ScienceX

Battery Storage Market Notes, September 2026 issue

Science X Inc. Published November 5, 2026

The price of electricity changes with the time of day. A "grid-scale battery" (a large battery connected to the power grid that stores electricity and releases it) earns money from that difference. These notes use published figures and our own records to show this month's trends in figures and tables. This issue is a back issue, prepared retroactively in November 2026. The grid connection study figures are as of the date it was prepared (October 19, 2026).

1. Three ways a battery storage plant earns money (how to read these notes)

A battery storage plant (grid-scale battery) earns income from three markets. ① Wholesale power (JEPX) is the market where you buy and store electricity when it is cheap and sell it when it is expensive. ② The balancing market (EPRX) is the market where you sell grid operators the "capability" to correct surpluses or shortages of electricity. ③ The capacity market (OCCTO) is the market where the country buys future electricity supply capacity in advance. These notes present figures for these three markets in this order. The ①②③ at the start of each section title shows which market it covers.

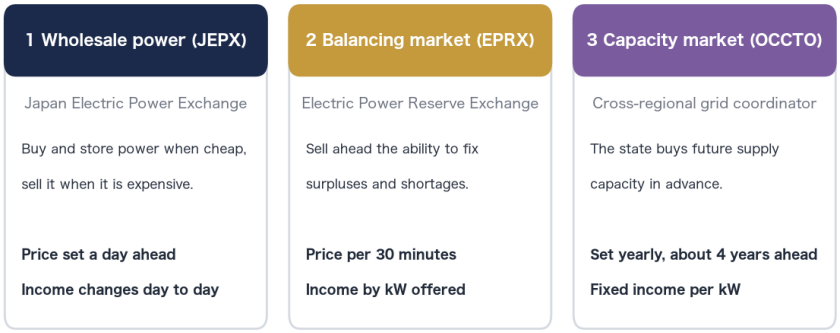


Figure 1 Three ways a battery storage plant earns money

Source: Rules of the Japan Electric Power Exchange (JEPX), the Electric Power Reserve Exchange (EPRX) and the Organization for Cross-regional Coordination of Transmission Operators (OCCTO).

2. Three trends this month

From the figures for the three markets, we picked three trends for this month.

- In wholesale power (JEPX), the monthly average spread between the most expensive 4 hours and the cheapest 4 hours in September 2026 is 13.42 yen/kWh in Tokyo and 15.17 yen/kWh in Kyushu.
- In the balancing market (EPRX), the bid ratio for Primary reserve (online) went above 100% in June 2026 (106.8%). This month it is 123.1%, and the average winning price is 3.43 yen/kW per 30 min.
- In the balancing market (EPRX), 56.9% of Tertiary reserve 2 revenue is concentrated in the top 10% of 30-minute slots.

3. ① Wholesale power (JEPX) | Average price

Wholesale power is electricity bought and sold between power companies and retailers. Its price is set on the "spot market" of the Japan Electric Power Exchange (JEPX), where electricity for the next day is traded the day before. "System (nationwide)" is the price when all of Japan is treated as one market (the system price). When the power lines between regions are congested, prices split by area from Hokkaido to Kyushu (area prices).

The average wholesale price in September 2026 is 19.12 yen/kWh for System (nationwide), against 11.62 yen/kWh in the same month last year (a difference of 7.50 yen).



Figure 2 Average wholesale price (yen/kWh). Navy is September 2026, grey is the same month last year

Source: Spot market trading results published by the Japan Electric Power Exchange (JEPX). Simple average of 30-minute prices. Our own count.

4. ① Wholesale power (JEPX) | How the price moves through the day

The wholesale price changes every 30 minutes. The figure shows the shape of one day, averaging the price at the same time across the month. If a battery charges when power is cheap and discharges when it is expensive, the difference becomes the battery's income.

The cheapest and most expensive times of day for wholesale power are, in Tokyo, around 1:00 at 19.23 yen and around 16:30 at 30.77 yen, and in Kyushu, around 12:00 at 9.61 yen and around 17:30 at 23.75 yen.

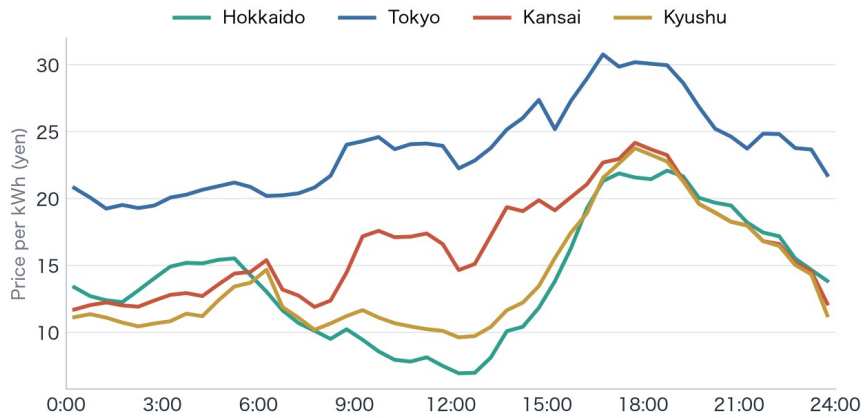


Figure 3 Daily peaks and troughs of the wholesale price (September 2026 average, yen/kWh)

Source: JEPX spot market. Our own count.

5. ① Wholesale power (JEPX) | How large is the spread per kWh

We took the average price of the day's most expensive 4 hours, subtracted the average price of the cheapest 4 hours, and show the monthly average by area. This equals the difference per kWh if you buy 1 kWh in the cheapest 4 hours and sell it in the most expensive 4 hours. It is a simple difference. It does not deduct power lost in charging and discharging or fees, and it ignores the order of the cheap and expensive hours.

By area, the largest monthly average spread between the most expensive 4 hours and the cheapest 4 hours is in Tohoku at 19.11 yen/kWh, and the smallest is in Tokyo at 13.42 yen/kWh.

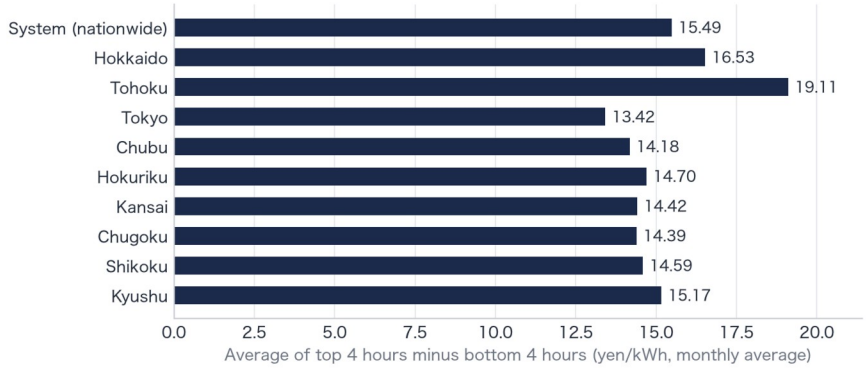


Figure 4 Wholesale price spread: average of the most expensive 4 hours − average of the cheapest 4 hours (September 2026, yen/kWh, monthly average)

Source: JEPX spot market. Our own count.

Area	2-hour spread (yen/kWh)	4-hour spread (yen/kWh)	Days with a 4-hour spread of 10 yen or more
System (nationwide)	17.16	15.49	28
Hokkaido	18.36	16.53	25
Tohoku	21.00	19.11	27
Tokyo	15.23	13.42	24
Chubu	15.99	14.18	25
Hokuriku	16.35	14.70	19
Kansai	16.22	14.42	19
Chugoku	16.31	14.39	20
Shikoku	16.87	14.59	22
Kyushu	16.87	15.17	19

The spread is the monthly average of the daily spreads. September 2026 covers 30 days.

6. ① Wholesale power (JEPX) | There is a spread every day

We show the same 4-hour spread day by day. The larger the spread on a day, the more room a battery has to earn from it.

For System (nationwide), the 4-hour wholesale spread was 10 yen or more on 28 of 30 days. By area, Tohoku had the most such days (27), and Hokuriku, Kansai and Kyushu had the fewest (19).

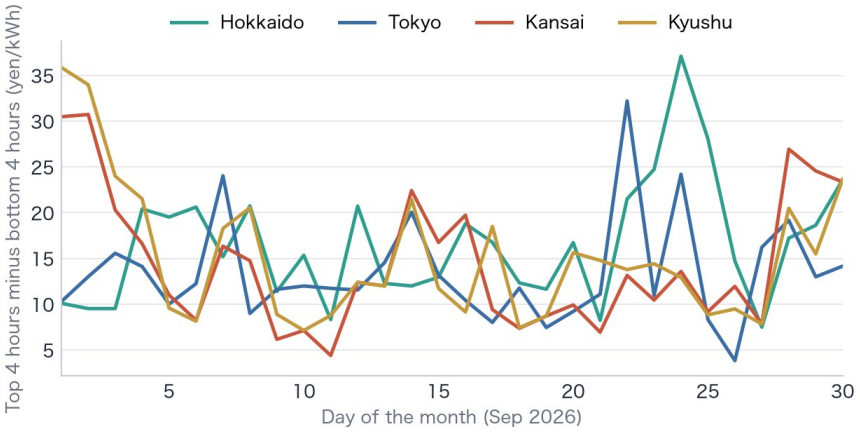


Figure 5 Daily wholesale price spread (average of the day's most expensive 4 hours − average of the cheapest 4 hours, yen/kWh)

Source: JEPX spot market. Our own count.

7. ② Balancing market (EPRX) | Seven products and prices by area

The balancing market is where grid operators buy, every 30 minutes, the "capability" to correct surpluses or shortages of electricity. Products are divided by how fast output must change after an instruction. Primary reserve is the fastest and Tertiary reserve 2 is the slowest. Primary reserve has two categories: "online", connected to the grid operator by a dedicated line, and "offline", operated through the simplified dispatch system without a dedicated line. They are tendered and traded separately, so we show them separately. A Composite product is a bid that offers several products together. Prices are set in yen per 1 kW of capability per 30 min. The figure shows the range of winning prices by area (by area where the power source is located). The thin line runs from the month's cheapest winning bid to its most expensive, the thick band is the price range that holds 8 of every 10 slots with awards, and the dot is the average winning price. Nationwide figures are in the tables in the "Market figures" section.

By area where the power source is located, the highest average winning price in the balancing market is Primary reserve (offline) in Tohoku at 9.51 yen/kW per 30 min, and the lowest is Tertiary reserve 2 in Shikoku at 0.38 yen/kW per 30 min.

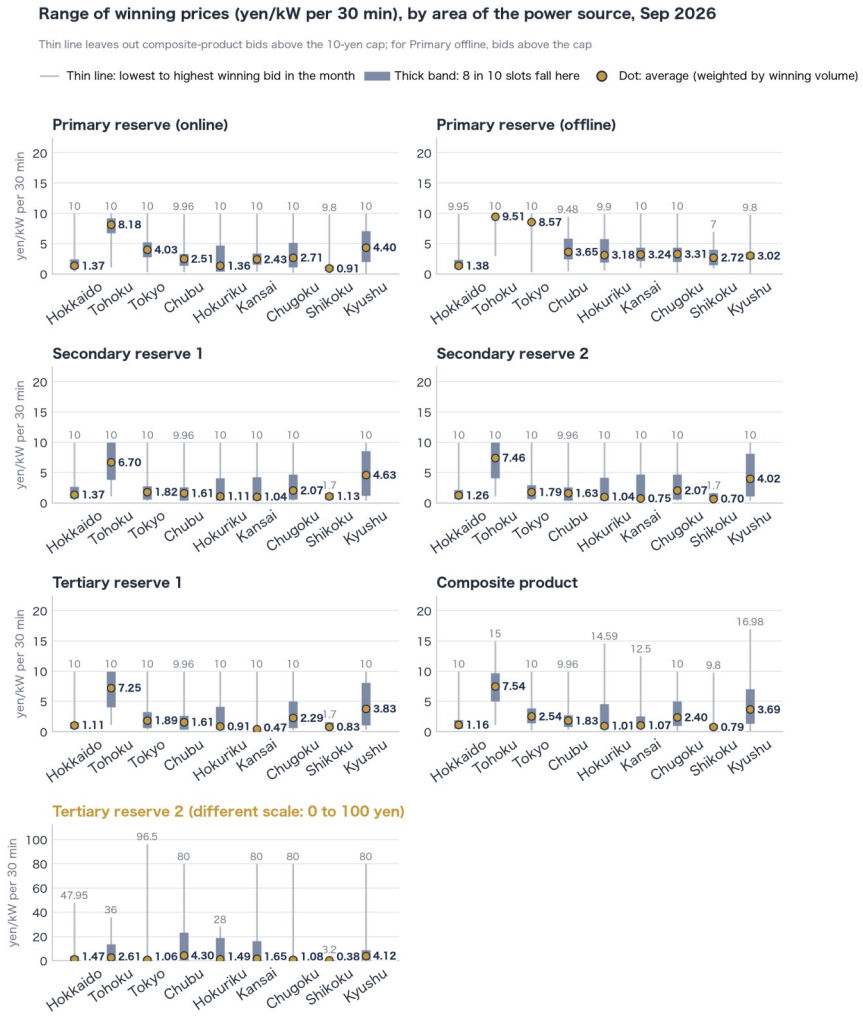


Figure 6 Range and average of winning prices by area in the balancing market (September 2026 (days 1–29), by area where the power source is located)

Source: Trading results (preliminary figures) published by the Electric Power Reserve Exchange (EPRX). Our own count.

Product	Time from instruction to output change	Duration
Primary reserve (online)	Within 10 seconds	5 minutes or more
Primary reserve (offline)	Within 10 seconds	5 minutes or more
Secondary reserve 1	Within 5 minutes	30 minutes
Secondary reserve 2	Within 5 minutes	30 minutes
Tertiary reserve 1	Within 15 minutes	30 minutes
Tertiary reserve 2	Within 60 minutes	30 minutes
Composite product	Requirements of the combined products	Requirements of the combined products

8. ② Balancing market (EPRX) | Grid areas and times where bids win more easily

The award rate is the share of the bid volume that was awarded. The higher it is, the more likely a bid is to win. The figure shows the award rate for each product by time of day (every 30 minutes), for each grid area (area where the power source is located). Where a line breaks, there were no bids at that time.

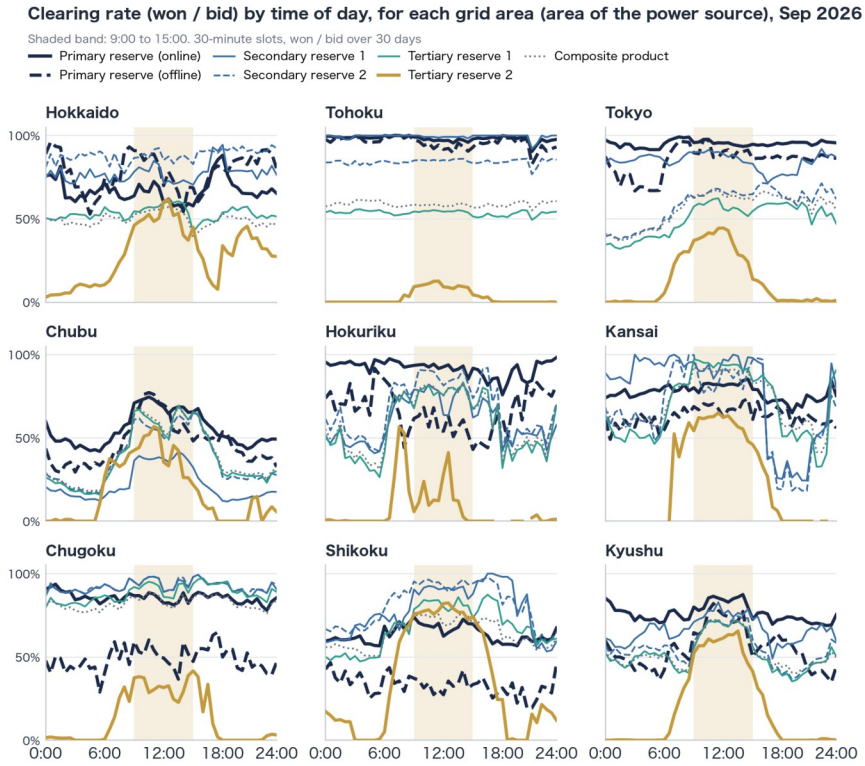


Figure 7 Balancing market award rate (grid area (area where the power source is located) × time of day, September 2026 (days 1–29))

Source: Trading results (preliminary figures) published by the Electric Power Reserve Exchange (EPRX). Our own count.

9. ② Balancing market (EPRX) | Primary reserve (online) became a contest for seats

Primary reserve is the fastest product: output must change within 10 seconds of an instruction. Batteries are often used for it. The left side is the online category and the right side the offline category. The bars are the bid ratio (bid volume ÷ volume the grid operators sought). Above 100%, more bids arrive than are sought, and some bids lose. The line is the average winning price. The figures are monthly, from April 2025, as far as our data goes. Primary reserve (offline) figures start in April 2026.

In the balancing market, the bid ratio for Primary reserve (online) went above 100% in June and is 123.1% this month, and for Primary reserve (offline) it is 84.0%. Their average winning prices are 3.43 and 5.79 yen/kW per 30 min.

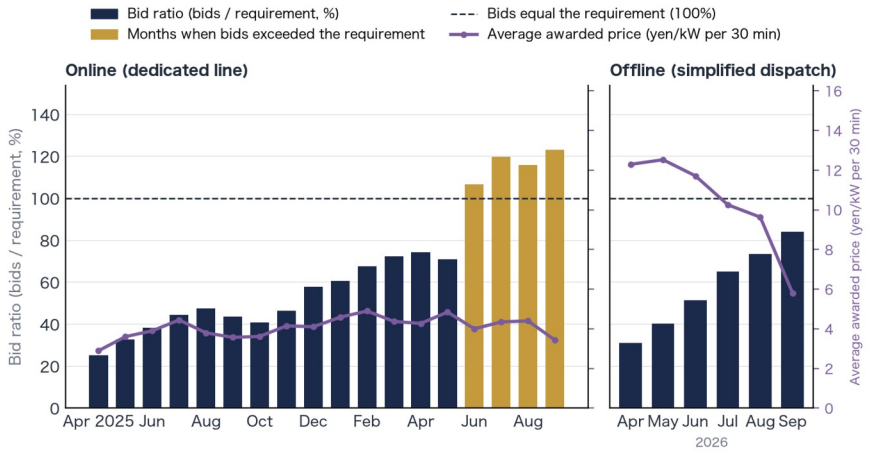


Figure 8 Primary reserve bid ratio (bars) and average winning price (line) (monthly; left is online, right is offline; gold bars are months when bids exceeded the volume sought)

Source: Trading results (preliminary figures) published by the Electric Power Reserve Exchange (EPRX). Our own count.

10. ② Balancing market (EPRX) | How each product's price has moved

These are the average winning prices for each product since April 2025 (monthly averages weighted by awarded volume). Primary reserve (offline) figures start in April 2026. From March 14, 2026, Primary through Tertiary reserve 1 and the Composite product changed from trading in 3-hour blocks to trading every 30 minutes (Tertiary reserve 2 was already every 30 minutes).

In the balancing market, the average winning price for Primary reserve (online) went from 2.89 yen in April 2025 to 3.43 yen this month. The highest was 4.90 yen in February 2026 (yen/kW per 30 min).

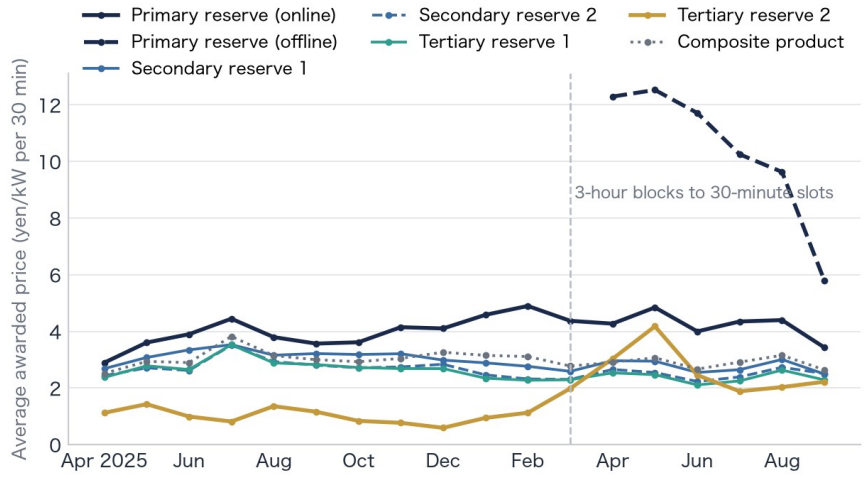


Figure 9 Average winning price by product in the balancing market (yen/kW per 30 min, monthly)

Source: Trading results (preliminary figures) published by the Electric Power Reserve Exchange (EPRX). Our own count.

11. ② Balancing market (EPRX) | Which hours of the day are expensive

These are the hourly average winning prices for each product in September 2026 (days 1–29).

In the balancing market, the average winning price for Primary reserve (online) is highest around 18:00 at 4.09 yen and lowest around 0:00 at 2.75 yen (yen/kW per 30 min).

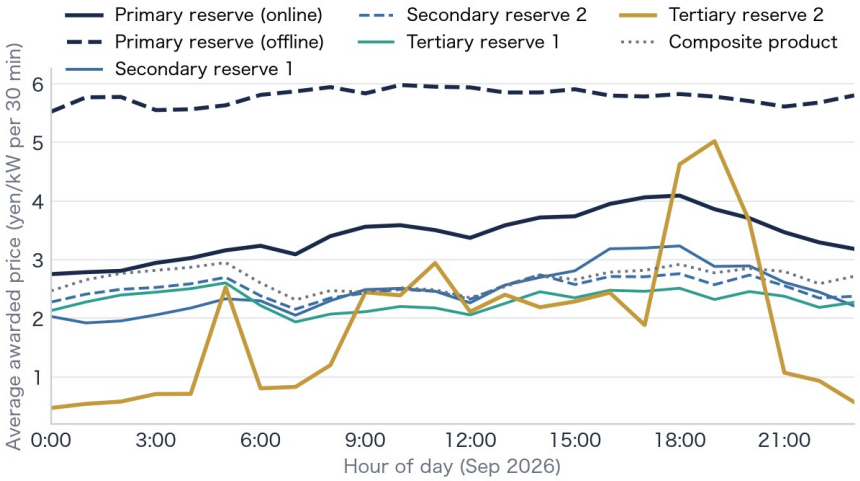


Figure 10 Average winning price by time of day in the balancing market (September 2026 (days 1–29), yen/kW per 30 min)

Source: Trading results (preliminary figures) published by the Electric Power Reserve Exchange (EPRX). Our own count.

12. ② Balancing market (EPRX) | In which products are batteries used

The figure shows the share of awarded volume taken by batteries. The table compares the average winning price of the volume awarded to batteries with the average winning price for the whole product.

In the balancing market, batteries have a 27.9% share of Primary reserve (online). The average winning price of the volume awarded to batteries is 5.17 yen, against 3.43 yen overall (yen/kW per 30 min).

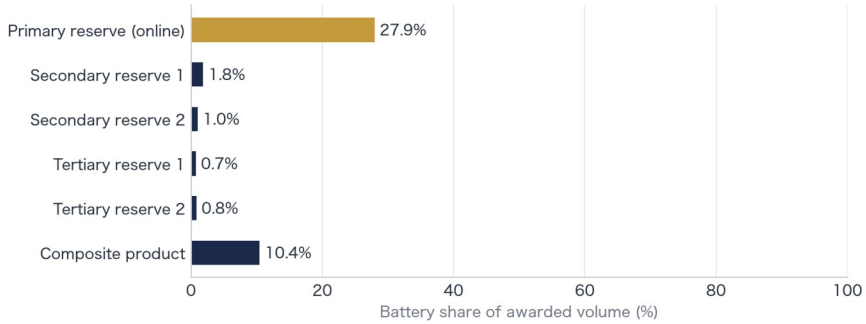


Figure 11 Share of batteries in the balancing market (%)

Source: Trading results (preliminary figures) by power source type published by the Electric Power Reserve Exchange (EPRX). Our own count.

Product	Awarded to batteries (yen/kW per 30 min)	Whole product (yen/kW per 30 min)
Primary reserve (online)	5.17	3.43
Secondary reserve 1	2.18	2.49
Secondary reserve 2	1.85	2.51
Tertiary reserve 1	1.86	2.28
Tertiary reserve 2	59.26	2.22
Composite product	5.13	2.64

Both are averages weighted by awarded volume (September 2026, preliminary figures, nationwide). Batteries make up only 0.8% of the awarded volume in Tertiary reserve 2, and much of it was won in high-price slots, so their average comes out high. Primary reserve (offline) is not in this table or the figure, because we do not include its published figures by power source type in our count.

13. ② Balancing market (EPRX) | Revenue is concentrated in a very few slots

We ranked the month's 30-minute slots with awards by revenue (average winning price × awarded volume, nationwide), from highest to lowest, and plotted for each product what % of the month's revenue the top slots take. The more the curve bulges above the dotted line, the more revenue is concentrated in a few slots. Tertiary reserve 2 is a product that covers errors in forecasting renewable output due to weather. Its price is low in most slots and high in a very few.

In the balancing market, the share of revenue in the top 10% of slots is 56.9% for Tertiary reserve 2 and 15.8% for Primary reserve (online). For the top 5%, it is 36.9% and 8.6%.

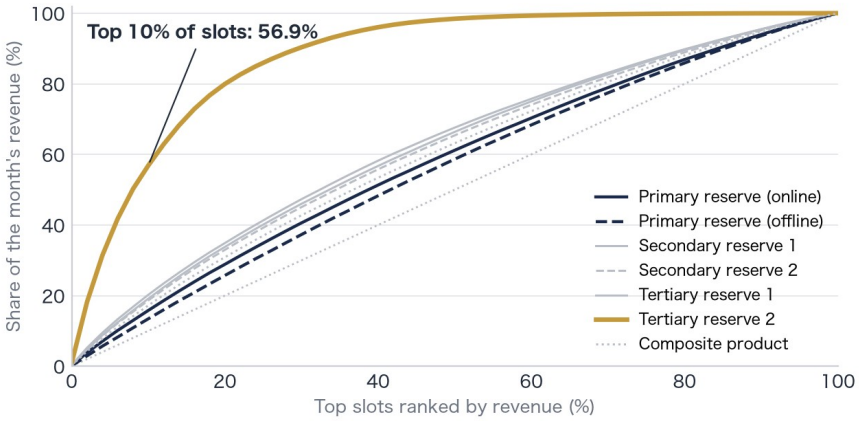


Figure 12 Share of balancing market revenue concentrated in the top slots (September 2026 (days 1–29), nationwide)

Source: Trading results (preliminary figures) published by the Electric Power Reserve Exchange (EPRX). Our own count.

In September 2026, of the 1,194 slots with awards, the top 1% by revenue (average winning price × awarded volume) took 9.4% of the month's revenue. There were 25 slots with a nationwide average winning price of 10 yen/kW per 30 min or more, and 198 slots with no awards.

Slots with the highest maximum winning prices (by area where the power source is located):

Day	Time	Area	Maximum winning price (yen/kW per 30 min)
September 8	9:30	Tokyo	96.50
September 8	10:30	Tokyo	96.50
September 8	11:00	Tokyo	96.50
September 27	11:00	Tokyo	96.00
September 27	11:30	Tokyo	96.00

Source: Tertiary reserve 2 trading results (preliminary figures) published by the Electric Power Reserve Exchange (EPRX). Our own count.

14. ③ Capacity market (OCCTO) | A market that buys future supply capacity

The capacity market buys electricity supply capacity 4 years ahead through an auction held once a year. The price is set in yen per kW for one year. The left figure shows the clearing prices of past main auctions. The right figure shows the battery and pumped hydro capacity contracted in the Long-Term Decarbonization Power Source Auction (a separate auction that supports new builds such as batteries and pumped hydro). These are published once a year, so they do not change every month. The latest is delivery fiscal year FY2029 (published January 2026).

The capacity market clearing price (Tokyo) is 14,137 yen/kW for delivery FY2024 and 15,111 yen/kW for FY2029. In the FY2025 round of the Long-Term Decarbonization Power Source Auction, batteries and pumped hydro cleared 819 MW of lithium-ion and 886 MW of non-lithium. Both are the latest annual publication.

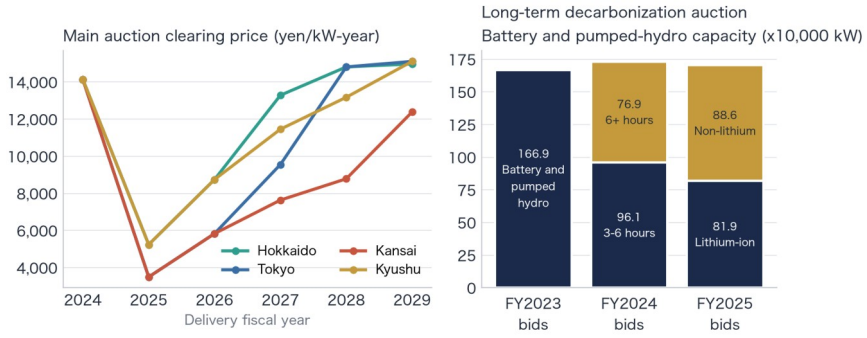


Figure 13 Capacity market clearing prices (left, yen/kW) and contracted battery and pumped hydro capacity in the Long-Term Decarbonization Power Source Auction (right, in units of 10,000 kW)

Source: Clearing results and capacity contract documents published by the Organization for Cross-regional Coordination of Transmission Operators (OCCTO) (sources listed in the last section (Assumptions and terms)). As published.

15. Our records | Where battery storage projects are increasing

We counted the projects newly listed this month in our DealRoom (our data room for buyers, where we list battery storage projects), by grid area. These are figures for projects we handled, not counts for the whole market. Transfer of rights is a sale that hands over the land and grid rights. Completed-build handover is a sale that hands over the facility once it is built.

In September 2026, our DealRoom added 33 new listings totaling 482.4 MW. By grid area, Tokyo had the most listings (11) and Chubu the most MW (111.6 MW).

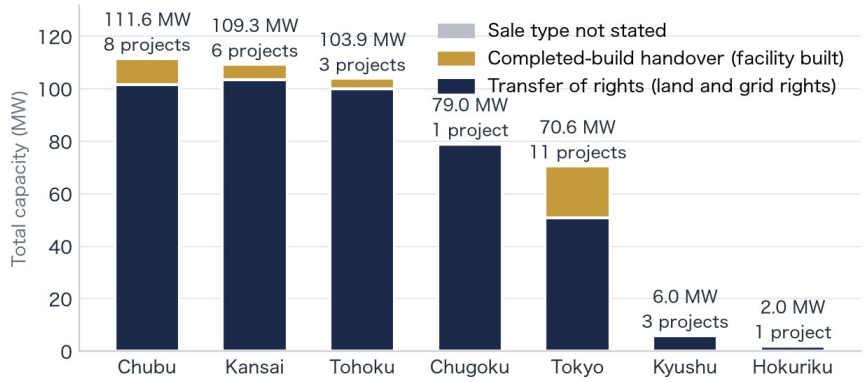


Figure 14 Output (MW) of projects we listed in our DealRoom in September 2026

Source: Our DealRoom records (project locations are given only down to grid area; prices and parties are not shown).

16. Our records | How many months and how much it costs to connect to the grid

A grid connection study is the procedure of asking the grid operator to check "can we connect at this site, and how much will the work cost?" The grid connection cost contribution is the part of the connection work cost paid by the applicant. Of the response documents we received, we counted only high-voltage ones (connections to 6,600 V distribution lines), by grid area. Extra-high voltage is not included. Grid areas with fewer than 5 cases are not shown.

The medians of grid connection study responses (high voltage only, as of October 19, 2026) range from 8.0 months in Tokyo to 17.0 months in Tohoku for the construction period, and from ¥3.02 million in Tokyo to ¥32.35 million in Tohoku for the grid connection cost contribution.

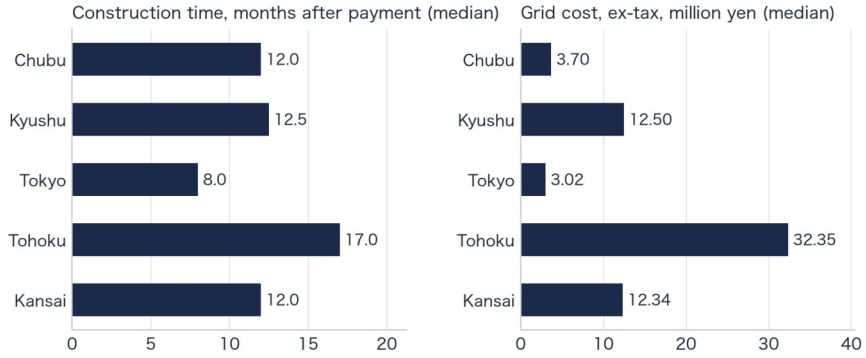


Figure 15 Median grid connection study responses (high voltage) by grid area (left: months of construction, right: grid connection cost contribution, excluding tax)

Source: Our count of the high-voltage grid connection study responses we received from grid operators (as of October 19, 2026).

17. Market figures (tables ready to use in your materials)

We put the figures behind the charts into tables you can use in your own materials: ① wholesale power (JEPX) figures by area and trading volume, ② nationwide balancing market figures by product (bid ratio, award rate, price, battery share), and ③ capacity market clearing prices.

Wholesale power, JEPX spot market (September 2026, by area, yen/kWh)

Area	Monthly average	Same month last year	Daytime (8:00–16:00)	Evening (16:00–20:00)	4-hour spread	Maximum	Slots at 30 yen or more	Slots at 0.01 yen
System (nationwide)	19.12	11.62	17.53	26.58	15.49	49.00	106	0
Hokkaido	14.01	12.14	9.59	21.15	16.53	50.01	30	56
Tohoku	17.35	11.33	11.48	26.21	19.11	50.01	90	16
Tokyo	23.78	12.92	24.38	29.40	13.42	50.01	265	0
Chubu	23.77	11.96	24.03	30.03	14.18	53.20	316	0
Hokuriku	16.88	11.26	18.30	22.55	14.70	53.20	164	0
Kansai	16.45	11.26	17.14	22.34	14.42	53.20	130	5
Chugoku	14.96	10.57	13.10	21.71	14.39	53.20	87	22
Shikoku	12.92	9.62	11.15	18.32	14.59	53.20	78	61
Kyushu	14.06	10.54	11.63	21.71	15.17	53.20	79	45

Trading volume (September 2026, total of 30 days): total cleared volume 32,413 million kWh (same month last year 24,757 million kWh), sell bids 51,279 million kWh, buy bids 40,562 million kWh.

Source: Spot market trading results published by the Japan Electric Power Exchange (JEPX). Prices are simple averages of 30-minute slots. Our own count.

Balancing market (September 2026, preliminary figures, nationwide)

Product	Volume sought (MW)	Bids (MW)	Awarded (MW)	Bid ratio (bids ÷ sought)	Award rate (awarded ÷ bids)	Average winning price (yen/kW per 30 min)	Battery share
Primary reserve (online)	1,388.7	1,710.0	1,337.3	123.1%	78.2%	3.43	27.9%
Primary reserve (offline)	497.8	418.4	265.7	84.0%	63.5%	5.79	—
Secondary	962.6	1,996.2	1,102.3	207.4%	55.2%	2.49	1.8%

© Science X Inc. · https://www.scix.co.jp

Product	Volume sought (MW)	Bids (MW)	Awarded (MW)	Bid ratio (bids ÷ sought)	Award rate (awarded ÷ bids)	Average winning price (yen/kW per 30 min)	Battery share
reserve 1							
Secondary reserve 2	983.1	3,709.3	2,163.2	377.3%	58.3%	2.51	1.0%
Tertiary reserve 1	2,498.5	5,895.9	3,021.0	236.0%	51.2%	2.28	0.7%
Tertiary reserve 2	376.3	1,371.7	368.9	364.5%	26.9%	2.22	0.8%
Composite product	3,383.8	6,641.4	3,623.5	196.3%	54.6%	2.64	10.4%

Volumes are averages per 30-minute slot. A product with a bid ratio below 100% did not receive enough bids for the volume sought. The award rate is the share of the bid volume that was awarded. The battery share for Primary reserve (offline) is "—" because we do not include its published figures by power source type in our count.

Source: Trading results (preliminary figures) and trading results by power source type published by the Electric Power Reserve Exchange (EPRX). Our own count.

Capacity market main auction area prices (yen/kW per year)

Delivery fiscal year	Hokkaido	Tohoku	Tokyo	Chubu	Hokuriku	Kansai	Chugoku	Shikoku	Kyushu
FY2024	14,137	14,137	14,137	14,137	14,137	14,137	14,137	14,137	14,137
FY2025	5,242	3,495	3,495	3,495	3,495	3,495	3,495	3,495	5,242
FY2026	8,749	5,833	5,834	5,832	5,832	5,832	5,832	5,832	8,748
FY2027	13,287	9,044	9,555	7,823	7,638	7,638	7,638	7,638	11,457
FY2028	14,812	14,812	14,812	10,280	8,785	8,785	8,785	8,785	13,177
FY2029	14,972	15,111	15,111	12,388	12,388	12,388	12,388	12,388	15,112

Contracted battery and pumped hydro capacity in the Long-Term Decarbonization Power Source Auction (in units of 10,000 kW)

Auction round	Category	Contracted capacity (10,000 kW)
FY2023 round	Batteries and pumped hydro	166.9
FY2024 round	3–6 hours	96.1
FY2024 round	6 hours or more	76.9
FY2025 round	Lithium-ion	81.9
FY2025 round	Non-lithium	88.6

Source: Clearing results and capacity contract documents published by the Organization for Cross-regional Coordination of Transmission Operators (OCCTO) (sources listed in the last section (Assumptions and terms)). As published.

© Science X Inc. · https://www.scix.co.jp

18. Assumptions and terms

- The figures are our own counts based on the published values in the sources. We have not added up several months or converted anything to an annual figure. We do not show revenue amounts for any single battery storage plant.
- Months covered: wholesale power (JEPX) is September 2026 (30 days); the balancing market (EPRX) is September 2026 preliminary figures (delivery dates up to the 29th). For the balancing market, the month may differ until the published September 2026 figures are included in our count.
- Average prices are simple averages of 30-minute slots (not weighted by trading volume). Daytime is the 8:00–16:00 slots and evening the 16:00–20:00 slots.
- Spread: the day's 30-minute slots are ranked by price, and the average of the 8 cheapest slots is subtracted from the average of the 8 most expensive slots (4 hours) (4 slots for 2 hours). We do not take into account the order of the cheap and expensive hours, the power lost in charging and discharging, or fees, taxes and grid usage charges. These figures do not show actual earnings.
- Balancing market: nationwide figures (the total column) from EPRX preliminary data. Volume sought is by grid operator (TSO); bids, awarded volume and average winning price are by area where the power source is located. Volumes are averages per 30-minute slot. Average winning price is weighted by awarded volume. Bid ratio = bids ÷ volume sought; award rate = awarded volume ÷ bids. For the 3-hour blocks until March 13, 2026, we counted each block as six 30-minute slots.
- Price range: the thin line runs, among the month's slots with awards, from the lowest winning bid (minimum winning price) to the highest (maximum winning price) (published figures by area where the power source is located). The published figures for Primary reserve (online), Secondary reserve 1 and 2, and Tertiary reserve 1 also include Composite product bids (one price for several products together), so we removed from the thin line any bids above 10 yen that can be explained by a Composite product bid in the same slot and area. For Primary reserve (offline), we removed from the thin line bids above the price cap (10 yen this month) (the balancing market system also awards bids above the cap and cuts them down to the cap at settlement). The thick band is the range from 10% to 90% from the bottom when the average winning prices of slots with awards are ranked from low to high. The dot is the average weighted by awarded volume.
- Award rate by grid area × time of day: total awarded volume ÷ total bids for slots at the same time of day in the month (by area where the power source is located).
- The time from instruction to output change and the duration for each balancing market product are the FY2026 specifications. For Primary reserve, online is the category connected to the grid operator by a dedicated line, and offline is the category operated through the simplified dispatch system without a dedicated line.
- High-price slots for Tertiary reserve 2: slots with a nationwide average winning price of 10 yen/kW per 30 min or more. The top 1% are the top 1% of slots ranked by revenue (average winning price × awarded volume). The maximum winning price is the published figure by area where the power source is located.

Sources (OCCTO, capacity market clearing results): delivery FY2024 https://www.occto.or.jp/iinkai/youryou/kentoukai/2020/files/youryou_kentoukai_27_05.pdf / delivery FY2025 https://www.occto.or.jp/iinkai/youryou/kentoukai/2021/files/youryou_kentoukai_35_03_1.pdf / delivery FY2026 https://www.occto.or.jp/iinkai/youryou/kentoukai/2022/files/youryou_kentoukai_43_03.pdf / delivery FY2027 https://www.occto.or.jp/market-board/market/oshirase/2023/files/240124_mainauction_youryouyakujokekka_kouhyou_jitsujukyu2027.pdf / delivery FY2028 https://www.occto.or.jp/market-board/market/oshirase/2024/files/250129_mainauction_youryouyakujokekka_kouhyou_jitsujukyu2028.pdf / delivery FY2029 https://www.occto.or.jp/assets/news/capacity-market/260120_mainauction_youryouyakujokekka_kouhyou_jitsujukyu2029.pdf

Sources (OCCTO, Long-Term Decarbonization Power Source Auction): FY2023 round https://www.occto.or.jp/assets/260605_auction_keiyakujyoukyou_kouhyou.pdf / FY2024 round https://www.occto.or.jp/market-board/market/jitsujukyukanren/files/longauction_keiyakukekka_2024.pdf / FY2025 round https://www.occto.or.jp/assets/various/capacity-market/jitsujukyukanren/yoryokakuhokeiyaku/longauction_keiyakukekka_2025.pdf

- Capacity market clearing results for each delivery fiscal year are published in different years (FY2024 in 2020, FY2029 in January 2026). We do not show the number of battery projects in the Long-Term Decarbonization Power Source Auction, because it is not in the published summary tables.

Sources: Japan Electric Power Exchange (JEPX) spot market trading results / Electric Power Reserve Exchange (EPRX) trading results (preliminary figures) and trading results by power source type / Organization for Cross-regional Coordination of Transmission Operators (OCCTO) capacity market main auction clearing results and Long-Term Decarbonization Power Source Auction capacity contract documents / our count of the grid connection study responses we received / our DealRoom records.

Terms: system price (System, nationwide) = the wholesale price when all of Japan is treated as one market. Area price = the price that splits by area depending on congestion on the power lines. The grid = the power companies' transmission network. Grid connection = connecting to the transmission network. MW = the size of power output (1 MW = 1,000 kW). MWh = the amount of electricity that can be stored. yen/kWh = the price per 1 kWh of electricity.

© Science X Inc. · https://www.scix.co.jp

Science X Inc. https://www.scix.co.jp Contact: s@scix.co.jp

Newsletter "Japan grid-scale BESS: primary data":
https://www.linkedin.com/newsletters/7521830530569445376/

You may use the figures, tables and numbers if you cite the source (citation guide https://www.scix.co.jp/press).