


Wiring Diagram for PATTONPAK Condensing Unit with CS / ZR / ZB Series Three Phase Compressor

May 2020 Rev.0

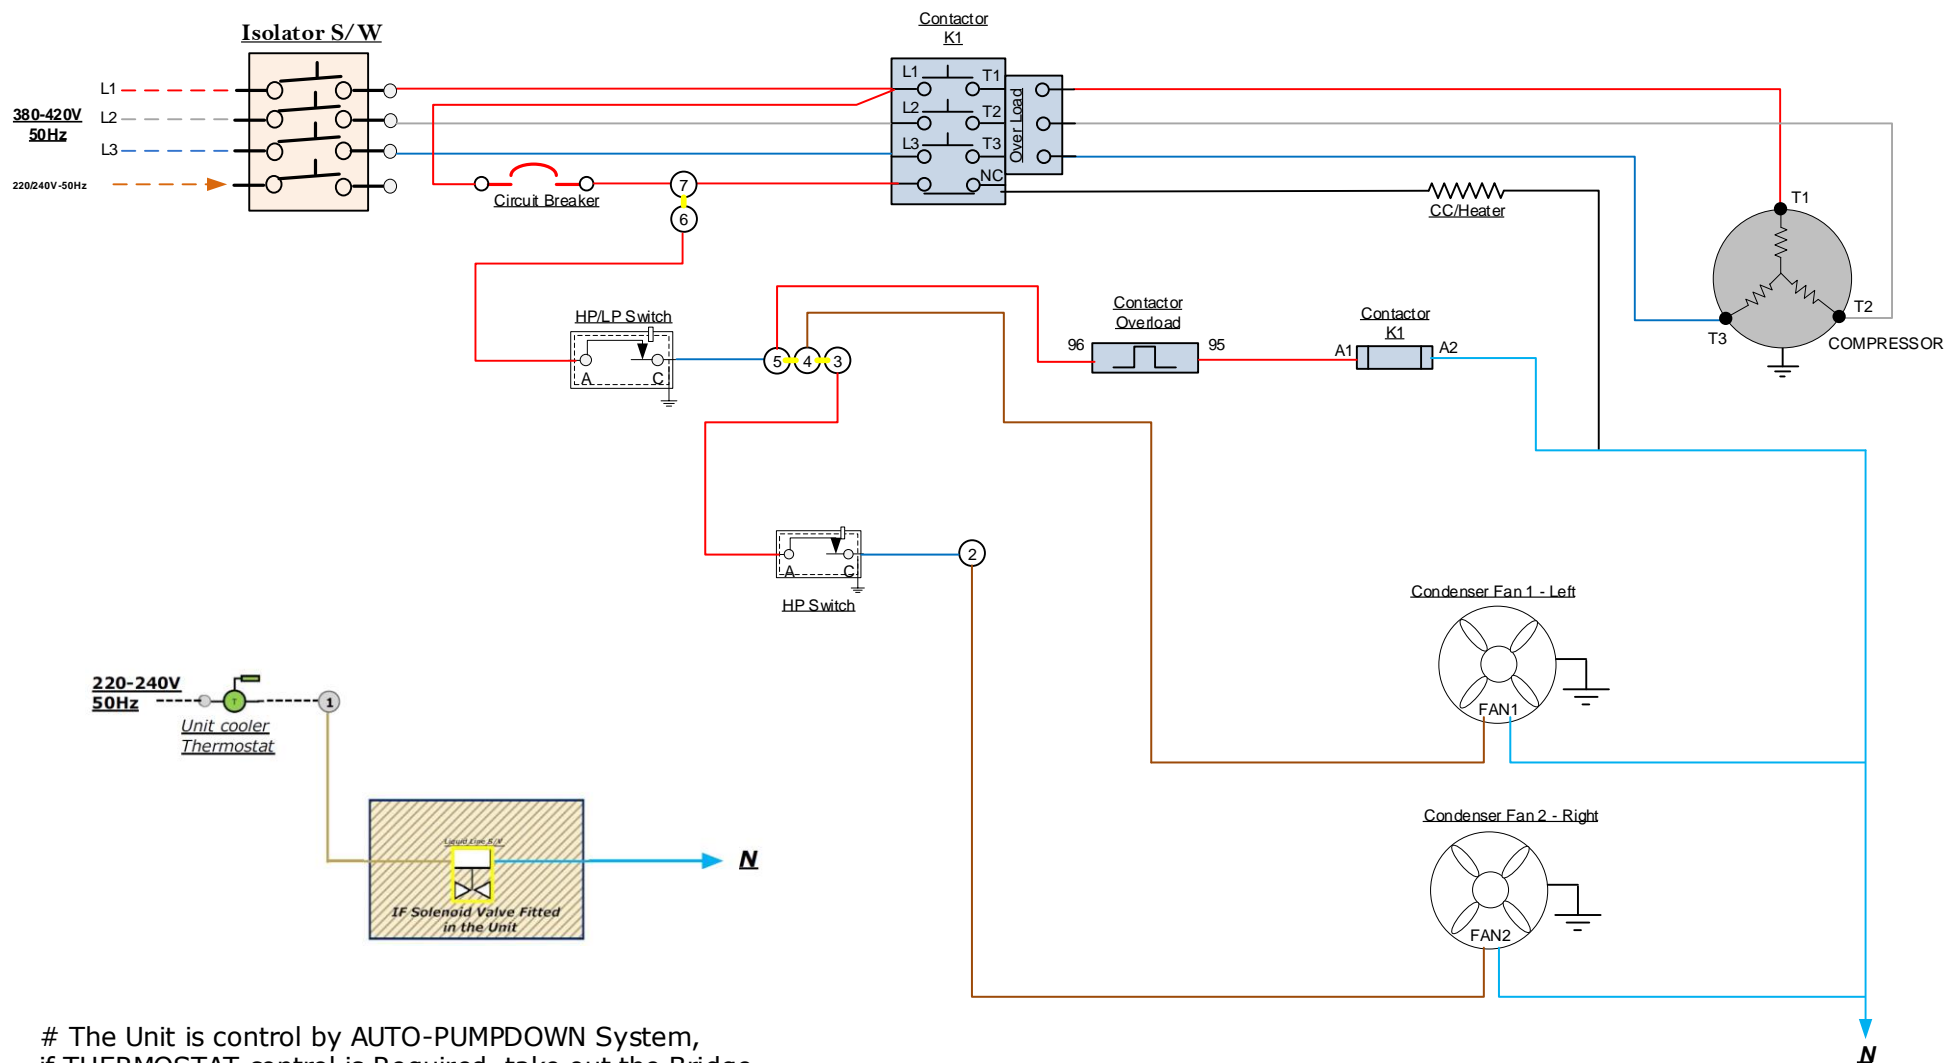

The Unit is control by AUTO-PUMPDOWN System, if THERMOSTAT control is Required, take out the Bridge between Terminal ⑥ and ⑦, then hooks up T/S wires there

Please NOTE . This Wiring Diagram has been prepared to provide application assistance and may not be used for claim against the COMPANY

U L tested to AS / NZS 60335.2.98 (appropriate to selected clauses)