


Wiring Diagram for PATTONPAK Condensing Unit with CS & NJ Series Single Phase Compressor

May 2020 Rev.0

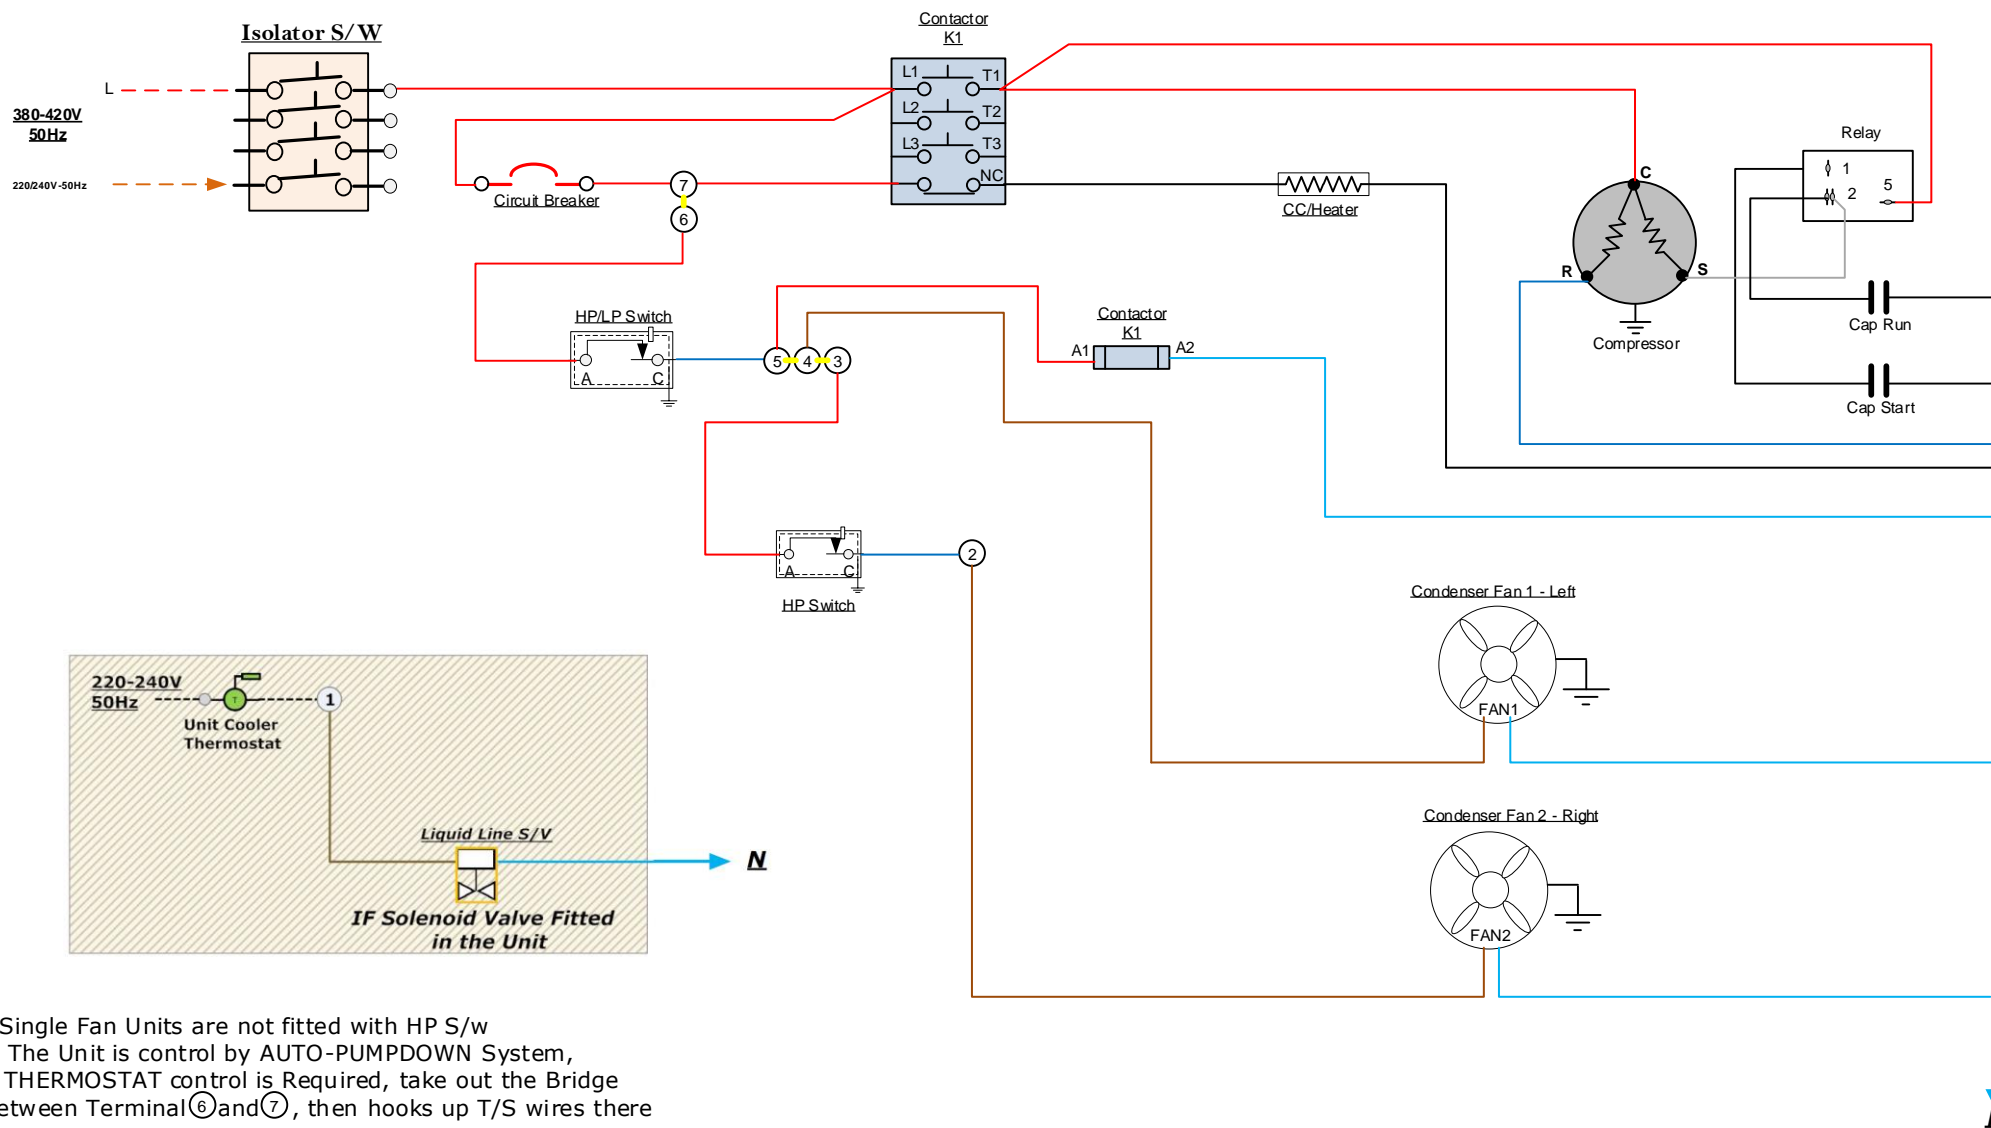

Single Fan Units are not fitted with HP S/w
 # The Unit is control by AUTO-PUMPDOWN System,
 if THERMOSTAT control is Required, take out the Bridge
 between Terminal⑥and⑦, then hooks up T/S wires there

EMBRACO NJ Series Compressors are not fitted with Crankcase Heater
 # UL tested to AS / NZS 60335.2.98 (appropriate to selected clauses)

Please NOTE . This Wiring Diagram has been prepared to provide application assistance and may not be used for claim against the COMPANY