

**Honeywell Logo for HPS Workstations
and Servers
Installation Instructions**

**HW13-100
51153633-005
Rev A
02/2008**

Notices and Trademarks

**Copyright 2008 by Honeywell International Inc.
Rev A – February 19, 2008**

While this information is presented in good faith and believed to be accurate, Honeywell disclaims the implied warranties of merchantability and fitness for a particular purpose and makes no express warranties except as may be stated in its written agreement with and for its customers.

In no event is Honeywell liable to anyone for any indirect, special or consequential damages. The information and specifications in this document are subject to change without notice.

Honeywell, PlantScape, Experion PKS, Icon Series, and **TotalPlant** are registered trademarks of Honeywell International Inc.

Other brand or product names are trademarks of their respective owners.

Honeywell International

Process Solutions

2500 West Union Hills Drive

Phoenix, AZ 85027

1-800 223-8947

About This Document

This document covers Installation Instructions for placing the Honeywell Logo on all HPS workstations/servers.

Revision Notes

The following list provides notes concerning all revisions of this document.

Document Number	Revision	Revision Date	Revision Notes
HW13-100	A	02/19/08	New Release

References

Not applicable.

Support and Other Contacts

United States and Canada

Contact: Honeywell Solution Support Center
Phone: 1-800-822-7673 (outside Arizona)
602-313-5558 (in Arizona)
Calls are answered by dispatcher between 6:00 am and 4:00 pm
Mountain Standard Time. Emergency calls outside normal working hours
are received by an answering service and returned within one hour.
Fascimile: 602-313-3293
Mail: Honeywell TAC, MS P13
2500 West Union Hills Drive
Phoenix, AZ, 85027

Europe

Contact: Honeywell TAC-EMEA
Phone: +32-2-728-2732
Fascimile: +32-2-728-2696
Mail: TAC-BE02
Hermes Plaza
Hermeslaan, 1H
B-1831 Diegem, Belgium

Pacific

Contact: Honeywell Global TAC – Pacific
Phone: 1300-300-4822 (toll free within Australia)
+61-8-9362-9559 (outside Australia)
Fascimile: +61-8-9362-9564
Mail: Honeywell Limited Australia
5 Kitchener Way
Burswood 6100, Western Australia
Email: GTAC@honeywell.com

India

Contact: Honeywell Global TAC – India
Phone: +91-20- 6603-9400
Fascimile: +91-20- 6603-9800
Mail: Honeywell Automation India Ltd
56 and 57, Hadapsar Industrial Estate
Hadapsar, Pune –411 013, India
Email: Global-TAC-India@honeywell.com

Korea

Contact: Honeywell Global TAC – Korea
Phone: +82-2-799-6317
+82-11-9227-6324
Fascimile: +82-2-792-9015
Mail: Honeywell Co., Ltd
17F, Kikje Center B/D,
191, Hangangro-2Ga
Yongsan-gu, Seoul, 140-702, Korea
Email: Global-TAC-Korea@honeywell.com

People's Republic of China

Contact: Honeywell Global TAC – China
Phone: +86- 21-5257-4568
Mail: Honeywell (China) Co., Ltd
33/F, Tower A, City Center, 100 Zunyi Rd.
Shanghai 200051, People's Republic of China
Email: Global-TAC-China@honeywell.com

Singapore

Contact: Honeywell Global TAC – South East Asia
Phone: +65-6580-3500
Fascimile: +65-6580-3501
+65-6445-3033
Mail: Honeywell Private Limited
Honeywell Building
17, Changi Business Park Central 1
Singapore 486073
Email: GTAC-SEA@honeywell.com

Taiwan

Contact: Honeywell Global TAC – Taiwan
Phone: +886-7-536-2567
Fascimile: +886-7-536-2039
Mail: Honeywell Taiwan Ltd.
17F-1, No. 260, Jhongshan 2nd Road.
Cianjhen District
Kaohsiung, Taiwan, ROC
Email: Global-TAC-Taiwan@honeywell.com

Japan

Contact: Honeywell Global TAC – Japan
Phone: +81-3-6730-7160
Facsimile: +81-3-6730-7228
Mail: Honeywell Japan Inc.
New Pier Takeshiba, South Tower Building,
20th Floor, 1-16-1 Kaigan, Minato-ku,
Tokyo 105-0022, Japan
Email: Global-TAC-JapanJA25@honeywell.com

Elsewhere

Call your nearest Honeywell office.

World Wide Web

Honeywell Solution Support Online:

<http://www.honeywell.com/ps>

Training Classes

Honeywell Automation College:

<http://www.automationcollege.com>

Symbol Definitions

Not applicable.

This page intentionally left blank.

Contents

- 1. INTRODUCTION 9
 - 1.1 Overview 9
 - Description 9
 - Guidelines 9
 - Apply logo to workstation or server 9

FIGURES

Figure 1-1 Front View of WS490 and T5400-based Honeywell Workstation	10
Figure 1-2 Front View of PE SC1430-based Honeywell Server	11
Figure 1-3 Front View of PE 2900 and 2900III-based Honeywell Server	12
Figure 1-4 Front View of PE 2950 and 2950III-based Honeywell Server	12

1. INTRODUCTION

1.1 Overview

Description

This document directs the Customer or System Integrator on the proper placement of a Honeywell logo to their HPS workstation or server if one is not already there. Honeywell strongly recommends placing the Honeywell logo for the following reasons:

- To provide notice to the Original Manufacturer's service personnel that this HPS workstation or server is not to be reconfigured (for example, BIOS, memory) in any way inconsistent with this document.
- To distinguish those HPS workstations/servers covered by Honeywell warranty from all others.

Guidelines

Since workstations/servers can change rapidly and are sourced from different suppliers and facilities it is impossible to cover all possibilities. Placing the Honeywell logo on a workstation or server will vary depending on shape and design of the workstation or server. Below is a list of guidelines to follow:

- Avoid unnecessarily blocking of ventilation holes when applying the logo.
- Apply the Honeywell logo as closely to the appearance of the figures below.
- Apply the Honeywell logo in a consistent and quality manner by maintaining recurring records of any deviation from this document and applying such deviations consistently as workstations/servers are processed.
- Forward such deviations to TAC or thru a Honeywell field representative so this document may be updated accordingly.

Apply logo to workstation or server

Use the following procedure to apply the Honeywell logo to your HPS workstation or server.

Step	Action	✓
1	Remove the adhesive tape from the back of the Honeywell logo (51303800-500).	
2	Place the Honeywell logo on the front of the HPS workstation or server according to the guidelines above and the figures below.	



Figure 1-1 Front View of WS490 and T5400-based Honeywell Workstation

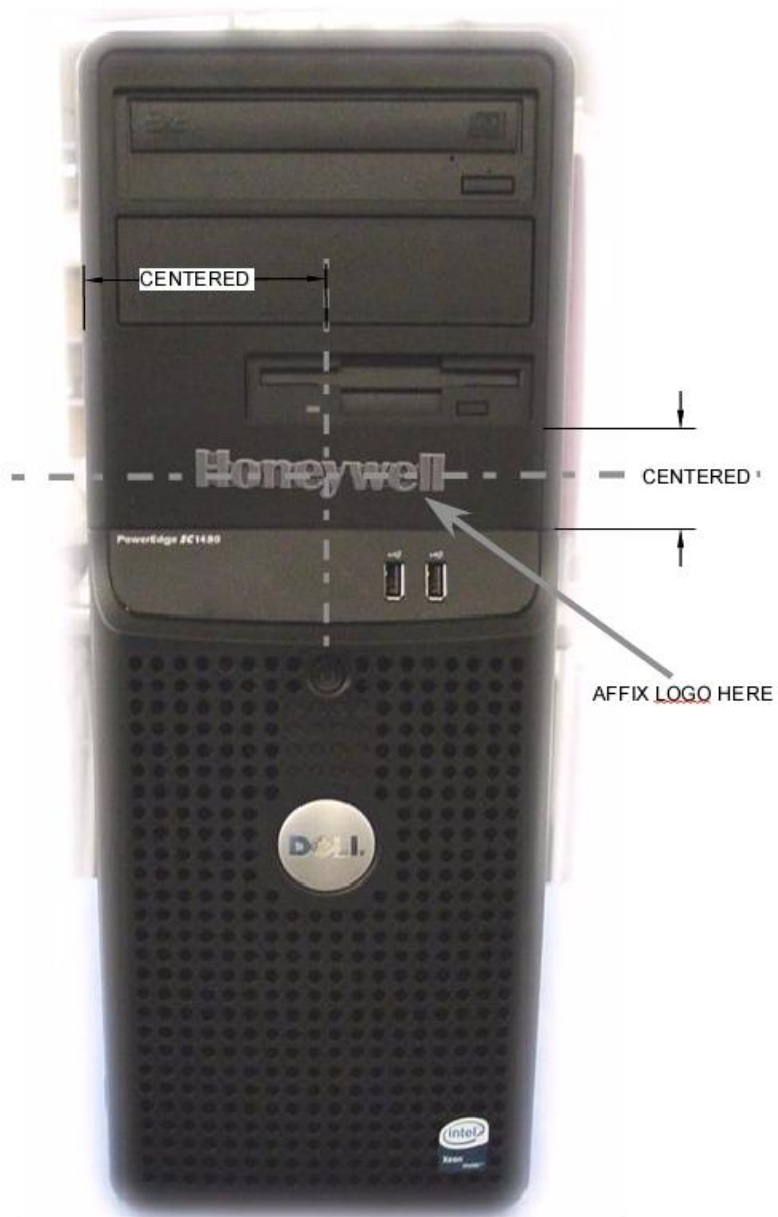


Figure 1-2 Front View of PE SC1430-based Honeywell Server

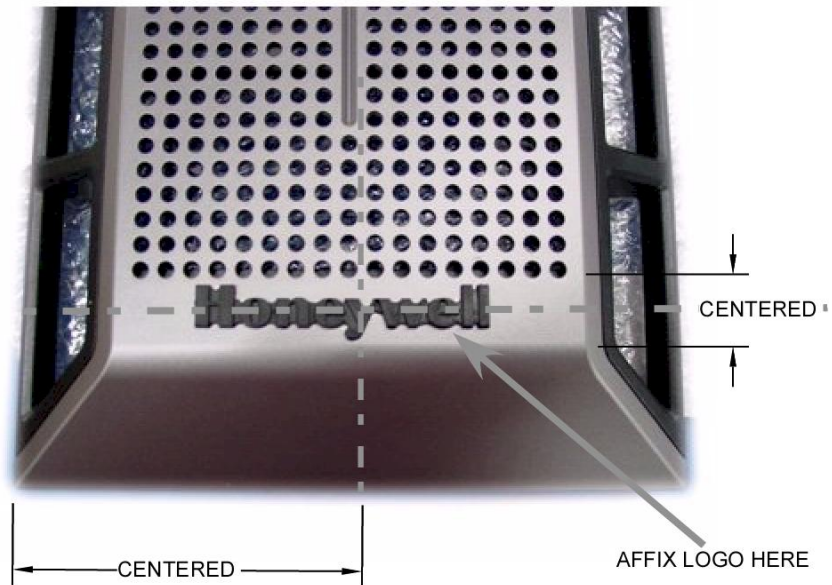


Figure 1-3 Front View of PE 2900 and 2900III-based Honeywell Server

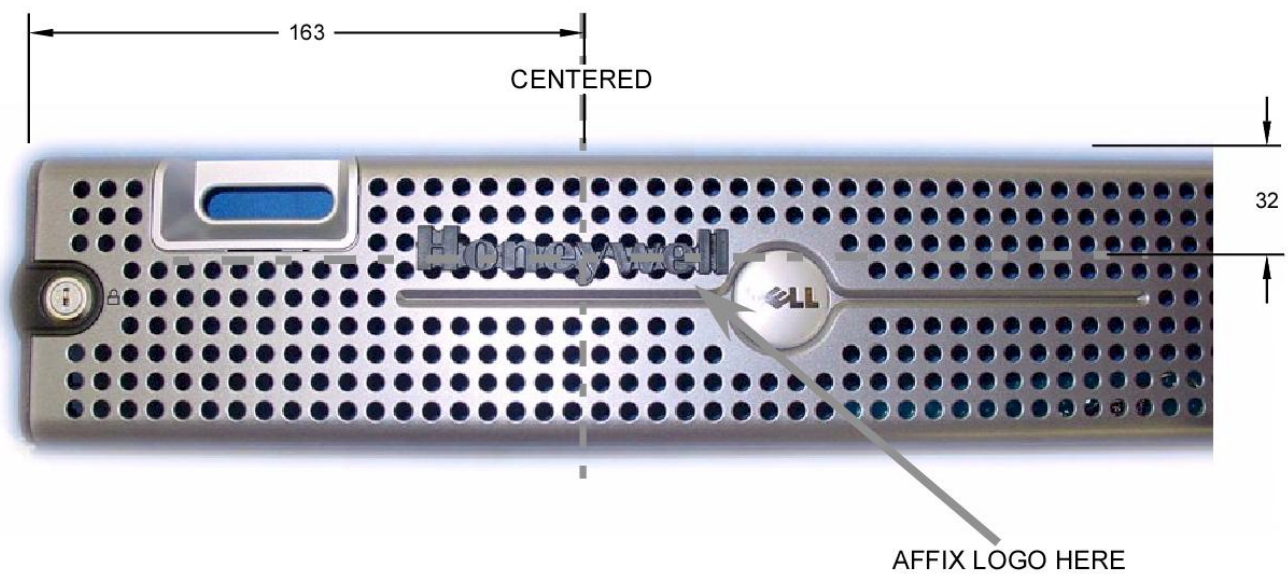


Figure 1-4 Front View of PE 2950 and 2950III-based Honeywell Server

This page intentionally left blank.

Honeywell

Process Solutions
2500 West Union Hills Drive
Phoenix, AZ 85027