

Honeywell

Experion/TPS

Native Window User's Guide

GU20-420

TPS R420

10/2011

Notices and Trademarks

**Copyright 2010 by Honeywell International Srl.
TPS R420 October 2011**

While this information is presented in good faith and believed to be accurate, Honeywell disclaims the implied warranties of merchantability and fitness for a particular purpose and makes no express warranties except as may be stated in its written agreement with and for its customers.

In no event is Honeywell liable to anyone for any indirect, special or consequential damages. The information and specifications in this document are subject to change without notice.

Honeywell, PlantScape, Experion PKS, and **TotalPlant** are registered trademarks of Honeywell International Inc.

Other brand or product names are trademarks of their respective owners.

Honeywell Process Solutions
1860 W. Rose Garden Lane
Phoenix, AZ 85027 USA
1-800 822-7673

About This Document

This document contains operating instructions for using Native Window. The Native Window is available on TPS Global User Stations (GUS) and integrated Experion-TPS Stations (ES-T).

Release Information

Document Name	Document ID	Release Number	Publication Date
Native Window User's Guide - GU20	GU20-420	TPS R420	10/2011

Document Category
Operations

References

The following list identifies all documents that may be sources of reference for material discussed in this publication.

Document Title	Document ID
<i>Integration Experion Nodes User Guide</i>	EX23
<i>Configuration Utility User's Guide</i>	TP20X
<i>LCNP Status User's Guide</i>	EX24

Support and Other Contacts

United States and Canada

Contact: Honeywell Solution Support Center
Phone: 1-800-822-7673
Calls are answered by dispatcher between 6:00 am and 4:00 pm Mountain Standard Time. Emergency calls outside normal working hours are received by an answering service and returned within one hour.
Facsimile: 1-973-455-5000
Mail: Honeywell TAC, MS L17
1860 W. Garden Lane
Phoenix, AZ, 85027 USA

Europe, Middle East, and Africa (EMEA)

Contact: Honeywell TAC-EMEA
Phone: +32-2-728-2345
Facsimile: +32-2-728-2696
Mail: TAC-BE02
Hermes Plaza
Hermeslaan, 1H
B-1831 Diegem, Belgium

Pacific

Contact: Honeywell Global TAC – Pacific
Phone: 1300-364-822 (toll free within Australia)
+61-8-9362-9559 (outside Australia)
Facsimile: +61-8-9362-9564
Mail: Honeywell Limited Australia
5 Kitchener Way
Burswood 6100, Western Australia
Email: GTAC@honeywell.com

India

Contact: Honeywell Global TAC – India
Phone: +91-20- 6603-9400
Facsimile: +91-20- 6603-9800
Mail: Honeywell Automation India Ltd
56 and 57, Hadapsar Industrial Estate
Hadapsar, Pune –411 013, India
Email: Global-TAC-India@honeywell.com

Korea

Contact: Honeywell Global TAC – Korea
Phone: +82-80-782-2255 (toll free within Korea)
Facsimile: +82-2-792-9015
Mail: Honeywell Co., Ltd
4F, Sangam IT Tower, , B4-4Block
1590, DMC Sangam-dong, Mapo-gu
Seoul, 121-835, Korea
Email: Global-TAC-Korea@honeywell.com

People's Republic of China

Contact: Honeywell Global TAC – China
Phone: +86- 21-2219-6888
800-820-0237
400-820-0386
Mail: Honeywell (China) Co., Ltd
33/F, Tower A, City Center, 100 Zunyi Rd.
Shanghai 200051, People's Republic of China
Email: Global-TAC-China@honeywell.com

Singapore

Contact: Honeywell Global TAC – South East Asia
Phone: +65-6580-3500
Facsimile: +65-6580-3501
+65-6445-3033
Mail: Honeywell Private Limited
Honeywell Building
17, Changi Business Park Central 1
Singapore 486073
Email: GTAC-SEA@honeywell.com

Taiwan

Contact: Honeywell Global TAC – Taiwan
Phone: +886-7-536-2567
Facsimile: +886-7-536-2039
Mail: Honeywell Taiwan Ltd.
17F-1, No. 260, Jhongshan 2nd Road.
Cianjhen District
Kaohsiung, Taiwan, ROC
Email: Global-TAC-Taiwan@honeywell.com

Japan

Contact: Honeywell Global TAC – Japan
Phone: +81-3-6730-7160
Facsimile: +81-3-6730-7228
Mail: Honeywell Japan Inc.
New Pier Takeshiba, South Tower Building,
20th Floor, 1-16-1 Kaigan, Minato-ku,
Tokyo 105-0022, Japan
Email: Global-TAC-JapanJA25@honeywell.com

Elsewhere

Call your nearest Honeywell office.

World Wide Web

Honeywell Solution Support Online:

<http://www.honeywell.com/ps>

Training Classes

Honeywell Automation College:

<http://www.automationcollege.com>

Contents

1.	GETTING STARTED WITH NATIVE WINDOW	13
1.1	Overview	13
Native Window description		13
Operator station		13
Considerations while operating Native Window		15
2.	FUNCTIONS OF NATIVE WINDOW	17
2.1	Interpreting Native Window Menus	17
Overview of menu bar selection		17
File menu		18
View menu		19
Alarms menu		20
Displays menu		21
Control menu		22
History menu		23
Engineering menu		24
Access menu (GUS)		25
Access menu (ES-T)		26
Help menu		27
2.2	Interpreting Native Window Status Bar	28
How to use Native Window Status Bar		28
Status bar button actions		29
3.	NATIVE WINDOW PROCESS OPERATIONS	31
3.1	Invoking Process and System Displays	31
Call up LCN process operation displays		31
Call up process and system displays		32
Call up customer (user-defined) displays		32
3.2	Performing Control Operations	33
Introduction		33
3.3	Requesting History Data	34
Introduction		34
How to make Native Window history changes		35
3.4	Responding to Process Alarms and Messages	36
Introduction		36
What happens when a process alarm occurs?		37
How to respond to process alarms		38

3.5	Responding to System Alarms	39
Introduction		39
How to respond to system to alarms		39
4.	NATIVE WINDOW DESKTOP OPERATIONS	41
4.1	Introduction	41
4.2	Connecting to the LCN.....	42
Connect/disconnect procedure		42
4.3	Loading a Personality	44
Overview		44
Operator station personality		44
Commands table		45
4.4	Managing Keyswitch and Cursor movement.....	47
Overview		47
Accessing Keyswitch (GUS Only)		48
Mounting/dismounting emulated disks		49
4.5	Connecting to a Remote LCNP	51
How to connect to a remote LCNP		51
4.6	Other operator station operations	52
Overview		52
Setting up the views		52
4.7	Configure a Windows Printer for GUS.....	53
5.	FEATURES OF NATIVE WINDOW	57
5.1	PC Keyboards	57
Environments		57
Native Window		57
Non-Native Window.....		59
5.2	Integrated Keyboard.....	60
Keyboard View		60
Native Window		60
Non-Native Window Key Functions		60
INS CHAR LED		60
5.3	Configurable Keyboard	61
Overview		61
Keyboard View		61
User Defined Keys		61

5.4	Security	62
	Security Objects	62
	Programs.....	62
	Configurable Options	62
	Connection Proxies	63
	Access Level Proxies (GUS Only).....	63
	Security Directory Structure - GUS	63
	Security Directory Structure – ES-T	64
	Enable Remote Access from Configuration Utility.....	65
	Users, Groups, and Permissions.....	65
6.	NATIVE WINDOW MENU BAR DETAILED DESCRIPTIONS	67
6.1	File Menu.....	67
	Connect.....	67
	Disconnect	69
	Print RTJ Queue	69
	LCN Print.....	70
	LCN Print Setup	71
	Save Display	73
	Windows Print Setup	74
	Print Display	74
	Exit	77
6.2	View Menu	78
	Hide Menu Bar	78
	Status bar	79
	Default Size.....	84
	Double Size.....	85
	Font Smoothing.....	86
	Always On Top.....	87
6.3	Alarms Menu.....	88
	ACK.....	88
	SILENCE	88
	ALARM SUMM	88
	UNIT ALARM SUMM	88
	ALARM ANNUNC	88
	MSG SUMM	88
	MSG CONFIRM	88
	MSG CLEAR	88
6.4	Displays Menu	89
	Operating	89
	System	91
	User Defined	91

6.5	Control Menu.....	93
	MAN	93
	AUTO	93
	NORM	93
	SP	93
	OUTPUT	93
	FAST	93
	LOAD	94
6.6	History Menu	95
	PRINT TREND	95
	UNIT TREND.....	96
	HOURLY AVG	96
	TREND.....	96
	RECORD.....	96
6.7	Engineering Menu.....	97
	MENU.....	97
	CMD_MENU.....	97
	HELP.....	97
	BREAK	97
	CANCEL.....	97
	HOME	97
	INS CHAR	97
	Appearance	97
	Colors	98
6.8	Access Menu.....	99
	Change Keyswitch Position (GUS Only)	99
	Mount/Dismount Emulated Disks	99
	Edit User Defined Keys	100
	View LCNP Status.....	100
	LCNP Auto Restart.....	100
	Reset LCNP Board.....	101
	US Cursor Movement.....	102
	Windows Universal Station Cursor Mode	102
	Windows Cursor Mode	104
	Input Focus	106
	Mouse/Trackball	106
	Keyboard	106
6.9	Help Menu.....	107
	Accessing Help.....	107
	Help Jumps	107

Tables

Table 1 Procedure Table for Calling Up Process Operation Displays	31
Table 2 Procedure Table for Calling Up System Displays	32
Table 3 Procedure Table to Edit User-Defined Keys	32
Table 4 Procedure Table for Making Trend Requests	35
Table 5 Procedure Table for Responding to Process Alarms	38
Table 6 Procedure Table for Responding to Process Alarms	39
Table 7 Connecting/Disconnecting Native Window.....	43
Table 8 Starting Native Window Operator Station Personality.....	45
Table 9 Native Window Views	52

Figures

Figure 1 Native Window.....	14
Figure 2 Status Bar Buttons	29
Figure 3 Connect/Disconnect Procedure.....	42
Figure 4 Keyswitch Dialog	48
Figure 5 Emulated Disk Dialog	50
Figure 6 Connecting to a Remote operator station	51
Figure 7 Example Windows Print Setup and LCN Print Setup.....	71
Figure 8 Diagram of LCN and Windows Based Printing	74

Contents

1. Getting Started with Native Window

1.1 Overview

Native Window description

The Native Window is a virtual LCN Universal Station within a PC window that provides all of the functionality of a Universal Station, including the operator and engineering functions. The Native Window (Figure 1) consists of:

- Menu Bar
- Local Control Network display
- Status Bar

Operator station

Through out this document, the term “operator station” is used to designate the PC that the control room operator uses to monitor the control process.

The operator station can be one of two types:

- Global User Station (GUS)
- Experion Station- TPS (ES-T)

1 Getting Started with Native Window

1.1 Overview

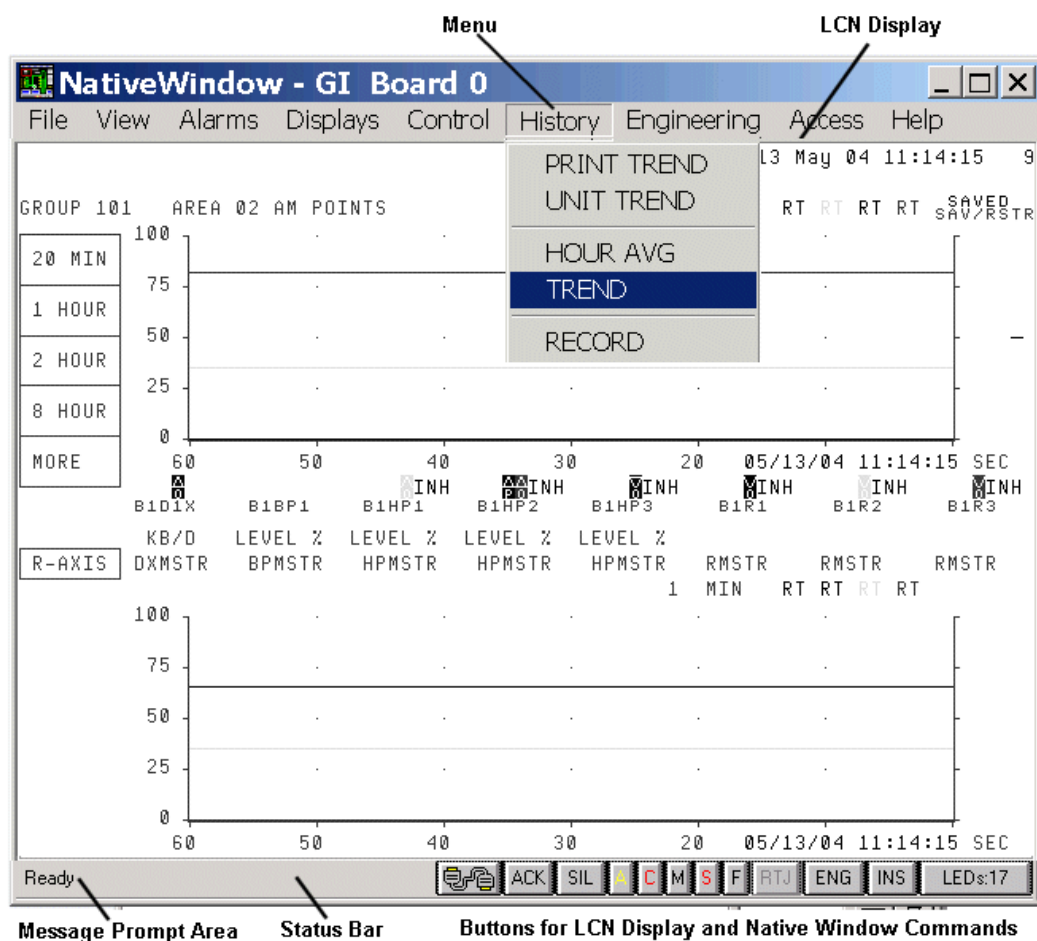


Figure 1 Native Window

More specifically, the Native Window is an application that runs in a Windows environment and interfaces to the TPS software.

Considerations while operating Native Window



ATTENTION

ACCIDENTAL TPN (LCN) TARGET SELECTION

- Be aware that casual clicking of the Native Window when it is in the background, in an attempt to bring it into the foreground, may result in the selection of a TPN (LCN) target. This can happen if the TPN (LCN) target is under the area you clicked. This is standard Microsoft Windows behavior.

FUNCTION KEY CUSTOMIZATION

- Do not set up the configurable function keys for the Windows operating system.
- The Windows operating system allows customization of the programmable function keys (F1 through F12) on a standard keyboard. Customizing the function keys overrides key actions reserved for Native Window operations. If you plan to have programmable function keys for this Station, do not customize the function keys for Windows.

LCN PRINT SETUP

- When in the Native Window, if you attempt to access the LCN Print Setup or Edit User defined Keys and you do not have the appropriate user rights (such as default OPER and SUPRV groups), no error message will be displayed. The functions do not appear.
-

1 Getting Started with Native Window


1.1 Overview

2. Functions of Native Window

2.1 Interpreting Native Window Menus

Overview of menu bar selection

The Native Window Main Menu Bar consists of the commands shown below. Descriptions of those commands, and the choices under each command, are described in the section Native Window Menu Bar Detailed Descriptions.



ATTENTION

Native Window menu items in ALL UPPER CASE correspond to **TotalPlant** Solution (TPS) Network buttons found on the classic operator keyboard; those in mixed case are new items.


2 Functions of Native Window

2.1 Interpreting Native Window Menus

File menu

As shown in the illustration below, the File Menu accesses Native Window operation and printing functions such as:

- Connect or disconnect the Native Window application to or from an LCNP
- Print reports, trends, the Real Time Journal, and the contents of the Native Window
- Change printer configuration and assignment
- Save or print a display
- Exit the Native Window application

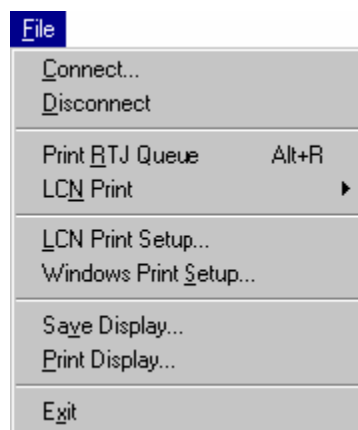


For more information, see File Menu under the section Native Window Menu Bar Detailed Descriptions.

View menu

As shown in the illustration below, the View Menu toggles the following functions on and off:

- The Menu Bar, which appears at the top of the Native Window
- The Status Bar, which appears at the bottom of the Native Window
- Double sizes the Native Window
- Returns the Native Window, which can be scaled, to its default size
- Smooth fonts so they don't display with "jagged edges"
- Keeps the Native Window always on top of any other window that is open



For more information, see View Menu under the section Native Window Menu Bar Detailed Descriptions.


2 Functions of Native Window

2.1 Interpreting Native Window Menus

Alarms menu

The Alarms Menu items handle alarms and messages in order to:

- Acknowledge a process or system alarm or program message to an operator
- Silence a process or system alarm
- Display an alarm summary display, such as the Alarm Summary, Unit Alarm Summary, or Alarm Annunciator
- Display a Message Summary, confirm a message, and clear an acknowledged message.

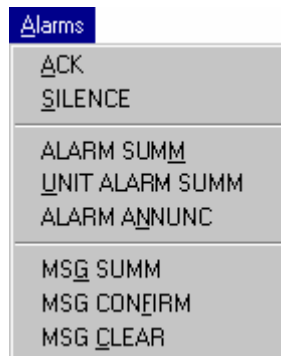


For more information, see Alarms Menu under the section Native Window Menu Bar Detailed Descriptions.

Displays menu

The Displays Menu calls up the following types of standard displays:

- Operating (Detail, Group, LCN schematic, Slot tagname position, Associated Display, Help, Prior Display, Display Backward, Display Forward, Page Back, Page Forward)
- System (LCN's Console Status, System Status, and System Menu)

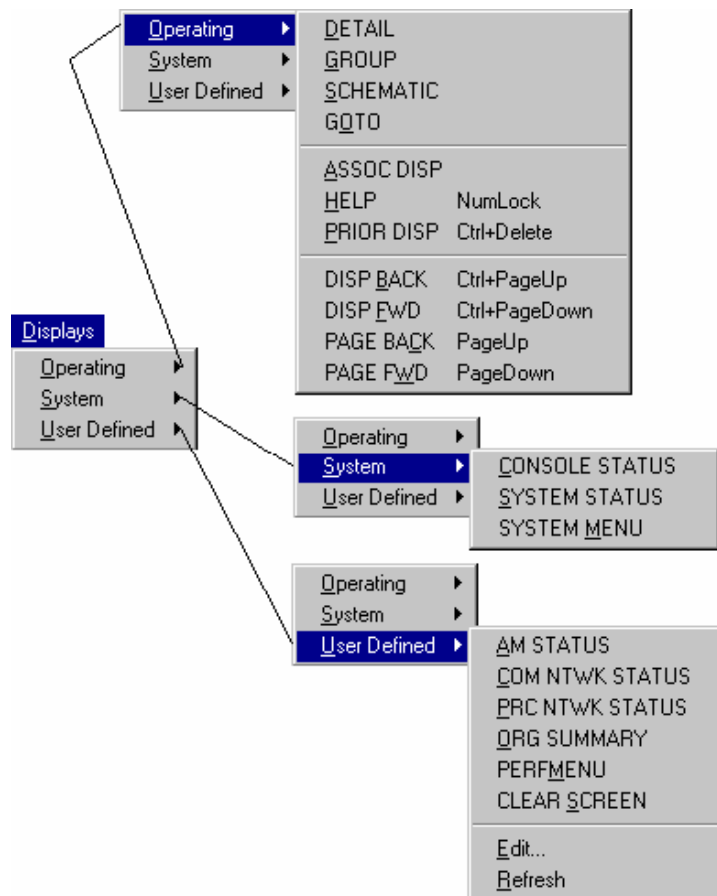

For more information, see Displays Menu under the section Native Window Menu Bar Detailed Descriptions.


2 Functions of Native Window

2.1 Interpreting Native Window Menus

Control menu

The Control Menu executes the following process control changes:

- Places selected points in the Manual, Automatic, or configured Normal mode
- Enables changes to the setpoint of a tagname
- Enables changes to an analog or digital output
- Increases the rate of display information updates
- Prepares the operator station for personality program loading

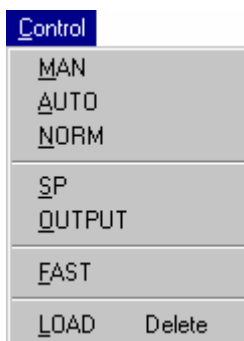

For more information, see Control Menu under the section Native Window Menu Bar Detailed Descriptions.

History menu

The History Menu access trend functions that:

- Displays a Unit Trend
- Displays the Hourly Averages and Group Trend displays from within a Group Display
- Activates trend printing



For more information, see History Menu under the section Native Window Menu Bar Detailed Descriptions.


2 Functions of Native Window

2.1 Interpreting Native Window Menus

Engineering menu

The Engineering Menu executes the following engineering functions:

- Call up the LCN's Engineering Main Menu and associated displays
- Execute special functions for Engineering Operations (BREAK, CANCEL, HOME, INS CHAR)
- Change the legacy Universal Station custom displays through the legacy Picture Editor behavior attributes (appearance and colors)

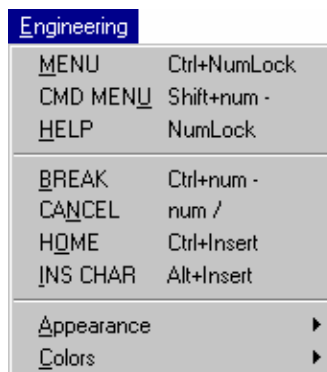


For more information, see Engineering Menu under the section Native Window Menu Bar Detailed Descriptions.

Access menu (GUS)

The Access menu items control access to process data and system configuration:

- Change the keyswitch position (operator, supervisor, engineer, view-only)
- Mount/dismount emulated disks
- Edit user-defined keys
- View LCNP status
- Reset the LCNP board
- LCNP Auto Restart
- Specify cursor behavior and cursor style when Native Window is active

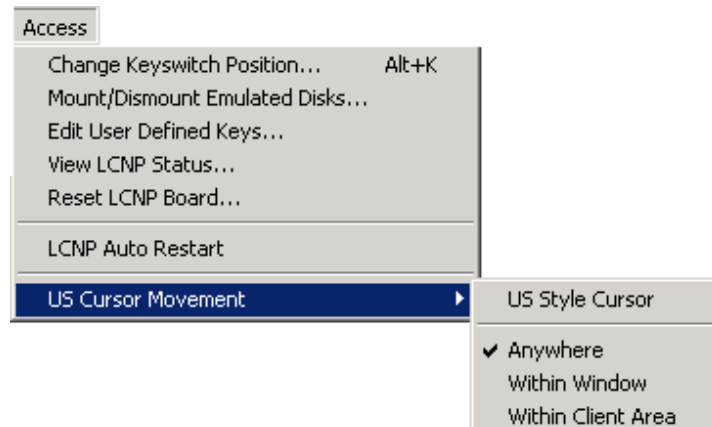

For more information, see Access Menu under the section Native Window Menu Bar Detailed Descriptions.


2 Functions of Native Window

2.1 Interpreting Native Window Menus

Access menu (ES-T)

The Access menu items control access to process data and system configuration:

- Mount/dismount emulated disks
- Edit user-defined keys
- View LCNP status
- Reset the LCNP board m
- LCNP Auto Restart
- Specify cursor behavior and cursor style when Native Window is active

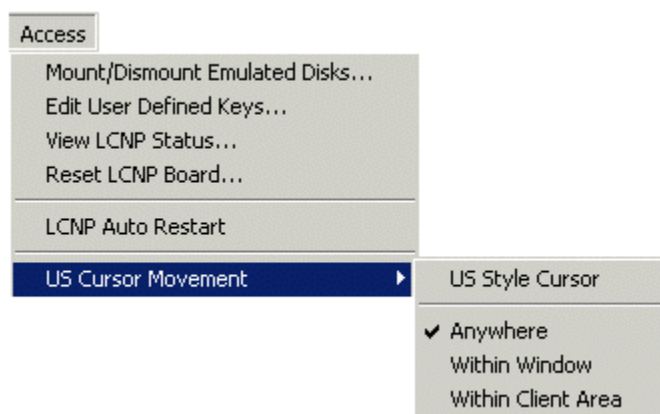


For more information, see Access Menu under the section Native Window Menu Bar Detailed Descriptions.

Help menu

The Help Menu items provide access to online Help topics

- Search with fast-find index
- Locate Help topics for all Native Window tasks
- View revision information

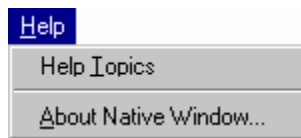

For more information, see Help Menu under the section Native Window Menu Bar Detailed Descriptions.

2.2 Interpreting Native Window Status Bar

How to use Native Window Status Bar

The Native Window Status Bar provides process and system indications, as well as convenient access to several LCN displays by using pushbuttons. The Native Window Status bar provides indicators and/or buttons that allow you to do the following:

- Identify the connection status of the operator station to LCN
- Acknowledge and silence alarms
- Identify whether messages or alarms are occurring for process alarms, system alarms, console alarms, or process messages
- Interpret whether Real Time Journal messages are in the print queue
- Identify the keyswitch position as operator, supervisor, or engineer or view-only
- Interpret whether insert or overwrite character function is on
- Provide LCNP status for this operator station


With TPS R420, on the Native Window status bar, the access levels for the operator and the view-only user logins are displayed as OPR and VIEW.

Status bar button actions

Review the following and table for descriptions of the status bar buttons.



Figure 2 Status Bar Buttons

Icon	Description
	Pressing this button connections/disconnects LCN Native Window.
	Pressing this button acknowledges alarms.
	Pressing this button silences alarms.
	Pressing this button calls up the Alarm Summary.
	Pressing this button calls up the Console Status.
	Pressing this button calls up the Message Summary.
	Pressing this button calls up the System Status.
	When this F button (fast option) is enabled, it indicates that the “Fast” data collection is active.
	Pressing this button requests a Real Time Journal.
	Pressing this button calls up a dialog box to change the keyswitch position to Operator, Supervisor, Engineer, or View-Only. Note: The ENG button allows you to change the keyswitch position only in a GUS environment. (for GUS node and an US replacement node).
	Pressing this button toggles between the insert character mode (INS) and the overwrite (OVR) character mode.
	Pressing this button calls up the LCNP status.

2 Functions of Native Window

2.2 Interpreting Native Window Status Bar

3. Native Window Process Operations

3.1 Invoking Process and System Displays

Call up LCN process operation displays

You can call up LCN process operating displays by using the following steps.

Table 1 Procedure Table for Calling Up Process Operation Displays

If you need to request a...	Then choose...
Detail display	Displays -> Operating -> Detail -> tagnam. Hit Enter.
Group display	Displays -> Operating -> Group -> # Hit Enter.
Control slot	Displays -> Operating -> Group -> # Hit Enter. Select GOTO and # of slot. (where # of slot is its position in the Group display). Hit Enter.
Custom schematic	Displays -> Operating -> schematic -> schematic name Hit Enter.
Display related to a display or tagname	Displays -> Operating -> Assoc Disp
Help Display related to a display	Displays -> Operating -> Help
Prior display	Displays -> Operating -> Prior Disp
Move forward or backward in displays	Displays -> Operating -> DISP BACK Displays -> Operating -> DISP FWD
Page forward or backward within a display	Displays -> Operating -> PAGE BACK Displays -> Operating -> PAGE FWD

3 Native Window Process Operations

3.1 Invoking Process and System Displays

Call up process and system displays

You can call up system displays from the Native Window by using the following steps.

Table 2 Procedure Table for Calling Up System Displays

If you need to request a...	Then choose...
Console Status display	Displays -> Systems -> Console Status
System Status display	Displays -> Systems -> System Status
System Menu display	Displays -> Systems -> System Menu

Call up customer (user-defined) displays

User-defined displays can be called up from the LCN Native Window. User-defined keys can be edited to include menu selections for display callups of your choice. (If you are using an integrated keyboard, the user-defined selections correspond to the six buttons on the lower-left side of the keyboard.) You can call up user-defined displays from the Native Window by using the following steps.


Table 3 Procedure Table to Edit User-Defined Keys

If you need to request a...	Then choose...
User-defined display	Displays -> User-defined -> display of interest
Label edit of user-defined keys	Displays -> User-defined -> Edit

3.2 Performing Control Operations

Introduction

This section shows you how to use the LCN Native Window's Control menu to perform control operations, such as changing setpoints and outputs. Review the following figure for the menu items used when controlling a loop.

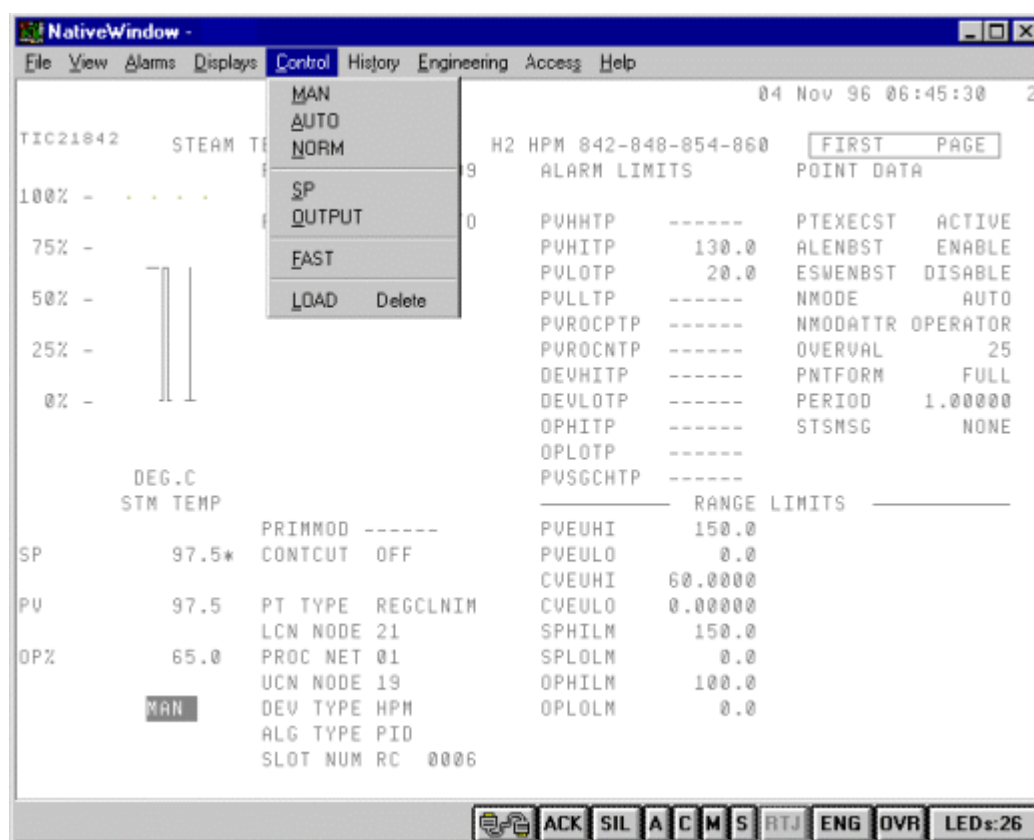


3.3 Requesting History Data

Introduction

This section shows you how to call up history or trend data by accessing the Trend menu in the Native Window. Review the various selections on the following figure that appear in the Native Window's History menu. This figure shows a Group display with historized points.

History Selections

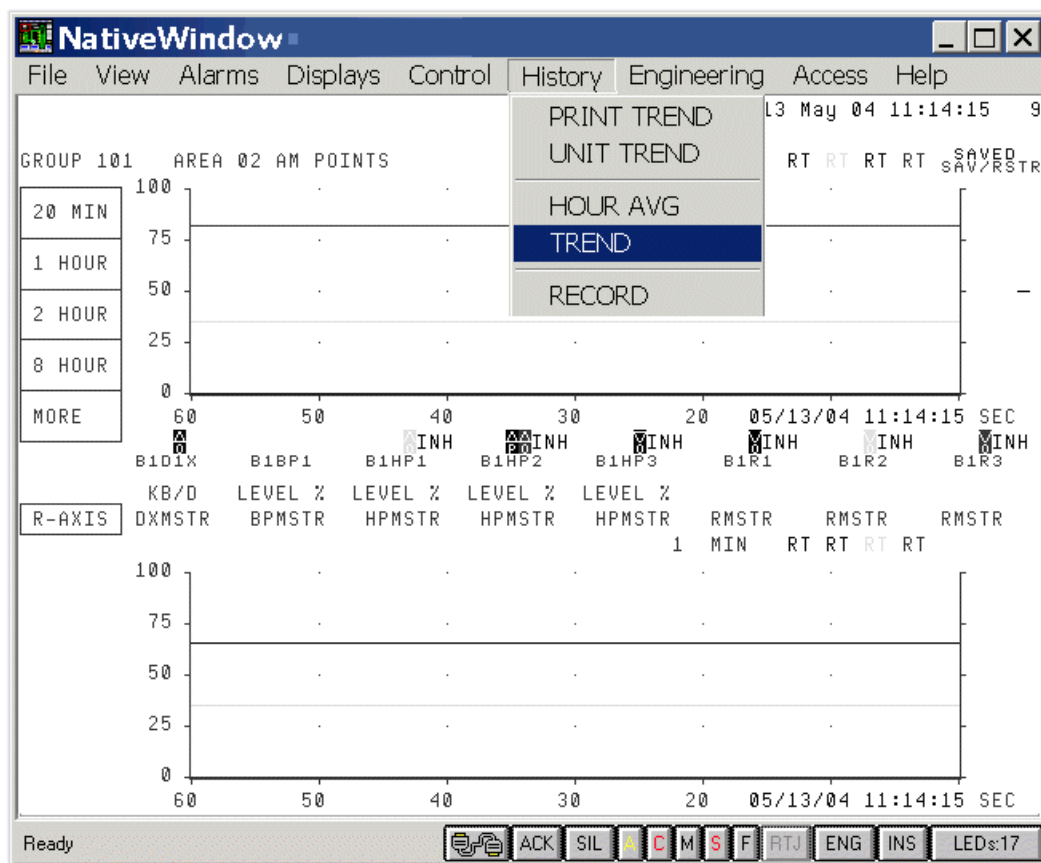

How to make Native Window history changes

You can make history changes from the Native Window by using the following steps.


Table 4 Procedure Table for Making Trend Requests

If you need to request a...	Then choose...
Trend a selected tagname (point) from the LCN Native Window	Displays -> Operating -> Group -> # Hit Enter. Displays -> Operating -> Goto -> # Hit Enter. History -> Trend
Call up an LCN Group Trend display from a Group display Displays -> Operating -> Group -> # Hit Enter. History -> Trend	Displays -> Operating -> Group -> # Hit Enter. History -> Trend
Call up the Hourly Averages display from an LCN Group display	Displays -> Operating -> Group -> # Hit Enter. History -> Hour Avg
Activate trend recording from the LCN Native Window	Displays -> Operating -> Group -> # Hit Enter. History -> Record
Call up an LCN Unit Trend display	History -> Unit Trend -> # Hit Enter.
Activate trend printing from the LCN Native Window	Displays -> Operating -> Group -> # Hit Enter. History -> Print Trend

3.4 Responding to Process Alarms and Messages

Introduction

This section shows you how to use the Local Control Network (LCN) Native Window Alarms menu to call up LCN Alarm and Message Summary displays. These displays are called up by operators as part of their corrective response to process alarms and messages. The following figure shows the menu selections you can make when responding to a process alarm or message.

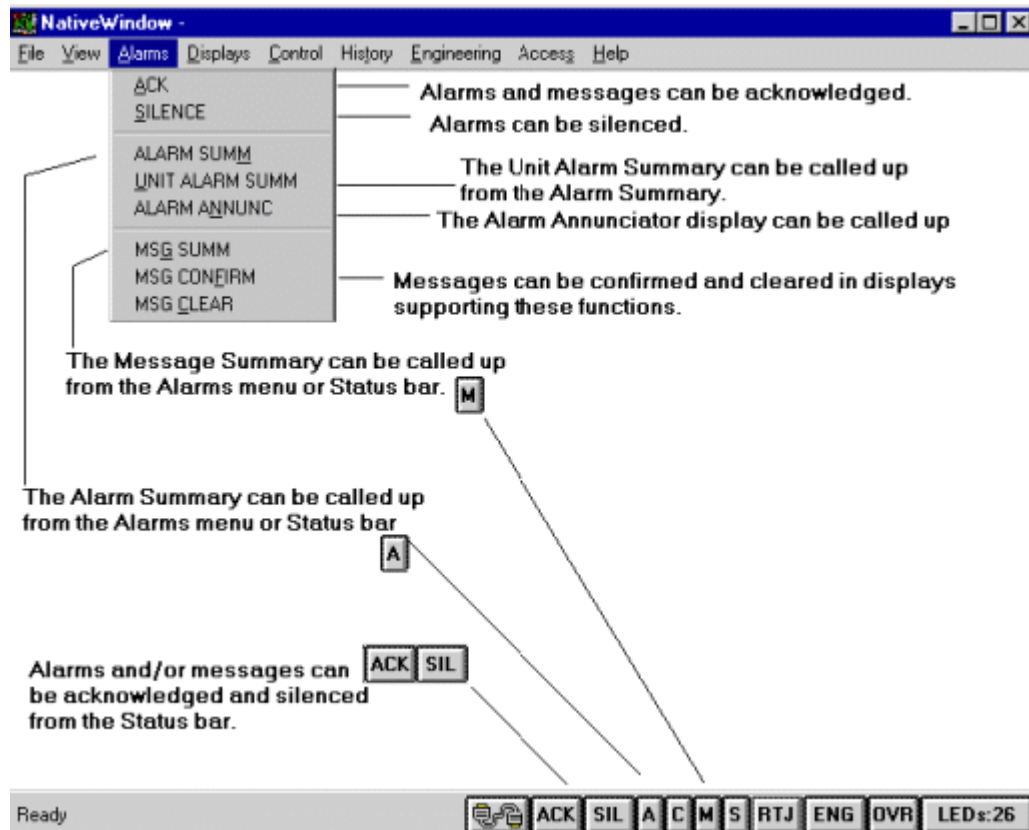

What happens when a process alarm occurs?

When a process alarm occurs in the unit assigned to your operator station, the letter A in the status bar changes color and blinks. You can access the Alarms Menu from the Native Window menu by one of the following methods:

- Selecting the Alarm Summary from the Alarm pull-down menu
- Selecting the Unit Alarm Summary from the Alarm pull-down menu
- Selecting the "A" button on the status bar

When a process message occurs in the unit assigned to your, the letter M in the status bar changes color and blinks. You can select the Alarms Menu from the Native Window menu, then select Message Summary; or, by selecting the "M" button on the Status Bar call up the Message Summary. The message(s) of interest can be acknowledged.

3 Native Window Process Operations

3.4 Responding to Process Alarms and Messages

How to respond to process alarms

You respond to process alarms and messages by making selections from the Native Window's Alarms Menu or Status Bar by using the following steps.

Table 5 Procedure Table for Responding to Process Alarms

If you need to...	Then ...
Call up the Area Alarm Summary	Press the "A" button on the Native Window Status bar, or select ALARM SUMM from the Alarms menu
Acknowledge alarms/messages	Select ACK from the Alarms menu or Status bar
Silence alarms	Select SILENCE from the Alarms menu or Status bar
Call up Unit Alarm Summary	From Alarms menu, select UNIT ALARM SUMM - > # Hit Enter.
Call up the Alarm Annunciator Display	From the Alarms menu, select ALARM ANNUNC
Call up the Message Summary	Press the "M" button on the Native Window Status bar, or select MSG SUMM from the Alarms menu
Confirm messages	Select MSG CONFIRM from the Alarms menu
Clear messages	Select MSG CLEAR from the Alarms menu

3.5 Responding to System Alarms

Introduction

This section shows the ways system alarm indications appear in the LCN Native Window. A system alarm, such as an LCN hardware failure, is indicated as an alarm on the Native Window Status bar (item turns red). The corresponding status display(s) can then be called up directly from the Native Window Status bar (the most convenient way) or from the Displays Menu.

A system alarm, such as an alarm for a TPS device that is not in the proper state, is annunciated as an alarm on the Native Window's Status Bar. The corresponding status display(s) can then be called up directly from the Native Window's Status Bar, the Displays Menu, or the Access menu.

System alarms can be categorized as one of the following:

- Console alarm
- Node status alarm
- LCNP alarm

How to respond to system to alarms

You respond to system alarms by making selections from the Native Window's Displays Menu or Status Bar by using the following steps.

Table 6 Procedure Table for Responding to Process Alarms

If you need to...	Then ...
Respond to a Console alarm, e.g. printer off-line	Press the "C" button on the Native Window Status bar, or select System->CONSOLE STATUS from the Displays menu.
Respond to a node status alarm, e.g. TPS device not in the correct state	Press the "S" button on the Native Window Status bar, or select System->SYSTEM STATUS from the Displays menu.
Respond to a GUS alarm, e.g. LCNP status	Press the "LEDs" button on the Native Window Status bar, or select View LCNP Status from the Access menu.

3 Native Window Process Operations

3.5 Responding to System Alarms

4. Native Window Desktop Operations

4.1 Introduction

Before a Native Window can operate, it must be connected to the LCN so that the operator station communications can be established. Communication to the LCN occurs through the LCNP board on the operator station. Therefore, the Native Window must be connected to the LCNP board.

Native Window Operations establish communication to the LCN through a process called "connecting". This is accomplished either through the File Menu or the Native Window Status bar.

4.2 Connecting to the LCN

Connect/disconnect procedure

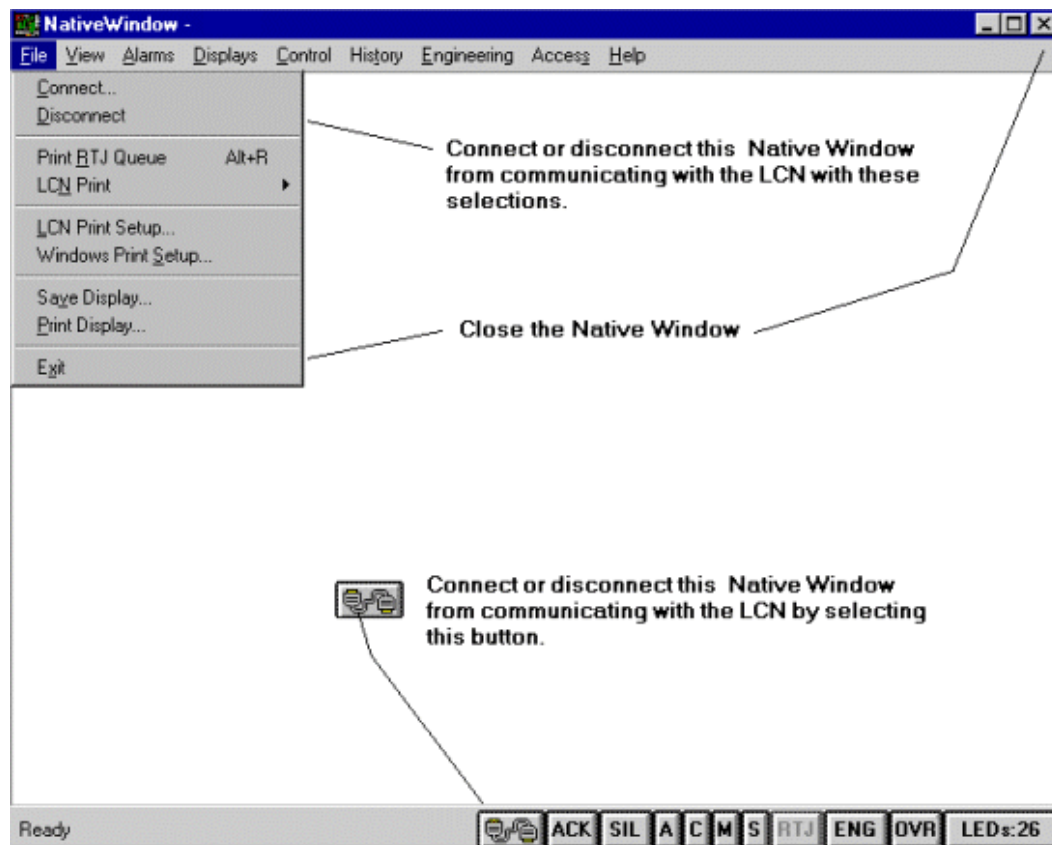


Figure 3 Connect/Disconnect Procedure

Perform the following to connect/disconnect and exit the Native Window.

Table 7 Connecting/Disconnecting Native Window

If you need to ...	Then choose ...
Connect/Disconnect the LCN Native Window	From the Native Window Menu bar: • File > Connect to establish LCN communication • File > Disconnect to end operator station communication to the LCNP. From the Native Window Status bar  Click to toggle state (a red broken cable indicates a disconnected state; a solid cable indicates a connected state).
Exit the Native Window	From the Native Window Menu bar: • File > Exit to close the Native Window Application or • Click the Close Window Icon (located in the upper right corner of the Native Window). 

4. Native Window Desktop Operations

4.3. Loading a Personality

4.3 Loading a Personality

Overview

You have seen how a Native Window could be connected to view a process. To have a process view, your operator station requires the appropriate personality program, to be running.

Operator station personality

The operator station is loaded with **the appropriate** system software personality. The operator station personality resides in the operator station LCNP board. Both the Native Window application and operator station personality have menu commands related to their operation.

Native Window requires the UxS personality, otherwise known as the “GUS” personality.

Commands table

Menu commands relating to activating either the Native Window or loading the operator station personality are shown in the following table.



ATTENTION

In the table below, Close, connect/disconnect commands apply to Native Window and Load, Reset LCNP commands apply to the operator station personality.

Table 8 Starting Native Window Operator Station Personality

Program	Menu Command	Comment
Native Window	From the Menu bar: - Select File > Exit or - Click the Close Window Icon (upper right corner). 	Disconnects and closes the Native Window application.
	From the Menu bar: - Select File > Connect or - Select File > Disconnect or - Click the Status bar button to change the state from connect to disconnect  (the red broken cable is the disconnected state).	Connects/disconnects the Native Window application to an LCNP. The Native Window displayed on your operator station can be connected to either a local or remote LCNP. The operator station Native Window application itself remains open.

4. Native Window Desktop Operations

4.3. Loading a Personality

Program	Menu Command	Comment
operator station Personality	If the operator station personality is NOT loaded but the Native Window is connected to the LCNP, the  button shows on the Status bar. To start the load, - Click the Load button or - From the Menu bar, select Control > Load. or - From the Access menu, select LCNP Auto Restart.	Initiates a load operation in which a user can load the operator station personality to the LCNP board. Note: The LCNP can optionally be configured to Auto Load without requiring manual intervention.
	From the Menu bar: Select Access > Reset LCNP Board.	Stops (resets) the operator station personality. The Native Window application remains open.



ATTENTION

For a Station to be fully operational as an ES-T, its TPN Server must be running. If the TPN Server stops, the station will revert back to a GUS.

4.4 Managing Keyswitch and Cursor movement

Overview

The Native Window **Access** menu provides various LCN operation options:

- Keyswitch position
- Emulated disk mounting
- Cursor movement

This section shows you how to set up options for LCN operations through selections from the Access menu. In some cases, the options can also be set up from other Native Window menus.

4. Native Window Desktop Operations

4.4. Managing Keyswitch and Cursor movement

Accessing Keyswitch (GUS Only)



ATTENTION

For an ES-T, the menu selection for “Change Keyswitch position” is not available because there is not a physical keyswitch on an ES-T.

Review the following menu item to change the keyswitch position when using a GUS.

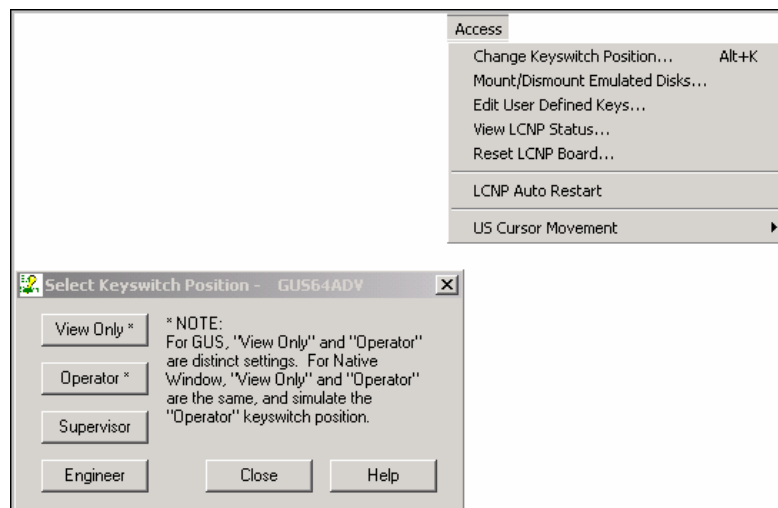


Figure 4 Keyswitch Dialog

The keyswitch positions that are available may depend on the currently logged-in user and whether a service called the Signon Manager is enabled. Signon Manager, if enabled, uses Windows XP accounts to determine allowable key level settings for a particular user. Its purpose is to allow a particular user to be able to change the key level to a certain level without logging in as a different user. Login-based keyswitch security can be disabled when using a GUS and either the physical keyswitch (Integrated Keyboard only) or software keyswitch can be used in its place, if desired.



ATTENTION

On ES-T nodes, change of operator logon (Windows logon or SignOn Manager) effects the change of key level.

Mounting/dismounting emulated disks

An Emulated Disk is a special file in the Windows environment that is used to “contain” LCN-formatted files. It functions like removable media on a Universal Station, hence the term “Emulated Disk”.

The Emulated Disk file, which has a .lcn extension, can reside anywhere a Windows file can be created, such as on the operator station PC hard drive, on a CD, zip, or network server.



ATTENTION

As of GUS 330, floppy disks should not be used as an emulated disk. The policy files restrict the use of floppies as a protective measure against the introduction of virus infected files.

On the TPS GUS nodes, the GUS Display Builder or GUS Display Runtime package is required for the “mount/dismount emulated disks” function to work.

- Install GUS Display Builder (or GUS Display Runtime) package using the TPS installation media.
- Reboot the node.
- After logon, verify if the lcnfilesvc.exe service is running using the Windows Task Manager.
- Verify if the volumes can be mounted/dismounted.

Note: These packages require install license.

Ensure that the GUS base software is installed prior to GUS personality installation.

Emulated Disks are “mounted” into one of the two Emulated Drives: the left drive or the right drive.

4. Native Window Desktop Operations

4.4. Managing Keyswitch and Cursor movement

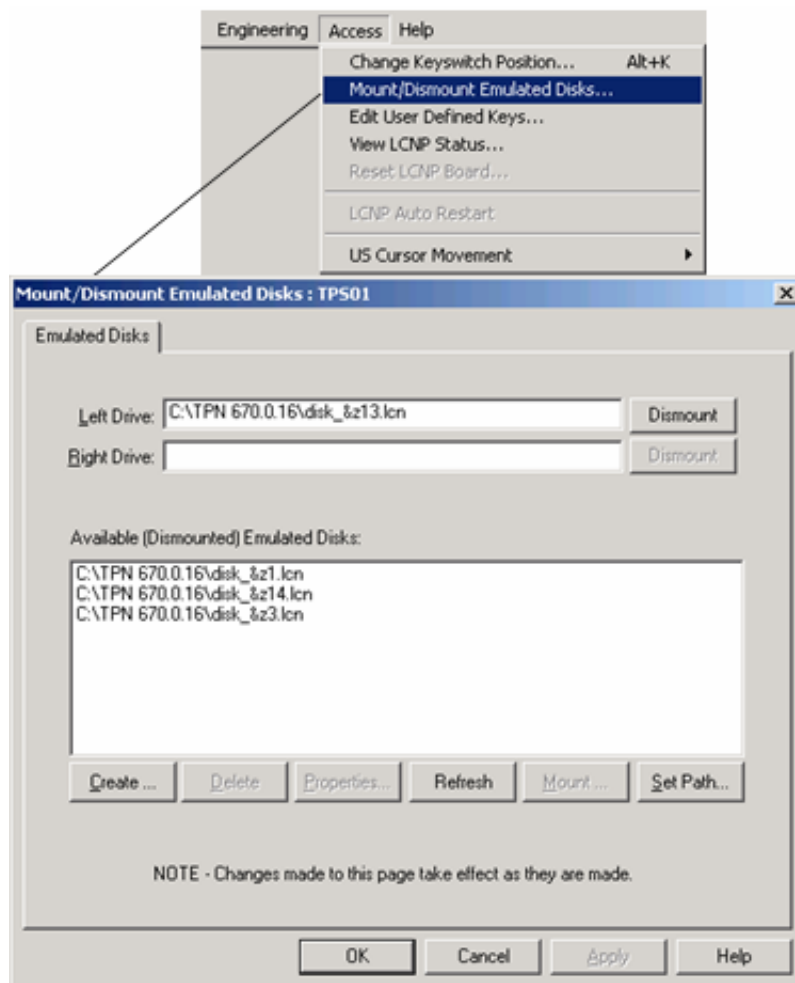


Figure 5 Emulated Disk Dialog

With GUS R360 and greater, emulated disks can also be operated using TPN (LCN) Command Processor and EC files.



REFERENCE - INTERNAL

For more information about operating emulated disks from TPN (LCN) Command Processor and EC files, refer to *Command Processor Operation, SW11*.

4.5 Connecting to a Remote LCNP

How to connect to a remote LCNP



ATTENTION

Both GUS and ES-T support remote connections. The details discussed in this section refer to requirements to make a remote connection using a GUS or Experion Station.

One of the options when connecting to an LCNP is to connect to a remote operator station LCNP. Assuming that your configuration supports this option, select "**Network**" and enter the system name for the remote operator station when the dialog box appears. Review the following figure for the entries that appear. Connecting to a remote operator station LCNP is sometimes called "stealing the Native Window."

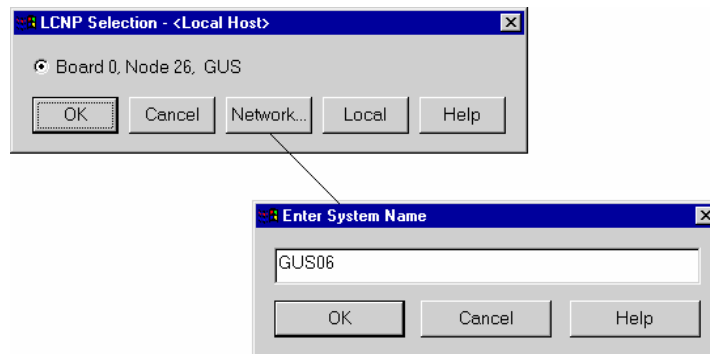


Figure 6 Connecting to a Remote operator station

The system name entry is the "computer name" of the remote operator station. To identify your computer name, select the **Control Panel**, and then **System**.

From the Network Identification tab select the **Properties** button. Note that the remote operator station Native Window must be disconnected from its LCNP before a local operator station can connect to the LCNP on the remote operator station.

4.6 Other operator station operations

Overview

This section describes how to change the view of the Native Window so that it will show (or not show) the Native Window Menu bar and/or Status bar.

Setting up the views

The following procedures can be followed to set up your views of the Native Window.

Table 9 Native Window Views

Action	Use the menu or status bar selections
Show or Hide the Menu Bar and/or Show the Status Bar	Select View from the Menu and select the desired view(s). A checkmark beside the Status Bar item indicates it shows. Or Press the right mouse button and select desired view(s). A checkmark beside an item indicates it shows.
Set up Native Window so it appears always on top of all other windows	Select View from the Menu and select Always On Top (you can also use the right mouse button menu). A checkmark beside the item indicates it is functioning.

4.7 Configure a Windows Printer for GUS

Note: This procedure applies to a Windows printer that will NOT be used as the dedicated LCN alarm printer.

Step	Action
Add Windows Printer	
1	Choose Start > Printers .
2	Double-click ADD Printer (launches the "Add Printer Wizard").
3	Click Next on the Welcome screen.
4	Select Local Printer (NOT Network Printer).
5	Uncheck Automatically detect and install my Plug & Play printer .
6	Click Next .
7	Select Create a new port .
8	In the Type port, select Standard TCP/IP port .
9	Click Next (launches the "Add Standard TCP/IP Printer Port Wizard").
10	Click Next on the Welcome screen.
11	In the Printer Name or IP Address port, enter the IP address of the printer. (Port Name is created based on the TCP/IP address.)
12	Click Next . (The window display indicates when the port is added.)
13	Click Finish . (The port wizard closes and defaults back to the printer wizard. When the wizard moves to the Manufacturers - Printer screen, the port has been created.)
14	Select the printer from the manufacturer and model.
15	Click Next .
16	If the "Use Existing Driver" screen displays, select Keep existing driver (recommended) .
17	Click Next .
18	On the "Name Your Printer" screen, enter a name for your printer in the "Printer Name" port.

4. Native Window Desktop Operations

4.7. Configure a Windows Printer for GUS

Step	Action
19	Click Next .
20	On the "Printer Sharing" screen, sharing is optional. If you choose to share the printer, enter a share name and click "Next". Otherwise accept the "Do not share this printer" default.
21	Click Next .
22	On the "Print Test Page" screen, answer Yes to the "Do you want to print a test page?" question.
23	Click Next .
24	Click Finish (the test page is printed).
25	Check for the test page. If good, select OK to close the message and the wizard.
Configure Native Window	
26	Call up Native Window.
27	Select the File on the menu bar.
28	Select Windows Print setup .
29	Verify the name of the printer just added is in the "Name:" port. If not, use the drop down arrow to select it.
30	Locate the "Orientation" configuration and select Landscape .
31	Click OK .
32	Select File on the menu bar.
33	Select LCN Print Setup .
34	Verify that Batch Printer Selection is selected. If not, select it.
35	Verify that the printer name just added appears in the "Name:" port. If not, select "Print Setup" and add it.
36	Click OK .

4. Native Window Desktop Operations

4.7. Configure a Windows Printer for GUS

Step	Action
Test Display Print	
37	Select Print display either from the IKB/OEP (PRINT DISP key) or from the Native Window display under "File" on the menu bar.
38	Verify that the requested display is printed. If not, re-run the procedure.

4. Native Window Desktop Operations

4.7. Configure a Windows Printer for GUS

5. Features of Native Window

5.1 PC Keyboards

Environments

The standard PC keyboard functions in two different environments:

- Native Window
- Non-Native Window

An overlay is provided that can be placed over the keys to more easily note their TPS system functions. Of particular note are the following mappings:

- Holding CTRL and typing the QWERTY digit keys 1-0 achieve the F keys.
- The PF keys are achieved by typing the F keys on the PC keyboard.

Native Window

When the Native Window is active, the PC function keys perform the actions marked with red labels on the Integrated Keyboard keys.

The red markings on the front edge of the Integrated Keyboard keys represent functions activated when the Control key is pressed along with the keyboard key. The Control key activates the same functions on the PC keyboard.

In addition, the Delete key becomes the Load key.

PF Keys

The standard function keys F1 - F12 can be configured as button configurator keys PF1 - PF12.

PF13 and PF14 are excluded.

Three other keys in the top row of the PC keyboard can also be configured as PF keys:

Print Screen = PF15 (It also copies a Print Screen image to the clipboard.)

Scroll Lock = PF16

Pause = PF17

5. Features of Native Window

5.1. PC Keyboards

These 15 PF keys are configurable using the LCN Button Configuration file and can be used alone or in conjunction with the Control or Shift keys, creating a total of 45 possible key positions.

The Honeywell-supplied default button file provides the following key positions:

	PF1	PF2	PF3	PF4	PF5	PF6	PF7	PF8
CTRL			HR_AVG					EHR
SHIFT		ASSOC	TREND	TO SCRN	FRMSCRN			REPMENU
NORMAL	LCN HELP	PR_DISP	GROUP	DETAIL	SCHEM	SYSTAT	CONSTAT	SYSTEMENU

	PF9	PF10	PF11	PF12	PF15	PF16	PF17
CTRL			ALMANC	MSGCLR	RECORD	FAST	RAISE
SHIFT	SIL		UALMSM	MSGCNF	OUT	SP	LOWER
NORMAL	ACK		ALMSUM	MSGSUM	MAN	AUTO	NORM

Function Keys

Function keys F1 - F12 are implemented through the numeric keys at the top of the QWERTY keyboard (1, 2, 3, 4, 5, 6, 7, 8, 9, 0, -, =) in combination with the Control key in the Native Window environment.

Num Lock Key

On the PC-101 keyboard, the Num Lock key is the TPS system Help key. During Native Window operation, the Num Lock key is used to provide TPS system-level Help and should not be used in a text input port where numbers are being entered because it will create an input error.

Non-Native Window

Keyboard functions

Outside the Native Window, the PC keyboard functions like a standard keyboard. The function keys are available for F1 - F12.

Right Mouse Button

Right-click the mouse button to display a menu with five choices for the right mouse button function.

When you select this...	The right mouse button's function is to do this...
Enter	Enter
Menu Bar	Call up/hide the Native Window Menu Bar
Status Bar	Call up/hide the Native Window Status Bar
Default Size	Return the Native Window to its default size of 640 x 448 pixels
Double Size	Unavailable unless the screen resolution is a minimum of 1280X1024. Allows doubling the size of the native Window.
Always On Top	Allow/disallow any other windows on the desktop to display on top of the Native Window



TIP

For both GUS and ES-T, native Window will disable the Always On Top option if it is explicitly set in SafeView for the window in which SafeView is managing Native Window.

When the Menu, Status Bar, or Always On Top is on, a check mark appears next to the pull-down menu selection.

5. Features of Native Window

5.2. Integrated Keyboard

5.2 Integrated Keyboard

Keyboard View



Native Window

Native Window numeric-F key and PF key positions are indicated in red on the Integrated Keyboard. The Integrated Keyboard PF keys operate alone or with the Control or Shift keys. They can also be configured using the LCN Button Configuration file.

Non-Native Window Key Functions

Non-Native Window key functions are indicated in blue on the Integrated keyboard.

INS CHAR LED


An LED titled “INS CHAR” is located at the top left corner of the integrated keyboard. When you are using an integrated keyboard on a Universal Station, this LED will be illuminated when you are in the insert mode. However, if you’re using an operator station, the INS CHAR LED will not indicate when you are in the insert mode. In fact, it cannot be used in this manner because the operator station is a multi-window system, and it is not possible to display the Insert/Overwrite mode of more than one window using a single LED. Instead, the operator station Native Window displays the mode as either INS or OVR on the Status Bar at the bottom of the window.

5.3 Configurable Keyboard

Overview

The Configurable keyboard operates in combination with the Integrated Keyboard. It contains button configuration keys and display call-up buttons similar to the classic Universal Station Operator keyboard.

Keyboard View

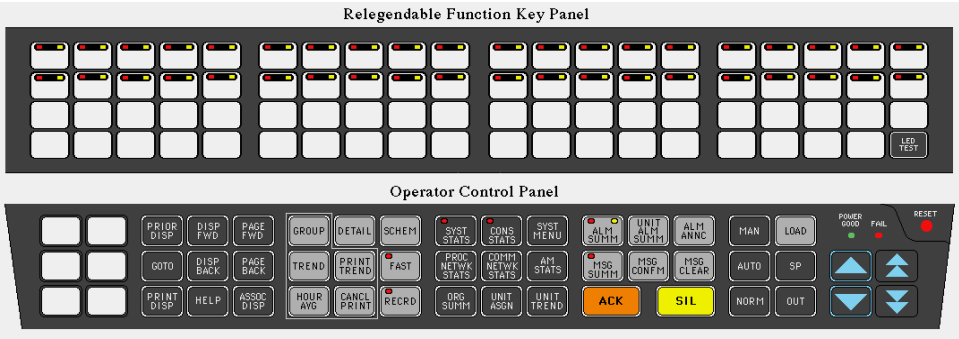

REFERENCE - INTERNAL

ES-T users should refer to the Integrated Keyboard section in the *Integrated Experion-TPS Nodes, EX23*, for details on the functions of each of the configurable keys on the IKB.

GUS users should refer to the Integrated Keyboard section in the *Keyboards manual, SW09-508*, for details on the operation and maintenance of the Integrated Keyboard.

User Defined Keys

The six buttons on the left side of the Integrated Keyboard Operator Control Panel correspond to the six User Defined key assignments.



REFERENCE - INTERNAL

Refer to the *Keyboard Page* section in the *TPS System Configuration Utility User's Guide* for information.

5. Features of Native Window

5.4. Security

5.4 Security

Security Objects

TPS Security provides three “lines of defense” based on the following Security Objects:

Security Object	What	Permissions	Enforced by
Programs	executables (.exe files)	for user to run executable	Windows OS
Configurable Options	configurations made using the Configuration Utility	to make this type of connection	program
Connection Proxies	proxy files	for user to make specific LCNP connections	program
Access Level Proxies	proxy files	for users to access the LCN at specified key levels	program

For additional security information, refer to Users, Groups, and Permissions.

Programs

Users should verify they have adequate permissions to run the executable.

When a user attempts to run the Native Window, LCNP Status, or Debug Window executables, Windows OS checks to see if the user has adequate permissions to run the executable.

Configurable Options

On an LCNP board-by-board basis, the Configuration Utility program provides the ability to enable or disable the following types of connections:

- Local Connections - Native Window connection to the local LCNP board by local users
- Remote Connections - Native Window connection to the local LCNP board by remote users
- Local Connection Override - The ability to override a remote user Native Window connection when a local user Native Window connection is requested

Connection Proxies

When a user attempts to connect a Native Window, LCNP Status, or debug window to an LCNP board, the program makes an attempt to open a corresponding proxy file. If the user does not have adequate permission to open the proxy file, the connection of that program to the LCNP board is denied.

Access Level Proxies (GUS Only)

When a user attempts to set the IKB or software key switch to a new level, the Native Window checks the proxy files to see if the user has permission to use that access level. If the user does not have "execute" permission to the file, the user is not allowed to use the selected key setting. If the user's permission to the file includes the "execute" permission, the user will be allowed to select the keyswitch setting.

Security Directory Structure - GUS

For GUS, the install program creates a Security directory and its associated substructure under the C:\Program Files\Honeywell\TPS\Emulators tree that resembles the following:

```
C:\Program Files\Honeywell
  TPS
    Emulators
      Security (shared as a read-only share name "GUS Security")
```

The AddBoard utility (normally runs as part of the installation process) creates *structures* under the Security directory on a board-by-board basis, as follows:

```
Honeywell\TPS
  Emulators
    Security (shared as a read-only share name "GUS Security")
      TdcBoard0
        Native Window
        LCNP Status
        Debug Window
        Operator
        Supervisor
        Engineer
```

5. Features of Native Window


5.4. Security

The files Native Window, LCNP Status, and Debug Window are proxies for the programs that can connect to an LCNP board. When one of these programs is instructed by the user to connect to a local or remote LCNP board, it first attempts to open the corresponding file. If the File/Open is not successful, (either because access settings do not permit it, or because the file does not exist), the connection is denied.

The Operator, Supervisor, and Engineer files are proxies for the key settings to the LCN attached to an LCNP board. Native Window verifies the current signed-on user's permission to access the LCN at the specified key level. The user has permission to access the LCN using that key setting. On a GUS, the Security share must be enabled following procedures found in the section, Remote Access Procedures, TP08W TPS System Implementation Guide


Security Directory Structure – ES-T

The security structure on an ES-T is one where the proxy files reside under C:\HWIAC\Security as shown in the figure. The Security share is automatically enabled for remote access as part of installation. At the host, enable access for the remote Native Window client(s) using the Native Window page under the System Management/Configuration Utility/Board0. The Windows account of the Remote Native Window user must be a member of one of the local Experion High Security groups at the host node.

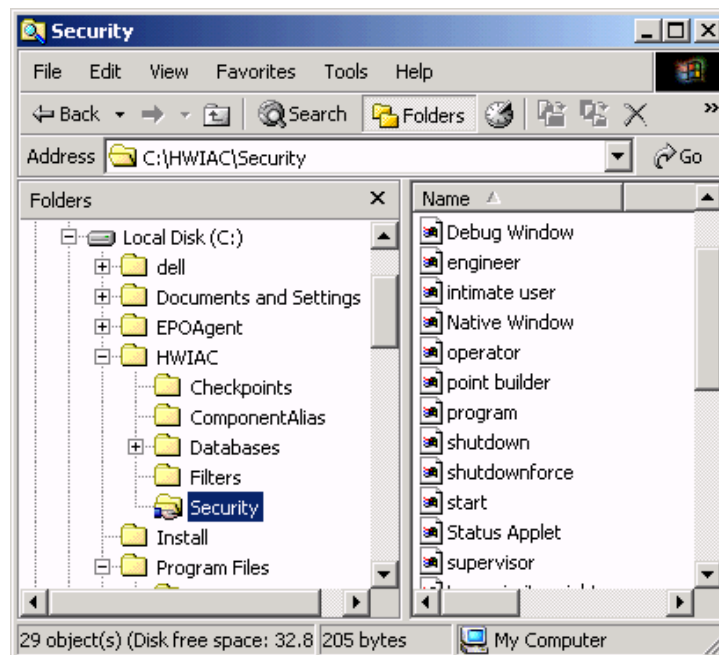

Enable Remote Access from Configuration Utility

For an ES-T and GUS, remote access is enabled from the Native Window page of the Configuration Utility as shown in the following figure. Additional information about setting your preferences for Connection Controls is found in the TP20WConfiguration Utility User's Guide.

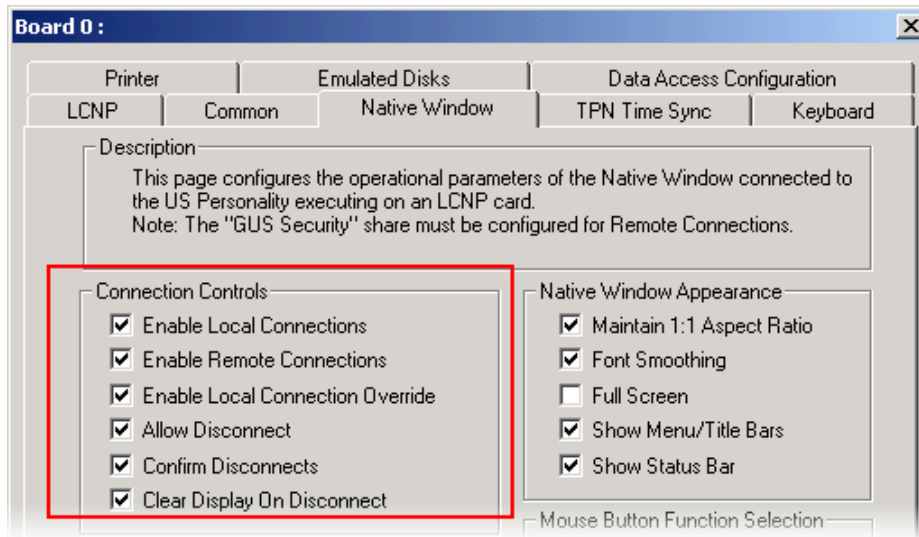

For remote access, in addition to the Windows security, the appropriate selection must be made on the Native Window page of the Configuration Utility.

Users, Groups, and Permissions

Users

A user account defines a user to Windows OS.

The user account includes the following:

- the user name and password required to log on
- the group or groups the user is a member of
- the user's rights/permissions while using the assigned computer

When a user logs on and attempts to perform a certain action, the user's rights/permissions are checked to determine whether the user is authorized to perform that action.

5. Features of Native Window

5.4. Security

Groups

A group is an account that contains user accounts. Groups are used to give users permissions to perform system tasks and to grant access to resources, such as file, directories, and printers.

Group accounts provide a convenient method of controlling access for users who perform similar tasks (for example, Operators and Supervisors). By placing multiple users in the same group, you can assign access to all of the users at the same time by assigning permissions to the group.


User accounts can be modified individually, even if they are members of one or more groups.

Permissions

- “Read” access permission is the minimum required to run and/or to connect.
- If user inherits No Access through any path, the user has No Access.
- A user may have permission to run an executable but is allowed to connect the executable only to certain LCNPs.

6. Native Window Menu Bar Detailed Descriptions

6.1 File Menu

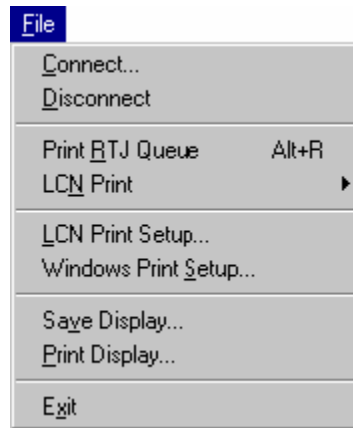

Connect

The **Connect** selection enables connection to a local or remote LCNP (LCN Processor) board:

- Local = LCNP board is located in the operator station node in which the Native Window is running.
- Remote = LCNP board is located in another operator station node on the same LCN or in a PIN-connected operator station node located on a different LCN.

When the Native Window program begins, it attempts to connect to the LCNP in the local operator station node. If successful, this menu item becomes disabled. If unsuccessful, or if a File/Disconnect has been performed, this menu item is enabled.

6. Native Window Menu Bar Detailed Descriptions

6.1. File Menu



ATTENTION: An LCNP board in the local machine is not required to connect to an LCNP in a remote machine.

Remote connections are subject to security constraints that include the following:

- Permission to run the program
- Permission at the operator station containing the LCNP to allow remote connections
- Permission at the operator station containing the LCNP for the specific current logged-in user to make a connection

To connect the Native Window to an LCNP, perform the steps in the table below:

Step	Action	Result
1	Select Connect from the File drop-down menu. OR Click the Connect/Disconnect button on the Native Window Status Bar. 	The LCNP Selection dialog appears
2	Specify the computer you want to connect to: • Click Local to connect to the local machine. • Click Network to connect to a remote machine, type the computer name as a simple name (for example, no forward or backward slash characters), and then click OK.	
3	Click OK .	Connection may take up to several minutes on a busy network.

Disconnect



ATTENTION

It is not necessary to disconnect prior to terminating the Native Window program. An automatic disconnect occurs when the program terminates.

Perform the following steps to disconnect the Native Window from the LCNP prior to reconnecting to an alternate LCNP.

Step	Action	Result
1	Select Disconnect from the File drop-down menu.	The Native Window client area turns solid black.
	OR	Disconnection may take up to several minutes
	Click the Connect/Disconnect button on the Native Window Status Bar.	



Print RTJ Queue

The TPS system makes periodic entries in the Real Time Journal (RTJ). If a continuous printer is selected in the printer settings, these entries appear on the printer as they occur. However, if a batch-mode printer is configured, the entries are collected for printing later. These collected messages can be printed on demand by clicking the RTJ button, or they can remain in the queue until the Idle Flush Time or Queue Length setting in Configuration Utility is met.



REFERENCE - INTERNAL

Refer to the *Printer Selection* section in the *TPS System Configuration Utility User's Guide* for information.

When RTJ events are available for printing, but the preconfigured time for automatically flushing the print queue has not yet expired, the **Print RTJ Queue** menu selection is enabled. The Status Bar **RTJ** button is also enabled.

6. Native Window Menu Bar Detailed Descriptions

6.1. File Menu

To demand print RTJ events in printer queue, execute the following procedure:


Step	Action	Result
1	Select Print RTJ Queue from the File drop-down menu. OR Click the RTJ button on the Native Window Status Bar. 	Queued Real Time Journal entries print.



TIP

An NCF option allows the user to control header/trailer messages. For an operator station RTJ queuing to work properly on a batch-mode printer, the user must configure the NCF System Wide Values > Console Data > Real Time Journal Header/Trailer Messages, then select BEG or END. This setting is not required for a continuous-mode printer.

LCN Print

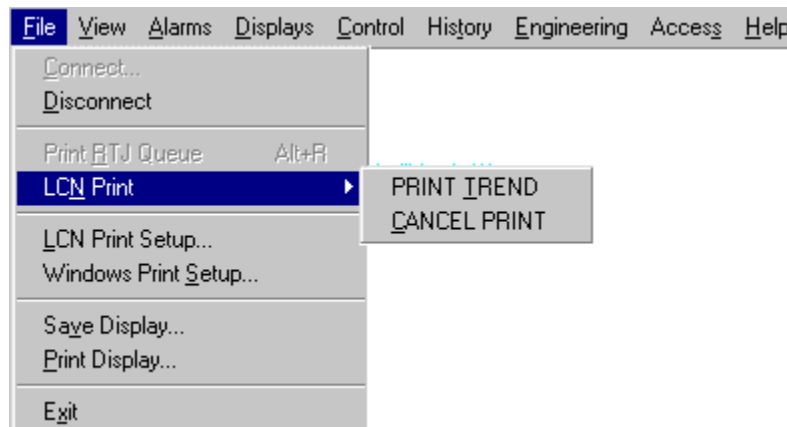

From this menu you can either print Active Trending or Cancel, abort printing on any printer on the console.

The PRINT TREND option in this menu can be disabled if you check the **Disable Print Trend** box in the Native Window page of the Configuration Utility.

LCN Print Setup

The **LCN Print Setup** affects LCN-initiated printing activities, such as trend prints, and Real Time Journals.

If the station supports LCN-initiated printing through US printer emulation (that is, if a printer is configured in the NCF), then configure the LCN Print Setup and Windows Print Setup to be the *same*. **Note:** When you add a Windows printer to a GUS, choose the "Local printer" option if the printer is to support LCN-initiated printing. If the printer is to be a dedicated LCN alarm printer, then choose "Continuous Printer Selection" in the LCN Print Setup, as shown in the following figure.

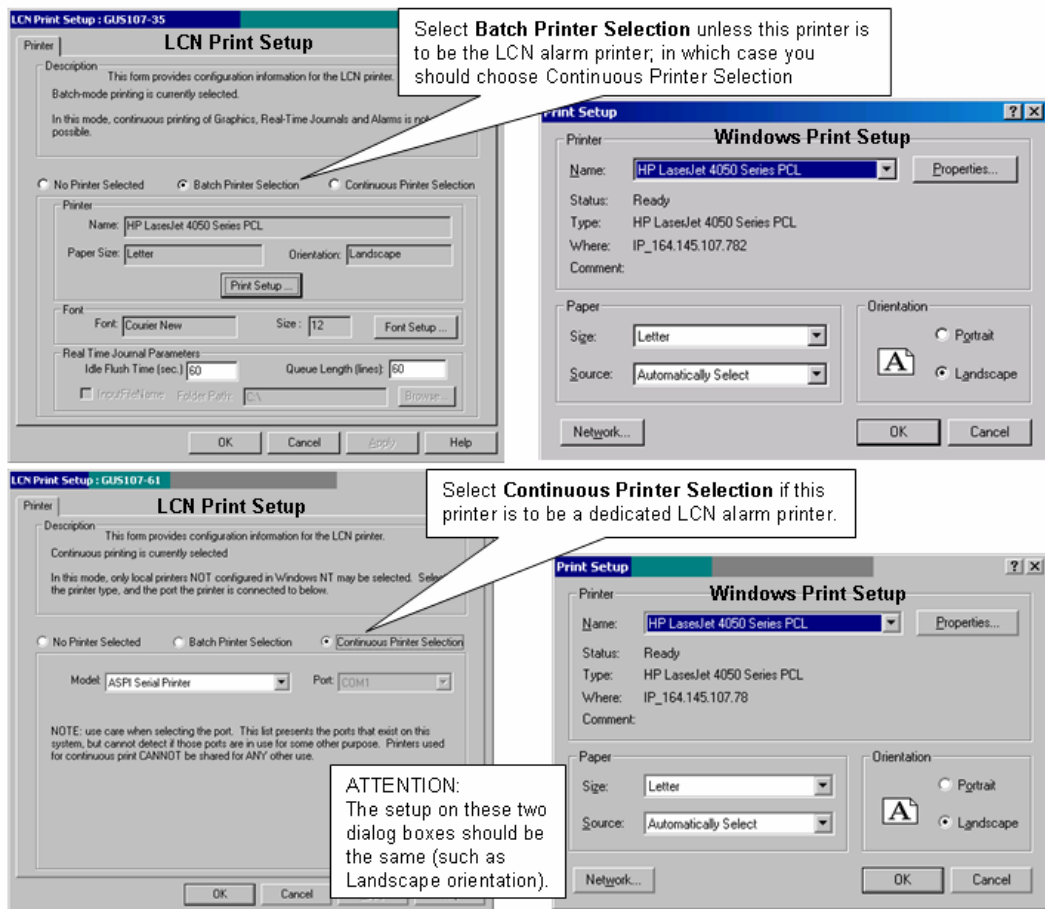


Figure 7 Example Windows Print Setup and LCN Print Setup

6. Native Window Menu Bar Detailed Descriptions

6.1. File Menu

If a Windows printer is to do LCN (US)-side printing, then the following must be done:

- Configure the printer in the **NCF**, and
- Add the printer to Windows using the **“Local printer”** option, not the “Network printer” option, and
- Configure the Native Window **LCN Print Setup** to be the same as the **Windows Print Setup**.

Note: Windows printers configured in "Batch Printer mode" do not support LCN graphics printing.

For the detailed steps to add a Windows printer to the GUS and configure the Native Window, refer to the section "*Configure a Windows Printer for GUS*" in this guide.



REFERENCE - INTERNAL

Refer to the Board Configuration Pages, Printer Page section in the System Components - *Configuration Utility User's Guide* for additional configuration information.

Save Display

Save a bitmap image of the current display.

Two types of images can be saved:

- Normal bitmap
 - A normal bitmap image captures the screen exactly as it appears, in color with a black background.
- Inverted bitmap
 - The inverted bitmap feature converts all black pixels to white and all white pixels to black, resulting in a white-background image. Pixels of other colors remain unchanged.

Saved bitmaps contain only the client area of the window. The Status Bar, Menu Bar, and window borders are not included. To obtain a bitmap of the entire Native Window including Status Bar, Menu Bar, and window borders, use the Print Screen key, paste the clipboard-stored image into Paintbrush, crop the image as desired, and save the result into a file.



TIP

Display names saved in Windows OS must be limited to 8 characters if they are to be called by way of the Schem field in the Native Window.

6. Native Window Menu Bar Detailed Descriptions

6.1. File Menu

Windows Print Setup

The **Windows Print Setup** affects printing for the Windows-related functions, such as the Native Window File>Print Display function.

See the "LCN Print Setup" section for more information.

Print Display

Print the current display to the station's Windows printer.



TIP

- You can only use this Print Display function to print on Windows printers.
 - Windows printers configured in "batch printer mode" do not support LCN graphics printing (see the "LCN Print Setup" section in this guide).
-



ATTENTION

Honeywell does not support the LCN console printer reassignment functionality for GUS, because the behavior is inconsistent. Do not use the Console Printer Assignment display to reassign a GUS printer to a remote station, or to reassign a remote station's printer to a GUS.


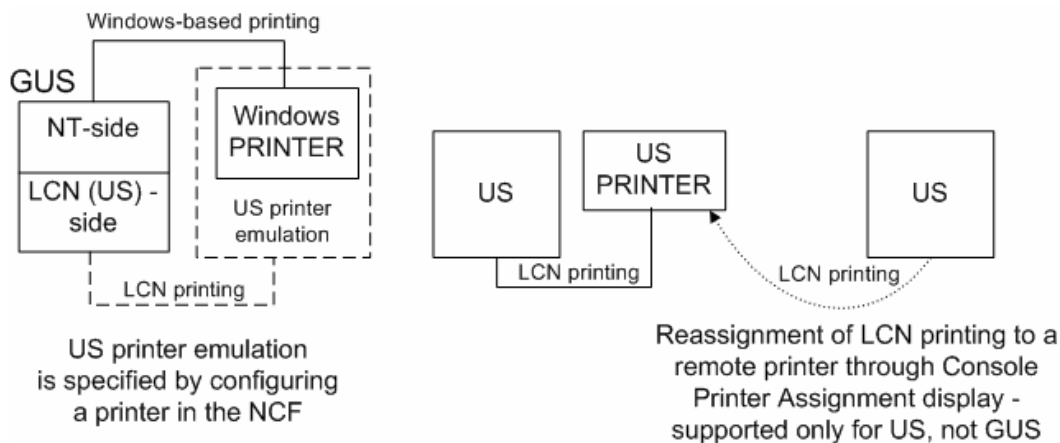


Figure 8 Diagram of LCN and Windows Based Printing

To print the current Display

Follow the steps in the table below to print the current display to the operator station assigned printer.

Step	Action
1	Select Print Display from the File drop-down menu.
2	The Print Display dialog box appears.

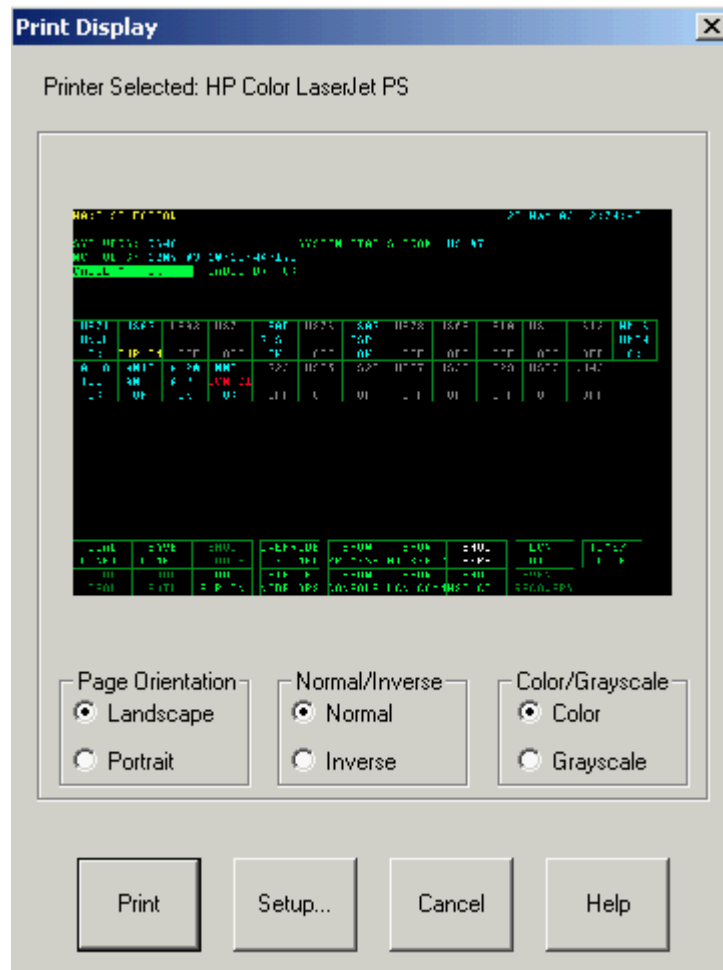

6. Native Window Menu Bar Detailed Descriptions

6.1. File Menu


Step	Action
3	Choose the desired Page Orientation by selecting the appropriate radio button: Landscape or Portrait.
4	Choose the desired pixel color of everything in the client area (excluding the Status Bar, Menu Bar, and window borders) by selecting the appropriate radio button: Normal or Inverse. • Normal keeps the colors the same as they appear on the screen. • Inverse converts all black pixels to white and all white pixels to black, leaving the pixels of all other colors unchanged.
	TIP: Typically, this function is employed to invert the background color of the current display to reduce toner/ink usage when the display is printed
5	Choose the desired color mode by selecting the appropriate radio button: Color or Grayscale .
6	If the currently assigned printer is not the one you want to use, select Setup... to pick the one you want.
7	Select Print .
8	The client area of the current display, which excludes the Status Bar, Menu Bar and window borders, is printed out on the assigned printer.

	TIP You can only use this Print Display function to print on Windows printers. You have to use the Universal Station (US) PRINT DISPLAY function to print on printers connected to a US. Reassigning a US printer to an operator station - connected printer and then requesting a PRINT DISPLAY at the US will only work if: • the operator station printer is configured as a continuous-mode printer, and • the selected printer type supports LCN graphics printing (for example, the Signum printer). Operator station batch-mode printers do not support LCN graphics printing.
---	--

6. Native Window Menu Bar Detailed Descriptions

6.1. File Menu

To avoid printing blank pages when using HP4 and 5 series printers, be sure the Negative checkbox is turned off on the Halftone Color Adjustment dialog. (Start > Settings > Printers > File > Document Defaults... > Advanced > Document Options > Halftone Color Adjustment.)

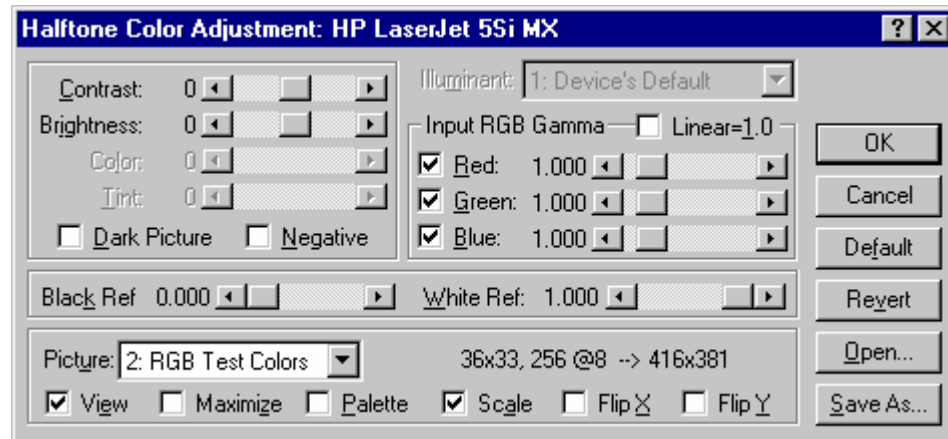

Exit

Exit the Native Window.

An automatic disconnect is performed if the Native Window is currently connected.




TIP

If SafeView has designated the Native Window as non-closable, the Exit selection in the File menu is automatically disabled.

6. Native Window Menu Bar Detailed Descriptions

6.2. View Menu

6.2 View Menu



Hide Menu Bar

To display the Native Window without the Menu Bar, execute the following procedure:

Step	Action	Result
1	Select Hide Menu Bar from the View drop-down menu.	The Menu Bar disappears

The **Menu Bar** menu selection toggles on and off when it is selected and deselected.

The Menu Bar can also be displayed/hidden by clicking the right mouse button and selecting/deselecting **Menu Bar** from the drop-down menu.

Status bar

To display the Native Window Status Bar, follow the steps in the following table.

Step	Action	Result
1	Select Status Bar from the View menu in the Native Window.	The Status Bar appears at the bottom of the Native Window and a check mark appears in front of the menu item.



The **Status Bar** menu selection toggles on and off when it is selected and deselected.

The Status Bar can also be displayed/hidden by clicking the right mouse button and selecting/deselecting **Status Bar** from the drop-down menu.

The Status Bar is divided into the following areas:

- Prompt
 - Connect/Disconnect Status
 - ACK
 - SIL
 - A C M S Alarm Message Indicators
 - Real Time Journal Queue
 - Keyswitch Position
 - Insert Character Mode
 - LEDs
-

Prompt

The Prompt pane, located at the extreme left of the status bar, provides a help message for any selected menu item, as well as various warnings and information.

6. Native Window Menu Bar Detailed Descriptions

6.2. View Menu

Connect/Disconnect status

The Connect/Disconnect button displays the following icons:

- Connected to LCNP



When connected, the button can be clicked to disconnect from the LCNP.

- Disconnected from LCNP



When disconnected, the button displays a broken cable in red and can be clicked to initiate reconnection.

To disconnect/reconnect, refer to Connect and Disconnect under the File Menu section.

ACK

Performs a TPS ACKNOWLEDGE action. The TPS ACKNOWLEDGE function is used to acknowledge various context-dependent conditions within the TPS system. Clicking the **ACK** button performs the same function as selecting the Control/ACK menu item.

SIL

Performs a TPS SILENCE action. The TPS SILENCE function is used to silence any audible alarms that are occurring. Clicking the **ACK** button performs the same function as selecting the Control/SILENCE menu item.

A C M S

The A C M S buttons indicate LCN alarms and messages and call up their corresponding displays.



Click any button to call up its corresponding display.

If the letter showing in red or yellow is....	Then there are messages or alarms on this display...
A	Alarm Summary
C	Console Status
M	Message Summary
S	System Status

Blinking and colored letters correspond to the LED indicator lights on the Universal Station Operator keyboard.

For the Alarm Summary letter "A" only:

If the letter is...	Then the message is...
RED	EMERGENCY Priority
YELLOW	HIGH or LOW Priority
BLINKING	Unacknowledged

If there are no display messages, the letter is solid black.

6. Native Window Menu Bar Detailed Descriptions

6.2. View Menu

Real Time Journal Queue

The Real Time Journal Queue button displays the letters "RTJ" in black when there are Real Time Journal messages in the print queue. This will occur only if a batch-mode printer is configured. Continuous-mode printers print the Real Time Journal entries as they occur.



These messages can be printed on demand by clicking the RTJ button, or they can remain in the queue until the Idle Flush Time or Queue Length setting in Configuration Utility is met.

Selecting Print RTJ Queue from the File drop-down menu can also print RTJ messages.

When there are no messages in the RTJ queue, the RTJ button is disabled.

Keyswitch Position

The Keyswitch Position button indicates the current keyswitch position in use when a "connect to the LCNP" request is made. The Signon Manager validates the position to which the key may be set. If an unsupported level is selected, the text of the button will still show the key position in use on the LCNP; however the text will be shown in yellow for GUS only.



ENG	Keyswitch position set to Engineer
SUP	Keyswitch position set to Supervisor
OPR	Keyswitch position set to Operator
VIEW	Keyswitch position set to View-Only
- - - -	Information not available (for example, when the node is not loaded)

To change the keyswitch position for a GUS, perform the following procedure:

Step	Action	Result
1	Click the Keyswitch Position button (ENG, SUP, OPR).	The Select Keyswitch Position dialog appears.
2	Select the Engineer , Supervisor , Operator , or View Only button. Note that Native Window treats Operator and View Only identically. A node can be configured as View Only in the NCF.	The keyswitch changes to the selected level and the text on the keyswitch button changes accordingly.
	With TPS R420/TPN R682 and later, Native Window treats the Operator and the View Only login users differently.	
	Select the View Only button for changing the access level of the node to View Only.	The CURRENT DEFAULT value changes to VIEW. The text on the keyswitch button changes to VIEW.
	Select the Operator button for changing the access level of the node to OPR.	The CURRENT DEFAULT value changes to OPR. The text on the keyswitch button changes to OPR.
	Note: The CURRENT DEFAULT value can be changed to OPR/VIEW by the privileged user.	

Follow the instructions under Configuring Signon Manager in the TPS System Implementation Guide to change the keyswitch position for an ES-T.

When the Native Window is shut down, the Keyswitch Position button becomes the **LOAD** button.



To reload the station, click **LOAD** to begin the loading sequence. This performs the same function as the **LOAD** selection from the **Control** drop-down menu, or the **LOAD** key on the keyboard.

6. Native Window Menu Bar Detailed Descriptions

6.2. View Menu

Insert Character Mode

The Insert Character Mode button displays the letters "INS" when the keyboard is in the insert instead of the overwrite character mode.




The Insert Character Mode button displays the letters "OVR" when the keyboard is in the Overwrite instead of the Insert character mode.



Click the Insert Character Mode button to toggle between insert and overwrite.

LEDs

The LEDs button corresponds to the physical LEDs on a K2LCN/K4LCN board.



It displays **LEDs nn**, where **nn** (a positive number) is the connected operator station node's physical address.

When **nn** is a negative number, it indicates a diagnostic or error condition.

To call up the LCNP Status dialog, execute the following procedure:

Step	Action	Result
1	Click the LEDs button on the Native Window Status Bar.	The LCNP Status dialog appears.

Clicking the **LEDs** button on the Status Bar calls up the **LCNP Status** dialog when the Native Window is connected. If the Native Window is disconnected, the LEDs button is inactive.

The LCNP Status application can be used to provide decoding for the LED values.

Default Size

The Default Size selection is used to return the Native Window to its default size when it has been scaled or stretched.

Double Size

The Double Size selection is used to double the size of the Native Window.



ATTENTION

To double the size of a Native Window, the Windows OS Display Settings must be at 1280x1024 pixels or higher. At lower settings, the Double Size selection will be disabled (grayed out).



ATTENTION

In Windows 2000 and greater, maximizing the Native Window does not increase the font size properly.

To properly increase the font size of the Native Window, use the procedure described in the "Increasing the Font Size for the Native Window" section of *TPS System Implementation Guide for Windows 2003/XP*, TP08X.


6. Native Window Menu Bar Detailed Descriptions

6.2. View Menu


Font Smoothing

When Font Smoothing is selected, the Native Window renders fonts in an enhanced way that results in smoother characters at all window sizes.

Font Smoothing turned off

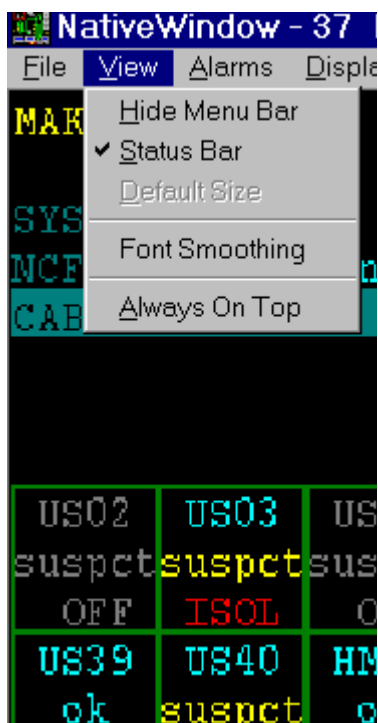

Font Smoothing turned on

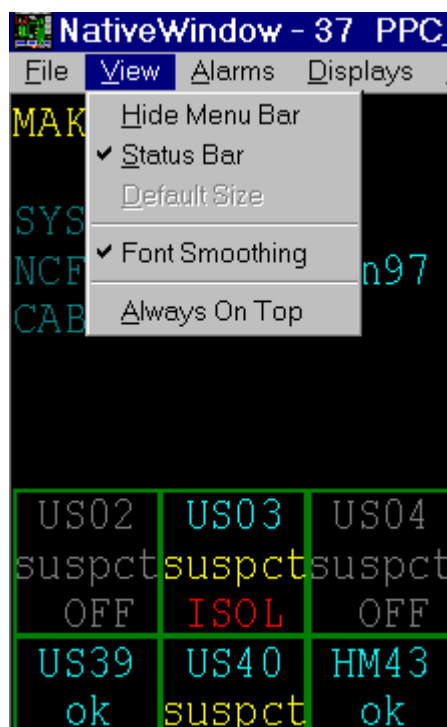

When enabled, font smoothing may be turned on or off at any time by selecting Font Smoothing from the View drop-down menu.



REFERENCE – INTERNAL

Refer to the Native Window Appearance section in the TPS System Configuration Utility User's Guide for information.

Always On Top

To keep the Native Window on top of all other windows automatically, execute the following procedure:

Step	Action
1	Select the View drop-down menu.
2	If the Always On Top selection is check marked, the feature is activated and the Native Window will remain on top of any other open windows.
3	If the Always On Top selection is not check marked, select it to activate the function.
4	When Always On Top is activated, a check mark appears in front of the menu item.

Note that **Always On Top** toggles on and off when its menu item is selected and reselected.

6. Native Window Menu Bar Detailed Descriptions

6.3. Alarms Menu

6.3 Alarms Menu

ACK

Acknowledge console alarms and messages.

SILENCE

Silence all audible console alarms.

ALARM SUMM

Call up the Area Alarm Summary display.

UNIT ALARM SUMM

Call up a specified Unit Alarm Summary display.

The system prompts for the Unit number.

ALARM ANNUNC

Call up the Alarm Annunciator display.

MSG SUMM

Call up the Message Summary display.

MSG CONFIRM

Confirm a selected message on the Message Summary display.

MSG CLEAR

Confirm an ACK/CNFM message on the Message Summary display.

6.4 Displays Menu

Operating

The following items can be selected from the **Operating** submenu to call up TPS system Operating displays:

- Detail display
- Group display
- Schematic display
- GO TO
- Associated display
- Help
- Prior display
- Display Back
- Display Forward
- Page Back
- Page Forward

DETAIL

Call up the Point Detail display.

The system prompts for the Point ID name.

GROUP

Call up the Group display.

The system prompts for the Group number.

SCHEMATIC

Call up a specified Picture Editor, GUS, or HMIWeb schematic display.

The system prompts for the schematic name.

6. Native Window Menu Bar Detailed Descriptions

6.4. Displays Menu

GO TO

Select a point on a group display.

The system prompts for the slot number.

ASSOC DISP

Call up the configured Associated display.

This selection is effective only when the current display has a configured associated display.

HELP

Call up the pre-configured Help display associated with the current display.

PRIOR DISP

Call up the display shown prior to the current display.

DISP BACK

Call up the next lower-numbered display of the same display type.

DISP FWD

Call up the next higher-numbered display of the same display type.

PAGE BACK

Call up the next lower-numbered page of a multiple-page display.

PAGE FWD

Call up the next higher-numbered page of a multiple-page display.

System

The following items can be selected from the **System** submenu to call up TPS system displays:

- Console Status
- System Status
- System Menu

CONSOLE STATUS

Call up the Console Status display.

SYSTEM STATUS

Call up the System Status display.

SYSTEM MENU

Call up the System Menu display.

User Defined

The following items can be selected from the **User Defined** submenu to call up configurable-key displays:

- User Defined 1-6
- Edit
- Refresh

USER DEFINED 1-6

Call up a configurable-key display.

These menu selections function in the same way as the configurable buttons on the Operator keyboard. When positions 1 - 6 of the button file in the Area Database are configured, they can be linked to these User Defined positions and the corresponding displays can be called up with the User Defined submenu.

6. Native Window Menu Bar Detailed Descriptions

6.4. Displays Menu

It is important to note that the user-defined keys are entered only as text and do not alter the actual keystrokes that are sent to the TPS system. The keystrokes that are sent are always the special six keys of the Operator keyboard. The meaning of these keys is defined in the TPS system configuration using the button file. The text appearing in the menu is set with the GUS Configuration Utility program. Some sophisticated users may select different meanings for these keys as a function of what area is loaded in the TPS node. However, there is no mechanism provided to automatically change the text in these menu items. For these cases, it is recommended that the buttons simply be named Button1, Button2, etc. This is the same type of interpretation that must be provided for a classic Operator keyboard when an area change is made, but button legends remain the same.

The configured display titles appear here if they have been entered in the Configuration Utility Keyboard configuration, or in the Edit... section of the User Defined submenu.

Edit

Edit the list of User Defined displays.

The six buttons on the lower-left side of the Integrated Keyboard Operator Control Panel correspond to the six User Defined key assignments.

The text appearing in these menu items (though not the actual keystrokes associated with the button file) can be changed through this mechanism.



REFERENCE - INTERNAL

Refer to the *Keyboard Page* section in the *TPS System Configuration Utility User's Guide* for information.

You can also refer to *User Defined 1-6*.

Refresh

Reads the User Defined key configuration on a remotely connected operator station.

On a locally connected operator station, this occurs automatically and this menu item is disabled.

6.5 Control Menu

MAN

Place a selected point in Manual mode.

AUTO

Place a selected point in Automatic mode.

NORM

Place a selected point in Normal mode.

SP

Enable changes to a Setpoint value.

This function is mode-dependent.

OUTPUT

Enable changes to an Analog or Digital Output value.

This function is mode-dependent.

FAST

Increase the rate of display information updates.

Selection and deselection of **FAST** toggles between the normal 4-second update and fast update.

The toggle's on or off status is indicated by an LED on the Integrated Keyboard's FAST button, not by a check mark on the menu item.

6. Native Window Menu Bar Detailed Descriptions

6.5. Control Menu

LOAD


Prepare the operator station for personality loading.

Step	Action	Result
1	Select the LOAD key, select LOAD from the Control drop-down menu, or click the LOAD button on the Status Bar.	The prompt W, N, 1, 2, 3, 4, X? appears.
2	Normally, respond by typing W for Workstation load and pressing ENTER .	The following prompts appear in sequence: WORKSTATION HOSTED LOAD IN PROGRESS WORKSTATION HOSTED LOAD IS COMPLETE NODE STARTING UP NCF? N,1,2,3,4,X
3	Respond by typing N for Network and then pressing ENTER .	The System Status display appears; the operator station node is loaded.

When the station is not loaded, the LOAD button appears on the Status Bar and can be clicked to initiate loading.



6.6 History Menu

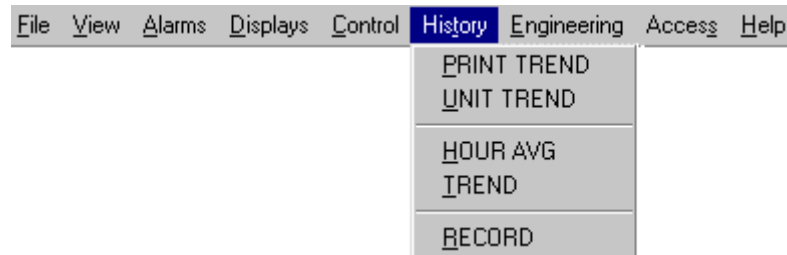

PRINT TREND

Trend printing behavior depends on whether you configure the printer for batch-mode or for continuous-mode.

The PRINT TREND option in this menu can be disabled if you check the **Disable Print Trend** box in the Native Window page of the Configuration Utility.

Batch-mode Printing

To correctly request a PRINT TREND from the US (by reassigning a US printer to an operator station printer) or to request a PRINT TREND from an operator station, the trend must be configured for numeric in the NCF under System Wide Values > Console Data > Printed Trend Format, then select [NUMERIC]. Printing of graphic trends is not supported.

Printing a numeric trend on an operator station printer works differently than on a US printer. The operator station printer uses the Windows OS print manager, which supports page prints. Group trends sent to an operator station printer are queued until a page of data has been queued or it has been 3 minutes since all trends were cancelled. The occurrence of either of the two previous conditions will cause the queued trend data to print.

Continuous-mode Printing

When a continuous-mode printer is configured, trend printing behaves much as it does on a classical Universal Station. If the selected printer supports LCN graphics printing, (for example the Signum printer), the NCF configuration can select either graphic or numeric printing. However, if the configured printer does not support LCN graphics printing, the NCF must select numeric printing.

6. Native Window Menu Bar Detailed Descriptions

6.6. History Menu

UNIT TREND

Call up a specified Unit Trend display.

The system prompts for the Unit number.

HOURLY AVG

Call up the Hourly Averages display from a Group display.

TREND

Call up the Group Trend display from a Group display or Trend a selected point.

RECORD

Activate trend pen recording.

6.7 Engineering Menu

MENU

Call up the Engineering Main Menu display.

CMD_MENU

Call up the Command Menu display (only active for certain functions).

On a PC-101 keyboard, this function can also be initiated by selecting the Shift and numeric Minus keys simultaneously.

HELP

Call up a pre-configured LCN Help display.

BREAK

Terminate execution of a current command.

On a PC-101 keyboard, this function can also be initiated by selecting the Ctrl and numeric Minus keys simultaneously.

CANCEL

Cancel current operation.

HOME

Move the cursor to the upper-left corner of the screen.

INS CHAR

Insert one or more characters. This function toggles between insert and overwrite. If insert is selected, the Status Bar indicates "INS," if overwrite, the Status Bar indicates "OVR."

Appearance

Select from the following **Appearance** menu items to change Picture Editor behavior attributes:

- Background
- Blink
- Intensity

6. Native Window Menu Bar Detailed Descriptions

6.7. Engineering Menu

BACKGRND

Change the behavior attribute to Reverse Background.

BLINK

Change the behavior attribute to Blink.

INTENSITY

Change the Intensity behavior attribute.

Colors

Select from the following Color submenu items to change Picture Editor color attributes to the selected color:

YELLOW	MAGENTA
RED	WHITE
CYAN	GREEN
BLUE	BLACK

6.8 Access Menu

Change Keyswitch Position (GUS Only)

To change the GUS keyswitch setting, execute the following procedure:

Step	Action
1	Select Change Keyswitch Position... from the Access drop-down menu.
2	The Select Keyswitch Position dialog box appears.
3	Select the button for the level access desired.
4	The keyswitch position is changed to your selection (after validation by SignOn Manager). If SignOn Manager determines that your user id is not allowed to set the selected level, the text of the keyswitch button on the status bar will be colored yellow.

A button on the Native Window Status Bar indicates the current keyswitch position. The Select Keyswitch Position dialog can also be called up by clicking on this button.



Refer to Status Bar Keyswitch Position for details.

Mount/Dismount Emulated Disks

Select **Mount/Dismount Emulated Disks...** from the Access drop-down menu to mount or dismount emulated disks.



REFERENCE - INTERNAL

Refer to the *Emulated Disks Page* section in the *TPS System Configuration Utility User's Guide* for information.

6. Native Window Menu Bar Detailed Descriptions

6.8. Access Menu

Edit User Defined Keys

Edit the list of User Defined displays.




REFERENCE - INTERNAL

Refer to the *Keyboard Page* section in the *TPS System Configuration Utility User's Guide* for information.

View LCNP Status

Select **View LCNP Status...** from the Access drop-down menu to call up the LCNP Status dialog.

This function can also be selected by clicking the LEDs button on the Native Window Status Bar.



REFERENCE - INTERNAL

Refer to the LCNP Status section in the *LCNP Status User's Guide* for more information.

LCNP Auto Restart

Step	Action	Result
1	Select LCNP Auto Restart ... from the Access drop-down menu to auto restart the LCNP	A checkmark appears on the LCNP Auto Restart menu item indicating that the LCNP auto restart feature is enabled.



This function can be configured using the Native Window tab of the Configuration Utility.

**REFERENCE - INTERNAL**

Refer to the Native Window Page section in the *TPS System Configuration Utility User's Guide* for additional information.

Reset LCNP Board

Step	Action	Result
1	Select Reset LCNP Board... to demand reset of the LCNP board.	A warning dialog appears.
2	Click Yes to confirm reset.	The LCNP board resets. To reload, refer to LOAD.

The Reset LCNP function can be configured in Configuration Utility to be active or non-active for the Native Window Access menu for Engineer and Supervisor users. It is never active for Operator users. When non-active, the menu selection appears with gray text.

**REFERENCE - INTERNAL**

Refer to the Extended Mode section in the *LCNP Status User's Guide* for more information.

6. Native Window Menu Bar Detailed Descriptions

6.8. Access Menu

US Cursor Movement

Within the Native Window, the cursor can operate in two different modes, Universal Station (US) and Windows.

- Windows XP Universal Station (US) Cursor mode
- Windows Cursor mode

Windows Universal Station Cursor Mode

With Windows, the Universal Station Cursor Mode attempts to simulate the behavior of the cursor on a classic Universal Station by displaying the US cursor separately from the mouse cursor.

In this mode, the basic mouse cursor shape is an arrow .

Depending upon where the mouse cursor is located, the basic shape will be changed in the following manner:

- a gunsight will added  when the mouse cursor is over a target
- a crosshair will be added  when the US is in the pixel graphics mode
- a mouse cursor (rectangle) will be added  when the mouse cursor is over a text input port (TIP) or a text input area

In this US cursor mode, the Native Window displays a separate US cursor that does not automatically move with the mouse cursor. Pressing the mouse select button while the mouse cursor is within the Native Window client area will (normally) cause the US cursor to move the current mouse cursor location. When the US cursor does move to the point of the mouse-click, it will normally assume the same cursor shape modification as the mouse cursor (arrow, gun sight, cross hair, or rectangle, as described below). Pressing the select mouse button triggers the same action that pressing your finger to the touch screen of a Universal Station would trigger. Releasing the select mouse button is equivalent to removing your finger from the touch screen, which will trigger the equivalent Universal Personality response.

In this mode, the US Cursor can move independently and therefore, can respond to movement requests from the LCN software without interfering with normal window operations.

The US cursor will appear in one of the following four different shapes, depending on the target area under the cursor:

- an arrow 
- a gun sight 
- cross hairs 
- a rectangle 

To select the US cursor mode, execute the following procedure:

Step	Action	Result
1	From the Access menu, select US Style Cursor.	A check mark is placed next to the US Style Cursor entry in the Access menu to indicate that it is the cursor mode currently selected.

6. Native Window Menu Bar Detailed Descriptions

6.8. Access Menu

Windows Cursor Mode

In the Windows Cursor mode, the mouse cursor can appear in one of four different forms. Moving this cursor around within the Native Window causes it to change shape, depending on the target area under the cursor. This is similar to pressing your finger against the touch screen of a Universal Station and moving it around. Clicking the mouse select button is equivalent to removing your finger from the touch screen of a Universal Station and will trigger the equivalent Universal Personality response.

TPN (LCN) software can request cursor relocation at any time. For example, the mouse cursor can automatically jump into a text input port (TIP) when a Native Window operation prompts the user for input. This can cause problems if it occurs at an inopportune moment. To help alleviate this problem, three cursor activation areas have been defined, such that the cursor will be moved only if

- the Native Window is the active window, and
- the cursor is currently within its specified activation area when cursor relocation is requested.

The three cursor-activation areas are:

- Anywhere
- Within Window
- Within Client Area

The Windows cursor will appear in one of the following four different shapes, depending on the target area under the cursor.


- an arrow 
- a gun sight 
- cross hairs 
- a rectangle 

6. Native Window Menu Bar Detailed Descriptions

6.8. Access Menu

To select the Windows Cursor mode, execute the following procedure:

Step	Action	Result
1	Select the desired cursor activation area (Anywhere, Within Window, or Within Client Area).	
2	Select Anywhere to allow automatic cursor response from anywhere within the window or desktop. OR Select Within Window to allow automatic cursor response from within the Native Window, including the client area (black background), the Status bar, the Menu Bar, and the window frame. OR Select Within Client Area to allow automatic cursor response from within the client area (black background) only, excluding the Status bar, the Menu Bar, and the window frame.	The Windows cursor replaces the US Style "pointing finger" cursor wherever it would normally appear. A check mark is placed next to the Access menu entry selected in step 2 to indicate that it is the cursor mode currently selected.

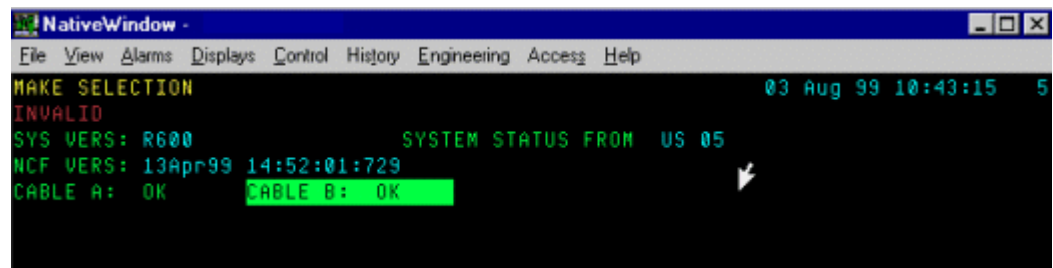

6. Native Window Menu Bar Detailed Descriptions

6.8. Access Menu

Input Focus

In the Windows Cursor mode, the Native Window must have input focus for the mouse cursor to move into the TIP. If another application has input focus when a TIP is opened (such as by a cross-screen invocation or other automatic processing) the cursor is NOT automatically moved to the TIP.

Even if the cursor does not move to the TIP, if the Native Window does have input focus, typing there will cause characters to be entered into the TIP correctly.

The currently active TIP remains enabled until a target or other TIP is activated, when you point and click with the mouse or tab and select using the keyboard. The action to enable the TIP is device-dependent.

Mouse/Trackball

The active TIP does not lose focus when the cursor moves out of it, only when the mouse is moved and clicked on another target or TIP.

Keyboard

Focus changes when the cursor is tabbed to another target or TIP. When the cursor is moved with the mouse or tab keys and the select button is used, the selection takes place at the new cursor position.

6.9 Help Menu

Accessing Help

Select items from the **Help** drop-down menu to call up the Native Window Users Guide from Knowledge Builder or information About Native Window.

Help Jumps

Step	Action
1	Select any topic that is double-underlined and appears in blue text to get more information on that topic from within Knowledge Builder.
2	From the browser button bar, click Back to return to the previous jump.

6. Native Window Menu Bar Detailed Descriptions

6.9. Help Menu

Honeywell

Honeywell Process Solutions
1860 W. Rose Garden Lane
Phoenix, AZ 85027 USA
1-800 822-7673