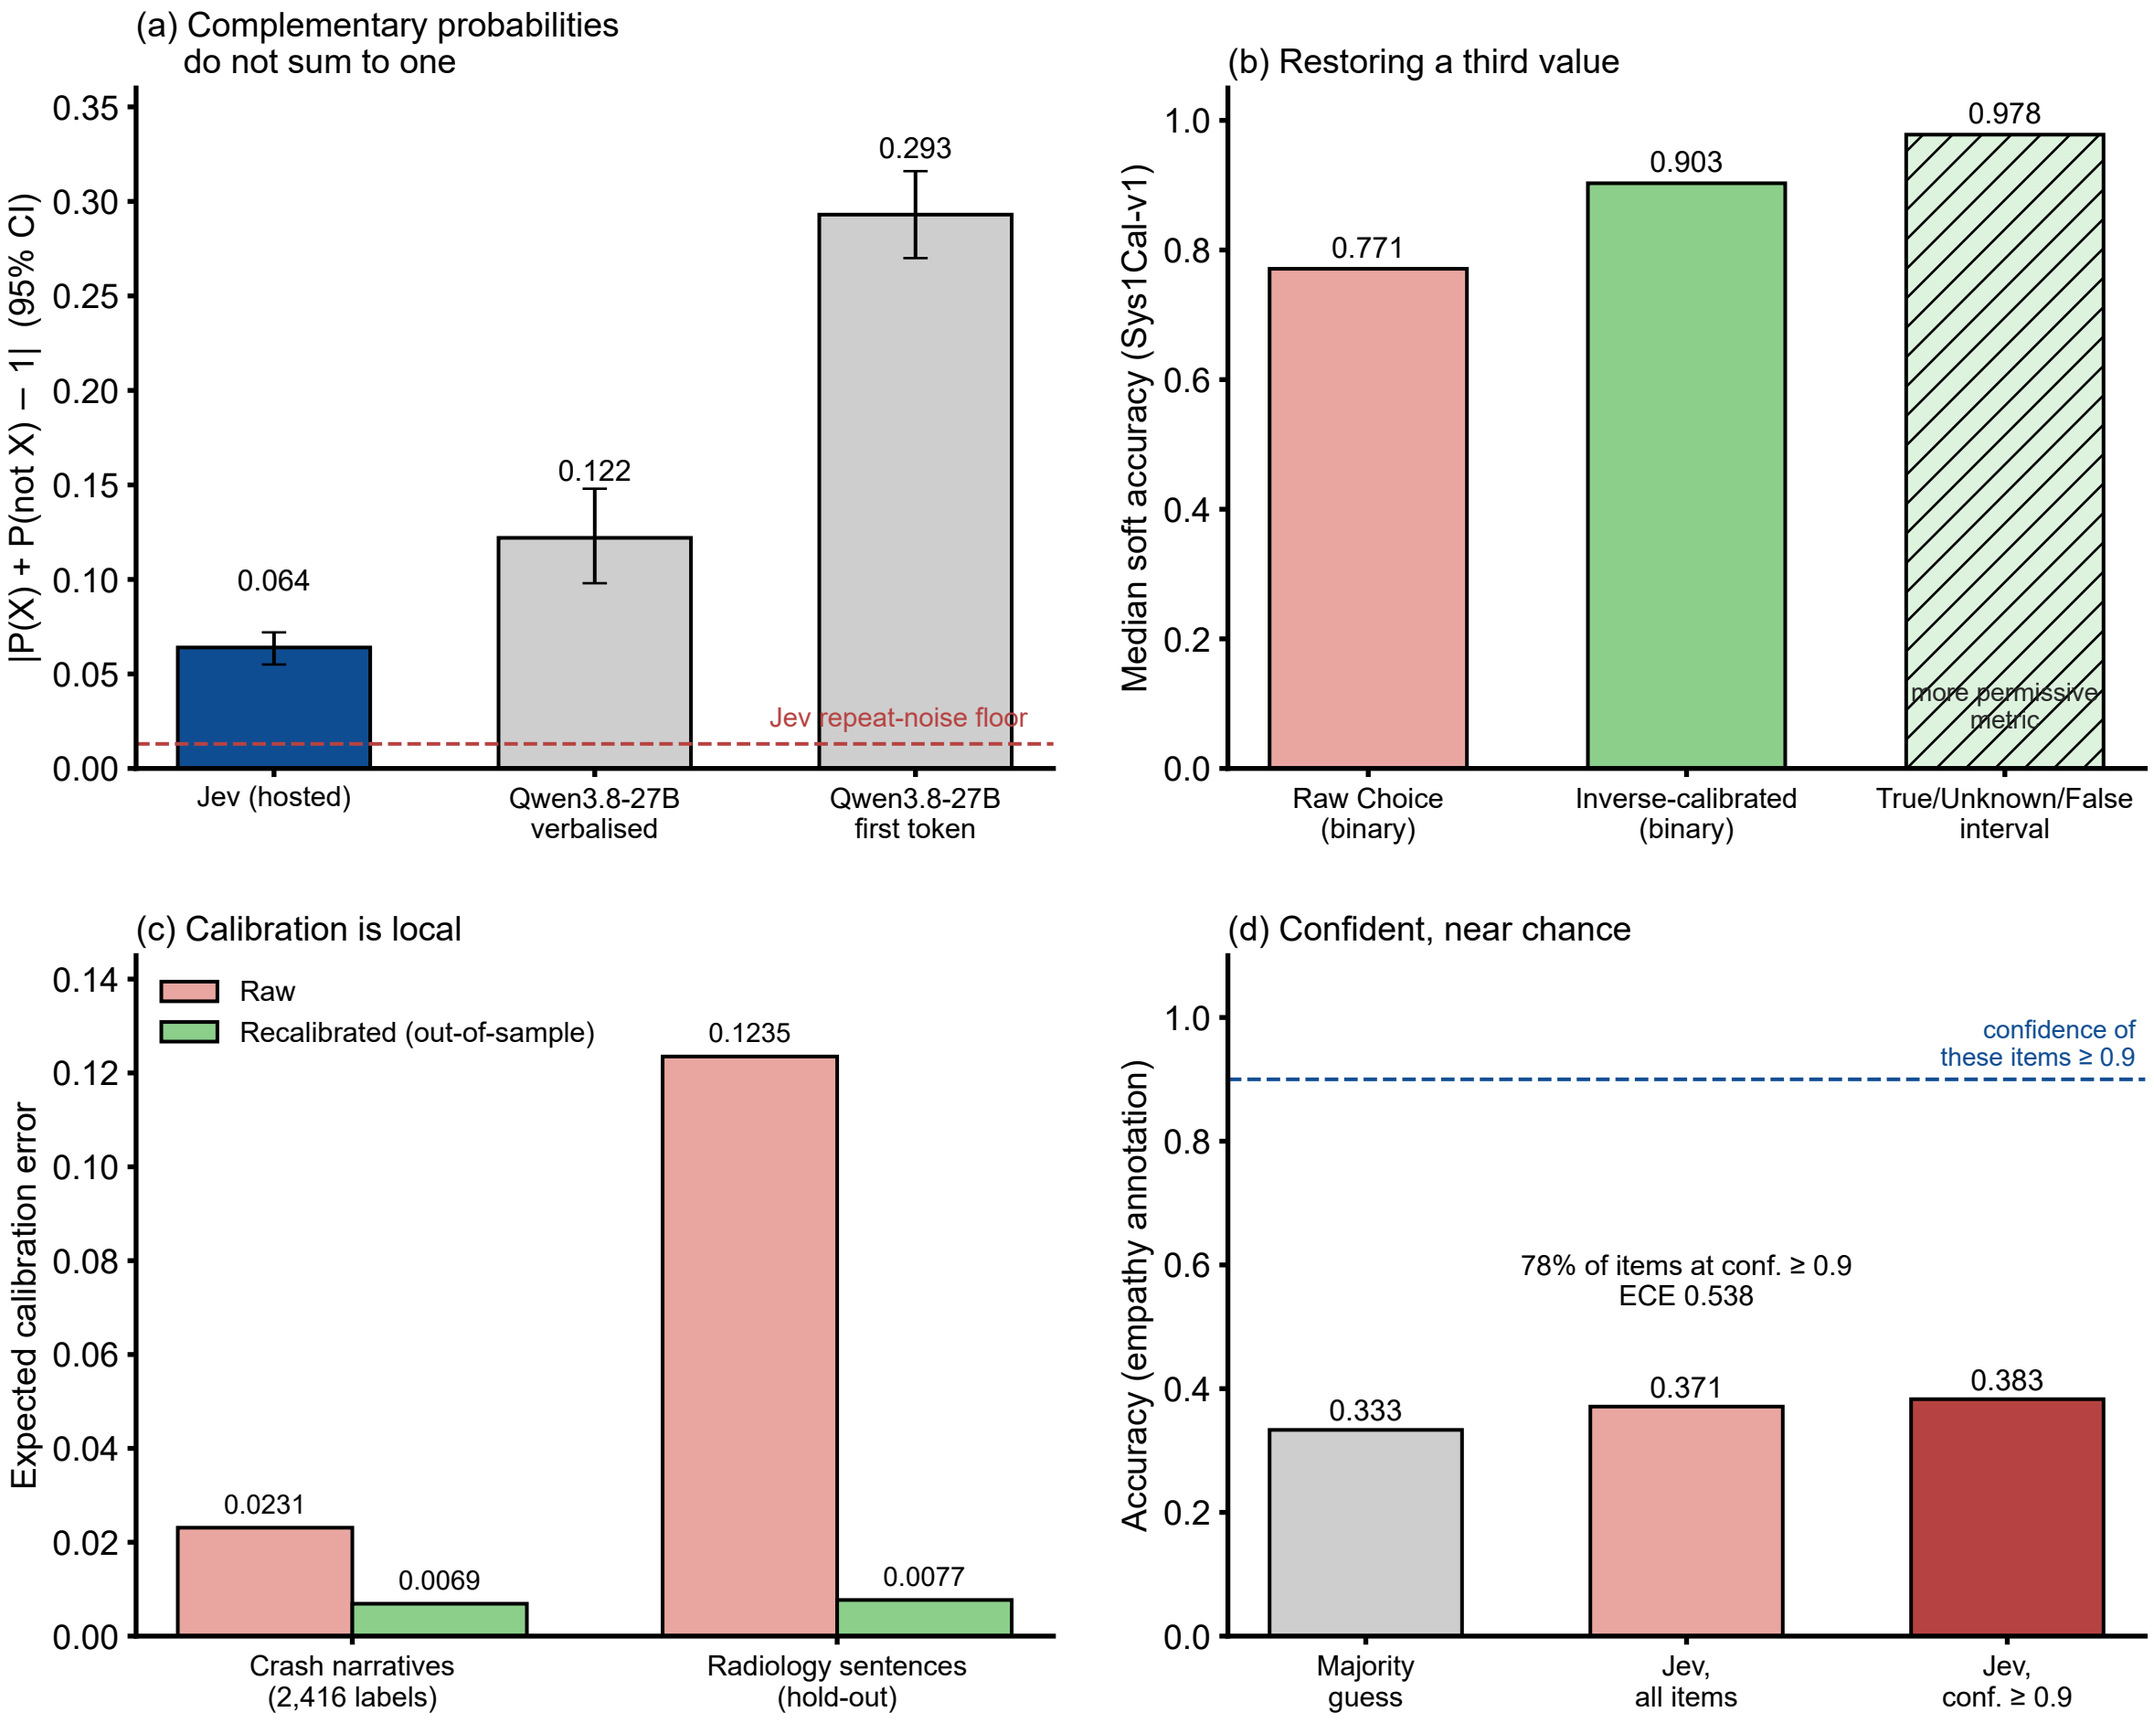
(a) Complementary probabilities do not sum to one
|P(X) + P(not X) − 1| (95% CI)
0.35
0.30
0.25
0.20
0.15
0.10
0.05
0.00
0.064
0.122
0.293
Jev repeat-noise floor
Jev (hosted)
Qwen3.8-27B verbalised
Qwen3.8-27B first token
(b) Restoring a third value
Median soft accuracy (Sys1Cal-v1)
1.0
0.8
0.6
0.4
0.2
0.0
0.771
0.903
0.978
more permissive metric
Raw Choice (binary)
Inverse-calibrated (binary)
True/Unknown/False interval
(c) Calibration is local
Expected calibration error
0.14
0.12
0.10
0.08
0.06
0.04
0.02
0.00
Raw
Recalibrated (out-of-sample)
0.0231
0.0069
0.1235
0.0077
Crash narratives (2,416 labels)
Radiology sentences (hold-out)
(d) Confident, near chance
Accuracy (empathy annotation)
1.0
0.8
0.6
0.4
0.2
0.0
confidence of these items ≥ 0.9
78% of items at conf. ≥ 0.9
ECE 0.538
0.333
0.371
0.383
Majority guess
Jev, all items
Jev, conf. ≥ 0.9