
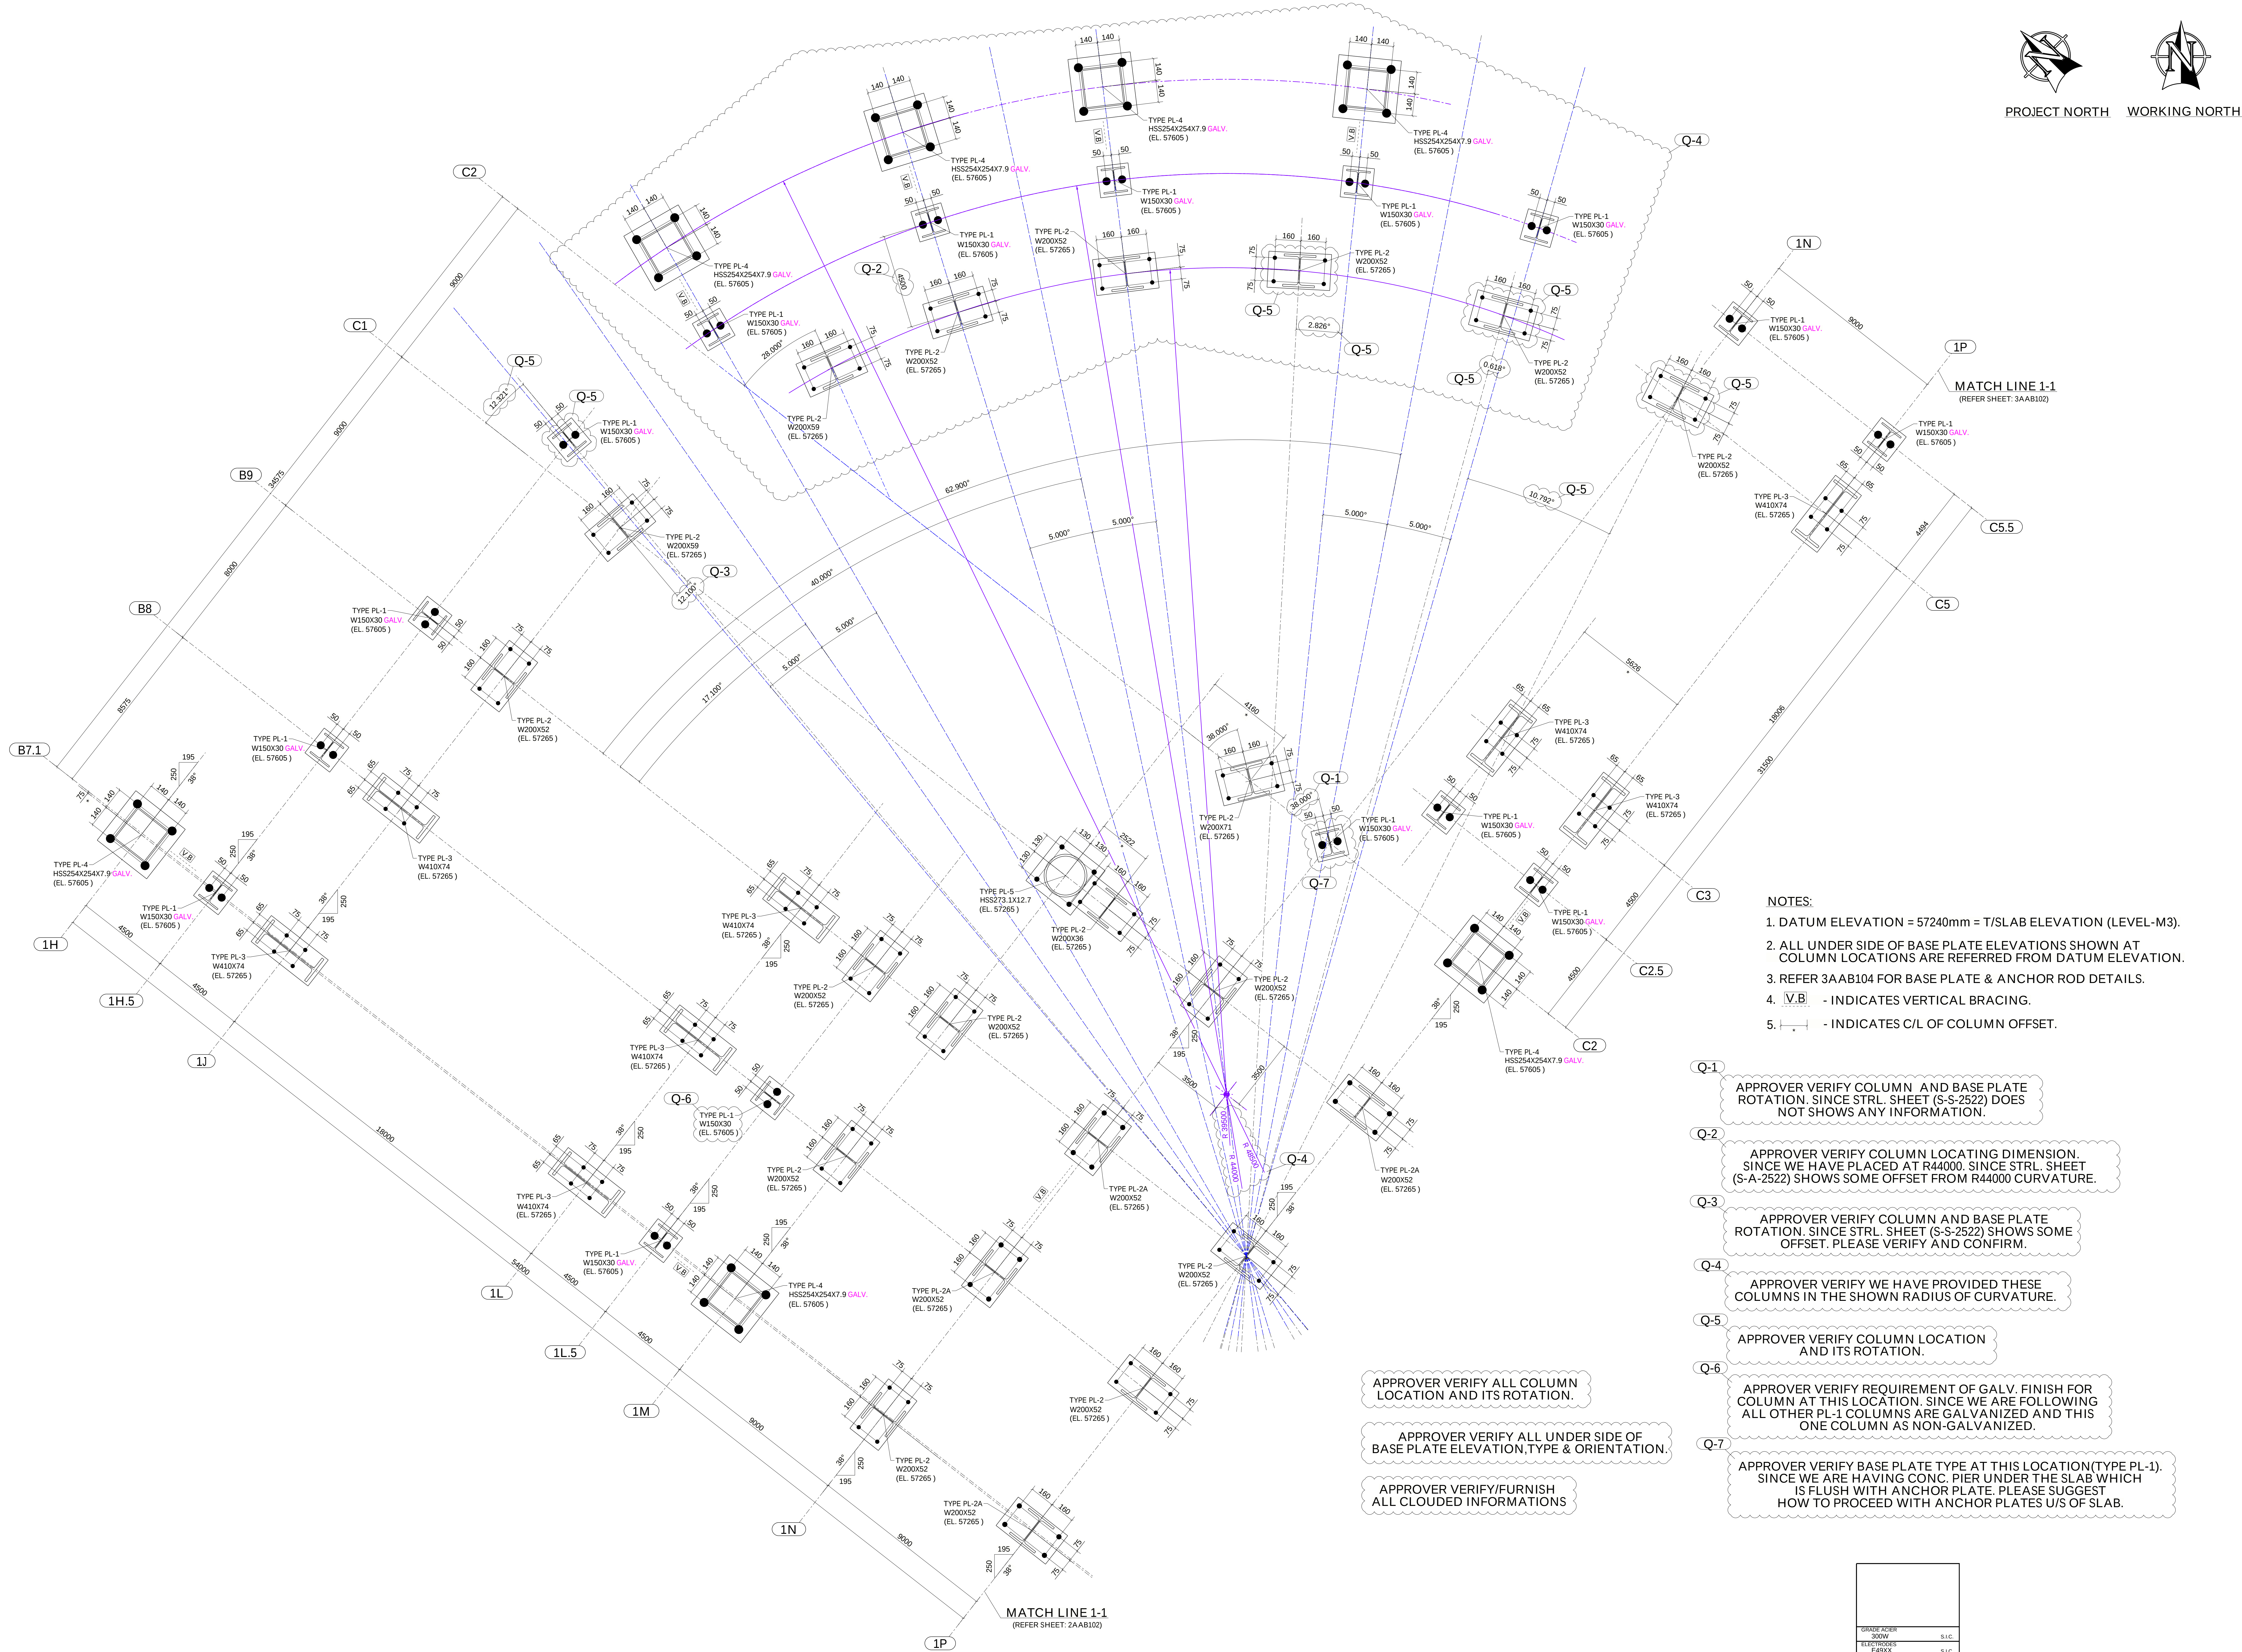




- NOTES:
- DATUM ELEVATION = 57240mm = T/SLAB ELEVATION (LEVEL-M3).
 - ALL UNDER SIDE OF BASE PLATE ELEVATIONS SHOWN AT COLUMN LOCATIONS ARE REFERRED FROM DATUM ELEVATION.
 - REFER 3AAB104 FOR BASE PLATE & ANCHOR ROD DETAILS.
 -  - INDICATES VERTICAL BRACING.
 -  - INDICATES C/L OF COLUMN OFFSET.


- Q-1 APPROVER VERIFY COLUMN AND BASE PLATE ROTATION. SINCE STRL. SHEET (S-S-2522) DOES NOT SHOWS ANY INFORMATION.
- Q-2 APPROVER VERIFY COLUMN LOCATING DIMENSION. SINCE WE HAVE PLACED AT R44000. SINCE STRL. SHEET (S-A-2522) SHOWS SOME OFFSET FROM R44000 CURVATURE.
- Q-3 APPROVER VERIFY COLUMN AND BASE PLATE ROTATION. SINCE STRL. SHEET (S-S-2522) SHOWS SOME OFFSET. PLEASE VERIFY AND CONFIRM.
- Q-4 APPROVER VERIFY WE HAVE PROVIDED THESE COLUMNS IN THE SHOWN RADIUS OF CURVATURE.
- Q-5 APPROVER VERIFY COLUMN LOCATION AND ITS ROTATION.
- Q-6 APPROVER VERIFY REQUIREMENT OF GALV. FINISH FOR COLUMN AT THIS LOCATION. SINCE WE ARE FOLLOWING ALL OTHER PL-1 COLUMNS ARE GALVANIZED AND THIS ONE COLUMN AS NON-GALVANIZED.
- Q-7 APPROVER VERIFY BASE PLATE TYPE AT THIS LOCATION (TYPE PL-1). SINCE WE ARE HAVING CONC. PIER UNDER THE SLAB WHICH IS FLUSH WITH ANCHOR PLATE. PLEASE SUGGEST HOW TO PROCEED WITH ANCHOR PLATES U/S OF SLAB.

- APPROVER VERIFY ALL COLUMN LOCATION AND ITS ROTATION.
- APPROVER VERIFY ALL UNDER SIDE OF BASE PLATE ELEVATION, TYPE & ORIENTATION.
- APPROVER VERIFY/FURNISH ALL CLOUDED INFORMATIONS


PARTIAL ANCHOR BOLT SETTING PLAN (LEVEL-M3) (SECTOR-A)
(REFER SHEET: S-A-2522)

DATE	NO	DESCRIPTION	PAR
06/21/2022	1	FOR RE-APPROVAL	
06/01/2022	2	FOR APPROVAL	

GRADE ACHER	300W	S.I.C.
FINISH THICKNESS	E48XX	S.I.C.
THICKNESS	6mm	S.I.C.
THICKNESS	220	S.I.C.
THICKNESS	AS PER	S.I.C.
THICKNESS	1-23A PRIMER	S.I.C.

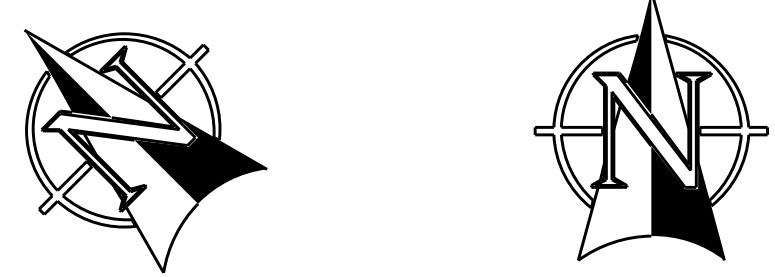

PROJECT NORTH WORKING NORTH

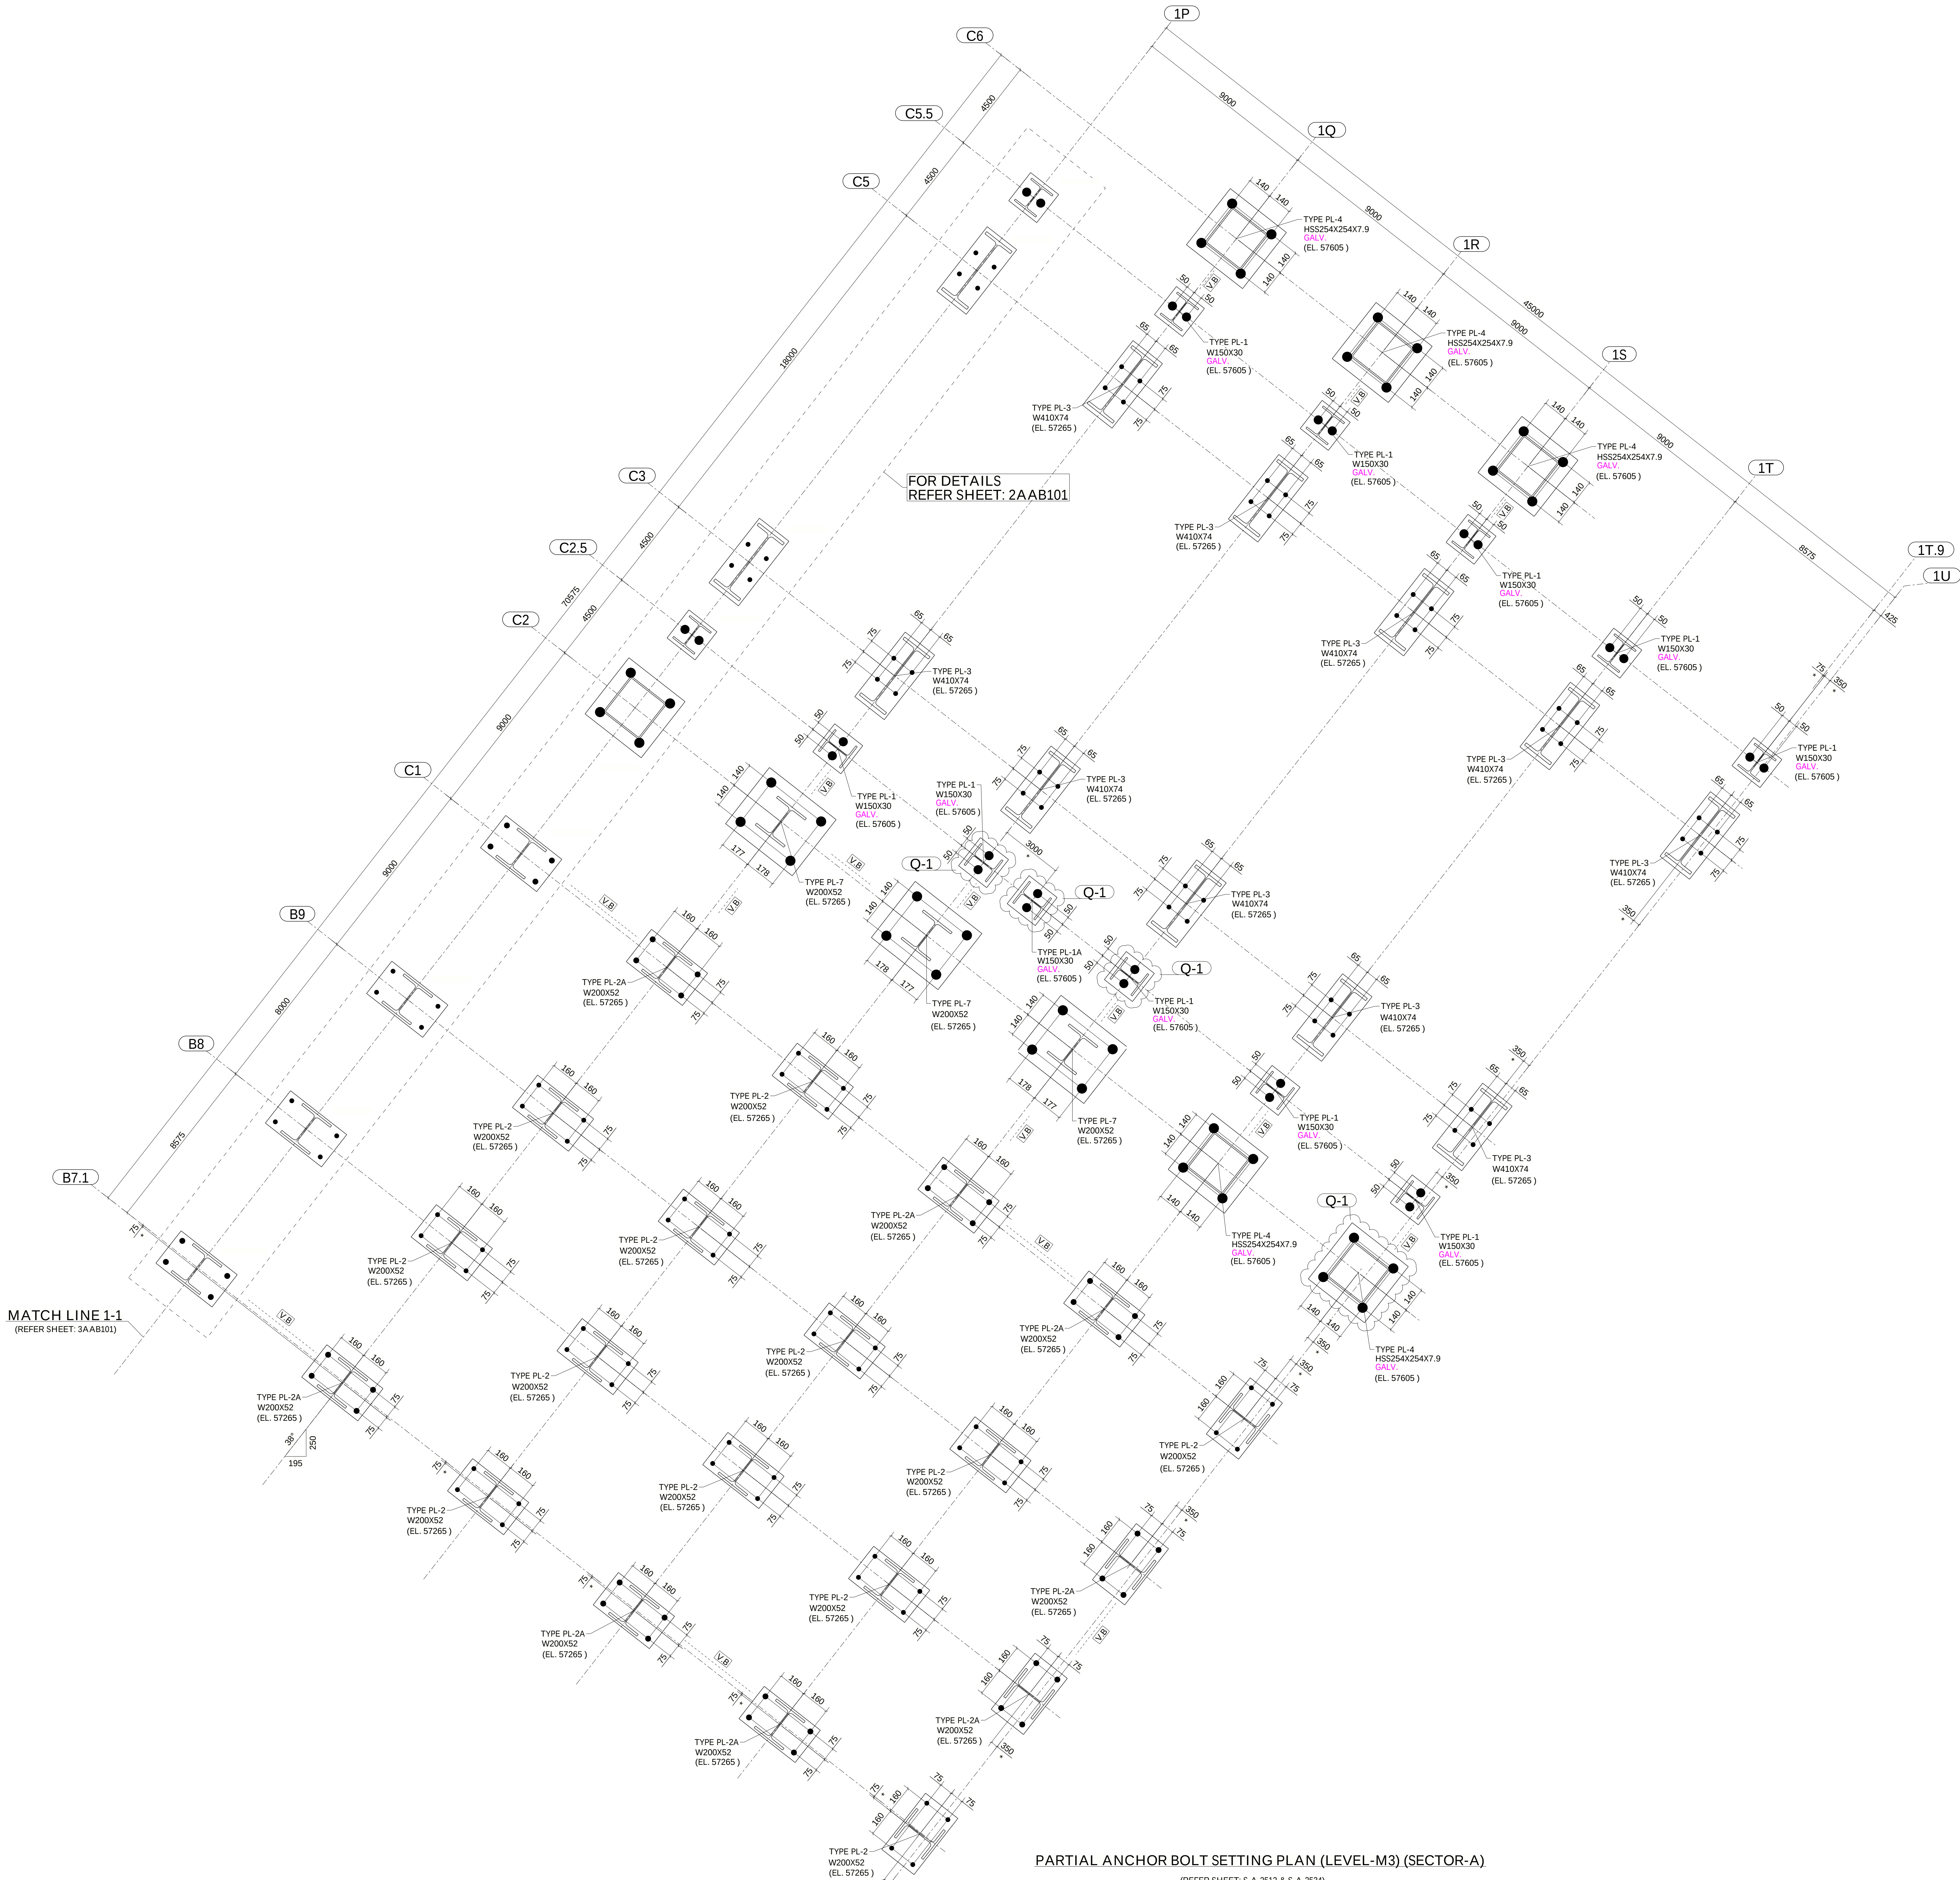

- NOTES:
- DATUM ELEVATION = 57240mm = T/SLAB ELEVATION (LEVEL-M3).
 - ALL UNDER SIDE OF BASE PLATE ELEVATIONS SHOWN AT COLUMN LOCATIONS ARE REFERRED FROM DATUM ELEVATION.
 - REFER 3AAB104 FOR BASE PLATE & ANCHOR ROD DETAILS.
 - V.B - INDICATES VERTICAL BRACING.
 - C/L - INDICATES C/L OF COLUMN OFFSET.

Q-1

APPROVER VERIFY U/S OF BASE PL. ELEVATION SINCE STRL. PLAN (S-A-2523) DOES NOT SHOWS ANY PIER AT THIS LOCATION. PLEASE VERIFY AND CONFIRM.

APPROVER VERIFY ALL UNDER SIDE OF BASE PLATE ELEVATION, TYPE & ORIENTATION.

APPROVER VERIFY COLUMN LOCATION AND ITS ROTATION.

APPROVER VERIFY/FURNISH ALL CLOUDED INFORMATIONS


PARTIAL ANCHOR BOLT SETTING PLAN (LEVEL-M3) (SECTOR-A)
(REFER SHEET: S-A-2512 & S-A-2534)

DATE	NO	DESCRIPTION	PAR	REVISIONS
06/21/2021	1	FOR RE-APPROVAL		1. 25A PRIMER
06/01/2022	2	FOR APPROVAL		

GRADE ACHER	300W	S.I.C.
FINISH FLOOR	E48XX	S.I.C.
THICKNESS	6mm	S.I.C.
THICKNESS	220	S.I.C.
THICKNESS	220	S.I.C.
THICKNESS	220	S.I.C.



PROJECT NORTH WORKING NORTH

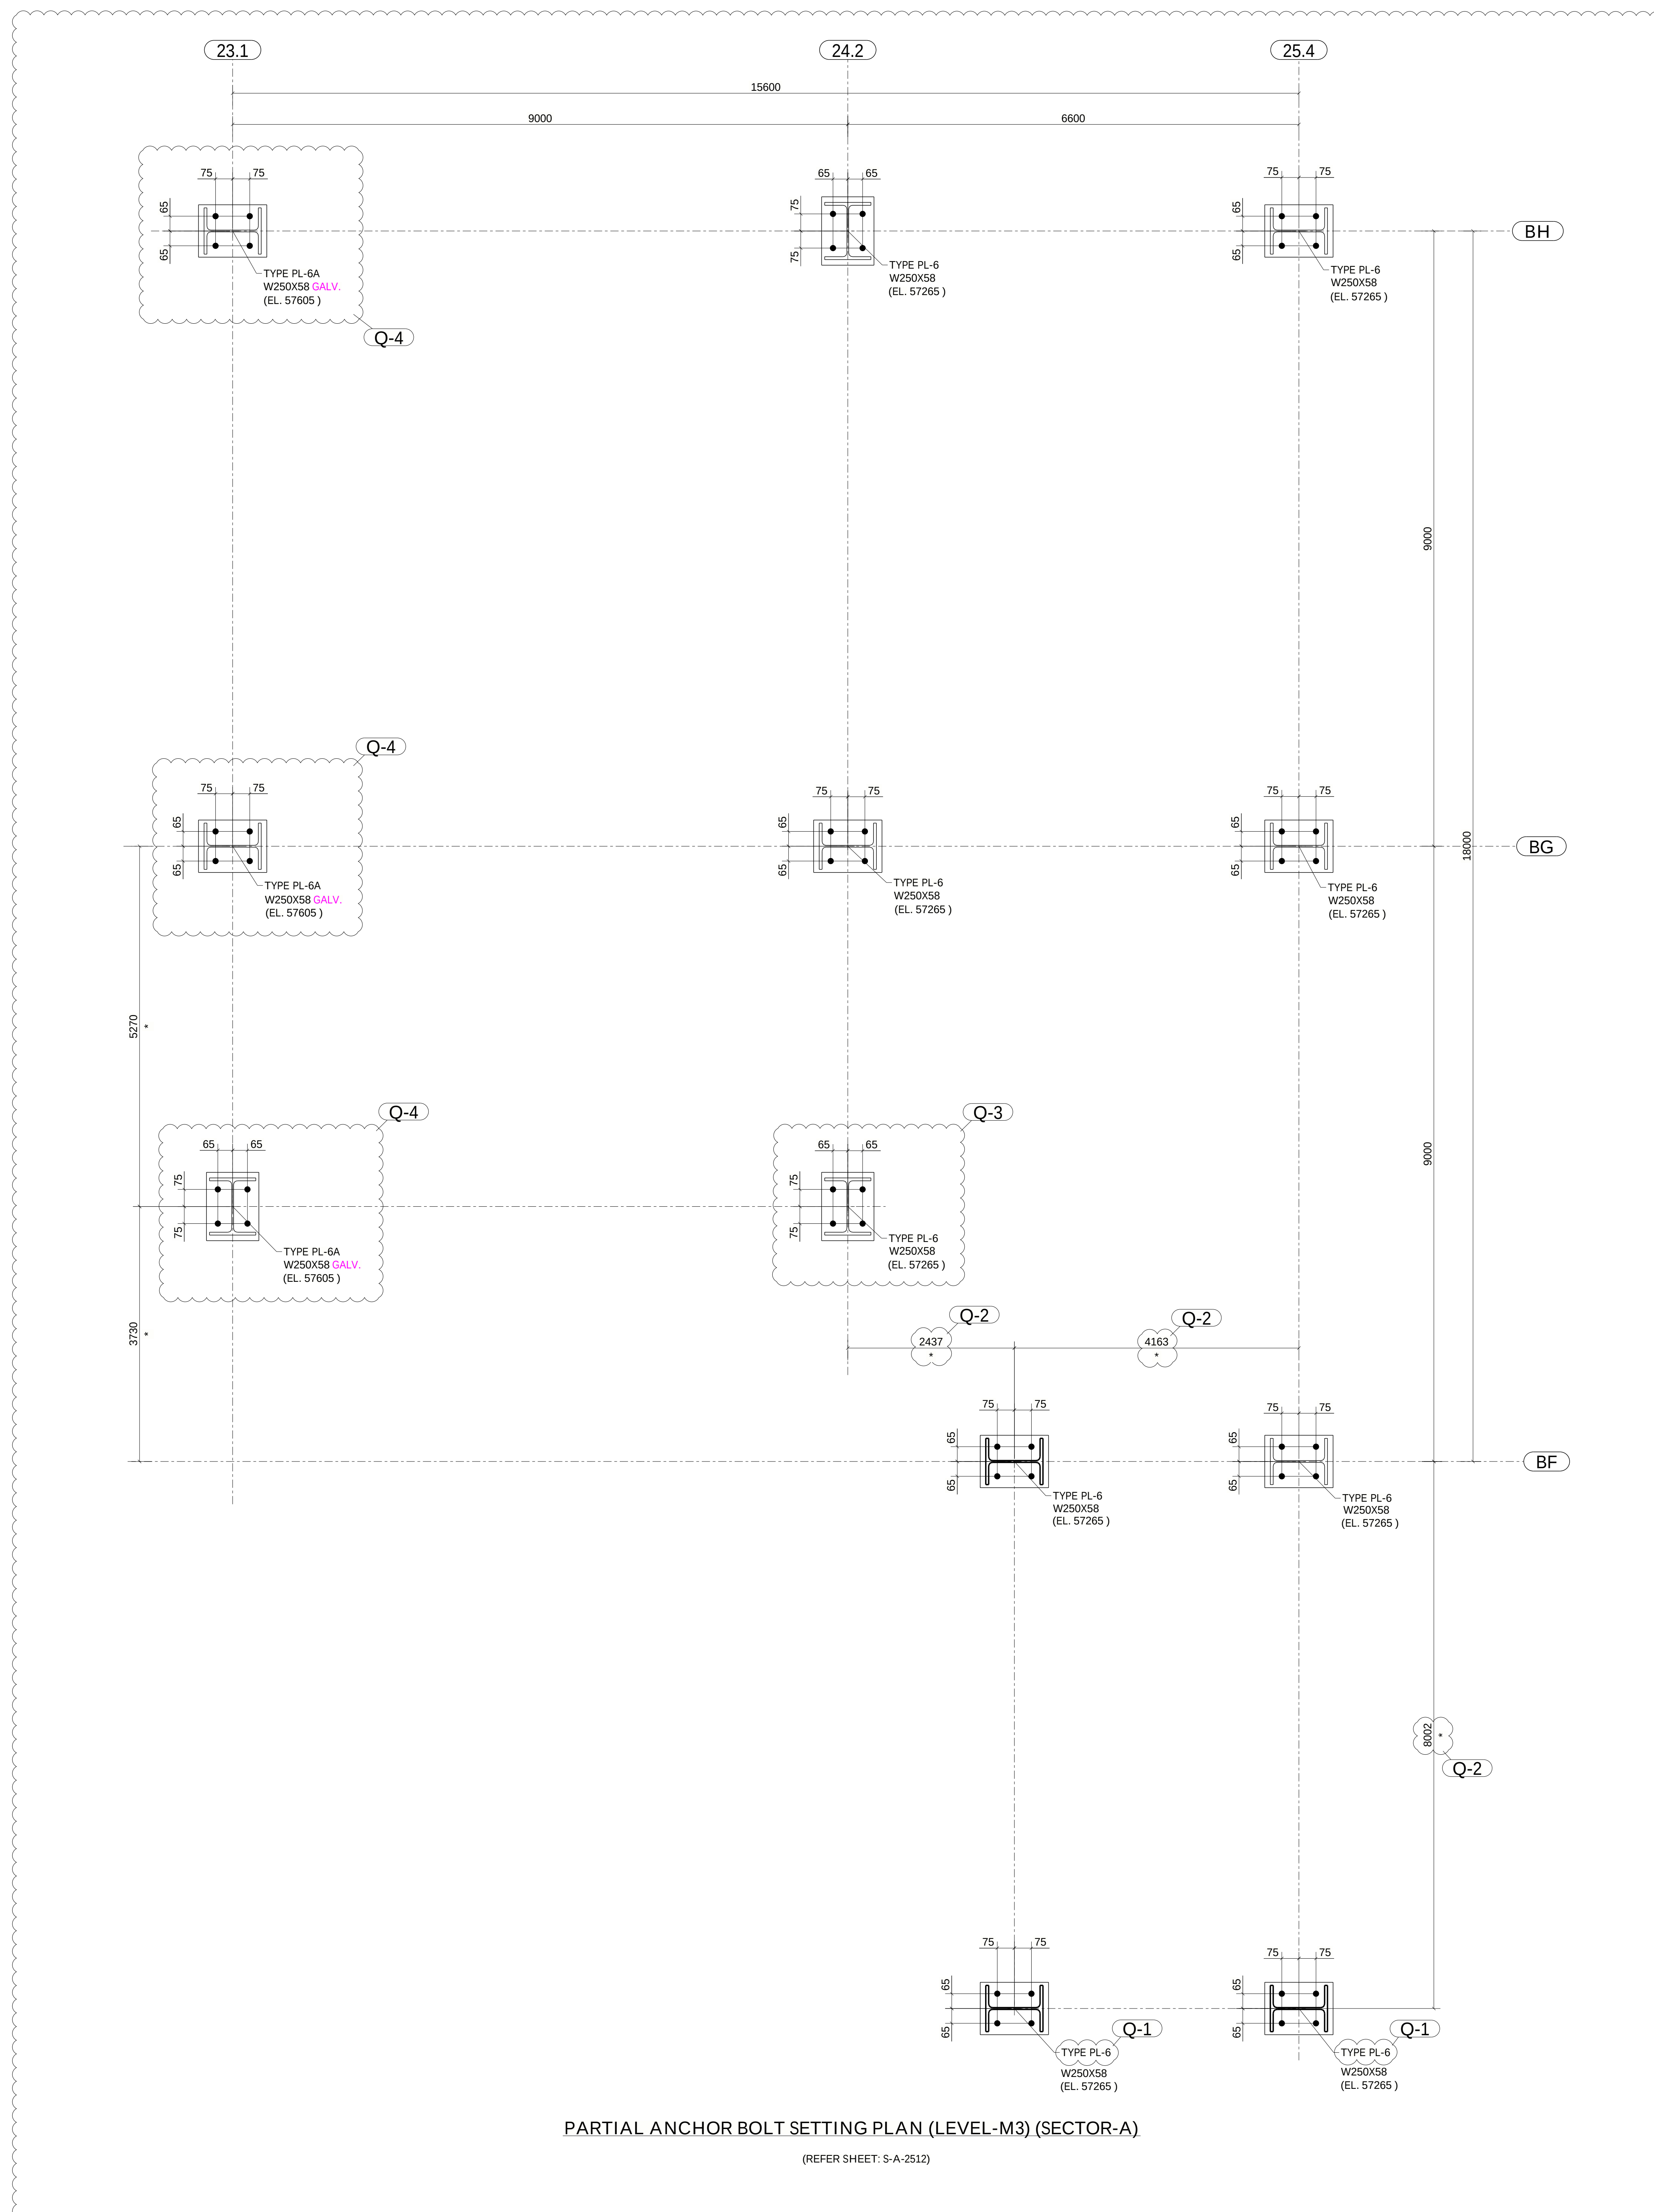

NOTES:

1. DATUM ELEVATION = 57240mm = T/SLAB ELEVATION (LEVEL-M3).
2. ALL UNDER SIDE OF BASE PLATE ELEVATIONS SHOWN AT COLUMN LOCATIONS ARE REFERRED FROM DATUM ELEVATION.
3. REFER 3AA8104 FOR BASE PLATE & ANCHOR ROD DETAILS.
4.  - INDICATES VERTICAL BRACING.
5.  - INDICATES C/L OF COLUMN OFFSET.

Q-1

APPROVER VERIFY BASE PLATE TYPE USED AT THIS LOCATIONS.
SINCE STRL.SHEETS DOES NOT HAVE CLEAR INFORMATION.

Q-2

APPROVER VERIFY COLUMN LOCATING DIMENSIONS.
SINCE STRL.SHEETS DOES NOT HAVE CLEAR INFORMATION.

O-3

APPROVER VERIFY BASE PLATE TYPE FOLLOWED (TYPE PL-6) WITH EMBEDMENT OF 300mm AT THIS LOCATION. SINCE WE ARE HAVING ONLY 250mm THICK SLAB. PLEASE SUGGEST HOW TO PROCEED WITH ANCHOR ROD LENGTH.





















Q-4

APPROVER VERIFY U/S OF BASE PL. ELEVATION.SINCE
STRL. PLAN (S-A-2523) DOES NOT SHOWS ANY PIER
AT THIS LOCATION. PLEASE VERIFY AND CONFIRM.

APPROVER VERIFY ALL UNDER SIDE OF
BASE PLATE ELEVATION,TYPE & ORIENTATION.

APPROVER VERIFY/FURNISH
ALL CLOUDED INFORMATIONS

DATE	NO.	DESCRIPTION	PAR	220	S.I
06/21/2022	B	FOR RE-APPROVAL		BOULONS A325N	S.I
06/01/2022	A	FOR APPROVAL		PEINTURE 1.721A PRIMER	S.I

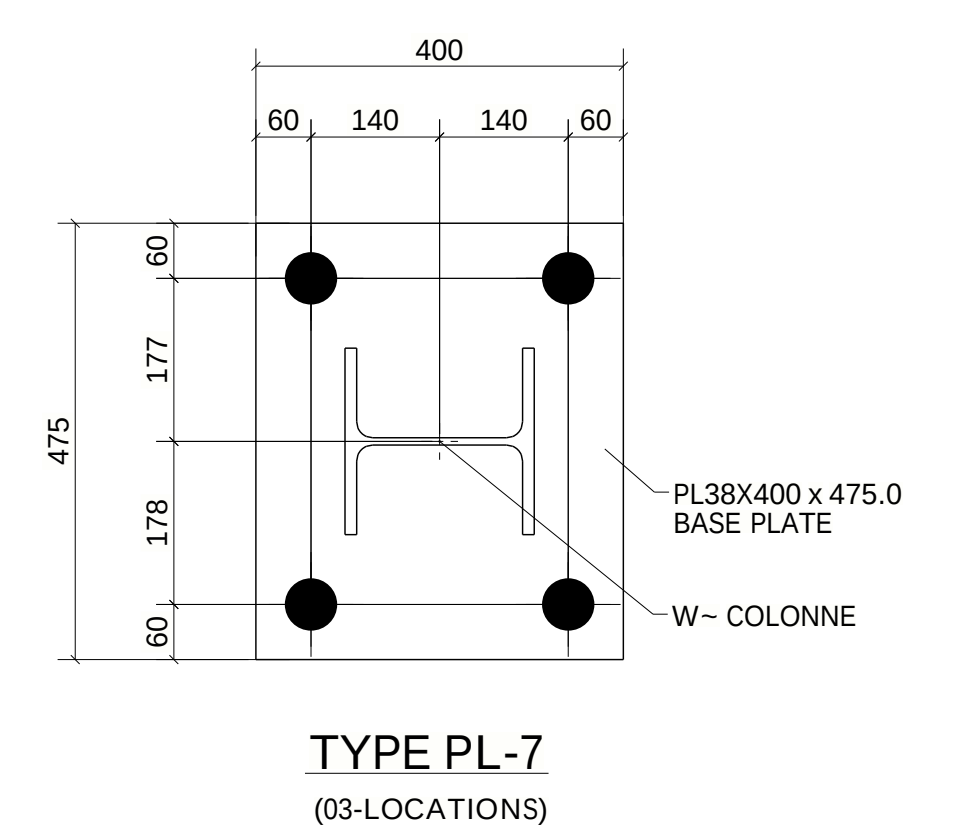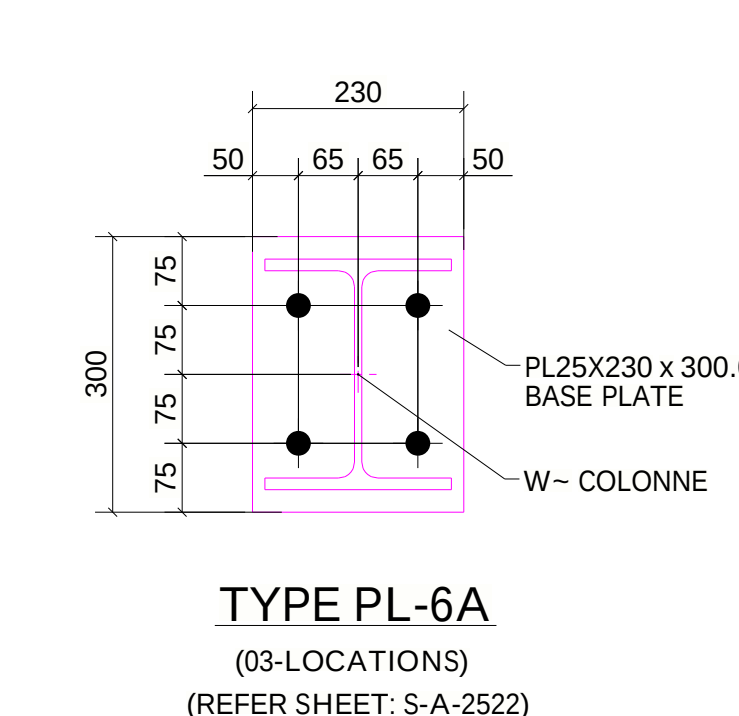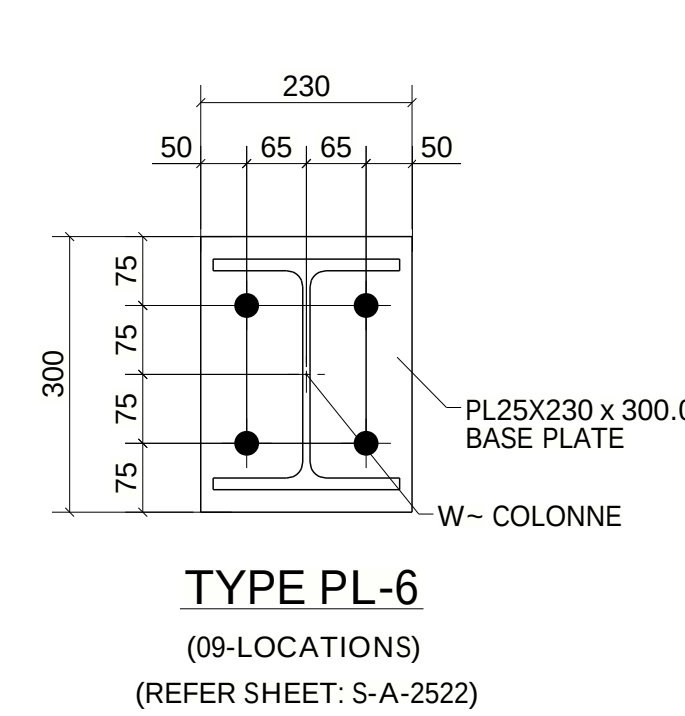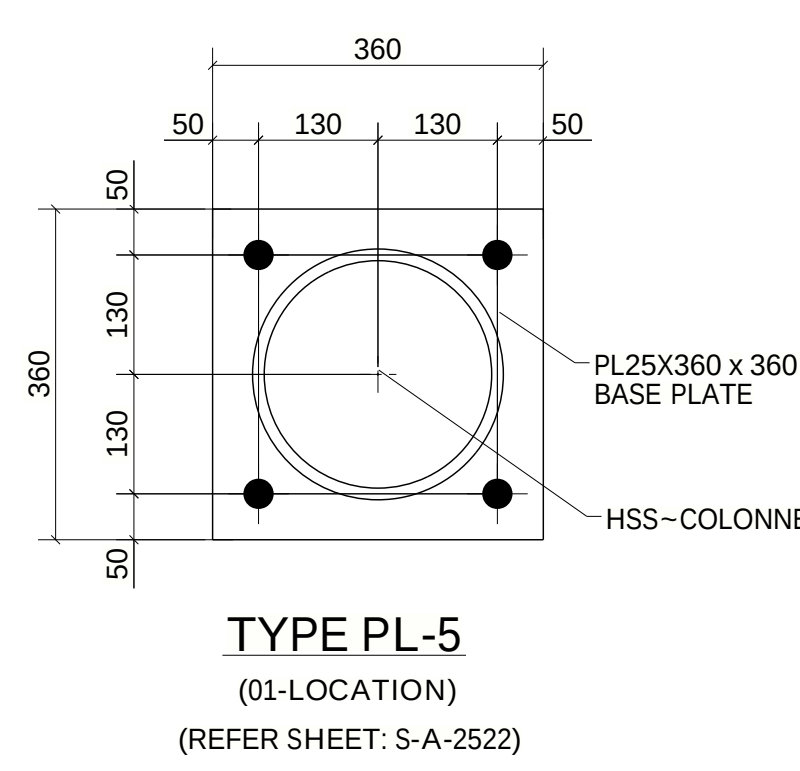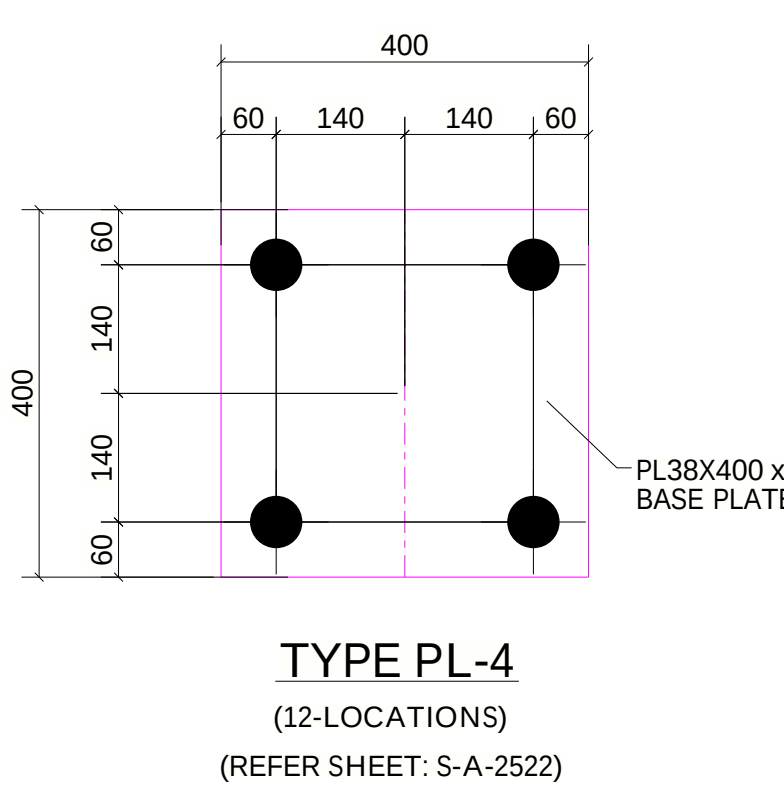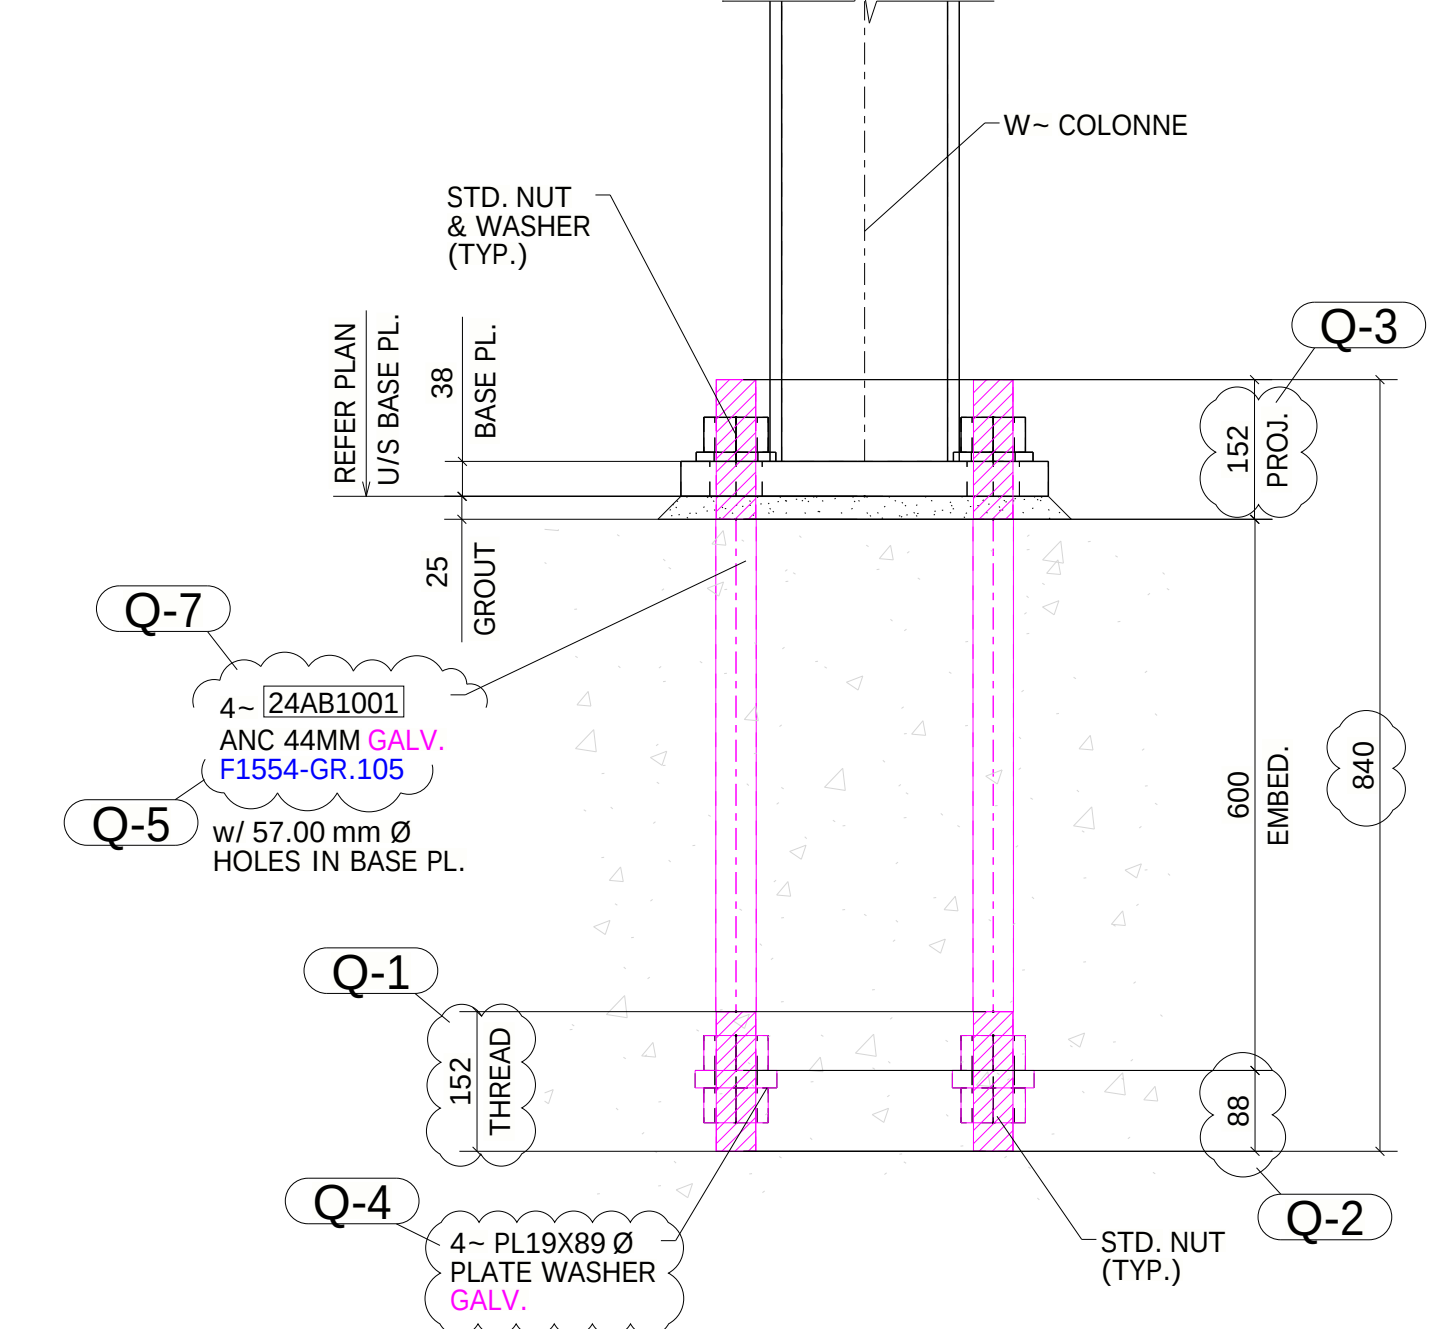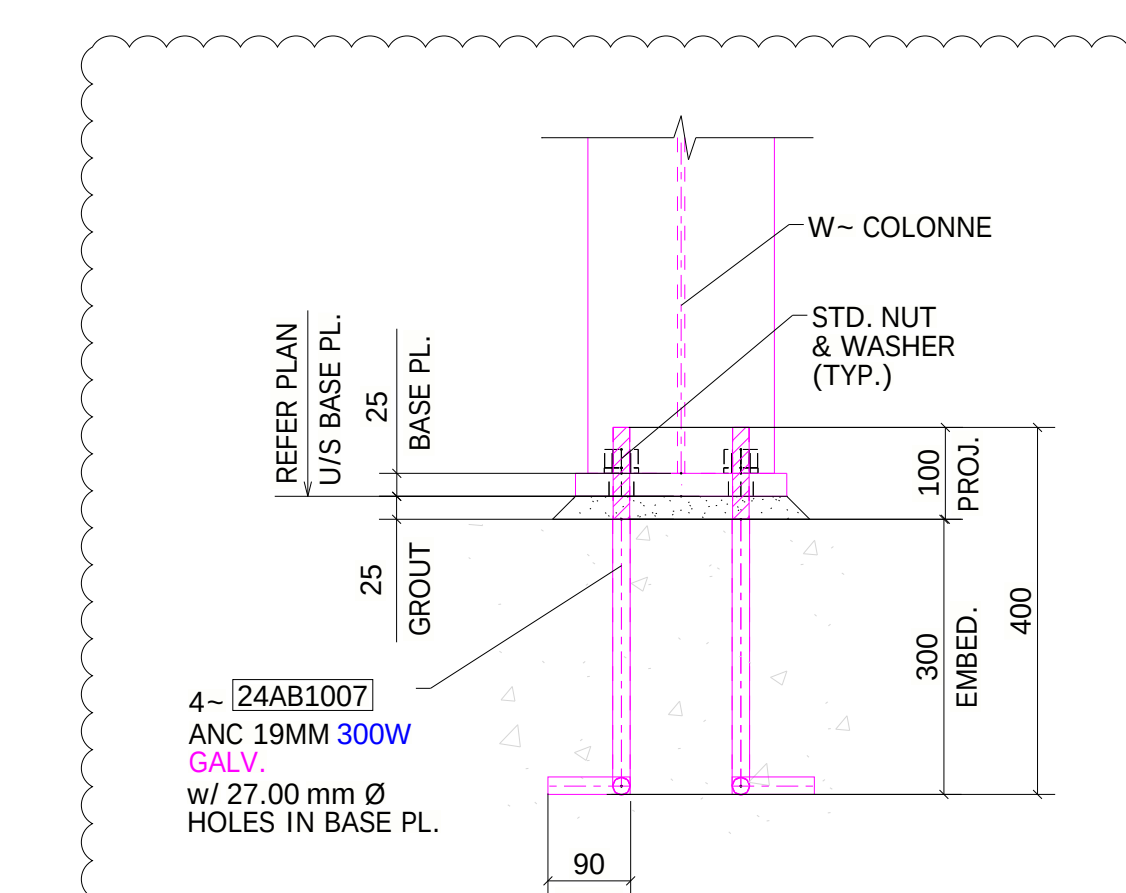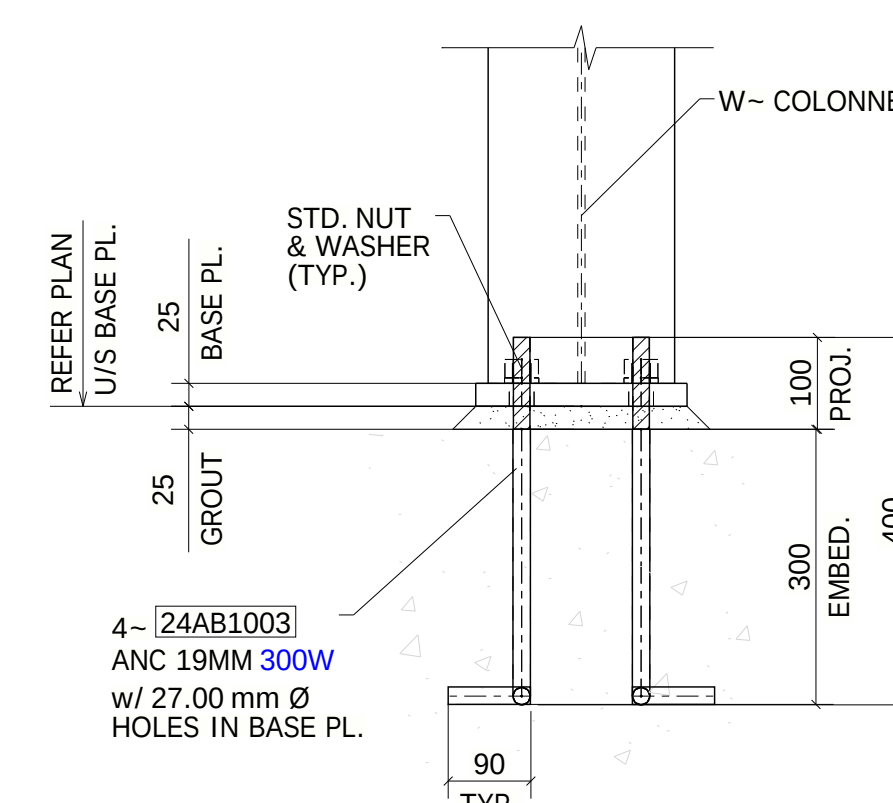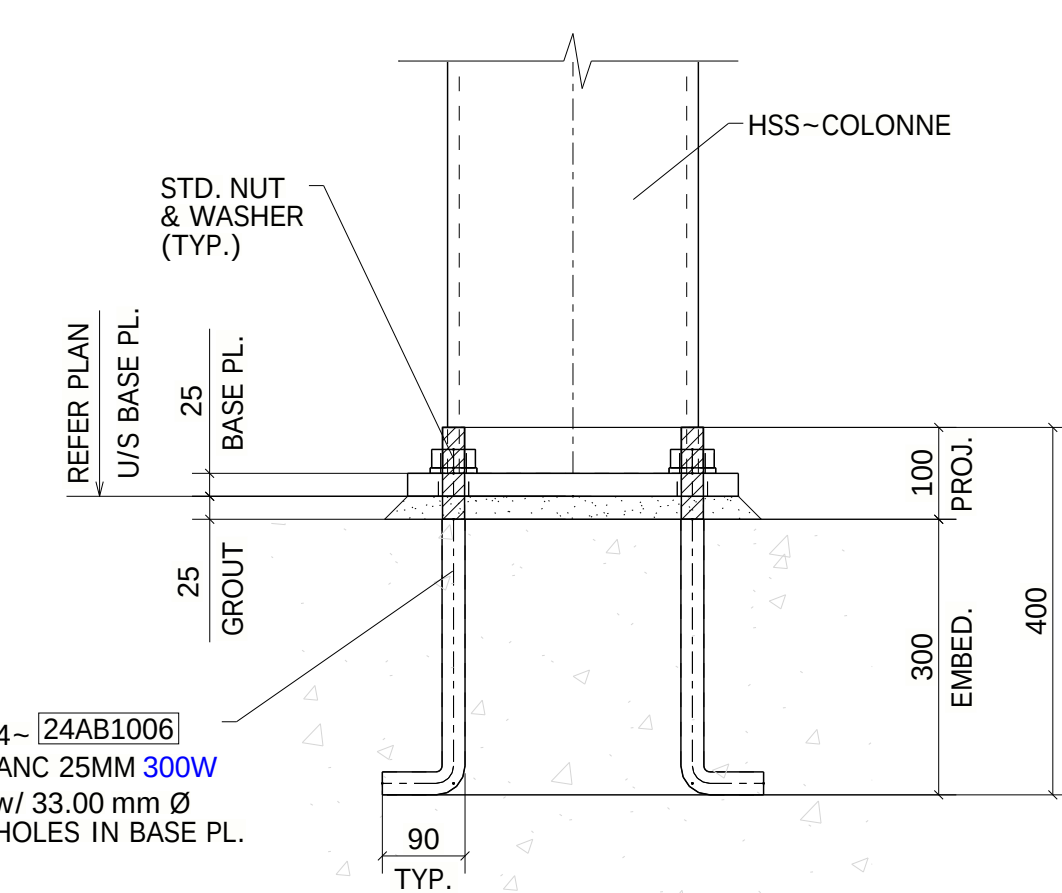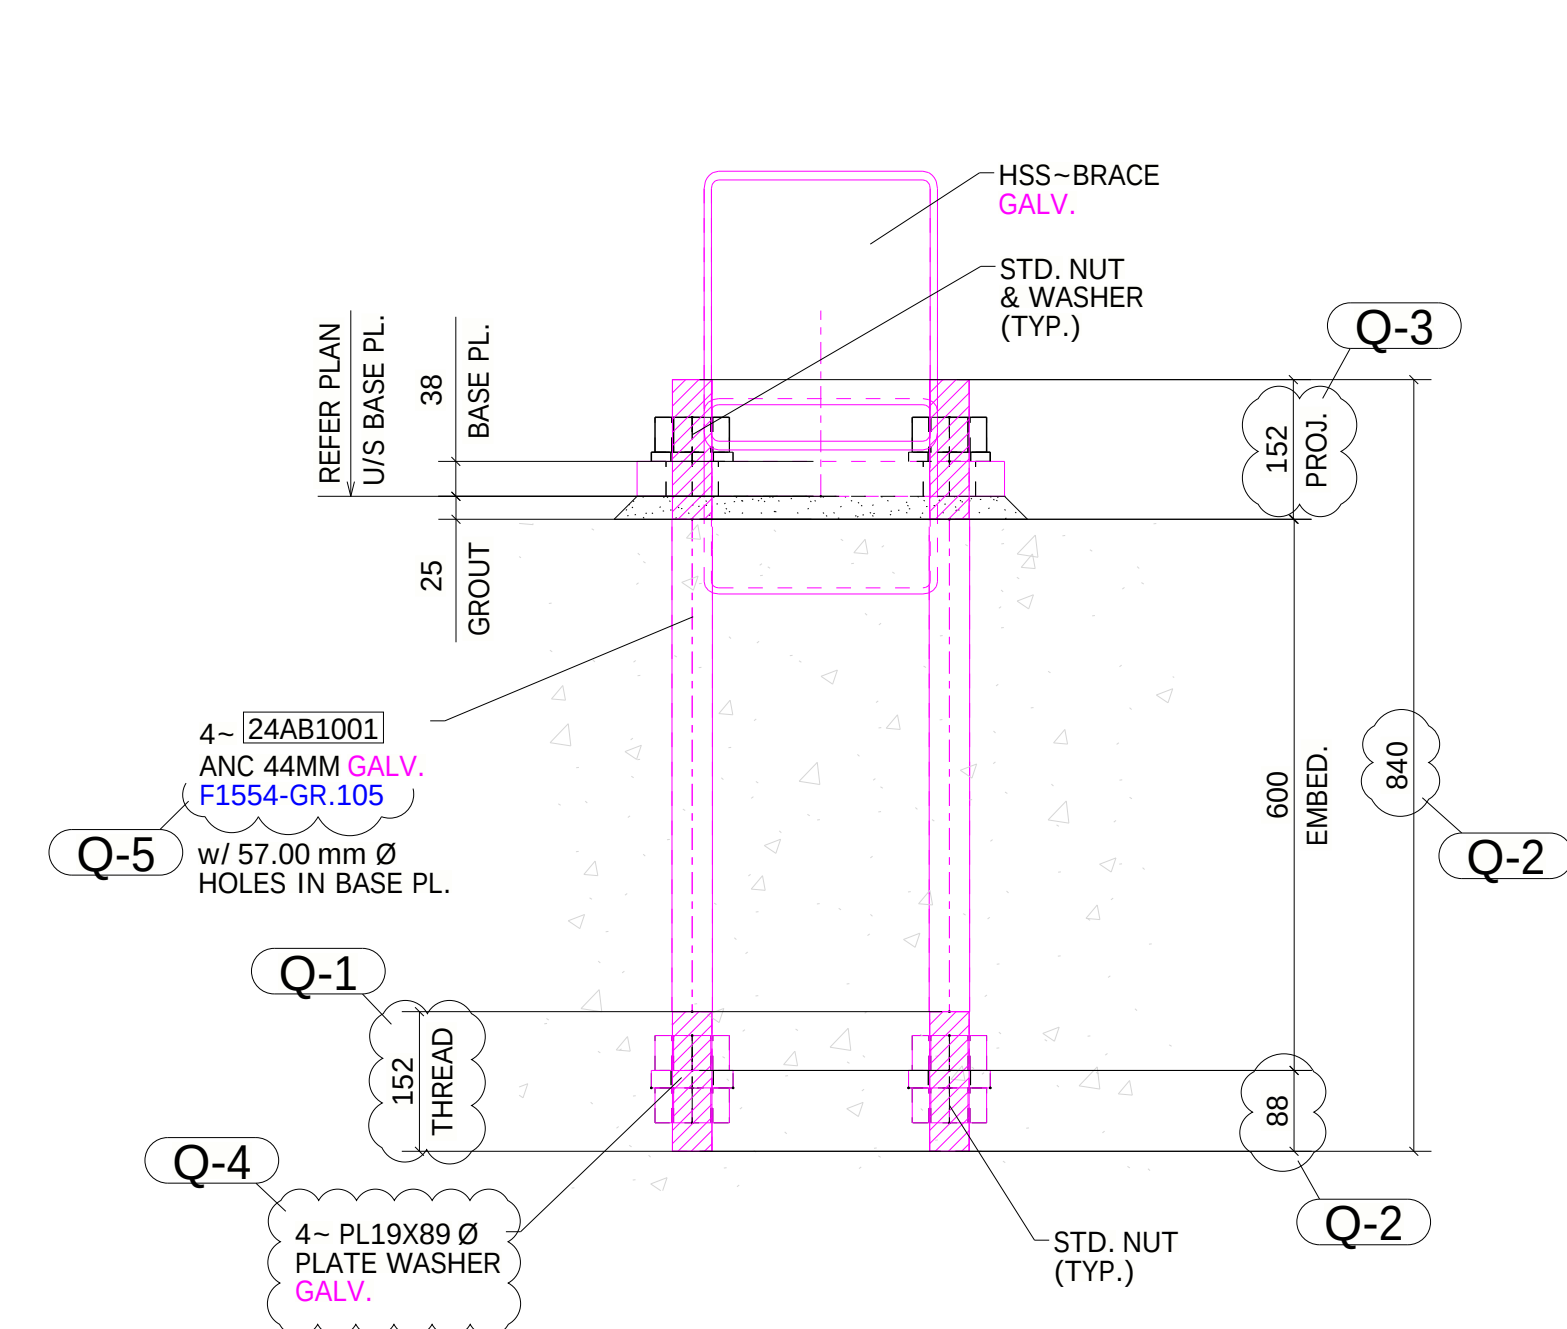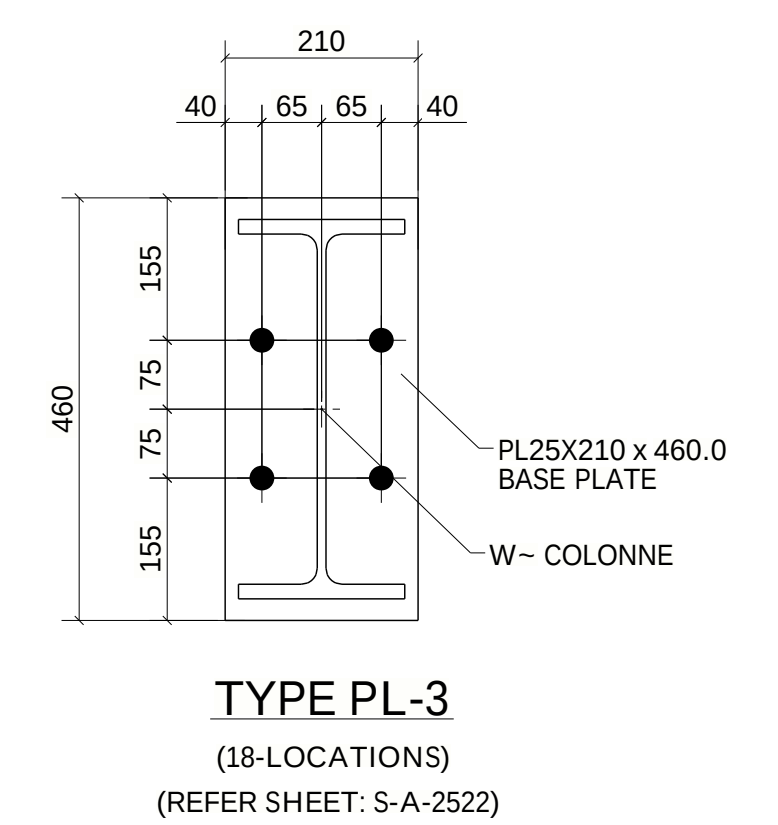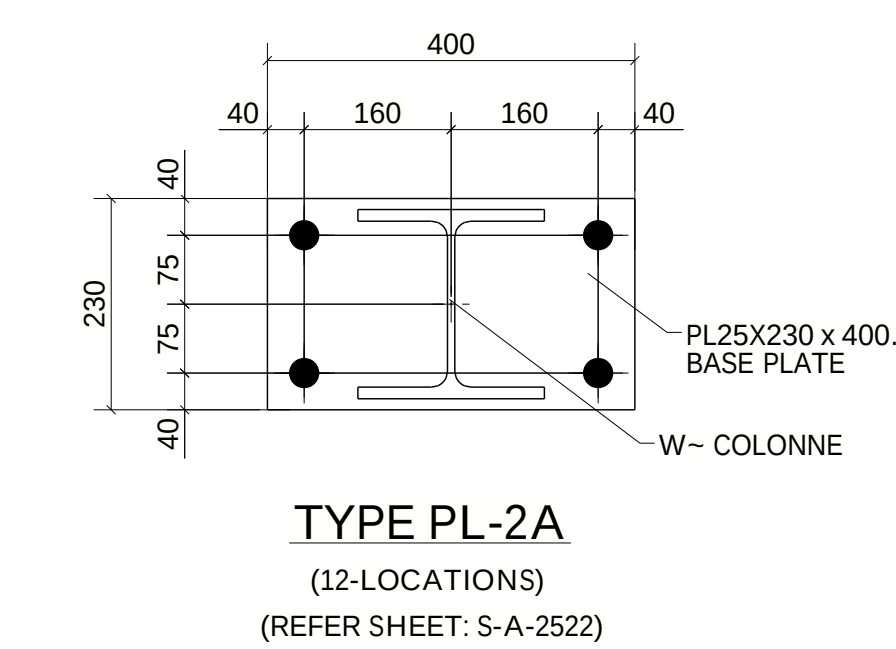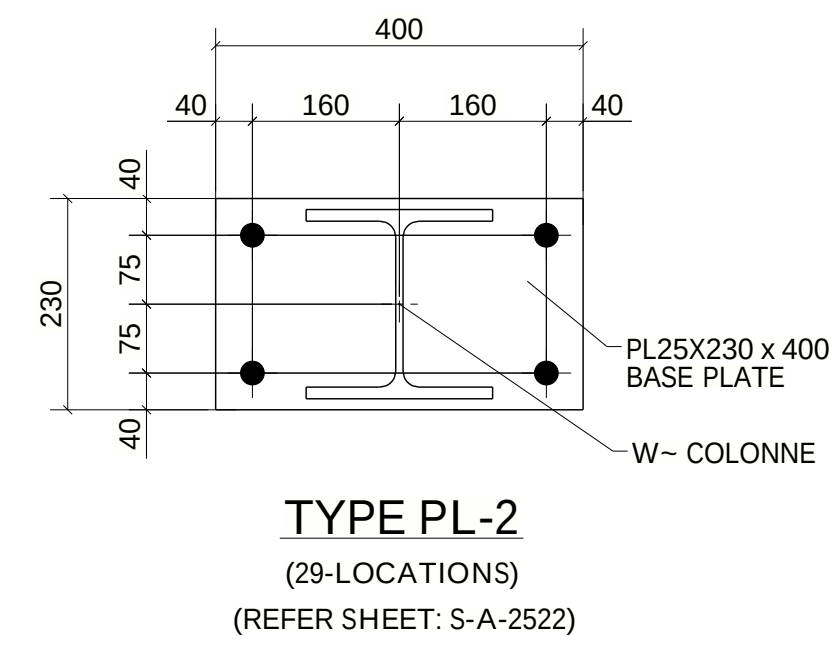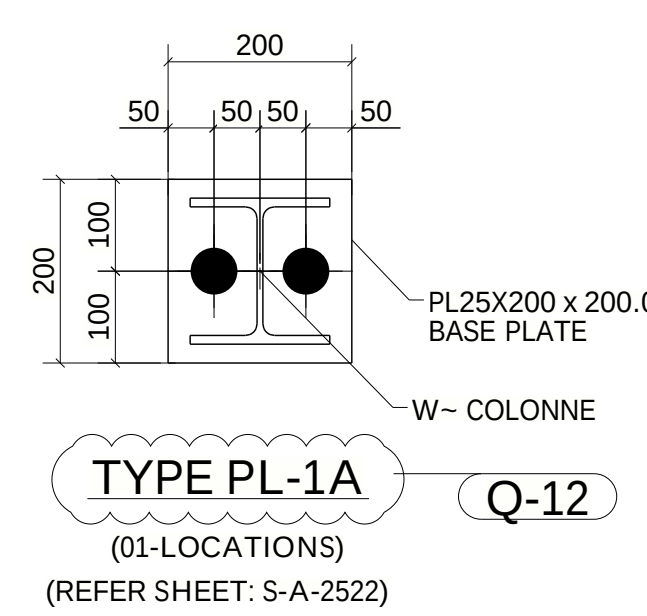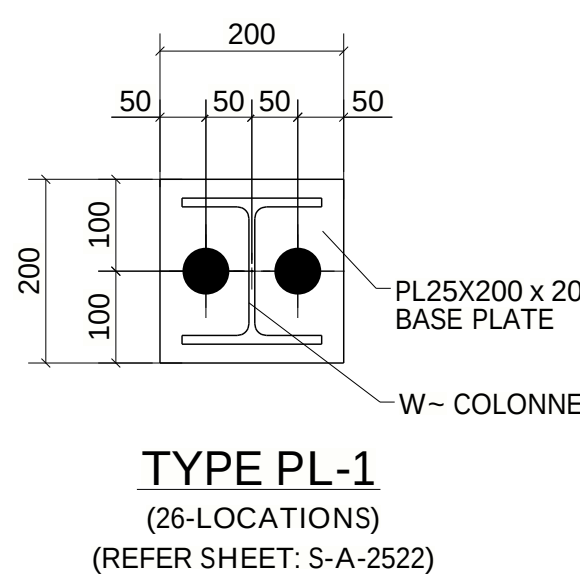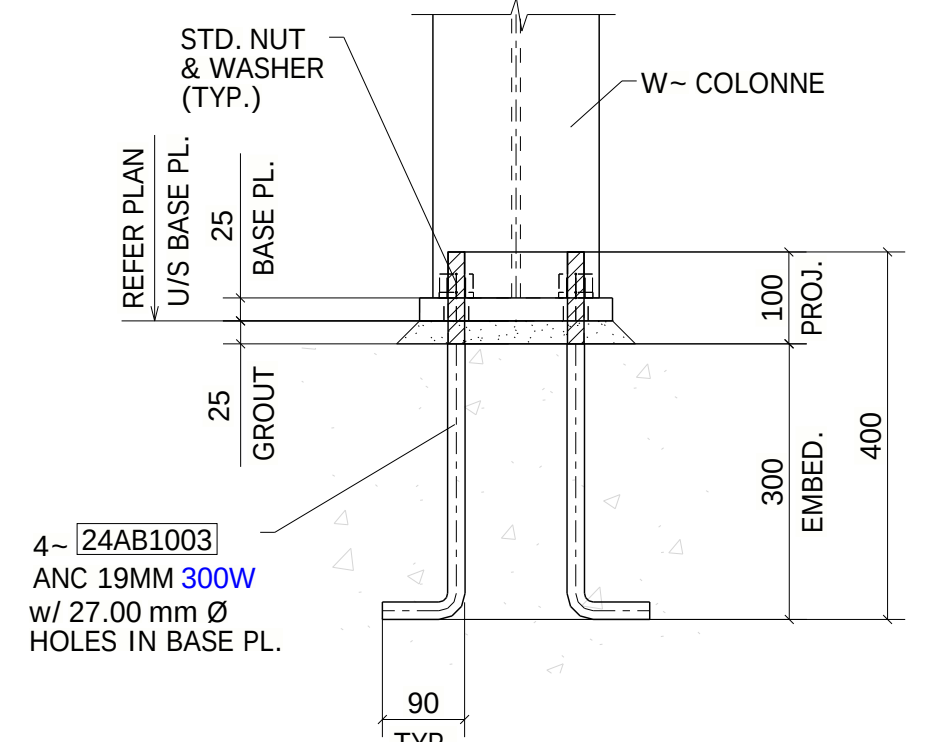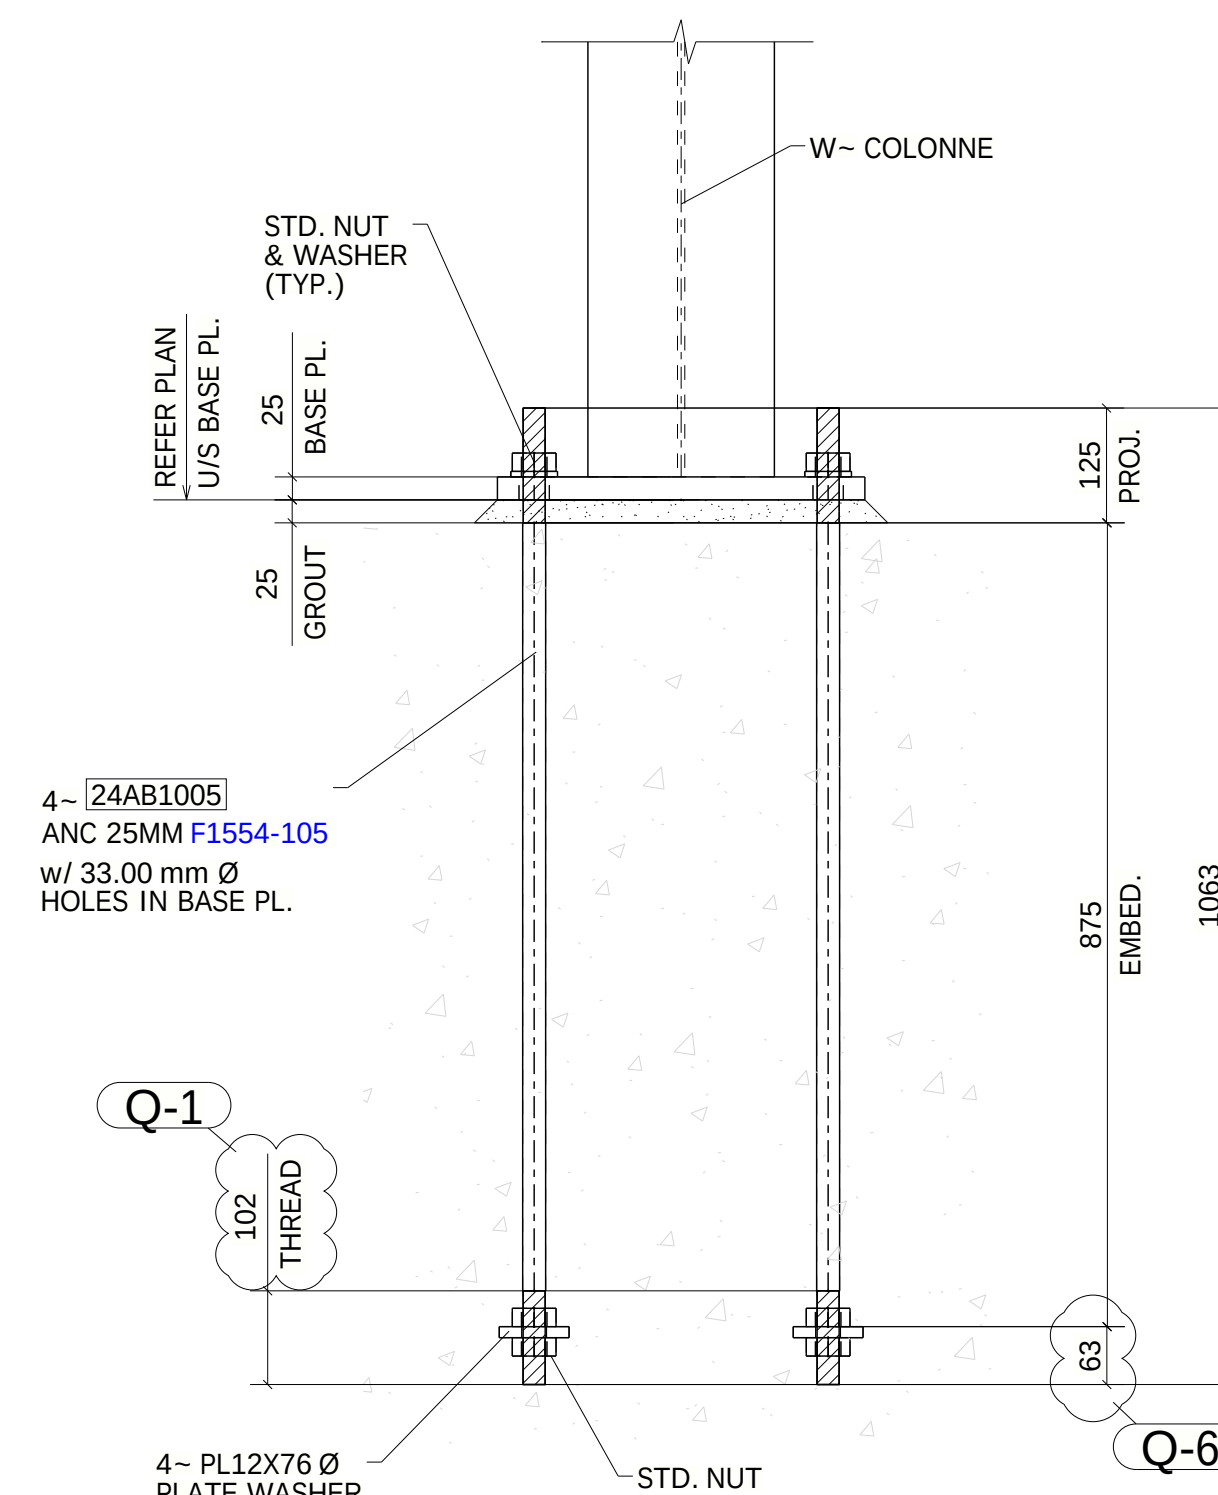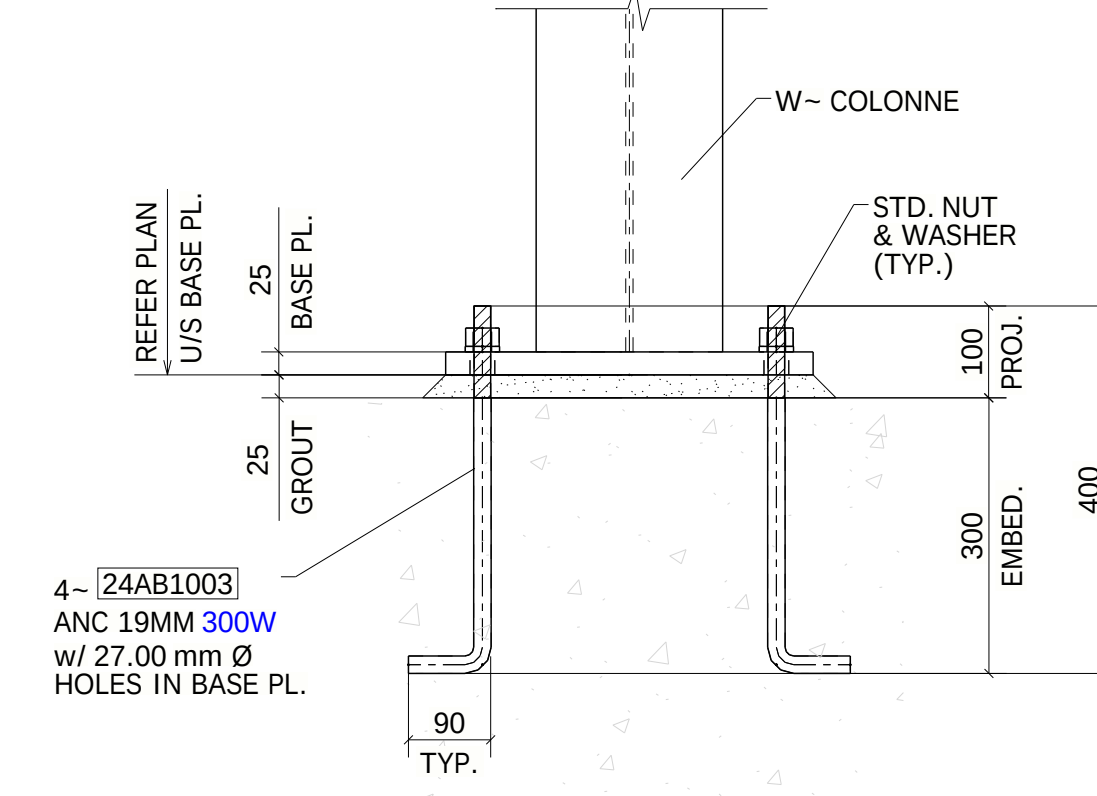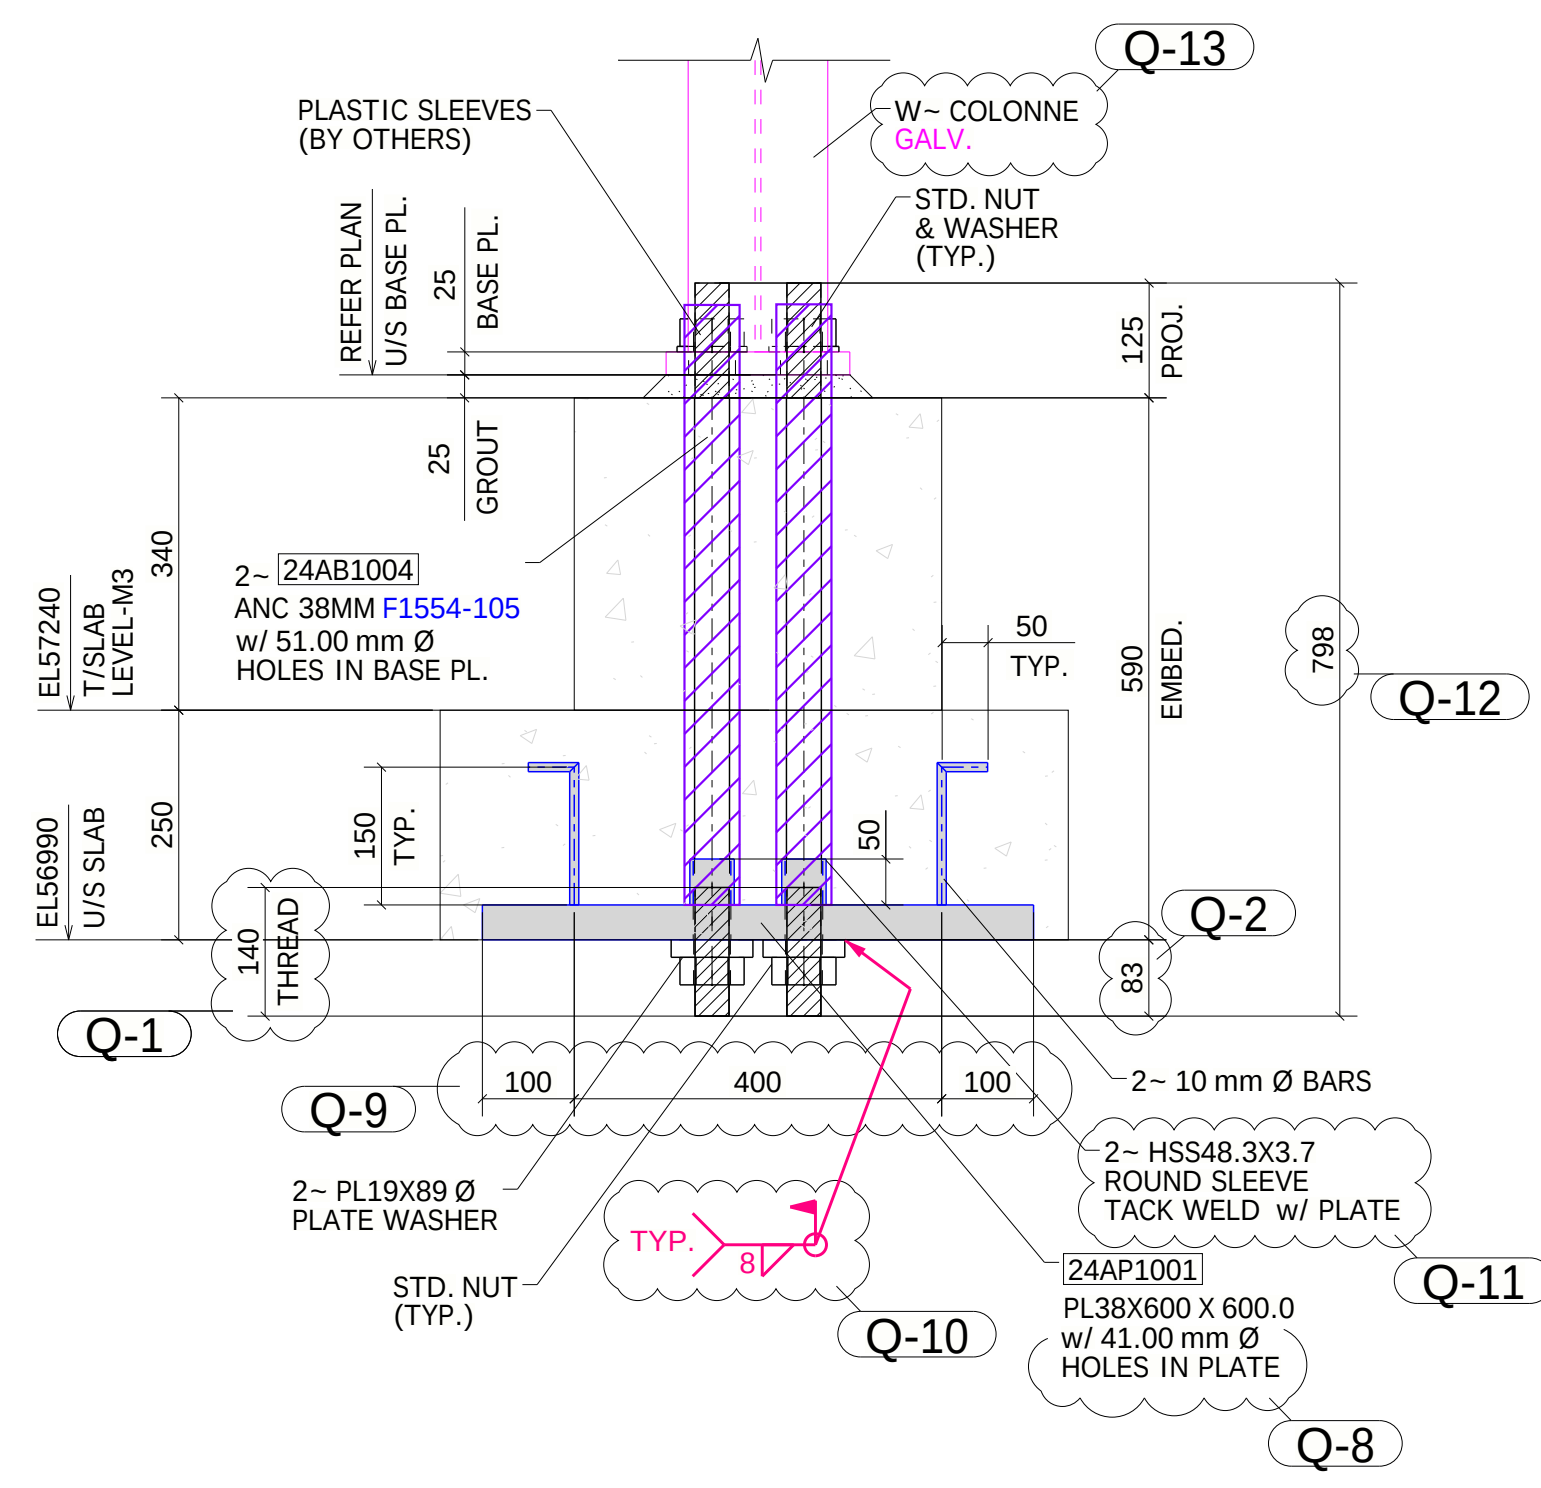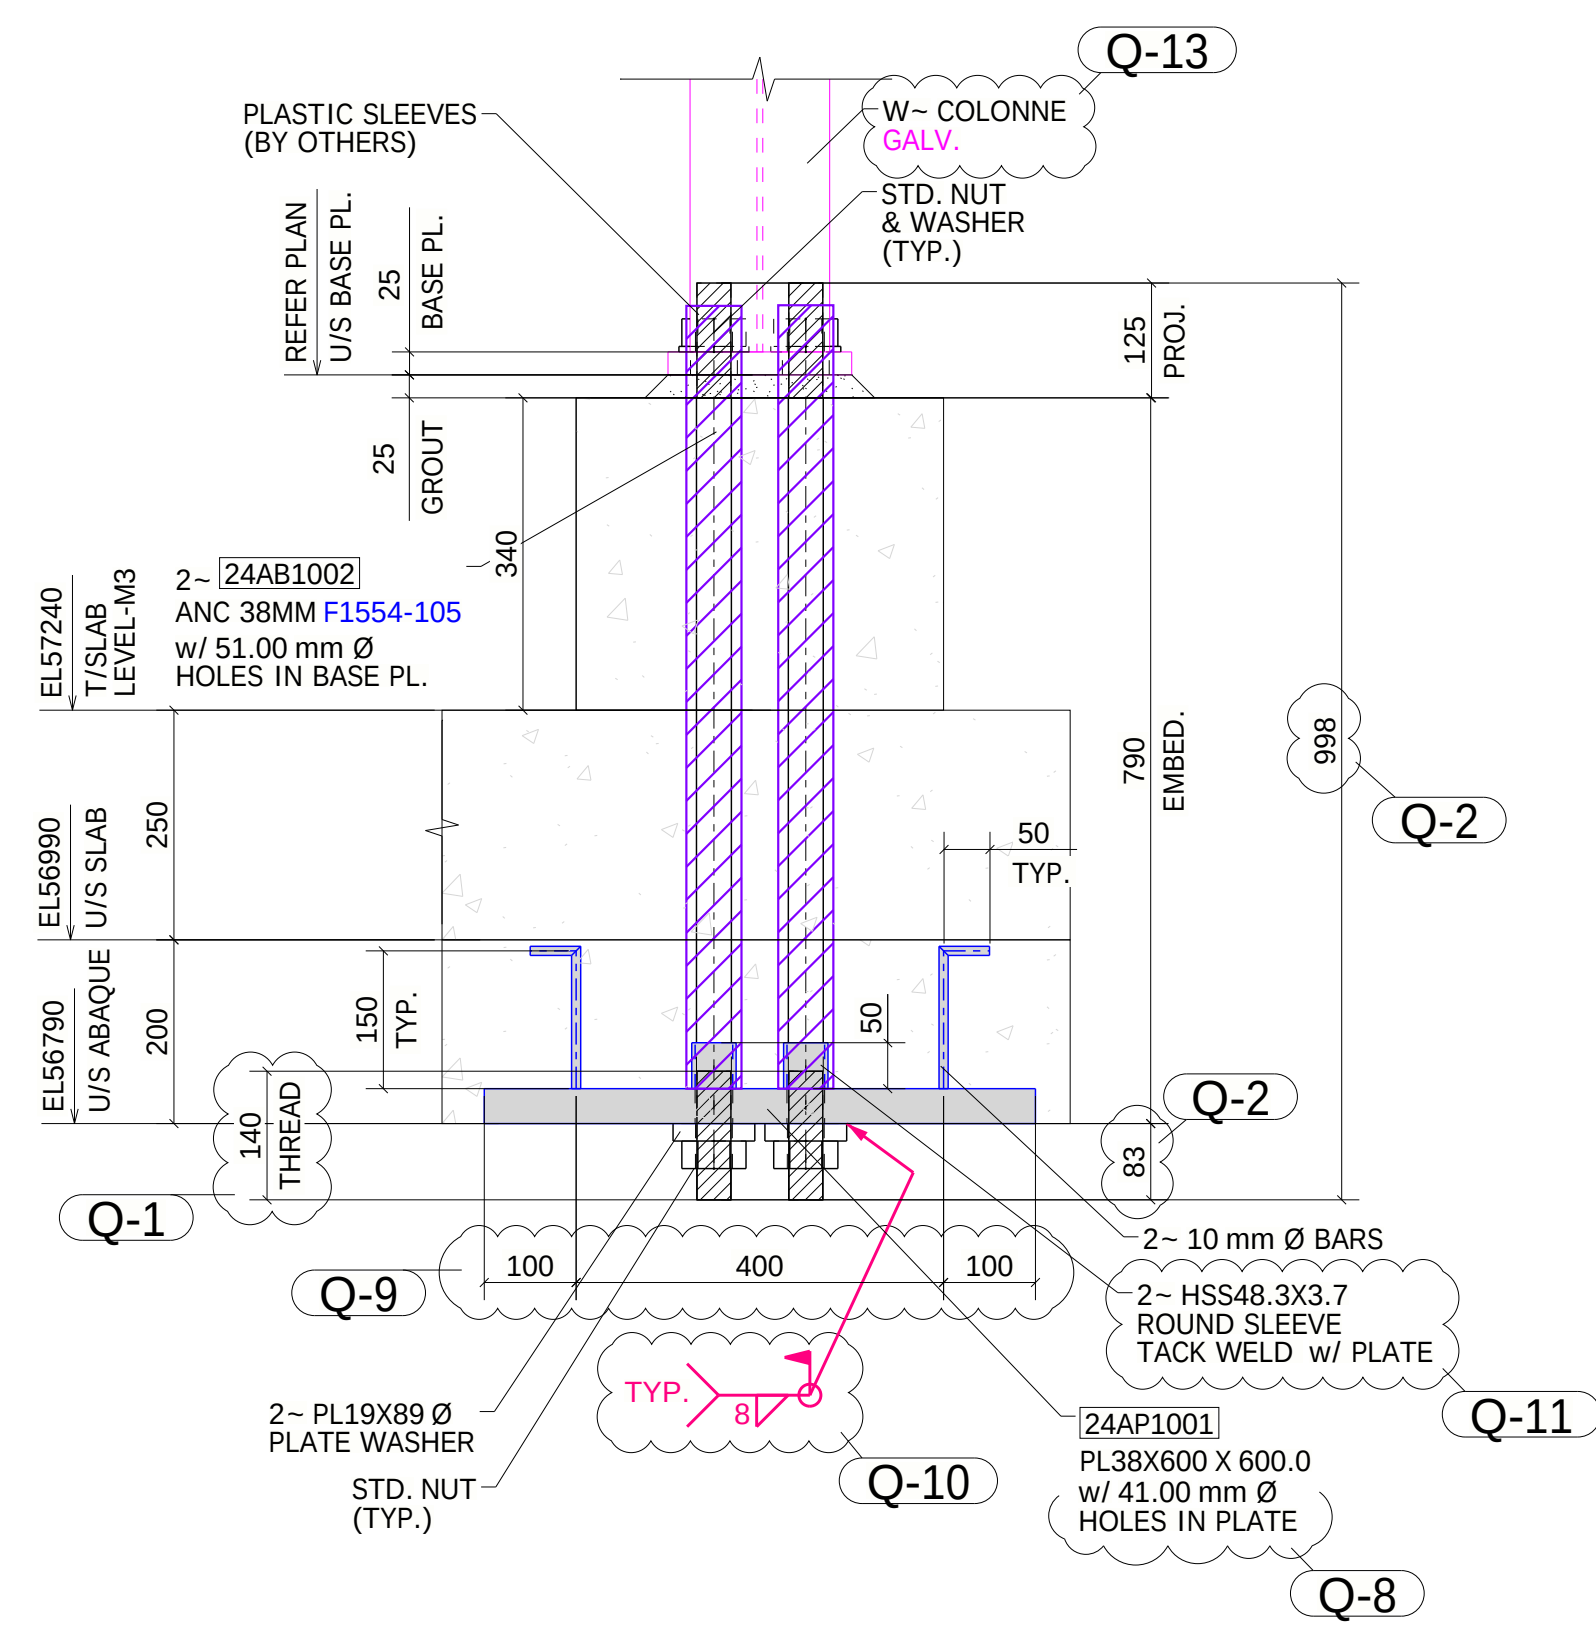

Q-1 APPROVER VERIFY THREAD LENGTH.

Q-2 APPROVER VERIFY ANCHOR ROD LENGTH.

Q-3 APPROVER VERIFY PROJECTION LENGTH. SINCE STRL.SHEET DOES NOT HAVE INFORMATION.

Q-4 APPROVER VERIFY PLATE WASHER PROFILE USED. SINCE STRL.SHEET DOES NOT HAVE INFORMATION.

Q-5 APPROVER VERIFY ANCHOR ROD MATERIAL GRADE USED.

Q-6 APPROVER VERIFY THIS DIMENSION.

Q-7 APPROVER VERIFY REQUIREMENT OF GALVANIZE FOR ANCHOR ROD. SINCE HAND SKETCH (PL-07) DETAIL SHOWS BASE PLATE IN GALVANIZE SINCE COLUMNS ARE NOT GALVANIZED AT (PL-7) LOCATION.

Q-8 APPROVER VERIFY ANCHOR ROD HOLE SIZE IN PLATE.

Q-9 APPROVER VERIFY ROD LOCATING DIMENSIONS.

Q-10 APPROVER VERIFY REQUIREMENT OF WELD. IF YES PLEASE VERIFY WELD DETAILS.

Q-11 APPROVER VERIFY ROUND SLEEVE PROFILE USED.

Q-12 APPROVER VERIFY ANCHOR ROD LENGTH AT TYPE-1A LOCATION. SINCE WE HAVE FOLLOWED 798mm LENGTH ANCHOR ROD AT NO ABAQUE LOCATIONS.


Q-13 APPROVER VERIFY WE ARE PROVIDED NON GALV. ANCHOR PLATE AND ROD. EVEN THOUGH COLUMNS ARE IN GALV. PLEASE VERIFY AND CONFIRM.

APPROVER VERIFY/FURNISH ALL CLOUDED INFORMATIONS


REFER 3AAB101 TO 3AAB103 FOR COLUMN SIZES, ORIENTATION AND BASE PLATE ORIENTATION.

DATE	NO	DESCRIPTION	PAR	COLONS
06/21/2022	1	FOR RE-APPROVAL		1-23A PRIMER
06/01/2022	2	FOR APPROVAL		

GRADE ACHER	300W	S.I.C.
FLUENT/PROCES	E48XX	S.I.C.
ROCKWELL	6mm	S.I.C.
THICK	220	S.I.C.
ROCKWELL	ASCM	S.I.C.
FLUENT/PROCES	1-23A PRIMER	S.I.C.

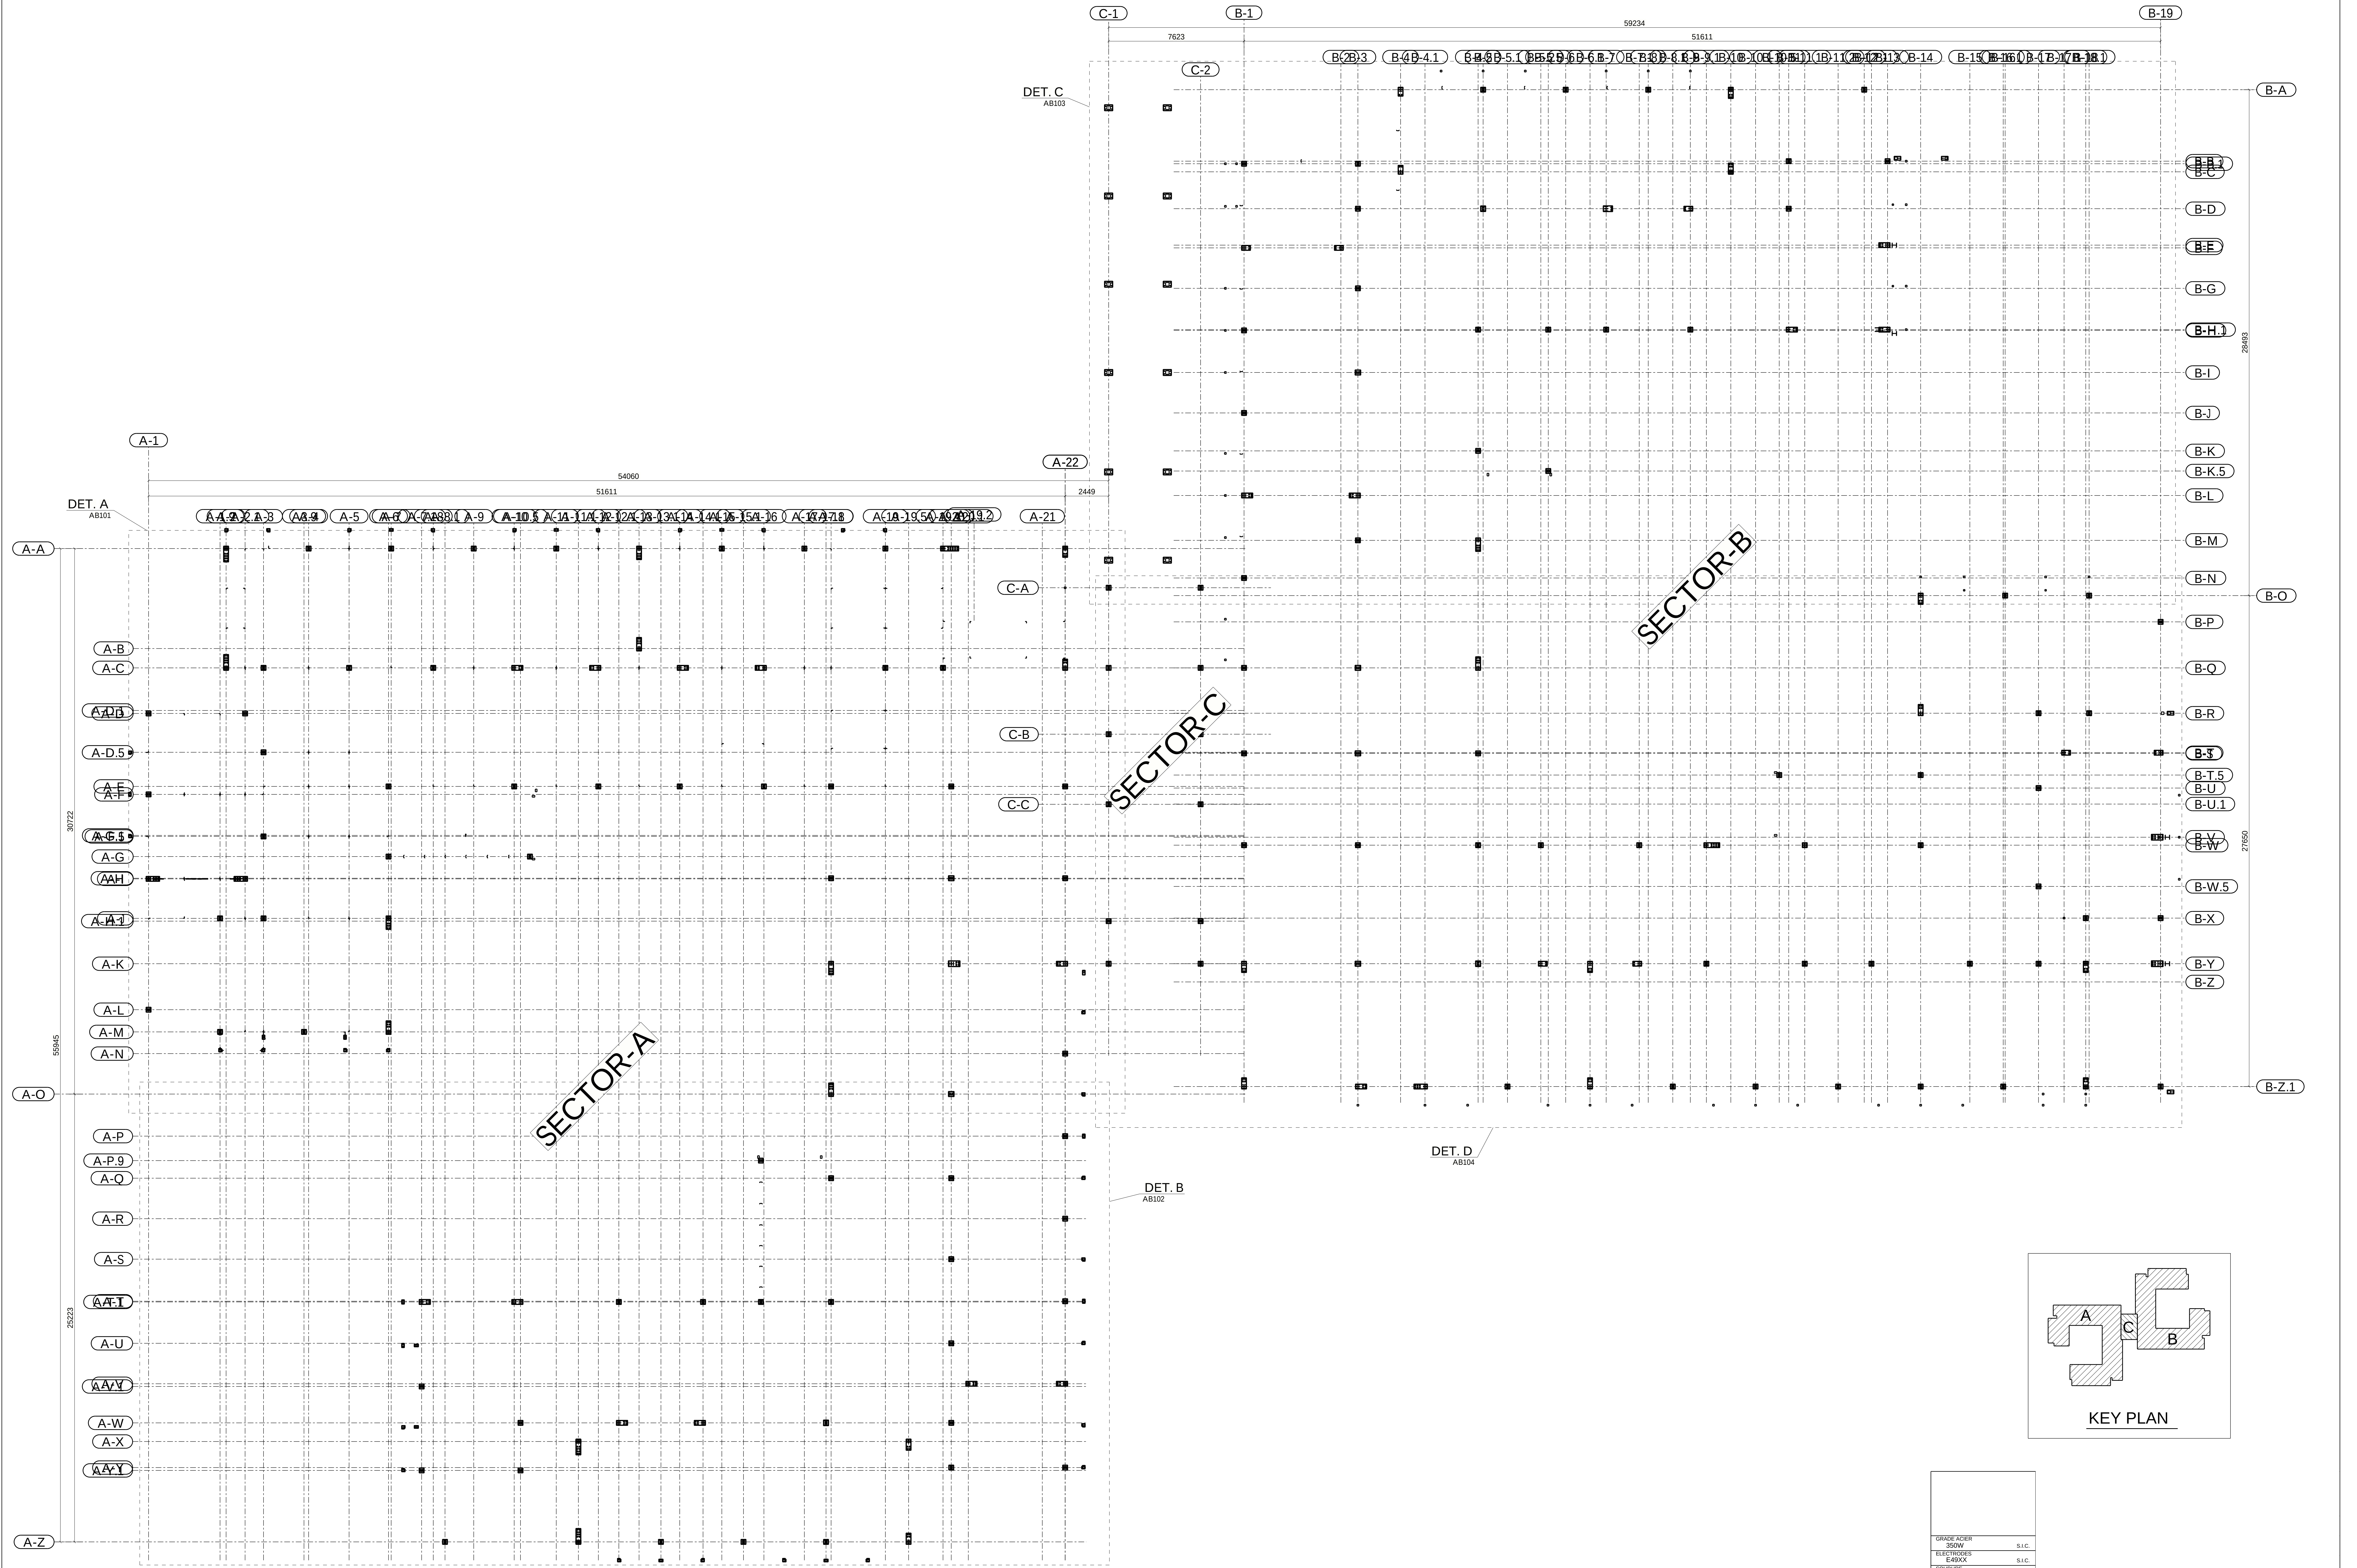


ANCHOR BOLT SETTING KEY PLAN (SECTOR A-B-C)

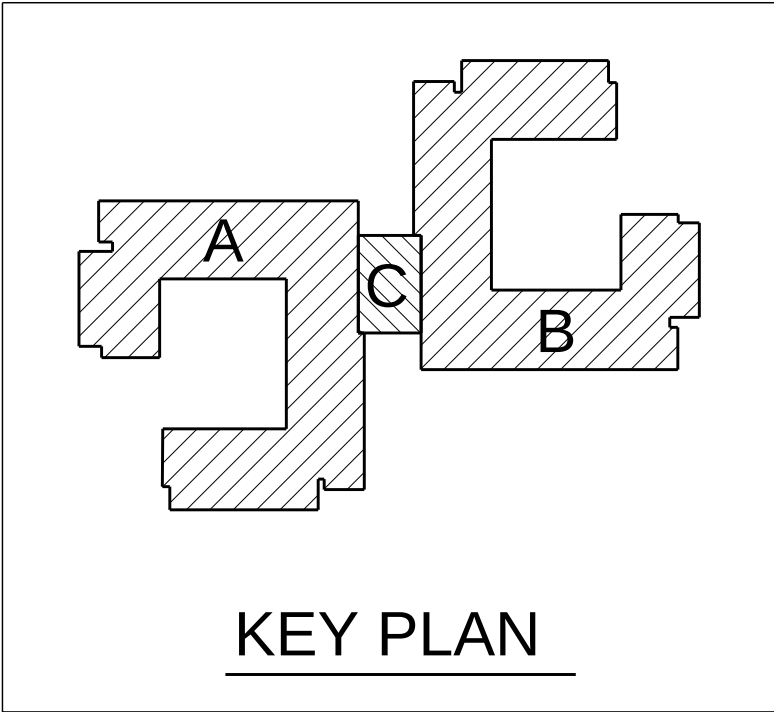

GRADE ADJER	350W	S.I.C.
ELECTRODES	E48XX	S.I.C.
SCREWER	6mm	S.I.C.
THROD	22Ø	S.I.C.
ROULONS	A325N	S.I.C.
PENTURE		S.I.C.

DATE	NO	DESCRIPTION	PAR
02/09/2021	△	FOR FIELD USE	
01/27/2021	△	FOR APPROVAL	

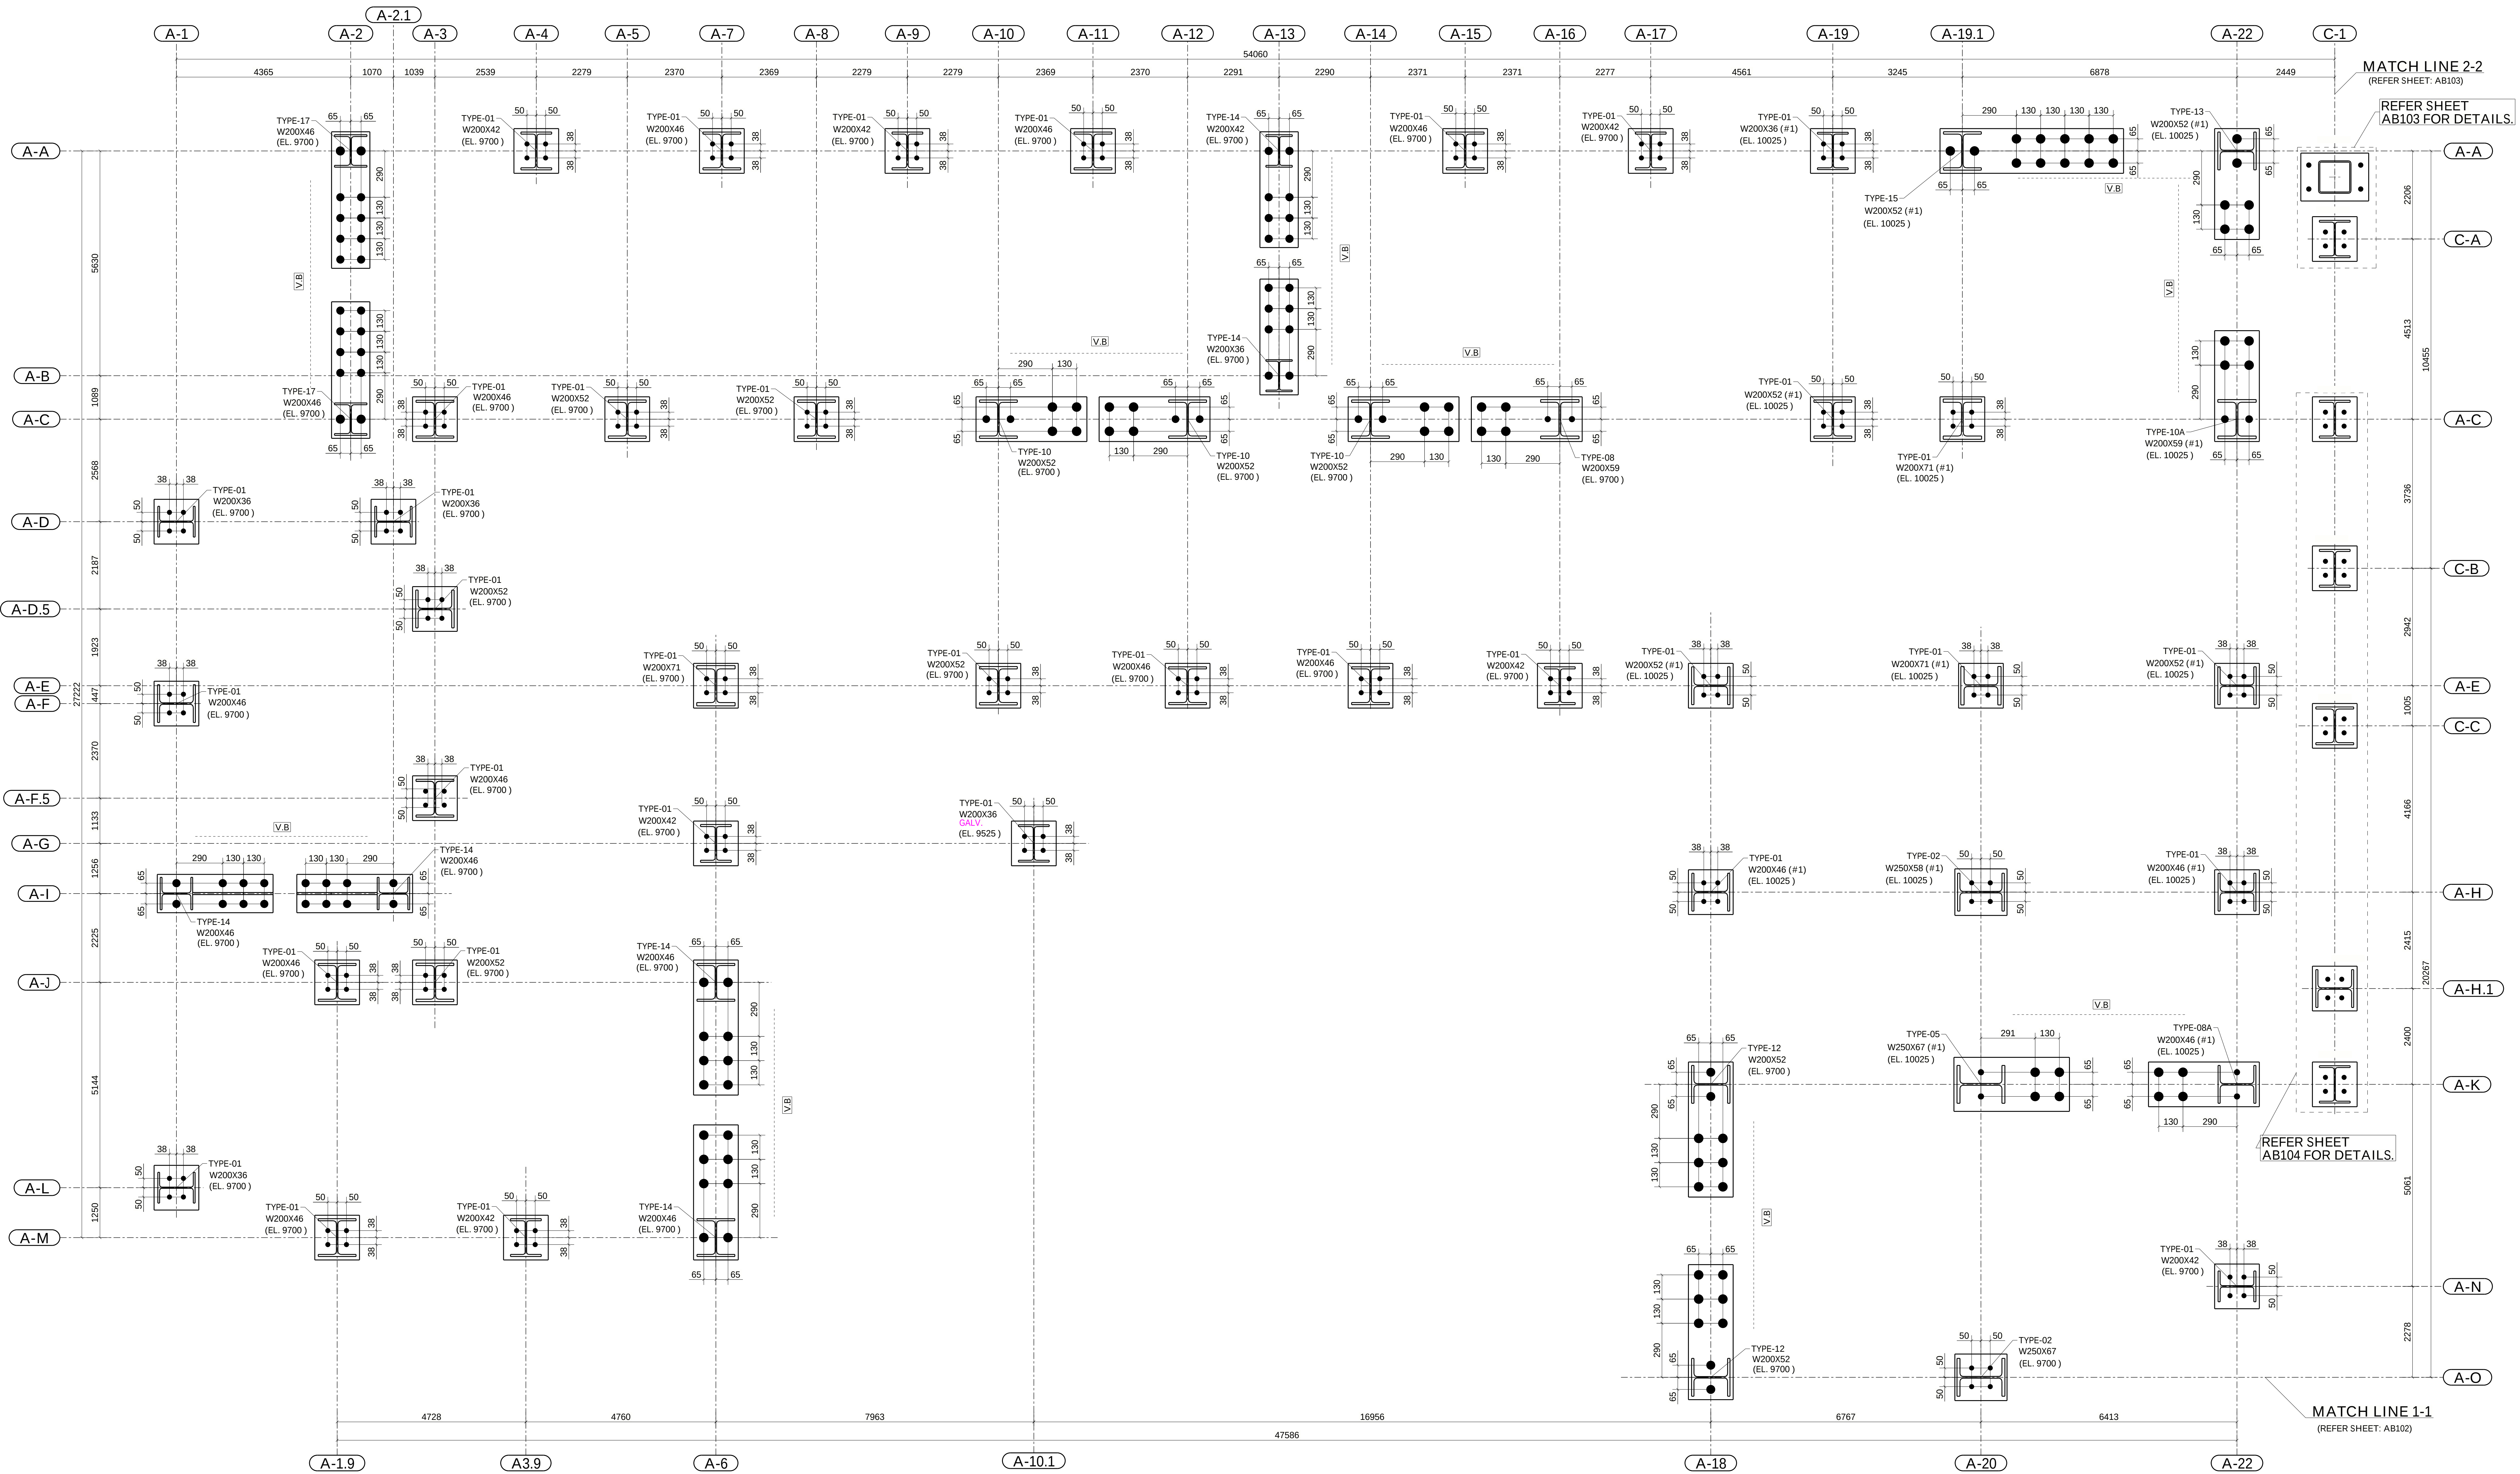

DETAIL-A
AB-100
PARTIAL ANCHOR BOLT SETTING PLAN (SECTOR-A)
(REFER SHEET: S-152A)

NOTES:


- FINISH FLOOR EL.=10000 mm = DATUM ELEVATION.
- ALL ELEVATIONS SHOWN AT COLUMN LOCATIONS ARE REFERRED TO UNDER SIDE OF BASE PLATE ELEVATIONS.
- REFER AB105 & AB106 FOR BASE PLATE AND ANCHOR ROD DETAILS.
- V.B. -INDICATES VERTICAL BRACING.
- ★ -INDICATES COLUMN OFFSET.

(#1) - INDICATED LOCATION COLUMN U/S BASE PLATE EL.10025 FOR STRUCTURAL SLAB.

GRADE ACIER	S.I.C.
350W	S.I.C.
ELECTRICISS	S.I.C.
E48XX	S.I.C.
SECURE	S.I.C.
6mm	S.I.C.
THICK	S.I.C.
22Ø	S.I.C.
ROULONS	S.I.C.
A32N	S.I.C.
PERITURE	S.I.C.

DATE	NO	DESCRIPTION	PAR
02/08/2021	1	FOR FIELD USE	
01/27/2021	2	FOR APPROVAL	

TRAIL STRUCTURES







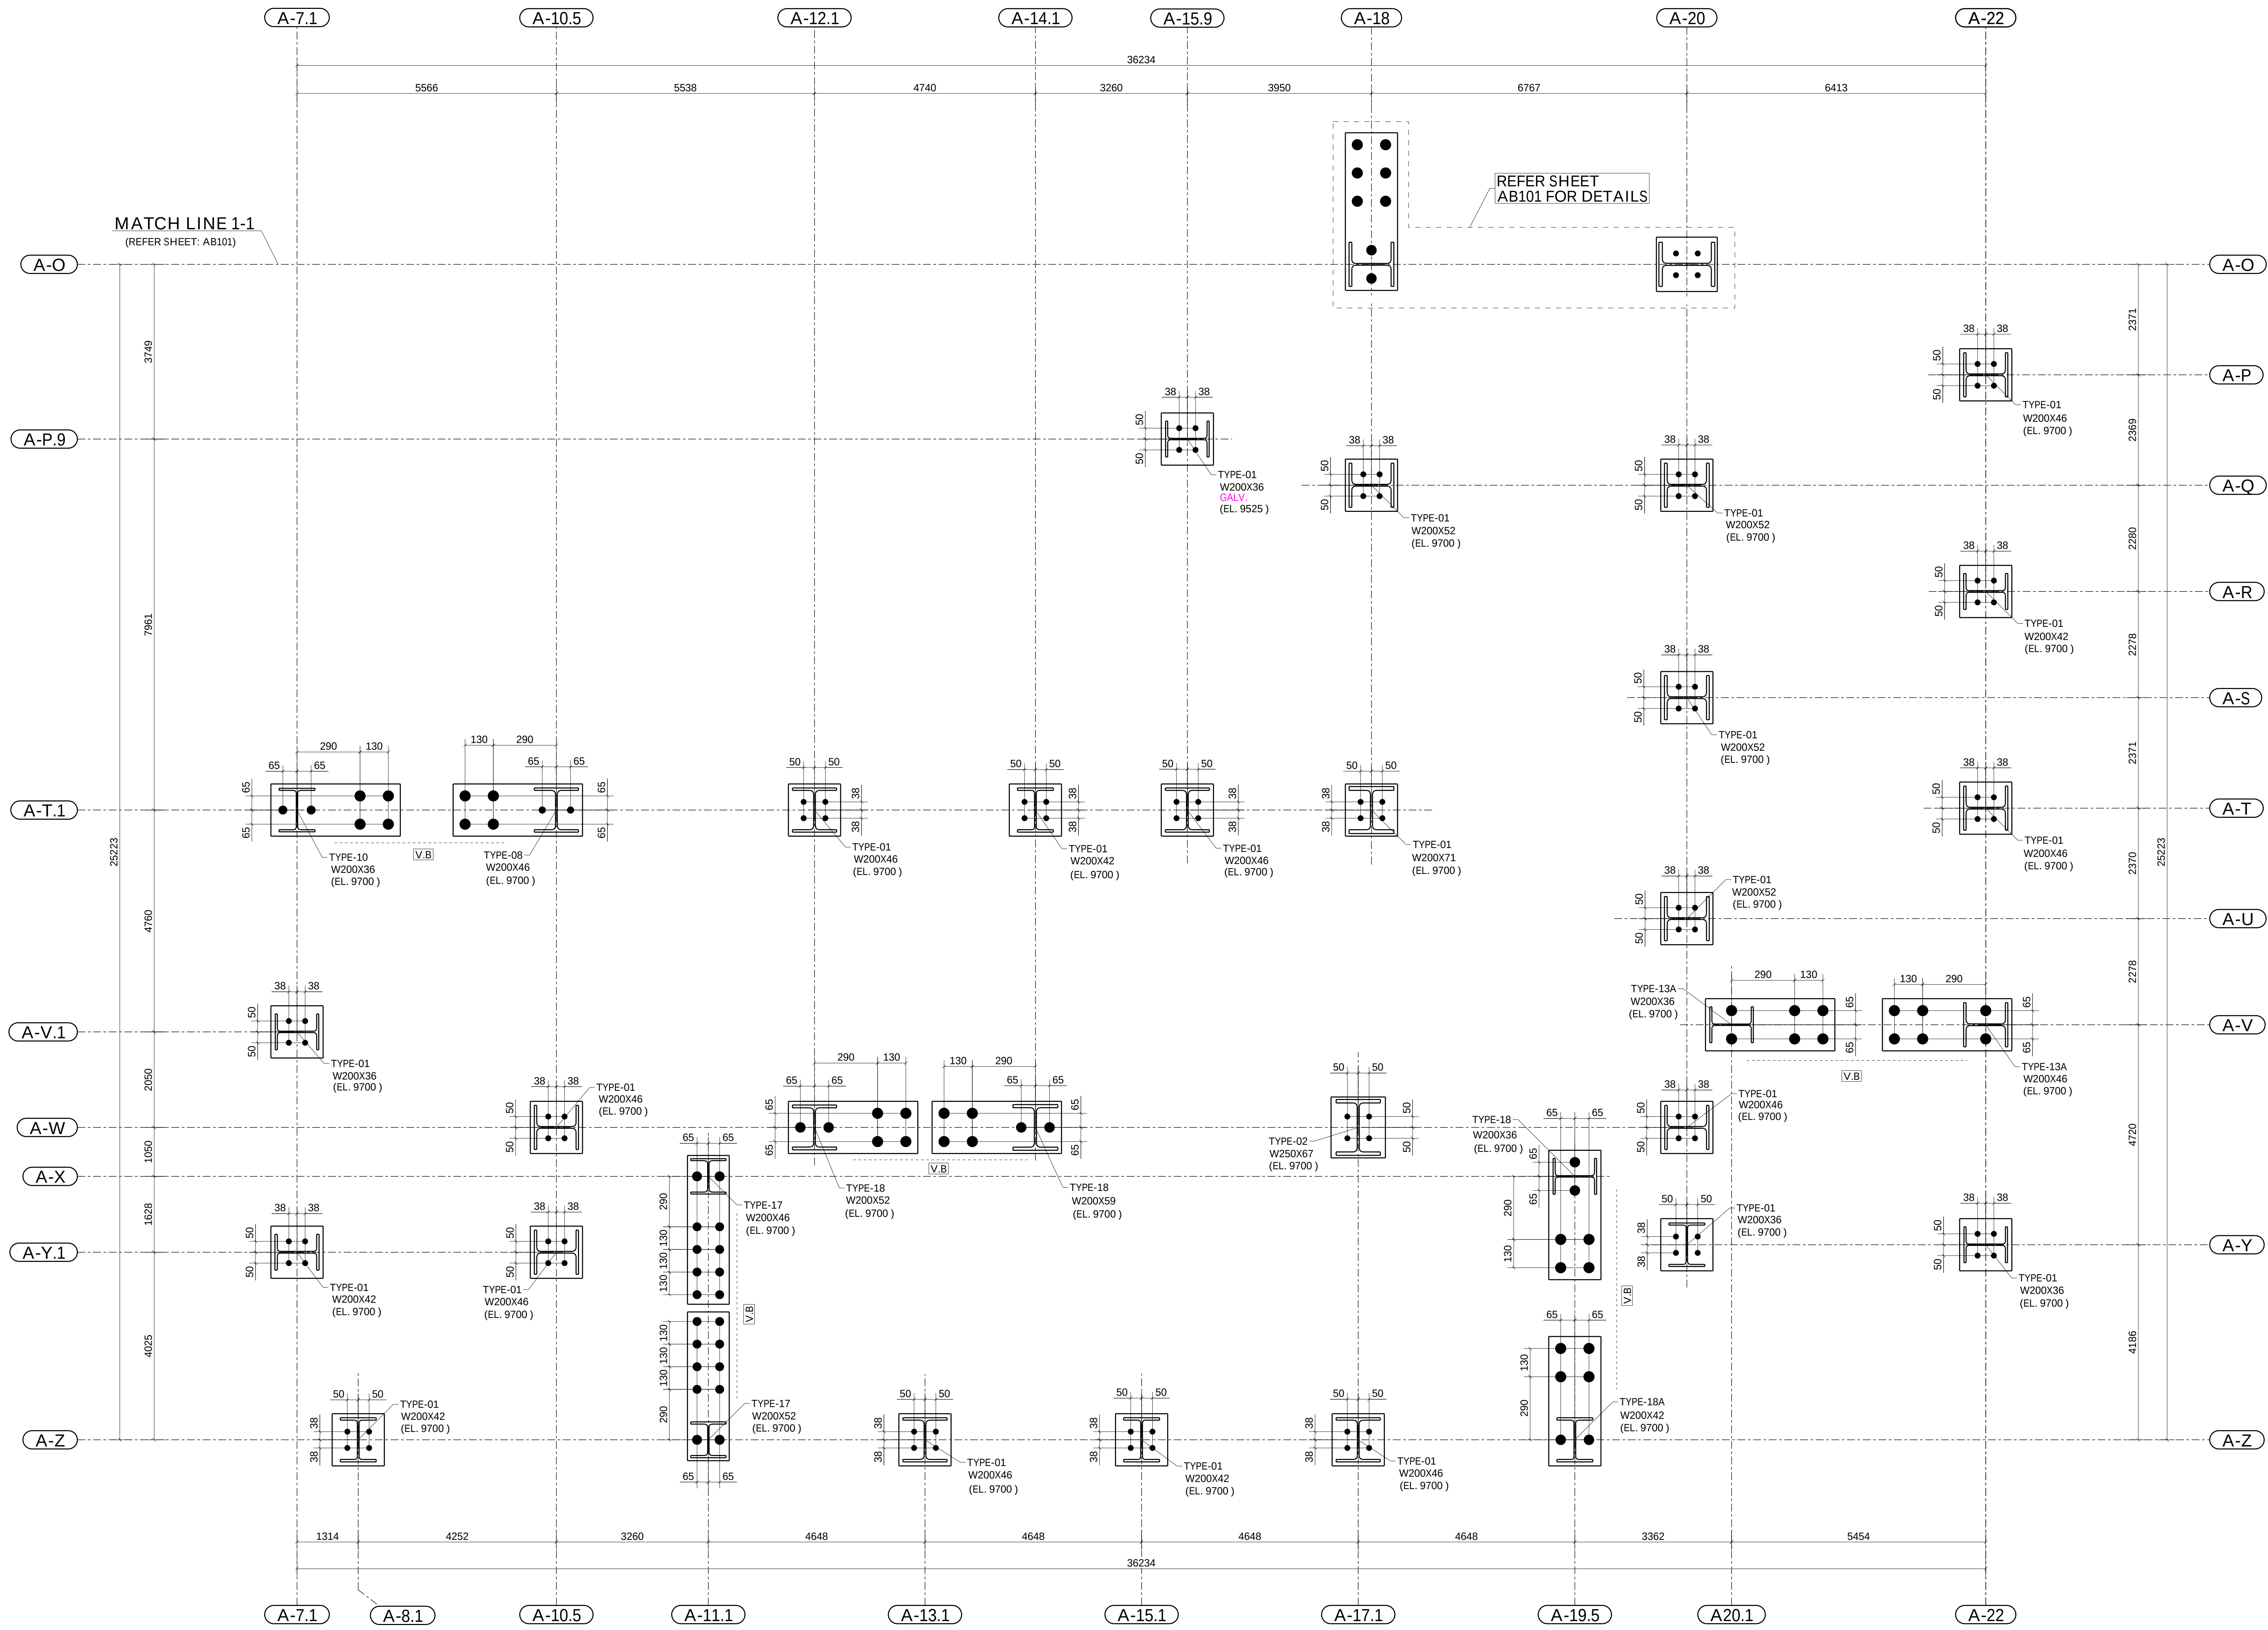


DETAIL-B
AB-100
PARTIAL ANCHOR BOLT SETTING PLAN (SECTOR-A)
(REFER SHEET S-152A)


DATE	NO	DESCRIPTION	PAR
02/08/2021	1	FOR FIELD USE	
01/27/2021	2	FOR APPROVAL	

GRADE ADIR	350W	S.I.C.
ELECTRICALS	E48XX	S.I.C.
SCAFFOLD	6mm	S.I.C.
TRUSS	220	S.I.C.
ROULERS	A32N	S.I.C.
PERITURE		S.I.C.




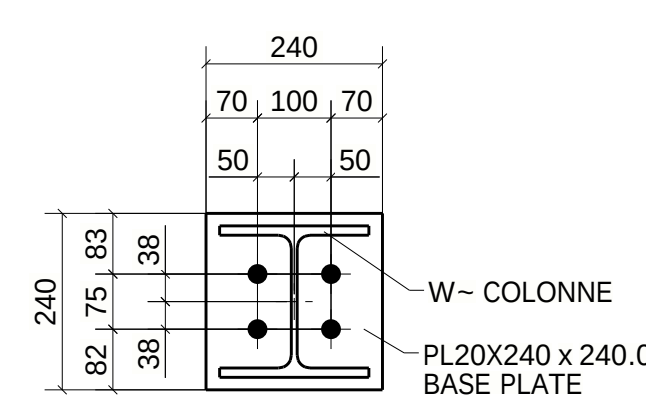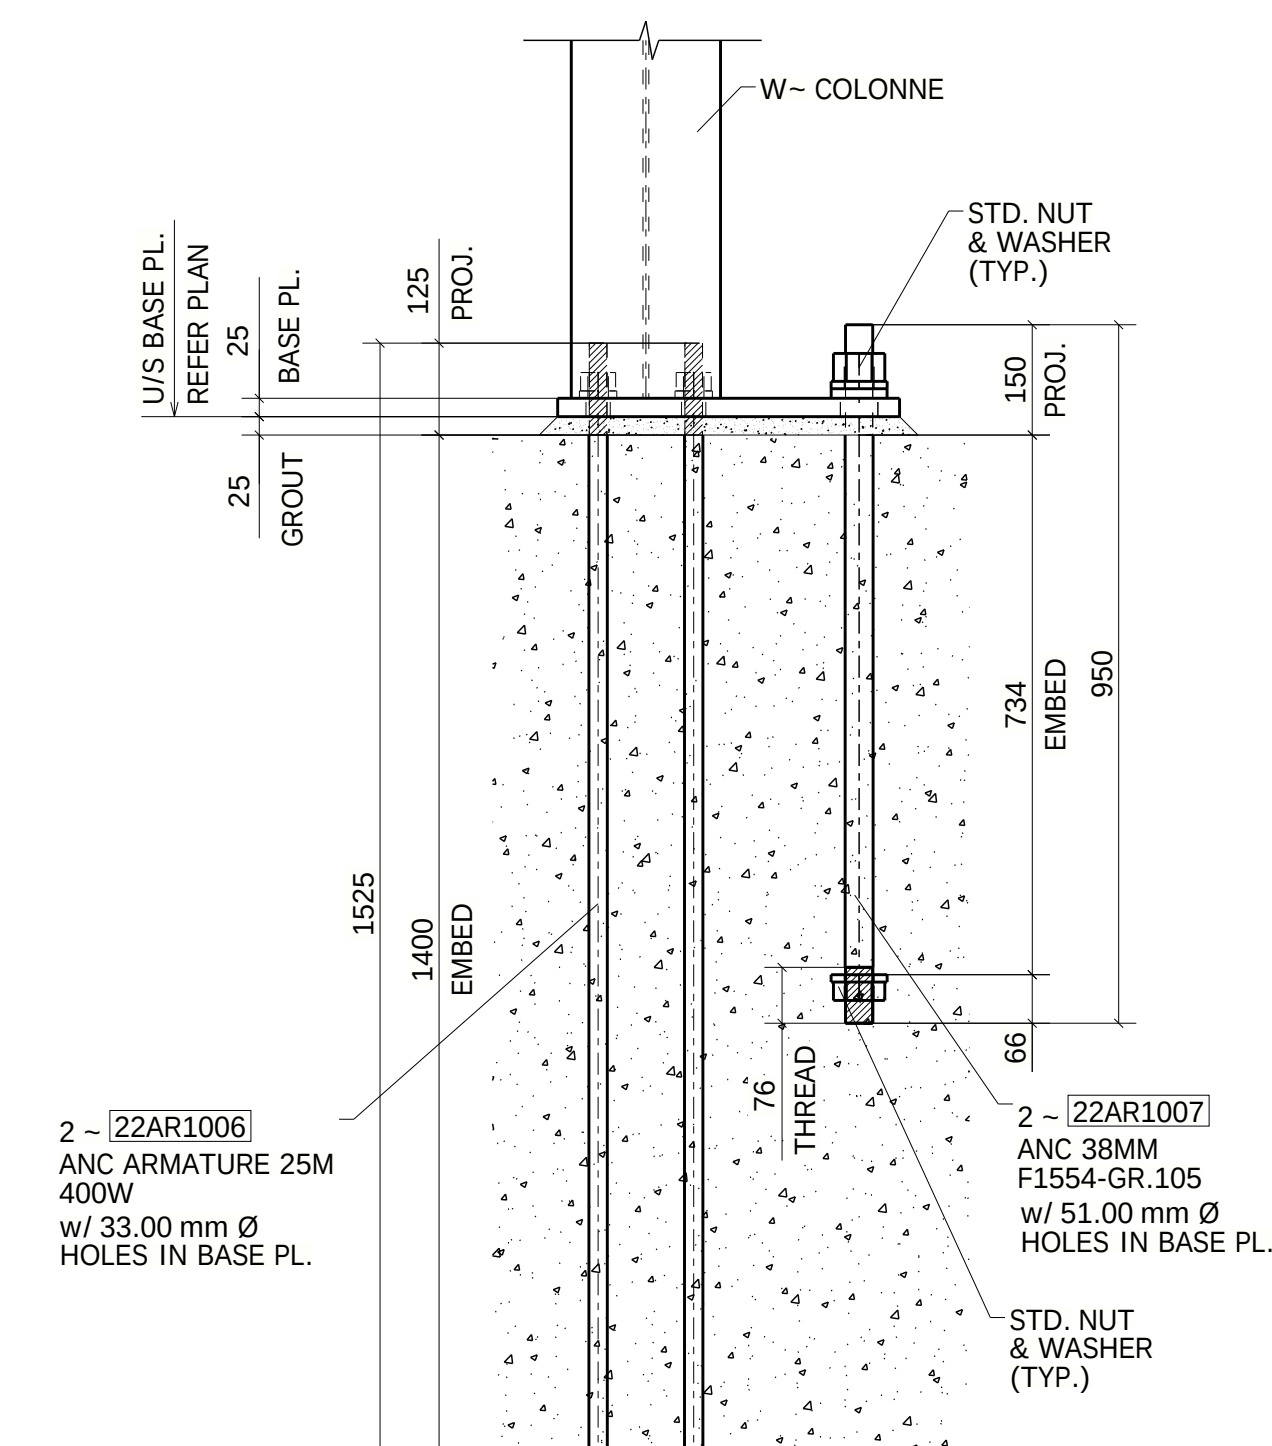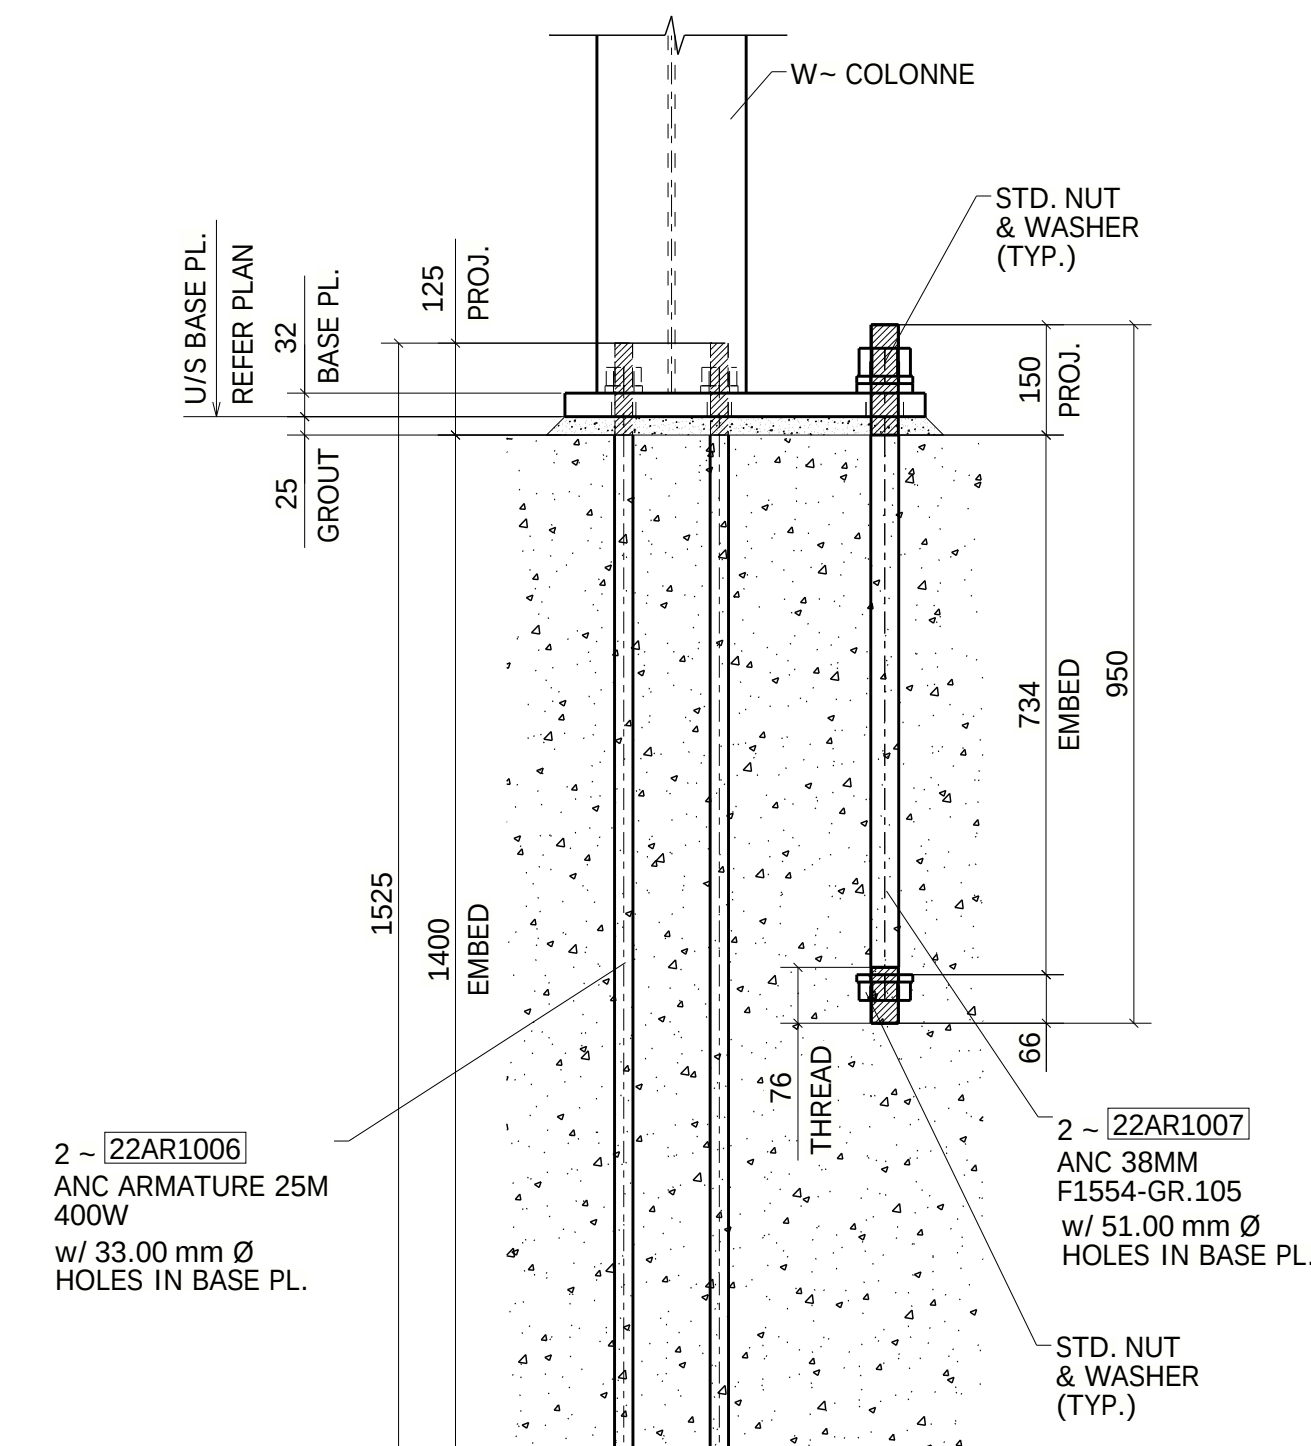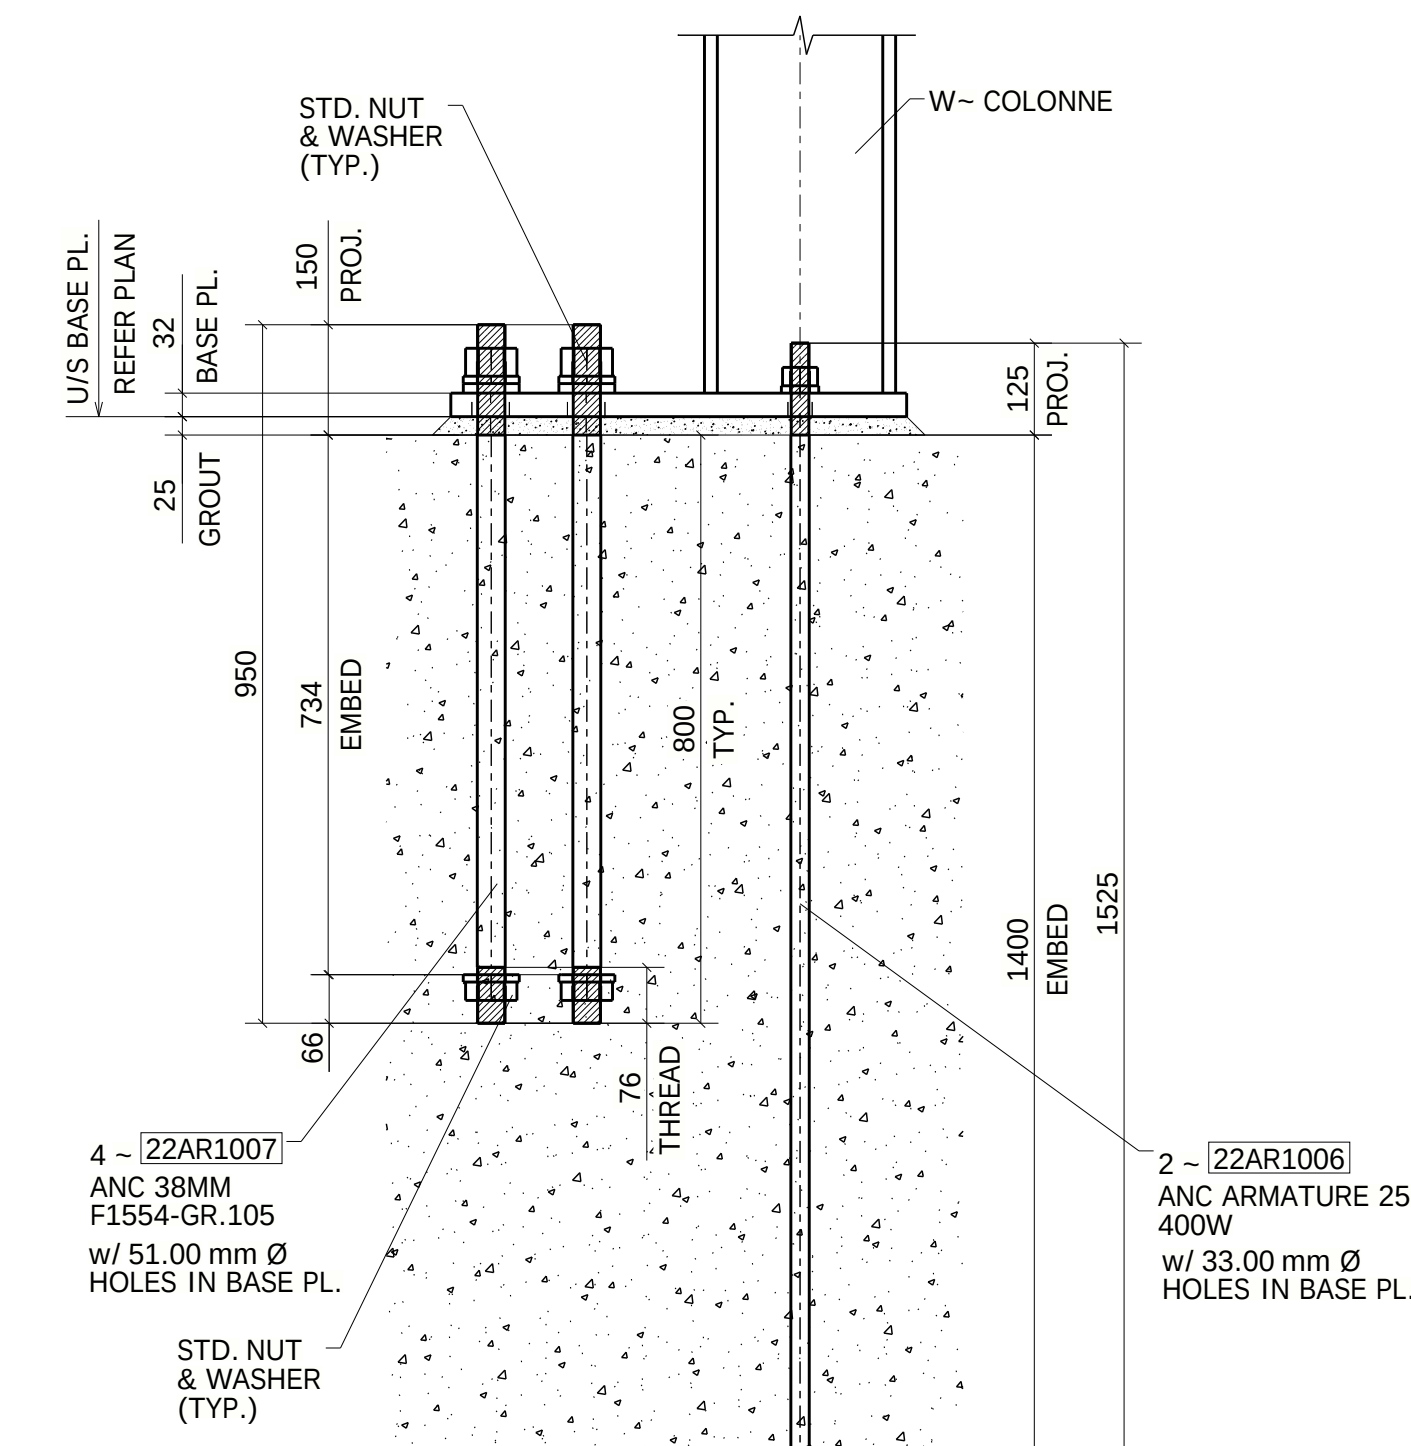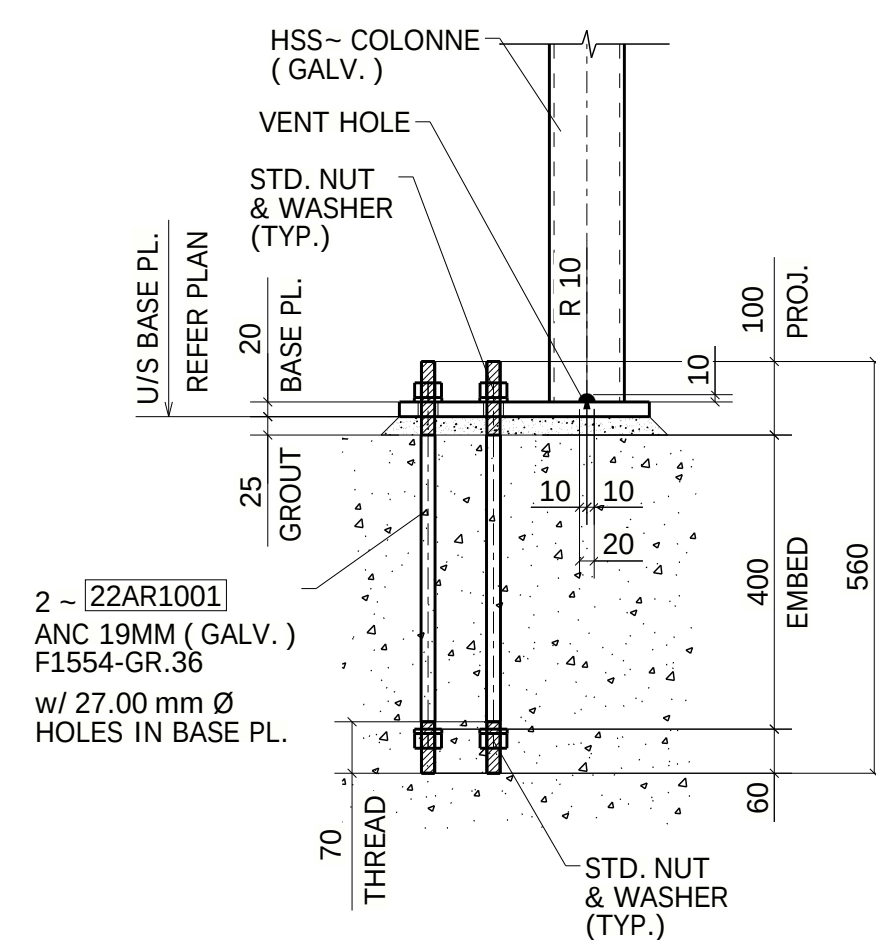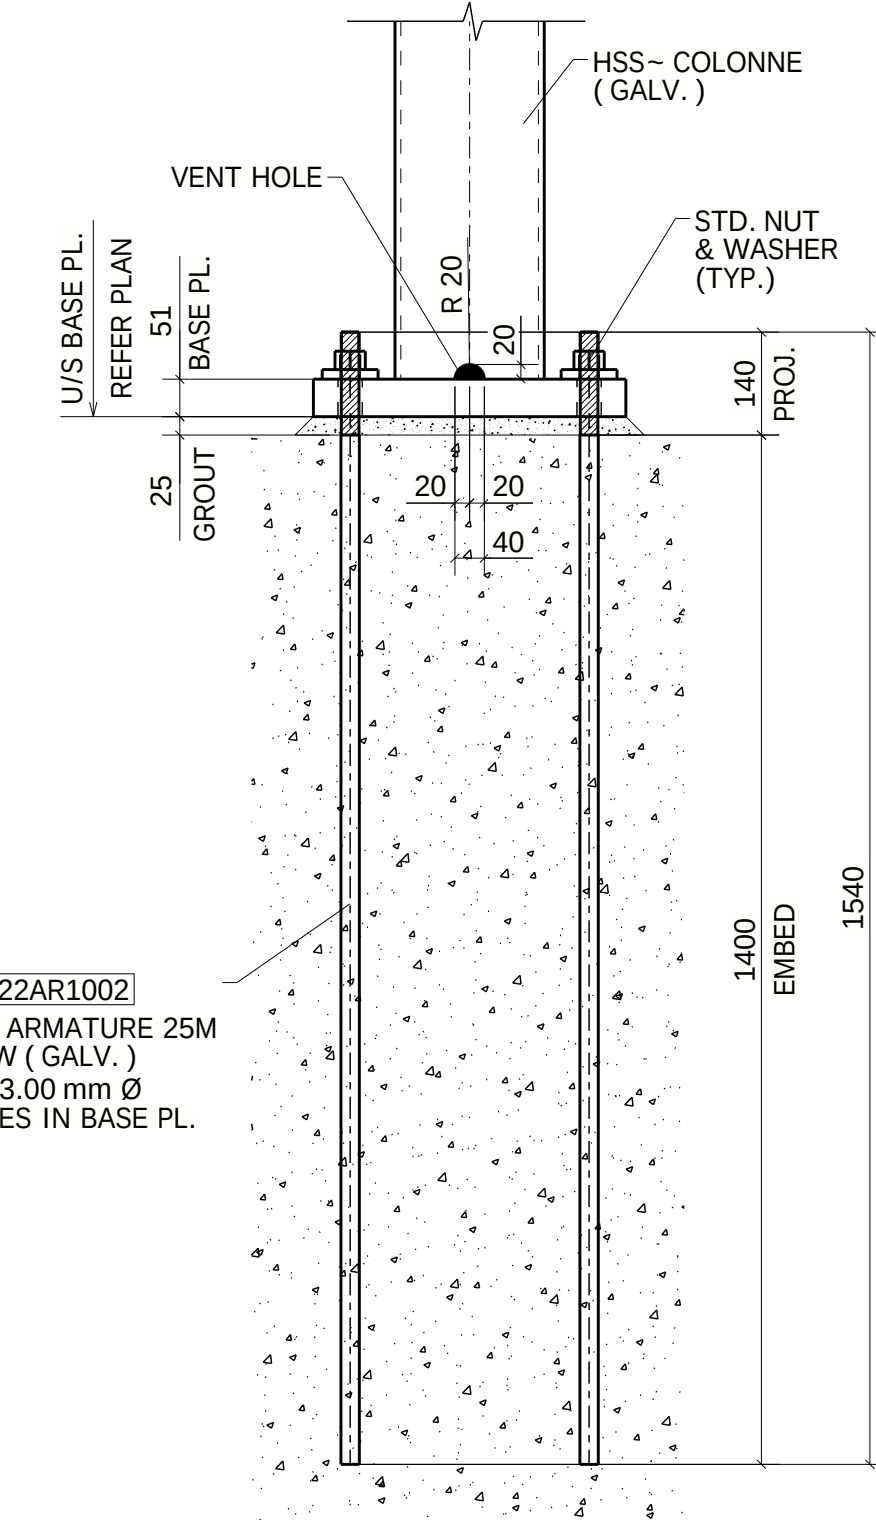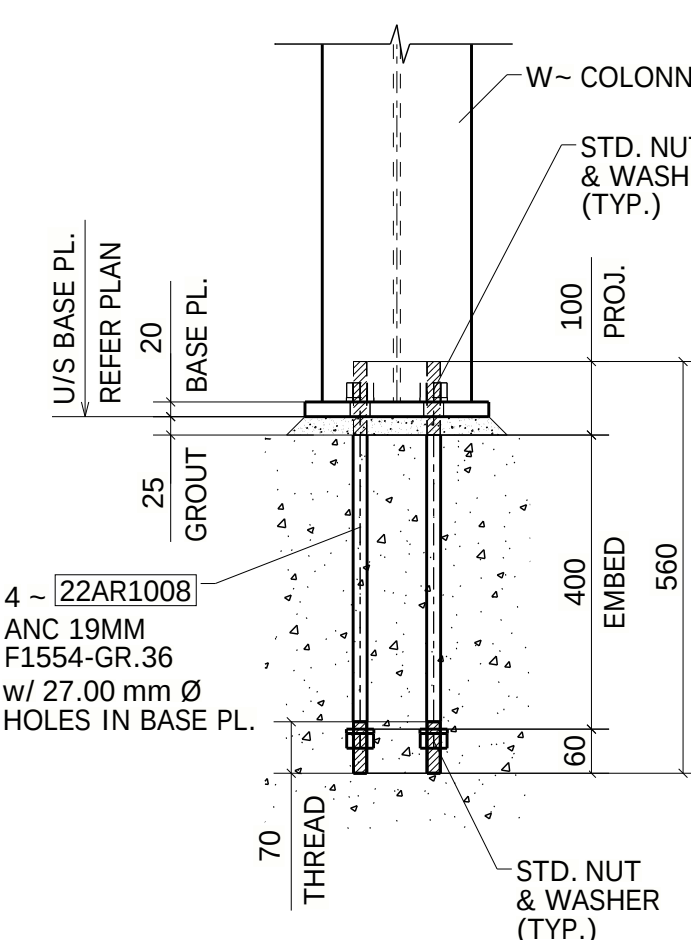


TYPE-01
(123-LOCATION)
119-LOCATION-NO PAINT (476 ANCHORS)
4-LOCATION- **GALVANIZED** (16 ANCHORS)
(REF : PB-3/S-170)

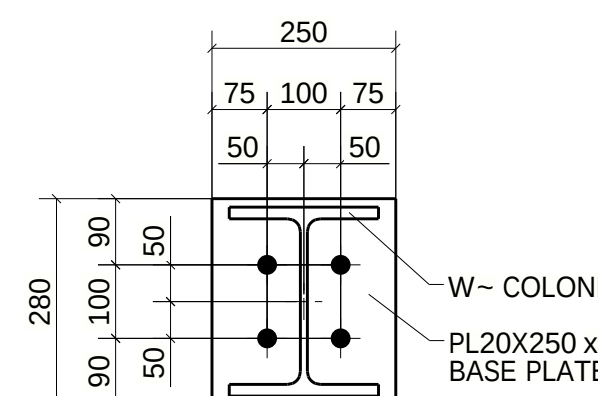


TYPE-02
(09-LOCATION)
(REF : PB-4/S-170)

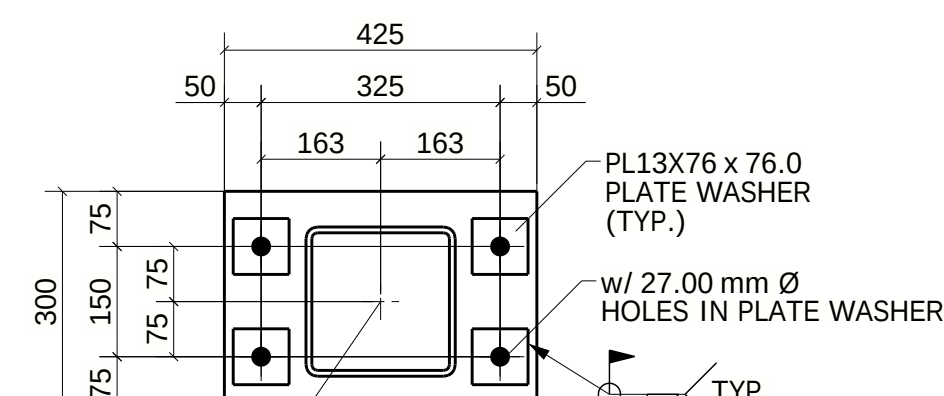


TYPE-03
(12-LOCATION)
(REF : PB-5/S-170)

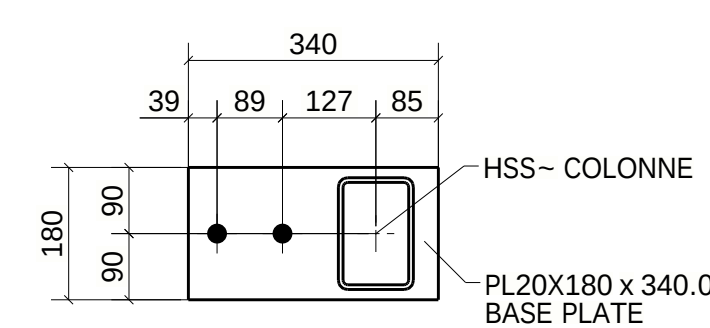


TYPE-04
(06-LOCATION)
(REF : PB-6/S-170)

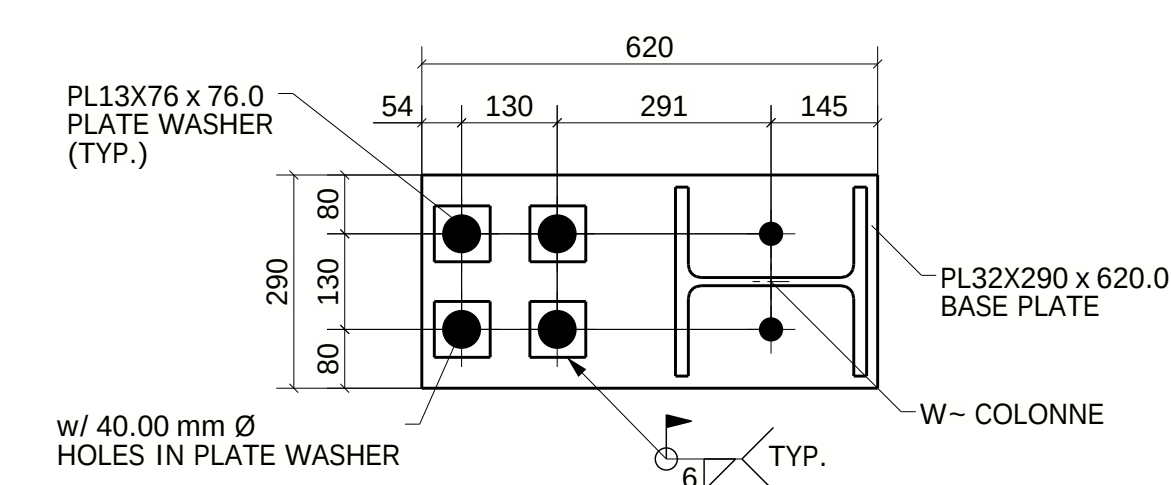








TYPE-05
(03-LOCATION)
(REF : PB-2-A-4/S-170)

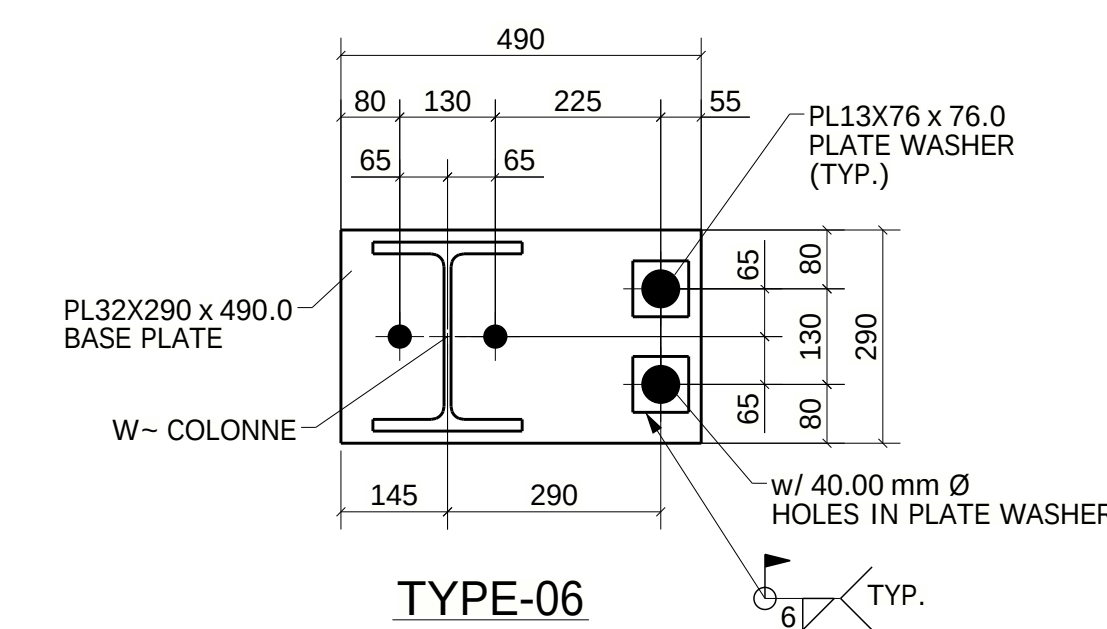


TYPE-06
(01-LOCATION)
(REF : PB-2-A-2/S-170)

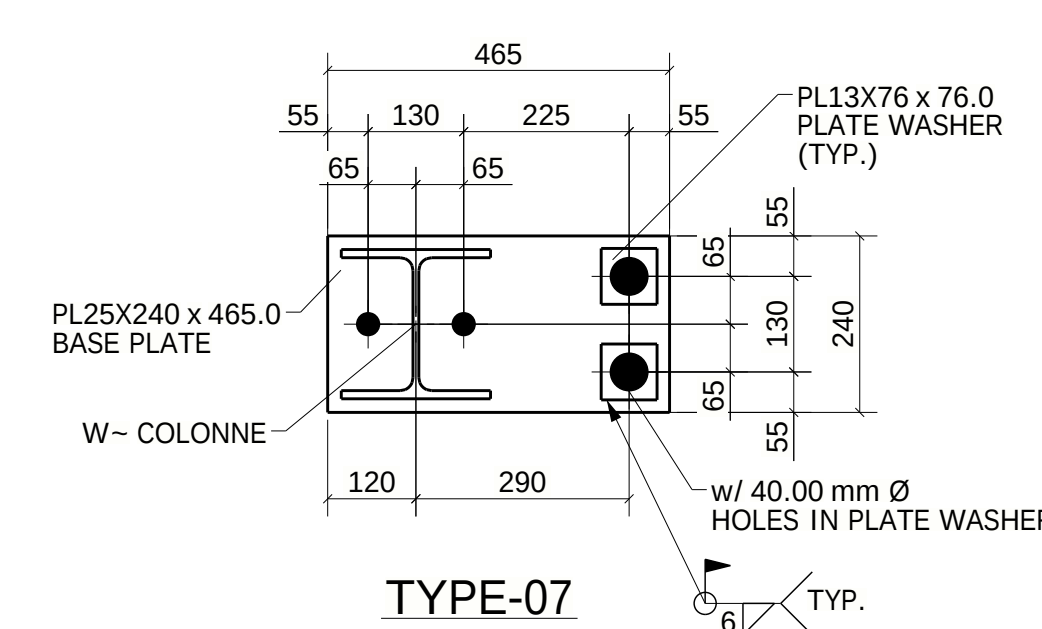


TYPE-07
(04-LOCATION)
(REF : PB-1-A-2/S-170)

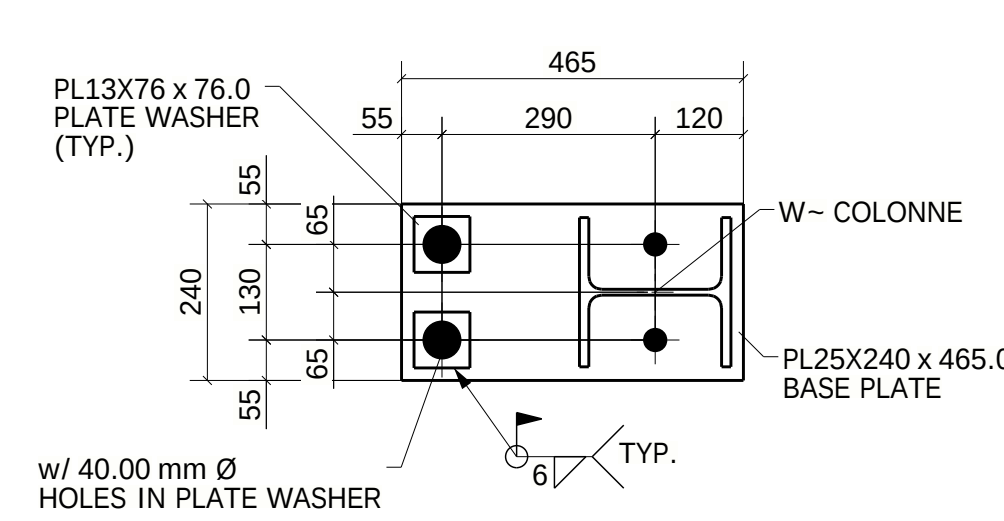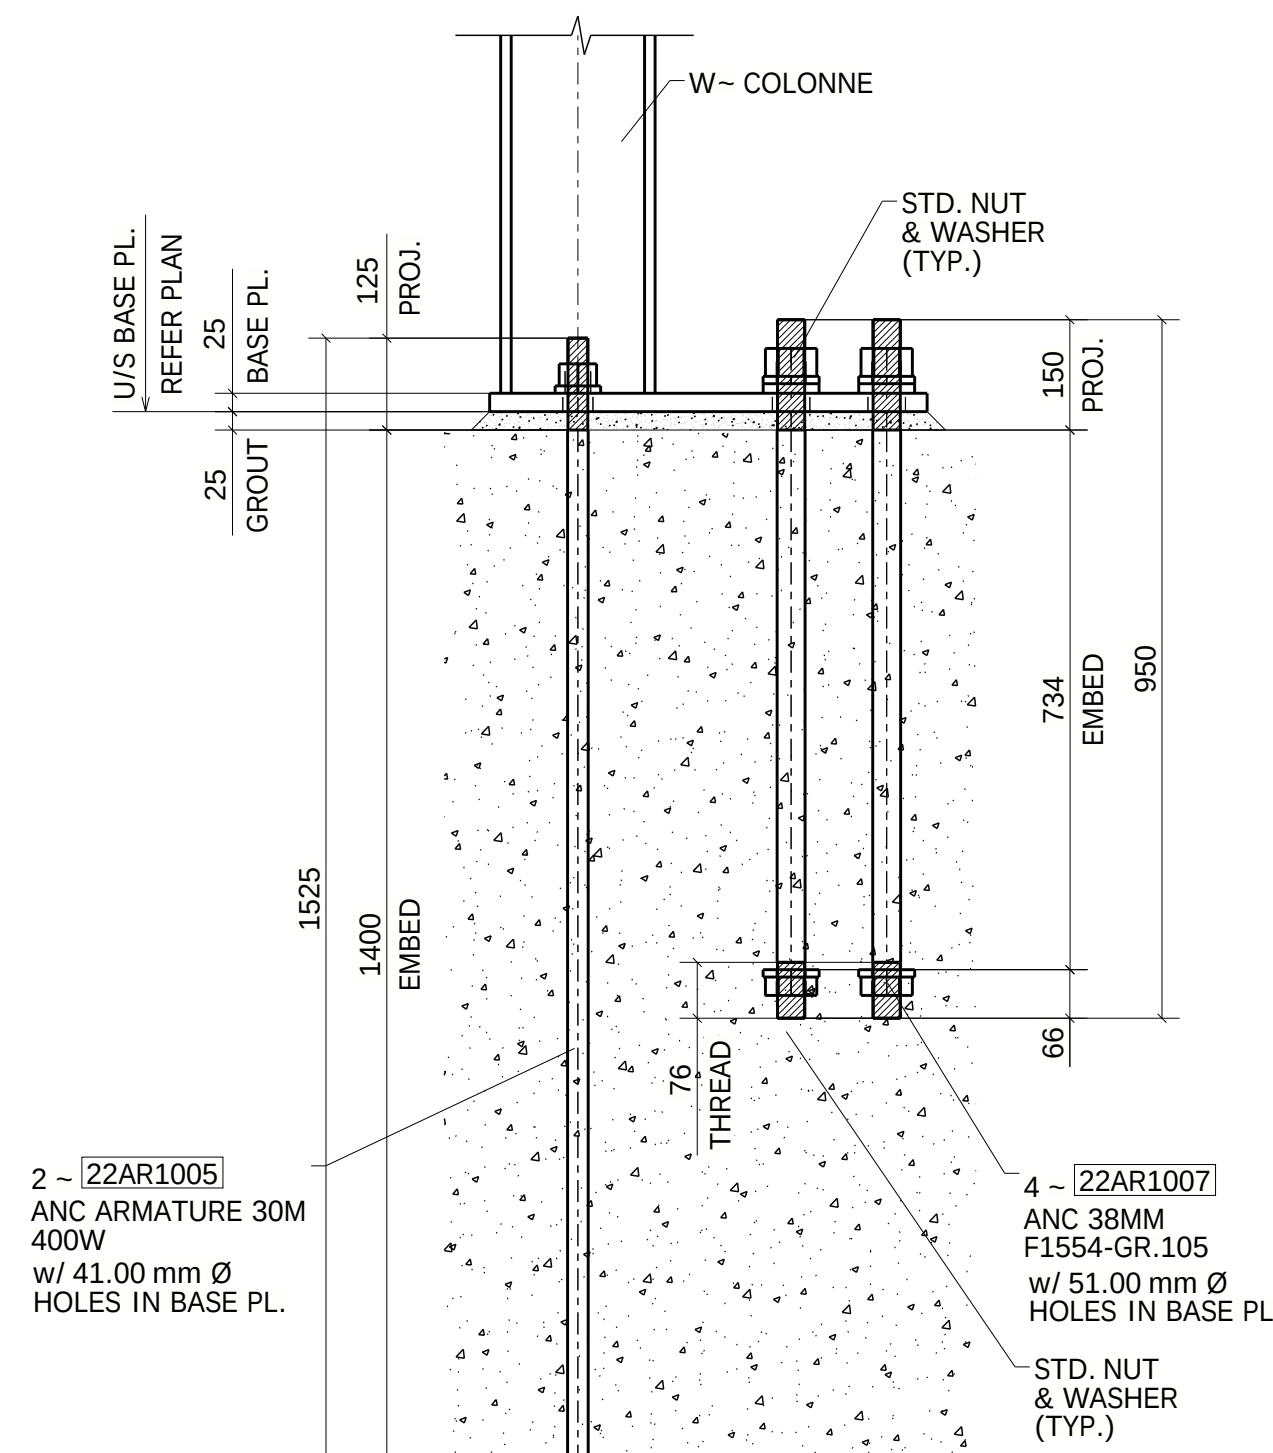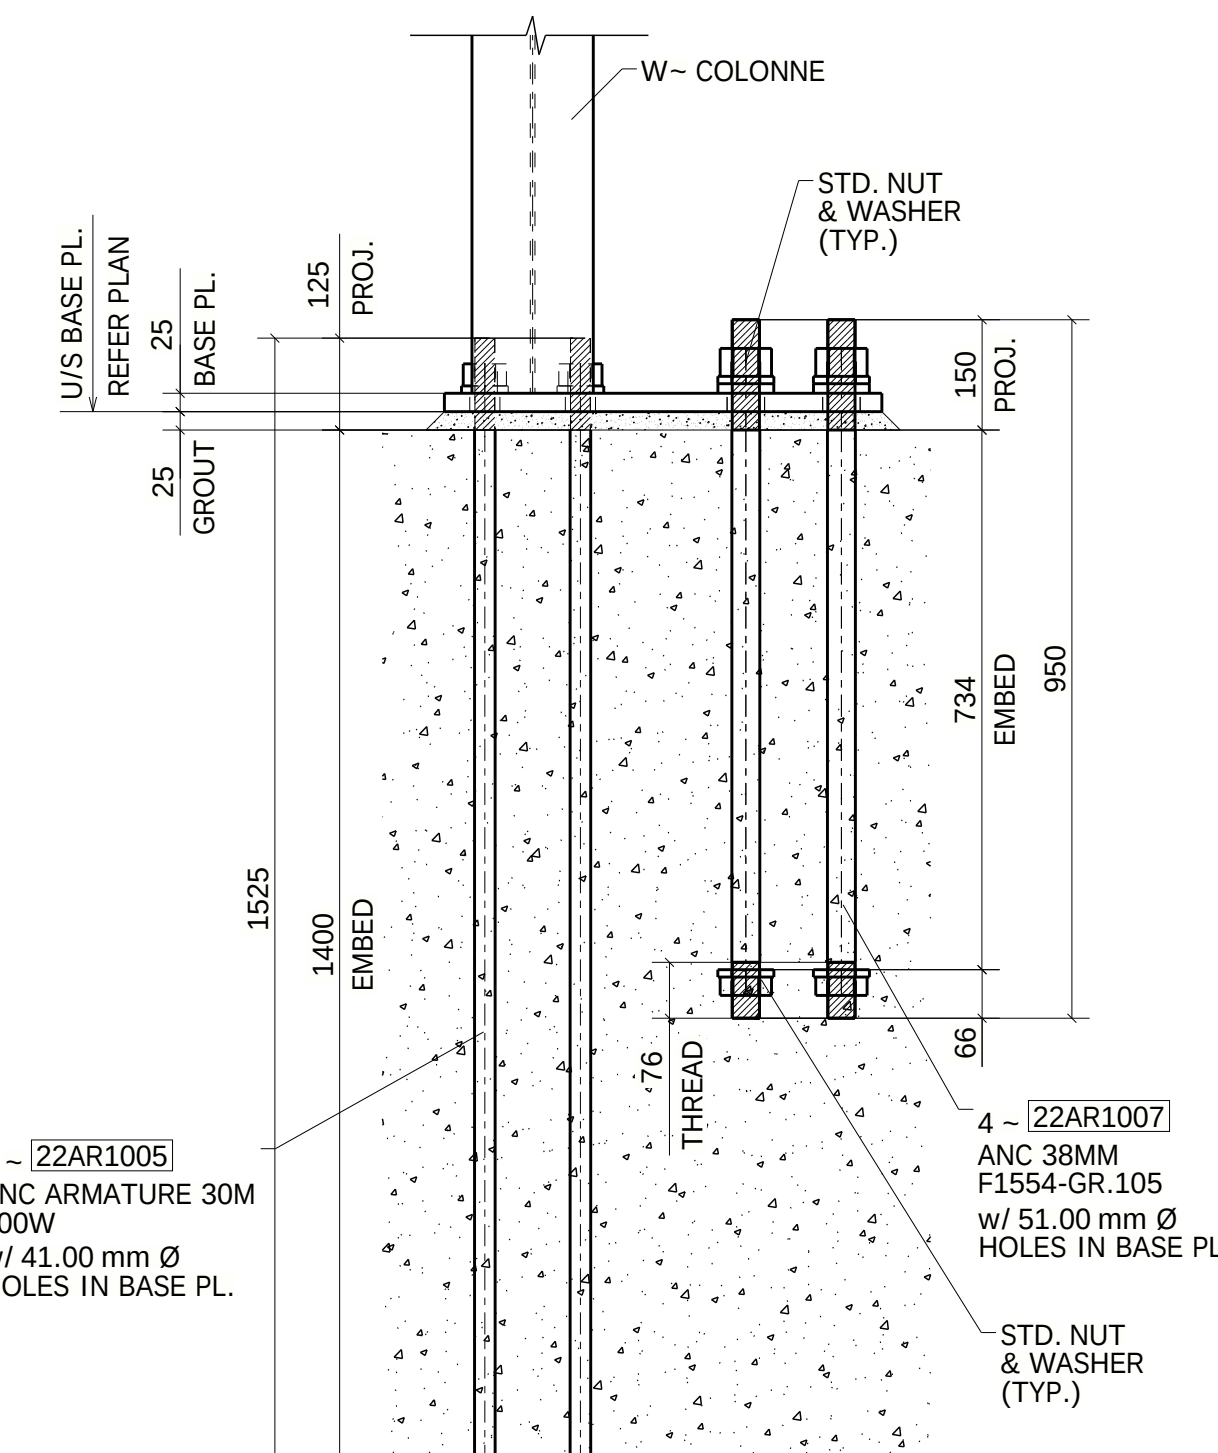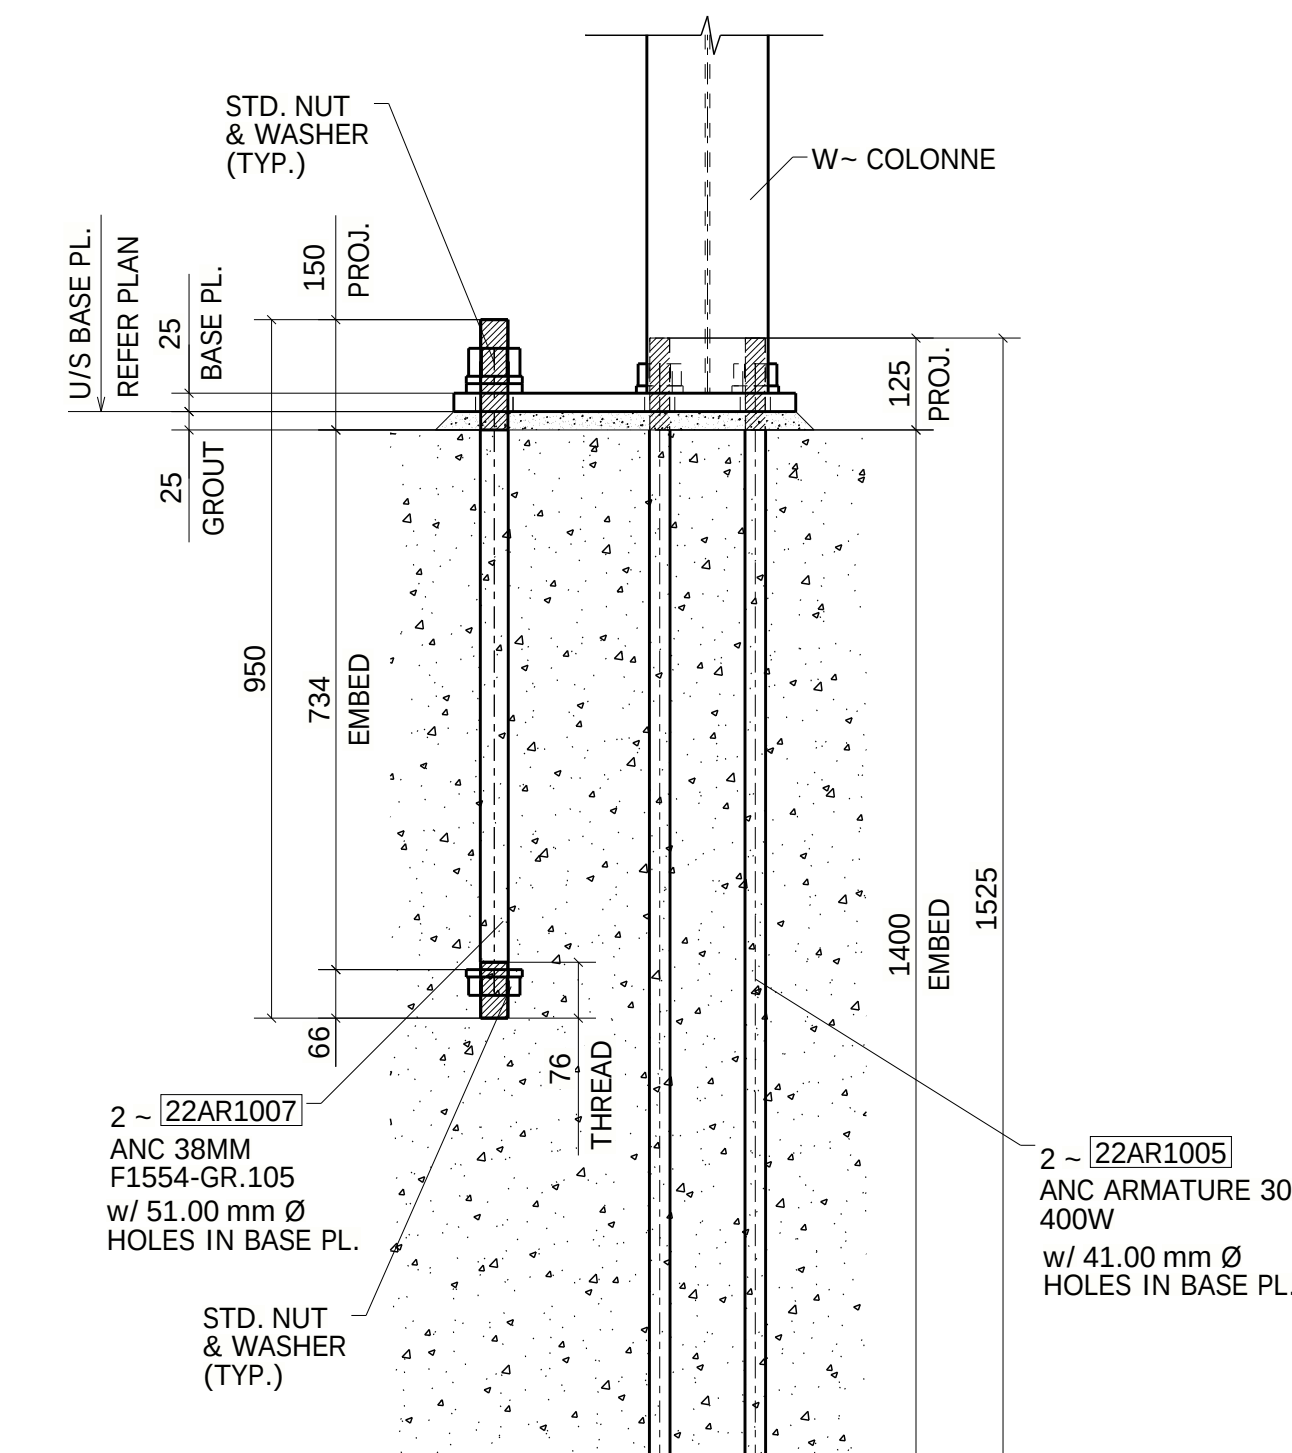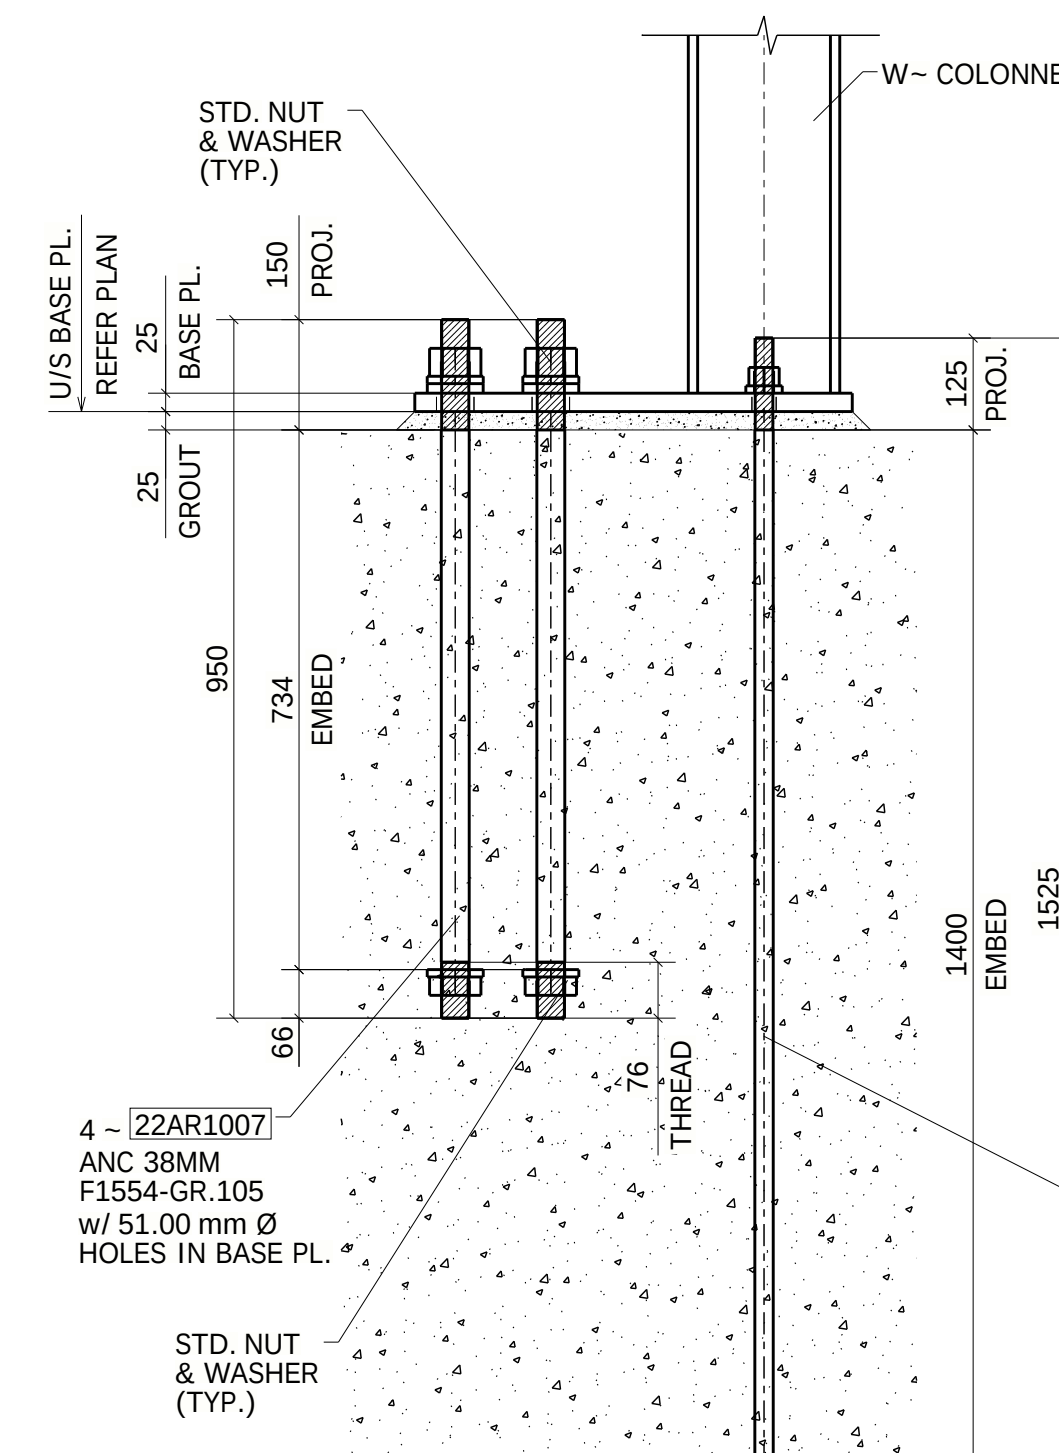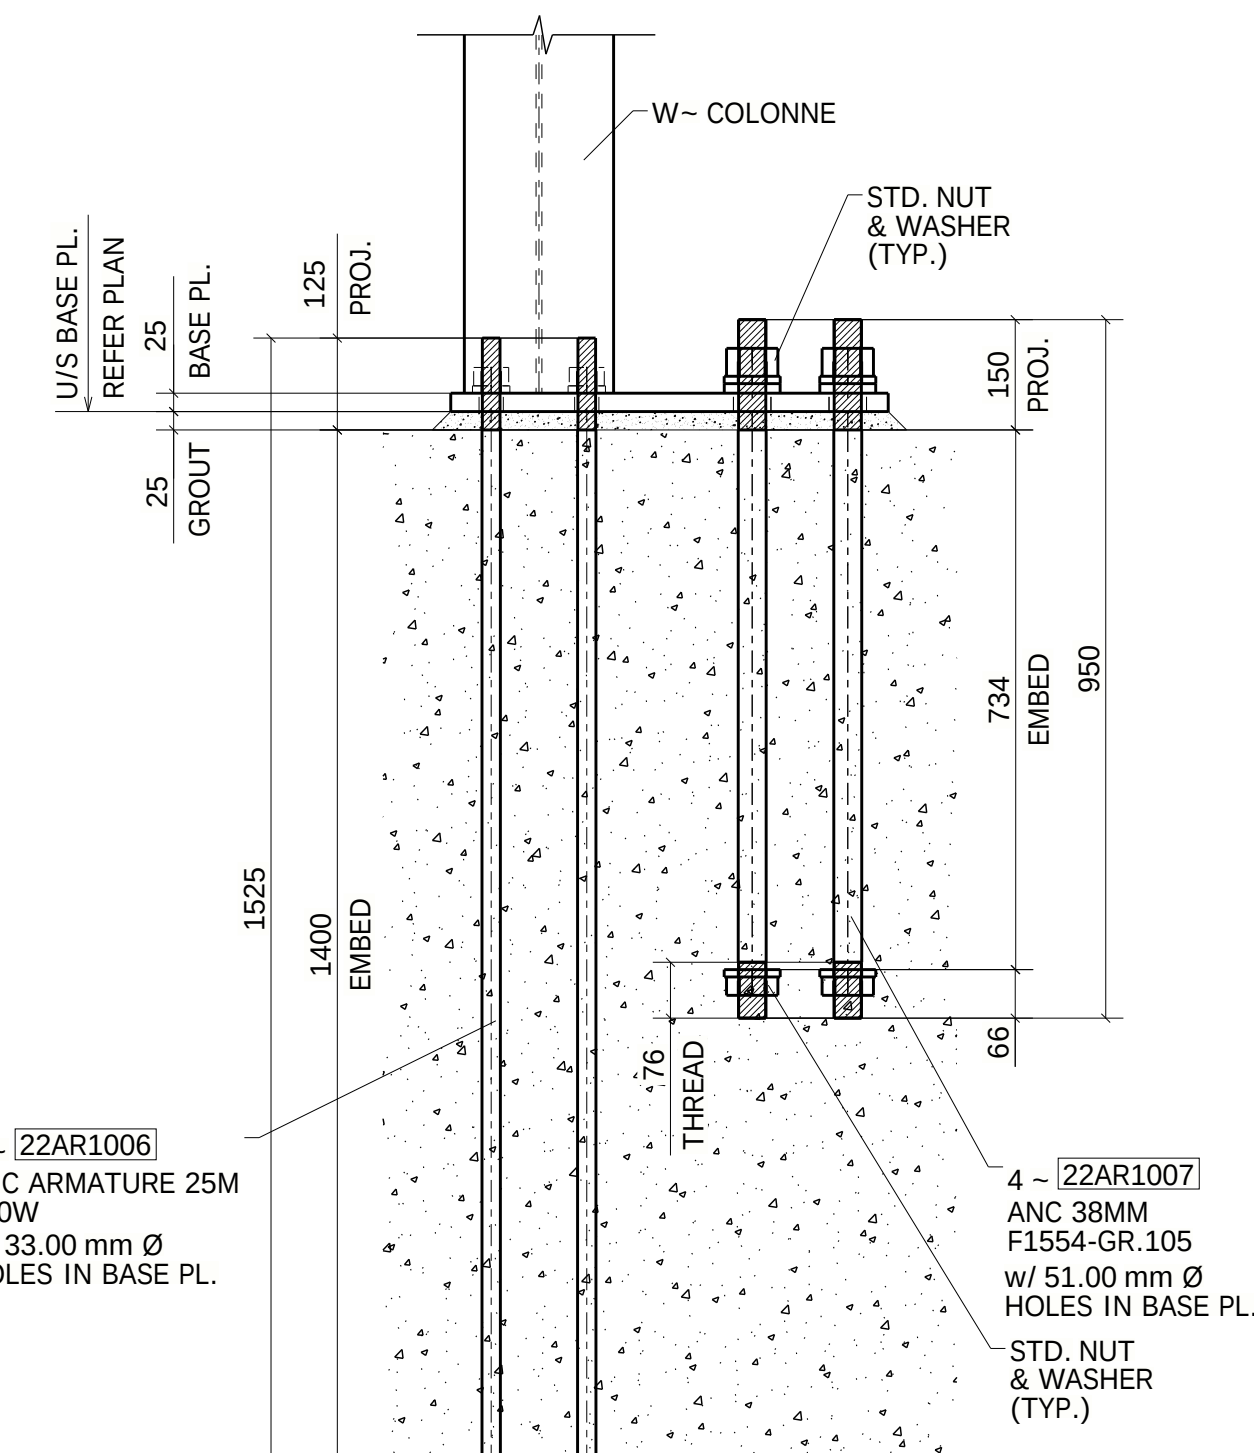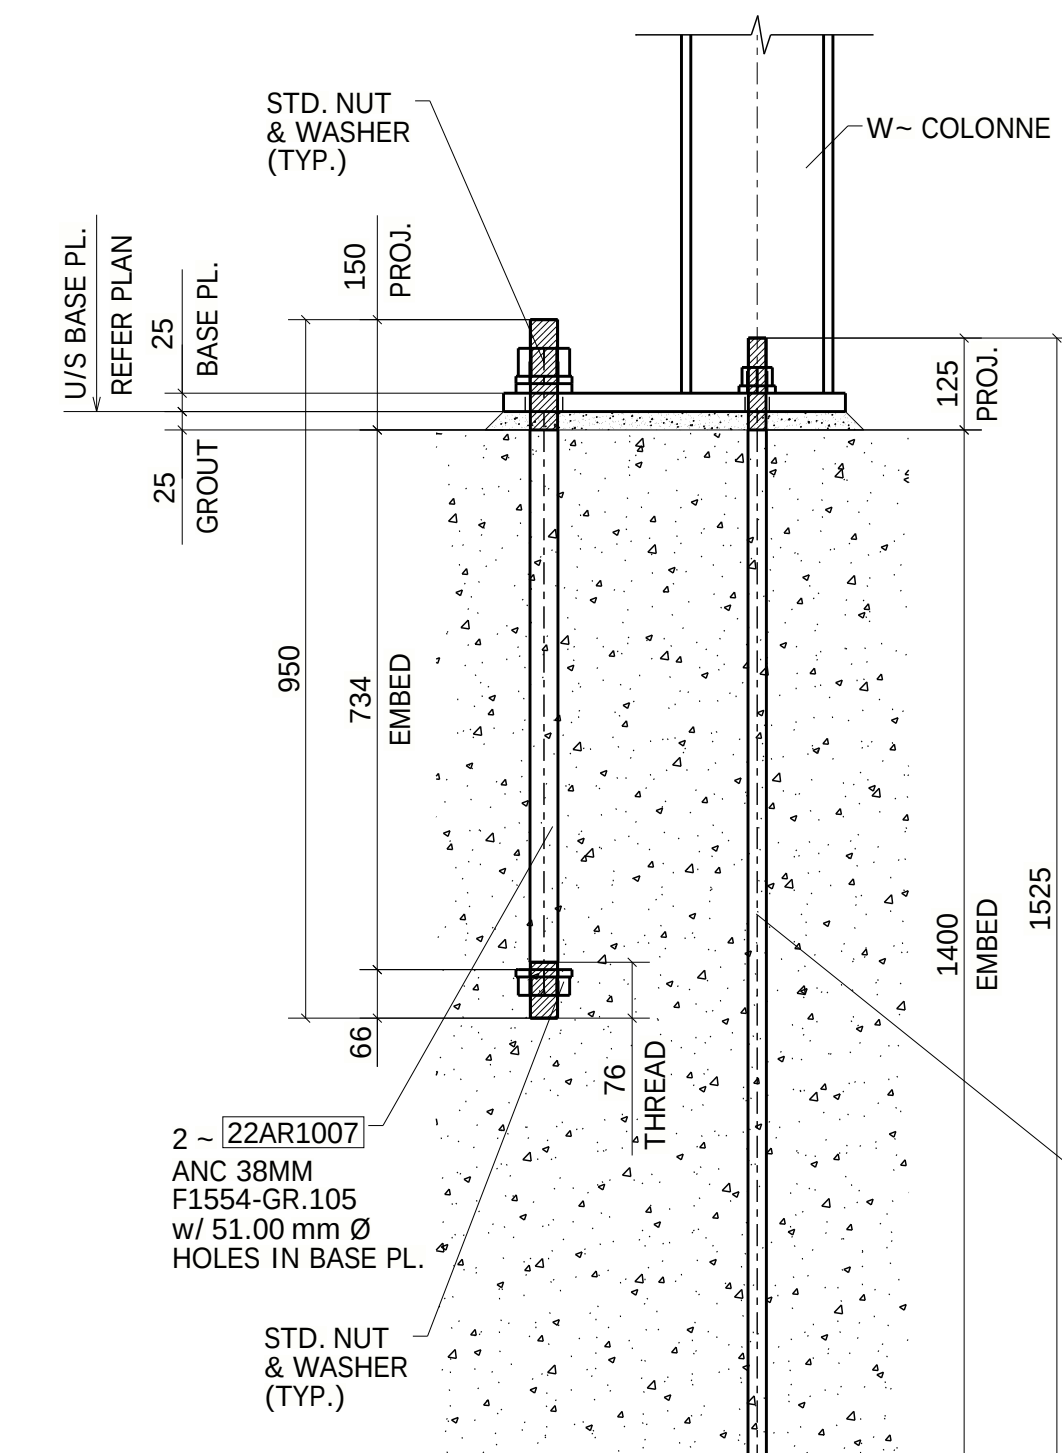


TYPE-07A
(03-LOCATION)
(REF : PB-1-A-2/S-170)

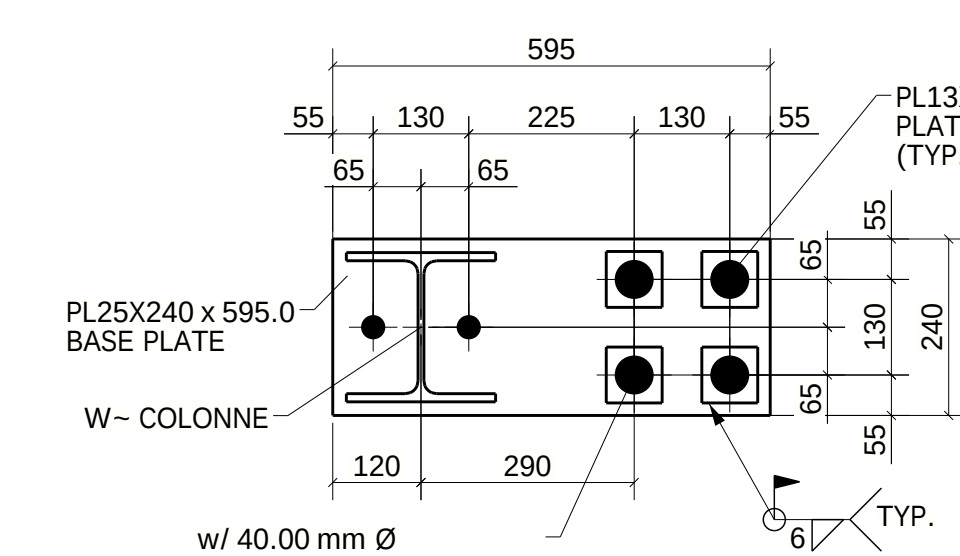


TYPE-08
(06-LOCATION)
(REF : PB-1-A-4/S-170)

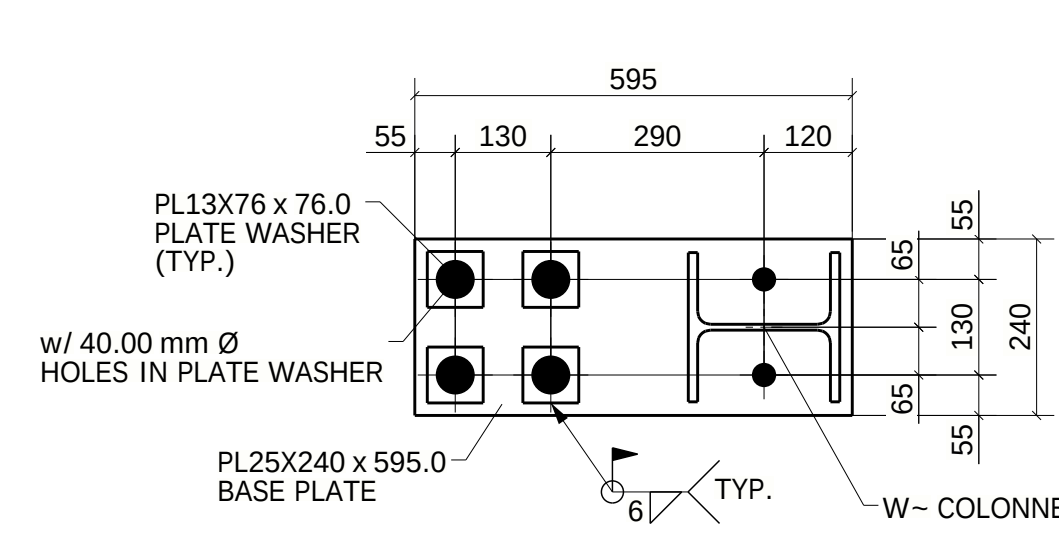


TYPE-08A
(08-LOCATION)
(REF : PB-1-A-4/S-170)

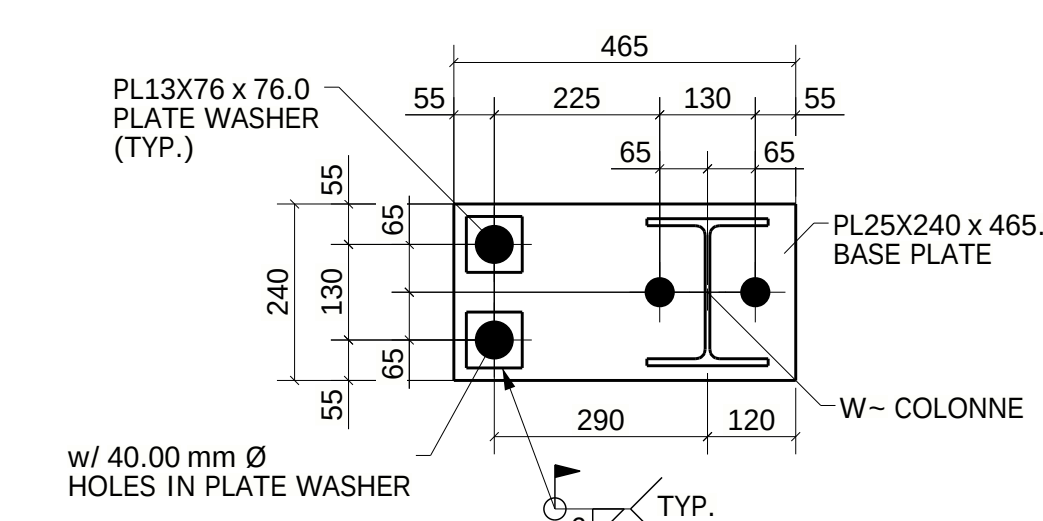

TYPE-09
(02-LOCATION)
(REF : PB-1-B-2/S-170)

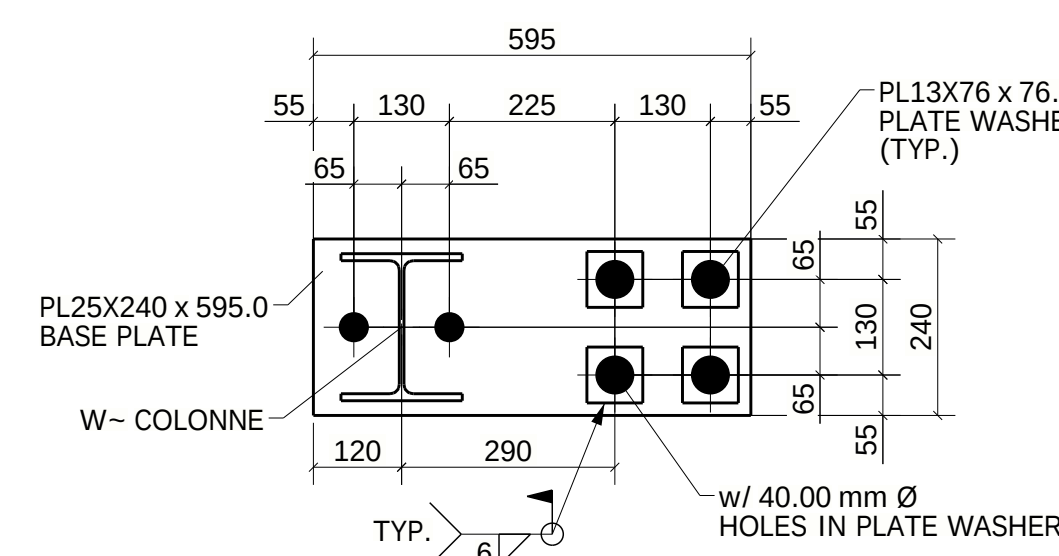

TYPE-10
(04-LOCATION)
(REF : PB-1-B-4/S-170)






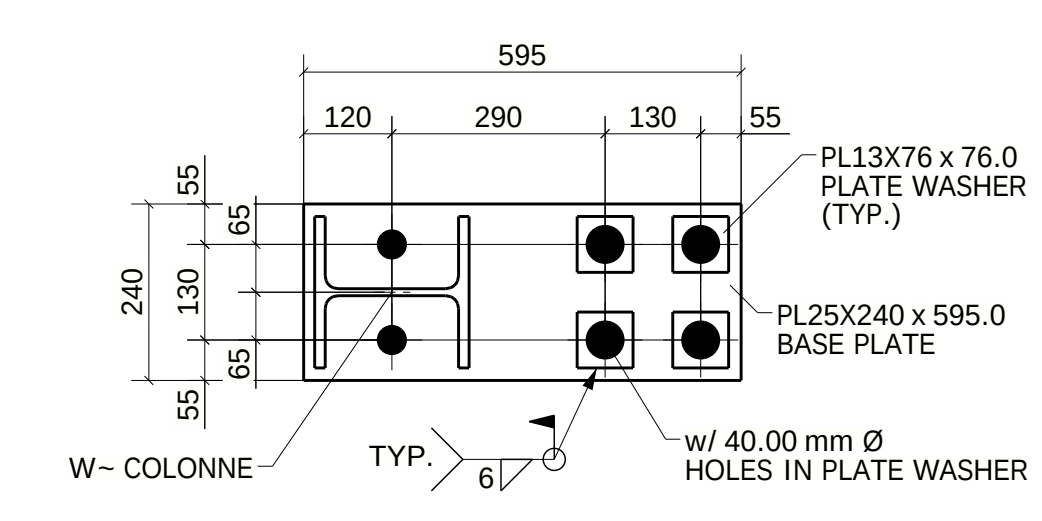


TYPE-10A
(02-LOCATION)
(REF : PB-1-B-4/S-170)

REFER AB101, AB102, AB103 & AB104
FOR COLUMN SIZES & ORIENTATION
AND BASE PLATE ORIENTATION

DATE	NO.	DESCRIPTION	PAR	TROUS 220	S.I.C.
02/08/2021		FOR FIELD USE		BOULONS A325N	S.I.C.
01/27/2021		FOR RE-APPROVAL		PEINTURE	S.I.C.
01/26/2021		FOR APPROVAL			S.I.C.

	GRADE ACIER 350W	S.I.C.
	ELECTRODES E49XX	S.I.C.
	SOUDURE 6mm	S.I.C.
R	TROUS 22Ø	S.I.C.
	BOULONS A325N	S.I.C.
	PEINTURE	S.I.C.

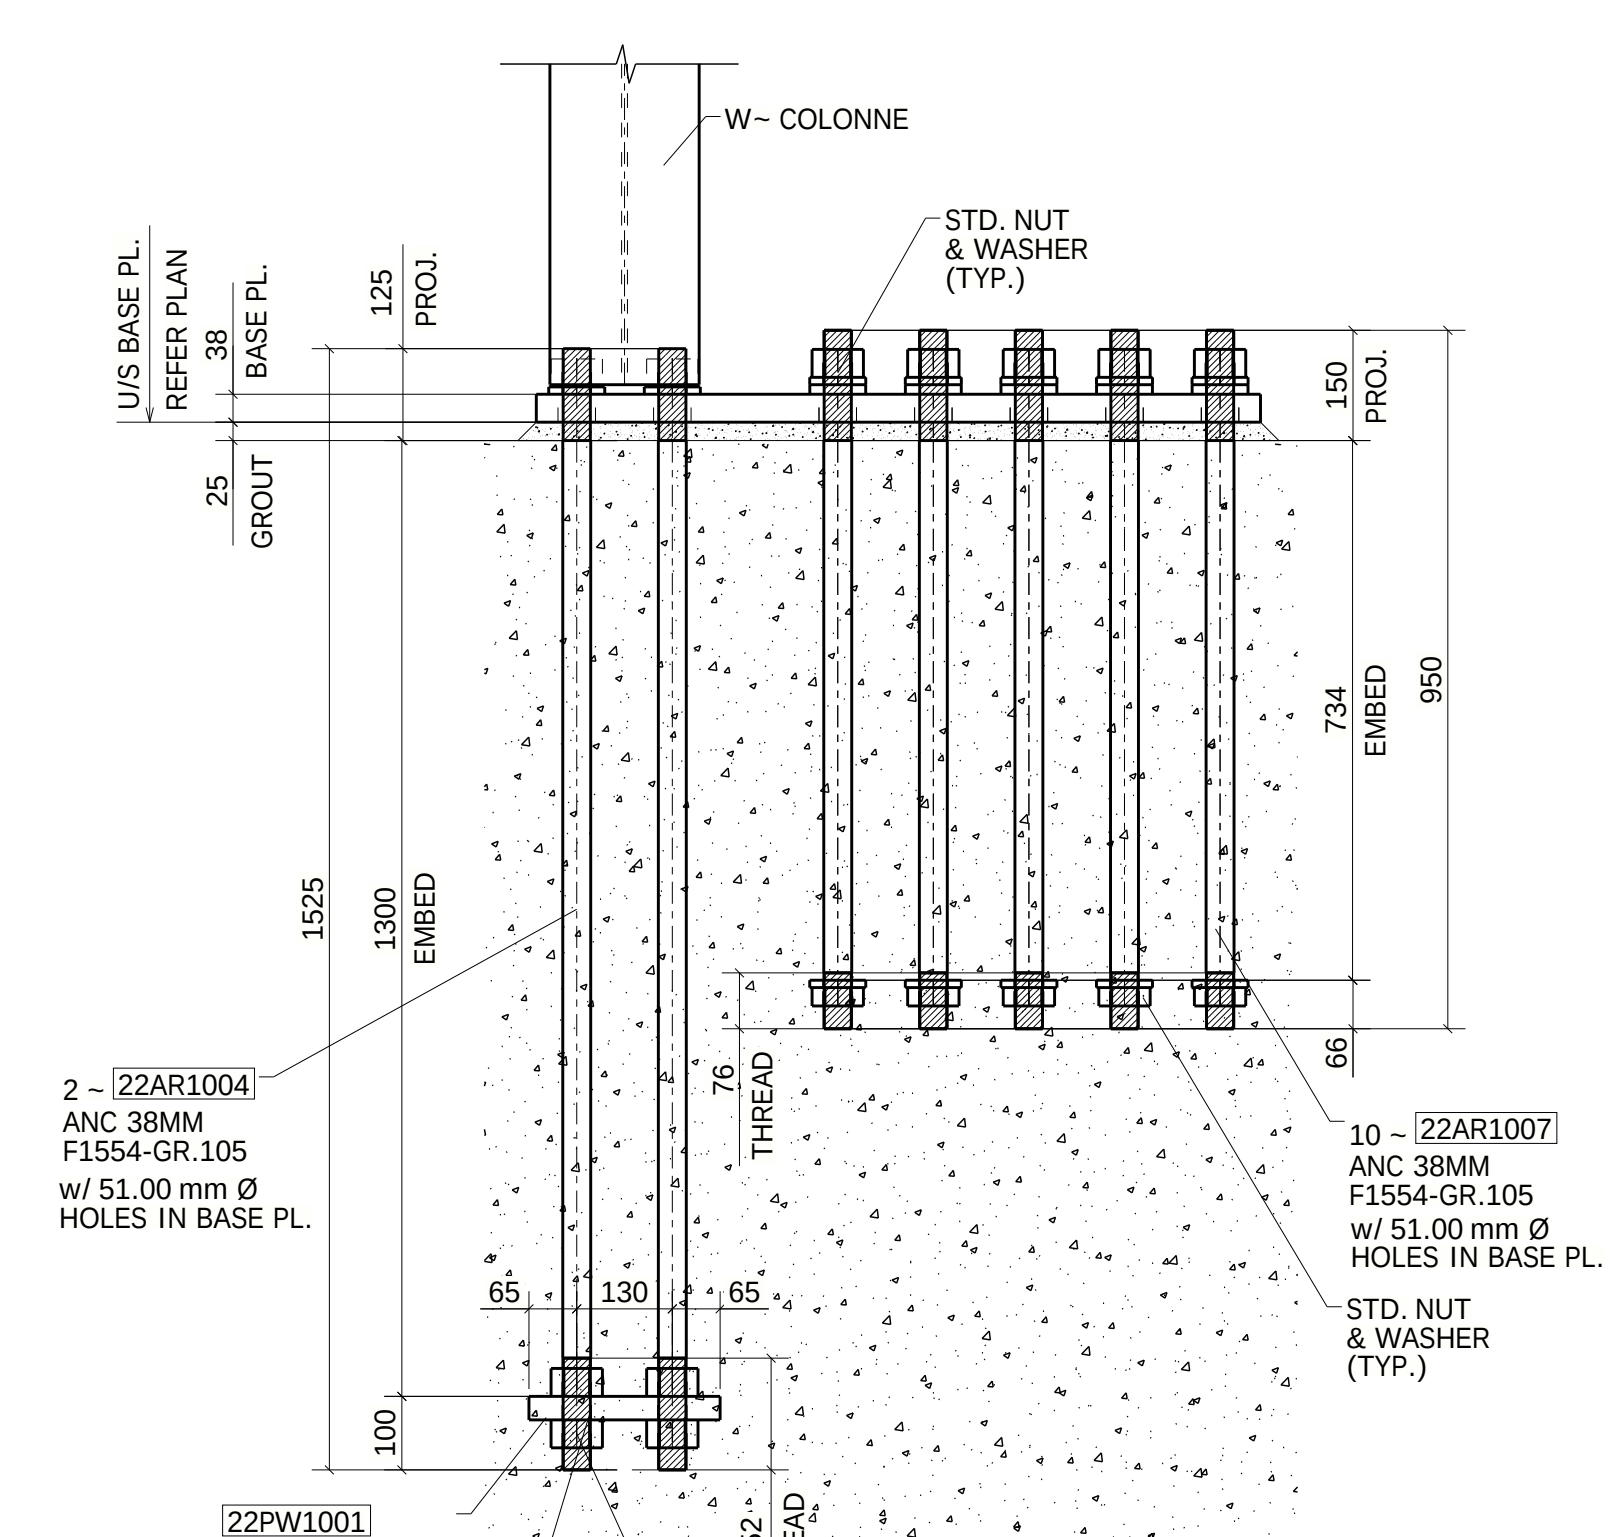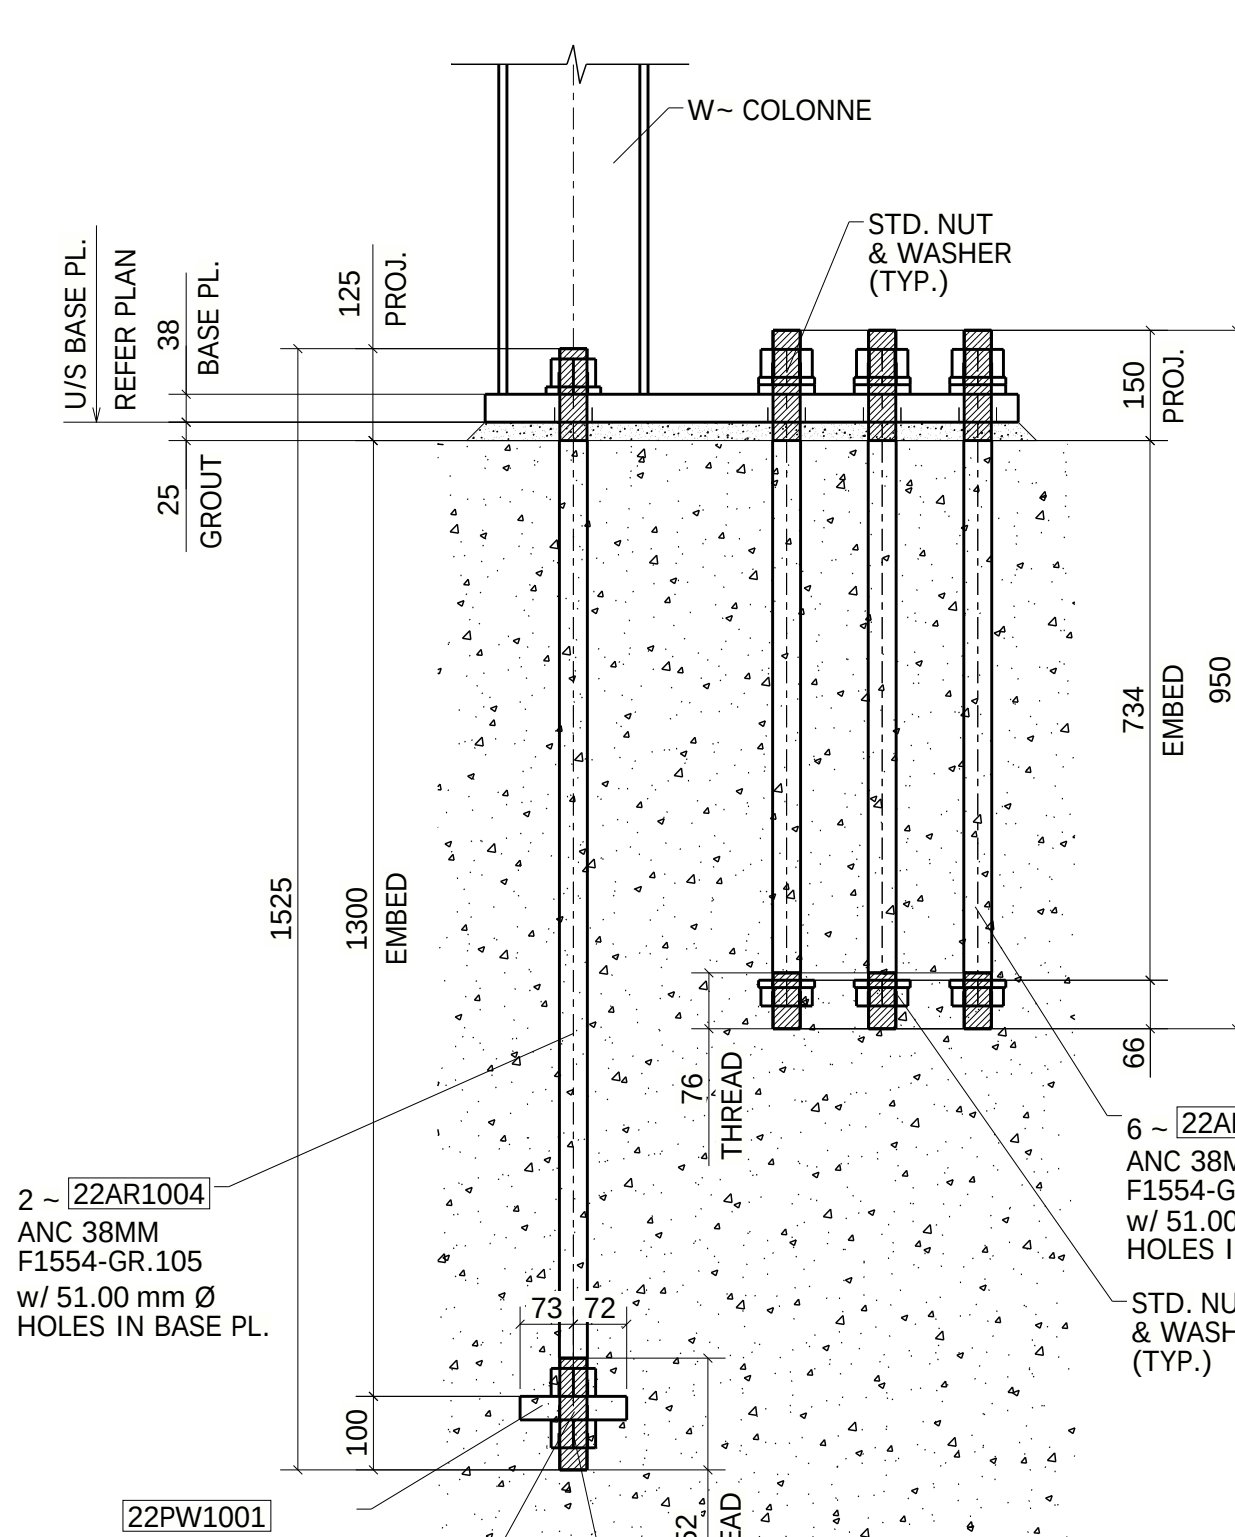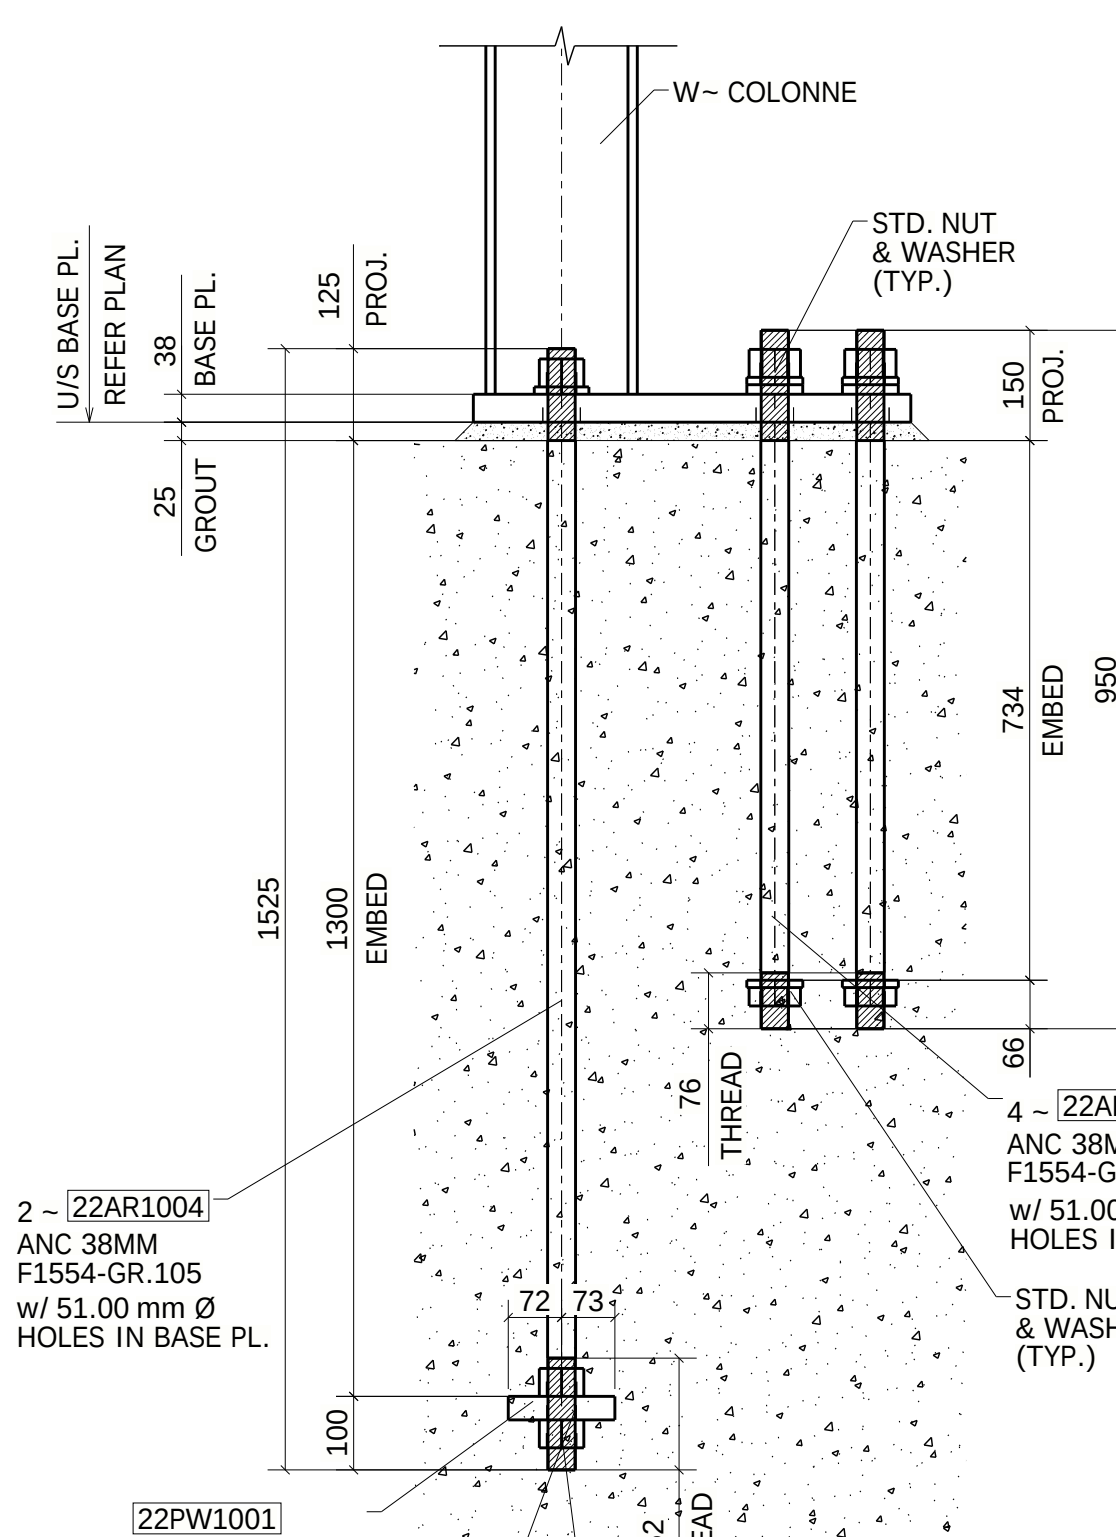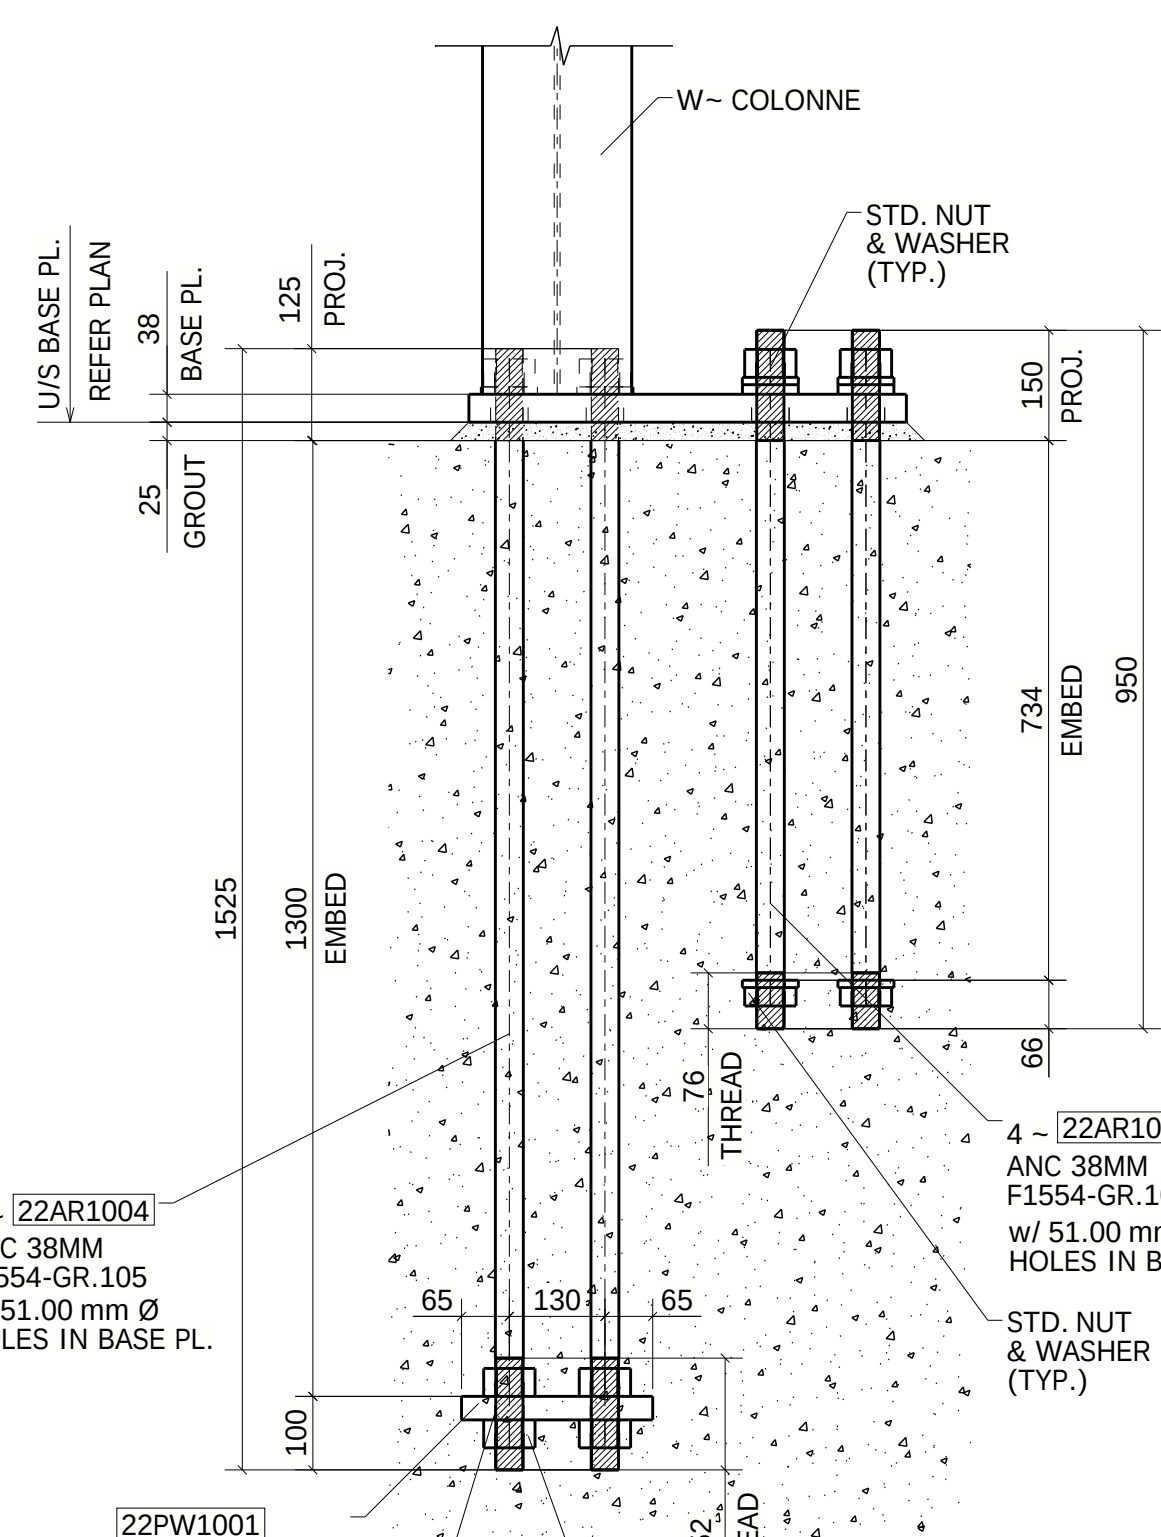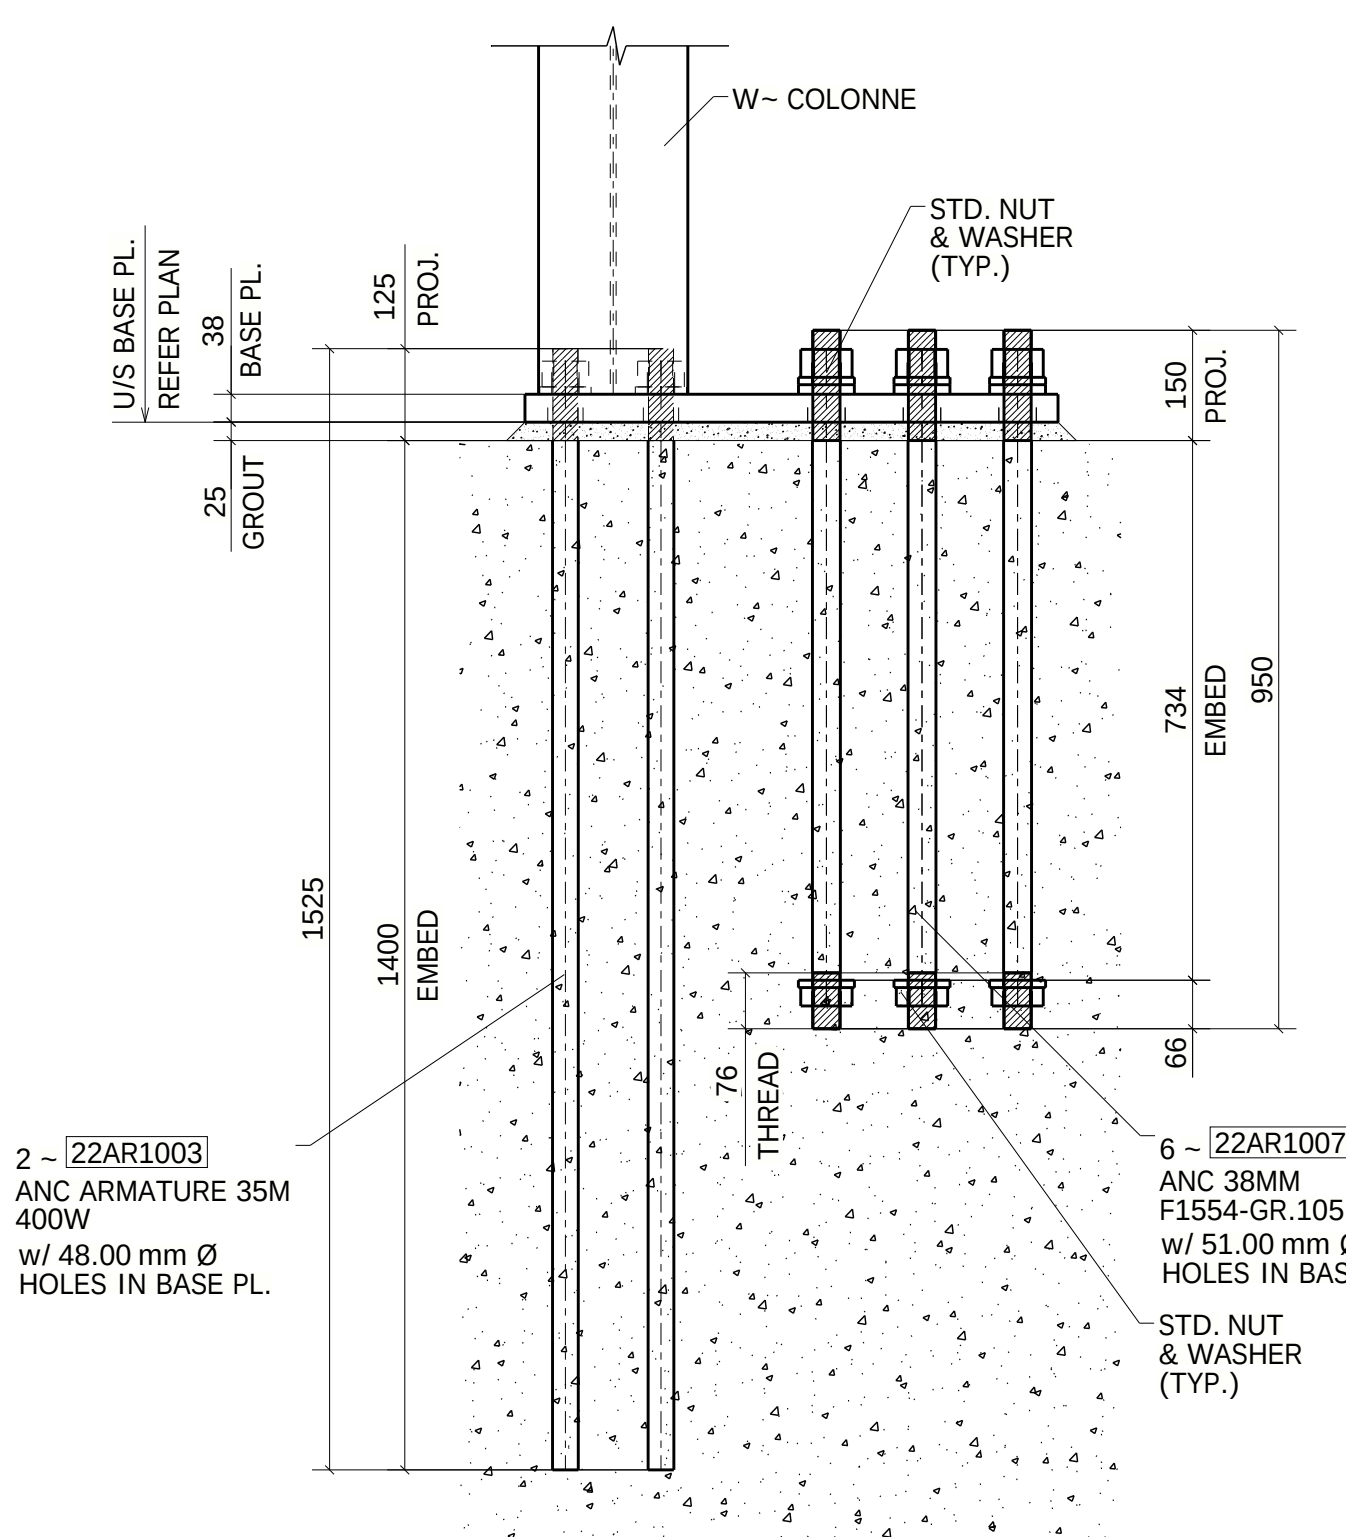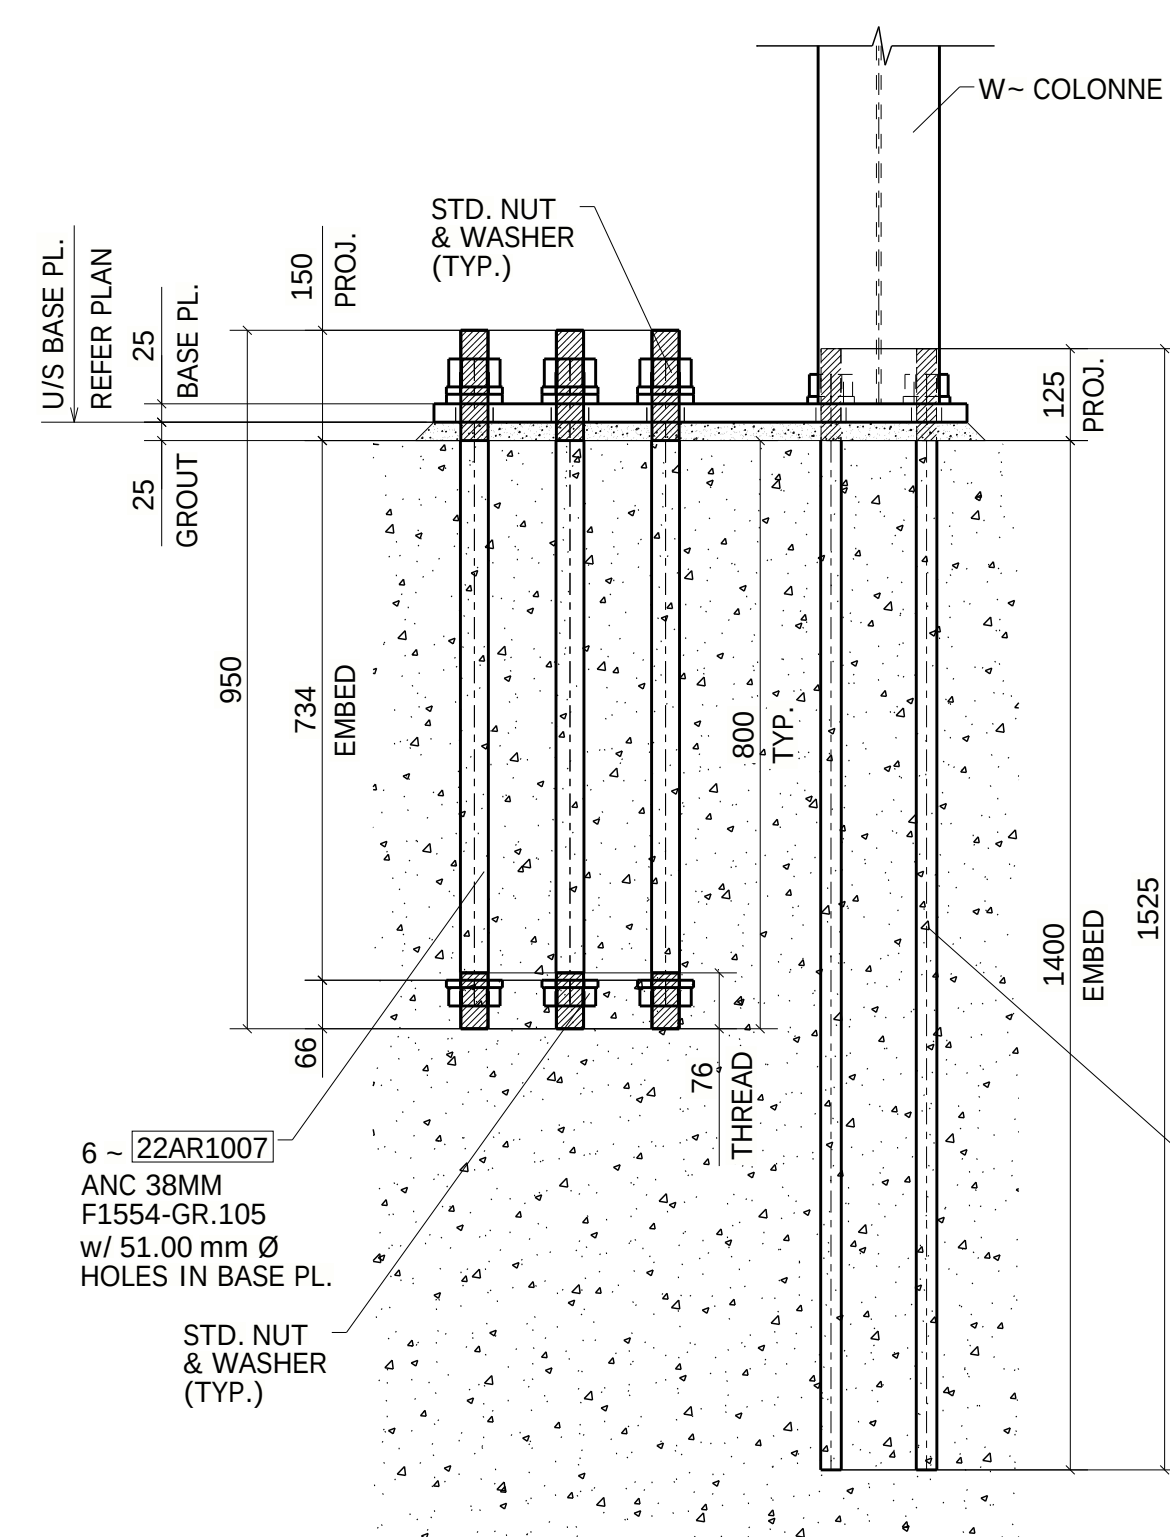

725

130 130 225 130 55

65 65

W~ COLONNE


PL25X240 x 725.0
BASE PLATE

290 120


WASHER

6 TYP.


TYPE-11
(03-LOCATIONS)
(REF : PB-1-B-6/S-170)

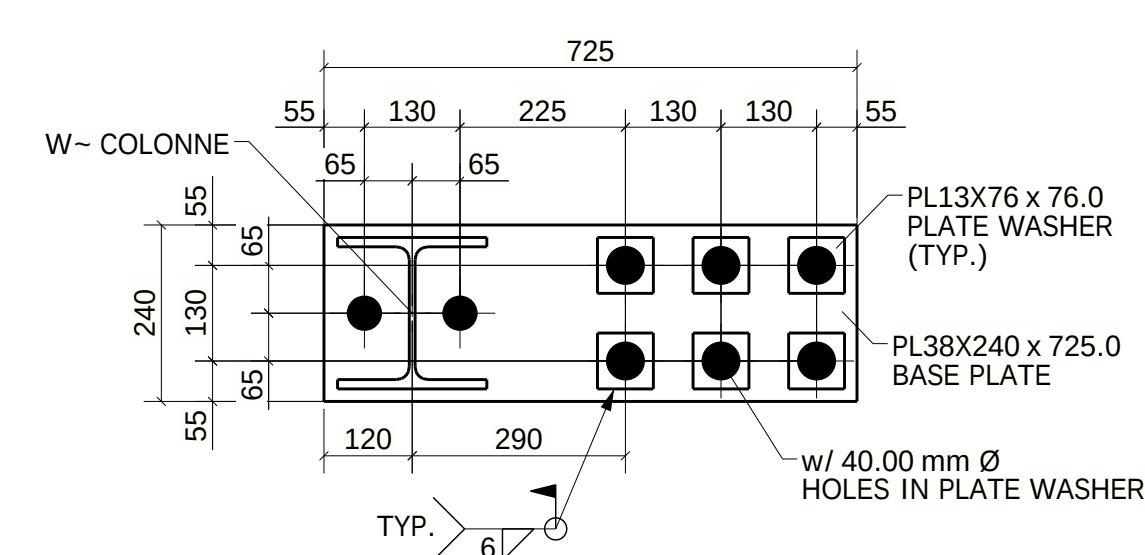


TYPE-12
(02-LOCATIONS)
(REF : PB-1-C-6/S-170)

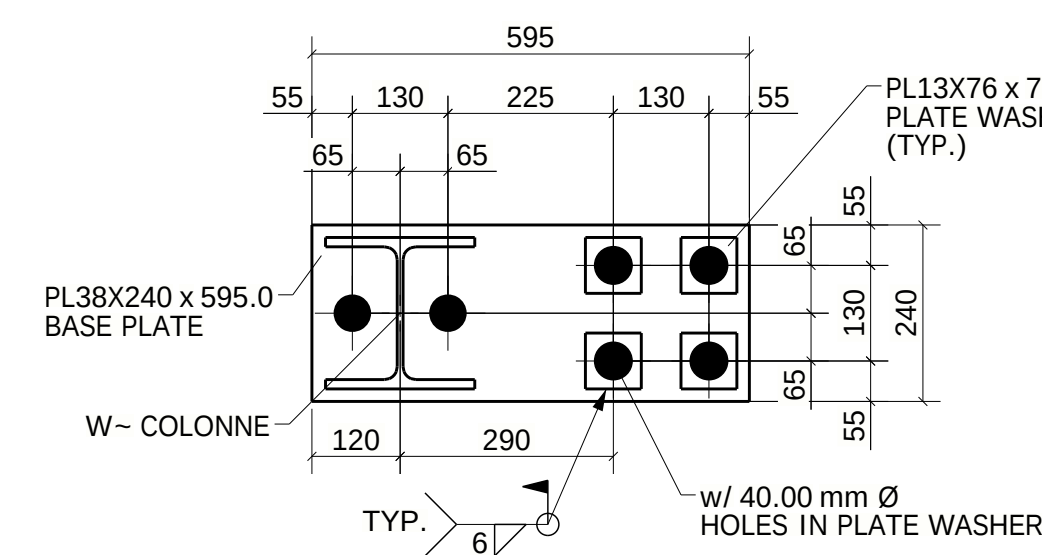


TYPE-13
(01-LOCATION)
(REF : PB-1-D-4/S-170)

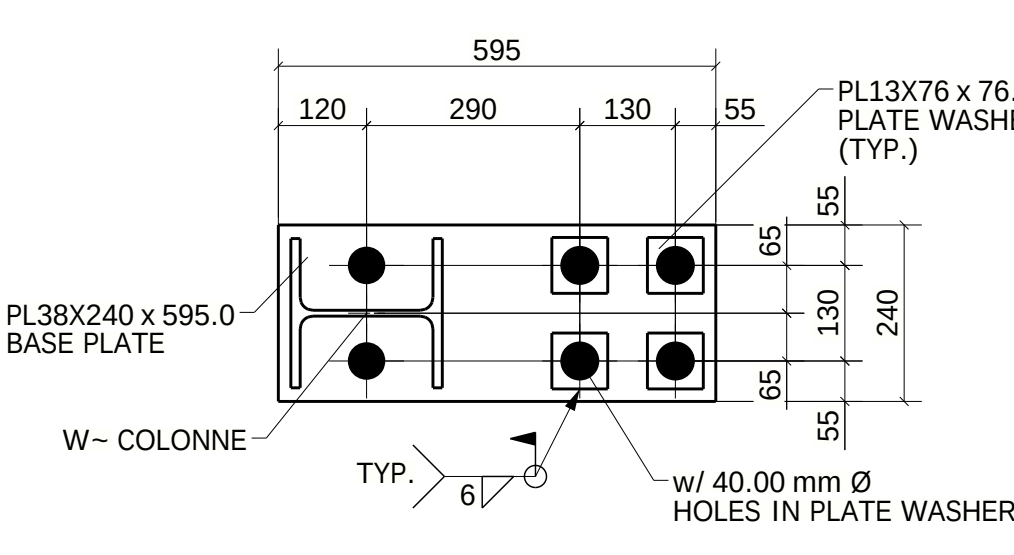







TYPE-13A
(05-LOCATIONS)
(REF : PB-1-D-4/S-170)

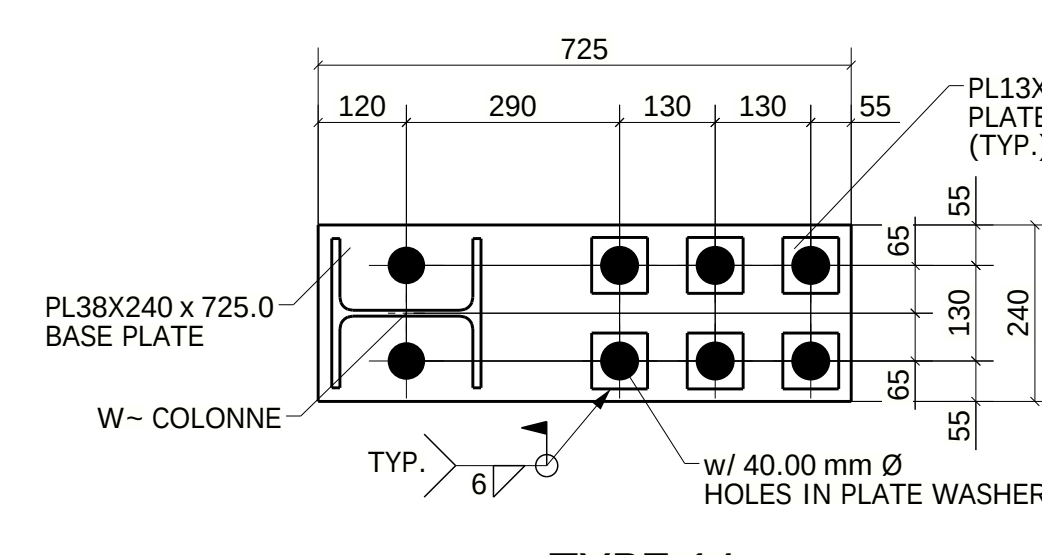

TYPE-14
(06-LOCATIONS)
(REF : PB-1-D-6/S-170)

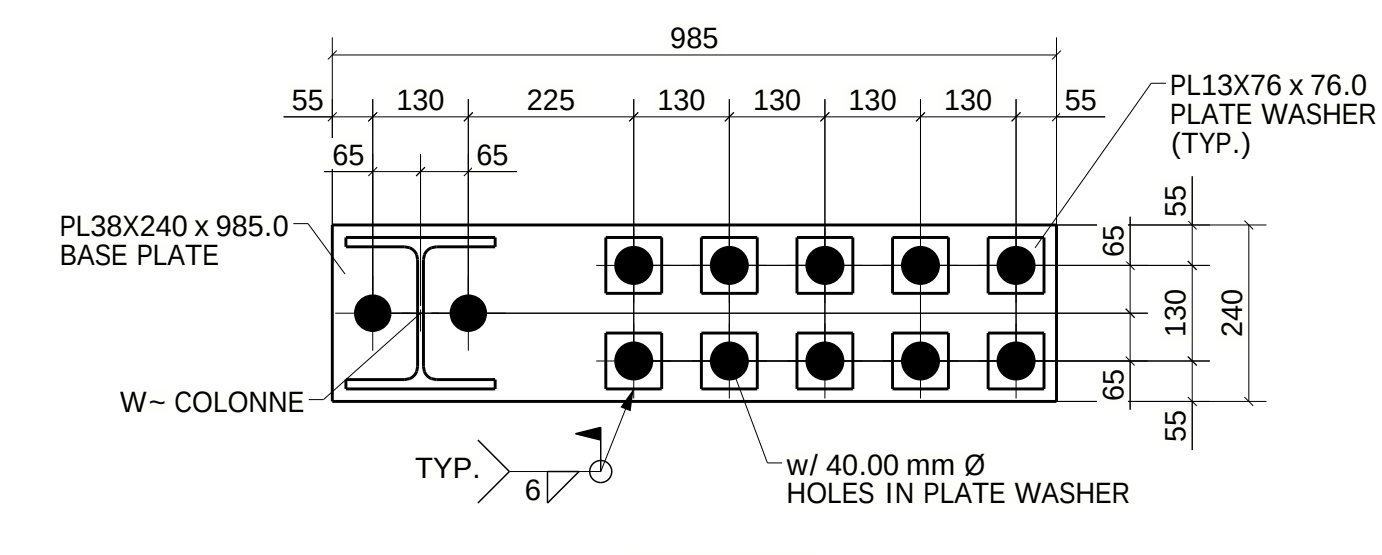

TYPE-15
(01-LOCATION)
(REF : PB-1-D-10/S-170)

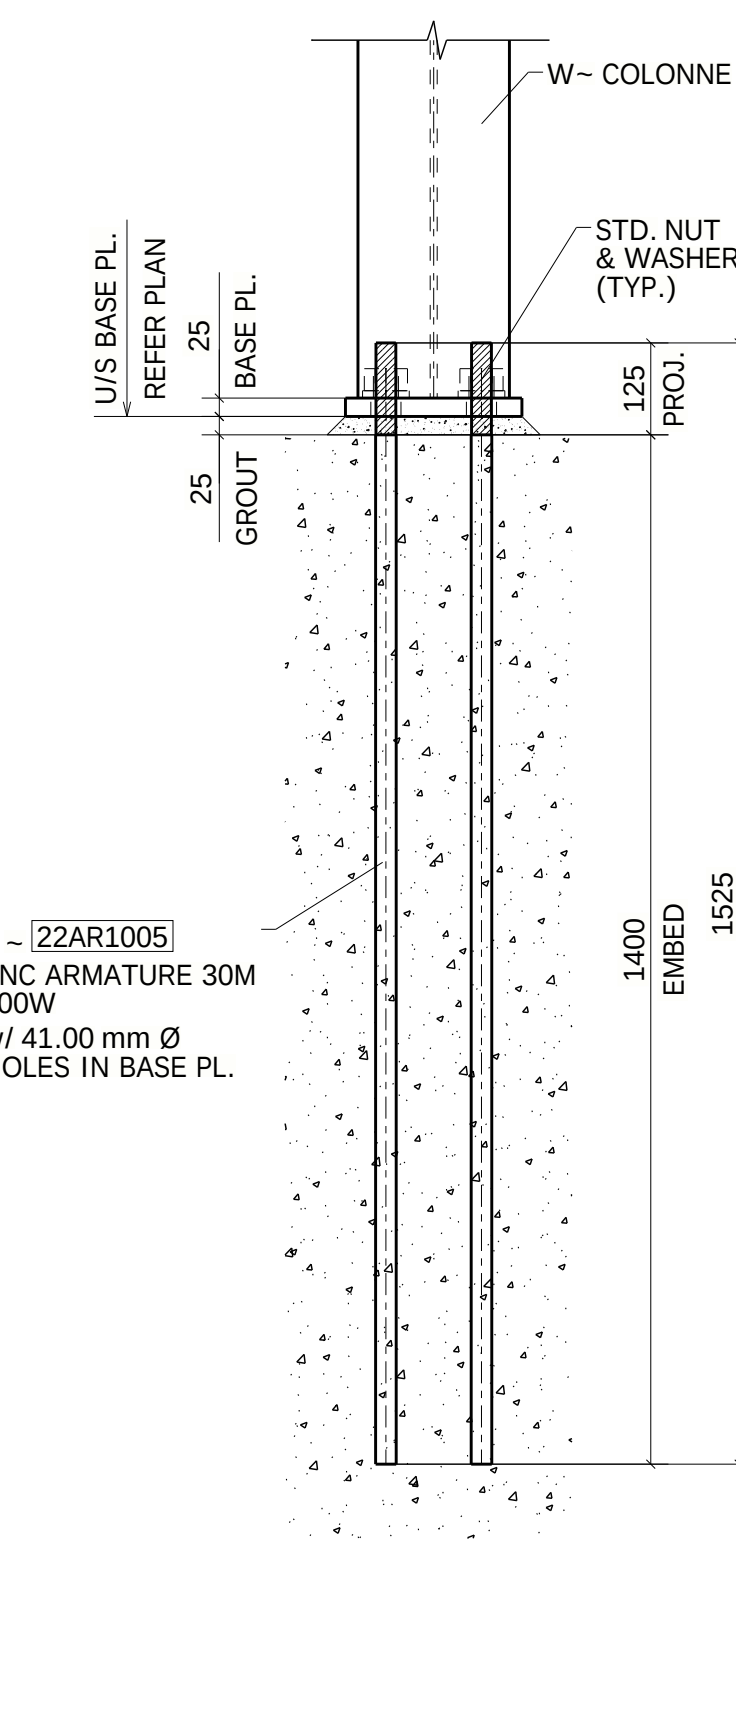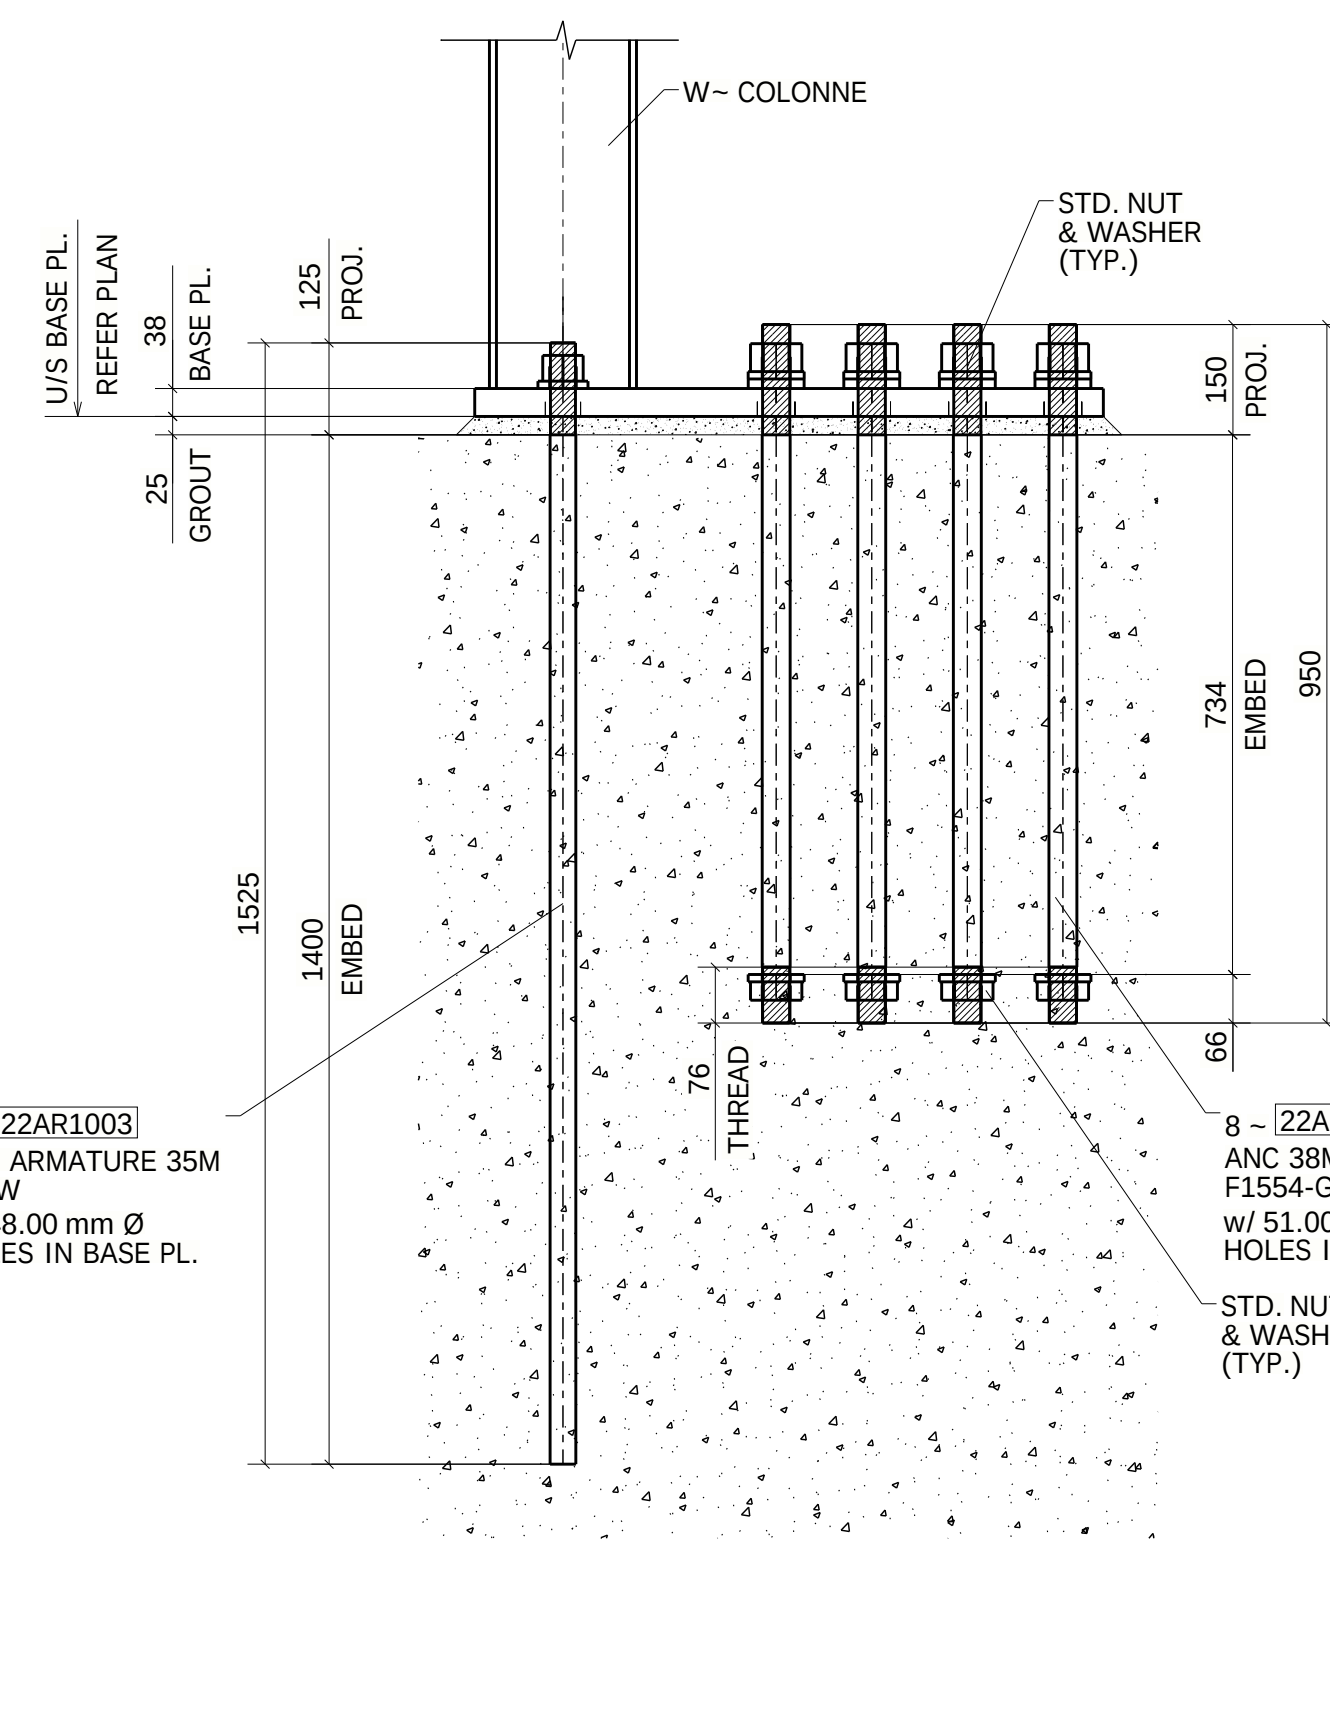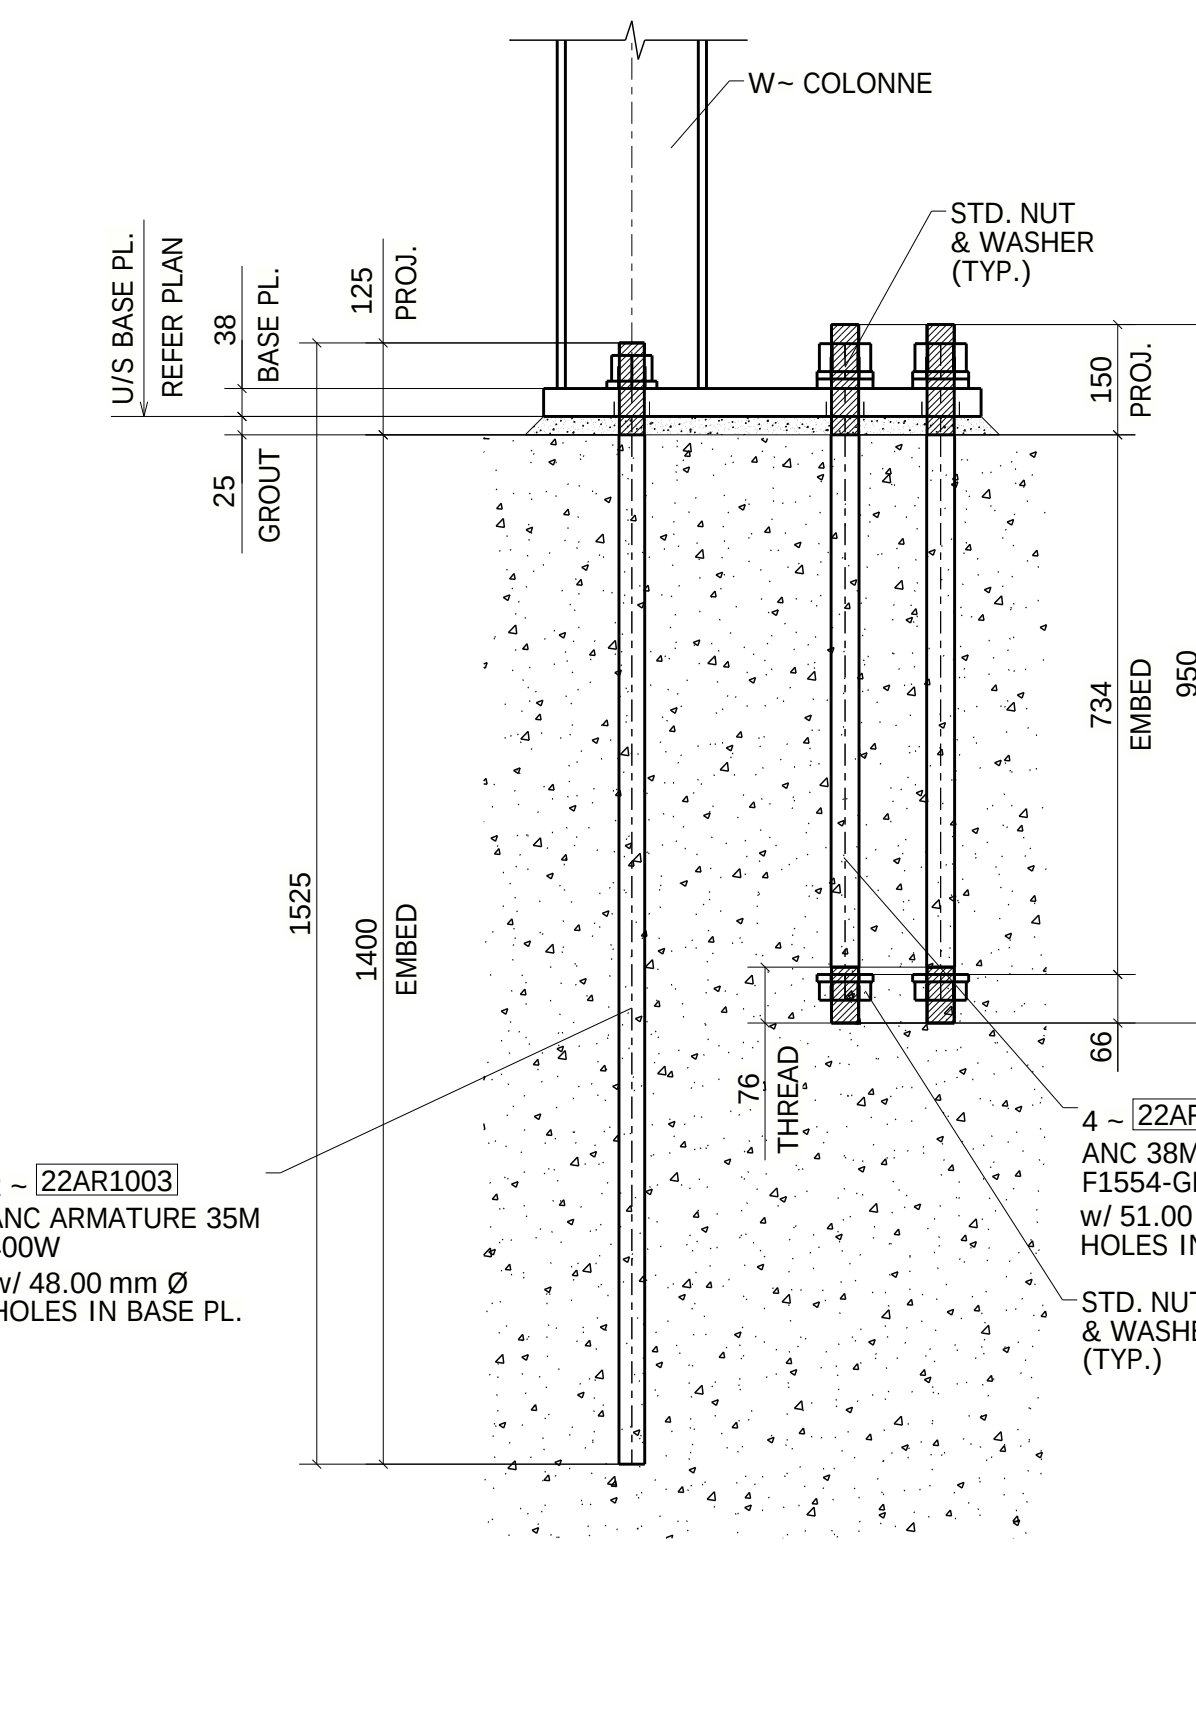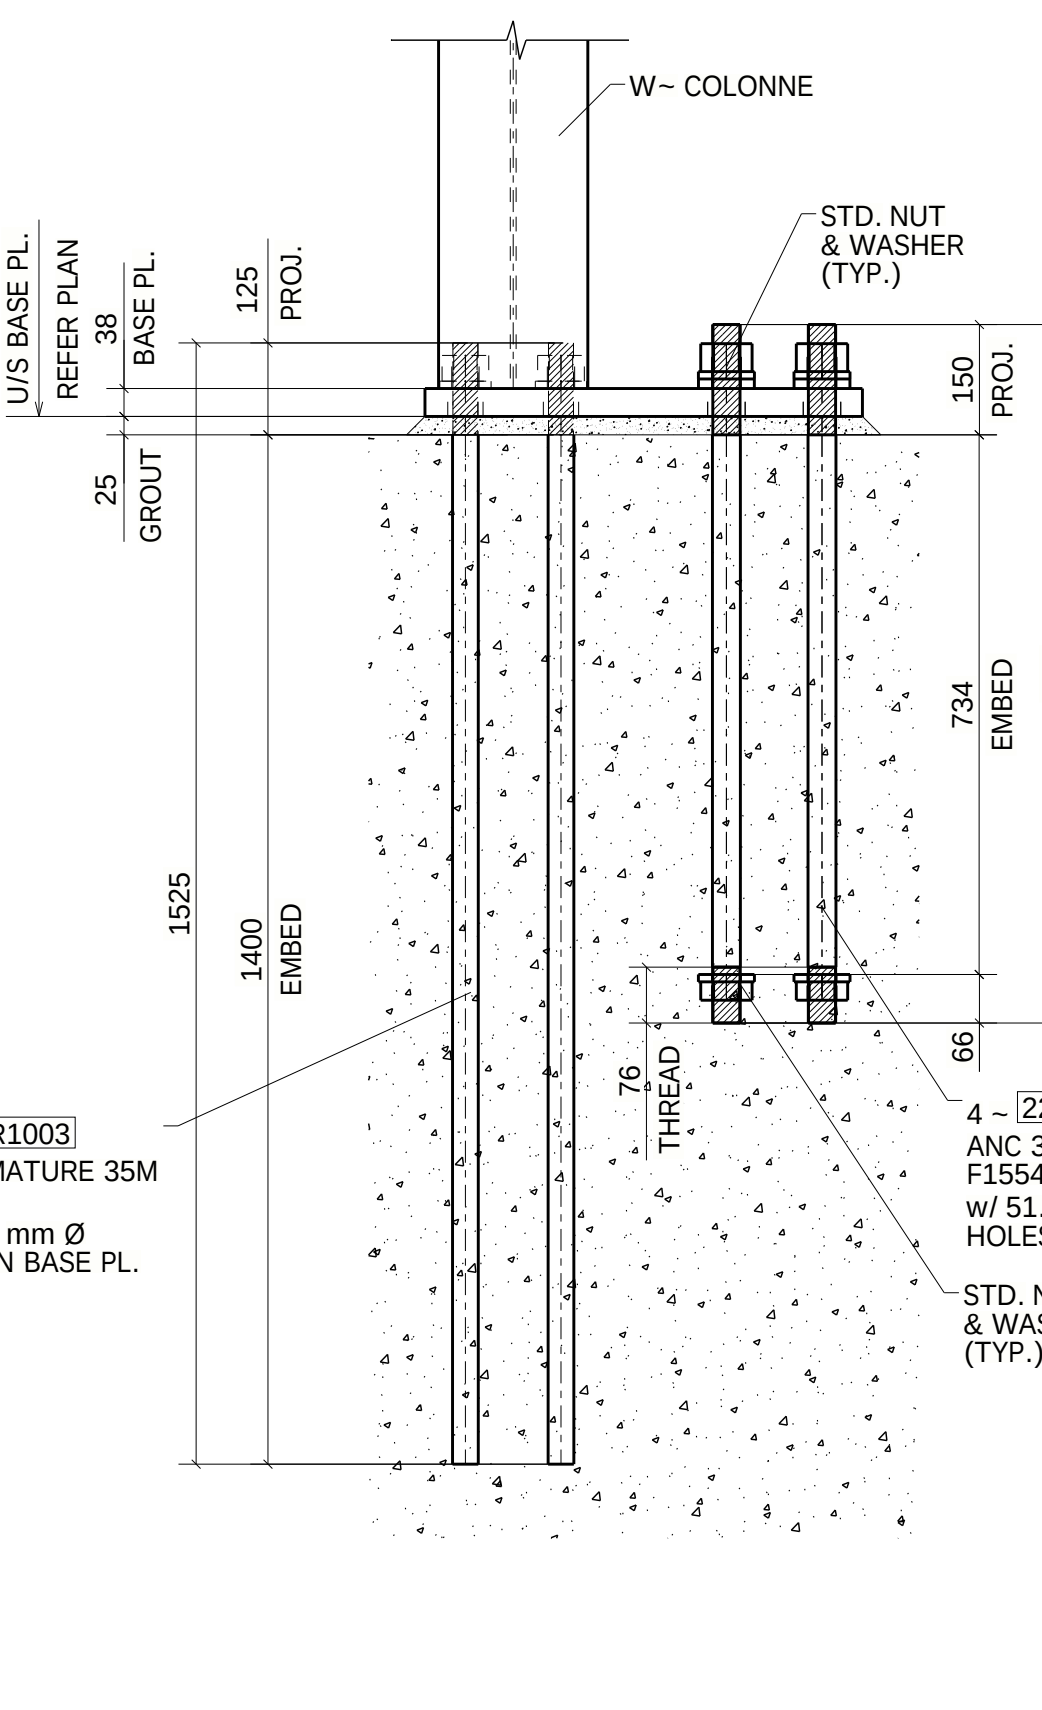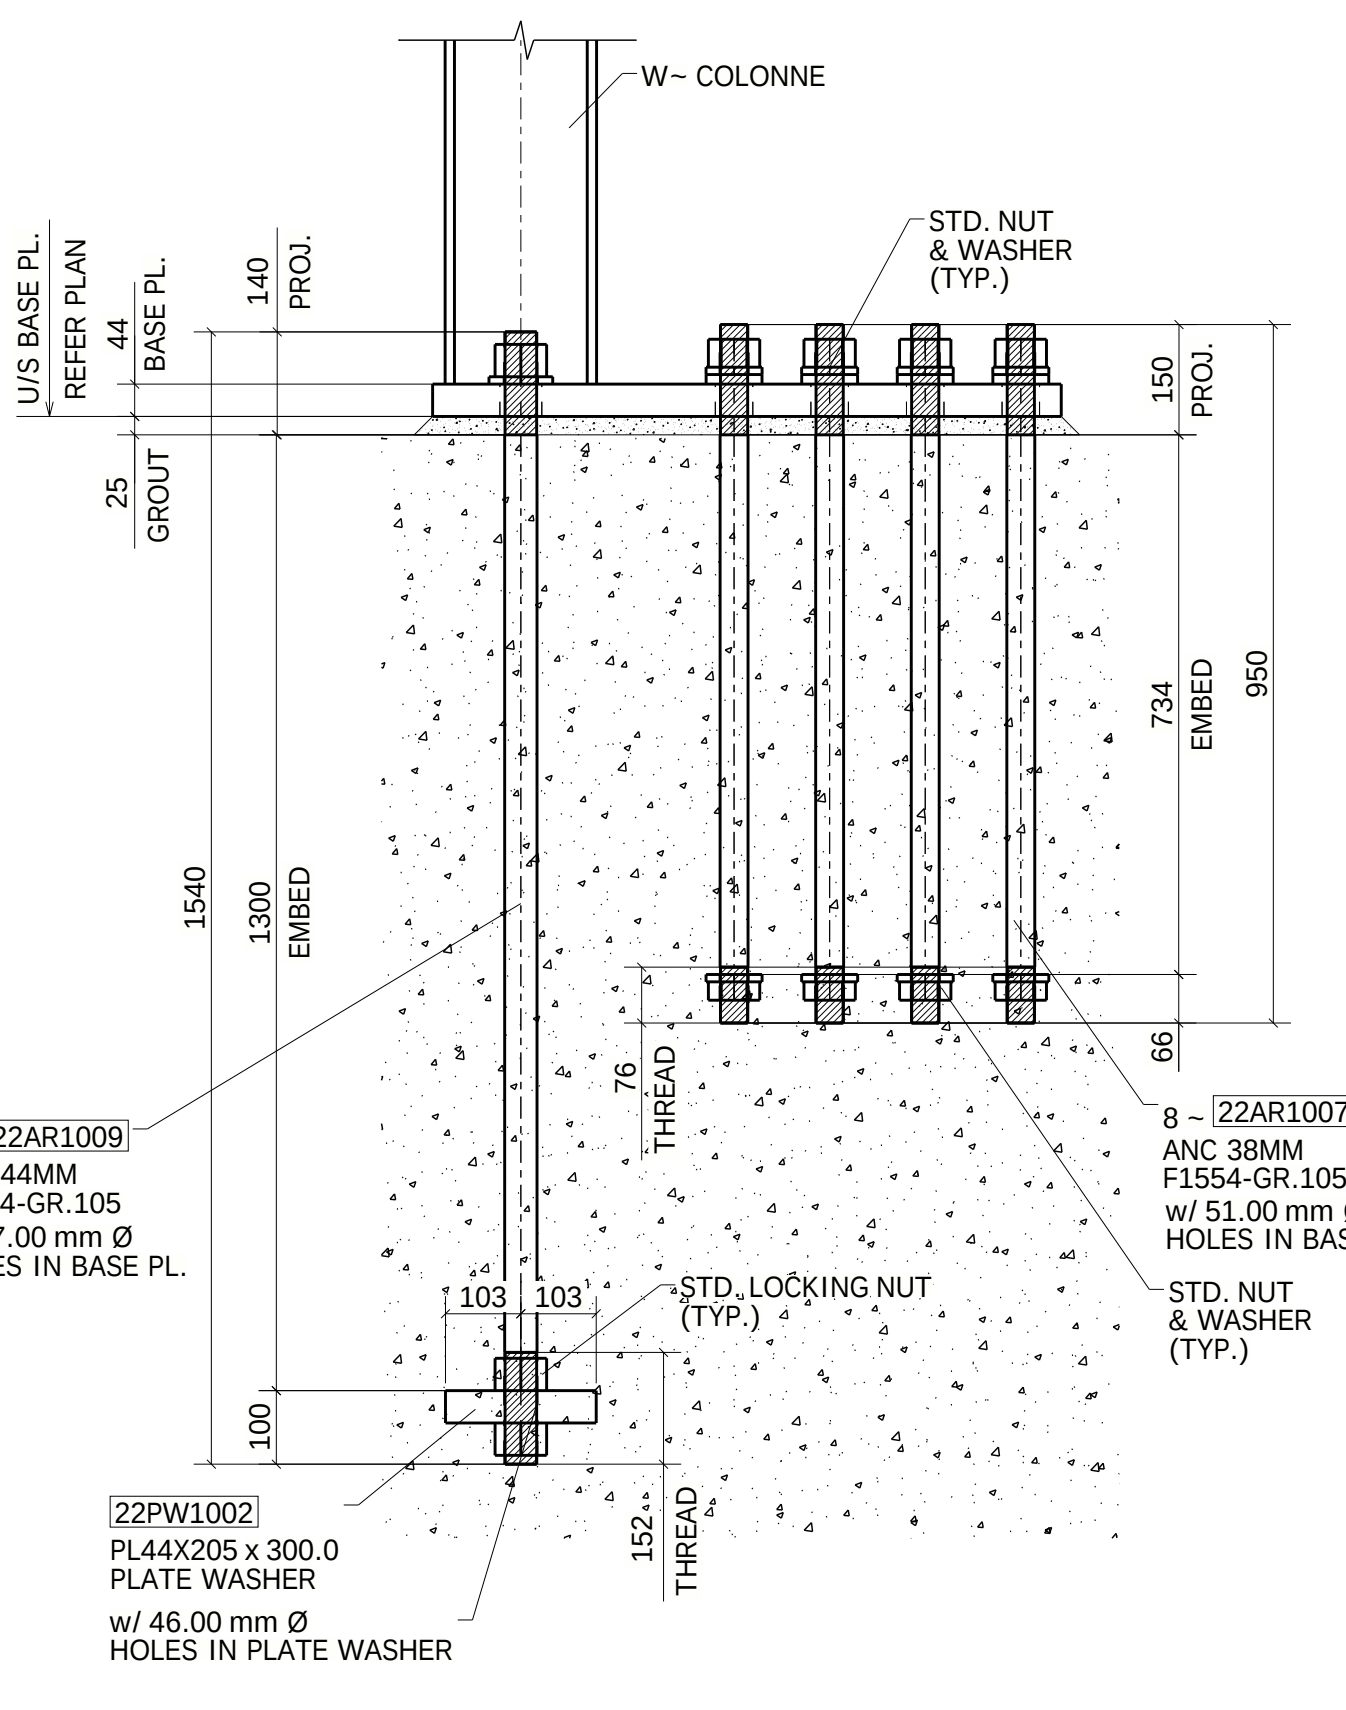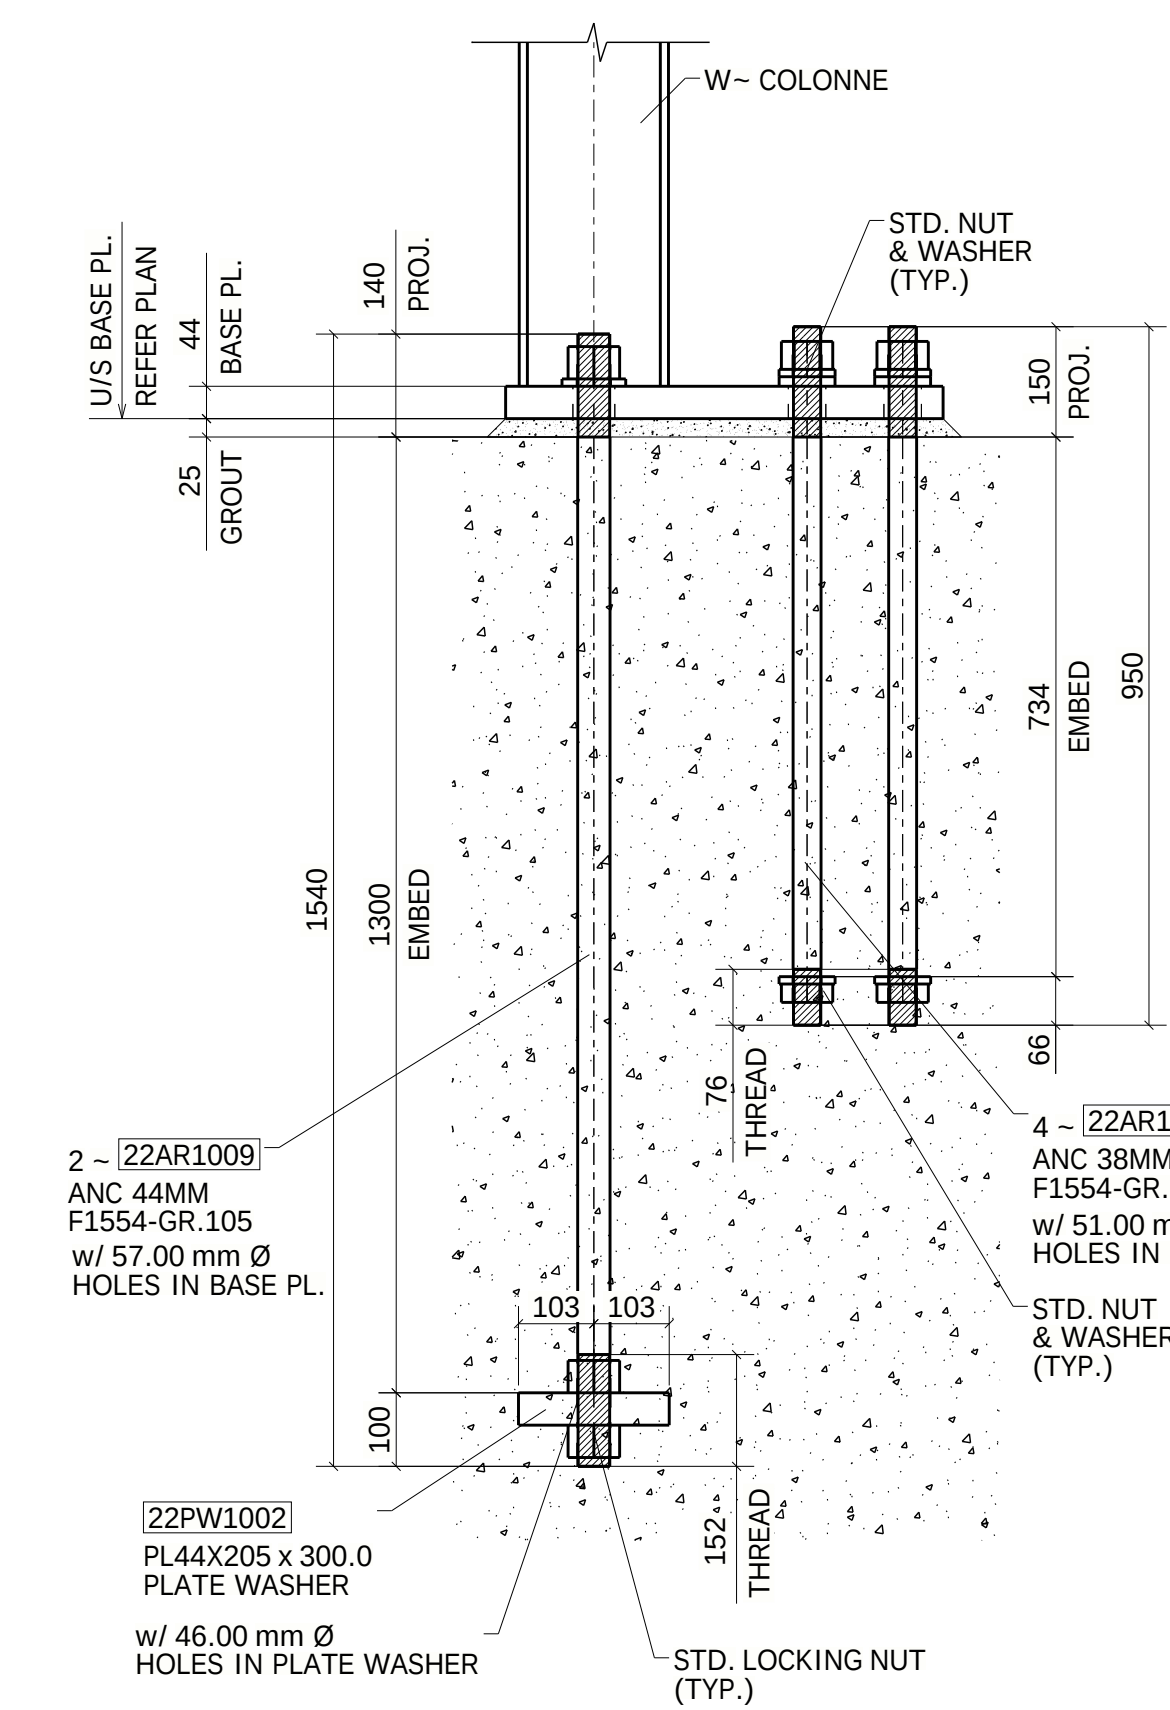

595

120 290 130 55

65 65 130 55

240

PL44X240 x 595.0
BASE PLATE


W-COLONNE

TYP


PL13X76 x
PLATE WASHER
(TYP.)

w/ 40.00 mm Ø
HOLES IN PLATE WASHER


TYPE-16
(01-LOCATION)
(REF : PB-1-E-4/S-170)

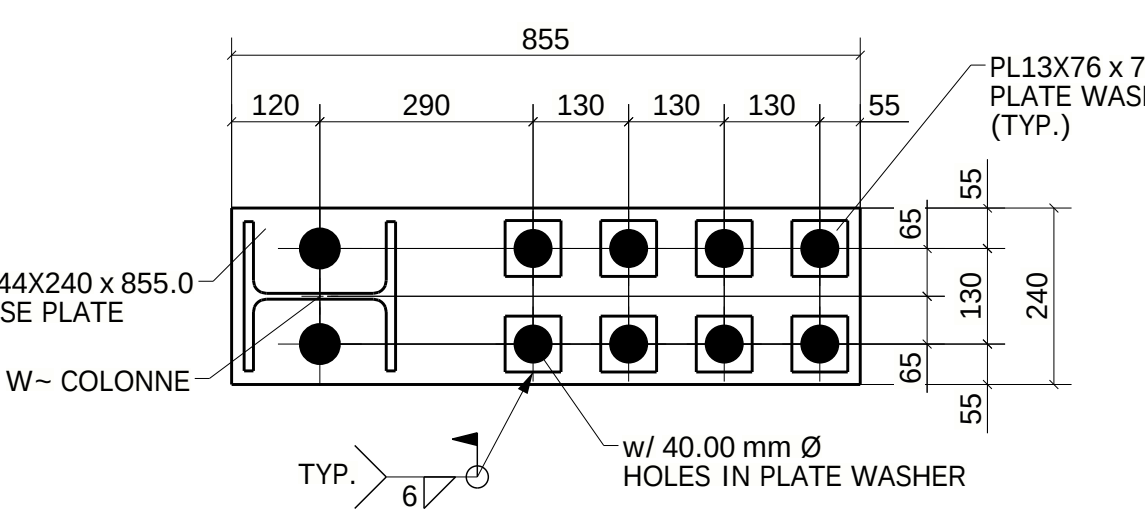


TYPE-17
(04-LOCATIONS)
(REF : PB-1-E-8/S-170)

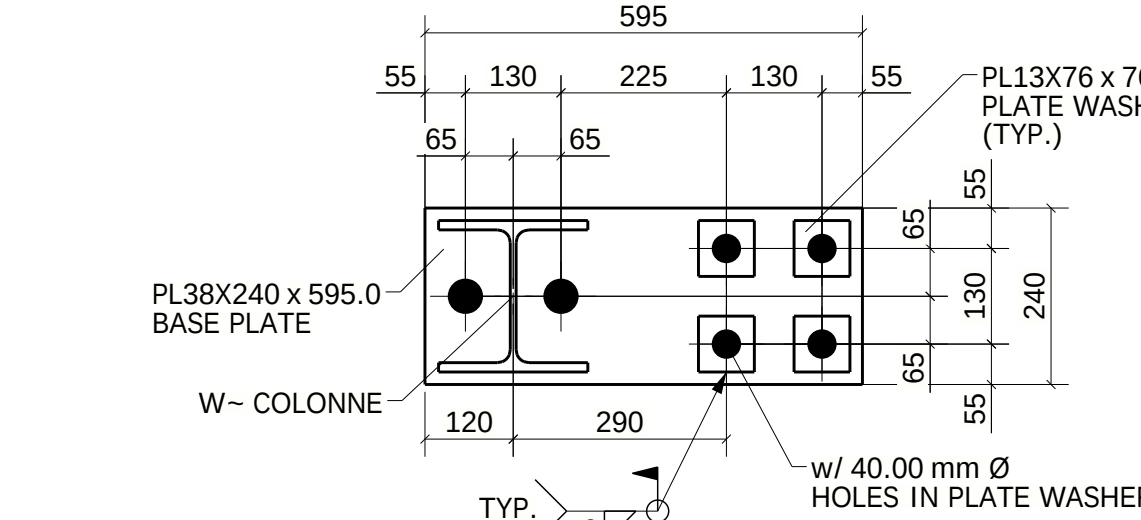


TYPE-18
(03-LOCATIONS)
(REF : PB-1-C-4/S-170)

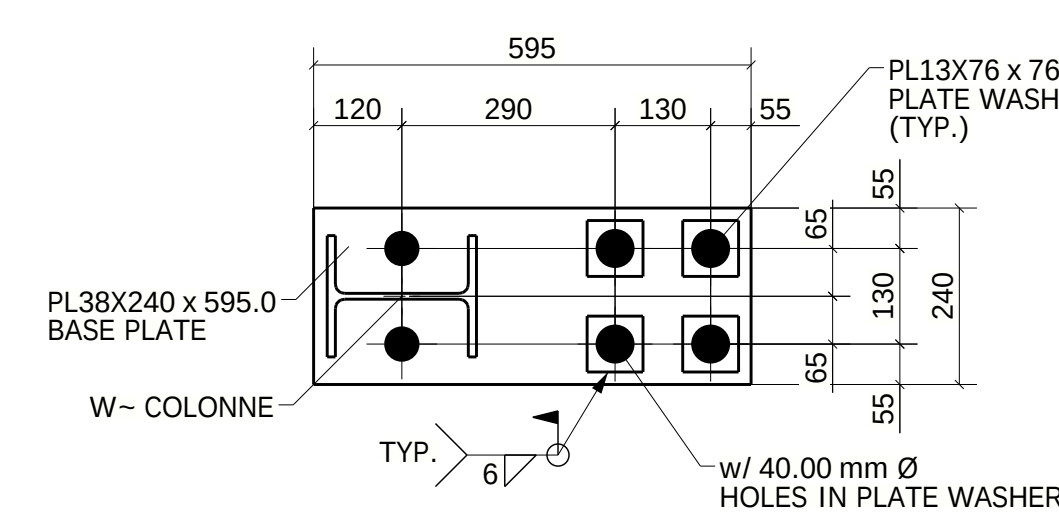

TYPE-18A
(01-LOCATION)
(REF : PB-1-C-4/S-170)

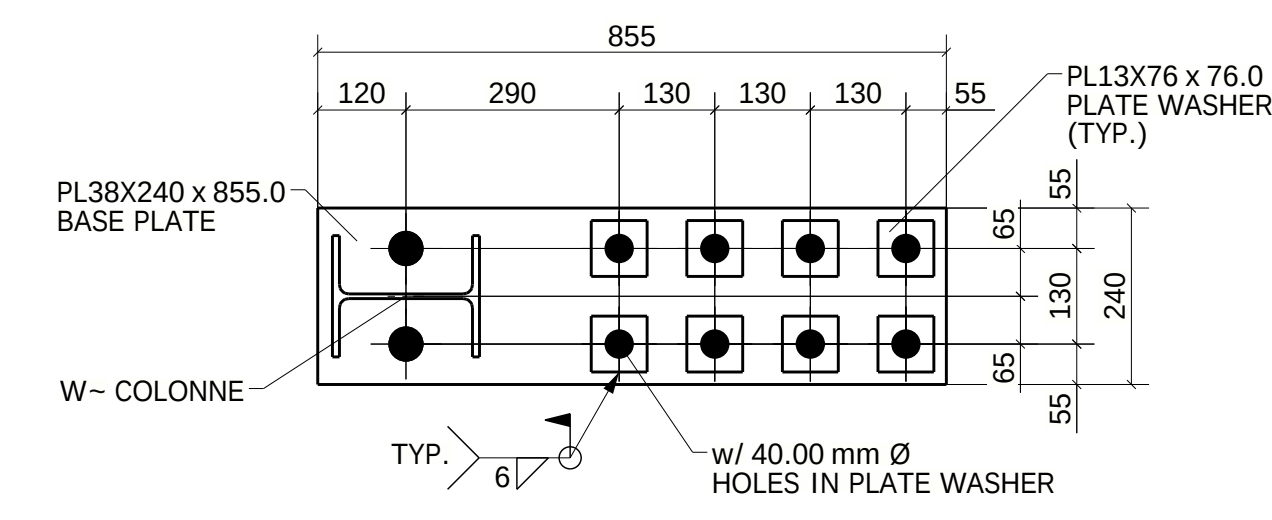



TYPE-19
(01-LOCATION)
(REF : PB-1-C-8/S-170)

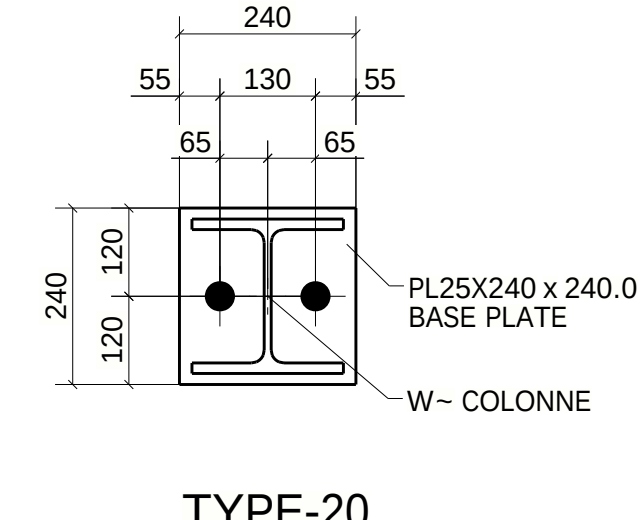

TYPE-20
(01-LOCATION)
(REF : PB-1-B-0/S-170)

REFER AB101, AB102, AB103 & AB104
FOR COLUMN SIZES & ORIENTATION
AND BASE PLATE ORIENTATION



DATE	NO.	DESCRIPTION	PAR	TROUS 220	S.I.C.
02/08/2021		FOR FIELD USE		BOULONS A325N	S.I.C.
01/27/2021		FOR RE-APPROVAL			S.I.C.
01/26/2021		FOR APPROVAL		PERITURE	S.I.C.

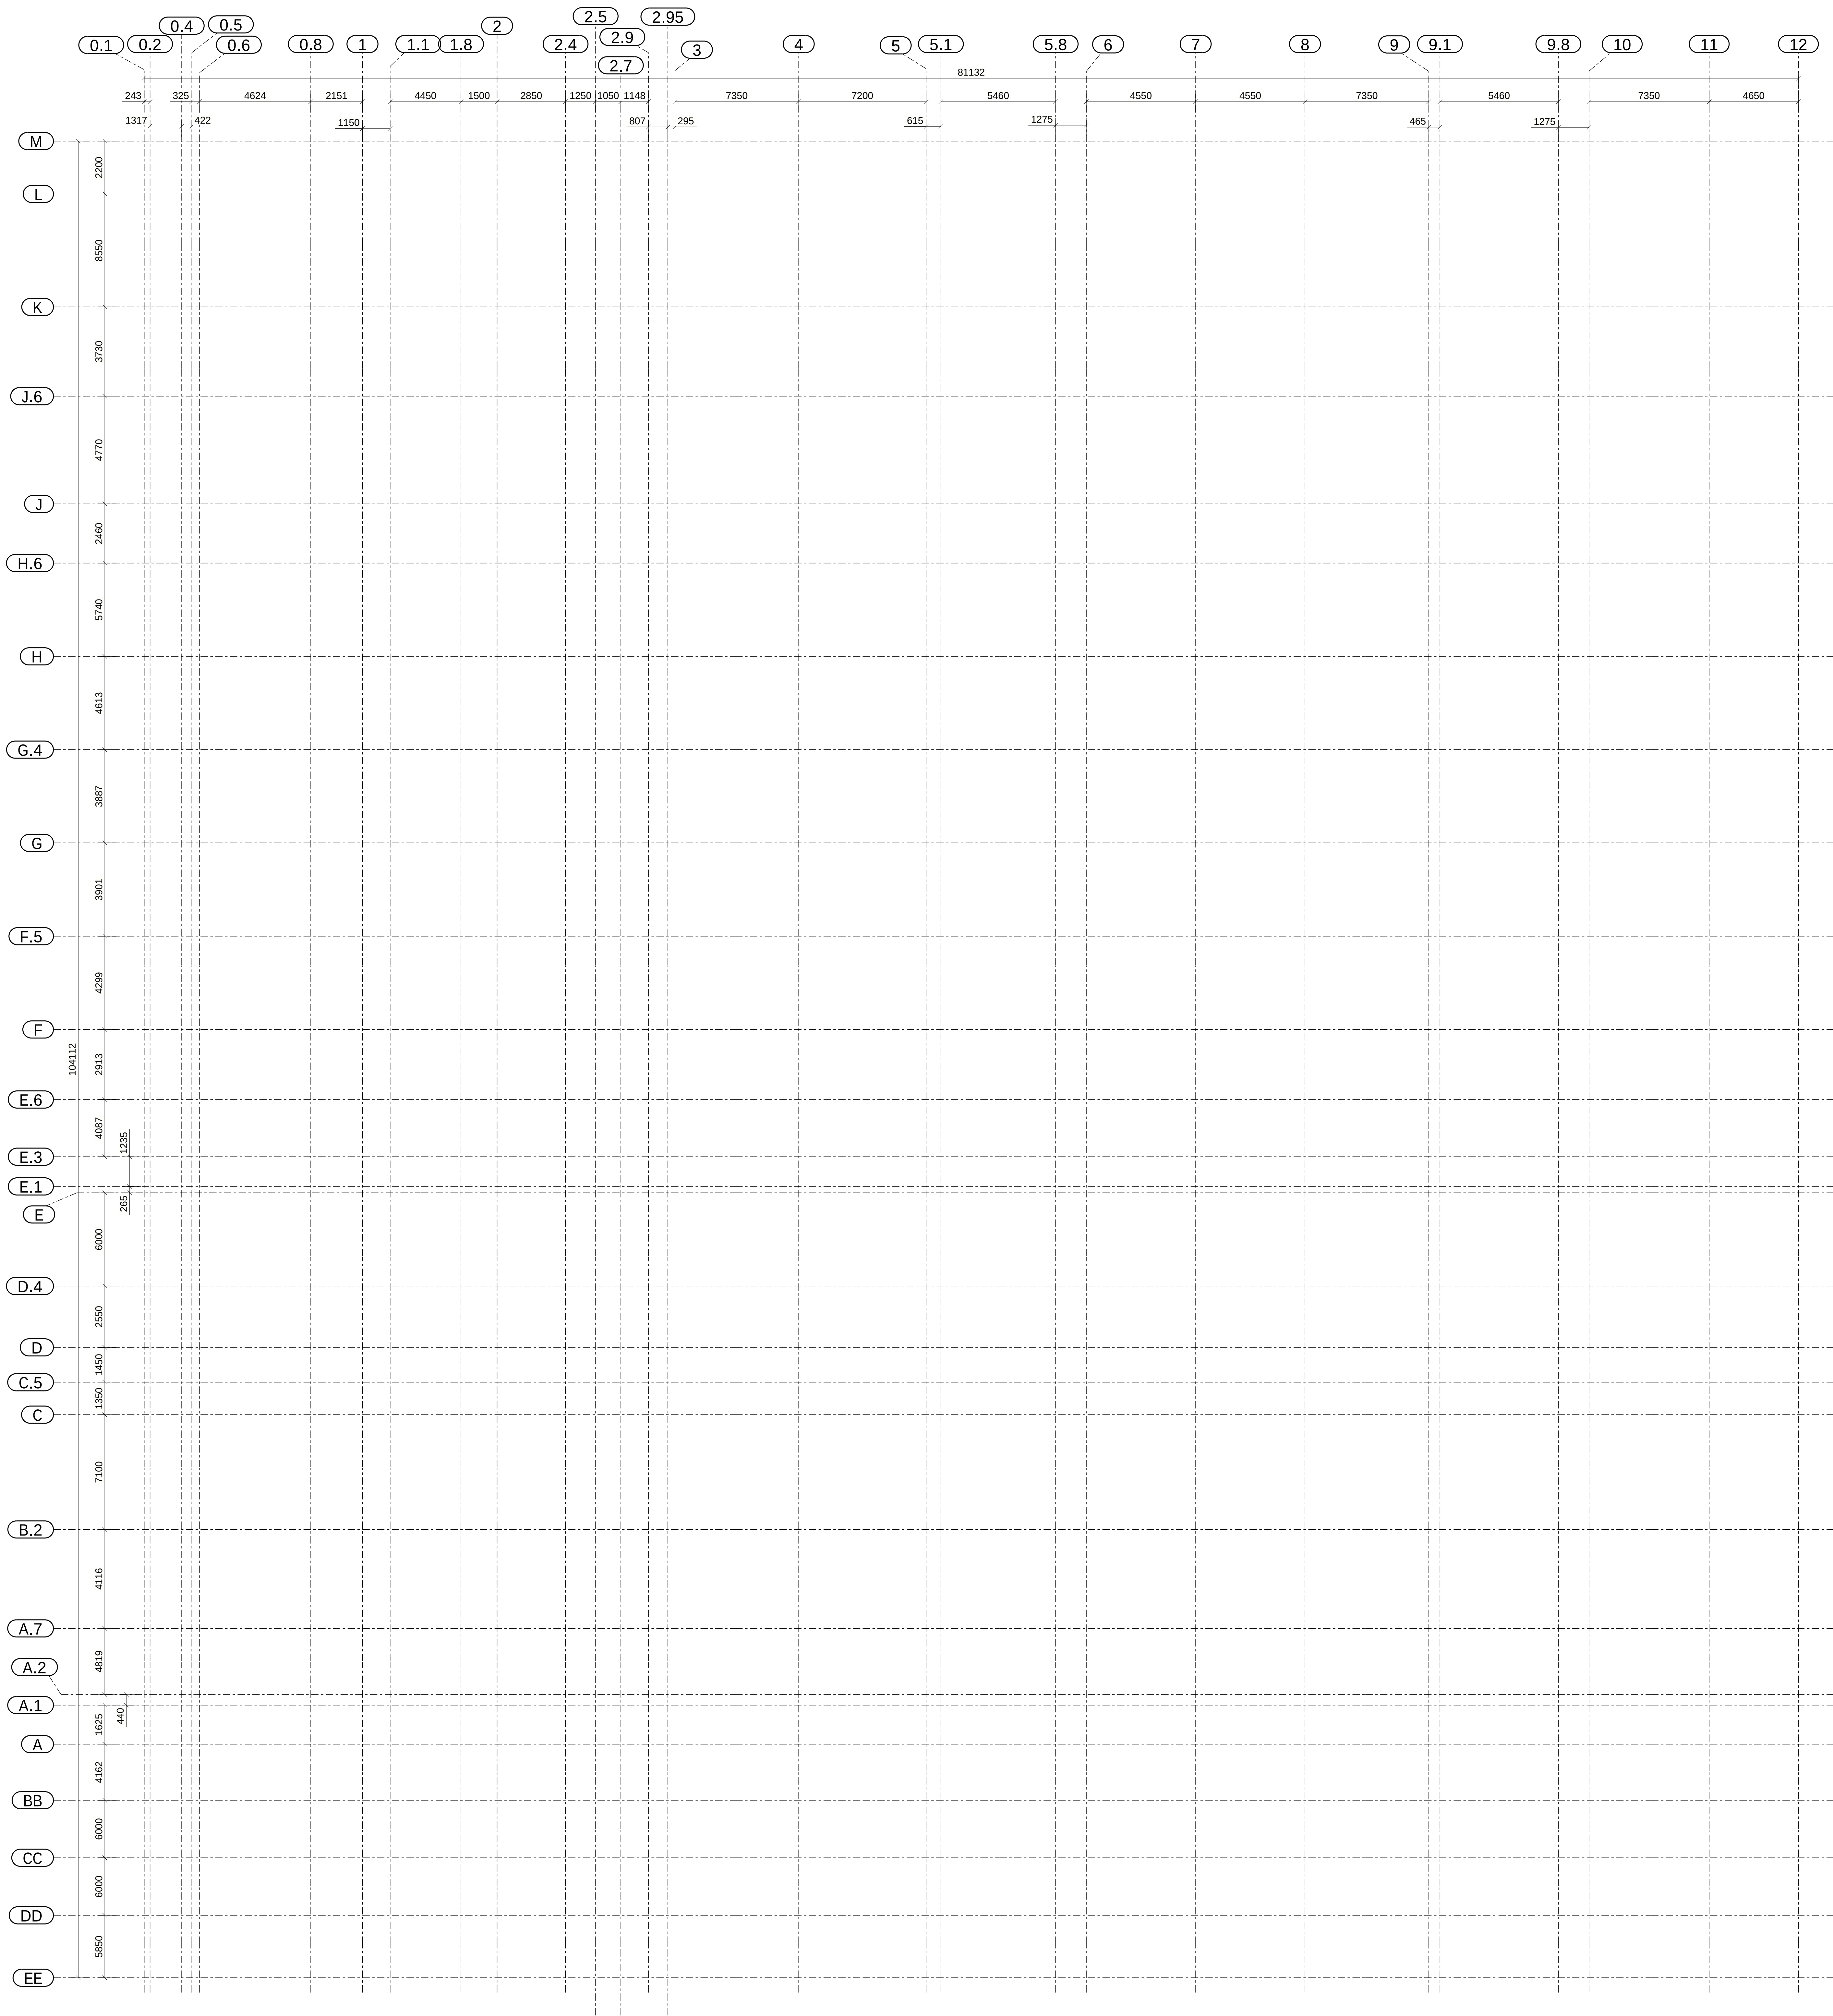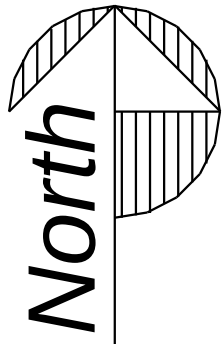


PLAN DE LA GRILLE
(DATA CENTER)

GRADE ACIER	S.I.C.
G40.21	S.I.C.
ELECTRODES	S.I.C.
E400X	S.I.C.
SOUDEUSE	S.I.C.
6mm	S.I.C.
TROUS	S.I.C.
21	S.I.C.
ROUVING	S.I.C.
A325	S.I.C.
PERCEUSE	S.I.C.
6mm	S.I.C.

DATE	NO.	DESCRIPTION	PAR
06/09/2021	1	Pour Construction	GO
06/07/2021	2	Pour Approbation	GO

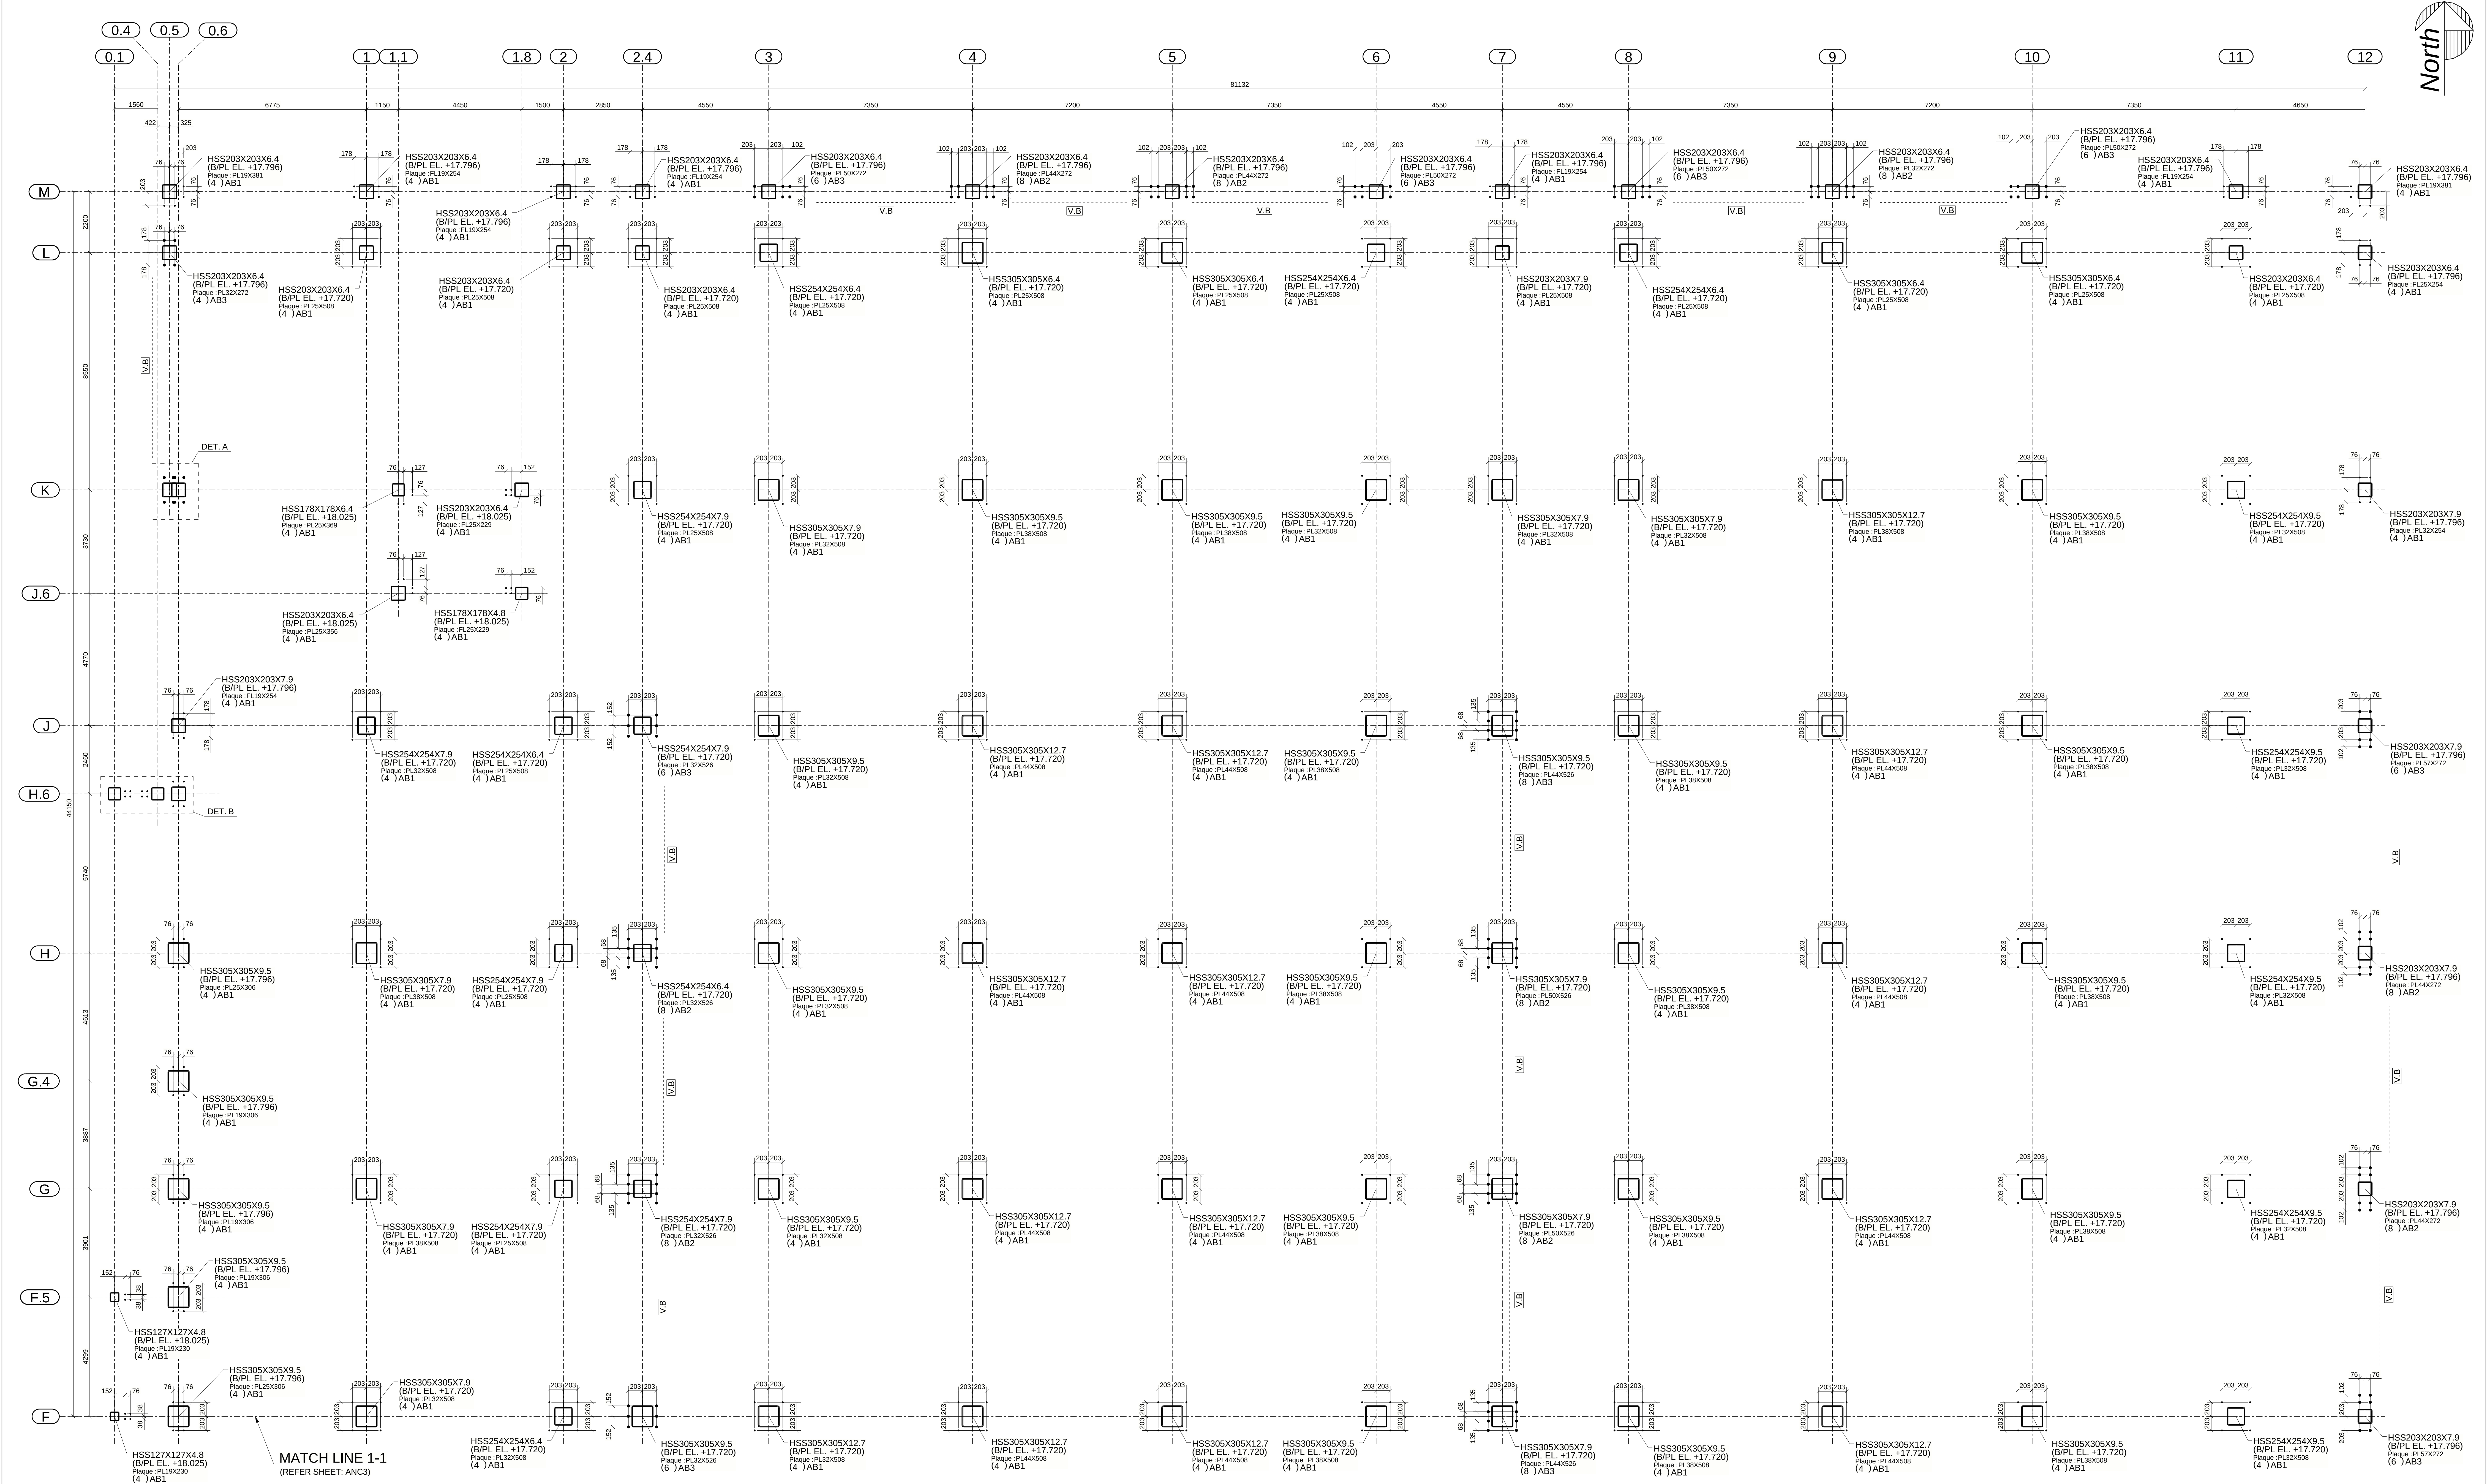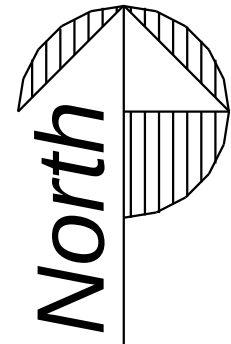



PLAN PARTIAL DE BOULON D'ANCRAGE

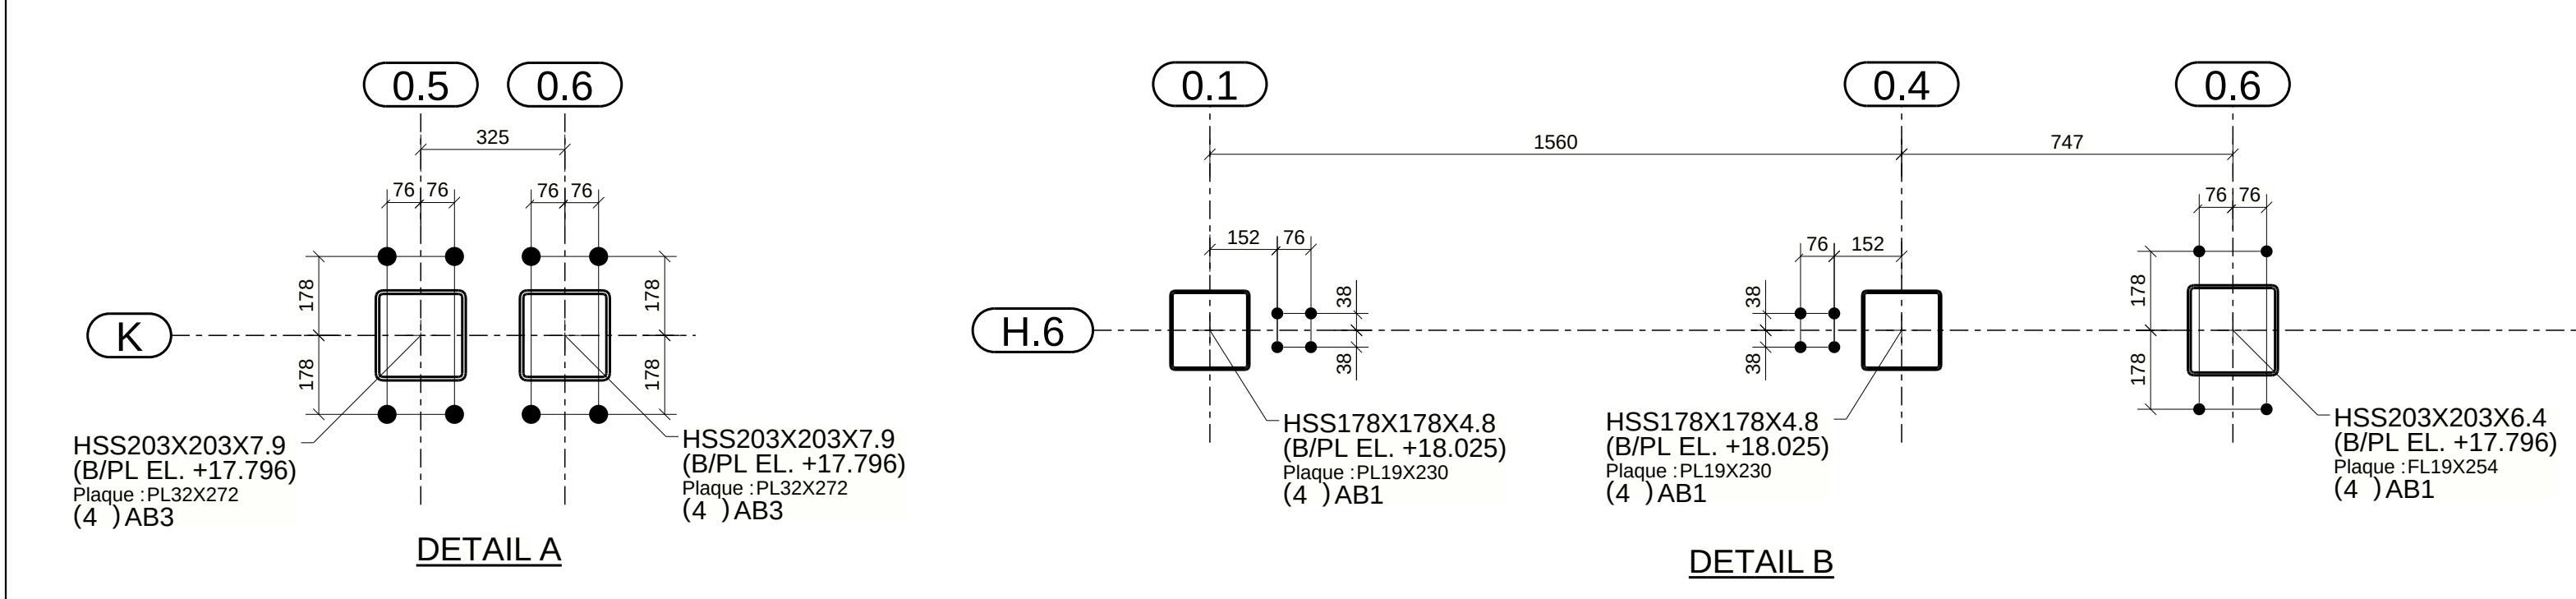


- NOTES:
- 1.) TOP OF FIN.FLOOR EL.18000mm= DATUM ELEVATION
 - 2.) ALL UNDER SIDE OF BASE PLATE ELEVATIONS SHOWN AT COLUMN LOCATIONS ARE REFERRED FROM DATUM ELEVATION
 - 3.) * - INDICATES COLUMN OFFSET FROM GRID.
 - 4.) V.B - INDICATES VERTICAL BRACING
 - 5.) (LSV)-INDICATES LONG SIDE VERTICAL (LSH)-INDICATES LONG SIDE HORIZONTAL

DATE	NO.	DESCRIPTION	PAR.
06/05/2021	01	Pour Construction	GO
06/07/2021	02	Pour Approbation	GO

GRADE ROIER	S.I.C.
G40.21	
ELECTRODES	S.I.C.
E-60XX	
SCOURURE	S.I.C.
6mm	
TROUS	S.I.C.
21	
ROUJONS	S.I.C.
A325	
PENETRATION	S.I.C.
GO	

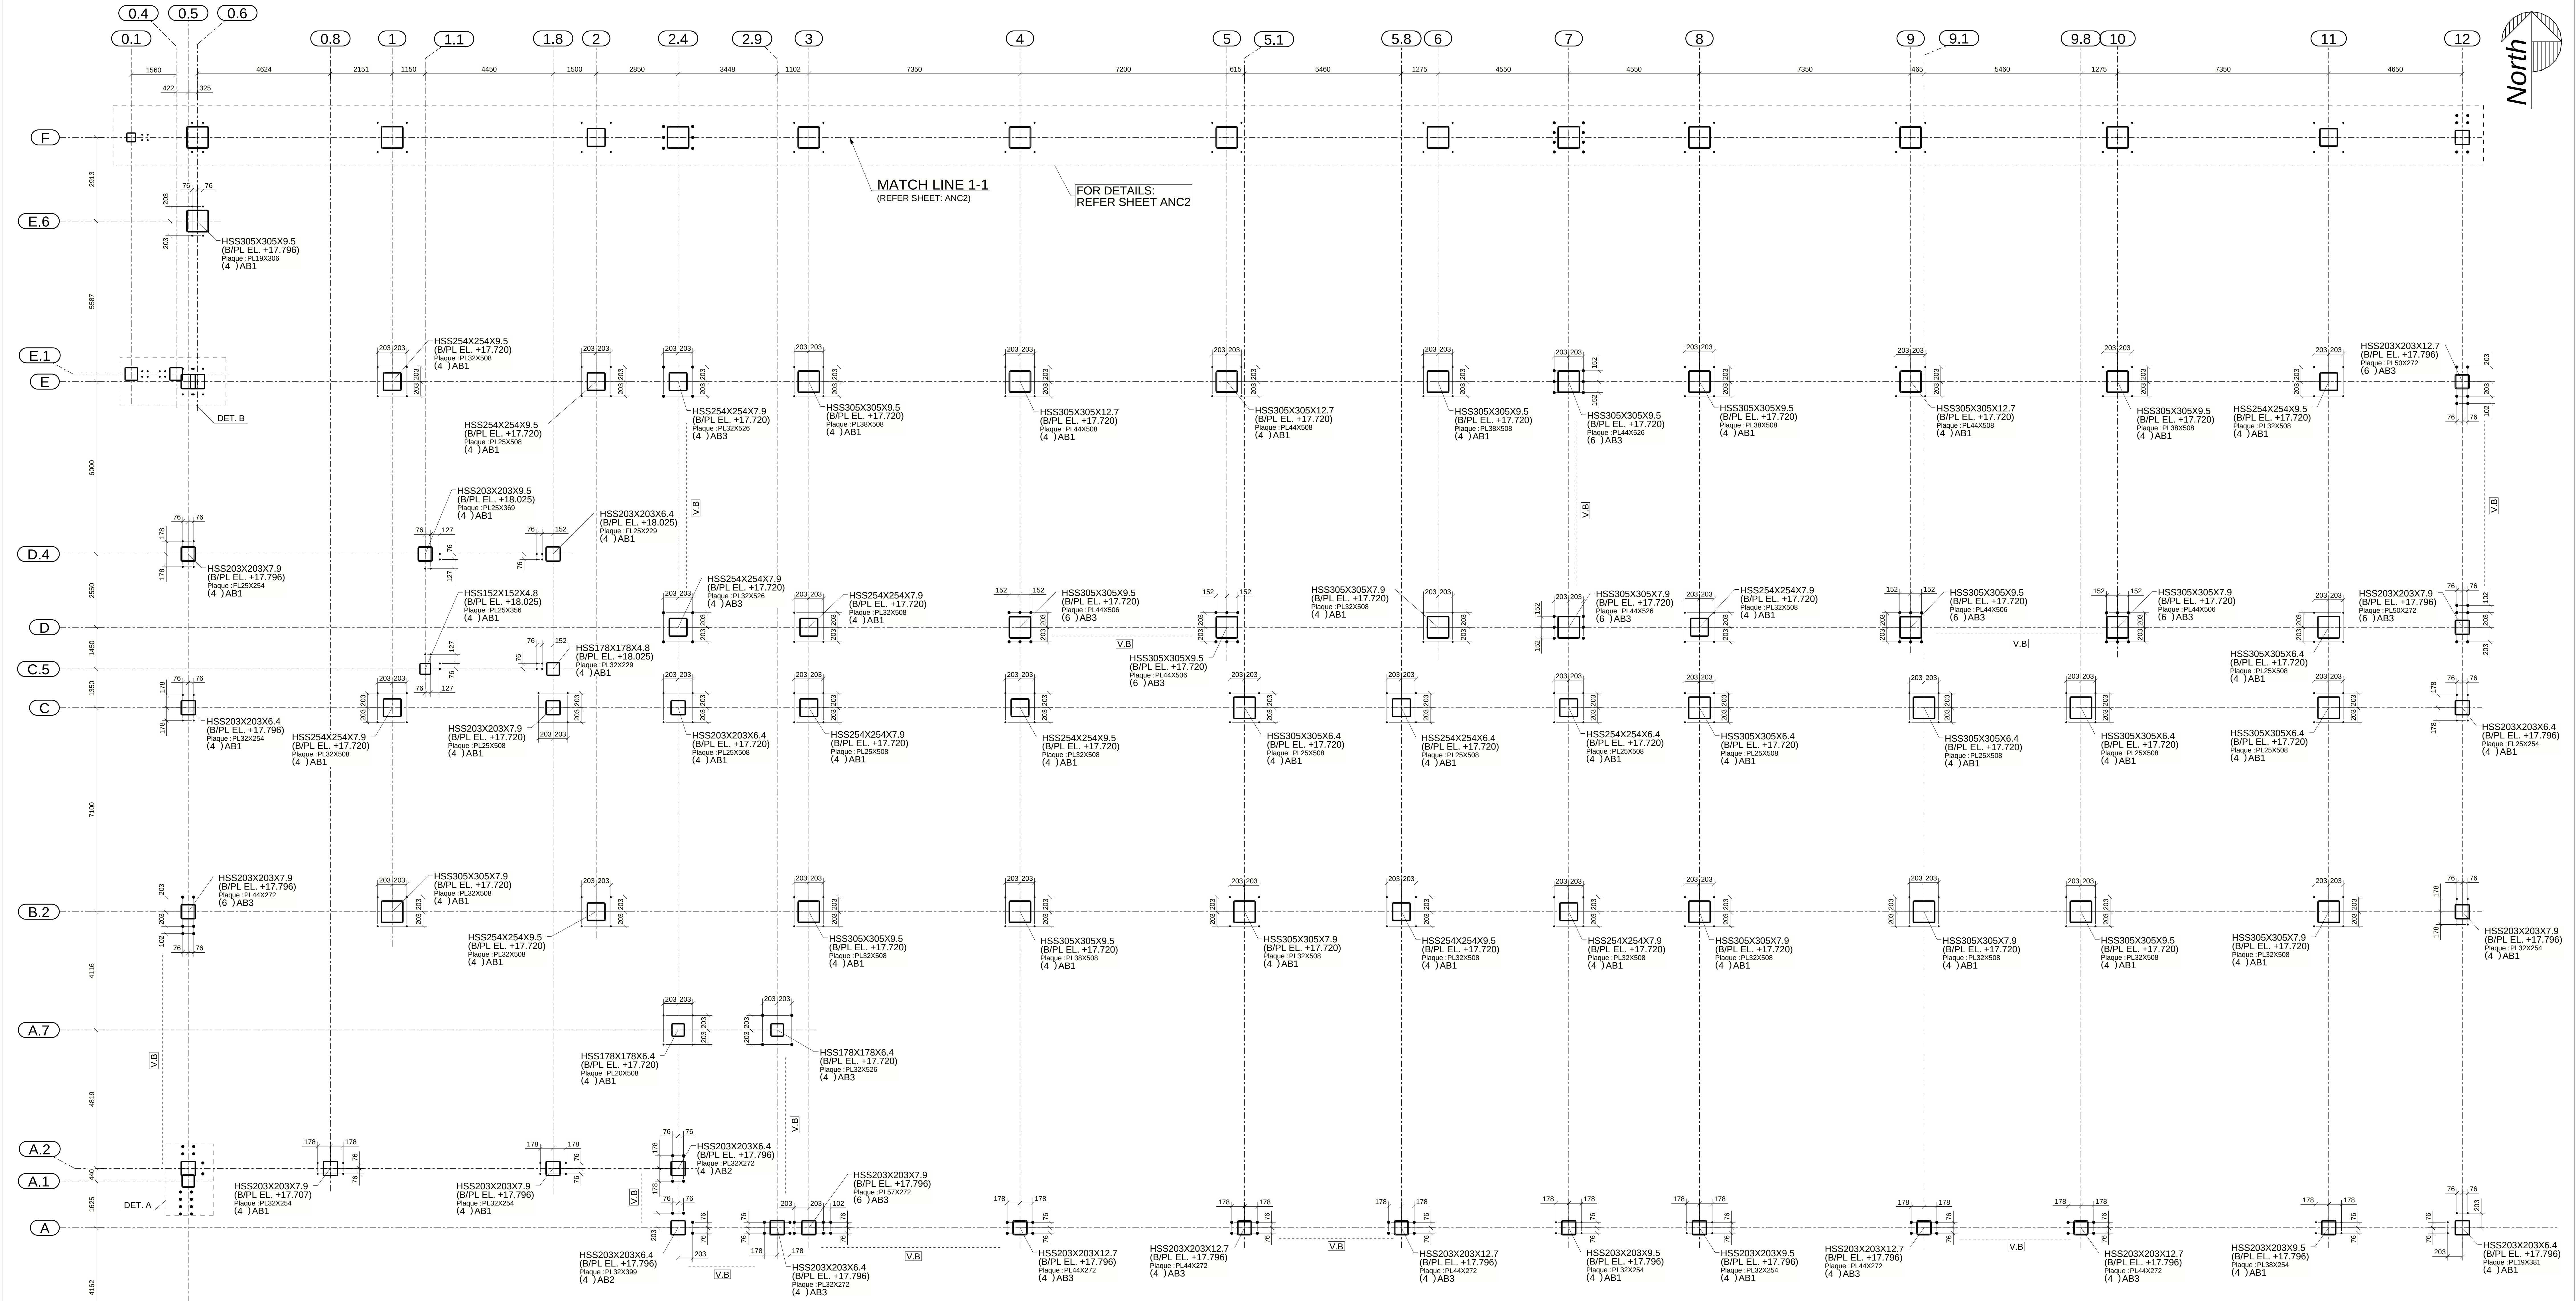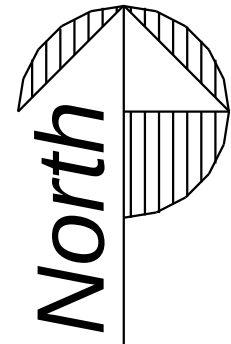

PLAN PARTIAL DE BOULON D'ANCRAGE

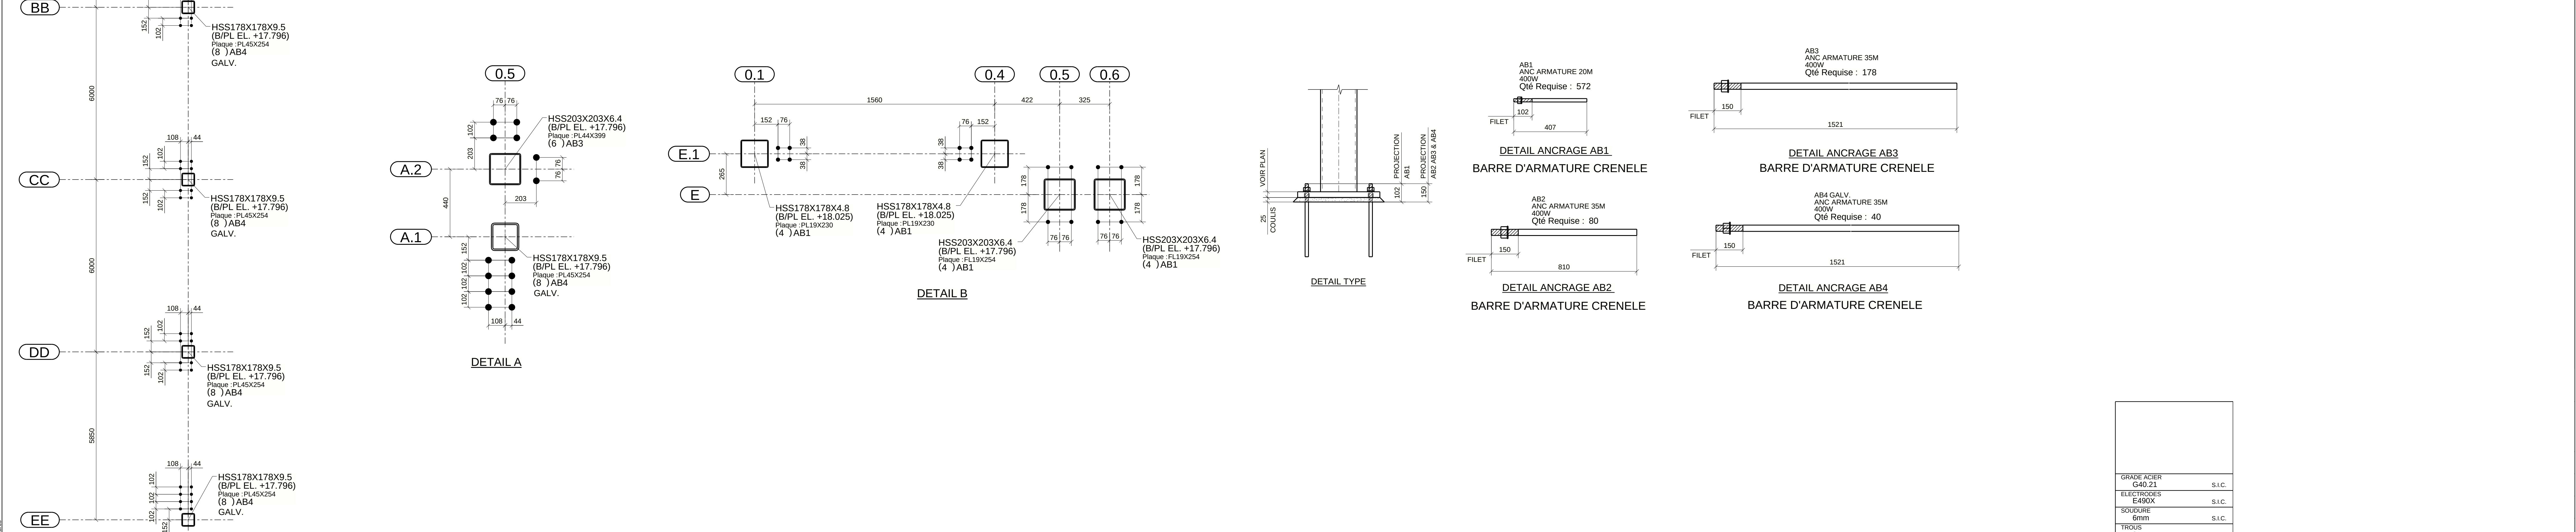

DATE	NO.	DESCRIPTION	PAR
06/09/2021	01	Pour Construction	GO
06/07/2021	02	Pour Approbation	GO

GRADE ACIER	S.I.C.
ELECTRODES	S.I.C.
BOULONS	S.I.C.
PROFIL	S.I.C.
21	S.I.C.
325	S.I.C.
PENETRE	S.I.C.
GTS	S.I.C.