



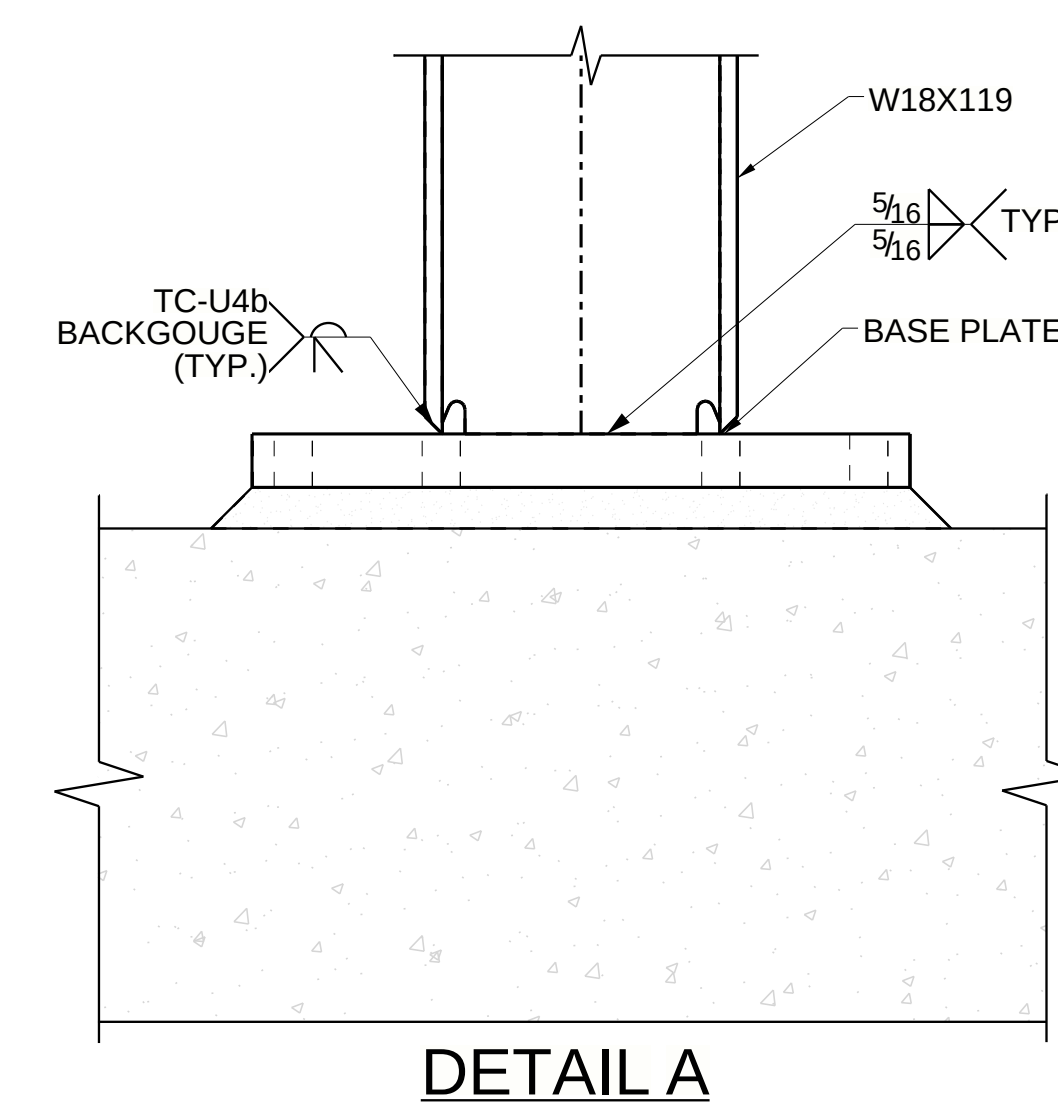

1. REFER E100 SHEET FOR GENERAL NOTES.
2. REFER E109 SHEET FOR TYPICAL SECTIONS & DETAILS.

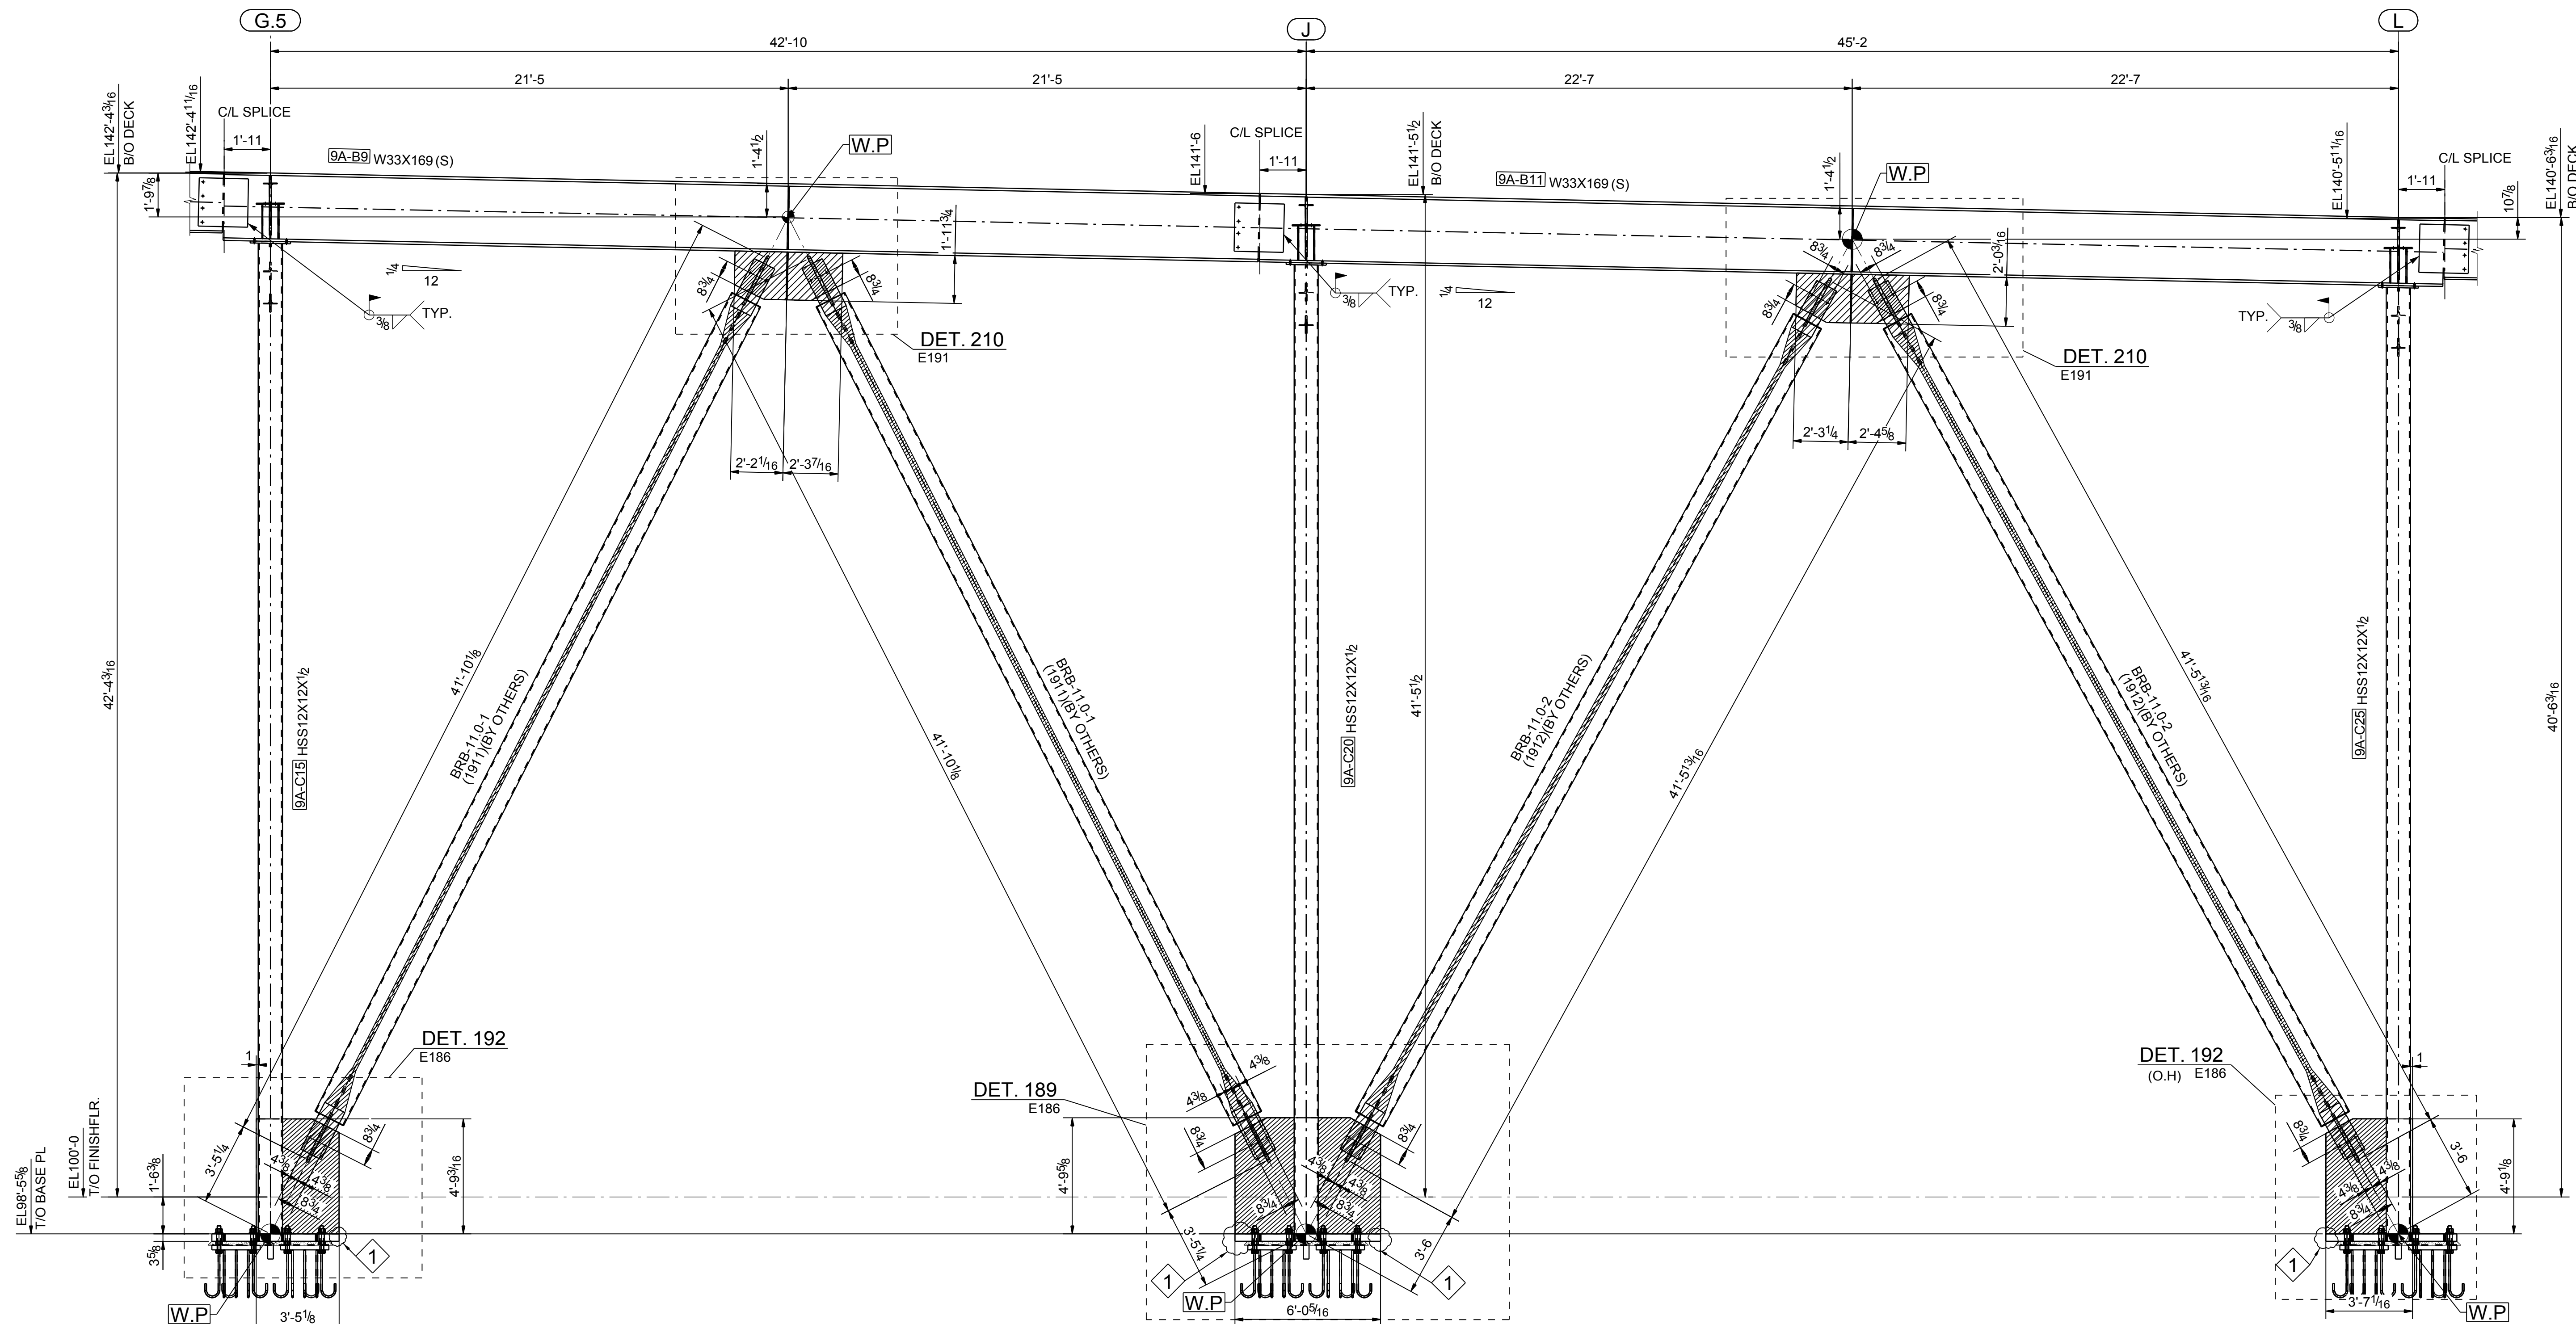


SECTION 80 - 80
E133
BRACED FRAME ELEVATION ALONG "24"
(REFER :BRACED FRAME ELEVATION ALONG GRID "24" (S-302))

APPROVER VERIFY & FURNISH ALL CLOUDED INFORMATION TYPICAL UNLESS NOTED


1 APPROVER VERIFY AS PER CORE BRACE CONNECTION SCHEDULE 2/CB-03 BASEPLATE LENGTH IS NOT SUFFICIENT TO ACCOMODATE GUSSET PLATE, SO TO ACHIEVE SHOP WELD FOR GUSSET PLATE TO BASEPLATE EXTENDING BASEPLATE AS REQUIRED TYPICAL AT ALL LOCATIONS.

NOTES:-

1. REFER E111 SHEET FOR GENERAL NOTES.
2. REFER E186 TYPICAL BRACE DETAILS.


 -INDICATE PROTECTED ZONES

BRB PROTECTED ZONES INCLUDE THE STEEL CORE AND CONNECTION ELEMENTS AND SHALL SATISFY THE REQUIREMENTS OF SECTION F4.5c OF AISC 341. ADDITIONALLY, ATTACHMENTS WHICH PENETRATE THE CASING (SCREWS, PAF, ETC) OR ANY ATTACHMENT SUPPORTING OVER 50LBS SHALL BE APPROVED BY THE ENGINEER OF RECORD AND COREBRACE.

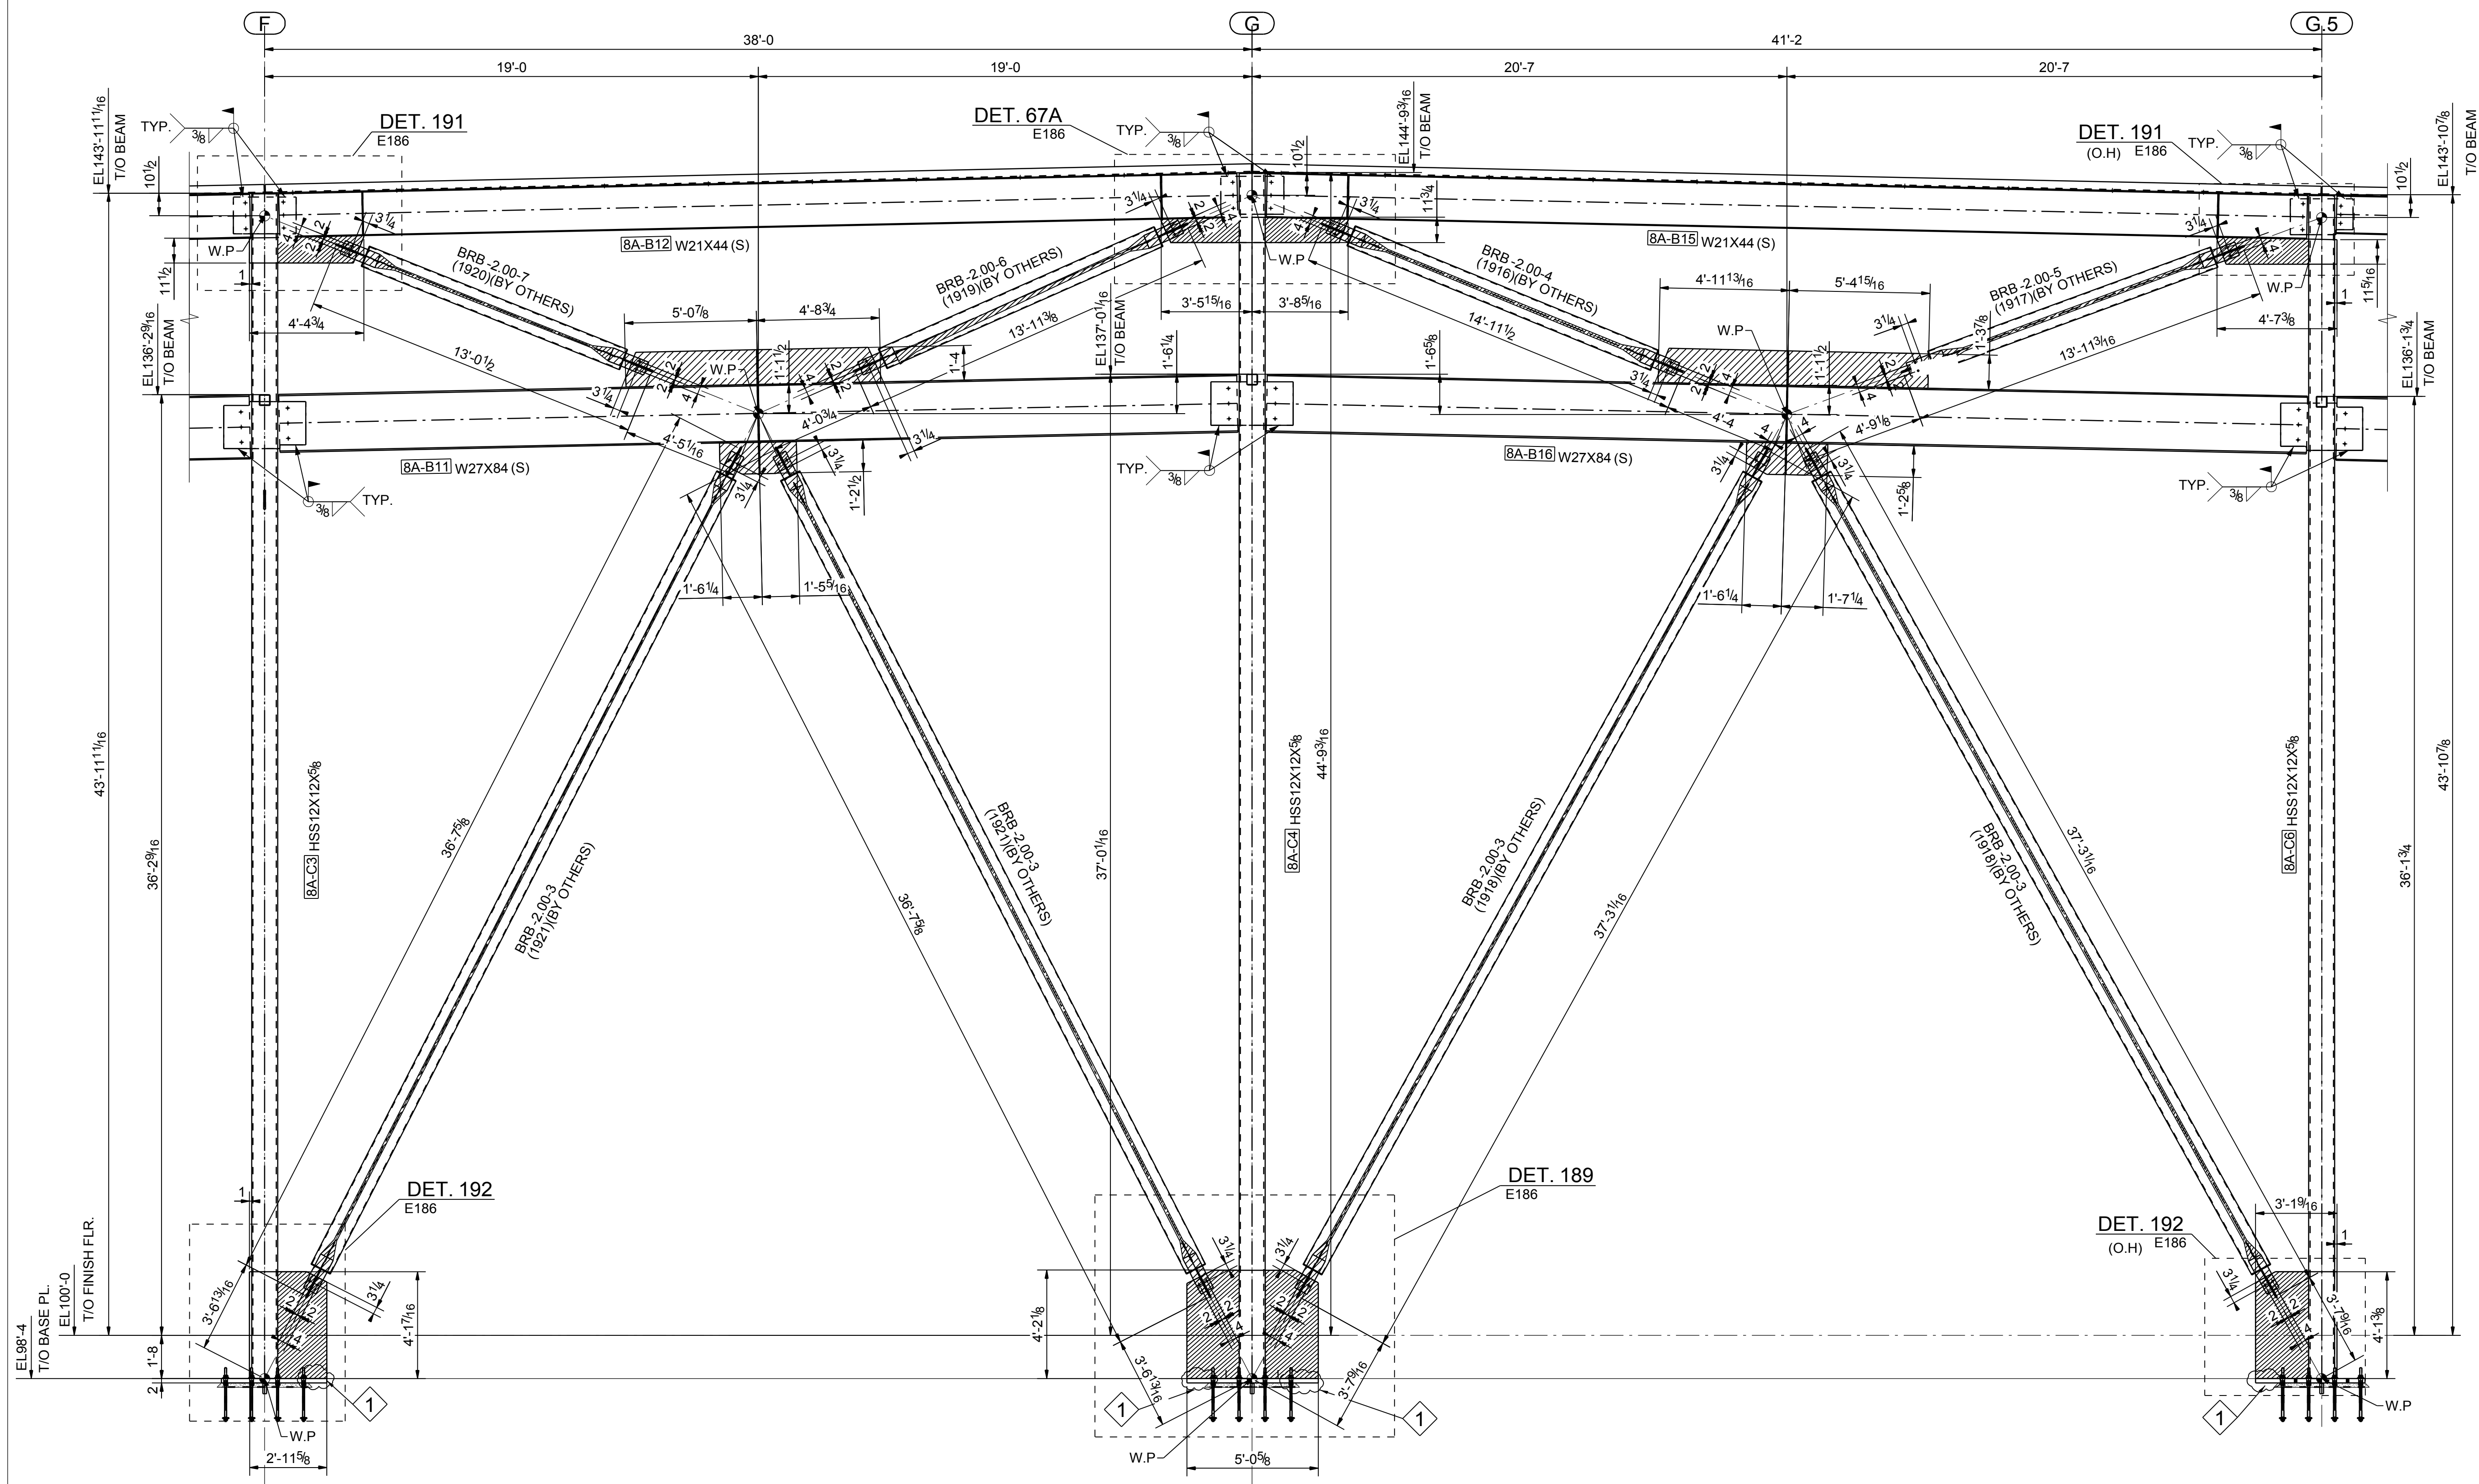

SECTION 67 - 67
E128
BRACED FRAME ELEVATION ALONG GRID "17"

(REFER :BRACED FRAME ELEVATION ALONG GRID "17" /S-301)

 - INDICATE PROTECTED ZONES


NOTES:-

1. REFER E111 SHEET FOR GENERAL NOTES.
2. REFER E186 TYPICAL BRACE DETAILS.

APPROVER VERIFY & FURNISH ALL CLOUDED INFORMATION TYPICAL UNLESS NOTED

APPROVER VERIFY AS PER CORE BRACE CONNECTION SCHEDULE 2/CB-03
BASEPLATE LENGTH IS NOT SUFFICIENT TO ACCOMODATE GUSSET PLATE,
SO TO ACHIEVE SHOP WELD FOR GUSSET PLATE TO BASEPLATE EXTENDING
BASEPLATE AS REQUIRED TYPICAL AT ALL LOCATIONS.


BRB PROTECTED ZONES INCLUDE THE STEEL CORE AND CONNECTION ELEMENTS AND SHALL SATISFY THE REQUIREMENTS OF SECTION F4.5c OF AISC 341. ADDITIONALLY, ATTACHMENTS WHICH PENETRATE THE CASING (SCREWS, PAF, ETC) OR ANY ATTACHMENT SUPPORTING OVER 50LBS SHALL BE APPROVED BY THE ENGINEER OF RECORD AND COREBRACE.

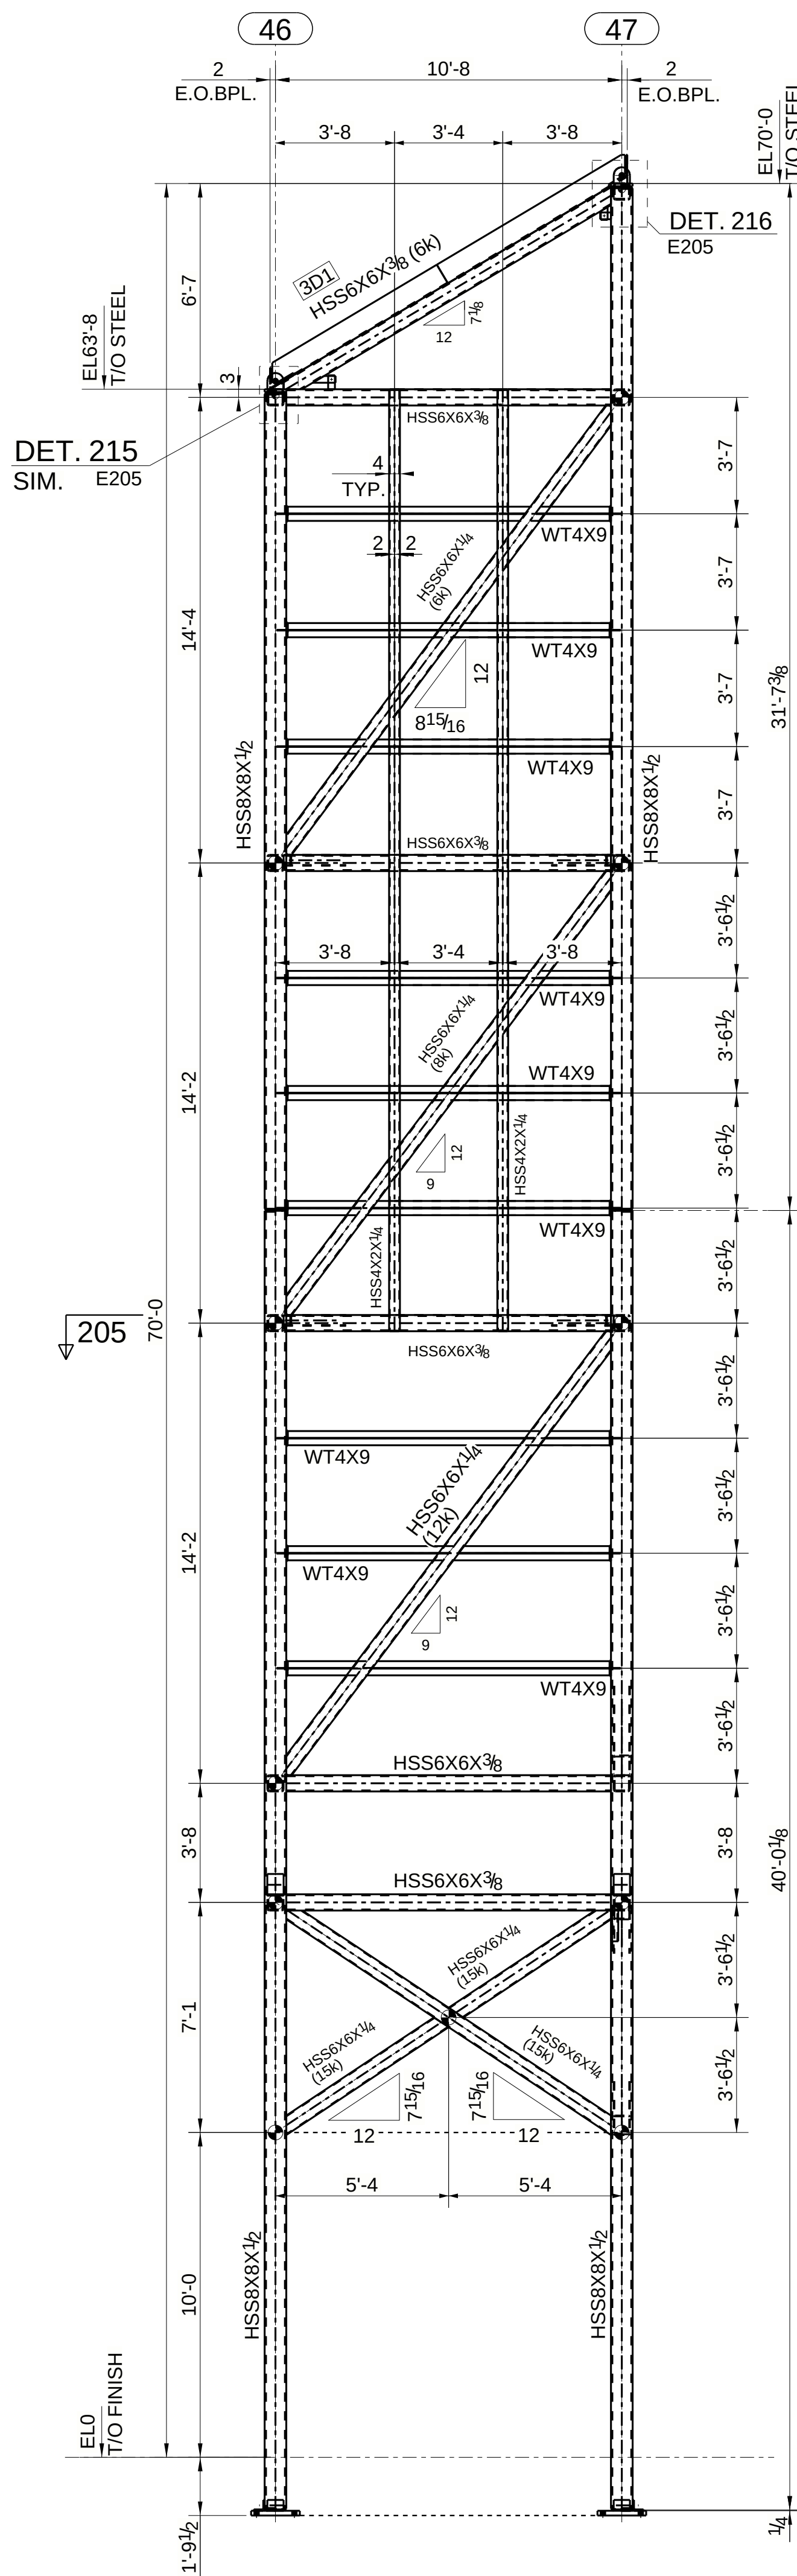

SECTION 201 - 201

E201


REFER : TOWER ELEVATION - F / S2.4

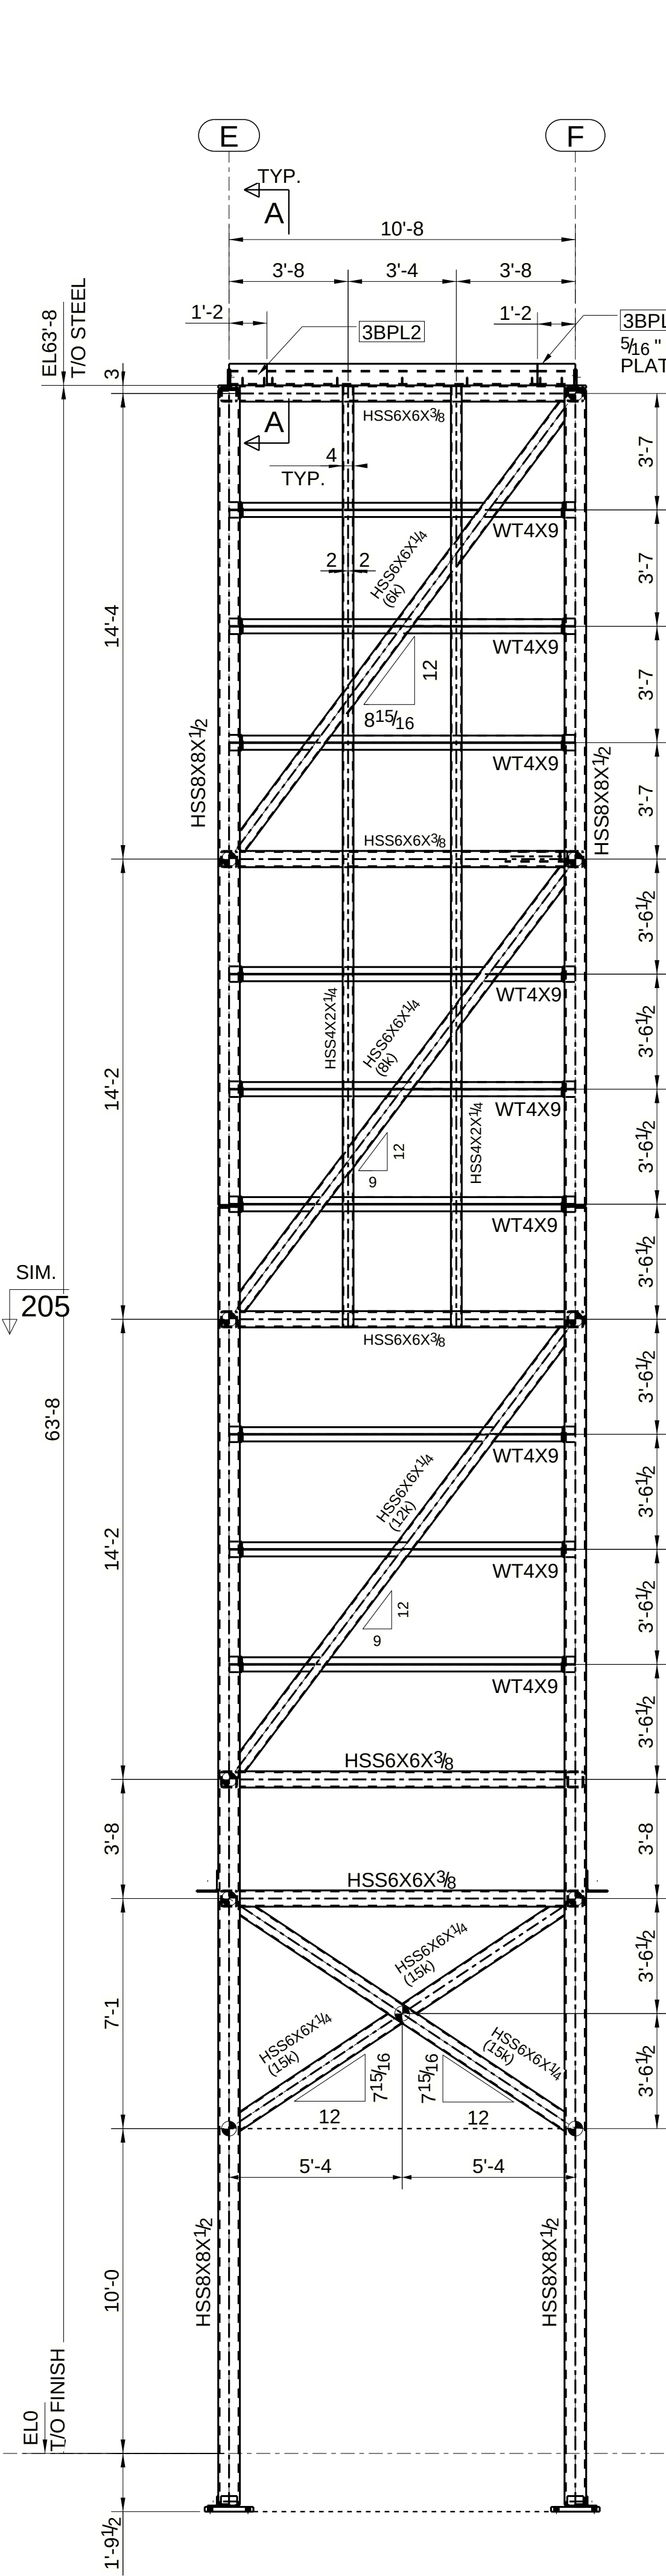

SECTION 202 - 202

E201


REFER : TOWER ELEVATION - 46 / S2.4

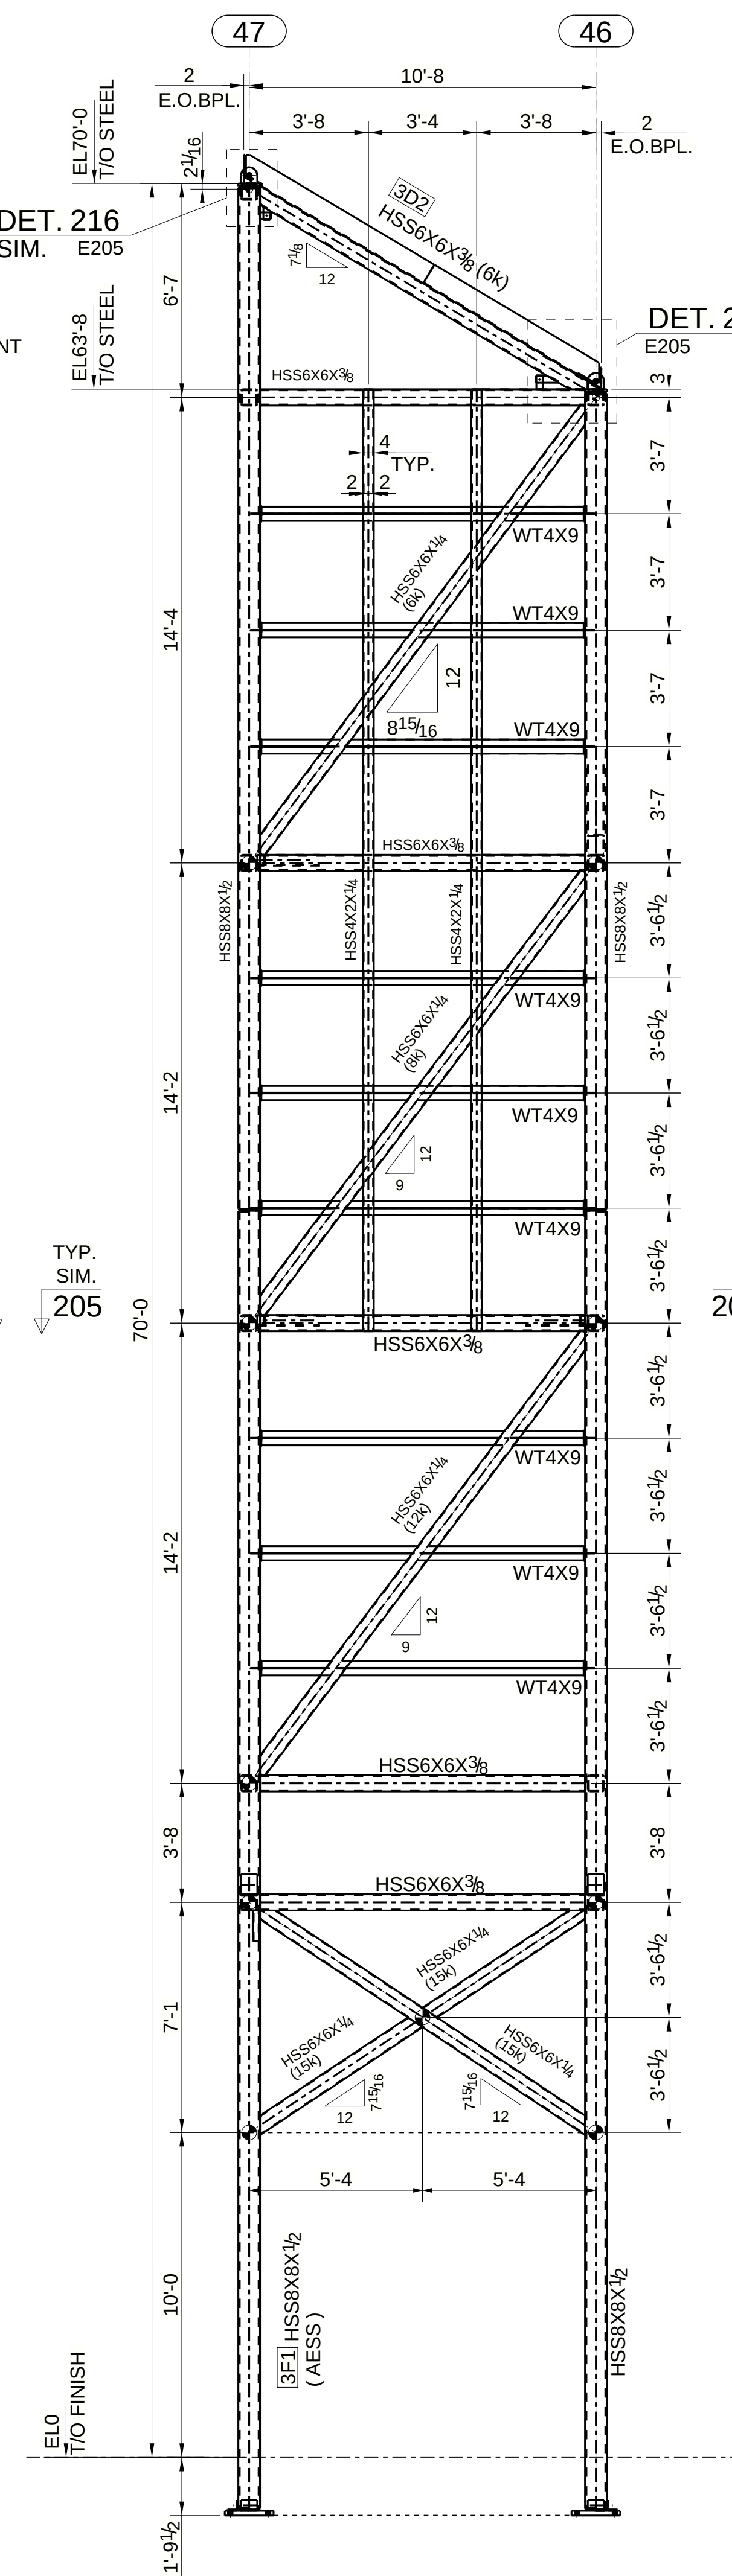

SECTION 203 - 203

E201


REFER : TOWER ELEVATION - E / S2.4

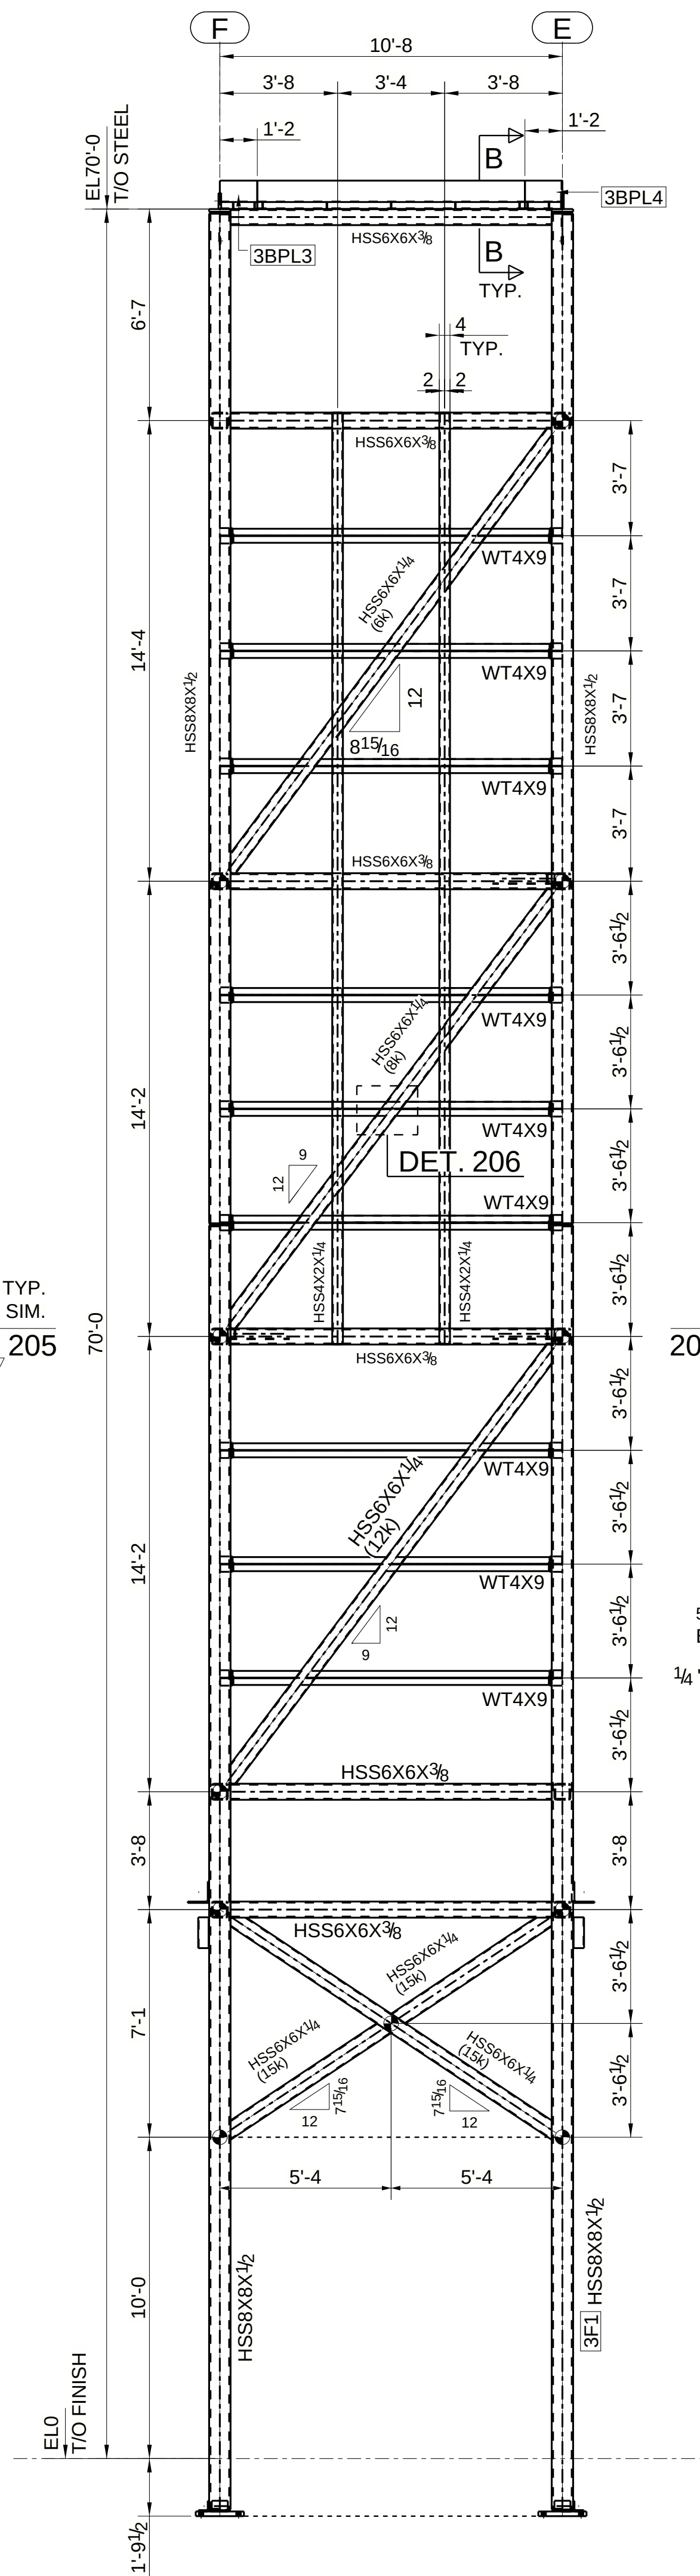


SECTION 204 - 204

E201

REFER : TOWER ELEVATION - 47 / S2.4

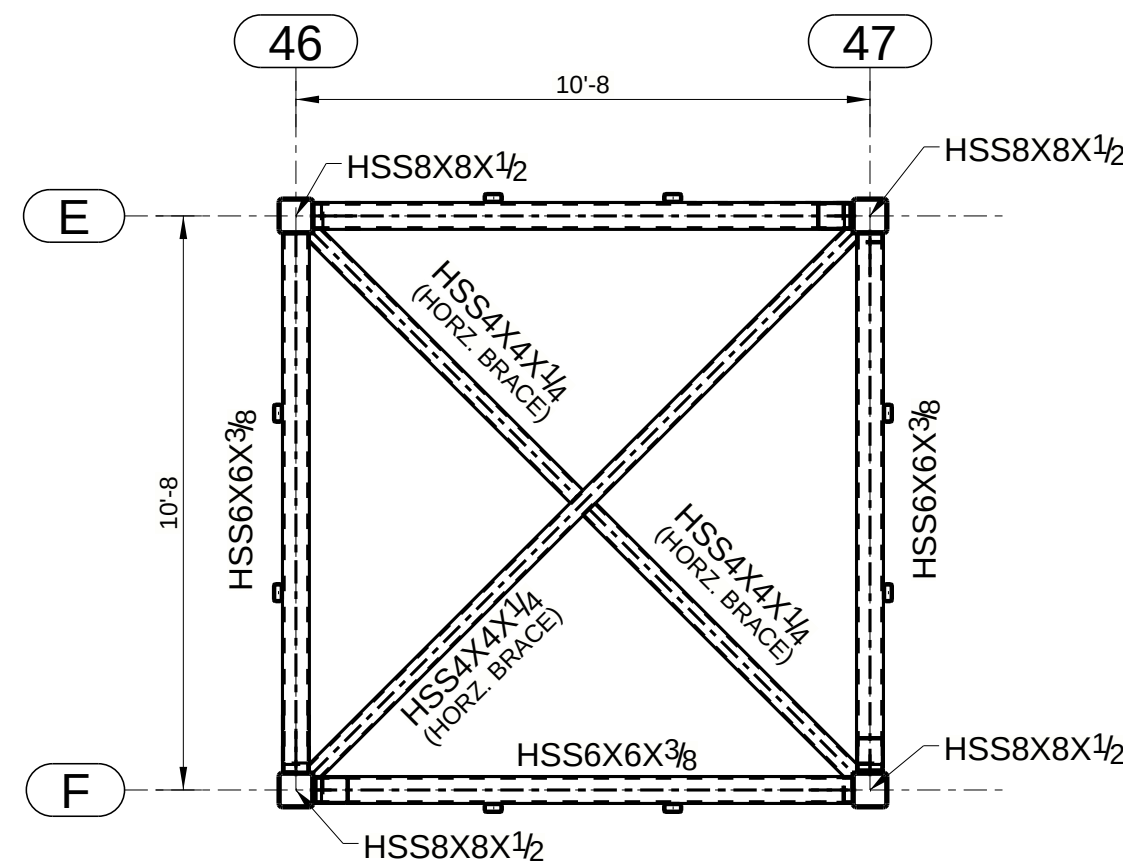


SECTION 205 - 205

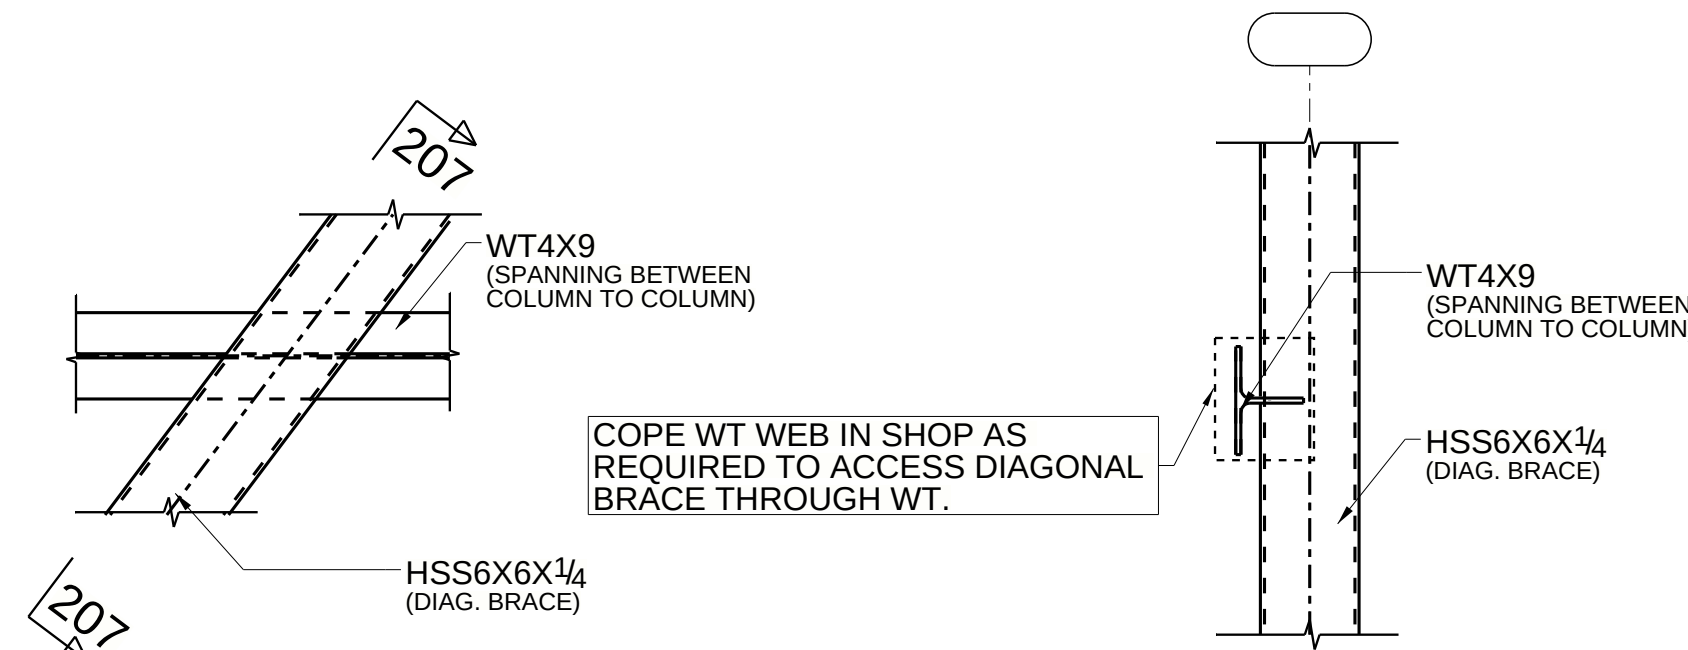

DETAIL 206


SECTION 207 - 207

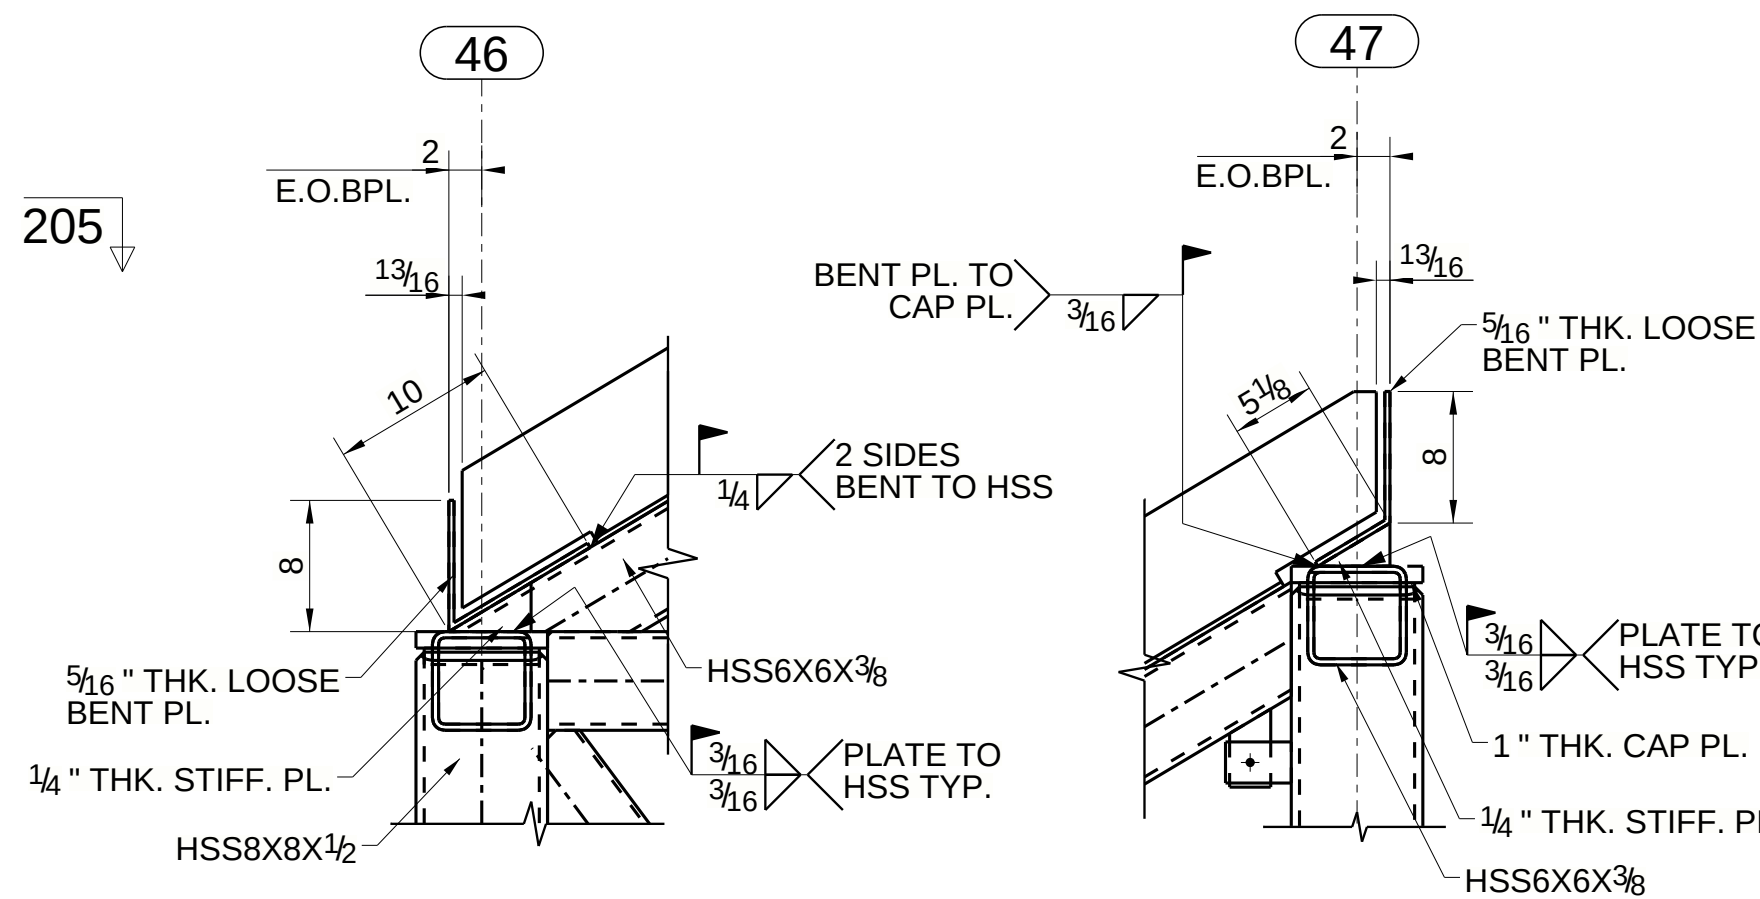





SECTION A - A

SECTION B - B

COMPLETE TOWER FRAME ASSEMBLY WILL
RECEIVE AESS FINISH.
REFER E100 SHEET FOR FURTHER INFORMATIONS.




SECTION B - B

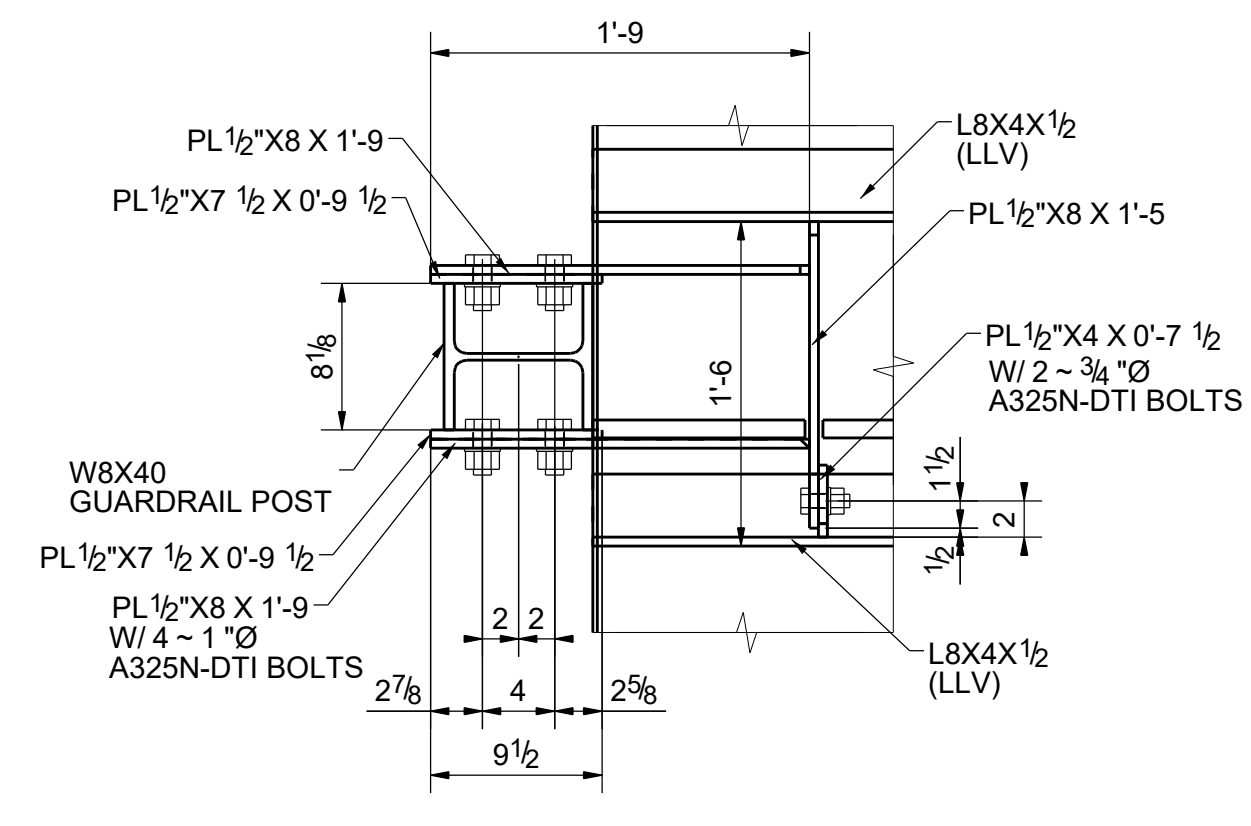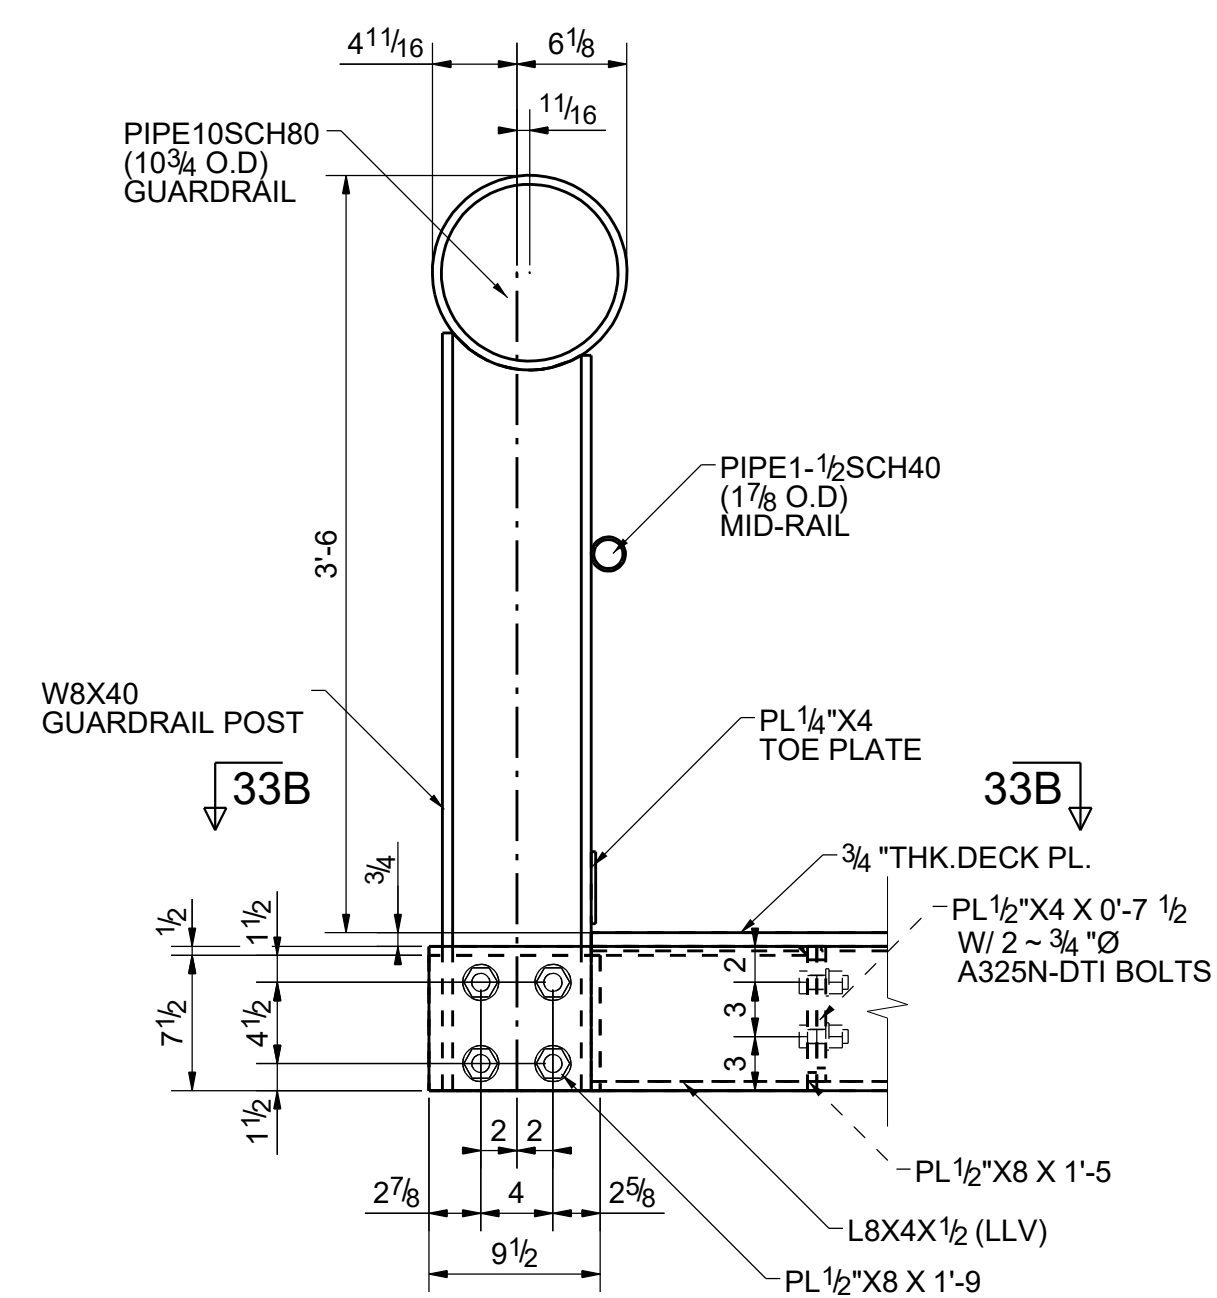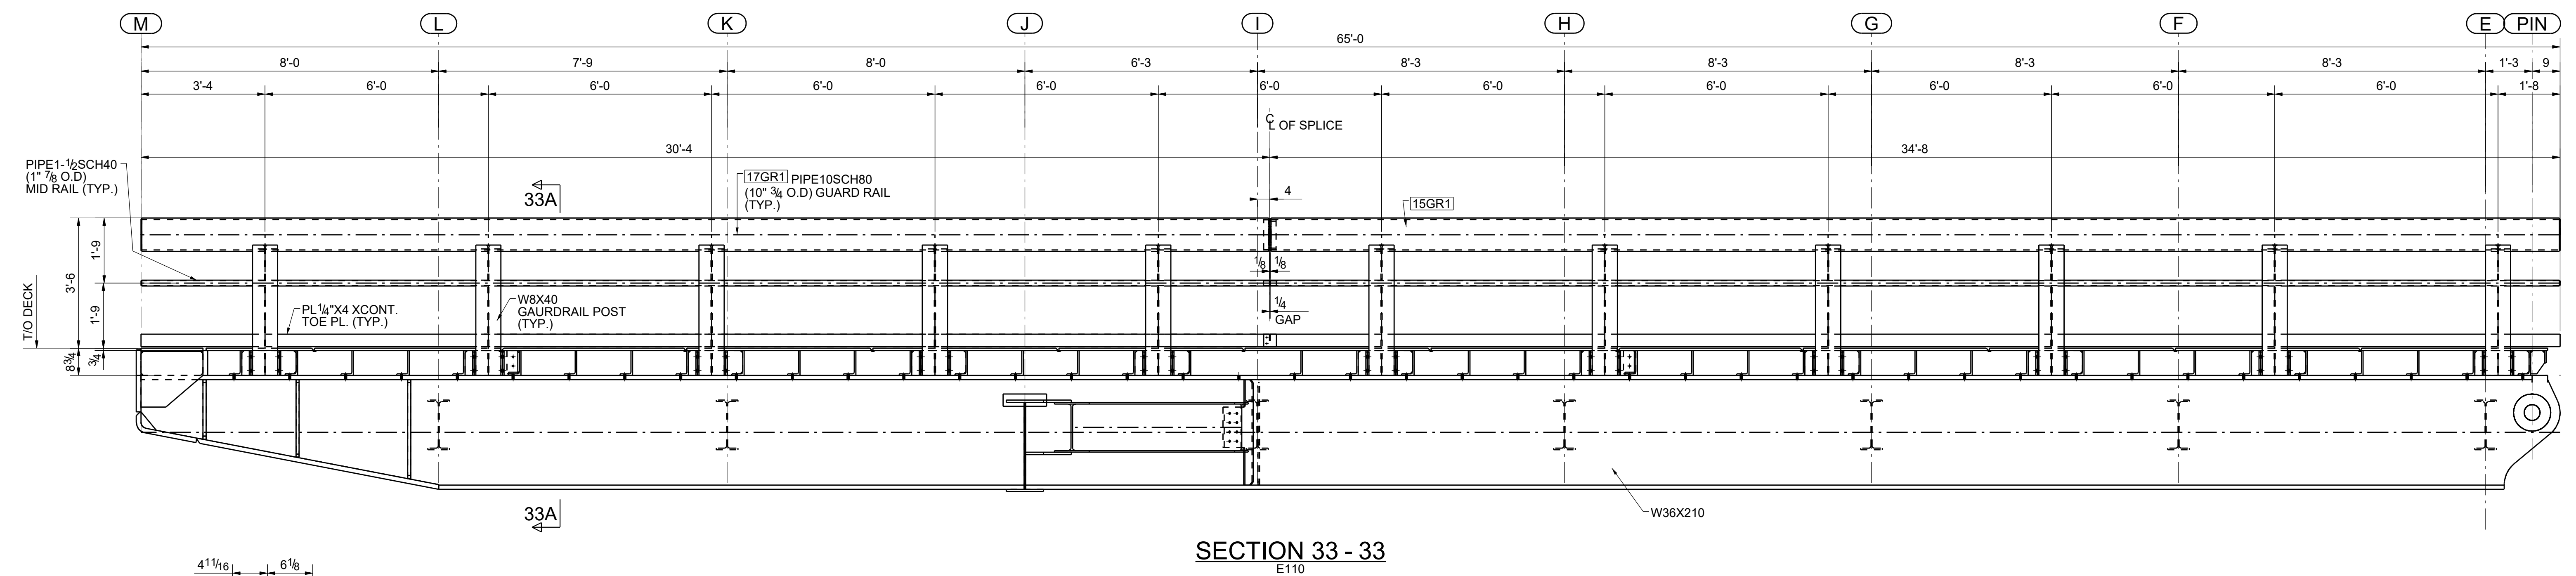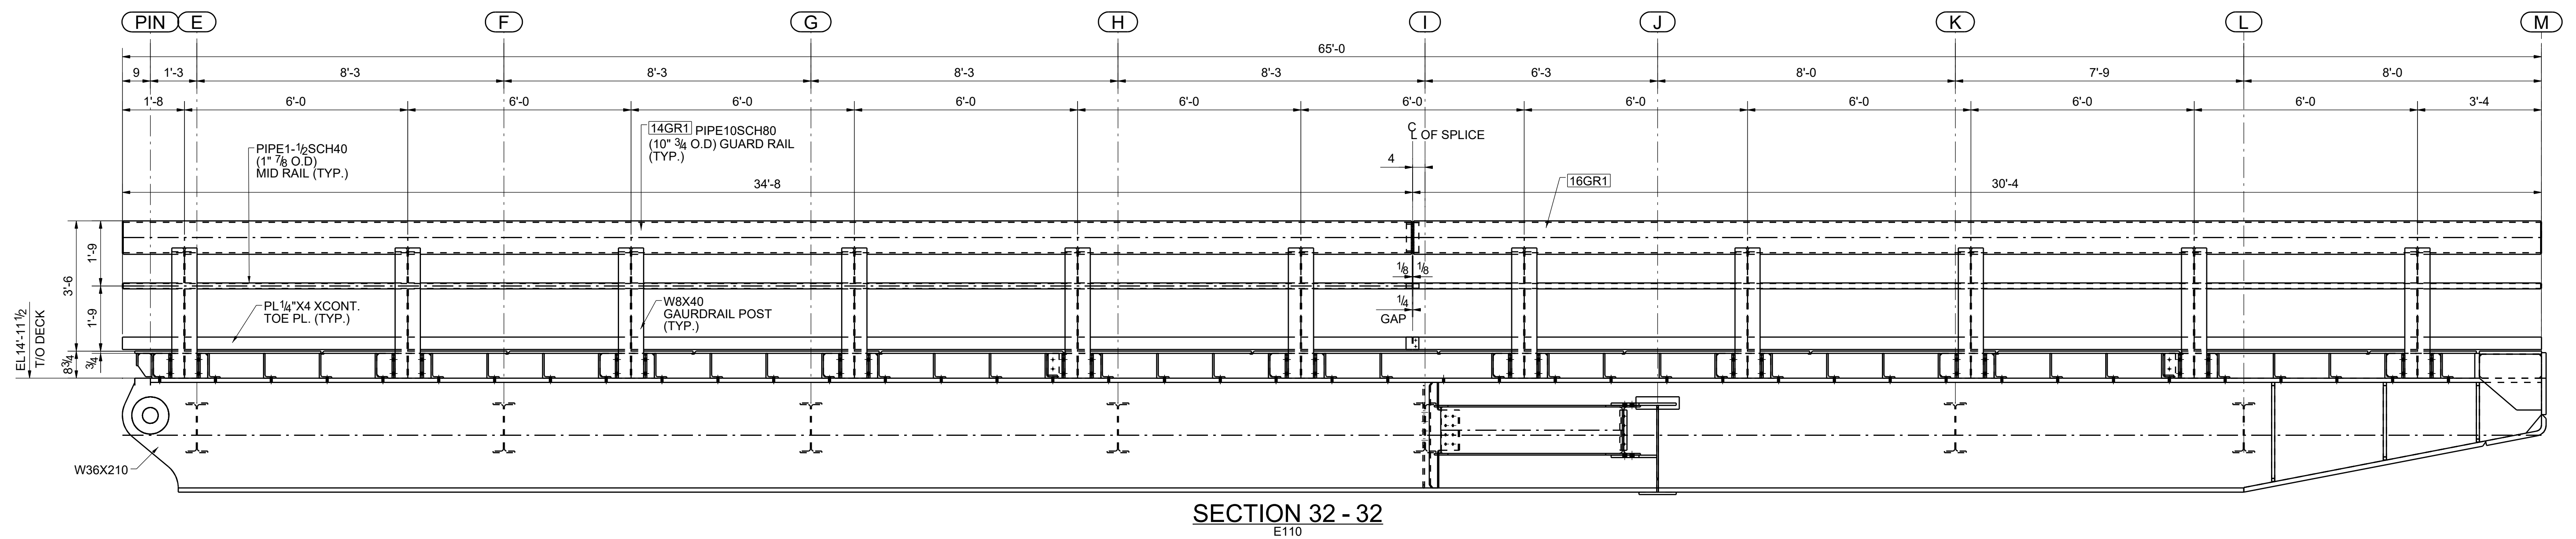


NOTES:-

1. REFER E100 SHEET FOR GENERAL NOTES.
2. REFER E139 & E140 SHEET FOR TYPICAL SECTION & DETAILS.

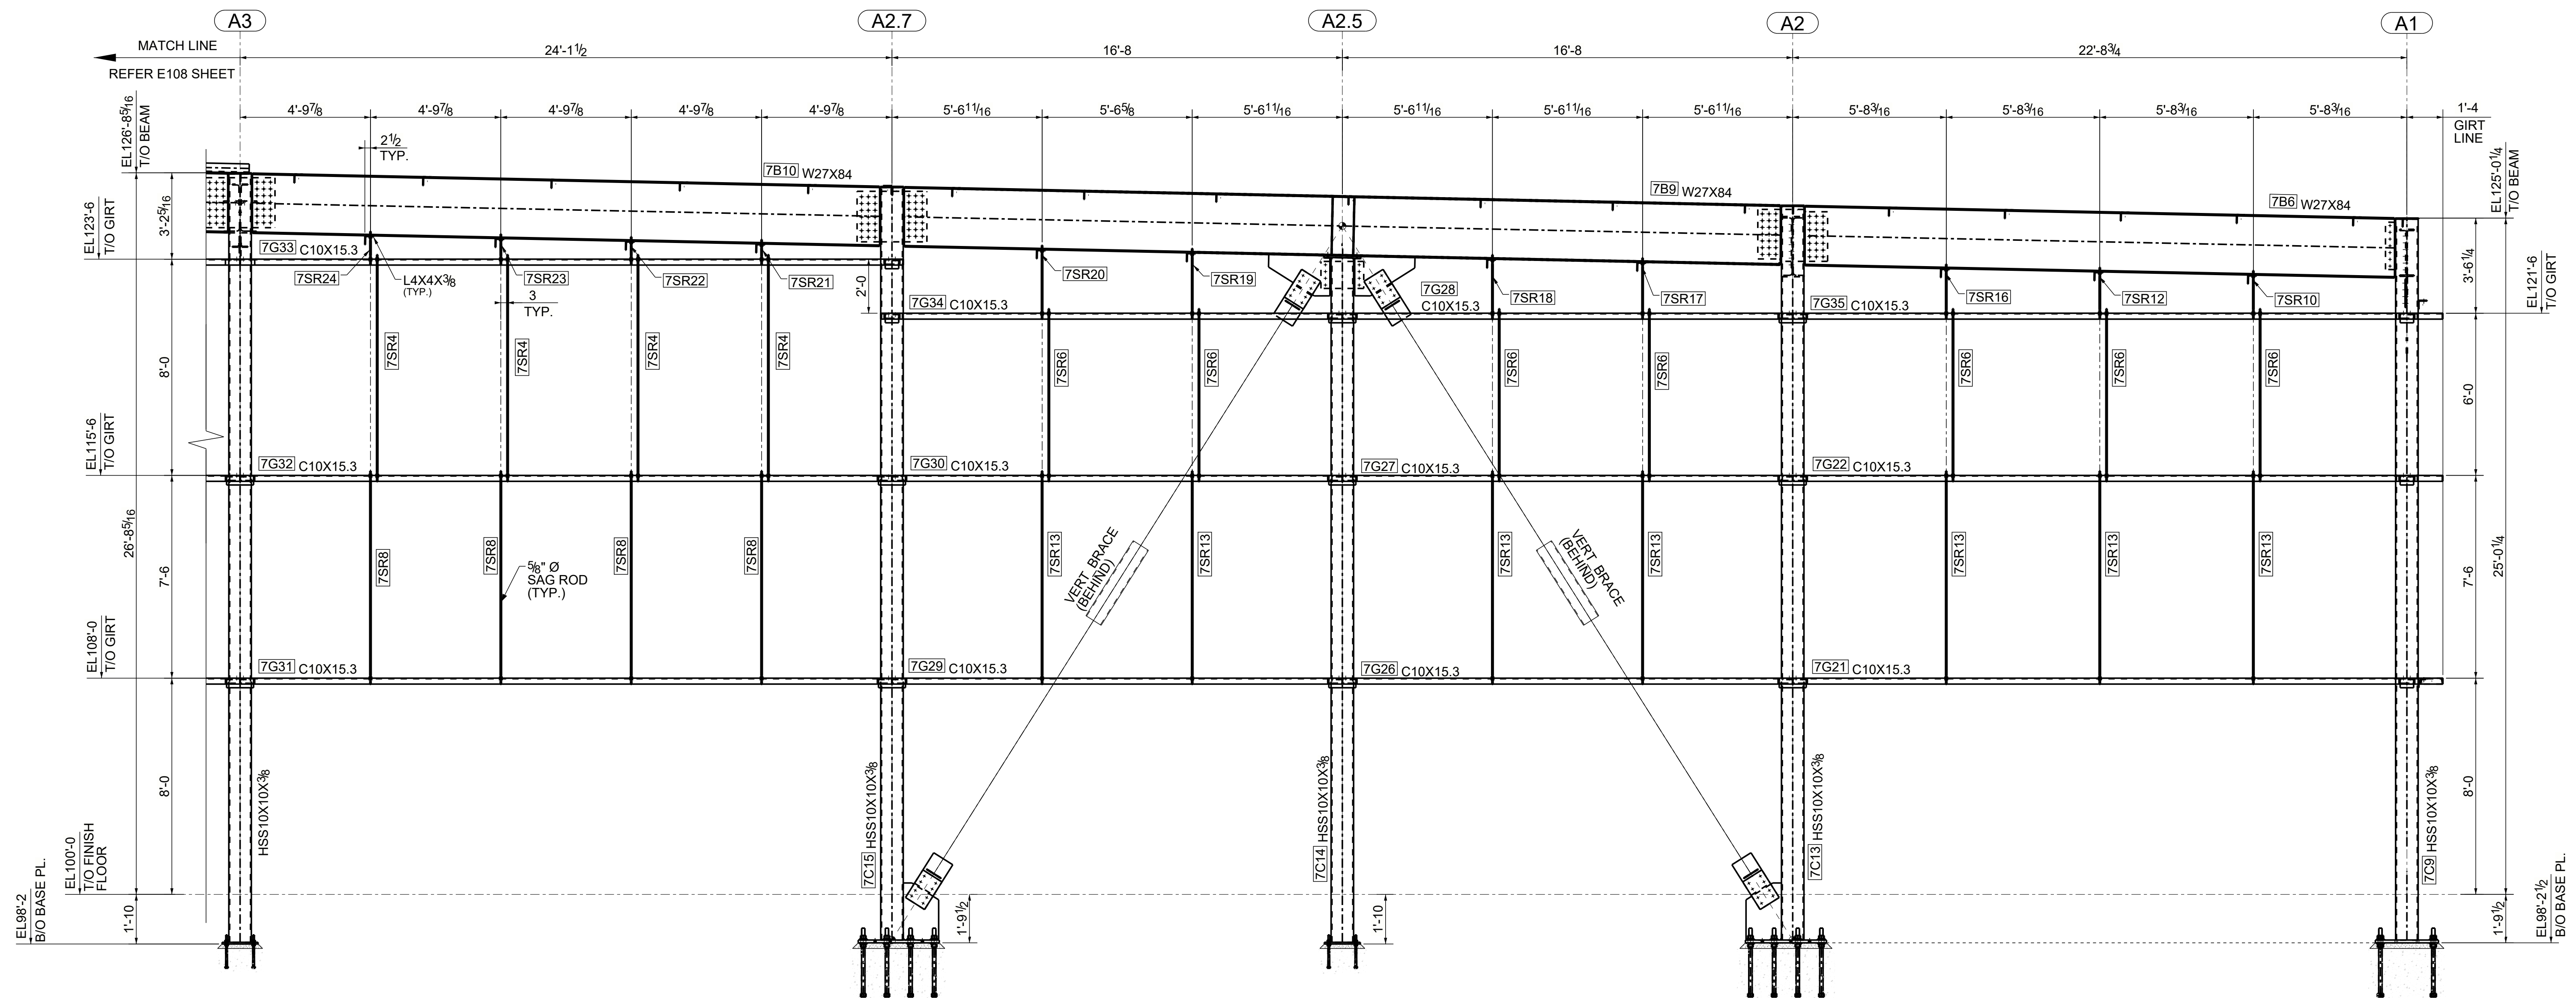

SECTION 3 - 3
E701
PARTIAL GIRT ELEVATION ALONG GRIDLINE - 6.7
(REFER: ELEVATION 1/66-88.S.03.01)


- NOTES:-
1. REFER E100 SHEET FOR GENERAL NOTES.
 2. REFER E708, E709 & E710 SHEET FOR TYPICAL SECTION & DETAILS.

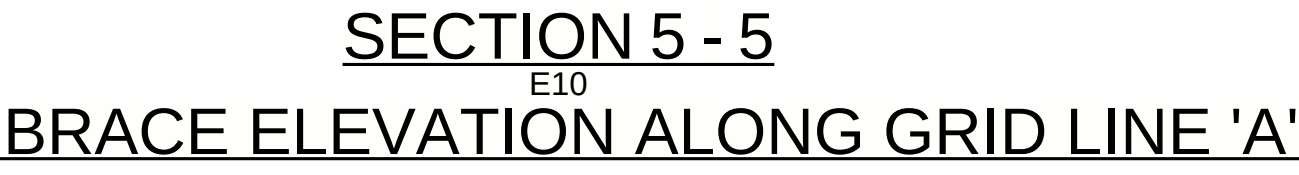


ELECTRODE	<u>E70XX</u>	UNLESS NOTED
HOLES	<u>13/16 Ø</u>	UNLESS NOTED
PAINT	1-S/C RUST INHIBITIVE PAINT U.N.O.	

REVISION

0

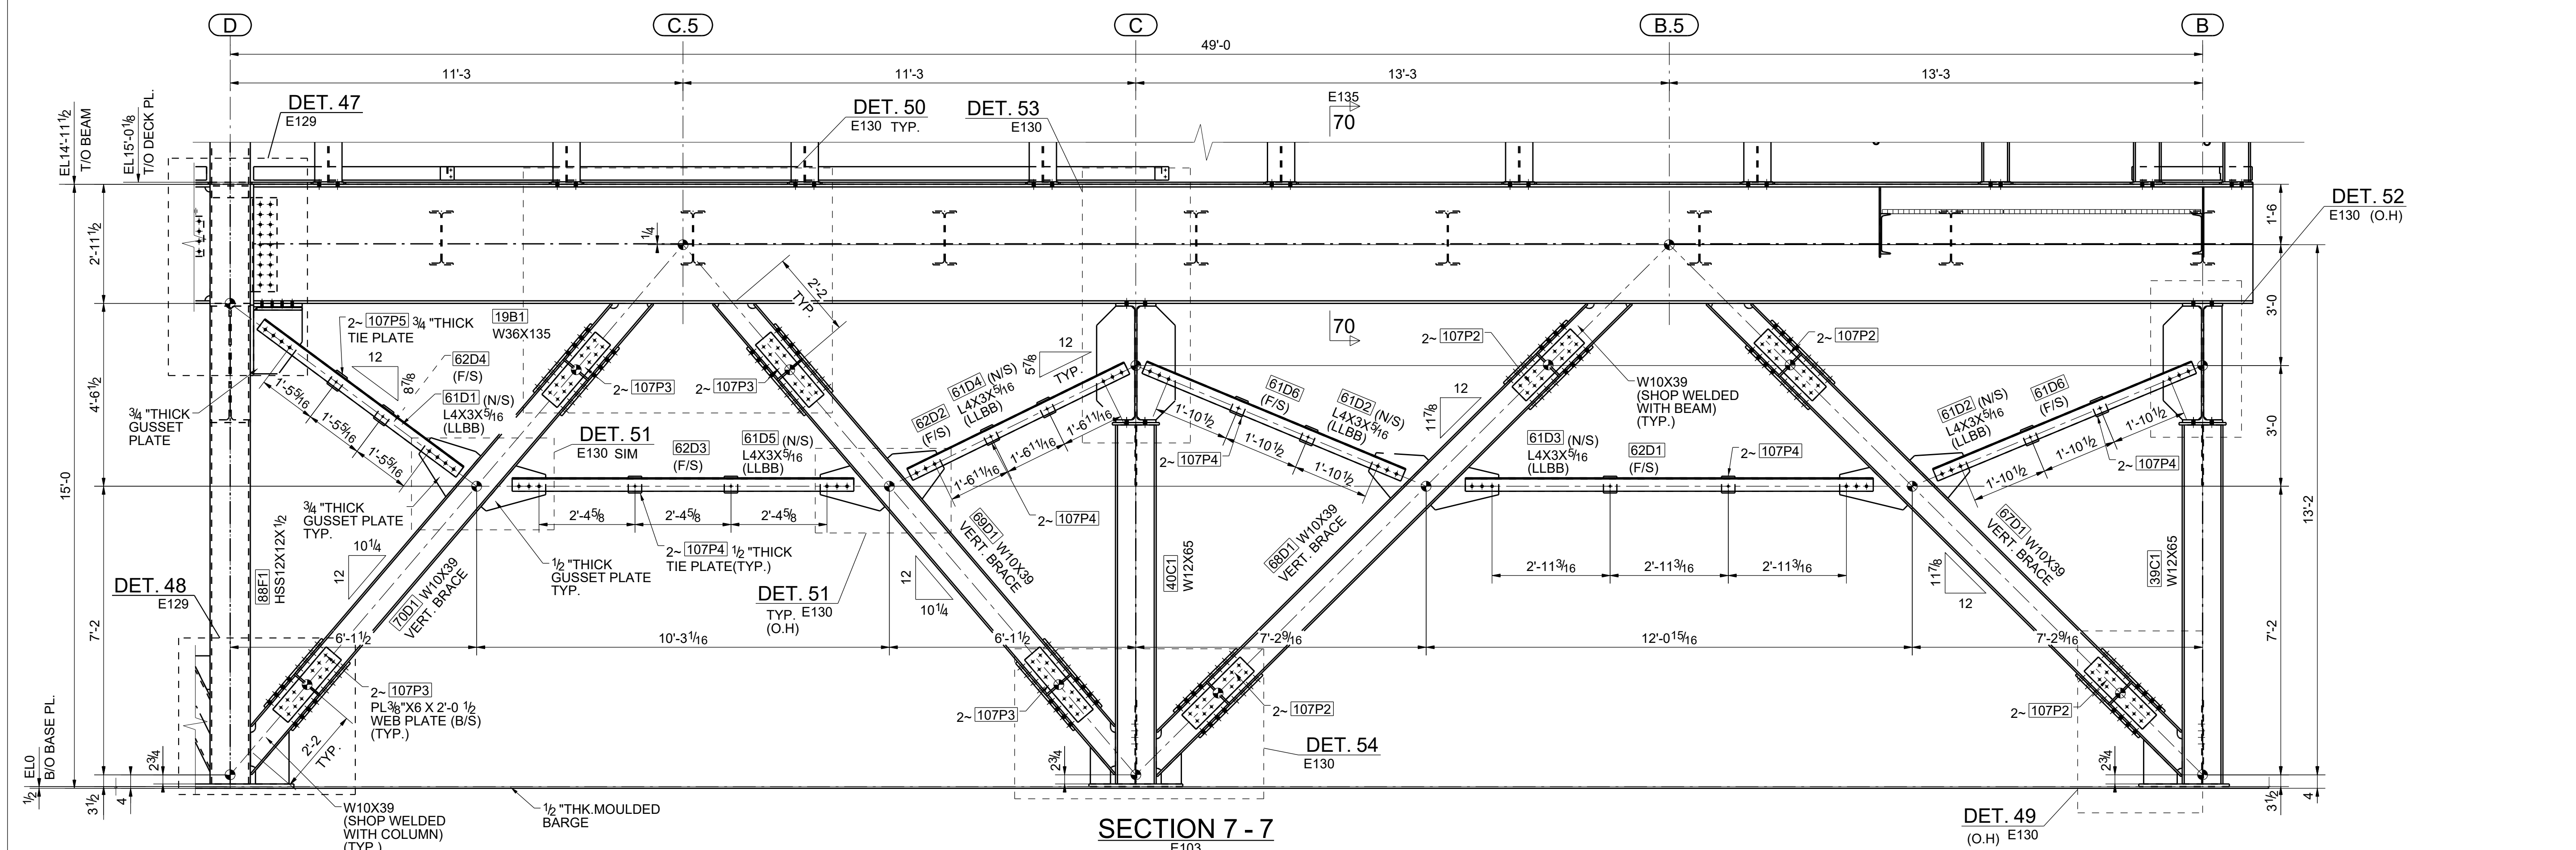


SECTION 7 - 7
TYPICAL BRACE ELEVATION ALONG GRID 2.0
 (REFER : CROSS SECTION OF BRACED FRAME / GANTRY FRAME / S2.07)

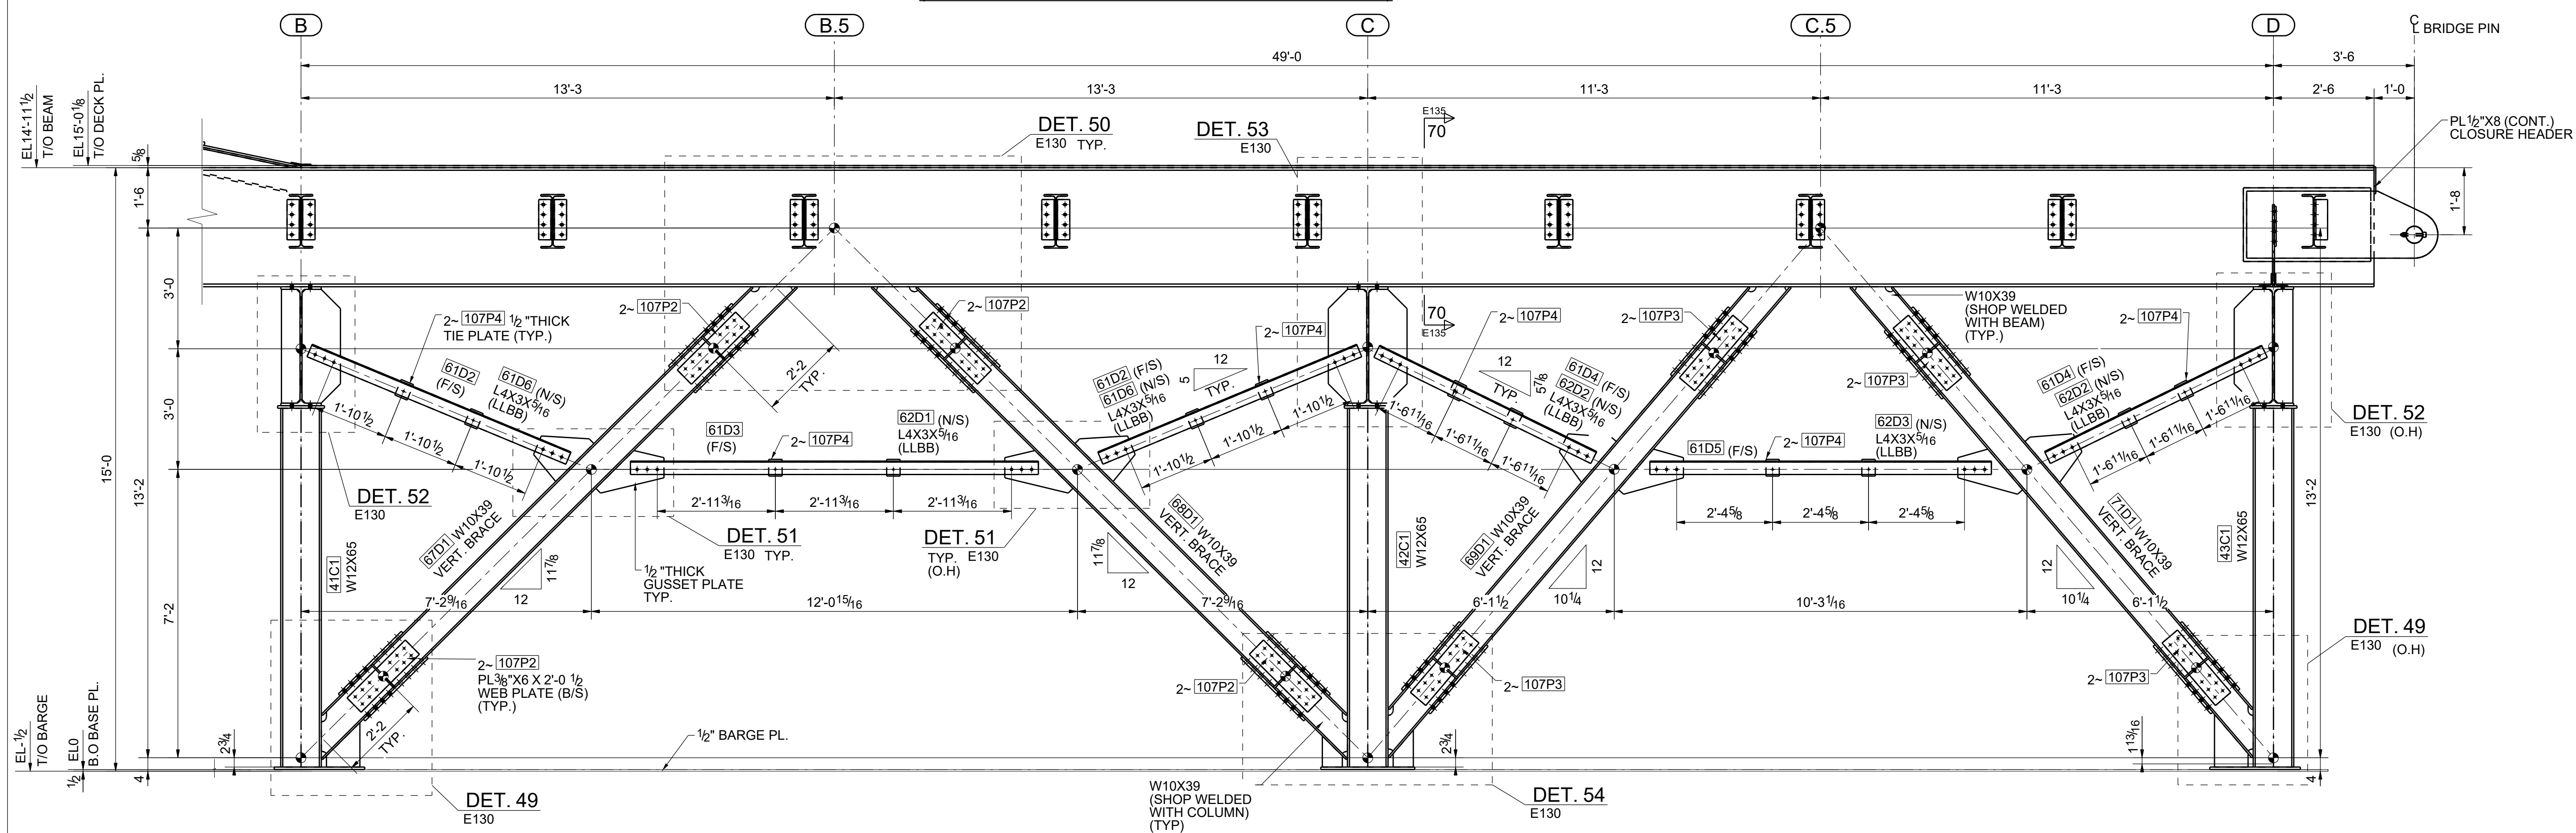

SECTION 8 - 8
TYPICAL BRACE ELEVATION ALONG GRID 3.0
 (REFER : CROSS SECTION OF BRACED FRAME @ GRID 3.0 & 4.0/S2.04)

NOTES:-


1. REFER E100 SHEET FOR GENERAL NOTES.
2. REFER E139 & E140 SHEET FOR TYPICAL SECTION & DETAILS.

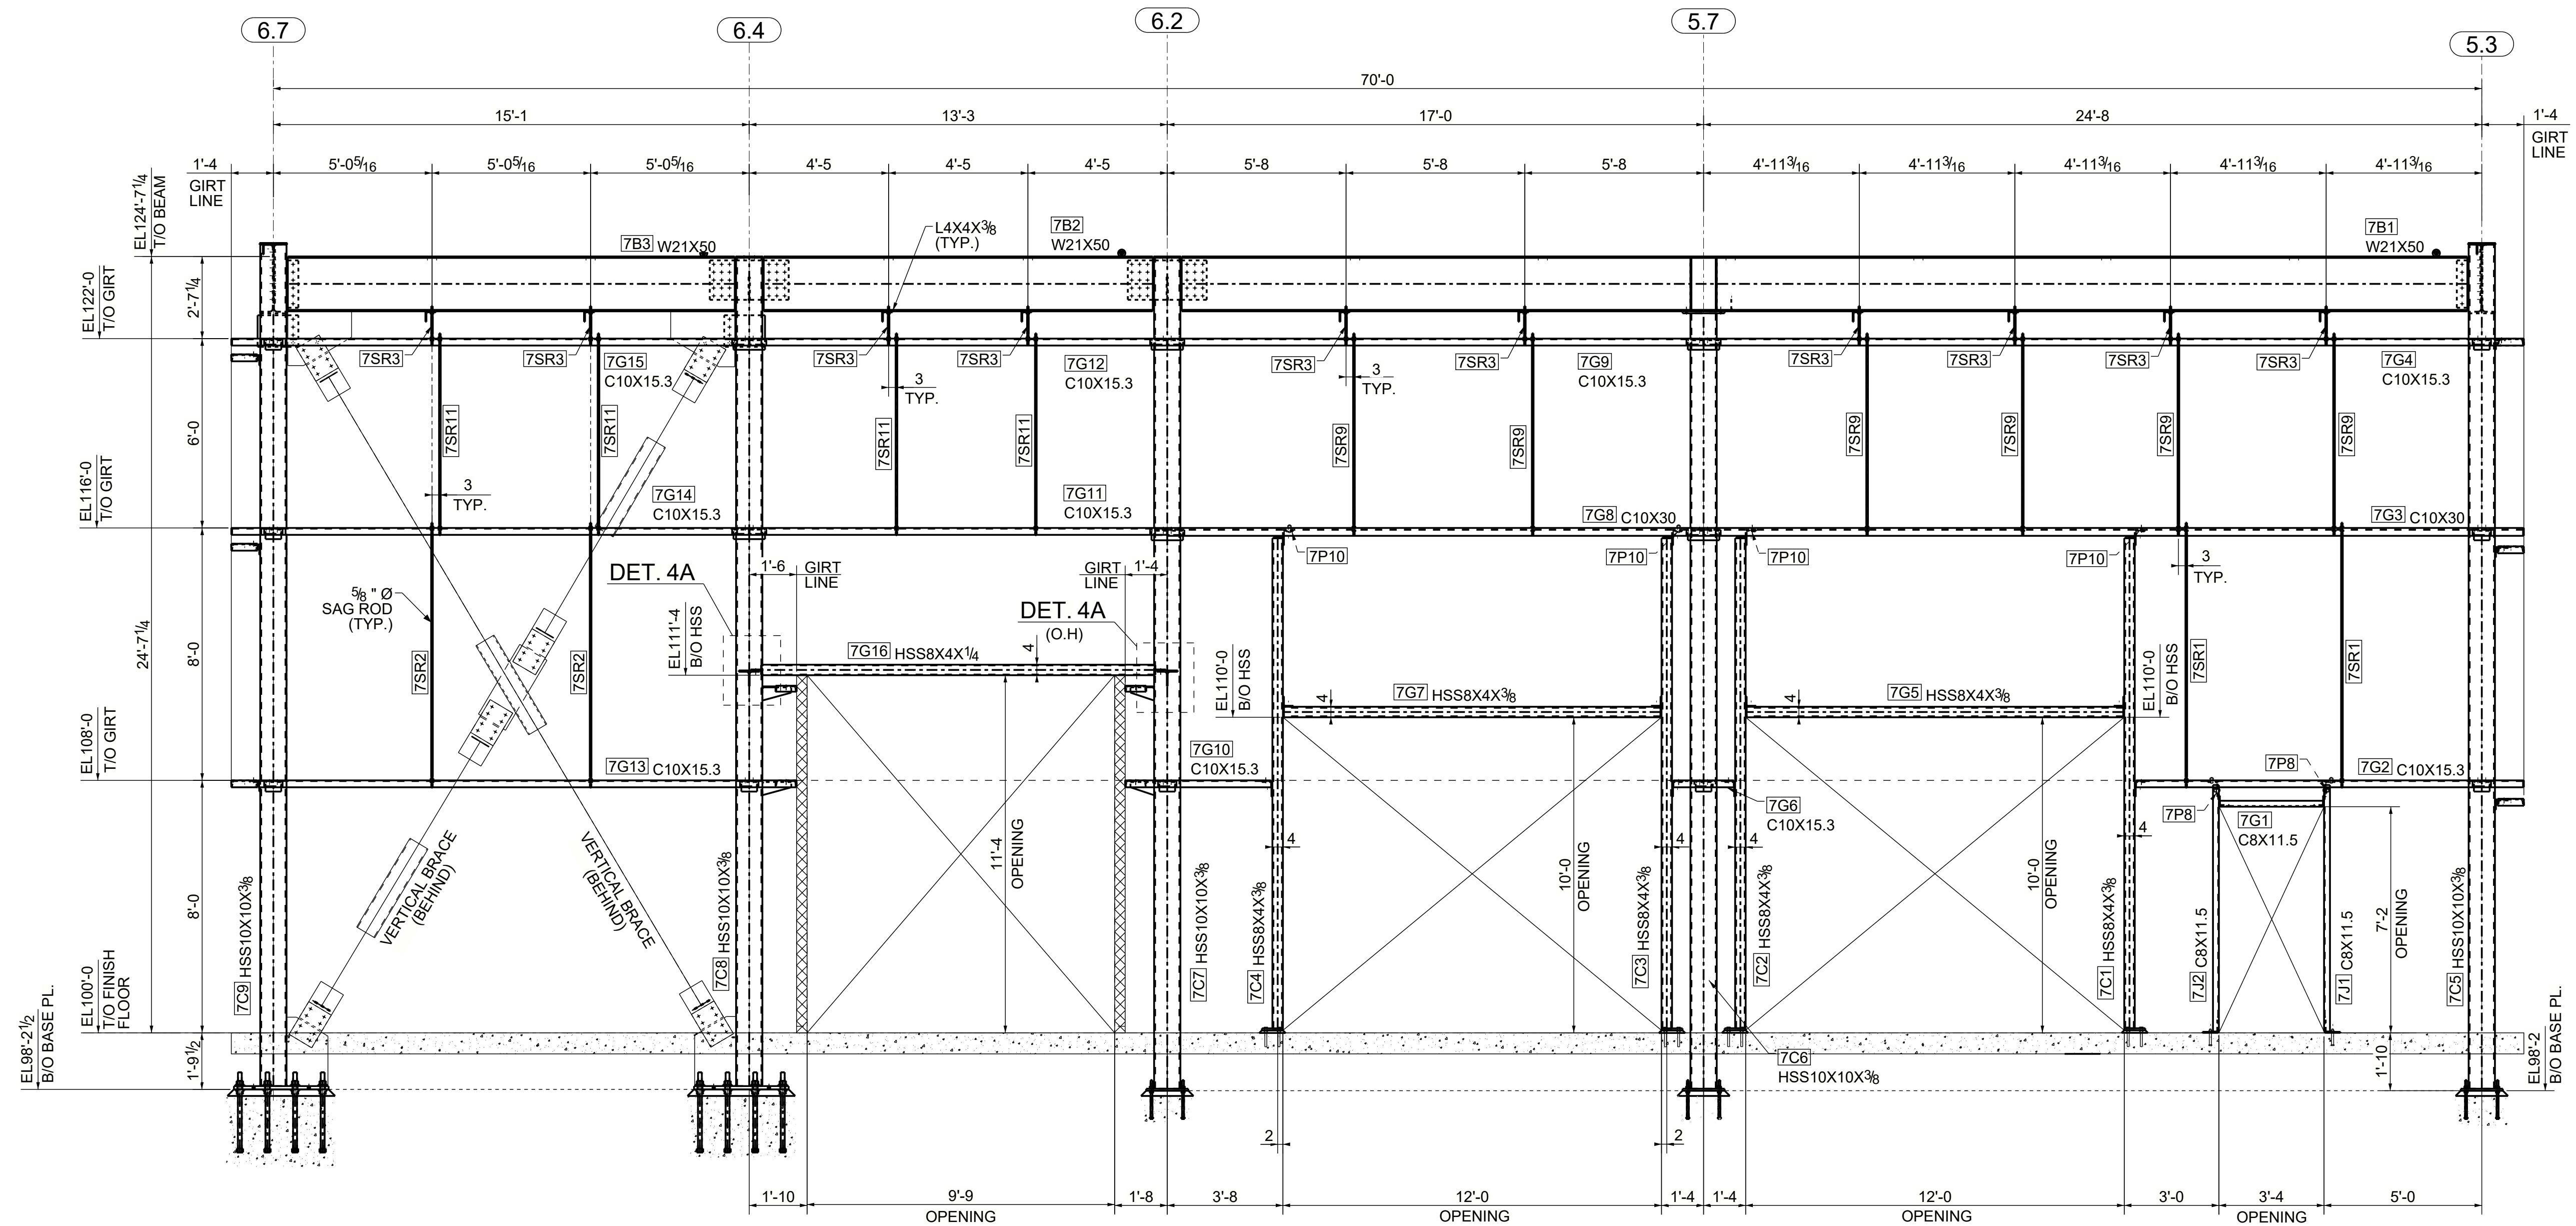


SECTION 4 - 4
E701
GIRT ELEVATION ALONG GRIDLINE - A1
(REFER ELEVATION : 6/66-88.S.03.01.)

NOTES:-



1. REFER E100 SHEET FOR GENERAL NOTES.
2. REFER E708, E709 & E710 SHEET FOR TYPICAL SECTION & DETAILS.

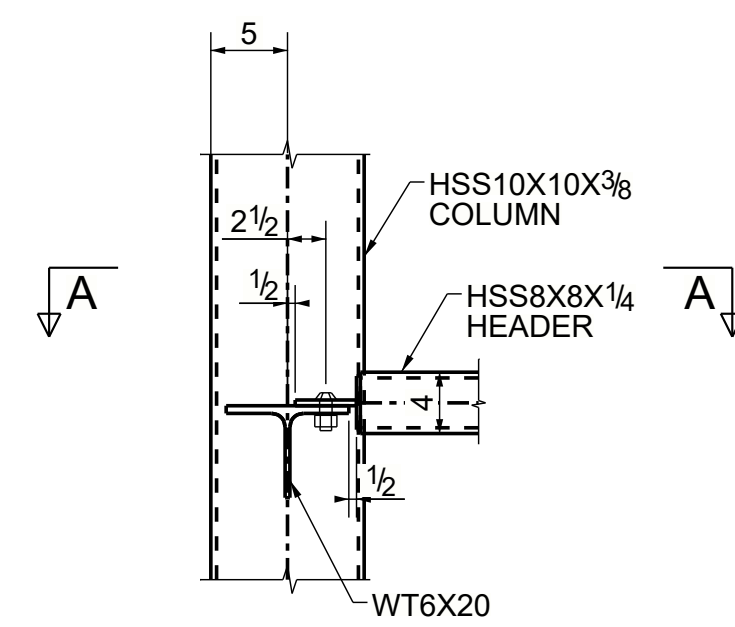

DETAIL 4A

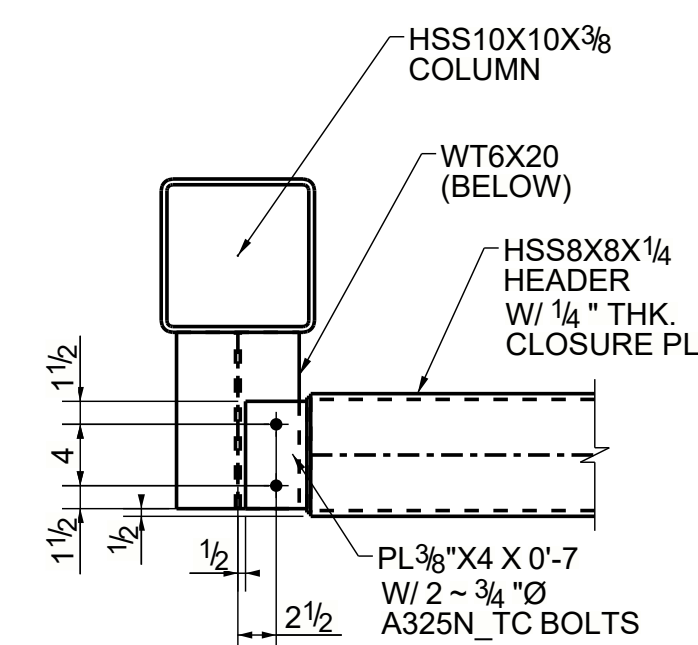

SECTION A - A

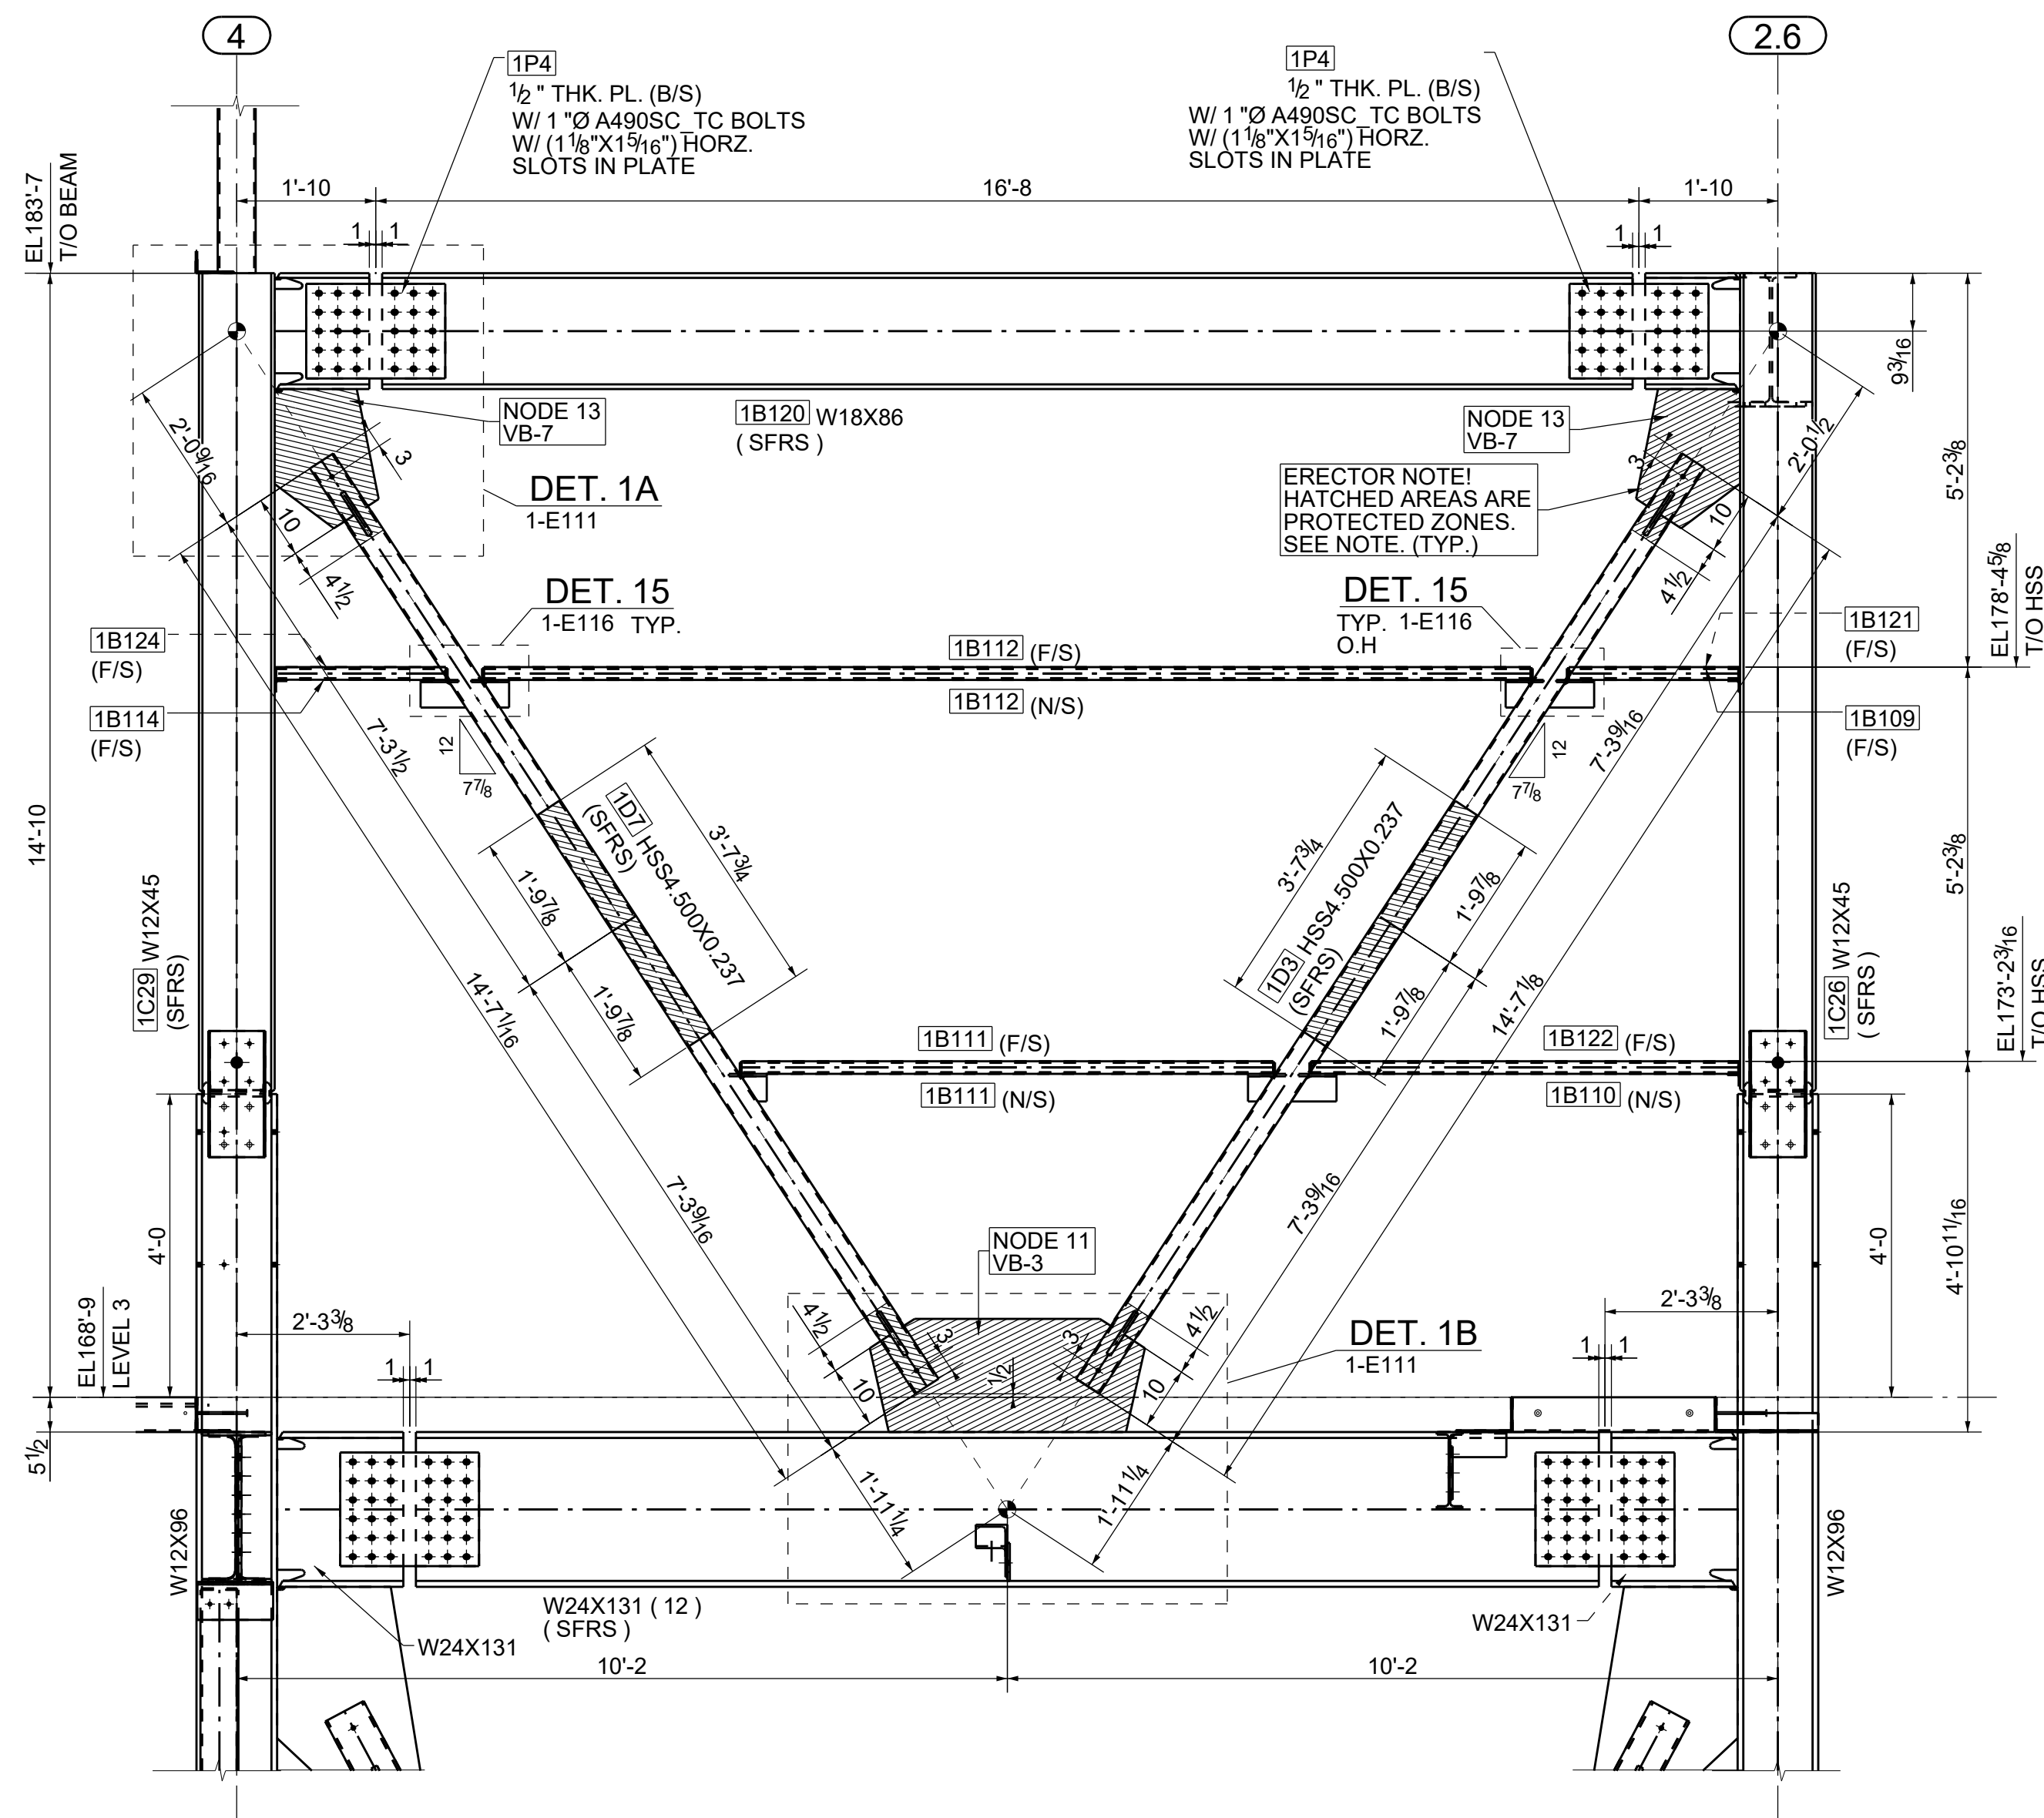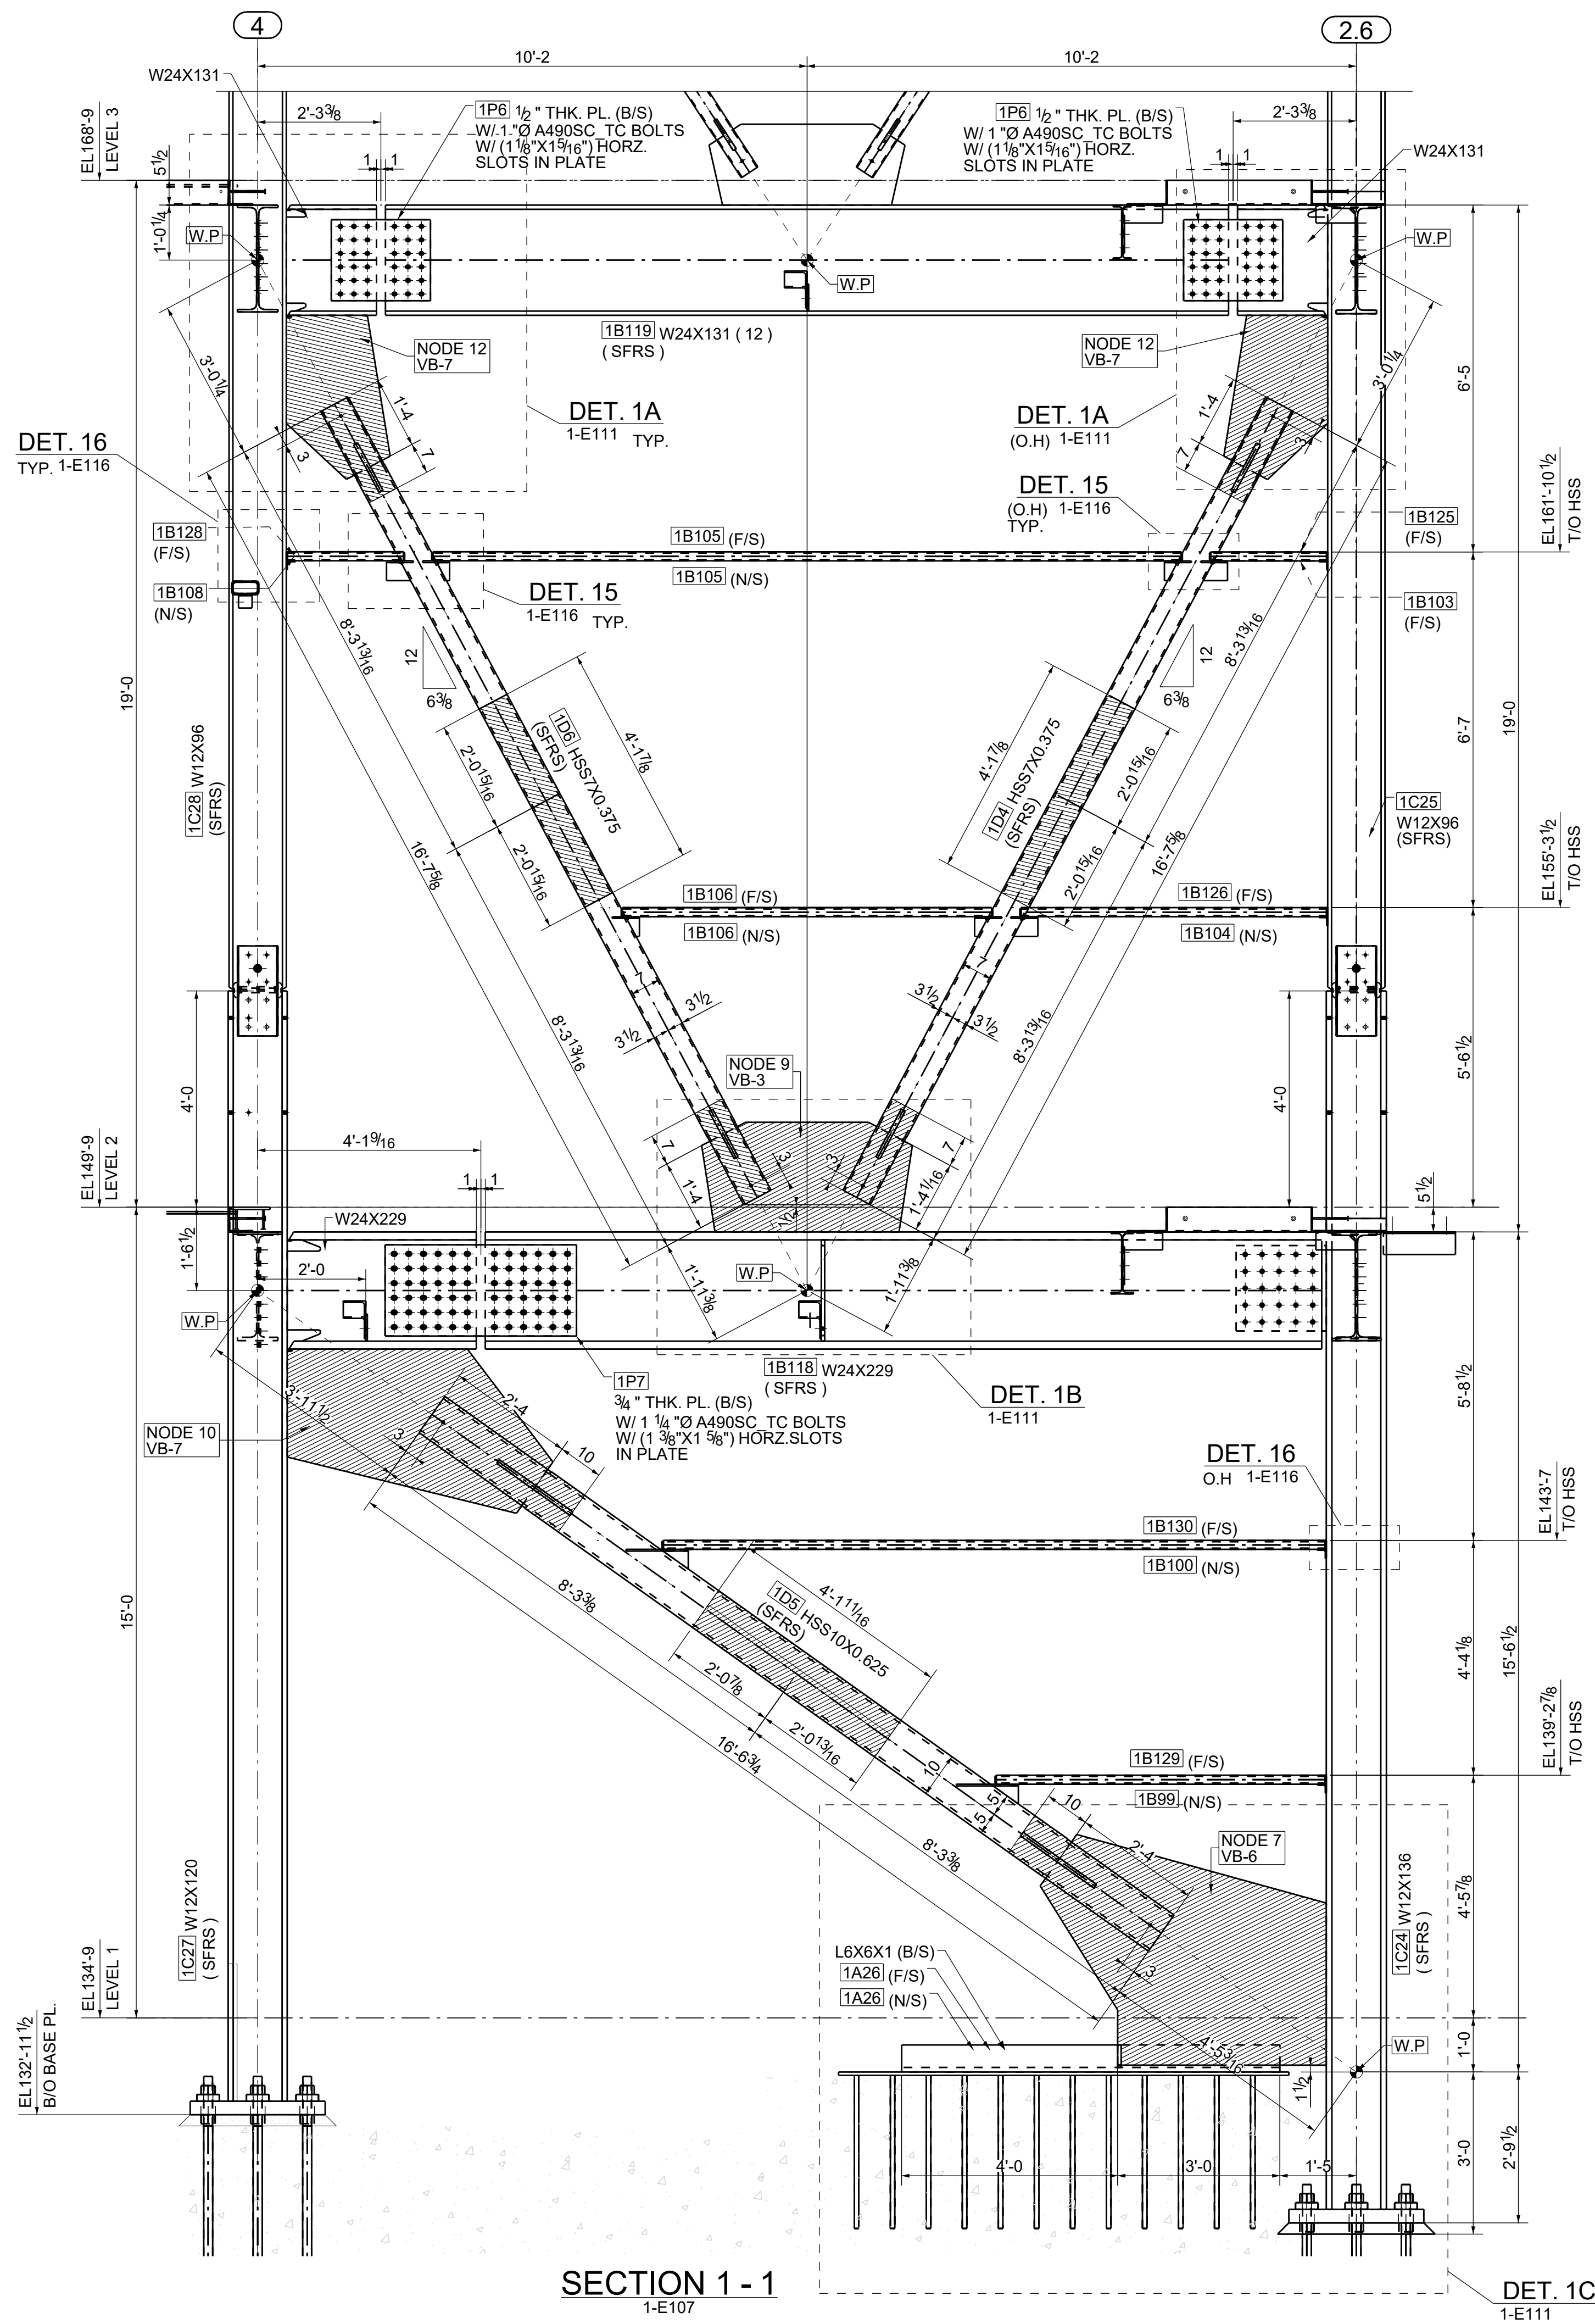

SECTION 1-1

(REFER: BRACE FRAME ELEVATION - GRID C.3 2/ S5.1)

PROTECTED ZONE SHALL BE PAINTED YELLOW

SUMMARY of SFRS Requirements

(REF: S0.1 Section G)

PROTECTED ZONE NOTE: (from Section F4.5C AISC 341)
HATCHED AREAS SHOWN INDICATE SFRS PROTECTED ZONES THAT INCLUDE THE STEEL CORE OF BRACES AND ELEMENTS THAT CONNECT STEEL CORE TO BEAMS AND COLUMNS, AND SHALL SATISFY THE REQUIREMENTS OF SECTION D1.3 (AISC 341)

THE PROTECTED ZONE OF BRACING MEMBERS INCLUDES THE CENTER ONE-QUARTER OF THE BRACE LENGTH, AND A ZONE ADJACENT TO EACH CONNECTION EQUAL TO THE LARGEST DIMENSION OF THE BRACE CROSS SECTION MINIMUM. THE PROTECTED ZONE ALSO INCLUDES GUSSET PLATES AND AREAS WHERE BOLTS, WELDS, ANGLES, ETC. CONNECT THE BRACE TO THE GUSSET PLATE.

WITHIN THE PROTECTED ZONE, DISCONTINUITIES CREATED BY FABRICATION OR ERECTION OPERATIONS, SUCH AS TACK WELDS, ERECTION AIDS, AIR-ARC GOUGING AND THERMAL CUTTING ARE PROHIBITED. ANY REQUIRED HOLES FOR ERECTION BOLTS SHALL BE DRILLED OR PUNCHED. ALSO, THESE HOLES MUST BE CHECKED FOR MINIMUM EDGE DISTANCE, SHEAR AND TENSION RUPTURE, BLOCK SHEAR RUPTURE, BEARING, AND OTHER STRUCTURAL LIMIT STATES.

WELDED, BOLTED, SCREWED OR SHOT-IN ATTACHMENTS OR OTHER ATTACHMENTS ARE PROHIBITED WITHIN THE PROTECTED ZONE.


DEMAND CRITICAL WELD NOTE:

DEMAND CRITICAL WELDS (WHERE NOTED) REQUIRE SPECIAL CONSIDERATIONS AS DEFINED IN SPECIFICATIONS (REF: pg. 05 12 00-1) (SEE PART 1- SECTION 1.04A NOTE 1-BELOW)

1.04 REFERENCES

A. Definitions:

1. Demand Critical Welds (DCW): Demand Critical Welds are identified in the provisions for each type of Seismic Force Resisting System (SFRS). Demand Critical Welds have special quality and inspection requirements and are subject to special Charpy V-Notch (CVN) toughness and testing requirements to ensure that this notch toughness will be provided.

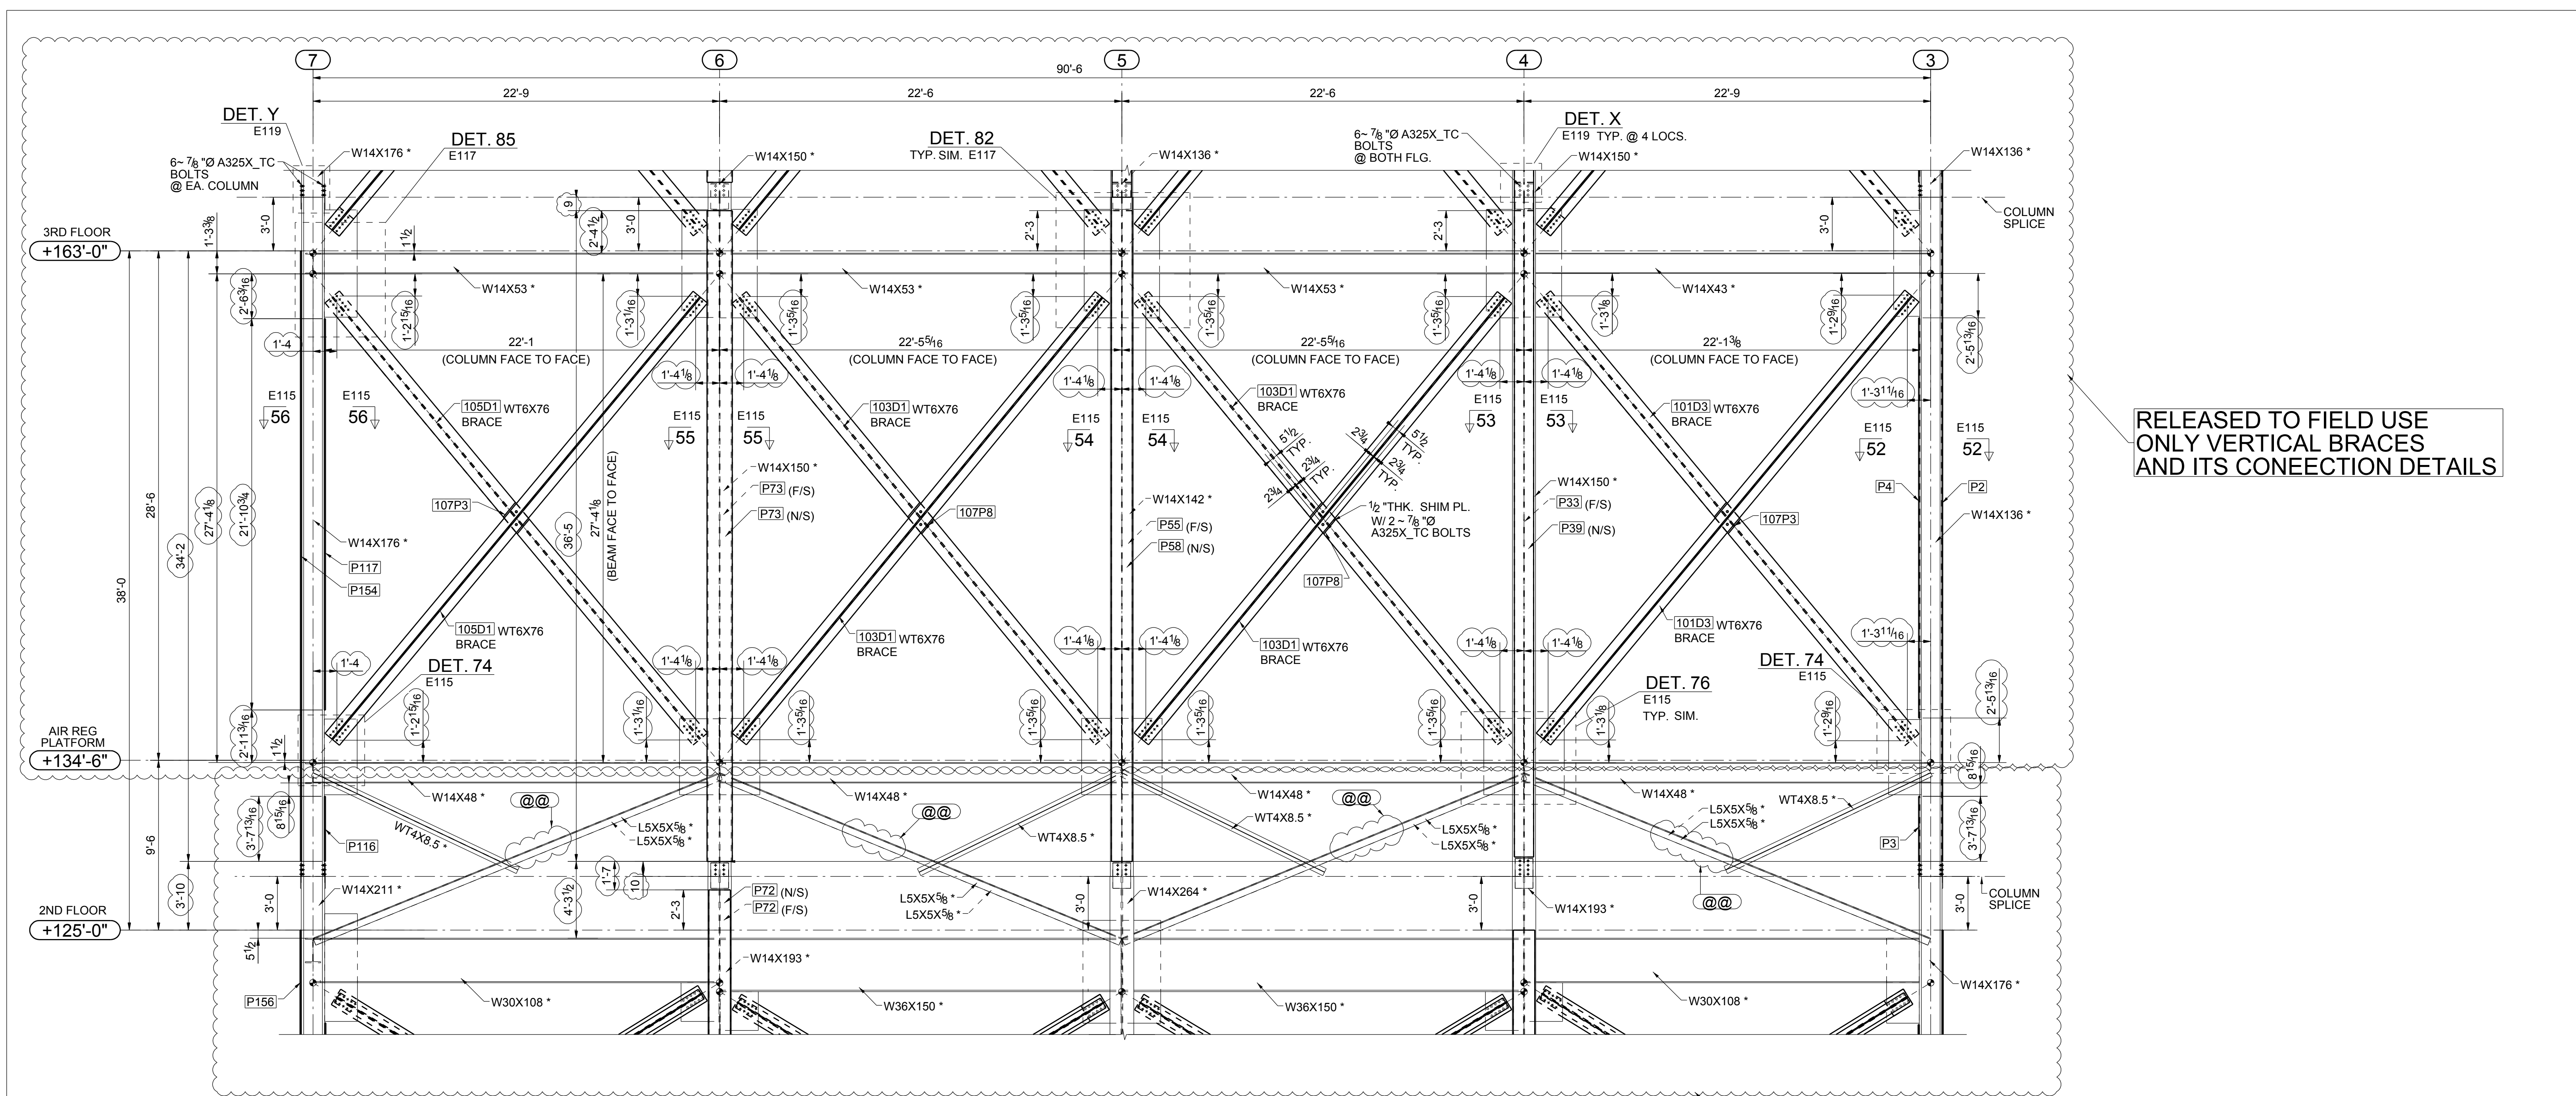

RELEASED TO FIELD USE
ONLY VERTICAL BRACES
AND ITS CONECTION DETAILS

ELEVATION @ ALONG COLUMN LINE "A"
(REFER: ELEVATION @ COL LINE "A" / C-18-1063-1)

THIS AREA IS COMPLETED

ALL DIAGONAL DIMENSION ARE SHOWN
FOR REINFORCEMENT PLATE OR ANGLE.
PLEASE VERIFY & CONFIRM THE SAME.

@@ -- APPROVER FIELD VERIFY MIN OF 3 INTERMEDIATE
CONNECTORS IN (E)2L5X5X EA. SIDE OF (E) WT4.
PLEASE FIELD FURNISH, IF ADDITIONAL NO. OF
CONNECTORS REQUIRED.





APPROVER VERIFY & CONFIRM
ALL COLUMN SPLICE CONNECTION
DETAIL NEED TO BE REVISED AS PER
DETAIL Y/E119 TYPICAL IN THIS
ELEVATION VIEW U.N.O.

APPROVER VERIFY / FURNISH
ALL CLOUDED INFORMATIONS
TYPICAL


APPROVER VERIFY & CONFIRM ALL SHOWN
BRACE WORK POINT LOCATIONS/DIMENSIONS
TYPICAL.

ALL CLOUDED INFORMATIONS ARE
FIELD VERIFY TYPICAL

APPROVER FIELD VERIFY & CONFIRM
NUMBER OF BOLTS SHOWN AT EACH
NEW BRACE LOCATIONS TYPICAL

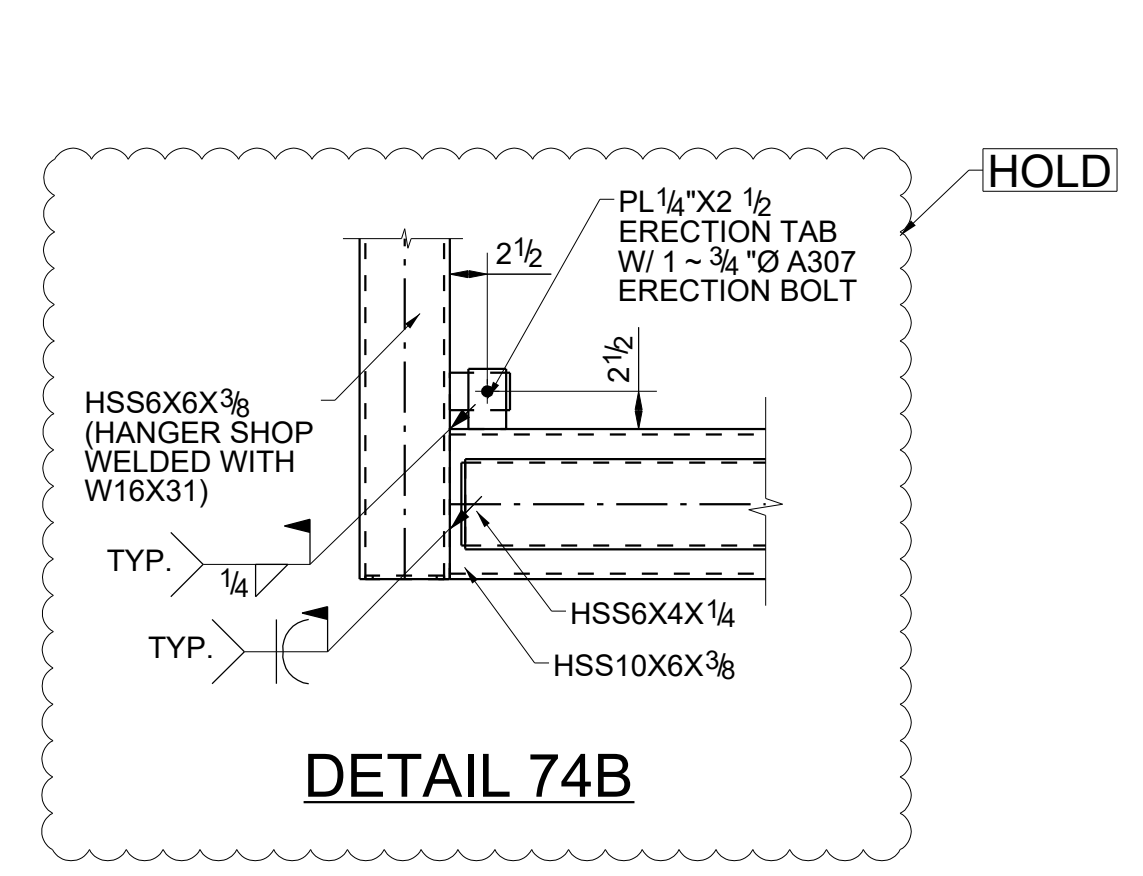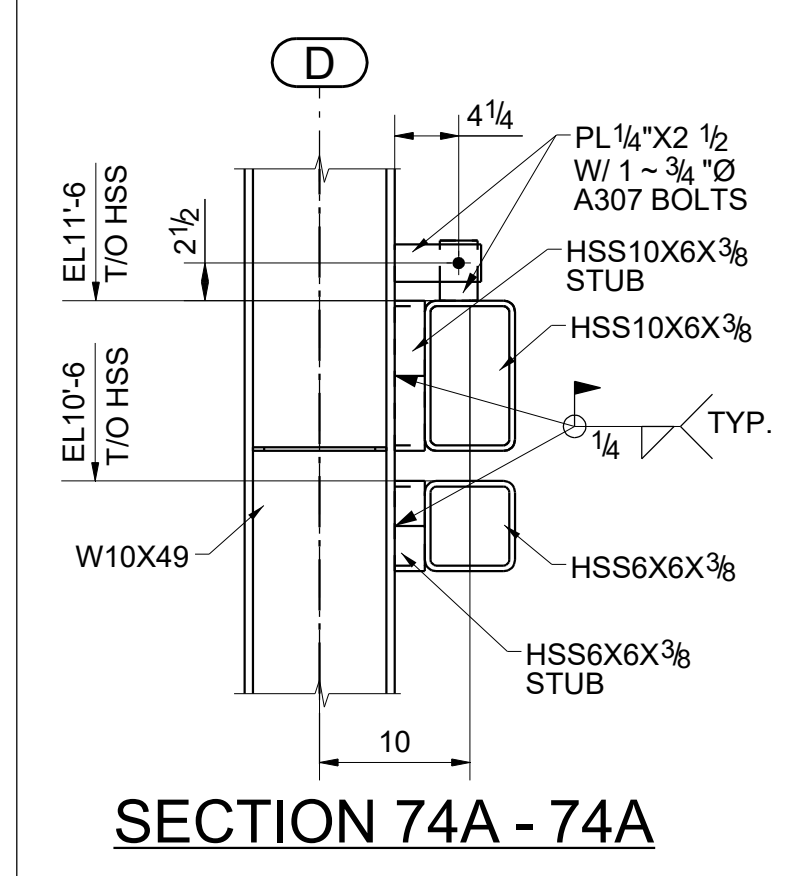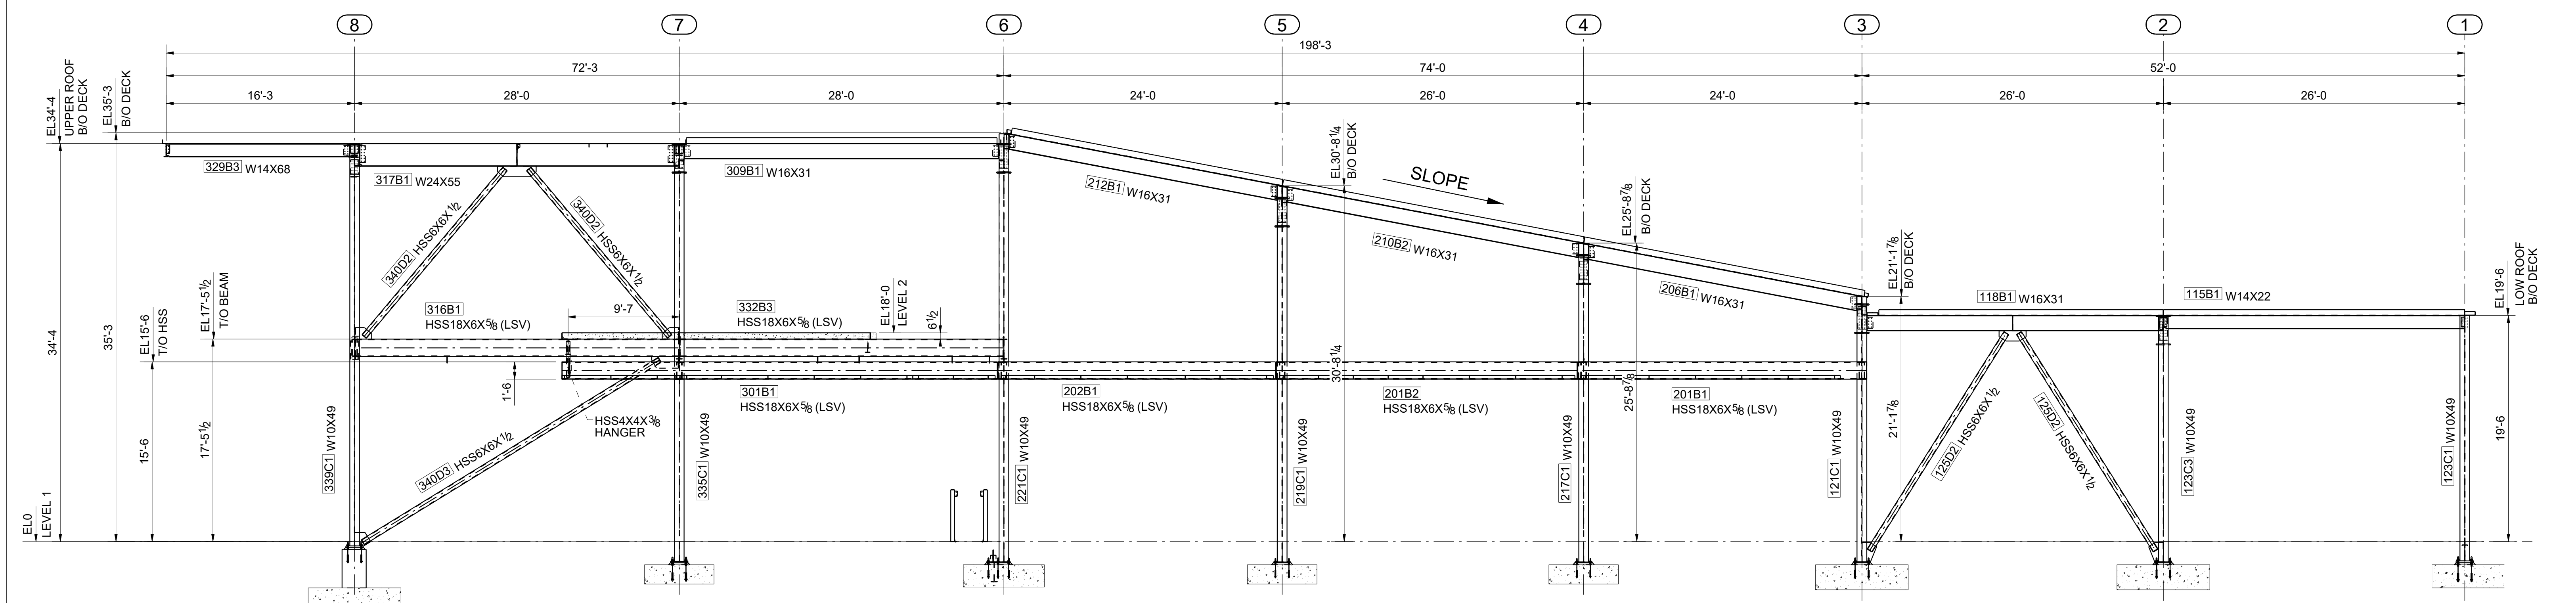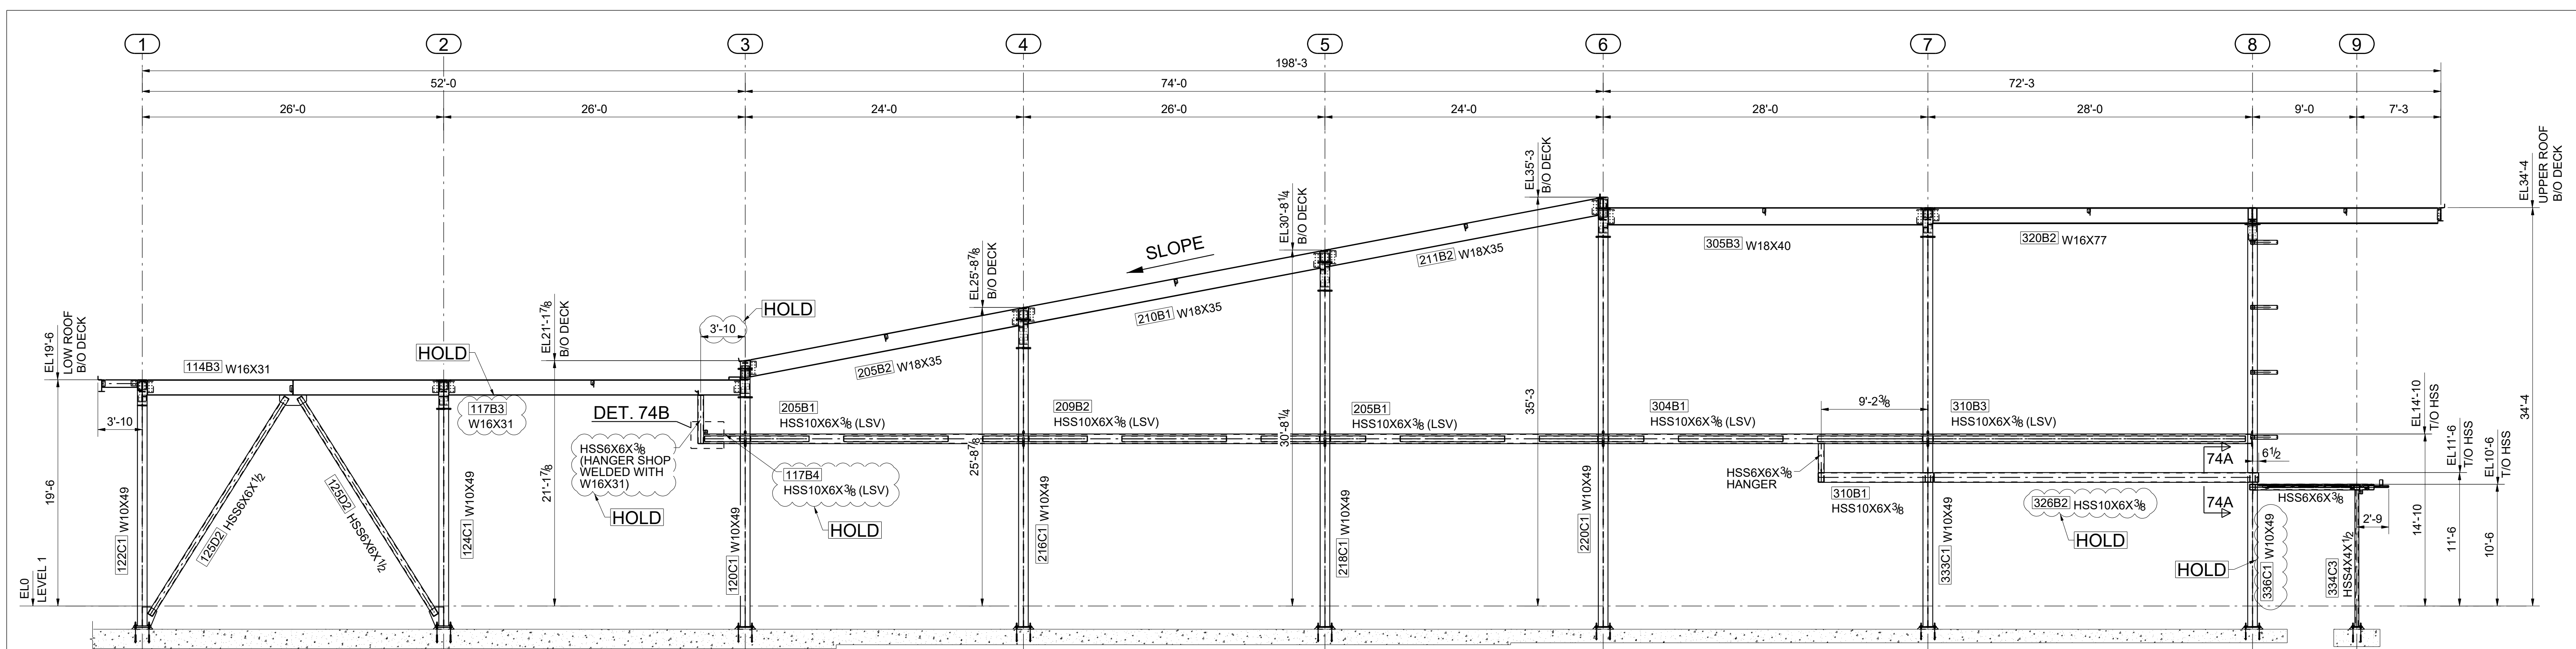


ERECTOR NOTE:
REMOVE ERECTION TAB AFTER
FIELD WELD AS REQUIRED

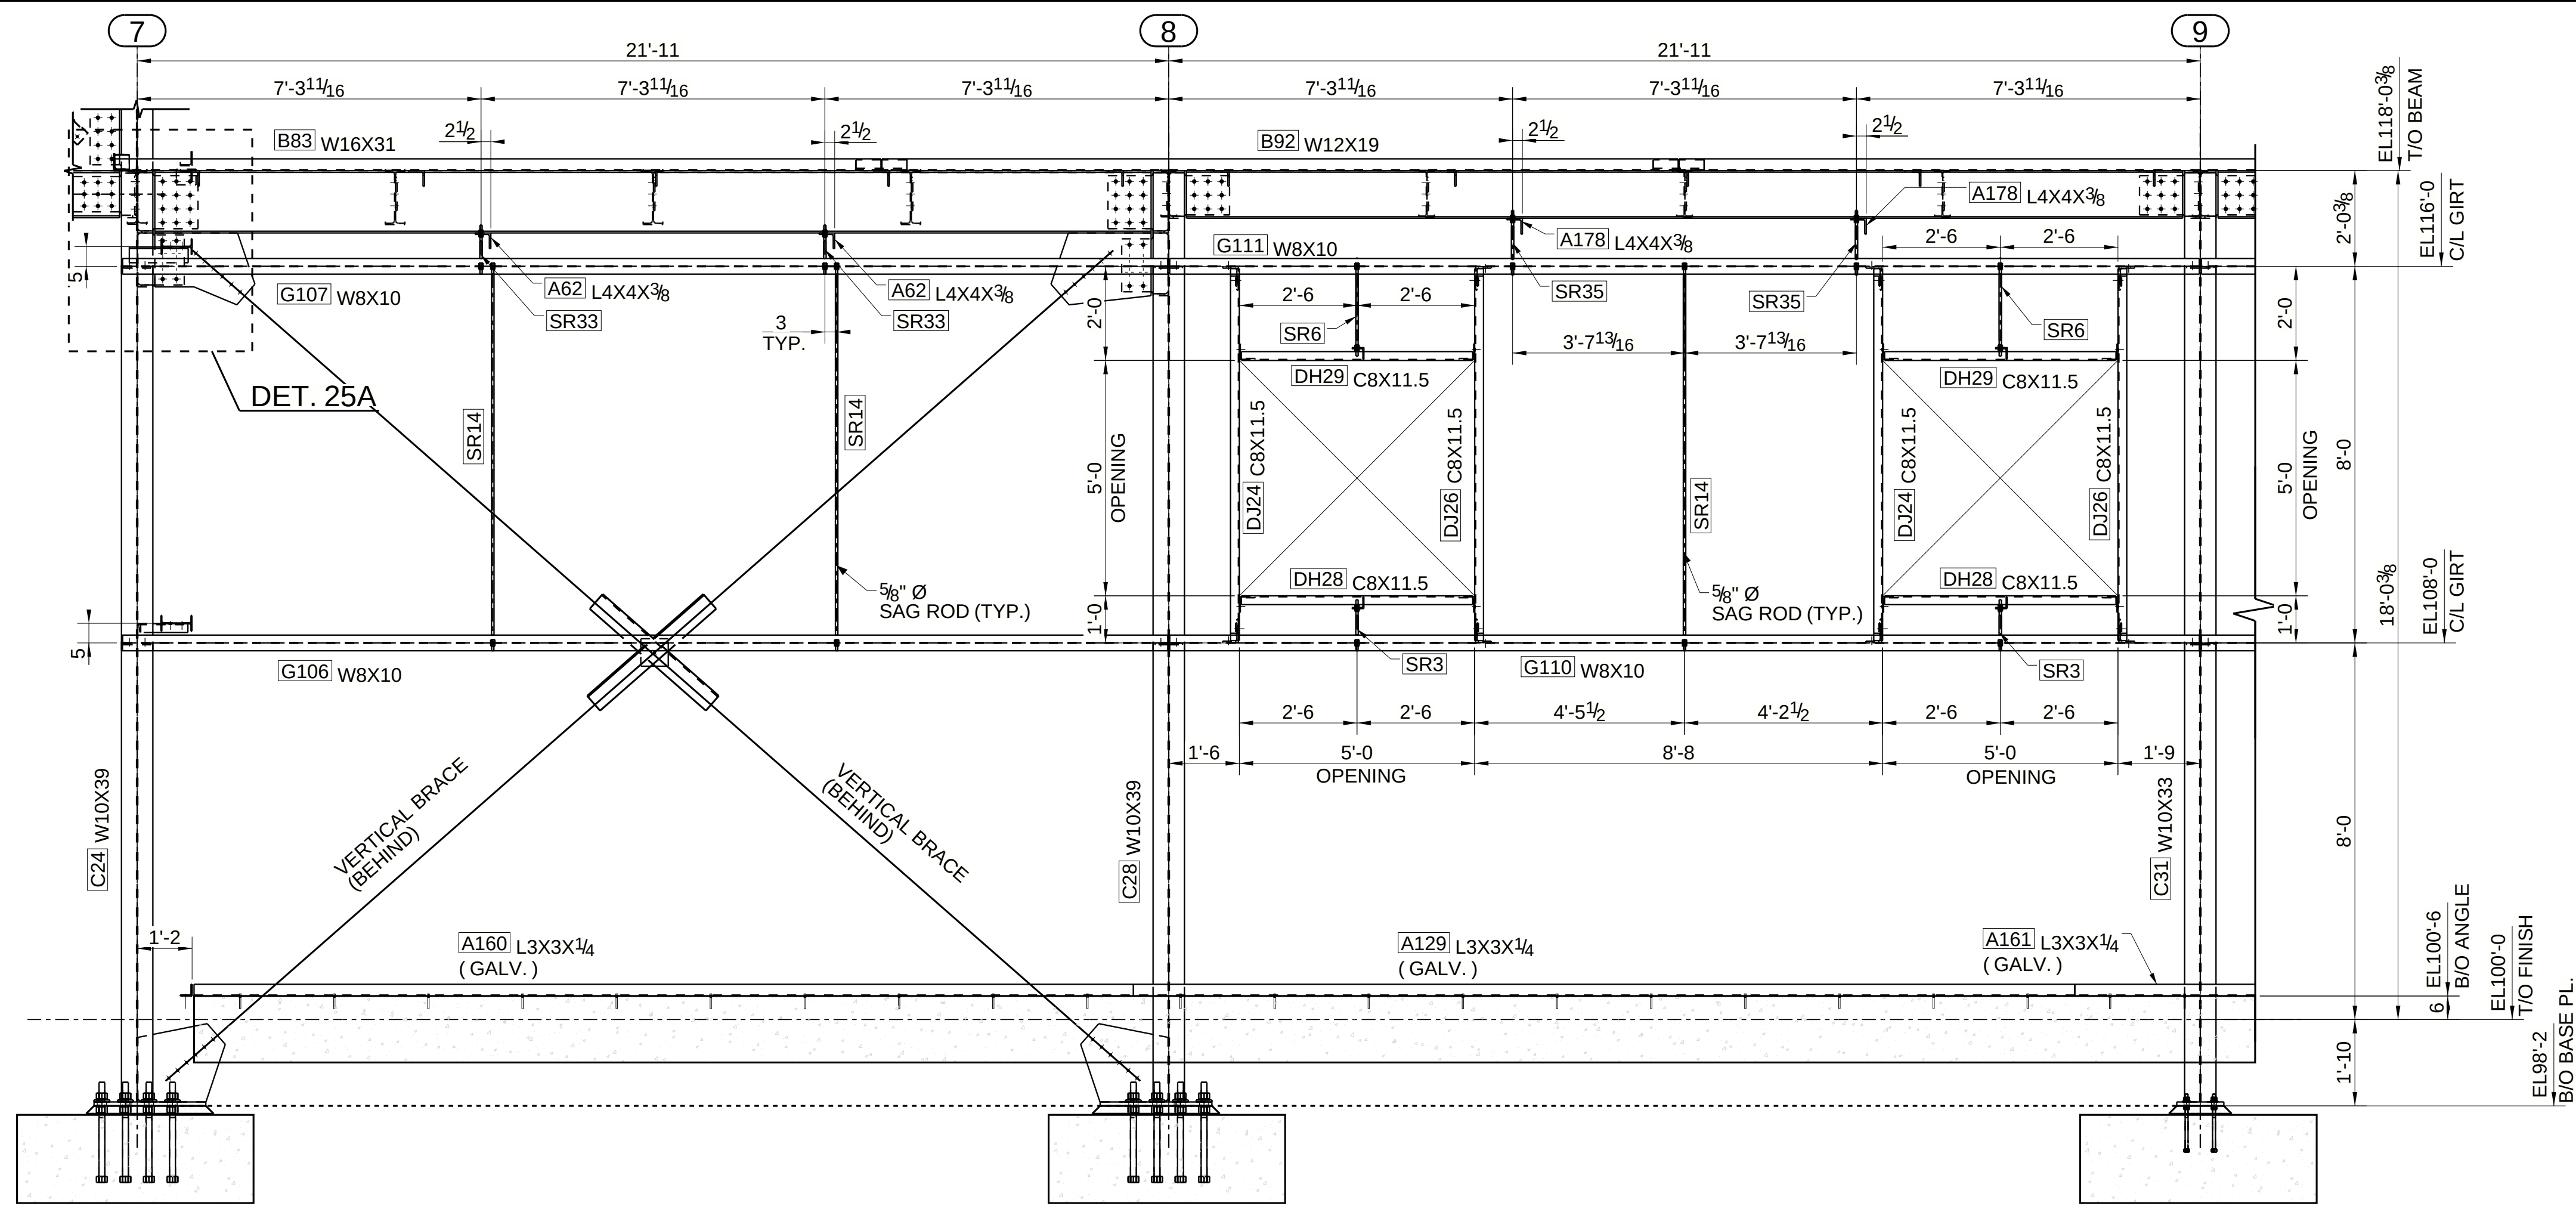

SECTION 25 - 25

E104

(REFER : FRAMING ELEVATION (GRID E) / 030.A2.94.S.02.02)

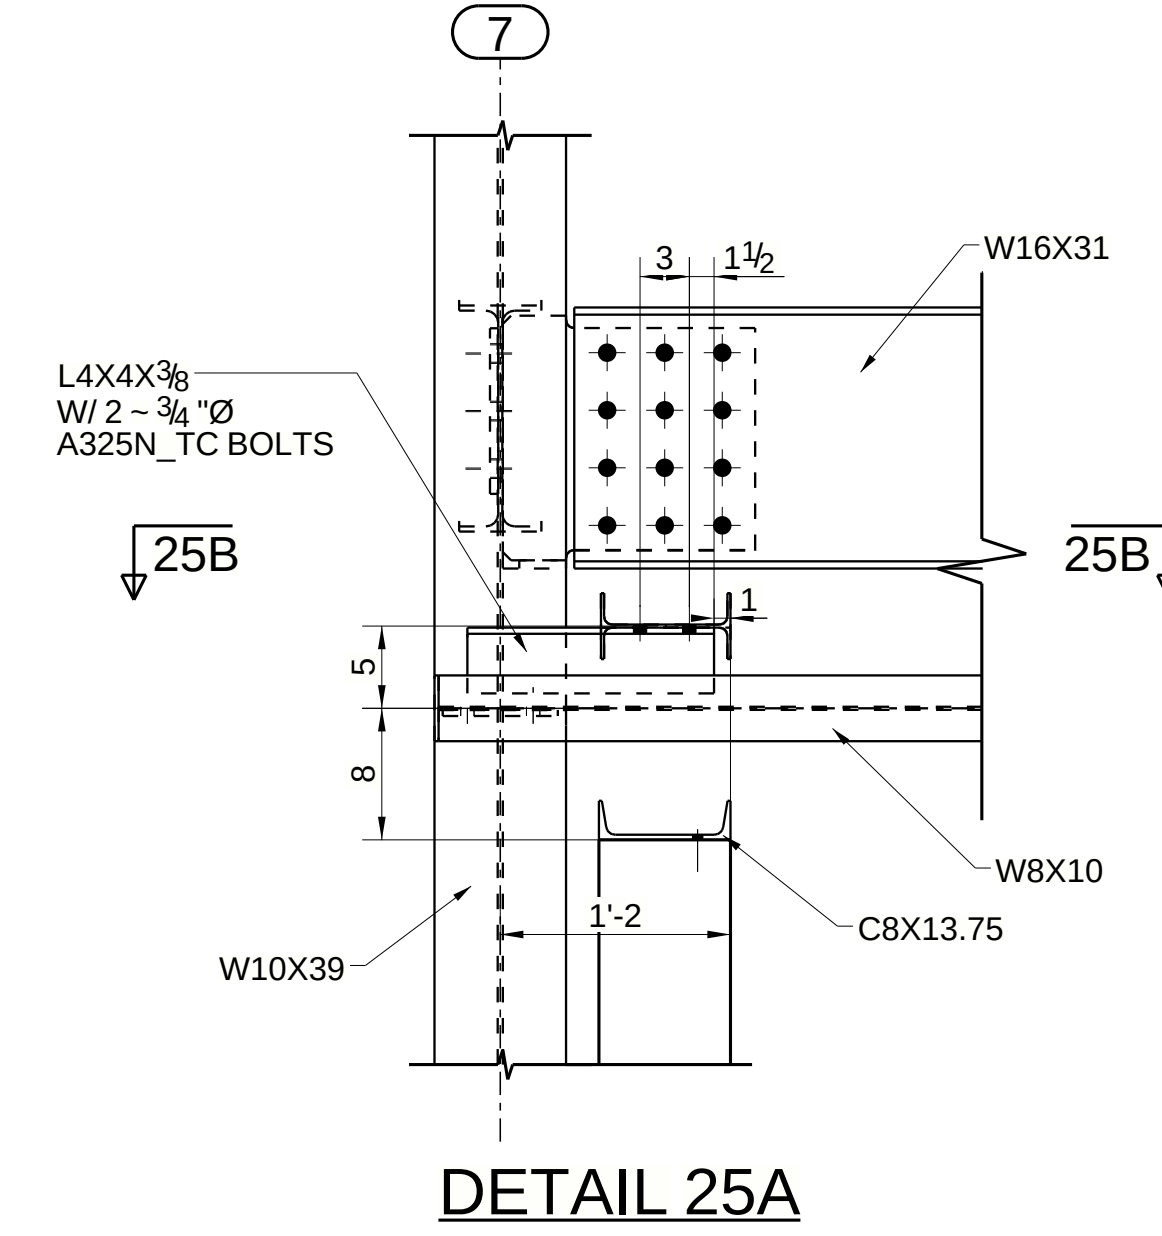


DETAIL 25A

SECTION 25B - 25B

NOTES:-

1. REFER E100 SHEET FOR GENERAL NOTES
2. REFER E128 FOR TYPICAL SECTION & DETAILS
3. (XXX) - INDICATES DOOR NUMBER.


FOR FIELD USE : 11/16/2022

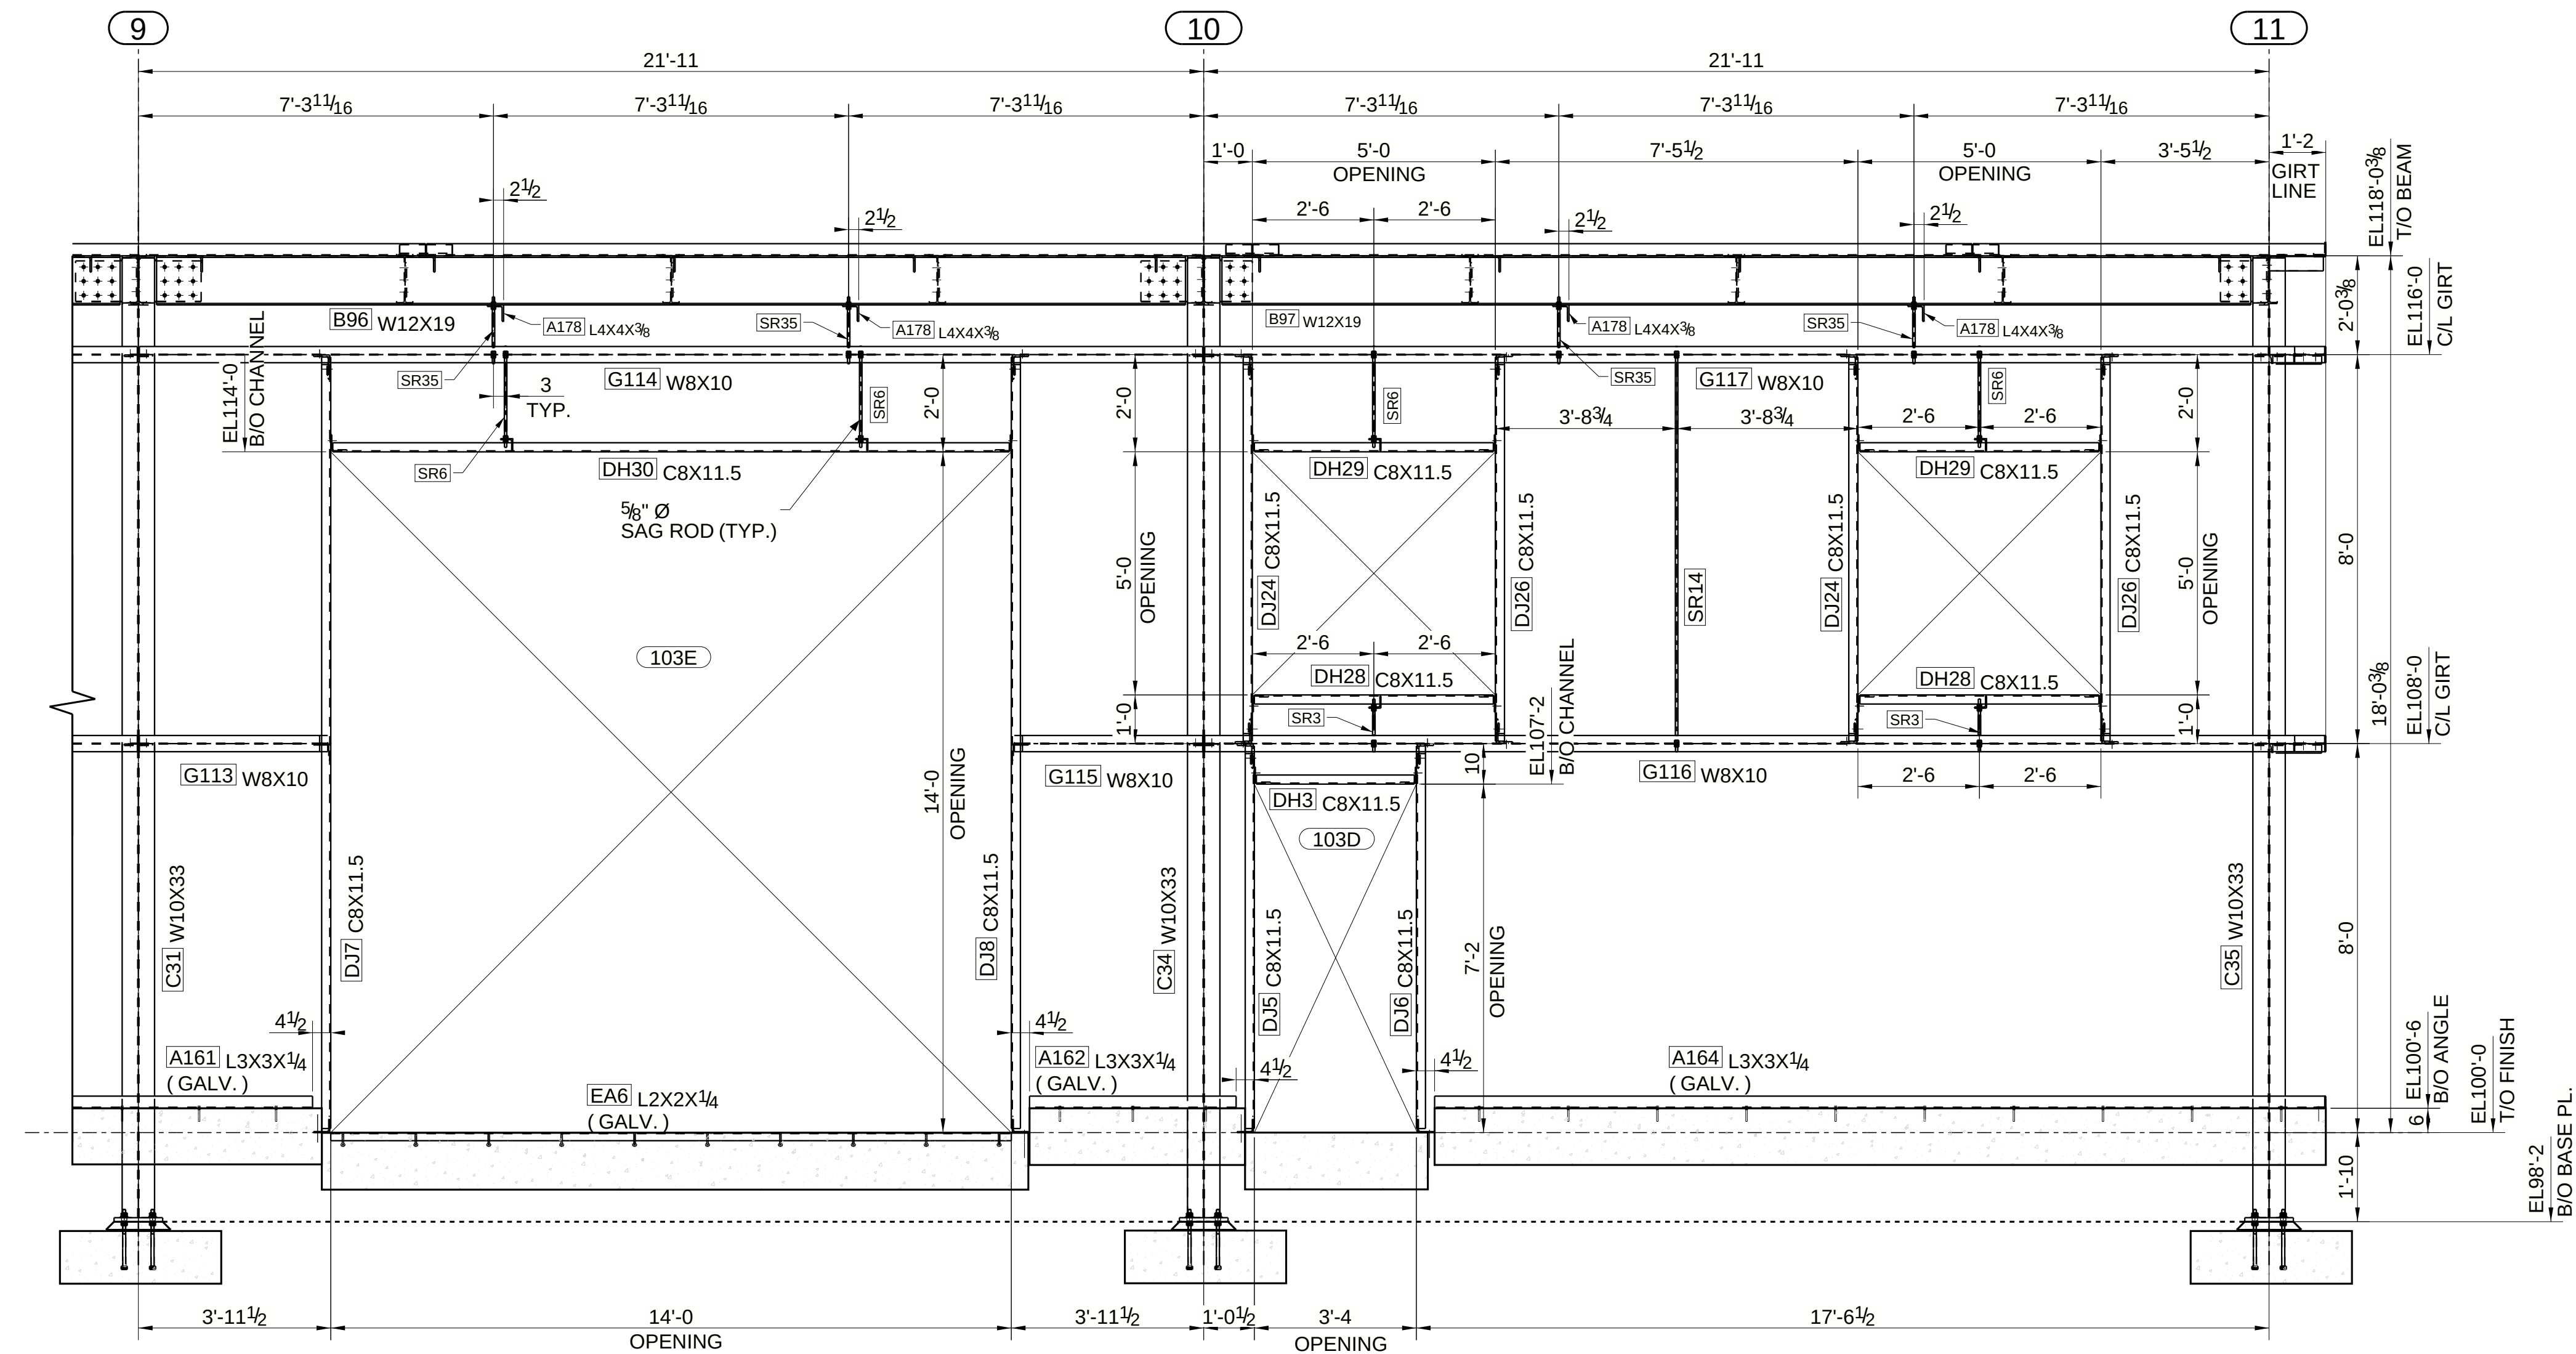

SECTION 24 - 24


E104

(REFER : FRAMING ELEVATION (GRID E) / 030.A2.94.S.02.02)

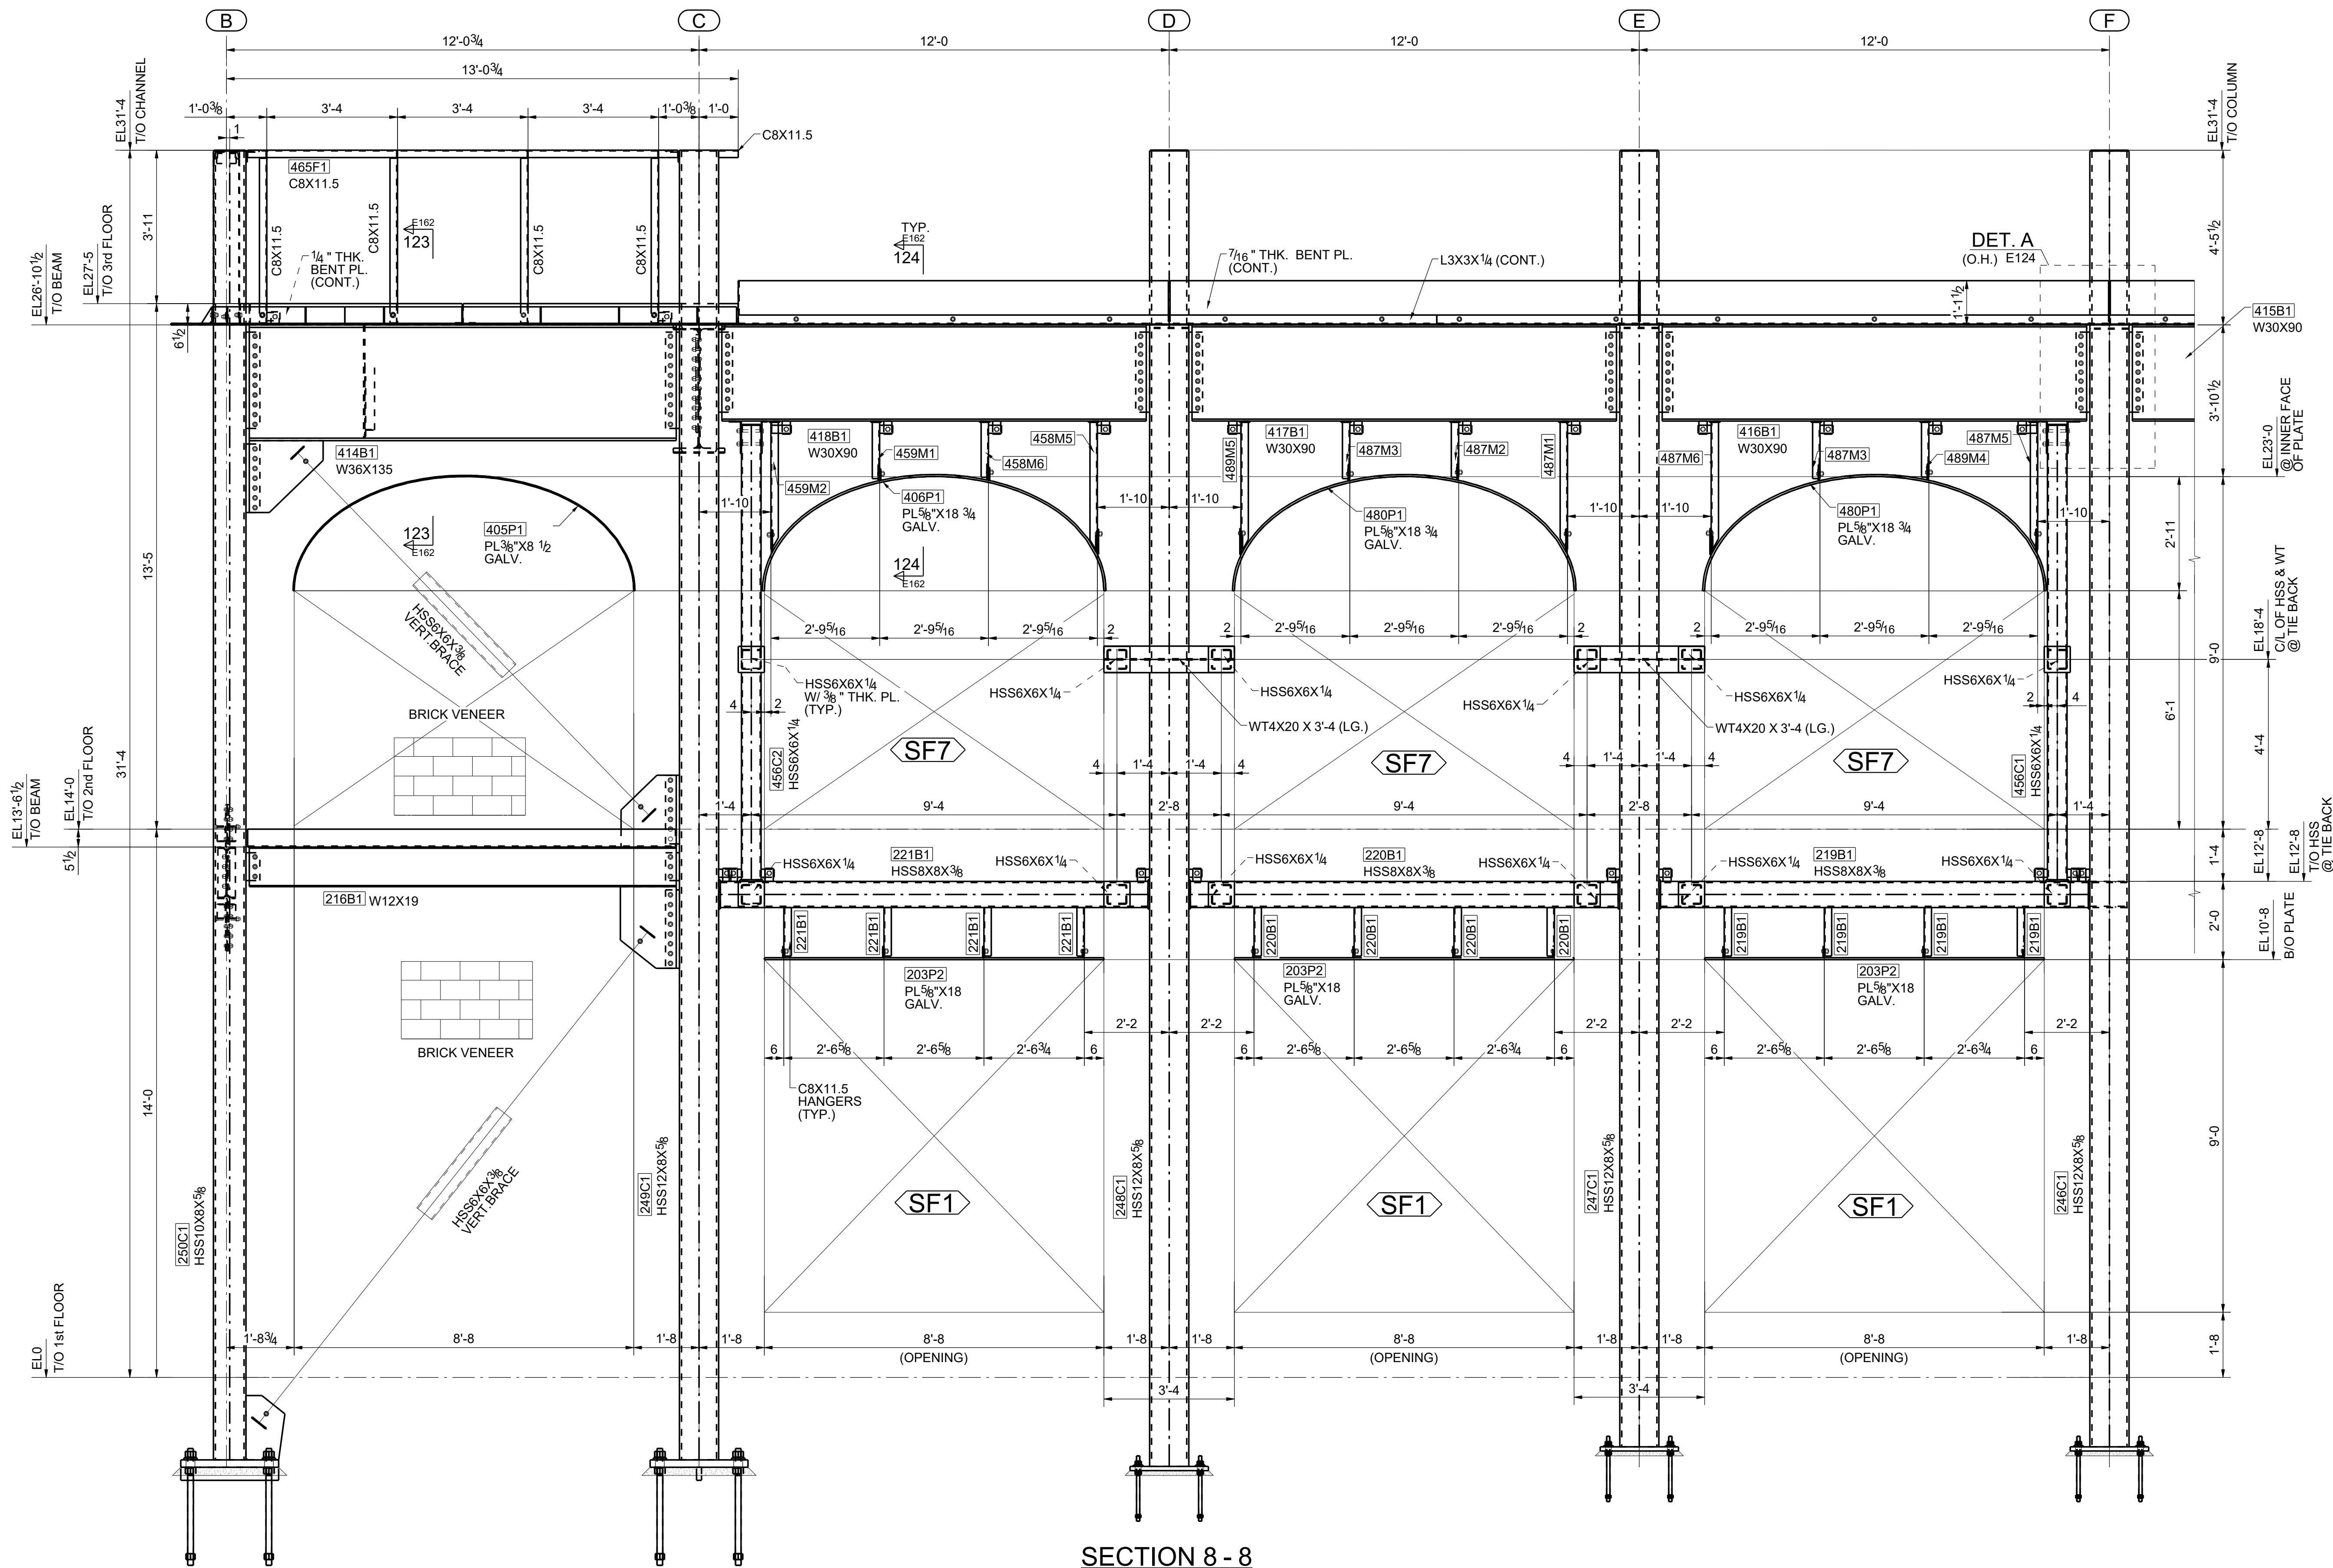

NOTES:-


1. REFER E100 SHEET FOR GENERAL NOTES.
2. REFER E161 SHEET FOR TYPICAL SECTION & DETAILS.
3. **XXX-X / XXX** - INDICATES STORE FRONT / DOOR NUMBER.

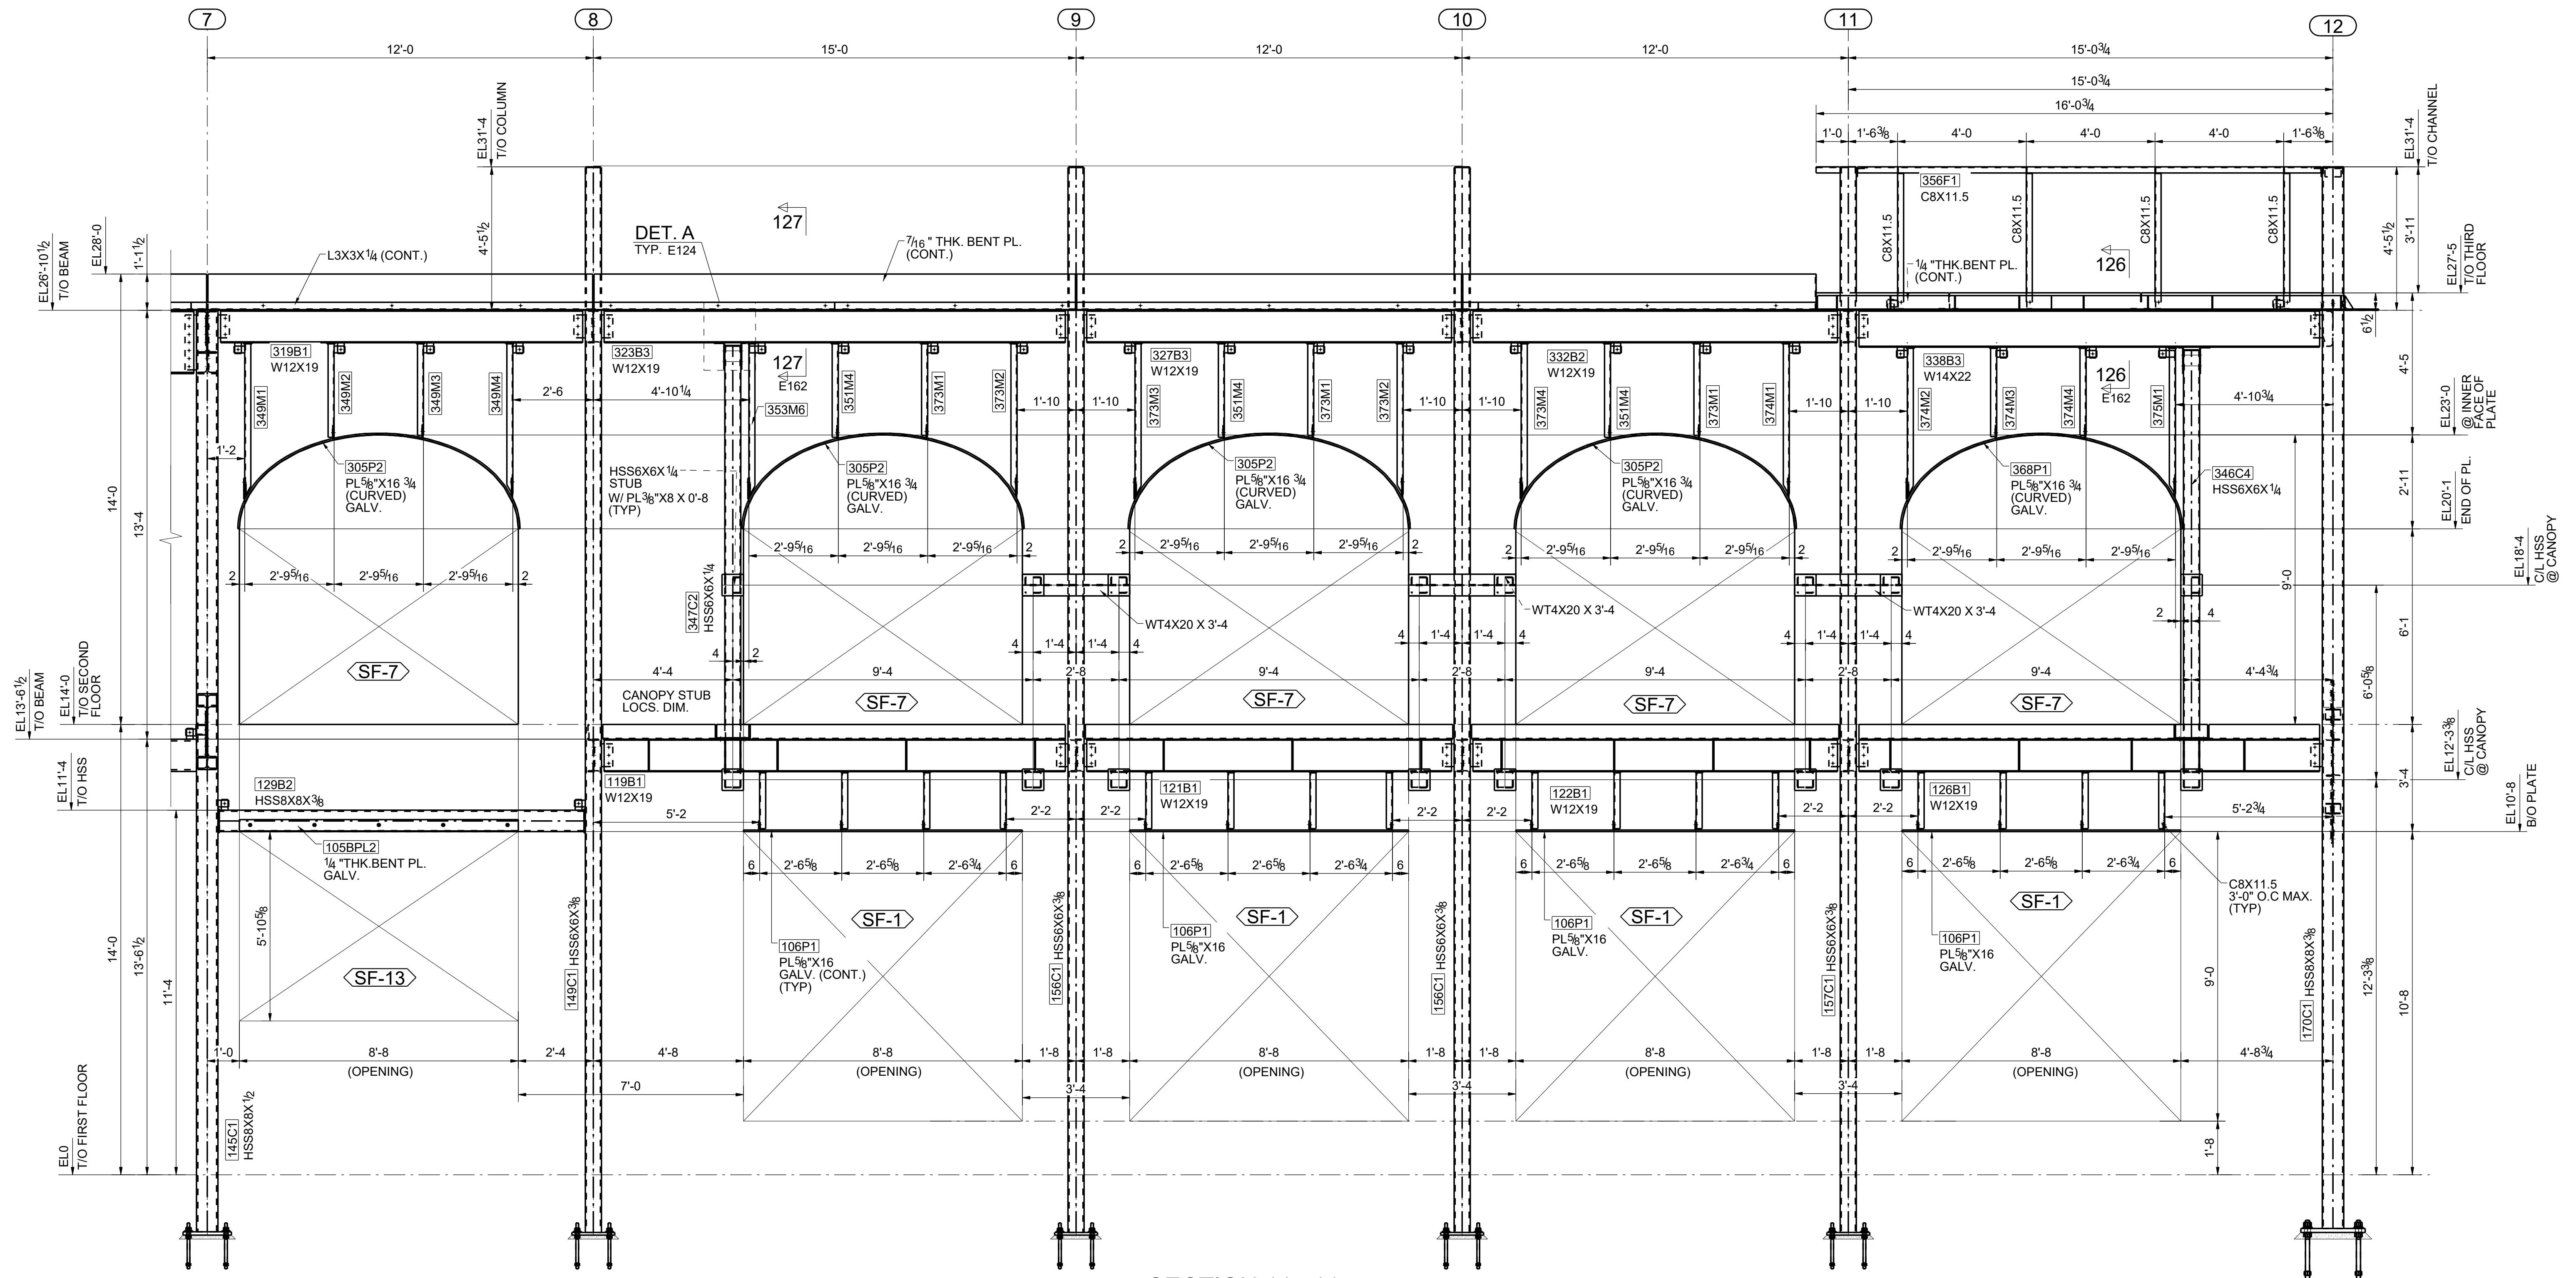


SECTION 11 - 11
E101
(REFER : EAST ELEVATION S-301)

NOTES:-

1. REFER E100 SHEET FOR GENERAL NOTES.
2. REFER E161 SHEET FOR TYPICAL SECTION & DETAILS.
3. $\langle XXX-X \rangle / XXX$ - INDICATES STORE FRONT / DOOR NUMBER.

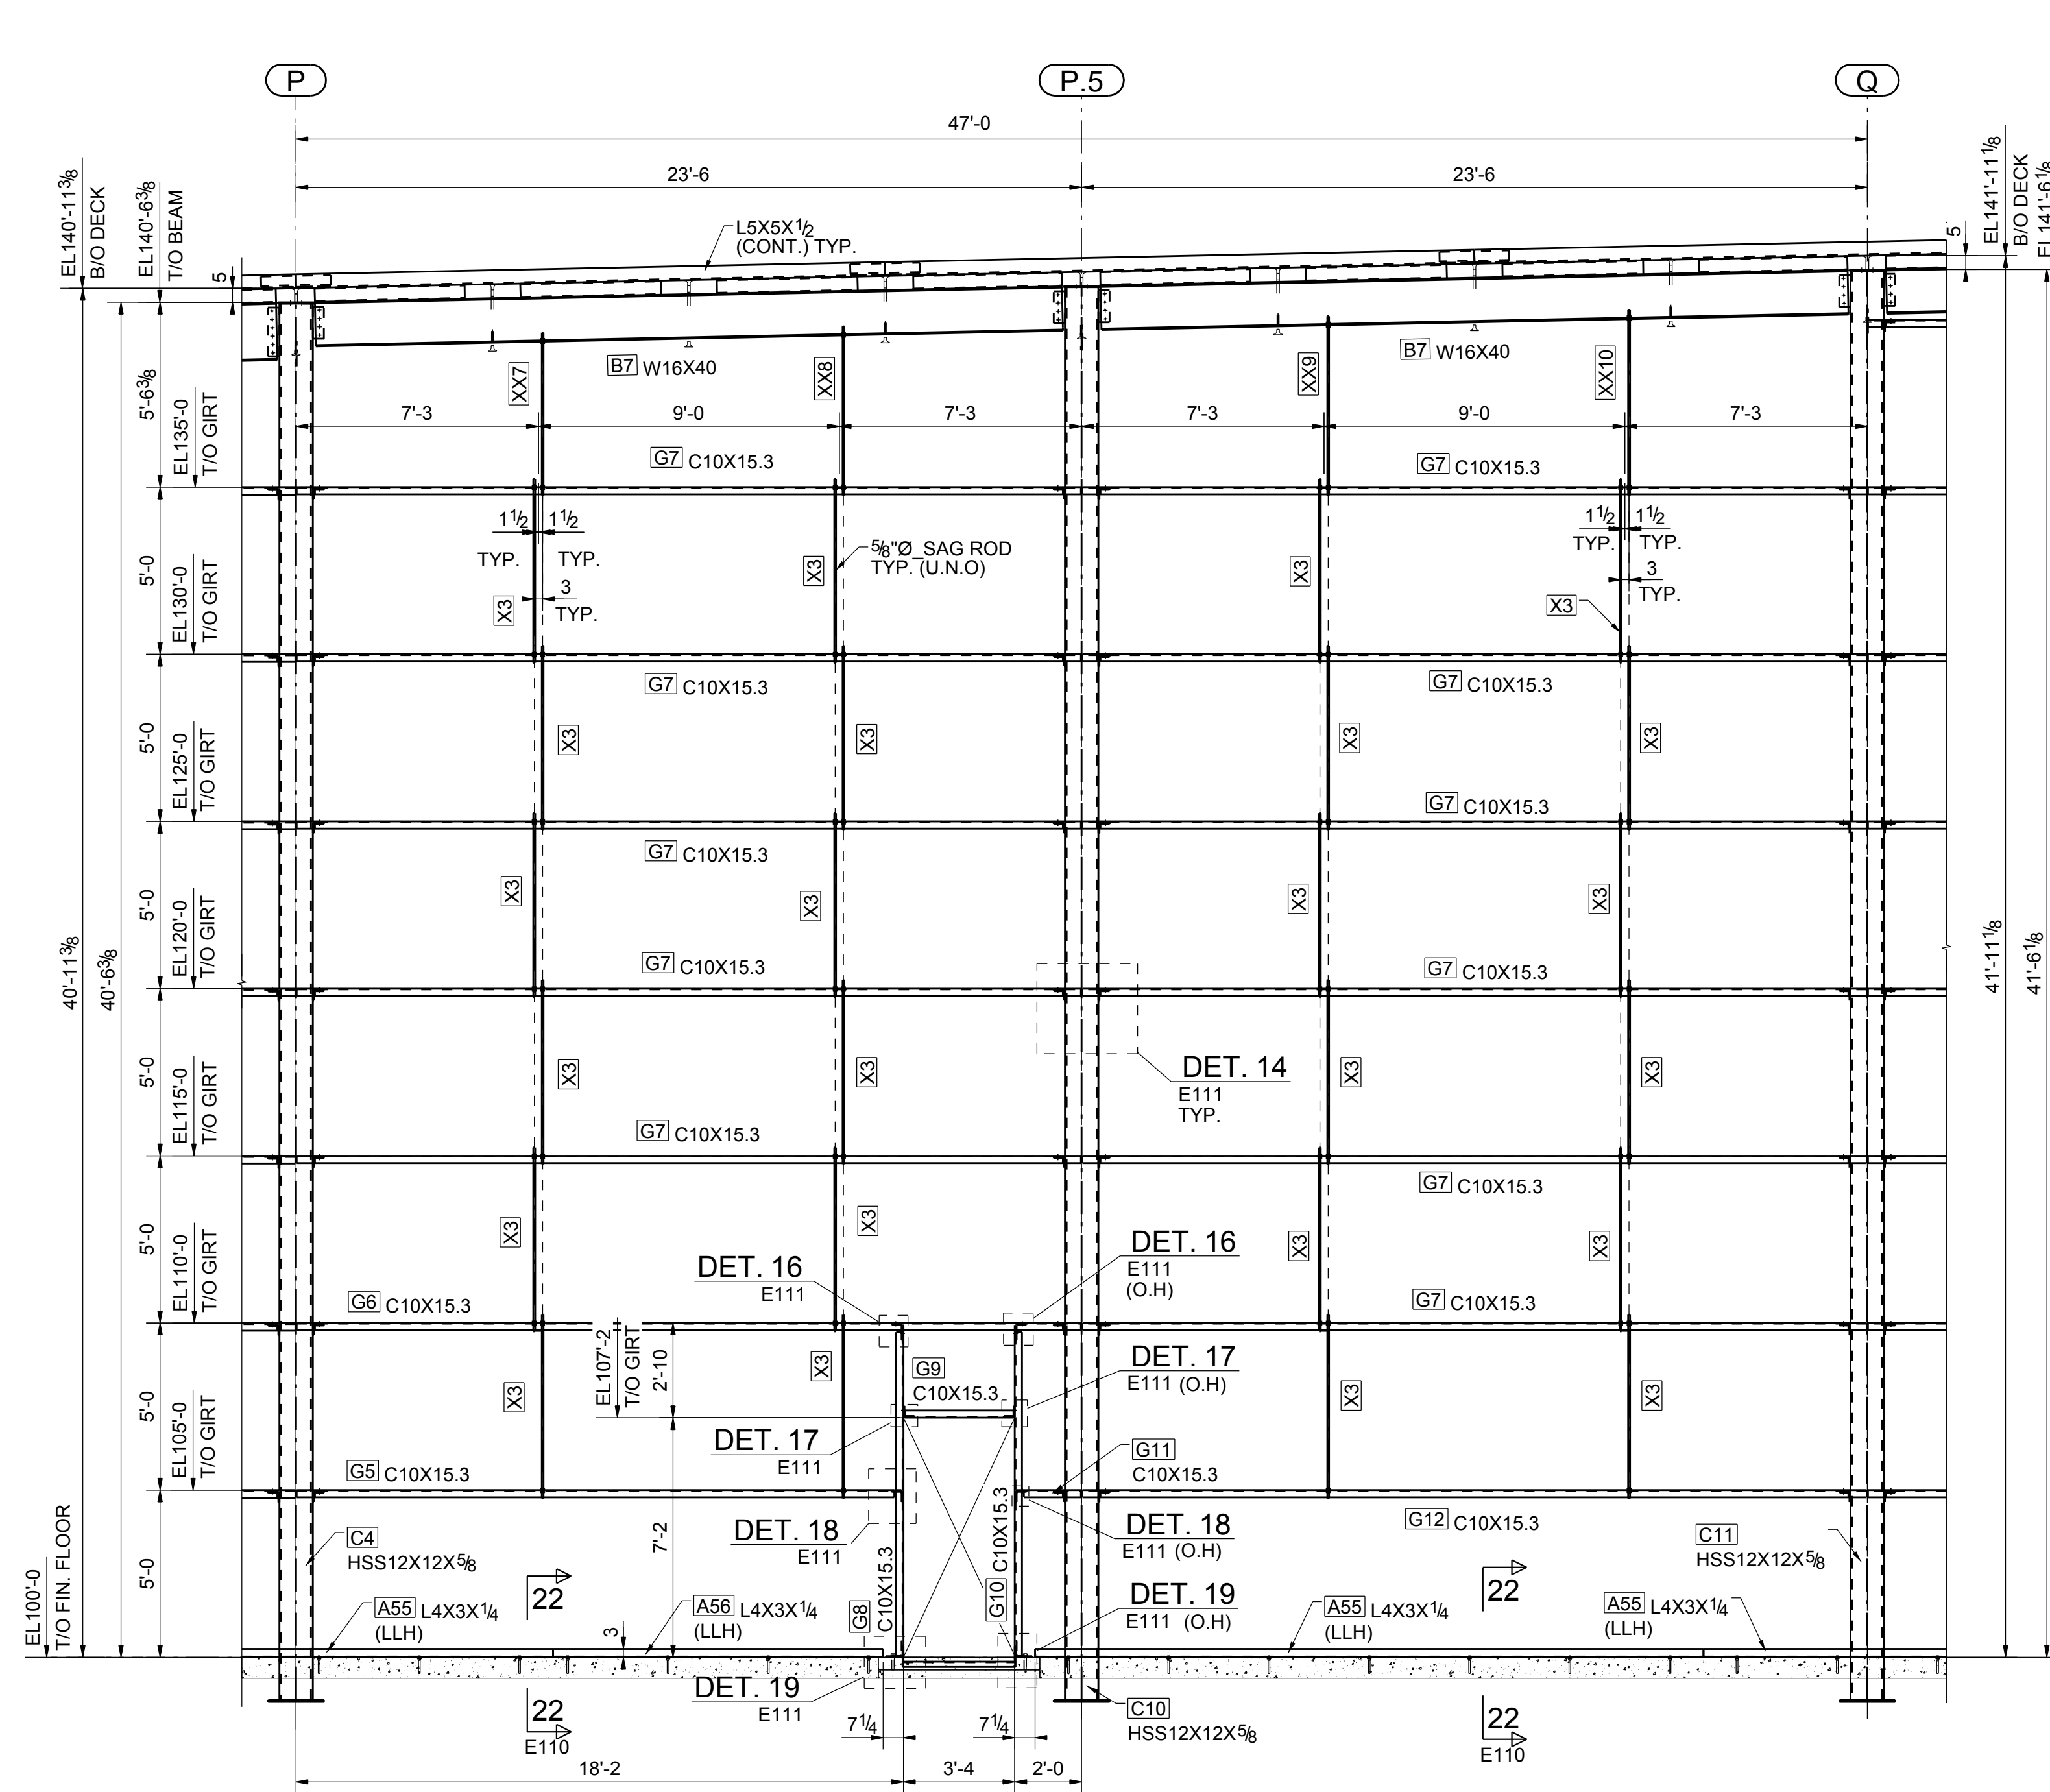


SECTION 3 - 3
E102
WIND GIRT ELEVATION @ ALONG GRIDLINE "20"
(REFER : WIND GIRT ELEVATION @ GRID "20" / S-301)
SEQUENCE - 1

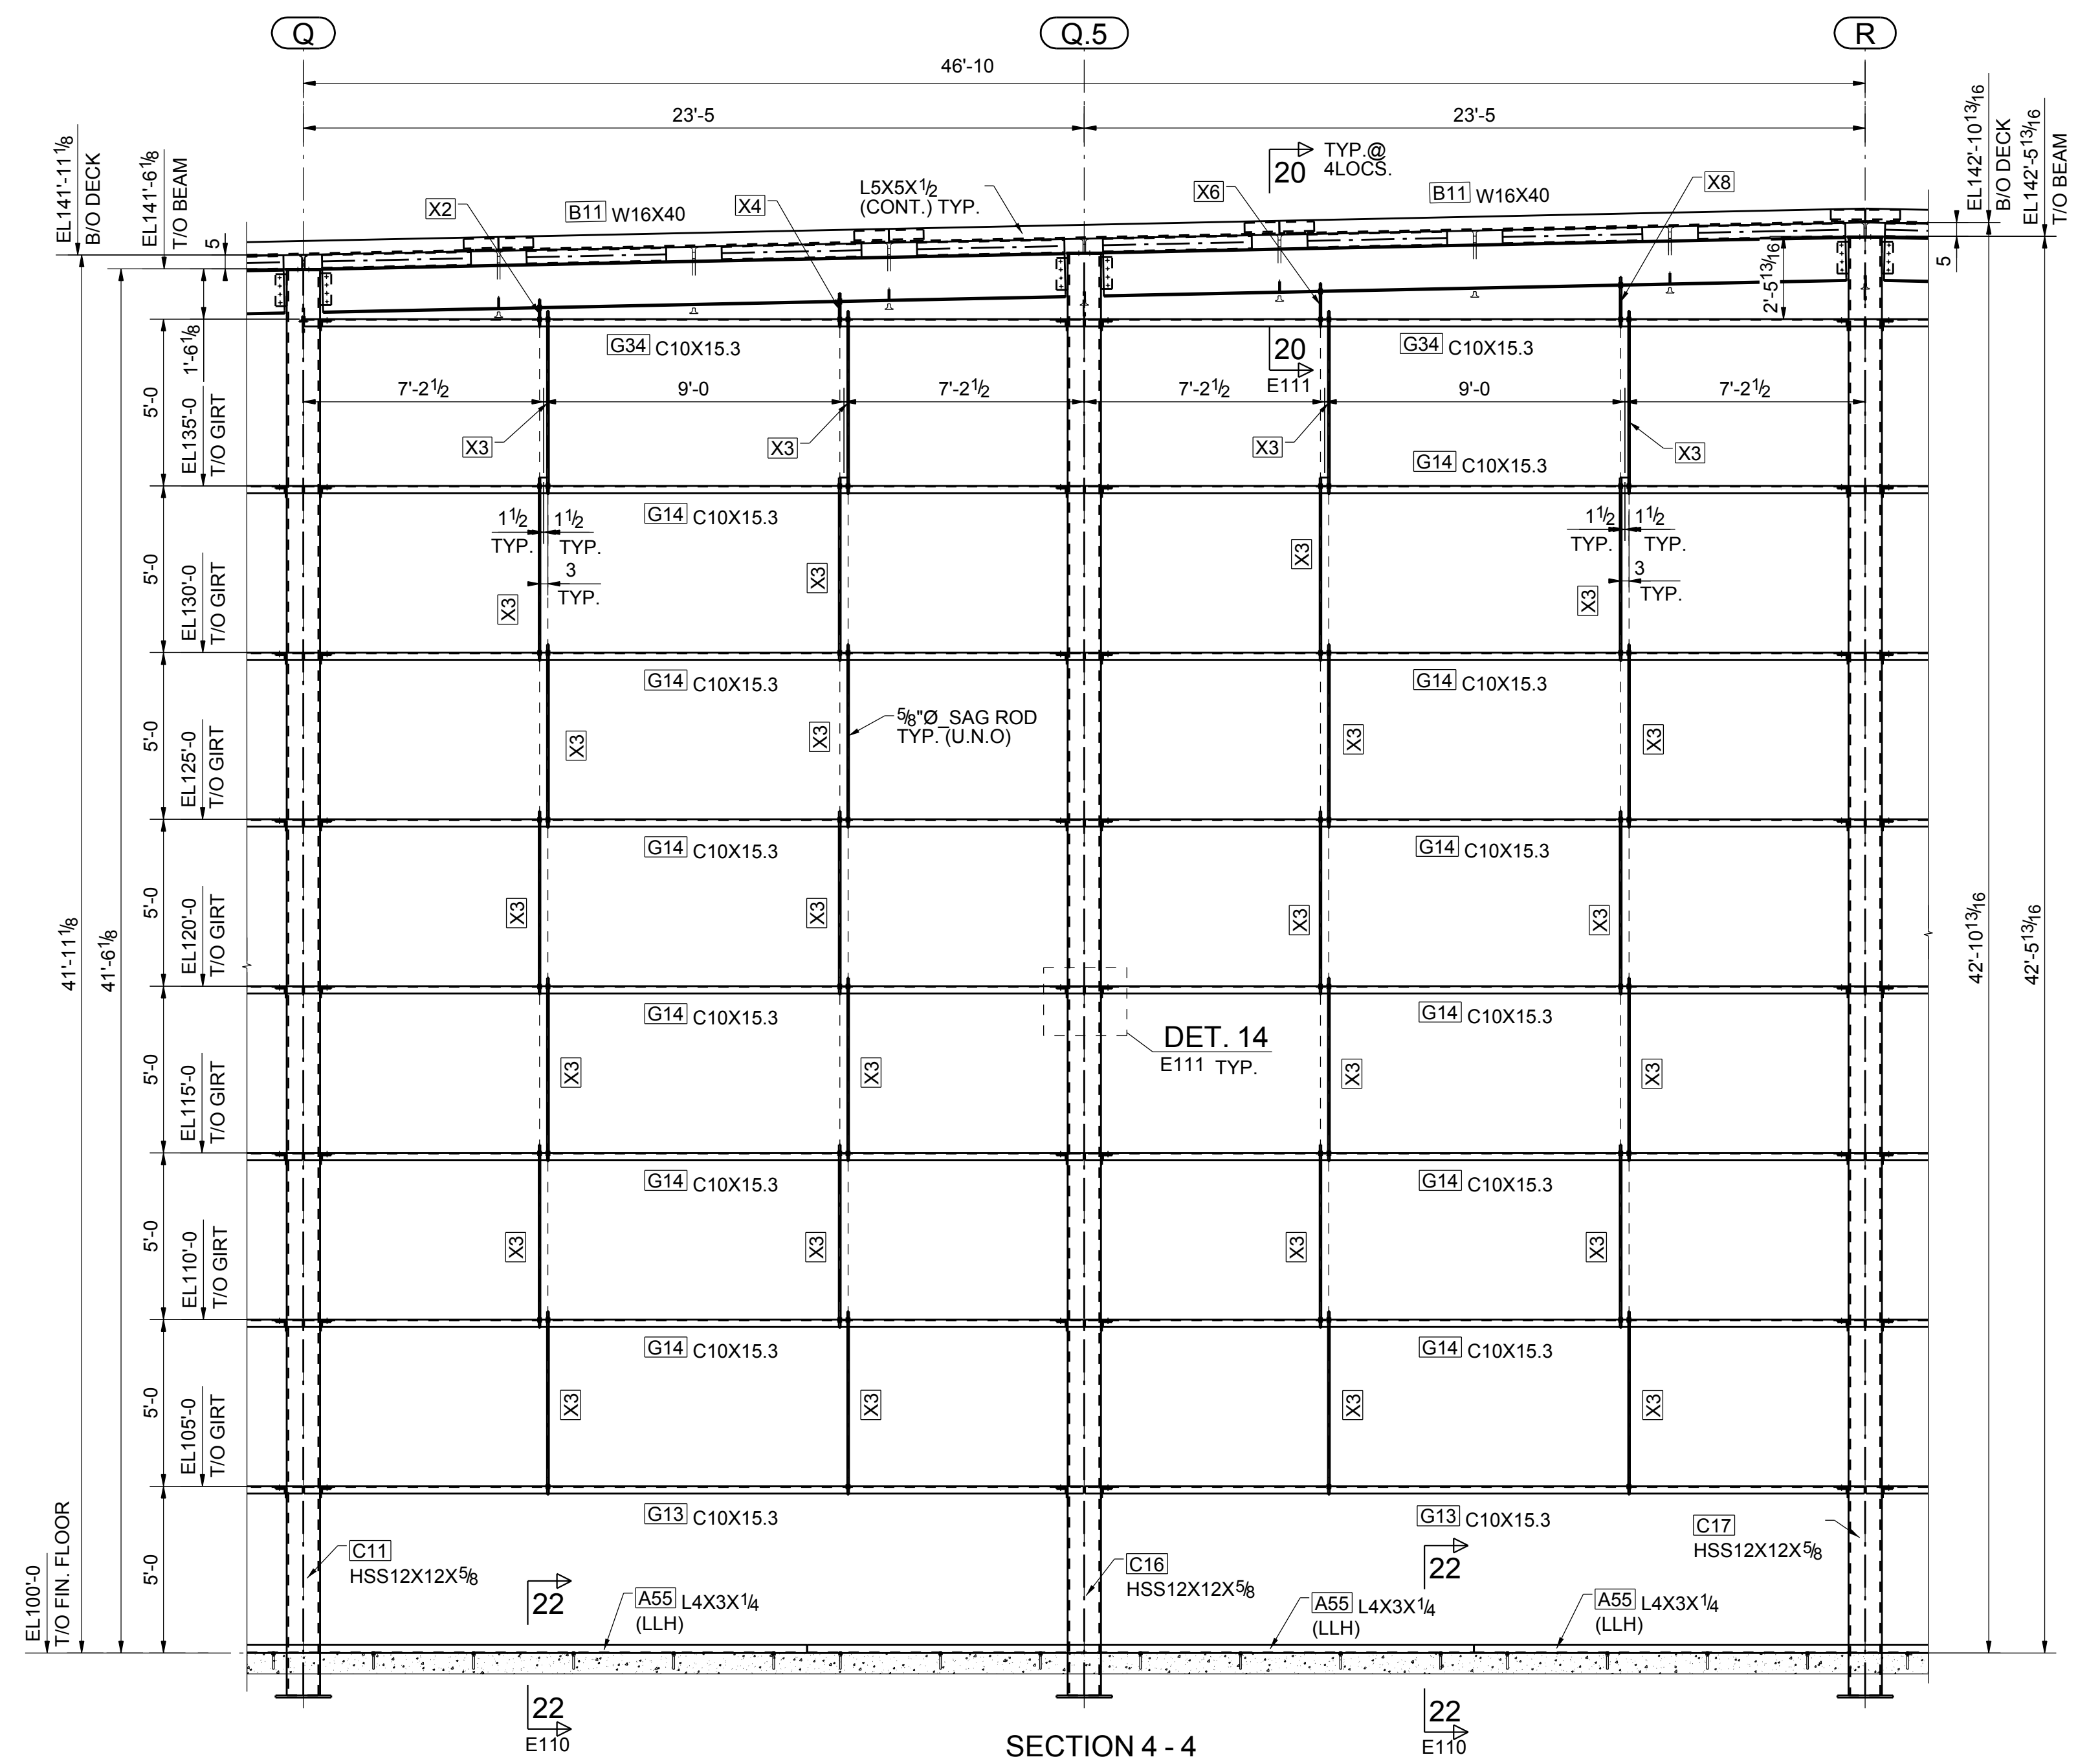

SECTION 4 - 4
E102
WIND GIRT ELEVATION @ ALONG GRIDLINE "20"
(REFER : WIND GIRT ELEVATION @ GRID "20" / S-301)
SEQUENCE - 1

FOR FIELD USE :04/25/2018
SEQ#1



1. REFER E100 SHEET FOR GENERAL NOTES
2. REFER E128 FOR TYPICAL SECTION & DETAILS
3. (XXX) - INDICATES DOOR NUMBER.