


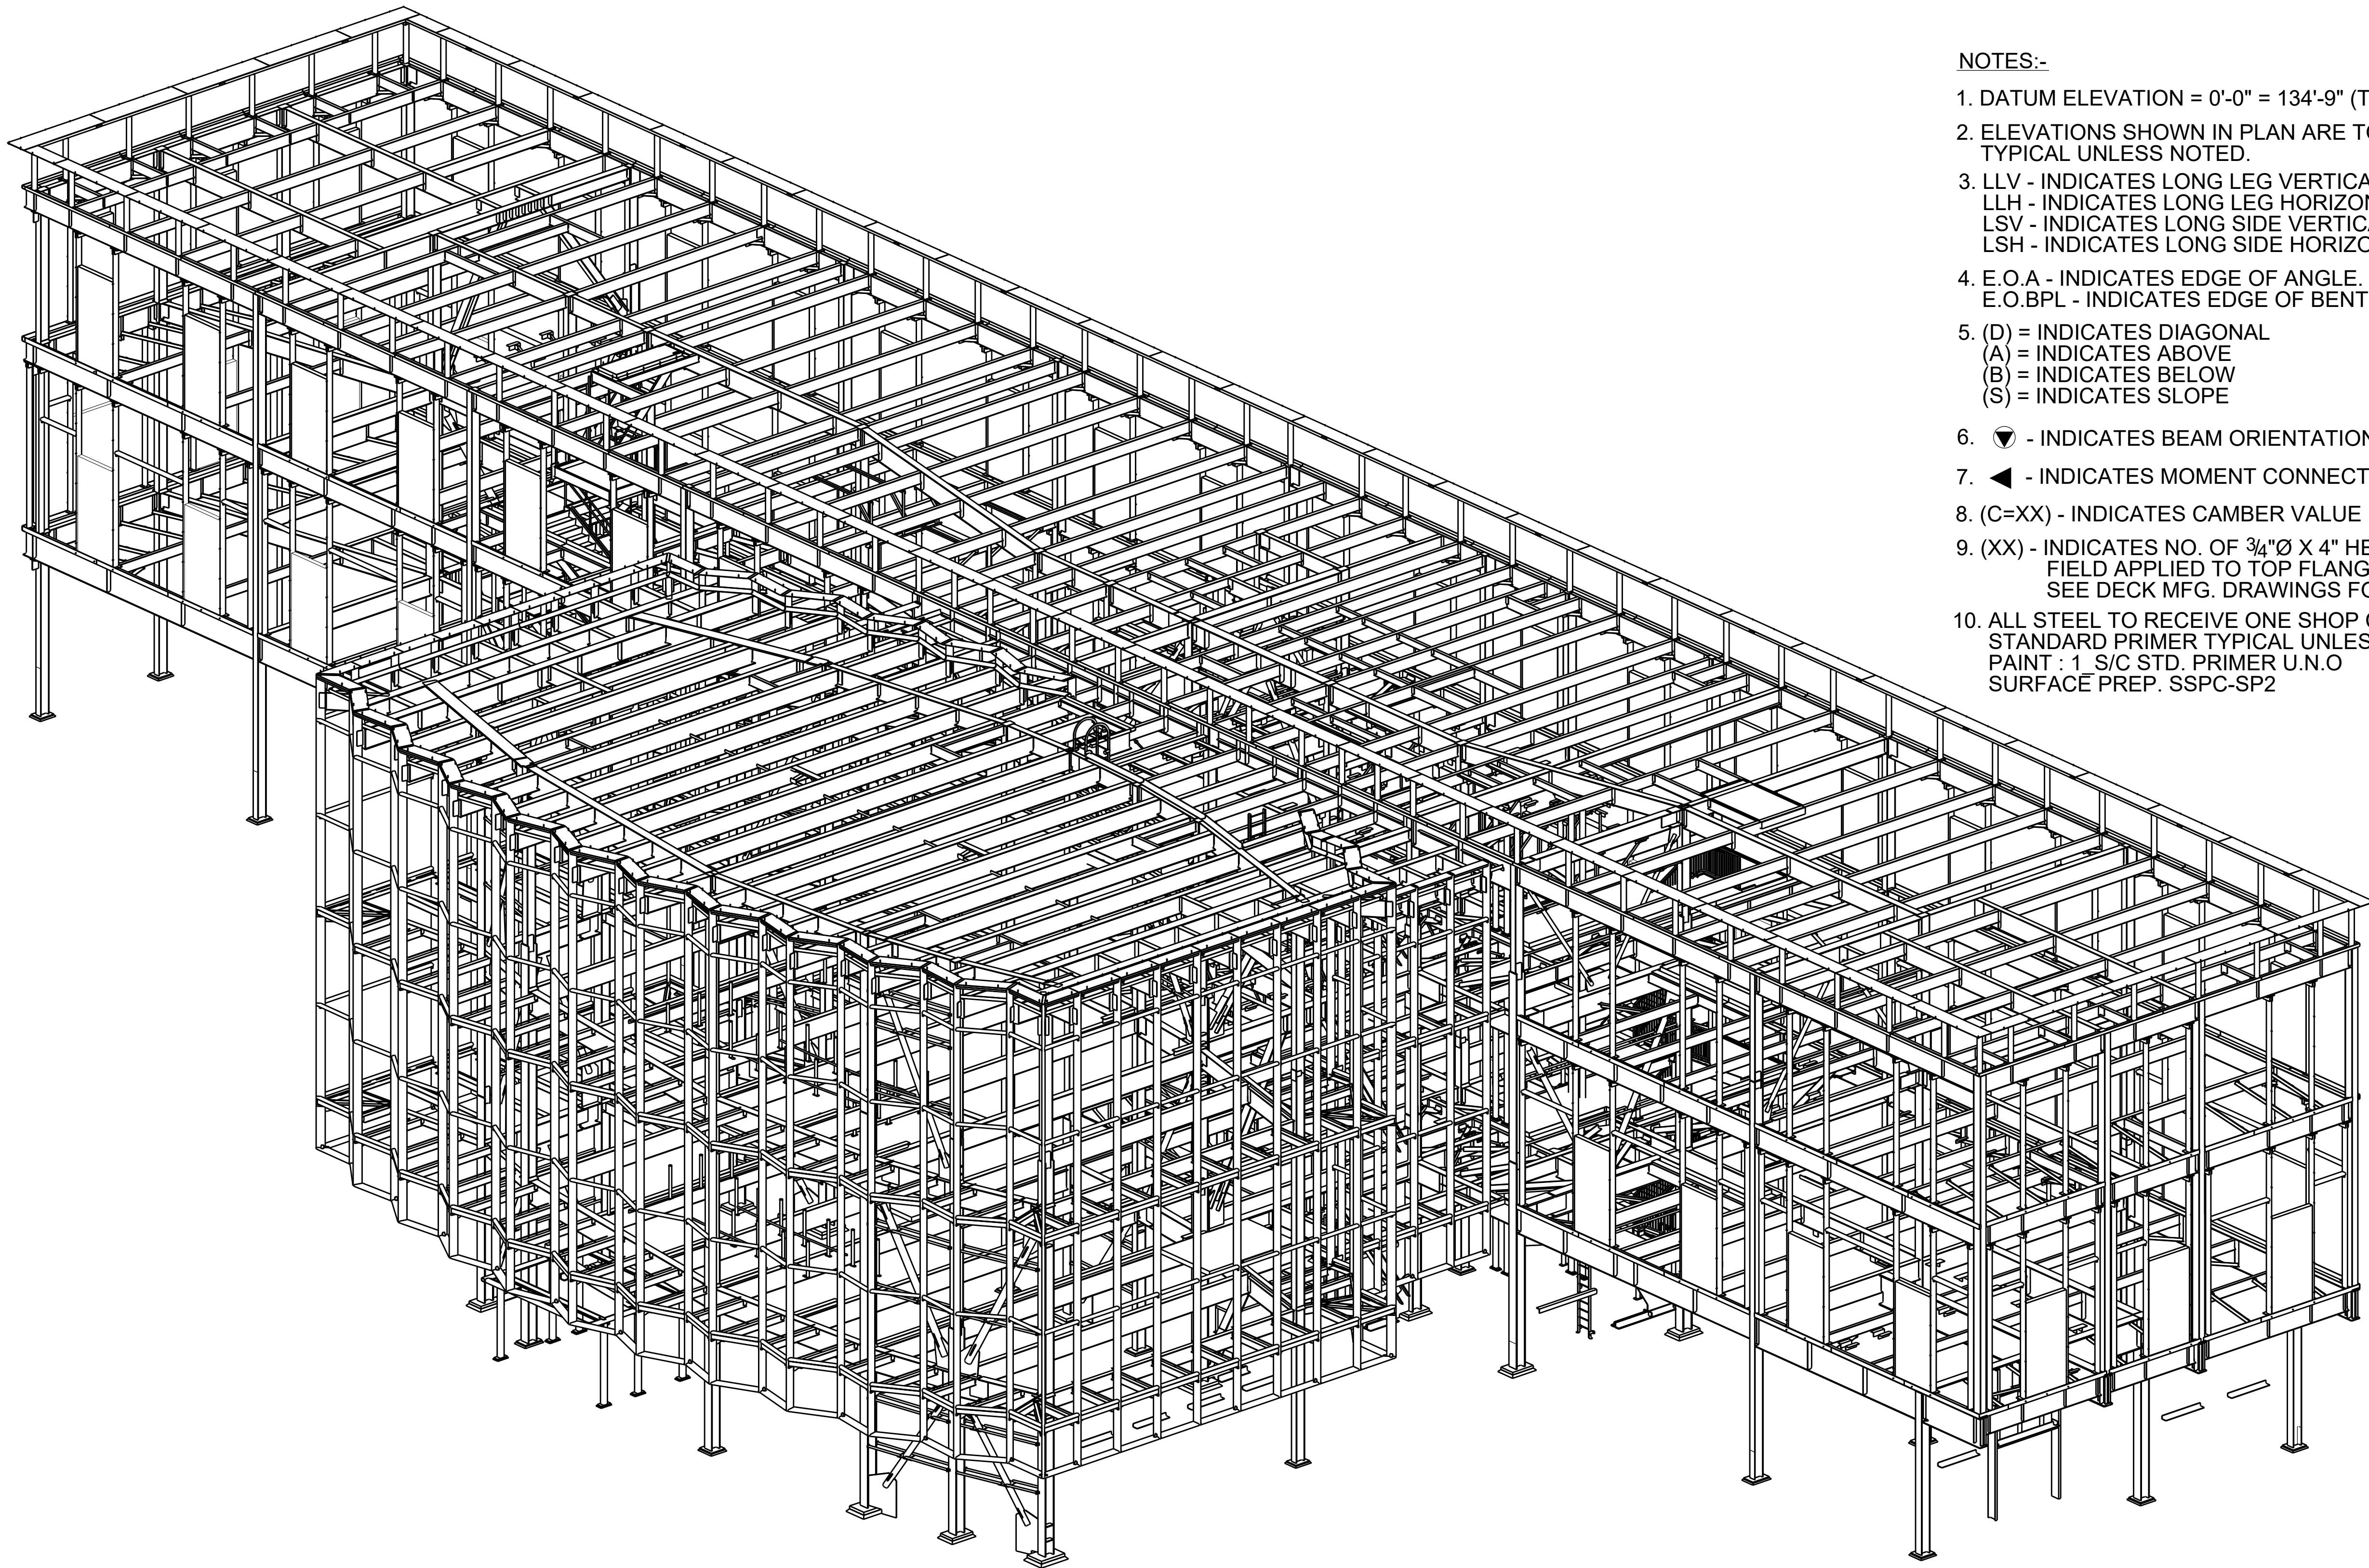

NOTES:-

1. DATUM ELEVATION = 0'-0" = 134'-9" (T/O FINISH FLOOR) TYPICAL UNLESS NOTED.
2. ELEVATIONS SHOWN IN PLAN ARE TO TOP OF STEEL TYPICAL UNLESS NOTED.
3. LLV - INDICATES LONG LEG VERTICAL OF ANGLE
LLH - INDICATES LONG LEG HORIZONTAL OF ANGLE
LSV - INDICATES LONG SIDE VERTICAL OF HSS MEMBER
LSH - INDICATES LONG SIDE HORIZONTAL OF HSS MEMBER.
4. E.O.A - INDICATES EDGE OF ANGLE.
E.O.BPL - INDICATES EDGE OF BENT PLATE.
5. (D) = INDICATES DIAGONAL
(A) = INDICATES ABOVE
(B) = INDICATES BELOW
(S) = INDICATES SLOPE
6. ▼ - INDICATES BEAM ORIENTATION MARK.
7. ◀ - INDICATES MOMENT CONNECTION.
8. (C=XX) - INDICATES CAMBER VALUE IN BEAM.
9. (XX) - INDICATES NO. OF 3/4"Ø X 4" HEADED SHEAR STUDS
FIELD APPLIED TO TOP FLANGE OF STEEL BEAM.
SEE DECK MFG. DRAWINGS FOR COMPLETE INFORMATION.
10. ALL STEEL TO RECEIVE ONE SHOP COAT
STANDARD PRIMER TYPICAL UNLESS NOTED.
PAINT : 1 S/C STD. PRIMER U.N.O
SURFACE PREP. SSPC-SP2

ERECTOR NOTES:-

- 1) ALL FIELD BOLTS TO BE 3/4"Ø A325N TC BOLTS
UNLESS NOTED OTHERWISE w/ HEAVY. HEX NUT
AND HARD FLAT WASHERS.
- 2) REFER TO ERECTION PLANS FOR PIECE MARKS.
- 3) THESE DWGS ARE FOR THE USE OF LOCATING STEEL BY DANIEL IRON
FABRICATOR AND NOT TO BE USED BY OTHER TRADES.
- 4) MATERIAL GRADES USED:
W-SHAPES: ASTM A992.
CHANNELS : ASTM A36
PLATES : ASTM A36. TYPICAL UNLESS NOTED.
ANGLES : ASTM A36
ROUND HSS & RECTANGULAR HSS = ASTM A500 GRADE C

3D-VIEW


LOOKING SOUTHEAST DIRECTION

REFER "TYPICAL BAR SPLICE BUTTON HEAD 5Ab DETAIL" IN 1-E117 FOR BUTTON
HEAD 5Ab MARKS, LENGTH AND LOCATIONS WHERE REINFORCEMENT BARS
INTERRUPTED BY STEEL COLUMN.

FOR FIELD USE :11/03/2022

NOTES:-

- 1. DATUM ELEVATION = 0'-0" = (T/O FINISH FLOOR) TYPICAL UNLESS NOTED.
- 2. ELEVATIONS SHOWN IN PLAN ARE REFERRED TO TOP OF STEEL ELEVATIONS TYPICAL UNLESS NOTED.
- 3. LLV - INDICATES LONG LEG VERTICAL OF ANGLE
LLH - INDICATES LONG LEG HORIZONTAL OF ANGLE
LSV - INDICATES LONG SIDE VERTICAL OF HSS MEMBER
LSH - INDICATES LONG SIDE HORIZONTAL OF HSS MEMBER.
- 4. E.O.A - INDICATES EDGE OF ANGLE.
E.O.BPL - INDICATES EDGE OF BENT PLATE.
- 5. (D) = INDICATES DIAGONAL
(A) = INDICATES ABOVE
(B) = INDICATES BELOW
(S) = INDICATES SLOPE
- 6. ▼ - INDICATES BEAM ORIENTATION MARK.
- 7. ◀ - INDICATES BEAM MOMENT CONNECTION.

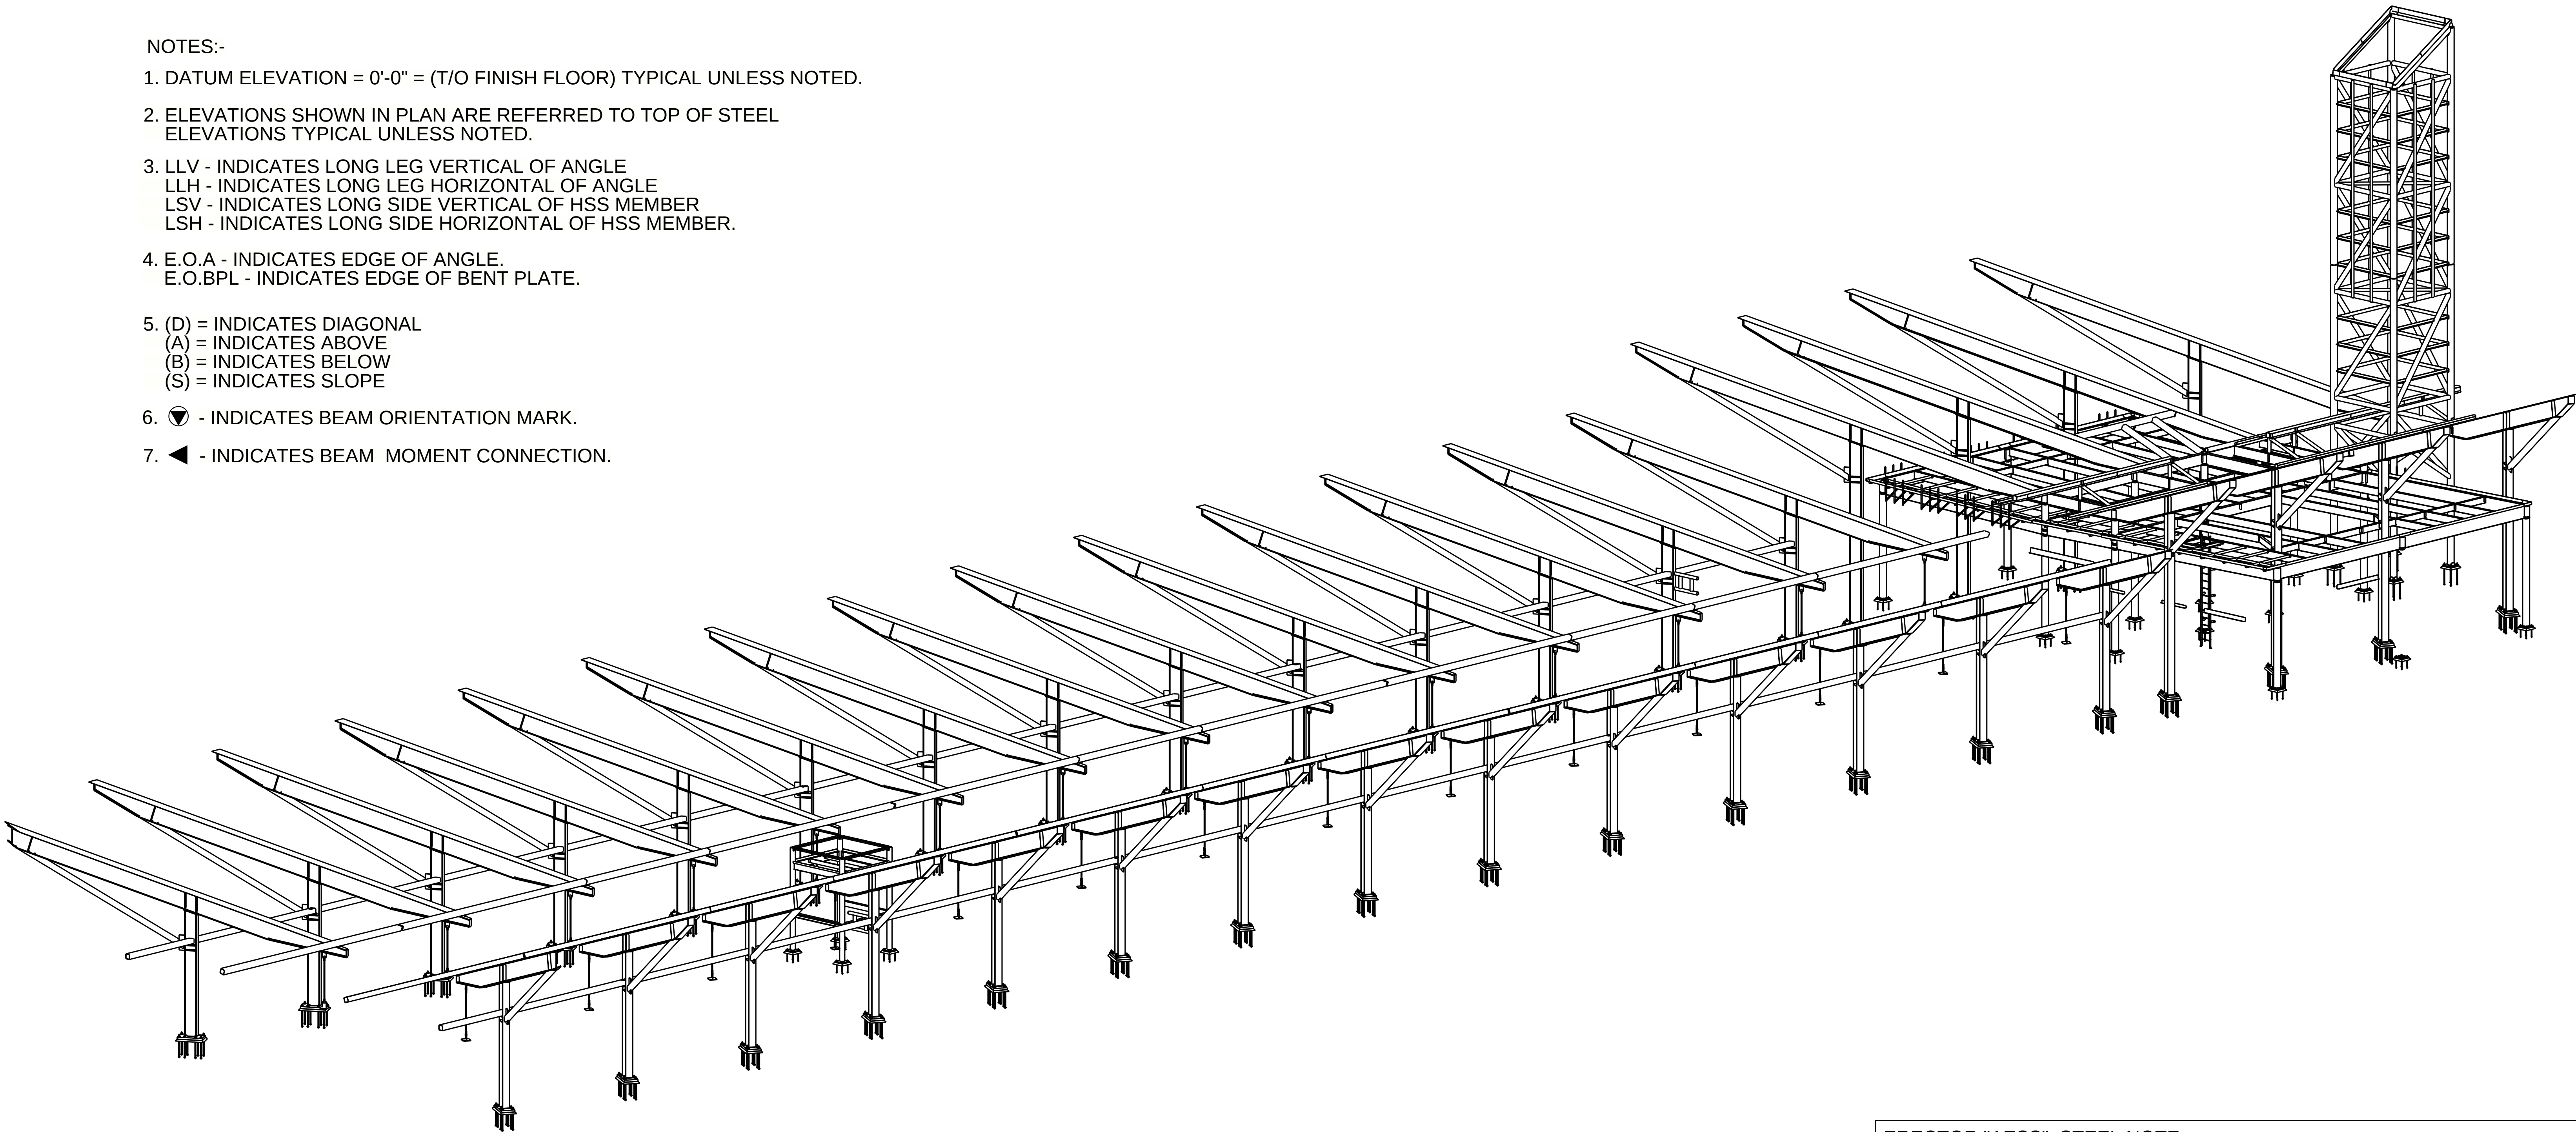

STRUCTURAL STEEL FRAMING FINISHES

ALL BUS CANOPY AND TOWER FRAME HAVING AESS FINISH (ARCHITECTURALLY EXPOSED STRUCTURAL STEEL) RESPECTIVE STEEL IS NOTED AS "AESS" IN ALL THE FOLLOWING PLANS & ELEVATIONS. TYPICAL.

ARCHITECTURALLY EXPOSED STRUCTURAL STEEL (AESS):

- 1. SHOP APPLIED PRIME COAT: PRIMER, ZINC-RICH, ORGANIC
A. SURFACE PREPARATION: ABRASIVE BLAST REFERENCING SSPC-SP 6; 1.0 MIL ANGULAR SURFACE PROFILE.
B. PRIMER: TNEMEC SERIES 90G-1K97 TNAME-ZINC APPLIED AT 2.5 TO 3.5 MILS DFT
- 2. FIELD TOUCHUP OF SHOP APPLIED PRIMER:
A. SURFACE PREPARATION: POWER TOOL CLEAN TO BARE METAL REFERENCING SSPC-SP 11
B. PRIMER: TNEMEC SERIES 90G-1K97 TNAME-ZINC APPLIED AT 2.5 TO 3.5 MILS DFT
- 3. STRIPE COAT: EPOXY, POLYAMIDE
A. TNEMEC SERIES 66 HI-BUILD EPOXOLINE APPLIED AT 4.0 TO 6.0 MILS DFT AT ALL CORNERS, PROTRUSIONS, AND SHARP EDGES
- 4. INTERMEDIATE COAT: EPOXY, POLYAMIDE
A. TNEMEC SERIES 66 HI-BUILD EPOXOLINE APPLIED AT 4.0 TO 6.0 MILS DFT
- 5. TOPCOAT: ADVANCED THERMOSET SOLUTION FLUOROPOLYMER, GLOSS/SEMI-GLOSS/SATIN
A. TNEMEC SERIES 1070 (OR 1071 OR 1072) FLUORONAR APPLIED AT 2.0 TO 3.0 MILS DFT


ERECTOR "AESS" STEEL NOTE :
MEMBERS NOTED "AESS" ARE ARCHITECTURALLY EXPOSED STRUCTURAL STEEL AND THE FOLLOWING SPECIAL CARE SHOULD BE TAKEN INTO ACCOUNT:
1. KEEP MEMBERS OFF GROUND AND PROTECT FROM EROSION.
2. USE SPECIAL CARE IN HANDLING TO PREVENT TWISTING OR WARPING.
3. CLOSE WELD ACCESS HOLES AT FULL PEN WELDS.
4. ALL RAT HOLES AT AESS LOCATIONS NEED TO BE FILLED & GROUND SMOOTH TYPICAL.

ERECTOR NOTES:-

- 1) ALL FIELD BOLTS TO BE 3/4 "Ø A325N TC BOLTS UNLESS NOTED OTHERWISE w/ STD. HEX NUT AND HARD FLAT WASHERS.
- 2) REFER TO ERECTION PLANS FOR PIECE MARKS.
- 3) THESE DWGS ARE FOR THE USE OF LOCATING STEEL BY DANIEL IRON FABRICATOR AND NOT TO BE USED BY OTHER TRADES.
- 4) MATERIAL GRADES USED:
W-SHAPES: ASTM A992
CHANNELS : ASTM A36
PLATES : ASTM A36
ANGLES : ASTM A36
RECTANGULAR HSS = ASTM A500 GRADE B

FOR FIELDUSE : 03/17/2023

ALL OTHER BUILDING FRAMING STEEL WILL RECEIVE ONE SHOP COAT STANDARD PRIMER TYPICAL UNLESS NOTED
SURFACE PREPARATION SSPC-SP 2

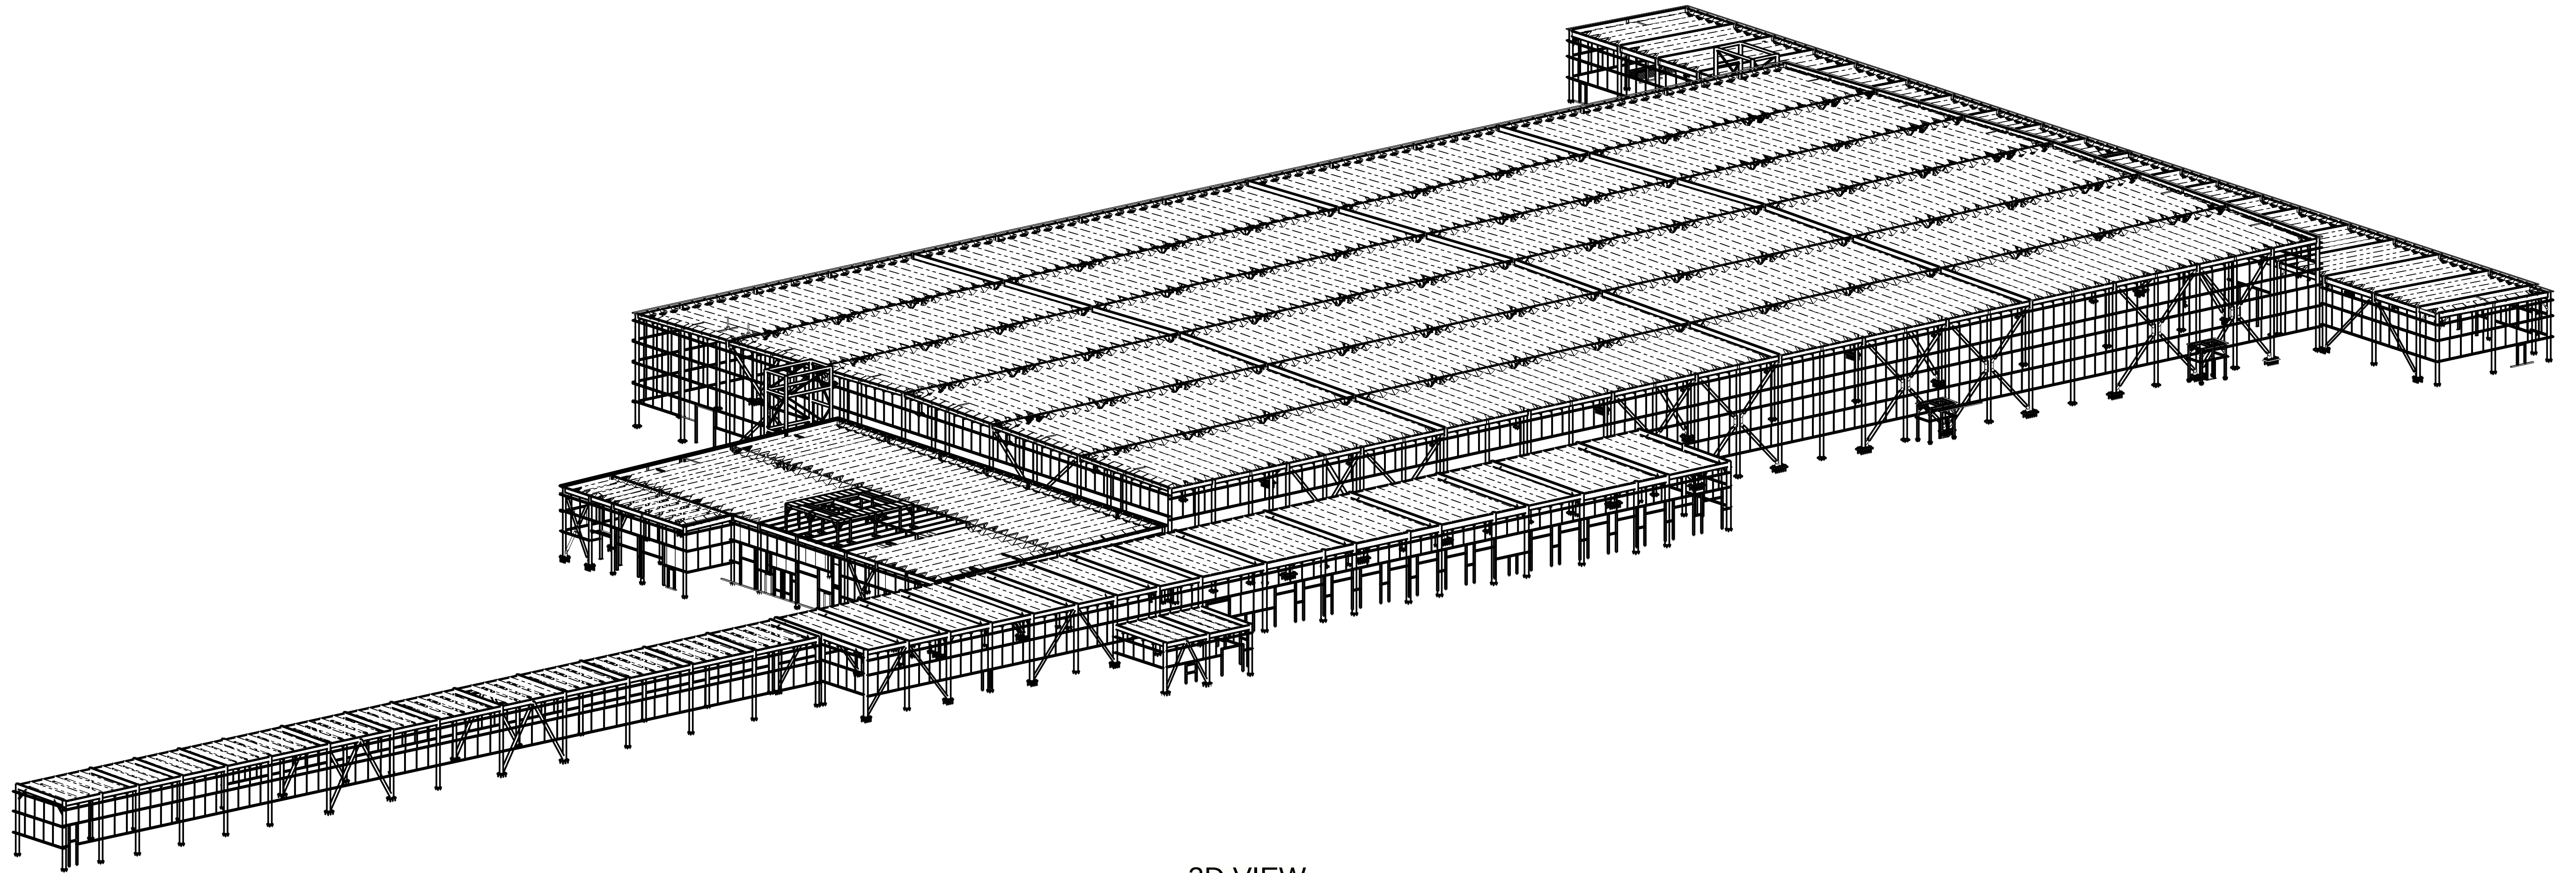


3D VIEW

GENERAL NOTES :-

- 1) DATUM ELEVATION = FINISHED FLOOR ELEVATION = 100'-0" U.N.O
- 2) E.O.G - INDICATES EDGE OF GRATING.
- 3) ELEVATIONS SHOWN IN PLAN ARE REFERRED TO
TOP OF STEEL ELEVATIONS TYPICAL U.N.O.
- 4) REFER E114 & E116 SHEETS FOR TYPICAL SECTIONS & DETAILS.
- 5) ► - DENOTES MOMENT CONNECTION
- 6) ALL FIELD BOLTS TO BE $\frac{3}{4}$ " Ø A325N TC
BOLTS UNLESS NOTED OTHERWISE W/ STD. HEX NUT
AND HARD FLAT WASHERS.
- 7) W-SHAPES : ASTM A992.
PLATES, ANGLES & CHANNELS : ASTM A36.
- 8) THESE DWGS ARE FOR THE USE OF LOCATING STEEL BY HASKELL.CO
FABRICATOR AND NOT TO BE USED BY OTHER TRADES.

FOR RE-APPROVAL : 06/12/2023

ALL STRUCTURAL FRAMING STEEL WILL RECEIVE
ONE SHOP COAT OF SSPC PAINT 25 2-4 MILS D.F.T.
AND SURFACE PREPERATION WILL BE SSPC-SP3
TYPICAL UNLESS NOTED.

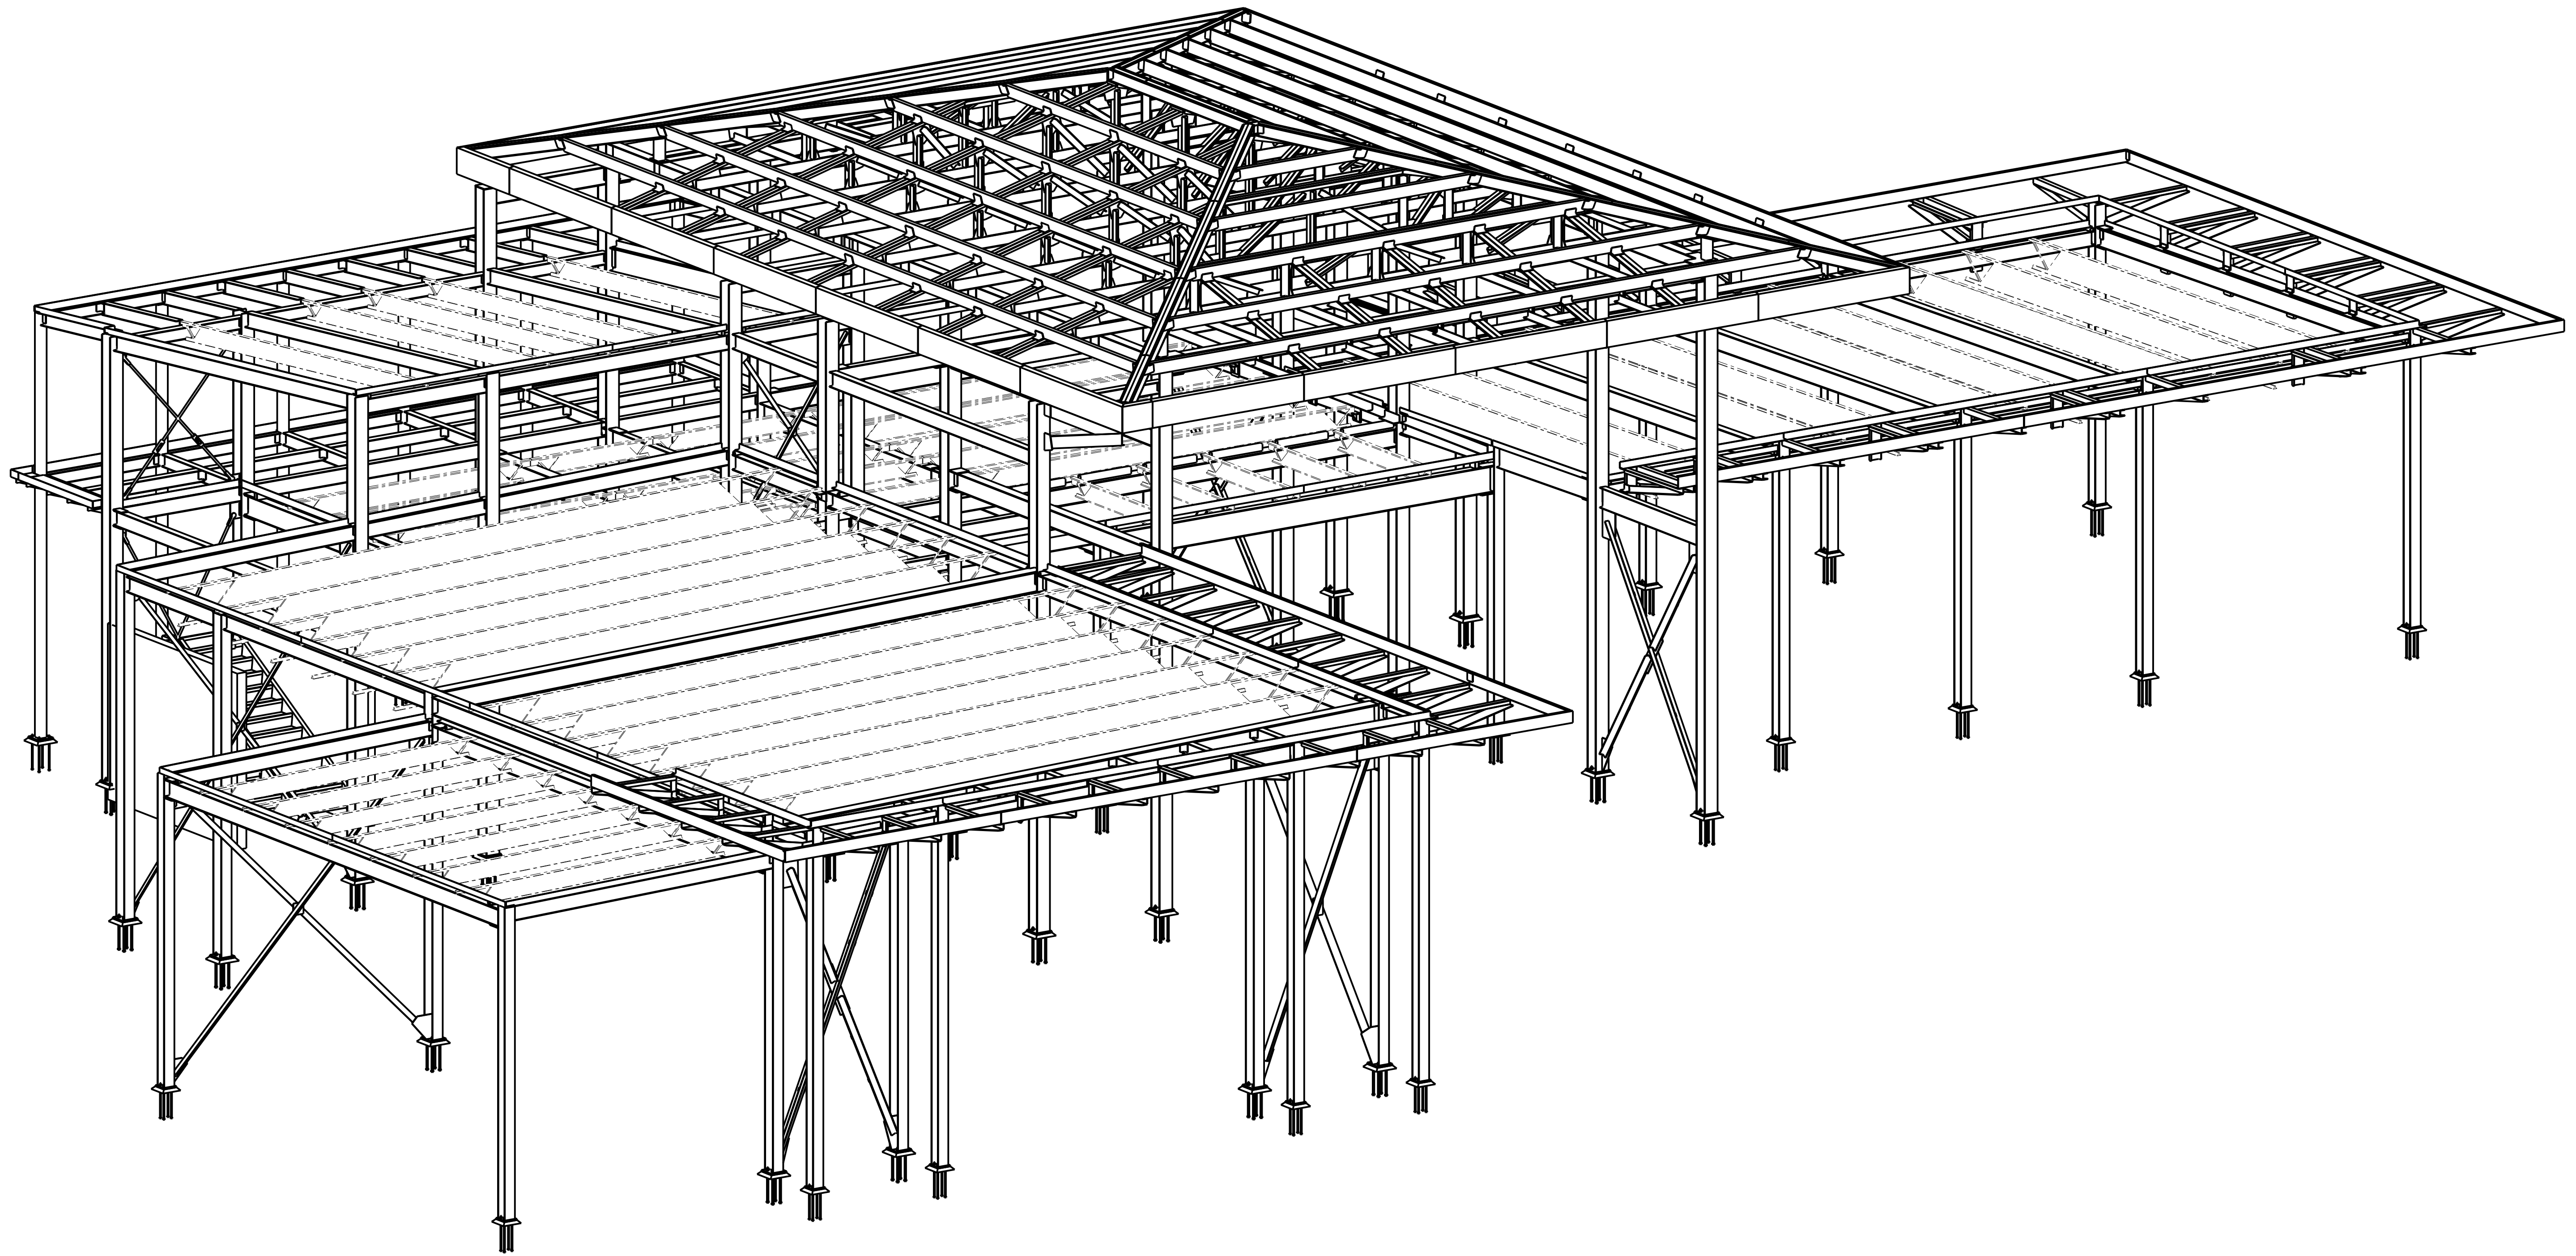


NOTES:-

1. ALL FILED BOLTS TO BE $\frac{3}{4}$ " $\varnothing$ A325N BOLTS UNLESS NOTED OTHERWISE W/STD. HEX NUT AND HARD FLAT WASHERS.
2. THESE DRAWINGD ARE THE ERECTION OF STEEL PROVIDED BY INDUSTRIAL FABRICATORS INC. AND NOT TO BE USED BY OTHERS TRADES.
3. REFER TO ERECTION PLANS FOR PIECE MARKS AND OTHERS INFORMATIONS.
4. ALL SHAPES BE AS FOLLOWS:
WIDE FLANGE SHAPES : ASTM A992
CHANNEL, ANGLES, ROD & PLATE : ASTM A36
TUBE STEEL : ASTM A500 GRADE B.
5. (S) - INDICATES SLOPES, (B) - INDICATES - BELOW, (A) - INDICATES - ABOVE.
(LLV) - LONG LEG VERTICAL, (LLH) - LONG LEG HORIZONTAL,
(LSV) - LONG SIDE VERITICAL, (LSH) - LONG SIDE HORIZONTAL.
(LLBB) - LONG LEG BACK TO BACK.
6.  - INDICATES ORIENTATION OF MEMBER.
7.  - INDICATES MOMENT CONNECTION.
8.  - INDICATES X- BRACING.
9.  - INDICATES MOMENT CONNECTION DETAIL REFER E115 SHEET.

3D - VIEW (SOUTH - WEST DIRECTION)

ALL STRUCTURAL STEEL SHALL RECEIVE ONE SHOP
COAT RED METAL PRIMER (SSPC-PAINT 25) TYPICAL UNLESS NOTED.
SURFACE PREPARATION : SSPC-SP3.

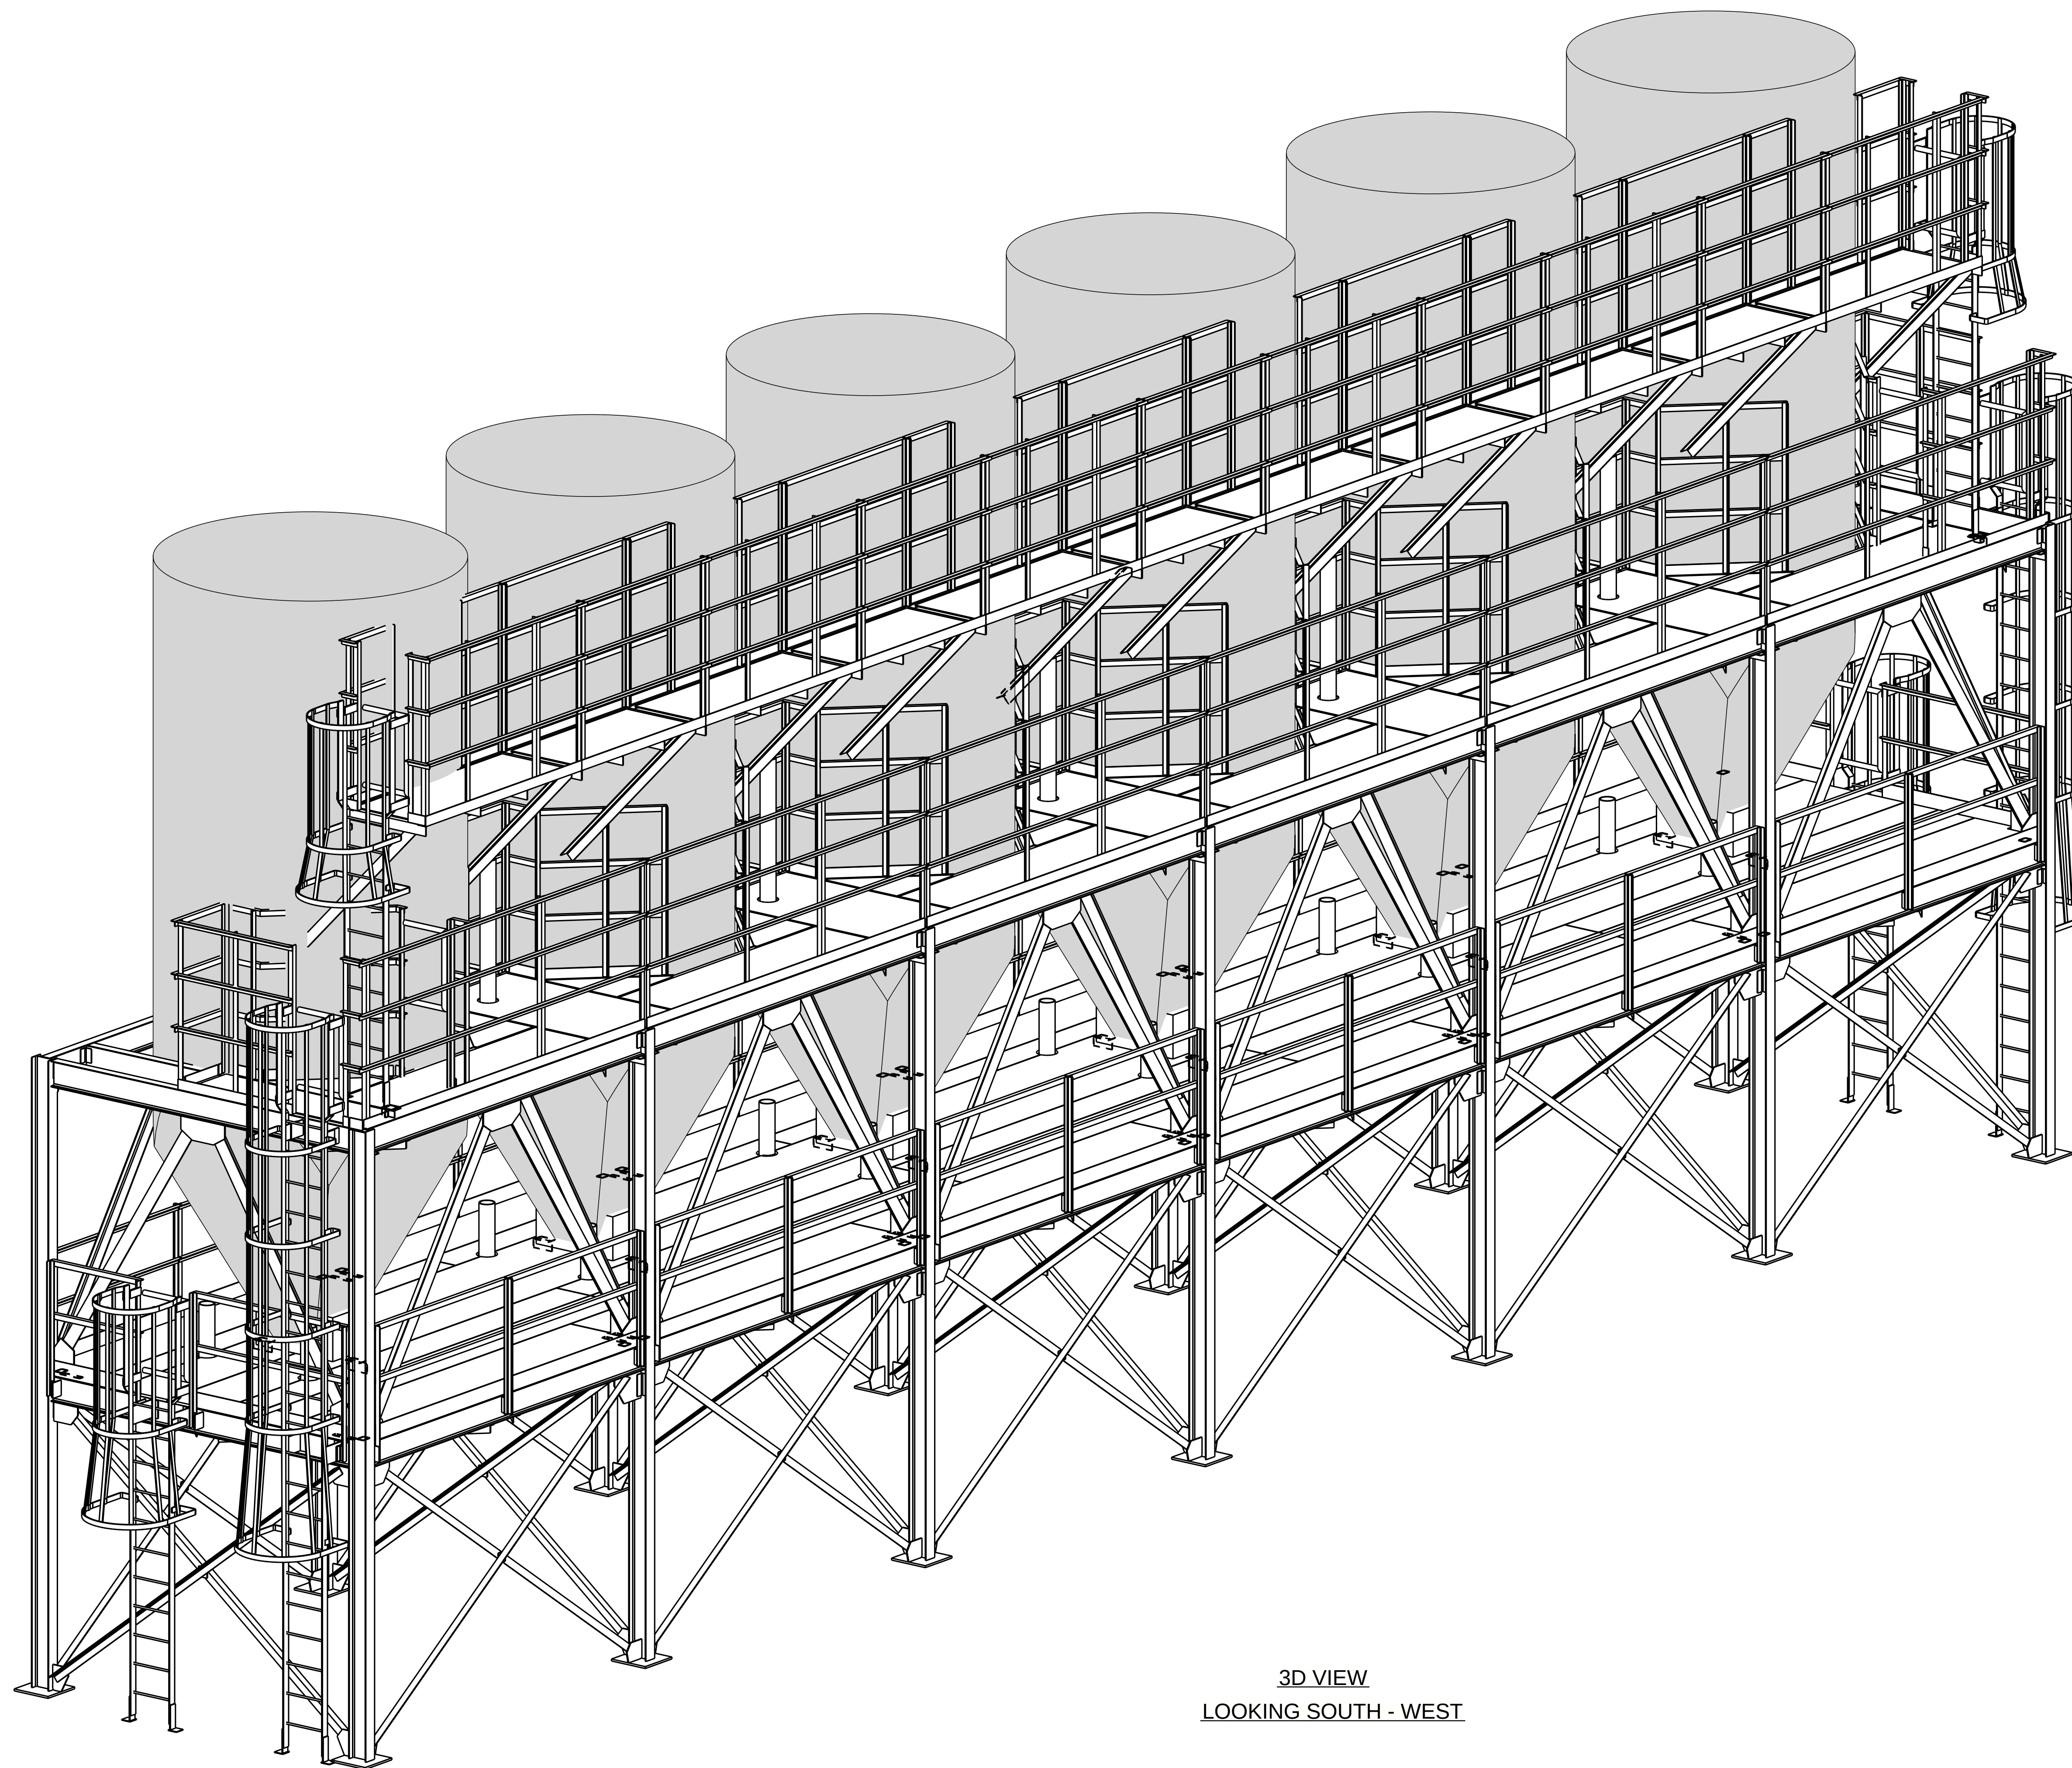

3D VIEW
LOOKING SOUTH - WEST

FINSIH NOTE:-

1. STRUCTURAL STEEL :
TOP COATS : MACRO EPOXY 646
FINISH COAT : ACROLON HS218
COLOR : BEIGE

SURFACE PREPARATION : SSPC-SP6
2. HANDRAILS & LADDERS
TOP COATS : MACRO EPOXY 646
FINISH COAT : ACROLON HS218
COLOUR : SAFETY YELLOW


SURFACE PREPARATION : SSPC-SP6
2. ACCESS PLATFORM FRAMES
TOP COATS : MACRO EPOXY 646
FINISH COAT : ACROLON HS218
COLOUR : SAFETY YELLOW


SURFACE PREPARATION : SSPC-SP6

GENERAL NOTES :

1. ALL ELEVATIONS SHOWN ARE REFERRED FROM FINISH FLOOR EL.= 0'-0"
- 2.THESE DRAWINGS ARE FOR THE ERECTION OF STEEL PROVIDED BY SWANTON WELDING CO. INC. ONLY. NOT FOR OTHER TRADES.
3. ALL FIELD BOLTS TO BE $\frac{3}{4}$ " $\varnothing$ A325N BOLTS UNLESS NOTED OTHERWISE W/ STD. HEX NUT AND HARD FLAT WASHER
4. LLH- INDICATES LONG LEG HORIZONTAL
LLV- INDICATES LONG LEG VERTICAL
5. T/EL.- INDICATES TOP OF ELEVATION
B/EL.- INDICATES BOTTOM OF ELEVATION
6. MATERIAL GRADE USED :
W-SHAPES : ASTM A992,

ANGELS , PLATES AND CHANNELS : ASTM A36

WT-SHAPES : ASTM A992
7.  - INDICATES VERTICAL BRACE.
8.  -INDICATES WORK POINT.
9.  -INDICATES ORIENTATION OF MEMBER.
10. E.O.G - INDICATES EDGE OF GRATING.
11.  -INDICATES GRATING SPAN.

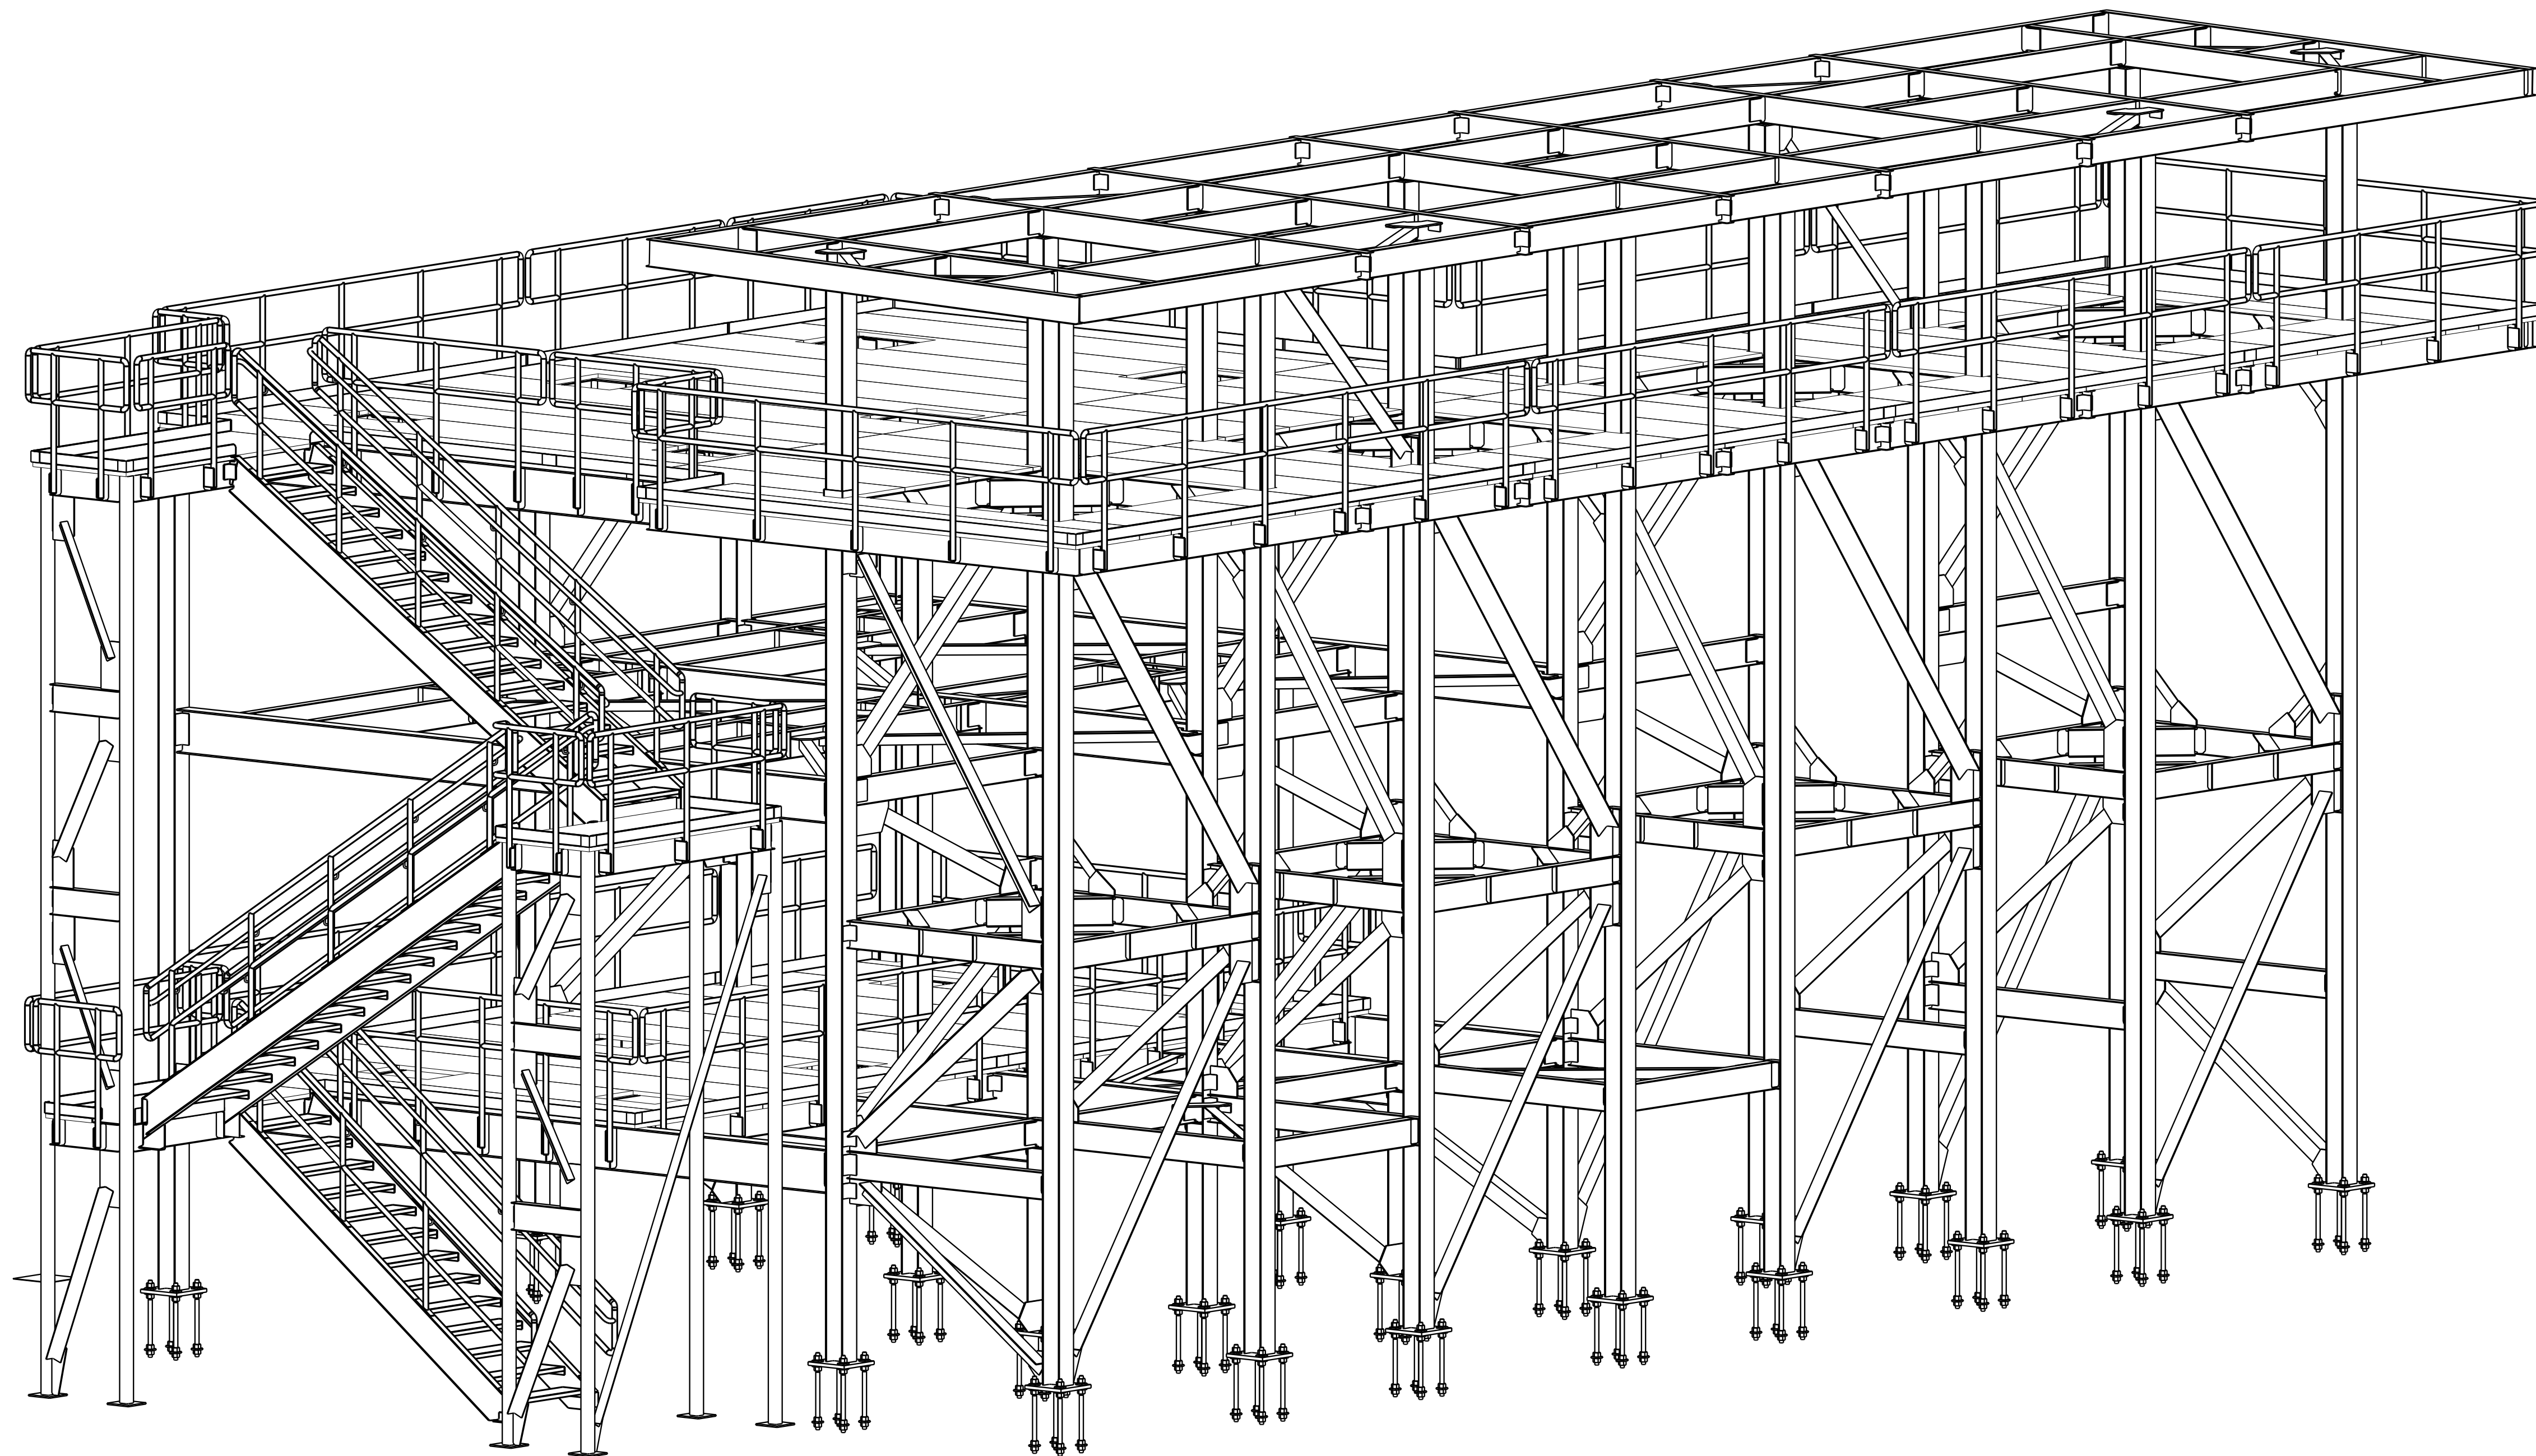


ALL STRUCTURAL STEEL SHALL BE
FULLY HOT-DIPPED GALVANIZED
TYPICAL UNLESS NOTED

GENERAL NOTES:-

- 1) FINISH FLOOR ELEVATION = DATUM ELEVATION = 0'-0" (U.N.O.)
- 2) E.O.A - INDICATES EDGE OF ANGLE.
- 3) ELEVATIONS SHOWN IN PLAN ARE REFERRED TO TOP OF STEEL ELEVATIONS TYPICAL U.N.O.
- 4) (A) INDICATES ABOVE, (B) INDICATES BELOW
- 5) LLV = INDICATES LONG LEG VERTICAL OF ANGLE.
LLH = INDICATES LONG LEG HORIZONTAL OF ANGLE.
LSV = INDICATES LONG SIDE VERTICAL OF HSS MEMBER.
LSH = INDICATES LONG SIDE HORIZONTAL OF HSS MEMBER.
- 6) ▼ INDICATES ORIENTATION MARK
- 7) ► INDICATES MOMENT CONNECTION

ERECTOR NOTES:-

- 1) ALL FIELD BOLTS TO BE $\frac{3}{4}$ " Ø A325N HOT DIPPED GALVANIZE BOLTS UNLESS NOTED OTHERWISE w/ STD. HEX NUT AND HARD FLAT WASHERS.
- 2) REFER TO ERECTION PLANS FOR PIECE MARKS.
- 3) THESE DWGS ARE FOR THE USE OF LOCATING STEEL BY JONQUIL STEEL FABRICATOR AND NOT TO BE USED BY OTHER TRADES
- 4) STRUCTURAL STEEL:-
W-SHAPES: ASTM A992
ANGLES, PLATE & BAR: ASTM A36
ALL STEEL PIPE: ASTM A53 GRADE-B
HOLLOW STRUCTURAL SECTIONS: ASTM A500 GRADE B

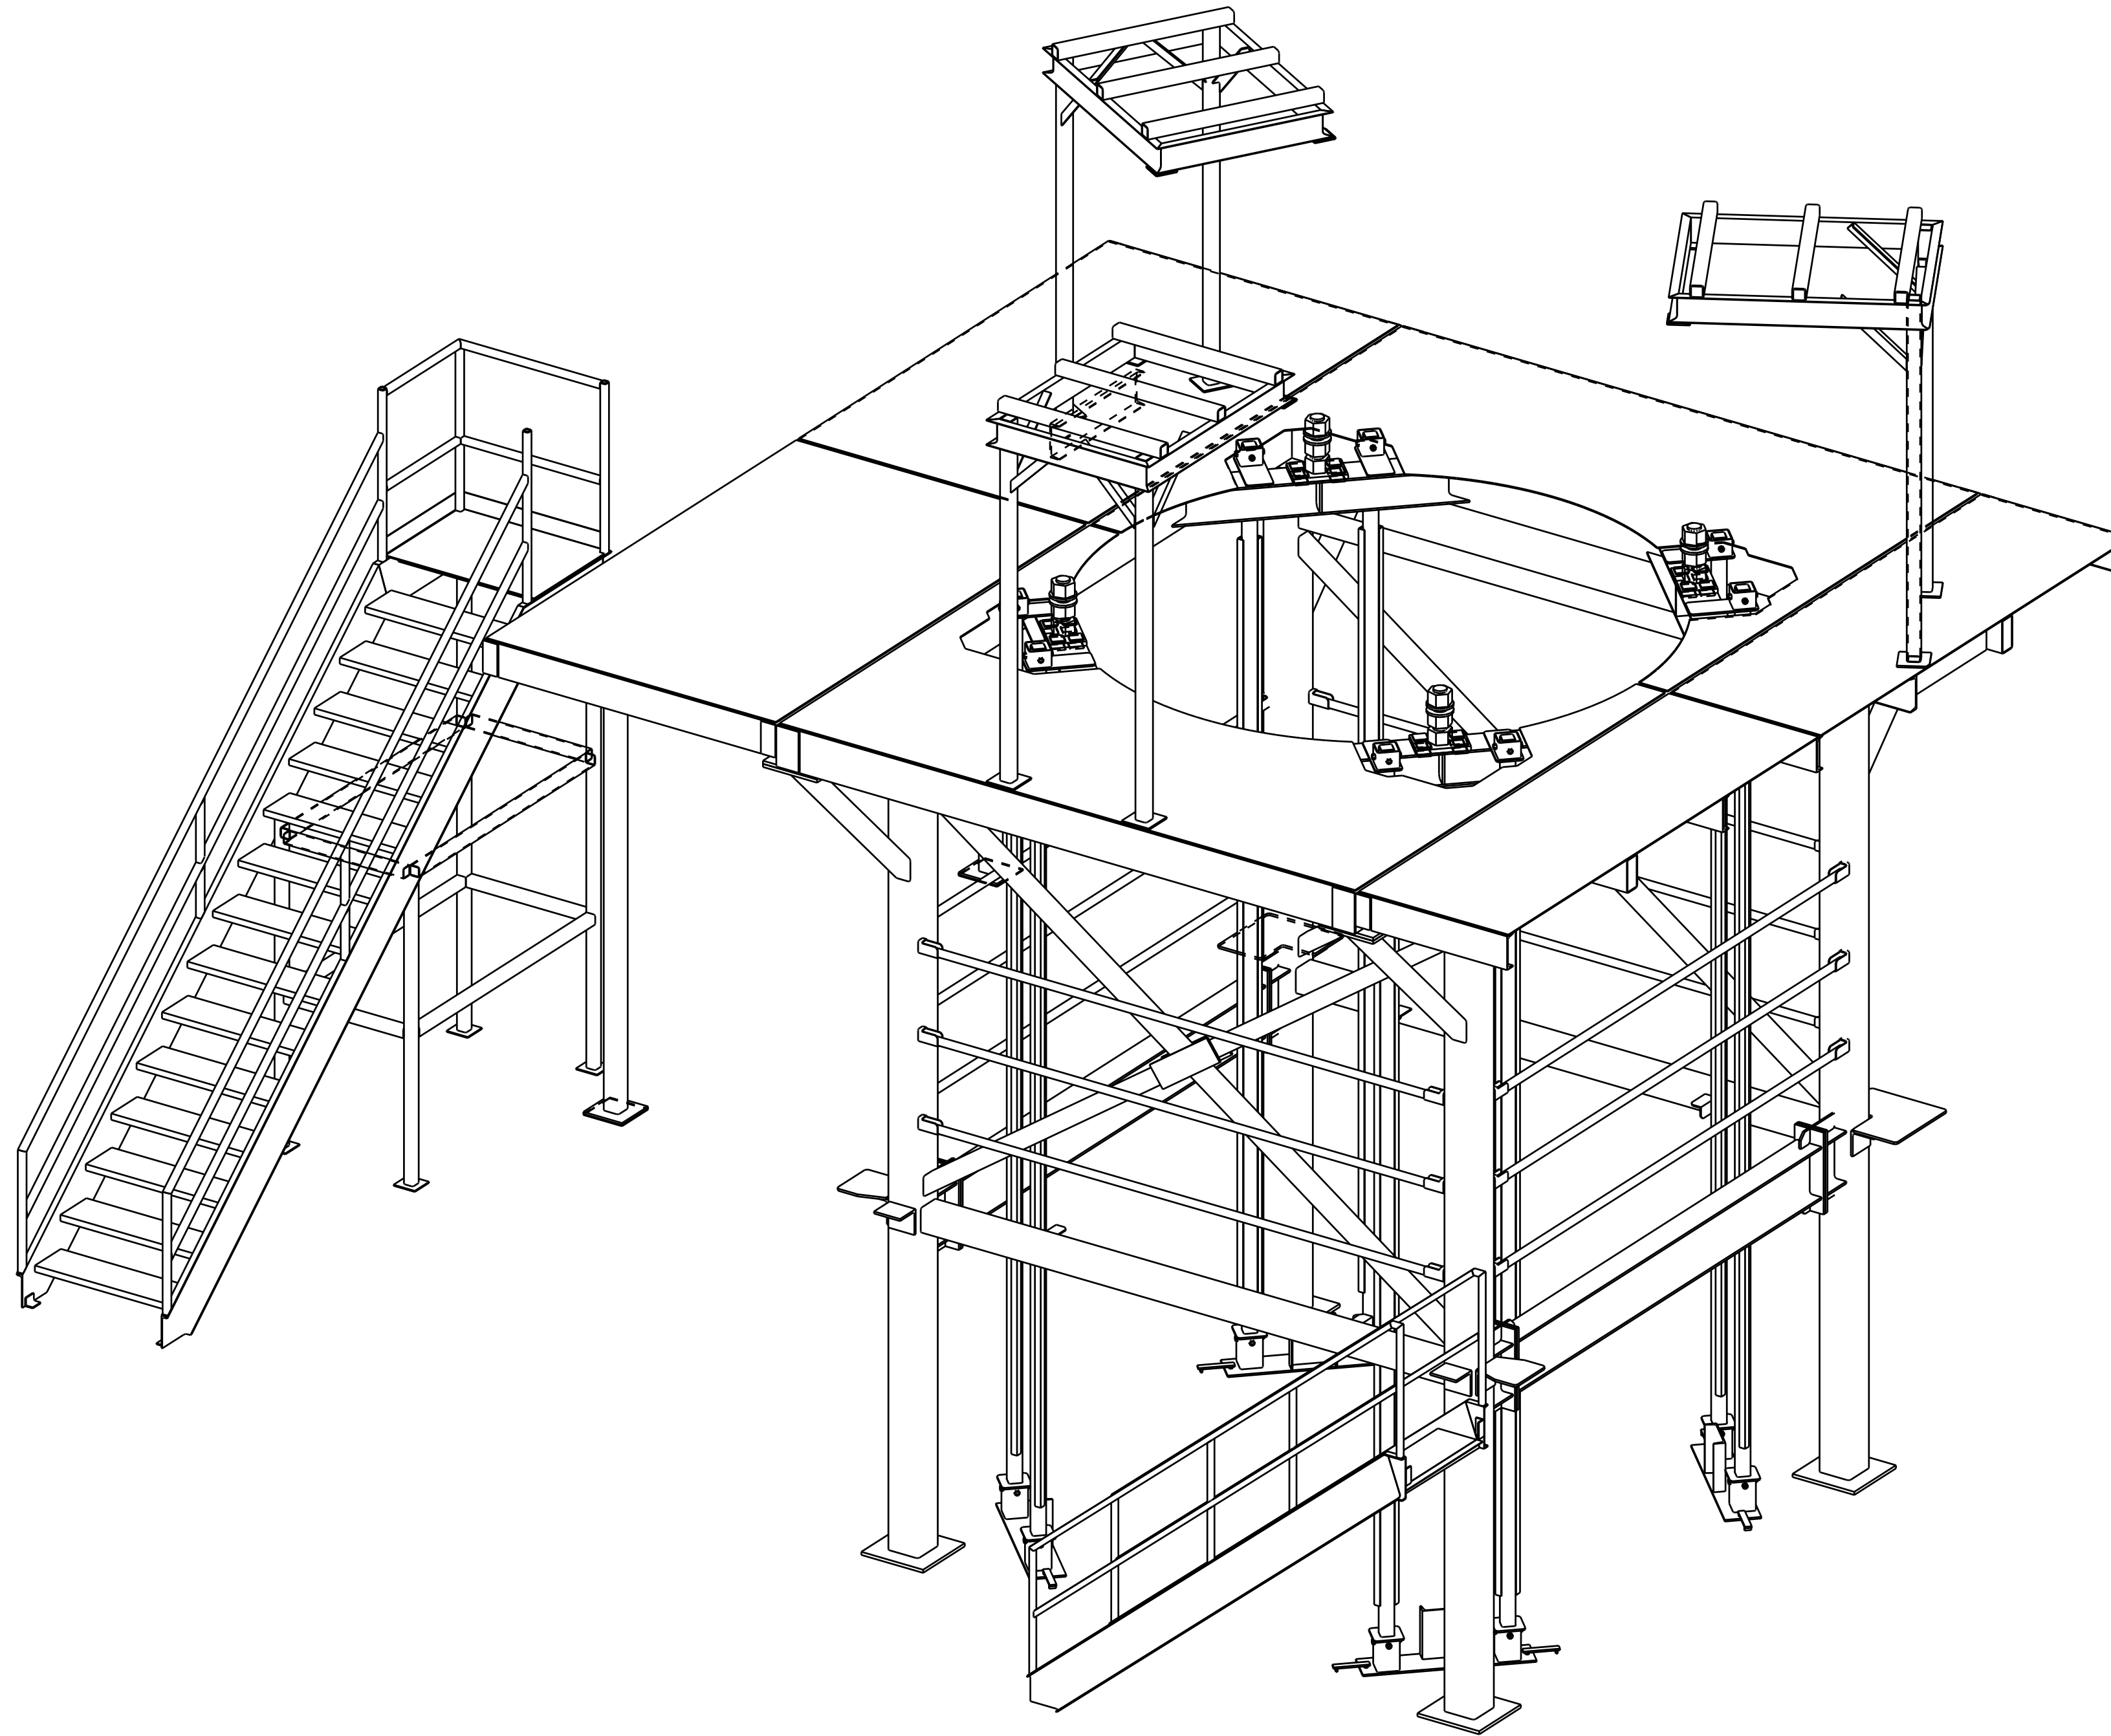


3D VIEW

NOTES :-

1. TOP OF FINISH FLOOR ELEVATION 0'-0" = DATUM ELEVATION.
2. THESE DRAWINGS ARE FOR THE ERECTION OF STEEL PROVIDED BY PIP'S IRON WORK INC. ONLY. NOT FOR USE BY OTHER TRADES.
3. ALL MATERIAL TO BE AS FOLLOWS:
STRUCTURAL W-BEAM STEEL : ASTM -A992
PLATES, ANGLES AND CHANNELS: ASTM A36
TUBE SHAPES: ASTM A500 GR. C
5. V.B - INDICATES VERTICAL BRACE.
6. (A)- INDICATES ABOVE, (B)- INDICATES BELOW.
7. T/EL / B/EL - INDICATES TOP ELEVATION / BOTTOM ELEVATION
8. ALL STRUCTURAL STEEL SHOP AND FIELD BOLTS TO BE $\frac{3}{4}$ " $\varnothing$ A325N BOLTS (BLACK) UNLESS NOTED OTHERWISE w/STD. HEX NUT AND HARD FLAT WASHERS.

FINISH NOTE:-

PAINT : ONE SHOP COAT MACROPOXY 646 (4-6 MILS DFT)
SURFACE PREPARATION : SSPC SP-6

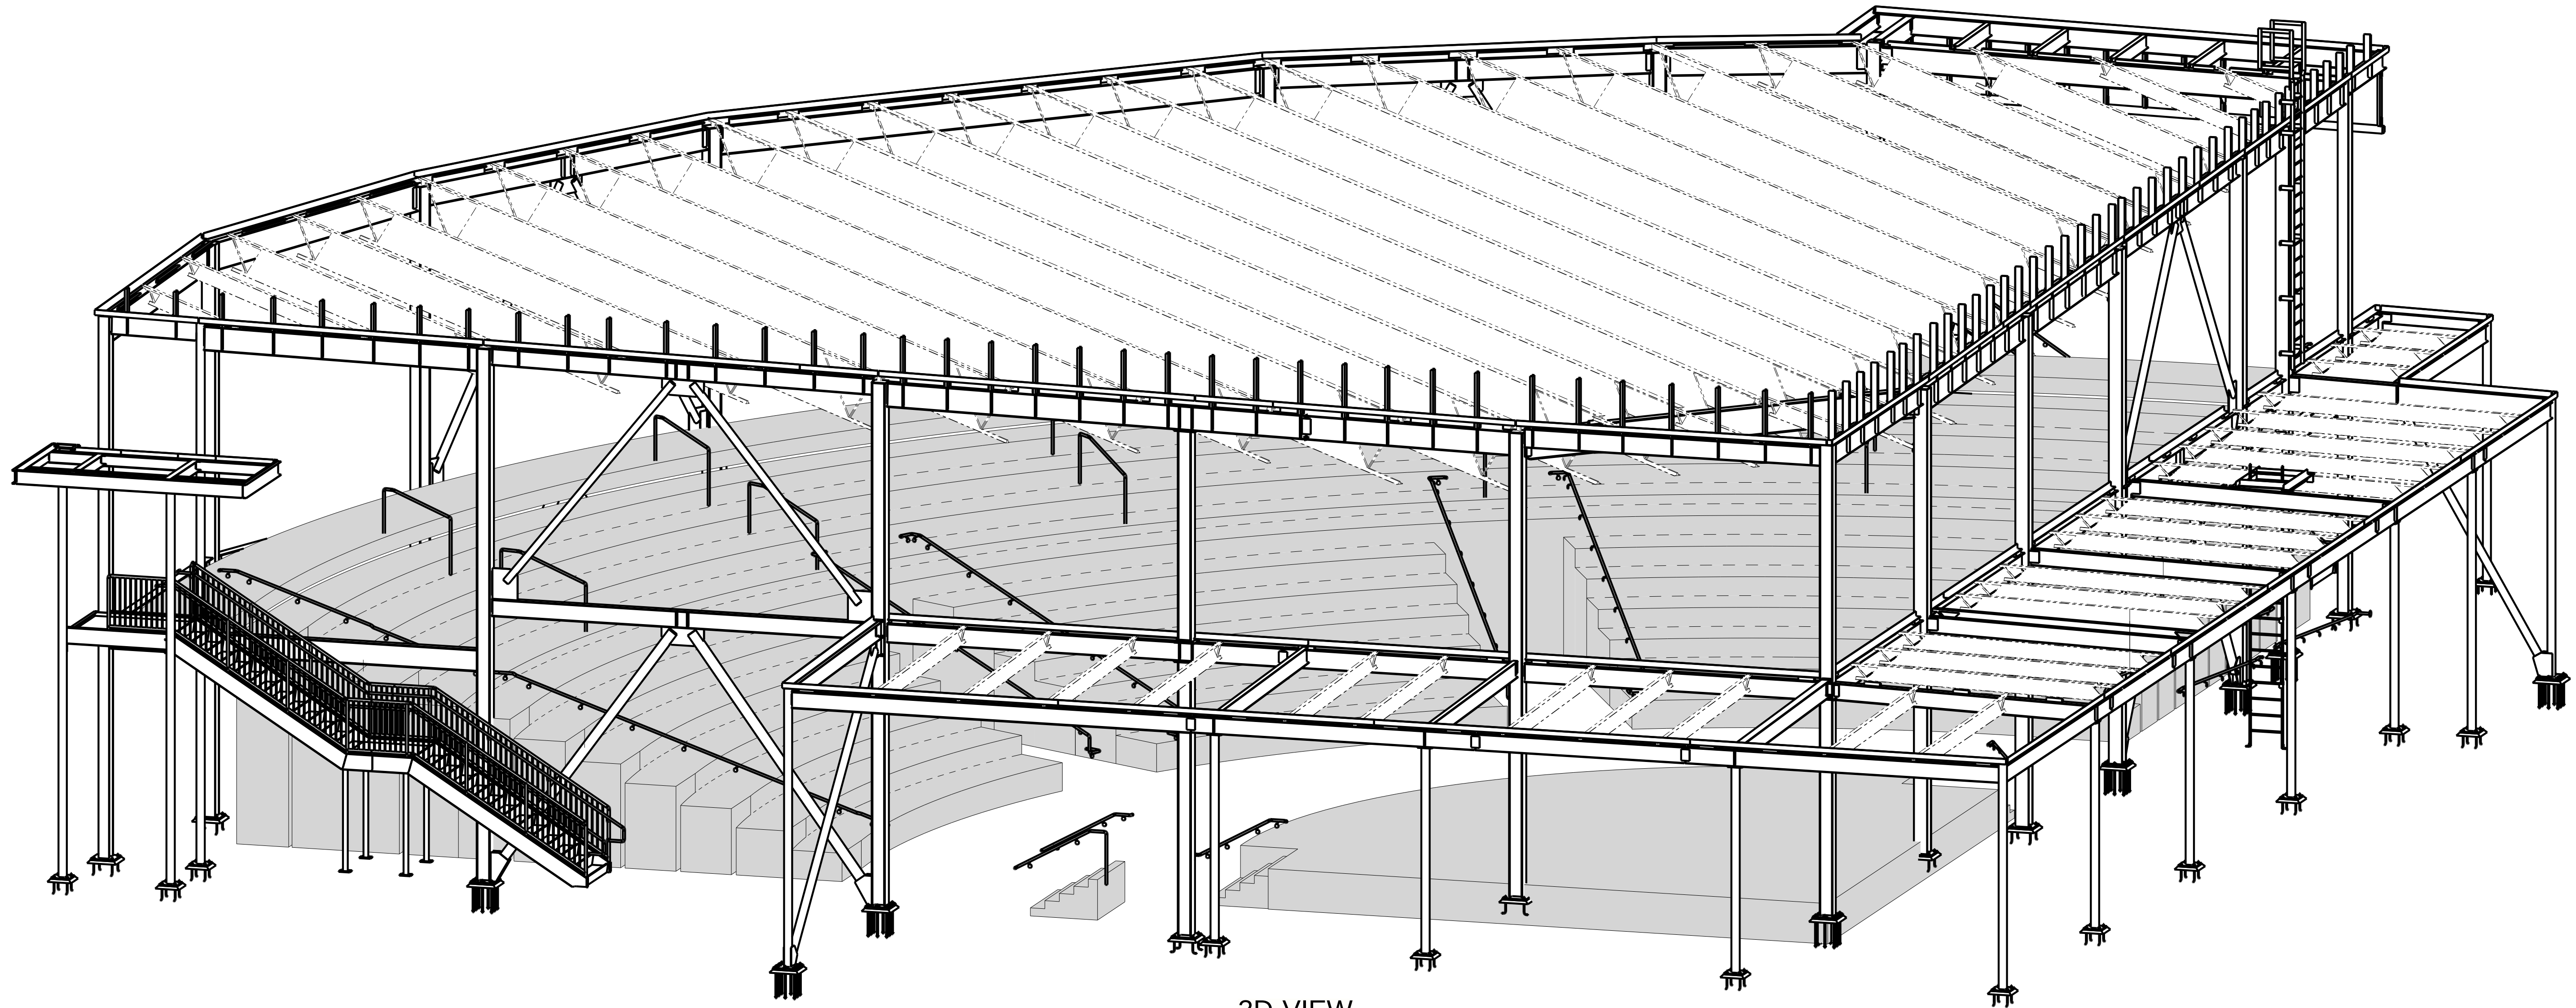

3D-VIEW

ERECTOR NOTES :-

1. FINISH FLOOR ELEVATION = DATUM ELEVATION = 0'-0" (U.N.O.)
2. THESE DRAWINGS ARE FOR THE ERECTION OF STEEL PROVIDED BY JONQUIL STEEL, AND NOT TO BE USED BY OTHER TRADES.
3. REFER TO ERECTION PLANS FOR PIECE MARKS AND OTHERS INFORMATIONS.
4. (S) - INDICATES SLOPES, (B) - INDICATES - BELOW, (A) - INDICATES - ABOVE.
(LLV) - LONG LEG VERTICAL, (LLH) - LONG LEG HORIZONTAL,
(LSV) - LONG SIDE VERITICAL, (LSH) - LONG SIDE HORIZONTAL.
5. E.O.A - INDICATES EDGE OF ANGLE.
6. ◀ - INDICATES ORIENTATION OF MEMBER
7. ▶ - INDICATES MOMENT CONNECTION
8. ALL HEADED SHEAR STUDS WILL BE $\frac{3}{4}$ " $\varnothing$ X0'-8" (L.G)
DO NOT USE PLUG WELD TO ATTACH HEADED STUDS
TO STEEL BEAM. USE AUTOMATIC STUD WELDING
GUN WITH CERAMIC FERRULES AT ALL HEADED
STUDS TYPICAL.

ALL STRUCTURAL STEEL WILL RECEIVE ONE SHOP COAT
STANDARD GRAY PRIMER.
TYPICAL UNLESS NOTED OTHERWISE.

SURFACE PREPARATION : SSPC-SP2


ALL AESS CATEGORY 1 (ARCHITECTURALLY EXPOSED STRUCTURAL STEEL)
MEMBERS WILL RECEIVE TNEDEC SERIES V10 PAINT.

SURFACE PREPARATION : SSPC-SP6

REFER PLAN AND ELEVATION FOR NOTED.

ERECTOR NOTES:

- 1) ALL FIELD BOLTS TO BE $\frac{3}{4}$ " $\varnothing$ A325N BOLTS w/STD. HEX NUT
AND HARD FLAT WASHERS TYPICAL UNLESS NOTED OTHERWISE.
2. STRUCTURAL STEEL:-
W-SHAPES: ASTM A992
ANGLES, PLATE & BAR : ASTM A36
HOLLOW STRUCTURAL SECTIONS : ASTM A500 GRADE 50

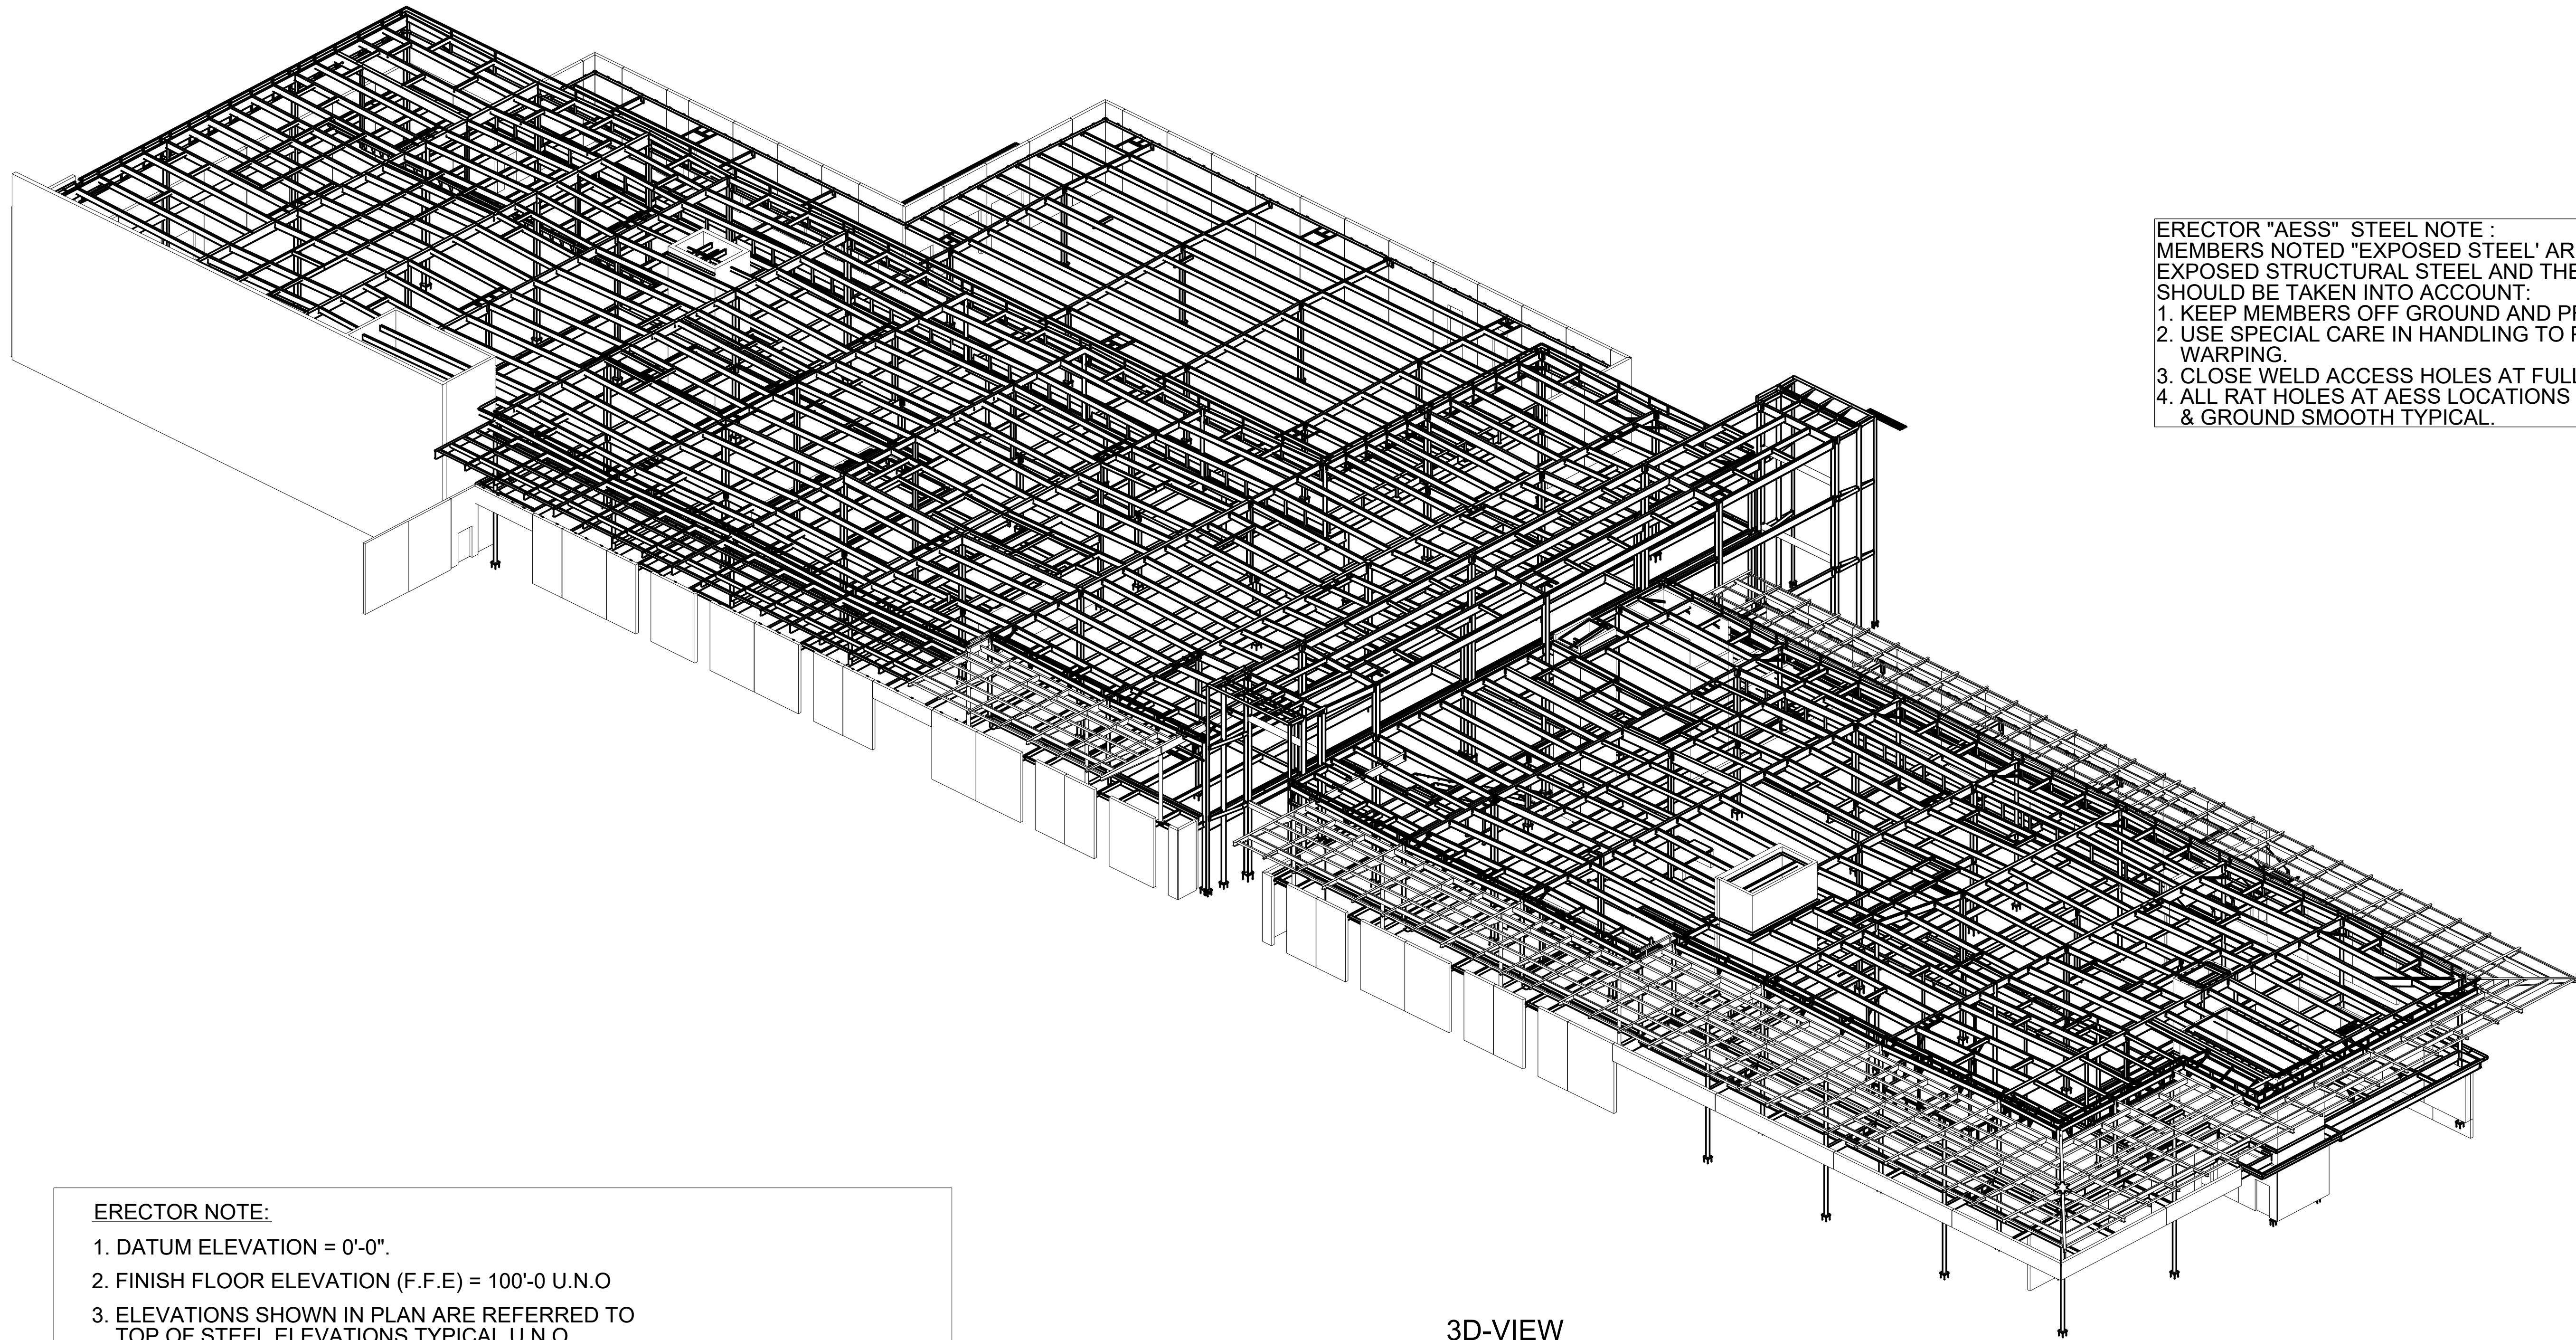


ERECTOR "AESS" STEEL NOTE :
 MEMBERS NOTED "EXPOSED STEEL" ARE "AESS" ARCHITECTURALLY
 EXPOSED STRUCTURAL STEEL AND THE FOLLOWING SPECIAL CARE
 SHOULD BE TAKEN INTO ACCOUNT:
 1. KEEP MEMBERS OFF GROUND AND PROTECT FROM EROSION.
 2. USE SPECIAL CARE IN HANDLING TO PREVENT TWISTING OR
 WARPING.
 3. CLOSE WELD ACCESS HOLES AT FULL PEN WELDS.
 4. ALL RAT HOLES AT AESS LOCATIONS NEED TO BE FILLED
 & GROUND SMOOTH TYPICAL.

ERECTOR NOTE:

1. DATUM ELEVATION = 0'-0".
2. FINISH FLOOR ELEVATION (F.F.E) = 100'-0 U.N.O
3. ELEVATIONS SHOWN IN PLAN ARE REFERRED TO
TOP OF STEEL ELEVATIONS TYPICAL U.N.O.
4. ["XX" CAMBER] - INDICATES CAMBER VALUE IN BEAM.
6. E.O.A - INDICATES EDGE OF ANGLE,
E.OB.PL. - INDICATES EDGE OF BENT PLATE
7. (XX) - INDICATES NO. OF 3/4 "ØX5" HEADED SHEAR STUDS
WELDED TO TOP FLANGE OF STEEL BEAM.
8. ALL FIELD BOLTS TO BE 3/4 "Ø A325N TC BOLTS
UNLESS NOTED OTHERWISE w/ STD. HEX NUT
AND HARD FLAT WASHERS.
9. W-SHAPES : ASTM A992.
PLATES, ANGLES & CHANNELS : ASTM A36.
HSS TUBES & PIPES : ASTM A500, GRADE B
10. THESE DWGS ARE FOR THE USE OF LOCATING STEEL BY HASKELL.CO
FABRICATOR AND NOT TO BE USED BY OTHER TRADES.
11. ALL EXPOSED STEEL WILL BE HOT DIPPED
GALVANIZED UNLESS NOTED.
12. ALL STRUCTURAL STEEL SHALL BE ONE SHOP
COAT PRIMER TYPICAL UNLESS NOTED

3D-VIEW
 SOUTH - EAST DIRECTION

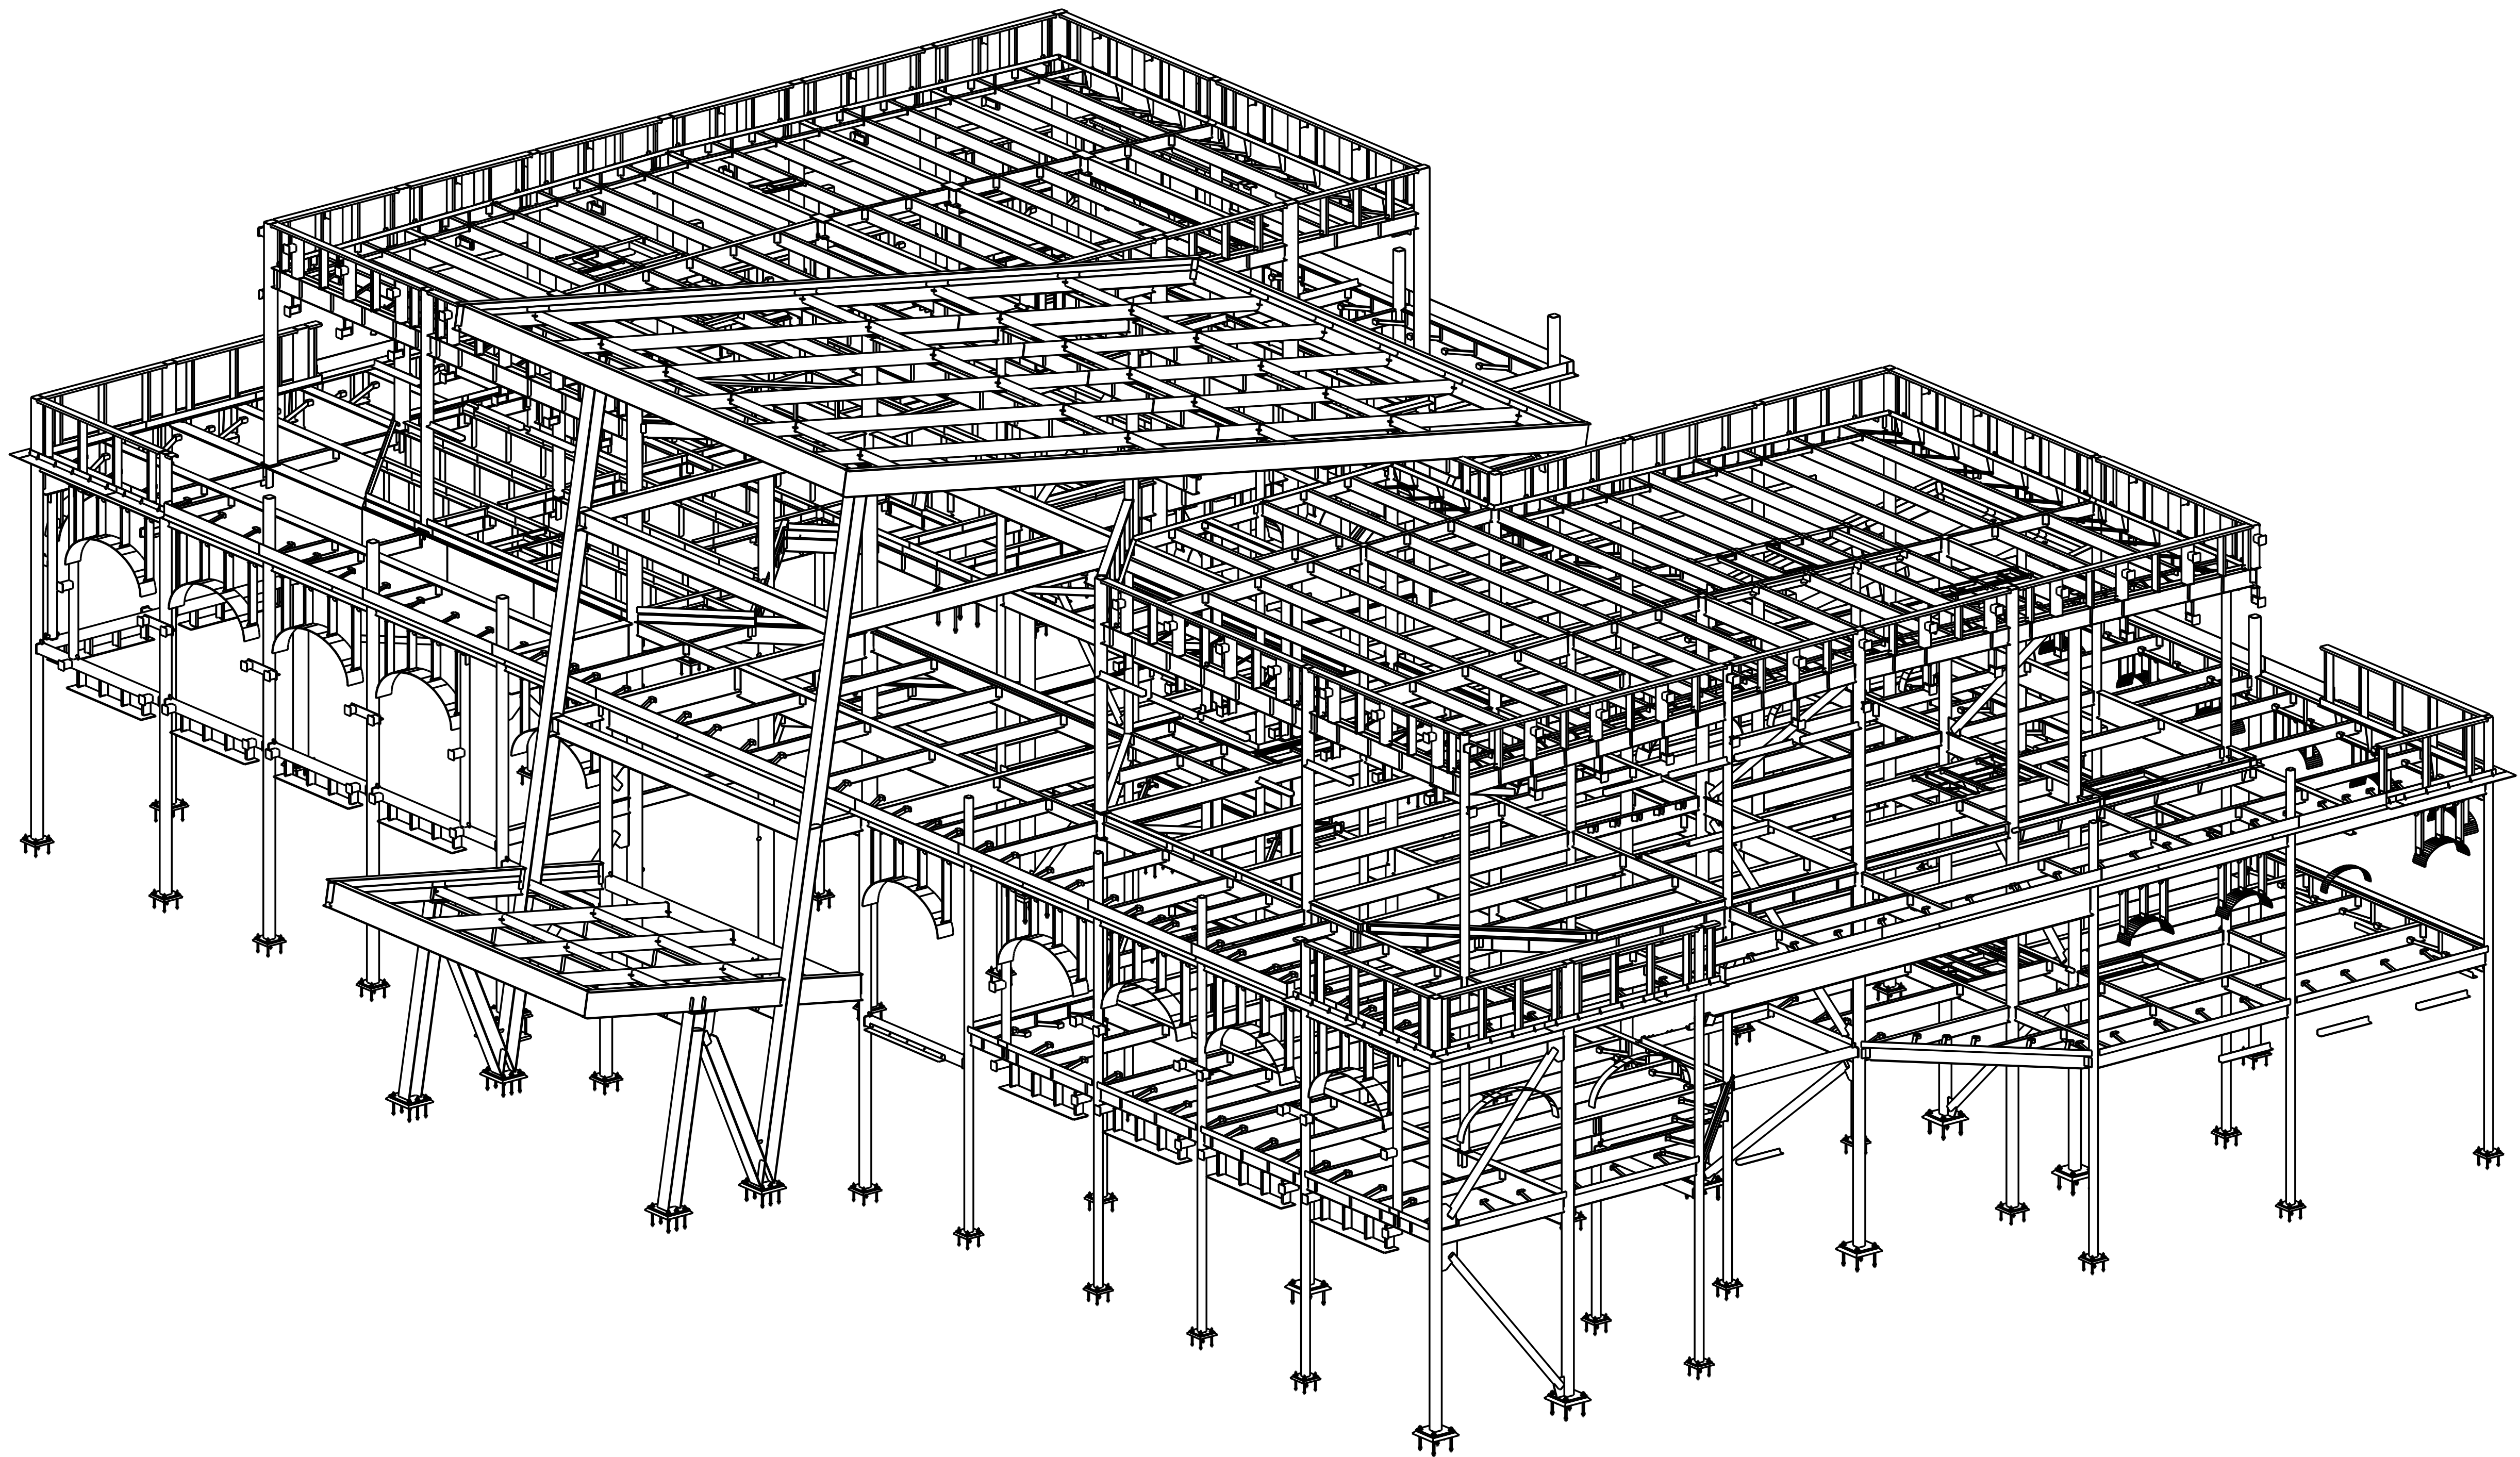

3D VIEW

GENERAL NOTES :-


- 1) DATUM ELEVATION = 0'-0" U.N.O.
- 2) E.O.A - INDICATES EDGE OF ANGLE.
E.O.BPL - INDICATES EDGE OF BENT PLATE.
- 3) ELEVATIONS SHOWN IN PLAN ARE REFERRED TO TOP OF STEEL ELEVATIONS TYPICAL U.N.O.
- 4) REFER E160 & E161 SHEETS FOR TYPICAL SECTIONS & DETAILS.
- 5) LLV = INDICATES LONG LEG VERTICAL OF ANGLE/BENT PLATE
LLH = INDICATES LONG LEG HORIZONTAL OF ANGLE/BENTPLATE
LSV = INDICATES LONG SIDE VERTICAL OF HSS MEMBER.
LSH = INDICATES LONG SIDE HORIZONTAL OF HSS MEMBER.
- 6) A = INDICATES ABOVE, B = INDICATES BELOW.
S = INDICATES SLOPE, D = INDICATES DIAGONAL.
- 7) (XX) - INDICATES QUANTITY OF $\frac{3}{4}$ " $\varnothing$ X 4" LONG SHEAR STUDS WELDED TO TOP FLANGE OF STEEL BEAM, REFER STUD DRAWING SHEETS FOR QUANTITY OF STUD AND DETAILS.
- 8) ▼ - INDICATES ORIENTATION MARK OF MEMBERS.
- 9) ► - INDICATES ORIENTATION MARK OF MEMBERS.
- 10) ● - INDICATES DRAG CONNECTION. DESIGN CONNECTIONS FOR AXIAL FORCES INDICATED ON PLAN AND IN ELEVATIONS.
- 11) V.B - INDICATES VERTICAL BRACE.

ALL FLOOR AND ROOF SUPPORTING STEEL FRAMING WILL RECEIVE ONE SHOP COAT STANDARD PRIMER.

ALL BRICK RELIEF ANGLES/PLATES AND LINTEL ANGLES ARE HOT DIPPED GALVANIZED STEEL WILL BE PREPPED FOR PAINT TYPICAL UNLESS NOTED.

ERECTOR NOTE :

- 1) ALL FIELD BOLTS TO BE $\frac{3}{4}$ " $\varnothing$ A325N. TC BOLTS TIGHTENING SHALL BE SNUG-TIGHT UNLESS NOTED OTHERWISE w/ STD. HEX NUT AND HARD FLAT WASHERS.
BOLT TIGHTENING SHALL BE SNUG-TIGHT U.N.O.
- 2) REFER TO ERECTION PLANS FOR PIECE MARKS.
- 3) THESE DWGS ARE FOR THE USE OF LOCATING STEEL BY JONQUIL STEEL FABRICATOR AND NOT TO BE USED BY OTHER TRADES
- 4) W-SHAPES: ASTM A992 GRADE 50
CHANNELS, ANGLES, PLATE & BAR : ASTM A36.
HOLLOW STRUCTURAL SECTIONS:
ASTM A500-GRADE C

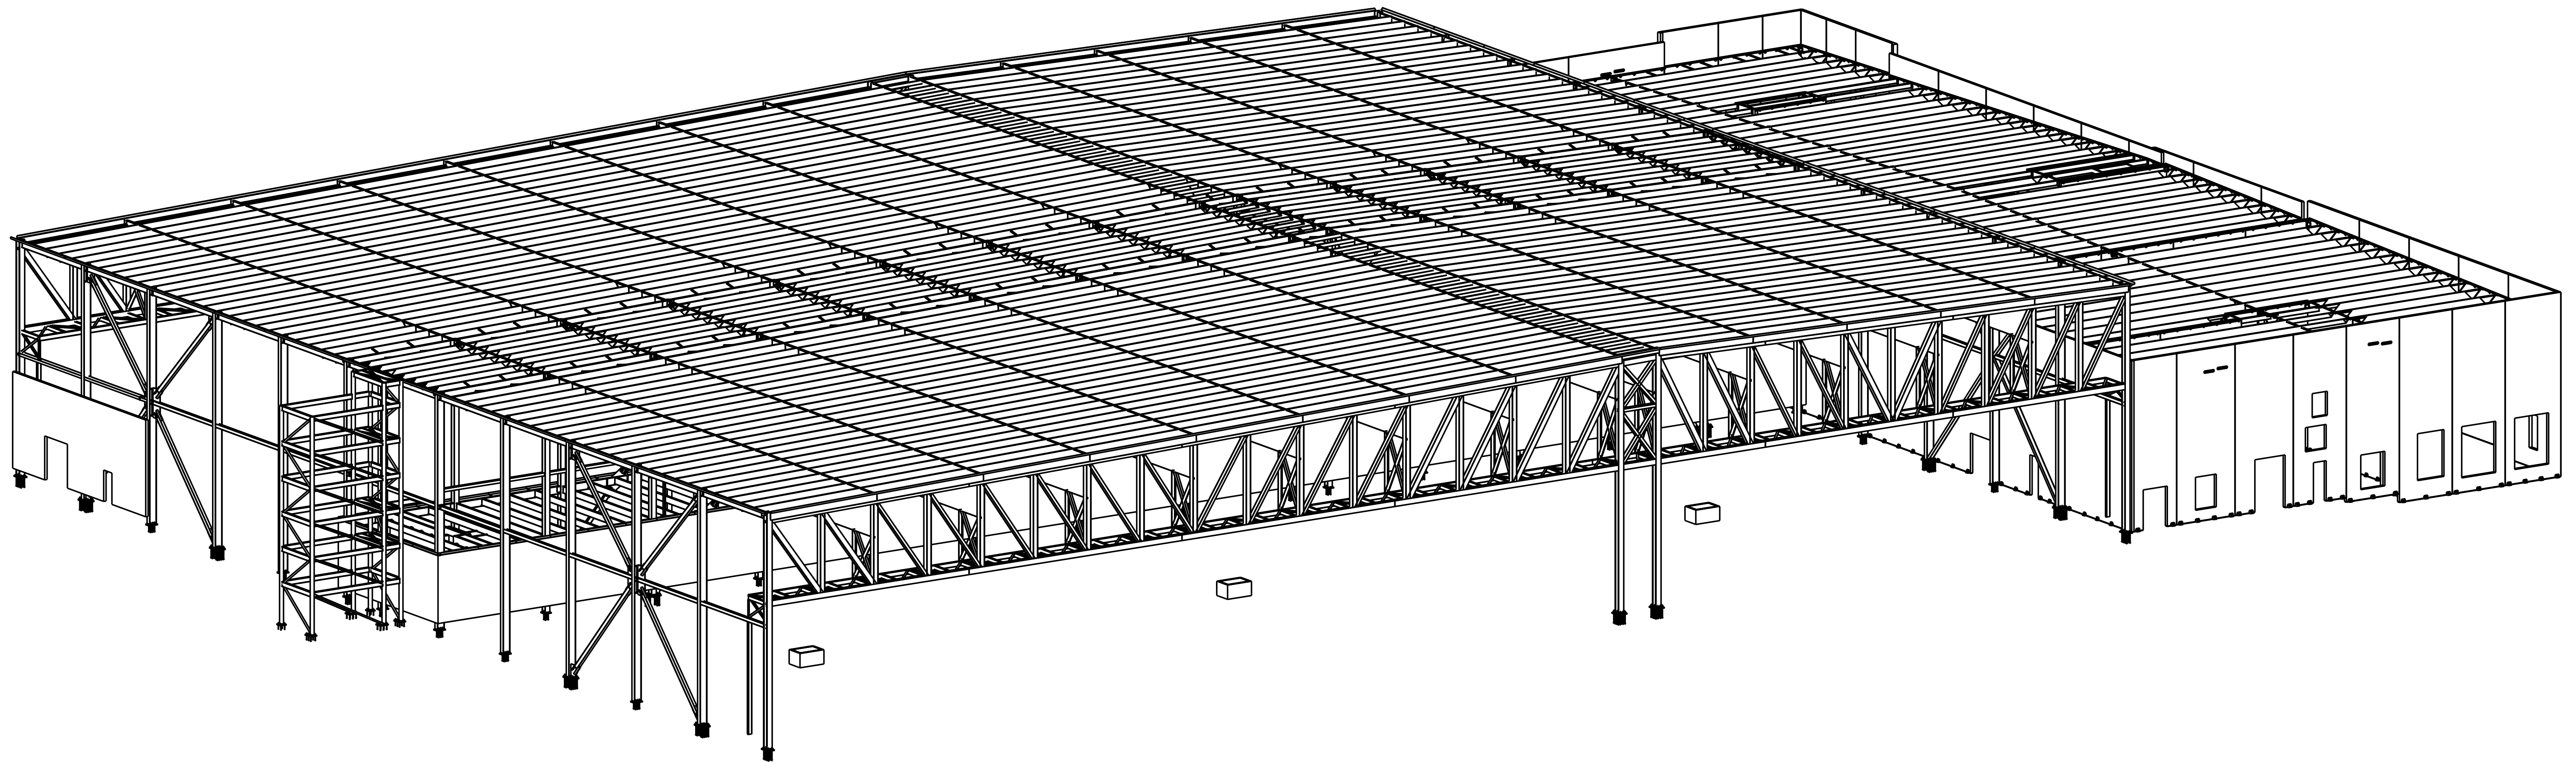


3D VIEW


ALL STRUCTURAL FRAMING STEEL WILL RECEIVE
ONE SHOP COAT STANDARD PRIMER
AND SURFACE PREPERATION WILL BE SSPC-SP3
TYPICAL UNLESS NOTED.

GENERAL NOTES :-

1. DATUM ELEVTION =FINISHED FLOOR ELEVATION = 100'-0" U.N.O
2. ELEVATIONS SHOWN IN PLAN ARE REFERRED TO
TOP OF STEEL ELEVATIONS TYPICAL U.N.O.
3. REFER E120 SHEETS FOR TYPICAL SECTIONS & DETAILS.
4. ALL FIELD BOLTS TO BE $\frac{3}{4}$ " $\varnothing$ A325N_TC
BOLTS UNLESS NOTED OTHERWISE w/ HEAVY HEX NUT
AND HARD FLAT WASHERS.
5. W-SHAPES : ASTM A992.
PLATES , ANGLES & CHANNELS : ASTM A36. (U.N.O)
6. THESE DWGS ARE FOR THE USE OF LOCATING STEEL BY HASKELL CO
FABRICATER AND NOT TO BE USED BY OTHER TRADERS.
7. (XX) - INDICATES QUANTITY OF $\frac{3}{4}$ " $\varnothing$ X 4 $\frac{1}{2}$ HEADED STUDS (EQUALLY SPACED)
8. (S) - DENOTES SLOPING MEMBER.
9. E.O.A - INDICATES EDGE OF ANGLE.
10. V.B - DENOTES VERTICAL BRACING.
11. (D) - DENOTES DIAGONAL BRACING.
12. E.O.BPL. - INDICATES EDGE OF BENT PLATE.

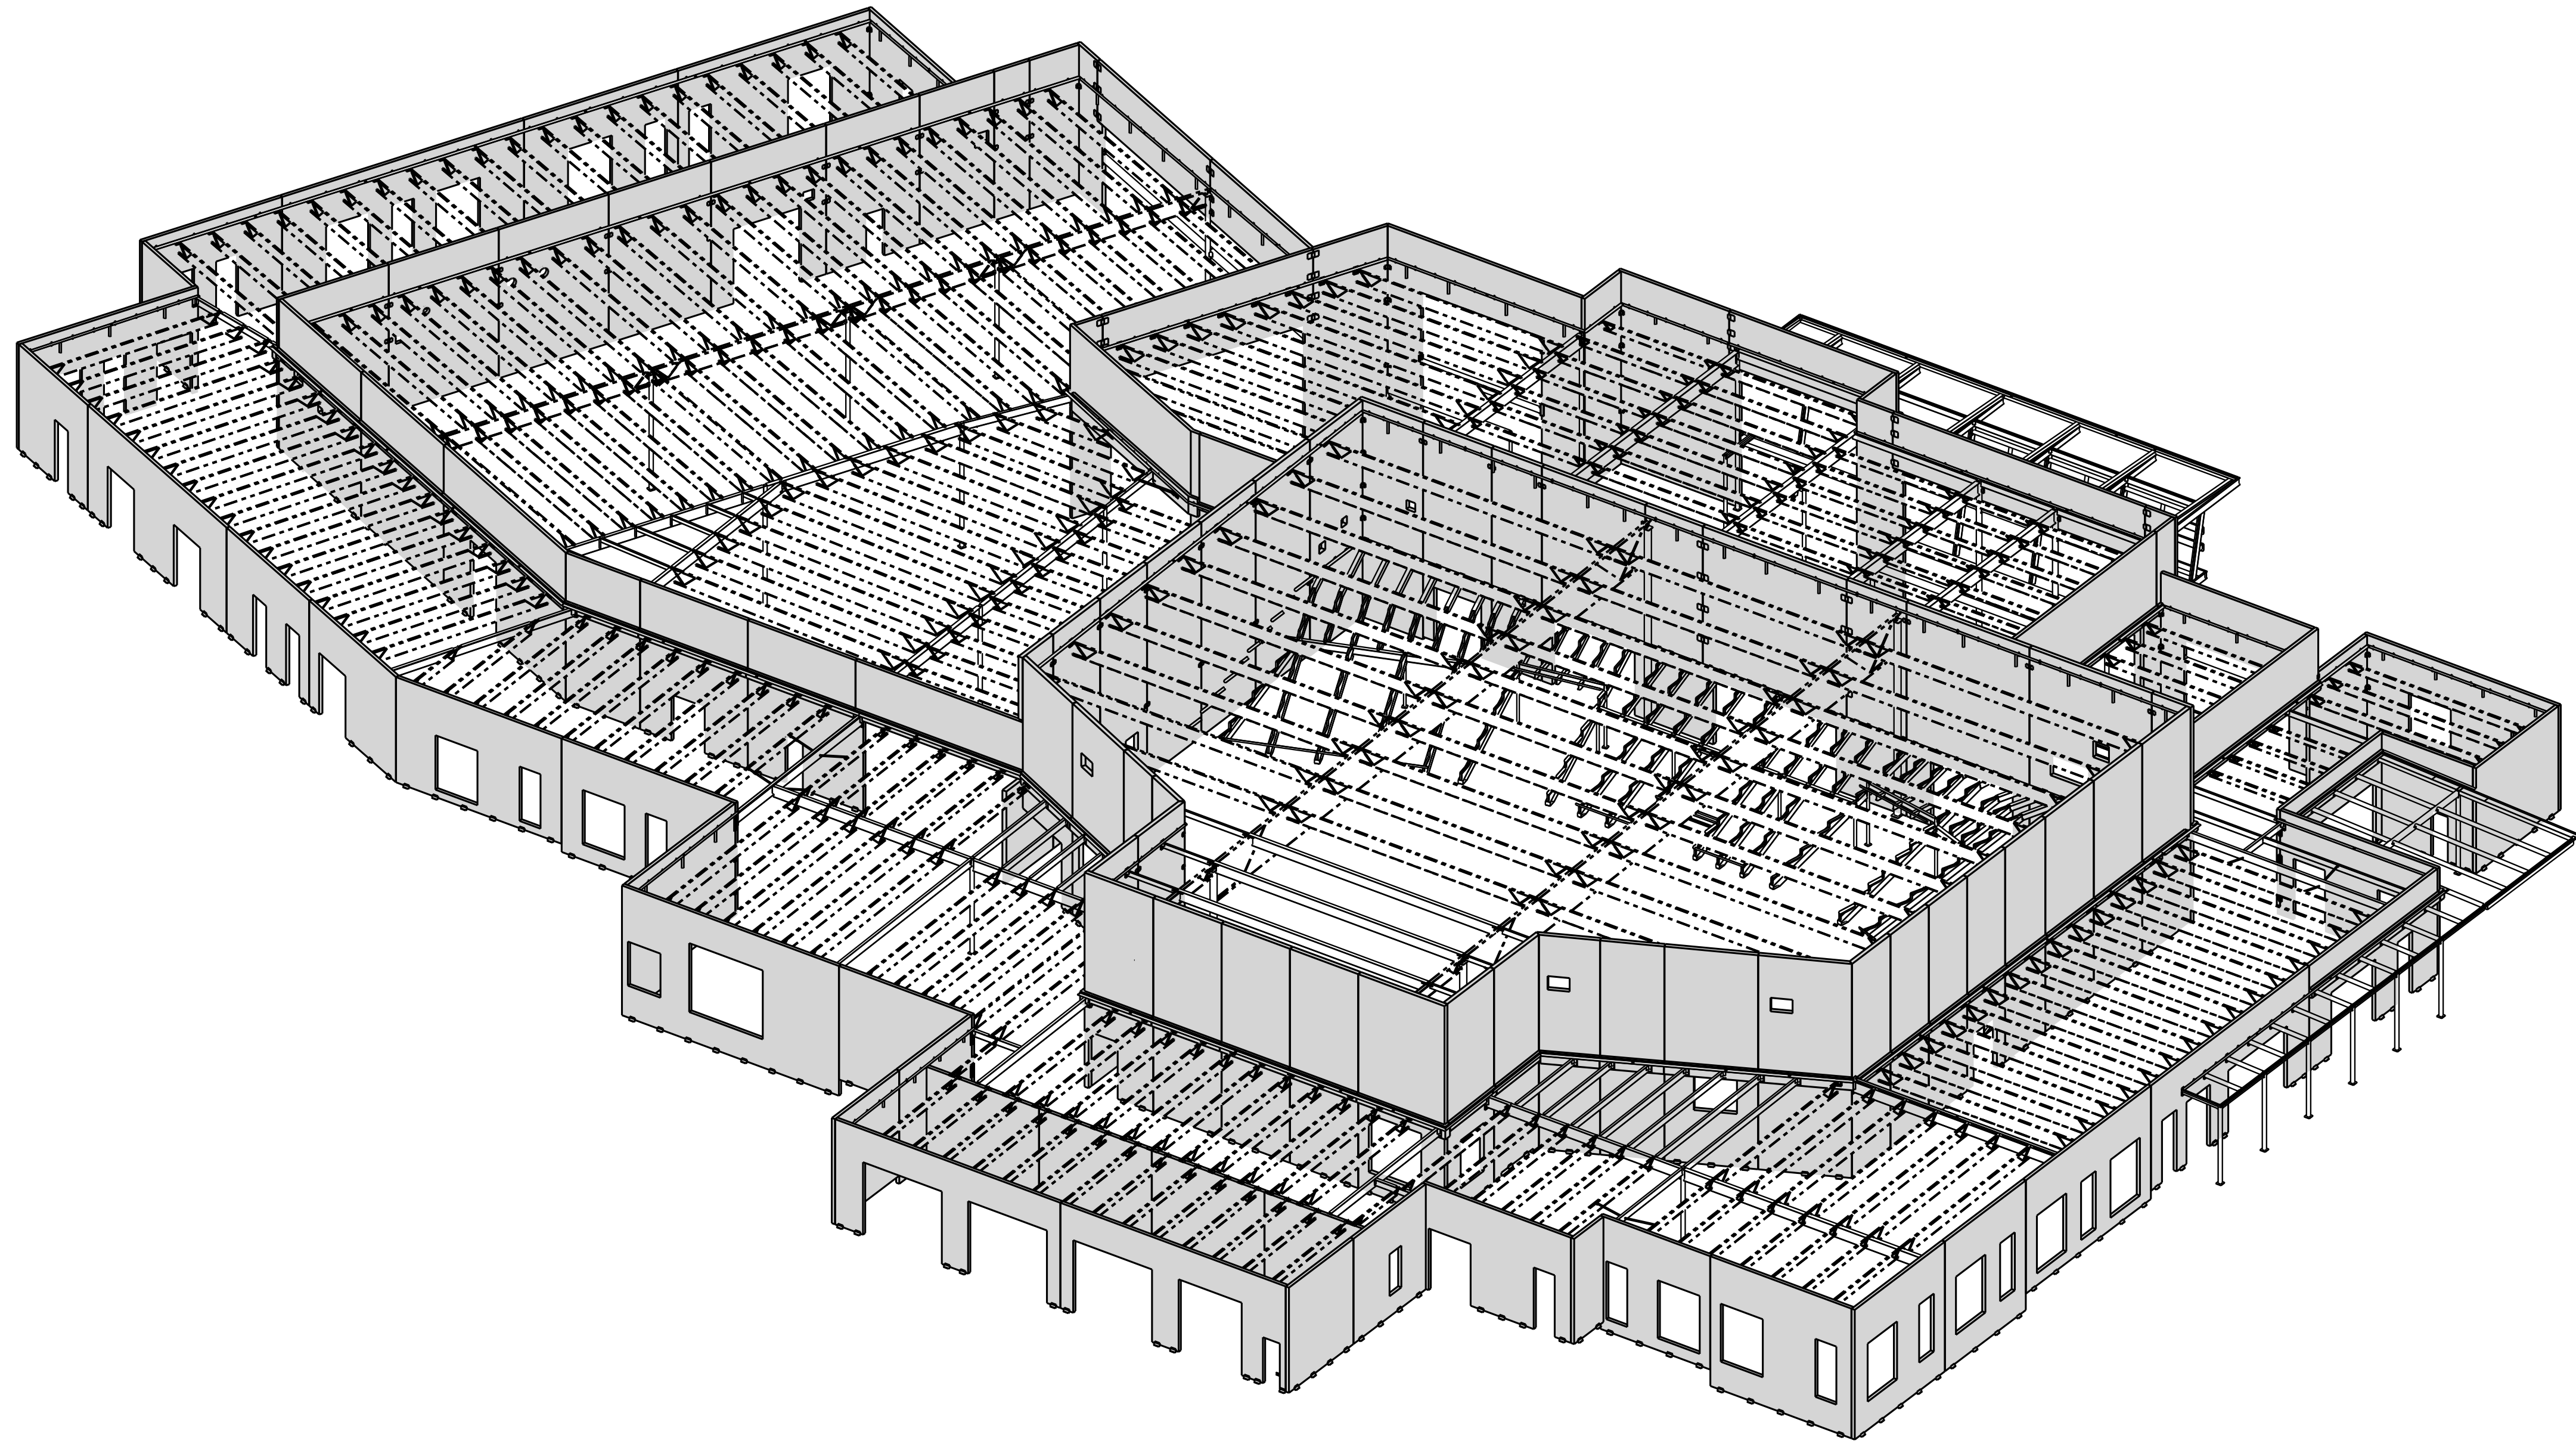

3D - VIEW
BETHLEHEM CHURCH
MAIN CAMPUS - MAIN BUILDING

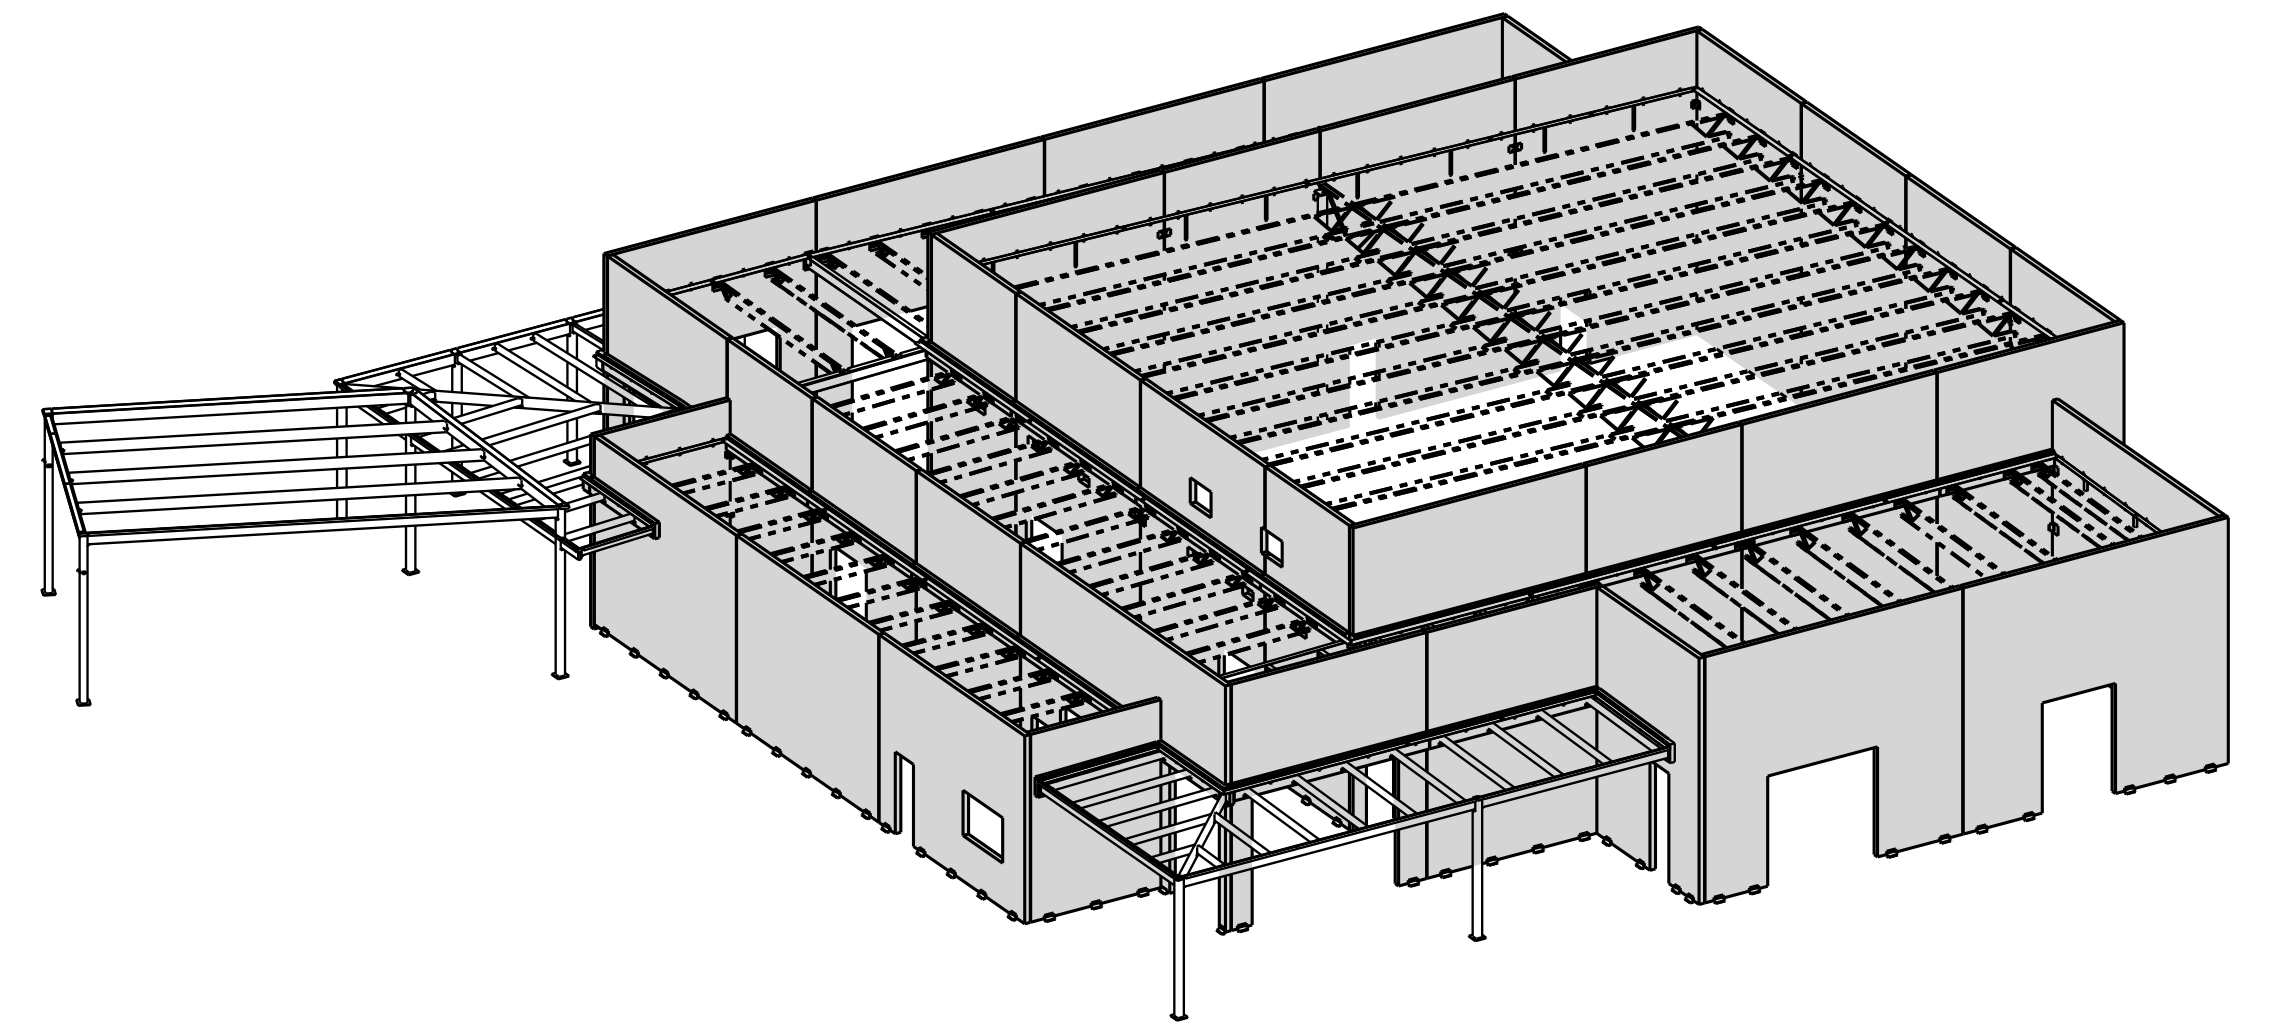


3D - VIEW
BETHLEHEM CHURCH
MAIN CAMPUS - STUDENT BUILDING

ERECTOR NOTES :-

1. TOP OF FINISH FLOOR = 0'-0 TYP. U.N.O
2. ALL FIELD BOLTS TO BE $\frac{3}{4}$ "Ø A325N BOLTS UNLESS NOTED OTHERWISE
W/HEAVY HEX NUT AND HARD FLAT WASHERS.
3. THESE DRAWINGS ARE FOR THE ERECTION OF STEEL PROVIDED BY JONQUIL STEEL.
AND NOT TO BE USED BY OTHER TRADES.
4. REFER TO ERECTION PLANS FOR PIECE MARKS AND OTHER INFORMATIONS.
5. ALL SHAPES BE AS FOLLOWS :
WIDE FLANGE SHAPES: ASTM A992
CHANNEL, ANGLE, & PLATES: ASTM A 36
TUBE STEEL: ASTM A500 GRADE C
6. ▼ - INDICATES ORIENTATION OF MEMBER.
7. ► - INDICATES MOMENT CONNECTION.
8. (S) - INDICATES SLOPES, (B) - INDICATES - BELOW, (A) - INDICATES - ABOVE.
(LLV) - LONG LEG VERTICAL, (LLH) - LONG LEG HORIZONTAL,
(LSV) - LONG SIDE VERITICAL, (LSH) - LONG SIDE HORIZONTAL.

ALL STRUCTURAL STEEL WILL RECEIVE ONE SHOP COAT
RUST - INHIBITING PRIMER WHICH IS LEAD FREE AND
CHROMATE FREE, NONASPHALTIC TYPICAL UNLESS NOTED.
SURFACE PREPARETION SSPC-SP3

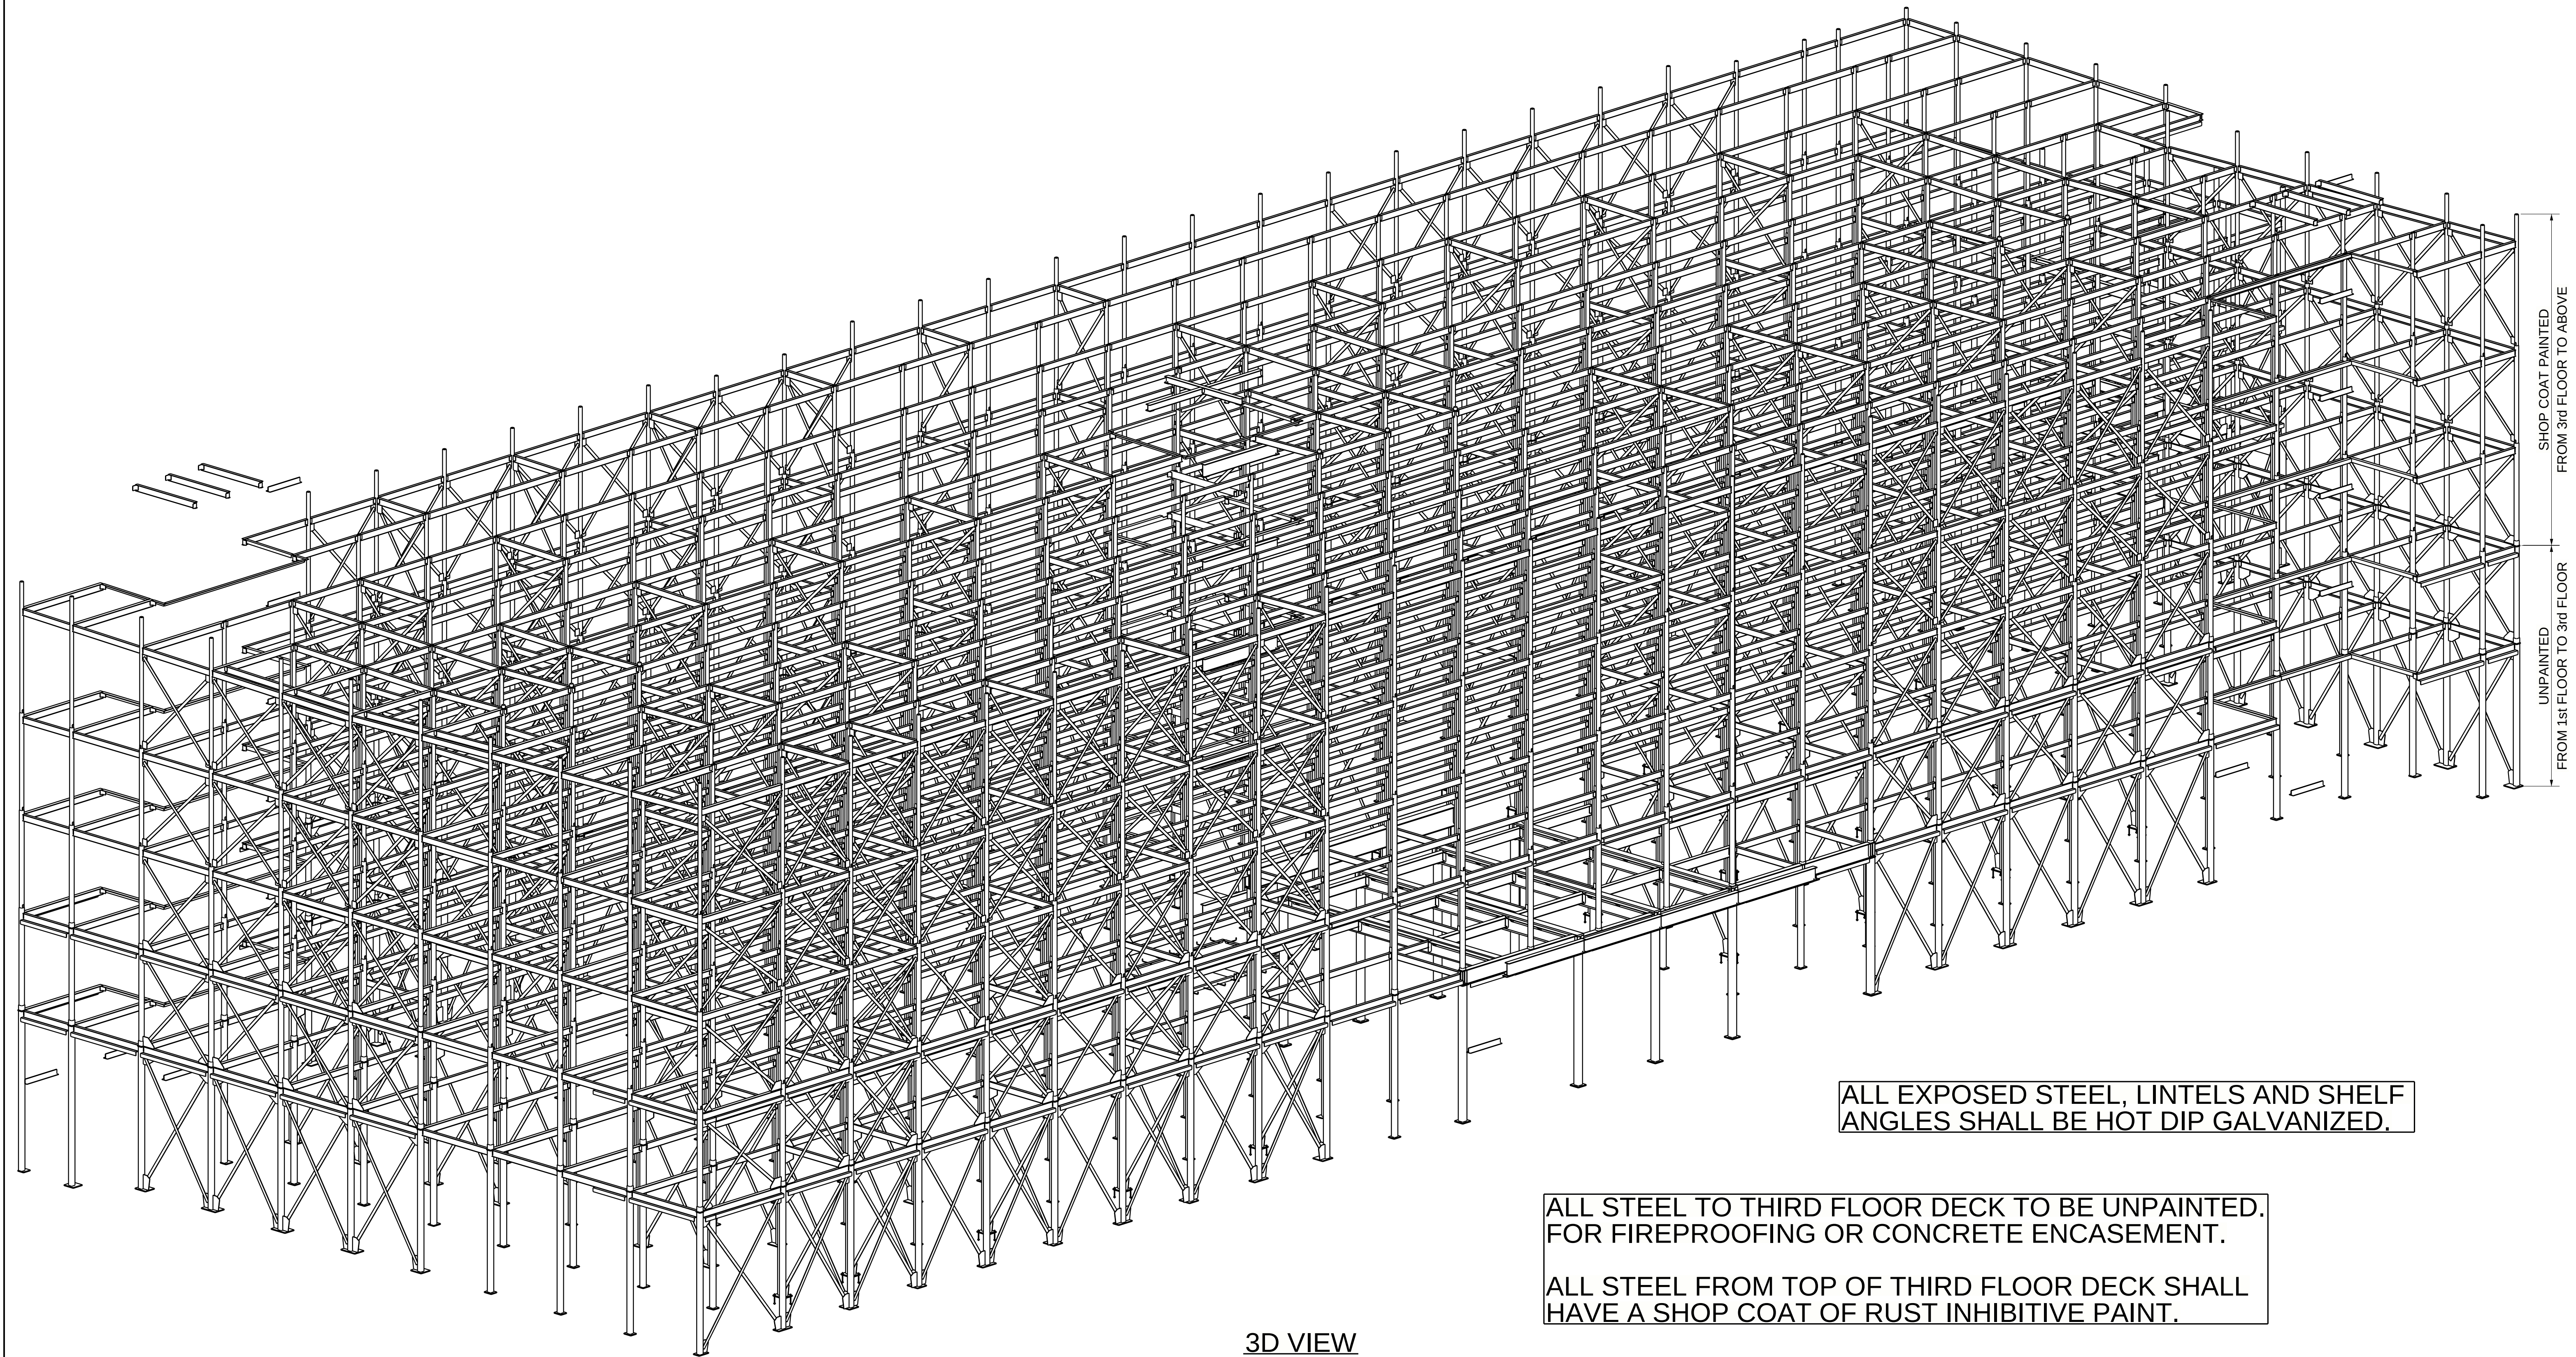

ALL EXPOSED STEEL, LINTELS AND SHELF ANGLES SHALL BE HOT DIP GALVANIZED.

ALL STEEL TO THIRD FLOOR DECK TO BE UNPAINTED. FOR FIREPROOFING OR CONCRETE ENCASEMENT.
ALL STEEL FROM TOP OF THIRD FLOOR DECK SHALL HAVE A SHOP COAT OF RUST INHIBITIVE PAINT.

3D VIEW

ERECTOR NOTES :-

1. ALL FIELD BOLTS TO BE $\frac{3}{4}$ "Ø A325N BOLTS UNLESS NOTED OTHERWISE w/ STD. HEX NUT AND HARD FLAT WASHERS.
2. THESE DWGS ARE FOR THE USE OF LOCATING STEEL BY HAMMETT STEEL FABRICATOR AND NOT TO BE USED BY OTHER TRADES.
3. W-SHAPES : ASTM A992
CHANNELS, ANGLES, PLATES & BAR : ASTM A36.
HOLLOW STRUCTURAL SECTIONS : ASTM A500 GRADE C

NOTES :-


1. ALL ELEVATIONS SHOWN ARE REFERRED FROM EL.0'-0" = DATUM ELEVATION.
2. ELEVATIONS SHOWN IN PLAN ARE REFERRED TO TOP OF STEEL ELEVATIONS TYPICAL U.N.O.
3. A = INDICATES ABOVE, B = INDICATES BELOW, D = INDICATES DIAGONAL.
4. LLV = INDICATES LONG LEG VERTICAL OF ANGLE.
LLH = INDICATES LONG LEG HORIZONTAL OF ANGLE.
LSV = INDICATES LONG SIDE VERTICAL OF HSS MEMBER.
LLH = INDICATES LONG SIDE HORIZONTAL OF HSS MEMBER.
5. ▼ - INDICATES ORIENTATION MARK OF MEMBERS.
6. ► - INDICATES MOMENT CONNECTION.

FOR FIELD USE : 10/28/2022

ELECTRODE	E70XX	UNLESS NOTED	REVISION
HOLES	13/16 Ø	UNLESS NOTED	0
PAINT	1-S/C RUST INHIBITIVE PAINT U.N.O.		

DRAWING NUMBER:

E9

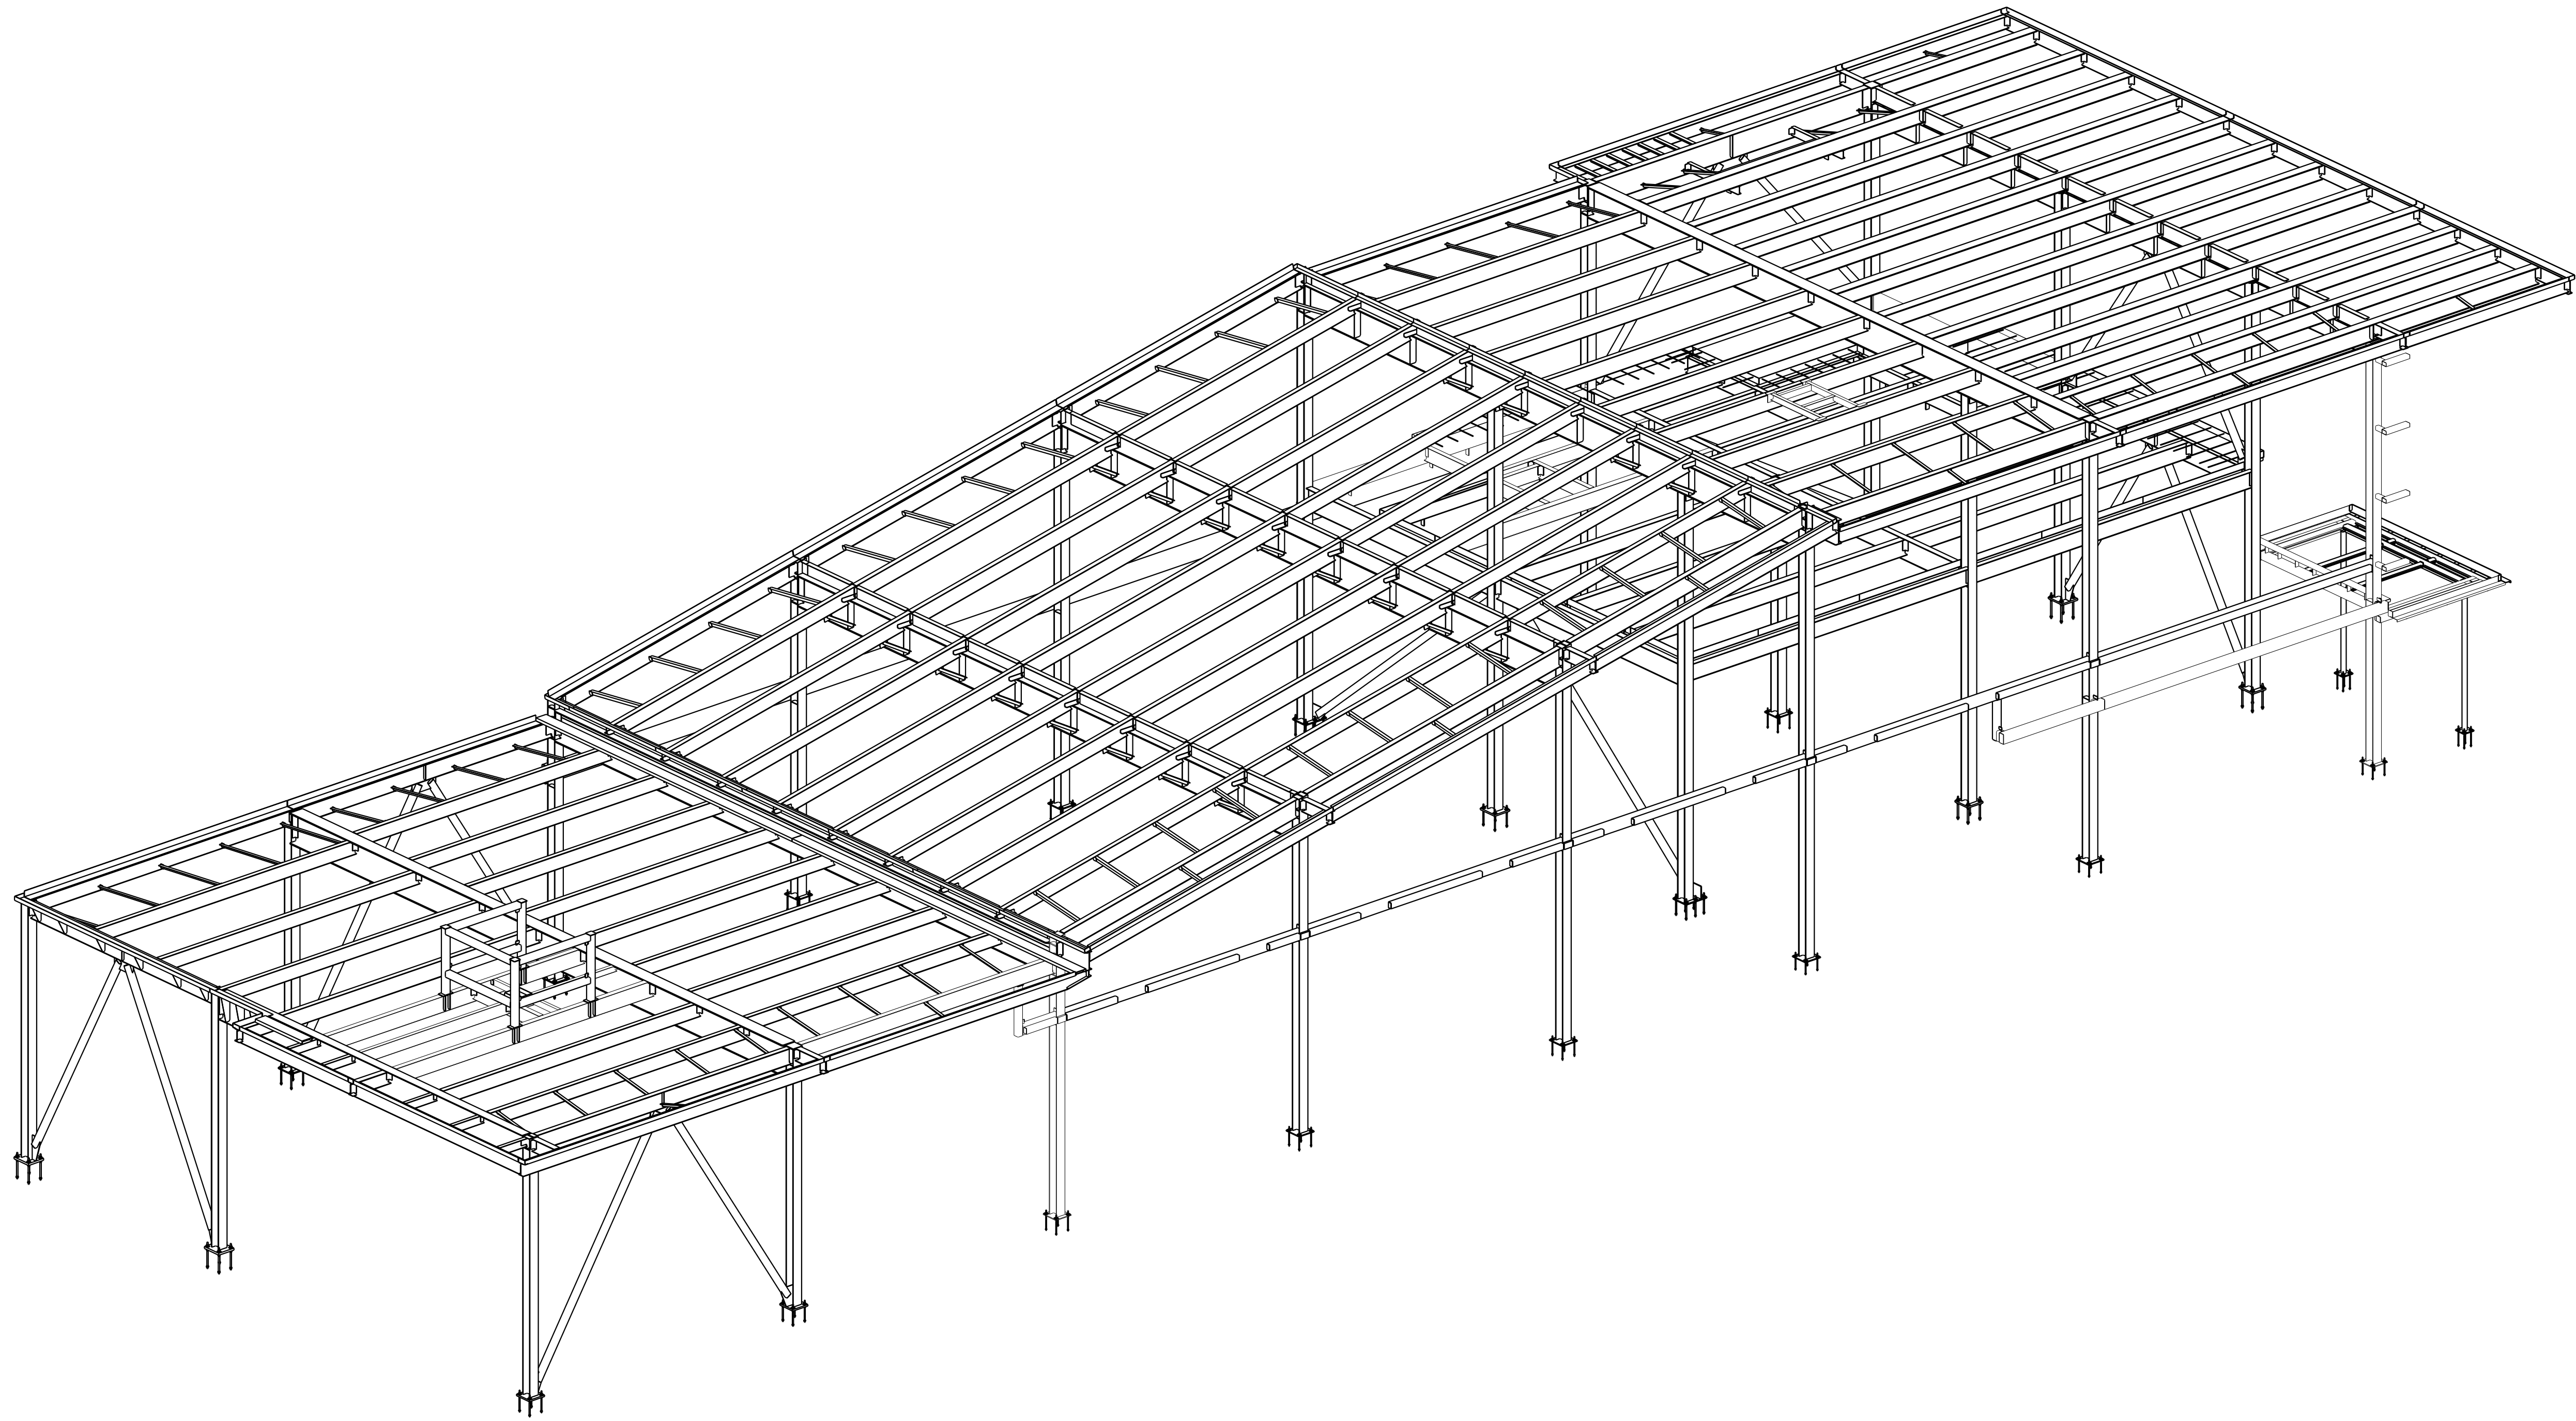

3D-VIEW


GENERAL NOTES :-

- 1) DATUM ELEVATION = 0'-0" U.N.O.
- 2) E.O.A - INDICATES EDGE OF ANGLE.
E.O.BPL - INDICATES EDGE OF BENT PLATE.
- 3) ELEVATIONS SHOWN IN PLAN ARE REFERRED TO
TOP OF STEEL ELEVATIONS TYPICAL U.N.O.
- 4) REFER E121 SHEETS FOR TYPICAL SECTIONS & DETAILS.
- 5) LLV = INDICATES LONG LEG VERTICAL OF ANGLE/BENT PLATE
LLH = INDICATES LONG LEG HORIZONTAL OF ANGLE/BENTPLATE
LSV = INDICATES LONG SIDE VERTICAL OF HSS MEMBER.
LSH = INDICATES LONG SIDE HORIZONTAL OF HSS MEMBER.
- 6) A = INDICATES ABOVE, B = INDICATES BELOW.
S = INDICATES SLOPE, D = INDICATES DIAGONAL.
- 7) (XX) - INDICATES QUANTITY OF $\frac{3}{4}$ " $\varnothing$ X 4 $\frac{1}{2}$ LONG SHEAR STUDS WELDED
TO TOP FLANGE OF STEEL BEAM.
- 8)  - INDICATES ORIENTATION MARK OF MEMBERS.
- 9)  - INDICATES MOMENT CONNECTION.
- 10)  - INDICATES VERTICAL BRACE.

ALL FLOOR AND ROOF SUPPORTING STEEL FRAMING
WILL RECEIVE ONE SHOP COAT STANDARD PRIMER
TYPICAL UNLESS NOTED.

ERECTOR NOTE :-

- 1) ALL FIELD BOLTS TO BE $\frac{3}{4}$ " $\varnothing$ A325N TC BOLTS TIGHTENING
SHALL BE SNUG-TIGHT UNLESS NOTED OTHERWISE w/ STD. HEX NUT
AND HARD FLAT WASHERS.
- 2) REFER TO ERECTION PLANS FOR PIECE MARKS.
- 3) THESE DWGS ARE FOR THE USE OF LOCATING STEEL BY JONQUIL STEEL
FABRICATOR AND NOT TO BE USED BY OTHER TRADES
- 4) W-SHAPES: ASTM A992 GRADE 50
CHANNELS, ANGLES, PLATE & BAR : ASTM A36.
HOLLOW STRUCTURAL SECTIONS:
ASTM A500-GRADE B

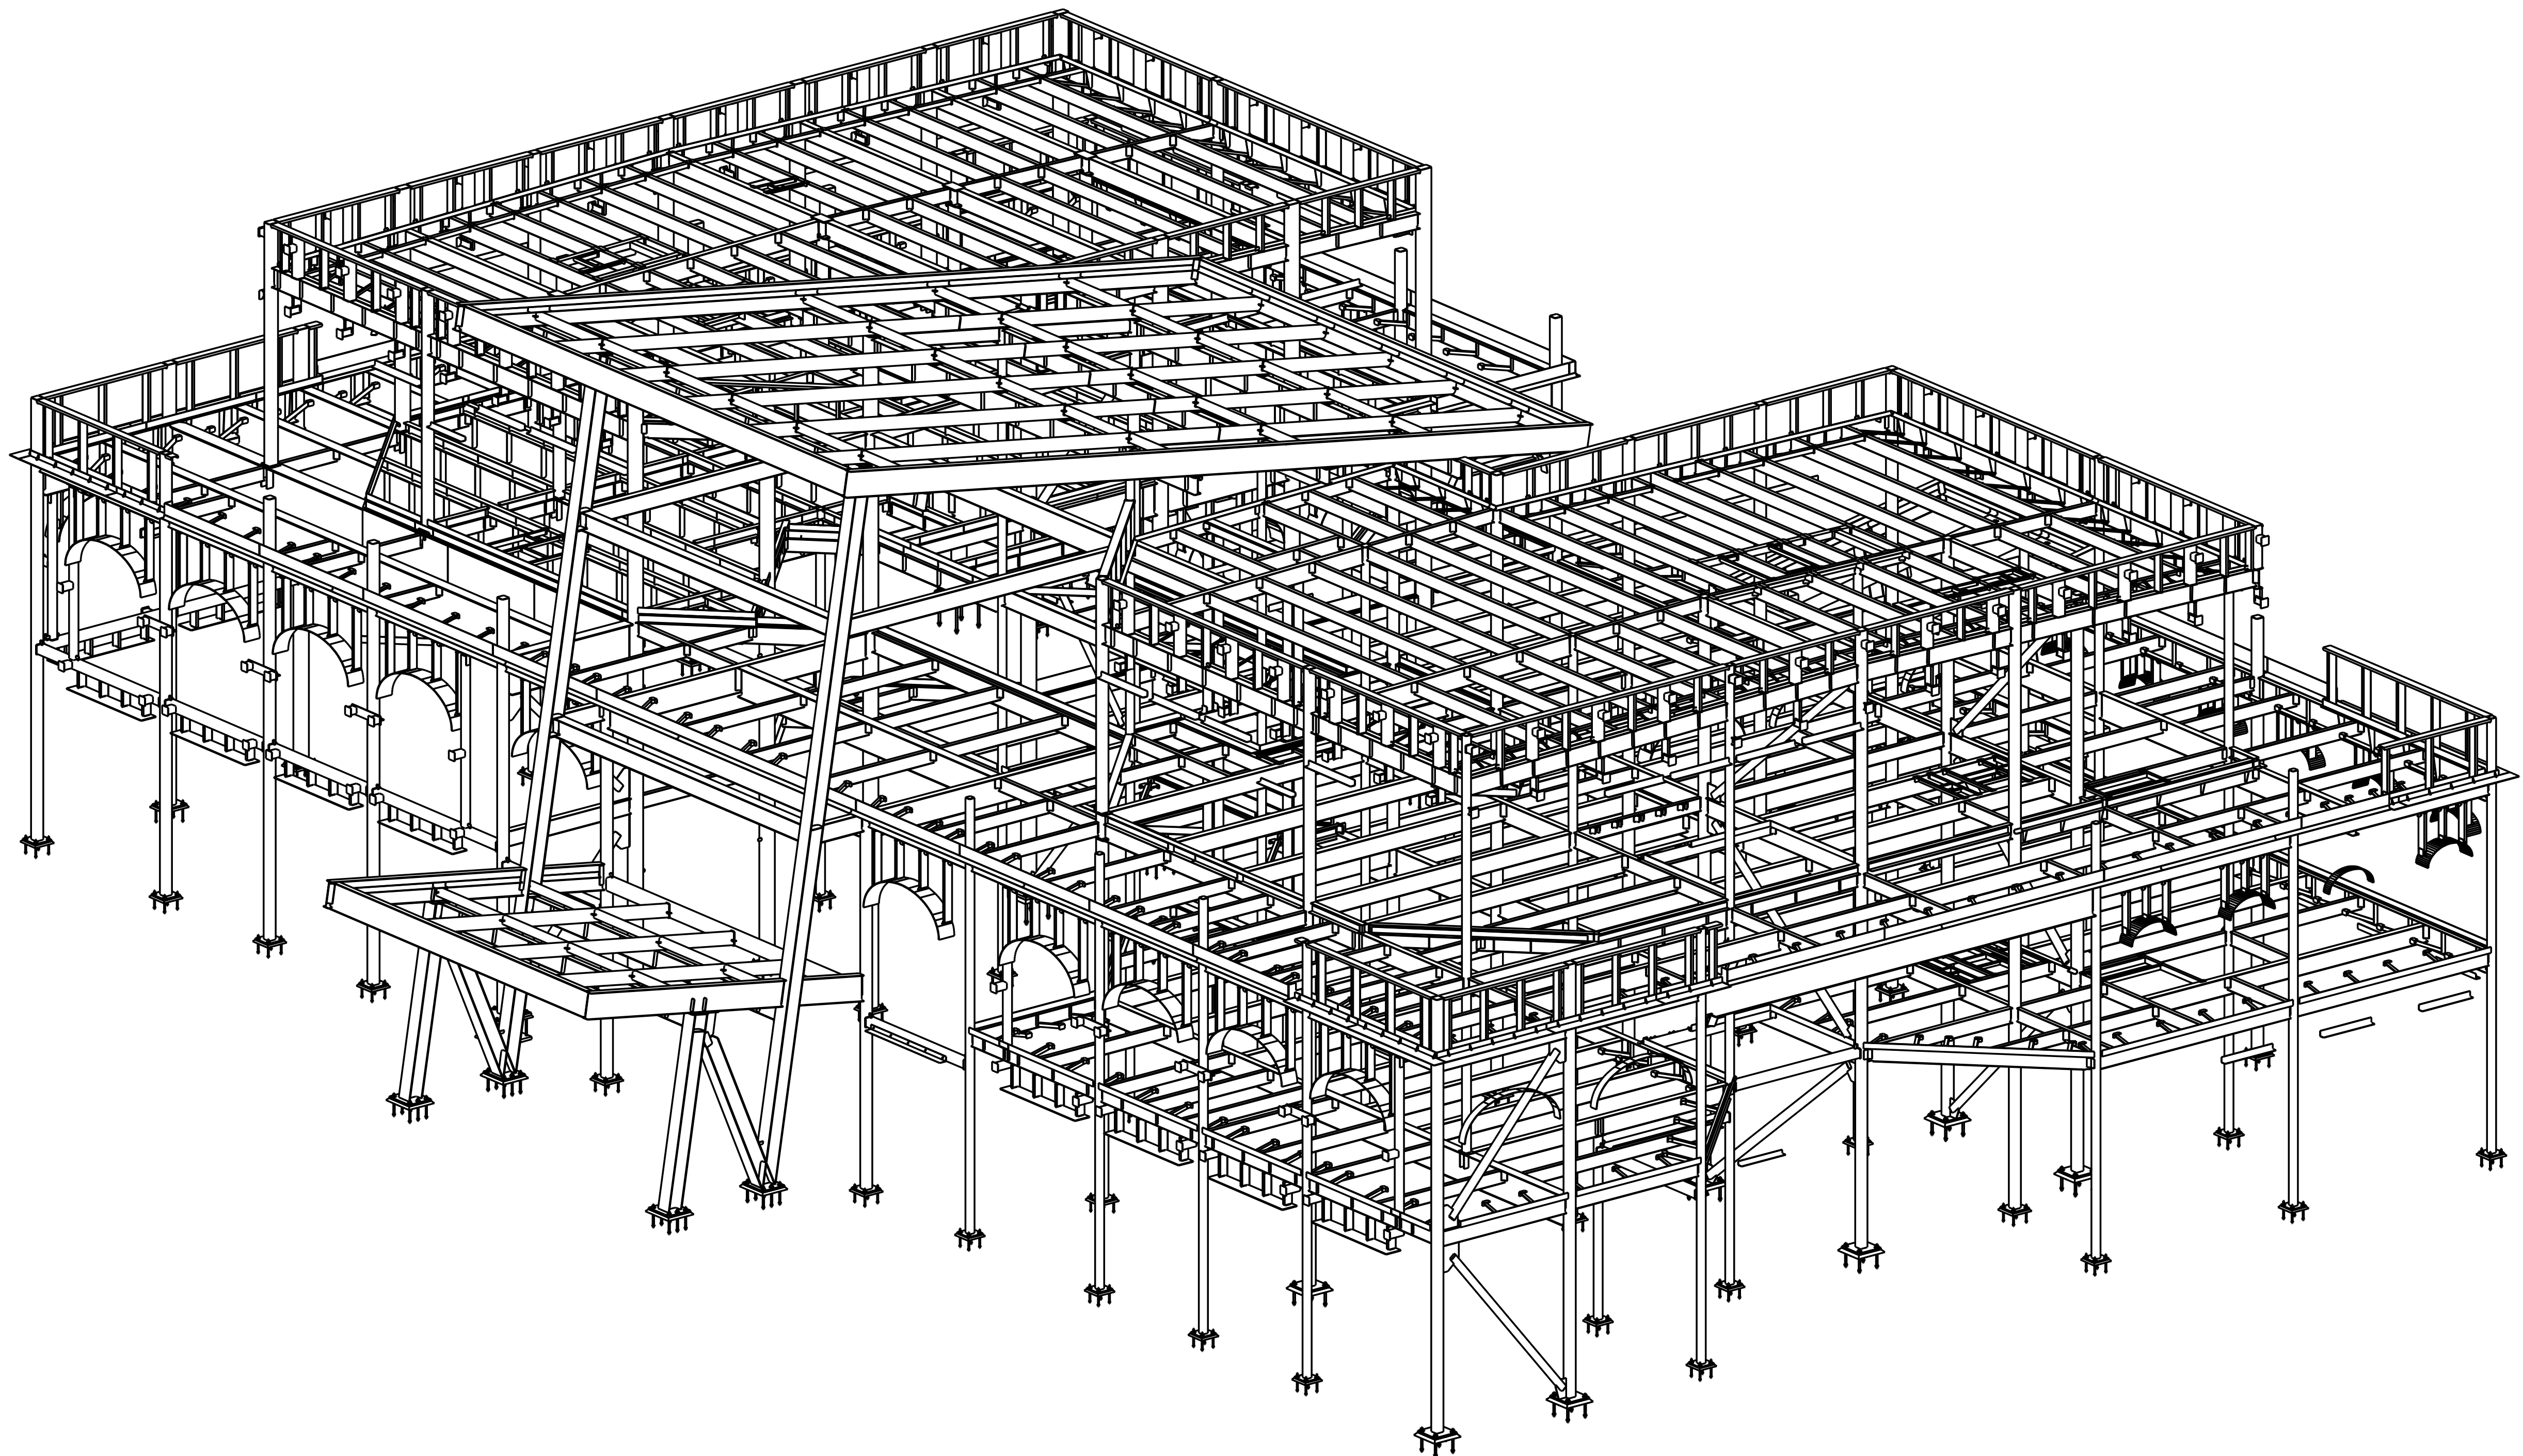

3D VIEW

GENERAL NOTES :-


- 1) DATUM ELEVATION = 0'-0" U.N.O.
- 2) E.O.A - INDICATES EDGE OF ANGLE.
E.O.BPL - INDICATES EDGE OF BENT PLATE.
- 3) ELEVATIONS SHOWN IN PLAN ARE REFERRED TO TOP OF STEEL ELEVATIONS TYPICAL U.N.O.
- 4) REFER E160 & E161 SHEETS FOR TYPICAL SECTIONS & DETAILS.
- 5) LLV = INDICATES LONG LEG VERTICAL OF ANGLE/BENT PLATE
LLH = INDICATES LONG LEG HORIZONTAL OF ANGLE/BENT PLATE
LSV = INDICATES LONG SIDE VERTICAL OF HSS MEMBER.
LSH = INDICATES LONG SIDE HORIZONTAL OF HSS MEMBER.
- 6) A = INDICATES ABOVE, B = INDICATES BELOW.
S = INDICATES SLOPE, D = INDICATES DIAGONAL.
- 7) (XX) - INDICATES QUANTITY OF $\frac{3}{4}$ " $\varnothing$ X 4" LONG SHEAR STUDS WELDED TO TOP FLANGE OF STEEL BEAM, REFER STUD DRAWING SHEETS FOR QUANTITY OF STUD AND DETAILS.
- 8) ▼ - INDICATES ORIENTATION MARK OF MEMBERS.
- 9) ► - INDICATES ORIENTATION MARK OF MEMBERS.
- 10) ● - INDICATES DRAG CONNECTION. DESIGN CONNECTIONS FOR AXIAL FORCES INDICATED ON PLAN AND IN ELEVATIONS.
- 11) ▮ - INDICATES VERTICAL BRACE.

ALL FLOOR AND ROOF SUPPORTING STEEL FRAMING WILL RECEIVE ONE SHOP COAT STANDARD PRIMER.


ALL BRICK RELIEF ANGLES/PLATES AND LINTEL ANGLES ARE HOT DIPPED GALVANIZED STEEL WILL BE PREPPED FOR PAINT TYPICAL UNLESS NOTED.

ERECTOR NOTE :

- 1) ALL FIELD BOLTS TO BE $\frac{3}{4}$ " $\varnothing$ A325N. TC BOLTS TIGHTENING SHALL BE SNUG-TIGHT UNLESS NOTED OTHERWISE W/ STD. HEX NUT AND HARD FLAT WASHERS.
BOLT TIGHTENING SHALL BE SNUG-TIGHT U.N.O.
- 2) REFER TO ERECTION PLANS FOR PIECE MARKS.
- 3) THESE DWGS ARE FOR THE USE OF LOCATING STEEL BY JONQUIL STEEL FABRICATOR AND NOT TO BE USED BY OTHER TRADES
- 4) W-SHAPES: ASTM A992 GRADE 50
CHANNELS, ANGLES, PLATE & BAR : ASTM A36.
HOLLOW STRUCTURAL SECTIONS:
ASTM A500-GRADE C

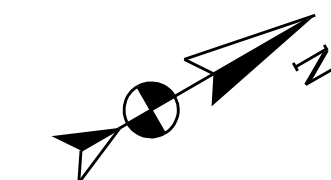

PROJECT NORTH /
WORKING NORTH

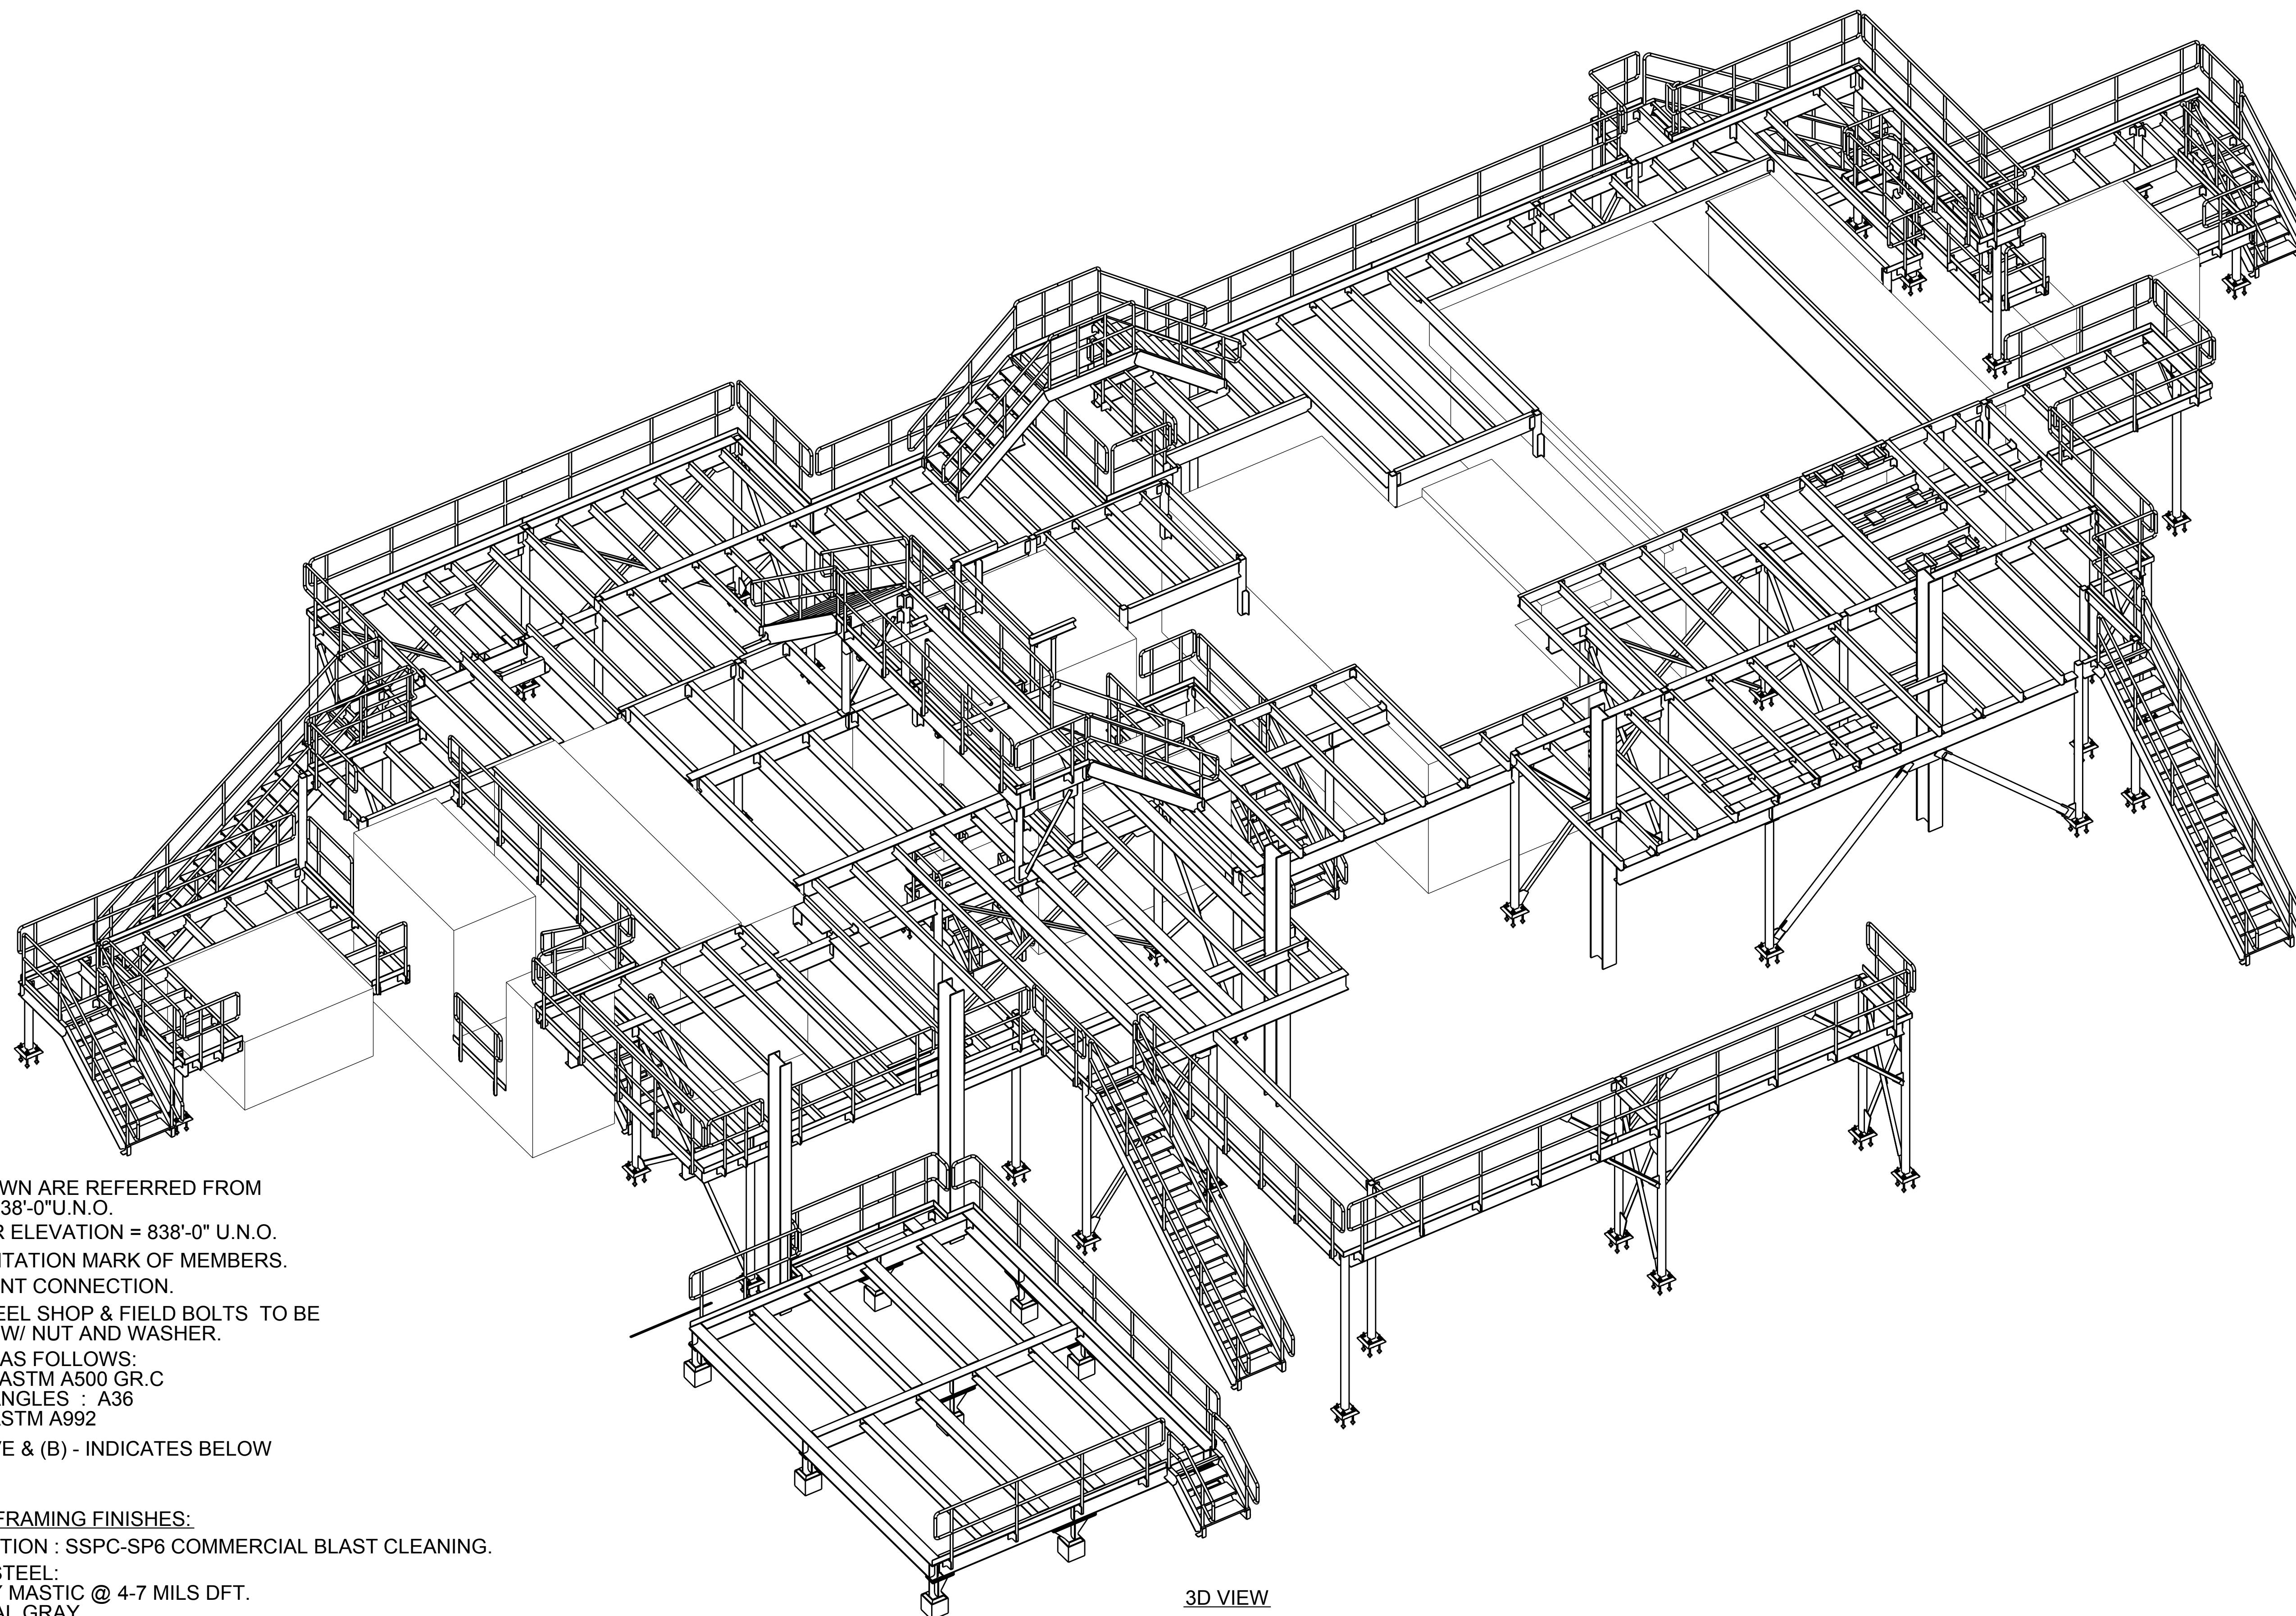

3D VIEW

(LOOKING SOUTH - EAST DIRECTION)

NOTES:-

1. ALL ELEVATIONS SHOWN ARE REFERRED FROM DATUM ELEVATION = 838'-0" U.N.O.
2. TOP OF FINISH FLOOR ELEVATION = 838'-0" U.N.O.
3. ◐ - INDICATES ORIENTATION MARK OF MEMBERS.
4. ► - INDICATES MOMENT CONNECTION.
5. ALL STRUCTURAL STEEL SHOP & FIELD BOLTS TO BE 3/4" DIA. A325X BOLTS W/ NUT AND WASHER.
6. ALL MATERIAL TO BE AS FOLLOWS:
HSS SHAPES : ASTM A500 GR.C
C SHAPES, PLATES, ANGLES : A36
W & WT SHAPES : ASTM A992
7. (A) - INDICATES ABOVE & (B) - INDICATES BELOW

STRUCTURAL STEEL FRAMING FINISHES:

1. SURFACE PREPARATION : SSPC-SP6 COMMERCIAL BLAST CLEANING.
2. APPLICATION FOR STEEL:
FIRST COAT: EPOXY MASTIC @ 4-7 MILS DFT.
COLOR = INDUSTRIAL GRAY.


GUARDRAIL & HANDRAIL FINISHES:

1. SURFACE PREPARATION : SSPC-SP 2 HAND TOOL CLEANING.
2. (2) COATS: SHERWIN WILLIAMS INDUSTRIAL GLOSS ENAMEL.
COLOR = SAFETY YELLOW (1.5 - 2 MILS DFT).

FOR CHECKERED PLATE FINISHES:

1. SURFACE PREPARATION : SSPC-SP6 COMMERCIAL BLAST CLEANING.
2. APPLICATION FOR STEEL:
FIRST COAT: EPOXY MASTIC @ 4-7 MILS DFT.
COLOR = INDUSTRIAL GRAY.

ERECTOR NOTE!
ALL CONNECTIONS BOLTS REQUIRED ARE A325 -X
UNLESS NOTED OTHERWISE. FIELD TO APPLY
ADDITIONAL WASHERS UNDER THE NUT TO ENSURE
BOLTS ARE EXCLUDED FROM THE SHEAR PLANE.

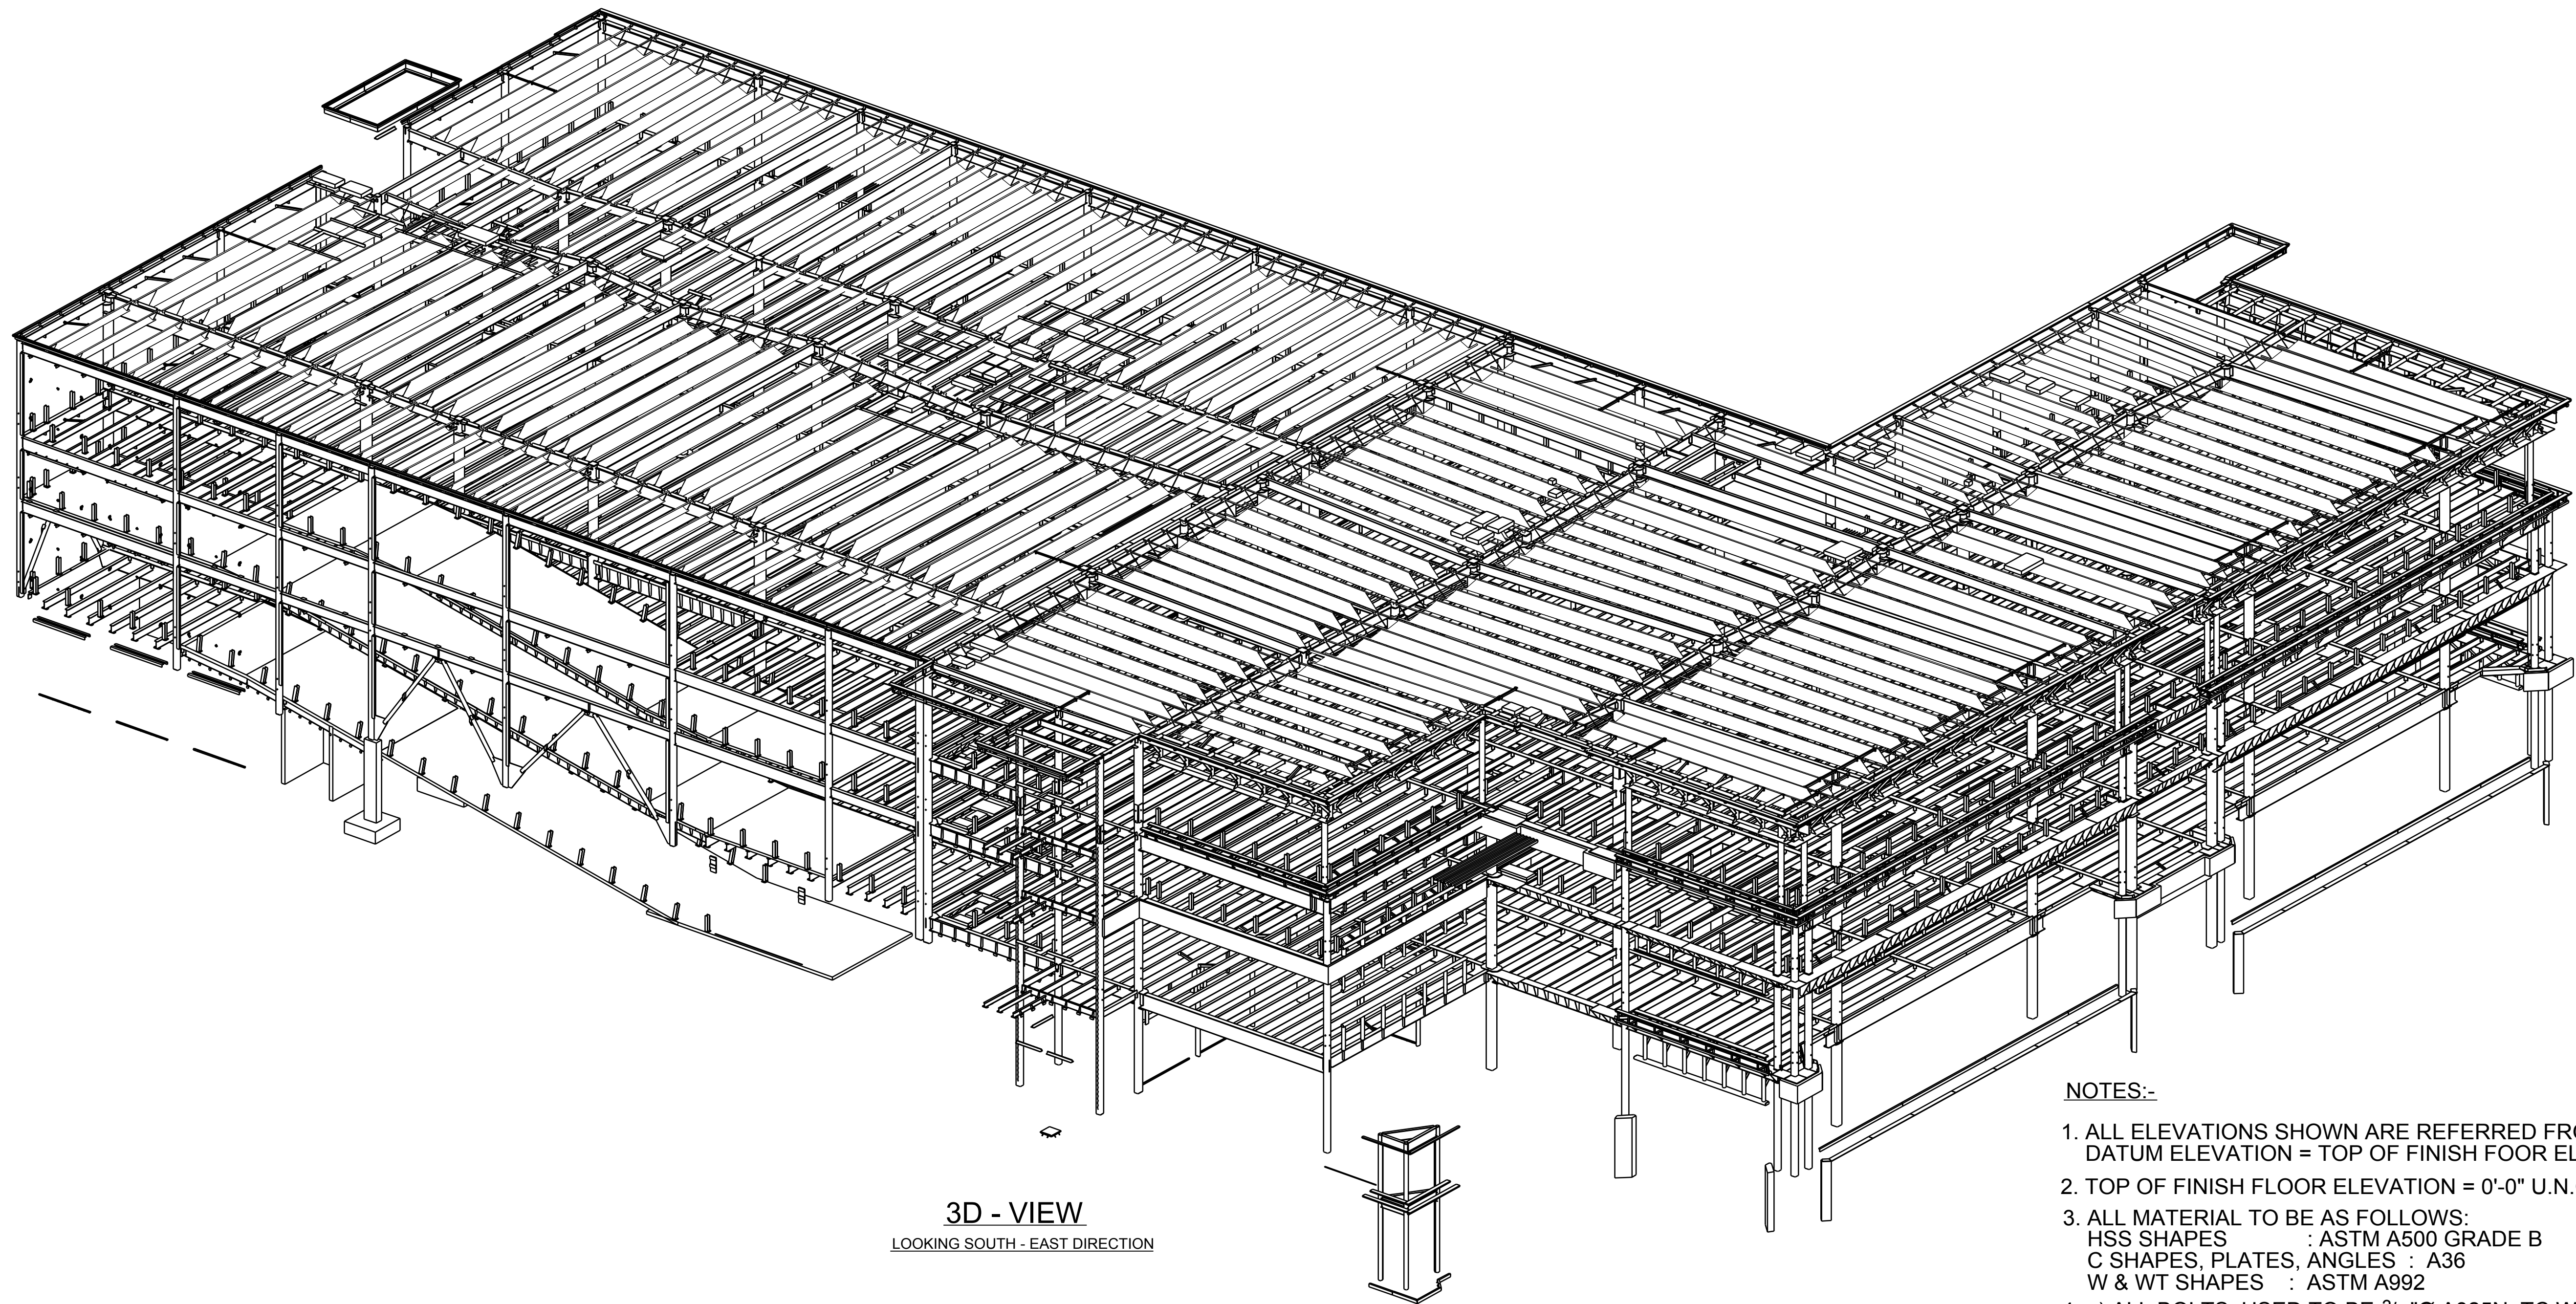

3D - VIEW




LOOKING SOUTH - EAST DIRECTION

LEGENDS:
B/O - BOTTOM OF
T/O - TOP OF
EL. - ELEVATION
U.N.O. - UNLESS NOTED OTHERWISE
(O.H.) - OPPOSITE HAND
LOCS. - LOCATIONS
(B) - BELOW
(A) - ABOVE
TYP. - TYPICAL
THK. - THICK
EX. - EXISTING
SIM. - SIMILAR
B/S - BOTH SIDES
PL. - PLATE
LLH - LONG LEG HORIZONTAL
LLV - LONG LEG VERTICAL
(CONT.) - CONTINUOUS
E.O.A - EDGE OF ANGLE
E.O.B.PL - EDGE OF BENT PL.

ALL STEEL WILL RECEIVE ONE SHOP COAT OF TNEDEC 90G METAL PRIMER.
COLOR TO BE GREY TYPICAL UNLESS NOTED.
STRUCTURAL STEEL MEMBERS THAT REQUIRE INTUMESCENT FIREPROFING
(SECOND FLOOR FRAMING BETWEEN COLUMN LINES 'A' AND 'G' -
COORDINATE EXTENTS WITH THE ARCHITECT) SHALL BE SHOP PRIMED WITH A
SUITABLE PRIMER THAT IS APPROVED BY ISOLATEK INTERNATIONAL FOR
COMPATIBILITY WITH CAFCO SPRAYFILM.

NOTES:-

1. ALL ELEVATIONS SHOWN ARE REFERRED FROM
DATUM ELEVATION = TOP OF FINISH FOOR ELEVATION = 0'-0"U.N.O.
2. TOP OF FINISH FLOOR ELEVATION = 0'-0" U.N.O.
3. ALL MATERIAL TO BE AS FOLLOWS:
HSS SHAPES : ASTM A500 GRADE B
C SHAPES, PLATES, ANGLES : A36
W & WT SHAPES : ASTM A992
4. a) ALL BOLTS USED TO BE $\frac{3}{4}$ "Ø A325N TC W/ NUT AND WASHER
TYPICAL UNLESS NOTED AT NON-COMPOSITE BEAMS.
b) ALL BOLTS USED TO BE $\frac{3}{4}$ "Ø A490 TC W/ NUT AND WASHER
TYPICAL UNLESS NOTED AT COMPOSITE BEAMS.
5. ▴ - INDICATES ORIENTATION OF MEMBERS.
6. ◀ - INDICATES MOMENT CONNECTION OF MEMBER.
7. REMOVE ERECTION TABS AFTER FIELD WELDING MEMBERS.

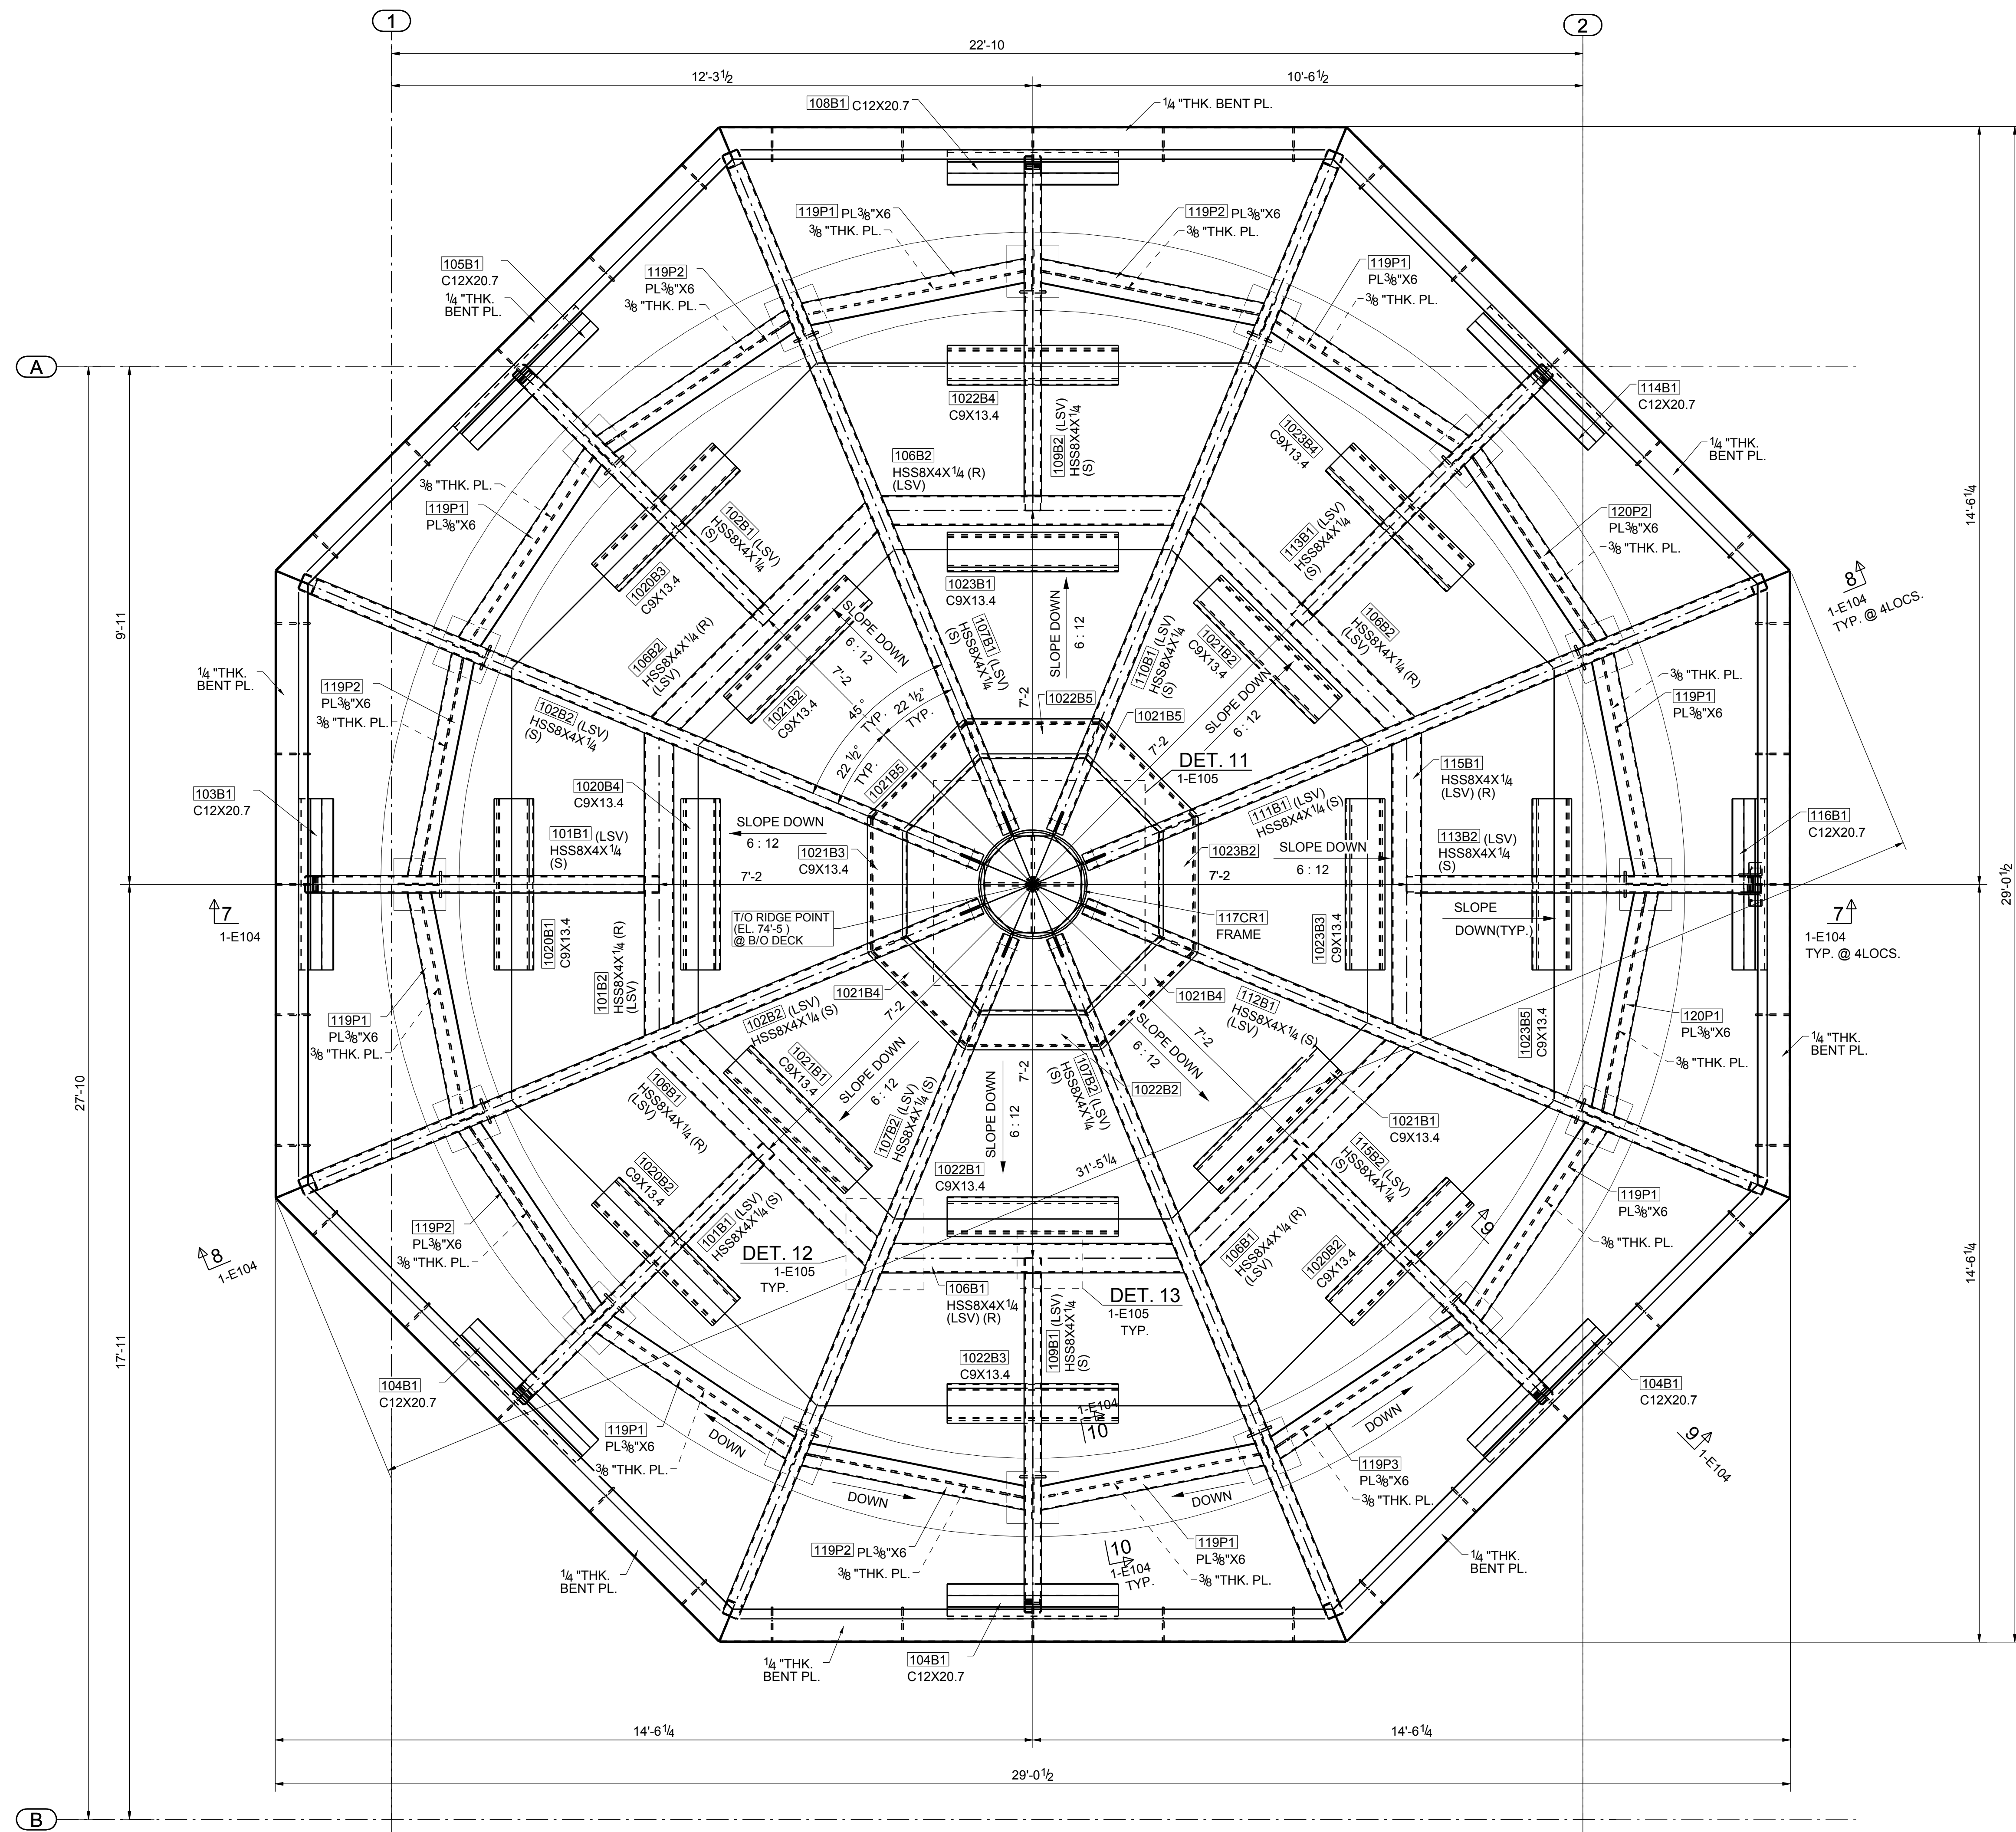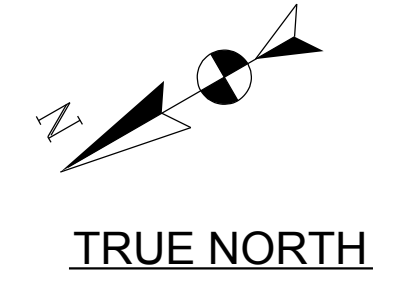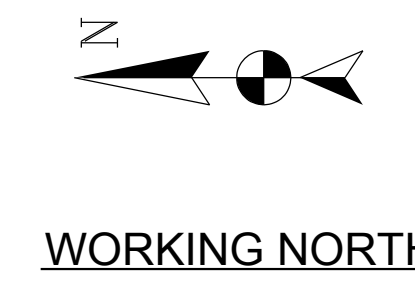


NOTES:-

1. REFER 1-E100 SHEET FOR ALL GENERAL NOTES.



PARTIAL ROOF LEVEL FRAMING PLAN

1-E101
(REFER: ROOF LEVEL FOR FRAMING PLAN / S-304)

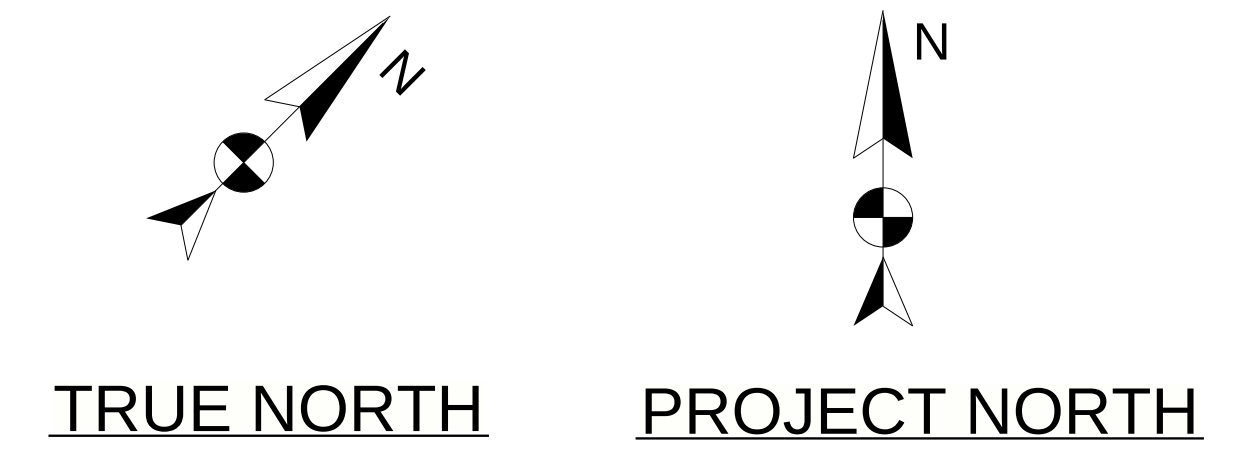


NOTES:-

1. REFER E100 SHEET FOR GENERAL NOTES.
2. REFER E109 SHEET FOR TYPICAL SECTION & DETAILS.

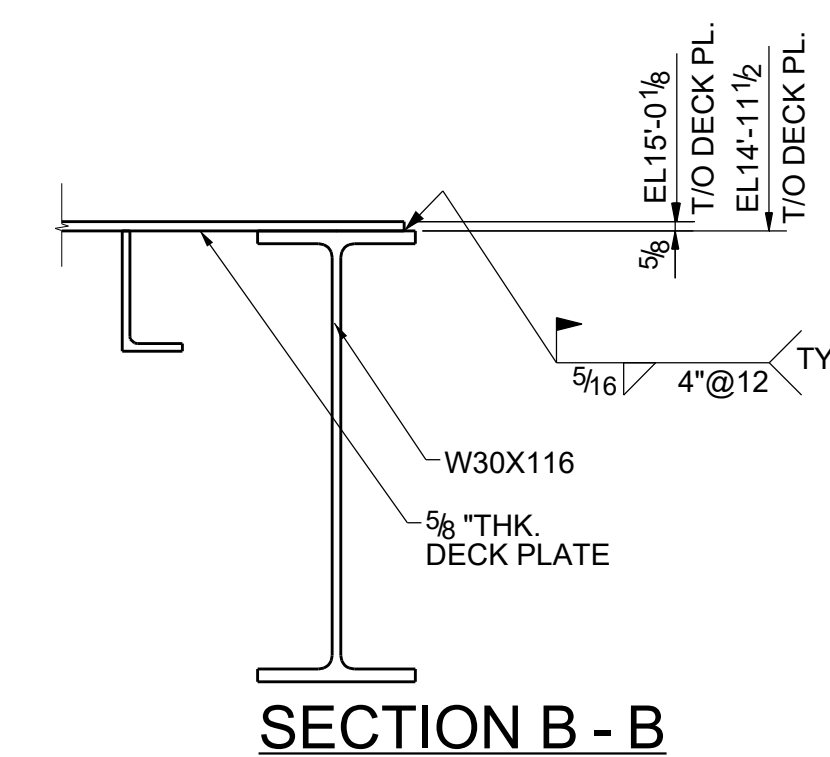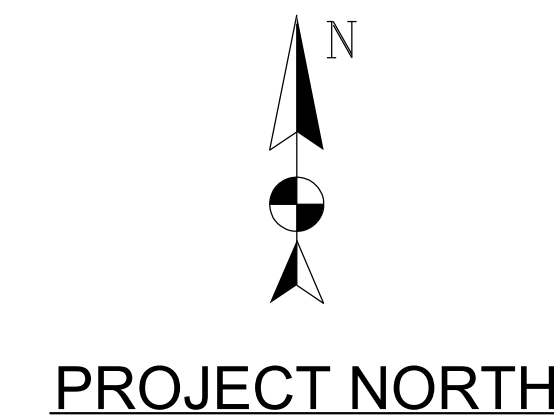


(REFER : ELEVATED PLATFORM - GUARDRAIL PLAN / S2.10)




TOP OF STEEL ELEVATION EL.1157'-10³/₄" TYP.U.N.O.
(CONT. DRGS.REF.NO :- LEVEL 2 FRAMING PLAN - AREA E / S102E)

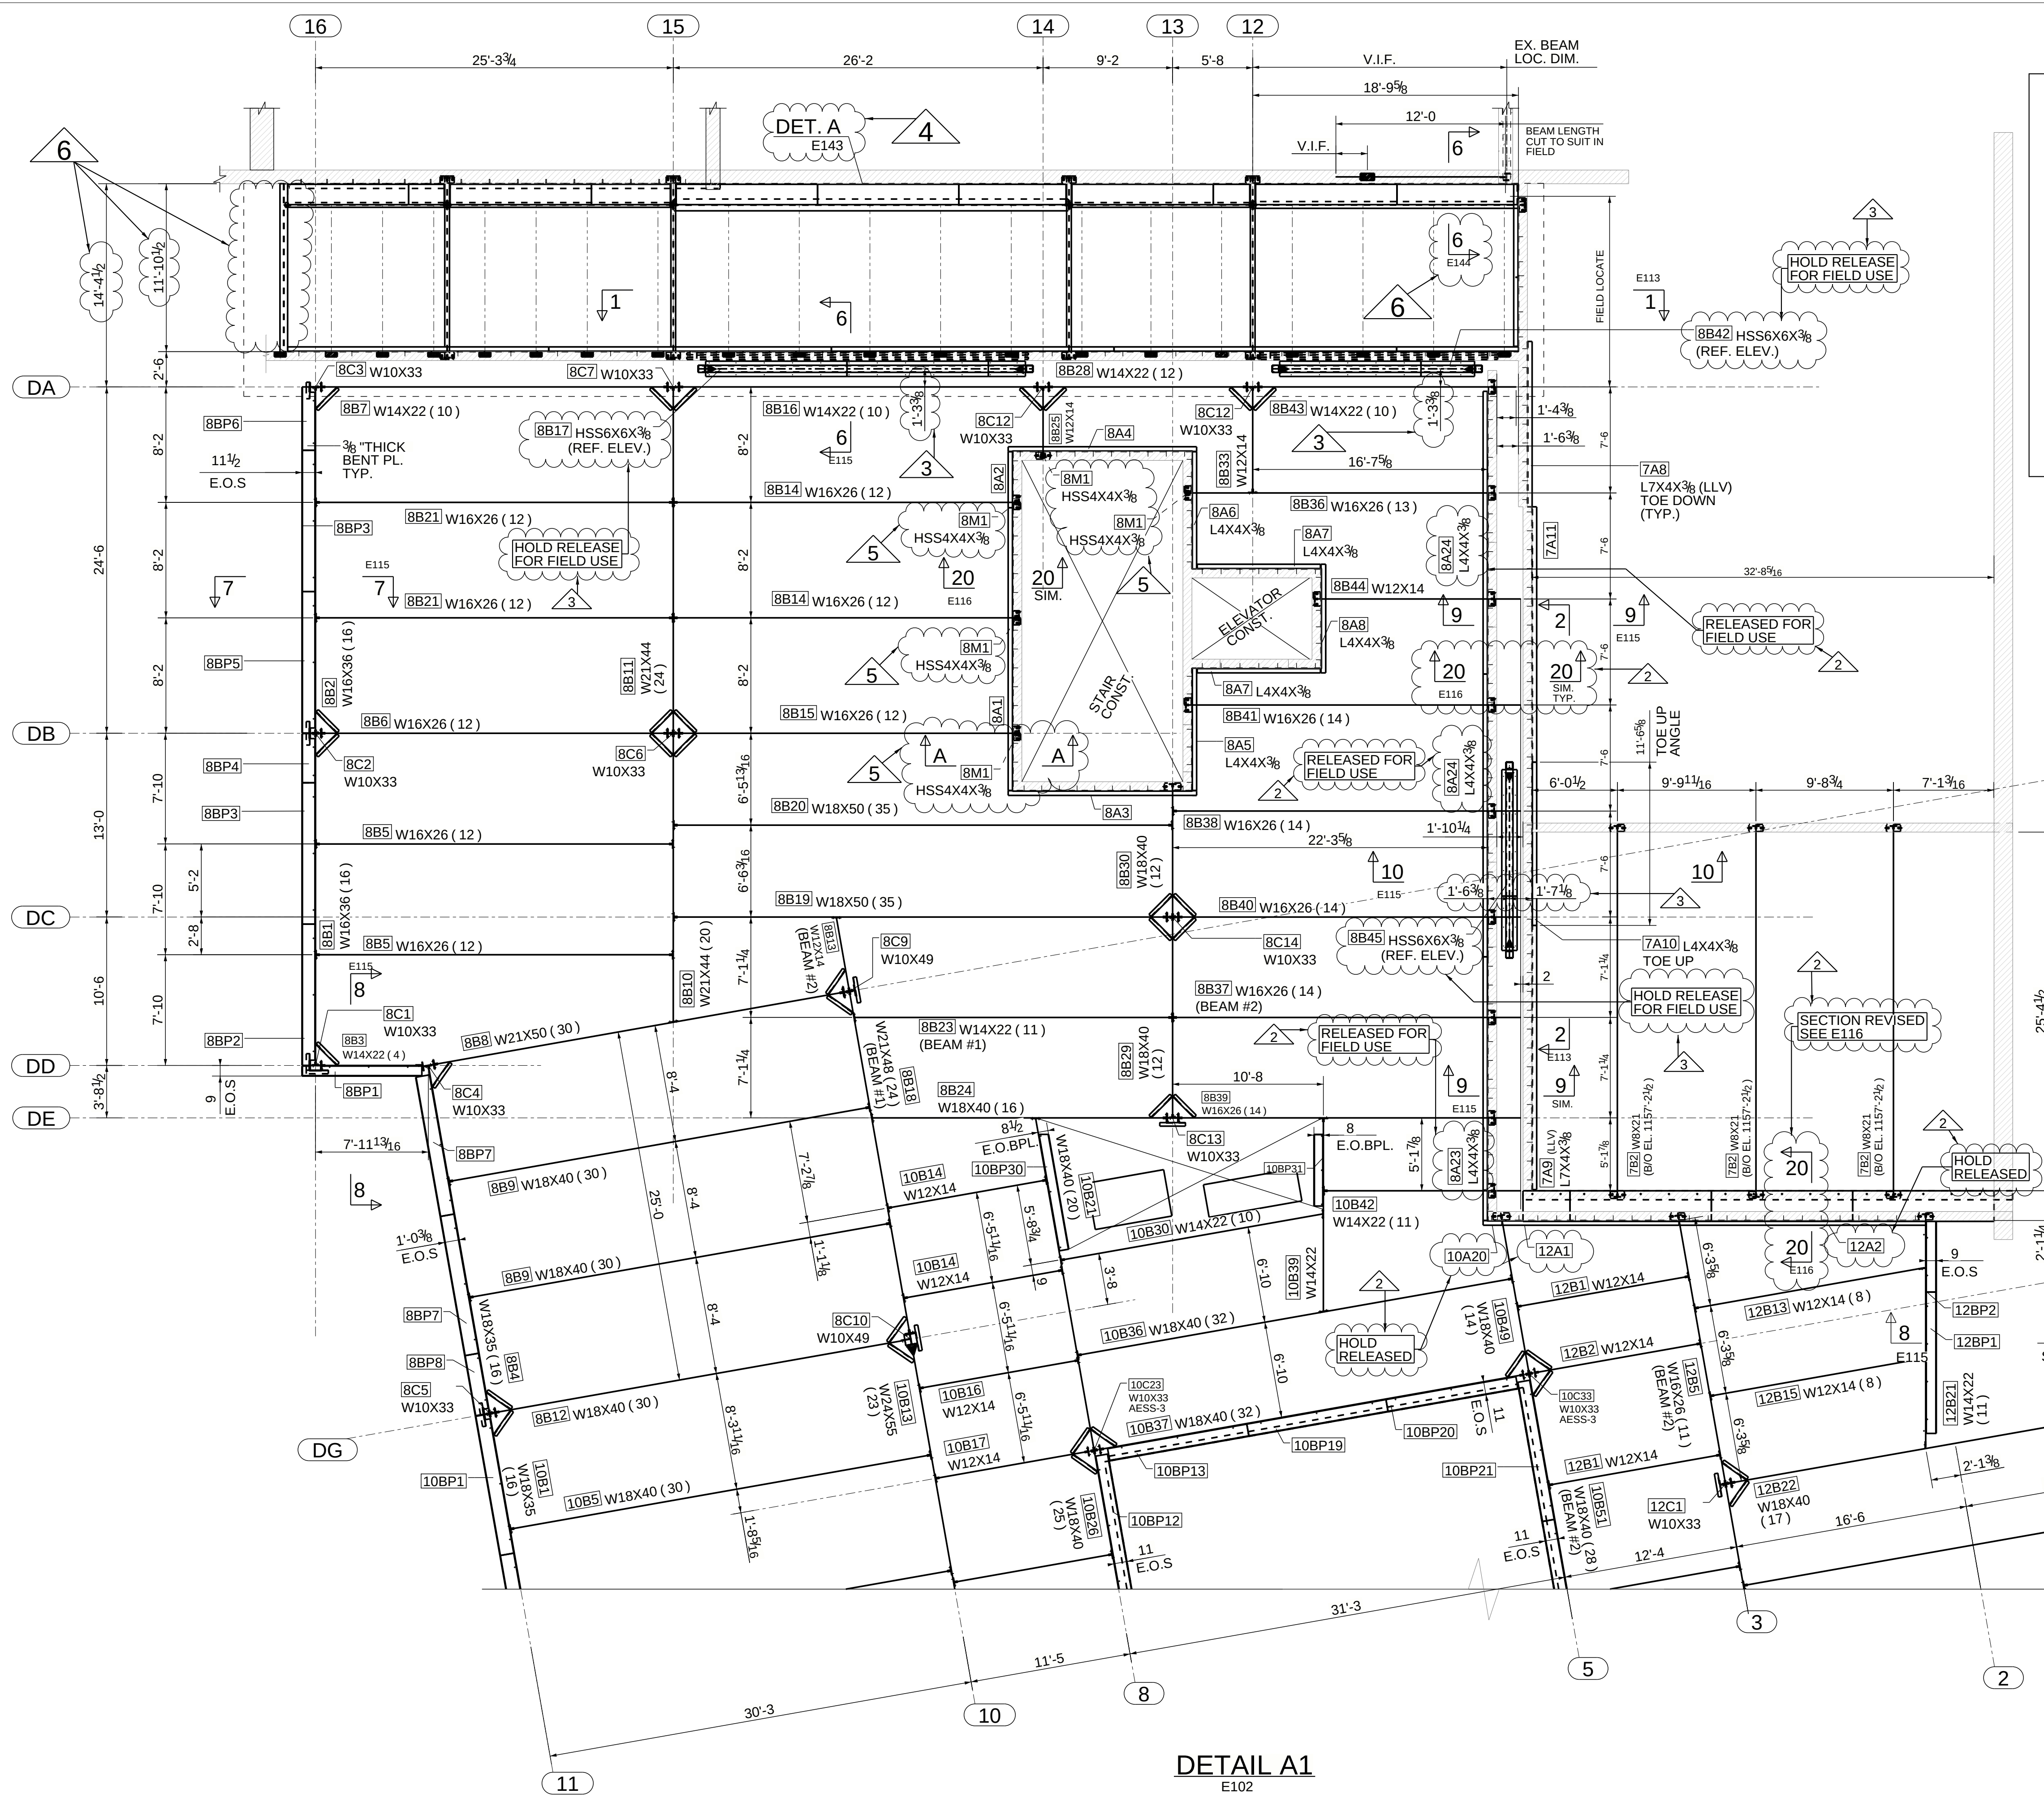


ALL BEAMS ARE EQUALLY
SPACED BETWEEN COLUMNS
TYPICAL UNLESS NOTED

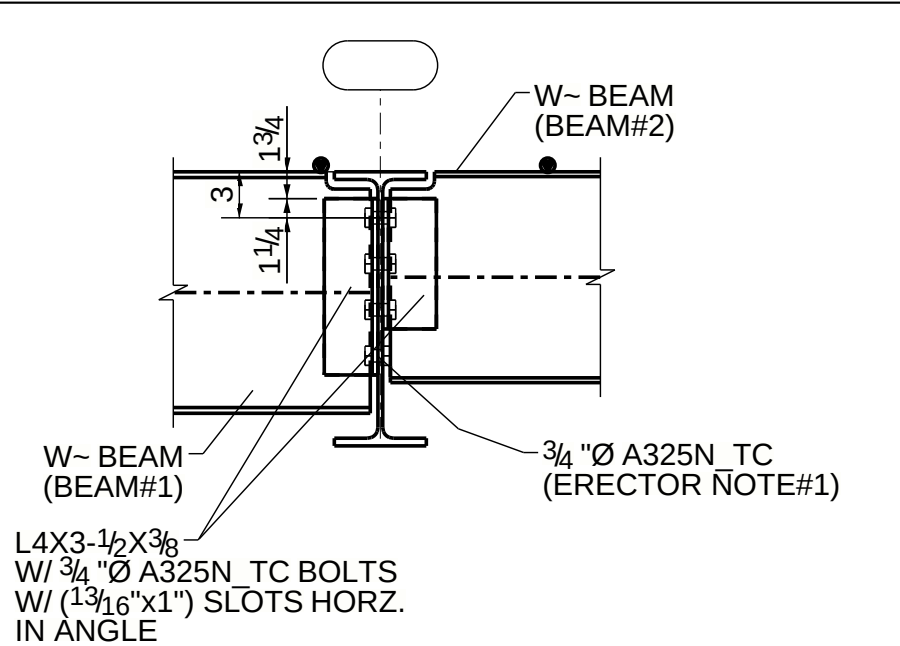

ERECTOR NOTE#1
INSTALL BEAM#1 PRIOR TO BEAM#2
BY USING BOTTOM BOLTS
(REFER PLAN FOR RESPECTIVE BEAM ASSEMBLY MARK)

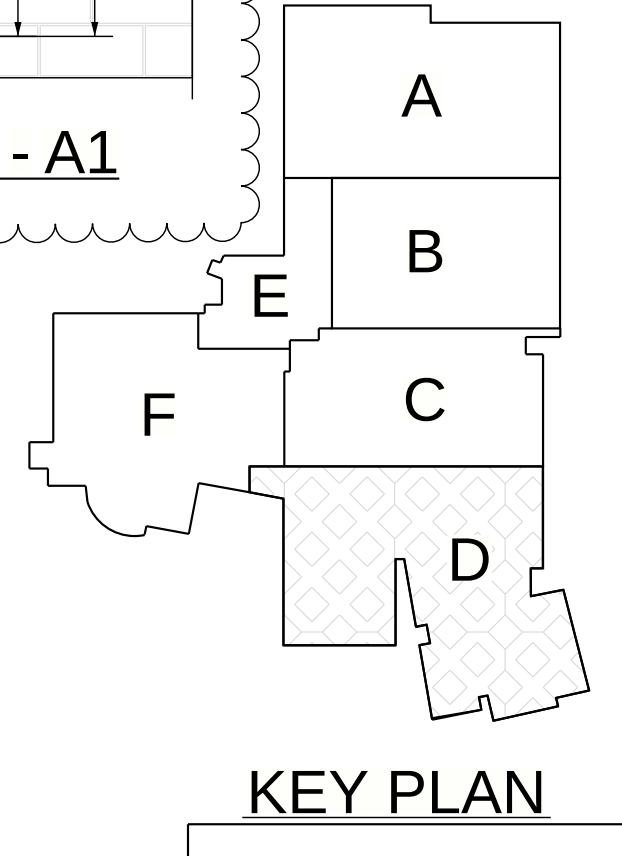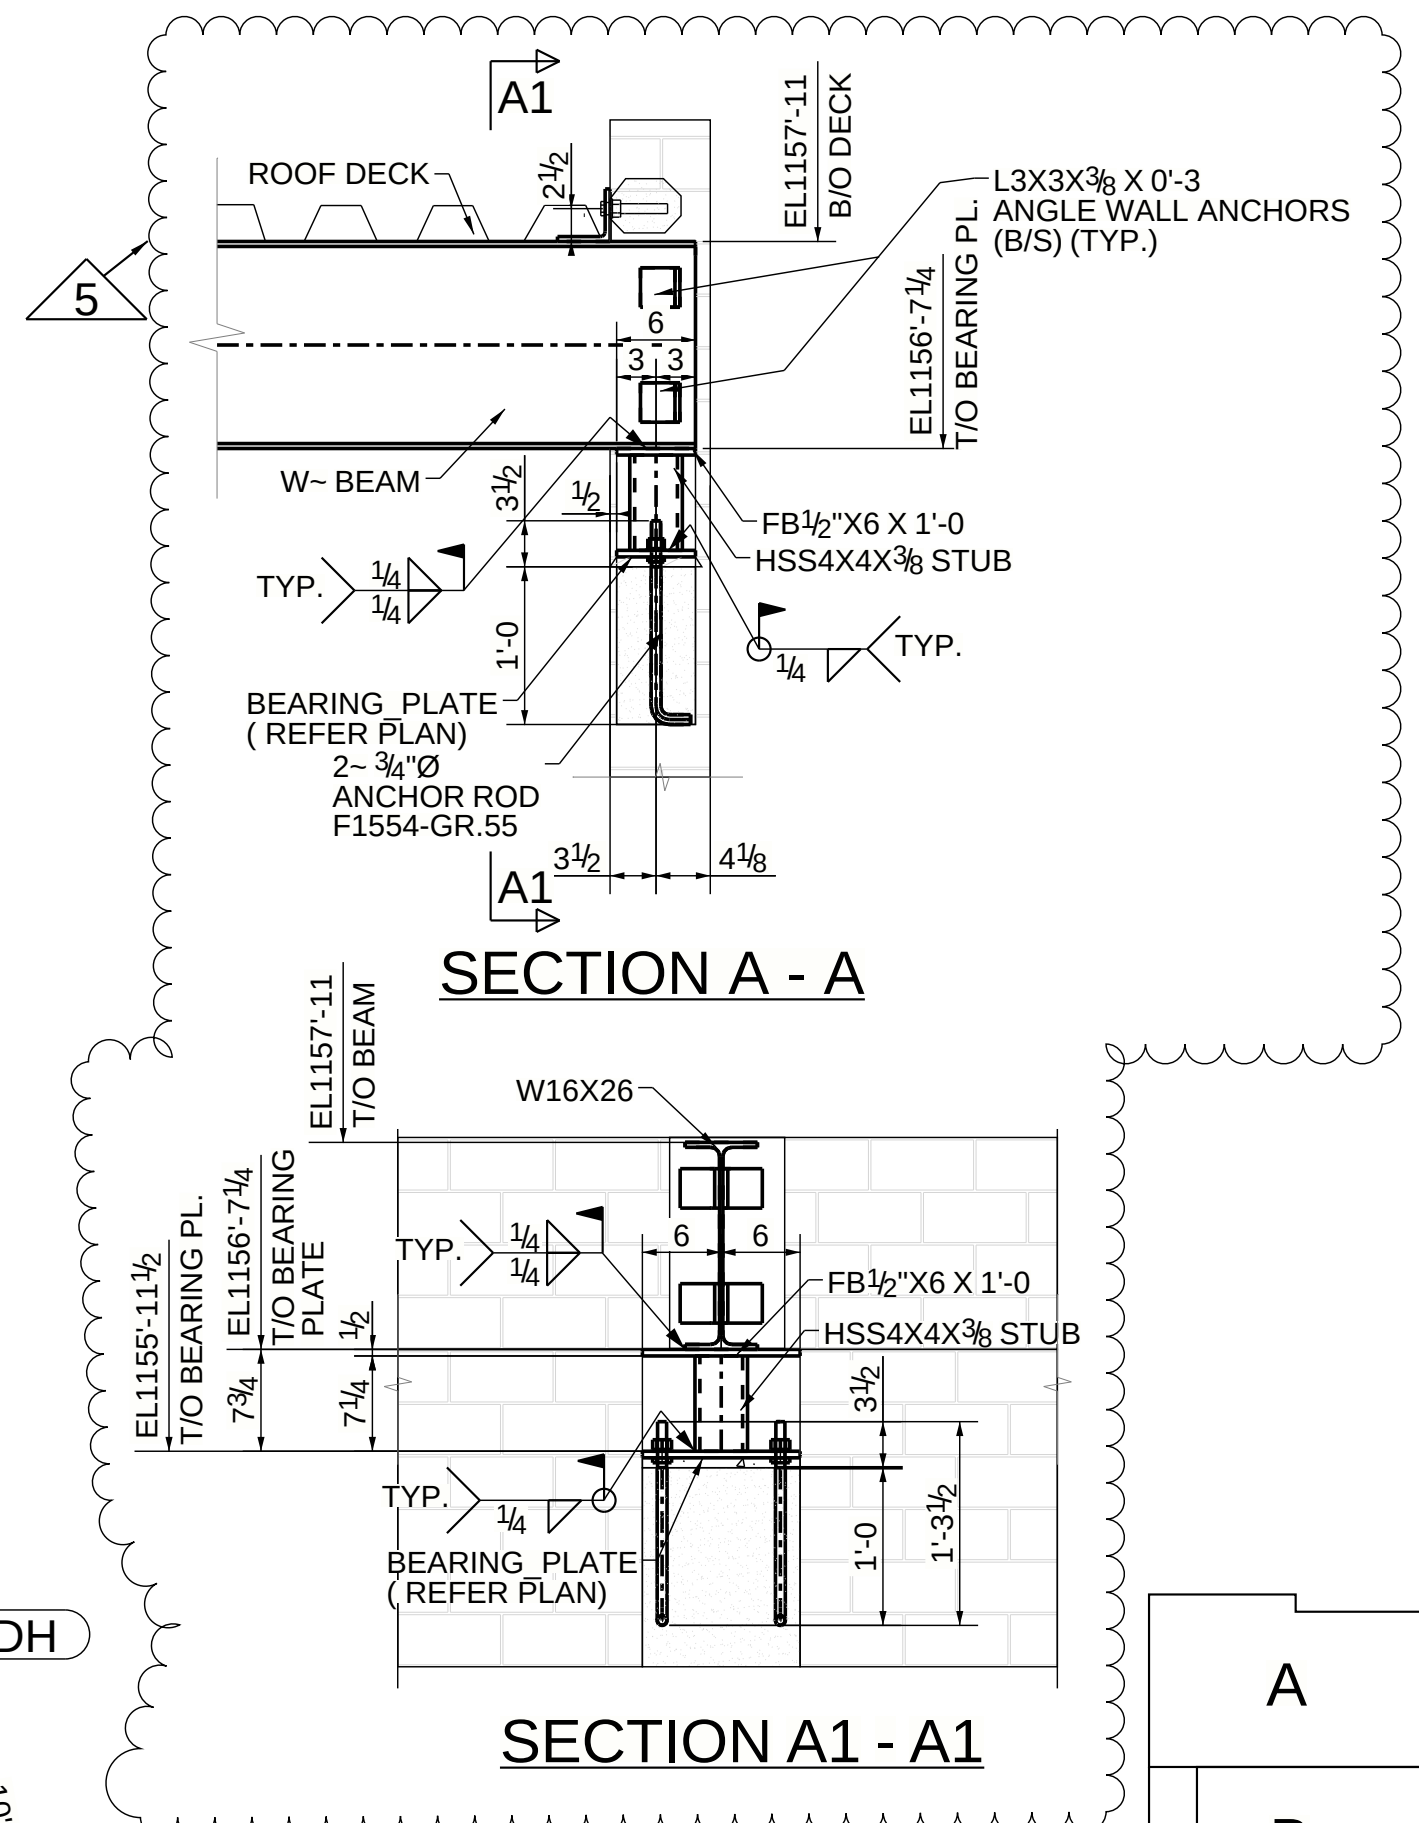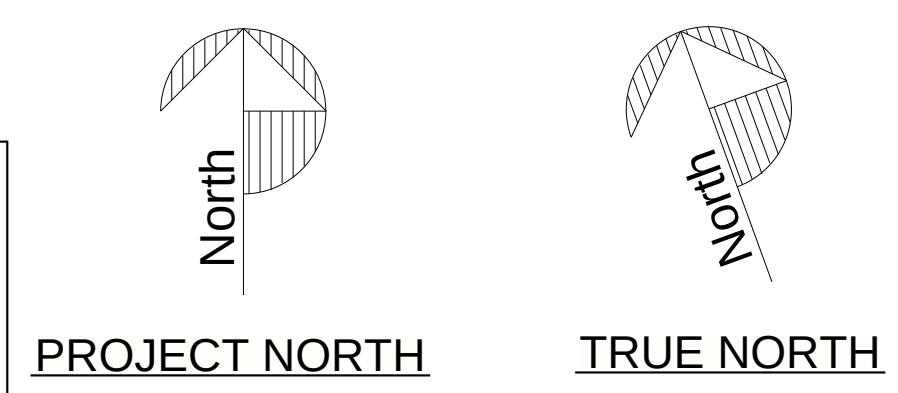


DETAIL A1
E102
PARTIAL LEVEL 2 FRAMING PLAN - AREA D
TOP OF SECOND FLOOR EL. 1158'-4" & TOP OF STEEL EL. 1157'-11" TYP. U.N.O.
(CONT. DRGS. REF. NO. :- LEVEL 02 FRAMING PLAN - AREA D / S102D)


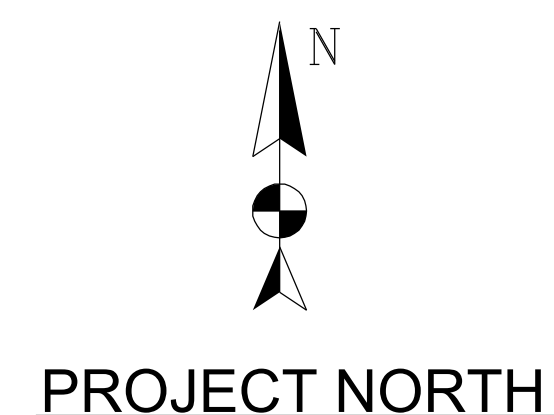


1 → APPROVER VERIFY CURVED HSS BEAM LOCATING DIMENSION & RADIUS.


2 → APPROVER VERIFY SLOPE HSS BEAM EXTENDED DIMANAION.

1. REFER E111 SHEET FOR GENERAL NOTES.
2. REFER E1013 TYPICAL SECTIONS & DETAILS.
3.  - INDICATES SLRS AXIAL CONNECTION FOR COLLECTOR ELEMENTS.
REFER E1014 SHEET FOR CONNECTION RELATED INFORMATION.

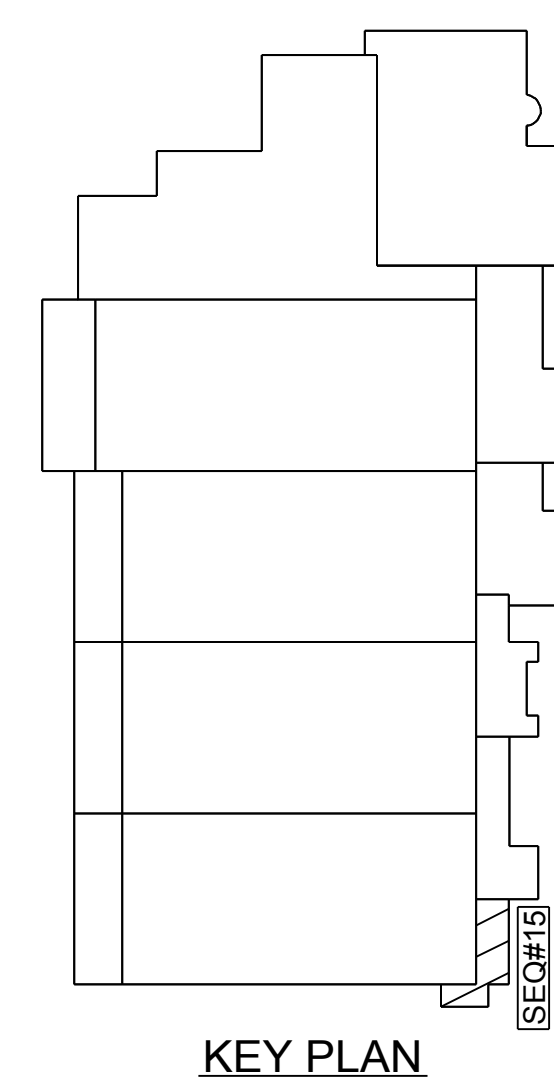

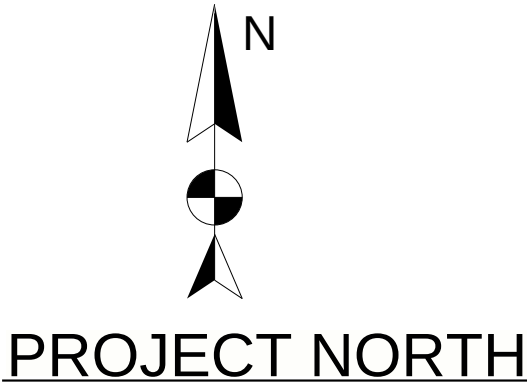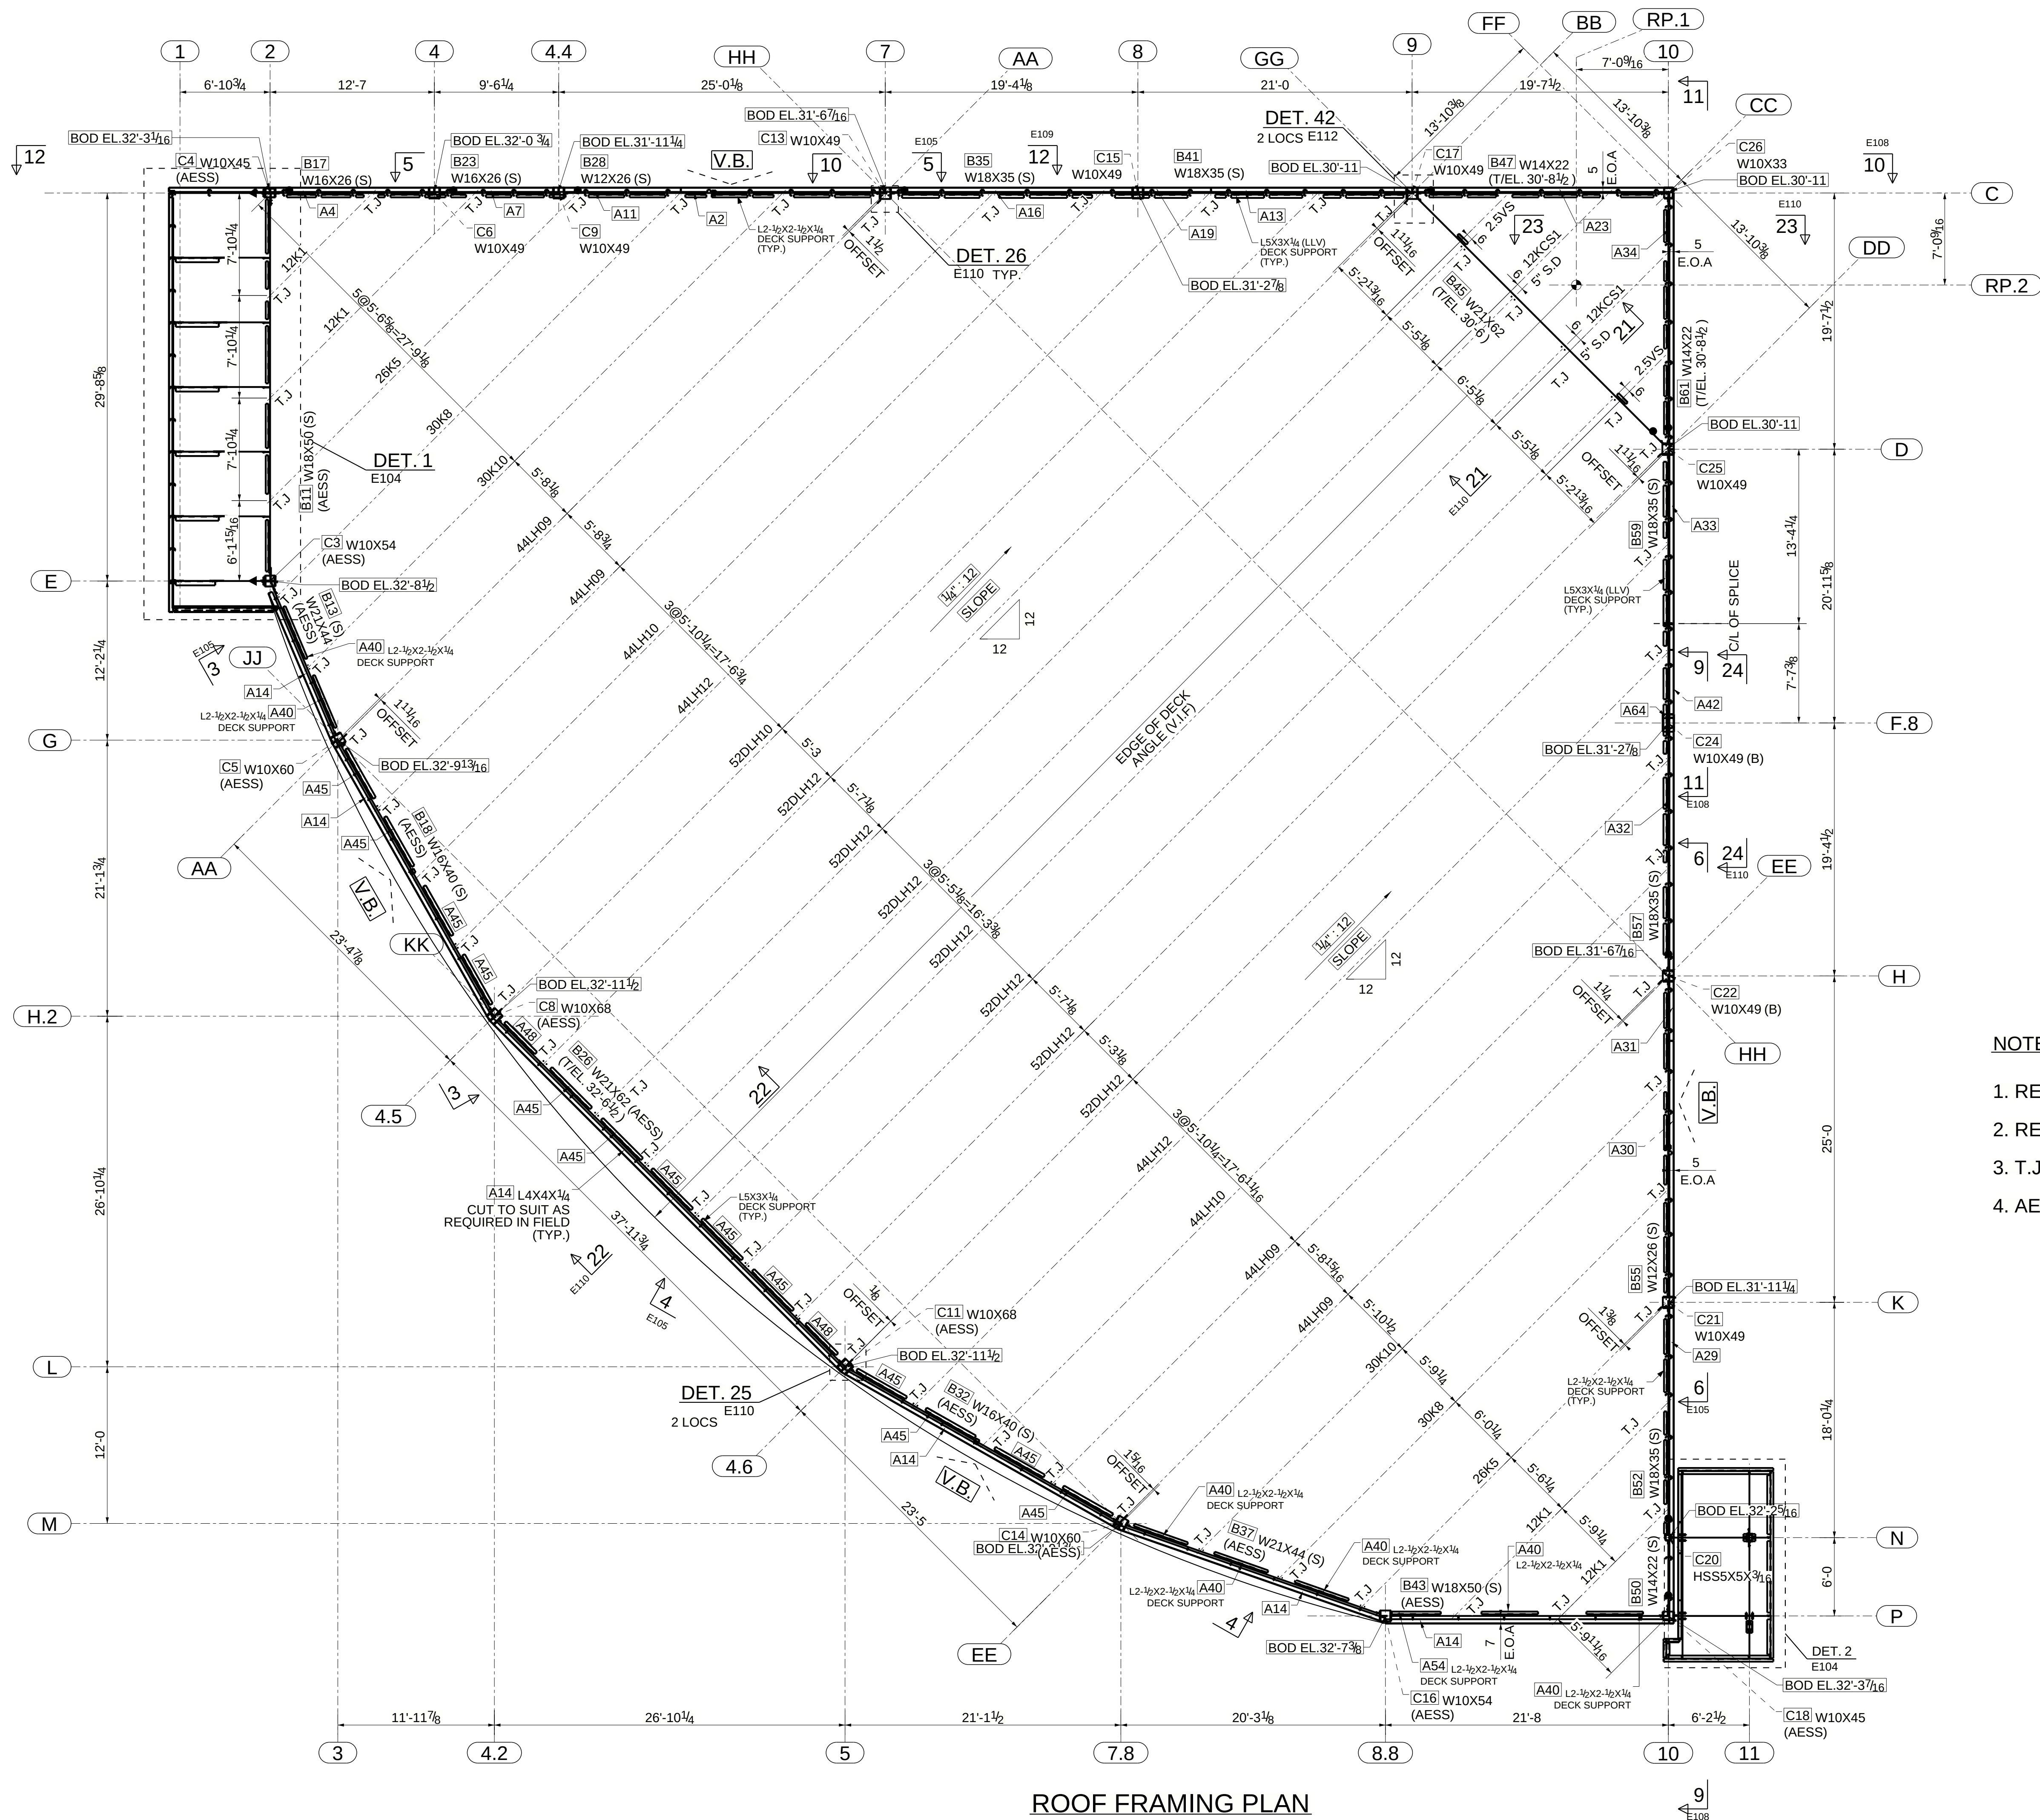


- NOTES:-
1. REFER E100 SHEET FOR GENERAL NOTES.
 2. REFER E113 SHEET FOR TYPICAL SECTION & DETAILS.
 3. T.J - INDICATES TIE JOIST
 4. AECS - INDICATES ARCHITECTURALLY EXPOSED STRUCTURAL STEEL

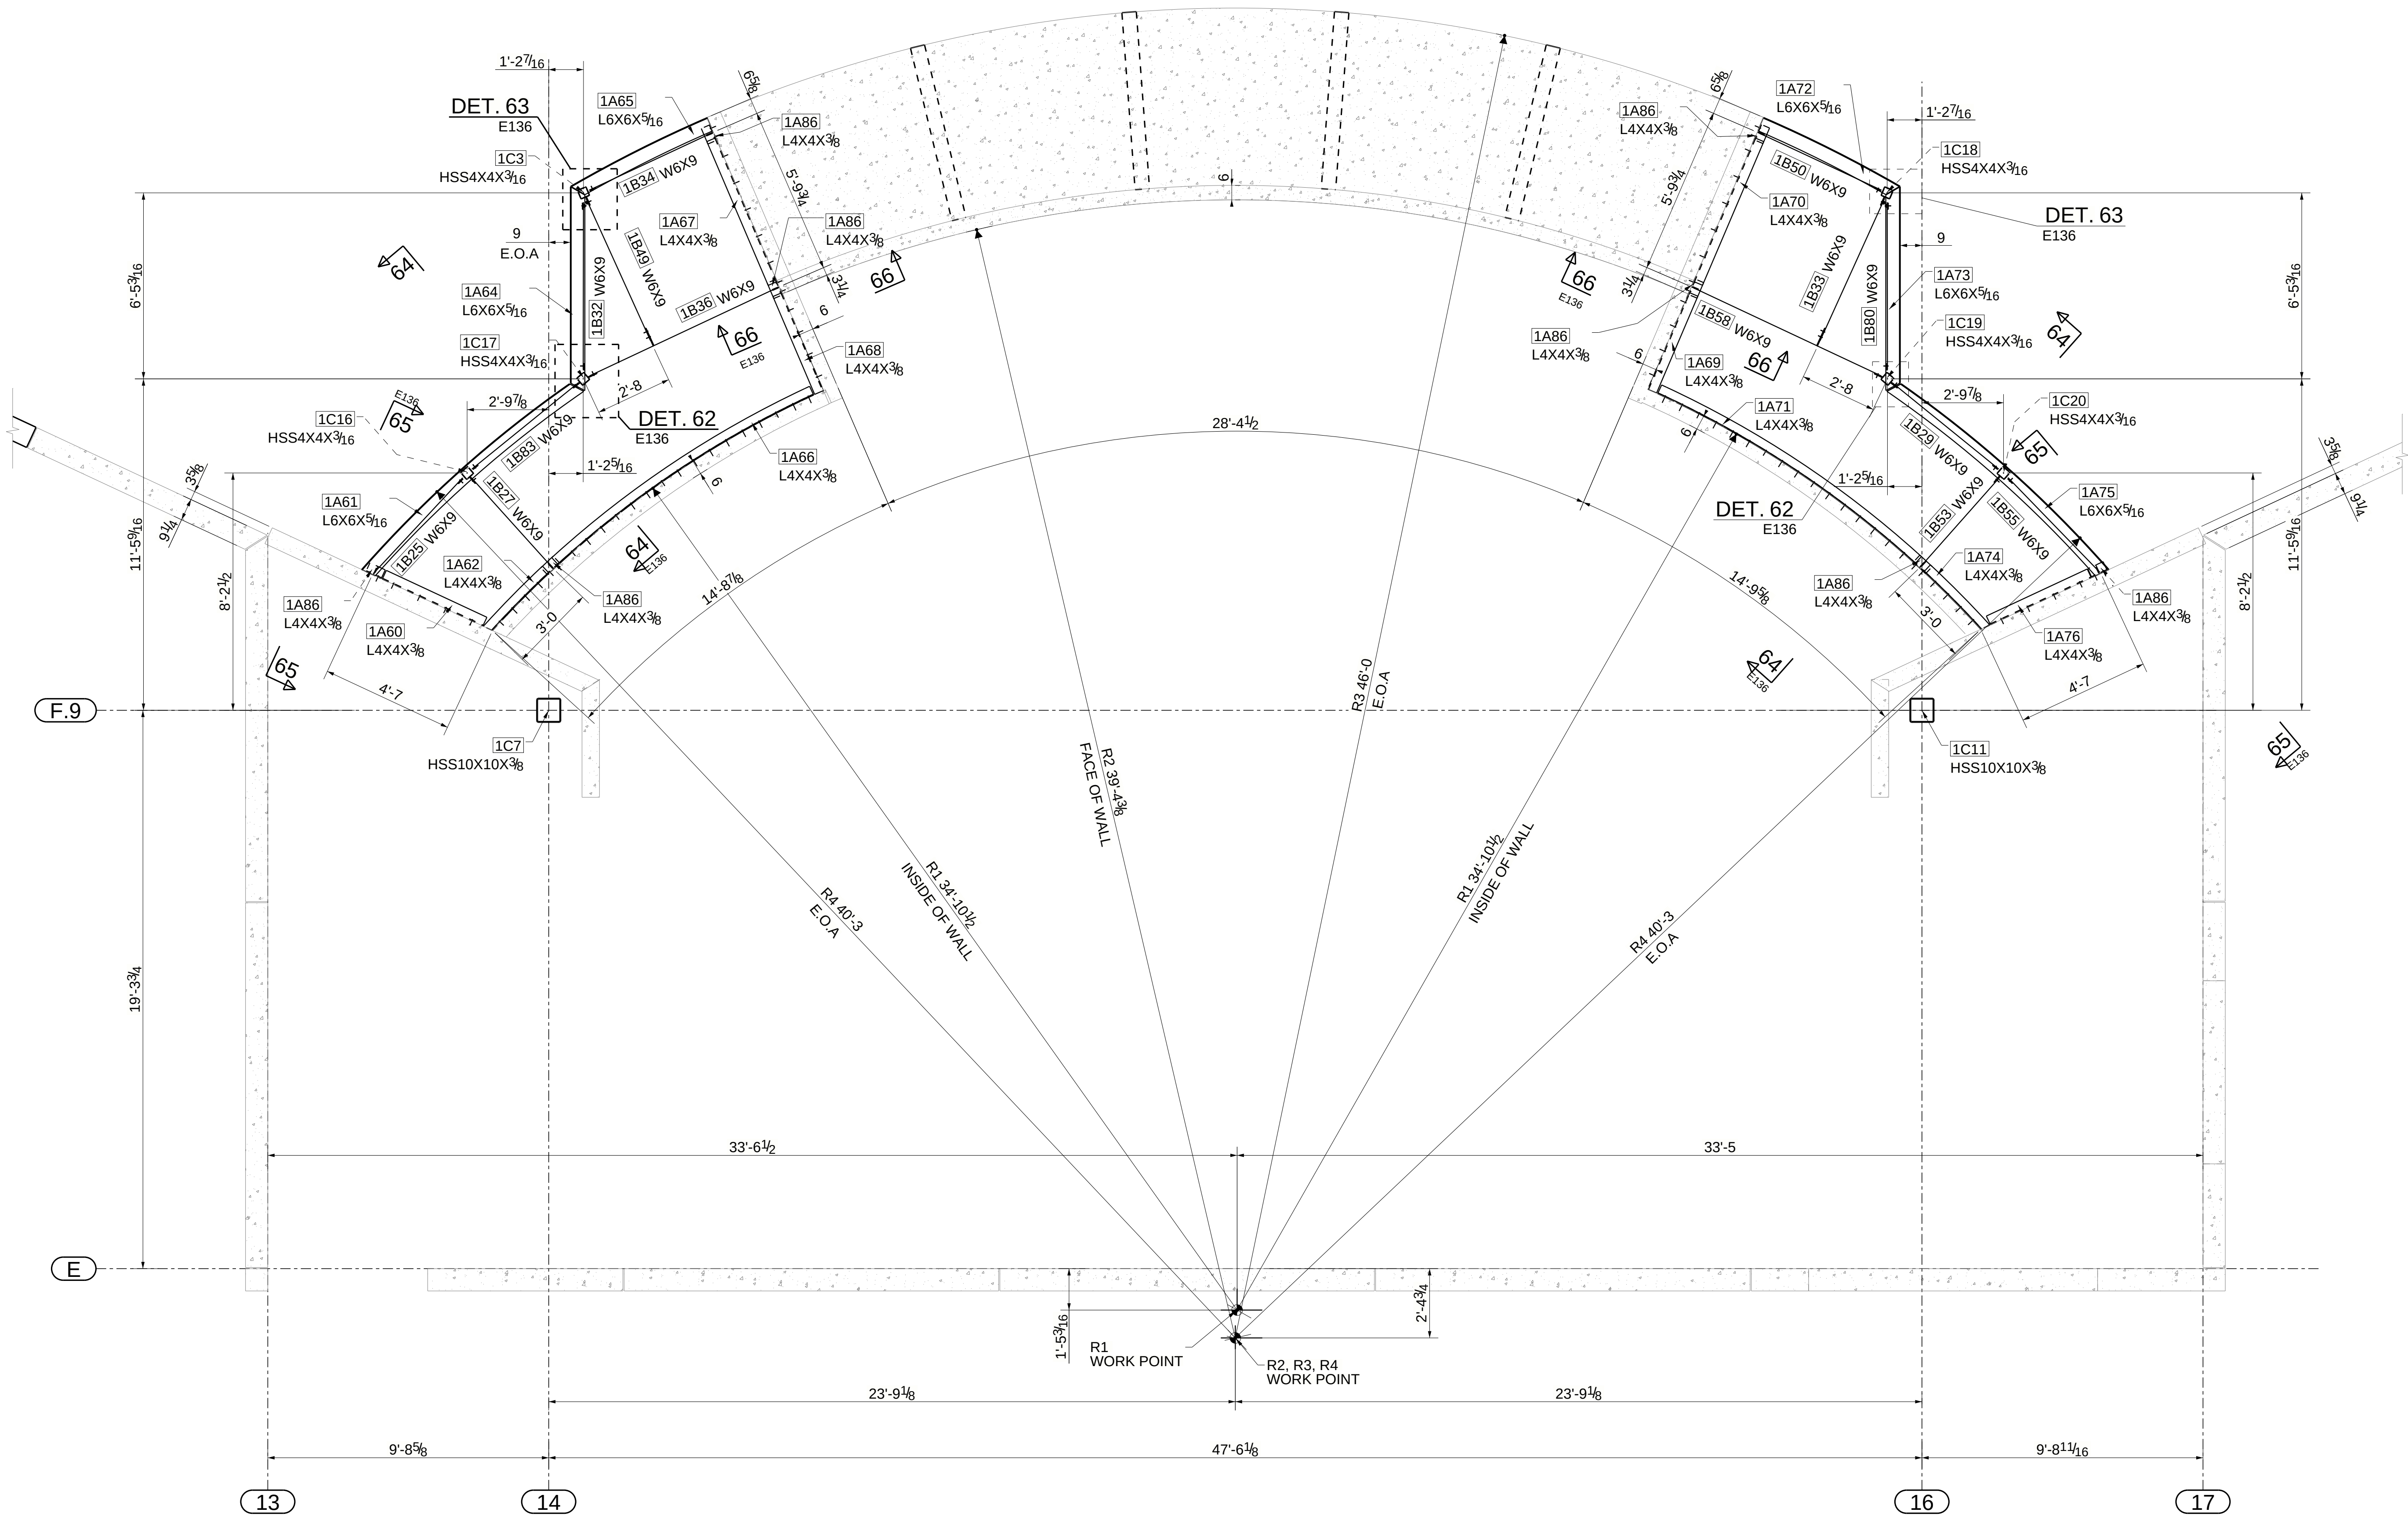


DETAIL P
E101
PARTIAL WORSHIP FRAMING PLAN
@ TOP OF BEAM ELEVATION = 2'-4 1/2"
(REFER : 1/FOUNDATION PLAN - MAIN WORSHIP / S-102)


- NOTES:-
1. REFER E100 SHEET FOR GENERAL NOTES.
 2. REFER E138 SHEET FOR TYPICAL SECTION & DETAILS.

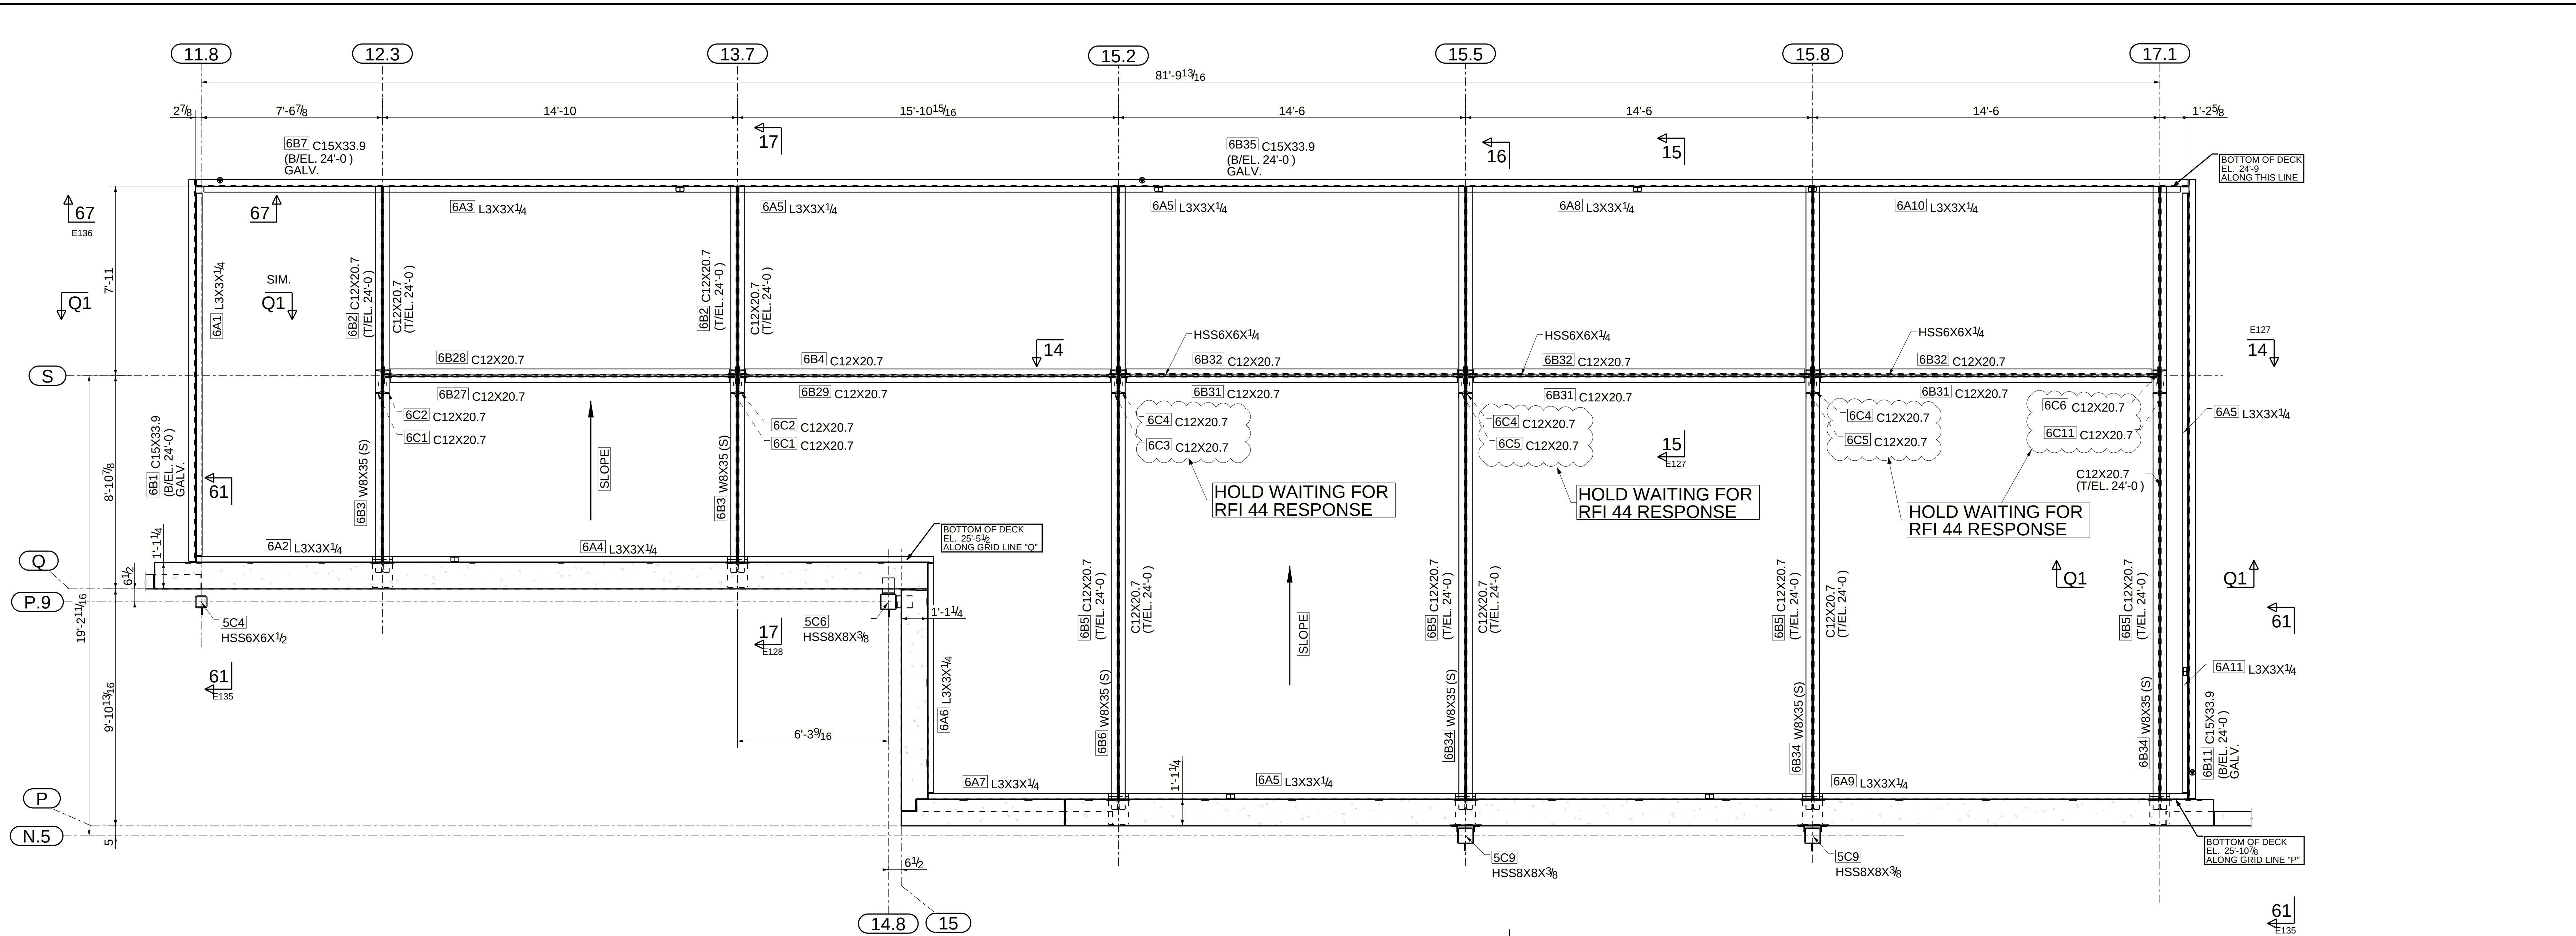

DETAIL Q
E101
CANOPY FRAMING PLAN
(REFER: ROOF FRAMING - MAIN LOBBY / S-201)

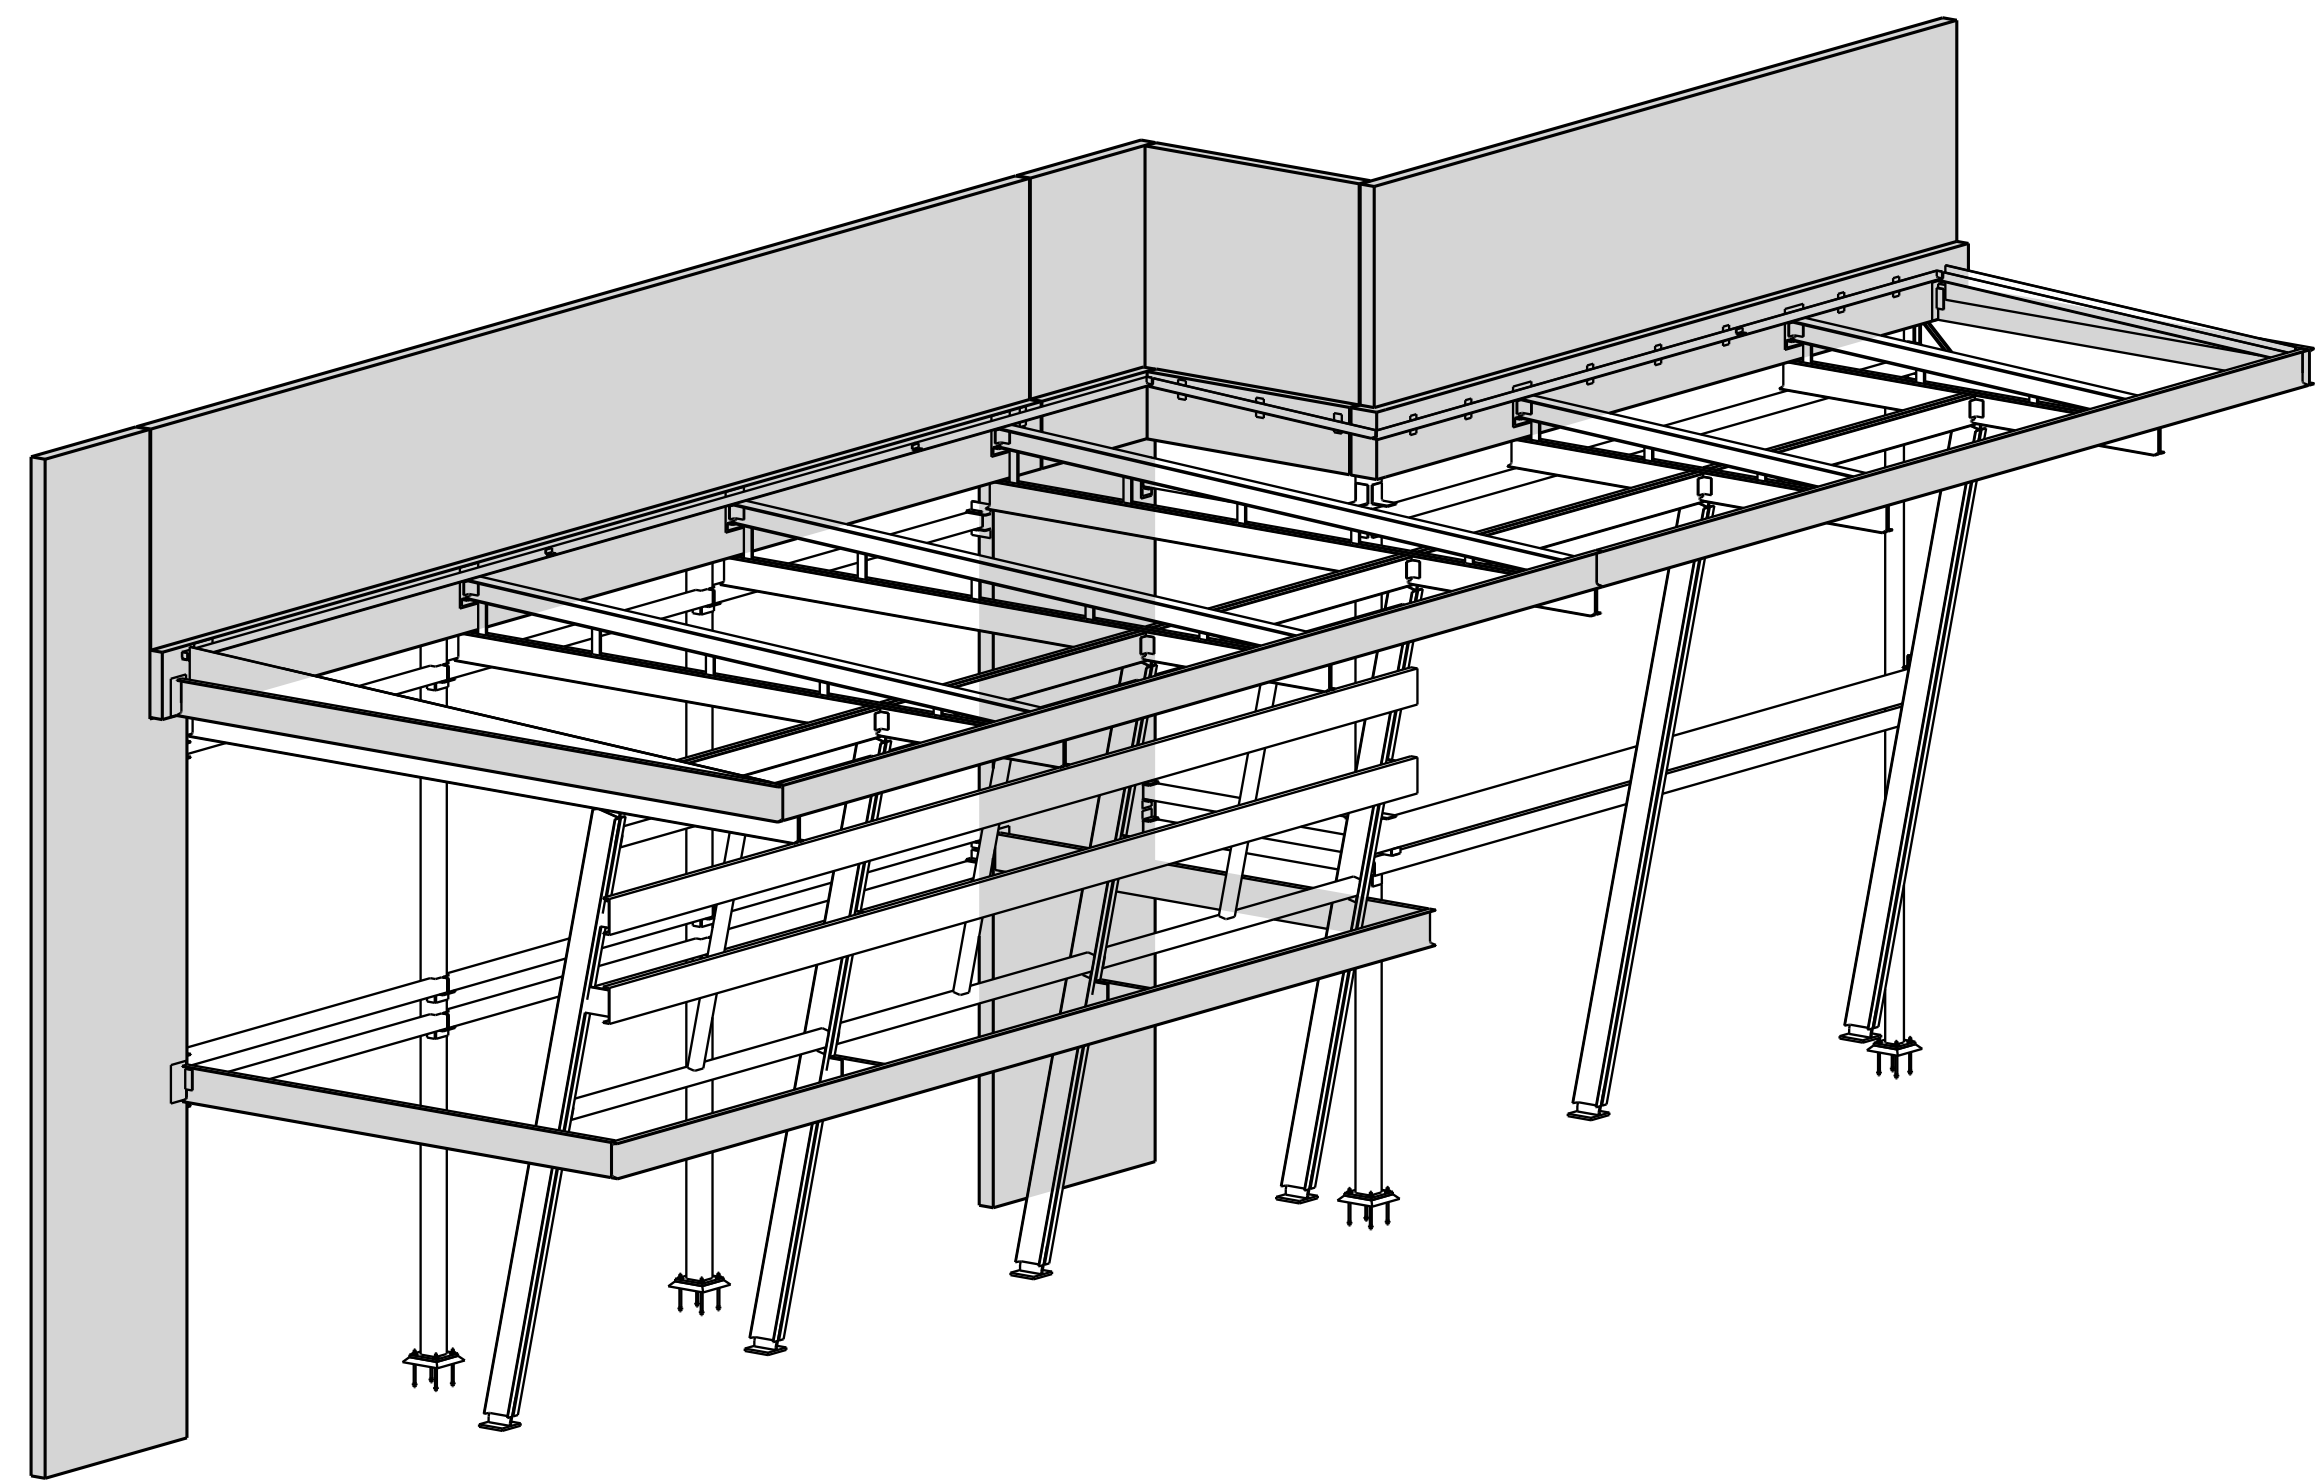



- NOTES:-
1. REFER E100 SHEET FOR GENERAL NOTES.
 2. REFER E138 SHEET FOR TYPICAL SECTION & DETAILS.

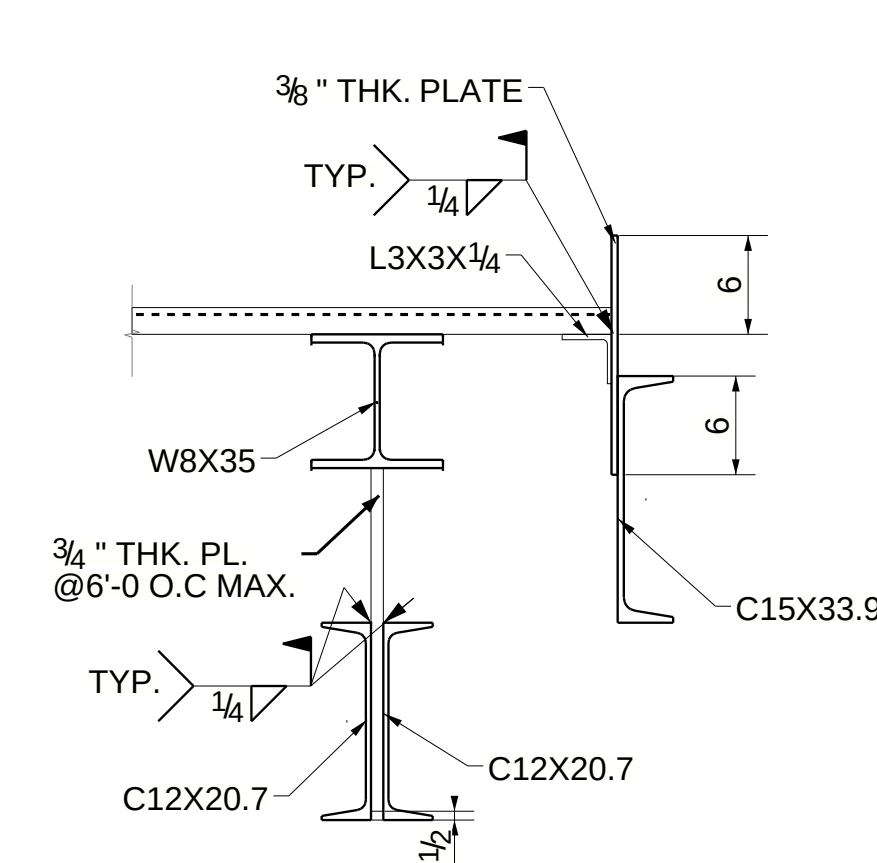


SECTION Q1 - Q1

(REFER: SECTION 4/S403)

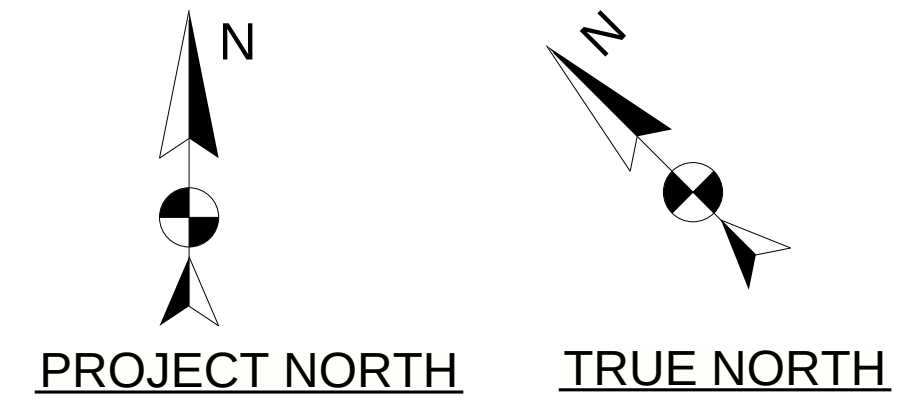


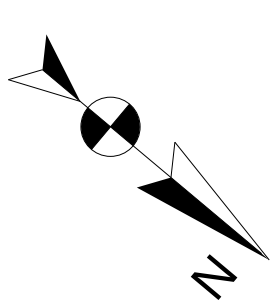

TRUE NORTH




PROJECT CALLED NORTH

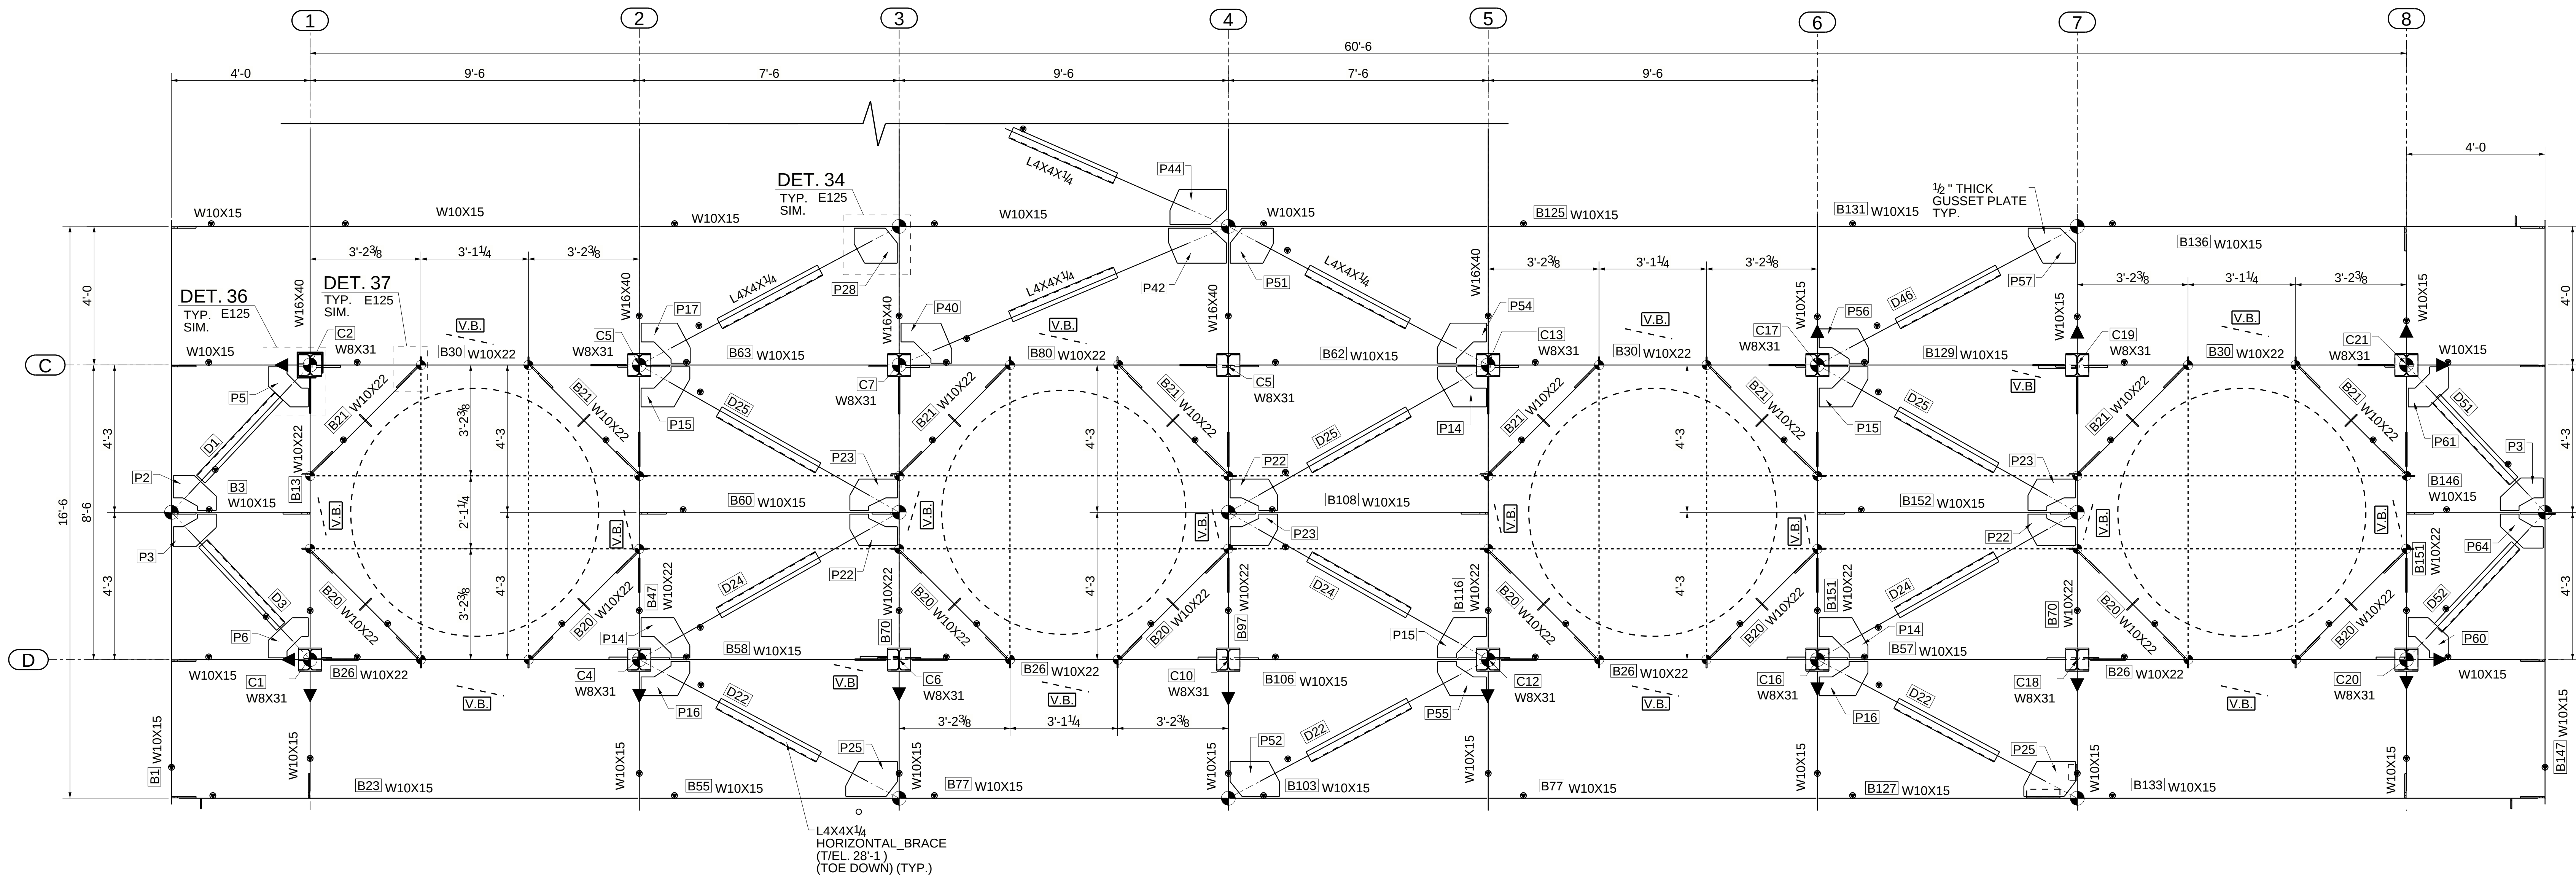

DETAIL B
E014


PARTIAL ROOF FRAMING PLAN
@T/O BEAM (EL. 28'-4") & T/O GRATING (EL.28'-5 1/2") TYP. U.N.O.
(REFER : FRAMING PLAN AT (+) 28'-4"/ S-105)

- NOTES:-
1. REFER E100 SHEET FOR GENERAL NOTES.
 2. REFER E126 & E127 SHEET FOR TYPICAL SECTION & DETAILS.

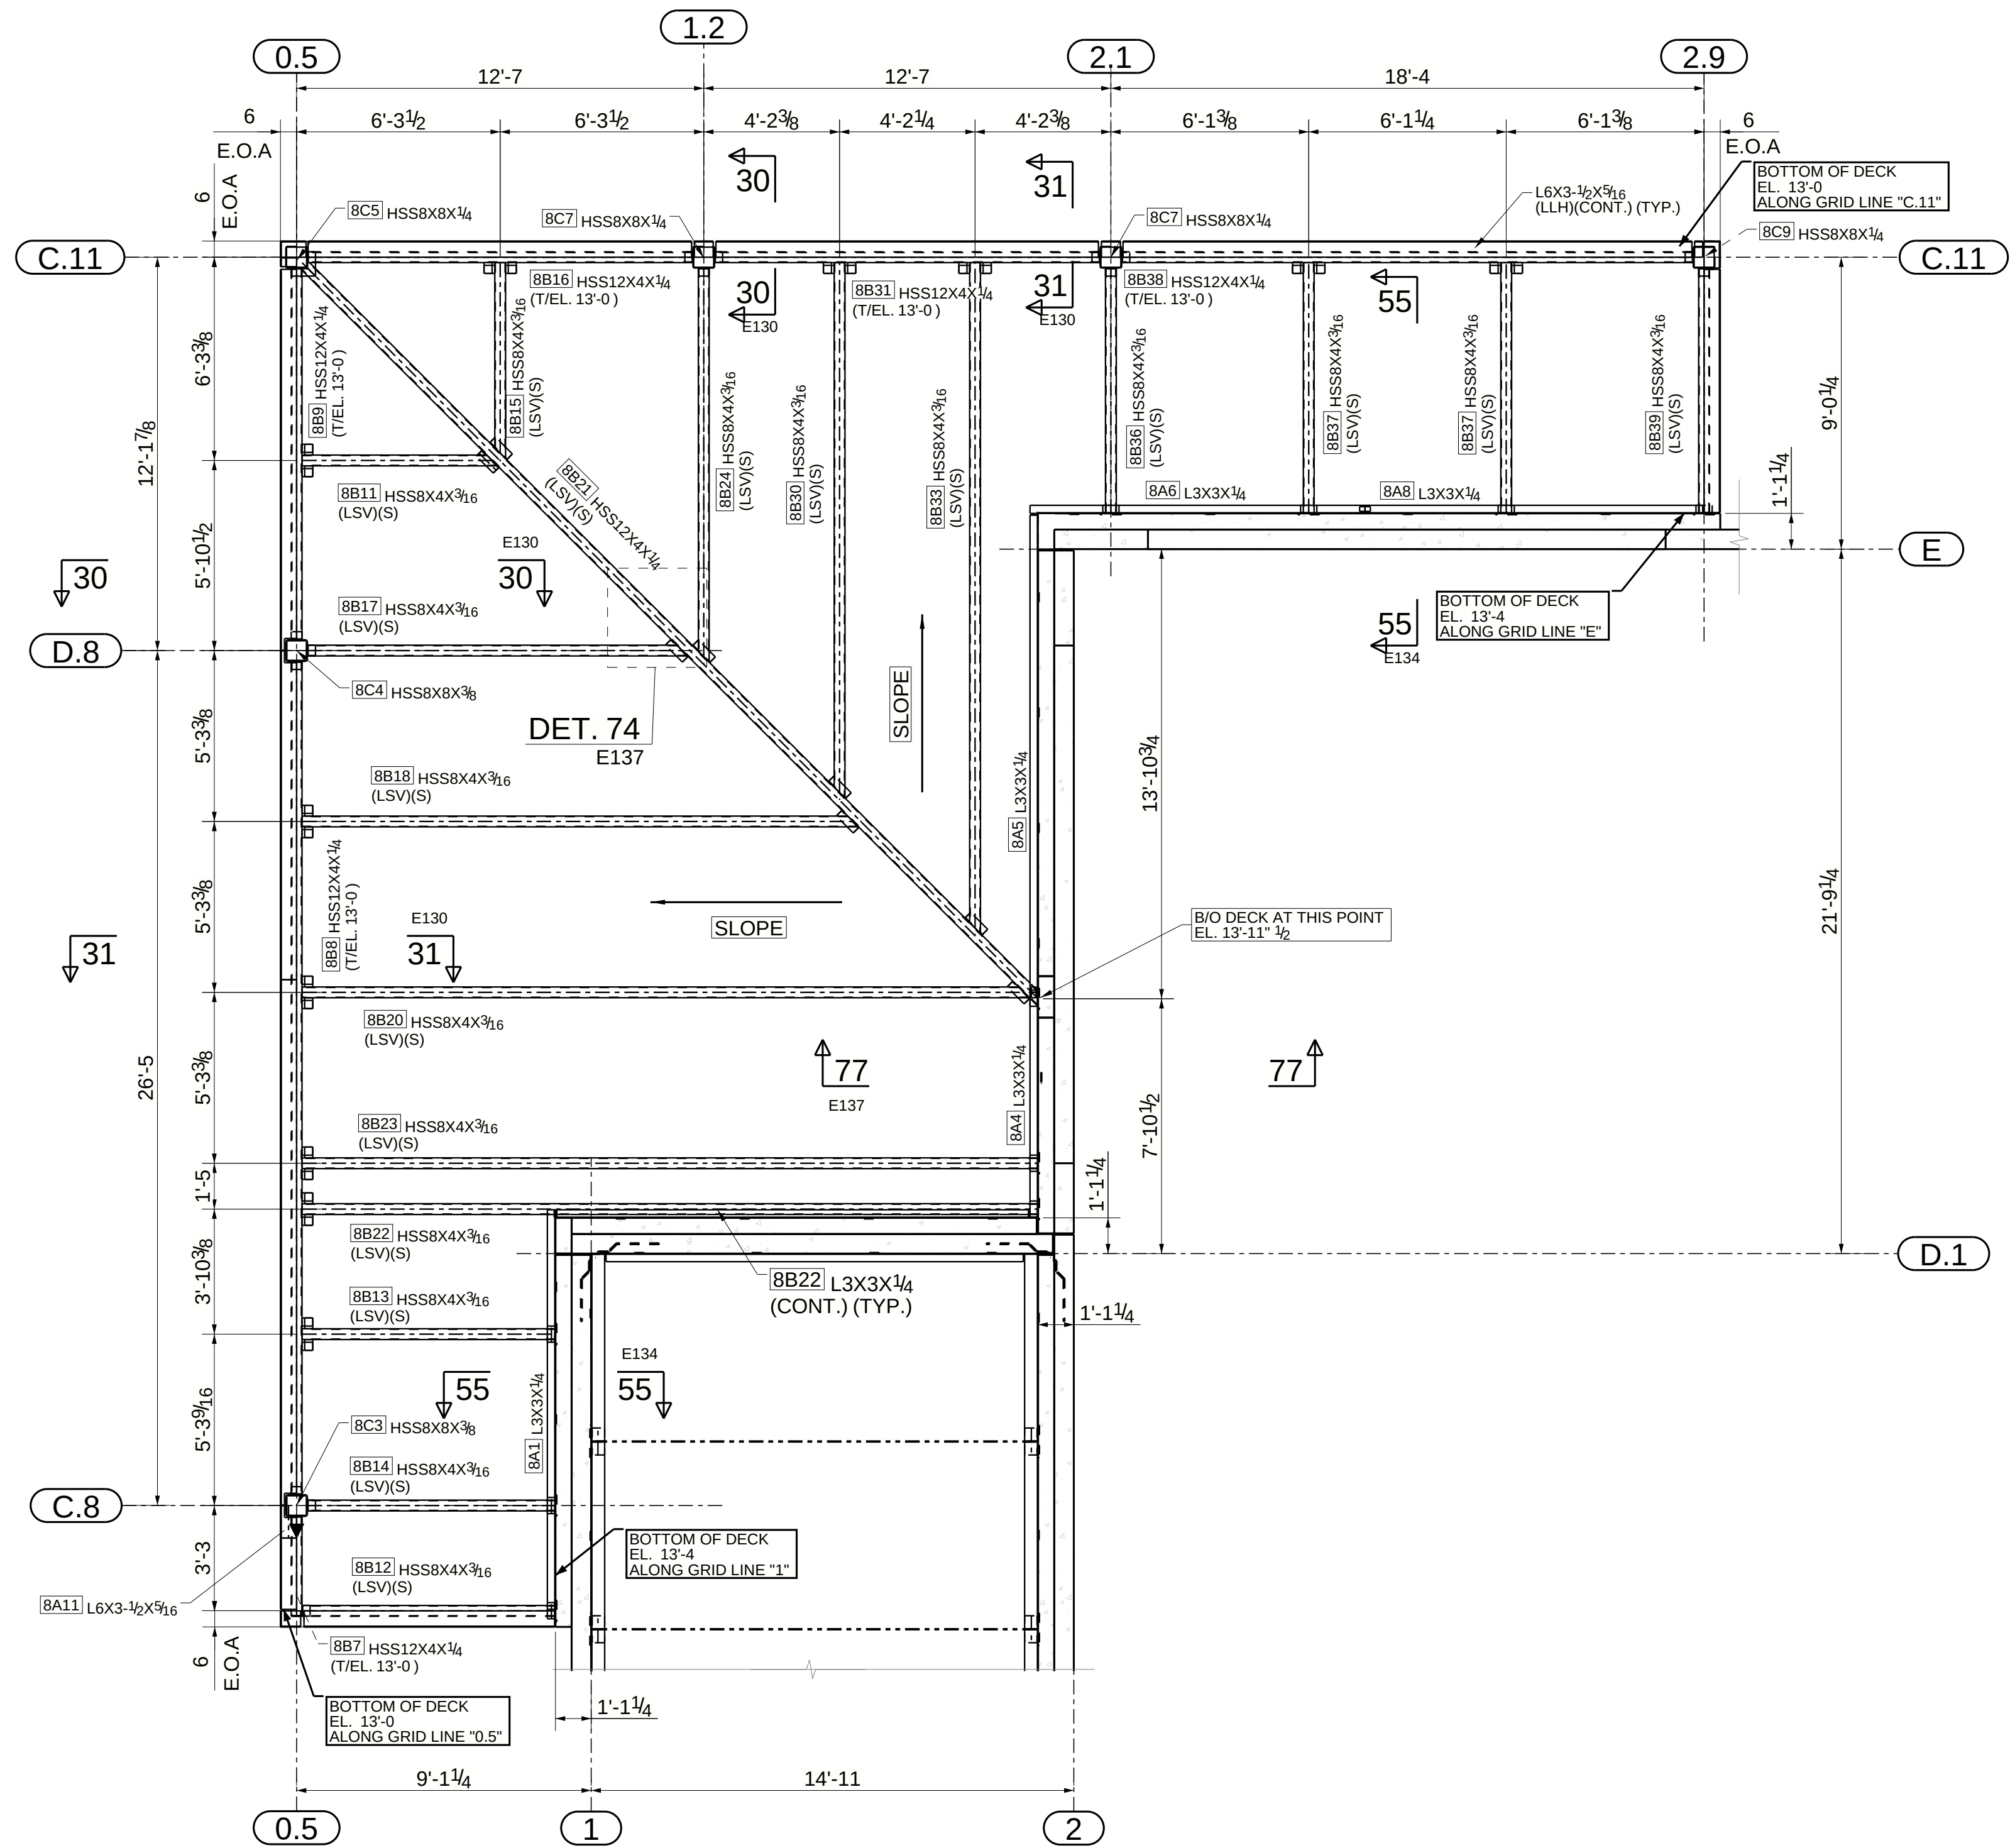

DETAIL V
E101
CANOPY FRAMING PLAN

(REFER: ROOF FRAMING PLAN- STUDENT BUILDING -S211)

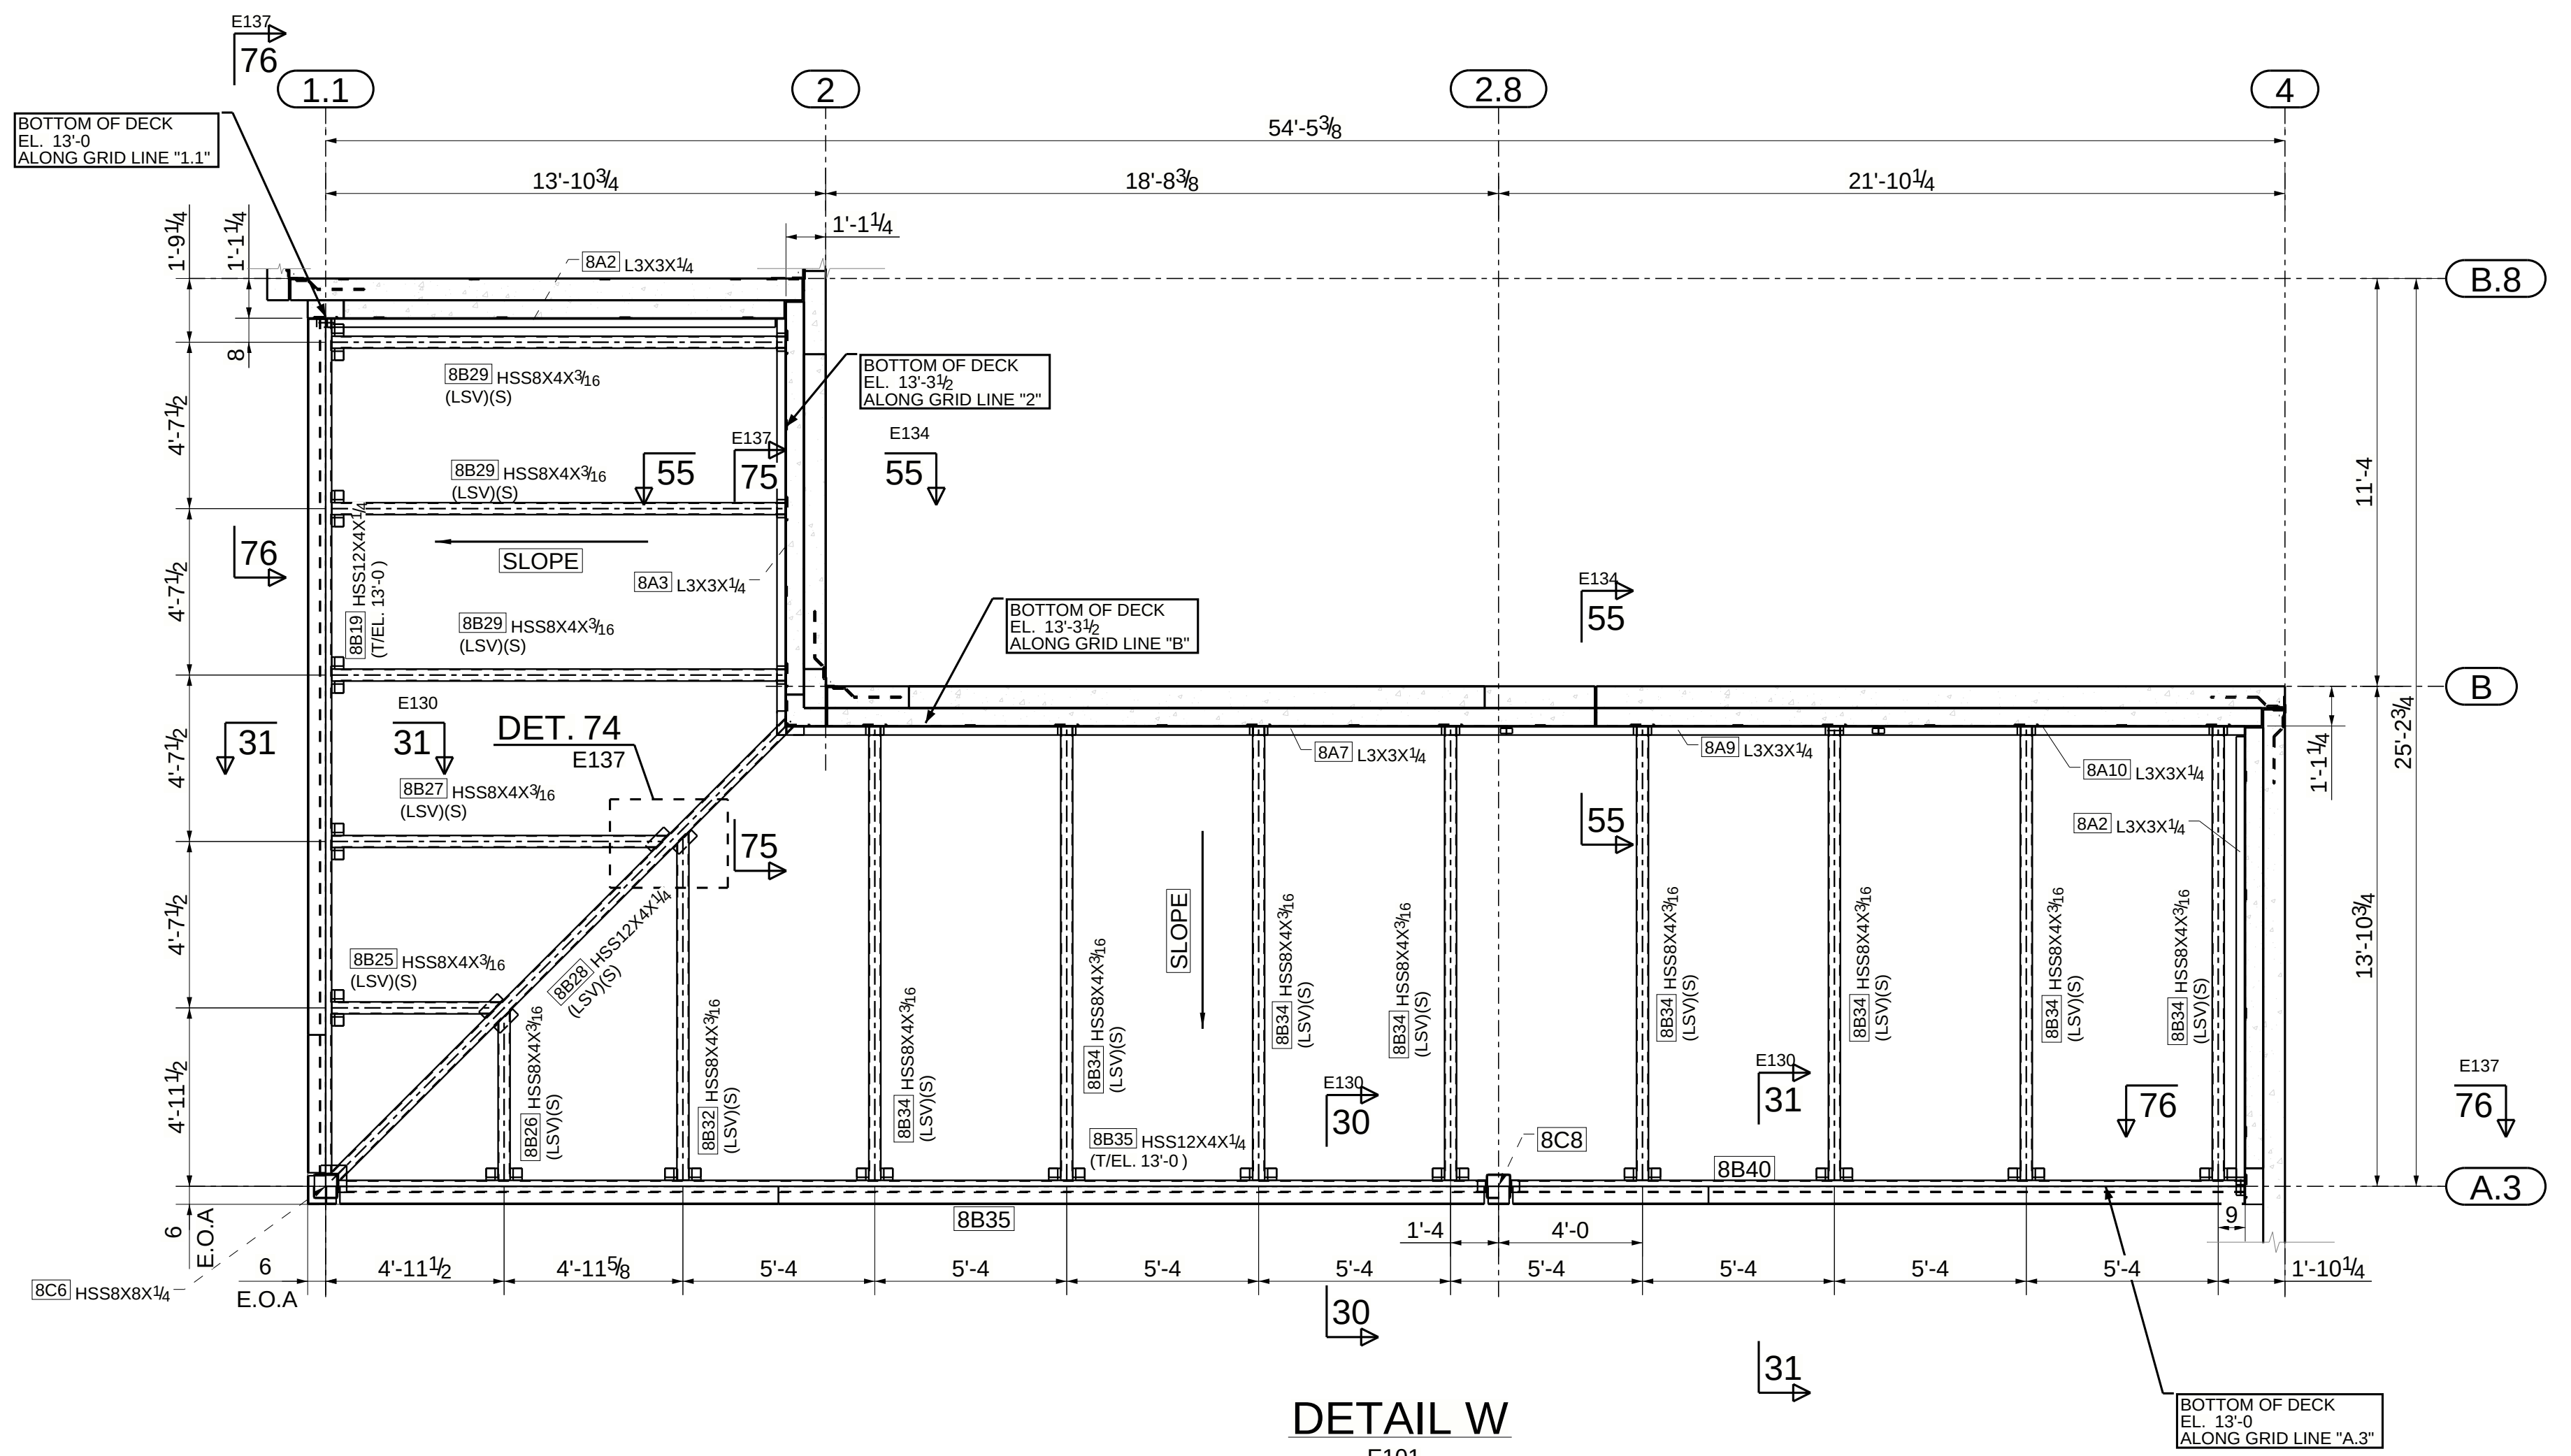

DETAIL W
E101
CANOPY FRAMING PLAN
(REFER: ROOF FRAMING PLAN- STUDENT BUILDING -S211)


NOTES:-

1. REFER E100 SHEET FOR GENERAL NOTES.
2. REFER E138 SHEET FOR TYPICAL SECTION & DETAILS.




REFER ELEVATION SHEETS FOR
PARAPET POST INFORMATIONS

FOR FIELD USE : 08/23/2023

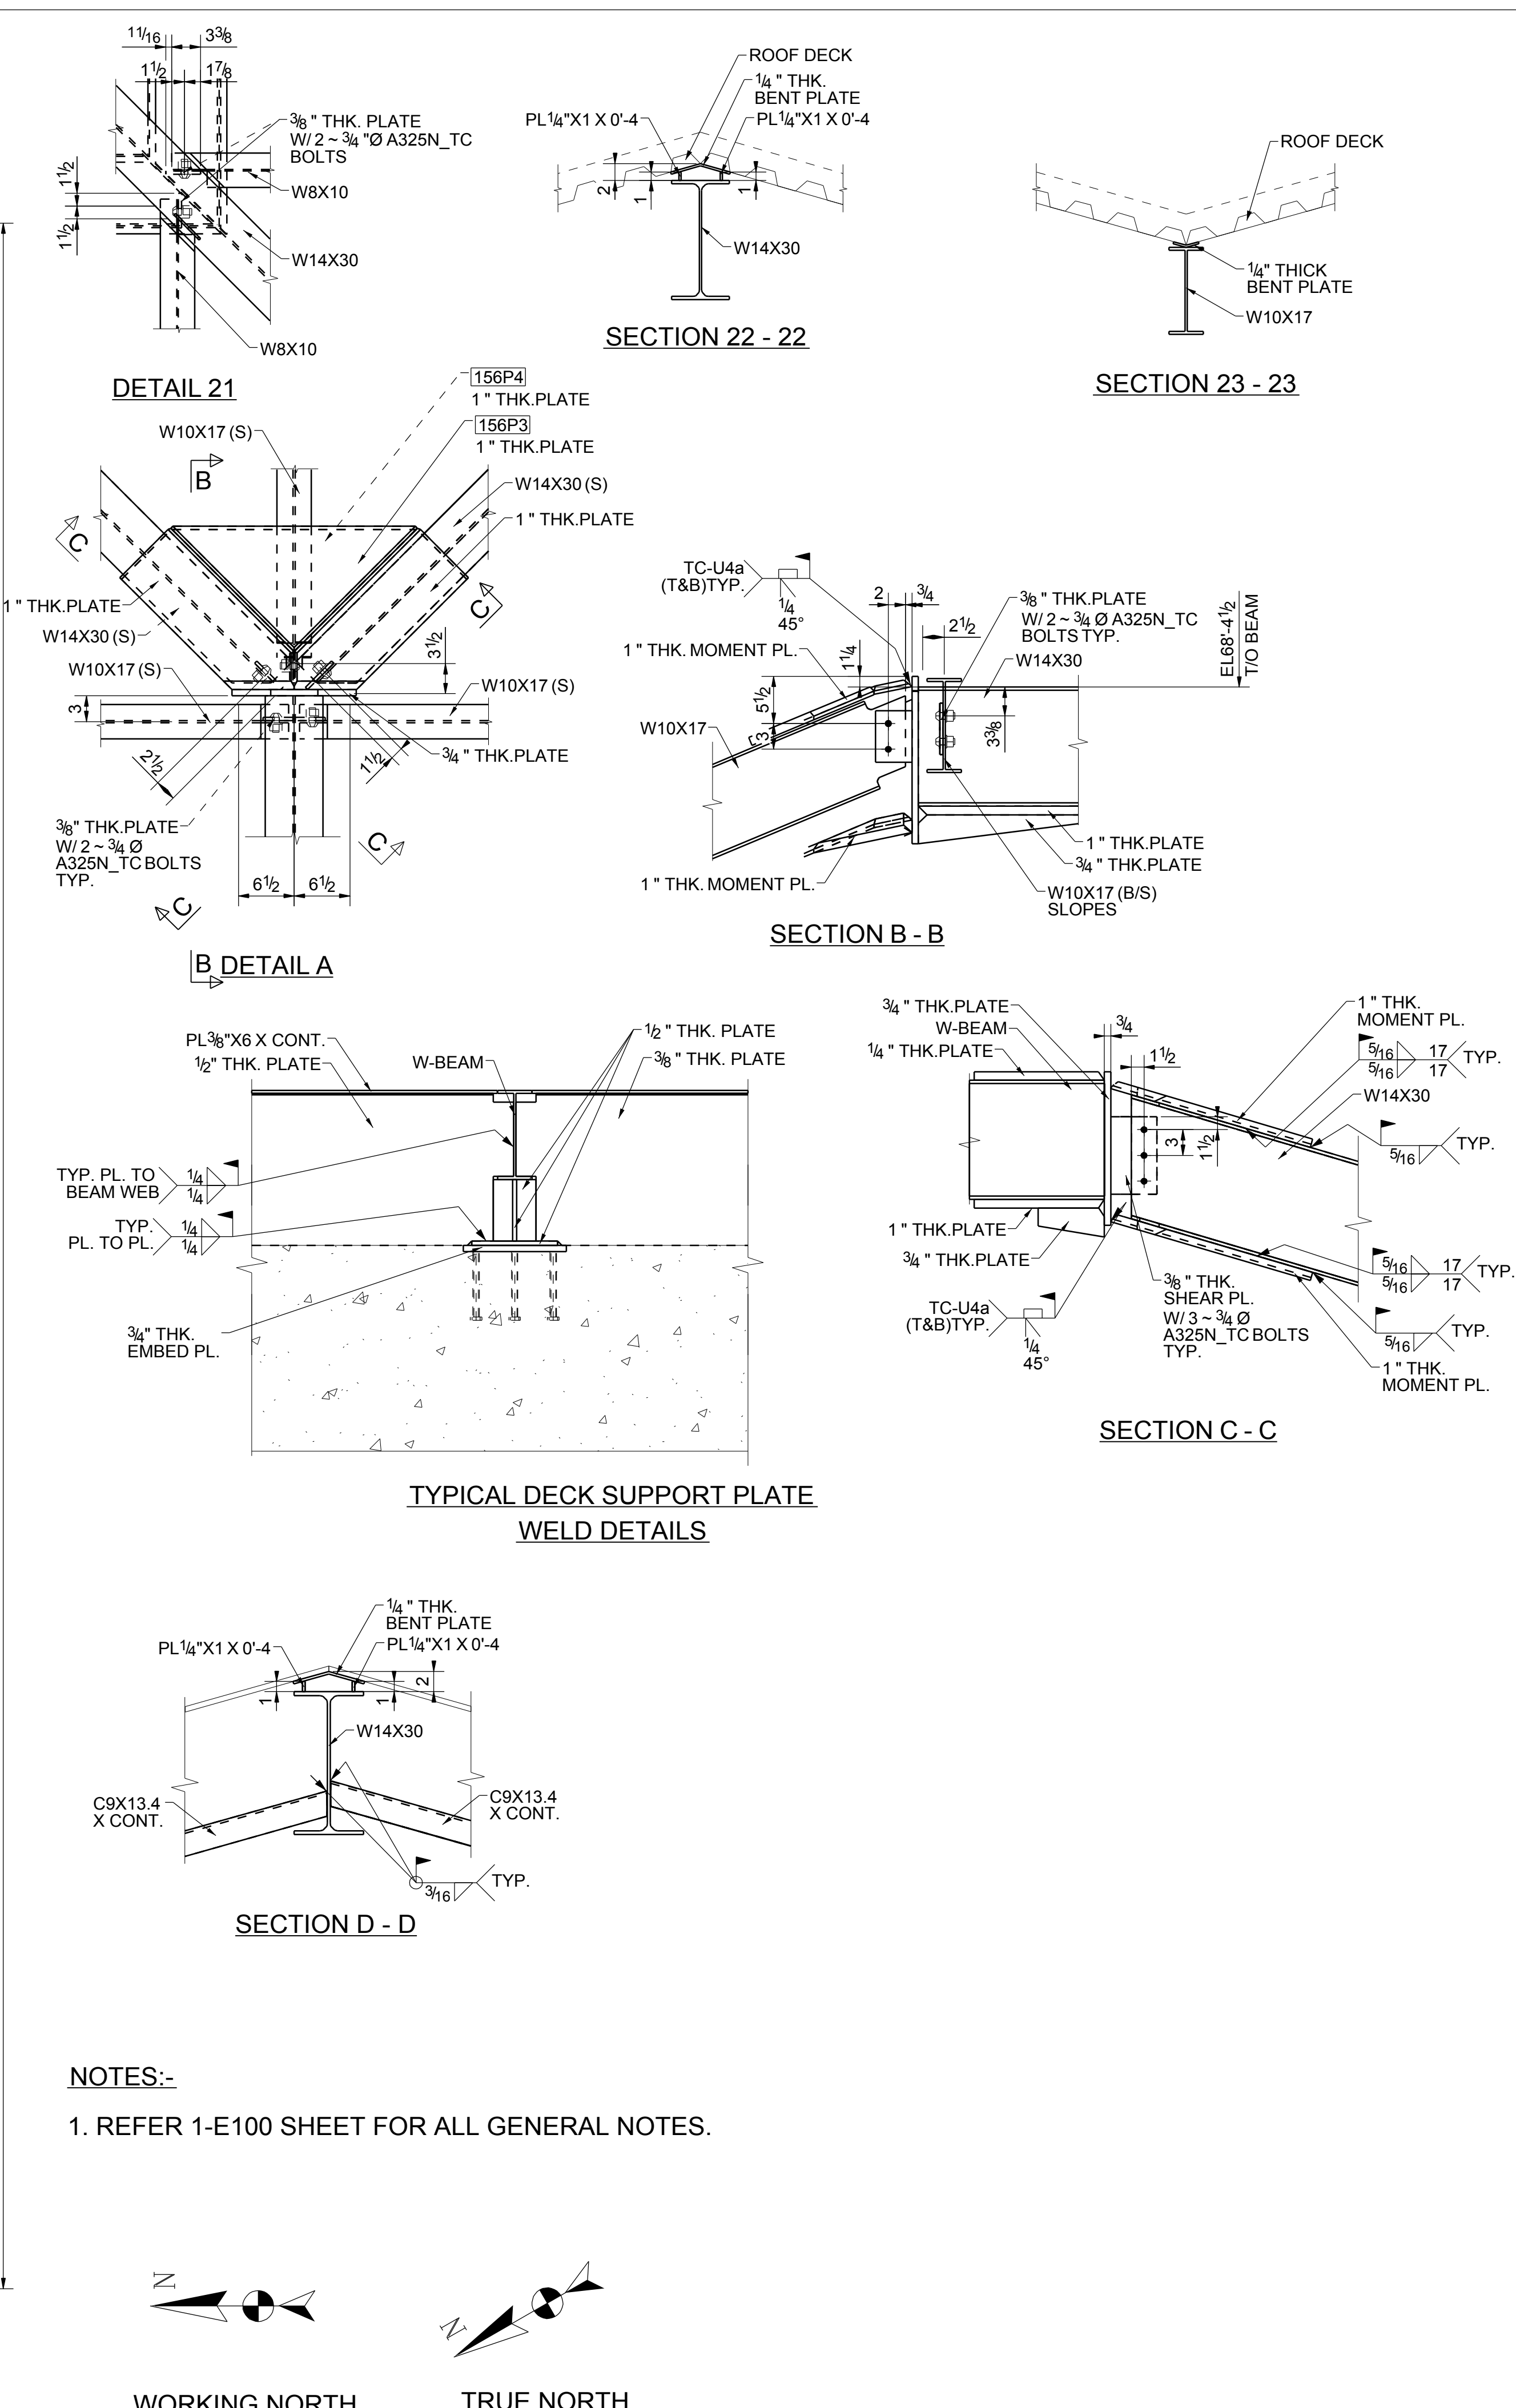


NOTES:-



1. REFER 1-E100 SHEET FOR ALL GENERAL NOTES.

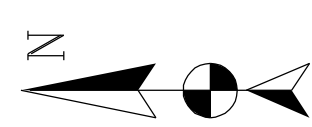

WORKING NORTH

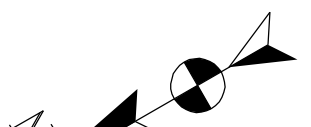



TRUE NORTH

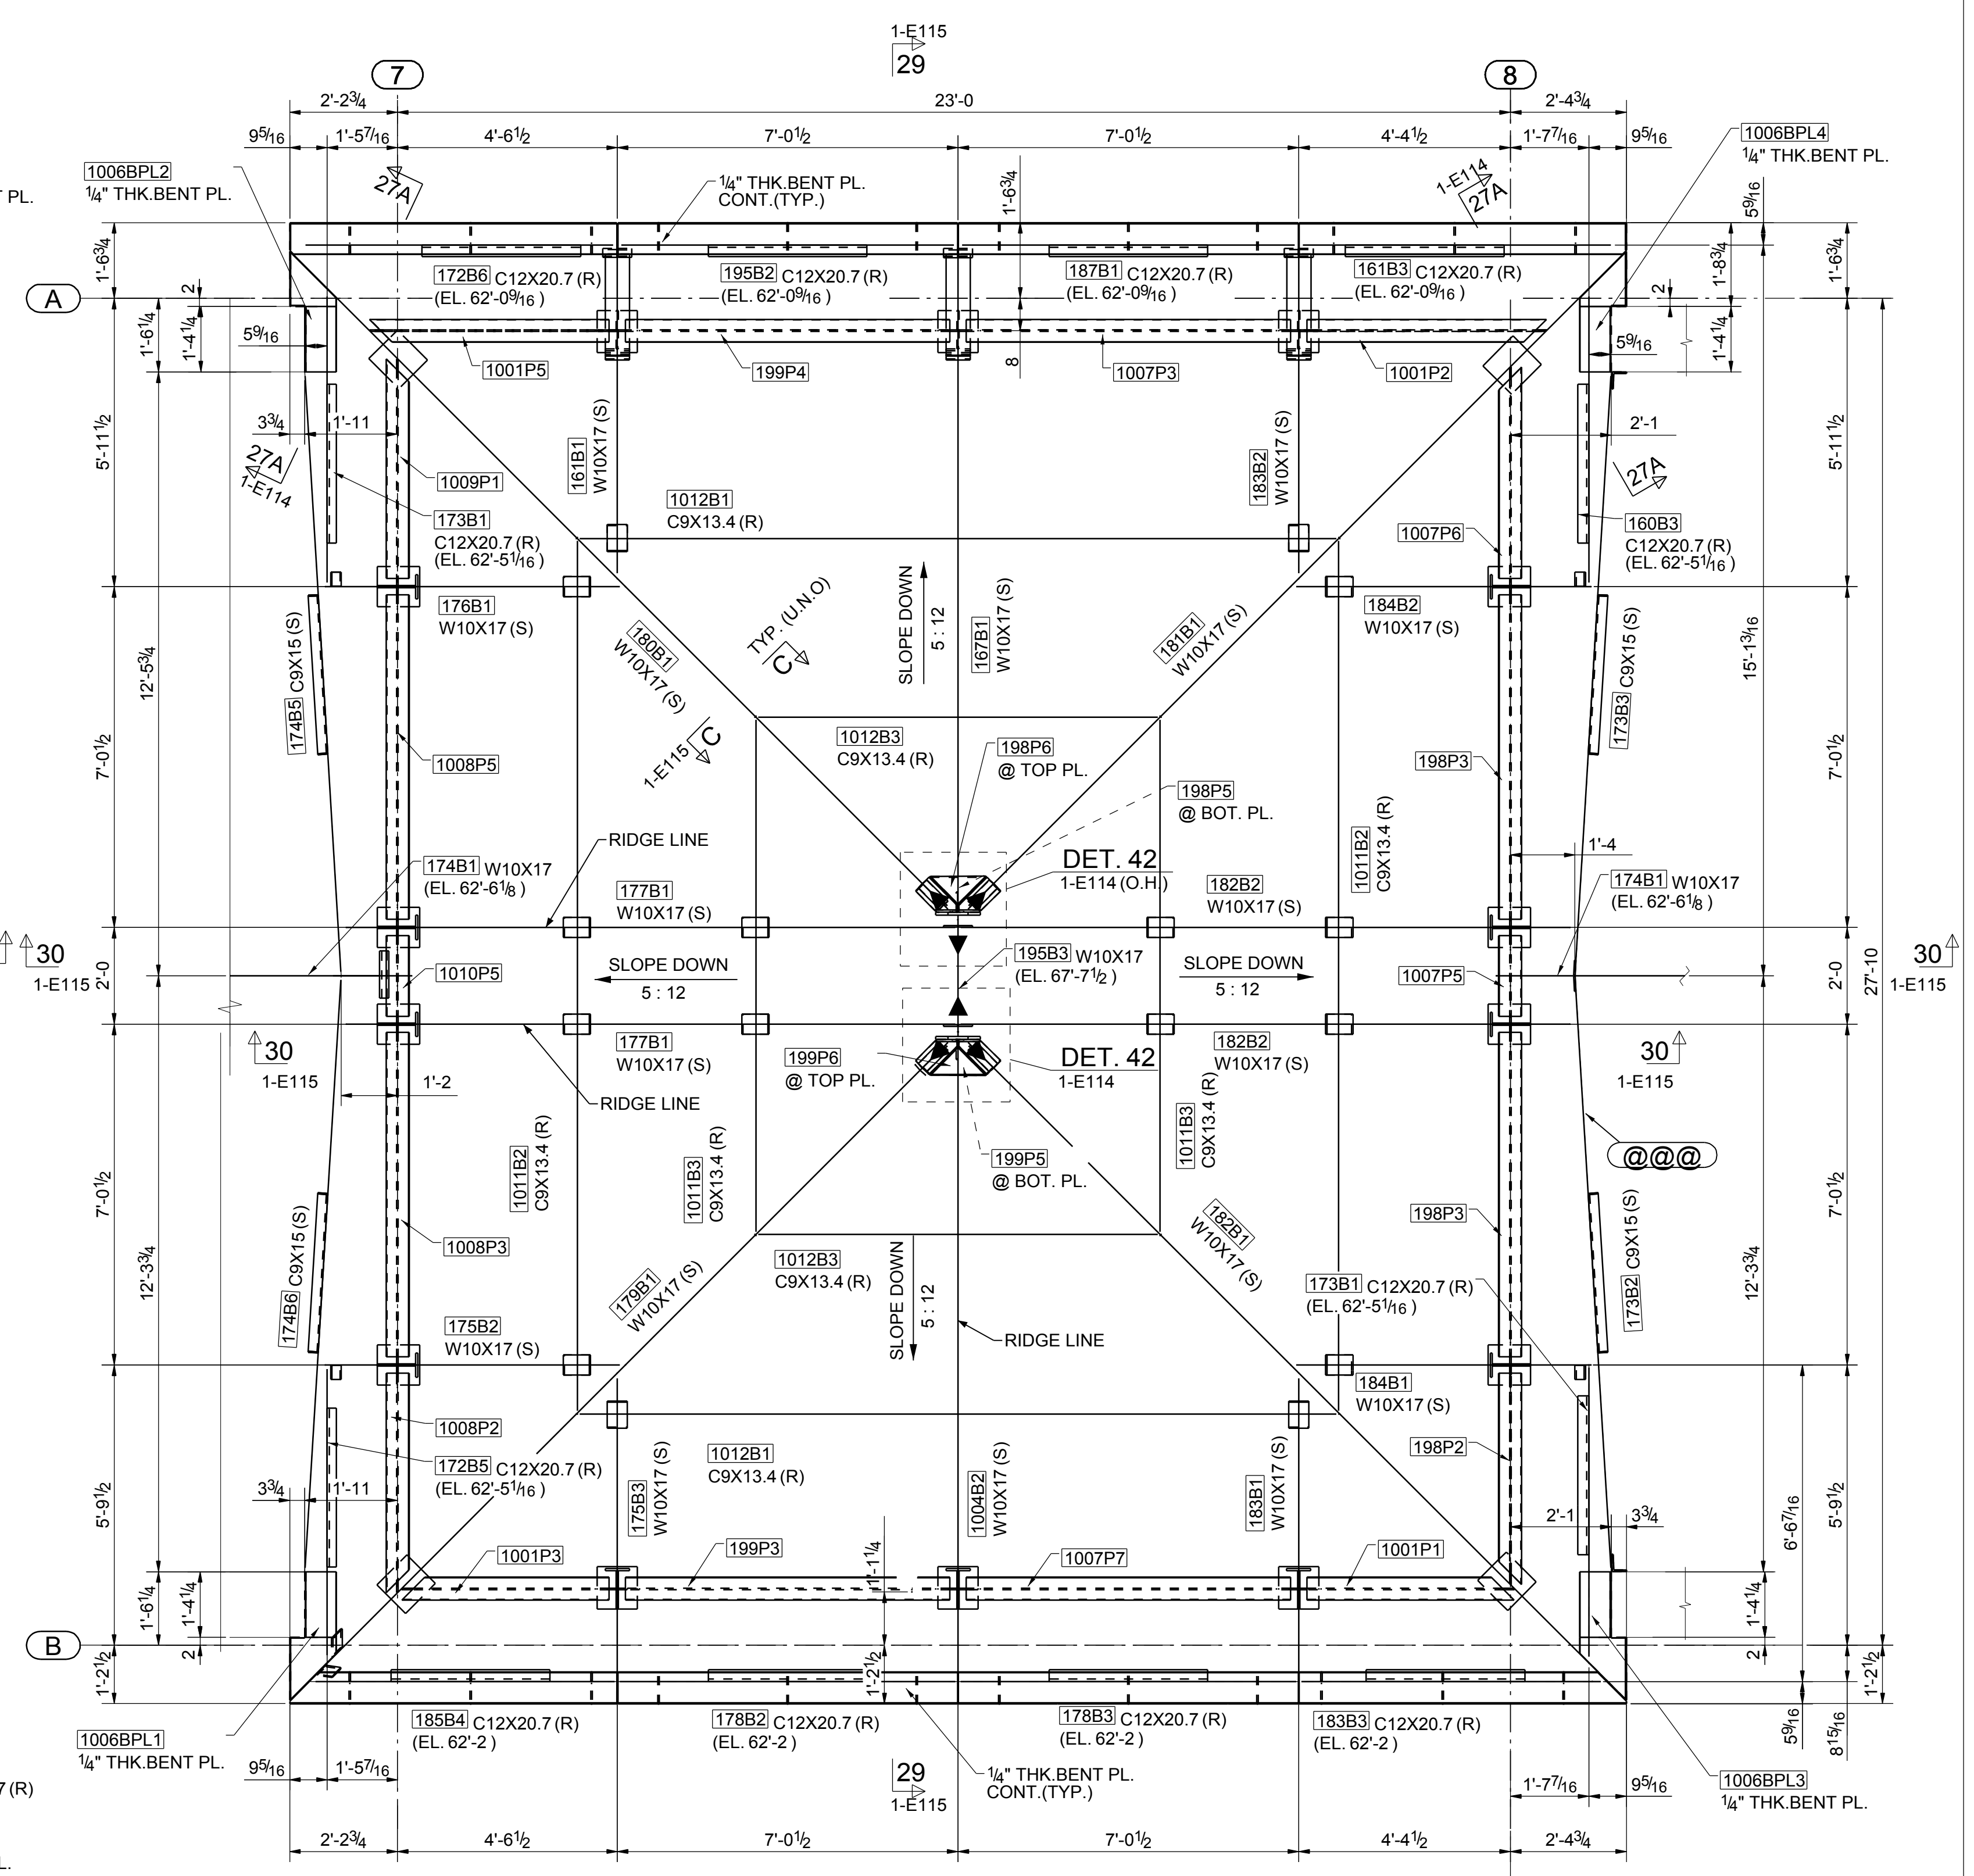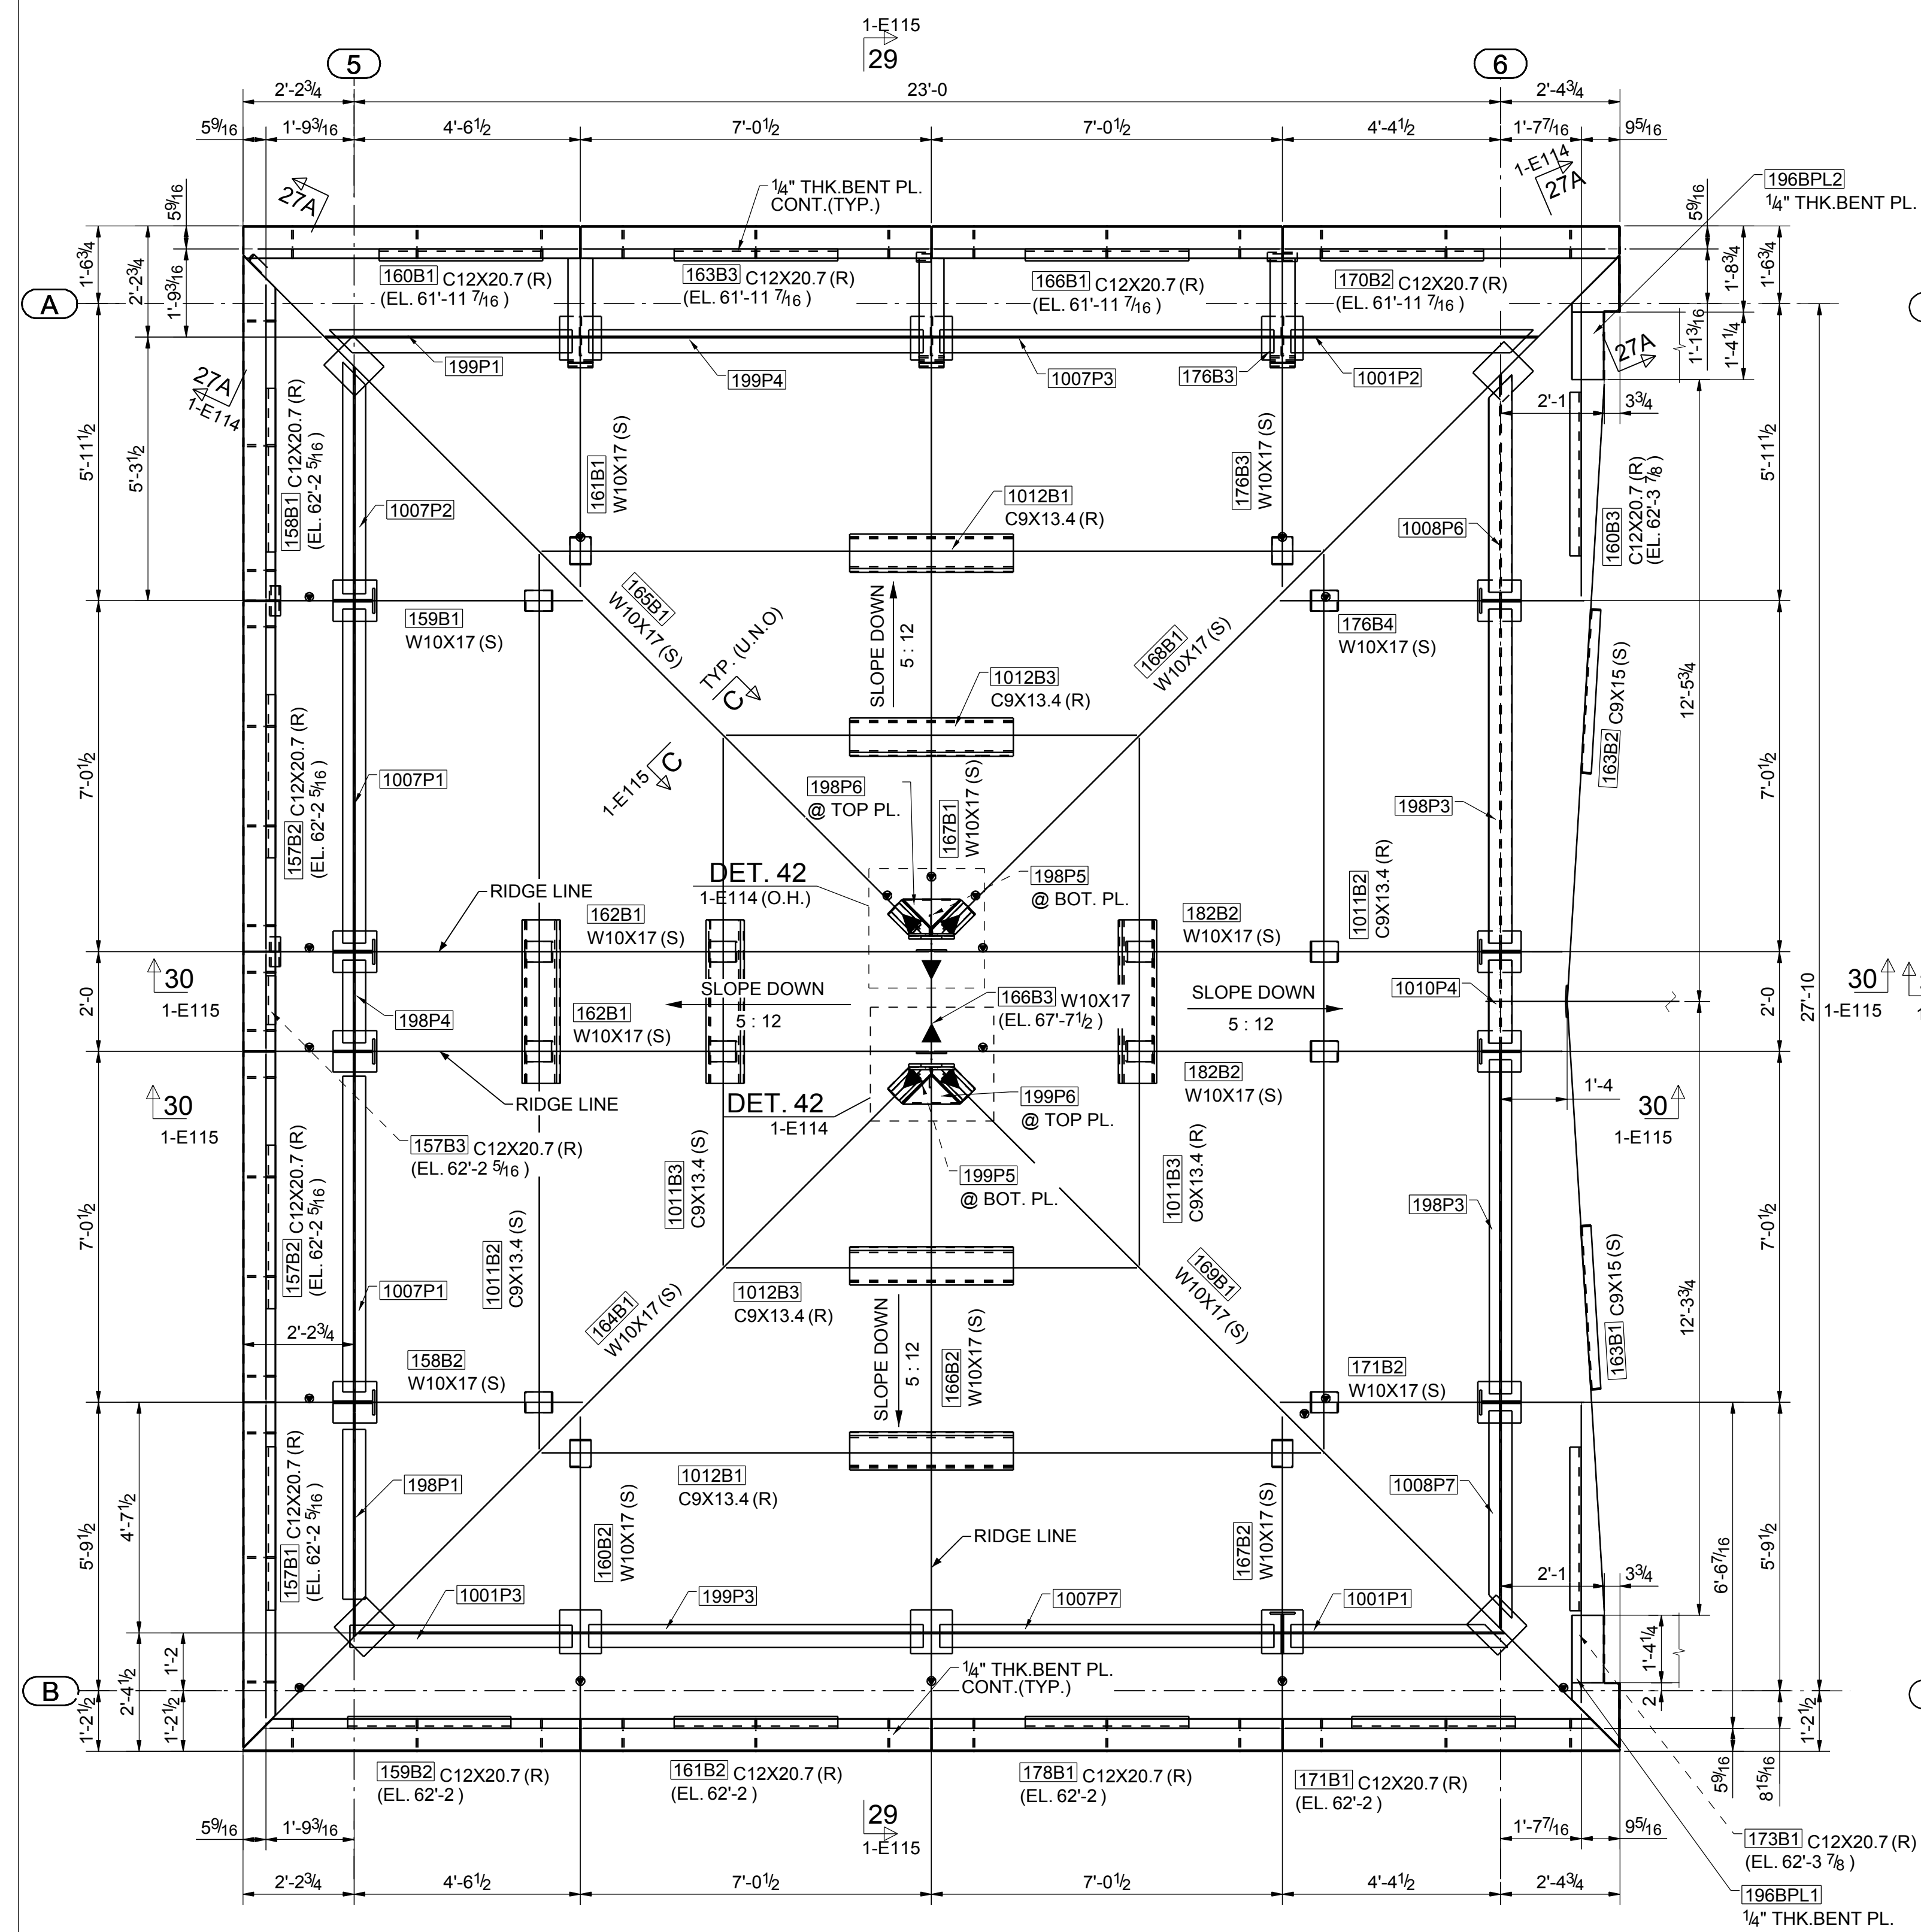


FOR FIELD USE :10/04/2019

NOTES:-

1. REFER 1-E100 SHEET FOR ALL GENERAL NOTES.

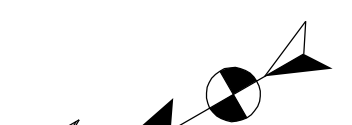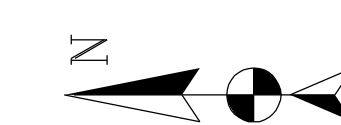

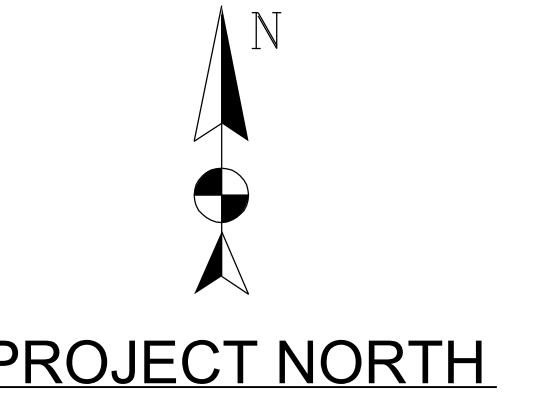

11

1'-8 3/4"

3/16"

341M3
HSS6X4X1/4
(LSH)

TILT-UP
PANEL

W-COLUMN

W-BEAM

E
L

HSS6X4X1/4
(LSH)(CONT.)


L3X3X1/4
(CONT.)

L4X4X1/4
(CONT.)

W-BEAM


DETAIL 53

FOR FIELD USE : 11/22/2021

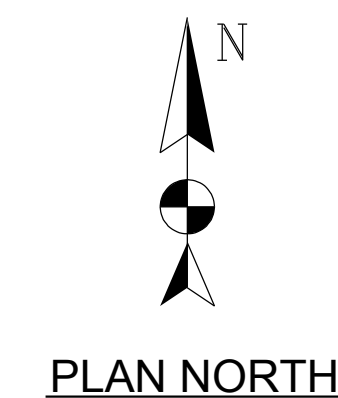

NOTES :-


1. REFER E100 SHEET FOR GENERAL NOTES.
2. REFER E111, E112, & E113 SHEET FOR TYPICAL SECTIONS & DETAILS.
3.  - INDICATES VERTICAL BRACING.
4. LH-SERIES JOIST SHOE DEPTH = 5" TYP. U.N.O.
LH-SERIES JOIST SHOE DEPTH = 6 1/2" @ ALONG GRID LINE '16'.
JOIST GIRDER SHOE DEPTH = 7 1/2" TYP. U.N.O.
5. ----- - INDICATES BRIDGING LINE REFER E101 KEY PLAN
FOR BRIGING LOCATING DIMENSIONS.
6. REFER E114 & E115 SHEETS FOR RTU DETAILS.

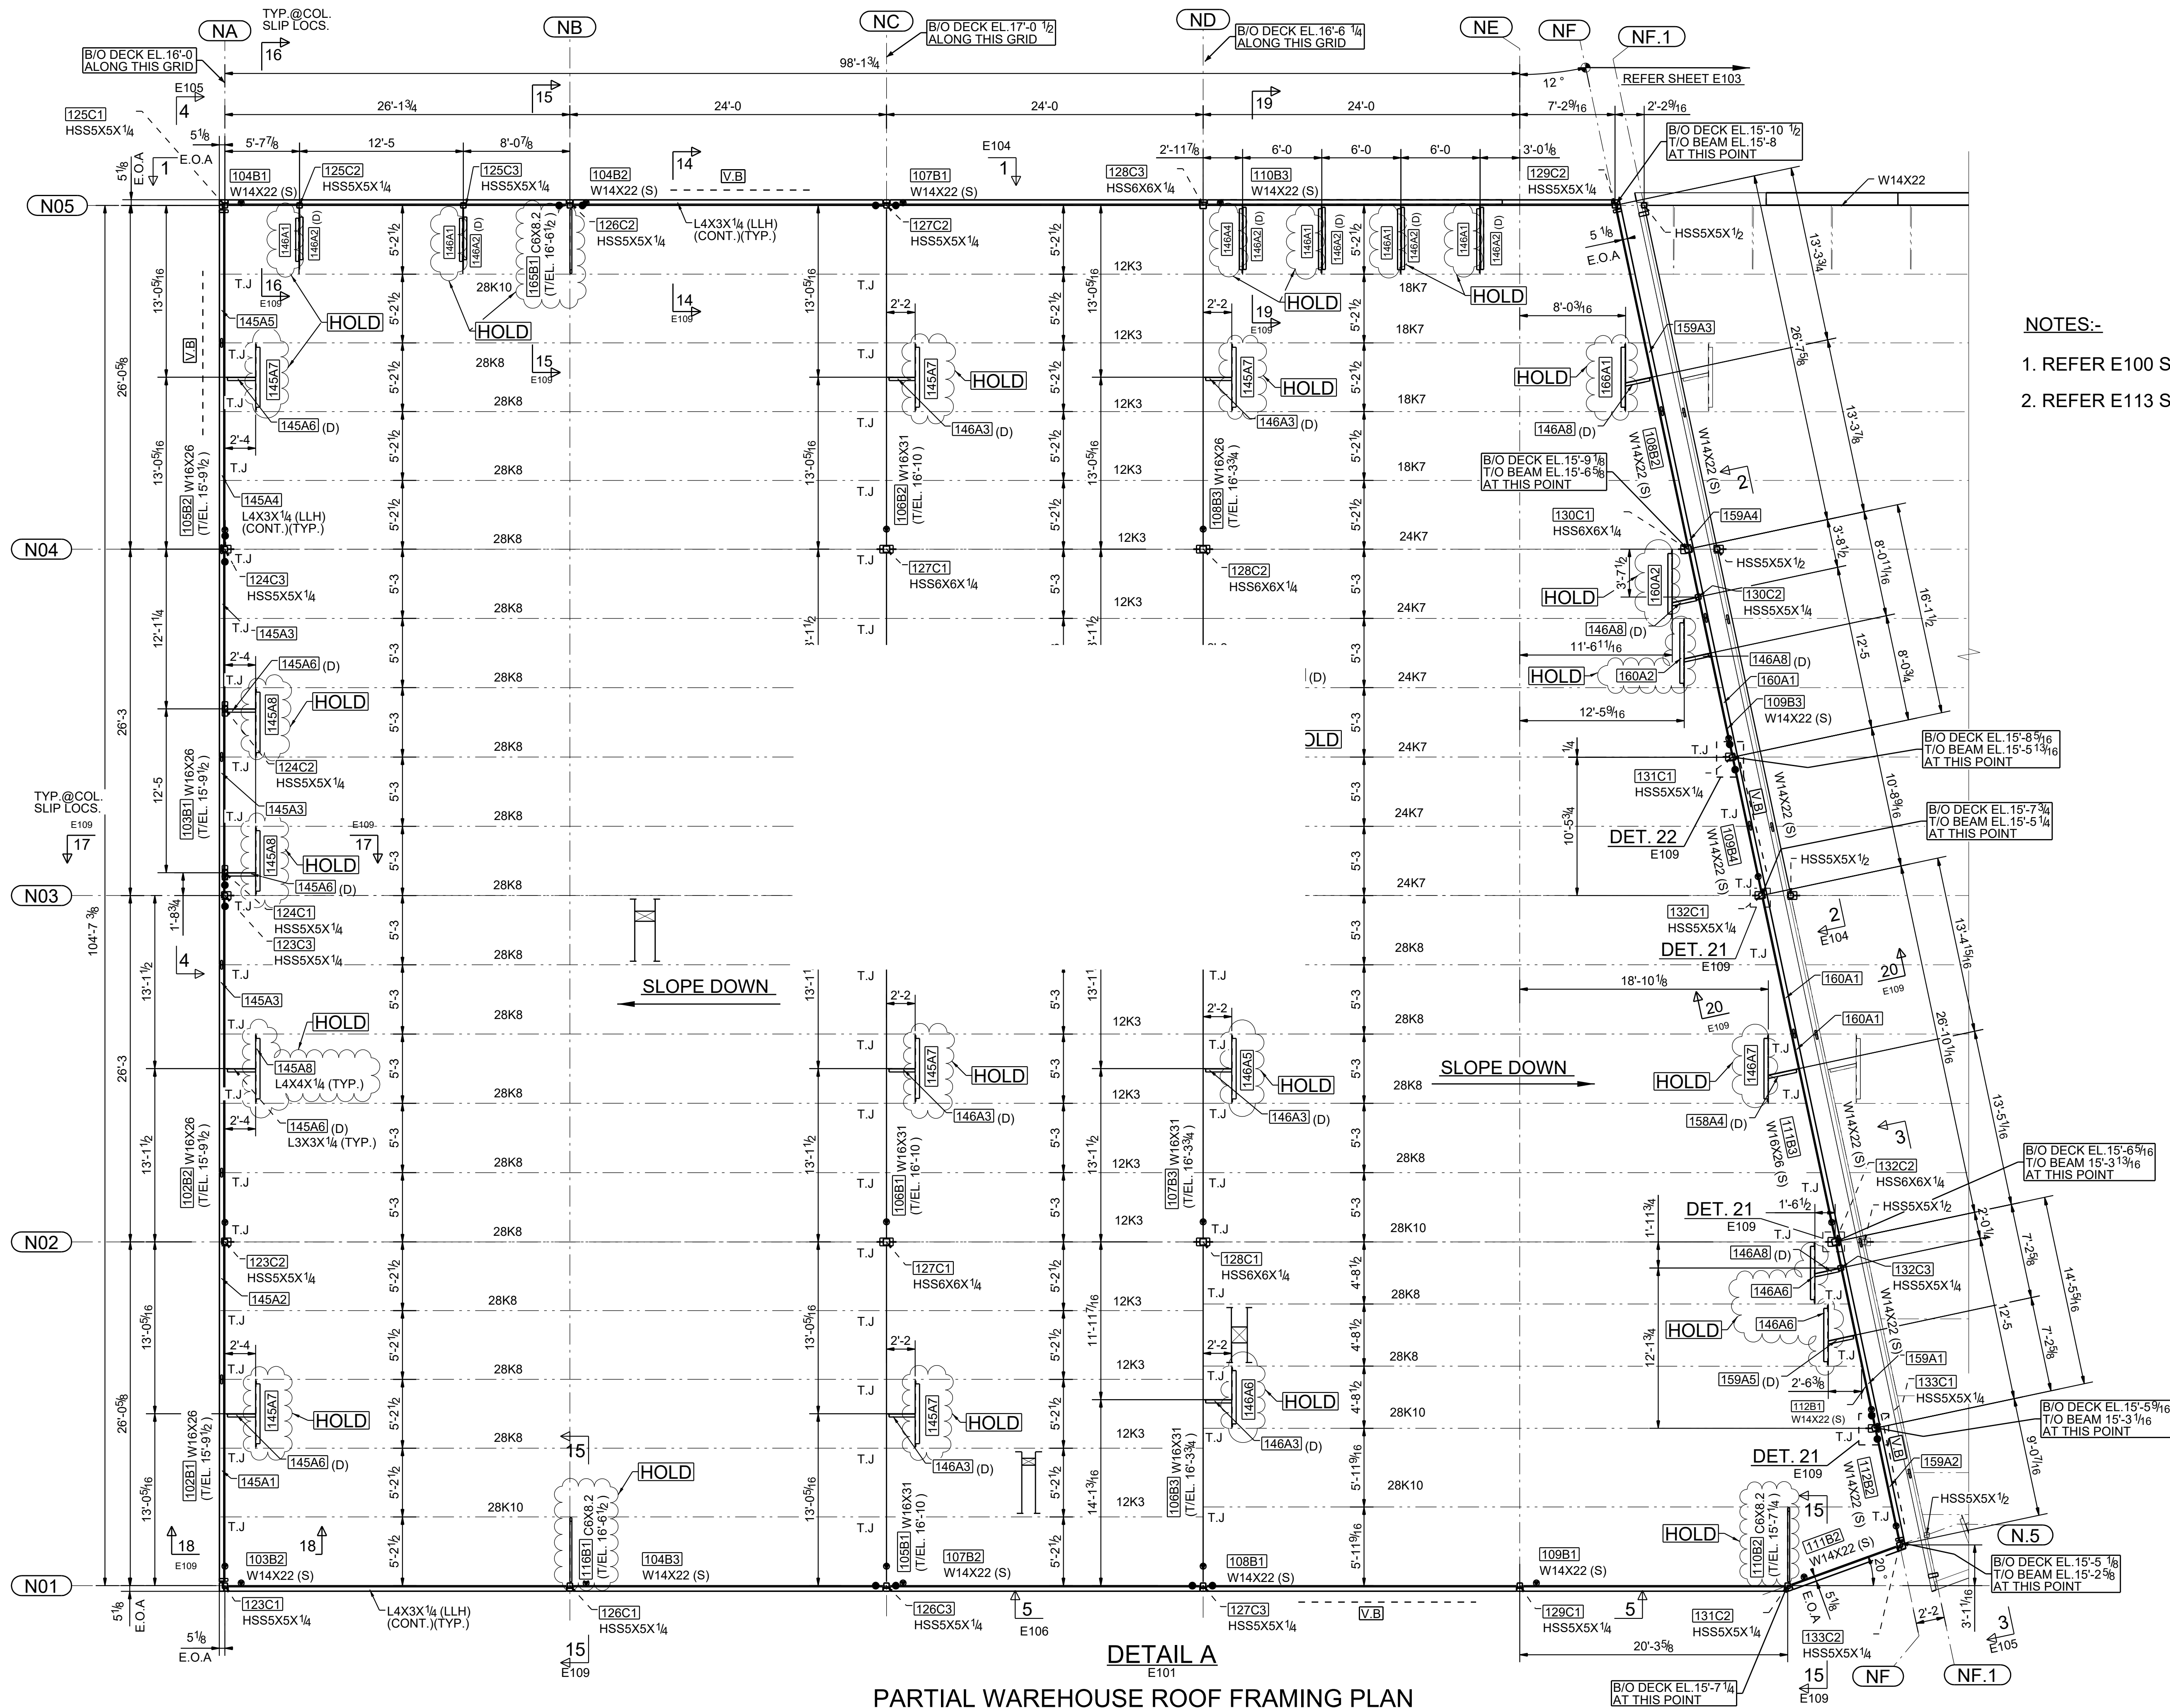

DETAIL A
E101
PARTIAL WAREHOUSE ROOF FRAMING PLAN


(REFER WAREHOUSE ROOF FRAMING PLAN 1/ S102N)



FOR FIELD USE : 02/22/2022

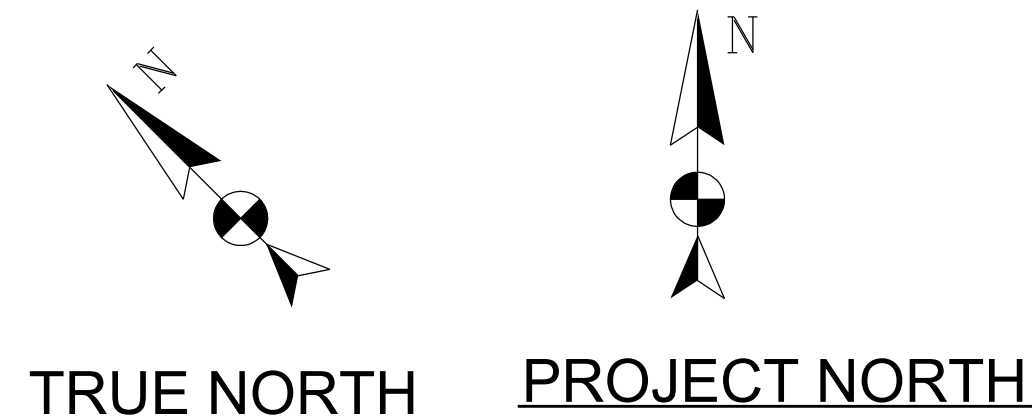

NOTES:-

1. REFER E100 SHEET FOR GENERAL NOTES.
2. REFER E113 SHEET FOR TYPICAL SECTION & DETAILS.

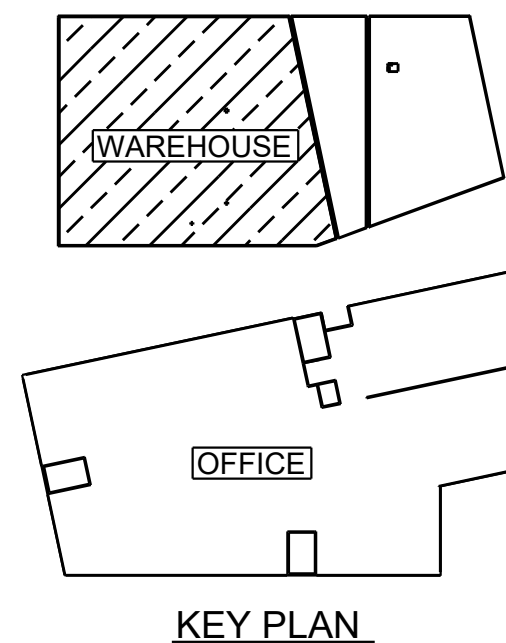

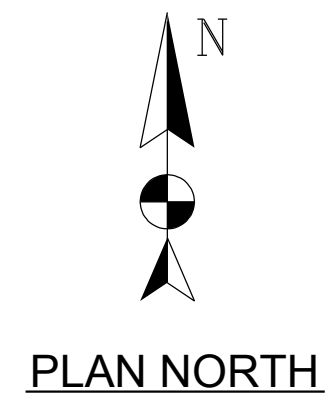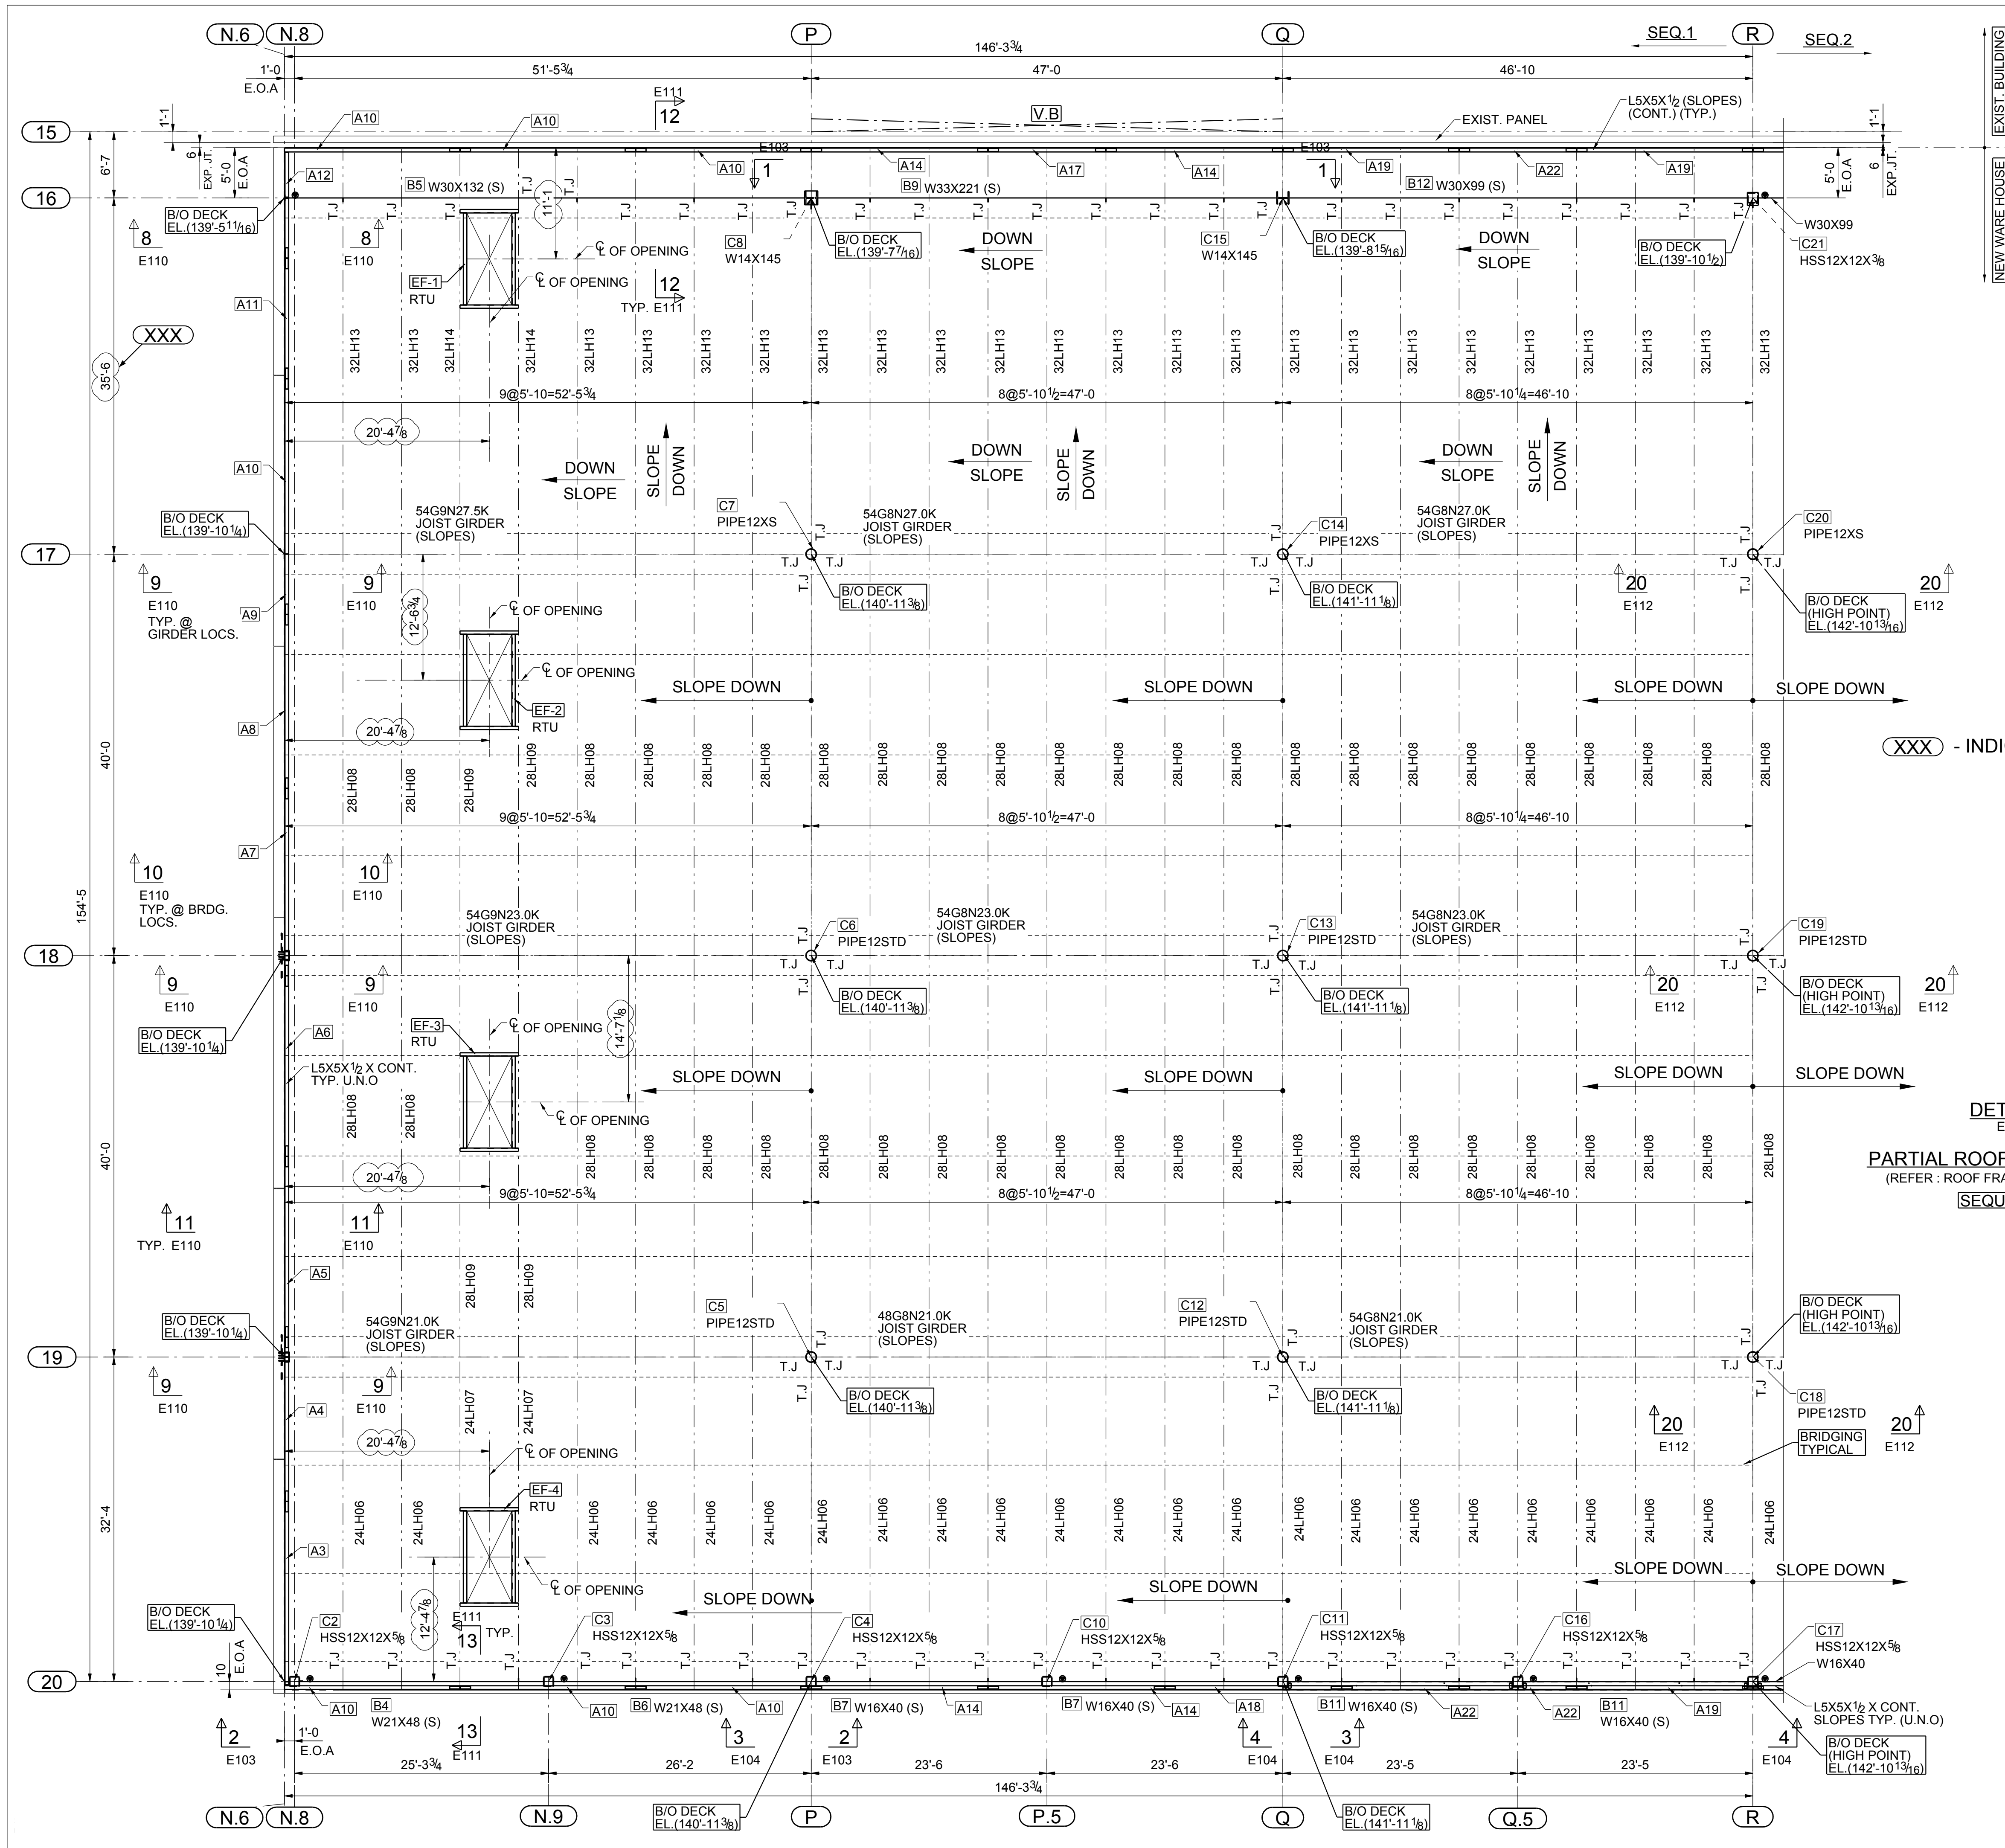

- NOTES :-
1. REFER E100 SHEET FOR GENERAL NOTES.
 2. REFER E111, E112, & E113 SHEET FOR TYPICAL SECTIONS & DETAILS.
 3. X - INDICATES VERTICAL BRACING.
 4. LH-SERIES JOIST SHOE DEPTH = 5" TYP.U.N.O.
JOIST GIRDER SHOE DEPTH = 7 1/2 TYP.U.N.O.
 5. - - - - - INDICATES BRIDGING LINE REFER E101 KEY PLAN FOR BRIDGING LOCATING DIMENSIONS.

XXX - INDICATES APPROVER VERIFY THESE STRUCTURALLY GIVEN GRID DIMENSIONS NOT MATCHING WITH ARCH. SHEET A-130, BUT WE MAINTAINED STRUCTURALLY SHOWN DIMENSION(35'-6")

APPROVER VERIFY / FURNISH ALL CLOUDED INFORMATIONS TYPICAL

APPROVER VERIFY / FURNISH ALL RTU(EF-1,EF-2,EF-3,EF-4) OPENING DIMENSIONS & LOCATING DIMENSIONS TYPICAL


DETAIL A
E101
PARTIAL ROOF FRAMING PLAN
(REFER : ROOF FRAMING PLAN / S-121)
SEQUENCE - 1

FOR APPROVAL : 03/02/2018
SEQ#1



1. REFER E100 SHEET FOR GENERAL NOTES.
2. REFER E113 SHEET FOR TYPICAL SECTION & DETAILS.



APPROVER VERIFY ROOF HATCH
OPENING LOCATION.

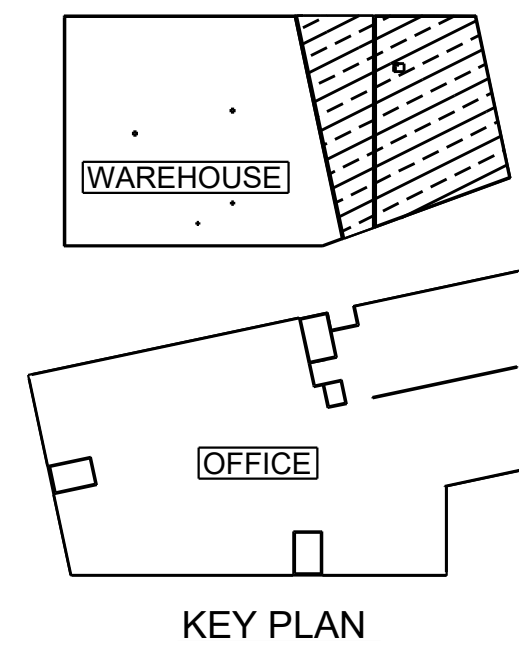

DETAIL B
E101
PARTIAL WAREHOUSE ROOF FRAMING PLAN

(RREFER :WAREHOUSE ROOF FRAMING PLAN 1/ S102N)

FOR FIELD USE : 02/22/2022

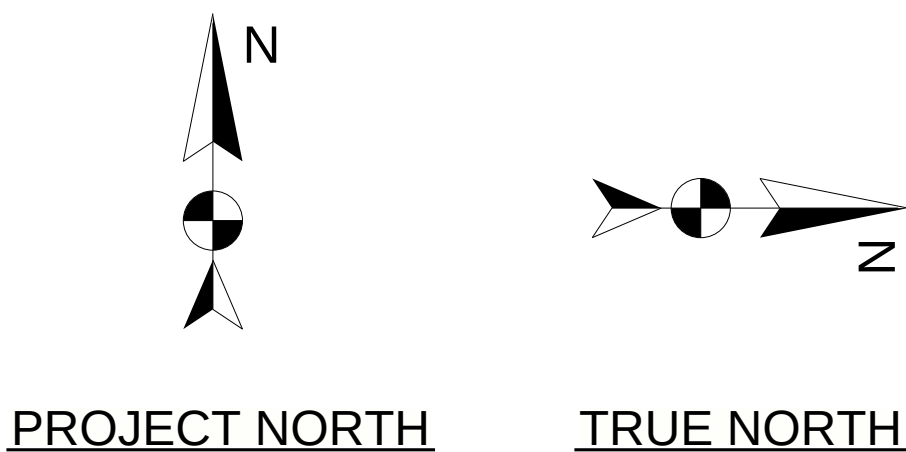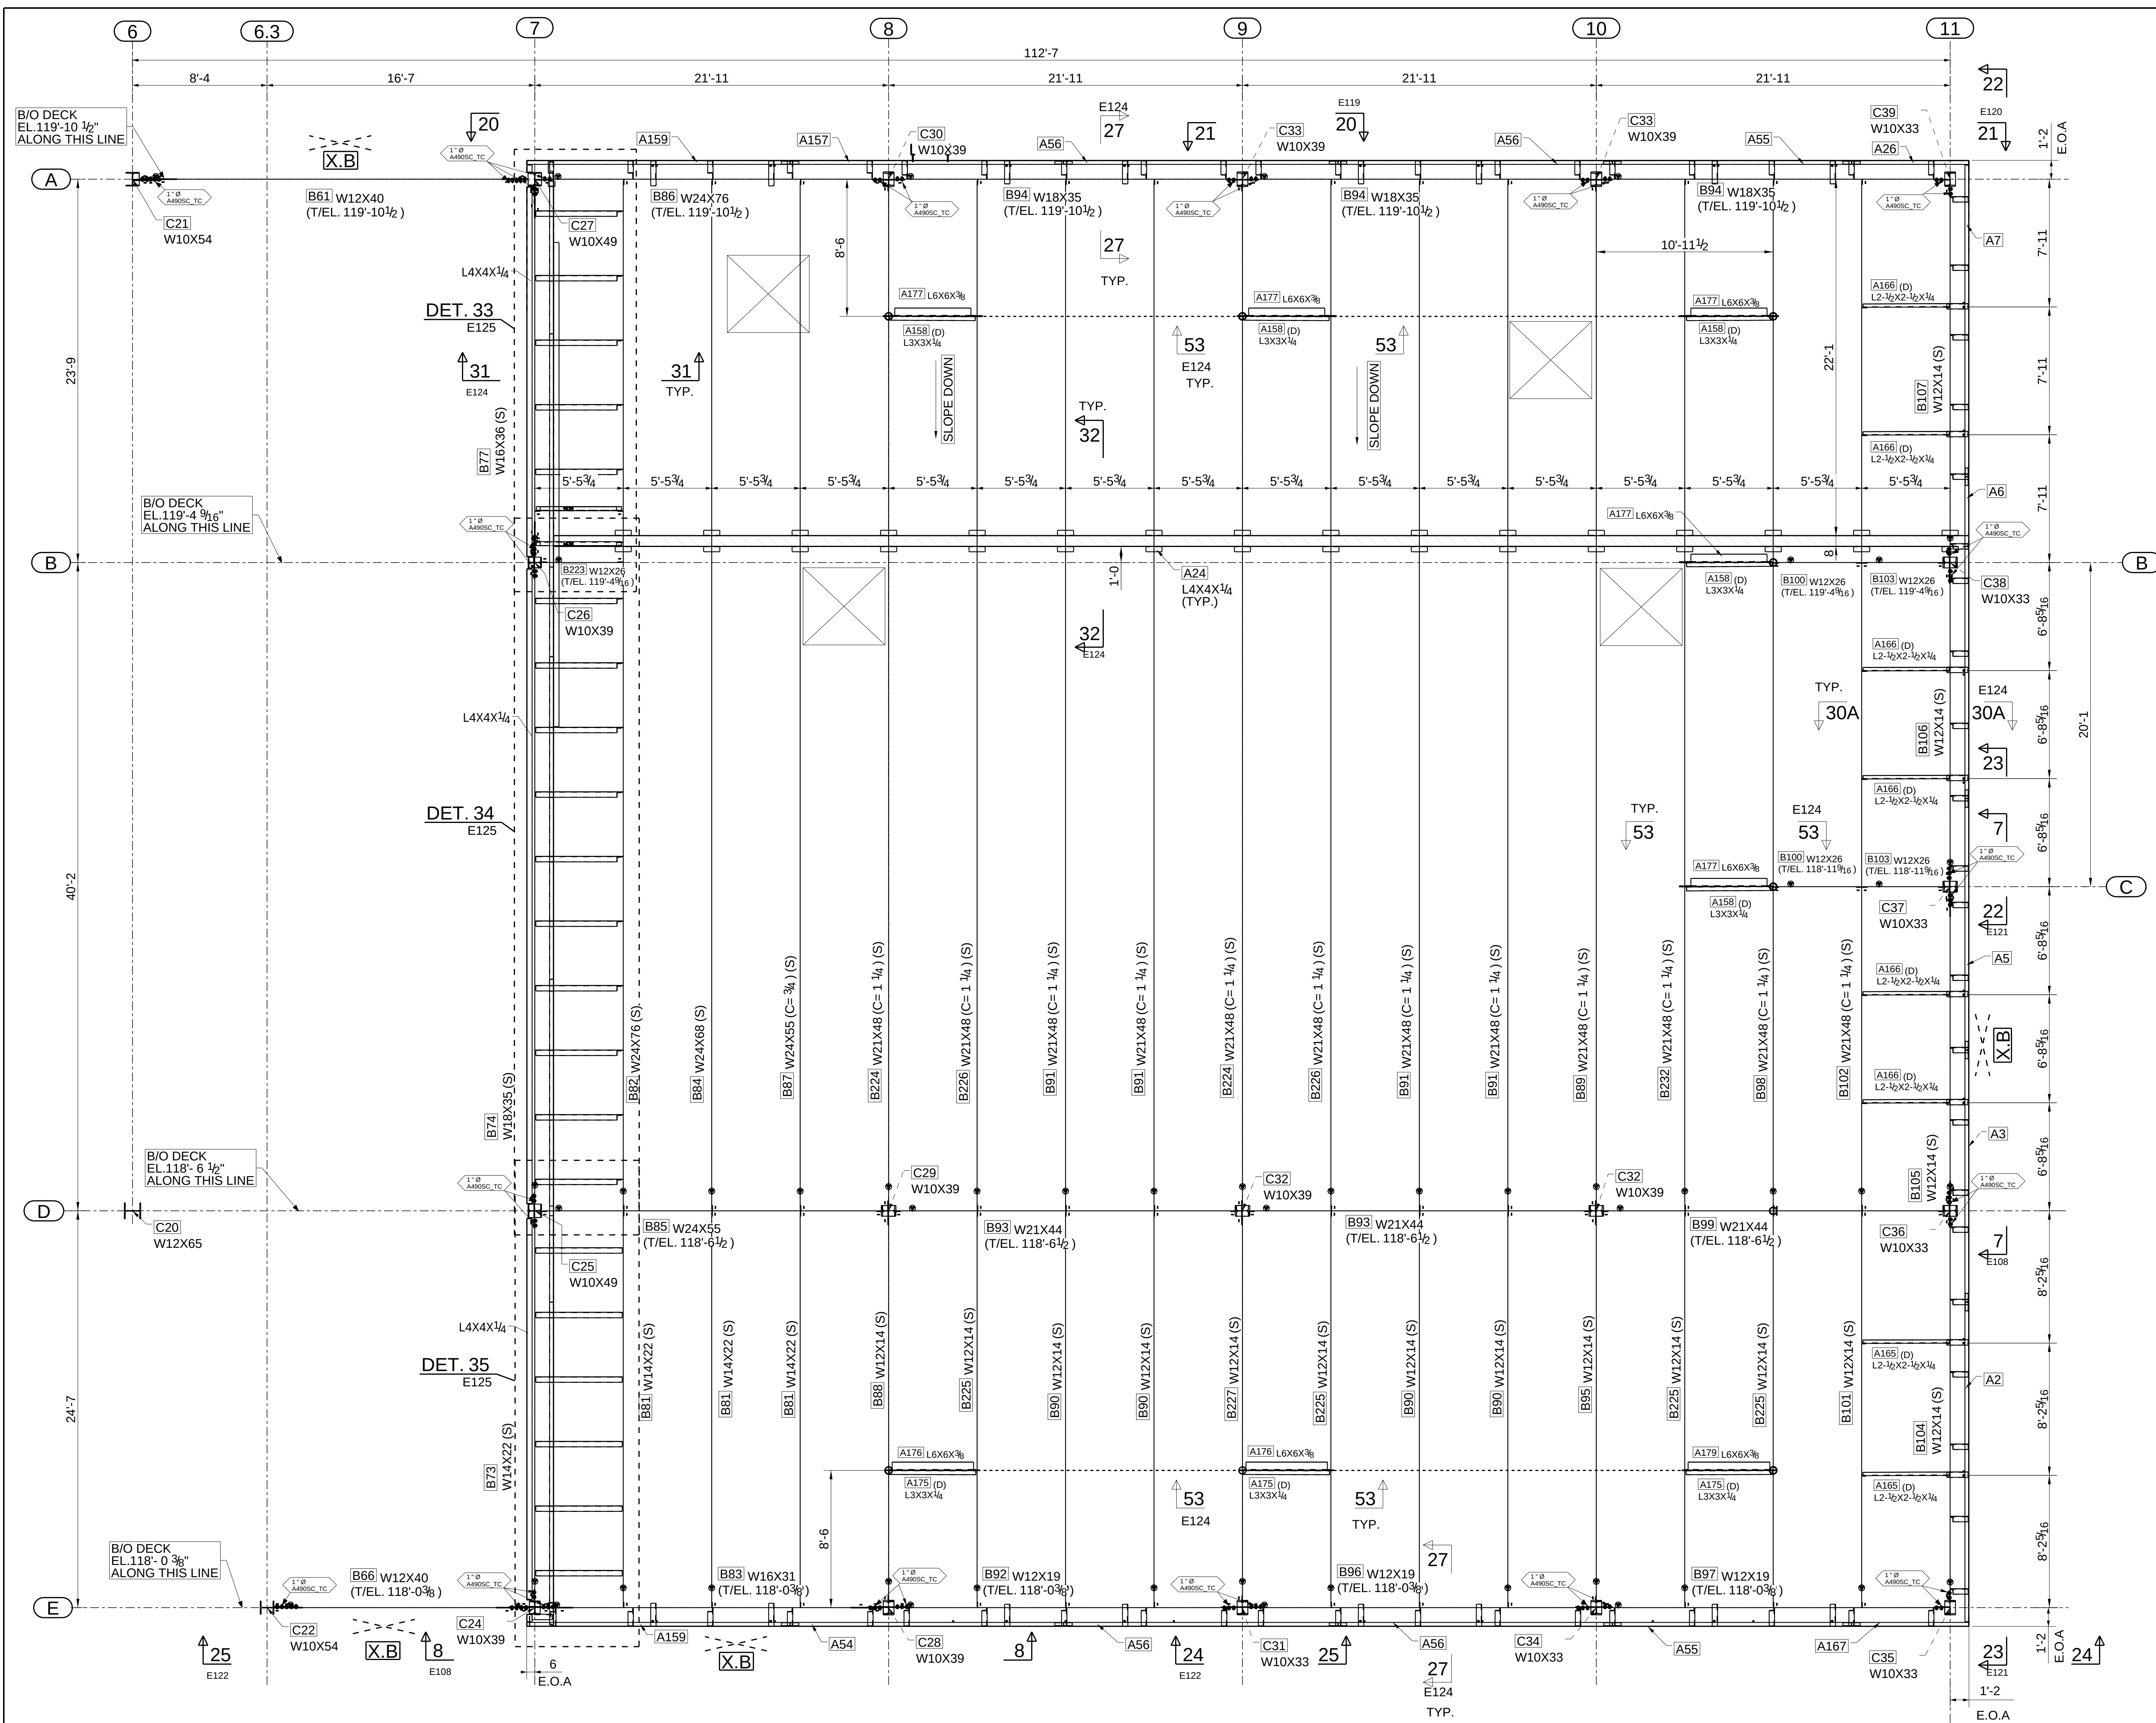

- NOTES:-
- 1. REFER E100 SHEET FOR GENERAL NOTES
 - 2. REFER E128 FOR TYPICAL SECTION & DETAILS

FOR FIELD USE : 11/16/2022

LOW ROOF FRAMING PLAN
(REFER : ROOF FRAMING PLAN / 030.A2.94.S.01.30)

