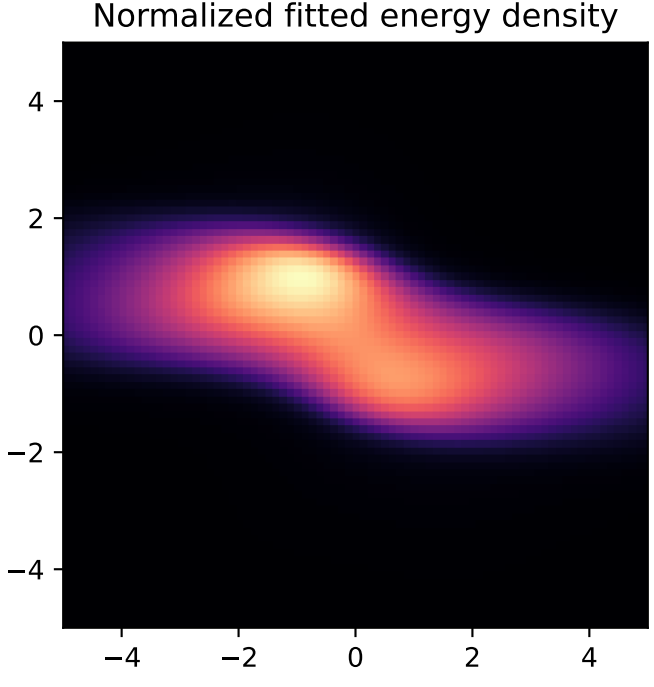
Normalized fitted energy density
4
2
0
−2
−4
−4
−2
0
2
4

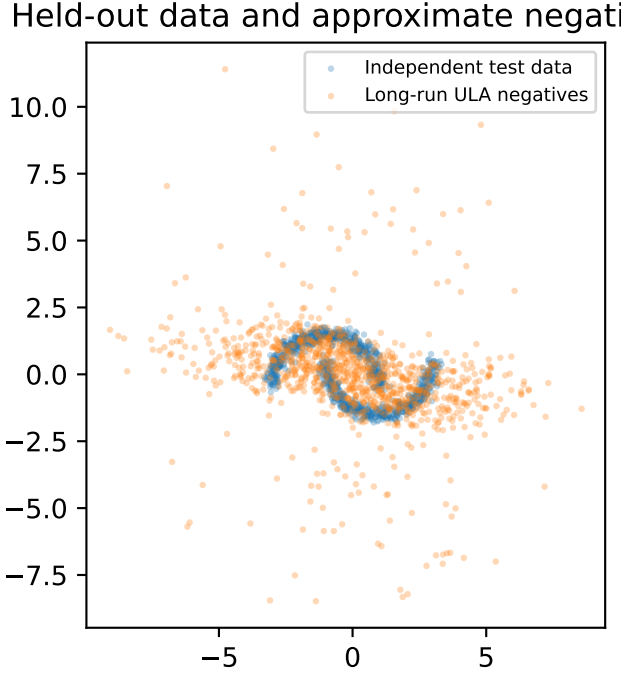
Held-out data and approximate negatives
Independent test data
Long-run ULA negatives
10.0
7.5
5.0
2.5
0.0
−2.5
−5.0
−7.5
−5
0
5

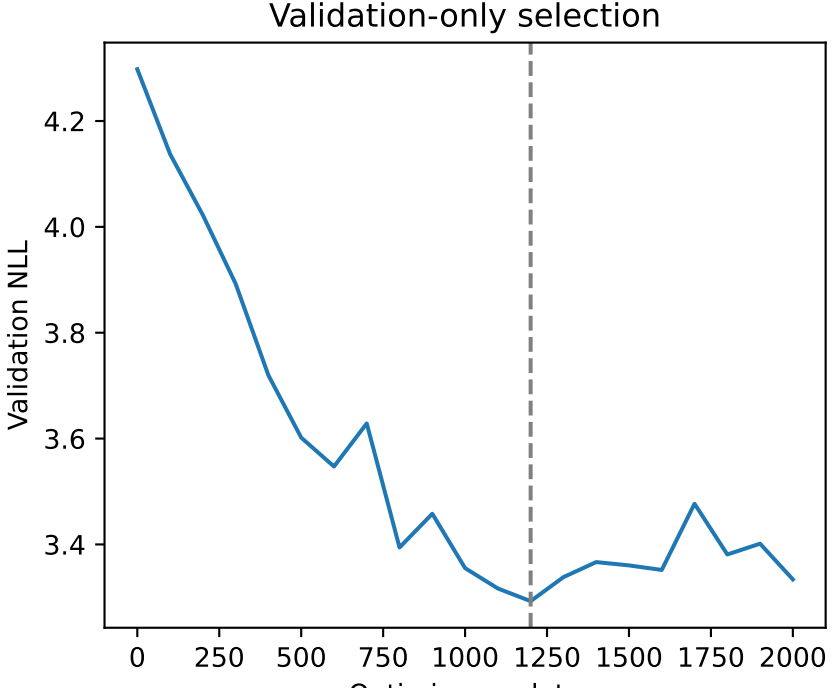
Validation-only selection
Validation NLL
4.2
4.0
3.8
3.6
3.4
0
250
500
750
1000
1250
1500
1750
2000
Optimizer update