



Product Catalog

Packaged Rooftop Air Conditioners Precedent™ Cooling and Electric Heat

High Efficiency

6 to 25 Tons — 60 Hz





Introduction

Packaged Rooftop Air Conditioners

Trane's customers demand products that provide exceptional reliability, meet stringent performance requirements, and are competitively priced. Trane delivers with Precedent™.

Precedent™ features cutting edge technologies: reliable compressors, Trane engineered Symbio controls, computer-aided run testing, and Integrated Comfort™ Systems. So, whether you're the contractor, the engineer, or the owner you can be certain Precedent™ products are built to meet your needs.

Through the years, Trane has designed and developed the most complete line of Packaged Rooftop products available in the market today. Trane was the first to introduce the Micro—microelectronic unit controls—and has continued to improve and revolutionize this design concept.

Symbio control platform offers the same great features and functionality as the original Micro, with additional benefits for greater application flexibility.

With its sleek, compact cabinet, Precedent™ continues to provide the highest standards in quality and reliability, comfort, ease of service, and the performance of Trane light commercial products.

Copyright

This document and the information in it are the property of Trane, and may not be used or reproduced in whole or in part without written permission. Trane reserves the right to revise this publication at any time, and to make changes to its content without obligation to notify any person of such revision or change.

Trademarks

All trademarks referenced in this document are the trademarks of their respective owners.



Table of Contents

Features and Benefits	5
Features	5
Control Options	6
Accessories	7
Key Benefits	9
Model Number Description	17
General Data	19
Gross Cooling Capacities	22
Reheat Temperature Rise	31
Evaporator Fan Performance	54
6 to 10 Ton Units — Downflow	54
6 to 10 Ton Units — Horizontal	58
12.5 Ton Units — Downflow	62
12.5 Ton Units — Horizontal	63
15 to 25 Ton Units — Downflow	65
15 to 25 Ton Units — Horizontal	68
Fan Performance	72
Heating Performance	73
Controls	74
Enhanced BAS Integration and Connectivity	74
Secure Remote Connectivity with Trane Connect	74
Serviceability	74
Flexibility	76
Economizer Controls	77
Zone Sensors	77
Air-Fi Wireless Communicating Zone Sensors	78
Thermostats	79
Humidity Control (HGRH)	79
Electrical Data	81
Dimensional Data	87
Weights	99

Mechanical Specifications	101
General	101
Casing	101
Coils	101
Coil Guards	101
Compressors	101
Filters	102
Frostat™	102
Indoor Fan	102
Powered or Unpowered Convenience Outlet	102
Stainless Steel Drain Pan	102
Through-the-Base Electrical with Circuit Breaker	102
Through-the-Base Electrical with Disconnect Switch	102
Economizer (Standard)	102
Electric Heaters	103
Manual Outside Air Damper	103
Motorized Outside Air Damper	103
Powered Exhaust	103
Roof Curb	103
Ventilation Override Operation	103



Features and Benefits

Features

Table 1. Precedent™ features – standard and optional

	Standard Features	Options		
		Factory Installed	Factory or Field Installed	Field Installed
3-year Limited Parts Warranty	X			
5-year Limited Compressor Warranty	X			
2 inch Filter	X			
2 inch MERV 8 Filters		X		
2 inch MERV 13 Filters		X		
Access Doors		X		
Access Door (Control Box)	X			
Access Panels	X			
Anti-Short Cycle Timer (Standard with Symbio)	X			
Barometric Relief			X	
CO ₂ Sensor				X
Clogged Filter Switch ^(a)			X	
Coil guards	X			
CompleteCoat™ Condenser Coil		X		
Condensate Overflow Switch ^(b)			X	
Convertible Airflow ^(c)	X			
Colored and Numbered Wiring	X			
Crankcase Heaters	X			
Humidity Control (HGRH)		X		
Direct Drive Plenum Fan	X			
Discharge Air Temperature Sensing Kit — MZVAV, SZVAV, Economizer	X			
Discharge Air Temperature Sensing Kit — Standard (Multispeed)			X	
Economizer: Low Leak — Downflow (6 to 25 Tons) ^(a)			X	
Economizer: Low Leak — Horizontal (6 to 25 Tons) ^{(d) (a)}				X
Economizer: Standard — Convertible (6 to 12.5 Tons) ^(a)			X	
Economizer: Standard — Downflow (15 to 25 Tons) ^(a)			X	
Economizer: Standard — Horizontal (15 to 25 Tons) ^(a)				X
Electric Heater ^(b)			X	
Expansion Modules ^(e)			X	
Fault Detection and Diagnostics (FDD) ^(f)	X			
Filter Removal Tool	X			
Foil-Faced and Edge Protected Insulation	X			
Frostat™	X			
High Pressure Control	X			
High Static/Oversized Motor		X		
High Temperature Sensor				X
IAQ Dual Sloped Composite Drain Pan	X			
Liquid Line Refrigerant Drier	X			
Low Ambient Cooling to 0°F			X	
Low Ambient Cooling to 40°F	X			
Low Pressure Control	X			
Manual Outside Air Damper			X	



Features and Benefits

Table 1. Precedent™ features – standard and optional (continued)

	Standard Features	Options		
		Factory Installed	Factory or Field Installed	Field Installed
Microchannel Coils	X			
Motorized Outside Air Damper			X	
Multispeed Direct Drive Motors	X			
Multiple Zone VAV (Variable Air Volume)		X		
Operating Charge of R-410A	X			
Phase Balance/Loss/Reversal Protection	X			
Phase Monitor	X			
Powered Exhaust				X
Powered or Unpowered Convenience Outlet		X		
Quick Adapt Curbs				X
Reference or Comparative Enthalpy			X	
Roof Curb				X
Single Point Power	X			
Single Side Service	X			
Smoke Detector - Return ^(a)		X		
Smoke Detector - Supply ^(b)		X		
Stainless Steel Drain Pan		X		
Standardized Components	X			
Symbio Controls	X			
Thermal Expansion Valve	X			
Through-the-Base Condensate ^(g)	X			
Through-the-Base Electrical Access		X		
Through-the-Base Electrical with Circuit Breaker		X		
Through-the-Base Electrical with Disconnect Switch		X		
Variable Air Flow (SZVAV)/Variable Air Flow (MZVAV)		X		
Ventilation Override ^(h)				X

^(a) Includes Symbio Fresh Air Options Module.

^(b) Includes Symbio Indoor Options Module.

^(c) Factory ships in downflow. For THJ180-300 units where horizontal airflow is required, FIAHZDC001* (Horizontal Conversion Panel) is required. No conversion kit required on THJ072-150 units.

^(d) Provided by third party.

^(e) Requires Tracer TU and utilizes TGP2 software.

^(f) Fault Detection and Diagnostics (FDD) requires Advanced Controller (either Digit 21=1 for BACnet or 21=3 for Air-Fi).

^(g) 6-12.5 tons only.

^(h) Requires FIASCCM001 accessory.

Control Options

Table 2. Precedent™ control options — standard and optional

	Standard Features	Options		
		Factory Installed	Factory or Field Installed	Field Installed
Dual Thermistor Remote Zone Sensor				X
Symbio Service and Installation App	X			
Symbio 700 Advanced Module ^(a)			X	
Humidity Sensor/Humidistat				X
Thermostat				X

Table 2. Precedent™ control options — standard and optional (continued)

	Standard Features	Options		
		Factory Installed	Factory or Field Installed	Field Installed
Wireless Zone Sensor				X
Zone Sensor				X
LonTalk® Communication Interface (LCI) ^(b)			X	
Trane® Air-Fi® Wireless Communication Interface (WCI) ^(b)			X	

Note: For more information, reference the Controls chapter.

^(a) Symbio 700 Advanced Module includes BACnet MS/TP or IP communication protocols.

^(b) Requires Symbio 700 Advanced Module (MOD03103).

Accessories

FIA KIT #S	DESCRIPTION	Used With Cabinets	Used With Models
FIAEHTB309 ^{*(a)}	9kW, 208-230V Electric Heater	B	THJ072A3-102A3
FIAEHTB318 ^{*(a)}	18kW, 208-230V Electric Heater	B	THJ072A3-120A3
FIAEHTB327 ^{*(a)}	27kW, 208-230V Electric Heater	B	THJ072A3-120A3
FIAEHTB336 ^{*(a)}	36kW, 208-230V Electric Heater	B	THJ072A3-120A3
FIAEHTB354 ^{*(a)}	54kW, 208-230V Electric Heater	B	THJ120A3
FIAEHTB409 ^{*(a)}	9kW, 460V Electric Heater	B	THJ072A4-102A4
FIAEHTB418 ^{*(a)}	18kW, 460V Electric Heater	B	THJ072A4-120A4
FIAEHTB427 ^{*(a)}	27kW, 460V Electric Heater	B	THJ072A4-120A4
FIAEHTB436 ^{*(a)}	36kW, 460V Electric Heater	B	THJ072A4-120A4
FIAEHTB454 ^{*(a)}	54kW, 460V Electric Heater	B	THJ120A4
FIAEHTBW09 ^{*(a)}	9kW, 575V Electric Heater	B	THJ072AW-102AW
FIAEHTBW18 ^{*(a)}	18kW, 575V Electric Heater	B	THJ072AW-120AW
FIAEHTBW27 ^{*(a)}	27kW, 575V Electric Heater	B	THJ072AW-120AW
FIAEHTBW36 ^{*(a)}	36kW, 575V Electric Heater	B	THJ072AW-120AW
FIAEHTBW54 ^{*(a)}	54kW, 575V Electric Heater	B	THJ120AW
FIAEHTC318 ^{*(a)}	18kW, 208-230V Electric Heater	C	THJ150A3
FIAEHTC327 ^{*(a)}	27kW, 208-230V Electric Heater	C	THJ150A3
FIAEHTC336 ^{*(a)}	36kW, 208-230V Electric Heater	C	THJ150A3
FIAEHTC354 ^{*(a)}	54kW, 208-230V Electric Heater	C	THJ150A3
FIAEHTC418 ^{*(a)}	18kW, 460V Electric Heater	C	THJ150A4
FIAEHTC427 ^{*(a)}	27kW, 460V Electric Heater	C	THJ150A4
FIAEHTC436 ^{*(a)}	36kW, 460V Electric Heater	C	THJ150A4
FIAEHTC454 ^{*(a)}	54kW, 460V Electric Heater	C	THJ150A4
FIAEHTCW18 ^{*(a)}	18kW, 575V Electric Heater	C	THJ150AW
FIAEHTCW27 ^{*(a)}	27kW, 575V Electric Heater	C	THJ150AW
FIAEHTCW36 ^{*(a)}	36kW, 575V Electric Heater	C	THJ150AW
FIAEHTCW54 ^{*(a)}	54kW, 575V Electric Heater	C	THJ150AW
FIAEHTD318 ^{*(a)}	18kW, 208-230V Electric Heater	D	THJ180A3
FIAEHTD336 ^{*(a)}	36kW, 208-230V Electric Heater	D	THJ180A3-300A3
FIAEHTD354 ^{*(a)}	54kW, 208-230V Electric Heater	D	THJ180A3-300A3
FIAEHTD372 ^{*(a)}	72kW, 208-230V Electric Heater	D	THJ210A3-300A3
FIAEHTD418 ^{*(a)}	18kW, 460V Electric Heater	D	THJ180A4
FIAEHTD436 ^{*(a)}	36kW, 460V Electric Heater	D	THJ180A4-300A4
FIAEHTD454 ^{*(a)}	54kW, 460V Electric Heater	D	THJ180A4-300A4




Features and Benefits

FIA KIT #S	DESCRIPTION	Used With Cabinets	Used With Models
FIAEHTD472*(a)	72kW, 460V Electric Heater	D	THJ210A4-300A4
FIAEHTDW18*(a)	18kW, 575V Electric Heater	D	THJ180AW
FIAEHTDW36*(a)	36kW, 575V Electric Heater	D	THJ180AW-300AW
FIAEHTDW54*(a)	54kW, 575V Electric Heater	D	THJ180AW-300AW
FIAEHTDW72*(a)	72kW, 575V Electric Heater	D	THJ210AW-300AW
FIABARM002*	Barometric Relief	B/C	THJ072A-150A
FIABARM003*	Barometric Relief	D	THJ180-300A
FIAC02K001*	CO ₂ (DCV) Wall Mounted Sensor	ALL	THJ072A-300A
FIAC02K002*	CO ₂ (DCV) Duct Mounted Sensor	ALL	THJ072A-300A
FIACURB402*	14-inch Full Perimeter Knockdown Curb	B	THJ072A-120A
FIACURB403*	14-inch Full Perimeter Knockdown Curb	C	THJ150A
FIACURB404*	14-inch Full Perimeter Knockdown Curb	D	THJ180A-300A
FIACLS001*(b)	Clogged Filter Switch	B/C	THJ072A-150A
FIACLS002*(b)	Clogged Filter Switch (MERV13)	B/C	THJ072A-150A
FIACLS003*(b)	Clogged Filter Switch	D	THJ180A-300A
FIACLS004*(b)	Clogged Filter Switch (MERV13)	D	THJ180A-300A
FIADAST003*	Discharge Air Sensing Tube Kit T/W Models	B	THJ072A-120A
FIADAST005*	Discharge Air Sensing Tube Kit T/W Models	C	THJ150A
FIADAST008*	Discharge Air Sensing Tube Kit T/W Models	D	THJ180A-300A
FIADFB001*(b)	Differential Dry Bulb Economizer Control	ALL	THJ072A-300A
FIADMPR002*	Manual Damper	B/C	THJ072A-150A
FIADMPR003*	Manual Damper	D	THJ180A-300A
FIADMPR102*	Motorized Damper	B/C	THJ072A-150A
FIADMPR103*	Motorized Damper	D	THJ180A-300A
FIAECON002*(b)	Dry Bulb Economizer	B/C	THJ072A-150A
FIAECON102*(b)	Dry Bulb Downflow Low Leak	B/C	THJ072A-150A
FIAECON003*(b)	Dry Bulb Downflow Economizer	D	THJ180A-300A
FIAECON303*(b)	Dry Bulb Horizontal Economizer	D	THJ180A-300A
FIAECON103*(b)	Dry Bulb Downflow Low Leak	D	THJ180A-300A
FIAECON203*(b)	Dry Bulb Horizontal Low Leak	D	THJ180A-300A
FIAENTH001*	Reference Enthalpy Economizer Control	ALL	THJ072A-300A
FIAENTH002*	Comparative Enthalpy Economizer Control	ALL	THJ072A-300A
FIAHTST001*	High Temperature (Fire) Duct Mounted Stat	ALL	THJ072A-300A
FIAHZDC001*	Horizontal Conversion Panel	D	THJ180A-300A
FIALOAM001*	Low Ambient	ALL	THJ072A-300A
FIALTCI001*	LonTalk Communication Interface	ALL	THJ072A-300A
FIAOPTN001*	Indoor Options Module	ALL	THJ072A-300A
FIAOPTN002*	Fresh Air Options Module	ALL	THJ072A-300A
FIAOVFL001*(e)	Condensate Overflow Switch	ALL	THJ072A-300A
FIAPWRX302*	Power Exhaust 230V	B/C	THJ072A3-150A3
FIAPWRX402*	Power Exhaust 460V	B/C	THJ072A4-150A4
FIAPWRXW02*	Power Exhaust 575V	B/C	THJ072AW-150AW
FIAPWRX303*	Power Exhaust 230V	D	THJ180A3-300A3
FIAPWRX403*	Power Exhaust 460V	D	THJ180A4-300A4
FIAPWRXW03*	Power Exhaust 575V	D	THJ180AW-300AW
FIAQACB026*	Adapter Curb, Existing BAYCURB026 to New C Cabinet (FIACURB403A)	C	THJ150A
FIAQACB027*	Adapter Curb, Existing BAYCURB027 to New C Cabinet (BAYCURB403A)	C	THJ150A
FIAQACB044*	Adapter Curb, Existing BAYCURB044 to New B Cabinet (BAYCURB402A)	B	THJ072A-120A

FIA KIT #S	DESCRIPTION	Used With Cabinets	Used With Models
FIASCCM001 ^(c) , ^(d)	Symbio Customer Connection Module	ALL	THJ072A-300A
FIAXMOD030 ^(d) , ^(e)	Symbio 700 XM30 Expansion Module	ALL	THJ072A-300A
FIAXMOD032 ^(d) , ^(e)	Symbio 700 XM32 Expansion Module	ALL	THJ072A-300A

- (a) Requires Symbio Indoor Options Module.
 (b) Requires Symbio Fresh Air Options Module.
 (c) Provides Ventilation Override, External Auto/Stop, Alarm Indicator, Remote Min Position.
 (d) Requires Symbio Advanced Controller (digit 21=1 or 3).
 (e) Requires Tracer TU and Utilizes TGP2 Software (programming knowledge required).

Key Benefits

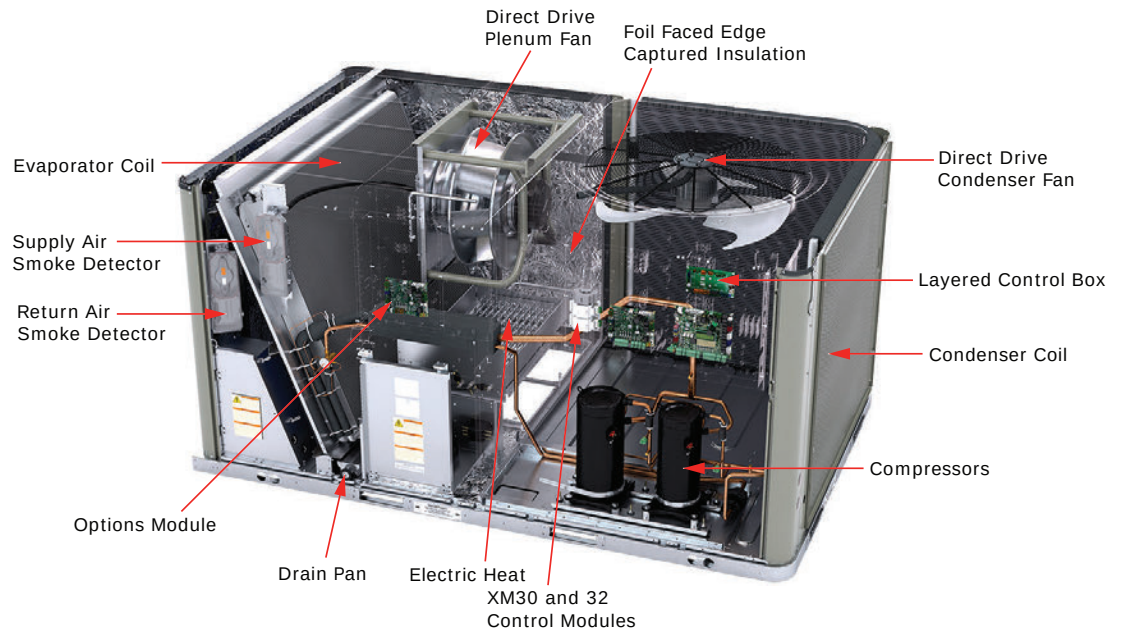

Airflow Distribution

Airflow is outstanding. Precedent™ can replace an older machine with old ductwork and, in many cases, improve the comfort through better air distribution.

Cabinet Integrity

For added water integrity, Precedent™ has a raised 1 inch lip around the supply and return of the downflow units to prevent water from blowing into the ductwork.

Coil Guards

Coil guards protect condenser coil during shipping as well as hail, vandals, wind, etc. Toolless design lends itself to ease of maintenance in cleaning coils.





Features and Benefits

CO₂ Sensor — Demand Control Ventilation (DCV)

Demand-controlled ventilation (DCV) is a control strategy that responds to the actual demand (need) for ventilation by regulating the rate at which the HVAC system brings outdoor air into the building. A CO₂ sensor measures the concentration (parts per million, ppm) of CO₂ (carbon dioxide) in the air. As the CO₂ concentration changes, the outside air damper modulates to meet the current ventilation needs of the zone. The CO₂ sensor kit is available as a field installed accessory and wires directly to the Symbio 700 controller.

CompleteCoat™ Condenser Coil

This optional coated coil provides excellent corrosion resistance as well as uniformity of coverage and coating thickness.

Controls — Symbio

Enhanced BAS Integration and Connectivity

- Open standard communications
 - BACnet® over Zigbee (Air-Fi Wireless)
 - BACnet MS/TP
 - BACnet IP
 - Modbus™ RTU
 - Modbus TCP/IP
 - LonTalk®
- Securely access, troubleshoot, and monitor equipment from anywhere via Trane Connect™

Serviceability

- Wireless mobile app interface (iPhone and Android) to simplify startup/service
- On-board user interface
- Data Trending
- Real-time, clear language diagnostics
- Historical alarm logs
- Backup and Restore functionality to reduce commissioning and service time

Flexibility

- Future-ready upgradable software, supporting changing codes and new sequences of operation
- Standard, consistent pre-engineered applications that meet industry standards
- Built-in Schedules (requires Tracer® TU)
- Expandable inputs and outputs (requires Tracer TU)
- Ability to add custom programmed sequences (requires Tracer TU)

Accessibility

Control box consists of a multilevel design with Symbio Controls located on hinged panels which provide protection from high voltage components for ease of servicing.


Convenience Outlet

This option is GFCI, 120V/15A, 2 plug, convenience outlet powered or GFCI, 120V/20A, 2 plug convenience outlet unpowered. This option can be ordered when through the base electrical with either the disconnect switch or circuit breaker option is ordered.



Convertible Units

Units ship in a downflow configuration and can be easily converted to horizontal by simply removing two panels. Optional field accessory kits required for 15 to 25 ton units.

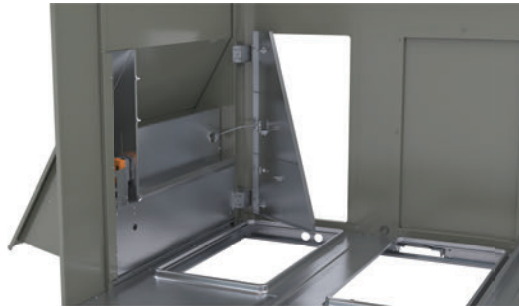


Direct Drive Plenum Fans

All 6 to 25 tons units are equipped with a direct drive plenum fan design with the following features.

- Backward-curved fan wheel
- External rotor direct drive variable speed indoor motor
- Variable speed adjustment available in Symbio controller
- Designed to slide out for ease of maintenance



Features and Benefits

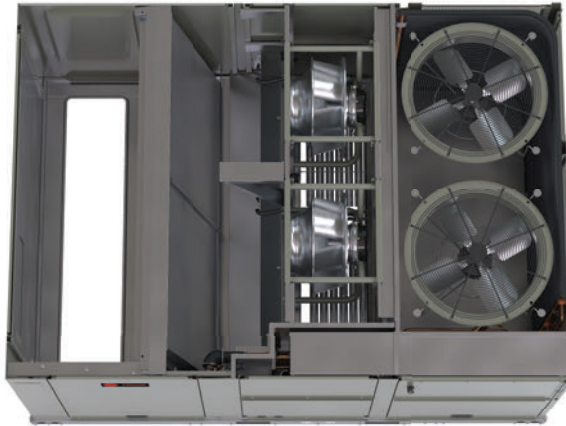

Drain Pan

Every Precedent™ unit has an easy-to-clean, composite removable dual-sloped drain pan (IAQ). On units with B or C (6 to 12.5T) size cabinets, the drain pan is reversible, allowing installation of the draining trap on either side of the unit.



Fault Detection and Diagnostics (FDD)

This offering meets the mandatory requirement of CA Title 24 of fully configurable diagnostics allowing fault history and reading fault codes at the unit via Symbio™ 700 board or app. This feature provides detection of the following faults: Air temperature sensor failure/fault and notification of acceptable economizer mode. The FDD system shall be certified by the Energy Commission as meeting the requirements.

Flexibility

Precedent™ offers ultimate flexibility. Units are built to order in our standard ship cycle time.

High Efficiency Filtration

Precedent™ units offer a variety of high efficiency filtration options. MERV 8 and MERV 13 filters provide additional filtration beyond the capabilities of typical 2 inches throwaway filters.

High Static Motor

Available on 10 and 25 ton models, this high static motor option extends beyond the capability of the standard motor.

Hinged Access Doors

These doors permit easy access to the filter, fan and compressor/control sections. They reduce the potential roof damage from screws or sharp access door corners.



Humidity Control (HGRH)

All 6 to 25 tons Precedent units can be ordered with a factory installed modulating humidity control system designed to provide year around comfort by improving indoor air quality while controlling humidity levels.

Humidity Sensor/Humidistat

The humidity sensor/humidistat, when used in conjunction with our dehumidification (hot gas reheat) units will provide outstanding humidity control and comfort. Humidity sensors can be wall or duct mounted. The humidity deadband can be set between 40% and 60% relative humidity.

Low Ambient Cooling

All Precedent™ units have cooling capabilities down to 40°F. Factory installed option or field installed accessory extends operation down to 0°F.


Low Leak Economizer

This accessory meets low leak requirements for ASHRAE 90.1, IECC, and CA Title 24 standards (4 cfm/ft²@1" wg exterior air/return air). This option allows 100% outdoor air supply from 0 to 100% modulating dampers and is standard with barometric relief. It can be paired with powered exhaust for additional building pressure relief. This option can be paired with or without fault detection and diagnostics (FDD) to meet current mandatory CA Title 24 requirements.

The economizers come with four control options, dry bulb, reference enthalpy, comparative enthalpy, or differential dry bulb.



Features and Benefits

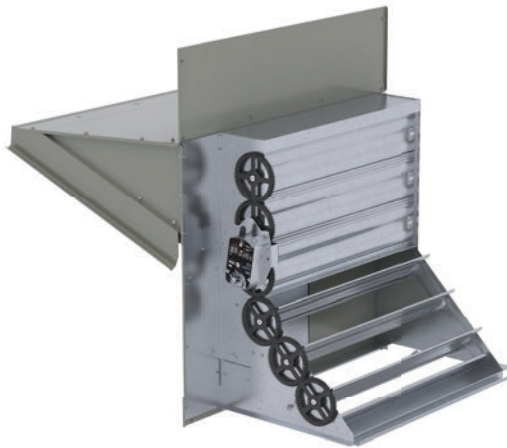


Note: Downflow low leak economizer is available as a factory installed option. Horizontal low leak economizer option is only available as a field installed option.

Microchannel Coils

Microchannel coils are all-aluminum coils with fully-brazed construction. This design reduces risk of leaks and provides increased coil rigidity — making them more rugged on the jobsite. Their flat streamlined tubes with small ports and metallurgical tube-to-fin bond allow for exceptional heat transfer. Microchannel all-aluminum construction provides several additional benefits:

- Light weight (simplifies coil handling)
- Easy to recycle
- Minimize galvanic corrosion

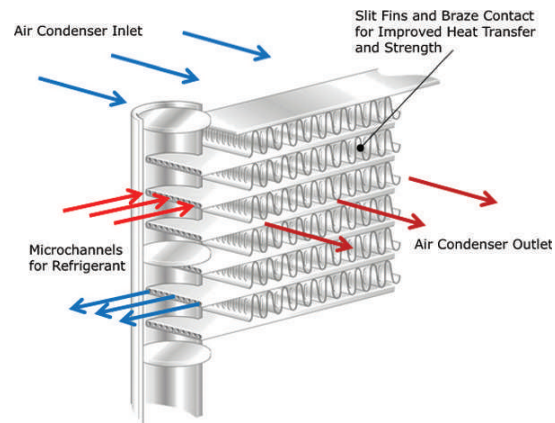

Multi-Speed Indoor Fan System

This system incorporates a multi-speed fan control to change the speed of the fan to 66% of full airflow based off of compressor stages.

Multiple-Zone VAV Control

A multiple-zone VAV (MZVAV) system consists of a packaged rooftop unit that serves several individually controlled zones. Each zone is equipped with a VAV terminal unit that varies the quantity of air delivered to maintain the desired temperature in that zone. The rooftop unit controller varies the speed of the indoor fan to maintain the static pressure in the supply ductwork at a setpoint, ensuring that all zones receive the necessary quantity of air. In addition, cooling capacity is cycled to maintain the supply air temperature at the desired setpoint.

For decades, Trane has been an industry leader in rooftop VAV systems. Now, multiple-zone VAV control is available in the light commercial rooftop platform (6 to 25 tons).

Other Benefits

- Cabinet design ensures water integrity
- Ease of Service, Installation and Maintenance
- Mixed model build enables “fastest in the industry” ship cycle times
- Outstanding Airflow Distribution
- Symbio Controls

Quick Adapt Curbs

Enables easy upgrade of existing Voyager™ 6 to 25 tons units to Precedent™ units on replacement jobs.

Rigorous Testing

All of the Precedent™ designs were rigorously rain tested at the factory to ensure water integrity.

Actual shipping tests were performed to determine packaging requirements. Units were test shipped around the country to determine the best packaging design. Factory shake and drop tests were used as part of the package design process to help assure that the unit arrives at the job site in top condition.

Rigging tests include lifting a unit into the air and letting it drop one foot, assuring that the lifting lugs and rails hold up under stress.

We perform a 100% coil leak test at the factory. The assembled unit is leak tested to 465 psig.

All parts are inspected at the point of final assembly. Sub-standard parts are identified and rejected immediately.

Every unit receives a 100% unit run test before leaving the production line to make sure it meets rigorous requirements.

Single Zone VAV (SZVAV)

SZVAV is fully integrated into the control system. It provides the simplest and fastest commissioning in the industry through proven factory-installed, wired, and tested system controllers. All control modules, logic boards and sensors are factory installed and tested to ensure the highest quality and most reliable system available. This means no special programming of algorithms, or hunting at the jobsite for field installed sensors, boards, etc. SZVAV is a quick and simple solution for many applications and is available from your most trusted rooftop VAV system solution provider -Trane.

Building system modeling in energy simulation software such as TRACE is recommended to evaluate performance improvements for your application.

Supply/Return Air Smoke Detector

With this option installed, if smoke is detected, all unit operation will be shut down. Reset will be manual at the unit. In order for the supply air smoke detector or return air smoke detector to properly sense smoke in the supply air stream or the return air stream, the air velocity entering the smoke detector unit must be between 500 to 4000 feet per minute. Equipment covered in this manual will develop an airflow velocity that falls within these limits over the entire airflow range specified in the evaporator fan performance table. Supply and/or return smoke detectors may not be used with the plenum smoke detector.

Figure 1. Supply/Return air smoke detector



Through-the-Base Condensate

6 to 12.5 tons unit includes provisions for through-the-base condensate drain connections. This allows the drain to be connected through the roof curb instead of a roof penetration.

Through-the-Base Electrical Access

An electrical service entrance shall be provided allowing electrical access for both control and main power connections inside the curb and through-the-base of the unit. Option will allow for field installation of liquid-tight conduit and an external field installed disconnect switch.

Ventilation Override

Ventilation override allows the unit to be set to transition to up to three different pre-programmed sequences for smoke purge, pressurization, and exhaust. The transition occurs when a binary input on the Customer Connection Module is closed (shorted). This would typically be a hard wired relay output from a smoke detector or fire control panel. The Customer Connection module that allows ventilation override is available as a field installed accessory (FIASCCM001). For more information on functionality, reference *Symbio™ 700 Controller with Precedent™ Packaged Rooftop Air-Conditioners Application Guide* (ACC-APG002*-EN).



Model Number Description

Digit 1 — Unit Function

T = DX Cooling

Digit 2 — Cooling Efficiency

H = High Efficiency

Digit 3 — Refrigerant

J = R-410A

Digit 4,5,6 — Nominal Gross Cooling Capacity (MBh)

072 = 6 Ton

090 = 7.5 Ton

102 = 8.5 Ton

120 = 10 Ton

150 = 12.5 Ton

180 = 15 Ton

210 = 17.5 Ton

240 = 20 Ton

300 = 25 Ton

Digit 7 — Design Sequence

Digit 8 — Voltage Selection

3 = 208–230/60/3

4 = 460/60/3

W = 575/60/3

Digit 9 — Unit Controls

S = Symbio™ 700

Digit 10 — Heat Type

0 = Base Model (None or Electric)

Digit 11 — Heating Capacity¹

0 = No Heat

C = 9 kW Electric Heat

G = 18 kW Electric Heat

K = 27 kW Electric Heat

N = 36 kW Electric Heat

P = 54 kW Electric Heat

R = 72 kW Electric Heat

Digit 12, 13 — Service Sequence

** = Factory Assigned

Digit 14 — Fresh Air Selection

0 = No Fresh Air

A = Manual Outside Air Damper 0–50%

B = Motorized Outside Air Damper 0–50%

C = Economizer, Dry Bulb 0–100% without Barometric Relief²

D = Economizer, Dry Bulb 0–100% with Barometric Relief²

E = Economizer, Reference Enthalpy 0–100% without Barometric Relief²

F = Economizer, Reference Enthalpy 0–100% with Barometric Relief²

G = Economizer, Comparative Enthalpy 0–100% without Barometric Relief²

H = Economizer, Comparative Enthalpy 0–100% with Barometric Relief²

K = Downflow Low Leak Economizer, Dry Bulb with Barometric Relief²

M = Downflow Low Leak Economizer, Reference Enthalpy with Barometric Relief²

P = Downflow Low Leak Economizer, Comparative Enthalpy with Barometric Relief²

R = Downflow Low Leak Economizer, Differential Dry Bulb with Barometric Relief²

Digit 15 — Supply Fan/Motor

0 = Multi-Speed Motor

1 = Optional Oversized/High Static Motor

2 = Single Zone Variable Air Volume with Standard Motor

3 = Single Zone Variable Air Volume with Oversized/High Static Motor

4 = Multiple Zone Variable Air Volume with Standard Motor

5 = Multiple Zone Variable Air Volume with Oversized/High Static Motor

Digit 16 — Hinged Access/Filters

0 = Standard Panels/Standard Filters

A = Hinged Access Panels/Standard Filters

B = Standard Panels/2 inch MERV 8 Filters

C = Hinged Access Panels/2 inch MERV 8 Filters

D = Standard Panels/2 inch MERV 13 Filters

E = Hinged Access Panels/2 inch MERV 13 Filters

Digit 17 — Coil Protection

0 = Standard Coil

1 = Condenser with CompleteCoat™

Digit 18 — Through-the-Base Provisions

0 = No Through-the-Base Provisions

A = Through-the-Base Electric

Digit 19 — Disconnect/Circuit Breaker (three-phase only)

0 = No Disconnect/No Circuit Breaker

1 = Unit Mounted/Non-Fused Disconnect

2 = Unit Mounted Circuit Breaker

Digit 20— Convenience Outlet

0 = No Convenience Outlet

A = Unpowered 20A Convenience Outlet

B = Powered 15A Convenience Outlet (three-phase only)

Digit 21— Communications Options

0 = No Communications Interface

1 = Advanced Controller with BACnet® Communications Interface

2 = Advanced Controller with LonTalk® Communications Interface

3 = Advanced Controller with Air-Fi® Communications Interface

Digit 22— Refrigeration System Option

0 = Standard Refrigeration System

A = Dehumidification Option^{1, 3}

Digit 23— Controls Expansion Module

0 = None

1 = XM-30 Expansion Module

2 = XM-32 Expansion Module

3 = XM-30 and XM-32 Expansion Module

4 = XM-30 Expansion Module (Qty 2)

5 = XM-32 Expansion Module (Qty 2)

Digit 24— Smoke Detector

0 = No Smoke Detector

A = Return Air Smoke Detector²

B = Supply Air Smoke Detector¹

C = Supply and Return Air Smoke Detectors^{1, 2}



Model Number Description

Digit 25— System Monitoring Controls

- 0 = No Monitoring Control
- 1 = Clogged Filter Switch²
- 2 = Condensate Overflow Switch¹
- 3 = Discharge Air Sensing Tube
- 4 = Clogged Filter Switch and Condensate Overflow Switch^{1, 2}
- 5 = Clogged Filter Switch and Discharge Air Sensing Tube²
- 6 = Condensate Overflow Switch and Discharge Air Sensing Tube¹
- 7 = Clogged Filter Switch, Condensate Overflow Switch and Discharge Air Sensing Tube^{1, 2}

Digit 26— Not Used

Digit 27— Hardware Enhancements

- 0 = No Enhancements
- 1 = Stainless Steel Drain Pan

Digit 28— Short Circuit Current Rating

- 0 = Standard (5k) SCCR Marking
- A = Tier 2 (=65K) SCCR Marking

Digit 29— Low Ambient⁴

- 0 = None
- A = Low Ambient Cooling to 0°F

Model Number Notes

Notes:

1. Includes Symbio™ Indoor Module.
2. Includes Symbio™ Fresh Air Module.
3. Includes Symbio™ Customer Connection Module.
4. Standard Low Ambient Cooling Limit is 40°F.



General Data

Table 3. General data— 6 to 12.5 tons, high efficiency

	6 Tons	7.5 Tons	8.5 Tons	10 Tons	12.5 Tons
	THJ072	THJ090	THJ102	THJ120	THJ150
Cooling Performance					
Gross Cooling Capacity	73000	91000	104000	122000	155000
EER	12.3	12.3	12.3	11.7	11.1
Nominal cfm/AHRI Rated cfm	1860	2625	2975	3700	5000
AHRI Net Cooling Capacity	72000	90000	102000	120000	150000
IEER (2-Speed)	16.0	16.8	16.8	15.5	15.3
IEER (SZVAV/MZVAV)	16.5	17.3	17.3	16.0	16.2
System Power (kW)	5.85	7.32	8.29	10.26	13.51
Compressor					
Number/Type	2/Manifold Scroll	2/Manifold Scroll	2/Manifold Scroll	2/Manifold Scroll	2/Manifold Scroll
Percent Capacity (Stage 1 - Stage 3)	32/68/100	33/67/100	32/68/100	28/72/100	32/68/100
Sound					
Outdoor Sound Rating (dBA)	86	86	86	86	89
Outdoor Coil					
Type	Microchannel	Microchannel	Microchannel	Microchannel	Microchannel
Configuration	Full Face	Full Face	Full Face	Full Face	Full Face
Tube Size (in.)	0.7	0.7	1.0	1.0	1.0
Face Area (sq. ft.)	21.64	21.64	21.64	21.64	28.32
Rows/FPI (Fins per inch)	1/23	1/23	1/21	1/21	1/23
Indoor Coil					
Type	Microchannel	Microchannel	Microchannel	Microchannel	Microchannel
Configuration	Full Face	Full Face	Full Face	Full Face	Full Face
Tube Size (in.)	1.0	1.0	1.0	1.0	1.0
Face Area (sq. ft.)	11.84	11.84	11.84	11.84	14.27
Rows/FPI (Fins per inch)	2/18	2/18	2/18	2/18	2/18
Refrigerant Control	TXV	TXV	TXV	TXV	TXV
Drain Connection No./Size (in.) NPT	1/0.75	1/0.75	1/0.75	1/0.75	1/0.75
Reheat Coil					
Type	Microchannel	Microchannel	Microchannel	Microchannel	Microchannel
Configuration	Full Face	Full Face	Full Face	Full Face	Full Face
Tube Size (in.)	0.6	0.6	0.6	0.6	0.6
Face Area (sq. ft.)	9.04	9.04	9.04	9.04	11.82
Rows/FPI (Fins per inch)	1/23	1/23	1/23	1/23	1/23
Outdoor Fan					
Type	Propeller	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter (in.)	1/26	1/26	1/26	1/26	1/30
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1	Direct/1
CFM	5900	5900	5900	6700	8200
Motor HP	0.70	0.70	0.70	0.75	1.00
Motor RPM	1100	1100	1100	1100	1100
Indoor Fan					
Type	BC Plenum	BC Plenum	BC Plenum	BC Plenum	BC Plenum



General Data

Table 3. General data— 6 to 12.5 tons, high efficiency (continued)

	6 Tons	7.5 Tons	8.5 Tons	10 Tons	12.5 Tons
	THJ072	THJ090	THJ102	THJ120	THJ150
No. Used/Diameter (in.)/Width (in.)	1/23x6	1/23x6	1/23x6	1/23x6	1/23x6
Drive Type/No. Speeds/RPM	Direct / Variable	Direct / Variable	Direct / Variable	Direct / Variable	Direct / Variable
Motor HP (Standard/Oversized)	3.0 / –	3.0 / –	3.0 / –	3.0 / 4.6	4.6 / –
Max Motor RPM	1850	1850	1850	1850 / 1940	1940
Filters^(a)					
Type Furnished	Throwaway	Throwaway	Throwaway	Throwaway	Throwaway
Number Size Recommended	(2) 18 x 24 x 2 (3) 24 x 16 x 2	(2) 18 x 24 x 2 (3) 24 x 16 x 2	(2) 18 x 24 x 2 (3) 24 x 16 x 2	(2) 18 x 24 x 2 (3) 24 x 16 x 2	(3) 18 x 18 x 2 (3) 24 x 18 x 2
Refrigerant Charge					
lbs of R-410A	9.0	9.0	9.5	10.1	11.4
lbs of R-410A, Hot Gas Reheat	10.3	9.6	10.1	10.7	11.6
Cabinet					
Cabinet Size	B0	B0	B0	B0	C0

^(a) Outdoor sound rating shown is tested in accordance with AHRI 370-2015. For additional information reference the outdoor sound power level data in the performance section.

Table 4. General data— 15 to 25 tons, high efficiency

	15 Tons	17.5 Tons	20 Tons	25 Tons
	THJ180	THJ210	THJ240	THJ300
Cooling Performance				
Gross Cooling Capacity	185000	214000	246000	281000
EER	12.1	11.7	11.0	10.7
Nominal cfm/AHRI Rated cfm	5250	6650	8000	10000
AHRI Net Cooling Capacity	182000	210000	240000	271000
IEER (2-Speed)	17.6	15.8	16.5	15.8
IEER (SZVAV/MZVAV)	18.1	16.3	17.0	16.3
System Power (kW)	15.04	17.95	21.82	25.33
Compressor				
Number/Type	2/Manifold Scroll	2/Manifold Scroll	2/Manifold Scroll	2/Manifold Scroll
Percent Capacity (Stage 1 - Stage 4)	33/67/100/NA	33/67/100/NA	24/36/64/100	25/37/63/100
Sound				
Outdoor Sound Rating (dBA)	87	91	91	93
Outdoor Coil				
Type	Microchannel	Microchannel	Microchannel	Microchannel
Configuration	Full Face	Full Face	Full Face	Full Face
Tube Size (in.)	0.71	0.71	1.0	1.0
Face Area (sq. ft.)	33.90	33.90	33.89	33.89
Rows/FPI (Fins per inch)	1/23	1/23	1/21	1/21
Indoor Coil				
Type	Microchannel	Microchannel	Microchannel	Microchannel
Configuration	Full Face	Full Face	Full Face	Full Face
Tube Size (in.)	1.0	1.0	1.0	1.0
Face Area (sq. ft.)	23.93	23.93	23.93	23.93
Rows/FPI (Fins per inch)	2/18	2/18	2/18	2/18

Table 4. General data— 15 to 25 tons, high efficiency (continued)

	15 Tons	17.5 Tons	20 Tons	25 Tons
	THJ180	THJ210	THJ240	THJ300
Refrigerant Control	TXV	TXV	TXV	TXV
STD. Drain Connection No./Size (in.)	1/1.00 PVC Female	1/1.00 PVC Female	1/1.00 PVC Female	1/1.00 PVC Female
Stainless Drain Connection No./Size (in.)	1/1.00 NPT	1/1.00 NPT	1/1.00 NPT	1/1.00 NPT
Reheat Coil				
Type	Microchannel	Microchannel	Microchannel	Microchannel
Configuration	Full Face	Full Face	Full Face	Full Face
Tube Size (in.)	0.6	0.6	0.6	0.6
Face Area (sq. ft.)	21.83	21.83	21.83	21.83
Rows/FPI (Fins per inch)	1/23	1/23	1/23	1/23
Outdoor Fan				
Type	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter (in.)	2/26x3	2/26x4	2/26x4	2/28x4
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM	11520	14660	14220	16600
Motor HP	2/0.50	2/1.0	2/1.0	2/1.0
Motor RPM	1125	1125	1125	1125
Indoor Fan				
Type	BC Plenum	BC Plenum	BC Plenum	BC Plenum
No. Used/Diameter (in.)/Width (in.)	2/23x6	2/23x6	2/23x6	2/23x6
Drive Type/No. Speeds/RPM	Direct / Variable	Direct / Variable	Direct / Variable	Direct / Variable
Motor HP (Standard/Oversized)	3.0 / –	3.0 / –	3.0 / –	3.0 / 4.6
Max Motor RPM	1850	1850	1850	1850 / 1940
Filters^(a)				
Type Furnished	Throwaway	Throwaway	Throwaway	Throwaway
Number Size Recommended	(8) 20 x 24 x 2	(8) 20 x 24 x 2	(8) 20 x 24 x 2	(8) 20 x 24 x 2
Refrigerant Charge				
lbs of R-410A	14.5	14.2	16.6	16.9
lbs of R-410A, Hot Gas Reheat	15.8	15.0	17.2	17.7
Cabinet				
Cabinet Size	D0	D0	D0	D0

^(a) Outdoor sound rating shown is tested in accordance with AHRI 370-2015. For additional information reference the outdoor sound power level data in the performance section.



Gross Cooling Capacities

Table 5. Gross cooling capacities — 6 tons

CFM	Ent DB (°F)	Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)					
		61		67		73		61		67		73		61		67		73	
		MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC
		Ambient Temperature 85°F						Ambient Temperature 95°F						Ambient Temperature 105°F					
1860	75	67.7	54.1	77.4	43.1	85.4	30.6	63.6	51.8	72.8	40.9	79.9	28.7	59.3	49.4	67.9	38.5	73.9	26.4
	80	67.6	63.1	77.3	52.8	85.7	40.6	63.5	60.8	72.8	50.6	80.4	38.2	59.2	58.3	67.9	48.2	74.6	35.7
	85	69.1	69.1	77.1	62.3	85.9	50.7	65.9	65.9	72.7	60.4	80.8	48.3	62.4	62.4	67.9	55.3	75.0	45.8
	90	76.9	71.5	76.9	71.5	85.9	60.5	70.2	70.2	72.5	69.2	80.8	58.2	66.5	66.5	67.7	66.7	75.1	55.7
2160	75	70.1	58.8	79.8	46.1	87.1	29.2	65.8	56.2	75.0	43.6	81.3	28.9	61.1	52.5	69.8	41.1	74.8	27.1
	80	69.7	68.8	79.7	57.2	87.5	42.8	65.5	65.5	75.0	54.9	81.9	40.5	61.5	61.5	69.8	52.4	75.8	38.0
	85	73.2	73.2	79.5	67.4	87.8	54.4	69.7	69.7	74.8	63.4	82.3	52.0	65.9	65.9	69.6	62.9	76.1	49.4
	90	77.7	77.7	79.1	78.2	87.9	65.8	74.1	74.1	74.5	74.5	82.4	63.4	70.1	70.1	70.2	70.2	76.3	60.8
2400	75	71.5	61.3	81.4	48.1	88.1	31.6	67.1	57.0	76.4	45.7	82.4	29.2	62.1	56.8	71.1	43.2	75.9	28.3
	80	71.1	71.1	81.3	60.6	88.6	44.7	67.6	67.6	76.3	58.2	82.9	42.2	63.7	63.7	71.0	55.7	76.7	39.8
	85	75.9	75.9	80.8	72.1	88.9	57.3	72.3	72.3	75.9	69.6	83.1	54.8	68.2	68.2	70.5	66.9	76.7	52.2
	90	80.6	80.6	80.7	80.7	89.0	69.9	76.7	76.7	76.8	76.8	83.3	67.5	72.3	72.3	72.4	72.4	77.0	63.0
2640	75	72.5	65.1	82.7	50.2	89.3	32.2	67.9	62.6	77.6	47.8	83.3	30.1	62.9	59.9	72.1	45.2	76.8	28.2
	80	73.4	73.4	82.5	63.8	89.6	46.3	69.7	69.7	77.4	61.4	83.9	43.9	65.6	65.6	71.9	58.8	77.4	41.2
	85	78.3	78.3	81.8	76.0	89.7	60.1	74.4	74.4	76.7	73.5	83.8	57.6	70.2	70.2	71.2	71.2	77.3	55.0
	90	83.0	83.0	83.0	83.0	89.9	73.1	78.8	78.8	78.9	78.9	84.0	67.8	74.0	74.0	74.1	74.1	77.1	67.8
2880	75	73.3	68.2	83.8	52.2	90.3	32.8	68.6	65.6	78.5	49.8	84.2	30.4	63.6	62.9	72.8	47.1	77.5	28.8
	80	75.3	75.3	83.5	67.0	90.5	47.9	71.5	71.5	78.3	64.0	84.4	45.4	67.3	67.3	72.7	59.4	78.1	42.8
	85	80.4	80.4	82.5	79.9	90.4	62.9	76.3	76.3	77.3	77.3	84.3	60.4	71.8	71.8	71.9	71.9	78.0	57.8
	90	84.9	84.9	85.0	85.0	90.3	76.9	80.5	80.5	80.5	80.5	84.1	74.2	75.2	75.2	75.3	75.3	77.4	71.3
		Ambient Temperature 115°F						Ambient Temperature 125°F											
1860	75	54.6	46.8	62.6	35.9	67.5	23.2	49.5	42.4	56.8	33.1	60.5	21.3						
	80	54.6	54.6	62.6	45.6	68.1	33.0	50.4	50.4	56.8	42.9	61.1	30.2						
	85	58.5	58.5	62.6	53.5	68.6	43.0	54.3	54.3	56.8	52.1	61.3	40.0						
	90	62.5	62.5	62.5	62.5	68.7	52.9	57.8	57.8	57.8	57.8	61.4	49.9						
2160	75	56.1	50.9	64.3	38.5	68.8	23.7	50.7	48.0	58.1	35.7	61.7	20.9						
	80	57.5	57.5	64.3	49.8	69.2	35.3	53.1	53.1	58.1	47.0	62.3	32.3						
	85	61.7	61.7	64.0	60.2	69.3	46.5	57.0	57.0	57.8	57.2	62.2	43.7						
	90	65.5	65.5	65.6	65.6	69.5	57.1	60.0	60.0	60.0	60.0	62.2	54.4						
2400	75	57.0	54.1	65.3	40.5	69.5	24.3	51.5	51.1	58.9	37.6	62.2	21.8						
	80	59.5	59.5	65.2	53.1	70.1	36.8	54.9	54.9	58.9	48.6	62.8	33.9						
	85	63.7	63.7	64.7	64.1	70.1	49.4	58.6	58.6	58.6	58.6	62.8	46.5						
	90	67.2	67.2	67.3	67.3	69.9	61.2	60.8	60.8	60.9	60.9	62.5	58.1						
2640	75	57.7	57.1	66.1	42.5	70.0	26.4	52.1	52.1	59.5	39.5	62.9	20.2						
	80	61.3	61.3	66.0	54.4	70.7	38.5	56.3	56.3	59.2	52.5	63.3	35.5						
	85	65.4	65.4	65.4	65.4	70.7	52.2	59.8	59.8	59.8	59.8	63.3	48.4						
	90	68.3	68.3	68.4	68.4	70.3	64.8	61.9	61.9	61.9	61.9	62.8	61.7						
2880	75	58.2	58.2	66.7	44.4	70.8	25.8	53.4	53.4	60.0	41.4	63.1	23.3						
	80	62.7	62.7	66.3	58.3	71.3	40.1	57.5	57.5	59.5	55.2	63.7	37.1						
	85	66.7	66.7	66.7	66.7	71.2	55.1	60.6	60.6	60.6	60.6	63.7	50.3						
	90	69.1	69.1	69.2	69.2	70.5	68.4	62.8	62.8	62.9	62.9	62.9	62.9						

Notes:

1. All capacities shown are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat. For indoor fan heat formula, refer to appropriate airflow table notes.
2. MBh = Total gross capacity
3. SHC = Sensible heat capacity

Table 6. Gross cooling capacities — 7.5 tons

CFM	Ent DB (°F)	Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)					
		61		67		73		61		67		73		61		67		73	
		MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC
		Ambient Temperature 85°F						Ambient Temperature 95°F						Ambient Temperature 105°F					
2400	75	84.6	68.9	96.3	54.7	106.0	40.1	79.7	66.3	90.8	52.1	100.3	34.2	74.5	63.6	84.8	49.4	92.8	34.2
	80	84.2	80.1	96.1	67.0	106.7	51.5	79.4	77.5	90.6	64.5	100.5	48.9	74.2	74.2	84.7	61.7	93.6	46.1
	85	86.6	86.6	95.8	79.5	107.0	64.2	82.8	82.8	90.4	76.8	100.7	61.6	78.6	78.6	84.5	72.0	93.8	58.8
	90	95.3	90.5	95.3	90.5	106.8	76.8	87.9	87.9	90.0	87.9	100.6	74.2	83.5	83.5	84.1	84.1	93.8	71.5
2700	75	86.7	73.5	98.5	57.6	107.9	40.8	81.6	69.7	92.7	54.6	101.5	37.2	76.1	65.0	86.5	51.8	94.4	34.1
	80	86.0	86.0	98.3	71.3	108.7	53.8	81.0	81.0	92.6	68.6	102.1	51.2	76.6	76.6	86.4	65.8	95.0	48.4
	85	90.3	90.3	97.9	83.1	108.8	68.0	86.3	86.3	92.1	81.6	102.3	65.3	81.8	81.8	85.9	78.6	95.2	62.4
	90	95.8	95.8	97.2	97.0	108.7	82.1	91.6	91.6	91.7	91.7	102.3	79.5	86.8	86.8	86.9	86.9	95.2	76.6
3000	75	88.3	75.0	100.4	59.9	109.4	39.7	82.8	74.2	94.4	57.2	102.7	38.0	77.1	71.2	88.0	54.4	95.2	35.1
	80	87.8	87.8	100.1	75.3	110.3	56.1	83.6	83.6	94.1	72.7	103.5	53.4	79.1	79.1	87.8	69.8	96.3	50.9
	85	93.5	93.5	99.3	89.3	110.4	71.6	89.2	89.2	93.4	86.5	103.6	68.9	84.5	84.5	87.0	83.5	96.3	66.0
	90	99.2	99.2	99.3	99.3	110.2	87.2	94.6	94.6	94.7	94.7	103.6	84.0	89.5	89.5	89.6	89.6	96.3	77.8
3300	75	89.3	80.8	102.0	62.5	110.6	41.8	83.9	78.0	95.8	59.7	103.8	37.9	78.0	74.9	89.2	56.8	96.0	35.8
	80	90.4	90.4	101.5	79.3	111.7	58.3	86.1	86.1	95.4	76.6	104.8	55.4	81.3	81.3	88.8	72.8	97.3	52.4
	85	96.3	96.3	100.4	94.1	111.6	75.1	91.8	91.8	94.2	94.2	104.7	72.4	86.8	86.8	87.7	87.7	97.1	69.5
	90	102.0	102.0	102.1	102.1	111.4	89.0	97.2	97.2	97.3	97.3	104.3	88.3	91.7	91.7	91.8	91.8	96.6	85.0
3600	75	90.3	84.5	103.2	64.9	111.4	43.3	84.6	84.6	96.9	62.1	104.6	36.0	78.6	78.6	90.1	59.2	96.7	36.0
	80	92.7	92.7	102.6	83.2	112.8	60.1	88.2	88.2	96.4	78.4	105.7	57.4	83.3	83.3	89.4	76.4	98.0	54.3
	85	98.8	98.8	101.1	101.1	112.6	78.6	94.0	94.0	94.9	94.9	105.5	75.9	88.7	88.7	88.8	88.8	97.8	72.9
	90	104.5	104.5	104.6	104.6	111.9	95.6	99.4	99.4	99.4	99.4	104.7	92.6	93.5	93.5	93.6	93.6	96.8	89.3
		Ambient Temperature 115°F						Ambient Temperature 125°F											
2400	75	68.9	59.4	78.3	46.3	85.3	32.3	62.6	57.1	71.4	43.2	77.3	26.0						
	80	69.2	69.2	78.3	58.9	86.1	43.3	64.3	64.3	71.4	55.8	78.0	40.2						
	85	74.0	74.0	78.1	70.5	86.4	55.8	68.8	68.8	71.1	67.2	78.1	52.6						
	90	78.6	78.6	78.7	78.7	86.4	68.5	73.0	73.0	73.1	73.1	78.2	63.7						
2700	75	70.1	64.3	79.9	48.9	86.7	28.5	63.7	61.0	72.7	45.7	77.9	26.8						
	80	71.9	71.9	79.8	62.9	87.4	45.6	66.7	66.7	72.6	59.8	79.1	42.0						
	85	76.8	76.8	79.3	75.5	87.4	59.4	71.3	71.3	72.0	72.0	78.9	56.1						
	90	81.5	81.5	81.6	81.6	87.5	71.6	75.3	75.3	75.4	75.4	78.7	69.2						
3000	75	71.0	68.1	81.1	51.3	87.3	29.8	64.5	64.5	73.7	48.1	78.4	27.3						
	80	74.2	74.2	80.9	66.6	88.4	47.3	68.7	68.7	73.4	62.0	79.7	44.0						
	85	79.2	79.2	80.1	80.1	88.2	62.9	73.3	73.3	73.3	73.3	79.4	60.1						
	90	83.8	83.8	83.8	83.8	87.9	77.3	77.0	77.0	77.0	77.0	78.8	73.6						
3300	75	71.7	71.7	82.1	53.7	87.8	30.3	65.5	65.5	74.4	50.4	78.8	27.8						
	80	76.2	76.2	81.6	69.7	89.1	49.3	70.4	70.4	73.8	66.2	80.1	45.8						
	85	81.2	81.2	81.3	81.3	88.9	66.3	74.8	74.8	74.9	74.9	79.9	62.3						
	90	85.5	85.5	85.6	85.6	88.1	81.6	78.1	78.1	78.1	78.1	78.8	77.9						
3600	75	72.5	72.5	82.9	56.0	88.3	34.4	66.9	66.9	75.1	52.7	79.8	33.0						
	80	77.9	77.9	82.1	73.0	89.6	51.1	71.8	71.8	74.2	69.5	80.5	47.7						
	85	82.9	82.9	82.9	82.9	89.4	69.7	76.1	76.1	76.2	76.2	80.1	64.6						
	90	86.8	86.8	86.9	86.9	88.2	85.8	78.8	78.8	78.8	78.8	78.9	78.9						

Notes:

1. All capacities shown are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat. For indoor fan heat formula, refer to appropriate airflow table notes.
2. MBh = Total gross capacity
3. SHC = Sensible heat capacity



Gross Cooling Capacities

Table 7. Gross cooling capacities — 8.5 tons

CFM	Ent DB (°F)	Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)					
		61		67		73		61		67		73		61		67		73	
		MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC
		Ambient Temperature 85°F						Ambient Temperature 95°F						Ambient Temperature 105°F					
2720	75	96.6	77.8	108.7	61.2	118.4	42.4	91.0	74.8	102.2	58.3	110.4	39.0	85.1	71.6	95.1	54.9	101.9	35.6
	80	96.0	90.3	108.5	75.2	118.6	57.0	90.5	87.2	102.0	72.1	110.7	53.7	84.6	83.9	95.0	68.8	102.1	50.1
	85	97.9	97.9	108.2	87.5	118.9	71.7	93.5	93.5	101.8	82.6	111.2	68.0	88.5	88.5	94.9	80.8	102.6	64.4
	90	107.6	101.4	107.6	101.4	118.8	85.4	98.8	98.8	101.2	98.2	111.1	82.1	93.4	93.4	94.2	94.2	102.6	78.6
3060	75	98.9	82.8	111.0	64.5	120.1	43.1	93.1	79.5	104.2	61.4	111.8	39.7	86.9	75.2	96.8	57.5	103.5	36.4
	80	98.0	96.2	110.8	79.8	120.5	59.5	92.2	92.2	104.0	76.6	112.3	56.1	86.6	86.6	96.7	73.2	103.6	52.9
	85	102.0	102.0	110.4	93.2	120.8	75.3	97.1	97.1	103.5	91.1	112.7	71.9	91.8	91.8	96.1	87.5	103.7	68.3
	90	107.7	107.7	109.4	108.4	120.7	91.2	102.4	102.4	102.7	102.7	112.6	87.8	96.5	96.5	96.6	96.6	103.7	84.2
3400	75	100.7	85.7	112.9	67.0	121.5	43.8	94.5	83.5	105.8	63.7	113.3	40.6	87.9	80.0	98.2	60.2	104.7	35.0
	80	99.5	99.5	112.6	84.3	122.1	62.2	94.5	94.5	105.6	81.0	113.6	58.8	89.2	89.2	97.9	77.6	105.0	55.3
	85	105.4	105.4	111.8	99.9	122.3	79.3	100.2	100.2	104.7	96.4	113.8	75.8	94.4	94.4	97.0	92.7	104.9	72.2
	90	111.1	111.1	111.2	111.2	122.2	96.8	105.5	105.5	105.5	105.5	113.8	92.8	98.9	98.9	99.0	99.0	104.5	88.5
3740	75	101.8	91.0	114.5	69.8	122.9	41.6	95.5	87.7	107.2	66.4	114.6	41.4	88.8	84.1	99.3	62.8	105.6	38.4
	80	102.2	102.2	114.1	88.6	123.5	64.4	97.1	97.1	106.8	85.3	115.1	60.7	91.5	91.5	99.0	81.0	106.0	57.1
	85	108.3	108.3	112.8	105.1	123.5	83.2	102.8	102.8	105.5	101.6	114.8	79.7	96.6	96.6	97.5	97.5	105.8	76.1
	90	114.0	114.0	114.1	114.1	123.4	98.9	107.9	107.9	108.0	108.0	114.4	97.3	100.8	100.8	100.9	100.9	105.0	93.4
4080	75	102.8	95.0	115.8	72.4	124.2	45.4	96.3	91.6	108.3	69.0	115.7	42.1	89.4	88.0	100.1	65.4	106.6	38.7
	80	104.7	104.7	115.3	92.9	124.8	66.4	99.3	99.3	107.8	87.6	115.9	62.8	93.4	93.4	99.4	84.7	107.0	59.3
	85	110.8	110.8	113.5	110.1	124.5	87.0	105.0	105.0	106.0	106.0	115.5	83.4	98.4	98.4	98.4	98.4	106.6	79.9
	90	116.4	116.4	116.5	116.5	123.8	105.9	109.9	109.9	109.9	109.9	114.6	102.0	102.3	102.3	102.3	102.3	105.4	98.2
		Ambient Temperature 115°F						Ambient Temperature 125°F											
2720	75	78.7	67.7	87.4	51.5	93.2	32.1	71.7	61.7	79.0	47.3	83.5	26.7						
	80	78.3	78.3	87.4	65.2	93.5	46.9	72.4	72.4	78.9	61.4	83.9	43.2						
	85	83.0	83.0	87.1	78.3	93.6	60.7	76.4	76.4	78.5	74.1	84.0	56.9						
	90	87.2	87.2	87.3	87.3	93.5	74.9	79.6	79.6	79.7	79.7	84.0	69.5						
3060	75	80.0	72.2	88.8	53.9	94.2	33.6	72.5	68.3	80.0	49.9	84.1	29.3						
	80	81.1	81.1	88.7	69.6	94.8	49.4	74.7	74.7	79.8	65.6	85.1	45.1						
	85	85.7	85.7	88.0	83.6	94.8	64.7	78.4	78.4	79.0	79.0	84.9	60.8						
	90	89.6	89.6	89.6	89.6	94.7	77.4	81.3	81.3	81.3	81.3	84.5	75.4						
3400	75	80.9	76.3	89.9	56.5	95.2	34.4	73.2	72.3	80.7	52.5	85.2	30.0						
	80	83.3	83.3	89.7	73.7	95.9	51.3	76.5	76.5	80.4	68.3	85.8	47.3						
	85	87.8	87.8	88.6	88.6	95.7	68.6	79.9	79.9	80.0	80.0	85.5	64.4						
	90	91.3	91.3	91.3	91.3	95.1	84.6	83.0	83.0	83.0	83.0	84.8	80.3						
3740	75	81.6	80.3	90.7	59.0	96.2	34.4	73.8	73.8	81.3	54.9	85.5	28.1						
	80	85.2	85.2	90.2	77.0	96.7	53.4	77.9	77.9	80.6	72.6	86.4	49.4						
	85	89.4	89.4	89.5	89.5	96.5	72.0	81.0	81.0	81.0	81.0	86.1	67.8						
	90	92.8	92.8	92.9	92.9	95.5	89.4	84.3	84.3	84.3	84.3	84.9	84.9						
4080	75	82.0	82.0	91.4	61.5	96.8	35.6	75.1	75.1	81.8	57.4	86.2	31.2						
	80	86.8	86.8	90.6	80.6	97.4	55.5	79.0	79.0	80.8	76.1	86.9	51.4						
	85	90.8	90.8	90.8	90.8	97.1	76.0	82.0	82.0	82.1	82.1	86.2	71.2						
	90	94.4	94.4	94.4	94.4	95.7	94.2	85.3	85.3	85.4	85.4	85.4	85.4						

Notes:

1. All capacities shown are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat. For indoor fan heat formula, refer to appropriate airflow table notes.
2. MBh = Total gross capacity
3. SHC = Sensible heat capacity

Table 8. Gross cooling capacities — 10 tons

CFM	Ent DB (°F)	Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)					
		61		67		73		61		67		73		61		67		73	
		MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC
		Ambient Temperature 85°F						Ambient Temperature 95°F						Ambient Temperature 105°F					
3200	75	113.3	91.6	127.5	72.0	138.4	47.1	106.8	88.1	119.9	68.7	129.2	43.6	99.8	84.5	111.7	64.9	119.2	41.7
	80	112.4	106.2	127.2	88.5	138.7	66.8	105.9	102.5	119.7	85.0	129.5	63.4	99.0	99.0	111.6	81.1	119.5	59.0
	85	114.8	114.8	126.8	105.0	139.0	84.2	109.6	109.6	119.4	101.5	130.1	80.0	103.9	103.9	111.3	95.1	120.1	75.8
	90	125.9	119.3	125.9	119.3	138.9	100.5	115.9	115.9	118.5	115.5	130.1	96.7	109.6	109.6	110.4	110.4	120.2	92.6
3600	75	115.9	97.5	130.2	75.8	140.2	50.4	109.1	93.6	122.2	72.2	130.5	46.5	101.8	87.1	113.6	67.9	120.9	42.7
	80	114.6	114.6	129.8	93.9	140.7	69.7	107.9	107.9	122.0	90.3	131.2	65.9	101.5	101.5	113.4	87.6	121.1	62.1
	85	119.4	119.4	129.3	109.2	141.1	88.4	113.9	113.9	121.3	107.2	131.7	84.6	107.7	107.7	112.7	103.0	121.3	80.4
	90	126.1	126.1	127.8	127.3	141.0	107.1	120.1	120.1	120.2	120.2	131.7	103.3	113.3	113.3	113.4	113.4	121.4	99.1
4000	75	117.9	100.4	132.3	78.8	141.6	51.1	110.6	98.2	124.1	75.0	132.2	47.4	103.0	94.1	115.2	71.0	122.2	43.6
	80	116.4	116.4	131.9	101.1	142.8	73.7	110.8	110.8	123.7	95.4	132.6	68.6	104.7	104.7	114.9	91.4	122.6	65.2
	85	123.4	123.4	130.7	117.4	142.6	93.0	117.4	117.4	122.6	113.4	132.9	89.1	110.8	110.8	113.6	113.6	122.5	84.9
	90	130.1	130.1	130.2	130.2	142.6	113.7	123.6	123.6	123.7	123.7	133.0	108.1	116.0	116.0	116.1	116.1	122.1	104.0
4400	75	119.1	106.9	134.1	82.0	143.1	52.0	111.8	103.0	125.6	78.2	133.6	48.3	103.9	98.8	116.4	74.0	123.3	44.4
	80	119.6	119.6	133.5	104.2	143.8	75.7	113.8	113.8	125.1	100.4	134.1	71.2	107.3	107.3	116.0	94.7	123.8	67.1
	85	126.7	126.7	131.8	123.4	143.9	97.6	120.4	120.4	123.3	123.3	133.9	93.6	113.3	113.3	114.1	114.1	123.5	89.5
	90	133.4	133.4	133.5	133.5	143.8	117.8	126.4	126.4	126.4	126.4	133.5	114.3	118.2	118.2	118.2	118.2	122.5	109.6
4800	75	120.1	111.6	135.5	85.1	144.4	52.9	112.5	112.5	126.8	81.2	134.7	49.2	104.5	104.5	117.3	77.0	124.3	45.3
	80	122.5	122.5	134.8	109.1	145.2	77.7	116.3	116.3	126.2	101.9	135.0	73.6	109.5	109.5	116.5	99.6	124.8	69.7
	85	129.6	129.6	132.4	132.4	145.0	102.0	122.9	122.9	123.8	123.8	134.8	97.4	115.3	115.3	115.4	115.4	124.4	94.0
	90	136.1	136.1	136.2	136.2	144.1	124.1	128.6	128.6	128.7	128.7	133.7	119.7	119.7	119.7	119.8	119.8	122.7	122.7
		Ambient Temperature 115°F						Ambient Temperature 125°F											
3200	75	92.4	79.7	102.8	60.9	109.0	37.7	84.2	75.7	92.9	56.0	97.6	33.3						
	80	91.9	91.9	102.7	77.0	109.4	55.0	85.3	85.3	92.8	71.9	98.2	51.0						
	85	97.5	97.5	102.3	92.3	109.5	71.5	90.0	90.0	92.3	87.5	98.4	67.1						
	90	102.5	102.5	102.6	102.6	109.4	88.2	93.8	93.8	93.9	93.9	98.4	81.3						
3600	75	93.8	85.0	104.3	63.6	110.3	38.6	85.3	80.6	94.0	59.1	97.8	36.7						
	80	95.2	95.2	104.2	82.8	110.8	57.9	88.0	88.0	93.9	77.6	99.5	53.2						
	85	100.7	100.7	103.3	98.5	110.8	76.2	92.4	92.4	92.9	92.9	99.3	71.7						
	90	105.2	105.2	105.3	105.3	110.6	93.5	95.4	95.4	95.4	95.4	98.8	88.8						
4000	75	94.8	89.9	105.5	66.7	111.4	39.5	86.0	86.0	94.8	62.0	99.3	35.0						
	80	97.9	97.9	105.3	86.6	112.0	60.3	90.0	90.0	94.5	81.4	100.2	55.7						
	85	103.1	103.1	103.9	103.9	111.8	82.3	94.0	94.0	94.1	94.1	99.8	74.7						
	90	107.1	107.1	107.2	107.2	111.1	99.4	97.2	97.2	97.3	97.3	99.1	94.5						
4400	75	95.5	95.5	106.4	69.7	112.2	40.3	86.8	86.8	95.5	64.9	99.9	35.8						
	80	100.0	100.0	105.8	90.7	112.9	62.8	91.7	91.7	94.7	85.6	100.6	57.3						
	85	105.0	105.0	105.1	105.1	112.6	83.0	95.1	95.1	95.2	95.2	100.6	79.2						
	90	108.6	108.6	108.7	108.7	111.5	105.0	98.7	98.7	98.7	98.7	99.2	99.2						
4800	75	96.1	96.1	107.2	72.6	112.9	41.1	88.3	88.3	96.0	67.8	100.5	36.7						
	80	101.9	101.9	106.2	94.8	113.8	66.2	93.0	93.0	94.8	94.8	101.2	61.1						
	85	106.5	106.5	106.5	106.5	113.3	88.0	96.1	96.1	96.2	96.2	100.6	83.7						
	90	110.3	110.3	110.4	110.4	111.6	110.6	99.8	99.8	99.8	99.8	99.9	99.9						

Notes:

1. All capacities shown are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat. For indoor fan heat formula, refer to appropriate airflow table notes.
2. MBh = Total gross capacity
3. SHC = Sensible heat capacity



Gross Cooling Capacities

Table 9. Gross cooling capacities — 12.5 tons

CFM	Ent DB (°F)	Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)					
		61		67		73		61		67		73		61		67		73	
		MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC
		Ambient Temperature 85°F						Ambient Temperature 95°F						Ambient Temperature 105°F					
4000	75	141.8	114.5	159.7	90.1	174.1	59.0	133.7	110.2	150.2	85.7	162.5	57.4	125.0	105.6	140.0	81.0	149.9	52.2
	80	140.5	132.6	159.4	110.8	174.3	83.7	132.5	128.1	150.0	106.2	162.9	77.3	123.9	123.2	139.8	101.4	150.5	73.8
	85	143.3	143.3	158.7	131.4	174.6	105.5	137.0	137.0	149.5	126.9	163.3	100.1	129.9	129.9	139.4	119.3	151.0	95.0
	90	157.4	149.1	157.4	149.1	174.4	125.9	144.8	144.8	148.2	144.3	163.3	121.1	137.1	137.1	138.2	138.2	151.1	116.0
4500	75	145.0	121.9	163.1	94.8	176.6	63.3	136.6	117.3	153.1	90.2	164.4	58.3	127.5	110.5	142.4	85.4	151.2	53.1
	80	143.2	141.1	162.7	117.5	177.0	87.3	134.8	134.8	152.8	112.9	165.0	80.9	126.9	126.9	142.1	110.0	152.1	77.3
	85	149.1	149.1	161.8	137.1	177.3	110.9	142.2	142.2	151.8	134.0	165.5	105.9	134.6	134.6	141.1	128.7	152.6	100.7
	90	157.5	157.5	159.8	159.1	177.1	134.3	150.1	150.1	150.3	150.3	165.5	129.4	141.7	141.7	141.8	141.8	152.8	124.3
5000	75	147.5	127.9	165.8	98.6	178.5	64.3	138.3	122.7	155.5	93.8	165.8	59.2	128.8	117.6	144.4	88.7	152.2	53.9
	80	145.2	145.2	165.2	127.5	179.1	90.9	138.3	138.3	154.9	118.9	166.8	86.2	130.7	130.7	143.9	110.0	153.6	80.8
	85	154.1	154.1	163.5	146.7	179.4	116.7	146.7	146.7	153.3	141.6	167.1	111.6	138.4	138.4	142.3	136.2	153.9	106.3
	90	162.5	162.5	162.7	162.7	179.2	131.9	154.5	154.5	154.6	154.6	167.2	135.7	145.3	145.3	145.4	145.4	153.8	130.4
5500	75	148.9	133.5	168.1	102.6	180.0	65.2	139.7	128.6	157.4	97.7	167.0	60.1	130.0	123.3	145.8	92.5	153.5	54.9
	80	149.3	149.3	167.2	130.4	181.0	94.9	142.0	142.0	156.6	125.6	168.4	90.1	134.0	134.0	145.3	119.2	154.8	83.7
	85	158.3	158.3	164.8	154.1	181.1	122.3	150.4	150.4	154.3	148.9	168.5	117.3	141.6	141.6	142.9	142.9	154.9	113.0
	90	166.7	166.7	166.9	166.9	181.0	146.2	158.1	158.1	158.2	158.2	167.9	143.1	148.2	148.2	148.3	148.3	154.1	137.2
6000	75	150.1	139.2	169.9	106.5	181.3	66.2	140.7	134.2	158.8	101.5	167.9	61.0	130.7	128.9	147.1	96.3	154.6	56.0
	80	152.9	152.9	168.8	136.6	182.6	97.5	145.3	145.3	158.0	128.5	169.5	92.3	136.8	136.8	145.9	124.4	155.5	86.7
	85	161.9	161.9	165.7	161.3	182.5	127.9	153.6	153.6	155.0	155.0	169.6	122.7	144.3	144.3	144.4	144.4	155.8	117.4
	90	170.3	170.3	170.4	170.4	181.3	155.4	161.0	161.0	161.1	161.1	168.2	149.8	150.4	150.4	150.5	150.5	154.1	143.9
		Ambient Temperature 115°F						Ambient Temperature 125°F											
4000	75	115.5	99.7	128.7	75.9	136.1	46.7	104.8	94.2	116.2	69.8	121.5	41.0						
	80	114.8	114.8	128.7	96.3	136.9	68.4	106.2	106.2	116.1	89.4	122.0	63.0						
	85	121.8	121.8	128.1	115.4	137.5	89.5	112.4	112.4	115.5	109.3	122.5	83.5						
	90	128.3	128.3	128.4	128.4	137.7	110.6	117.6	117.6	117.7	117.7	122.8	101.6						
4500	75	117.2	106.1	130.7	79.5	137.3	47.6	106.2	100.3	117.6	73.6	122.5	42.0						
	80	118.8	118.8	130.5	99.4	138.2	71.8	109.6	109.6	117.5	92.5	123.4	66.6						
	85	125.8	125.8	129.3	129.3	138.6	95.1	115.5	115.5	116.3	116.3	123.2	95.8						
	90	131.9	131.9	132.0	132.0	138.9	113.7	119.9	119.9	120.0	120.0	122.9	110.5						
5000	75	118.5	112.1	132.2	83.3	138.5	48.6	107.1	106.1	118.7	77.4	123.4	43.0						
	80	122.2	122.2	131.9	104.9	139.5	74.9	112.3	112.3	118.3	101.6	124.3	69.0						
	85	129.0	129.0	130.2	130.2	139.4	102.3	117.8	117.8	117.8	117.8	124.2	91.8						
	90	134.6	134.6	134.7	134.7	139.0	124.1	121.4	121.4	121.5	121.5	123.2	117.6						
5500	75	119.4	117.8	133.4	87.0	139.5	49.7	108.0	108.0	119.6	81.1	124.1	44.0						
	80	125.0	125.0	132.6	113.3	140.3	78.0	114.5	114.5	118.7	106.8	125.0	72.2						
	85	131.5	131.5	131.6	131.6	140.2	102.5	119.5	119.5	119.5	119.5	125.0	97.9						
	90	136.5	136.5	136.6	136.6	139.0	130.9	122.7	122.7	122.8	122.8	123.3	123.3						
6000	75	119.9	119.9	134.3	90.7	140.4	50.7	110.0	110.0	120.3	84.7	124.7	45.0						
	80	127.3	127.3	133.1	118.4	141.2	81.1	116.2	116.2	118.8	118.8	125.6	75.3						
	85	133.5	133.5	133.6	133.6	140.9	109.9	120.7	120.7	120.7	120.7	125.0	104.1						
	90	137.8	137.8	137.9	137.9	139.0	139.0	124.1	124.1	124.1	124.1	124.2	124.2						

Notes:

1. All capacities shown are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat. For indoor fan heat formula, refer to appropriate airflow table notes.
2. MBh = Total gross capacity
3. SHC = Sensible heat capacity

Table 10. Gross cooling capacities — 15 tons

CFM	Ent DB (°F)	Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)					
		61		67		73		61		67		73		61		67		73	
		MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC
		Ambient Temperature 85°F						Ambient Temperature 95°F						Ambient Temperature 105°F					
4800	75	171.4	138.6	192.9	109.4	211.2	72.4	162.1	133.8	182.5	104.9	199.1	71.7	152.3	128.8	171.4	99.9	186.2	66.6
	80	170.4	160.6	192.6	134.2	211.4	102.3	161.3	155.6	182.2	129.3	199.5	97.5	151.5	151.5	171.2	124.3	186.8	92.4
	85	173.9	173.9	191.9	158.8	211.7	128.2	166.7	166.7	181.7	154.0	200.0	123.5	158.7	158.7	170.7	147.5	187.5	117.7
	90	190.9	180.4	190.9	180.4	211.6	152.6	176.1	176.1	180.6	175.2	199.9	147.8	167.8	167.8	169.6	169.6	187.3	142.6
5400	75	175.4	147.5	197.2	115.2	214.7	78.1	165.8	142.6	186.3	110.3	202.1	73.1	155.5	134.3	174.7	104.9	188.7	67.9
	80	173.9	173.9	196.7	142.3	215.1	106.9	164.4	164.4	185.9	137.4	202.7	101.9	155.1	155.1	174.4	132.2	189.6	96.8
	85	180.9	180.9	195.9	167.0	215.7	135.0	173.2	173.2	185.3	158.3	203.3	130.0	164.7	164.7	173.4	157.3	190.2	124.8
	90	191.0	191.0	194.1	192.6	215.3	162.9	182.9	182.9	183.5	183.5	203.1	157.9	173.8	173.8	174.0	174.0	190.0	152.7
6000	75	178.6	154.8	200.6	120.5	218.0	79.7	168.7	144.8	189.4	114.7	204.6	74.5	157.6	143.6	177.5	109.5	190.7	69.2
	80	176.6	176.6	200.0	150.2	218.3	111.3	168.5	168.5	188.8	146.8	205.5	106.8	160.0	160.0	176.9	139.9	192.1	101.7
	85	186.9	186.9	198.6	177.7	218.7	142.1	178.7	178.7	187.3	172.3	205.9	137.0	169.7	169.7	175.2	166.6	192.4	131.7
	90	197.2	197.2	197.4	197.4	218.3	172.9	188.4	188.4	188.6	188.6	205.7	167.9	178.8	178.8	178.9	178.9	192.2	157.6
6600	75	180.7	161.9	203.5	124.7	221.0	81.2	170.3	156.4	192.0	119.6	207.0	75.9	159.3	150.7	179.7	114.2	192.6	70.6
	80	181.3	181.3	202.7	157.9	221.1	116.2	173.1	173.1	191.2	153.3	208.0	111.3	164.2	164.2	179.0	147.5	194.4	106.3
	85	192.1	192.1	200.4	186.7	221.2	149.0	183.4	183.4	188.8	181.2	208.1	143.9	174.0	174.0	176.4	176.4	194.2	138.6
	90	202.4	202.4	202.6	202.6	220.8	179.3	193.1	193.1	193.3	193.3	207.6	174.4	182.8	182.8	183.0	183.0	193.1	169.1
7200	75	182.4	168.8	206.0	129.4	223.8	82.8	171.8	163.3	194.1	124.2	209.2	77.4	160.5	160.5	181.6	118.8	194.5	71.9
	80	185.6	185.6	204.9	165.4	223.6	120.8	177.1	177.1	193.1	158.8	210.4	114.4	167.8	167.8	180.7	148.6	196.3	108.9
	85	196.6	196.6	201.6	201.6	223.3	155.9	187.5	187.5	189.8	189.8	209.9	154.9	177.5	177.5	177.7	177.7	195.7	145.3
	90	206.8	206.8	207.0	207.0	222.0	189.1	197.0	197.0	197.2	197.2	208.2	183.3	186.2	186.2	186.3	186.3	193.5	177.3
		Ambient Temperature 115°F						Ambient Temperature 125°F											
4800	75	141.8	122.9	159.5	94.4	172.5	61.3	130.5	113.5	146.6	89.1	157.7	55.6						
	80	141.2	141.2	159.3	118.9	173.3	87.1	132.0	132.0	146.4	113.2	158.6	81.8						
	85	150.1	150.1	159.0	137.0	174.0	112.3	140.4	140.4	145.7	135.8	159.2	106.5						
	90	158.6	158.6	158.8	158.8	173.8	137.3	148.1	148.1	148.3	148.3	159.1	131.5						
5400	75	144.3	130.3	162.4	99.1	174.6	62.5	132.4	124.2	149.1	93.3	159.3	56.8						
	80	146.3	146.3	162.1	126.8	175.7	91.9	136.7	136.7	148.7	120.5	160.8	86.4						
	85	155.4	155.4	160.9	151.4	176.2	119.3	145.0	145.0	147.4	147.4	161.0	113.4						
	90	163.9	163.9	164.0	164.0	176.1	146.7	152.5	152.5	152.6	152.6	160.6	139.4						
6000	75	146.2	137.7	164.8	103.9	176.2	63.8	133.9	133.9	151.0	98.0	160.6	58.0						
	80	150.7	150.7	164.2	131.8	178.0	96.5	140.5	140.5	150.5	125.8	163.1	89.6						
	85	159.9	159.9	162.4	162.4	178.0	126.2	148.8	148.8	148.9	148.9	162.4	122.6						
	90	168.1	168.1	168.2	168.2	177.3	154.5	155.9	155.9	156.0	156.0	161.1	147.8						
6600	75	147.6	147.6	166.7	108.5	177.7	65.0	135.1	135.1	152.5	102.5	161.8	59.3						
	80	154.5	154.5	166.0	137.6	180.1	99.4	143.7	143.7	151.3	133.6	164.3	93.4						
	85	163.5	163.5	163.7	163.7	179.4	132.9	151.9	151.9	152.0	152.0	163.5	126.7						
	90	171.4	171.4	171.6	171.6	177.8	162.8	158.5	158.5	158.6	158.6	161.2	156.2						
7200	75	148.6	148.6	168.2	113.1	179.2	66.4	137.5	137.5	153.8	107.0	163.0	60.6						
	80	157.7	157.7	166.6	146.5	181.3	103.2	146.5	146.5	152.0	139.9	165.3	97.1						
	85	166.6	166.6	166.7	166.7	180.7	139.6	154.4	154.4	154.5	154.5	164.5	130.7						
	90	174.2	174.2	174.3	174.3	177.9	171.0	160.5	160.5	160.6	160.6	161.2	161.2						

Notes:

1. All capacities shown are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat. For indoor fan heat formula, refer to appropriate airflow table notes.
2. MBh = Total gross capacity
3. SHC = Sensible heat capacity



Gross Cooling Capacities

Table 11. Gross cooling capacities — 17.5 tons

CFM	Ent DB (°F)	Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)					
		61		67		73		61		67		73		61		67		73	
		MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC
		Ambient Temperature 85°F						Ambient Temperature 95°F						Ambient Temperature 105°F					
5600	75	195.0	155.8	221.2	123.2	241.9	80.7	184.3	149.7	209.0	117.3	226.7	78.3	172.8	143.3	195.9	110.8	210.5	71.2
	80	193.3	180.4	220.7	151.4	241.8	114.4	182.8	174.0	208.6	145.1	226.5	107.5	171.3	171.3	195.5	138.4	210.7	100.5
	85	196.1	196.1	219.5	179.3	241.7	144.0	187.7	187.7	207.6	173.1	226.7	137.3	178.4	178.4	194.7	166.0	210.6	128.9
	90	207.8	207.8	218.0	203.4	241.7	171.7	199.0	199.0	206.1	196.8	226.9	164.9	189.3	189.3	193.2	189.8	210.7	157.6
6300	75	199.7	165.9	226.3	129.9	247.2	87.4	188.6	159.6	213.4	123.5	230.9	80.1	176.6	151.3	199.6	116.8	213.7	72.8
	80	197.3	197.3	225.6	160.5	247.2	119.9	186.3	186.3	212.8	154.1	230.9	112.8	174.5	174.5	199.1	151.6	214.0	106.0
	85	204.4	204.4	224.1	185.8	246.5	151.4	195.4	195.4	211.7	179.8	231.2	143.7	185.6	185.6	197.7	175.7	214.1	137.0
	90	216.5	216.5	221.8	217.0	245.4	182.9	207.0	207.0	209.3	209.3	229.7	175.9	196.4	196.4	196.6	196.6	213.3	168.6
7000	75	203.4	174.4	230.3	135.9	251.4	89.3	191.9	164.0	216.9	129.5	234.2	81.8	179.1	159.8	202.6	121.2	216.2	74.3
	80	200.3	200.3	229.3	169.3	251.3	125.1	189.8	189.8	216.1	162.8	234.3	117.8	179.9	179.9	201.9	155.8	216.7	110.6
	85	211.5	211.5	227.2	200.3	250.7	159.7	202.0	202.0	214.0	193.3	234.0	152.3	191.5	191.5	199.8	185.9	216.6	144.7
	90	223.8	223.8	224.3	224.3	249.0	194.2	213.5	213.5	213.7	213.7	233.3	185.0	201.9	201.9	202.1	202.1	215.9	177.2
7700	75	205.8	181.8	233.5	140.3	254.9	91.1	193.8	174.9	219.7	133.5	237.0	83.5	181.0	167.6	205.0	126.3	218.3	75.8
	80	204.7	204.7	232.7	175.5	254.7	130.9	195.2	195.2	218.6	164.2	237.0	123.6	184.9	184.9	204.0	159.1	218.9	116.3
	85	217.7	217.7	229.3	210.3	253.8	167.5	207.6	207.6	215.4	215.4	236.5	160.0	196.5	196.5	200.9	200.9	218.5	152.3
	90	229.8	229.8	230.0	230.0	252.2	202.9	218.7	218.7	218.9	218.9	235.0	194.6	206.0	206.0	206.2	206.2	216.9	186.7
8400	75	207.7	189.5	236.3	145.5	257.8	92.8	195.9	181.9	222.0	138.5	239.2	85.1	182.2	182.2	206.8	131.3	220.0	77.2
	80	209.9	209.9	234.6	178.2	257.5	135.3	200.0	200.0	220.6	165.6	239.3	126.5	189.3	189.3	205.8	166.9	220.8	118.6
	85	222.9	222.9	230.5	230.5	256.4	175.2	212.4	212.4	216.5	216.5	238.5	173.3	200.6	200.6	201.7	201.7	220.0	158.7
	90	234.8	234.8	235.0	235.0	253.6	212.3	222.8	222.8	223.0	223.0	236.0	204.2	208.9	208.9	209.0	209.0	217.6	195.9
		Ambient Temperature 115°F						Ambient Temperature 125°F											
5600	75	160.6	136.5	181.7	103.9	193.3	63.7	147.4	126.8	166.3	96.5	174.2	55.8						
	80	159.2	159.2	181.4	131.4	193.7	93.1	147.2	147.2	166.1	123.9	175.1	85.3						
	85	168.4	168.4	180.8	154.0	194.1	121.6	157.1	157.1	165.3	149.5	175.6	113.7						
	90	178.5	178.5	179.3	179.3	193.6	150.0	166.0	166.0	166.2	166.2	175.5	142.2						
6300	75	163.9	140.2	184.9	109.8	195.5	65.1	149.7	136.3	168.8	100.9	175.6	57.0						
	80	163.9	163.9	184.4	140.1	196.2	98.2	152.7	152.7	168.4	133.3	176.9	89.9						
	85	174.8	174.8	183.1	168.0	196.4	129.3	162.6	162.6	166.8	166.8	177.1	121.2						
	90	184.5	184.5	184.6	184.6	196.1	160.2	170.3	170.3	170.4	170.4	176.8	150.7						
7000	75	165.8	152.3	187.3	113.8	197.3	66.5	151.3	151.3	170.7	105.9	176.7	58.3						
	80	169.2	169.2	186.7	146.9	198.2	103.7	157.4	157.4	170.2	139.8	178.6	93.9						
	85	180.0	180.0	184.4	184.4	198.2	136.9	166.8	166.8	167.9	167.9	178.1	130.0						
	90	188.6	188.6	188.7	188.7	197.4	169.0	172.3	172.3	172.4	172.4	177.3	160.0						
7700	75	167.2	167.2	189.2	118.8	198.7	67.9	152.6	152.6	172.0	110.7	177.5	59.6						
	80	173.7	173.7	188.5	154.0	200.0	106.4	161.2	161.2	171.1	146.2	179.6	97.8						
	85	184.1	184.1	185.3	185.3	199.5	145.0	169.8	169.8	169.9	169.9	179.1	136.7						
	90	191.1	191.1	191.2	191.2	198.0	178.2	174.4	174.4	174.5	174.5	177.5	169.2						
8400	75	168.4	168.4	190.6	123.6	199.8	69.2	153.8	153.8	173.1	115.5	178.2	60.8						
	80	177.5	177.5	189.1	161.7	201.3	110.5	164.4	164.4	171.5	153.1	180.3	101.9						
	85	187.4	187.4	187.5	187.5	200.7	152.6	171.8	171.8	171.9	171.9	179.8	141.7						
	90	193.4	193.4	193.5	193.5	198.3	187.3	176.4	176.4	176.5	176.5	177.5	177.5						

Notes:

1. All capacities shown are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat. For indoor fan heat formula, refer to appropriate airflow table notes.
2. MBh = Total gross capacity
3. SHC = Sensible heat capacity

Table 12. Gross cooling capacities — 20 tons

CFM	Ent DB (°F)	Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)					
		61		67		73		61		67		73		61		67		73	
		MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC
		Ambient Temperature 85°F						Ambient Temperature 95°F						Ambient Temperature 105°F					
6400	75	226.5	180.4	254.8	142.6	275.1	92.9	213.2	173.3	239.2	135.3	256.8	91.0	198.7	165.7	222.0	127.3	237.1	83.1
	80	224.0	207.9	254.6	174.6	275.4	131.6	210.8	200.4	239.1	167.1	256.9	123.9	196.3	196.3	221.9	159.1	237.3	116.0
	85	225.9	225.9	253.2	206.0	275.9	165.2	215.6	215.6	237.9	198.7	256.9	157.4	204.0	204.0	221.1	181.1	237.5	148.3
	90	238.8	238.8	251.1	233.1	276.0	196.5	227.9	227.9	235.8	225.2	257.0	188.5	215.3	215.3	218.8	216.5	237.0	180.2
7200	75	231.9	190.5	260.3	149.9	280.2	100.7	217.9	184.3	243.8	142.4	261.1	93.0	202.8	175.3	225.7	134.3	240.2	84.8
	80	228.4	228.4	259.8	184.7	280.2	137.3	214.6	214.6	243.4	177.0	261.3	129.6	199.6	199.6	225.3	174.1	240.7	122.2
	85	235.1	235.1	258.2	219.7	280.0	173.1	224.0	224.0	242.2	207.2	261.3	165.4	211.5	211.5	223.9	200.6	240.9	157.1
	90	248.3	248.3	254.9	247.9	279.8	208.9	236.3	236.3	238.8	238.8	260.2	200.8	222.3	222.3	222.5	222.5	240.2	192.7
8000	75	236.1	202.3	264.6	156.5	284.6	102.7	221.6	191.6	247.4	148.0	264.5	94.8	205.2	183.9	228.6	139.2	242.7	86.3
	80	231.6	231.6	263.8	194.4	284.6	143.0	218.0	218.0	246.7	186.5	264.8	135.8	205.6	205.6	228.0	176.6	243.4	127.8
	85	243.0	243.0	261.3	229.4	284.2	182.0	231.1	231.1	244.3	220.8	264.6	174.1	217.6	217.6	225.5	211.6	243.4	165.7
	90	256.1	256.1	257.3	257.3	282.7	221.0	243.0	243.0	243.2	243.2	263.4	213.2	227.6	227.6	227.7	227.7	242.6	198.6
8800	75	239.4	204.6	268.1	161.5	288.1	104.5	223.5	201.2	250.3	153.4	267.2	96.4	207.0	192.4	230.8	144.7	244.5	87.9
	80	235.7	235.7	267.0	203.8	288.2	149.2	224.0	224.0	249.3	193.6	267.7	141.4	210.9	210.9	230.1	178.5	245.7	133.3
	85	249.7	249.7	263.4	240.2	287.5	190.7	237.0	237.0	245.7	231.5	267.2	182.7	222.5	222.5	226.3	226.3	245.3	174.1
	90	262.6	262.6	262.8	262.8	285.5	232.3	248.3	248.3	248.5	248.5	265.4	221.6	231.3	231.3	231.5	231.5	243.3	212.4
9600	75	240.7	217.9	271.0	167.2	291.0	106.2	225.1	209.5	252.6	159.0	269.4	98.0	208.2	208.2	232.4	150.2	246.0	89.3
	80	241.4	241.4	269.5	211.1	291.1	154.4	229.1	229.1	251.5	199.4	270.1	146.5	215.3	215.3	231.8	189.8	247.6	136.3
	85	255.4	255.4	264.5	264.5	290.1	199.2	241.9	241.9	246.4	246.4	269.3	196.8	226.3	226.3	226.7	226.7	246.9	178.7
	90	268.0	268.0	268.1	268.1	286.8	240.8	252.5	252.5	252.6	252.6	266.2	231.9	234.2	234.2	234.4	234.4	243.9	222.5
		Ambient Temperature 115°F						Ambient Temperature 125°F											
6400	75	182.9	157.7	203.0	119.3	215.1	74.5	165.7	144.0	181.8	110.1	190.1	65.0						
	80	180.7	180.7	203.0	150.4	215.6	107.5	166.1	166.1	181.9	141.0	191.2	98.9						
	85	191.0	191.0	202.5	174.6	216.1	139.7	175.5	175.5	180.9	169.3	191.8	130.2						
	90	200.6	200.6	200.8	200.8	215.8	171.7	182.2	182.2	182.3	182.3	191.8	160.4						
7200	75	186.0	165.7	205.9	124.8	217.1	75.9	167.6	156.1	183.7	114.7	191.0	66.3						
	80	186.4	186.4	205.6	159.9	218.0	113.6	171.4	171.4	183.6	146.0	192.9	104.5						
	85	197.1	197.1	203.9	190.9	218.4	148.3	179.8	179.8	181.6	181.6	193.1	138.6						
	90	205.6	205.6	205.7	205.7	218.1	180.4	185.7	185.7	185.8	185.8	192.5	171.1						
8000	75	187.9	174.6	207.9	130.0	218.5	77.3	168.9	168.9	184.9	120.1	191.6	67.5						
	80	191.7	191.7	207.6	161.0	220.1	119.2	175.5	175.5	185.0	153.7	194.4	107.7						
	85	201.8	201.8	204.7	204.7	220.1	156.7	182.6	182.6	182.7	182.7	194.0	141.9						
	90	208.7	208.7	208.8	208.8	218.9	192.2	189.0	189.0	189.1	189.1	192.6	181.4						
8800	75	189.2	189.2	209.4	135.4	219.6	78.7	169.9	169.9	185.9	125.4	192.1	68.8						
	80	196.1	196.1	209.2	172.5	221.8	122.3	178.6	178.6	185.0	164.7	195.0	112.2						
	85	205.3	205.3	205.4	205.4	221.4	165.0	184.6	184.6	184.7	184.7	194.8	153.0						
	90	212.6	212.6	212.7	212.7	219.3	202.4	191.2	191.2	191.3	191.3	192.5	191.5						
9600	75	190.1	190.1	210.6	140.7	220.5	80.0	172.2	172.2	186.8	130.7	192.6	70.2						
	80	199.6	199.6	209.3	183.2	222.9	126.8	181.0	181.0	185.0	172.1	195.4	116.6						
	85	207.8	207.8	207.9	207.9	222.5	174.2	187.1	187.1	187.2	187.2	195.1	160.6						
	90	215.8	215.8	215.9	215.9	219.4	212.4	192.5	192.5	192.6	192.6	192.6	192.6						

Notes:

1. All capacities shown are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat. For indoor fan heat formula, refer to appropriate airflow table notes.
2. MBh = Total gross capacity
3. SHC = Sensible heat capacity



Gross Cooling Capacities

Table 13. Gross cooling capacities — 25 tons

CFM	Ent DB (°F)	Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)						Entering Wet Bulb Temp (°F)					
		61		67		73		61		67		73		61		67		73	
		MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC	MBh	SHC
		Ambient Temperature 85°F						Ambient Temperature 95°F						Ambient Temperature 105°F					
8000	75	255.1	208.2	290.7	166.0	319.2	115.1	241.0	200.7	274.2	158.4	298.9	106.7	225.7	192.8	256.3	149.9	276.4	97.6
	80	250.0	250.0	289.6	202.5	319.4	154.4	236.1	236.1	273.1	194.7	299.4	146.1	221.1	221.1	255.2	186.3	277.3	137.2
	85	255.1	255.1	286.4	239.3	319.5	194.9	244.4	244.4	270.3	213.6	299.9	184.5	232.5	232.5	252.9	215.2	278.1	175.4
	90	270.3	270.3	281.6	268.6	318.4	230.7	259.0	259.0	265.6	260.3	298.9	222.4	246.3	246.3	248.2	248.2	277.5	213.5
9000	75	260.3	220.8	297.1	174.5	324.1	117.2	245.6	211.2	279.7	166.7	302.6	108.4	228.8	201.7	260.8	156.0	279.2	99.2
	80	253.7	253.7	295.2	225.3	324.6	160.9	239.2	239.2	278.0	206.1	303.6	152.4	226.4	226.4	259.3	200.1	280.6	143.9
	85	265.0	265.0	291.0	250.7	324.9	203.2	253.6	253.6	273.5	242.3	304.0	194.5	240.9	240.9	254.9	232.9	281.2	185.2
	90	280.8	280.8	284.8	284.8	323.2	245.2	268.6	268.6	268.8	268.8	302.9	236.8	254.8	254.8	255.0	255.0	280.6	227.7
10000	75	263.5	228.8	302.0	180.1	327.9	119.0	247.7	220.7	284.1	171.8	305.4	110.1	231.0	211.5	264.8	162.9	282.6	101.2
	80	257.3	257.3	299.5	226.2	328.8	168.5	245.9	245.9	281.6	218.6	307.1	158.7	233.2	233.2	262.3	202.3	283.6	149.5
	85	273.6	273.6	293.3	263.7	328.7	213.1	261.5	261.5	275.6	254.8	307.1	204.3	248.0	248.0	256.3	256.3	283.4	205.7
	90	289.7	289.7	289.9	289.9	326.9	259.5	276.7	276.7	276.9	276.9	305.9	245.6	261.7	261.7	261.9	261.9	281.7	237.0
11000	75	265.4	238.9	306.5	187.1	330.9	120.7	249.4	230.1	288.0	178.6	308.6	112.1	232.2	232.2	267.7	169.5	285.3	103.2
	80	264.4	264.4	302.8	229.2	332.4	175.1	252.4	252.4	284.5	226.8	310.3	164.6	239.2	239.2	264.7	214.8	286.1	154.1
	85	281.1	281.1	294.7	294.7	331.8	222.8	268.3	268.3	276.6	276.6	309.5	226.3	254.0	254.0	257.0	257.0	285.4	205.8
	90	297.4	297.4	297.6	297.6	328.5	268.8	283.4	283.4	283.6	283.6	306.3	258.9	267.4	267.4	267.5	267.5	282.0	248.4
12000	75	266.5	266.5	310.1	193.7	334.3	122.8	250.3	250.3	290.8	185.1	311.8	114.2	232.9	232.9	269.9	175.8	287.6	105.1
	80	270.6	270.6	305.4	229.9	335.6	178.4	258.1	258.1	285.7	235.0	312.6	169.1	244.3	244.3	264.8	224.7	288.0	159.3
	85	287.7	287.7	295.4	295.4	334.3	232.4	274.2	274.2	277.0	277.0	311.6	226.8	259.0	259.0	259.2	259.2	287.0	206.0
	90	304.0	304.0	304.2	304.2	329.2	279.9	289.1	289.1	289.3	289.3	306.5	270.1	271.9	271.9	272.1	272.1	282.2	258.5
		Ambient Temperature 115°F						Ambient Temperature 125°F											
8000	75	209.3	181.4	236.7	141.3	252.1	88.0	190.7	172.0	215.1	130.1	226.8	78.3						
	80	206.0	206.0	235.7	183.0	253.1	128.5	192.1	192.1	214.2	164.6	227.9	118.0						
	85	219.3	219.3	232.8	210.2	254.0	165.5	204.1	204.1	211.3	211.3	227.6	155.0						
	90	231.9	231.9	232.1	232.1	253.8	203.8	214.7	214.7	214.8	214.8	227.5	186.5						
9000	75	211.5	192.2	240.6	146.8	255.4	90.0	192.6	192.6	218.1	136.7	228.9	80.2						
	80	213.2	213.2	239.0	186.0	256.0	133.7	198.2	198.2	216.8	172.2	230.6	123.0						
	85	226.6	226.6	234.6	234.6	256.1	175.2	210.0	210.0	212.5	212.5	229.6	164.8						
	90	238.9	238.9	239.1	239.1	255.5	214.3	219.6	219.6	219.7	219.7	227.7	201.5						
10000	75	213.1	213.1	243.6	153.4	257.9	91.9	193.8	193.8	220.2	143.1	230.7	81.9						
	80	219.3	219.3	241.5	189.1	258.7	138.8	203.3	203.3	217.7	185.7	232.4	128.5						
	85	232.7	232.7	235.6	235.6	257.8	184.7	214.7	214.7	214.8	214.8	231.3	166.7						
	90	244.3	244.3	244.5	244.5	255.7	225.8	223.0	223.0	223.1	223.1	227.8	213.1						
11000	75	214.0	214.0	245.8	159.8	260.0	93.8	194.8	194.8	221.8	149.3	232.1	83.7						
	80	224.4	224.4	242.1	205.6	261.6	142.1	207.6	207.6	218.1	194.3	233.9	133.7						
	85	237.6	237.6	237.7	237.7	259.5	185.1	218.3	218.3	218.4	218.4	232.5	181.7						
	90	248.5	248.5	248.6	248.6	255.8	236.2	225.1	225.1	225.2	225.2	228.0	224.7						
12000	75	214.4	214.4	247.5	166.0	261.7	95.6	198.5	198.5	223.0	163.2	233.5	85.5						
	80	228.8	228.8	242.5	214.1	262.9	149.5	211.1	211.1	218.1	218.1	235.1	138.8						
	85	241.7	241.7	241.8	241.8	260.6	201.7	221.0	221.0	221.1	221.1	232.7	188.8						
	90	251.6	251.6	251.6	251.6	255.8	245.3	228.0	228.0	228.0	228.0	228.1	228.1						

Notes:

1. All capacities shown are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat. For indoor fan heat formula, refer to appropriate airflow table notes.
2. MBh = Total gross capacity
3. SHC = Sensible heat capacity

Reheat Temperature Rise

Table 14. Reheat temperature rise — 6 tons

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
Ambient DB 60°F													
1200	60	28.5(a)	32.0(a)	45.9	54.1	32.2(a)	36.9	50.7	56.7	36.3	41.8	55.2	59.0
	65	28.5(a)	32.0(a)	45.9	54.2	32.2(a)	36.9	50.7	56.7	36.4	41.8	55.2	59.0
	70	28.5(a)	32.2(a)	45.8	54.2	32.2(a)	36.9	50.6	56.7	36.3	41.8	55.1	59.0
	75	30.1(a)	36.4	47.7	56.3	32.2(a)	37.1	50.6	56.7	36.3	41.8	55.1	59.1
1440	60	31.5(a)	33.9(a)	46.6	54.8	35.2	38.9	51.3	57.4	39.2	44.0	56.0	60.0
	65	31.6(a)	34.0(a)	46.7	54.9	35.3	39.0	51.3	57.4	39.3	43.9	56.0	59.9
	70	31.9(a)	35.8	47.0	55.7	35.4	39.0	51.4	57.5	39.3	43.9	56.1	60.0
	75	34.6(a)	40.1	50.1	57.9	35.4	40.2	51.4	58.0	39.4	44.0	56.1	60.0
1680	60	33.9(a)	35.5	47.2	55.2	37.7	40.5	51.9	57.9	41.5	45.6	56.6	60.7
	65	34.0(a)	35.7	47.3	55.3	37.8	40.6	52.0	58.0	41.6	45.5	56.6	60.6
	70	35.4	38.7	48.7	56.9	37.9	40.6	52.1	58.0	41.7	45.6	56.7	60.7
	75	38.3	43.2	52.2	59.3	38.4	43.3	52.4	59.3	41.8	45.7	56.8	60.7
1920	60	35.8	36.8	47.8	55.7	39.6	41.7	52.5	58.4	43.6	46.8	57.1	61.1
	65	36.0	37.0	48.0	55.7	39.8	41.9	52.6	58.5	43.5	46.7	57.0	61.1
	70	38.3	41.1	50.4	57.9	39.9	42.1	52.7	58.5	43.6	46.9	57.1	61.2
	75	41.3	45.8	53.9	60.4	41.4	45.9	54.0	60.5	43.8	47.1	57.3	61.3
2160	60	37.4	37.0	48.3	56.1	41.2	42.8	52.9	58.7	45.1	47.8	57.4	61.5
	65	38.0	38.6	48.7	56.2	41.4	43.0	53.0	58.8	45.0	47.8	57.4	61.5
	70	40.8	43.2	51.9	58.7	41.7	43.7	53.2	59.1	45.2	48.0	57.5	61.6
	75	43.8	48.0	55.4	61.4	43.9	48.2	55.5	61.5	45.4	48.7	57.7	61.8
2400	60	38.8	38.9	48.7	56.0	42.5	43.6	53.2	58.9	46.3	48.6	57.7	61.7
	65	39.5	40.0	49.3	56.6	42.7	43.9	53.4	59.0	46.3	48.6	57.7	61.7
	70	42.9	45.0	53.2	59.4	43.4	44.8	53.9	59.4	46.5	48.9	57.8	61.8
	75	45.9	50.0	56.6	62.2	46.0	50.1	56.7	62.3	46.9	49.8	58.1	62.2
2640	60	39.9	39.8	49.1	55.9	43.5	44.4	53.5	59.0	47.4	49.3	57.9	61.9
	65	41.3	41.5	50.4	57.0	43.8	44.7	53.7	59.2	47.4	49.4	57.9	61.9
	70	44.7	46.6	54.2	60.1	44.6	46.7	54.3	60.1	47.7	49.7	58.1	62.0
	75	47.8	51.7	57.7	62.9	47.8	51.8	57.8	63.0	48.4	51.9	58.6	63.1
2880	60	40.8	40.6	49.3	55.7	44.4	45.1	53.7	59.1	48.3	49.8	58.1	61.9
	65	42.8	42.9	51.2	57.4	44.8	45.5	53.9	59.3	48.4	50.1	58.1	62.0
	70	46.2	48.1	55.2	60.6	45.7	48.2	54.7	60.6	48.7	50.4	58.3	62.2
	75	49.4	53.2	58.7	63.6	49.5	53.3	58.8	63.6	49.5	53.5	59.0	63.7
Ambient DB 65°F													
1200	60	29.0(a)	31.4(a)	46.4	56.4	32.6(a)	36.4	51.1	59.0	36.5	41.4	56.1	61.5
	65	29.0(a)	31.5(a)	46.4	56.4	32.6(a)	36.4	51.0	59.0	36.6	41.4	56.2	61.5
	70	29.0(a)	31.7(a)	46.3	56.4	32.6(a)	36.5	51.0	59.0	36.5	41.4	56.0	61.5
	75	30.8(a)	35.6	48.5	58.5	32.6(a)	36.4	51.0	59.0	36.5	41.4	56.0	61.5



Reheat Temperature Rise

Table 14. Reheat temperature rise — 6 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
1440	60	32.0 ^(a)	33.2 ^(a)	47.0	56.9	35.7	38.3	51.8	59.7	39.5	43.5	56.6	62.4
	65	32.1 ^(a)	33.3 ^(a)	47.1	56.9	35.8	38.4	51.8	59.7	39.6	43.4	56.6	62.4
	70	32.4 ^(a)	34.8 ^(a)	47.4	57.6	35.9	38.5	51.8	59.8	39.6	43.4	56.6	62.4
	75	35.3	39.1	50.9	60.0	35.9	38.9	51.9	59.9	39.7	43.5	56.7	62.4
1680	60	34.3 ^(a)	34.7 ^(a)	47.7	57.4	38.2	39.8	52.4	60.3	42.0	45.0	57.2	63.1
	65	34.5 ^(a)	34.9 ^(a)	47.7	57.4	38.3	39.9	52.5	60.3	42.0	44.9	57.2	63.0
	70	36.1	37.5	49.4	58.8	38.4	40.1	52.6	60.4	42.1	45.0	57.3	63.1
	75	39.0	42.1	53.0	61.3	38.9	42.2	53.0	61.4	42.2	45.1	57.3	63.1
1920	60	36.3	36.1	48.3	57.2	40.1	41.0	52.9	60.7	44.1	46.2	57.8	63.5
	65	36.5	36.3	48.4	57.3	40.2	41.2	53.0	60.7	44.0	46.1	57.7	63.5
	70	39.0	39.8	51.1	59.8	40.4	41.4	53.1	60.8	44.2	46.3	57.8	63.5
	75	42.0	44.5	54.8	62.4	42.1	44.7	54.9	62.5	44.4	46.5	57.9	63.6
2160	60	37.8	37.5	48.7	56.8	41.6	42.0	53.3	60.9	45.6	47.1	58.1	63.8
	65	38.4	38.1	49.1	57.2	41.7	42.2	53.4	61.0	45.5	47.1	58.0	63.8
	70	41.4	41.8	52.5	60.5	42.2	42.8	53.7	61.2	45.7	47.3	58.2	63.9
	75	44.5	46.7	56.2	63.3	44.6	46.8	56.3	63.4	46.0	47.9	58.3	64.1
2400	60	39.1	38.7	49.0	56.5	42.8	42.9	53.5	60.9	46.8	47.9	58.3	64.0
	65	39.9	39.5	49.7	57.0	43.0	43.2	53.7	61.0	46.8	48.0	58.3	64.0
	70	43.4	43.6	53.7	61.1	43.7	44.0	54.2	61.4	47.0	48.2	58.4	64.1
	75	46.7	48.6	57.5	64.1	46.8	48.7	57.6	64.1	47.3	49.0	58.6	64.4
2640	60	40.2	39.8	49.3	56.1	43.8	43.7	53.7	60.7	47.8	48.6	58.4	64.0
	65	41.8	41.2	50.8	57.3	44.1	44.0	54.0	60.9	47.9	48.7	58.5	64.1
	70	45.2	45.2	54.7	61.5	45.0	45.0	54.7	61.5	48.1	49.0	58.7	64.2
	75	48.5	50.2	58.6	64.7	48.6	50.4	58.7	64.7	48.9	50.0	59.2	64.6
2880	60	41.1	40.7	49.6	55.8	44.7	44.5	53.9	60.5	48.7	49.2	58.6	64.1
	65	43.3	42.7	51.7	57.7	45.1	44.9	54.2	60.7	48.8	49.4	58.6	64.1
	70	46.7	46.6	55.6	62.0	46.8	46.7	55.7	62.0	49.1	49.7	58.8	64.3
	75	50.1	51.7	59.6	65.2	50.2	51.8	59.6	65.3	50.0	52.0	59.6	65.4
Ambient DB 70°F													
1200	60	29.5 ^(a)	30.9 ^(a)	46.9	58.4	33.2 ^(a)	36.0	51.7	61.3	37.0	41.0	56.6	63.9
	65	29.5 ^(a)	30.9 ^(a)	46.8	58.4	33.1 ^(a)	35.9	51.6	61.3	37.1	41.0	56.7	63.9
	70	29.5 ^(a)	31.1 ^(a)	46.8	58.5	33.1 ^(a)	36.0	51.5	61.3	37.0	41.0	56.6	63.9
	75	31.5 ^(a)	34.8 ^(a)	49.2	60.6	33.1 ^(a)	36.0	51.5	61.3	37.0	41.0	56.5	63.9
1440	60	32.5 ^(a)	32.6 ^(a)	47.5	58.7	36.3	37.7	52.3	62.0	40.2	43.0	57.4	64.9
	65	32.5 ^(a)	32.7 ^(a)	47.5	58.7	36.3	37.8	52.3	62.1	40.2	42.8	57.4	64.8
	70	33.0 ^(a)	33.1 ^(a)	48.0	59.0	36.4	37.9	52.4	62.1	40.3	42.9	57.4	64.8
	75	36.0	38.1	51.6	62.1	36.4	38.3	52.4	62.3	40.3	43.0	57.4	64.9
1680	60	34.8 ^(a)	34.5 ^(a)	48.1	58.1	38.6	39.1	52.9	62.5	42.5	44.4	57.8	65.5
	65	34.9 ^(a)	34.6 ^(a)	48.2	58.2	38.7	39.2	53.0	62.6	42.6	44.3	57.8	65.4
	70	36.8	36.5	50.1	60.0	38.9	39.4	53.0	62.6	42.6	44.4	57.9	65.5
	75	39.7	40.9	53.8	63.4	39.6	41.0	53.7	63.5	42.8	44.5	58.0	65.5

Table 14. Reheat temperature rise — 6 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
1920	60	36.7	36.2	48.7	57.4	40.4	40.3	53.3	62.4	44.5	45.5	58.2	65.8
	65	36.9	36.5	48.8	57.7	40.6	40.5	53.4	62.5	44.4	45.4	58.2	65.8
	70	39.6	39.1	51.7	60.5	40.8	40.7	53.5	62.6	44.5	45.6	58.3	65.9
	75	42.6	43.2	55.4	64.3	42.7	43.4	55.5	64.4	44.7	45.8	58.4	65.9
2160	60	38.2	37.7	49.0	56.8	41.9	41.6	53.6	61.9	45.9	46.5	58.5	66.0
	65	38.8	38.3	49.5	57.2	42.1	41.8	53.7	62.1	45.9	46.4	58.4	66.0
	70	41.9	41.4	53.1	61.0	42.5	42.0	54.1	62.2	46.1	46.6	58.6	66.1
	75	45.1	45.3	56.9	65.0	45.2	45.5	57.0	65.1	46.3	47.1	58.7	66.3
2400	60	39.4	38.9	49.4	56.4	43.1	42.7	53.8	61.5	47.1	47.3	58.6	66.0
	65	40.4	39.7	50.2	56.9	43.4	42.9	54.0	61.6	47.1	47.3	58.6	66.0
	70	43.9	43.3	54.2	61.4	44.1	43.7	54.6	62.1	47.4	47.6	58.8	66.1
	75	47.2	47.2	58.1	65.5	47.3	47.3	58.2	65.6	48.0	48.3	59.2	66.5
2640	60	40.5	40.0	49.6	56.2	44.1	43.7	54.0	61.0	48.1	48.0	58.7	65.8
	65	42.3	41.6	51.3	57.5	44.4	44.0	54.2	61.2	48.2	48.0	58.8	65.8
	70	45.7	45.0	55.2	61.8	45.5	44.8	55.1	61.8	48.5	48.4	59.0	66.0
	75	49.0	48.9	59.2	66.0	49.1	49.0	59.2	66.1	49.2	49.3	59.6	66.5
2880	60	41.4	41.0	49.8	55.9	45.0	44.6	54.2	60.6	49.0	48.7	58.8	65.4
	65	43.7	43.1	52.1	57.9	45.3	44.9	54.4	60.8	49.1	48.8	58.9	65.5
	70	47.2	46.5	56.1	62.2	47.2	46.6	56.2	62.3	49.4	49.2	59.1	65.7
	75	50.6	50.4	60.1	66.4	50.7	50.5	60.2	66.5	50.6	50.2	60.2	66.4

Note: MIN, MAX: The leaving evaporator temperature is affected by the modulating valve position. The MIN and MAX numbers represent modulating valve position impact on both the leaving evaporator temperature and the leaving reheat coil temperature. MAX represents wide open, MIN represents closed to minimum position.

(a) The unit might be tripped by Froststat at these conditions due to low leaving evaporator air temperature.

Table 15. Reheat temperature rise — 7.5 tons

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
Ambient DB 60°F													
1500	60	29.5 ^(a)	32.9 ^(a)	46.1	55.0	33.1 ^(a)	38.0	50.7	57.8	36.7	43.2	55.0	60.6
	65	29.7 ^(a)	33.0 ^(a)	46.2	55.1	33.0 ^(a)	38.1	50.6	57.8	36.9	43.1	55.2	60.5
	70	29.7 ^(a)	34.1 ^(a)	46.2	55.5	33.2 ^(a)	38.3	50.7	57.9	36.8	43.2	55.1	60.6
	75	31.9 ^(a)	38.7	48.7	58.0	33.3 ^(a)	38.7	50.7	58.1	36.9	43.4	55.1	60.6
1800	60	32.5 ^(a)	34.8 ^(a)	47.0	55.7	36.1	39.8	51.6	58.5	39.8	45.1	56.0	61.3
	65	32.7 ^(a)	35.0	47.1	55.8	36.3	40.1	51.7	58.6	39.9	45.0	56.0	61.2
	70	33.3 ^(a)	37.6	47.7	57.1	36.5	40.3	51.8	58.7	40.0	45.2	56.1	61.3
	75	36.4	42.3	51.2	59.7	37.0	42.5	52.2	59.7	40.2	45.4	56.2	61.4
2100	60	34.8 ^(a)	36.3	47.7	56.2	38.5	41.3	52.3	58.9	42.2	46.5	56.7	61.7
	65	35.1	36.8	47.9	56.4	38.7	41.6	52.4	59.1	42.3	46.5	56.8	61.7
	70	37.0	40.4	49.8	58.2	39.0	42.0	52.6	59.2	42.5	46.8	56.9	61.9
	75	40.0	45.4	53.3	60.9	39.8	45.5	53.3	61.0	42.8	47.1	57.1	62.0



Reheat Temperature Rise

Table 15. Reheat temperature rise — 7.5 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
2400	60	36.7	37.5	48.3	56.4	40.3	42.4	52.8	59.2	44.2	47.6	57.4	62.0
	65	37.4	38.3	48.8	56.8	40.6	42.8	53.0	59.4	44.2	47.6	57.3	62.0
	70	39.8	42.8	51.4	59.2	41.0	43.6	53.2	59.7	44.5	48.0	57.5	62.2
	75	42.9	48.0	55.0	62.0	43.0	48.1	55.1	62.0	44.8	48.8	57.7	62.5
2700	60	38.3	38.6	48.7	56.5	41.8	43.4	53.1	59.4	45.7	48.5	57.7	62.2
	65	39.1	39.6	49.4	57.0	42.2	43.9	53.4	59.6	45.7	48.6	57.7	62.2
	70	42.2	44.9	52.8	59.9	42.9	44.9	54.0	60.0	46.1	49.1	57.9	62.4
	75	45.3	50.2	56.4	62.8	45.4	50.3	56.5	62.9	46.6	50.1	58.3	62.9
3000	60	39.5	39.6	49.1	56.4	43.1	44.3	53.4	59.5	46.9	49.3	57.9	62.3
	65	40.6	40.8	50.0	57.1	43.5	44.8	53.8	59.7	47.0	49.5	58.0	62.4
	70	44.2	46.7	54.0	60.5	44.4	46.0	54.5	60.2	47.4	50.0	58.3	62.6
	75	47.4	52.1	57.6	63.6	47.4	52.3	57.7	63.6	48.2	52.4	58.9	63.7
3300	60	40.6	40.5	49.4	56.3	44.1	45.1	53.7	59.6	47.9	49.9	58.1	62.4
	65	42.5	42.8	51.1	57.8	44.6	45.6	54.0	59.8	48.1	50.3	58.2	62.5
	70	45.9	48.3	55.0	61.1	45.7	48.4	54.9	61.1	48.5	50.8	58.5	62.7
	75	49.1	53.8	58.7	64.2	49.2	53.9	58.8	64.3	49.5	54.0	59.3	64.3
3600	60	41.5	41.3	49.7	56.1	45.0	45.7	53.9	59.6	48.8	50.3	58.3	62.3
	65	43.9	44.2	52.0	58.1	45.5	46.3	54.3	59.8	49.0	50.9	58.4	62.6
	70	47.4	49.7	55.9	61.6	47.5	49.8	56.0	61.6	49.5	51.8	58.8	63.0
	75	50.7	55.3	59.6	64.8	50.8	55.4	59.7	64.8	50.7	55.5	59.7	64.9
Ambient DB 65°F													
1500	60	29.9 ^(a)	32.0 ^(a)	46.6	57.3	33.6 ^(a)	37.2	51.4	60.1	37.2	42.5	56.0	62.9
	65	30.1 ^(a)	32.1 ^(a)	46.7	57.3	33.5 ^(a)	37.3	51.3	60.1	37.4	42.4	56.2	62.9
	70	30.4 ^(a)	32.6 ^(a)	47.0	57.6	33.7 ^(a)	37.4	51.4	60.2	37.3	42.5	56.1	62.9
	75	32.4 ^(a)	37.3	49.4	60.0	33.8 ^(a)	37.9	51.5	60.4	37.5	42.7	56.1	63.0
1800	60	32.9 ^(a)	33.7 ^(a)	47.4	57.8	36.5	38.9	52.1	60.7	40.3	44.3	56.9	63.6
	65	33.1 ^(a)	33.9 ^(a)	47.6	57.9	36.7	39.1	52.2	60.8	40.4	44.2	57.0	63.6
	70	33.7 ^(a)	35.9	48.2	58.9	36.9	39.4	52.4	60.9	40.5	44.4	57.1	63.7
	75	36.9	40.7	51.9	61.5	37.4	40.8	52.8	61.6	40.7	44.6	57.2	63.7
2100	60	35.2	35.2	48.1	57.9	38.8	40.3	52.7	61.1	42.9	45.7	57.7	64.0
	65	35.5	35.6	48.3	58.1	39.1	40.6	52.9	61.2	42.8	45.6	57.6	64.0
	70	37.5	38.6	50.4	59.9	39.3	40.9	53.1	61.4	43.0	45.9	57.8	64.1
	75	40.4	43.6	54.0	62.7	40.2	43.8	53.8	62.8	43.3	46.2	57.9	64.2
2400	60	37.0	36.7	48.6	57.6	40.6	41.5	53.2	61.3	44.5	46.7	57.9	64.2
	65	37.7	37.4	49.2	58.1	41.0	41.8	53.4	61.5	44.6	46.8	58.0	64.3
	70	40.3	41.0	52.0	60.7	41.3	42.6	53.6	61.8	44.9	47.1	58.2	64.4
	75	43.4	46.1	55.7	63.6	43.5	46.3	55.8	63.7	45.2	47.9	58.4	64.7
2700	60	38.5	38.1	49.1	57.3	42.1	42.5	53.5	61.3	46.1	47.7	58.3	64.4
	65	39.4	39.0	49.8	57.9	42.5	42.9	53.8	61.6	46.1	47.7	58.3	64.4
	70	42.6	43.0	53.3	61.3	43.3	43.8	54.4	62.0	46.5	48.2	58.6	64.6
	75	45.8	48.3	57.1	64.4	45.9	48.4	57.2	64.5	46.9	49.1	58.8	65.0

Table 15. Reheat temperature rise — 7.5 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
3000	60	39.8	39.3	49.4	56.9	43.4	43.4	53.8	61.2	47.3	48.4	58.5	64.4
	65	40.9	40.4	50.3	57.7	43.8	43.9	54.1	61.5	47.4	48.6	58.5	64.5
	70	44.6	44.8	54.5	61.8	44.7	45.0	54.9	62.1	47.8	49.1	58.8	64.7
	75	47.9	50.2	58.4	65.1	48.0	50.3	58.5	65.1	48.7	50.2	59.5	65.2
3300	60	40.9	40.4	49.7	56.7	44.4	44.2	54.0	61.1	48.3	49.1	58.6	64.4
	65	42.9	42.2	51.6	58.1	44.9	44.7	54.4	61.3	48.5	49.4	58.7	64.5
	70	46.3	46.4	55.5	62.3	46.1	46.3	55.4	62.2	48.9	49.9	59.1	64.8
	75	49.7	51.8	59.4	65.6	49.8	51.9	59.5	65.7	50.0	52.1	59.9	65.8
3600	60	41.8	41.3	50.0	56.4	45.3	45.0	54.2	60.8	49.1	49.7	58.8	64.3
	65	44.3	43.7	52.4	58.4	45.8	45.5	54.6	61.2	49.4	50.0	58.9	64.5
	70	47.8	47.9	56.4	62.7	47.9	48.0	56.5	62.7	49.9	50.5	59.3	64.8
	75	51.3	53.3	60.4	66.1	51.4	53.4	60.5	66.2	51.1	53.5	60.2	66.2
Ambient DB 70°F													
1500	60	30.3 ^(a)	31.1 ^(a)	47.1	59.4	34.0 ^(a)	36.3	52.0	62.3	37.7	41.8	56.9	65.3
	65	30.4 ^(a)	31.2 ^(a)	47.2	59.4	33.9 ^(a)	36.4	51.9	62.4	37.9	41.6	57.0	65.2
	70	30.8 ^(a)	31.7 ^(a)	47.5	59.7	34.1 ^(a)	36.6	52.0	62.4	37.9	41.7	57.0	65.2
	75	33.0 ^(a)	35.8	50.1	61.9	34.2 ^(a)	37.0	52.0	62.6	38.0	41.9	57.0	65.3
1800	60	33.2 ^(a)	33.0 ^(a)	47.9	59.2	36.9	38.0	52.6	62.9	40.7	43.5	57.6	65.9
	65	33.4 ^(a)	33.2 ^(a)	48.0	59.3	37.1	38.2	52.7	63.0	40.8	43.4	57.6	65.8
	70	34.3 ^(a)	33.8 ^(a)	48.8	59.8	37.3	38.4	52.8	63.1	41.0	43.6	57.7	65.9
	75	37.4	39.1	52.6	63.3	37.8	39.1	53.3	63.4	41.2	43.8	57.8	66.0
2100	60	35.5	34.9 ^(a)	48.5	58.5	39.2	39.4	53.2	63.0	43.2	44.8	58.2	66.2
	65	35.8	35.2	48.7	58.7	39.4	39.7	53.3	63.2	43.2	44.7	58.1	66.2
	70	38.0	37.4	50.9	60.7	39.7	40.0	53.5	63.3	43.4	45.0	58.3	66.3
	75	41.0	41.9	54.6	64.3	40.7	42.0	54.4	64.4	43.6	45.3	58.4	66.5
2400	60	37.3	36.7	49.0	58.0	41.0	40.6	53.6	62.7	45.0	45.9	58.5	66.4
	65	38.0	37.4	49.5	58.4	41.3	41.0	53.8	62.9	45.0	45.9	58.5	66.4
	70	40.8	40.0	52.5	61.2	41.8	41.6	54.2	63.3	45.3	46.2	58.7	66.6
	75	43.9	44.3	56.3	65.1	44.0	44.5	56.4	65.2	45.6	46.8	58.9	66.8
2700	60	38.8	38.3	49.4	57.7	42.4	41.9	53.9	62.3	46.4	46.8	58.7	66.4
	65	39.7	39.1	50.1	58.2	42.8	42.3	54.1	62.5	46.5	46.8	58.7	66.4
	70	43.1	42.3	53.9	61.7	43.6	43.1	54.8	63.1	46.8	47.3	59.0	66.6
	75	46.3	46.5	57.7	65.7	46.4	46.6	57.8	65.8	47.5	48.2	59.5	67.0
3000	60	40.1	39.5	49.7	57.3	43.6	43.1	54.1	61.9	47.6	47.6	58.9	66.2
	65	41.3	40.6	50.8	58.0	44.1	43.5	54.4	62.2	47.7	47.8	58.9	66.3
	70	45.1	44.3	55.0	62.2	45.0	44.5	55.2	62.8	48.1	48.2	59.2	66.5
	75	48.4	48.4	59.0	66.3	48.5	48.5	59.0	66.4	49.0	49.3	59.9	67.1
3300	60	41.1	40.6	50.0	57.0	44.7	44.1	54.3	61.6	48.6	48.4	59.0	66.0
	65	43.3	42.5	52.0	58.5	45.1	44.6	54.7	61.9	48.8	48.6	59.1	66.1
	70	46.8	46.0	56.0	62.7	46.7	45.7	56.0	62.7	49.2	49.1	59.4	66.4
	75	50.2	50.1	60.0	66.7	50.3	50.2	60.1	66.8	50.3	50.3	60.3	67.0

Reheat Temperature Rise

Table 15. Reheat temperature rise — 7.5 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
3600	60	42.0	41.5	50.2	56.7	45.6	45.0	54.5	61.3	49.4	49.1	59.1	65.9
	65	44.7	43.9	52.8	58.9	46.0	45.5	54.9	61.6	49.7	49.3	59.2	66.0
	70	48.2	47.5	56.9	63.1	48.3	47.5	57.0	63.2	50.1	49.8	59.6	66.3
	75	51.8	51.6	61.0	67.2	51.9	51.7	61.0	67.3	51.8	51.2	61.0	67.0

Note: MIN, MAX: The leaving evaporator temperature is affected by the modulating valve position. The MIN and MAX numbers represent modulating valve position impact on both the leaving evaporator temperature and the leaving reheat coil temperature. MAX represents wide open, MIN represents closed to minimum position.

(a) The unit might be tripped by Froststat at these conditions due to low leaving evaporator air temperature.

Table 16. Reheat temperature rise — 8.5 tons

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
Ambient DB 60°F													
1700	60	29.0(a)	32.9(a)	45.5	51.9	32.7(a)	37.7	49.7	54.6	37.2	42.5	52.8	57.2
	65	29.2(a)	33.2(a)	45.7	52.0	32.8(a)	37.8	49.7	54.6	37.4	42.6	52.9	57.3
	70	29.4(a)	33.9(a)	45.8	52.4	33.0(a)	38.1	49.9	54.8	37.4	42.8	52.9	57.4
	75	31.4(a)	38.4	47.9	54.8	33.2(a)	38.7	50.0	55.0	37.6	43.1	53.0	57.5
2040	60	32.0(a)	35.2	46.4	52.6	35.7	39.9	50.7	55.3	40.1	44.9	53.9	58.1
	65	32.3(a)	35.5	46.6	52.8	35.8	40.3	50.8	55.4	40.2	44.9	54.0	58.0
	70	33.0(a)	38.2	47.3	54.1	36.2	40.6	51.0	55.6	40.4	45.2	54.1	58.2
	75	35.9	42.6	50.4	56.6	36.8	42.7	51.4	56.7	40.8	45.3	54.3	58.3
2380	60	34.3(a)	37.1	47.1	53.1	37.9	41.7	51.3	55.7	42.3	46.6	54.7	58.5
	65	34.7(a)	37.8	47.4	53.4	38.3	42.1	51.6	55.9	42.5	46.6	54.8	58.5
	70	36.3	41.4	48.9	55.4	38.6	42.8	51.8	56.3	42.9	47.0	55.0	58.8
	75	39.5	46.0	52.3	58.0	39.6	46.1	52.5	58.1	43.2	47.4	55.2	58.9
2720	60	36.2	38.5	47.7	53.4	39.8	43.0	51.9	56.0	44.3	47.9	55.4	58.8
	65	36.8	39.5	48.2	53.8	40.2	43.6	52.2	56.3	44.3	48.0	55.4	58.9
	70	39.3	44.1	50.7	56.4	40.6	44.5	52.5	56.7	44.8	48.5	55.7	59.2
	75	42.6	48.8	53.9	59.2	41.8	48.9	53.4	59.2	45.2	49.4	55.9	59.6
3060	60	37.8	39.8	48.2	53.6	41.3	44.2	52.3	56.3	45.7	48.9	55.8	59.1
	65	38.7	41.1	49.0	54.2	41.8	44.8	52.7	56.6	45.8	49.3	55.9	59.2
	70	41.7	46.3	52.0	57.3	42.6	45.9	53.3	57.1	46.3	49.7	56.2	59.5
	75	45.3	51.2	55.2	60.2	45.4	51.3	55.3	60.2	46.9	50.8	56.5	60.0
3400	60	39.1	40.8	48.7	53.7	42.5	45.3	52.7	56.5	46.9	49.8	56.2	59.2
	65	40.2	43.2	49.6	55.0	43.1	45.8	53.1	56.7	47.1	50.2	56.3	59.4
	70	43.7	48.2	53.2	58.1	44.2	48.3	53.9	58.1	47.7	50.7	56.6	59.7
	75	47.6	53.2	56.3	61.0	47.7	53.3	56.4	61.1	48.8	53.4	57.2	61.1
3740	60	40.2	41.7	49.0	53.8	43.6	46.1	53.0	56.6	47.9	50.4	56.4	59.2
	65	41.6	44.8	50.2	55.6	44.2	46.7	53.5	56.9	48.2	51.0	56.7	59.6
	70	45.4	49.9	54.2	58.7	45.5	50.0	54.4	58.8	48.8	51.7	57.0	60.0
	75	49.6	54.9	57.3	61.8	49.7	55.0	57.4	61.8	50.1	55.1	57.7	61.9

Table 16. Reheat temperature rise — 8.5 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
4080	60	41.2	42.5	49.4	53.9	44.6	46.8	53.3	56.7	48.7	51.0	56.7	59.3
	65	43.4	46.2	51.3	56.1	45.2	47.7	53.8	57.2	49.1	51.7	56.9	59.7
	70	47.0	51.4	55.0	59.3	46.6	51.4	54.8	59.3	49.8	52.7	57.3	60.2
	75	51.4	56.5	58.2	62.5	51.5	56.5	58.3	62.5	51.2	56.6	58.1	62.6
Ambient DB 65°F													
1700	60	29.3 ^(a)	32.2 ^(a)	45.8	54.1	32.9 ^(a)	37.1	50.5	56.8	36.8	41.9	54.7	59.5
	65	29.5 ^(a)	32.4 ^(a)	46.0	54.2	32.9 ^(a)	37.2	50.5	56.9	37.0	42.1	54.9	59.6
	70	29.7 ^(a)	33.0 ^(a)	46.1	54.5	33.2 ^(a)	37.1	50.6	56.8	37.0	42.2	54.8	59.6
	75	31.7 ^(a)	37.3	48.4	56.8	33.3 ^(a)	38.0	50.8	57.3	37.2	42.5	55.0	59.8
2040	60	32.3 ^(a)	34.4 ^(a)	46.8	54.7	35.8	39.2	51.2	57.4	39.7	44.3	55.6	60.3
	65	32.6 ^(a)	34.4 ^(a)	47.0	54.7	36.0	39.6	51.3	57.6	39.9	44.3	55.7	60.2
	70	33.3 ^(a)	36.9	47.6	56.0	36.3	39.5	51.6	57.6	40.0	44.6	55.8	60.4
	75	36.2	41.4	50.9	58.5	36.9	41.5	52.1	58.6	40.4	44.9	56.0	60.5
2380	60	34.7 ^(a)	36.2	47.5	55.1	38.1	40.9	51.8	57.8	42.0	45.9	56.2	60.7
	65	35.0	36.6	47.8	55.3	38.4	41.3	52.1	58.0	42.2	46.0	56.4	60.7
	70	36.9	40.1	49.5	57.1	38.8	41.7	52.3	58.2	42.5	46.4	56.6	60.9
	75	39.7	44.7	52.9	59.8	39.7	44.9	53.1	59.9	42.8	46.8	56.8	61.0
2720	60	36.6	37.7	48.1	55.3	40.0	42.3	52.3	58.1	44.0	47.2	56.9	60.9
	65	37.0	38.6	48.4	55.8	40.4	42.8	52.6	58.3	44.0	47.3	56.9	60.9
	70	39.7	42.7	51.2	58.1	40.8	43.7	53.0	58.7	44.4	47.9	57.2	61.2
	75	42.7	47.5	54.6	60.8	42.8	47.6	54.7	60.9	44.8	48.7	57.4	61.6
3060	60	38.1	38.9	48.6	55.5	41.5	43.4	52.8	58.2	45.4	48.3	57.2	61.1
	65	39.1	40.0	49.4	56.0	42.0	44.0	53.1	58.5	45.5	48.5	57.2	61.1
	70	42.1	44.9	52.6	58.8	42.8	45.1	53.8	59.0	46.0	49.1	57.6	61.4
	75	45.1	49.8	56.1	61.7	45.2	50.0	56.2	61.8	46.5	50.1	57.9	62.0
3400	60	39.4	40.0	49.0	55.5	42.8	44.4	53.1	58.3	46.6	49.1	57.5	61.2
	65	40.5	41.2	50.0	56.1	43.3	45.0	53.5	58.6	46.8	49.5	57.5	61.3
	70	44.0	46.8	53.7	59.5	44.3	46.8	54.3	59.5	47.3	50.1	58.0	61.6
	75	47.2	51.9	57.3	62.5	47.3	52.0	57.4	62.6	48.3	51.3	58.7	62.2
3740	60	40.5	40.9	49.4	55.5	43.9	45.3	53.5	58.4	47.6	49.9	57.7	61.2
	65	42.1	43.4	50.7	56.9	44.5	45.9	53.9	58.7	47.8	50.4	57.8	61.4
	70	45.6	48.5	54.6	60.1	45.6	48.6	54.8	60.1	48.5	50.9	58.3	61.7
	75	49.0	53.6	58.3	63.2	49.1	53.7	58.4	63.2	49.6	53.8	59.1	63.3
4080	60	41.5	41.7	49.7	55.5	44.9	46.1	53.7	58.4	48.5	50.4	57.8	61.1
	65	43.8	44.8	51.8	57.3	45.4	46.7	54.2	58.7	48.8	51.1	58.1	61.5
	70	47.1	50.0	55.5	60.6	47.0	50.1	55.5	60.7	49.4	52.0	58.5	62.0
	75	50.6	55.1	59.3	63.8	50.7	55.2	59.3	63.8	50.8	55.3	59.5	63.9
Ambient DB 70°F													
1700	60	29.6 ^(a)	31.4 ^(a)	46.3	56.3	33.3 ^(a)	36.4	51.0	59.0	36.9	41.4	55.6	61.8
	65	29.9 ^(a)	31.7 ^(a)	46.4	56.4	33.3 ^(a)	36.5	51.0	59.1	37.1	41.5	55.8	61.8
	70	30.0 ^(a)	32.3 ^(a)	46.6	56.7	33.5 ^(a)	36.8	51.1	59.2	37.1	41.6	55.7	61.9
	75	32.2 ^(a)	36.2	49.0	58.8	33.7 ^(a)	37.3	51.2	59.5	37.3	41.9	55.9	62.0



Reheat Temperature Rise

Table 16. Reheat temperature rise — 8.5 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
2040	60	32.7 ^(a)	33.6 ^(a)	47.2	56.8	36.2	38.5	51.8	59.6	39.9	43.7	56.3	62.5
	65	32.9 ^(a)	33.9 ^(a)	47.4	56.9	36.4	38.8	51.9	59.8	40.0	43.6	56.4	62.5
	70	33.7 ^(a)	34.9 ^(a)	48.1	57.5	36.7	39.1	52.1	59.9	40.2	44.0	56.5	62.6
	75	36.7	40.2	51.6	60.4	37.3	40.0	52.7	60.3	40.5	43.9	56.8	62.6
2380	60	34.9 ^(a)	35.3	47.9	57.0	38.5	40.2	52.4	59.9	42.2	45.3	56.8	62.8
	65	35.3	35.8	48.1	57.2	38.9	40.6	52.6	60.1	42.4	45.3	57.0	62.8
	70	37.3	38.7	50.1	58.8	39.2	40.8	52.9	60.2	42.7	45.7	57.2	63.0
	75	40.3	43.4	53.7	61.5	40.1	43.5	53.7	61.6	43.0	45.8	57.5	63.0
2720	60	36.8	36.9	48.5	56.9	40.4	41.5	52.9	60.1	44.3	46.6	57.5	63.0
	65	37.6	37.7	49.1	57.4	40.8	42.0	53.2	60.3	44.3	46.6	57.5	63.0
	70	40.1	41.3	51.7	59.7	41.3	42.8	53.6	60.7	44.6	47.2	57.7	63.3
	75	43.2	46.1	55.4	62.5	43.3	46.3	55.5	62.6	45.0	48.0	58.0	63.7
3060	60	38.4	38.3	49.0	56.7	41.8	42.7	53.2	60.1	45.7	47.6	57.8	63.1
	65	39.3	39.3	49.7	57.4	42.3	43.2	53.6	60.4	45.8	47.8	57.8	63.1
	70	42.4	43.5	53.1	60.3	43.2	44.3	54.3	60.9	46.3	48.3	58.2	63.4
	75	45.6	48.5	56.8	63.3	45.7	48.6	56.9	63.4	46.9	49.4	58.7	63.9
3400	60	39.7	39.5	49.3	56.5	43.1	43.6	53.5	60.1	46.9	48.5	58.1	63.1
	65	40.8	40.7	50.3	57.3	43.6	44.3	54.0	60.5	47.1	48.8	58.1	63.3
	70	44.4	45.4	54.2	60.9	44.7	45.5	54.8	61.1	47.6	49.4	58.5	63.5
	75	47.7	50.5	58.0	64.0	47.8	50.6	58.1	64.1	48.5	50.6	59.2	64.1
3740	60	40.7	40.6	49.7	56.3	44.1	44.6	53.8	60.1	47.9	49.2	58.3	63.1
	65	42.2	41.9	50.9	57.2	44.7	45.2	54.3	60.4	48.2	49.7	58.4	63.3
	70	46.1	47.1	55.2	61.4	46.0	47.0	55.3	61.4	48.7	50.2	58.8	63.6
	75	49.5	52.2	59.0	64.6	49.5	52.3	59.1	64.6	49.8	52.4	59.7	64.7
4080	60	41.7	41.5	49.9	56.1	45.1	45.3	54.0	60.1	48.8	49.9	58.4	63.0
	65	44.1	43.9	52.2	58.1	45.7	46.0	54.5	60.4	49.1	50.4	58.6	63.3
	70	47.6	48.6	56.1	61.9	47.4	48.7	55.9	61.9	49.7	51.0	59.1	63.6
	75	51.0	53.7	59.9	65.1	51.1	53.8	60.0	65.2	51.0	53.9	60.1	65.2

Note: MIN, MAX: The leaving evaporator temperature is affected by the modulating valve position. The MIN and MAX numbers represent modulating valve position impact on both the leaving evaporator temperature and the leaving reheat coil temperature. MAX represents wide open, MIN represents closed to minimum position.

^(a) The unit might be tripped by Froststat at these conditions due to low leaving evaporator air temperature.

Table 17. Reheat temperature rise — 10 tons

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
Ambient DB 60°F													
2000	60	29.8(a)	33.5(a)	45.8	52.6	33.6(a)	38.3	50.2	55.4	37.9	43.4	53.4	58.3
	65	30.1(a)	33.8(a)	46.1	52.8	33.6(a)	38.5	50.2	55.5	38.1	43.3	53.5	58.2
	70	30.7(a)	35.0	46.5	53.4	33.9(a)	38.5	50.4	55.5	38.2	43.5	53.6	58.3
	75	32.7(a)	39.6	48.7	56.0	34.1(a)	39.6	50.5	56.0	38.5	43.8	53.7	58.5

Table 17. Reheat temperature rise — 10 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
2400	60	32.8 ^(a)	35.8	46.8	53.2	36.4	40.5	51.0	55.9	40.7	45.5	54.4	58.8
	65	33.1 ^(a)	36.3	47.0	53.4	36.6	40.9	51.2	56.1	40.9	45.5	54.5	58.8
	70	34.0 ^(a)	39.3	47.8	55.0	37.0	41.2	51.4	56.3	41.2	45.9	54.6	59.0
	75	37.2	43.8	51.2	57.7	37.8	43.9	52.0	57.7	41.6	46.2	54.9	59.1
2800	60	35.1	37.7	47.5	53.6	38.7	42.2	51.7	56.3	42.9	47.1	55.1	59.2
	65	35.5	38.5	47.8	54.0	39.0	42.7	52.0	56.5	43.2	47.2	55.2	59.2
	70	37.6	42.5	49.8	56.2	39.5	43.5	52.3	56.9	43.6	47.7	55.5	59.5
	75	40.8	47.2	53.1	59.0	40.6	47.3	53.1	59.1	44.1	48.5	55.7	59.9
3200	60	36.9	39.1	48.1	53.8	40.5	43.6	52.2	56.5	44.9	48.4	55.7	59.4
	65	37.8	40.2	48.8	54.3	40.9	44.2	52.6	56.8	45.0	48.6	55.8	59.5
	70	40.4	45.2	51.4	57.2	41.5	45.3	52.9	57.4	45.5	49.2	56.1	59.8
	75	43.9	50.0	54.7	60.1	44.0	50.1	54.8	60.2	46.0	50.2	56.4	60.3
3600	60	38.5	40.4	48.6	53.9	41.9	44.7	52.6	56.7	46.3	49.4	56.1	59.5
	65	39.6	42.3	49.5	54.9	42.5	45.4	53.1	57.0	46.5	49.8	56.2	59.8
	70	42.7	47.4	52.7	58.1	43.5	47.5	53.8	58.1	47.1	50.4	56.6	60.0
	75	46.5	52.3	55.9	61.1	46.6	52.4	56.0	61.1	48.1	52.6	57.2	61.2
4000	60	39.8	41.4	49.1	54.0	43.2	45.8	53.0	56.8	47.5	50.1	56.4	59.5
	65	41.0	44.2	50.1	55.6	43.8	46.4	53.5	57.2	47.7	50.8	56.6	59.9
	70	44.7	49.3	53.9	58.8	45.0	49.4	54.3	58.8	48.4	51.4	57.0	60.3
	75	48.8	54.3	57.0	61.9	48.9	54.4	57.1	62.0	49.6	54.5	57.7	62.0
4400	60	40.9	42.3	49.4	54.1	44.2	46.6	53.2	56.9	48.4	50.8	56.6	59.6
	65	42.8	45.7	51.0	56.1	44.9	47.3	53.8	57.3	48.8	51.6	56.9	60.0
	70	46.5	50.9	54.8	59.4	46.3	51.0	54.8	59.5	49.5	52.5	57.3	60.5
	75	50.8	56.0	58.0	62.7	50.9	56.1	58.1	62.7	50.9	56.2	58.2	62.8
4800	60	41.8	43.3	49.7	54.3	45.2	47.3	53.5	57.0	49.2	51.4	56.8	59.7
	65	44.3	47.1	51.9	56.6	45.9	48.3	54.1	57.5	49.7	52.2	57.2	60.1
	70	48.0	52.3	55.6	60.0	47.4	52.4	55.2	60.0	50.4	53.3	57.6	60.7
	75	52.5	57.5	58.9	63.3	52.6	57.6	58.9	63.4	52.1	57.7	58.6	63.4
Ambient DB 65°F													
2000	60	30.1 ^(a)	32.6 ^(a)	46.3	54.7	33.6 ^(a)	37.5	50.8	57.5	37.4	42.4	55.1	60.3
	65	30.4 ^(a)	33.0 ^(a)	46.5	54.8	33.6 ^(a)	37.7	50.8	57.6	37.7	42.6	55.3	60.3
	70	30.9 ^(a)	33.7 ^(a)	47.0	55.2	33.9 ^(a)	38.1	51.0	57.7	37.7	42.8	55.3	60.4
	75	32.9 ^(a)	38.3	49.2	57.8	34.2 ^(a)	38.7	51.2	58.1	38.0	43.1	55.4	60.6
2400	60	33.1 ^(a)	34.9 ^(a)	47.3	55.2	36.5	39.7	51.5	58.0	40.3	44.8	55.9	60.9
	65	33.4 ^(a)	35.3	47.5	55.4	36.7	40.1	51.7	58.2	40.5	44.8	56.1	60.9
	70	34.3 ^(a)	37.8	48.3	56.7	37.1	40.4	52.0	58.3	40.8	45.2	56.2	61.1
	75	37.3	42.4	51.7	59.3	37.8	42.5	52.6	59.4	41.2	45.4	56.5	61.2
2800	60	35.3	36.7	48.0	55.4	38.8	41.4	52.2	58.2	42.6	46.4	56.5	61.2
	65	35.9	37.2	48.4	55.7	39.2	41.9	52.5	58.5	42.8	46.5	56.7	61.2
	70	38.0	41.0	50.4	57.8	39.6	42.3	52.8	58.7	43.2	47.0	57.0	61.4
	75	40.8	45.7	53.7	60.6	40.6	45.9	53.6	60.6	43.6	47.4	57.2	61.6



Reheat Temperature Rise

Table 17. Reheat temperature rise — 10 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
3200	60	37.2	38.2	48.6	55.6	40.7	42.8	52.8	58.4	44.6	47.7	57.1	61.3
	65	38.1	39.2	49.3	56.1	41.1	43.3	53.1	58.7	44.6	47.8	57.2	61.4
	70	40.8	43.6	52.0	58.7	41.7	44.4	53.5	59.2	45.1	48.4	57.5	61.7
	75	43.7	48.5	55.4	61.6	43.8	48.6	55.5	61.6	45.6	49.4	57.8	62.2
3600	60	38.7	39.5	49.0	55.6	42.1	43.9	53.2	58.5	46.0	48.7	57.5	61.4
	65	39.8	40.7	49.9	56.3	42.7	44.6	53.6	58.8	46.1	49.0	57.5	61.5
	70	43.0	45.9	53.3	59.4	43.6	45.8	54.3	59.4	46.7	49.6	57.9	61.9
	75	46.1	50.9	56.8	62.4	46.2	51.0	56.9	62.5	47.6	50.8	58.6	62.5
4000	60	40.0	40.5	49.4	55.7	43.3	44.9	53.5	58.5	47.2	49.6	57.7	61.4
	65	41.3	42.6	50.5	56.8	44.0	45.6	53.9	58.9	47.4	50.0	57.9	61.7
	70	44.9	47.8	54.4	60.0	45.1	47.9	54.8	60.1	48.0	50.6	58.3	62.0
	75	48.2	52.9	58.0	63.2	48.3	53.0	58.1	63.2	49.1	53.1	59.1	63.3
4400	60	41.1	41.4	49.8	55.6	44.4	45.8	53.7	58.6	48.2	50.1	58.0	61.3
	65	43.2	44.3	51.6	57.3	45.1	46.5	54.3	58.9	48.5	50.8	58.2	61.7
	70	46.5	49.4	55.3	60.6	46.4	49.5	55.3	60.7	49.1	51.5	58.6	62.1
	75	50.0	54.6	59.0	63.8	50.1	54.7	59.1	63.9	50.4	54.8	59.5	64.0
4800	60	42.0	42.2	50.0	55.6	45.4	46.5	54.0	58.6	49.0	50.7	58.1	61.3
	65	44.6	45.6	52.4	57.7	46.0	47.4	54.5	59.1	49.4	51.5	58.4	61.8
	70	48.0	50.8	56.2	61.1	48.0	50.9	56.2	61.1	50.1	52.6	58.9	62.3
	75	51.6	56.1	59.9	64.4	51.7	56.2	60.0	64.5	51.6	56.3	59.9	64.5
Ambient DB 70°F													
2000	60	30.3 ^(a)	31.8 ^(a)	46.8	56.8	34.0 ^(a)	36.7	51.5	59.6	37.5	41.7	55.9	62.4
	65	30.6 ^(a)	32.1 ^(a)	47.0	56.9	34.0 ^(a)	36.9	51.5	59.7	37.7	41.9	56.1	62.5
	70	31.2 ^(a)	32.8 ^(a)	47.4	57.3	34.3 ^(a)	37.2	51.7	59.8	37.8	42.1	56.1	62.6
	75	33.4 ^(a)	37.0	49.9	59.6	34.5 ^(a)	37.9	51.8	60.2	38.0	42.4	56.2	62.8
2400	60	33.3 ^(a)	34.0 ^(a)	47.7	57.1	36.8	38.9	52.2	60.0	40.5	44.1	56.7	63.0
	65	33.6 ^(a)	34.4 ^(a)	47.9	57.3	37.1	39.2	52.4	60.2	40.7	44.0	56.8	63.0
	70	34.5 ^(a)	36.4	48.7	58.3	37.5	39.6	52.6	60.4	40.9	44.4	57.0	63.1
	75	37.8	41.0	52.5	61.0	38.2	40.6	53.3	60.9	41.3	44.8	57.2	63.3
2800	60	35.5	35.8	48.3	57.2	39.1	40.6	52.8	60.2	42.8	45.7	57.2	63.2
	65	36.1	36.4	48.7	57.5	39.5	41.0	53.1	60.4	43.0	45.7	57.4	63.2
	70	38.2	39.5	50.8	59.3	39.9	41.5	53.4	60.7	43.4	46.2	57.7	63.4
	75	41.3	44.3	54.5	62.1	41.0	44.4	54.3	62.2	43.8	46.7	57.9	63.7
3200	60	37.4	37.4	48.9	57.1	40.9	41.9	53.3	60.3	44.8	46.9	57.8	63.3
	65	38.3	38.3	49.6	57.6	41.4	42.5	53.6	60.5	44.9	47.1	57.9	63.3
	70	41.0	42.1	52.4	60.1	41.9	43.4	54.0	61.0	45.3	47.6	58.2	63.6
	75	44.2	47.0	56.2	63.0	44.3	47.1	56.3	63.1	45.8	48.6	58.5	64.1
3600	60	38.9	38.8	49.3	56.8	42.4	43.1	53.6	60.3	46.2	48.0	58.1	63.3
	65	40.0	39.9	50.2	57.6	42.9	43.7	54.0	60.6	46.3	48.2	58.2	63.4
	70	43.3	44.3	53.8	60.7	43.9	44.9	54.8	61.2	46.9	48.8	58.6	63.7
	75	46.6	49.3	57.6	63.8	46.7	49.5	57.7	63.9	47.8	50.0	59.3	64.3

Table 17. Reheat temperature rise — 10 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
4000	60	40.2	40.0	49.7	56.6	43.6	44.1	53.9	60.2	47.4	48.8	58.3	63.2
	65	41.5	41.3	50.8	57.5	44.2	44.8	54.4	60.6	47.6	49.3	58.5	63.4
	70	45.2	46.3	54.9	61.3	45.4	46.1	55.3	61.3	48.2	49.9	58.9	63.8
	75	48.6	51.3	58.7	64.5	48.7	51.5	58.8	64.5	49.3	51.2	59.8	64.5
4400	60	41.2	41.0	50.0	56.4	44.6	45.0	54.1	60.2	48.4	49.6	58.5	63.1
	65	43.4	43.2	51.9	58.0	45.3	45.7	54.7	60.5	48.7	50.1	58.7	63.4
	70	46.9	47.9	55.9	61.8	46.7	48.0	55.8	61.8	49.3	50.7	59.2	63.8
	75	50.3	53.1	59.7	65.0	50.4	53.2	59.7	65.1	50.6	53.3	60.2	65.2
4800	60	42.2	41.9	50.3	56.2	45.5	45.7	54.4	60.1	49.2	50.1	58.7	63.0
	65	44.8	44.6	52.7	58.4	46.2	46.5	54.9	60.5	49.6	50.8	58.9	63.4
	70	48.4	49.4	56.8	62.2	48.5	49.5	56.8	62.2	50.3	51.7	59.4	63.9
	75	51.8	54.6	60.5	65.6	51.9	54.7	60.6	65.6	51.7	54.8	60.5	65.7

Note: MIN, MAX: The leaving evaporator temperature is affected by the modulating valve position. The MIN and MAX numbers represent modulating valve position impact on both the leaving evaporator temperature and the leaving reheat coil temperature. MAX represents wide open, MIN represents closed to minimum position.

^(a) The unit might be tripped by Froststat at these conditions due to low leaving evaporator air temperature.

Table 18. Reheat temperature rise — 12.5 tons

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
Ambient DB 60°F													
2500	60	29.7(a)	32.1(a)	45.5	54.3	33.2(a)	36.9	49.9	57.3	36.9	41.8	54.4	60.4
	65	30.0(a)	32.4(a)	45.7	54.5	33.3(a)	37.1	50.0	57.4	37.1	42.0	54.6	60.5
	70	30.5(a)	33.2(a)	46.1	54.8	33.6(a)	37.5	50.2	57.6	37.2	42.2	54.6	60.6
	75	32.5(a)	37.4	48.3	57.3	33.9(a)	38.2	50.4	57.9	37.4	42.6	54.8	60.7
3000	60	32.7(a)	34.4(a)	46.6	54.7	36.2	39.1	50.9	57.8	39.9	44.2	55.4	61.0
	65	33.1(a)	34.8(a)	46.9	54.9	36.4	39.6	51.1	58.0	40.1	44.2	55.5	61.0
	70	34.0(a)	37.0	47.6	56.1	36.8	40.0	51.4	58.2	40.3	44.6	55.7	61.2
	75	37.0	41.5	51.0	58.9	37.6	41.0	52.0	58.7	40.7	45.0	56.0	61.4
3500	60	35.1	36.2	47.4	55.0	38.6	40.9	51.8	58.1	42.2	45.9	56.0	61.3
	65	35.6	36.9	47.8	55.3	39.0	41.4	52.0	58.3	42.4	45.9	56.3	61.3
	70	37.6	40.2	49.6	57.2	39.4	41.9	52.3	58.6	42.8	46.5	56.5	61.6
	75	40.5	44.8	53.0	60.2	40.4	45.0	53.2	60.3	43.3	47.0	56.9	61.8
4000	60	37.0	37.7	48.1	55.1	40.5	42.2	52.4	58.2	44.3	47.1	56.8	61.4
	65	37.9	38.8	48.8	55.7	40.9	42.9	52.7	58.5	44.3	47.3	56.8	61.5
	70	40.4	42.8	51.4	58.2	41.5	43.9	53.1	59.1	44.8	47.9	57.2	61.8
	75	43.4	47.6	54.7	61.3	43.4	47.7	54.8	61.4	45.3	49.0	57.5	62.3
4500	60	38.5	39.0	48.6	55.2	41.9	43.4	52.8	58.3	45.7	48.2	57.1	61.5
	65	39.7	40.4	49.5	55.9	42.5	44.1	53.3	58.7	45.8	48.5	57.2	61.6
	70	42.8	45.1	52.8	59.0	43.5	45.4	54.0	59.3	46.4	49.2	57.7	62.0
	75	45.8	50.0	56.2	62.2	45.9	50.1	56.3	62.3	47.1	50.4	58.2	62.6



Reheat Temperature Rise

Table 18. Reheat temperature rise — 12.5 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
5000	60	39.8	40.2	49.1	55.2	43.2	44.4	53.1	58.4	46.9	49.1	57.4	61.5
	65	41.2	41.7	50.2	56.0	43.8	45.2	53.7	58.8	47.1	49.5	57.6	61.8
	70	44.7	47.0	54.0	59.6	45.0	46.7	54.6	59.5	47.8	50.2	58.1	62.1
	75	47.9	52.0	57.5	63.0	48.0	52.1	57.6	63.0	48.8	51.7	58.9	62.9
5500	60	40.9	41.1	49.5	55.2	44.2	45.3	53.4	58.4	47.9	49.8	57.7	61.5
	65	42.7	43.7	50.9	56.7	45.0	46.1	54.0	58.8	48.2	50.4	57.9	61.9
	70	46.4	48.7	54.9	60.2	46.3	48.8	55.1	60.3	48.9	51.1	58.4	62.2
	75	49.6	53.7	58.6	63.7	49.7	53.8	58.6	63.7	50.2	53.9	59.4	63.8
6000	60	41.9	42.0	49.8	55.2	45.2	46.1	53.7	58.4	48.7	50.3	57.9	61.4
	65	44.3	45.0	52.0	57.1	45.9	46.9	54.3	58.9	49.2	51.1	58.2	61.9
	70	47.8	50.1	55.8	60.8	47.4	50.2	55.5	60.8	49.9	52.1	58.7	62.4
	75	51.2	55.2	59.5	64.3	51.3	55.3	59.6	64.3	51.3	55.4	59.9	64.4
Ambient DB 65°F													
2500	60	30.2 ^(a)	31.3 ^(a)	46.1	56.2	33.8 ^(a)	36.2	50.8	59.4	37.3	41.2	55.2	62.5
	65	30.5 ^(a)	31.7 ^(a)	46.3	56.4	33.9 ^(a)	36.4	50.8	59.5	37.6	41.4	55.5	62.6
	70	31.1 ^(a)	32.4 ^(a)	46.8	56.8	34.2 ^(a)	36.8	51.0	59.6	37.6	41.6	55.5	62.7
	75	33.2 ^(a)	36.2	49.1	59.1	34.5 ^(a)	37.4	51.2	60.0	37.9	42.0	55.6	62.8
3000	60	33.2 ^(a)	33.6 ^(a)	47.1	56.5	36.7	38.4	51.6	59.7	40.4	43.6	56.2	63.0
	65	33.6 ^(a)	34.0 ^(a)	47.4	56.7	37.0	38.8	51.8	59.9	40.6	43.6	56.4	63.0
	70	34.5 ^(a)	35.2	48.2	57.3	37.4	39.2	52.1	60.1	40.8	44.0	56.5	63.2
	75	37.7	40.3	51.8	60.5	38.2	40.2	52.8	60.6	41.2	44.4	56.8	63.4
3500	60	35.5	35.5	47.9	56.5	39.0	40.1	52.3	59.9	42.7	45.2	56.8	63.2
	65	35.9	36.1	48.2	56.8	39.4	40.6	52.6	60.1	43.0	45.3	57.1	63.2
	70	38.2	38.9	50.3	58.6	39.9	41.1	52.9	60.4	43.4	45.8	57.3	63.5
	75	41.2	43.6	53.9	61.7	41.0	43.7	53.9	61.8	43.8	46.3	57.6	63.7
4000	60	37.3	37.1	48.5	56.4	40.8	41.5	52.8	59.9	44.7	46.5	57.5	63.2
	65	38.2	38.1	49.2	57.0	41.3	42.1	53.2	60.2	44.8	46.6	57.6	63.3
	70	40.9	41.6	52.0	59.4	41.8	43.1	53.6	60.7	45.3	47.3	57.9	63.6
	75	44.1	46.3	55.7	62.6	44.2	46.5	55.8	62.7	45.8	48.2	58.3	64.1
4500	60	38.9	38.5	49.0	56.2	42.2	42.7	53.2	59.9	46.1	47.6	57.8	63.2
	65	40.0	39.7	49.9	57.0	42.8	43.4	53.7	60.3	46.3	47.8	57.9	63.3
	70	43.2	43.8	53.3	60.1	43.9	44.6	54.5	60.9	46.9	48.5	58.4	63.7
	75	46.5	48.7	57.1	63.5	46.6	48.8	57.2	63.5	47.8	49.7	59.0	64.3
5000	60	40.1	39.8	49.4	56.0	43.5	43.7	53.5	59.8	47.3	48.4	58.1	63.2
	65	41.5	41.2	50.5	57.0	44.1	44.5	54.1	60.3	47.5	48.8	58.2	63.4
	70	45.2	45.7	54.5	60.7	45.4	45.9	55.0	61.0	48.2	49.5	58.7	63.8
	75	48.5	50.7	58.3	64.2	48.6	50.8	58.4	64.2	49.3	50.9	59.6	64.5
5500	60	41.2	40.8	49.8	55.9	44.5	44.6	53.8	59.7	48.3	49.2	58.3	63.1
	65	43.3	42.8	51.6	57.3	45.2	45.4	54.4	60.2	48.7	49.7	58.5	63.4
	70	46.8	47.4	55.5	61.3	46.7	47.3	55.5	61.2	49.3	50.4	59.0	63.8
	75	50.3	52.4	59.4	64.8	50.4	52.5	59.5	64.8	50.6	52.0	60.0	64.6

Table 18. Reheat temperature rise — 12.5 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
6000	60	42.1	41.8	50.1	55.7	45.5	45.5	54.1	59.7	49.1	49.8	58.4	63.0
	65	44.7	44.3	52.4	57.8	46.2	46.3	54.6	60.2	49.6	50.4	58.7	63.4
	70	48.3	48.9	56.4	61.7	48.1	49.0	56.3	61.8	50.3	51.3	59.3	63.8
	75	51.8	53.9	60.3	65.3	51.9	54.0	60.4	65.4	51.8	54.1	60.4	65.4
Ambient DB 70°F													
2500	60	30.6 ^(a)	30.6 ^(a)	46.7	57.8	34.3 ^(a)	35.5	51.4	61.4	37.9	40.6	56.2	64.6
	65	31.0 ^(a)	31.0 ^(a)	46.9	58.0	34.3 ^(a)	35.7	51.4	61.5	38.1	40.8	56.3	64.7
	70	31.6 ^(a)	31.7 ^(a)	47.4	58.4	34.6 ^(a)	36.0	51.6	61.6	38.3	41.0	56.4	64.8
	75	33.8 ^(a)	35.0	50.0	60.7	34.9 ^(a)	36.6	51.8	61.9	38.5	41.3	56.6	64.9
3000	60	33.6 ^(a)	33.2 ^(a)	47.6	57.4	37.1	37.7	52.2	61.5	40.9	42.6	56.9	64.8
	65	34.0 ^(a)	33.6 ^(a)	47.9	57.7	37.4	38.0	52.4	61.7	41.1	42.9	57.1	65.0
	70	34.9 ^(a)	34.6 ^(a)	48.7	58.4	37.8	38.4	52.7	61.9	41.3	43.3	57.3	65.1
	75	38.2	39.0	52.5	62.0	38.6	39.4	53.3	62.5	41.8	43.7	57.6	65.3
3500	60	35.8	35.3	48.3	57.1	39.4	39.4	52.8	61.5	43.4	44.6	57.7	65.0
	65	36.4	35.8	48.7	57.4	39.8	39.9	53.1	61.7	43.4	44.6	57.7	65.1
	70	38.7	38.2	50.9	59.4	40.2	40.4	53.4	62.0	43.8	45.1	57.9	65.3
	75	41.7	42.3	54.6	63.0	41.4	41.9	54.5	62.9	44.2	45.6	58.3	65.5
4000	60	37.7	37.1	48.9	56.8	41.1	40.9	53.2	61.3	45.1	45.6	58.0	64.8
	65	38.6	38.0	49.6	57.4	41.6	41.5	53.6	61.6	45.2	46.0	58.1	65.1
	70	41.4	40.9	52.6	60.2	42.2	42.2	54.0	62.1	45.7	46.6	58.4	65.4
	75	44.6	45.1	56.3	63.9	44.7	45.2	56.4	64.0	46.2	47.3	58.8	65.8
4500	60	39.2	38.6	49.4	56.5	42.6	42.2	53.6	61.1	46.5	46.9	58.3	64.9
	65	40.3	39.8	50.3	57.3	43.2	42.8	54.1	61.5	46.6	47.1	58.4	65.0
	70	43.7	43.1	53.9	60.8	44.2	44.0	54.9	62.1	47.2	47.8	58.8	65.4
	75	47.0	47.4	57.7	64.6	47.1	47.5	57.8	64.7	48.2	49.0	59.6	65.9
5000	60	40.4	39.9	49.8	56.3	43.8	43.3	53.9	60.8	47.6	47.8	58.5	64.7
	65	41.8	41.2	50.9	57.2	44.5	44.0	54.4	61.2	47.8	48.1	58.6	64.9
	70	45.6	45.0	55.0	61.4	45.7	45.4	55.4	62.1	48.5	48.9	59.2	65.3
	75	49.0	49.4	58.9	65.2	49.1	49.6	59.0	65.3	49.7	50.2	60.1	66.0
5500	60	41.5	41.0	50.1	56.2	44.8	44.3	54.1	60.5	48.5	48.6	58.6	64.6
	65	43.7	42.9	52.0	57.6	45.5	45.1	54.7	61.0	49.0	49.1	58.9	64.8
	70	47.3	46.7	56.0	61.9	47.0	46.6	55.9	62.0	49.6	49.8	59.4	65.3
	75	50.7	51.2	60.0	65.8	50.8	51.3	60.1	65.9	51.0	51.4	60.5	66.1
6000	60	42.4	42.0	50.3	56.0	45.7	45.3	54.4	60.4	49.3	49.3	58.7	64.4
	65	45.1	44.4	52.8	58.1	46.5	46.0	54.9	60.9	49.8	49.9	59.1	64.7
	70	48.7	48.1	56.9	62.3	48.8	48.1	57.0	62.4	50.6	50.6	59.6	65.2
	75	52.3	52.7	60.9	66.3	52.3	52.8	61.0	66.3	52.1	52.8	60.9	66.4

Note: MIN, MAX: The leaving evaporator temperature is affected by the modulating valve position. The MIN and MAX numbers represent modulating valve position impact on both the leaving evaporator temperature and the leaving reheat coil temperature. MAX represents wide open, MIN represents closed to minimum position.

^(a) The unit might be tripped by Froststat at these conditions due to low leaving evaporator air temperature.



Reheat Temperature Rise

Table 19. Reheat temperature rise — 15 tons

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
Ambient DB 60°F													
3000	60	30.9(a)	31.2(a)	39.8	63.0	34.9(a)	36.7	44.6	66.2	38.9	42.4	49.3	69.5
	65	31.1(a)	31.4(a)	40.0	63.1	34.8(a)	36.8	44.5	66.3	39.1	42.3	49.5	69.4
	70	31.4(a)	31.8(a)	40.3	63.3	35.0	37.0	44.5	66.3	39.0	42.4	49.3	69.4
	75	33.9(a)	36.4	43.2	65.8	35.2	37.4	44.7	66.5	39.1	42.6	49.4	69.5
3600	60	34.0(a)	33.4(a)	41.7	62.4	37.9	38.7	46.4	65.7	42.0	44.4	51.2	69.0
	65	34.1(a)	33.6(a)	41.9	62.5	38.0	39.0	46.4	65.8	42.1	44.2	51.2	68.9
	70	35.5	35.3	43.3	63.3	38.2	39.2	46.6	65.9	42.1	44.5	51.2	69.1
	75	38.6	40.4	46.9	66.4	38.7	40.5	47.1	66.4	42.3	44.7	51.3	69.1
4200	60	36.3	35.2	43.2	61.7	40.2	40.3	47.8	65.2	44.5	45.8	52.6	68.5
	65	36.6	35.5	43.5	61.9	40.4	40.7	47.9	65.3	44.4	45.8	52.5	68.5
	70	39.1	38.5	46.1	63.6	40.6	41.0	48.1	65.5	44.6	46.1	52.6	68.7
	75	42.3	43.8	49.8	66.9	42.4	43.9	49.9	67.0	44.8	46.4	52.8	68.7
4800	60	38.1	36.7	44.4	61.1	42.0	41.7	48.8	64.7	46.2	47.0	53.6	68.1
	65	38.7	37.4	44.9	61.5	42.3	42.1	49.0	64.9	46.2	47.0	53.5	68.1
	70	41.9	41.2	48.4	63.9	42.8	42.7	49.5	65.2	46.4	47.5	53.7	68.3
	75	45.3	46.6	52.2	67.4	45.4	46.7	52.3	67.5	46.7	48.1	53.9	68.5
5400	60	39.6	38.0	45.3	60.6	43.4	42.8	49.6	64.3	47.6	48.0	54.3	67.7
	65	40.5	38.9	46.1	61.0	43.8	43.3	49.9	64.5	47.6	48.1	54.2	67.8
	70	44.3	43.5	50.2	64.3	44.5	44.1	50.5	64.8	47.9	48.6	54.5	68.0
	75	47.8	48.9	54.1	67.8	47.9	49.1	54.2	67.9	48.6	49.4	55.1	68.3
6000	60	40.8	39.2	46.0	60.1	44.6	43.7	50.2	63.9	48.7	48.9	54.9	67.3
	65	42.7	40.2	47.8	60.6	45.0	44.3	50.6	64.1	48.8	49.1	54.8	67.5
	70	46.3	45.5	51.8	64.5	46.3	45.3	51.8	64.5	49.2	49.5	55.2	67.7
	75	49.9	51.0	55.8	68.2	50.0	51.1	55.8	68.3	50.0	50.5	55.9	68.0
6600	60	41.8	40.2	46.6	59.7	45.6	44.7	50.8	63.6	49.7	49.6	55.3	67.0
	65	44.3	41.3	49.1	60.3	46.0	45.2	51.2	63.8	49.8	49.9	55.4	67.2
	70	48.0	47.2	53.1	64.8	48.1	47.3	53.2	64.9	50.2	50.3	55.7	67.4
	75	51.7	52.7	57.1	68.5	51.8	52.8	57.2	68.6	51.9	53.0	57.3	68.7
7200	60	42.7	41.1	47.1	59.3	46.5	45.4	51.2	63.2	50.4	50.2	55.7	66.6
	65	45.7	43.6	50.2	61.0	46.9	45.9	51.6	63.5	50.7	50.6	55.8	66.9
	70	49.5	48.7	54.3	65.0	49.6	48.8	54.4	65.1	51.1	51.0	56.2	67.1
	75	53.3	54.3	58.3	68.9	53.3	54.4	58.4	68.9	53.4	54.5	58.5	69.0
Ambient DB 65°F													
2500	60	31.6(a)	29.9(a)	40.6	64.8	35.7	35.6	45.5	68.4	39.8	41.1	50.4	71.5
	65	31.7(a)	30.1(a)	40.7	64.9	35.6	35.5	45.3	68.3	39.8	41.2	50.4	71.6
	70	32.1(a)	30.5(a)	41.1	65.0	35.7	35.7	45.4	68.4	39.8	41.2	50.3	71.6
	75	35.0	34.1(a)	44.4	67.3	36.0	35.9	45.6	68.5	39.9	41.5	50.4	71.6
3000	60	34.6(a)	32.3(a)	42.5	63.6	38.6	37.5	47.2	67.6	43.0	43.3	52.3	71.0
	65	34.8(a)	32.5(a)	42.6	63.7	38.8	37.7	47.2	67.7	42.9	43.2	52.1	71.0
	70	36.5	33.1(a)	44.4	64.1	38.9	38.0	47.4	67.8	43.0	43.4	52.1	71.1
	75	39.7	38.2	48.1	67.7	39.6	38.6	48.1	68.0	43.1	43.6	52.3	71.1

Table 19. Reheat temperature rise — 15 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
3500	60	36.9	34.4 ^(a)	43.9	62.6	40.9	39.3	48.5	66.9	45.3	44.8	53.5	70.4
	65	37.3	34.7 ^(a)	44.3	62.7	41.1	39.6	48.6	67.0	45.2	44.8	53.4	70.4
	70	40.0	36.7	47.2	64.3	41.3	39.8	48.9	67.1	45.3	45.1	53.5	70.6
	75	43.5	41.7	51.1	68.0	43.5	41.8	51.2	68.1	45.5	45.3	53.7	70.6
4000	60	38.7	36.3	45.0	61.8	42.6	40.7	49.5	66.2	47.0	46.1	54.4	69.9
	65	39.4	36.8	45.6	62.1	42.9	41.1	49.7	66.4	46.9	46.1	54.3	69.9
	70	42.9	39.6	49.5	64.7	43.5	41.5	50.2	66.6	47.2	46.5	54.5	70.1
	75	46.5	44.5	53.5	68.4	46.6	44.7	53.5	68.5	47.7	46.8	54.9	70.2
4500	60	40.2	37.8	45.8	61.1	44.0	42.0	50.2	65.7	48.3	47.2	55.1	69.4
	65	41.5	38.5	47.2	61.5	44.4	42.4	50.5	65.9	48.3	47.2	54.9	69.4
	70	45.3	42.0	51.3	65.0	45.2	43.2	51.3	66.2	48.6	47.6	55.3	69.6
	75	49.0	47.0	55.4	68.8	49.1	47.1	55.5	68.8	49.3	48.4	55.9	69.9
5000	60	41.3	39.1	46.5	60.4	45.2	43.0	50.8	65.2	49.4	48.0	55.6	68.9
	65	43.5	40.0	48.7	61.0	45.6	43.5	51.2	65.4	49.5	48.1	55.5	69.0
	70	47.3	44.1	52.9	65.3	47.4	44.5	53.0	65.8	49.8	48.6	55.9	69.2
	75	51.1	49.1	57.0	69.1	51.1	49.2	57.1	69.1	51.1	49.6	57.1	69.6
5500	60	42.3	40.2	47.1	59.9	46.1	43.9	51.3	64.6	50.3	48.8	56.0	68.5
	65	45.1	41.2	50.0	60.6	46.6	44.5	51.7	65.0	50.4	49.1	56.0	68.7
	70	49.0	45.8	54.2	65.5	49.1	45.6	54.3	65.5	50.8	49.5	56.4	68.9
	75	52.8	50.9	58.4	69.4	52.9	51.0	58.5	69.4	53.0	50.6	58.5	69.3
6000	60	43.4	41.1	47.8	59.5	47.0	44.9	51.7	64.2	50.9	49.5	56.2	68.1
	65	46.5	43.2	51.0	61.3	47.6	45.3	52.4	64.5	51.2	49.8	56.4	68.3
	70	50.5	47.4	55.3	65.8	50.5	47.5	55.4	65.8	51.9	50.3	57.0	68.5
	75	54.4	52.5	59.5	69.6	54.4	52.6	59.6	69.7	54.5	52.7	59.7	69.8
Ambient DB 70°F													
2500	60	32.3 ^(a)	29.2 ^(a)	41.4	65.3	36.5	34.3 ^(a)	46.4	70.3	40.7	40.0	51.5	73.7
	65	32.4 ^(a)	29.4 ^(a)	41.5	65.4	36.4	34.2 ^(a)	46.3	70.2	40.7	40.0	51.4	73.7
	70	32.8 ^(a)	29.7 ^(a)	41.9	65.6	36.6	34.4 ^(a)	46.3	70.3	40.7	40.1	51.4	73.7
	75	36.1	32.0 ^(a)	45.7	68.1	36.9	34.6 ^(a)	46.7	70.3	40.9	40.3	51.4	73.8
3000	60	35.3	32.1 ^(a)	43.2	63.9	39.4	36.5	48.1	69.1	43.9	42.0	53.3	72.9
	65	35.5	32.3 ^(a)	43.4	64.0	39.5	36.6	48.1	69.2	43.8	42.1	53.2	72.9
	70	37.5	32.8 ^(a)	45.6	64.5	39.7	36.9	48.2	69.3	43.8	42.3	53.1	73.0
	75	40.9	36.5	49.5	68.5	41.0	37.4	49.6	69.6	44.0	42.5	53.3	73.1
3500	60	37.6	34.4 ^(a)	44.6	62.9	41.6	38.5	49.3	68.2	46.1	43.9	54.5	72.3
	65	38.0	34.7 ^(a)	45.0	63.0	41.8	38.8	49.4	68.3	46.0	43.8	54.3	72.2
	70	41.1	36.4	48.4	64.6	42.2	39.0	49.8	68.4	46.2	44.1	54.4	72.4
	75	44.7	40.1	52.5	68.9	44.8	39.8	52.6	68.9	46.4	44.3	54.6	72.5
4000	60	39.3	36.3	45.6	62.0	43.3	40.1	50.2	67.3	47.7	45.3	55.3	71.6
	65	40.1	36.9	46.4	62.4	43.6	40.5	50.4	67.4	47.6	45.2	55.1	71.6
	70	44.0	39.3	50.7	65.0	44.2	40.9	51.0	67.6	47.9	45.6	55.3	71.8
	75	47.7	43.0	54.9	69.3	47.8	43.1	55.0	69.4	48.5	46.0	55.9	71.9



Reheat Temperature Rise

Table 19. Reheat temperature rise — 15 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
4500	60	40.7	37.9	46.5	61.2	44.6	41.6	50.8	66.4	49.0	46.4	55.9	71.1
	65	42.5	38.6	48.2	61.7	45.0	42.0	51.2	66.6	49.0	46.4	55.6	71.1
	70	46.4	41.7	52.5	65.3	46.4	42.7	52.6	67.0	49.3	46.9	56.1	71.2
	75	50.2	45.5	56.8	69.6	50.3	45.6	56.9	69.7	50.2	47.6	56.9	71.5
5000	60	41.9	39.2	47.1	60.6	45.7	42.8	51.4	65.7	50.1	47.3	56.4	70.6
	65	44.4	40.1	49.7	61.2	46.2	43.3	51.8	65.9	50.1	47.4	56.2	70.6
	70	48.4	43.7	54.1	65.5	48.4	44.1	54.1	66.4	50.5	47.9	56.6	70.8
	75	52.3	47.6	58.4	69.9	52.4	47.7	58.5	70.0	52.5	48.8	58.6	71.2
5500	60	42.8	40.3	47.7	60.0	46.7	43.9	51.9	65.0	50.8	48.1	56.6	70.1
	65	46.0	41.4	50.9	60.7	47.1	44.4	52.3	65.3	51.0	48.4	56.6	70.1
	70	50.1	45.5	55.4	65.8	50.1	45.4	55.4	65.9	51.4	48.8	57.1	70.3
	75	54.1	49.4	59.7	70.2	54.1	49.5	59.8	70.3	54.2	49.8	59.9	70.8
6000	60	43.9	41.3	48.3	59.5	47.5	44.9	52.3	64.5	51.5	48.9	56.9	69.5
	65	47.4	43.5	52.0	61.5	48.2	45.3	53.0	64.8	51.8	49.2	57.0	69.6
	70	51.5	47.0	56.5	66.0	51.6	46.5	56.5	65.5	52.5	49.6	57.7	69.9
	75	55.5	51.0	60.9	70.5	55.6	51.1	60.9	70.6	55.7	50.8	61.0	70.5

Note: MIN, MAX: The leaving evaporator temperature is affected by the modulating valve position. The MIN and MAX numbers represent modulating valve position impact on both the leaving evaporator temperature and the leaving reheat coil temperature. MAX represents wide open, MIN represents closed to minimum position.

(a) The unit might be tripped by Froststat at these conditions due to low leaving evaporator air temperature.

Table 20. Reheat temperature rise — 17.5 tons

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
Ambient DB 60°F													
3500	60	30.0(a)	31.4(a)	38.6	62.5	33.8(a)	36.9	43.1	66.0	37.7	42.6	47.8	69.5
	65	30.1(a)	31.6(a)	38.7	62.6	33.8(a)	37.0	43.1	66.0	37.9	42.5	47.9	69.4
	70	30.5(a)	32.1(a)	39.0	62.8	33.9(a)	37.2	43.1	66.0	37.8	42.6	47.8	69.4
	75	32.6(a)	36.9	41.4	65.6	34.0(a)	37.7	43.2	66.2	37.9	42.8	47.9	69.4
4200	60	33.0(a)	33.5(a)	40.5	62.0	36.8	38.9	45.0	65.6	40.8	44.5	49.7	69.1
	65	33.2(a)	33.8(a)	40.7	62.1	37.0	39.1	45.1	65.6	40.9	44.4	49.8	69.0
	70	34.0(a)	35.7(a)	41.5	63.0	37.2	39.4	45.3	65.7	41.0	44.6	49.9	69.1
	75	37.2	40.8	45.0	66.3	37.7	41.0	45.7	66.4	41.2	44.8	50.0	69.2
4900	60	35.3	35.3	42.1	61.6	39.2	40.5	46.5	65.1	43.4	45.9	51.3	68.7
	65	35.6	35.6	42.3	61.7	39.4	40.8	46.7	65.2	43.3	45.9	51.2	68.7
	70	37.7	38.8	44.4	63.5	39.6	41.1	46.8	65.4	43.5	46.2	51.3	68.8
	75	40.9	44.0	48.0	67.0	40.9	44.2	48.0	67.1	43.7	46.6	51.5	68.9
5600	60	37.2	36.8	43.3	61.1	41.0	41.7	47.6	64.7	45.2	47.1	52.4	68.3
	65	37.8	37.5	43.8	61.4	41.3	42.1	47.9	64.9	45.2	47.1	52.3	68.3
	70	40.6	41.5	46.7	63.9	41.7	42.9	48.2	65.2	45.4	47.5	52.5	68.4
	75	43.9	46.7	50.4	67.5	44.0	46.8	50.5	67.6	45.7	48.2	52.7	68.7

Table 20. Reheat temperature rise — 17.5 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
6300	60	38.8	38.0	44.3	60.6	42.5	42.8	48.5	64.3	46.6	48.0	53.2	67.9
	65	39.6	39.0	45.0	61.0	42.8	43.3	48.8	64.5	46.6	48.1	53.2	67.9
	70	43.0	43.7	48.7	64.3	43.6	44.2	49.4	64.9	47.0	48.6	53.4	68.1
	75	46.4	49.0	52.4	68.0	46.5	49.1	52.5	68.1	47.6	49.5	54.0	68.5
7000	60	40.0	39.2	45.1	60.1	43.7	43.7	49.3	63.9	47.8	48.8	53.8	67.5
	65	41.2	40.3	46.2	60.7	44.1	44.3	49.6	64.2	47.9	49.0	53.9	67.6
	70	45.0	45.6	50.3	64.6	45.0	45.4	50.4	64.6	48.3	49.5	54.2	67.8
	75	48.5	51.0	54.1	68.4	48.6	51.1	54.2	68.5	49.1	50.6	54.9	68.3
7700	60	41.1	40.2	45.7	59.6	44.7	44.6	49.9	63.6	48.8	49.5	54.4	67.2
	65	43.1	42.1	47.7	60.8	45.2	45.1	50.2	63.8	48.9	49.8	54.5	67.3
	70	46.7	47.2	51.7	64.9	46.8	47.3	51.7	65.0	49.3	50.3	54.8	67.5
	75	50.3	52.7	55.6	68.8	50.4	52.8	55.6	68.8	50.4	52.9	55.7	68.9
8400	60	42.0	41.0	46.3	59.1	45.6	45.3	50.4	63.2	49.6	50.0	54.8	66.8
	65	44.5	43.5	48.9	61.0	46.1	45.9	50.7	63.5	49.8	50.4	55.0	67.0
	70	48.3	48.7	52.9	65.1	48.3	48.8	52.9	65.2	50.3	51.0	55.3	67.3
	75	51.9	54.2	56.8	69.1	52.0	54.3	56.9	69.2	52.1	54.4	57.0	69.2
Ambient DB 65°F													
2500	60	30.5 ^(a)	30.2 ^(a)	39.1	64.6	34.4 ^(a)	35.8	43.7	68.2	38.4	41.4	48.5	71.6
	65	30.6 ^(a)	30.4 ^(a)	39.2	64.7	34.4 ^(a)	35.8	43.7	68.2	38.4	41.4	48.5	71.6
	70	31.0 ^(a)	30.8 ^(a)	39.5	64.9	34.5 ^(a)	36.0	43.8	68.2	38.5	41.5	48.5	71.7
	75	33.3 ^(a)	34.7 ^(a)	42.2	67.2	34.6 ^(a)	36.1	43.8	68.3	38.6	41.7	48.6	71.7
3000	60	33.4 ^(a)	32.4 ^(a)	41.0	63.6	37.4	37.8	45.6	67.6	41.4	43.5	50.4	71.2
	65	33.7 ^(a)	32.6 ^(a)	41.2	63.7	37.5	38.0	45.7	67.6	41.5	43.4	50.4	71.1
	70	34.5 ^(a)	33.3 ^(a)	42.0	64.2	37.7	38.2	45.8	67.7	41.6	43.6	50.5	71.2
	75	37.9	38.7	45.9	67.8	38.3	38.9	46.4	68.0	41.8	43.8	50.6	71.3
3500	60	35.8	34.4 ^(a)	42.6	62.6	39.7	39.4	47.0	67.0	43.9	45.0	51.9	70.7
	65	36.1	34.7 ^(a)	42.8	62.7	39.9	39.7	47.2	67.1	43.9	44.9	51.9	70.6
	70	38.4	36.9	45.2	64.5	40.1	40.0	47.4	67.2	44.1	45.2	52.0	70.7
	75	41.6	42.0	48.8	68.2	41.7	42.2	48.9	68.3	44.3	45.5	52.1	70.8
4000	60	37.7	36.2	43.7	61.7	41.5	40.8	48.1	66.4	45.7	46.2	52.9	70.1
	65	38.3	36.7	44.3	62.0	41.8	41.1	48.4	66.5	45.7	46.2	52.9	70.1
	70	41.3	39.7	47.5	64.7	42.3	41.7	48.8	66.7	46.0	46.6	53.1	70.3
	75	44.6	44.8	51.2	68.6	44.7	45.0	51.3	68.7	46.3	46.9	53.3	70.4
4500	60	39.2	37.7	44.7	60.9	42.9	42.0	49.0	65.7	47.1	47.2	53.8	69.6
	65	40.0	38.5	45.4	61.4	43.3	42.4	49.3	65.9	47.2	47.3	53.7	69.6
	70	43.6	42.0	49.4	65.0	44.0	43.3	49.9	66.4	47.5	47.7	54.0	69.8
	75	47.2	47.1	53.3	69.0	47.2	47.3	53.4	69.1	48.2	48.6	54.6	70.2
5000	60	40.4	38.9	45.4	60.3	44.1	43.0	49.7	65.2	48.3	48.1	54.4	69.1
	65	42.0	39.9	47.0	60.9	44.5	43.5	50.0	65.4	48.4	48.2	54.4	69.2
	70	45.7	44.1	51.0	65.3	45.5	44.5	50.9	65.9	48.7	48.7	54.7	69.4
	75	49.3	49.2	55.0	69.3	49.4	49.3	55.1	69.4	49.6	49.7	55.5	69.8



Reheat Temperature Rise

Table 20. Reheat temperature rise — 17.5 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
5500	60	41.4	40.1	46.1	59.8	45.1	43.9	50.3	64.6	49.2	48.8	54.9	68.6
	65	43.7	41.2	48.3	60.5	45.6	44.4	50.6	64.9	49.4	49.0	55.0	68.8
	70	47.4	45.8	52.4	65.5	47.5	45.6	52.4	65.5	49.8	49.5	55.3	69.0
	75	51.1	51.0	56.4	69.6	51.2	51.1	56.5	69.7	51.1	51.0	56.5	69.7
6000	60	42.3	41.0	46.6	59.3	46.0	44.7	50.8	64.1	49.9	49.5	55.2	68.2
	65	45.1	43.2	49.4	61.1	46.5	45.3	51.1	64.4	50.3	49.7	55.4	68.4
	70	48.9	47.3	53.6	65.7	49.0	47.4	53.6	65.8	50.7	50.3	55.8	68.7
	75	52.7	52.6	57.7	69.9	52.8	52.7	57.8	69.9	52.9	52.8	57.8	70.0
Ambient DB 70°F													
2500	60	31.0 ^(a)	29.3 ^(a)	39.7	65.6	35.0	34.7 ^(a)	44.4	70.4	39.0	40.3	49.2	73.9
	65	31.1 ^(a)	29.4 ^(a)	39.8	65.6	35.0	34.6 ^(a)	44.3	70.3	39.1	40.4	49.2	73.9
	70	31.5 ^(a)	29.8 ^(a)	40.1	65.8	35.1	34.8 ^(a)	44.4	70.4	39.1	40.5	49.3	73.9
	75	34.1 ^(a)	32.5 ^(a)	43.1	68.5	35.2	35.0	44.5	70.4	39.3	40.6	49.3	74.0
3000	60	33.9 ^(a)	32.0 ^(a)	41.6	63.9	38.0	36.7	46.2	69.3	42.1	42.2	51.1	73.2
	65	34.2 ^(a)	32.2 ^(a)	41.7	64.0	38.1	36.8	46.3	69.4	42.2	42.4	51.1	73.2
	70	35.6	32.9 ^(a)	43.2	64.5	38.3	37.1	46.4	69.5	42.3	42.5	51.2	73.3
	75	38.7	36.7	46.8	68.8	38.8	37.7	47.0	69.8	42.5	42.8	51.3	73.4
3500	60	36.3	34.3 ^(a)	43.1	62.7	40.2	38.5	47.6	68.2	44.5	44.1	52.6	72.6
	65	36.6	34.5 ^(a)	43.3	62.8	40.4	38.7	47.8	68.3	44.5	44.0	52.5	72.5
	70	39.1	36.4	46.0	64.5	40.7	39.0	47.9	68.5	44.7	44.2	52.6	72.6
	75	42.4	40.2	49.7	69.1	42.5	39.9	49.8	69.0	44.9	44.5	52.8	72.7
4000	60	38.1	36.2	44.2	61.9	42.0	40.2	48.7	67.2	46.3	45.4	53.6	71.8
	65	38.8	36.6	44.8	62.0	42.3	40.5	48.9	67.4	46.3	45.3	53.5	71.8
	70	42.0	39.2	48.2	64.8	42.8	40.8	49.4	67.5	46.5	45.7	53.7	72.0
	75	45.5	43.1	52.2	69.4	45.6	43.3	52.3	69.5	46.8	46.1	53.9	72.1
4500	60	39.6	37.8	45.1	61.1	43.4	41.6	49.5	66.3	47.7	46.5	54.3	71.1
	65	40.5	38.6	46.0	61.6	43.7	41.9	49.8	66.5	47.7	46.5	54.3	71.1
	70	44.4	41.6	50.1	65.1	44.5	42.7	50.5	67.0	48.0	46.9	54.5	71.3
	75	48.0	45.6	54.2	69.6	48.1	45.7	54.3	69.8	48.8	47.7	55.2	71.7
5000	60	40.8	39.1	45.8	60.4	44.6	42.8	50.2	65.6	48.8	47.2	54.9	70.3
	65	42.6	40.0	47.6	61.1	45.0	43.2	50.5	65.8	48.9	47.5	54.9	70.5
	70	46.4	43.7	51.7	65.4	46.2	44.1	51.6	66.4	49.2	48.0	55.2	70.8
	75	50.1	47.7	55.9	69.9	50.2	47.8	56.0	70.0	50.2	48.9	56.0	71.2
5500	60	41.8	40.2	46.5	59.9	45.6	43.8	50.7	65.0	49.7	48.2	55.4	69.9
	65	44.3	41.7	48.9	61.0	46.0	44.3	51.1	65.2	49.9	48.4	55.5	70.0
	70	48.1	45.5	53.1	65.7	48.2	45.4	53.2	65.9	50.3	48.9	55.8	70.2
	75	52.0	49.6	57.4	70.2	52.0	49.7	57.4	70.3	52.1	50.0	57.5	70.8
6000	60	42.8	41.1	47.1	59.4	46.4	44.7	51.2	64.4	50.4	48.9	55.7	69.4
	65	45.7	43.3	50.1	61.3	46.8	45.2	51.5	64.7	50.7	49.2	55.9	69.5
	70	49.6	47.0	54.3	65.9	49.7	46.5	54.4	65.5	51.2	49.7	56.3	69.7
	75	53.5	51.2	58.6	70.5	53.6	51.3	58.7	70.5	53.7	51.0	58.8	70.4

Note: MIN, MAX: The leaving evaporator temperature is affected by the modulating valve position. The MIN and MAX numbers represent modulating valve position impact on both the leaving evaporator temperature and the leaving reheat coil temperature. MAX represents wide open, MIN represents closed to minimum position.

^(a) The unit might be tripped by Froststat at these conditions due to low leaving evaporator air temperature.

Table 21. Reheat temperature rise — 20 tons

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
Ambient DB 60°F													
4000	60	31.0 ^(a)	29.6 ^(a)	44.3	59.8	34.7 ^(a)	33.3 ^(a)	49.1	65.4	38.5	38.0	54.0	69.8
	65	31.6 ^(a)	30.1 ^(a)	44.7	60.1	34.8 ^(a)	33.5 ^(a)	49.1	65.3	38.8	38.3	54.3	70.0
	70	32.1 ^(a)	30.6 ^(a)	45.3	60.6	35.4	34.1 ^(a)	49.5	65.7	38.9	38.4	54.2	70.0
	75	34.4 ^(a)	32.6 ^(a)	47.9	62.9	35.6	34.4 ^(a)	49.7	65.9	39.4	39.1	54.6	70.3
4800	60	34.4 ^(a)	33.1 ^(a)	45.8	59.1	37.6	36.2	50.2	64.4	41.5	40.6	55.2	69.2
	65	34.7 ^(a)	33.3 ^(a)	46.2	59.5	38.4	36.7	50.6	64.5	41.8	40.9	55.4	69.3
	70	35.5	34.1 ^(a)	47.0	60.2	38.7	37.2	51.0	64.9	42.2	41.5	55.4	69.6
	75	39.0	37.1	51.0	63.8	39.4	37.9	51.7	65.5	42.8	42.1	56.0	69.9
5600	60	36.8	35.4	46.9	58.6	39.9	38.5	51.2	63.6	43.8	42.6	56.1	68.6
	65	37.1	35.8	47.3	59.0	40.9	39.4	51.7	64.0	44.1	43.0	56.2	68.8
	70	39.5	36.9	49.6	59.9	41.2	39.7	52.2	64.4	45.0	44.0	56.7	69.2
	75	42.7	40.8	53.4	64.7	42.4	40.8	53.3	65.2	45.4	44.4	57.1	69.5
6400	60	38.7	37.4	47.8	58.2	41.8	40.4	51.8	63.0	45.9	44.3	56.9	68.1
	65	39.4	38.0	48.5	58.8	42.8	41.4	52.6	63.6	46.0	44.7	56.8	68.3
	70	42.3	40.6	51.5	61.3	43.2	41.8	53.0	64.0	47.0	45.8	57.5	68.8
	75	45.7	43.8	55.4	65.5	45.8	43.7	55.5	65.5	47.4	46.3	58.0	69.2
7200	60	40.3	39.0	48.5	57.9	43.4	42.0	52.4	62.5	47.3	45.7	57.4	67.6
	65	41.2	39.9	49.3	58.6	44.5	43.1	53.3	63.2	47.7	46.2	57.2	67.7
	70	44.6	43.0	53.1	61.9	45.2	43.8	54.0	63.8	48.7	47.3	58.2	68.5
	75	48.1	46.3	57.1	66.2	48.2	46.4	57.2	66.3	49.4	47.9	58.9	68.9
8000	60	41.7	40.4	49.2	57.6	44.8	43.5	52.7	62.0	48.4	47.1	57.7	67.3
	65	42.6	41.5	50.0	58.4	45.8	44.5	53.9	62.9	49.7	47.8	57.9	67.3
	70	46.6	45.0	54.4	62.5	46.7	45.4	54.7	63.6	50.1	48.7	58.8	68.1
	75	50.2	48.4	58.5	66.8	50.3	48.5	58.6	66.8	50.9	49.6	59.5	68.7
8800	60	42.8	41.6	49.7	57.4	46.6	45.4	53.5	61.7	49.4	48.0	57.9	66.8
	65	44.6	42.8	51.4	58.3	47.0	45.7	54.4	62.7	51.4	49.5	59.0	67.0
	70	48.3	46.7	55.6	62.9	47.9	46.7	55.3	63.4	51.3	49.9	59.2	67.9
	75	52.0	50.2	59.8	67.3	52.1	50.3	59.8	67.4	52.1	50.9	60.0	68.5
9600	60	43.8	42.7	50.1	57.2	48.0	46.4	54.4	61.4	50.2	48.8	58.1	66.4
	65	46.0	44.6	52.4	58.9	48.0	46.8	54.8	62.4	52.3	50.5	59.3	66.7
	70	49.8	48.2	56.6	63.3	49.9	47.9	56.6	63.2	52.3	50.9	59.6	67.6
	75	53.6	51.8	60.8	67.7	53.7	51.9	60.9	67.8	53.2	52.0	60.5	68.3
Ambient DB 65°F													
4000	60	32.8 ^(a)	29.7 ^(a)	38.4	62.7	36.5	33.6 ^(a)	42.8	68.4	40.6	38.4	47.5	72.7
	65	33.1 ^(a)	30.3 ^(a)	38.8	63.0	36.6	33.7 ^(a)	42.8	68.3	40.8	38.8	47.6	72.9
	70	33.7 ^(a)	30.6 ^(a)	39.4	63.4	37.2	34.3 ^(a)	43.3	68.7	41.0	38.9	47.7	72.9
	75	36.7 ^(a)	32.8 ^(a)	42.6	65.9	37.6	34.7 ^(a)	43.8	68.9	41.5	39.6	48.2	73.2
4800	60	35.9	33.2 ^(a)	40.7	61.6	39.3	36.4	44.9	67.1	43.8	40.9	49.9	71.9
	65	36.1	33.5 ^(a)	41.1	62.0	40.1	36.8	45.3	67.1	43.8	41.2	49.8	72.0
	70	38.0	34.3 ^(a)	42.9	62.7	40.4	37.4	45.7	67.6	44.4	41.9	50.2	72.2
	75	41.3	37.3	46.6	66.5	41.1	38.1	46.5	68.1	44.8	42.4	50.6	72.5



Reheat Temperature Rise

Table 21. Reheat temperature rise — 20 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
5600	60	38.2	35.5	42.5	60.8	41.5	38.6	46.4	66.0	46.0	42.8	51.5	71.1
	65	38.6	35.9	42.9	61.2	42.5	39.5	47.1	66.3	46.0	43.2	51.3	71.2
	70	41.5	37.0	45.9	62.2	42.8	39.9	47.6	66.7	46.9	44.1	52.0	71.6
	75	45.0	40.9	49.8	67.1	45.1	40.9	49.9	67.5	47.3	44.6	52.5	71.9
6400	60	40.1	37.4	43.9	60.2	43.3	40.4	47.6	65.2	47.7	44.4	52.6	70.3
	65	40.8	37.9	44.7	60.6	44.4	41.5	48.6	65.7	47.7	44.8	52.3	70.5
	70	44.3	40.7	48.3	63.4	45.0	41.9	49.3	66.1	48.8	45.9	53.4	71.0
	75	48.0	43.9	52.4	67.6	48.1	43.2	52.5	67.0	49.2	46.4	53.9	71.4
7200	60	41.6	39.1	45.1	59.6	44.7	42.0	48.5	64.4	49.0	45.7	53.5	69.6
	65	42.4	40.0	45.9	60.4	45.9	43.1	49.7	65.1	50.7	46.3	54.6	69.7
	70	46.6	43.1	50.3	63.8	46.7	43.9	50.5	65.8	50.4	47.4	54.5	70.5
	75	50.5	46.4	54.6	68.1	50.6	46.5	54.6	68.2	51.1	48.0	55.3	70.9
8000	60	42.9	40.5	46.1	59.2	47.3	43.6	50.6	63.8	50.0	47.1	54.2	69.2
	65	44.6	41.5	47.8	60.0	47.2	44.6	50.7	64.7	51.8	48.1	55.4	69.2
	70	48.6	45.1	52.0	64.2	48.4	45.5	51.9	65.4	51.7	48.8	55.5	70.0
	75	52.6	48.5	56.3	68.6	52.7	48.6	56.4	68.7	52.5	49.7	56.3	70.6
8800	60	44.0	41.7	46.9	58.9	48.3	45.4	51.2	63.2	50.8	48.0	54.7	68.6
	65	46.2	43.0	49.2	59.9	48.3	45.7	51.5	64.3	52.8	49.6	56.0	68.6
	70	50.2	46.8	53.4	64.6	50.3	46.8	53.5	65.0	52.8	50.0	56.2	69.6
	75	54.4	50.4	57.9	69.0	54.4	50.4	57.9	69.1	54.5	51.0	58.0	70.2
9600	60	44.9	42.7	47.6	58.6	49.1	46.5	51.7	62.8	51.4	48.9	55.0	68.0
	65	47.6	44.7	50.3	60.2	49.3	46.8	52.1	63.9	53.5	50.6	56.5	68.2
	70	51.7	48.3	54.7	64.9	51.7	47.9	54.7	64.7	53.7	51.0	56.9	69.2
	75	55.9	51.9	59.1	69.3	55.9	52.0	59.2	69.4	56.0	52.1	59.3	69.9
Ambient DB 70°F													
4000	60	33.5 ^(a)	29.9 ^(a)	39.1	62.9	37.1	33.5 ^(a)	43.5	68.8	41.3	37.7	48.4	74.3
	65	33.7 ^(a)	30.5 ^(a)	39.4	63.2	37.3	33.7 ^(a)	43.5	68.7	41.5	38.1	48.5	74.5
	70	34.3 ^(a)	30.7 ^(a)	40.0	63.5	37.8	34.3 ^(a)	44.0	69.0	41.6	38.1	48.5	74.5
	75	37.6	33.1 ^(a)	43.6	66.3	38.3	34.6 ^(a)	44.6	69.3	42.2	38.8	49.0	74.7
4800	60	36.4	33.3 ^(a)	41.3	61.8	39.9	36.5	45.5	67.5	44.5	40.4	50.7	73.0
	65	36.7	33.6 ^(a)	41.7	62.1	40.7	37.0	46.0	67.4	44.4	40.7	50.5	73.1
	70	38.8	34.4 ^(a)	43.8	62.9	41.0	37.5	46.4	68.0	45.1	41.3	50.9	73.3
	75	42.2	37.6	47.6	66.9	42.0	38.2	47.5	68.5	45.4	41.8	51.4	73.6
5600	60	38.7	35.7	43.1	60.8	42.1	38.7	47.0	66.3	46.6	42.6	52.2	71.9
	65	39.1	36.0	43.5	61.3	43.0	39.7	47.8	66.6	46.5	42.9	51.9	72.0
	70	42.2	37.9	46.8	62.9	43.4	40.0	48.2	67.1	47.5	43.9	52.7	72.3
	75	45.9	41.2	50.8	67.5	46.0	41.1	50.9	67.9	47.9	44.2	53.2	72.8
6400	60	40.6	37.6	44.5	60.2	43.7	40.6	48.1	65.3	48.2	44.3	53.3	70.9
	65	40.8	38.1	44.7	60.7	44.9	41.7	49.1	65.9	48.3	44.8	52.9	71.0
	70	45.0	40.9	49.2	63.5	45.6	42.1	49.9	66.3	49.4	45.8	54.0	71.6
	75	48.9	44.1	53.4	68.0	49.0	43.4	53.5	67.3	50.0	46.2	54.7	72.0

Table 21. Reheat temperature rise — 20 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
7200	60	42.1	39.3	45.6	59.7	45.6	42.2	49.2	64.5	49.5	45.8	54.1	70.0
	65	43.1	40.2	46.6	60.4	46.4	43.3	50.3	65.2	51.2	46.3	55.1	70.1
	70	47.3	43.3	51.2	64.0	47.1	44.1	50.9	65.9	50.9	47.4	55.1	70.9
	75	51.4	46.6	55.5	68.5	51.5	46.7	55.6	68.6	51.7	47.9	55.9	71.4
8000	60	43.4	40.7	46.5	59.3	47.7	43.8	51.0	63.7	50.5	47.2	54.7	69.6
	65	45.2	41.7	48.5	60.0	47.7	44.7	51.2	64.7	52.3	47.8	55.8	69.1
	70	49.3	45.3	52.8	64.3	49.3	45.7	52.9	65.5	52.2	48.9	56.0	70.3
	75	53.4	48.7	57.3	68.9	53.5	48.8	57.3	69.0	53.4	49.7	57.2	71.0
8800	60	44.4	41.9	47.3	58.9	48.7	45.6	51.6	63.2	51.3	48.2	55.2	68.9
	65	46.8	43.0	49.8	59.7	48.8	45.9	51.9	64.3	52.9	49.8	56.2	68.8
	70	50.9	47.0	54.2	64.7	51.0	47.0	54.2	65.1	53.3	50.1	56.7	69.9
	75	55.2	50.5	58.7	69.3	55.2	50.6	58.8	69.4	55.3	51.0	58.9	70.5
9600	60	45.3	42.9	48.0	58.6	49.4	46.6	52.1	62.8	51.8	49.0	55.5	68.3
	65	48.1	44.9	50.9	60.4	49.7	47.0	52.6	63.9	53.9	50.8	56.8	68.3
	70	52.3	48.5	55.4	65.0	52.4	48.1	55.4	64.7	54.2	51.1	57.3	69.4
	75	56.7	52.1	60.0	69.6	56.7	52.2	60.0	69.7	56.8	52.2	60.1	70.2

Note: MIN, MAX: The leaving evaporator temperature is affected by the modulating valve position. The MIN and MAX numbers represent modulating valve position impact on both the leaving evaporator temperature and the leaving reheat coil temperature. MAX represents wide open, MIN represents closed to minimum position.

(a) The unit might be tripped by Froststat at these conditions due to low leaving evaporator air temperature.

Table 22. Reheat temperature rise — 25 tons

Airflow (cfm)	Ent DB (° F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
Ambient DB 60°F													
5000	60	33.3(a)	32.4(a)	48.3	59.4	36.6	35.7	52.7	64.5	40.2	39.7	57.4	69.4
	65	34.0(a)	33.1(a)	48.8	59.9	37.1	36.2	53.1	64.9	40.6	40.3	57.9	69.8
	70	35.2	34.3(a)	49.9	60.8	37.7	36.8	53.7	65.3	41.1	40.9	58.3	70.1
	75	38.1	37.0	53.1	63.7	38.6	37.6	54.3	65.8	41.7	41.5	58.8	70.4
6000	60	36.0	35.2	49.0	58.7	39.3	38.5	53.4	63.7	42.9	42.2	58.0	68.7
	65	36.8	36.0	49.7	59.3	40.0	39.1	53.9	64.2	43.4	42.8	58.5	69.1
	70	38.8	37.7	51.4	60.6	40.8	39.9	54.6	64.8	44.0	43.5	59.0	69.5
	75	42.3	41.2	55.5	64.8	42.3	41.4	55.8	65.8	44.8	44.4	59.7	70.0
7000	60	38.1	37.3	49.7	58.2	41.4	40.6	54.0	63.1	44.9	44.1	58.5	68.0
	65	39.1	38.3	50.5	58.8	42.2	41.4	54.6	63.7	45.6	44.8	59.0	68.6
	70	42.3	41.3	53.5	61.4	43.1	42.3	55.3	64.3	46.3	45.7	59.7	69.1
	75	45.6	44.5	57.3	65.6	45.0	44.2	56.9	65.6	47.2	46.6	60.3	69.6
8000	60	39.9	39.1	50.3	57.8	43.1	42.3	54.4	62.6	46.5	45.7	58.8	67.4
	65	41.5	40.7	51.5	58.9	44.0	43.2	55.1	63.3	47.2	46.4	59.4	68.0
	70	44.8	43.9	54.9	62.1	45.4	44.3	56.2	63.9	48.1	47.4	60.1	68.7
	75	48.2	47.2	58.9	66.4	48.3	47.3	59.0	66.5	49.1	48.5	60.8	69.2



Reheat Temperature Rise

Table 22. Reheat temperature rise — 25 tons (continued)

Airflow (cfm)	Ent DB (°F)	Entering Wet Bulb (°F)											
		51				55				59			
		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)		Lvg Evap DB (°F)		Lvg Reheat DB (°F)	
		MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
9000	60	41.3	40.6	50.7	57.5	44.4	43.6	54.7	62.1	48.0	47.0	59.2	66.8
	65	43.1	42.4	52.2	58.7	45.4	44.7	55.5	62.9	48.6	47.8	59.7	67.5
	70	46.9	46.0	56.2	62.7	47.1	46.4	56.8	64.0	49.6	48.8	60.5	68.2
	75	50.4	49.5	60.2	67.0	50.5	49.6	60.3	67.1	51.2	50.5	61.7	69.2
10000	60	42.5	41.8	51.1	57.2	45.5	44.8	54.9	61.7	49.1	48.2	59.4	68.1
	65	44.6	43.9	52.8	58.6	46.6	45.9	55.9	62.5	49.7	48.9	59.9	67.0
	70	48.6	47.8	57.2	63.2	48.6	47.9	57.3	63.8	50.8	50.1	60.8	67.9
	75	52.3	51.4	61.3	67.6	52.4	51.5	61.4	67.6	52.6	52.0	62.1	69.0
11000	60	43.5	42.9	51.4	57.0	46.4	45.8	55.1	61.3	49.9	49.2	59.5	66.1
	65	46.4	45.6	53.9	59.0	47.7	47.0	56.1	62.2	50.8	49.9	60.1	66.6
	70	50.1	49.3	58.1	63.6	49.8	49.1	57.8	63.7	51.9	51.2	61.0	67.5
	75	53.9	53.0	62.3	68.0	53.9	53.1	62.4	68.1	53.9	53.2	62.5	68.8
12000	60	44.4	43.8	51.6	56.8	47.3	46.6	55.4	61.1	50.5	49.9	59.4	65.7
	65	47.6	46.9	54.6	59.4	48.5	47.9	56.3	62.0	51.6	50.8	60.3	66.4
	70	51.4	50.7	58.9	64.0	51.5	50.7	58.9	64.0	52.8	52.1	61.2	67.2
	75	55.2	54.4	63.1	68.4	55.3	54.5	63.2	68.5	54.9	54.3	62.9	68.6
Ambient DB 65°F													
5000	60	34.5 ^(a)	32.5 ^(a)	41.7	61.9	38.0	35.8	45.8	67.2	41.7	39.7	50.2	72.3
	65	35.2	33.2 ^(a)	42.3	62.4	38.5	36.3	46.2	67.5	42.2	40.3	50.6	72.7
	70	36.5	34.4 ^(a)	43.5	63.3	39.1	37.0	46.8	68.0	42.7	40.8	51.1	73.0
	75	39.8	37.2	47.1	66.4	40.3	37.7	47.8	68.4	43.3	41.6	51.6	73.4
6000	60	37.2	35.2	43.5	60.8	40.7	38.5	47.5	66.1	44.4	42.7	51.8	71.6
	65	37.9	36.1	44.1	61.4	41.3	39.2	48.1	66.6	44.9	42.9	52.4	71.7
	70	40.6	37.8	46.7	62.7	42.1	40.0	48.8	67.1	45.5	43.5	52.8	72.1
	75	43.9	41.4	50.4	67.1	43.6	41.5	50.2	68.1	46.3	44.3	53.5	72.6
7000	60	39.2	37.4	44.8	60.1	42.7	40.7	48.8	65.2	46.3	44.2	53.1	70.3
	65	40.6	38.4	46.0	60.6	43.4	41.4	49.5	65.8	47.0	44.8	53.6	70.8
	70	43.7	41.4	49.2	63.3	44.5	42.4	50.4	66.4	47.7	45.7	54.3	71.4
	75	47.2	44.7	53.0	67.7	47.3	44.3	53.1	67.7	48.6	46.6	55.0	71.9
8000	60	40.9	39.2	45.9	59.5	44.2	42.3	49.8	64.4	48.1	45.7	54.2	69.4
	65	42.5	40.8	47.3	60.5	45.1	43.2	50.6	65.1	48.6	46.5	54.6	70.0
	70	46.2	44.0	51.2	63.8	46.6	44.4	51.8	65.7	49.5	47.4	55.4	70.7
	75	49.8	47.4	55.1	68.2	49.9	47.5	55.2	68.3	50.8	48.5	56.5	71.2
9000	60	42.3	40.7	46.8	59.0	45.5	43.7	50.5	63.7	49.3	47.0	54.9	68.7
	65	44.2	42.5	48.5	60.2	46.5	44.8	51.4	64.5	49.9	47.8	55.3	69.3
	70	48.2	46.1	52.8	64.2	48.2	46.5	52.9	65.6	50.9	48.9	56.2	70.0
	75	52.0	49.6	56.9	68.7	52.1	49.7	57.0	68.8	52.5	50.5	57.6	71.0
10000	60	43.4	41.9	47.5	58.6	46.5	44.8	51.2	63.2	50.1	48.3	55.3	82.5
	65	46.1	44.0	50.1	60.0	47.6	46.0	52.1	64.0	51.0	49.0	56.0	68.7
	70	50.0	47.9	54.2	64.6	49.6	48.0	53.8	65.2	52.0	50.2	56.9	69.5
	75	53.8	51.5	58.4	69.1	53.9	51.6	58.5	69.2	53.8	52.0	58.5	70.6