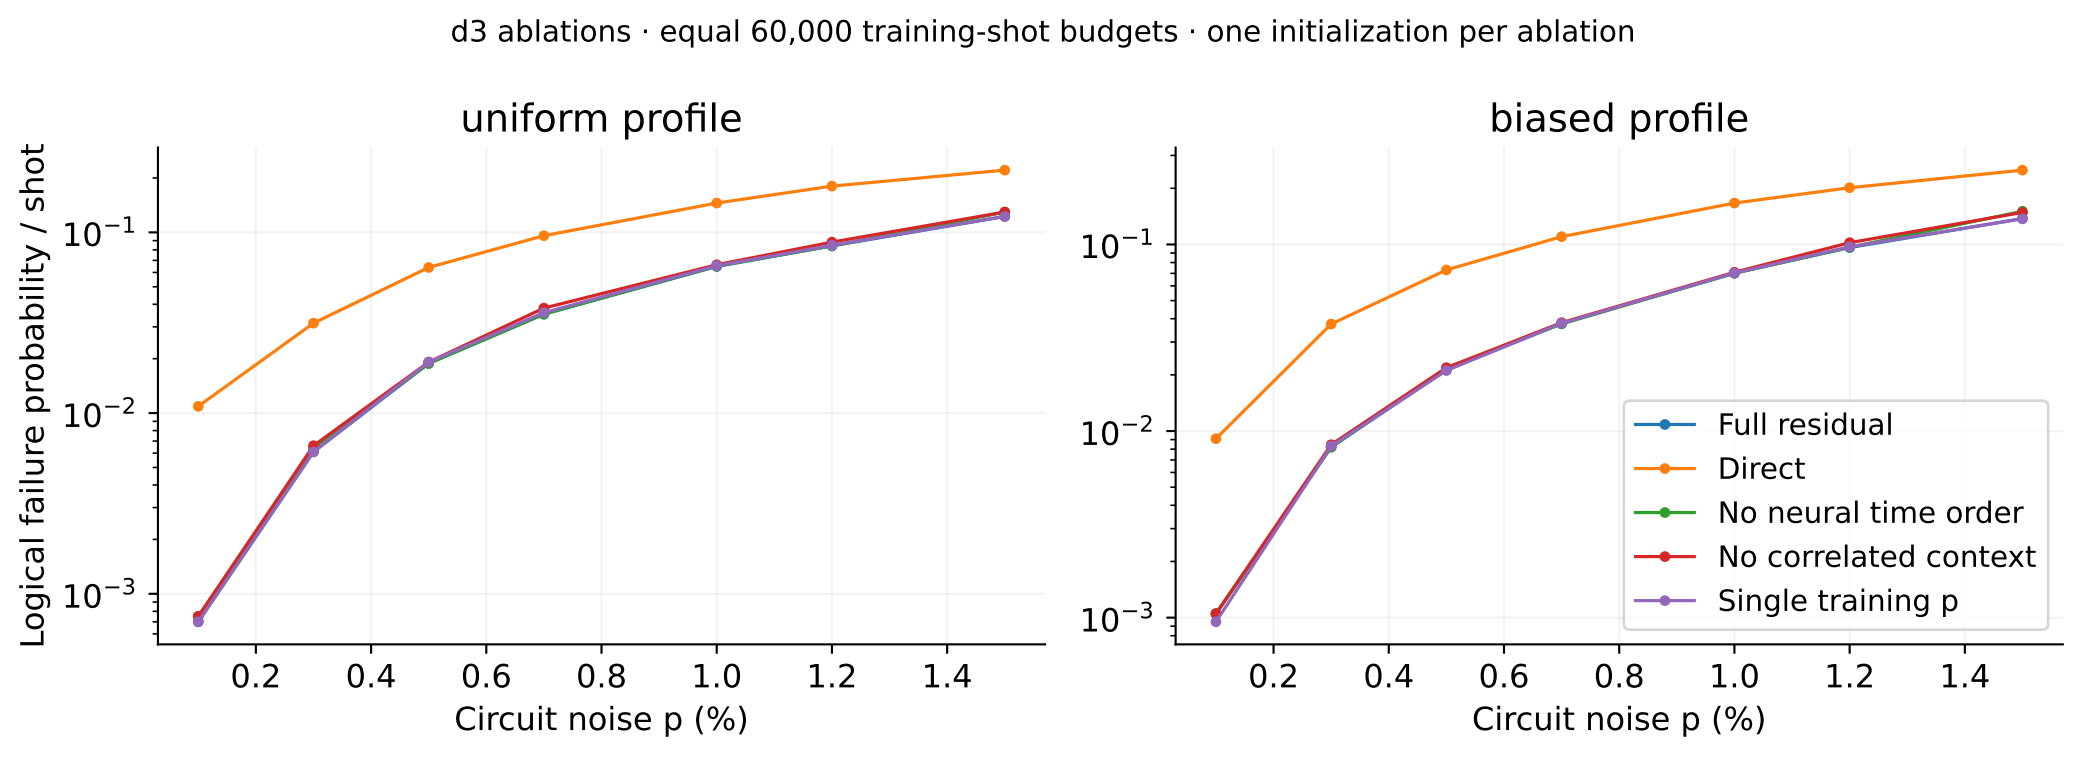
d3 ablations · equal 60,000 training-shot budgets · one initialization per ablation
uniform profile
biased profile
Logical failure probability / shot
10^{-1}
10^{-2}
10^{-3}
0.2
0.4
0.6
0.8
1.0
1.2
1.4
Circuit noise p (%)
Full residual
Direct
No neural time order
No correlated context
Single training p