


G2 - FR-C6-01-01 named hardware configuration constraint

G1 plus accepted BAP-FRC6-01-01-05: HardwareConfigurationProfile constrains DermaTriageEnvironment. Numeric profile detail remains outside this level; former candidate procedure-to-resource dependencies remain absent.

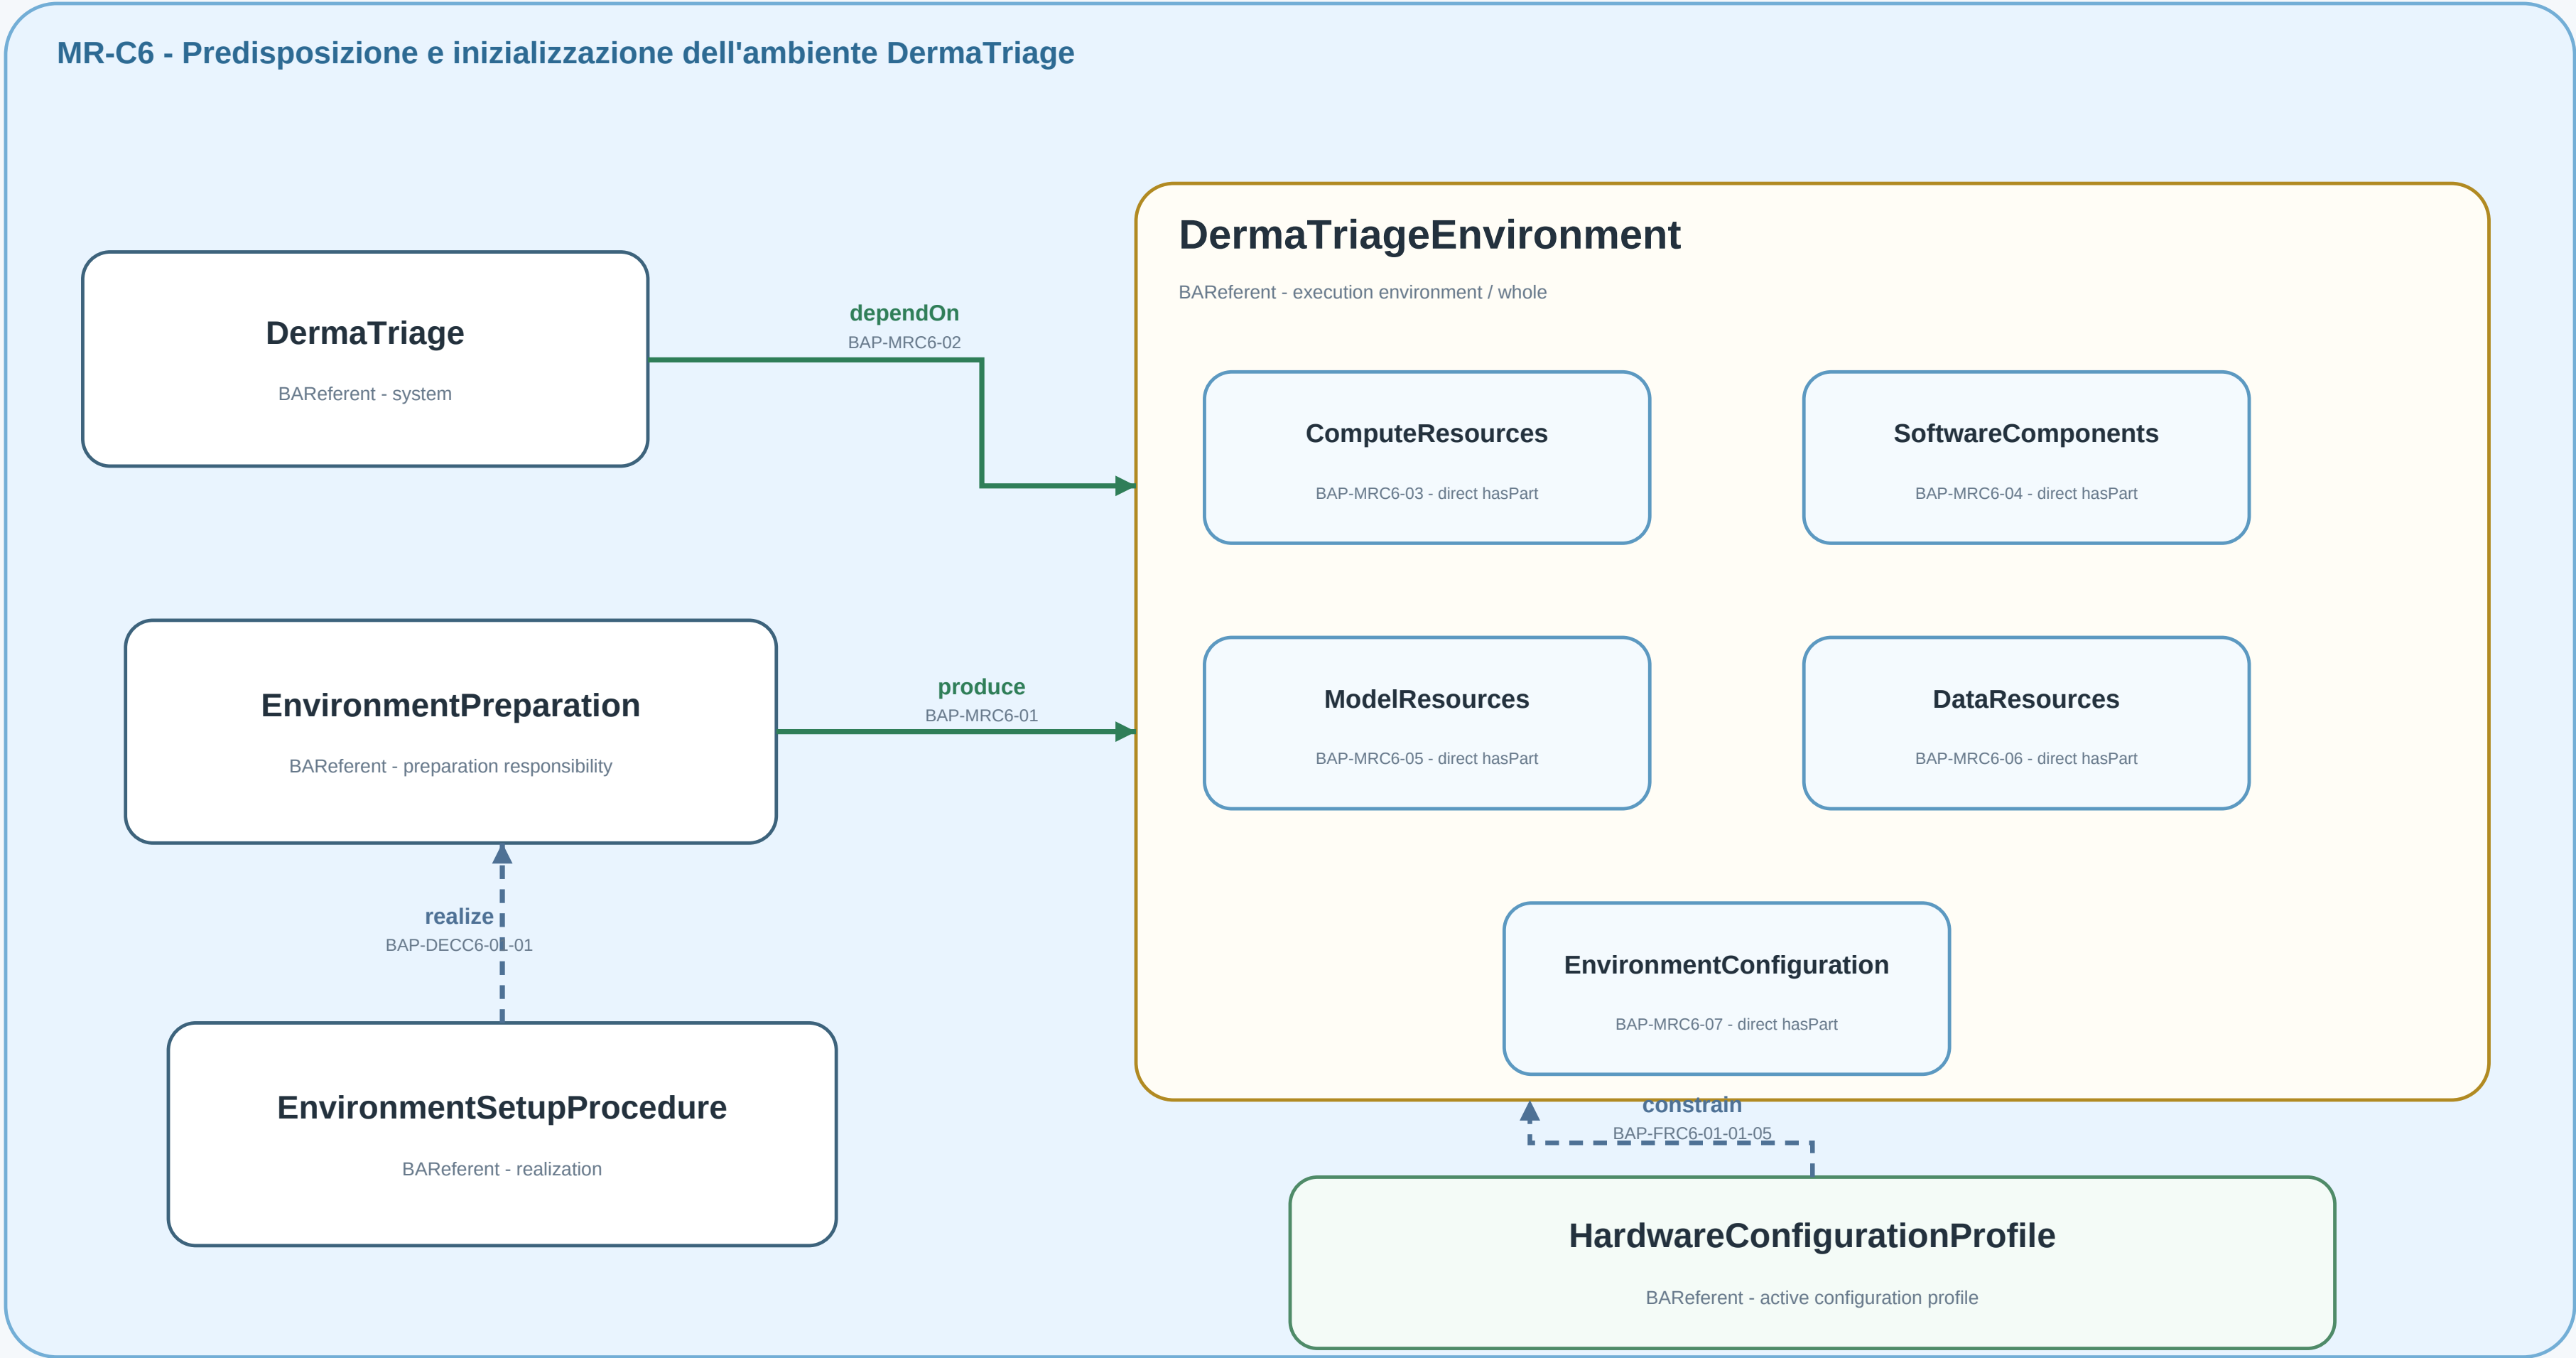

G2 - adds only the accepted named configuration constraint; former FR-C6-01-01 candidate dependOn edges are absent.