
MACS

MACS v0.5.0 | Settings | ▶ Capture | REC | Sync integration | Downsample analysis (≤10kHz) | 00:00.0 | ▶ Start | Mark | Reset | Markers


Lofargram | Mode: Classic · left click = confirm · right click = clear

Palette: Thermal | FFT: 131072 | ≈0.37 Hz/bin

Cursor: + Classic | ♦ Harmonic | ↔ Sideband | Fmin 0 | Fmax 100 Hz | Floor -113 | Dyn. 138 dB | Norm | Integrate | Box | Noise sub.

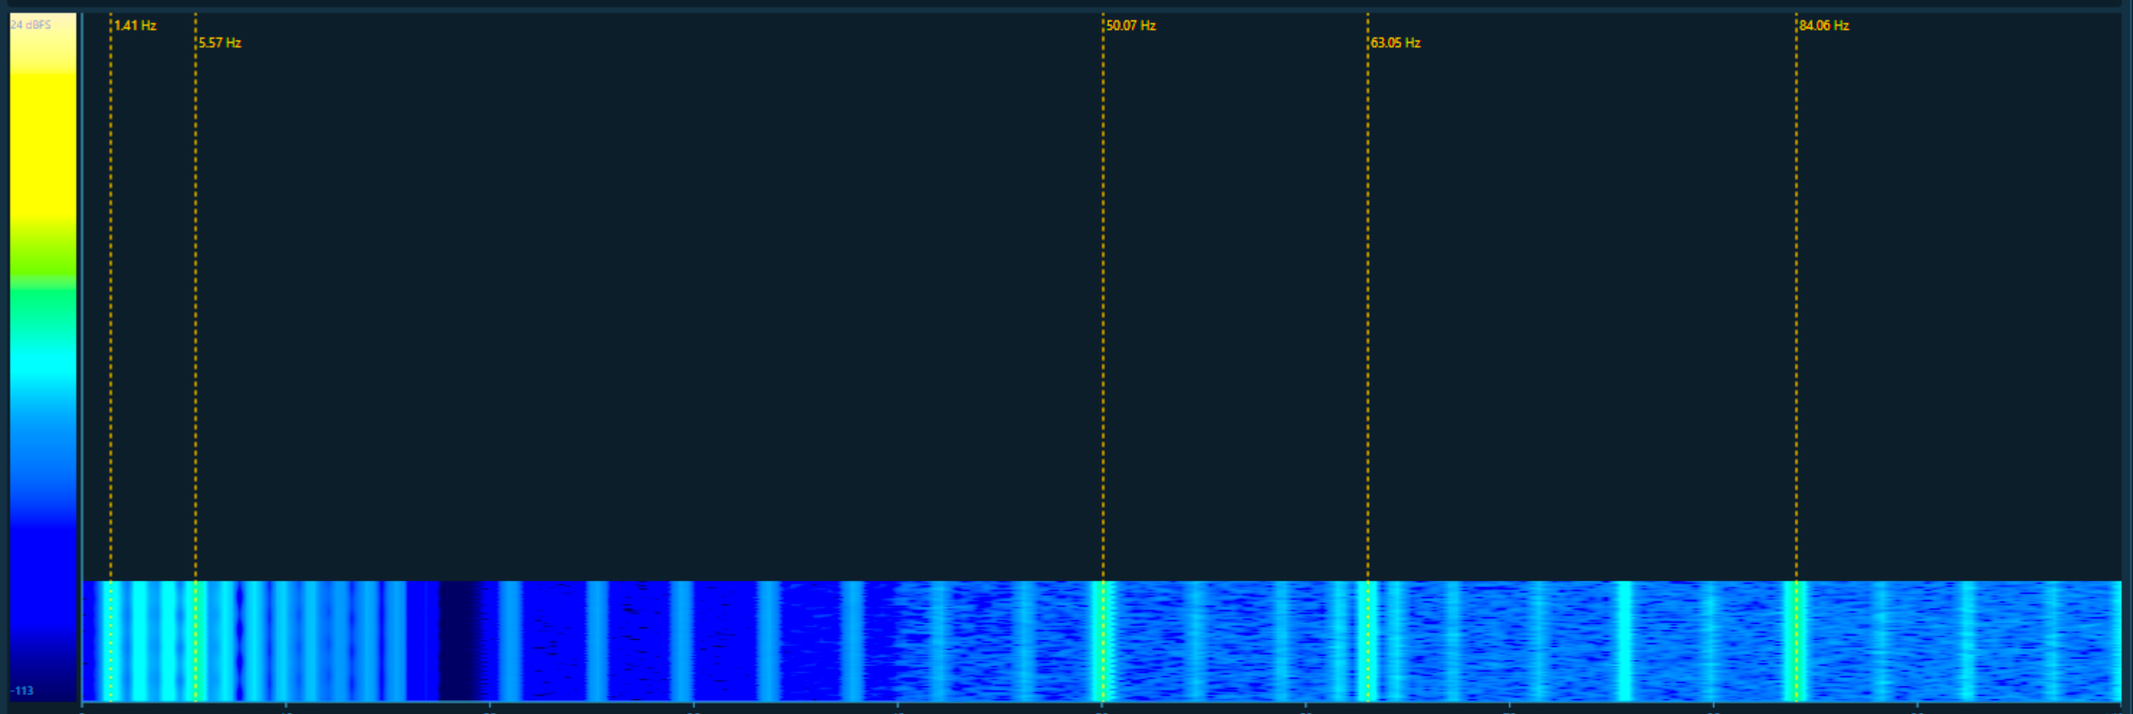

Psd | Palette: Thermal | FFT: 131072 | ≈0.37 Hz/bin | Power Spectral Density (PSD) | Integrate | Box

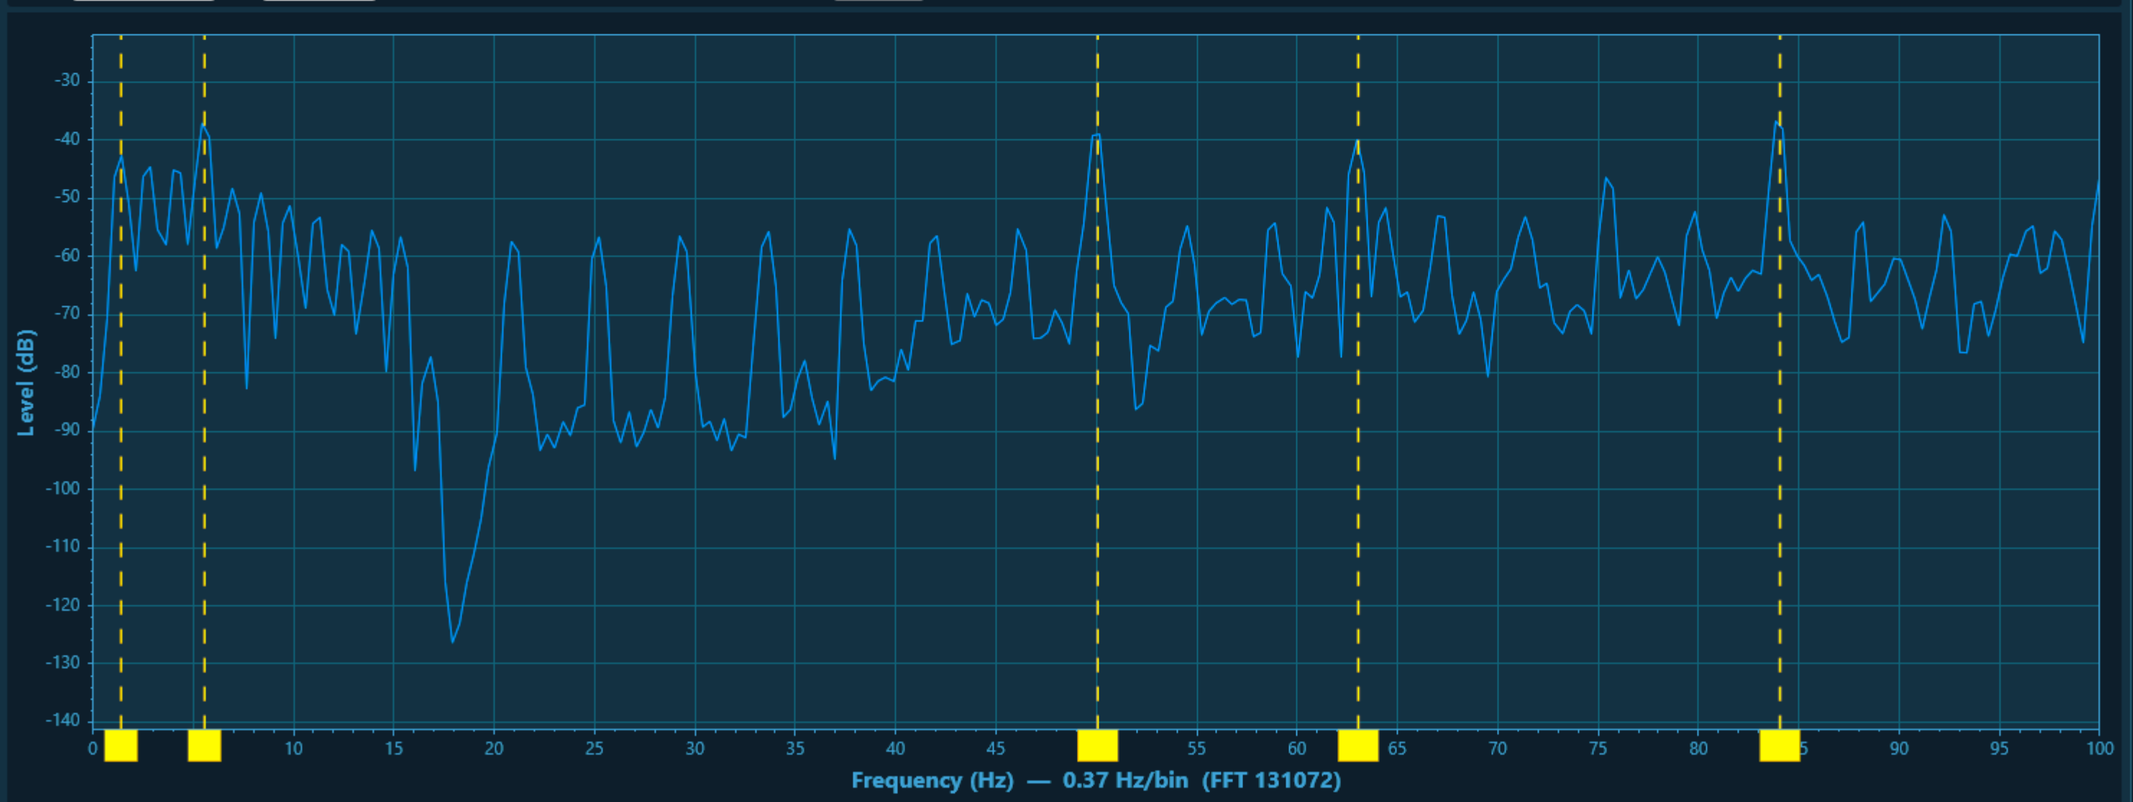

Live monitor

Speed: 1x

Vol 100%

Listen

Compare against database

Compare marks against database

MARKED FREQUENCIES

- 1.41 Hz
- 5.57 Hz
- 50.07 Hz
- 63.05 Hz
- 84.06 Hz

Suggest groups...

NEW CONTACT

Contact name (e.g. Type 209) *

Optional description

Frequencies to save: 5

+ Create with marked frequencies

CONTACTS 48 in library

Browse all contacts... | Import... | Export...

Pin contacts to keep them in the sidebar.

RECORDINGS

PLAYBACK OUTPUT

Bandpass filter

Volume 100%

Loop

Speed: 1x

- Type55_new
- t55_fatline
- sabre_flank_28kt
- sabre_cruise_14kt
- Fuyu 2 LAB
- Fuyu 03 TB34
- Fuyu 01 TB34

▶ sabre_cruise_14kt