


Public timetable intake and modeled energy reference

(A) Full mandatory timetable · 37 source services



(B) Constructed 37-bus feasibility reference, not optimized

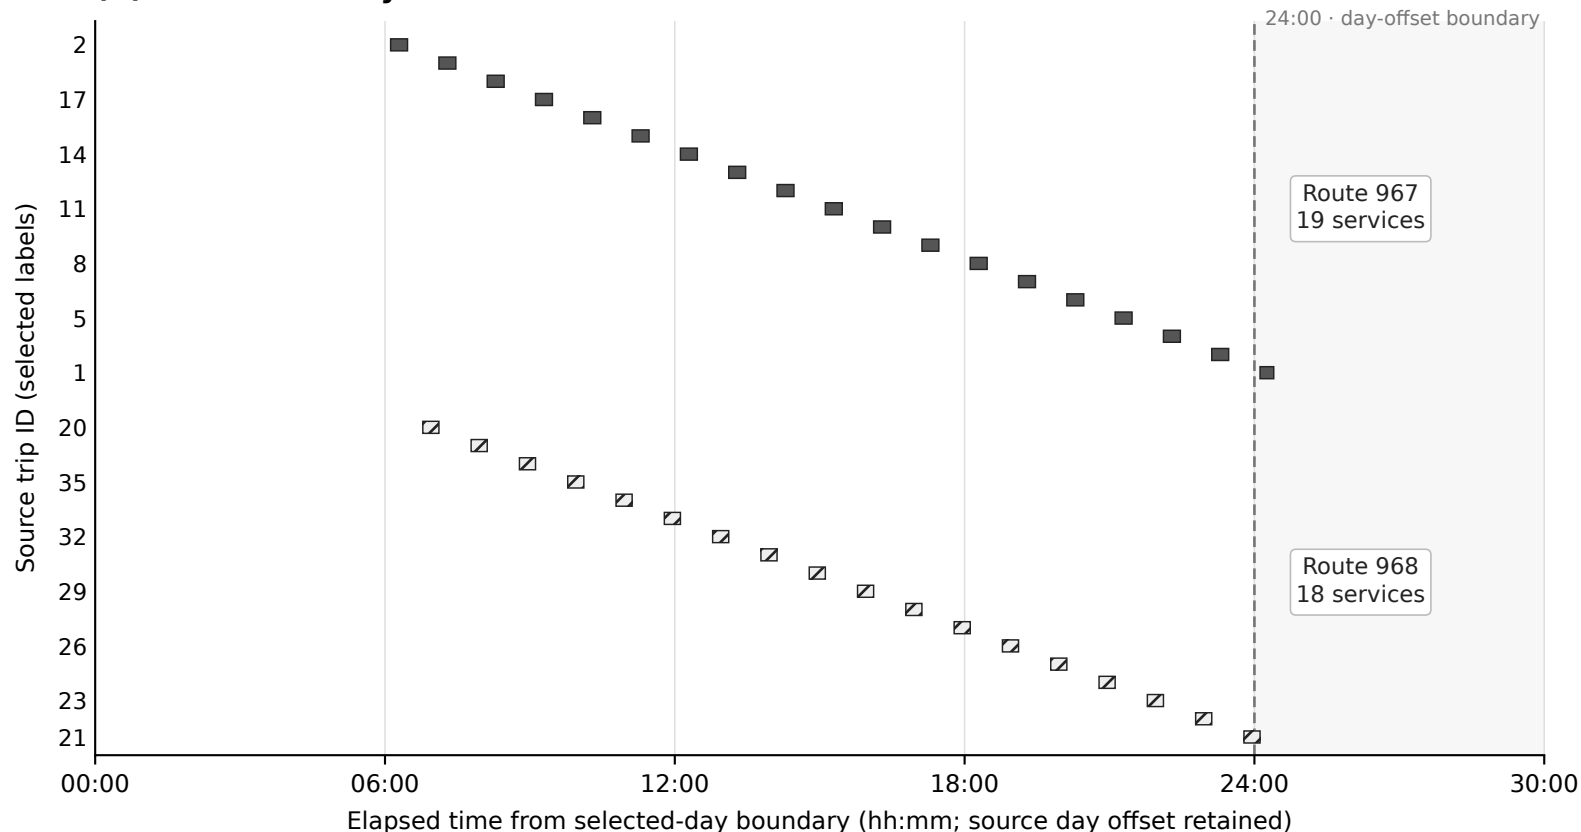