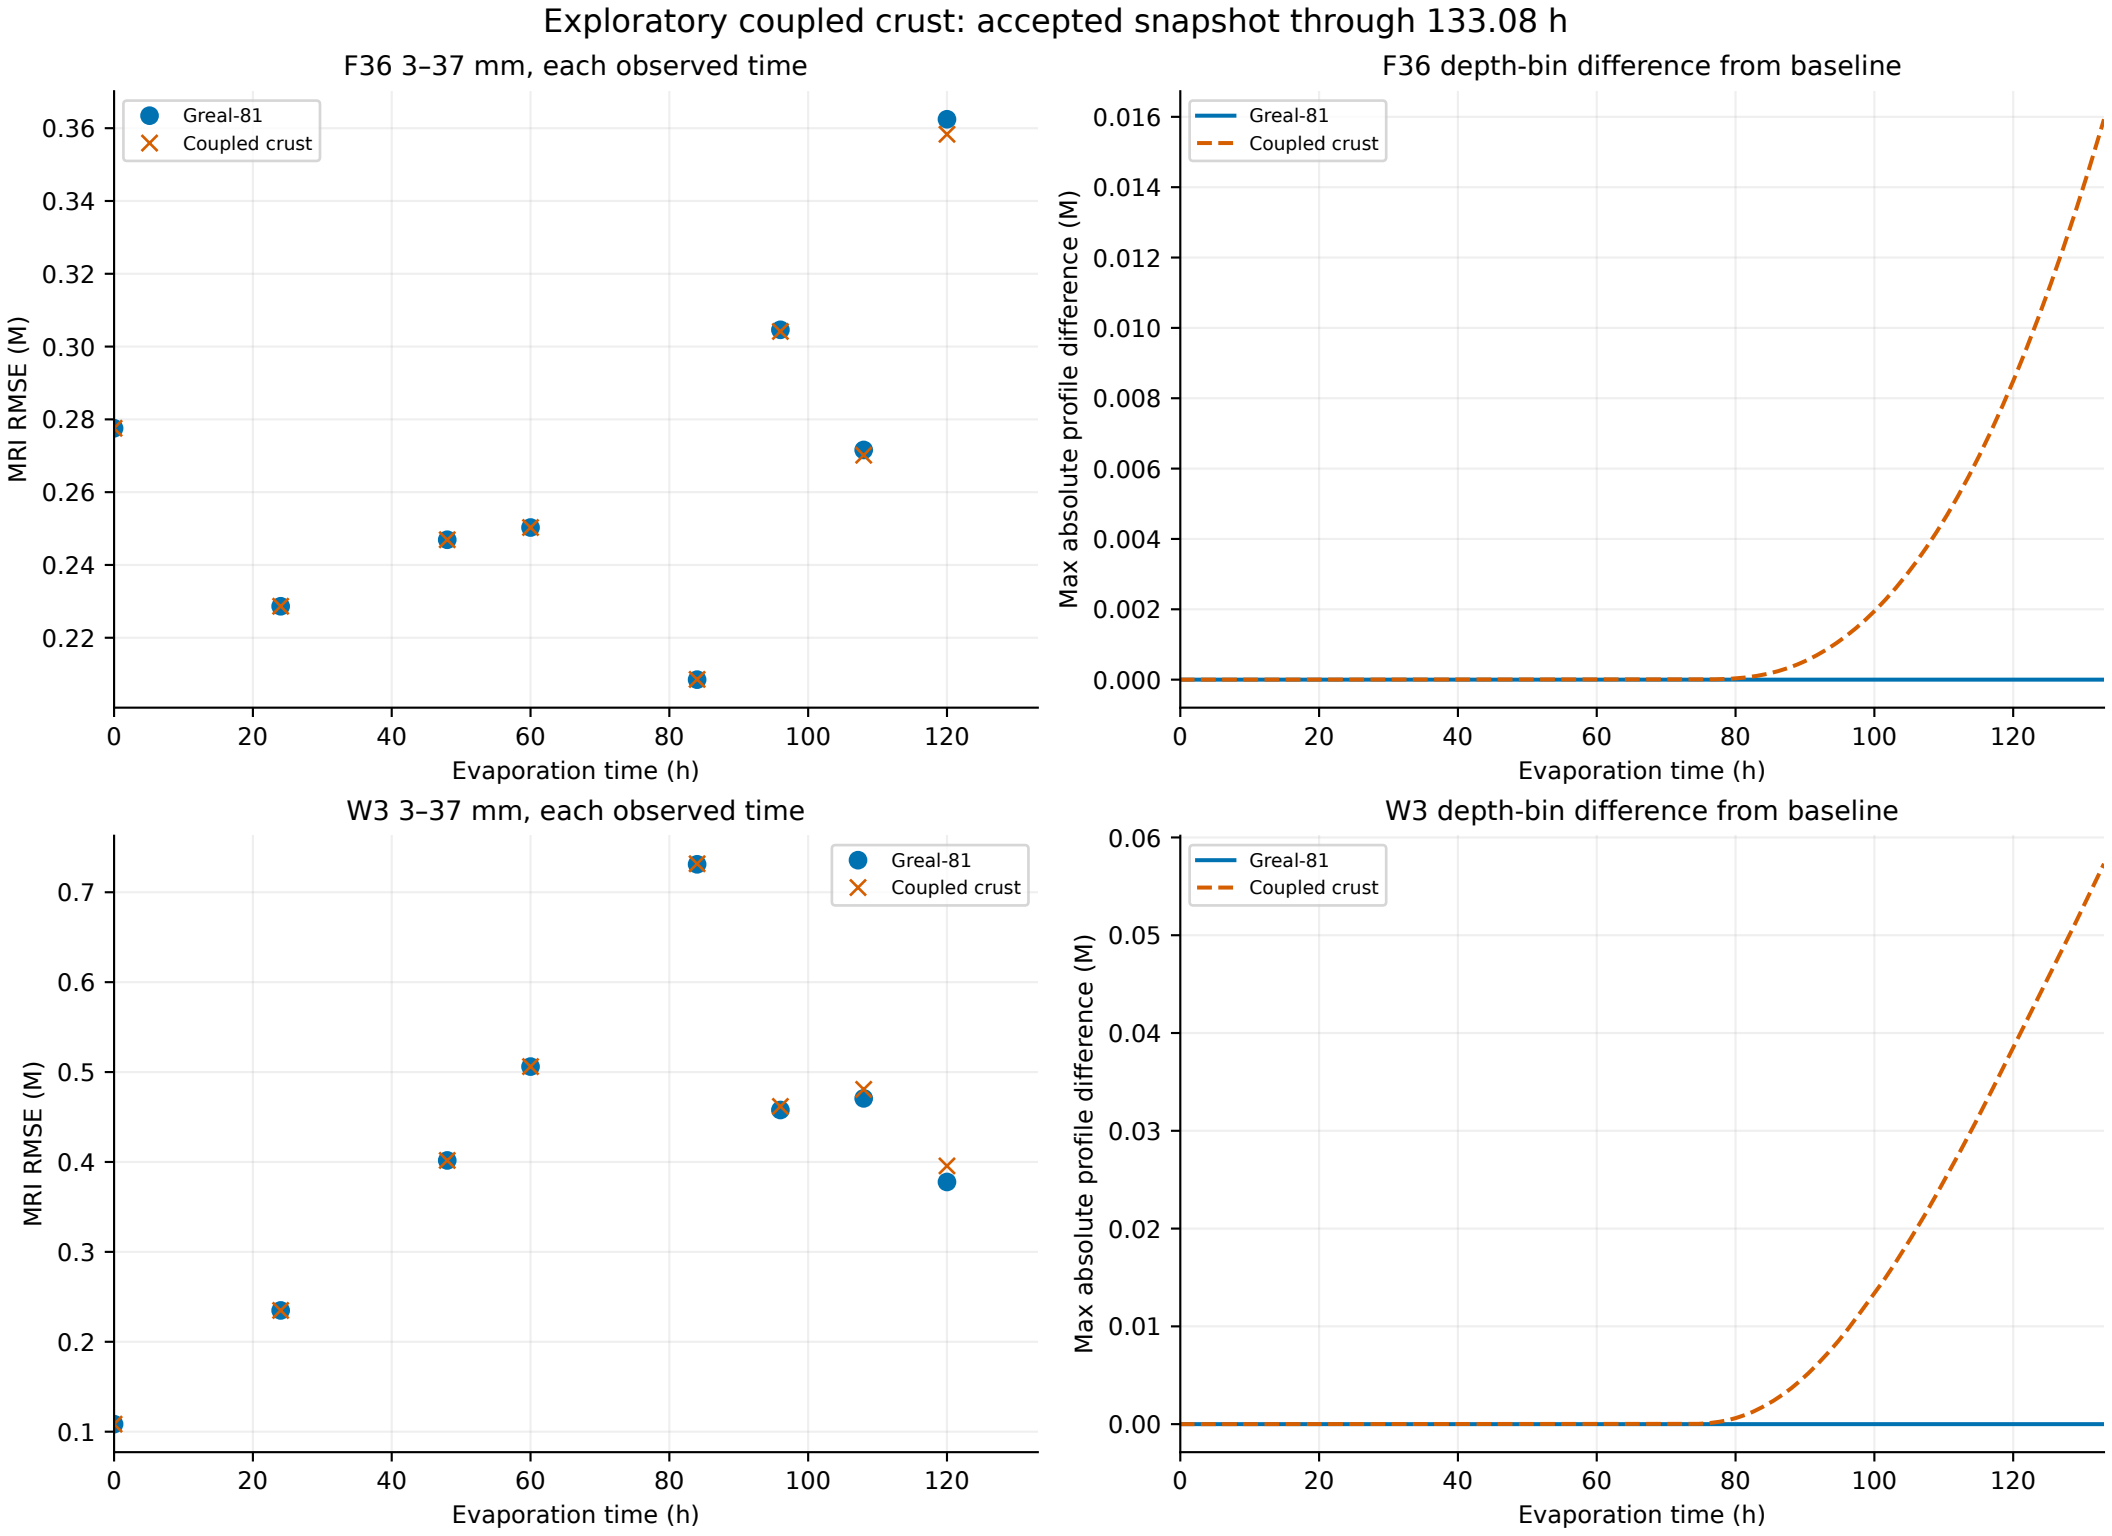
Exploratory coupled crust: accepted snapshot through 133.08 h
F36 3–37 mm, each observed time
Greal-81
Coupled crust
MRI RMSE (M)
Evaporation time (h)
F36 depth-bin difference from baseline
Max absolute profile difference (M)
W3 3–37 mm, each observed time
W3 depth-bin difference from baseline