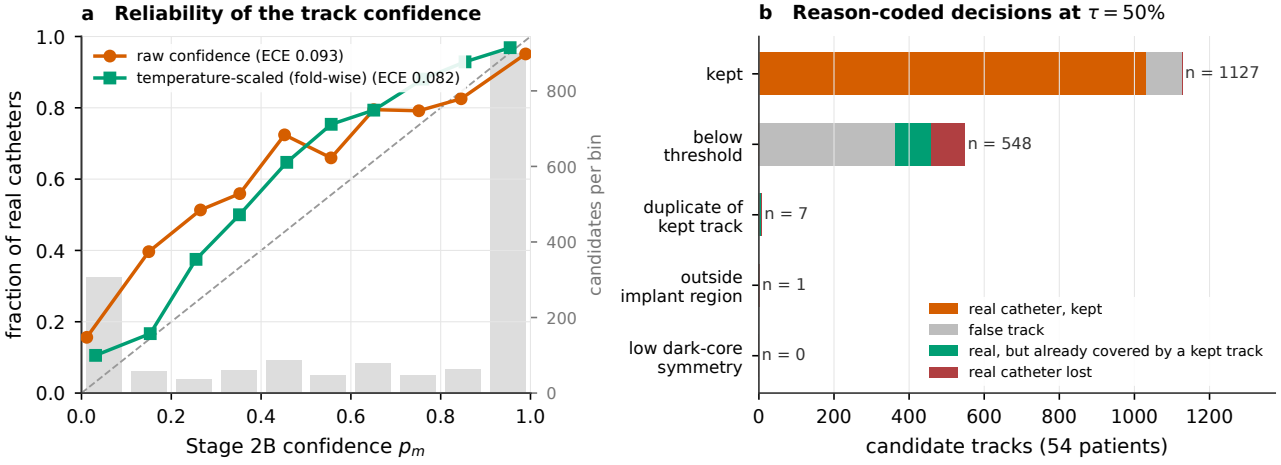
a Reliability of the track confidence
raw confidence (ECE 0.093)
temperature-scaled (fold-wise) (ECE 0.082)
fraction of real catheters
candidates per bin
Stage 2B confidence p_m
b Reason-coded decisions at $\tau = 50\%$
kept
below threshold
duplicate of kept track
outside implant region
low dark-core symmetry
n = 1127
n = 548
n = 7
n = 1
n = 0
real catheter, kept
false track
real, but already covered by a kept track
real catheter lost
candidate tracks (54 patients)