

AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT			BPA NO.		1. CONTRACT ID CODE		PAGE 1 OF 5 PAGES		
2. AMENDMENT/MODIFICATION NUMBER 0002			3. EFFECTIVE DATE 04-28-2025		4. REQUISITION/PURCHASE REQ. NUMBER 549-25-3-5096-0134			5. PROJECT NUMBER (if applicable)	
6. ISSUED BY Department Of Veterans Affairs Network Contracting Office 17 5441 Babcock Road Ste. 302 San Antonio TX 78240			CODE 36C257		7. ADMINISTERED BY (If other than Item 6) Department Of Veterans Affairs Network Contracting Office 17 5441 Babcock Road Ste. 302 San Antonio TX 78240			CODE 36C257	
8. NAME AND ADDRESS OF CONTRACTOR (Number, street, county, State and ZIP Code) To all Offerors/Bidders					(X)	9A. AMENDMENT OF SOLICITATION NUMBER 36C25725Q0463			
					☒	9B. DATED (SEE ITEM 11)			
					☐	10A. MODIFICATION OF CONTRACT/ORDER NUMBER			
					☐	10B. DATED (SEE ITEM 13)			
CODE			FACILITY CODE						
11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS									
☒ The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offers ☒ is extended, ☐ is not extended. Offers must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended, by one of the following methods: (a) By completing Items 8 and 15, and returning <u>1</u> copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or electronic communication which includes a reference to the solicitation and amendment numbers. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment you desire to change an offer already submitted, such change may be made by letter or electronic communication, provided each letter or electronic communication makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified. ** HOUR & DATE for Receipt of Offers is EXTENDED to: 05-01-2025 11AM CDT									
12. ACCOUNTING AND APPROPRIATION DATA (If required)									
13. THIS ITEM APPLIES ONLY TO MODIFICATIONS OF CONTRACTS/ORDERS, IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.									
CHECK ONE	A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.								
☐	B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(b).								
☐	C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:								
☐	D. OTHER (Specify type of modification and authority)								
E. IMPORTANT: Contractor ☐ is not, ☒ is required to sign this document and return <u>1</u> copies to the issuing office.									
14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.) The purpose of this amendment is to: 1. Provide answers to questions. 2. Provide a copy of the site visit sign-in sheet. 3. Extend the solicitation response due time and date. See block 11 for the extension period.									
Except as provided herein, all terms and conditions of the document referenced in Item 9A or 10A, as heretofore changed, remains unchanged and in full force and effect.									
15A. NAME AND TITLE OF SIGNER (Type or print)					16A. NAME AND TITLE OF CONTRACTING OFFICER (Type or print)				
15B. CONTRACTOR/OFFEROR (Signature of person authorized to sign)			15C. DATE SIGNED		16B. UNITED STATES OF AMERICA (Signature of Contracting Officer)			16C. DATE SIGNED	

CONTINUATION PAGE

Questions & Answers

RFQ 36C25725Q0463 Amendment 0002

NTX Replacement of Steam Coils

Q1. Are we replacing the entire ductwork in the building per the second statement "all new ducting is required..."?

A1. In building 9 we will be replacing all of the ductwork.

Q2. Are we reusing the ceiling tiles or replacing them if ductwork is being replaced?

A2. We will be reusing the current ceiling tiles.

Q3. Will the building be empty during the project?

A3. The buildings will remain partially occupied during the installation. Staff may be relocated as needed.

Q4. Existing ductwork is all flex, if all ductwork is required, will hard or flex ductwork be required?

A4. Ducting should be replaced with hard ducting as this is not a residential building.

Q5. Will the project hours be after-hours or will it follow a specific schedule/phases?

A5. Contractor will have access to the inside of the buildings during normal business hours. M-F 0800-1700 anything outside of this time can be coordinated with COR.

Q6. Are there drawings for Building 9 showing new outside pads and the drawings for existing ductwork and new ductwork?

A6. There are no drawings

Q7. Where are the existing gas lines located and are they capable of handling the required gas for the new outside units?

A7. There is already gas to the building at the building contractor will be responsible for routing the line to the new gas unit.

Q8. How will Building 9 be closed for phasing so that ductwork can be demoed and new ductwork installed? What hours can the contractor perform work on the inside ductwork?

A8. Contractor shall submit a schedule so staff can be relocated as need.

Q9. Can any information be provided on the existing equipment?

A9. Information on existing equipment is provided in SOW.

Q10. TT-54, will a crane be able to operate during the day swinging equipment over the top of the building?

A10. In the event you need a Lift/Crane Plan. Lift/ Crane Plan must be submitted, reviewed and approved by Construction Safety Officer/ Safety 14 days prior to use.

1. Lift Plans ___/___ Ton Crane
2. Operators Certificate
3. Riggers Certification
4. Annual Inspection ___/___ Ton Crane
5. Load Chart ___/___ Ton Crane
6. Crane Locations ___/___ Ton Crane
7. Accident Hazardous Analysis

Q11. Is there a specific type of thermostat desired?

A11. No specific type of thermostat is desired.


Q12. Does the thermostat need to have BACNet capabilities?

A12. No, the thermostat does not need to have BACNet capabilities.

Q13. Will drawings be provided for building 9?

A13. There are no drawings for building 9.

ACES	
Total	37

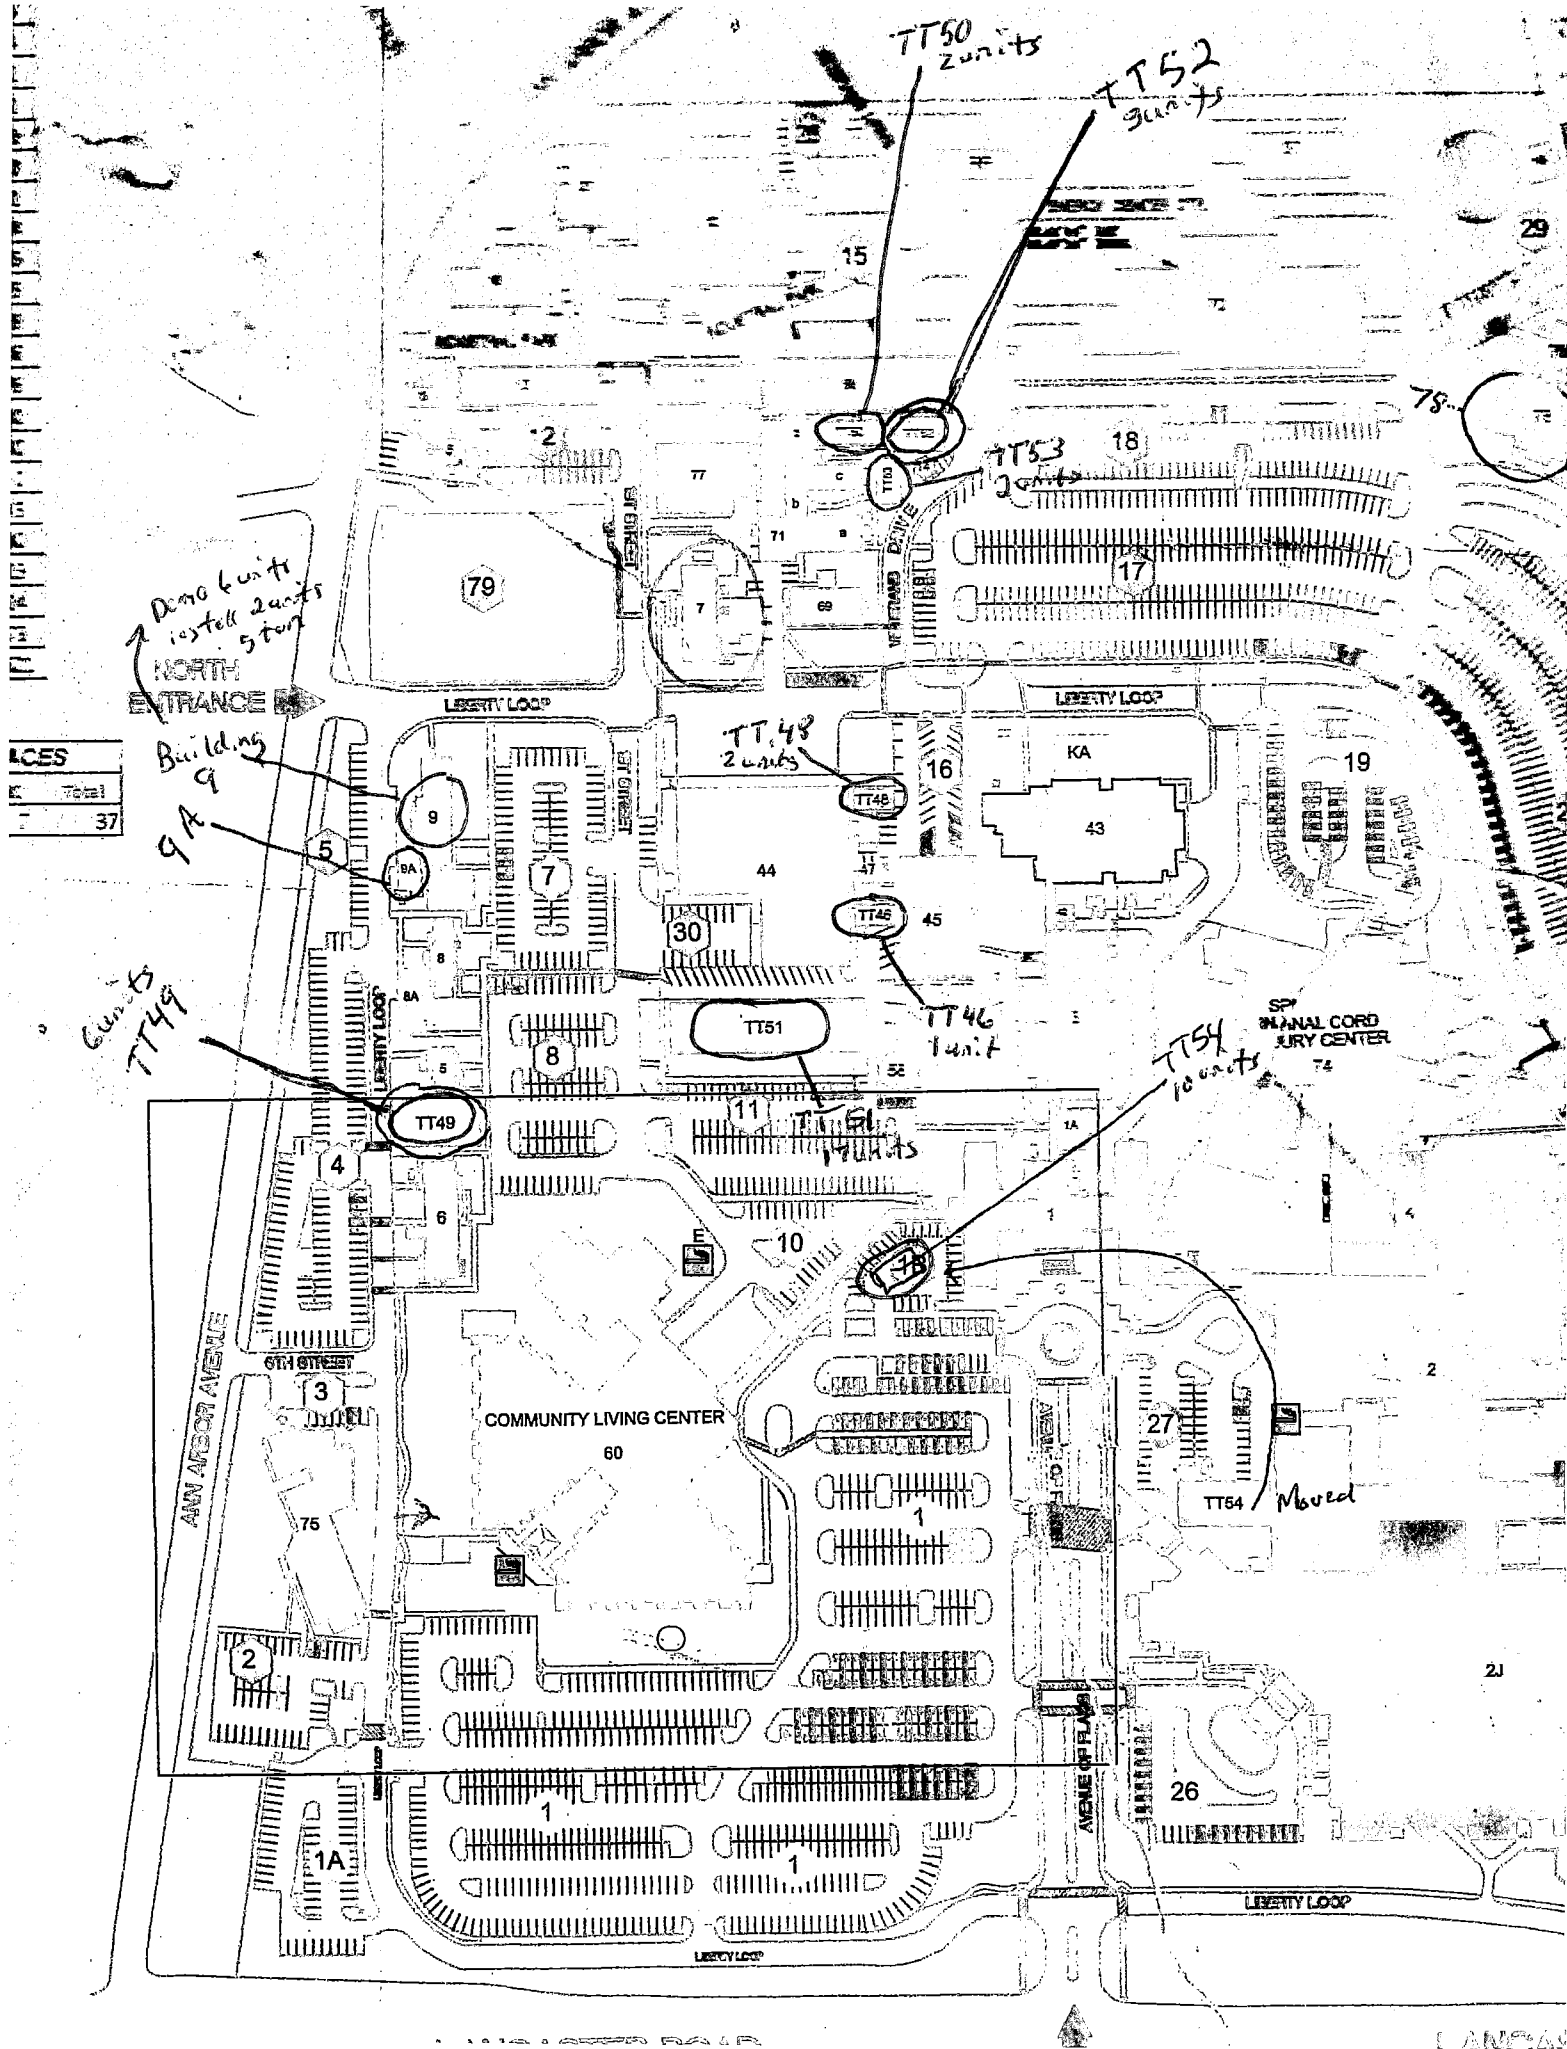

ATTENDANCE ROSTER			
Project:	HVAC UNIT PLACEMENT Sol# 36C257-25-AP-1999	Meeting Date:	APRIL 09, 2025 @ 09:00 AM CT
Facilitator:	Jerry Reese	Place/Room:	NTVHCS, 4500 S. Lancaster Rd., Bldg. 9, Dallas, TX 75216

Name	Company	Phone	E-Mail
Robert Hopson	RLP Mechanical	214-980-0674	rhopson@RLP.mechanical.com
Matthew Elledge	Dyche Ind.	682-847-0781	melledge@dychelindustrial.com
Cody Brown	Tx Mechanical	210-996-6553	cody@txmechanical.net
Brec Earp	Tx Mechanical	732-677-9183	Brec@txmechanical.net
Wes Farley	PM G	214-280-6056	wes.farley@Dom@service.com
Alarion Cooper	Arlos Group	682-402-7292	acooper@arlosmanagement.com
Will Ramsey	RMS Blackhawk construction	817-233-3510	Will@RSTRadestx.com
Tristan Bowens	George McKenna Electric	817-791-9816	TBowens@george-mckenna.com
Ed Crowley	George McKenna Electric	781-838-0703	ecrowley@george-mckenna.com
James Carpenter	ACS	469-615-6819	james@innoservul.net
Julian Montoya	GCC Enterprises	214-923-2739	jmontoya@gccenterprises.com
Lorenzo Stokes	ACS	469-596-3588	lhorro5@yahoo.com
Aaron Eldredge	EBSS Unlimited	214-585-7976	Estimating@EBSS.ME
Zach Allison	Air Texas Mechanical	817-368-8818	zallison@airTexasmechanical.com
Ryan Philpot	Dyche Ind.	214-440-8787	rphilpot@dychelindustrial.com
Ivory Nero	Numinious Supports NS	215-480-8986	monique.nero@gmail.com