



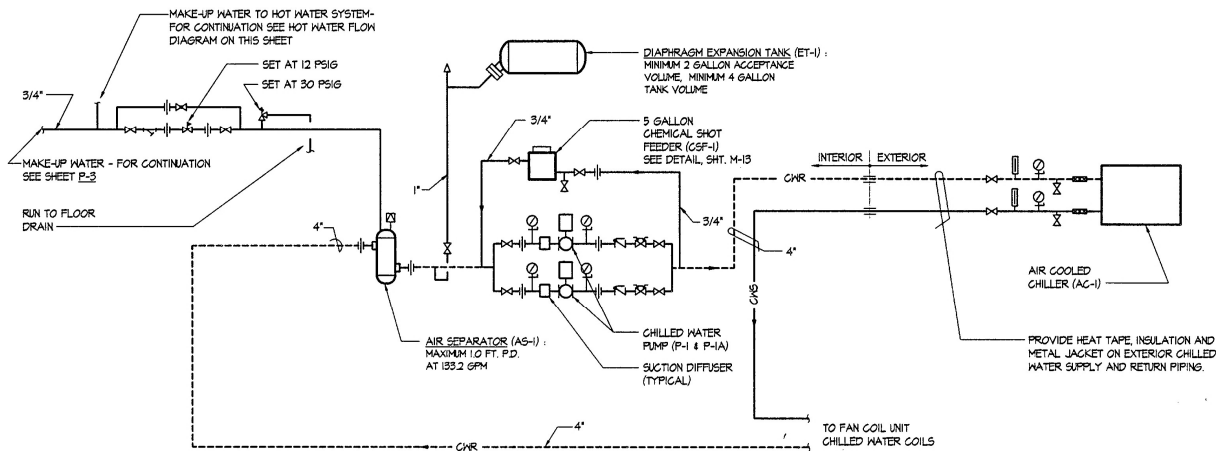


CHILLED WATER FLOW DIAGRAM

NO SCALE

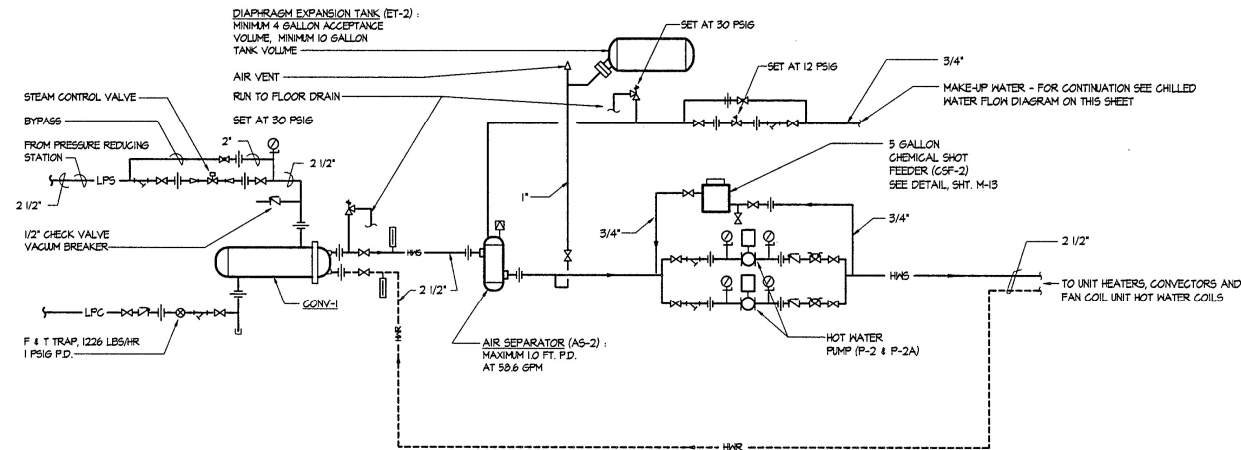

HOT WATER FLOW DIAGRAM

NO SCALE

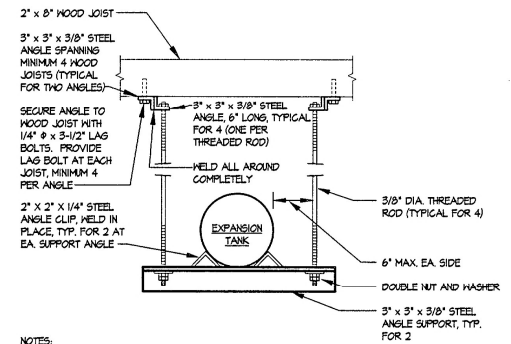


NOTES:

1. MOUNT EXPANSION TANK APPROX. 12'-0" FT. ABOVE FLOOR.

EXPANSION TANK MOUNTING DETAIL

NO SCALE

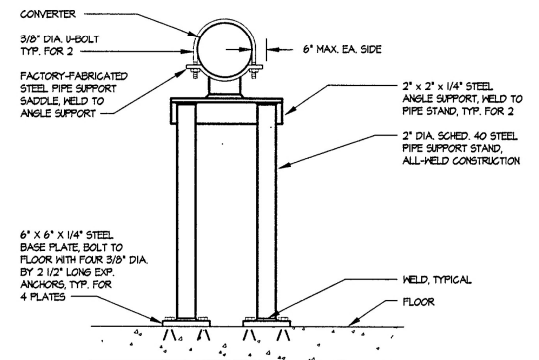

NOTES:

1. MOUNT CONVERTOR APPROX. 48" ABOVE FLOOR.

2. PROVIDE SUPPORT SPACING AND NUMBER OF SUPPORTS AS RECOMMENDED BY THE CONVERTER MFR.

CONVERTER MOUNTING DETAIL

NO SCALE

		HUDSON + ASSOC'S, ARCHITECTS 503 BOTEBOUR STREET NORFOLK, VA. 23510		DEPARTMENT OF THE NAVY NAVAL PUBLIC WORKS CENTER NORFOLK, VA.	
		JOB ORDER NO. 1323093 DES. NKC/DR. WGB (CH. PDP) DR. WGB/J.H. SALLEY, JR. SUBMITTED BY: DATE:		NAVY ORDER NO. 1323093 CIRCULAR AREA ADDITIONS & RENOVATIONS TO BUILDINGS NH-15, NH-16, & NH-17	
DR. J. STARK CH. DR. R.H. IVES, JR. DES. CORP. DES. DR. FELTES (SCOUT) 10/16/94 DR.		HVC PIPING DIAGRAMS		DR. CODE IDENT NO. 80091 NAVFAC DRAWING NO. 4287,834 PWC DRAWING NO. 15060EB	
APPROVED: <i>Tom Salley</i> FOR C.B. FOR CHAIRMAN OFFICE:		COMB. CONTR. NO. N62470-94-B-2232 SPEC 05-94-2232		SHEET 58 OF 78	

DRAWING DATE