



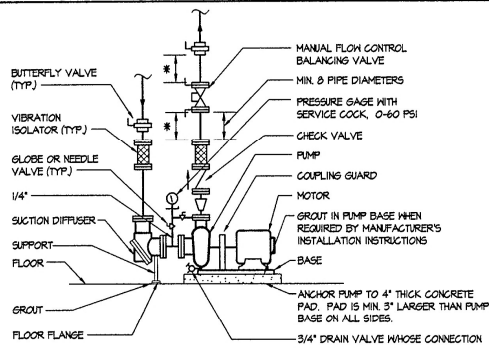


- STRAIGHT LENGTHS OF UNOBSTRUCTED PIPE WITHOUT INLINE APPURTENANCES SHALL BE INSTALLED UP / DOWNSTREAM OF FLOW CONTROL BALANCING VALVE PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.


BASE MOUNTED CENTRIFUGAL PUMP DETAIL (P-1 & 1A)
NO SCALE

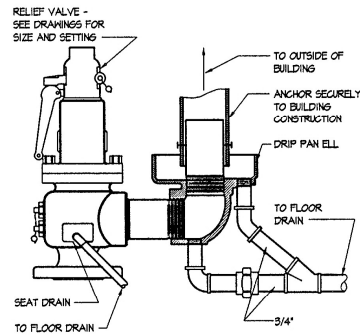


STEAM RELIEF VALVE DRIP PAN ELL
NO SCALE

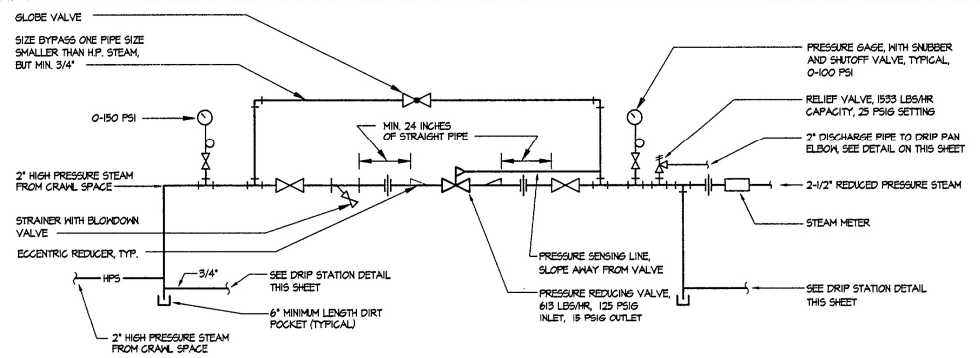


STEAM PRESSURE REDUCING STATION DETAIL
NO SCALE

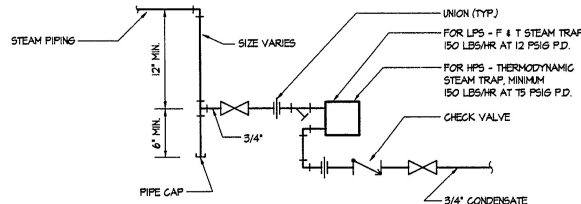

DRIP STATION DETAIL
NO SCALE

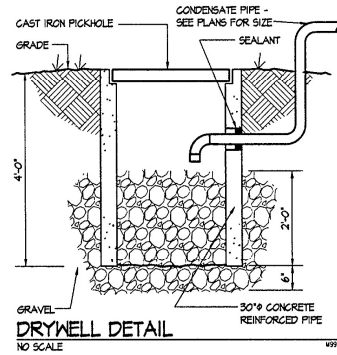


DRYWELL DETAIL
NO SCALE

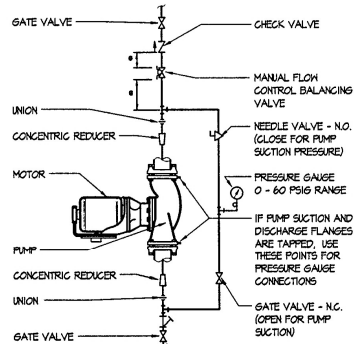


- STRAIGHT LENGTHS OF UNOBSTRUCTED PIPE WITHOUT INLINE APPURTENANCES SHALL BE INSTALLED UP / DOWNSTREAM OF FLOW CONTROL BALANCING VALVE PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.

INLINE CENTRIFUGAL PUMP DETAIL (P-2 & 2A)
NO SCALE

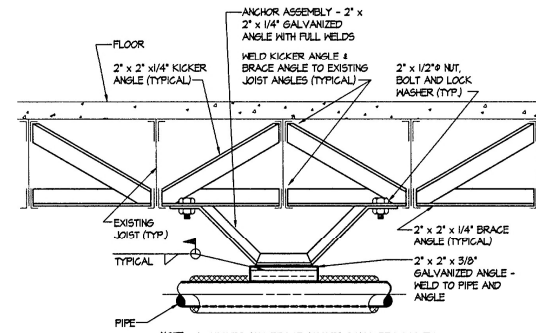

PIPE ANCHOR DETAIL
NO SCALE

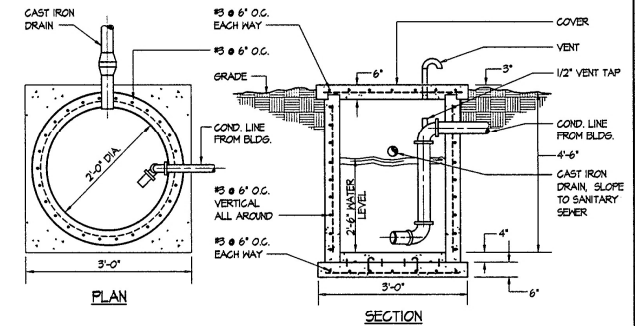

CONDENSATE COOLING WELL DETAIL
NO SCALE

		M-13	
		NAVY PUBLIC WORKS CENTER	
ADDITIONS & RENOVATIONS TO BUILDINGS NH-15, NH-16, & NH-17		HVAC DETAILS	
DR. CODE IDENT. NO.	80091	NAVFAC DRAWING NO.	4,287,837
CONSTR. CONTR. NO.	N62470-94-B-2232	PWC DRAWING NO.	15060HB
SCALE: NONE	SPRC: 05-94-2232	SHEET 61 OF 78	

DRAWING DATE: _____