REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62

CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM
2400 HOSPITAL ROAD
TUSKEGEE, AL 36083

VA PROJECT #: 619A4-24-102

PROJECT SITE MAP

AREIAL VIEW
CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM - EAST CAMPUS
2400 HOSPITAL ROAD
TUSKEGEE, AL 36083

PROJECT LOCATION MAP

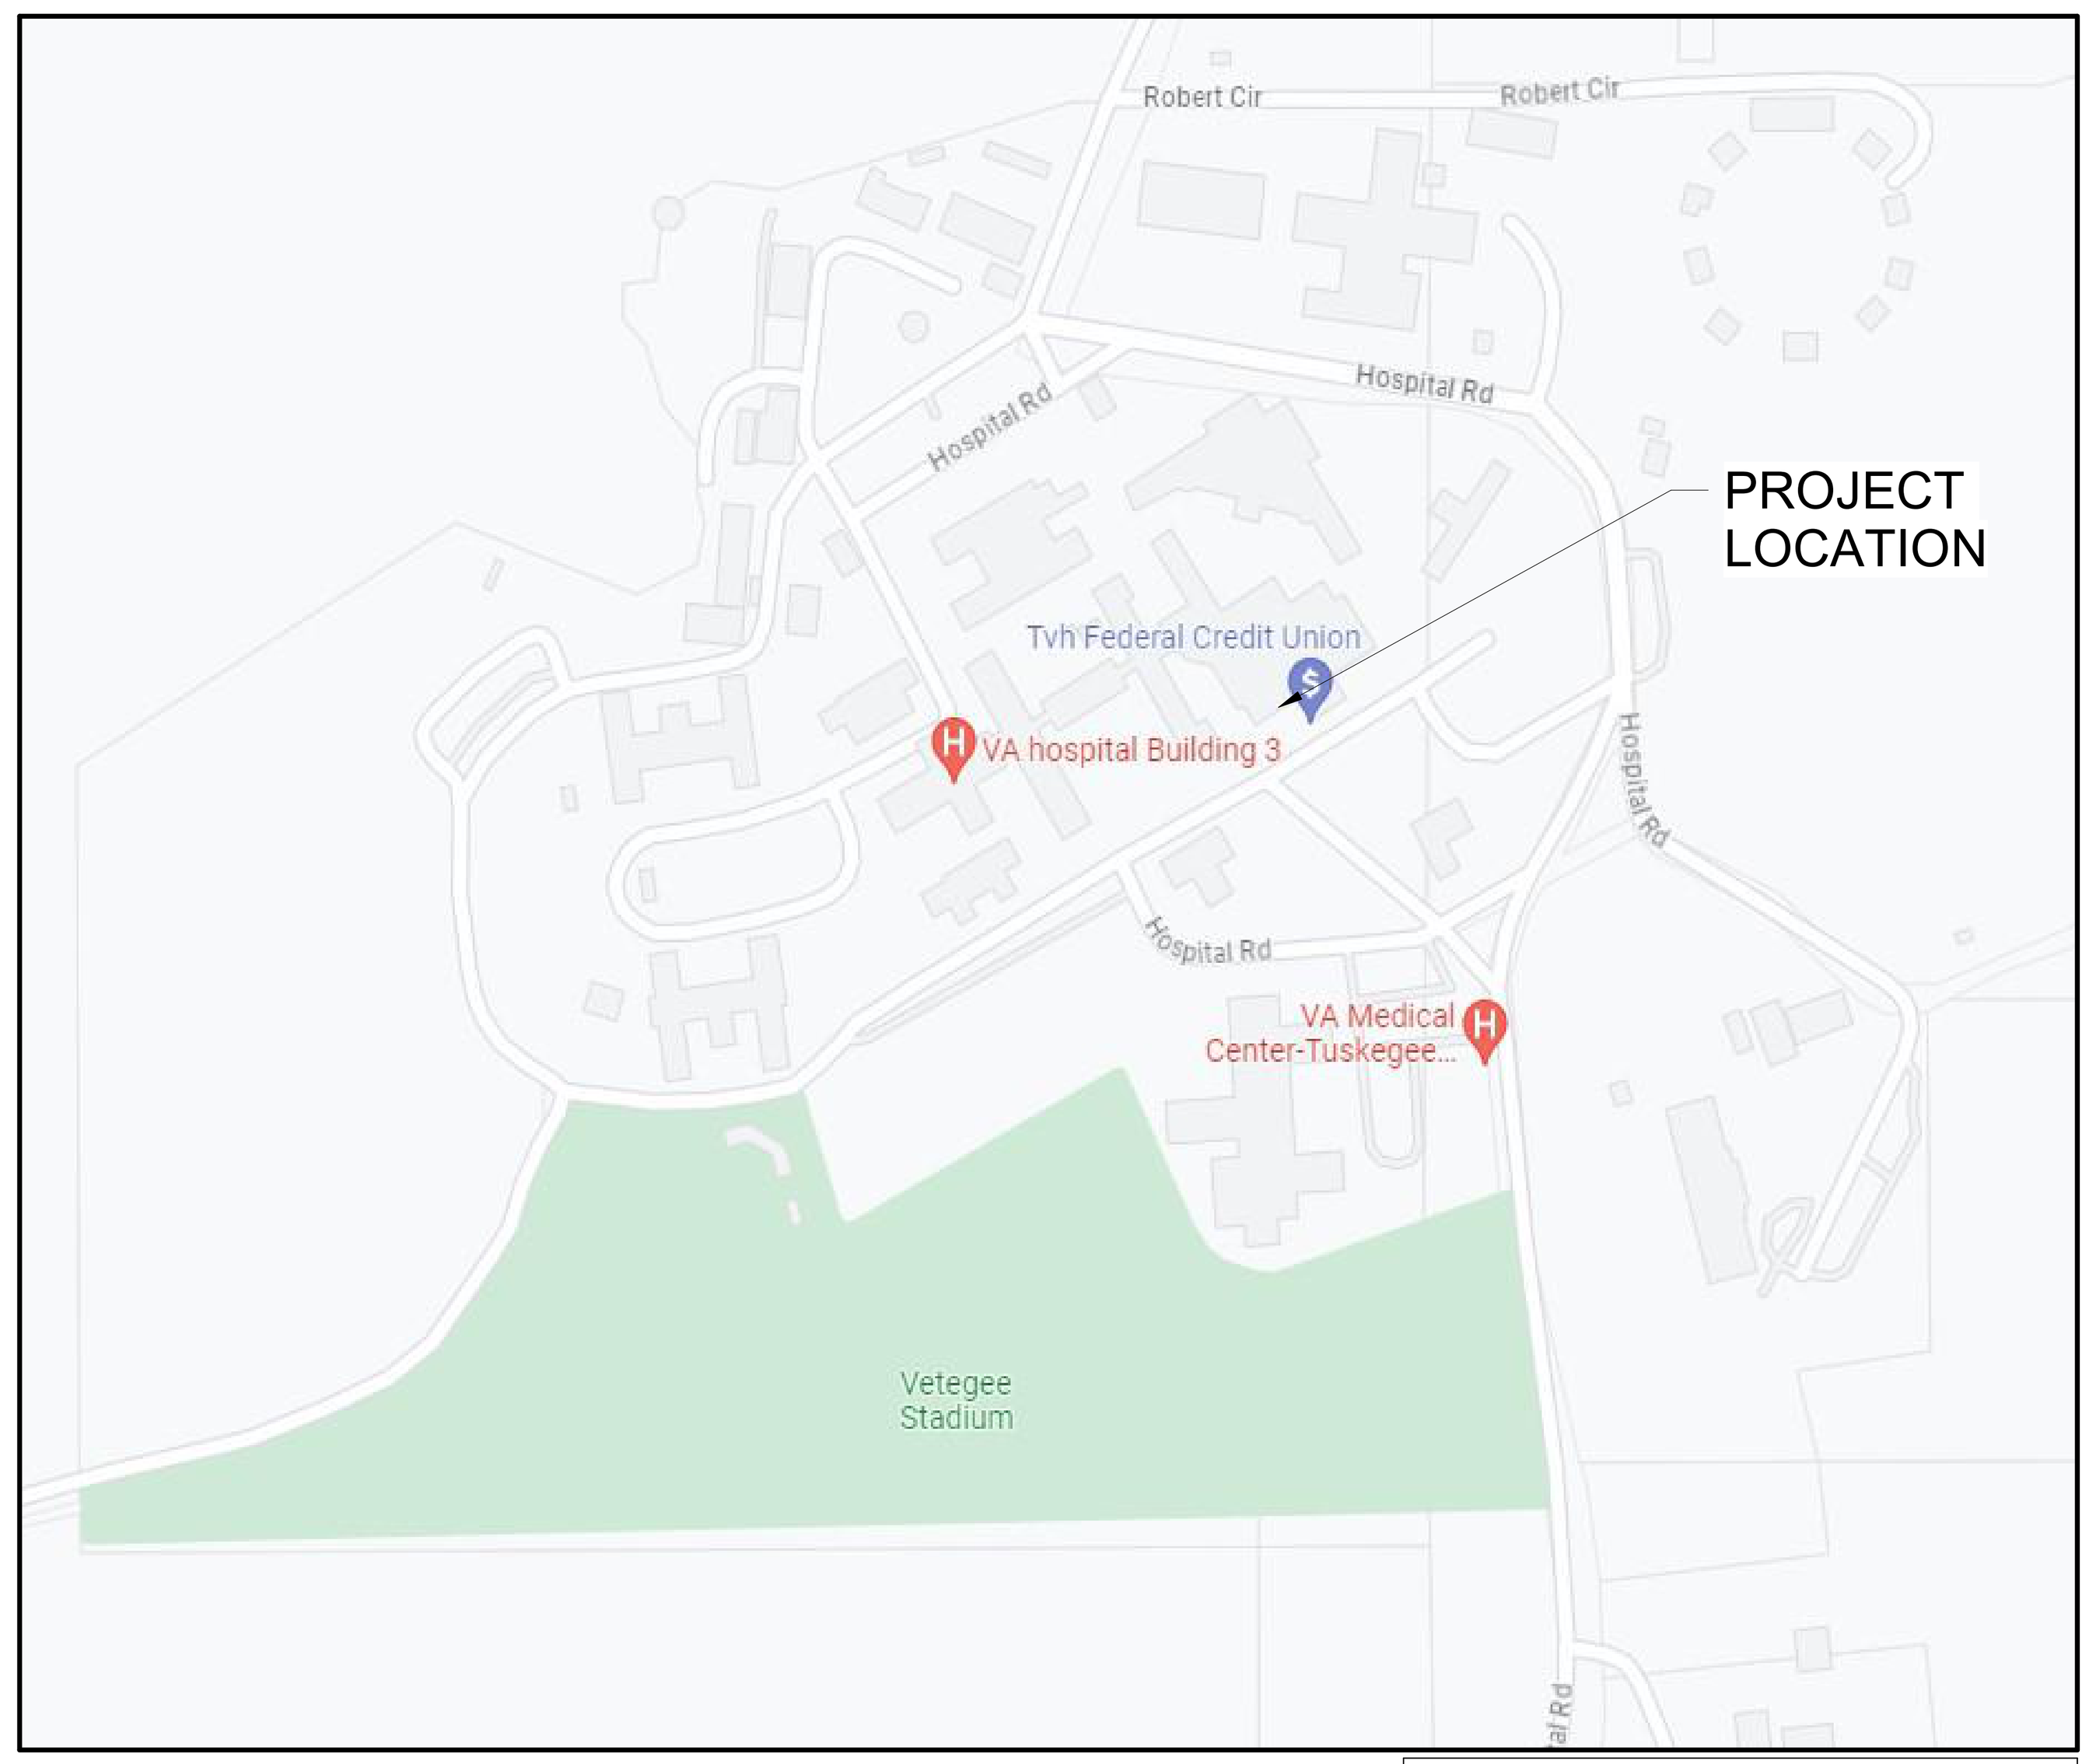

CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM - EAST CAMPUS
2400 HOSPITAL ROAD
TUSKEGEE, AL 36083

PROJECT IMAGE

SHEET LIST

SHEET NUMBER	SHEET NAME	DWG	OF DWG
GENERAL			
G-001	COVER	1	3
G-002	GENERAL INFORMATION	2	3
GC101	SITE PLAN	3	3
ARCHITECTURAL			
A-001	ARCHITECTURAL REPAIR ITEMS AND QUANTITIES	1	14
19.AD101	BUILDING 19 DEMOLITION ROOF PLAN	2	14
19.A-101	BUILDING 19 ROOF PLAN	3	14
20.AD101	BUILDING 20 DEMOLITION ROOF PLAN	4	14
20.A-101	BUILDING 20 ROOF PLAN	5	14
50.AD101	BUILDING 50 DEMOLITION ROOF PLAN	6	14
50.A-101	BUILDING 50 ROOF PLAN	7	14
51.AD101	BUILDING 51 DEMOLITION ROOF PLAN	8	14
51.A-101	BUILDING 51 ROOF PLAN	9	14
62.AD101	BUILDING 62 DEMOLITION ROOF PLAN	10	14
62.A-101	BUILDING 62 ROOF PLAN	11	14
A-501	ROOF DETAILS	12	14
A-502	ROOF DETAILS	13	14
A-503	ROOF DETAILS	14	14
ELECTRICAL			
19.E-101	BUILDING 19 ROOF LIGHTNING PROTECTION PLAN	1	6
20.E-101	BUILDING 20 ROOF LIGHTNING PROTECTION PLAN	2	6
50.E-101	BUILDING 50 ROOF LIGHTNING PROTECTION PLAN	3	6
51.E-101	BUILDING 51 ROOF LIGHTNING PROTECTION PLAN	4	6
62.E-101	BUILDING 62 ROOF LIGHTNING PROTECTION PLAN	5	6
E-501	LIGHTNING PROTECTION DETAILS	6	6

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

PROJECT MANAGER

ACG Project Number 23-069

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: COVER

Project Title: REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62

VA PROJECT NUMBER: 619A4-24-102

Building Number: # 19, 20, 50, 51, AND 62

Location: CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM
2400 HOSPITAL ROAD
TUSKEGEE, AL 36083

Approved:

Date: JUNE 19, 2024 | Checked: WVS | Drawn: RF

Drawing Number: G-001

Dwg 1 of 3

GENERAL NOTES

1. ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH ALL PUBLISHED APPLICABLE LOCAL / STATE / FEDERAL / NATIONAL CODES, ORDINANCES AND REGULATIONS ALONG WITH ALL RELATED VA DIRECTIVES, DESIGN GUIDES AND MANUALS, SPECIFICATIONS THAT ARE PROJECT SPECIFIC.
2. EACH CONTRACTOR SHALL HAVE LIABILITY, PROPERTY DAMAGE AND WORKMAN'S COMPENSATION INSURANCE AS REQUIRED BY THE VA IN THE BIDDING DOCUMENTATION. CONTACT THE VA/CO DURING THE BIDDING PHASE WITH ANY QUESTIONS, VERIFICATIONS, AND DOCUMENTATION NECESSARY CONCERNING ALL REQUIREMENTS FOR PROJECT INSURANCE COVERAGE.
3. BEFORE SUBMITTING A BID, ALL CONTRACTORS WILL CAREFULLY EXAMINE THE DRAWINGS AND SPECIFICATIONS SO AS TO BE THOROUGHLY FAMILIAR WITH ALL THE CONTRACT REQUIREMENTS. EACH BIDDER SHOULD THEN VISIT THE SITE OF THE WORK TO BECOME ACQUAINTED WITH ALL VISIBLE FIELD CONDITIONS AFFECTING THE CONTRACT, SUCH AS OBSTACLES WHICH MAY BE ENCOUNTERED AND ALL OTHER CONDITIONS RELATIVE TO WHAT COULD AFFECT/IMPACT THE WORK OR BE AFFECTED BY THE PERFORMANCE OF THE WORK.
4. IF AWARDED THE CONTRACT, THE CONTRACTORS SHALL NOT BE ALLOWED ANY EXTRA COMPENSATION BY REASON OF ANY UNFORESEEN DIFFICULTIES OR OBSTACLES WHICH THE BIDDER COULD HAVE REASONABLY ANTICIPATED PRIOR TO BIDDING. SHOULD ANY DISCREPANCIES, ERRORS, CONFLICT OR ITEMS NEEDING CLARIFICATION BE DISCOVERED IN THE PLANS AND/OR SPECIFICATIONS, THE CONTRACTOR SHALL NOTIFY THE VA/CO PRIOR TO SUBMITTING A BID AND THE VA/COR BEFORE STARTING ANY OF THE WORK.DRAWINGS ARE PREPARED USING DIMENSIONS AND PRODUCT DRAWINGS FOR SPECIFIC PRODUCTS. DETAILS FOR SPECIFIC PRODUCTS MAY CHANGE BEFORE THEY ARE ACTUALLY INCORPORATED INTO THE WORK, AND PRODUCTS BY OTHER MANUFACTURERS ARE ALSO ACCEPTABLE. THEREFORE, INSTALLATION DETAILS AND DIMENSIONS MAY DIFFER FROM THOSE SHOWN. CONTRACTOR SHALL VERIFY INSTALLATION REQUIREMENTS FOR ALL PRODUCTS TO BE INCORPORATED IN THE WORK
5. THE DOCUMENTS DO NOT AND ARE NOT INTENDED TO INDICATE OR DESCRIBE IN DETAIL ALL THE NECESSARY WORK REQUIRED FOR FULL PERFORMANCE AND COMPLETION OF THE REQUIREMENTS OF THE CONTRACT. ON THE BASIS OF THE GENERAL SCOPE INDICATED IN THESE DOCUMENTS, THE TRADE CONTRACTORS SHALL FURNISH ALL ITEMS REQUIRED FOR THE PROPER EXECUTION AND COMPLETION OF THEIR WORK.
6. THE DRAWINGS AND SPECIFICATIONS ARE COMPLEMENTARY; ITEMS SHOWN IN ANY ONE LOCATION IN THE DRAWINGS SHALL BE CONSIDERED TO BE REQUIREMENTS OF THE CONTRACT FOR CONSTRUCTION. IN THE EVENT OF AN INCONSISTENCY BETWEEN THE DRAWINGS AND SPECIFICATIONS, OR WITHIN EITHER DOCUMENT, THE CONTRACTOR SHALL SEEK CLARIFICATION OR INTERPRETATION FROM THE COR PRIOR TO BIDDING. WHERE INCONSISTENCIES ARE NOT CLARIFIED PRIOR TO BIDDING, AND WHERE THE ACTUAL SOLUTION OR INTENT CANNOT BE REASONABLY INFERRED, THE CONTRACTOR SHALL PROVIDE THE BETTER QUALITY OR GREATER QUANTITY OF WORK.
7. THE CONTRACTOR SHALL NOTIFY THE COR IMMEDIATELY SHOULD DISCREPANCIES BE FOUND IN THE DRAWINGS AND SPECIFICATIONS.
8. THE CONTRACTOR IS RESPONSIBLE FOR CHECKING ALL FIELD CONDITIONS AND DIMENSIONS AS THEY RELATE TO THIS PROJECT. SHOULD DISCREPANCIES EXIST BETWEEN THE WORK INDICATED AND ACTUAL FIELD CONDITIONS NOTIFY THE COR PRIOR TO BIDDING.
9. DO NOT SCALE THE DRAWINGS. DRAWING SCALES AS INDICATED ARE FOR REFERENCE ONLY AND ARE NOT INTENDED TO ACCURATELY DEPICT ACTUAL OR DESIGNATED CONDITIONS. WRITTEN DIMENSIONS SHALL GOVERN.
10. CONTRACTORS SHALL REFERENCE ALL DRAWINGS IN ALL SECTIONS OF WORK FOR FULLY DEFINING THEIR SCOPE OF WORK RESPONSIBILITIES AND COORDINATE SAME WITH THE GENERAL/PRIME CONTRACTOR. SUBCONTRACTORS AND SUPPLIERS FOR EACH TRADE ARE ADVISED THAT INFORMATION PERTINENT TO THEIR SCOPE OF WORK ALSO OCCURS IN OTHER SECTIONS OF THE DRAWINGS AND THE COMPLETE SET OF CONTRACT DOCUMENTS.
11. EACH CONTRACTOR SHALL MAINTAIN A COMPETENT OSHA-30 FOREMAN OR DIRECT REPRESENTATIVE ON THE JOB AT ALL TIMES. THE CONTRACTOR SHALL COOPERATE WITH AND COORDINATE WITH THE SUPERINTENDENT AND FOREMAN OF OTHER TRADES IN ORDER THAT THERE BE NO DELAYS IN THE EXECUTION AND COMPLETION OF THE WORK.
12. IT SHALL BE THE RESPONSIBILITY OF EACH CONTRACTOR TO ADEQUATELY PROTECT EXISTING CONSTRUCTION AND FINISHES TO REMAIN IN PLACE DURING BOTH DEMOLITION AND CONSTRUCTION SEQUENCES OF THE WORK. ANY DAMAGE TO SUCH AREAS SHALL BE RESTORED.
13. THE CONTRACTOR IS RESPONSIBLE FOR THE PATCH, REPAIR, REFINISHING AND/OR REPLACEMENT OF ALL CONSTRUCTION, MATERIALS, ASSEMBLIES, EQUIPMENT, SIGNAGE AND FINISHES DAMAGED BY THE PROJECT DEMOLITION, TEMPORARY CONSTRUCTION, NEW CONSTRUCTION OR THE MOVEMENT OF PERSONNEL, TOOLS, EQUIPMENT, MATERIALS, ETC. BOTH INSIDE AND OUTSIDE OF THE DESIGNATED AREAS OF WORK.
14. THE CONTRACTOR IS RESPONSIBLE TO PROVIDE THE REMOVAL OF ALL CONSTRUCTION DEMOLITION DEBRIS, SOIL AND MATERIALS FROM THE PROJECT SITE.
15. PROVIDE SEALANT AT ALL INTERSECTIONS BETWEEN DIFFERENT MATERIALS.
16. ALL WOOD IN CONTACT WITH CONCRETE SHALL BE PRESSURE TREATED.

DEMOLITION NOTES

1. REMOVE EXISTING CONSTRUCTION AS DESIGNATED AND CLEAR AREA OF DEBRIS PRIOR TO PROCEEDING WITH NEW CONSTRUCTION.
2. EXISTING EQUIPMENT REMOVED SHALL BE PROPERLY DISPOSED OFF PROJECT GROUNDS. COORDINATE WITH COR.
3. AT AREAS INDICATED TO BE PATCHED AND REPAIRED, FOR ADDITION AND RENOVATION PROJECTS: THE CONSTRUCTION AND ASSEMBLY OF THE PATCH OR REPAIR SHALL MATCH THE ASSEMBLY AND INTEGRITY OF THE ADJACENT EXISTING CONSTRUCTION, FOR FIRE RATING, MATERIALS, FINISH, THICKNESS, AND QUALITY.
4. COORDINATE WORKING HOURS ALLOWED FOR DEMOLITION AND WASTE REMOVAL WITH COR.
5. CONTRACTOR SHALL PROTECT AREA ADJACENT TO THE DEMOTION AND NEW CONSTRUCTION WORK TO PREVENT DAMAGES, (IF DAMAGED REPAIR, RE-PATCH, SAND SMOOTH AND REFINISH TO MATCH EXISTING.) REPAIR OR REPLACE ITEMS DAMAGED DURING CONSTRUCTION ACTIVITIES AT NO ADDITIONAL COST.
6. THE INFORMATION CONTAINED IN DEMOLITION DOCUMENTS DEFINES GENERAL SCOPE ONLY AND DOES NOT RELIEVE THE CONTRACTOR OF THE RESPONSIBILITY OF PROVIDING ALL DEMOLITION REQUIRED FOR THE COMPLETION OF THE PROJECT.
7. REFER TO THE ELECTRICAL DRAWINGS FOR FURTHER INFORMATION REGARDING INSTALLATION OF LIGHTING PROTECTION SYSTEM.
8. PRIOR TO SUBMITTING BID IDENTIFY ANY REQUIRED DEMOLITION BEYOND THE PROJECT SCOPE. NOTIFY AND THE COR.
9. ALL DEMOLITION WORK SHALL BE PERFORMED WITH DUE CARE AND DILIGENCE IN ORDER TO PREVENT DAMAGE OR INTERRUPTION OF SERVICE OR CONCEALED UTILITIES INTENDED TO REMAIN IN SERVICE. DISCOVERY OF UTILITIES OR CONDITIONS THAT ARE NOT IDENTIFIED AND AFFECT PROJECT CONSTRUCTION ARE TO BE REPORTED TO COR.
10. VERIFY ALL EXISTING CONDITIONS PRIOR TO BEGINNING WORK. NOTIFY COR AND ARCHITECT OF ANY CONFLICTS, PRIOR TO PROCEEDING WITH DEMOLITION WORK WITH LISTED QUANTITIES ON A-001.
11. NO DEMOLITION ITEMS ARE TO BE SALVAGED. ALL DEMOLITION DEBRIS TO BE DISPOSED OF OFF SITE.

ARCHITECTURAL SYMBOL LEGEND

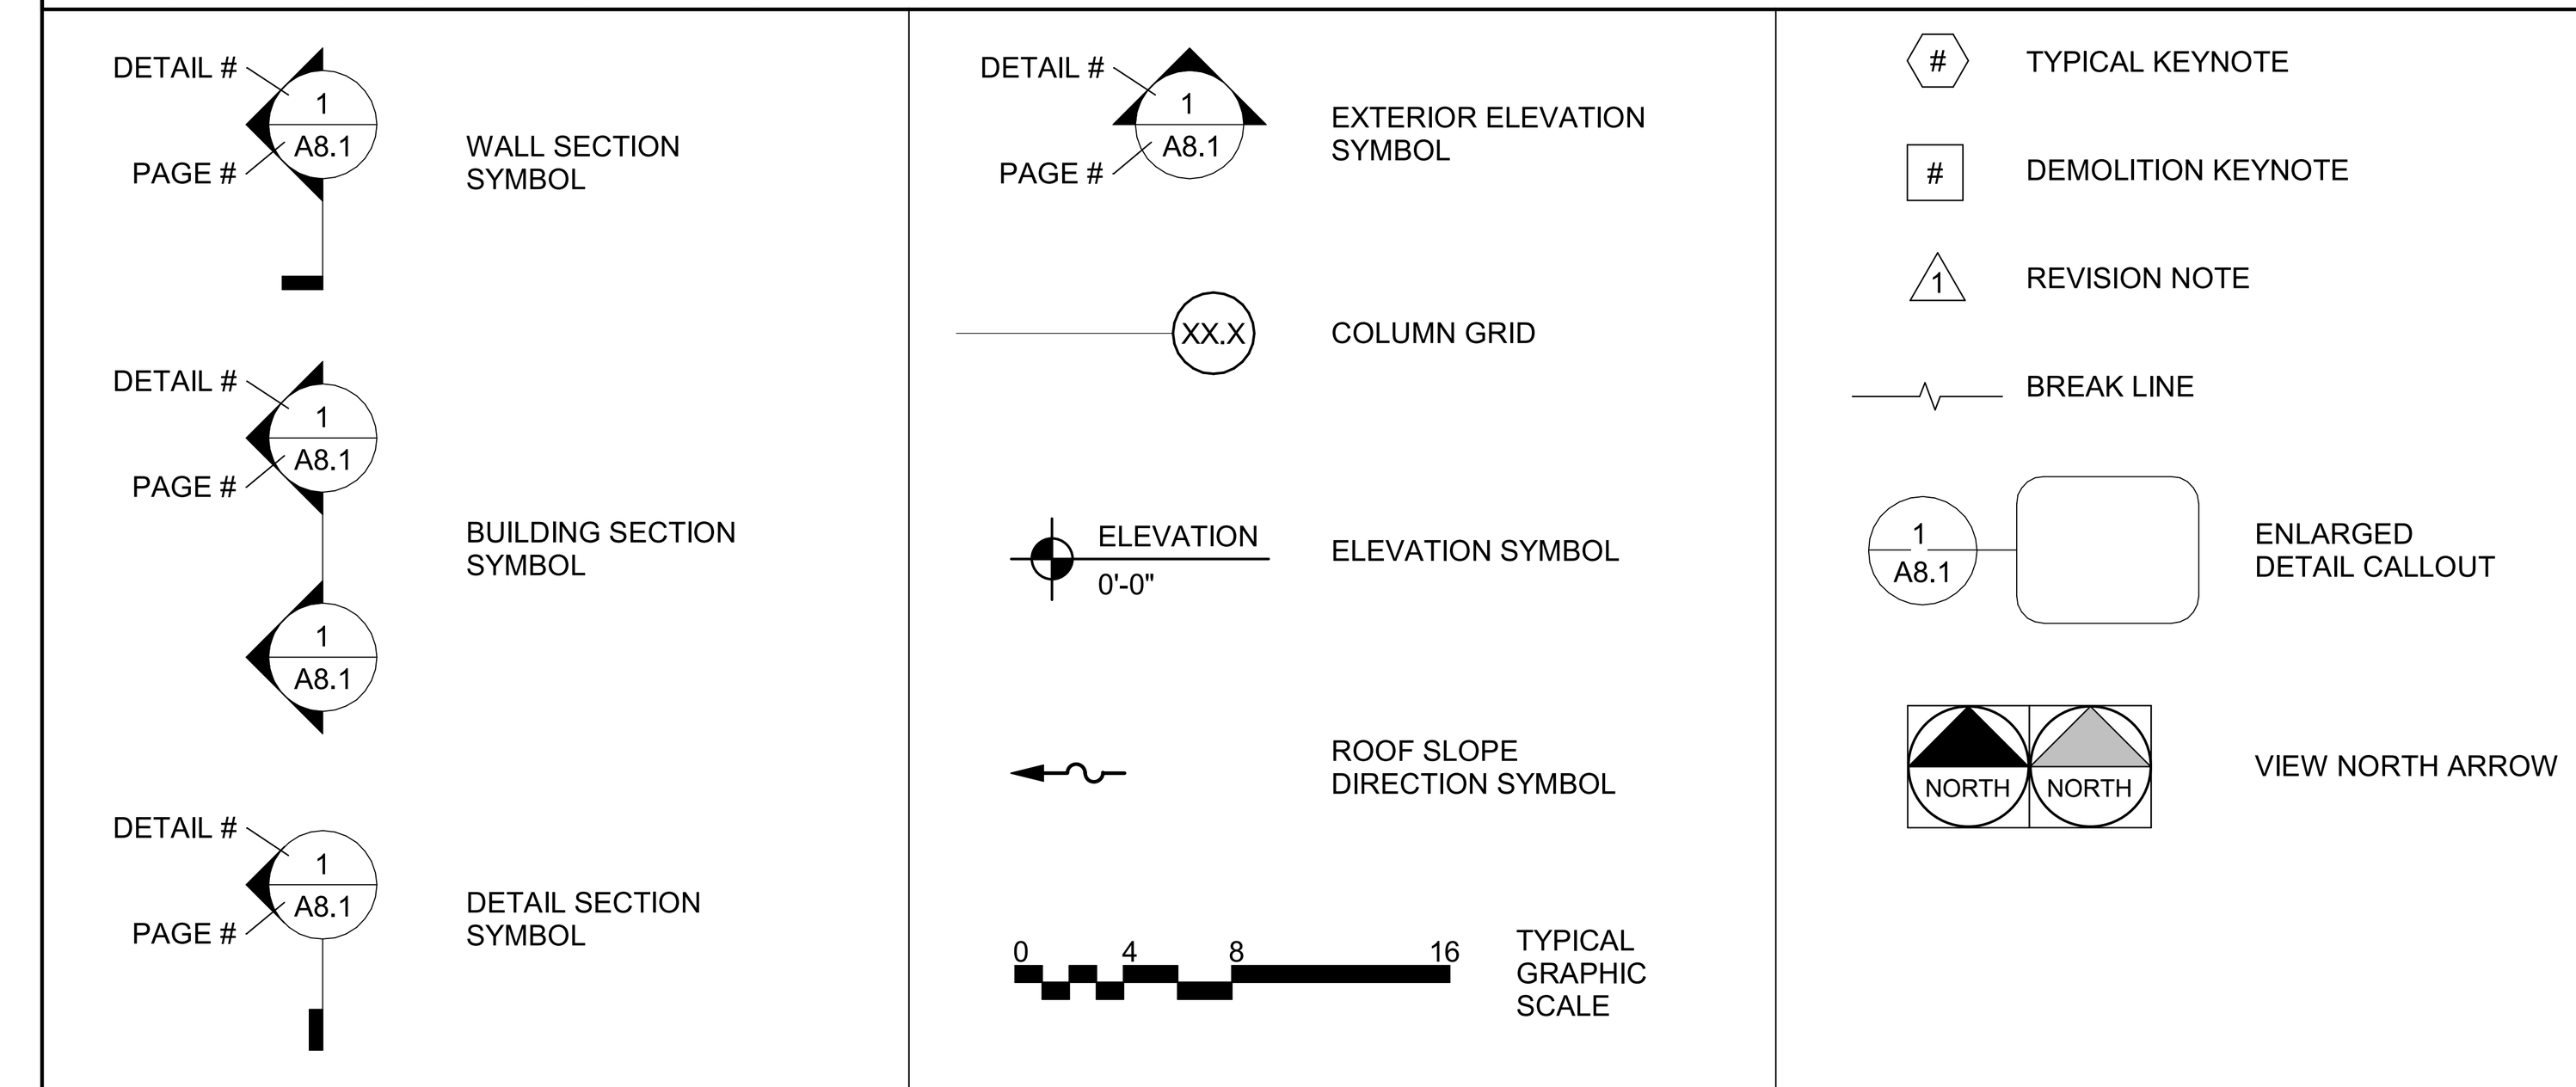

G_ABBREVIATIONS

AFF	ABOVE FINISHED FLOOR
ACP/APC	ACOUSTIC CEILING PANEL/ ACOUSTIC PANEL CEILING
ACT	ACOUSTIC(AL) TILE
ADJ	ADJUSTABLE
ADT'L	ADDITIONAL
AGG	AGGREGATE
ALT	ALTERNATE
AL	ALUMINUM
APPROX	APPROXIMATE(LY)
ASPH	ASPHALT
AUTO	AUTOMATIC
B/O	BOTTOM OF
BD	BOARD
BLDG	BUILDING
BLKG	BLOCKING
BOT	BOTTOM
BRG	BEARING
℄	CENTERLINE
C/C	CENTER TO CENTER
CJ	CONTROL JOINT
CLL	CONTRACT LIMIT LINE
CEM	CEMENT(ITIOUS)
CMU	CONCRETE MASONRY UNIT
CLG	CEILING
CLR	CLEAR
COL	COLUMN
CONC	CONCRETE
CONST	CONSTRUCTION
CONT	CONTINUOUS
CPT	CARPET
CT	CERAMIC TILE
CTR	CENTER(ED)
DF	DRINKING FOUNTAIN
DS	DOWNSPOUT
DBL	DOUBLE
DEG	DEGREE
DEMO	DEMOLITION
DET/DTL	DETAIL
DIA	DIAMETER
DIM	DIMENSION
DN	DOWN
DWG(S)	DRAWING(S)
E	EAST
EC	ELECTRICAL CONTRACTOR
EHO	ELECTRICAL HOLD OPEN
EJ	EXPANSION JOINT
EW	EACH WAY
EA	EACH
EIFS	EXTERIOR INSULATION FINISH SYSTEM
EL	ELEVATION
ELEC	ELECTRIC(AL)
ELEV	ELEVATOR
EMER	EMERGENCY
EQ	EQUAL
EQUIP	EQUIPMENT
EXIST	EXISTING
EXT	EXTERIOR
EWC	ELECTRIC WATER COOLER
FD	FLOOR DRAIN
FE	FIRE EXTINGUISHER
FFE	FINISH FLOOR ELEVATION
FV	FIELD VERIFY
FEC	FIRE EXTINGUISHER CABINET
FDN	FOUNDATION
FIN	FINISH
FLSHG	FLASHING
FLR	FLOOR
FRMG	FRAMING
FRT	FIRE RETARDANT TREATED
FT	FOOT/FEET
FTG	FOOTING
GC	GENERAL CONTRACTOR
GA	GAUGE
GALV	GALVANIZED
GEN	GENERAL
GYP	GYPSUM
HM	HOLLOW METAL
HDWR	HARDWARE
HOL	HOLLOW
HOR	HORIZONTAL
HT	HEIGHT
HVAC	HEATING/VENTILATION/AIR CONDITIONING
ID	INSIDE DIAMETER
IN	INCH
INCL	INCLUDING
INSUL	INSULATION
INT	INTERIOR
JAN	JANITOR
JT	JOINT
LAV	LAVATORY
LB(S)	POUND(S)
L/S	LANDSCAPE
LT	LIGHT
MO	MASONRY OPENING
MAS	MASONRY
MAT'L	MATERIAL
MAX	MAXIMUM
MECH	MECHANICAL
MFR	MANUFACTURER
MIN	MINIMUM
MISC	MISCELLANEOUS
MTD	MOUNTED
MTL	METAL
N	NORTH
NIC	NOT IN CONTRACT
NTS	NOT TO SCALE
NOM	NOMINAL
OC	ON CENTER
OD	OUTSIDE DIAMETER
O TO O	OUT TO OUT
OPNG	OPENING
OPP	OPPOSITE
OVHD	OVERHEAD
PEB	PRE-ENGINEERED BUILDING
PJF	PREFORMED JOINT FILLER
PERIM	PERIMETER
PL	PLATE
PLAM	PLASTIC LAMINATE
PLBG	PLUMBING
PLYWD	PLYWOOD
PNT	PAINT
PR	PAIR
PT	PRESSURE TREATED
PTD	PAINTED
PWR	POWER
RB	RUBBER BASE
RD	ROOF DRAIN
RF	FIRE RETARDANT TREATED
RO	ROUGH OPENING
RAD	RADIUS
REC	RECESSED
REINF	REINFORCED
REQ'D	REQUIRED
REV	REVISED (REVISION)
RM	ROOM
S	SOUTH
SB	SPLASH BLOCK
SF	SQUARE FEET
SS	STAINLESS STEEL
SIM	SIMILAR
SPEC	SPECIFICATIONS
SQ	SQUARE
STD	STANDARD
STL	STEEL
STOR	STORAGE
STRUCT	STRUCTURAL
SUSP	SUSPENDED
T&G	TONGUE AND GROOVE
T/O	TOP OF
TELE	TELEPHONE
TRTD	TREATED
TS	TUBE STEEL
TYP	TYPICAL
UNFIN	UNFINISHED
UNO	UNLESS NOTED OTHERWISE
VCT	VINYL COMPOSITION TILE
VIF	VERIFY IN FIELD
VERT	VERTICAL
W	WEST
W/	WITH
W/O	WITHOUT
WC	WATER CLOSET
WWF	WELDED WIRE FABRIC
WD	WOOD
WH	WATER HEATER
WT	WEIGHT

DEDUCTIVE ALTERNATIVES

BASE BID:
ALL WORK AS DESCRIBED BY CONTRACT DOCUMENTS.

ALTERNATE DEDUCT #1:
DELETE ALL WORK AND MATERIAL ASSOCIATED WITH INSTALLATION OF RIGID INSULATION IN ATTIC OF BUILDINGS 19 & 20. INCLUDING BUT NOT LIMITED TO ALL DEMOLITION WORK FOR PREPARATION OF INSTALLATION.

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

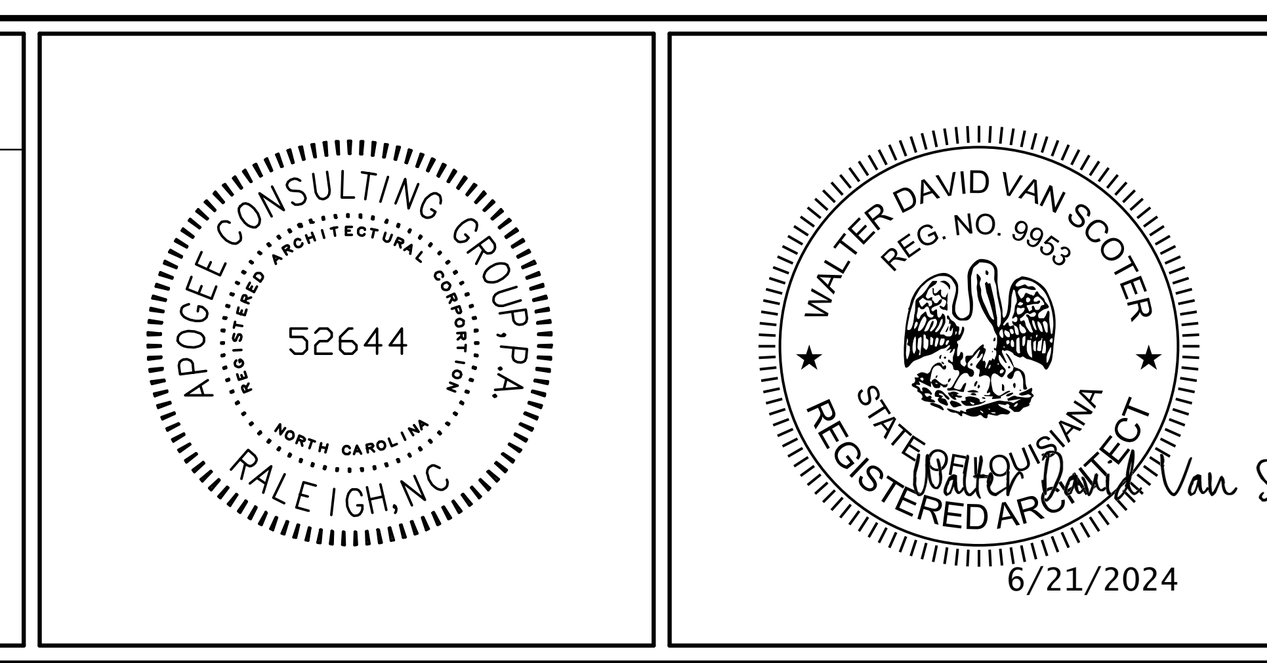

PROJECT MANAGER

ACG Project Number: 23-069

APOGEE
Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	GENERAL INFORMATION
Location	CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM 2400 HOSPITAL ROAD TUSKEGEE, AL 36083
Project Title	REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
Approved	
Date	JUNE 19, 2024
Checked	WVS
Drawn	RF
VA PROJECT NUMBER	619A4-24-102
Building Number	# 19, 20, 50, 51, AND 62
Drawing Number	G-002
Dwg	2 of 3

SITE PLAN

Scale: 1" = 80'-0"

SHEET NOTES:

A. CONTRACTOR TO COORDINATE LOCATION AND SCHEDULING OF CRANE TO LIFT SUPPLIES ONTO ROOF WITH COR PRIOR TO CRANE OPERATIONS STARTING. MINIMUM TWO WEEKS PRIOR TO CRANE ARRIVAL. CRANE LIFT PLAN SUBMITAL REQUIRED.

B. CONTRACTOR RESPONSIBLE TO PROTECT ALL PAVING, CONCRETE, & LANDSCAPE IN AREAS OF CRANE LOCATION INCLUDING CRANE TRANSIT ON SITE TO AND FROM LIFT LOCATIONS.

C. CONTRACTOR SHALL REPAIR ALL DAMAGE FROM CONSTRUCTION ACTIVITIES. INCLUDING, BUT NOT LIMITED TO GRASS AREAS, PAVED AREAS, AND LANDSCAPING. REPAIRED AREAS TO BE BACK TO ORIGINAL CONDITION OR BETTER.

D. CONTRACTOR SHALL VERIFY DIMENSIONS IN FIELD PRIOR TO BEGINNING CONSTRUCTION.

E. PROVIDE POSITIVE DRAINAGE TO ALL ROOF DRAINS.

F. ROOFING COMPONENTS MAY VARY DEPENDING ON ROOFING MANUFACTURER. CONTRACTOR SHALL INSTALL A COMPLETE CODE COMPLIANT AND WARRANTIED ROOFING SYSTEM BASED ON THE ROOFING MANUFACTURERS WRITTEN INSTRUCTIONS AND INSTALLATION GUIDELINES.

G. ROOFING INSULATION R-VALUE MAY VARY DEPENDING ON INSULATION MANUFACTURER. ROOFING CONTRACTOR TO CONSULT INSULATION MANUFACTURERS WRITTEN DOCUMENTATION AND PROVIDE A ROOF INSULATION THICKNESS TO MEET OR EXCEED 2018 IBC REQUIREMENTS.

H. NEW ROOF AREAS MUST HAVE POSITIVE DRAINAGE. NEW ROOFS TO HAVE NO PONDING OF WATER.

I. THE CONTRACTOR SHALL ENSURE THAT UPON COMPLETION OF ROOF WORK, ALL ROOF DRAINS ARE CLEAN AND CLEAR OF DEBRIS TO PROVIDE AND UNOBSTRUCTED, FREE FLOW OF WATER.

J. DUMPSTER AND TRASH CHUTE LOCATIONS ARE TO BE COORDINATED WITH THE COR PRIOR TO LOCATION ON SITE. SEE THIS SHEET FOR SUGGESTED LOCATIONS OF DUMPSTER, CHUTE, AND STAGING AREAS.

K. BUILDING ACCESS FOR WORKERS: CONTRACTOR'S DISCRETION, POTENTIAL ACCESS METHODS: THRU BUILDING INTERIOR, EXISTING FIRE ESCAPES, SCAFFOLDING BUILT STAIRS, OR LIFTS.

KEY NOTES:

1 POTENTIAL LOCATION OF CRANE FOR LIFTING SUPPLIES TO THE ROOF OR REMOVING DEBRIS FORM FROM ROOF. COORDINATE WITH COR.

2 POTENTIAL LOCATION OF DUMPSTER, COORDINATE WITH COR PRIOR TO START OF CONSTRUCTION. ALL DUMPSTERS TO HAVE FABRIC GUARD TO LIMIT DUST.

3 STAGING AREA. CONTRACTOR TO PROVIDE SECURE AREA WITH 6' HIGH CONSTRUCTION CHAIN LINK FENCE (PANEL TYPE WITH SAND BAGS). WITH PRIVACY FABRIC. PROVIDE ONE DOUBLE SWINGING 10'-0" GATE ACCESS. COORDINATE EXACT EXTENT AND LAYOUT WITH COR.

4 EXISTING BUILDING TO BE RE-ROOFED.

5 ENCLOSED CONNECTOR BRIDGE BETWEEN BUILDINGS 50, 51 + 62 .

6 PROVIDE (1) DOUBLE SWINGING 10'-0" GATE. 6' HIGH CHAIN LINK WITH PRIVACY FABRIC. POSTS TO BE INSTALLED IN AUGER DUG HOLES AS PER GATE SUPPLIER INSTALLATION INSTRUCTIONS. WIDTH OF EXISTING ROAD 30'. FROM NORTH SIDE OF ROAD TO EXISTING FENCE 20'.

7 EXISTING CAMPUS PERIMETER SECURITY FENCE.

8 EXISTING GUARDHOUSE.

9 POTENTIAL DEBRIS CHUTE LOCATION CONTRACTOR TO VERIFY LOCATIONS WITH THE C.O.R. PRIOR TO START OF CONSTRUCTION.

10 PROVIDE TEMPORARY FENCING 6' HIGH CONSTRUCTION CHAIN LINK FENCE WITH PRIVACY FABRIC - APPROX 70 LF. (PANEL TYPE WITH SAND BAGS).

SCOPE OF WORK

BUILDINGS IN SCOPE OF WORK

0 40 80 160

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

APOGEE CONSULTING GROUP, P.A. 52644 RALEIGH, NC

WALTER DAVID VAN SCOTER REG. NO. 9953 STATE OF LOUISIANA REGISTERED ARCHITECT 6/21/2024

PROJECT MANAGER

ACG Project Number 23-069

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: SITE PLAN

Location: CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM
2400 HOSPITAL ROAD
TUSKEGEE, AL 36083

Project Title: REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62

Approved:

Date	Checked	Drawn
JUNE 19, 2024	WVS	RF

VA PROJECT NUMBER 619A4-24-102

Building Number # 19, 20, 50, 51, AND 62

Drawing Number GC101

ROOF REPAIR ITEMS AND QUANTITIES

BUILDING 19

REPAIR / REPLACEMENT	APROX. QTY	UNIT	NOTES
REMOVE ASPHALT SHINGLES ROOF	7,200	SQUARE FOOT	1, 2, 3
REMOVE BUR SYSTEM FROM ENTRANCE ROOF	210	SQUARE FOOT	4
REMOVE AND REPLACE ROOF HATCH	1	EACH	5, 6
REPLACE VALLEY FLASHING	50	LINEAL FOOT	
REPLACE FLASHING AT CHIMNEYS, FANS, VTR, ETC.	24	LINEAL FOOT	
REPLACE ALL DRIP EDGE	460	LINEAL FOOT	
REPLACE ALL WOOD FASCIA, TRIM, SOFFIT, ETC.	460	LINEAL FOOT	9
REPLACE WOOD ROOF SHEATHING	800	SQUARE FOOT	
NEW BUILT IN GUTTER	460	LINEAL FOOT	UPPER AND LOWER ROOFS

ROOF REPAIR ITEMS AND QUANTITIES

BUILDING 20

REPAIR / REPLACEMENT	APROX. QTY	UNIT	NOTES
REMOVE AND REPLACE ASPHALT SHINGLE ROOF	6,400	SQUARE FOOT	1, 2
INSTALL NEW ROOF HATCH AT EXISTING HATCH OPENING	1	EACH	5, 6
REPLACE VALLEY FLASHING	45	LINEAL FOOT	
REPLACE FLASHING AT FANS, VTR, ETC.	20	LINEAL FOOT	
REPLACE ALL DRIP EDGE	460	LINEAL FOOT	UPPER AND LOWER ROOFS
REPLACE ALL WOOD FASCIA, TRIM, SOFFIT, ETC.	460	LINEAL FOOT	9, UPPER AND LOWER ROOFS
REPAIR OR REPLACE INTEGRAL GUTTER	40	LINEAL FOOT	3
REPLACE WOOD ROOF SHEATHING	800	SQUARE FOOT	
NEW BUILT IN GUTTER	460	LINEAL FOOT	UPPER AND LOWER ROOFS

ROOF REPAIR ITEM AND QUANTITIES

BUILDING 50

REPAIR / REPLACEMENT	APROX. QTY	UNIT	NOTES
REMOVE EXISTING BUR SYSTEM	17,300	SQUARE FOOT	7
REMOVE ASPHALT SHIGLES FROM PITCHED ROOF	2,500	SQUARE FOOT	1, 2
REMOVE EXHAUST FANS	24	EACH	8
INSTALL NEW RIGID INSULATION, SLOPE TO ROOF DRAINS	17,300	SQUARE FOOT	12
INSTALL NEW TPO ROOF SYSTEM	17,300	SQUARE FOOT	12
INSTALL NEW ASPHALT SHINGLE ROOF ON MECHANICAL PENTHOUSE ROOF	2,500	SQUARE FOOT	
REMOVE AND REPLACE ALL FLASHING	850	LINEAL FOOT	
PATCH CONCRETE ROOF SLAB WHERE EQUIPMENT IS REMOVED	125	SQUARE FOOT	11
REPLACE WOOD SHEATHING MECHANICAL PENTHOUSE ROOF	2,500	SQUARE FOOT	

ROOF REPAIR ITEMS AND QUANTITIES

BUILDING 51

REPAIR / REPLACEMENT	APROX. QTY	UNIT	NOTES
REMOVE EXISTING BUR SYSTEM	17,000	SQUARE FOOT	7
REMOVE EXHAUST FANS	24	EACH	8
INSTALL NEW RIGID INSULATION, SLOPE TO ROOF DRAINS	12,710	SQUARE FOOT	12
INSTALL NEW TPO ROOF SYSTEM	17,000	SQUARE FOOT	12
REMOVE AND REPLACE ALL FLASHING	600	LINEAL FOOT	
PATCH CONCRETE ROOF SLAB WHERE EQUIPMENT IS REMOVED	100	SQUARE FOOT	11
STONE COPING RESET	20	LINEAL FOOT	
BRICK WALL REBUILDING	100	SQUARE FOOT	

ROOF REPAIR ITEMS AND QUANTITIES

BUILDING 62

REPAIR / REPLACEMENT	APROX. QTY	UNIT	NOTES
REMOVE EXISTING BUR SYSTEM	17,300	SQUARE FOOT	7
REMOVE ASPHALT SHIGLES FROM PITCHED ROOF	2,500	SQUARE FOOT	1, 2
REMOVE EXHAUST FANS	5	EACH	8
INSTALL NEW RIGID INSULATION, SLOPE TO ROOF DRAINS	17,300	SQUARE FOOT	12
INSTALL NEW TPO ROOF SYSTEM	17,300	SQUARE FOOT	12
INSTALL NEW ASPHALT SHINGLE ROOF ON MECHANICAL PENTHOUSE ROOF	2,500	SQUARE FOOT	
REMOVE AND REPLACE ALL FLASHING	850	LINEAL FOOT	
PATCH CONCRETE ROOF SLAB WHERE EQUIPMENT IS REMOVED	25	SQUARE FOOT	11
REPLACE WOOD SHEATHING MECHANICAL PENTHOUSE ROOF	2,500	SQUARE FOOT	

ROOF REPAIR ITEMS AND QUANTITIES

BUILDINGS 50, 51, AND 62 CONNECTOR

REPAIR / REPLACEMENT	APROX. QTY	UNIT	NOTES
REMOVE EXISTING BUR SYSTEM	4,000	SQUARE FOOT	7
INSTALL NEW RIGID INSULATION, SLOP TO ROOF DRAINS	4,000	SQUARE FOOT	
INSTALL NEW TPO ROOF SYSTEM	4,000	SQUARE FOOT	
PATCH CONCRETE ROOF SLAB WHERE EQUIPMENT IS REMOVED	40	SQUARE FOOT	11
INSTALL NEW ROOF DRAINS	6	EACH	

SHEET NOTES:

A. ASSUME ALL EXTERIOR PAINTED SURFACES CONTAIN LEAD BASED PAINT. REMOVE PER SPECIFICATION SECTION 02 83 33.13 LEAD BASED PAINT REMOVAL.

B. ALL NEW MATERIALS TO BE INSTALLED PER CONTRACT DOCUMENTS, DRAWINGS AND SPECIFICATIONS.

NOTES:

1. REMOVE ASPHALT SHINGLES AND ROOF UNDERLAYMENT TO EXISTING SUBSTRATE.
2. REPLACE DAMAGED OR DETERIORATED WOOD SUBSTRATE MATERIALS.
3. REPLACE INTEGRAL GUTTER SYSTEM AT ROOF EDGE. INCLUDE ALL WOOD FRAMING REQUIRED TO RESTORE OPERABLE GUTTER SYSTEM.
4. REMOVE ENTIRE ROOF SYSTEM, INCLUDING EXISTING SUBSTRATE.
5. REPLACE WOOD FRAMING AT EXISTING ROOF HATCH.
6. INSTALL NEW ROOF HATCH.
7. REMOVE EXISTING BUILT UP ROOF SYSTEM, INSULATION, UNDERLAYMENT, ETC. TO SUBSTRATE.
8. REMOVE EXISTING EXHAUST FANS AND EQUIPMENT.
9. REPLACE ALL FASCIA, TRIM, SOFFIT, ETC. AROUND ENTIRE EDGE OF PITCHED ROOF.
10. REMOVE SBS SINGLE PLY ROOF SYSTEM, INSULATION AND UNDERLAYMENT TO EXISTING SUBSTRATE.
11. PATCH THE EXISTING OPENINGS IN ROOF SLAB WHERE EXHAUST FANS/EQUIPMENT REMOVED.

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

6/21/2024

PROJECT MANAGER — ACG Project Number 23-069

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title	ARCHITECTURAL REPAIR ITEMS AND QUANTITIES
Location	CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM 2400 HOSPITAL ROAD TUSKEGEE, AL 36083
Project Title	REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
Approved	
Date	JUNE 19, 2024
Checked	WVS
Drawn	RF
VA PROJECT NUMBER	619A4-24-102
Building Number	# 19, 20, 50, 51, AND 62
Drawing Number	A-001
Dwg	1 of 14

SHEET NOTES:

A. CONTRACTOR TO ENSURE PROPER SAFETY BARRIERS AND ENCLOSURES ARE PROVIDED AT ALL ENTRY/EXIT POINTS FROM BUILDING WHERE WORK IS BEING PERFORMED ABOVE.

B. ALL PERSONNEL TO WEAR PROPER SAFETY DEVICES/FALL PROTECTION.

C. CONTRACTOR SHALL PROVIDE PROTECTION AS PER OSHA REQUIREMENTS.

D. CONTRACTOR TO ASSUME ALL DEMOLITION OF PAINT OR PAINTED WOOD OR METAL CONTAINS LBP AND NEEDS TO BE ABATED PER SPEC SECTION 02 83 33.13

E. ALL DIMENSIONS ON THE DRAWINGS HAVE BEEN DETERMINED BASED ON MINIMAL AS-BUILT INFORMATION AVAILABLE. CONTRACTOR TO VERIFY ALL DIMENSIONS AND QUANTITIES PRIOR TO SUBMITTING BID.

F. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING OF EXISTING ROOF STRUCTURE AS NECESSARY FOR CONSTRUCTION LIVE LOADS.

G. APPROXIMATE HEIGHT TO EAVE FROM GRADE AVERAGES APPROX. 30'-0". APPROXIMATE HEIGHT TO LOW FRONT ROOF FROM GRADE 12'-0".

H. ATTIC ACCESS FOR WORKERS ACCEPTABLE THROUGH BUILDING INTERIOR. POWER IS NOT AVAILABLE AT THIS BUILDING SITE. ANY ELECTRICAL POWER NEEDED SHALL BE PROVIDED BY THE CONTRACTOR.

DEMOLITION KEY NOTES:

1 REMOVE EXISTING ASPHALT SHINGLE ROOF AND UNDERLAYMENT TO EXISTING SUBSTRATE.
2 REMOVE EXISTING EXHAUST FAN IN ITS ENTIRETY. FILL IN HOLE WITH 3/4" FT PLYWOOD.
3 EXISTING VENT TO BE REMOVED.
4 REMOVE EXISTING ROTTED / DAMAGED WOOD SUBSTRATE PREP FOR NEW MATERIAL INSTALLATION. SEE A-001 FOR QUANTITIES.
5 EXISTING METAL CANOPY TO REMAIN. NO WORK ON THIS ROOF.
6 REPLACE DAMAGED AND DETERIORATED WOOD AROUND INTERIOR GUTTER. REPAIR GUTTER SECTIONS TO MAKE A CONTINUOUS, FULLY FUNCTIONING, INTERIOR GUTTER SYSTEM.
7 REMOVE AND REPLACE WOOD FASCIA, WOOD TRIM AND DECORATIVE WOOD ITEMS.
8 REMOVE EXISTING ROOF HATCH.
9 REMOVE EXISTING VALLEY FLASHING.
10 EXISTING BRICK MASONRY CHIMNEY TO REMAIN. RE-POINT ALL EXPOSED BRICK.
11 REMOVE CAPPED EQUIPMENT CURB AND INFILL ROOF OPENING WITH 3/4" FT PLYWOOD.
12 REMOVE FLAT BUILT-UP ROOF INCLUDING SUBSTRATE (ASSUMED WOOD PLANKING DECK).
13 REMOVE EXIST. SUBSTRATE IN THIS AREA. PRIOR TO FILLING IN WITH NEW SHEATHING, USE OPEN AREA FOR MATERIAL MOVEMENT FOR ATTIC RIGID INSULATION.
14 EXISTING STEEL FIRE ESCAPE TO REMAIN.
15 REMOVE ALL VEGETATION FROM WALL IN THIS AREA. AFTER REMOVAL, SPRAY WALL WITH ENVIRONMENTALLY SAFE WEED KILL TO PREVENT GROW BACK.
16 REMOVE EXISTING SUBSTRATE THIS AREA.
17 REMOVE EXISTING BUILT IN COPPER GUTTER AND DOWNSPOUTS.

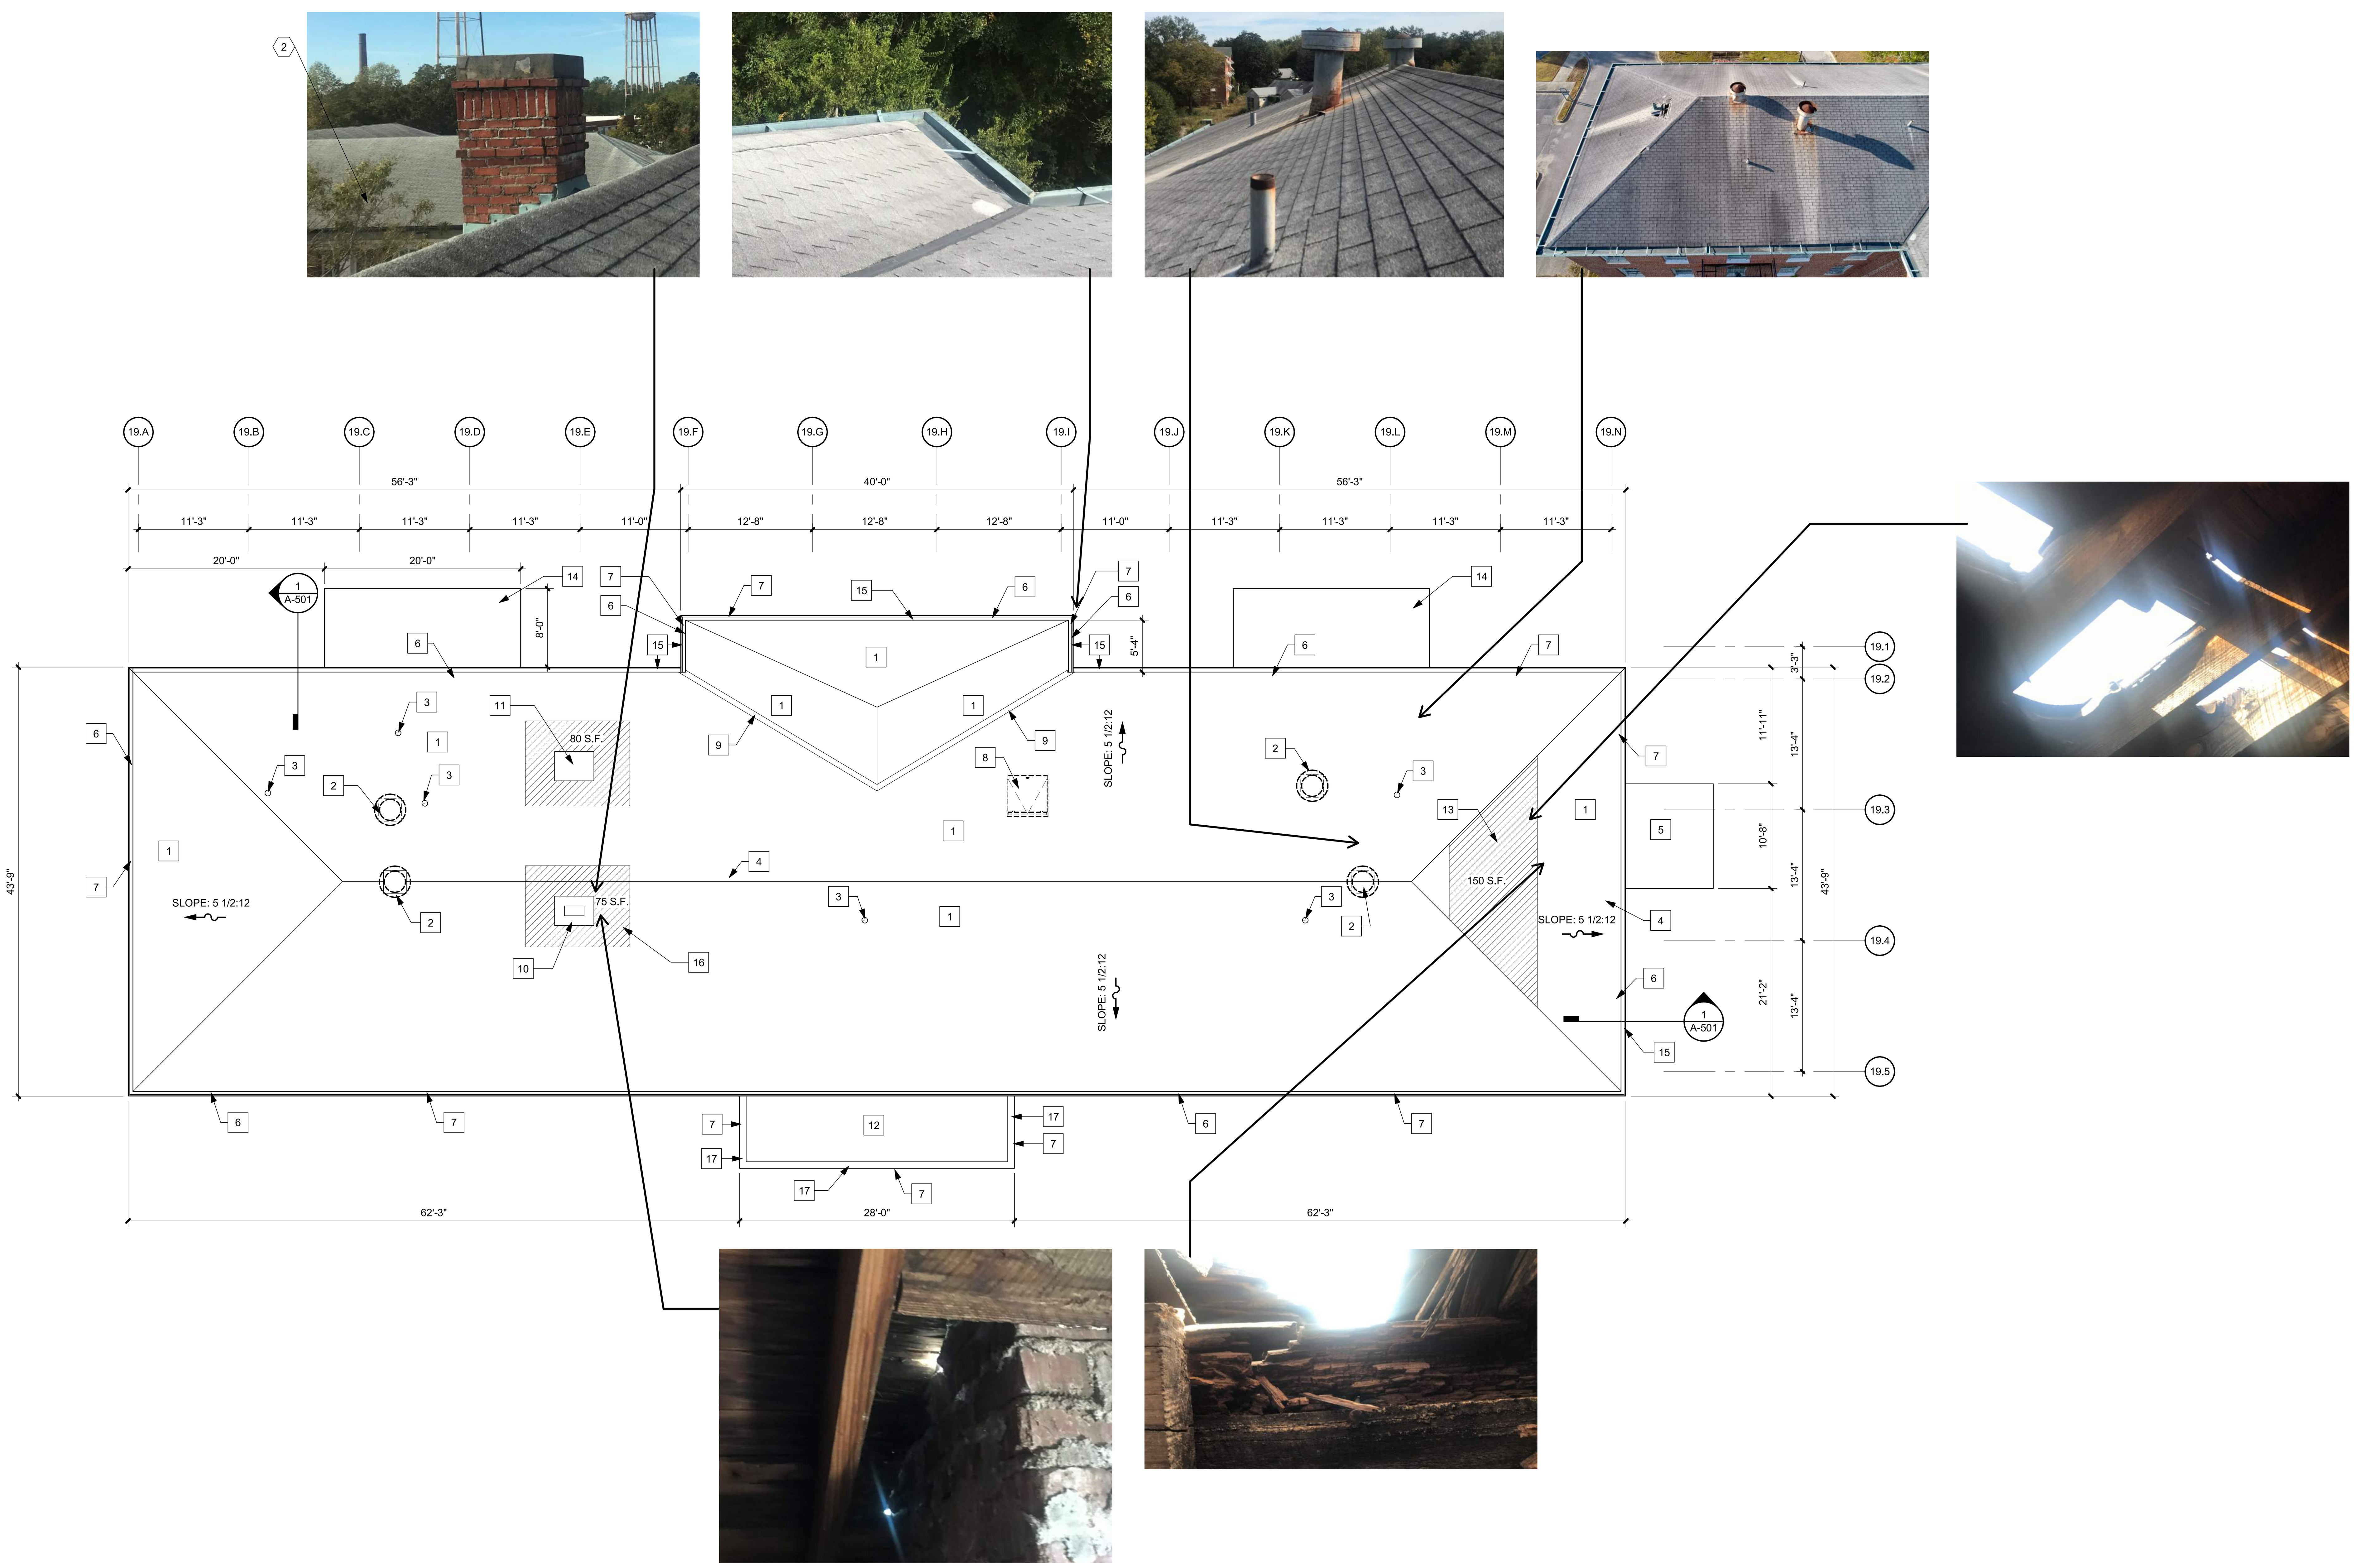

1 BUILDING 19 DEMOLITION ROOF PLAN

Scale: 1/8" = 1'-0"

0 4 8 16 NORTH

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

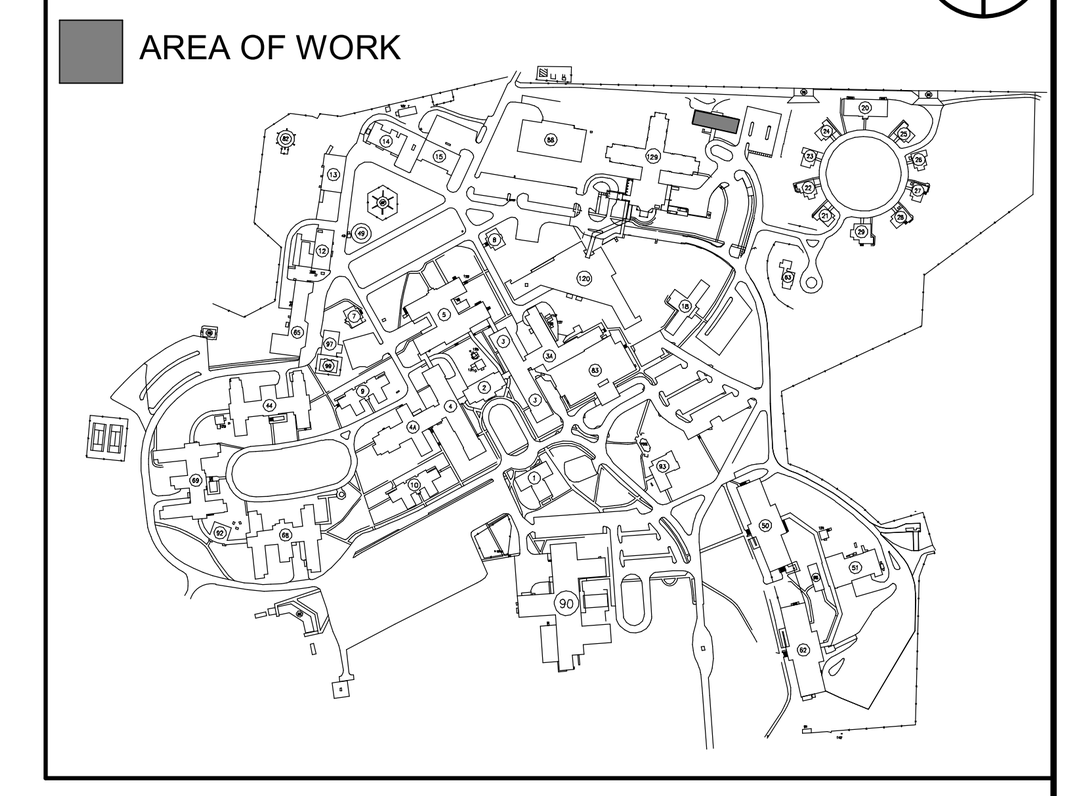

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:





Walter David Van Scoter
6/21/2024

PROJECT MANAGER

ACG Project Number 23-069

APOGEE
Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 19 DEMOLITION ROOF PLAN

Location: CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM
2400 HOSPITAL ROAD
TUSKEGEE, AL 36083

Project Title: REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62

Approved

Date: JUNE 19, 2024 | Checked: WVS | Drawn: RF

VA PROJECT NUMBER: 619A4-24-102

Building Number: # 19

Drawing Number: 19.AD101

Dwg 2 of 14

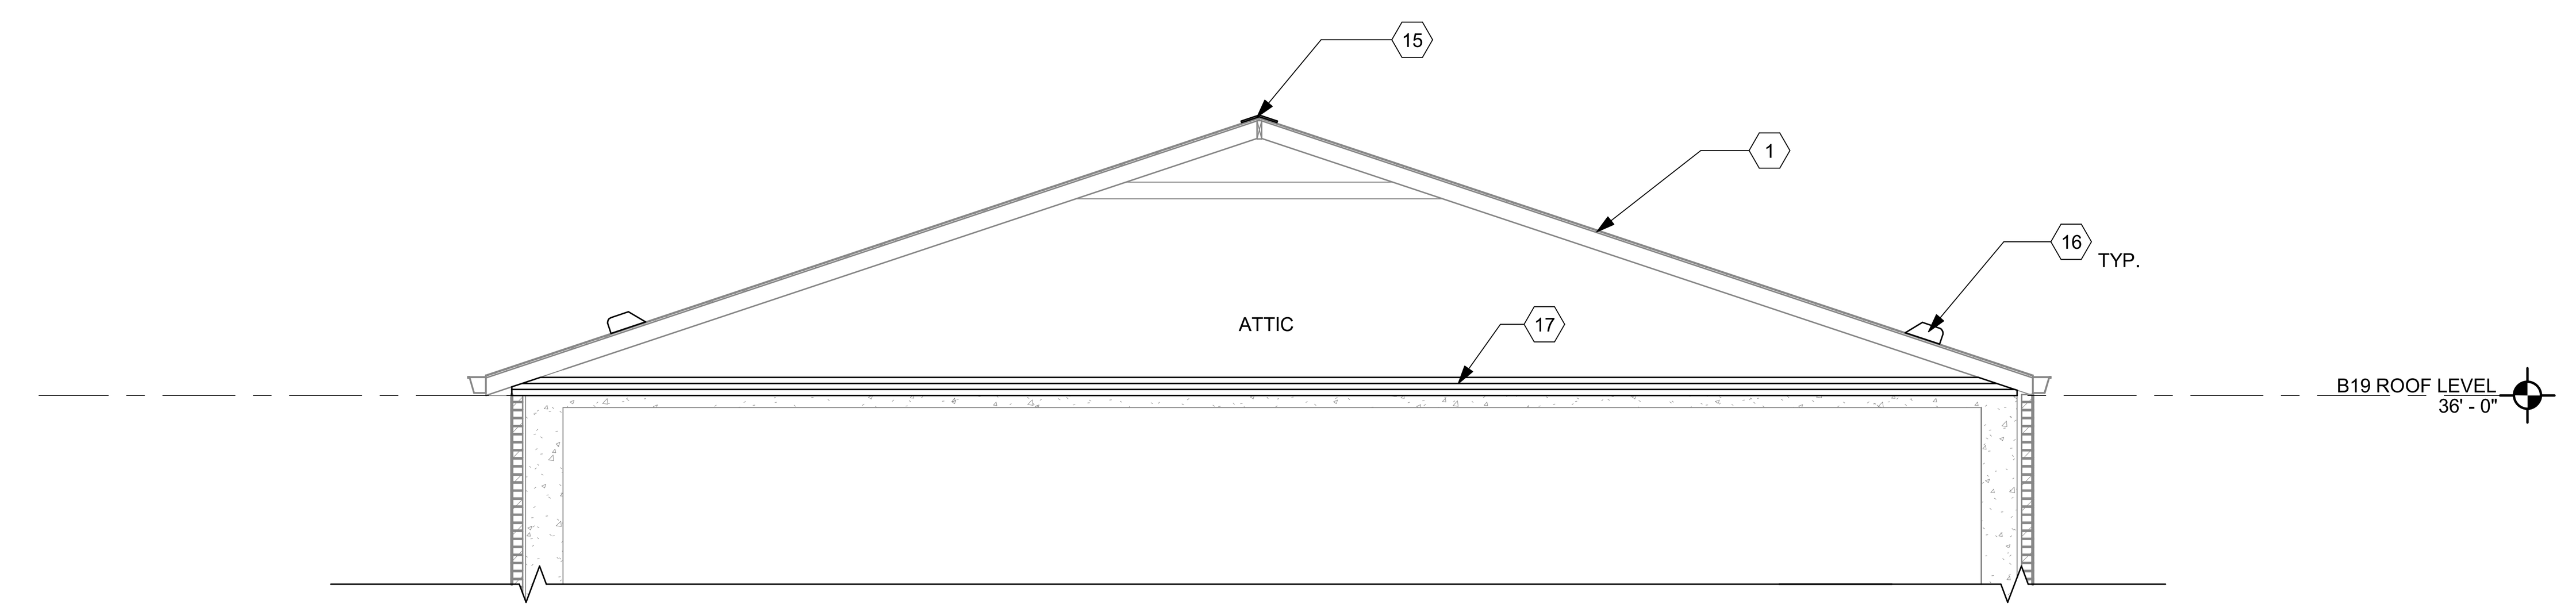

1 **BUILDING 19 SCHEMATIC SECTION**
Scale: 1/4" = 1'-0"

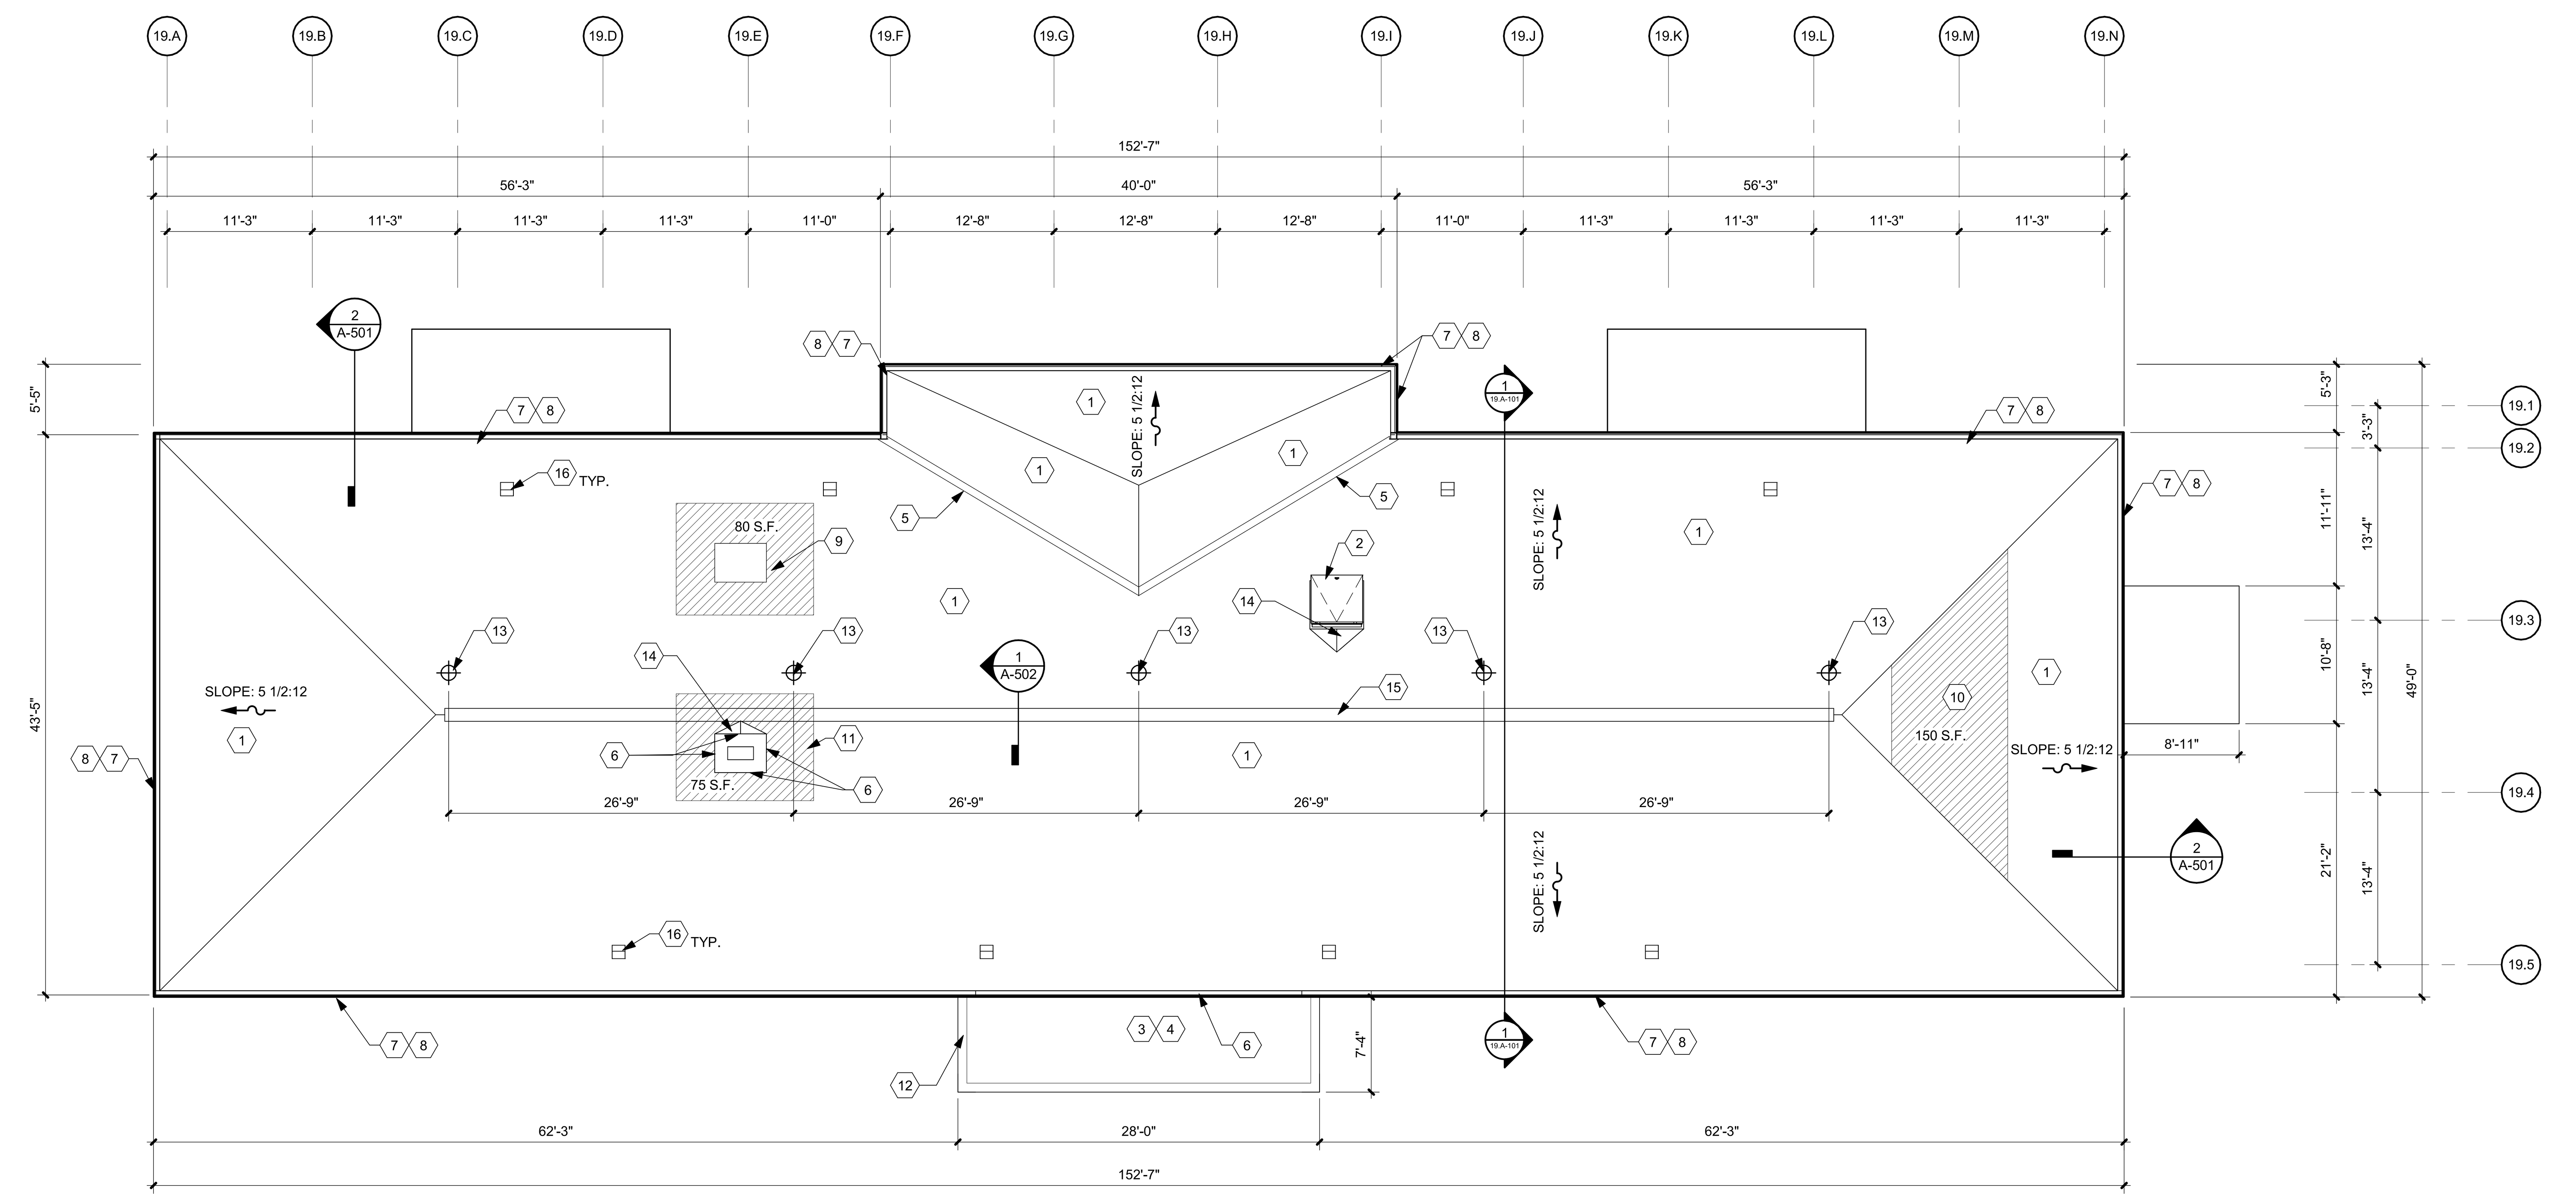

2 **BUILDING 19 ROOF PLAN**
Scale: 1/8" = 1'-0"

SHEET NOTES:

A. CONTRACTOR TO ENSURE PROPER SAFETY BARRIERS AND ENCLOSURES ARE PROVIDED AT ALL ENTRY/EXIT POINTS FROM BUILDING WHERE WORK IS BEING PERFORMED ABOVE.

B. ALL PERSONNEL TO WEAR PROPER SAFETY DEVICES/FALL PROTECTION.

C. CONTRACTOR SHALL PROVIDE FALL PROTECTION PER OSHA REQUIREMENTS.

D. ALL DIMENSIONS ON THE DRAWINGS HAVE BEEN DETERMINED BASED ON MINIMAL AS-BUILT INFORMATION AVAILABLE. CONTRACTOR TO VERIFY ALL DIMENSIONS AND QUANTITIES PRIOR TO SUBMITTING BID.

E. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING OF EXISTING ROOF STRUCTURE AS NECCESSARY FOR CONTRUCTION LIVE LOADS.

F. APPROXIMATE HEIGHT TO EAVE FROM GRADE AVERAGES APPROX. 30'-0".

G. ATTIC ACCESS FOR WORKERS PERMITTED THROUGH BUILDING INTERIOR.

H. ANY WOOD RAFTER DISCOVERED TO BE NON STRUCTURALLY SOUND SHALL BE REPAIRED AS PER DETAIL 9/A-502.

I. POWER IS NOT AVAILABLE AT THIS BUILDING SITE. ANY ELECTRICAL POWER NEEDED SHALL BE PROVIDED BY THE CONTRACTOR.

KEY NOTES:

1 INSTALL NEW ASPHALT SHINGLE ROOF SYSTEM OVER SELF ADHERED SHEET MEMBRANE ROOF UNDERLAYMENT. MEMBRANE THICKNESS 40 MIL.
2 REPLACE EXISTING ROOF HATCH, MATCH EXISTING HATCH SIZES. BASIS OF DESIGN: BILCO TYPE S ROOF HATCH W/ LADDER OR EQUAL. INSTALL FLASHING UP TO INTEGRAL CAP FLASHING ON HATCH FRAME. REPLACE DETERIORATED WOOD FRAMING FOR HATCH, ALL WOOD FRAMING AND SHEATHING AROUND HATCH TO BE REPLACED.
3 INSTALL NEW 3/4" WOOD SHEATHING ENTIRE LOW ROOF (APPROX. 200 S.F.). SLOPE SHEATHING TO BUILT IN GUTTER VIA SHIMS.
4 INSTALL NEW 60 MIL FLEECE BACK TPO ROOFING ON NEW SHEATHING.
5 INSTALL NEW VALLEY FLASHING.
6 INSTALL NEW BASE FLASHING AT WALL PER ROOF SYSTEM MANUFACTURER'S STANDARD DETAILS.
7 EXISTING INTEGRAL GUTTER WITH NEW COPPER LINING, ENSURE PROPER CONNECTIONS TO ALL DOWNSPOUTS AND ALL GUTTER SECTIONS.
8 REPLACE FASCIA, EAVES, SOFFITS AND OTHER ROTTED OR DETERIORATED WOOD MATERIAL BEFORE INSTALLING NEW FLASHING OR ROOF MATERIAL. SEE SHEET A-001 FOR QUANTITIES.
9 INSTALL NEW 3/4" WOOD SHEATHING FLUSH WITH EXISTING (APPROX. 80 S.F.).
10 INSTALL NEW 3/4" WOOD SHEATHING FLUSH WITH EXISTING (APPROX. 150 S.F.).
11 INSTALL NEW 3/4" WOOD SHEATHING FLUSH WITH EXISTING (APPROX. 75 S.F.).
12 INSTALL NEW 16 OZ COPPER BUILT IN GUTTER MATCH EXISTING PROFILE. ALL WELDED SEAMS. NEW 18 OZ 3" ROUND DOWNSPOUTS.
13 INSTALL NEW FALL PROTECTION STANCHION. BOD: FRONTLINE COMMERCIAL ROOF ANCHOR - R012 OR EQUAL, TYPICAL.
14 NEW 16 OZ COPPER CRICKET W/ SELF ADHERED UNDERLAYMENT. AS PER SMACNA.
15 SHINGLE OVER RIDGE VENT. SUBMITTAL REQUIRED.
16 12 X 12 ROOF VENT. BASIS OF DESIGN: GAF, MASTER FLOW ROOF LOUVER SSB960 METAL, SLANT BACK. COLOR TO MATCH SHINGLES, OR EQUAL.
17 INSTALL (3) LAYERS OF 2" XPS INSULATION ON TOP OF EXISTING ATTIC SLAB. DEMOLISH ALL CONDUIT AND PIPING TO ALLOW INSULATION TO LAY ON ATTIC SLAB. (35 PENETRATIONS) SEAL ALL OPENINGS WITH FIRE CAULKING. METHOD OF ATTACHMENT - ADHESIVE. BASIS OF DESIGN: OWENS CORNING, FOAMULAR 250, 2" THICK, 4'X8' SHEETS, OR EQUAL ENTIRE ATTIC AREA.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

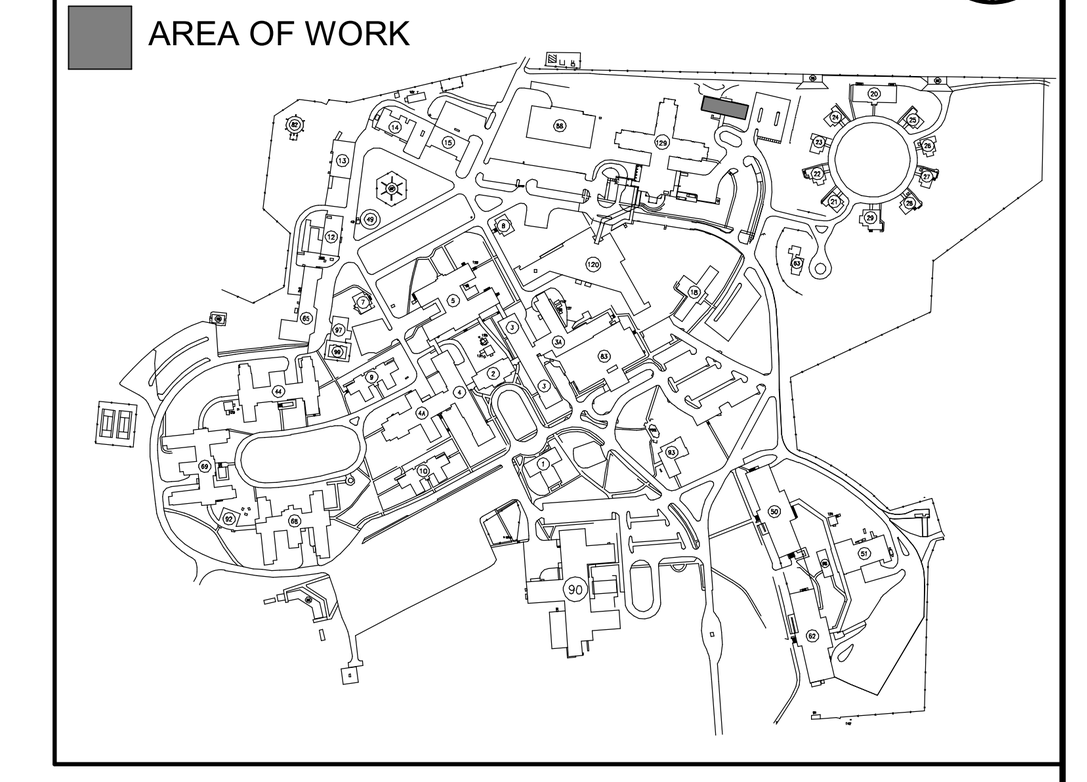

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

PROJECT MANAGER	ACG Project Number 23-069
APOGEE Engineers | Architects	Headquarters: **Apogee Consulting Group, P.A.** 1151 Kildaire Farm Road, Suite 120 Cary, North Carolina 27511
www.acg-pa.com	919-858-7420

APOGEE CONSULTING GROUP, P.A. 52644 RALEIGH, NC

WALTER DAVID VAN SOTER REG. NO. 9863 STATE OF LOUISIANA REGISTERED ARCHITECT 6/21/2024

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 19 ROOF PLAN
Project Title	REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
VA PROJECT NUMBER	619A4-24-102
Building Number	# 19
Location	CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM 2400 HOSPITAL ROAD TUSKEGEE, AL 36083
Approved	
Date	JUNE 19, 2024
Checked	WVS
Drawn	RF
Drawing Number	19.A-101
Dwg	3 of 14

REFERENCE PHOTO LOW ROOF AT ENTRANCE

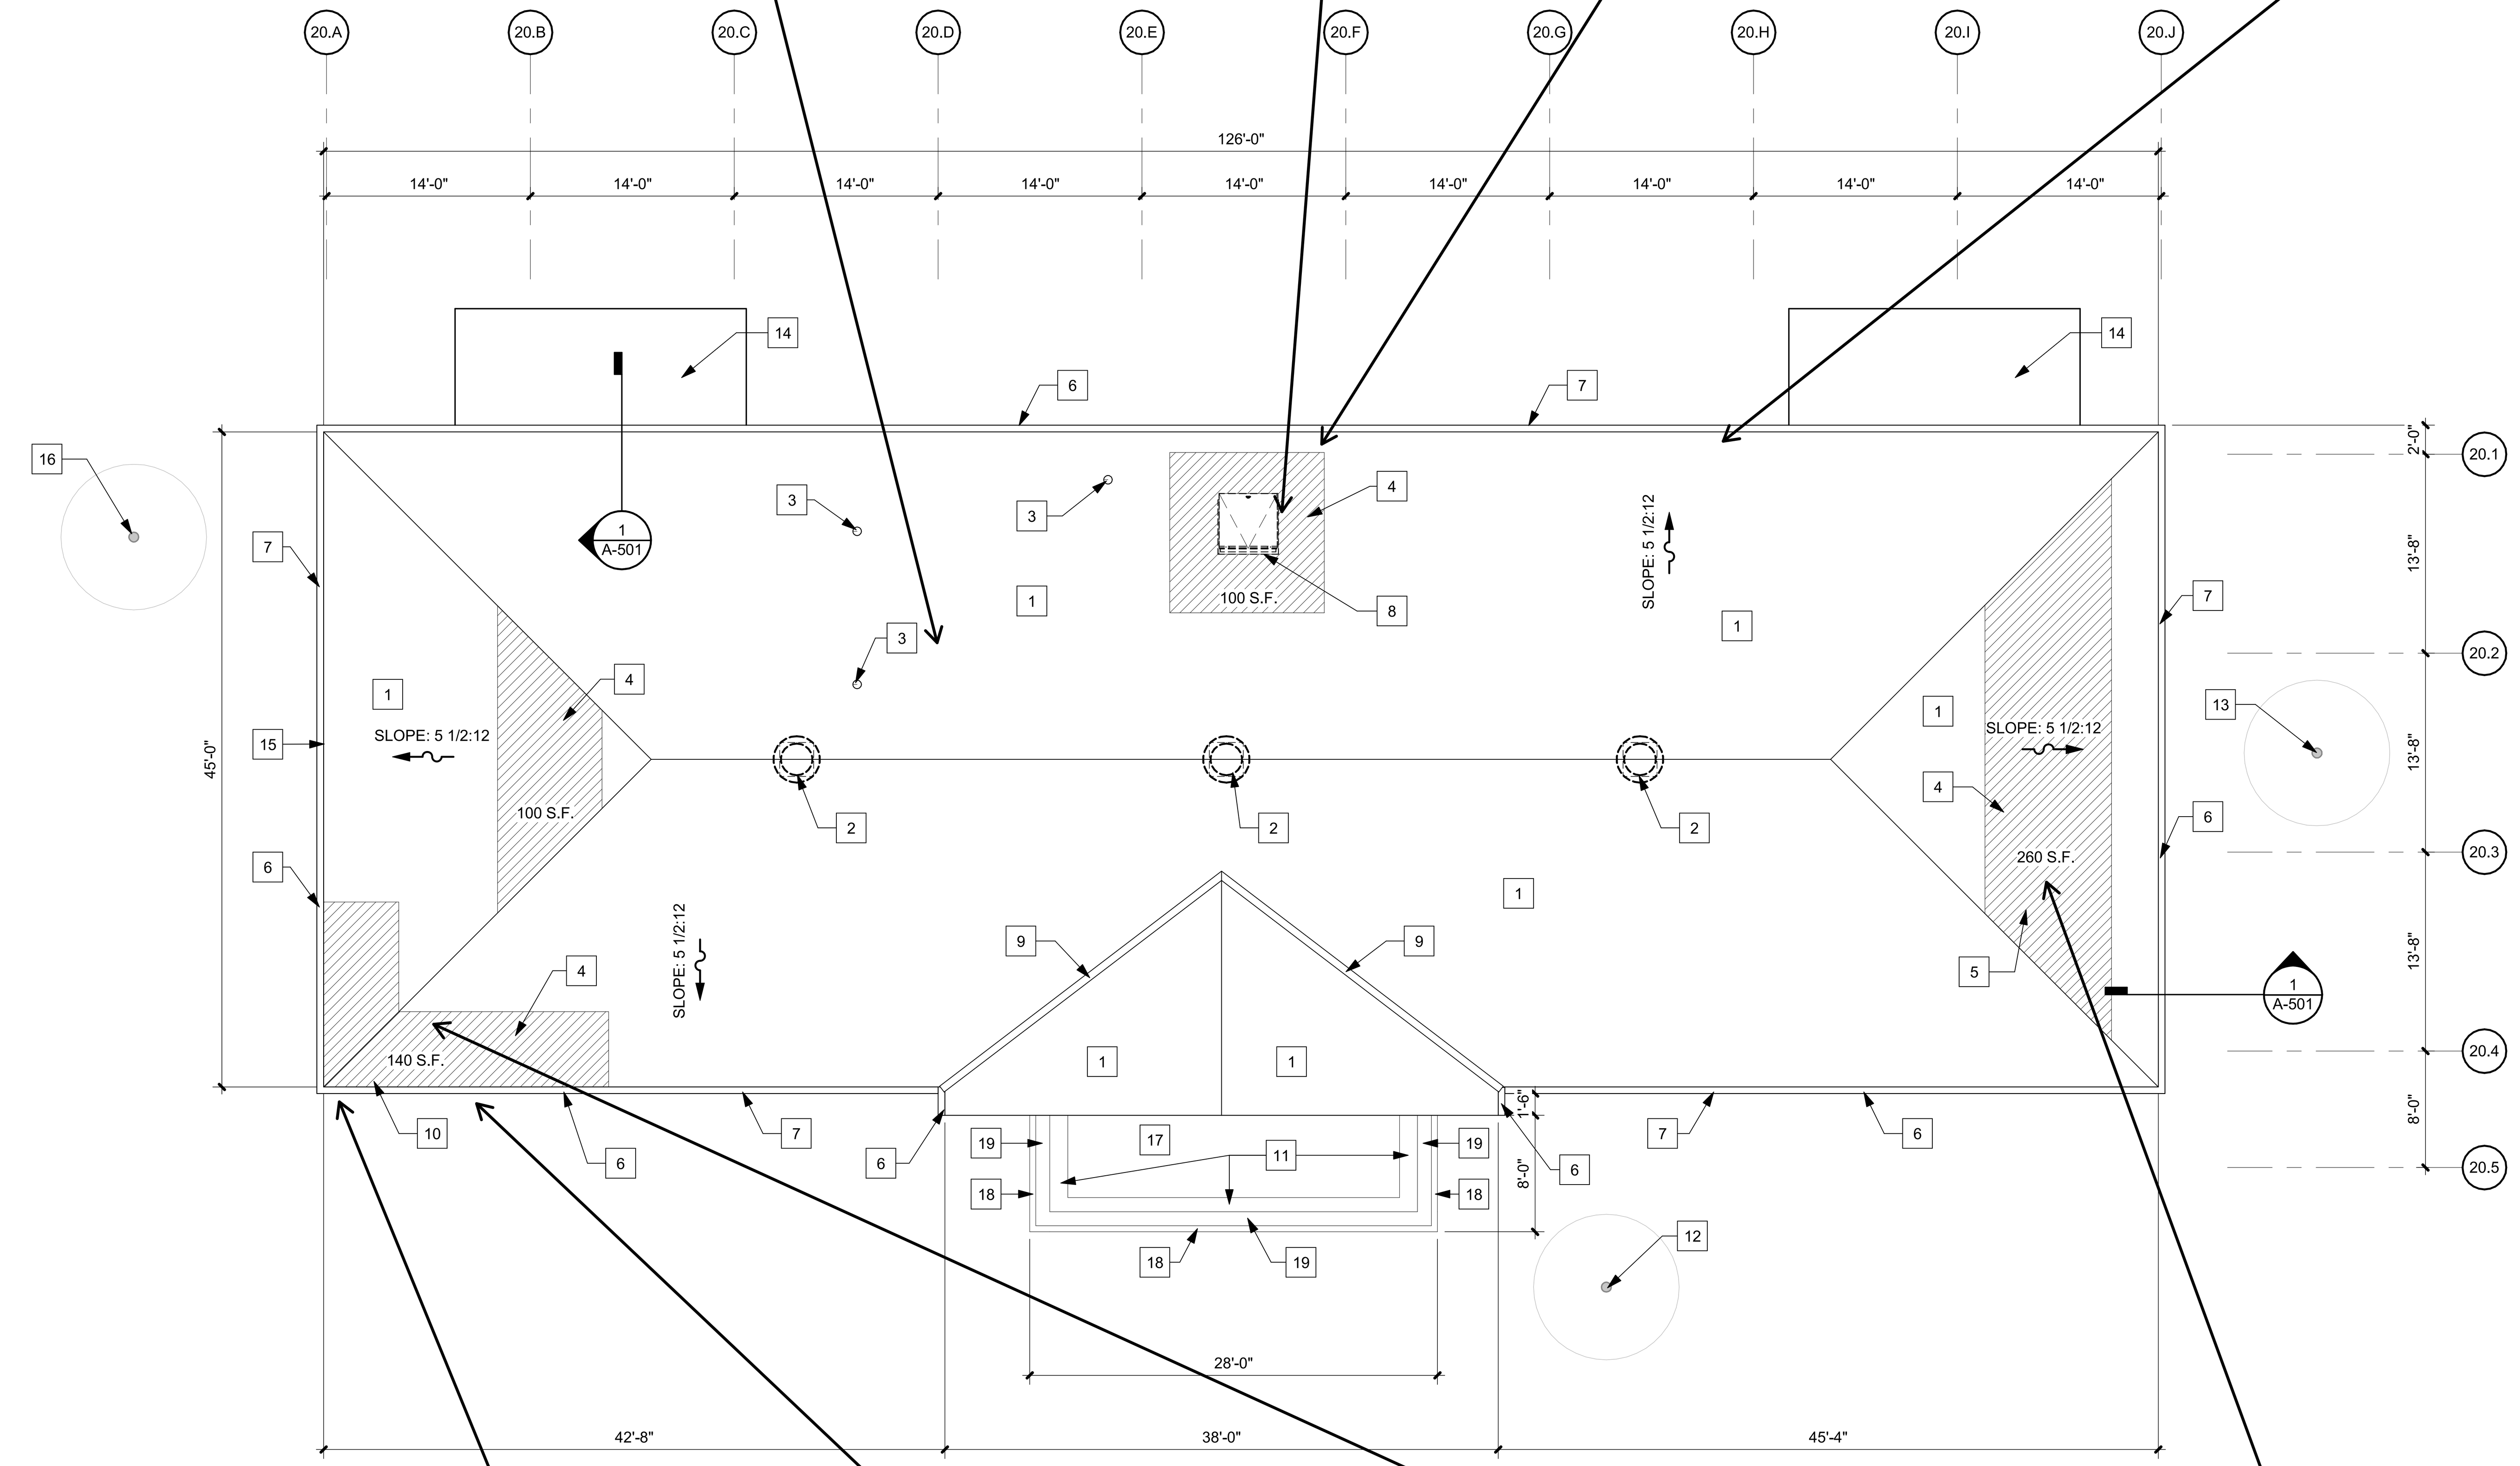

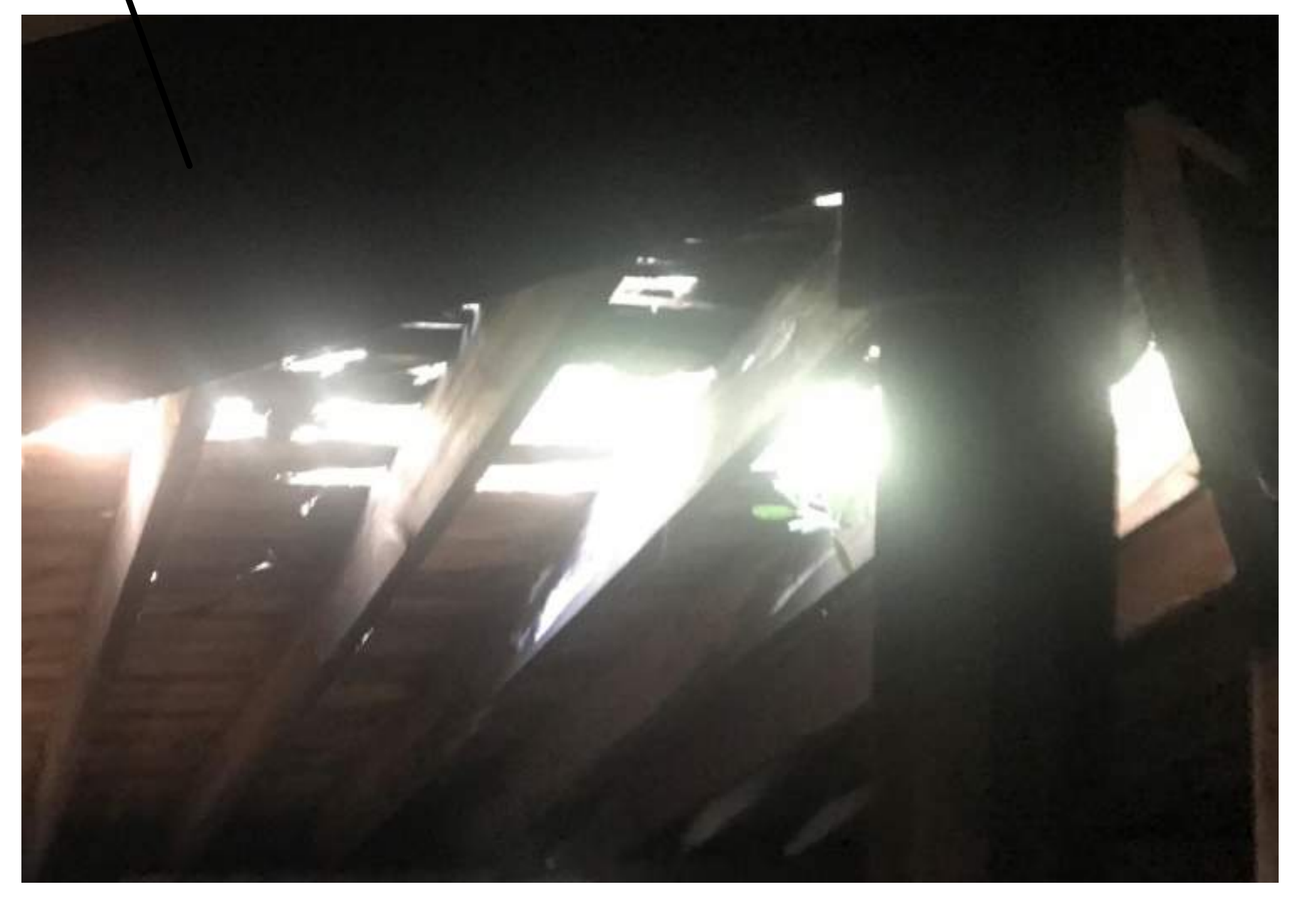

1 **BUILDING 20 DEMOLITION ROOF PLAN**

Scale: 1/8" = 1'-0"

NORTH

SHEET NOTES:

A. CONTRACTOR TO ENSURE PROPER SAFETY BARRIERS AND ENCLOSURES ARE PROVIDED AT ALL ENTRY/EXIT POINTS FROM BUILDING WHERE WORK IS BEING PERFORMED ABOVE.

B. ALL PERSONNEL TO WEAR PROPER SAFETY DEVICES/FALL PROTECTION.

C. CONTRACTOR SHALL PROVIDE PROTECTION AS PER OSHA REQUIREMENTS.

D. CONTRACTOR TO ASSUME ALL DEMOLITION OF PAINT OR PAINTED WOOD OR METAL CONTAINS LBP AND NEEDS TO BE ABATED PER SPEC SECTION 02 83 33.13

E. ALL DIMENSIONS ON THE DRAWINGS HAVE BEEN DETERMINED BASED ON MINIMAL AS-BUILT INFORMATION AVAILABLE. CONTRACTOR TO VERIFY ALL DIMENSIONS AND QUANTITIES PRIOR TO SUBMITTING BID.

F. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING OF EXISTING ROOF STRUCTURE AS NECESSARY FOR CONSTRUCTION LIVE LOADS.

G. APPROXIMATE HEIGHT TO EAVE FROM GRADE AVERAGES APPROX. 30'-0". APPROXIMATE HEIGHT TO LOW FRONT ROOF FROM GRADE APPROX. 12'-0".

H. ATTIC ACCESS FOR WORKERS ACCEPTABLE THROUGH BUILDING INTERIOR. POWER IS NOT AVAILABLE AT THIS BUILDING SITE. ANY ELECTRICAL POWER NEEDED SHALL BE PROVIDED BY THE CONTRACTOR.

DEMOLITION KEY NOTES:

1 REMOVE EXISTING ASPHALT SHINGLE ROOF AND UNDERLAYMENT TO EXISTING SUBSTRATE.
2 REMOVE EXISTING EXHAUST FAN IN ITS ENTIRETY. FILL IN HOLE WITH 3/4" FT PLYWOOD.
3 EXISTING VENT TO BE REMOVED.
4 REMOVE EXISTING ROTTED / DAMAGED WOOD SUBSTRATE PREP FOR NEW MATERIAL INSTALLATION. SEE A-001 FOR QUANTITIES.
5 REMOVE EXISTING SUBSTRATE IN THIS AREA ALL THE WAY DOWN TO FRAMING. PRIOR TO FILLING IN WITH NEW SHEATHING, USE OPEN AREA FOR MATERIAL MOVEMENT.
6 REPLACE DAMAGED AND DETERIORATED WOOD AROUND INTERIOR GUTTER. REPAIR GUTTER SECTIONS TO MAKE A CONTINUOUS, FULLY FUNCTIONING, INTERIOR GUTTER SYSTEM.
7 REMOVE AND REPLACE WOOD FASCIA, WOOD TRIM AND DECORATIVE WOOD ITEMS.
8 REMOVE EXISTING ROOF HATCH.
9 REMOVE EXITING VALLEY FLASHING.
10 REMOVE DETERIORATED RAFTER TAILS.
11 REMOVE SLOTTED PARAPET WALL, TRIM, AND CAP.
12 EXISTING MAGNOLIA TREE, TRIM 10 LARGE BRANCHES (BACK TO MAIN TRUNK) THAT ARE POINTING TOWARD THE BUILDING OR OVER LOWER ROOF.
13 EXISTING LARGE TREE, TRIM 10 LARGE BRANCHES (BACK TO MAIN TRUNK) THAT ARE POINTING TOWARD THE BUILDING.
14 EXISTING STEEL FIRE ESCAPE TO REMAIN.
15 REMOVE ALL VEGETATION FROM WHOLE ELEVATION THIS WALL. AFTER REMOVAL, SPRAY WALL WITH ENVIRONMENTALLY SAFE WEED KILL TO PREVENT GROW BACK.
16 EXISTING LARGE TREE TO BE CUT DOWN AND REMOVED OFFSITE. CUT 1'-0" +/- ABOVE GRADE.
17 REMOVE EXISTING SUBSTRATE IN THIS AREA DOWN TO FRAMING.
18 REMOVE COPING.
19 REMOVE EXISTING BUILT IN COPPER GUTTER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

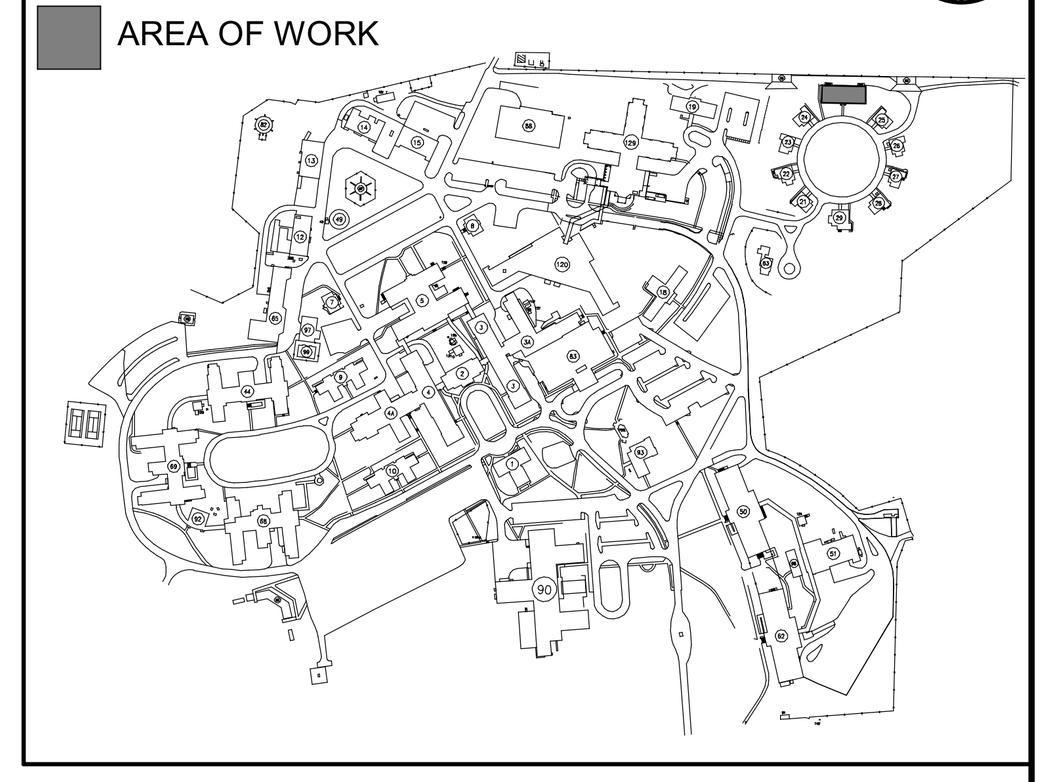

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

APOGEE CONSULTING GROUP, P.A. 52644 RALEIGH, NC

WALTER DAVID VAN SCOTER REG. NO. 9953 STATE OF LOUISIANA REGISTERED ARCHITECT 6/21/2024

PROJECT MANAGER

ACG Project Number 23-069

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511

APOGEE Engineers | Architects

www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 20 DEMOLITION ROOF PLAN
Location	CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM 2400 HOSPITAL ROAD TUSKEGEE, AL 36083
Project Title	REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
Approved	
Date	JUNE 19, 2024
Checked	WVS
Drawn	RF
VA PROJECT NUMBER	619A4-24-102
Building Number	# 20
Drawing Number	20.AD101
Dwg	4 of 14

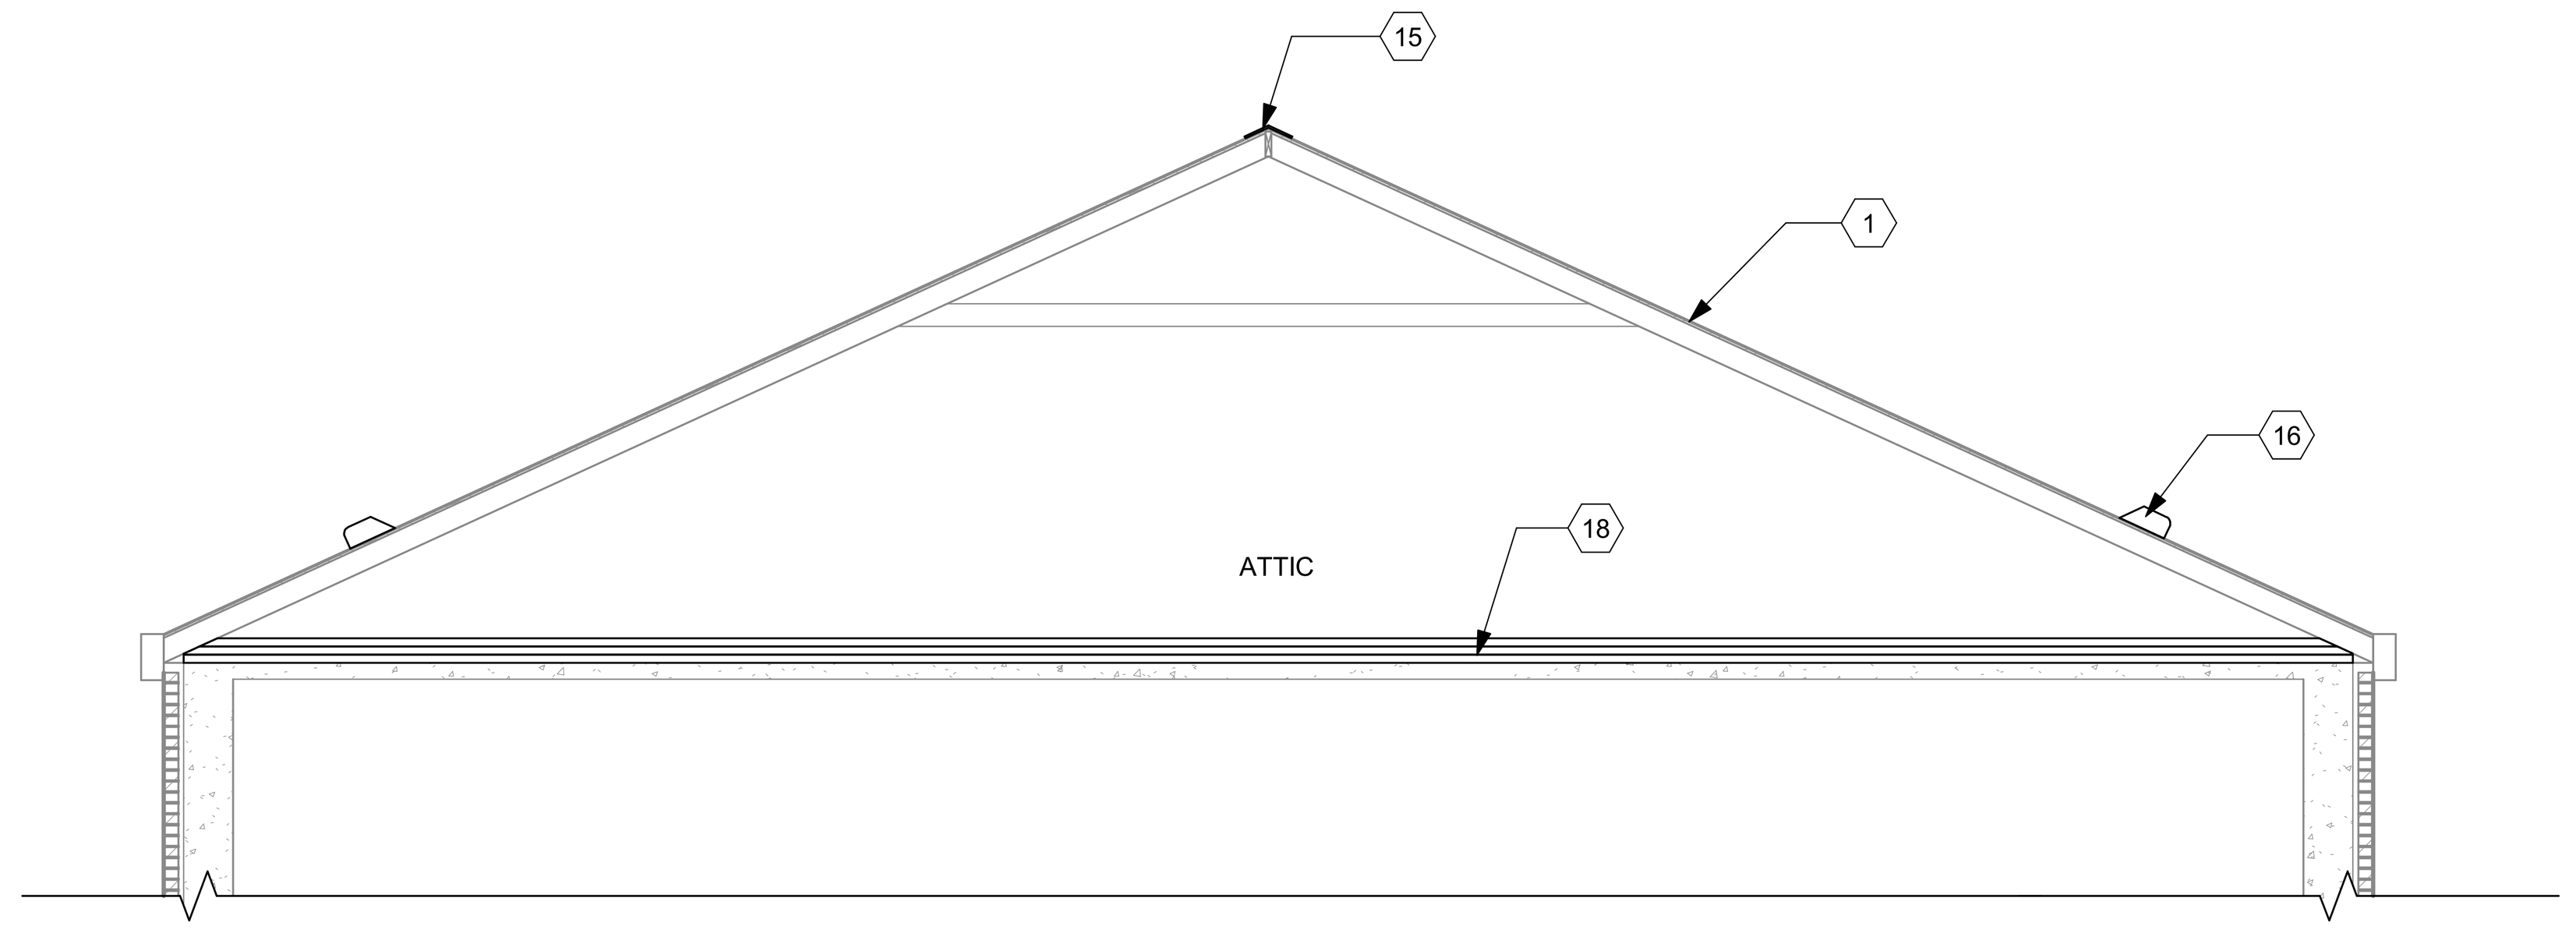

1 BUILDING 20 SCHEMATIC SECTION
Scale: 1/4" = 1'-0"

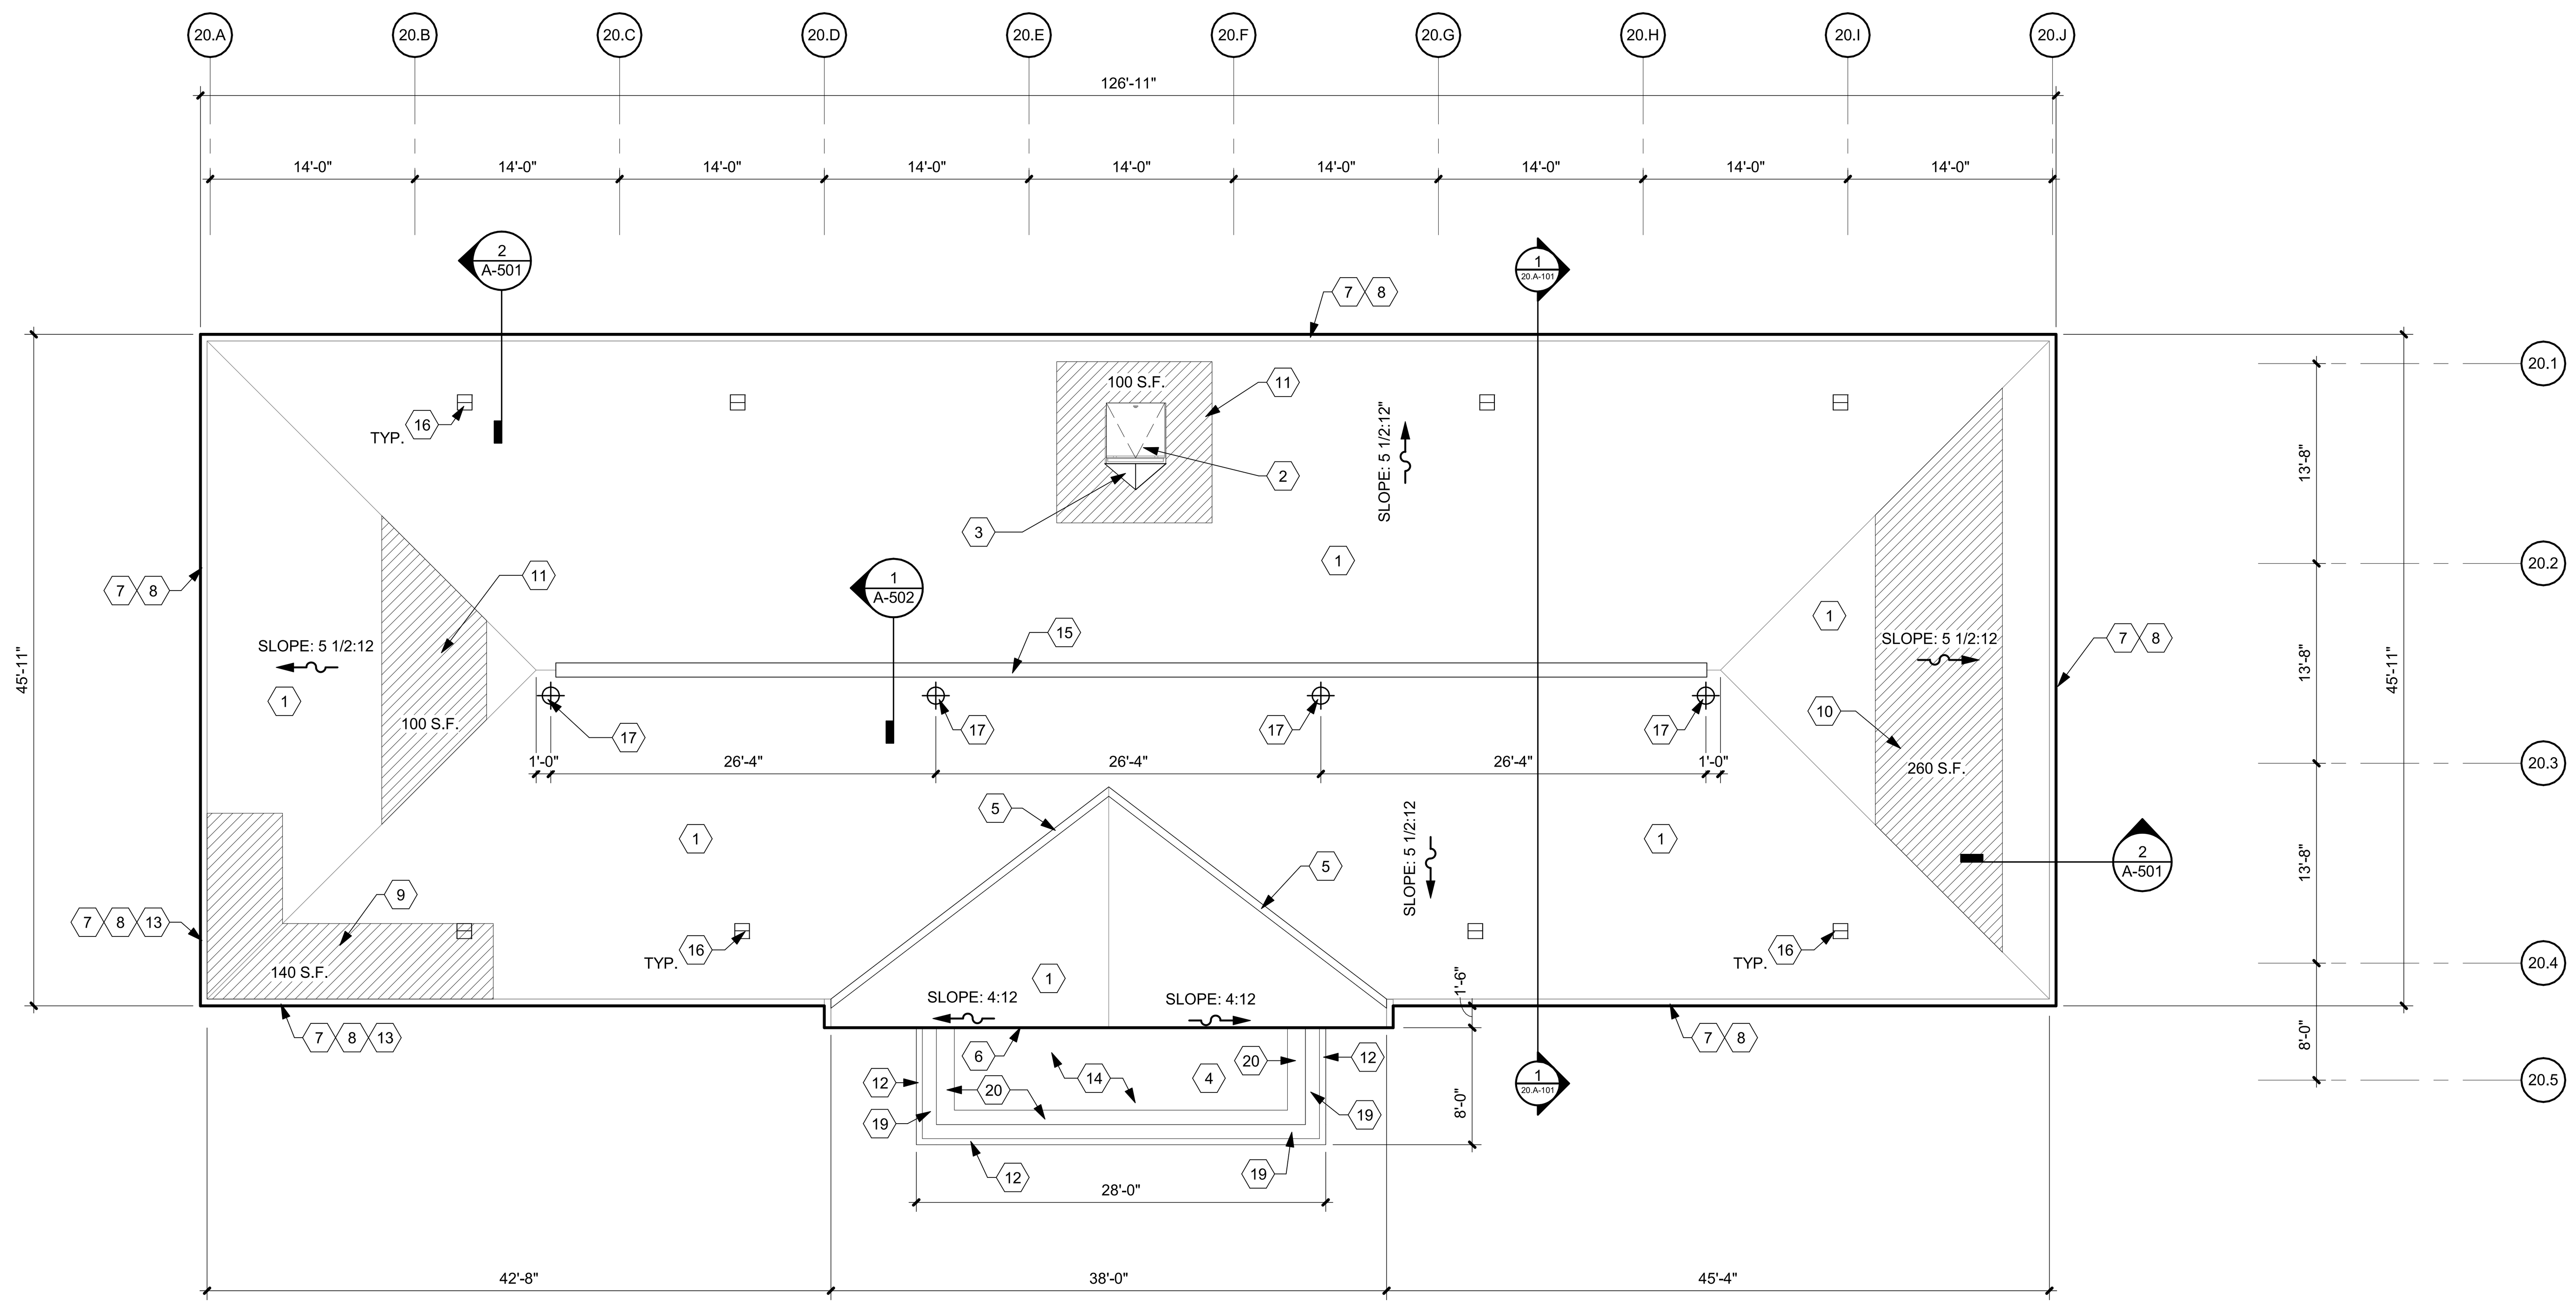

2 BUILDING 20 ROOF PLAN
Scale: 1/8" = 1'-0"

SHEET NOTES:

A. CONTRACTOR TO ENSURE PROPER SAFETY BARRIERS AND ENCLOSURES ARE PROVIDED AT ALL ENTRY/EXIT POINTS FROM BUILDING WHERE WORK IS BEING PERFORMED ABOVE.

B. ALL PERSONNEL TO WEAR PROPER SAFETY DEVICES/FALL PROTECTION.

C. CONTRACTOR SHALL PROVIDE FALL PROTECTION PER OSHA REQUIREMENTS.

D. ALL DIMENSIONS ON THE DRAWINGS HAVE BEEN DETERMINED BASED ON MINIMAL AS-BUILT INFORMATION AVAILABLE. CONTRACTOR TO VERIFY ALL DIMENSIONS AND QUANTITIES PRIOR TO SUBMITTING BID.

E. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING OF EXISTING ROOF STRUCTURE AS NECCESSARY FOR CONTRUCTION LIVE LOADS.

F. APPROXIMATE HEIGHT TO EAVE FROM GRADE AVERAGES APPROX. 30'-0".

G. ATTIC ACCESS FOR WORKERS ACCEPTABLE THROUGH BUILDING INTERIOR.

H. ANY WOOD RAFTER DISCOVERED TO BE NON STRUCTURALLY SOUND SHALL BE REPAIRED AS PER DETAIL 9/A-502.

I. POWER IS NOT AVAILABLE AT THIS BUILDING SITE. ANY ELECTRICAL POWER NEEDED SHALL BE PROVIDED BY THE CONTRACTOR.

KEY NOTES:

1 INSTALL NEW ASPHALT SHINGLE ROOF SYSTEM.
2 REPLACE EXISTING ROOF HATCH, MATCH EXISTING HATCH SIZES. BASIS OF DESIGN: BILCO TYPE S ROOF HATCH W/ LADDER OR EQUAL. INSTALL FLASHING UP TO INTEGRAL CAP FLASHING ON HATCH FRAME. REPLACE DETERIORATED WOOD FRAMING FOR HATCH, ASSUME ALL WOOD TO BE REPLACED.
3 NEW 16 OZ COPPER CRICKET W/SELF ADHERED UNDERLAYMENT. AS PER SMACNA.
4 INSTALL NEW 60 MIL FLEECE BACK TPO ROOFING ON NEW SHEATHING.
5 INSTALL NEW VALLEY FLASHING.
6 INSTALL NEW BASE FLASHING AT WALL PER ROOF SYSTEM MANUFACTURER'S STANDARD DETAILS.
7 EXISTING INTEGRAL GUTTER WITH NEW COPPER LINING, ENSURE PROPER CONNECTIONS TO ALL DOWNSPOUTS AND ALL GUTTER SECTIONS.
8 REPLACE FASCIA, EAVES, SOFFITS AND OTHER ROTTED OR DETERIORATED WOOD MATERIAL BEFORE INSTALLING NEW FLASHING OR ROOF MATERIAL. SEE SHEET A-001 FOR QUANTITIES.
9 INSTALL NEW 3/4" WOOD SHEATHING FLUSH WITH EXISTING (APPROX. 140 S.F.).
10 INSTALL NEW 3/4" WOOD SHEATHING FLUSH WITH EXISTING (APPROX. 260 S.F.).
11 INSTALL NEW 3/4" WOOD SHEATHING FLUSH WITH EXISTING (APPROX. 100 S.F.).
12 NEW 16 OZ COPPER COPING, MATCH EXISTING PROFILE.
13 INSTALL NEW RAFTER TAIL LENGTH MIN 4'-0" (QUANTITY 12).
14 INSTALL NEW 3/4" WOOD SHEATHING. SLOPE SHEATHING TO BUILT IN GUTTER VIA SHIMS.
15 SHINGLE OVER RIDGE VENT.
16 12 X 12 ROOF VENT. BASIS OF DESIGN: GAF, MASTER FLOW ROOF LOUVER SSB960 METAL, SLANT BACK. COLOR TO MATCH SHINGLES, OR EQUAL.
17 INSTALL NEW FALL PROTECTION STANCHION. BOD: FRONTLINE COMMERCIAL ROOF ANCHOR - R012 OR EQUAL, TYPICAL.
18 INSTALL (3) LAYERS OF 2" XPS INSULATION ON TOP OF EXISTING ATTIC SLAB. DEMOLISH ALL CONDUIT AND PIPING TO ALLOW INSULATION TO LAY ON ATTIC SLAB. SEAL ALL OPENINGS WITH FIRE CAULKING. METHOD OF ATTACHMENT - ADHESIVE. BASIS OF DESIGN: OWENS CORNING, FOAMULAR 250, 2" THICK, 4'X8' SHEETS, OR EQUAL ENTIRE ATTIC AREA.
19 INSTALL NEW BUILT IN 16 OZ COPPER GUTTER, PROFILE TO MATCH EXISTING, ALL WELDED SEAMS, NEW 3" ROUND 18 OZ COPPER DOWNSPOUTS.
20 REBUILD SLOTTED PARAPET WALL, INCLUDING FRAMING, WOOD TRIM TO MATCH EXISTING, AND CAP. NEW PARAPET WALL TO MATCH EXISTING IN HEIGHT AND APPEARANCE.

KEY PLAN

SCALE: NO SCALE
AREA OF WORK

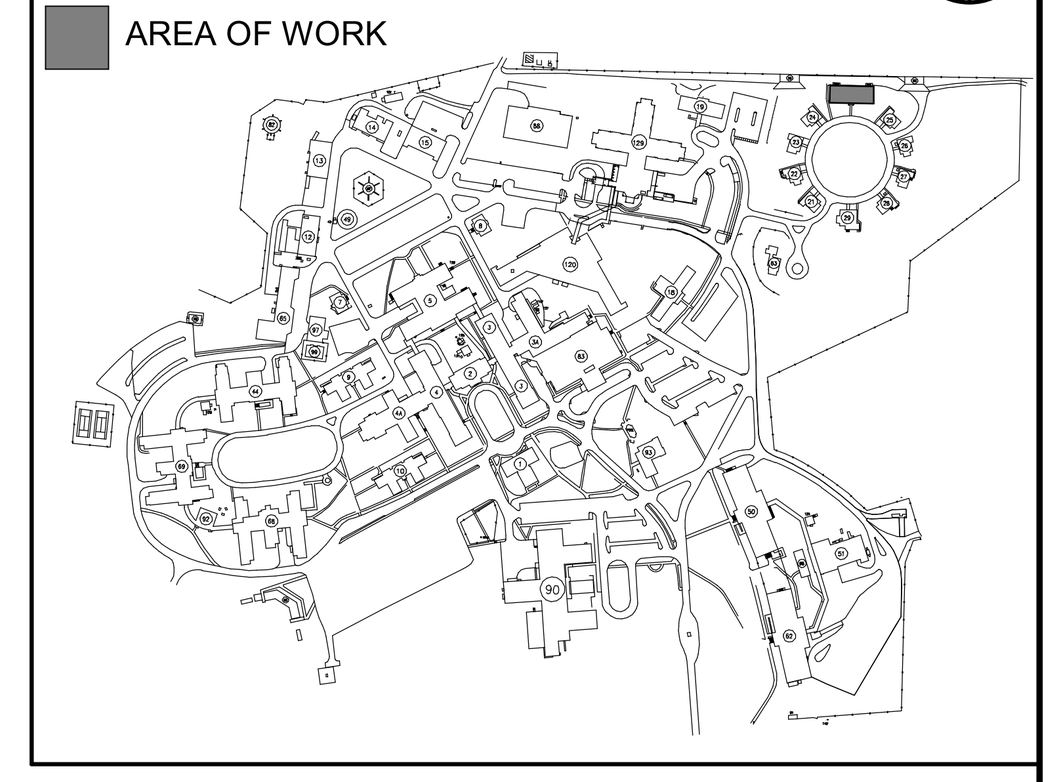

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

APOGEE CONSULTING GROUP, P.A. 52644 RALEIGH, NC

WALTER DAVID VAN SCOTER REG. NO. 9853 STATE OF LOUISIANA REGISTERED ARCHITECT 6/21/2024

PROJECT MANAGER
ACG Project Number 23-069

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 20 ROOF PLAN
Location	CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM 2400 HOSPITAL ROAD TUSKEGEE, AL 36083
Project Title	REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
Approved	
Date	JUNE 19, 2024
Checked	WVS
Drawn	RF
VA PROJECT NUMBER	619A4-24-102
Building Number	# 20
Drawing Number	20.A-101
Dwg	5 of 14

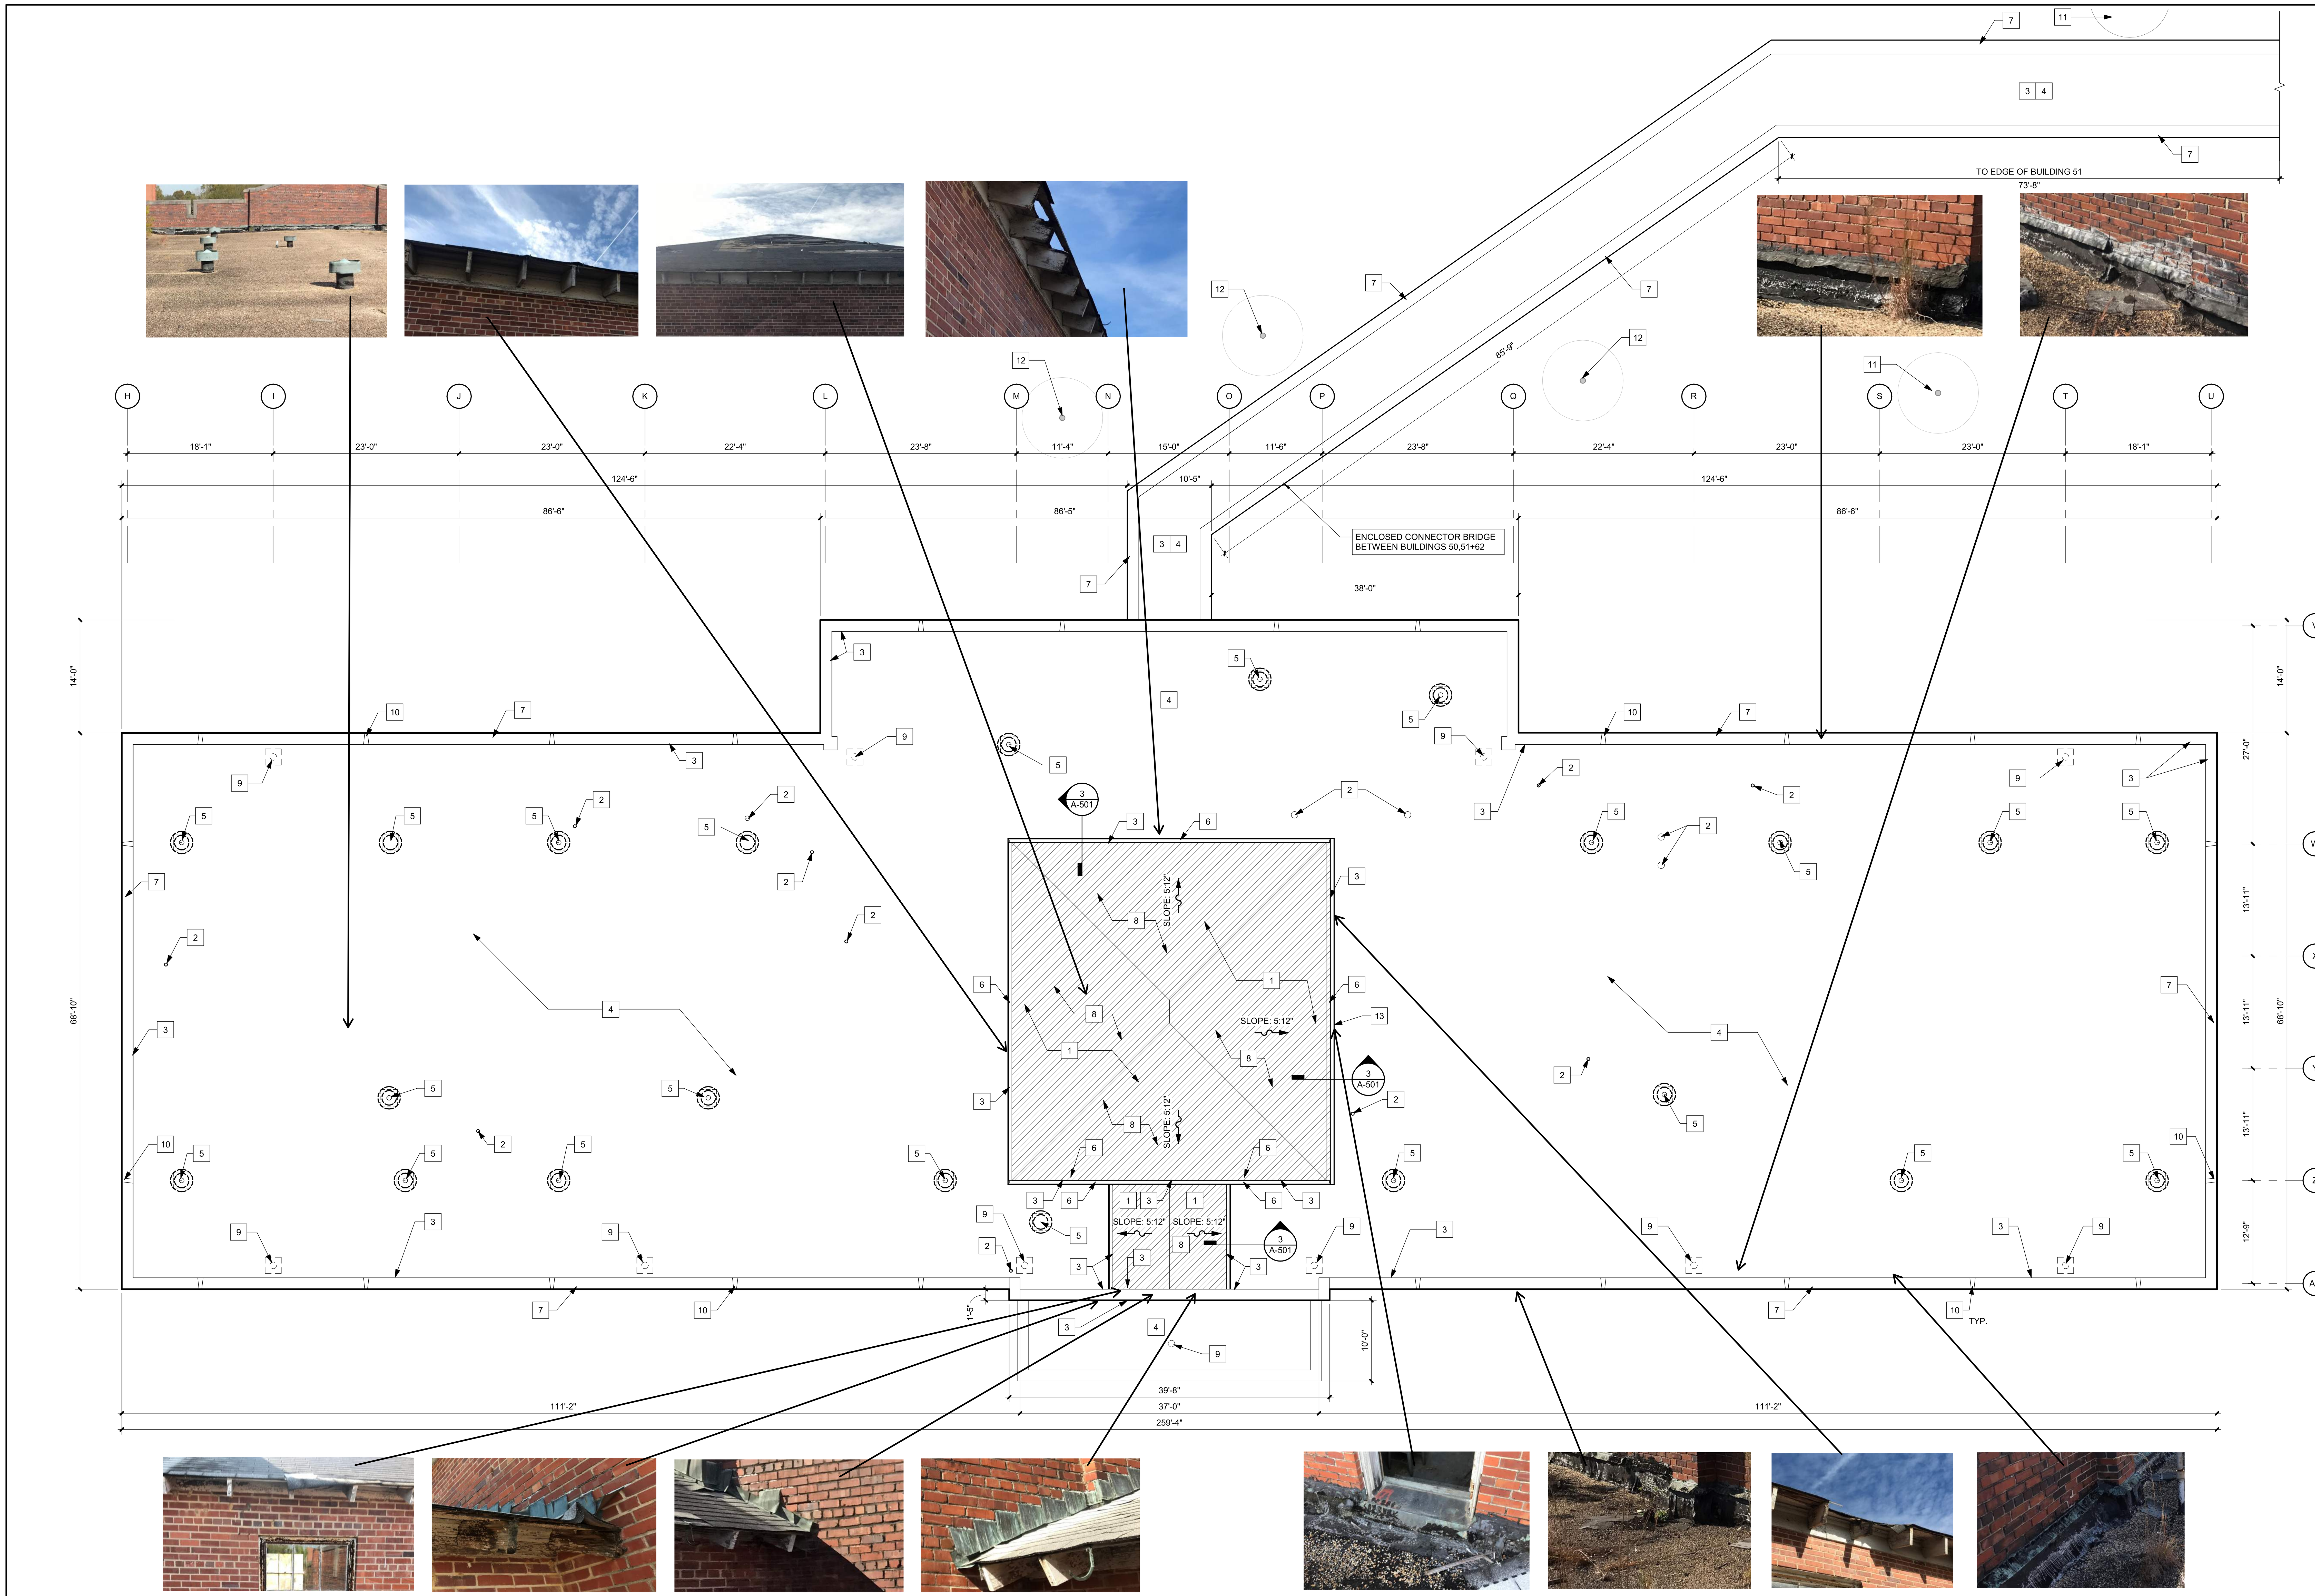

1 **BUILDING 50 DEMOLITION ROOF PLAN**

Scale: 1/8" = 1'-0"

SHEET NOTES:

A. CONTRACTOR TO ENSURE PROPER SAFETY BARRIERS AND ENCLOSURES ARE PROVIDED AT ALL ENTRY/EXIT POINTS FROM BUILDING WHERE WORK IS BEING PERFORMED ABOVE.

B. ALL PERSONNEL TO WEAR PROPER SAFETY DEVICES/FALL PROTECTION.

C. CONTRACTOR TO REMOVE ALL ROOF DRAIN COVERS AND PROVIDE BLOW DOWN OF DRAIN PIPES TO ENSURE NO BLOCKAGE.

D. CONTRACTOR SHALL PROTECT THE EXISTING CONCRETE SLAB FROM DAMAGE DURING CONSTRUCTION.

E. CONTRACTOR TO ASSUME ALL DEMOLITION OF PAINT OR PAINTED WOOD OR METAL CONTAINS LBP AND NEEDS TO BE ABATED PER SPEC SECTION 02 83 33.13

F. ALL DIMENSIONS ON THE DRAWINGS HAVE BEEN DETERMINED BASED ON MINIMAL AS-BUILT INFORMATION AVAILABLE. CONTRACTOR TO VERIFY ALL DIMENSIONS AND QUANTITIES PRIOR TO SUBMITTING BID.

G. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING OF EXISTING ROOF STRUCTURE AS NECESSARY FOR CONSTRUCTION LIVE LOADS.

H. THIS ROOFING PROJECT IS A COMPLETE TEAR OFF AND RE-ROOF. EXIST ROOF HAS A 2 PLY BUILT UP. INSULATION TYPE AND THICKNESS, UNKNOWN. PRICE DEMOLITION OF 6" POLY ISO.

DEMOLITION KEY NOTES:

1 REMOVE EXISTING ASPHALT SHINGLE ROOF SYSTEM AND ALL PARTS OF ROOF SYSTEM INCLUDING EXISTING SUBSTRATE.

2 REMOVE ALL ABANDONED EQUIPMENT, SUPPORTS, PIPES, ANTENNAS, ETC. NOT IN USE.

3 REMOVE FLASHING FOR INSTALLATION OF NEW ROOF SYSTEM.

4 REMOVE EXISTING BUILT UP ROOF SYSTEM INCLUDING INSULATION, ETC. TO CONCRETE SUBSTRATE.

5 EXISTING EXHAUST FANS TO BE REMOVED AND INFILL OPENING IN CONCRETE SUBSTRATE.

6 REMOVE EXISTING ROTTED / DAMAGED FASCIA/DRIP EDGE AROUND PERIMETER OF ROOF.

7 EXISTING CAST STONE/CONCRETE COPING CAP TO REMAIN.

8 REMOVE ALL SUBSTRATE PLANKS, TYPICAL.

9 EXISTING ROOF DRAINS TO BE REMOVED. VERTICAL PIPE TO FIRST 90 DEGREE ELBOW AND THE FIRST 90 DEGREE ELBOW TO BE REPLACED, SEE DETAIL 4/A-502.

10 EXISTING CAST STONE NOTCH IN PARAPET WALL TO REMAIN, TYPICAL.

11 EXISTING LARGE TREE TO BE CUT DOWN AND REMOVED OFFSITE. CUT 1'-0" +/- ABOVE GRADE.

12 EXISTING LARGE TREE, TRIM 10 LARGE BRANCHES (BACK TO MAIN TRUNK) THAT ARE POINTING TOWARD THE BUILDING.

13 REMOVE EXISTING THRESHOLD.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

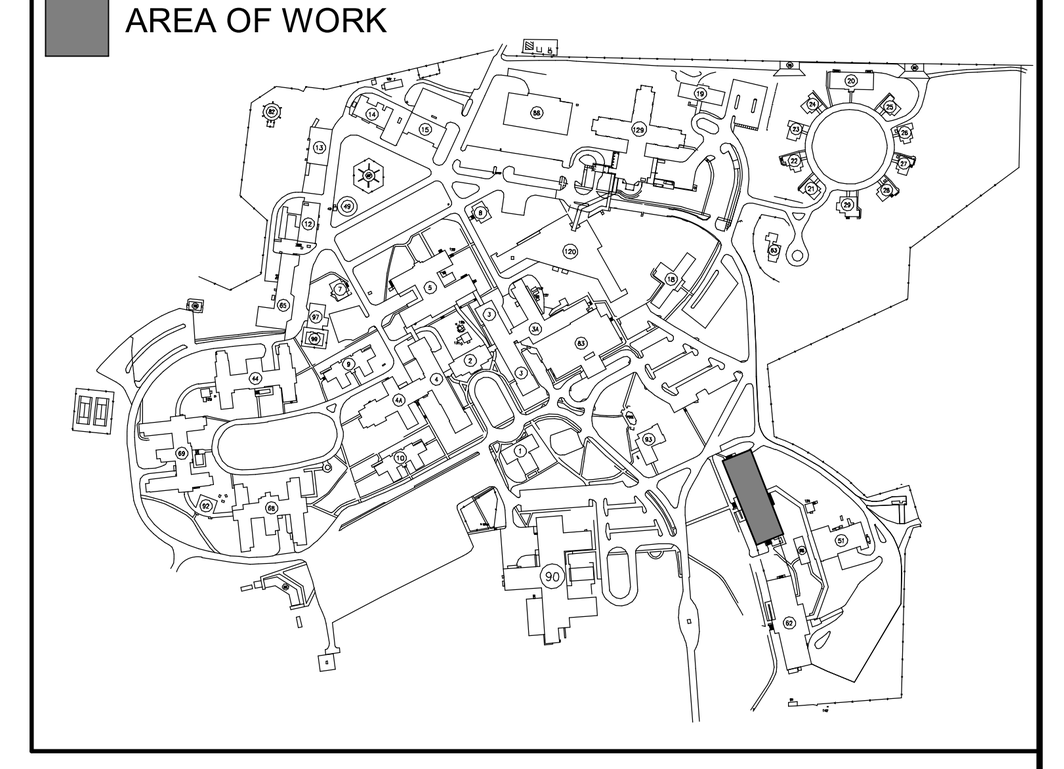

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

PROJECT MANAGER

ACG Project Number 23-069

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

APOGEE Engineers | Architects

6/21/2024

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 50 DEMOLITION ROOF PLAN
Location	CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM, 2400 HOSPITAL ROAD, TUSKEGEE, AL 36083
Project Title	REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
Approved	
Date	JUNE 19, 2024
Checked	WVS
Drawn	RF
VA PROJECT NUMBER	619A4-24-102
Building Number	# 50
Drawing Number	50.AD101
Dwg	6 of 14

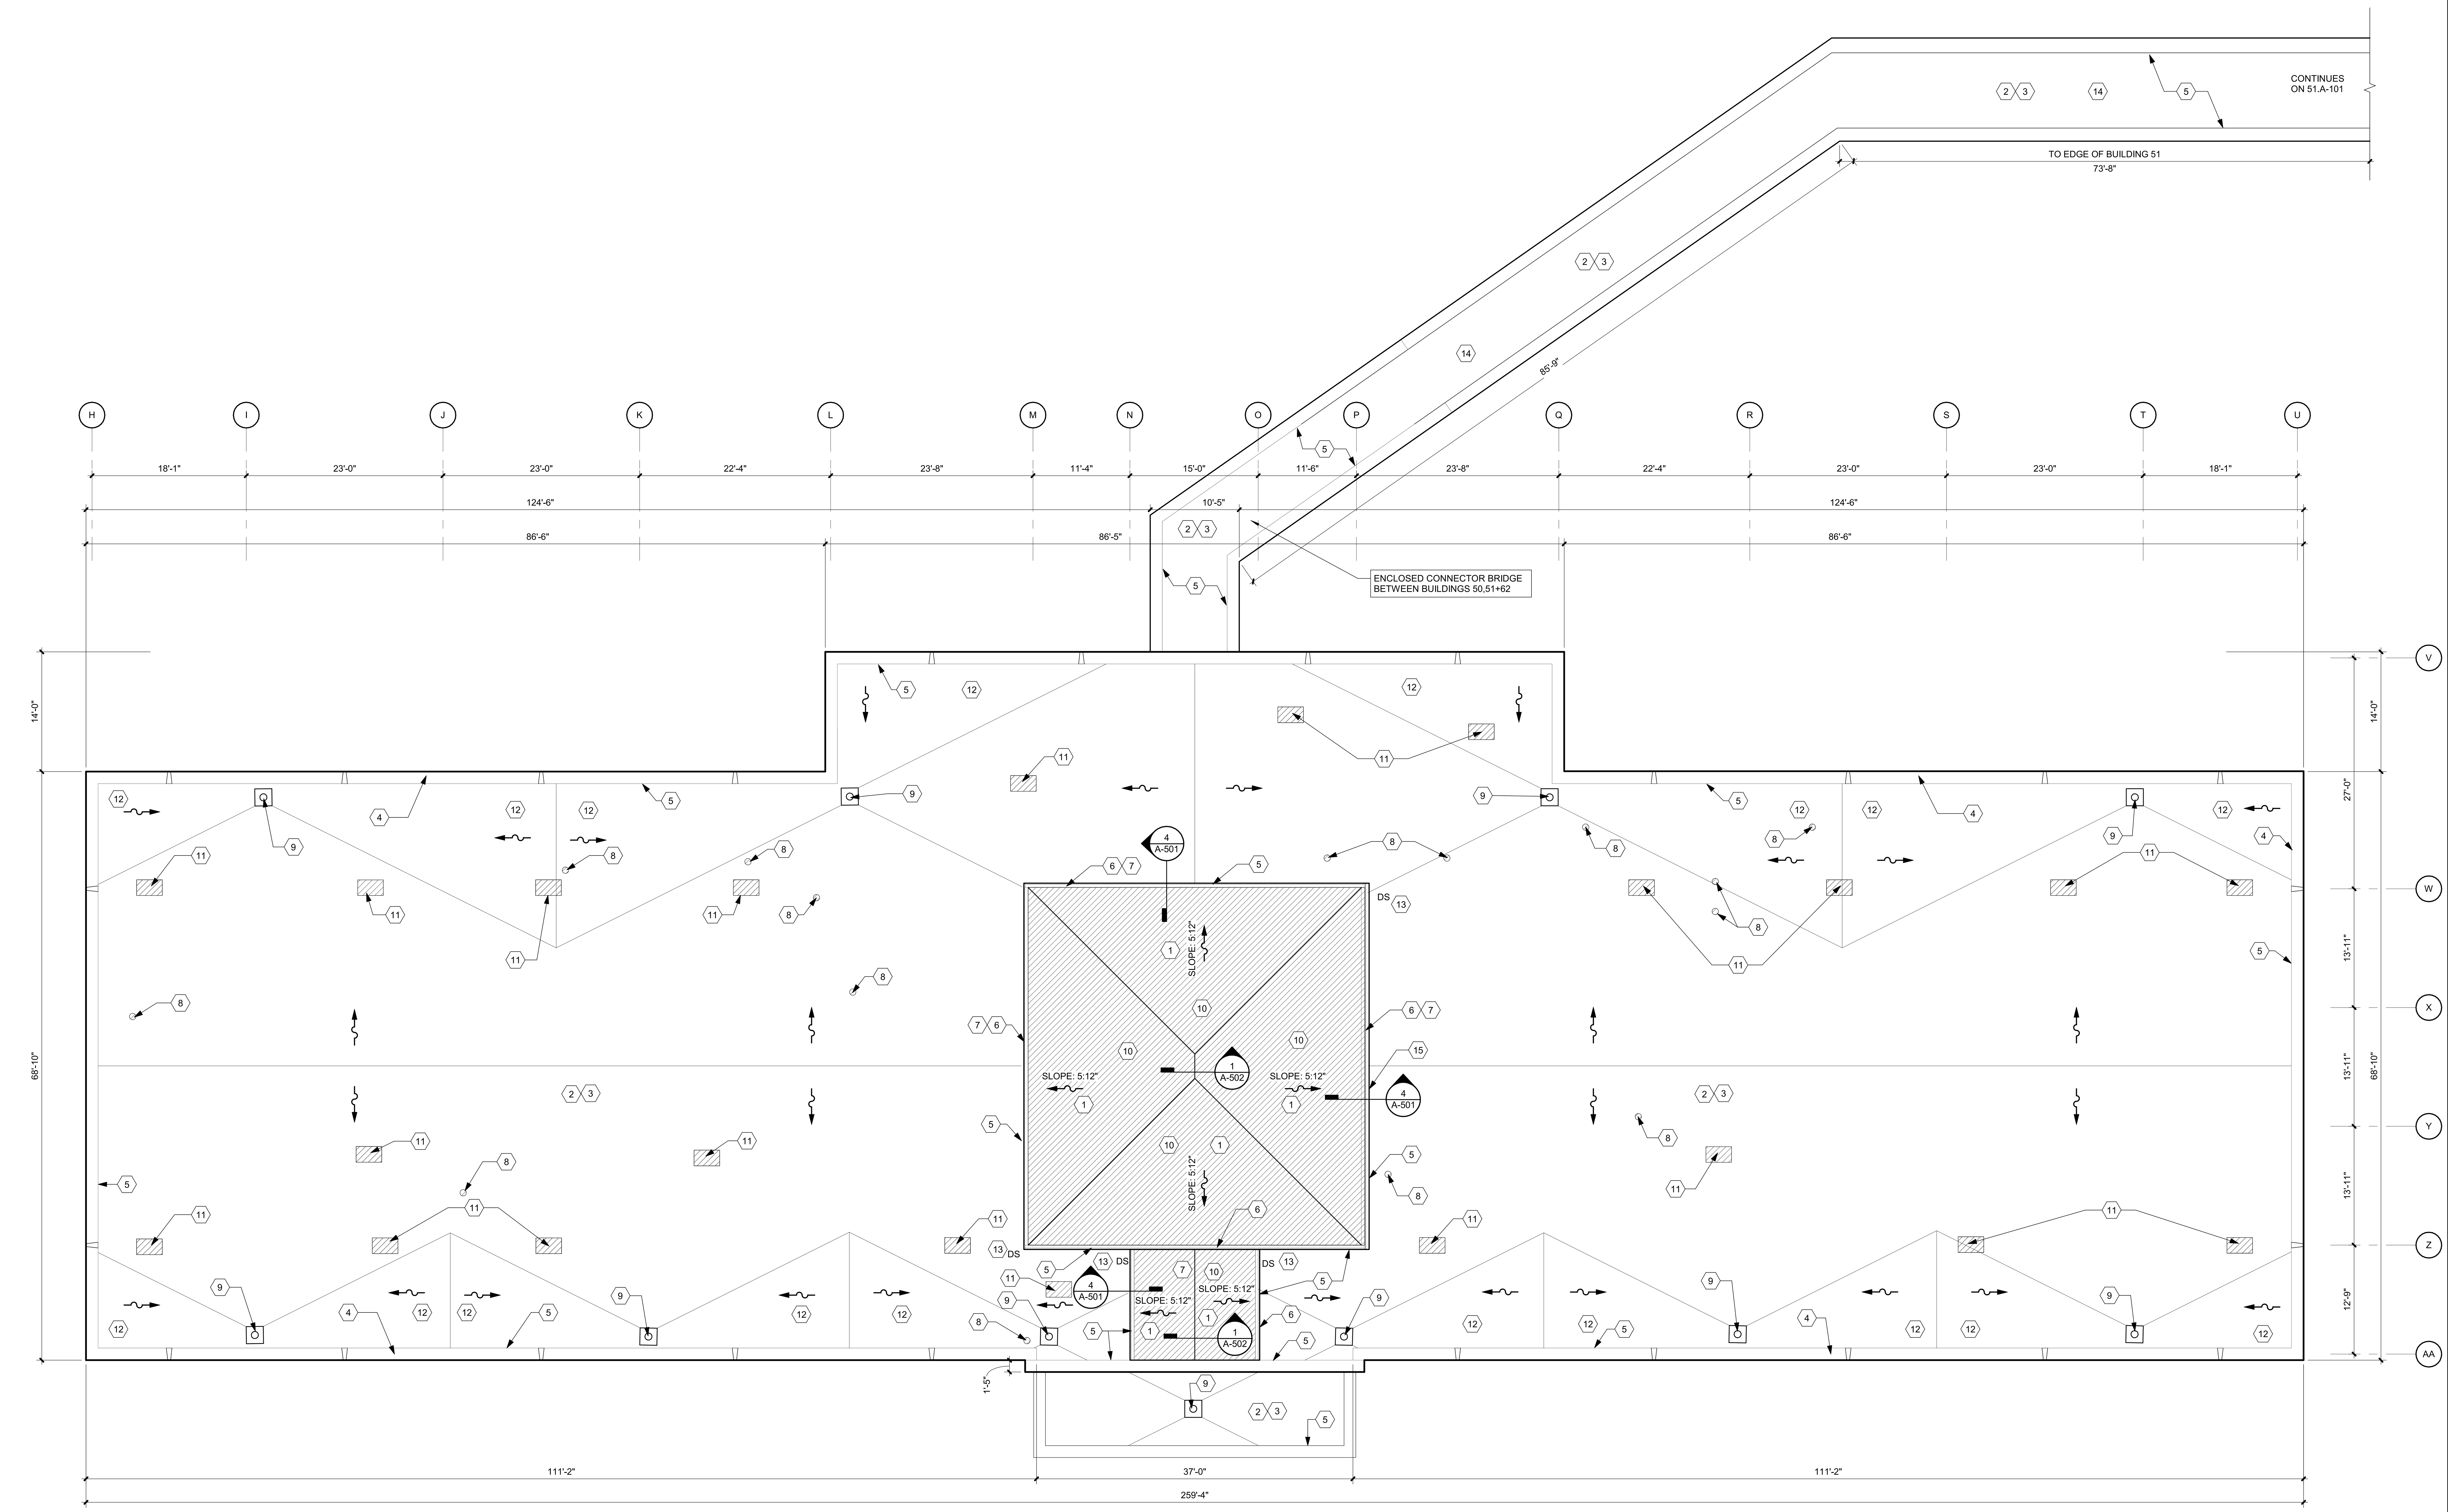

1 BUILDING 50 ROOF PLAN
Scale: 1/8" = 1'-0"

SHEET NOTES:

A. CONTRACTOR TO ENSURE PROPER SAFETY BARRIERS AND ENCLOSURES ARE PROVIDED AT ALL ENTRY/EXIT POINTS FROM BUILDING WHERE WORK IS BEING PERFORMED ABOVE.

B. ALL PERSONNEL TO WEAR PROPER SAFETY DEVICES/FALL PROTECTION.

C. CONTRACTOR TO REMOVE ALL ROOF DRAIN COVERS AND PROVIDE BLOW DOWN OF DRAIN PIPES TO ENSURE NO BLOCKAGE.

D. CONTRACTOR TO VERIFY ALL EXISTING ROOF CURBS, PENETRATIONS, OR ANYTHING ATTACHED TO THE ROOF MEET ROOFING MINIMUM HEIGHT REQUIREMENTS. NOTIFY COR IMMEDIATELY PRIOR TO STARTING WORK.

E. CONTRACTOR SHALL PROVIDE PROTECTION STRUCTURES AS NECESSARY AT ALL WALKWAYS.

F. CONTRACTOR SHALL PROTECT THE EXISTING CONCRETE SLAB FROM DAMAGE DURING CONSTRUCTION.

G. CONTRACTOR TO ASSUME ALL DEMOLITION OF PAINT OR PAINTED WOOD OR METAL CONTAINS LBP AND NEEDS TO BE ABATED PER SPEC SECTION 02 83 33.13.

H. ALL DIMENSIONS ON THE DRAWINGS HAVE BEEN DETERMINED BASED ON MINIMAL AS-BUILT INFORMATION AVAILABLE. CONTRACTOR TO VERIFY ALL DIMENSIONS AND QUANTITIES PRIOR TO SUBMITTING BID.

I. CONTRACTOR TO ENSURE ROOFS SLOPE TO DRAINS, MINIMUM ROOF SLOPE 1/4" = 1'-0".

J. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING OF EXISTING ROOF STRUCTURE AS NECESSARY FOR CONTRUCTION LIVE LOADS.

K. PENTHOUSE ROOF SLOPE IS 5:12 FOR PITCHED ROOF.

L. NEW ROOFING SYSTEM: INSTALL VAPOR BARRIER ON EXISTING CONCRETE DECK (BASIS OF DESIGN, GAF SA VAPOR RETARDER XL, OR EQUAL). R-33 PLYISO INSULATION, ADHERED, LOW RISE FOAM. 5/8" GYPSUM COVER BOARD, ADHERED, LOW RISE FOAM, AND 60 MIL FLEECE BACK, ADHERED, LOW RISE FOAM. (BASIS OF DESIGN, EVERGAURD TPO FLEECE BACK MEMBRANE OR EQUAL).

M. INTERNAL DRAINS NOT ABLE TO BE LOCATED AT BUILDING 50, 51, 62, CONNECTOR DURING A/E SURVEY. CONTRACTOR TO INCLUDE PRICING FOR INSTALLATION OF 6 NEW ROOF DRAINS AT CONNECTOR. INSTALLATION OF DRAIN VERTICAL PIPE DOWN AND 90 ELBOW TO BE INCLUDED.

KEY NOTES:

1 INSTALL NEW ASPHALT SHINGLE ROOF SYSTEM.
2 INSTALL NEW TPO ROOFING SYSTEM.
3 INSTALL ROOF INSULATION AND INSTALL MIN R-33 POLY ISO INSULATION. APPLICATION METHOD - LOW RISE FOAM.
4 EXISTING CAST STONE CONCRETE PARAPET CAP, PRESSURE WASH CAP CLEAN.
5 INSTALL NEW BASE FLASHING AT WALL PER ROOF SYSTEM VENDOR STANDARD DETAILS AND RECOMMENDATIONS.
6 INSTALL NEW GUTTER AND DOWNSPOUTS TO MATCH EXISTING SEE DETAIL 4/A-501.
7 REPLACE ALL FASCIAS, EAVES, SOFFITS, & RAKES BEFORE INSTALLING FLASHING OR REROOFING.
8 FILL ABANDONED CORE HOLES FROM EQUIPMENT DEMOLITION WITH NON SHRINKING CEMENTITIOUS GROUT. ACCEPTABLE METHODS OF INSTALLATION. PLYWOOD FORMS BELOW OR HOLE MOLE CORE HOLE FILLING SYSTEM OR EQUAL.
9 INSTALL NEW ROOF DRAIN ASSEMBLY, REPLACE EXISTING VERTICAL PIPE TO FIRST ELBOW AND REPLACE FIRST 90 DEGREE ELBOW AND RECONNECT TO EXISTING STORM.
10 REPLACE ALL SUBSTRATE PLANKS, WITH NEW 3/4" PT PLYWOOD, TYPICAL.
11 PATCH OPENINGS IN CONCRETE ROOF DECK WHERE EQUIPMENT WAS REMOVED, SEE DETAIL 3/A-501.
12 INSTALL CRICKETS WITH TAPERED RIGID INSULATION. ALL ANGLES TO BE 2:1 OR 3:1.
13 PROVIDE AND INSTALL 12"X24"X4" H MIN. PRE CAST CONCRETE SPLASH BLOCK.
14 INTERNAL DRAINS NOT ABLE TO BE LOCATED AT BUILDING 50, 51, 62, CONNECTOR DURING A/E SURVEY. CONTRACTOR TO INCLUDE PRICING FOR INSTALLATION OF 6 NEW ROOF DRAINS AT CONNECTOR. INSTALLATION OF DRAIN VERTICAL PIPE DOWN AND 90 ELBOW TO BE INCLUDED.
15 NEW BRAKE METAL THRESHOLD. 16 GA. GALVANIZED METAL 3" VERTICAL LEG TO EXTERIOR, HORIZONTAL = WIDTH OF WALL VERTICAL LEG TO BE OVER NEW MEMBRANE. TYPICAL (2) LOCATIONS.

KEY PLAN
SCALE: NO SCALE
AREA OF WORK

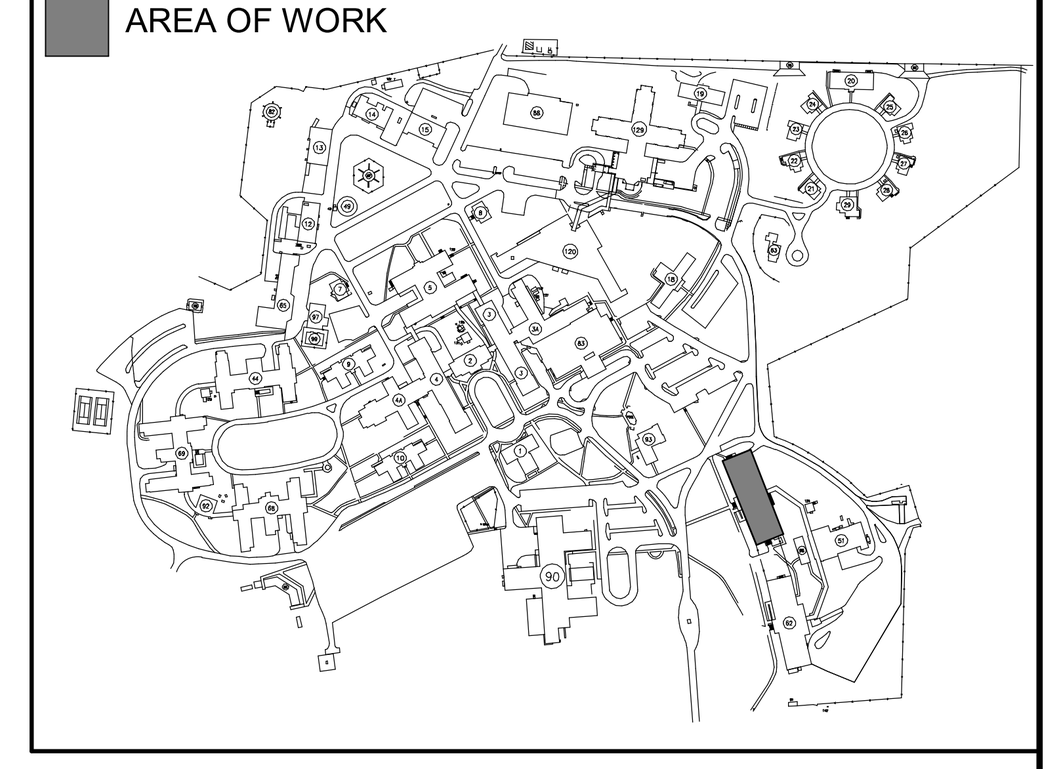

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

APOGEE CONSULTING GROUP, P.A. 52644 RALEIGH, NC

WALTER DAVID VAN SCOTER REG. NO. 9953 STATE OF LOUISIANA REGISTERED ARCHITECT 6/21/2024

PROJECT MANAGER
ACG Project Number 23-069

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 50 ROOF PLAN

Location: CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM
2400 HOSPITAL ROAD
TUSKEGEE, AL 36083

Project Title: REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62

Approved

Date	Checked	Drawn
JUNE 19, 2024	WVS	RF

VA PROJECT NUMBER 619A4-24-102

Building Number # 50

Drawing Number 50.A-101

Dwg 7 of 14

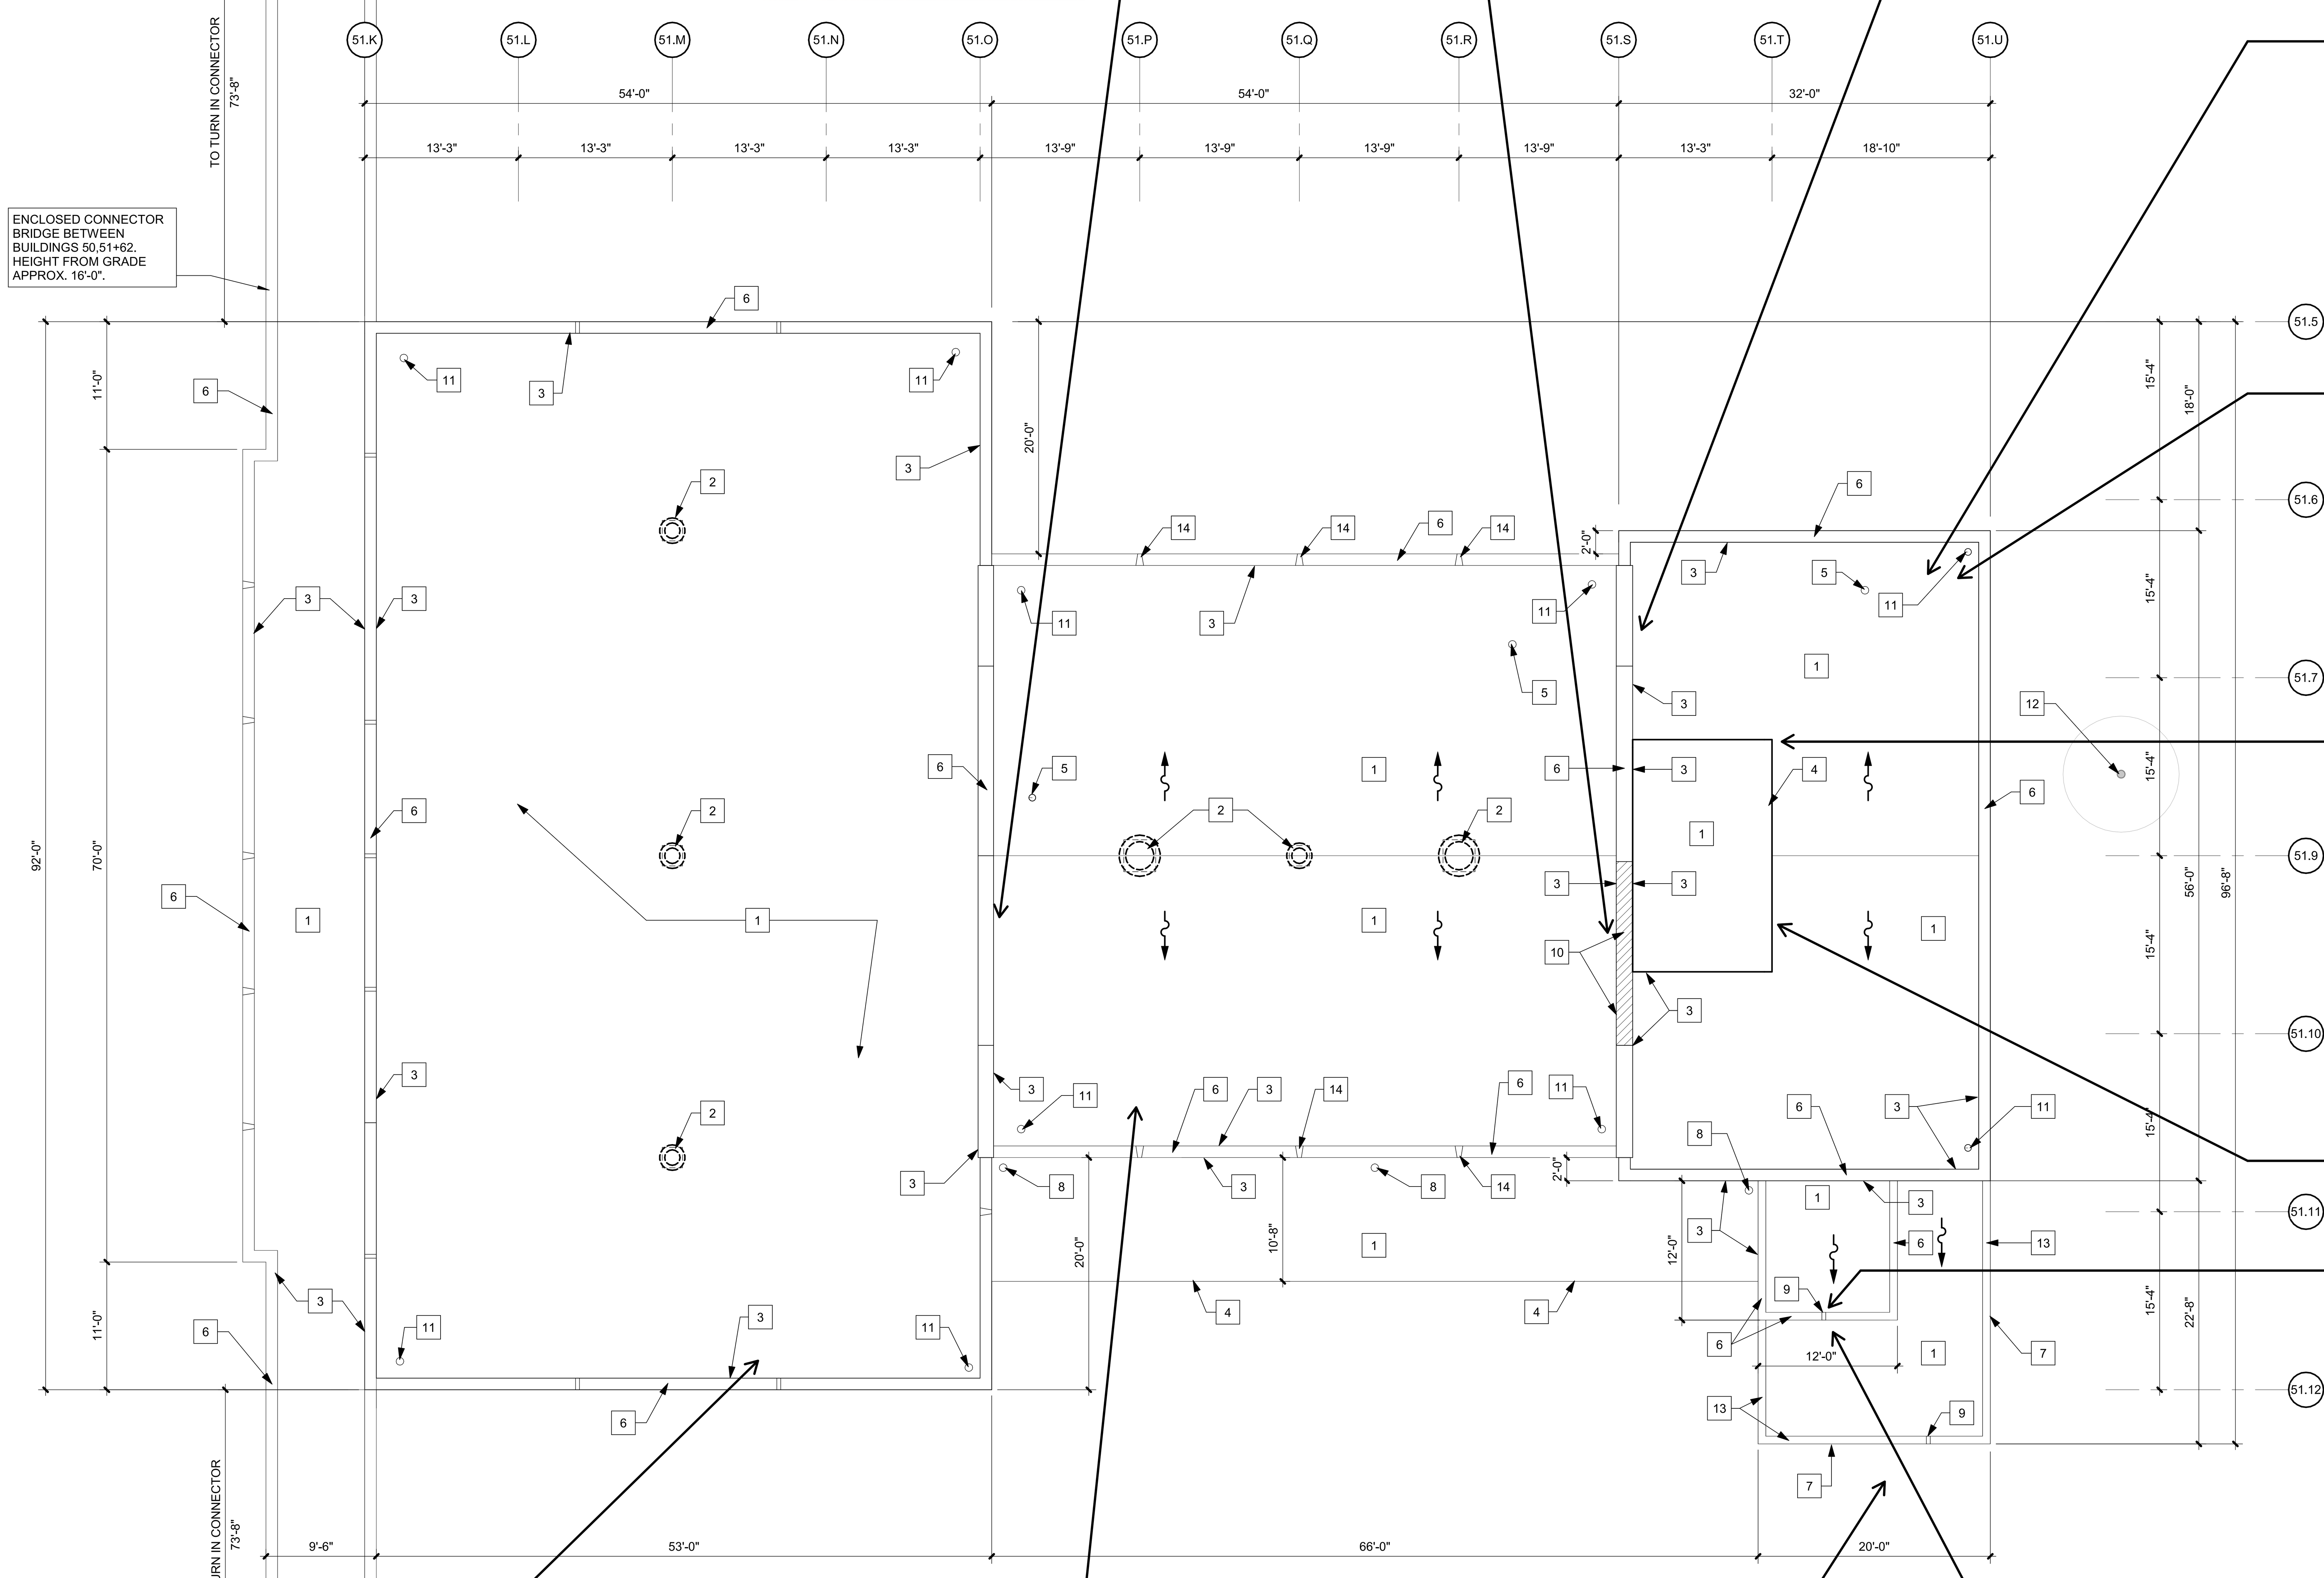

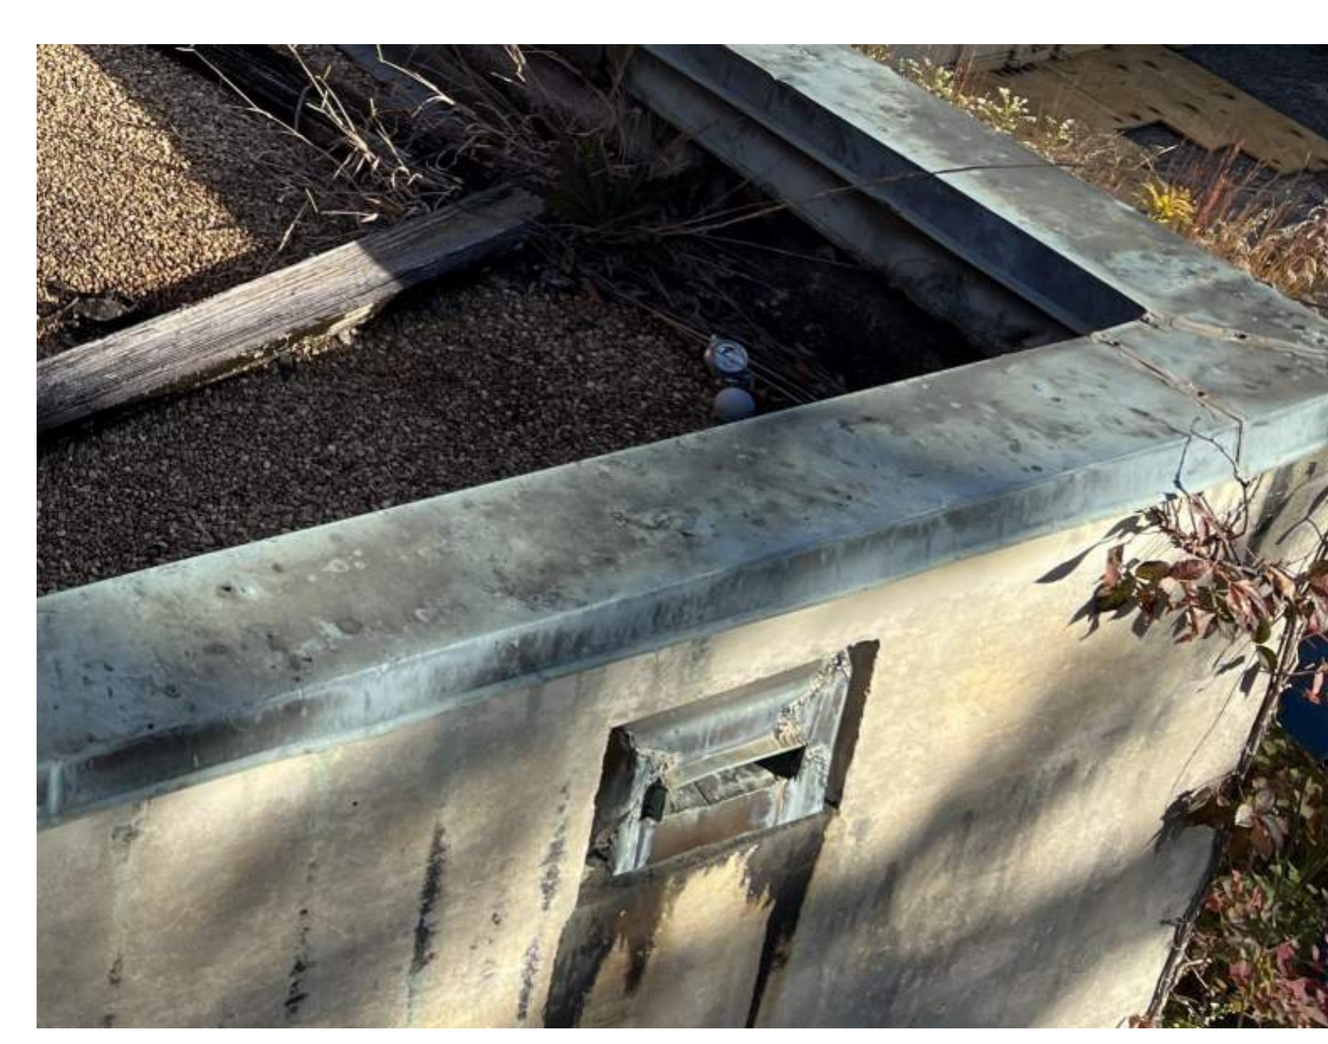

1 **BUILDING 51 DEMOLITION ROOF PLAN**
Scale: 1/8" = 1'-0"

0 4 8 16 NORTH

SHEET NOTES:

A. CONTRACTOR TO ENSURE PROPER SAFETY BARRIERS AND ENCLOSURES ARE PROVIDED AT ALL ENTRY/EXIT POINTS FROM BUILDING WHERE WORK IS BEING PERFORMED ABOVE.

B. ALL PERSONNEL TO WEAR PROPER SAFETY DEVICES/FALL PROTECTION.

C. CONTRACTOR TO REMOVE ALL ROOF DRAIN COVERS AND PROVIDE BLOW DOWN OF DRAIN PIPES TO ENSURE NO BLOCKAGE. DRAIN PIPING TO BE REPLACED TO FIRST 90 DEGREE ELBOW.

D. CONTRACTOR SHALL PROTECT THE EXISTING CONCRETE SLAB FROM DAMAGE DURING CONSTRUCTION.

E. CONTRACTOR SHALL PROVIDE PROTECTION STRUCTURES AS NECESSARY AT ALL WALKWAYS.

F. CONTRACTOR SHALL PROTECT THE EXISTING CONCRETE SLAB FROM DAMAGE DURING RESTORATION.

G. CONTRACTOR TO ASSUME ALL DEMOLITION OF PAINT OR PAINTED WOOD OR METAL CONTAINS LBP AND NEEDS TO BE ABATED PER SPEC SECTION 02 83 33.13

H. ALL DIMENSIONS ON THE DRAWINGS HAVE BEEN DETERMINED BASED ON MINIMAL AS-BUILT INFORMATION AVAILABLE. CONTRACTOR TO VERIFY ALL DIMENSIONS AND QUANTITIES PRIOR TO SUBMITTING BID.

J. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING OF EXISTING ROOF STRUCTURE AS NECESSARY FOR CONSTRUCTION LIVE LOADS.

DEMOLITION KEY NOTES:

1 REMOVE EXISTING BUILT UP ROOF SYSTEM INCLUDING INSULATION, ETC. TO CONCRETE SUBSTRATE.
2 REMOVE ALL ABANDONED EQUIPMENT, SUPPORTS, PIPES, ANTENNAS, ETC. NOT IN USE. CONFIRM ABANDONED ITEMS WITH COR PRIOR TO REMOVAL.
3 REMOVE FLASHING.
4 REMOVE EXISTING LOW PROFILE EDGE MATERIAL FOR BUILT UP ROOF SYSTEM.
5 EXISTING VTR TO BE REMOVED.
6 EXISTING CAST STONE/CONCRETE COPING CAP TO REMAIN.
7 EXISTING METAL COPING TO REMAIN, REMOVE AS NECESSARY TO REROOF AREA.
8 EXISTING ROOF DRAINS TO BE REMOVED.
9 REMOVE THROUGH WALL SCUPPER.
10 BRICK DAMAGE AND STONE COPING DISPLACEMENT. REBUILD ALL LAYERS OF BRICK (APPROX. 100 S.F.) AND RE-SET 20 L.F. OF STONE COPING.
11 EXISTING ROOF DRAINS TO BE REMOVED. VERTICAL PIPE TO EXISTING STORM SEWER BELOW TO BE REPLACED. BLOW OUT DRAIN TO ENSURE THERE IS NO BLOCKAGE. SEE DETAIL 4/A-502
12 EXISTING LARGE TREE TO BE CUT DOWN AND REMOVED OFFSITE. CUT 1'-0" +/- ABOVE GRADE.
13 REMOVE EXISTING COPPER COPING.
14 REMOVE EXISTING SLOPED COPPER.

KEY PLAN

SCALE: NO SCALE
AREA OF WORK

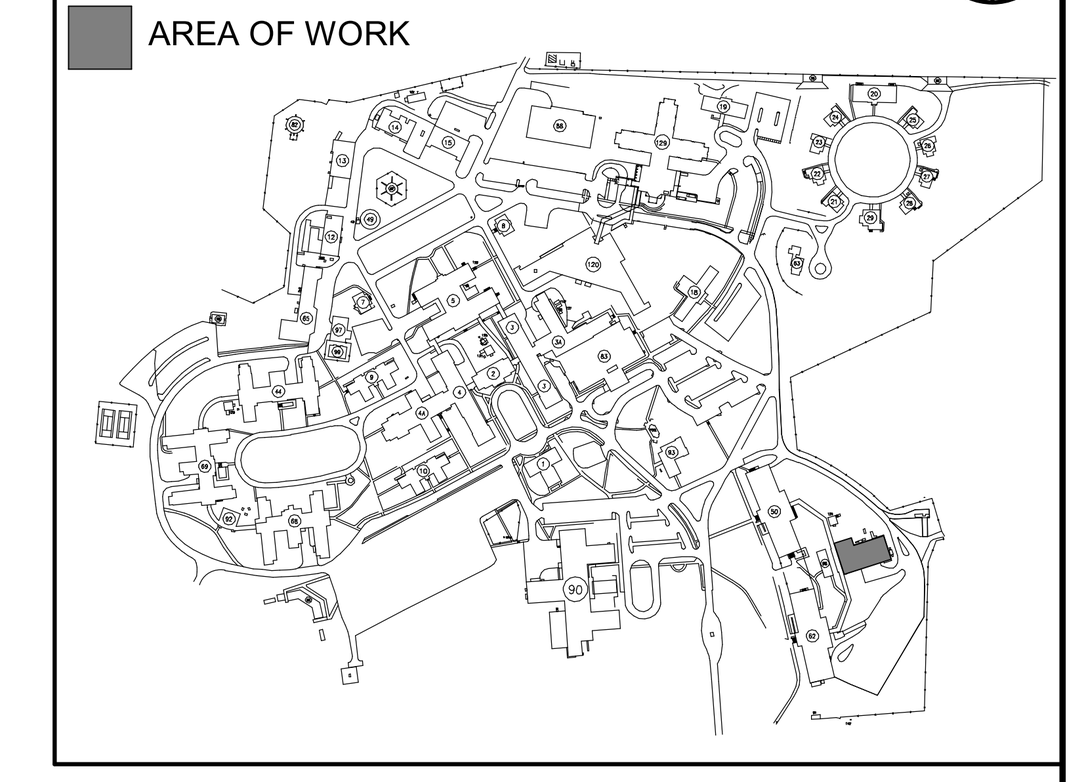

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

PROJECT MANAGER
ACG Project Number 23-069

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 51 DEMOLITION ROOF PLAN

Location: CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM
2400 HOSPITAL ROAD
TUSKEGEE, AL 36083

Project Title: REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62

Approved:

Date: JUNE 19, 2024 | Checked: WVS | Drawn: RF

VA PROJECT NUMBER: 619A4-24-102
Building Number: # 51
Drawing Number: 51.AD101
Dwg 8 of 14

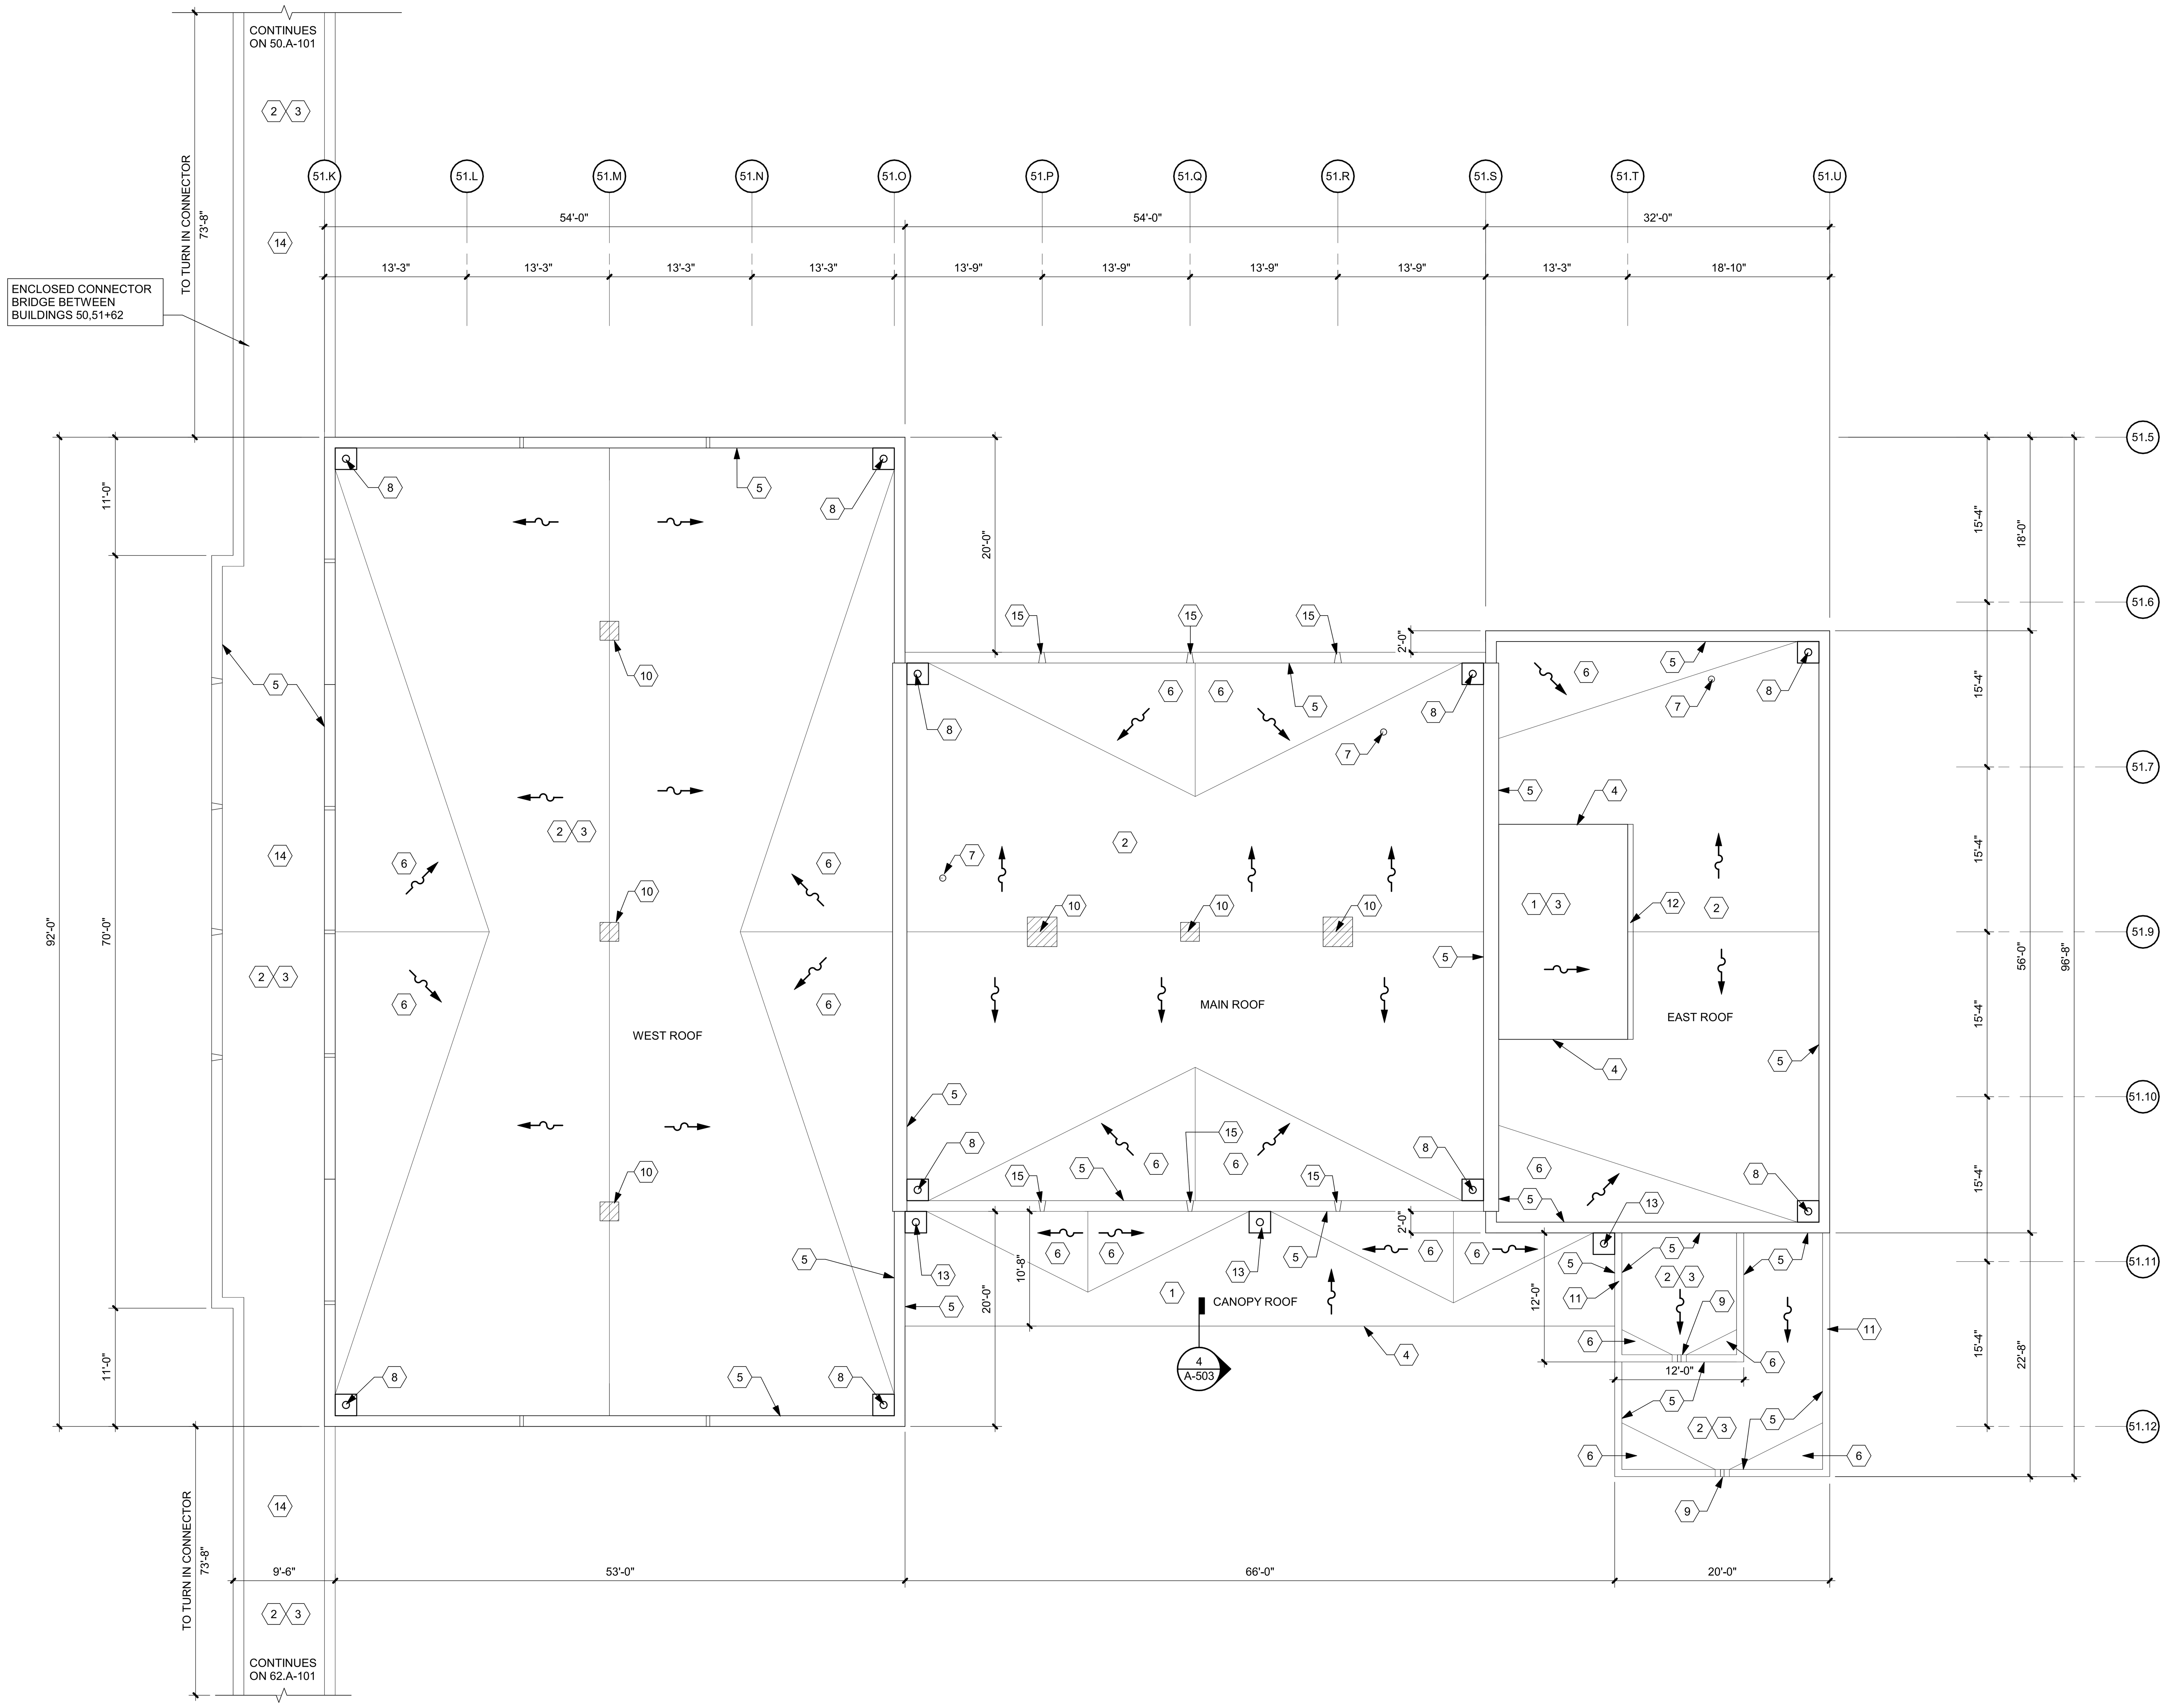

1 BUILDING 51 ROOF PLAN

Scale: 1/8" = 1'-0"

0 4 8 16

NORTH

SHEET NOTES:

A. CONTRACTOR TO ENSURE PROPER SAFETY BARRIERS AND ENCLOSURES ARE PROVIDED AT ALL ENTRY/EXIT POINTS FROM BUILDING WHERE WORK IS BEING PERFORMED ABOVE.

B. ALL PERSONNEL TO WEAR PROPER SAFETY DEVICES/FALL PROTECTION.

C. CONTRACTOR TO REMOVE ALL ROOF DRAIN COVERS AND PROVIDE BLOW DOWN OF DRAIN PIPES TO ENSURE NO BLOCKAGE.

D. CONTRACTOR TO VERIFY ALL EXISTING ROOF CURBS, PENETRATIONS, OR ANYTHING ATTACHED TO THE ROOF MEET ROOFING MINIMUM HEIGHT REQUIREMENTS. NOTIFY COR IMMEDIATELY PRIOR TO STARTING WORK.

E. CONTRACTOR SHALL PROVIDE PROTECTION STRUCTURES AS NECESSARY AT ALL WALKWAYS.

F. CONTRACTOR SHALL PROTECT THE EXISTING CONCRETE SLAB FROM DAMAGE DURING CONSTRUCTION.

G. CONTRACTOR TO ASSUME ALL DEMOLITION OF PAINT OR PAINTED WOOD OR METAL CONTAINS LBP AND NEEDS TO BE ABATED PER SPEC SECTION 02 83 33.13.

H. ALL DIMENSIONS ON THE DRAWINGS HAVE BEEN DETERMINED BASED ON MINIMAL AS-BUILT INFORMATION AVAILABLE. CONTRACTOR TO VERIFY ALL DIMENSIONS AND QUANTITIES PRIOR TO SUBMITTING BID.

I. CONTRACTOR TO ENSURE ROOFS SLOPE TO DRAINS, MINIMUM ROOF SLOPE 1/4" = 1'-0".

J. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING OF EXISTING ROOF STRUCTURE AS NECESSARY FOR CONTRUCTION LIVE LOADS.

K. PENTHOUSE ROOF SLOPE IS 5:12 FOR PITCHED ROOF.

L. WEST ROOF AND CONNECTOR ROOF:

NEW ROOFING SYSTEM: INSTALL VAPOR BARRIER ON EXISTING CONCRETE DECK (BASIS OF DESIGN, GAF SA VAPOR RETARDER XL, OR EQUAL). R-33 PLYISO INSULATION, ADHERED, LOW RISE FOAM. 5/8" GYPSUM COVER BOARD, ADHERED, LOW RISE FOAM, AND 60 MIL FLEECE BACK, ADHERED, LOW RISE FOAM. (BASIS OF DESIGN, EVERGAURD TPO FLEECE BACK MEMBRANE).

M. MAIN ROOF AND EAST ROOF:

NEW ROOFING SYSTEM: INSTALL VAPOR BARRIER ON EXISTING CONCRETE DECK (BASIS OF DESIGN, GAF SA VAPOR RETARDER XL, OR EQUAL. 5/8" GYPSUM COVER BOARD, ADHERED, LOW RISE FOAM AND 60 MIL FLEECE BACK TPO, ADHERED, LOW RISE FOAM. THESE TWO ROOFS DO NOT HAVE INSULATION, INSULATION CAN BE INSTALLED INSIDE UNDER SEPARATE FUTURE PROJECT.

KEY NOTES:

1 INSTALL NEW 60 MIL FLEECE BACK TPO MEMBRANE (LOW RISE FOAM) OVER 2" POLY STYRENE (LOW RISE FOAM).
2 INSTALL NEW 60 MIL FLEECE BACK TPO MEMBRANE (LOW RISE FOAM) OVER 5/8" GYPSUM COVER BOARD (LOW RISE FOAM).
3 INSTALL ROOF INSULATION R-33 POLYISO.
4 INSTALL NEW EDGE TRIM PER ROOF SYSTEM VENDOR STANDARD DETAILS AND RECOMMENDATIONS. SEE 1/A-503.
5 INSTALL NEW BASE FLASHING AT WALL PER ROOF SYSTEM VENDOR STANDARD DETAILS AND RECOMMENDATIONS.
6 INSTALL CRICKETS WITH TAPERED RIGID INSULATION. ANGLES TO BE 2:1 OR 3:1.
7 FILL ABANDONED CORE HOLES FROM EQUIPMENT DEMOLITION WITH NON SHRINKING CEMENTITIOUS GROUT. ACCEPTABLE METHODS OF INSTALLATION. PLYWOOD FORMS BELOW OR HOLE MOLE CORE HOLE FILLING SYSTEM OR EQUAL.
8 PROVIDE NEW ROOF DRAIN, REPLACE EXISTING VERTICAL PIPE TO FIRST ELBOW AND REPLACE FIRST 90 DEGREE ELBOW AND RECONNECT TO EXISTING STORM. BASIS OF DESIGN FOR ALL NEW FLAT ROOF DRAINS: J.R. SMITH 1010 LARGE GENERAL PURPOSE ROOF DRAIN OR EQUAL.
9 INSTALL METAL THROUGH WALL SCUPPER AND FLASHING, SEE DETAIL 2/A-503.
10 PATCH OPENINGS IN CONCRETE ROOF DECK WHERE EQUIPMENT WAS REMOVED, SEE DETAIL 7/A-501.
11 INSTALL NEW METAL COPING CAP ON PARAPET.
12 NEW GUTTER AND DOWNSPOUT. SEE 7/A-503.
13 PROVIDE NEW ROOF DRAIN, REPLACE EXISTING VERTICAL PIPE TO EXISTING STORM SEWER CONNECTION BELOW. BLOW OUT DRAIN TO ENSURE THERE IS NO BLOCKAGE. DRAIN INSERT: BASIS OF DESIGN OLYFLOW HERCULES DRAIN BY OLYFLOW ROOFING OR EQUAL. FOLLOW ALL MANUFACTURER'S INSTALLATION RECOMMENDATIONS.
14 INTERNAL DRAINS NOT ABLE TO BE LOCATED AT BUILDING 50, 51, 62, CONNECTOR DURING A/E SURVEY. CONTRACTOR TO INCLUDE PRICING FOR INSTALLATION OF 6 NEW ROOF DRAINS AT CONNECTOR. INSTALLATION OF DRAIN VERTICAL PIPE DOWN AND 90 ELBOW TO BE INCLUDED.
15 SEE 6/A-503 FOR FLASHING DETAIL @ PARAPET ABOVE EXISTING KITCHEN.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

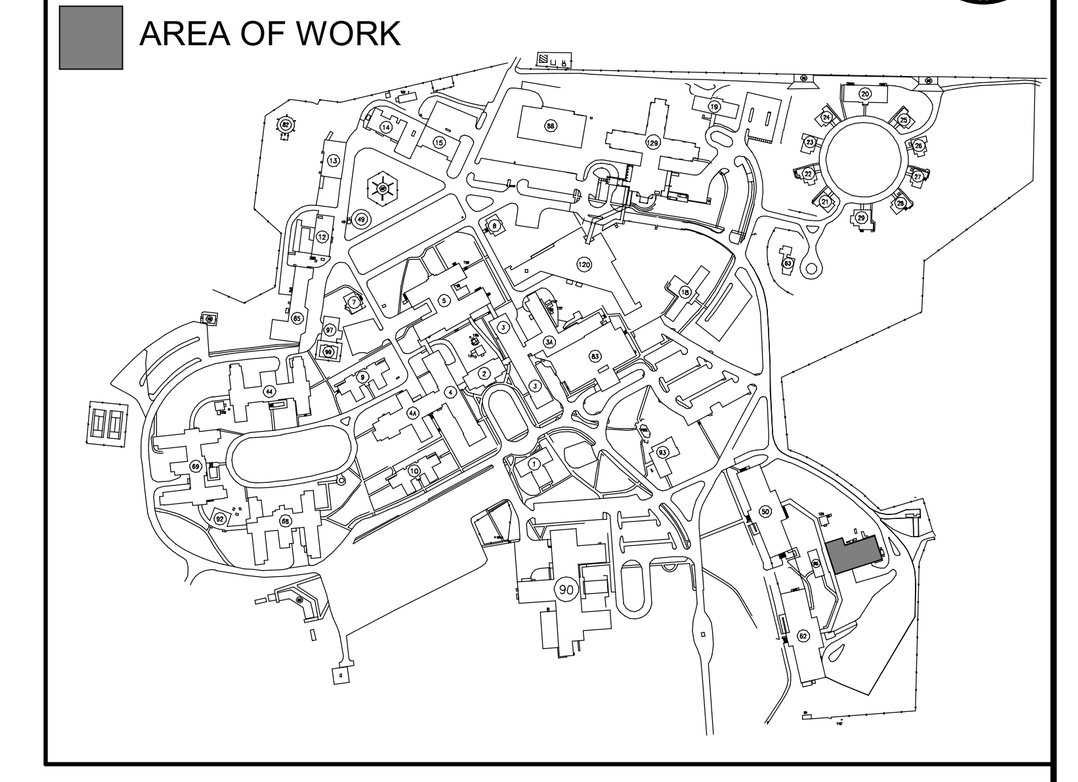

N

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

52644

6/21/2024

PROJECT MANAGER

ACG Project Number 23-069

APOGEE
Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 51 ROOF PLAN
Location	CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM 2400 HOSPITAL ROAD TUSKEGEE, AL 36083
Project Title	REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
Approved	
Date	JUNE 19, 2024
Checked	WVS
Drawn	RF
VA PROJECT NUMBER	619A4-24-102
Building Number	# 51
Drawing Number	51.A-101
Dwg	9 of 14

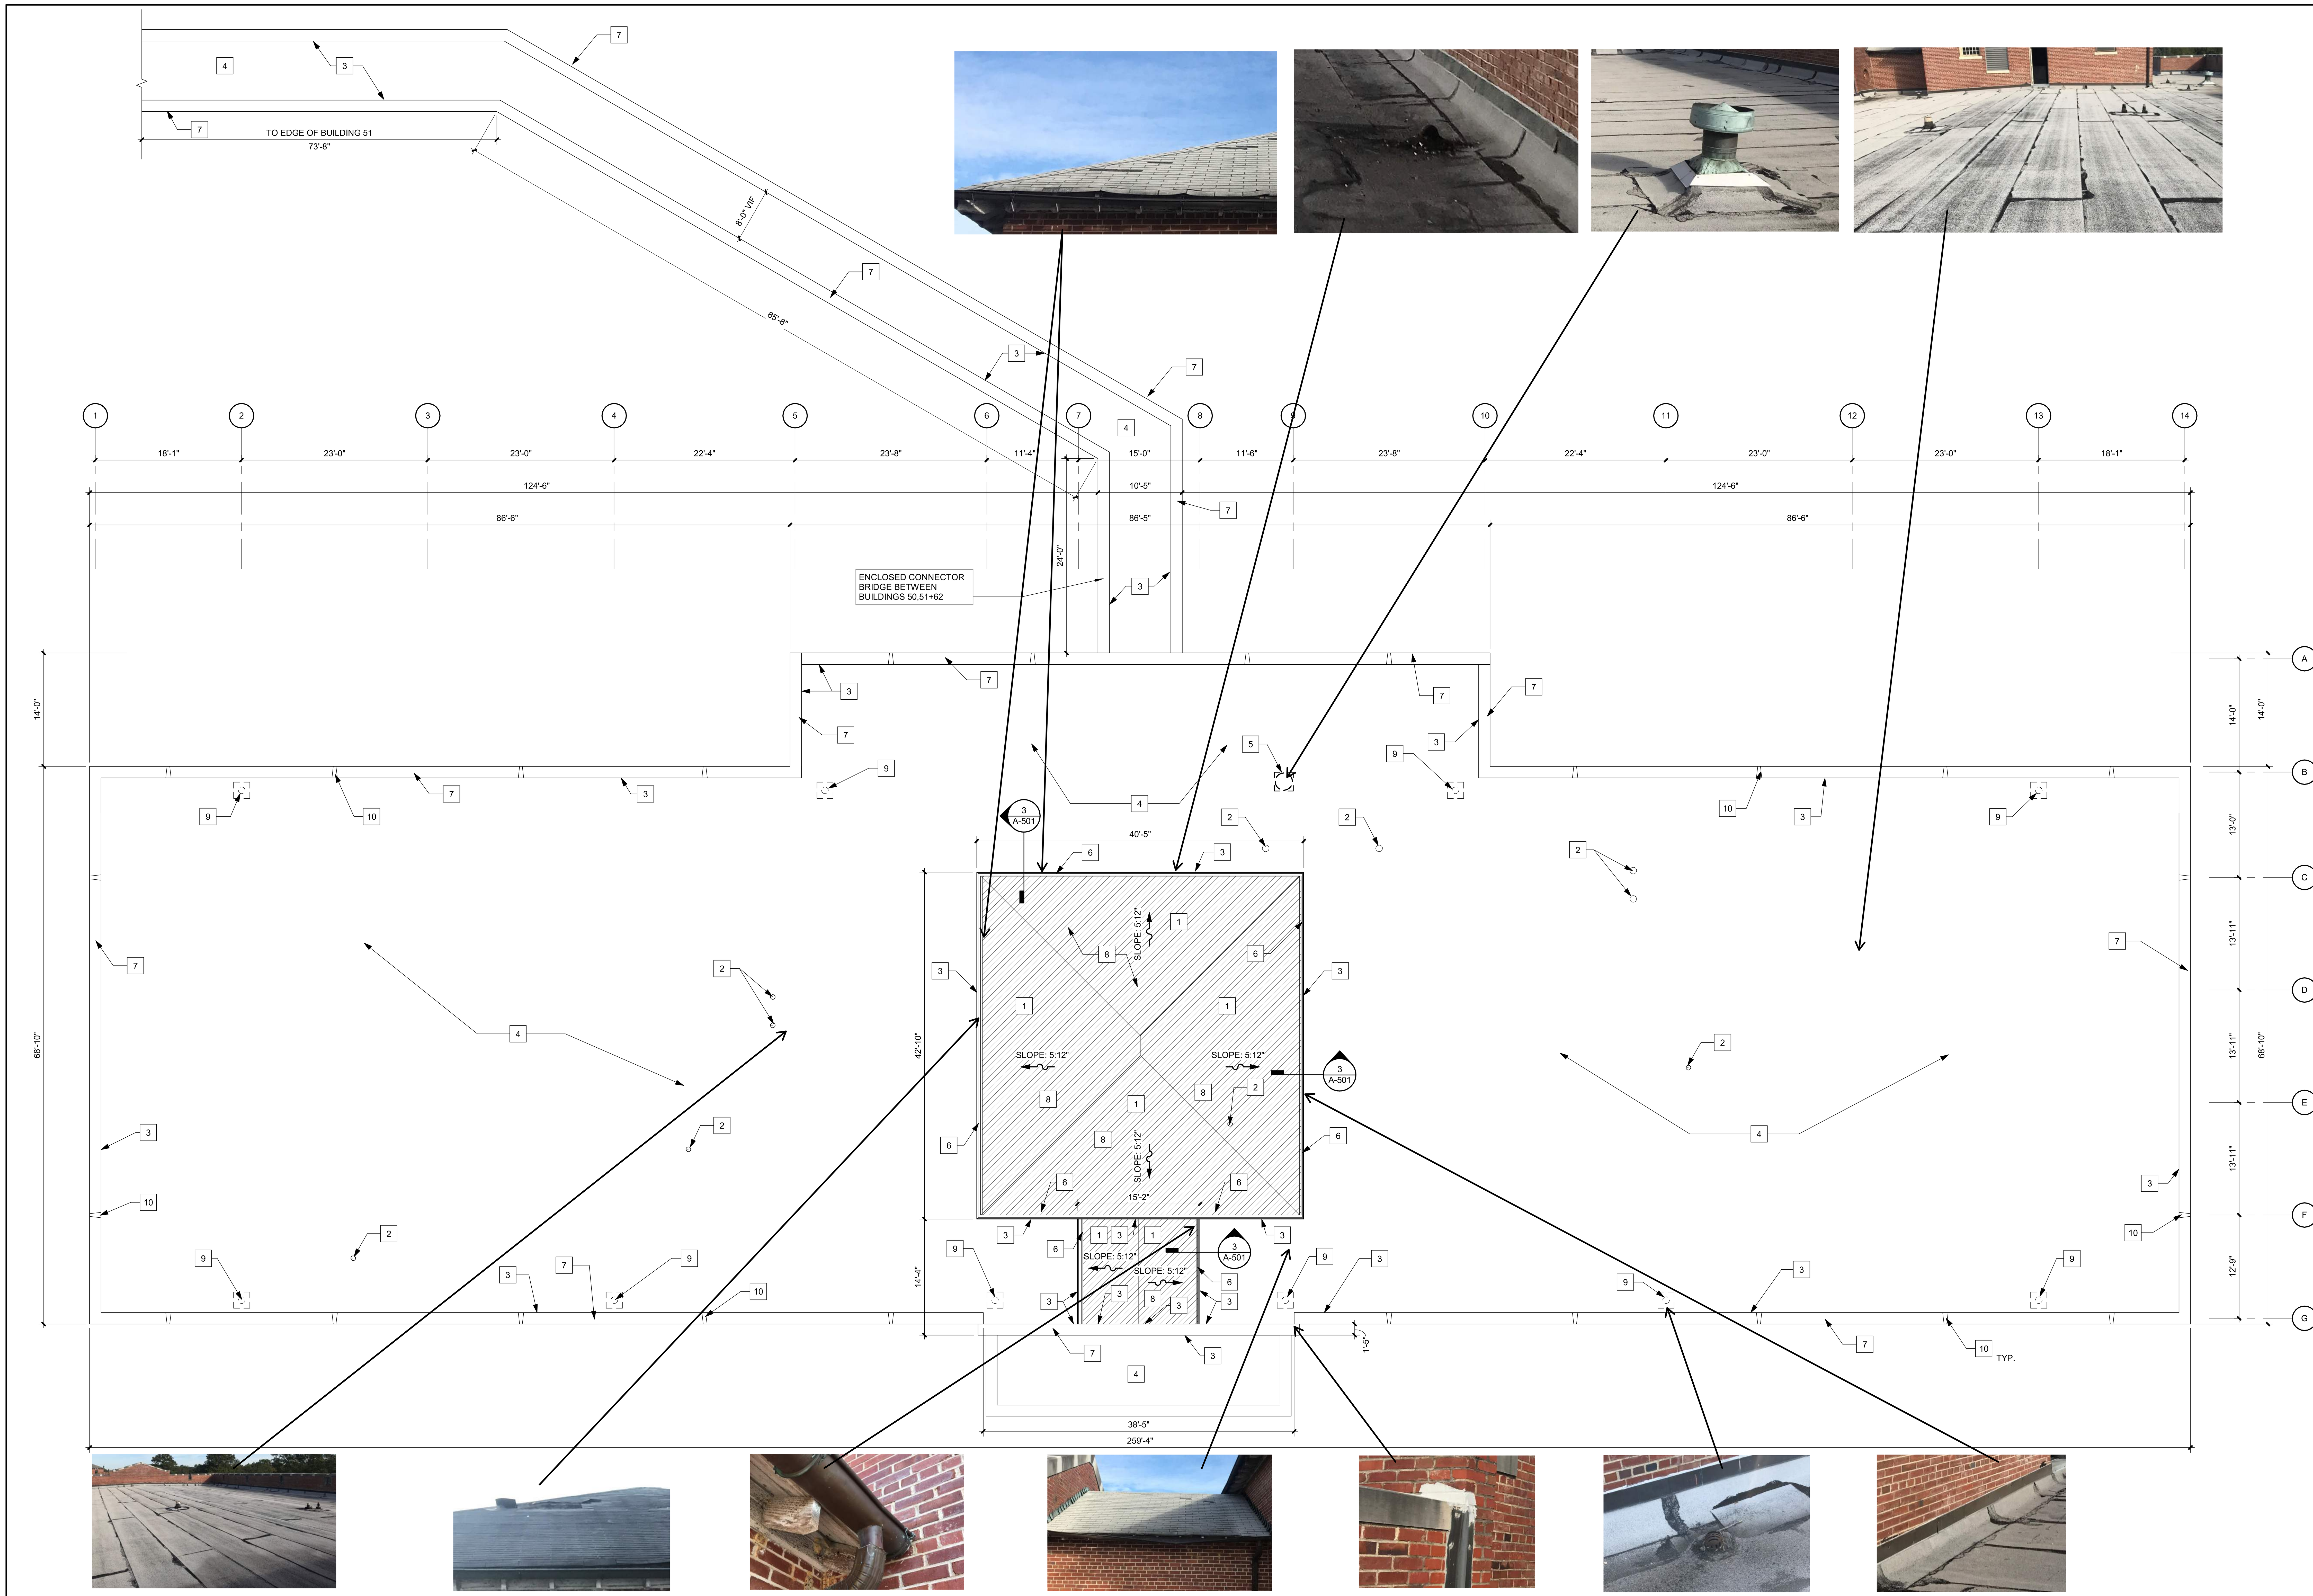

1 BUILDING 62 DEMOLITION ROOF PLAN

Scale: 1/8" = 1'-0"

SHEET NOTES:

A. CONTRACTOR TO ENSURE PROPER SAFETY BARRIERS AND ENCLOSURES ARE PROVIDED AT ALL ENTRY/EXIT POINTS FROM BUILDING WHERE WORK IS BEING PERFORMED ABOVE.

B. ALL PERSONNEL TO WEAR PROPER SAFETY DEVICES/FALL PROTECTION.

C. CONTRACTOR TO REMOVE ALL ROOF DRAIN COVERS AND PROVIDE BLOW DOWN OF DRAIN PIPES TO ENSURE NO BLOCKAGE.

D. CONTRACTOR SHALL PROTECT THE EXISTING CONCRETE SLAB FROM DAMAGE DURING CONSTRUCTION.

E. CONTRACTOR TO ASSUME ALL DEMOLITION OF PAINT OR PAINTED WOOD OR METAL CONTAINS LBP AND NEEDS TO BE ABATED PER SPEC SECTION 02 83 33.13

F. ALL DIMENSIONS ON THE DRAWINGS HAVE BEEN DETERMINED BASED ON MINIMAL AS-BUILT INFORMATION AVAILABLE. CONTRACTOR TO VERIFY ALL DIMENSIONS AND QUANTITIES PRIOR TO SUBMITTING BID.

G. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING OF EXISTING ROOF STRUCTURE AS NECESSARY FOR CONSTRUCTION LIVE LOADS.

H. THIS ROOFING PROJECT IS A COMPLETE TEAR OFF AND RE-ROOF. EXIST ROOF HAS 2 LAYERS OF 3" POLY ISO INSULATION WITH A 2 PLY BUILT UP.

DEMOLITION KEY NOTES:

1 REMOVE EXISTING ASPHALT SHINGLE ROOF SYSTEM AND ALL PARTS OF ROOF SYSTEM TO EXISTING SUBSTRATE.
2 REMOVE ALL ABANDONED EQUIPMENT, SUPPORTS, PIPES, ANTENNAS, ETC. NOT IN USE.
3 REMOVE FLASHING FOR INSTALLATION OF NEW ROOF SYSTEM.
4 REMOVE EXISTING BUILT UP ROOF SYSTEM INCLUDING INSULATION, ETC. TO CONCRETE SUBSTRATE.
5 EXISTING EXHAUST FANS TO BE REMOVED AND INFILL OPENING IN CONCRETE SUBSTRATE.
6 REMOVE EXISTING ROTTED / DAMAGED FASCIA/DRIP EDGE AROUND PERIMETER OF ROOF.
7 EXISTING CAST STONE/CONCRETE COPING CAP TO REMAIN.
8 REMOVE ALL SUBSTRATE PLANKS, TYPICAL.
9 EXISTING ROOF DRAINS TO BE REMOVED. VERTICAL PIPE TO FIRST 90 DEGREE ELBOW AND THE FIRST 90 DEGREE ELBOW TO BE REPLACED, SEE DETAIL 4/A-502.
10 EXISTING CAST STONE NOTCH IN PARAPET WALL TO REMAIN, TYPICAL.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

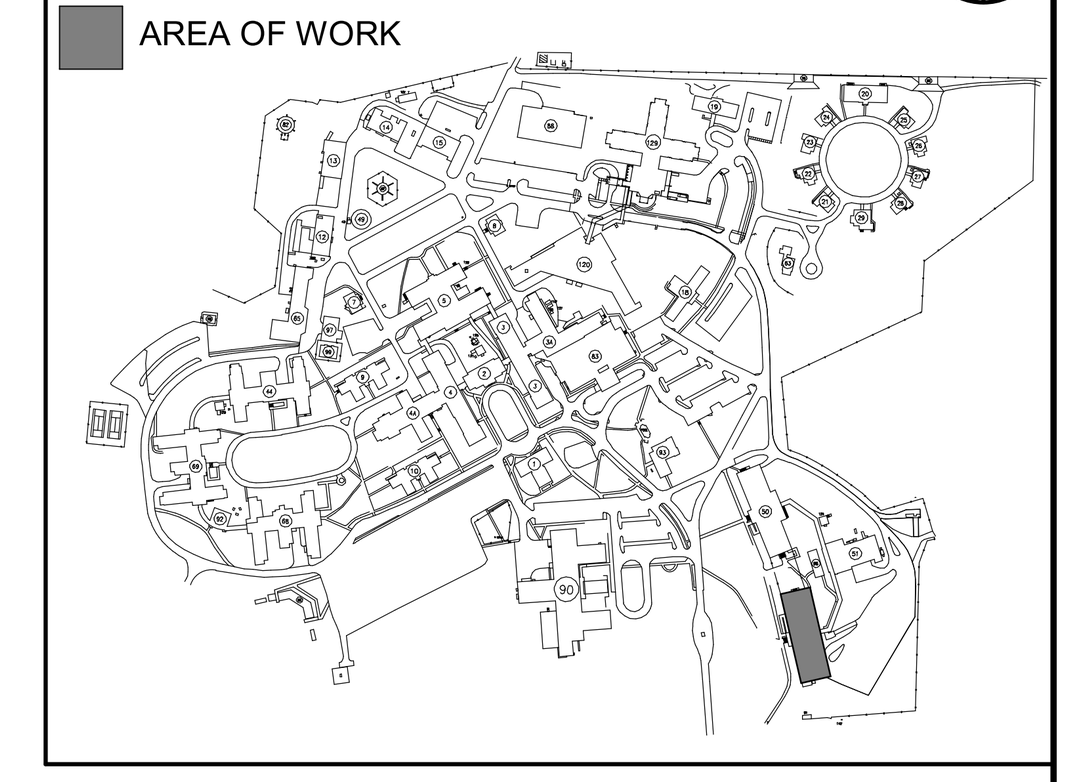

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

PROJECT MANAGER

ACG Project Number 23-069

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

APOGEE Engineers | Architects

6/21/2024

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 62 DEMOLITION ROOF PLAN
Project Title	REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
VA PROJECT NUMBER	619A4-24-102
Building Number	# 62
Location	CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM 2400 HOSPITAL ROAD TUSKEGEE, AL 36083
Approved	
Date	JUNE 19, 2024
Checked	WVS
Drawn	RF
Drawing Number	62.AD101
Dwg	10 of 14

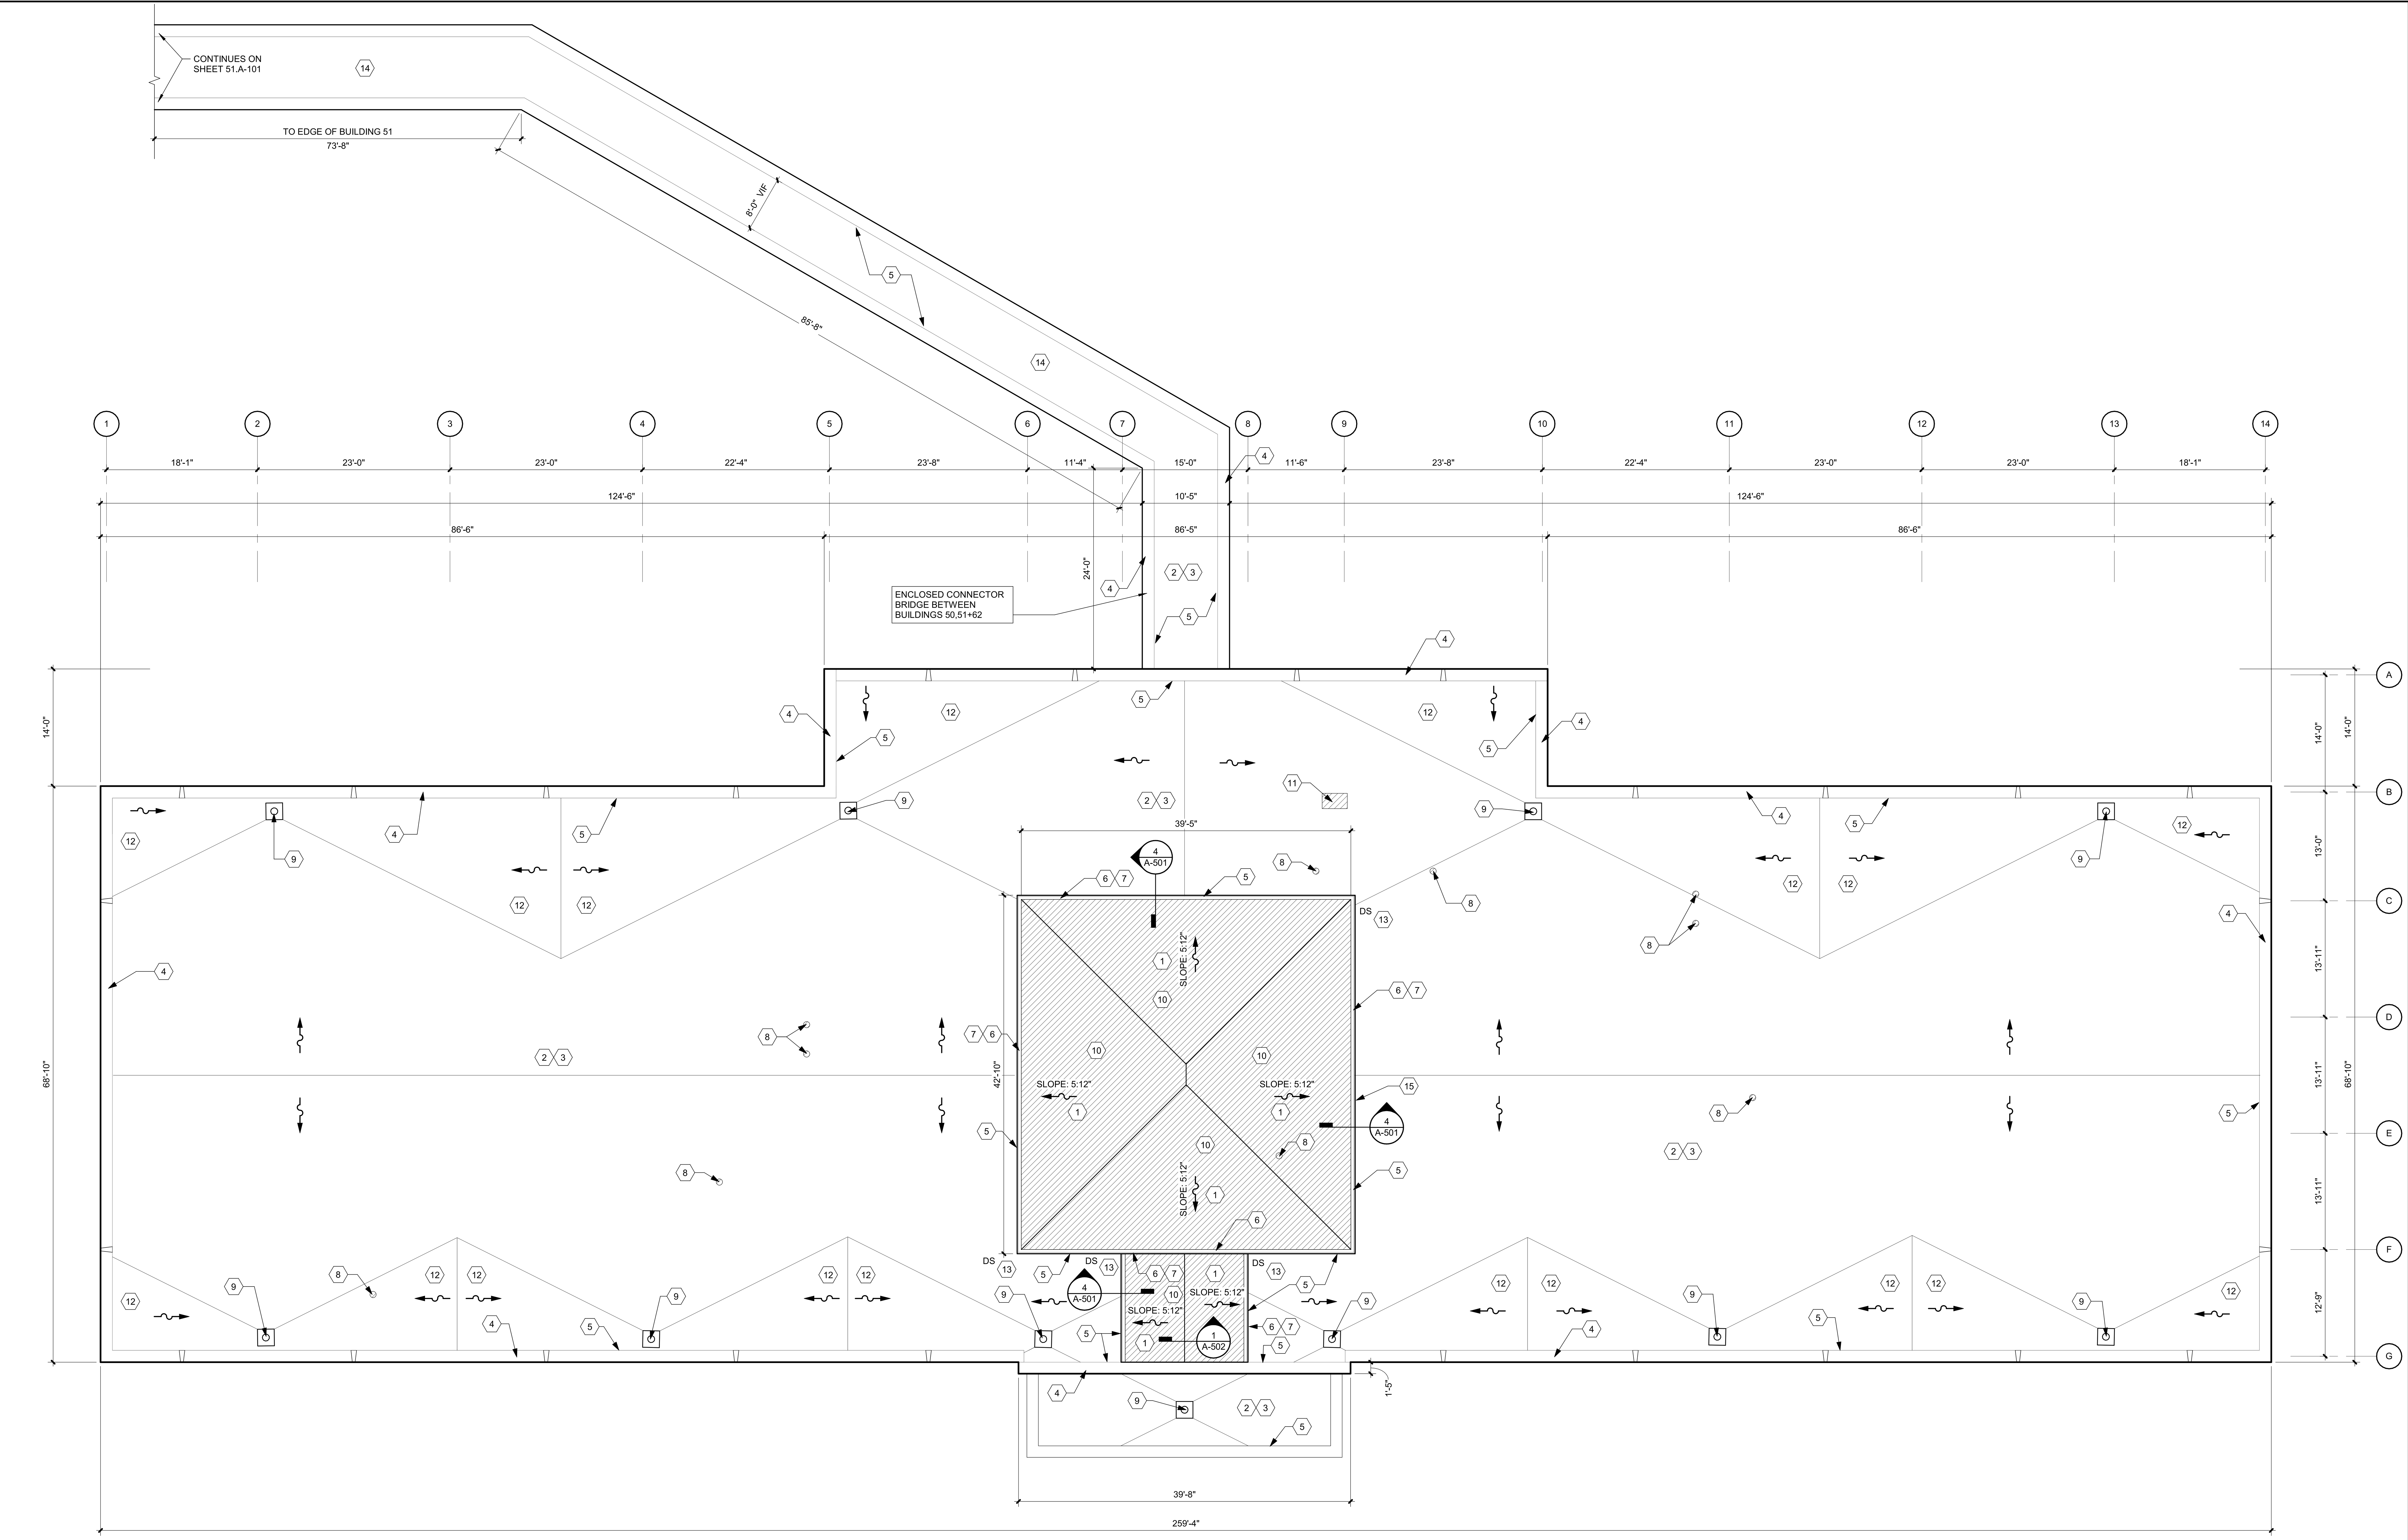

CONTINUES ON SHEET 51.A-101

1 BUILDING 62 ROOF PLAN

Scale: 1/8" = 1'-0"

0 4 8 16

NORTH

SHEET NOTES:

A. CONTRACTOR TO ENSURE PROPER SAFETY BARRIERS AND ENCLOSURES ARE PROVIDED AT ALL ENTRY/EXIT POINTS FROM BUILDING WHERE WORK IS BEING PERFORMED ABOVE.

B. ALL PERSONNEL TO WEAR PROPER SAFETY DEVICES/FALL PROTECTION.

C. CONTRACTOR TO REMOVE ALL ROOF DRAIN COVERS AND PROVIDE BLOW DOWN OF DRAIN PIPES TO ENSURE NO BLOCKAGE.

D. CONTRACTOR TO VERIFY ALL EXISTING ROOF CURBS, PENETRATIONS, OR ANYTHING ATTACHED TO THE ROOF MEET ROOFING MINIMUM HEIGHT REQUIREMENTS. NOTIFY COR IMMEDIATELY PRIOR TO STARTING WORK.

E. CONTRACTOR SHALL PROVIDE PROTECTION STRUCTURES AS NECESSARY AT ALL WALKWAYS.

F. CONTRACTOR SHALL PROTECT THE EXISTING CONCRETE SLAB FROM DAMAGE DURING CONSTRUCTION.

G. CONTRACTOR TO ASSUME ALL DEMOLITION OF PAINT OR PAINTED WOOD OR METAL CONTAINS LBP AND NEEDS TO BE ABATED PER SPEC SECTION 02 83 33.13.

H. ALL DIMENSIONS ON THE DRAWINGS HAVE BEEN DETERMINED BASED ON MINIMAL AS-BUILT INFORMATION AVAILABLE. CONTRACTOR TO VERIFY ALL DIMENSIONS AND QUANTITIES PRIOR TO SUBMITTING BID.

I. CONTRACTOR TO ENSURE ROOFS SLOPE TO DRAINS, MINIMUM ROOF SLOPE 1/4" = 1'-0".

J. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING OF EXISTING ROOF STRUCTURE AS NECESSARY FOR CONTRUCTION LIVE LOADS.

K. PENTHOUSE ROOF SLOPE IS 5:12 FOR PITCHED ROOF.

L. NEW ROOFING SYSTEM: INSTALL VAPOR BARRIER ON EXISTING CONCRETE DECK (BASIS OF DESIGN, GAF SA VAPOR RETARDER XL, OR EQUAL). R-33 PLYISO INSULATION, ADHERED, LOW RISE FOAM. 5/8" GYPSUM COVER BOARD, ADHERED, LOW RISE FOAM, AND 60 MIL FLEECE BACK, ADHERED, LOW RISE FOAM. (BASIS OF DESIGN, EVERGAURD TPO FLEECE BACK MEMBRANE OR EQUAL).

KEY NOTES:

1 INSTALL NEW ASPHALT SHINGLE ROOF SYSTEM.
2 INSTALL NEW TPO ROOFING SYSTEM.
3 INSTALL ROOF INSULATION AND INSTALL MIN R-33 POLY ISO INSULATION. APPLICATION METHOD - LOW RISE FOAM.
4 EXISTING CAST STONE CONCRETE PARAPET CAP, PRESSURE WASH CAP CLEAN.
5 INSTALL NEW BASE FLASHING AT WALL PER ROOF SYSTEM VENDOR STANDARD DETAILS AND RECOMMENDATIONS.
6 INSTALL NEW GUTTER AND DOWNSPOUTS TO MATCH EXISTING SEE DETAIL 4/A-501.
7 REPLACE ALL FASCIAS, EAVES, SOFFITS, & RAKES BEFORE INSTALLING FLASHING OR REROOFING.
8 FILL ABANDONED CORE HOLES FROM EQUIPMENT DEMOLITION WITH NON SHRINKING CEMENTITIOUS GROUT. ACCEPTABLE METHODS OF INSTALLATION. PLYWOOD FORMS BELOW OR HOLE MOLE CORE HOLE FILLING SYSTEM OR EQUAL.
9 INSTALL NEW ROOF DRAIN ASSEMBLY, REPLACE EXISTING VERTICAL PIPE TO FIRST ELBOW AND REPLACE FIRST 90 DEGREE ELBOW AND RECONNECT TO EXISTING STORM.
10 REPLACE ALL SUBSTRATE PLANKS, WITH NEW 3/4" PT PLYWOOD, TYPICAL.
11 PATCH OPENINGS IN CONCRETE ROOF DECK WHERE EQUIPMENT WAS REMOVED, SEE DETAIL 3/A-501.
12 INSTALL CRICKETS WITH TAPERED RIGID INSULATION. ALL ANGLES TO BE 2:1 OR 3:1.
13 PROVIDE AND INSTALL 12"X24"X4" H MIN. PRE CAST CONCRETE SPLASH BLOCK.
14 INTERNAL DRAINS NOT ABLE TO BE LOCATED AT BUILDING 50, 51, 62, CONNECTOR DURING A/E SURVEY. CONTRACTOR TO INCLUDE PRICING FOR INSTALLATION OF 6 NEW ROOF DRAINS AT CONNECTOR. INSTALLATION OF DRAIN VERTICAL PIPE DOWN AND 90 ELBOW TO BE INCLUDED.
15 EXISTING DOOR THRESHOLD - VERIFY THICKNESS, APPROX. 6" EXISTING INSULATION REMOVED AND APPROX. 6" NEW BEING INSTALLED. EXISTING SILL TO REMAIN.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

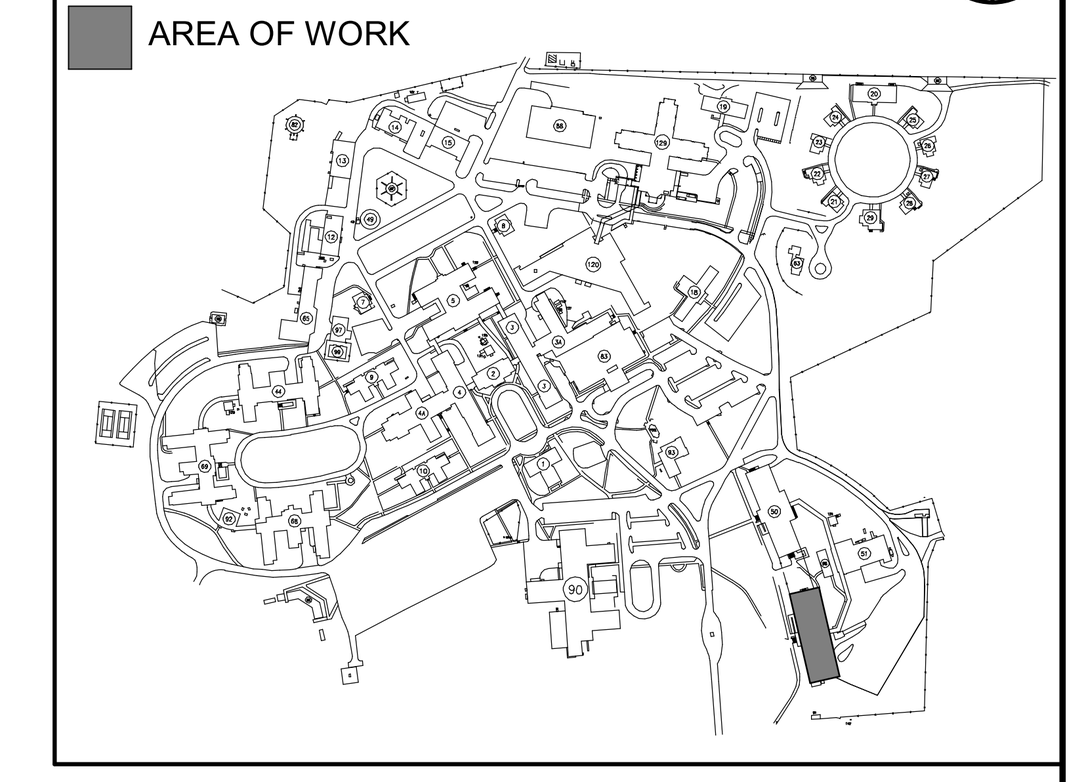

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

52644

6/21/2024

PROJECT MANAGER

ACG Project Number 23-069

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 62 ROOF PLAN
Location	CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM 2400 HOSPITAL ROAD TUSKEGEE, AL 36083
Project Title	REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
Approved	
Date	JUNE 19, 2024
Checked	WVS
Drawn	RF
VA PROJECT NUMBER	619A4-24-102
Building Number	# 62
Drawing Number	62.A-101
Dwg	11 of 14

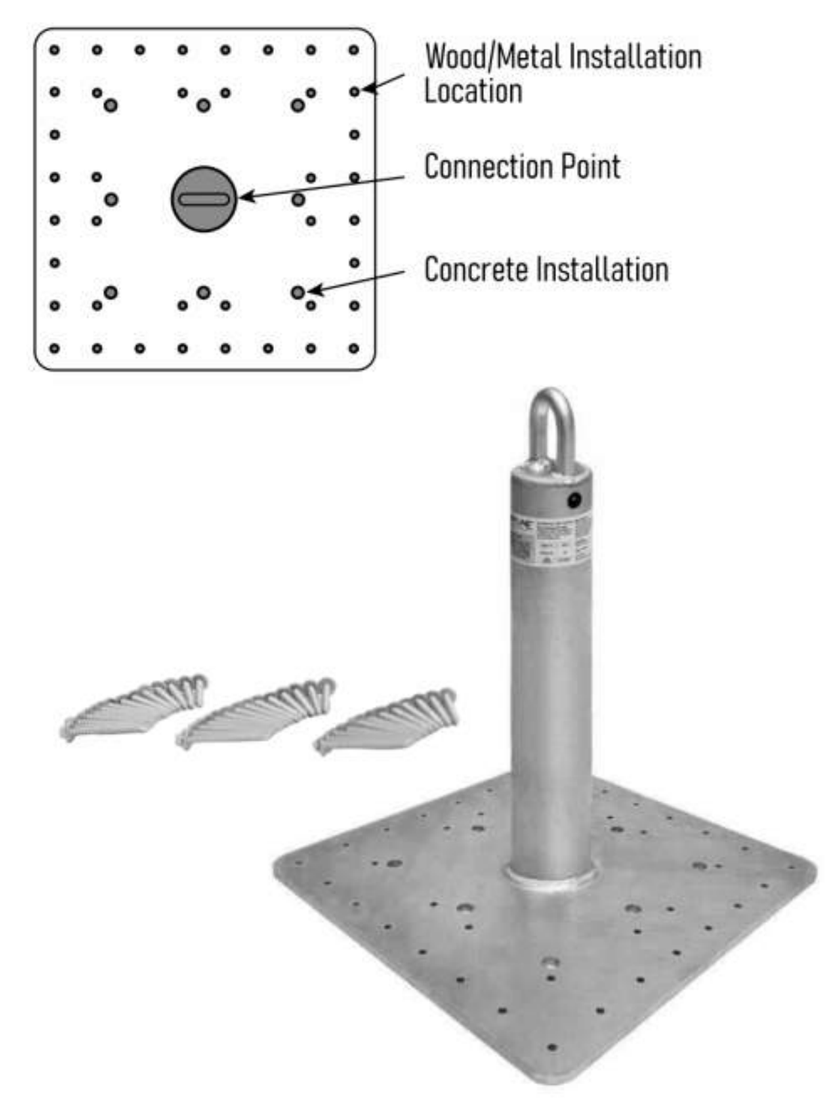



Part Number	R012
Weight	29.3 Lbs
Base Thickness	3/8"
Post Diameter	2.8"

FRONTLINE - COMMERCIAL ROOF ANCHOR SYSTEM OR EQUAL.
FOLLOW MANUFACTURER'S INSTRUCTION MANUAL FOR WOOD INSTALLATION, TYPICAL

7 FALL ARREST STANCHION SPECIFICATION
Scale: No Scale

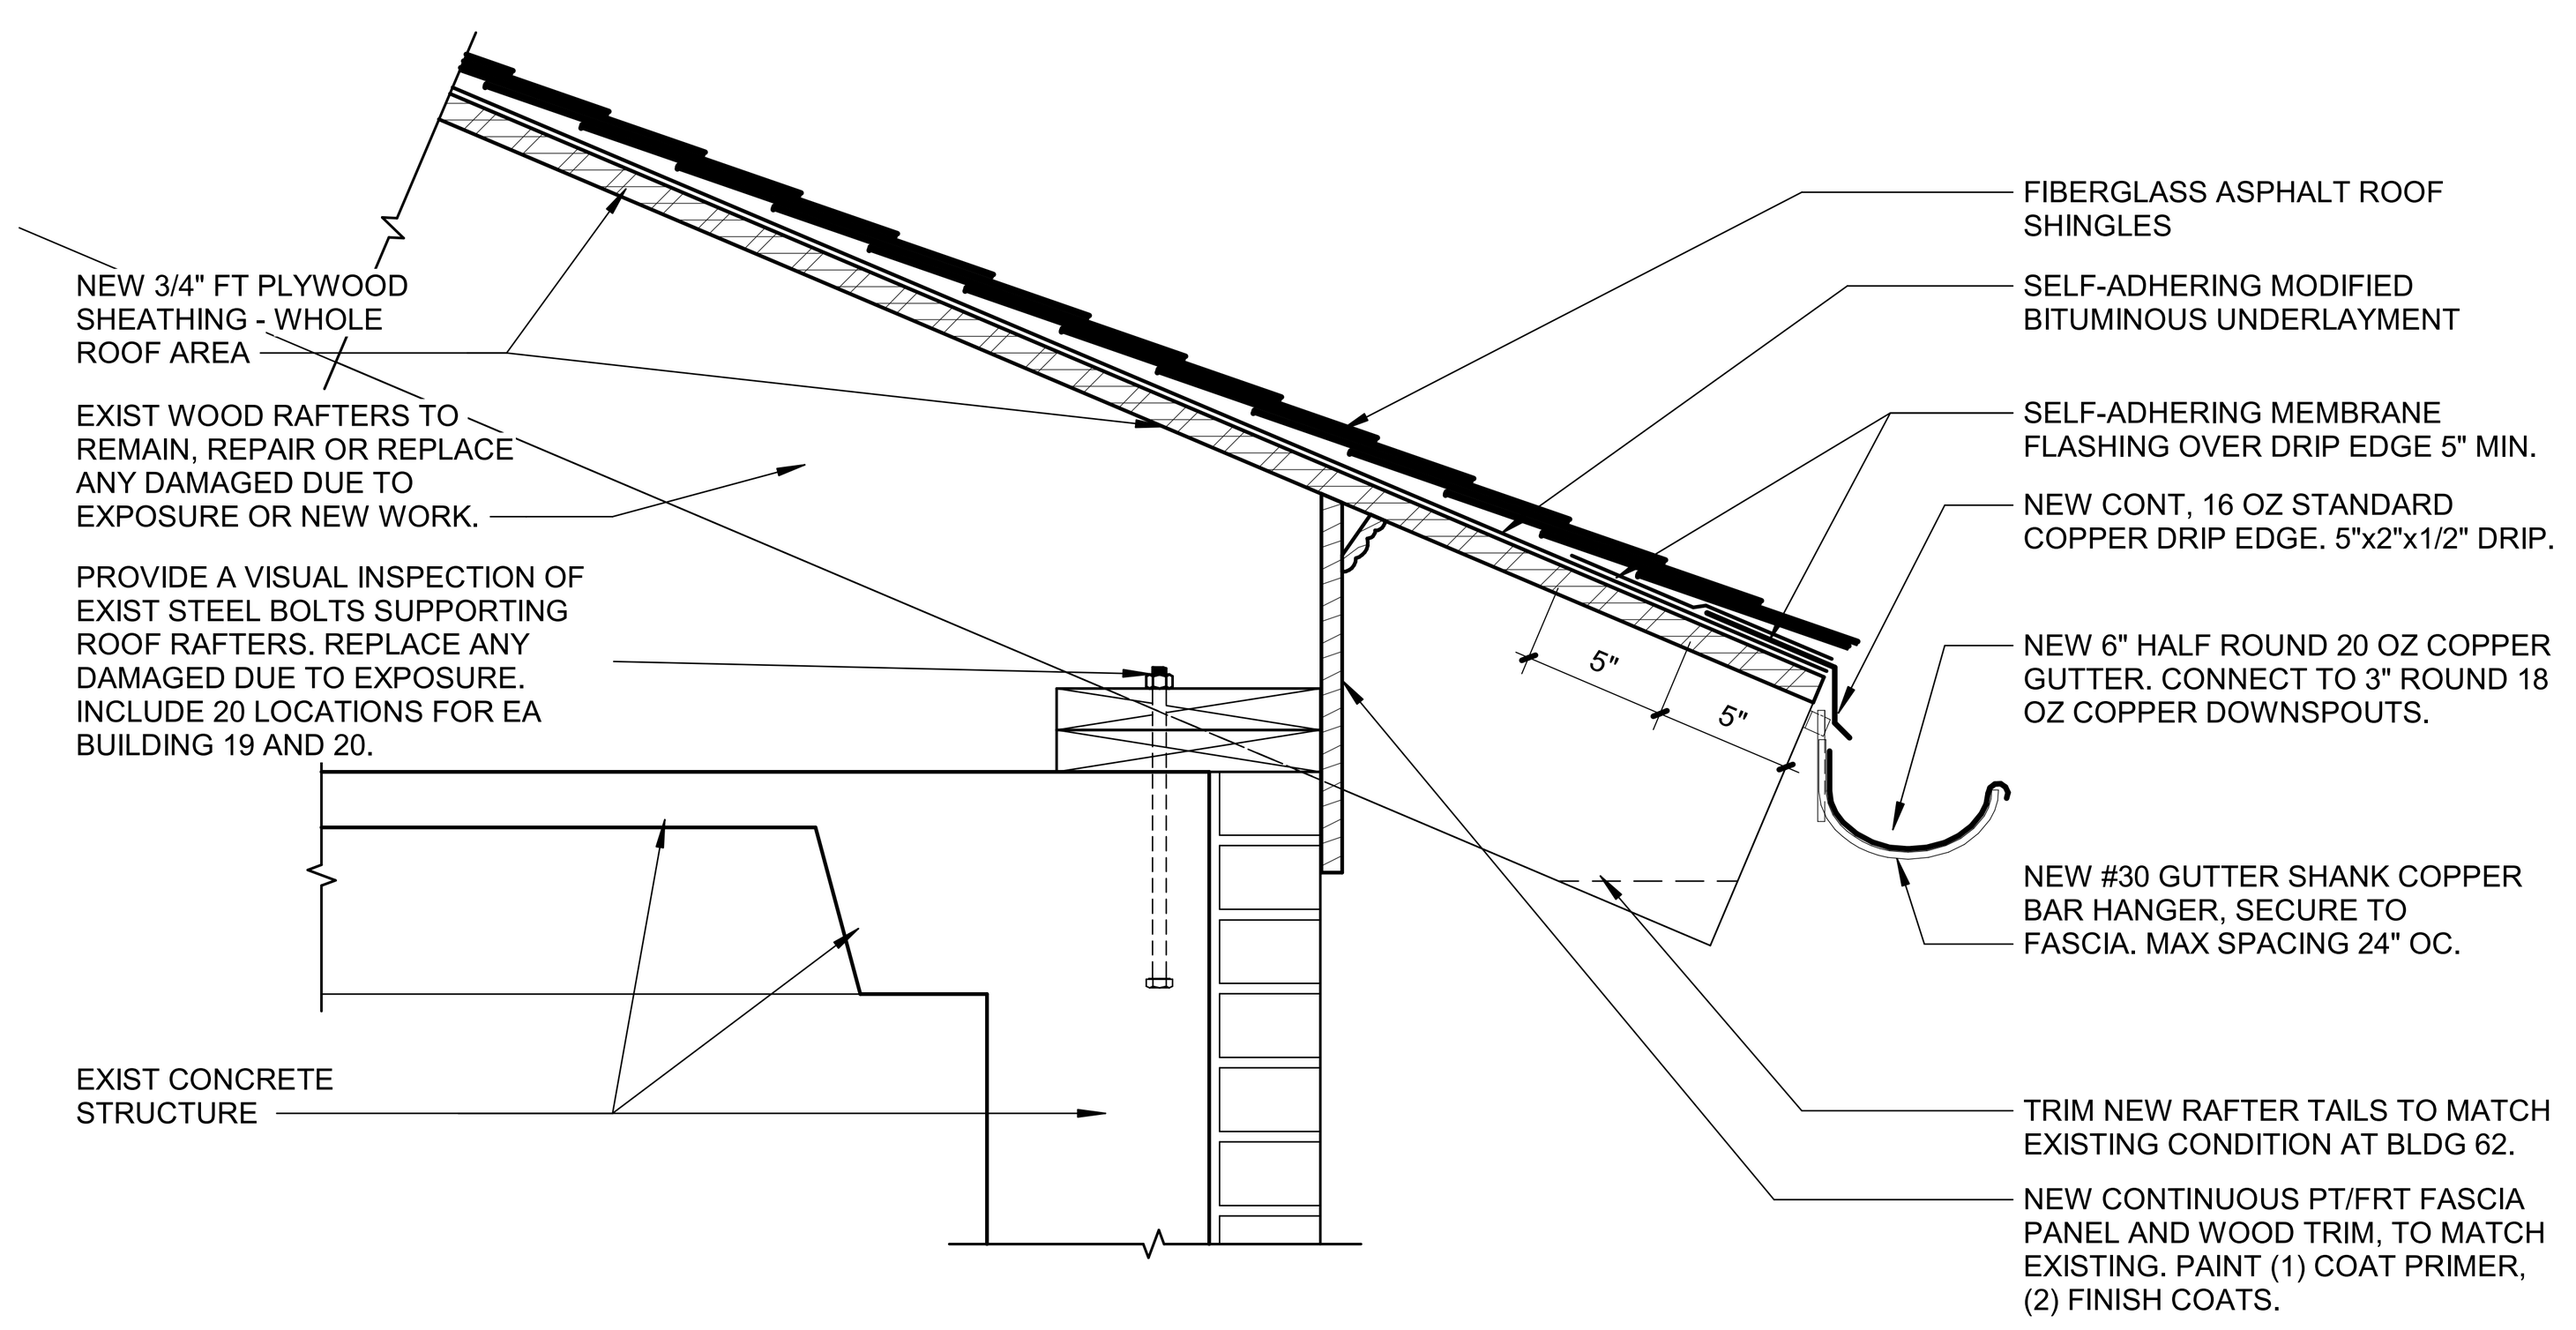

4 ASPHALT SHINGLE ROOF DETAIL - BLDG 50, 51 & 62 NEW WORK
Scale: 1 1/2" = 1'-0"
0 3" 6" 12"

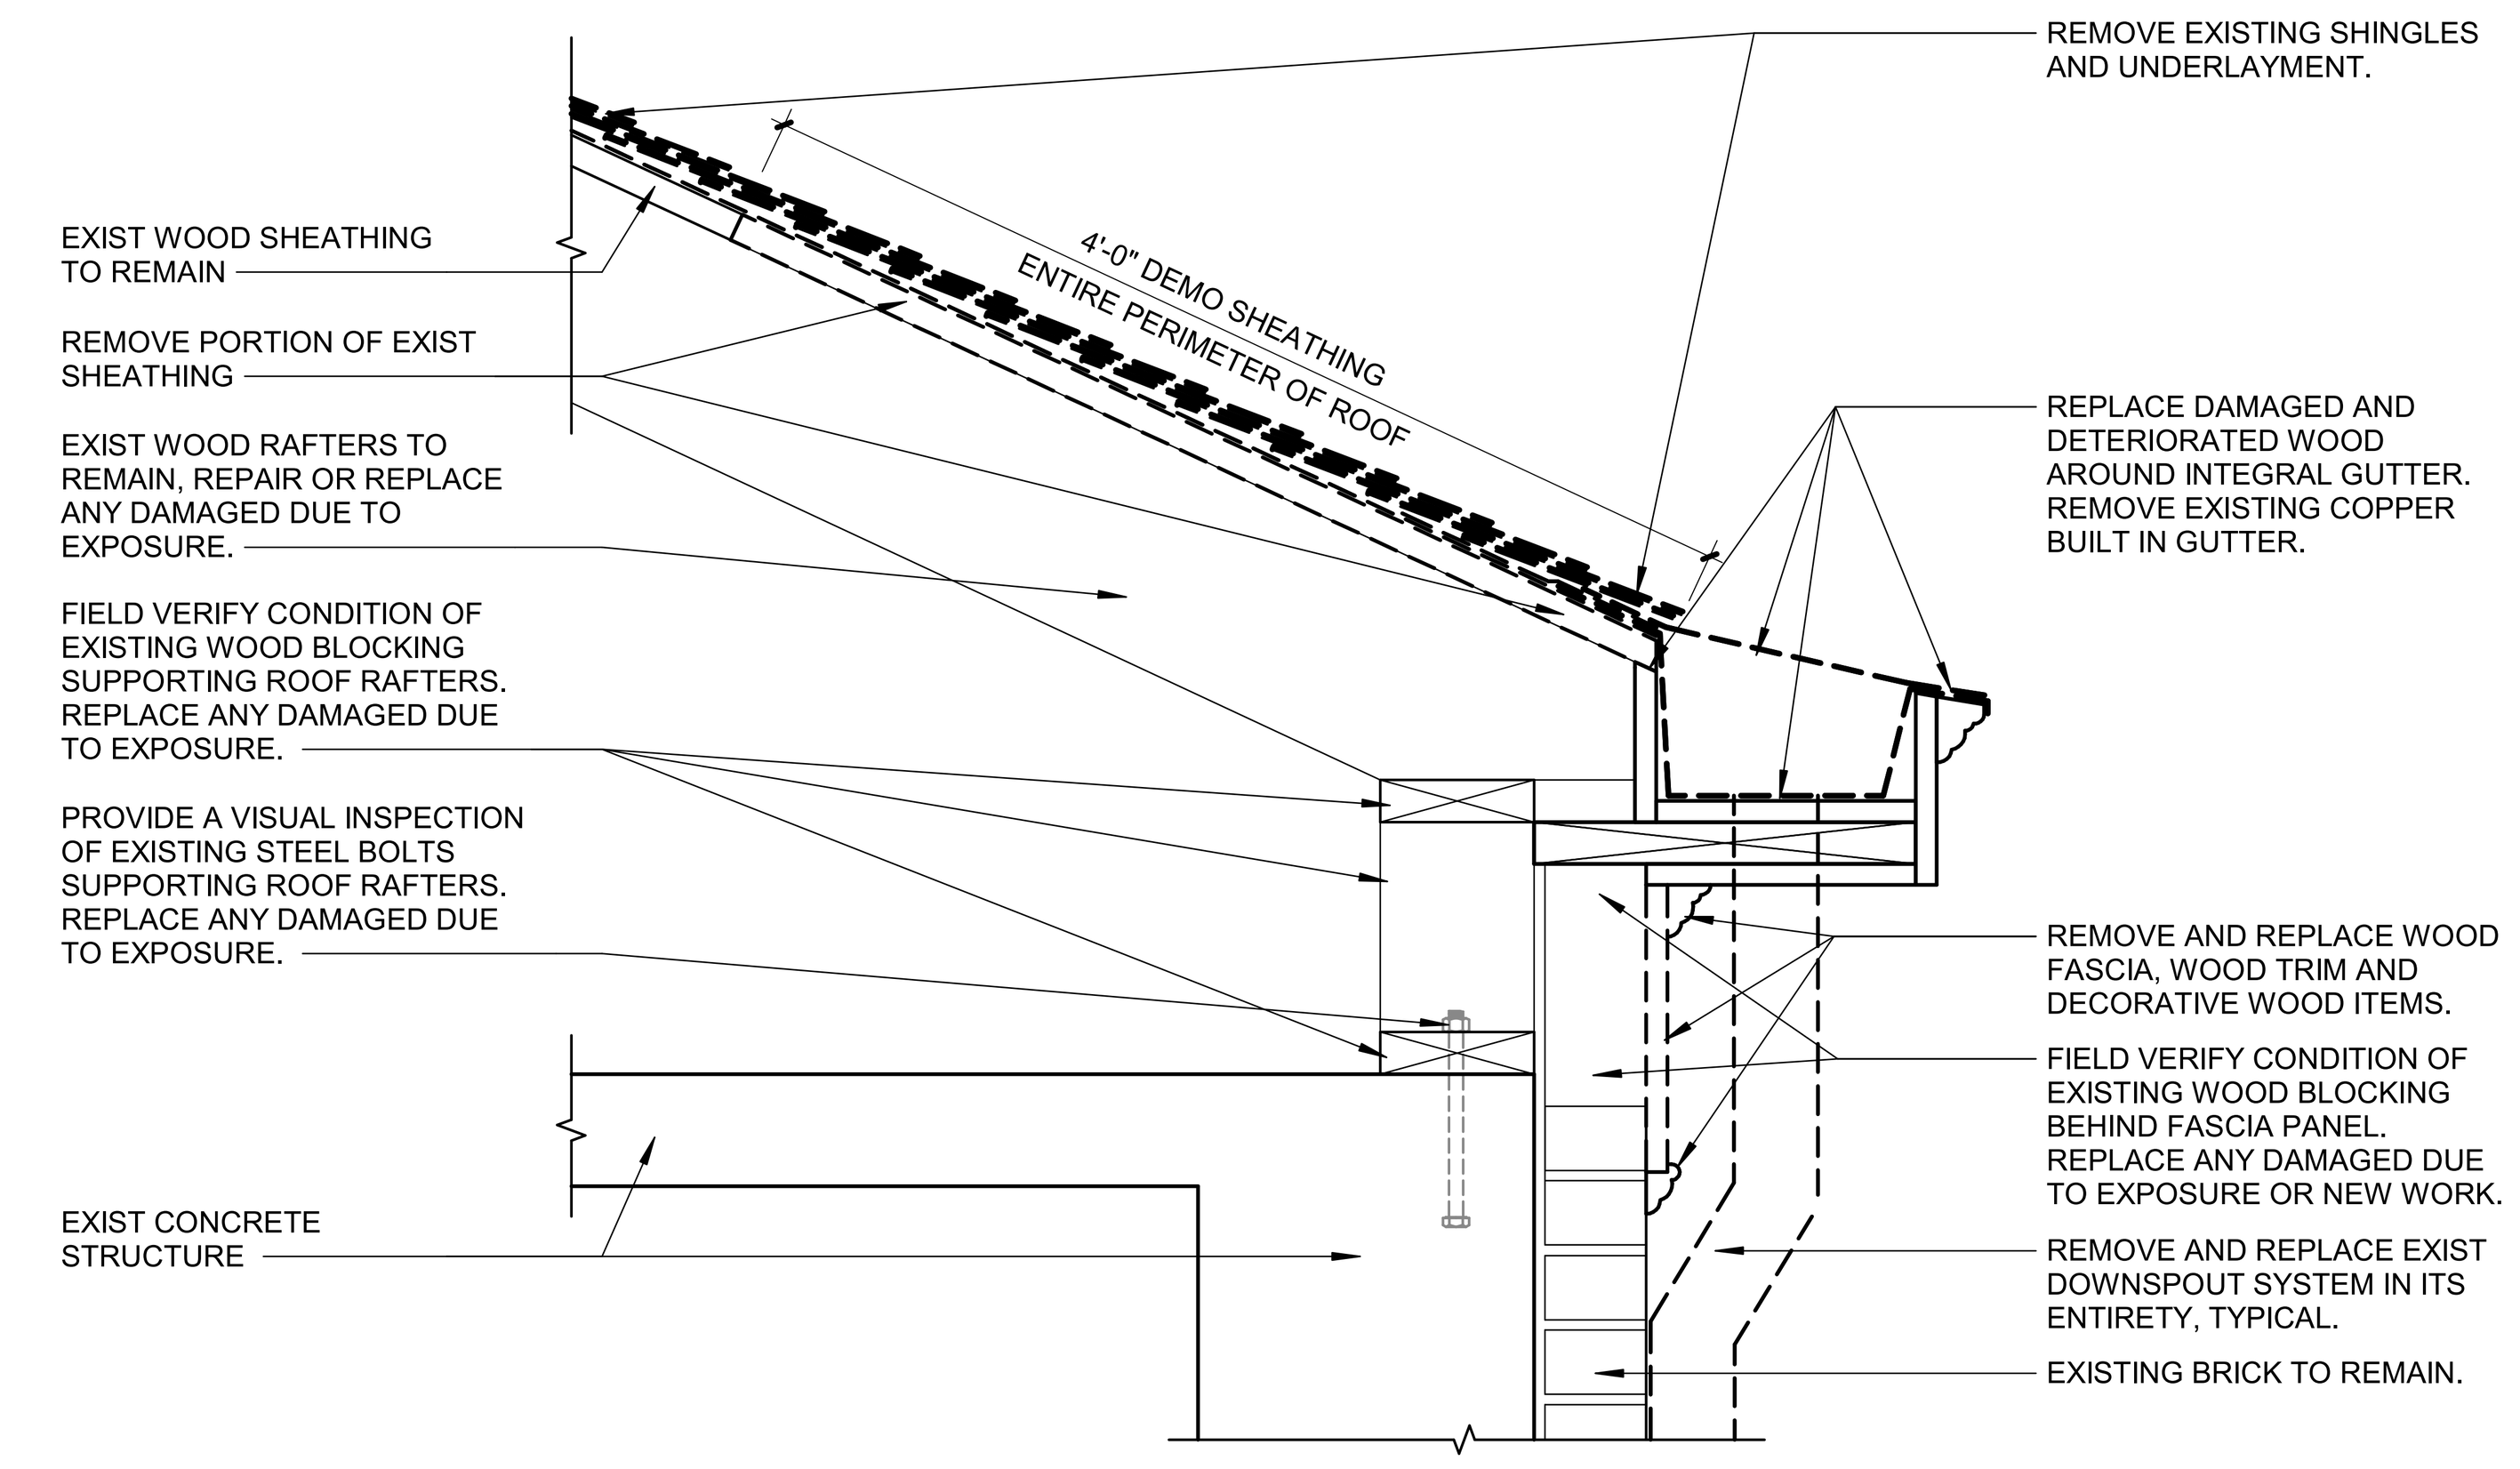

1 ASPHALT SHINGLE ROOF DETAIL - BLDG 19 & 20 DEMO
Scale: 1 1/2" = 1'-0"
0 3" 6" 12"

SHEET NOTES:

A. THE FINAL DETAILS SHALL BE SUBMITTED AS PART OF THE SHOP DRAWING SUBMITTAL PROCESS WITH THE ROOFING MANUFACTURER'S RECOMMENDED DETAILS.

B. CONTRACTOR TO REMOVE ALL ROOF DRAIN COVERS AND PROVIDE BLOW DOWN OF DRAIN PIPES TO ENSURE NO BLOCKAGE.

C. THE ROOF SYSTEM FOR BUILDINGS 19, 20, AS WELL AS THE PENTHOUSE ROOFS FOR BUILDINGS 50 AND 62, IS ASPHALT SHINGLE ROOFS PER SPECIFICATION SECTION 07 31 13.

D. THE ROOF MEMBRANE SYSTEM FOR BUILDINGS 50, 51 AND 62, IS A TPO ROOFING SYSTEM PER SPECIFICATION SECTION 07 54 23.

E. CONTRACTOR TO INSTALL INSULATION PER SPECIFICATION SECTION 07 22 00, AND ROOF MANUFACTURER APPROVED SUBMITTALS. R-30 RIGID INSULATION SHOWN ON DETAILS IS THE MINIMUM INSULATION REQUIRED.

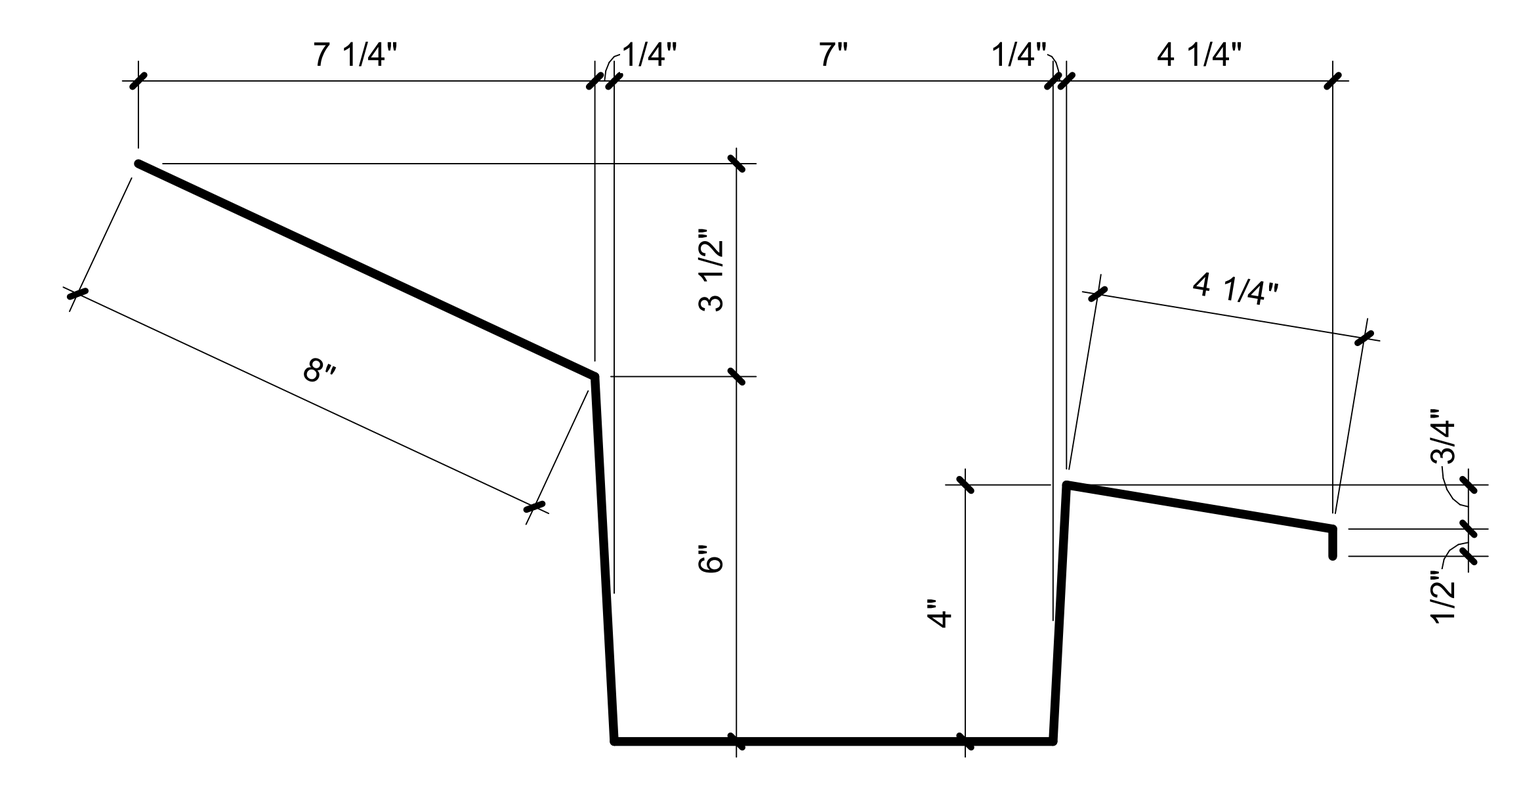

FIELD VERIFY EXISTING CONDITIONS TYPICAL. THIS DETAIL IS PROVIDED FOR REFERENCE AND FOR PRICING.

5 16 OZ COPPER BREAK METAL PROFILE AT NEW INTEGRAL GUTTER
Scale: 3" = 1'-0"
0 2" 4" 8"

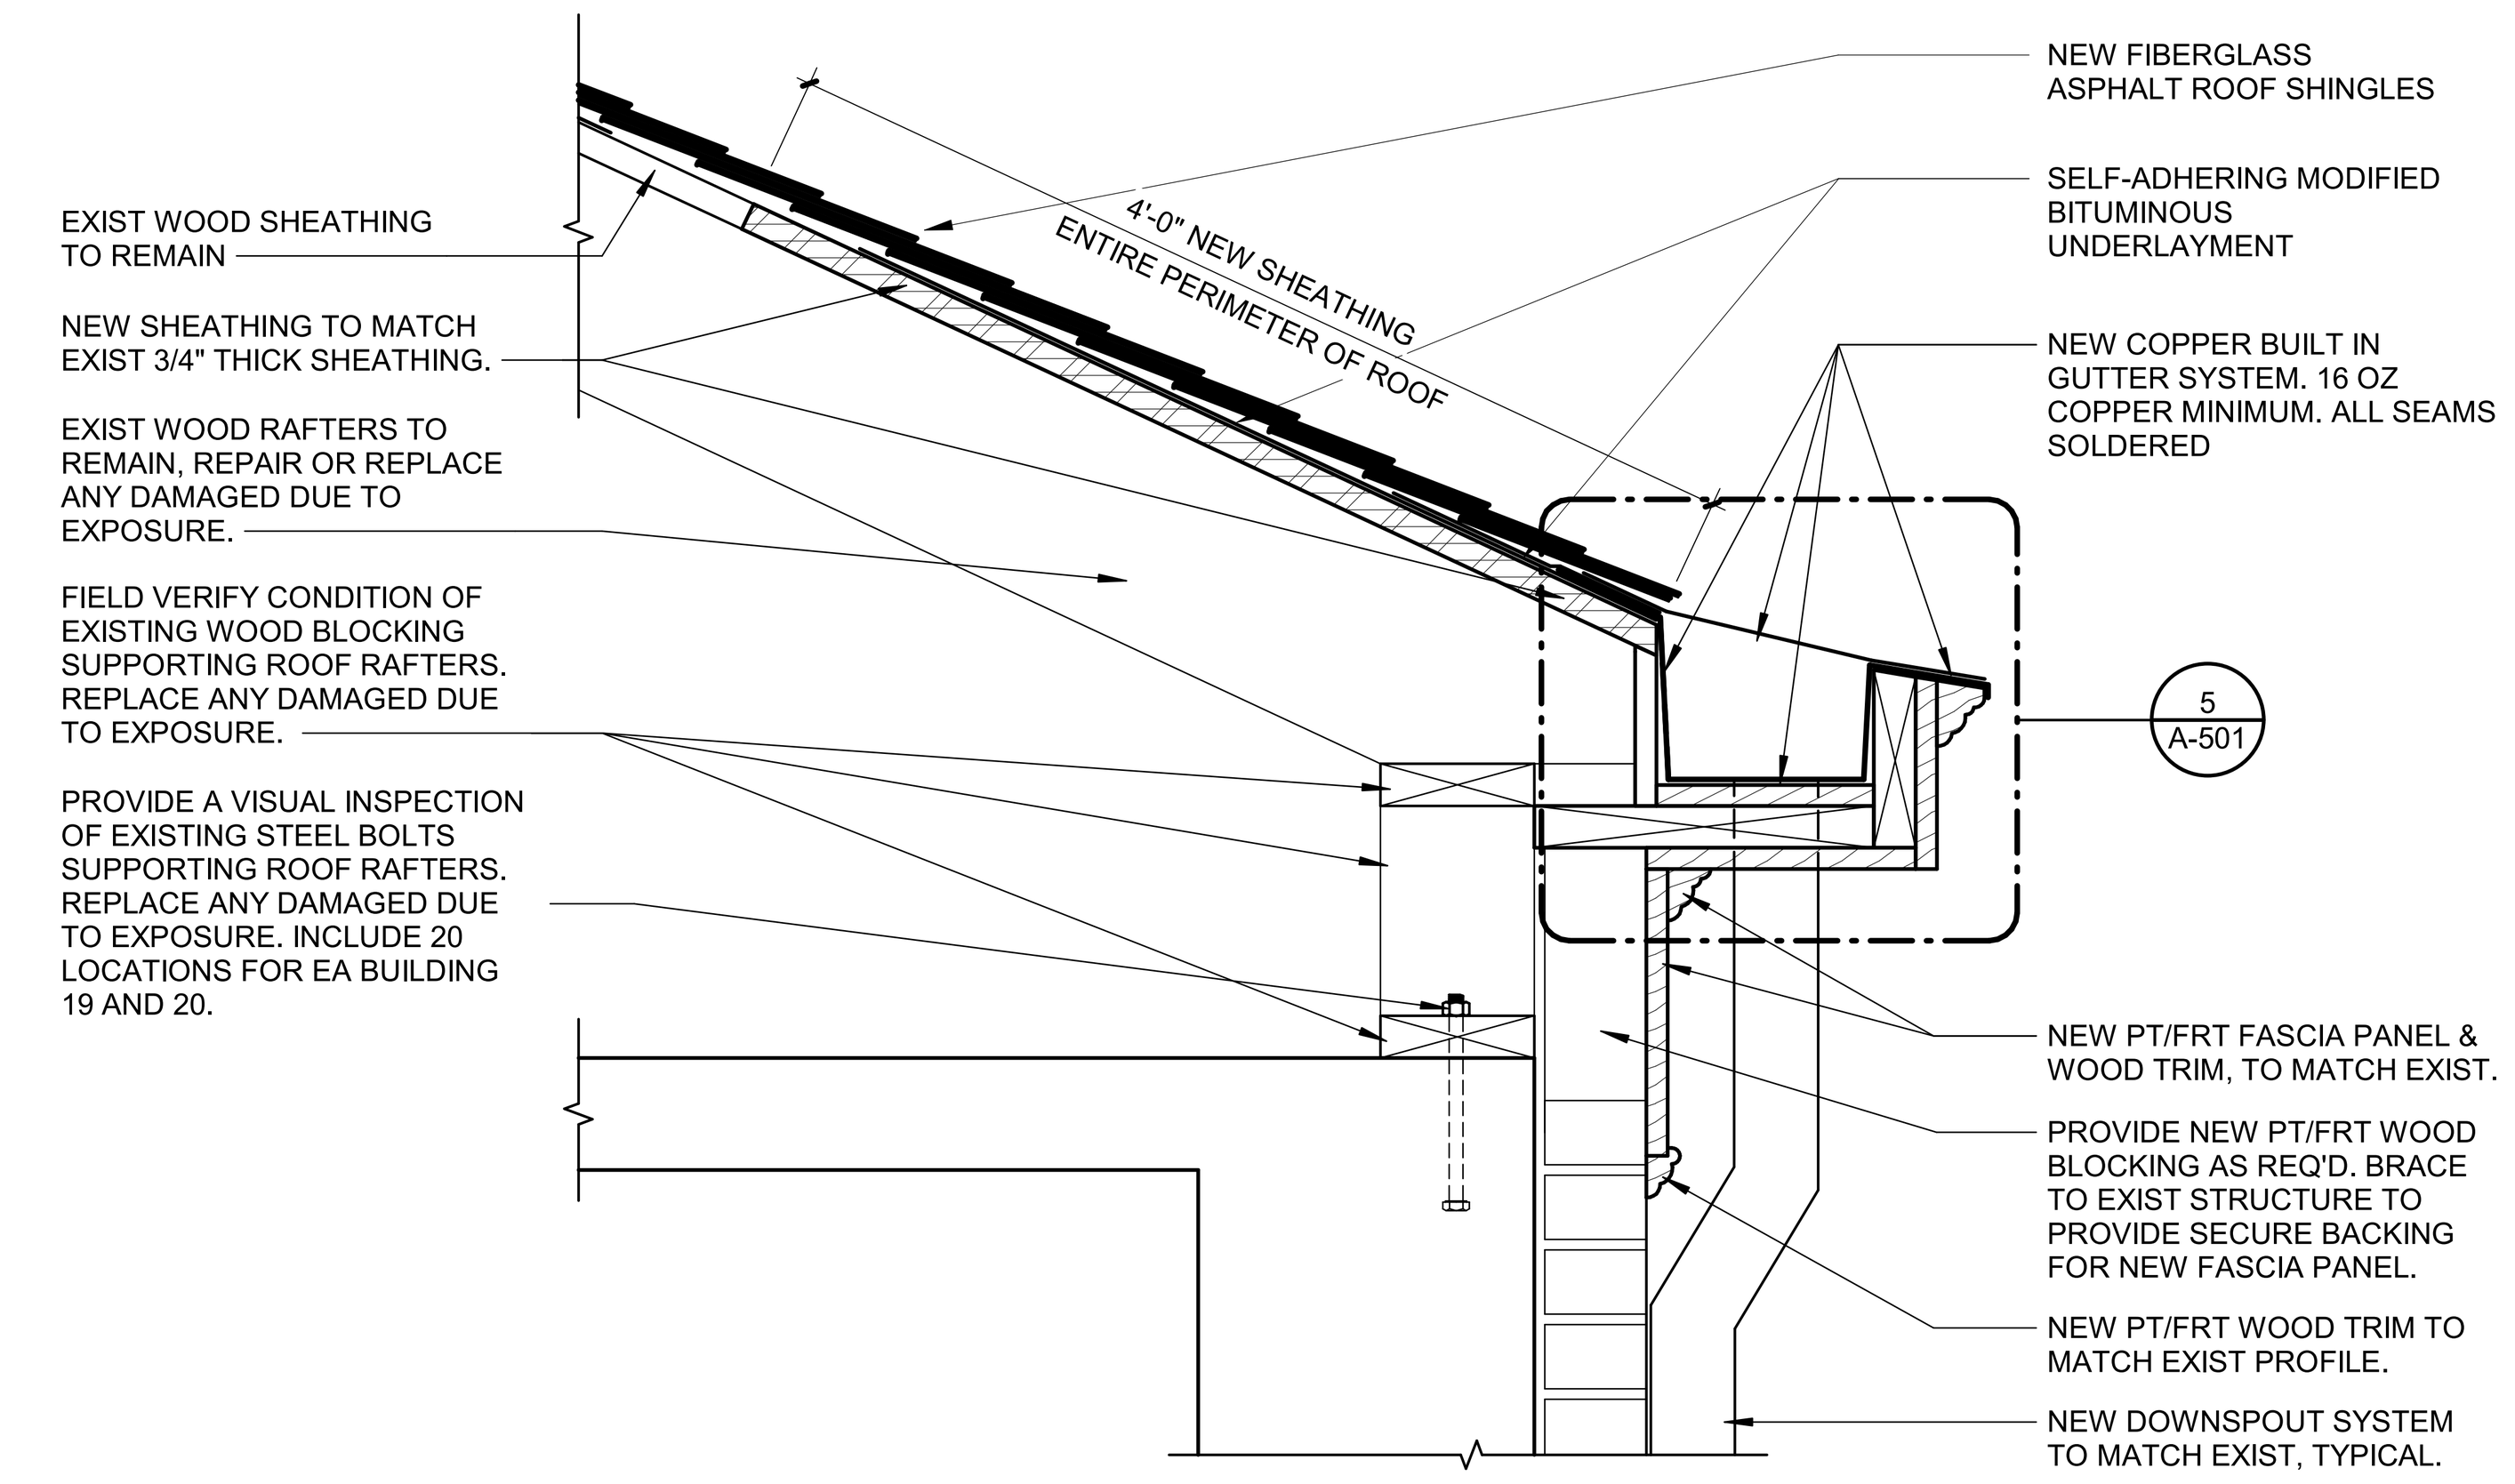

2 ASPHALT SHINGLE ROOF DETAIL - BLDG 19&20 NEW WORK
Scale: 1 1/2" = 1'-0"
0 3" 6" 12"

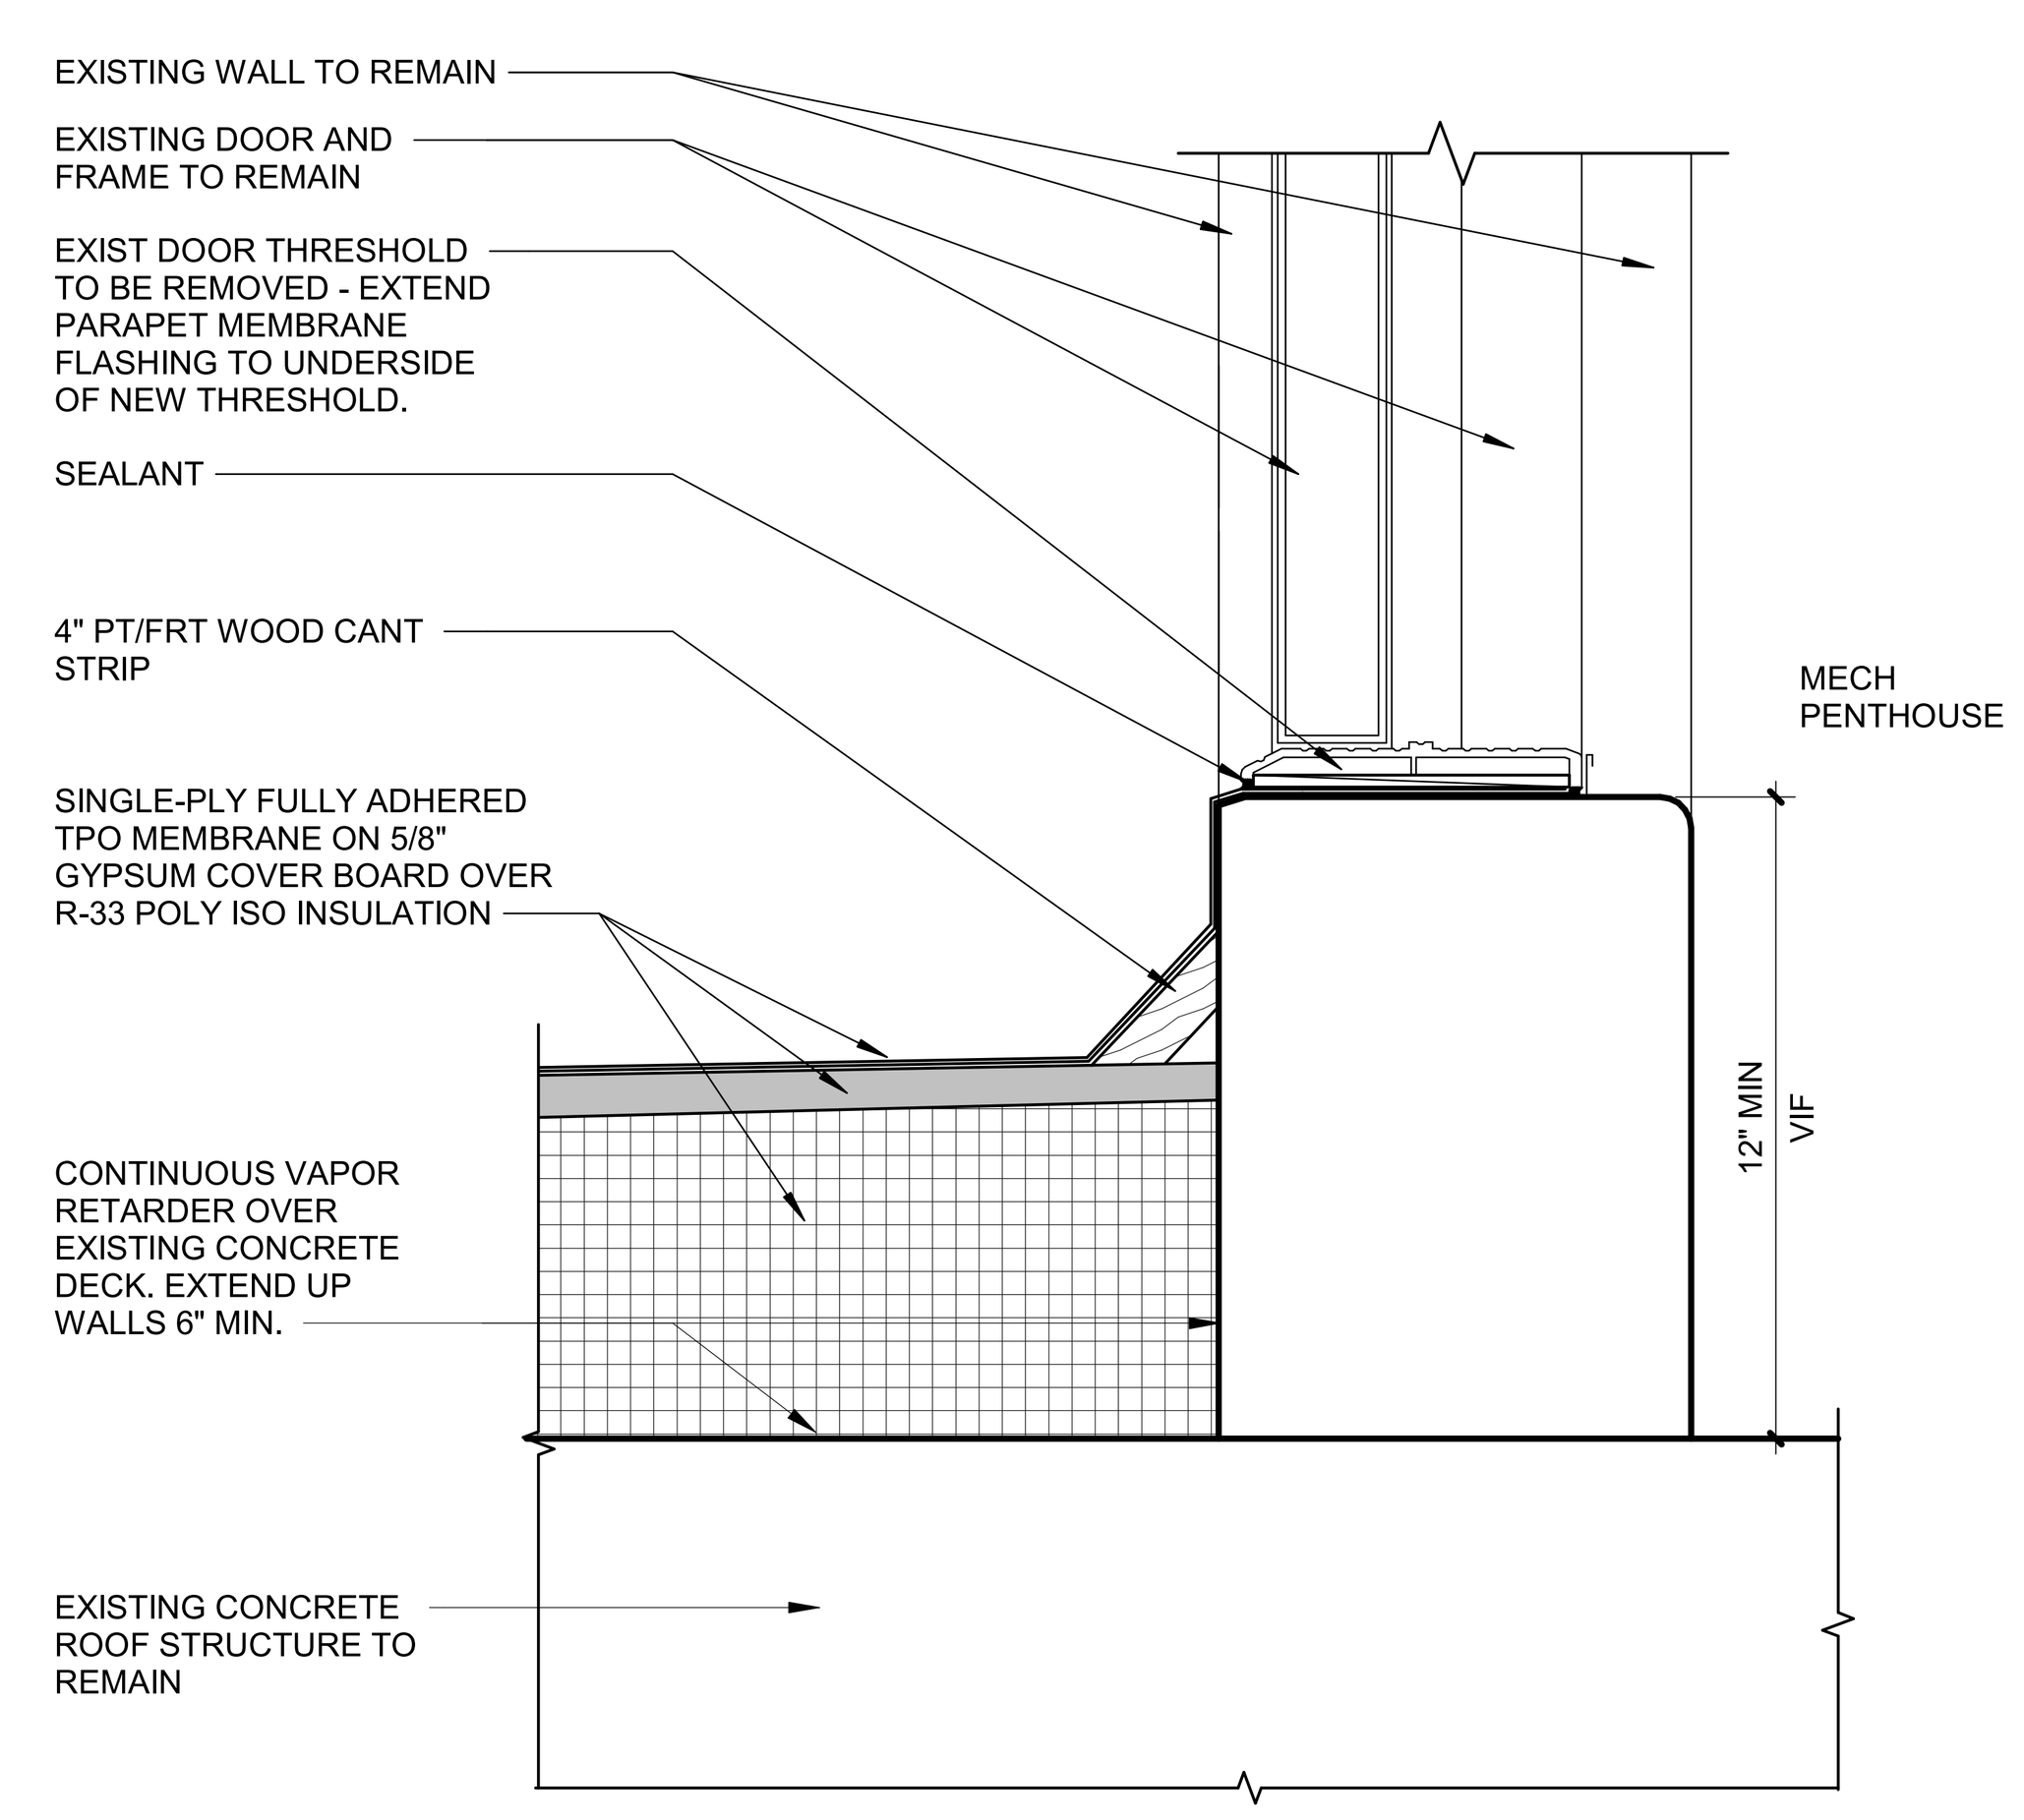

6 DOOR CURB DETAIL @ ROOF
Scale: 3" = 1'-0"
0 2" 4" 8"

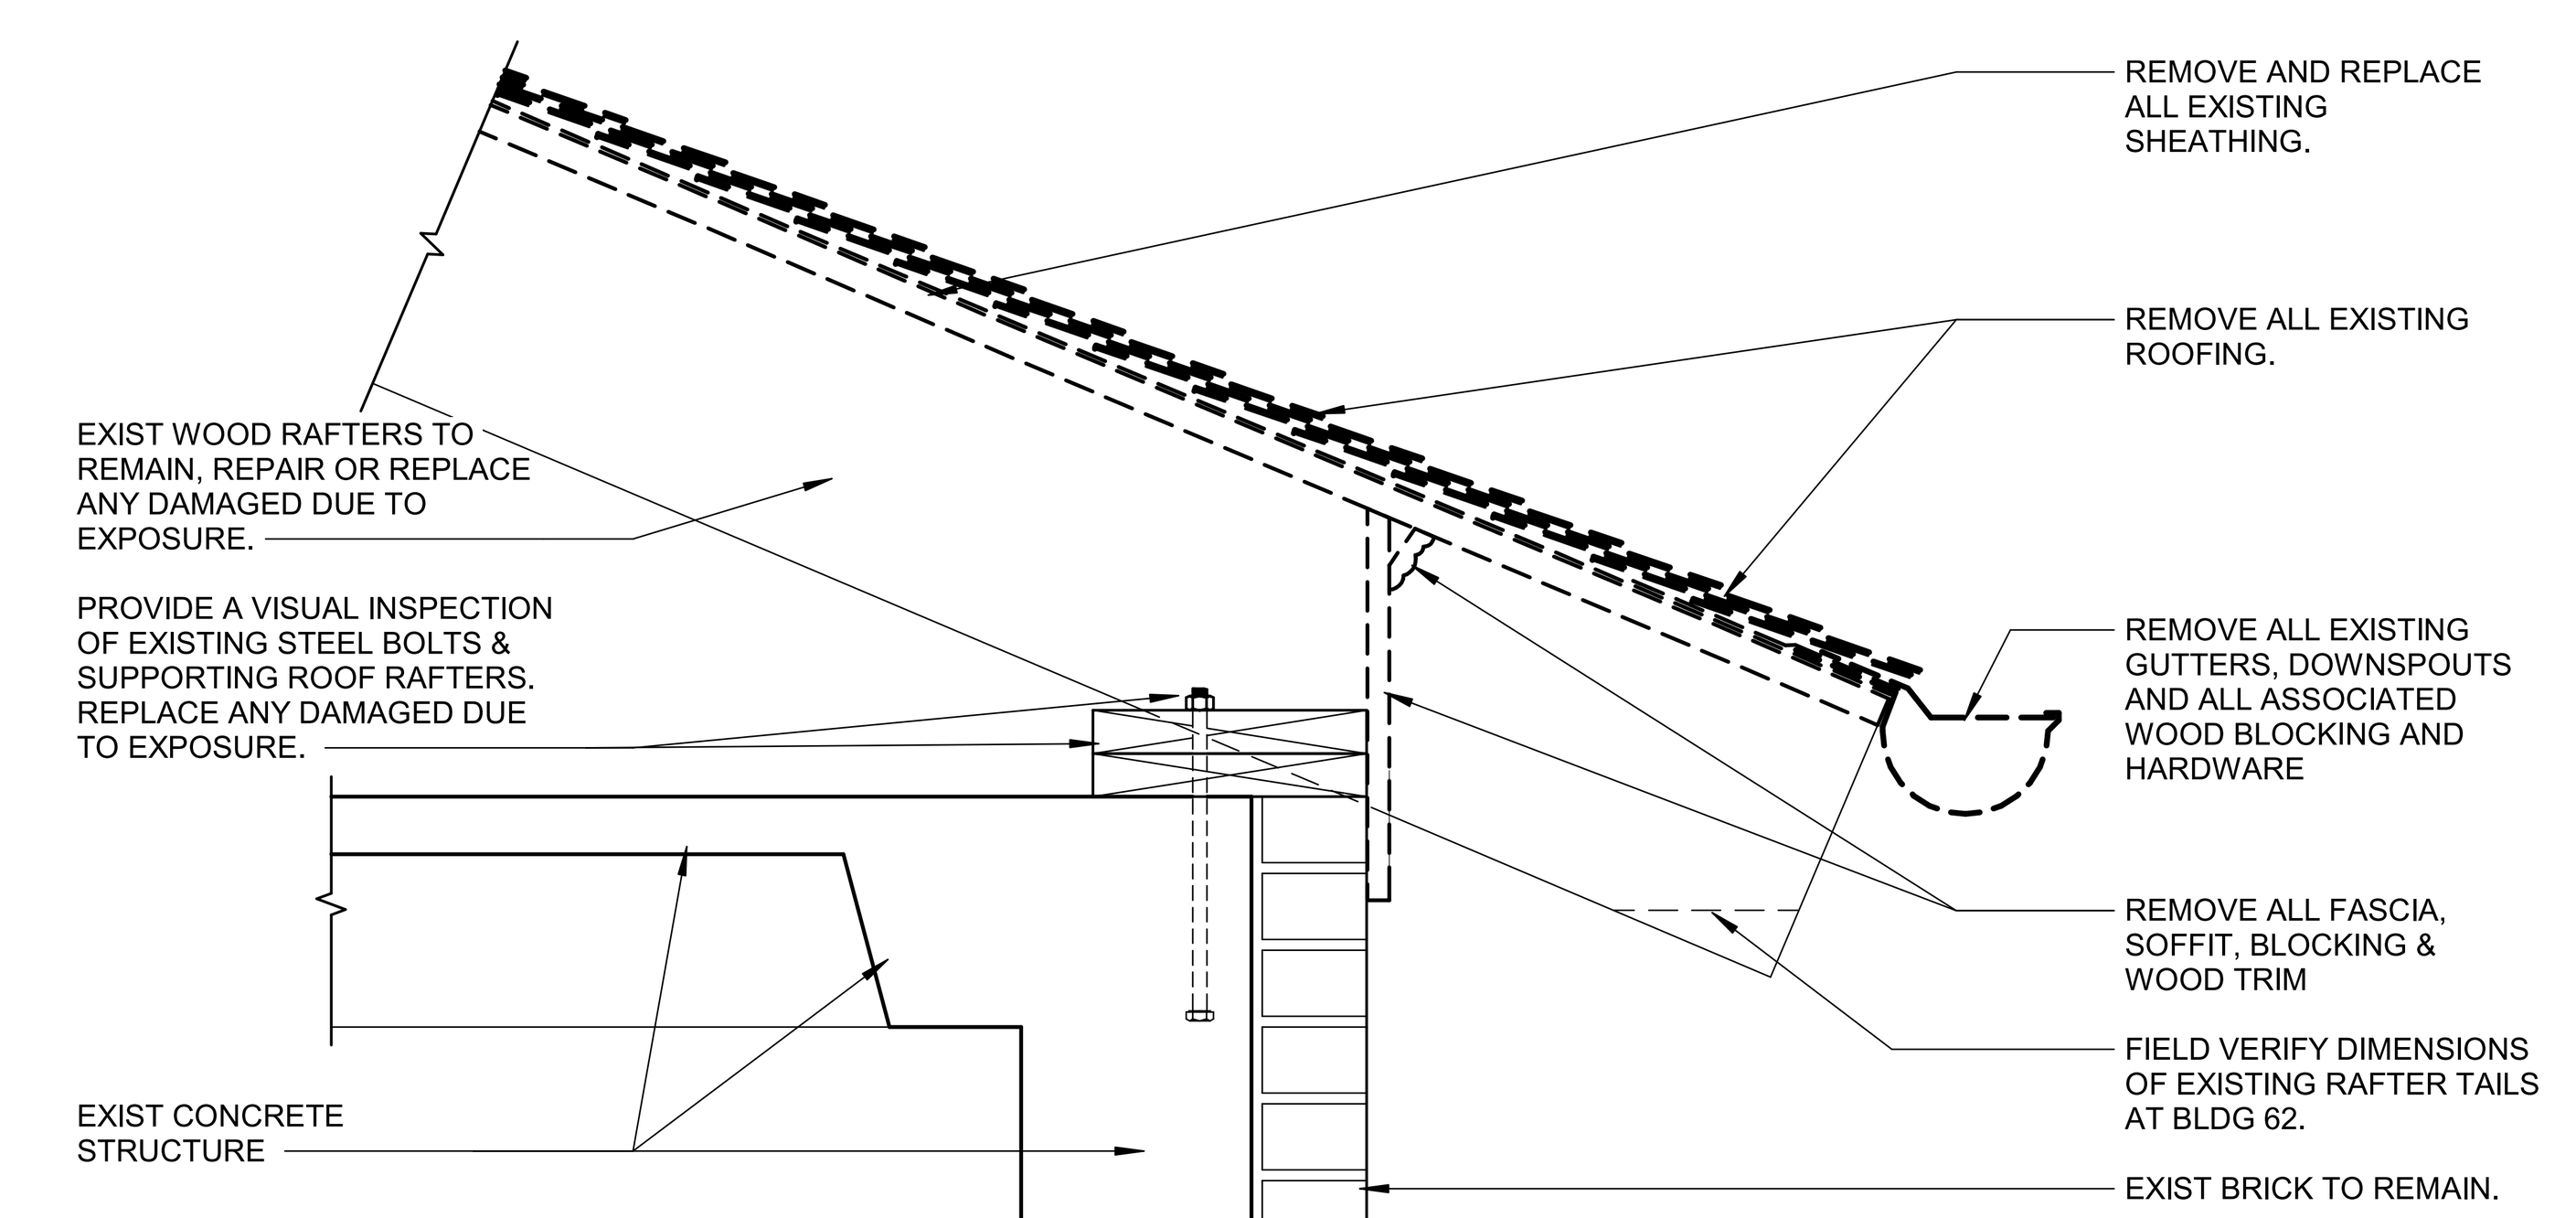

3 ASPHALT SHINGLE ROOF DETAIL - BLDG 50, 51 & 62 DEMO
Scale: 1 1/2" = 1'-0"
0 3" 6" 12"

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

APOGEE CONSULTING GROUP, P.A. 52644 RALEIGH, NC

WALTER DAVID VAN SCOTER REG. NO. 9953 STATE OF LOUISIANA REGISTERED ARCHITECT 6/21/2024

Walter David Van Scoter

PROJECT MANAGER
ACG Project Number 23-069

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ROOF DETAILS

Project Title: REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62

VA PROJECT NUMBER: 619A4-24-102

Building Number: # 19, 20, 50, 51, AND 62

Location: CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM 2400 HOSPITAL ROAD TUSKEGEE, AL 36083

Approved:

Date	Checked	Drawn
JUNE 19, 2024	WVS	RF

Drawing Number: A-501
Dwg 12 of 14

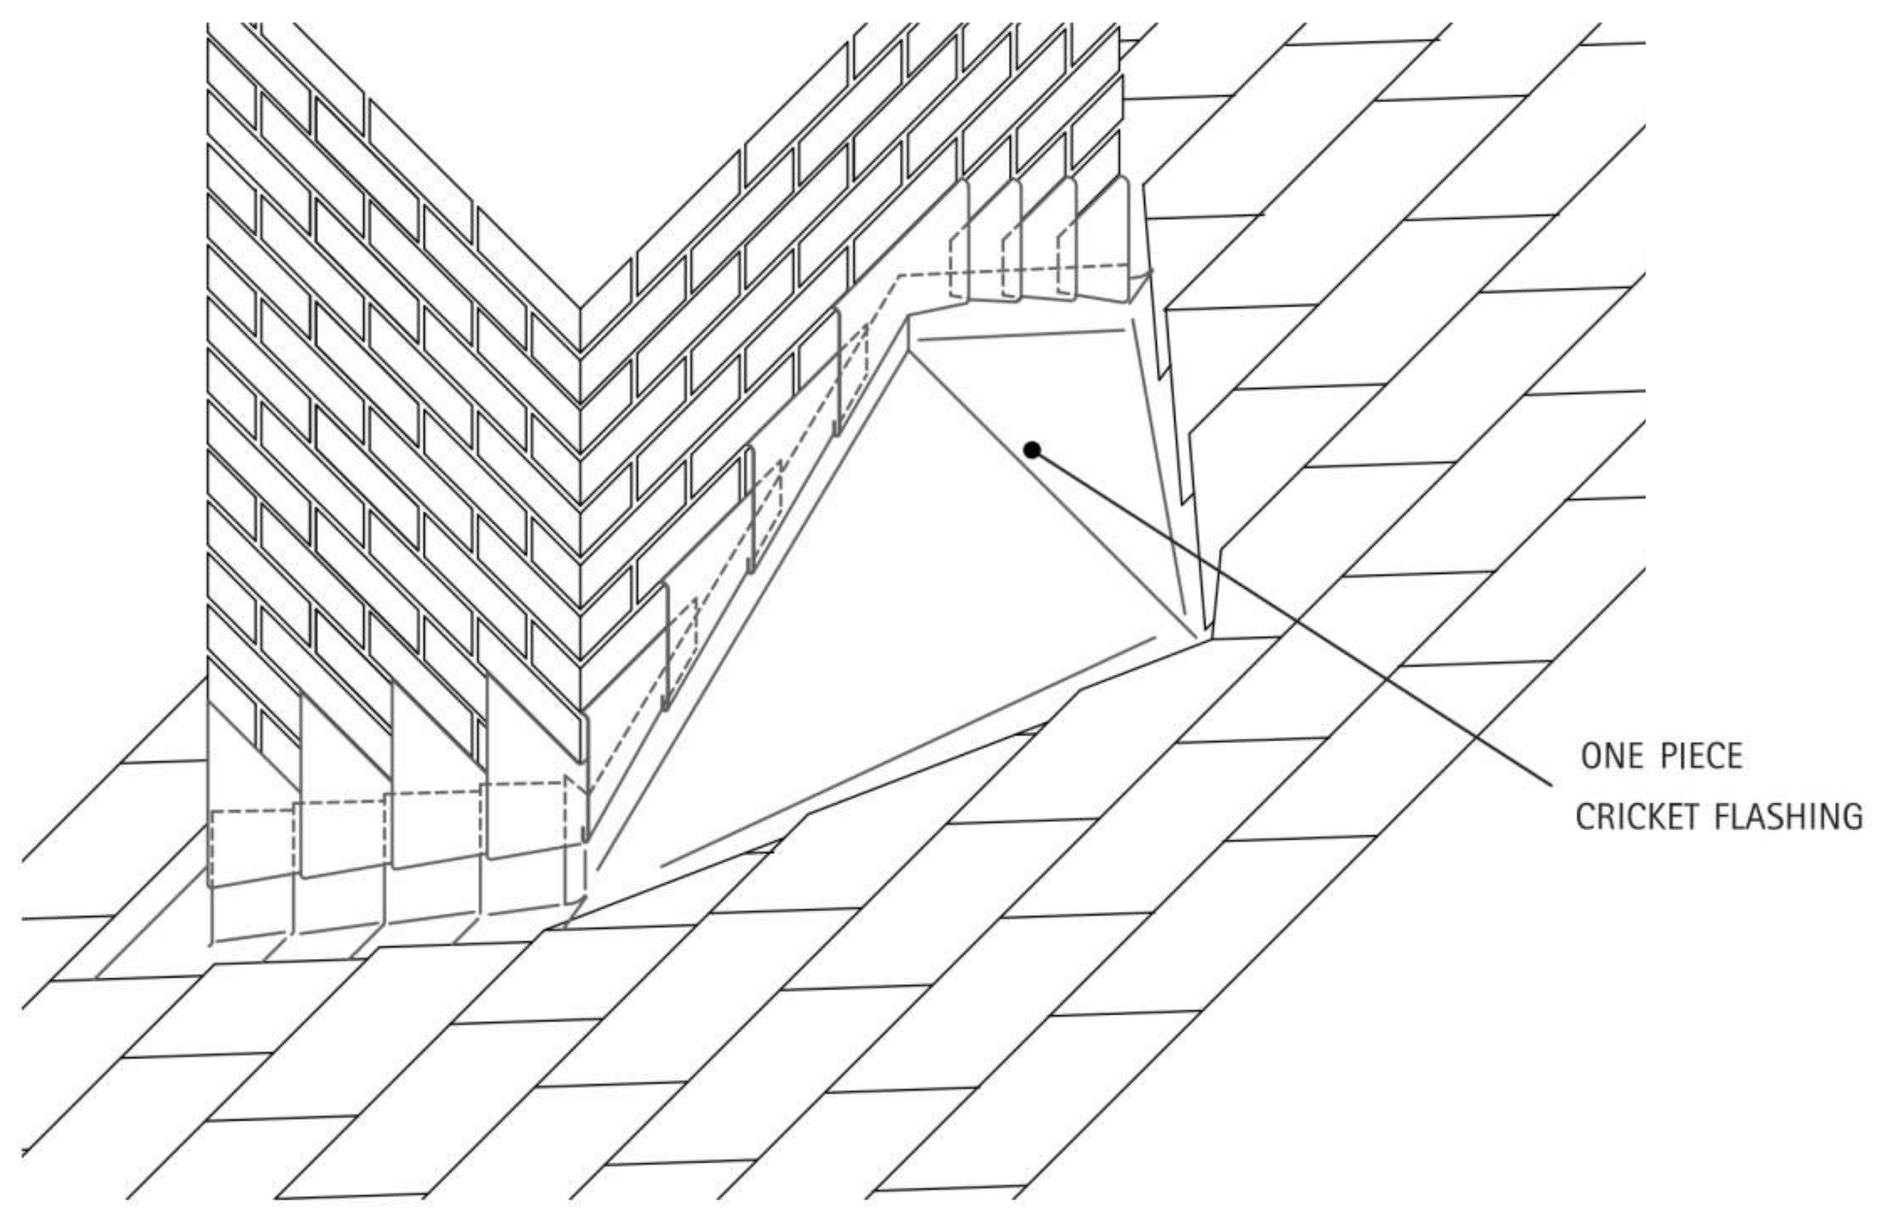

6 **CHIMNEY CRICKETT - COPPER FLASHING**
Scale: No Scale

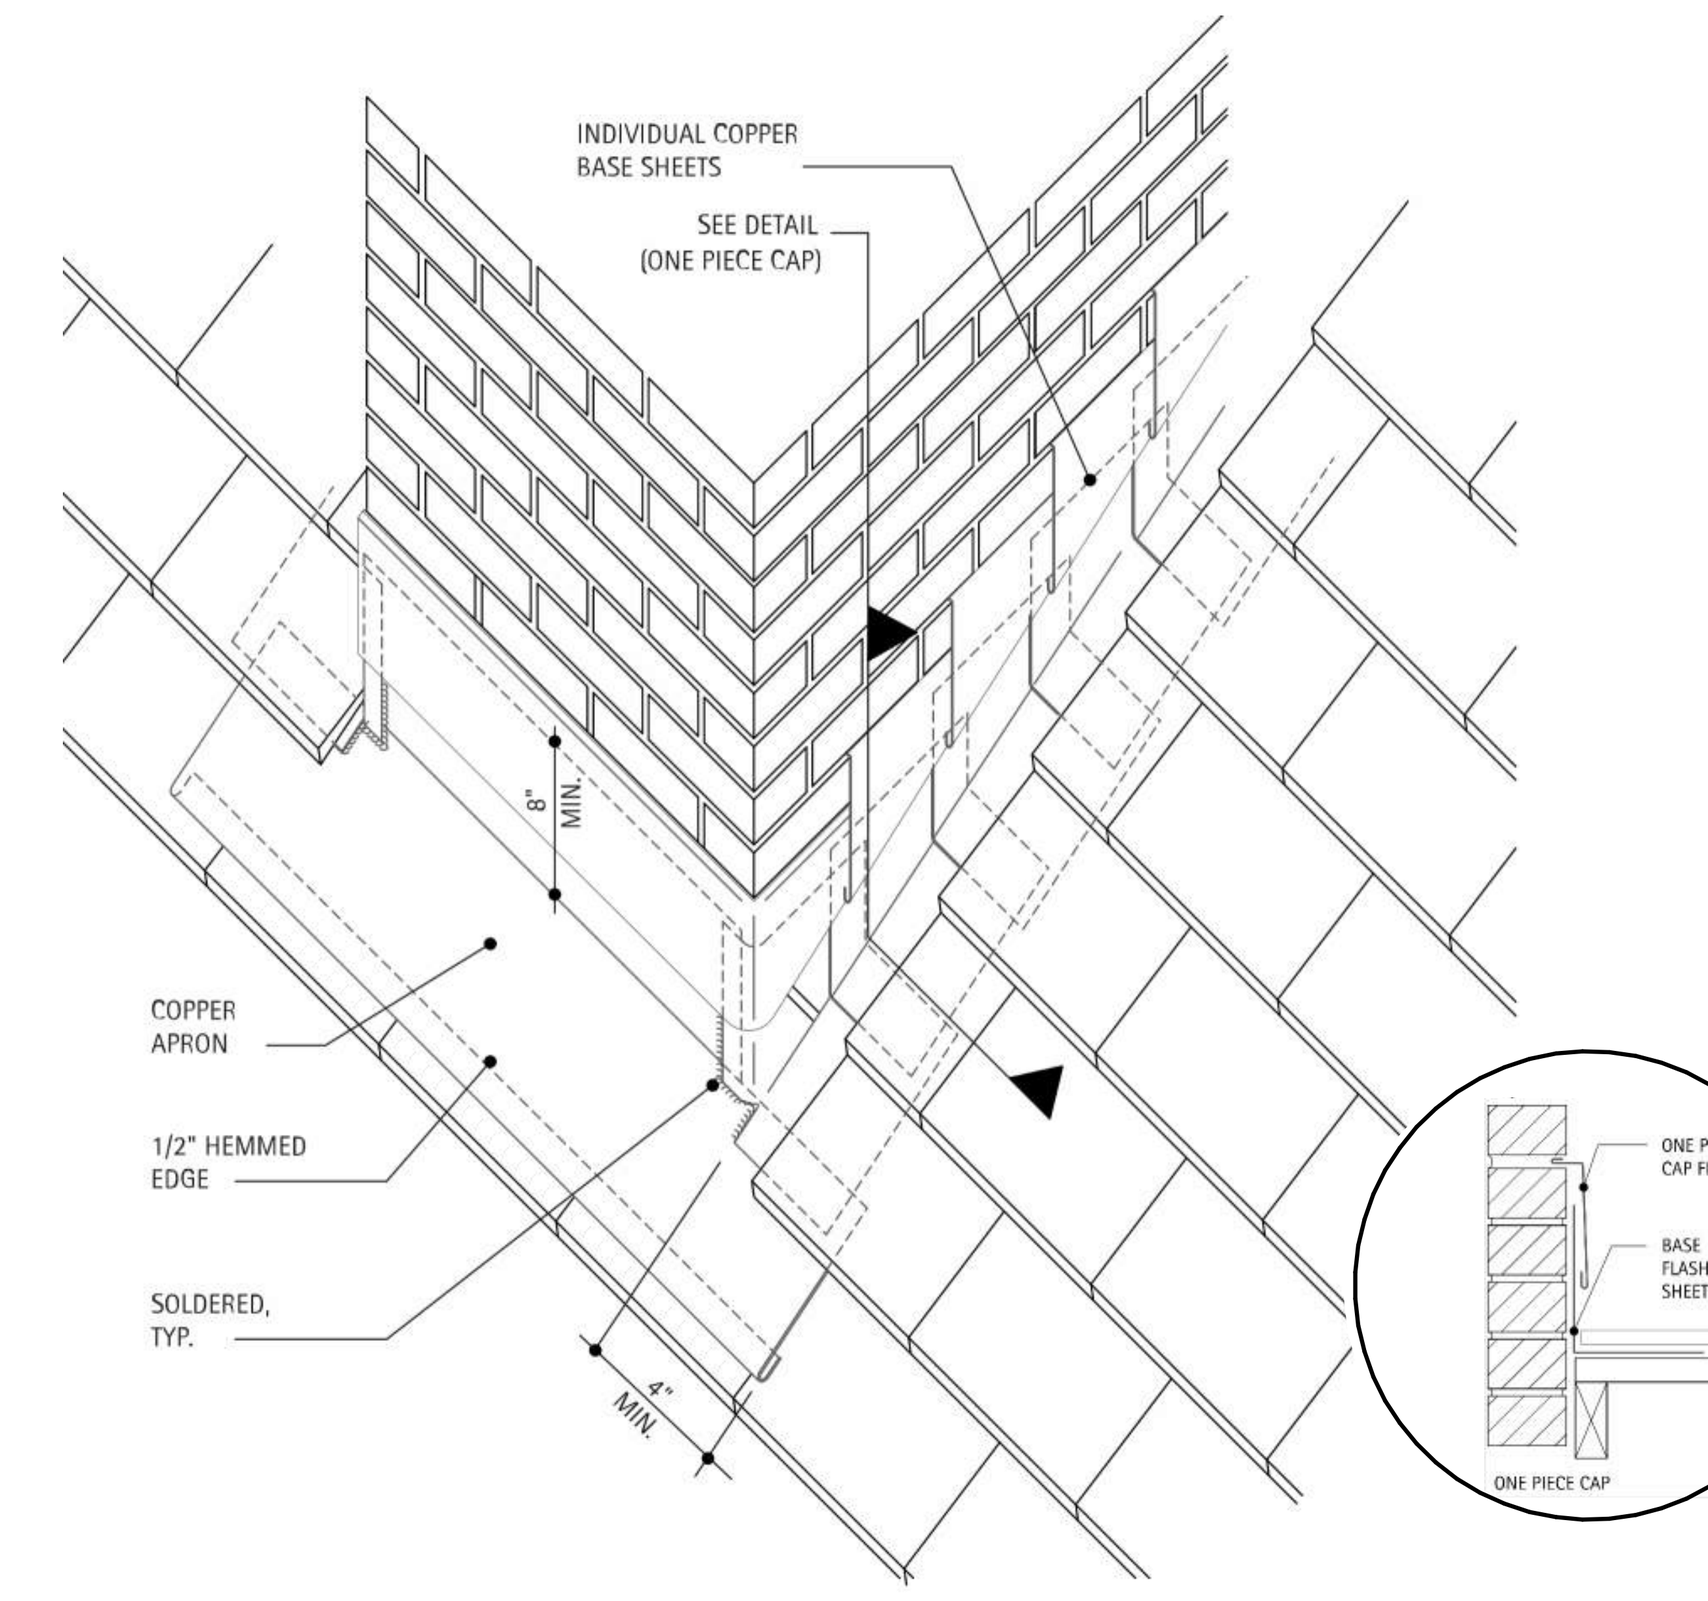

3 **STEPPED AND CHIMNEY- COPPER FLASHING**
Scale: No Scale

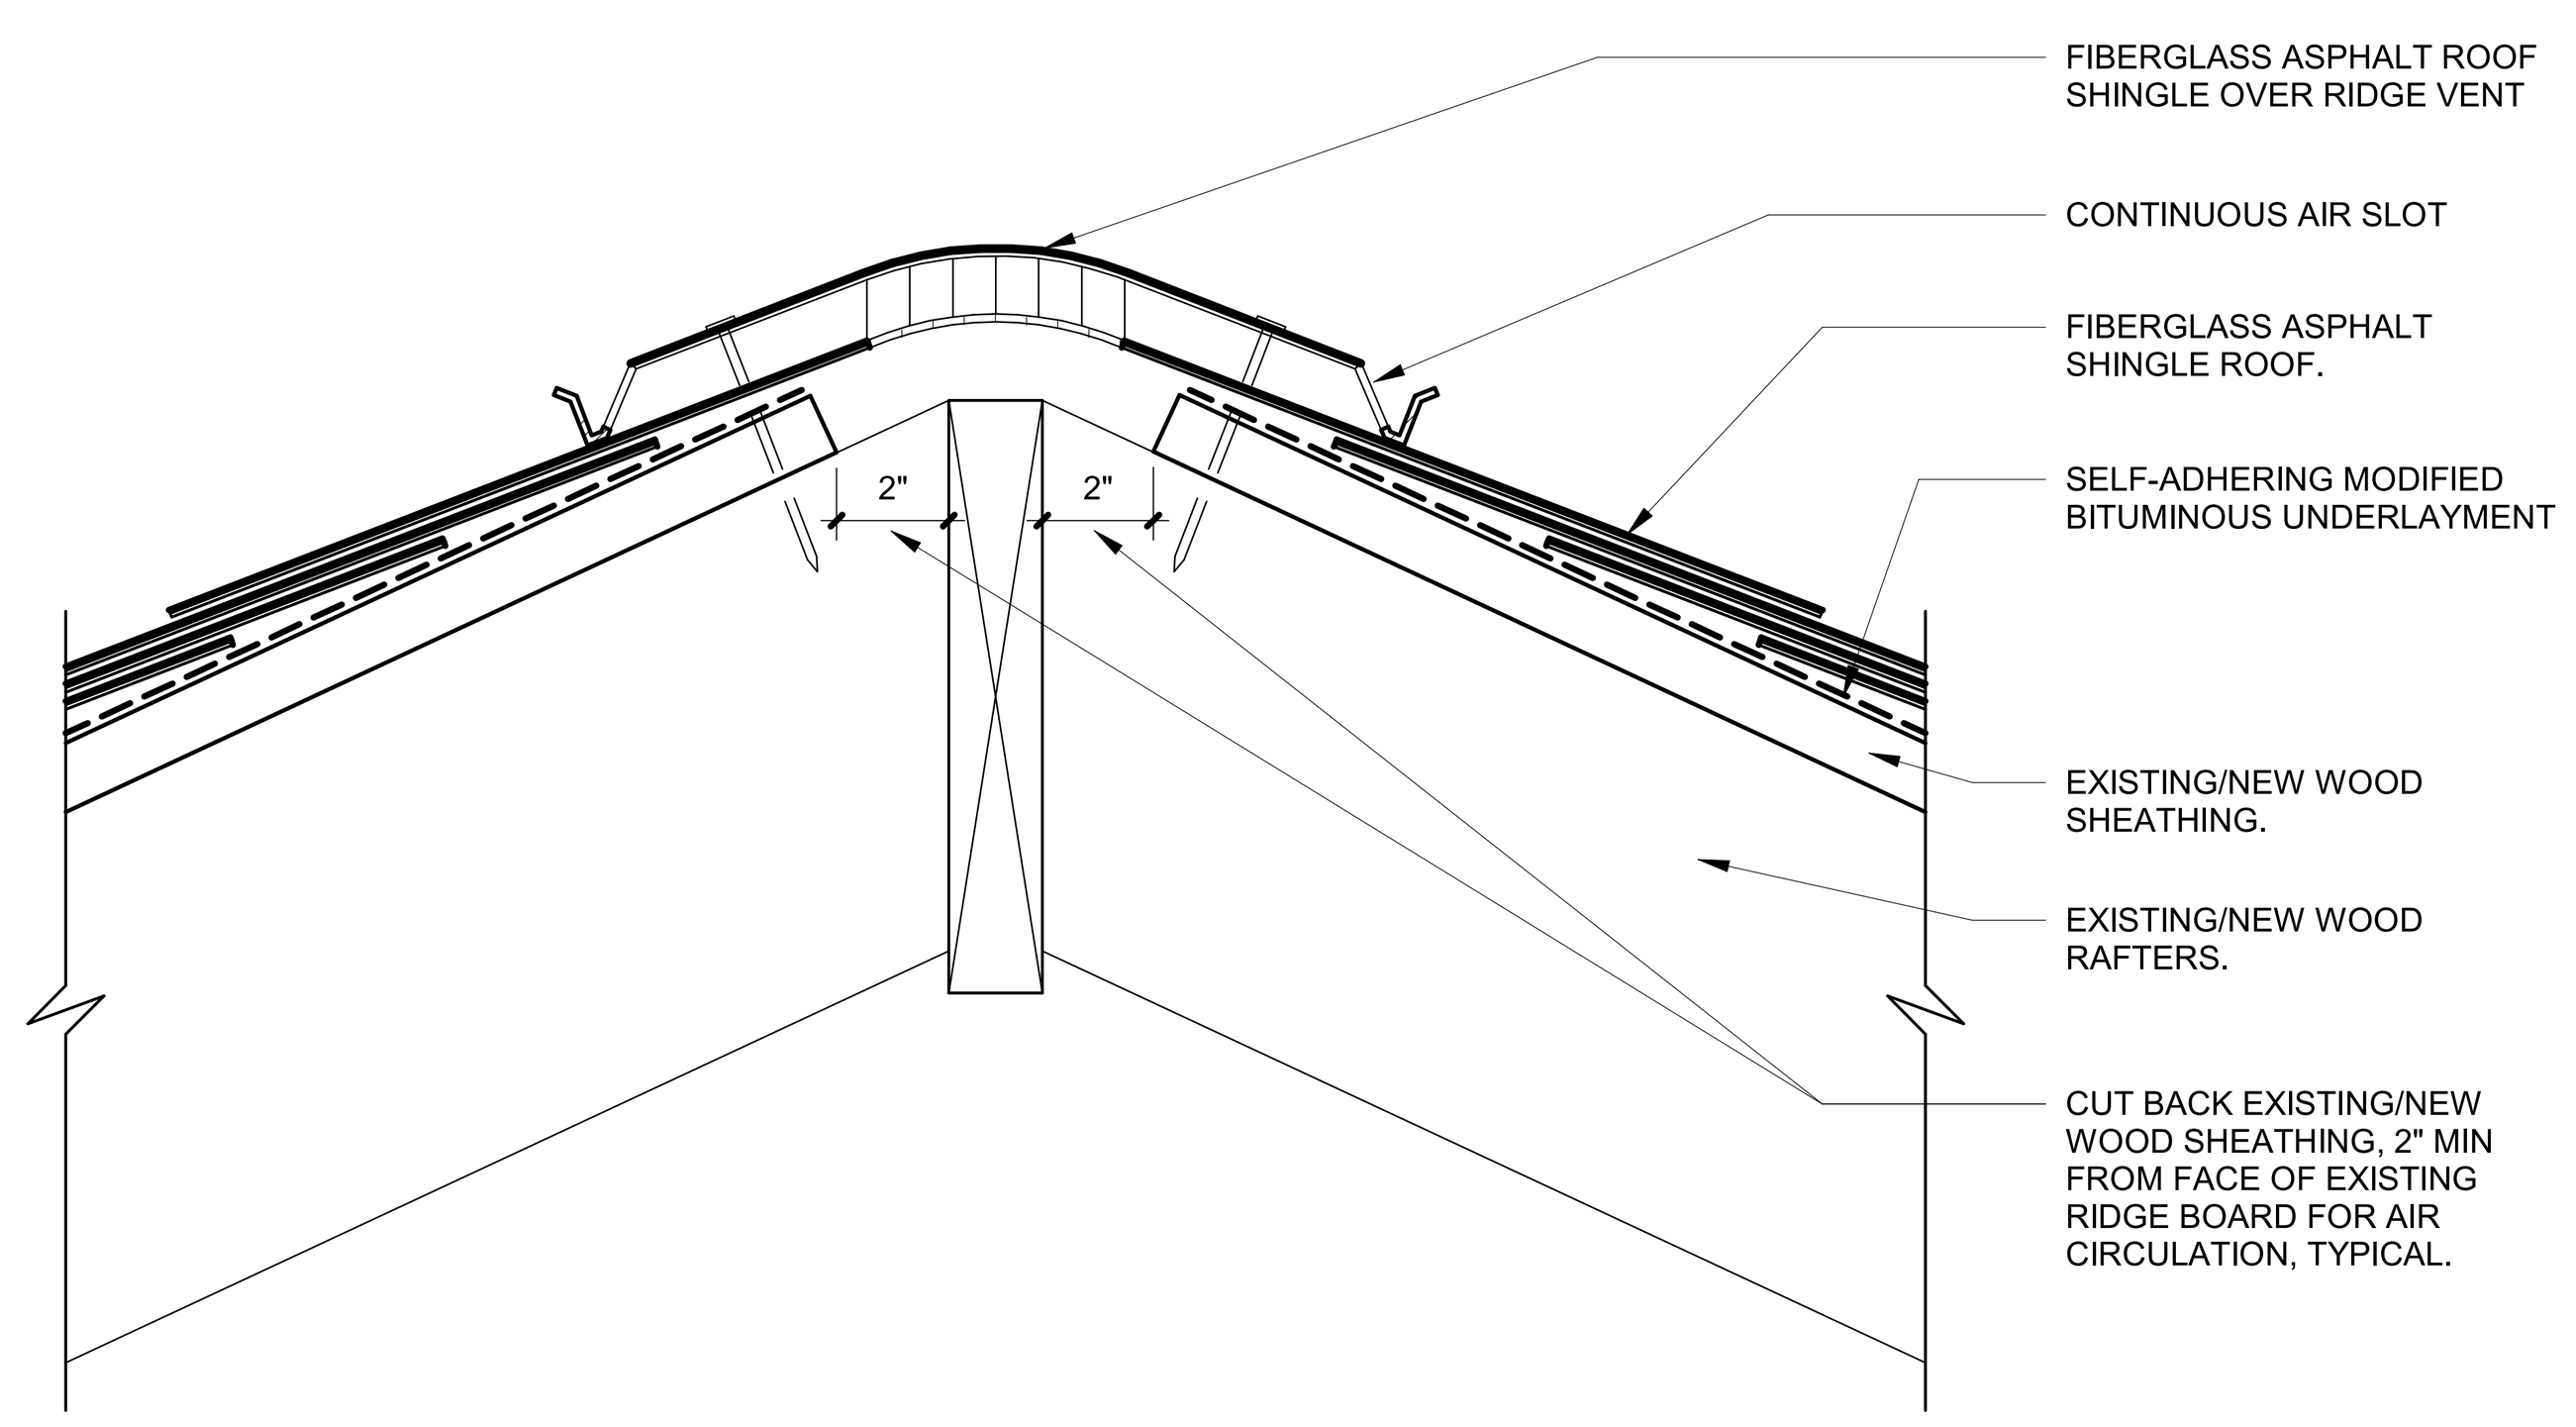

1 **VENTED ASPHALT SHINGLE RIDGE CAP DETAIL**
Scale: 3" = 1'-0"

SHEET NOTES:

A. THE FINAL DETAILS SHALL BE SUBMITTED AS PART OF THE SHOP DRAWING SUBMITTAL PROCESS WITH THE ROOFING MANUFACTURER'S RECOMMENDED DETAILS.

B. CONTRACTOR TO REMOVE ALL ROOF DRAIN COVERS AND PROVIDE BLOW DOWN OF DRAIN PIPES TO ENSURE NO BLOCKAGE.

C. THE ROOF SYSTEM FOR BUILDINGS 19, 20, AS WELL AS THE PENTHOUSE ROOFS FOR BUILDINGS 50 AND 62, IS ASPHALT SHINGLE ROOFS PER SPECIFICATION SECTION 07 31 13.

D. THE ROOF MEMBRANE SYSTEM FOR BUILDINGS 50, 51 AND 62, IS A TPO ROOFING SYSTEM PER SPECIFICATION SECTION 07 54 23.

E. CONTRACTOR TO INSTALL INSULATION PER SPECIFICATION SECTION 07 22 00, AND ROOF MANUFACTURER APPROVED SUBMITTALS. R-30 RIGID INSULATION SHOWN ON DETAILS IS THE MINIMUM INSULATION REQUIRED.

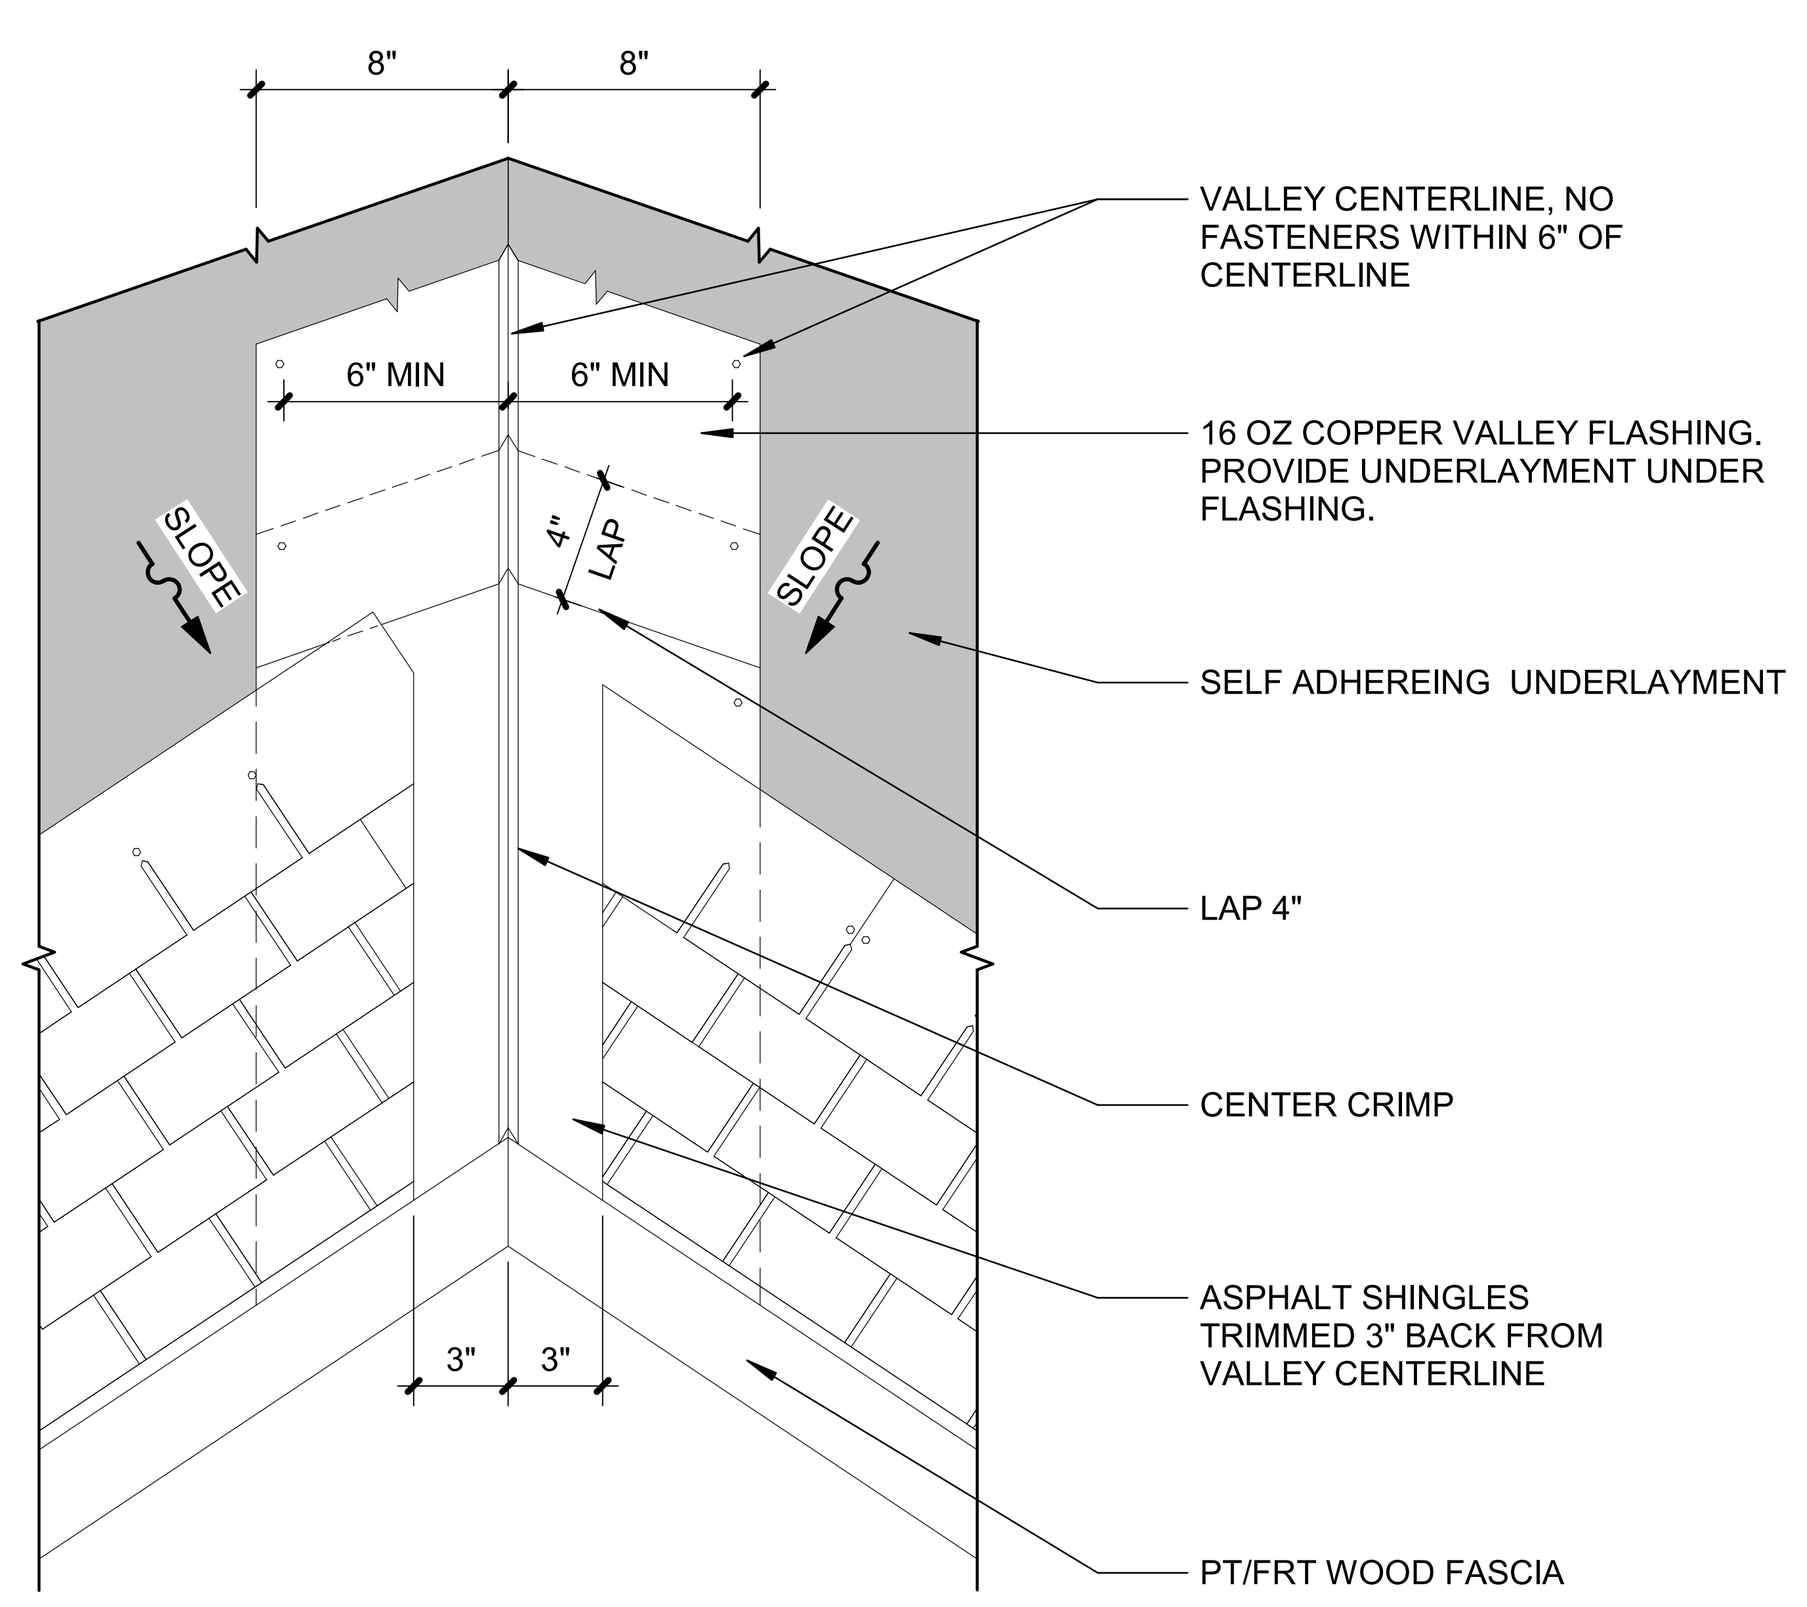

7 **VALLEY FLASHING DETAIL**
Scale: 1 1/2" = 1'-0"

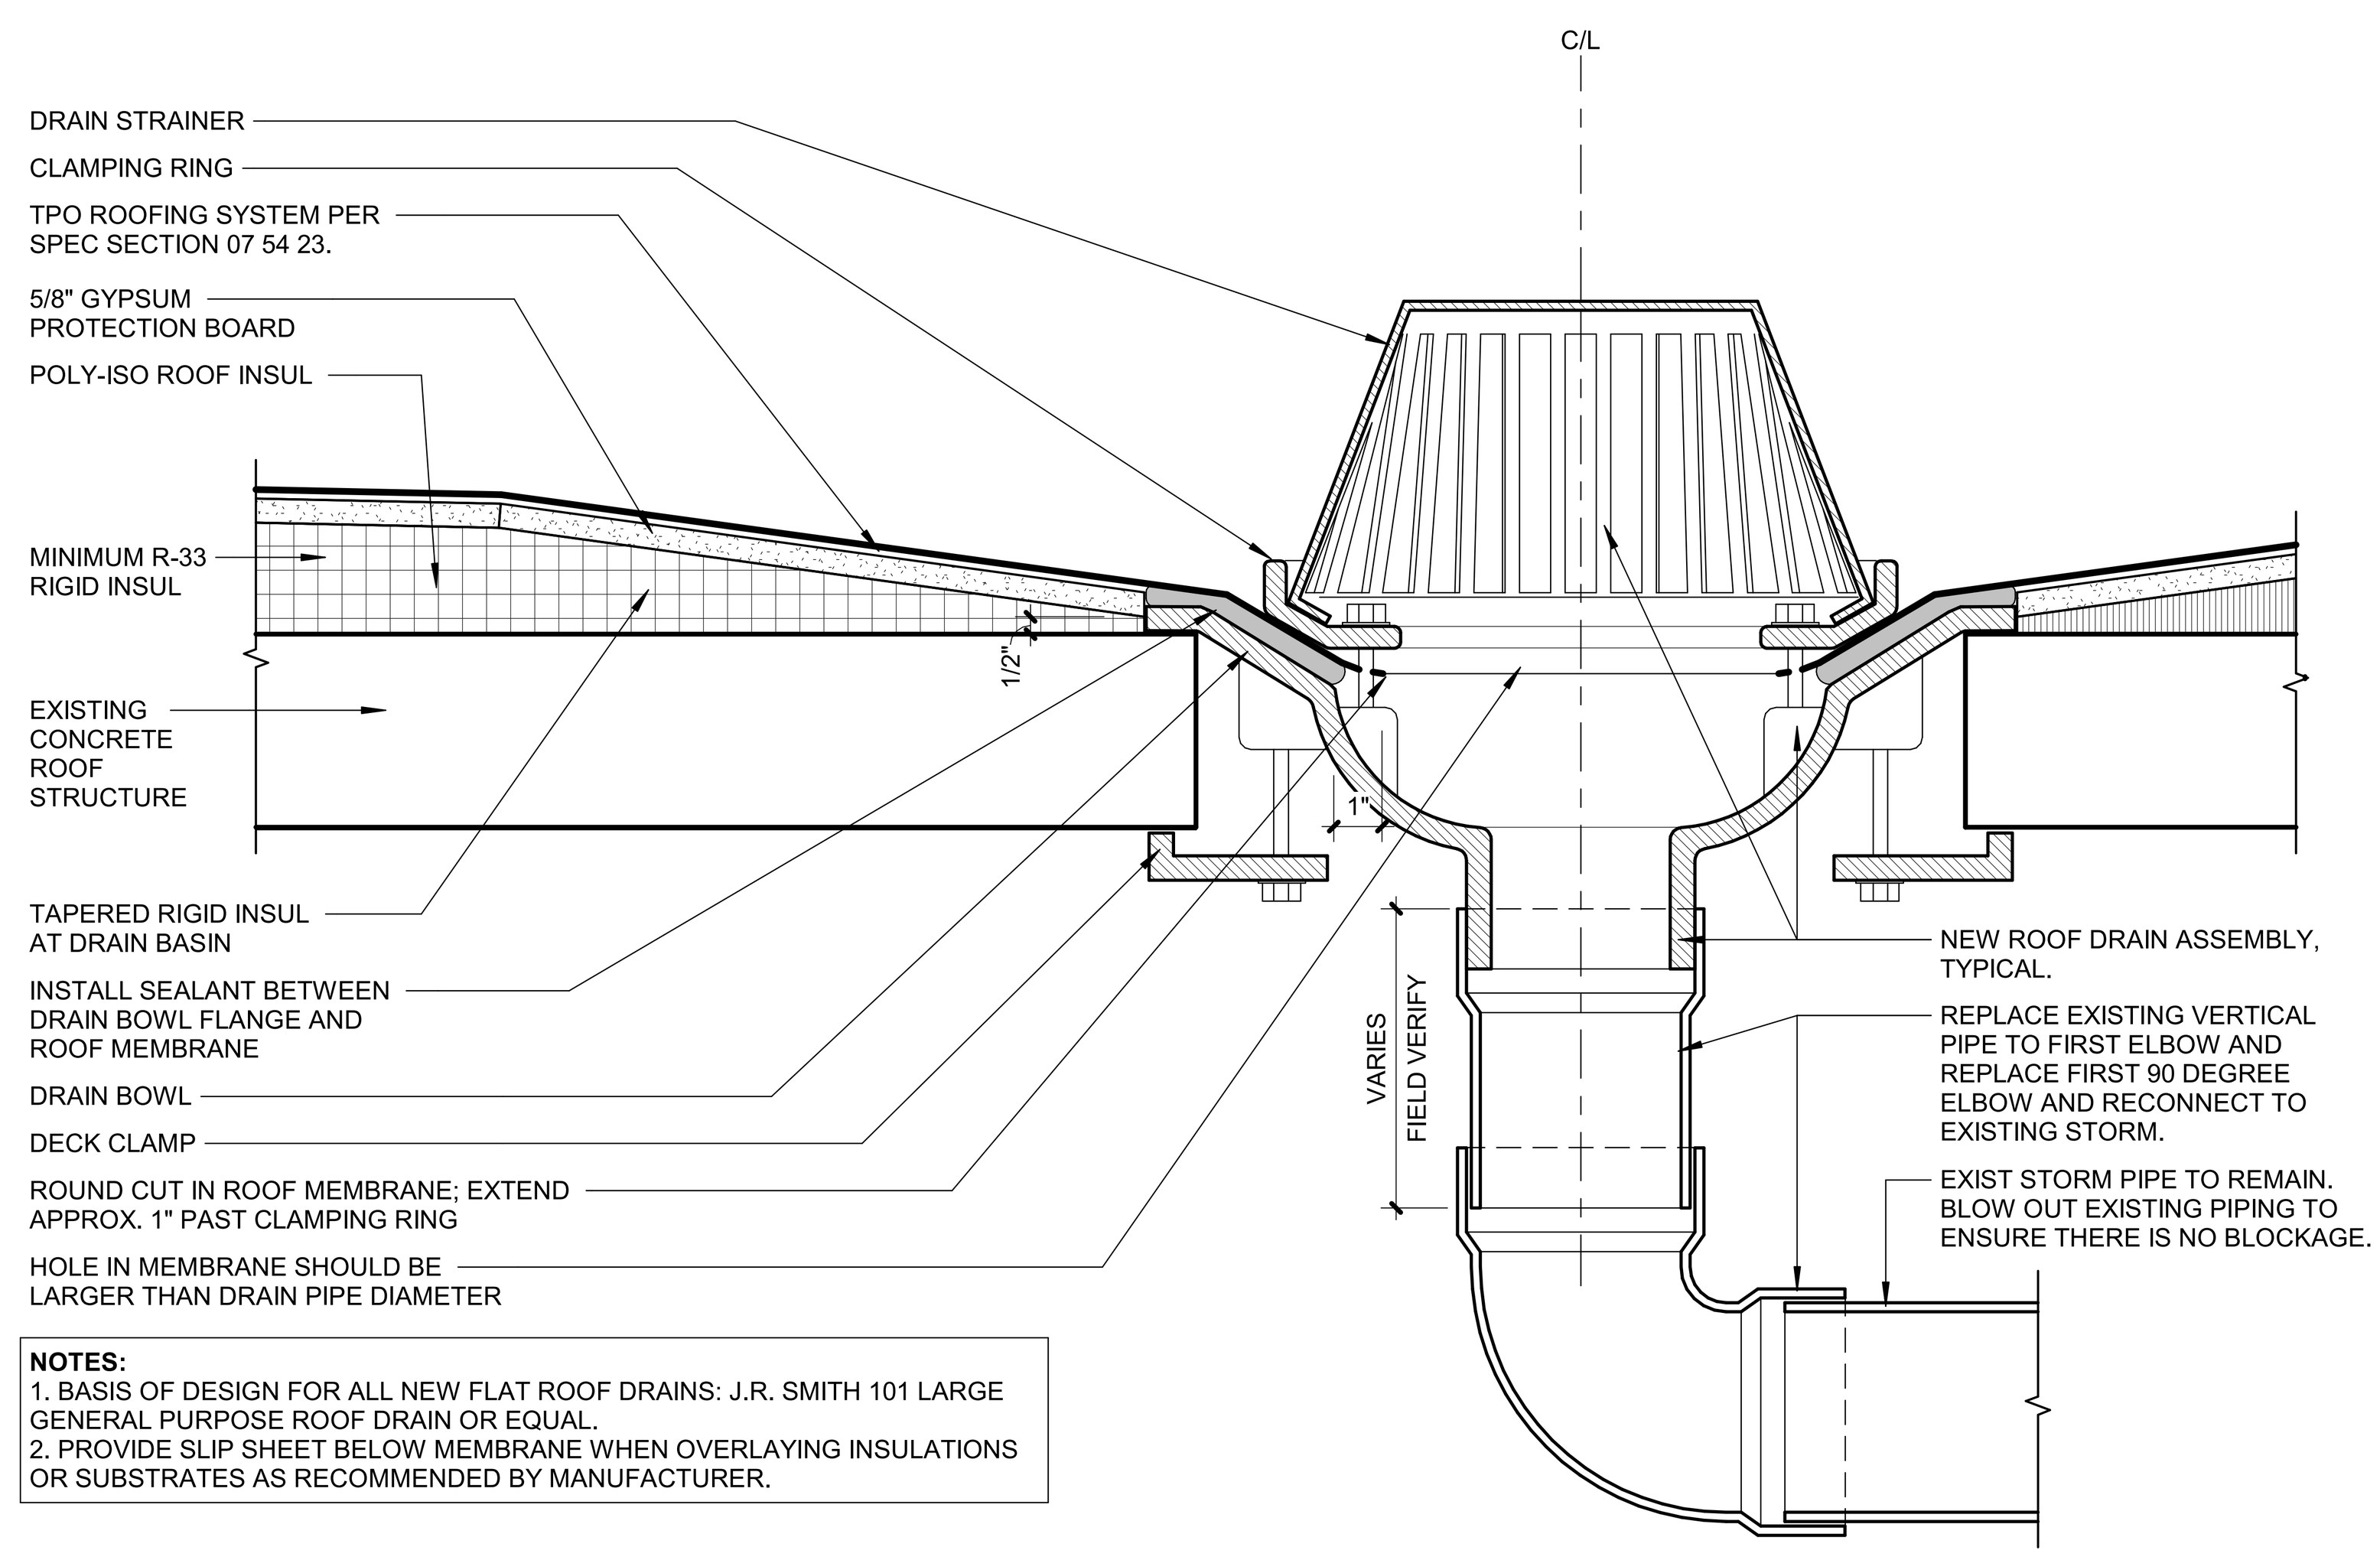

NOTES:
1. BASIS OF DESIGN FOR ALL NEW FLAT ROOF DRAINS: J.R. SMITH 101 LARGE GENERAL PURPOSE ROOF DRAIN OR EQUAL.
2. PROVIDE SLIP SHEET BELOW MEMBRANE WHEN OVERLAYING INSULATIONS OR SUBSTRATES AS RECOMMENDED BY MANUFACTURER.

4 **TYPICAL ROOF DRAIN DETAIL**
Scale: 3" = 1'-0"

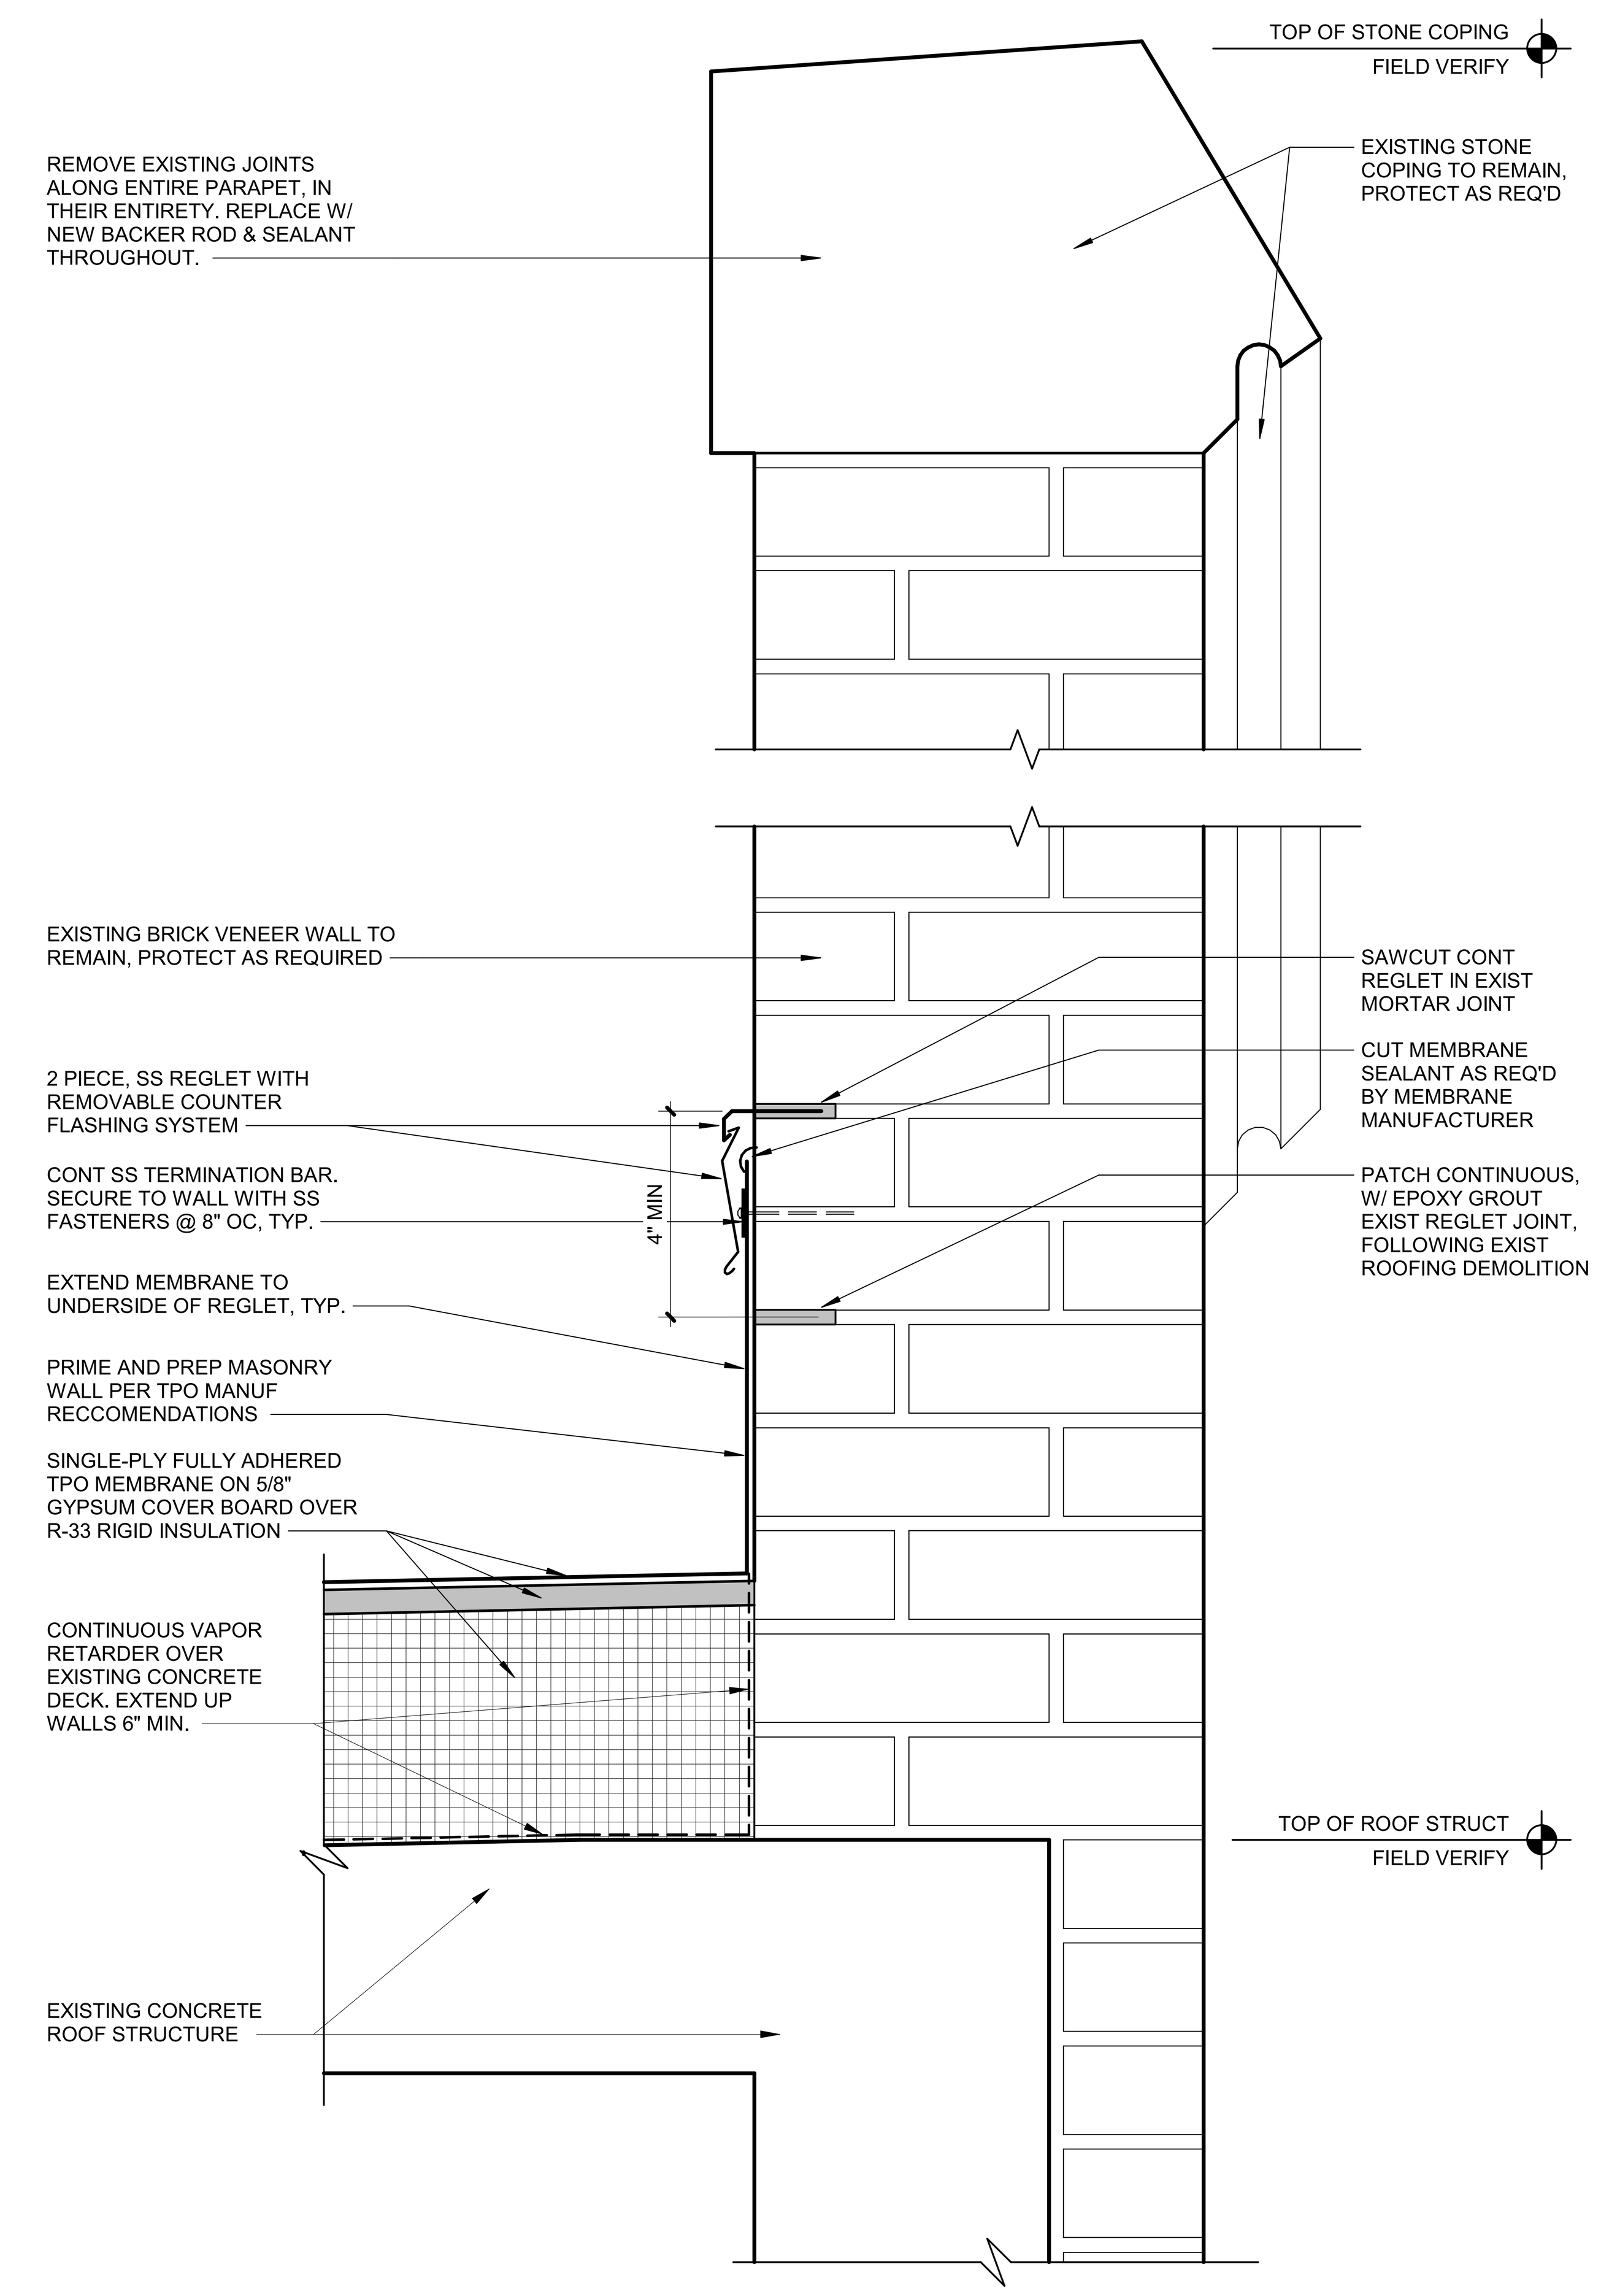

2 **ROOF FLASHING DETAIL @ PARAPET**
Scale: 3" = 1'-0"

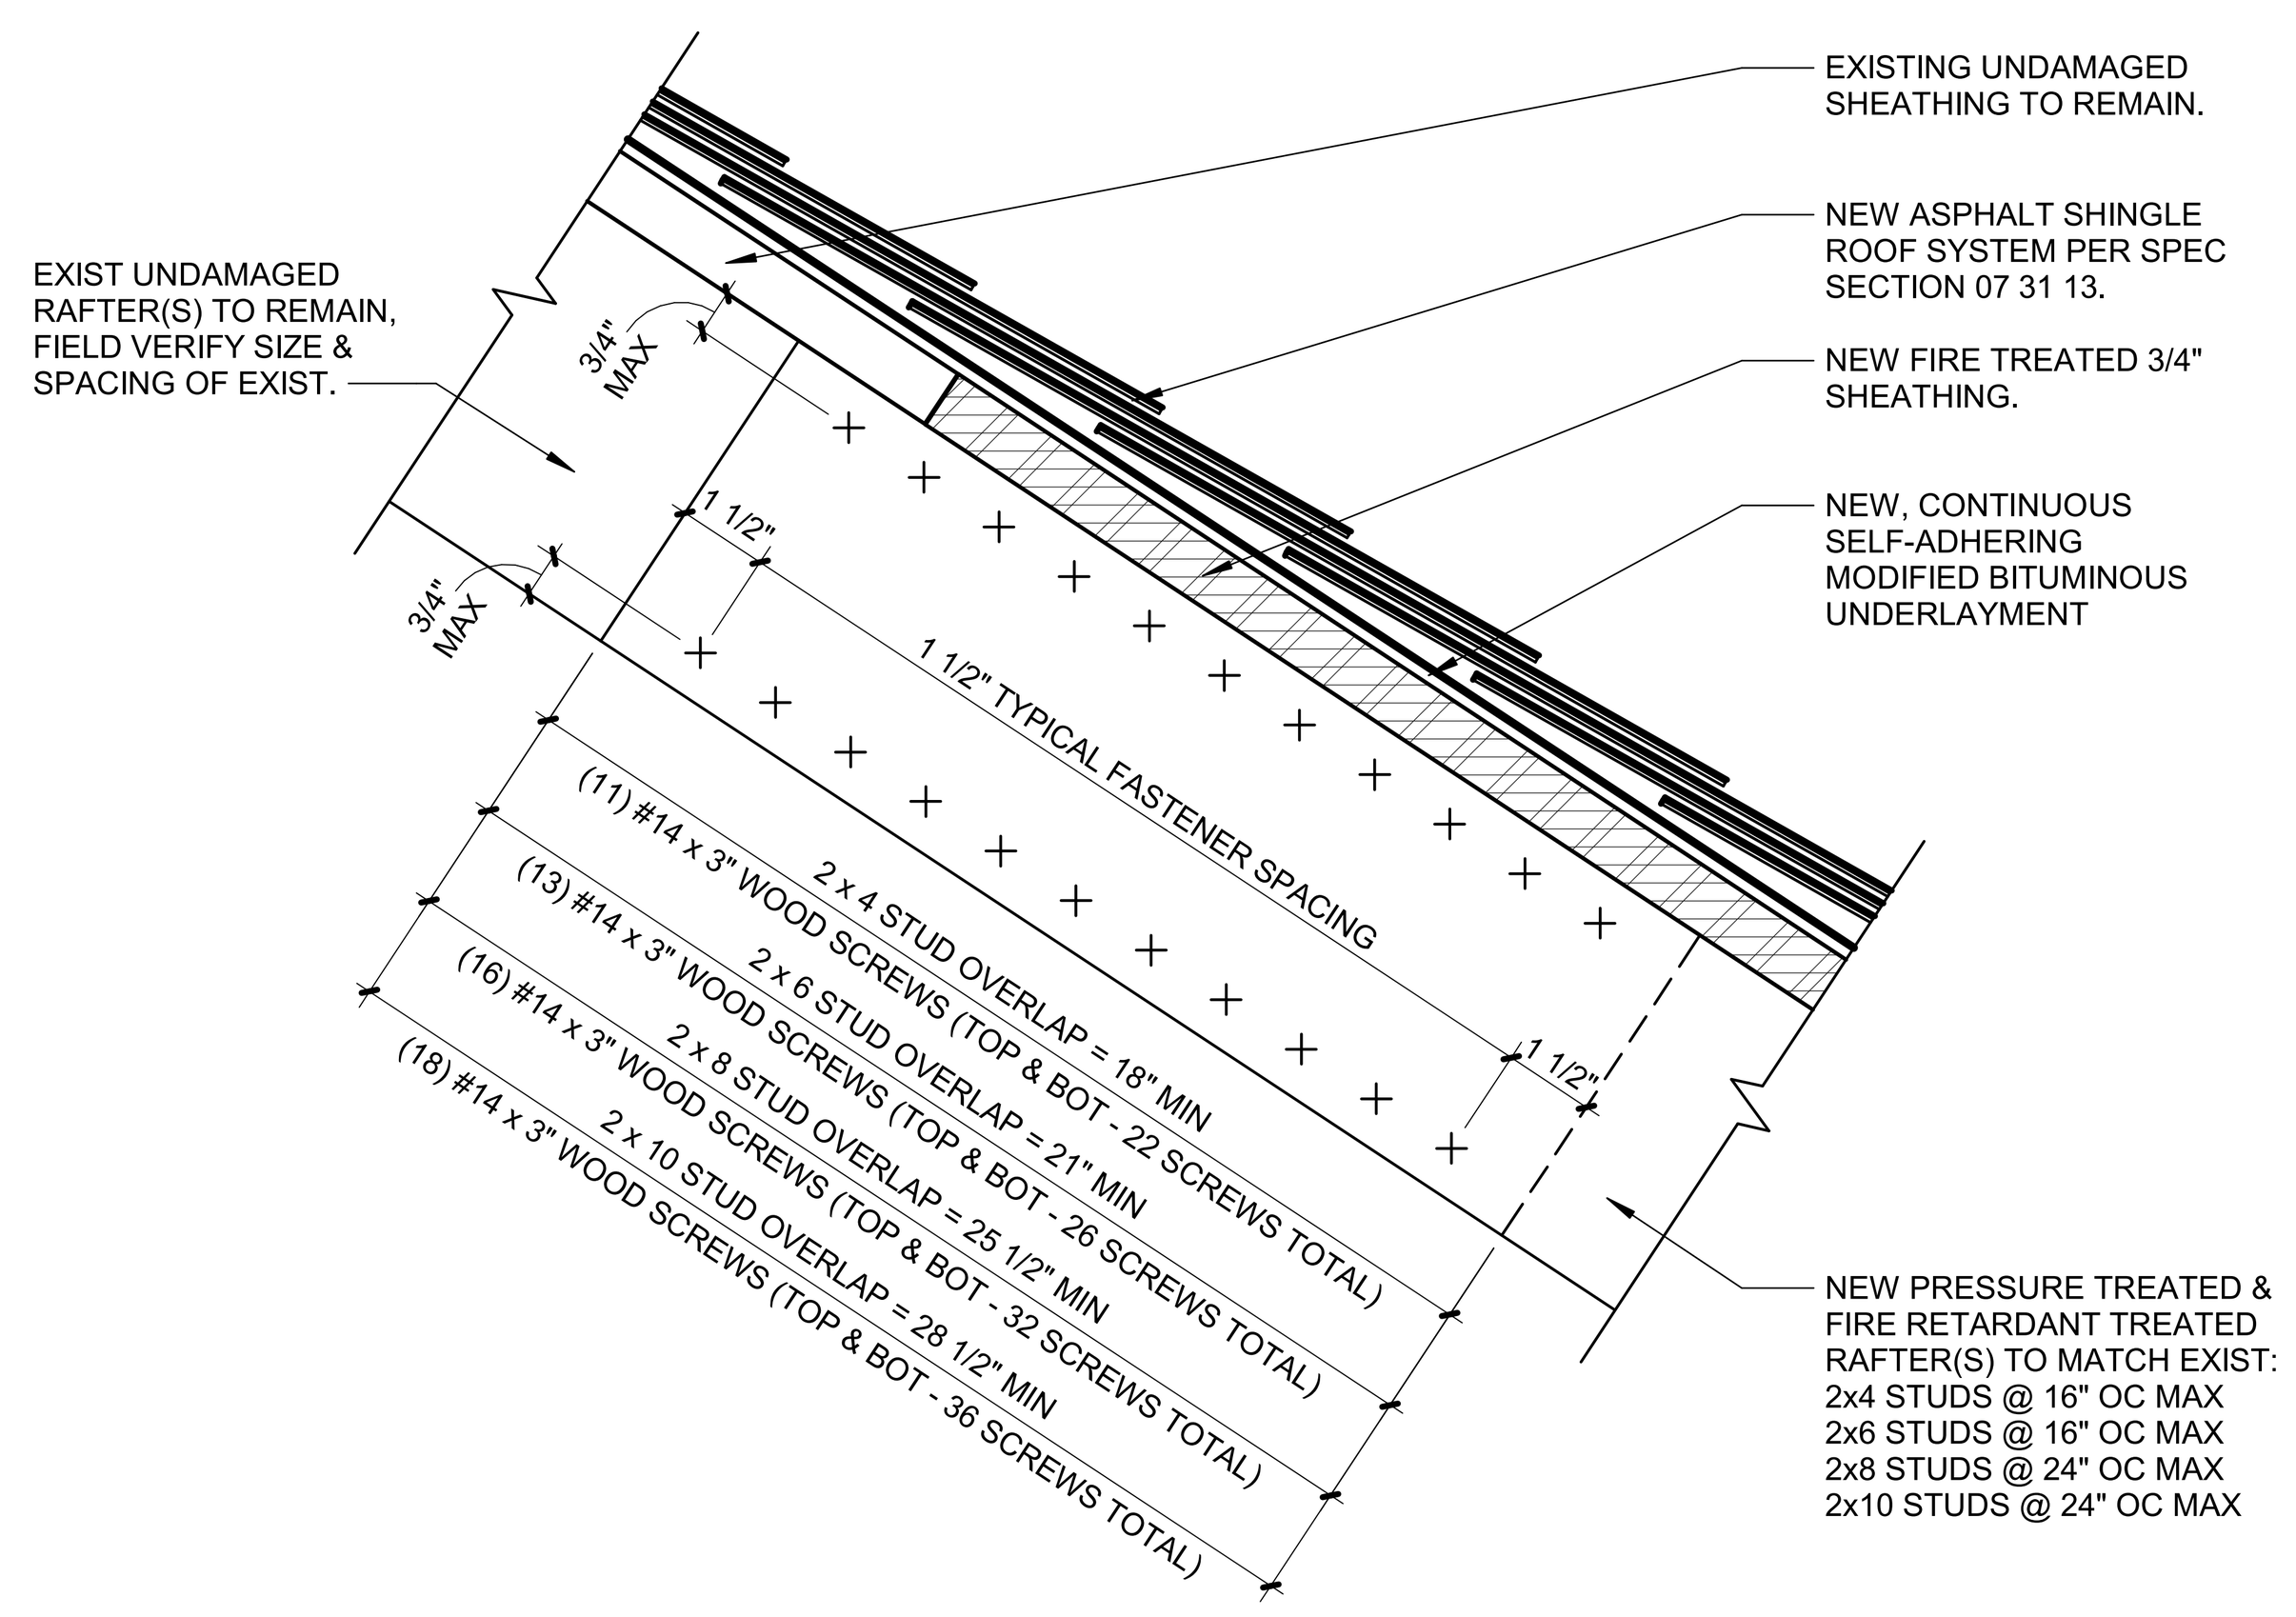

8 **TYPICAL RAFTER SPLICE DETAIL**
Scale: 3" = 1'-0"

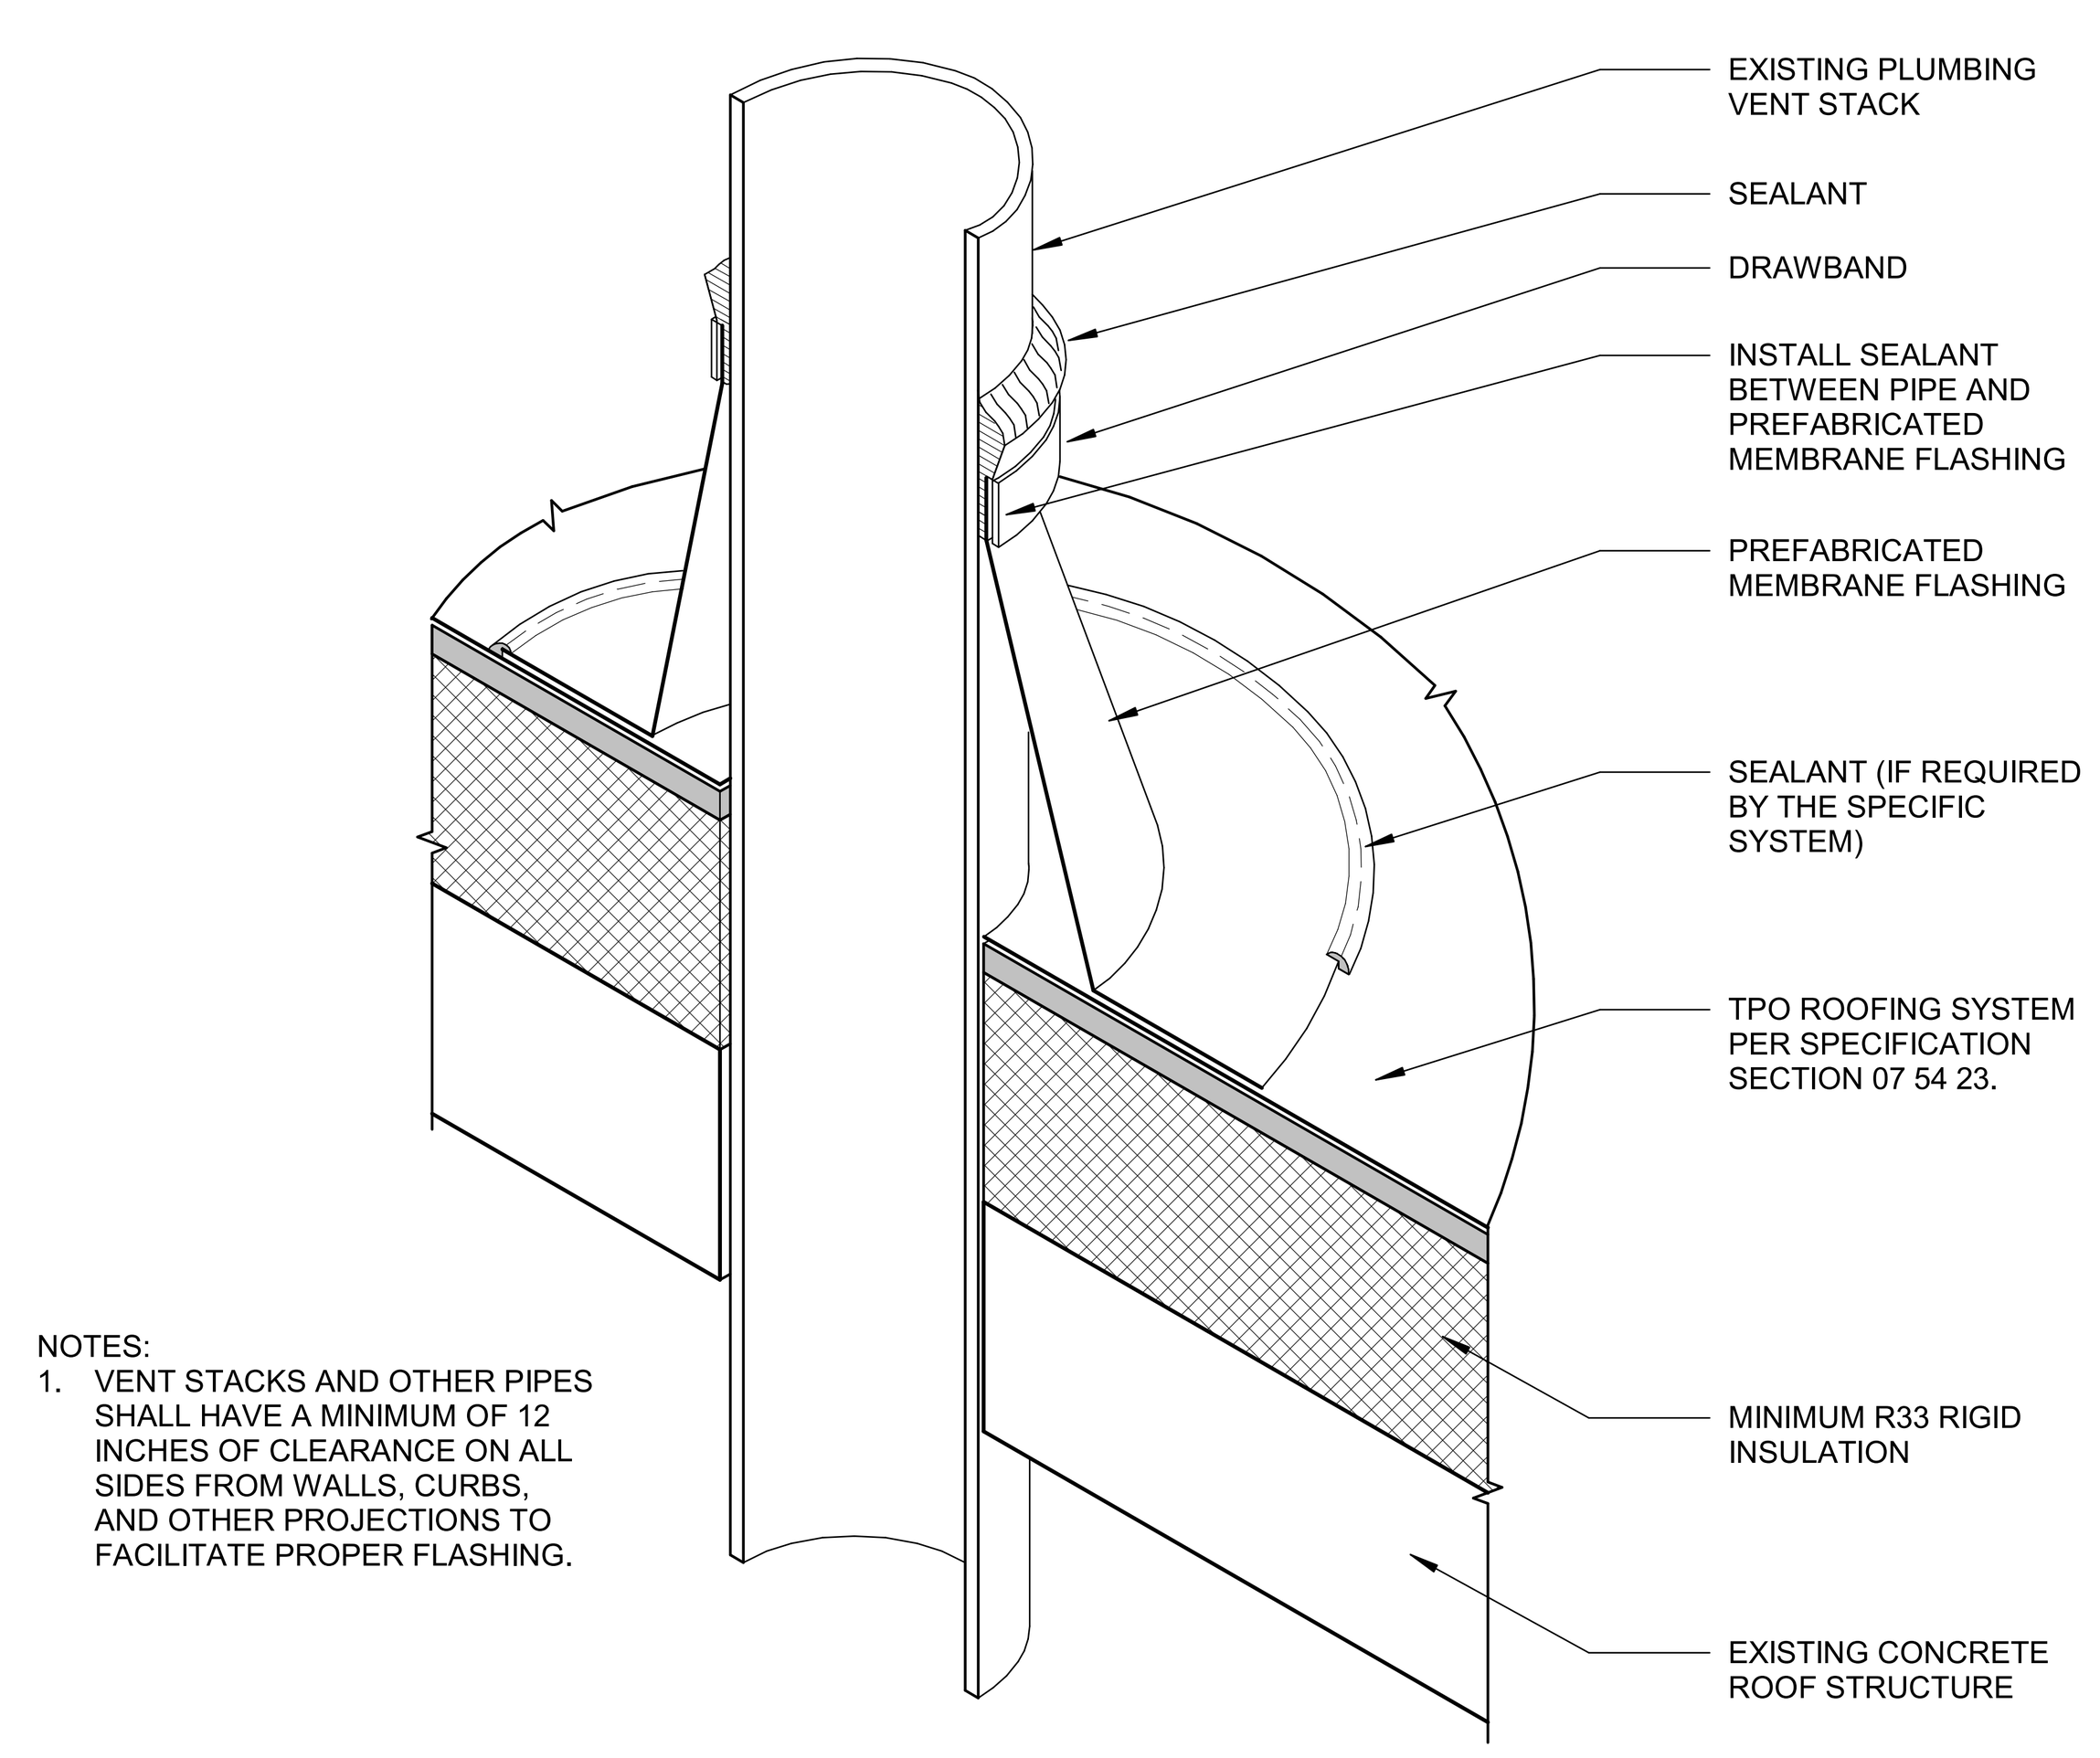

NOTES:
1. VENT STACKS AND OTHER PIPES SHALL HAVE A MINIMUM OF 12 INCHES OF CLEARANCE ON ALL SIDES FROM WALLS, CURBS, AND OTHER PROJECTIONS TO FACILITATE PROPER FLASHING.

5 **VENT THROUGH ROOF DETAIL**
Scale: 3" = 1'-0"

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

PROJECT MANAGER
ACG Project Number 23-069

APOGEE
Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	ROOF DETAILS
Project Title	REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
VA PROJECT NUMBER	619A4-24-102
Building Number	# 19, 20, 50, 51, AND 62
Location	CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM 2400 HOSPITAL ROAD TUSKEGEE, AL 36083
Approved	
Date	JUNE 19, 2024
Checked	WVS
Drawn	RF
Drawing Number	A-502
Dwg	13 of 14

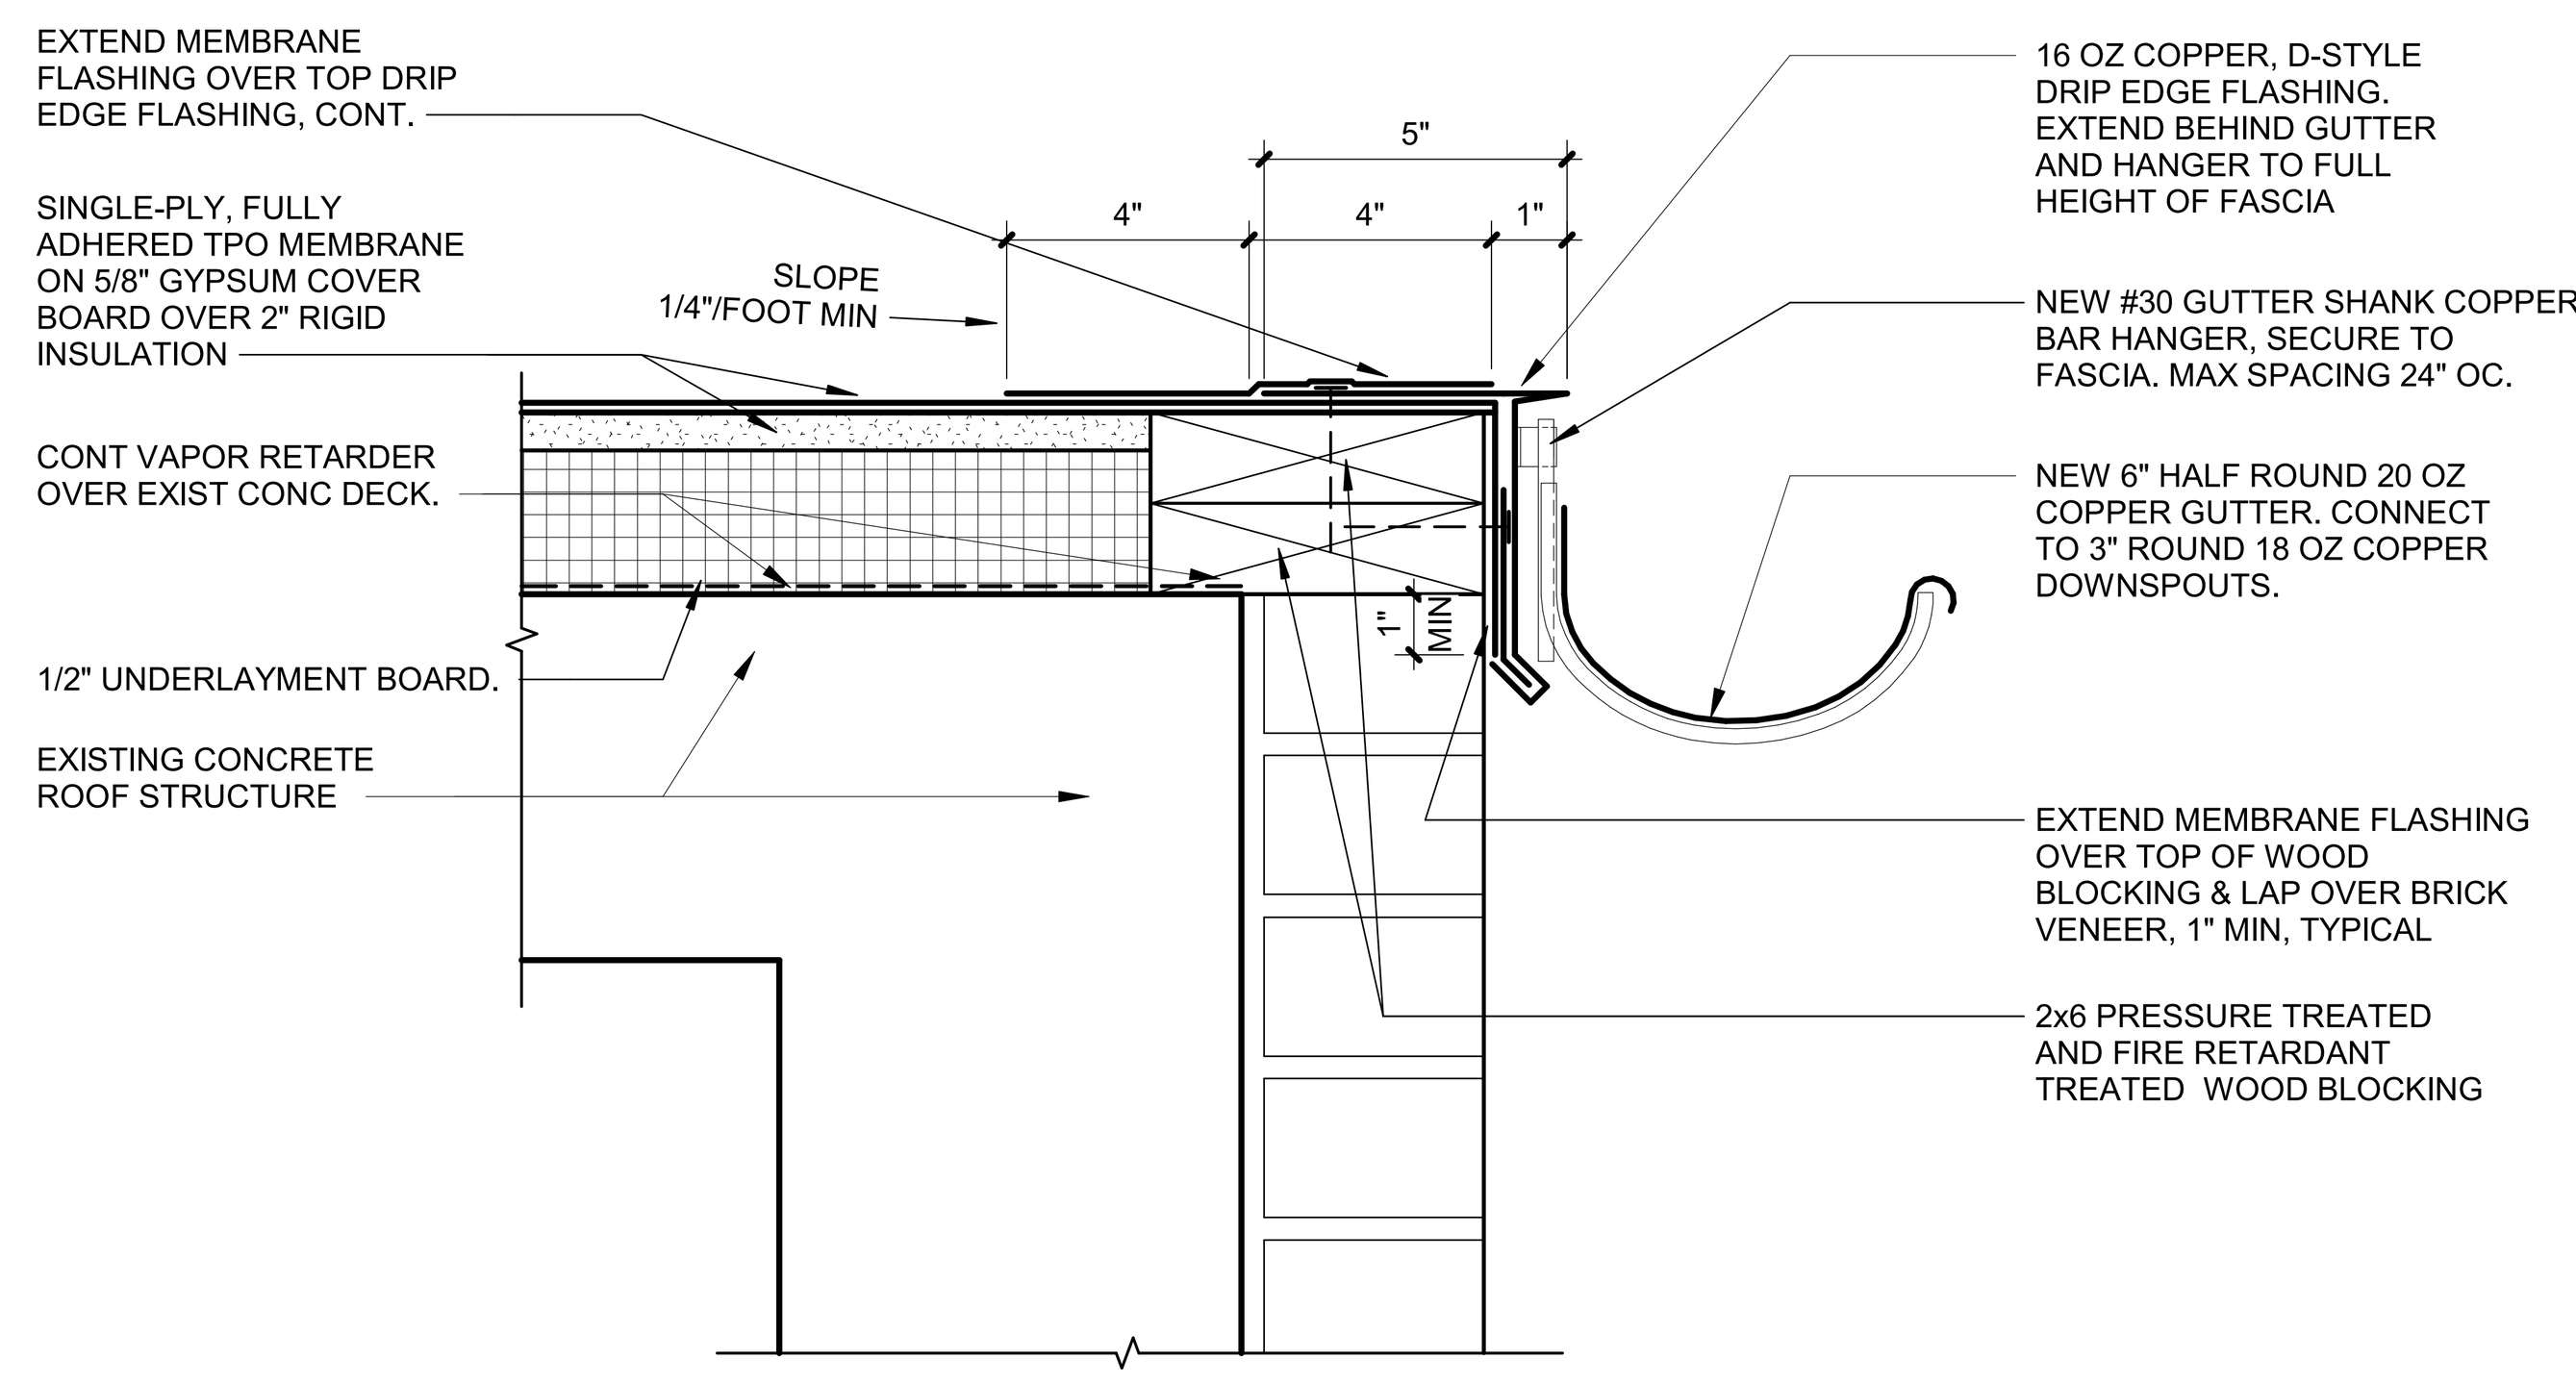

7 **LOW PROFILE ROOF EDGE DETAIL W/GUTTER**
Scale: 3" = 1'-0"
0 2" 4" 8"

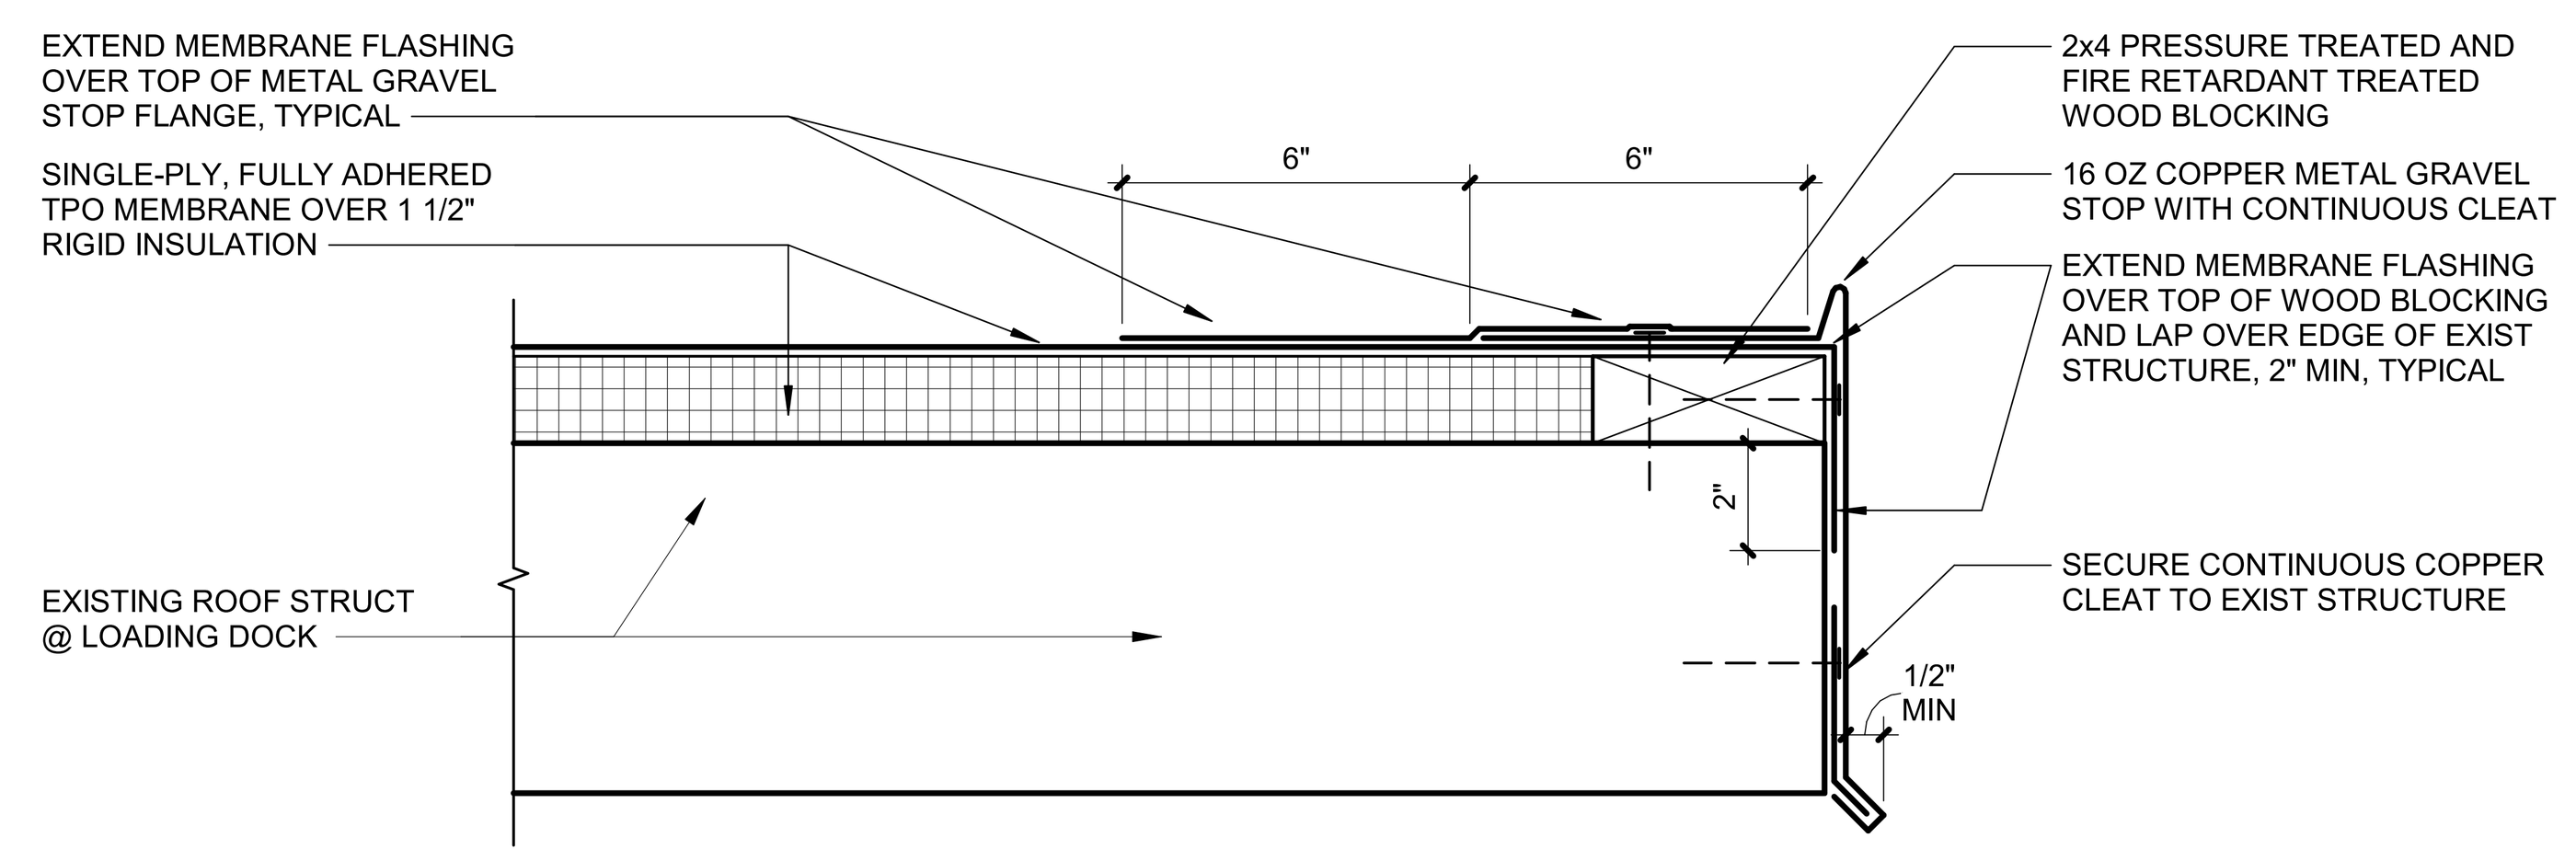

4 **LOW PROFILE ROOF @ LOADING DOCK**
Scale: 3" = 1'-0"
0 2" 4" 8"

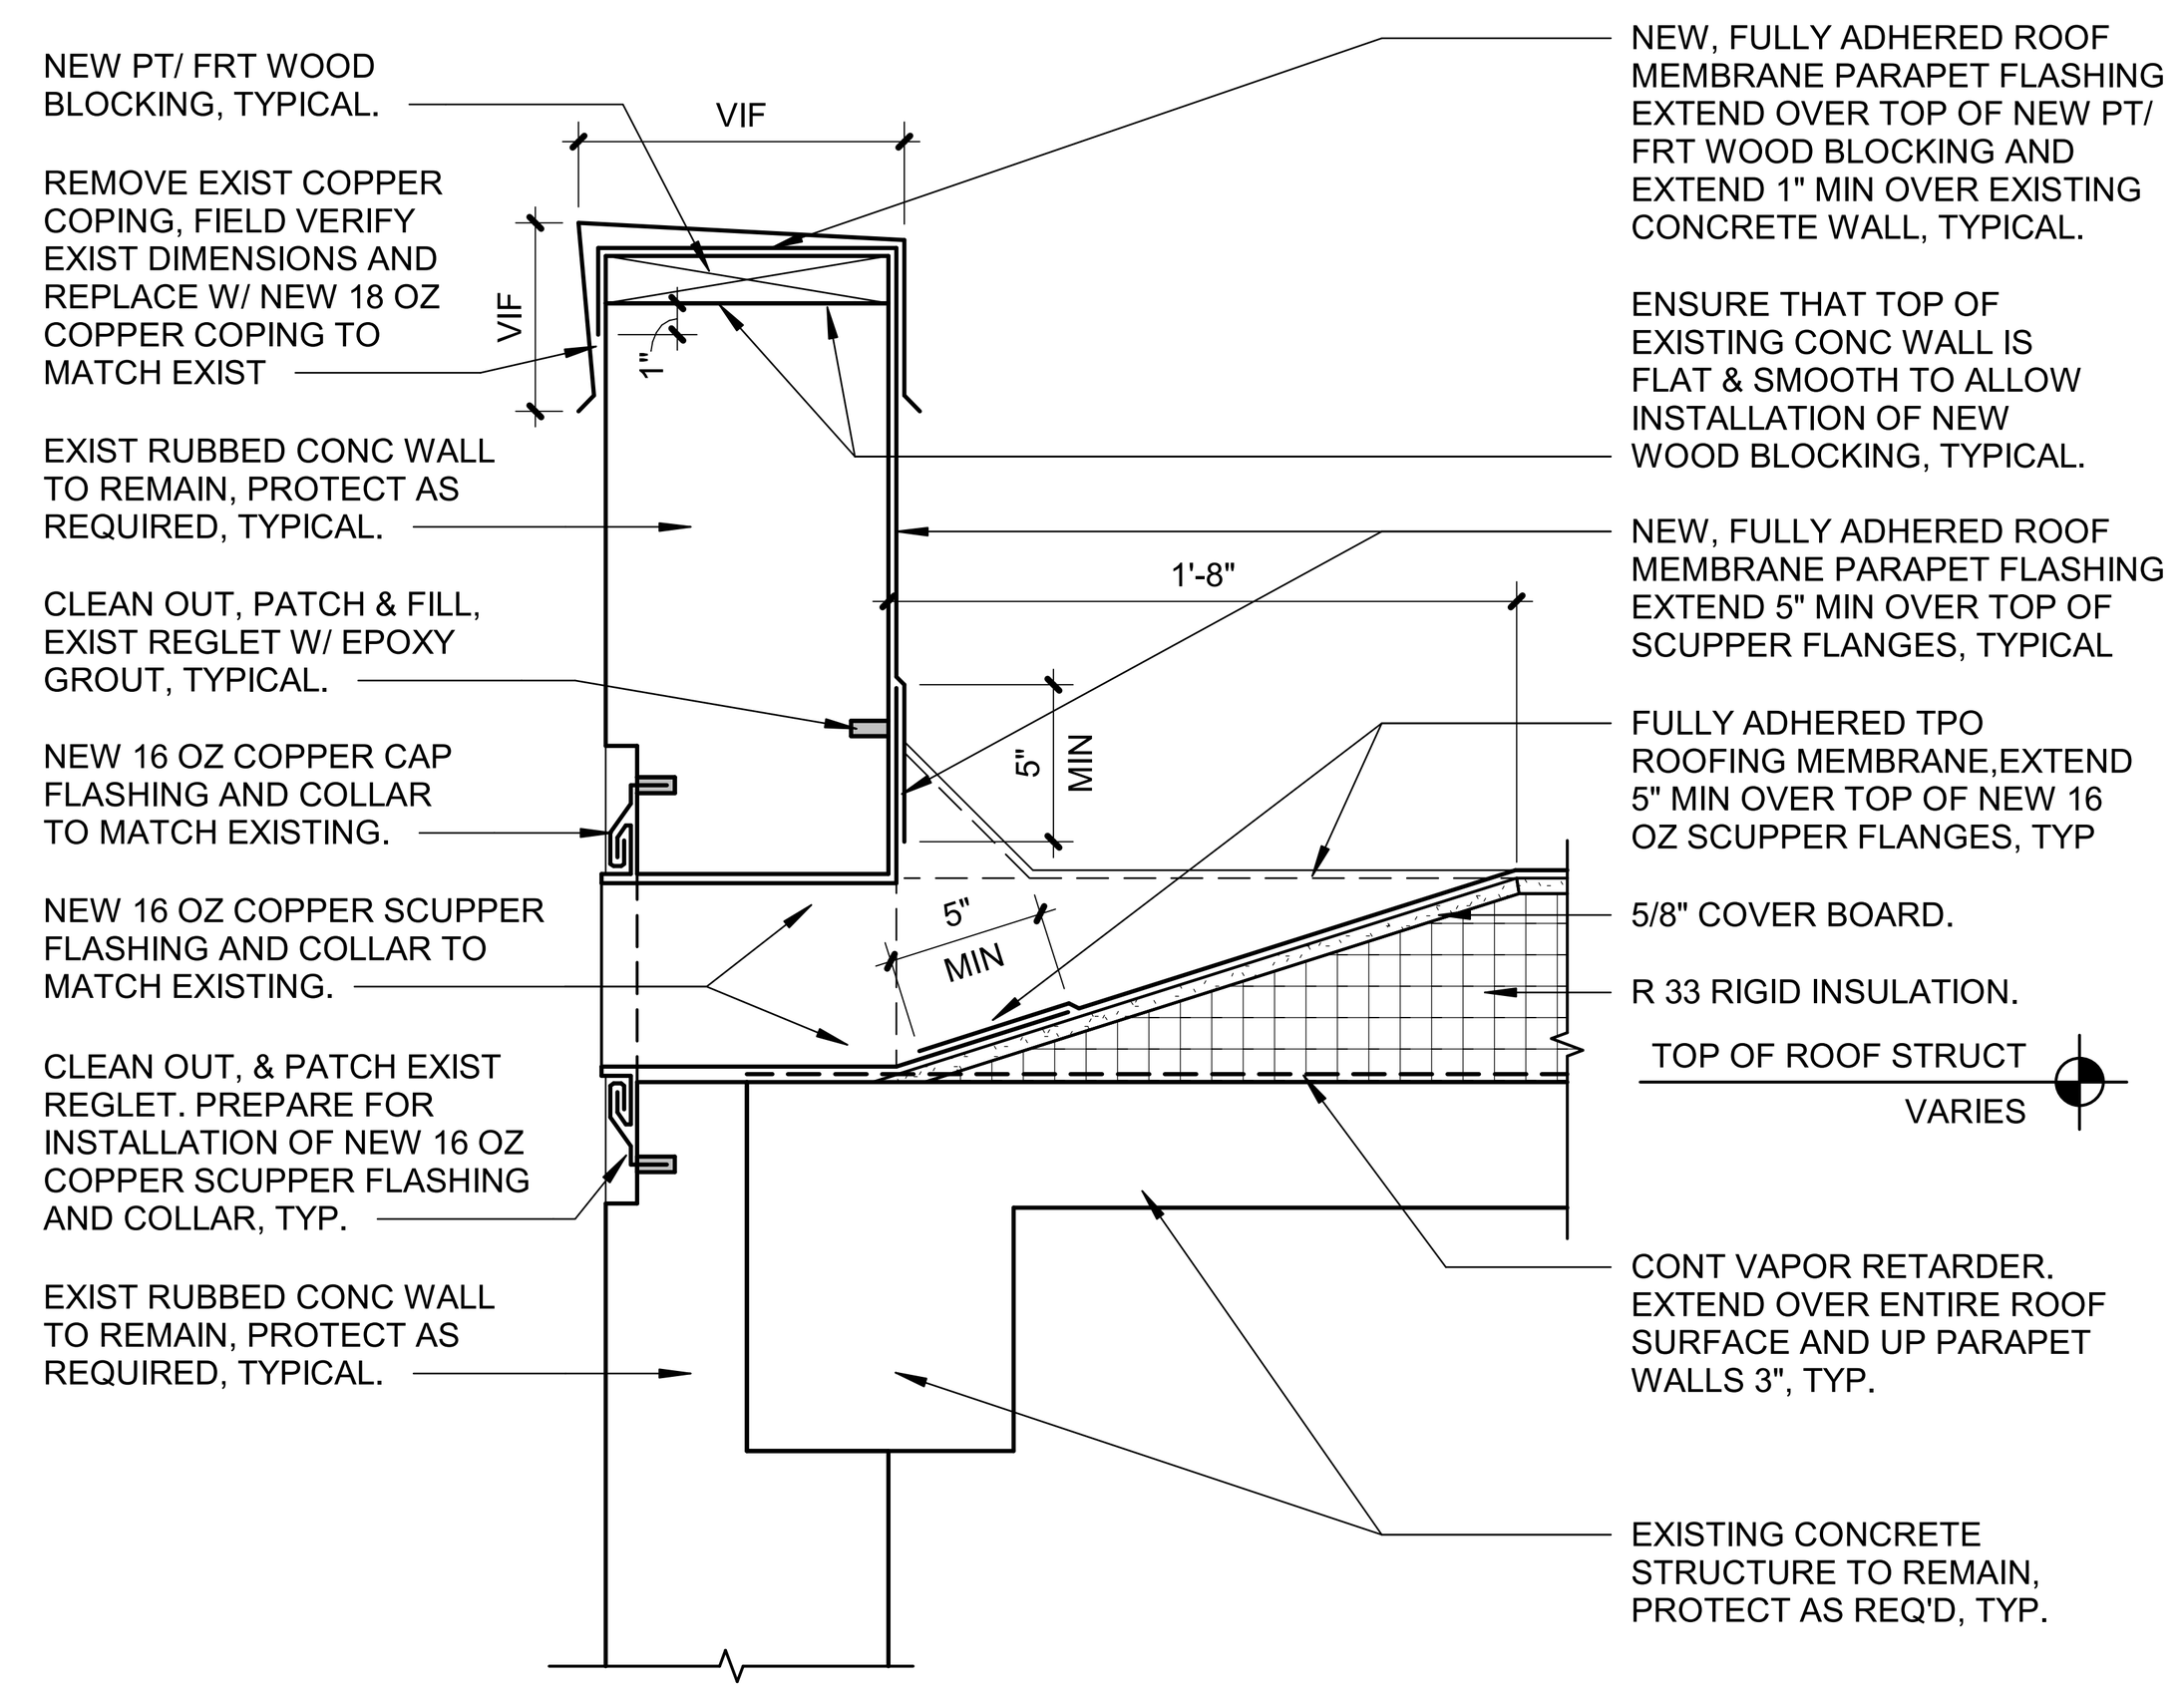

5 **PARAPET AND SCUPPER DETAIL NEXT TO LOADING DOCK**
Scale: 1 1/2" = 1'-0"
0 3" 6" 12"

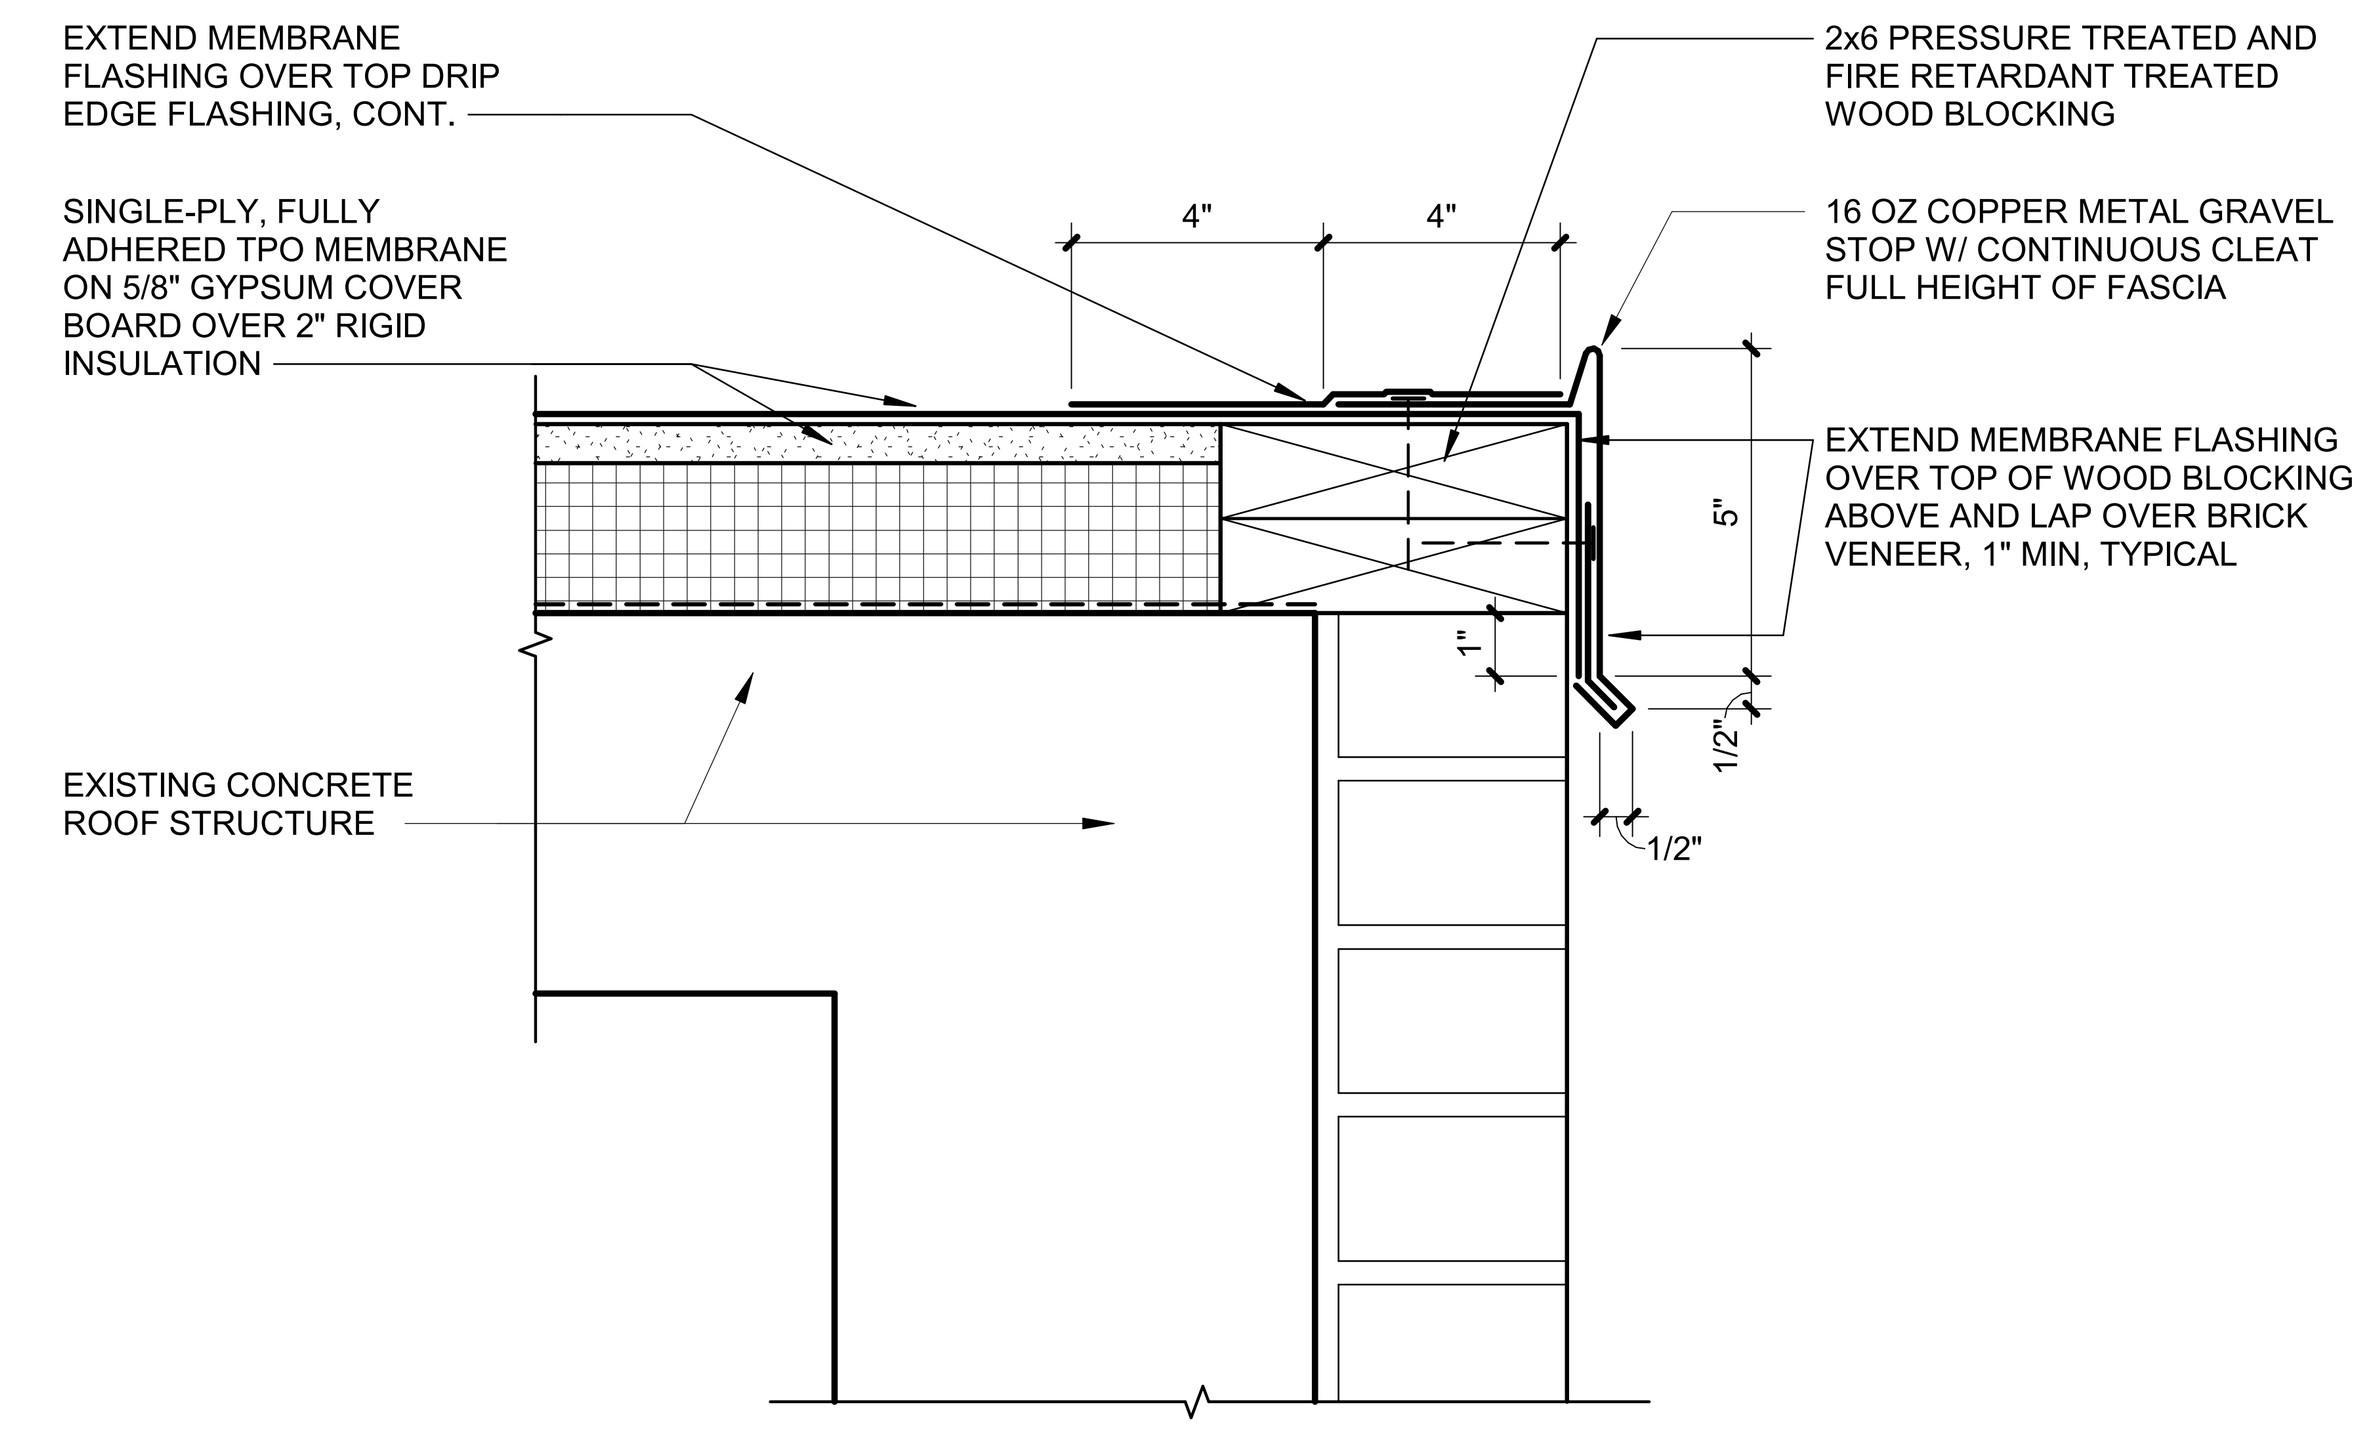

1 **LOW PROFILE ROOF EDGE DETAIL**
Scale: 3" = 1'-0"
0 2" 4" 8"

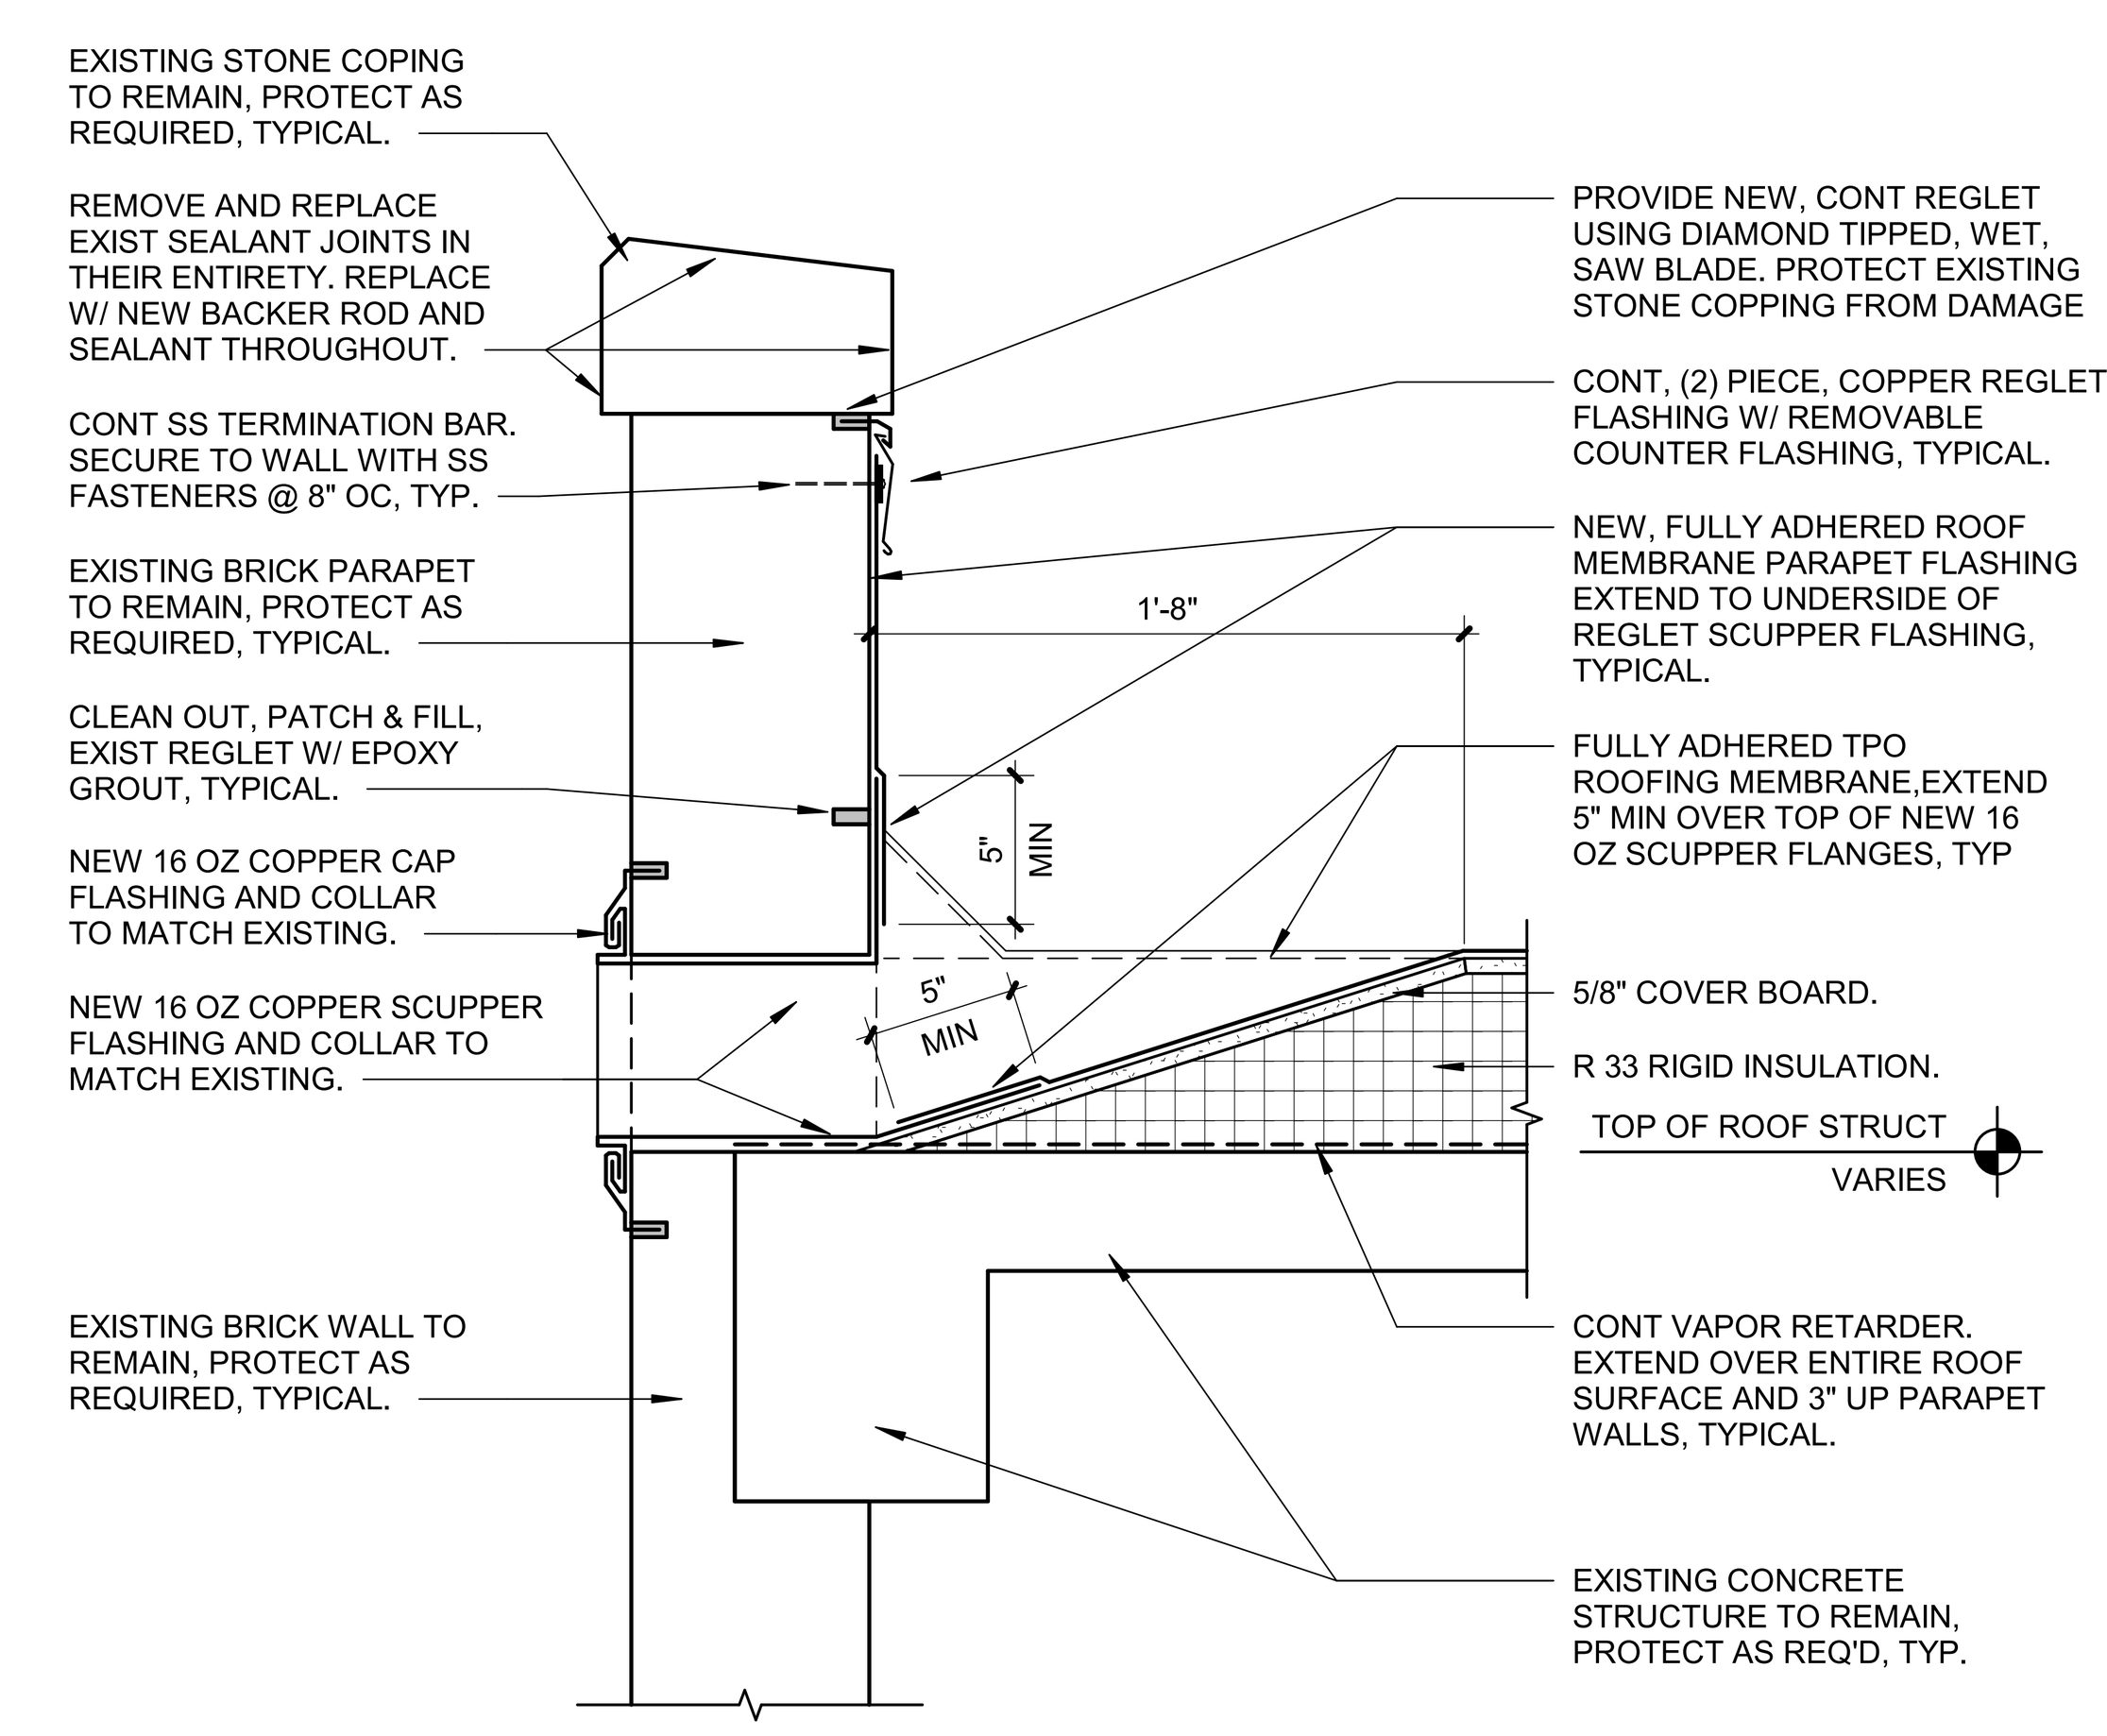

2 **PARAPET AND SCUPPER DETAIL**
Scale: 1 1/2" = 1'-0"
0 3" 6" 12"

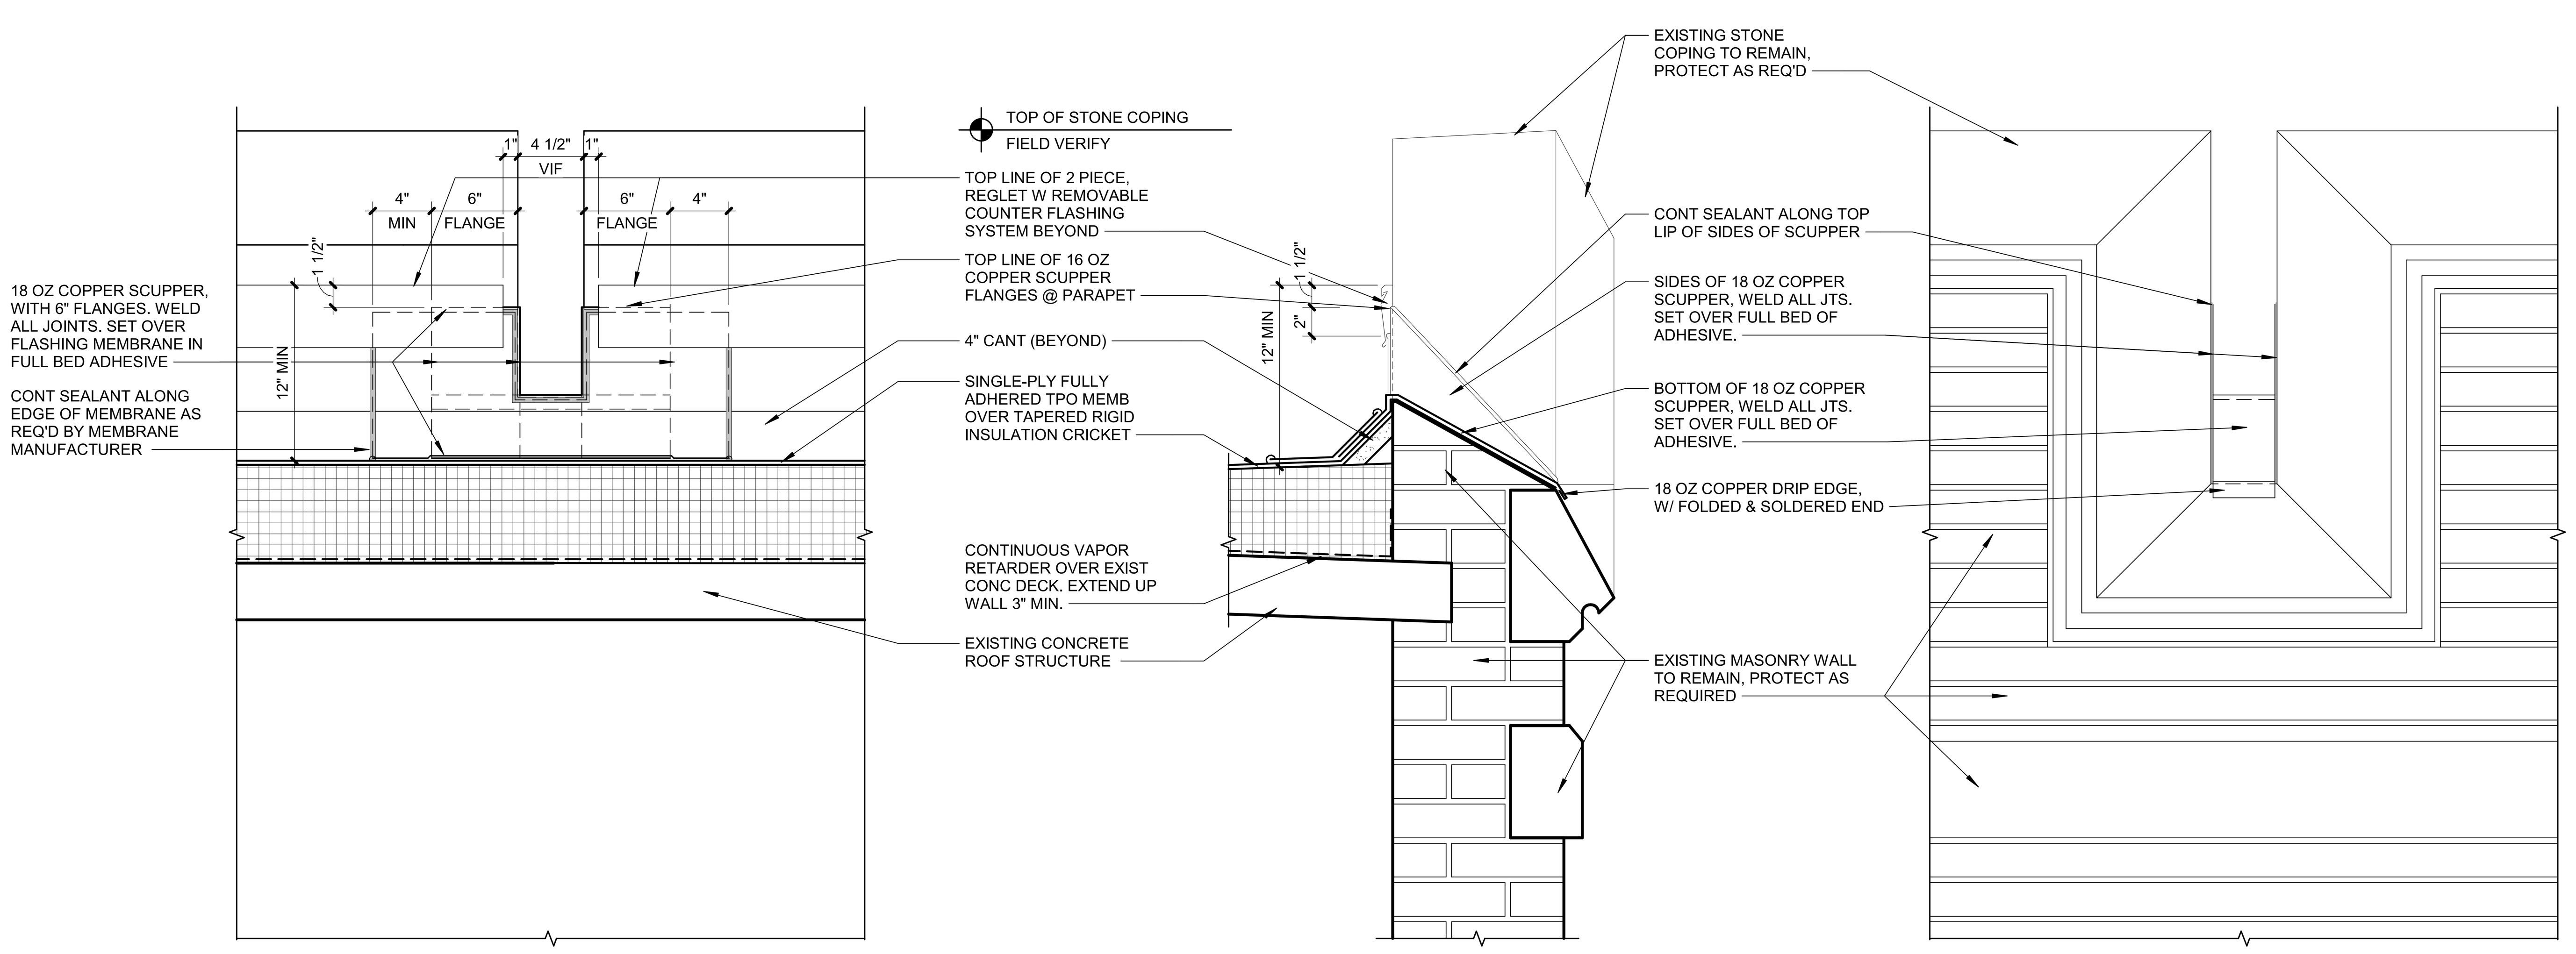

BACK OF PARAPET ELEVATION PARAPET SECTION FRONT OF PARAPET ELEVATION

6 **FLASHING DETAIL @ PARAPET ABOVE KITCHEN BLDG 51**
Scale: 1 1/2" = 1'-0"
0 3" 6" 12"

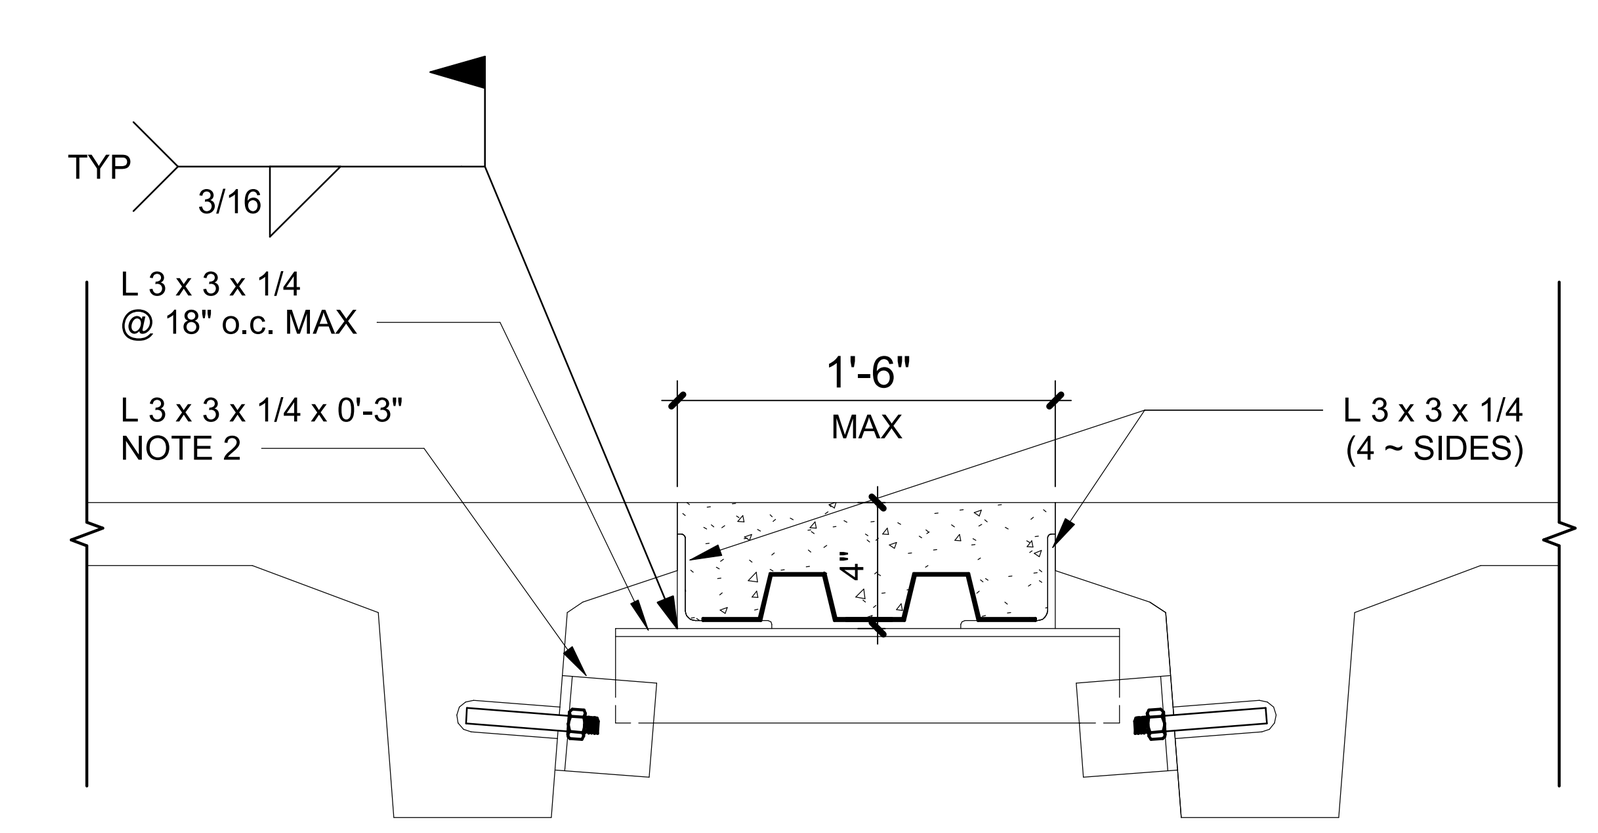

NOTES:
1. FLOOR CONSTRUCTION TO BE 2 1/2" NORMAL WEIGHT CONCRETE ON 1.5C20 (G60) FLOOR DECK (4" TOTAL SLAB THICKNESS. ATTACH TO SUPPORTS w/ 5/8" DIA PUDDLE WELDS (E60XX) @ 6" o.c.
2. ATTACH L3 TO STEM w/ ONE ~ 1/2" DIA HILTI HIT-V ROD USING HILTI HIT-HY200 ADHESIVE SYSTEM (MIN EMBED = 2").

3 **CONCRETE DECK PATCH DETAIL**
Scale: 1 1/2" = 1'-0"
0 3" 6" 12"

SHEET NOTES:

A. THE FINAL DETAILS SHALL BE SUBMITTED AS PART OF THE SHOP DRAWING SUBMITTAL PROCESS WITH THE ROOFING MANUFACTURER'S RECOMMENDED DETAILS.
B. CONTRACTOR TO REMOVE ALL ROOF DRAIN COVERS AND PROVIDE BLOW DOWN OF DRAIN PIPES TO ENSURE NO BLOCKAGE.
C. THE ROOF SYSTEM FOR BUILDINGS 19, 20, AS WELL AS THE PENTHOUSE ROOFS FOR BUILDINGS 50 AND 62, IS ASPHALT SHINGLE ROOFS PER SPECIFICATION SECTION 07 31 13.
D. THE ROOF MEMBRANE SYSTEM FOR BUILDINGS 50, 51 AND 62, IS A TPO ROOFING SYSTEM PER SPECIFICATION SECTION 07 54 23.
E. CONTRACTOR TO INSTALL INSULATION PER SPECIFICATION SECTION 07 22 00, AND ROOF MANUFACTURER APPROVED SUBMITTALS. R-30 RIGID INSULATION SHOWN ON DETAILS IS THE MINIMUM INSULATION REQUIRED.

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

APOGEE CONSULTING GROUP, P.A. 52644 RALEIGH, NC

WALTER DAVID VAN SCOTER REG. NO. 9853 STATE OF LOUISIANA REGISTERED ARCHITECT 6/21/2024

PROJECT MANAGER
ACG Project Number 23-069

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	ROOF DETAILS
Location	CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM 2400 HOSPITAL ROAD TUSKEGEE, AL 36083
Project Title	REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
Approved	
Date	JUNE 19, 2024
Checked	WVS
Drawn	RF
VA PROJECT NUMBER	619A4-24-102
Building Number	#
Drawing Number	A-503
Dwg	14 of 14

LIGHTNING PROTECTION CLASS 1 MATERIAL REQUIREMENTS

TYPE OF CONDUCTOR		COPPER STANDARD	COPPER METRIC
AIR TERMINAL, SOLID	MIN. DIAMETER	3/8 IN.	9.5 MM
AIR TERMINAL, TUBULAR	MIN. DIAMETER	5/8 IN.	15.9 MM
	MIN. WALL THICKNESS	0.033 IN.	0.8 MM
MAIN CONDUCTOR, CABLE	MIN. SIZE EA. STRAND	17 AWG	
	WGT. PER LENGTH	187 LB/1000 FT.	84.8 KG/304.8 M
	CROSS SECT. AREA	57,400 CM	29MM²
MAIN CONDUCTOR, SOLID STRIP	THICKNESS	0.051 IN.	1.3 MM
	WIDTH	1 IN.	25.4 MM
BONDING CONDUCTOR, CABLE (SOLID OR STRANDED)	MIN. SIZE EA. STRAND	17 AWG	
	CROSS SECT. AREA	26,240 CM	13.9 MM²
BONDING CONDUCTOR, SOLID STRIP	THICKNESS	0.051 IN.	1.3 MM
	WIDTH	1/2 IN.	12.7 MM

LIGHTNING PROTECTION SYMBOL LEGEND

SYMBOL	DESCRIPTION
	LIGHTNING PROTECTION AIR TERMINAL
	LIGHTNING PROTECTION CONDUCTOR
	LIGHTNING PROTECTION GROUND ROD
	LIGHTNING PROTECTION DOWN CONDUCTOR
	"T" CONNECTION OF CONDUCTORS
	BOND LIGHTNING PROTECTION TO METAL BODY

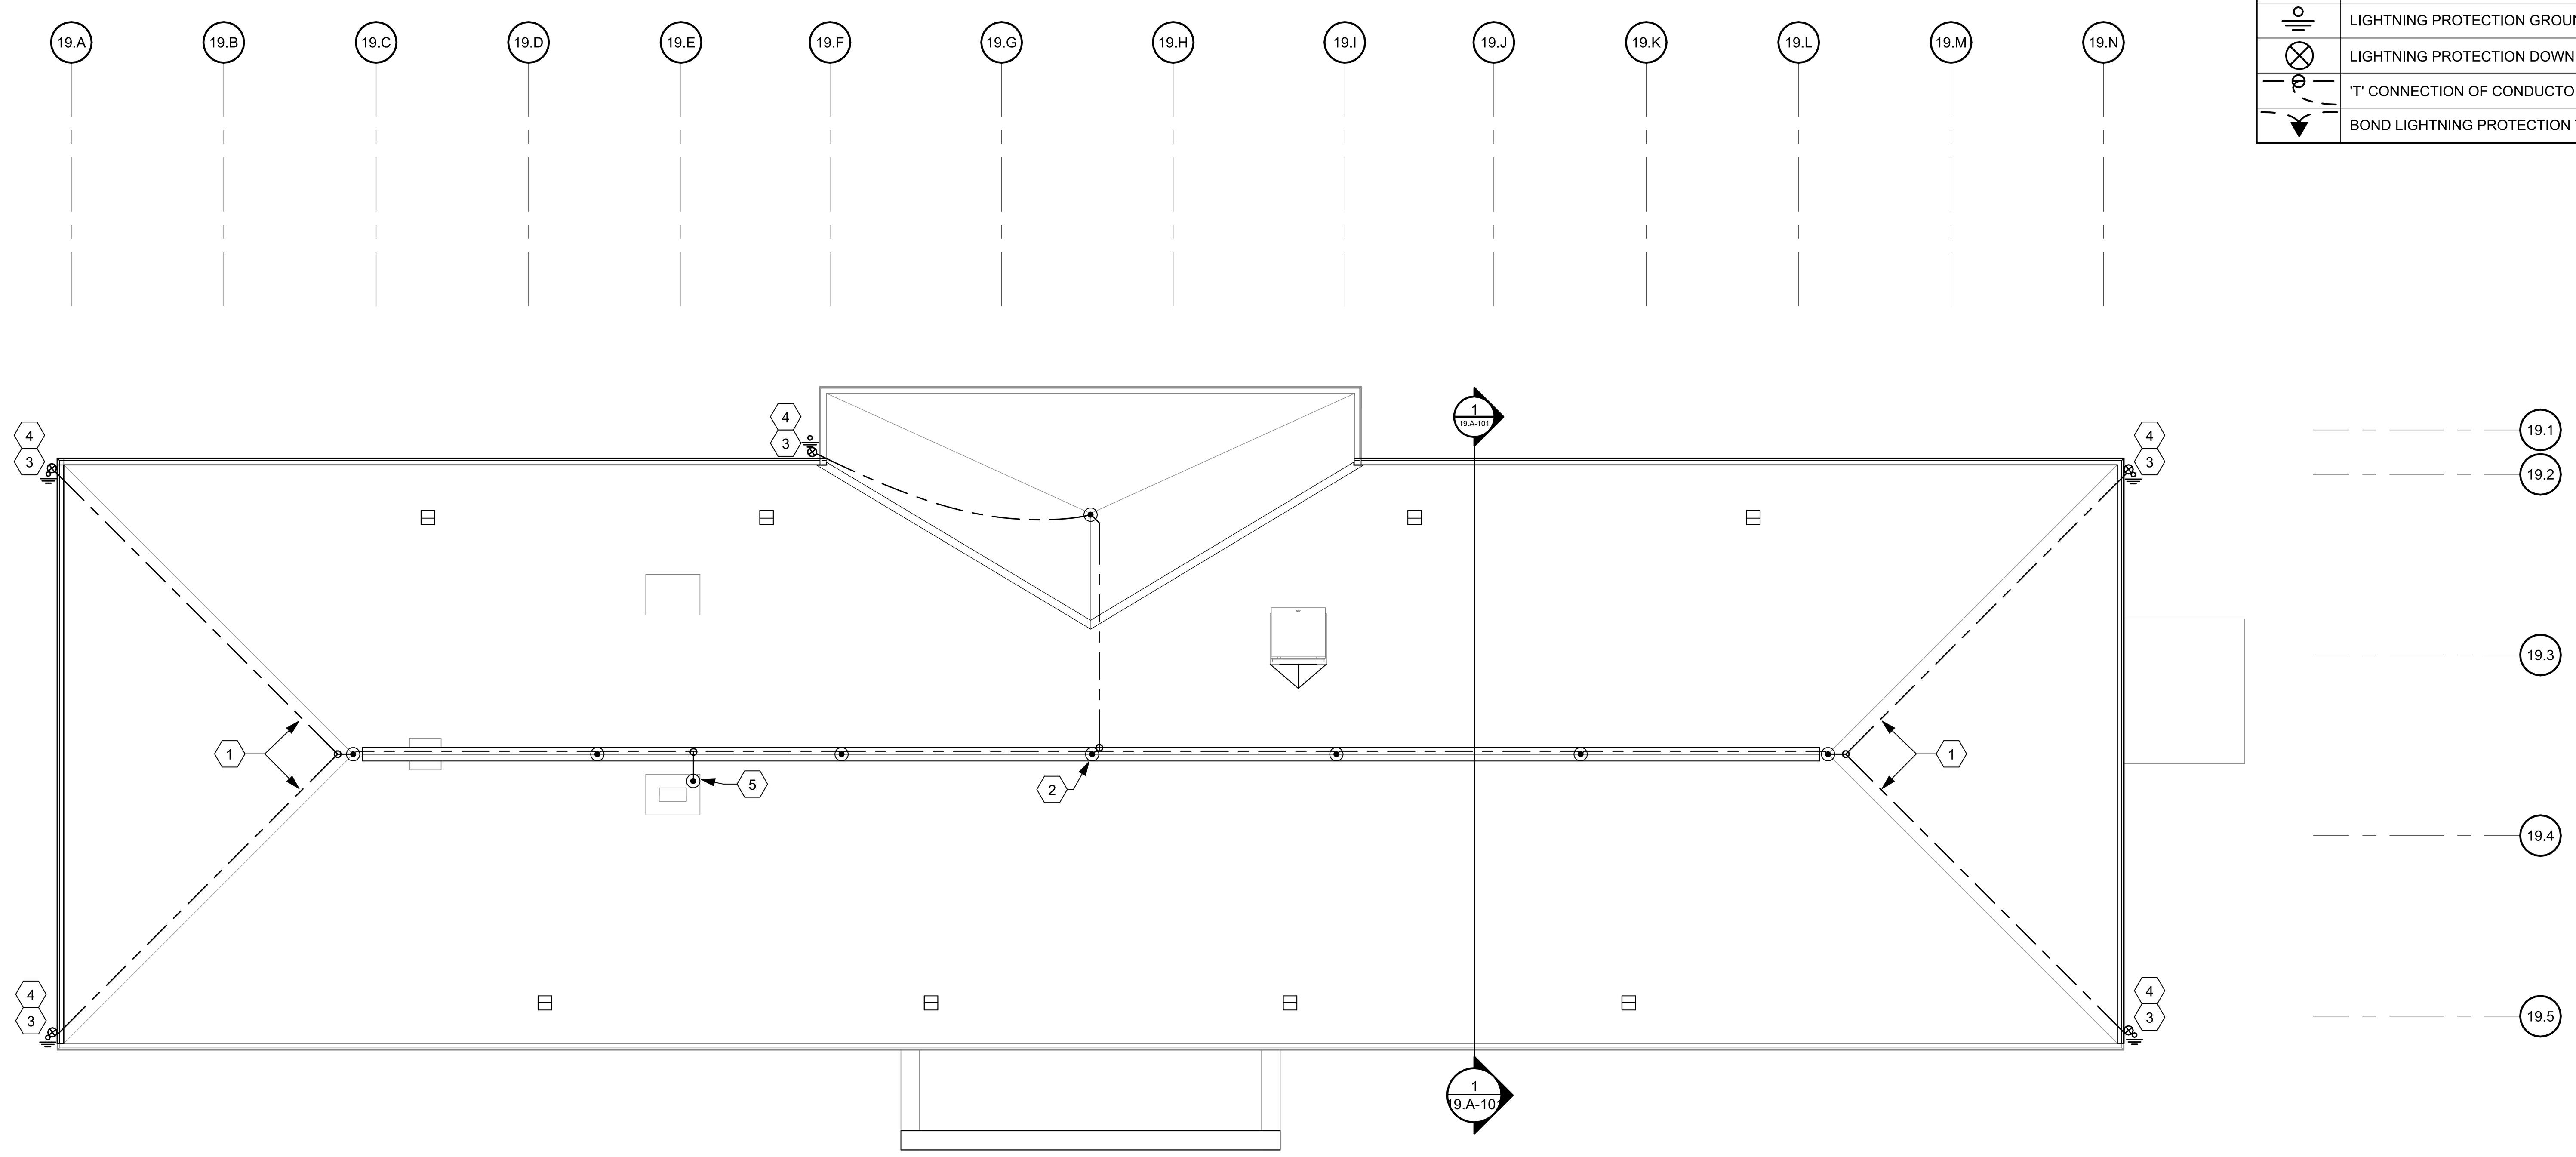

1 **BUILDING 19 ROOF LIGHTNING PROTECTION PLAN**
Scale: 1/8" = 1'-0"

0 4 8 16 NORTH

SHEET NOTES:

A. FIELD VERIFY PROTECTION REQUIREMENTS AND COMMUNICATE ANY DISCREPENCIES AND/OR DEFICIENCIES WITH THE COR PRIOR TO INSTALLATION.

B. LIGHTNING PROTECTION SYSTEM TO BE INSTALLED BY A CERTIFIED LIGHTNING PROTECTION INSTALLER.

C. ACTUAL JOB SITE CONDITIONS MAY NECESSITATE SLIGHT ALTERATIONS OF AIR TERMINAL AND GROUND LOCATIONS. ANY ALTERATIONS SHALL BE APPROVED BY THE COR PRIOR TO THEIR EXECUTION.

D. AIR TERMINALS SHALL BE PLACED AROUND THE ROOF PERIMETER OR RIDGE AT 20'-0" MAXIMUM INTERVALS FOR 10" TO 24" AIR TERMINALS AND EXTEND A MINIMUM OF 10" ABOVE THE OBJECT OR AREA IT IS TO PROTECT.

E. AIR TERMINALS SHALL BE PLACED WITHIN 24" FROM THE OUTSIDE EDGES OF THE OBJECT TO BE PROTECTED.

F. MID-ROOF AIR TERMINALS ON FLAT OR GENTLY SLOPING ROOFS SHALL BE INSTALLED AT A MAXIMUM 50'-0" INTERVALS.

G. ALL ROOF PROJECTIONS AND/OR OBJECTS THAT ARE SUBJECT TO A DIRECT LIGHTNING STRIKE SHALL BE PROVIDED WITH AIR TERMINALS UNLESS THEY ARE LOCATED WITHIN A ZONE OF PROTECTION.

H. METAL BODIES SITUATED WITHIN 6'-0" OF A LIGHTNING PROTECTION CONDUCTOR SHALL BE BONDED TO THE LIGHTNING PROTECTION SYSTEM.

I. AIR TERMINALS AND CONDUCTOR MOUNTS ARE TO BE MOUNTED TO THE PARAPET WALL USING ADHESIVE MOUNTS OR ANOTHER UL APPROVED METHOD THAT PREVENTS SPALLING AND CRACKING OF THE EXISTING CONCRETE.

KEY NOTES:

1 CLASS 1 LIGHTNING PROTECTION CONDUCTORS FASTENED EVERY 3'-0" OC. ROUTING OF CONDUCTORS IS TO BE IN ACCORDANCE WITH NFPA 780, APPROVED CONDUCTOR BEND RADIUS REQUIREMENTS, AND STANDARD BUILDING PRACTICE.
2 AIR TERMINALS ARE TO BE MOUNTED ALONG THE RIDGELINE OF THE ROOF USING THRU-ROOF HARDWARE PROPERLY SEALED TO PREVENT INGRESS OF ELEMENTS OR THE PREMATURE FAILURE OF ROOF.
3 PROVIDE DOWN CONDUCTOR ALONG EXTERIOR FACADE OF BUILDING AND CONNECT TO NEW PROVIDED GROUND ROD. DOWN CONDUCTORS SHALL BE FASTENED TO BUILDING FAÇADE WITH FASTENERS DESIGNED FOR BUILDING'S EXTERIOR MATERIAL.
4 DOWN CONDUCTOR TO BE PROTECTED TO A HEIGHT OF 6' FROM GRADE WITH RIGID SCHEDULE 80 PVC ATTACHED TO BUILDING.
5 PROVIDE LIGHTNING PROTECTION AIR TERMINAL MOUNTED TO UPPERMOST OUTSIDE FACADE OF CHIMNEY STACK. MOUNT AIR TERMINAL USING UL LISTED ADHESIVE MOUNTING SOLUTION.

KEY PLAN

SCALE: NO SCALE
AREA OF WORK

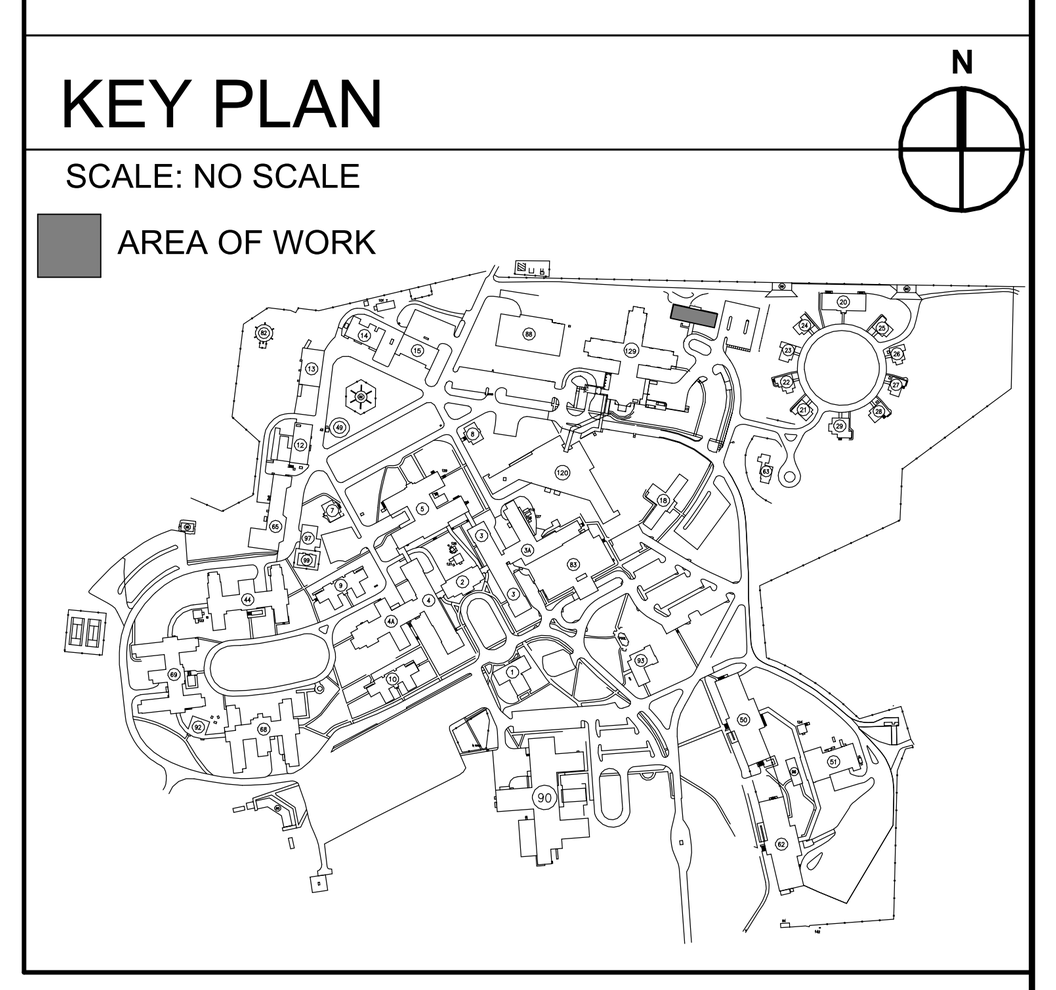

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

ALABAMA LICENSED No. 39881-E PROFESSIONAL ENGINEER KEVIN TODD KUBLI 6/21/2024

PROJECT MANAGER
ACG Project Number 23-069

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 19 ROOF LIGHTNING PROTECTION PLAN
Location: CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM, 2400 HOSPITAL ROAD, TUSKEGEE, AL 36083
Project Title: REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
Approved:
Date: JUNE 19, 2024 | Checked: KTK | Drawn: WSR
VA PROJECT NUMBER: 619A4-24-102
Building Number: # 19
Drawing Number: 19.E-101
Dwg 1 of 6

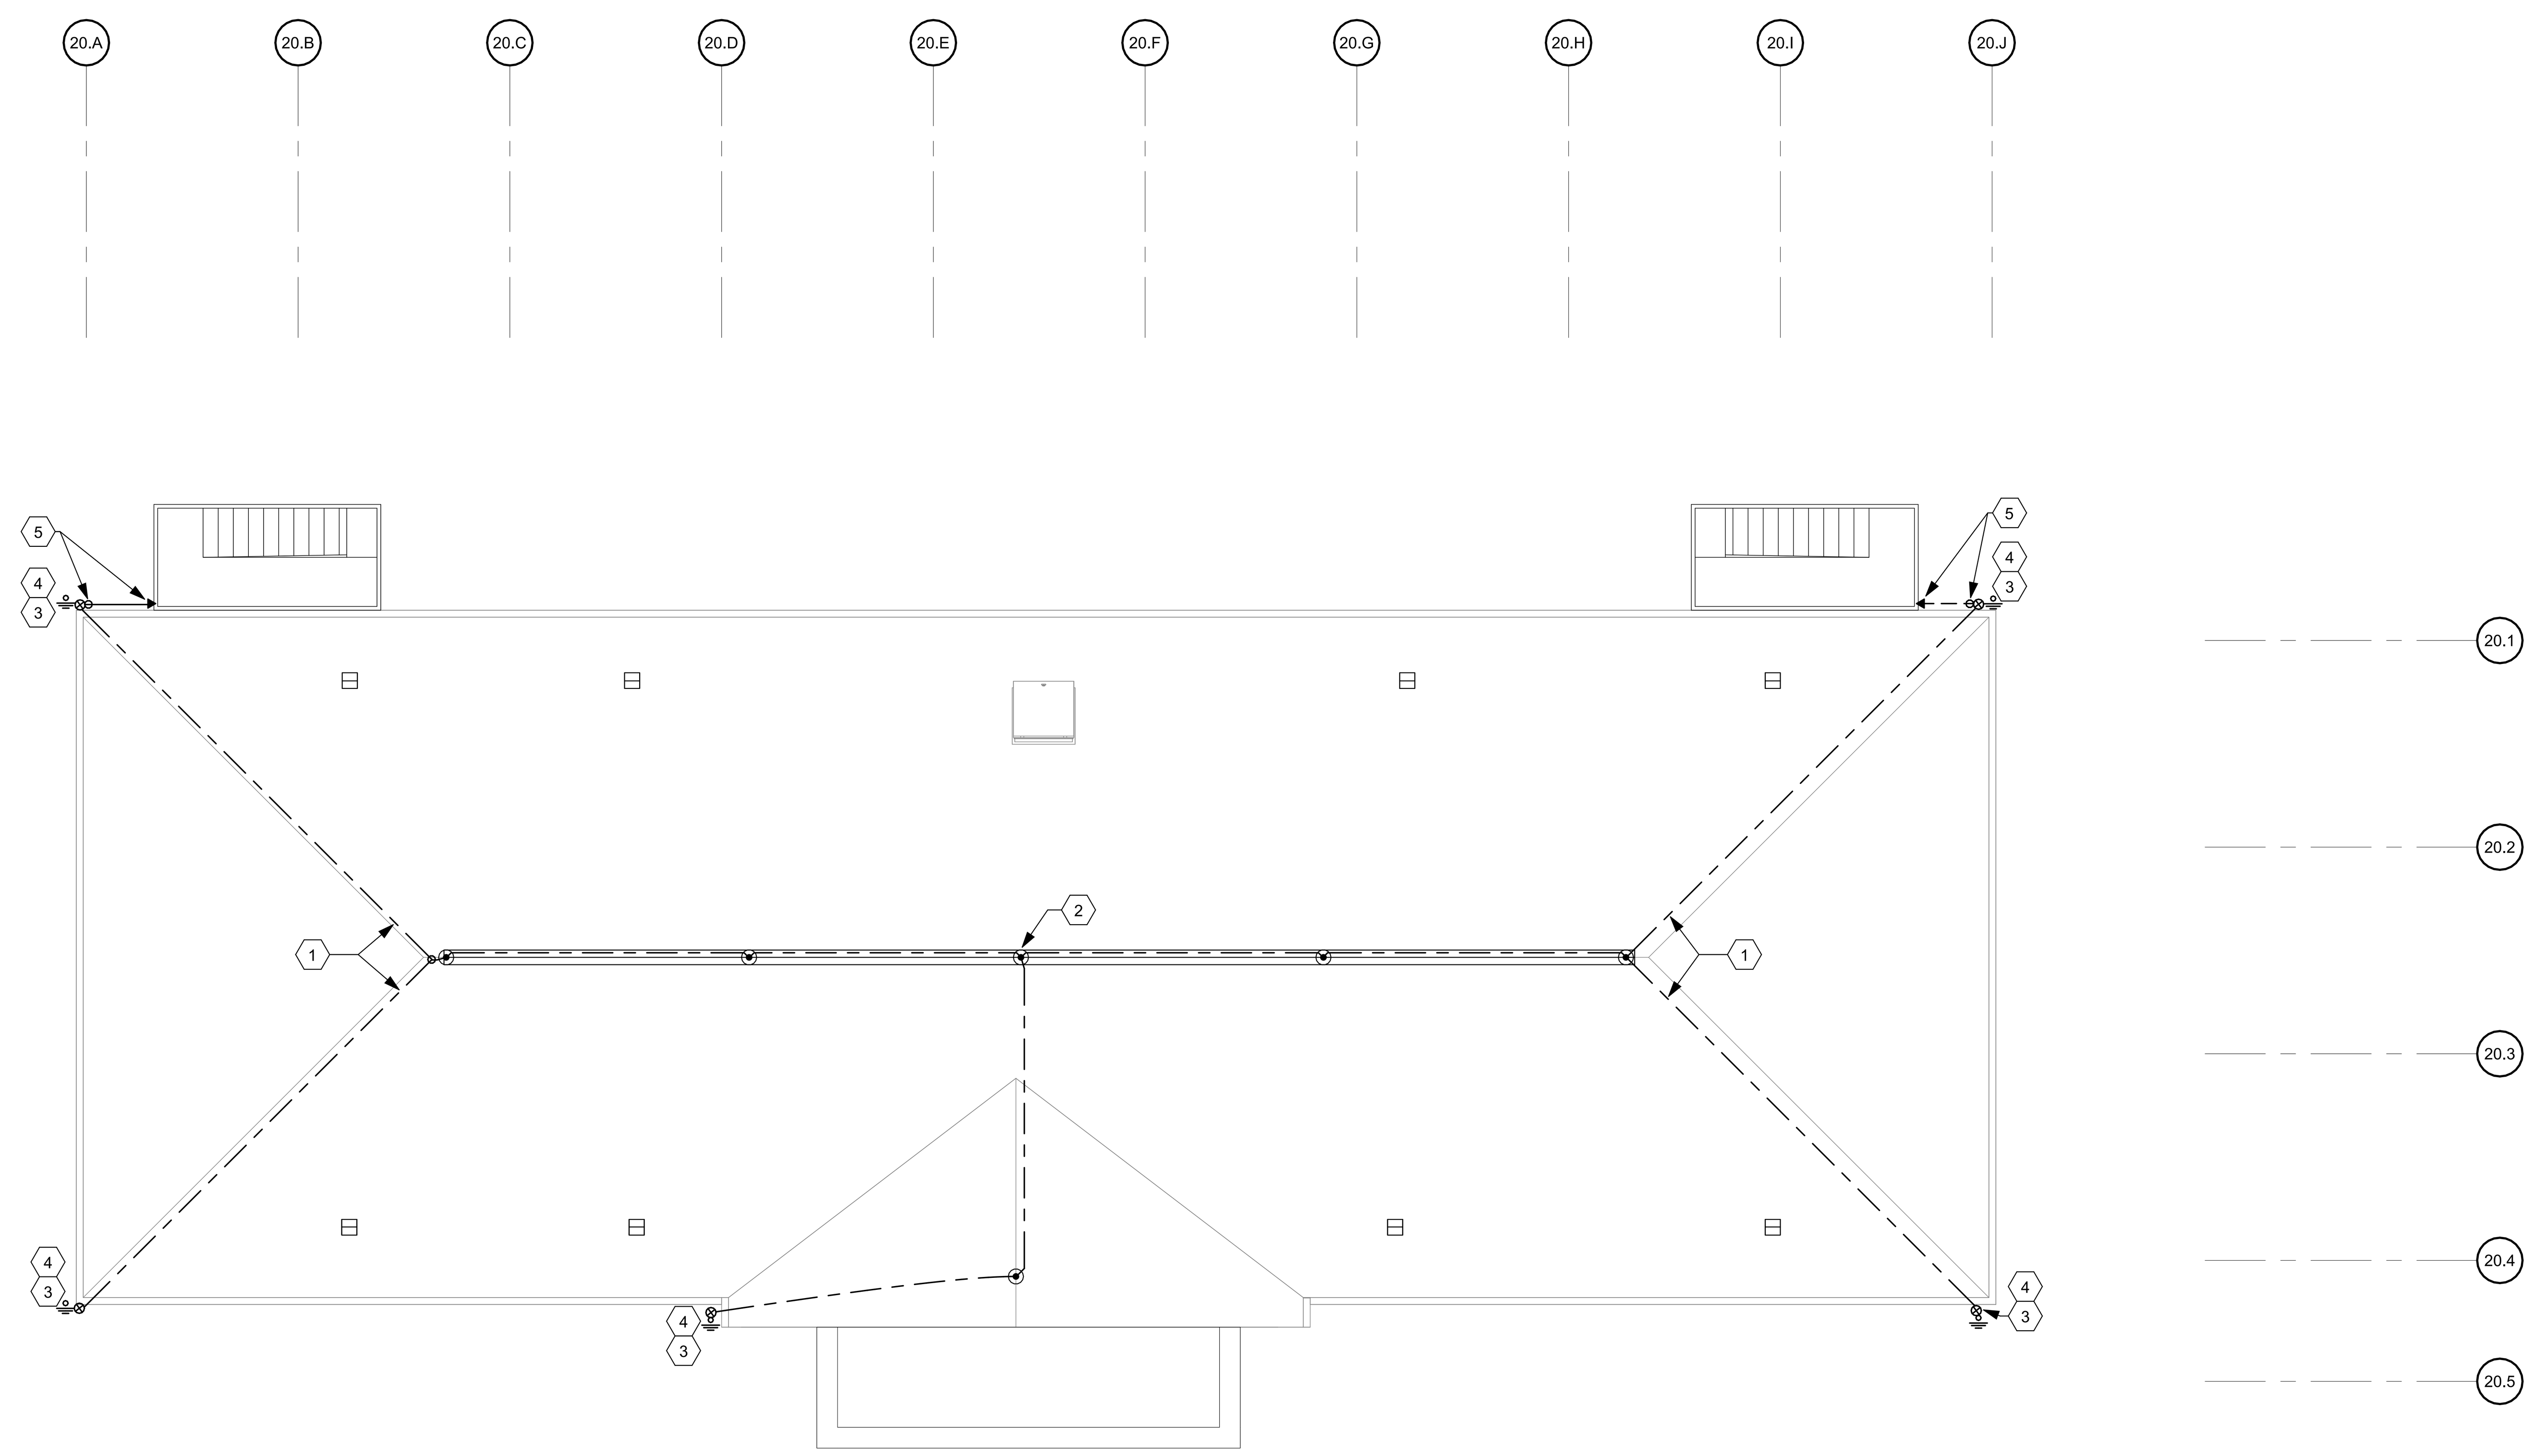

1 BUILDING 20 ROOF LIGHTNING PROTECTION PLAN

Scale: 1/8" = 1'-0"



SHEET NOTES:

A. FIELD VERIFY PROTECTION REQUIREMENTS AND COMMUNICATE ANY DISCREPENCIES AND/OR DEFICIENCIES WITH THE COR PRIOR TO INSTALLATION.

B. LIGHTNING PROTECTION SYSTEM TO BE INSTALLED BY A CERTIFIED LIGHTNING PROTECTION INSTALLER.

C. ACTUAL JOB SITE CONDITIONS MAY NECESSITATE SLIGHT ALTERATIONS OF AIR TERMINAL AND GROUND LOCATIONS. ANY ALTERATIONS SHALL BE APPROVED BY THE COR PRIOR TO THEIR EXECUTION.

D. AIR TERMINALS SHALL BE PLACED AROUND THE ROOF PERIMETER OR RIDGE AT 20'-0" MAXIMUM INTERVALS FOR 10" TO 24" AIR TERMINALS AND EXTEND A MINIMUM OF 10" ABOVE THE OBJECT OR AREA IT IS TO PROTECT.

E. AIR TERMINALS SHALL BE PLACED WITHIN 24" FROM THE OUTSIDE EDGES OF THE OBJECT TO BE PROTECTED.

F. MID-ROOF AIR TERMINALS ON FLAT OR GENTLY SLOPING ROOFS SHALL BE INSTALLED AT A MAXIMUM 50'-0" INTERVALS.

G. ALL ROOF PROJECTIONS AND/OR OBJECTS THAT ARE SUBJECT TO A DIRECT LIGHTNING STRIKE SHALL BE PROVIDED WITH AIR TERMINALS UNLESS THEY ARE LOCATED WITHIN A ZONE OF PROTECTION.

H. METAL BODIES SITUATED WITHIN 6'-0" OF A LIGHTNING PROTECTION CONDUCTOR SHALL BE BONDED TO THE LIGHTNING PROTECTION SYSTEM.

I. AIR TERMINALS AND CONDUCTOR MOUNTS ARE TO BE MOUNTED TO THE PARAPET WALL USING ADHESIVE MOUNTS OR ANOTHER UL APPROVED METHOD THAT PREVENTS SPALLING AND CRACKING OF THE EXISTING CONCRETE.

KEY NOTES:

1 CLASS 1 LIGHTNING PROTECTION CONDUCTORS FASTENED EVERY 3'-0" OC. ROUTING OF CONDUCTORS IS TO BE IN ACCORDANCE WITH NFPA 780, APPROVED CONDUCTOR BEND RADIUS REQUIREMENTS, AND STANDARD BUILDING PRACTICE.

2 AIR TERMINALS ARE TO BE MOUNTED ALONG THE RIDGELINE OF THE ROOF USING THRU-ROOF HARDWARE PROPERLY SEALED TO PREVENT INGRESS OF ELEMENTS OR THE PREMATURE FAILURE OF ROOF.

3 PROVIDE DOWN CONDUCTOR ALONG EXTERIOR FACADE OF BUILDING AND CONNECT TO NEW PROVIDED GROUND ROD. DOWN CONDUCTORS SHALL BE FASTENED TO BUILDING FAÇADE WITH FASTENERS DESIGNED FOR BUILDING’S EXTERIOR MATERIAL.

4 DOWN CONDUCTOR TO BE PROTECTED TO A HEIGHT OF 6’ FROM GRADE WITH RIGID SCHEDULE 80 PVC ATTACHED TO BUILDING.

5 BOND REAR EXIT STAIRS TO LIGHTNING PROTECTION SYSTEM USING A 'T' ADAPTER INTO THE DOWN CONDUCTOR FROM THE ROOF. FASTEN TO BUILDING FAÇADE WITH FASTENERS DESIGNED FOR BUILDING’S EXTERIOR MATERIAL.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

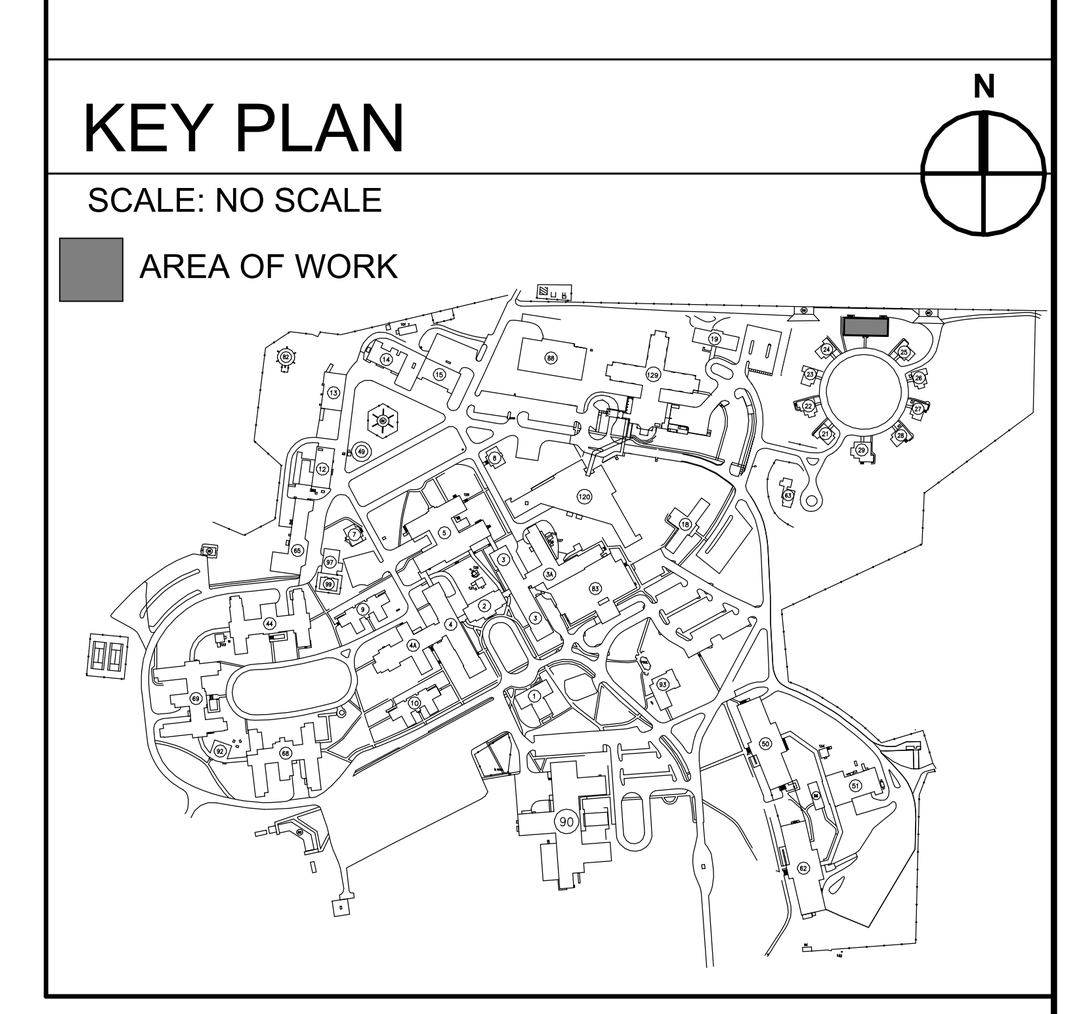

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

ALABAMA LICENSED No. 39881-E PROFESSIONAL ENGINEER KEVIN TODD KUBLANK
6/21/2024

PROJECT MANAGER

ACG Project Number 23-069

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 20 ROOF LIGHTNING PROTECTION PLAN

Location: CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM
2400 HOSPITAL ROAD
TUSKEGEE, AL 36083

Project Title: REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62

Approved:

Date	Checked	Drawn
JUNE 19, 2024	KTK	WSR

VA PROJECT NUMBER: 619A4-24-102

Building Number: # 20

Drawing Number: 20.E-101

Dwg 2 of 6

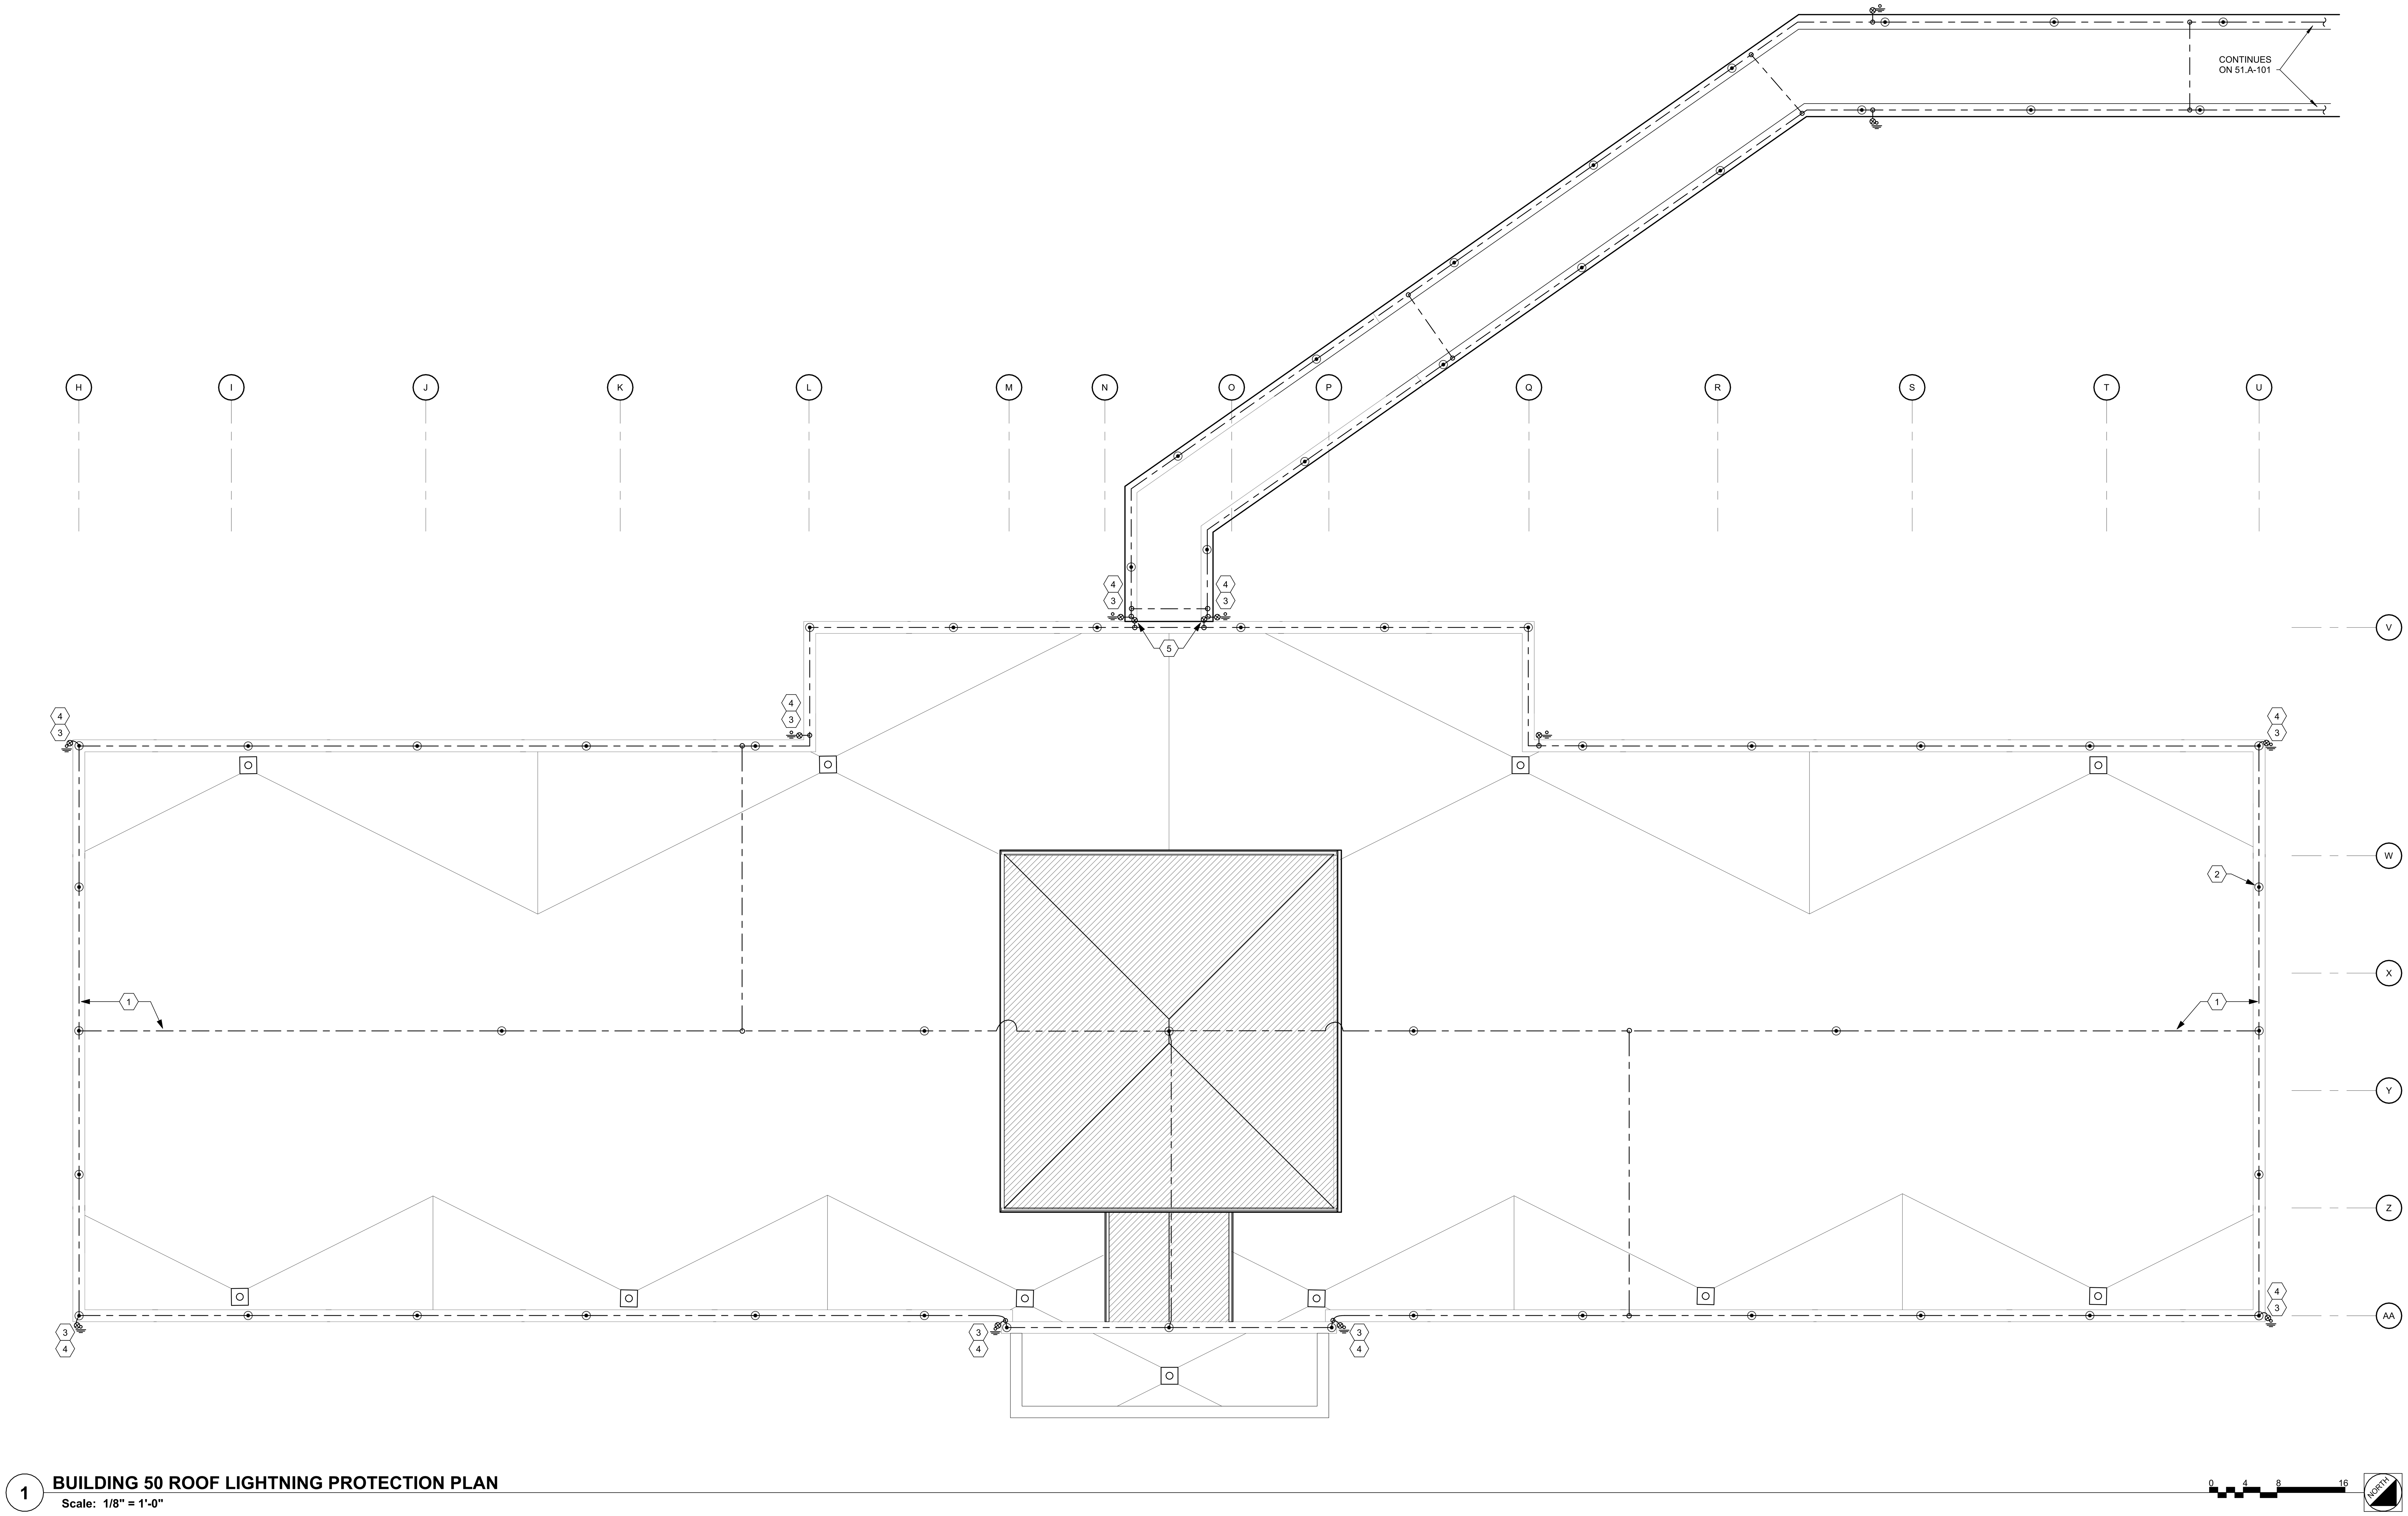

1 **BUILDING 50 ROOF LIGHTNING PROTECTION PLAN**

Scale: 1/8" = 1'-0"

SHEET NOTES:

A. FIELD VERIFY PROTECTION REQUIREMENTS AND COMMUNICATE ANY DISCREPENCIES AND/OR DEFICIENCIES WITH THE COR PRIOR TO INSTALLATION.

B. LIGHTNING PROTECTION SYSTEM TO BE INSTALLED BY A CERTIFIED LIGHTNING PROTECTION INSTALLER.

C. ACTUAL JOB SITE CONDITIONS MAY NECESSITATE SLIGHT ALTERATIONS OF AIR TERMINAL AND GROUND LOCATIONS. ANY ALTERATIONS SHALL BE APPROVED BY THE COR PRIOR TO THEIR EXECUTION.

D. AIR TERMINALS SHALL BE PLACED AROUND THE ROOF PERIMETER OR RIDGE AT 20'-0" MAXIMUM INTERVALS FOR 10" TO 24" AIR TERMINALS AND EXTEND A MINIMUM OF 10" ABOVE THE OBJECT OR AREA IT IS TO PROTECT.

E. AIR TERMINALS SHALL BE PLACED WITHIN 24" FROM THE OUTSIDE EDGES OF THE OBJECT TO BE PROTECTED.

F. MID-ROOF AIR TERMINALS ON FLAT OR GENTLY SLOPING ROOFS SHALL BE INSTALLED AT A MAXIMUM 50'-0" INTERVALS.

G. ALL ROOF PROJECTIONS AND/OR OBJECTS THAT ARE SUBJECT TO A DIRECT LIGHTNING STRIKE SHALL BE PROVIDED WITH AIR TERMINALS UNLESS THEY ARE LOCATED WITHIN A ZONE OF PROTECTION.

H. METAL BODIES SITUATED WITHIN 6'-0" OF A LIGHTNING PROTECTION CONDUCTOR SHALL BE BONDED TO THE LIGHTNING PROTECTION SYSTEM.

I. AIR TERMINALS AND CONDUCTOR MOUNTS ARE TO BE MOUNTED TO THE PARAPET WALL USING ADHESIVE MOUNTS OR ANOTHER UL APPROVED METHOD THAT PREVENTS SPALLING AND CRACKING OF THE EXISTING CONCRETE.

KEY NOTES:

1 CLASS 1 LIGHTNING PROTECTION CONDUCTORS FASTENED EVERY 3'-0" OC. CONDUCTORS ARE GRAPHICALLY REPRESENTED ON TOP OF PARAPET FOR LEGIBILITY. MOUNT CONDUCTORS TO BACK SIDE OF PARAPET. ROUTING OF CONDUCTORS IS TO BE IN ACCORDANCE WITH NFPA 780, APPROVED CONDUCTOR BEND RADIUS REQUIREMENTS, AND STANDARD BUILDING PRACTICE.

2 LIGHTNING PROTECTION AIR TERMINALS ARE GRAPHICALLY REPRESENTED ON TOP OF PARAPET FOR LEGIBILITY. AIR TERMINALS ARE TO BE MOUNTED TO THE BACK SIDE FACE OF THE PARAPET USING A UL LISTED ADHESIVE MOUNTING SOLUTION.

3 PROVIDE DOWN CONDUCTOR ALONG EXTERIOR FACADE OF BUILDING AND CONNECT TO NEW PROVIDED GROUND ROD. DOWN CONDUCTORS SHALL BE FASTENED TO BUILDING FAÇADE WITH FASTENERS DESIGNED FOR BUILDING’S EXTERIOR MATERIAL.

4 DOWN CONDUCTOR TO BE PROTECTED TO A HEIGHT OF 6’ FROM GRADE WITH RIGID SCHEDULE 80 PVC ATTACHED TO BUILDING.

5 TIE-IN BUILDING 50 ROOF LIGHTNING PROTECTION WITH CONNECTOR ROOF LEVEL LIGHTNING PROTECTION SYSTEM. PROVIDE DOWN CONDUCTOR ALONG EXTERIOR FACADE OF BUILDING AND CONNECT TO NEW CONNECTOR LEVEL SYSTEM. DOWN CONDUCTOR SHALL BE FASTENED TO BUILDING FACADE WITH FASTENERS DESIGNED FOR BUILDING’S EXTERIOR MATERIAL.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

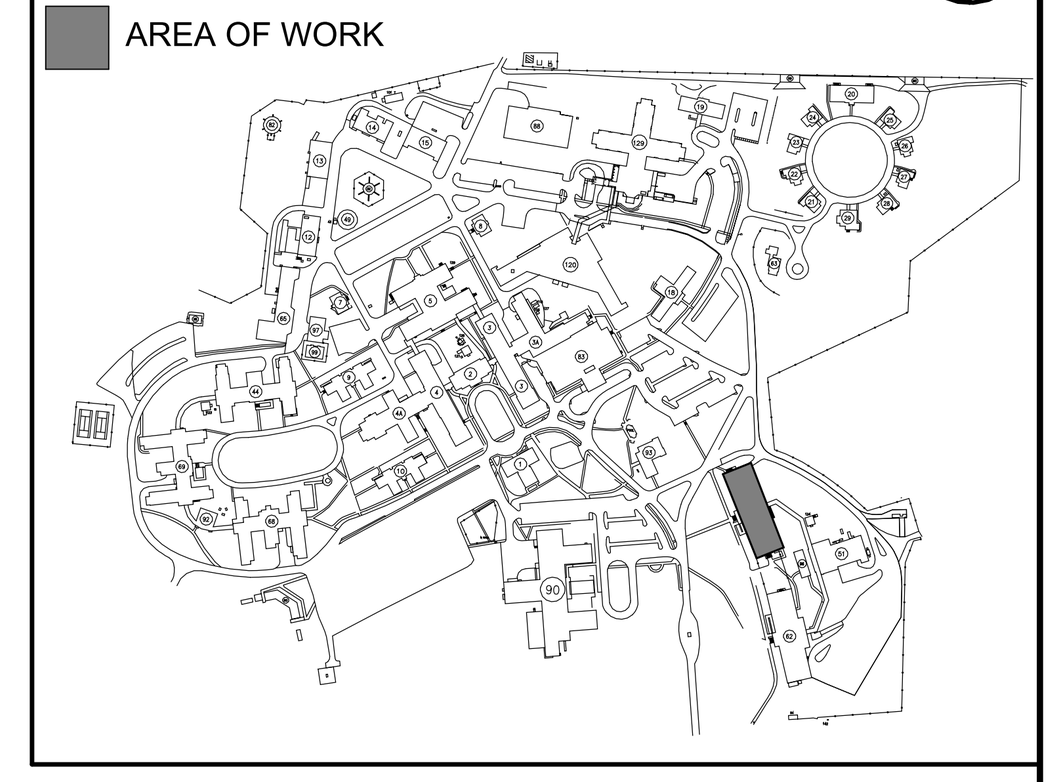

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

ALABAMA LICENSED No. 39881-E PROFESSIONAL ENGINEER KEVIN TODD KUBLANK 6/21/2024

PROJECT MANAGER

ACG Project Number 23-069

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 50 ROOF LIGHTNING PROTECTION PLAN
Location	CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM 2400 HOSPITAL ROAD TUSKEGEE, AL 36083
Project Title	REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
Approved	
Date	JUNE 19, 2024
Checked	KTK
Drawn	WSR
VA PROJECT NUMBER	619A4-24-102
Building Number	# 50
Drawing Number	50.E-101
Dwg	3 of 6

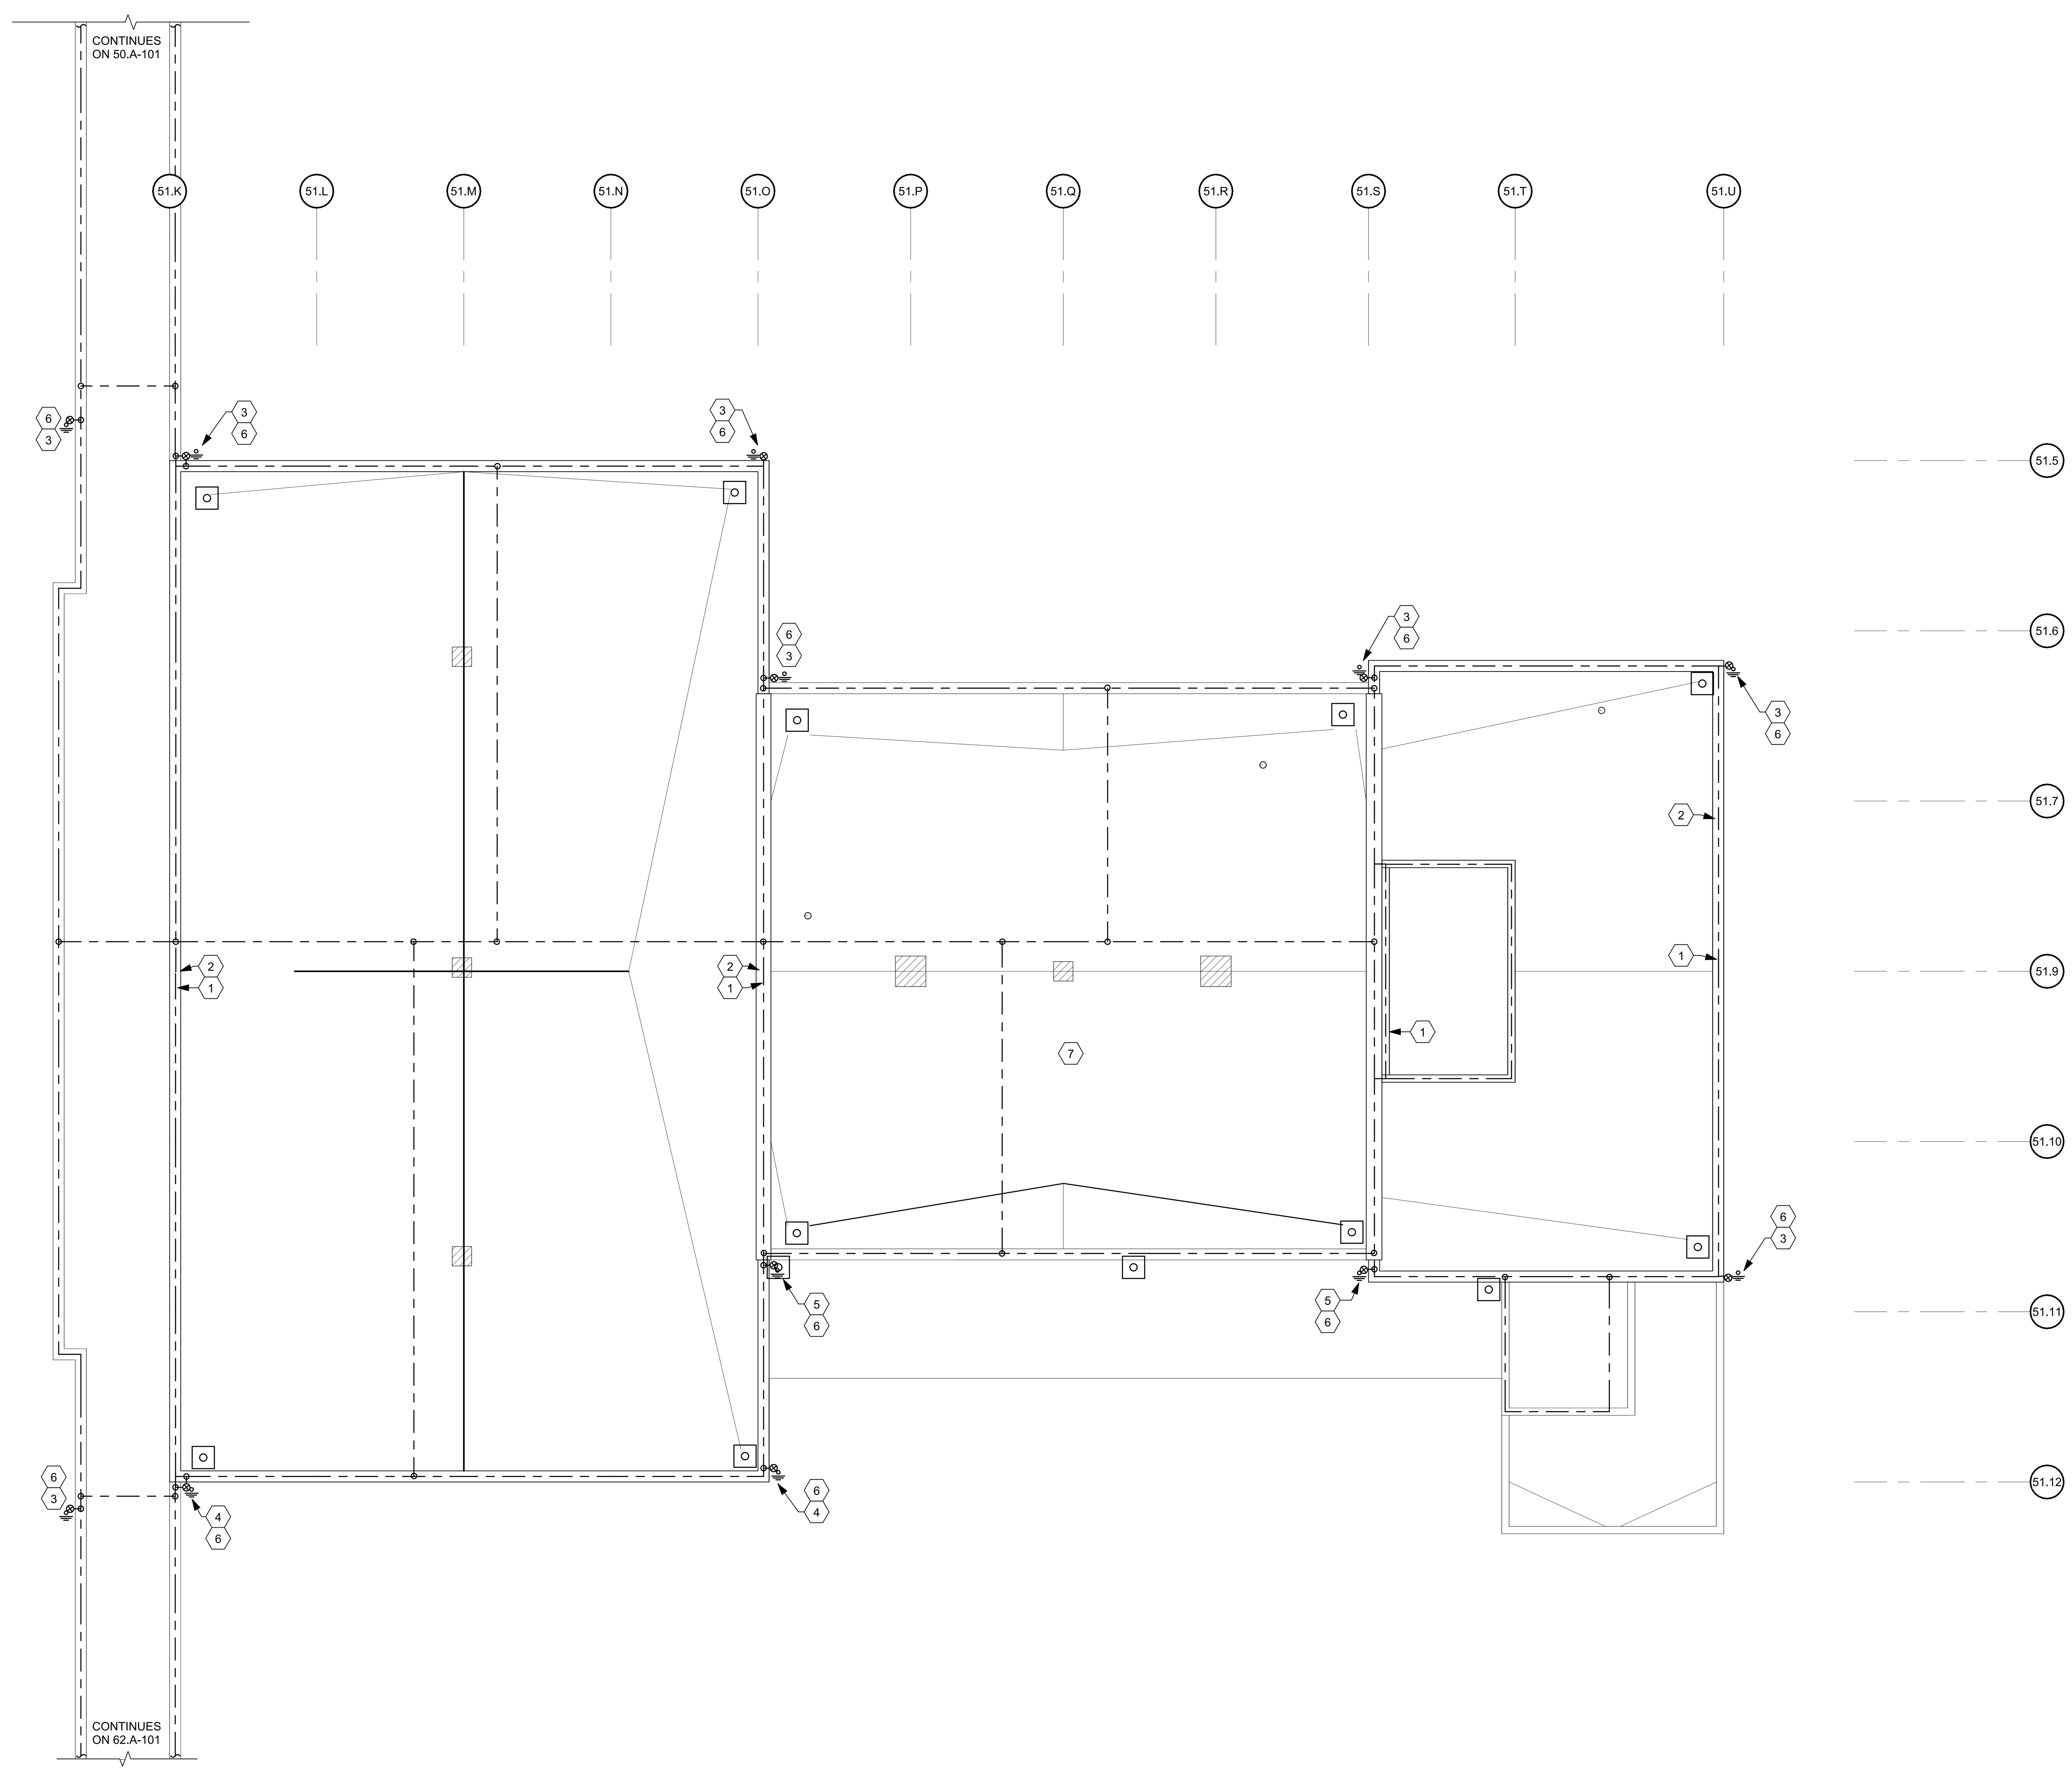

1 BUILDING 51 ROOF LIGHTNING PROTECTION PLAN

Scale: 1/8" = 1'-0"

SHEET NOTES:

A. FIELD VERIFY PROTECTION REQUIREMENTS AND COMMUNICATE ANY DISCREPENCIES AND/OR DEFICIENCIES WITH THE COR PRIOR TO INSTALLATION.

B. LIGHTNING PROTECTION SYSTEM TO BE INSTALLED BY A CERTIFIED LIGHTNING PROTECTION INSTALLER.

C. ACTUAL JOB SITE CONDITIONS MAY NECESSITATE SLIGHT ALTERATIONS OF AIR TERMINAL AND GROUND LOCATIONS. ANY ALTERATIONS SHALL BE APPROVED BY THE COR PRIOR TO THEIR EXECUTION.

D. AIR TERMINALS SHALL BE PLACED AROUND THE ROOF PERIMETER OR RIDGE AT 20'-0" MAXIMUM INTERVALS FOR 10" TO 24" AIR TERMINALS AND EXTEND A MINIMUM OF 10" ABOVE THE OBJECT OR AREA IT IS TO PROTECT.

E. AIR TERMINALS SHALL BE PLACED WITHIN 24" FROM THE OUTSIDE EDGES OF THE OBJECT TO BE PROTECTED.

F. MID-ROOF AIR TERMINALS ON FLAT OR GENTLY SLOPING ROOFS SHALL BE INSTALLED AT A MAXIMUM 50'-0" INTERVALS.

G. ALL ROOF PROJECTIONS AND/OR OBJECTS THAT ARE SUBJECT TO A DIRECT LIGHTNING STRIKE SHALL BE PROVIDED WITH AIR TERMINALS UNLESS THEY ARE LOCATED WITHIN A ZONE OF PROTECTION.

H. METAL BODIES SITUATED WITHIN 6'-0" OF A LIGHTNING PROTECTION CONDUCTOR SHALL BE BONDED TO THE LIGHTNING PROTECTION SYSTEM.

I. ELECTRICAL CONTRACTOR SHALL FOLLOW SITE LOCK-OUT/TAG-OUT GUIDELINES TO DEENERGIZE EQUIPMENT AS REQUIRED.

J. AIR TERMINALS AND CONDUCTOR MOUNTS ARE TO BE MOUNTED TO THE PARAPET WALL USING ADHESIVE MOUNTS OR ANOTHER UL APPROVED METHOD THAT PREVENTS SPALLING AND CRACKING OF THE EXISTING CONCRETE.

KEY NOTES:

1 CLASS 1 LIGHTNING PROTECTION CONDUCTORS FASTENED EVERY 3'-0" OC. CONDUCTORS ARE GRAPHICALLY REPRESENTED ON TOP OF PARAPET FOR LEGIBILITY. MOUNT CONDUCTORS TO BACK SIDE OF PARAPET. ROUTING OF CONDUCTORS IS TO BE IN ACCORDANCE WITH NFPA 780, APPROVED CONDUCTOR BEND RADIUS REQUIREMENTS, AND STANDARD BUILDING PRACTICE.

2 LIGHTNING PROTECTION AIR TERMINALS ARE GRAPHICALLY REPRESENTED ON TOP OF PARAPET FOR LEGIBILITY. AIR TERMINALS ARE TO BE MOUNTED TO THE BACK SIDE FACE OF THE PARAPET USING A UL LISTED ADHESIVE MOUNTING SOLUTION.

3 PROVIDE DOWN CONDUCTOR ALONG EXTERIOR FACADE OF BUILDING AND CONNECT TO NEW PROVIDED GROUND ROD. DOWN CONDUCTORS SHALL BE FASTENED TO BUILDING FAÇADE WITH FASTENERS DESIGNED FOR BUILDING'S EXTERIOR MATERIAL.

4 PROVIDE DOWN CONDUCTOR ALONG EXTERIOR FACADE OF BUILDING AND CONNECT TO NEW PROVIDED GROUND ROD. CUT HARDSCAPE TO CREATE TRENCH FOR DOWN CONDUCTOR AND GROUND ROD. PROVIDE GROUND TESTING WELL FOR FUTURE INSPECTION. CUT AREA SHALL BE REPAIRED WITH LIKE MATERIALS TO MATCH EXISTING. GROUND WELL SHALL BE TIER 15 RATED.

5 PROVIDE DOWN CONDUCTOR ALONG EXTERIOR FACADE OF BUILDING AND CONNECT TO NEW PROVIDED GROUND ROD. CUT HARDSCAPE TO CREATE TRENCH FOR DOWN CONDUCTOR AND GROUND ROD. PROVIDE GROUND TESTING WELL FOR FUTURE INSPECTION. CUT AREA SHALL BE REPAIRED WITH LIKE MATERIALS TO MATCH EXISTING. GROUND WELL SHALL BE TIER 15 RATED. COORDINATE ROUTING OF CONDUCTOR WITH AWNING.

6 DOWN CONDUCTOR TO BE PROTECTED TO A HEIGHT OF 6' FROM GRADE WITH RIGID SCHEDULE 80 PVC ATTACHED TO BUILDING.

7 CONNECT LIGHTNING PROTECTION SYSTEM TO BUILDING GROUNDING BUS AND PROVIDE SURGE PROTECTIVE DEVICE IN MAIN DISTRIBUTION PANEL.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

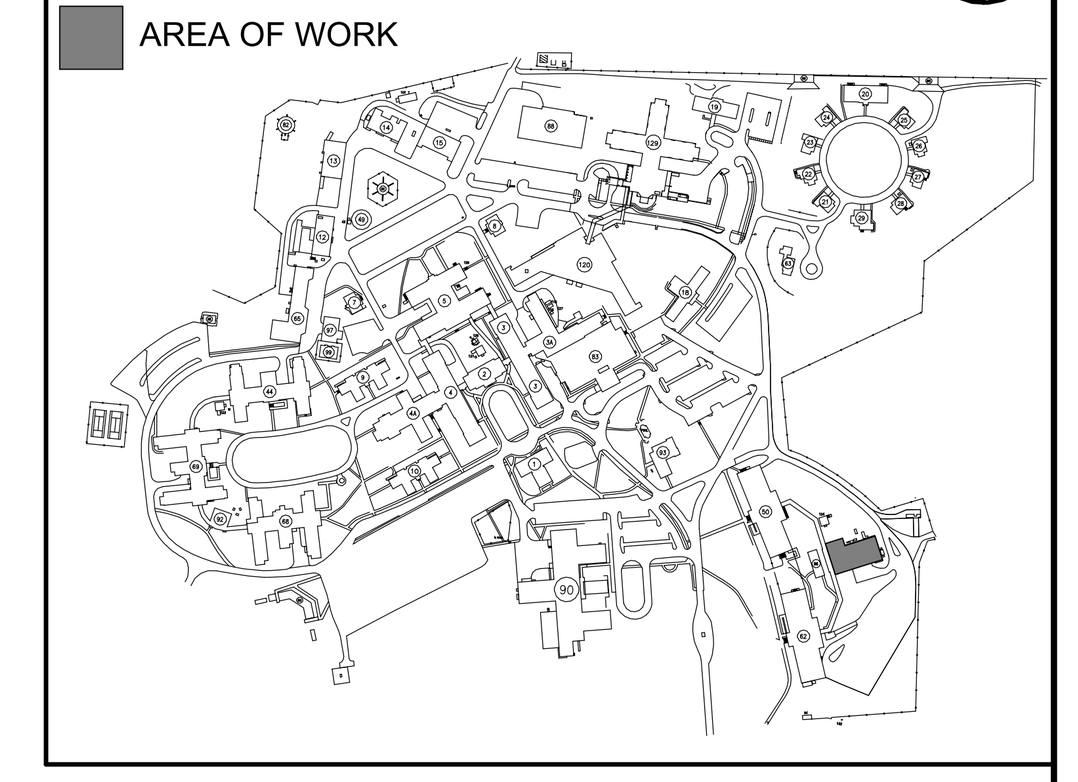

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

ALABAMA LICENSED No. 39881-E PROFESSIONAL ENGINEER KEVIN TODD KUBIK 6/21/2024

PROJECT MANAGER

ACG Project Number 23-069

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 51 ROOF LIGHTNING PROTECTION PLAN

Location: CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM, 2400 HOSPITAL ROAD, TUSKEGEE, AL 36083

Project Title: REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62

Approved:

Date	Checked	Drawn
JUNE 19, 2024	KTK	WSR

VA PROJECT NUMBER: 619A4-24-102

Building Number: # 51

Drawing Number: 51.E-101

Dwg 4 of 6

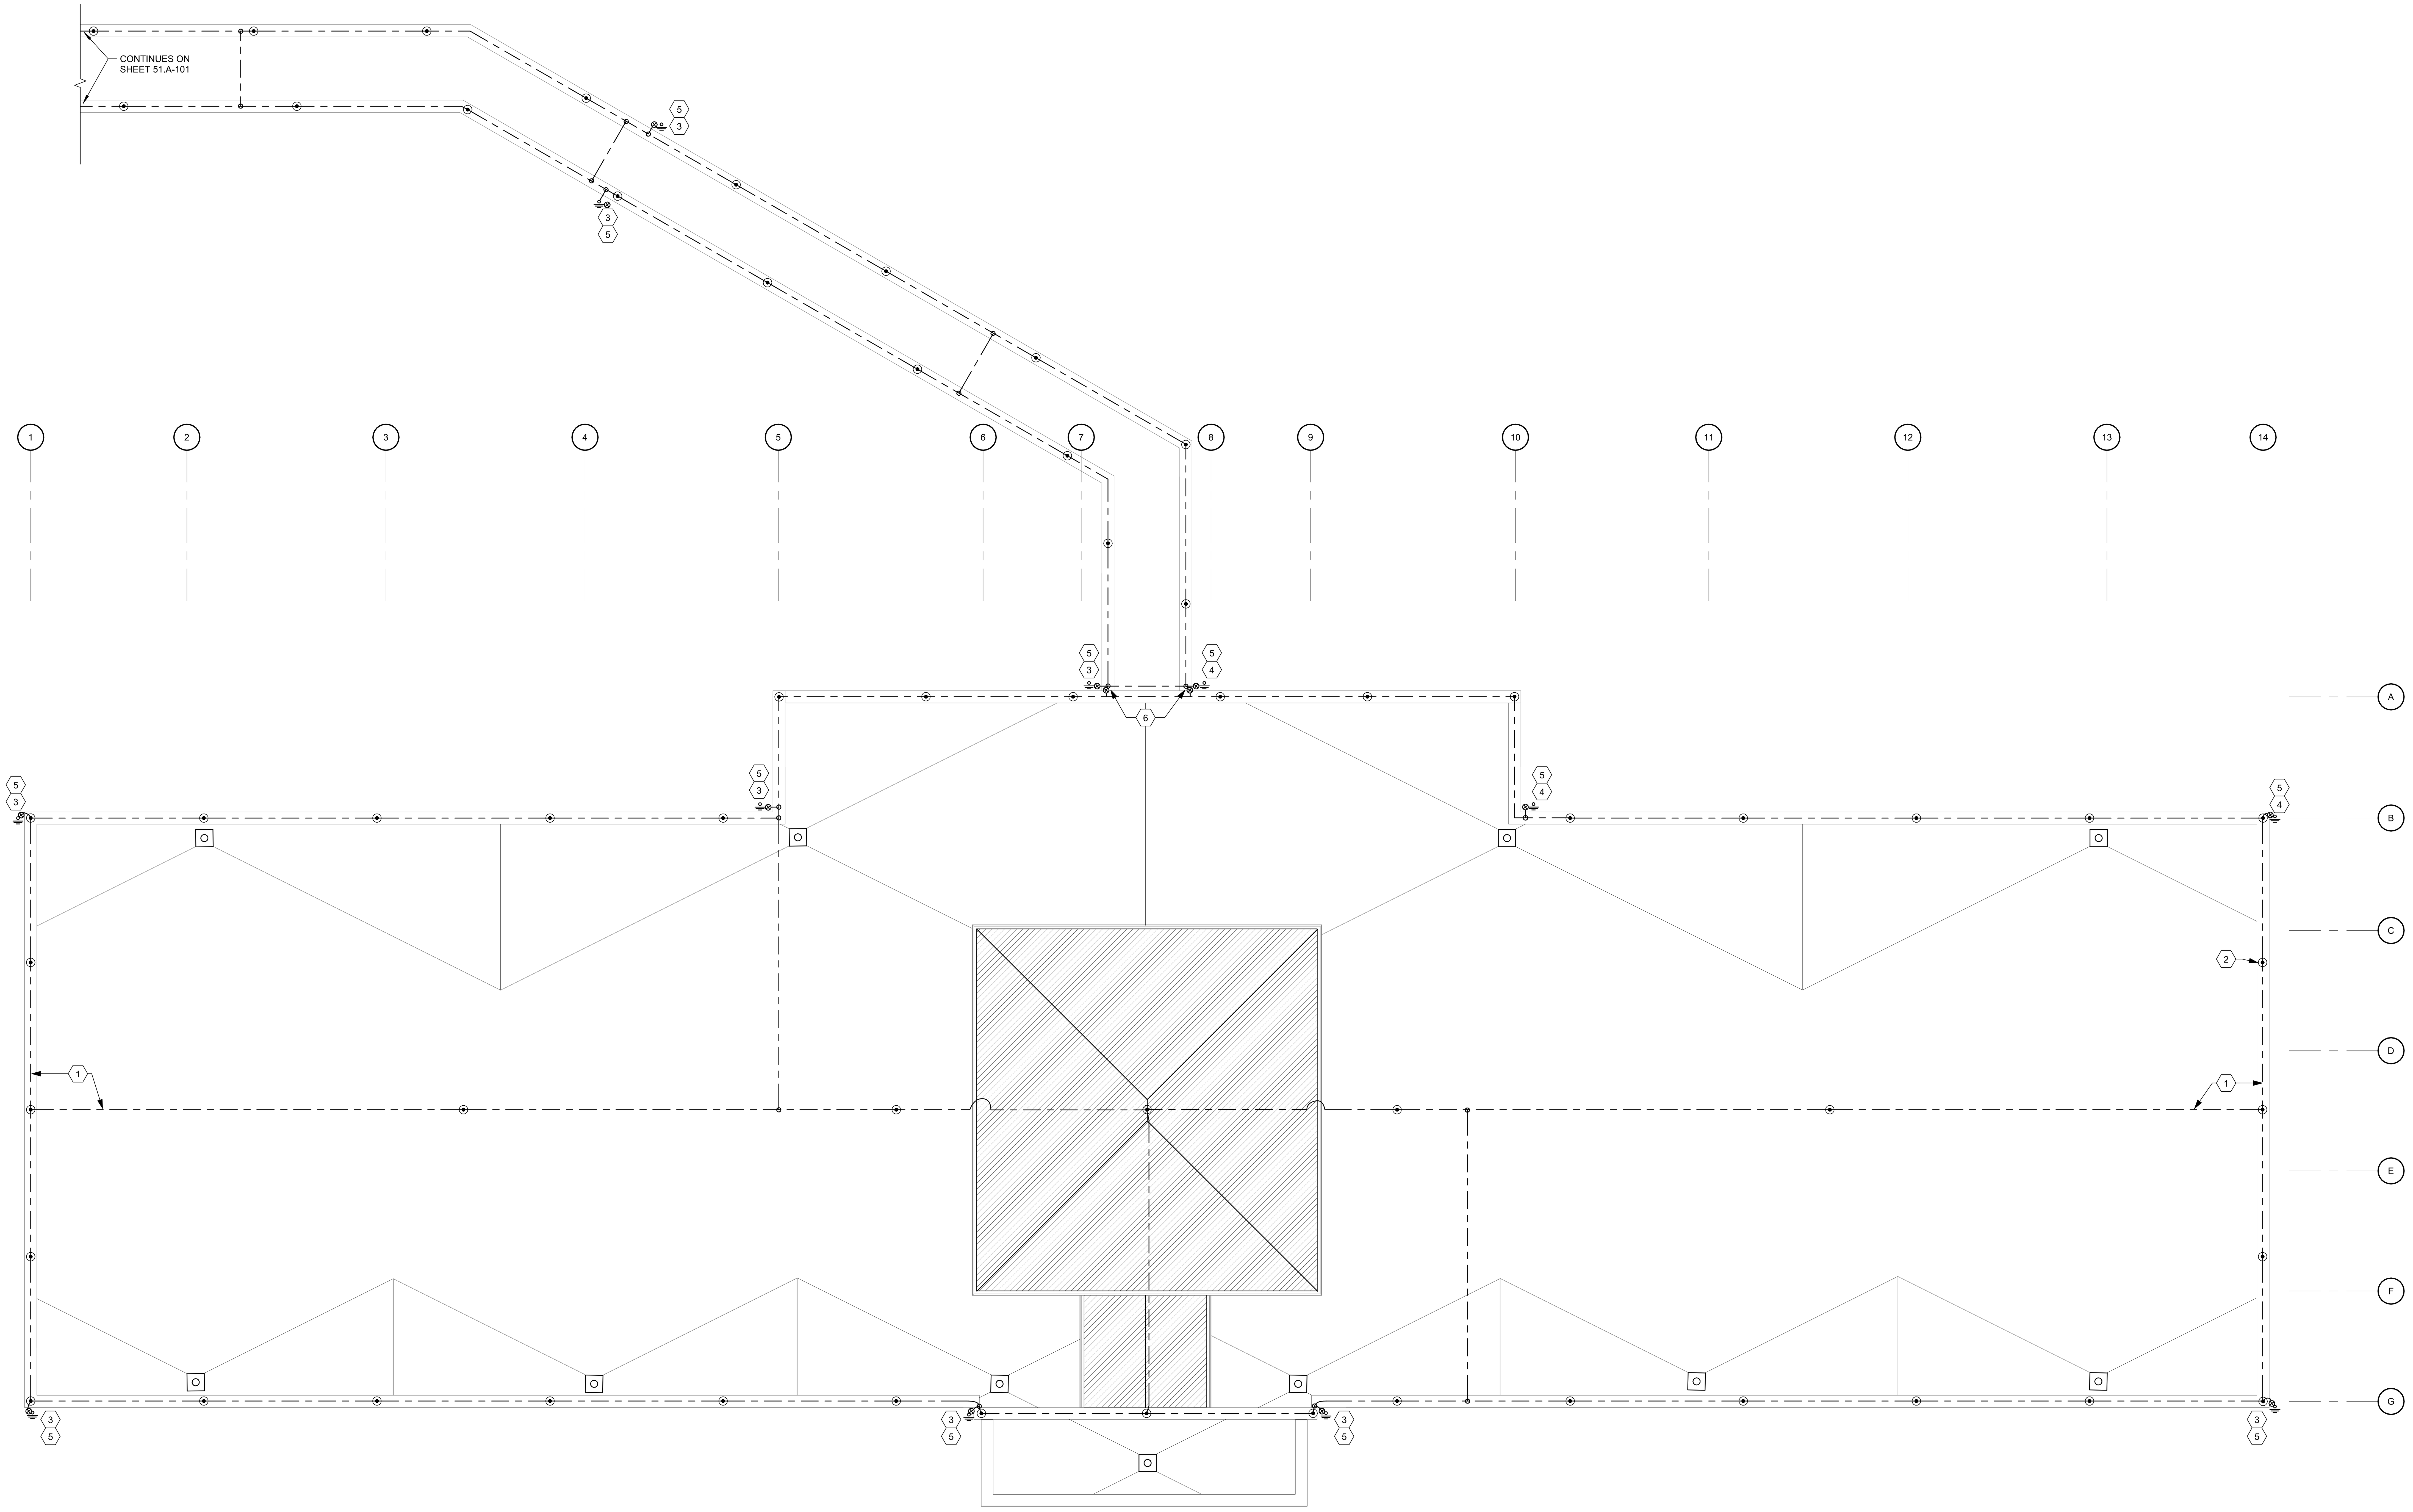

1 **BUILDING 62 ROOF LIGHTNING PROTECTION PLAN**
Scale: 1/8" = 1'-0"

SHEET NOTES:

A. FIELD VERIFY PROTECTION REQUIREMENTS AND COMMUNICATE ANY DISCREPENCIES AND/OR DEFICIENCIES WITH THE COR PRIOR TO INSTALLATION.

B. LIGHTNING PROTECTION SYSTEM TO BE INSTALLED BY A CERTIFIED LIGHTNING PROTECTION INSTALLER.

C. ACTUAL JOB SITE CONDITIONS MAY NECESSITATE SLIGHT ALTERATIONS OF AIR TERMINAL AND GROUND LOCATIONS. ANY ALTERATIONS SHALL BE APPROVED BY THE COR PRIOR TO THEIR EXECUTION.

D. AIR TERMINALS SHALL BE PLACED AROUND THE ROOF PERIMETER OR RIDGE AT 20'-0" MAXIMUM INTERVALS FOR 10" TO 24" AIR TERMINALS AND EXTEND A MINIMUM OF 10" ABOVE THE OBJECT OR AREA IT IS TO PROTECT.

E. AIR TERMINALS SHALL BE PLACED WITHIN 24" FROM THE OUTSIDE EDGES OF THE OBJECT TO BE PROTECTED.

F. MID-ROOF AIR TERMINALS ON FLAT OR GENTLY SLOPING ROOFS SHALL BE INSTALLED AT A MAXIMUM 50'-0" INTERVALS.

G. ALL ROOF PROJECTIONS AND/OR OBJECTS THAT ARE SUBJECT TO A DIRECT LIGHTNING STRIKE SHALL BE PROVIDED WITH AIR TERMINALS UNLESS THEY ARE LOCATED WITHIN A ZONE OF PROTECTION.

H. METAL BODIES SITUATED WITHIN 6'-0" OF A LIGHTNING PROTECTION CONDUCTOR SHALL BE BONDED TO THE LIGHTNING PROTECTION SYSTEM.

I. AIR TERMINALS AND CONDUCTOR MOUNTS ARE TO BE MOUNTED TO THE PARAPET WALL USING ADHESIVE MOUNTS OR ANOTHER UL APPROVED METHOD THAT PREVENTS SPALLING AND CRACKING OF THE EXISTING CONCRETE.

KEY NOTES:

1 CLASS 1 LIGHTNING PROTECTION CONDUCTORS FASTENED EVERY 3'-0" OC. CONDUCTORS ARE GRAPHICALLY REPRESENTED ON TOP OF PARAPET FOR LEGIBILITY. MOUNT CONDUCTORS TO BACK SIDE OF PARAPET. ROUTING OF CONDUCTORS IS TO BE IN ACCORDANCE WITH NFPA 780, APPROVED CONDUCTOR BEND RADIUS REQUIREMENTS, AND STANDARD BUILDING PRACTICE.

2 LIGHTNING PROTECTION AIR TERMINALS ARE GRAPHICALLY REPRESENTED ON TOP OF PARAPET FOR LEGIBILITY. AIR TERMINALS ARE TO BE MOUNTED TO THE BACK SIDE FACE OF THE PARAPET USING A UL LISTED ADHESIVE MOUNTING SOLUTION.

3 PROVIDE DOWN CONDUCTOR ALONG EXTERIOR FACADE OF BUILDING AND CONNECT TO NEW PROVIDED GROUND ROD. DOWN CONDUCTORS SHALL BE FASTENED TO BUILDING FAÇADE WITH FASTENERS DESIGNED FOR BUILDING'S EXTERIOR MATERIAL.

4 PROVIDE DOWN CONDUCTOR ALONG EXTERIOR FACADE OF BUILDING AND CONNECT TO NEW PROVIDED GROUND ROD. DOWN CONDUCTOR SHALL BE FASTENED TO BUILDING FACADE WITH FASTENERS DESIGNED FOR BUILDING'S EXTERIOR MATERIAL. CUT HARDSCAPE TO CREATE TRENCH FOR DOWN CONDUCTOR AND GROUND ROD. PROVIDE GROUND TESTING WELL FOR FUTURE INSPECTION. CUT AREAS SHALL BE REPAIRED WITH LIKE MATERIALS TO MATCH EXISTING. GROUND WELL SHALL BE TIER 15 RATED.

5 DOWN CONDUCTOR TO BE PROTECTED TO A HEIGHT OF 6' FROM GRADE WITH RIGID SCHEDULE 80 PVC ATTACHED TO BUILDING.

6 TIE-IN BUILDING 62 ROOF LIGHTNING PROTECTION WITH CONNECTOR ROOF LEVEL LIGHTNING PROTECTION SYSTEM. PROVIDE DOWN CONDUCTOR ALONG EXTERIOR FACADE OF BUILDING AND CONNECT TO NEW CONNECTOR LEVEL SYSTEM. DOWN CONDUCTOR SHALL BE FASTENED TO BUILDING FACADE WITH FASTENERS DESIGNED FOR BUILDING'S EXTERIOR MATERIAL.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

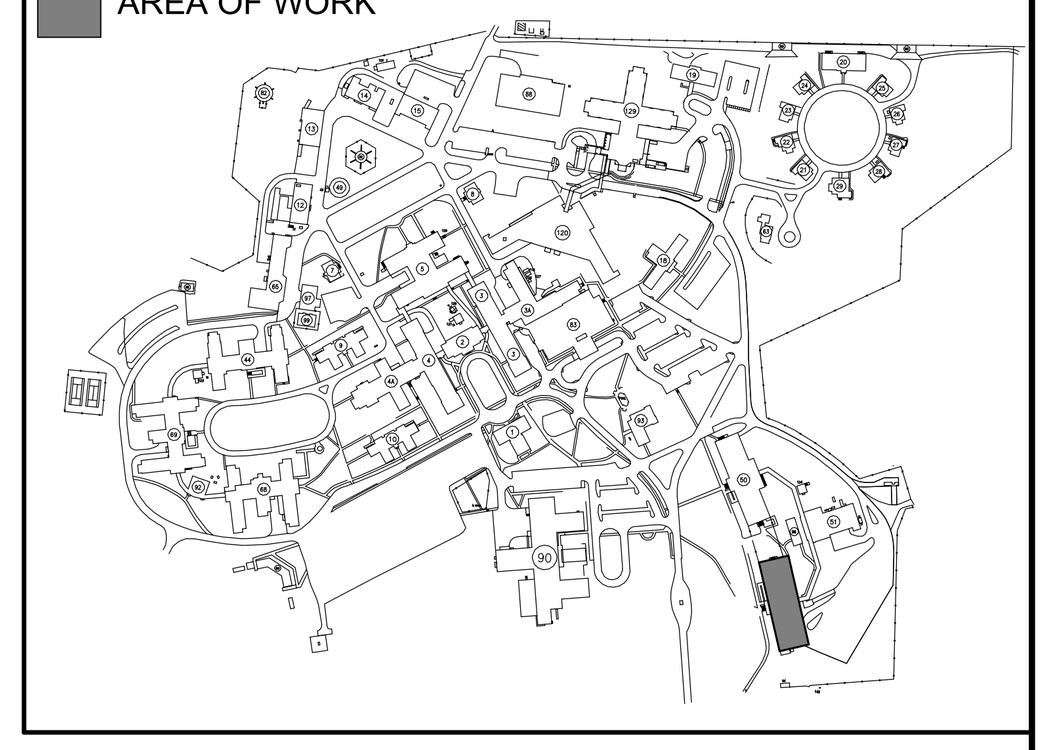

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

ALABAMA LICENSED No. 39881-E PROFESSIONAL ENGINEER KEVIN TODD KUBLI 6/21/2024

PROJECT MANAGER
ACG Project Number 23-069

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 62 ROOF LIGHTNING PROTECTION PLAN

Location: CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM, 2400 HOSPITAL ROAD, TUSKEGEE, AL 36083

Project Title: REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62

Approved

Date	Checked	Drawn
JUNE 19, 2024	KTK	WSR

VA PROJECT NUMBER: 619A4-24-102

Building Number: # 62

Drawing Number: 62.E-101

Dwg 5 of 6

C:\Users\wreed\Documents\A_23-069 VA Tuskegee-Replace Roof_R23_wreedRG6RE.rvt

6/17/2024 4:03:37 PM

VA FORM 08-6231

SYSTEM NO.W-L-1001
JUNE 15, 2005
F RATINGS - 1, 2, 3 AND 4 HR (SEE ITEMS 2 AND 3)
T RATINGS - 0, 1, 2, 3, AND 4 HR (SEE ITEM 3)
L RATING AT AMBIENT - LESS THAN 1 CFM/SQ FT
L RATING AT 400 F - LESS THAN 1 CFM/SQ FT

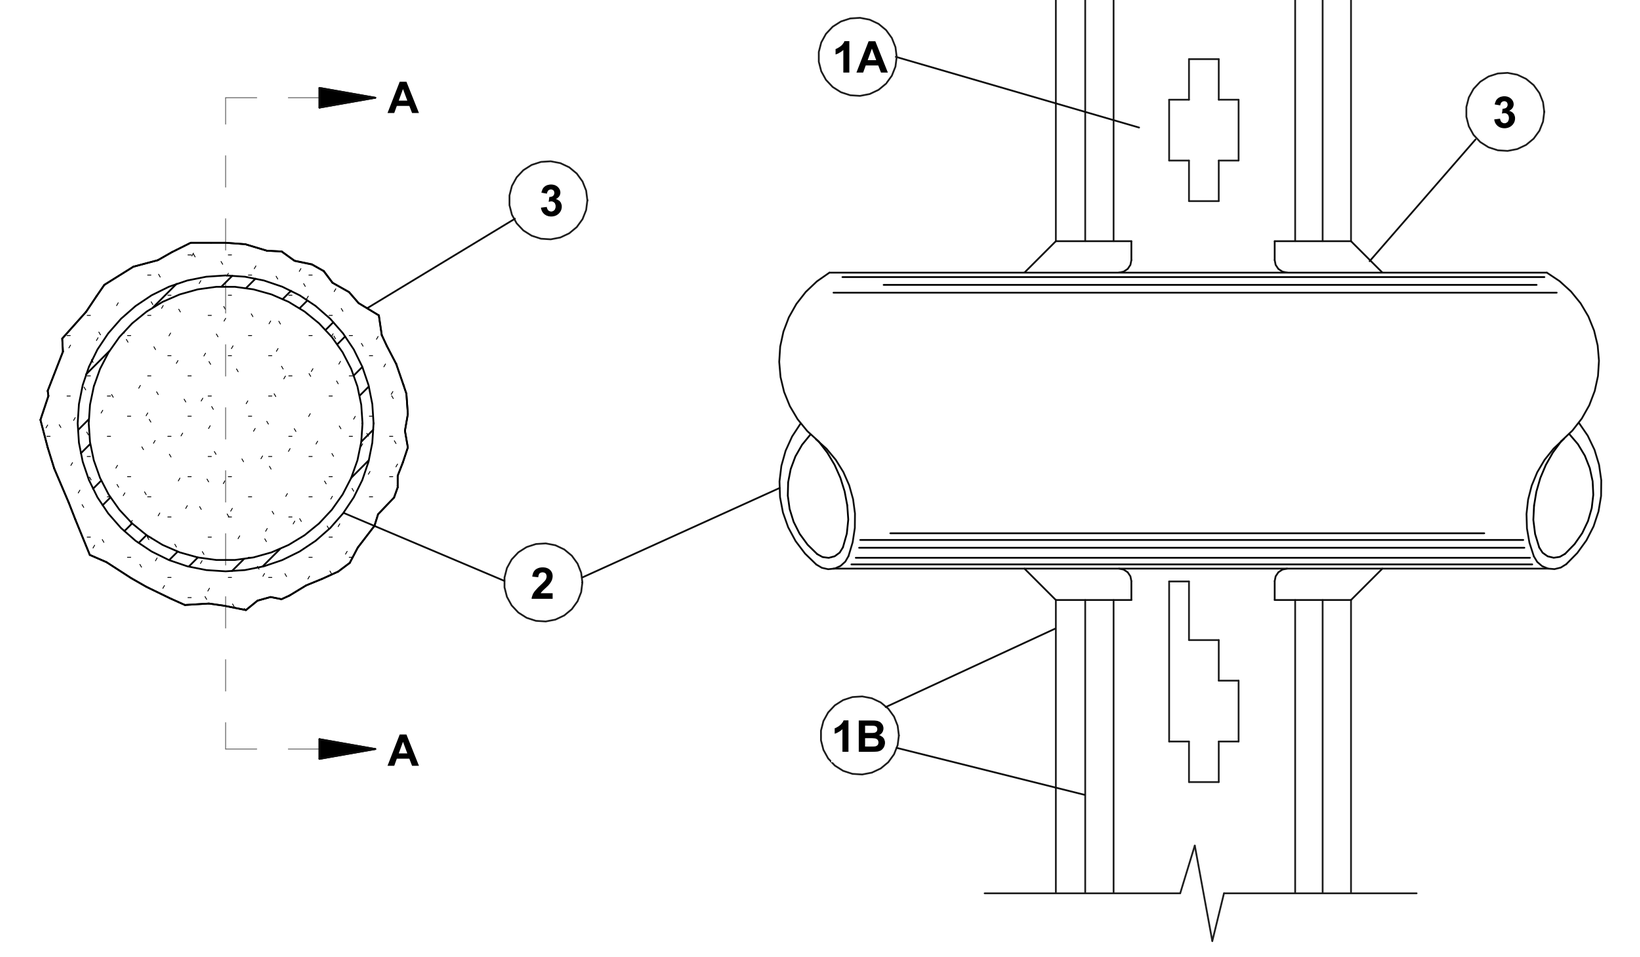

SECTION A-A

1. WALL ASSEMBLY - THE 1, 2, 3 OR 4 HR FIRE-RATED GYPSUM WALLBOARD/STUD WALL ASSEMBLY SHALL BE CONSTRUCTED OF THE MATERIALS AND IN THE MANNER DESCRIBED IN THE INDIVIDUAL U300 OR U400 SERIES WALL OR PARTITION DESIGNS IN THE UL FIRE RESISTANCE DIRECTORY AND SHALL INCLUDE THE FOLLOWING CONSTRUCTION FEATURES:

- **A. STUDS** - WALL FRAMING MAY CONSIST OF EITHER WOOD STUDS (MAX 2 HR FIRE RATED ASSEMBLIES) OR STEEL CHANNEL STUDS. WOOD STUDS TO CONSIST OF NOM 2 BY 4 IN. (51 BY 102 MM) LUMBER SPACED 16 IN. (406 MM) OC WITH NOM 2 BY 4 IN. (51 BY 102 MM) LUMBER END PLATES AND CROSS BRACES. STEEL STUDS TO BE MIN 3-5/8 IN. (92 MM) WIDE BY 1-3/8 IN. (35 MM) DEEP CHANNELS SPACED MAX 24 IN. (610 MM) OC.
- **B. GYPSUM BOARD*** - NOM 1/2 OR 5/8 IN. (13 OR 16 MM) THICK, 4 FT. (122 CM) WIDE WITH SQUARE OR TAPERED EDGES. THE GYPSUM WALLBOARD TYPE, THICKNESS, NUMBER OF LAYERS, FASTENER TYPE AND SHEET ORIENTATION SHALL BE AS SPECIFIED IN THE INDIVIDUAL U300 OR U400 SERIES DESIGN IN THE UL FIRE RESISTANCE DIRECTORY. MAX DIAM OF OPENING IS 26 IN. (660 MM).

2. THROUGH PENETRANT - ONE METALLIC PIPE, CONDUIT OR TUBING INSTALLED EITHER CONCENTRICALLY OR ECCENTRICALLY WITHIN THE FIRESTOP SYSTEM. THE ANNULAR SPACE BETWEEN PIPE, CONDUIT OR TUBING AND PERIPHERY OF OPENING SHALL BE MIN OF 0 IN. (0 MM) (POINT CONTACT) TO MAX 2 IN. (51 MM). PIPE, CONDUIT OR TUBING TO BE RIGIDLY SUPPORTED ON BOTH SIDES OF WALL ASSEMBLY. THE FOLLOWING TYPES AND SIZES OF METALLIC PIPES, CONDUITS OR TUBING MAY BE USED:

- **A. STEEL PIPE** - NOM 24 IN. (610 MM) DIAM (OR SMALLER) SCHEDULE 10 (OR HEAVIER) STEEL PIPE.
- **B. IRON PIPE** - NOM 24 IN. (610 MM) DIAM (OR SMALLER) SERVICE WEIGHT (OR HEAVIER) CAST IRON SOIL PIPE, NOM 12 IN. (305 MM) DIAM (OR SMALLER) OR CLASS 50 (OR HEAVIER) DUCTILE IRON PRESSURE PIPE.
- **C. CONDUIT** - NOM 6 IN. (152 MM) DIAM (OR SMALLER) STEEL CONDUIT OR NOM 4 IN. (102 MM) DIAM (OR SMALLER) STEEL ELECTRICAL METALLIC TUBING
- **D. COPPER TUBING** - NOM 6 IN. (152 MM) DIAM (OR SMALLER) TYPE L (OR HEAVIER) COPPER TUBING
- **E. COPPER PIPE** - NOM 6 IN. (152 MM) DIAM (OR SMALLER) REGULAR (OR HEAVIER) COPPER PIPE.
- **F. THROUGH PENETRATING PRODUCT* - FLEXIBLE METAL PIPING** - THE FOLLOWING TYPES OF STEEL FLEXIBLE METAL GAS PIPING MAY BE USED:

1. NOM 2 IN. (51 MM) DIAM (OR SMALLER) STEEL FLEXIBLE METAL GAS PIPING. PLASTIC COVERING ON PIPING MAY OR MAY NOT BE REMOVED ON BOTH SIDES OF FLOOR OR WALL ASSEMBLY.

OMEGA FLEX INC

2. NOM 1 IN. (25 MM) DIAM (OR SMALLER) STEEL FLEXIBLE METAL GAS PIPING. PLASTIC COVERING ON PIPING MAY OR MAY NOT BE REMOVED ON BOTH SIDES OF FLOOR OR WALL ASSEMBLY.

TITEFLEX CORP
A BUNDY CO

3. NOM 1 IN. (25 MM) DIAM (OR SMALLER) STEEL FLEXIBLE METAL GAS PIPING. PLASTIC COVERING ON PIPING MAY OR MAY NOT BE REMOVED ON BOTH SIDES OF FLOOR OR WALL ASSEMBLY.

WARD MFG INC

3. FILL,VOID OR CAVITY MATERIAL* - CAULK OR SEALANT - MIN 5/8. 1-1/4,1-7/8 AND 2-1/2 IN. (16, 32, 48 AND 64 MM) THICKNESS OF CAULK FOR 1, 2, 3 AND 4 HR RATED ASSEMBLIES, RESPECTIVELY, APPLIED WITHIN ANNULUS, FLUSH WITH BOTH SURFACES OF WALL. MIN 1/4 IN. (6 MM) DIAM BEAD OF CAULK APPLIED TO GYPSUM BOARD/PENETRANT INTERFACE AT POINT CONTACT LOCATION ON BOTH SIDES OF WALL.
THE HOURLY F RATING OF THE FIRESTOP SYSTEM IS DEPENDENT UPON THE HOURLY FIRE RATING OF THE WALL ASSEMBLY IN WHICH IT IS INSTALLED, AS SHOWN IN THE FOLLOWING TABLE.
THE HOURLY T RATING OF THE FIRESTOP SYSTEM IS DEPENDENT UPON THE TYPE OR SIZE OF THE PIPE OR CONDUIT AND THE HOURLY FIRE RATING OF THE WALL ASSEMBLY IN WHICH IT IS INSTALLED, AS TABULATED BELOW:

+WHEN COPPER PIPE IS USED, T RATING IS 0 HR.

3M COMPANY - CP 25WB+ CAULK OR FB-3000 WT SEALANT,

*BEARING THE UL CLASSIFICATION MARKING

MAX PIPE OR CONDUIT DIAM IN. (mm)	F RATING HR	T RATING HR
1 (25)	1 OR 2	0+, 1 OR 2
1 (25)	3 OR 4	3 OR 4
4 (102)	1 OR 2	0
6 (152)	3 OR 4	0
12 (305)	1 OR 2	0

13 UL PENETRATION DETAIL W-L-1001
Scale: No Scale

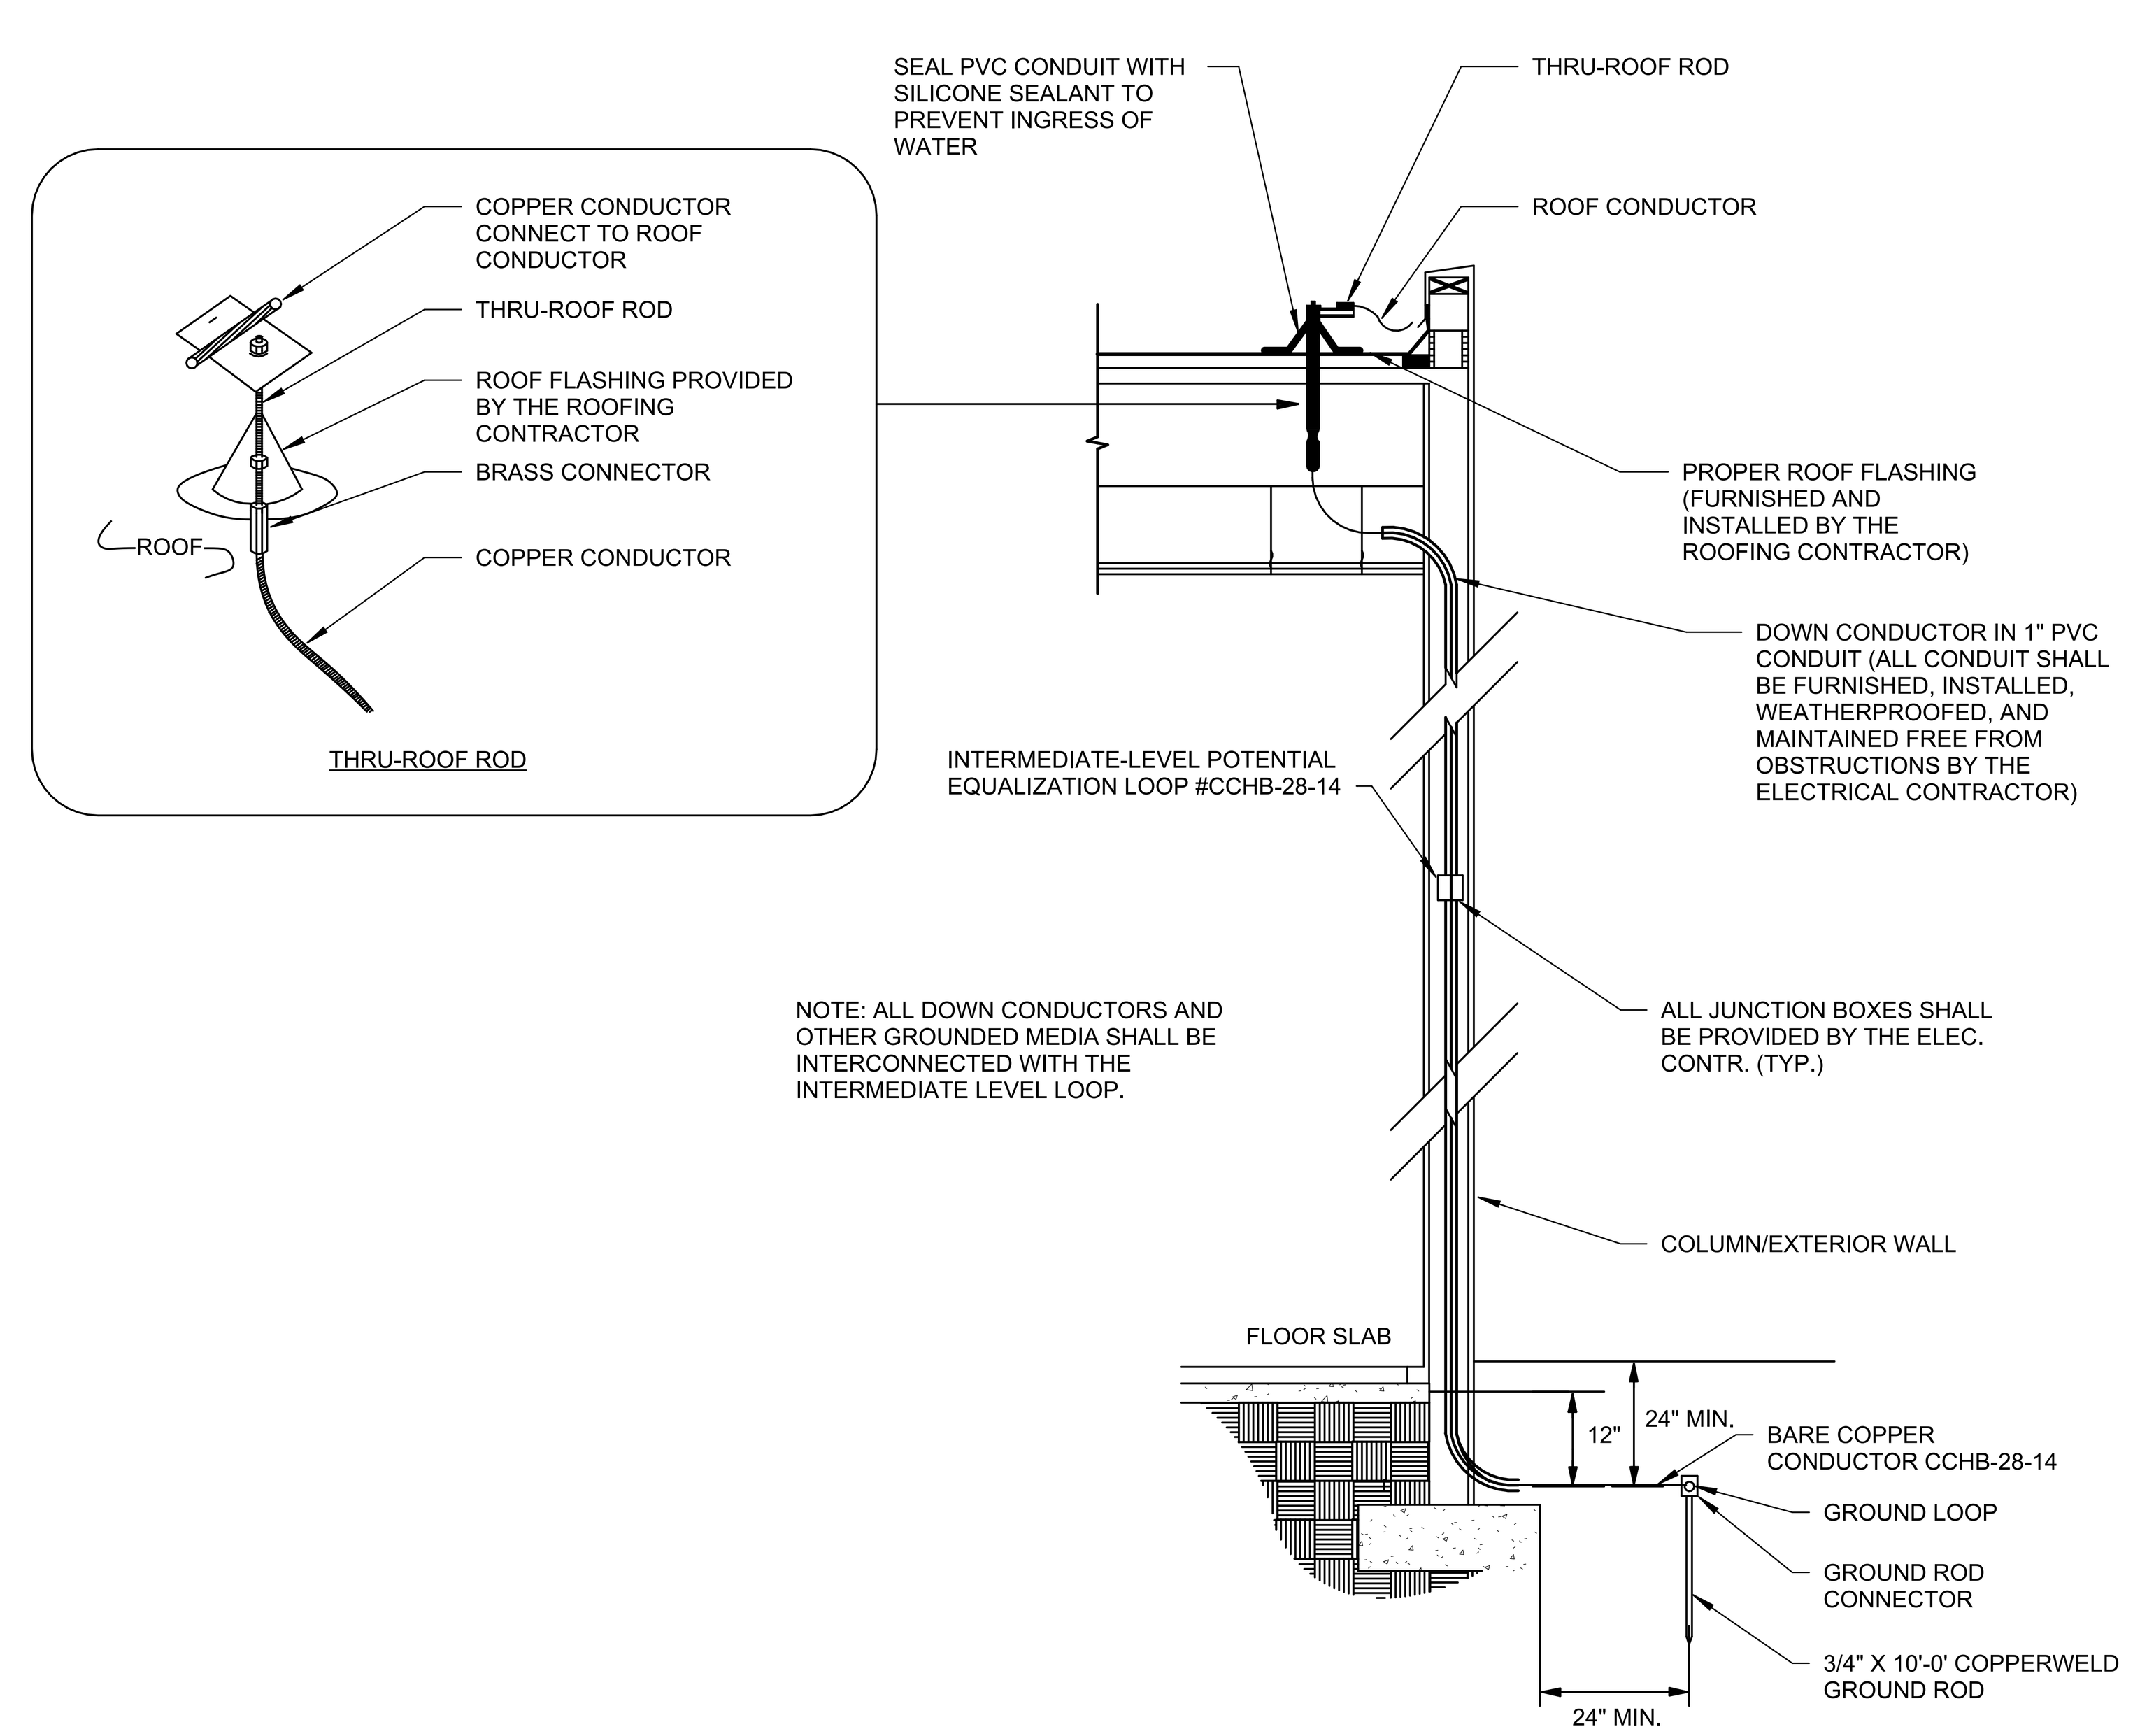

10 LIGHTNING PROTECTION THROUGH ROOF PENETRATION DETAIL
Scale: No Scale

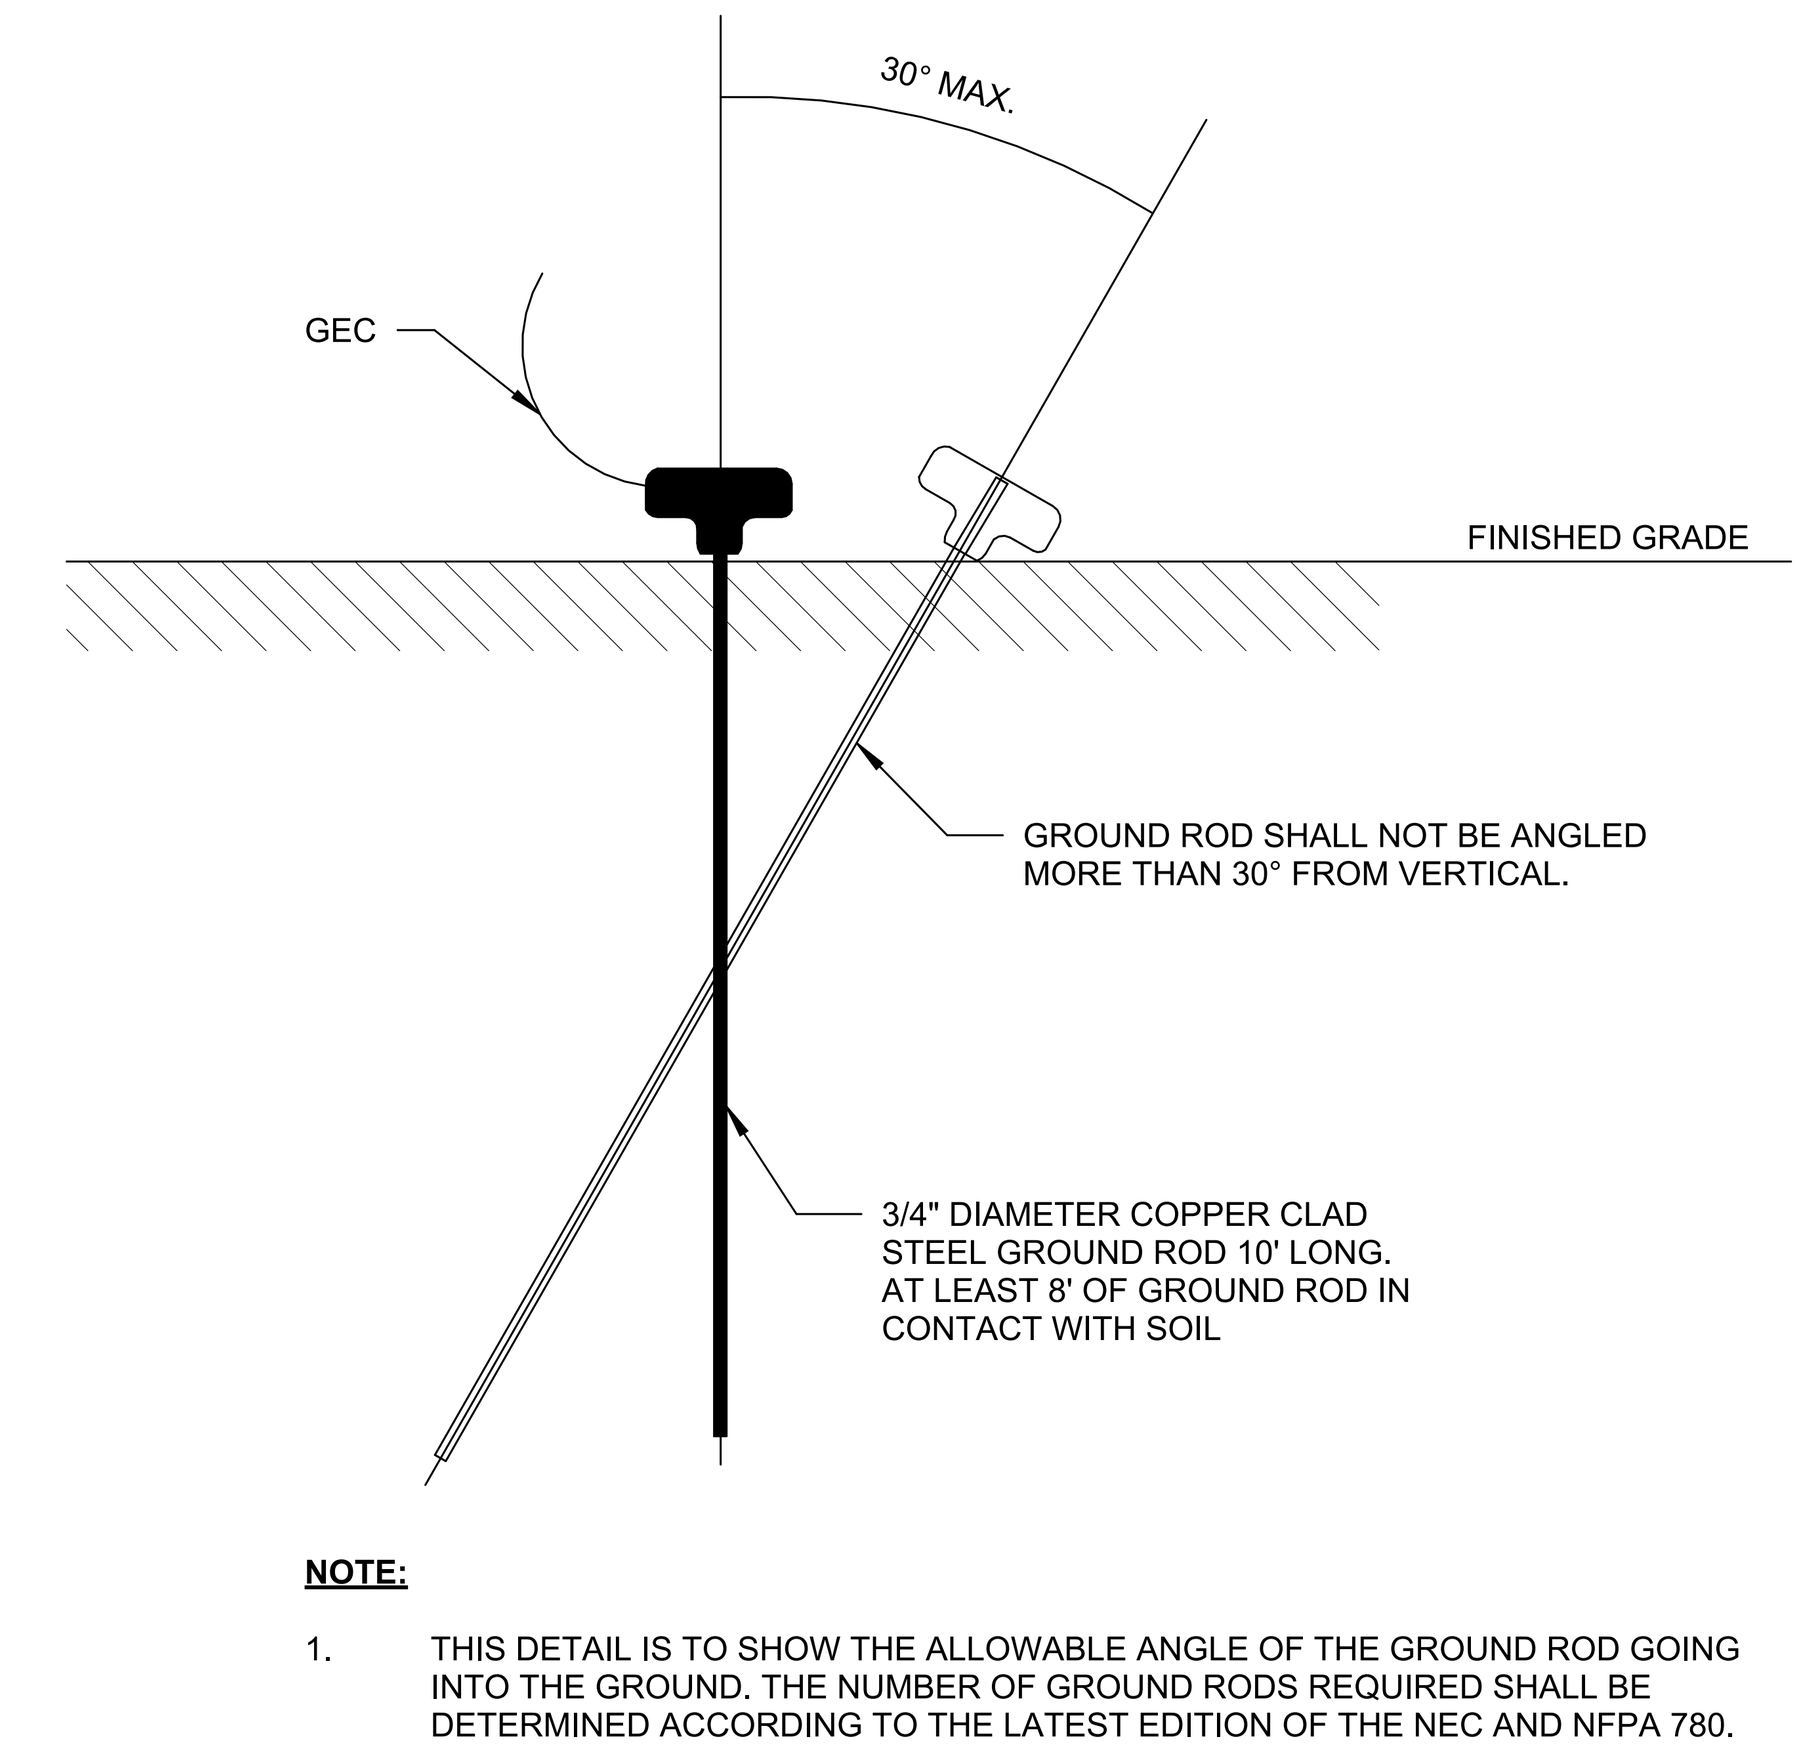

NOTE:

1. THIS DETAIL IS TO SHOW THE ALLOWABLE ANGLE OF THE GROUND ROD GOING INTO THE GROUND. THE NUMBER OF GROUND RODS REQUIRED SHALL BE DETERMINED ACCORDING TO THE LATEST EDITION OF THE NEC AND NFPA 780.

6 GROUND ROD DETAIL
Scale: No Scale

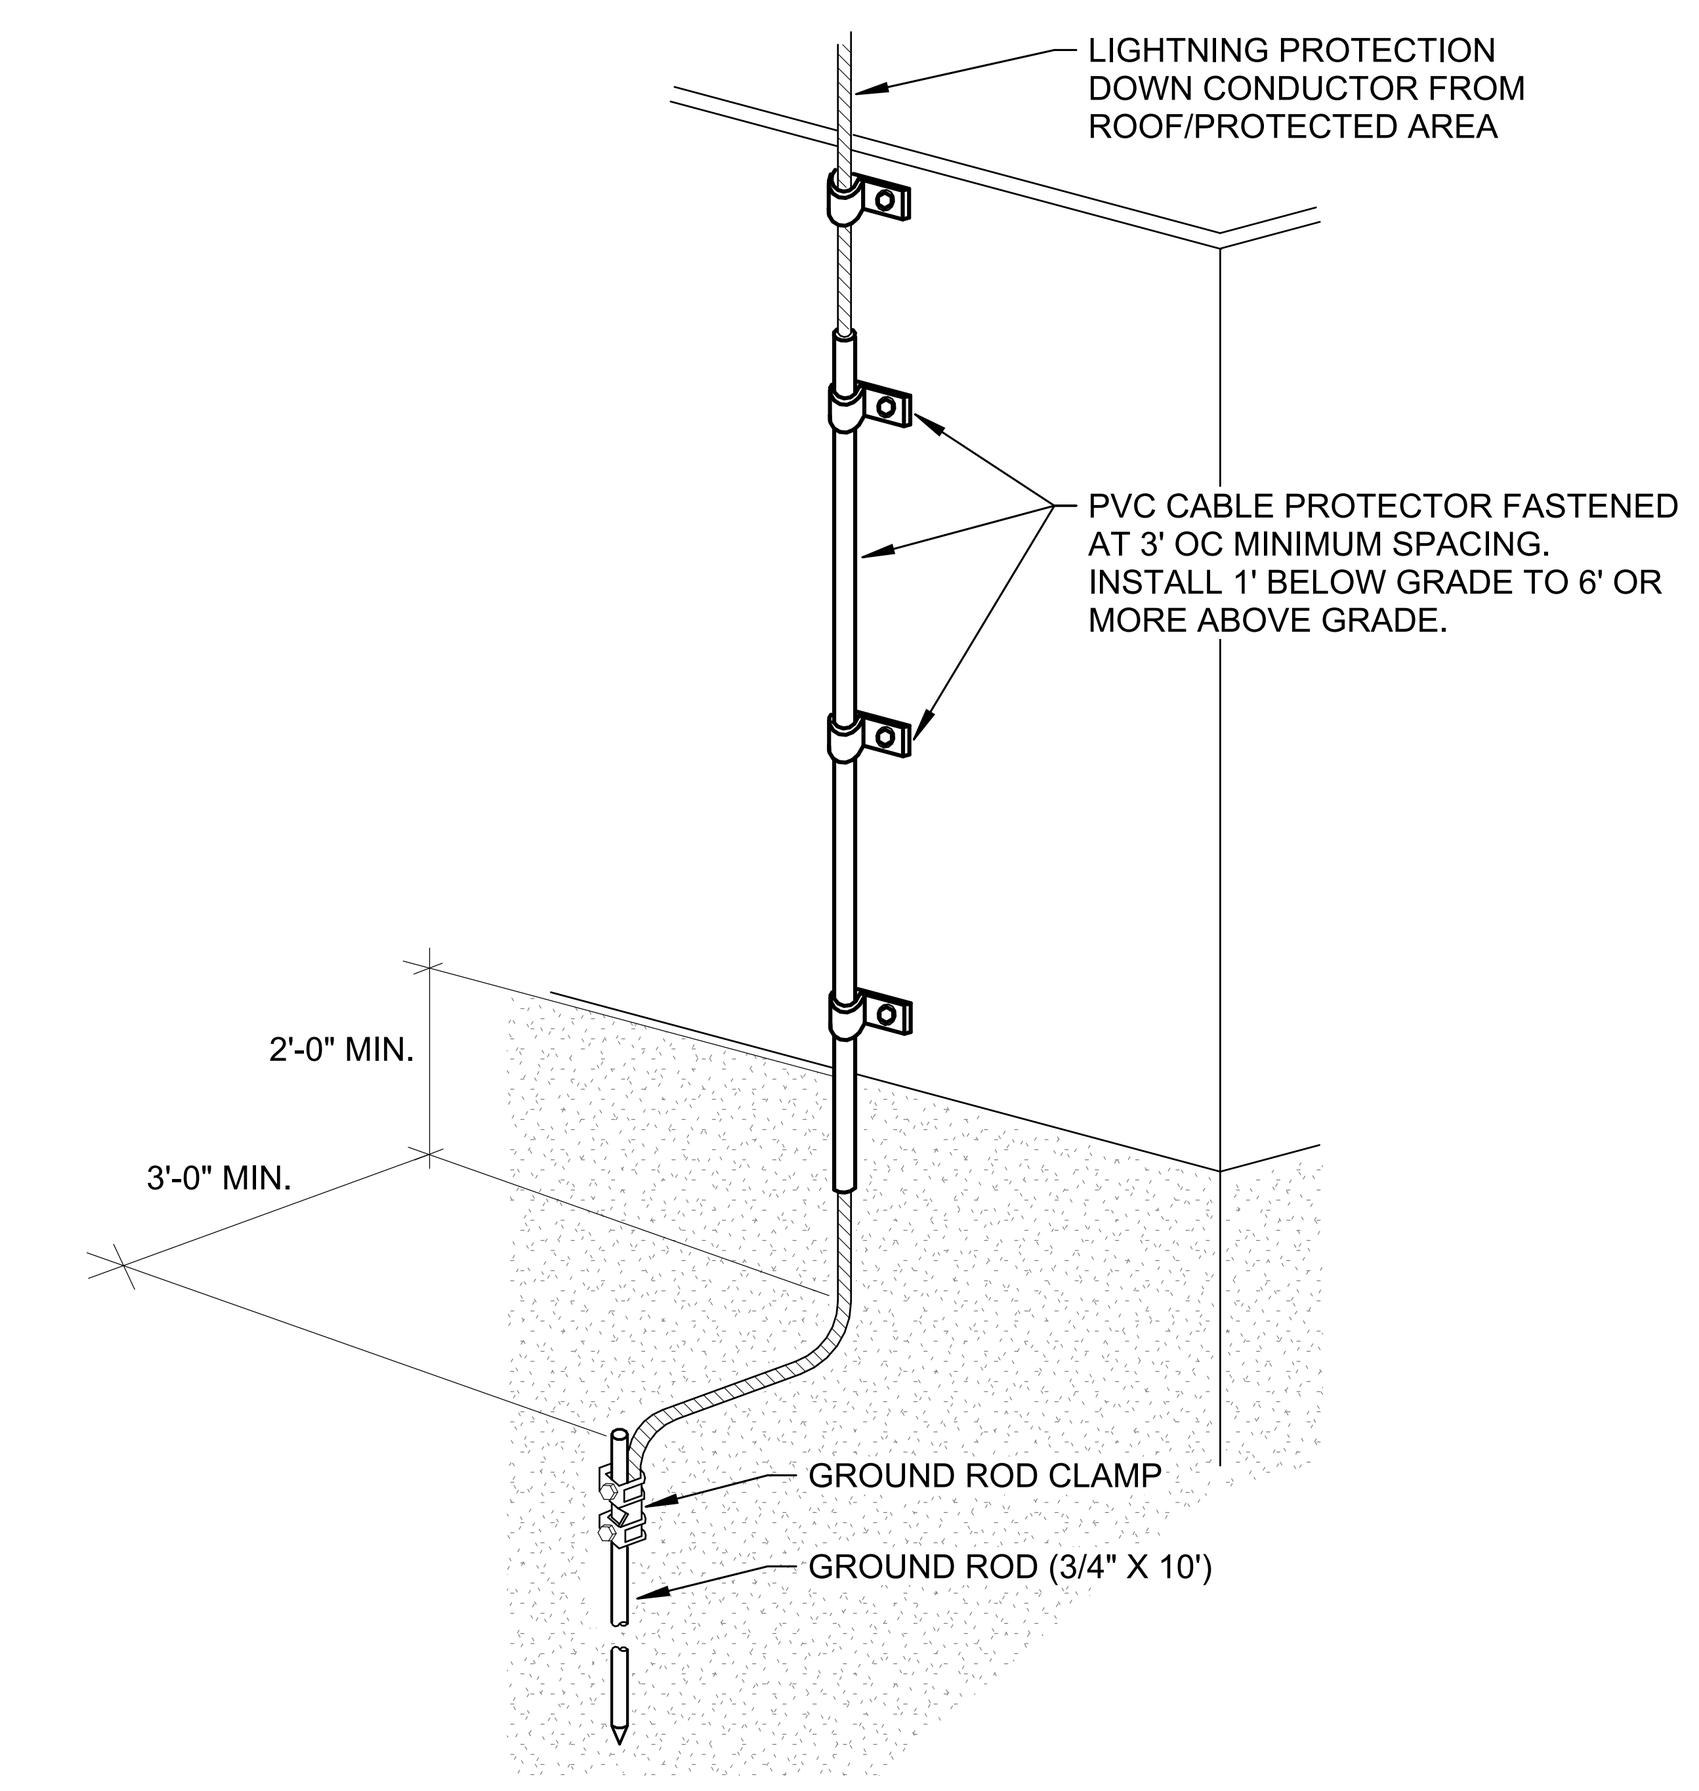

1 TYPICAL DOWNLEAD AND GROUND ROD
Scale: No Scale

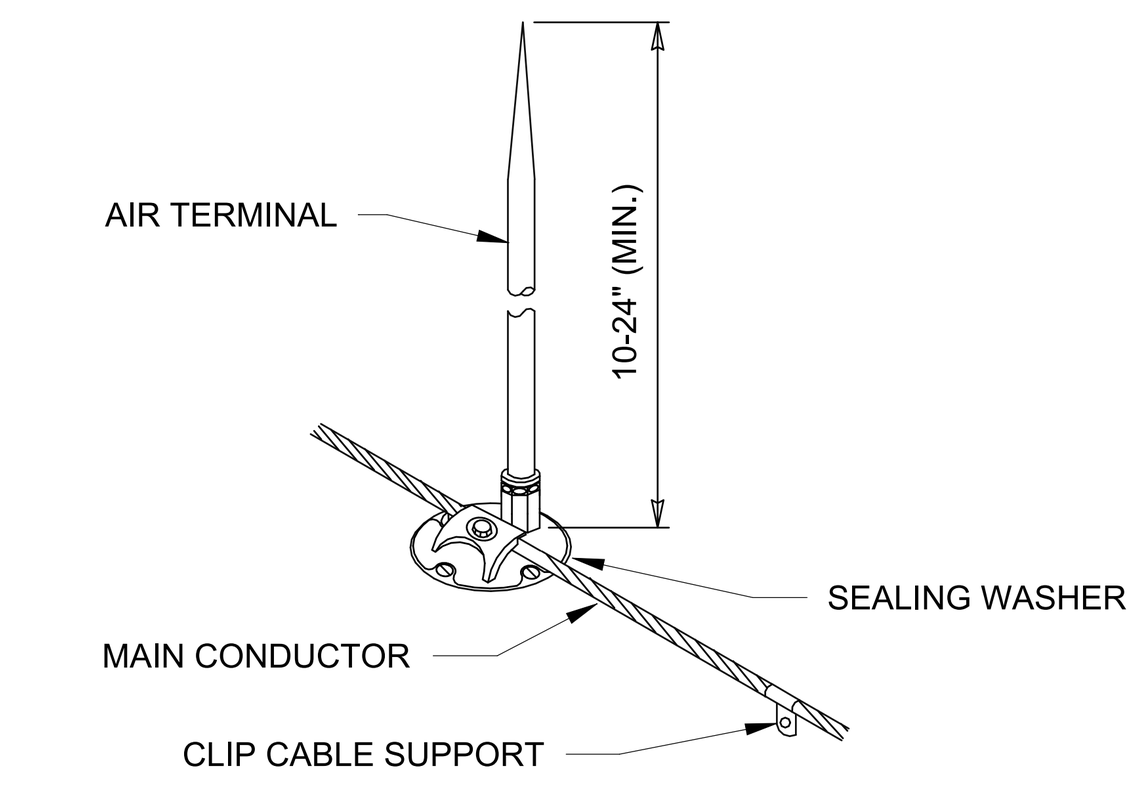

NOTES:

1. SEE SHEET E-001 FOR LEGEND.
2. ALL SPLICES BELOW GRADE SHALL BE THE EXOTHERMIC WELD TYPE.
3. AIR TERMINALS SHALL EXTEND NO LESS THAN 10 INCHES ABOVE THE ROOF OR EQUIPMENT BEING PROTECTED.
4. ALL METAL EQUIPMENT ON THE ROOF SHALL BE BONDED TO THE LIGHTNING PROTECTION SYSTEM.
5. THRU ROOF FLASHING SHALL BE COPPER WITH 8 INCH ROUND BASE AND VERTICAL TUBE WITH NEOPRENE SEAL. FLASHING SHALL BE THE PRODUCT OF THE MANUFACTURER OF THE LIGHTNING PROTECTION SYSTEM. A MEMBRANE FLASHING SHALL BE PROVIDED OVER THE THRU ROOF FLASHING.

7 LIGHTNING PROTECTION AIR TERMINAL
Scale: No Scale

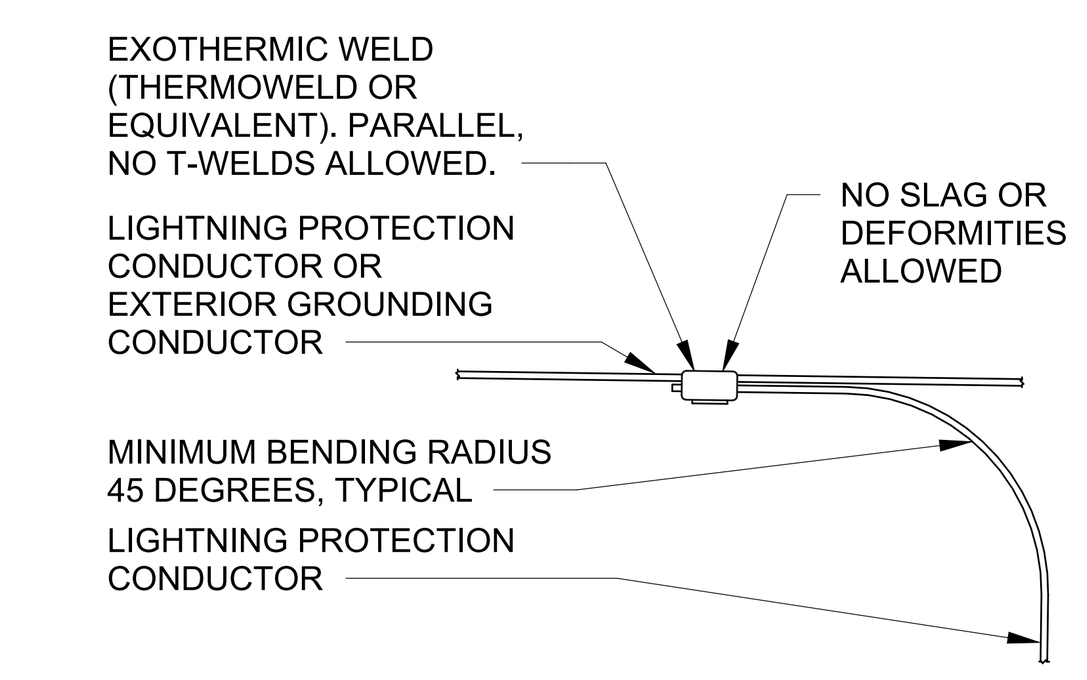

2 EXOTHERMIC WELD - WIRE TO WIRE
Scale: No Scale

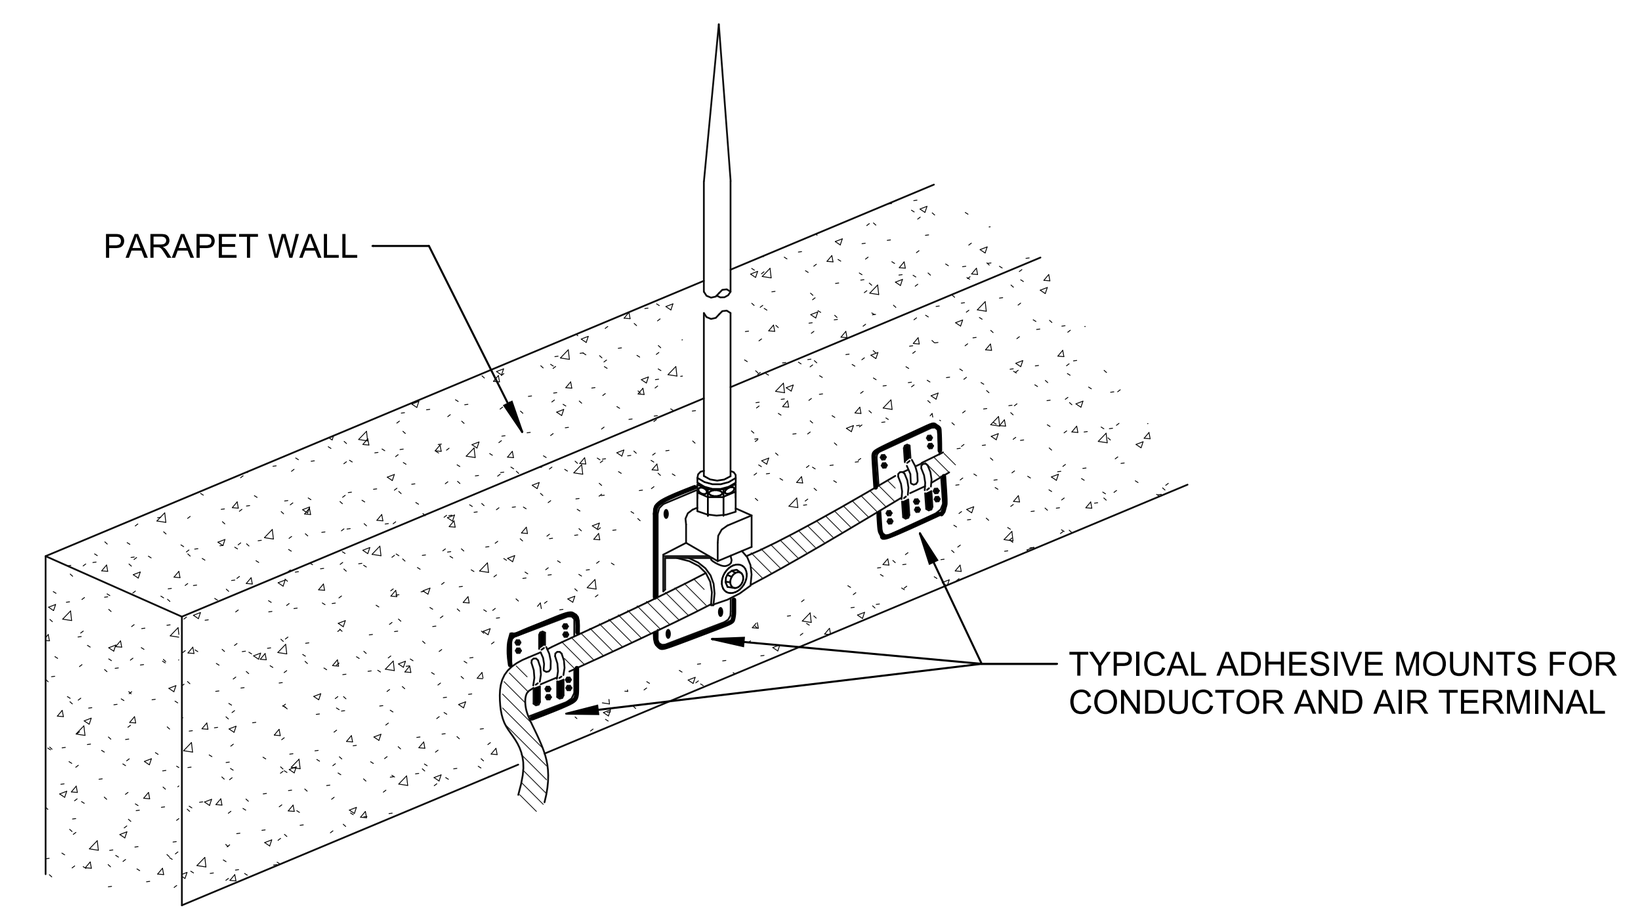

12 LIGHTNING PROTECTION AIR TERMINAL
Scale: No Scale

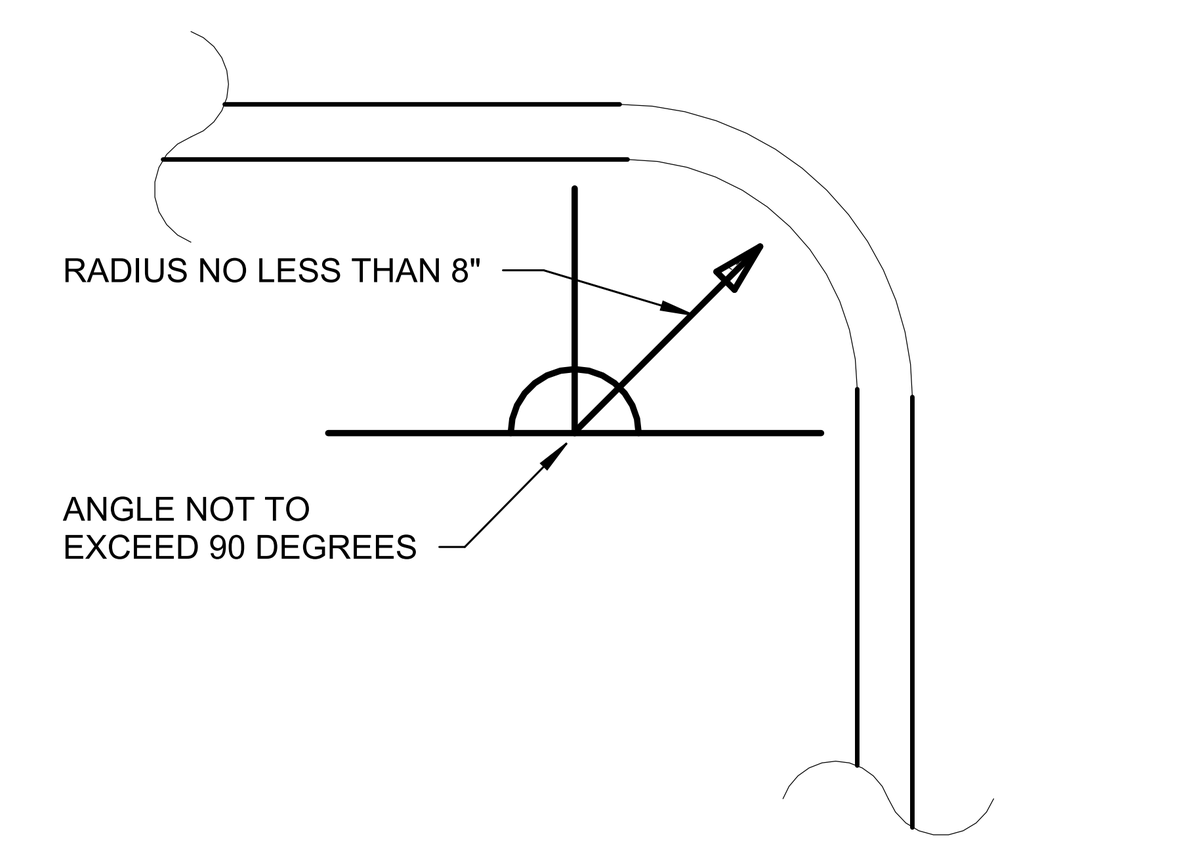

11 BONDING CONDUCTOR BEND RADIUS
Scale: No Scale

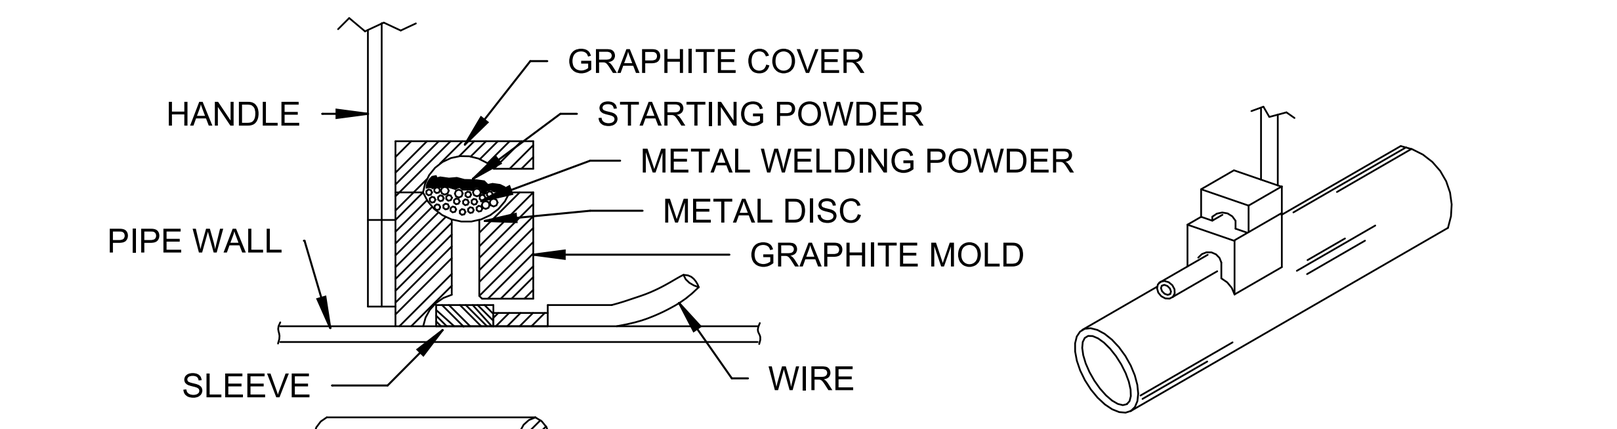

STEP 1.	FILE STRUCTURE CONNECTION AREA (3 IN. X 3 IN. MIN) TO BARE SHINY METAL AND CLEAN.
STEP 2.	STRIP INSULATION FROM WIRE, ATTACH SLEEVE (REQUIRED ON NO. 4 AWG WIRE AND SMALLER).
STEP 3.	HOLD MOLD FIRMLY WITH OPENING AWAY FROM OPERATOR AND IGNITE WITH FLINT GUN.
STEP 4.	REMOVE SLAG FROM CONNECTION AND PEEN WELD FOR SOUNDNESS.
STEP 5.	COVER CONNECTION AND EXPOSED STRUCTURE SURFACE WITH AN EPOXY COATING.

NOTES

1. ALL CABLES WELDS SHALL BE MINIMUM 3 INCHES APART.
2. STANDARD WELD CARTRIDGES SHALL BE USED FOR STEEL SURFACES. FOR DIP USE XF-19 WELD CARTRIDGES.

3 EXOTHERMIC WELD DETAIL
Scale: No Scale

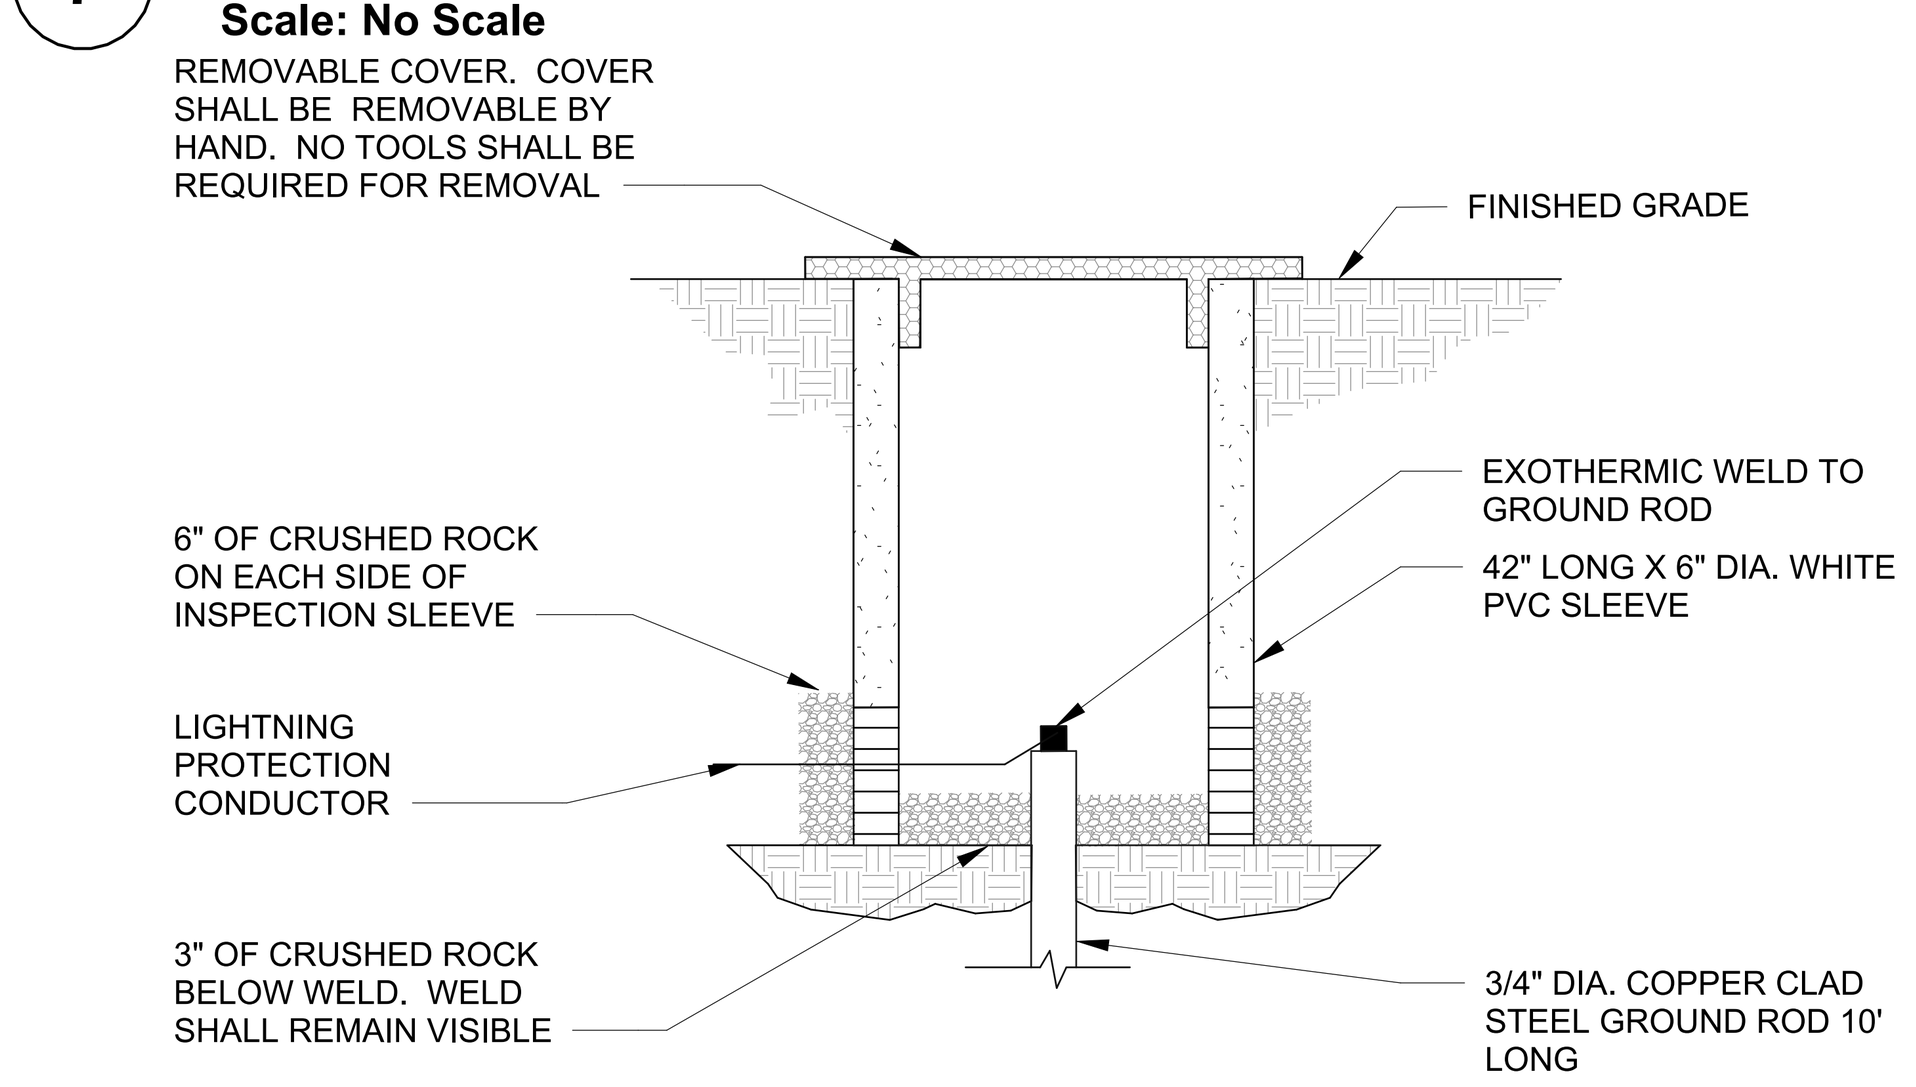

8 GROUND TEST WELL
Scale: No Scale

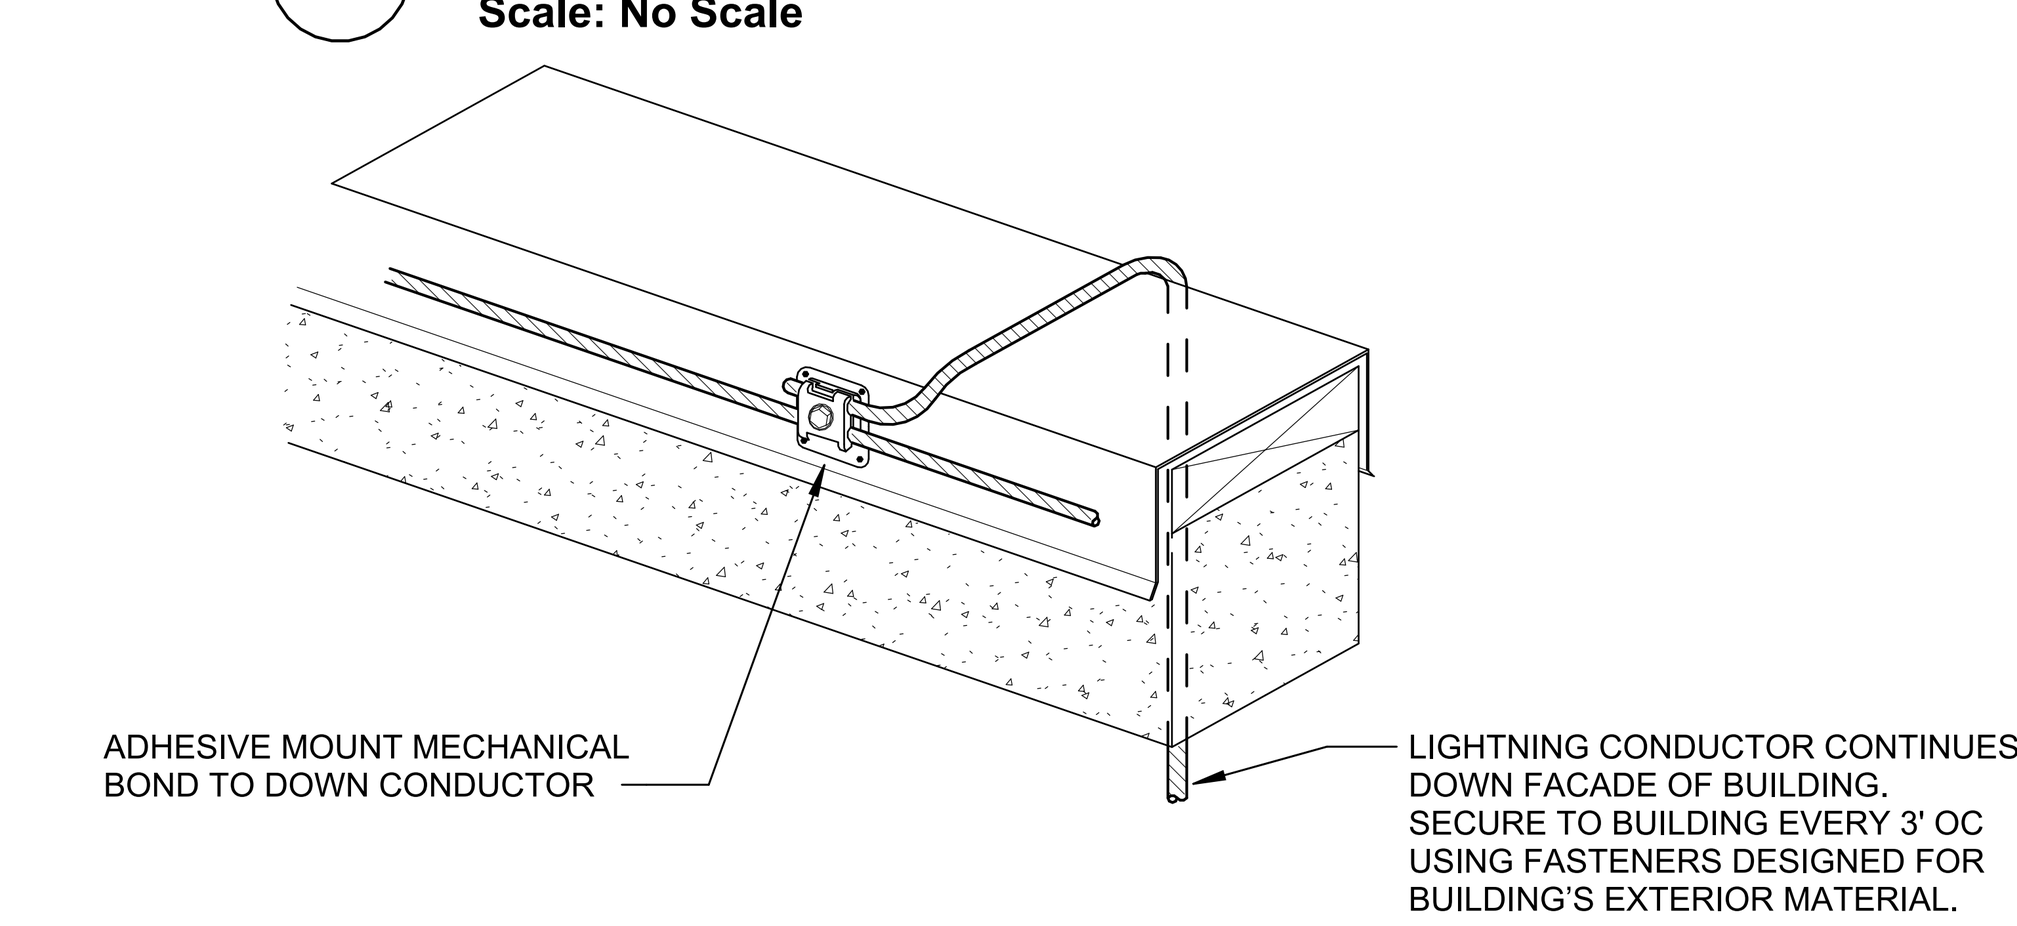

4 TYPICAL LOOP OVER TO DOWN CONDUCTOR
Scale: No Scale

System No. C-AJ-1001
June 15, 2005
F Rating - 3 Hr
T Rating - 0 Hr
W Rating - Class I (See Item 4)

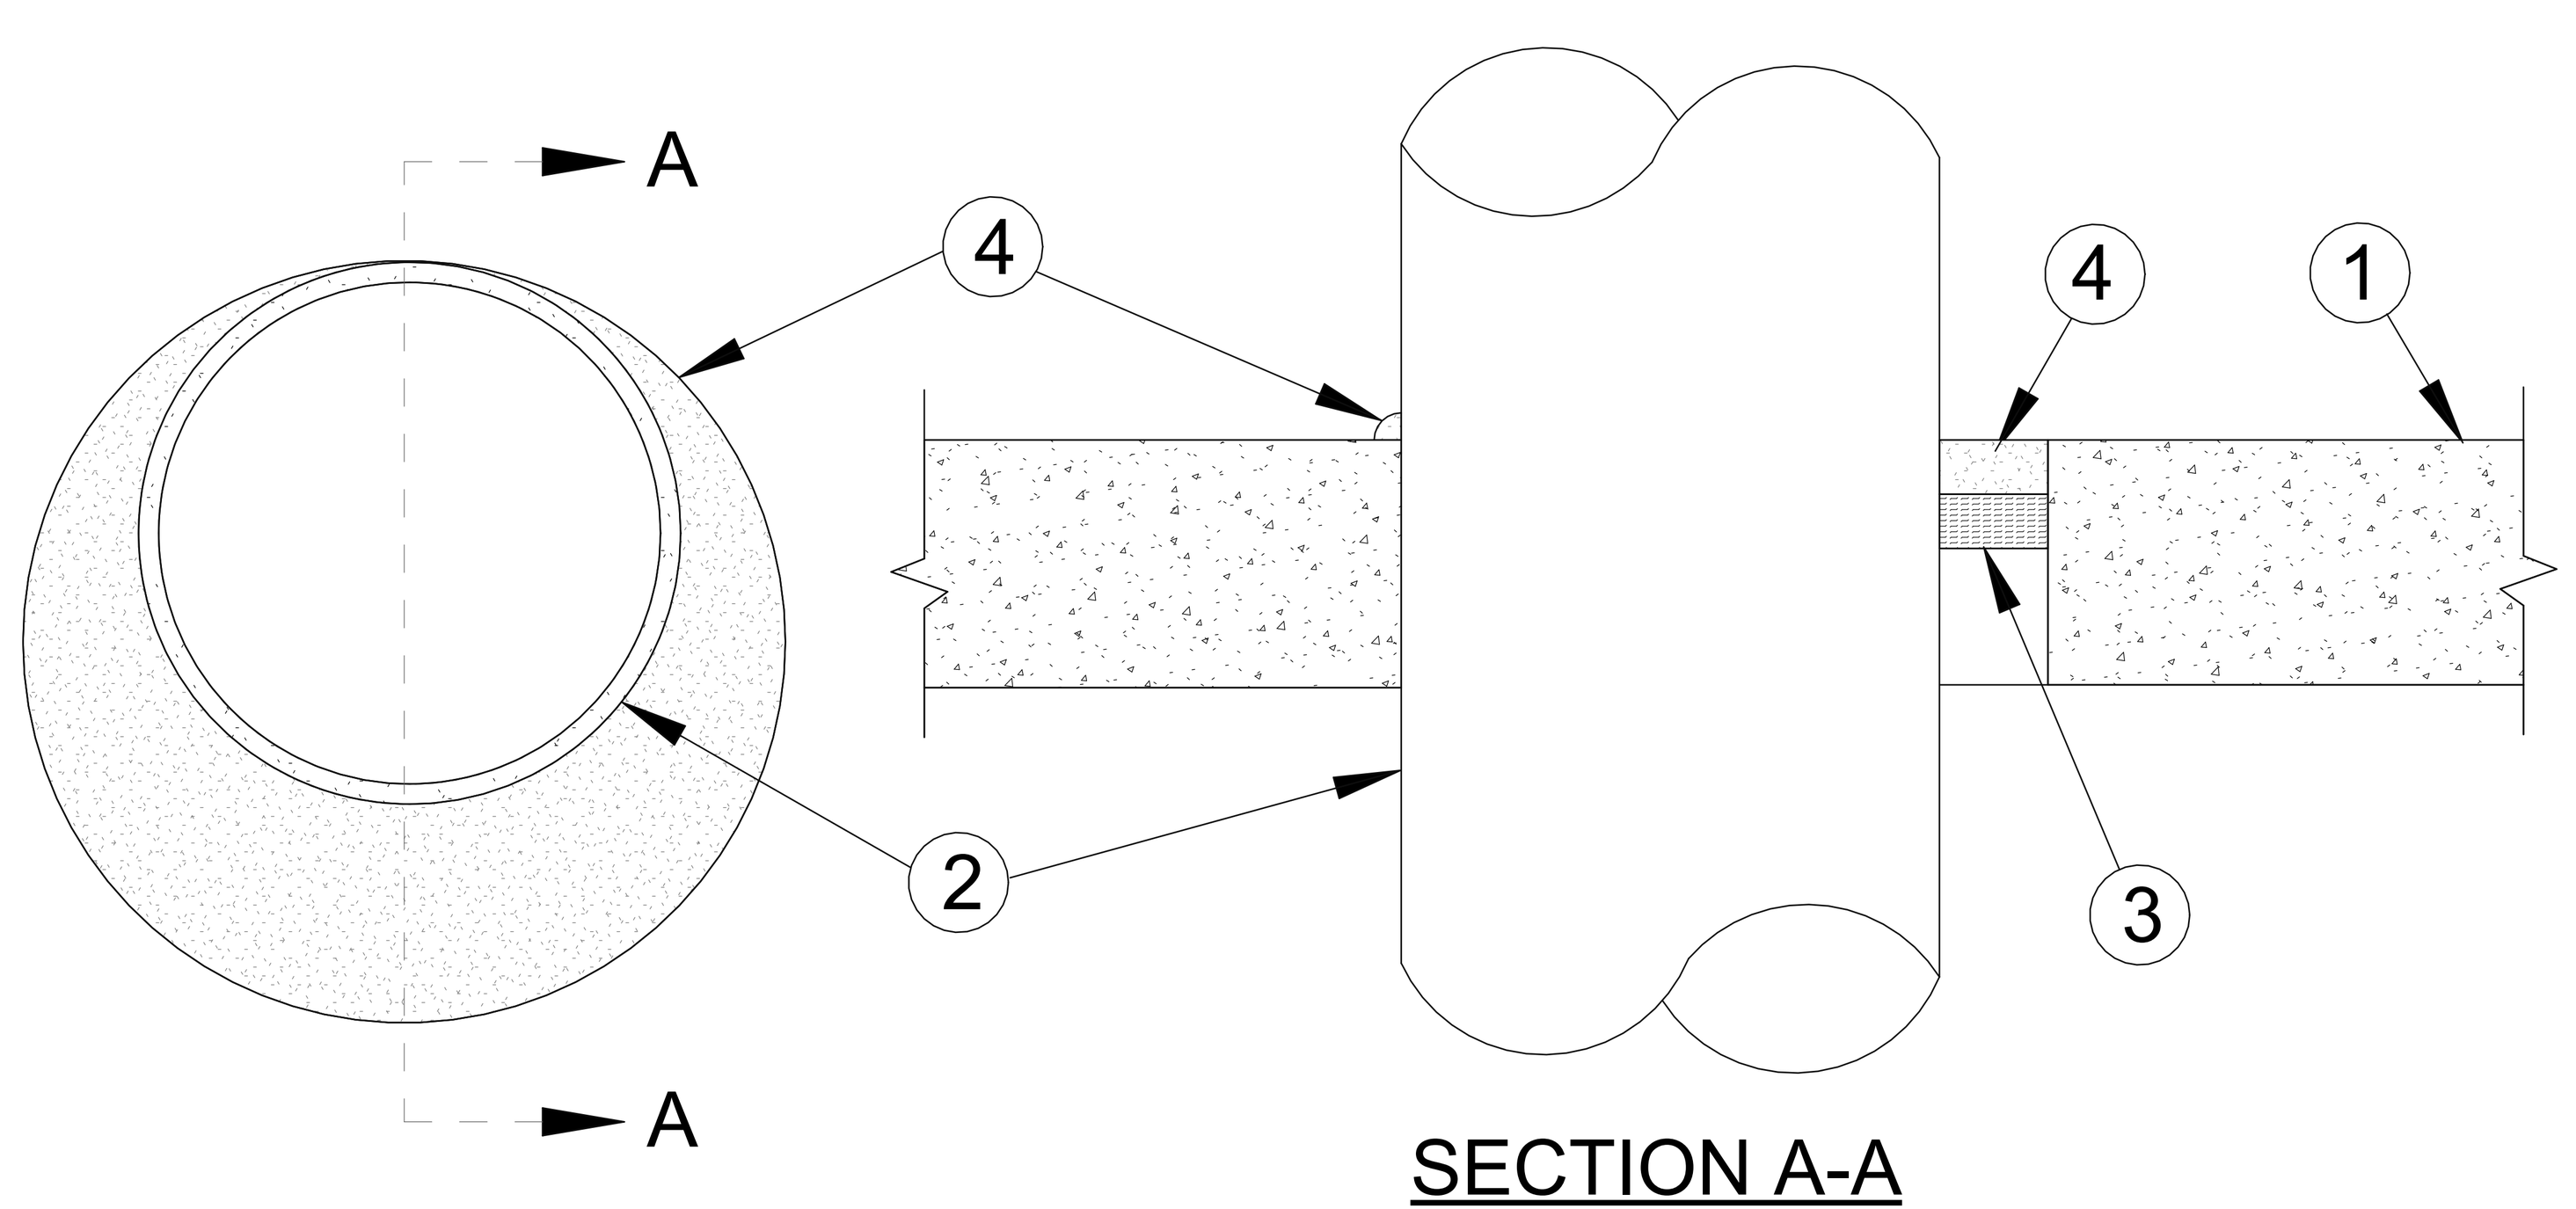

SECTION A-A

1. FLOOR OR WALL ASSEMBLY - MIN 4-1/2 IN. (114 MM) THICK LIGHTWEIGHT OR NORMAL WEIGHT (100-150 PCF OR 1600-2400 KG/M3) CONCRETE. WALL MAY ALSO BE CONSTRUCTED OF ANY UL CLASSIFIED **CONCRETE BLOCKS***. MAX DIAM OF CIRCULAR THROUGH OPENING IS 32-1/2 IN. (826 MM).

SEE **CONCRETE BLOCKS** (CAZT) CATEGORY IN THE FIRE RESISTANCE DIRECTORY FOR NAMES OF MANUFACTURERS.

1A. STEEL SLEEVE (OPTIONAL, NOT SHOWN) - NOM 12 IN. (305 MM) DIAM (OR SMALLER) SCHEDULE 40 (OR HEAVIER) STEEL PIPE SLEEVE CAST INTO CONCRETE FLOOR OR WALL. SLEEVE TO BE FLUSH WITH OR PROJECT MAX 2 IN. (51MM) FROM TOP SURFACE OF FLOOR OR FROM BOTH SURFACES OF WALL.

2. THROUGH PENETRANT - ONE METALLIC PIPE, CONDUIT OR TUBING INSTALLED EITHER CONCENTRICALLY OR ECCENTRICALLY WITHIN THE FIRESTOP SYSTEM. THE ANNULAR SPACE BETWEEN PIPE, CONDUIT OR TUBING AND PERIPHERY OF OPENING SHALL BE MIN OF 0 IN. (0 MM)(POINT CONTACT) TO MAX 1-3/8 IN. (35 MM). PIPE, CONDUIT OR TUBING TO BE RIGIDLY SUPPORTED ON BOTH SIDES OF WALL ASSEMBLY. THE FOLLOWING TYPES AND SIZES OF METALLIC PIPES, CONDUITS OR TUBING MAY BE USED:

- **A. STEEL PIPE** - NOM 30 IN. (762 MM) DIAM (OR SMALLER) SCHEDULE 10 (OR HEAVIER) STEEL PIPE.
- **A1. IRON PIPE** - NOM 30 IN. (762 MM) DIAM (OR SMALLER) CAST OR DUCTILE IRON PIPE.
- **B. CONDUIT** - NOM 6 IN. (152 MM) DIAM (OR SMALLER) RIGID STEEL CONDUIT.
- **C. CONDUIT** - NOM 4 IN. (102 MM) DIAM (OR SMALLER) STEEL ELECTRICAL METALLIC TUBING.

3. PACKING MATERIAL - POLYETHYLENE BACKER ROD OR NOM 1 IN. (25 MM) THICKNESS OF TIGHTLY-PACKED CERAMIC (ALUMINA SILICA) FIBER BLANKET, MINERAL WOOL BATT OR GLASS FIBER INSULATION MATERIAL USED AS A PERMANENT FORM. PACKING MATERIAL TO BE RECESSED FROM TOP SURFACE OF FLOOR OR FROM BOTH SURFACES OF SOLID CONCRETE OR CONCRETE BLOCK WALL AS REQUIRED TO ACCOMMODATE THE REQUIRED THICKNESS OF CAULK FILL MATERIAL (ITEM 4). AS AN ALTERNATE WHEN MAX PIPE SIZE IS 10 IN. (254 MM) DIAM AND WHEN MAX ANNULAR SPACE IS 1 IN. (25 MM), A MIN 1 IN. (25 MM) THICKNESS OF TIGHTLY-PACKED CERAMIC FIBER BLANKET OR MINERAL WOOL BATT PACKING MATERIAL MAY BE RECESSED MIN 1/2 IN. (13 MM) FROM BOTTOM SURFACE OF FLOOR OR FROM EITHER SIDE OF SOLID CONCRETE WALL.

4. FILL,VOID OR CAVITY MATERIALS* - CAULK OR SEALANT - APPLIED TO FILL THE ANNULAR SPACE TO THE MIN THICKNESS SHOWN IN THE FOLLOWING TABLE:

MAX PIPE DIAM IN. (MM)	MAX ANNULAR SPACE IN. (MM)	PACKING MATL TYPE (a)	MIN. CAULK THKNS IN. (MM)
10 (254)	1 (25)	BR, CF, GF OR MW	1/2 (13) (b)
10 (254)	1 (25)	CF OR MW	1/2 (13) (c)
30 (762)	2-1/2 (64)	BR, CF, GF OR MW	1 (25) (b)

(A) BR = POLYETHYLENE BACKER ROD.
CF = CERAMIC FIBER BLANKET.
GF = GLASS FIBER INSULATION.
MW = MINERAL-WOOL BATT.
(B) CAULK INSTALLED FLUSH WITH TOP SURFACE OF FLOOR OR BOTH SURFACES OF WALL.
(C) CAULK INSTALLED FLUSH WITH BOTTOM SURFACE OF FLOOR OR ONE SURFACE OF SOLID (NON-CONCRETE BLOCK) WALL.

3M COMPANY - CP 25WB+ CAULK OR FB-3000 WT SEALANT.
(NOTE: W RATING APPLIES ONLY WHEN FB-3000 WT SEALANT IS USED.)

*BEARING THE UL CLASSIFICATION MARKING

14 UL PENETRATION DETAIL C-AJ-1001
Scale: No Scale

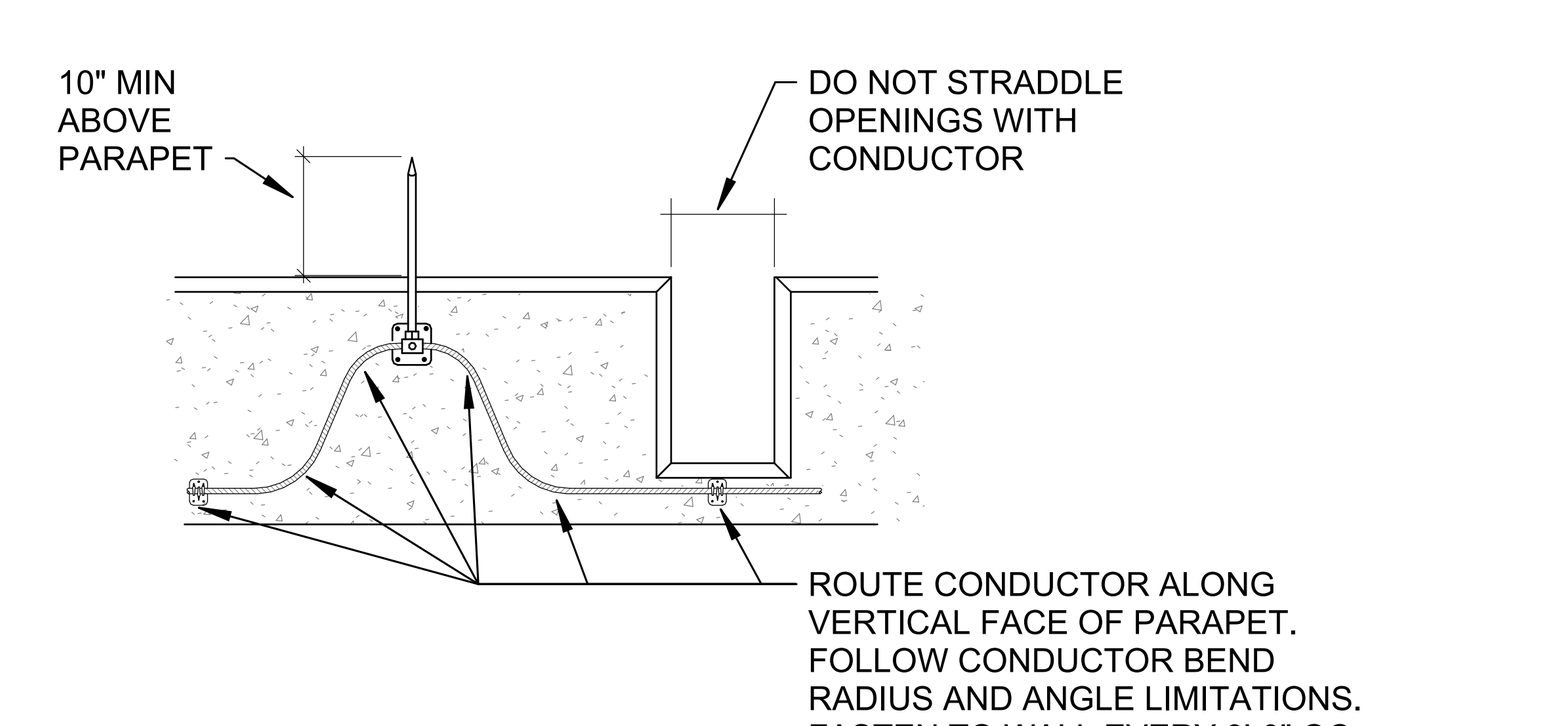

9 LPS CONDUCTOR ROUTING ALONG PARAPET
Scale: No Scale

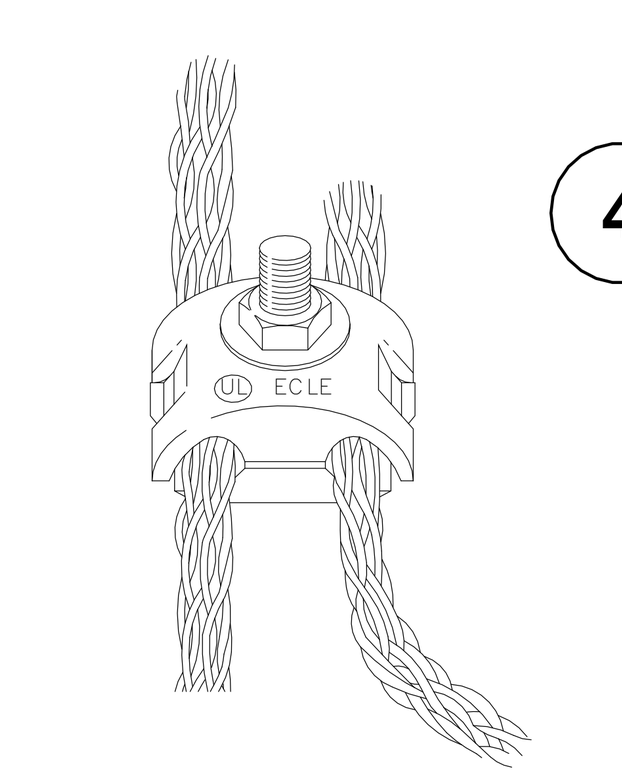

5 LIGHTNING PROTECTION MECHANICAL BOND
Scale: No Scale

CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

ALABAMA LICENSED No. 39881-E PROFESSIONAL ENGINEER KEVIN TODD KUBL 6/21/2024

PROJECT MANAGER
ACG Project Number 23-069

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: LIGHTNING PROTECTION DETAILS
Project Title: REPLACE ROOFS IN BLDGS. 19, 20, 50, 51, AND 62
VA PROJECT NUMBER: 619A4-24-102
Building Number: #
Location: CENTRAL ALABAMA VETERANS HEALTH CARE SYSTEM, 2400 HOSPITAL ROAD, TUSKEGEE, AL 36083
Approved:
Drawing Number: E-501
Date: JUNE 19, 2024 | Checked: KTK | Drawn: WSR
Dwg 6 of 6