THE VETERANS AFFAIRS SAINT LOUIS HEALTH CARE SYSTEM (VASTLHCS)

NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259

915 GRAND BLVD.
SAINT LOUIS, MISSOURI 63106

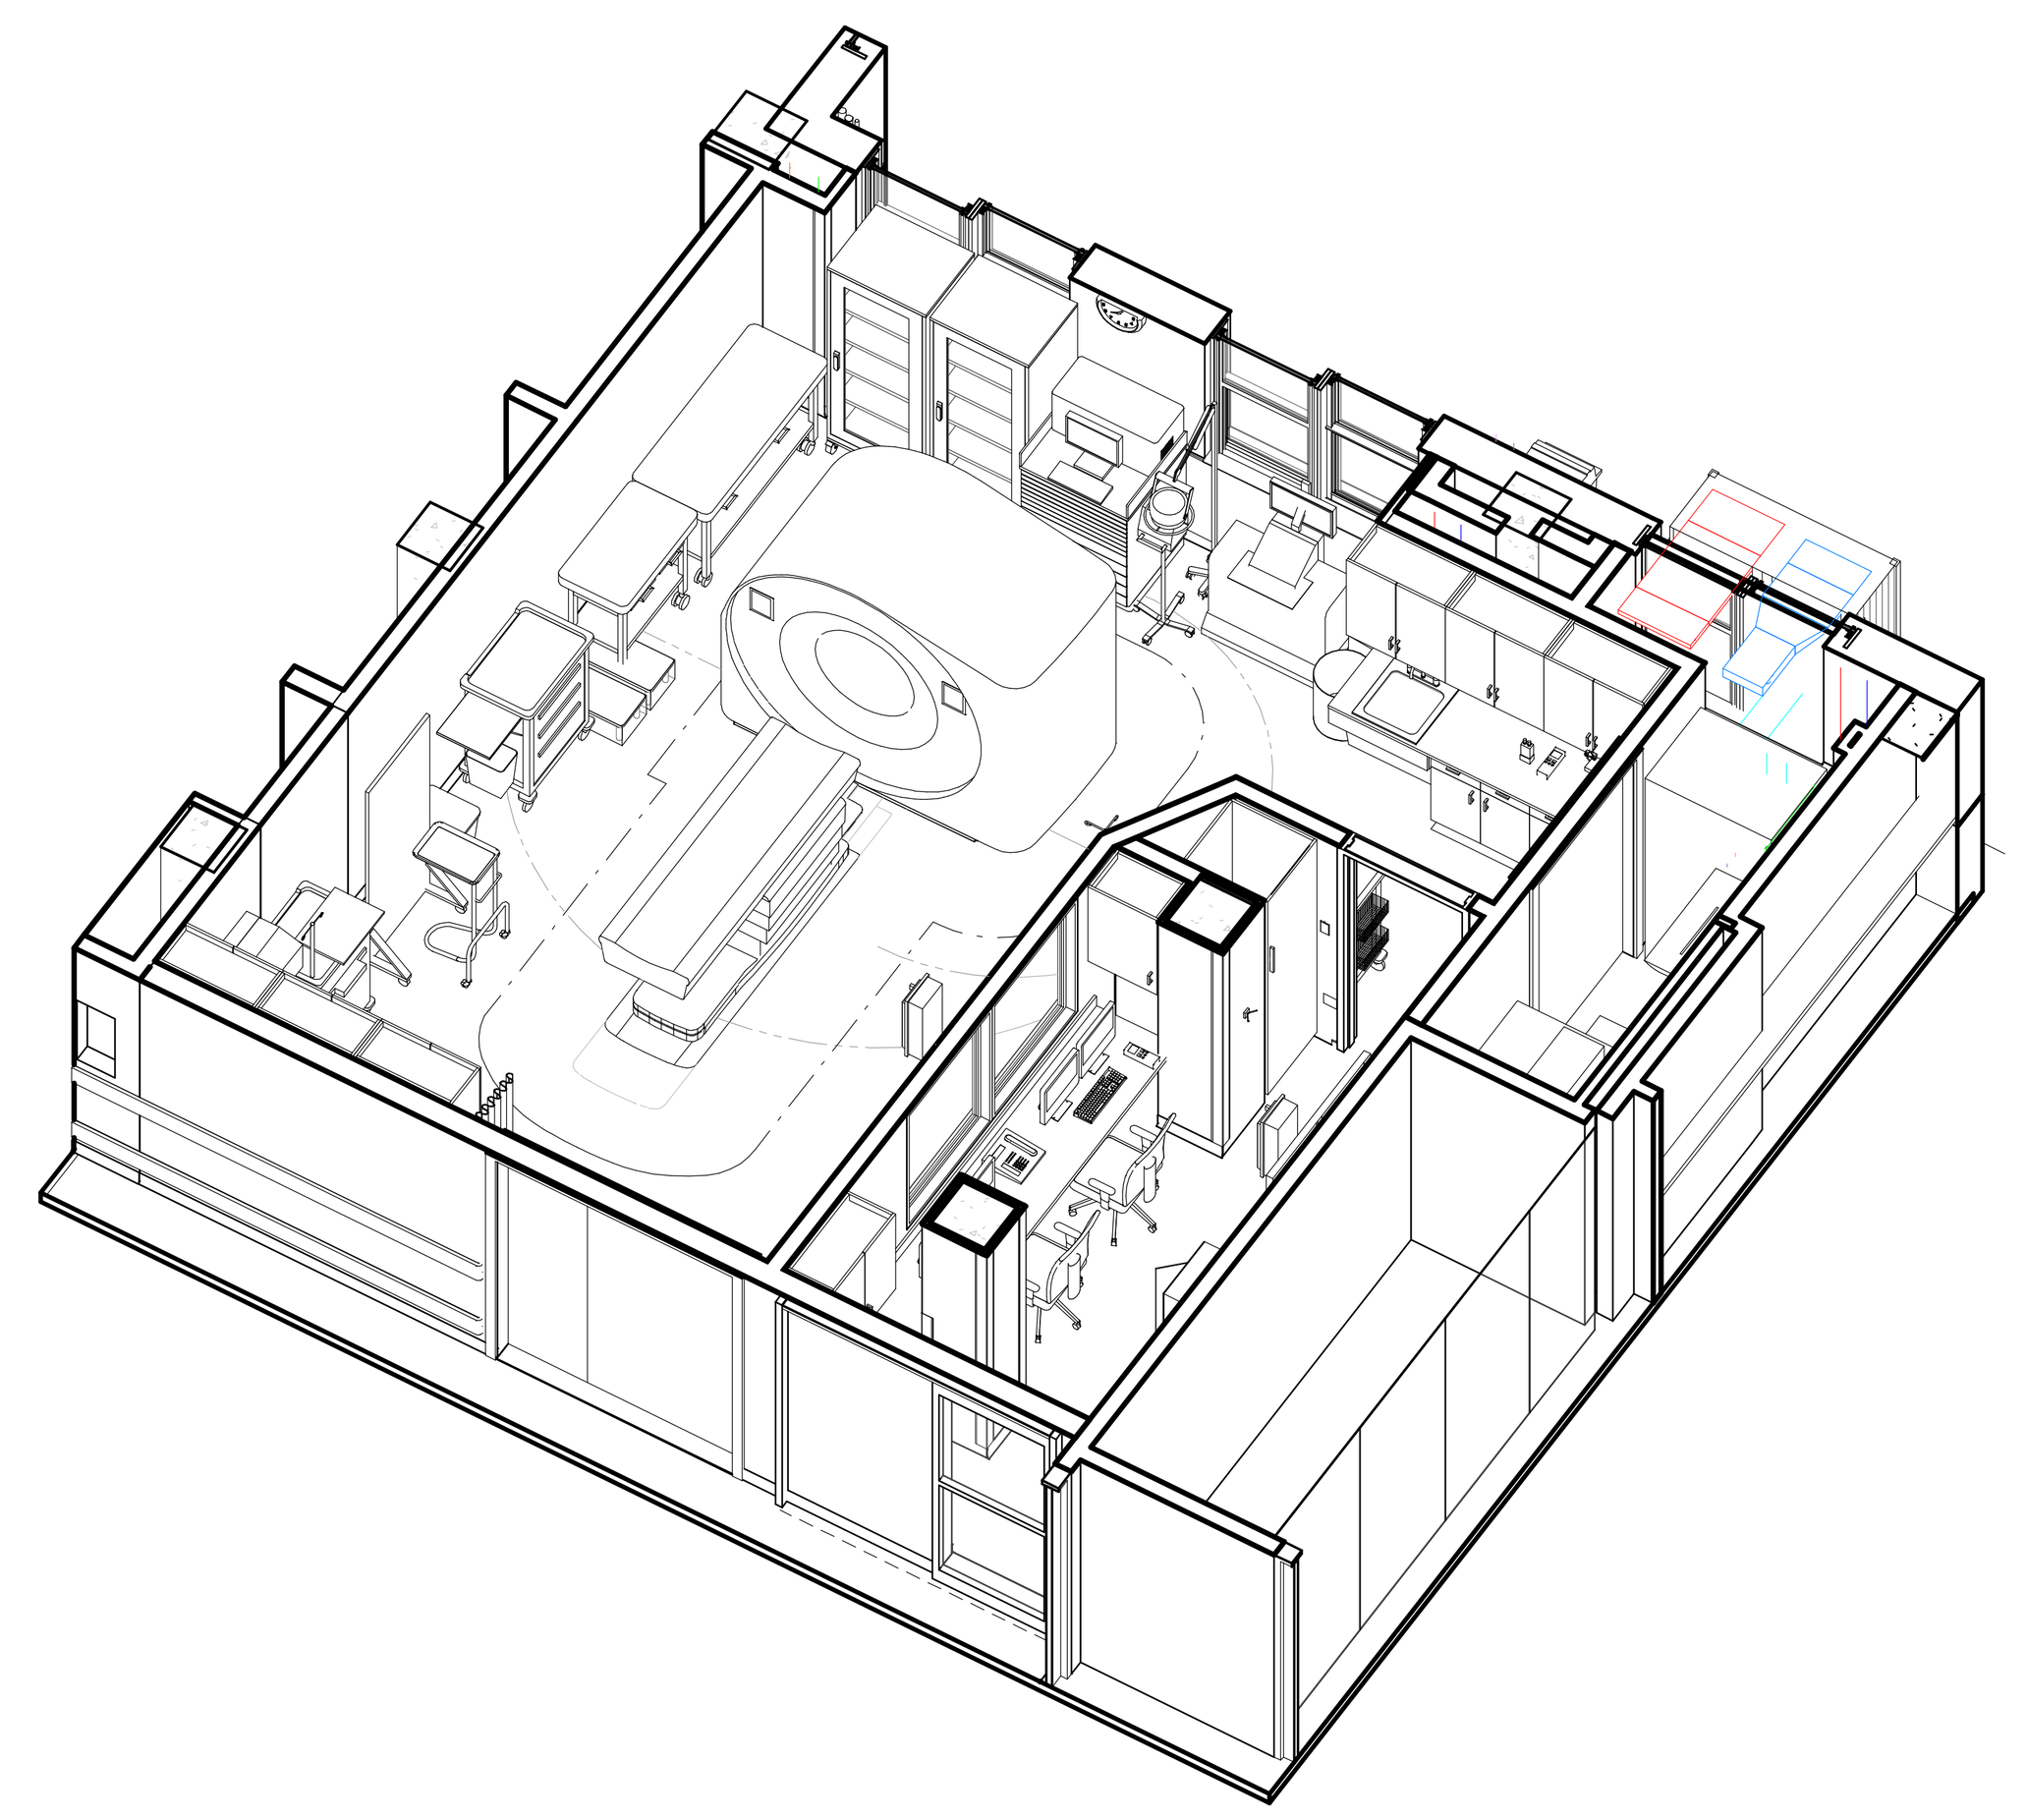

SITE MAP

PROJECT LOCATION

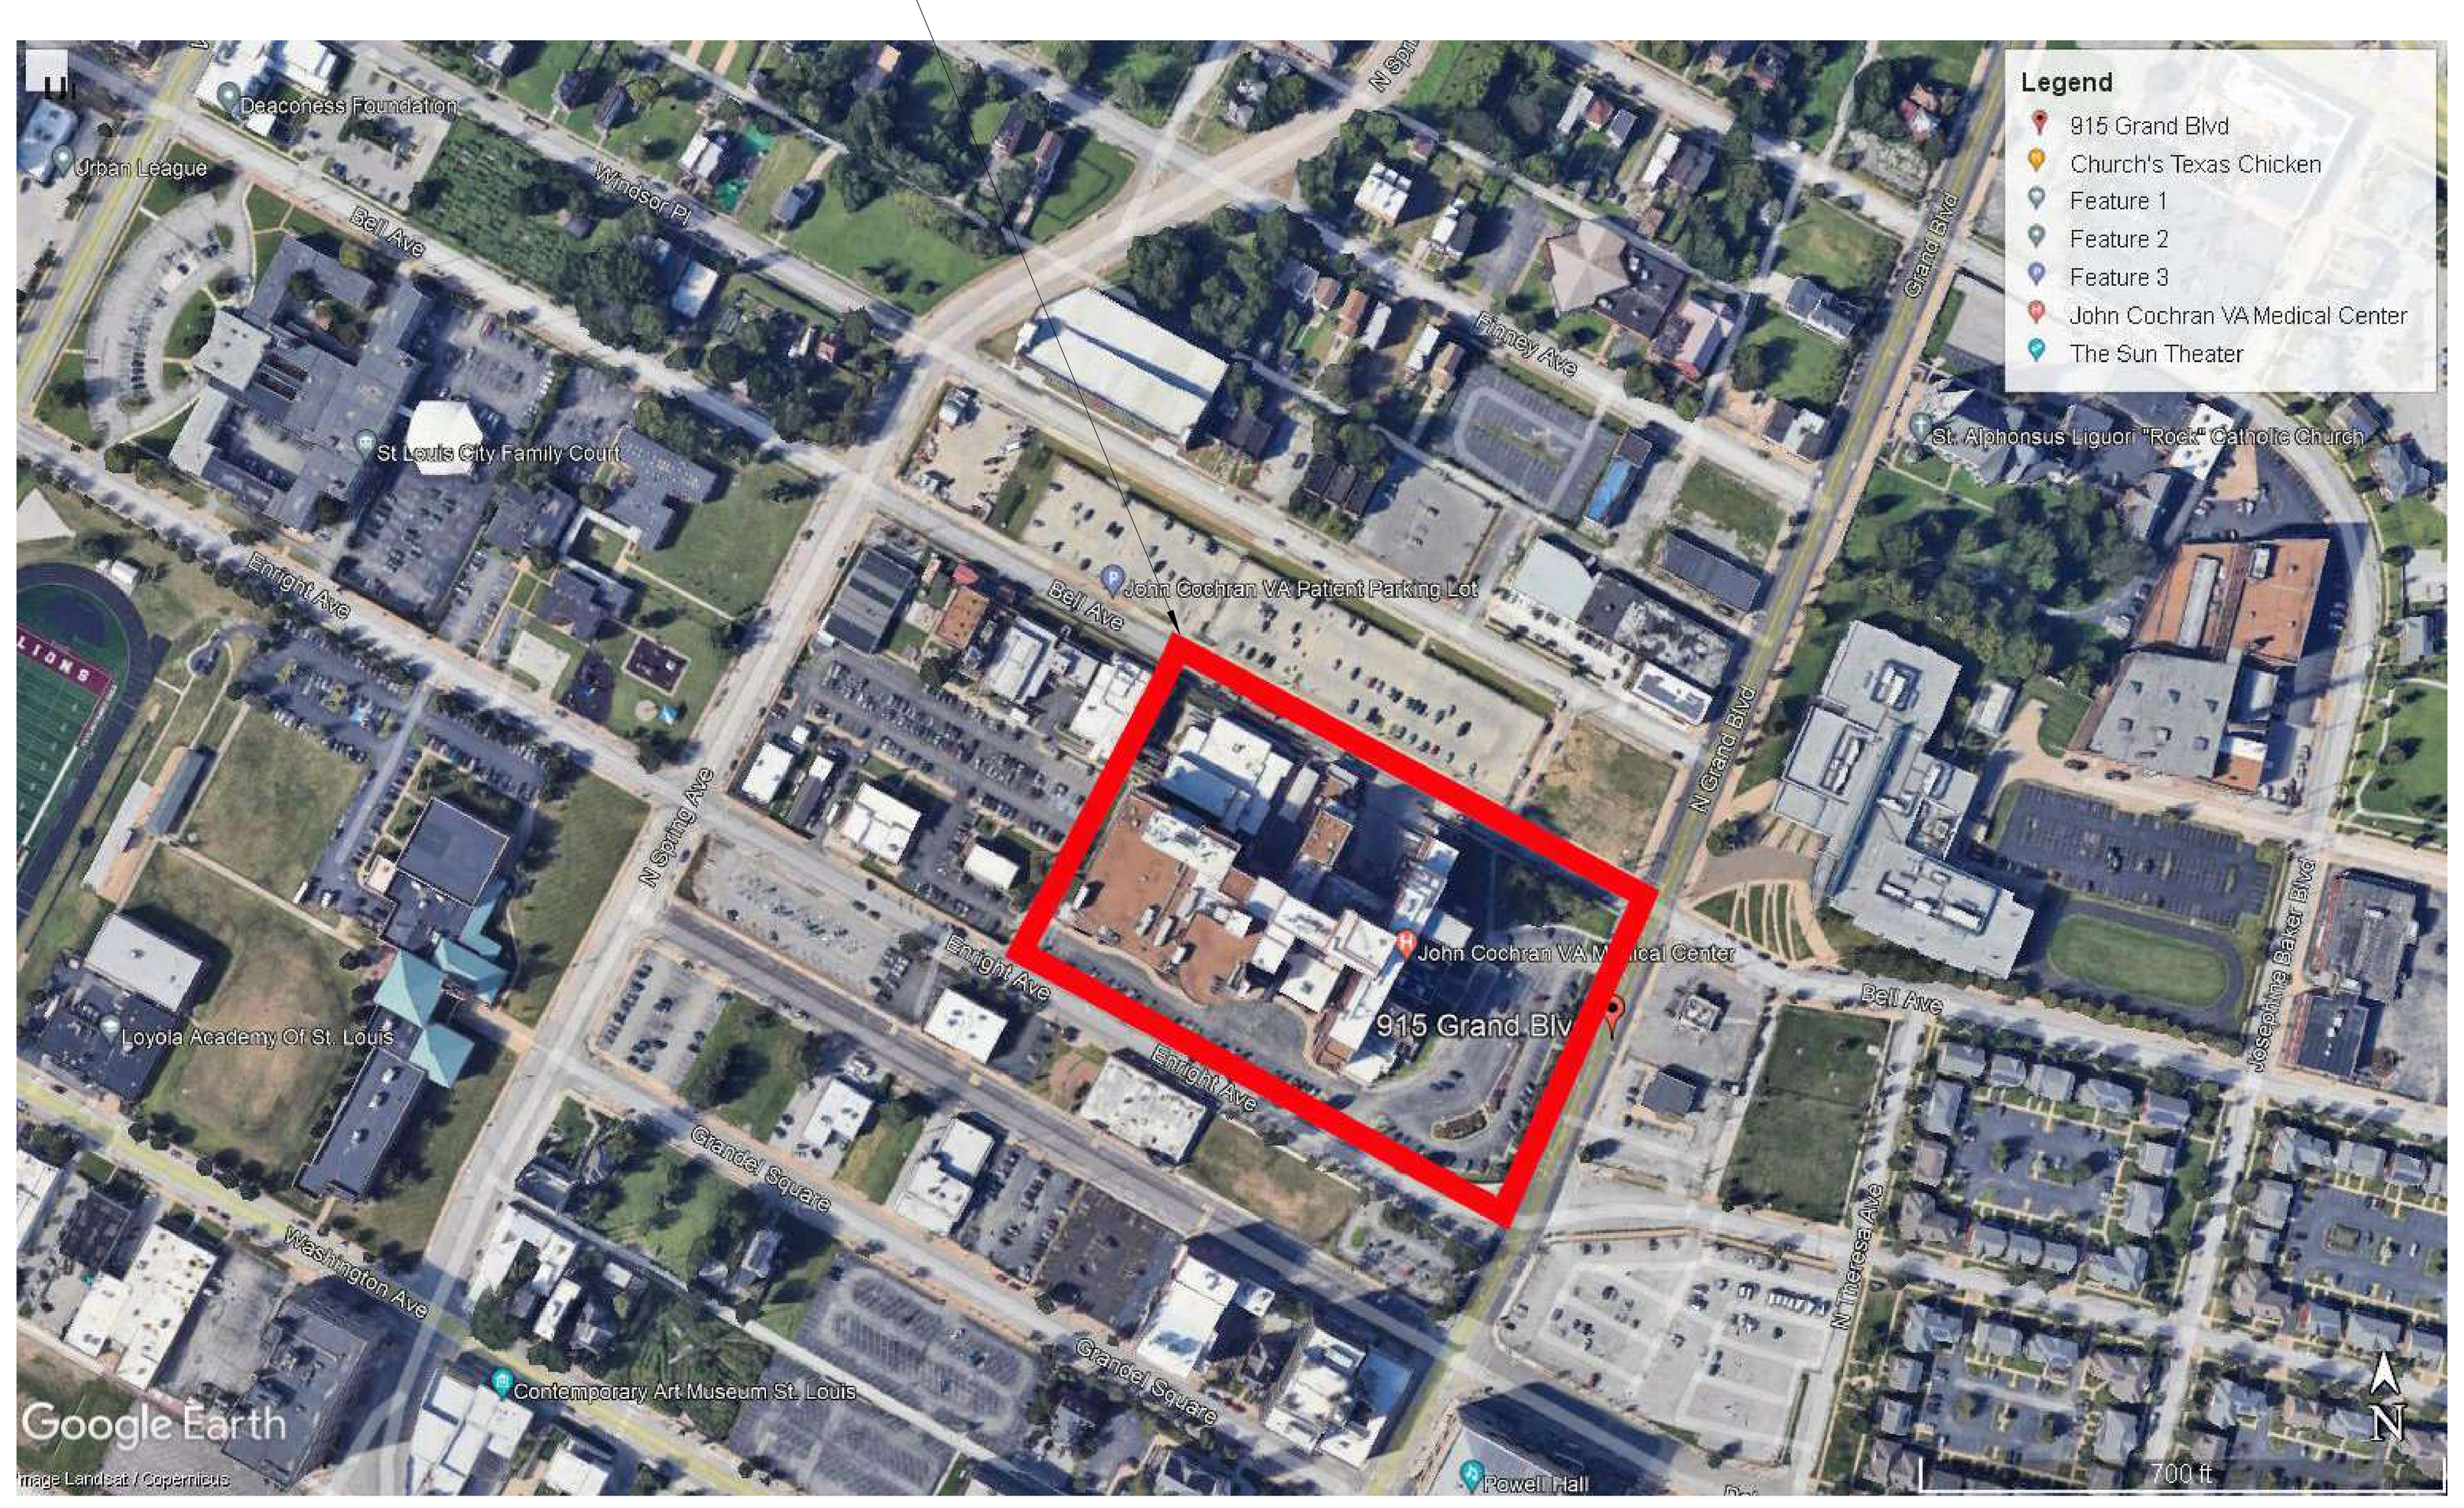

SYMBOLS

CONSTRUCTION SUBSYSTEM (00)	REFERS TO A TYPICAL ASSEMBLY
BUILDING WALL SECTION (1 / A101, SIM)	LOCATION ON DRAWING SHEET; SHEET DETAIL IS LOCATED
ELEVATION (1 / A101)	ARROW INDICATES DIRECTION OF ELEVATION; SHEET LOCATION WHERE ELEVATION IS LOCATED
INTERIOR ELEVATION (A101)	NUMBER INDICATES ELEVATION ON SHEET; SHEET LOCATION WHERE ELEVATION IS LOCATED
PLAN & SECTION DETAIL REFERENCE (1 / A101)	LOCATION ON DRAWING SHEET; LOCATION ON DRAWING SHEET
REVISION	REVISIONS ARE SHOWN WITHIN "CLOUDED" AREA REVISION NUMBER & DATE WILL APPEAR IN TITLE BLOCK SPACE SO LABELED
ROOM NUMBER (Room name 101)	REFERS TO NUMBER ON FLOOR PLAN
DOORS (X)	REFERS TO NUMBER ON DOOR SCHEDULE, SEE SHEET **A401**
PARTITION TYPES	REFERS TO INTERIOR PARTITIONS, SEE SHEET **G004**
EXTERIOR AND INTERIOR WINDOWS (#)	REFERS TO FRAME TYPE, SEE ENLARGED ELEVATIONS ON SHEET **A402**
EXTERIOR AND INTERIOR STOREFRONT (SF 00)	REFERS TO FRAME TYPE, SEE ENLARGED ELEVATIONS ON SHEET **A402**
CONSTRUCTION NOTE (X)	REFERS TO CONSTRUCTION NOTES ON THAT SHEET
DEMOLITION NOTE (X)	REFERS TO DEMOLITION NOTES ON THAT SHEET
EXISTING GRID LINE (0)	REFERS TO EXISTING GRID LINES IN PROJECT
NEW GRID LINE (0)	REFERS TO NEW GRID LINES

SUBMISSION REVIEW LOG:

DIVISION	NAME		
☐ CONCUR	☐ DO NOT CONCUR	DATE	
DIVISION	NAME		
☐ CONCUR	☐ DO NOT CONCUR	DATE	
DIVISION	NAME		
☐ CONCUR	☐ DO NOT CONCUR	DATE	
DIVISION	NAME		
☐ CONCUR	☐ DO NOT CONCUR	DATE	
DIVISION	NAME		
☐ CONCUR	☐ DO NOT CONCUR	DATE	
DIVISION	NAME		
☐ CONCUR	☐ DO NOT CONCUR	DATE	
DIVISION	NAME		
☐ CONCUR	☐ DO NOT CONCUR	DATE	

DRAWING LIST

N
PROJECT NORTH
TRUE NORTH

Revisions:	Date:

CONSULTANT

Above Group
ENGINEERING DESIGN CONSULTING

Mabbett
Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects

THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP

STATE OF MISSOURI
RUSSELL DINARDO
NUMBER
A - 2024000203
ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
COVER SHEET	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
			Building Number 1
Approved:		**Location** 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	**Drawing Number** G001
		Issue Date 06 MARCH 2026 / **Checked** TB / **Drawn** PS	

ABBREVIATIONS:

A LABEL	CLASS A DOOR
A/C	AIR CONDITION
A/E	ARCHITECT/ENGINEER
ABV	ABOVE
ACT	ACOUSTICAL CEILING TILE
AD	AREA DRAIN
ADH	ADHESIVE
ADJ	ADJACENT
ADMIN	ADMINISTRATION
AFC	ABOVE FINISHED COUNTER
AFF	ABOVE FINISHED FLOOR
AHU	AIR HANDLING UNIT
ALT	ALTERNATE
ALUM	ALUMINUM
APPROX	APPROXIMATE
ARCH	ARCHITECT
ASB	ASBESTOS
ASPH	ASPHALT
ASSN	ASSOCIATION
AUTO	AUTOMATIC
AUX	AUXILIARY
BAT	BATTEN
BD	BOARD
BEV	BEVEL
BKG	BACKING
BLDG	BUILDING
BOT	BOTTOM
BTWN	BETWEEN
C TO C	CENTER TO CENTER
CAB	CABINET
CONC	CONCRETE
CIR	CIRCLE
CL	CENTER LINE
CLDG	CLADDING
CLG	CEILING
CLG HT	CEILING HEIGHT
CLR	CLEAR
CMU	CONCRETE MASONRY UNIT
CNTR	COUNTER
COL	COLUMN
CONC FLR	CONCRETE FLOOR
CONSTR	CONSTRUCTION
CONT	CONTINUE
COORD	COORDINATE
CPT	CARPET OR CARPET TILE
CSWK	CASEWORK
CT	CERAMIC TILE
CTRL	CONTROL
DAT	DATUM
DC	DIRECT CURRENT
DEG	DEGREE
DEL	DELETE
DEMO	DEMOLITION
DEPT	DEPARTMENT
DTL	DETAIL
DIFF	DIFFERENCE
DIM	DIMENSION
DIR	DIRECTION
DR	DOOR, OR DRAIN
DR OPNG	DOOR OPENING
E.J.	EXPANSION JOINT
EL	ELEVATION
ELEC	ELECTRIC
ELEV	ELEVATOR
EMER	EMERGENCY
ENGR	ENGINEER
EQ	EQUAL
EQUIP	EQUIPMENT
EQUIV	EQUIVALENT
ESP	ESPECIALLY
EXIST	EXISTING
FA	FIRE ALARM
FAS	FASCIA
FD	FLOOR DRAIN
FE	FIRE EXTINGUISHER
FEC	FIRE EXTINGUISHER CABINET
FIN FLR	FINISH FLOOR
FIXT	FIXTURE
FLR	FLOOR
FP	FIRE PROTECTION OR FIREPROOF
FRT	FIRE RETARDANT TREATED
FRZ	FREEZER
FT	FEET OR FOOT
FURN	FURNISH OR FURNITURE
GA	GAGE OR GYPSUM ASSOCIATION
GAL	GALLON
GALV	GALVANIC OR GALVANIZED
GB	GRAB BAR
GC	GENERAL CONTRACTOR
GEN	GENERAL OR GENERATOR
GL	GLASS
GLU LAM	GLUED LAMINATED WOOD
GT	GROUT
GYP	GYPSUM
GYP BD	GYPSUM BOARD
HB	HOSE BIBB
HC	HOLLOW CORE
HDWD	HARDWOOD
HM	HOLLOW METAL
HT	HEIGHT
HVAC	HEATING, VENTILATING, AND AIR CONDITIONING
ID	IDENTIFICATION
ILLUM	ILLUMINATION
INCL	INCLUDED
INFO	INFORMATION
INSUL	INSULATION
INT	INTERIOR
JAN	JANITOR
J-BOX	JUNCTION BOX
LAB	LABORATORY
LAM	LAMINATE
LAV	LAVATORY
LDR	LEADER
LED	LIGHT EMITTING DIODE
LT	LIGHT
LVD	LOUVERED
LVR	LOUVER
LVT	LUXURY VINYL TILE
LYR	LAYER
MAINT	MAINTENANCE
MATL	MATERIAL
MAX	MAXIMUM
MECH	MECHANICAL
MEMO	MEMORANDUM
MEZZ	MEZZANINE
MID	MIDDLE
MIRR	MIRROR
MISC	MISCELLANEOUS
MLDG	MOLDING (MOULDING)
MLWK	MILLWORK
MO	MASONRY OPENING
MTL	METAL
MULL	MULLION
NA	NOT APPLICABLE
NAT	NATURAL
NIC	NOT IN CONTRACT
NO	NUMBER
NOM	NOMINAL
NUM	NUMERAL
OC	ON CENTER
OCC	OCCUPY
OFF	OFFICE
OPNG	OPENING
OPP	OPPOSITE
OSHA	OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
JOZ	OUNCE
PART	PARTIAL
PAT	PATTERN
PEN	PENETRATE
PERF	PERFORATED
PERP	PERPENDICULAR
PLAS	PLASTER OR PLASTIC
PLBG	PLUMBING
PLYWD	PLYWOOD
PNL	PANEL
PRB	PROFILE BASE
PRCST	PRECAST
PREFAB	PREFABRICATE
PRELIM	PRELIMINARY
PREP	PREPARATION
PREV	PREVIOUS
PROP	PROPERTY
PTD	PAINTED
PVC	POLYVINYL CHLORIDE (PLASTIC)
QA	QUALITY ASSURANCE
QC	QUALITY CONTROL
QT	QUARRY TILE
QTB	QUARRY TILE BASE
QTR	QUARTER
QTY	QUANTITY
R	RADIUS OR RISER
RAD	RADIATOR
RB	RESILIENT BASE OR RUBBER BASE
RBR	RUBBER
RCP	REFLECTED CEILING PLAN
RCVR	RECEIVER
RD	ROAD OR ROOF DRAIN
REC	RECESSED
RECT	RECTANGLE
REF	REFERENCE OR REFRIGERATOR
REINF	REINFORCE
REQ	REQUIRE
REQD	REQUIRED
RES	RESINOUS FLOORING
RESIL	RESILIENT
RET	RETURN
REV	REVISION
RF	RUBBER FLOORING
RM	ROOM
RND	ROUND
RO	ROUGH OPENING
SALV	SALVAGE
SBSTR	SUBSTRATE
SCHED	SCHEDULE
SCHEM	SCHEMATIC
SECT	SECTION
SEP	SEPARATE
SF	SQUARE FOOT (FEET)
SLNT	SEALANT
SMK	SMOKE
SPEC	SPECIFICATION
SPKLR	SPRINKLER
SPLY	SUPPLY
SQ	SQUARE
SS	STAINLESS STEEL
STD	STANDARD
STOR	STORAGE
STR	STRINGERS
STRUCT	STRUCTURAL
SURF	SURFACE
SUSP	SUSPEND
SVT	SOLID VINYL FLOOR TILE
SYS	SYSTEM
T&G	TONGUE AND GROOVE
TECH	TECHNICAL
TEL	TELEPHONE
TEMP	TEMPERATURE OR TEMPORARY
THK	THICKNESS
THRU	THROUGH
TMPD	TEMPERED
TO	TOP OF ___
TRANS	TRANSOM
TRTD	TREATED
TYP	TYPICAL
U	HEAT TRANSFER COEFFICIENT
UNO	UNLESS NOTED OTHERWISE
UPS	UNINTERRUPTIBLE POWER SUPPLY
UTIL	UTILITY
UV	ULTRAVIOLET
VAC	VACUUM
VAR	VARIES
VCT	VINYL COMPOSITION TILE
VENT	VENTILATION
VERT	VERTICAL
VEST	VESTIBULE
VIF	VERIFY IN FIELD
VOL	VOLUME
W/	WITH
W/O	WITHOUT
WD	WOOD
WSCT	WAINSCOT
WSF	WELDED SEAM SHEET FLOORING
WT	WEIGHT

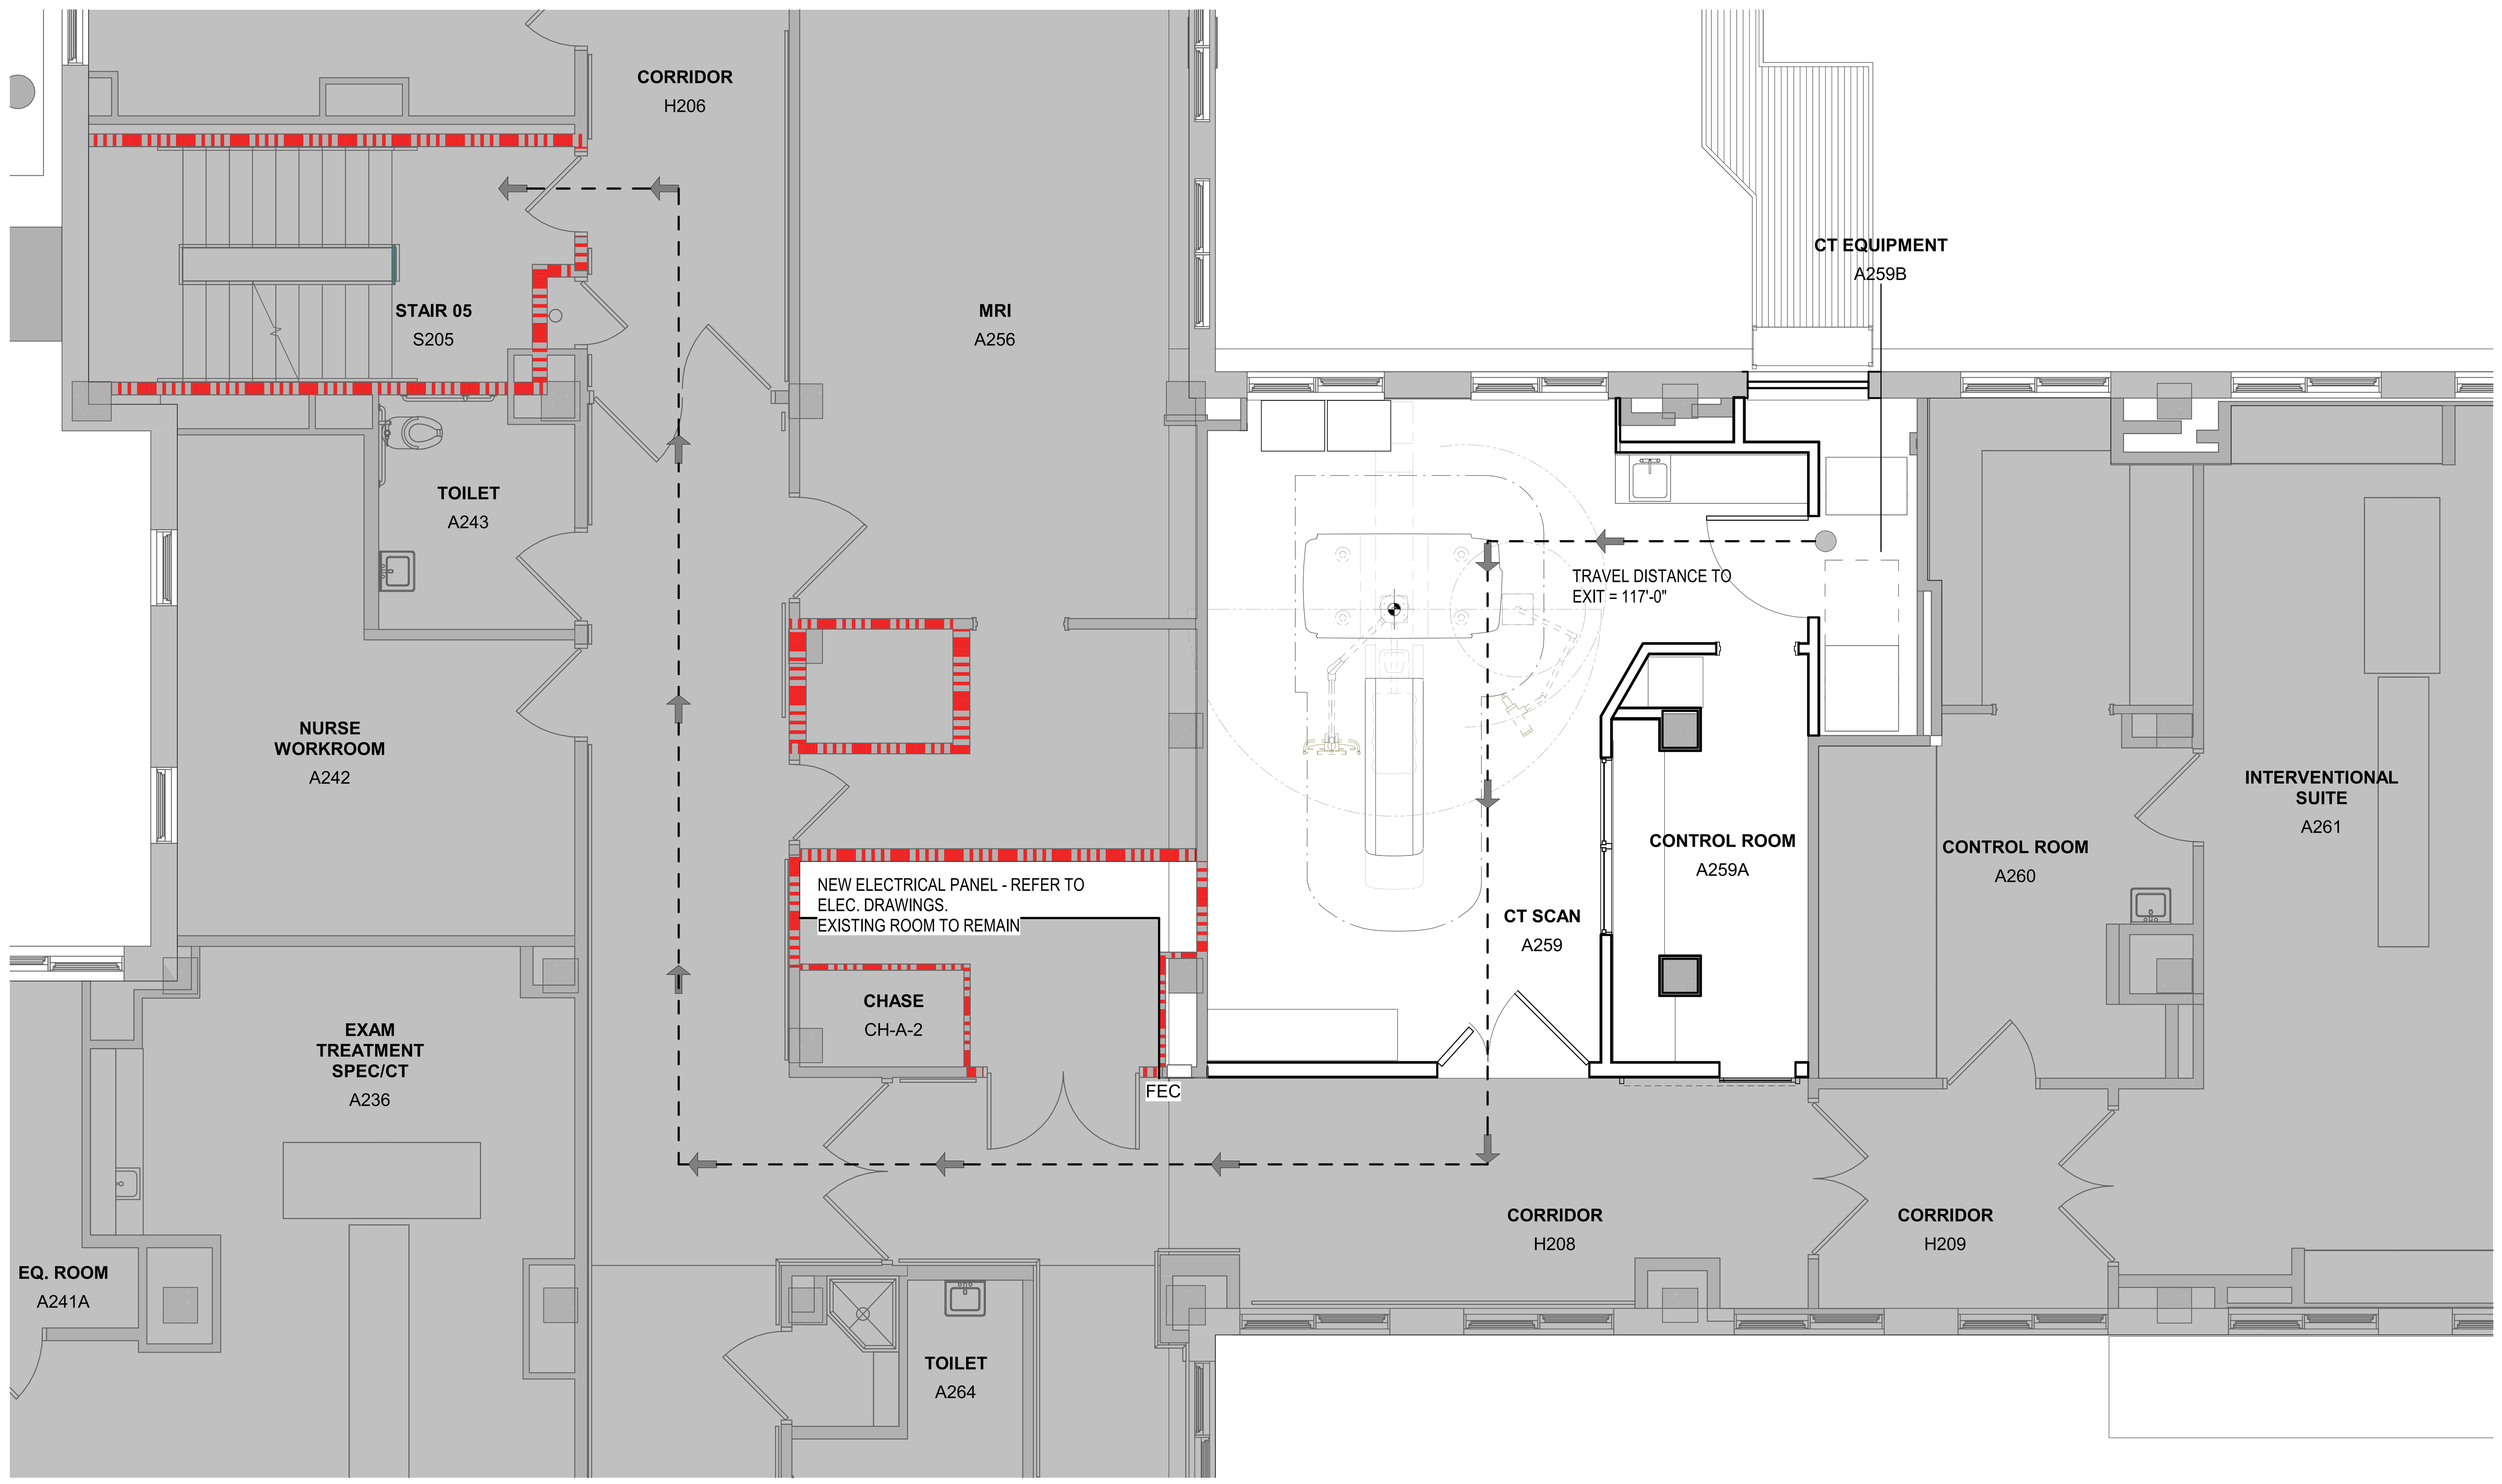

1 SECOND FLOOR LIFE SAFETY PLAN

1/4" = 1'-0"

GOVERNING CODE NOTES:

A. PRIMARY APPLICABLE CODES AND STANDARDS - EXISTING BUILDING / RECONSTRUCTION

DEPARTMENT OF VETERANS AFFAIRS HAS ADOPTED THE LATEST EDITION OF THE FOLLOWING CODES AND STANDARDS AS A MINIMUM FOR ALL PROJECTS PERFORMED IN THE MODERNIZATION, ALTERATION, ADDITION, OR IMPROVEMENT OF ITS REAL PROPERTY AND THE CONSTRUCTION OF NEW STRUCTURES. VA DESIGN MANUALS AND MASTER SPECIFICATIONS SPECIFY OTHER CODES AND STANDARDS THAT VA FOLLOWS ON ITS PROJECTS:

1. VA DIRECTIVES, DESIGN MANUALS, MASTER SPECIFICATIONS, VA NATIONAL CAD STANDARD APPLICATION GUIDE, AND OTHER GUIDANCE ON THE TECHNICAL INFORMATION LIBRARY (TIL) (HTTP://WWW.CFM.VA.GOV/TIL/), INCLUDING BUT NOT LIMITED TO:
   a. NFPA 101 LIFE SAFETY CODE, 2024 EDITION.
   b. NFPA NATIONAL FIRE CODES (WITH THE EXCEPTION OF NFPA 5000 AND NFPA 900)
   c. NATIONAL ELECTRICAL CODE (NEC).
   d. ASME BOILER AND PRESSURE VESSEL CODE.
   e. ASME CODE FOR PRESSURE PIPING.
   f. ARCHITECTURAL BARRIERS ACT ACCESSIBILITY STANDARDS (ABAAS) INCLUDING VA SUPPLEMENT, BARRIER FREE DESIGN GUIDE (PG-08-13), NOTED ABOVE.
   g. ENERGY POLICY ACT (EPACT).
   h. INTERNATIONAL BUILDING CODE (IBC) (ONLY WHEN SPECIFICALLY REFERENCED IN VA DESIGN DOCUMENTS, SEE NOTES BELOW).
   i. BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE, AMERICAN CONCRETE INSTITUTE AND COMMENTARY (ACI 318).
   j. MANUAL OF STEEL CONSTRUCTION, LOAD AND RESISTANCE FACTOR DESIGN SPECIFICATIONS FOR STRUCTURAL STEEL BUILDINGS, AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC).
   k. NATIONAL COUNCIL ON RADIATION PROTECTION & MEASUREMENT (NCRP) REPORT NO. 147
   l. AMERICAN ASSOCIATION OF PHYSICISTS IN MEDICINE (AAPM TASK GROUP 108 REPORT
   m. AMERICAN COLLEGE OF RADIOLOGY (ACR) MANUAL ON MR SAFETY
   n. FACILITY GUIDELINES INSTITUTE (FGI) GUIDELINES OF DESIGN AND CONSTRUCTION OF HOSPITAL FACILITIES
   o. THE PROVISIONS FOR CONSTRUCTION AND SAFETY SIGNS. STATED IN THE GENERAL REQUIREMENTS SECTION 01010 OF THE VA MASTER CONSTRUCTION SPECIFICATION.
   p. VENTILATION FOR ACCEPTABLE INDOOR AIR QUALITY – ASHRAE STANDARD 62.1- 2004.
   q. SAFETY STANDARD FOR REFRIGERATION SYSTEMS – ASHRAE STANDARD 15 – 2007.
   r. OCCUPATIONAL, SAFETY AND HEALTH ADMINISTRATION (OSHA) STANDARDS.
   s. **VA DIRECTIVES, DESIGN MANUALS, MASTER SPECIFICATIONS, VA NATIONAL CAD STANDARD APPLICATION GUIDE, AND OTHER GUIDANCE ON THE TECHNICAL INFORMATION LIBRARY (TIL)**
   t. VA H-08-03, VA CONSTRUCTION STANDARDS
   u. VA H-08-05, EQUIPMENT GUIDE LIST
   v. VA H-18-08 SEISMIC DESIGN REQUIREMENTS
   w. VA H-08-09, PLANNING CRITERIA FOR MEDICAL FACILITIES
   x. VA H-08-13, BARRIER FREE DESIGN HANDBOOK
   y. VA CONSTRUCTION STANDARD CD-28, ACCOMMODATION FOR THE PHYSICALLY HANDICAPPED

B. LOCAL CODES: AS AN AGENCY OF THE FEDERAL GOVERNMENT, VA IS NOT SUBJECT TO LOCAL IMPOSITION OF CODE ENFORCEMENT PROCEDURES (DRAWING REVIEWS, BUILDING PERMITS, INSPECTIONS, FEES, ETC.). VA MUST FUNCTION AS THE AUTHORITY HAVING JURISDICTION (AHJ) AND THUS HAS THE RESPONSIBILITY TO GUARD PUBLIC HEALTH AND SAFETY THROUGH ENFORCING ITS ADOPTED CODES. HOWEVER, LOCAL AUTHORITIES SHOULD BE NOTIFIED ABOUT PLANNED PROJECTS AND GIVEN OPPORTUNITY TO REVIEW DRAWINGS PROVIDED THAT VA DOES NOT PAY FOR REVIEW OR INSPECTION FEES.

C. NOTES
1. NFPA 101 PRIMARILY ADDRESSES LIFE SAFETY AND FIRE PROTECTION FEATURES WHILE THE IBC ADDRESSES A WIDE RANGE OF CONSIDERATIONS, INCLUDING, BUT NOT LIMITED TO, STRUCTURAL STRENGTH, SEISMIC STABILITY, SANITATION, ADEQUATE LIGHT AND VENTILATION, AND ENERGY CONSERVATION. VA BUILDINGS MUST MEET THE REQUIREMENTS OF NFPA 101 AND DOCUMENTS REFERENCED BY NFPA 101 IN ORDER TO COMPLY WITH THE ACCREDITATION REQUIREMENTS OF THE JOINT COMMISSION. THEREFORE, DESIGNS SHALL COMPLY WITH THE REQUIREMENTS OF THE LATEST EDITION OF NFPA 101 AND DOCUMENTS REFERENCED THEREIN. DESIGN FEATURES NOT ADDRESSED BY NFPA 101 OR DOCUMENTS REFERENCED THEREIN SHALL COMPLY WITH THE REQUIREMENTS OF THE LATEST EDITION OF THE IBC OR AS OTHERWISE ADDRESSED IN THE VA PROGRAM GUIDE. FOR DESIGN FEATURES THAT ARE ADDRESSED BY BOTH THE IBC AS WELL AS NFPA 101 OR A DOCUMENT REFERENCED BY NFPA 101, THE REQUIREMENTS OF NFPA 101 OR THE DOCUMENT REFERENCED BY NFPA 101 SHALL BE USED EXCLUSIVELY (THIS APPLIES EVEN IF THE IBC REQUIREMENTS ARE DIFFERENT).
2. CONFLICTS BETWEEN NATIONALLY RECOGNIZED CODES AND STANDARDS AND VA REQUIREMENTS – SHOULD A CONFLICT EXIST BETWEEN VA REQUIREMENTS AND VA ADOPTED NATIONALLY RECOGNIZED CODES AND STANDARDS, THE CONFLICT SHALL BE BROUGHT TO THE ATTENTION OF VA. THE RESOLUTION OF THE CONFLICT SHALL BE MADE BY THE AUTHORITY HAVING JURISDICTION FOR VA TO ENSURE A CONSISTENCY SYSTEM WIDE.

D. CONSTRUCTION TYPE CLASSIFICATION: TYPE II (222). THE MINIMUM FIRE RATING FOR ALL LOAD-BEARING STRUCTURAL ELEMENTS IS 2 HRS.

NFPA 101 REVIEW

A. **HEALTH CARE:**
1. 6.1.5 HEALTH CARE OCCUPANCY
2. SHALL COMPLY WITH CHAPTER 20/21, "NEW AND EXISTING AMBULATORY HEALTH CARE OCCUPANCIES"

B. **FIRE SUPPRESSION: THE EXISTING ENTIRE BUILDING IS PROTECTED THROUGHOUT BY AN APPROVED, SUPERVISED AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE WITH SECTION 9.7.**

C. **CONSTRUCTION, REPAIR AND IMPROVEMENT OPERATIONS:**
1. SHALL COMPLY WITH SECTION 4.6.10, PROJECT AREA WILL BE OCCUPIED DURING CONSTRUCTION WITH ALL REQUIRED MEANS OF EGRESS AND REQUIRED FIRE PROTECTION FEATURES REMAINING IN PLACE AND CONTINUOUSLY MAINTAINED.

D. **MEANS OF EGRESS (SECTIONS 7 AND 20) EXISTING**
1. EXIT ACCESS CORRIDORS SERVING MORE THAN 30 SHALL BE 1-HOUR RATED (7.1.3.1):
   (2) THIS REQUIREMENT SHALL NOT APPLY WHERE OTHERWISE PROVIDED IN CHAPTERS 11 THROUGH 43.
   (20.3.6.1) CORRIDORS TO BE 1-HOUR RATED UNLESS:
   (3) WITHIN BUILDINGS PROTECTED THROUGHOUT BY AN APPROVED, SUPERVISED AUTOMATIC SPRINKLER SYSTEM.
2. DOORS (7.2.1.2.3.2): DOOR OPENING MEANS OF EGRESS SHALL NOT BE LESS THAN 32" IN CLEAR WIDTH.

E. **FINISHES (SECTIONS 20)**
1. INTERIOR FINISHES SHALL BE IN ACCORDANCE WITH SECTION 10.2.
2. WALLS AND CEILINGS (20.3.3.2.1): INTERIOR WALL AND CEILING FINISH MATERIALS SHALL BE CLASS A, CLASS B OR CLASS C IN AREAS OTHER THAN THOSE SPECIFIED IN 20.3.3.2.1.

F. **EXTINGUISHMENT REQUIREMENTS**
1. (20.3.5.3) PORTABLE FIRE EXTINGUISHERS SHALL BE PROVIDED IN AMBULATORY HEALTH CARE FACILITIES IN ACCORDANCE WITH SECTION 9.9 (AN EXISTING FE IS LOCATED IN A CABINET DIRECTLY OUTSIDE OF ROOM A259 IN THE CORRIDOR).

LIFESAFETY LEGEND:

- 2 HOUR RATED FIRE PARTITION
- EXIT ACCESS TRAVEL DISTANCE
- FEC FIRE EXTINGUISHER IN CABINET

KEY PLAN

PROJECT AREA

N

PROJECT NORTH

TRUE NORTH

Revisions:	Date:

CONSULTANT

Above Group ENGINEERING DESIGN CONSULTING

Mabbett Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD

THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP

STATE OF MISSOURI
RUSSELL DINARDO
NUMBER
A - 2024000203
ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
LIFESAFETY, ABBREVIATIONS & CODE NOTES	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:		Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number: 1
		Issue Date: 06 MARCH 2026 / Checked: TB / Drawn: PS	Drawing Number: G002

INFECTION CONTROL NOTES:

THE PURPOSE OF INFECTION CONTROL PROCEDURES IS TO MINIMIZE THE POTENTIAL FOR THE SPREAD OF INFECTIONS DUE TO DEGRADED AIR QUALITY, ENVIRONMENTAL CONTAMINATION, OR CONTAMINATION OF WATER. IT IS THE POLICY OF THIS MEDICAL CENTER THAT A SYSTEMATIC APPROACH BASED ON ASSESSMENT AND PLANNING WILL EFFECTIVELY MANAGE THE ISSUE OF TRANSMISSION OF INFECTIOUS DISEASES AND THE AGGRAVATION OF ALLERGIES. THE OVERALL APPROACH RELIES ON PRE-CONSTRUCTION ASSESSMENT, MANAGEMENT OF HVAC SYSTEMS, AND AGGRESSIVE USE OF A VARIETY OF BARRIERS. CONTRACTOR IS TO WORK CLOSELY WITH THE VA FACILITY MANAGEMENT SERVICE CENTER, THE INFECTION CONTROL PROGRAM STAFF AND THE SAFETY AND OCCUPATION HEALTH MANAGER TO HAVE IN PLACE A MONITORING PROGRAM TO ASSURE RIGOROUS IMPLEMENTATION OF THE REQUIRED MEASURES, REFER TO PROJECT SPECIFICATIONS.

A. THE CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS IN THE FIELD AND COORDINATE ALL INFECTION CONTROL REQUIREMENTS WITH THE DEMOLITION AND NEW CONSTRUCTION. THE CONTRACTOR SHALL REPORT ALL DISCOVERIES TO THE OWNERS' REPRESENTATIVE FOR RESOLUTION PRIOR TO BEGINNING.

B. CONTRACTOR TO INSTALL BARRIERS AND OTHER MEASURES. CONSTRUCTION BARRIER DOOR(S) MUST BE SELF-CLOSING. PROVIDE DUST CONTROL AND CONTAINMENT STICKY MATS ON ALL ACCESS DOORS INTO CONSTRUCTION AREA. ANTE-ROOM REQUIRED AT CONSTRUCTION ENTRY. PROVIDE MANOMETER MONITORS FOR ALL CONSTRUCTION BARRIERS.

C. CONTRACTOR TO DISPOSE OF MATERIALS BEFORE 8:00 AND OR AFTER 4:00 PM UNLESS ARRANGED WITH THE VA TO DISPOSE OF DURING NORMAL HOURS. USE ROUTE AGREED UPON BY ICRA TEAM AND COTR FOR TRANSPORT OF TRANSPORT CONTAINERS THROUGH THE FACILITY. CONTRACTORS CAN ONLY DEVIATE TO NORMAL HOURS WITH THE APPROVAL OF THE INFECTION CONTROL NURSE AND COR DUE TO PARTICULAR CIRCUMSTANCES THAT MAY OBSTRUCT PROGRESS. A CLEAR PLAN WILL HAVE TO BE SUBMITTED AND PRECAUTIONARY INFECTION CONTROL MEASURES IMPLEMENTED.

D. CONTRACTOR TO COVER CARTS AND WEAR BOOTIES WHEN DISPOSING MATERIALS.

E. CONTRACTOR TO CHANGE MATS MULTIPLE TIMES A DAY AS NEEDED AND MOP FLOORS BEHIND THEM MULTIPLE TIMES A DAY.

F. CONTRACTOR TO MAINTAIN CONTINUOUS NEGATIVE AIR PRESSURE WITHIN THE WORK SITE UTILIZING WINDOW EXHAUST FANS STRATEGICALLY LOCATED OR PROVIDED NEGATIVE PRESSURE AIR HEPA UNITS AND EXHAUST TO EXTERIOR OF THE BUILDING. CONTRACTOR TO INCLUDE MONITORING MANOMETER AT ANTEROOM SO THE NEGATIVE PRESSURE CAN BE INSPECTED.

INFECTION CONTROL RISK ASSESSMENT

Infection Control Risk Assessment
Matrix of Precautions for Construction & Renovation

STEP ONE: Using the following table, identify the Type of Construction Project Activity (Type A-D)

TYPE A	**Inspection and Non-Invasive Activities** Includes, but is not limited to: • removal of ceiling tiles for visual inspection only e.g., limited to 1 tile per 50 square feet with limited exposure time. • Limited building system maintenance (e.g., pneumatic tube station, HVAC system, fire suppression system, electrical and carpentry work to include painting without sanding) that does not create dust or debris. • Clean plumbing activity limited in nature.
TYPE B	**Small scale, short duration activities that create minimal dust and debris.** Includes, but is not limited to: • Work conducted above the ceiling (e.g., prolonged inspection or repair of firewalls and barriers, installation of conduit and/or cabling, and access to mechanical and/or electrical chase spaces). • Fan shutdown/startup. • Installation of electrical devices or new flooring that produces minimal dust and debris. • The removal of drywall where minimal dust and debris is created. • Controlled sanding activities (e.g., wet, or dry sanding) that produce minimal dust and debris.
TYPE C	**Large-scale, longer duration activities that create a moderate amount of dust and debris.** Includes, but is not limited to: • Removal of preexisting floor covering, walls, casework, or other building components. • New drywall placement. • Renovation work in a single room. • Non-existing cable pathway or invasive electrical work above ceilings. • The removal of drywall where a moderate amount of dust and debris is created. • Dry sanding where a moderate amount of dust and debris is created. • Work creating significant vibration and/or noise. • Any activity that cannot be completed in a single work shift.
TYPE D	**Major demolition and construction activities** Includes, but is not limited to: • Removal or replacement of building system component(s). • Removal/installation of drywall partitions. • Invasive large-scale new building construction. • Renovation work in two or more rooms.

STEP 1 - Activity Type: TYPE C

STEP TWO: Using the following table, identify the Patient Risk Groups that will be affected. If more than one risk group will be affected, select the higher risk group.

LOW RISK	MEDIUM RISK	HIGH RISK	HIGHEST RISK
Non-patient care areas: • Outbuildings • Office Areas, meeting Rooms • Environmental Services • Prosthetis • Canteen Store • Chapel • Morgue • Elevators • Warehouse • Police • Boiler Plant • Facilities Maintenance Shop	• Respiratory Therapy • Outpatient Clinics • CBOS's • Adult Day Care • Psychiatry • Echocardiography • Physical Therapy • EEG • EKG • Occupational Health • Animal Research Laboratories • Dental Excluding Dental Operating Suites • Canteen Food Areas • Behavioral Health	• Emergency Room • Phlebotomy • Research Laboratories, Laboratories (Patient) • Pharmacy • Post Anesthesia Care Unit • Endoscopy • Surgical Unit • Medical Unit • Community Living Center • Pulmonary, Renal and Infectious Disease Clinic • Sleep Lab • Nuclear Medicine (Building 27) • Any Sterile Supply Room • Radiology/MRI/CT • Logistics Storage • Laundry/Linen Areas	• Dialysis • Cardiac Cath Lab • Sterile Processing and Distribution • Intensive Care Unit • Oncology • Radiation Therapy/Building 26 • Operating Rooms (including Dental Operating Suite) • VIR Suite • Urology Procedure Room • Ophthalmology Procedure Room • Women's Health Procedure Room • Stratton Inn Microbiology Lab • Pharmacy (USP 797/800 Compounding Areas

STEP 2 - Patient Risk Group: HIGH RISK

STEP THREE: Match the Patient Risk Group (Low, Medium, High, Highest) from Step Two with the planned Construction Activity Project Type (A, B, C, D) from Step one using the table to find the Class of Precautions (I, II, III, IV or V) or level of infection control activities required.

Construction Project Type

Patient Risk Group	TYPE A	TYPE B	TYPE C	TYPE D
LOW Risk Group	I	II	II	III
MEDIUM Risk Group	I	II	III	IV
HIGH Risk Group	I	III	IV	V
HIGHEST Risk Group	III	IV	V	V

Infection control permit and approval will be required when Class of Precautions III (Type C) and all Class of Precautions IV or V are necessary.

Environmental conditions that could affect human health, such as sewage, mold, asbestos, gray water and black water will require Class of Precautions IV for LOW and MEDIUM Risk Groups and Class of Precautions V for HIGH and HIGHEST Risk Groups.

*Type C [Medium Risk Groups] and Type D [Low Risk Groups] work areas [Class III precautions] that cannot be sealed and completely isolated from occupied patient care spaces should be elevated to include negative air exhaust requirements as listed in Class IV Precautions.

STEP 3 - Class of Precautions: CLASS IV

STEP FOUR: Assess potential risk to areas surrounding the project. Using Table 4, identify the surrounding areas that will be affected and the type of impact that will occur. If more than one risk group will be affected, select the higher risk group using Table 2 - Patient Risk Group.

SURROUNDING AREA ASSESSMENT

Unit Below:	Unit Above:	Unit Lateral:	Unit Behind:	Unit in Front:
Risk Group:	Risk Group:	Risk Group:	Risk Group:	Risk Group:
Contact:	Contact:	Contact:	Contact:	Contact:
Phone:	Phone:	Phone:	Phone:	Phone:
Additional Controls: ☐ Noise ☐ Vibration ☐ Dust Control ☐ Ventilation ☐ Pressurization ☐ Vertical Shafts ☐ Elevator/Stairs	**Additional Controls:** ☐ Noise ☐ Vibration ☐ Dust Control ☐ Ventilation ☐ Pressurization ☐ Vertical Shafts ☐ Elevator/Stairs	**Additional Controls:** ☐ Noise ☐ Vibration ☐ Dust Control ☐ Ventilation ☐ Pressurization ☐ Vertical Shafts ☐ Elevator/Stairs	**Additional Controls:** ☐ Noise ☐ Vibration ☐ Dust Control ☐ Ventilation ☐ Pressurization ☐ Vertical Shafts ☐ Elevator/Stairs	**Additional Controls:** ☐ Noise ☐ Vibration ☐ Dust Control ☐ Ventilation ☐ Pressurization ☐ Vertical Shafts ☐ Elevator/Stairs
System Impacted: ☐ Data ☐ Mechanical ☐ Med Gases ☐ Hot/Cold Water	**System Impacted:** ☐ Data ☐ Mechanical ☐ Med Gases ☐ Hot/Cold Water	**System Impacted:** ☐ Data ☐ Mechanical ☐ Med Gases ☐ Hot/Cold Water	**System Impacted:** ☐ Data ☐ Mechanical ☐ Med Gases ☐ Hot/Cold Water	**System Impacted:** ☐ Data ☐ Mechanical ☐ Med Gases ☐ Hot/Cold Water

Noise & Vibration Mitigation Strategies

- ☐ Use diamond drills instead of powder-actuated fasteners.
- ☐ Schedule noise-making periods with adjacent spaces.
- ☐ Use beam clamps instead of shot.
- ☐ Prefab where possible.
- ☐ Use tim snips to cut metal studs instead of using a chop saw.
- ☐ Install metal decking with vent tabs, then use cellar floor deck hangers.
- ☐ Consider compression style fittings instead of soldering, brazing, or welding.
- ☐ Wet core drill instead of dry core or percussion.
- ☐ Instead of jackhammering concrete, use wet diamond saws.
- ☐ Use HEPA vacuums instead of standard wet/dry vacuums.
- ☐ Use mechanical joining system sprinkler fittings instead of threaded.
- ☐ Where fumes are tolerated, use chemical adhesive remover (floor glue) instead of mechanical.
- ☐ To remove flooring, consider abrasive blasting instead of using a floor scraper.
- ☐ Use electronic sheers instead of reciprocating saw for ductwork cutting.
- ☐ Install exterior man/material lifts.

Ventilation & Pressurization Mitigation Strategies

- ☐ HEPA to exterior.
- ☐ Install temporary ductwork.
- ☐ Utilize temporary HVAC equipment.
- ☐ Vacate the area.
- ☐ Install temporary partitions.
- ☐ Use carbon filtration odors.

Impact to Other Systems Mitigation Strategies

- ☐ Schedule outages.
- ☐ Provide temporary systems.
- ☐ Back-feed electrical or medical gases.

Minimum Required Infection Control Precautions by Class | Before and During Work Activity

CLASS I	1. Perform noninvasive work activity as to not block or interrupt patient care. 2. Perform noninvasive work activities in areas that are not directly occupied with patients. 3. Perform noninvasive work activity in a manner that does not create dust. 4. Immediately replace any displaced ceiling tile before leaving the area and/or at end of noninvasive work activity.
CLASS II	1. Perform only limited dust work and/or activities designed for basic facilities and engineering work. 2. Perform limited dust and invasive work following standing precautions procedures approved by the organization. 3. This Class of Precautions must never be used for construction or renovation activities.
CLASS III	1. Provide active means to prevent airborne dust dispersion into the occupied areas. 2. Means for controlling minimal dust dispersion may include hand-held HEPA vacuum devices, polyethylene plastic containment, or isolation of work area by closing room door. 3. Remove or isolate return air diffusers to avoid dust from entering the HVAC system. 4. Remove or isolate the supply air diffusers to avoid positive pressurization of the space, 5. If work area is contained, then it must be neutrally to negatively always pressurized. 6. Seal all doors with tape that will not leave residue. 7. Contain all trash and debris in the work area. 8. Nonporous/smooth and cleanable containers (with a hard lid) must be used to transport trash and debris from the construction areas. These containers must be damp-wiped cleaned and free of visible dust/debris before leaving the contained work area. 9. Install an adhesive (dust collection) mat at entrance of contained work area based on facility policy. Adhesive mats must be changed routinely and when visibly soiled. 10. Maintain clean surroundings when area is not contained by damp mopping or HEPA vacuuming surfaces.
CLASS IV	1. Construct and complete critical barriers meeting NFPA 241 requirements including: Barriers must extend to the ceiling or, if ceiling tile is removed, to the deck above, and all penetrations through the barrier shall meet the appropriate fire rating requirements. 2. All (plastic or hard) barrier construction activities must be completed in a manner that prevents dust release. Plastic barriers must be effectively affixed to ground and ceiling and secure from movement or damage. Apply tape that will not leave a residue to seal gaps between barriers, ceiling or floor. 3. Seal all penetrations in containment barriers, including floors and ceiling, using approved materials (UL schedule firestop if applicable for barrier type). 4. Containment units or environmental containment units (ECUs) approved for Class IV precautions in small areas totally contained by the unit and that has HEPA-filtered exhaust air. 5. Remove or isolate return air diffusers to avoid dust entering the HVAC system. 6. Remove or isolate the supply air diffusers to avoid positive pressurization of the space. 7. Negative airflow pattern must be maintained from the entry point to the anteroom and into the construction area. The airflow must cascade from outside to inside the construction area. The entire construction area must remain negatively pressurized. 8. Maintain negative pressurization of the entire workspace by use of HEPA exhaust air systems directed outdoors. Exhaust discharged directly to the outdoors that is 25 feet or greater from entrances, air intakes and windows does not require HEPA-filtered air. 9. If exhaust is directed indoors, then the system must be HEPA filtered. Prior to start of work, HEPA filtration must be verified by particulate measurement as no less than 99.97% efficiency and must not alter or change airflow/pressure relationships in other areas. 10. Exhaust into shared or recirculating HVAC systems, or other shared exhaust systems (e.g., bathroom exhaust) is not acceptable. 11. Install device on exterior of work containment to continually monitor negative pressurization. To assure proper pressure is continuously maintained, it is recommended that the device(s) have a visual pressure indicator. 12. Contain all trash and debris in the work area. 13. Nonporous/smooth and cleanable containers (with a hard lid) must be used to transport trash and debris from the construction areas. These containers must be damp-wiped cleaned and free of visible dust/debris before leaving the contained work area. 14. Worker clothing must be clean and free of visible dust before leaving the work area. HEPA vacuuming of clothing or use of cover suits is acceptable. 15. Workers must wear shoe covers prior to entry into the work area. Shoe covers must be changed prior to exiting the anteroom to the occupied space (non-work area). Damaged shoe covers must be immediately changed. 16. Install an adhesive (dust collection) mat at entrance of contained work area based on facility policy. Adhesive mats must be changed routinely and when visibly soiled. 17. Consider collection of particulate data during work to monitor and ensure that contaminates do not enter the occupied spaces. Routine collection of particulate samples may be used to verify HEPA filtration efficiencies.
CLASS V	1. Construct and complete critical barriers meeting NFPA 241 requirements including: Barriers must extend to the ceiling, or if ceiling tile is removed, to the deck above, and all penetrations through the barrier shall meet the appropriate fire rating requirements. 2. All (plastic or hard) barrier construction activities must be completed in a manner that prevents dust release. Plastic barriers must be effectively affixed to ground and ceiling and secure from movement or damage. Apply tape that will not leave a residue to seal gaps between barriers, ceiling or floor. 3. Seal all penetrations in containment barriers, anteroom barriers, including floors and ceiling using approved materials (UL schedule firestop if applicable for barrier type). 4. Construct anteroom large enough for equipment staging, cart cleaning, workers. The anteroom must be constructed adjacent to entrance of construction work area. 5. Personnel will be required to wear disposable coveralls at all times during Class V work activities. Disposable coveralls must be removed before leaving the anteroom. 6. Remove or isolate return air diffusers to avoid dust entering the HVAC system. 7. Remove or isolate the supply air diffusers to avoid positive pressurization of the space. 8. Negative airflow pattern must be maintained from the entry point to the anteroom and into the construction area. The airflow must cascade from outside to inside the construction area. The entire construction area must remain negatively pressurized. 9. Maintain negative pressurization of the entire workspace using HEPA exhaust air systems directed outdoors. Exhaust discharged directly to the outdoors that is 25 feet or greater from entrances, air intakes and windows do not require HEPA-filtered air. 10. If exhaust is directed indoors, then the system must be HEPA filtered. Prior to start of work, HEPA filtration must be verified by particulate measurement as no less than 99.97% efficiency and must not alter or change airflow/pressure relationships in other areas. 11. Exhaust into shared or recirculating HVAC systems, or other shared exhaust systems (bathroom exhaust) is not acceptable. 12. Install device on exterior of work containment to continually monitor negative pressurization. To assure proper pressure is continuously maintained, it is recommended that the device(s) have a visual pressure indicator. 13. Contain all trash and debris in the work area. 14. Nonporous/smooth and cleanable containers (with a hard lid) must be used to transport trash and debris from the construction areas. These containers must be damp-wiped cleaned and free of visible dust/debris before leaving the contained work area. 15. Worker clothing must be clean and free of visible dust before leaving the work area anteroom. 16. Workers must wear shoe covers prior to entry into the work area. Shoe covers must be changed prior to exiting the anteroom to the occupied space (non-work area). Damaged shoe covers must be immediately changed. 17. Install an adhesive (dust collection) mat at entrance of contained work area based on facility policy. Adhesive mats must be changed routinely and when visibly soiled. 18. Consider collection of particulate data during work to monitor and ensure that contaminates do not enter the occupied spaces. Routine collection of particulate samples may be used to verify HEPA filtration efficiencies.

Minimum Required Infection Control Precautions | Upon Completion of Work Activity

CLASSES I, II, & III	Cleaning: 1. Perform Clean work areas including all environmental surfaces, high horizontal surfaces, and flooring materials. 2. Check all supply and return air registers for dust accumulation on upper surfaces as well as air diffuser surfaces. HVAC Systems: 1. Remove isolation of HVAC system in areas where work is being performed. Verify that HVAC systems are clean and operational. 2. Verify the HVAC systems meet original airflow and air exchange design specifications.
CLASSES IV & V	Class III (Type C Activities only), IV, and V precautions require inspection and documentation for downgraded ICRA precautions. Construction areas must be inspected by an infection preventionist or designee and engineering representative for discontinuation or downgrading of ICRA precautions. Work Area Cleaning: 1. 1. Clean work areas including all environmental surfaces, high horizontal surfaces, and flooring materials. 2. 2. Check all supply and return air registers for dust accumulation on upper surfaces as well as air diffuser surfaces. Removal of Critical Barriers: 1. Clean Critical barriers must remain in place during all work involving drywall removal, creation of dust and activities beyond simple touch-up work. The barrier may NOT be removed until a work area cleaning has been performed. 2. All (plastic or hard) barrier removal activities must be completed in a manner that prevents dust release. Use the following precautions when removing hard barriers: A. Carefully remove screws and painter tape. B. If dust will be generated during screw removal, use hand-held HEPA vacuum. C. Drywall cutting is prohibited during removal process. D. Clean all stud tracks with HEPA vacuum before removing outer hard barrier E. Use a plastic barrier to enclose area if dust could be generated. Negative Air Requirements: 1. The use of negative air must be designed to remove contaminates from the work area. 2. Negative air devices must always remain operational and in place for a period after completion of dust creating activities to remove contaminants from the work area and before removal of critical barriers. HVAC systems: 1. Upon removal of critical barriers, remove isolation of HVAC system in areas where work is being performed. 2. Verify that HVAC systems are clean and operational. 3. Verify the HVAC systems meets original airflow and air exchange design specifications.

Attachment A: Infection Control Construction Permit		Project No:	
Location of Construction:		Project Start Date:	
Project Coordinator:		Estimated Duration:	
Contractor Performing Work:		Permit Expiration Date:	
Supervisor:		Telephone:	
Permit Request Signature:		Date:	
Permit Authorized Signature:		Date:	

YES	NO	CONSTRUCTION ACTIVITY	YES	NO	INFECTION CONTROL RISK GROUP
☐	☐	TYPE A: Inspection, non-invasive activity.	☐	☐	GROUP 1: LOW RISK
☐	☐	TYPE B: Small scale, short duration.	☐	☐	GROUP 2: MEDIUM RISK
☐	☐	TYPE C: Activity generates moderate to high levels of dust. Requires consecutive work shifts.	☐	☐	GROUP 3: HIGH RISK
☐	☐	TYPE D: Major demolition and construction activities. Requires consecutive work shifts.	☐	☐	GROUP 4: HIGHEST RISK

Assigned CLASS	**CLASS I** ☐ **CLASS II** ☐ **CLASS III** ☐ **CLASS IV** ☐ **CLASS V** ☐ *See below for mandatory CLASS requirements
CLASS I	1. Perform noninvasive work activity as to not block or interrupt patient care. 2. Perform noninvasive work activities in areas that are not directly occupied with patients. 3. Perform noninvasive work activity in a manner that does not create dust. 4. Immediately replace any displaced ceiling tile before leaving the area and/or at end of noninvasive work activity. 5. Clean work areas including all environmental surfaces, high horizontal surfaces, and flooring materials. 6. Check all supply and return air registers for dust accumulation on upper surfaces as well as air diffuser surfaces. 7. Remove isolation of HVAC system in areas where work is being performed. Verify that HVAC systems are clean and operational. 8. Verify the HVAC systems meet original airflow and air exchange design specifications.
CLASS II **Implement all activities from CLASS I in addition to:	1. Perform only limited dust work and/or activities designed for basic facilities and engineering work. 2. Perform limited dust and invasive work following standing precautions procedures approved by the organization. 3. This Class of Precautions must never be used for construction or renovation activities.
CLASS III **Implement all activities from CLASS I & II in addition to:	1. Provide active means to prevent airborne dust dispersion into the occupied areas. 2. Means for controlling minimal dust dispersion may include hand-held HEPA vacuum devices, polyethylene plastic containment, or isolation of work area by closing room door. 3. Remove or isolate return air diffusers to avoid dust from entering the HVAC system. 4. Remove or isolate the supply air diffusers to avoid positive pressurization of the space. 5. If work area is contained, then it must be neutrally to negatively pressurized at all times. 6. Seal all doors with tape that will not leave residue. 7. Contain all trash and debris in the work area. 8. Nonporous/smooth and cleanable containers (with a hard lid) must be used to transport trash and debris from the construction areas. These containers must be damp-wiped cleaned and free of visible dust/debris before leaving the contained work area. 9. Install an adhesive (dust collection) mat at entrance of contained work area based on facility policy. Adhesive mats must be changed routinely and when visibly soiled. 10. Maintain clean surroundings when area is not contained by damp mopping or HEPA vacuuming surfaces. 11. Critical barriers must remain in place during all work involving drywall removal, creation of dust and activities beyond simple touch-up work. The barrier may NOT be removed until a work area cleaning has been performed. 12. All (plastic or hard) barrier removal activities must be completed in a manner that prevents dust release. Use the following precautions when removing hard barriers: Carefully remove screws and painter tape, if dust will be generated during screw removal, use hand-held HEPA vacuum. Drywall cutting is prohibited during removal process. Clean all stud tracks with HEPA vacuum before removing outer hard barrier. Use a plastic barrier to enclose area if dust could be generated. 13. The use of negative air must be designed to remove contaminates from the work area. 14. Negative air devices must always remain operational and in place for a period after completion of dust creating activities to remove contaminants from the work area and before removal of critical barriers.
	1. Construct and complete critical barriers meeting NFPA 241 requirements including: Barriers must extend to the ceiling or, if ceiling tile is removed, to the deck above, and all penetrations through the barrier shall meet the appropriate fire rating requirements. 2. All (plastic or hard) barrier construction activities must be completed in a manner that prevents dust release. Plastic barriers must be effectively affixed to ground and ceiling and secure from movement or damage. Apply tape that will not leave a residue to seal gaps between barriers, ceiling or floor. 3. Seal all penetrations in containment barriers, including floors and ceiling, using approved materials (UL schedule firestop if applicable for barrier type). 4. Containment units or environmental containment units (ECUs) approved for Class IV precautions in small areas totally contained by the unit and that has HEPA-filtered exhaust air. 5. Negative airflow pattern must be maintained from the entry point to the anteroom and into the construction area. The airflow must cascade from outside to inside the construction area. The entire construction area must remain negatively pressurized. 6. Maintain negative pressurization of the entire workspace by use of HEPA exhaust air systems directed outdoors. Exhaust discharged directly to the outdoors that is 25 feet or greater from entrances, air intakes and windows does not require HEPA-filtered air. 7. If exhaust is directed indoors, then the system must be HEPA filtered. Prior to start of work, HEPA filtration must be verified by particulate measurement as no less than 99.97% efficiency and must not alter or change airflow/pressure relationships in other areas. 8. Exhaust into shared or recirculating HVAC systems, or other shared exhaust systems (e.g., bathroom exhaust) is not acceptable. 9. Install device on exterior of work containment to continually monitor negative pressurization. To assure proper pressure is continuously maintained, it is recommended that the device(s) have a visual pressure indicator. 10. Worker clothing must be clean and free of visible dust before leaving the work area. HEPA vacuuming of clothing or use of cover suits is acceptable. 11.Workers must wear shoe covers prior to entry into the work area. Shoe covers must be changed prior to exiting the anteroom to the occupied space (non-work area). Damaged shoe covers must be immediately changed. 12. Consider collection of particulate data during work to monitor and ensure that contaminates do not enter the occupied spaces. Routine collection of particulate samples may be used to verify HEPA filtration efficiencies.
	1. Construct anteroom large enough for equipment staging, cart cleaning, workers. The anteroom must be constructed adjacent to entrance of construction work area. 2. Personnel will be required to always wear disposable coveralls during Class V work activities. Disposable coveralls must be removed before leaving the anteroom.

Revisions:	Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.

Mabbett
Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects

THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP

STATE OF MISSOURI
RUSSELL DINARDO
NUMBER A-2024000203
ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
INFECTION CONTROL RISK ASSESSMENT	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:		Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number: 1
		Issue Date: 06 MARCH 2026 / Checked: TB / Drawn: PS	Drawing Number: G003

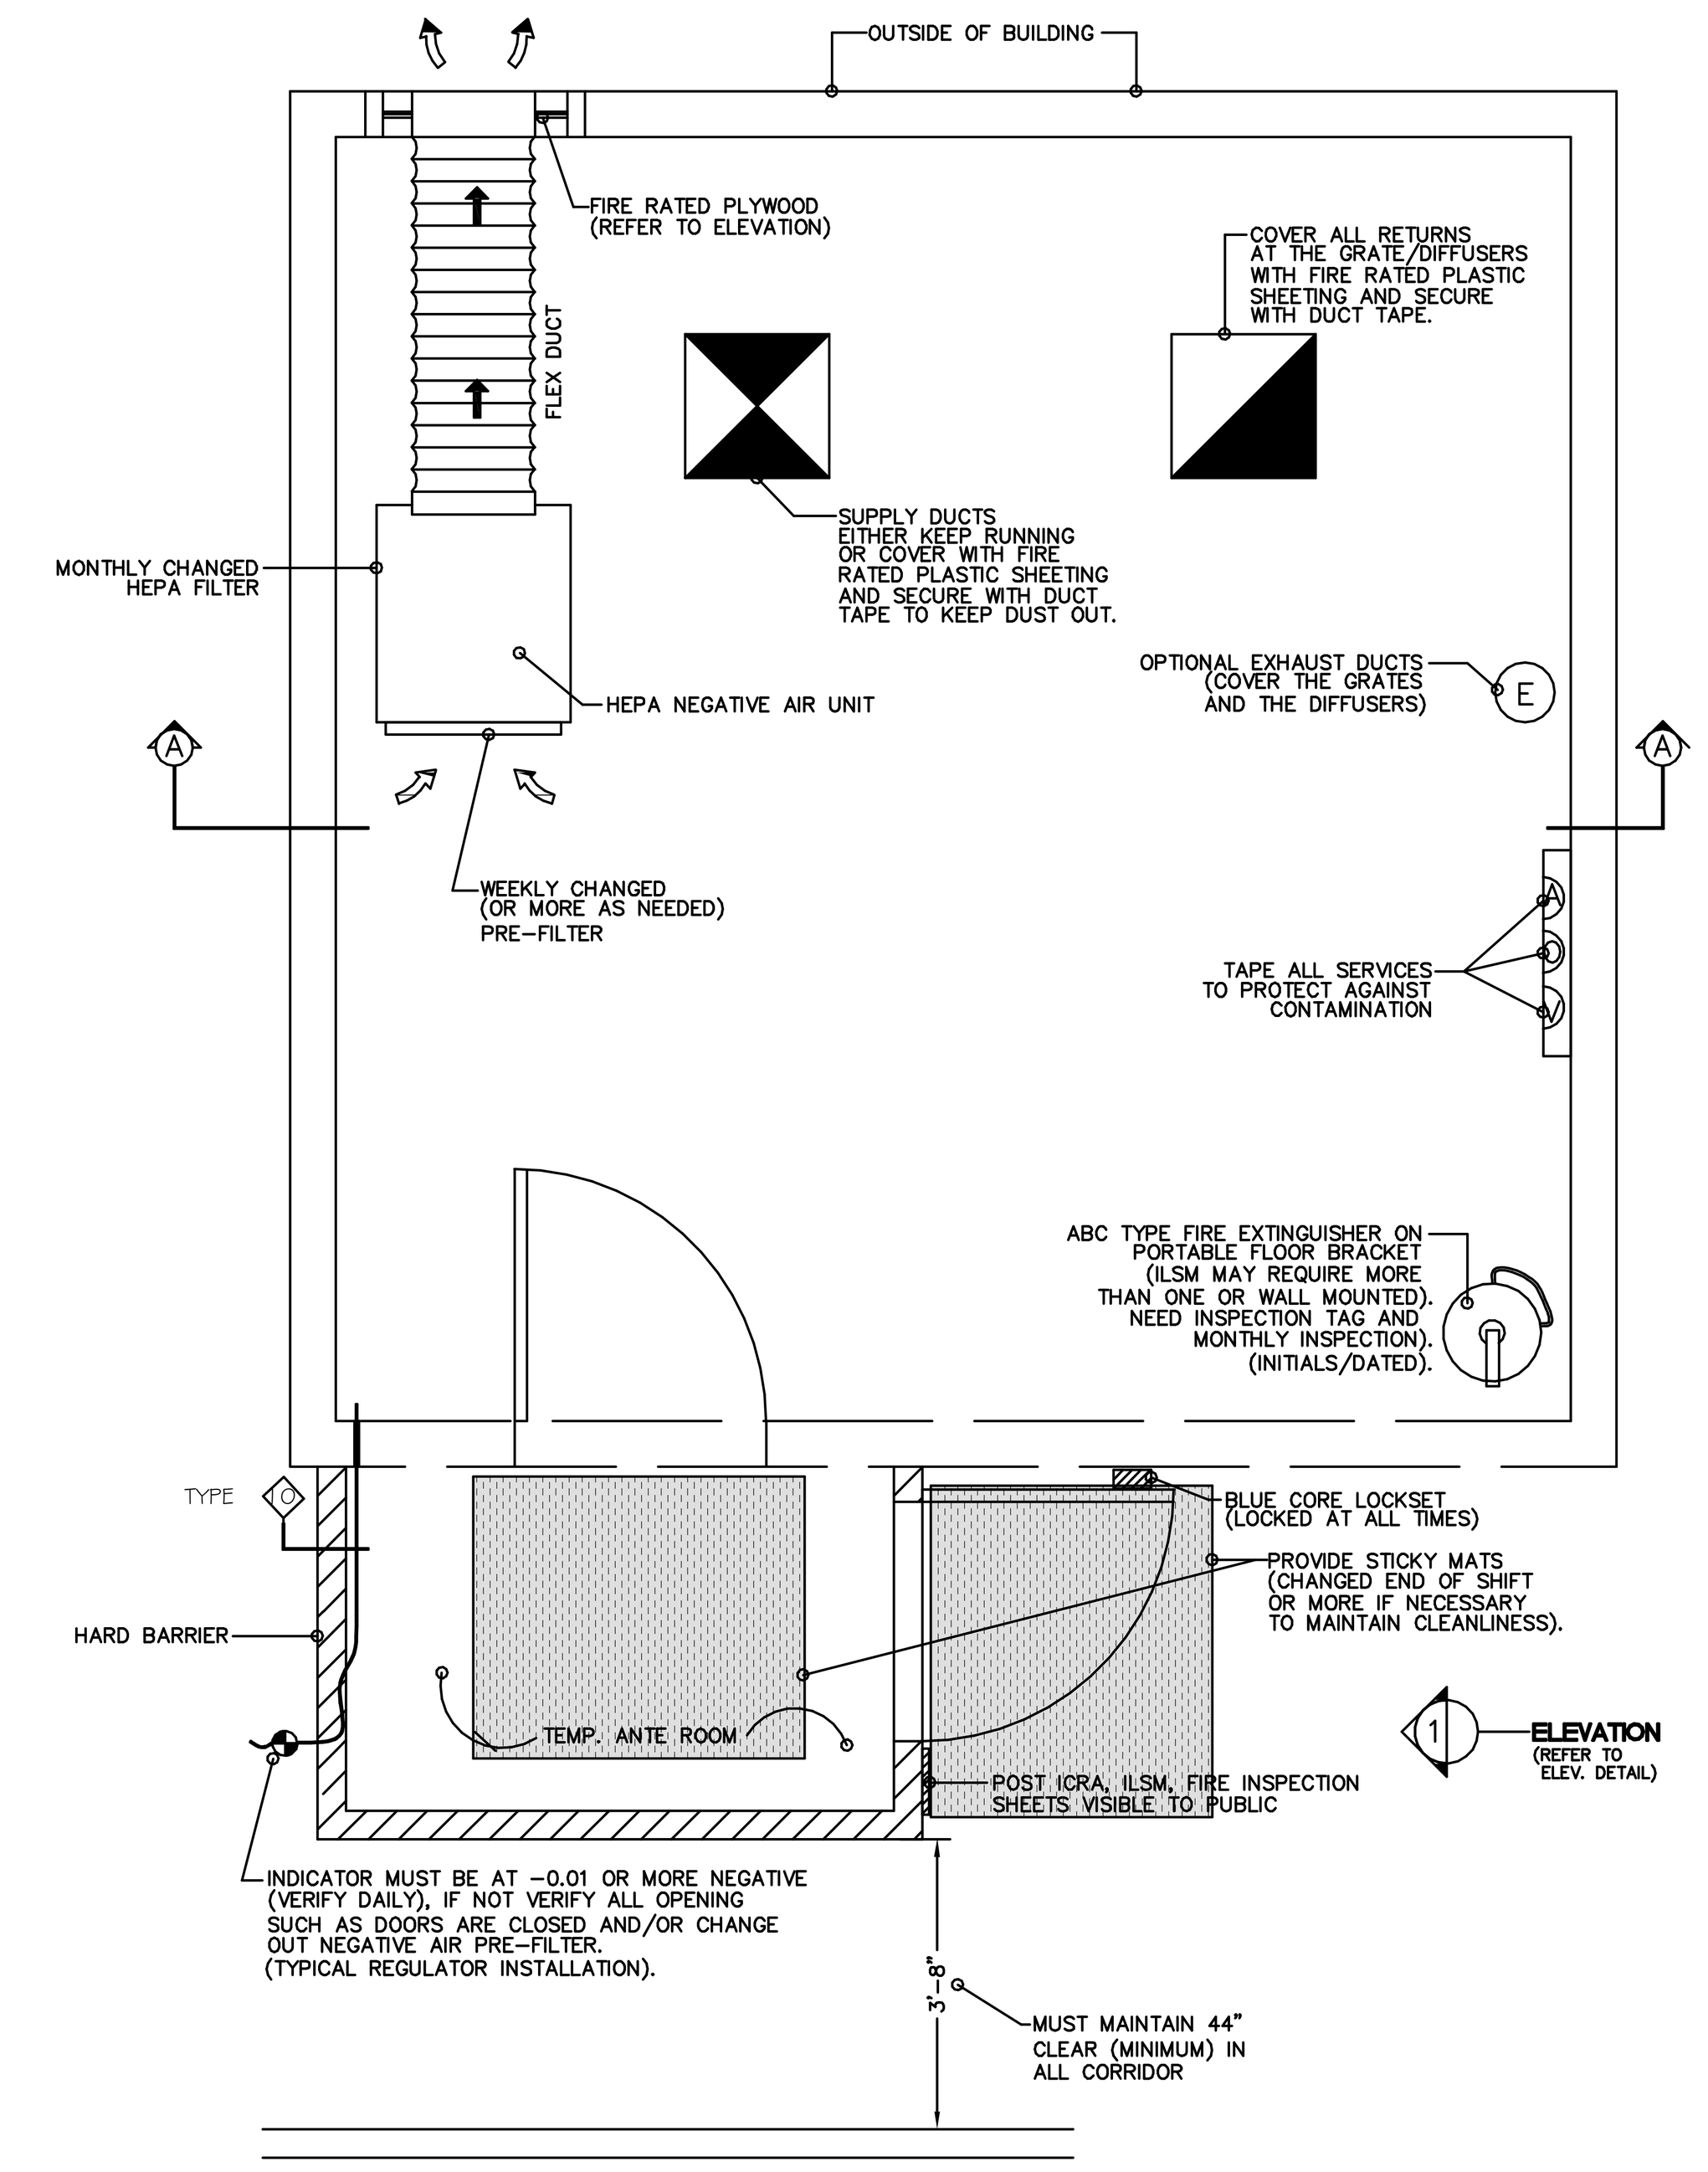

TYPICAL IDEAL CONSTRUCTION LAYOUT CLASS IV

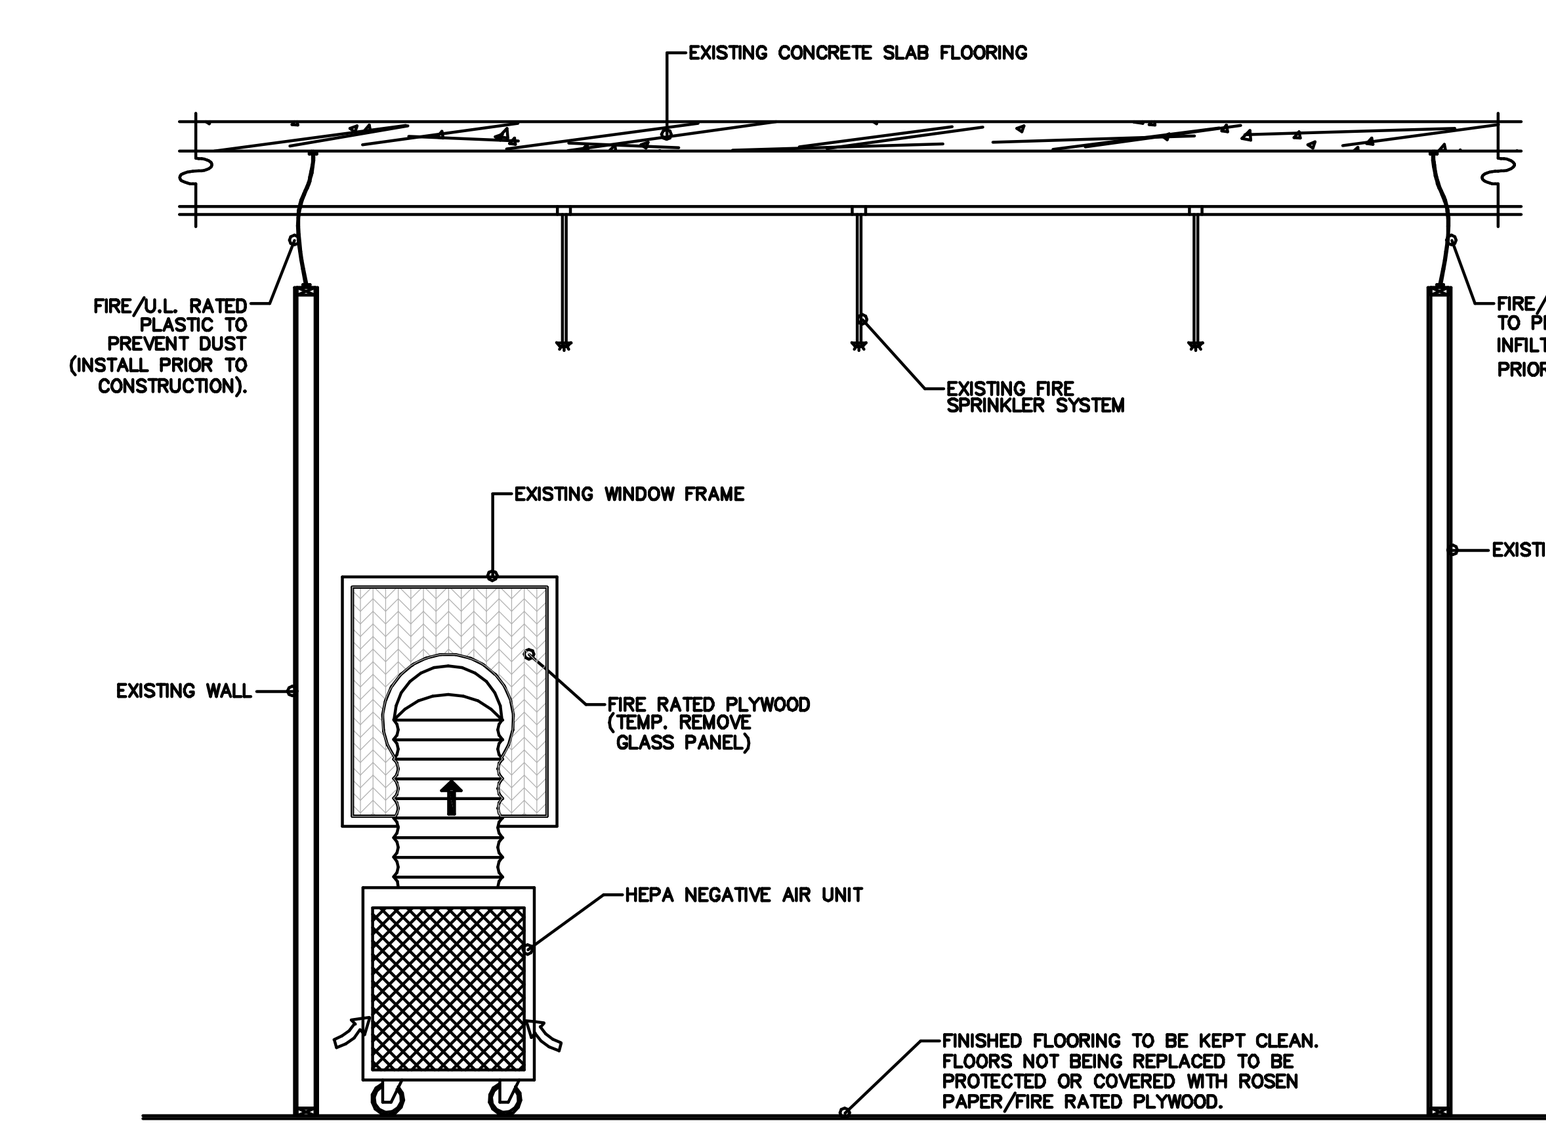

CROSS-SECTION 'A-A'
CLASS IV

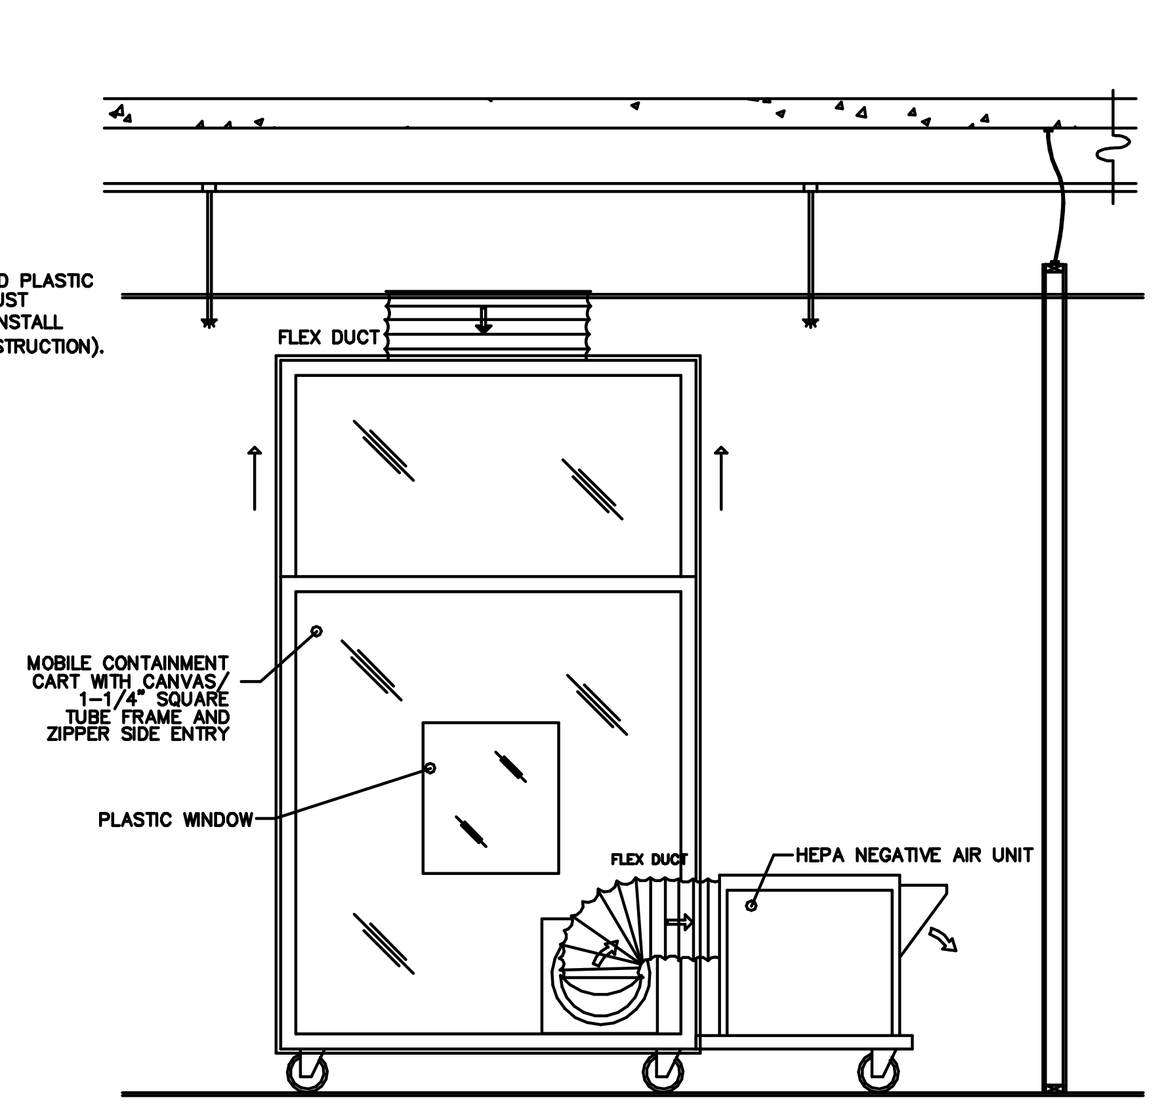

MOBILE CONTAINMENT CART

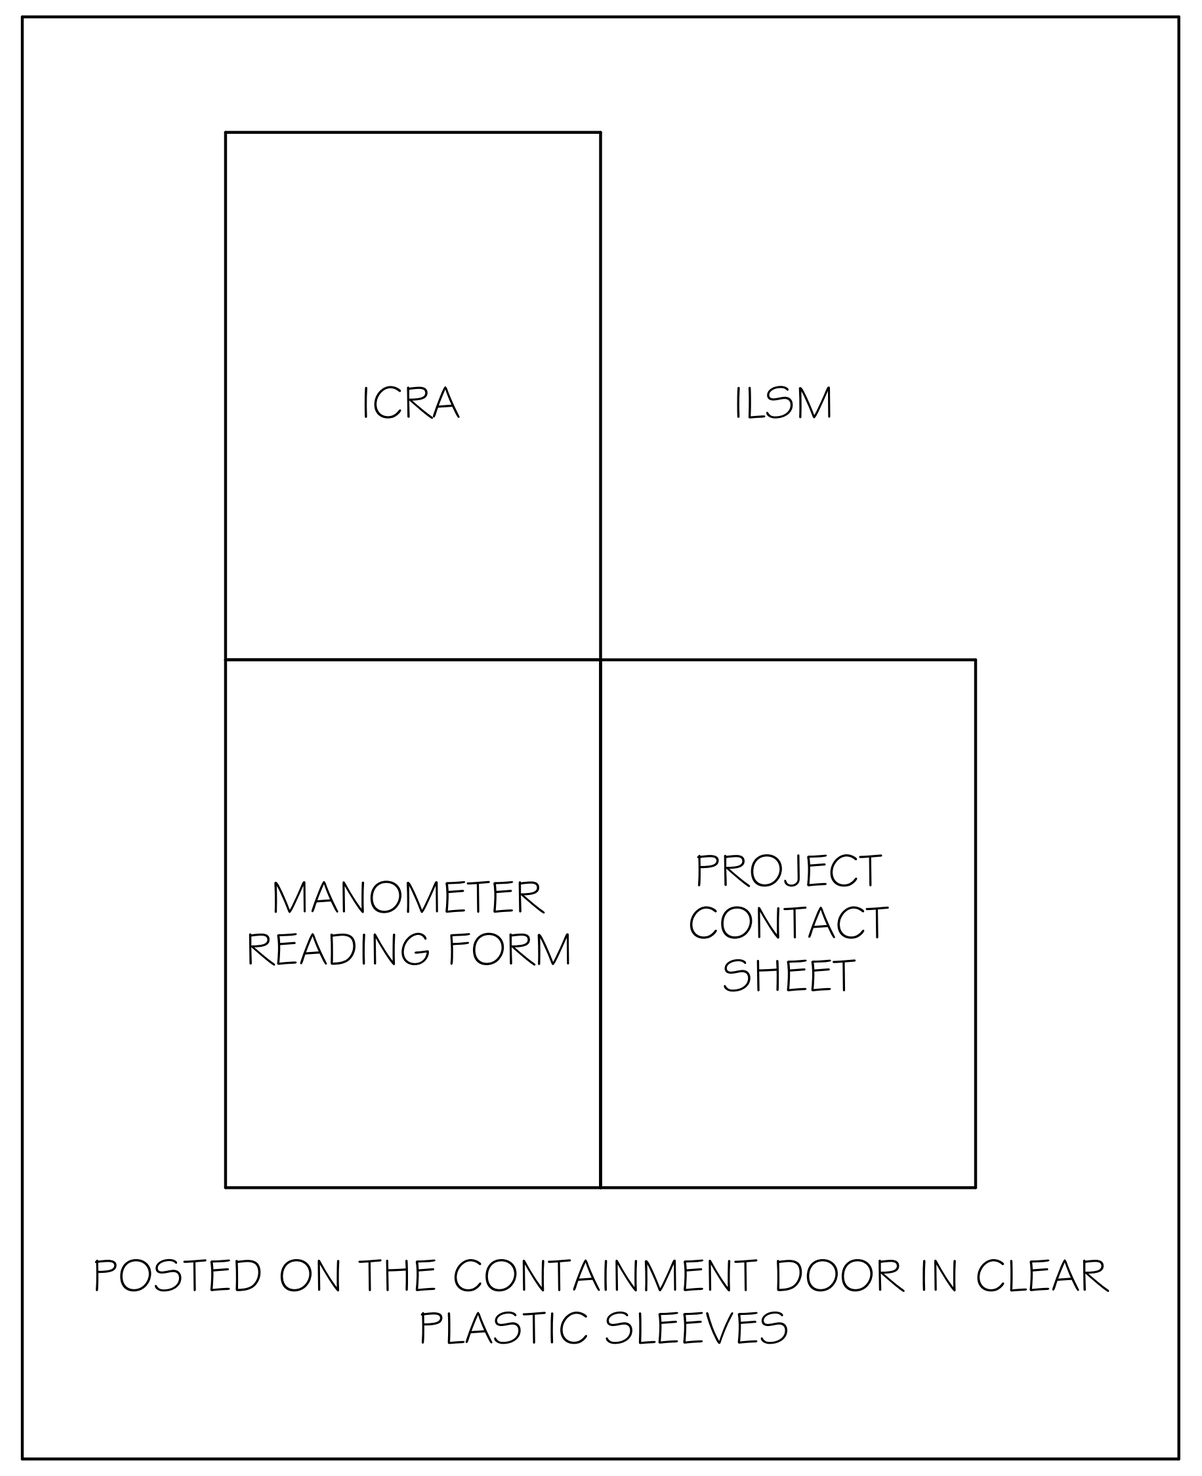

TYPE IV ICRA CONSTRUCTION DETAILS

Revisions: | Date:

CONSULTANT
Above Group ENGINEERING DESIGN CONSULTING
Mabbett® Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD
THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP
STATE OF MISSOURI RUSSELL DINARDO NUMBER A-2024000203 ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)
VA U.S. Department of Veterans Affairs

Drawing Title: TYPICAL ICRA CONSTRUCTION DETAILS
Approved:

Phase: 100% CONTRACT DOCUMENTS FOR BIDDING

Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date: 06 MARCH 2026 | Checked: TB | Drawn: PS

Project Number: 657-23-104JC
Building Number: 1
Drawing Number: G004

VA FORM 08 - 6231
Autodesk Docs://24001 VA ST Louis CT/657-23-104JC_657-JC-01-02_ARCH.rvt
3/3/2026 2:40:09 PM

0A GYP. BD. ON METAL STUDS

1 LAYER OF 5/8" IMPACT RESISTANT GYP. BD. EXTEND TO 6" ABOVE CEILING ON ONE SIDE OF 7/8" (U.N.O) METAL FURRING @16" O.C. STUDS EXTEND TO UNDERSIDE OF DECK ABOVE.

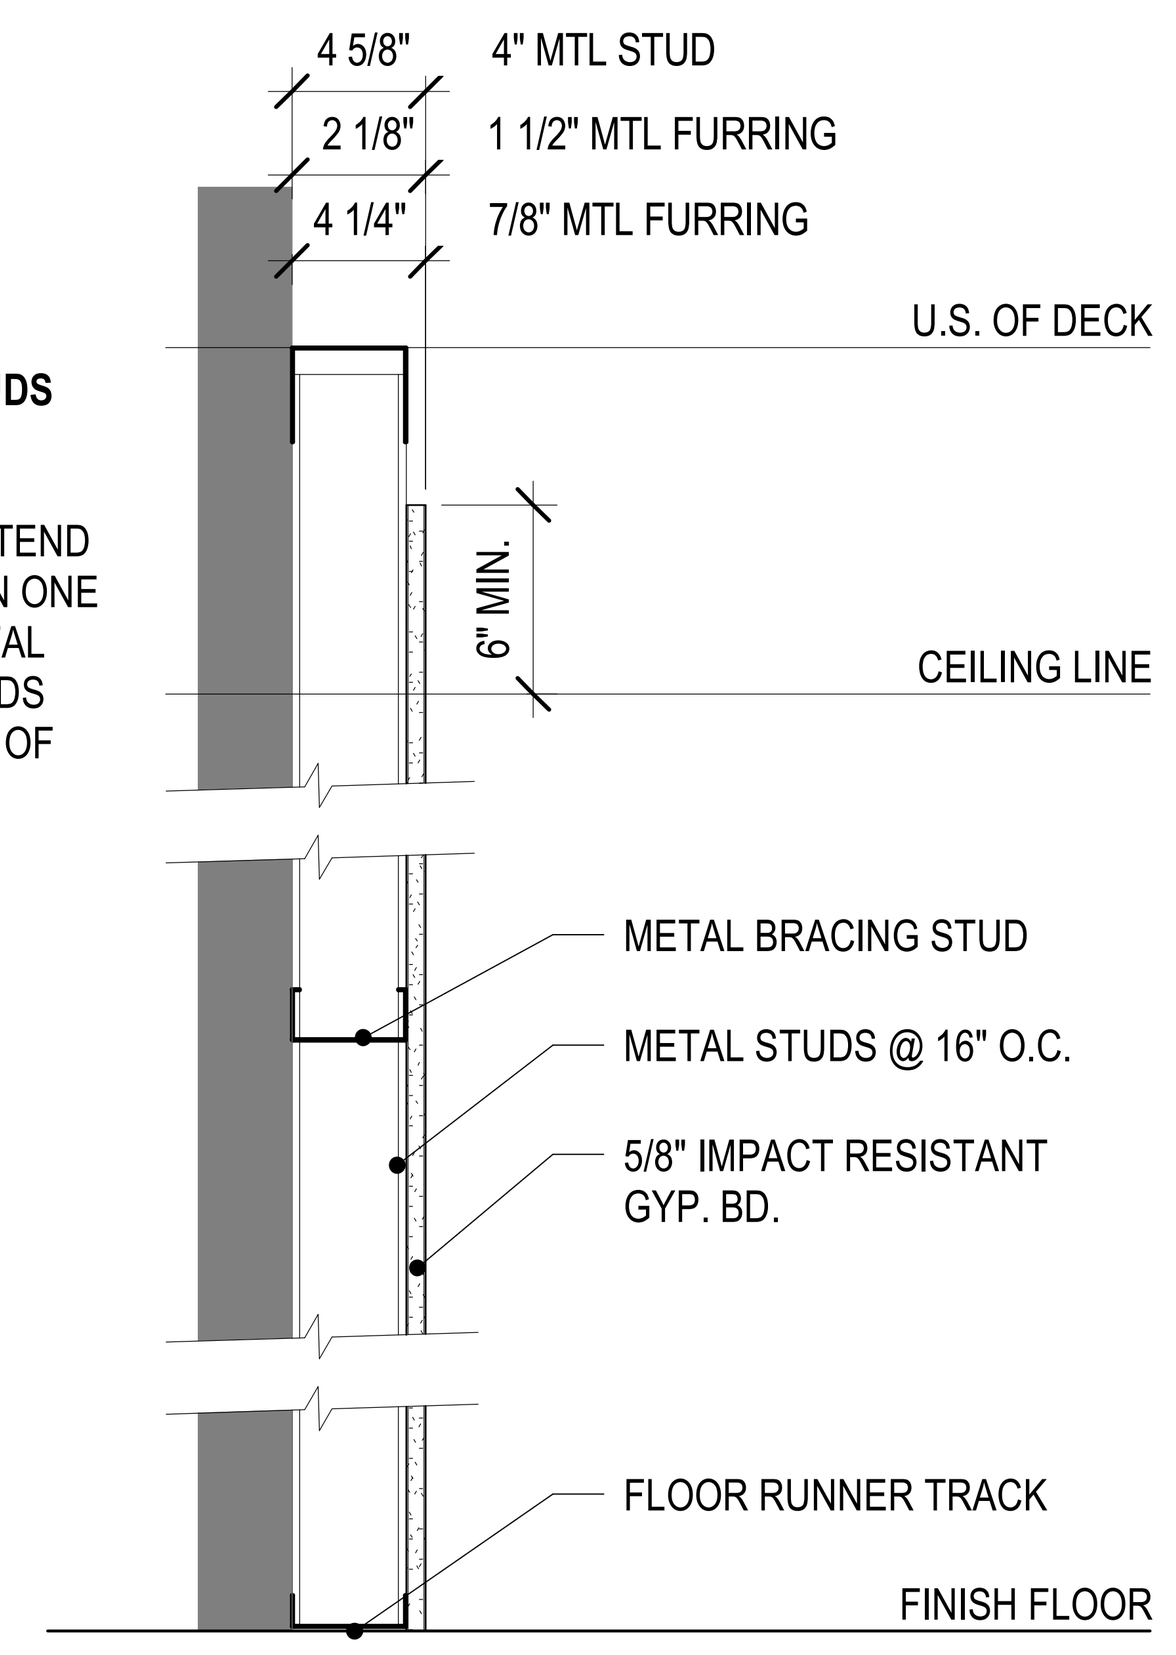

1A GYP. BD. ON 7/8" FURRING

(1) LAYER OF 5/8" GYP. BD. GYP. BD. TO EXTEND TO DECK

1B LEAD LINED GYP. BD. ON 7/8" FURRING

(1) LAYER OF 5/8" IMPACT RESISTANT GYP. BD. AND LEAD LINING.
GYP. BD. TO EXTEND TO DECK

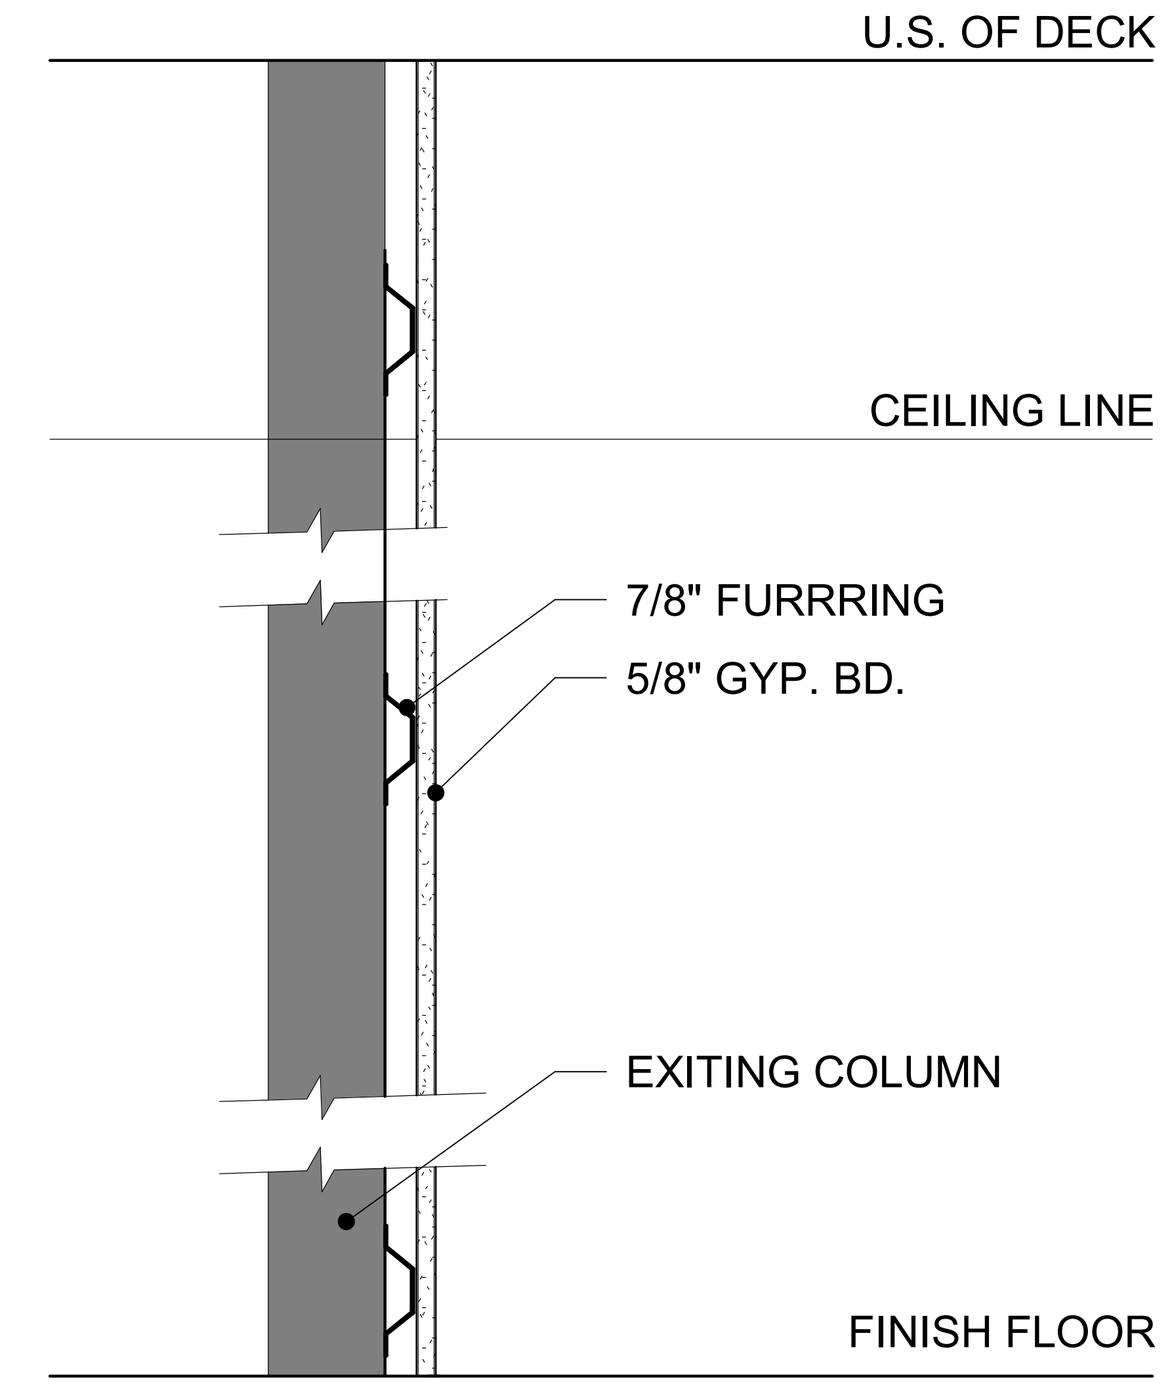

LEAD LINE WALL NOTE:
VA TO CONDUCT IN-HOUSE REVIEW TO VERIFY SHIELDING REQUIREMENTS AND LEAD THICKNESS.

3A GYP. BD. ON METAL STUDS

1 LAYER OF 5/8" IMPACT RESISTANT GYP. BD. EACH SIDE OF 3 5/8" (U.N.O.) METAL STUDS @16" O.C. PARTITION EXTENDS TO UNDERSIDE OF DECK ABOVE.

3B LEAD LINED GYP. BD. ON METAL STUDS

1 LAYER OF 5/8" IMPACT RESISTANT GYP. BD. AND LEAD LINING ON EACH SIDE OF 3 5/8" (U.N.O.) METAL STUDS @16" O.C. PARTITION EXTENDS TO UNDERSIDE OF DECK ABOVE.

3C LEAD LINED GYP. BD. ON METAL STUDS

1 LAYER OF 5/8" IMPACT RESISTANT GYP. BD. AND LEAD LINING ON EACH SIDE OF 6" (U.N.O.) METAL STUDS @16" O.C. PARTITION EXTENDS TO UNDERSIDE OF DECK ABOVE.

3D GYP. BD. ON METAL STUDS

1 LAYER OF 5/8" IMPACT RESISTANT GYP. BD. EACH SIDE OF 6" (U.N.O.) METAL STUDS @16" O.C. PARTITION EXTENDS TO UNDERSIDE OF DECK ABOVE.

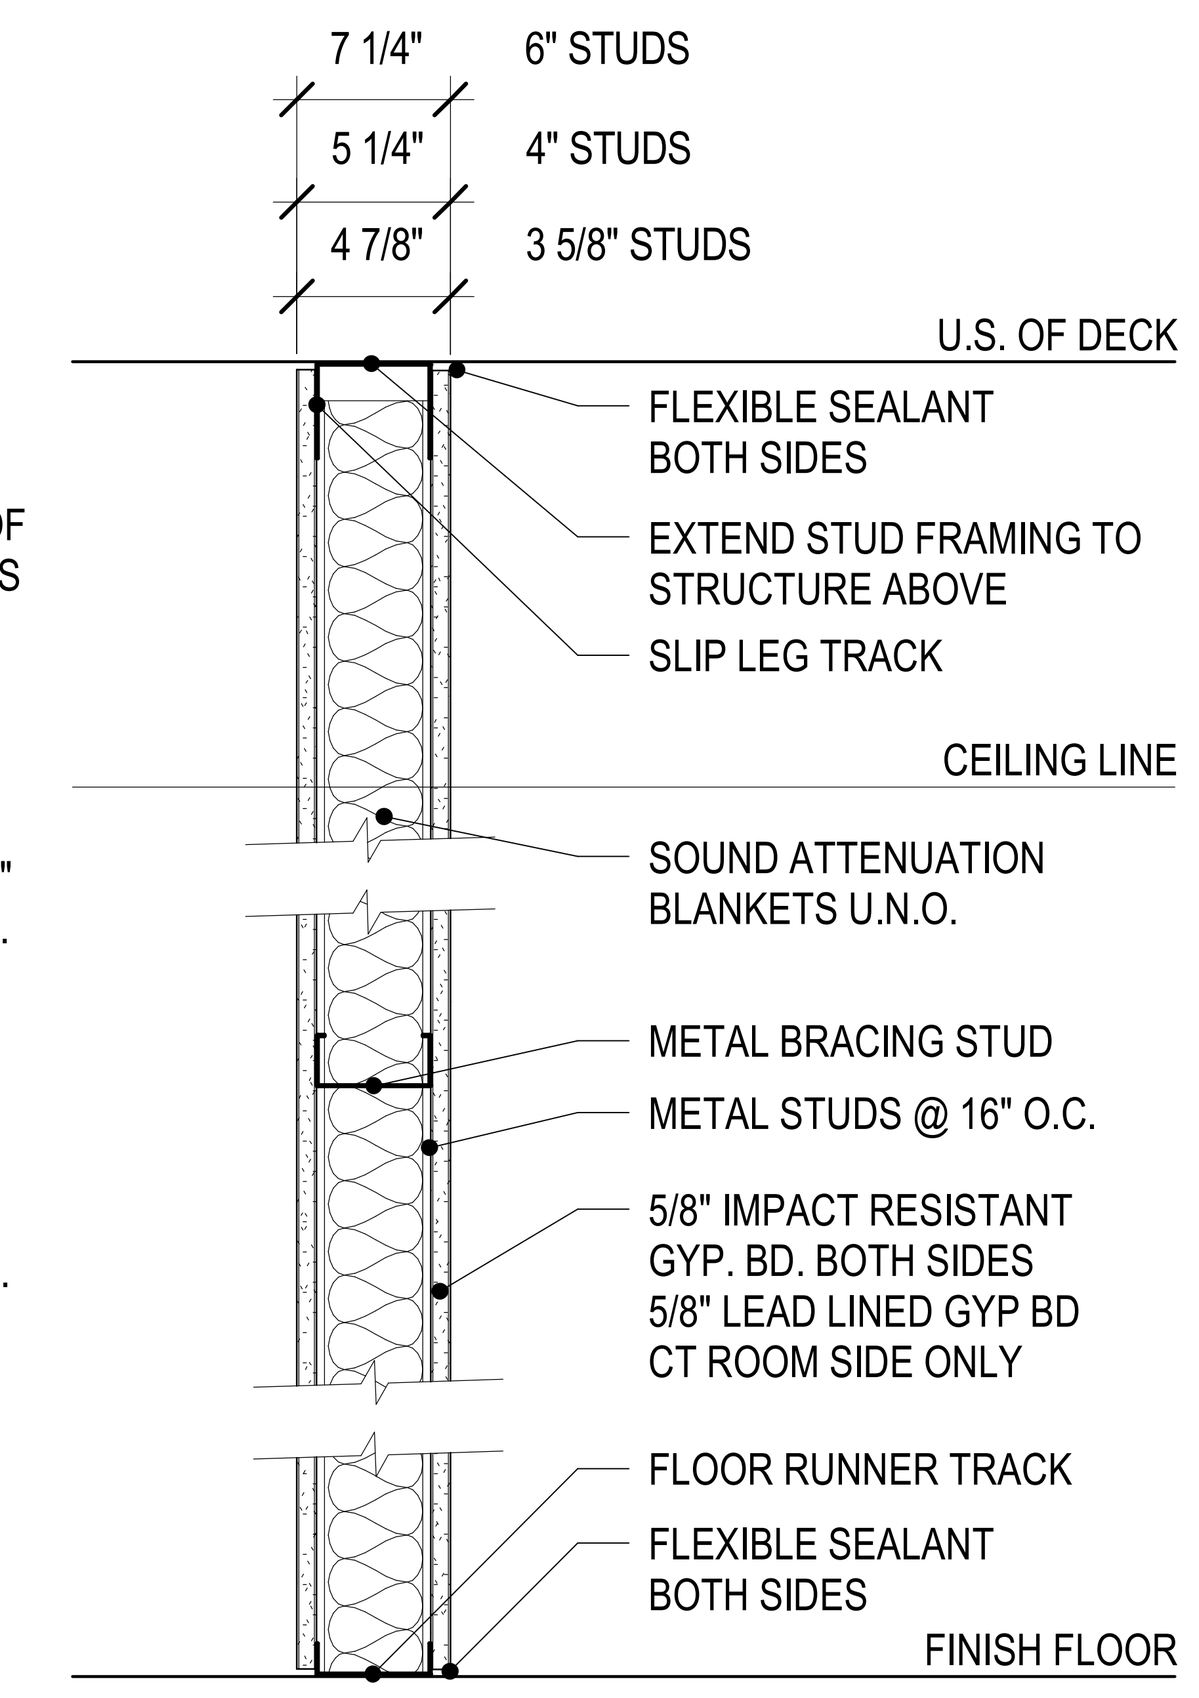

LEAD LINE WALL NOTE:
VA TO CONDUCT IN-HOUSE REVIEW TO VERIFY SHIELDING REQUIREMENTS AND LEAD THICKNESS.

PARTITION NOTES:

A. ALL STUD SPACING IS 16 INCHES ON CENTER UNLESS NOTED OTHERWISE.

B. SEE FINISH SCHEDULE FOR LOCATION OF APPLIED FINISHES (SUCH AS WALL COVERING, ETC.) THAT MAY AFFECT THE PARTITION SURFACE AND CONSTRUCTION REQUIREMENTS.

C. ALL SOUND RATED WALLS OR PARTITIONS (STC 45 OR AND ABOVE) SHALL HAVE AN ACOUSTICAL GASKET AND/OR ACOUSTICAL SEALANT AT THE TOP, BOTTOM AND SIDES WHERE A SOUND LEAK COULD OCCUR. ALL PENETRATIONS THROUGH SUCH PARTITIONS SHALL BE GASKETED AND SEALED ALONG THE PENETRATION PERIMETER. IF PARTITIONS ARE FIRE-RATED, PROVIDE UL-LABELED FIRE STOPPING IN PLACE OF ACOUSTICAL SEALANT. AT PARTITIONS THAT ARE SOUND AND FIRE RATED, PROVIDE ACOUSTICAL SEALANT AT PARTITION PENETRATIONS THAT DO NOT REQUIRE FIRE STOPPING (EXAMPLE: DUCT PENETRATIONS WITH FIRE DAMPERS).

D. ALL FIRE AND/OR SMOKE PARTITIONS, FIRE BARRIERS AND FIRE WALLS SHALL EXTEND FROM FINISH FLOOR TO WHERE IT MAY BE SEALED, SUCH AS THE UNDERSIDE OF THE STRUCTURE OR DECK, AND BE ENTIRELY SEALED WITH FIRE SAFING MATERIALS PER AN APPROVED FIRE RATED ASSEMBLY IN ACCORDANCE WITH A U.L. DESIGN, OR A DESIGN TESTED BY A TESTING LAB APPROVED BY THE AUTHORITY HAVING JURISDICTION. ALL PENETRATIONS THROUGH AND EDGES OF PARTITIONS SHALL ALLOW FOR APPROPRIATE DEFLECTIONS AND MOVEMENT OF ADJACENT MATERIALS AND RESULTING SPACES PROPERLY FILLED WITH FIRE SAFING INSULATION AND/OR SEALED TO MAINTAIN THE RATING INTEGRITY.

E. ALL RATED PARTITIONS SHALL BE PERMANENTLY IDENTIFIED WITH A SIGN OR STENCILING ABOVE THE CEILING. THE SIGN SHALL READ **"X-HOUR FIRE AND/OR SMOKE BARRIER - PROTECT ALL OPENINGS"**, AND BE LOCATED A MAXIMUM 15 FEET O.C. ON CONTINUOUS WALLS. BEGIN NEW SERIES ON ALL CORNERS. LETTERING AND ARROWS MAY BE UTILIZED TO INDICATE THE DIRECTION AND EXTENT OF THE FIRE RATING.

F. PARTITIONS WITH SOUND ATTENUATION BLANKETS WHICH DO NOT EXTEND TO THE UNDERSIDE OF STRUCTURE SHALL HAVE ENCAPSULATED SOUND ATTENUATION BLANKETS ON BOTH SIDES OF THE PARTITION (MINIMUM 24" WIDE) ABOVE THE FINISHED CEILING.

G. PROVIDE BLOCKING AT ALL ACCESSORIES AND CASEWORK.

H. AT SPACES WITHOUT CEILINGS, SURROUNDING PARTITIONS SHALL EXTEND TO STRUCTURE OR DECK ABOVE WITHOUT ANY VOIDS ABOVE TOP OF WALL.

I. SEE SPECIFICATION SECTION 092900 - GYPSUM BOARD ASSEMBLIES FOR FINISH LEVEL REQUIRED, UNLESS SPECIFICALLY NOTED.

J. PROVIDE L-BEAD WITH SEALANT AND BACKER ROD WHERE GWB ABUTS A DISSIMILAR MATERIAL SUCH AS CMU.

K. WALL ACCESSORIES SUCH AS FIRE EXTINGUISHER CABINETS, PAPER TOWEL DISPENSERS, ETC. INSTALLED IN RATED WALLS SHALL BE INSTALLED IN A MANNER WHICH WILL NOT REDUCE THE FIRE RATING OF THE WALL.

L. ALL OUTSIDE CORNERS AND END OF GYPSUM BOARD PARTITIONS SHALL RECEIVE METAL CORNER BEADS OR METAL TRIM UNLESS NOTED OTHERWISE.

M. SHIELDING WILL NEED TO BE CONFIRMED WITH THE FINAL VA STUDY.

N. ANY PENETRATIONS IN A GIVEN BARRIER SHOULD BE DESIGNED TO AFFORD THE SAME SHIELDING EQUIVALENCY OR GREATER AS THAT SPECIFIED FOR THE BARRIER AND SHOULD HAVE NO VOIDS.

5A EXISTING WALL W/ NEW LEAD LINING
1 LAYER OF 5/8" IMPACT RESISTANT LEAD LINE GYP. BD. ON RADIATION SIDE OF EXISTING 3 5/8" (U.N.O.) METAL STUDS @16" O.C. PARTITION. EXTENDS TO UNDERSIDE OF DECK ABOVE.

5B EXISTING WALL W/ GYP
1 LAYER OF 5/8" IMPACT RESISTANT GYP. BD. ON RADIATION SIDE OF EXISTING 3 5/8" (U.N.O.) METAL STUDS @16" O.C. PARTITION. EXTENDS TO UNDERSIDE OF DECK ABOVE.

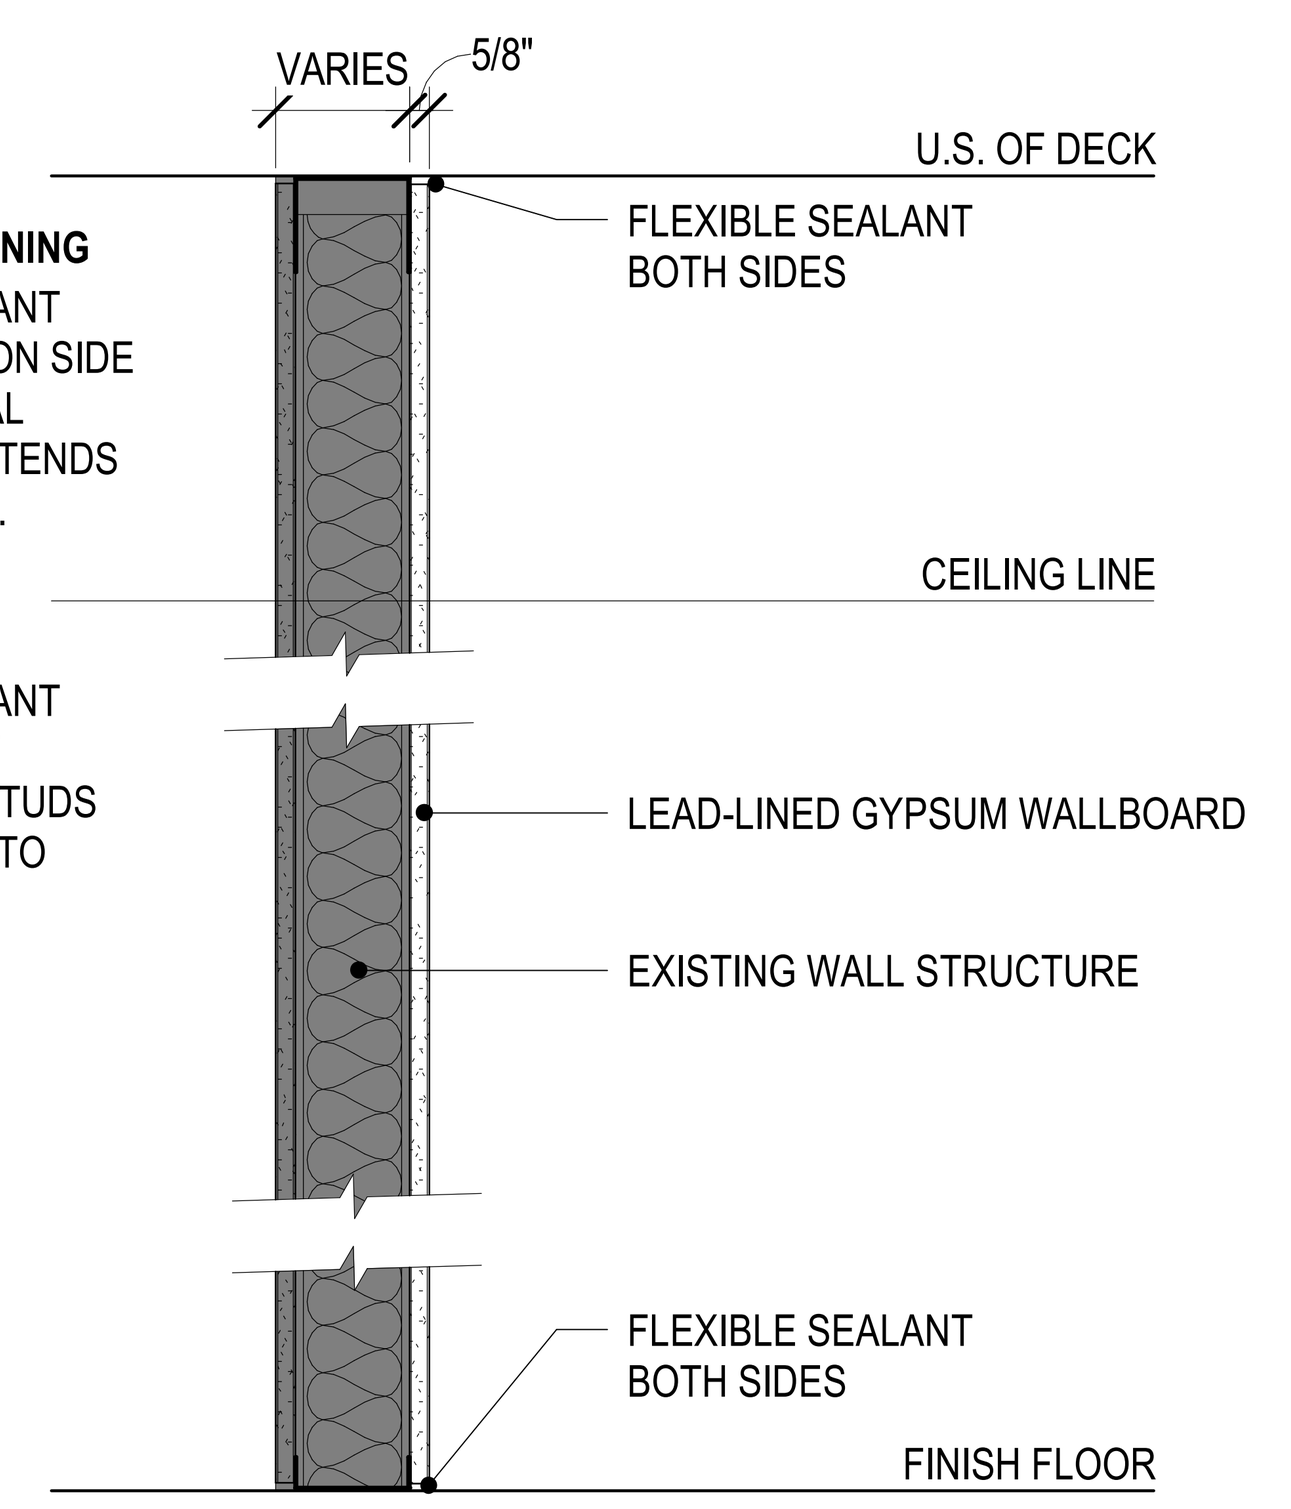

LEAD LINE WALL NOTE:
VA TO CONDUCT IN-HOUSE REVIEW TO VERIFY SHIELDING REQUIREMENTS AND LEAD THICKNESS.

Revisions:	Date:

CONSULTANT
Above Group
Mabbett

ARCHITECT/ENGINEER OF RECORD
THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP
STATE OF MISSOURI
RUSSELL DINARDO
NUMBER
A - 2024000203
ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)
VA U.S. Department of Veterans Affairs

Drawing Title: CONSTRUCTION SUB-SYSTEMS AND PARTITION TYPES
Approved:
Phase: 100% CONTRACT DOCUMENTS FOR BIDDING
Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date: 06 MARCH 2026
Checked: TB
Drawn: PS
Project Number: 657-23-104JC
Building Number: 1
Drawing Number: G005

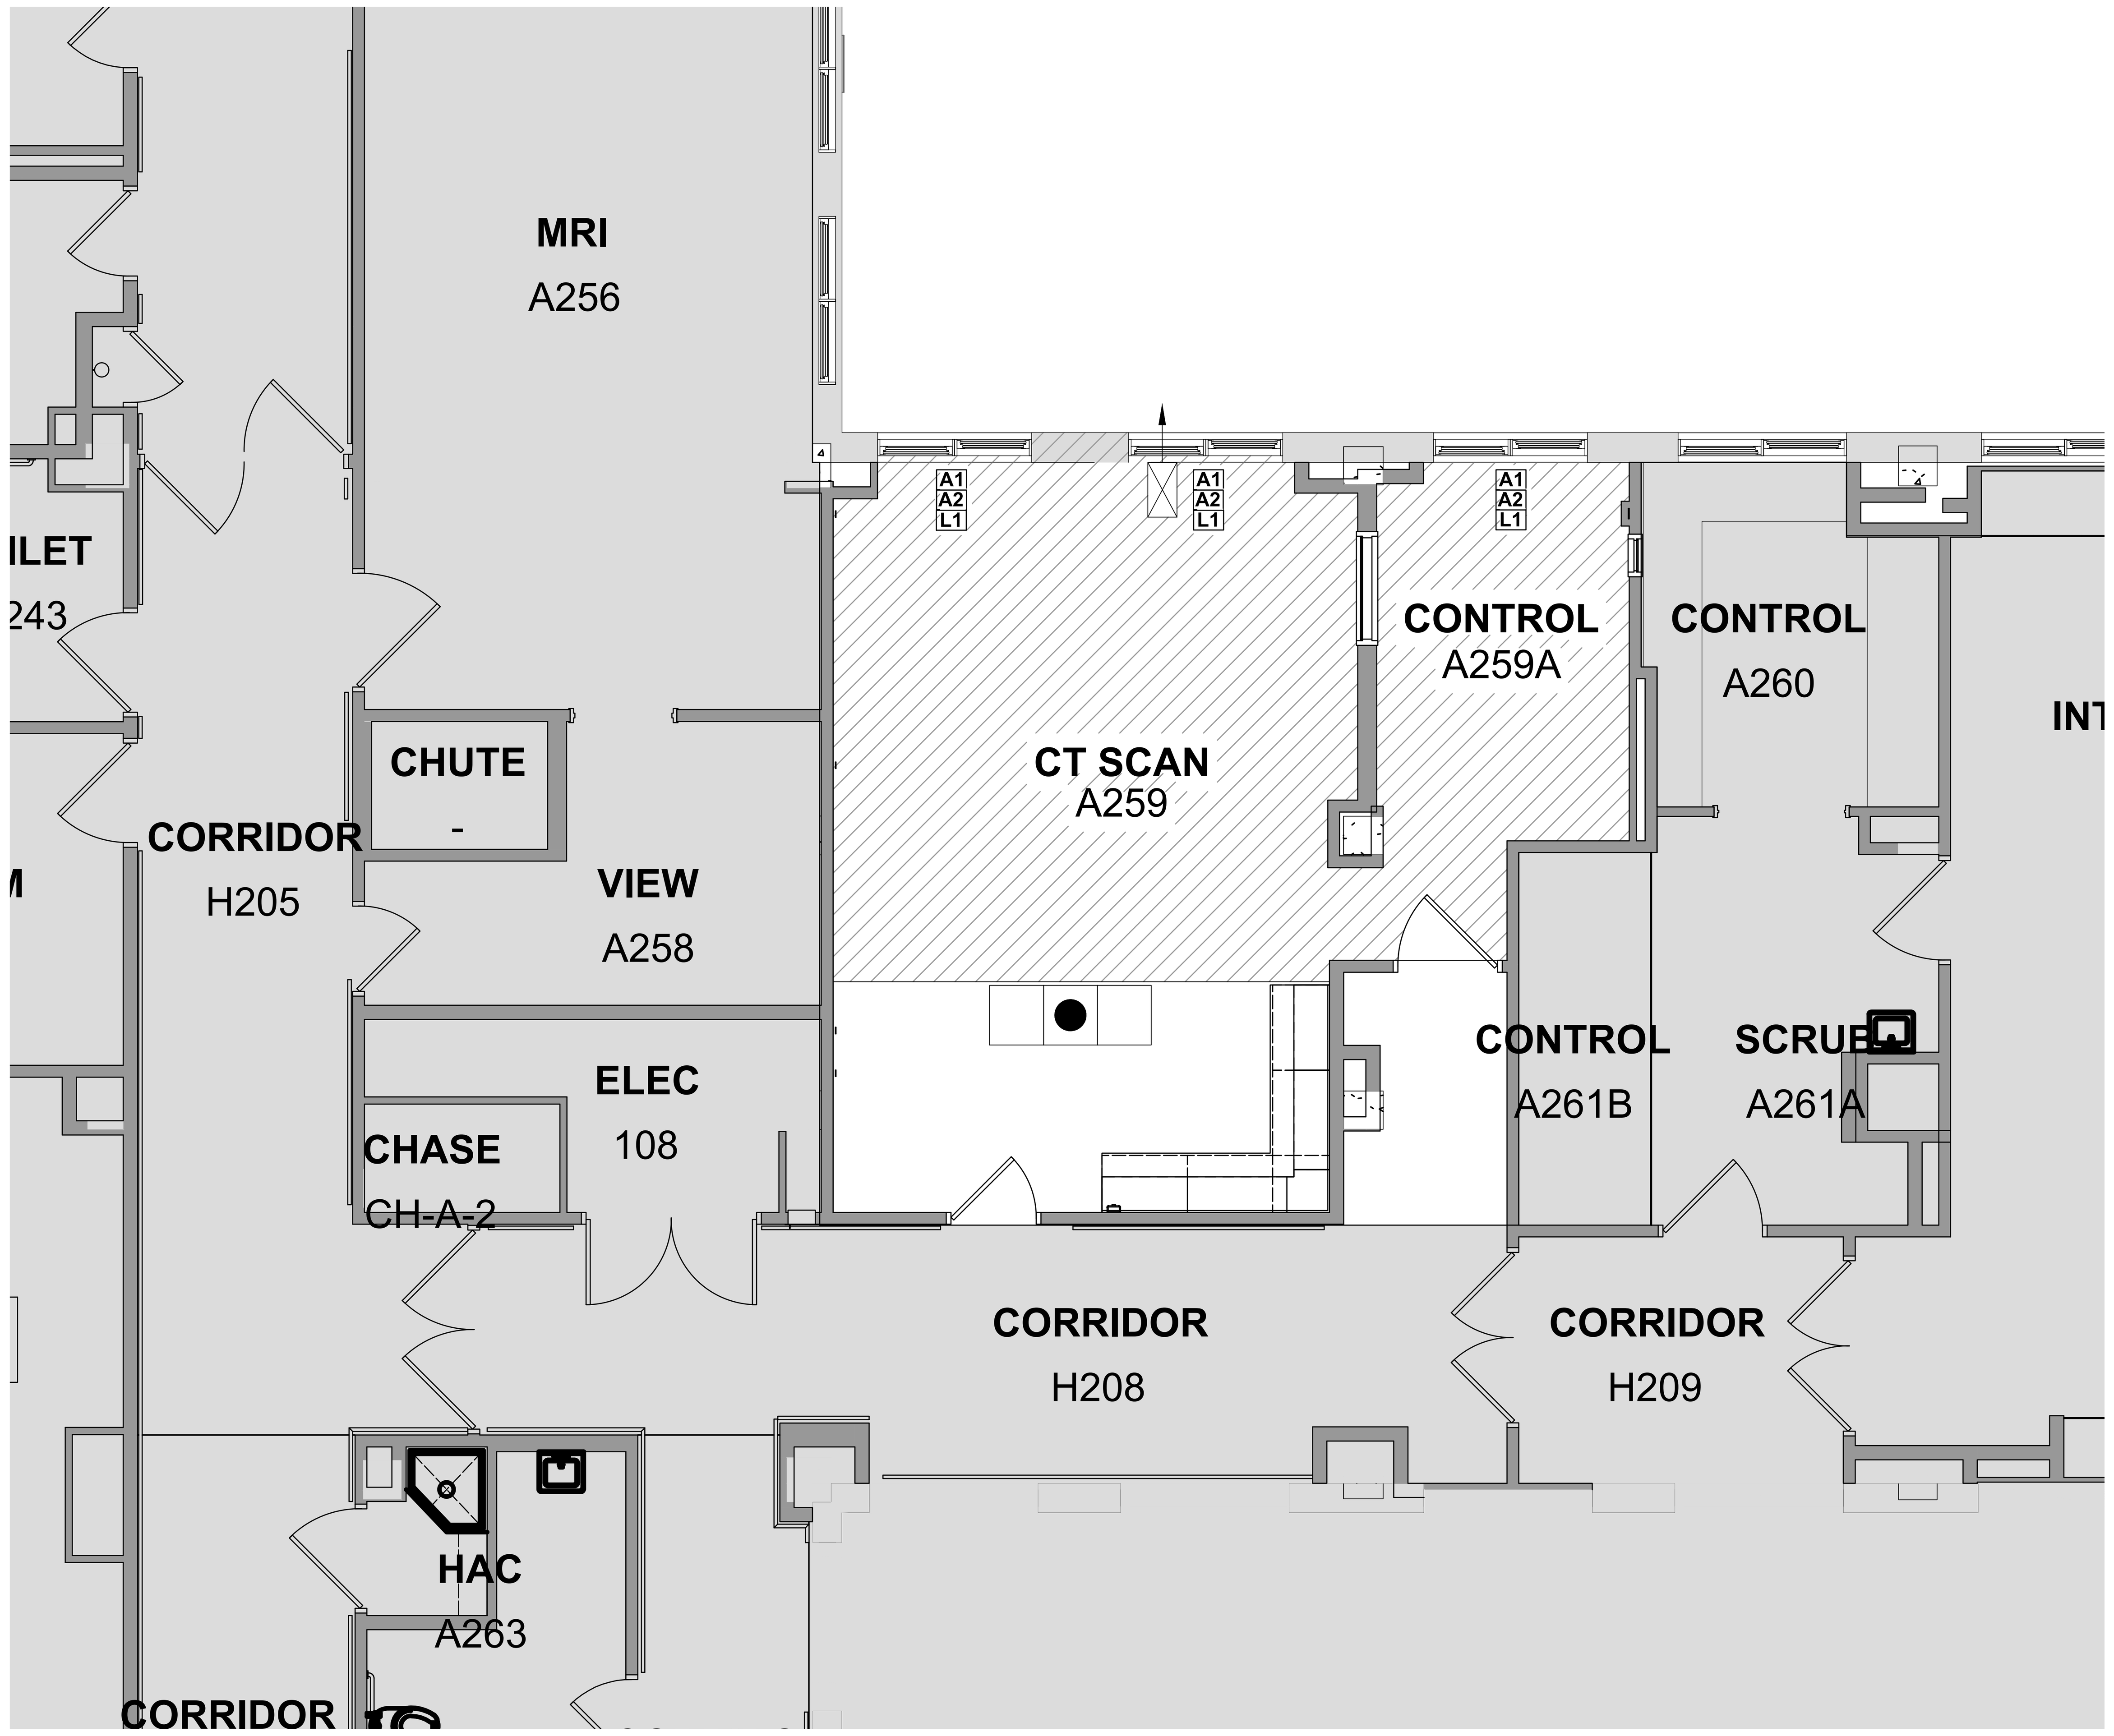

SECOND FLOOR
ABATEMENT PLAN

1

1/4" = 1'-0"

GENERAL ABATEMENT NOTES:

1. ASBESTOS ABATEMENT WORK SHALL BE PERFORMED IN ACCORDANCE WITH APPLICABLE GOVERNMENT REGULATIONS AND AS OUTLINED IN THE VA DOCUMENT "TRADITIONAL ASBESTOS ABATEMENT". THE CONTRACTOR SHALL USE MANUAL WET WORK METHODS TO CONTROL THE RELEASE OF DUST AND FIBERS WHEN PERFORMING THE REMOVAL OF ALL KNOWN AND ASSUMED ASBESTOS CONTAINING MATERIALS, ASBESTOS CONTAINING BUILDING COMPONENTS, AND NON-ASBESTOS CONTAINING MATERIALS FROM THE WORK AREA. MATERIALS REMOVED WILL BE CONTAINED FOR DISPOSAL UTILIZING APPROPRIATE WETTED RECEPTACLES FOR APPROPRIATE DISPOSAL IN ACCORDANCE WITH STATE AND FEDERAL REGULATIONS.

2. INTERIOR ABATEMENT ACTIVITIES WILL BE CONDUCTED UNDER A FULL CONTAINMENT CONSTRUCTED WITH APPROPRIATE LAYERS OF POLY TO MEET THE REQUIRED MIL THICKNESS AND FIRE RESISTANCE, AND A 3-CHAMBER PDF CONSTRUCTED WITH APPROPRIATE LAYERS OF POLY AND UNDERLAYMENT TO MEET THE REQUIRED MIL THICKNESS AND FIRE RESISTANCE.

3. THE CONTAINMENT SHALL MAINTAIN A NEGATIVE AIR PRESSURE OF AT LEAST -0.02 INCHES OF WATER COLUMN DURING ASBESTOS REMOVAL **AND UNTIL FINAL CLEARANCE IS GRANTED BY THE OWNERS VPIH/CIH.** THE CONTAINMENT SHALL BE EQUIPPED WITH DIGITAL MANOMETER(S) POSTED ON THE EXTERIOR OF THE CONTAINMENT SUFFICIENT TO CONTINUOUSLY MONITOR NEGATIVE PRESSURE WITHIN THE CONTAINMENT. NEGATIVE AIR PRESSURE SHALL BE CREATED IN THE WORK AREA USING HEPA FILTERED EXHAUST UNITS AND EXHAUSTED TO THE OUTDOORS AT A LOCATION DEEMED SAFE FROM POSSIBLE EXPOSURE. THE CONTAINMENT WILL BE EQUIPPED WITH ADEQUATE HEPA FILTERED EXHAUST UNITS TO GENERATE AT LEAST FOUR AIR CHANGES PER HOUR INSIDE THE WORK AREA.

4. THE CONTRACTOR SHALL REMOVE HAZARDOUS MATERIALS THAT EXIST WITHIN WORK AREAS PRIOR TO DISTURBANCE. REFER TO PROJECT DESIGN DOCUMENTS FOR FURTHER INFORMATION. REFER TO SPECIFICATIONS FOR REMOVAL REQUIREMENTS.

5. SYMBOLS SHOWING LOCATIONS OF KNOWN AND ASSUMED ASBESTOS CONTAINING WALL MOUNTED STEAM RADIATORS AND ASSOCIATED MATERIALS (A1)(THREE LOCATIONS) ARE APPROXIMATE AND NOT TO SCALE. THEY ARE FOR REFERENCE ONLY.

6. WORK AREAS WERE SURVEYED TO IDENTIFY HAZARDOUS MATERIALS. REFER TO MABBETT & ASSOCIATES REGULATED BUILDING MATERIALS SURVEY REPORT DATED MARCH 10, 2025 FOR ADDITIONAL INFORMATION. NOT ALL AREAS MAY HAVE BEEN ACCESSIBLE AND HAZARDOUS MATERIALS MAY EXIST WHICH HAVE NOT BEEN IDENTIFIED.IF SUSPECT MATERIALS ARE DISCOVERED WHICH HAVE NOT BEEN PREVIOUSLY IDENTIFIED, THE CONTRACTOR SHALL NOT DISTURB THOSE MATERIALS AND SHALL IMMEDIATELY NOTIFY THE CONTRACTING OFFICERS REPRESENTATIVE.

7. ALTHOUGH NOT ANTICIPATED TO BE IMPACTED, OSHA LEAD REGULATIONS WILL APPLY TO ANY DEMOLITION OR RENOVATION OPERATION (I.E. SANDING, SCRAPING, CUTTING, AND WELDING) THAT WOULD DISTURB PAINTED SURFACES OR BUILDING MATERIALS WHICH CONTAIN LEAD IN ANY CONTENT. OCCUPATIONAL EXPOSURE TO LEAD IS REGULATED BY OSHA (29 CFR 1910.1025) AS WELL AS APPLICABLE STATE REGULATIONS. DISPOSAL OF MATERIALS COATED WITH PAINT OR BUILDING MATERIALS CONTAINING LEAD ARE SUBJECT TO THE USEPA RESOURCE CONSERVATION AND RECOVERY ACT (RCRA) REGULATIONS. REFER TO SPECIFICATIONS FOR FURTHER INFORMATION.

ABATEMENT KEYNOTES:

A1 EXISTING WALL MOUNTED STEAM RADIATORS ARE ASSUMED TO CONTAIN ACM. IF IMPACTED BY THE PROJECT, THE ABATEMENT CONTRACTOR SHALL REMOVE AND DISPOSE 12 SF OF ASSUMED ASBESTOS CONTAINING INSULATION AND BACKING MATERIAL AS ACM, 1 ENCLOSURE.

A2 LEAD (Pb) PAINT ON THE WINDOW SILL, PROTECT AS NECESSARY.

L1 REMOVE RADIATOR. REMOVE ASSUMED ACM INSULATION AND BACKING MATERIAL PRESENT.

ABATEMENT LEGEND:

NEGATIVE PRESSURE ENCLOSURE

THREE STAGE DECON AND TWO STAGE LOAD OUT IN ACCORDANCE WITH SPECIFICATIONS

HEPA EXHAUST FAN

KEY PLAN

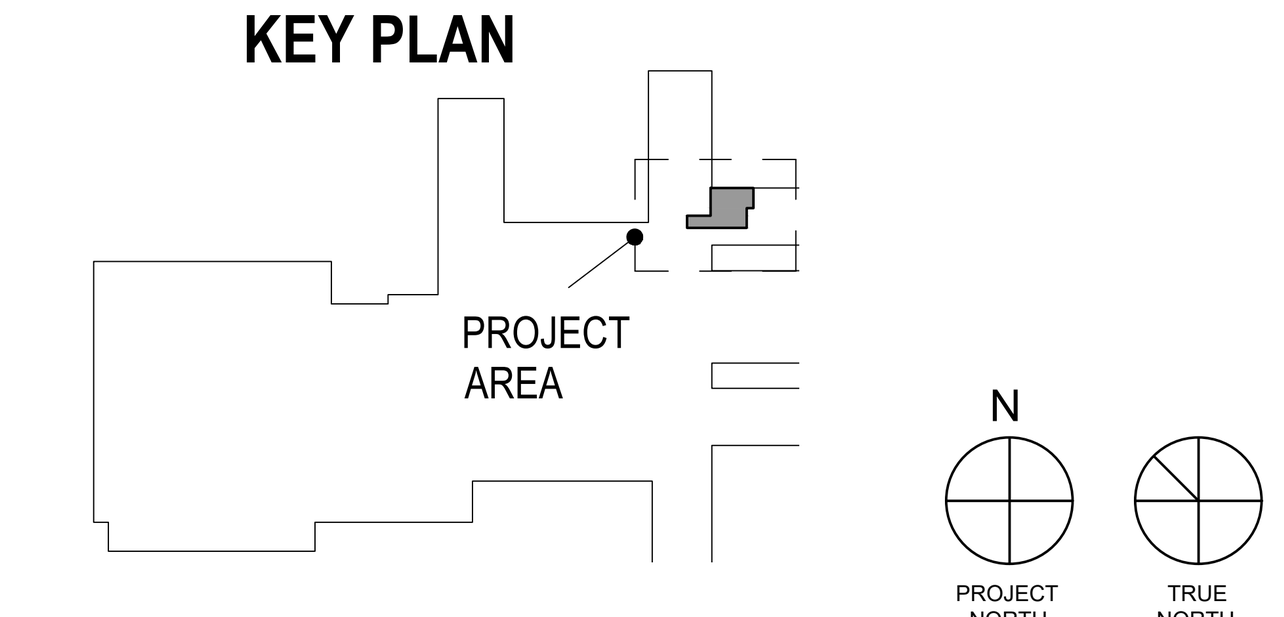

Revisions: | Date:

CONSULTANT

Mabbett®
Scientists | Engineers | Program Managers
Mabbett & Associates, Inc.
105 Central Street Stoneham, MA 02180
T. 781-275-6050
www.mabbett.com

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

REVIEWED BY MISSOURI DNR ASBESTOS - PROJECT DESIGNER
William L Wright
No. 17835

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	SECOND FLOOR ABATEMENT PLAN
Approved:	
Phase	100% CONTRACT DOCUMENTS FOR BIDDING
Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	WLW
Drawn	DJA
Project Number	657.23.104JC
Building Number	1
Drawing Number	HA101

GENERAL NOTES

GENERAL:

1. CONTRACTOR IS SOLELY RESPONSIBLE FOR MEANS AND METHODS DURING THE COURSE OF THE WORK. DO NOT DAMAGE OR ENDANGER THE STRUCTURAL INTEGRITY OF THE WORK.
2. CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROPER AND SAFE DESIGN OF SHORING SYSTEMS FOR TRENCHES AND EXCAVATIONS.
3. LOADS GREATER THAN THE DESIGN LIVE LOADS SHALL NOT BE PLACED ON THE STRUCTURE.
4. NOTIFY COR IN CASE OF DISCREPANCIES BETWEEN DRAWINGS, THESE NOTES, AND PROJECT MANUAL BEFORE PROCEEDING WITH THE WORK.
5. USE ARCHITECTURAL DRAWINGS AND DRAWINGS OF OTHER TRADES IN CONJUNCTION WITH THE STRUCTURAL DRAWINGS TO PROPERLY PERFORM THE WORK.
6. IF CONDITIONS DISCLOSED DURING EXCAVATION REVEAL UNFORESEEN CONDITIONS, PROMPTLY REQUEST DIRECTION FROM COR BEFORE PROCEEDING.
7. CONTRACTOR IS RESPONSIBLE FOR COORDINATING BETWEEN TRADES.
8. DO NOT SCALE DRAWINGS.
9. SECTIONS AND DETAILS SHOWN, WHILE DRAWN FOR SPECIFIC LOCATIONS, ARE INTENDED TO ESTABLISH THE GENERAL TYPES OF DETAILS WILL APPLY TO OTHER LOCATIONS.
10. THE ENGINEER'S REVIEW OF A SUBMITTAL SHALL NOT RELIEVE THE CONTRACTOR OF THEIR RESPONSIBILITY TO FOLLOW THE INTENT OF THE CONTRACT DRAWINGS.
11. REPRODUCTION OF CONTRACT DOCUMENTS WILL NOT BE ACCEPTED AS SHOP DRAWINGS.

DELEGATED DESIGN ITEMS:

1. EMPLOY OR RETAIN A LICENSED PROFESSIONAL ENGINEER IN THE PROJECT JURISDICTION TO DESIGN AND DETAIL THE FOLLOWING PERFORMANCE SPECIFIED STRUCTURAL COMPONENTS:
   A. UNISTRUT SUPPORTS
2. SEE INDIVIDUAL MATERIAL SECTIONS FOR ADDITIONAL REQUIREMENTS.
3. SHOP DRAWINGS AND CALCULATIONS SHALL BE SIGNED AND SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE LOCAL JURISDICTION AND SUBMITTED FOR REVIEW.

RIGGING, HOISTING AND SCAFFOLDING REQUIREMENTS:

1. THE CONTRACTOR SHALL PREPARE AND SUBMIT TO THE COR FOR REVIEW A SITE SPECIFIC RIGGING AND HOISTING PLAN FOR ALL MAJOR EQUIPMENT THAT WILL BE TRANSPORTED THROUGH OR HOISTED FROM THE BUILDING. THE PLAN SHALL INCLUDE THE SEQUENCE OF ERECTION, THE DESCRIPTION OF THE RIGGING, HOISTING AND TRANSPORTATION EQUIPMENT AND THE SITE PREPARATIONS THAT WILL BE NEEDED TO COMPLETE THE INSTALLATION.
2. THE CONTRACTOR SHALL PREPARE AND SUBMIT TO THE COR FOR REVIEW A SITE SPECIFIC PLAN FOR ALL SCAFFOLDING THAT WILL BE INSTALLED ON FRAMED FLOORS AND ROOFS.
3. THE PROPOSED RIGGING, HOISTING OR SCAFFOLDING PLAN SHALL BE REVIEWED BY A PROFESSIONAL ENGINEER REGISTERED IN THE LOCAL JURISDICTION. THE PROFESSIONAL ENGINEER SHALL PROVIDE A SIGNED AND SEALED CERTIFICATION STATING THAT THE PROPOSED PLAN WILL NOT DAMAGE OR OVERSTRESS THE STRUCTURE. SHORING AND SCAFFOLDING SHALL COMPLY WITH OSHA REGULATIONS.
4. IT IS THE CONTRACTOR'S RESPONSIBILITY TO INSURE THAT THE LOADS SUPERIMPOSED BY THE RIGGING, HOISTING OR SCAFFOLDING SYSTEMS WILL NOT EXCEED THE FOLLOWING LOADS:
   FRAMED FLOORS = 80 PSF
   ROOFS = 30 PSF
5. THE CONTRACTOR SHALL PROVIDE PROTECTION FOR ALL FINISHES.

EXISTING CONSTRUCTION:

1. ABOVE GROUP, INC. HAS PREPARED THESE PLANS BASED ON A LIMITED AMOUNT OF FIELD EXPLORATION AND ON THE STRUCTURAL INFORMATION SHOWN IN THE DRAWINGS 1-1 - 1-84 OF VA PROJECT # 9-4009 DATED 1950. THE EXISTING MEMBER SIZES ARE NOTED (E) AND ARE SHOWN IN THE PLANS. THE CONTRACTOR SHALL VERIFY THAT THE EXISTING MEMBERS SHOWN IN THE PLANS MATCH EXISTING AS BUILT CONDITIONS PRIOR TO PREPARING SHOP DRAWINGS. IF THE AS BUILT CONDITIONS DO NOT CONFORM TO THE INFORMATION SHOWN IN THE PLANS, OR IF ANY STRUCTURAL MEMBER IS FOUND TO BE IN POOR CONDITION, THE CONTRACTOR SHALL INFORM COR OF THE ACTUAL SIZES AND/OR CONDITION. RE-DESIGN AND ADDITIONAL FRAMING MAY BE REQUIRED IN THAT CASE.
2. ALL NEW PENETRATIONS THROUGH THE EXISTING FRAMED FLOORS, ROOFS AND WALLS SHALL BE ACCURATELY LOCATED BY THE CONTRACTOR. THE CONTRACTOR SHALL PREPARE SHOP DRAWINGS SHOWING ALL PROPOSED OPENINGS AND SHALL SUBMIT THESE FOR REVIEW AND APPROVAL PRIOR TO CUTTING ANY OPENINGS.
3. NEW PENETRATIONS SHOWN IN THE STRUCTURAL DRAWINGS ARE PRINCIPAL OPENINGS. THE CONTRACTOR SHALL COORDINATE WITH THE ARCHITECTURAL, MEP AND TELECOMMUNICATION DRAWINGS FOR ALL PENETRATIONS.
4. ALL NEW PIPE AND DUCT PENETRATIONS SHALL BE LOCATED BY THE CONTRACTOR TO AVOID CONCRETE SLAB REINFORCEMENT AND SUPPORTING MEMBERS UNDER THE SLAB. IF CUTTING OF ANY REINFORCEMENT OR EXISTING SUPPORTING MEMBER CANNOT BE AVOIDED, THEN PRIOR TO CUTTING, THE CONTRACTOR SHALL PREPARE A DETAILED DRAWING SHOWING THE PROPOSED PENETRATION AND ALL THE AFFECTED REINFORCEMENT AND SUPPORTING MEMBERS AND SHALL SUBMIT THE DRAWING TO THE COR FOR REVIEW AND APPROVAL. THE CONTRACTOR SHALL NOT CUT ANY REINFORCEMENT OR MEMBER WITHOUT THE PRIOR APPROVAL OF ENGINEER.

FOUNDATIONS:

1. FOUNDATIONS ARE DESIGNED FOR AN ASSUMED BEARING PRESSURE OF 1500 PSF.
2. ALL FOOTINGS TO BEAR ON SOIL A MINIMUM 2'-6" BELOW EXTERIOR GRADE PER LOCAL FROST DEPTH REQUIREMENTS.
3. CONTRACTOR SHALL NOTIFY THE GEOTECHNICAL ENGINEER FOR INSPECTION BEFORE PLACING ANY FOOTINGS. GEOTECHNICAL ENGINEER SHALL INSPECT AND REPORT ON ADEQUACY OF BEARING MATERIAL.
4. FOOTINGS SHOULD BE CAST ON THE SAME DAY IN WHICH EXCAVATION FOR THEM IS COMPLETED. IF PLACING OF CONCRETE IS DELAYED, FOOTING BOTTOM SHALL BE TRIMMED TO FIRM MATERIAL IMMEDIATELY BEFORE CASTING.
5. PLACE CONCRETE IN DRY EXCAVATIONS ONLY. NOTE SOIL AND WATER CONDITIONS AS SHOWN BY BORINGS AND DEPTHS OF FOOTINGS AS SHOWN ON FOUNDATION PLANS. PENDING APPROVAL BY THE COR, CONTRACTOR MAY ELECT TO CONDUCT FURTHER SUBSURFACE INVESTIGATIONS AT THEIR OWN EXPENSE.
6. WHERE TRENCH BOTTOMS ARE DUG BELOW ADJACENT FOOTING BOTTOMS ON A SLOPE STEEPER THAN ONE VERTICAL TO TWO HORIZONTAL, THE TRENCH SHALL BE BACKFILLED WITH LEAN CONCRETE TO THE POINT WHERE THE STATED SLOPE CROSSES THE TRENCH.
7. FOOTINGS SHALL BE FORMED UNLESS OTHERWISE PERMITTED BY THE ENGINEER.
8. BACKFILLING:
   A. BEFORE BACKFILLING WALLS, GROUT AND/OR CONCRETE SHALL HAVE ATTAINED DESIGN STRENGTH, AND ALL SLABS AND BEAMS THAT ARE NECESSARY FOR THE STABILITY OF THE WALLS SHALL BE IN PLACE.
   B. BACKFILL SHALL BE CARRIED UP EVENLY ON BOTH SIDES OF WALL TO LOWER GRADE.
   C. BACKFILL SHALL BE PLACED IN MAXIMUM OF 8" LOOSE LIFT THICKNESS AND COMPACTED TO INFILL 98% OF STANDARD PROCTOR.
   D. TESTS SHALL BE PERFORMED FOR EACH LIFT AT A RATE OF TWO TESTS PER LIFT MINIMUM AND NOT LESS THAN ONE TEST PER 100' OF WALL LENGTH.
9. STRUCTURAL FILL INCLUDING UNDER FOOTINGS:
   A. SHALL BE PLACED IN MAXIMUM OF 8" LOOSE LIFT THICKNESS AND COMPACTED TO 98% OF STANDARD PROCTOR.
   B. ON-SITE OR IMPORTED GRANULAR FILLS INCLUDING GW, GP, GM, SW, SP, ND, SM CLASSIFIED IN ACCORDANCE WITH THE UNIFIED SOIL CLASSIFICATION SYSTEM (USCS) AND WITHIN 2% OF OPTIMUM MOISTURE. FURTHERMORE, THE MATERIAL TO BE UTILIZED AS STRUCTURAL FILL SHOULD HAVE A PLASTICITY INDEX (PI) LESS THAN 2, SUBJECT TO FINAL APPROVAL BY THE GEOTECHNICAL ENGINEER.
10. FILL UNDER SLABS ON GRADE SHALL BE COMPACTED TO 98% OF STANDARD PROCTOR DENSITY. TESTS SHALL BE PERFORMED FOR EACH LIFT.

CONCRETE:

1. CONCRETE NOT OTHERWISE SPECIFIED SHALL BE f'c=3000 PSI NORMAL WEIGHT CONCRETE, UNLESS NOTED OTHERWISE. ALL CONCRETE EXPOSED TO THE WEATHER SHALL BE f'c=5000 PSI MINIMUM AND SHALL BE AIR ENTRAINED FOR EXPOSURE CLASS F2 PER ACI 318 "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE".
2. ALL REINFORCING STEEL SHALL BE CONFORMING TO ASTM DESIGNATION A615, GRADE 60. ALL REINFORCING STEEL SHALL BE DETAILED, FABRICATED AND PLACED IN ACCORDANCE WITH ACI SP-66, "ACI DETAILING MANUAL".
3. ALL SPLICES IN REINFORCING SHALL BE CLASS "B" SPLICES IN ACCORDANCE WITH ACI 318, "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE" EXCEPT AS OTHERWISE NOTED.

CONCRETE REBAR MINIMUM SPLICE LENGTH TABLE (CLASS B)

BAR SIZE	TOP (INCHES)	OTHER (INCHES)
#4	32"	25"
#5	40"	31"
#6	48"	38"
#7	70"	53"
#8	80"	61"
#9	90"	70"

NOTE:
1. BASED ON 4,000 PSI NW CONCRETE AND GRADE 60 UNCOATED OR GALVANIZED REINFORCING BAR
2. "TOP" ARE HORIZONTAL BARS LOCATED WHERE MORE THAN 12" OF FRESH CONCRETE IS CAST IN MEMBER BELOW THE BARS

4. UNLESS OTHERWISE NOTED ON STRUCTURAL DRAWINGS, PROVIDE CONCRETE PROTECTION FOR REINFORCING AS FOLLOWS:
   A. CAST AGAINST EARTH = 3"
   B. EXPOSED TO EARTH OR WEATHER:
      1. NO. 6 AND LARGER BARS = 2"
      2. NO. 5 AND SMALLER BARS = 1 1/2"
   C. NOT EXPOSED TO EARTH OR WEATHER:
      1. SLABS AND WALLS = 3/4"
      2. BEAMS AND COLUMNS = 1 1/2" TO TIES, STIRRUPS OR SPIRALS
5. THE GENERAL CONTRACTOR SHALL SUBMIT PLANS SHOWING ALL PENETRATIONS THROUGH THE FRAMED SLABS. THE OPENINGS SHALL BE ACCURATELY LOCATED AND DIMENSIONED.
6. NO OPENINGS SHALL BE MADE THROUGH CONCRETE FRAMED FLOORS UNLESS THESE ARE SPECIFICALLY SHOWN ON THE STRUCTURAL DRAWINGS.
7. CONSTRUCTION JOINTS SHALL HAVE THE SURFACE OF THE FIRST POUR ROUGHENED TO 1/4" AMPLITUDE, UNLESS OTHERWISE NOTED.

CONCRETE CONTINUED...:

8. THE CONTRACTOR MUST SUBMIT A CONCRETE DESIGN MIX IN ACCORDANCE WITH ACI 318. SUCH DESIGN MIX SHALL BE ACCOMPANIED BY THE APPROPRIATE GRAPHS AND BACKGROUND DATA. CONCRETE DESIGN MIX SHALL INDICATE 7 AND 28 DAY STRENGTHS, CEMENT CONTENT, WATER-CEMENT RATIO, FINE AND COARSE AGGREGATES AND ADMIXTURES FOR EACH DESIGN STRENGTH. THE ADDITION OF WATER AT THE PLANT OR IN THE FIELD GREATER THAN THE SPECIFIED WATER CONTENT IS STRICTLY PROHIBITED.
9. ALL CONCRETE WORK SHALL CONFORM TO THE LATEST LOCAL APPROVED EDITIONS OF THE FOLLOWING ACI AND ASTM DOCUMENTS:
   A. ACI-301 SPECIFICATIONS FOR STRUCTURAL CONCRETE
   B. ACI-318 CODE
   C. ACI-214 COMPRESSIVE TEST
   D. ACI-306 COLD WEATHER
   E. ACI SP-66 DETAILING
   F. ACI-347 FORMWORK
   G. ACI-305 HOT WEATHER
   H. ACI-211 PROPORTIONS OF CONCRETE
   I. ACI-304 PLACING CONCRETE
   J. ASTM C-94 READY-MIX CONCRETE
10. ALL FIELD AND LAB TESTING OF CONCRETE SHALL CONFORM TO THE LATEST LOCAL APPROVED EDITIONS OF ASTM:
    A. ASTM C-31 FIELD CYLINDER SPECIMENS
    B. ASTM C-143 SLUMP TEST
    C. ASTM C-231 AIR CONTENT (WHEN REQUIRED)
    D. ASTM C-39 LAB TESTING CYLINDERS
    E. ASTM C-172 SAMPLING FRESH CONCRETE
    F. ASTM C-42 HARDENED CORES (WHEN REQUIRED)
    TEST RESULTS SHALL BE SIGNED AND SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE LOCAL JURISDICTION.
11. ALL FORMWORK SHALL BE IN ACCORDANCE WITH ACI 347, "GUIDE TO FORMWORK FOR CONCRETE".

POST-INSTALLED ANCHORS:

1. DRILL AND INSTALL POST-INSTALLED ANCHORS ACCORDING TO MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS AND PER MANUFACTURER'S ON-SITE TRAINING.
2. ALL INSTALLERS OF POST-INSTALLED ANCHORS SHALL BE ACI/CRSI ADHESIVE ANCHOR INSTALLER CERTIFIED. SUBMIT CERTIFICATES FOR RECORD.
3. ALL POST-INSTALLED ANCHORS SHALL MEET ICC-ES COMPLIANCE FOR EACH TYPE OF APPLICATION.
4. SUBMIT PRODUCT INFORMATION AND ICC-ES EVALUATION REPORT FOR EACH ANCHOR.
5. ALL ANCHOR DESIGNS ARE FOR INSTALLATION IN THE FOLLOWING CONDITIONS, UNLESS NOTED OTHERWISE. WRITTEN APPROVAL MUST BE RECEIVED FROM ENGINEER PRIOR TO INSTALLATION OF ADHESIVE ANCHORS IN ALTERNATE CONDITIONS.
   A. DRY CONCRETE, UNLESS NOTED OTHERWISE.
   B. CONCRETE TEMPERATURE AT TIME OF INSTALLATION MUST BE BETWEEN 14° F AND 104° F. SEE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTION FOR ADHESIVE GEL AND CURE TIMES.
   C. ANCHOR HOLES TO BE HAMMER DRILLED.
   D. ANCHOR HOLES TO BE CLEANED PER MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS PRIOR TO ADHESIVE INJECTION.
   E. ANCHORS/POST-INSTALLED REINFORCING SHALL NOT BE LOADED UNTIL CONCRETE OR GROUT HAS BEEN ALLOWED TO CURE FOR 21 DAYS AND/OR HAS ATTAINED 70% OF ITS DESIGN STRENGTH.
6. ALL POST-INSTALLED ANCHORS IN CONCRETE SHALL BE SUITED FOR USE IN SEISMIC AND CRACKED CONCRETE APPLICATIONS.
7. ADHESIVE ANCHORS IN CONCRETE SHALL BE HILTI HIT HY-200, OR APPROVED EQUAL.
8. ADHESIVE ANCHORS IN CMU GROUTED SOLID AT THE ANCHOR SHALL BE HILTI HY-270, OR APPROVED EQUAL. CELLS AT THE ANCHOR AND ONE COURSE ABOVE AND BELOW THE ANCHOR SHALL BE GROUTED SOLID.
9. ADHESIVE ANCHORS IN MASONRY AND HOLLOW CMU SHALL BE HILTI HIT HY-270 WITH MESH SLEEVES, OR APPROVED EQUAL.
10. EXPANSION ANCHORS IN CONCRETE SHALL BE HILTI KWIK BOLT TZ2, OR APPROVED EQUAL.
11. EXPANSION ANCHORS IN CMU GROUTED SOLID AT THE ANCHOR SHALL BE HILTI KWIK BOLT TZ2. CELLS AT THE ANCHOR AND ONE COURSE ABOVE AND BELOW THE ANCHOR SHALL BE GROUTED SOLID.
12. PROVIDE STANDARD AISC HOLES IN ALL STEEL MEMBERS RECEIVING POST-INSTALLED ANCHORS. IF OVERSIZED HOLES ARE PROVIDED TO EASE INSTALLATION OF THE ANCHORS, A PLATE WASHER (1/4"X2"X2") WITH AN AISC STANDARD HOLE SHALL BE INSTALLED AND 1/8" FILLET WELDED (ALL AROUND) TO THE MEMBER.
13. ALL ANCHORS AND REINFORCING SHALL BE INSTALLED IN ACCORDANCE WITH THE SPACING AND EDGE DISTANCES SHOWN IN THE DRAWINGS. THE CONTRACTOR SHALL INFORM THE COR PRIOR TO INSTALLING THE ANCHORS IF THE SPACING AND EDGE DISTANCES SHOWN IN THE DRAWINGS CANNOT BE ACHIEVED. IF THIS IS THE CASE, RE-DESIGN MIGHT BE REQUIRED AND THE ANCHORS SHOULD NOT BE INSTALLED UNTIL APPROVAL HAS BEEN PROVIDED BY THE ENGINEER.
14. DO NOT CUT ANY REINFORCING UNLESS IT IS SPECIFICALLY INDICATED IN THE DRAWINGS OR IS APPROVED BY THE ENGINEER.
15. POST INSTALLED ANCHORS AND REINFORCING SHALL ONLY BE USED WHERE SPECIFIED IN THE CONTRACT DRAWINGS. THE CONTRACTOR SHALL OBTAIN APPROVAL FROM THE ENGINEER PRIOR TO INSTALLING POST INSTALLED ANCHORS WHERE CAST-IN PLACE ANCHORS ARE MISSING, MISPLACED OR DAMAGED.

DESIGN CODES:

VA DESIGN MANUAL STRUCTURAL:
PG-18-10 (OCTOBER 1, 2022 REV JULY 1, 2023)

VA SEISMIC DESIGN REQUIREMENTS:
H18-8 (JULY 1, 2023)

INTERNATIONAL BUILDING CODE:
IBC 2021

MINIMUM BUILDING DESIGN LOADS AND ASSOCIATED CRITERIA FOR BUILDINGS AND OTHER STRUCTURES:
ASCE 7-22

BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE:
ACI 318-19

BUILDING CODE AND SPECIFICATION FOR MASONRY STRUCTURES:
TMS 402/602-16

SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS:
AISC 14TH EDITION 360-16

SEISMIC PROVISIONS FOR STRUCTURAL STEEL BUILDINGS:
AISC 341-16

DESIGN CRITERIA:
RISK CATEGORY IV

FLOOR LIVE LOADS:

CLINICAL AND SUPPORT SERVICES	80 PSF
CORRIDOR	100 PSF
PARTITIONS	20 PSF (NOT REQUIRED WITH LIVE LOAD OF 100 PSF OR HIGHER)

SEISMIC DESIGN DATA:

EQUIVALENT LATERAL FORCE PROCEDURE
SOIL SITE CLASS ASSUMED 'D'
SEISMIC DESIGN CATEGORY D
SEISMIC IMPORTANCE FACTOR, Ie = 1.5

MAPPED SPECTRAL RESPONSE ACCELERATION PARAMETERS:
Ss = 0.61g
S1 = 0.18g

DESIGN SPECTRAL RESPONSE ACCELERATION PARAMETERS:
Sds = 0.43g
Sd1 = 0.25g

WIND LOADS:
DESIGN WIND SPEED:
Vult = 119 MPH (3 SECOND GUST)

WIND EXPOSURE B
INTERNAL PRESSURE COEFFICIENT, GCpi = +/-0.18

STRUCTURAL ABBREVIATIONS

ABBR.	DESCRIPTION
AB	ANCHOR BOLT
ABV	ABOVE
ACI	AMERICAN CONCRETE INSTITUTE
ADDL	ADDITIONAL
ADH	ADHESIVE
ADJ	ADJACENT, ADJUSTMENT
A/E	ARCHITECT/ENGINEER
AESS	ARCHITECTURALLY EXPOSED STRUCTURAL STEEL
AFF	ABOVE FINISHED FLOOR
AGG	AGGREGATE
AHJ	AUTHORITY HAVING JURISDICTION
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION
AISI	AMERICAN IRON AND STEEL INSTITUTE
ALT	ALTERNATE
ANCH	ANCHOR
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
APA	ENGINEERED WOOD ASSOCIATION
APRX	APPROXIMATE
AR	ANCHOR ROD
ARCH	ARCHITECT(URAL)
ASCE	AMERICAN SOCIETY OF CIVIL ENGINEERS
ASD	ALLOWABLE STRESS DESIGN
ASTM	AMERICAN SOCIETY FOR TESTING AND MATERIALS
AWC	AMERICAN WOOD COUNCIL
AWPA	AMERICAN WOOD PROTECTION AGENCY
AWS	AMERICAN WELDING SOCIETY
AVG	AVERAGE
B	BOTTOM
B/	BOTTOM OF
B-B	BACK-TO-BACK
BAL	BALANCE
BEL	BELOW
BF	BRACED FRAME
BLDG	BUILDING
BLK(G)	BLOCK(ING)
BM	BEAM
BOT	BOTTOM
BP	BASE PLATE, BEARING PLATE
BR	BRACE(ING)
BRDG	BRIDGING
BRG	BEARING
BRK	BRICK
BRKT	BRACKET
BS	BOTH SIDES
BSMT	BASEMENT
BT	BENT
BTWN	BETWEEN
BYD	BEYOND
C	STEEL CHANNEL
CAIS	CAISSON
CALC	CALCULATION
CANT	CANTILEVER
CAP	CAPACITY
C-C	CENTER-TO-CENTER
CE	CONCRETE ENCASED
CFM	COLD FORMED METAL
CHAM	CHAMFER
CI	CAST IRON
CIP	CAST IN PLACE
CJ	CONTROL/CONTRACTION JOINT
CL	CENTERLINE, COLUMN LINE
CLG	CEILING
CLR	CLEAR
CM	CONSTRUCTION MANAGER
CMU	CONCRETE MASONRY UNIT
COL	COLUMN
COMB	COMBINED
COMP	COMPOSITE
CONC	CONCRETE
COND	CONDITION
CONN	CONNECTION
CONST	CONSTRUCTION
CONT	CONTINUOUS
CONTR	CONTRACTOR
COORD	COORDINATE
COV	COVER
CP	CAP PLATE
CRSI	CONCRETE REINFORCING STEEL INSTITUTE
CSK	COUNTERSUNK
CTR	CENTER(ED)
CY	CUBIC YARD
CYL	CYLINDER
d	PENNY (AS IN NAIL, ld)
DBL	DOUBLE
DD	DESIGN DEVELOPMENT
DEF	DEFLECTION
DEG	DEGREE
DEMO	DEMOLITION/DEMOLISH
DEPR	DEPRESS(ED)/DEPRESSION
DET(S)	DETAIL(S)
DEV	DEVELOP/DEVELOPMENT
DIA	DIAMETER
DIAG	DIAGONAL
DIM(S)	DIMENSION(S)
DIR	DIRECTION
DK	DECK
DL	DEAD LOAD
DN	DOWN
do	DITTO
DP	DEEP
DWG(S)	DRAWING(S)
DWL	DOWEL
(E)	EXISTING
E	EAST
EA	EACH
EF	EACH FACE
EIFS	EXTERIOR INSULATION FINISH SYSTEM
EJ	EXPANSION JOINT
EL	ELEVATION
ELEC	ELECTRICAL
ELEV	ELEVATOR
EMBED	EMBEDMENT/EMBEDDED
ENGR	ENGINEER
EO	EDGE OF
EOD	EDGE OF DECK
EOM	EDGE OF MASONRY
EOS	EDGE OF SLAB
EQ	EQUAL
EQUIP	EQUIPMENT
ES	EACH SIDE
ES	EACH SIDE
EXCAV	EXCAVATE/EXCAVATION
EXP	EXPANSION
EXT	EXTERIOR
EXIST	EXISTING
EW	EACH WAY
F/	FACE OF
FAB	FABRICATE
FB	FLAT BAR
FBO	FURNISHED BY OTHERS
FDN	FOUNDATION
FFE	FINISHED FLOOR ELEVATION
FIN	FINISH(ED)
FL(R)	FLOOR
FLG	FLANGE
FND	FOUNDATION
FO	FACE OF
FOC	FACE OF CONCRETE
FOF	FACE OF FINISH
FOM	FACE OF MASONRY
FOS	FACE OF STUD
FP	FIREPROOFING
FRMG	FRAMING
FRP	FIBER-REINFORCED POLYMER
FRT	FIRE RETARDANT TREATED
FS	FAR SIDE
FT	FEET
FTG	FOOTING
FUT	FUTURE
FV	FIELD VERIFY
GA	GAUGE
GALV	GALVANIZE(D)
GB	GRADE BEAM
GC	GENERAL CONTRACTOR
GLB	GLUE LAMINATED BEAM
GR	GRADE
GYP	GYPSUM
HD	HEAVY DUTY
HDR	HEADER
HEF	HORIZONTAL EACH FACE
HGR	HANGER
HI	HIGH
HIF	HORIZONTAL INSIDE FACE
HK	HOOK(ED)
HOF	HORIZONTAL OUTSIDE FACE
HORIZ	HORIZONTAL
HP	HIGH POINT
HS	HIGH STRENGTH
HT	HEIGHT
H&V	HORIZONTAL & VERTICAL
HVAC	HEATING, VENTILATING & AIR CONDITIONING
IBC	INTERNATIONAL BUILDING COUNCIL
ICC	INTERNATIONAL CODE COUNCIL
ID	INSIDE DIAMETER
IF	INSIDE FACE
IFC	ISSUE FOR CONSTRUCTION
IN	INCH
INCL	INCLUDE(D)(ING)
INFO	INFORMATION
INSTL	INSTALL/INSTALLATION
INSUL	INSULATION
INT	INTERIOR
INV	INVERT(ED)
JST(S)	JOIST(S)
JT	JOINT
k	KIP (THOUSAND POUNDS)
KB	KNEE BRACE
KSI	KIPS PER SQUARE INCH
LB, #	POUND
LDGR	LEDGER (BOARD)
LEN	LENGTH
LG	LONG
LL	LIVE LOAD
LLBB	LONG LEGS BACK TO BACK
LLH	LONG LEG HORIZONTAL
LLV	LONG LEG VERTICAL
LOCN	LOCATION
LONGIT	LONGITUDINAL
LP	LOW POINT
LRFD	LOAD AND RESISTANCE FACTOR DESIGN
LSL	LONG SLOTTED HOLE, LAMINATED STRAND LUMBER
LVL	LAMINATED VENEER LUMBER
LW	LONG WAY
LWC	LIGHT WEIGHT CONCRETE
M	MOMENT
MAS	MASONRY
MATL	MATERIAL
MAX	MAXIMUM
MECH	MECHANICAL
MEP	MECHANICAL, ELECTRICAL & PLUMBING
MEZZ	MEZZANINE
MFR	MANUFACTURER
MIN	MINIMUM
MISC	MISCELLANEOUS
MO	MASONRY OPENING
MONO	MONOLITHIC
MPH	MILES PER HOUR
MTL	METAL
NA	NOT APPLICABLE
NDS	NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION
NIC	NOT IN CONTRACT
NO	NUMBER
NOM	NOMINAL
NS	NEAR SIDE
NTS	NOT TO SCALE
NWC	NORMAL WEIGHT CONCRETE
OC	ON CENTER
OD	OUTSIDE DIAMETER
OF	OUTSIDE FACE
O-O	OUT-TO-OUT
OPG	OPENING
OPP	OPPOSITE
OSB	ORIENTED STRAND BOARD
OSHA	OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
OSL	OUTSTANDING LEG, ORIENTED STRAND LUMBER
OVS	OVERSIZED HOLE
PAF	POWDER ACTUATED FASTENER
PC	PRECAST CONCRETE, PIECE
PCF	POUNDS PER CUBIC FOOT
PED	PEDESTAL
PERP	PERPENDICULAR
PREFAB	PREFABRICATE(D)
PL	PLATE
PLF	POUNDS PER LINEAR FOOT
PLYWD	PLYWOOD
PMF	PREMOLDED FILLER
PROJ	PROJECT(ION)
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PSL	PARALLEL STRAND LUMBER
PT	PRESERVATIVE-TREATED, POST-TENSIONED
PVC	POLYVINYL CHLORIDE
QTY	QUANTITY
R	RADIUS
RCMU	REINFORCED CONCRETE MASONRY UNIT
RCSC	RESEARCH COUNCIL ON STRUCTURAL CONNECTIONS
RD	ROOF DRAIN
RDK	ROOF DECK
REF	REFERENCE
REINF	REINFORCE(D)/REINFORCEMENT
REQ(D)	REQUIRE(D)
RET	RETAINING
REV	REVISE(D)/REVISION
RO	ROUGH OPENING
RQMT(S)	REQUIREMENT(S)
RTU	ROOFTOP UNIT
RXN	REACTION
SAN	SANITARY
SC	SLIP-CRITICAL (CONNECTION)
SCHED	SCHEDULE
SECT	SECTION
SD	STORM DRAIN
SDI	STEEL DECK INSTITUTE
SF	SQUARE FOOT
SHRG	SHORING
SHTHG	SHEATHING
SIM	SIMILAR
SL	SLOPE(D)
SLBB	SHORT LEGS BACK TO BACK
SLV	SLEEVE
SOD	SLAB ON DECK
SOG	SLAB ON GRADE
SPA	SPACE(S)/SPACING
SPEC(S)	SPECIFICATION(S)
SQ	SQUARE
SS	STAINLESS STEEL
SSL	SHORT SLOTTED HOLE
STD	STANDARD
STIFF	STIFFENER
STIR	STIRRUP
STL	STEEL
STRUC	STRUCTURAL
SUPT	SUPPORT
SW	SHORT WAY, SHEAR WALL
SYM	SYMMETRICAL
T	TOP
T/	TOP OF
T&B	TOP AND BOTTOM
TB	TRUSS BEARING
TC	TERRA COTTA
TEMP	TEMPORARY,TEMPERATURE
T&G	TONGUE AND GROOVE
THD	THREAD(ED)
THK	THICK(NESS)
TMS	THE MASONRY SOCIETY
TOS	TOP OF SLAB
TYP	TYPICAL
UNO	UNLESS NOTED OTHERWISE
U-P	UNDERPINNING
V	SHEAR
VAR	VARIES
VB	VAPOR BARRIER
VEF	VERTICAL EACH FACE
VERT	VERTICAL
VIF	VERTICAL INSIDE FACE, VERIFY IN FIELD
VOF	VERTICAL OUTSIDE FACE
VR	VAPOR RETARDER
W/	WITH
W/O	WITHOUT
WD	WOOD
WI	WROUGHT IRON
WP	WORK POINT, WATERPROOFING
WT	WEIGHT
WWF	WELDED WIRE FABRIC
XS	EXTRA STRONG
XXS	DOUBLE EXTRA STRONG
Ø	DIAMETER
±	PLUS OR MINUS

SHEET LIST

Sheet Number	Sheet Name
S-001	GENERAL NOTES AND ABBREVIATIONS
SS101	FIRST FLOOR FOUNDATION PLAN
SS102	SECOND AND THIRD FLOOR FRAMING PLANS
S-301	DETAILS AND SECTIONS

Revisions: Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
RACHEL A. STERNBERG
ENGINEER
PE093259

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: GENERAL NOTES AND ABBREVIATIONS

Approved:

Phase: 100% CONTRACT DOCUMENTS FOR BIDDING

FULLY SPRINKLERED

Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259

Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106

Issue Date: 06 MARCH 2026 | Checked: RAS | Drawn: RAS

Project Number: 657-23-104JC

Building Number:

Drawing Number: S-001

DRAWING NOTES:

1. CONTRACTOR TO CONFIRM SIZE OF EXISTING PAD TO BE REUSED PRIOR TO APPROVAL OF MECHANICAL EQUIPMENT SELECTION.
2. CONTRACTOR TO CONFIRM SIZE OF FINAL MECHANICAL EQUIPMENT PRIOR TO POURING CONCRETE.

CODED NOTES:

1 EXISTING MECHANICAL EQUIPMENT PAD.
2 NEW MECHANICAL EQUIPMENT, REFER TO MECHANICAL DRAWINGS.
3 NEW ELECTRICAL EQUIPMENT, REFER TO ELECTRICAL DRAWINGS.
4 6" THICK CONCRETE PAD WITH REINFORCED, REFER TO DETAIL 3/ S-301 .
5 6" THICK CONCRETE PAD WITH TURNED DOWN SLAB, REFER TO DETAIL 1/ S-301 .
6 UNISTRUT POST, REFER TO SECTION CUT ON PLAN.

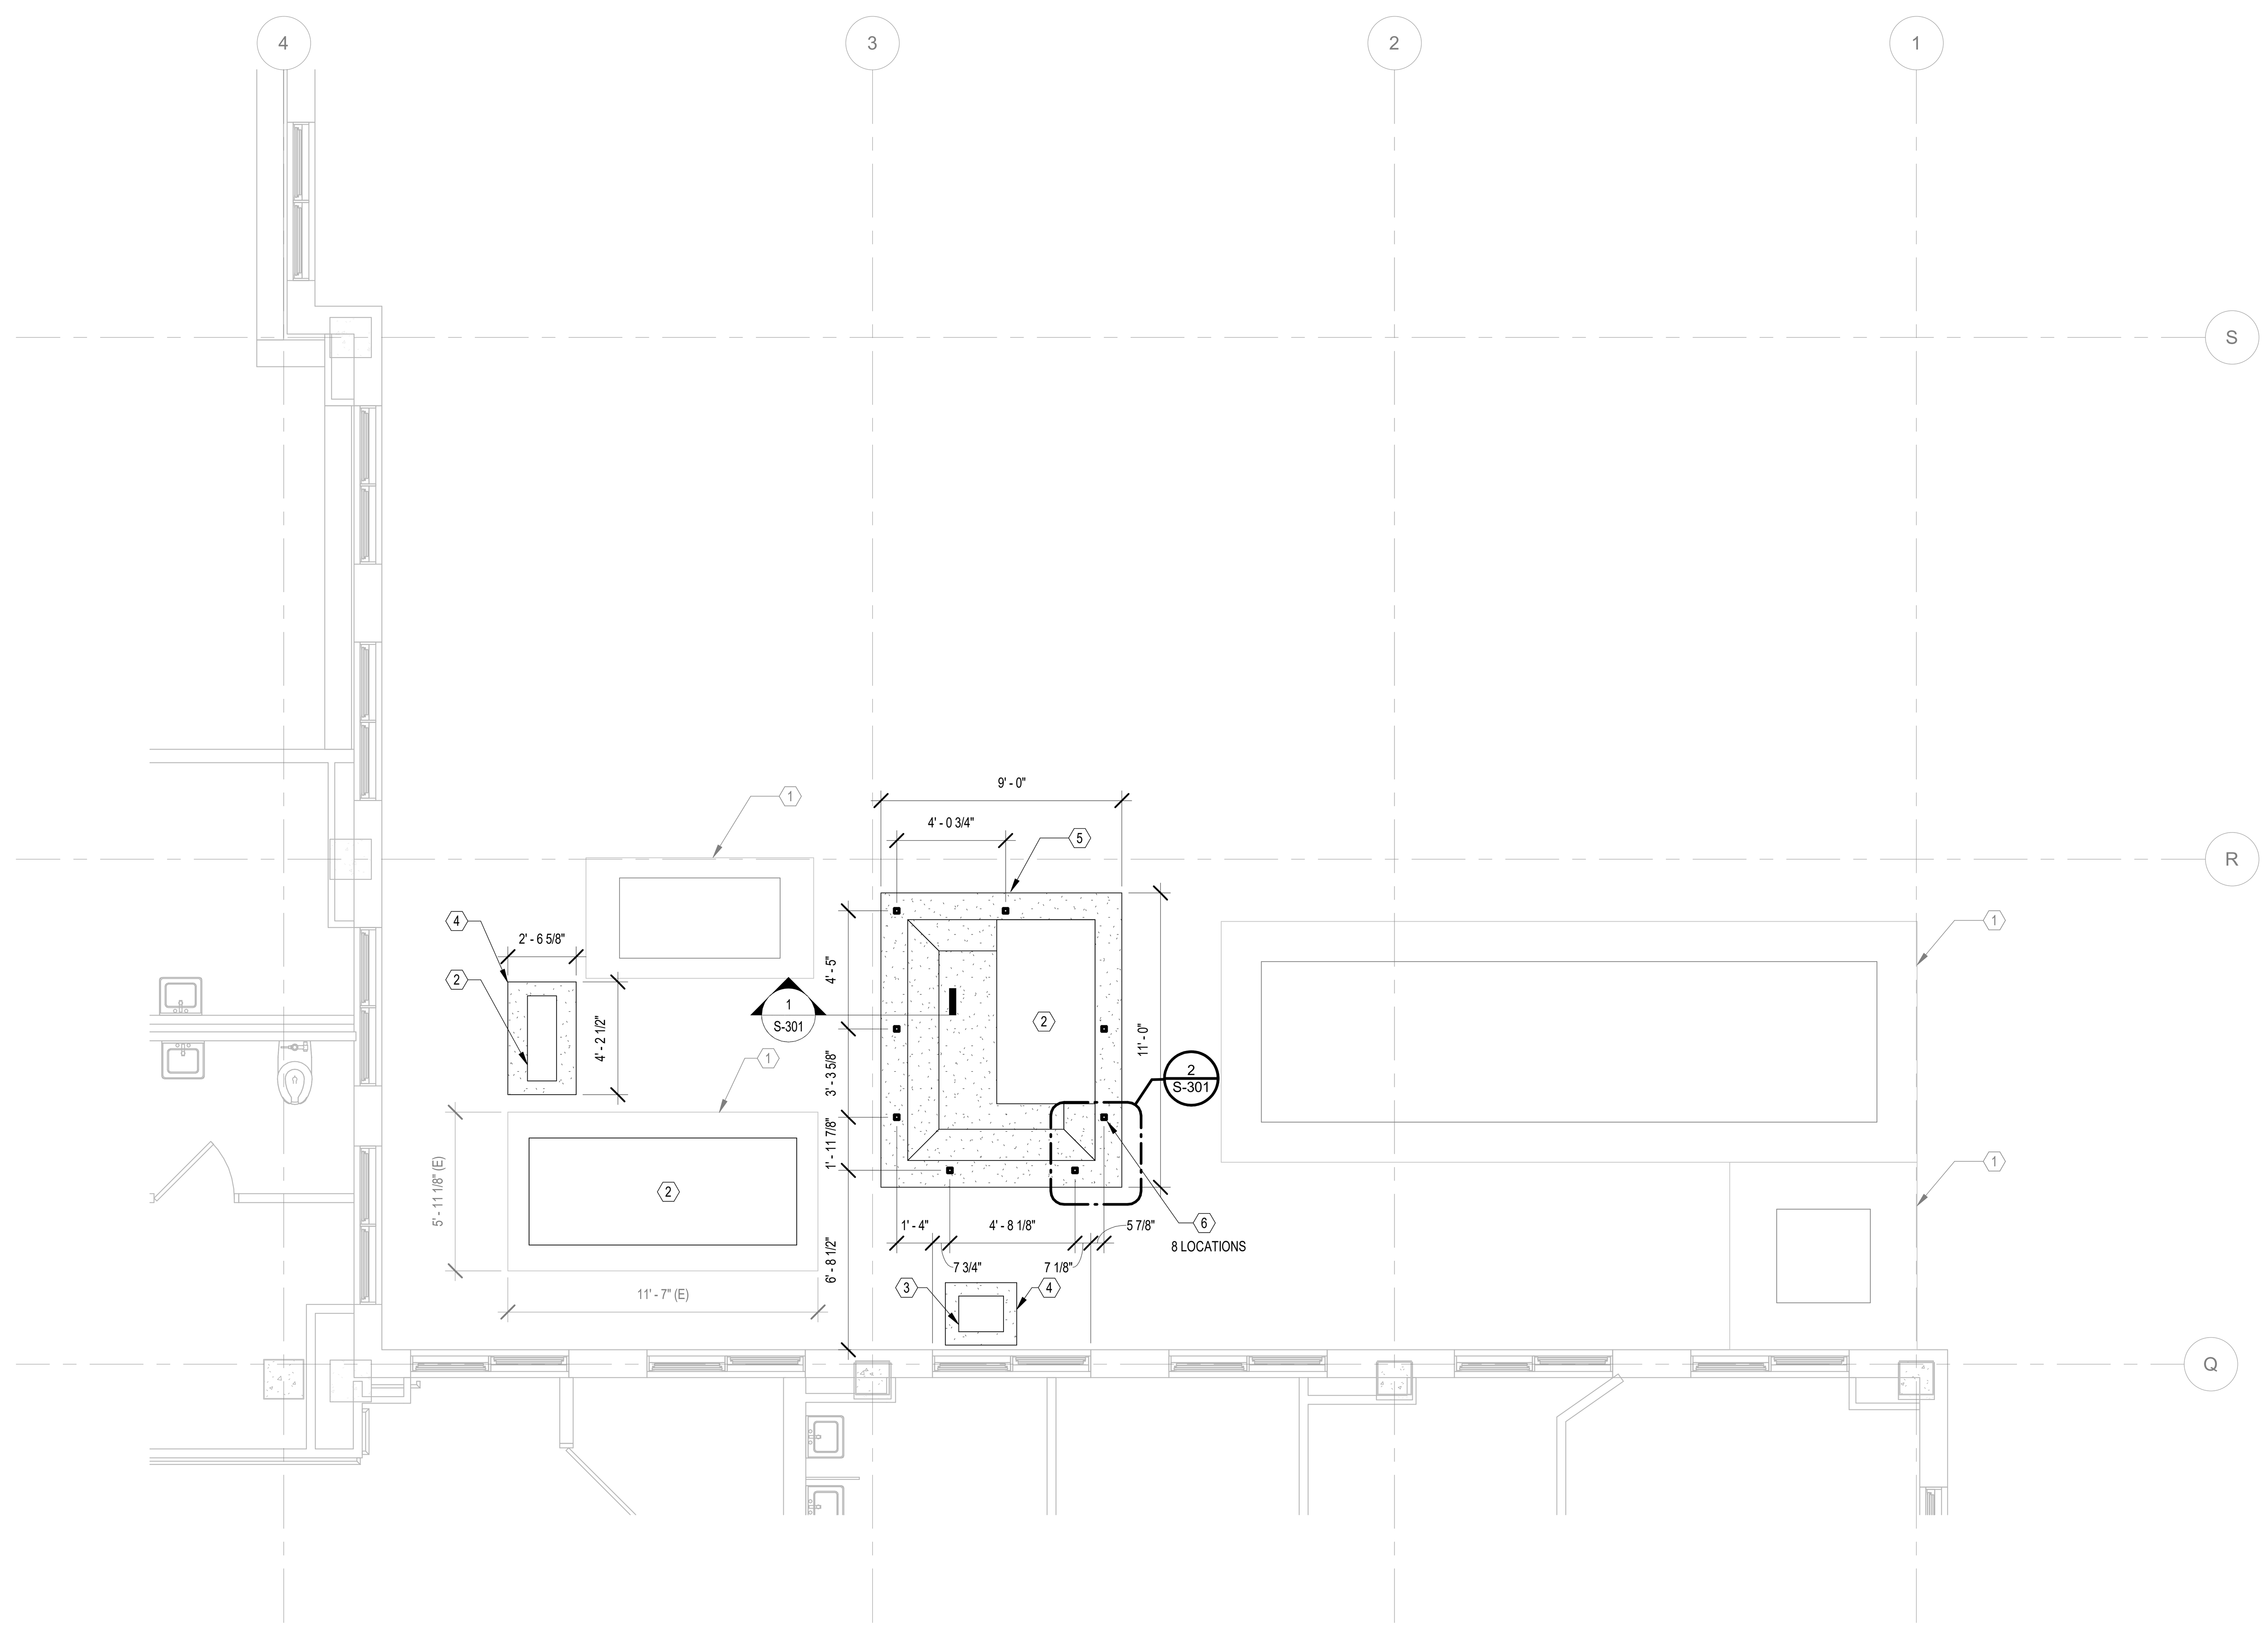

1 FIRST FLOOR FOUNDATION PLAN
1/4" = 1'-0"

KEY PLAN

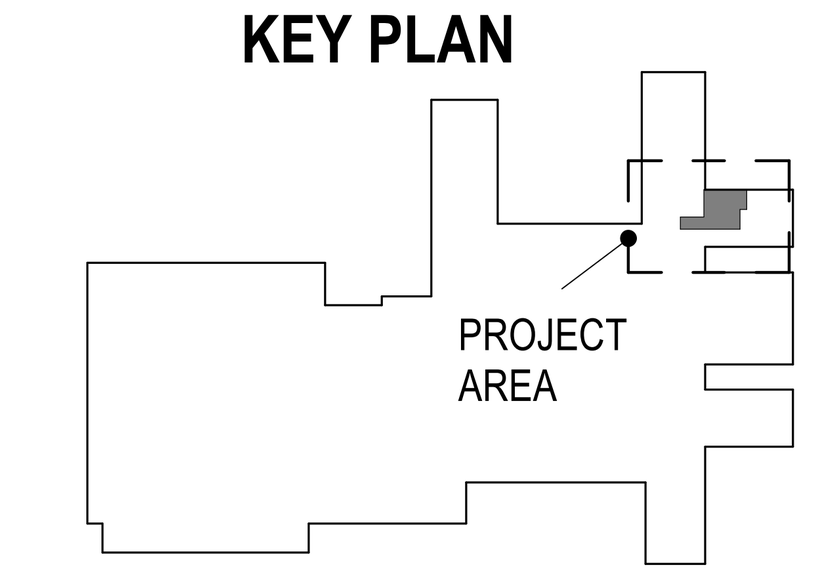

N
0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL ENGINEER
RACHEL A. STERNBERG
PE093259

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title	FIRST FLOOR FOUNDATION PLAN
Approved:	
Phase	100% CONTRACT DOCUMENTS FOR BIDDING
	FULLY SPRINKLERED
Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	RAS
Drawn	RAS
Project Number	657-23-104JC
Building Number	1
Drawing Number	SS101

DRAWING NOTES:

1. EXISTING FLOOR SLAB IS 4 1/2" THICK CONCRETE REINFORCED WITH #4 AT 8" O.C. CONTRACTOR TO GPR SCAN SECOND AND THIRD FLOOR SLAB PRIOR TO INSTALLING POST INSTALLED ANCHORS OR CORE DRILLING HOLES FOR PLUMBING PENETRATIONS. IF REBAR IS ENCOUNTERED, EQUIPMENT OR PIPING SHOULD BE RELOCATED SLIGHTLY SO THAT REBAR IS NOT CUT.
2. ALL EXISTING STEEL BEAMS SHOWN ARE ENCASED IN 2" MIN. CONCRETE.
3. IF FINAL EQUIPMENT SELECTION WEIGHT EXCEEDS 10% OF THE BASIS OF DESIGN, RE-ANALYSIS OF THE STRUCTURE WILL BE REQUIRED AND REINFORCEMENT OF THE EXISTING STRUCTURE MAY BE REQUIRED.
4. CONTRACTOR TO CONFIRM FLOOR AREA AROUND GANTRY AND PATIENT TABLE MEETS THE MANUFACTURER'S FLOOR LEVELNESS CRITERIA PRIOR TO INSTALLING EQUIPMENT. IF FLOOR IS NOT LEVEL, THE TOP SURFACE WILL NEED TO BE ROUGHENED AND PATCHED WITH LEVEL TOPPING CONCRETE.
5. WEIGHT OF ADDED LEAD SHIELDING IS BASED ON PHYSICIST REPORT BY WEST PHYSICS DATED NOVEMBER 12, 2024. REFER TO ARCHITECTURAL DRAWINGS FOR ADDED LEAD FOR WALLS. 1/32" LEAD HAS BEEN ACCOUNTED FOR BEING APPLIED TO THE FLOOR AND THE CEILING. IF THE THICKNESS OF LEAD IS MORE THAN INDICATED IN FINAL PHYSICISTS REPORT, RE- ANALYSIS OF THE STRUCTURE WILL BE REQUIRED AND REINFORCEMENT OF THE EXISTING STRUCTURE MAY BE REQUIRED IN THAT CASE.

CODED NOTES:

1. GANTRY, 6,300 LBS. THRU BOLTED TO THE EXISTING SECOND FLOOR SLAB WITH POST INSTALLED ANCHORS PER MANUFACTURER'S REQUIREMENTS.
2. PATIENT TABLE, 1,100 LBS. THRU BOLTED TO THE EXISTING SECOND FLOOR SLAB WITH POST INSTALLED ANCHORS PER MANUFACTURER'S REQUIREMENTS.
3. HEAT EXCHANGER CABINET, 950 LBS. THRU BOLTED TO THE EXISTING SECOND FLOOR SLAB WITH POST INSTALLED ANCHORS PER MANUFACTURER'S REQUIREMENTS.
4. UPS, 800 LBS. THRU BOLTED TO THE EXISTING SECOND FLOOR SLAB WITH POST INSTALLED ANCHORS PER MANUFACTURER'S REQUIREMENTS.
5. MEDRAD INJECTOR SUPPORTED BY CEILING PLATE SUPPORTED BY UNISTRUT FRAME PROVIDED BY CONTRACTOR ANCHORED TO UNDERSIDE OF EXISTING THIRD FLOOR SLAB WITH POST INSTALLED ANCHORS PER MANUFACTURER'S REQUIREMENTS.
6. MONITOR SUPPORTED BY CEILING PLATE ANCHORED TO UNDERSIDE OF EXISTING THIRD FLOOR SLAB WITH POST INSTALLED ANCHORS PER MANUFACTURER'S REQUIREMENTS. ADDITIONAL TRANSFER PLATE REQUIRED TO PROVIDE SUPPORT BYPASSING CONCRETE ENCASED STEEL BEAM.
7. CAMERA SUPPORTED FROM UNDERSIDE OF EXISTING THIRD FLOOR SLAB WITH POST INSTALLED ANCHORS PER MANUFACTURER'S REQUIREMENTS. ADDITIONAL TRANSFER PLATE REQUIRED TO PROVIDE SUPPORT BYPASSING CONCRETE ENCASED STEEL BEAM.
8. METAL PANEL ENCLOSURE, REFER TO ARCHITECTURAL DRAWINGS.
9. UNISTRUT FRAMING, REFER TO SECTION CUT ON PLAN.
10. SUPPORT END UNISTRUT FRAME ON DUCT SUPPORT ANGLE BRACKET, REFER TO MECHANICAL DRAWINGS.
11. PENETRATION IN EXISTING FLOOR, REFER TO PLUMBING DRAWINGS.

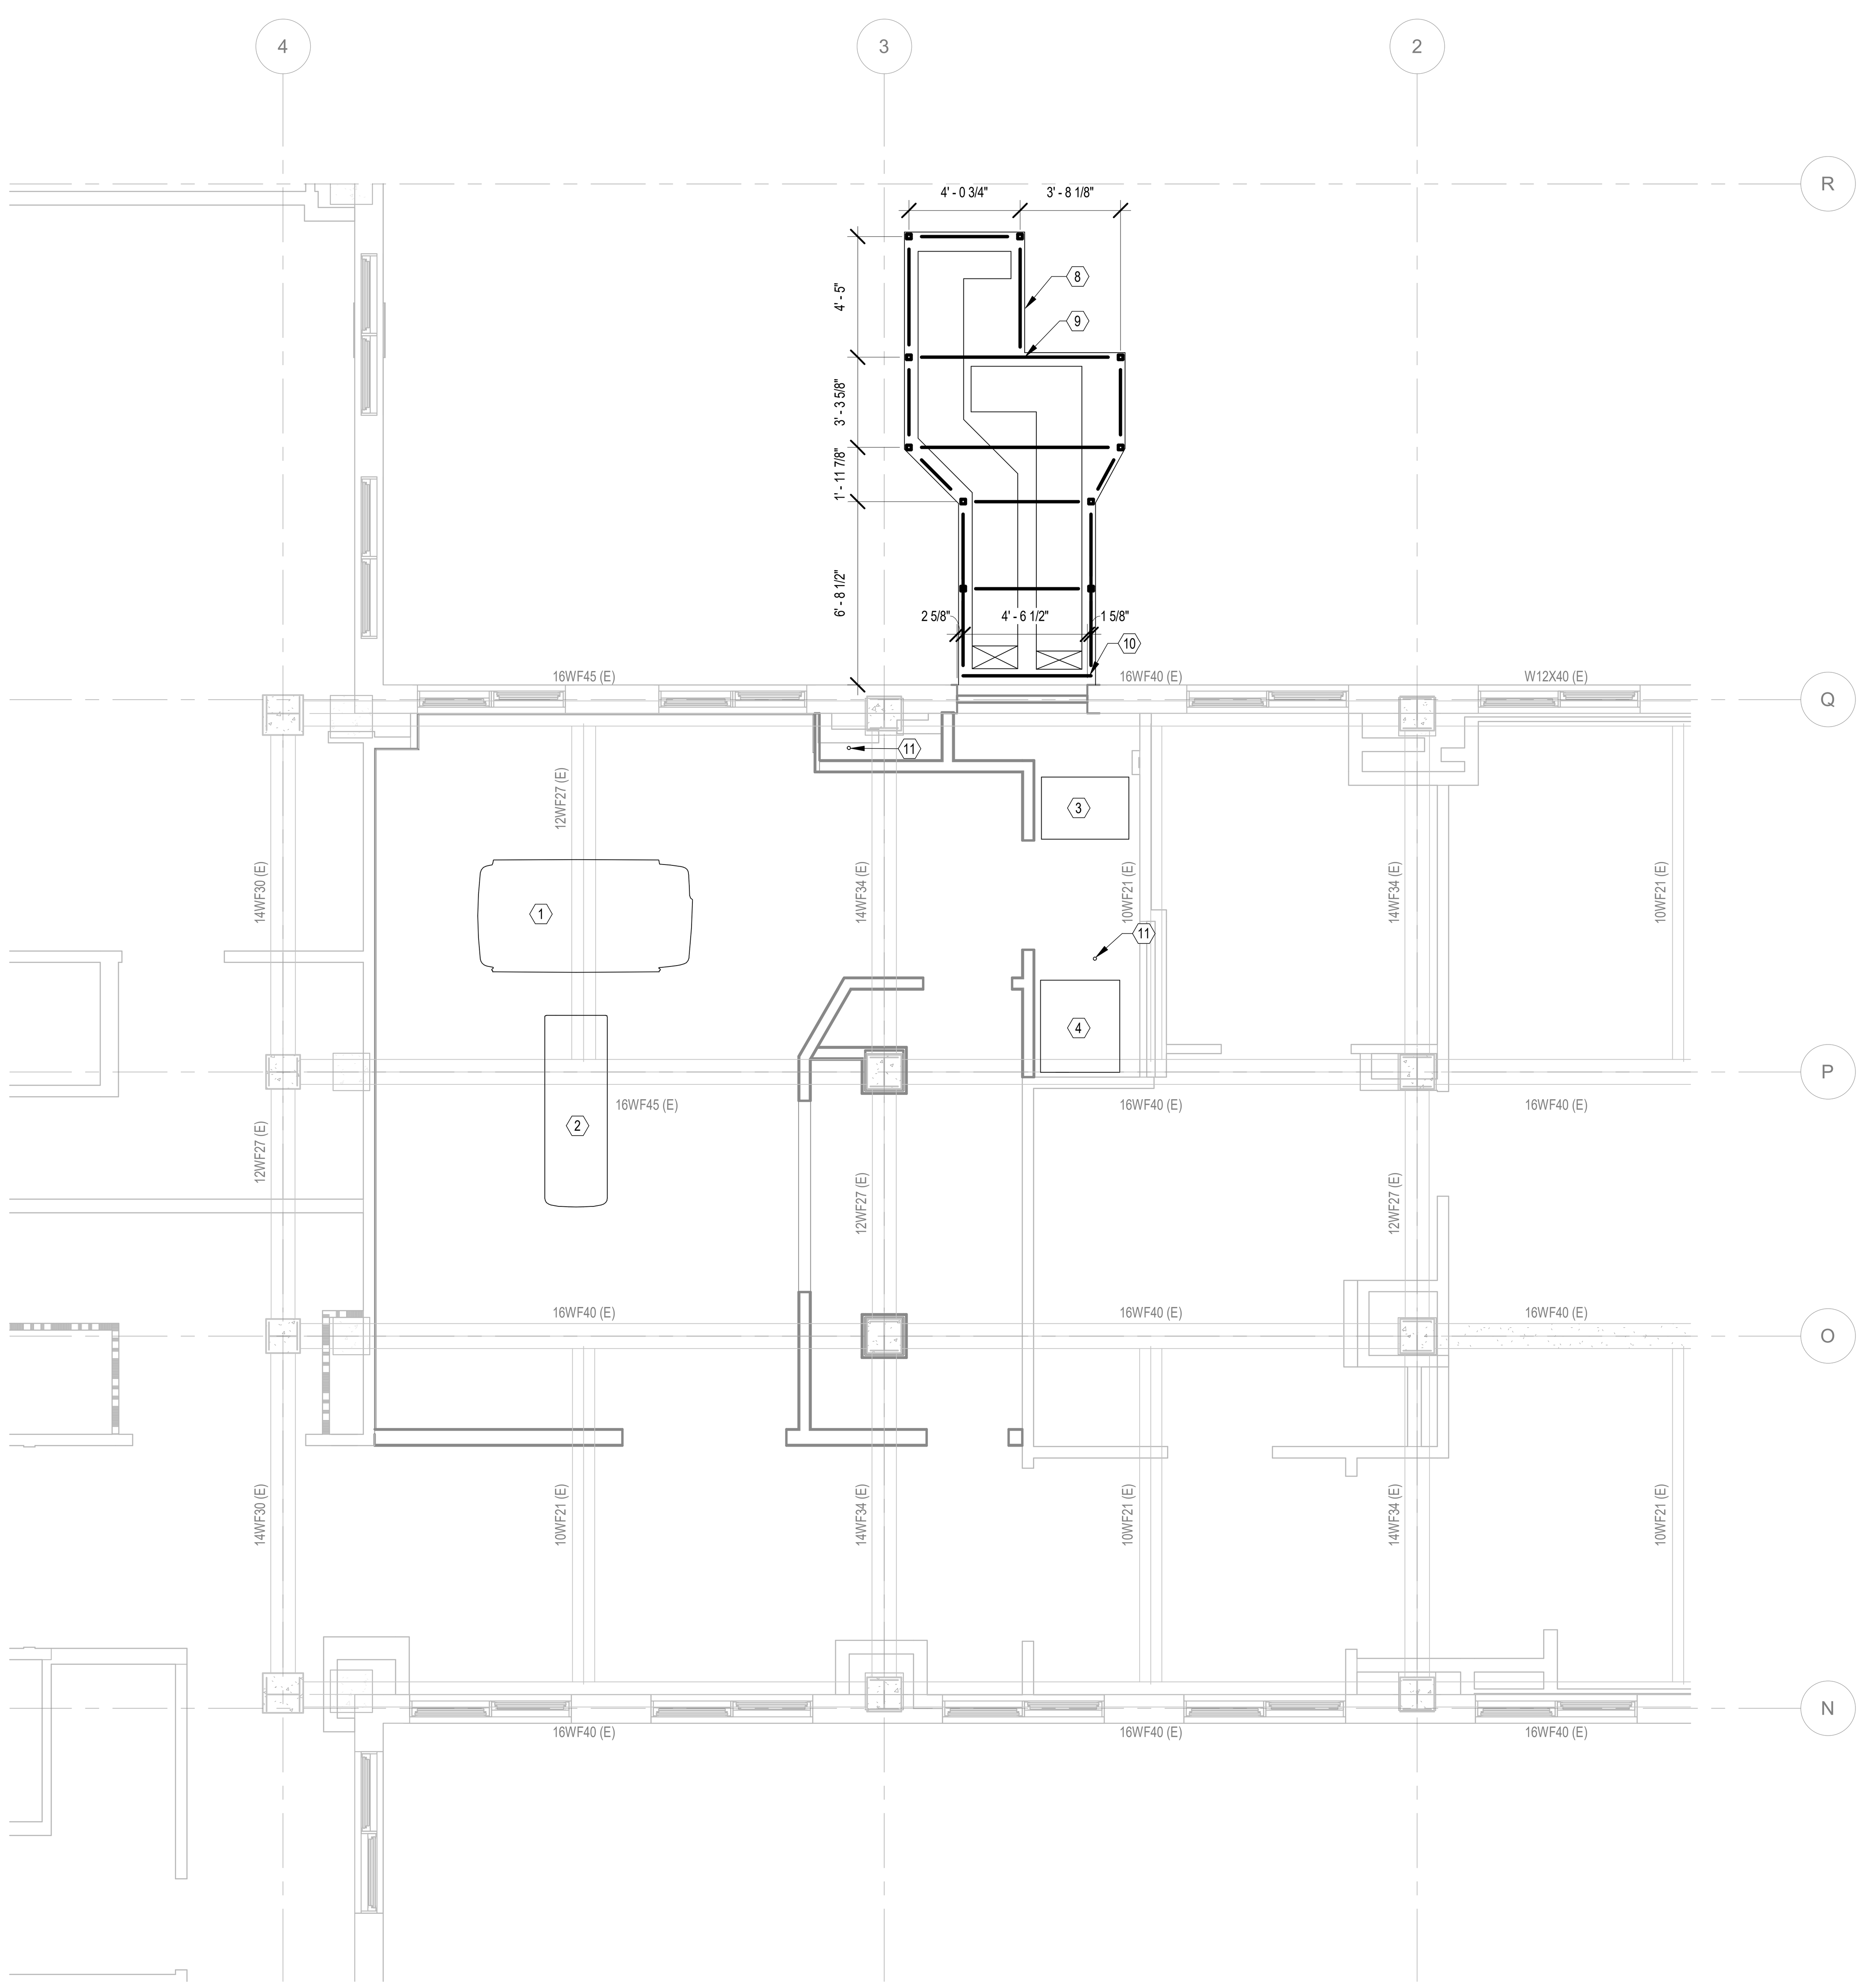

1 SECOND FLOOR FRAMING PLAN
1/4" = 1'-0"

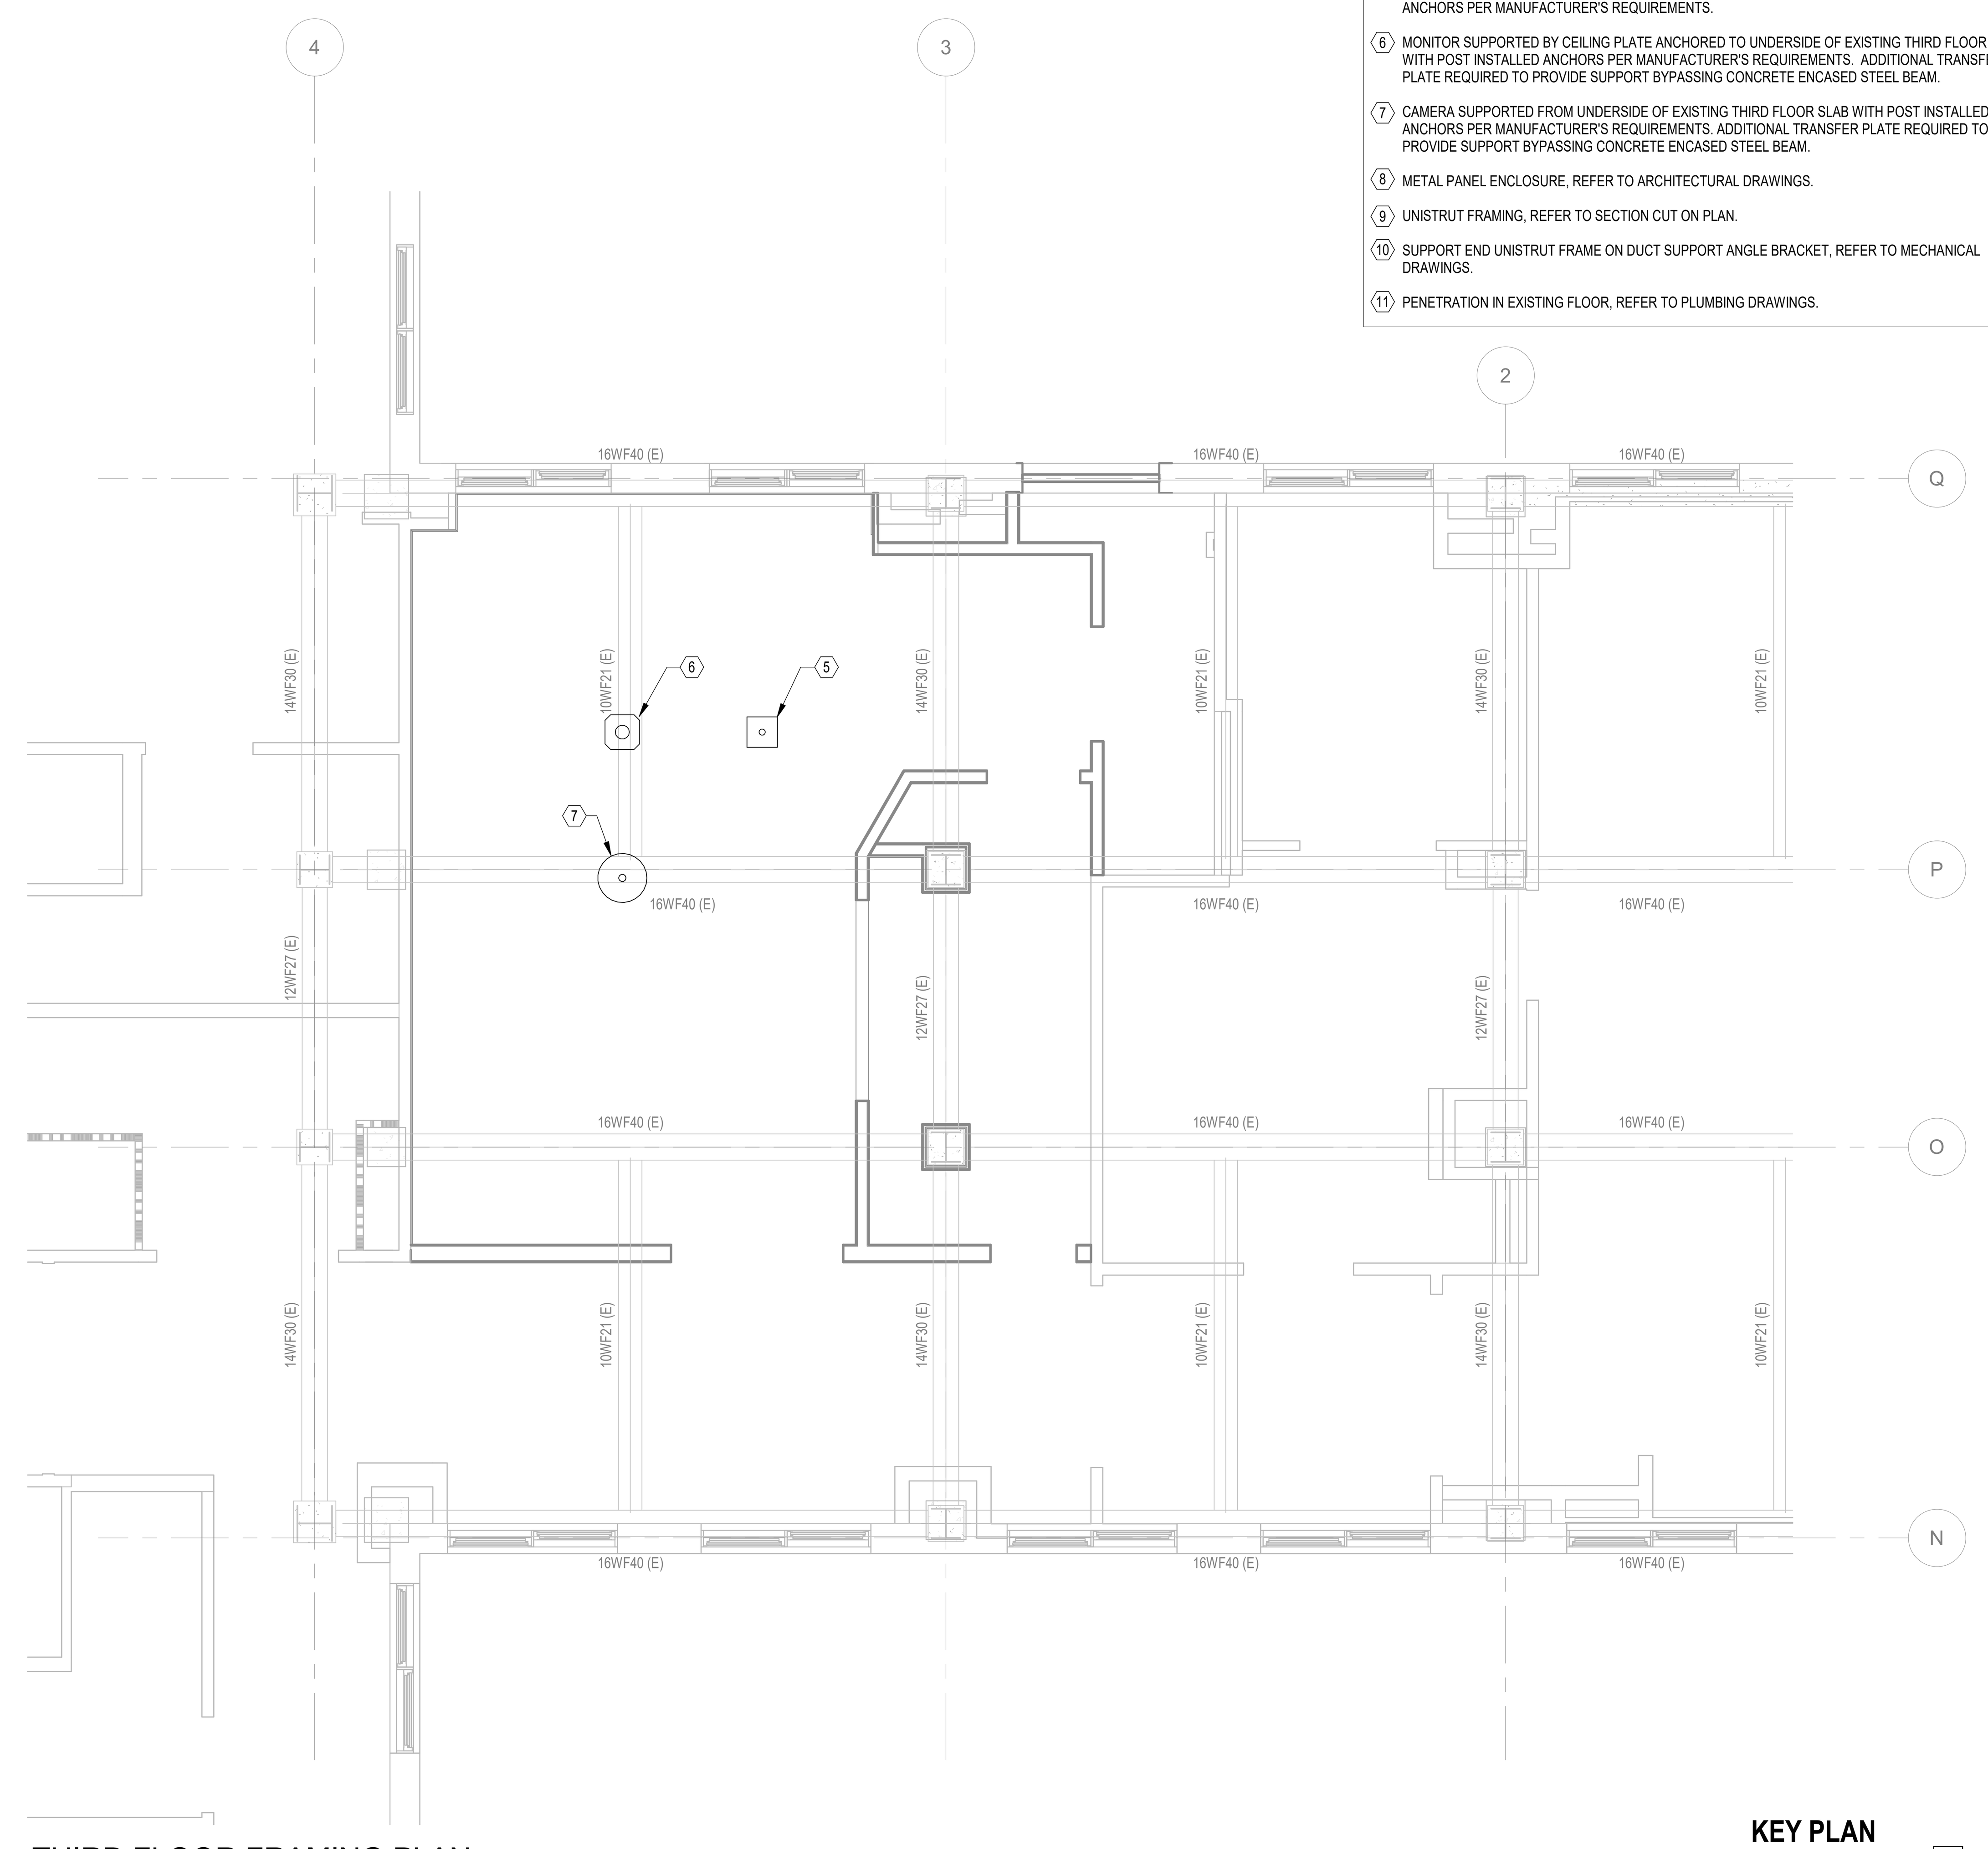

2 THIRD FLOOR FRAMING PLAN
1/4" = 1'-0"

KEY PLAN

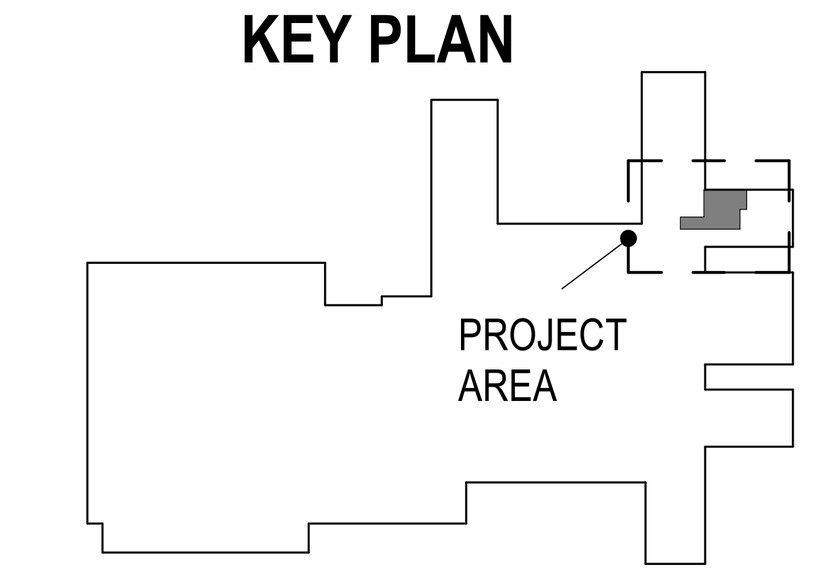

N
0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions: | Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP
COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
RACHEL A. STERNBERG
ENGINEER
PE093259

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: SECOND AND THIRD FLOOR FRAMING PLANS	Phase: 100% CONTRACT DOCUMENTS FOR BIDDING	Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	Project Number: 657-23-104JC
			Building Number: 1
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Drawing Number: SS102
		Issue Date: 06 MARCH 2026 / Checked: RAS / Drawn: RAS	

VA FORM 08 - 6231

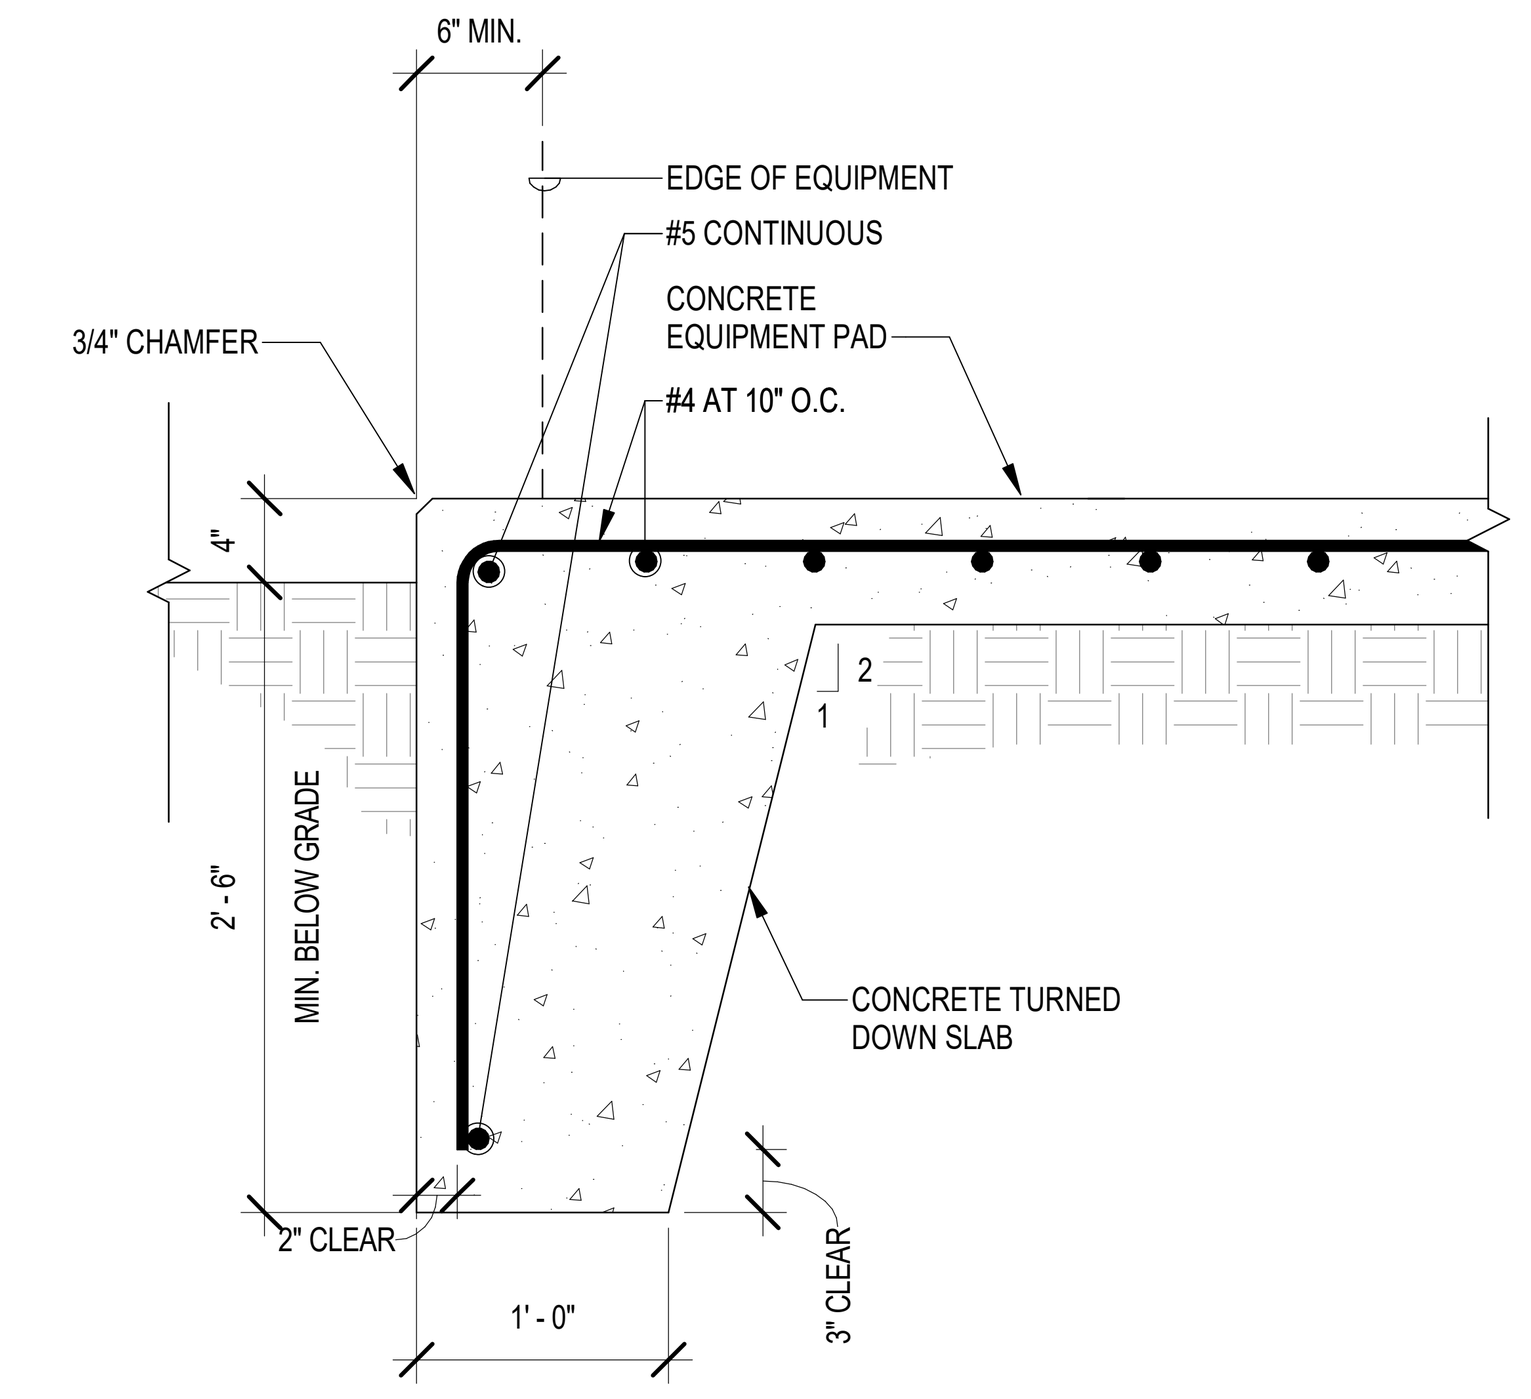

NOTE:
1. ALL REBAR TO BE EPOXY COATED.
2. AT CONTRACTOR'S OPTION, USE 1:1 SLOPE IF NEEDED FOR SOILS ON SITE.

1 EXTERIOR CONCRETE EQUIPMENT PAD DETAIL
N.T.S.

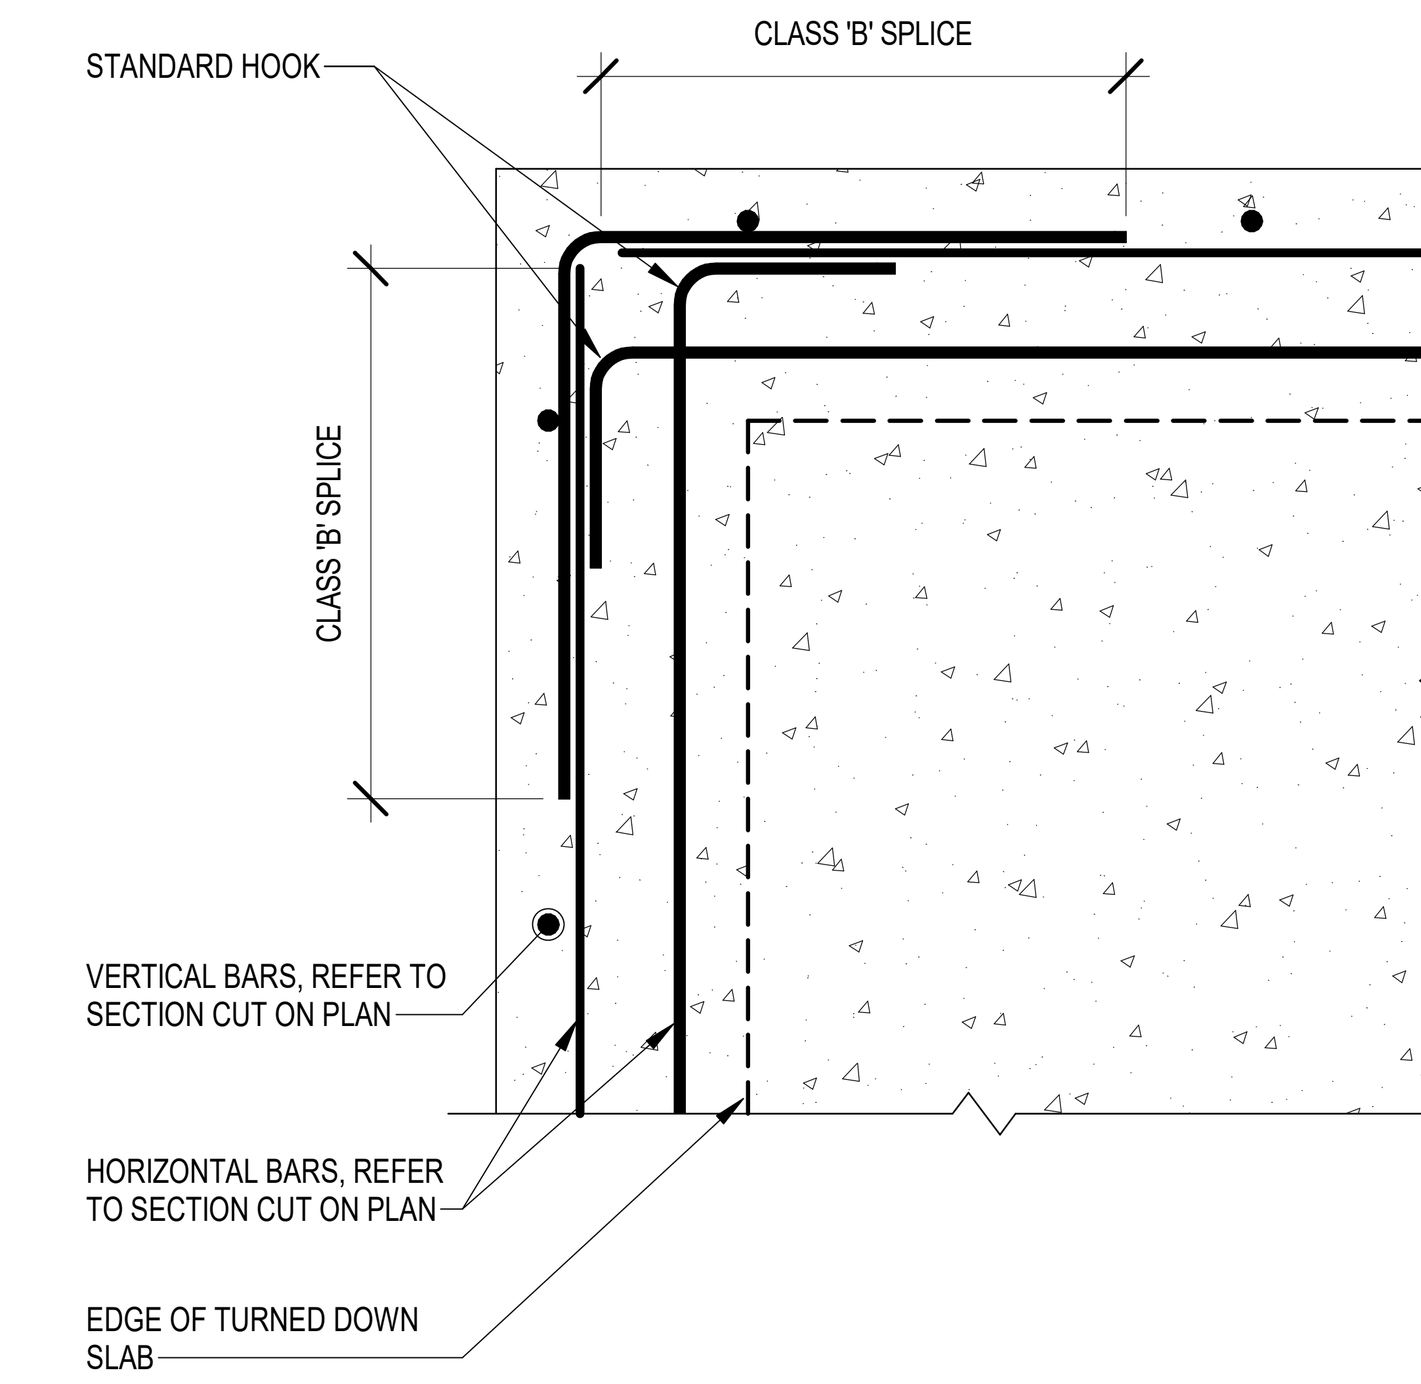

2 TURNED DOWN SLAB CORNER DETAIL
N.T.S.

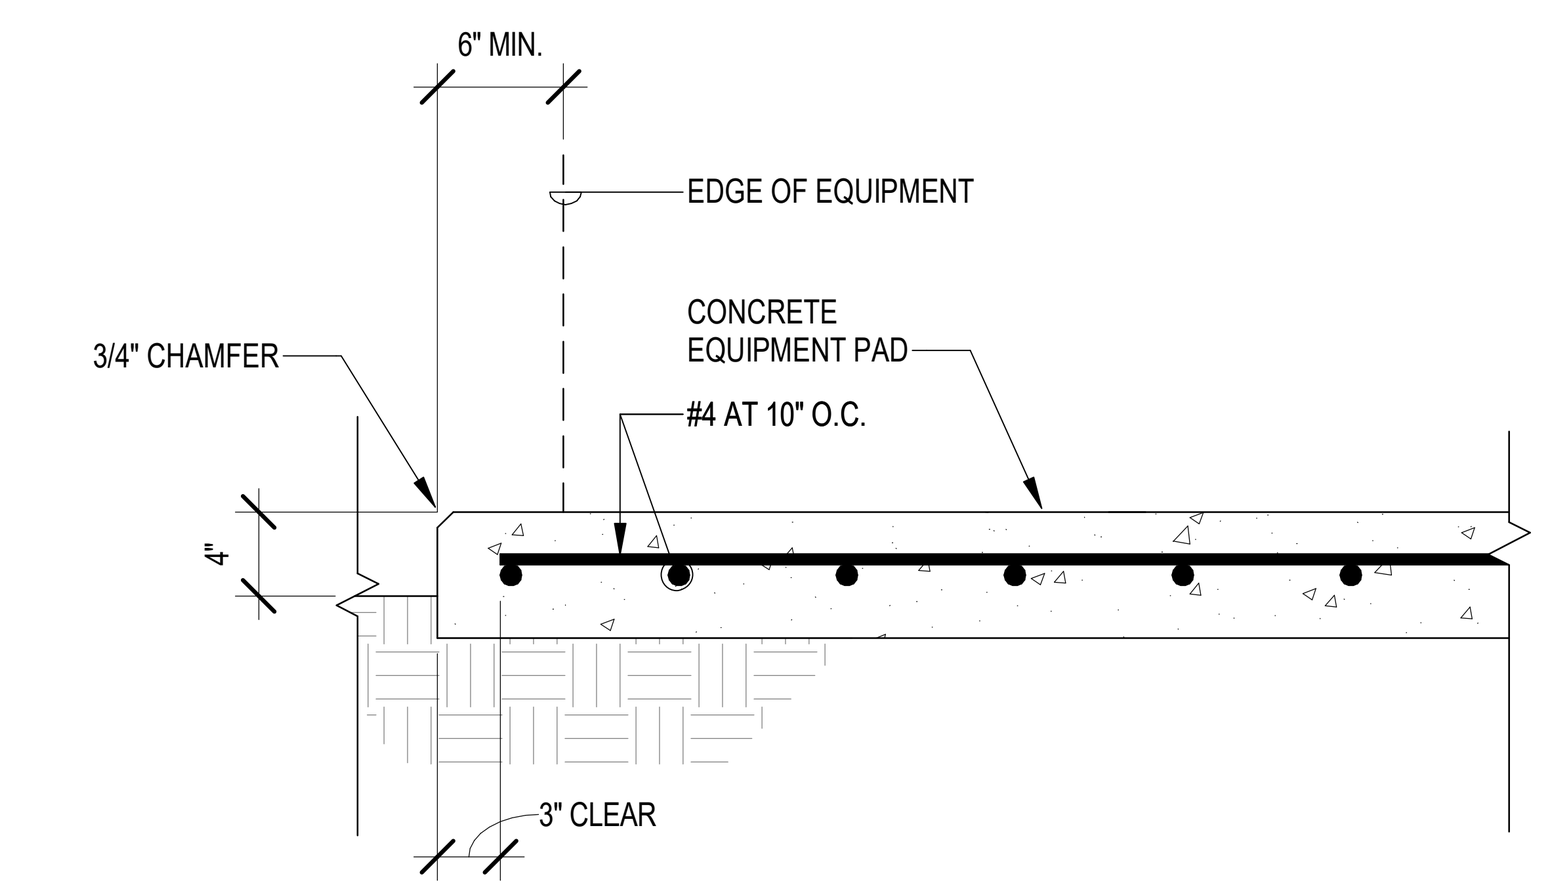

NOTE:
ALL REBAR TO BE EPOXY COATED.

3 EXTERIOR CONCRETE EQUIPMENT PAD DETAIL
N.T.S.

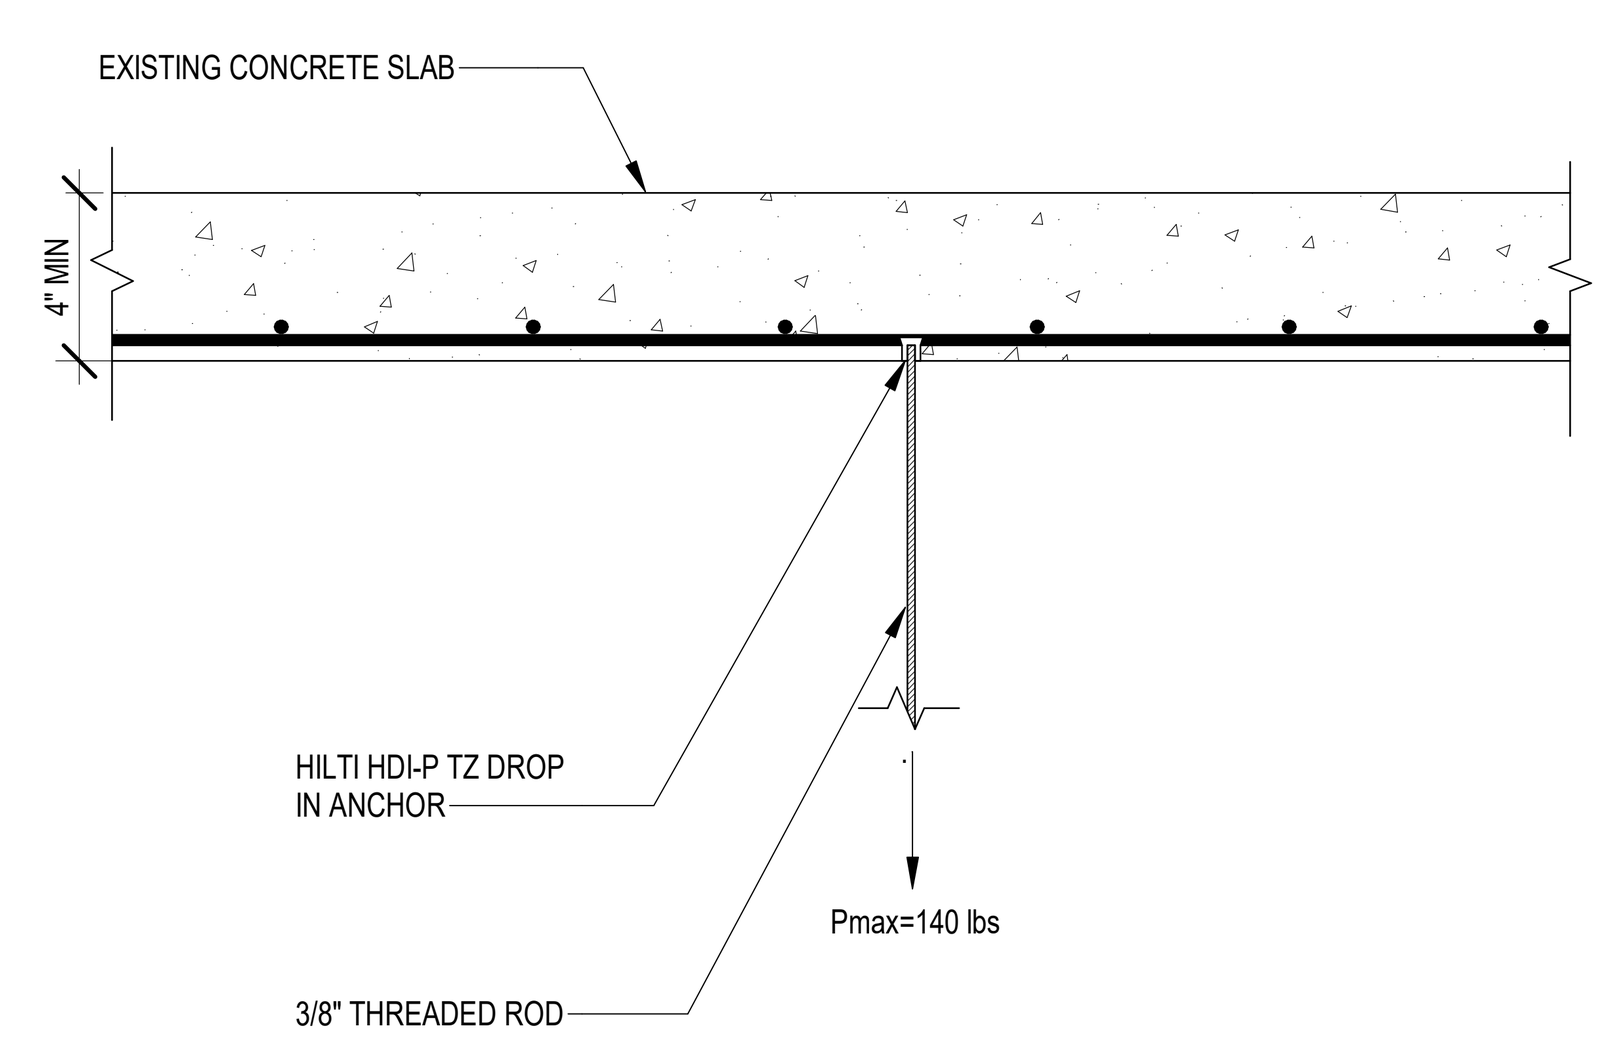

NOTE:
DETAIL MAY ALSO APPLY TO THE BOTTOM OF CONCRETE BEAMS.

4 SECURE HANGING RODS IN CONCRETE
N.T.S.

Revisions: Date:

CONSULTANT
Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD
THINKFORM
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP
COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
RACHEL A. STERNBERG
ENGINEER
PE093259

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: DETAILS AND SECTIONS	Phase: 100% CONTRACT DOCUMENTS FOR BIDDING	Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259		Project Number: 657-23-104JC
				Building Number
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106		Drawing Number: S-301
		Issue Date: 06 MARCH 2026	Checked: RAS / Drawn: RAS	

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis Prep Site For CT_R23_S.rvt
3/4/2026 1:24:03 PM

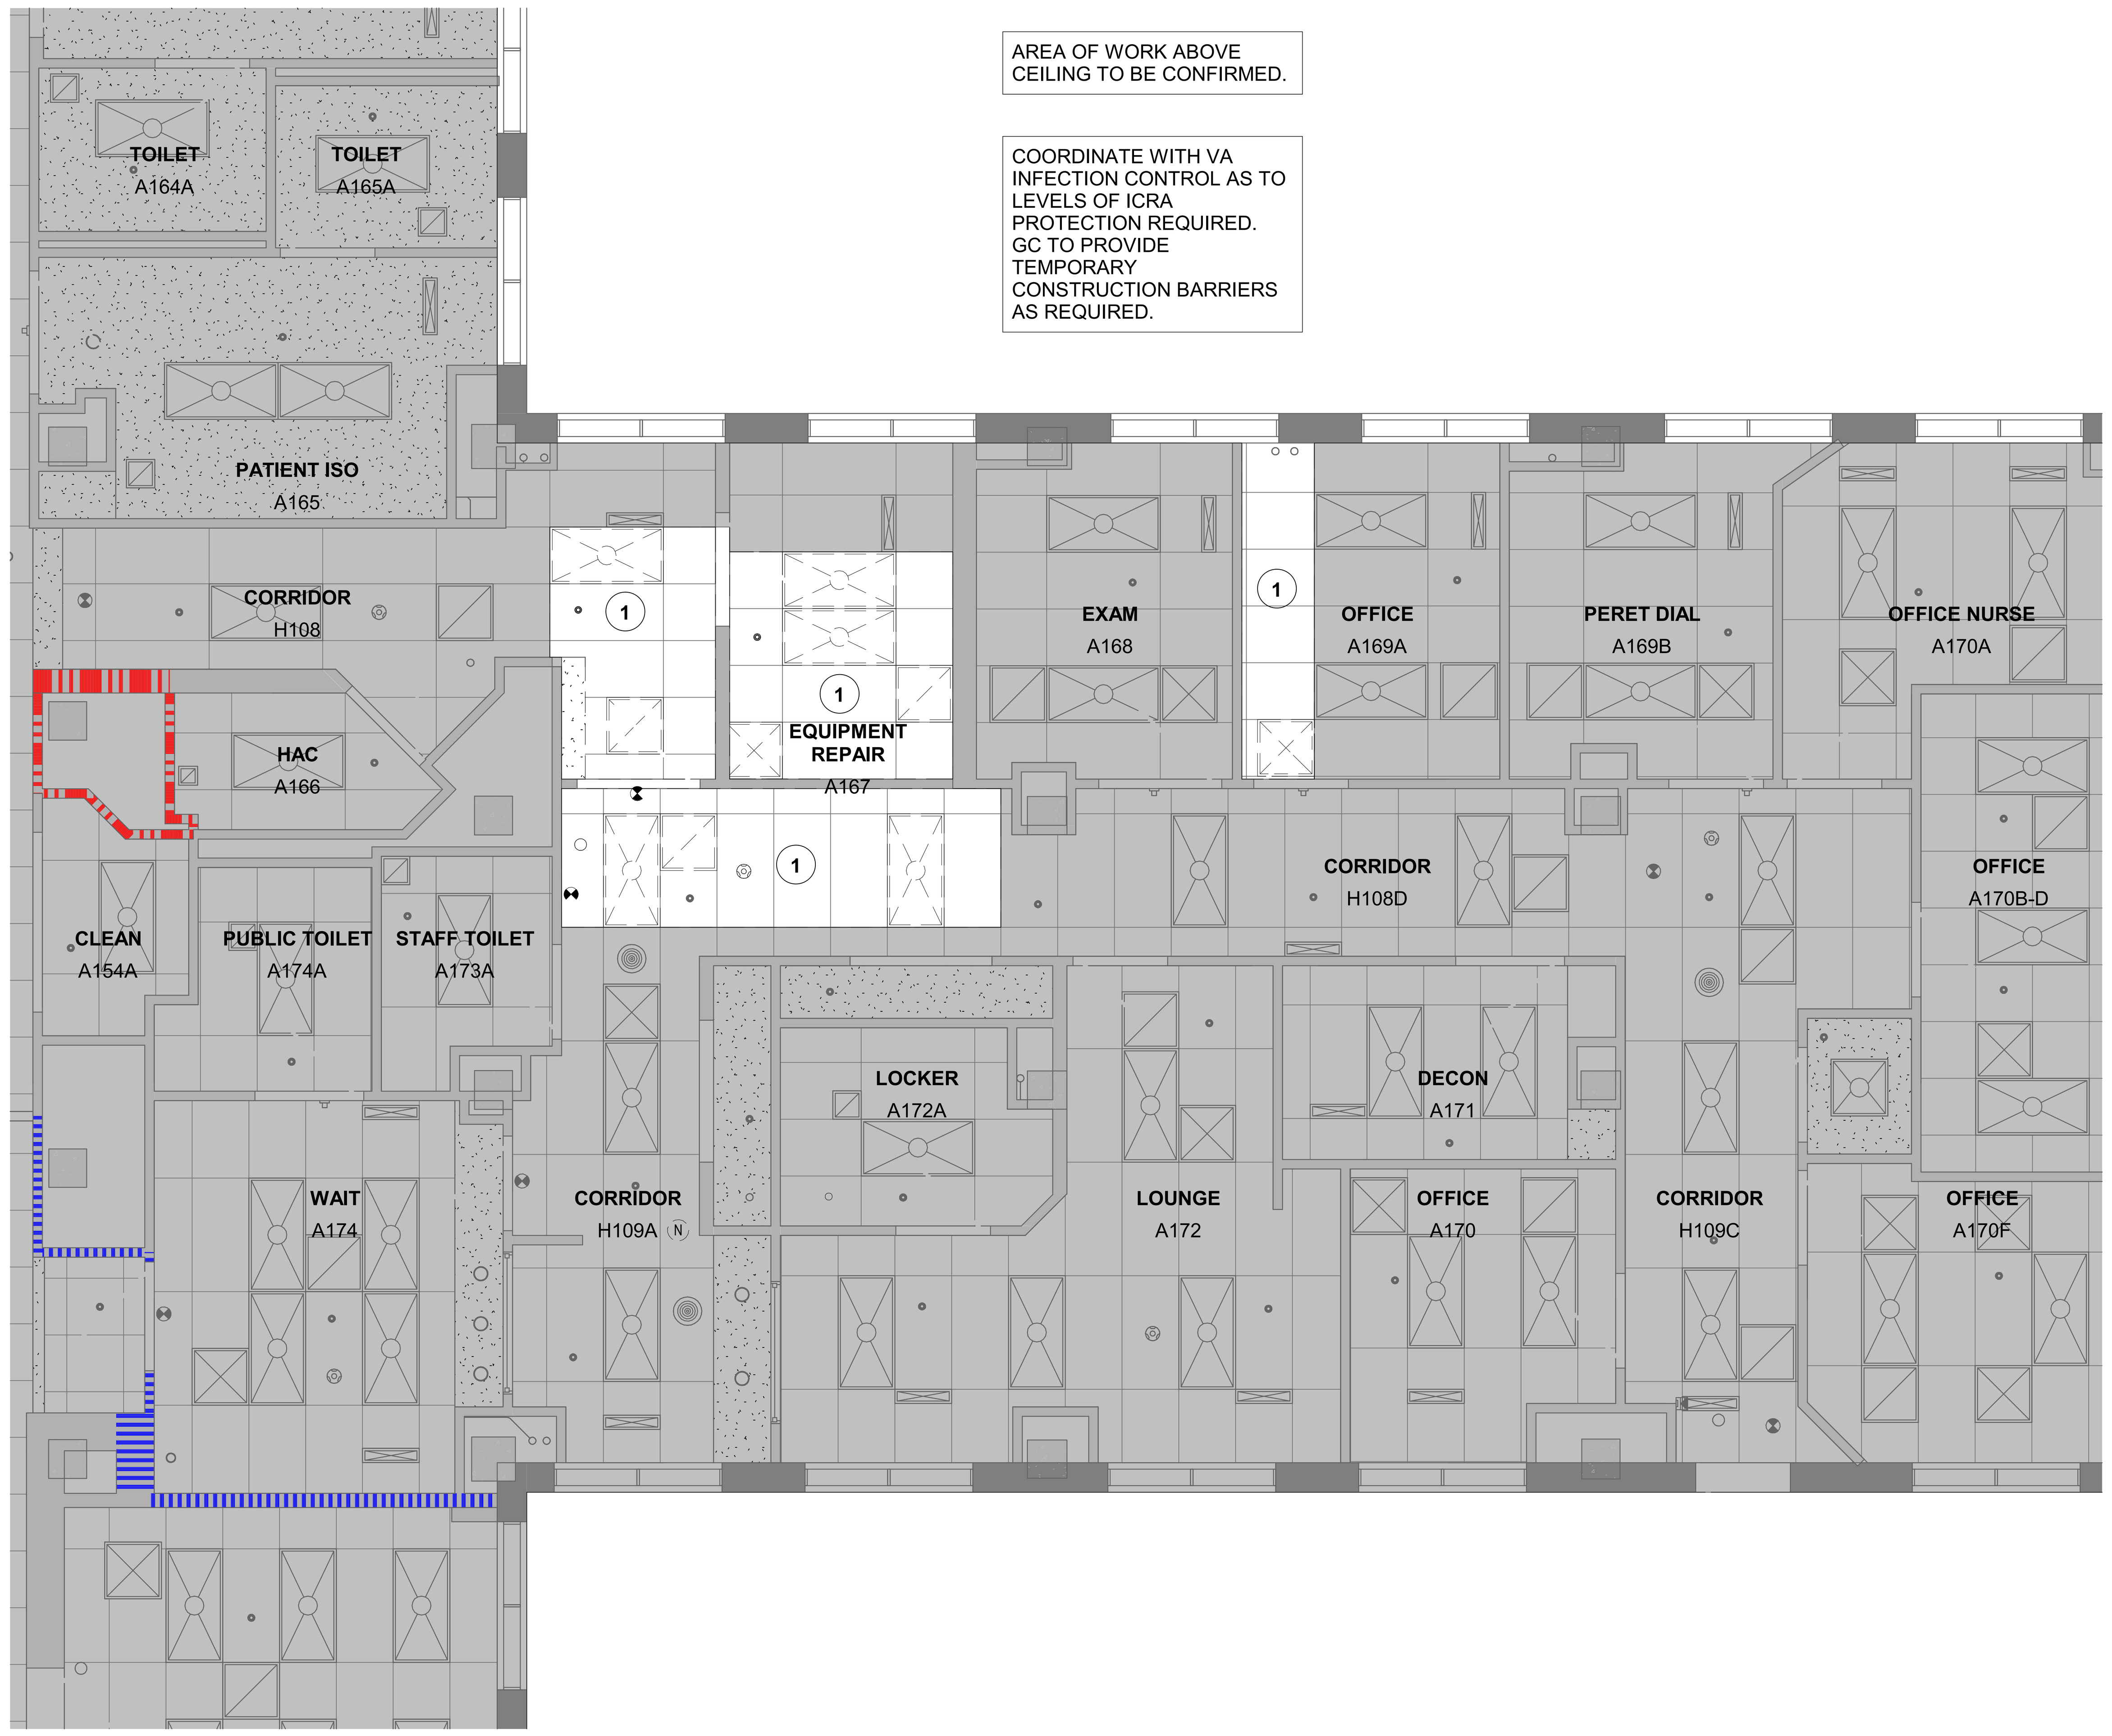

1 FIRST FLOOR REFLECTED CEILING DEMOLITION PLAN

1/4" = 1'-0"

DEMOLITION NOTES

(APPLY TO THIS SHEET ONLY)

1 TEMPORARILY REMOVE AND SALVAGE CEILING, GRID AND LIGHT FIXTURES AS REQUIRED TO ACCESS SPACE ABOVE FOR MEP WORK. DAMAGED TILES TO BE REPLACED TO MATCH ADJACENT

DEMOLITION LEGEND:

- EXISTING WALL TO REMAIN
- EXISTING DOOR TO REMAIN
- TEMPORARY 1 HR BARRIER
- DEMOLITION SCOPE
- EXISTING 2 HR FIRE RATED FIRE BARRIER
- NOT IN SCOPE
- EXTENT OF FLOOR SLAB TO BE REMOVED. COORDINATE DIMENSIONS AND LOCATIONS WITH STRUCTURAL AND UTILITIES
- TEMPORARY CONSTRUCTION STICKY MAT
- 10 DEMOLITION NOTE

RCP DEMOLITION LEGEND:

REFER TO MEP DRAWINGS AND SPECIFICATIONS FOR MORE INFORMATION

- 9'-0" CEILING HEIGHT TAG
- EXISTING 2' X 4' SUSPENDED ACOUSTICAL CEILING TILE TO BE REMOVED IN ITS ENTIRETY
- EXISTING GYPSUM BOARD SOFFIT TO REMOVED
- 2 X 4 FIXTURE TO BE REMOVED - SEE MEP DRAWINGS
- 2 X 2 FIXTURE TO BE REMOVED - SEE MEP DRAWINGS
- RECESSED CAN FLUORESCENT LIGHT FIXTURE - SEE MEP DRAWINGS
- SPRINKLER HEAD TO BE SALVAGED FOR REUSE - SEE MEP DRAWINGS
- RETURN GRILL TO BE REMOVED - SEE MEP DRAWINGS
- SUPPLY 2X 4. DIFFUSER GRILL TO BE REMOVED - SEE MEP DRAWINGS
- SUPPLY 2X2 DIFFUSER GRILL TO BE REMOVED - SEE MEP DRAWINGS

GENERAL DEMOLITION NOTES:

A. THE CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS IN THE FIELD AND COORDINATE ALL REMOVAL ACTIVITIES WITH NEW CONSTRUCTION. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES TO THE OWNER'S REPRESENTATIVE FOR RESOLUTION PRIOR TO BEGINNING REMOVALS.

B. PROTECT ALL CONSTRUCTION TO REMAIN FROM DAMAGE DURING REMOVAL OF ADJACENT CONSTRUCTION. REPAIR/REPLACE CONSTRUCTION TO REMAIN THAT WAS DAMAGED DURING DEMOLITION TO MATCH THE QUALITY OF THE NEW WORK. PROVIDE DUST CONTROL AND CONTAINMENT MATS, FLOOR AND WALL PROTECTION.

C. THE ARCHITECTURAL DRAWINGS SHOW PRINCIPAL AREAS WHERE WORK MUST BE ACCOMPLISHED UNDER THIS CONTRACT. INCIDENTAL WORK MAY ALSO BE NECESSARY IN AREAS NOT SHOWN ON THE ARCHITECTURAL DRAWINGS DUE TO CHANGES AFFECTING EXISTING ELECTRICAL, OR OTHER SYSTEMS. SUCH INCIDENTAL WORK IS ALSO A PART OF THE CONTRACT. CONTRACTOR SHALL INSPECT THOSE AREAS AND ASCERTAIN WORK NEEDED AND DO THAT WORK IN ACCORDANCE WITH THE CONTRACT REQUIREMENTS AND AT NO ADDITIONAL COST TO THE OWNER.

D. DO NOT DRILL OR CUT EXISTING FLOOR JOISTS, BEAMS, COLUMNS OR OTHER STRUCTURAL ELEMENTS UNLESS SPECIFICALLY NOTED. MAKE OPENINGS OF PROPER SIZE FOR CONDUITS AND PIPING AND OTHER ITEMS PASSING THROUGH OPENINGS.

E. GC TO SCAN THE SLAB AT EA LOCATION OF PROPOSED FLOOR/SLAB PENETRATION PRIOR TO CUTTING TO ENSURE THAT AREA IS CLEAR OF EMBEDDED CONDUITS AND/OR LIVE CONDUCTORS.

F. REPAIR, PATCH AND FINISH, OR REFINISH AS APPLICABLE, TO MATCH ADJACENT EXISTING FINISHES DAMAGED OR NEWLY EXPOSED DURING THE PERFORMANCE OF THE WORK OF THIS CONTRACT.

G. WHERE CUTTING OF EXISTING SURFACES OR REMOVAL OF EXISTING FINISHES IS REQUIRED TO PERFORM THE WORK UNDER THIS CONTRACT, AND A NEW FINISH IS NOT INDICATED, FILL RESULTING OPENINGS AND PATCH THE SURFACE AFTER DOING THE WORK, AND FINISH TO MATCH ADJACENT EXISTING SURFACES.

H. WHERE A NEW CEILING IS NOT SCHEDULED, INSTALL CONDUITS AND PIPING IN EVERY CASE ABOVE THE CEILING. REMOVE EXISTING CEILING AS NECESSARY. AFTER INSTALLATION OF CONCEALED WORK, REINSTALL REMOVED CEILING AND PATCH AND REFINISH TO MATCH ADJACENT UN-REMOVED CEILINGS.

I. WORK SHOWN IS NEW UNLESS SPECIFICALLY NOTED OR OTHERWISE INDICATED AS EXISTING.

J. PROVIDE HEADERS/LINTELS OVER EVERY OPENING IN BOTH NEW AND EXISTING WALLS AND PARTITIONS.

K. WHERE "MATCH EXISTING" IS INDICATED, NEW CONSTRUCTION OR FINISHES, AS APPROPRIATE TO THE NOTE, SHALL MATCH THE EXISTING IN THE PARTICULAR.

L. DEFINITIONS
M1. REMOVE: REMOVE AND LEGALLY DISPOSE OF ITEMS EXCEPT THOSE INDICATED TO BE REINSTALLED, SALVAGED, OR EXISTING.
M2. SALVAGE: ITEMS INDICATED TO BE SALVAGED SHALL REMAIN THE OWNER'S PROPERTY. REMOVE, CLEAN AND PACK OR CRATE ITEMS TO PROTECT AGAINST DAMAGE. IDENTIFY CONTENTS OF CONTAINERS AND DELIVER TO OWNER'S DESIGNATED STORAGE AREA.
M3. REINSTALL: REMOVE ITEMS INDICATED. CLEAN SERVICE AND OTHERWISE PREPARE THEM FOR REUSE. STORE AND PROTECT AGAINST DAMAGE. REINSTALL ITEMS IN THE SAME LOCATIONS OR IN LOCATIONS INDICATED.
M4. EXISTING: ORIGINAL ITEM TO REMAIN. PROTECT CONSTRUCTION INDICATED AS EXISTING AGAINST DAMAGE AND SOILING DURING SELECTIVE DEMOLITION.
M5. RESTORE: ITEMS INDICATED SHALL BE BROUGHT BACK TO THEIR ORIGINAL CONDITION. ORIGINAL CONDITION IS THE CONDITION THAT THE REFERENCED ITEM WAS IN WHEN THE BUILDING WAS FIRST CONSTRUCTED.
M6. REPLACE: EXISTING ITEM TO BE REMOVED. PROVIDE NEW ITEM TO MATCH EXISTING.

M. CONTRACTOR TO ABIDE BY ALL THE ICRA INFECTION CONTROL REGULATIONS.

N. CONTRACTOR SHALL KEEP THE SITE CLEAN AT ALL TIMES AND COORDINATE TRASH REMOVAL WITH THE VA.

O. TEMPORARY CONTINUOUS CONSTRUCTION BARRIER MUST BE IN PLACE PRIOR TO ANY DEMOLITION. GC TO DETERMINE LOCATION FOR TEMPORARY CONSTRUCTION BARRIER DOOR ACCESS. CONSTRUCTION BARRIER DOOR(S) MUST BE SELF-CLOSING. PROVIDE STICKY MATS ON ALL ACCESS DOORS INTO CONSTRUCTION AREA. ANTE-ROOM REQUIRED AT CONSTRUCTION ENTRY. PAINT PUBLIC FACE OF TEMP BARRIER WHITE.

P. PROVIDE NANOMETER PRESSURE MONITORS FOR ALL CONSTRUCTION BARRIERS.

Q. PROVIDE NEGATIVE PRESSURE AIR HEPA UNITS AND EXHAUST TO EXTERIOR OF THE BUILDING.

R. CONTRACTOR TO REVIEW & FOLLOW ALL ABATEMENT REQUIREMENTS PRIOR TO THE START OF GENERAL DEMOLITION.

S. GC TO COORDINATE WITH VA WHEN MAJOR SHUTDOWNS ARE TO OCCUR. SHUTDOWNS WILL NEED TO OCCUR AFTER REGULAR BUSINESS HOURS, OVERNIGHT AND WEEKENDS AS NEEDED TO MINIMIZE IMPACT TO PATIENTS AND STAFF.

KEY PLAN

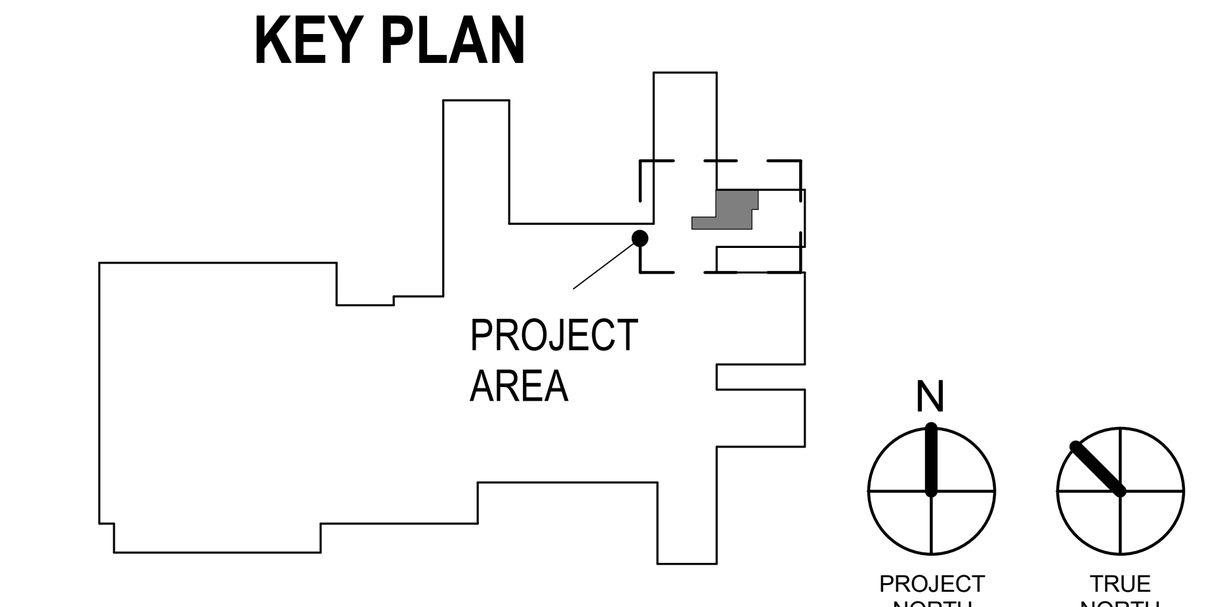

Revisions:	Date:

CONSULTANT

Above Group ENGINEERING. DESIGN. CONSULTING.

Mabbett Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects

THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP

STATE OF MISSOURI RUSSELL DINARDO NUMBER A - 2024000203 ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
FIRST FLOOR REFLECTED CEILING DEMOLITION PLAN	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:		Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number: 1
		Issue Date: 06 MARCH 2026 / Checked: TB / Drawn: PS	Drawing Number: AD101

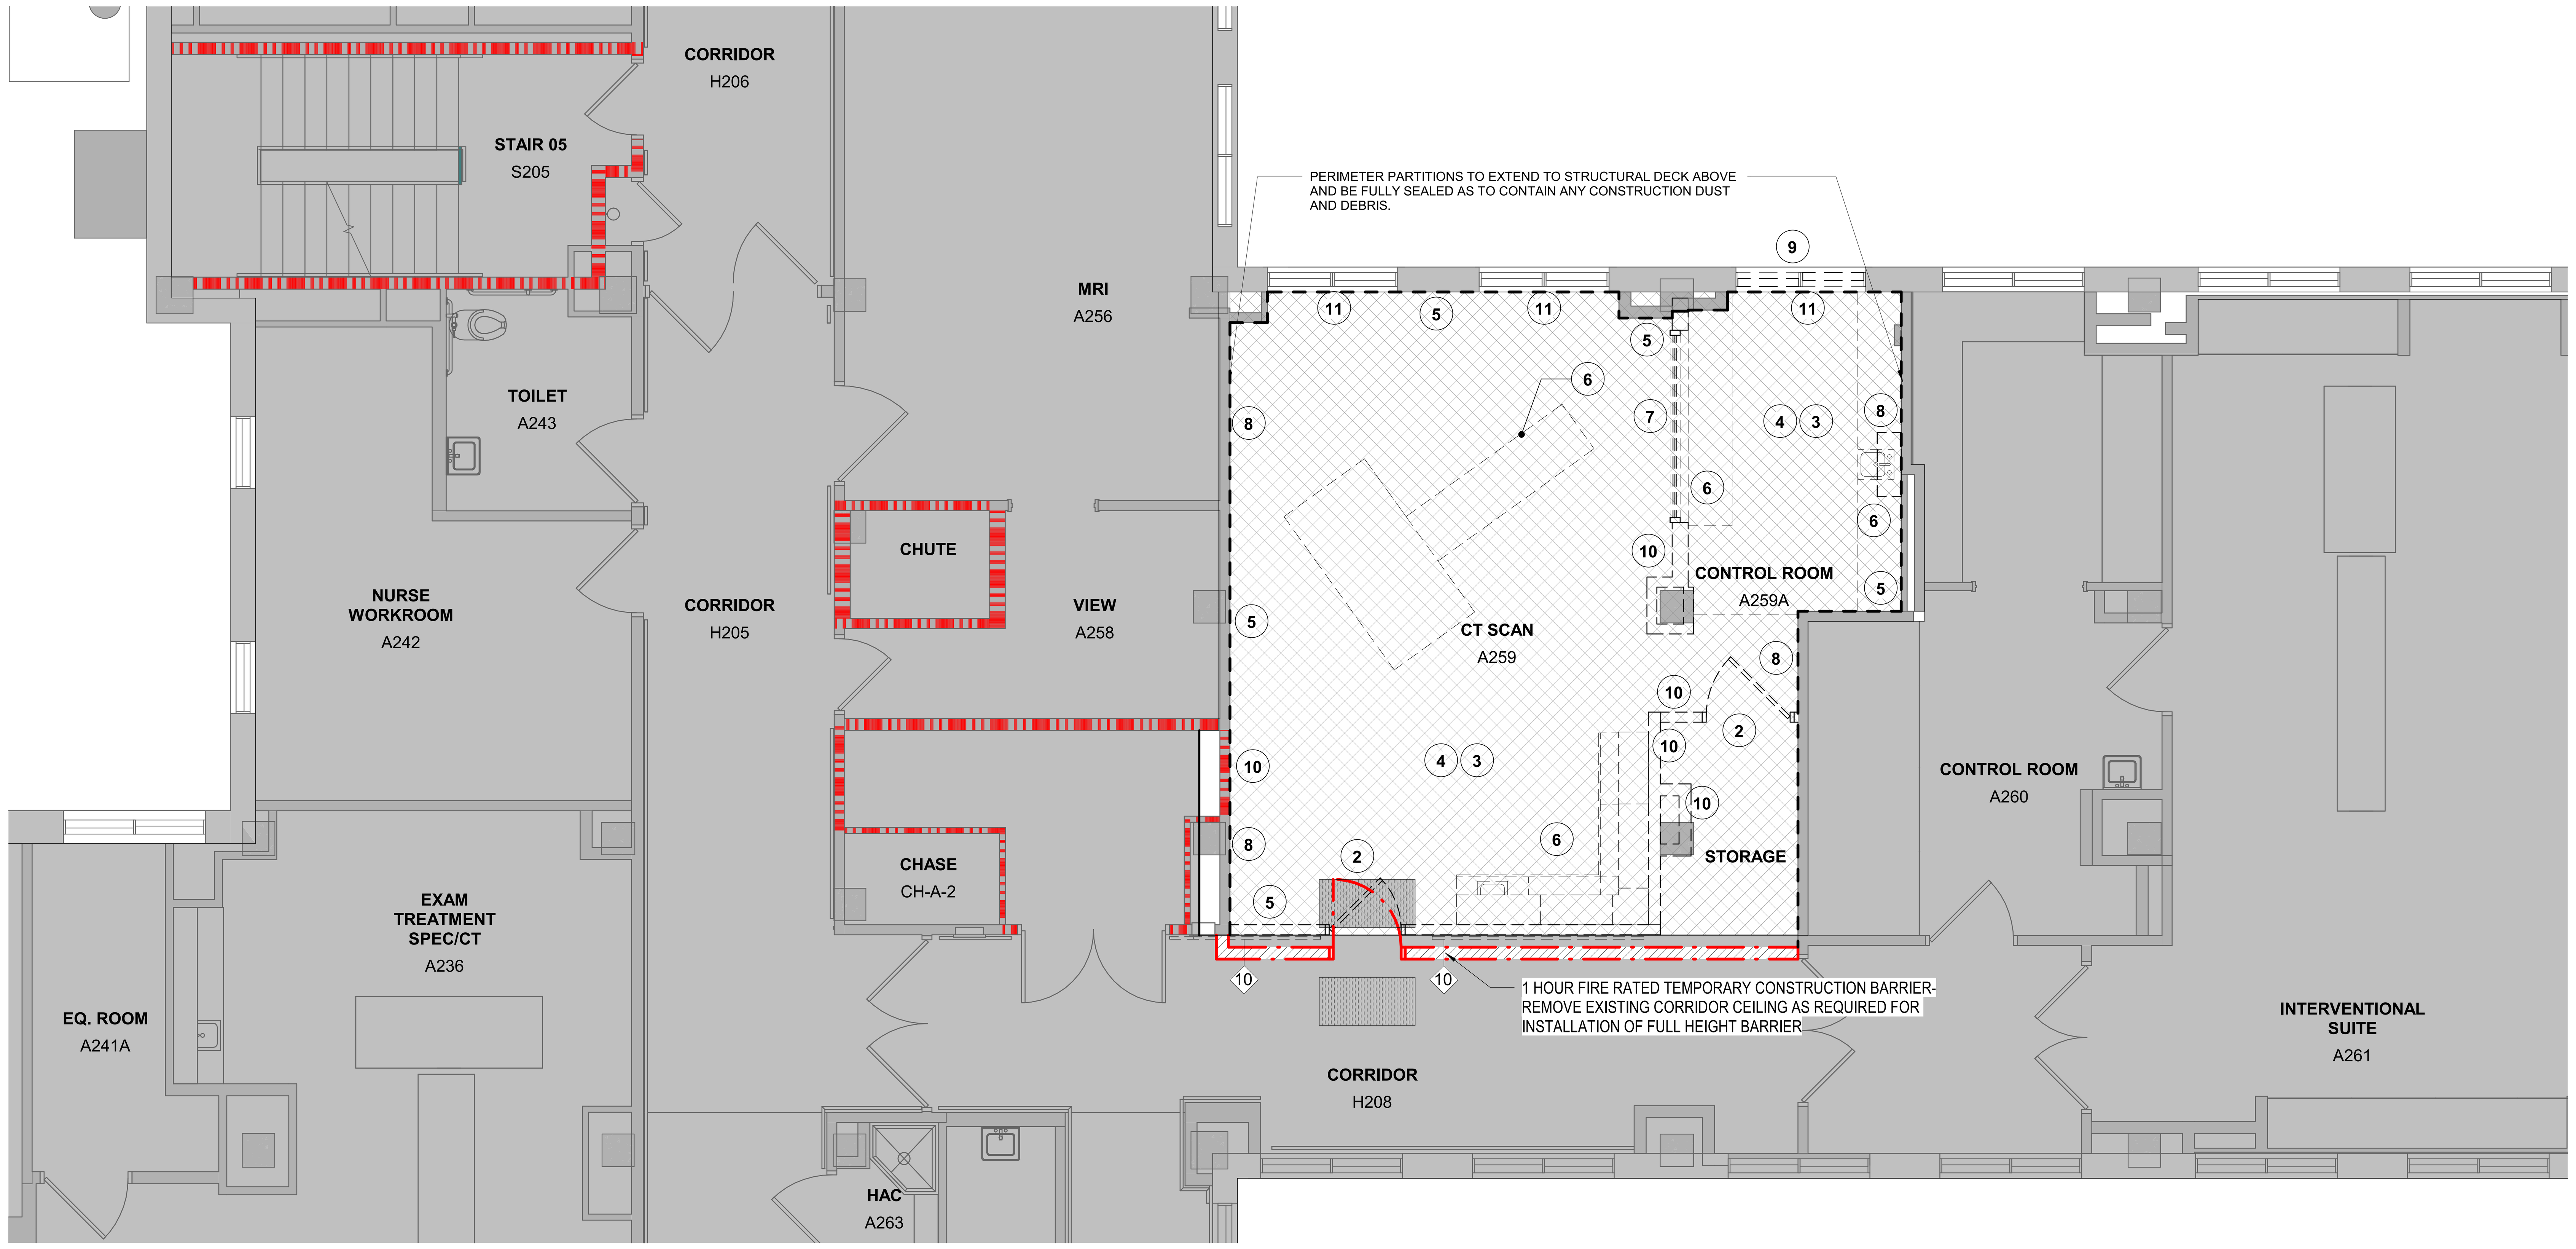

1 SECOND FLOOR DEMOLITION PLAN

1/4" = 1'-0"

DEMOLITION NOTES

(APPLY TO THIS SHEET ONLY)

2 REMOVE EXISTING DOOR AND FRAME IN THEIR ENTIRETY.

3 REMOVE ALL CEILING AND EQUIPMENT. THIS INCLUDES BUT IS NOT LIMITED TO SUSPENDED CEILING PANELS, GRID, HANGERS, GYP BOARD CEILINGS, LIGHTING, MECHANICAL GRILL/REGISTERS, SPRINKLERS, SPEAKERS AND OTHER CEILING COMPONENTS IN THEIR ENTIRETY.

4 REMOVE EXISTING FLOOR TILE AND MASTIC. PREP SLAB TO RECEIVE NEW FINISH.

5 FOR EXISTING PARTITIONS REMAINING IN PLACE: REMOVE EXISTING WALL COVERING, HANDRAILS, CORNER GUARDS, AND WAINSCOT IN THEIR ENTIRETY. PATCH, REPAIR AND PREP TO RECEIVE NEW FINISH.

6 REMOVE ALL CASEWORK, PLUMBING, FURNITURE AND EQUIPMENT IN ITS ENTIRETY.

7 REMOVE EXISTING WINDOW AND FRAME IN THEIR ENTIRETY.

8 REMOVE FINISH FACE OF EXISTING WALL BACK TO EXISTING LEAD LINING (STUD WALL FRAMING TO REMAIN). VERIFY IF EXISTING LINING MEETS NEW REQUIREMENTS OF CT EQUIPMENT AND REPLACE AS REQUIRED.

9 REMOVE WINDOW AS REQUIRED FOR INSTALLATION OF NEW DUCTWORK AND PIPING FROM EQUIPMENT YARD BELOW

10 REMOVE EXISTING INTERIOR PARTITIONS IN THEIR ENTIRETY TO EXTENT SHOWN.

11 REMOVE EXISTING STEAM RADIATORS. REFER TO MEP DRAWINGS.

DEMOLITION LEGEND:

- EXISTING WALL TO REMAIN
- EXISTING DOOR TO REMAIN
- TEMPORARY 1 HR BARRIER
- DEMOLITION SCOPE
- EXISTING 2 HR FIRE RATED FIRE BARRIER
- NOT IN SCOPE
- EXTENT OF FLOOR SLAB TO BE REMOVED. COORDINATE DIMENSIONS AND LOCATIONS WITH STRUCTURAL AND UTILITIES
- TEMPORARY CONSTRUCTION STICKY MAT
- 10 DEMOLITION NOTE

GENERAL DEMOLITION NOTES:

A. THE CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS IN THE FIELD AND COORDINATE ALL REMOVAL ACTIVITIES WITH NEW CONSTRUCTION. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES TO THE OWNER'S REPRESENTATIVE FOR RESOLUTION PRIOR TO BEGINNING REMOVALS.

B. PROTECT ALL CONSTRUCTION TO REMAIN FROM DAMAGE DURING REMOVAL OF ADJACENT CONSTRUCTION. REPAIR/REPLACE CONSTRUCTION TO REMAIN THAT WAS DAMAGED DURING DEMOLITION TO MATCH THE QUALITY OF THE NEW WORK. PROVIDE DUST CONTROL AND CONTAINMENT MATS, FLOOR AND WALL PROTECTION.

C. THE ARCHITECTURAL DRAWINGS SHOW PRINCIPAL AREAS WHERE WORK MUST BE ACCOMPLISHED UNDER THIS CONTRACT. INCIDENTAL WORK MAY ALSO BE NECESSARY IN AREAS NOT SHOWN ON THE ARCHITECTURAL DRAWINGS DUE TO CHANGES AFFECTING EXISTING ELECTRICAL, OR OTHER SYSTEMS. SUCH INCIDENTAL WORK IS ALSO A PART OF THE CONTRACT. CONTRACTOR SHALL INSPECT THOSE AREAS AND ASCERTAIN WORK NEEDED AND DO THAT WORK IN ACCORDANCE WITH THE CONTRACT REQUIREMENTS AND AT NO ADDITIONAL COST TO THE OWNER.

D. DO NOT DRILL OR CUT EXISTING FLOOR JOISTS, BEAMS, COLUMNS OR OTHER STRUCTURAL ELEMENTS UNLESS SPECIFICALLY NOTED. MAKE OPENINGS OF PROPER SIZE FOR CONDUITS AND PIPING AND OTHER ITEMS PASSING THROUGH OPENINGS.

E. GC TO SCAN THE SLAB AT EA LOCATION OF PROPOSED FLOOR/SLAB PENETRATION PRIOR TO CUTTING TO ENSURE THAT AREA IS CLEAR OF EMBEDDED CONDUITS AND/OR LIVE CONDUCTORS.

F. REPAIR, PATCH AND FINISH, OR REFINISH AS APPLICABLE, TO MATCH ADJACENT EXISTING FINISHES DAMAGED OR NEWLY EXPOSED DURING THE PERFORMANCE OF THE WORK OF THIS CONTRACT.

G. WHERE CUTTING OF EXISTING SURFACES OR REMOVAL OF EXISTING FINISHES IS REQUIRED TO PERFORM THE WORK UNDER THIS CONTRACT, AND A NEW FINISH IS NOT INDICATED, FILL RESULTING OPENINGS AND PATCH THE SURFACE AFTER DOING THE WORK, AND FINISH TO MATCH ADJACENT EXISTING SURFACES.

H. WHERE A NEW CEILING IS NOT SCHEDULED, INSTALL CONDUITS AND PIPING IN EVERY CASE ABOVE THE CEILING. REMOVE EXISTING CEILING AS NECESSARY. AFTER INSTALLATION OF CONCEALED WORK, REINSTALL REMOVED CEILING AND PATCH AND REFINISH TO MATCH ADJACENT UN-REMOVED CEILINGS.

I. WORK SHOWN IS NEW UNLESS SPECIFICALLY NOTED OR OTHERWISE INDICATED AS EXISTING.

J. PROVIDE HEADERS/LINTELS OVER EVERY OPENING IN BOTH NEW AND EXISTING WALLS AND PARTITIONS.

K. WHERE "MATCH EXISTING" IS INDICATED, NEW CONSTRUCTION OR FINISHES, AS APPROPRIATE TO THE NOTE, SHALL MATCH THE EXISTING IN THE PARTICULAR.

L. DEFINITIONS
M1. REMOVE: REMOVE AND LEGALLY DISPOSE OF ITEMS EXCEPT THOSE INDICATED TO BE REINSTALLED, SALVAGED, OR EXISTING.
M2. SALVAGE: ITEMS INDICATED TO BE SALVAGED SHALL REMAIN THE OWNER'S PROPERTY. REMOVE, CLEAN AND PACK OR CRATE ITEMS TO PROTECT AGAINST DAMAGE. IDENTIFY CONTENTS OF CONTAINERS AND DELIVER TO OWNER'S DESIGNATED STORAGE AREA.
M3. REINSTALL: REMOVE ITEMS INDICATED. CLEAN SERVICE AND OTHERWISE PREPARE THEM FOR REUSE. STORE AND PROTECT AGAINST DAMAGE. REINSTALL ITEMS IN THE SAME LOCATIONS OR IN LOCATIONS INDICATED.
M4. EXISTING: ORIGINAL ITEM TO REMAIN. PROTECT CONSTRUCTION INDICATED AS EXISTING AGAINST DAMAGE AND SOILING DURING SELECTIVE DEMOLITION.
M5. RESTORE: ITEMS INDICATED SHALL BE BROUGHT BACK TO THEIR ORIGINAL CONDITION. ORIGINAL CONDITION IS THE CONDITION THAT THE REFERENCED ITEM WAS IN WHEN THE BUILDING WAS FIRST CONSTRUCTED.
M6. REPLACE: EXISTING ITEM TO BE REMOVED. PROVIDE NEW ITEM TO MATCH EXISTING.

M. CONTRACTOR TO ABIDE BY ALL THE ICRA INFECTION CONTROL REGULATIONS.

N. CONTRACTOR SHALL KEEP THE SITE CLEAN AT ALL TIMES AND COORDINATE TRASH REMOVAL WITH THE VA.

O. TEMPORARY CONTINUOUS CONSTRUCTION BARRIER MUST BE IN PLACE PRIOR TO ANY DEMOLITION. GC TO DETERMINE LOCATION FOR TEMPORARY CONSTRUCTION BARRIER DOOR ACCESS. CONSTRUCTION BARRIER DOOR(S) MUST BE SELF-CLOSING. PROVIDE STICKY MATS ON ALL ACCESS DOORS INTO CONSTRUCTION AREA. ANTE-ROOM REQUIRED AT CONSTRUCTION ENTRY. PAINT PUBLIC FACE OF TEMP BARRIER WHITE.

P. PROVIDE NANOMETER PRESSURE MONITORS FOR ALL CONSTRUCTION BARRIERS.

Q. PROVIDE NEGATIVE PRESSURE AIR HEPA UNITS AND EXHAUST TO EXTERIOR OF THE BUILDING.

R. CONTRACTOR TO REVIEW & FOLLOW ALL ABATEMENT REQUIREMENTS PRIOR TO THE START OF GENERAL DEMOLITION.

S. GC TO COORDINATE WITH VA WHEN MAJOR SHUTDOWNS ARE TO OCCUR. SHUTDOWNS WILL NEED TO OCCUR AFTER REGULAR BUSINESS HOURS, OVERNIGHT AND WEEKENDS AS NEEDED TO MINIMIZE IMPACT TO PATIENTS AND STAFF.


CORRIDOR H208


CASEWORK A259

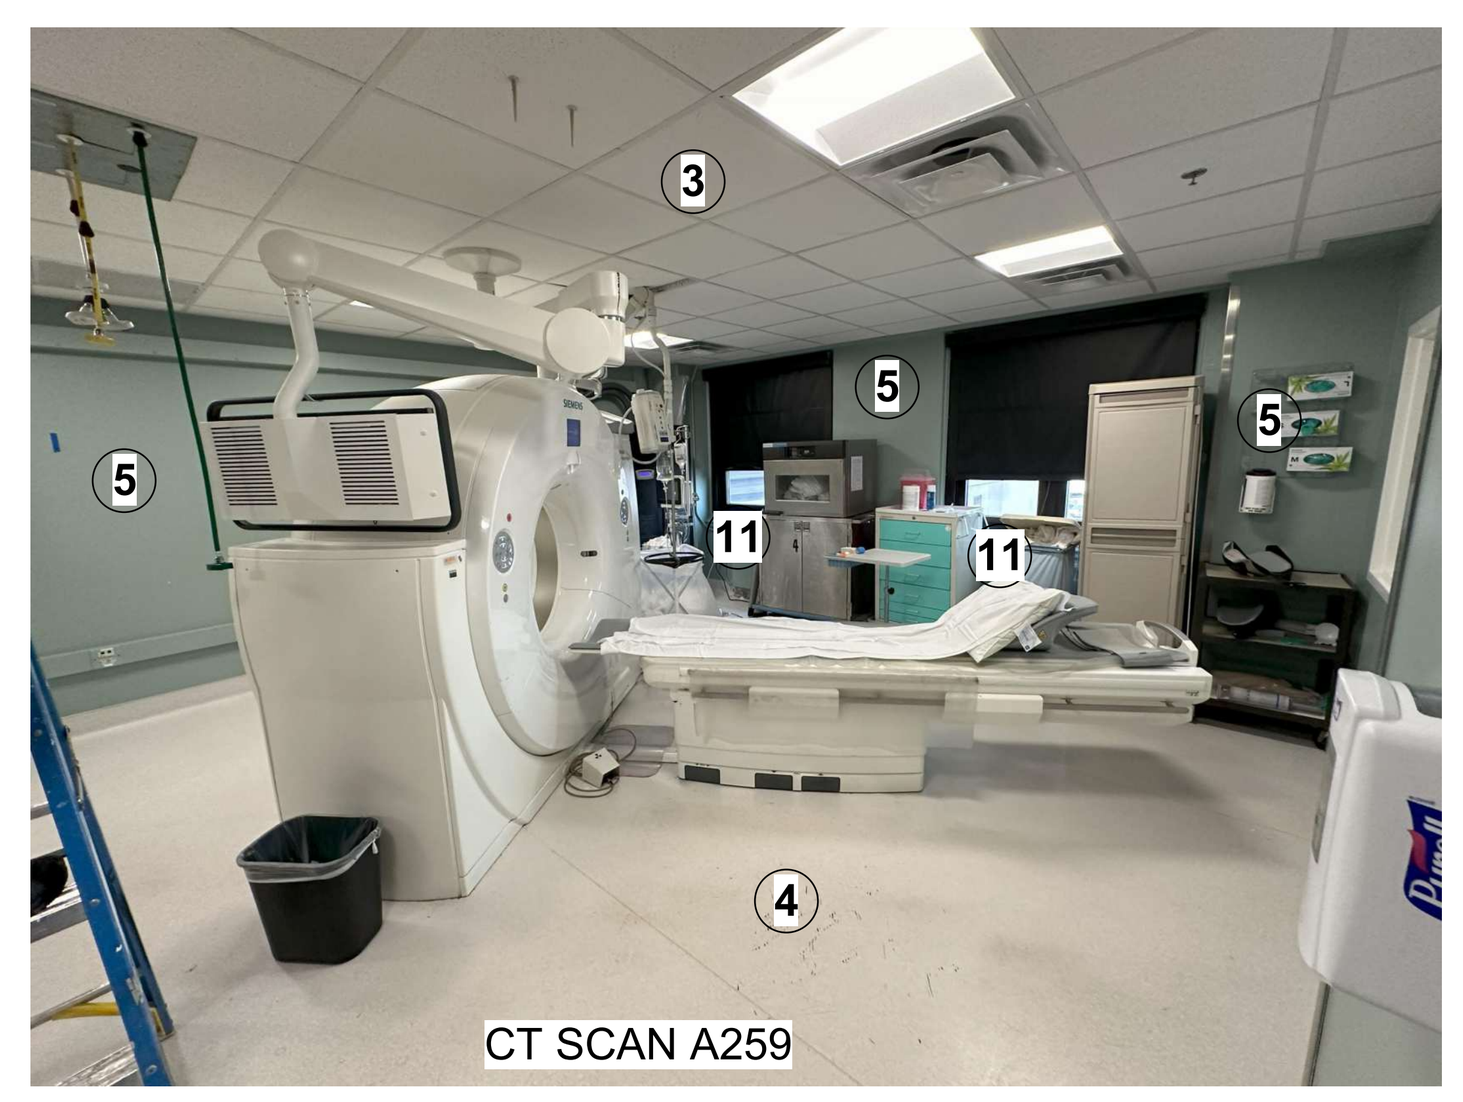
CT SCAN A259


EXISTING CT SCAN A259 DOOR

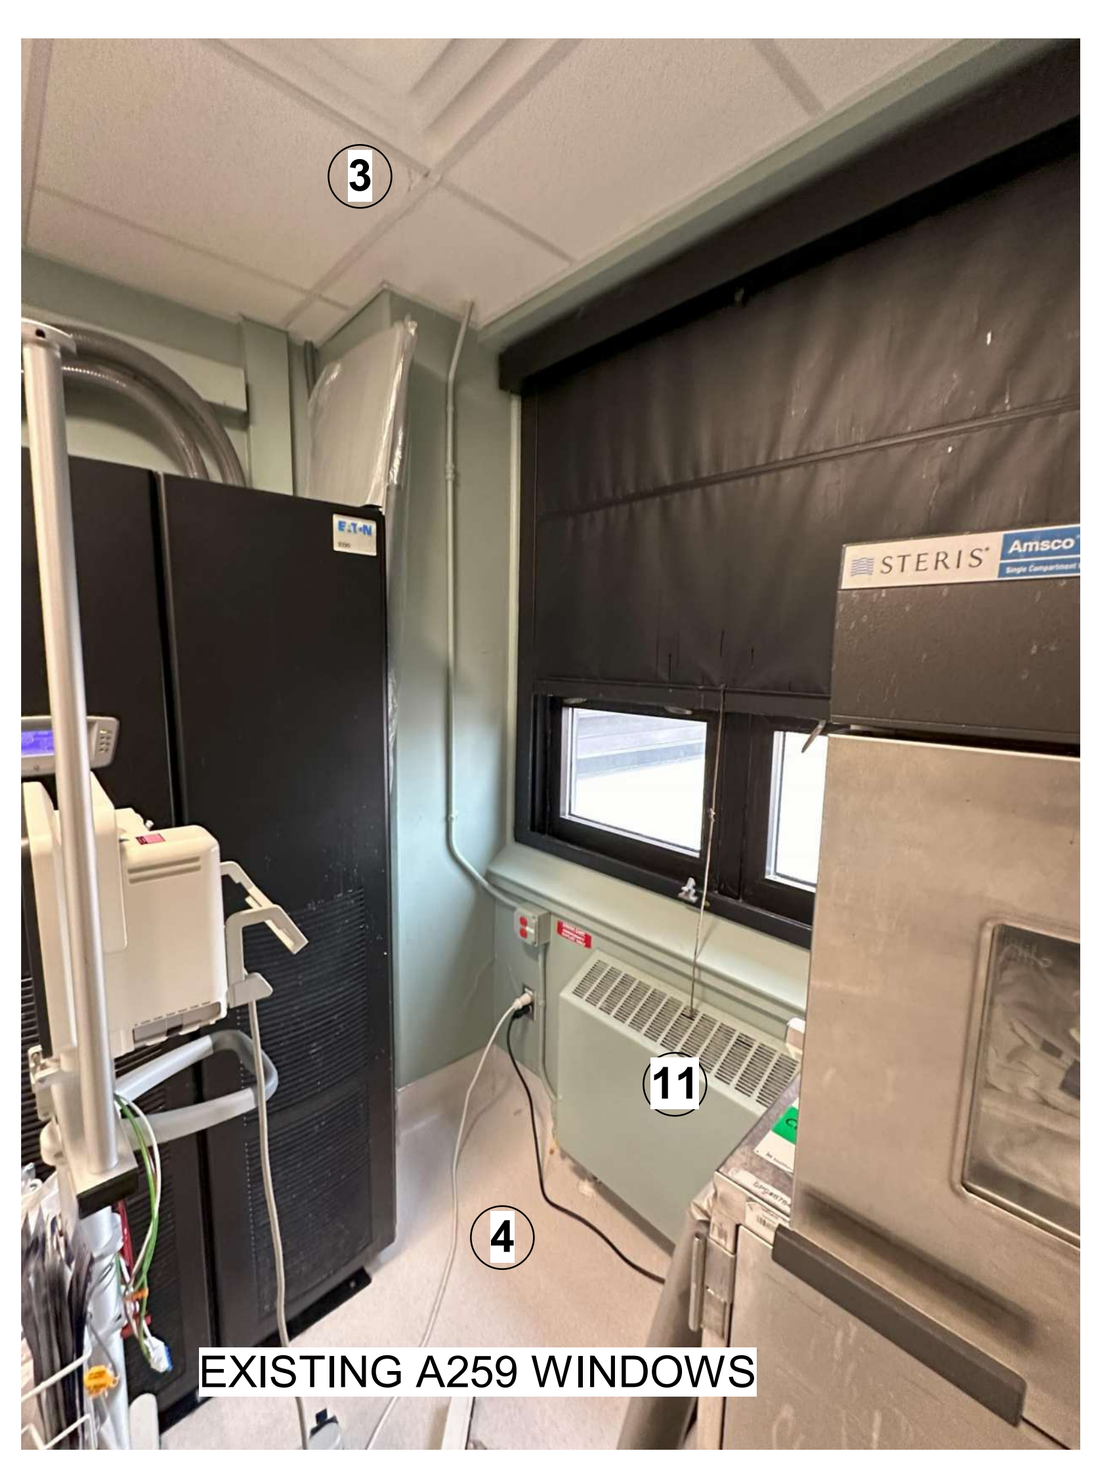
EXISTING A259 WINDOWS


EXISTING A259A CONTROL ROOM

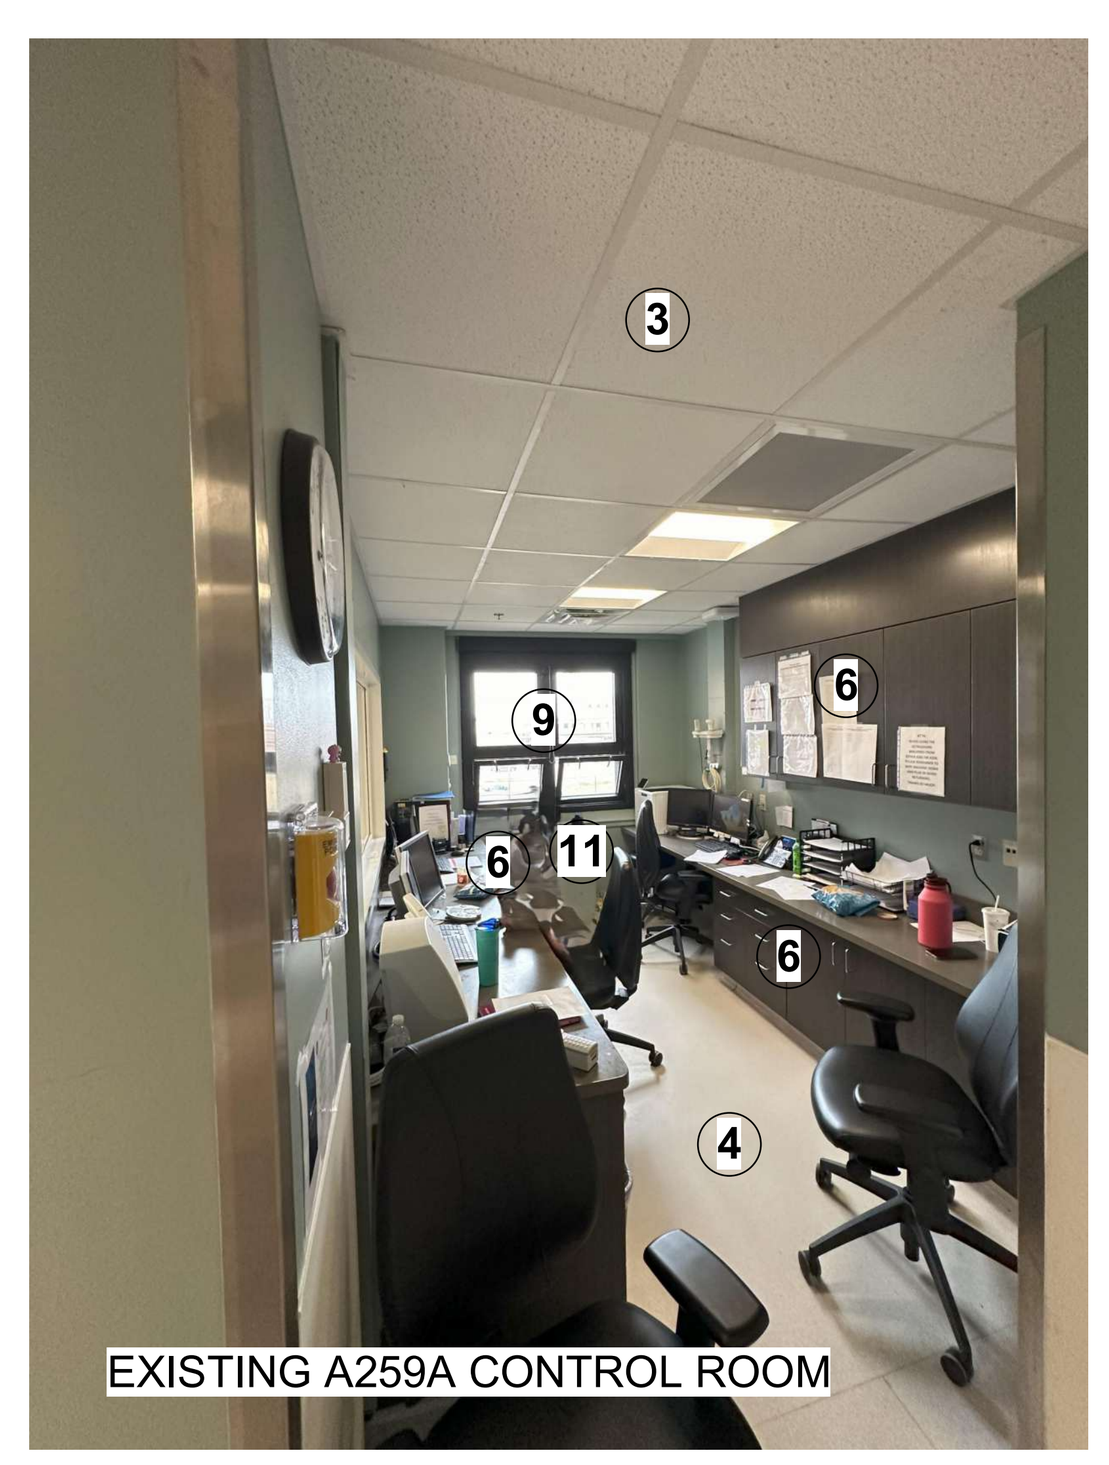
EXISTING A259A CONTROL ROOM

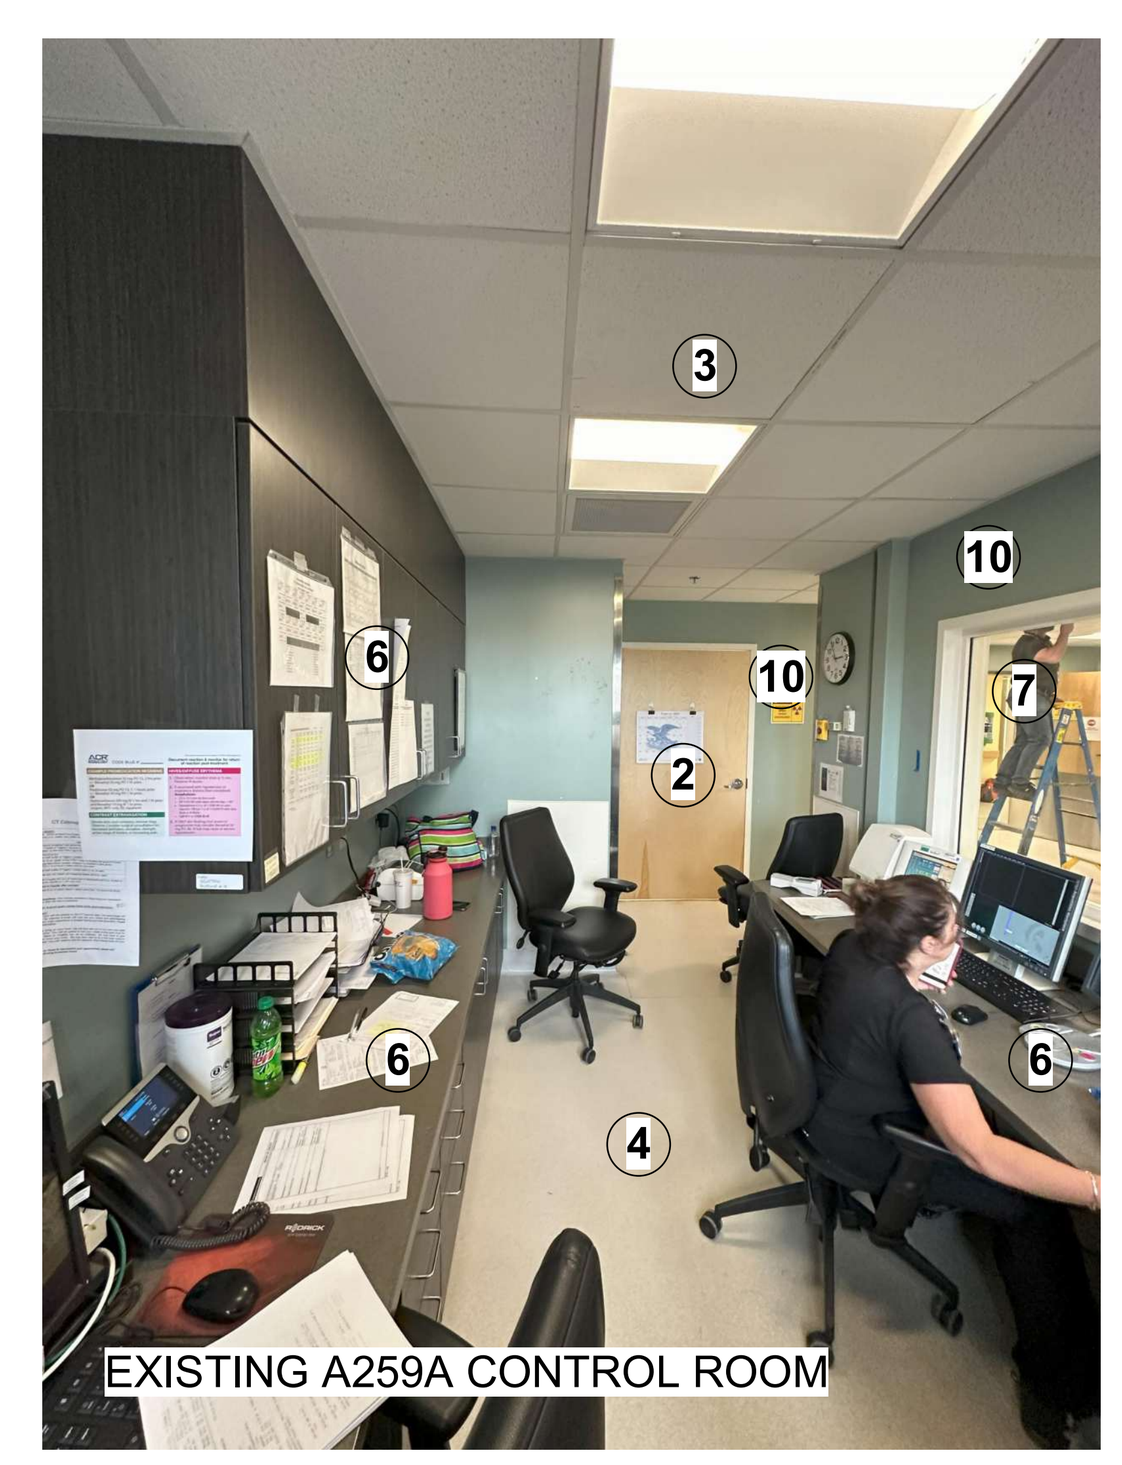
EXISTING A259A CONTROL ROOM

2 EXISTING PICTURES

NOT TO SCALE

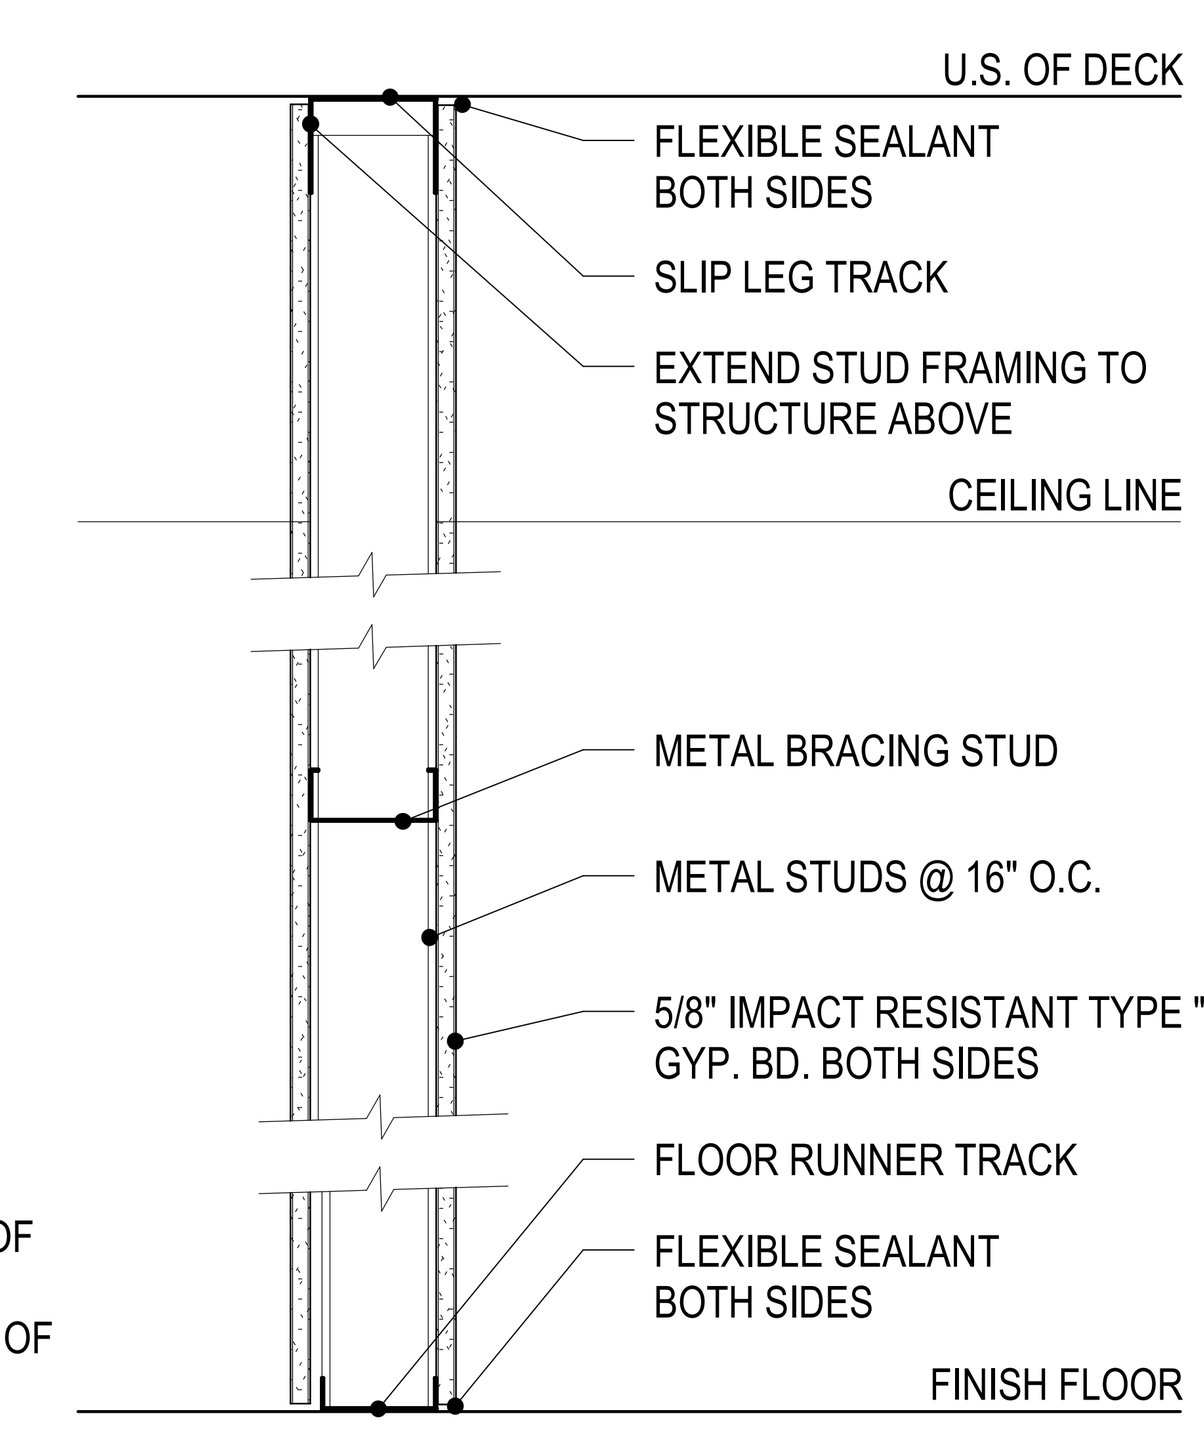

10 UL U419 1HR TEMPORARY BARRIER
GYP. BD. ON METAL STUDS

1 LAYER 5/8" TYPE "X" IMPACT RESISTANT GYP. BD. ON EACH SIDE OF 4" (U.N.O.) METAL STUDS @16" O.C. PARTITION EXTENDS TO UNDERSIDE OF DECK ABOVE.

KEY PLAN

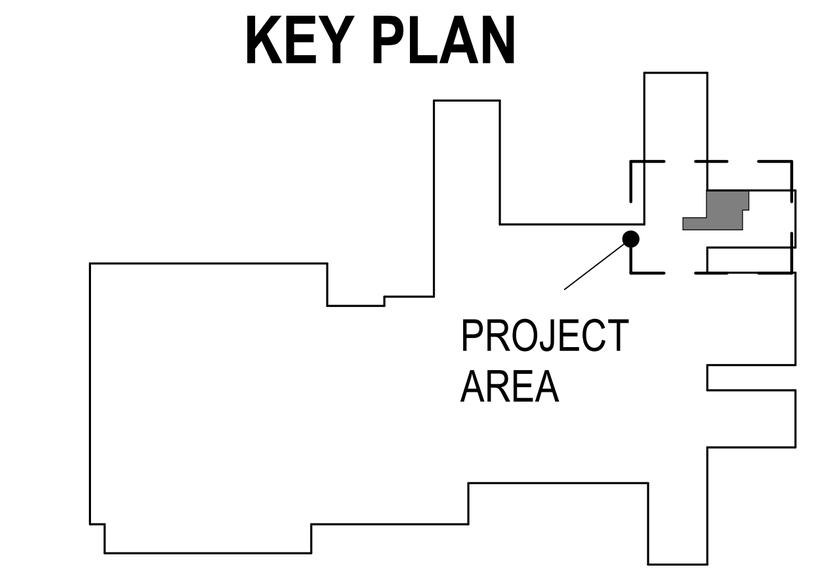

N

PROJECT NORTH

TRUE NORTH

Revisions:	Date:

CONSULTANT

Above Group
ENGINEERING DESIGN CONSULTING

Mabbett
Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD

THINKFORM

THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP

STATE OF MISSOURI
RUSSELL DINARDO
NUMBER A - 2024000203
ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
SECOND FLOOR DEMOLITION PLAN	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:		Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number: 1
		Issue Date: 06 MARCH 2026 / Checked: TB / Drawn: PS	Drawing Number: AD102

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/657-23-104JC_657-JC-01-02_ARCH.rvt

3/3/2026 2:40:16 PM

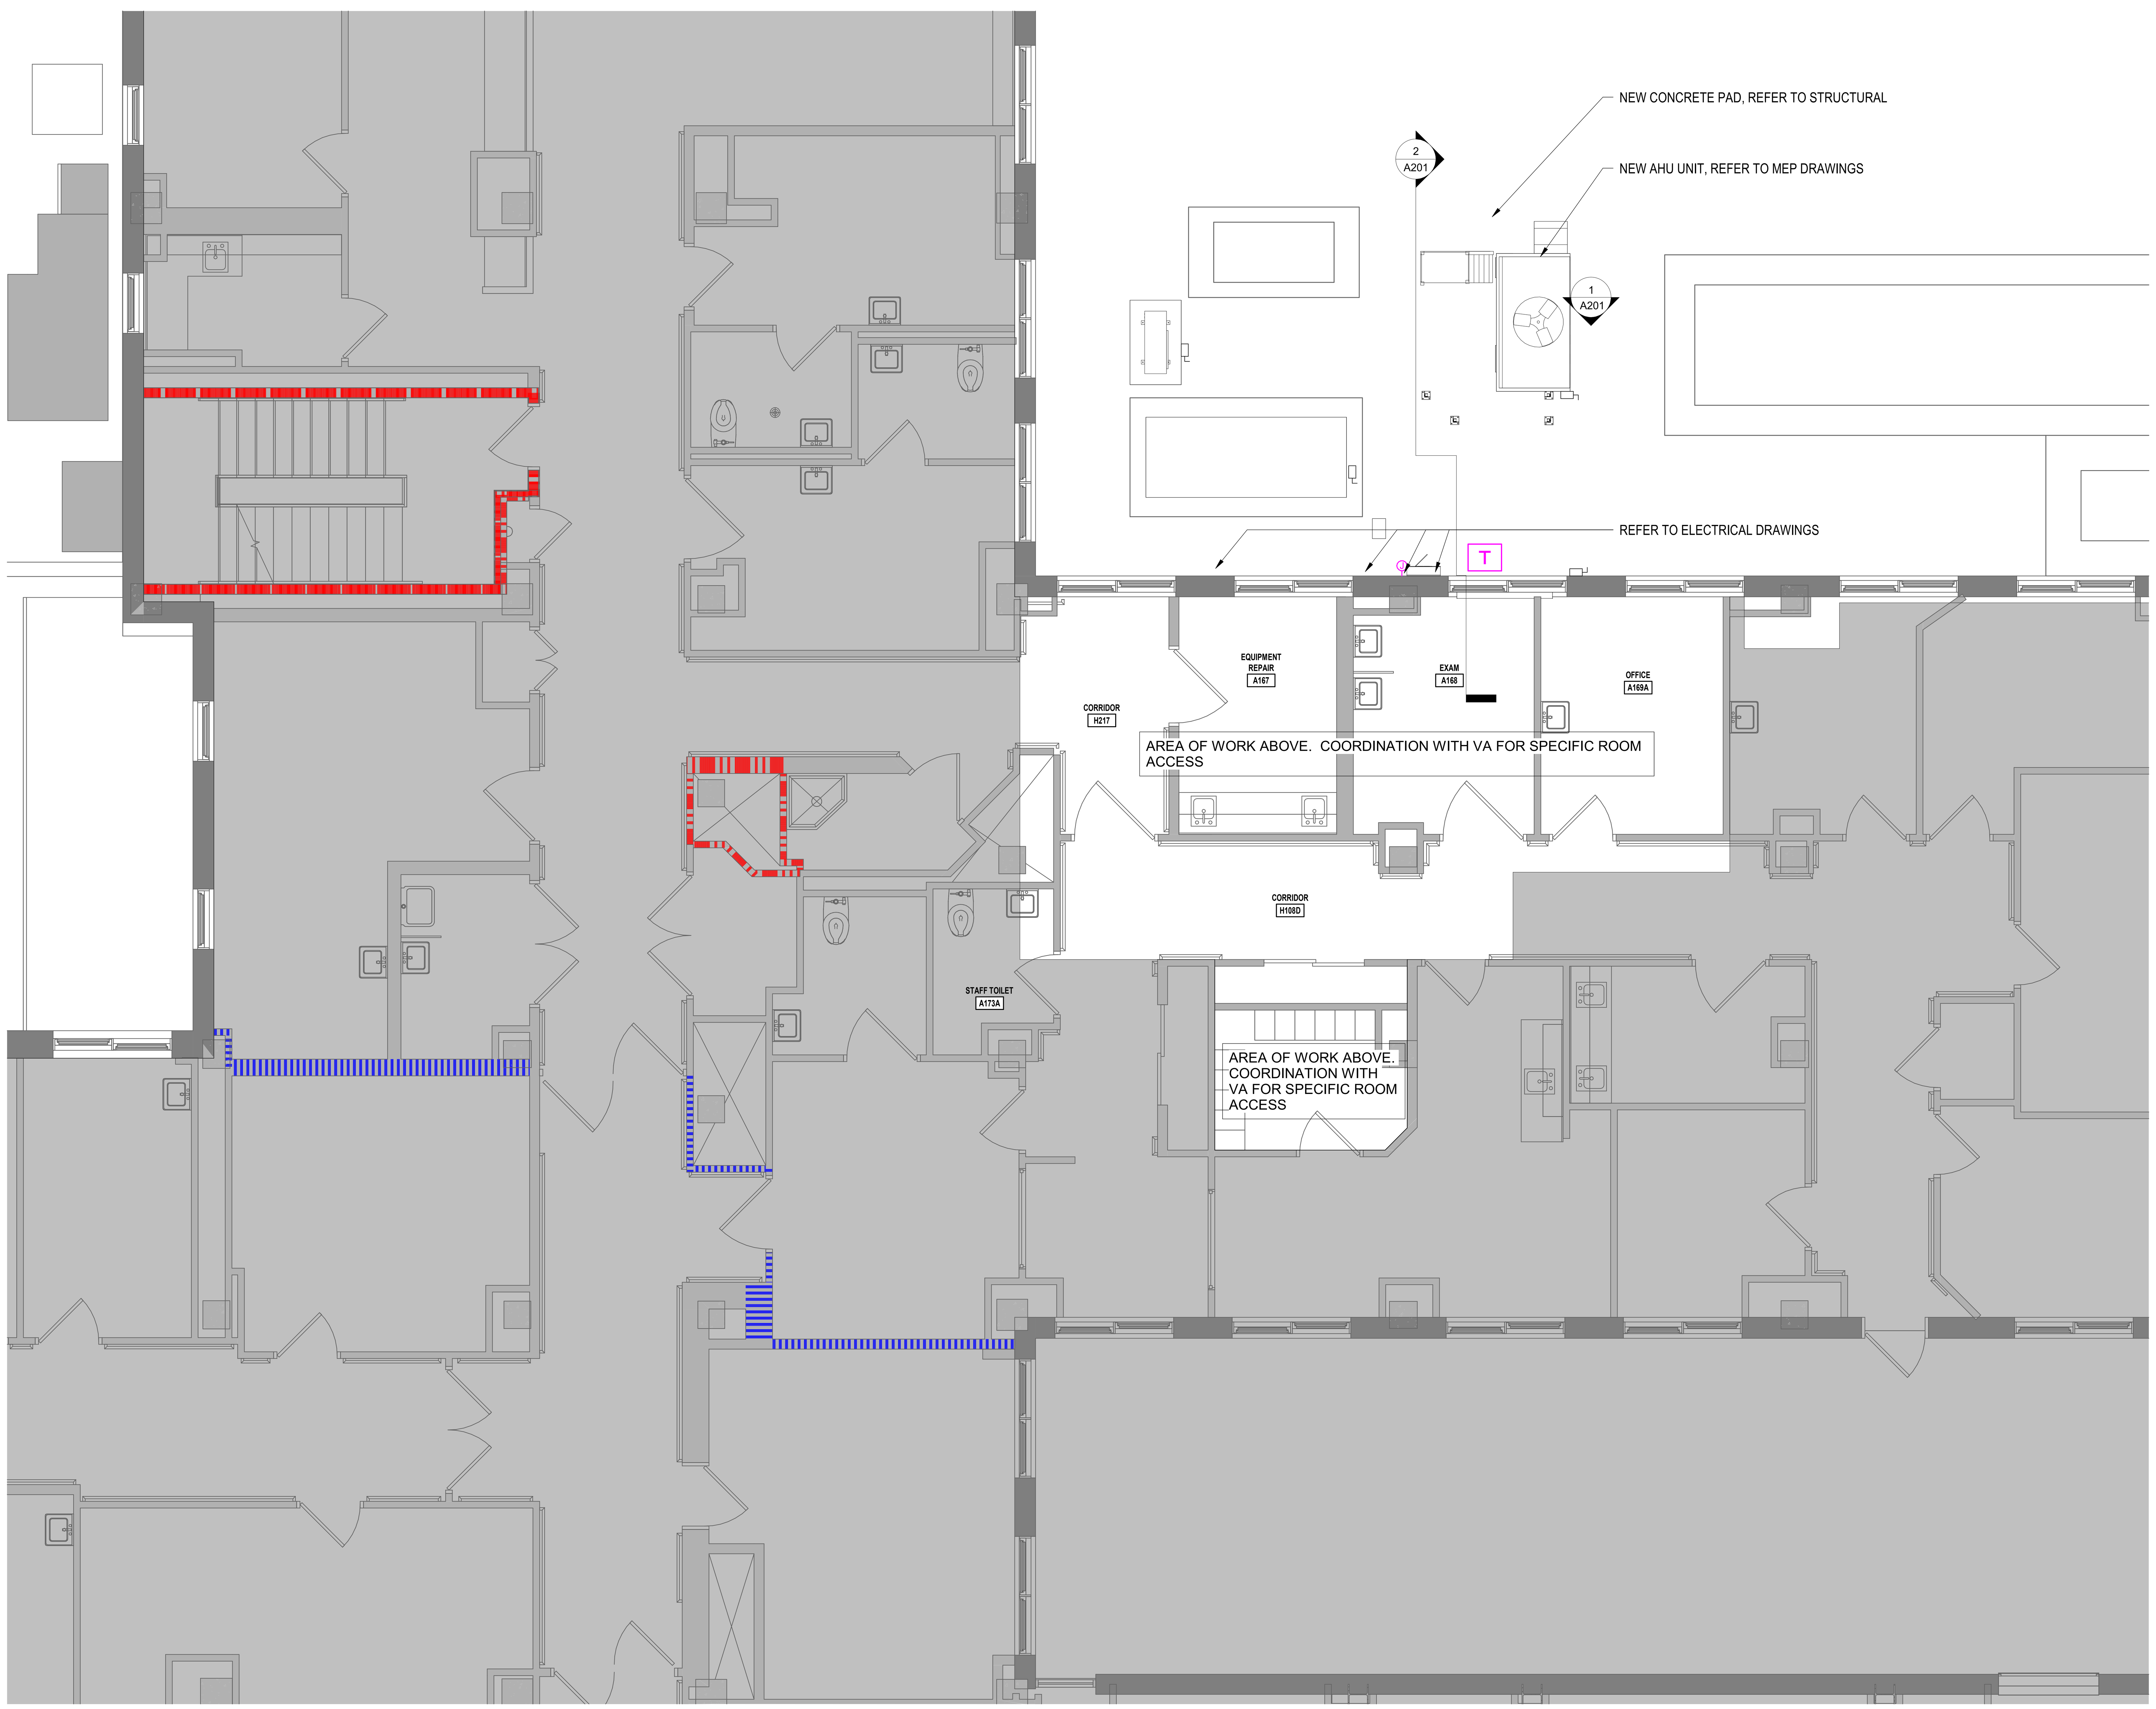

1 **FIRST FLOOR PLAN**
1/4" = 1'-0"

GENERAL FLOOR PLAN NOTES:

A. DIMENSIONS TO FACE OF NEW STUD UNLESS NOTED OTHERWISE. EXISTING WALLS ARE DIMENSION TO FACE OF EXISTING FINISH WALL. FIELD VERIFY ALL DIMENSIONS TO EXISTING WALLS.
B. ALL INTERIOR DOORS ARE LOCATED WITH INTERIOR OF JAMB AT HINGE SIDE 4 INCHES FROM ADJACENT WALL, UNLESS NOTED OTHERWISE. FIELD VERIFY FOR EXISTING WALLS
C. DOORS REFERENCED BY A DOOR NUMBER INDICATE A NEW DOOR OR SOME MODIFICATION TO AN EXISTING DOOR. SEE DOOR SCHEDULE. DOORS WITHOUT DOOR NUMBER REFERENCES ARE EXISTING DOORS TO REMAIN, WITH NO WORK OR MODIFICATION REQUIRED.
D. ALL CORRIDORS TO RECEIVE ABUSE-RESISTANT GYPSUM BOARD TO **6" ABOVE CEILING LINE**, U.N.O.
E. FOR MARKERBOARDS AND TACKBOARDS INDICATED BY SYMBOL, SEE **A605-606**. EXACT LOCATION TO BE DETERMINED IN THE FIELD WITH OWNER.
F. PROVIDE CODE COMPLIANT FIRE TREATED WOOD BLOCKING OR SHEET METAL PLATES IN HOLLOW WALL SYSTEMS FOR ATTACHMENT OF ANY WALL MOUNTED ACCESSORIES INCLUDING, BUT NOT LIMITED TO, SHELVING, CASEWORK, LIGHT FIXTURES, AUDIO VISUAL EQUIPMENT, SECURITY CAMERAS, MARKER BOARDS, ETC.
G. WALL ACCESSORIES SUCH AS FIRE EXTINGUISHER CABINETS AND PAPER TOWEL DISPENSERS THAT REQUIRE A SEMI-RECESSED INSTALLATION SHALL NOT REDUCE THE FIRE RATING OF THE WALL. IF A DETAIL IS NOT PROVIDED WITHIN THE CONTRACT DOCUMENTS, THE CONTRACTOR SHALL CONSULT THE ARCHITECT FOR PROPER DETAILS PRIOR TO INSTALLING THE ACCESSORY.
H. PARTITION TYPES AT INFILL WALLS SHALL MATCH ADJOINING EXISTING WALLS PROVIDING FOR A FLUSH, SMOOTH TRANSITION IN THE FINISHED SURFACE. MATCH BASE IN AREAS WHERE BASE IS OTHERWISE INDICATED TO REMAIN, RUNNING FROM AN INTERIOR CORNER OR OTHER DEFINED EDGE.
I. PATCH AND REPAIR ALL GYPSUM BOARD SURFACES WHERE DEMOLITION OF ADJOINING OR INTERSECTING PARTITIONS HAS RESULTED IN LESS THAN A FINISHED CONDITION. PATCHES SHALL BE FLUSH AND SMOOTH.
J. EXISTING ROOMS THAT ARE NOT INDICATED TO BE AFFECTED BY THE WORK ARE TO BE PROTECTED FROM DAMAGE AND/OR PAINT DEGRADATION. SHOULD THE GENERAL CONTRACTOR AFFECT THE CONDITION OR FINISH OF THESE ROOMS, THE SURFACE OR SPACE SHALL BE RESTORED TO ORIGINAL CONDITION.
K. REFERENCE DRAWING **AD101 - AD111** FOR GENERAL DEMOLITION PLANS. WHERE NEW CONSTRUCTION ABUTS EXISTING CONSTRUCTION IN THE SAME PLANE, FINISHES SHALL BE FLUSH. VERIFY ALL DIMENSIONS TO EXISTING ELEMENTS.
L. NOTIFY THE ARCHITECT OF ANY AND ALL DISCREPANCIES BETWEEN EXISTING CONDITIONS AND THE CONTRACT DOCUMENTS BEFORE PROCEEDING WITH THAT PORTION OF THE WORK. FAILURE TO NOTIFY THE ARCHITECT WILL NOT RELIEVE THE CONTRACTOR OF THE RESPONSIBILITY TO PERFORM THE WORK AS INTENDED BY THE CONTRACT DOCUMENTS.
M. VERIFY EXISTING DIMENSIONS, CONDITIONS AND CLEARANCES PRIOR TO THE SUBMISSION OF SHOP DRAWINGS.
N. SEE SHEET **G004** FOR PARTITION TYPES.
O. PREP EXISTING SUBFLOOR TO RECEIVE SHEET LEAD DIRECTLY OVER EXISTING CONCRETE FLOOR THEN COAT FULLY CURED CONCRETE WITH A SEALANT. ENSURE THE LEAD IS FREE OF BUMPS, AIR POCKETS OR OBSTRUCTIONS AND LIES COMPLETELY FLAT - LEAD LINE FLOOR AT SHIELDING REQUIREMENTS, SEE STRUCTURAL DRAWINGS.
P. VA TO CONDUCT IN-HOUSE REVIEW TO VERIFY SHIELDING REQUIREMENTS FOR THE FLOOR, WALLS AND CEILINGS. GC TO PURCHASE AND INSTALL SHIELDING AS PER REQUIREMENTS LISTED IN VA REPORT. COORDINATE INSTALLATION REQUIREMENTS OF THE PURCHASED CT EQUIPMENT AS PER MANUFACTURER INSTRUCTIONS.

NEW CONSTRUCTION LEGEND:

- EXISTING 2 HR FIRE RATED FIRE BARRIER
- EXISTING SMOKE BARRIER
- EXISTING CONSTRUCTION TO REMAIN
- NEW PARTITION
- NEW DOOR LEAF
- NEW WINDOW
- EQ ℄ EQ — DIMENSIONS CENTERLINE
- E — FIRE EXTINGUISHER
- FEC — FIRE EXTINGUISHER CABINET AND EXTINGUISHER
- 4 — NEW CONSTRUCTION NOTE
- B1 — INDICATES INTERIOR PARTITION TYPE (SEE **G004** FOR PARTITION LEGEND). INTERIOR PARTITIONS ARE TYPE **3A** UNLESS NOTED OTHERWISE. WHERE ENLARGED PLANS OR DETAILS ARE PROVIDED, SEE THOSE DRAWINGS FOR PARTITION TYPES.
- 00 — EQUIPMENT - SEE EQUIPMENT SCHEDULE
- X — DOOR TAG - SEE DOOR & WINDOW SCHEDULE
- # — WINDOW TAG - SEE DOOR & WINDOW SCHEDULE

KEY PLAN

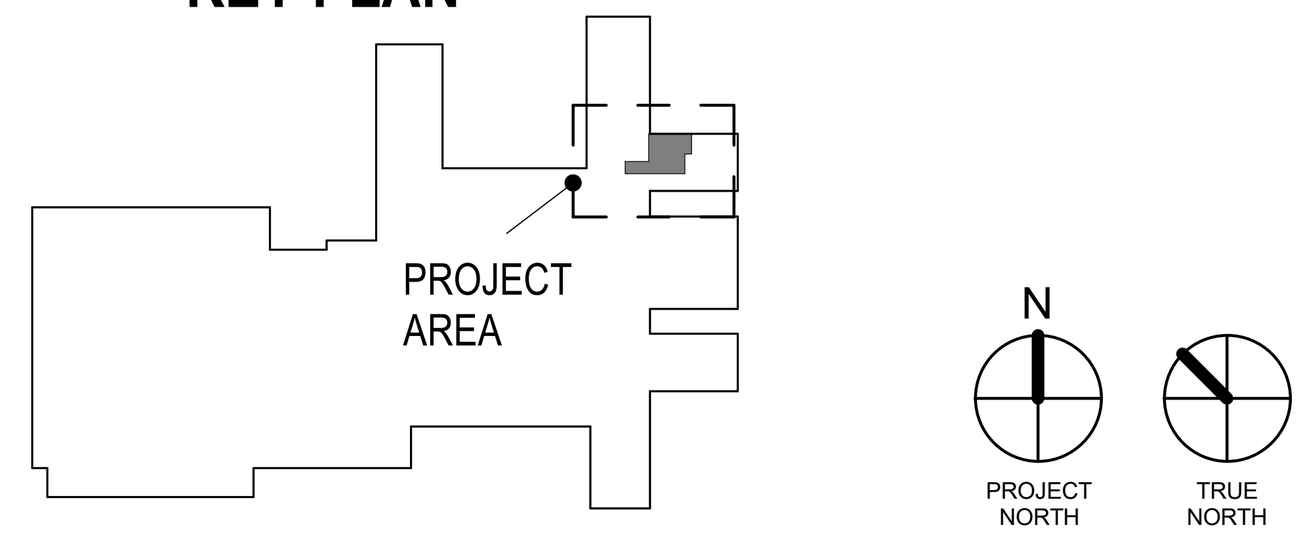

Revisions:	Date:

CONSULTANT

Above Group — ENGINEERING DESIGN CONSULTING

Mabbett — Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD

THINKFORM

THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP

STATE OF MISSOURI — RUSSELL DINARDO — NUMBER A - 2024000203 — ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)

VA U.S. Department of Veterans Affairs

Drawing Title	FIRST FLOOR PLAN
Approved:	
Phase	100% CONTRACT DOCUMENTS FOR BIDDING
Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	TB
Drawn	PS
Project Number	657-23-104JC
Building Number	1
Drawing Number	A101

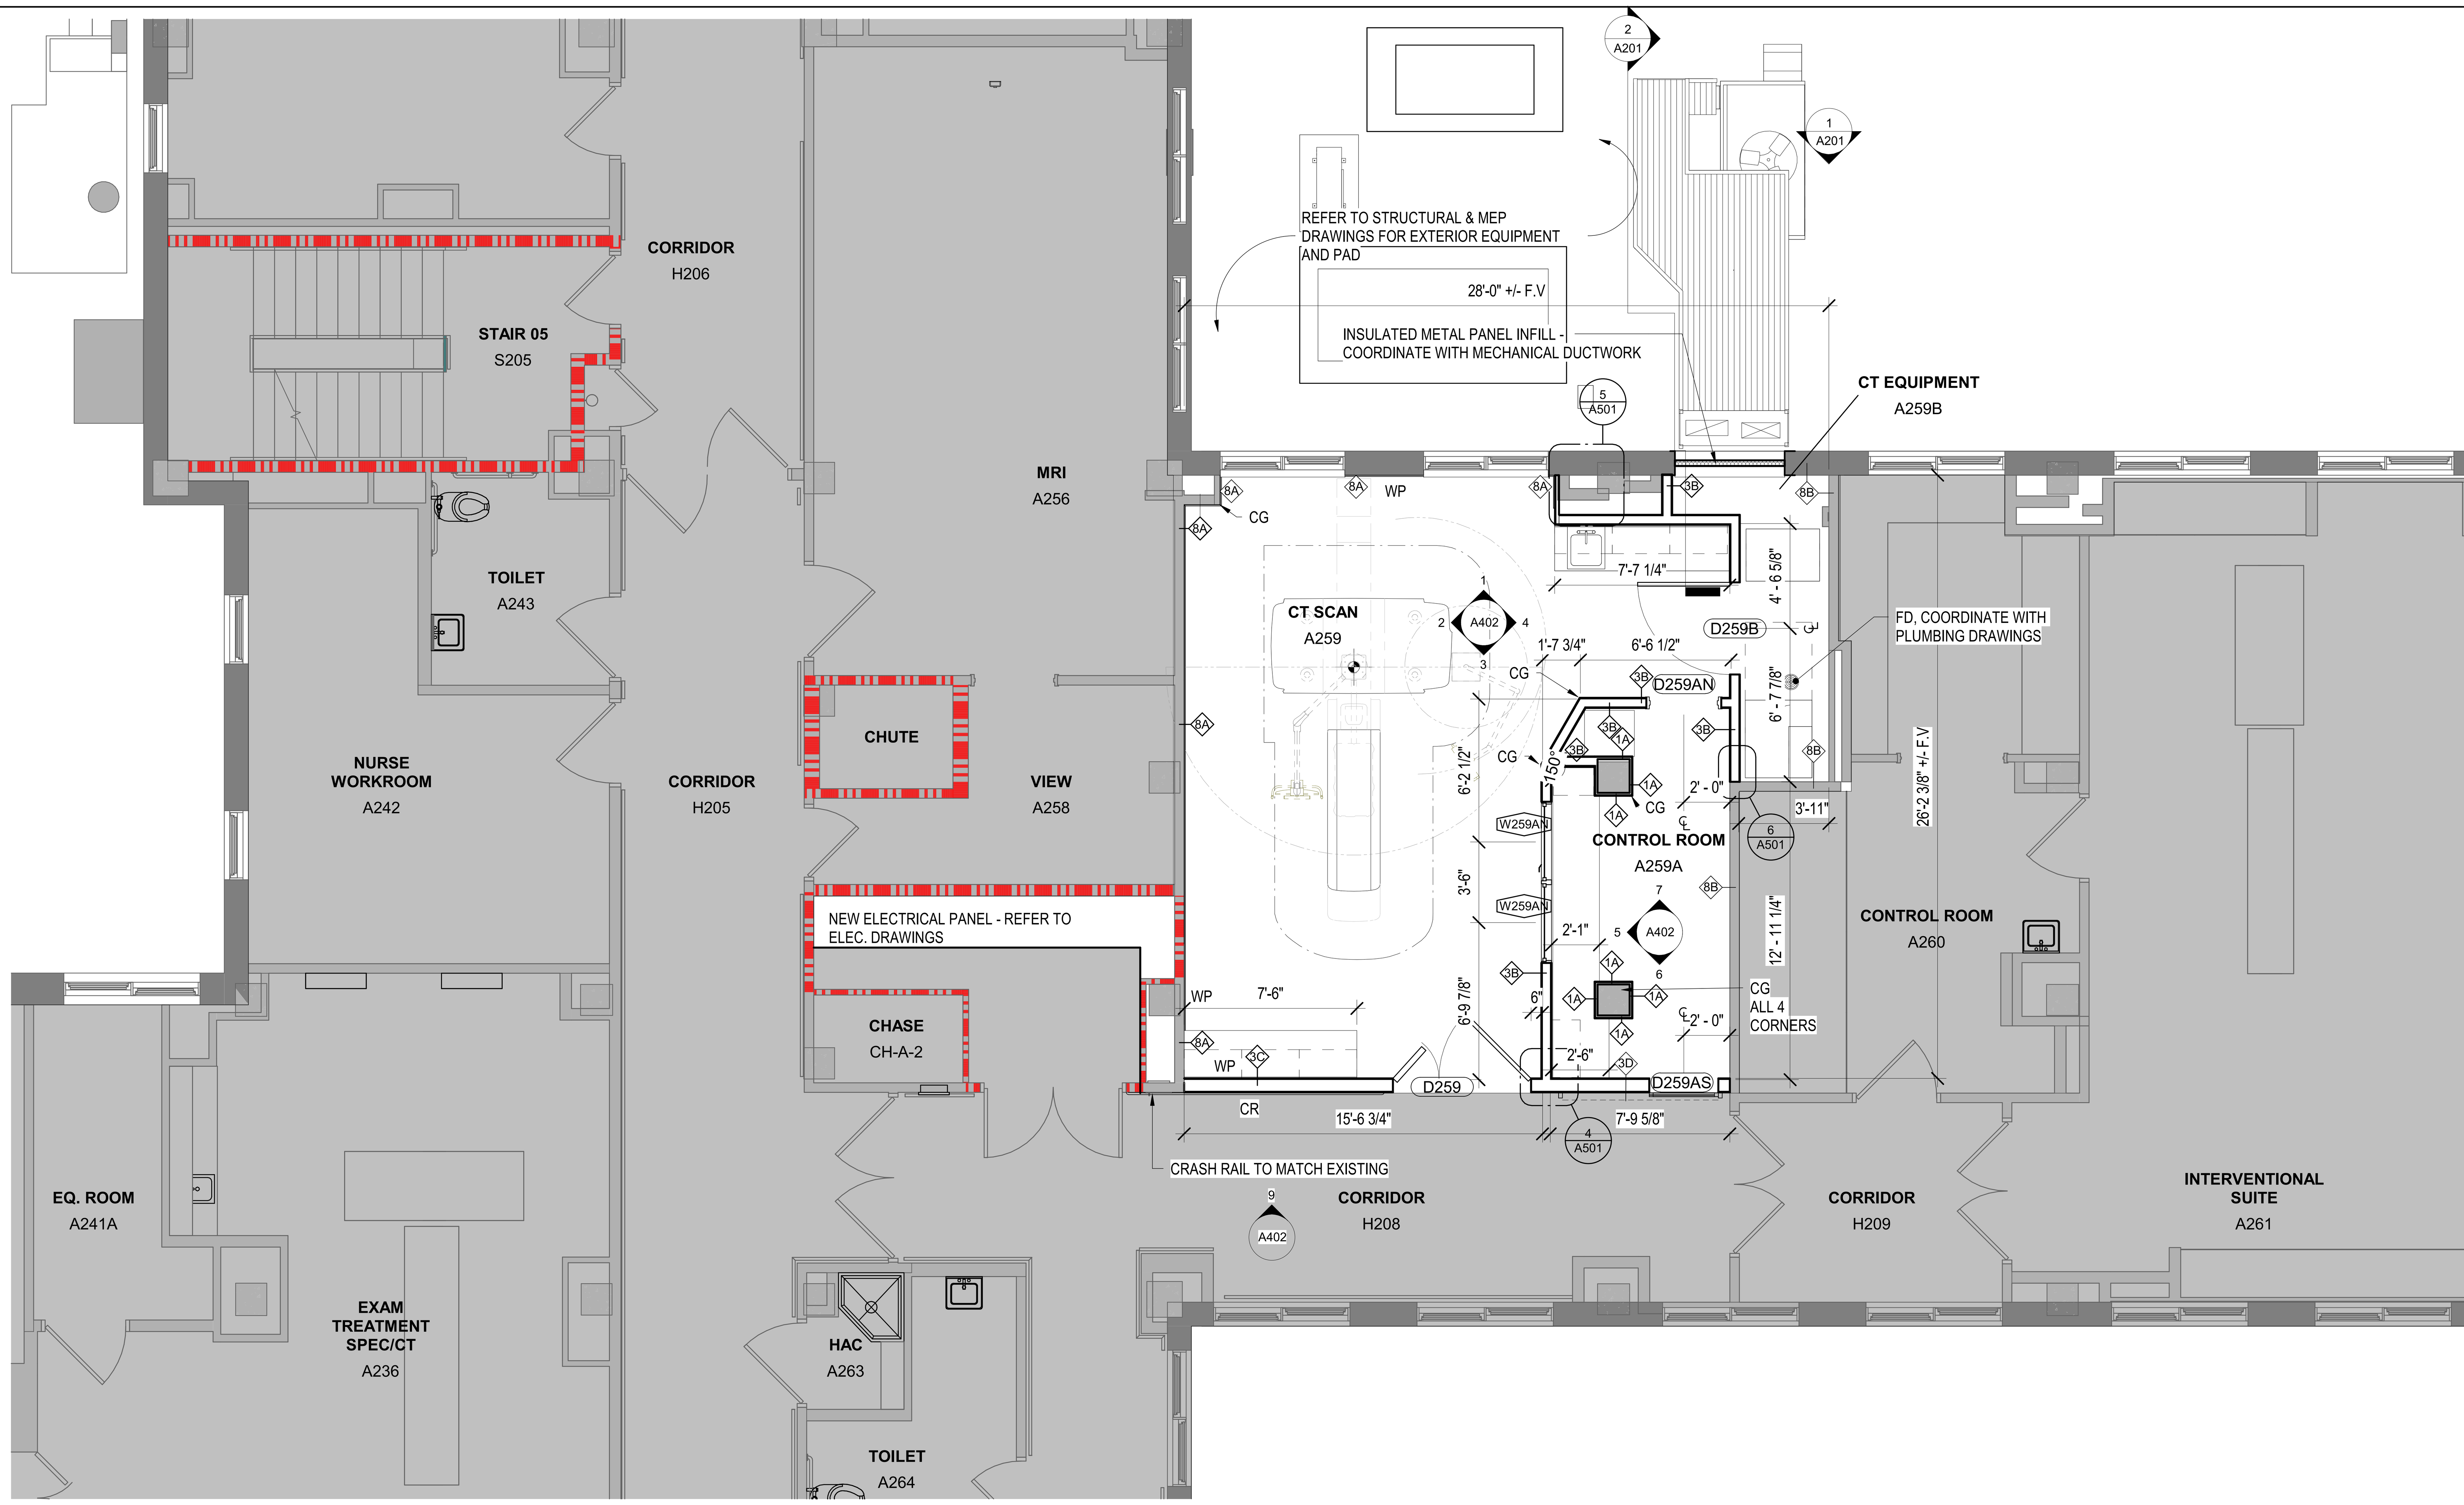

1 SECOND FLOOR PLAN
1/4" = 1'-0"

GENERAL FLOOR PLAN NOTES:

A. DIMENSIONS TO FACE OF NEW STUD UNLESS NOTED OTHERWISE. EXISTING WALLS ARE DIMENSION TO FACE OF EXISTING FINISH WALL. FIELD VERIFY ALL DIMENSIONS TO EXISTING WALLS.
B. ALL INTERIOR DOORS ARE LOCATED WITH INTERIOR OF JAMB AT HINGE SIDE 4 INCHES FROM ADJACENT WALL, UNLESS NOTED OTHERWISE. FIELD VERIFY FOR EXISTING WALLS
C. DOORS REFERENCED BY A DOOR NUMBER INDICATE A NEW DOOR OR SOME MODIFICATION TO AN EXISTING DOOR. SEE DOOR SCHEDULE. DOORS WITHOUT DOOR NUMBER REFERENCES ARE EXISTING DOORS TO REMAIN, WITH NO WORK OR MODIFICATION REQUIRED.
D. ALL CORRIDORS TO RECEIVE ABUSE-RESISTANT GYPSUM BOARD TO **6" ABOVE CEILING LINE**, U.N.O.
E. FOR MARKERBOARDS AND TACKBOARDS INDICATED BY SYMBOL, SEE **A605-606**. EXACT LOCATION TO BE DETERMINED IN THE FIELD WITH OWNER.
F. PROVIDE CODE COMPLIANT FIRE TREATED WOOD BLOCKING OR SHEET METAL PLATES IN HOLLOW WALL SYSTEMS FOR ATTACHMENT OF ANY WALL MOUNTED ACCESSORIES INCLUDING, BUT NOT LIMITED TO, SHELVING, CASEWORK, LIGHT FIXTURES, AUDIO VISUAL EQUIPMENT, SECURITY CAMERAS, MARKER BOARDS, ETC.
G. WALL ACCESSORIES SUCH AS FIRE EXTINGUISHER CABINETS AND PAPER TOWEL DISPENSERS THAT REQUIRE A SEMI-RECESSED INSTALLATION SHALL NOT REDUCE THE FIRE RATING OF THE WALL. IF A DETAIL IS NOT PROVIDED WITHIN THE CONTRACT DOCUMENTS, THE CONTRACTOR SHALL CONSULT THE ARCHITECT FOR PROPER DETAILS PRIOR TO INSTALLING THE ACCESSORY.
H. PARTITION TYPES AT INFILL WALLS SHALL MATCH ADJOINING EXISTING WALLS PROVIDING FOR A FLUSH, SMOOTH TRANSITION IN THE FINISHED SURFACE. MATCH BASE IN AREAS WHERE BASE IS OTHERWISE INDICATED TO REMAIN, RUNNING FROM AN INTERIOR CORNER OR OTHER DEFINED EDGE.
I. PATCH AND REPAIR ALL GYPSUM BOARD SURFACES WHERE DEMOLITION OF ADJOINING OR INTERSECTING PARTITIONS HAS RESULTED IN LESS THAN A FINISHED CONDITION. PATCHES SHALL BE FLUSH AND SMOOTH.
J. EXISTING ROOMS THAT ARE NOT INDICATED TO BE AFFECTED BY THE WORK ARE TO BE PROTECTED FROM DAMAGE AND/OR PAINT DEGRADATION. SHOULD THE GENERAL CONTRACTOR AFFECT THE CONDITION OR FINISH OF THESE ROOMS, THE SURFACE OR SPACE SHALL BE RESTORED TO ORIGINAL CONDITION.
K. REFERENCE DRAWING **AD101 - AD111** FOR GENERAL DEMOLITION PLANS. WHERE NEW CONSTRUCTION ABUTS EXISTING CONSTRUCTION IN THE SAME PLANE, FINISHES SHALL BE FLUSH. VERIFY ALL DIMENSIONS TO EXISTING ELEMENTS.
L. NOTIFY THE ARCHITECT OF ANY AND ALL DISCREPANCIES BETWEEN EXISTING CONDITIONS AND THE CONTRACT DOCUMENTS BEFORE PROCEEDING WITH THAT PORTION OF THE WORK. FAILURE TO NOTIFY THE ARCHITECT WILL NOT RELIEVE THE CONTRACTOR OF THE RESPONSIBILITY TO PERFORM THE WORK AS INTENDED BY THE CONTRACT DOCUMENTS.
M. VERIFY EXISTING DIMENSIONS, CONDITIONS AND CLEARANCES PRIOR TO THE SUBMISSION OF SHOP DRAWINGS.
N. SEE SHEET **G004** FOR PARTITION TYPES.
O. PREP EXISTING SUBFLOOR TO RECEIVE SHEET LEAD DIRECTLY OVER EXISTING CONCRETE FLOOR THEN COAT FULLY CURED CONCRETE WITH A SEALANT. ENSURE THE LEAD IS FREE OF BUMPS, AIR POCKETS OR OBSTRUCTIONS AND LIES COMPLETELY FLAT - LEAD LINE FLOOR AT SHIELDING REQUIREMENTS, SEE STRUCTURAL DRAWINGS.
P. VA TO CONDUCT IN-HOUSE REVIEW TO VERIFY SHIELDING REQUIREMENTS FOR THE FLOOR, WALLS AND CEILINGS. GC TO PURCHASE AND INSTALL SHIELDING AS PER REQUIREMENTS LISTED IN VA REPORT. COORDINATE INSTALLATION REQUIREMENTS OF THE PURCHASED CT EQUIPMENT AS PER MANUFACTURER INSTRUCTIONS.

NEW CONSTRUCTION LEGEND:

- EXISTING 2 HR FIRE RATED FIRE BARRIER
- EXISTING SMOKE BARRIER
- EXISTING CONSTRUCTION TO REMAIN
- NEW PARTITION
- NEW DOOR LEAF
- NEW WINDOW
- EQ ℄ EQ — DIMENSIONS CENTERLINE
- E — FIRE EXTINGUISHER
- FEC — FIRE EXTINGUISHER CABINET AND EXTINGUISHER
- 4 — NEW CONSTRUCTION NOTE
- 01 — INDICATES INTERIOR PARTITION TYPE (SEE **G004** FOR PARTITION LEGEND). INTERIOR PARTITIONS ARE TYPE **3A** UNLESS NOTED OTHERWISE. WHERE ENLARGED PLANS OR DETAILS ARE PROVIDED, SEE THOSE DRAWINGS FOR PARTITION TYPES.
- 00 — EQUIPMENT - SEE EQUIPMENT SCHEDULE
- X — DOOR TAG - SEE DOOR & WINDOW SCHEDULE
- # — WINDOW TAG - SEE DOOR & WINDOW SCHEDULE

KEY PLAN

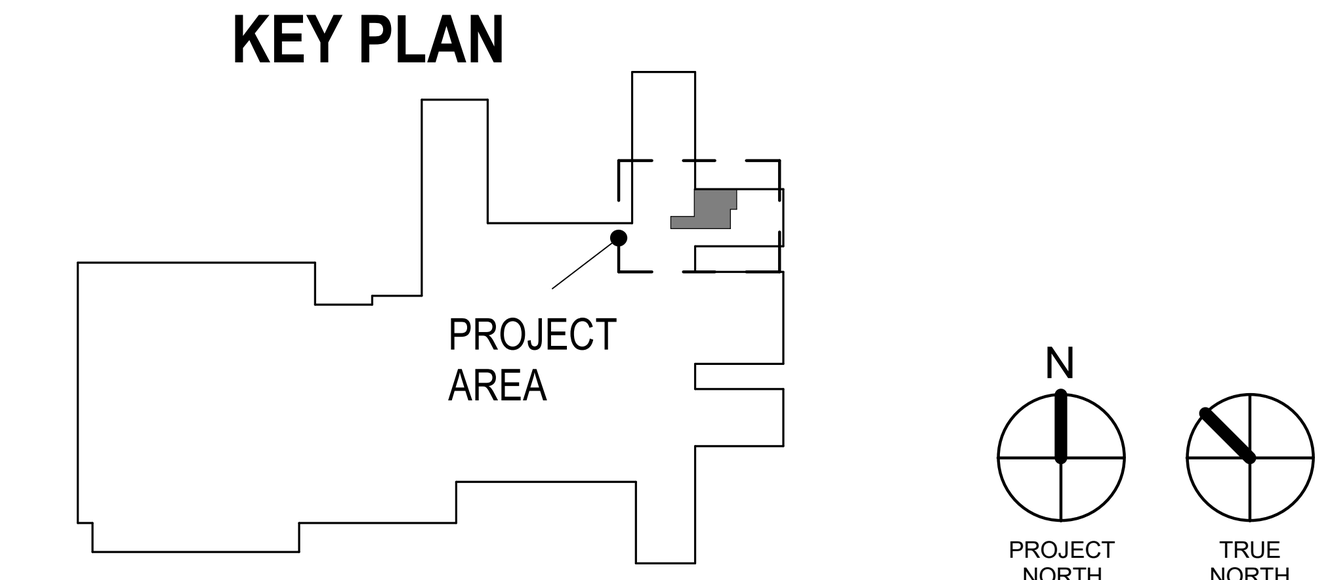

Revisions:	Date:

CONSULTANT
Above Group
ENGINEERING DESIGN CONSULTING
Mabbett
Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD
THINKFORM
THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP
STATE OF MISSOURI
RUSSELL DINARDO
NUMBER
A - 2024000203
ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)
VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
SECOND FLOOR PLAN	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
			Building Number: 1
Approved:		Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Drawing Number
		Issue Date: 06 MARCH 2026 / Checked: TB / Drawn: PS	A102

GENERAL RCP NOTES:

A. IN ANY UNBRACED AREA OF CEILING WHICH IS MORE THAN 1000 SF, IT IS REQUIRED THAT SPRINKLER HEADS AND OTHER PENETRATIONS BE INSTALLED WITH A 2" OVERSIZED RING, SLEEVE, OR ADAPTER THROUGH THE CEILING TILE TO ALLOW FOR ONE INCH OF FREE MOVEMENT IN ALL HORIZONTAL DIRECTIONS.
B. HEIGHT OF CEILING ABOVE FINISH FLOOR IS TAKEN FROM FLOOR SURFACE DIRECTLY BELOW. CEILING HEIGHT TO BE **8-3"** AFF UNLESS NOTED OTHERWISE.
C. THE BUILDING IS IN A SEISMIC CATEGORY "C" AND ALL CODE RELATED CEILING REQUIREMENTS WILL APPLY. SEE CEILING DETAIL SHEET **A113**.
D. SUSPENSION GRIDS SHALL BE CENTERED IN ALL SPACES UNLESS INDICATED OTHERWISE ON ARCHITECTURAL RCP.
E. NO TILE LESS THAN 6" IN WIDTH SHALL BE INSTALLED. IF FIELD CONDITIONS REQUIRE THAT A CEILING TILE LARGER THAN 24" IN ANY DIMENSION BE USED IN THE PERIMETER BOARDS OF A TYPICAL GRID, THE BOARDS SHALL BE CUT FROM A 24"X48" CEILING TILE OF THE SAME MATERIAL. A DOUBLE WALL ANGLE SHALL NOT BE USED IN THE CEILING GRID SYSTEM.
F. ALL DEVICES MOUNTED IN ACOUSTICAL CEILING TILES SUCH AS LIGHTS, SPEAKERS, EXHAUST GRILLES, SPRINKLER HEADS, SMOKE DETECTORS, REMOTE TEST SWITCHES FOR DUCT DETECTORS, ETC. SHALL BE CENTERED IN THE ACOUSTICAL CEILING TILE U.N.O. ALL DEVICES SHALL BE INDEPENDENTLY SUPPORTED.
G. SPRINKLER HEADS IN GYPSUM BOARD CEILINGS SHALL BE CENTERED AND ALIGN WITH RECESSED LIGHT FIXTURES IF APPLICABLE.
H. RADIATION SHIELDING STUDY TO BE UPDATED BY THE VA FOR SPECIFIC EQUIPMENT PURCHASED. GC TO INSTALL SHIELDING REQUIREMENTS FLOOR, WALLS AND CEILINGS. COORDINATE WITH MEP INSTALLATIONS.

RCP LEGEND:

- 2' X 2' ACT - SEE FINISH PLANS AND SPECIFICATIONS FOR TYPE
- 2' X 4' ACT - SEE FINISH PLANS AND SPECIFICATIONS FOR TYPE
- 2' X 2' LIGHT FIXTURE - SEE ELECTRICAL DRAWINGS
- 8" RECESSED CAN LIGHT - SEE ELECTRICAL DRAWINGS
- DECORATIVE SKYLIGHT - DECORATIVE SKYLIGHT - SEE ELECTRICAL DRAWINGS
- DIFFUSER - SEE MECHANICAL DRAWINGS
- SMOKE DETECTOR - SEE ELECTRICAL DRAWINGS
- LED WALL MOUNTED CT SIGNAGE - CT IN USE SIGN - SEE ELECTRICAL DRAWINGS
- SPRINKLER - SEE FIRE PROTECTION DRAWINGS
- TRACK LIGHTING
- 9'-0" HEIGHT ABOVE FINISHED FLOOR SEE GENERAL NOTE D
- EXISTING 2 HOUR RATED FIRE BARRIER
- EXISTING RATED SMOKE BARRIER

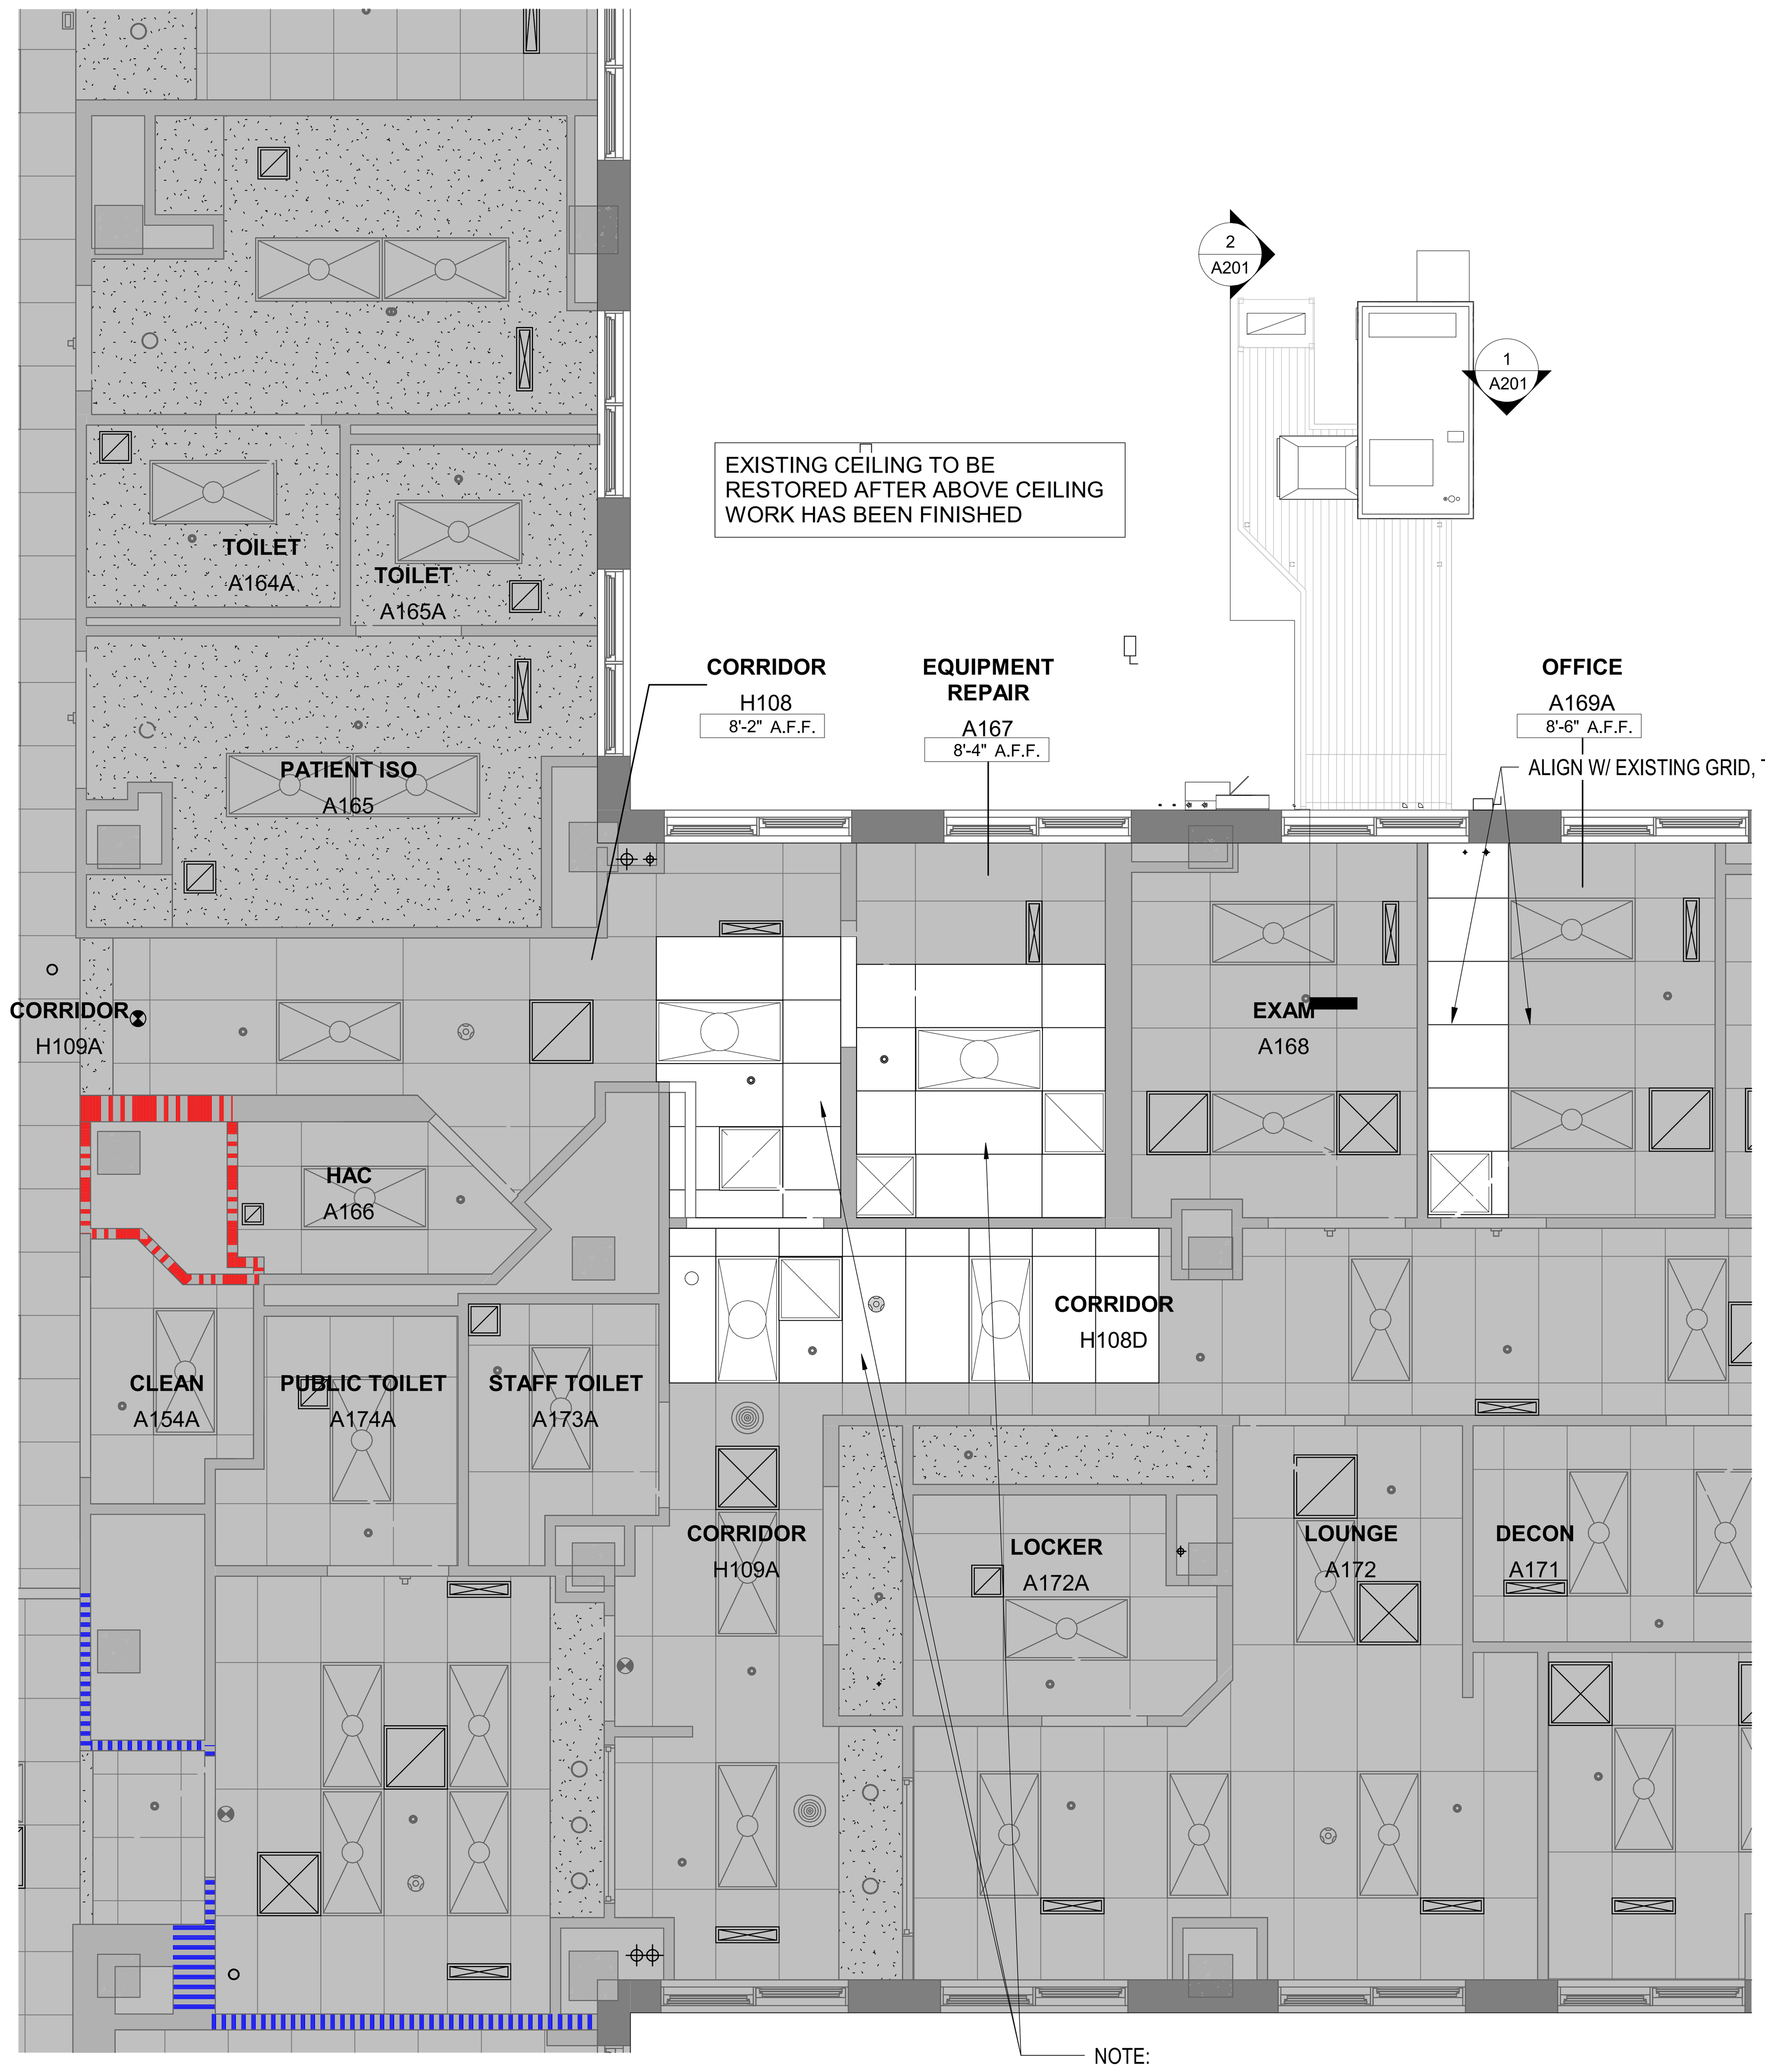

1 FIRST FLOOR REFLECTED CEILING PLAN
1/4" = 1'-0"

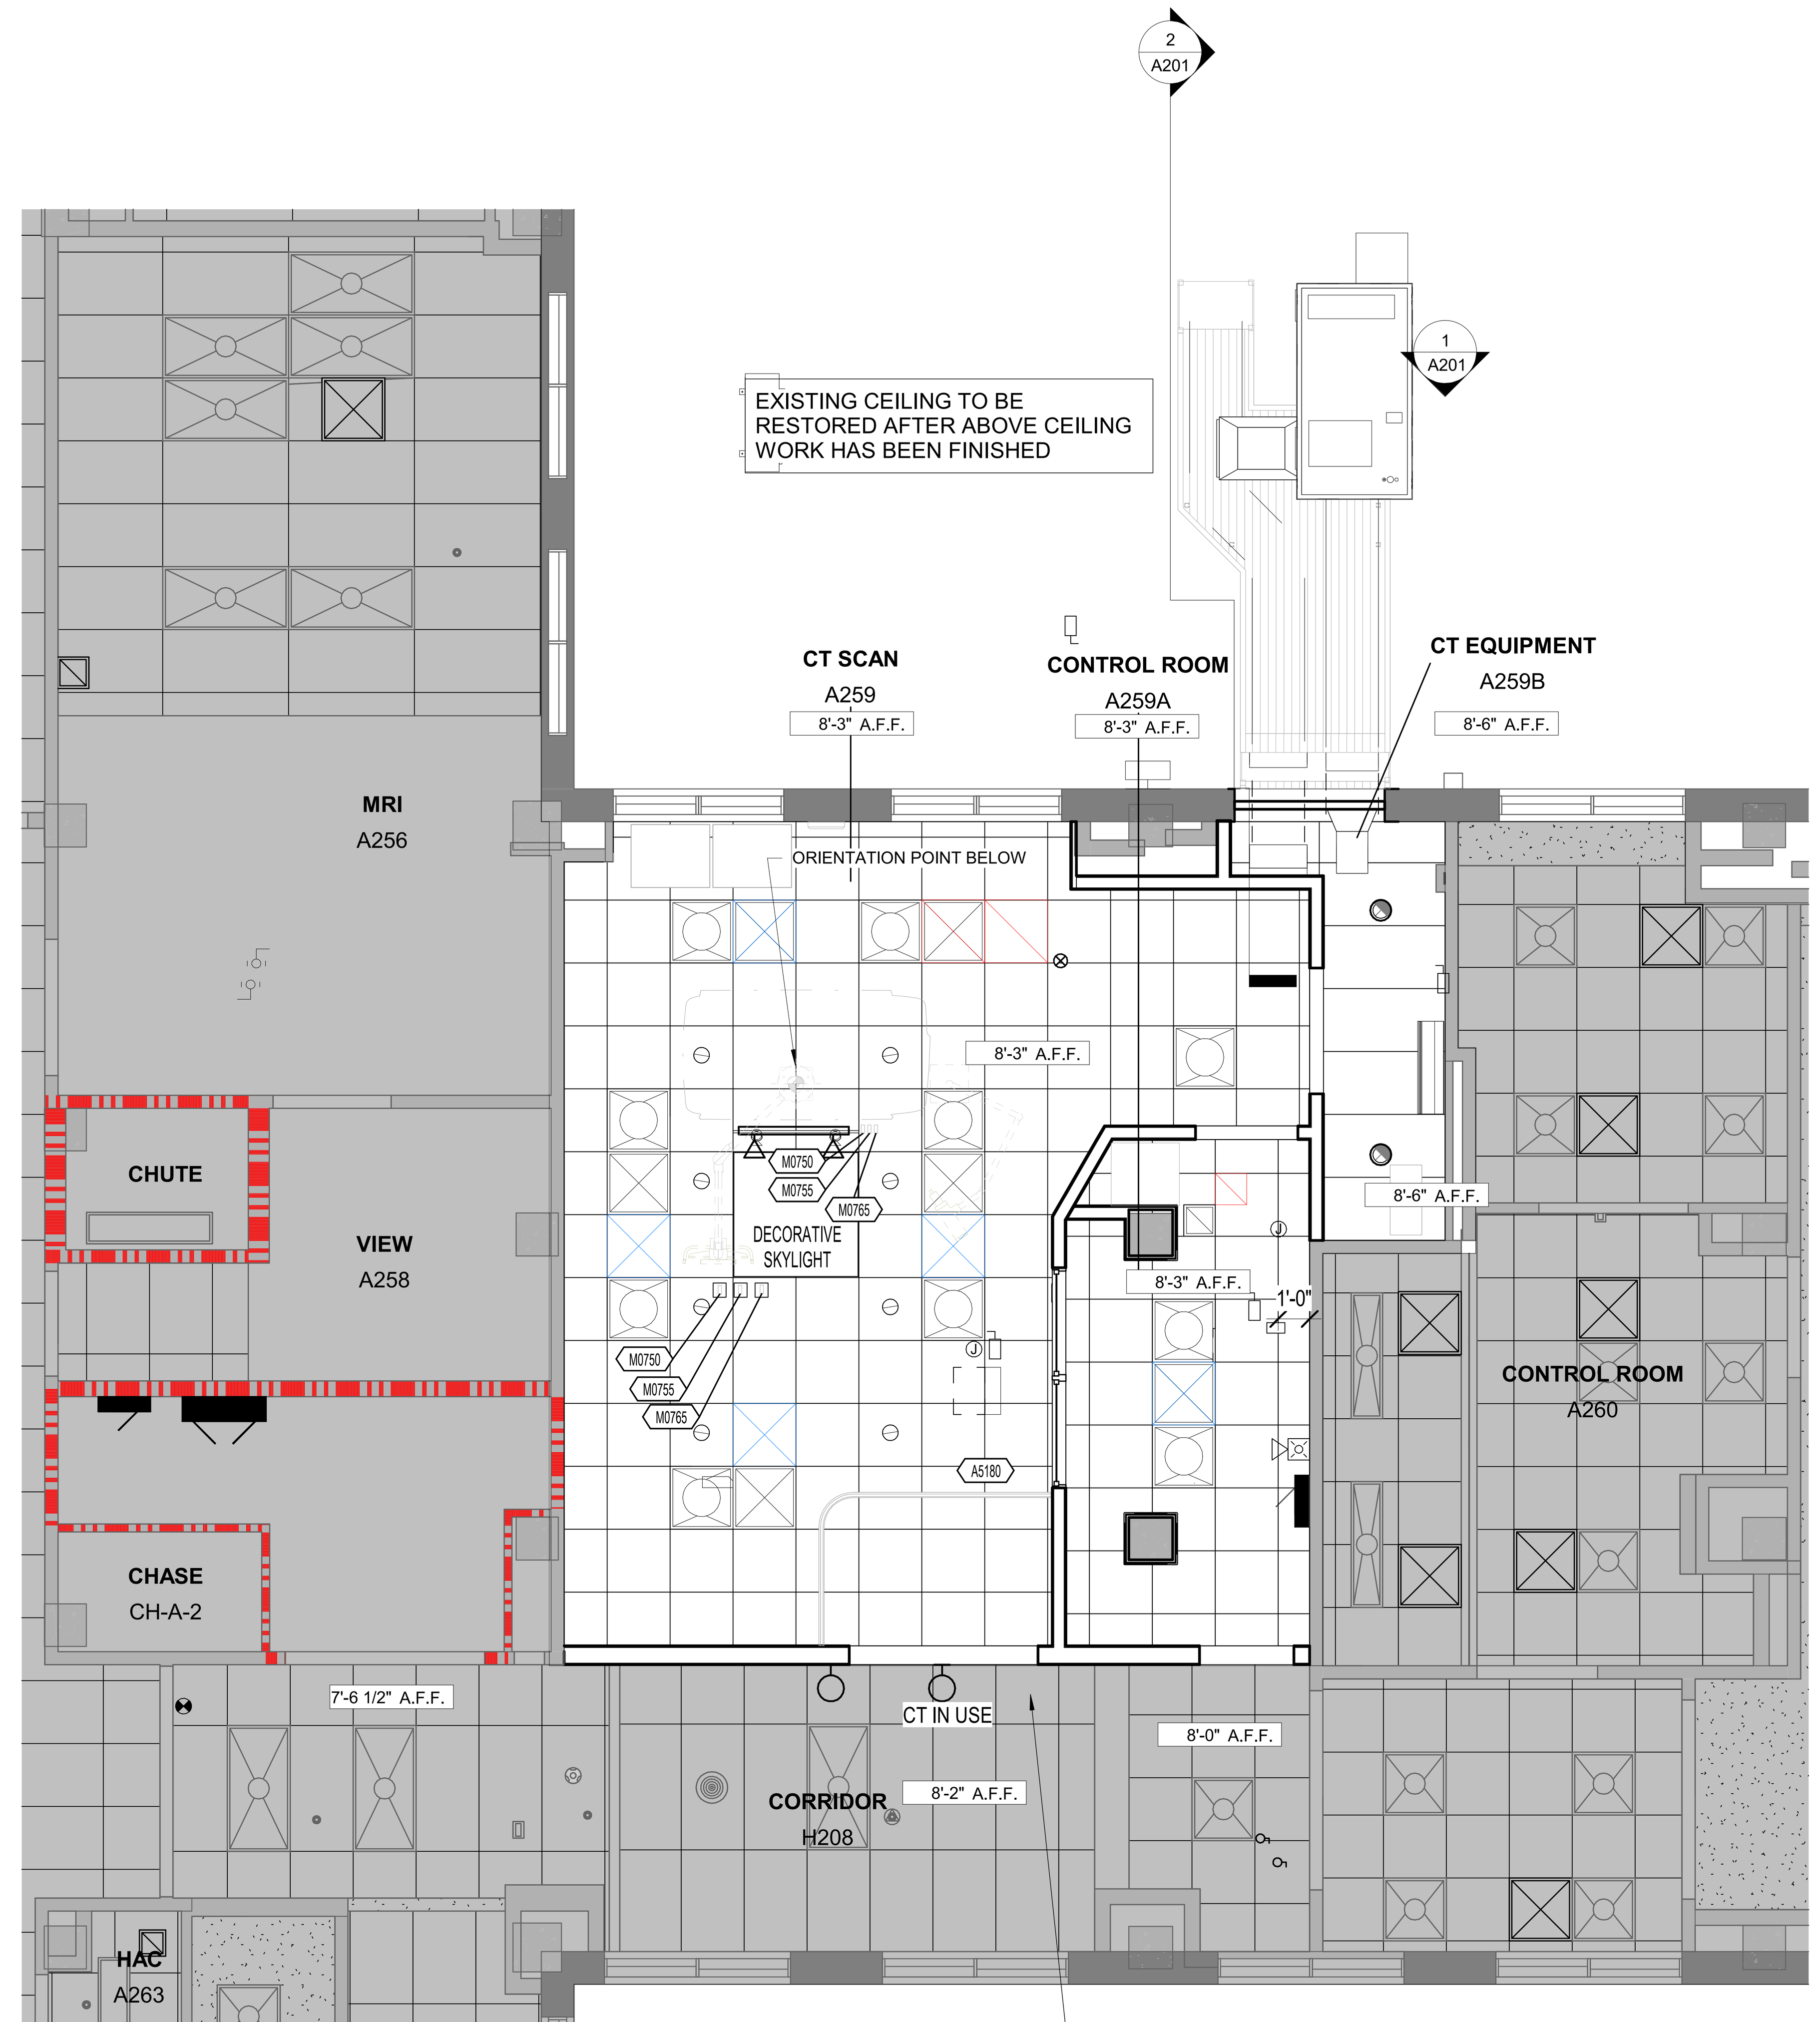

2 SECOND FLOOR REFLECTED CEILING PLAN
1/4" = 1'-0"

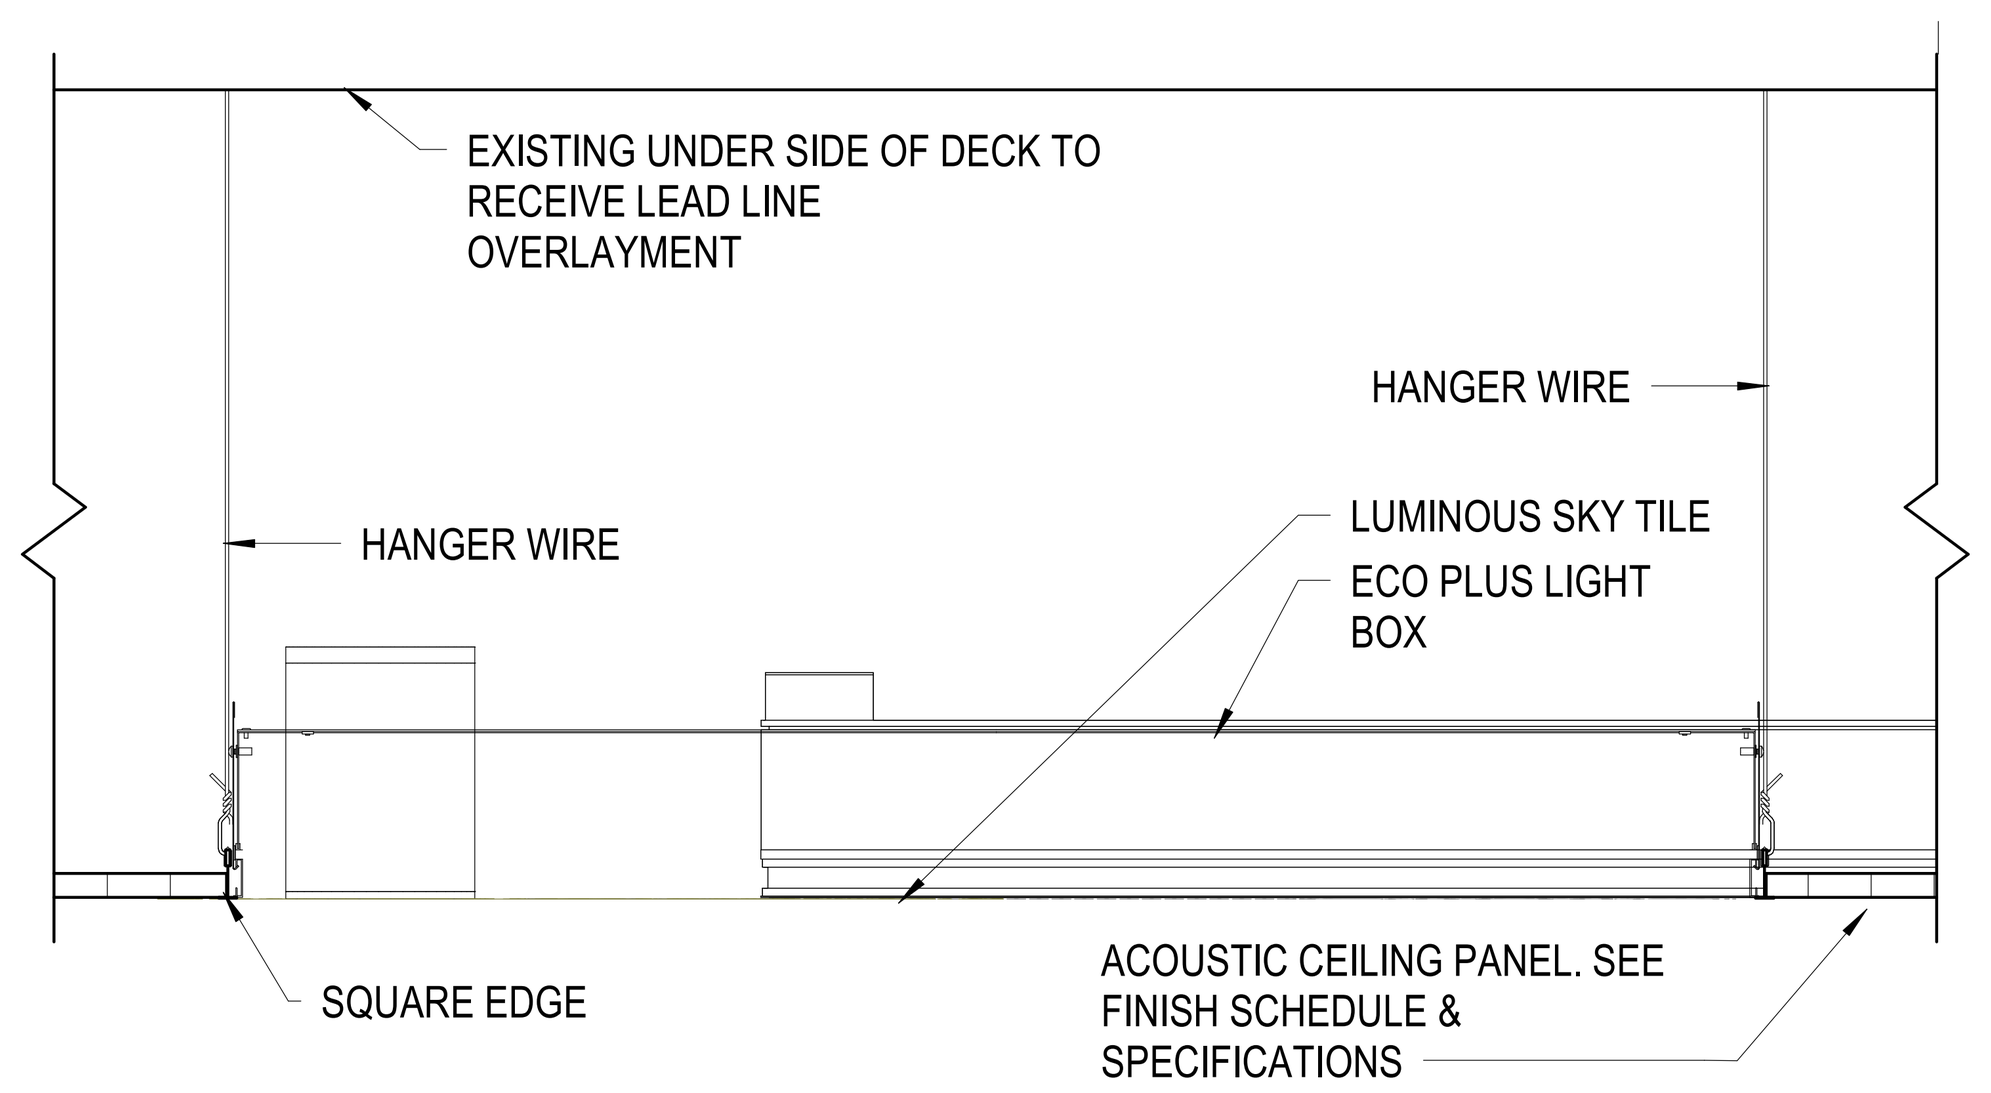

3 DECORATIVE SKYLIGHT DETAIL
1 1/2" = 1'-0"

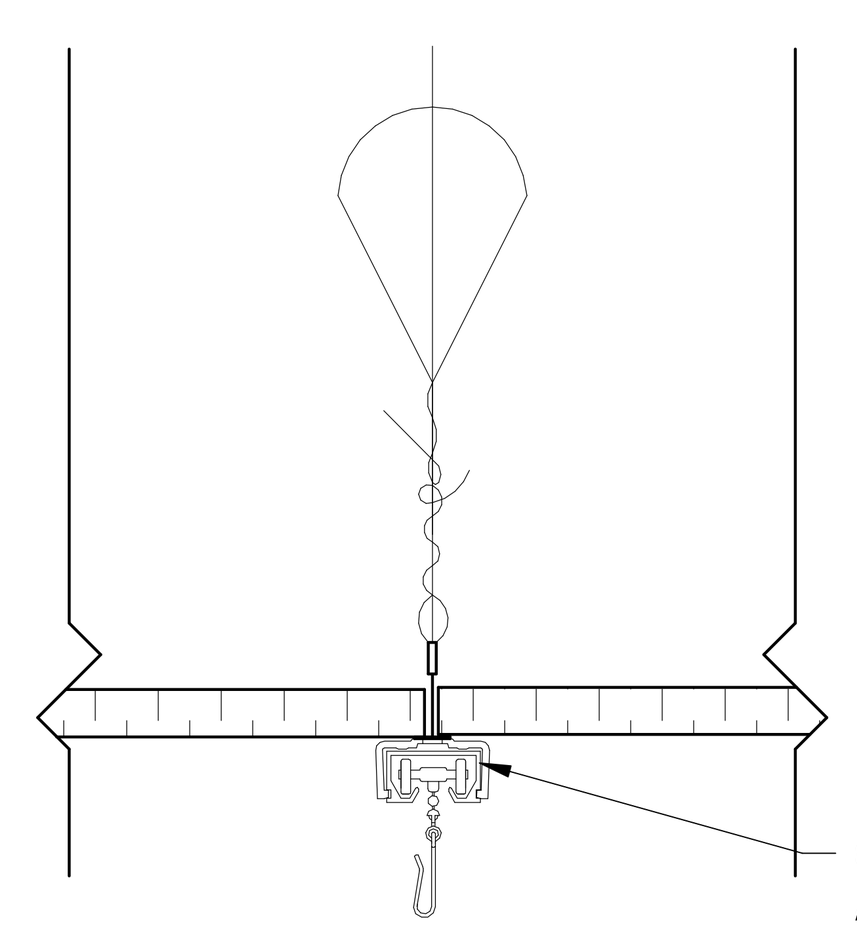

4 PATIENT CURTAIN TRACK
3" = 1'-0"

KEY PLAN

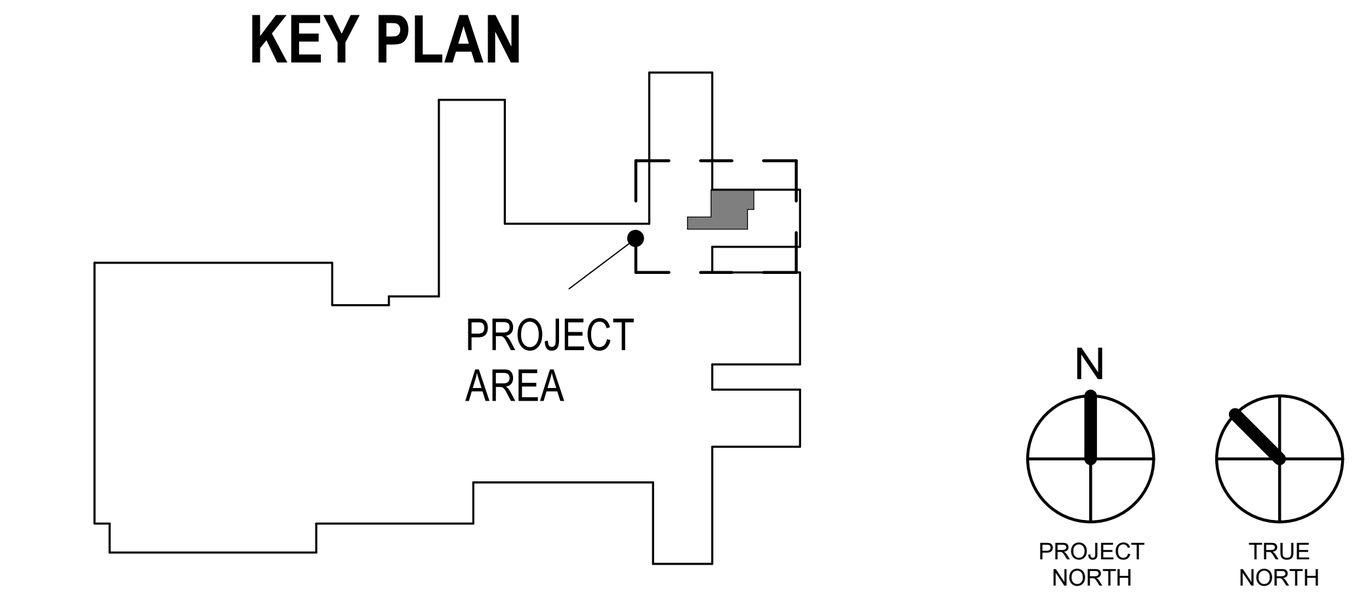

Revisions:	Date:

CONSULTANT
Above Group ENGINEERING DESIGN CONSULTING
Mabbett Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD
THINKFORM
THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP
STATE OF MISSOURI RUSSELL DINARDO NUMBER A - 2024000203 ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)
VA U.S. Department of Veterans Affairs

Drawing Title	FIRST & SECOND FLOOR REFLECTED CEILING PLAN
Approved:	
Phase	100% CONTRACT DOCUMENTS FOR BIDDING
Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	TB
Drawn	PS
Project Number	657-23-104JC
Building Number	1
Drawing Number	A111

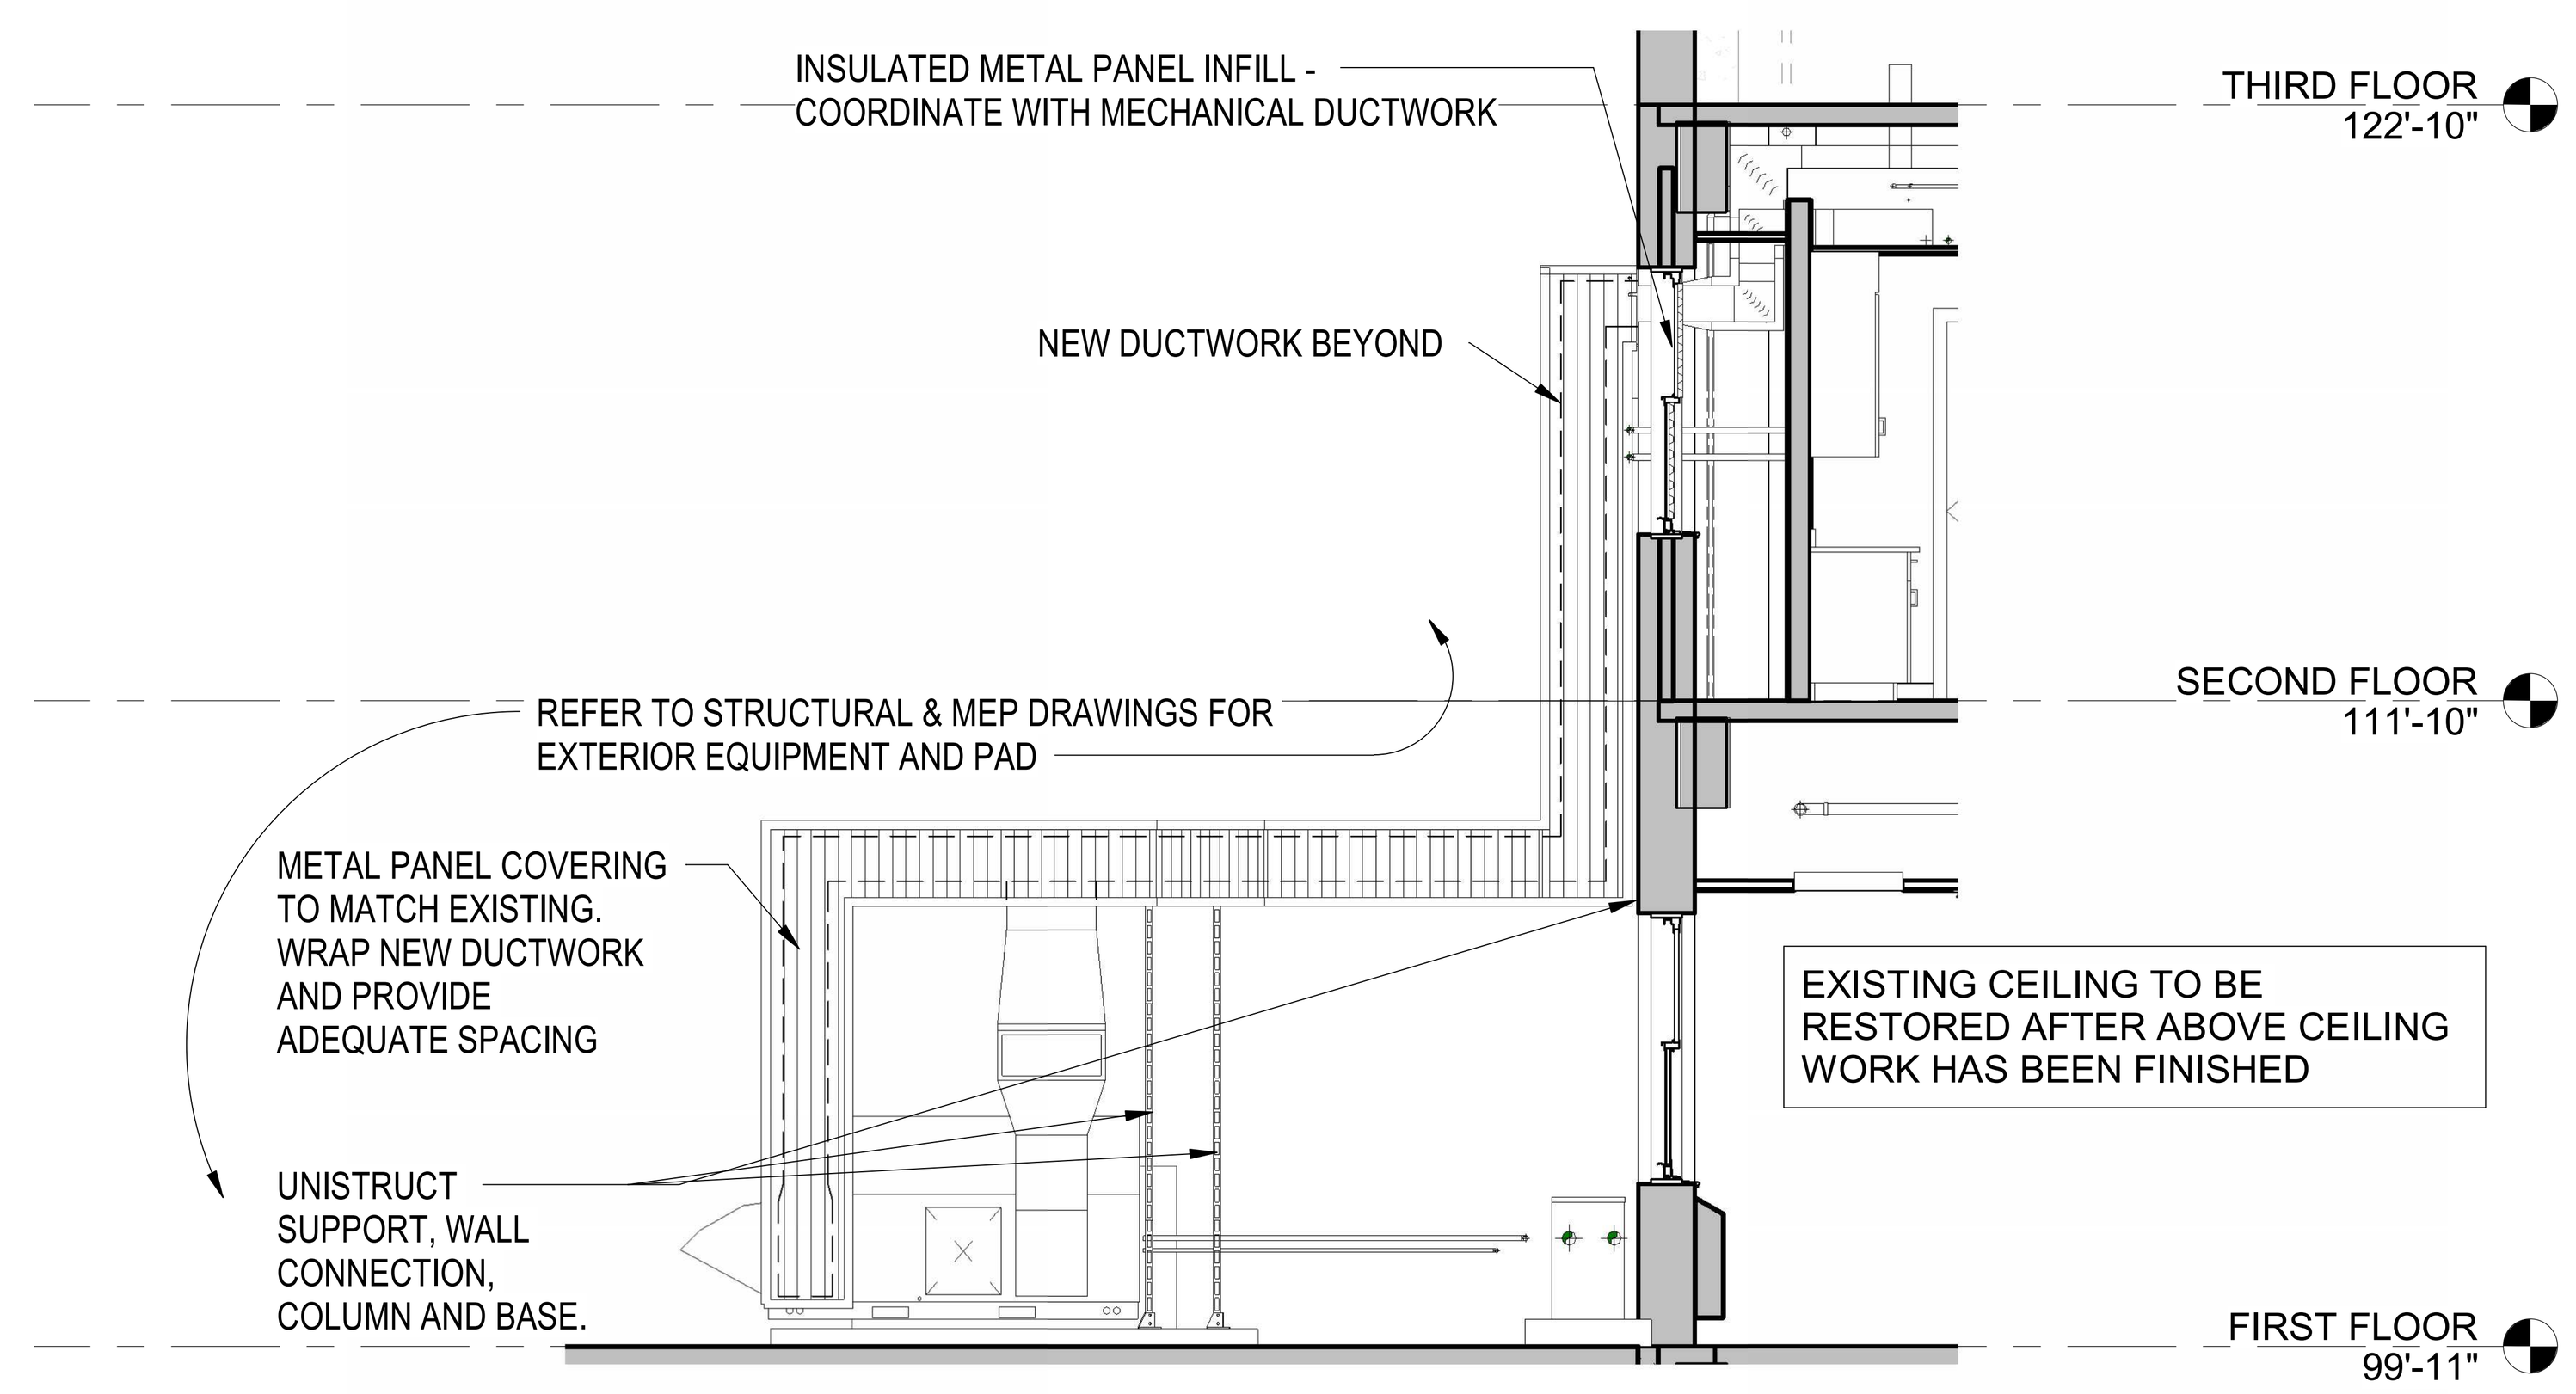

2 **SECTION @ OPENING**
1/4" = 1'-0"

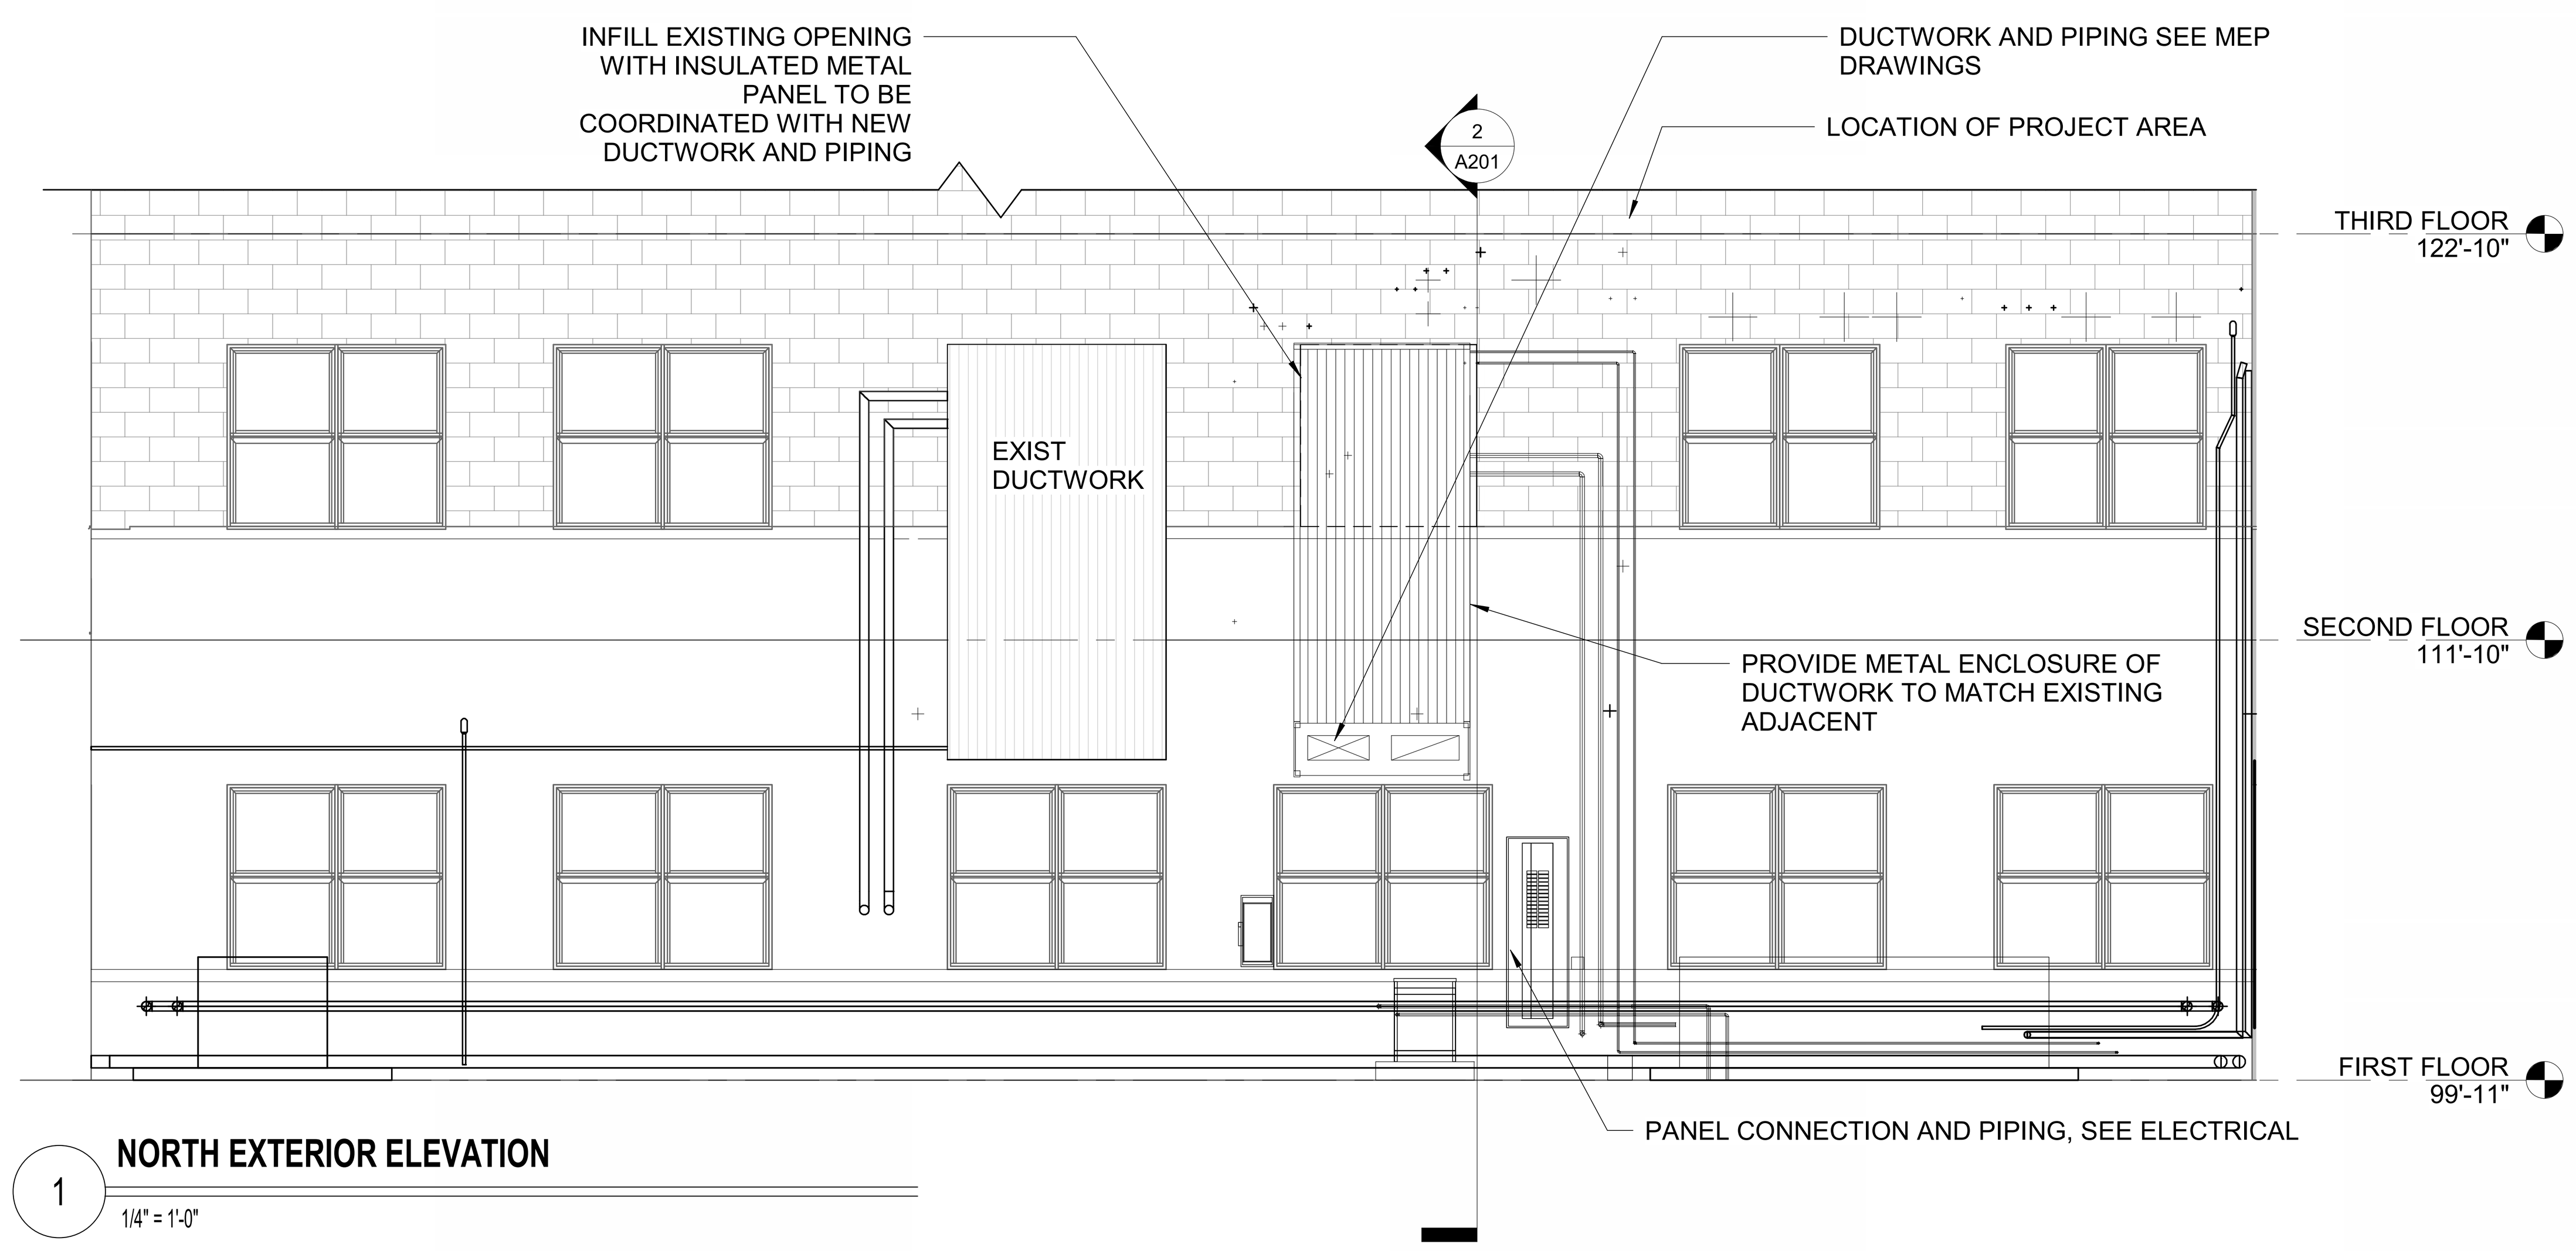

1 **NORTH EXTERIOR ELEVATION**
1/4" = 1'-0"

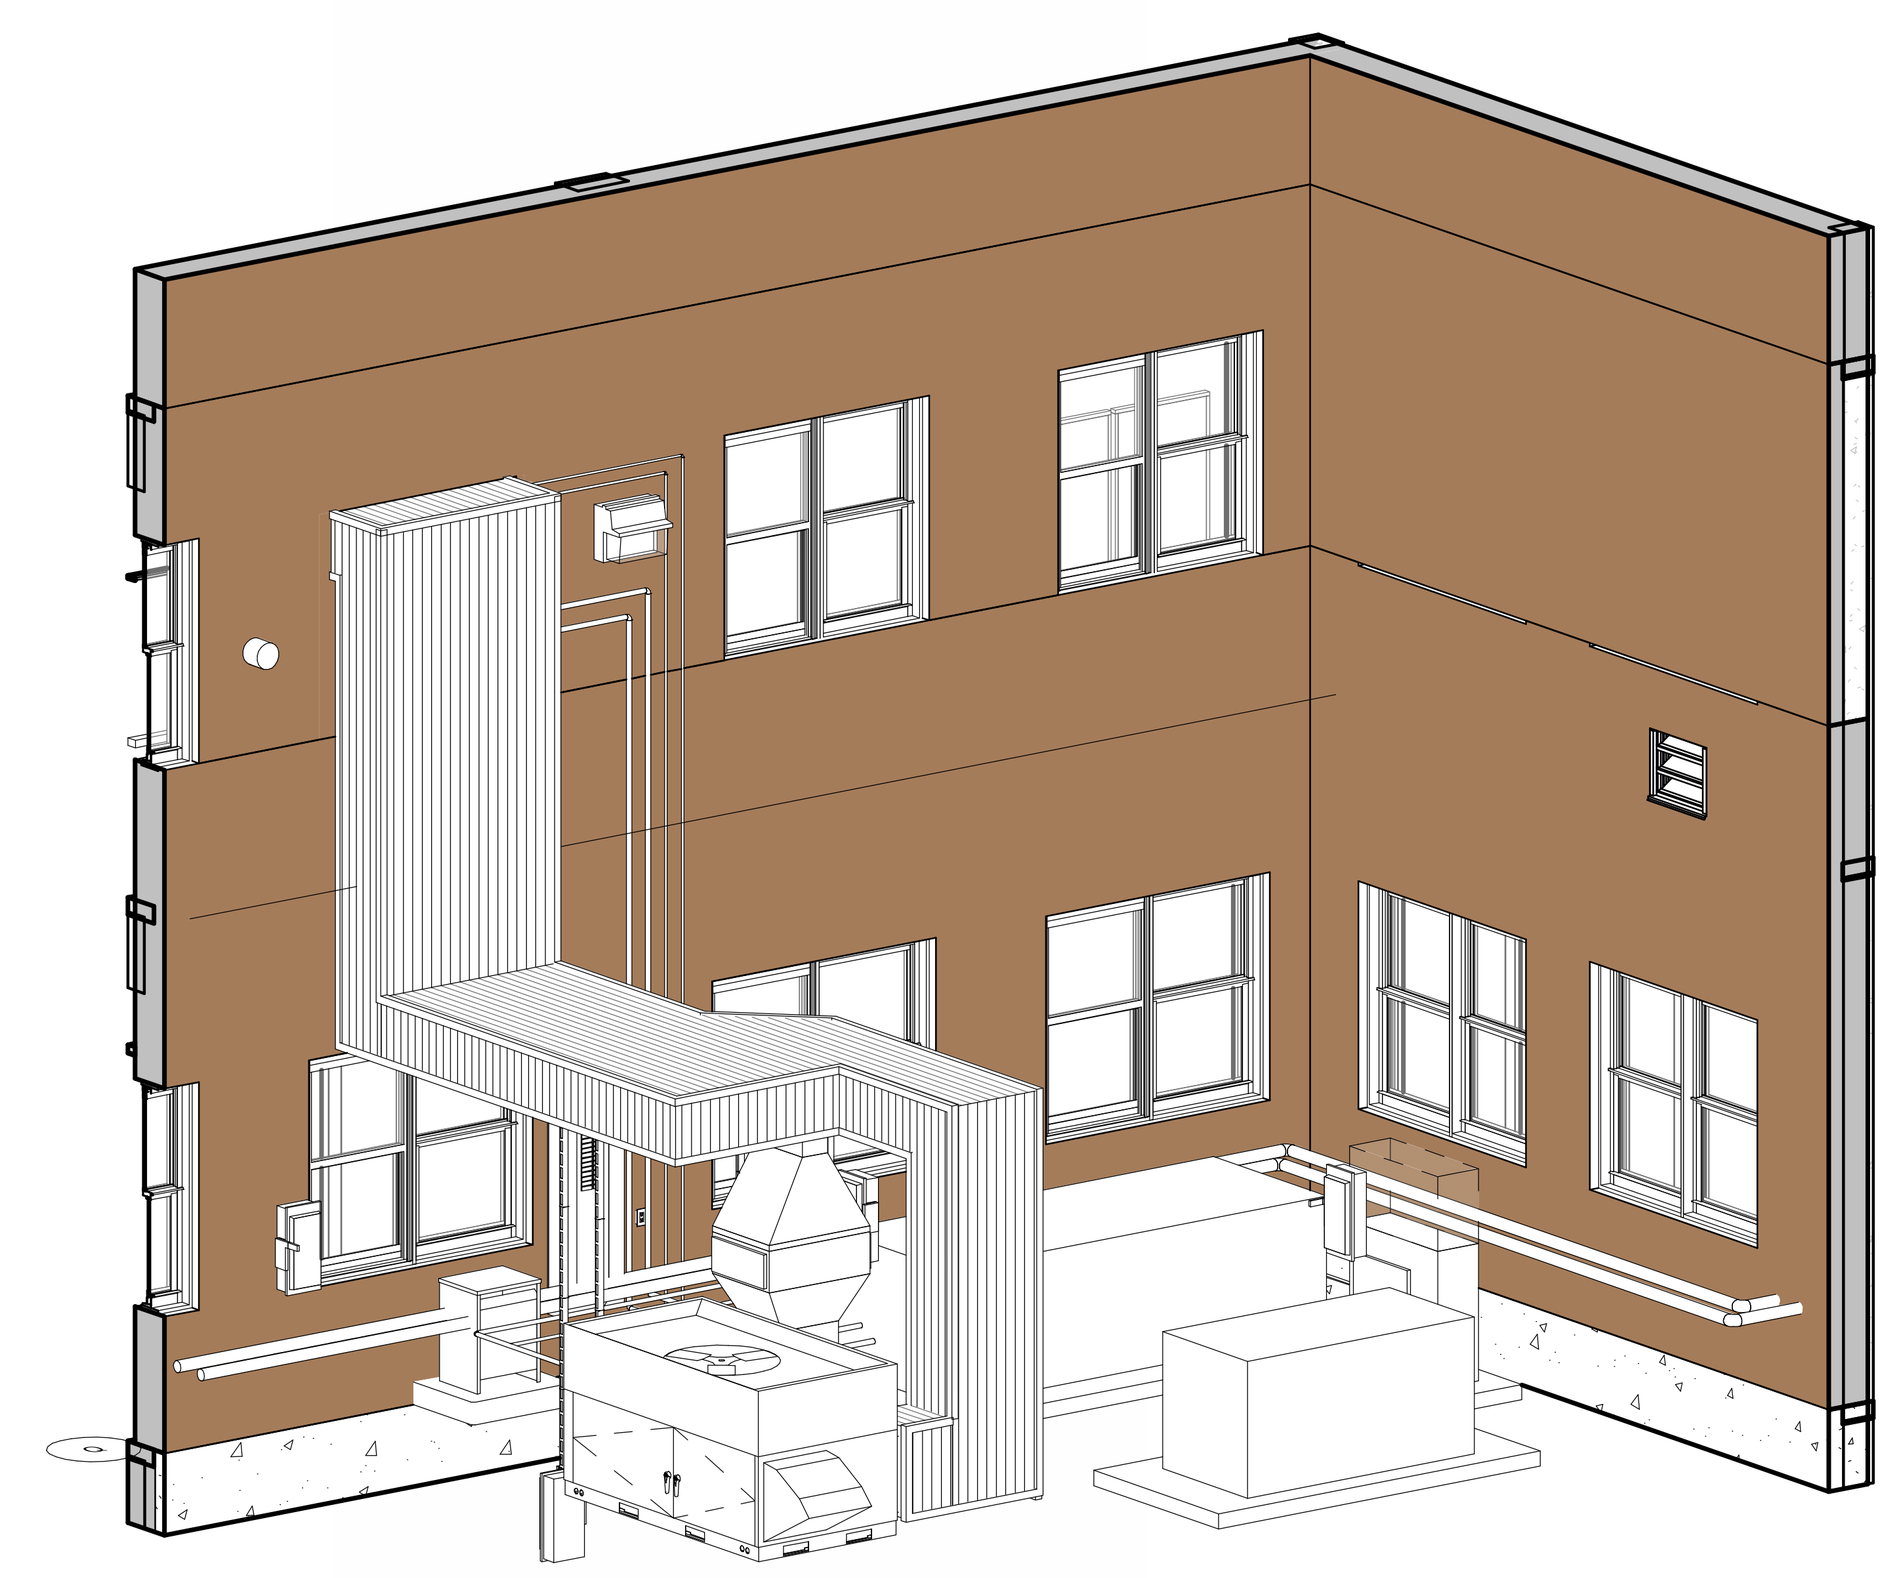

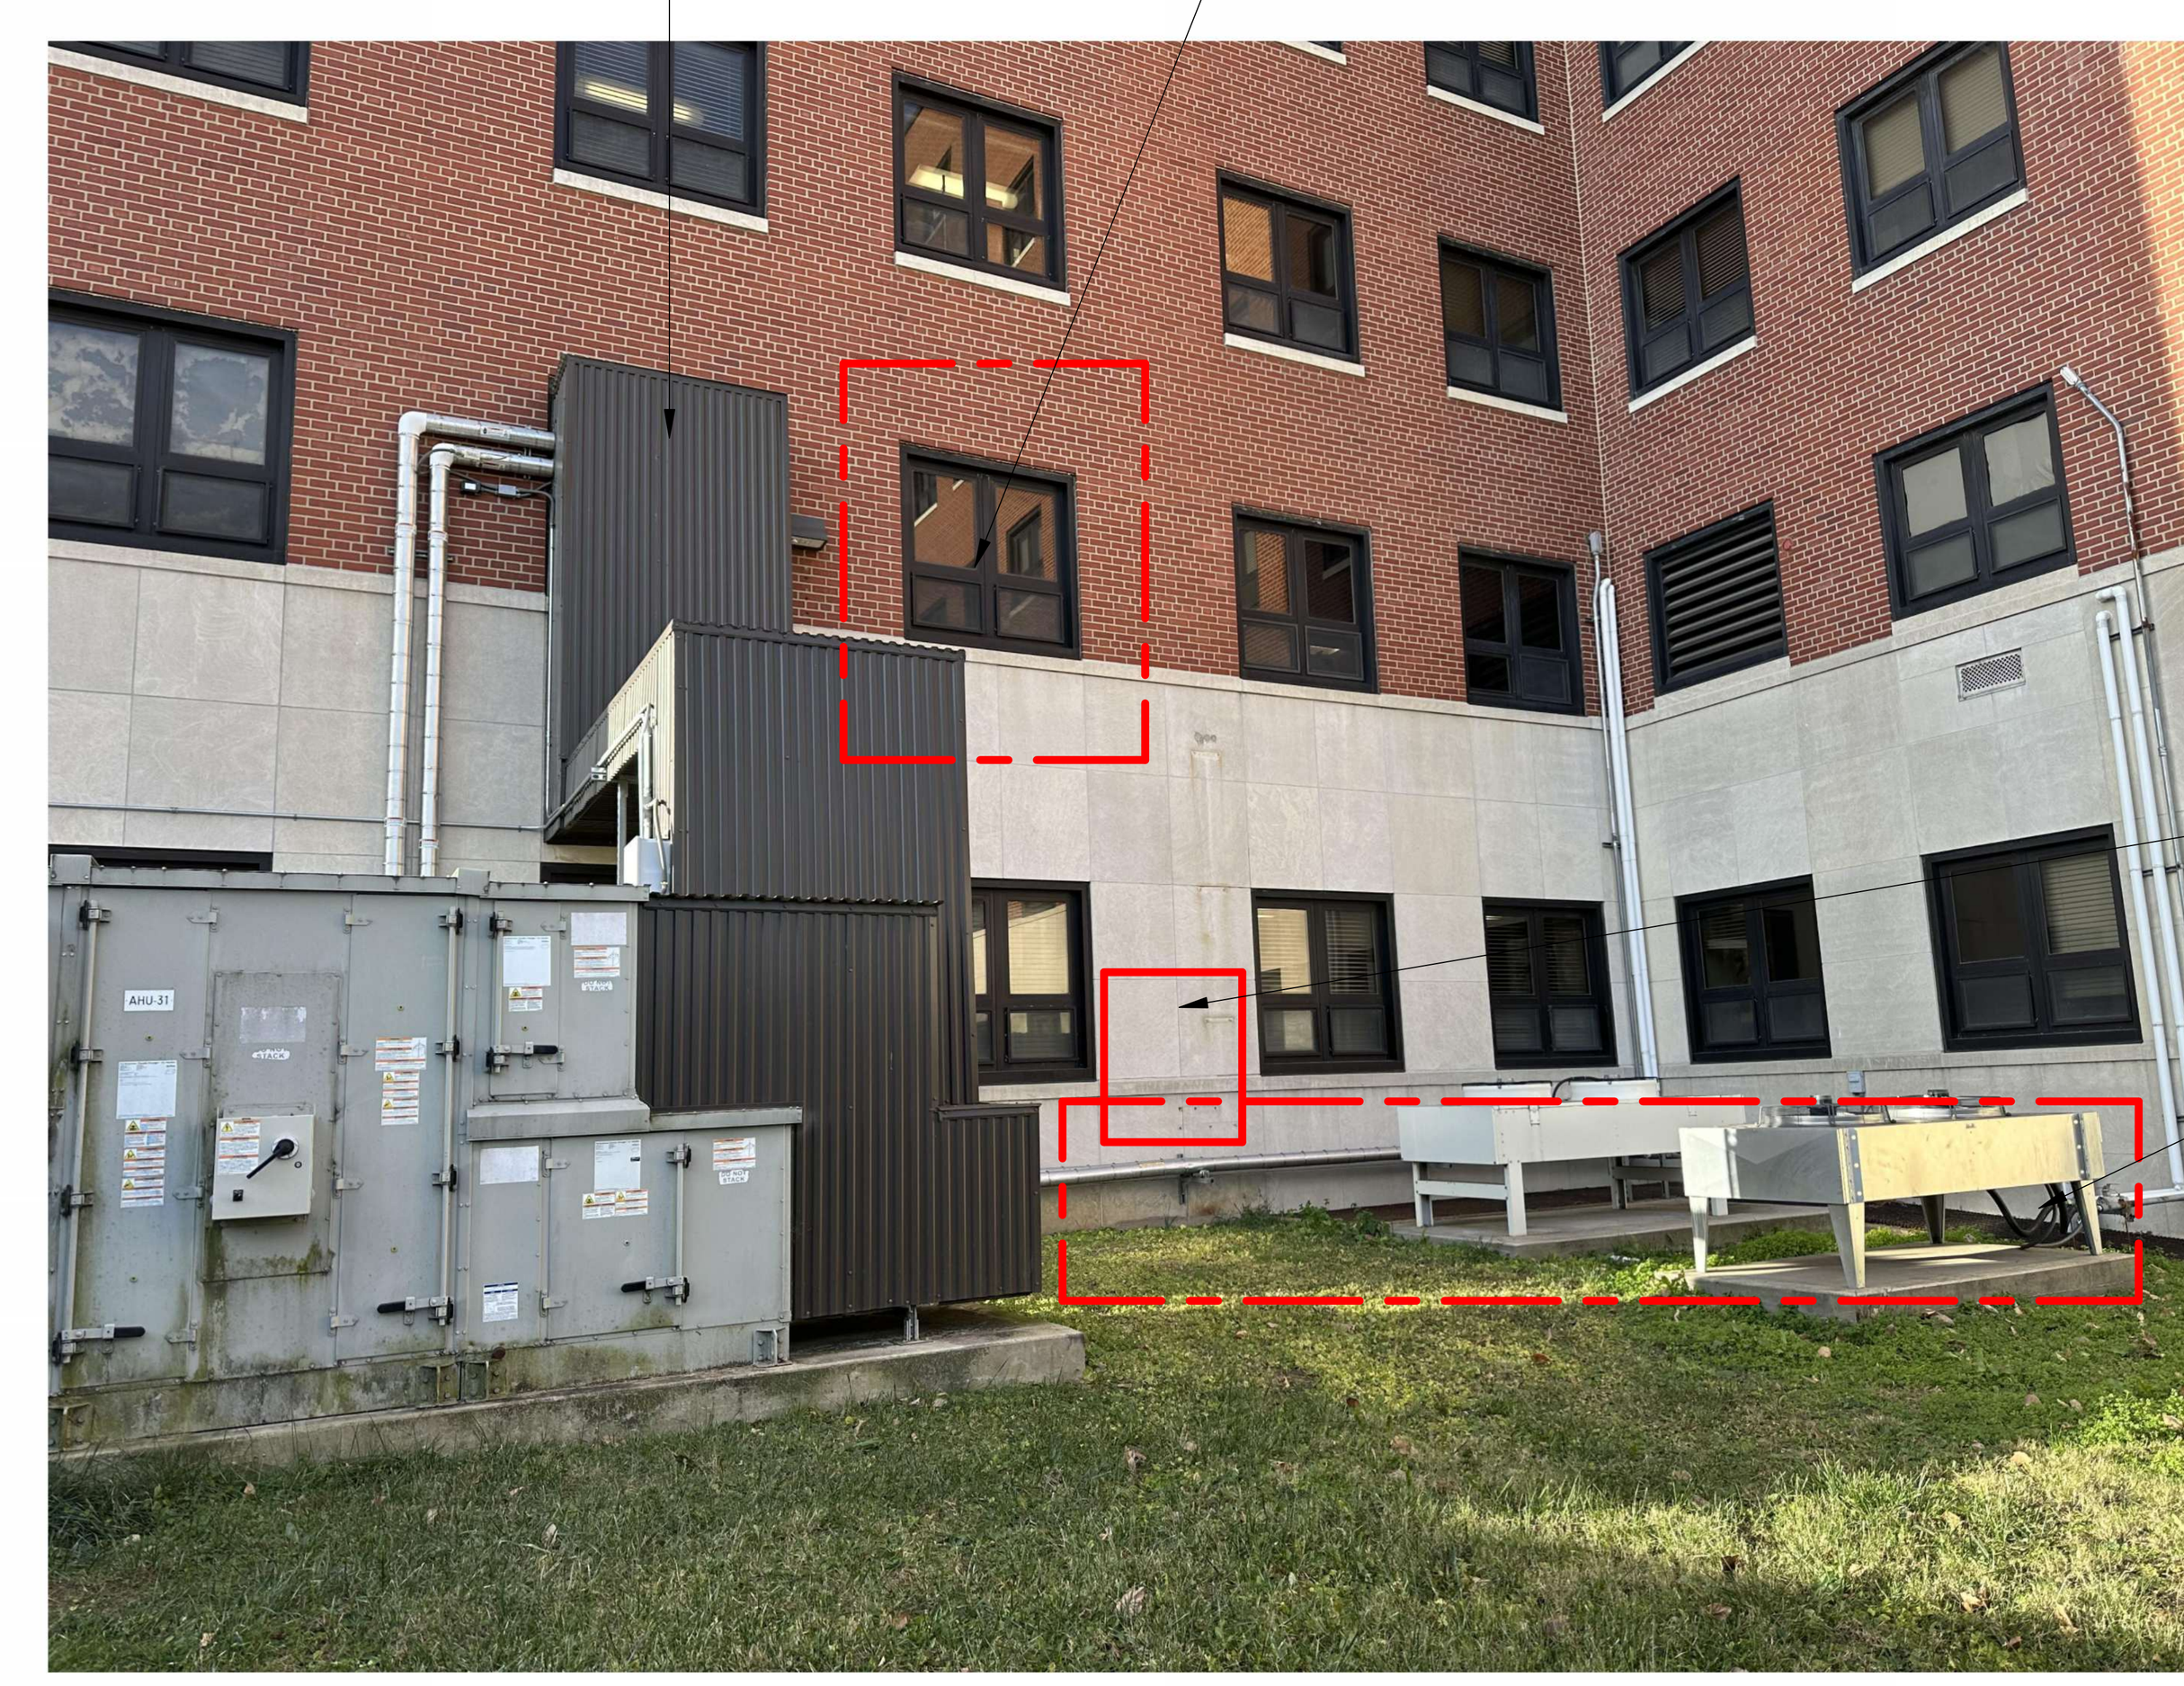

3 **NEW INSULATED PANEL REFERENCE**

3/3/2026 2:40:27 PM

Autodesk Docs://24001 VA ST Louis CT/657-23-104JC_657-JC-01-02_ARCH.rvt

Revisions:	Date:

CONSULTANT
Above Group ENGINEERING DESIGN CONSULTING
Mabbett Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD
THINKFORM
THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP
STATE OF MISSOURI RUSSELL DINARDO NUMBER A-2024000203 ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)
VA U.S. Department of Veterans Affairs

Drawing Title	EXTERIOR ELEVATIONS
Phase	100% CONTRACT DOCUMENTS FOR BIDDING
Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Project Number	657-23-104JC
Building Number	1
Approved:	
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	TB
Drawn	PS
Drawing Number	A201

VA FORM 08 - 6231

DOOR LEGEND

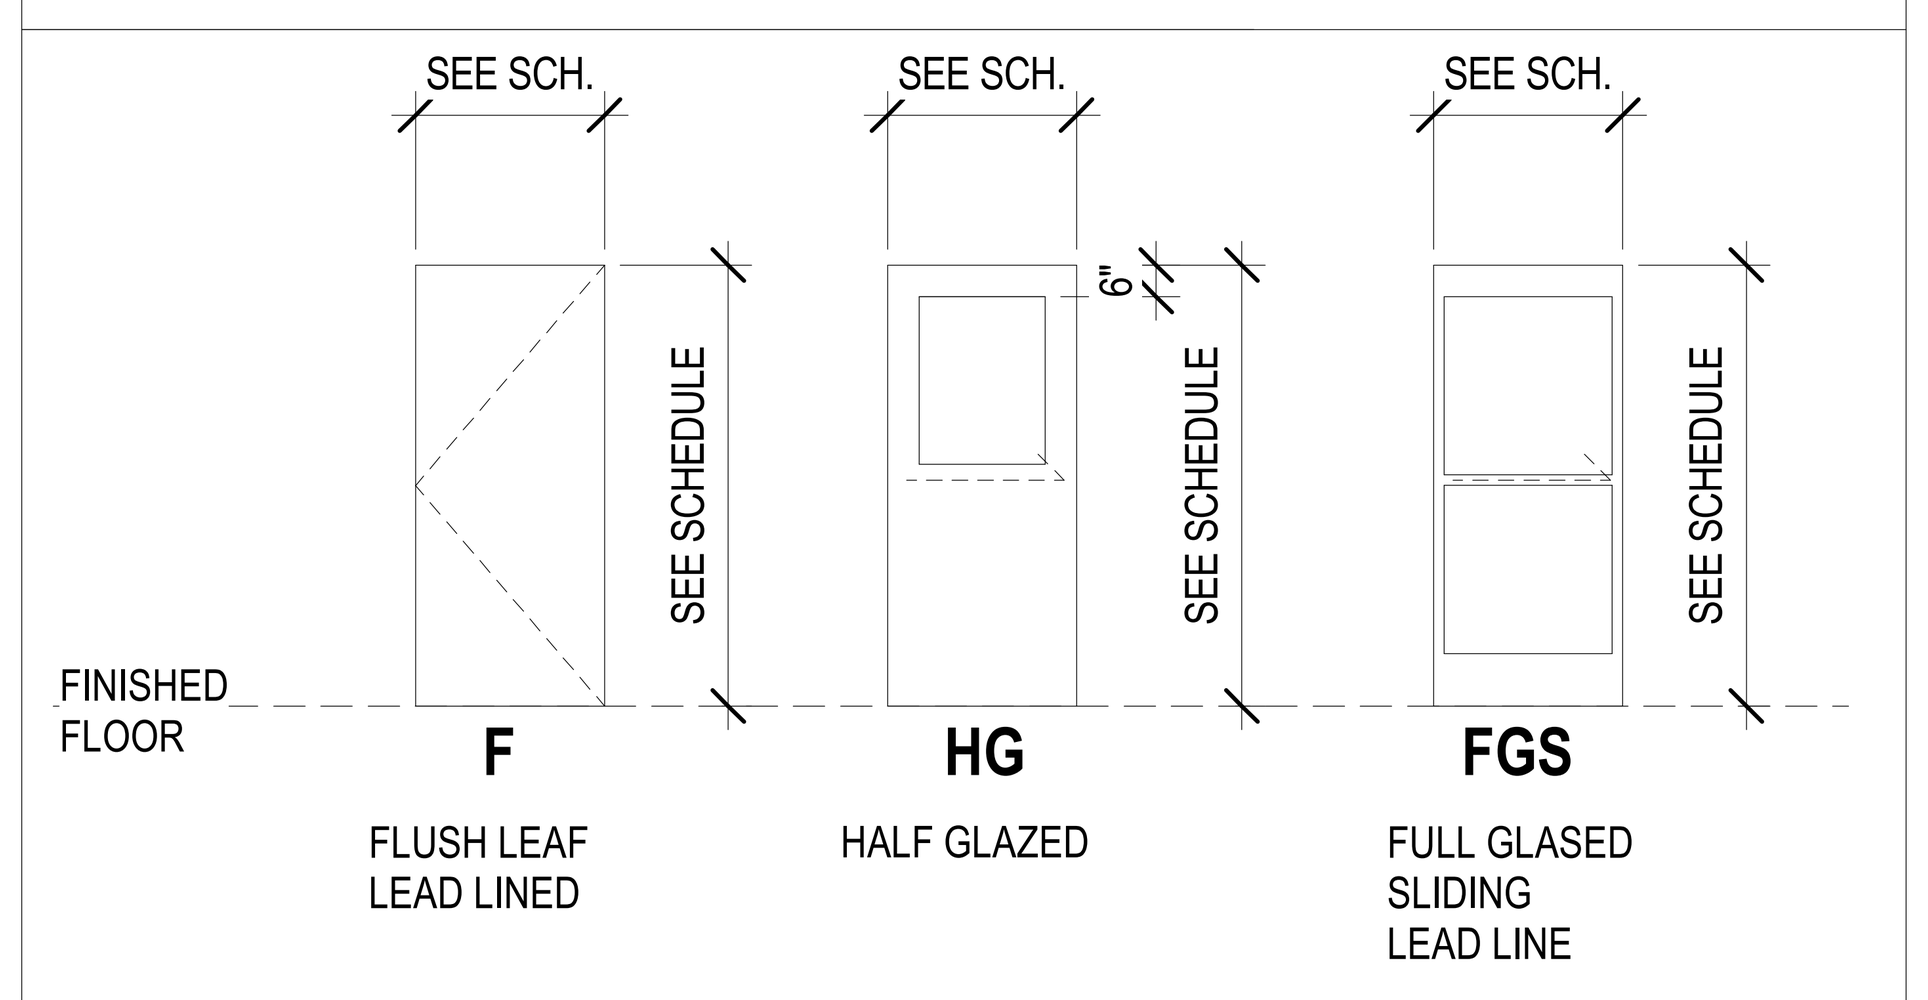

FRAME LEGEND

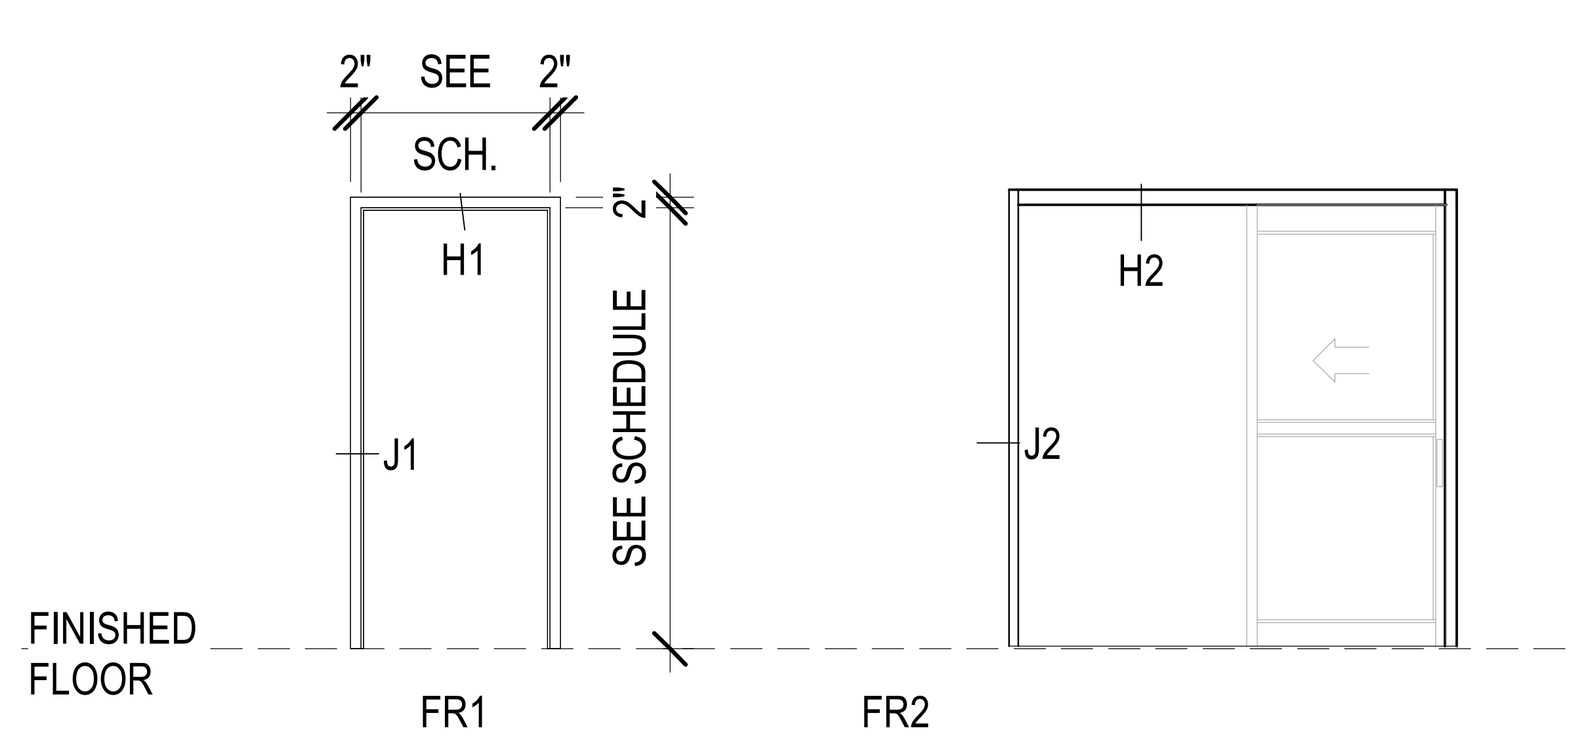

HM1: INTERIOR MTL STUD WALL

DOOR SCHEDULE

NUMBER	LOCATION	DOOR LEAF WIDTH	DOOR LEAF HEIGHT	DOOR LEAF MATERIAL	DOOR LEAF	DOOR FRAME STYLE	DOOR FRAME MATERIAL	FIRE RATING	HARDWARE SET	REMARKS
SECOND FLOOR										
D259	CORRIDOR TO CT SCAN A259 (PAIR)	(1) 2'-0" (2) 4'-0"	7'-0"	WD	F	FR1	HM	-	HW-10E	NOTES 1,2,3,7,8
D259AN	CT SCAN A259 TO CONTROL ROOM A259A	3'-0"	7'-0"	-	-	FR1	HM			NOTE 1 (CASED OPENING
D259AS	CORRIDOR TO CONTROL ROOM A259A	3'-0"	7'-0"	ALUM	FGS	FR2	ALUM	-		PROVIDE SLIDING PANEL HARDWARE PER MNF
D259B	CT EQUIPMENT TO CT SCAN	4'-0"	7'-0"	WD	F	FR1	HM		HW-4K	NOTES 1,2,3, 8

GENERAL DOOR SCHEDULE NOTES:

A. THE FOLLOWING SCHEDULE OF DOORS AND FRAMES IS PREPARED AS A SELECTION OF MATERIALS, CONFIGURATIONS, RATINGS AND DETAILS FOR DOORS, DOOR FRAMES AND OTHER INTERIOR FRAMES. TECHNICAL REQUIREMENTS OF MATERIALS CAN BE FOUND IN THE SPECIFICATIONS.
B. ALL INTERIOR DOORS ARE 1 3/4" THICK UNLESS NOTED OTHERWISE.
C. SEE SPECIFICATIONS FOR HARDWARE SET SCHEDULES.
D. FOR DOOR NUMBERS SEE FLOOR PLANS
E. *SHIELDING WILL NEED TO BE CONFIRMED WITH THE FINAL VA SELECT CT. REFER TO SHIELDING REPORT FOR MINIMUM SHIELDING REQUIRED.

DOOR SCHEDULE NOTES:

1. ALL HM INTERIOR DOOR FRAMES TO BE PAINTED TO MATCH WALL PAINT COLOR.
2. ALL INTERIOR WOOD DOORS TO BE FACTORY STAINED & FINISHED UNLESS NOTED OTHERWISE.
3. ALL DOOR HARDWARE SHALL BE INSTALLED BY CONTRACTOR AND BE COMPATIBLE WITH BEST CORE SYSTEM.
4. * VERIFY DOOR LEAF HEIGHT & WIDTH REQUIREMENTS W/ SLIDING DOOR TRACK MANUFACTURER.
5. THE SLIDE-SWING PANEL SHALL BE PROVIDED WITH POSITIVE LATCH THAT WILL LATCH THIS PANEL IN PLACE WHEN CLOSED. A LEVER HANDLE SHALL BE PROVIDED ON EACH SIDE OF THE SLIDING PANEL TO UNLOCK THE DOOR. HARDWARE BY DOOR MANUFACTURER.
6. DOOR GLAZING TO BE WHITE TRANSLUCENT
7. PROVIDE DOOR KICK PLATE. 3' HIGH
8. LEAD LINED DOOR

DOOR ABBREVIATION. LEGEND

HM	HOLLOW METAL
TEMP	TEMPERED
PR	PAIR
ALUM	ALUMINUM
GL	GLAZING
WD	WOOD

WINDOW ELEVATIONS

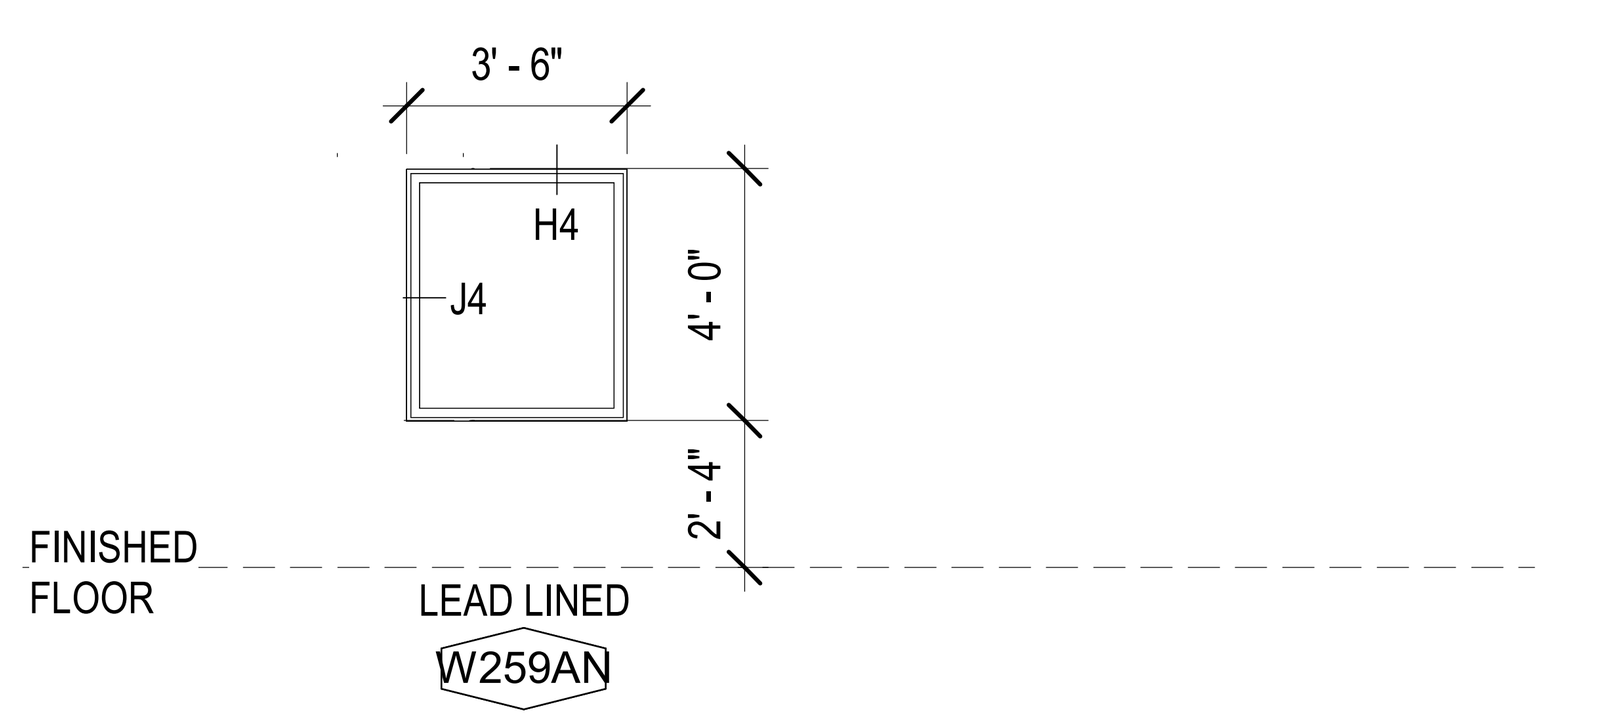

NOTE: SEE SPECIFICATIONS FOR DETAILED DESCRIPTIONS OF THE VARIOUS GLAZING TYPES. ALL WINDOWS TO INCLUDE RADIATION SHIELDED GLAZING.

GLAZING LEGEND

GLAZING TO MEET RADITATION SHIELDING REQUIREMENTS

NOTE: SEE SPECIFICATIONS FOR DETAILED DESCRIPTIONS OF THE VARIOUS GLAZING TYPES.

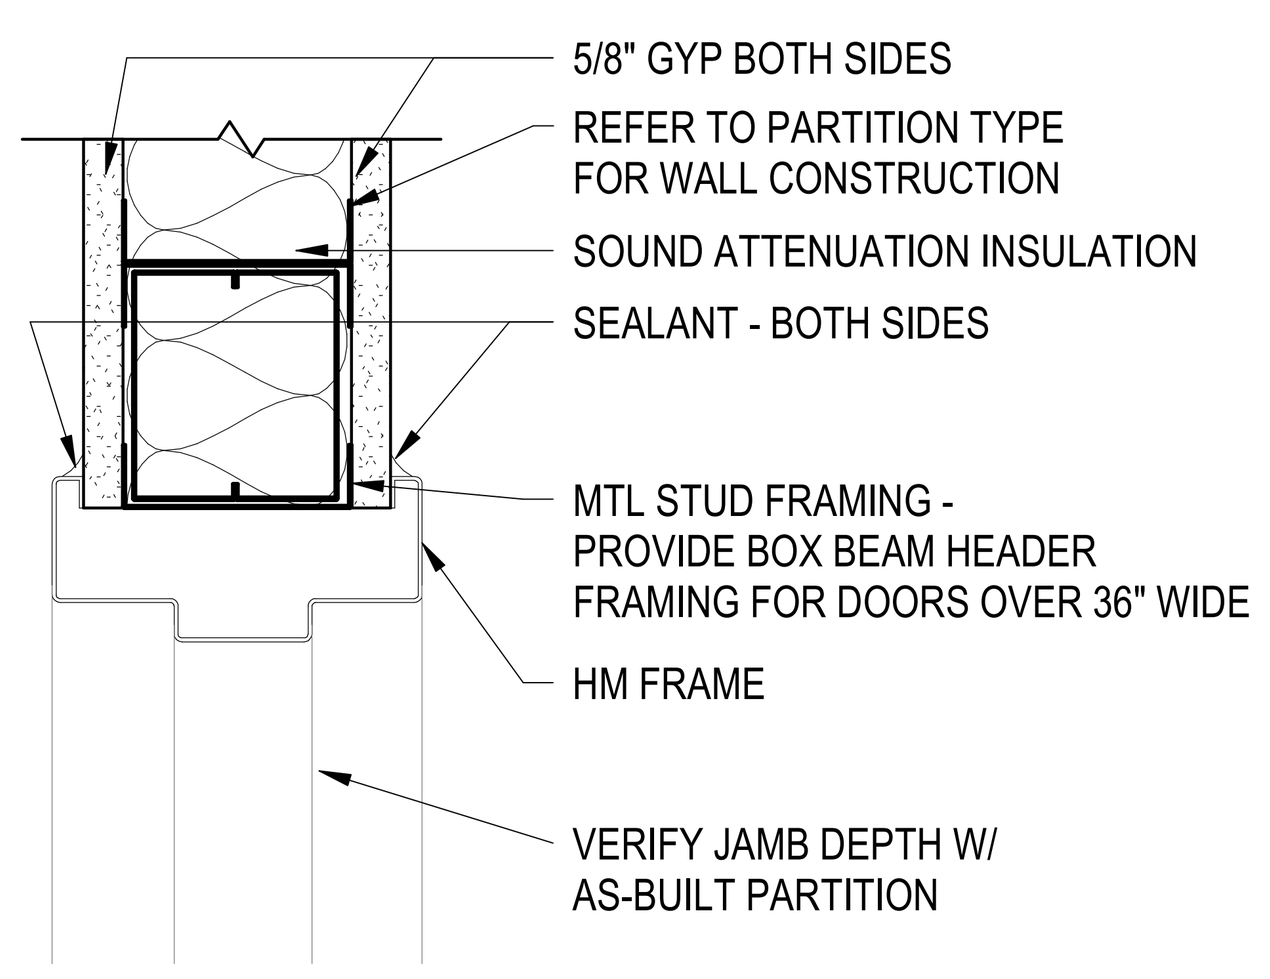

H1 HEADER

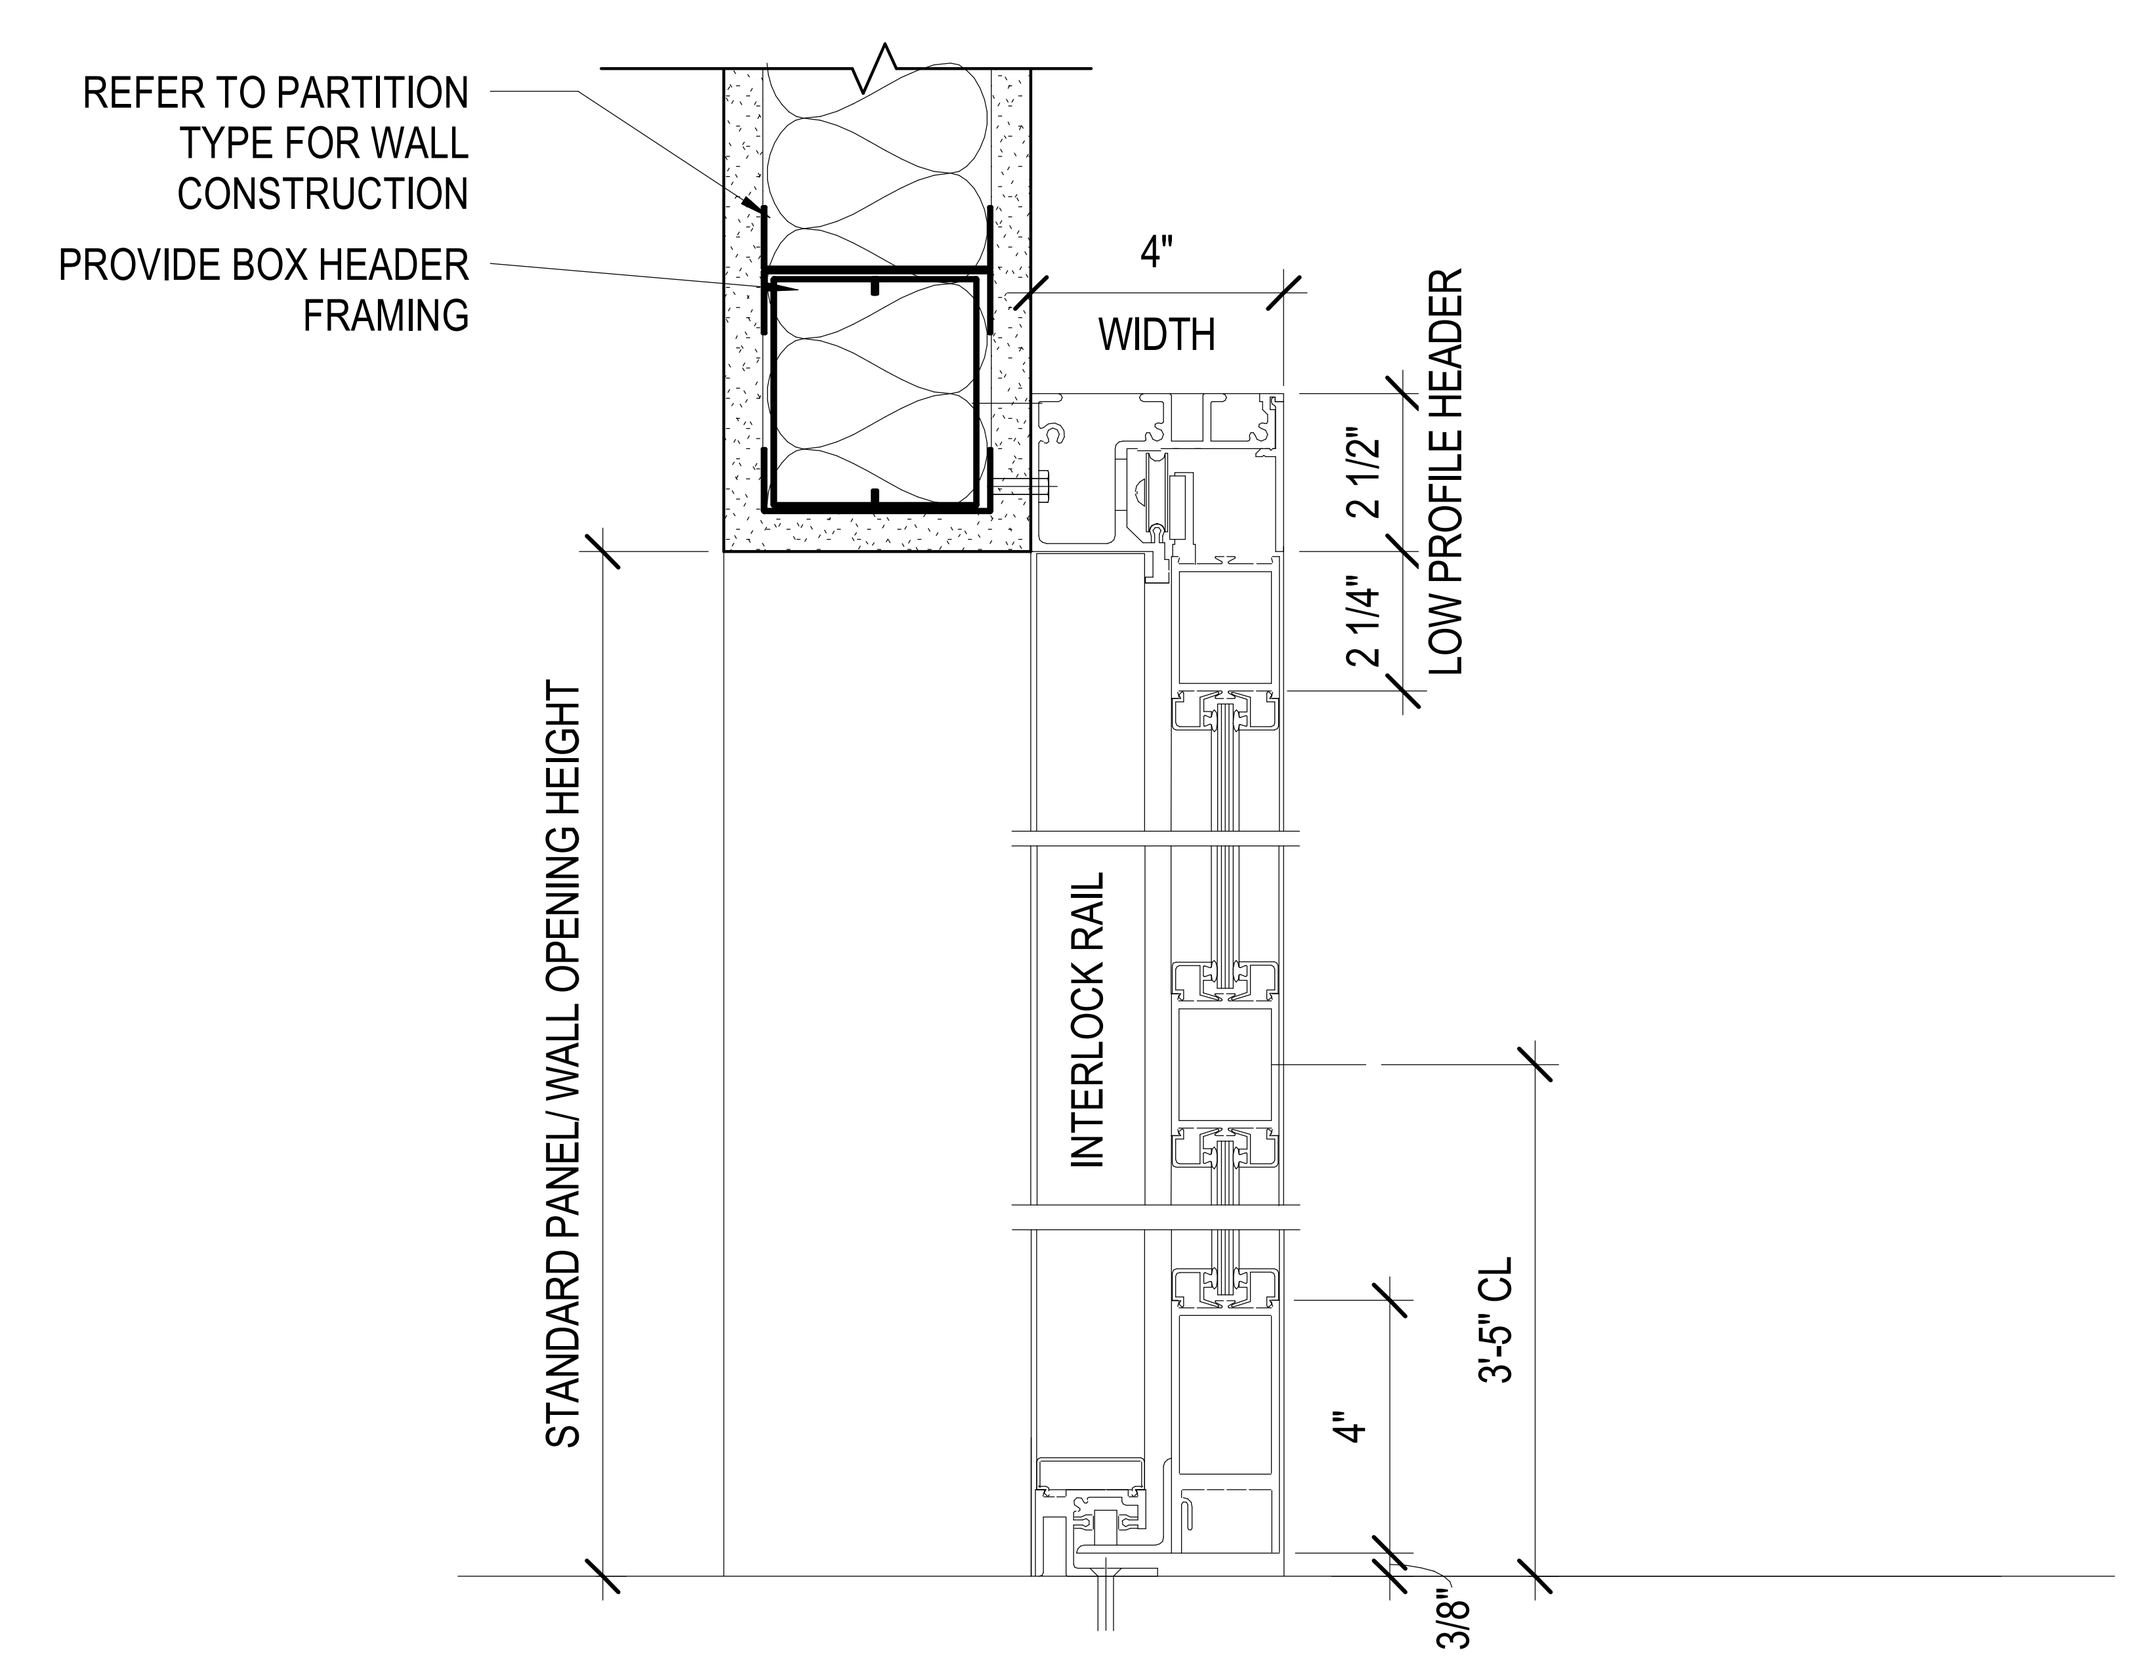

H2 RIGHT HAND VERTICAL SECTION

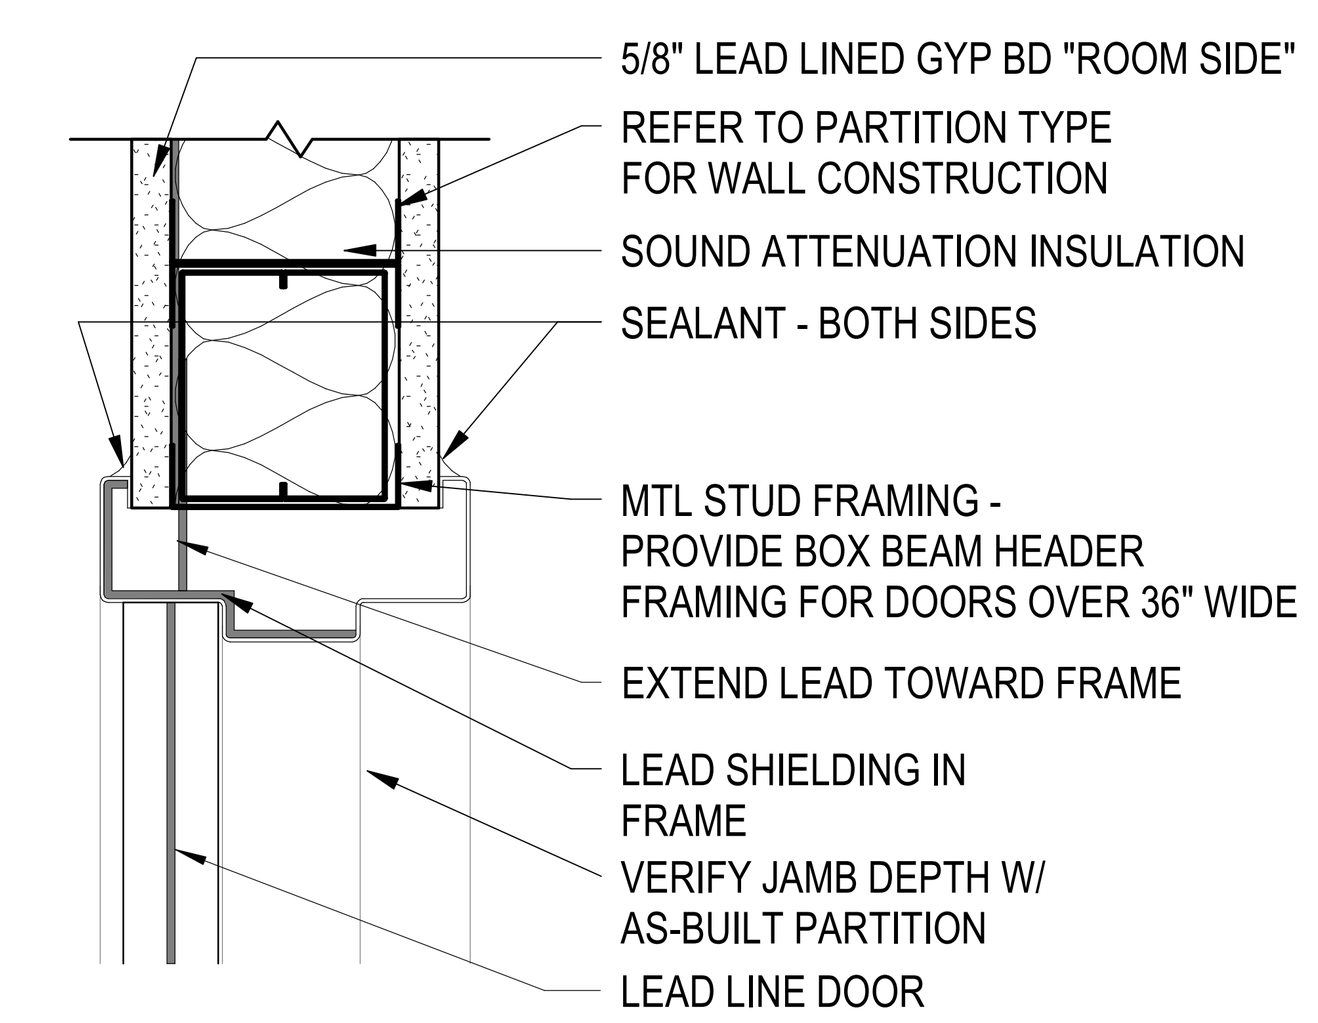

H3 HEADER

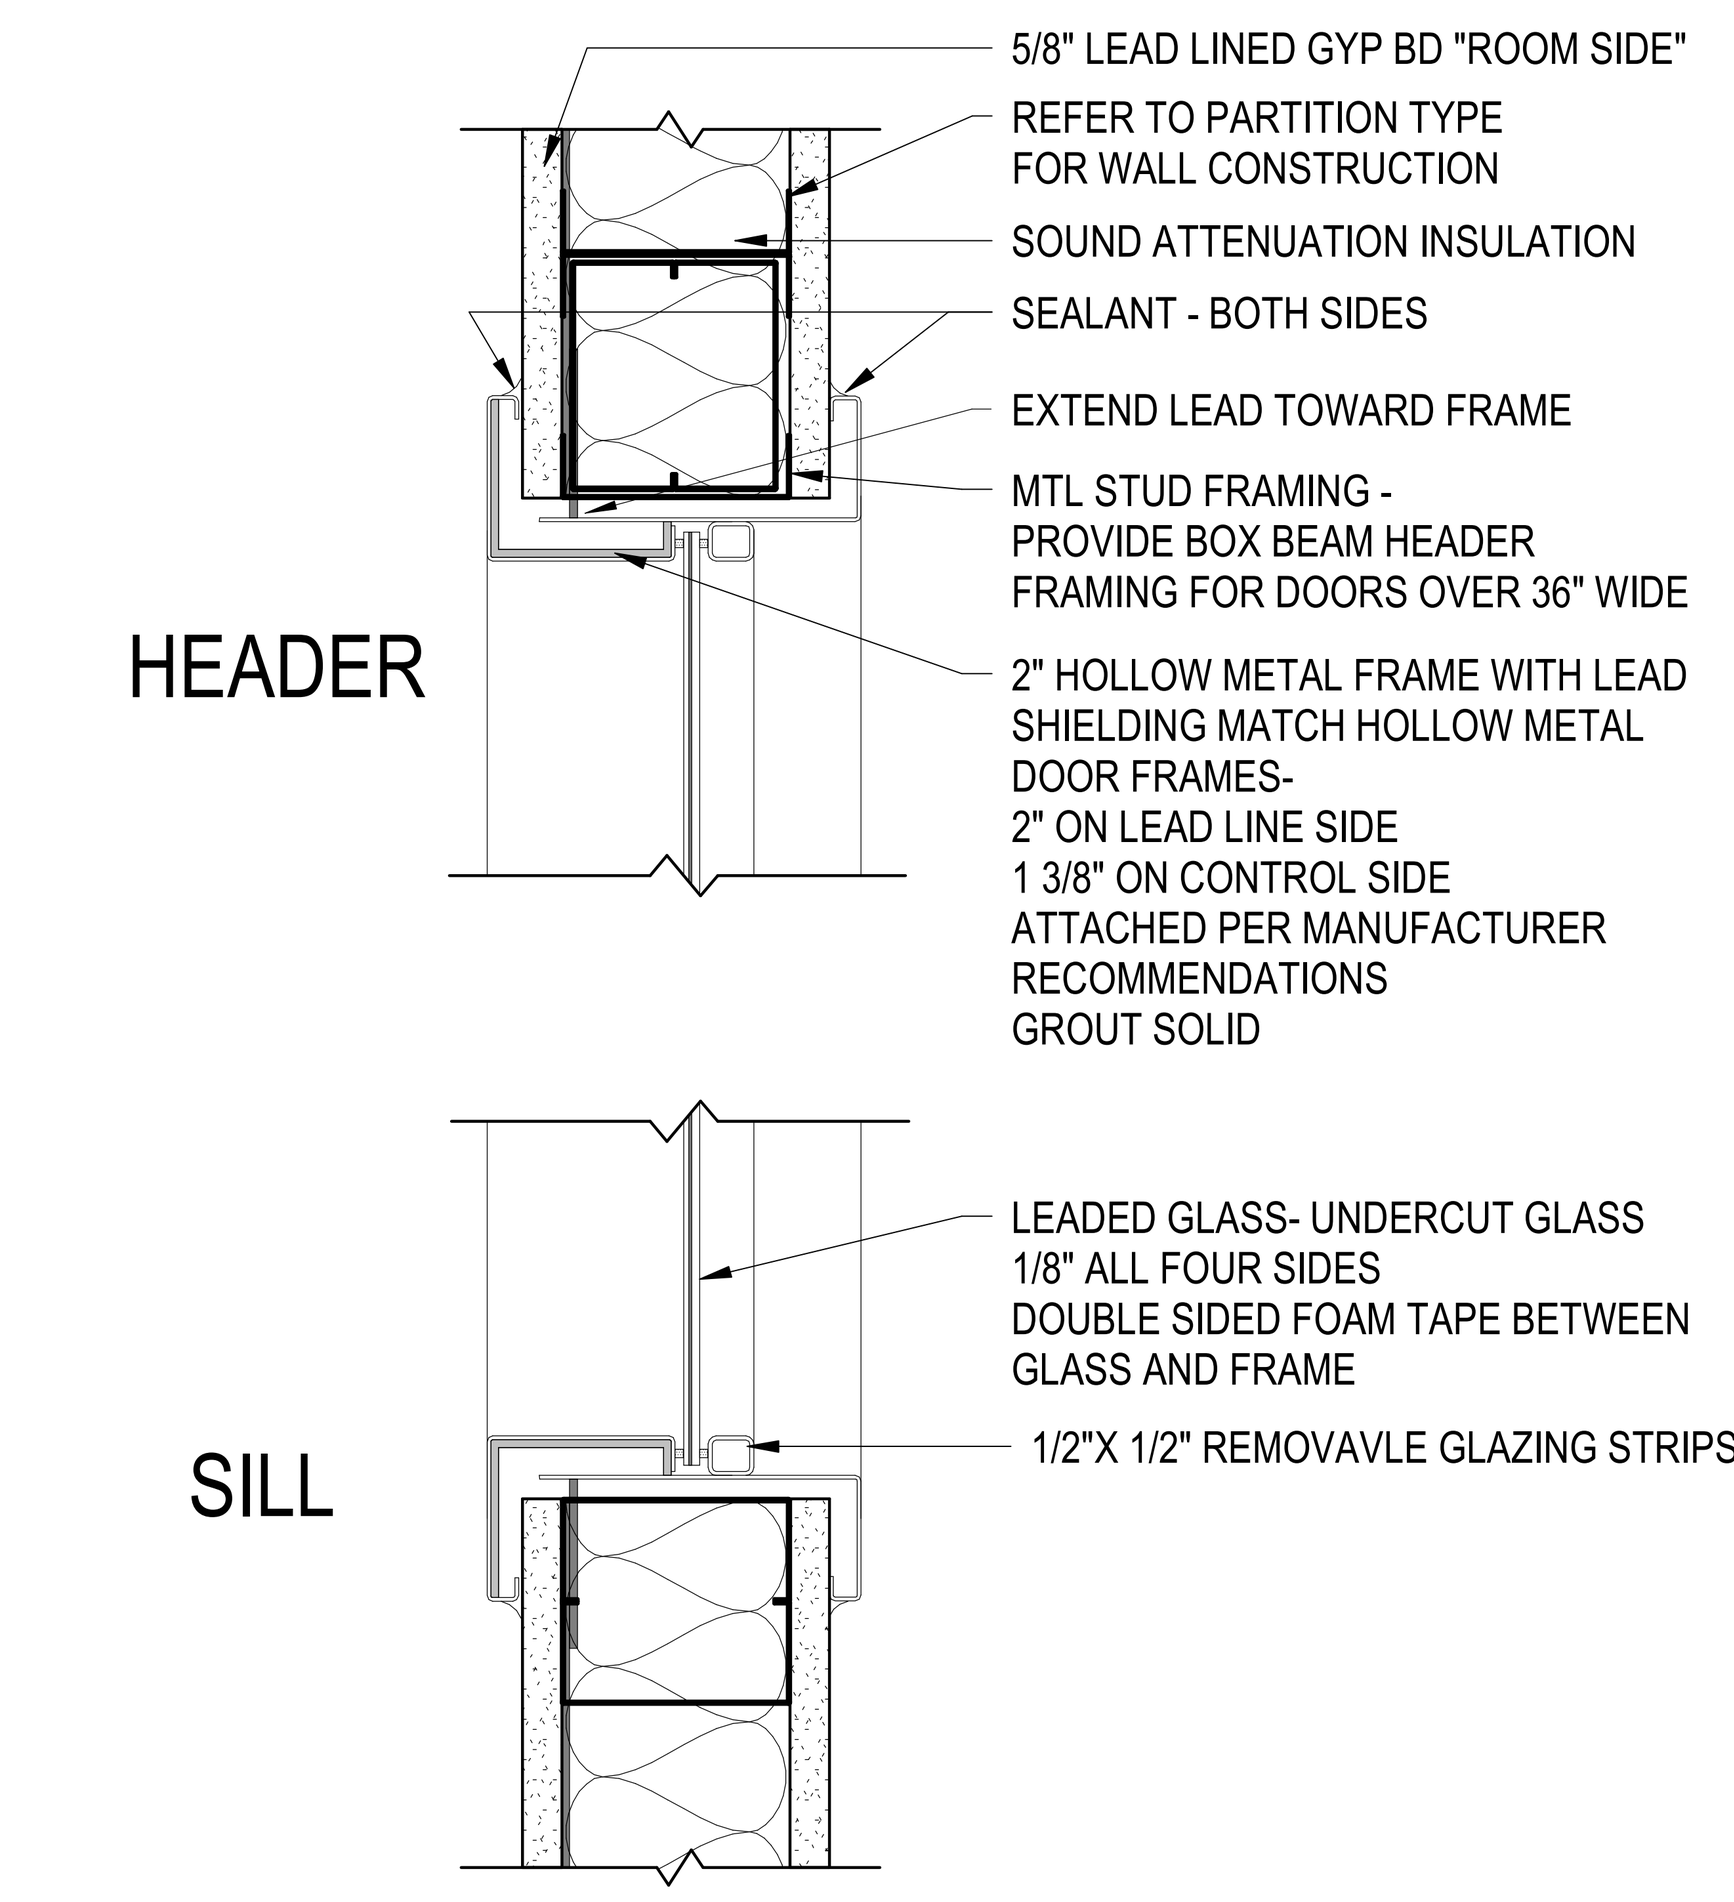

H4

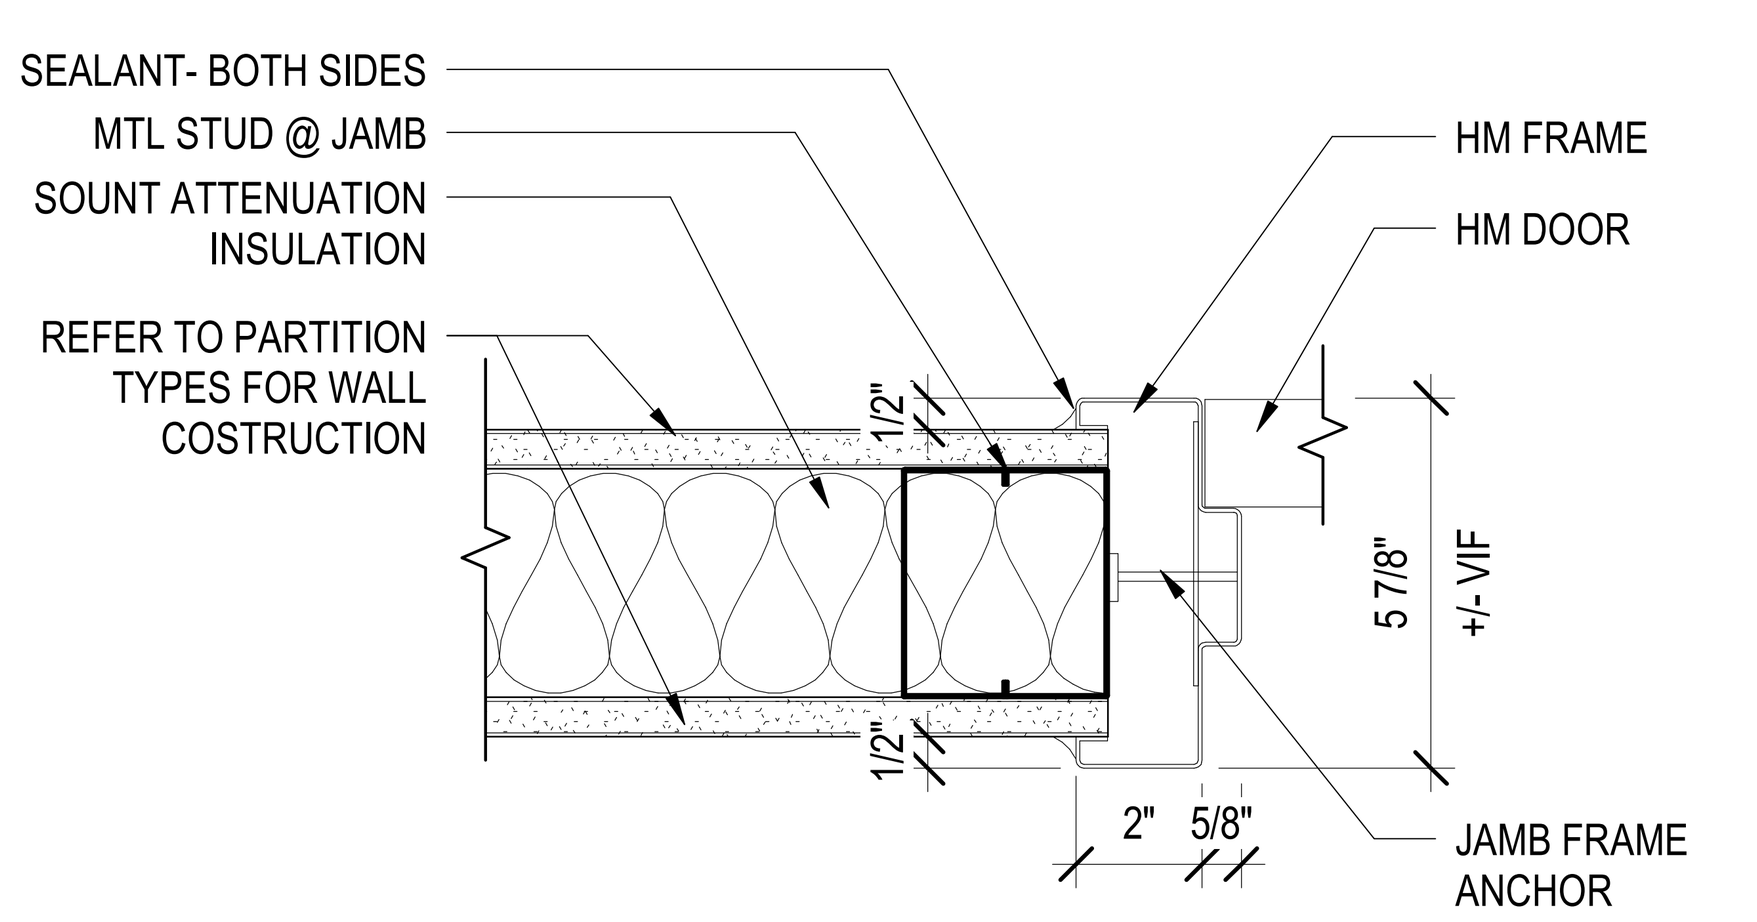

JAMB

J1

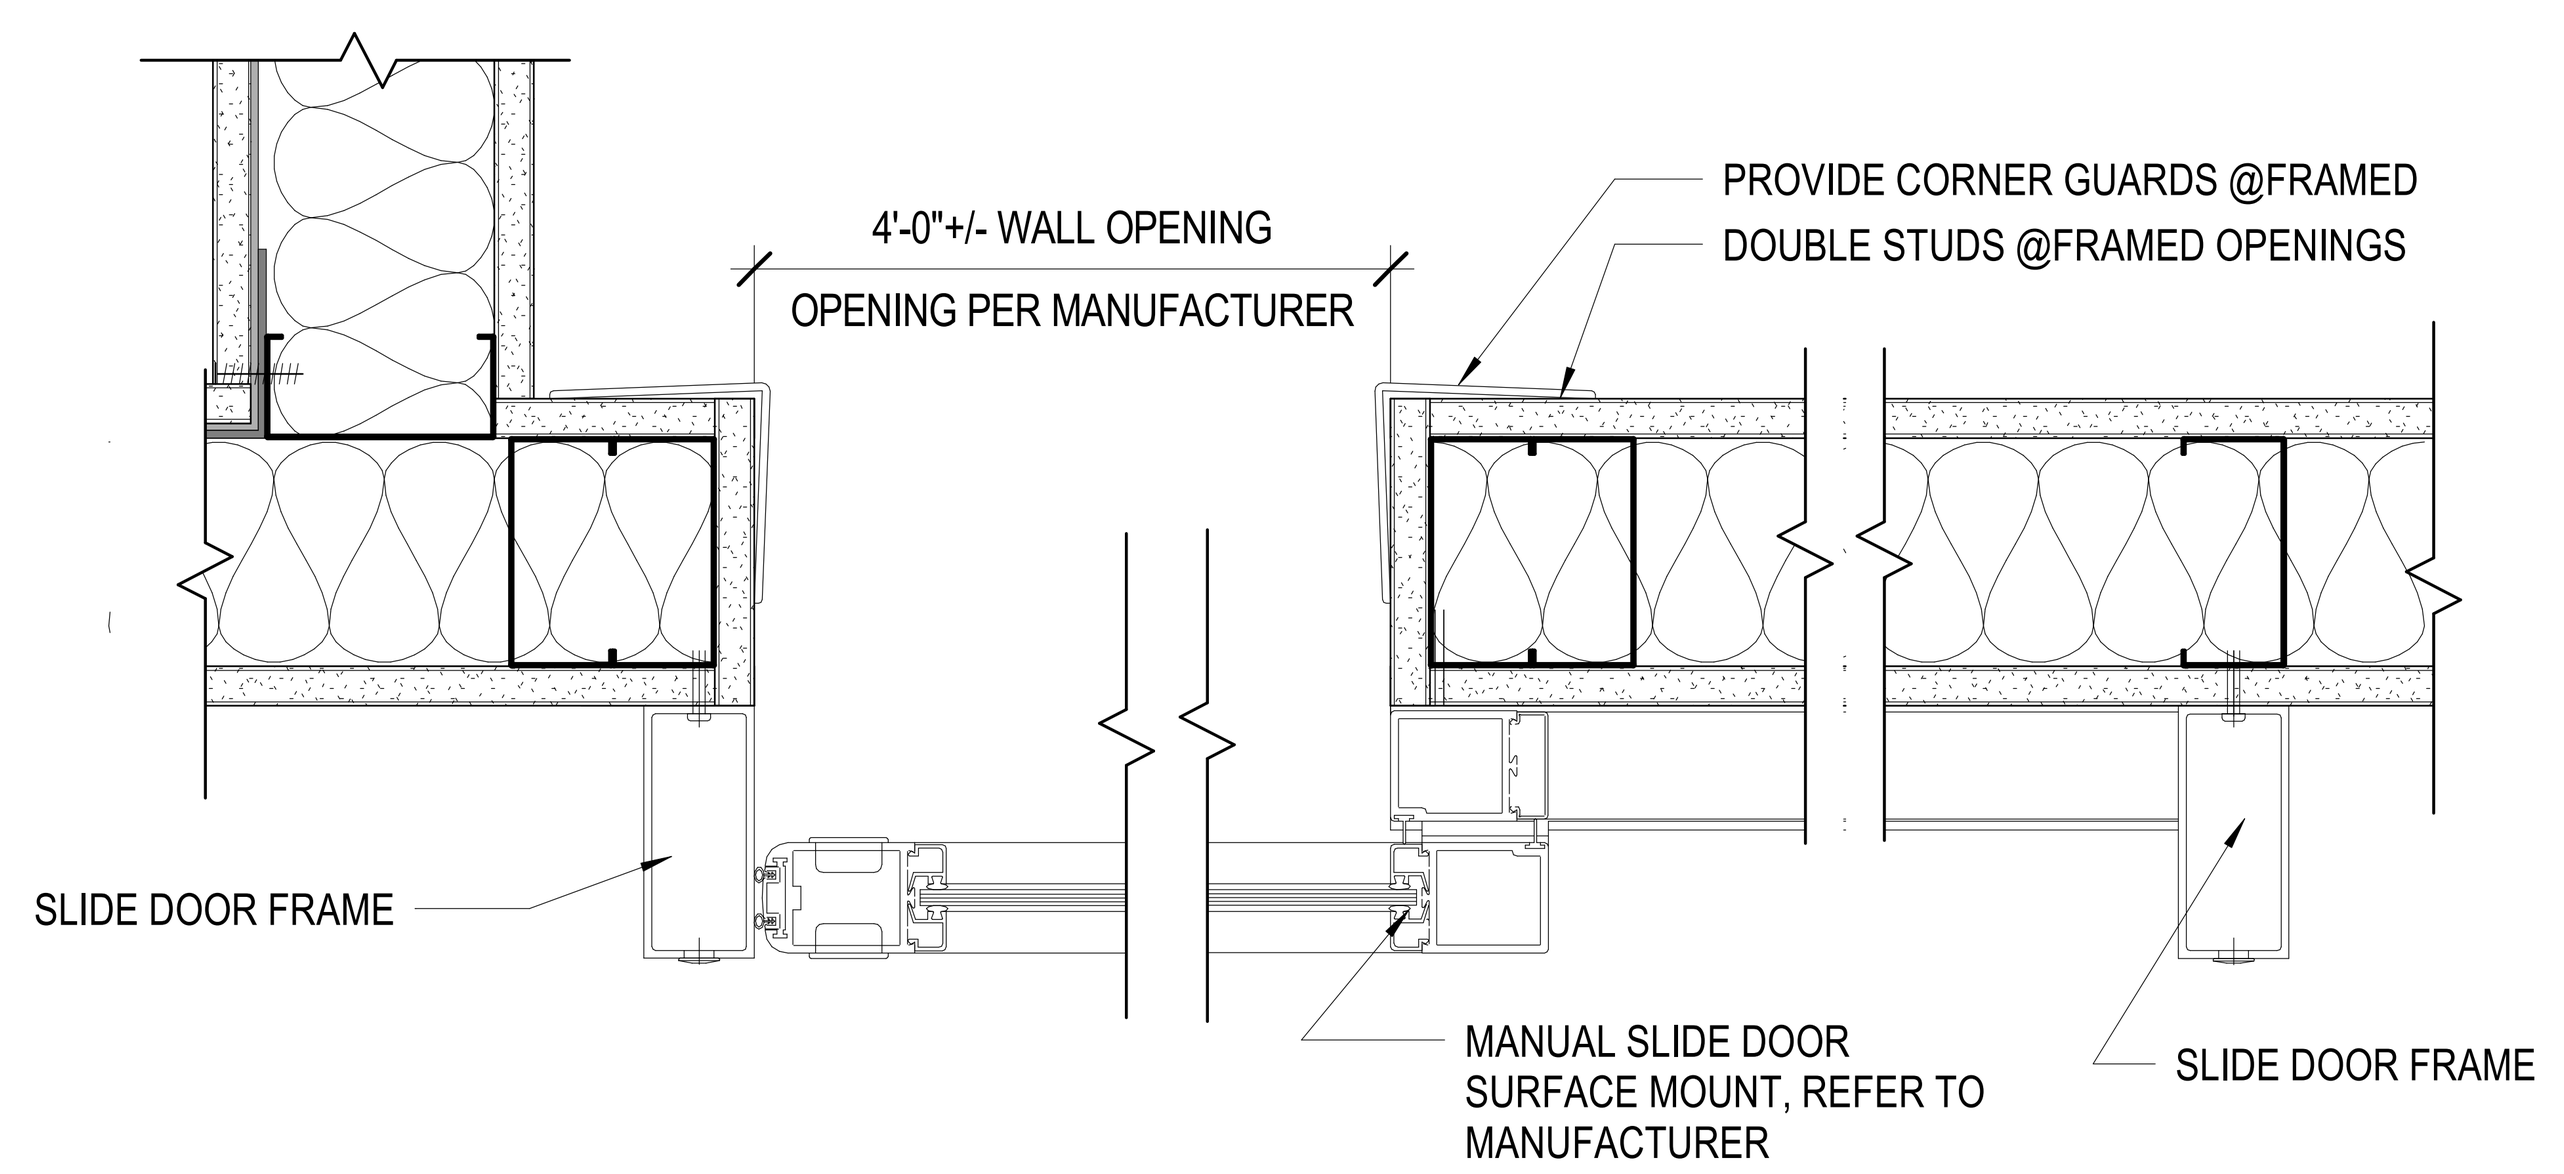

J2 MANUAL SLIDE DOOR SURFACE MOUNT

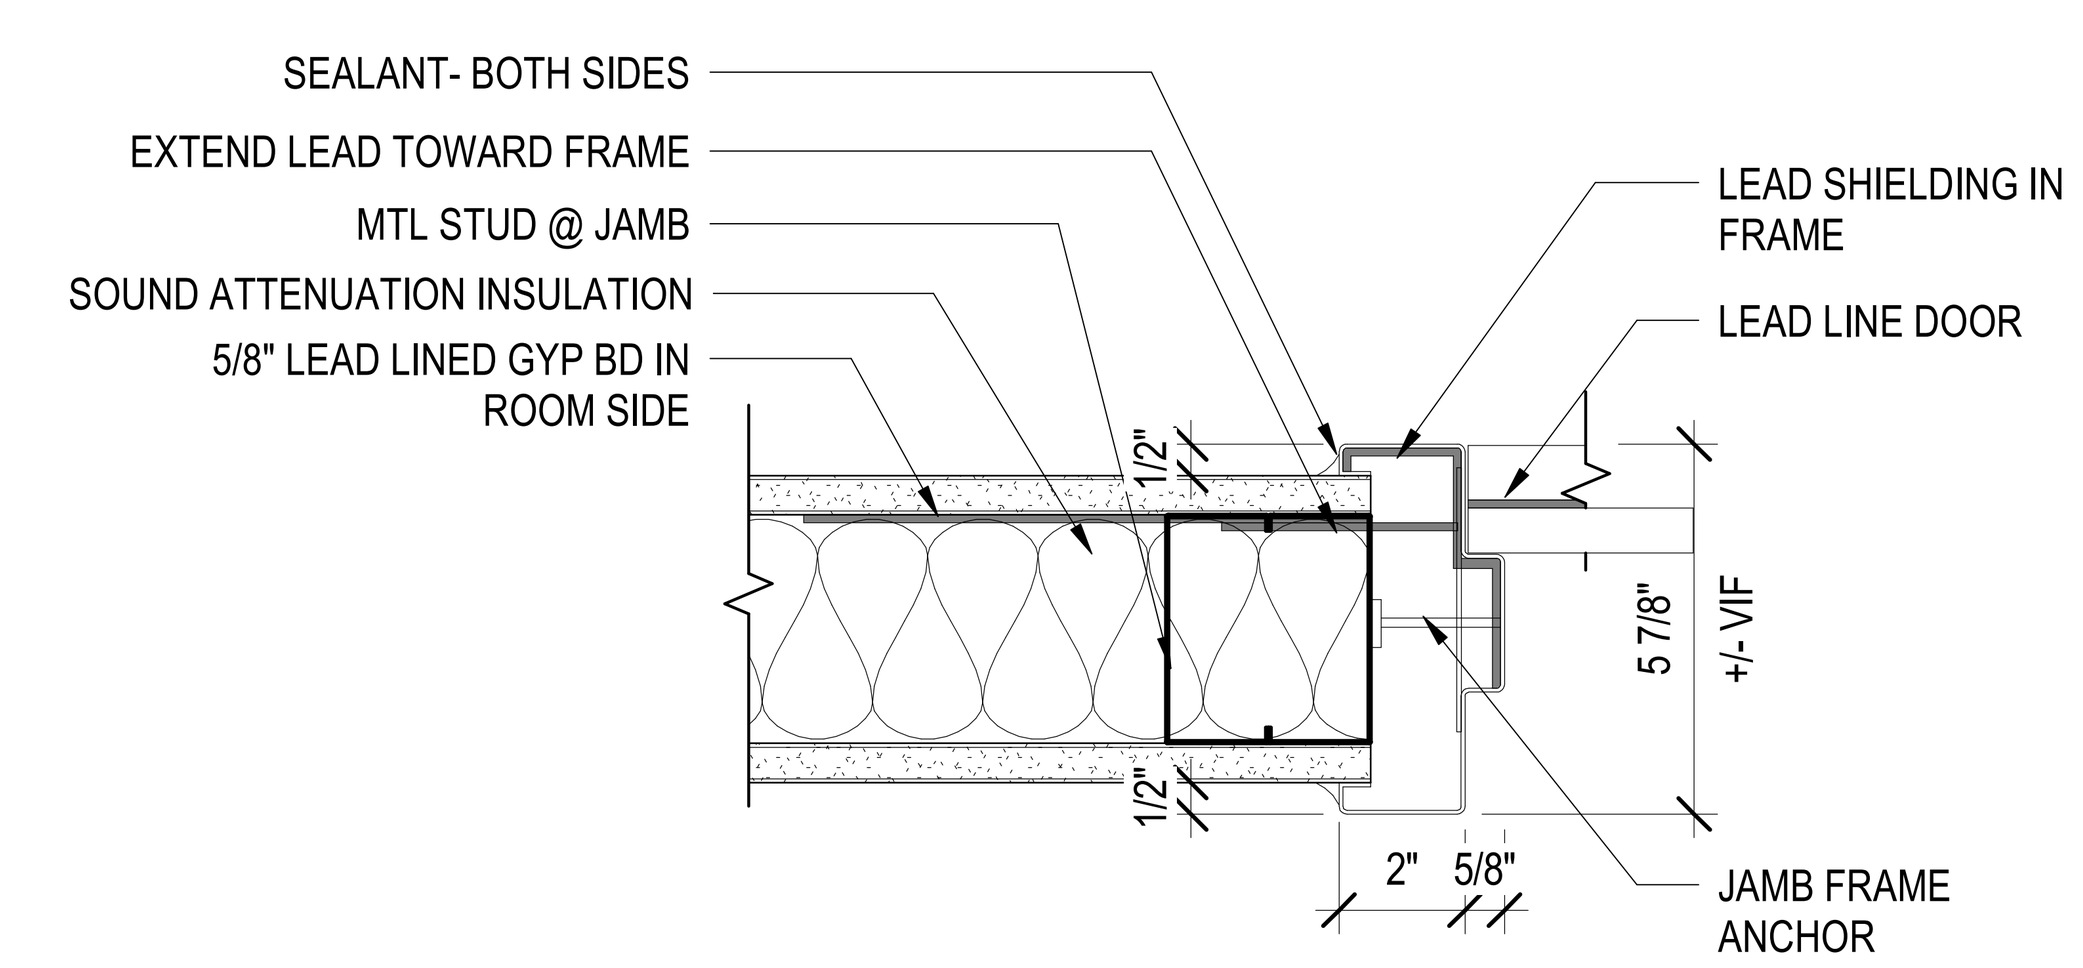

JAMB

J3

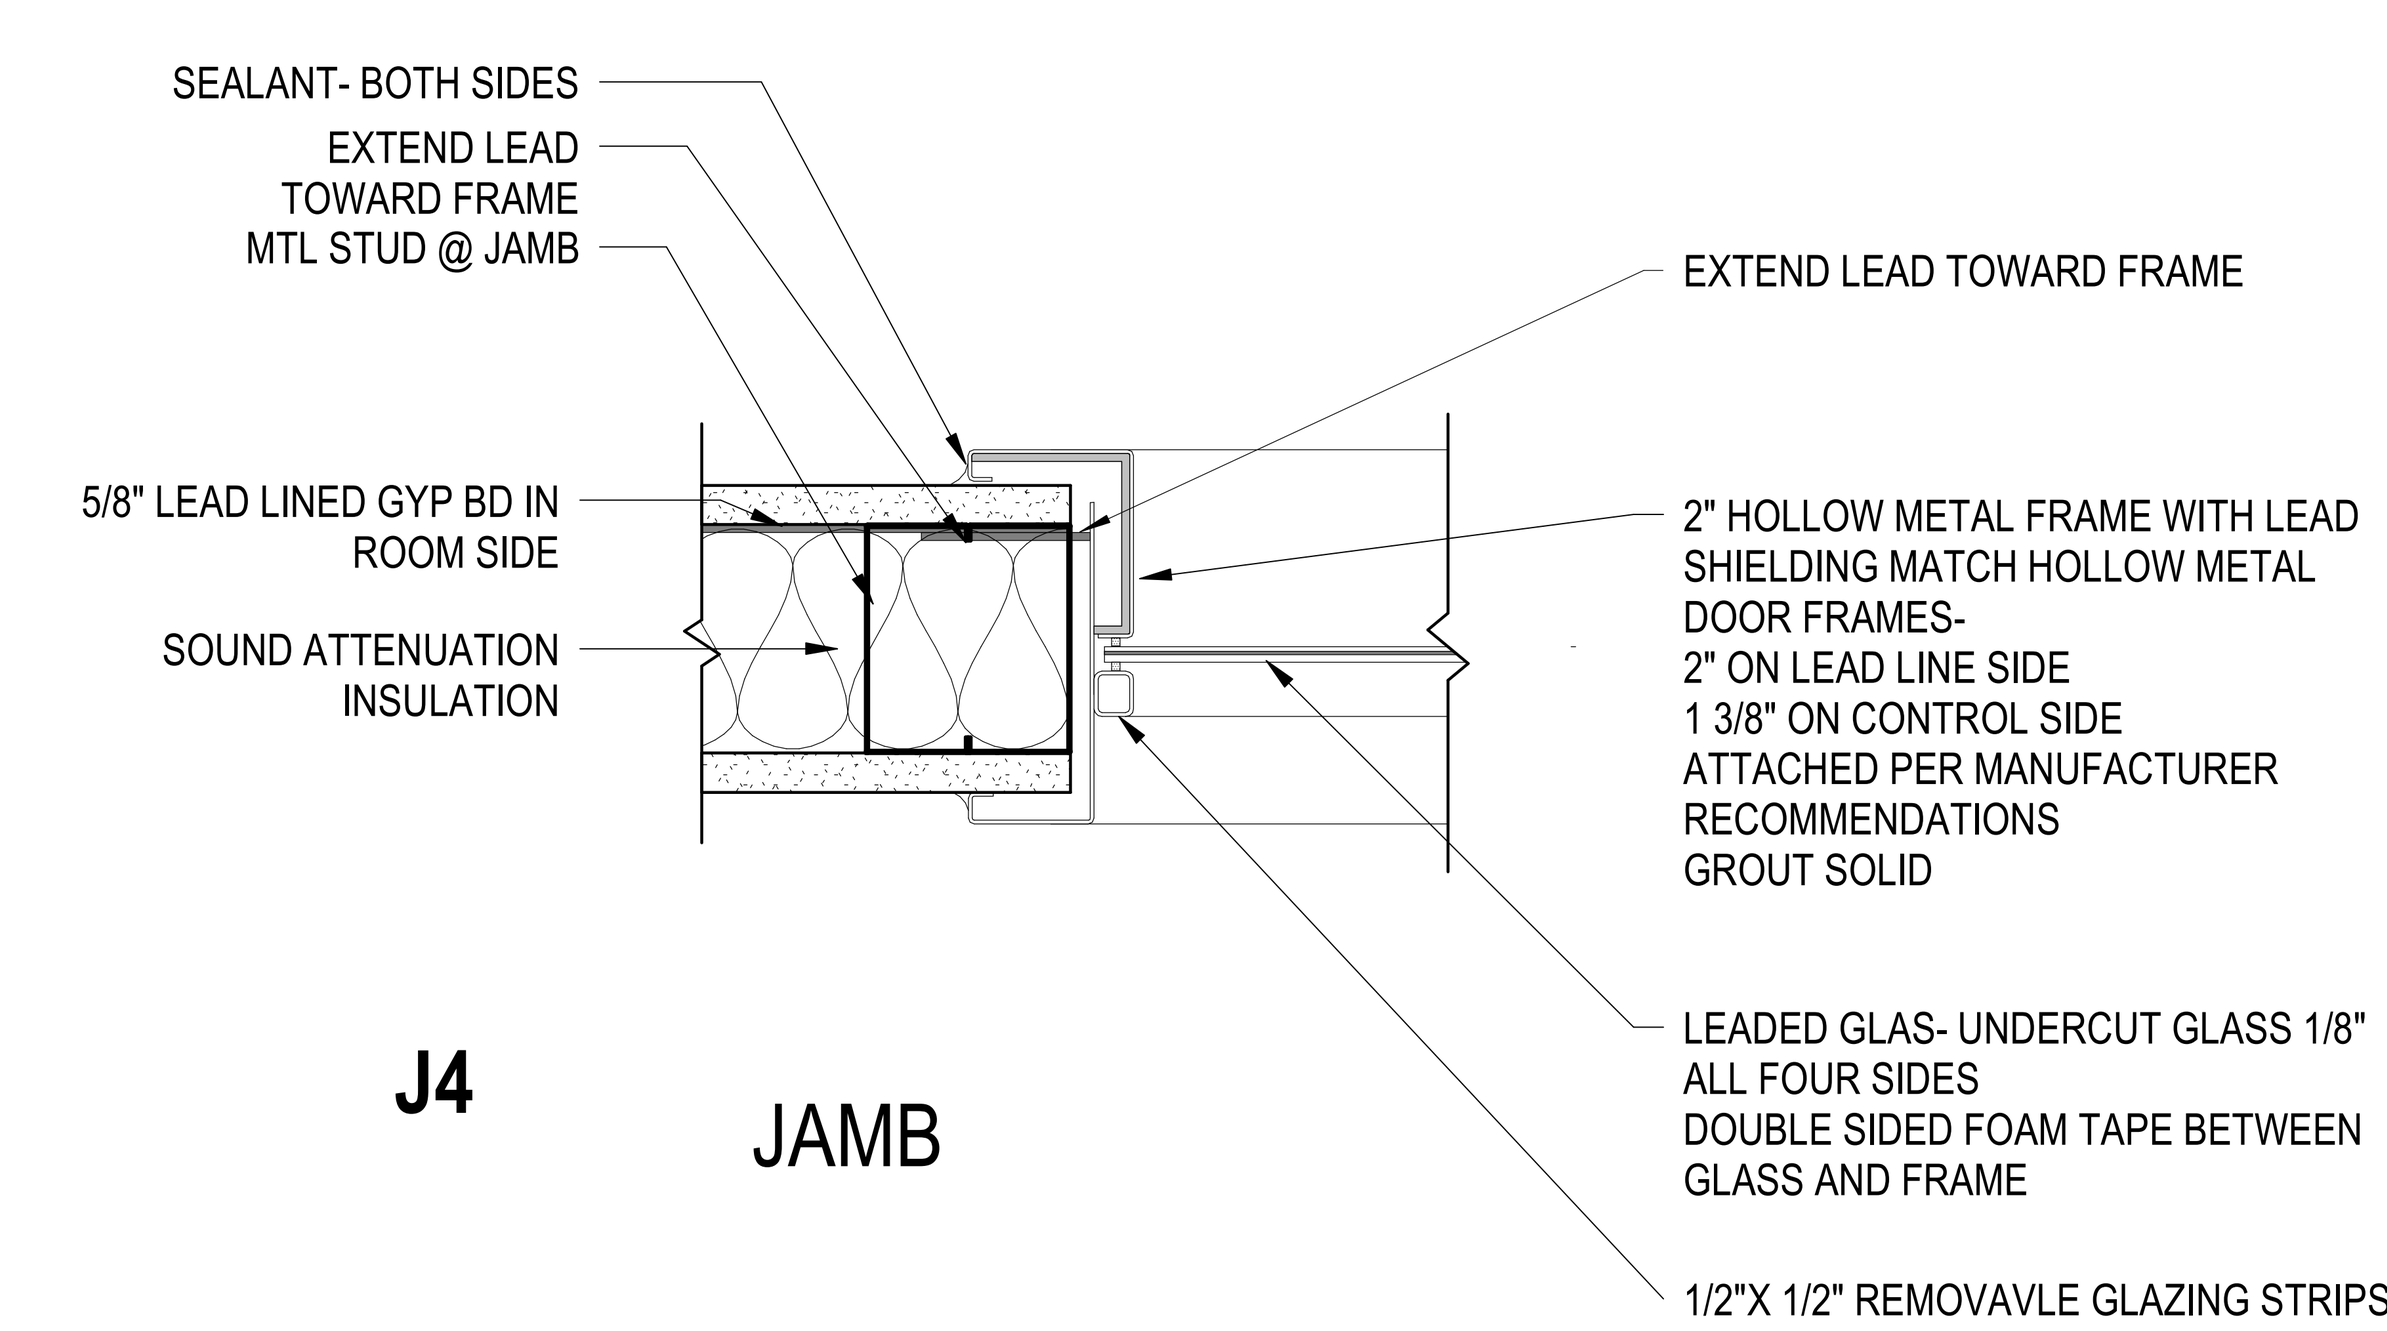

J4 JAMB

LEAD LINE DOOR NOTE:
SHIELDING WILL NEED TO BE CONFIRMED WITH THE FINAL VA SELECT CT. REFER TO SHIELDING REPORT FOR MINIMUM SHIELDING REQUIRED FOR DOOR/ FRAME.

LEAD LINE GLAZING NOTE:
SHIELDING WILL NEED TO BE CONFIRMED WITH THE FINAL VA SELECT CT. REFER TO SHIELDING REPORT FOR MINIMUM SHIELDING REQUIRED.

1 **ONE LAYER GYP BD - HEAD/JAMB DETAIL**
3" = 1'-0"

Revisions: | Date:

CONSULTANT
Above Group ENGINEERING DESIGN CONSULTING
Mabbett Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD
THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP
STATE OF MISSOURI RUSSELL DINARDO NUMBER A - 2024000203 ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)
VA U.S. Department of Veterans Affairs

Drawing Title	DOOR LEGEND, SCHEDULE & DETAILS
Approved:	
Phase	100% CONTRACT DOCUMENTS FOR BIDDING
Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	TB
Drawn	PS
Project Number	657-23-104JC
Building Number	1
Drawing Number	A401

1 CT- FRONT ELEVATION
1/2" = 1'-0"

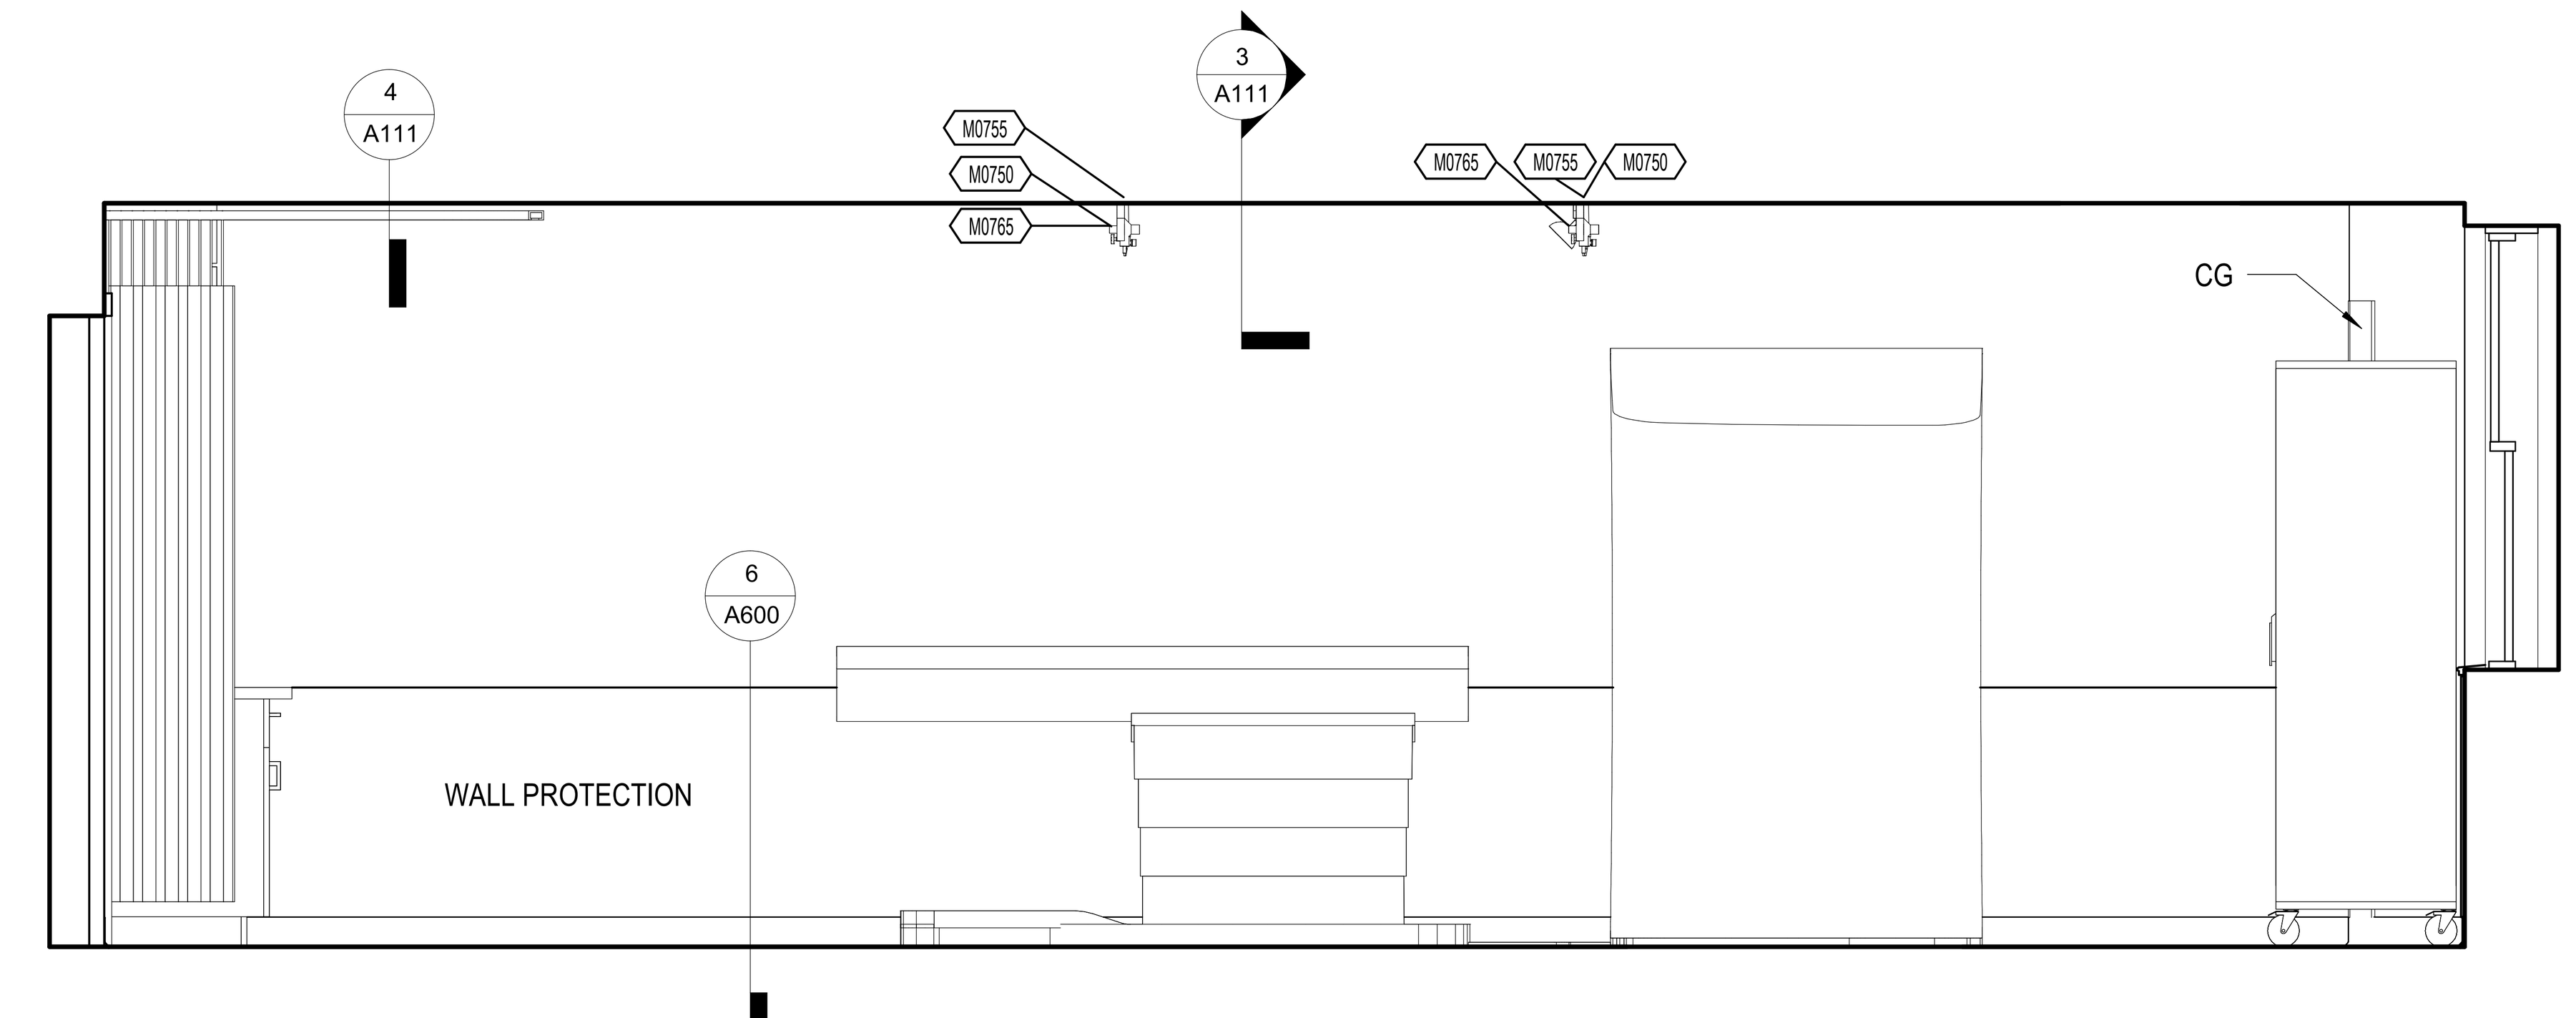

2 CT - WEST ELEVATION
1/2" = 1'-0"

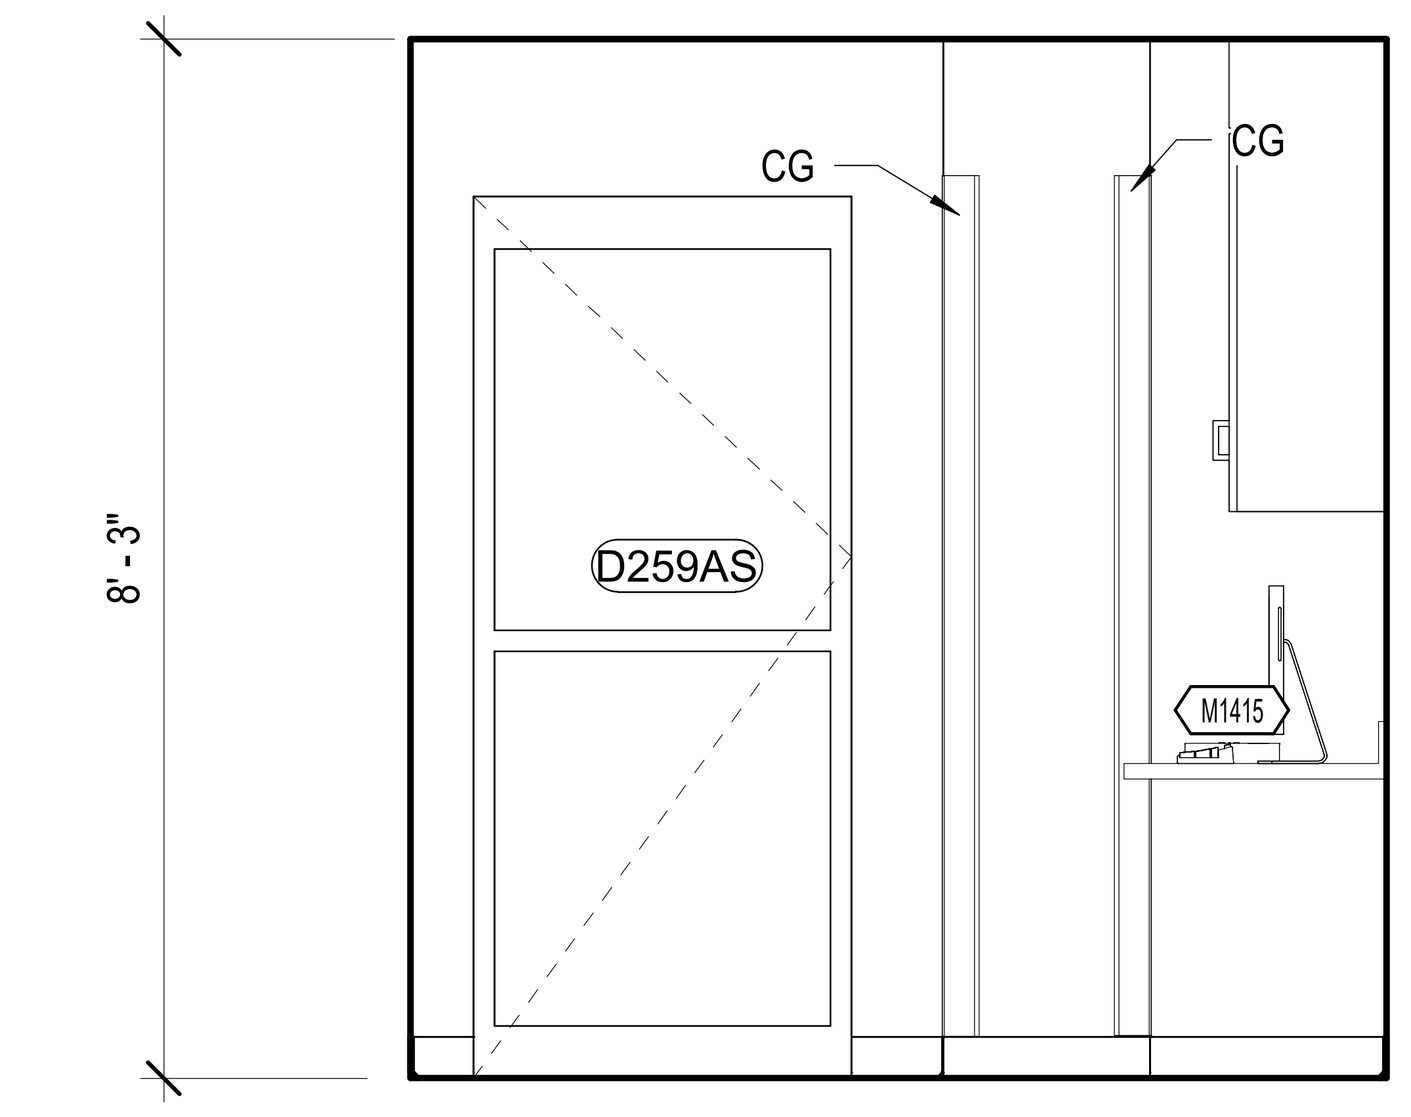

6 CONTROL ROOM SOUTH
1/2" = 1'-0"

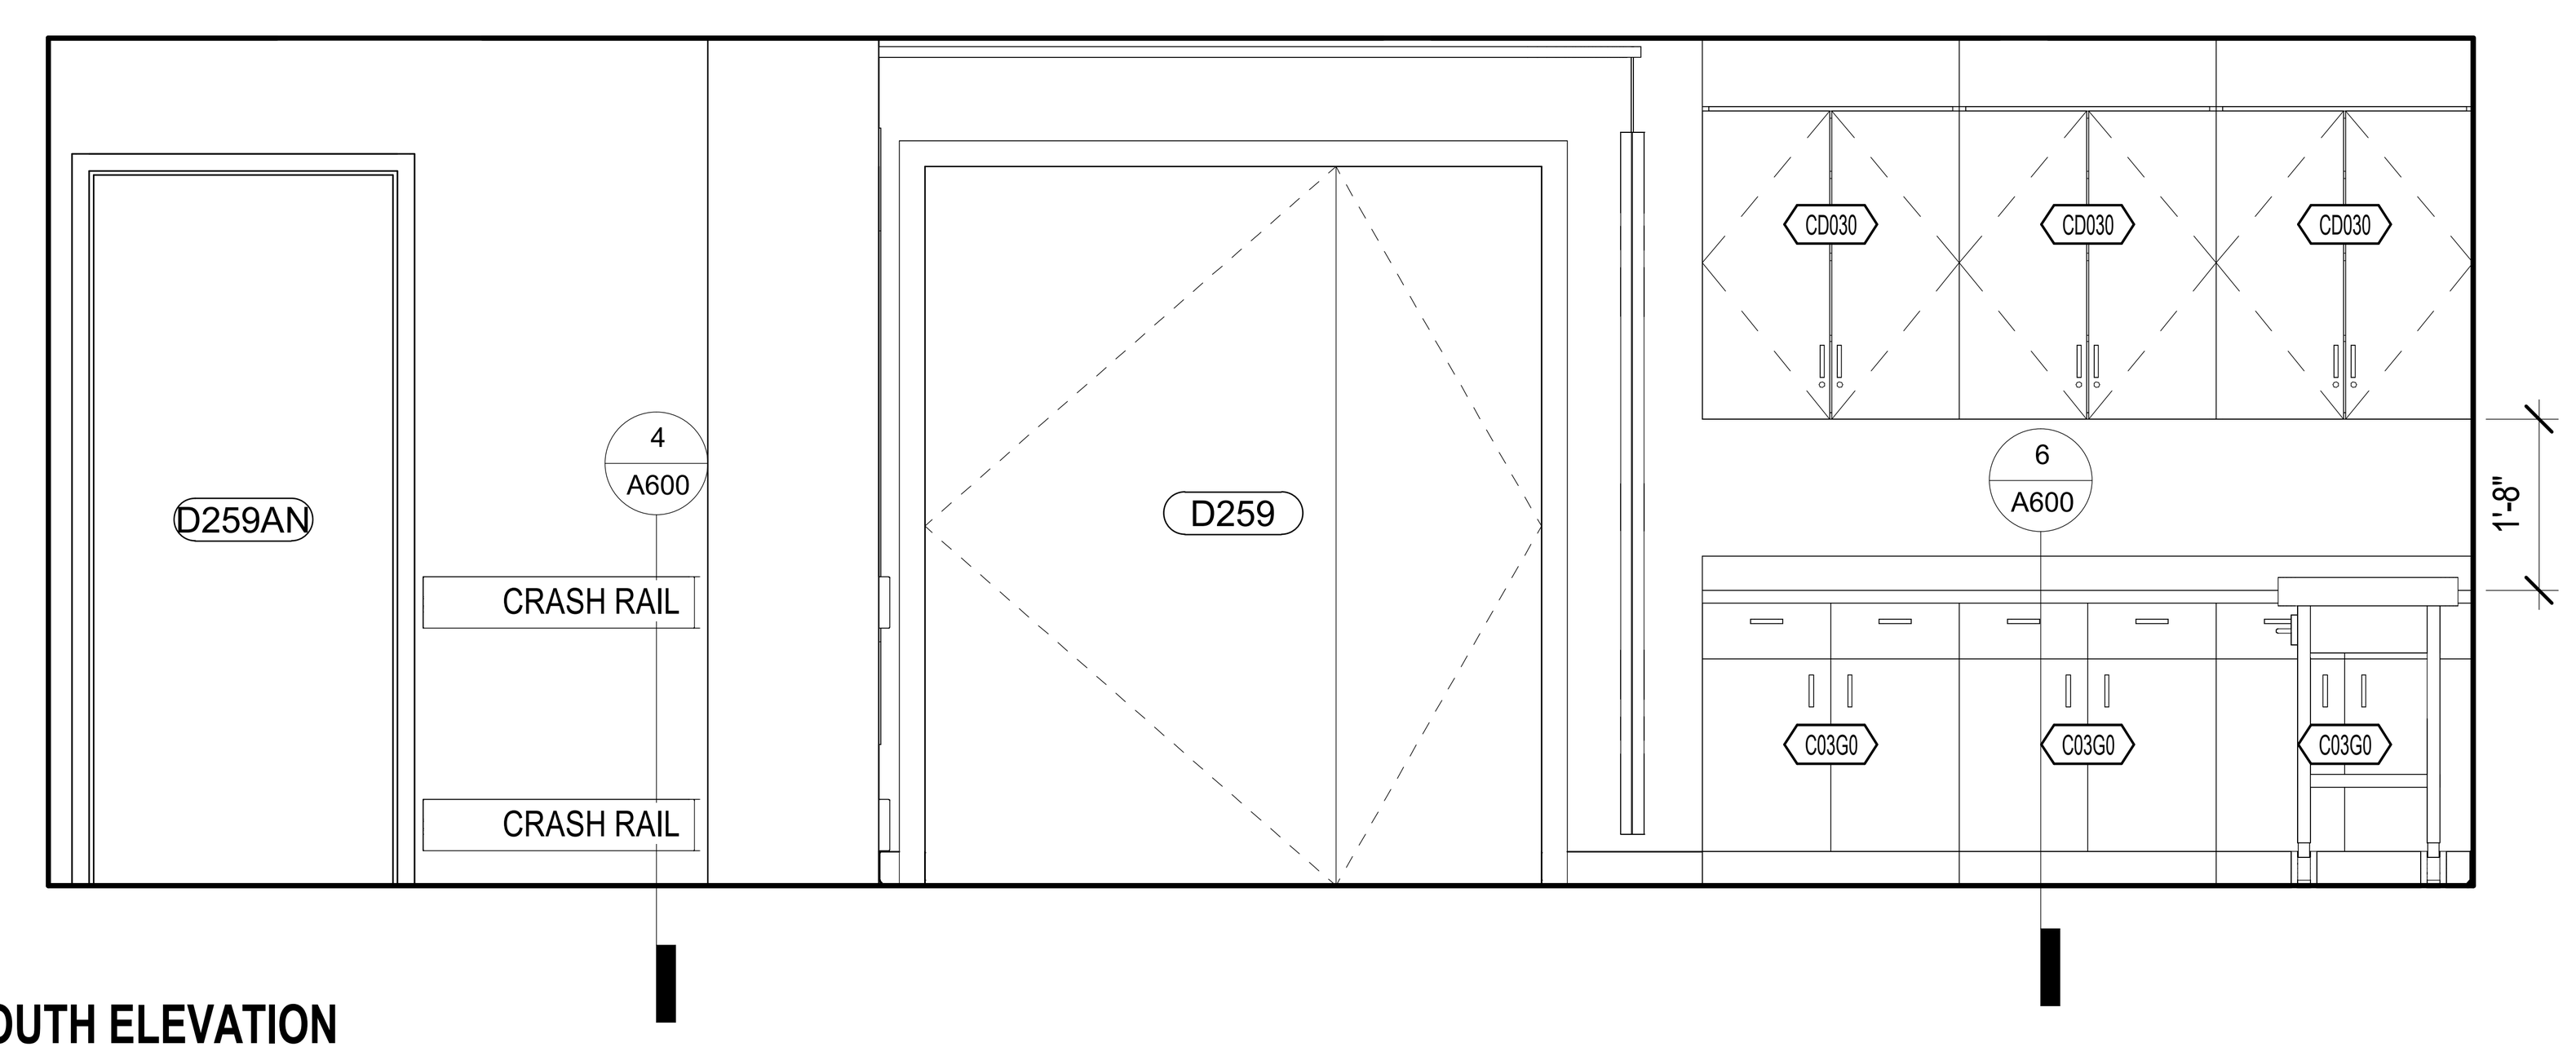

3 CT - SOUTH ELEVATION
1/2" = 1'-0"

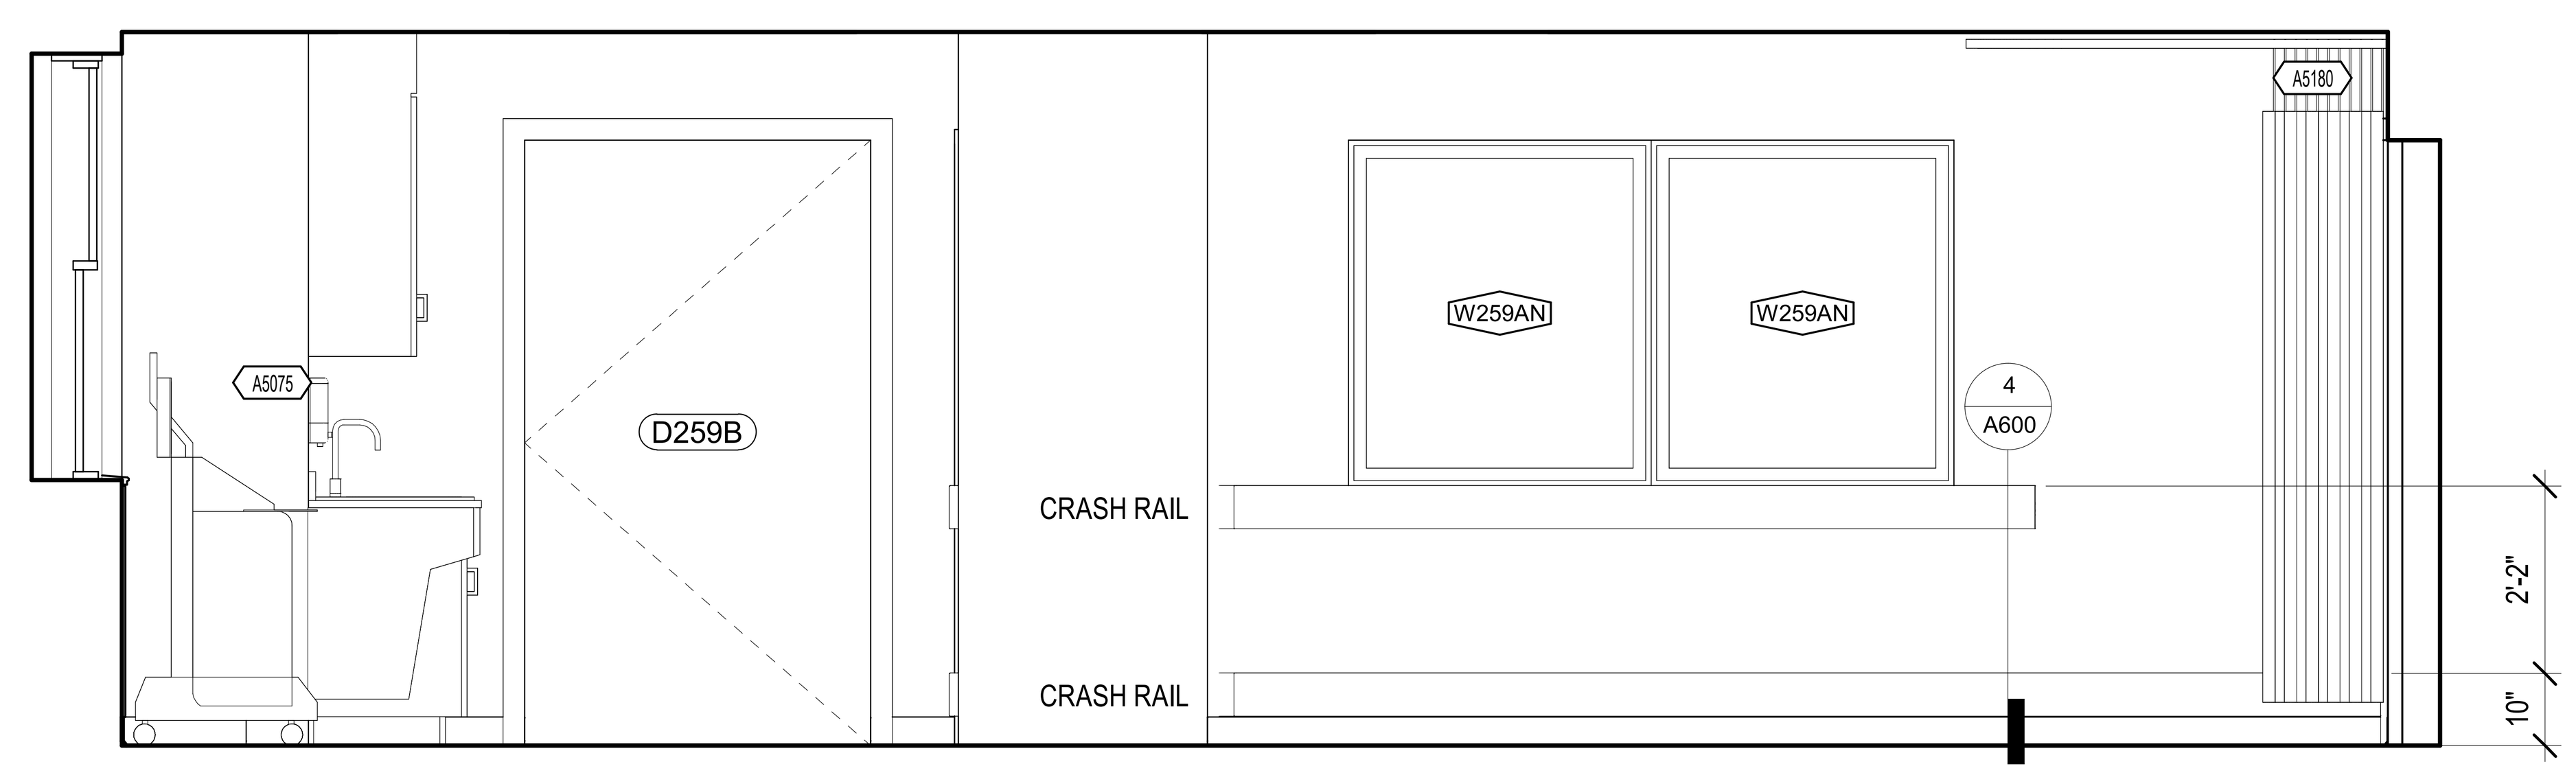

4 CT - EAST ELEVATION
1/2" = 1'-0"

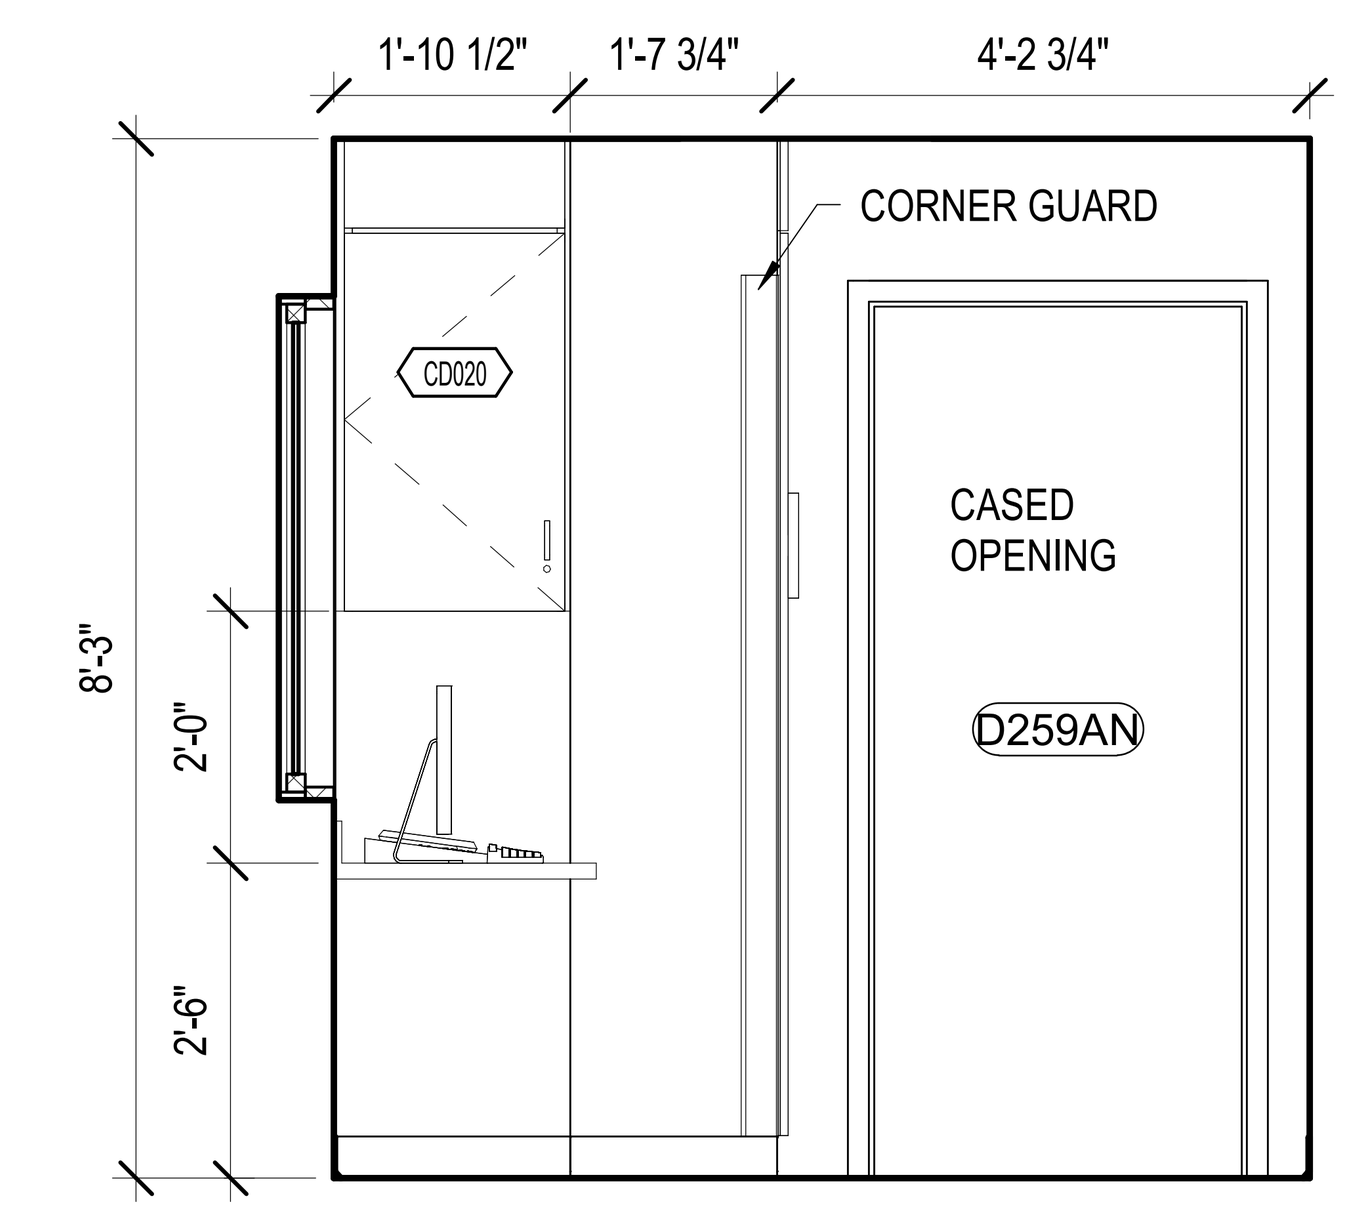

7 CONTROL ROOM - NORTH ELEVATION
1/2" = 1'-0"

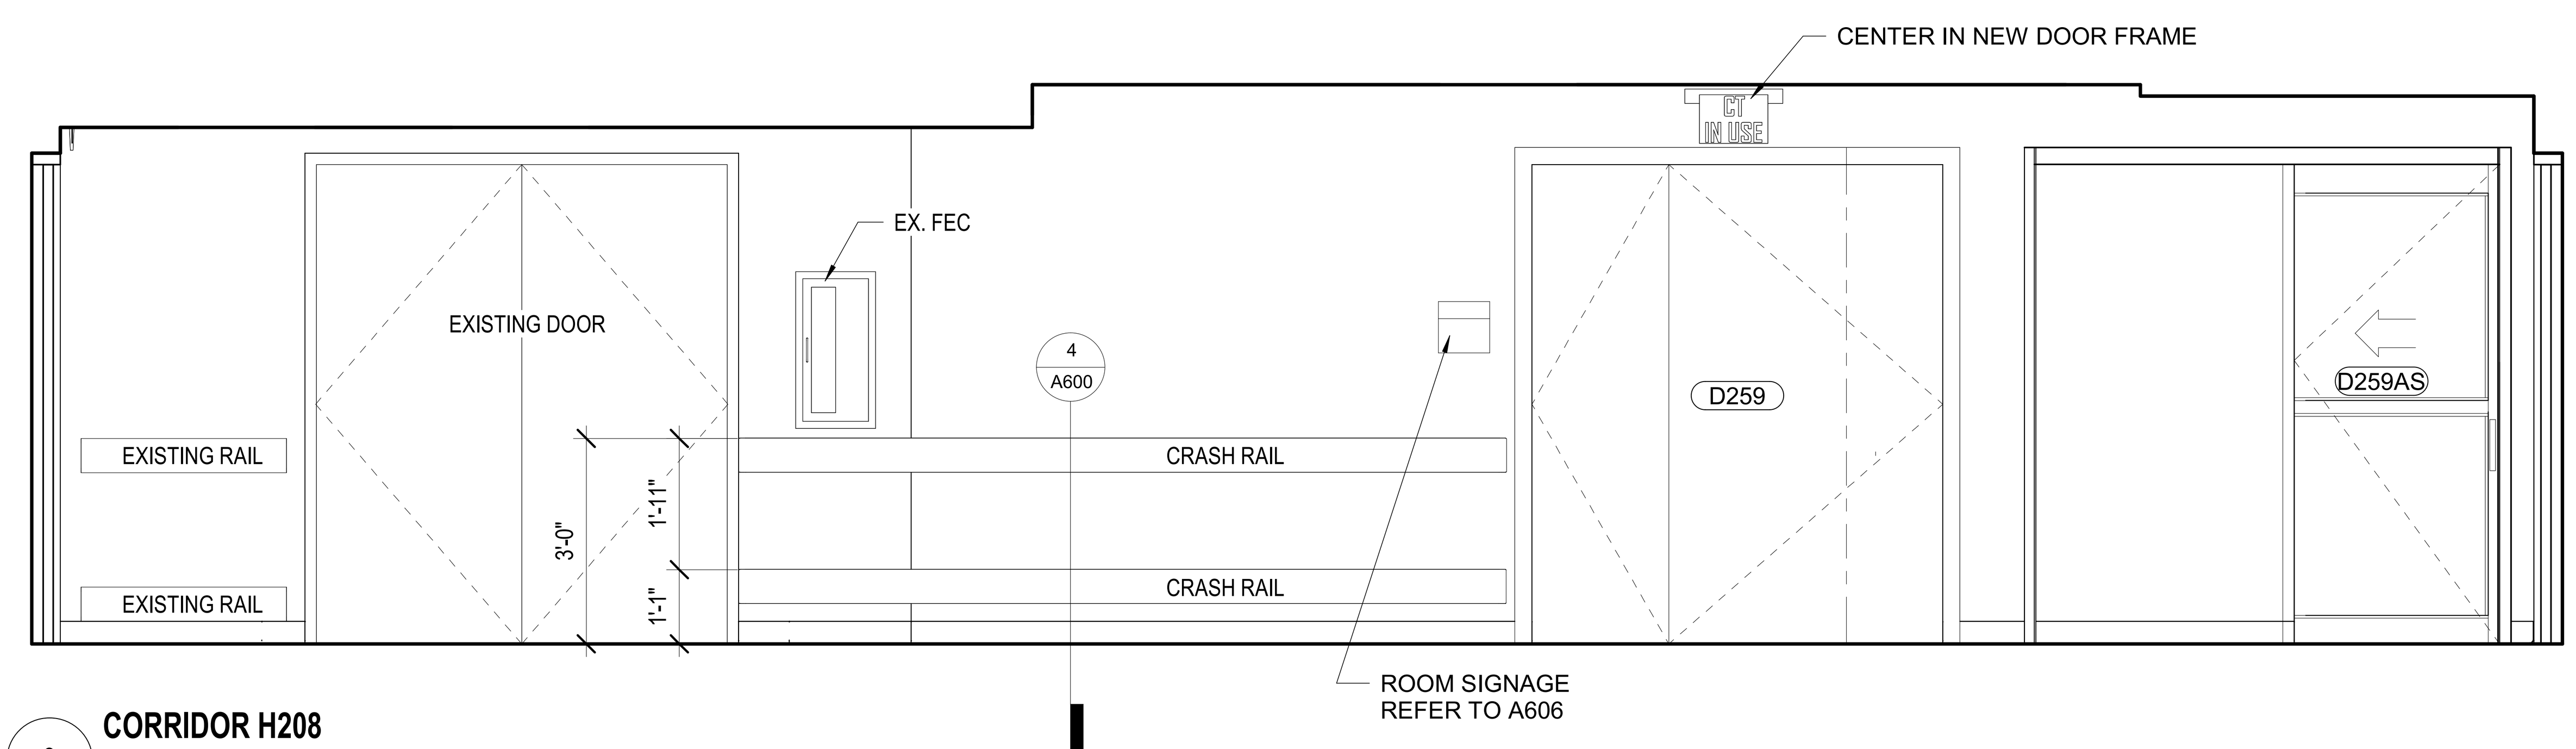

9 CORRIDOR H208
1/2" = 1'-0"

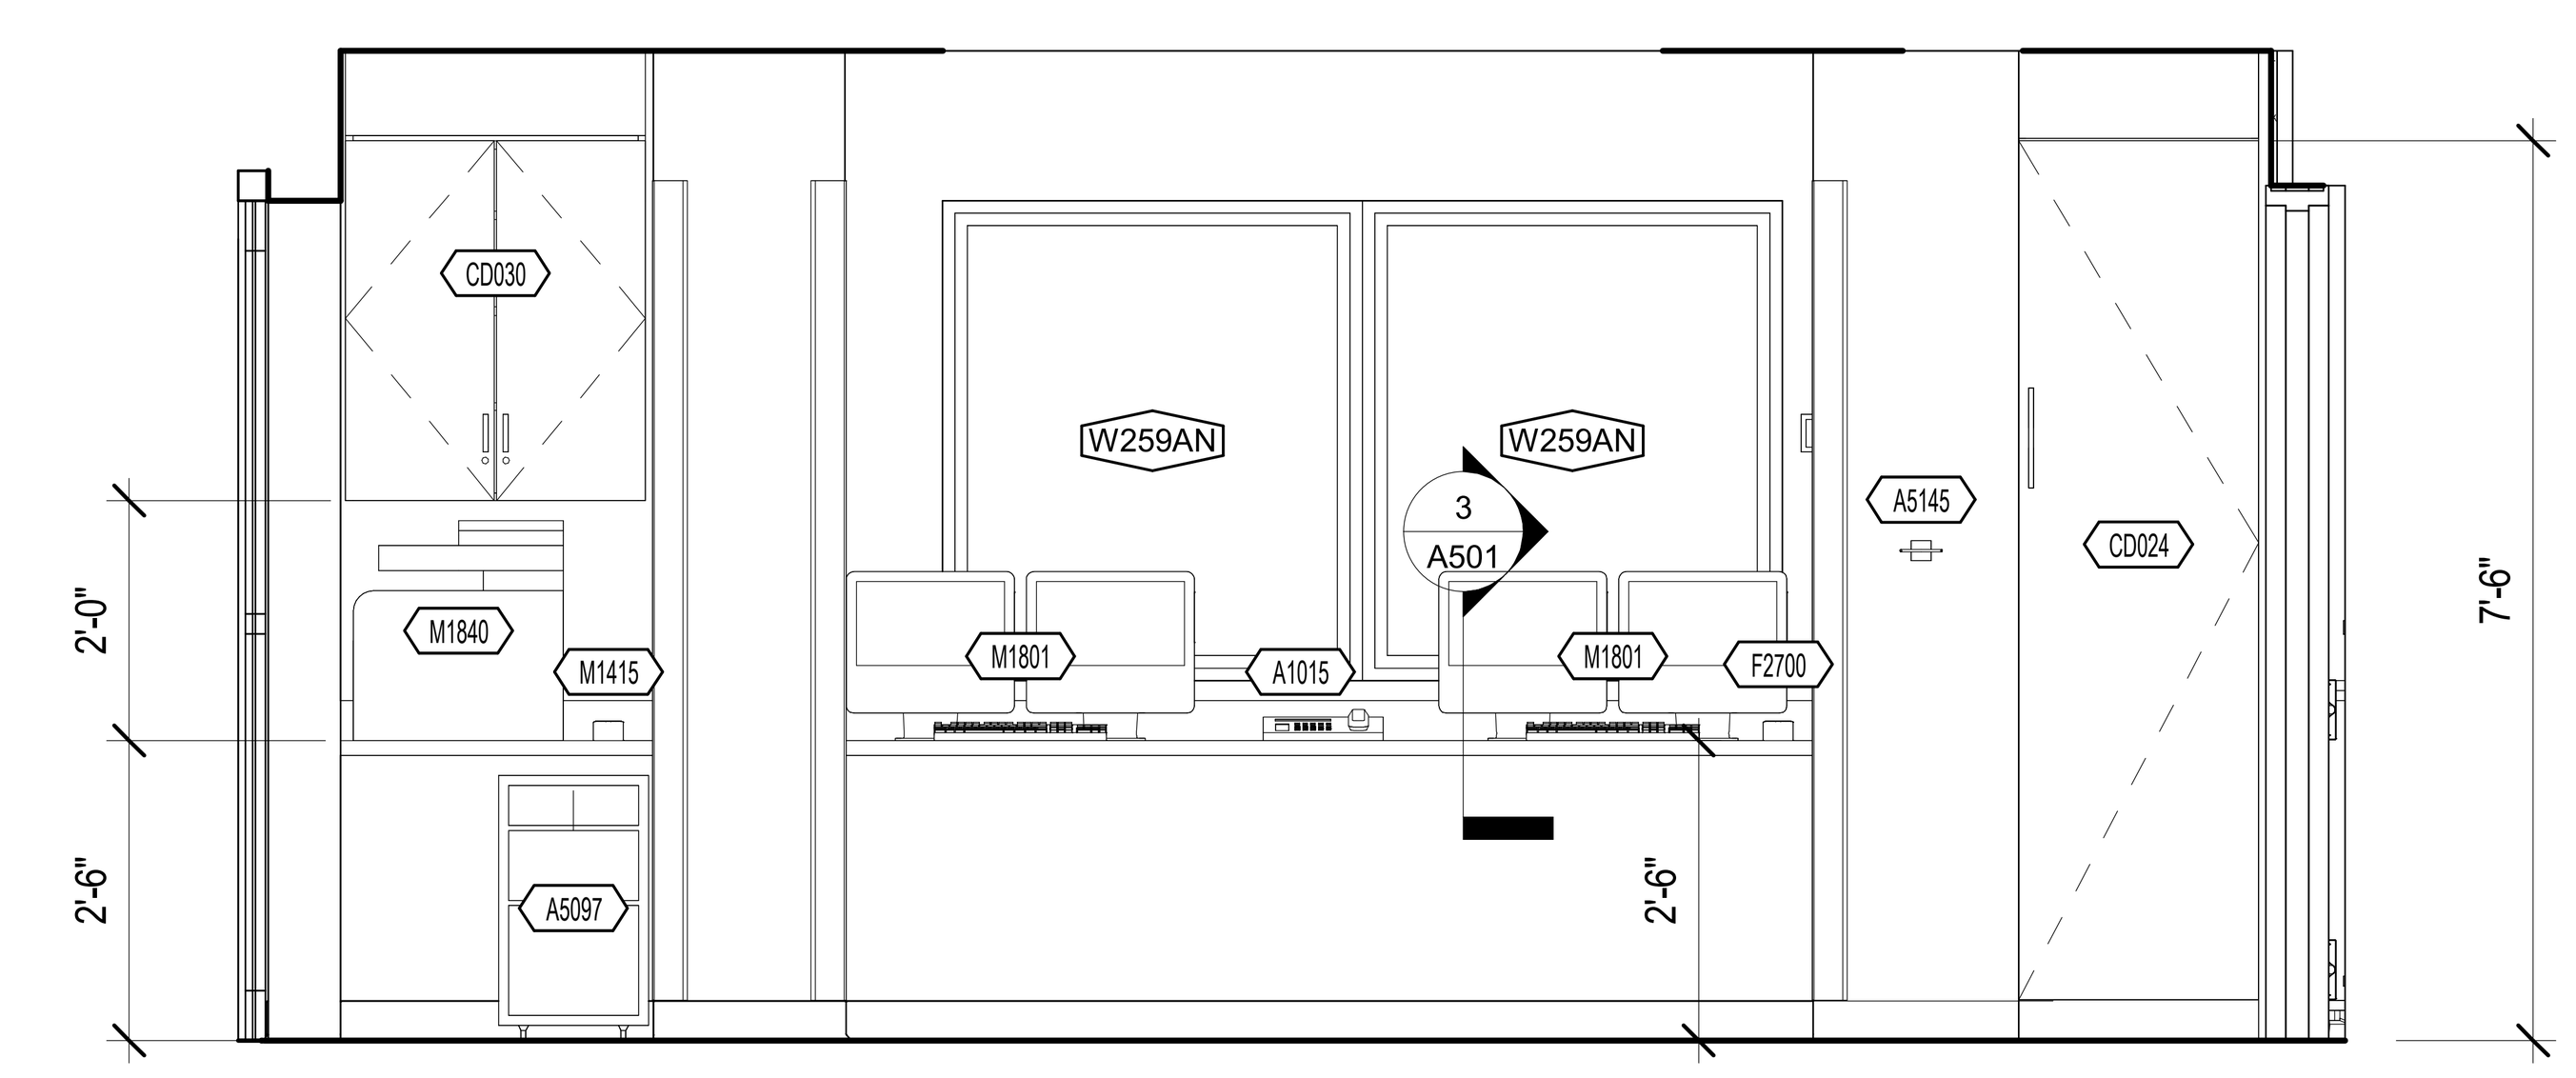

5 CONTROL ROOM WEST
1/2" = 1'-0"

Revisions:	Date:

CONSULTANT

Above Group
ENGINEERING DESIGN CONSULTING

Mabbett
Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD

THINKFORM ARCHITECTS

THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP

STATE OF MISSOURI
RUSSELL DINARDO
NUMBER
A - 2024000203
ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
INTERIOR ELEVATION	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
			Building Number: 1
Approved:		Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Drawing Number
		Issue Date: 06 MARCH 2026 / Checked: TB / Drawn: PS	A402

VA FORM 08 - 6231

3/3/2026 2:40:32 PM

Autodesk Docs://24001 VA ST Louis CT/657-23-104JC_657-JC-01-02_ARCH.rvt

GENERAL DETAIL NOTES:

A. STUD CONFIGURATIONS ARE DIAGRAMMATIC TO THE POINT THAT THEY INDICATE THE REQUIRED FACE OF STUD TO WHICH OTHER MATERIALS ARE ATTACHED. ADDITIONAL STUD FRAMING MAY BE REQUIRED, BEYOND THE INDIVIDUAL STUDS INDICATED, TO EITHER PROVIDE ATTACHMENTS FOR MATERIAL EDGE CONDITIONS, OR TO SATISFY THE REQUIREMENTS OF THE STEEL STUD DESIGNER OR MANUFACTURER AS OUTLINED IN THE SPECIFICATIONS.

B. SEAL ALL PENETRATIONS OF SHEATHING AND AIR BARRIER WITH COMPATIBLE CLOSED CELL FOAM INSULATION.

C. ALL DISSIMILAR METALS SHALL BE EFFECTIVELY ISOLATED FROM OTHER METALS TO AVOID GALVANIC ACTION.

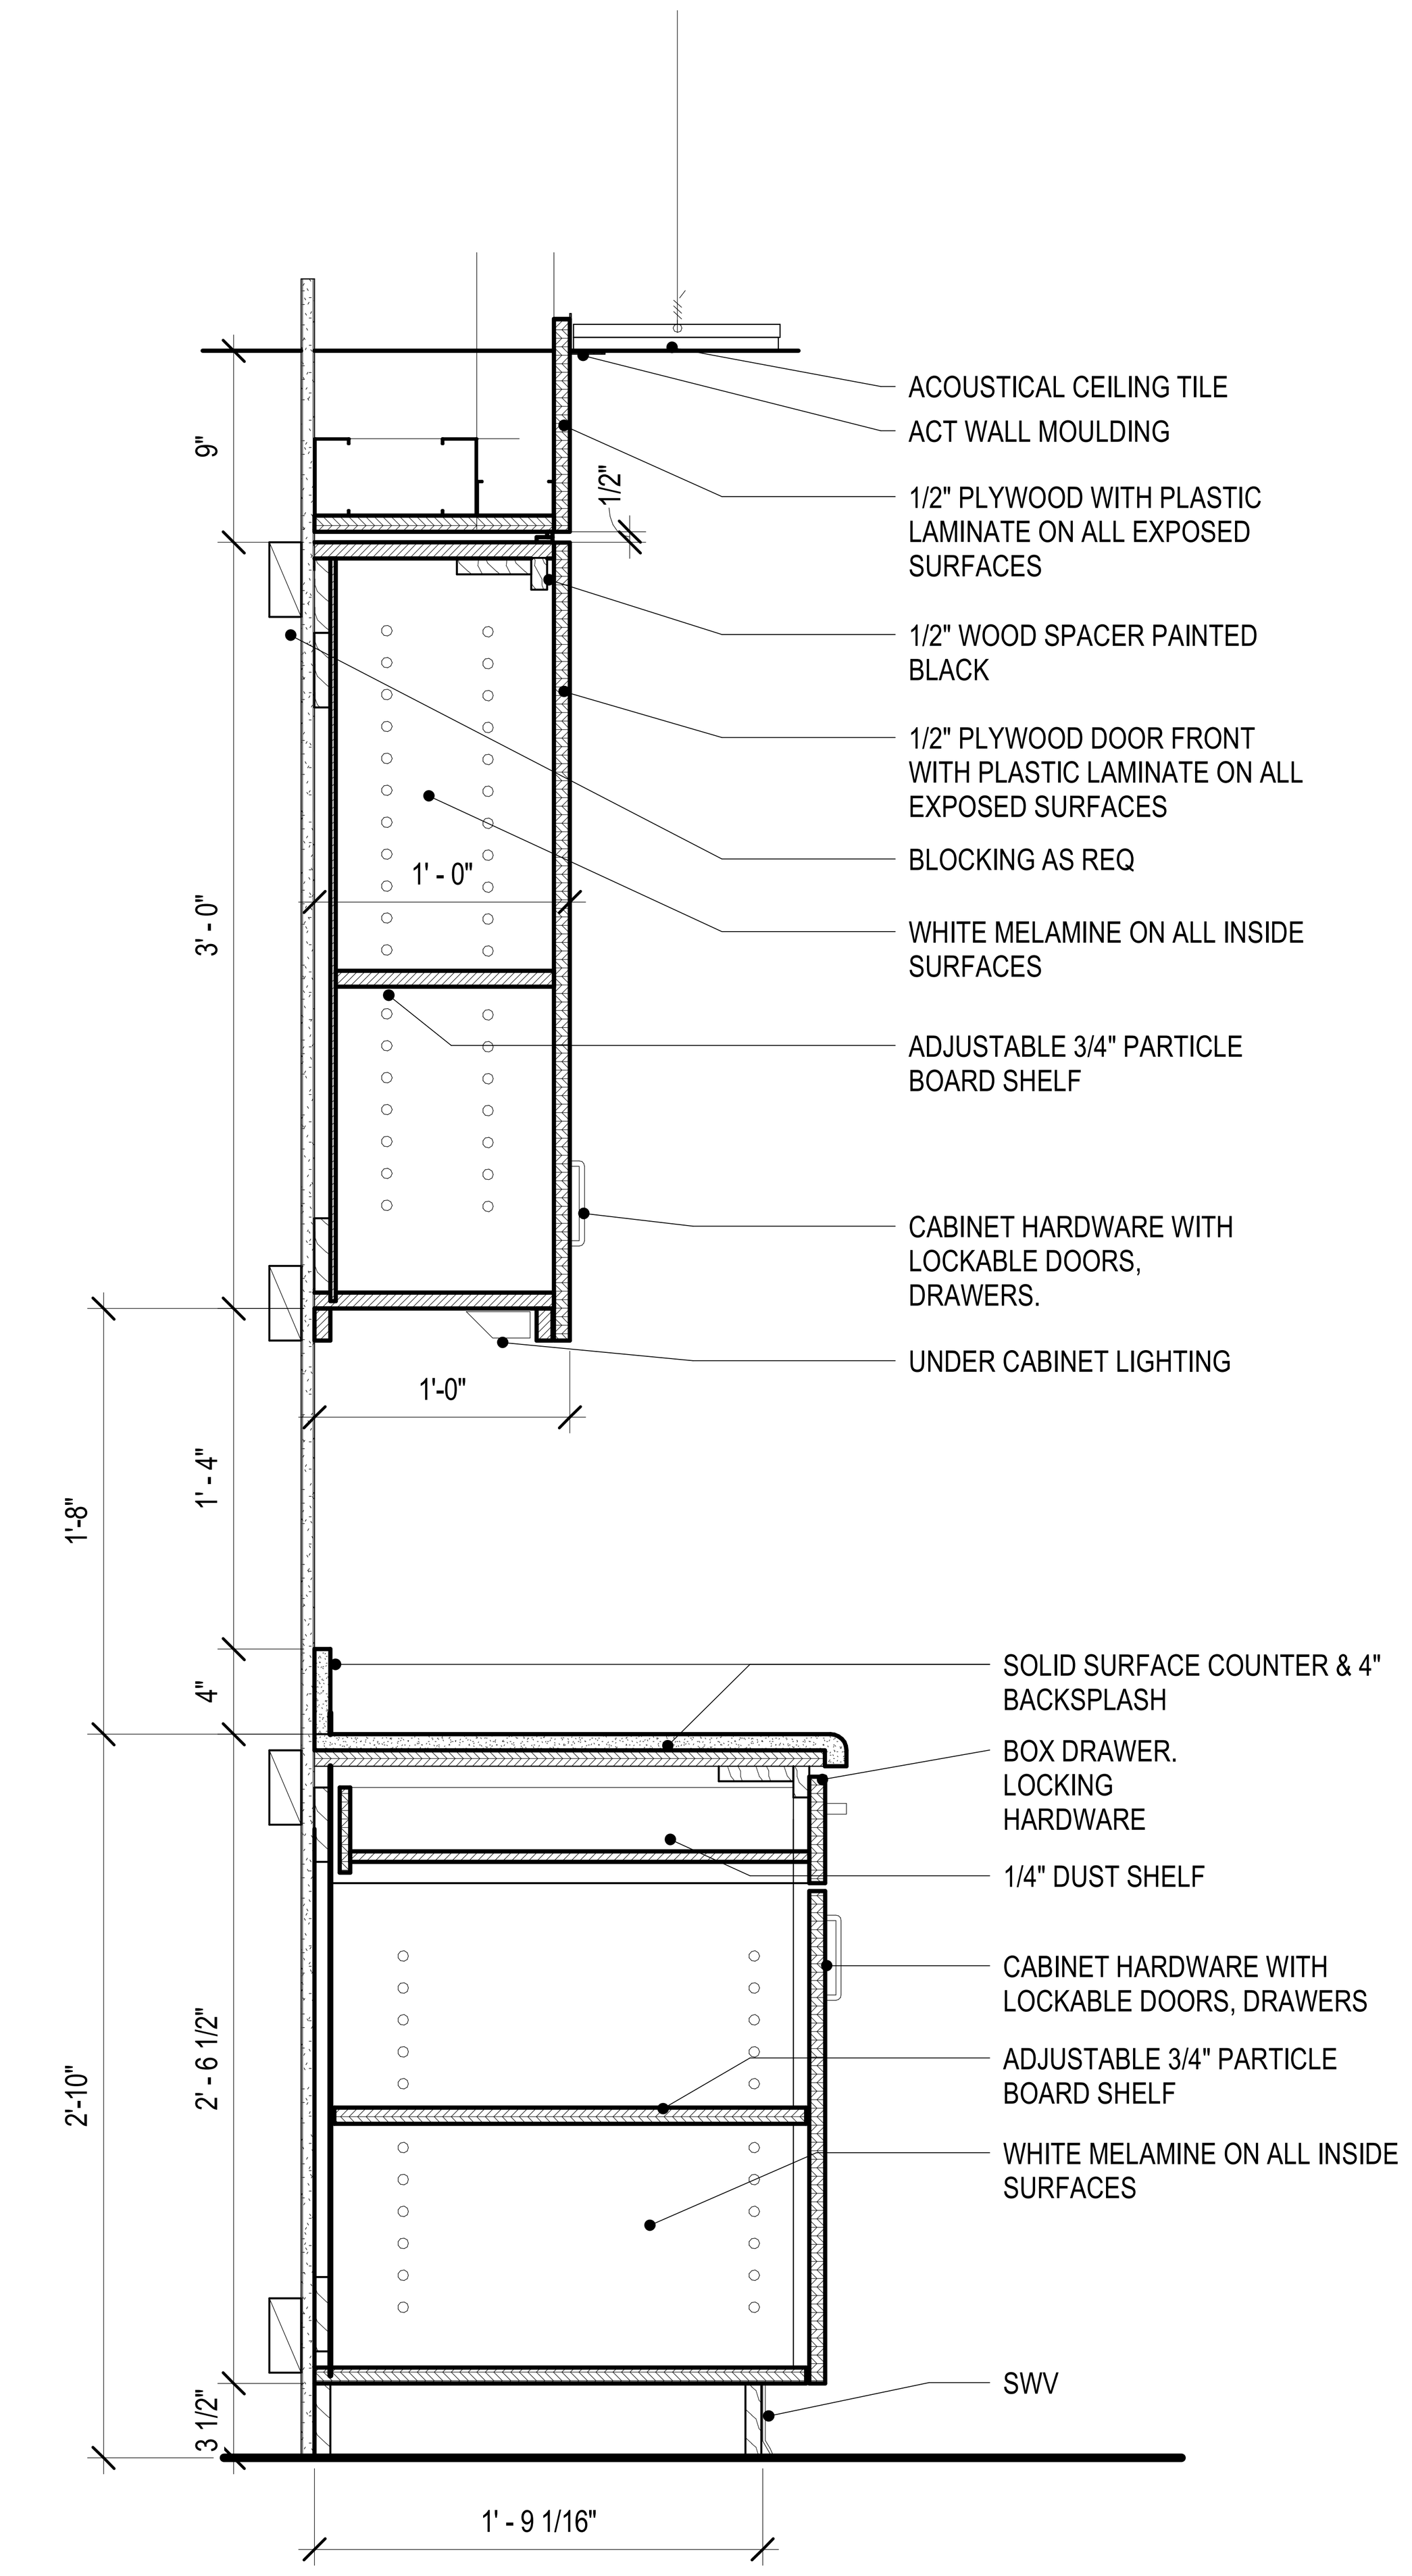

1 UPPER CABINET OVER LOWER CABINET SECTION DETAIL
1 1/2" = 1'-0"

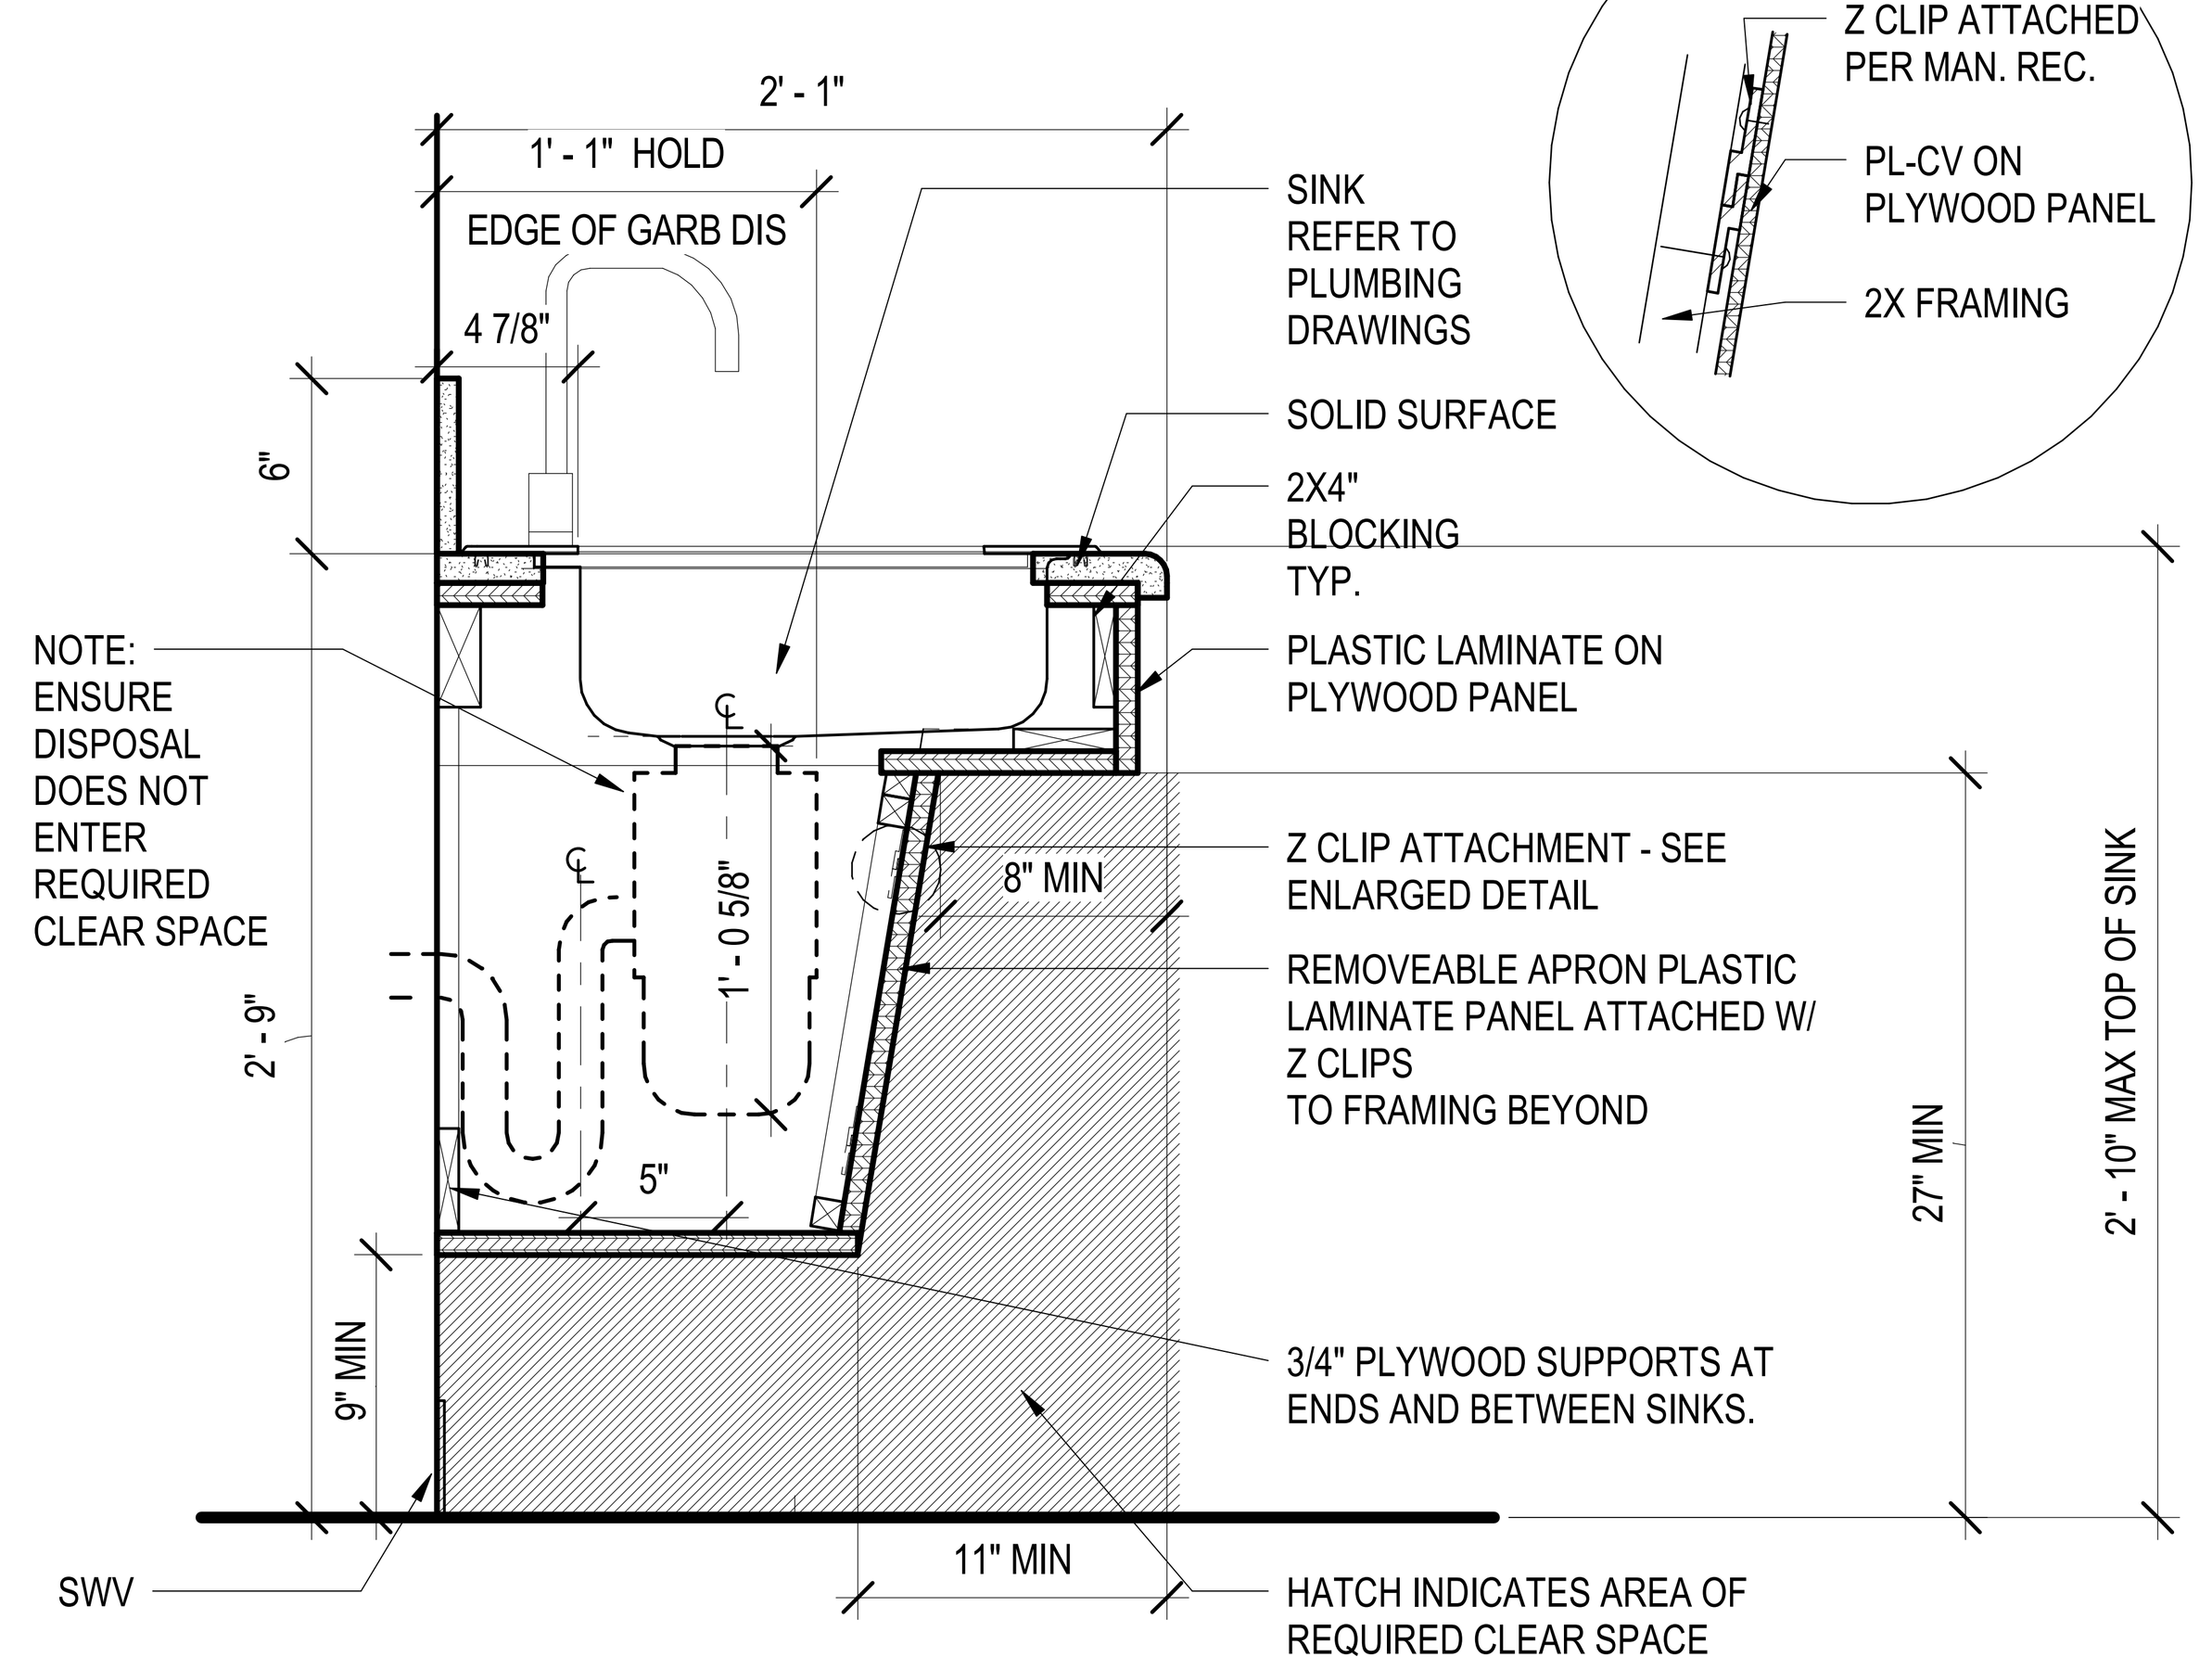

2 SINK CABINET DETAIL
1 1/2" = 1'-0"

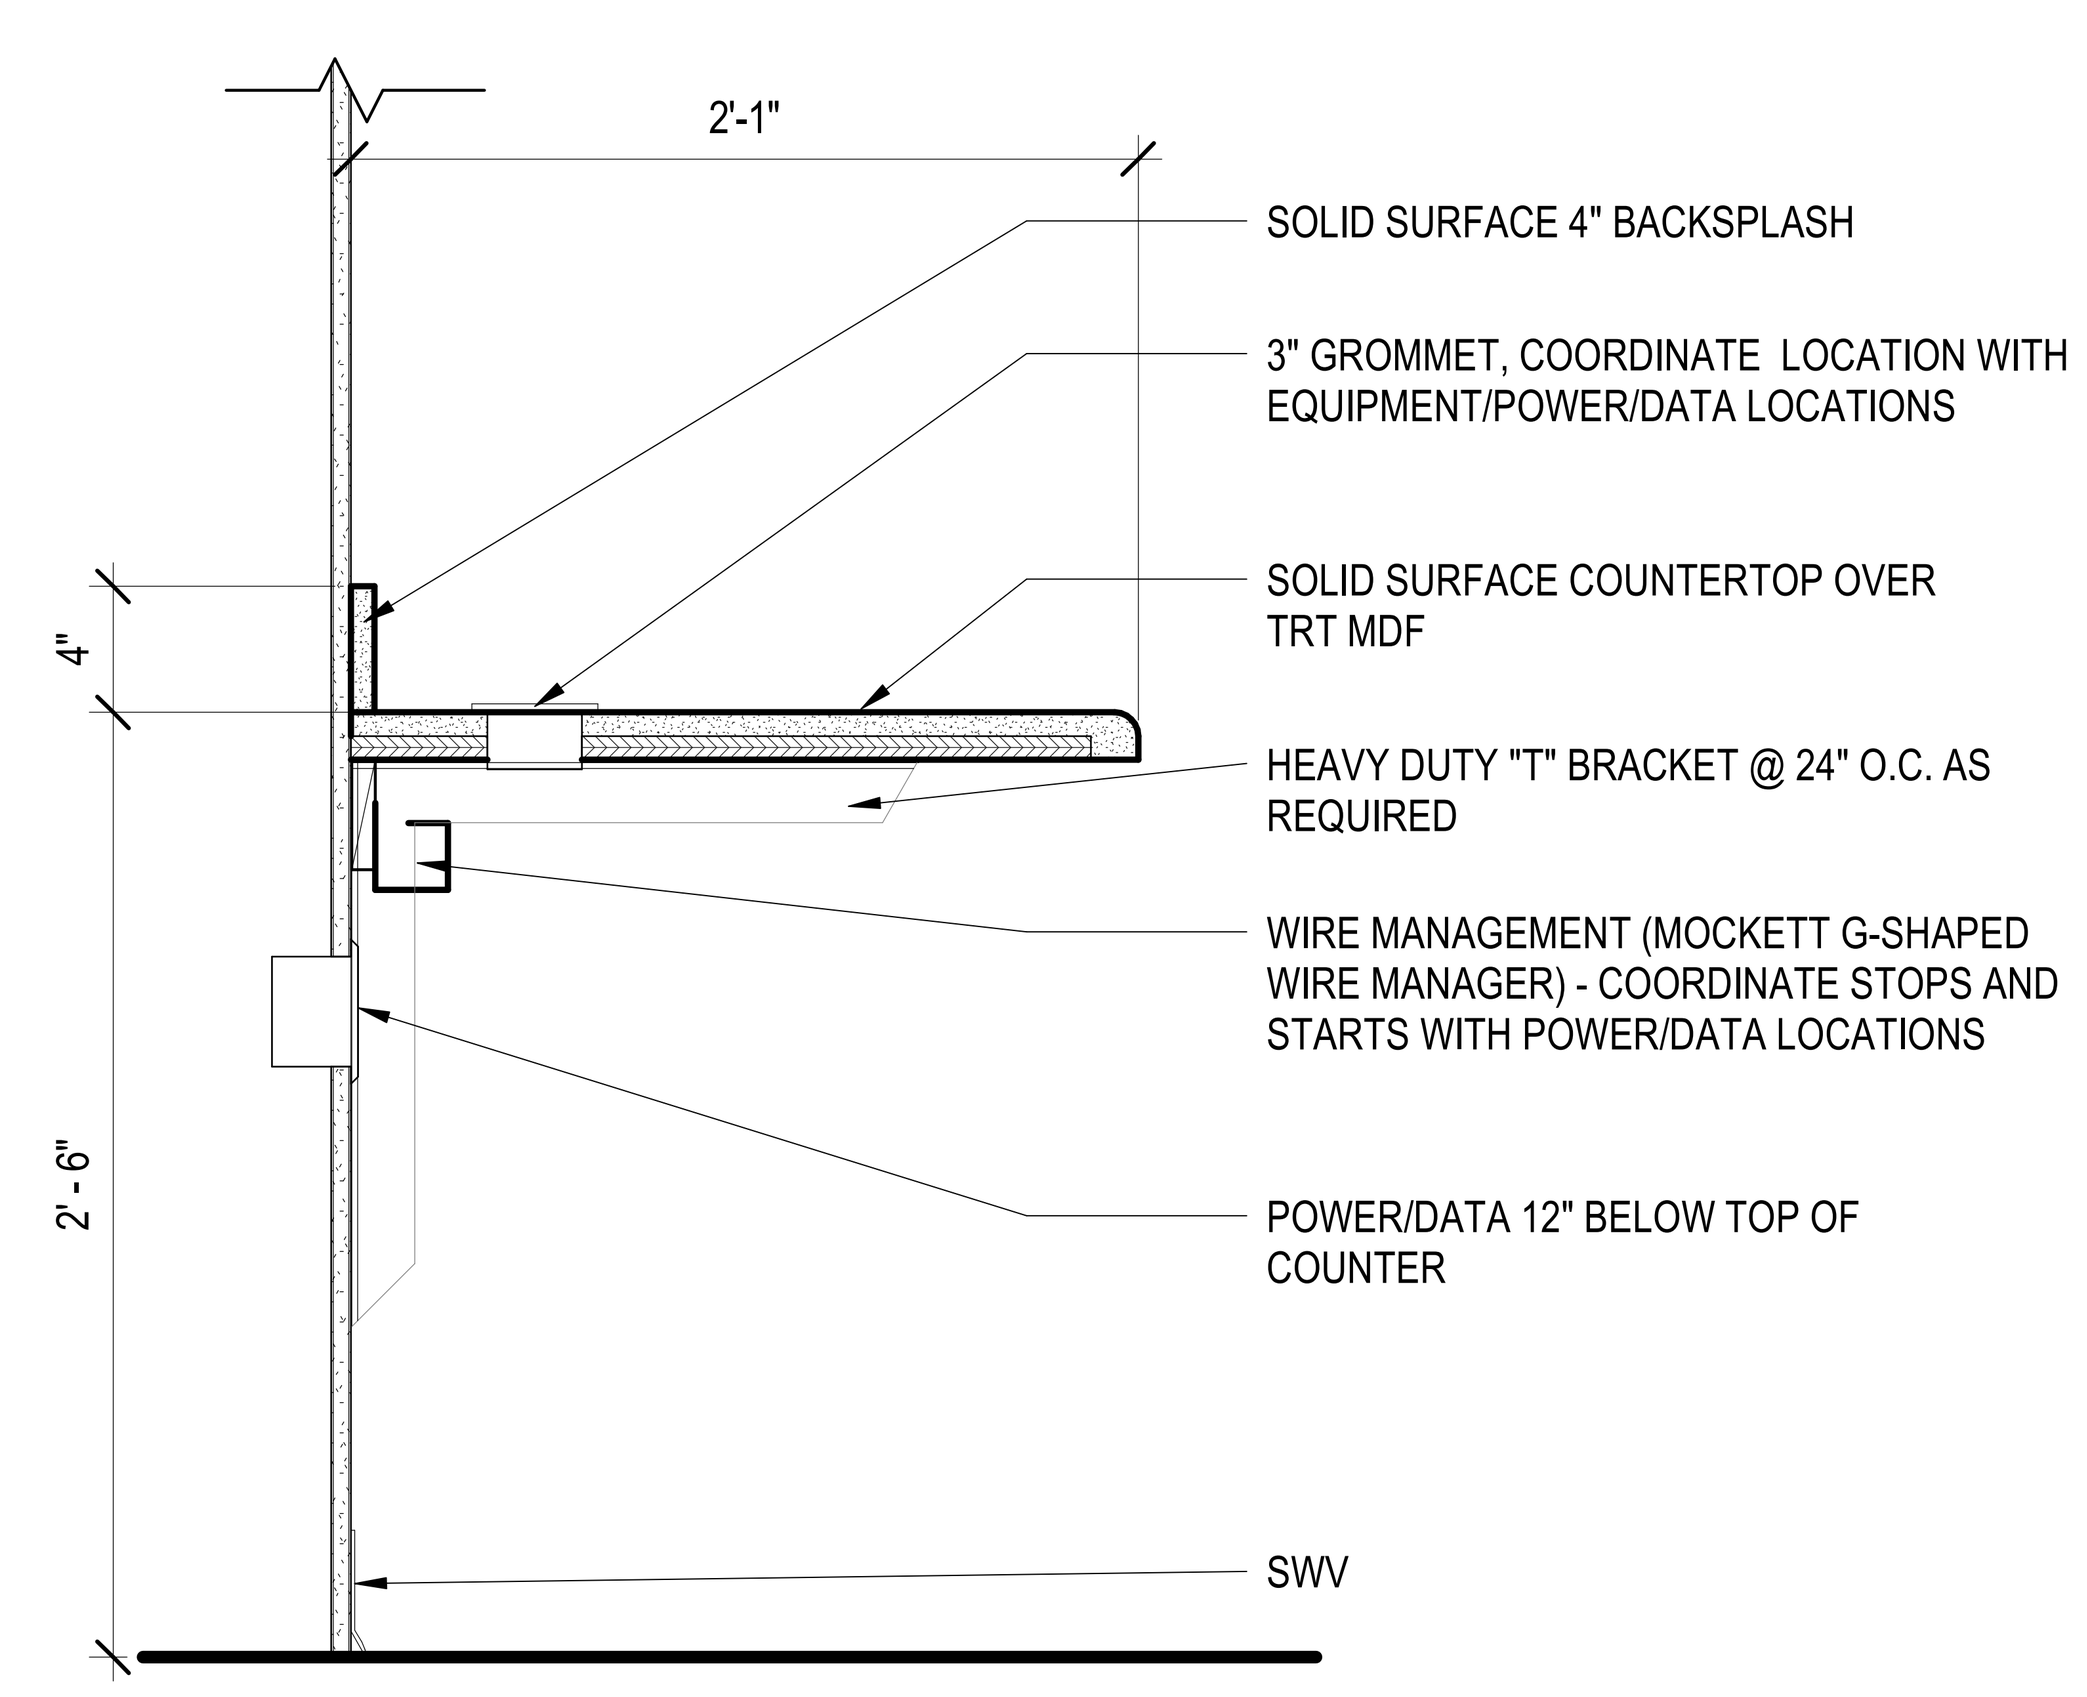

3 DESK, COUNTER DETAIL
1 1/2" = 1'-0"

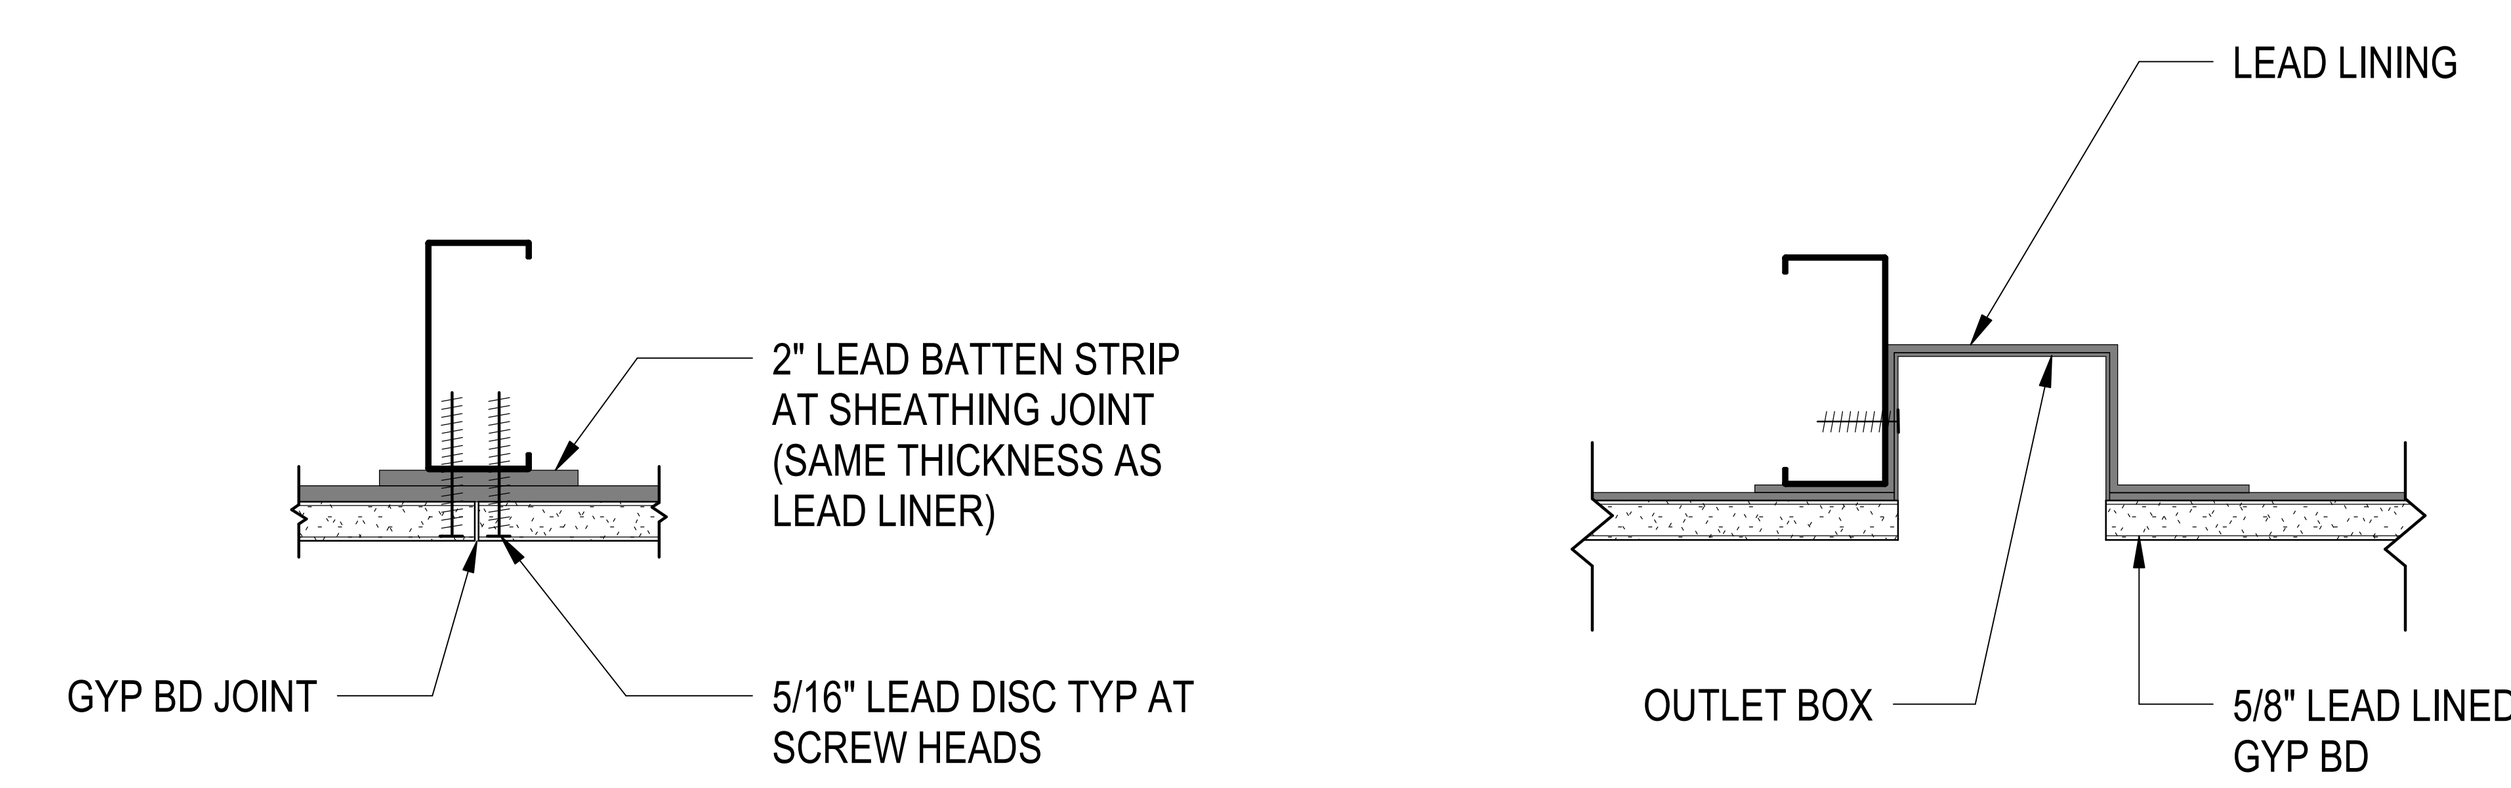

8 TYP. LEAD WALL DETAILS
3" = 1'-0"

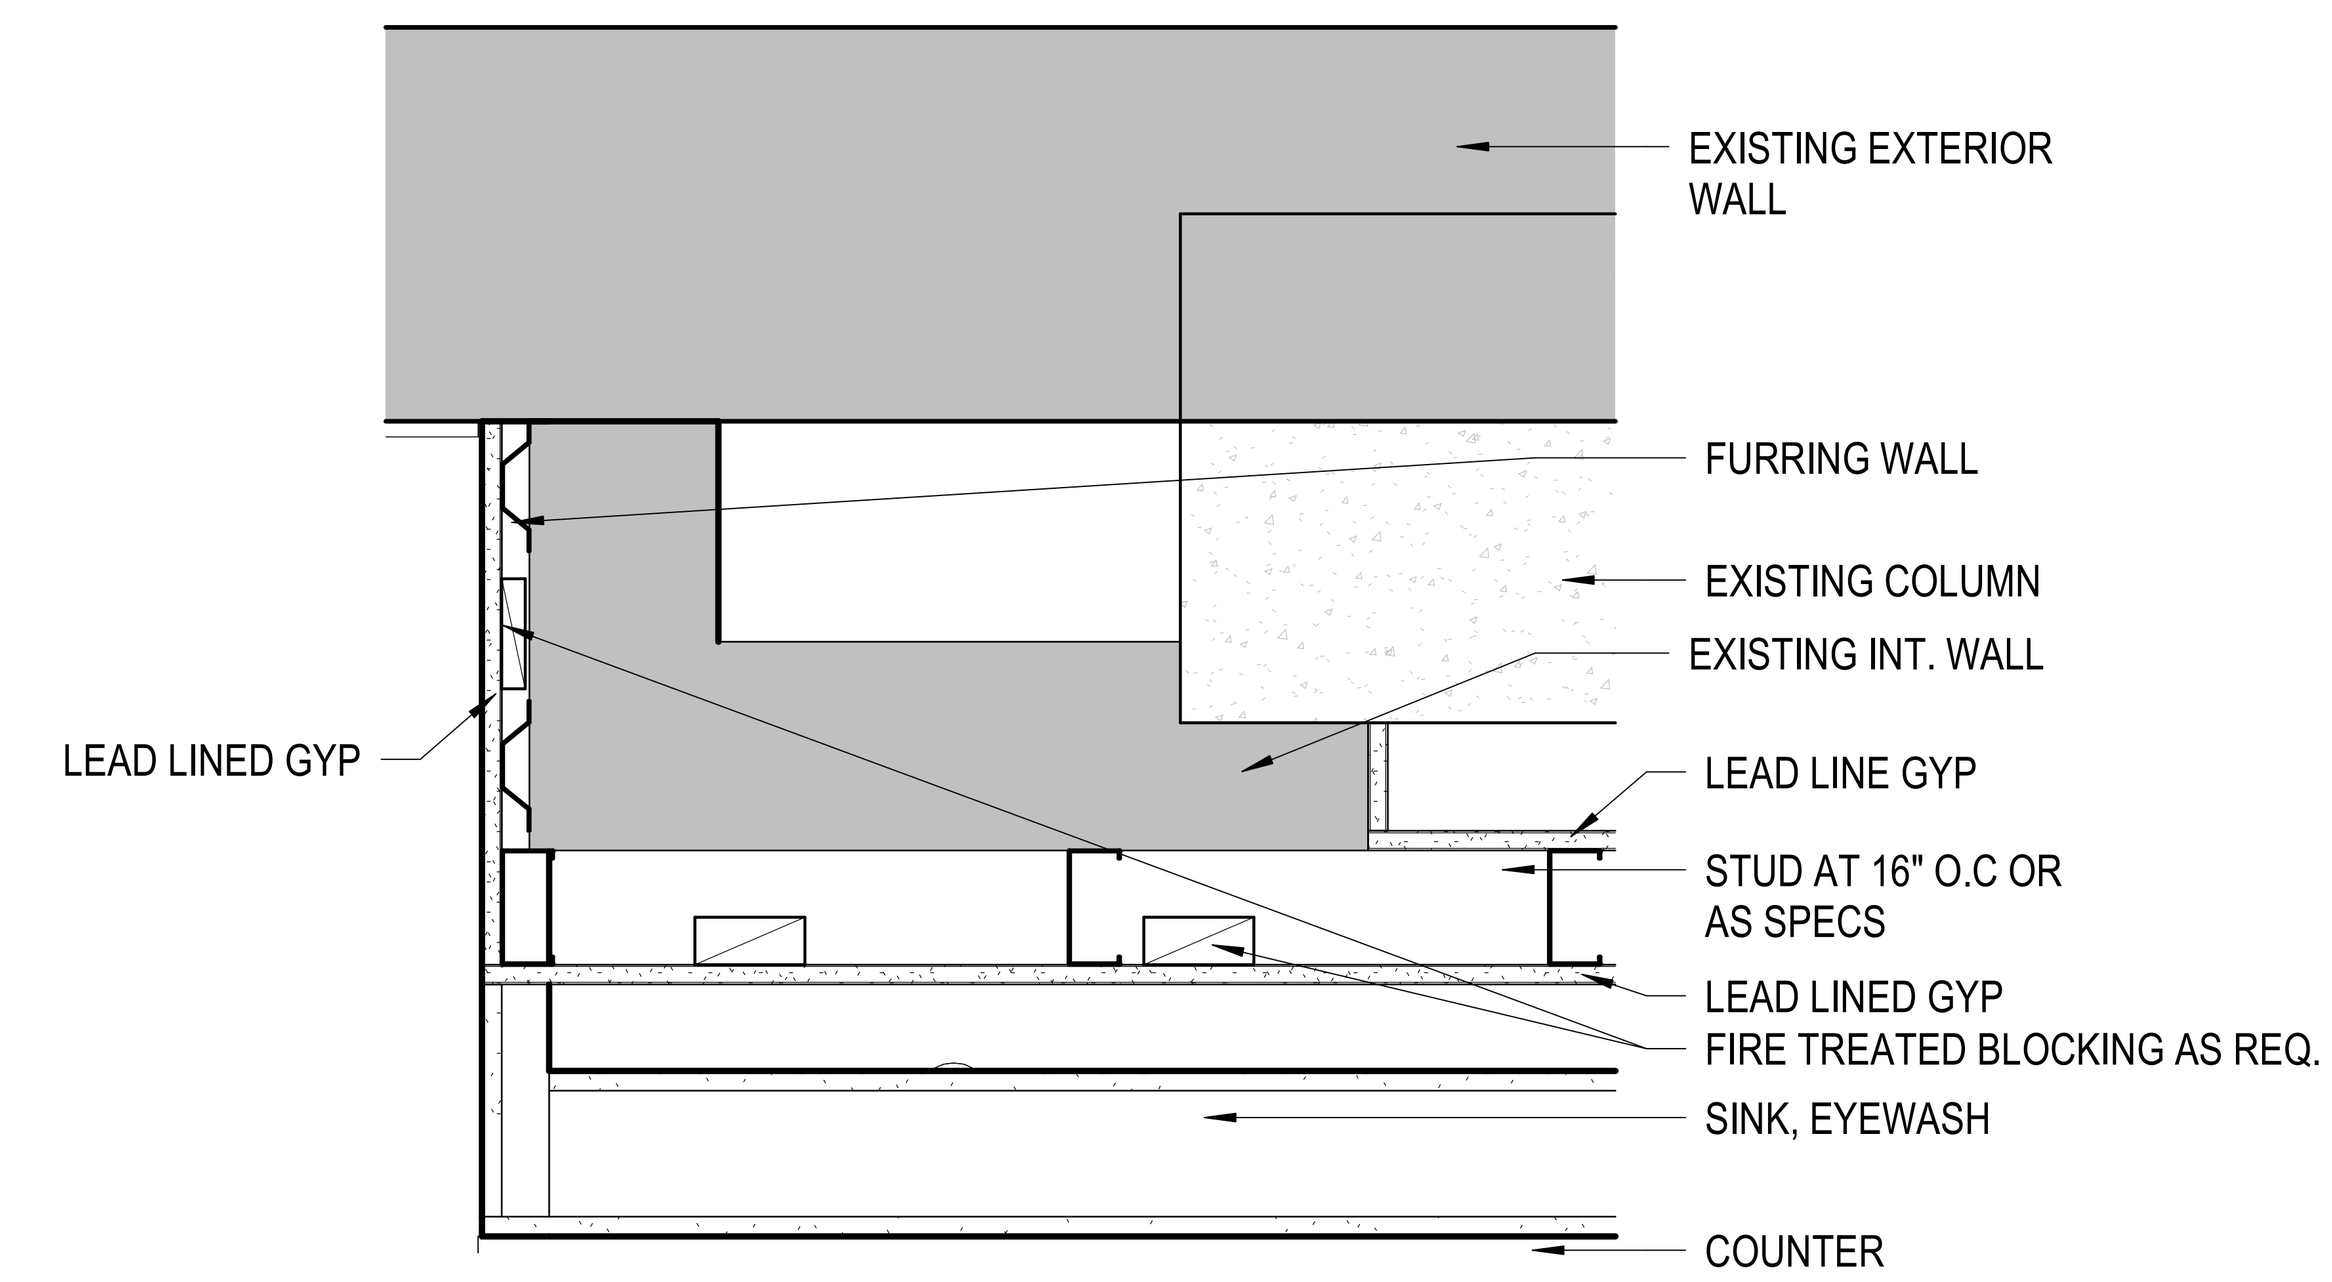

5 WALL DETAIL AT EXTERIOR
1 1/2" = 1'-0"

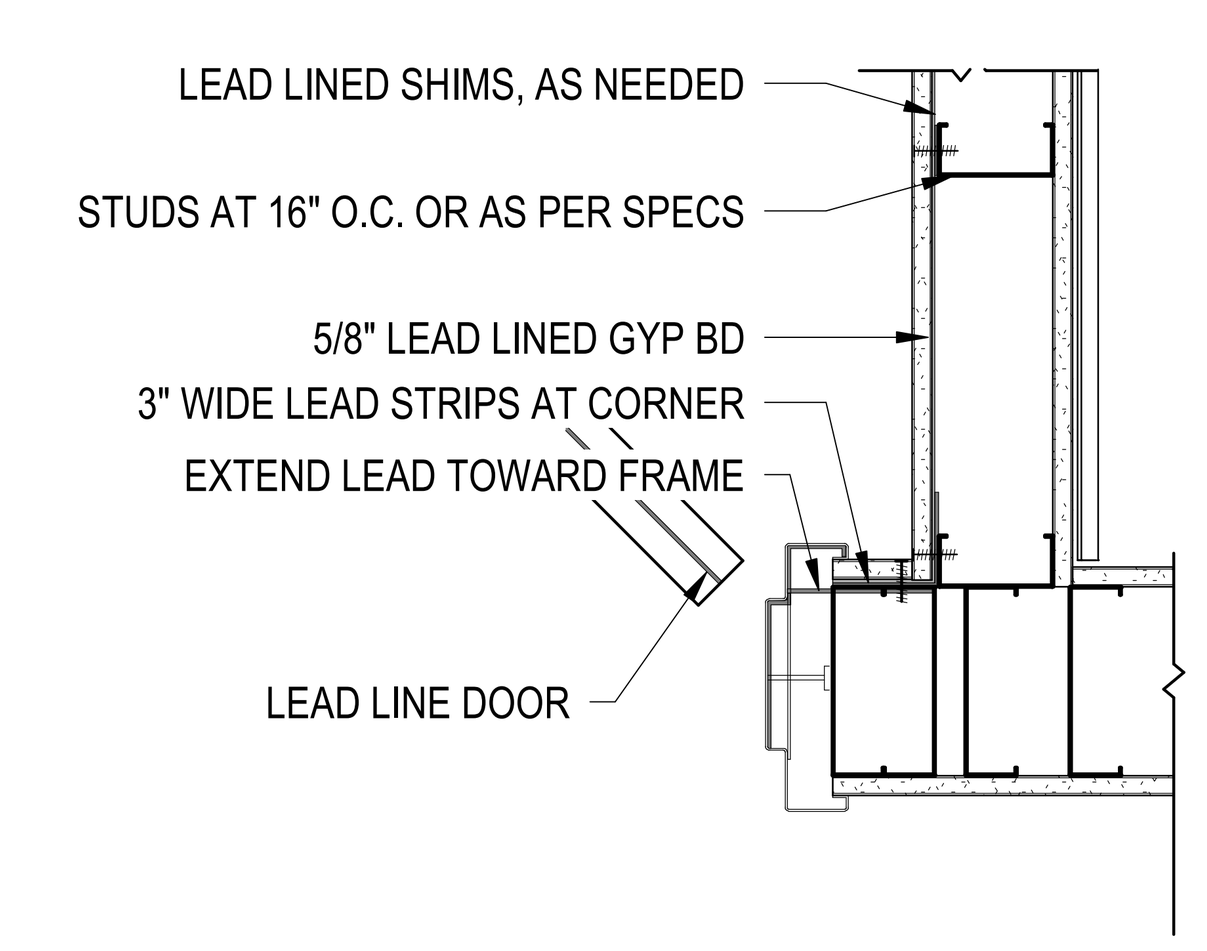

4 WALL DETAIL @ CORRIDOR - LEAD LINE WALL
1 1/2" = 1'-0"

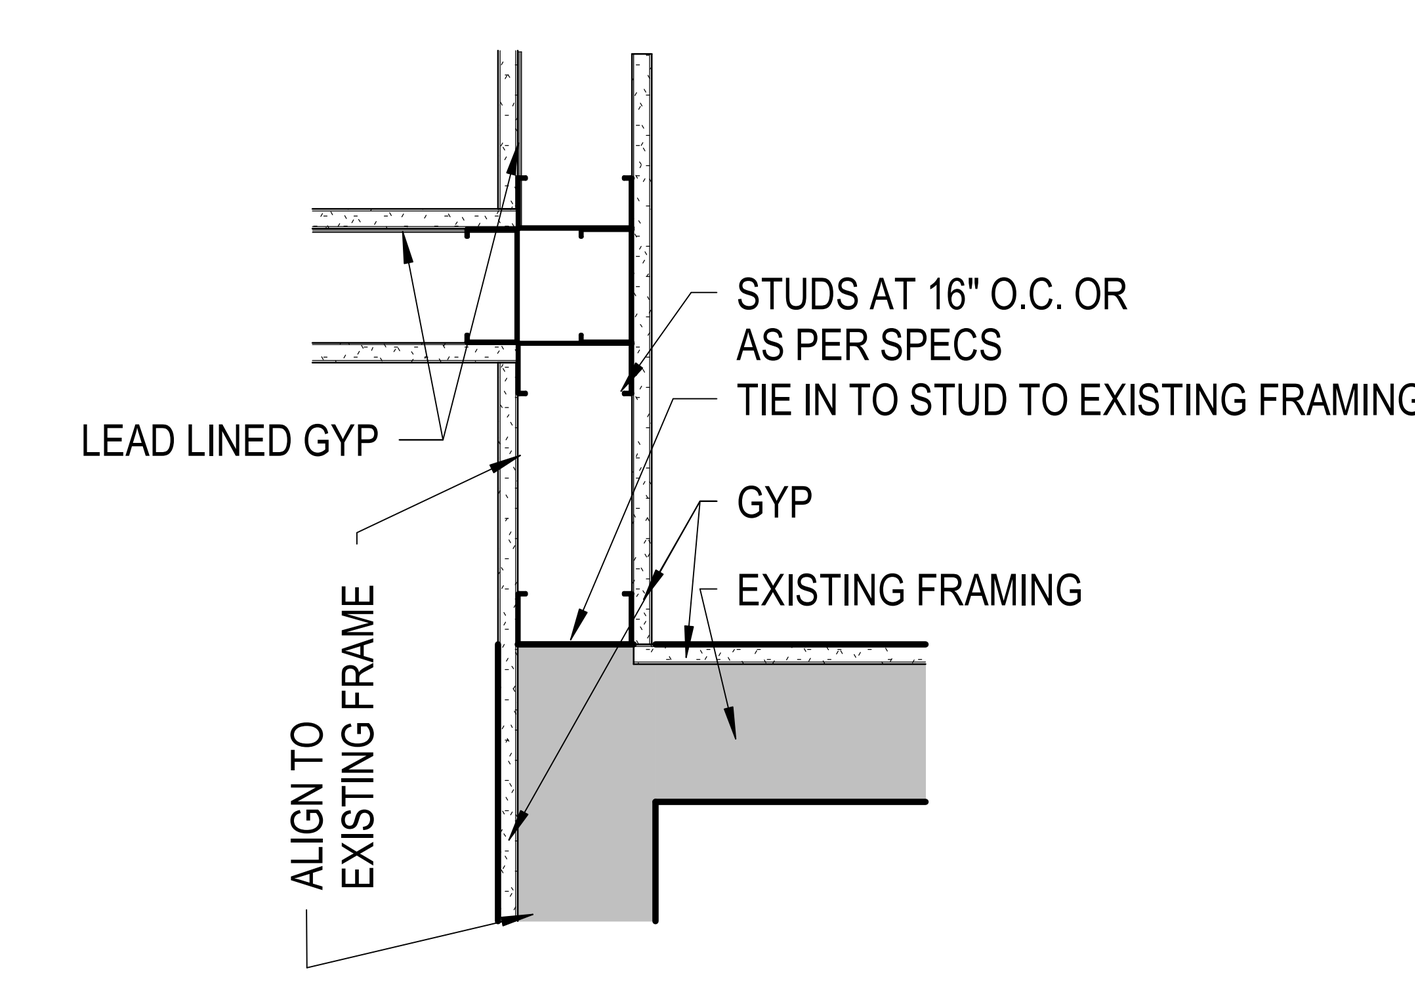

6 DETAIL CORNER CONNECTION
1 1/2" = 1'-0"

Revisions:	Date:

CONSULTANT

Above Group
ENGINEERING DESIGN CONSULTING

Mabbett®
Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD

THINKFORM
ARCHITECTS

THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP

STATE OF MISSOURI
RUSSELL DINARDO
NUMBER A - 2024000203
ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)

VA U.S. Department of Veterans Affairs

Drawing Title
DETAILS & CASEWORK DETAILS

Approved:

Phase
100% CONTRACT DOCUMENTS FOR BIDDING

Project Title
NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259

Location
915 GRAND BLVD.
SAINT LOUIS, MISSOURI 63106

Issue Date	Checked	Drawn
06 MARCH 2026	TB	PS

Project Number
657-23-104JC

Building Number
1

Drawing Number
A501

3/3/2026 2:40:33 PM

Autodesk Docs://24001 VA ST Louis CT/657-23-104JC_657-JC-01-02_ARCH.rvt

VA FORM 08 - 6231

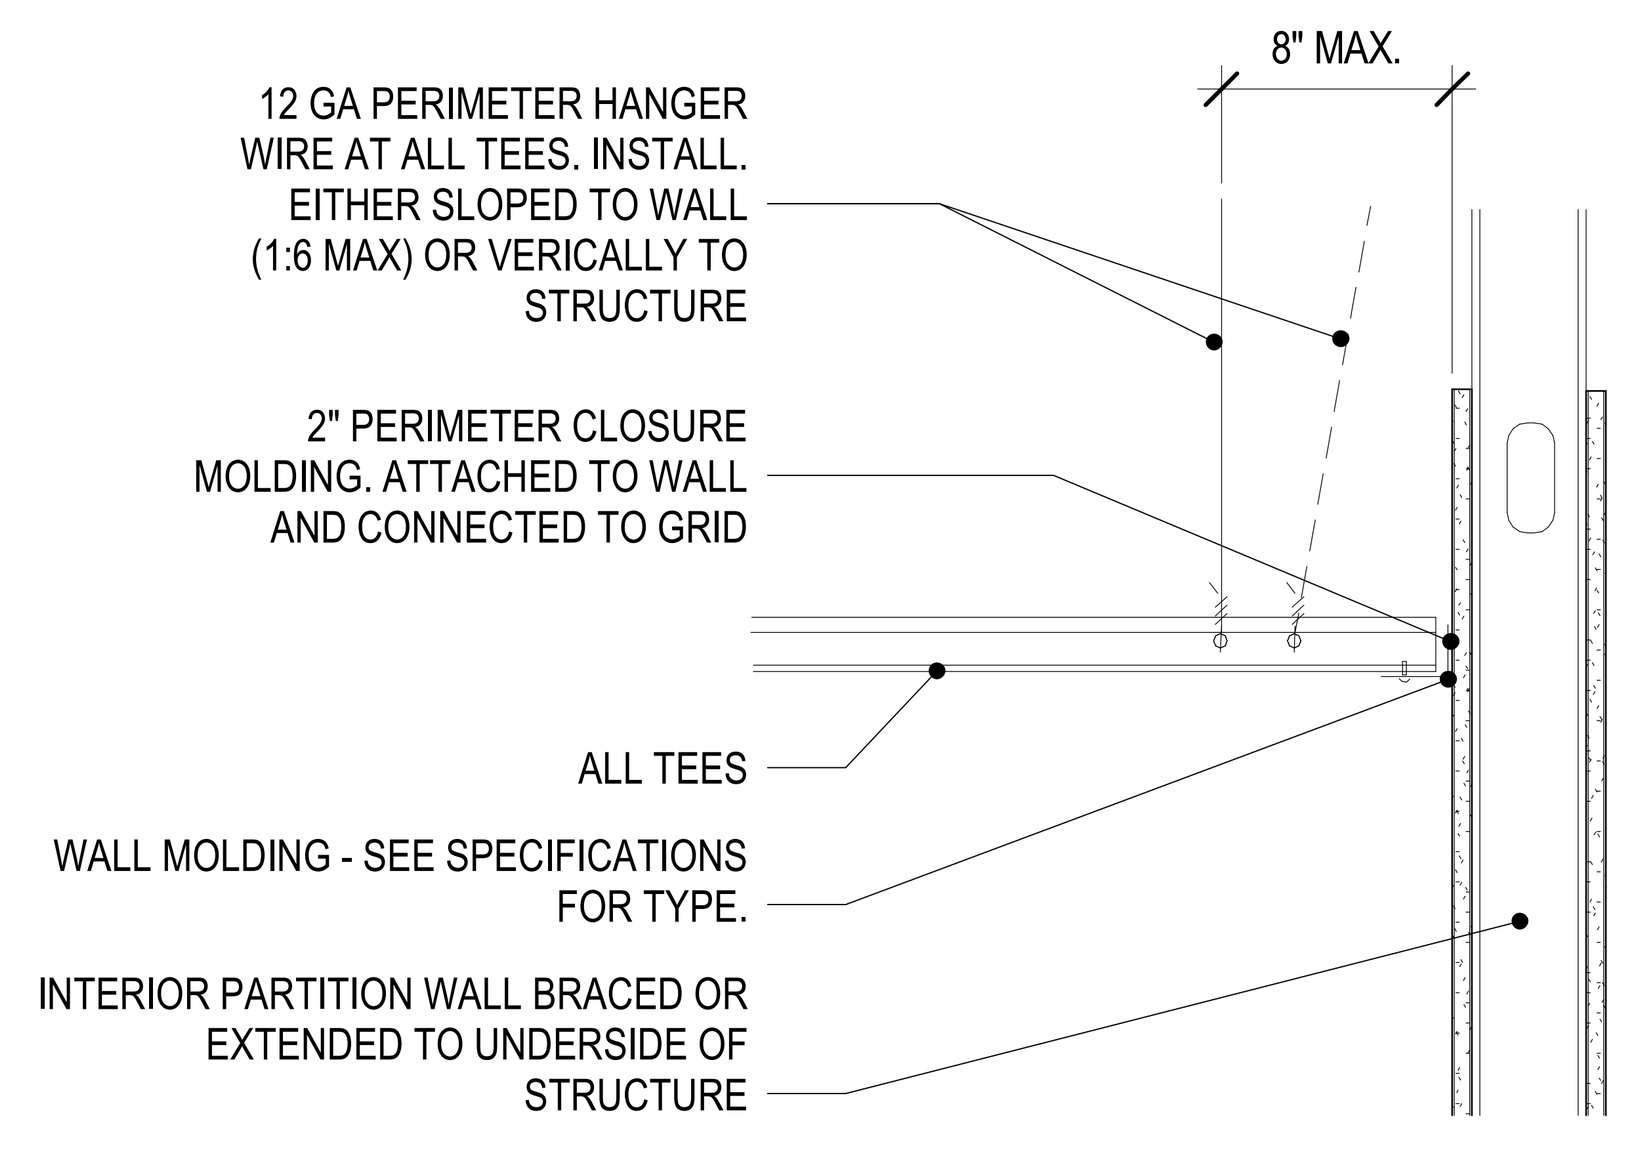

A.1 **ATTACHED TO WALL**
(DETAIL @TWO ADJACENT WALLS WITH GRID ATTACHED TO PERIMETER MOLDING)

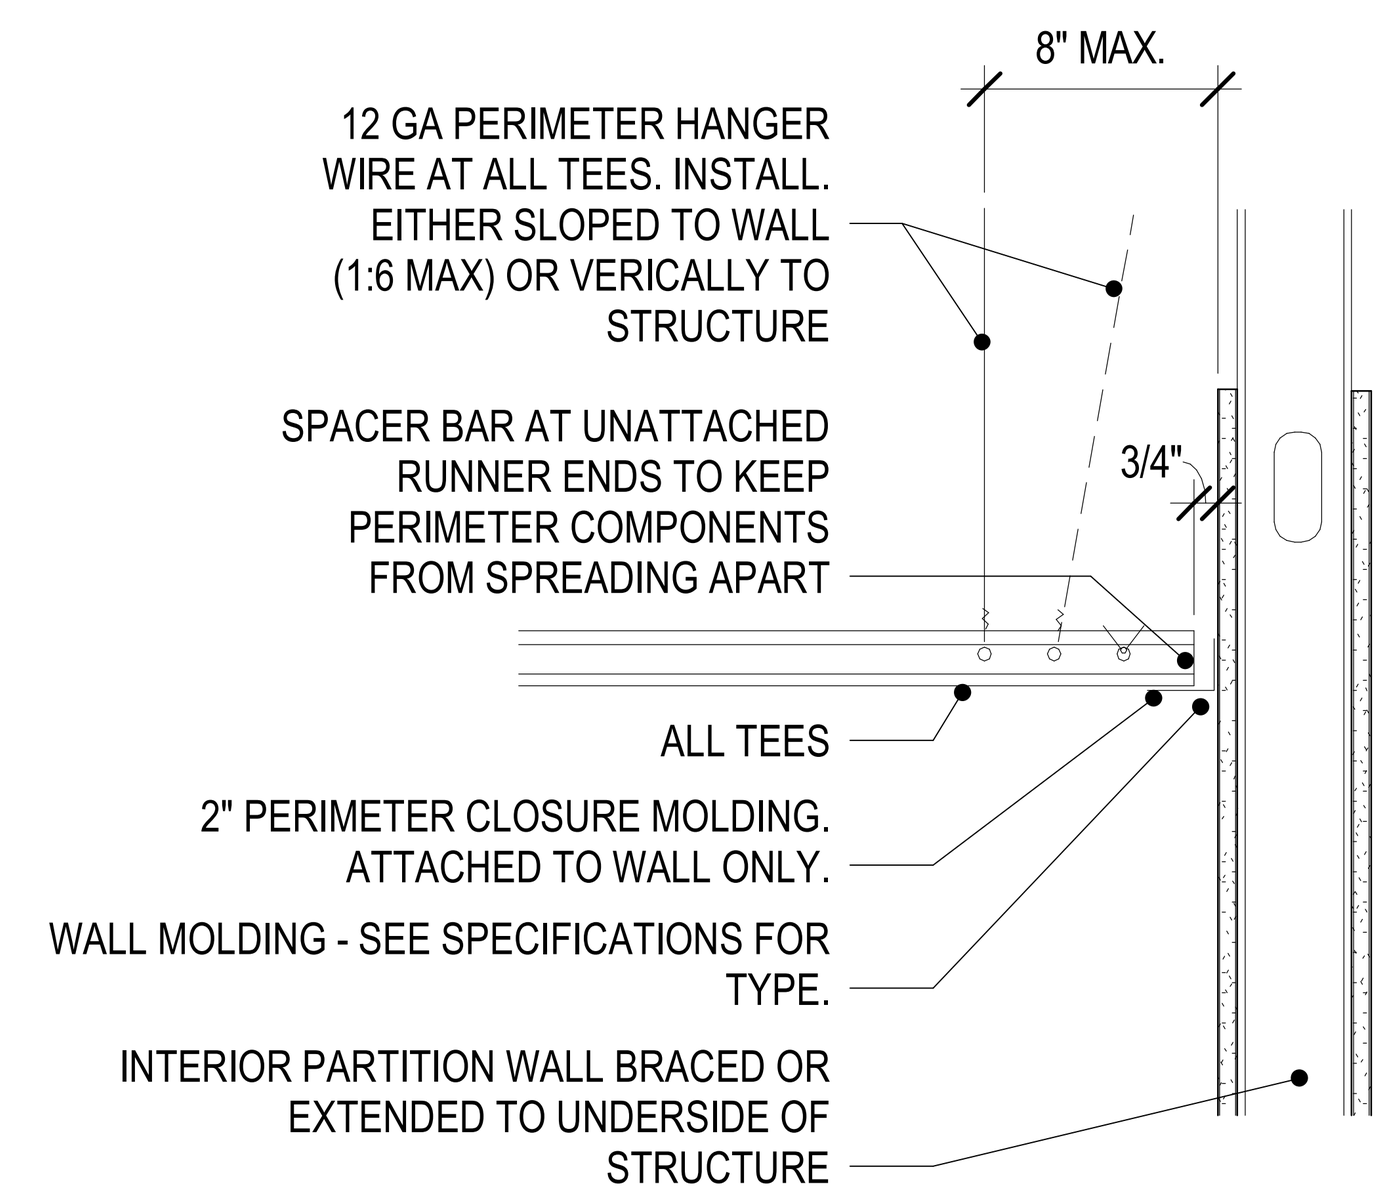

A.2 **UNATTACHED TO WALL**
(DETAIL @TWO ADJACENT WALLS WITH GRID UNATTACHED TO ALLOW 3/4" MOVEMENT IN BOTH DIRECTIONS

1 PERIMETER DETAILS W 2' EDGE MOLD
1 1/2" = 1'-0"

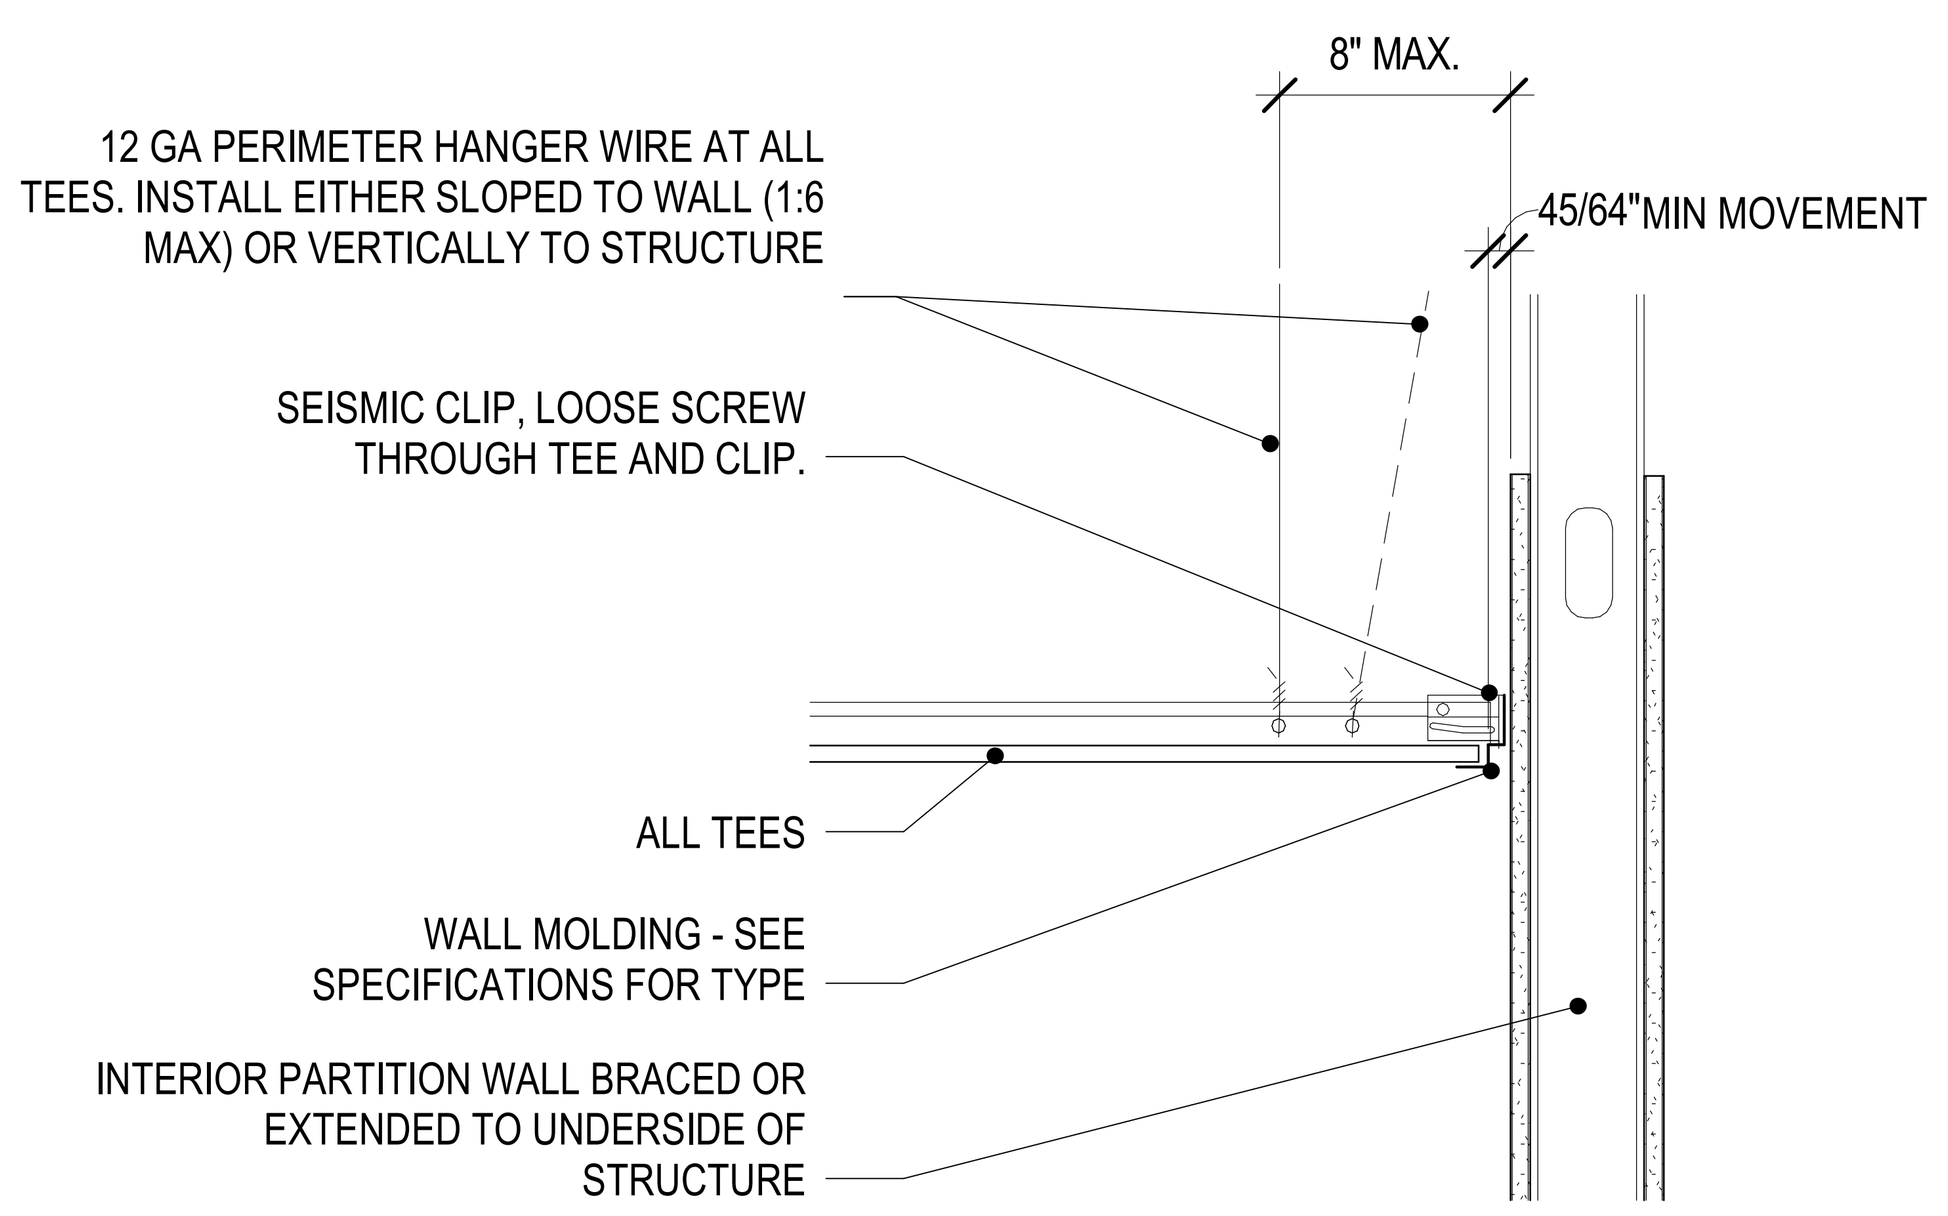

A.1 **FLOATING SIDES**
TWO ADJACENT WALLS WITH GRID TEES ATTACHED TO SEISMIC CLIP. LOOSE SCREW THROUGH SEISMIC CLIP AND TEE.

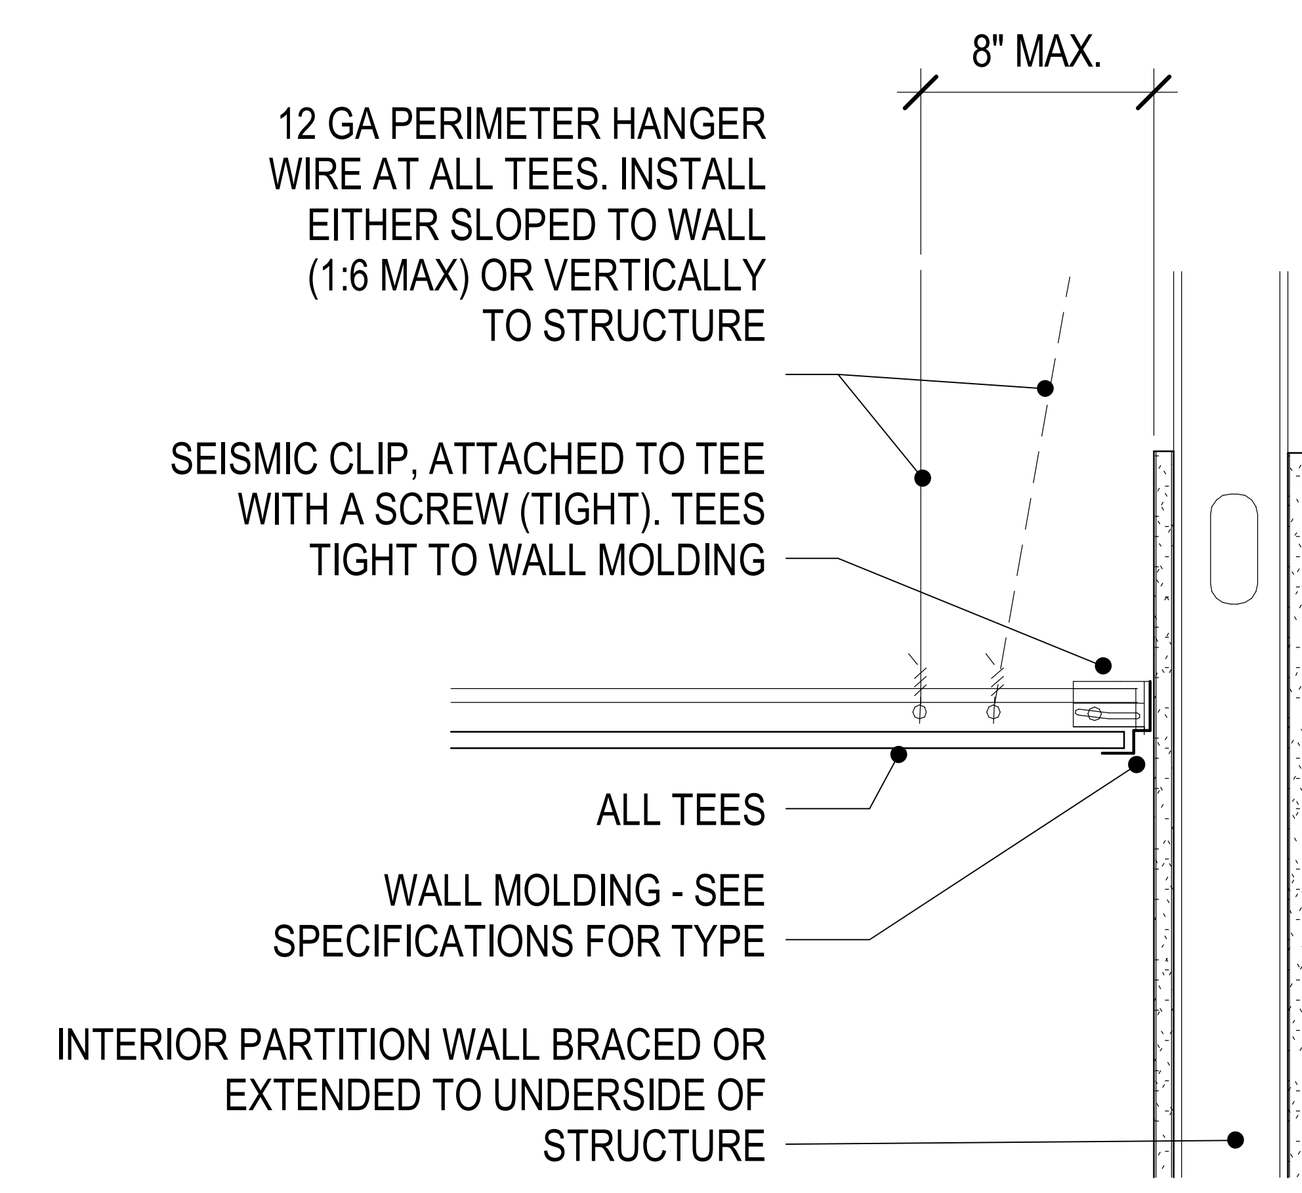

A.2 **FIXED SIDES**
TWO ADJACENT WALLS WITH GRID TEES ATTACHED TO SEISMIC CLIP. CLIP IS ATTACHED TO TEES WITH A TIGHTENED SCREW.

4 PERIMETER DETAILS W SEISMIC CLIPS
1 1/2" = 1'-0"

SEISMIC DESIGN CATEGORY C

CONNECTIONS/HANGERS	
HANGERS	#12 @ 4' O.C.
PLUMB	VERTICAL OR NOT MORE THAN 1 IN 6
CONNECTION DEVICES	MIN. 100 LBS
PERIMETER WIRES	MAXIMUM 8" FROM ALL WALLS

LATERAL FORCE BRACING	SEE DETAIL D3
4 WIRE CLUSTERS	REQUIRED OVER 1000 SF CEILING AREA
FIRST POINT	MAX. 6 FEET FROM PERIMETER WALLS
DEFLECTION	LIMITED TO LESS THAN 1/4"
SPACING	12'-0" O.C.
CONNECTION STRENGTH	MIN. 250 LBS
COMPRESSION POSTS	REQUIRED (CONDUIT/STEEL STUD)

MOLDING/PARTITIONS	SEE DETAILS A.1 & A.2
PERIMETER CLOSURE MOLDING	2 INCHES
ATTACHMENT TO GRID	REQUIRED @ 2 ADJACENT WALLS
CLEARANCE	3/4" @ 2 ADJACENT WALLS
SPACER BARS	REQUIRED AT UNATTACHED WALLS
PARTITION ATTACHMENT TO GRID	ALLOWED W/ BRACING, UNDER 2,500 SF

SEISMIC MATRIX

2 SEISMIC MATRIX
1/2" = 1'-0"

CEILING INSTALLATION NOTES:

A. THIS PROJECT IS LOCATED IN SEISMIC DESIGN CATEGORY C. IN ROOMS RECEIVING A COMPLETE CEILING REPLACEMENT, THE CEILING INSTALLATION SHALL BE PER THE REQUIREMENTS OF THE 2015 INTERNATIONAL BUILDING CODE, ASCE 7.16, ASTM E580, AND CISCA SEISMIC CONSTRUCTION HANDBOOK (2018 EDITION).

B. ALL CEILING GRID SHALL BE HEAVY DUTY.

C. CEILINGS AREAS UNDER 144 SF ARE EXEMPT FROM ALL SEISMIC FORCE REQUIREMENTS.

D. CEILING AREAS OVER 1,000 SF REQUIRE LATERAL FORCE BRACING. SEE DETAILS A3 & D3 ON THIS SHEET.

E. CEILING AREA SHALL NOT EXCEED 2,500 SF. USE SEISMIC SEPARATION JOINTS OR BULKHEADS BRACED TO THE STRUCTURE TO CREATE SUBSECTIONS. SUBSECTIONS SHALL NOT EXCEED A RATIO OF 4:1 FOR THE LONG SIDE TO THE SHORT SIDE.

F. FOR FIELD-TIED CONNECTIONS, VERTICAL HANGER WIRES MUST BE SHARPLY BENT AND WRAPPED WITH THREE TURNS IN 3 INCHES OR LESS.

G. WIRES MAY NOT ATTACH TO OR BEND AROUND INTERFERING EQUIPMENT. USE TRAPEZES TO AVOID SUCH OBSTACLES.

H. THE CISCA SEISMIC CONSTRUCTION HANDBOOK (2018 EDITION) STATES THAT LATERAL FORCE BRACING MUST START WITHIN 6 FEET OF TWO ADJACENT WALLS. IT IS NOT NECESSARY TO END THE LATERAL FORCE BRACING WITHIN 6 FEET OF THE OPPOSITE TWO WALLS. THE LAST LATERAL FORCE BRACE MUST ONLY BE WITHIN 12 FEET OF THE OPPOSITE WALLS. LATERAL FORCE BRACING MUST BE SPACED A MINIMUM OF 6 INCHES FROM UNBRACED HORIZONTAL PIPING OR DUCTWORK.

3 SEISMIC CEILING NOTES:
1 1/2" = 1'-0"

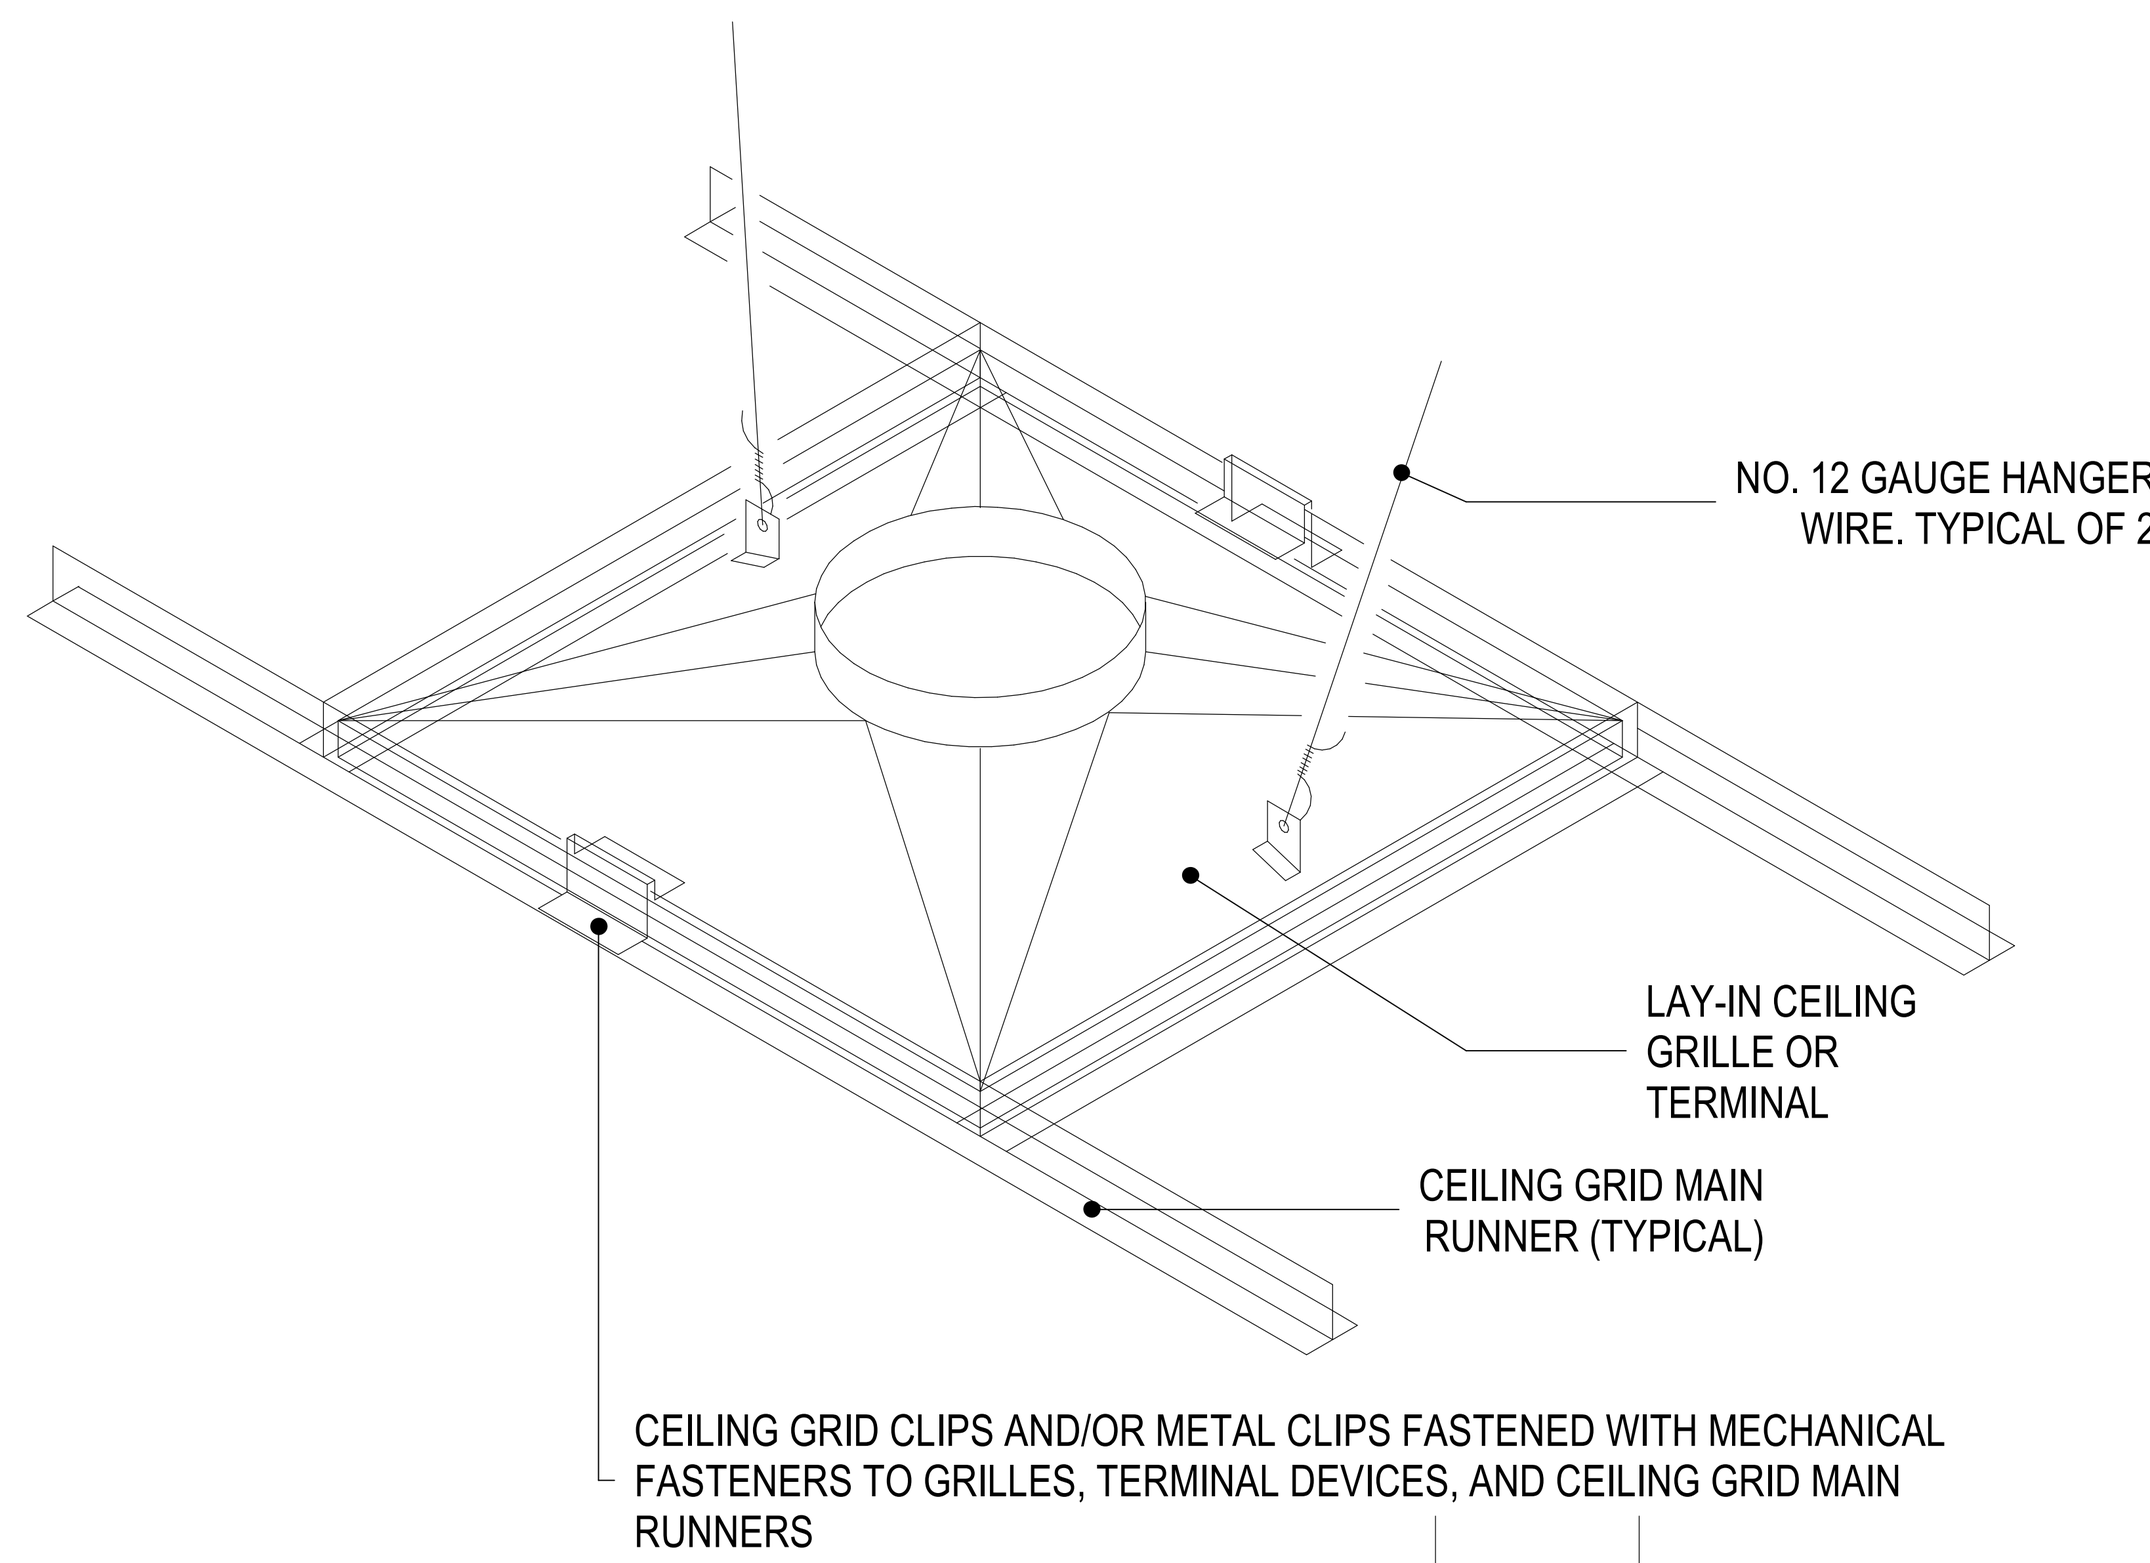

AIR TERMINAL ATTACHMENT NOTES:

CEILING MOUNTED AIR TERMINALS SERVICES WEIGHING 20 LBS OR LESS SHALL BE POSITIVELY ATTACHED TO THE CEILING SUSPENSION MAIN RUNNERS OR CROSS RUNNERS.

AIR TERMINALS OR SERVICES WEIGHING MORE THAN 20 LBS AND LESS THAN 56 LBS SHALL HAVE, IN ADDITION TO THE ATTACHMENTS NOTED ABOVE, TWO NO. 12 GAUGE HANGERS CONNECTED TO THE CEILING SYSTEM HANGERS OR TO THE STRUCTURE ABOVE. WIRES MAY BE SLACK.

AIR TERMINALS OR SERVICES WEIGHING MORE THAN 56 LBS SHALL BE SUPPORTED DIRECTLY FROM THE STRUCTURE ABOVE BY APPROVED HANGERS.

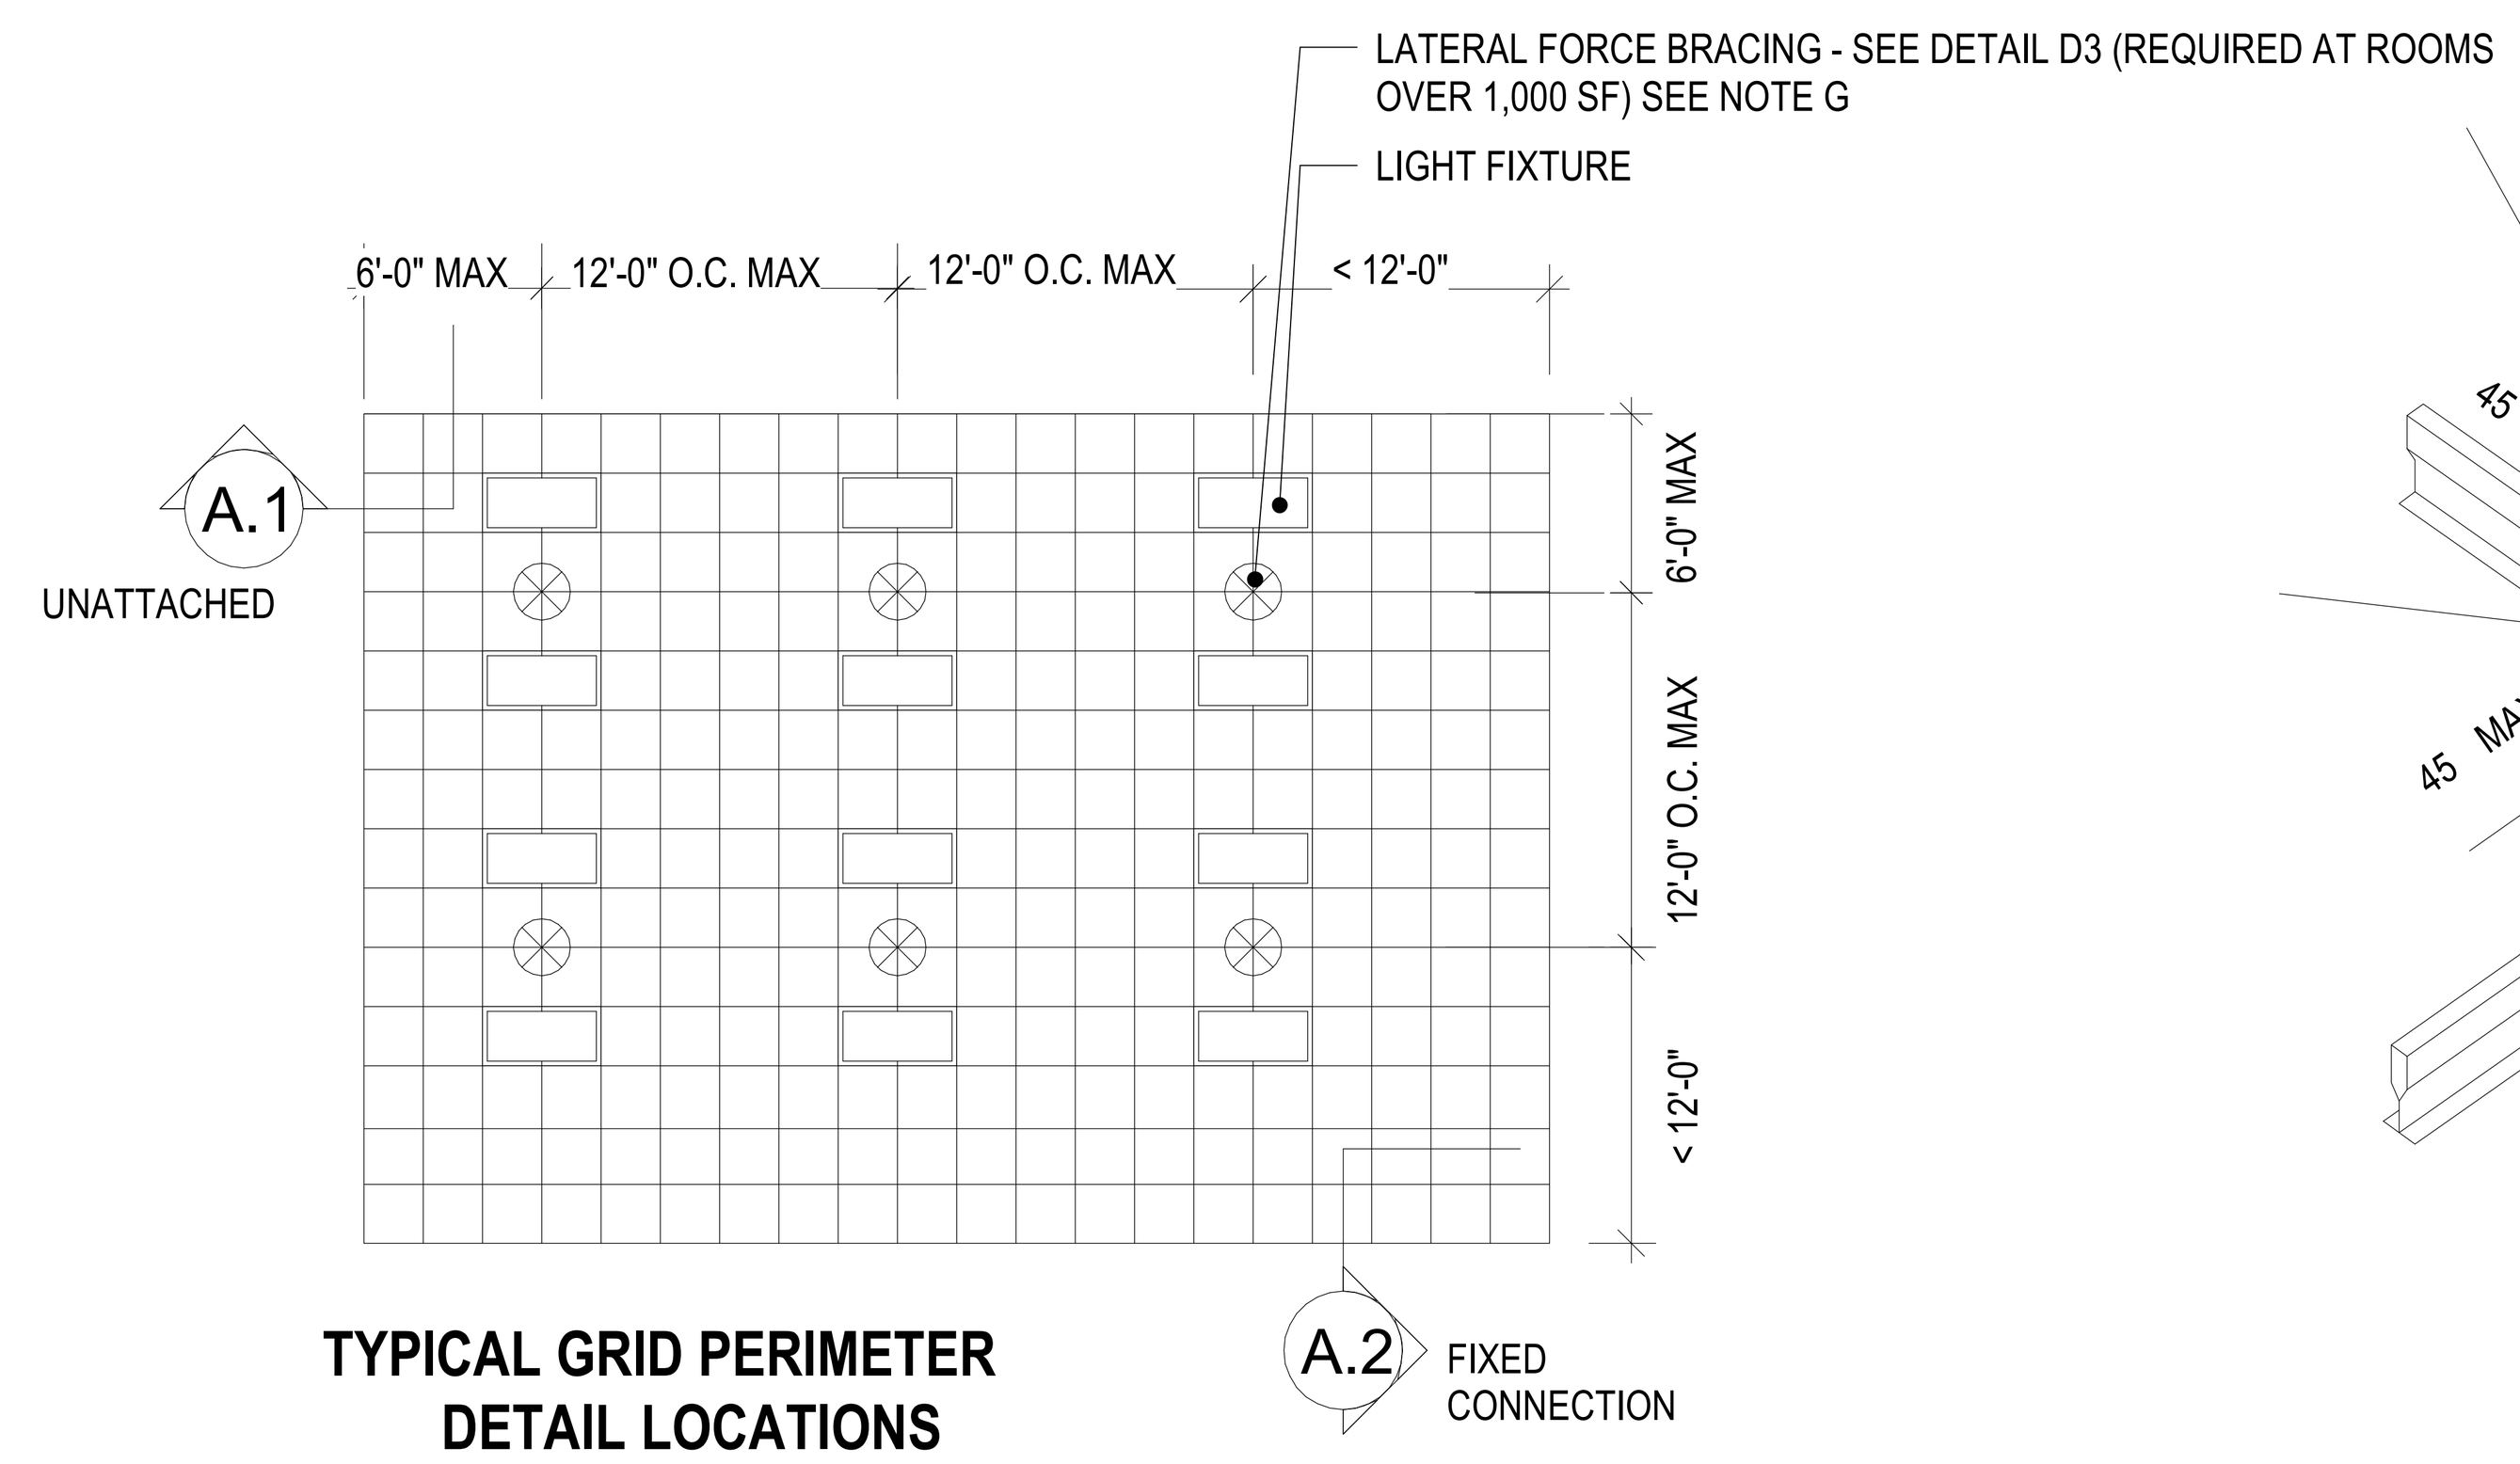

TYPICAL GRID PERIMETER DETAIL LOCATIONS

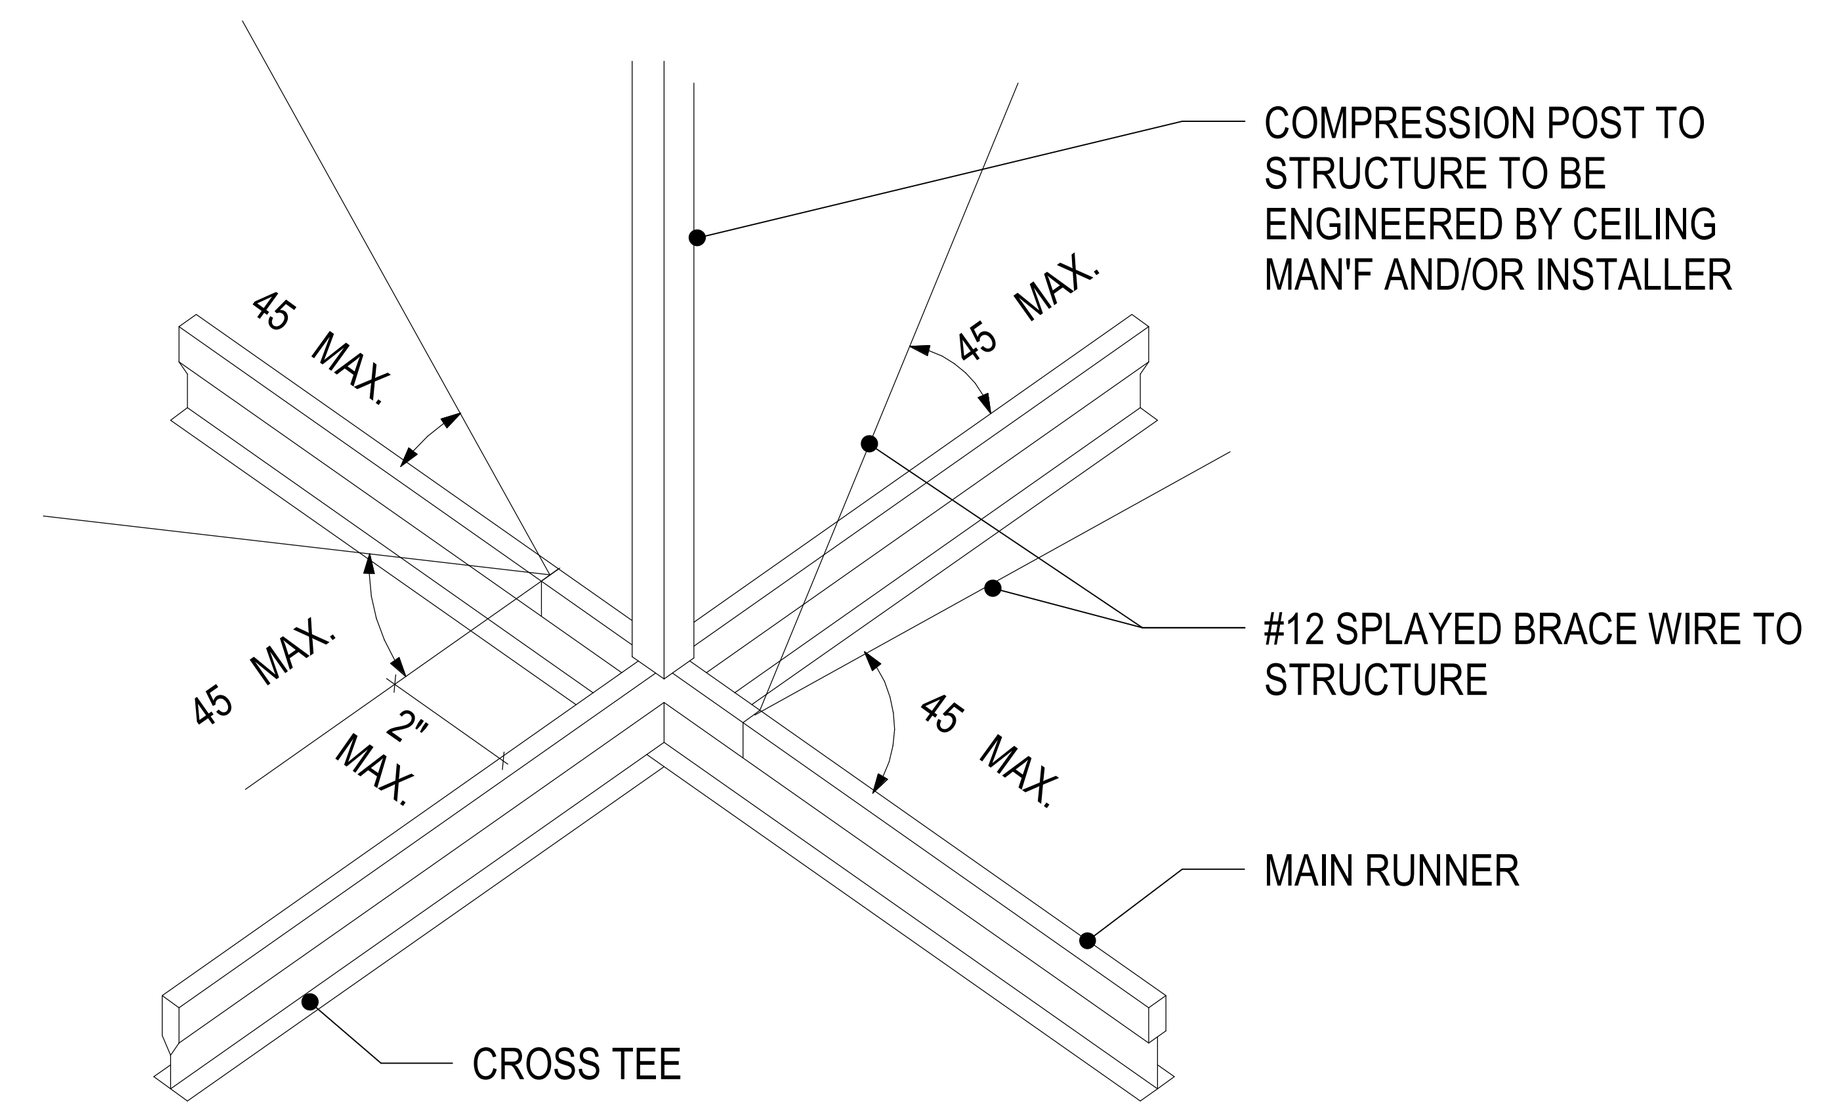

D.3 **LATERAL FORCE BRACING DETAIL (REQUIRED @ ROOMS OVER 1000 SF)**

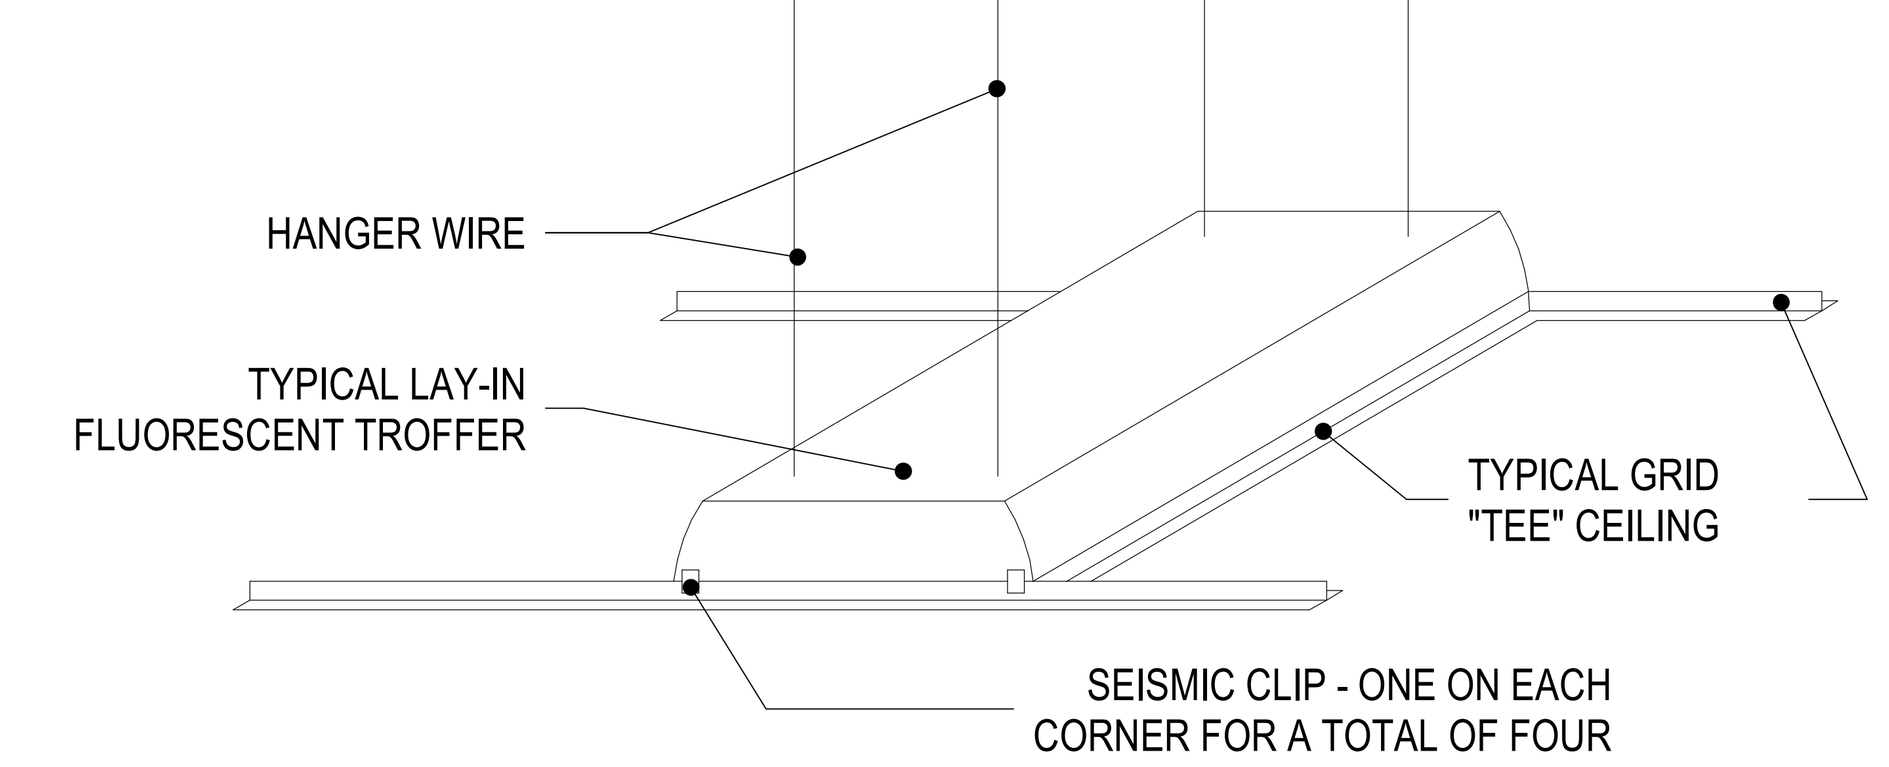

LIGHT FIXTURE ATTACHMENT NOTES:

FIXTURES AND ATTACHMENTS WEIGHING 10 LBS OR LESS REQUIRE ONE NO. 12 GAGE HANGER WIRE CONNECTED TO THE HOUSING AND THE STRUCTURE ABOVE. THE WIRE MAY BE SLACK.

FOR FIXTURES WEIGHING GREATER THAN 10 LBS AND LESS THAN OR EQUAL TO 56 LBS, TWO NO. 12 GAGE MINIMUM HANGER WIRES ARE REQUIRED TO BE CONNECTED TO THE FIXTURE HOUSING ON OPPOSITE DIAGONAL CORNERS AND CONNECTED TO THE STRUCTURE ABOVE. HANGER WIRES MUST BE INSTALLED VERTICAL, BUT NOT MORE THAN 1 IN 6 OUT OF PLUMB.

FIXTURES WEIGHING MORE THAN 56 LBS REQUIRE INDEPENDENT SUPPORT FROM THE STRUCTURE BY HANGERS APPROVED BY THE AUTHORITY HAVING JURISDICTION.

CLAMPING DEVICES FOR SURFACE MOUNTED LIGHT FIXTURES SHALL HAVE SAFETY WIRES TO THE GRID OR STRUCTURE ABOVE.

5 PERIMETER DETAIL LOCATIONS
1/2" = 1'-0"

6 LATERAL FORCE BRACING DETAIL
1/2" = 1'-0"

7 DIFFUSER/LIGHT FIXTURE
1/2" = 1'-0"

Revisions: Date:

CONSULTANT
Above Group ENGINEERING DESIGN CONSULTING
Mabbett Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD
THINKFORM ARCHITECTS
THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP
STATE OF MISSOURI RUSSELL DINARDO NUMBER A - 2024000203 ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)
VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
SEISMIC RCP DETAILS	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:		Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number: 1
		Issue Date: 06 MARCH 2026 / Checked: TB / Drawn: PS	Drawing Number: A508

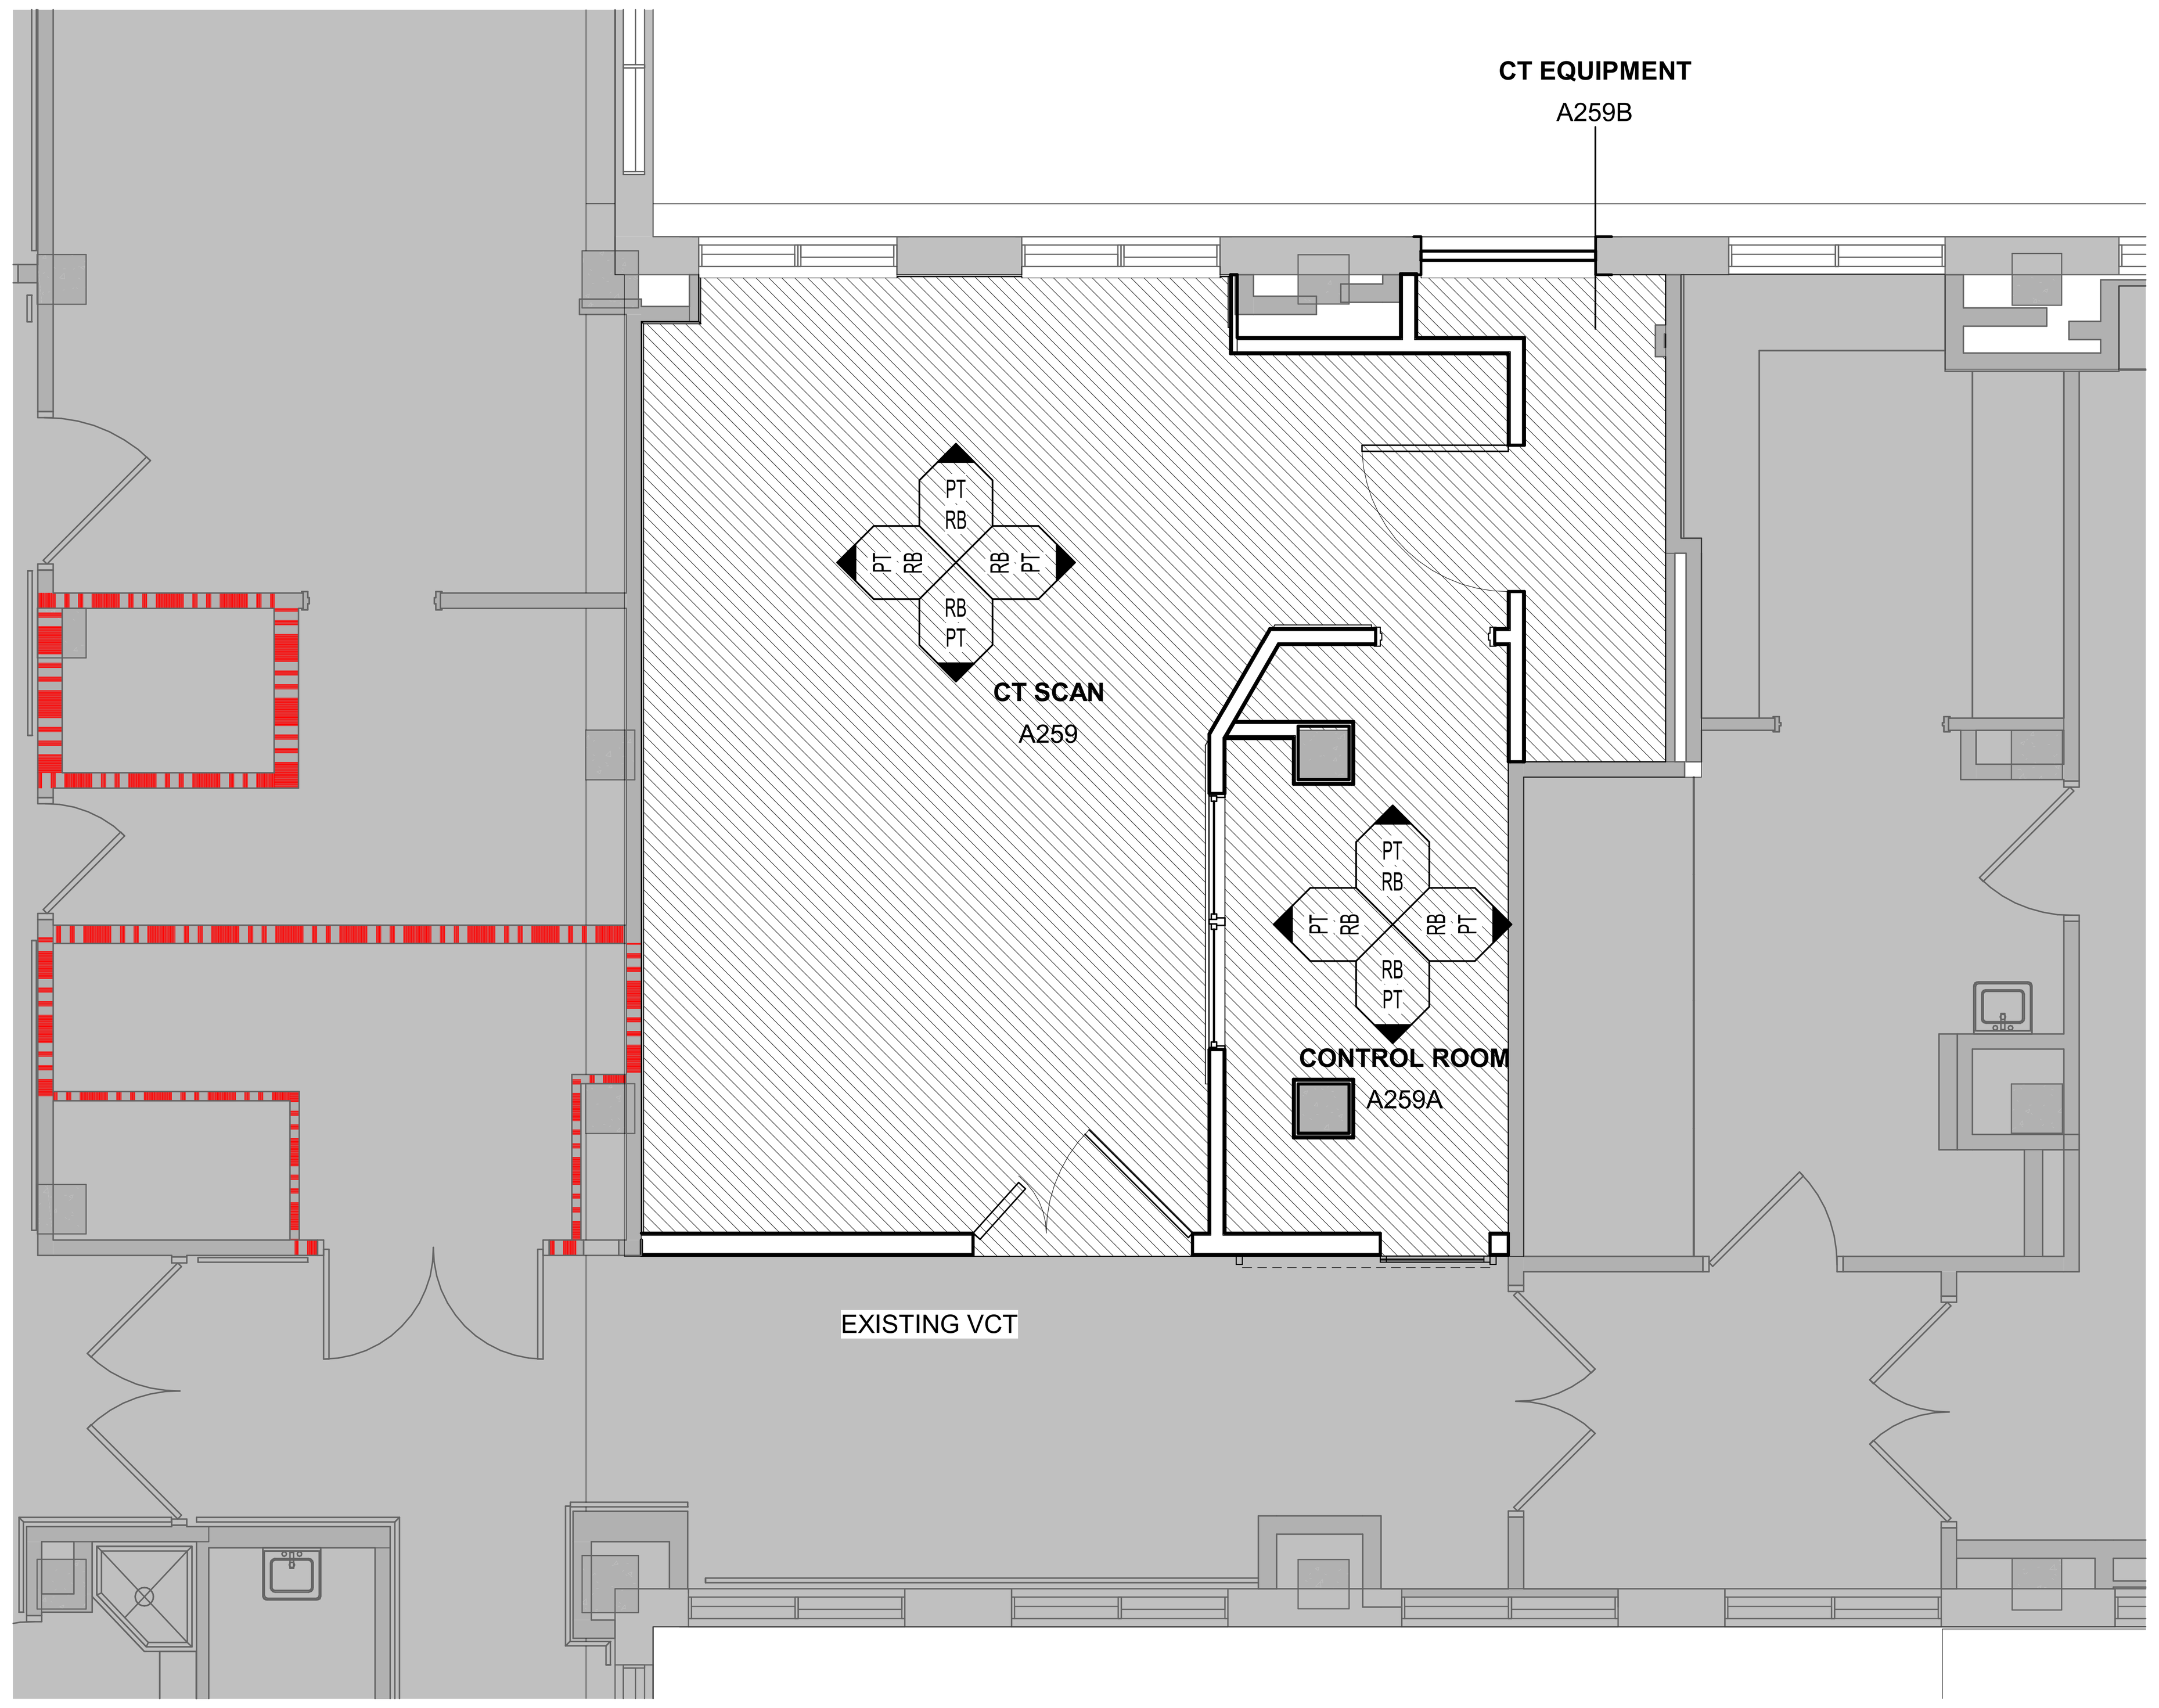

1 SECOND FLOOR FINISH PLAN
1/4" = 1'-0"

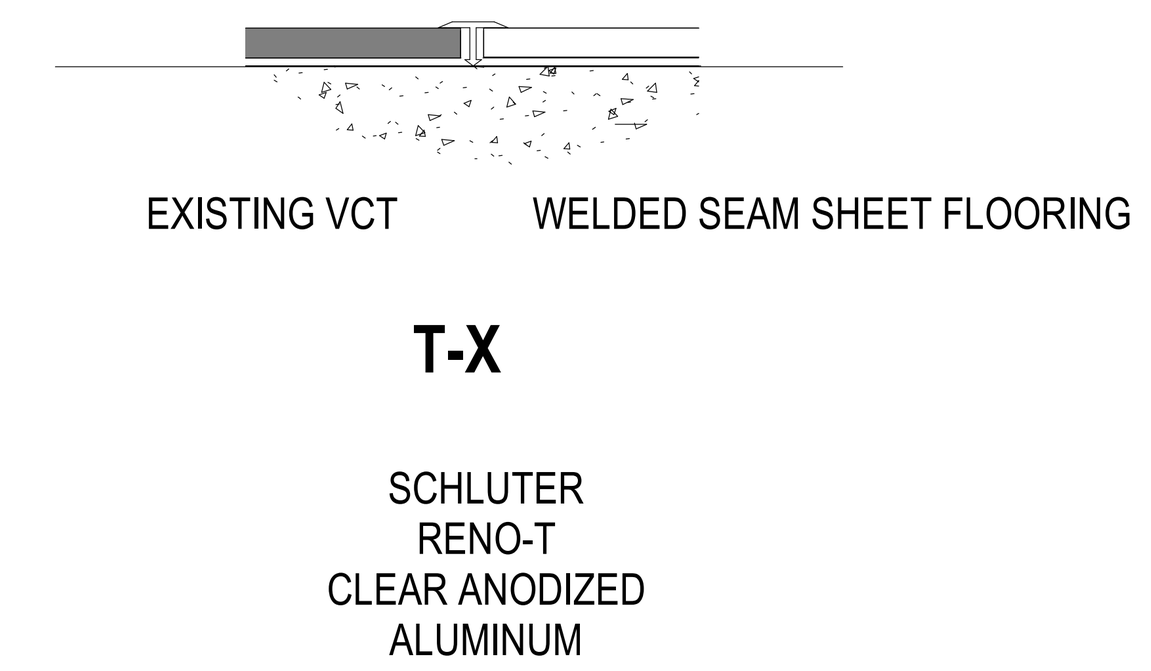

2 FLOOR TRANSITION DETAILS
6" = 1'-0"

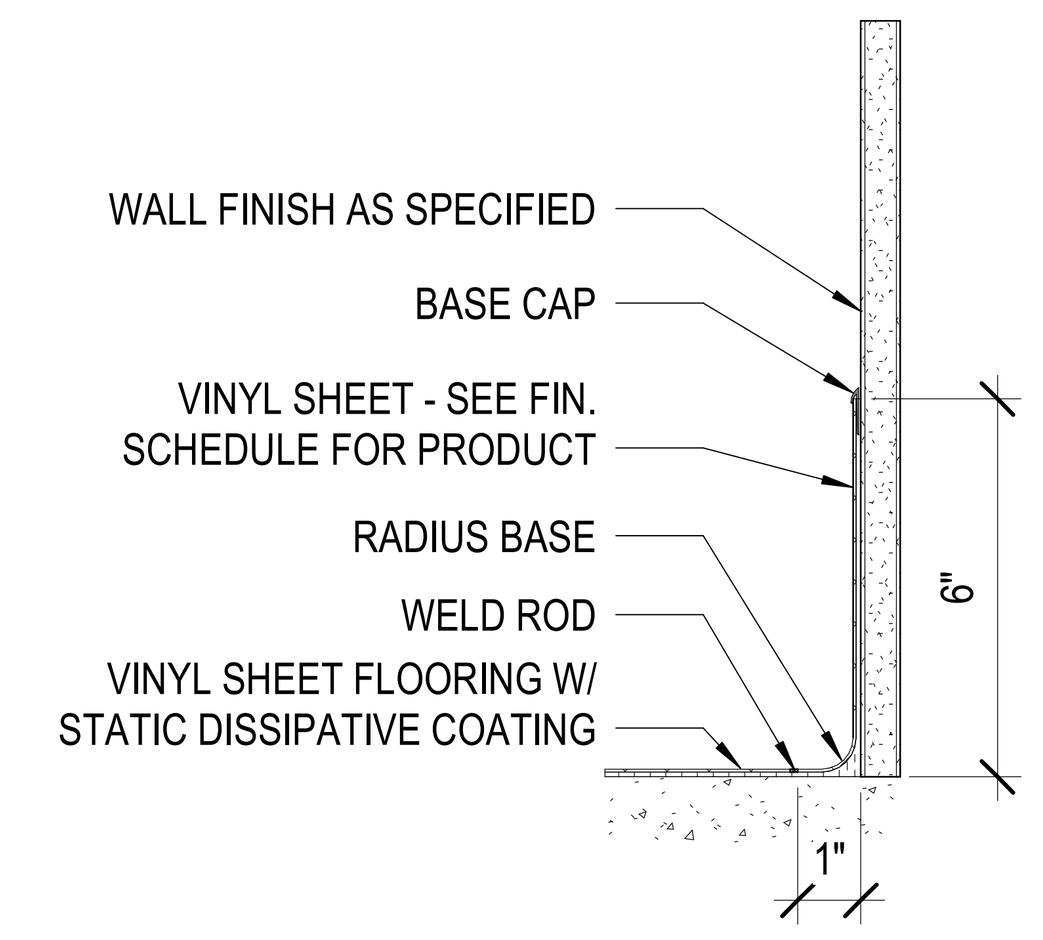

3 INTEGRAL BASE (SWV)
3" = 1'-0"

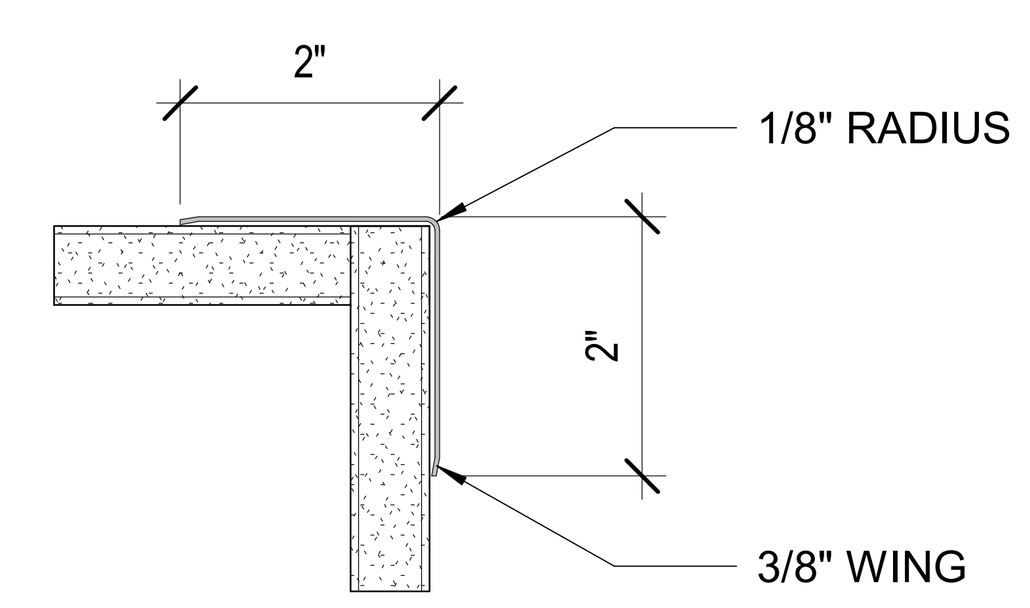

NOTE:
FORMED STAINLESS STEEL TYPE 304
#4 SATIN FINISH. 08 GAUGE. HEIGHT -72" TALL

5 STAINLESS STEEL CORNER DETAIL
6" = 1'-0"

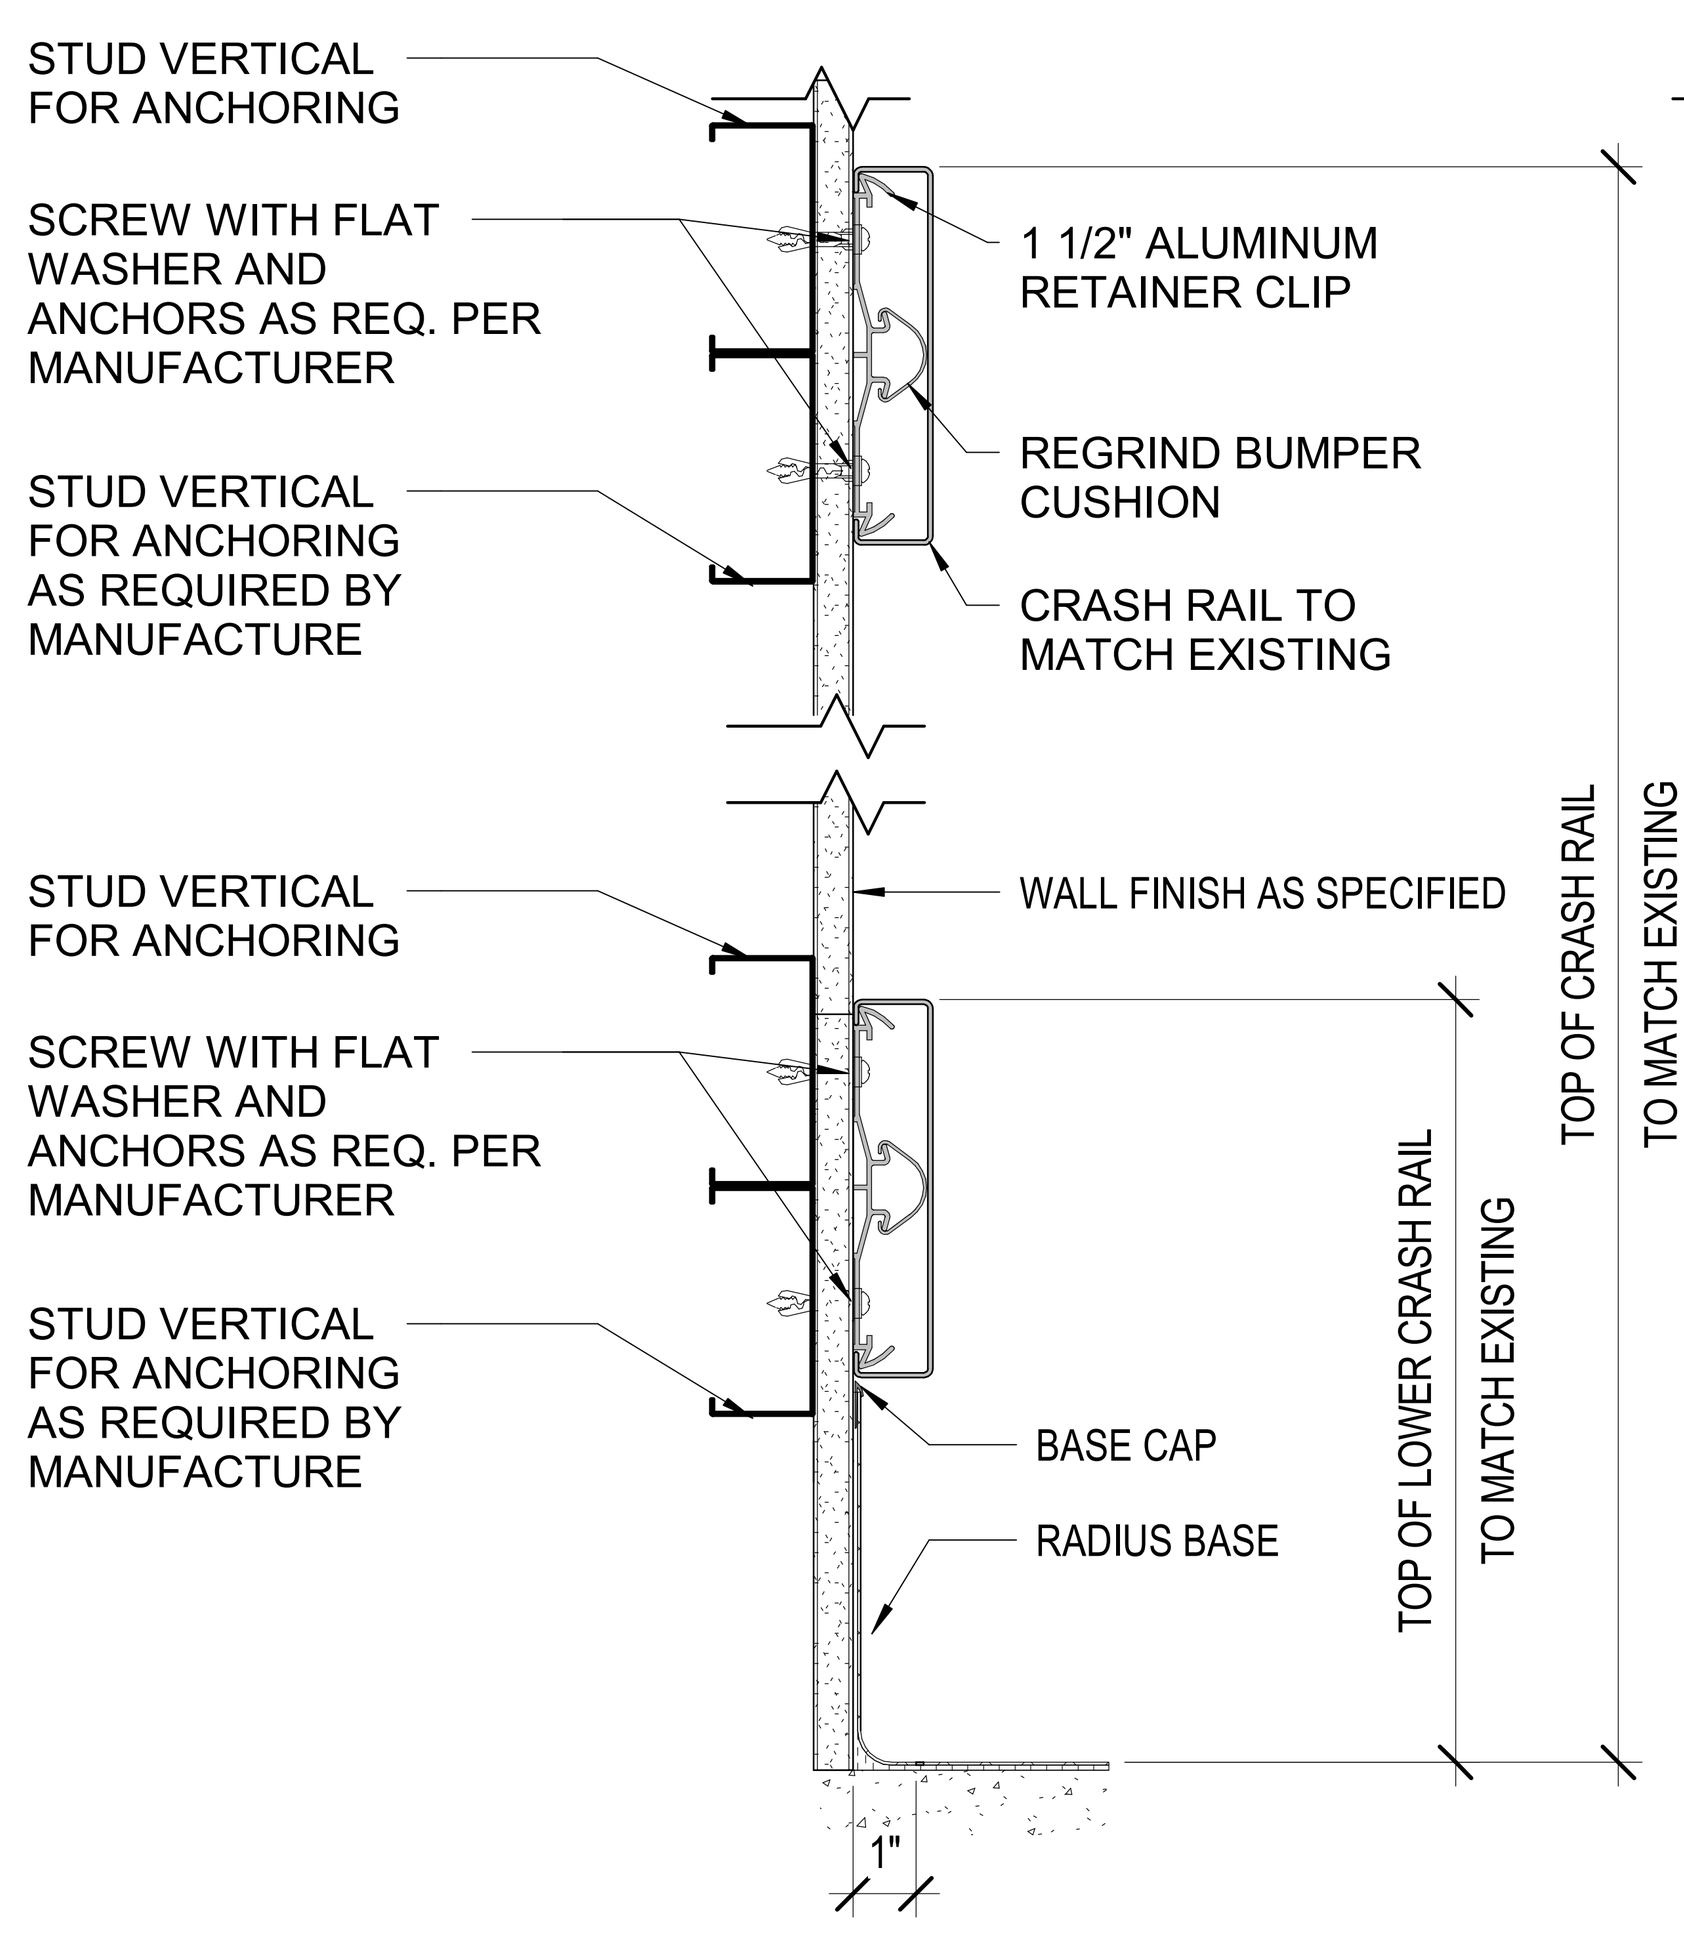

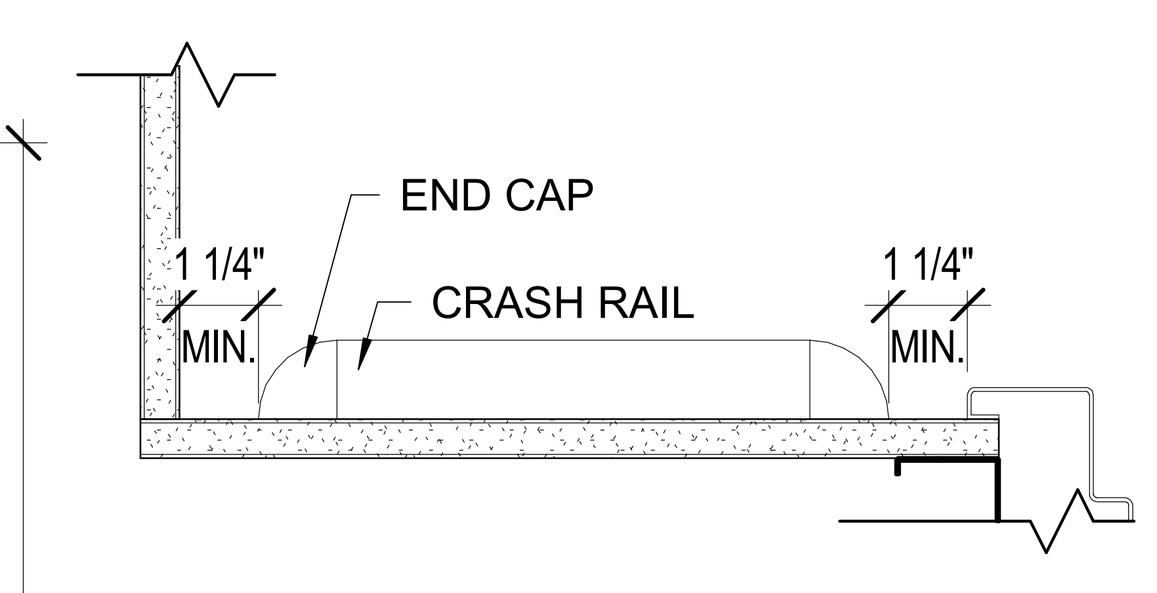

CRASH RAIL PLAN VIEW DETAILS

4 CRASH RAIL SECTION DETAIL
3" = 1'-0"

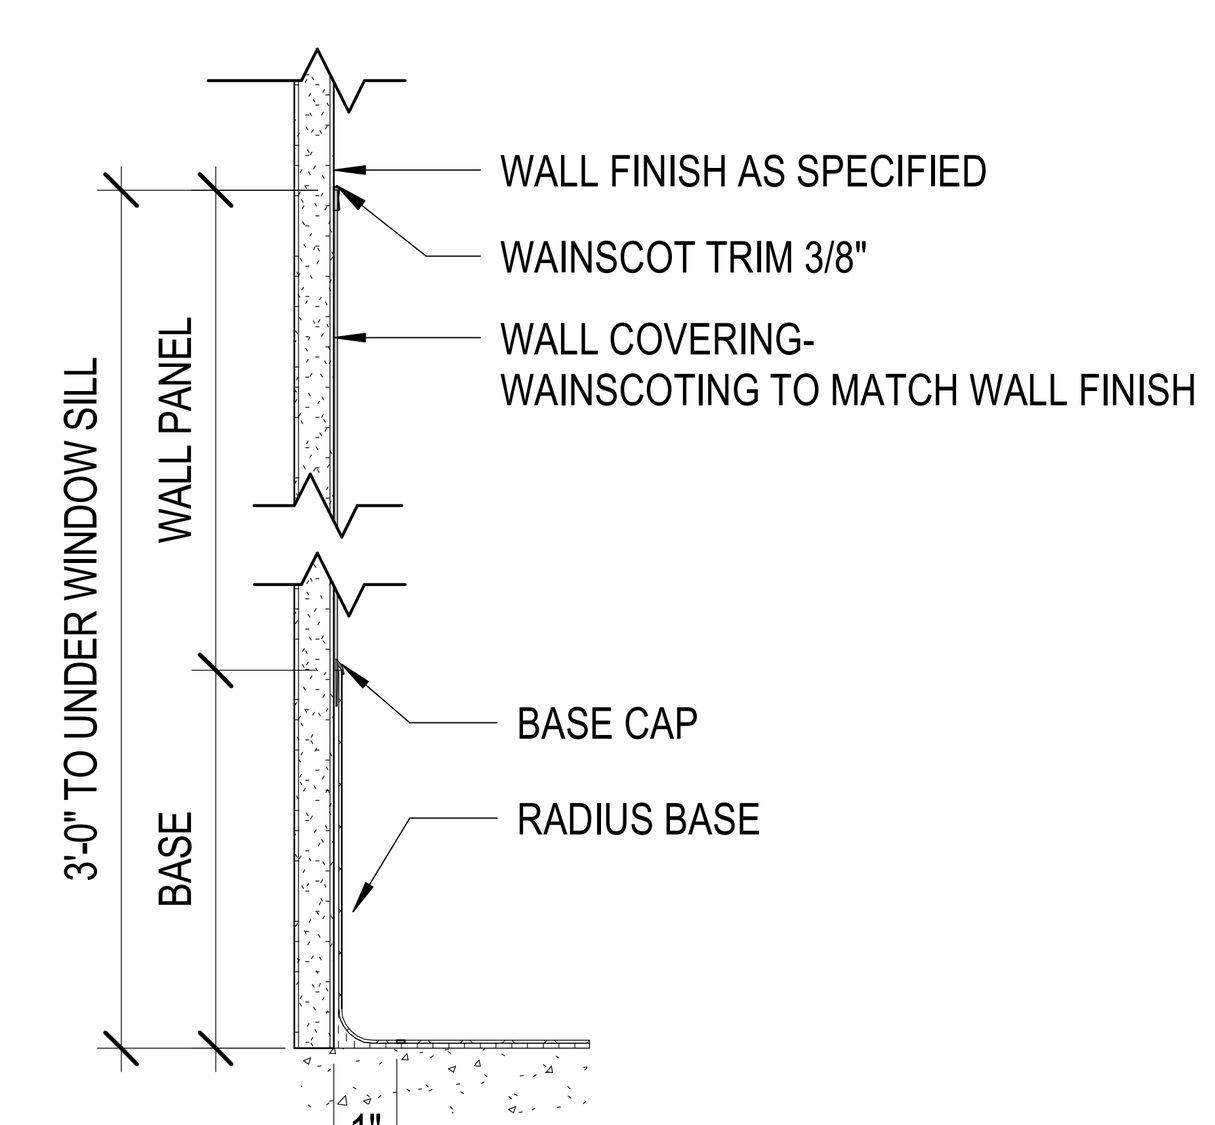

6 WALL PROTECTION - WAINSCOTING WITH TRIM SECTION DETAIL
3" = 1'-0"

KEY PLAN

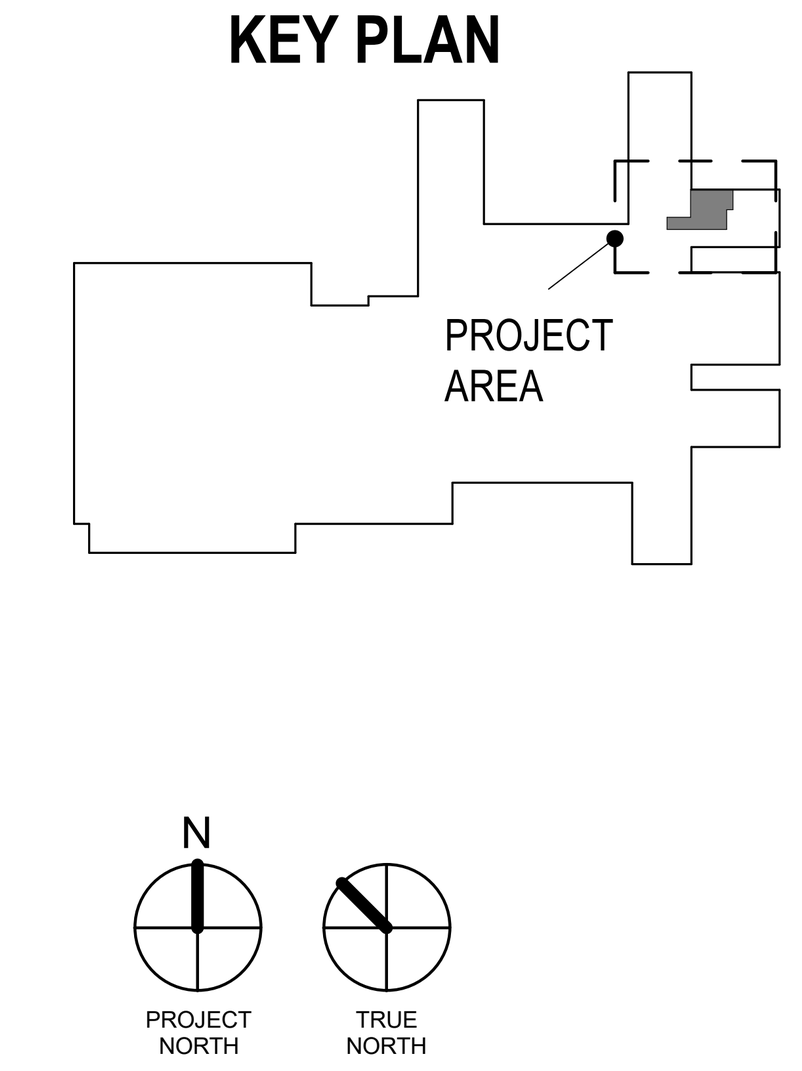

FLOOR FINISH LEGEND

XXX-# MATERIAL TYPE AND PATTERN ORIENTATION

XXX# WALL FINISH
XXX# BASE FINISH

ROOM FINISH TAG

NOT IN SCOPE

SWV 1 - SEAMLESS WELDED VINYL 1 (MEDELLA HUES C2062, NATURAL GRAY LIGHT H5304)

GENERAL FINISHES NOTES:

A. PRIOR TO INSTALLATION AND FABRICATION, CONTRACTOR SHALL COORDINATE WITH ARCHITECT AND INTERIOR DESIGNER TO REVIEW ALL FLOOR PATTERNS AND FINISHES.
B. PAINT METAL WALL-MOUNTED ACCESS DOORS, GRILLS, RETURN AIR GRILLES, COVER PLATES, FAN COIL UNITS, FIRE EQUIPMENT CABINETS, AND ELECTRICAL CABINETS TO MATCH THE ADJACENT SURFACE UNLESS NOTED OTHERWISE.
C. ALL FLOOR FINISH CHANGES SHALL OCCUR AT THE CENTER LINE OF CLOSED DOORS.
D. FLOOR PATTERN TO CONTINUE UNDER ALL OPEN WOODWORK WORK SURFACES UNLESS NOTED OTHERWISE.
E. IN AREAS INDICATED BY THE FINISH SCHEDULE TO BE PAINTED AND WHERE NO CEILING IS INDICATED, PAINT SHALL EXTEND TO THE BOTTOM OF THE FLOOR OR ROOF STRUCTURE (TYPICAL). REFER TO THE FINISH SCHEDULE FOR PAINTING OF EXPOSED STRUCTURE.
F. ALL UPPER AND LOWER CABINET FACES, SUPPORTS, AND SKIRTS SHALL BE **WILSONART, PHANTOM PEARL 8211**, UNLESS OTHERWISE NOTED.
G. SEE TRANSITION DETAILS ON **SHEET TBD** FOR TRANSITION BETWEEN FLOORING MATERIALS.

FINISH SCHEDULE

RM NO.	ROOM NAME	FLOOR	BASE	NORTH WALL	EAST WALL	SOUTH WALL	WEST WALL	CEILING	CASEWORK	NOTES
A259	CT SCAN	SVW	RB	PT	PT	PT	PT	ACT	PL, SS	DOCUMENT PG-18-14 RECOMMENDS INTEGRAL BASE. VA TO CONFIRM IF A RUBBER BASE OR INTEGRAL WELDED SEAM BASE IS PREFERRED.
A259A	CONTROL ROOM	SVW	RB	PT	PT	PT	PT	ACT	PL, SS	DOCUMENT PG-18-14 RECOMMENDS INTEGRAL BASE. VA TO CONFIRM IF A RUBBER BASE OR INTEGRAL WELDED SEAM BASE IS PREFERRED.
A259B	CT EQUIPMENT	SVW	RB	PT	PT	PT	PT	ACT	N/A	DOCUMENT PG-18-14 RECOMMENDS INTEGRAL BASE. VA TO CONFIRM IF A RUBBER BASE OR INTEGRAL WELDED SEAM BASE IS PREFERRED.
H208	CORRIDOR	N/A	X	X, WP	N/A	N/A	N/A	N/A	N/A	FLOORING, CEILING, EAST WALL, SOUTH WALL AND WEST WALL NOT IN SCOPE

CABINETRY & MILLWORK

KEY	FINISH MATERIAL	MANUF.	ITEM NUMBER/COLOR/FINISH	SIZE	NOTES
PL	PLASTIC LAMINATE	WILSONART	PHANTOM PEARL 8211	N/A	
SS	SOLID SURFACE	CORIAN	ARROWROOT	N/A	

CASEWORK HARDWARE/SPECIALITIES

KEY	FINISH MATERIAL	MANUF	ITEM NUMBER/COLOR/FINISH	SIZE	NOTES
CH 1	CASEWORK HARDWARE 1				
CH 2	CASEWORK HARDWARE 2				

FLOOR FINISHES

KEY	FINISH MATERIAL	MANUF.	ITEM NUMBER/COLOR/FINISH	SIZE	NOTES
SWV 1	SEAMLESS WELDED VINYL 1	MOHAWK GROUP	MEDELLA HUES C2062, NATURAL GRAY LIGHT H5304	6' W	HOMOGENOUS SHEET WITH QUANTUM GUARD HP FINISH - BIOSPEC MD. WELD RODS TO MATCH COLOR.
X	MATCH EXISTING CONDITIONS				

BASE & TRIM FINISHES

KEY	FINISH MATERIAL	MANUF.	ITEM NUMBER/COLOR/FINISH	SIZE	NOTES
RB	RUBBER BASE	ROPPE	700 SERIES WALL BASE 2024 70-100, BLACK	4"	ACCORDING TO PG-18-14, THE VA REQUIRES SVW INTEGRAL BASE. PLEASE CONFIRM WHETHER A SEPARATE OR INTEGRAL BASE WOULD BE PREFERRED
SWV	SEAMLESS WELDED VINYL	MOHAWK GROUP	MEDELLA HUES C2062, NATURAL GRAY LIGHT H5304	6' W	
X	MATCH EXISTING CONDITIONS				

PAINT/WALL FINISHES

KEY	FINISH MATERIAL	MANUF.	ITEM NUMBER/COLOR/FINISH	SIZE	NOTES
DWP 1	DECORATIVE WALL PANEL 1				
PT 1	PAINT 1 (WALL)	SHERWIN WILLIAMS	SEA SALT SW6204	N/A	
PT 2	PAINT 2 (ACCENT)	SHERWIN WILLIAMS	PURE WHITE SW7005	N/A	
WP	WALL PROTECTION TO MATCH EXISTING				EXISTING WALL MOUNTED HANDRAILS AND BUMPERS TO BE RE-INSTALLED FOLLOWING CONSTRUCTION
X	MATCH EXISTING CONDITIONS				

CEILING FINISHES

KEY	FINISH MATERIAL	MANUF.	ITEM NUMBER/COLOR/FINISH	SIZE	NOTES
ACT	ACOUSTICAL CEILING TILE	ARMSTRONG	ULTIMA LAY-IN	24X24	9/16" SUPRAFINE GRID
X	MATCH EXISTING CONDITIONS				

Revisions: Date:

CONSULTANT
Above Group
Mabbett

ARCHITECT/ENGINEER OF RECORD
THINKFORM
THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP
STATE OF MISSOURI
RUSSELL DINARDO
NUMBER
A - 2024000203
ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)
VA U.S. Department of Veterans Affairs

Drawing Title: SECOND FLOOR PLAN, FINISH LEGEND, NOTES & DETAILS
Approved:
Phase: 100% CONTRACT DOCUMENTS FOR BIDDING
Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date: 06 MARCH 2026
Checked: TB
Drawn: PS
Project Number: 657-23-104JC
Building Number: 1
Drawing Number: A600

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/657-23-104JC_657-JC-01-02_ARCH.rvt
3/3/2026 2:40:36 PM

EQUIPMENT SCHEDULE

C/C - CONTRACTOR ACQUIRED / CONTRACTOR INSTALLED
V/V - VA ACQUIRED / VA INSTALLED
V/C - VA ACQUIRED / CONTRACTOR INSTALLED

JSN	NAME	ACQ/INS	DESCRIPTION
A1010	Telecommnication Outlet	VV	Telecommunication outlet location.
A1012	Wall Mounted Telephone	VV	Telephone, wall mounted, 1 line.
A1015	Telephone	VV	Telephone, desk, multiple line
A5075	Soap Dispenser	VV	Disposable soap dispenser. One-handed dispensing operation. Designed to accommodate disposable soap cartridge and valve.
A5077	Dispenser, Hand Sanitizer, Hands-Free	VV	A touch free wall-mounted hand sanitizer dispenser. For use throughout a healthcare facility. Unit does not include the sanitizing liquid. Units are battery operated.
A5080	Dispenser, Paper Towel, SS, Surface Mounted	CC	A surface mounted, satin finish stainless steel, single-fold, paper towel dispenser. Dispenser features: tumbler lock; front hinged at bottom; and refill indicator slot. Minimum capacity 400 single-fold paper towels. For general purpose use throughout the facility.
A5097	Dispenser, Personal Protection, Mobile	VV	
A5106	Waste Disposal Unit, Sharps w/Glove Dispenser	VV	The unit is designed for the disposal of sharps and complies with OSHA guidelines for the handling of sharps. It shall house a 5 quart container and be capable of being mounted on a wall. It shall have a glove dispenser attached. The unit shall be secured by a locked enclosure.
A5107	Dispenser, Glove, Surgical/Examination, Wall Mntd	VV	Examination glove dispenser box for wall mounting. Fabricated of either cold rolled steel with a white baked enamel finish, plastic or acrylic. Provided with wall bracket to facilitate mounting and demounting.
A5108	Waste Disposal Unit, Sharps	VV	A container for collecting and transporting syringes and other sharps for decontamination and disposal. Available in 2 gallon and 8 gallon with locking rotor. Complies with OSHA regulations for handling sharps.
A5145	Hook	CC	a surface mounted, satin finish stainless steel, double garment hook. equipped with a concealed mounting bracket that is secured to a concealed wall plate. for general purpose use throughout the facility to hang various items of apparel.
A5180	Track, Cubicle, Surface Mounted, With Curtain	VV	Surface mounted cubicle track, with curtain. Track constructed of thick extruded aluminum. Equipped with self lubricating carriers, beaded drop chain hooks, and flame resistant curtain. To include removable end caps. Designed to be suspended around patient areas where privacy is needed. Price listed is per foot of the track, curtains to be priced per quote.
C03G0	Cabinet, U/C/B, 1 Shelf, 2 Half DR, 2 DO	CC	Standing height under counter base cabinet with an adjustable shelf and two half width drawers above solid hinged doors. Also referred to as a combination cabinet or a drawer and cupboard cabinet. For general purpose use throughout the facility.
CD020	Cabinet, W/H, 2 Shelf, 2 DO, Sloping Top	CC	Wall hung Plastic Laminate cabinet with two adjustable shelves, solid hinged doors, and sloping top. Also referred to as a solid hinged double door wall case. For general purpose use throughout the facility.
CD024	Cabinet, Tall full height	CC	Millwork Tall Plastic Laminate cabinet
CD030	Cabinet, W/H, 2 Shelf, 2 DO, Sloping Top	CC	Wall hung Plastic Laminate cabinet with two adjustable shelves, solid hinged doors, and sloping top. Also referred to as a solid hinged double door wall case. For general purpose use throughout the facility.
CS070	Sink, SS, Single Compartment,	CC	Single compartment stainless steel sink, drop-in, self-rimming, ledge-type, connected with a drain and provided with a mixing faucet. Brushed/polished interior and top surfaces, and sound deadened. For general purpose use throughout the facility.
CT020	Countertop, Solid Surface	CC	A solid, nonporous countertop with a smooth seamless appearance. Easy to clean and maintain and with proper cleaning does not support the growth of mold. Also referred to as a work surface or work top. Used in lab and other hospital areas requiring optimum physical and chemical resisting properties.
E0945	Cart, Computer, Mobile	VV	A mobile computer cart for use throughout the facility. The cart dimensions will be approximately 45" H x 30" W x 22" D with casters. May include drawers and miscellaneous other accessories that will be determined at time of purchase. This Typical may include: 1 Cart Body, w/Computer Support, Style-A Narrow, w/Raised Edge Top 1 Flip-Up Shelf 1 Sharps Container Holder 1 Wastebasket 1 Chart Holder 2 Drawers, 3"H 2 Drawers, 6"H 3 Accessory Rail, Side Drawer Organizer Bins
E0948	Cart, General Storage, Mobile, 42"H x 32"W x 22"D	VV	THIS TYPICAL INCLUDES: 1 Cart Body, Style-A Narrow, w/Raised Edge Top; 2 Drawers, 3" H ; 4 Drawers, 6" H ; 1 Accessory Rail, Side; Drawer Organizer Bins
E0954	Cart, Emergency, Mobile, 66"H x 32"W x 22"D	VV	THIS TYPICAL INCLUDES: 1 Cart body, style-A narrow, w/raised edge top 1 Accessory rail, side 1 Accessory rail, back 1 Defibrillator tray 1 IV pole 1 Breakaway bar 1 Flip-up shelf 1 Wastebasket 1 Oxygen tank holder 1 Electrical box-4 outlet 1 Cord wrap 4 Drawer, 3"H 3 Drawer, 6"H Drawer organizer bins.
F0275	Chair Swivel High Back	VV	Highback contemporary swivel chair, 41" high X 23" wide X 23" deep with five (5) caster swivel base and arms. Chair may be used at desks or in conference rooms. Back and seat are foam padded and upholstered with either woven textile fabric or vinyl.
F0340	Stool, Self Adjusting	VV	Self adjusting stool. Consists of a foam padded upholstered seat with attached foot rest for added comfort. Mounted on swivel casters. Designed for doctor's use during examinations.
F0350	Stool, Step, Retractable Caster	VV	Step stool. Used to assist patients getting on and off exam or surgical tables. Fitted with electrically conductive rubber tips.
F0360	Footstool, Straight w/Handle	VV	Step stool. Used to assist patients getting on and off exam or surgical tables. Fitted with electrically conductive rubber tips.
F2000	Basket, Wastepaper, Fire Resistant	VV	Round wastepaper basket, approximately 18" high X 16" diameter. This metal unit is used to collect and temporarily store small quantities of paper refuse in patient rooms, administrative areas and nursing stations. NSN: 7520002051857 JSN: F2000
F2700	Reader, Bar Code, Hand Held	VV	Hand held laser bar code reader with computer interface. Used for automated inventory, using bar code stickers / labels. Convenience outlet required at point of use.
F3065	White Board, Bulletin Board	VV	A combination whiteboard and bulletin board, half LCS and half cork. Available with either aluminum or wood frame. It can be used in patient rooms or in any appropriate space in the facility.
F3200	Clock	VV	Clock, 12" diameter. Round surface, easy to read numbers with sweep second hand. Wall mounted unit for use when impractical to install a fully synchronized clock system. Battery operated, (batteries not included).
L0100	Microscope, Binocular	VV	Binocular microscope. Equipped with plan achromatic objectives to suit work in brightfield, phase contrast, darkfield, photomicrography, dual viewing and projection screen. Microscope has a high light intensity, 100 watt halogen lamp, for constant color temperature and illumination, a three step variable transformer, focusable aspheric abbe condenser system; heat absorbing glass; centerable field diaphragm; two built-in filter turrets permitting a combination of selective light balancing and color compensating filters. Other components/features include a swing-in condenser, 4X objective, quadruple nosepiece, 10X wide field eyepieces and a graduated stage. Other observation tubes can be added. It is used in laboratories for cell counting and other observation techniques.
M0750	Flowmeter, Air, Connect w/50 PSI Supply	VV	Air flowmeter. Unit has a stainless steel needle valve with clear flowtube for connection to 50 PSI air outlet from central pipeline system. Requires the appropriate adapter for connection to the wall outlet and fitting to connect to tubing. Database prices reflect fittings with an attached DISS power outlet. Other outlet and adapter configurations are available.
M0755	Flowmeter, Oxygen, Low Flow	VV	Oxygen flowmeter. Consists of a clear crystal flowtube calibrated to 3.5 or 8 LPM depending on manufacturer. For oxygen regulation in hospital settings. Database pricing includes DISS fitting and DISS power outlet and wall adapter. Other fitting and adapter configurations are available.
M0765	Regulator, Vacuum	VV	Vacuum pressure regulator for connection to central piped vacuum system. Standard display scale is graduated at least from 0 to 200 mm Hg of vacuum. Displays on specialized regulators may cover other vacuum ranges. Regulator type (continuous, intermittent, continuous/intermittent, surgical, pediatric, thoracic, etc.) as required. To be used in delivery, neonatal, pediatrics or any area where suction is required. Database pricing reflects continuous regulators graduated to 200 mm Hg with a full line vacuum selection switch and DISS configured inlets and outlets.
M1415	reader bar code	VV	Hand held laser bar code reader with computer interface. Used for automated inventory, using bar code stickers / labels. Convenience outlet required at point of use.

EQUIPMENT SCHEDULE

C/C - CONTRACTOR ACQUIRED / CONTRACTOR INSTALLED
V/V - VA ACQUIRED / VA INSTALLED
V/C - VA ACQUIRED / CONTRACTOR INSTALLED

JSN	NAME	ACQ/INS	DESCRIPTION
M1801	Monitor computer	VV	PC monitor. Keyboard
M1840	Printer/fax/scanner/ combination	VV	multifunctional printer, fax, scanner and copier (pfc) all-in-one machine.
M3070	hamper linen	VV	Mobile linen hamper with hand or foot operated lid. Made of heavy tubular stainless steel with heavy gauge welded steel platform. Holds 25" hamper bags. Mounted on ball bearing casters. For linen transport in hospitals and clinics.
M3073	infectious waste	VV	A biohazard waste container with a step-on lid. The container will have a capacity of approximately 12 gallons and be made of a fire safe material.
M3150	Distribution System, Medication, Automatic	VV	An automated dispensing system that provides controlled dispensing, inventory and security. Size and cost will vary dependent on number of modules selected.
M4116	Vital Sign Monitor	VV	Electronic sphygmomanometer. LCD displays non-invasive blood pressure, pulse rate and temperature. Used in hospitals and clinics. Includes an optional mobile stand.
M4255	Stand, IV, Adjustable	VV	Adjustable IV stand with 4-hook arrangement. Stand has stainless steel construction with heavy weight base. It adjusts from 66 inches to 100 inches and is mounted on conductive rubber, ball bearing, swivel casters. Stand is used for administering intravenous solutions.
M4645	Patient Transfer Device	VV	A patient transfer board designed to make lateral patient transfers safer for staff and be more comfortable for the patients. The board uses a smooth, low friction and static free surface to eliminate the need for metal rollers. The board has a soft foam core that makes them lightweight for ease of use and storage. The long board device also enables the transfer of a patient in the seated or Fowler position. The boards come in three sizes with the long board being foldable. The dimensions and price are for the long wide board.
M7401	Light, Exam, Mobile, Spotlight, Mobile Stand	VV	The exam light shall be a mobile floor unit. The light will be a halogen bulb or LED that can produce a continuous and homogeneous spot of light adjustable from 5 to 9 inches in diameter from a set distance. The light intensity shall be a minimum of 750 foot-candles at a distance of 16 inches and have a color temperature of 3,200 degrees Kelvin. The unit will consist of an arm or sleeve of approximately 45 inches in length to allow for easy arm rotation and arm movement up and down. The unit shall be mounted on a caster base for easy movement.,
M7650	Defibrillator/Monitor, Acute Care	VV	Portable defibrillator-monitor-recorder with built in advisory protocol. Unit is designed for use by ambulance crews and cardiac arrest teams where a physician will not be available to determine if defibrillation is appropriate. System provides lead II ECG monitoring only, recording and logging of a resuscitation event for later review. This system provides up to 360 joules output and has an external battery charger available. Unit is sometimes referred to as an "Automatic Advisory Defibrillator" or "AAD". Unit may be line powered with an optional battery substitute pack.
M7910	thermometer	VV	Electronic thermometer. Pocket size unit with easy to read zero Fahrenheit or zero Centigrade LCD display in approximately 20 seconds. Battery operated and enclosed in a heavy duty plastic case. Unit is hand-held portable and may be stand or wall mounted. For patient body temperature readings.
M8770	pressure unit	VV	General purpose suction/pressure apparatus. Double stainless steel console unit with a 1/8 HP motor, stand-mounted. Stands include 2 1/2" casters with chemical resistant top. Pumps suction capacity: 22 LPM. Unit includes collection bottle, bacteria filter and suction regulating valve. Used for oral/nasal, tracheal suctioning and other emergency purposes.
M8810	stand mayo	VV	Adjustable instrument table. Table is corrosion resistant stainless steel construction and is mounted on two casters with two skid rails. It has telescopic upright adjusts from 39 inches to 60 inches with automatic locking device, and removable 13"x19" instrument tray. Designed for use in operating and procedure rooms.
M8825	table instrument	VV	Instrument and dressing table. Made of corrosion resistant stainless steel with a sound deadened top. Includes guard rail, shelf and two side-by-side drawers. The table is mounted on swivel, ball-bearing casters.
M8826	table instrument	VV	Instrument and dressing table. Made of corrosion resistant stainless steel with a sound deadened top. Includes guard rail, shelf and two side-by-side drawers. The table is mounted on swivel, ball-bearing casters.
P1965	Eyewash, Eye/Face, Sink Mounted, Hands-free	CC	A sink mounted eyewash station. The unit is designed for emergency eye and face rinsing from soft flow dual spray-heads. The Flow must be activated by the single momentary action and remain on until terminated.
T0175	Mobile Cabinet	VV	Mobile Cabinet with wheels, size varies
X2100	scanner ultrasound	VV	High definition, diagnostic ultrasound system for Radiology, Cardiology, Vascular, ob-gyn, Perinatology, and Surgical imaging applications. The unit employs curved, phased and linear array imaging technology. The system supports colorflow, pulse and continuous wave imaging modalities. On board software measurement packages available for all imaging applications. The system is DICOM 3.0 compatible, for easy linkage to filmless image management systems and review stations. In addition, a full line of probes and conventional recording devices are available.
X3145	screen xray	VV	Mobile X-ray protective screen/barrier. The X-ray barrier provides optically-clear visibility while shielding medical personnel from scatter radiation. Its large clear Pb lead-plastic or acrylic window offers 0.5 mm lead-equivalent protection to the user's head and upper body. The unit is used for effective radiation protection of department personnel during vascular or other procedures. This unit can fit any application with its mobility. Adjustable screens are also available.
X6196	injector	VV	CT injector. This unit is a specialized radiographic system that provides sharp, well-defined visual images of the vascular anatomy. The injector introduces a vision radiopaque fluid (contrast medium) into an artery or vein through a small catheter, making vessels contrast with their more radiolucent surrounding. The unit incorporates an electromechanical or pneumatically driven syringe to deliver the contrast medium. The syringe assemblies consist of an electric motor connected to a jackscrew that moves the syringe piston into or out of the syringe barrel. The unit is used in hospitals with radiographic procedures. The unit can be ceiling, wall, or remote stand mounted.

Revisions: Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.

Mabbett®
Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects

THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP

STATE OF MISSOURI
RUSSELL DINARDO
NUMBER
A - 2024000203
ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
SECOND FLOOR EQUIPMENT SCHEDULE	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:		Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number: 1
		Issue Date: 06 MARCH 2026 / Checked: TB / Drawn: PS	Drawing Number: A605

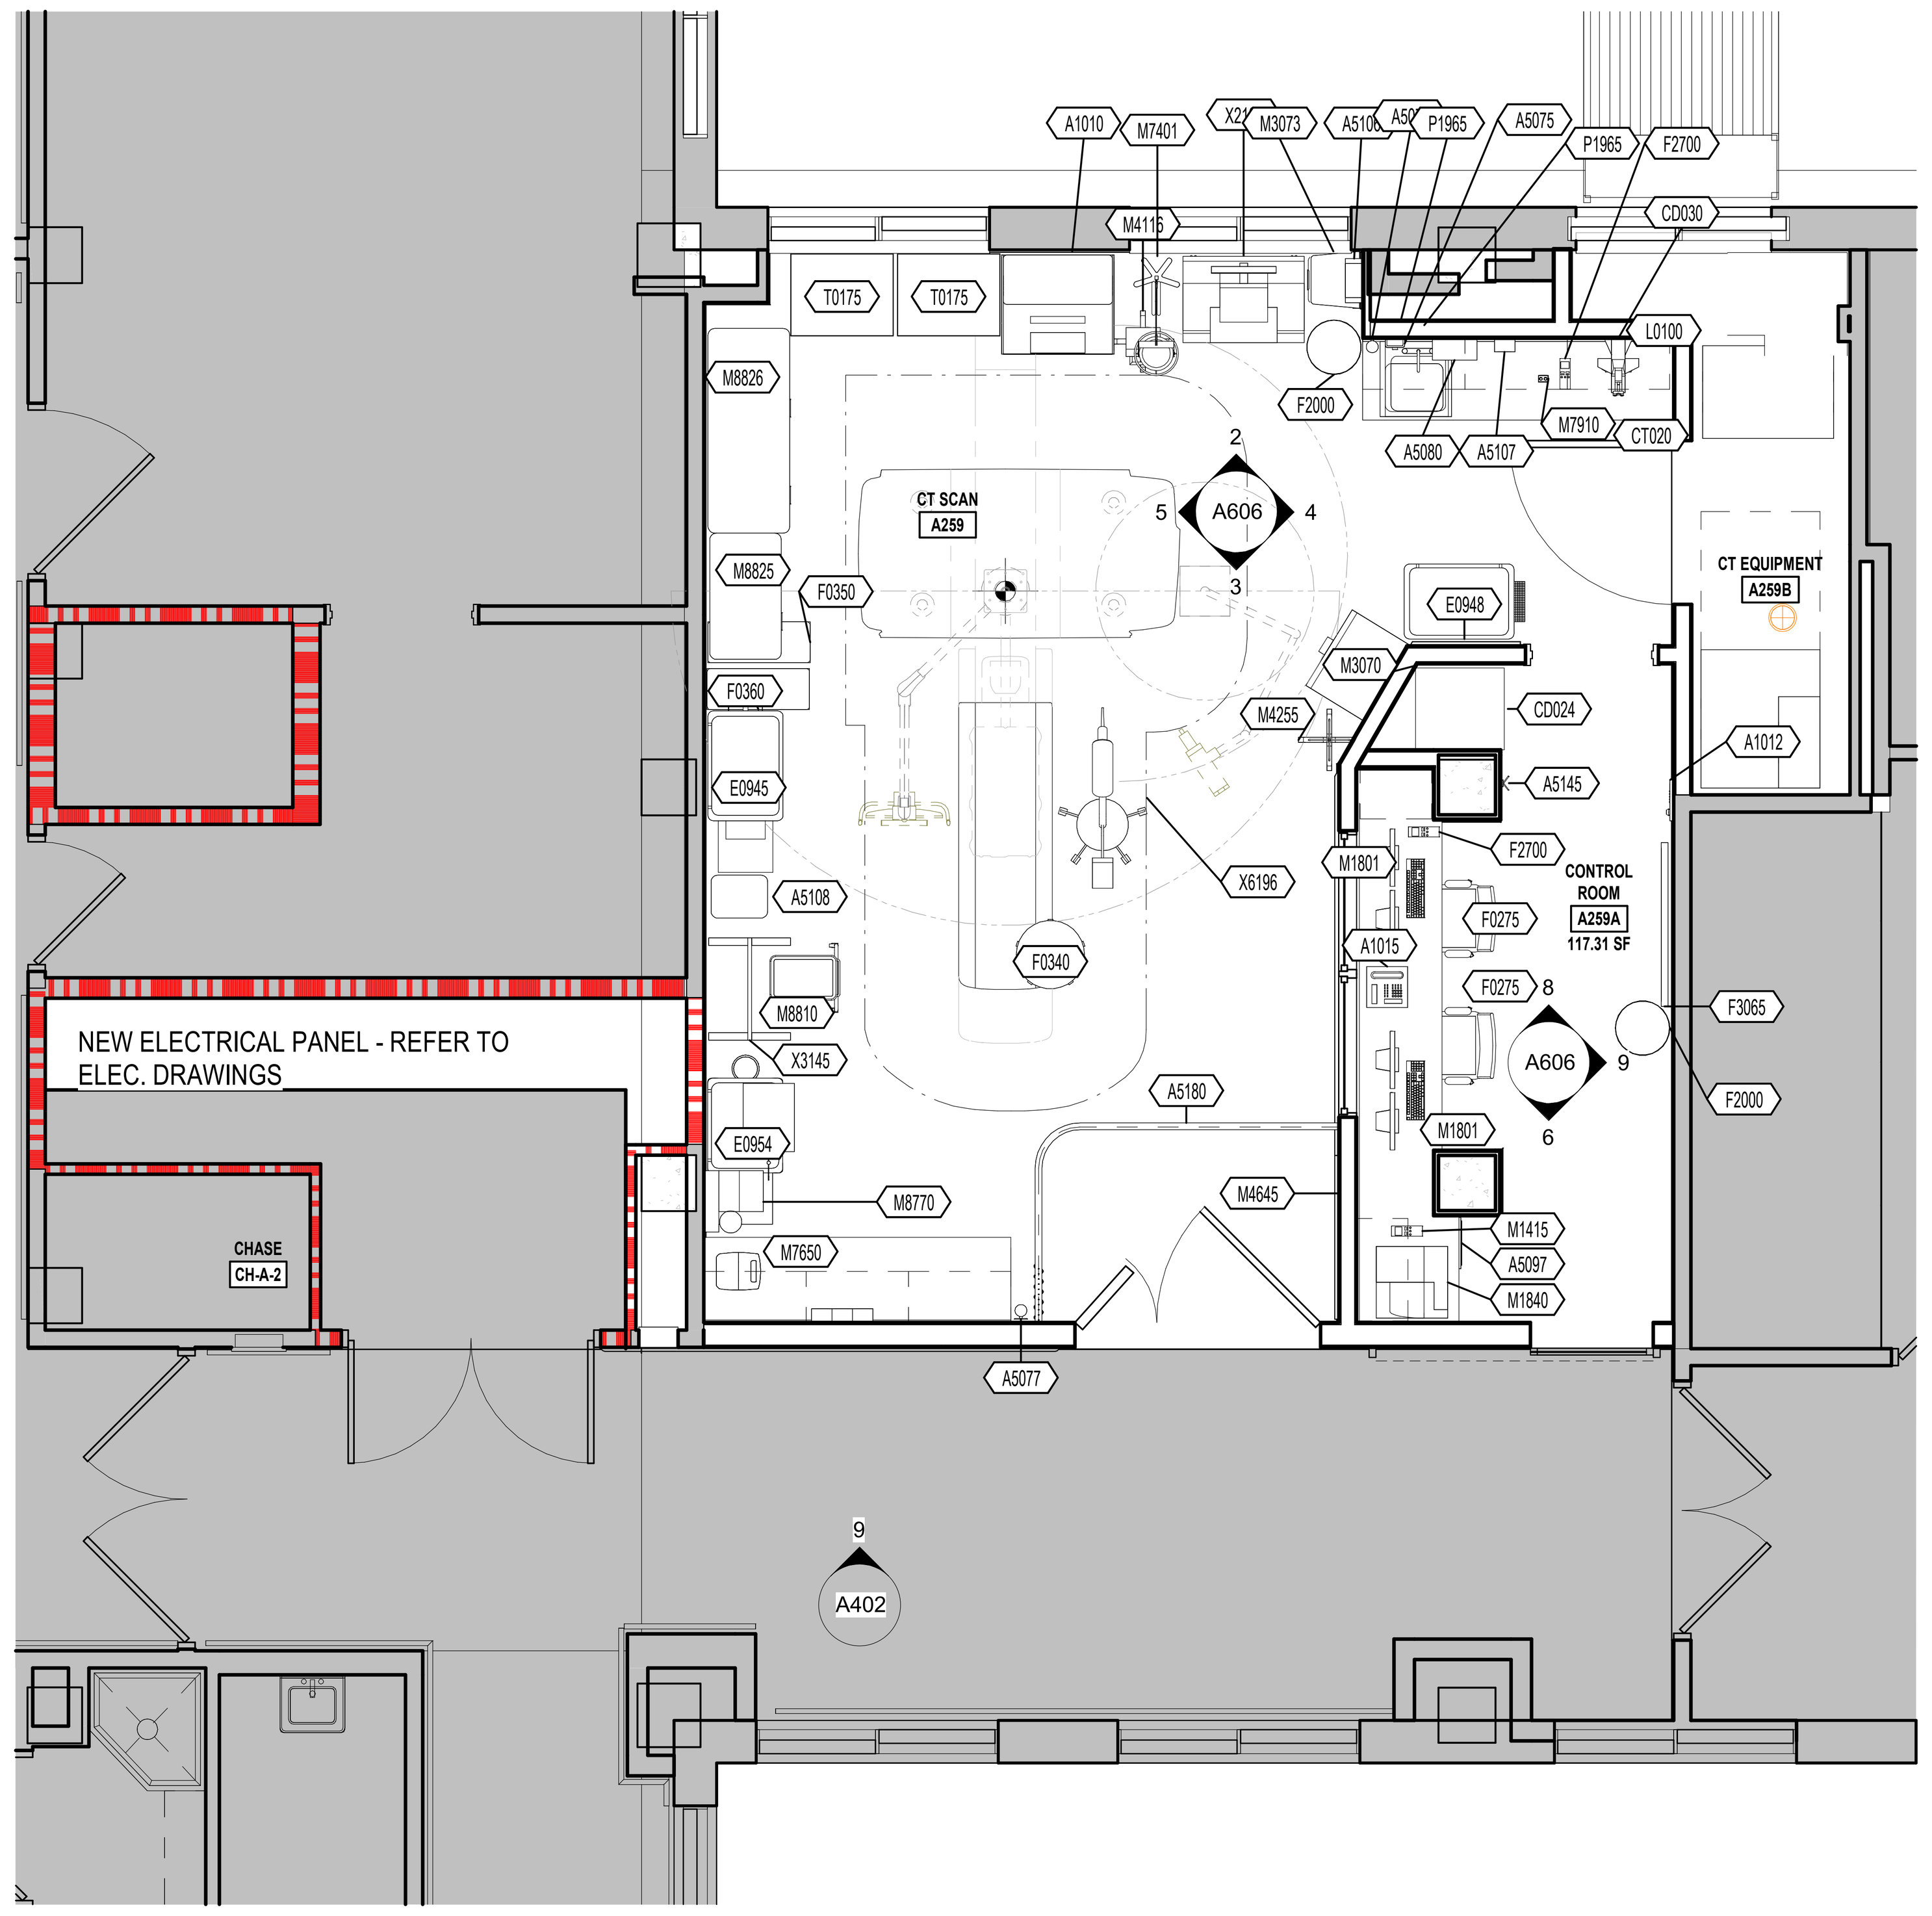

1 SECOND FLOOR EQUIPMENT PLAN
1/4" = 1'-0"

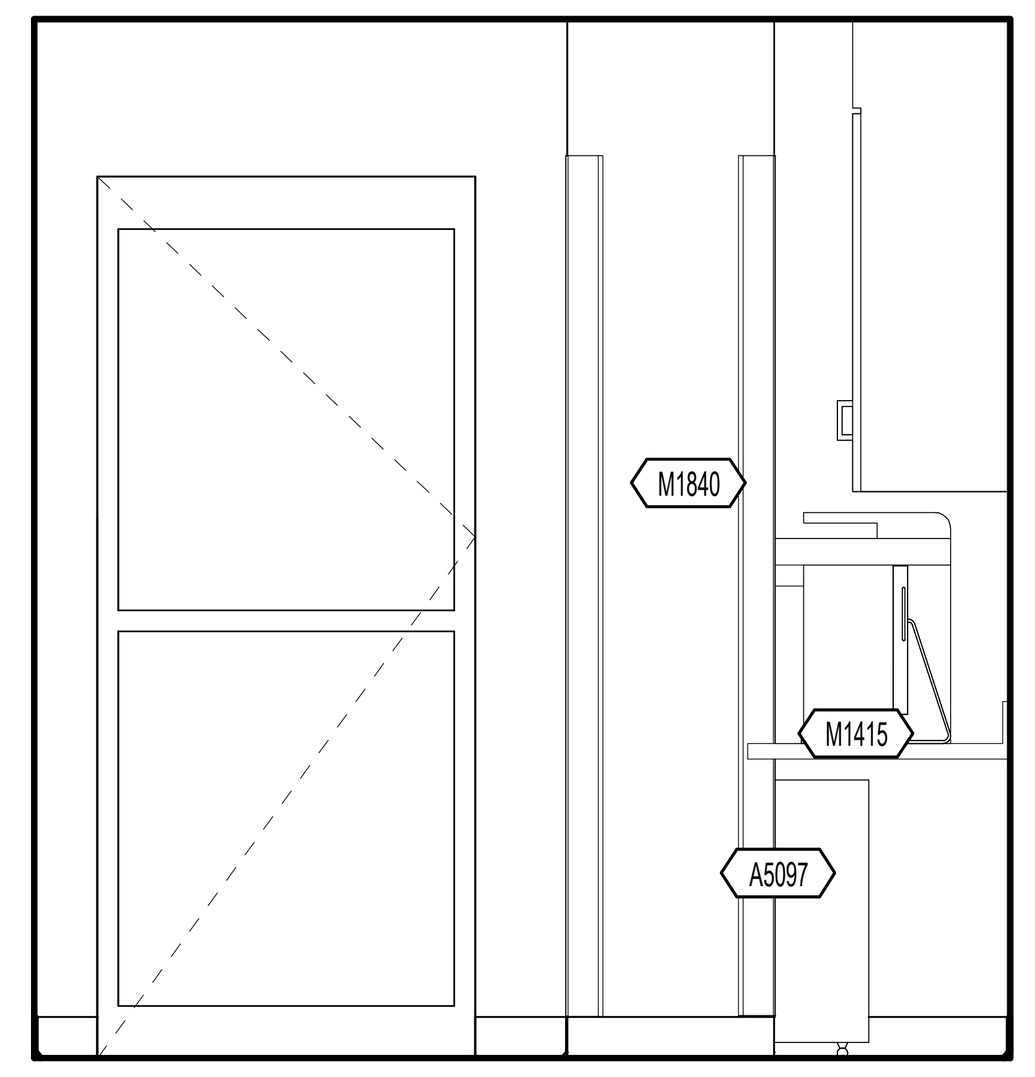

6 CONTROL ROOM SOUTH EQUIPMENT
1/2" = 1'-0"

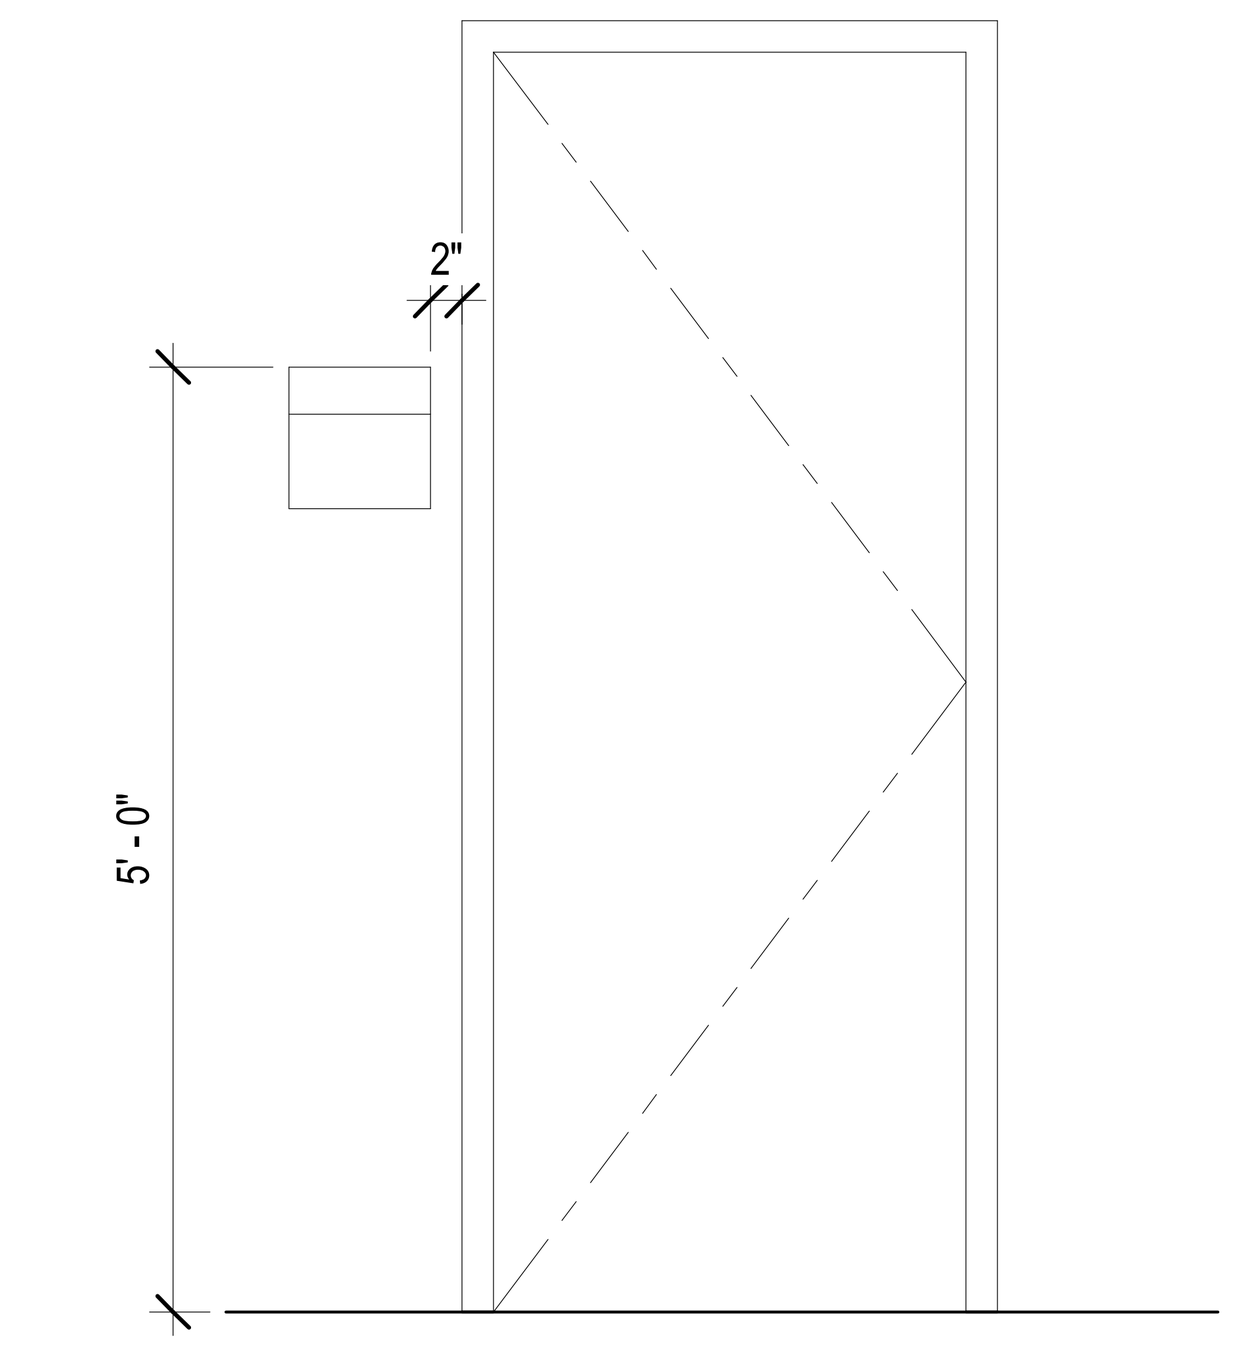

10 TYPICAL ROOM SIGNAGE PLACEMENT
3/4" = 1'-0"

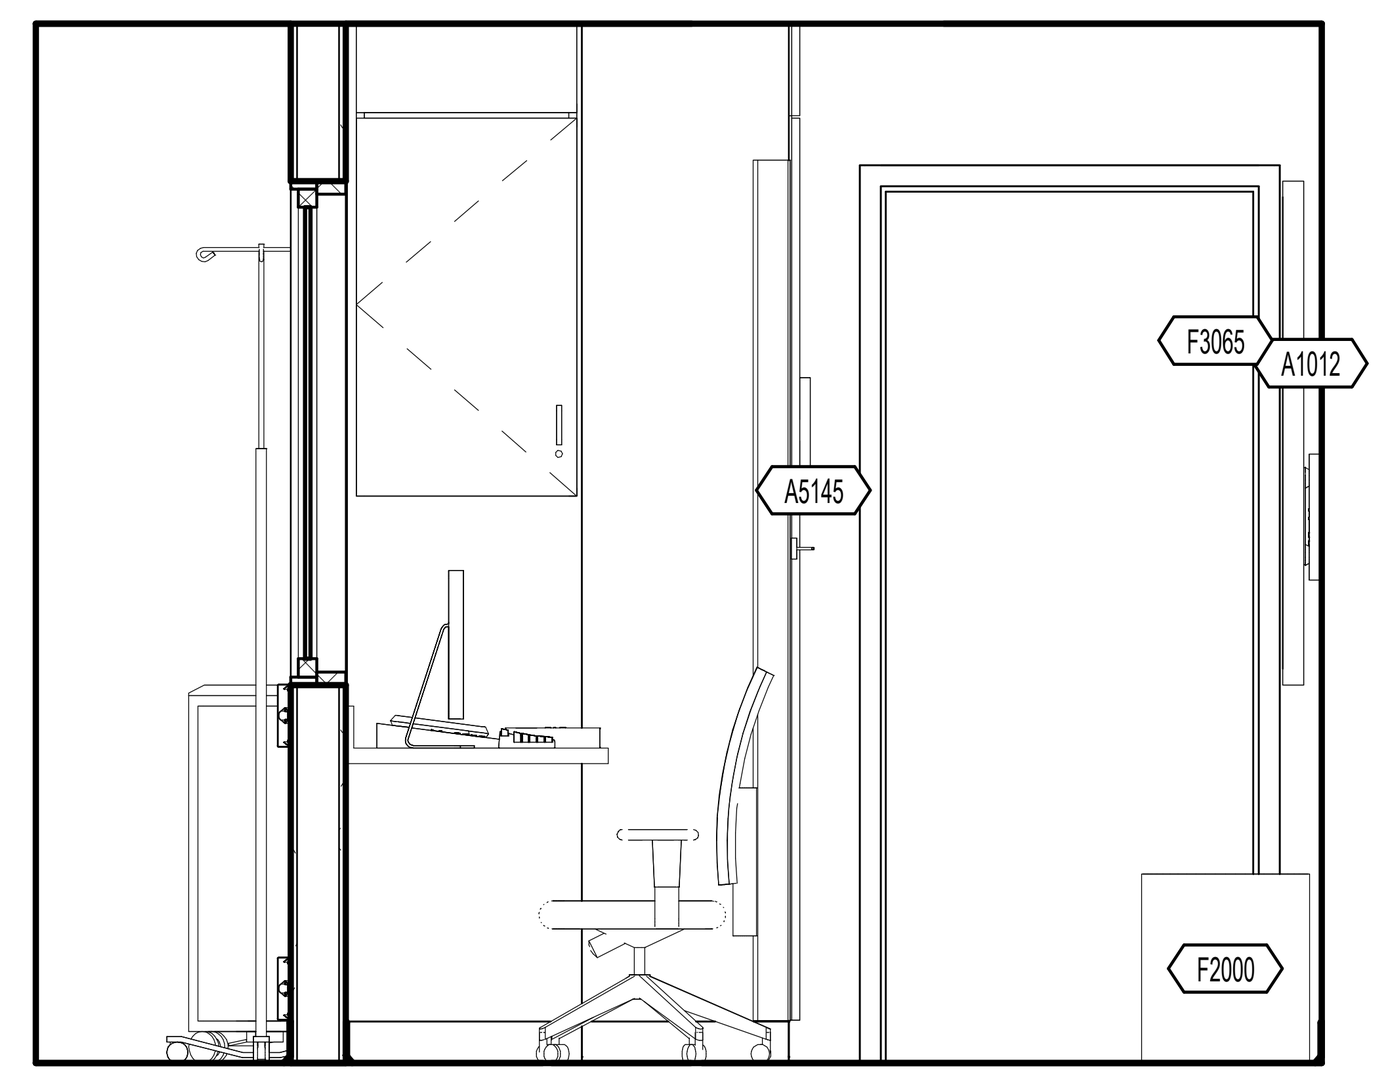

8 CONTROL ROOM - NORTH ELEVATION EQUIPMENT
1/2" = 1'-0"

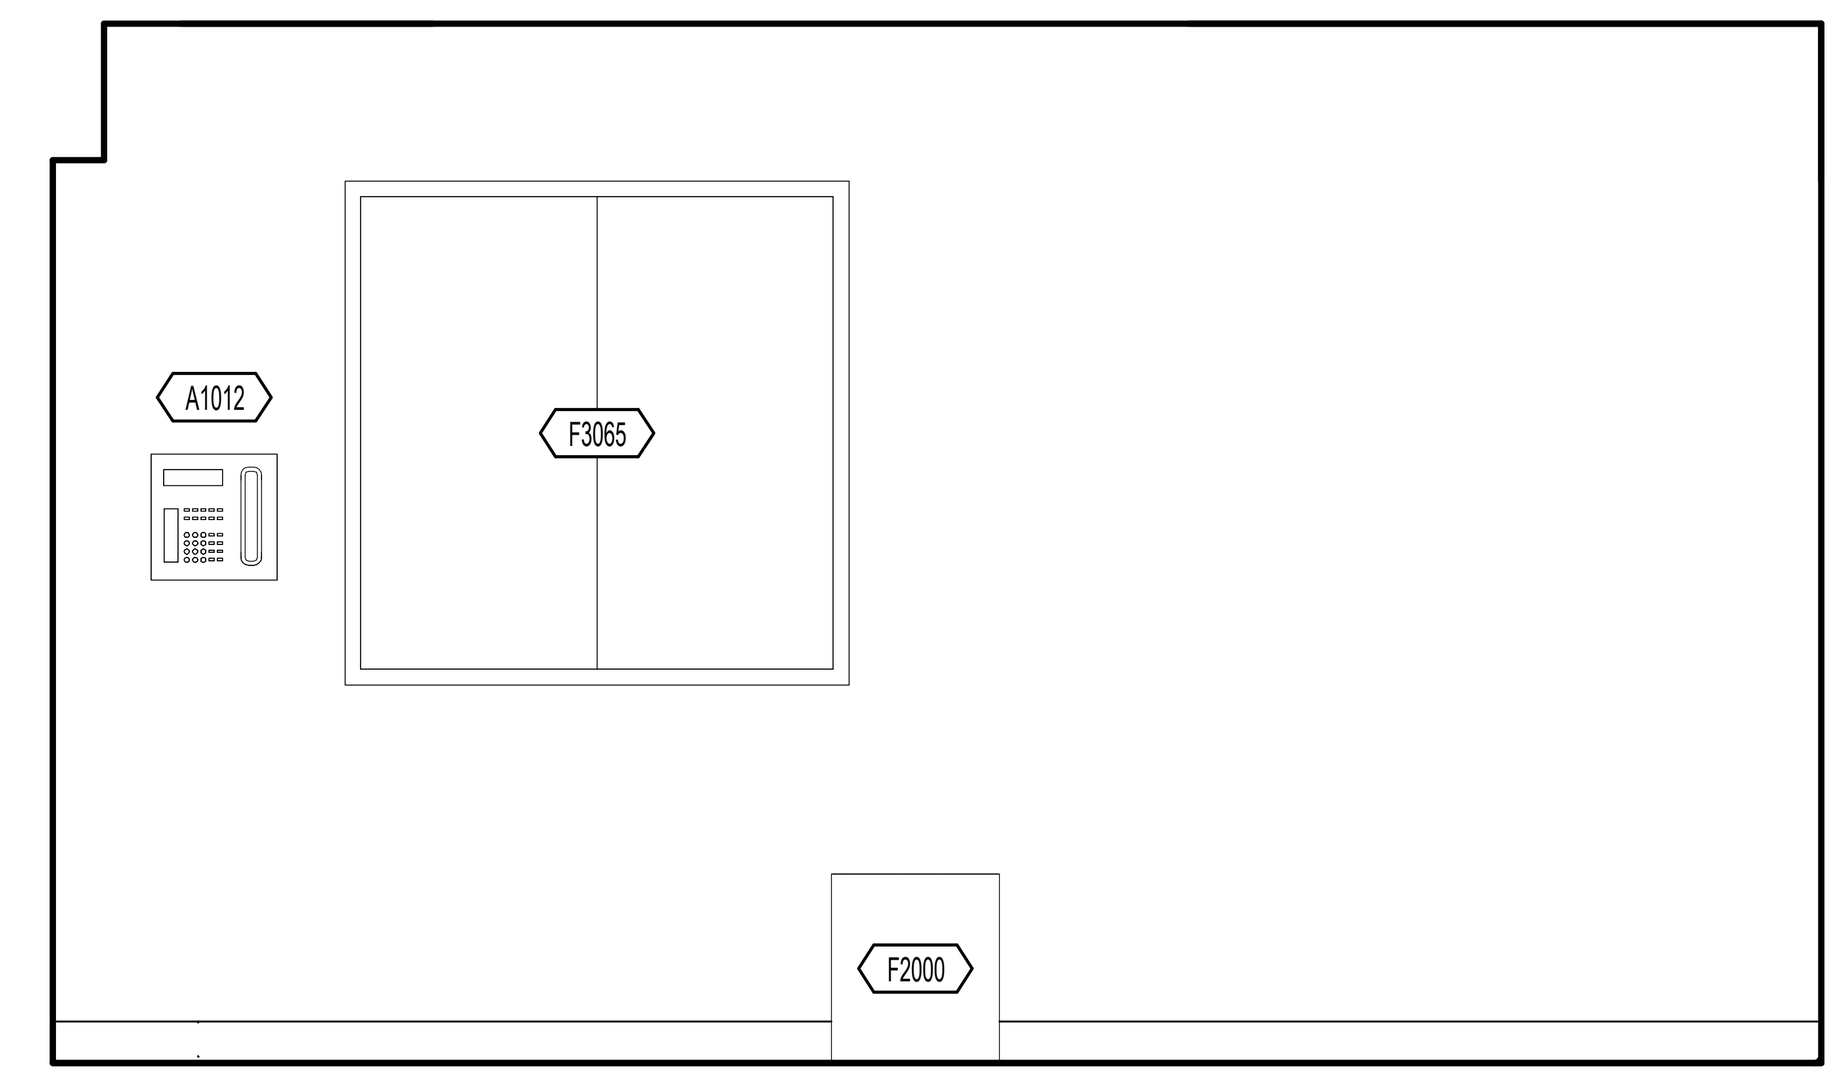

9 CONTROL - EAST ELEVATION EQUIPMENT
1/2" = 1'-0"

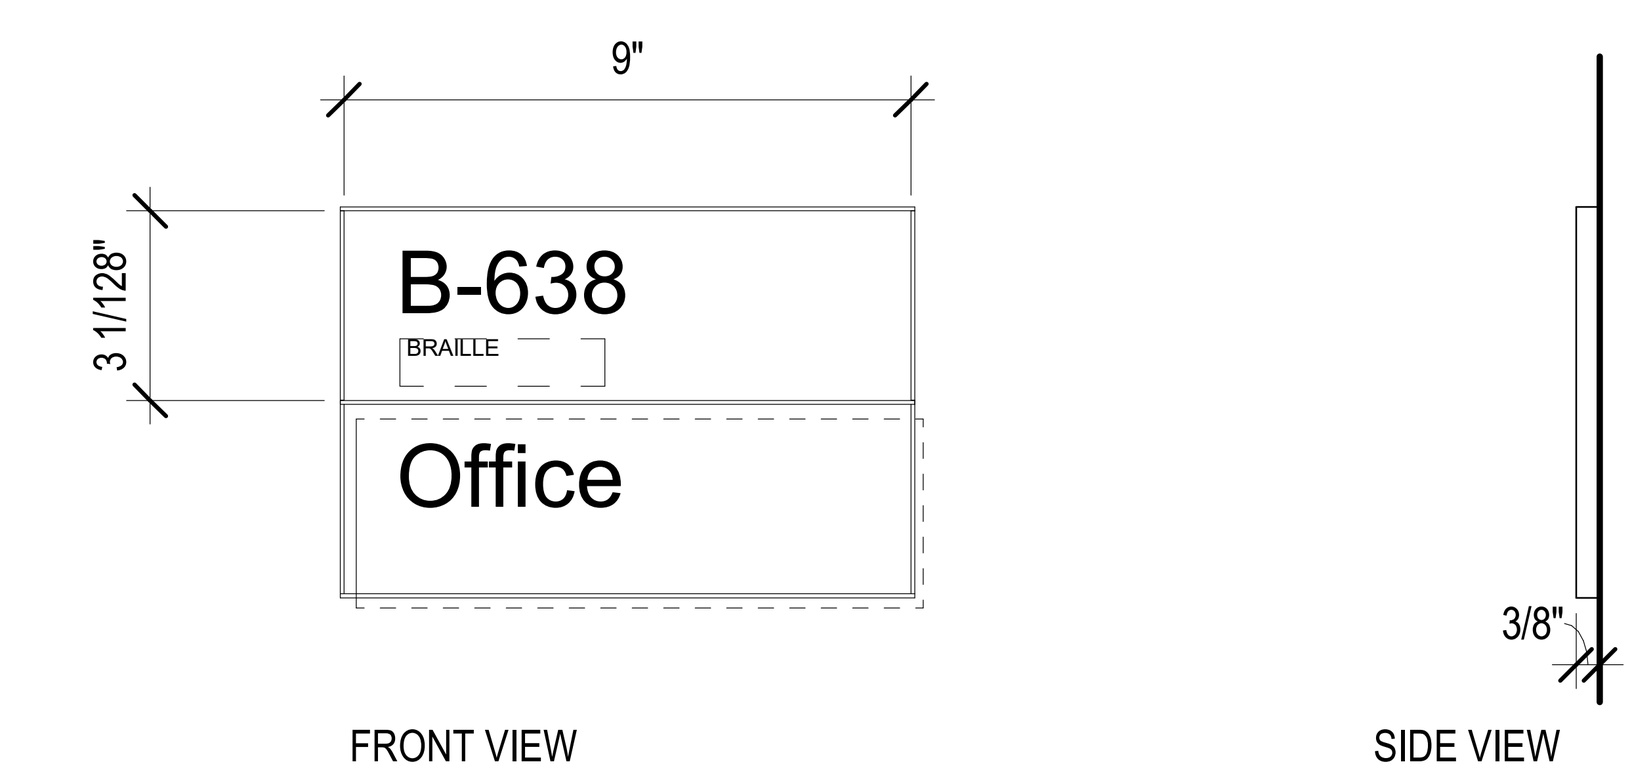

TYPICAL PRIMARY ROOM SIGN TWITH IINSERT
TOP:
BRAILLE. REFER TO VAMC FOR ESTABLISHED COLORS AND TEXT

MOUNTED WITH SILASTIC ADHESIVE.

NOTE: REFER TO INTERIOR SIGNS IN-04.04 OF THE VA GUIDE FOR LAYOUT, LETTERING SIZES, DIMENSIONS AND TYPOGRAPHY.

11 TYPICAL SECONDARY ROOM SIGNAGE W/INSERT
3" = 1'-0"

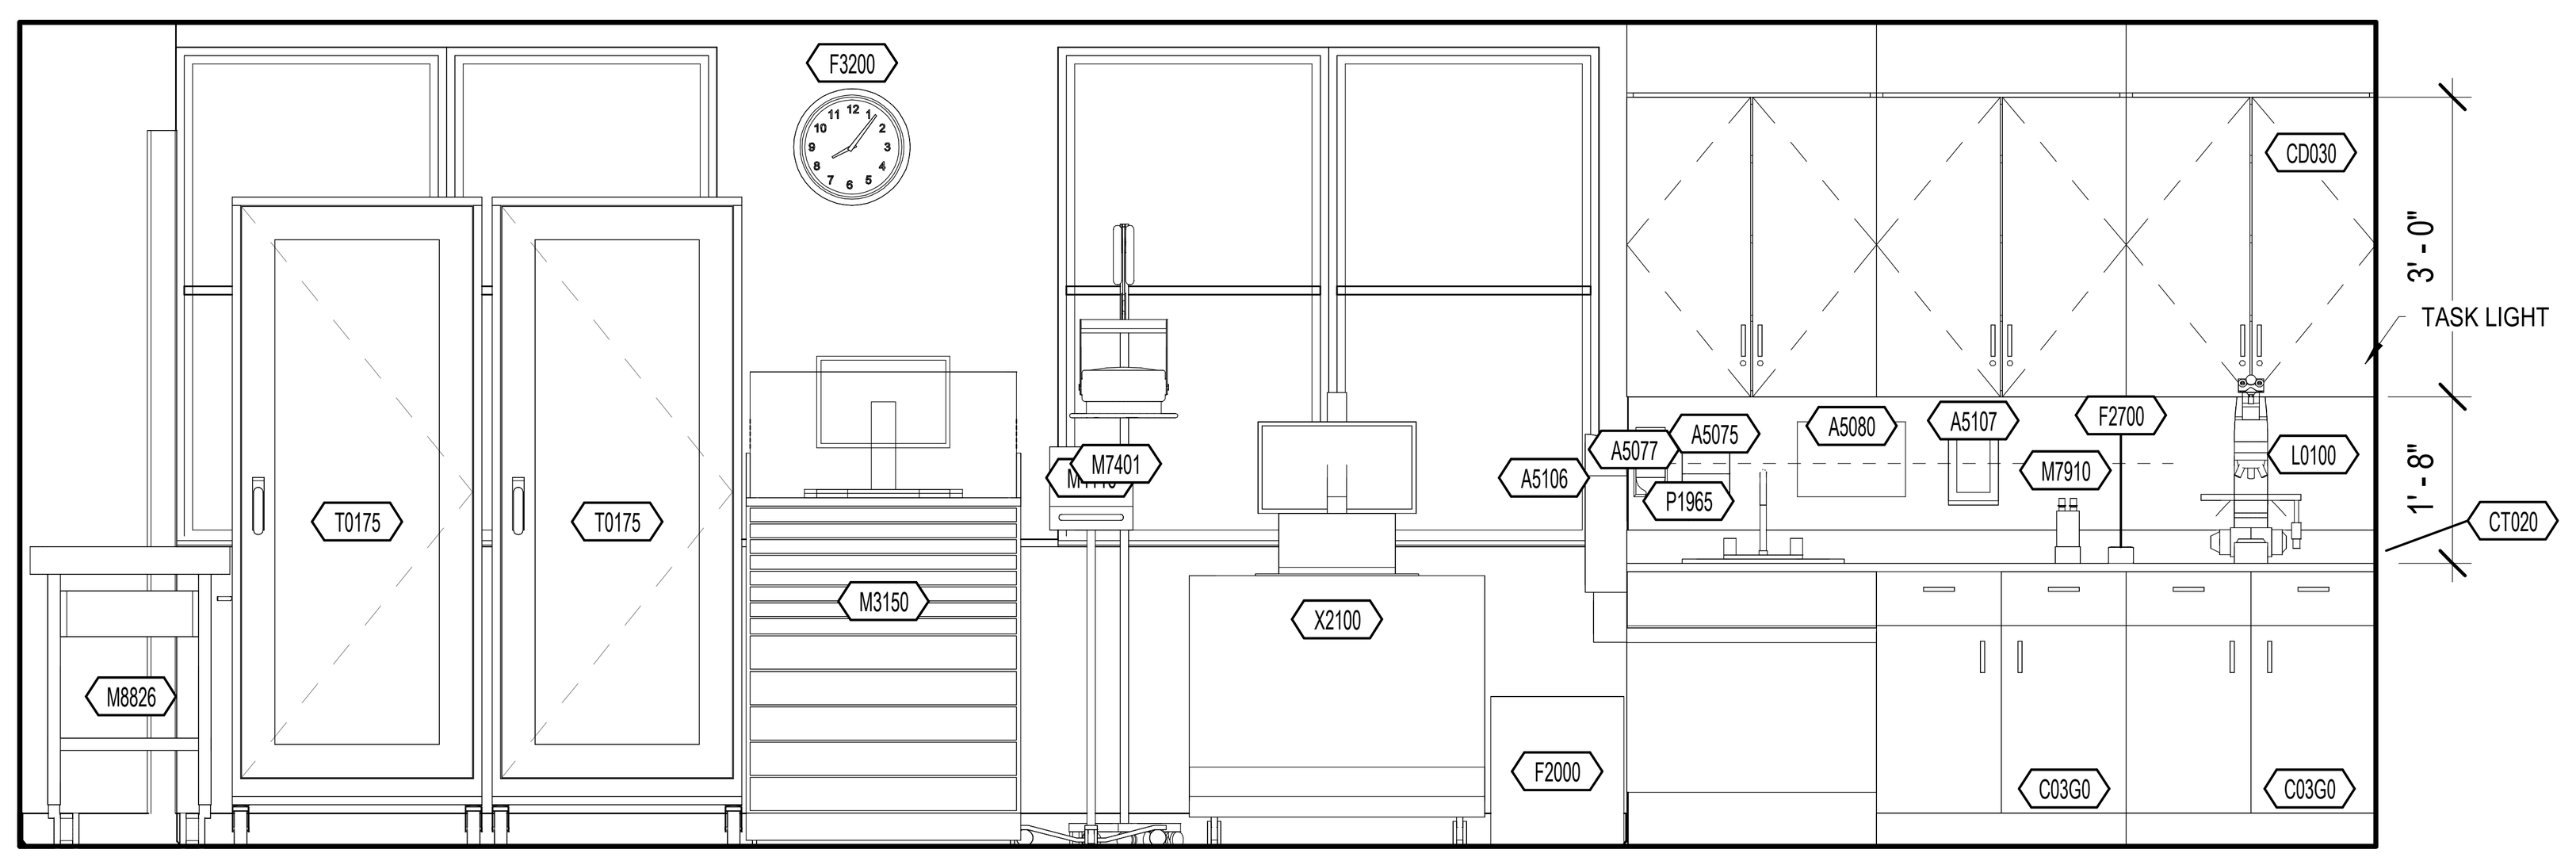

2 CT- FRONT ELEVATION EQUIPMENT
1/2" = 1'-0"

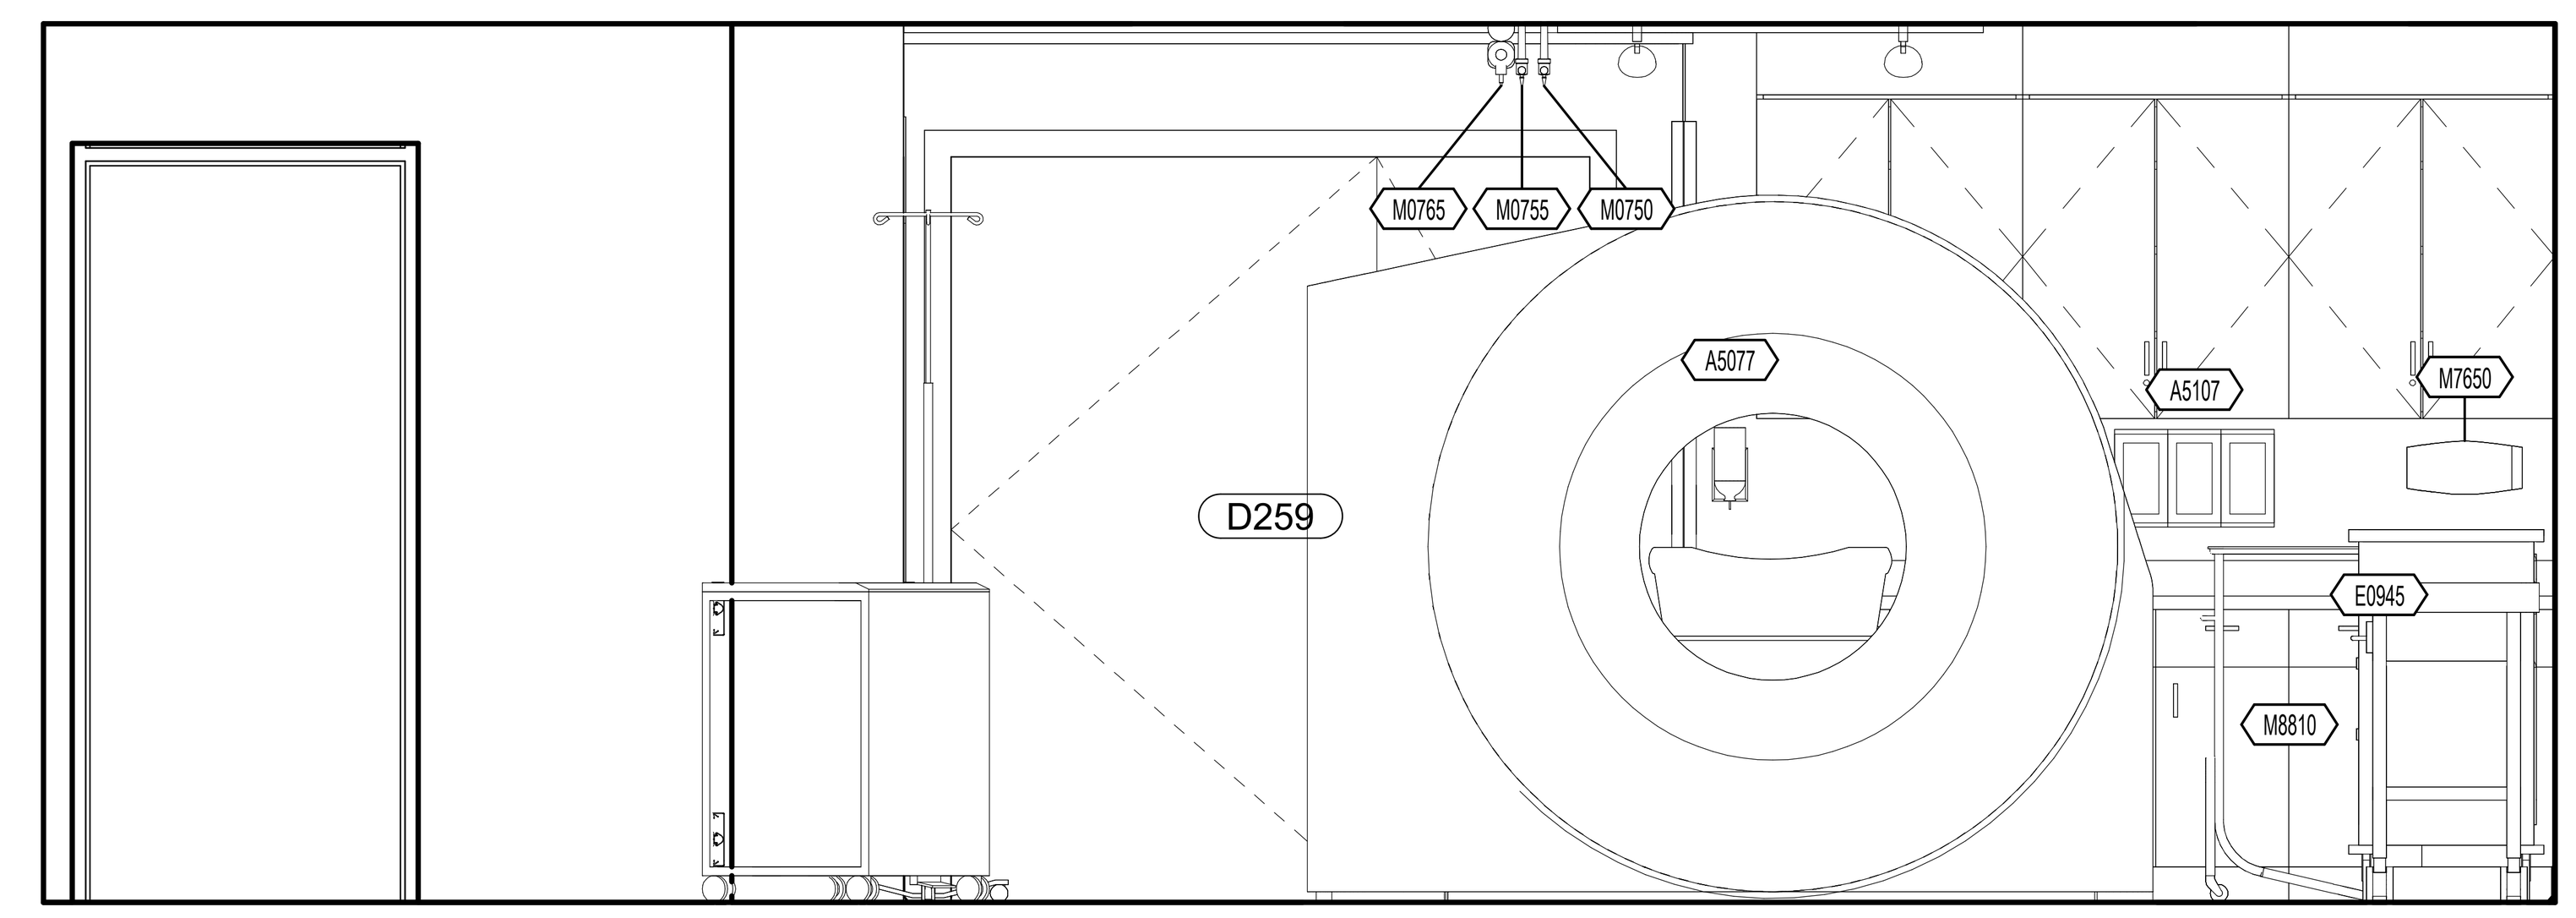

3 CT - SOUTH ELEVATION EQUIPMENT
1/2" = 1'-0"

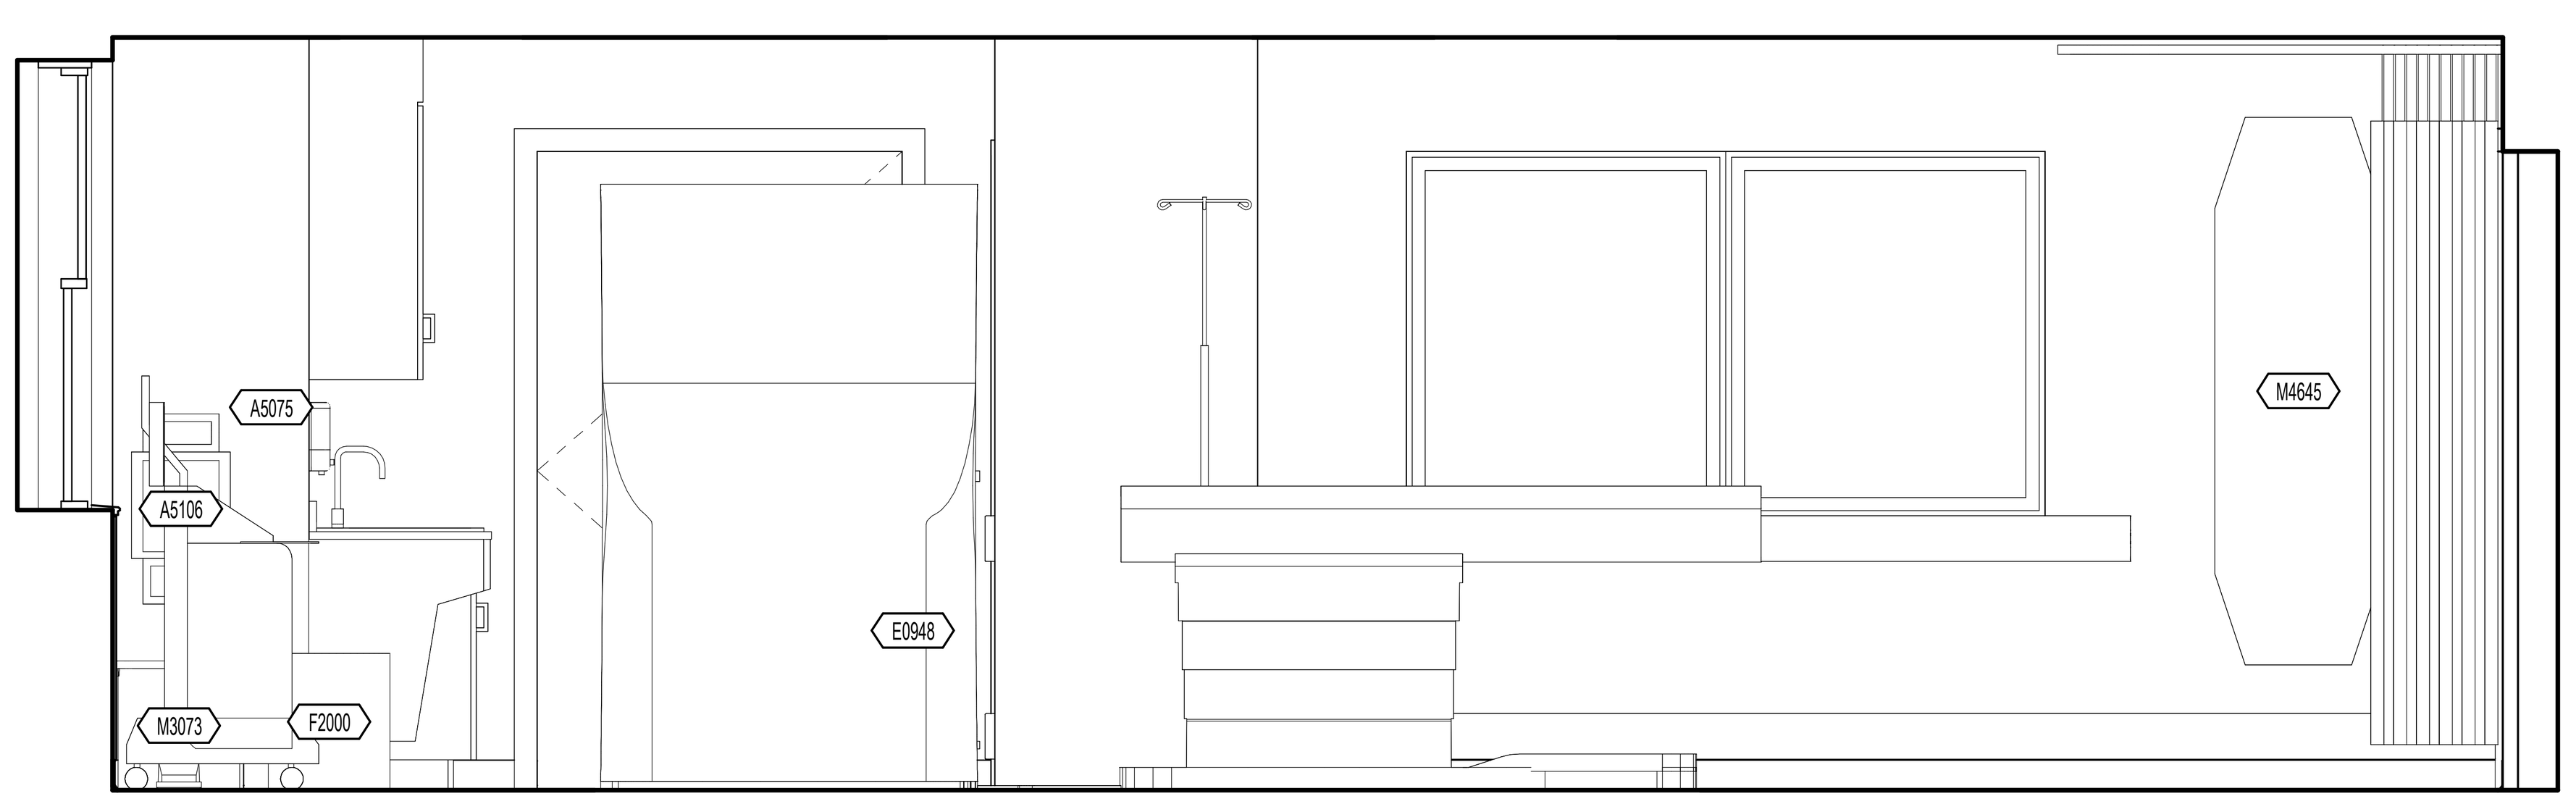

4 CT - EAST ELEVATION EQUIPMENT
1/2" = 1'-0"

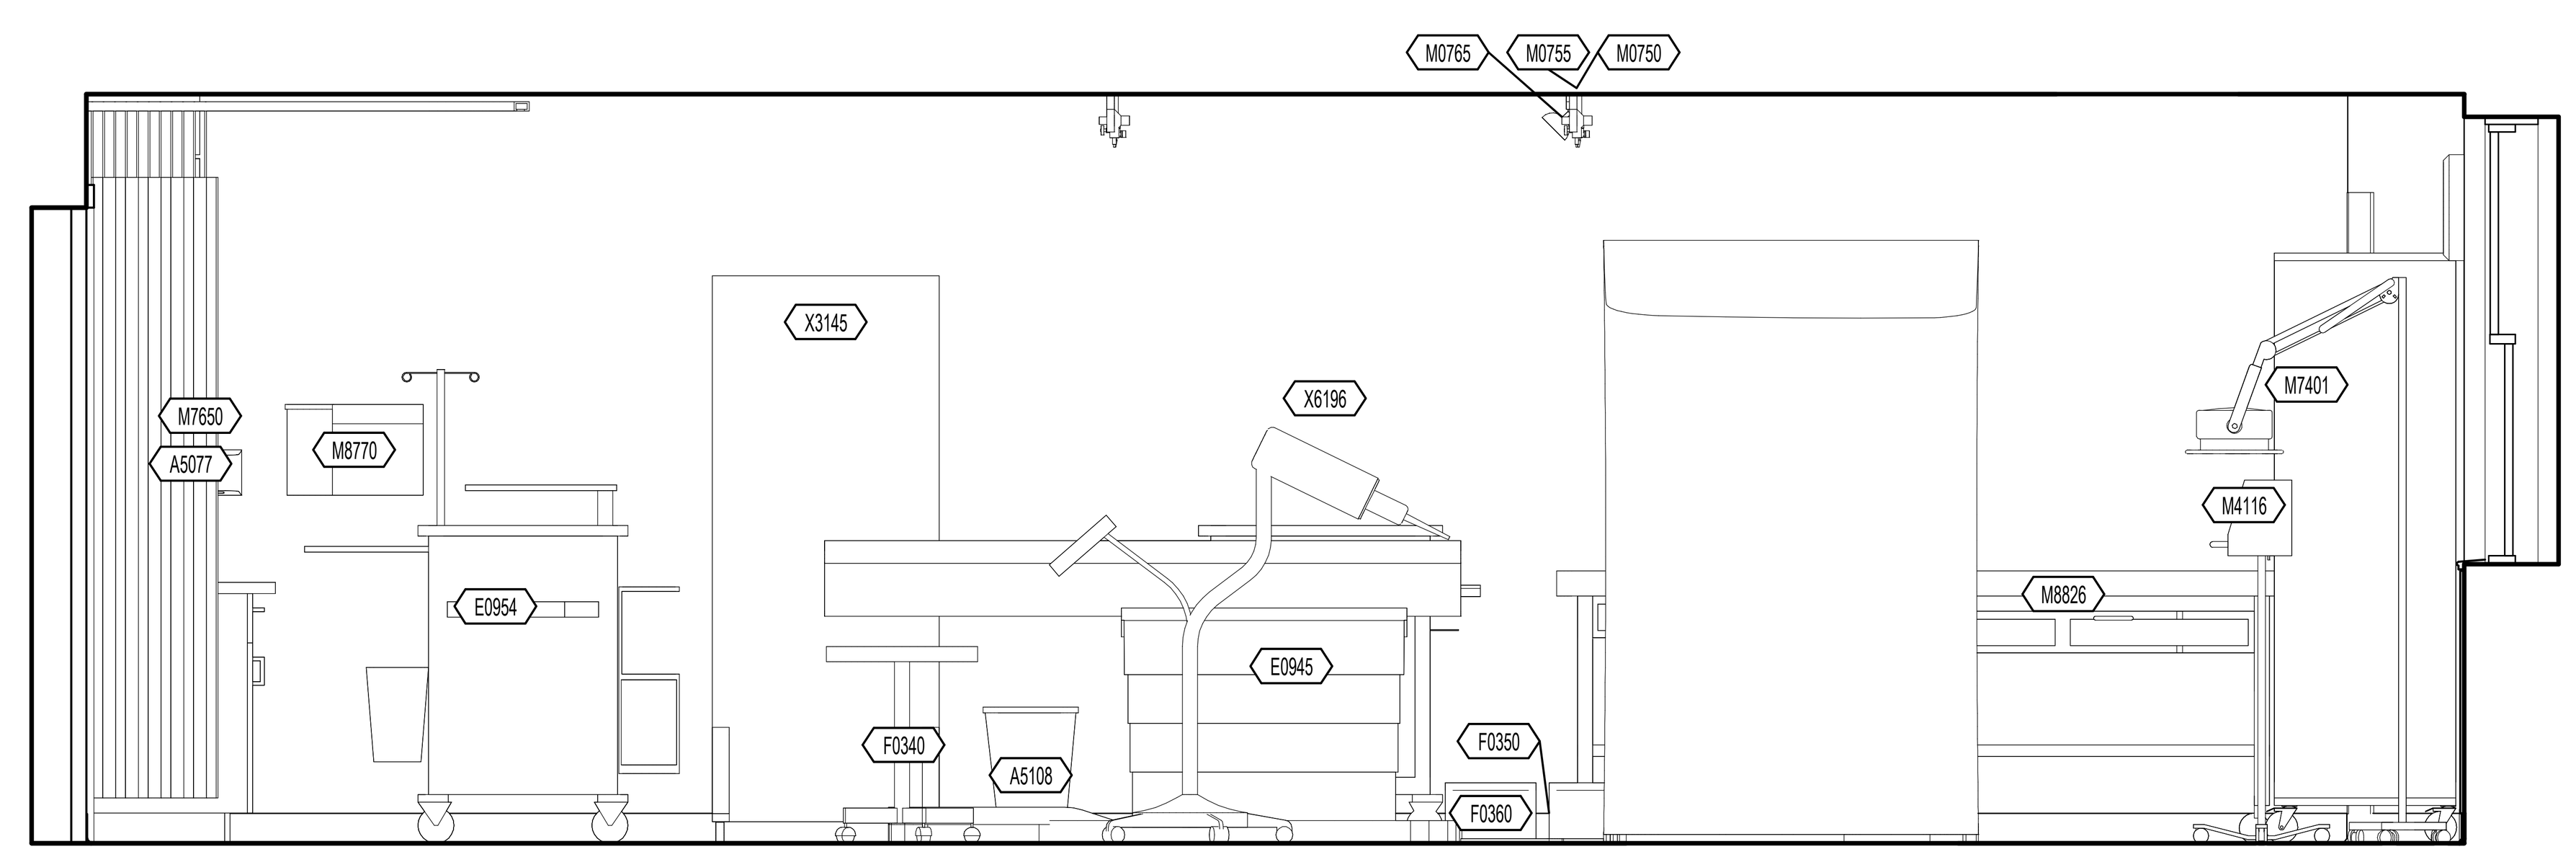

5 CT - WEST ELEVATION EQUIPMENT
1/2" = 1'-0"

Revisions: Date:

CONSULTANT
Above Group ENGINEERING DESIGN CONSULTING
Mabbett Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD
THINKFORM

THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP
STATE OF MISSOURI RUSSELL DINARDO NUMBER A - 2024000203 ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)
VA U.S. Department of Veterans Affairs

Drawing Title: SECOND FLOOR EQUIPMENT PLAN & INT. ELEV / SIGNAGE
Approved:
Phase: 100% CONTRACT DOCUMENTS FOR BIDDING
Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date: 06 MARCH 2026
Checked: TB
Drawn: PS
Project Number: 657-23-104JC
Building Number: 1
Drawing Number: A606

VA FORM 08 - 6231

3/3/2026 2:40:44 PM
Autodesk Docs://24001 VA ST Louis CT/657-23-104JC_657-JC-01-02_ARCH.rvt

GENERAL RIGGING NOTES:

A. GC TO COORD W/ VA DATES AND TIMES FOR BRINGING IN NEW EQUIPMENT.
B. GC TO COORD W COR AND PROVIDE A DETAILED LIFT PLAN PER SPEC GIVING THE VAMC A MIN OF 24 DAYS NOTICE AFTER PLAN APPROVAL.
C. GC TO PROVIDE PERSONNEL MEETING WITH SAFETY REQUIREMENTS, ENTRY/EXIT STAGING WITHIN CRANE PICK AREA FOR THE ENTIRE TIME THE CRANE AREA IS IN USE. SEE PLAN FOR RECOMMENDED PICK AREA.
D. GC TO COORDINATE WITH COR TO ENSURE THAT NO TWO MEANS OF EGRESS ARE CLOSED OFF DURING RIGGING. MORE THAN TWO MEANS OF EGRESS AND ENTRY MAY HAVE A STAGE WITH A SAFETY PERSON BUT NO TWO EXITS MAY BE CLOSED OFF AT THE SAME TIME, UNLESS THE AREA SERVING THE STAIR IS VACATED.
E. EXISTING GLAZING CAN BE STAGED WITHIN CRANE SHUT-DOWN AREA FOR A OF THREE DAYS AND TWO NIGHTS.
F. GC TO PROTECT ALL EXISTING FINISHES IN THE PATH OF TRAVEL. DAMAGE TO EXISTING SURFACES INCURRED DURING RIGGING SHALL BE REPAIRED BY GC. FINISH REPAIRS TO MATCH EXISTING ADJACENT.
G. GC TO COORDINATE WITH EQUIPMENT MANUFACTURER ALL CLEARANCES REQUIRED FOR RIGGING AND SHALL PROVIDE A CLEAR PATH FOR THE EQUIPMENT.
H. GC IS RESPONSIBLE FOR REMOVING, STORING AND REINSTALLING ANY EXISTING FURNITURE OR FREESTANDING DEVICES REQUIRED TO BE MOVED TO A CLEAR 4'-6" PATH FOR THE NEW CT SCAN DELIVERY.

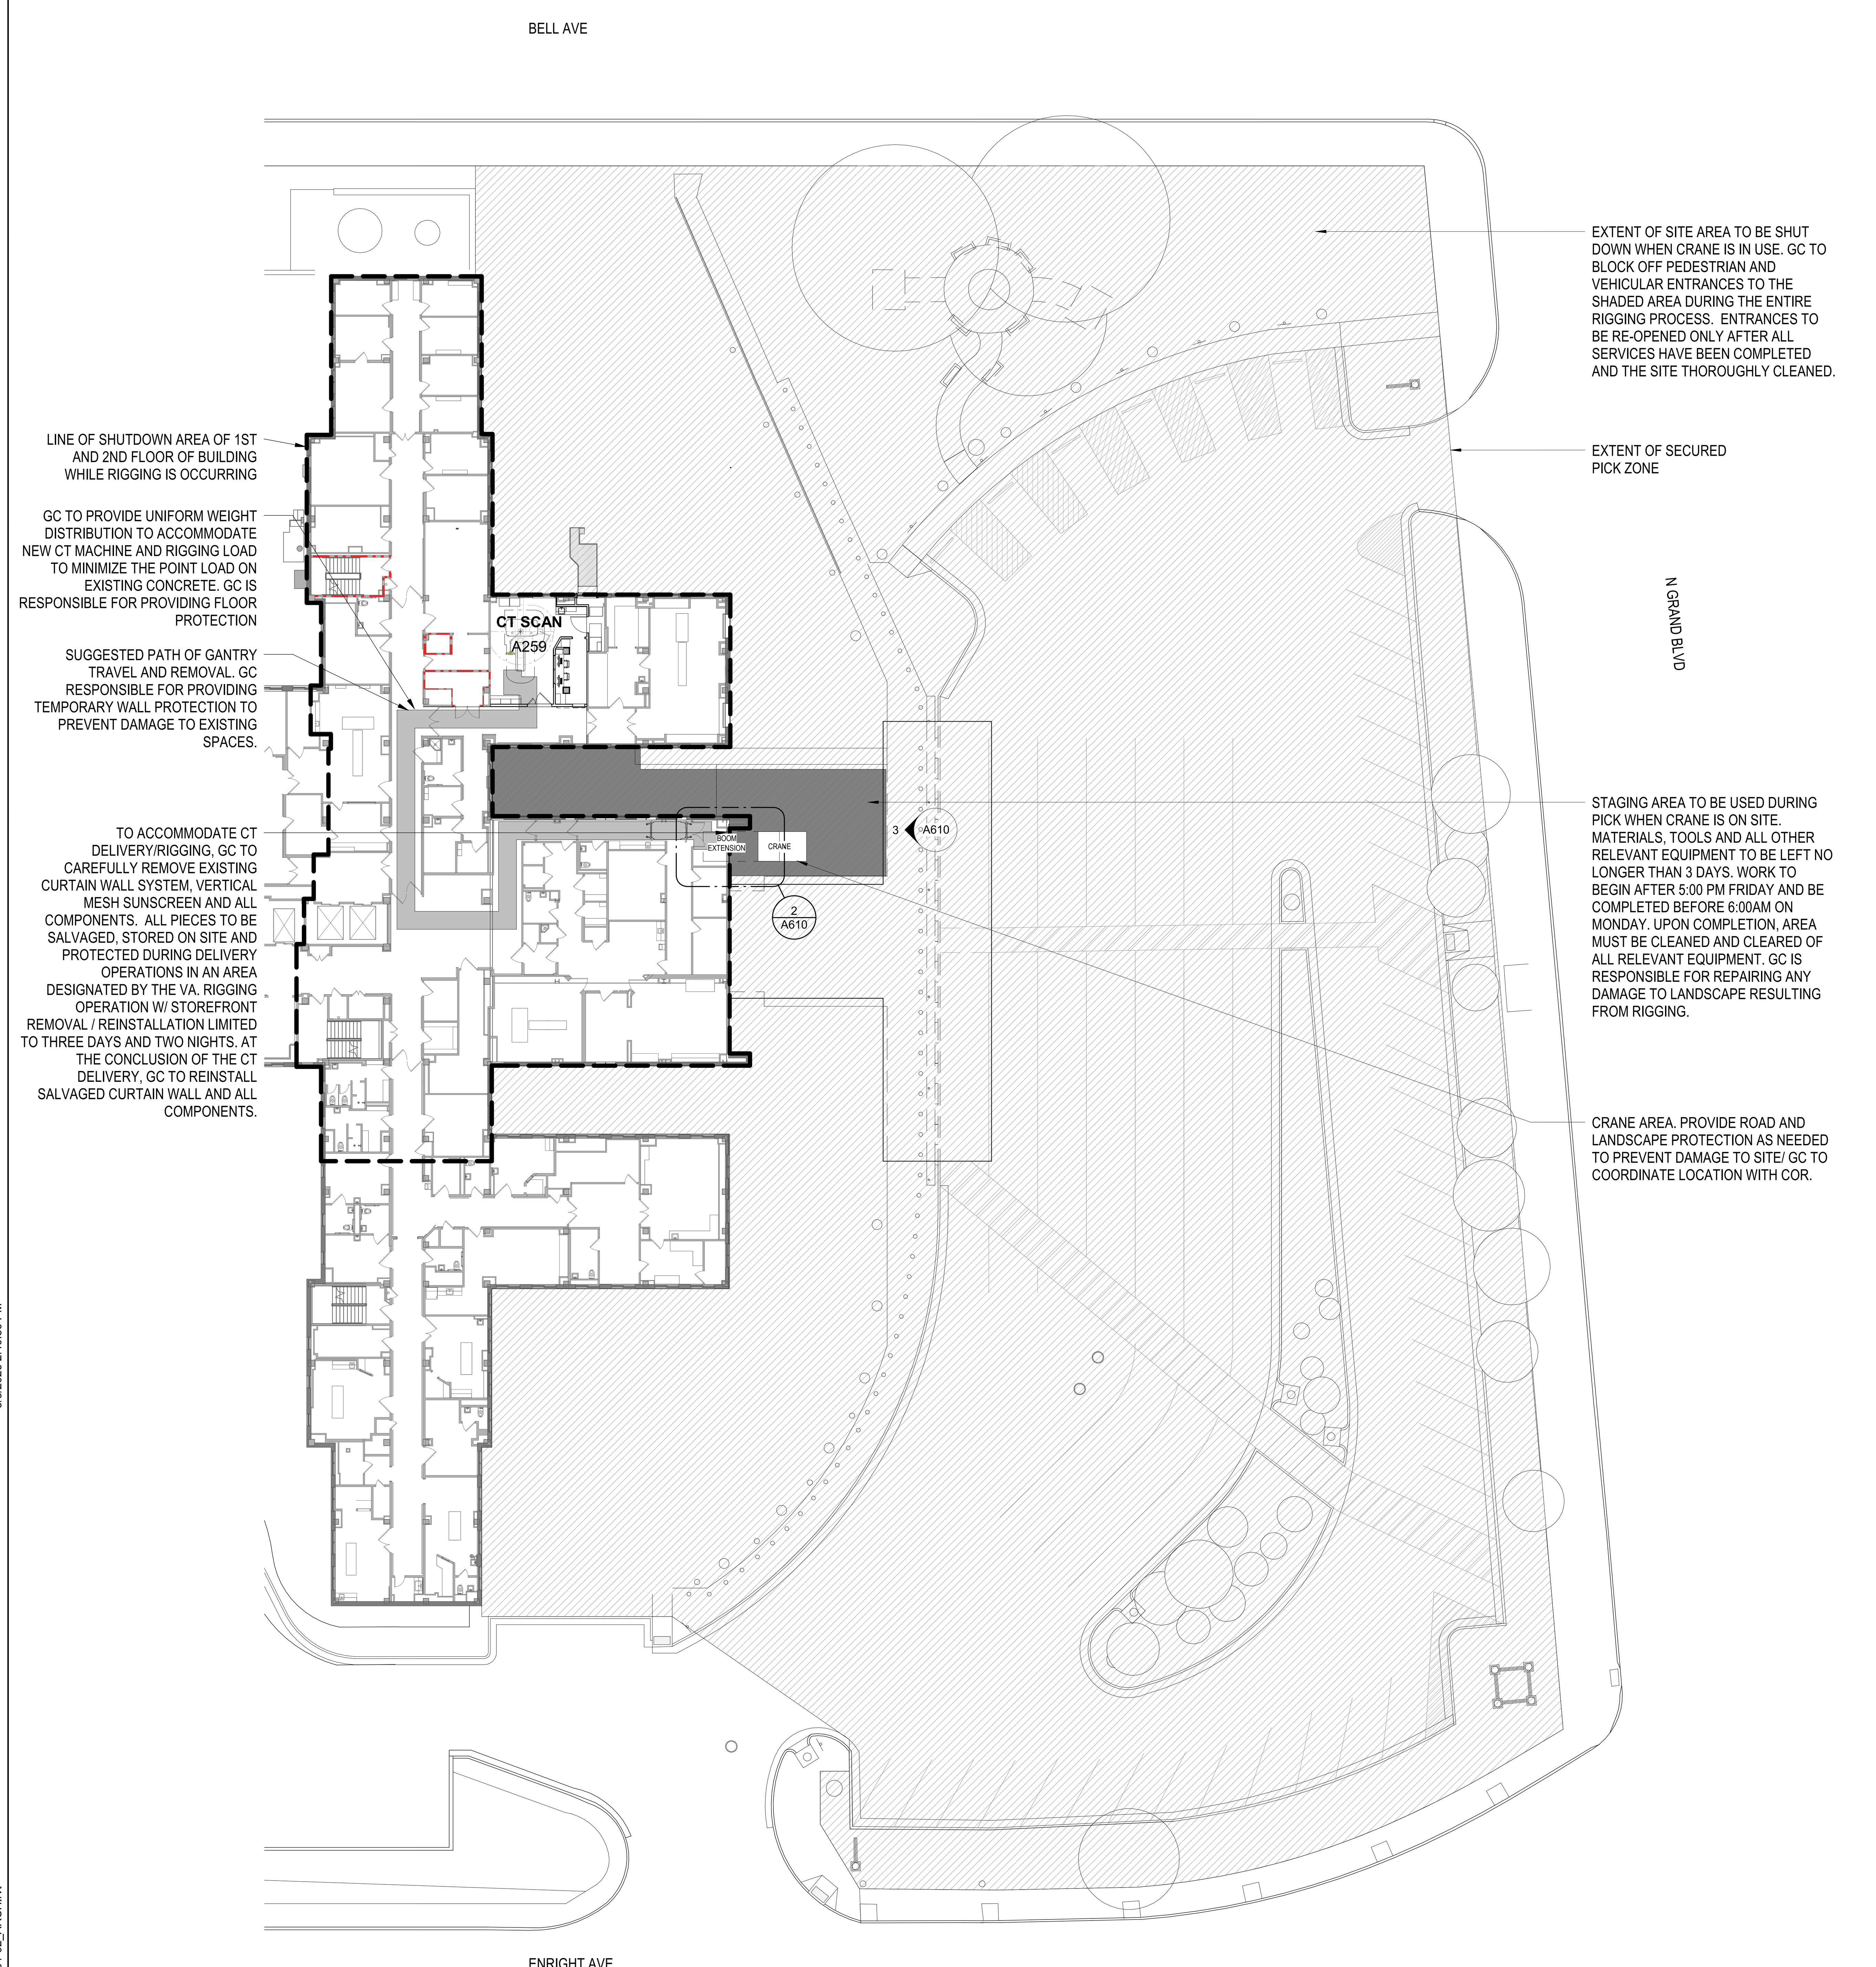

1 SECOND FLOOR RIGGING PLAN
3/64" = 1'-0"

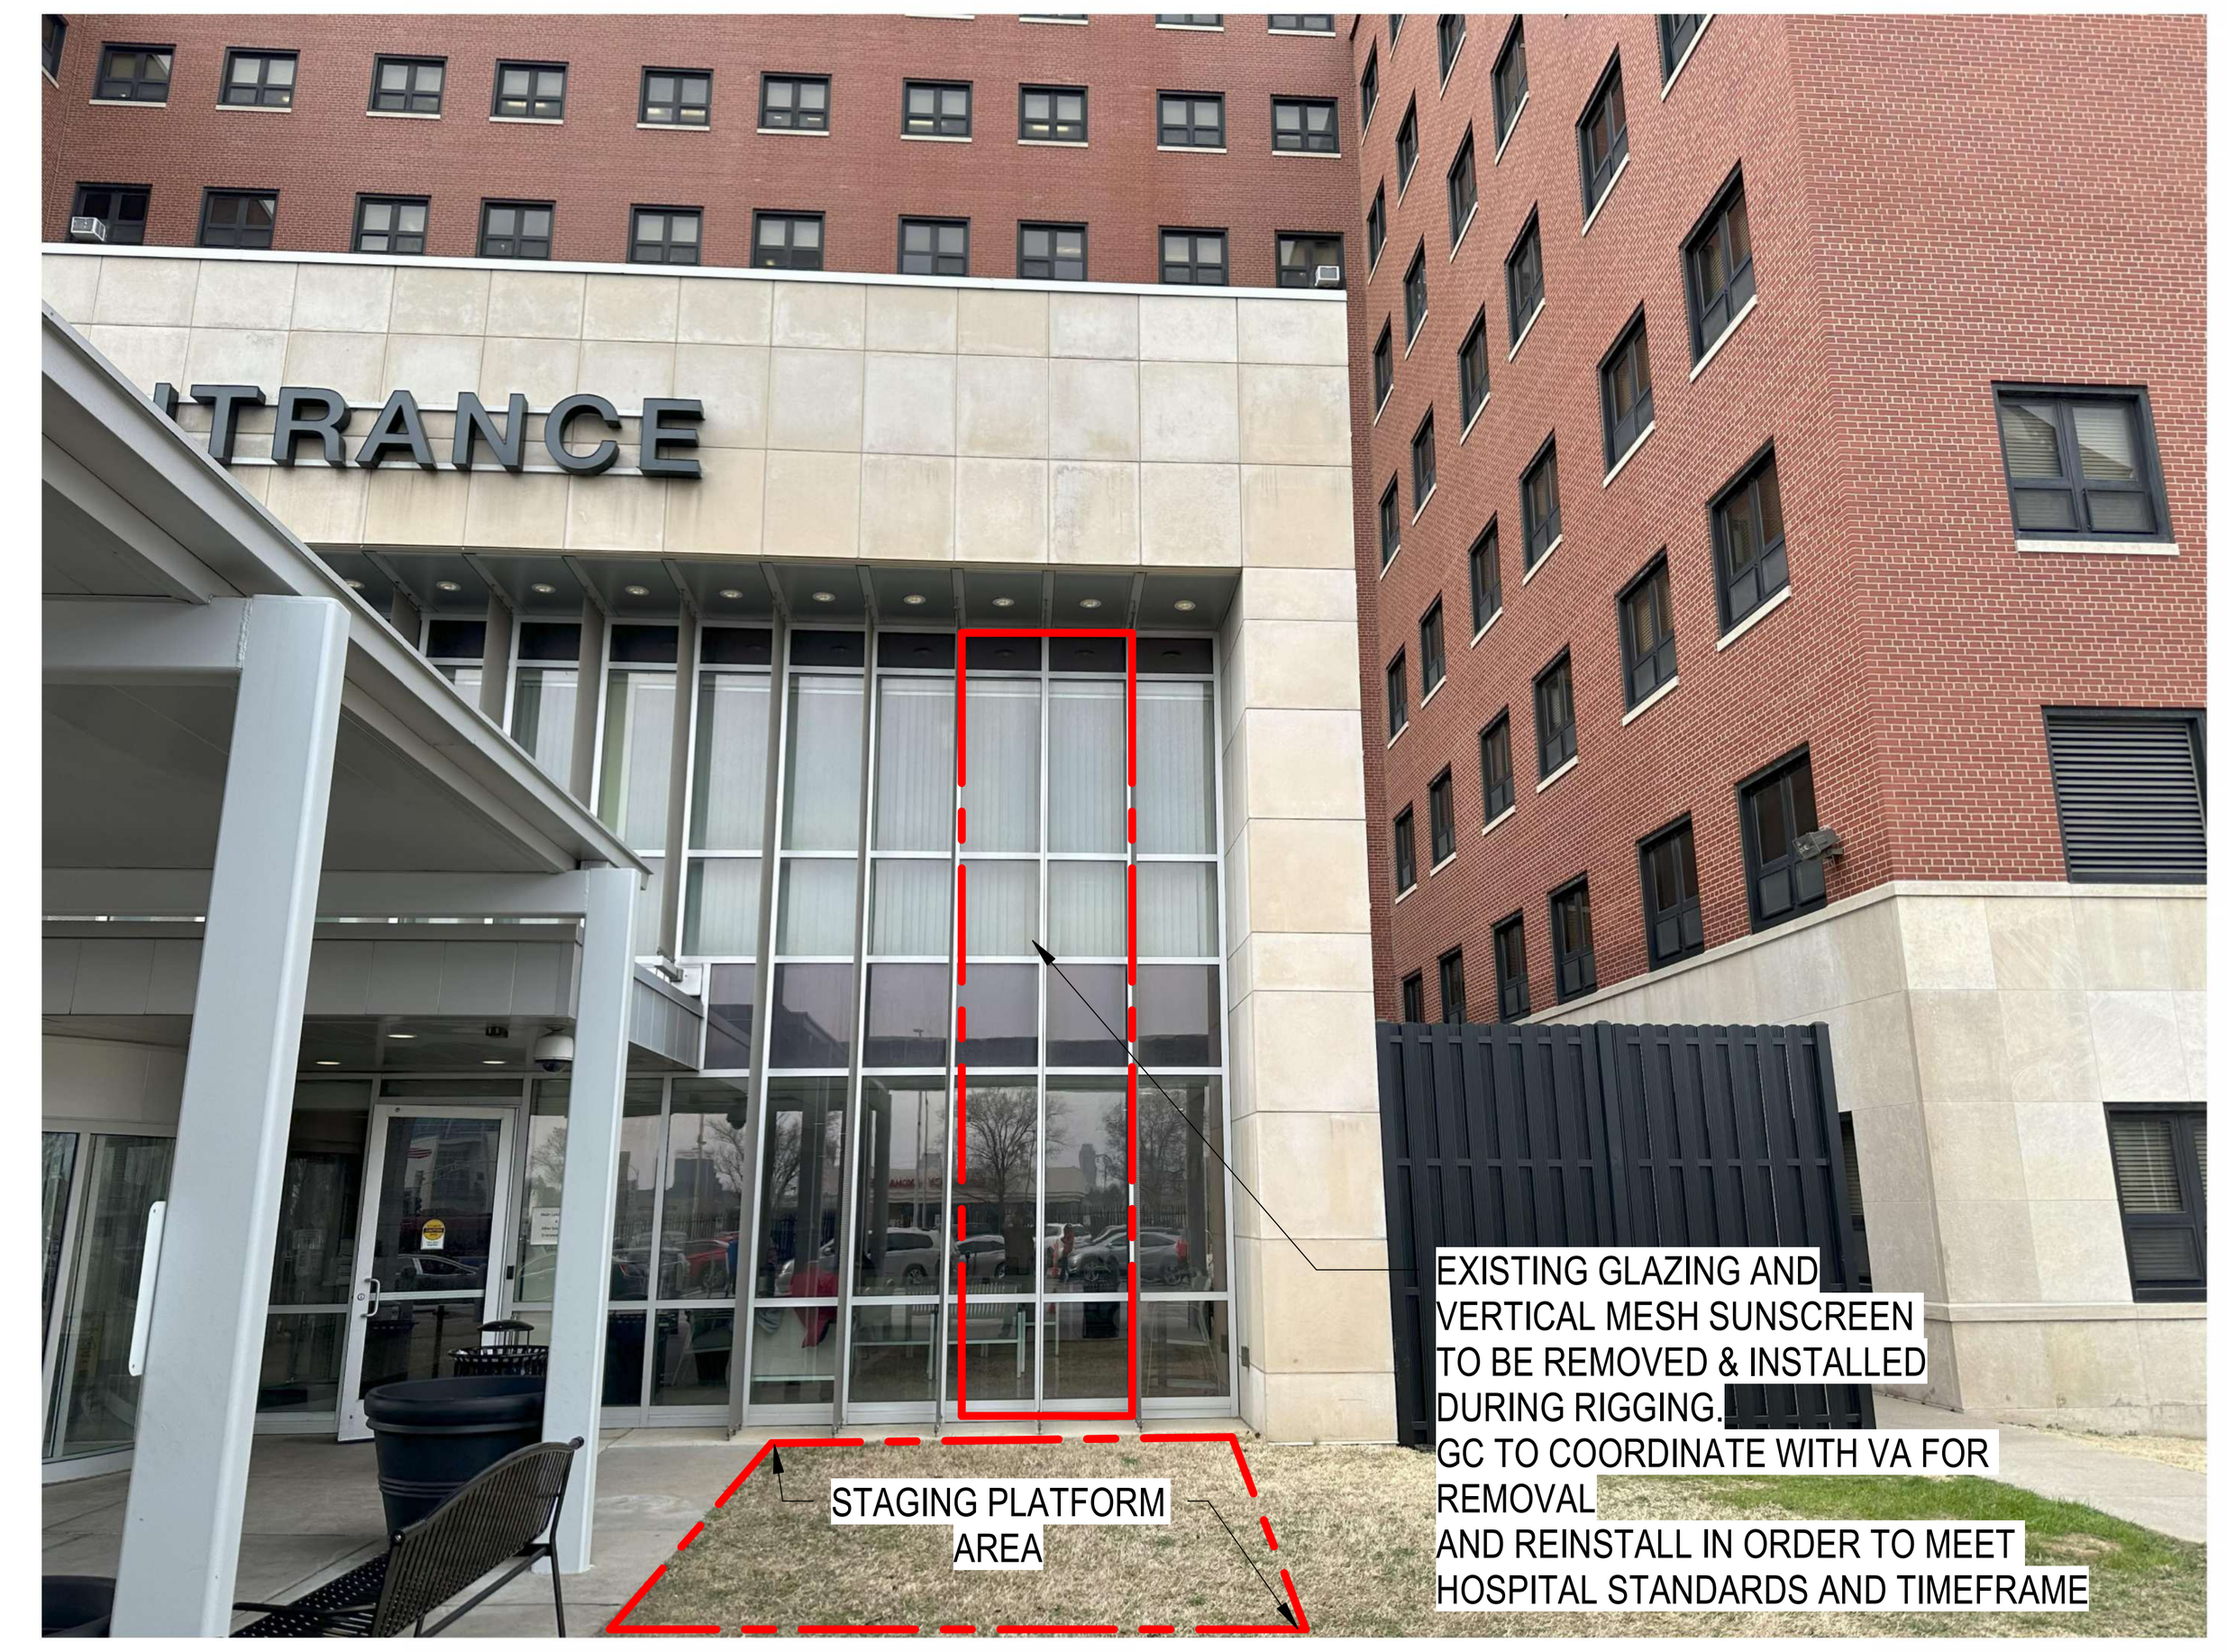

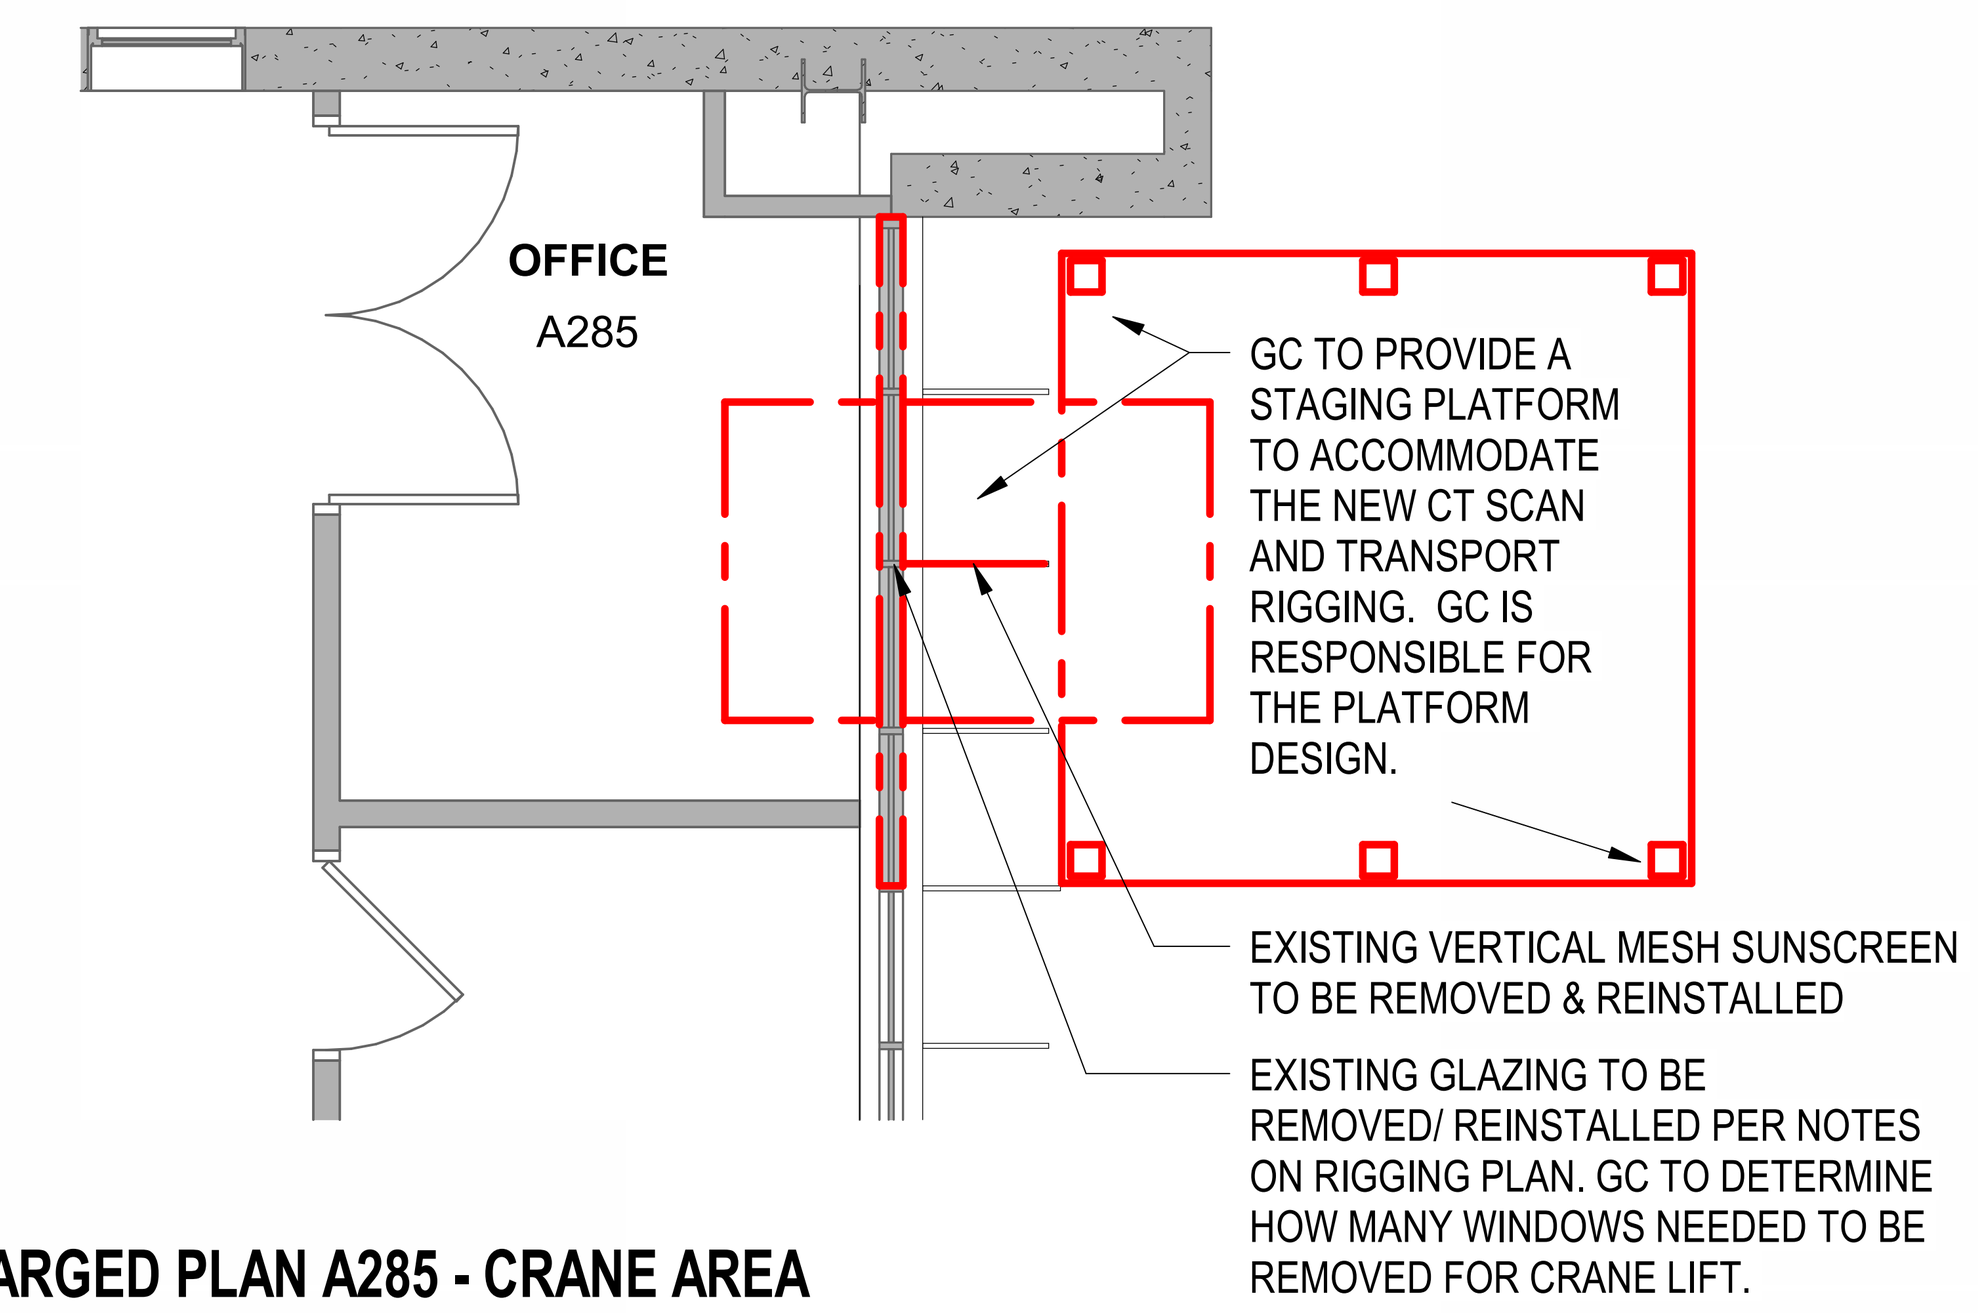

2 ENLARGED PLAN A285 - CRANE AREA
1/4" = 1'-0"

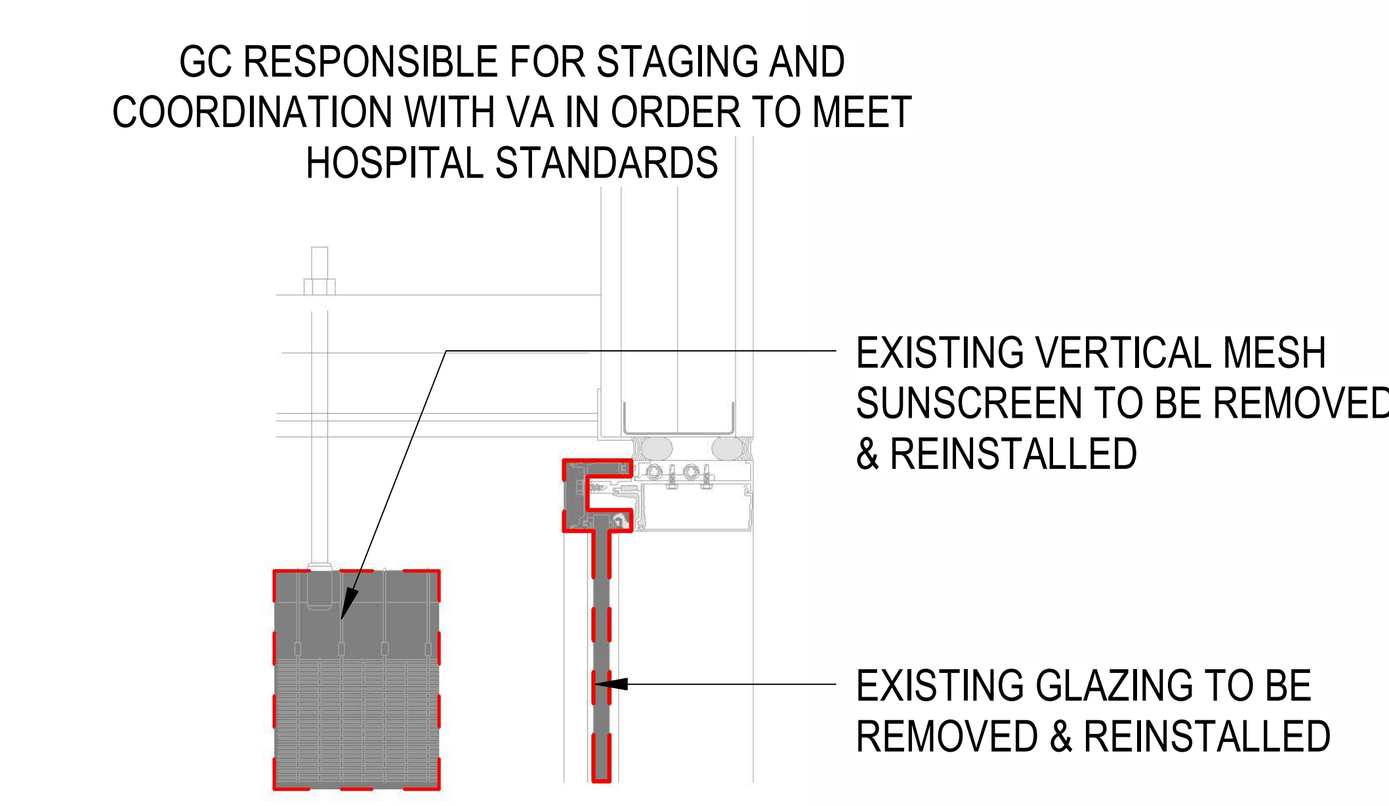

6 STAGING SECTION - BOTTOM OF OVERHANG
1 1/2" = 1'-0"

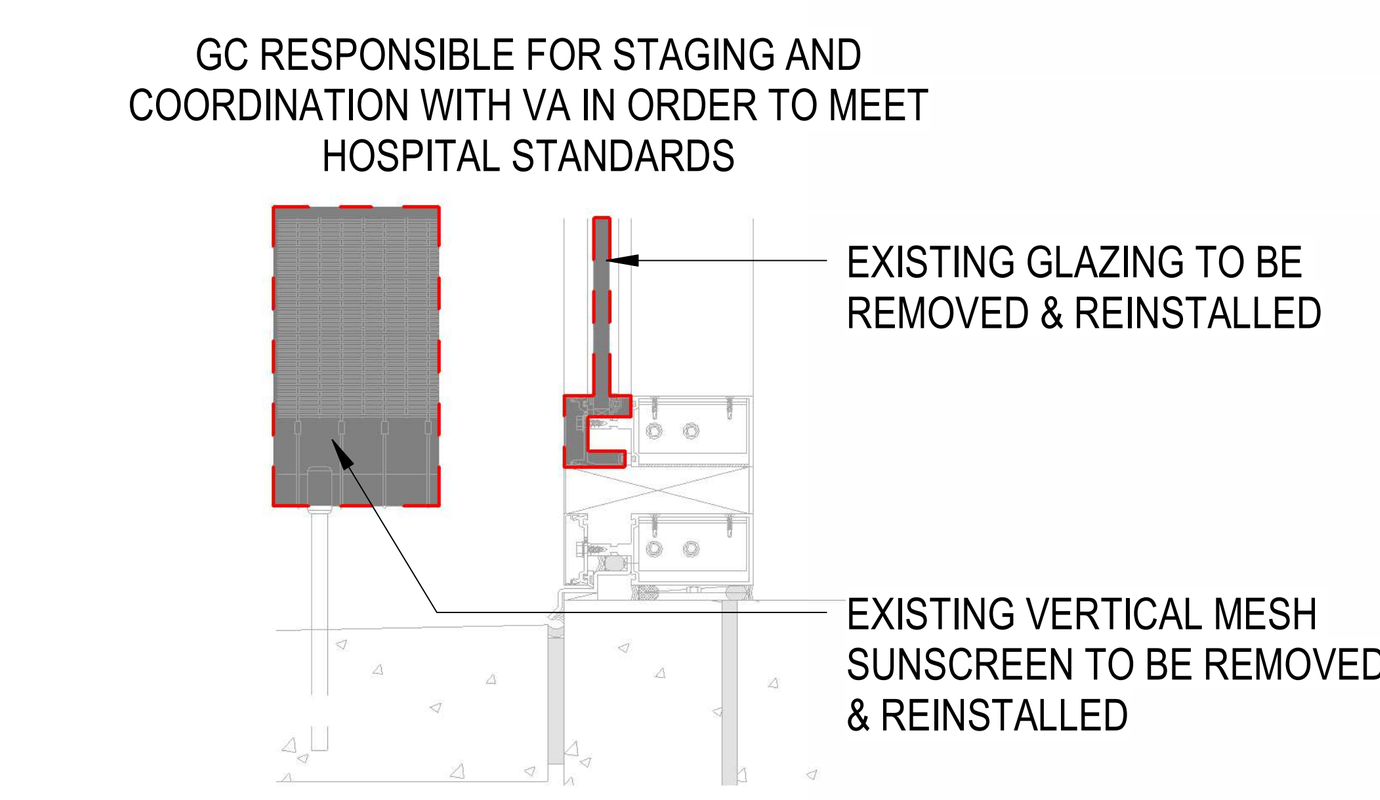

5 STAGING SECTION - AT FIRST FLOOR
1 1/2" = 1'-0"

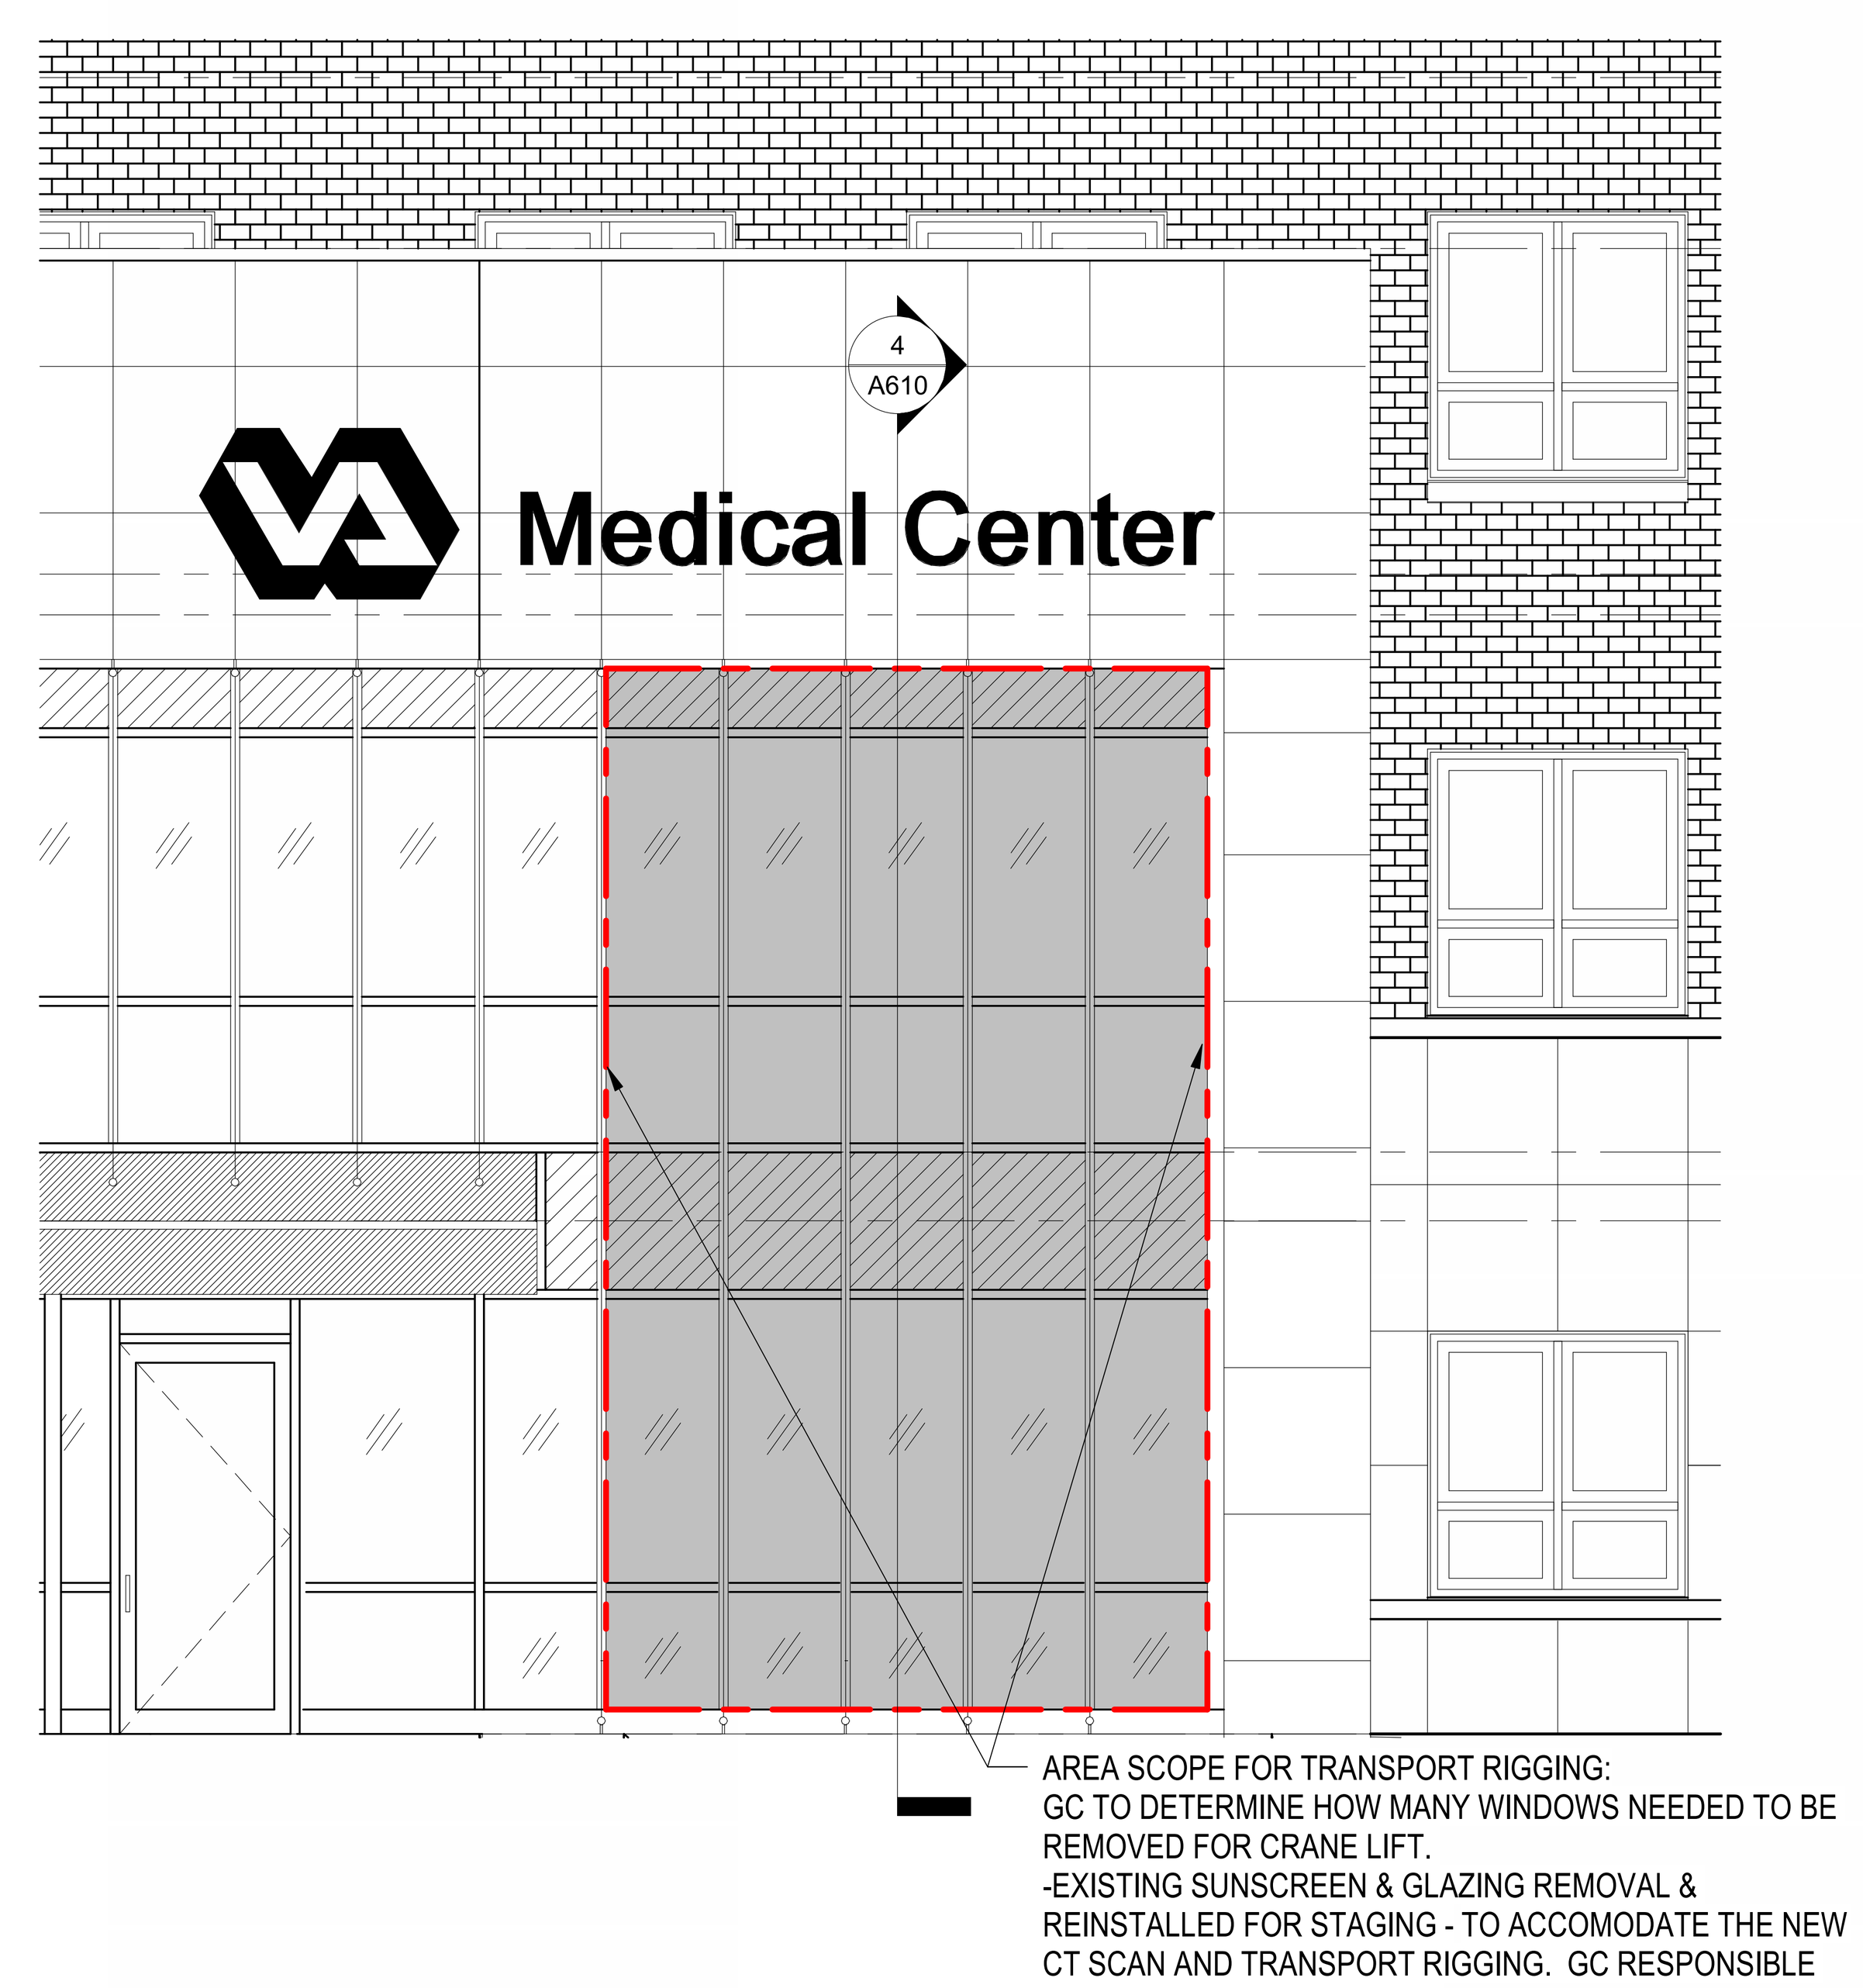

3 FRONT ELEVATION - STAGING
1/4" = 1'-0"

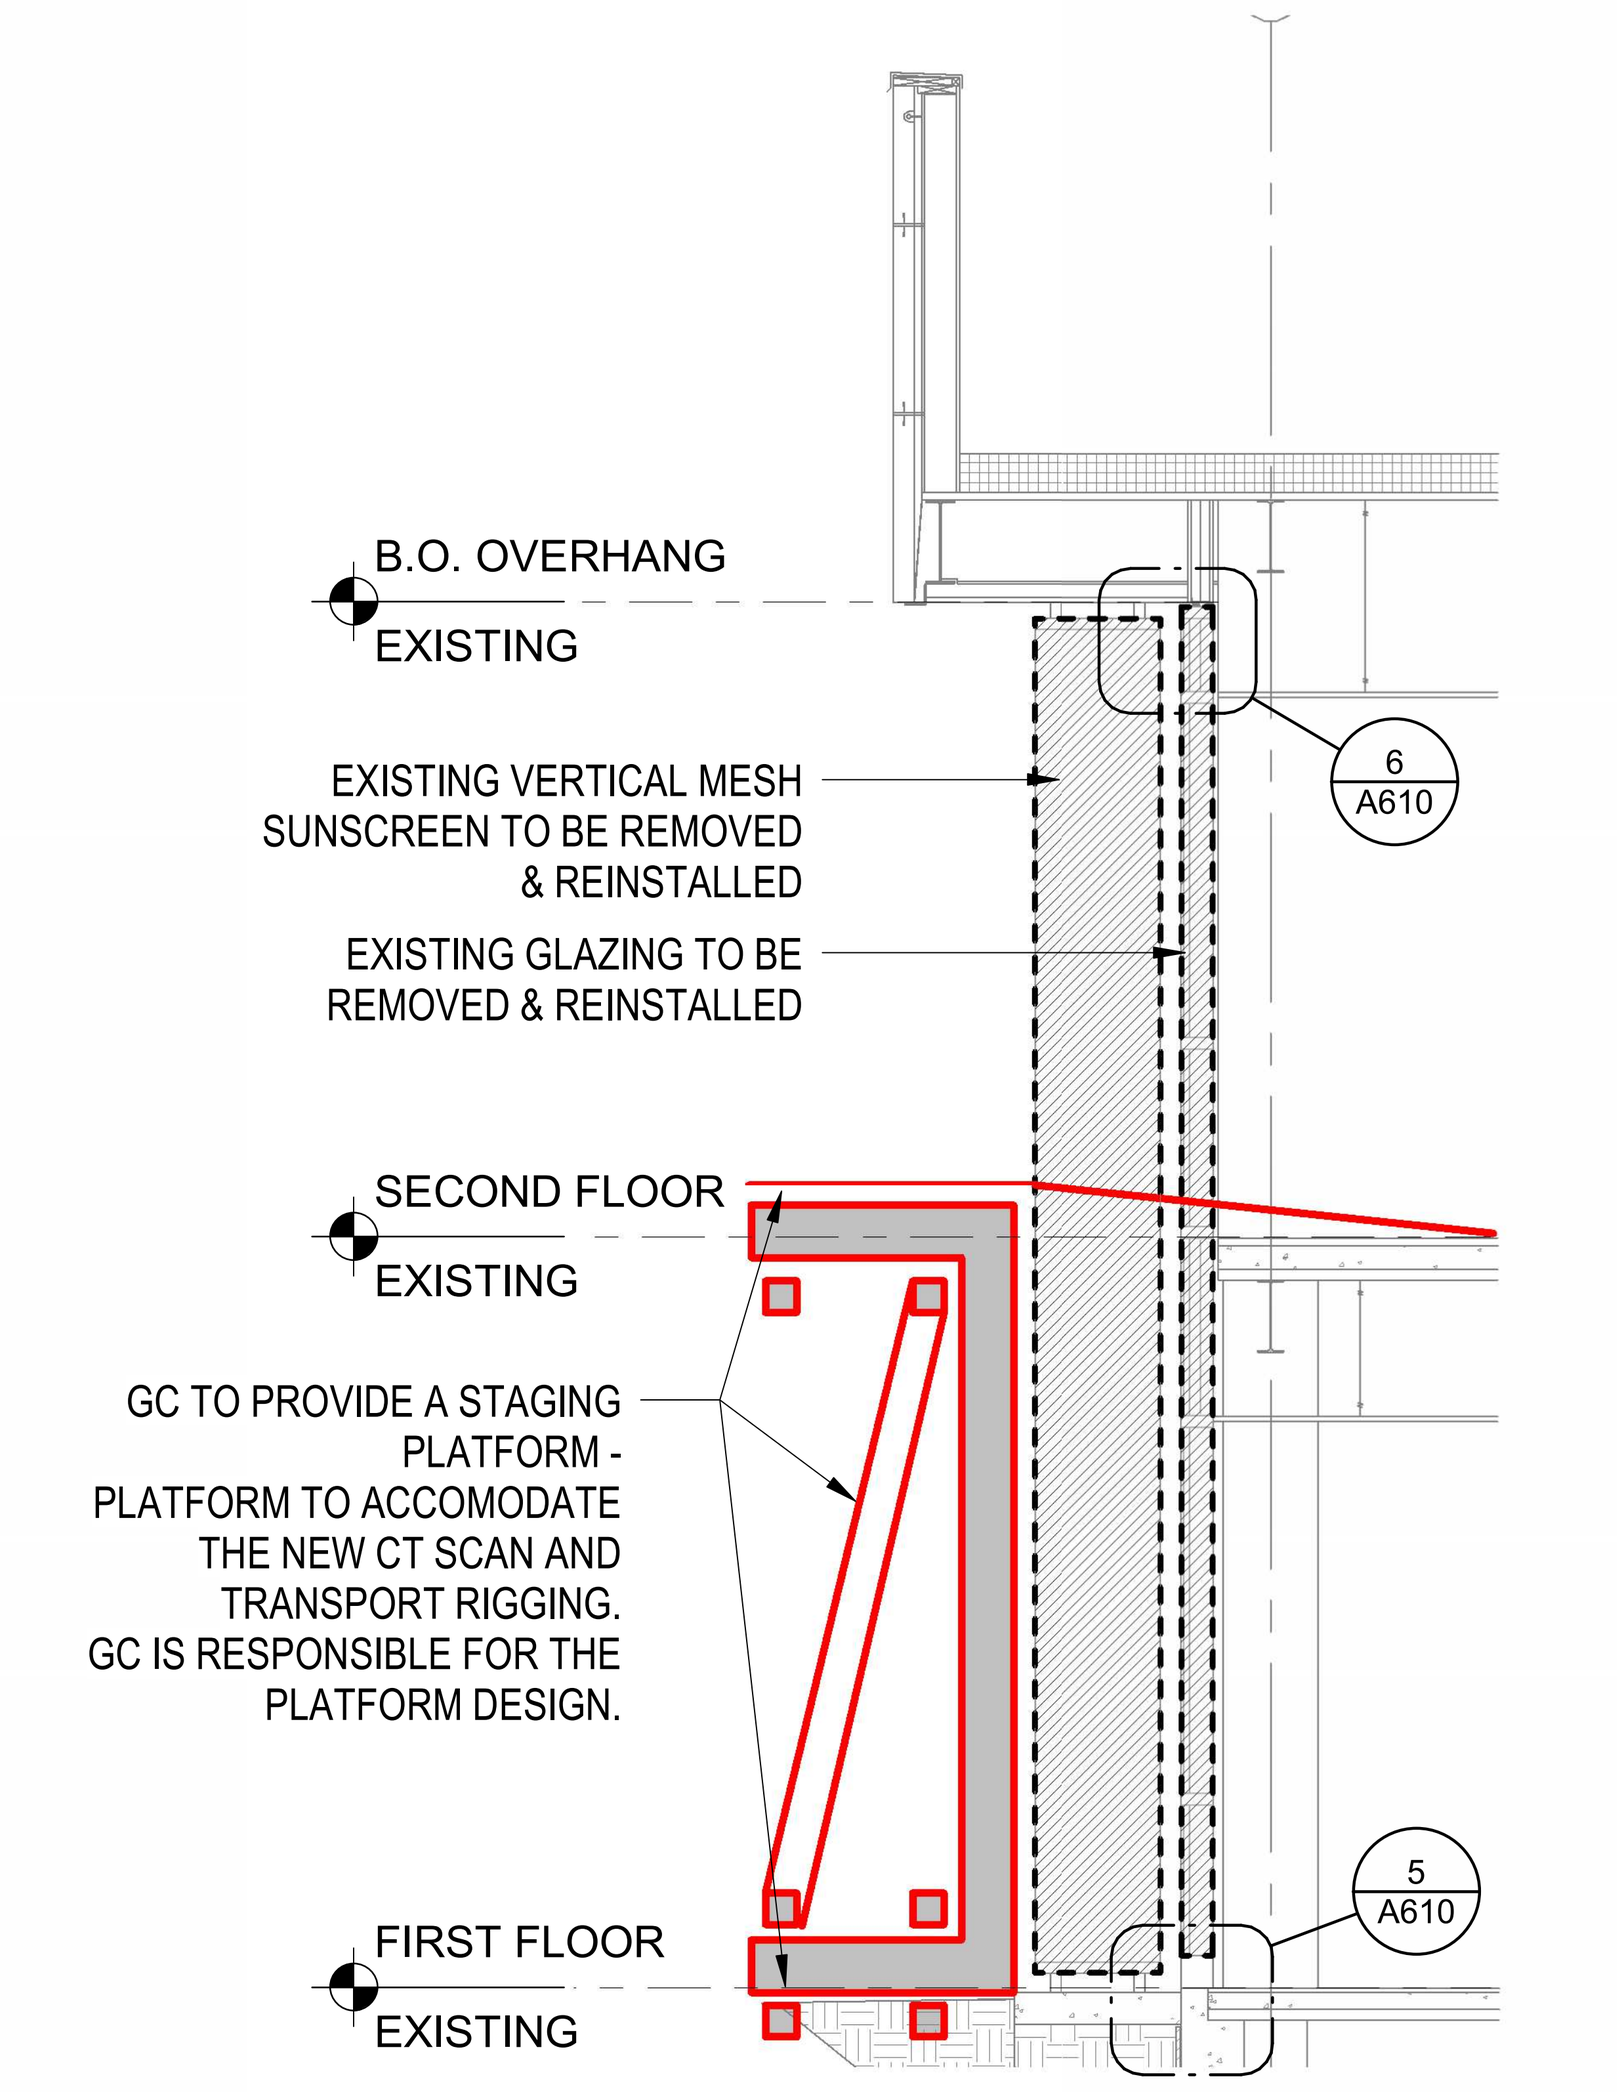

4 STAGING SECTION
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT

Above Group
ENGINEERING DESIGN CONSULTING

Mabbett
Scientists | Engineers | Program Managers

ARCHITECT/ENGINEER OF RECORD

THINKFORM

THINKFORM DESIGN ARCHITECTS LLC
1435 VINE STREET
CINCINNATI, OH 45202
T: 855.821.0274 F: 609.644.4397
Russell DiNardo, AIA MO A-2024000203

STAMP

STATE OF MISSOURI
RUSSELL DINARDO
NUMBER A - 2024000203
ARCHITECT

The Veterans Affairs Saint Louis Health Care System (VASTLHCS)

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
RIGGING PATH & ELEVATIONS	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
			Building Number: 1
Approved:		Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Drawing Number
		Issue Date: 06 MARCH 2026 / Checked: TB / Drawn: PS	A610

3/3/2026 2:40:50 PM

Autodesk Docs://24001 VA ST Louis CT/657-23-104JC_657-JC-01-02_ARCH.rvt

VA FORM 08 - 6231

FIRE PROTECTION LEGEND

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	HAZARD CLASSIFICATION KEY
	GATE VALVE		OS&Y VALVE	LIGHT HAZARD
	BALL VALVE		FIRE DEPARTMENT CONNECTION	ORDINARY HAZARD GROUP 1
	ALARM CHECK VALVE		FIRE PROTECTION RISER	ORDINARY HAZARD GROUP 2
	PRESSURE REGULATING VALVE		PIPE TURNING DOWN	EXTRA HAZARD GROUP 1
	BUTTERFLY VALVE		PIPE TURNING UP	EXTRA HAZARD GROUP 2
	FLOW SWITCH		FLUSHING CONNECTION OR CAP	N/A
		FS	FLOW SWITCH	
		TS	TAMPER SWITCH	
		HOSE	HOSE LINE CABINET	

FIRE SPRINKLER LEGEND

SYMBOL	MFG.	MODEL	MFG.	ORF	NPT	TEMP	RESPONSE	K-FAC	FINISH	STYLE
	TYCO	ROYAL FLUSH II	TY3531	1/2"	1/2"	155°	QUICK	5.6	WHITE	CONCEALED
	TYCO	TY-FRB	TY323	1/2"	1/2"	155°	QUICK	5.5	CHROME	RECESSED PENDENT
	TYCO	TY-FRB	TY3231	1/2"	1/2"	155°	QUICK	5.6	BRASS	PENDENT
	TYCO	DS-1	TY3255	1"	1"	155°	QUICK	5.6	BRASS	DRY PENDENT
	TYCO	TY-FRB	TY3131	1/2"	1/2"	155°	QUICK	5.6	BRASS	UPRIGHT
	TYCO	TY-FRB	TY3331	1/2"	1/2"	155°	QUICK	5.6	CHROME	HORIZONTAL SIDEWALL
	TYCO	TY-L	TY3311	1/2"	1/2"	200°	STANDARD	5.6	CHROME	HORIZONTAL SIDEWALL

GENERAL LEGEND

SYMBOL	DESCRIPTION
FP / 1	FIRE PROTECTION RISER DESIGNATION: FP = RISER IDENTIFYING SYSTEM TYPE 1= RISER IDENTIFYING SYSTEM NUMBER
A / B SIM	SECTION SYMBOL: A = IDENTIFYING LETTER B = SHEET WHERE SECTION IS SHOWN SIM = SIMILAR (ONLY NOTED IF IT APPLIES)
A	TITLE SYMBOL ON SHEET WHERE SHOWN A = IDENTIFYING NUMBER/LETTER
1 *REV DESCR*	REVISION CLOUD AND REVISION NUMBER. REVISION DESCRIPTION SHOWN IN ITALICS.
1	SHEET NOTE CALLOUT
	DEMOLISH TO POINT INDICATED
	CONNECT TO EXISTING

FIRE PROTECTION ABBREVIATIONS

ABBR.	DESCRIPTION	ABBR.	DESCRIPTION
AS	ABOVE SLAB	KW	KILOWATT
AHJ	AUTHORITY HAVING JURISDICTION	LF	LINEAR FEET
AFF	ABOVE FINISHED FLOOR	MAX	MAXIMUM
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE	MIN	MINIMUM
ASTM	AMERICAN STANDARDS TESTING MATERIALS	NA	NOT APPLICABLE
BFP	BACKFLOW PREVENTER	NC	NORMALLY CLOSED
BLDG	BUILDING	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
BOR	BOTTON OF RISER	NTS	NOT TO SCALE
BS	BELOW SLAB	OD	OUTSIDE DIAMETER
CAP	CAPACITY	OS&Y	OUTSIDE SCREW AND YOLK
CONN	CONNECTION	P	PUMP
CONT	CONTINUOUS	PH	PHASE
CV	CHECK VALVE	PIV	POST INDICATING VALVE
DIA	DIAMETER	POC	POINT OF CONNECTION
DN	DOWN	PSI	POUNDS PER SQUARE INCH
DP	DRY PENDENT	PS	PRESSURE SWITCH
DS	DRY SIDE WALL	QR	QUICK RESPONSE
DWG	DRAWING	RM	ROOM
ELEV	ELEVATION	RPM	REVOLUTIONS PER MINUTE
°F	DEGREES FAHRENHEIT	SF	SQUARE FEET
FDC	FIRE DEPARTMENT CONNECTION	SPEC	SPECIFICATIONS
FDV	FIRE DEPARTMENT VALVE	SR	STANDARD RESPONSE
FM	FACTORY MUTUAL	STD	STANDARD
FP	FIRE PROTECTION	TEMP	TEMPERATURE
FS	FLOW SWITCH	TDH	TOTAL DYNAMIC HEAD
FT	FEET	TOR	TOP OF RISER
GA	GAUGE	TS	TAMPER SWITCH
GAL	GALLON(S)	TYP	TYPICAL
GALV	GALVANIZED	UG	UNDERGROUND
GPM	GALLONS PER MINUTE	UL	UNDERWRITER'S LABORATORY
HD	HEAD	UNO	UNLESS NOTED OTHERWISE
HP	HORSEPOWER	V	VOLTS
HR	HOUR	VIV	VALVE IN VERTICAL
HYD	HYDRANT	VLV	VALVE
HZ	HERTZ	VOL	VOLUME
IE	INVERT ELEVATION	W/	WITH
ID	INTERNAL DIAMETER		
IN	INCHES		
IPS	INTERNATIONAL PIPE STANDARD		

NOTE: SOME ABBREVIATIONS AND SYMBOLS SHOWN ON THIS LEGEND MAY NOT PERTAIN TO THIS PROJECT

FIRE PROTECTION COMPLIANCE NOTES

BUILDING DESIGN:

THE CT SCANNER SPACE IN A259 AND ASSOCIATED SPACES WILL BE RENOVATED TO ACCOMMODATE A NEW SCANNER, CONTROL ROOM, AND EQUIPMENT ROOM. THE EXISTING SPRINKLER HEADS WILL BE REARRANGED AS REQUIRED.

SCOPE OF WORK:

PROVIDE A FULLY AUTOMATIC WET SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA 13 2022 EDITION. ALL SPRINKLER HEADS SHALL BE QUICK RESPONSIVE TYPE AND INSTALLED IN CENTER OF CEILING TILES. SPRINKLER CONTRACTOR SHALL USE FLOW DATA WHEN PERFORMING HYDRAULIC CALCULATIONS.

FIRE PROTECTION SPRINKLER CONTRACTOR SHALL COORDINATE THE DESIGN AND INSTALLATION OF THE FIRE PROTECTION SPRINKLER SYSTEM AND DELIVER A COMPLETE, FULLY FUNCTIONAL, AND TESTED FIRE PROTECTION SYSTEM THAT MEETS THE REQUIREMENTS OF THE FIRE PROTECTION DRAWINGS, FIRE PROTECTION SPECIFICATIONS, LISTED CODES AND STANDARDS, AND THE REQUIREMENTS OF THE AHJ. THE FIRE PROTECTION SPRINKLER CONTRACTOR SHALL PROVIDE AND INSTALL NEW MATERIALS THAT ARE UL LISTED AND\OR FM APPROVED AS REQUIRED BY THE FIRE PROTECTION DRAWINGS AND THE FIRE PROTECTION SPECIFICATIONS. THE FIRE PROTECTION SPRINKLER CONTRACTOR SHALL INTEGRATE THE NEW FIRE SPRINKLER SYSTEM WITH THE NEW FIRE ALARM SYSTEM.

MICROBIAL INDUCED CORROSION (MIC):

THE LOCAL WATER PURVEYOR IS REQUESTED TO ADVISE THE ENGINEER OF RECORD IF CONDITIONS EXIST IN THEIR WATER SUPPLY THAT COULD LEAD TO MIC SO THAT THE ENGINEER CAN DESIGN CORRECTIVE MEASURES

QUALITY AND PERFORMANCE SPECIFICATIONS OF ALL INTERIOR FIRE PROTECTION COMPONENTS:

ALL NEW INTERIOR FIRE PROTECTION EQUIPMENT EQUIPMENT SHALL BE UL LISTED OR FM APPROVED.

ACCEPTANCE TEST CRITERIA:

FIRE SPRINKLER SYSTEM SHALL BE DESIGNED PER NFPA 13, 2022 EDITION AND SHALL COMPLY WITH THE LOCAL FIRE MARSHAL AND ALL AUTHORITIES HAVING JURISDICTION. THE ACCEPTANCE TESTING OF THE FIRE SPRINKLER SYSTEM AND IT'S COMPONENTS SHALL CONSIST OF ALL APPLICABLE ITEMS SHOWN ON THESE TWO FORMS, NFPA 13, 2022 EDITION, ANNEX A (FIG. A.29.1) CONTRACTOR'S MATERIAL AND TEST CERTIFICATE FOR ABOVE GROUND PIPING. SEE NFPA 13, 2022 EDITION CHAPTER 29 FOR SYSTEM ACCEPTANCE AND NFPA 25, 2020 INSPECTION TESTING AND MAINTENANCE.

1. NFPA 13 2022 CHAPTER 29, SYSTEM ACCEPTANCE
   A. 29.1 APPROVAL OF SPRINKLER SYSTEM
   B. 29.2 ACCEPTANCE REQUIREMENTS
   C. 29.3 INSTRUCTIONS
   D. 29.4 HYDRAULIC DESIGN INFORMATION SIGNS

APPLICABLE NFPA AND VA STANDARDS TO BE APPLIED:

1. VA FIRE PROTECTION DESIGN MANUAL (FPDM) EIGHTH EDITION
2. INTERNATIONAL BUILDING CODE (IBC) 2021 EDITION
3. STANDARD FOR THE INSTALLATION OF SPRINKLER SYSTEMS (NFPA 13) 2022 EDITION
4. STANDARD FOR THE INSTALLATION OF STANDPIPE AND HOSE SYSTEMS (NFPA 14) 2019 EDITION
5. STANDARD FOR WATER TANKS FOR PRIVATE FIRE PROTECTION (NFPA 22) 2023 EDITION
6. STANDARD FOR THE INSTALLATION OF PRIVATE FIRE SERVICE MAINS AND THEIR APPURTENANCES (NFPA 24) 2022 EDITION
7. INSPECTION, TESTING AND MAINTENANCE OF WATER BASED FIRE PROTECTION SYSTEM (NFPA 25) 2023 EDITION
8. COMPRESSED GASES AND CRYOGENIC FLUIDS (NFPA 55) 2023 EDITION
9. LIFE SAFETY CODE (NFPA 101) 2021 EDITION

CLASSIFICATION OF HAZARD OCCUPANCY FOR EACH ROOM OR AREA:

LIGHT HAZARD:
SPACES WITH LOW QUANTITY AND COMBUSTIBILITY OF CONTENTS
I.E. OFFICES, EXAM ROOMS, CORRIDORS, MEETING ROOMS, BREAK ROOMS, AND RESTROOMS.

ORDINARY HAZARD GROUP 1:
SPACES WITH MODERATE QUANTITY AND LOW COMBUSTIBILITY OF CONTENTS
I.E. LABORATORIES, MECHANICAL ROOMS, ELECTRICAL ROOMS, JANITOR CLOSETS, CLEAN AND SOILED UTILITY ROOMS, AND AUTOPSY.

ORDINARY HAZARD GROUP 2:
SPACES WITH MODERATE TO HIGH QUANTITY AND COMBUSTIBILITY OF CONTENTS
I.E. NITROGEN STORAGE, MODERATE QUANTITY AND MODERATE COMBUSTIBILITY STORAGE (UP TO 12 FT IN HEIGHT),CLEAN AND SOILED LINEN ROOMS, AND LAUNDRY.

EXTRA HAZARD GROUP 1:
SPACES WITH HIGH QUANTITY AND COMBUSTIBILITY OF CONTENTS
I.E. SPACES WHERE DUST, LINT, OR OTHER MATERIALS ARE PRESENT THAT WILL CONTRIBUTE A RAPIDLY DEVELOPING FIRE.

EXTRA HAZARD GROUP 2:
SPACES WITH HIGH QUANTITY AND COMBUSTIBILITY OF CONTENTS
I.E. SPACES WITH SUBSTANTIAL AMOUNTS OF COMBUSTIBLE/FLAMABLE LIQUIDS, SPACES WHERE SHIELDING OF COMBUSTIBLES IS EXTENSIVE.

DESIGN APPROACH:

SPRINKLER SYSTEM TO EXTEND INTO ALL AREAS IN ACCORDANCE WITH NFPA 13 LIGHT HAZARD OR AS NOTED. LISTED AND APPROVED SIDEWALL (5.60 K-FACTOR) AND PENDENT (5.60 K-FACTOR) SPRINKLER HEADS TO BE PROVIDED. UPRIGHT (5.60 K-FACTOR) HEADS TO BE PROVIDED WHERE NOTED ON DRAWINGS.

LIGHT HAZARD:

SYSTEM TYPE: WET PIPE AUTOMATIC SPRINKLER SYSTEM, USING STEEL SUPPLY PIPING TO NEW QUICK RESPONSE, PENDENT OR UPRIGHT HEADS. AREAS SUBJECT TO FREEZING SHALL USE DRY BARREL TYPE SPRINKLERS.

K-FACTOR: 5.6 (EXTENDED COVERAGE SPRINKLER HEADS ARE ACCEPTABLE).
DENSITY: 0.10 GPM/SQ.FT.

AREA OF OPERATION: 900 SQ FT MIN AND 1500 SQ FT MAX (DESIGN AREA REDUCTION MAY ONLY BE USED IF CEILING HEIGHT AND AREA CLASSIFICATION PERMITS PER NFPA 13 2022 EDITION.

HEAD TEMPERATURE RATING: 155 DEGREES F.
SPACING: 225 SQ. FT. MAX. PER SPRINKLER HEAD OR BY MANUFACTURER LITERATURE.
HOSE ALLOWANCE: 100 GPM

ORDINARY HAZARD GROUP 1:

SYSTEM TYPE: WET PIPE AUTOMATIC SPRINKLER SYSTEM, USING STEEL SUPPLY PIPING TO NEW QUICK RESPONSE, PENDENT OR UPRIGHT HEADS.

K-FACTOR: 5.6, 8.0, 11.2, OR 14.0 (EXTENDED COVERAGE SPRINKLER HEADS ARE ACCEPTABLE).
DENSITY: 0.15 GPM/SQ.FT.

AREA OF OPERATION: 900 SQ FT MIN AND 1500 SQ FT MAX (DESIGN AREA REDUCTION MAY ONLY BE USED IF CEILING HEIGHT AND AREA CLASSIFICATION PERMITS PER NFPA 13 2022 EDITION.

HEAD TEMPERATURE RATING: 155 DEGREES F.
SPACING: 130 SQ. FT. MAX. PER SPRINKLER HEAD OR BY MANUFACTURER LITERATURE.
HOSE ALLOWANCE: 250 GPM

ORDINARY HAZARD GROUP 2:

SYSTEM TYPE: WET PIPE AUTOMATIC SPRINKLER SYSTEM, USING STEEL SUPPLY PIPING TO NEW QUICK RESPONSE, OR STANDARD SPRAY UPRIGHT, SEMI-RECESSED PENDENT, OR SIDEWALL HEADS.

K-FACTOR: 5.6, 8.0, 11.2, OR 14.0 (EXTENDED COVERAGE SPRINKLER HEADS ARE ACCEPTABLE).
DENSITY: 0.20 GPM/SQ.FT.

AREA OF OPERATION: 900 SQ FT MIN AND 1500 SQ FT MAX (DESIGN AREA REDUCTION MAY ONLY BE USED IF CEILING HEIGHT AND AREA CLASSIFICATION PERMITS PER NFPA 13 2022 EDITION).

HEAD TEMPERATURE RATING: 155 DEGREES F.
SPACING: 130 SQ. FT. MAX. PER SPRINKLER HEAD OR BY MANUFACTURER LITERATURE.
HOSE ALLOWANCE: 250 GPM

EXTRA HAZARD GROUP 1:

SYSTEM TYPE: WET PIPE AUTOMATIC SPRINKLER SYSTEM, USING STEEL SUPPLY PIPING TO NEW QUICK RESPONSE, OR STANDARD SPRAY UPRIGHT, SEMI-RECESSED PENDENT, OR SIDEWALL HEADS.

K-FACTOR: 8.0 OR LARGER.
DENSITY: 0.30 GPM/SQ.FT.

AREA OF OPERATION: 2,500 SQ FT MIN

HEAD TEMPERATURE RATING: 155 DEGREES F.
SPACING: 100 SQ. FT. MAX. PER SPRINKLER HEAD OR BY MANUFACTURER LITERATURE.
HOSE ALLOWANCE: 500 GPM

EXTRA HAZARD GROUP 2:

SYSTEM TYPE: WET PIPE AUTOMATIC SPRINKLER SYSTEM, USING STEEL SUPPLY PIPING TO NEW QUICK RESPONSE, OR STANDARD SPRAY UPRIGHT, SEMI-RECESSED PENDENT, OR SIDEWALL HEADS.

K-FACTOR: 8.0 OR LARGER.
DENSITY: 0.40 GPM/SQ.FT.

AREA OF OPERATION: 2,500 SQ FT MIN

HEAD TEMPERATURE RATING: 155 DEGREES F.
SPACING: 100 SQ. FT. MAX. PER SPRINKLER HEAD OR BY MANUFACTURER LITERATURE.
HOSE ALLOWANCE: 500 GPM

FIRE PROTECTION GENERAL NOTES

1. FIRE PROTECTION SYSTEM SHALL COMPLY WITH NFPA 13 AND VA FIRE PROTECTION MANUAL FOR INSTALLATION OF SPRINKLER SYSTEMS. INSPECTION, TESTING, AND MAINTENANCE SHALL COMPLY TO NFPA 25. IN ADDITION, INSTALLATION AND INSPECTION, TESTING, AND MAINTENANCE SHALL COMPLY WITH THE PROJECT SPECIFICATIONS AND ALL APPLICABLE STATE, LOCAL CODES & AHJ REQUIREMENTS.
2. FINAL INSPECTION AND APPROVAL BY AUTHORITY HAVING JURISDICTION (AHJ).
3. SPRINKLER SHOP DRAWINGS AND MATERIAL SUBMITTALS SHALL BE SUBMITTED TO THE ARCHITECT/ENGINEER AND STATE FIRE MARSHALL AND SHALL BE APPROVED PRIOR TO ANY INSTALLATION. THE ENGINEER OF RECORD SHALL HAVE THE RIGHT TO REJECT ANY SUBMITTALS.
4. CUTTING OF STRUCTURAL AND/OR ARCHITECTURAL MEMBERS TO BE DONE ONLY WITH THE WRITTEN APPROVAL OF THE ARCHITECT AND STRUCTURAL ENGINEER.
5. FITTINGS REQUIRED FOR PROPER INSTALLATION, COORDINATION WITH OTHER EXISTING TRADES, AND/OR TO MAINTAIN PROPER CLEARANCES SHALL BE PROVIDED. VERIFY STRUCTURAL, MECHANICAL, ELECTRICAL INSTALLATIONS AND AVOID AN/ALL OBSTRUCTIONS OR INTERFERENCES WITH FIRE PROTECTION PIPE ROUTING.
6. CONTRACTOR SHALL MAKE A FIELD VISIT TO VERIFY ARCHITECTURAL REFLECTED CEILING CONDITIONS AND ELECTRICAL LIGHTING, CEILING CONFIGURATIONS AND HEIGHTS.
7. FIRE STOP ALL PENETRATIONS OF SMOKE/FIRE WALLS, CEILINGS, FLOORS, ROOFS, ETC., FLASH AND COUNTERFLASH ROOF PENETRATIONS.
8. PROVIDE ACCESS PANELS TO ALL VALVES ABOVE NON-ACCESSIBLE CEILINGS AND CHASES.
9. SPRINKLER HEADS ARE TO BE COORDINATED WITH ALL LOCATIONS OF DIFFUSERS, SPEAKERS, LIGHTING FIXTURES, CEILING SYSTEMS AND STRUCTURAL SYSTEM.
10. INDICATE CENTER TO CENTER DIMENSIONS AND/OR PIPE CUT LENGTHS AND NOMINAL PIPE DIAMETERS ON ALL PIPING. INDICATE PIPE TYPE, SCHEDULE OF WALL THICKNESS AND METHOD OF JOINING ON SHOP DRAWING.
11. PROVIDE STOCK OF EXTRA SPRINKLERS IN ACCORDANCE WITH NFPA 13.
12. PROVIDE DETAIL AND INDICATE TYPE OF HANGERS TO BE INSTALLED FOR SPRINKLER PIPING. METHODS OF HANGING PIPES, HEADERS AND BRANCHES SHALL BE IN ACCORDANCE WITH NFPA 13. ALL HANGERS ON 4" PIPE AND LARGER SHALL BE CLEVIS-TYPE HANGERS. HANGERS SHALL NOT INTERFERE WITH ANY OTHER TRADE. POWDER DRIVEN STUDS SHALL NOT BE USED.
13. ALL GROOVED & SCREWED FITTINGS SHALL BE UL/FM APPROVED AND SUBMITTED TO THE ENGINEER OF RECORD FOR APPROVAL PRIOR TO ANY INSTALLATION. THE ENGINEER OF RECORD RESERVES THE RIGHT TO DISAPPROVE ANY FITTING. ALL SCREWED PIPING SHALL BE SCHEDULE 40 BLACK STEEL PIPE IN ACCORDANCE WITH SPECIFICATIONS ASTM A120 AND SHALL BE JOINED BY SCREWED JOINTS IN ACCORDANCE WITH SPECIFICATION ANSI B2.1. ALL GROOVED PIPING 2-1/2" OR LARGER SHALL BE SCHEDULE 10 BLACK STEEL.
14. WELD-O-LETS SHALL BE TWO SIZES SMALLER THAN CROSS MAIN, NO LENGTH OF CROSS MAIN SHALL BE GREATER THAN 10'-0". ALL SPRINKLER PIPING & FITTINGS SHALL BE INSTALLED ABSOLUTELY RUST-FREE.
15. AUTOMATIC SPRINKLER TEMPERATURE RATINGS OF FUSIBLE ELEMENTS TO BE IN ACCORDANCE WITH NFPA 13.
16. ALL VALVES FOR FIRE SERVICE SHALL BE LISTED BY THE UNDERWRITER'S LABORATORIES, INC. AND THE FACTORY MUTUAL LABORATORIES. VALVES SHALL BE FACTORY MARKED "UL" OR "FM", AND RATED FOR 175 WORKING PRESSURE.
17. ELECTRICALLY SUPERVISED VALVES SHALL BE PROVIDED WHERE REQUIRED IN NFPA 13. TYPE AND EXACT LOCATION AND PURCHASE/INSTALLATION OF FLOW AND SUPERVISORY SWITCHES SHALL BE BY THE SPRINKLER CONTRACTOR. ELECTRICAL CONTRACTOR TO PROVIDE ADDITIONAL CIRCUITS, WIRING, SWITCHES, CONDUIT OR JUNCTION BOXES REQUIRED.
18. SPRINKLER COVERAGE SHALL COMPLY WITH NFPA 13. SPRINKLER LOCATIONS WITH RESPECT TO OBSTRUCTIONS SHALL COMPLY WITH NFPA 13-2022, CHAPTER 9, OR THE APPROPRIATE CHAPTER BASED ON SPRINKLER TYPE.
19. IMMEDIATELY NOTIFY THE ARCHITECT/ENGINEER OF ANY DISCREPANCIES FOUND BETWEEN THESE PLANS, OTHER ENGINEERING PLANS, THE ARCHITECTURAL PLANS AND/OR FIELD CONDITIONS PRIOR TO FINAL BID PRICE OR FINAL PERMITTING.
20. IN CASE OF DISPUTE OR DOUBT AS TO INTENT OF DRAWINGS OR SPECIFICATIONS, OBTAIN ARCHITECT/ENGINEER'S WRITTEN DECISION BEFORE PROCEEDING WITH BID OR WORK INVOLVED.
21. BEFORE SUBMITTING PROPOSAL OR BID, EXAMINE ALL DRAWINGS AND SPECIFICATIONS RELATING TO THIS PROJECT, THE AMOUNT OF SPACE AVAILABLE FOR PIPING, EQUIPMENT AND CONNECTING SERVICES, THE SCOPE OF SITE OF THE WORK, THE REQUIREMENTS TO CORRELATE THE FIRE PROTECTION WORK WITH THAT OF OTHER TRADES AND THE TIME SCHEDULE NECESSARY TO PERFORM THAT WORK.
22. PIPE SHALL BE REAMED AND CLEANED BEFORE ASSEMBLY, AND AFTER ASSEMBLY THE ENTIRE PIPING SYSTEM SHALL BE FLUSHED CLEAN.
23. ADJUST NEW SPRINKLER PIPING AND SPRINKLER HEAD PLACEMENT TO ACCOMMODATE EXISTING CEILING HEIGHTS AND STRUCTURAL CONFIGURATIONS.
24. PROVIDE SPRINKLERS ABOVE AND BELOW EXPOSED DUCTWORK 4 FEET OR WIDER.
25. PROVIDE HAZARD COVERAGE FOR THE FUNCTIONS FOR EACH AREA.
26. INDICATE THE LOCATION AND SIZE OF BLIND SPACES AND CLOSETS.
27. INDICATE THE TOTAL SQUARE FOOT AREA PROTECTED BY SYSTEM(S).
28. INDICATE THE NUMBER OF SPRINKLERS ON EACH RISER.
29. ALL PENDENT SPRINKLERS SHALL BE CENTER OF TILE, UNLESS MAXIMUM DISTANCES FROM WALLS OR BETWEEN HEADS IS EXCEEDED OR UNLESS SHOWN DIFFERENTLY ON DRAWINGS. IF NOT POSSIBLE ALL SPRINKLER HEADS MOUNTED IN CEILING SHALL BE LOCATED A MINIMUM OF 4" AWAY FROM ANY WALLS, CEILING GRID MEMBERS, CEILING HEIGHT CHANGES OR ANY OTHER VERTICAL INTERSECTING STRUCTURAL SURFACE.
30. FIRE PROTECTION CONTRACTOR SHALL ASSIST IN PREPARATION OF COORDINATION DRAWINGS FOR ALL LEVELS WHICH INDICATE ALL THE ENGINEERING DISCIPLINES & FIRE PROTECTION PIPING. THESE DRAWINGS SHALL BE PREPARED & APPROVED BY THE ENGINEER OF RECORD PRIOR TO ANY INSTALLATION.
31. FIRE SPRINKLER PIPING SHALL NOT TRAVEL OVER THE TOPS OF ELECTRICAL PANELBOARDS.
32. PROVIDE TEFLON COATING FOR ALL SPRINKLERS IN ANY CORROSIVE AREA.
33. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING HEIGHTS IN EACH AREA.
34. ALL EXPOSED PIPING SHALL BE SHALL BE PAINTED RED.
35. ALL MATERIALS, WHERE APPLICABLE, SHALL BE U.L. LISTED OR FACTORY MUTUAL APPROVED FOR USE IN AUTOMATIC SPRINKLER SYSTEMS. ALL NEW PIPING SHALL BE HYDROSTATICALLY TESTED FOR TWO HOURS IN ACCORDANCE WITH NFPA 13. MINIMUM HYDROSTATIC TEST PRESSURE SHALL BE 200 PSI.
36. FLEXIBLE SPRINKLER CONNECTIONS SHALL ONLY BE PERMITTED UPON VA APPROVAL. IF FLEXIBLE SPRINKLER CONNECTIONS ARE PERMITTED AND USED, HYDRAULIC CALCULATIONS MUST BE PERFORMED AND SUBMITTED TO THE ENGINEER OF RECORD.
37. THE SMALL ROOM RULE SHALL BE ACCEPTABLE FOR PLACEMENT OF SPRINKLERS PER NFPA 13-2022, 10.2.5.2.3.
38. UPON SPRINKLER SYSTEM IMPAIRMENT, NFPA 25-2023, 15.5.2 SHALL BE FOLLOWED DURING SPRINKLER SYSTEM DOWNTIME. APPROVED PERSONNEL SHALL COORDINATE REQUIREMENTS PER NFPA 25, SUCH AS AN APPROVED FIRE WATCH IF REQUIRED. IMPAIRMENT PROCEDURES REQUIRED TO BE TAKEN SHALL BE INCLUDED IN CONTRACTOR'S BUDGET.

SHEET LIST

Revisions: Date:

CONSULTANT
Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD
THINKFORM
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP
COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
FIRE PROTECTION LEGENDS & SYMBOLS	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number: 1
		Issue Date: 06 MARCH 2026 / Checked: CNB / Drawn: CSC	Drawing Number: FP001

DRAWING NOTES:

1. EXISTING CONDITIONS SHOWN ARE BASED ON LIMITED RECORD DRAWINGS AND SITE EXPLORATION. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AND NOTIFY THE COR IN WRITING WITH ANY DEVIATIONS.

CODED NOTES:

1 UPON SPRINKLER SYSTEM IMPAIRMENT, NFPA 25-2020, 15.5.2 SHALL BE FOLLOWED DURING SPRINKLER SYSTEM DOWNTIME. APPROVED PERSONNEL SHALL COORDINATE REQUIREMENTS WITH COR, PER NFPA 25, SUCH AS AN APPROVED FIRE WATCH IF REQUIRED.

KEY	HAZARD CLASSIFICATION
(cross-hatched)	LIGHT HAZARD
(blank)	N/A

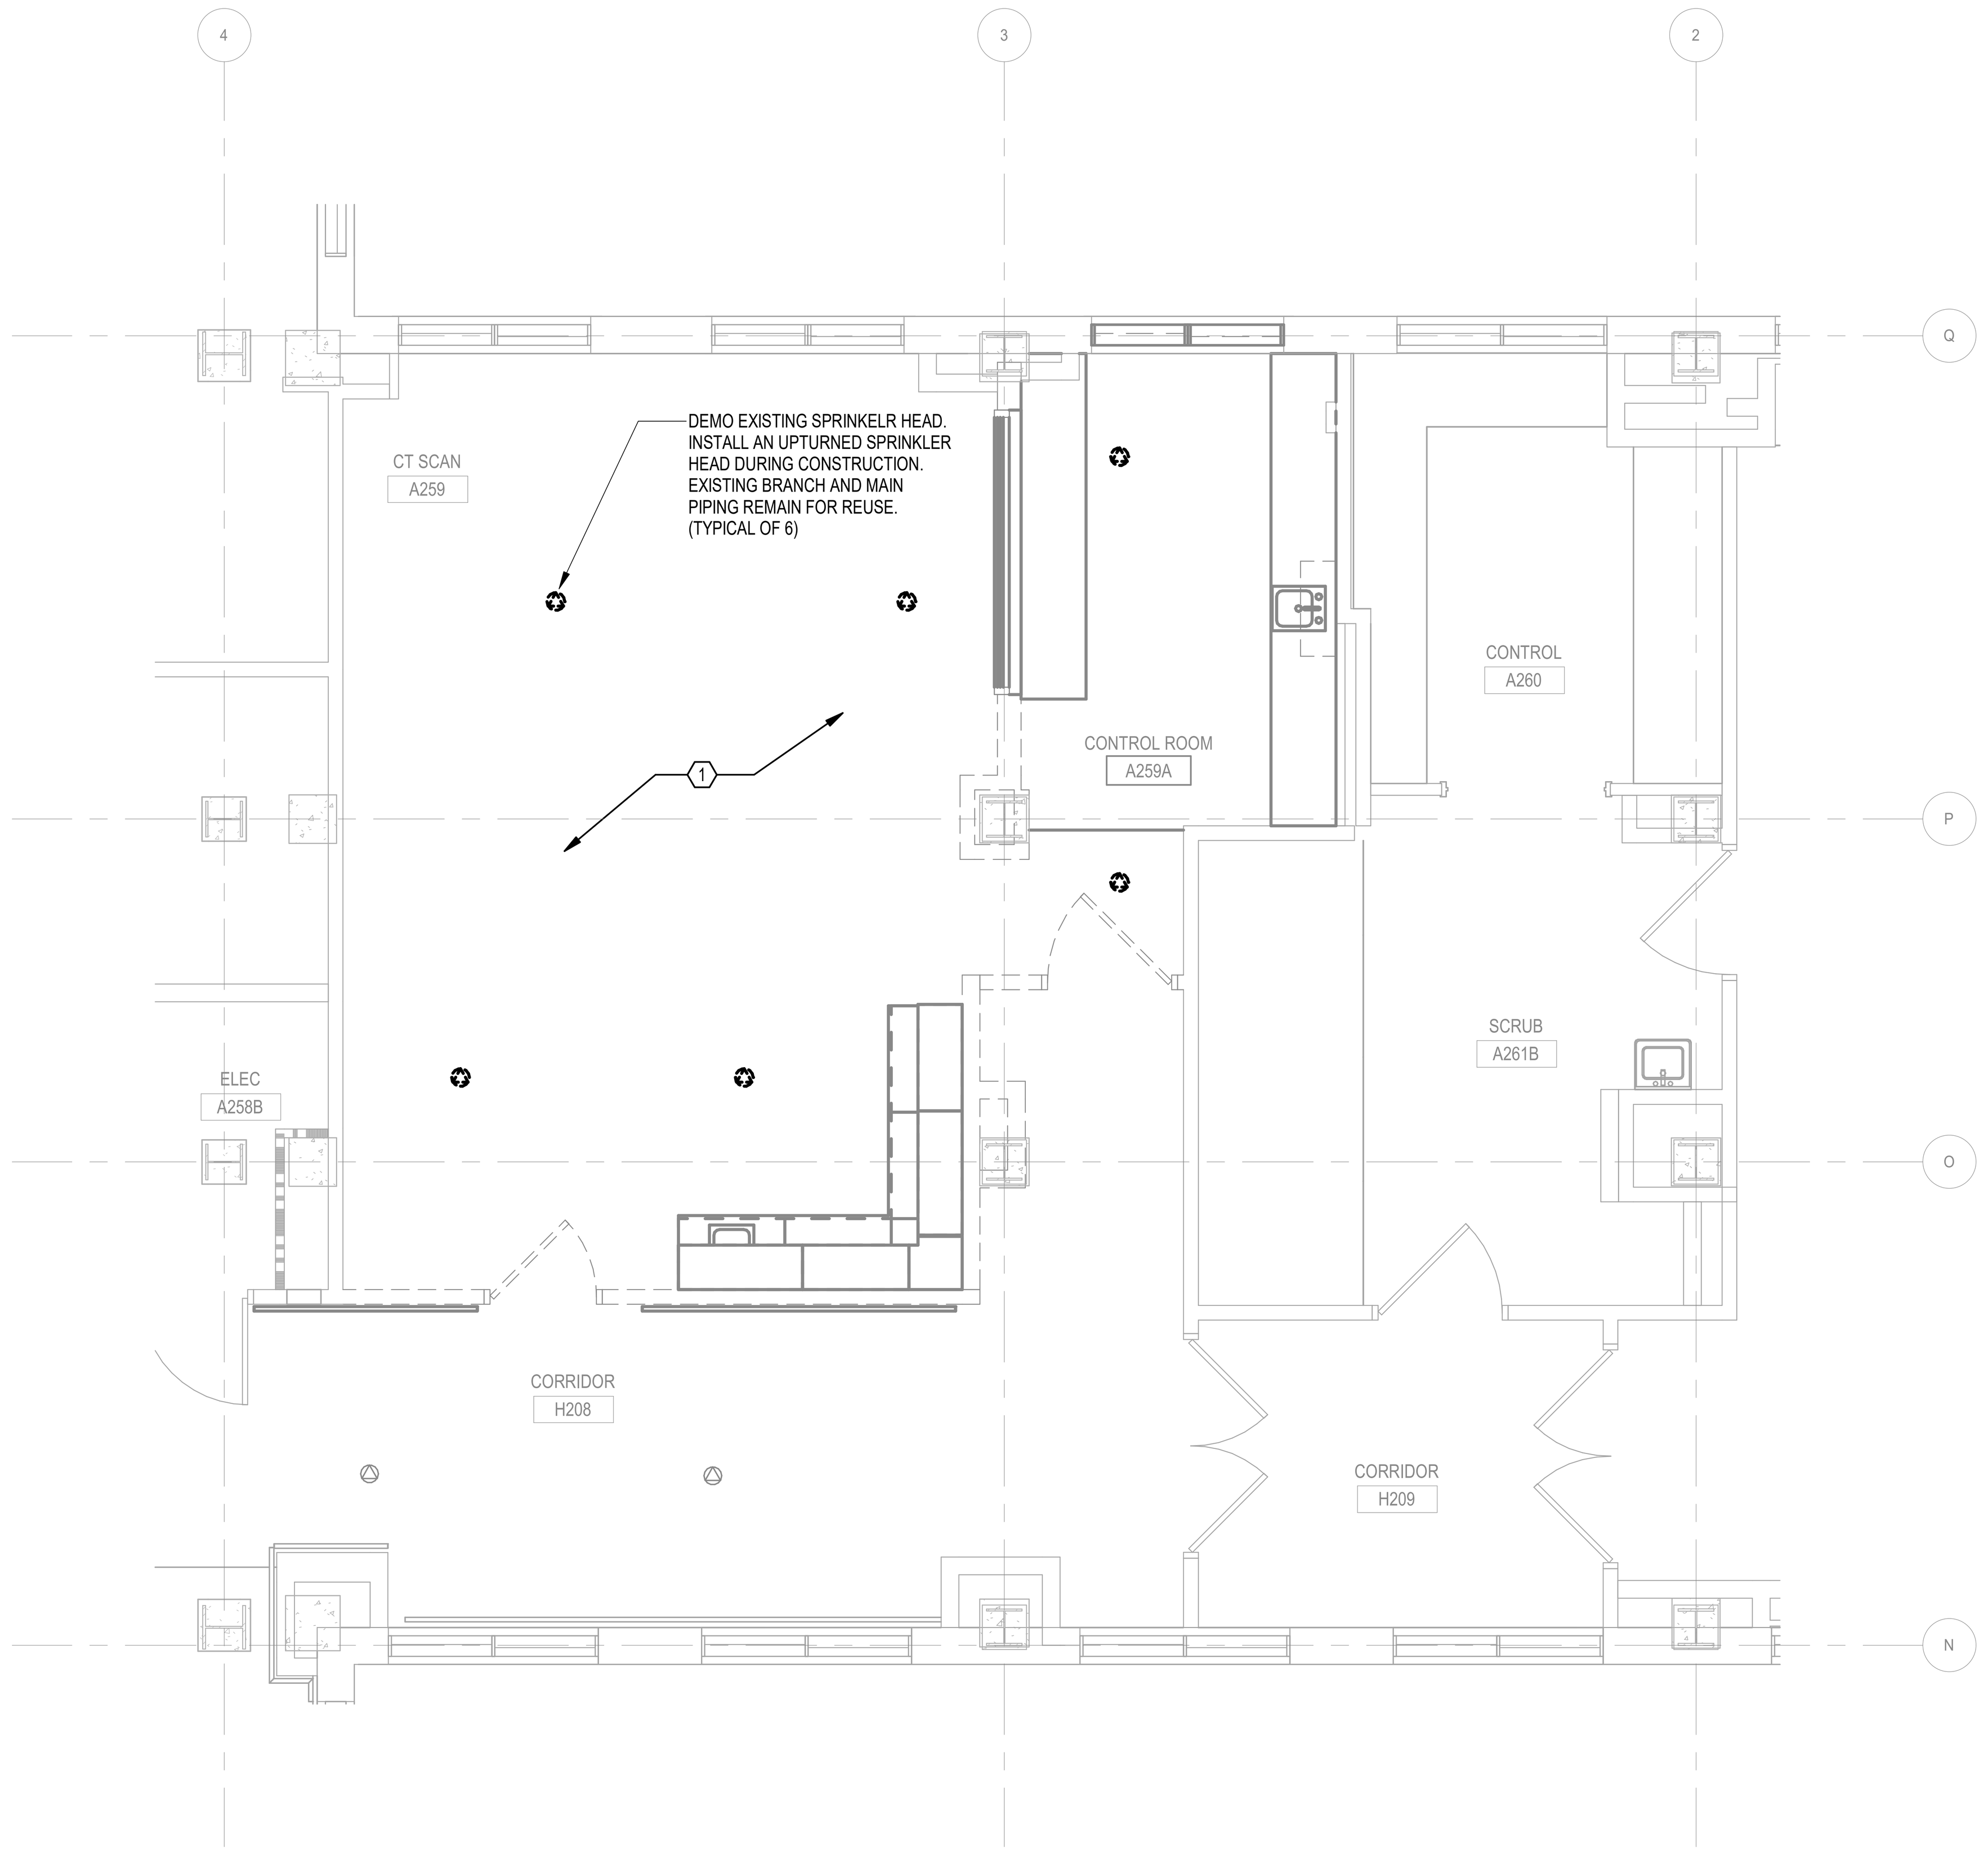

1 SECOND FLOOR PLAN - FIRE PROTECTION - DEMOLITION
1/4" = 1'-0"

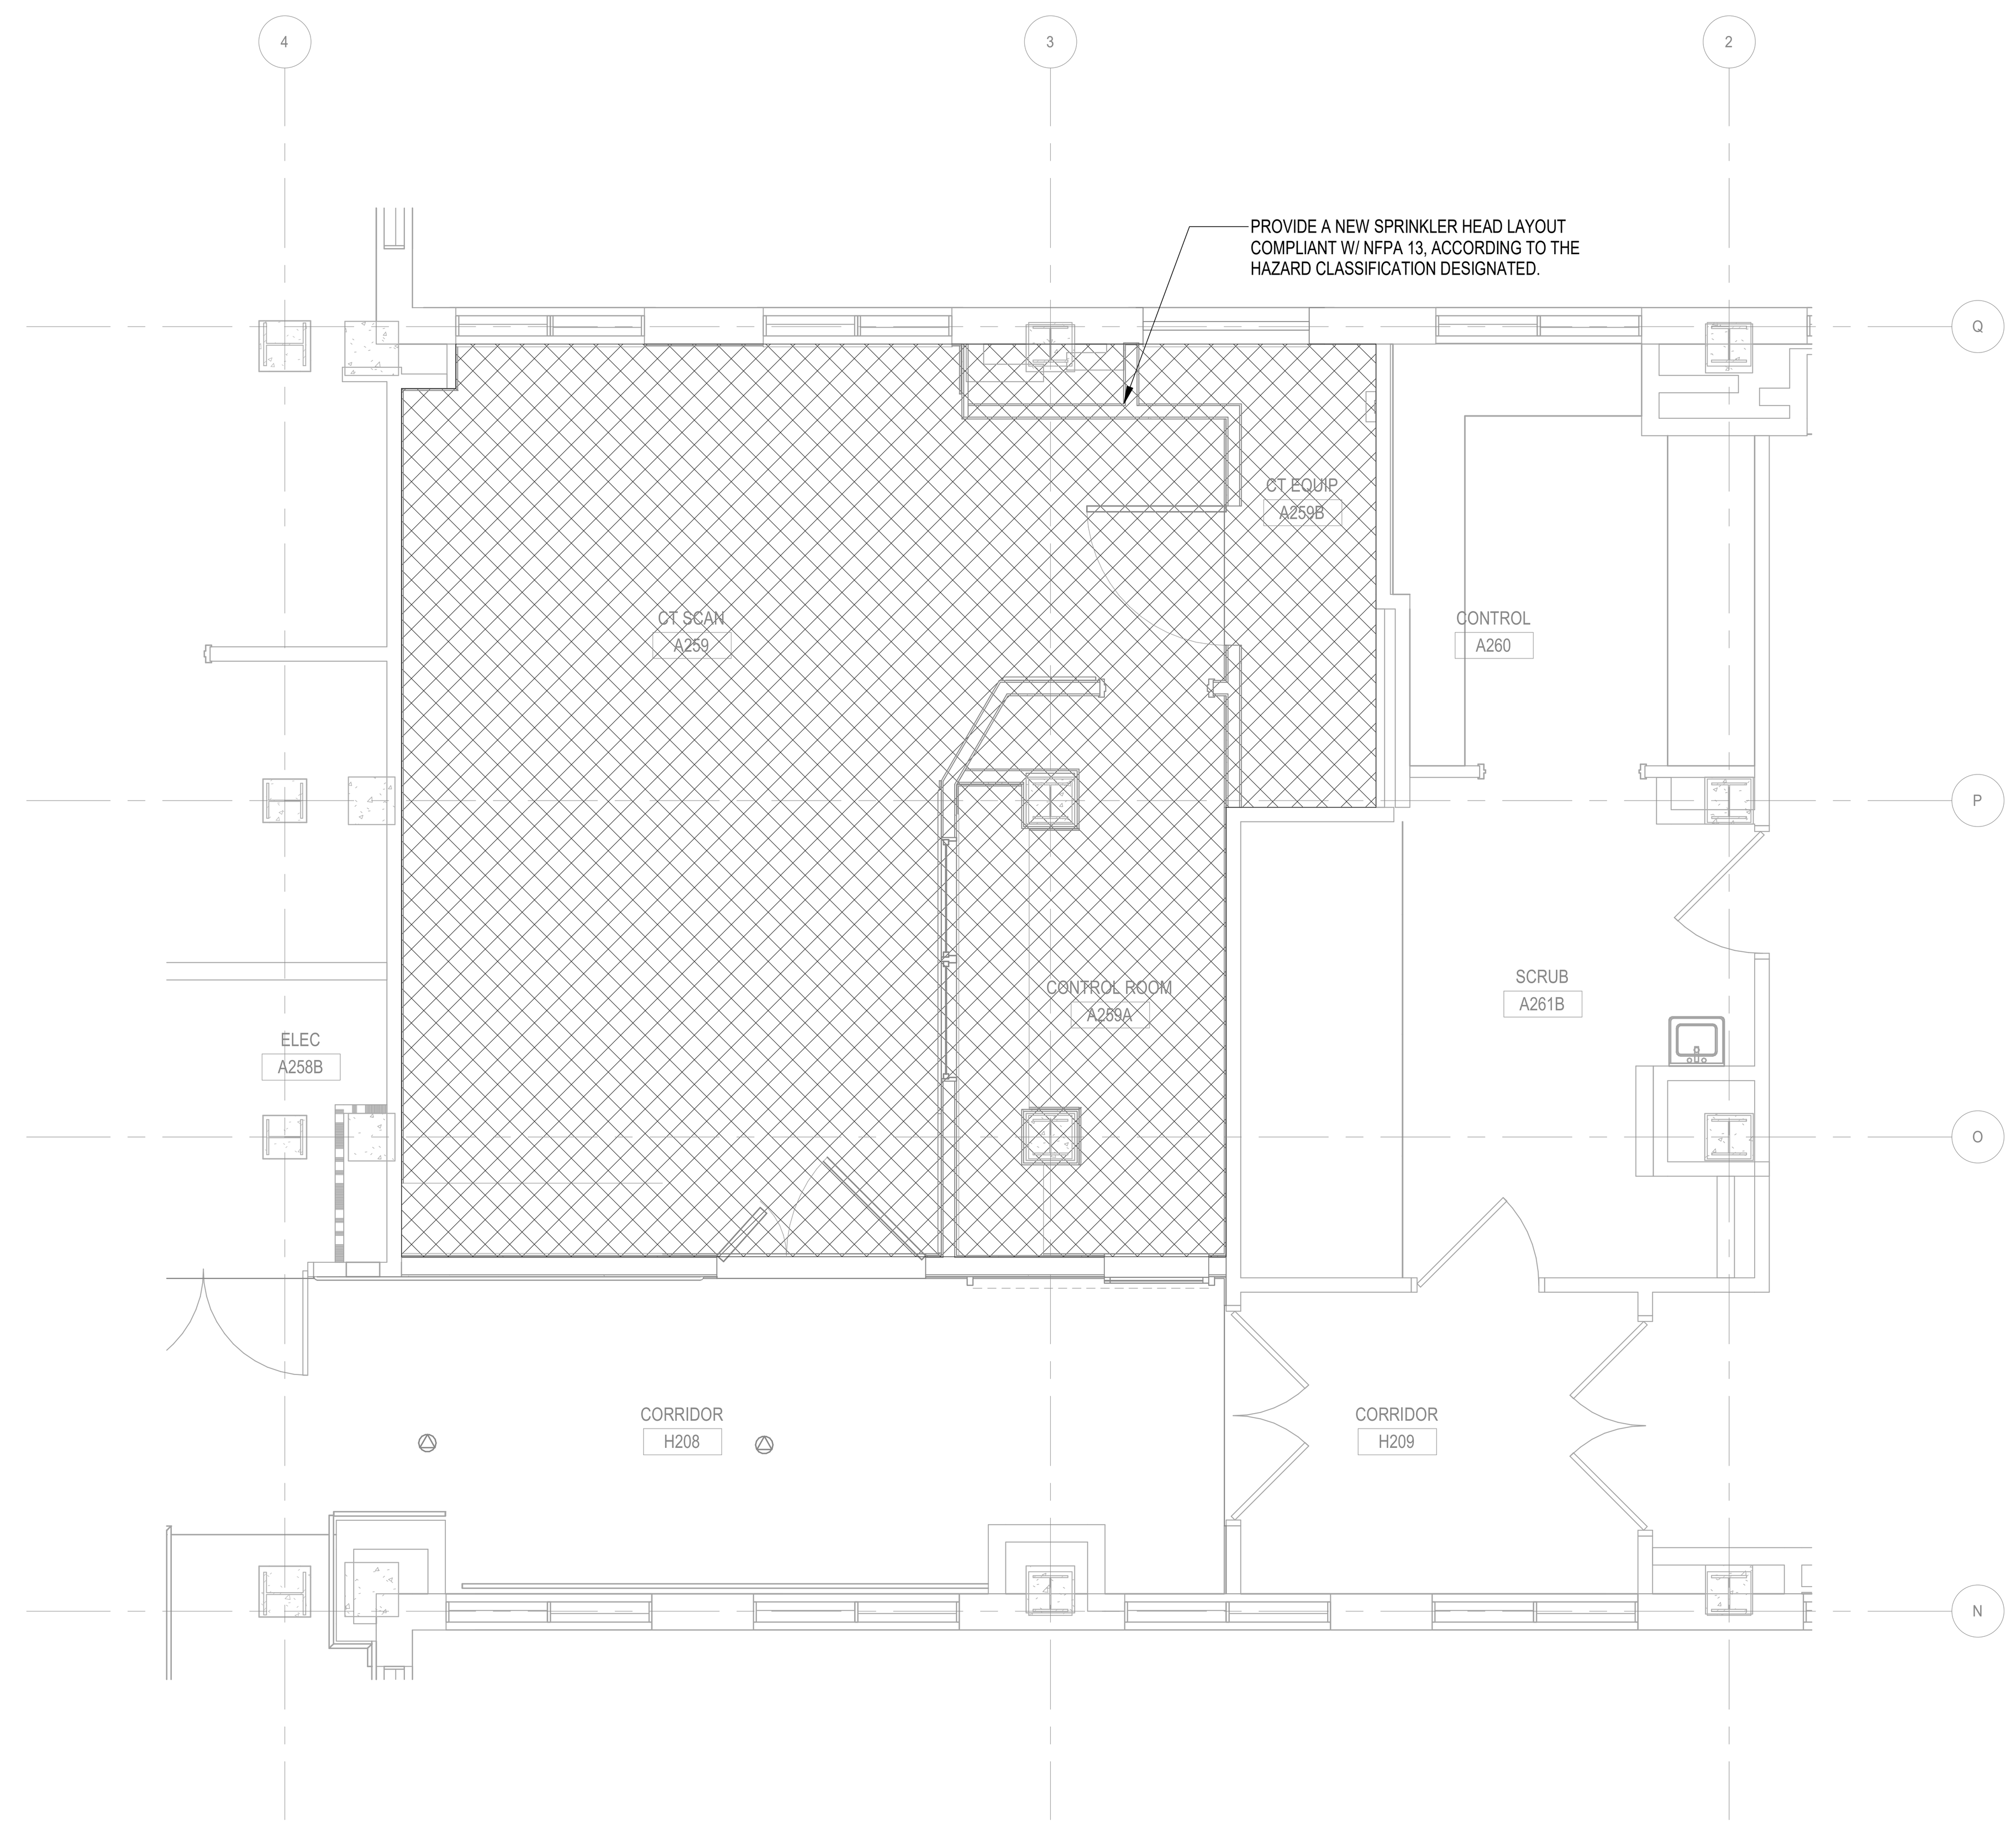

2 SECOND FLOOR PLAN - FIRE PROTECTION - NEW WORK
1/4" = 1'-0"

KEY PLAN

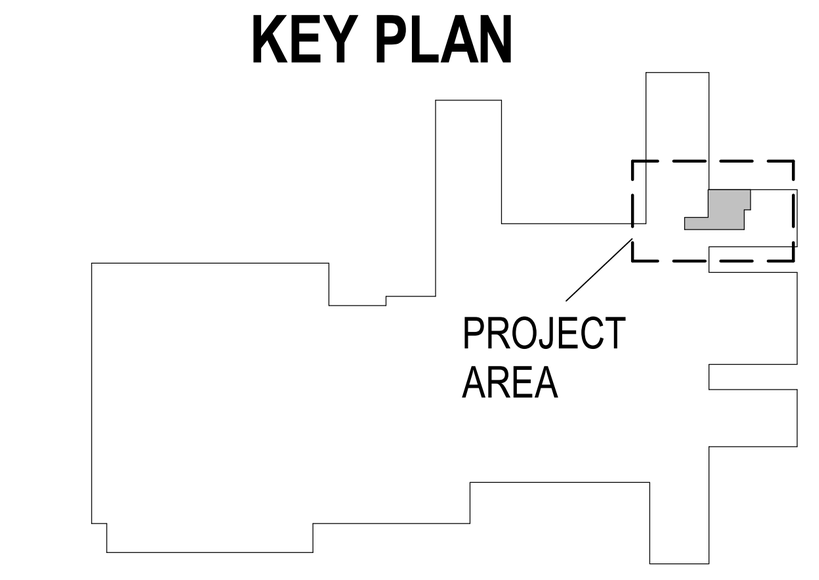

0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions: / Date:	CONSULTANT: Above Group — ENGINEERING. DESIGN. CONSULTING. 305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com; www.abovegroupinc.com COA/CA Lic. No. 31120; 305 East Dr., Suite H, Melbourne, Florida 32904 PH: 321.345.9026	ARCHITECT/ENGINEER OF RECORD: THINKFORM architects — THINKFORM DESIGN ARCHITECT LLC, 38 EAST BROAD STREET, HOPEWELL, NJ 08525, T:855.821.0274 F:609.644.4397, Russell DiNardo, AIA NY 031521-1	STAMP: COMMONWEALTH OF PENNSYLVANIA, REGISTERED PROFESSIONAL ENGINEER, ALLEN LANTZ III, PE091315	Office of Construction and Facilities Management; VA U.S. Department of Veterans Affairs	Drawing Title: SECOND FLOOR - FIRE PROTECTION PLAN - ROOM A259; Approved:	Phase: 100% CONTRACT DOCUMENTS FOR BIDDING; FULLY SPRINKLERED	Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259; Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106; Issue Date: 06 MARCH 2026; Checked: CNB; Drawn: CSC

Project Number	Building Number	Drawing Number
657-23-104JC	1	FP101

VA FORM 08 - 6231

PLUMBING SYMBOL LEGEND

SYMBOL	DESCRIPTION
	NEW PIPING
	EXISTING PIPING
	DEMOLISHED PIPING
G	NATURAL GAS PIPING
CA	COMPRESSED AIR PIPING
CW	COLD WATER PIPING
HW	110° HOT WATER PIPING
HWR	HOT WATER RETURN PIPING
S U/G	SANITARY DRAINAGE PIPING (UNDERGROUND)
SAN	SANITARY DRAINAGE PIPING (ABOVE SLAB)
STO	STORM OVERFLOW (SECONDARY)
ST	STORM (PRIMARY)
ST U/G	STORM PIPING (UNDERGROUND)
V	VENT PIPING
CD	CONDENSATE PIPING
OR	CLEANOUTS
	PIPE END CAP
	PIPE TURNING DOWN
	PIPE TURNING UP
	PIPE TURNING DOWN (TEE)
	PIPING TEE
	ROLL DOWN
	P-TRAP
	FLOW ARROW
HB-1 OR WHY-1	HOSE BIBB / WALL HYDRANT
	PRESSURE GAUGE
	CIRCULATING PUMP
	BALL VALVE
	CALIBRATING BALANCING VALVE
	BUTTERFLY VALVE
	UNION
	STRAINER
	CONTROL VALVE
	PSI REG.
	PSI REG.
	CHECK VALVE
	FLOW SWITCH
	FLEX CONNECTION
	THREE-WAY CONTROL VALVE
	THERMOMETER
	RELIEF VALVE
	VALVE ON RISER
	TEST PLUG
	FLOW SWITCH
	PRESSURE SWITCH
	GLOBE VALVE
	AUTOMATIC AIR VENT

SYMBOL	DESCRIPTION
A / 1	PLUMBING RISER DESIGNATION: A = RISER IDENTIFYING SYSTEM TYPE 1 = RISER IDENTIFYING SYSTEM NUMBER
A / B SIM	SECTION SYMBOL: A = IDENTIFYING LETTER B = SHEET WHERE SECTION IS SHOWN SIM = SIMILAR (ONLY NOTED IF IT APPLIES)
A	TITLE SYMBOL ON SHEET WHERE SHOWN A = IDENTIFYING NUMBER/LETTER
1	REVISION CLOUD AND REVISION NUMBER
1	SHEET NOTE CALLOUT
	DEMOLISH TO POINT INDICATED
	CONNECT TO EXISTING
PDI-"A"	WATER HAMMER ARRESTOR & SIZE
	GATE VALVE
	BALL VALVE
	CIRCUIT SETTER VALVE
	CHECK VALVE
	THERMOSTATIC MIXING VALVE
	PRESSURE REGULATING VALVE
	BUTTERFLY VALVE

WATER HAMMER ARRESTOR

SYMBOL	PIPE SIZE	PDI STANDARD	FIXTURE UNIT CAP.
	1/2"	A	1 TO 11
	3/4"	B	12 TO 32
	1"	C	33 TO 60
	1-1/4"	D	61 TO 113

NOTE: SOME SYMBOLS SHOWN ON THIS LEGEND MAY NOT PERTAIN TO THIS PROJECT

PLUMBING ABBREVIATIONS

ABBR.	DESCRIPTION
AS	ABOVE SLAB
ADA	AMERICANS WITH DISABILITIES ACT
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
AP	ACCESS PANEL
ASTM	AMERICAN STANDARDS TESTING MATERIALS
AWWA	AMERICAN WATER WORKS ASSOCIATION
BFP	BACKFLOW PREVENTER
BS	BELOW SLAB
BF	BELOW FLOOR
BG	BELOW GRADE
CA	COMPRESSED AIR
CD	CONDENSATE
CO	CLEANOUT
CONN	CONNECTION
CONT	CONTINUOUS
CP	CIRCULATING PUMP
CW	COLD WATER
DF	DRINKING FOUNTAIN
DFU	DRAINAGE FIXTURE UNITS
DIA	DIAMETER
DN	DOWN
DWG	DRAWING
DW	DOMESTIC WATER
ECO	EXTERIOR CLEANOUT
ELEV	ELEVATION
EQUIP	EQUIPMENT
EWC	ELECTRIC WATER COOLER
EWH	ELECTRIC WATER HEATER
EXIST	EXISTING
ºF	DEGREES FAHRENHEIT
FCO	FLOOR CLEANOUT
FD	FLOOR DRAIN
FIN	FINISH
FL	FLOOR
FPS	FEET PER SECOND
FT	FEET
FU	FIXTURE UNITS
G	NATURAL GAS
GAL	GALLON(S)
GPM	GALLONS PER MINUTE
GR	GREASE WASTE
HB	HOSE BIBB
HP	HORSEPOWER
HR	HOUR
HW	HOT WATER
HWR	HOT WATER RETURN
HZ	HERTZ
IE	INVERT ELEVATION
ID	INTERNAL DIAMETER
IN	INCHES
IPS	INTERNATIONAL PIPE STANDARD
IRR	IRRIGATION WATER
KW	KILOWATT

ABBR.	DESCRIPTION
LAV	LAVATORY
LF	LINEAR FEET
MAX	MAXIMUM
MIN	MINIMUM
MNTG	MOUNTING
MS	MOP SINK
NA	NOT APPLICABLE
NC	NORMALLY CLOSED
NIC	NOT IN CONTRACT
NO	NORMALLY OPEN
NSF	NATIONAL SANITATION FOUNDATION
NTS	NOT TO SCALE
OD	OUTSIDE DIAMETER
ORWL	OVERFLOW RAIN WATER LEADER
PDI	PLUMBING DRAINAGE INSTITUTE
PH	PHASE
PPP	PRECISION PLUMBING PRODUCTS
PSI	POUNDS PER SQUARE INCH
RD	ROOF DRAIN
RPM	REVOLUTIONS PER MINUTE
RWL	RAIN WATER LEADER
S	SANITARY
SAN	SANITARY
SH	SHOWER
SK	SINK
SL	SODA LINE
SPEC	SPECIFICATION
SQ	SQUARE
SS	STAINLESS STEEL
STD	STANDARD
ST	STORM
TDH	TOTAL DYNAMIC HEAD
TEMP	TEMPERATURE
TET	THERMAL EXPANSION TANK
TMV	THERMOSTATIC MIXING VALVE
TP	TRAP PRIMER
TYP	TYPICAL
UL	UNDERWRITER'S LABORATORY
U/G	UNDERGROUND
UNO	UNLESS NOTED OTHERWISE
UR	URINAL
UF	UNDERFLOOR
V	VENT
VTR	VENT THROUGH ROOF
VIV	VALVE IN VERTICAL
VLV	VALVE
VOL	VOLUME
W	WATTS
W/	WITH
WC	WATER CLOSET
WCO	WALL CLEANOUT
WHA	WATER HAMMER ARRESTOR
WHY	WALL HYDRANT
WFU	WATER SUPPLY FIXTURE UNITS

SHEET LIST

SHEET NUMBER	SHEET NAME
P-001	PLUMBING NOTES, LEGENDS, & SYMBOLS
PD101	FIRST AND SECOND FLOOR PLAN - DWV PIPING DEMOLITION
PS101	FIRST AND SECOND FLOOR PLAN - DWV PIPING NEW WORK
PP101	SECOND FLOOR PLAN - PRESSURE PIPING - ROOM A259
PG101	SECOND FLOOR PLAN - MED GAS - ROOM A259
P-501	PLUMBING DETAILS
P-801	PLUMBING SCHEDULES

PLUMBING GENERAL NOTES

1. DRAWINGS ARE DIAGRAMMATIC AND INDICATE GENERAL ARRANGEMENT OF SYSTEMS. PROVIDE COMPONENTS INDICATED IN DETAILS AND/OR RISER DIAGRAMS WHETHER OR NOT INDICATED ON PLANS AND VICE VERSA. WHERE A DISCREPANCY OR CONFLICT IS FOUND BETWEEN ONE DRAWING AND ANOTHER, OR BETWEEN A DRAWING AND APPLICABLE SPECIFICATIONS, NOTIFY THE ARCHITECT/ENGINEER IMMEDIATELY IN WRITTEN FORM. IN GENERAL, THE MOST STRINGENT REQUIREMENT SHALL GOVERN UNLESS THE DISCREPANCY CONFLICTS WITH APPLICABLE CODES OR OWNER'S DESIGN STANDARDS, WHEREIN THE CODE OR OWNER'S DESIGN STANDARDS SHALL GOVERN.
2. LOCATE VALVES IN ACCESSIBLE AREAS WHERE NECESSARY. (12"X12" MIN.)
3. COORDINATE ACTUAL LOCATIONS OF MECHANICAL FLOOR DRAINS WITH FINAL EQUIPMENT LOCATIONS ON SHOP DRAWINGS.
4. VENT PIPING SHOWN IS ONLY FOR DIAGRAMMATIC PURPOSES. COORDINATE VTRS WITH HVAC AIR INTAKES.
5. PROVIDE BACKWATER VALVES FOR CONDENSATE PIPING CONNECTIONS TO STORM SEWER.
6. ROUTE WATER HEATER T&P VALVE PIPING TO BUILDING EXTERIOR WHERE POSSIBLE. ALTERNATE DISCHARGE LOCATIONS WILL BE MOP SINKS OR ADJACENT FLOOR DRAINS ONLY.
7. PROVIDE PIPE MARKER FOR ALL PIPING ABOVE THE CEILING SPACES IN ACCORDANCE WITH DIVISION 22 SPECIFICATION SECTION. "IDENTIFICATION FOR PLUMBING PIPING AND EQUIPMENT".
8. LABEL VALVES ABOVE CEILINGS AND IN CONCEALED SPACES AT CEILING TILE WITH METAL CEILING TACKS INDICATING VALVE # AND TYPE OF WATER. (i.e.; BLUE= COLD WATER, LETTERING CW VLV1-001).
9. PROVIDE AND INSTALL WATER WATER HAMMER ARRESTORS IN ACCORDANCE WITH PDI-WH201 IN ALL HW AND CW SUPPLY PIPING WITH QUICK CLOSING VALVES AS REQUIRED. AIR CHAMBERS ARE NOT ACCEPTABLE SUBSTITUTIONS.
10. PROVIDE THERMAL INSULATION FOR HOT WATER AND HOT WATER RETURN PIPING IN ACCORDANCE WITH THE ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION AND PER SPECIFICATIONS.
11. PROVIDE CLEANOUTS AT THE BASE OF EACH SANITARY STACK. SIZE CLEANOUTS TO MATCH THE PIPING SERVED. SPACE FLOOR CLEANOUTS AT 100'-0" MAX. ALSO PROVIDE CLEANOUTS IN HORIZONTAL CHANGE OF DIRECTION > 45°.
12. THE MANUFACTURERS OF EQUIPMENT SHOWN ARE THE BASIS OF DESIGN. SEE SPECIFICATION FOR OTHER ACCEPTABLE MANUFACTURER'S.
13. FIRE CAULK AND SLEEVE PENETRATIONS THROUGH FIRE RATED ASSEMBLIES. REFER TO LIFE SAFETY PLANS FOR RATED ASSEMBLY LOCATIONS. REFER TO ARCHITECTURAL SHEETS FOR DETAILS AND UL ASSEMBLY NUMBERS.
14. REFER TO ARCHITECTURAL SHEETS FOR FIXTURE MOUNTING.
15. COORDINATE UNDERGROUND PIPING INVERT ELEVATIONS WITH STRUCTURAL FOOTING ELEVATIONS AND CIVIL INVERT CONNECTIONS PRIOR TO ANY UNDERGROUND PIPING INSTALLATIONS. IF FOOTINGS ARE IN CONFLICT AND WHERE A PIPING ROLL DOWN IS NOT POSSIBLE, COORDINATE WITH GENERAL CONTRACTOR FOR DROPS IN FOOTING AS REQUIRED.
16. COORDINATE CEILING PIPING AND ELEVATIONS IN SHOP DRAWINGS WITH ALL OTHER TRADES (I.E. HVAC, FIRE PROTECTION, ELECTRICAL, TELECOMM, STRUCTURAL, ETC.) PRIOR TO ANY INSTALLATION TO ENSURE PROPER CLEARANCES AND PENETRATIONS.
17. SLOPE SANITARY PIPING 2-1/2" OR LESS AT 1/4" PER FOOT. SLOPE SANITARY PIPING 3" AND LARGER AT 1/8" PER FOOT.
18. VALVES AND FITTINGS SHALL BE THE SAME SIZE AS THE PIPING WHERE THEY ARE LOCATED UNLESS NOTED OTHERWISE.
19. PROVIDE ALL NECESSARY SUPPORTING DEVICES FOR FIXTURES PER MANUFACTURER INSTALLATION INSTRUCTIONS.
20. PROVIDE ALL FLOOR DRAINS, FLOOR SINKS AND HUB DRAINS WITH DEEP SEAL P-TRAPS. ALL DRAINS NOT RECEIVING CONTINUOUS DISCHARGE SHALL BE PROVIDED WITH TRAP PRIMER CONNECTIONS TO ENSURE TRAP SEAL PROTECTION.
21. ROUGH-IN WASTE AND WATER SUPPLIES FOR FIXTURES AND PERFORM FINAL CONNECTIONS PER MANUFACTURER RECOMMENDATIONS.
22. THE CONTRACTOR SHALL BASE THEIR PROPOSAL UPON THE EQUIPMENT AS SCHEDULED USING THE MANUFACTURERS AND MODEL NUMBERS AS SCHEDULED ON THE DRAWINGS. IF THE CONTRACTOR WISHES TO USE EQUIPMENT NOT SCHEDULED, THEY MAY SUBMIT TO ENGINEER FOR REVIEW AND COMPLIANCE WITH CONTRACT DOCUMENTS.
23. ROUGH IN FLUSH VALVE WATER CLOSETS SO THAT THE FLUSH VALVE HANDLE IS TO THE WIDE SIDE OF THE ROOM.
24. COMPLY WITH THE AMERICANS WITH DISABILITIES ACT (ADA) ACCESSIBILITY GUIDELINES FOR BUILDINGS AND FACILITIES.
25. DISINFECT DOMESTIC WATER PIPING BY EITHER OF TWO WAYS: FILL SYSTEM WITH 50PPM CHLORINE SOLUTION AND STAND FOR 24 HOURS OR 200PPM CHLORINE SOLUTION AND STAND FOR 3 HOURS.
26. ALL AUTOMATIC CONTROL, PROTECTIVE OR SIGNAL DEVICES REQUIRED FOR THE OPERATION SPECIFIED, SHALL BE PROVIDED WITH ANY CONTROL WIRING AND INSTALLED PER MANUFACTURERS REQUIREMENTS.
27. ALL SANITARY AND VENT RISER SHALL BE SERVICE WEIGHT NO-HUB CAST IRON PIPE WITH SCHEDULE 40 PVC BRANCH PIPE. SANITARY PIPING BELOW GRADE SHALL BE SCHEDULE 40 SOLID CORE PVC PIPE ASTM 2665.
28. ALL HOT, COLD AND HOT WATER RETURN PIPE SHALL BE TYPE 'L' COPPER
29. PROVIDE AN AIR GAP, WHEN REQUIRED BY CODE, SERVING INDIVIDUAL FIXTURES, DEVICES, APPLIANCES AND APPARATUS.

APPLICABLE CODES

1. VA PLUMBING DESIGN MANUAL 2023 EDITION
2. INTERNATIONAL CODE COUNCIL:
   A. INTERNATIONAL BUILDING CODE (IBC) 2021 EDITION
   B. INTERNATIONAL PLUMBING CODE (IPC) 2021 EDITION
   C. INTERNATIONAL ENERGY CONSERVATION CODE (IECC) 2021 EDITION
3. NATIONAL FIRE PROTECTION ASSOCIATION (NFPA), INCLUDING (BUT NOT LIMITED TO):
   A. COMPRESSED GASES AND CRYOGENIC FLUIDS CODE, NFPA 55 2020 2016 EDITION
   B. NATIONAL ELECTRICAL CODE (NFPA 70 - NEC) 2023 EDITION
   C. HEALTH CARE FACILITIES CODE (NFPA 99) 2021 EDITION
   D. LIFE SAFETY CODE (NFPA 101) 2021 EDITION
4. VA SEISMIC DESIGN REQUIREMENTS 2019 EDITION
5. VA SUSTAINABLE DESIGN MANUAL 2017 EDITION
6. NATIONAL INSTITUTES OF HEALTH (NIH) DESIGN REQUIREMENTS MANUAL 2020 EDITION
7. OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA)
8. AMERICANS WITH DISABILITIES ACT (ADA)
9. AMERICAN SOCIETY OF TESTING AND MATERIALS (ASTM)
10. APPLICABLE REGULATORY REQUIREMENTS AND ADVISORY PRACTICES OF APPROPRIATE AUTHORITIES HAVING JURISDICTION (AHJs)
11. APPLICABLE STANDARDS, REGULATIONS, AND PRACTICES OF THE OWNER

Revisions: Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP
COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
PLUMBING NOTES, LEGENDS, & SYMBOLS	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number: 1
		Issue Date: 06 MARCH 2026 / Checked: CNB / Drawn: CSC	Drawing Number: P-001

DRAWING NOTES:

1. EXISTING CONDITIONS SHOWN ARE BASED ON LIMITED RECORD DRAWINGS AND SITE EXPLORATION. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AND NOTIFY THE COR IN WRITING ON ANY DEVIATIONS.

CODED NOTES:

1 REMOVE EXISTING SANITARY PIPING FROM SINK TO APPROXIMATE LOCATION SHOWN.

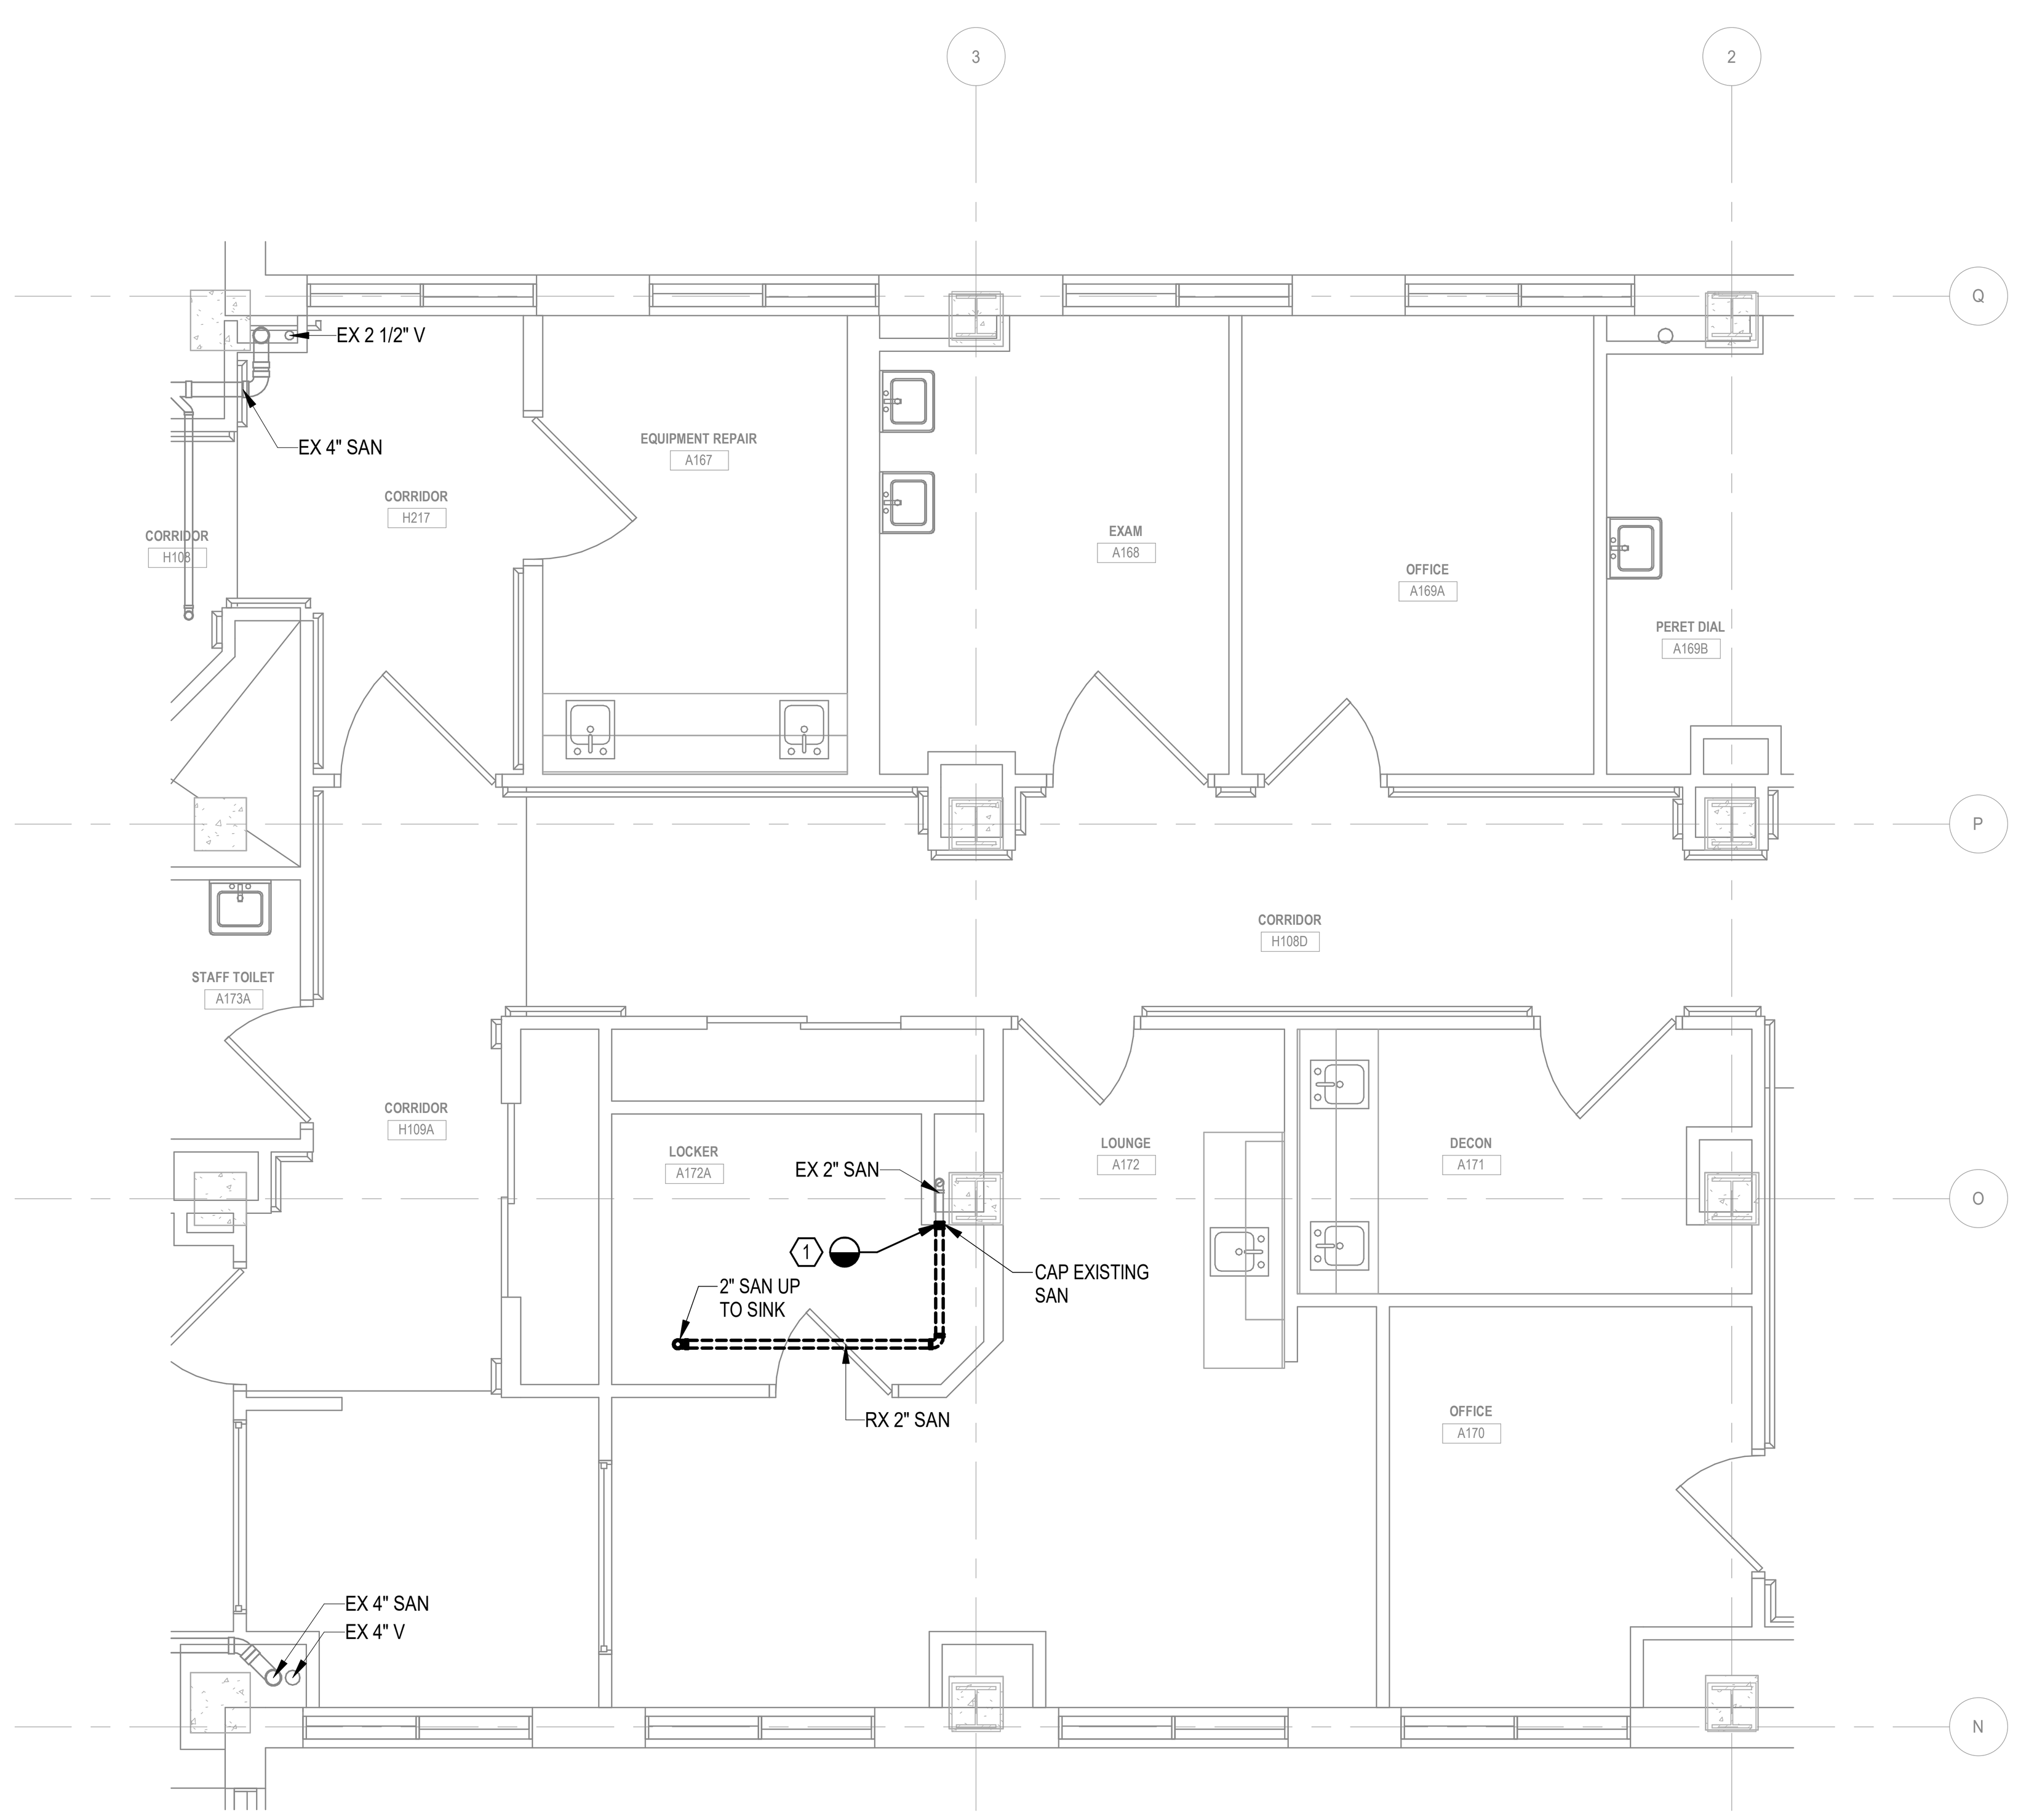

1 FIRST FLOOR PLAN - DWV PLUMBING - DEMOLITION
1/4" = 1'-0"

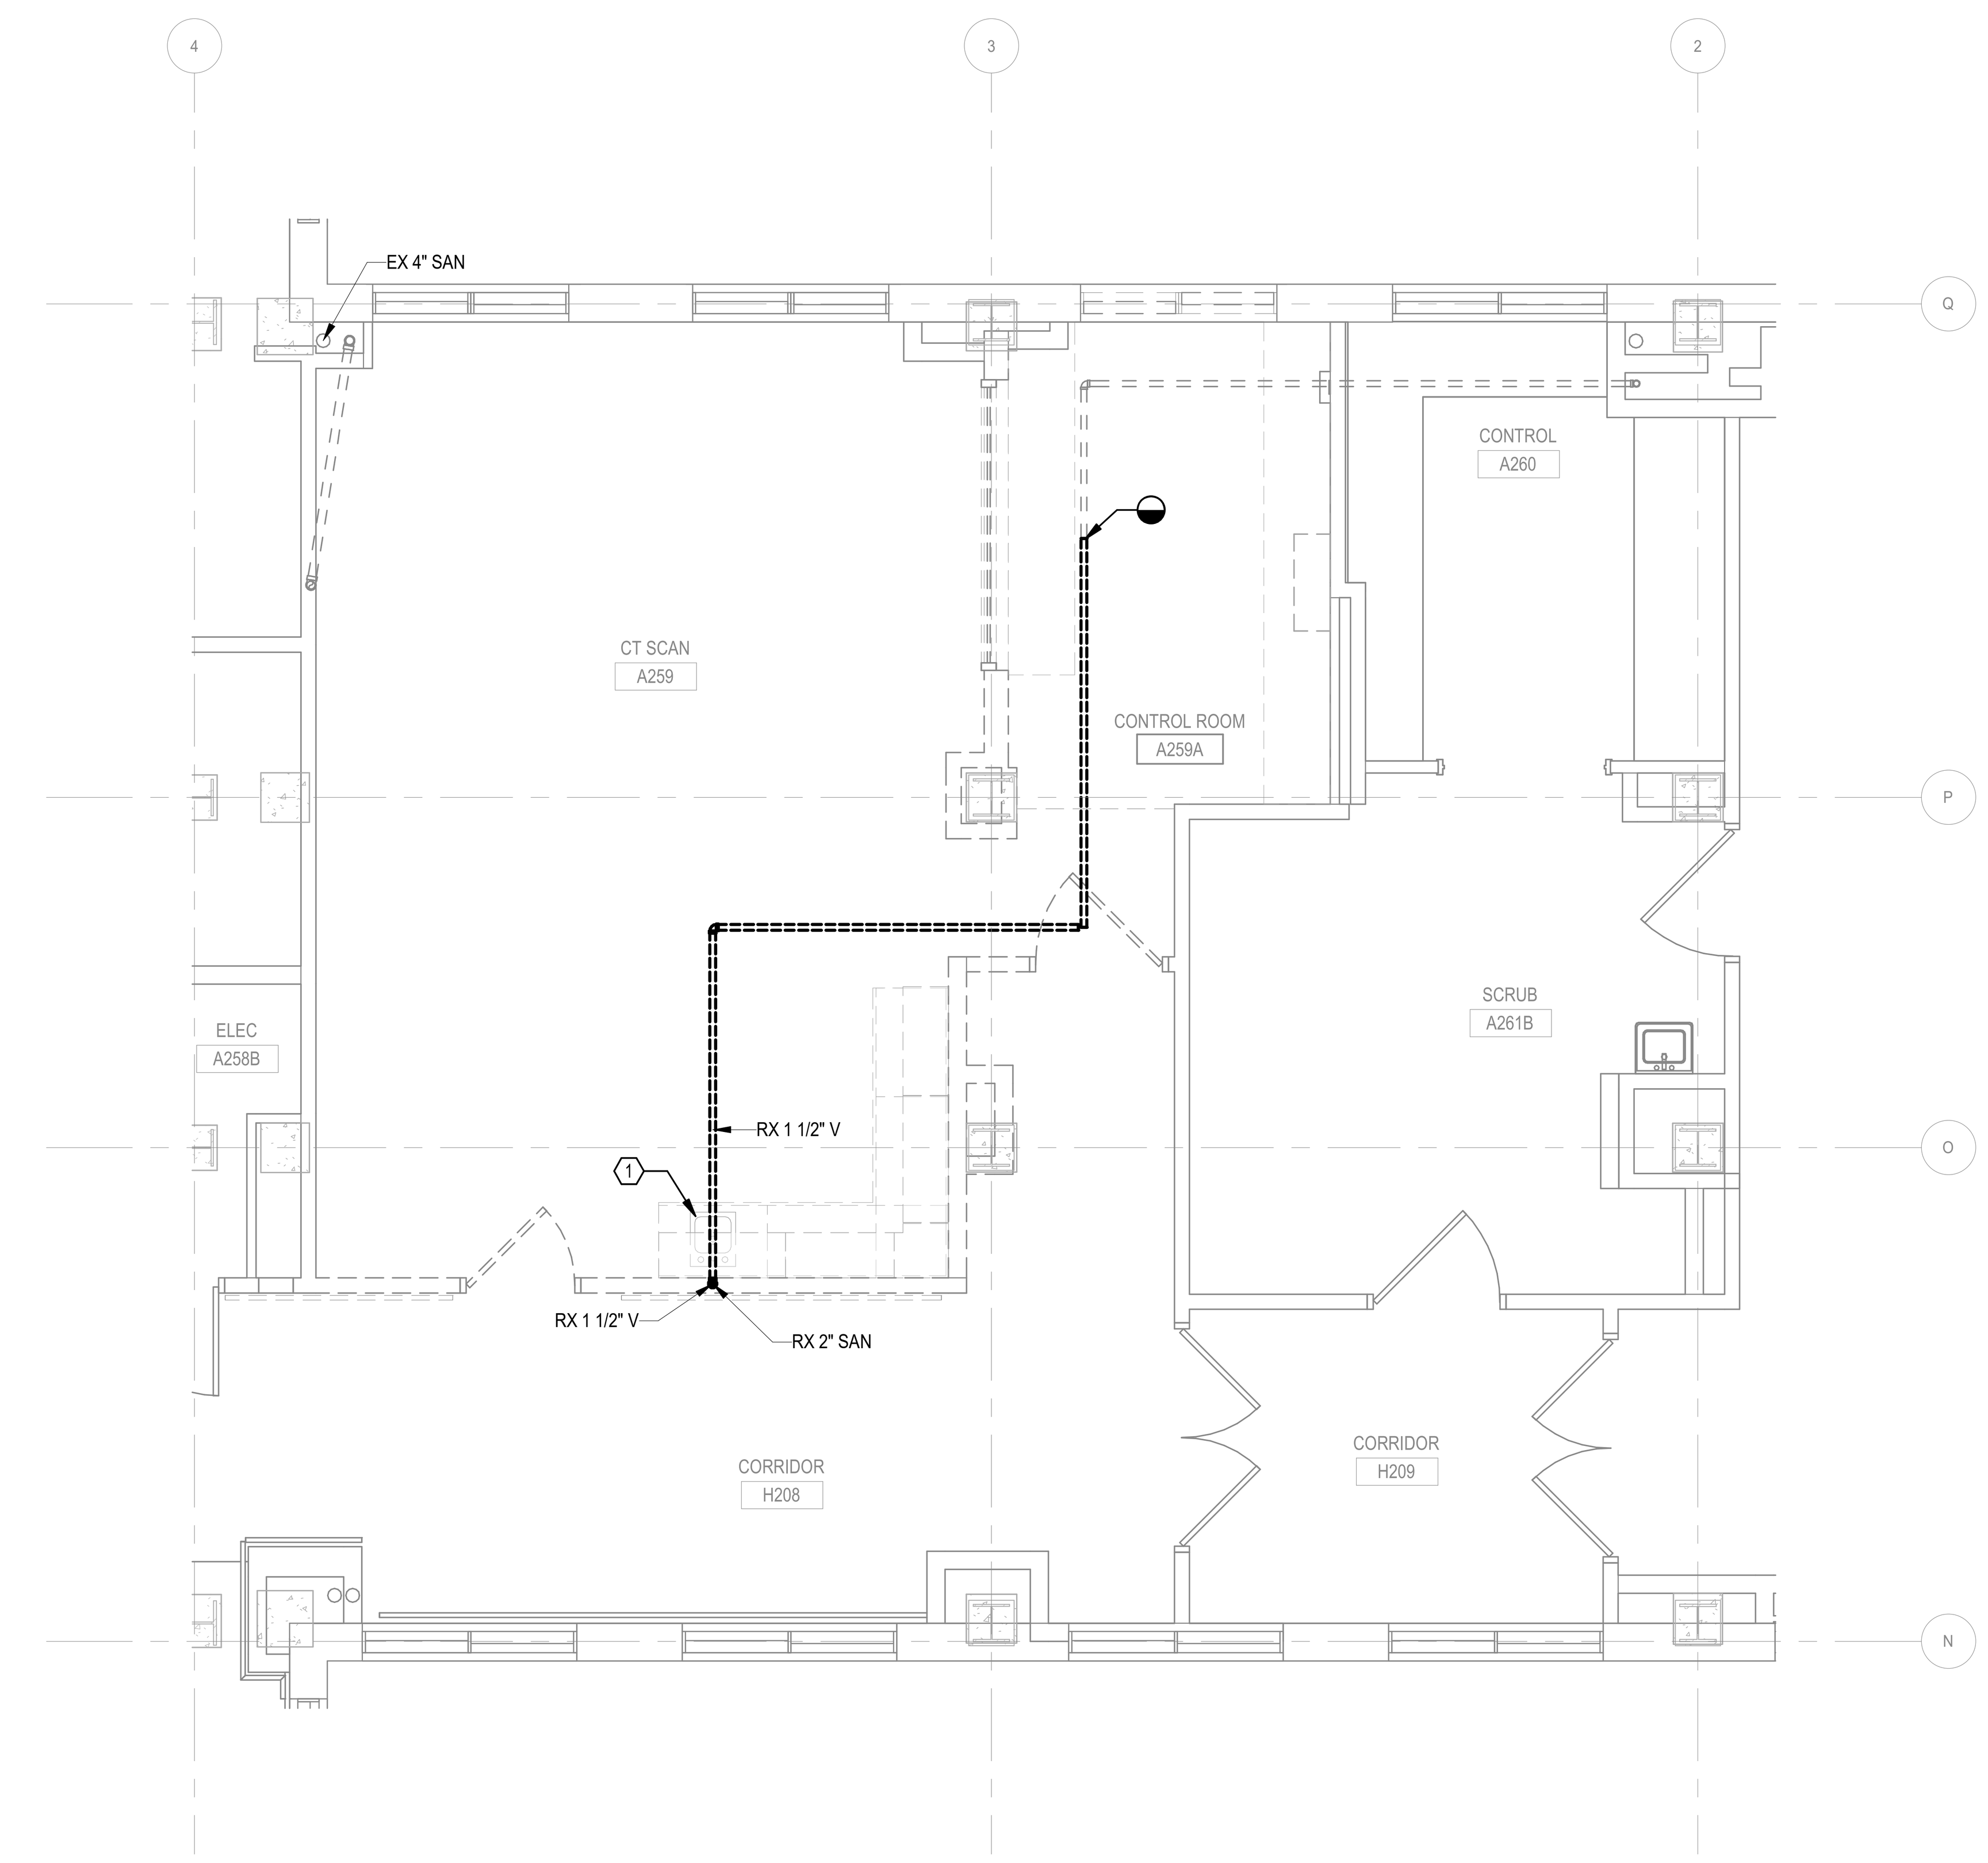

2 SECOND FLOOR PLAN - DWV PLUMBING - DEMOLITION
1/4" = 1'-0"

KEY PLAN

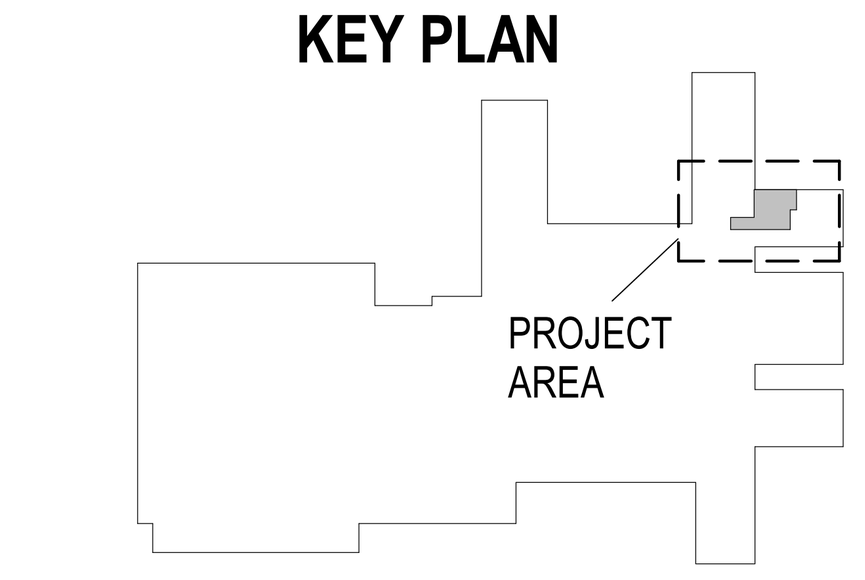

0 2' 4' 8' 12'
1/4" = 1'-0"

CONSULTANT	Above Group ENGINEERING. DESIGN. CONSULTING. 305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com www.abovegroupinc.com COA/CA Lic. No. 31120 305 East Dr., Suite H, Melbourne, Florida 32904 PH: 321.345.9026
ARCHITECT/ENGINEER OF RECORD	THINKFORM THINKFORM DESIGN ARCHITECT LLC 38 EAST BROAD STREET HOPEWELL, NJ 08525 T:855.821.0274 F:609.644.4397 Russell DiNardo, AIA NY 031521-1
STAMP	COMMONWEALTH OF PENNSYLVANIA REGISTERED PROFESSIONAL ALLEN LANTZ III ENGINEER PE091315
Office of Construction and Facilities Management	VA U.S. Department of Veterans Affairs
Drawing Title	FIRST AND SECOND FLOOR PLAN - DWV PIPING DEMOLITION
Approved:	
Phase	100% CONTRACT DOCUMENTS FOR BIDDING
	FULLY SPRINKLERED
Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	CNB
Drawn	CSC
Project Number	657-23-104JC
Building Number	1
Drawing Number	PD101

Revisions: Date:

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

3/6/2026 12:02:21 PM

DRAWING NOTES:

1. EXISTING CONDITIONS SHOWN ARE BASED ON LIMITED RECORD DRAWINGS AND SITE EXPLORATION. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AND NOTIFY THE COR IN WRITING ON ANY DEVIATIONS.
2. CONTRACTOR SHALL NOTIFY VA COR IN WRITING A MINIMUM OF FOUR WEEKS PRIOR TO SHUTDOWN OF UTILITIES.

CODED NOTES:

1 CONNECT NEW 2" SANITARY SEWER PIPING TO EXISTING RISER IN CHASE.

2 2" SANITARY SEWER UP TO SINK ABOVE.

3 2" SANITARY SEWER UP TO FLOOR DRAIN IN EQUIPMENT ROOM.

4 CONNECT TO EXISTING VENT PIPING.

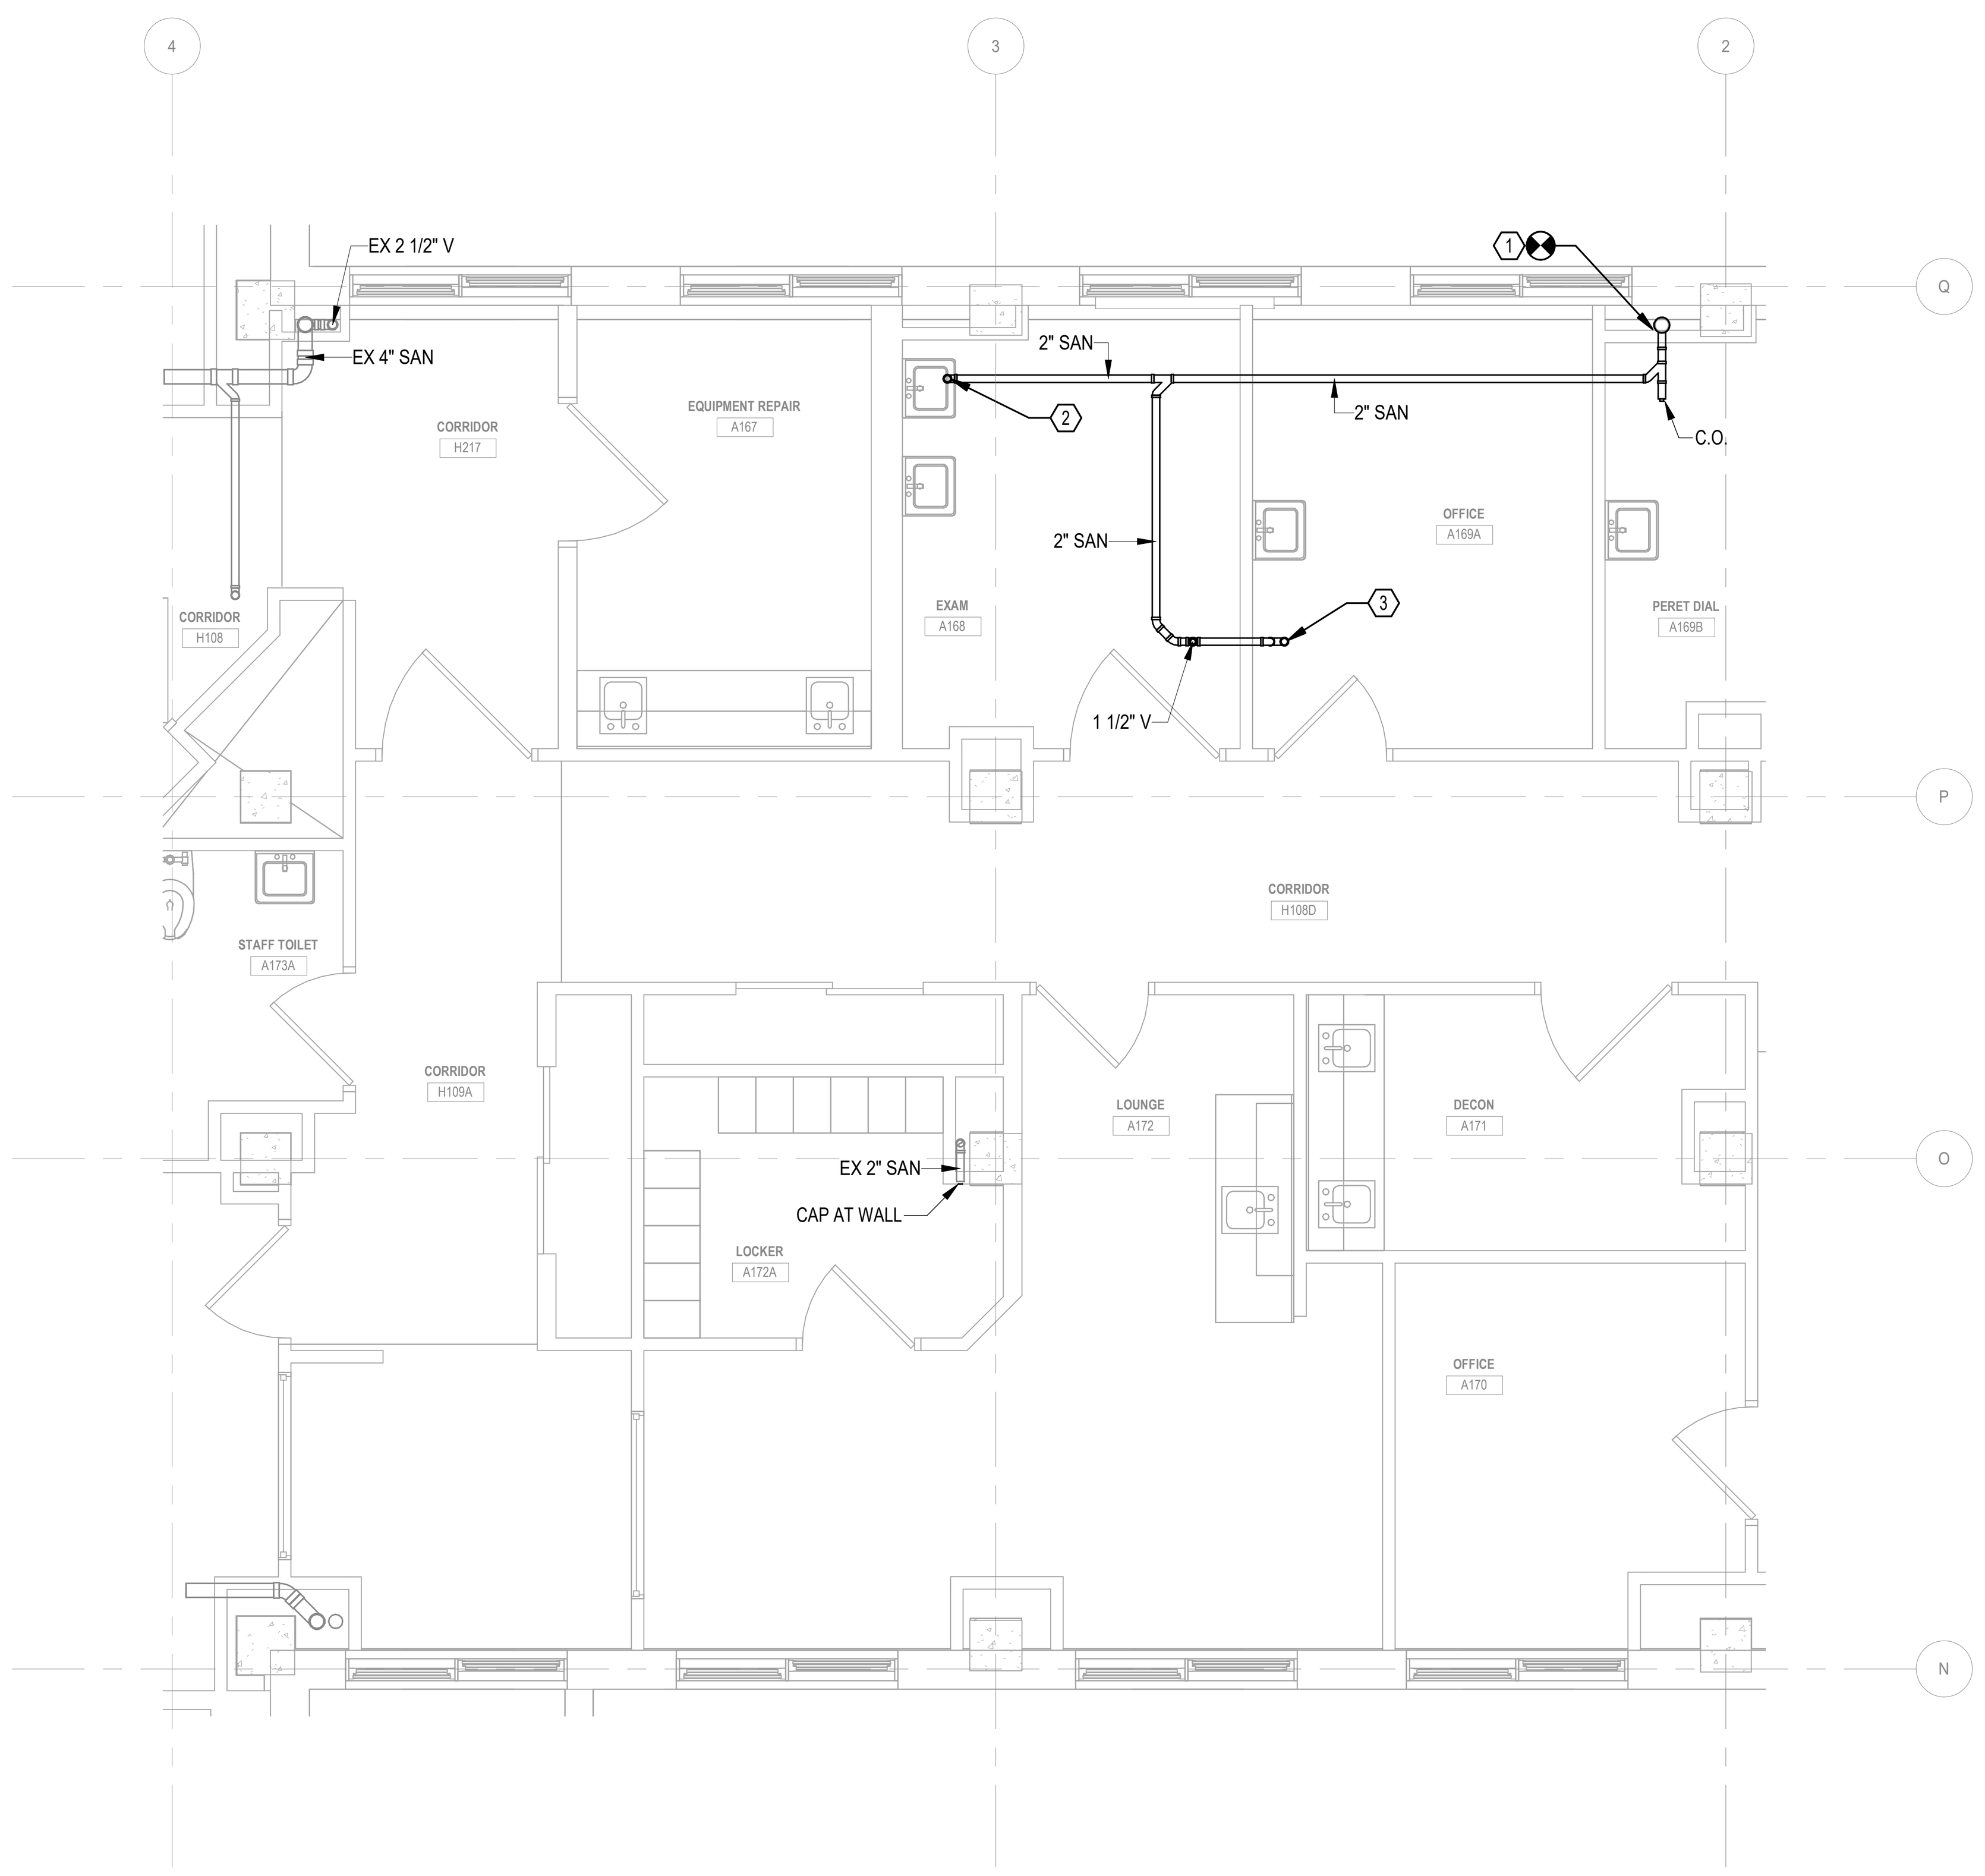

1 FIRST FLOOR PLAN - DWV PLUMBING - NEW WORK
1/4" = 1'-0"

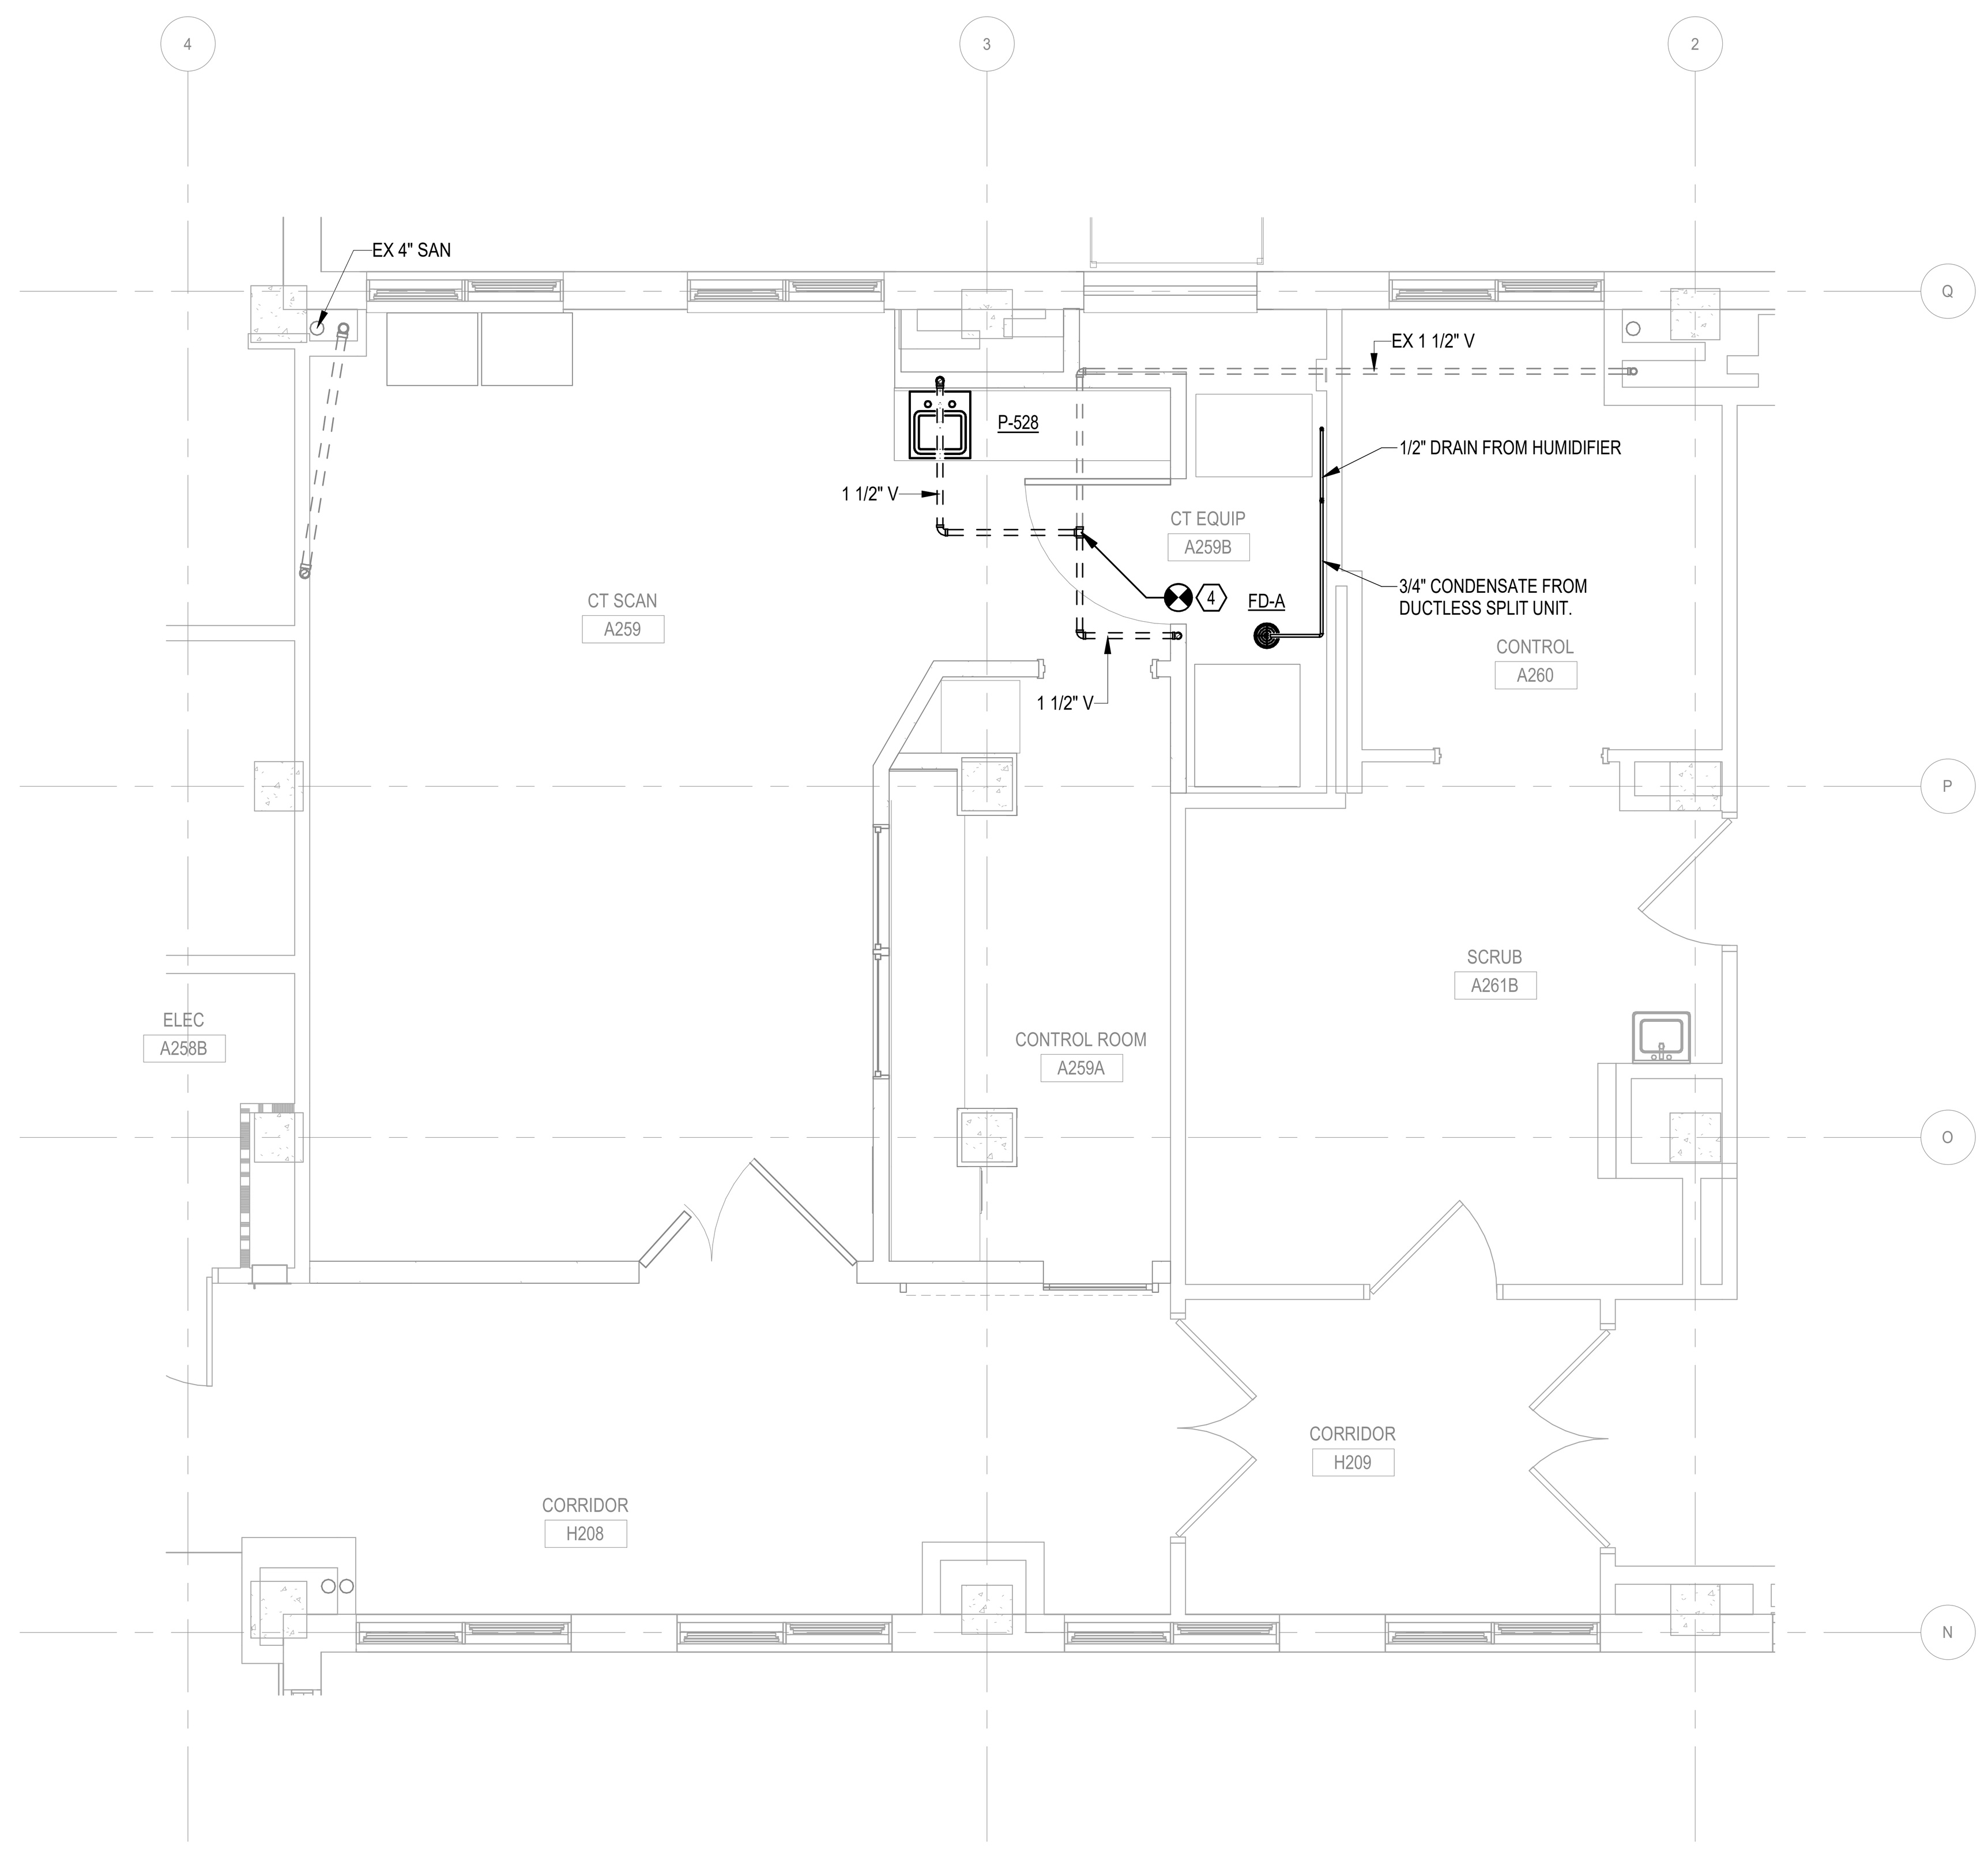

2 SECOND FLOOR PLAN - DWV PLUMBING - NEW WORK
1/4" = 1'-0"

KEY PLAN

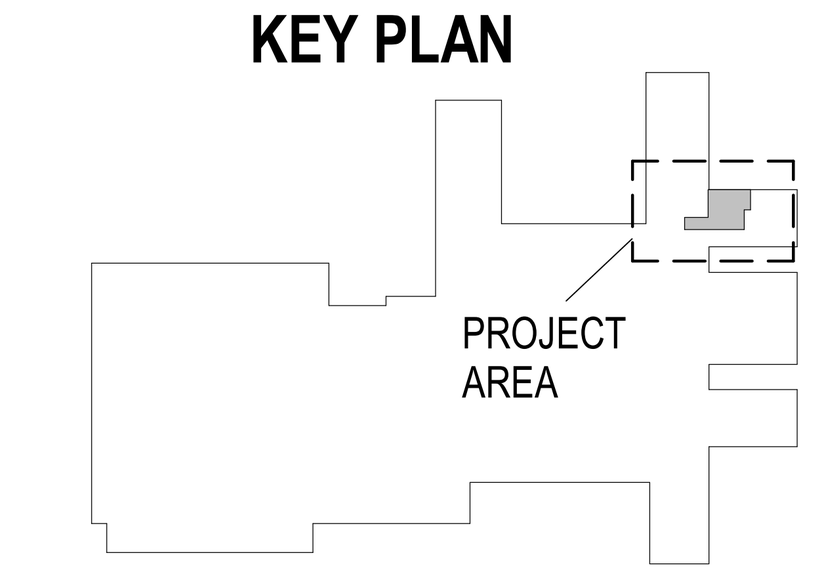

N

0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
FIRST AND SECOND FLOOR PLAN - DWV PIPING NEW WORK	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
			Building Number: 1
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Drawing Number
		Issue Date: 06 MARCH 2026 / Checked: CNB / Drawn: CSC	PS101

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

3/6/2026 12:02:24 PM

DRAWING NOTES:

1. EXISTING CONDITIONS SHOWN ARE BASED ON LIMITED RECORD DRAWINGS AND SITE EXPLORATION. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AND NOTIFY THE COR IN WRITING ON ANY DEVIATIONS.

CODED NOTES:

1. REMOVE EXISTING SINK AND ASSOCIATED BRANCH PIPING BACK TO MAIN AND CAP/SEAL WATER-TIGHT WITHOUT CREATING DEAD-LEGS.
2. DOMESTIC WATER PIPING IN CHASE, DOWN TO FLOOR BELOW.
3. CONNECT NEW 1/2" HOT WATER RETURN PIPE TO EXISTING RISER IN WALL. PROVIDE ISOLATION VALVE AND BALANCING VALVE SET AT 0.5 GPM.

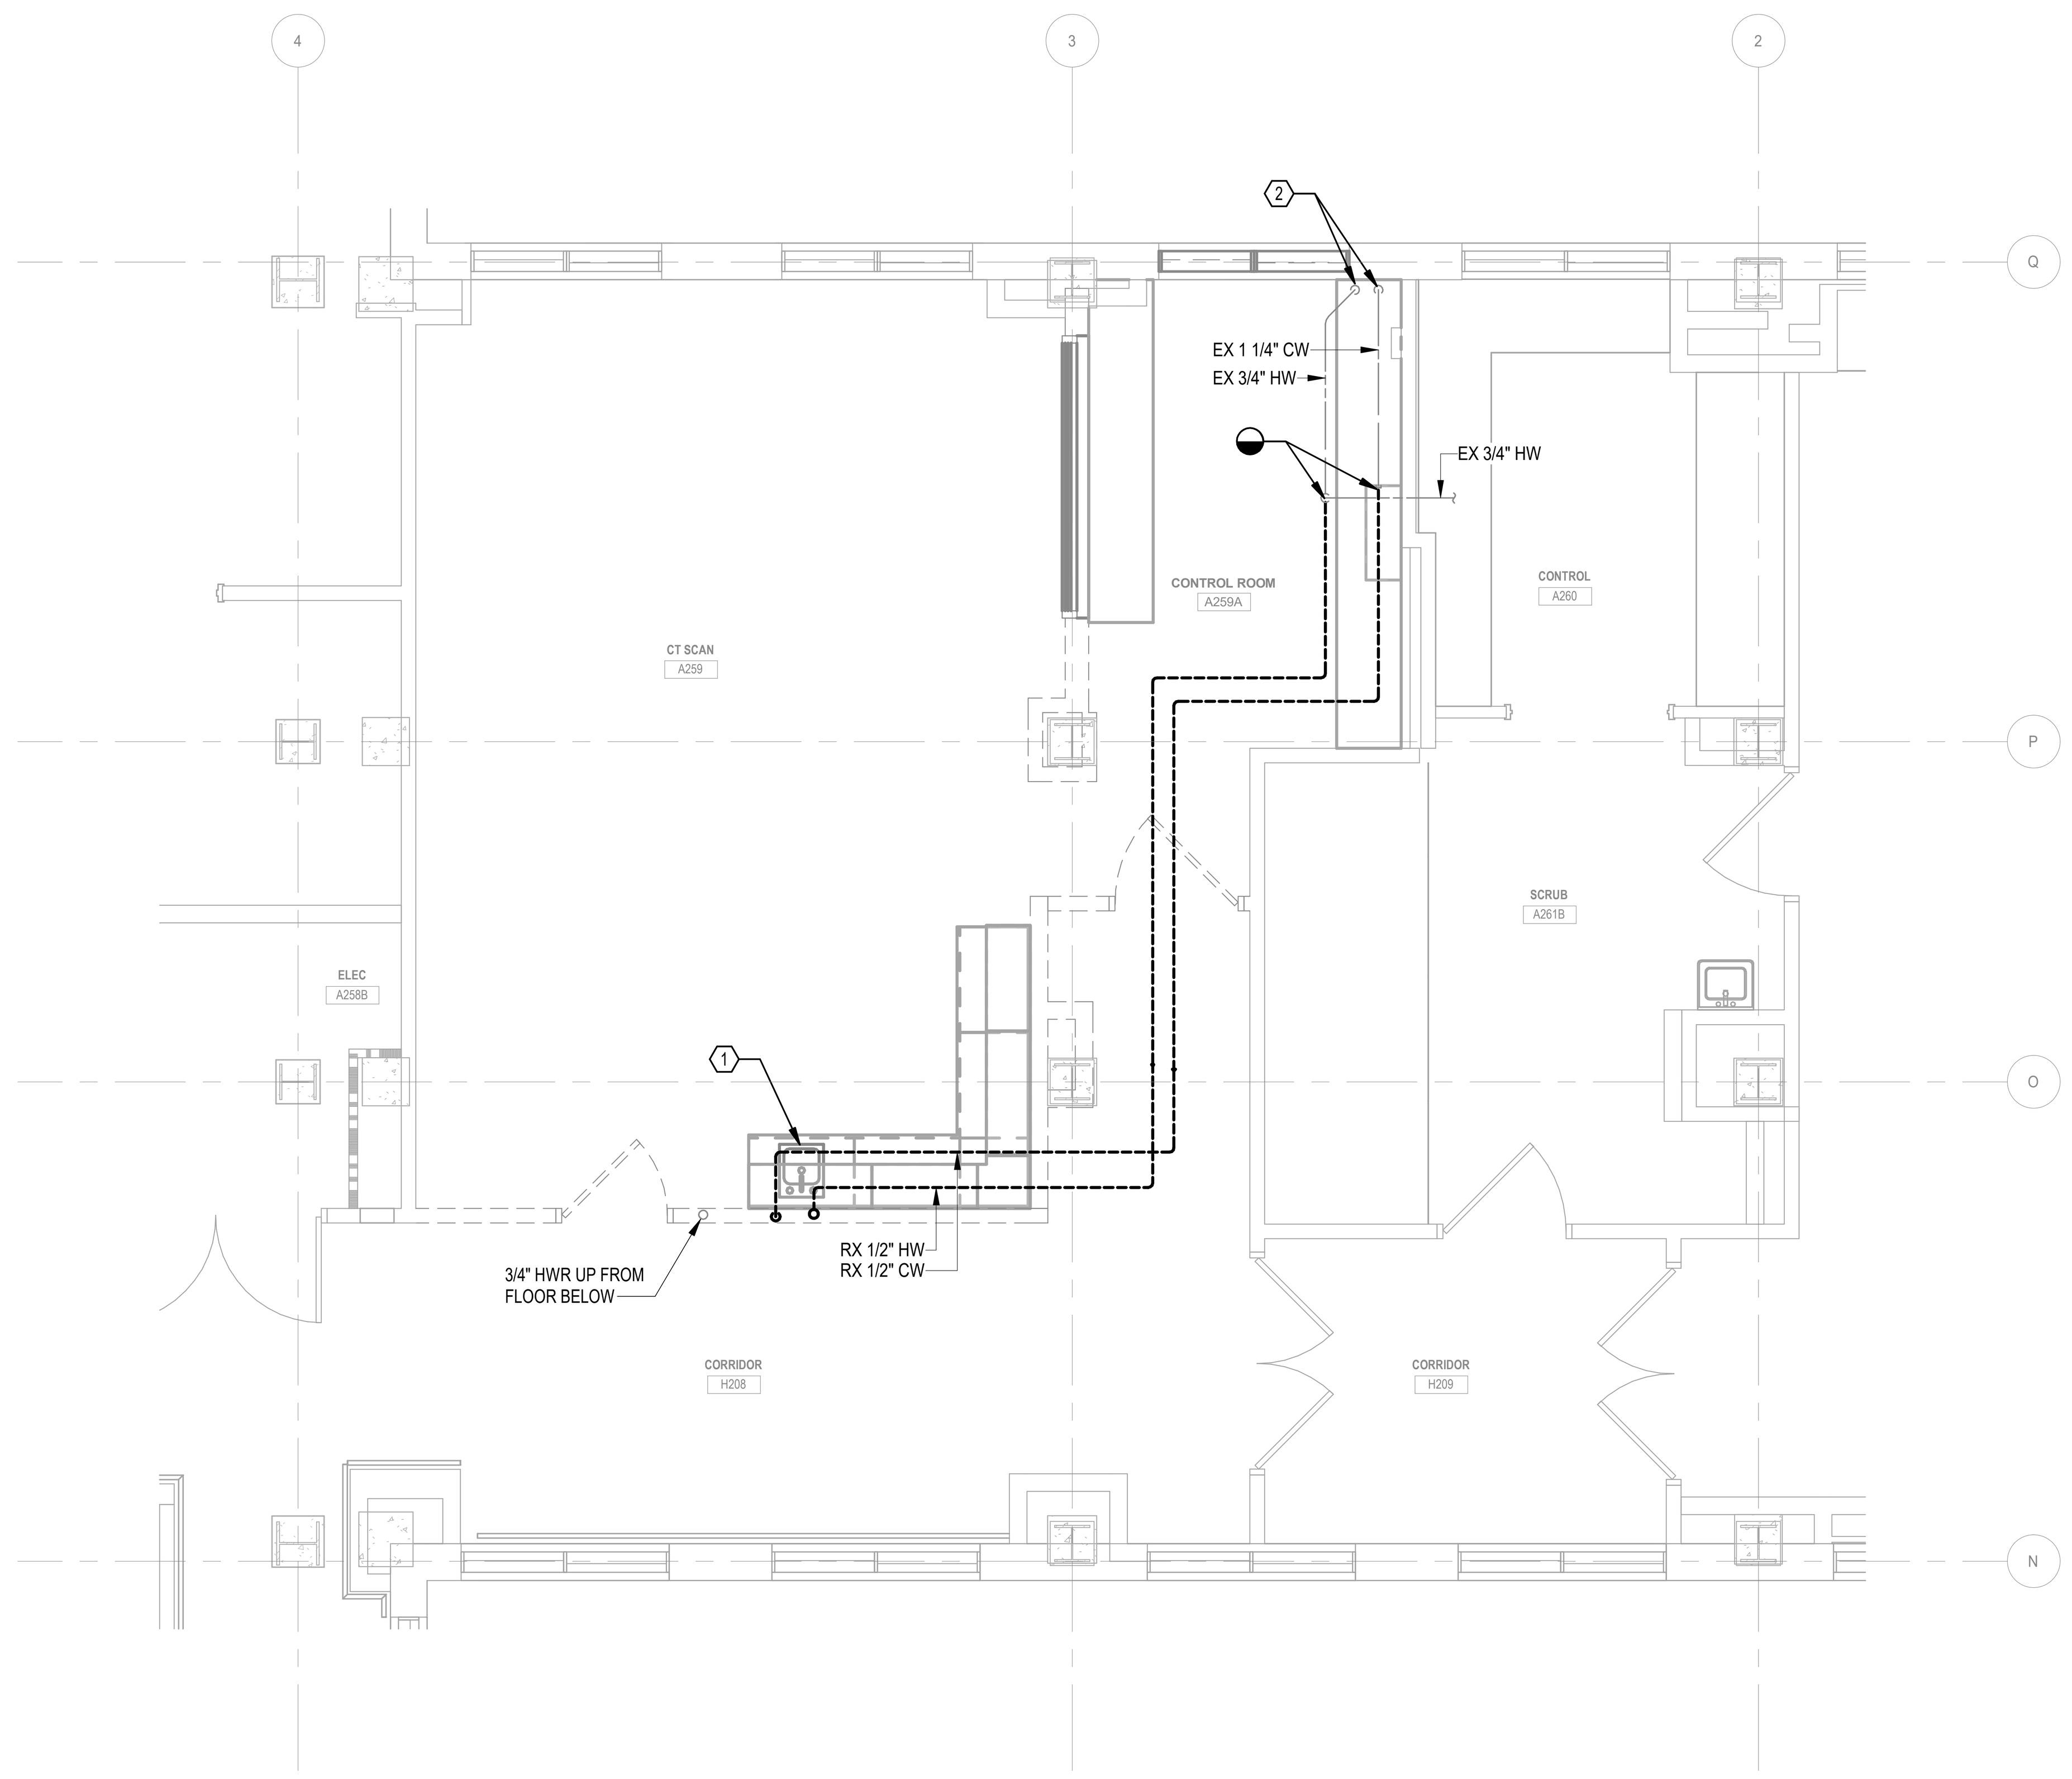

1 SECOND FLOOR PLAN - PRESSURE PLUMBING - DEMOLITION
1/4" = 1'-0"

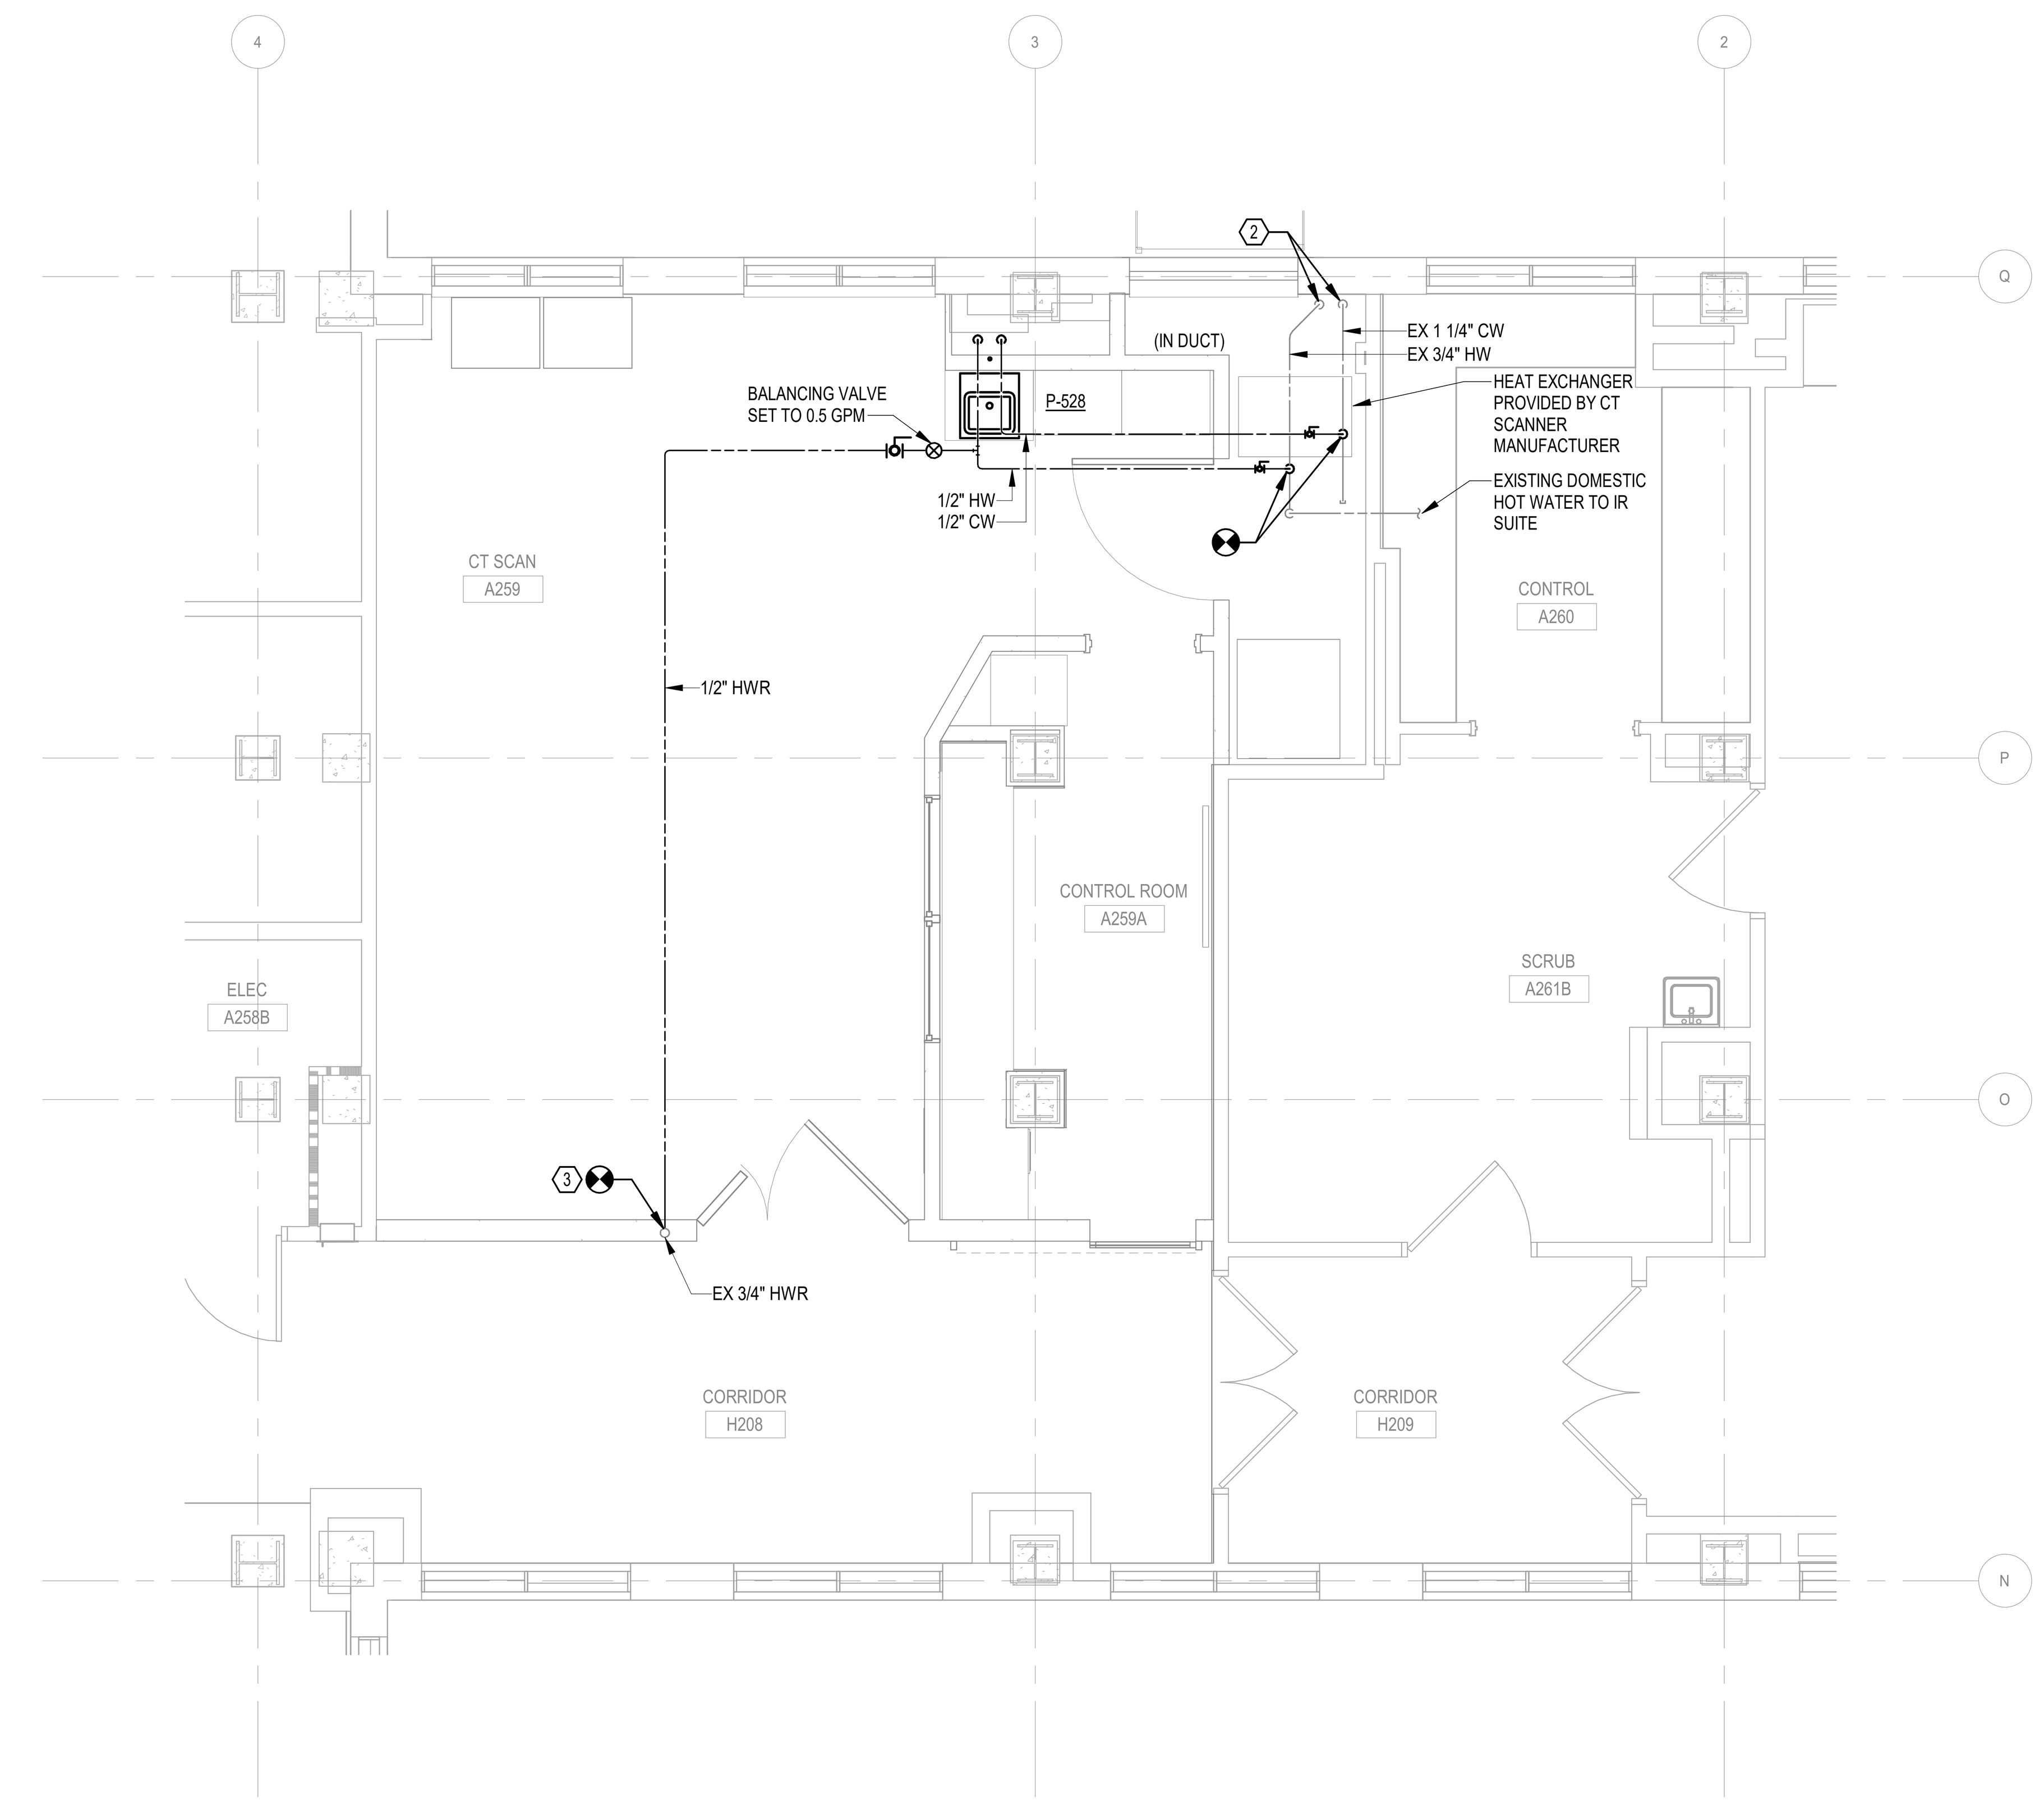

2 SECOND FLOOR PLAN - PRESSURE PLUMBING - NEW WORK
1/4" = 1'-0"

KEY PLAN

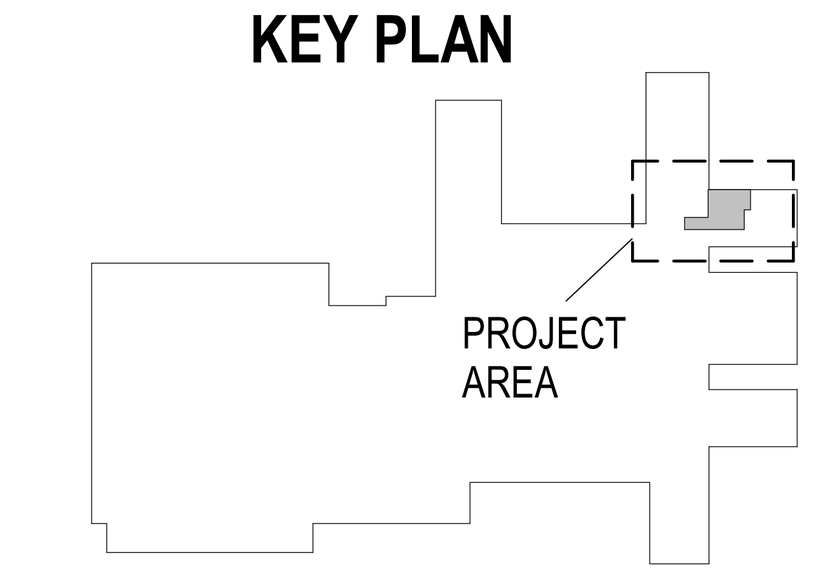

N
0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
SECOND FLOOR PLAN - PRESSURE PIPING - ROOM A259	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
			Building Number: 1
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Drawing Number: PP101
		Issue Date: 06 MARCH 2026 / Checked: CNB / Drawn: CSC	

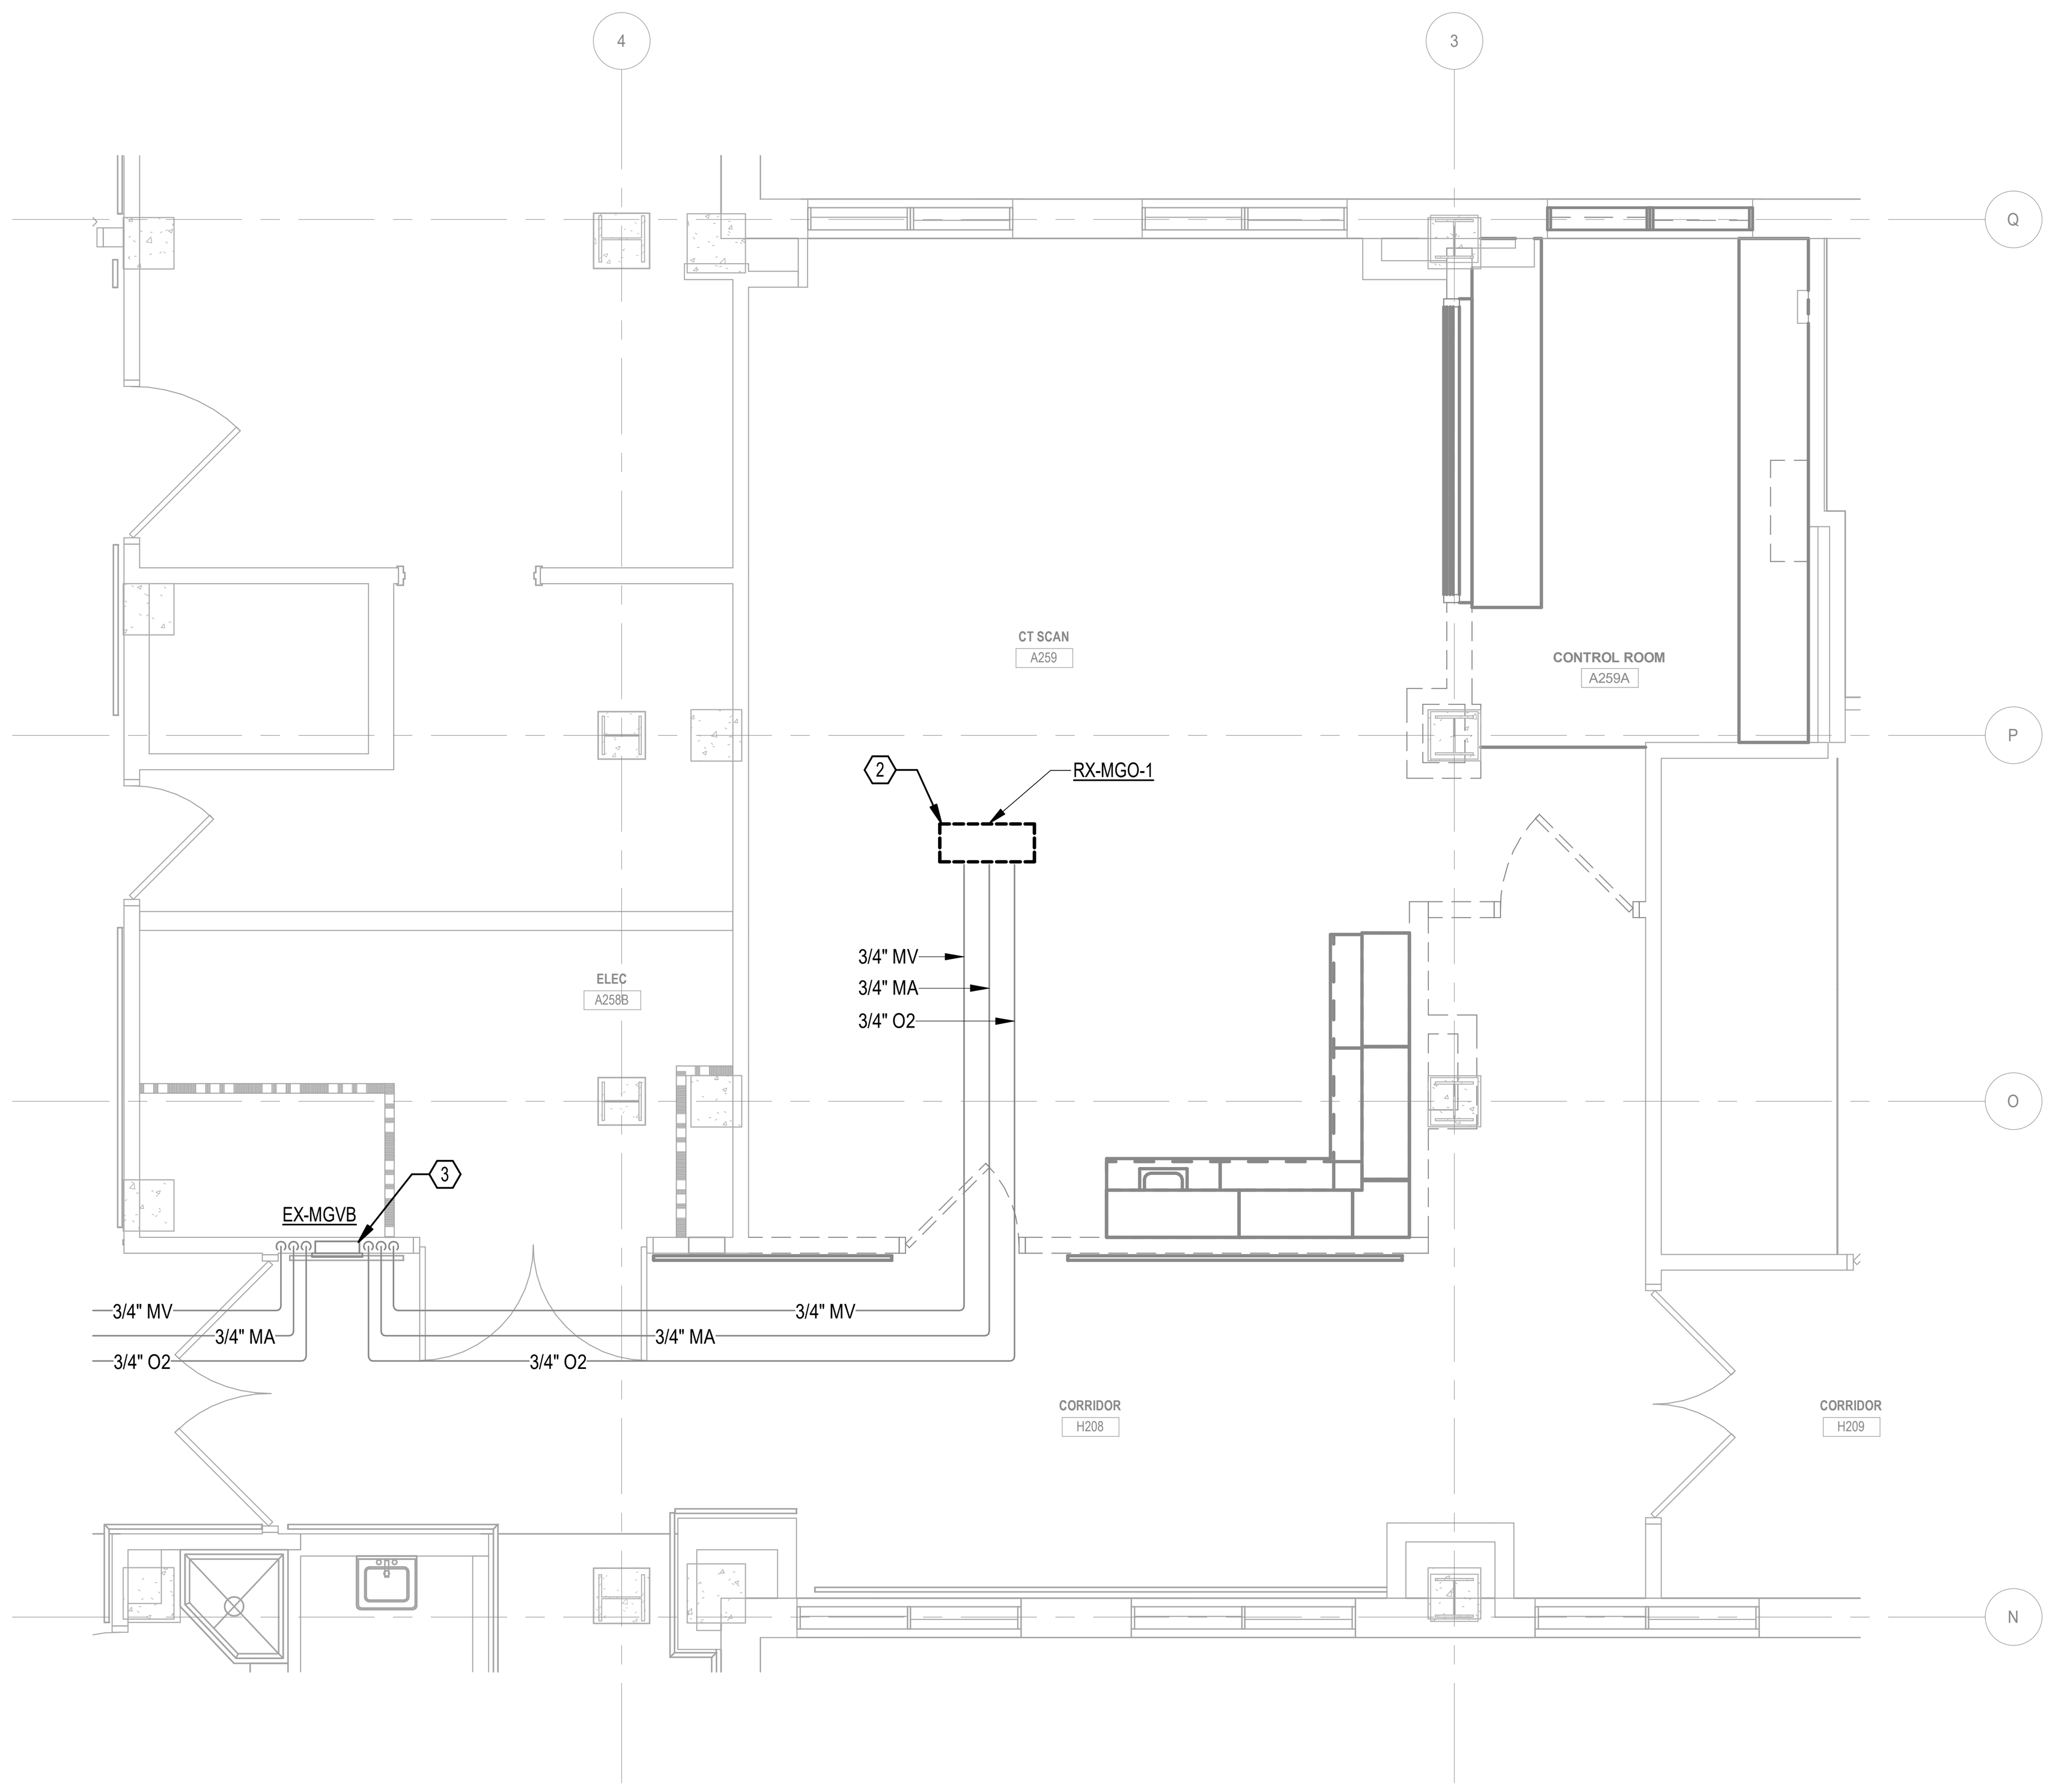

1 SECOND FLOOR PLAN - MED GAS - DEMOLITION
1/4" = 1'-0"

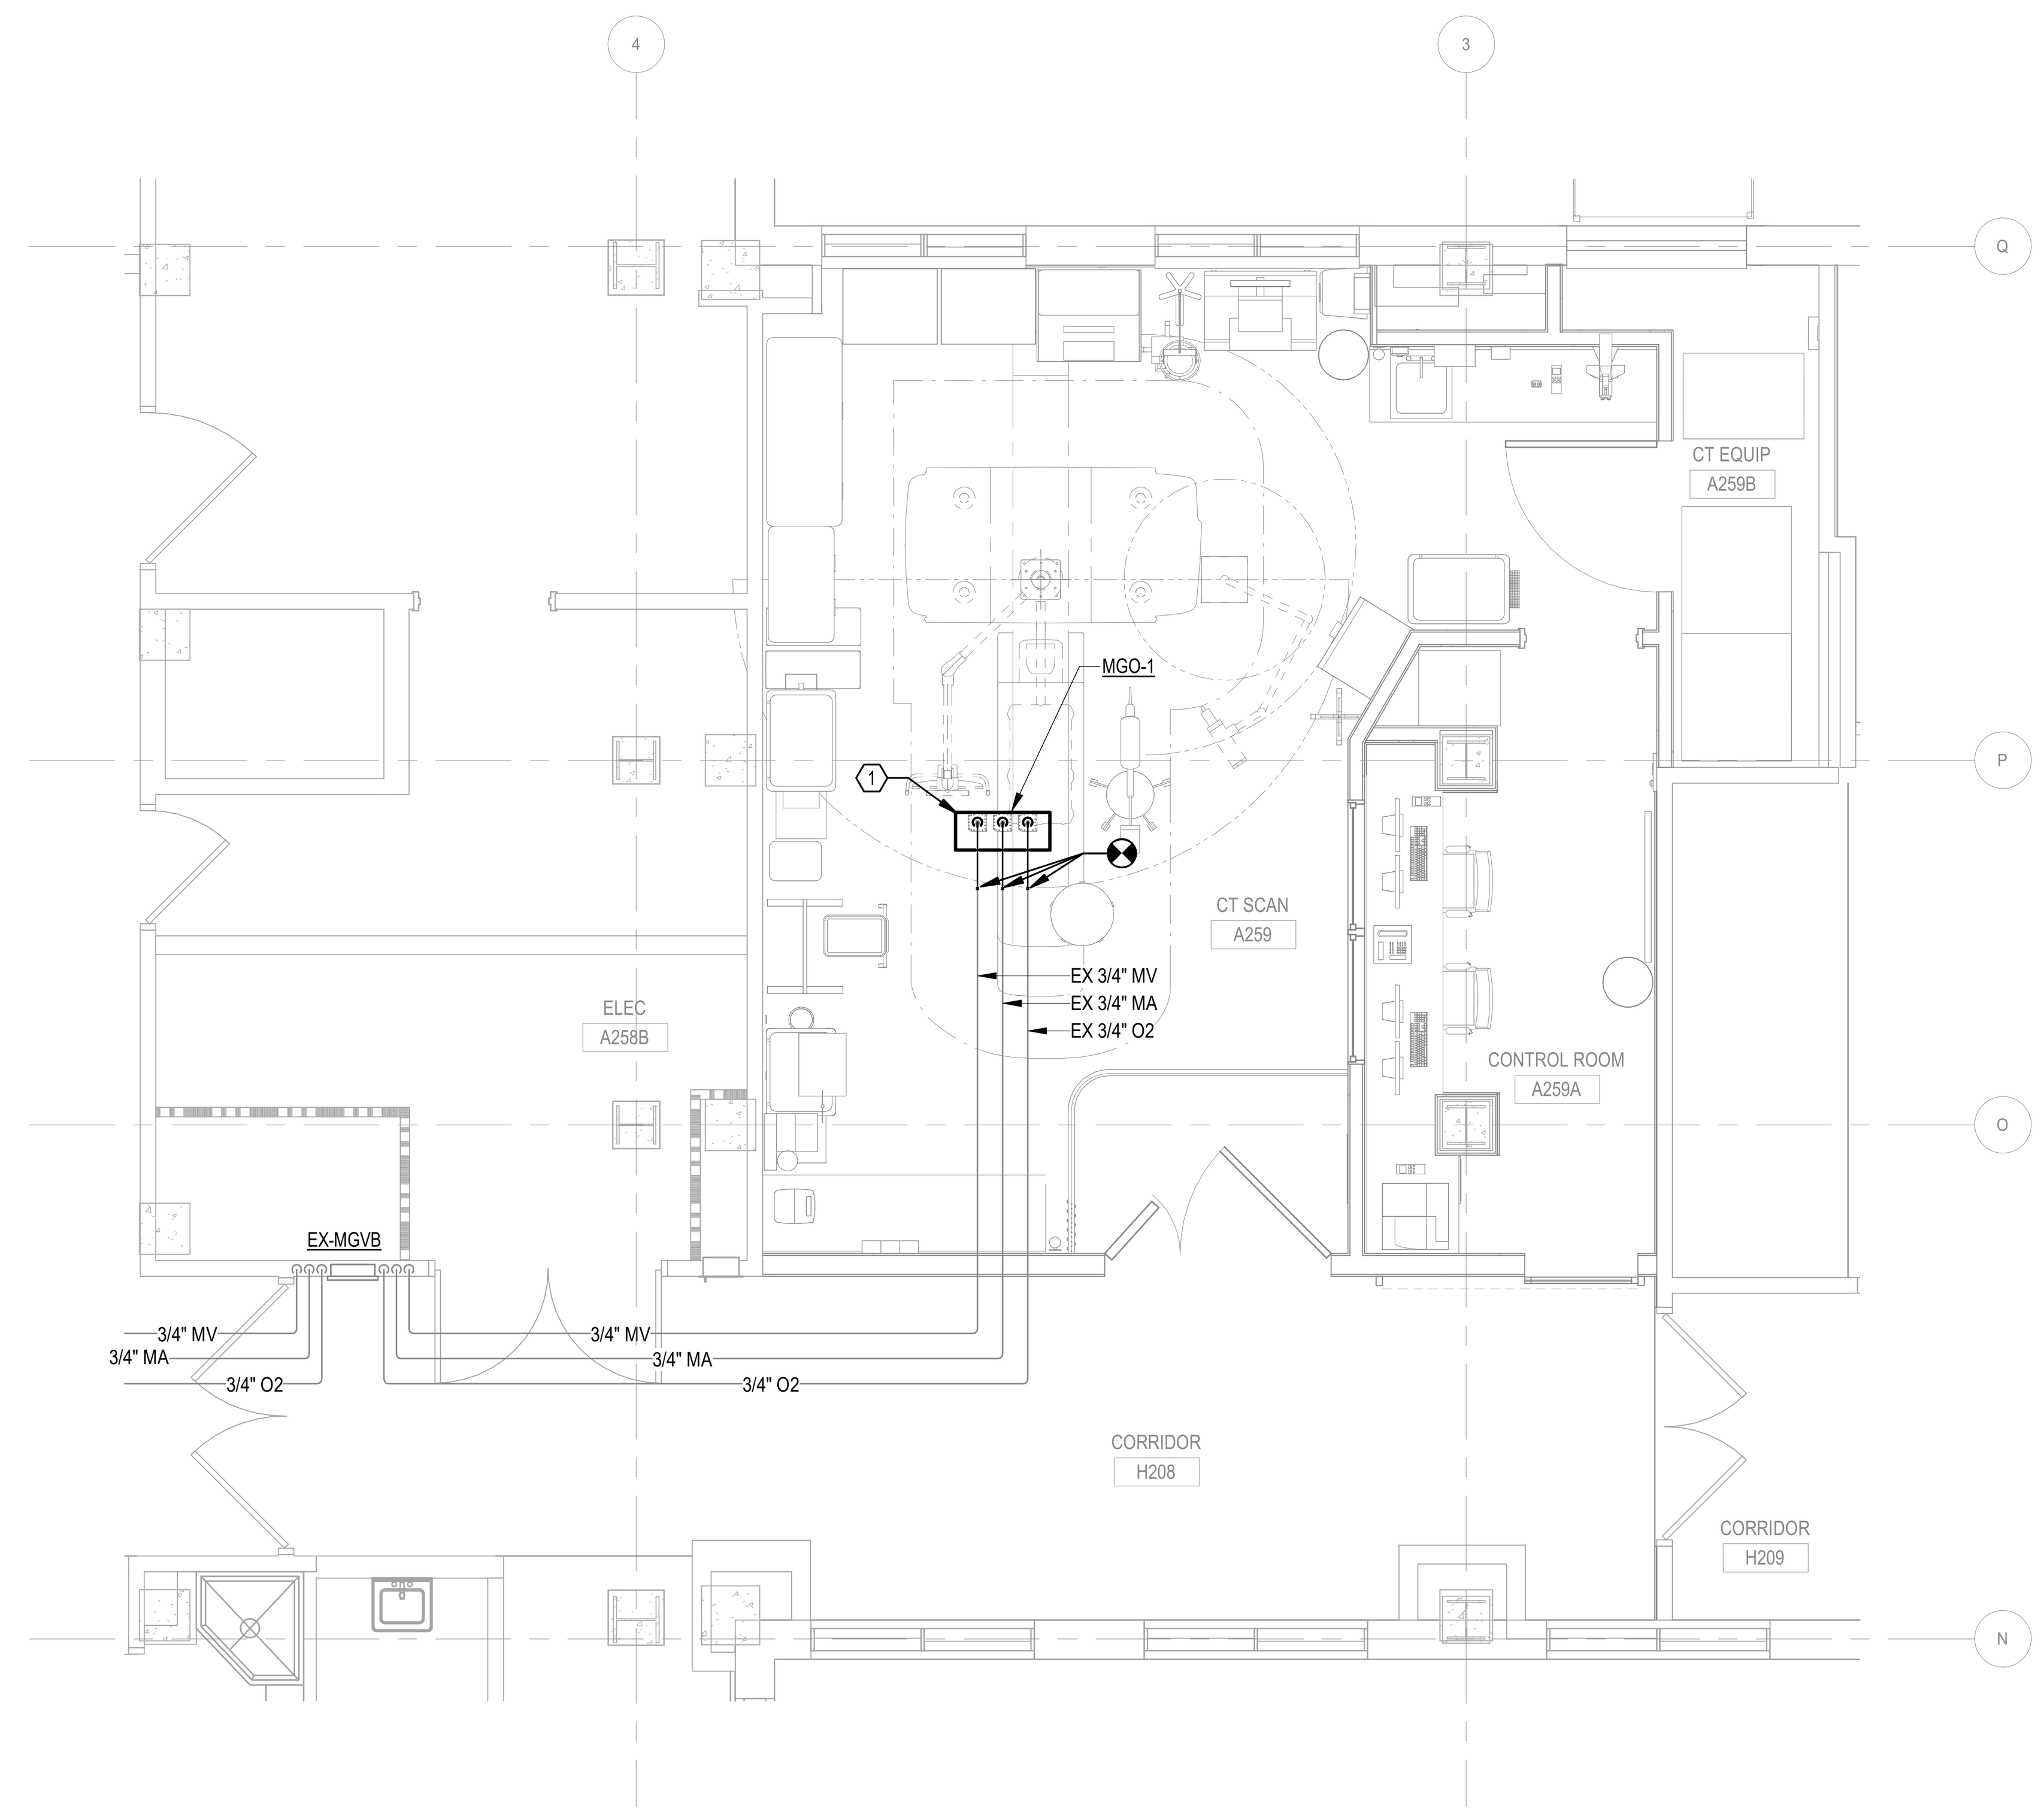

2 SECOND FLOOR PLAN - MED GAS - NEW WORK
1/4" = 1'-0"

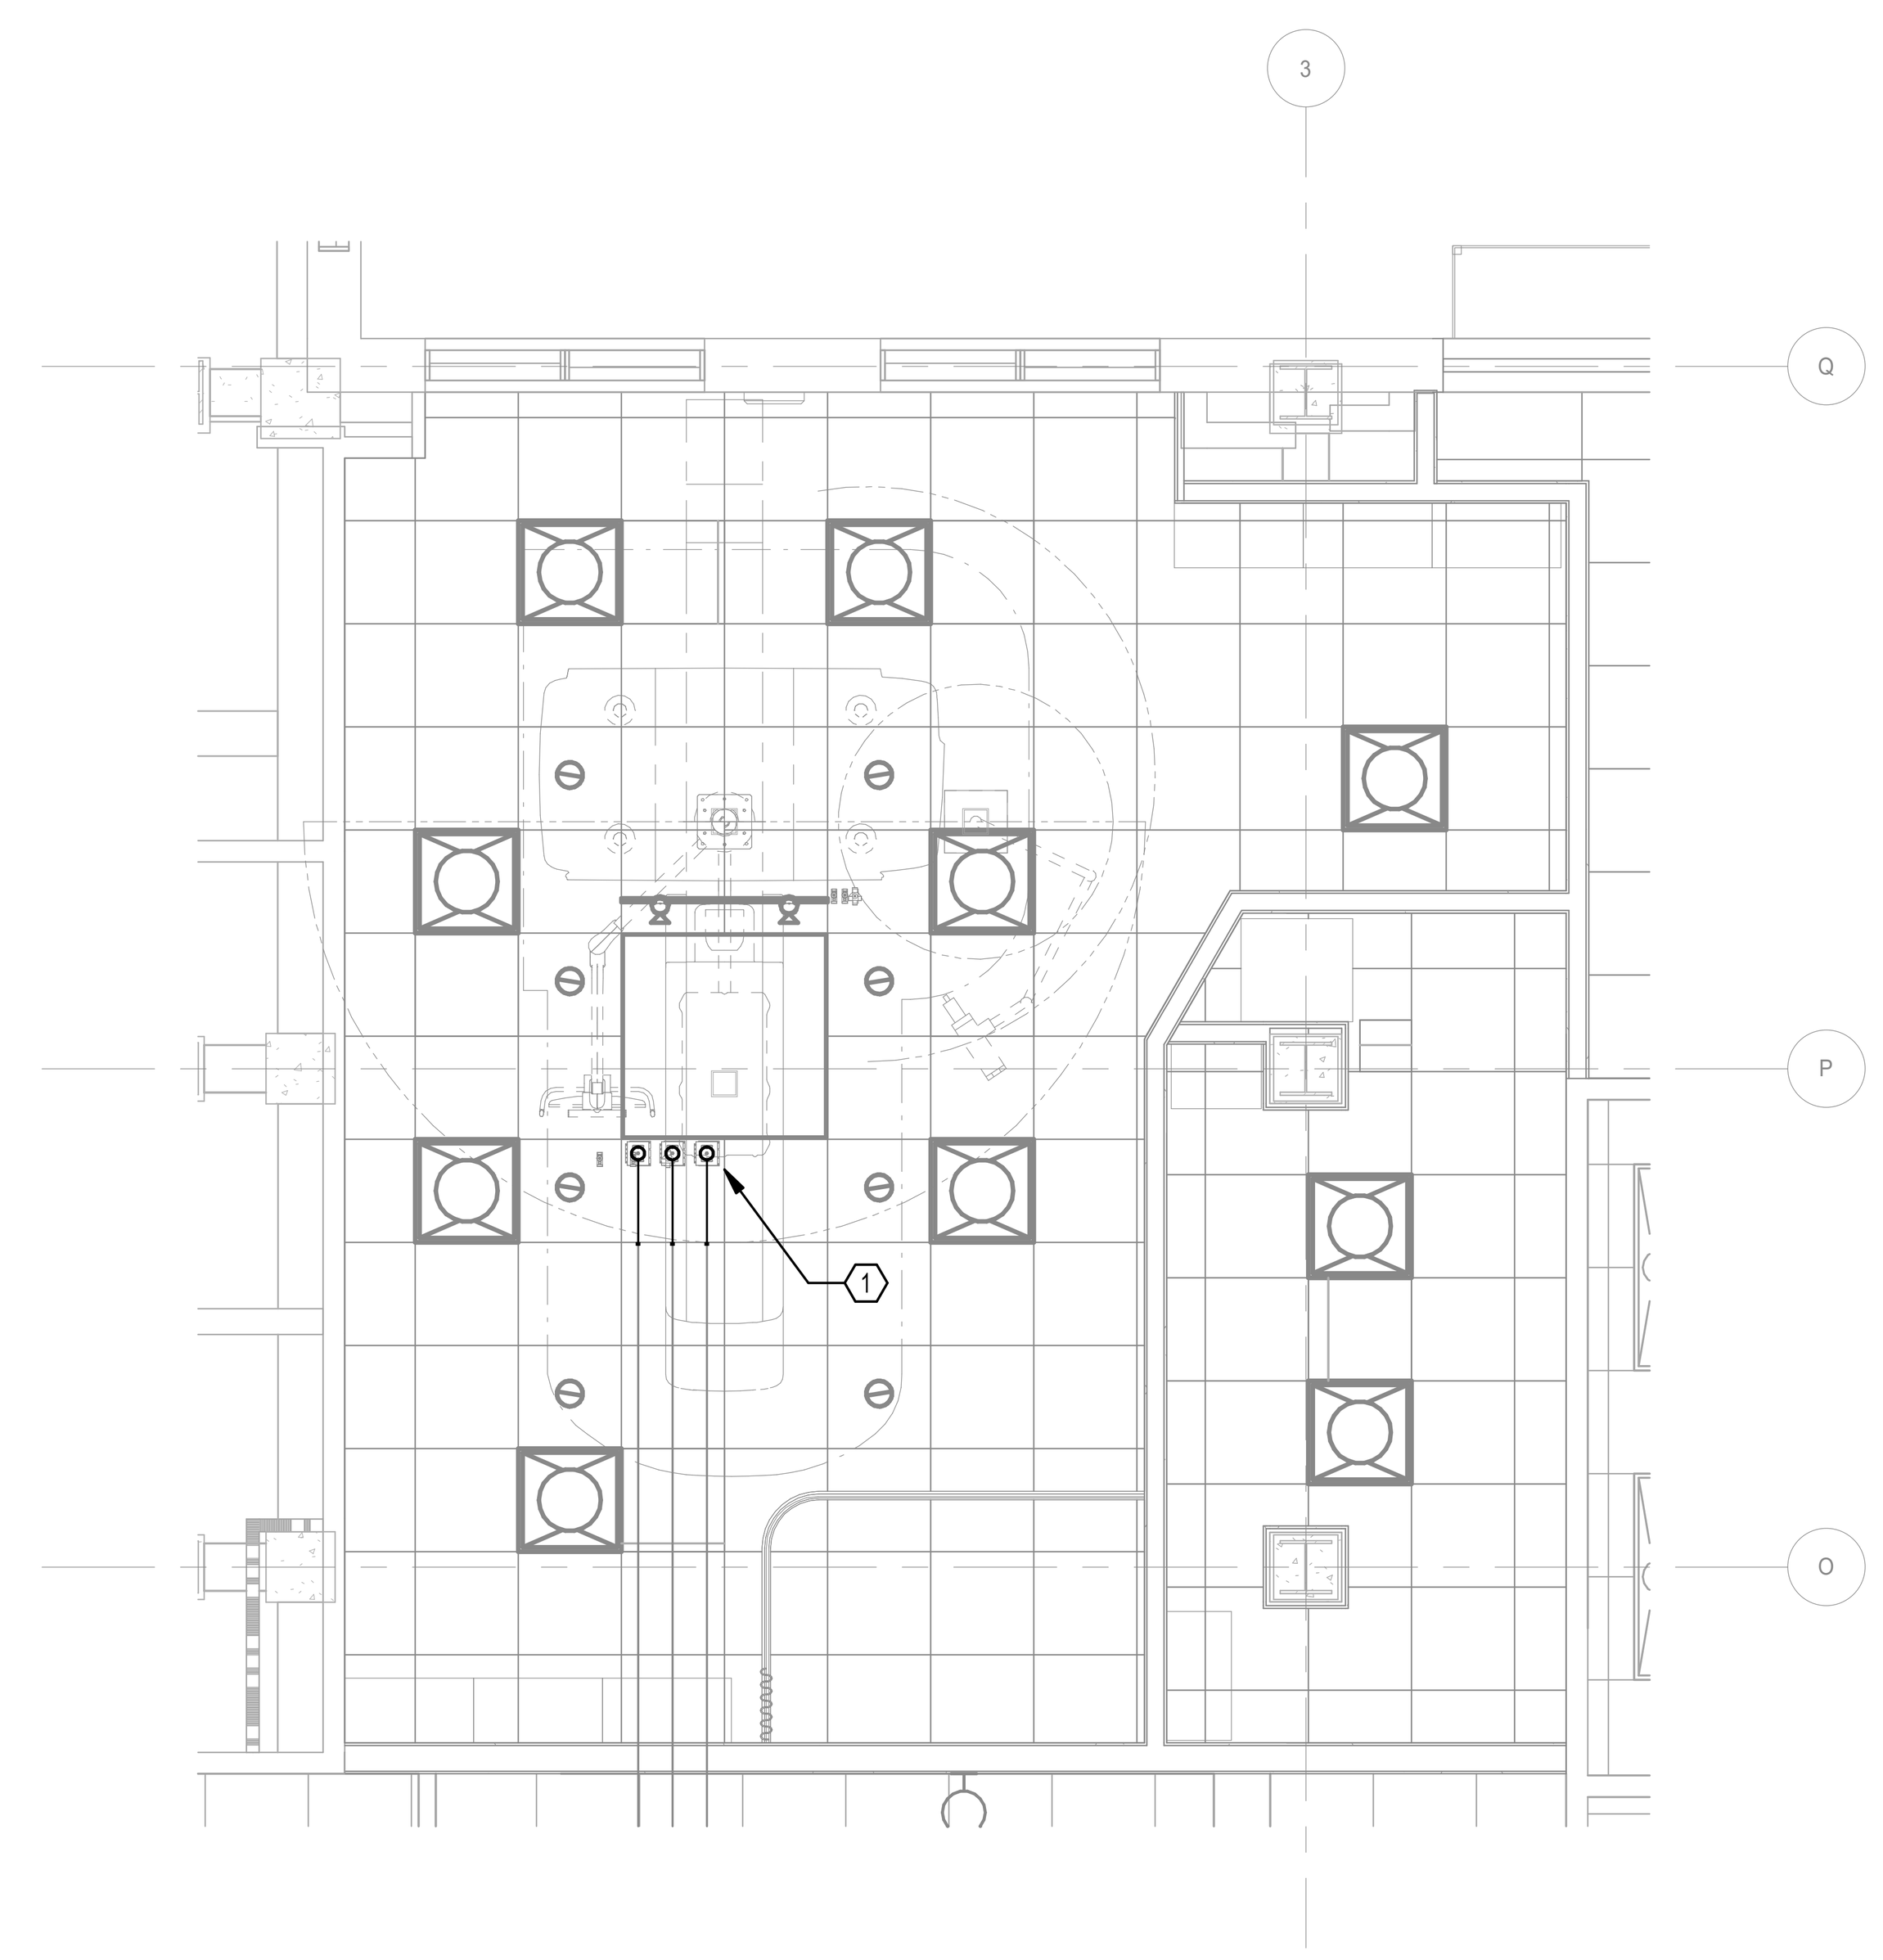

3 SECOND FLOOR MEDICAL GAS CEILING COORDINATION PLAN
1/4" = 1'-0"

DRAWING NOTES:

1. EXISTING CONDITIONS SHOWN ARE BASED ON LIMITED RECORD DRAWINGS AND SITE EXPLORATION. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AND NOTIFY THE COR IN WRITING ON ANY DEVIATIONS.
2. OWNER TO CONFIRM LOCATION OF MEDICAL GAS OUTLETS AND CONNECTION TYPES.
3. CONTRACTOR SHALL MATCH FACILITY MEDICAL GAS OUTLET KEY TYPES UNLESS DIRECTED OTHERWISE.
4. CONTRACTOR SHALL NOTIFY VA COR IN WRITING A MINIMUM OF FOUR WEEKS PRIOR TO SHUTDOWN OF UTILITIES.

CODED NOTES:

1 NEW MGO. COORDINATE EXACT LOCATION WITH ARCHITECTURAL CEILING PLAN. EXTEND EXISTING MED GAS PIPING TO NEW LOCATION.

2 REMOVE EXISTING MEDICAL GAS OUTLET. SHUT OFF GASES AT ZONE VALVE BOX. PREPARE PIPE FOR CONNECTION TO NEW OUTLET.

3 EXISTING MEDICAL GAS ZONE VALVE BOX TO REMAIN.

KEY PLAN

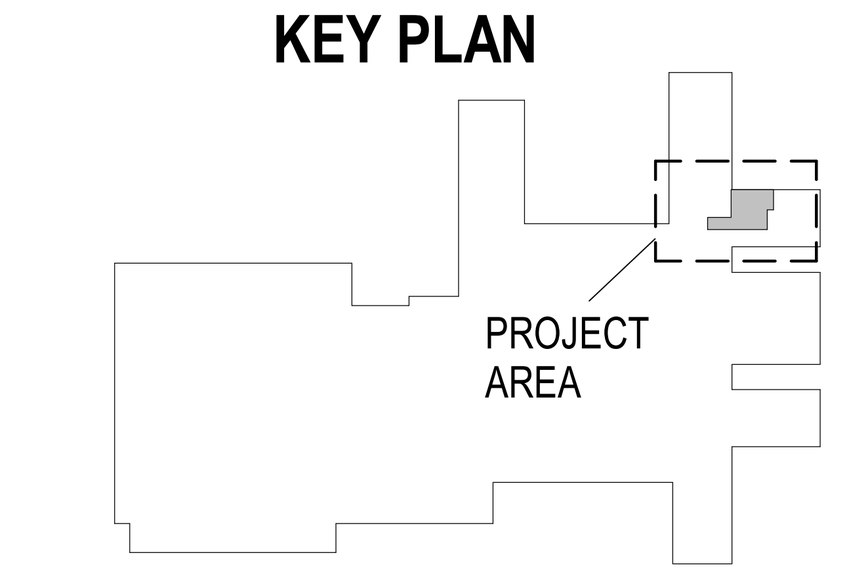

N

0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions:
Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM
architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: SECOND FLOOR PLAN - MED GAS - ROOM A259	Phase: 100% CONTRACT DOCUMENTS FOR BIDDING
Approved:	FULLY SPRINKLERED

Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259			Project Number: 657-23-104JC
			Building Number: 1
Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106			Drawing Number: PG101
Issue Date: 06 MARCH 2026	Checked: CNB	Drawn: CSC	

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

3/6/2026 12:02:32 PM

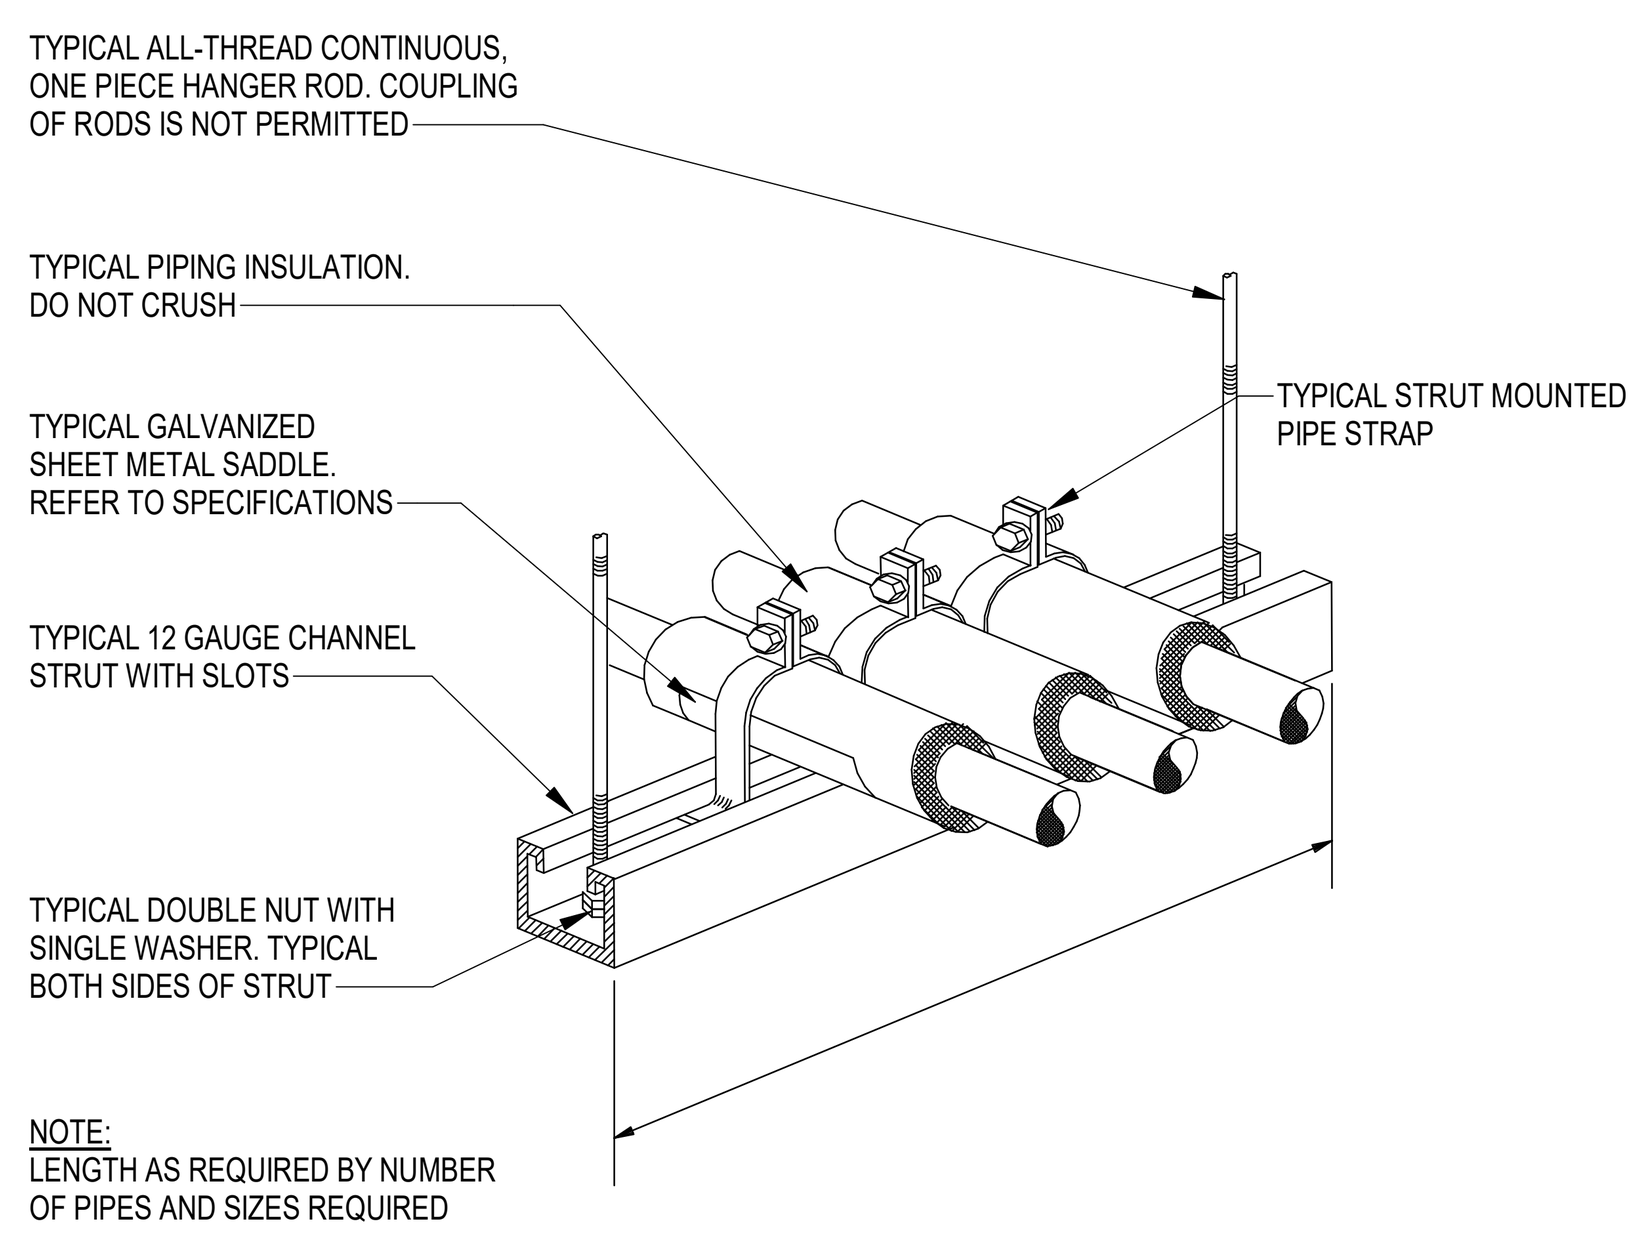

NOTE:
LENGTH AS REQUIRED BY NUMBER OF PIPES AND SIZES REQUIRED

1 TRAPEZE HANGER DETAIL
N.T.S.

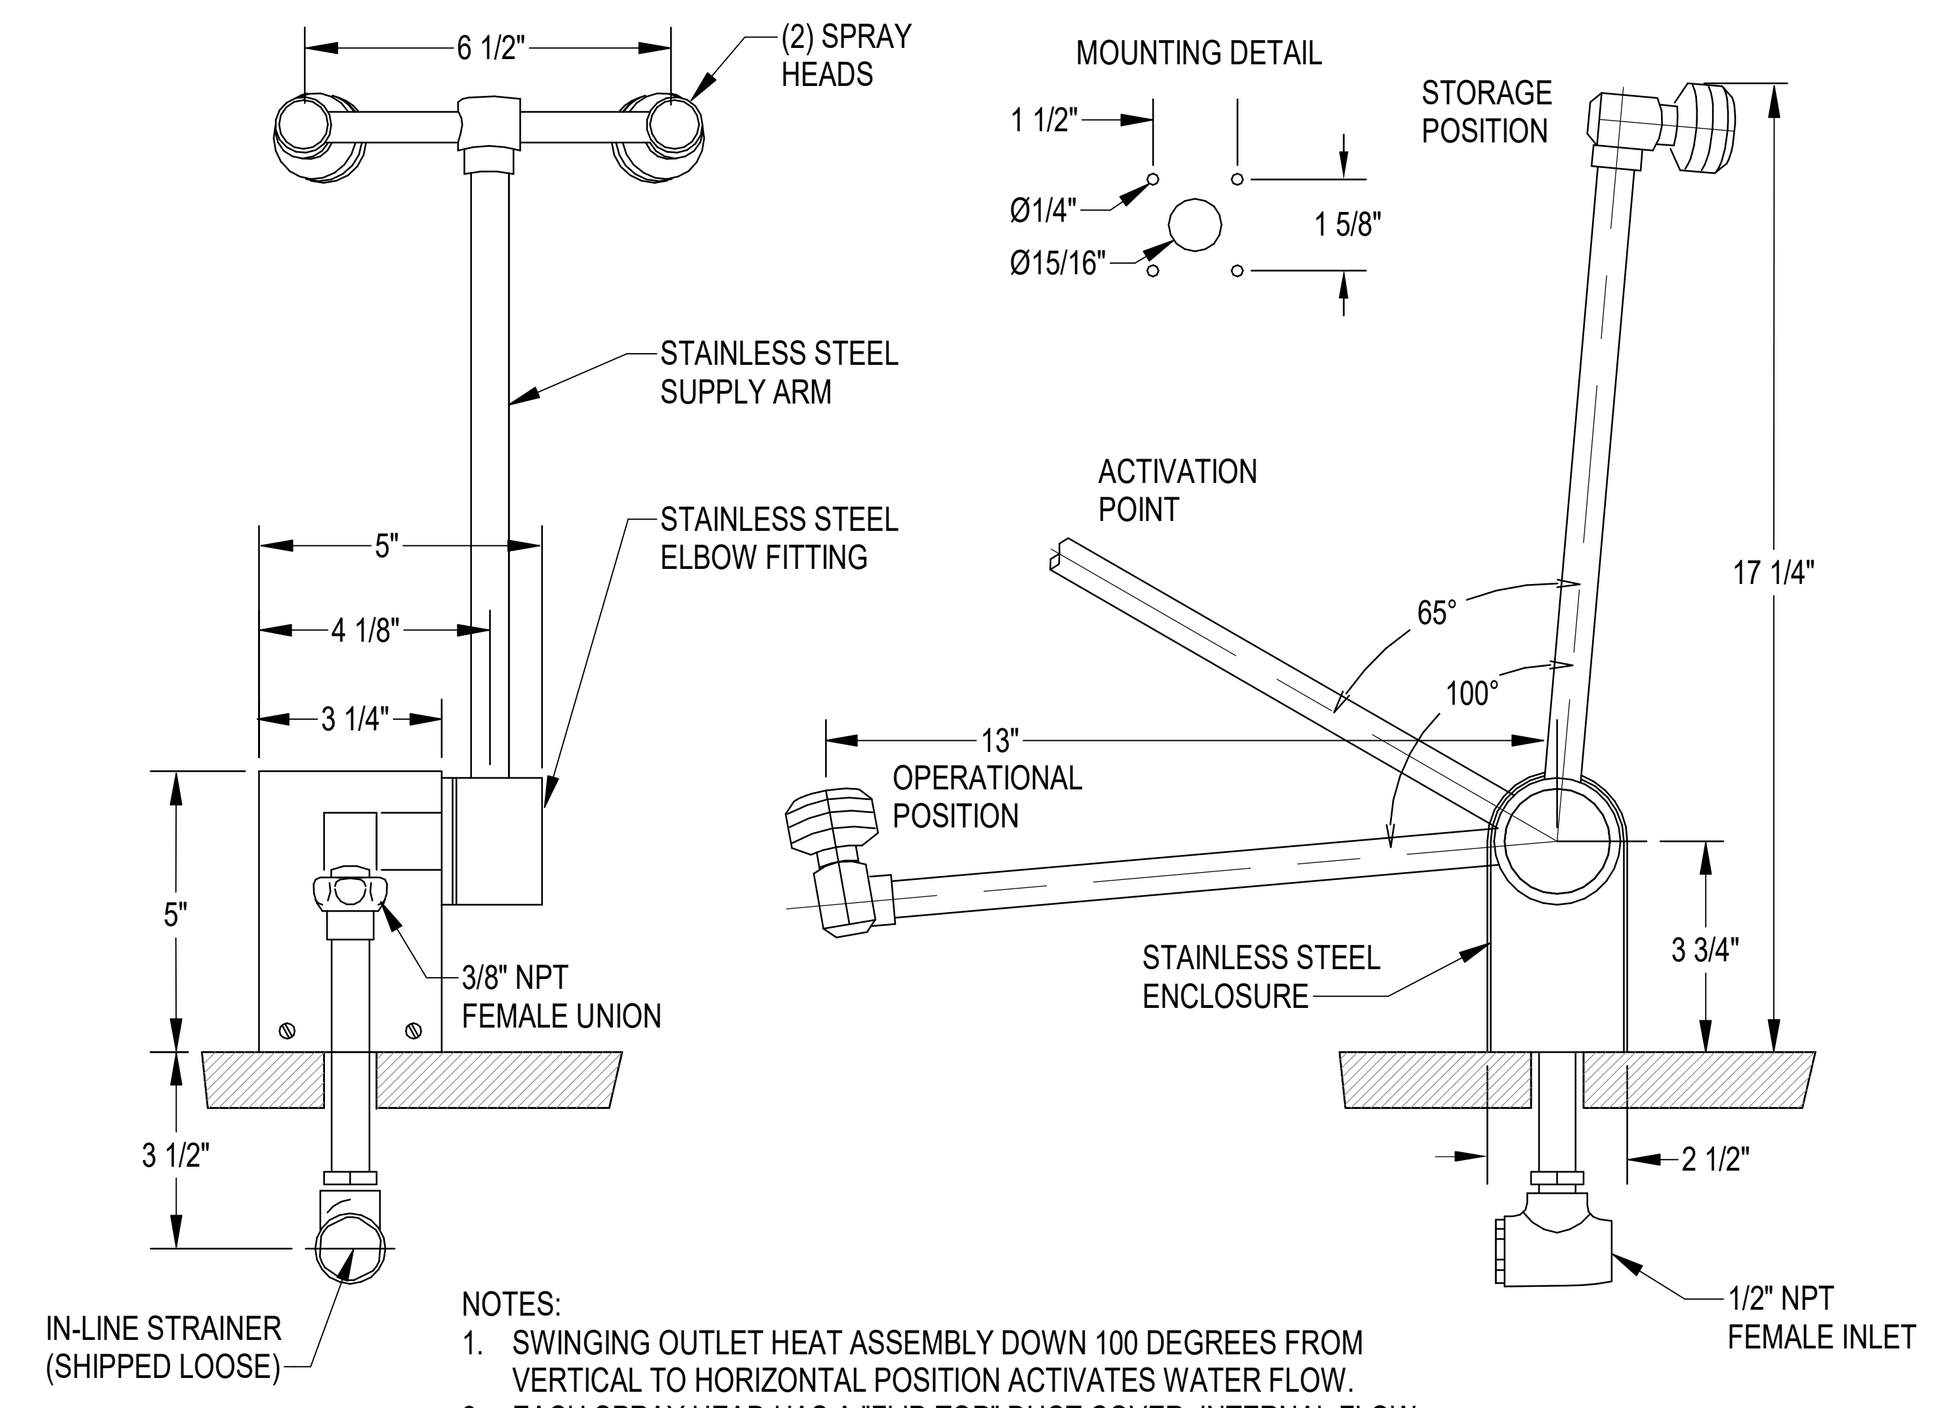

NOTES:
1. SWINGING OUTLET HEAT ASSEMBLY DOWN 100 DEGREES FROM VERTICAL TO HORIZONTAL POSITION ACTIVATES WATER FLOW.
2. EACH SPRAY HEAD HAS A "FLIP-TOP" DUCT COVER, INTERNAL FLOW CONTROL AND FILTER TO REMOVE IMPURITIES FROM THE WATER FLOW.
3. SECURE UNIT TO COUNTER USING HARDWARE SUPPLIED WITH UNIT. UNIT MOUNTS INTO COUNTERTOPS UP TO 2" THICK.
4. SUPPLY UNIT WITH IN-LINE STRAINER TO PROTECT SPRAY HEADS AND VALVE COMPONENTS FROM DEBRIS IN WATER LINE.
5. VALVE BEGINS TO OPEN AT "ACTIVATION POINT" SHOWN ABOVE.

2 DECK MOUNTED EYEWASH DETAIL
N.T.S.

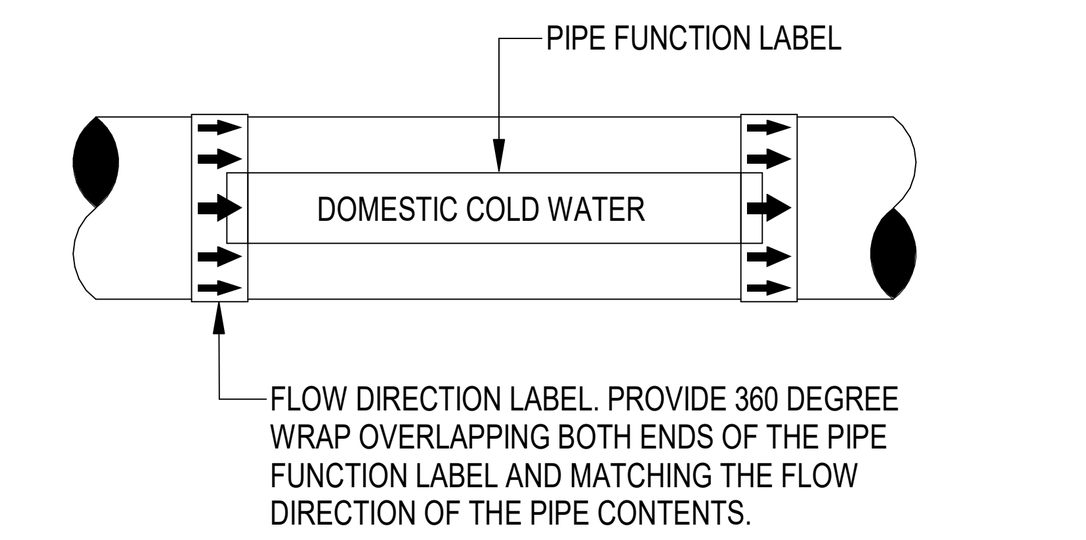

DETAIL NOTES:

A. PROVIDE A PIPE LABEL FOR EACH PIPE FUNCTION.

B. PROVIDE AT LEAST ONE LABEL ON EACH PIPE FOR EVERY ROOM THE PIPE PASSES THROUGH.

C. PROVIDE LABELS IN LARGE SPACES ON MAXIMUM 20' CENTERS FOR EVERY PIPE UNLESS OTHERWISE NOTED IN THE SPECIFICATIONS.

D. LABELS TO BE LOCATED IN AN EASILY VISIBLE LOCATION AS THEY WOULD NORMALLY BE SEEN. IE. ON THE BOTTOM HALF OF PIPES IN THE AIR AND ON THE TOP HALF OR SIDES OF PIPES MOUNTED LOW.

E. LABELS SHALL BE, COLOR CODED, PRE-PRINTED, SELF ADHESIVE VINYL.

F. SEE SPECIFICATION FOR OTHER REQUIREMENTS AND LIST OF PIPE FUNCTIONS.

3 PIPING IDENTIFICATION LABEL DETAIL
N.T.S.

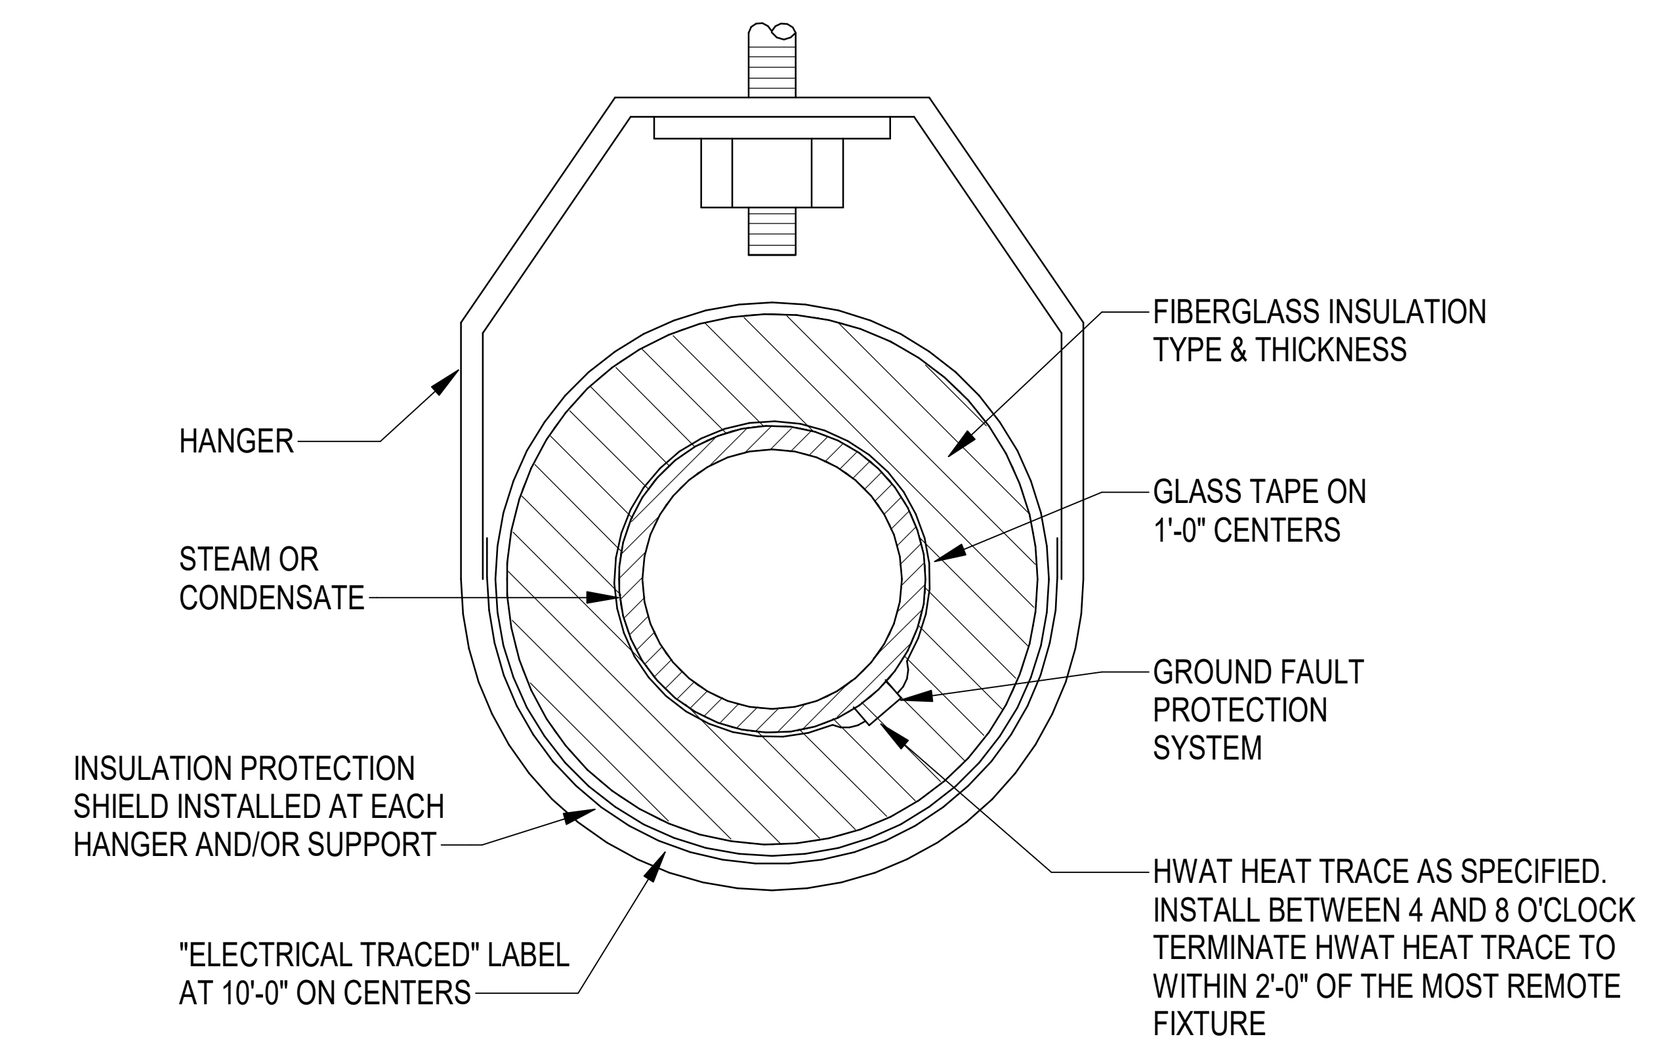

BASIS OF DESIGN: RAYCHEM CORP. HWAT-R2 (140°F)

4 TYPICAL HEAT TRACE DETAIL
N.T.S.

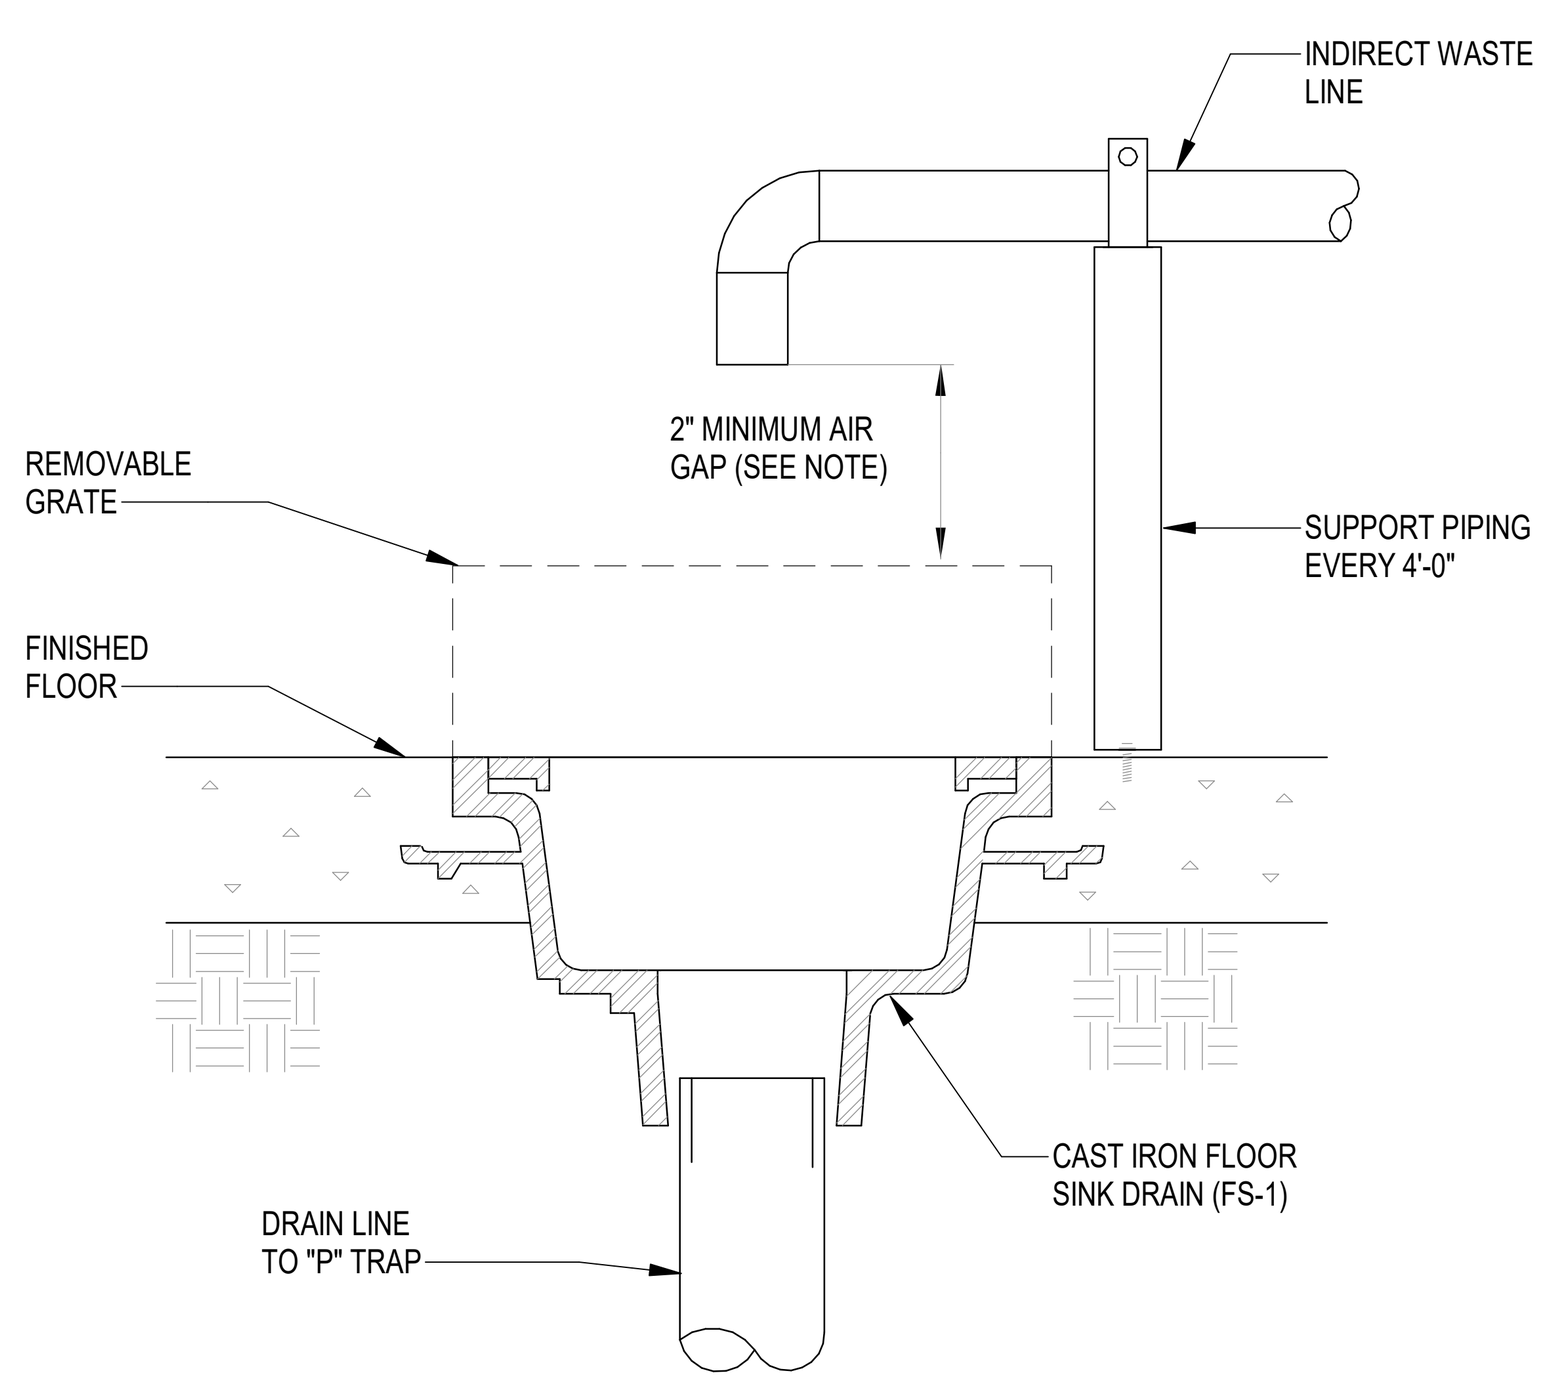

NOTE:
THE AIR GAP BETWEEN THE INDIRECT WASTE PIPE AND THE FLOOD LEVEL RIM OF THE WASTE RECEPTOR SHALL BE A MINIMUM OF TWICE THE EFFECTIVEOPENING OF THE INDIRECT WASTE PIPE.

5 CONDENSATE FLOOR DRAIN DETAIL
12" = 1'-0"

Revisions: Date:

CONSULTANT
Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD
THINKFORM architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP
COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: PLUMBING DETAILS	Phase: 100% CONTRACT DOCUMENTS FOR BIDDING	Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259		Project Number: 657-23-104JC
				Building Number: 1
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106		Drawing Number: P-501
		Issue Date: 06 MARCH 2026	Checked: CNB / Drawn: CSC	

VA FORM 08 - 6231

PLUMBING FIXTURE SCHEDULE

UNIT NO.	FIXTURE	MIXING VALVE NO.	CONNECTION SIZES: CW	CONNECTION SIZES: HW	CONNECTION SIZES: WASTE	CONNECTION SIZES: VENT	FIXTURE UNITS: WATER FIXTURE UNITS	FIXTURE UNITS: COLD WATER FIXTURE UNITS	FIXTURE UNITS: HOT WATER FIXTURE UNITS	FIXTURE UNITS: WASTE FIXTURE UNITS	FLUSH VALVE/FAUCET TYPE: MANUAL HANDLE	FLUSH VALVE/FAUCET TYPE: HARD WIRED SENSOR	FLUSH VALVE/FAUCET TYPE: BATTERY SENSOR	FLUSH VALVE/FAUCET TYPE: FOOT PEDAL	BASIS OF DESIGN: FIXTURE	BASIS OF DESIGN: FAUCET	COMMENTS
P-528	SINK (CRS, SINGLE COMPARTMENT, COUNTERTOP)	NA	1/2"	1/2"	2"	1-1/2	2	1.5	1.5	3	YES	NO	NO	NO	ELKAY LR2222	ELKAY LK406LGN08T4	PROVIDE GUARDIAN GBF1849R DECK MOUNTED EYEWASH WITH G6020 TMV.
FD-A	FLOOR DRAIN	NA	-	-	2	1-1/2	-	-	-	4	NO	NO	NO	NO	WATTS FD-100-B		PROVIDE TRAP GUARD BASIS OF DESIGN: RECTORSEAL MODEL: SURESEAL TRAP GUARD

MEDICAL GAS OUTLETS

MARK	DESCRIPTION	MOUNTING	QUANTITY OF OUTLETS	BASIS OF DESIGN	NOTES
MGO-1	MEDICAL GAS OUTLET	CEILING	1-OXY, 1-AIR & 1-VAC W/ HOSE ASSEMBLIES	AMICO / CHEMETRON	1

NOTES:
1. COORDINATE EXACT LOCATION OF CEILING OUTLETS WITH CT SCANNER LOCATION.

Revisions: Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM
architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: PLUMBING SCHEDULES

Approved:

Phase: 100% CONTRACT DOCUMENTS FOR BIDDING

FULLY SPRINKLERED

Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259

Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106

Issue Date: 06 MARCH 2026 | Checked: CNB | Drawn: CSC

Project Number: 657-23-104JC

Building Number: 1

Drawing Number: P-801

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

3/6/2026 12:02:33 PM

HVAC SYMBOL LEGEND

SYMBOL	DESCRIPTION
	CEILING DIFFUSER, ROUND NECK (CEILING DIFFUSERS ARE 4-WAY THROW UNO)
	CEILING RETURN
	CEILING EXHAUST
	CEILING DIFFUSER, RECTANGULAR OR SQUARE NECK (CEILING DIFFUSERS ARE 4-WAY THROW UNO)
	SUPPLY DIFFUSER OR GRILLE (VERTICAL MOUNT, SIDEWALL)
	RETURN / EXHAUST REGISTER OR GRILLE (VERTICAL MOUNT, SIDEWALL)
CO2	CARBON DIOXIDE SENSOR
T	THERMOSTAT / TEMPERATURE SENSOR
H	HUMIDISTAT / HUMIDITY SENSOR
	DUCT SMOKE DETECTOR
H	HUMIDITY SENSOR (DUCT MOUNTED)
CO2	CARBON DIOXIDE SENSOR (DUCT MOUNTED)
M	MOTORIZED CONTROL DAMPER
F	AIRFLOW SENSOR/STATION
T	TEMPERATURE SENSOR
SP	STATIC PRESSURE SENSOR
BD	BACKDRAFT DAMPER
	CEILING MOUNTED ACCESS DOOR

SYMBOL	DESCRIPTION
SD	SMOKE DAMPER (WITH ACCESS PANEL)
FD	FIRE DAMPER (WITH ACCESS PANEL)
MOD	MOTOR OPERATED CONTROL DAMPER (MOD)
VD	MANUAL BALANCING DAMPER
	DOOR GRILLE
UC	UNDERCUT DOOR
	ACCESS DOORS, VERTICAL OR HORIZONTAL
	FLEXIBLE CONNECTION
24x12	NEW DUCTWORK, FIRST DIMENSION IS SIDE SHOWN
UP DN	CHANGE OF ELEVATION
DOWN UP	DUCT ELBOW, SUPPLY OR OUTSIDE AIR
	DUCT ELBOW, EXHAUST AIR
	DUCT ELBOW, RETURN AIR
	FLEXIBLE DUCT

SYMBOL	DESCRIPTION
	TRANSITION, CONCENTRIC
	TRANSITION, ECCENTRIC
	TRANSITION, SQUARE TO ROUND
	SQUARE THROAT ELBOW W/ TURNING VANES
	RADIUS ELBOW
	RECTANGULAR / ROUND BRANCH TAKE-OFF OR ROUND / ROUND BRANCH TAKE-OFF
	SQUARE THROAT TEE W/ TURNING VANES
	RADIUS TEE
	RECTANGLE-TO-ROUND TAKE-OFF
	STANDARD BRANCH TAKE-OFF
	SPININ TAKE-OFF
EQUIPMENT	EQUIPMENT WITH MANUFACTURER'S CLEARANCE SHOWN IN DASHED LINES

HVAC ABBREVIATIONS

SYMBOL	DESCRIPTION
A/E	ARCHITECT / ENGINEER
ADA	AMERICANS WITH DISABILITIES ACT
AFF	ABOVE FINISHED FLOOR
AFR	ABOVE FINISHED ROOF
AHU	AIR HANDLING UNIT
AP	ACCESS PANEL
APPROX	APPROXIMATE
ASTM	AMERICAN STANDARDS TESTING MATERIALS
BAS	BUILDING AUTOMATION SYSTEM
BOP	BOTTOM OF PIPE
BHP	BRAKE HORSEPOWER
BFV	BUTTERFLY VALVE
BTU	BRITISH THERMAL UNIT
CAV	CONSTANT AIR VOLUME
CD	CONDENSATE
CFM	CUBIC FEET PER MINUTE
CL	CENTER LINE
CO	CLEAN OUT
COR	CONTRACTING OFFICER'S REPRESENTATIVE
CT	COOLING TOWER
CU	CONDENSING UNIT
DB	DRY BULB
DDC	DIRECT DIGITAL CONTROLS
DN	DOWN
EA	EXHAUST AIR
EAT	ENTERING AIR TEMPERATURE
ECC	ENGINEERING CONTROL CENTER
EER	ENERGY EFFICIENCY RATING
EQUIP	EQUIPMENT
ESP	EXTERNAL STATIC PRESSURE
ETR	EXISTING TO REMAIN
EWT	ENTERING WATER TEMPERATURE
EX	EXISTING
ºF	DEGREES FAHRENHEIT
FAS	FIRE ALARM SYSTEM
FD	FLOOR DAMPER
FE	FLUE EXHAUST
FLA	FULL LOAD AMPS
FPM	FEET PER MINUTE
GPM	GALLONS PER MINUTE
HP	HORSEPOWER
HR	HOUR
HZ	HERTZ
IPLV	INTEGRATED PART-LOAD VALUE
IN	INCHES
KW	KILOWATT
LAT	LEAVING AIR TEMPERATURE
LD	LINEAR DIFFUSER
LWT	LEAVING WATER TEMPERATURE

SYMBOL	DESCRIPTION
MAX	MAXIMUM
MBH	THOUSAND BTUs PER HOUR
MCA	MINIMUM CIRCUIT AMPS
MIN	MINIMUM
MOCP	MAXIMUM OVER CURRENT PROTECTION
MOD	MOTORIZED CONTROL DAMPER
NA	NOT APPLICABLE
NC	NORMALLY CLOSED
NO	NORMALLY OPEN
NTS	NOT TO SCALE
OA	OUTSIDE AIR
OAT	OUTSIDE AIR TEMPERATURE
PH	PHASE
PRV	PRESSURE REDUCING VALVE
PRS	PRESSURE REDUCING STATION
PSI	POUNDS PER SQUARE INCH
PSIG	PSI GAUGE
PTAC	PACKAGED TERMINAL AIR CONDITIONER
PVC	POLYVINYL CHLORIDE PIPE
RA	RETURN AIR
RH	RELATIVE HUMIDITY
RHC	REHEAT COIL
RPM	REVOLUTIONS PER MINUTE
RS/L	REFRIGERANT SUCTION & LIQUID LINES
RTU	ROOFTOP AIR CONDITIONING UNIT
SA	SUPPLY AIR
SF	SQUARE FEET
SP	STATIC PRESSURE
SPEC	SPECIFICATION
SS	STAINLESS STEEL
STD	STANDARD
SU	SLOPE UP (# INDICATES DISTANCE IN INCHES)
SD	SLOPE DOWN (# INDICATES DISTANCE IN INCHES)
TA	TRANSFER AIR
TDH	TOTAL DYNAMIC HEAD
TEMP	TEMPERATURE
TSP	TOTAL STATIC PRESSURE
TYP	TYPICAL
UL	UNDERWRITER'S LABORATORY
U/G	UNDERGROUND
UNO	UNLESS NOTED OTHERWISE
V/PH	VOTS/PHASE
VA	U.S. DEPARTMENT OF VETERANS AFFAIRS
VAV	VARIABLE AIR VOLUME
VFD	VARIABLE FREQUENCY DRIVE
VRF	VARIABLE REFRIGERANT FLOW
W	WATTS
W/	WITH
WB	WET BULB

GENERAL NOTES

1. DRAWINGS ARE DIAGRAMMATIC AND INDICATE GENERAL ARRANGEMENT OF SYSTEMS. PROVIDE COMPONENTS INDICATED IN DETAILS, RISER DIAGRAMS, CONTROL DIAGRAMS, AND/OR FLOW DIAGRAMS WHETHER OR NOT INDICATED ON PLANS AND VICE VERSA. WHERE A DISCREPANCY OR CONFLICT IS FOUND BETWEEN ONE DRAWING AND ANOTHER, OR BETWEEN A DRAWING AND APPLICABLE SPECIFICATIONS, NOTIFY THE ARCHITECT/ENGINEER IMMEDIATELY IN WRITTEN FORM. IN GENERAL, THE MOST STRINGENT REQUIREMENT SHALL GOVERN UNLESS THE DISCREPANCY CONFLICTS WITH APPLICABLE CODES OR OWNER'S DESIGN STANDARDS, WHEREIN THE CODE OR OWNER'S DESIGN STANDARDS SHALL GOVERN.
2. CONNECTION TO EQUIPMENT SHALL BE VERIFIED WITH MANUFACTURER'S CERTIFIED DRAWINGS. TRANSITIONS TO ALL EQUIPMENT SHALL BE VERIFIED AND PROVIDED FOR EQUIPMENT FURNISHED.
3. DIMENSIONS SHALL BE FIELD-VERIFIED AND COORDINATED PRIOR TO PROCUREMENT OR FABRICATION. COORDINATE THE WORK WITH OTHER TRADES INVOLVED. FIELD MODIFICATIONS SUCH AS OFFSETS IN PIPING OR DUCTWORK (INCLUDING DIVIDED DUCTWORK) NEEDED DUE TO OBSTRUCTIONS OR INTERFERENCES SHALL BE PROVIDED AT NO ADDITIONAL COST.
4. DUCT CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE SMACNA HVAC DUCT CONSTRUCTION STANDARD.
5. INSTALL ALL FIRE DAMPERS, SMOKE DAMPERS AND COMBINATION FIRE/SMOKE DAMPERS IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION DIRECTIONS. PROVIDE ACCESS DOORS TO ALLOW COMPLETE INSPECTION AND MAINTENANCE OF ALL DEVICES.
6. PROVIDE 1.5R ELBOWS IN DUCTWORK AS INDICATED. IF 1.5R ELBOWS DO NOT FIT, PROVIDE 1.0R ELBOWS. IF 1.0R ELBOWS DO NOT FIT, PROVIDE 90-DEGREE RECTANGULAR DUCT ELBOWS WITH TURNING VANES.
7. DUCT SIZES AND ALL OPENINGS THROUGH BUILDING CONSTRUCTION SHALL SUIT EQUIPMENT FURNISHED.
8. COORDINATE DIFFUSER, GRILLE AND REGISTER LOCATIONS WITH ARCHITECTURAL REFLECTED CEILING PLANS AND EQUIPMENT OF ALL TRADES.
9. LOCATE THERMOSTATS, TEMPERATURE SENSORS, HUMIDISTATS, AND HUMIDITY SENSORS AT 48" ABOVE FINISHED FLOOR UNLESS NOTED OTHERWISE. COORDINATE LOCATIONS WITH OTHER EQUIPMENT, FURNITURE, AND DOOR SWINGS.
10. ALL EQUIPMENT, DUCTWORK, ETC., SHALL BE SUPPORTED AS DETAILED AND/OR SPECIFIED. PROVIDE ADDITIONAL SUPPORTS AS REQUIRED TO PROVIDE A VIBRATION-FREE, RIGID INSTALLATION.
11. ALL DUCT SIZES SHOWN ARE INSIDE CLEAR DIMENSIONS.
12. DAMPERS AND INSIDES OF DUCTS VISIBLE THROUGH GRILLES, REGISTERS AND DIFFUSERS SHALL BE PAINTED FLAT BLACK.
13. REFER TO TYPICAL DETAILS FOR PIPING AND INSTALLATION OF EQUIPMENT.
14. TRAPPED CONDENSATE DRAINS FROM ALL MECHANICAL EQUIPMENT SHALL BE PROVIDED FOR PROPER DRAINAGE TO SUIT EQUIPMENT FURNISHED.
15. ACCESS PANELS IN DUCTWORK AND CEILINGS SHALL BE PROVIDED WHERE REQUIRED FOR OPERATION, BALANCING OR MAINTENANCE OF ALL MECHANICAL EQUIPMENT.
16. ALL DUCTWORK AND PIPING IS SHOWN SCHEMATICALLY. PROVIDE ALL TRANSITIONS, TURNING VANES, ELBOWS, FITTINGS, ETC., TO ALLOW SMOOTH FLOWS. ALL SPLIT DUCT FITTINGS SHALL TRANSITION TO FULL SIZE OF THE SUM OF BOTH BRANCHES, UPSTREAM OF SPLIT.
17. COORDINATE SIZE REQUIREMENTS OF ALL CONCRETE HOUSEKEEPING PADS UNDER ALL FLOOR-MOUNTED EQUIPMENT. SEE STRUCTURAL DRAWINGS FOR PAD DETAILS AND SPECIFICATIONS.
18. VERIFY FINISH WITH ARCHITECT PRIOR TO PURCHASING GRILLES, REGISTERS, DIFFUSERS, LOUVERS AND OTHER AIR DISTRIBUTION DEVICES.
19. PROVIDE FLEXIBLE DUCT CONNECTIONS ON ALL DUCTWORK CONNECTING TO FANS, AIR HANDLING UNITS, AND FAN COIL UNITS.
20. PROVIDE TRANSITIONS AT DIFFUSER NECKS AS REQUIRED TO MATCH SIZES OF FLEX DUCTS TO BE CONNECTED.
21. SLEEVE AND SEAL ALL PIPING PENETRATIONS THROUGH BUILDING PARTITIONS.
22. MAINTAIN CLEARANCE OF A MINIMUM OF 6" BETWEEN DUCTWORK, PIPING, EQUIPMENT, ETC., AND ALL FIRE RATED AND FIRE/SMOKE RATED PARTITIONS, TO ALLOW FOR INSPECTIONS OF RATED WALLS.
23. LOCATE ALL OUTSIDE AIR INTAKES A MINIMUM OF 25'-0" CLEAR FROM ALL PLUMBING VENTS AND EXHAUST AIR DISCHARGE LOCATIONS. LOWEST POINT OF EACH OUTSIDE AIR INTAKE ON ROOF SHALL BE A MINIMUM OF 24" ABOVE ROOF.
24. DUCT RUNOUTS TO DIFFUSERS SHALL MATCH THE SIZE OF THE DIFFUSER NECK.
25. UNLESS OTHERWISE NOTED, ALL EQUIPMENT AND VALVE DRAINS SHALL BE INDEPENDENTLY PIPED FULL SIZE TO THE NEAREST PLUMBING DRAIN.
26. MECHANICAL PRESS-CONNECT FITTINGS FOR COPPER PIPE AND TUBE ARE PROHIBITED. SEE PLUMBING DESIGN MANUAL FOR ADDITIONAL INFORMATION.

PIPING LEGEND

SYMBOL	DESCRIPTION
CHWS	CHILLED WATER SUPPLY
CHWR	CHILLED WATER RETURN
HHWS	HEATING HOT WATER SUPPLY
HHWR	HEATING HOT WATER RETURN
CD	CONDENSATE
HPS	HIGH PRESSURE STEAM SUPPLY (>60#)
MPS	MEDIUM PRESSURE STEAM SUPPLY (>15#, <60#)
LPS	LOW PRESSURE STEAM SUPPLY (0#-15#)
LPC	LOW PRESSURE CONDENSATE RETURN
	FLOW DIRECTION
	FLANGES
	UNION
	PIPE ANCHORS
	CONCENTRIC REDUCER
	ECCENTRIC REDUCER
	AUTOMATIC AIR VENT
	MANUAL VENT
FM	FLOW METER
	INLINE PUMP
	CAP
	HOSE CONNECTION
	ANGLE GLOBE VALVE
	RELIEF VALVE
	THERMOMETER
	PRESSURE GAUGE WITH SHUTOFF
	TEST PLUG (PRESSURE/TEMPERATURE)
	FLOW SWITCH
	PRESSURE SWITCH
EQUIP.	P-TRAP
	ELBOW, 90°
	ELBOW, 45°
R	45° PIPE RISE (R)/DROP (D)

SYMBOL	DESCRIPTION
	BALL VALVE
	GATE VALVE
	GLOBE VALVE
	BUTTERFLY VALVE
	THREE-WAY VALVE
	CHECK VALVE
	STRAINER
	CIRCUIT SETTER VALVE
	PRESSURE REGULATING VALVE
M	MOTORIZED ACTUATOR
	SOLENOID VALVE (2-POSTION W/ ACTUATOR)
	ELBOW, TURNED DOWN
	ELBOW, TURNED UP
	TEE, OUTLET DOWN
	TEE, OUTLET UP
	TEE, SIDE CONNECTION
	FLEX CONNECTION (DOUBLE SPHERE FOR PIPES 6" AND LARGER; SINGLE SPHERE FOR PIPES 4" AND SMALLER
	PNEUMATIC ACTUATOR

CONTROLS LEGEND

SYMBOL	DESCRIPTION
A	ALARM
	TEMPERATURE SENSOR
	RELATIVE HUMIDITY SENSOR
	PUSH-BUTTON OVERRIDE SWITCH
	PRESSURE SENSOR
i	HARD-WIRED INTERLOCK
	DRY CONTACT
CS	CURRENT SENSING STATUS
	STARTER
S	DUCT SMOKE DETECTOR
	IMMERSION TEMPERATURE TRANSMITTER W/ THERMOWELL
	EMERGENCY PUSHBUTTON
CO2	SPACE CARBON DIOXIDE SENSOR
R	REFRIGERANT SENSOR
H	SPACE HUMIDISTAT / HUMIDITY SENSOR
T	SPACE THERMOSTAT SENSOR
P	SPACE PRESSURE SENSOR
TS	MANUAL OVERRIDE TIMER SWITCH
	DUCT MOUNTED TEMPERATURE SENSOR
F	AIR FLOW SENSOR
	INDICATES AVERAGING ELEMENT SENSOR
	INDICATES PROBE SENSOR
	MAGNEHELIC DIFFERENTIAL PRESSURE GAUGE
24VAC	ACTUATOR W / 24VAC OR 120VAC AS INDICATED
24VAC	TWO POSITION VALVE W / 24VAC OR 120VAC AS INDICATED

SYMBOL	DESCRIPTION
DPIT	DIFF. PRESSURE INDICATING TRANSMITTER
VFD	VARIABLE FREQUENCY DRIVE
PT	PARTICULATE TRANSMITTER
	OPPOSED BLADE DAMPER
	PARALLEL BLADE DAMPER
AFSX	AIRFLOW SENSOR
CO2X	CARBON DIOXIDE SENSOR
CTX	CONDUCTIVITY TRANSMITTER
DX	DAMPER
DPSX	DIFFERENTIAL PRESSURE SENSOR
ECCX	ENGINEERING CONTROL CENTER
FTX	FLOW TRANSMITTER
HX	HUMIDITY TRANSMITTER
HOA	HAND SWITCH (HAND-OFF-AUTO SWITCH)
ITX	CURRENT TRANSMITTER
LCX	LEVEL CONTROLLER
LTX	LEVEL TRANSMITTER
PTX	PRESSURE TRANSMITTER
PDTX	PRESSURE DIFFERENTIAL TRANSMITTER
SPSX	STATIC PRESSURE SWITCH
TTX	TEMPERATURE TRANSMITTER
TSX	TEMPERATURE SWITCH (FREEZESTAT)
VCX	VALVE POSITION CONTROLLER
WFMX	WATER FLOW METER
WFSX	WATER FLOW SWITCH DIGITAL

DRAWING SYMBOLS

SYMBOL	DESCRIPTION
1 / H1	VIEW NUMBER SHEET NUMBER
A / H1	SECTION LETTER DRAWING NUMBER WHERE SHOWN
1	REVISION REFERENCE
1	SHEET NOTE CALLOUT
	CONNECT TO EXISTING
	DEMOLISH TO POINT INDICATED
2-AHU-3-1	BUILDING NO. WHERE EQUIPMENT IS LOCATED. EQUIPMENT ABBREVIATION. AN "EX" SHOWN IN FRONT OF EQUIPMENT TAGS NOTIFIES THAT EQUIPMENT IS EXISTING. LEVEL EQUIPMENT LOCATED ON / LEVEL IT SERVES AHU NUMBER TYPICAL UNIT NUMBER; AHU NO. 1, LOCATED ON LEVEL 3, LOCATED IN BLDG. 2
26-TU-1-5	BUILDING NO. WHERE EQUIPMENT IS LOCATED ITEM (TERMINAL UNIT SHOWN) SERVED BY AIR HANDLER UNIT NUMBER ITEM NUMBER TYPICAL UNIT NUMBER; TU NO. 5, SERVED BY AHU NO. 1, LOCATED IN BLDG. 26
S1 200	DEVICE MARK AND NUMBER (S = SUPPLY, R = RETURN, E = EXHAUST) DEVICE FLOW RATE (CFM) TYPICAL AIR DISTRIBUTION DEVICE TAG
12X10 SA	INTERIOR DUCT DIMENSIONS IN INCHES. FIRST DIMENSION IS SIDE SHOWN. SYSTEM TYPE (SA = SUPPLY AIR , RA = RETURN AIR, OA = OUTSIDE AIR, EA = EXHAUST AIR, SS EA = STAINLESS STEEL EXHAUST) TYPICAL DUCTWORK TAG

BASIC MATERIALS

SYMBOL	DESCRIPTION
	EXISTING TO BE REMOVED (HEAVY, DASHED LINE)
	EXISTING TO REMAIN (THIN, HALFTONED, SOLID LINE)
	NEW (HEAVY, SOLID LINE)

APPLICABLE CODES

1. VA HVAC DESIGN MANUAL (HVACDM) REV. MAR 1, 2024
2. VA SEISMIC DESIGN REQUIREMENTS (SDR) 2023 EDITION
3. VA SUSTAINABLE DESIGN MANUAL (SDM) REV. AUGUST 18, 2017
4. NATIONAL INSTITUTES OF HEALTH (NIH) DESIGN REQUIREMENTS MANUAL 2020 EDITION
5. INTERNATIONAL BUILDING CODE (IBC) 2021 EDITION
6. INTERNATIONAL MECHANICAL CODE (IMC) 2021 EDITION
7. INTERNATIONAL FUEL AND GAS CODE (IFGC) 2021 EDITION
8. INTERNATIONAL PLUMBING CODE (IPC) 2021 EDITION
9. INTERNATIONAL ENERGY CONSERVATION CODE (IECC) 2021 EDITION
10. AMERICAN SOCIETY OF HEATING, REFRIGERATION AND AIR-CONDITIONING ENGINEERS (ASHRAE):
    A. SAFETY STANDARD FOR REFRIGERATION SYSTEMS (ASHRAE 15 & 34) 2022 EDITION
    B. VENTILATION FOR ACCEPTABLE INDOOR AIR QUALITY (ASHRAE 62.1) 2022 EDITION
    C. ENERGY STANDARD FOR BUILDINGS (ASHRAE 90.1) 2022 EDITION
    D. VENTILATION OF HEALTH CARE FACILITIES (ASHRAE 170) 2021 EDITION
11. NATIONAL FIRE PROTECTION ASSOCIATION (NFPA):
    A. COMPRESSED GASES AND CRYOGENIC FLUIDS CODE, NFPA 55 2020 EDITION
    B. NATIONAL ELECTRICAL CODE (NEC) 2023 EDITION
    C. NATIONAL FIRE ALARM CODE (NFPA 72) 2022 EDITION
    D. STANDARD FOR THE INSTALLATION OF AIR-CONDITIONING AND VENTILATING SYSTEMS (NFPA 90A) 2021 EDITION
    E. STANDARD FOR THE INSTALLATION OF WARM AIR HEATING AND AIR-CONDITIONING SYSTEMS (NFPA 90B) 2021 EDITION
    F. STANDARD FOR SMOKE CONTROL SYSTEMS (NFPA 92) 2021 EDITION
    G. STANDARD FOR VENTILATION CONTROL AND FIRE PROTECTION OF COMMERCIAL COOKING (NFPA 96) 2023 EDITION
    H. HEALTH CARE FACILITIES CODE (NFPA 99) 2021 EDITION
    I. LIFE SAFETY CODE (NFPA 101) 2021 EDITION
12. APPLICABLE PUBLICATIONS INCLUDING BUT NOT LIMITED TO:
    A. ARCHITECTURAL BARRIERS ACT ACCESSIBILITY STANDARD (ABAAS)
    B. AMERICANS WITH DISABILITIES ACT (ADA)
    C. AIR-CONDITIONING, HEATING, AND REFRIGERATION INSTITUTE (AHRI)
    D. AIR MOVEMENT AND CONTROL ASSOCIATION (AMCA)
    E. AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)
    F. ASSOCIATION FOR RUBBER PRODUCTS MANUFACTURERS (ARPM)
    G. AMERICAN SOCIETY OF TESTING AND MATERIALS (ASTM)
    H. MANUFACTURERS STANDARDIZATION SOCIETY OF THE VALVE AND FITTINGS INDUSTRY, INC. (MSS)
    I. OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA)
    J. SHEET METAL AND AIR CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION (SMACNA)
13. APPLICABLE STANDARDS, REGULATIONS, AND PRACTICES OF THE OWNER

SHEET LIST

SHEET NUMBER	SHEET NAME
M-001	MECHANICAL NOTES, LEGENDS, & SYMBOLS
MD100	SECOND FLOOR PLAN - MECHANICAL - DEMOLITION
MH100	FIRST FLOOR EQUIPMENT YARD - MECHANICAL
MH101	SECOND FLOOR PLAN - MECHANICAL - ROOM A259
M-301	MECHANICAL SECTIONS
M-501	MECHANICAL DETAILS
M-701	MECHANICAL CONTROLS
M-801	MECHANICAL SCHEDULES

NOTE: SOME SYMBOLS AND ABBREVIATIONS SHOWN MAY NOT PERTAIN TO THIS PROJECT

Revisions:

Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
SBA SERVICE-DISABLED VETERAN-OWNED CERTIFIED
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
MECHANICAL NOTES, LEGENDS, & SYMBOLS	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
			Building Number: 1
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Drawing Number: M-001
		Issue Date: 06 MARCH 2026 / Checked: CNB / Drawn: CSC	

DRAWING NOTES:

1. EXISTING CONDITIONS SHOWN ARE BASED ON LIMITED RECORD DRAWINGS AND SITE EXPLORATION. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AND NOTIFY THE COR IN WRITING ON ANY DEVIATIONS.

CODED NOTES:

1. REMOVE EXISTING FAN COIL UNIT AND ALL ASSOCIATED DUCTWORK, PIPING, PIPING ACCESSORIES, CONTROLS, AND AIR DEVICES.
2. REMOVE EXISTING PIPING BACK TO POINT INDICATED. PROVIDE AN ISOLATION VALVE AND PREPARE FOR CONNECTION TO NEW HUMIDIFIER.
3. REMOVE EXISTING STEAM HUMIDIFIER AND ALL ASSOCIATED PIPING, ACCESSORIES, AND CONTROLS.
4. REMOVE EXISTING STEAM RADIATORS. TERMINATE STEAM PIPING BELOW FLOOR WITH ISOLATION VALVE AND CAP.
5. REMOVE EXISTING CONDENSATE PIPING AND CONNECTION TO EXISTING SANITARY SYSTEM.
6. REMOVE EXISTING PIPING BACK TO POINT INDICATED. PROVIDE ISOLATION VALVE AND CAP.

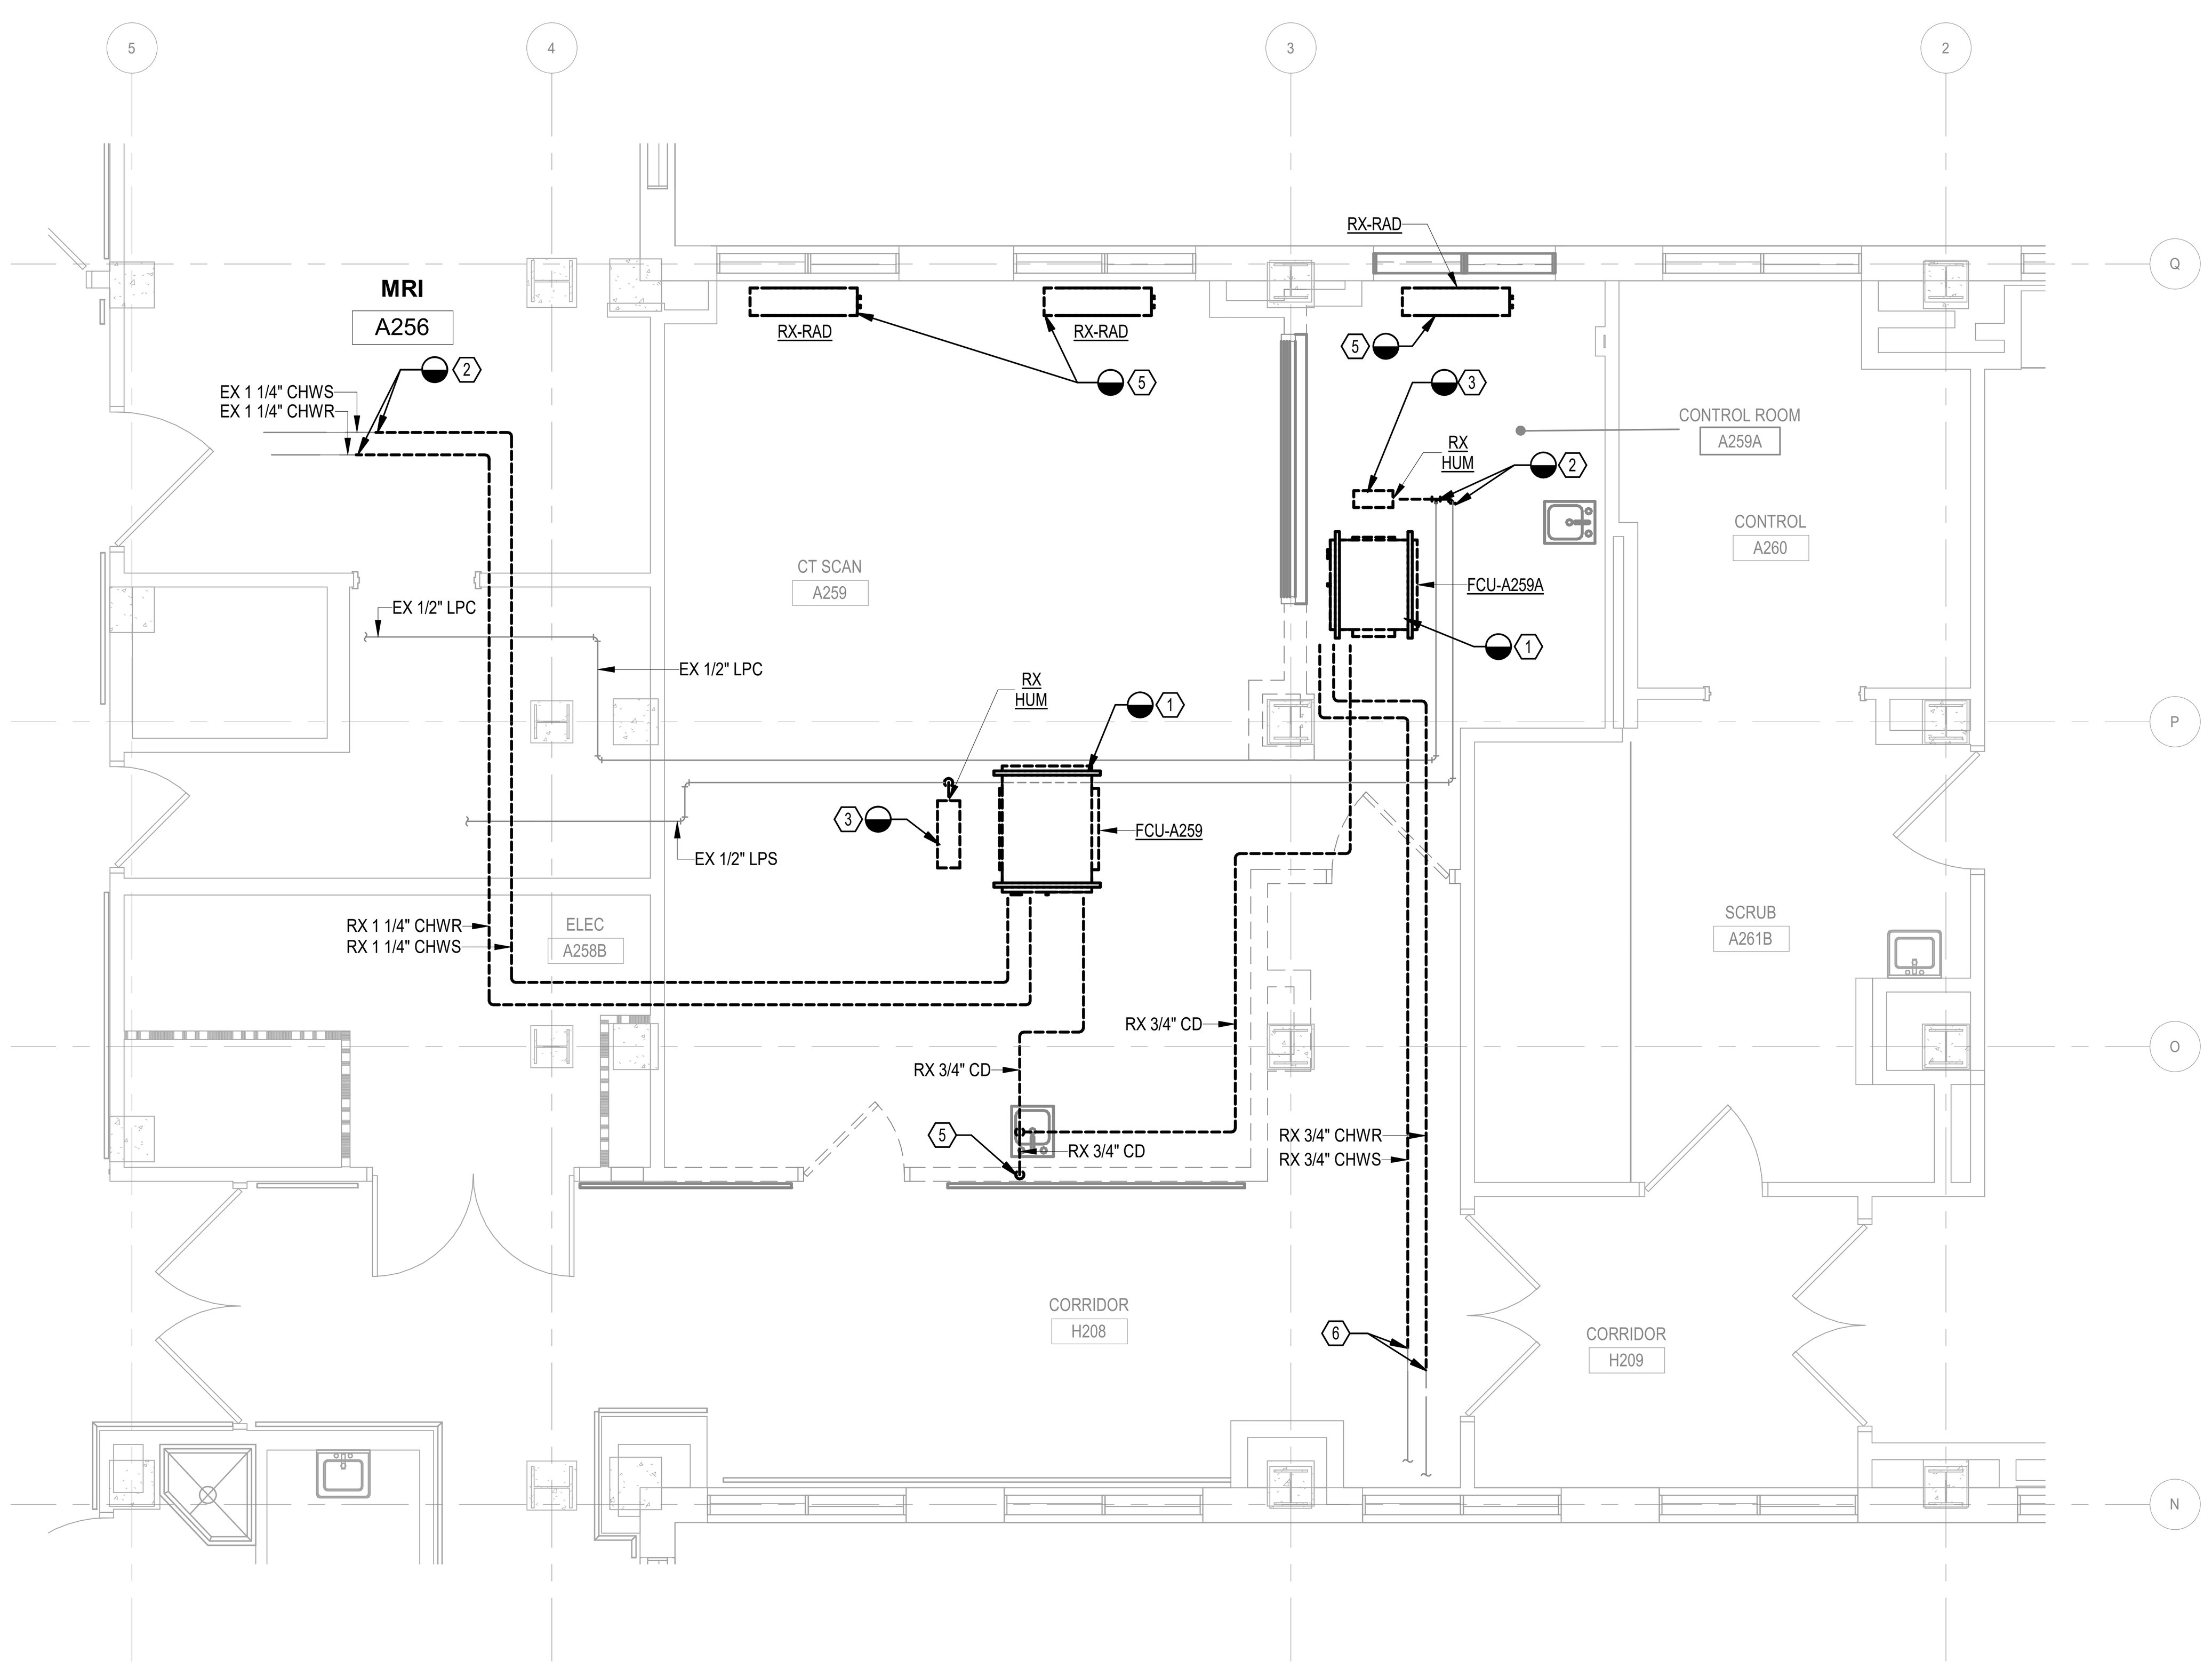

1 SECOND FLOOR PLAN - MECHANICAL PIPING - DEMOLITION
1/4" = 1'-0"

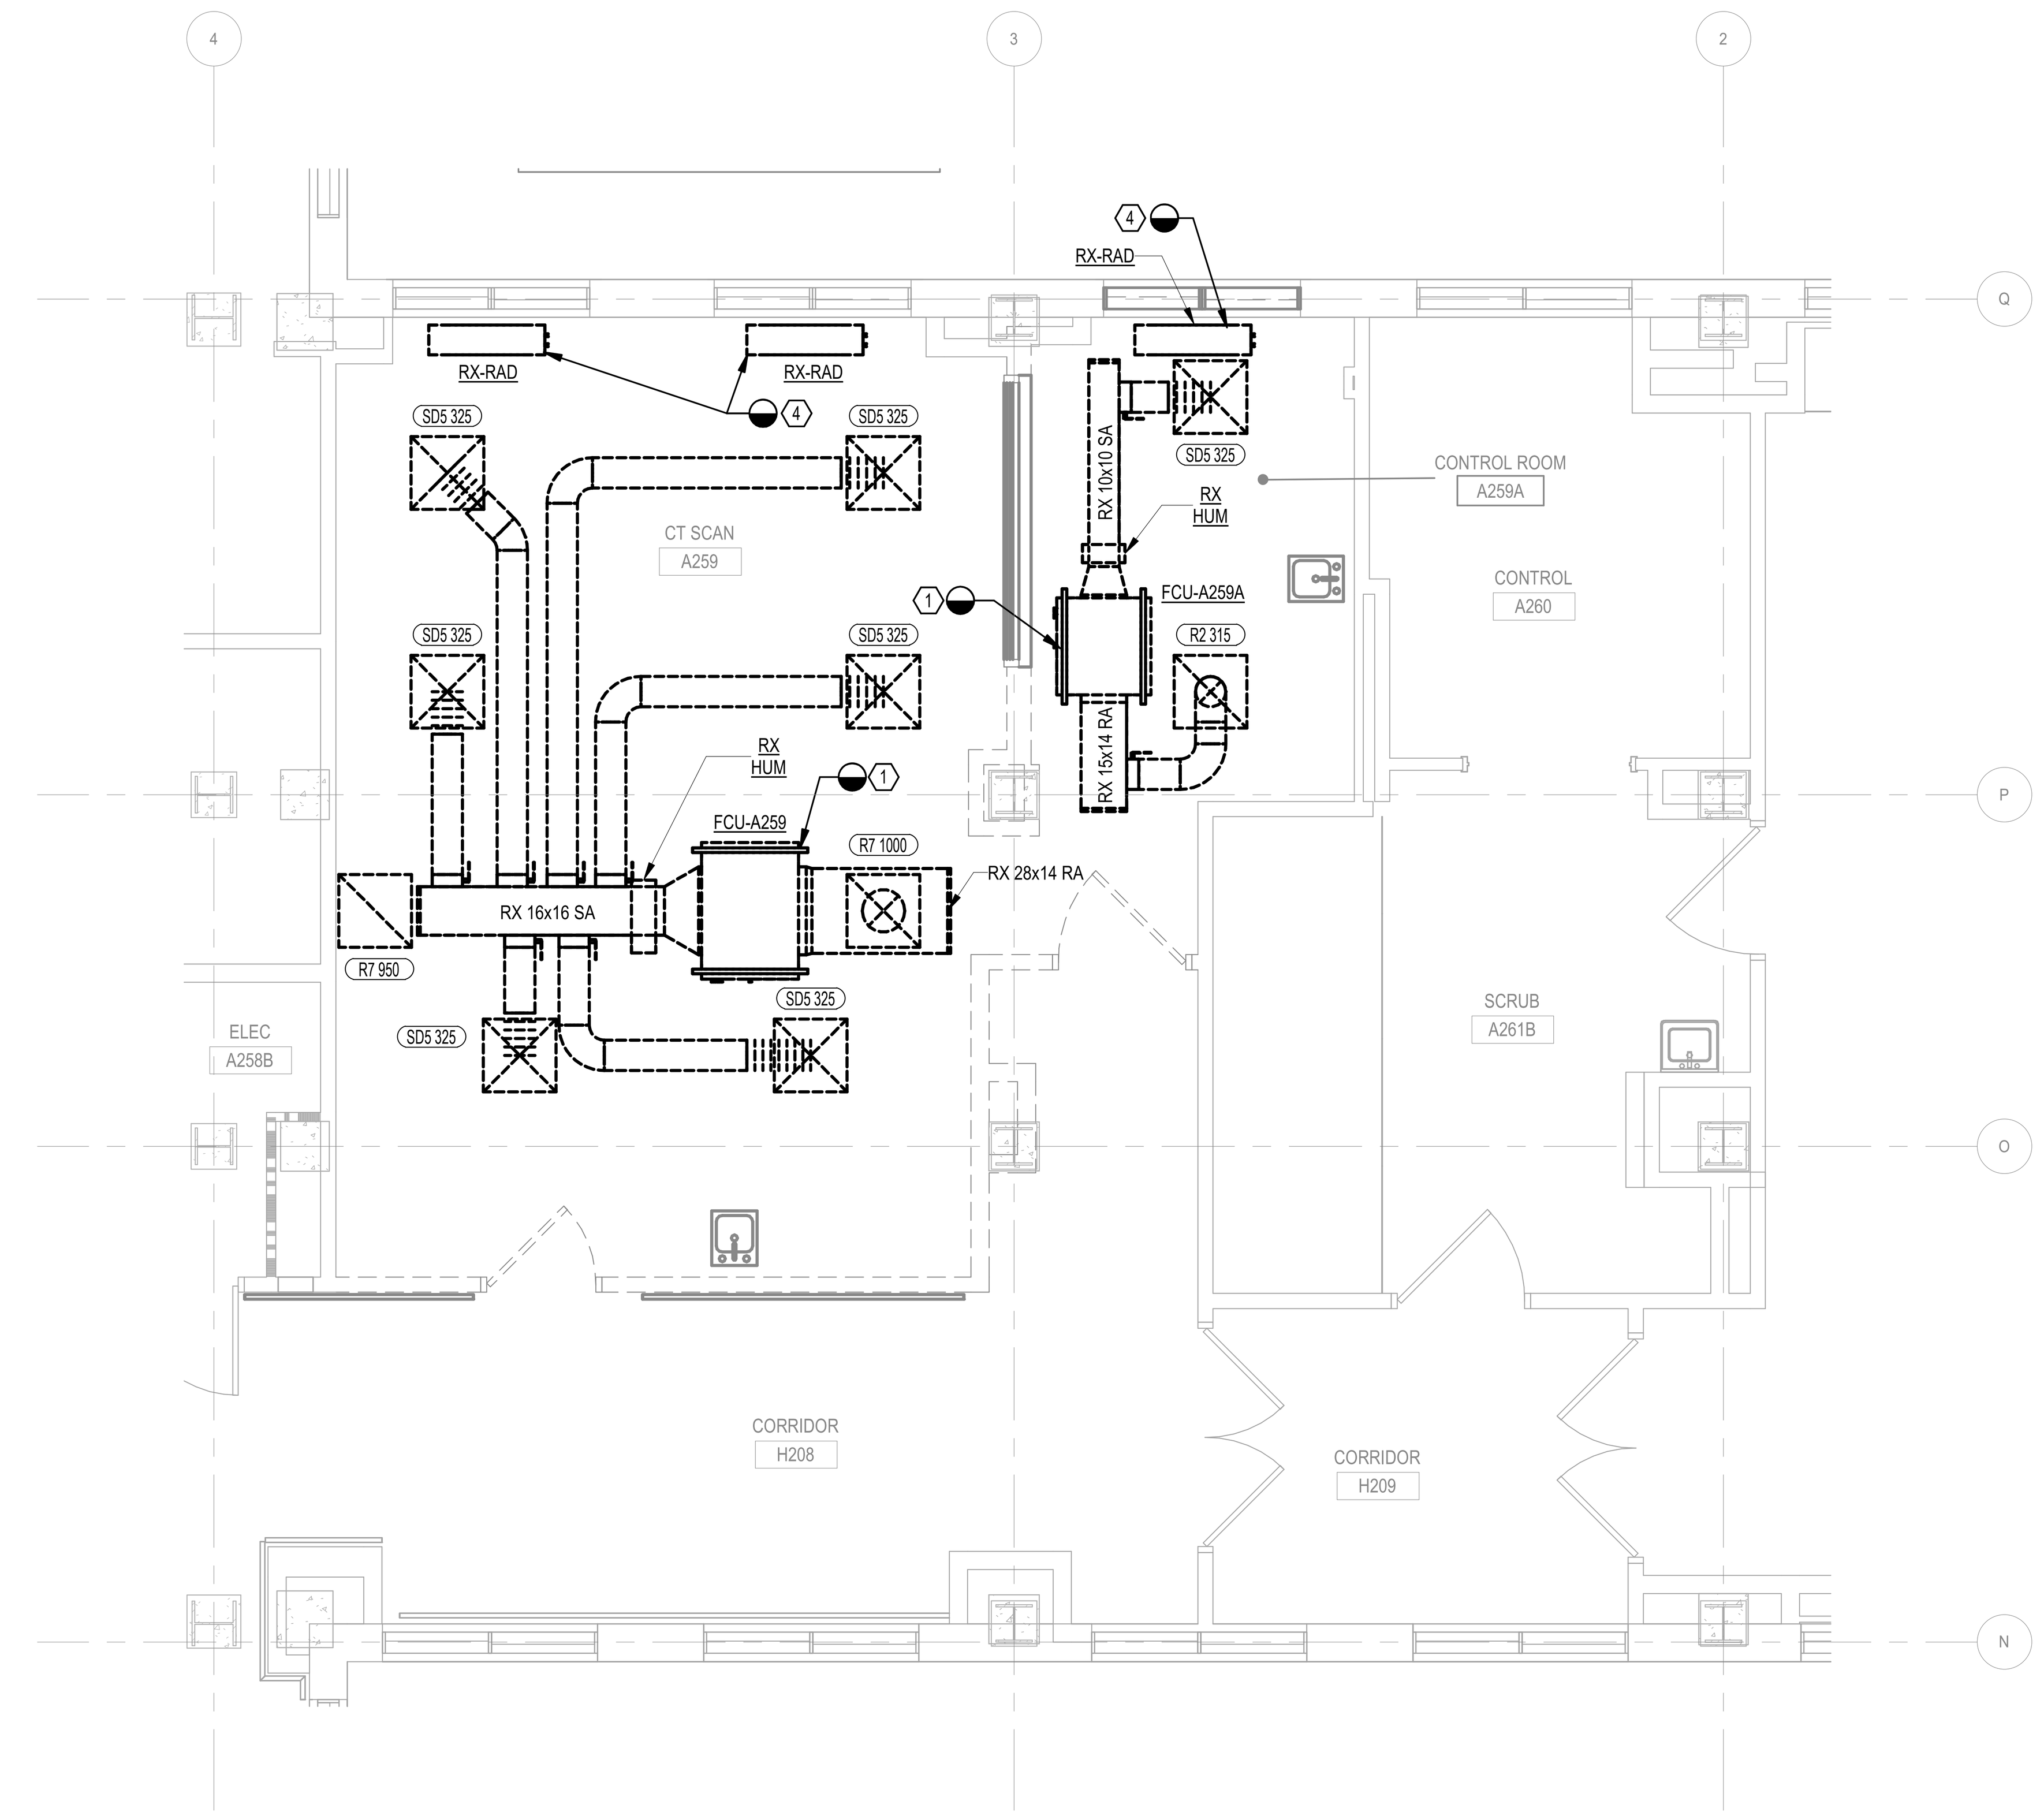

2 SECOND FLOOR PLAN - MECHANICAL HVAC - DEMOLITION
1/4" = 1'-0"

KEY PLAN

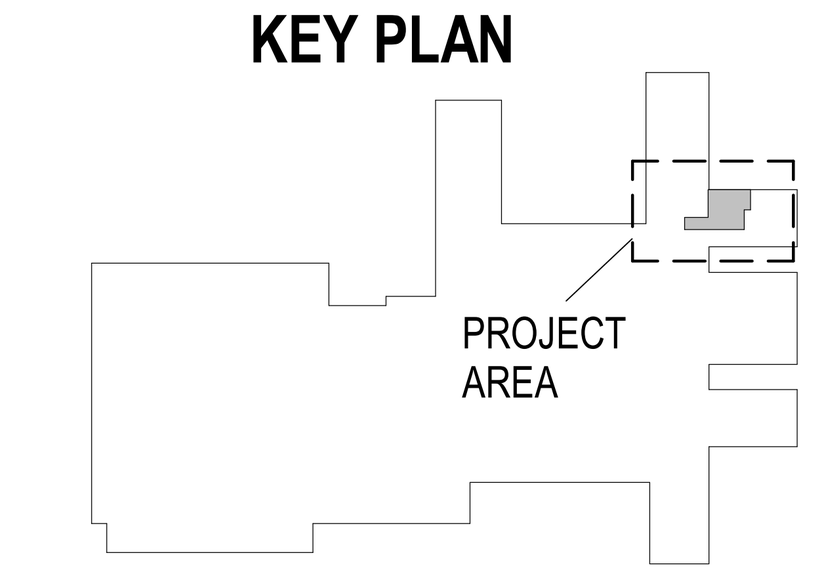

N 0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
SECOND FLOOR PLAN - MECHANICAL - DEMOLITION	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
			Building Number: 1
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Drawing Number
		Issue Date: 06 MARCH 2026 / Checked: CNB / Drawn: CSC	MD100

VA FORM 08 - 6231

3/6/2026 12:01:12 PM

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

DRAWING NOTES:

1. EXISTING CONDITIONS SHOWN ARE BASED ON LIMITED RECORD DRAWINGS AND SITE EXPLORATION. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AND NOTIFY THE COR IN WRITING ON ANY DEVIATIONS.
2. CONTRACTOR SHALL NOTIFY VA COR A MINIMUM OF FOUR WEEKS PRIOR TO ANY SHUTDOWNS OF UTILITIES.

CODED NOTES:

1. CONNECT TO EXISTING LOW PRESSURE STEAM AND CONDENSATE PIPING FOR AHU HEATING AND HUMIDIFICATION.
2. MEDICAL EQUIPMENT CHILLER PROVIDED BY MEDICAL EQUIPMENT SUPPLIER. COORDINATE FINAL EQUIPMENT PAD SIZE, PIPING CONDUIT AND PIPING / HOSE ROUTING WITH EQUIPMENT SUPPLIER.
3. ROUTE REFRIGERANT PIPING ALONG EXTERIOR WALL FROM INDOOR UNIT TO OUTDOOR UNIT. ROUTE PIPING HIGH ENOUGH TO ALLOW ACCESS TO PIPING / UTILITY TUNNEL.
4. CHILLED WATER HOSE FROM AIR COOLED CHILLER TO HEAT EXCHANGER. EQUIPMENT AND PIPING PROVIDED BY EQUIPMENT MANUFACTURER AND INSTALLED BY MECHANICAL CONTRACTOR. PROVIDE CONDUIT AS REQUIRED BY EQUIPMENT MFR. PER MFRS DOCUMENTATION, CHILLED WATER CONTAINS 40% GLYCOL SOLUTION.
5. PROVIDE HEAT TRACING FOR LOW PRESSURE STEAM AND CONDENSATE. REFER TO ELECTRiCAL PLANS FOR POWER REQUIREMENTS. REFER TO DETAIL 11/M-501.
6. PROVIDE PIPING SUPPORTS FOR LOW PRESSURE STEAM AND CONDENSATE PIPING. SLOPE CONDENSATE PIPING BACK TO MAIN IN TRENCH AS SHOWN. REFER TO 10/M-501 FOR PIPING SUPPORT DETAIL.
7. CT MANUFACTURER SUPPLIED WATER HOSES FROM THE HEAT EXCHANGER TO THE OUTDOOR UNIT TO BE INSTALLED BY THE MECHANICAL CONTRACTOR. THE HOSES SHALL BE RUN IN (2) 3" CONDUITS OR ACCORDING TO CODE.

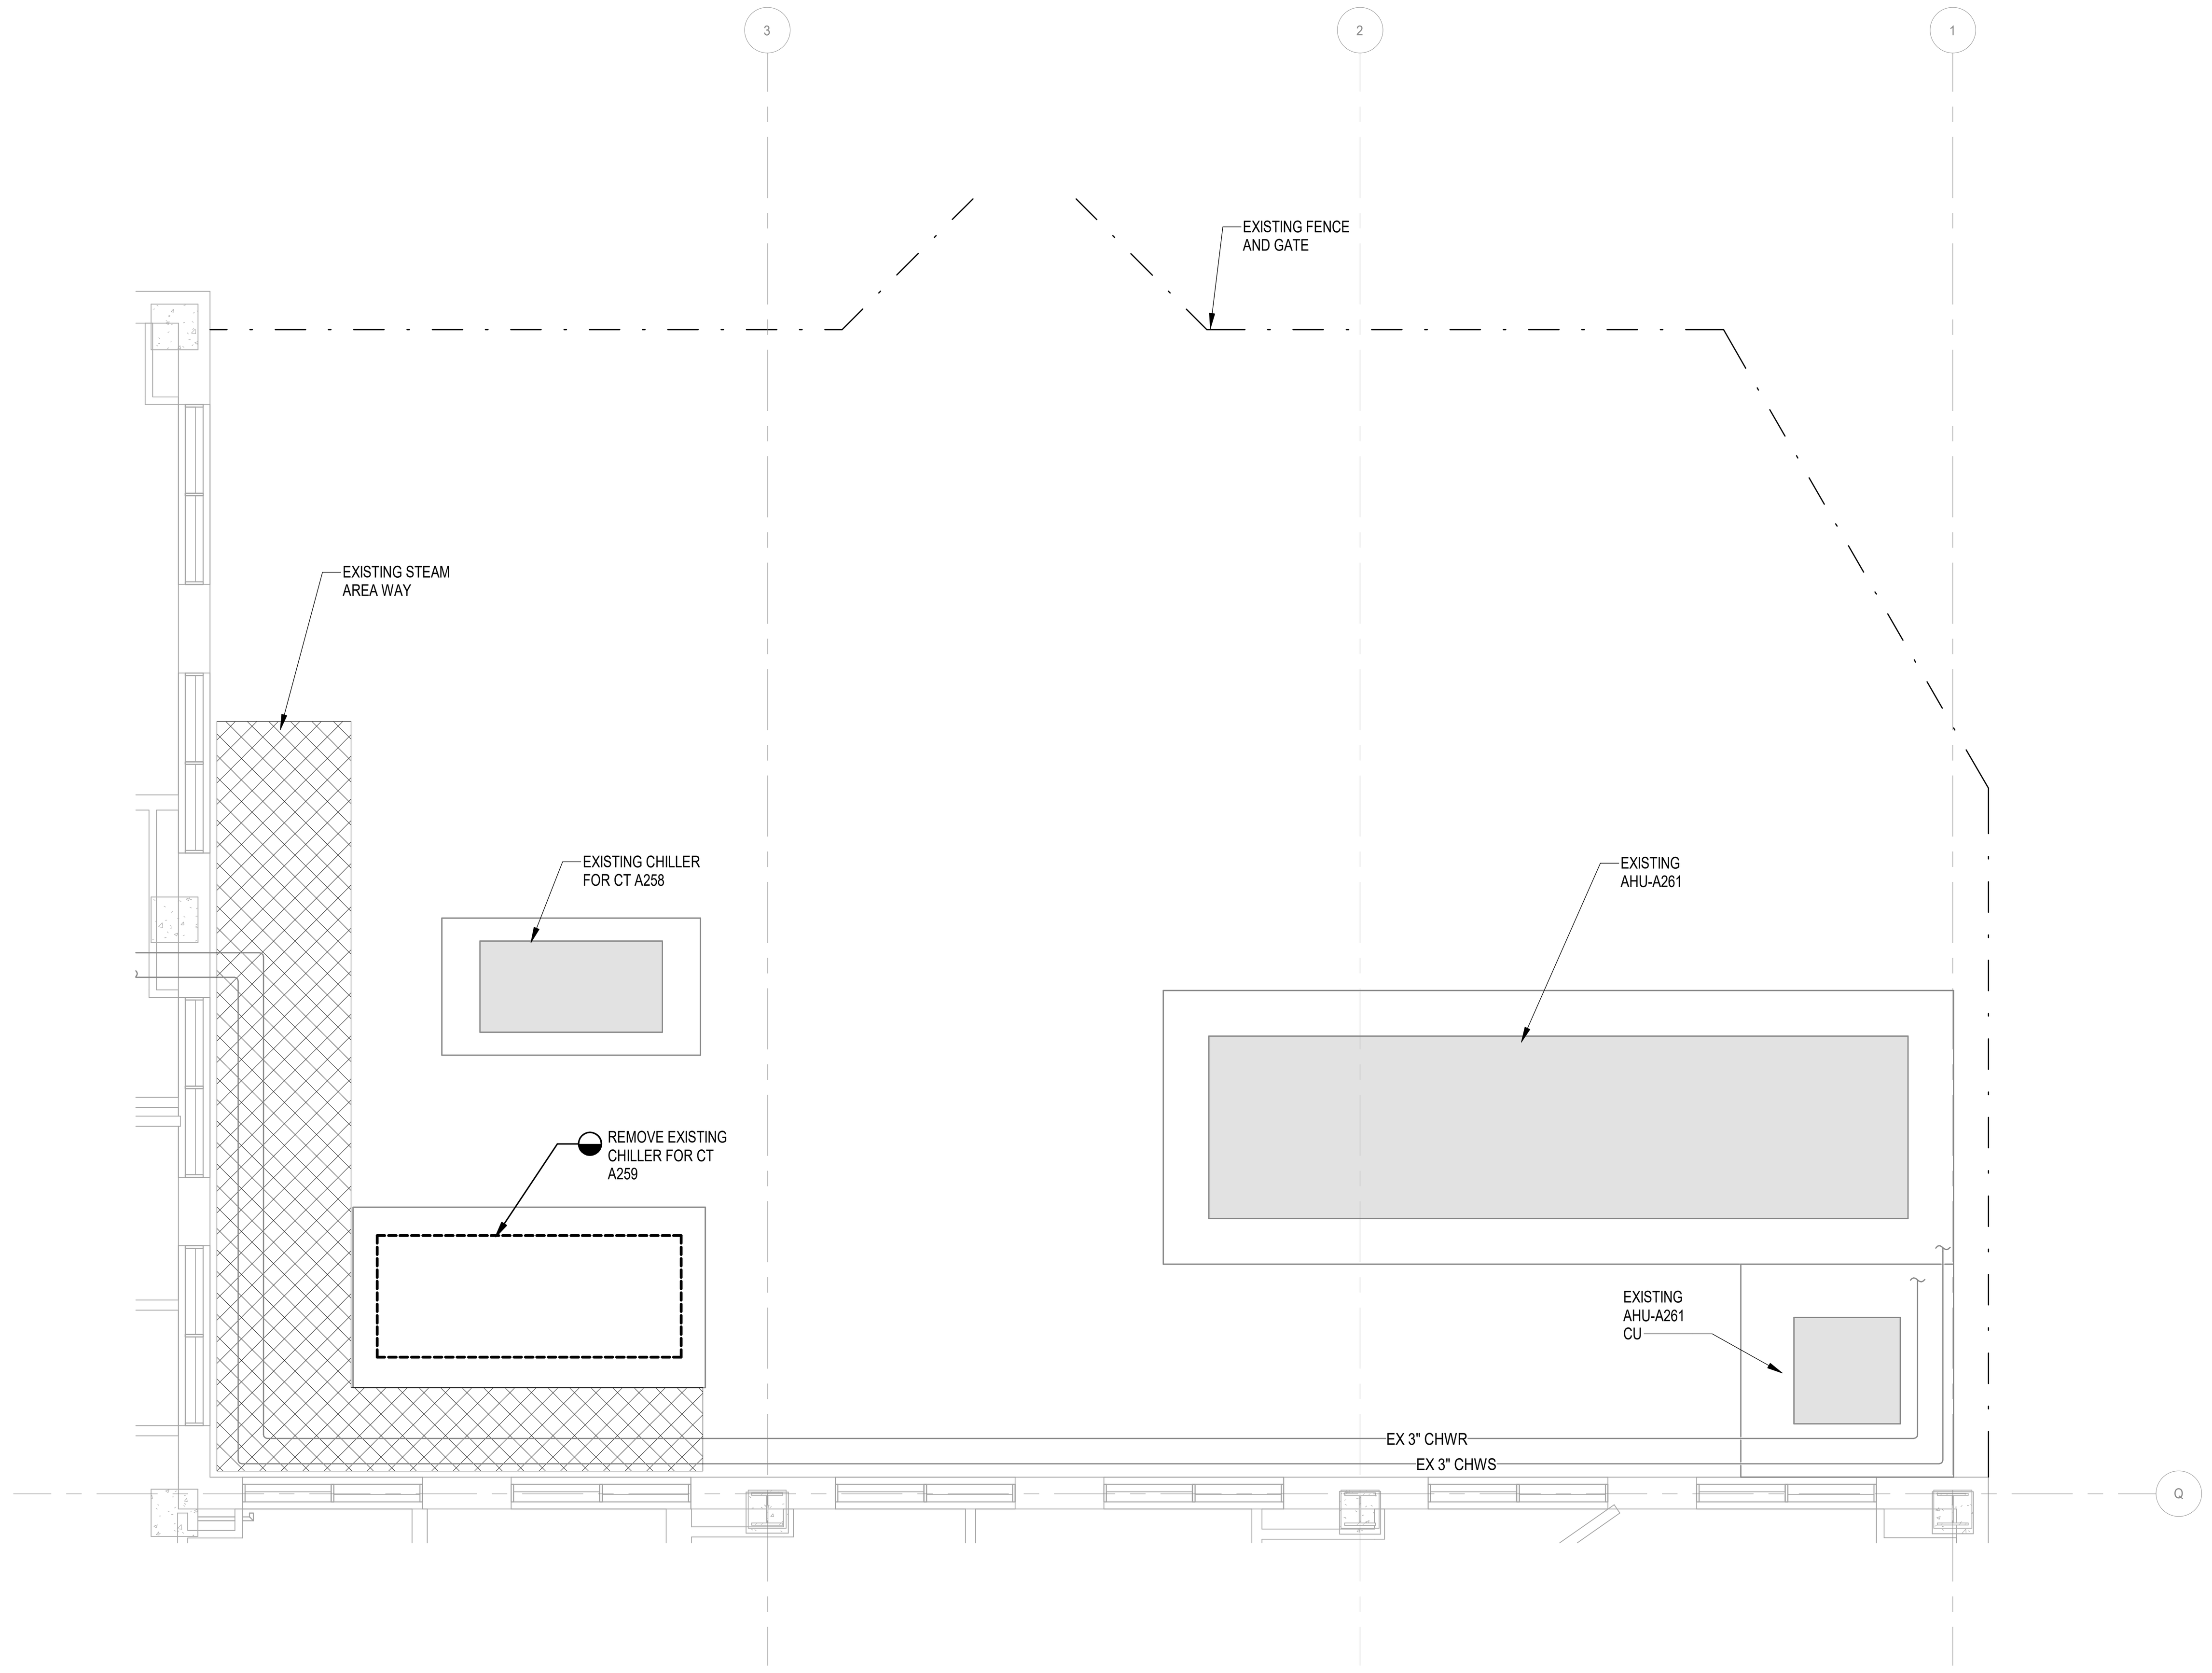

1 FIRST FLOOR PLAN - MECHANICAL HVAC - DEMOLITION
1/4" = 1'-0"

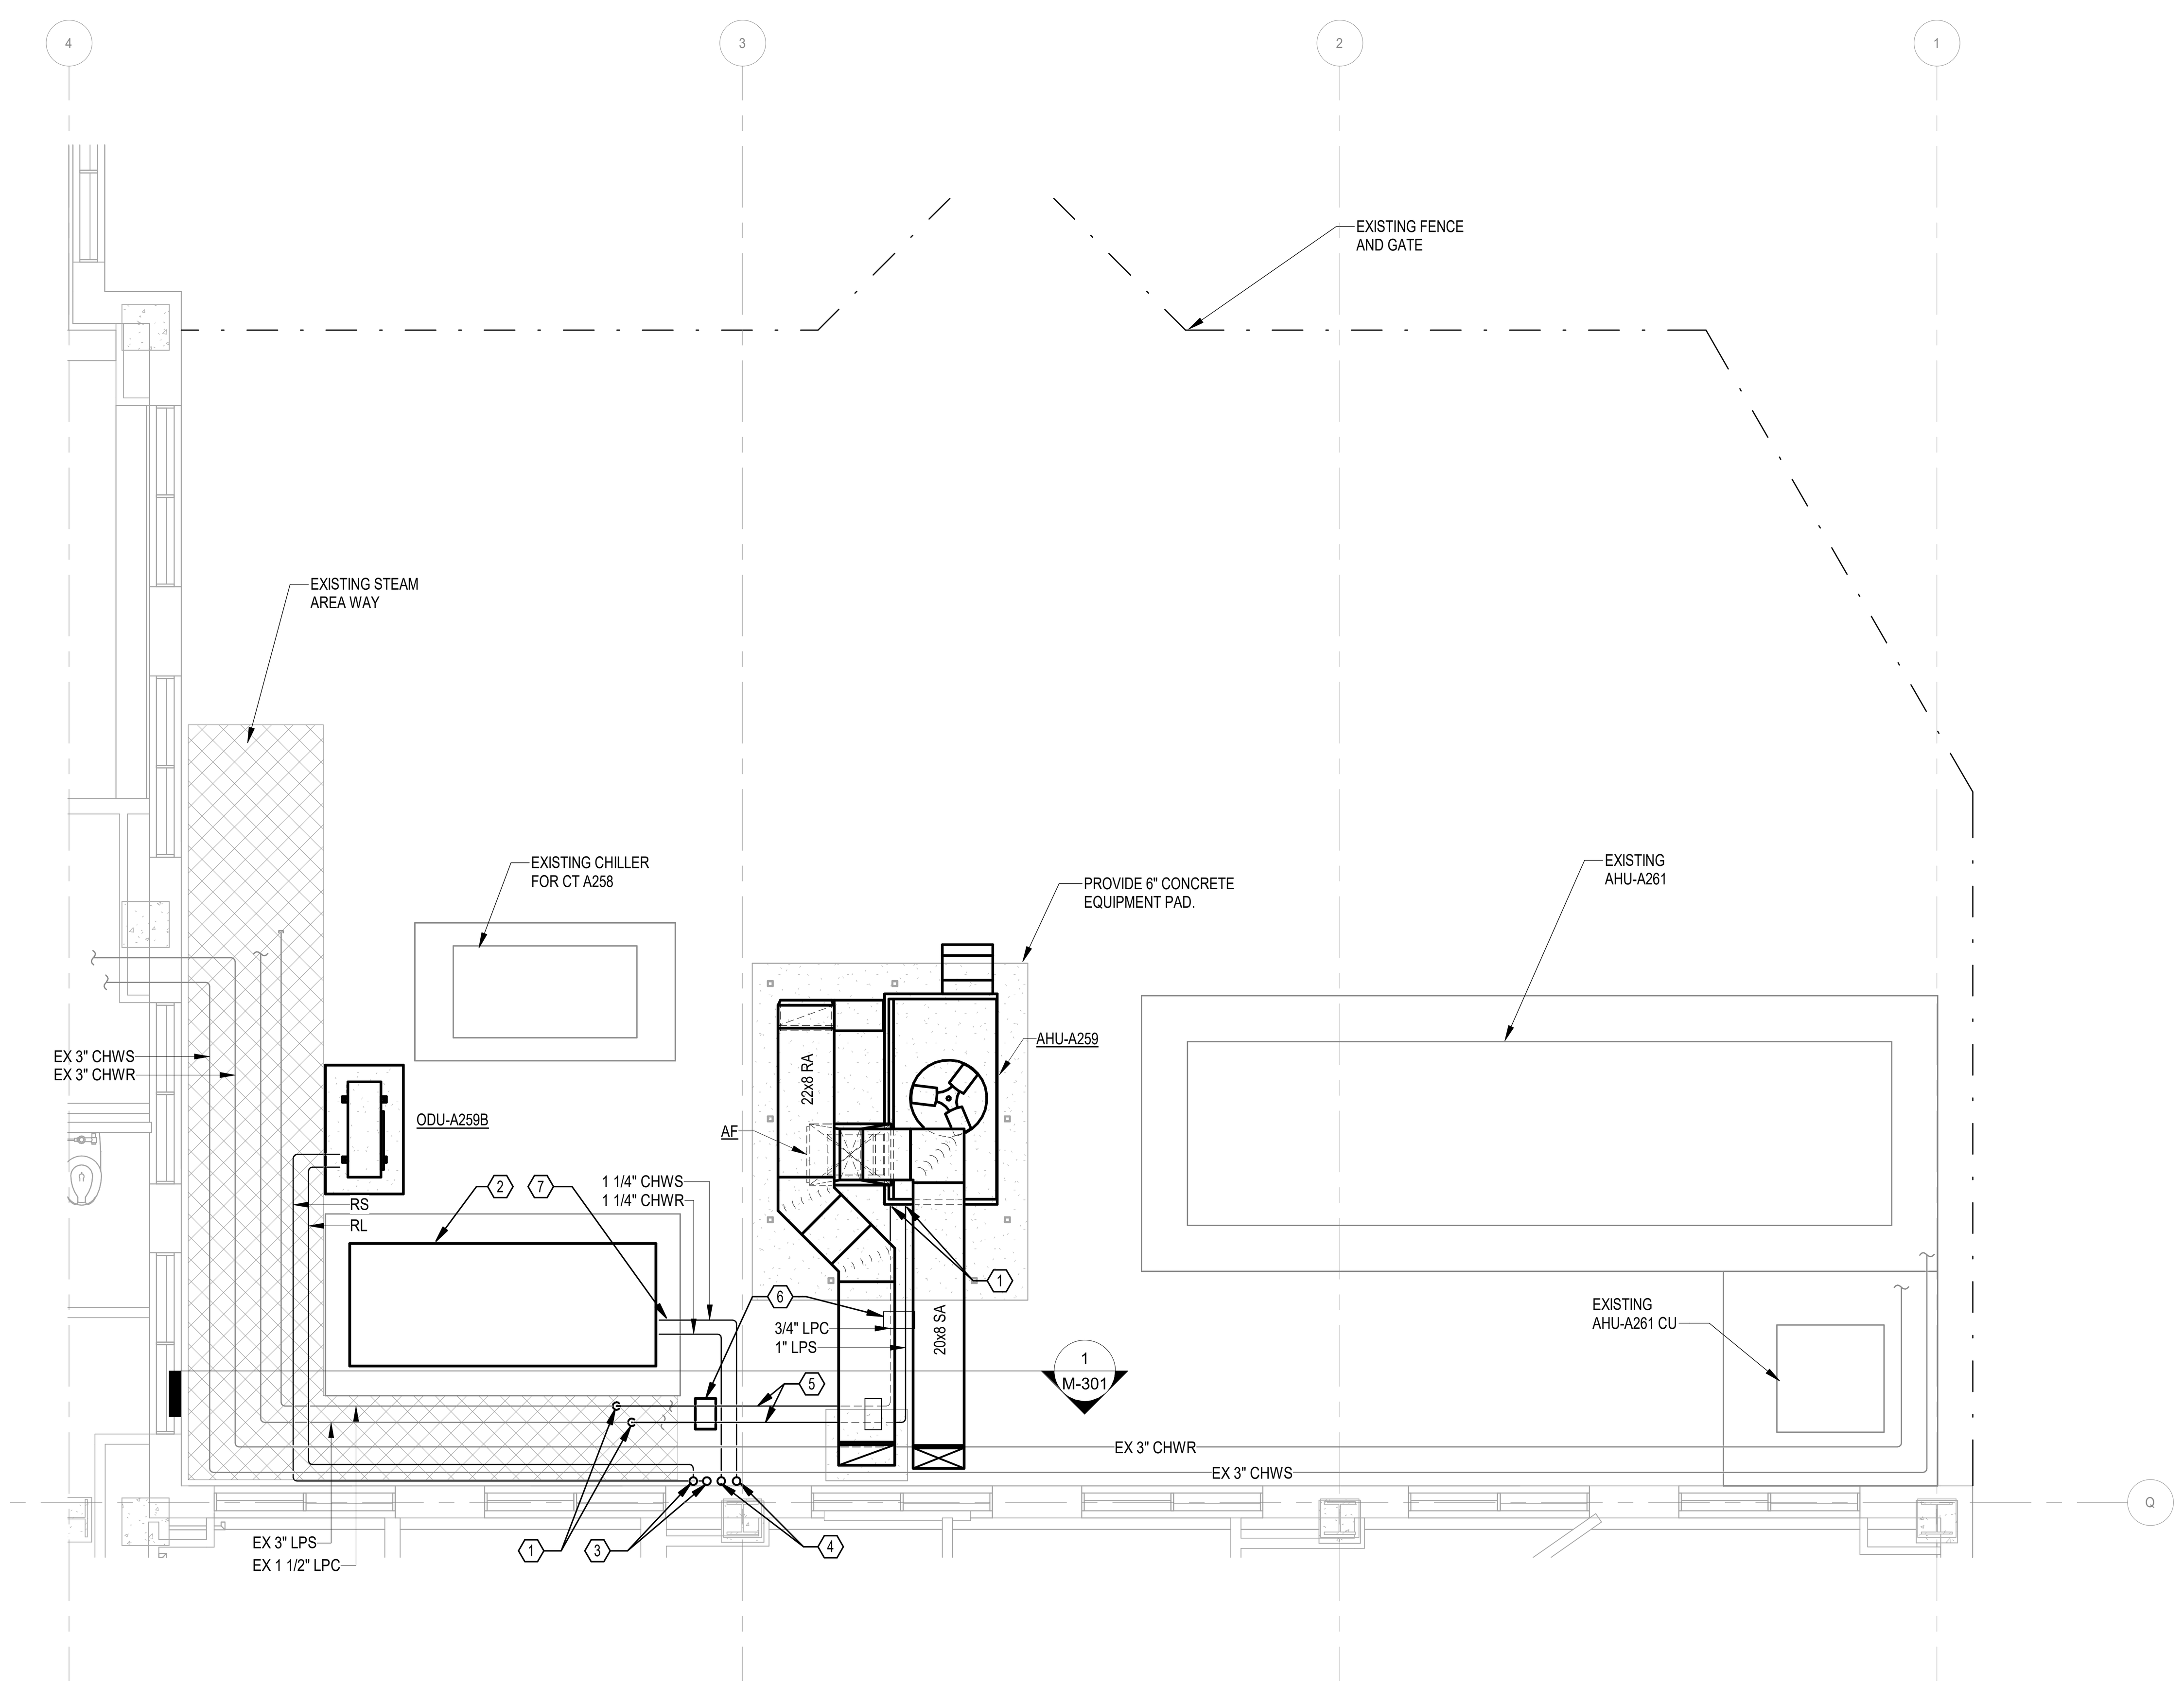

2 FIRST FLOOR PLAN - MECHANICAL HVAC - NEW WORK
1/4" = 1'-0"

KEY PLAN

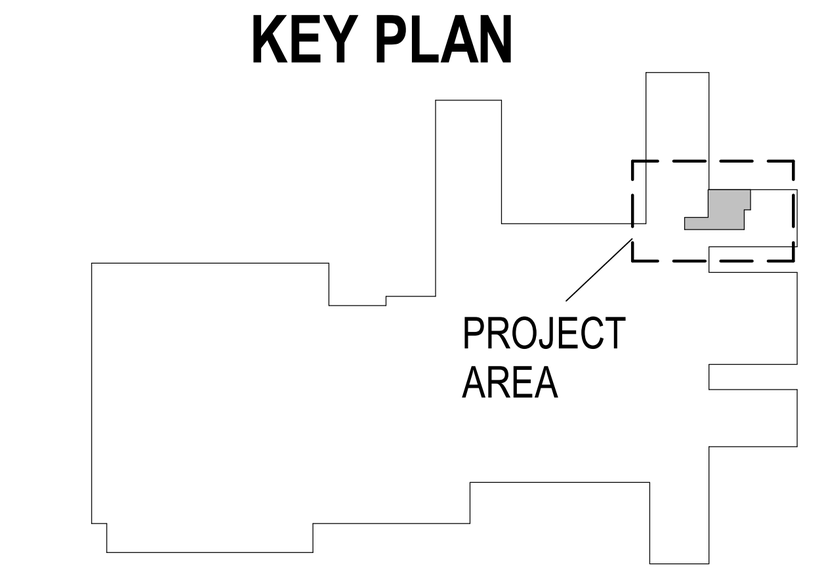

0 2' 4' 8' 12'
1/4" = 1'-0"

CONSULTANT: Above Group — ENGINEERING. DESIGN. CONSULTING. 305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com; www.abovegroupinc.com; COA/CA Lic. No. 31120; 305 East Dr., Suite H, Melbourne, Florida 32904; PH: 321.345.9026	ARCHITECT/ENGINEER OF RECORD: THINKFORM DESIGN ARCHITECT LLC; 38 EAST BROAD STREET; HOPEWELL, NJ 08525; T:855.821.0274 F:609.644.4397; Russell DiNardo, AIA NY 031521-1	STAMP: COMMONWEALTH OF PENNSYLVANIA; REGISTERED PROFESSIONAL; ALLEN LANTZ III; ENGINEER; PE091315	Office of Construction and Facilities Management; VA U.S. Department of Veterans Affairs
Drawing Title: FIRST FLOOR EQUIPMENT YARD - MECHANICAL	Phase: 100% CONTRACT DOCUMENTS FOR BIDDING	Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	Project Number: 657-23-104JC
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number: 1
		Issue Date: 06 MARCH 2026; Checked: CNB; Drawn: CSC	Drawing Number: MH100

Revisions: Date:

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt 3/6/2026 12:01:16 PM

DRAWING NOTES:

1. EXISTING CONDITIONS SHOWN ARE BASED ON LIMITED RECORD DRAWINGS AND SITE EXPLORATION. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AND NOTIFY THE COR IN WRITING ON ANY DEVIATIONS.

CODED NOTES:

1. COOLING SYSTEM HOSES PROVIDED BY EQUIPMENT MANUFACTURER AND INSTALLED BY MECHANICAL CONTRACTOR. REFER TO MANUFACTURER'S DRAWINGS FOR CONTINUATION.
2. HEAT EXCHANGER PROVIDED BY MEDICAL EQUIPMENT SUPPLIER AND INSTALLED BY MECHANICAL CONTRACTOR. REFER TO MANUFACTURER'S DOCUMENTATION FOR INSTALLATION REQUIREMENTS.
3. ROUTE HUMIDIFIER AND STEAM DISPERSION DRAIN TO NEW FLOOR DRAIN.
4. CONNECT NEW HUMIDIFIER TO EXISTING LOW PRESSURE STEAM PIPING.
5. SLOPE BOTTOM OF DUCTWORK MIN 12" UPSTREAM AND DOWNSTREAM OF HUMIDIFIER AT 1/8" PER FOOT. PROVIDE PITCH POCKET AND DRAIN BENEATH HUMIDIFIER DISPERSION TUBE.
6. CT MANUFACTURER SUPPLIED AND INSTALLED WATER HOSES FROM THE HEAT EXCHANGER TO THE CT GANTRY. THE HOSES SHALL BE RUN IN (2) 3" CONDUITS OR ACCORDING TO LOCAL CODE.
7. VAV STATIC PRESSURE SENSOR LOCATED IN VERTICAL SECTION OF DUCT.
8. PROVIDE ISOLATION VALVES AND CAP PIPING IN THIS APPROXIMATE LOCATION.

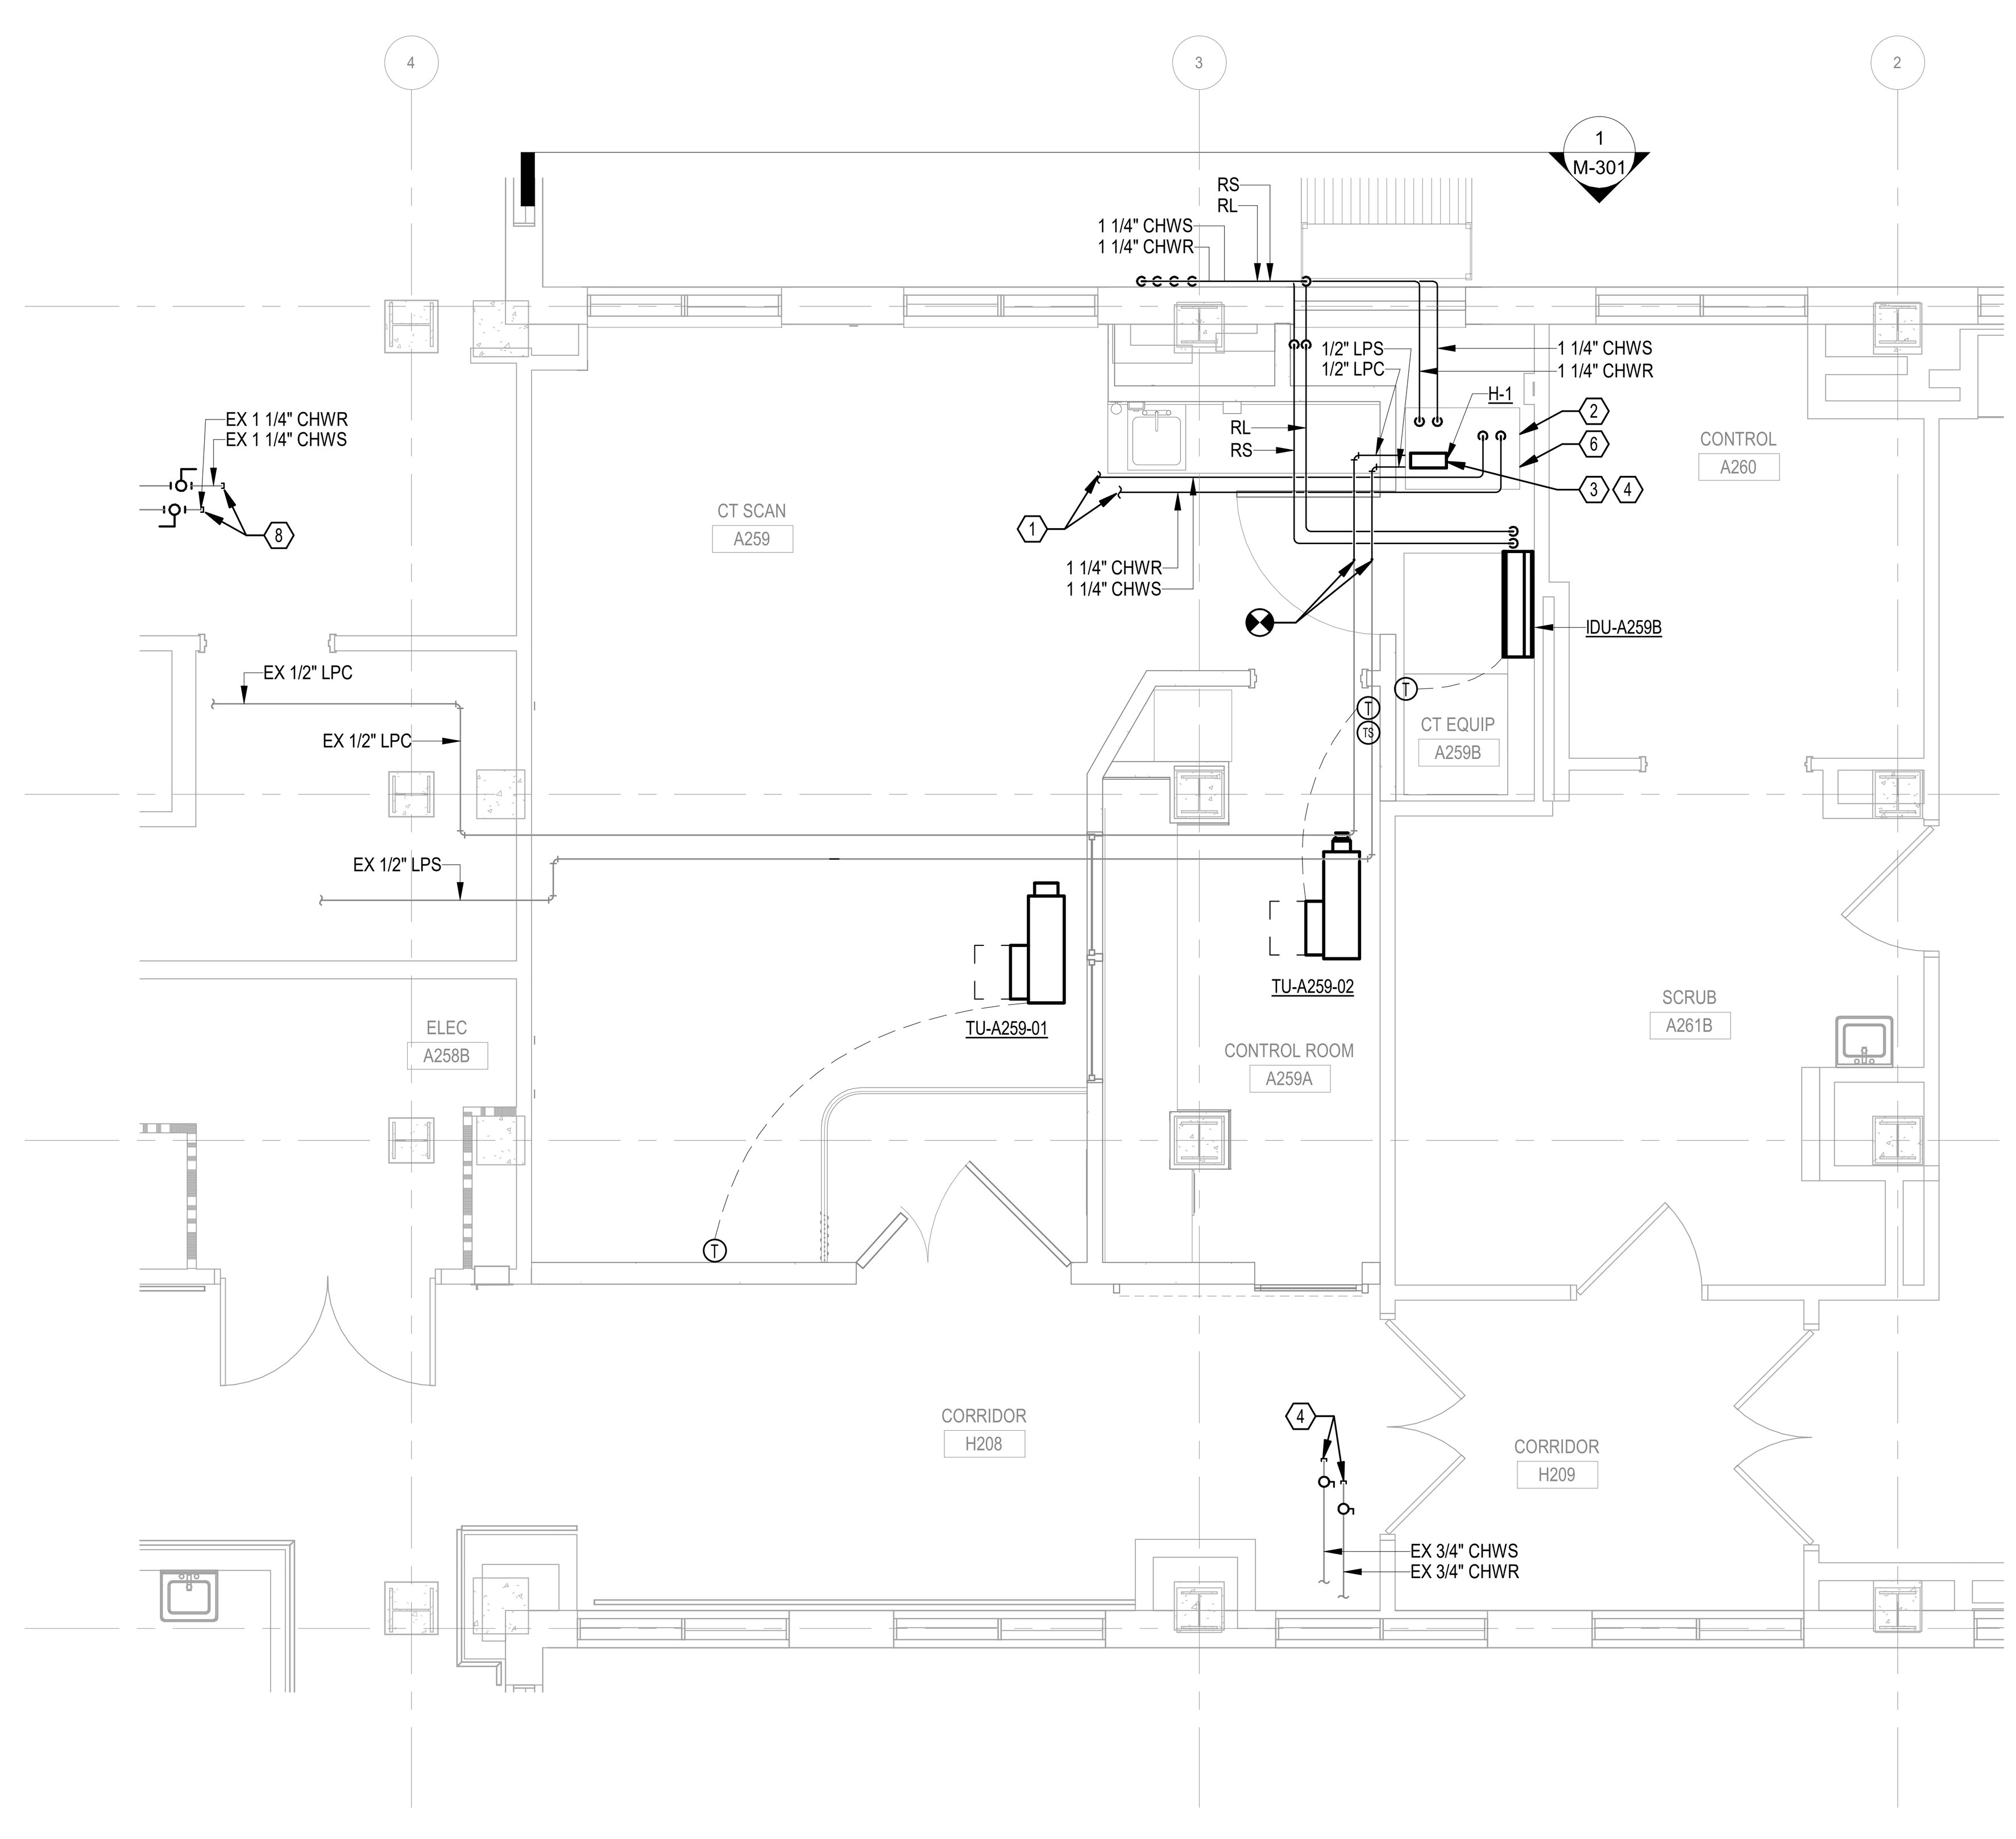

1 SECOND FLOOR PLAN - MECHANICAL PIPING - NEW WORK
1/4" = 1'-0"

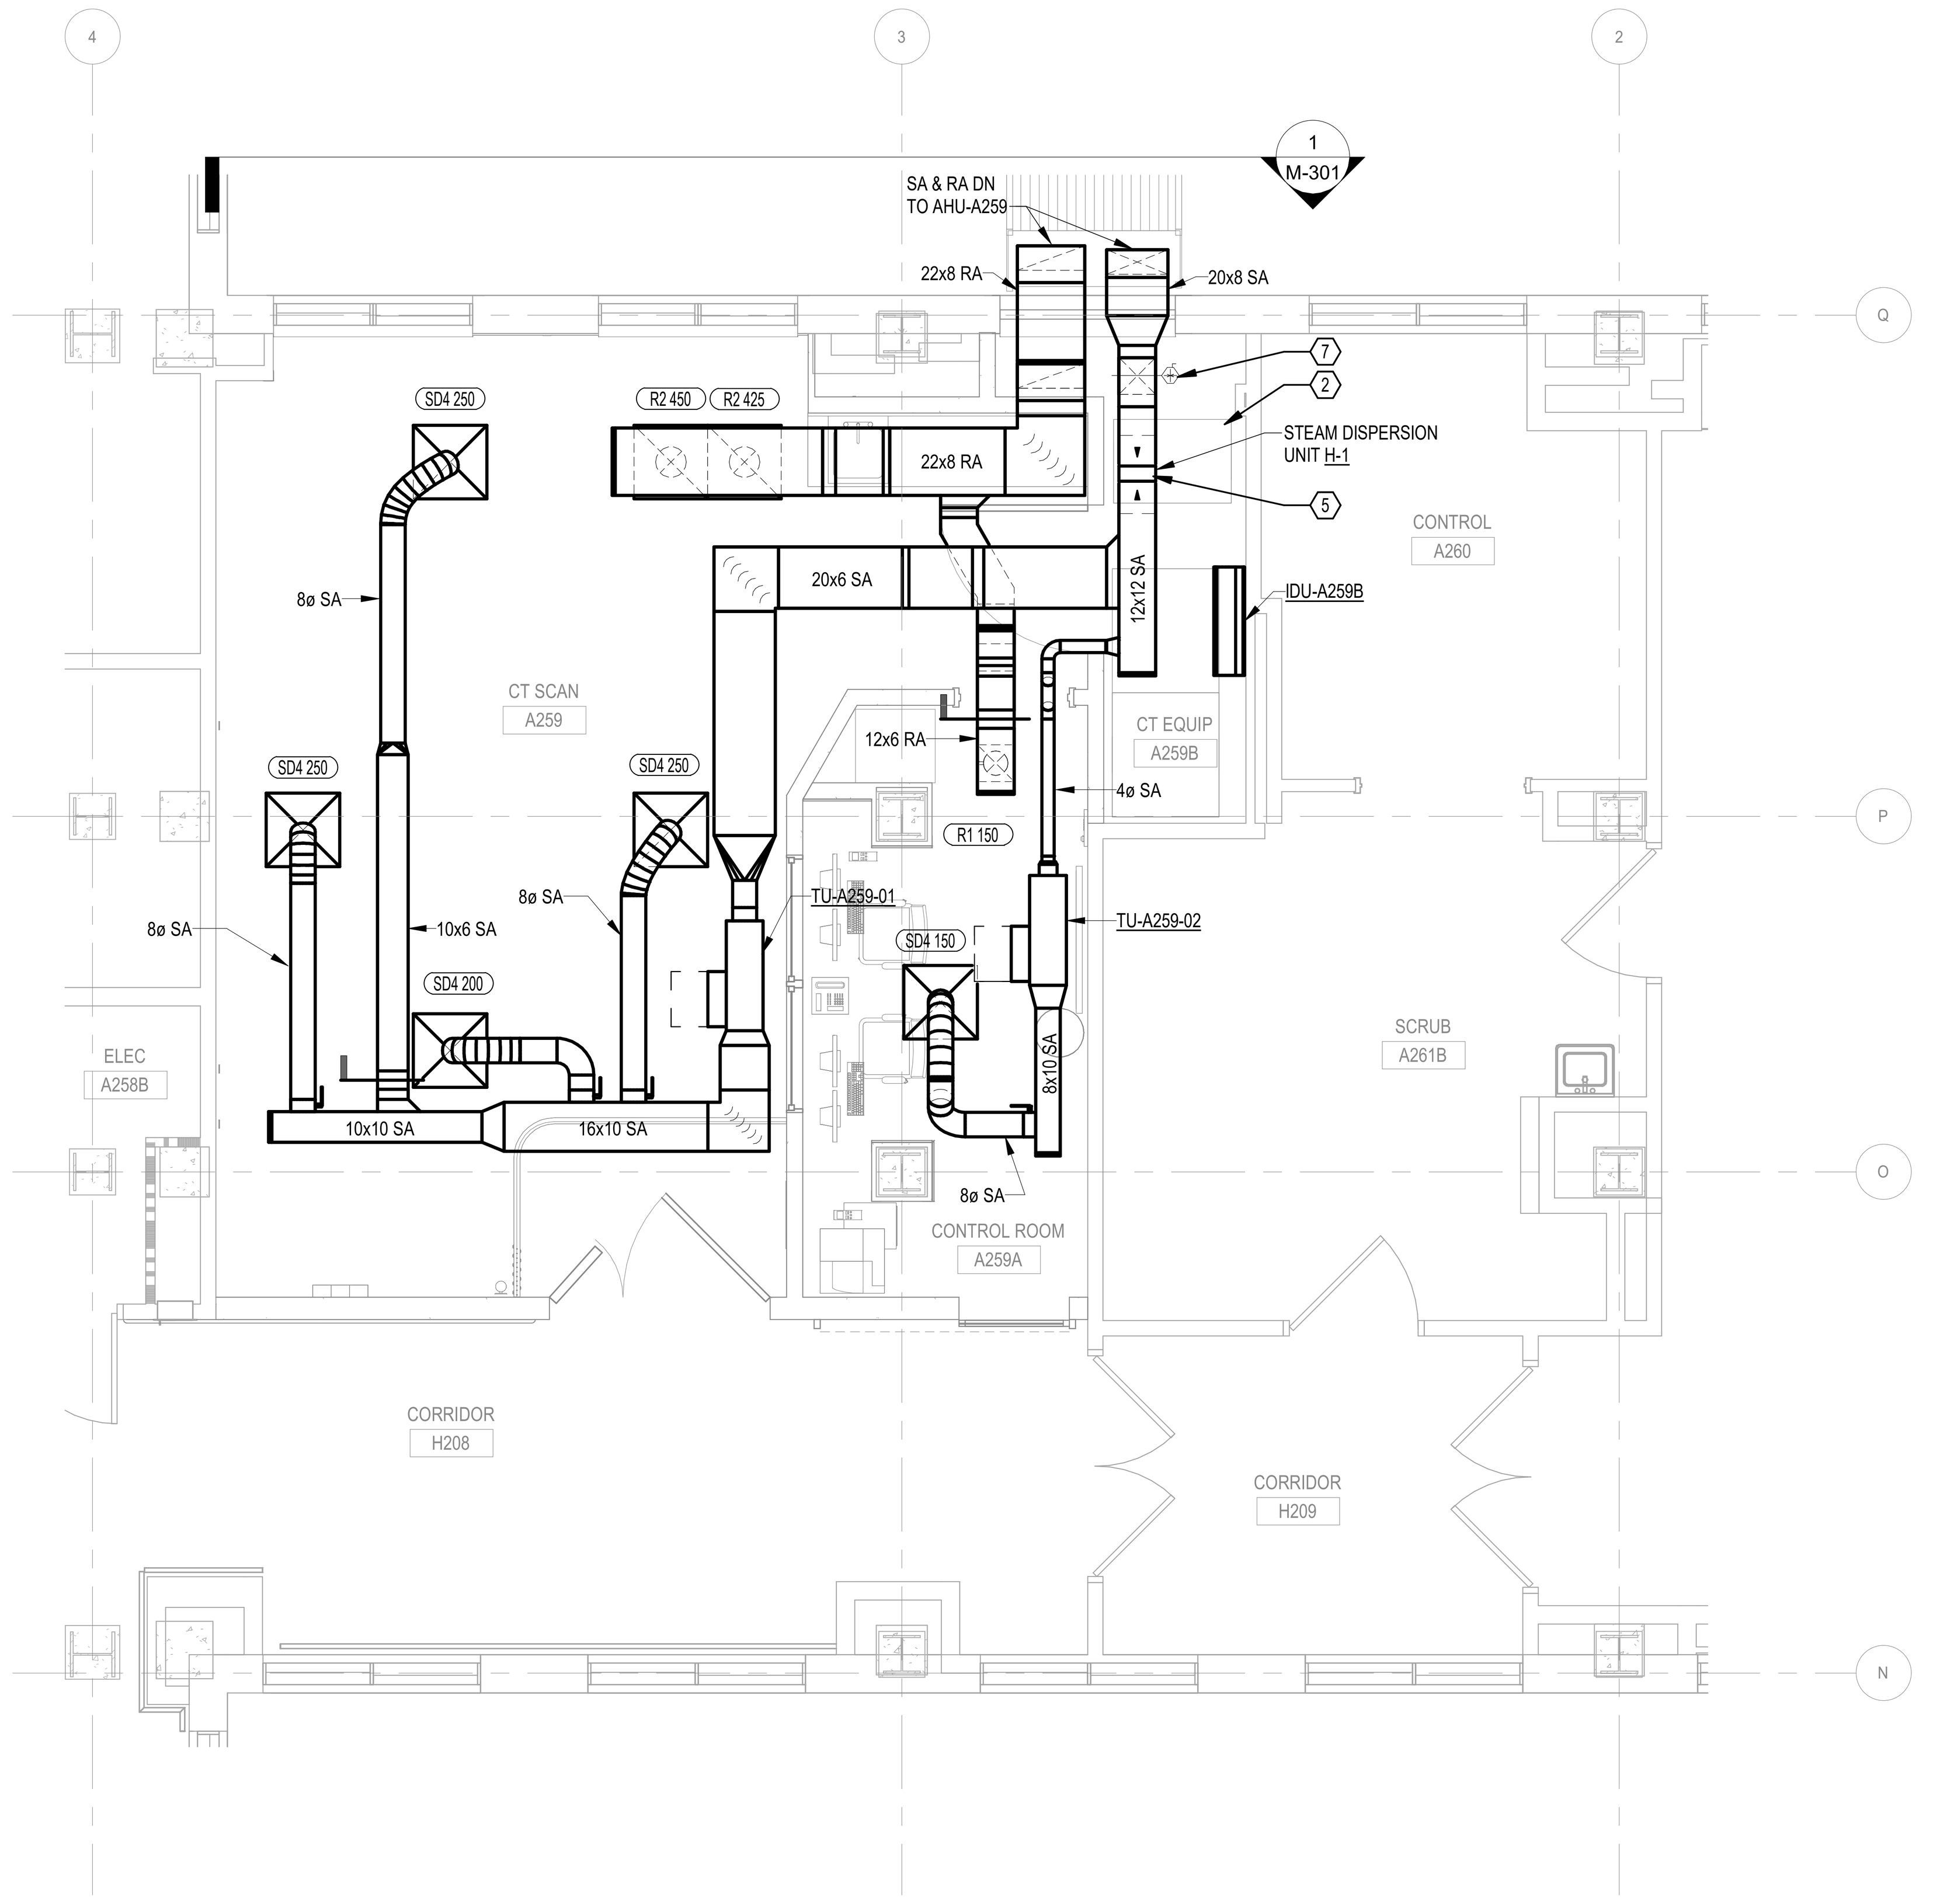

2 SECOND FLOOR PLAN - MECHANICAL HVAC - NEW WORK
1/4" = 1'-0"

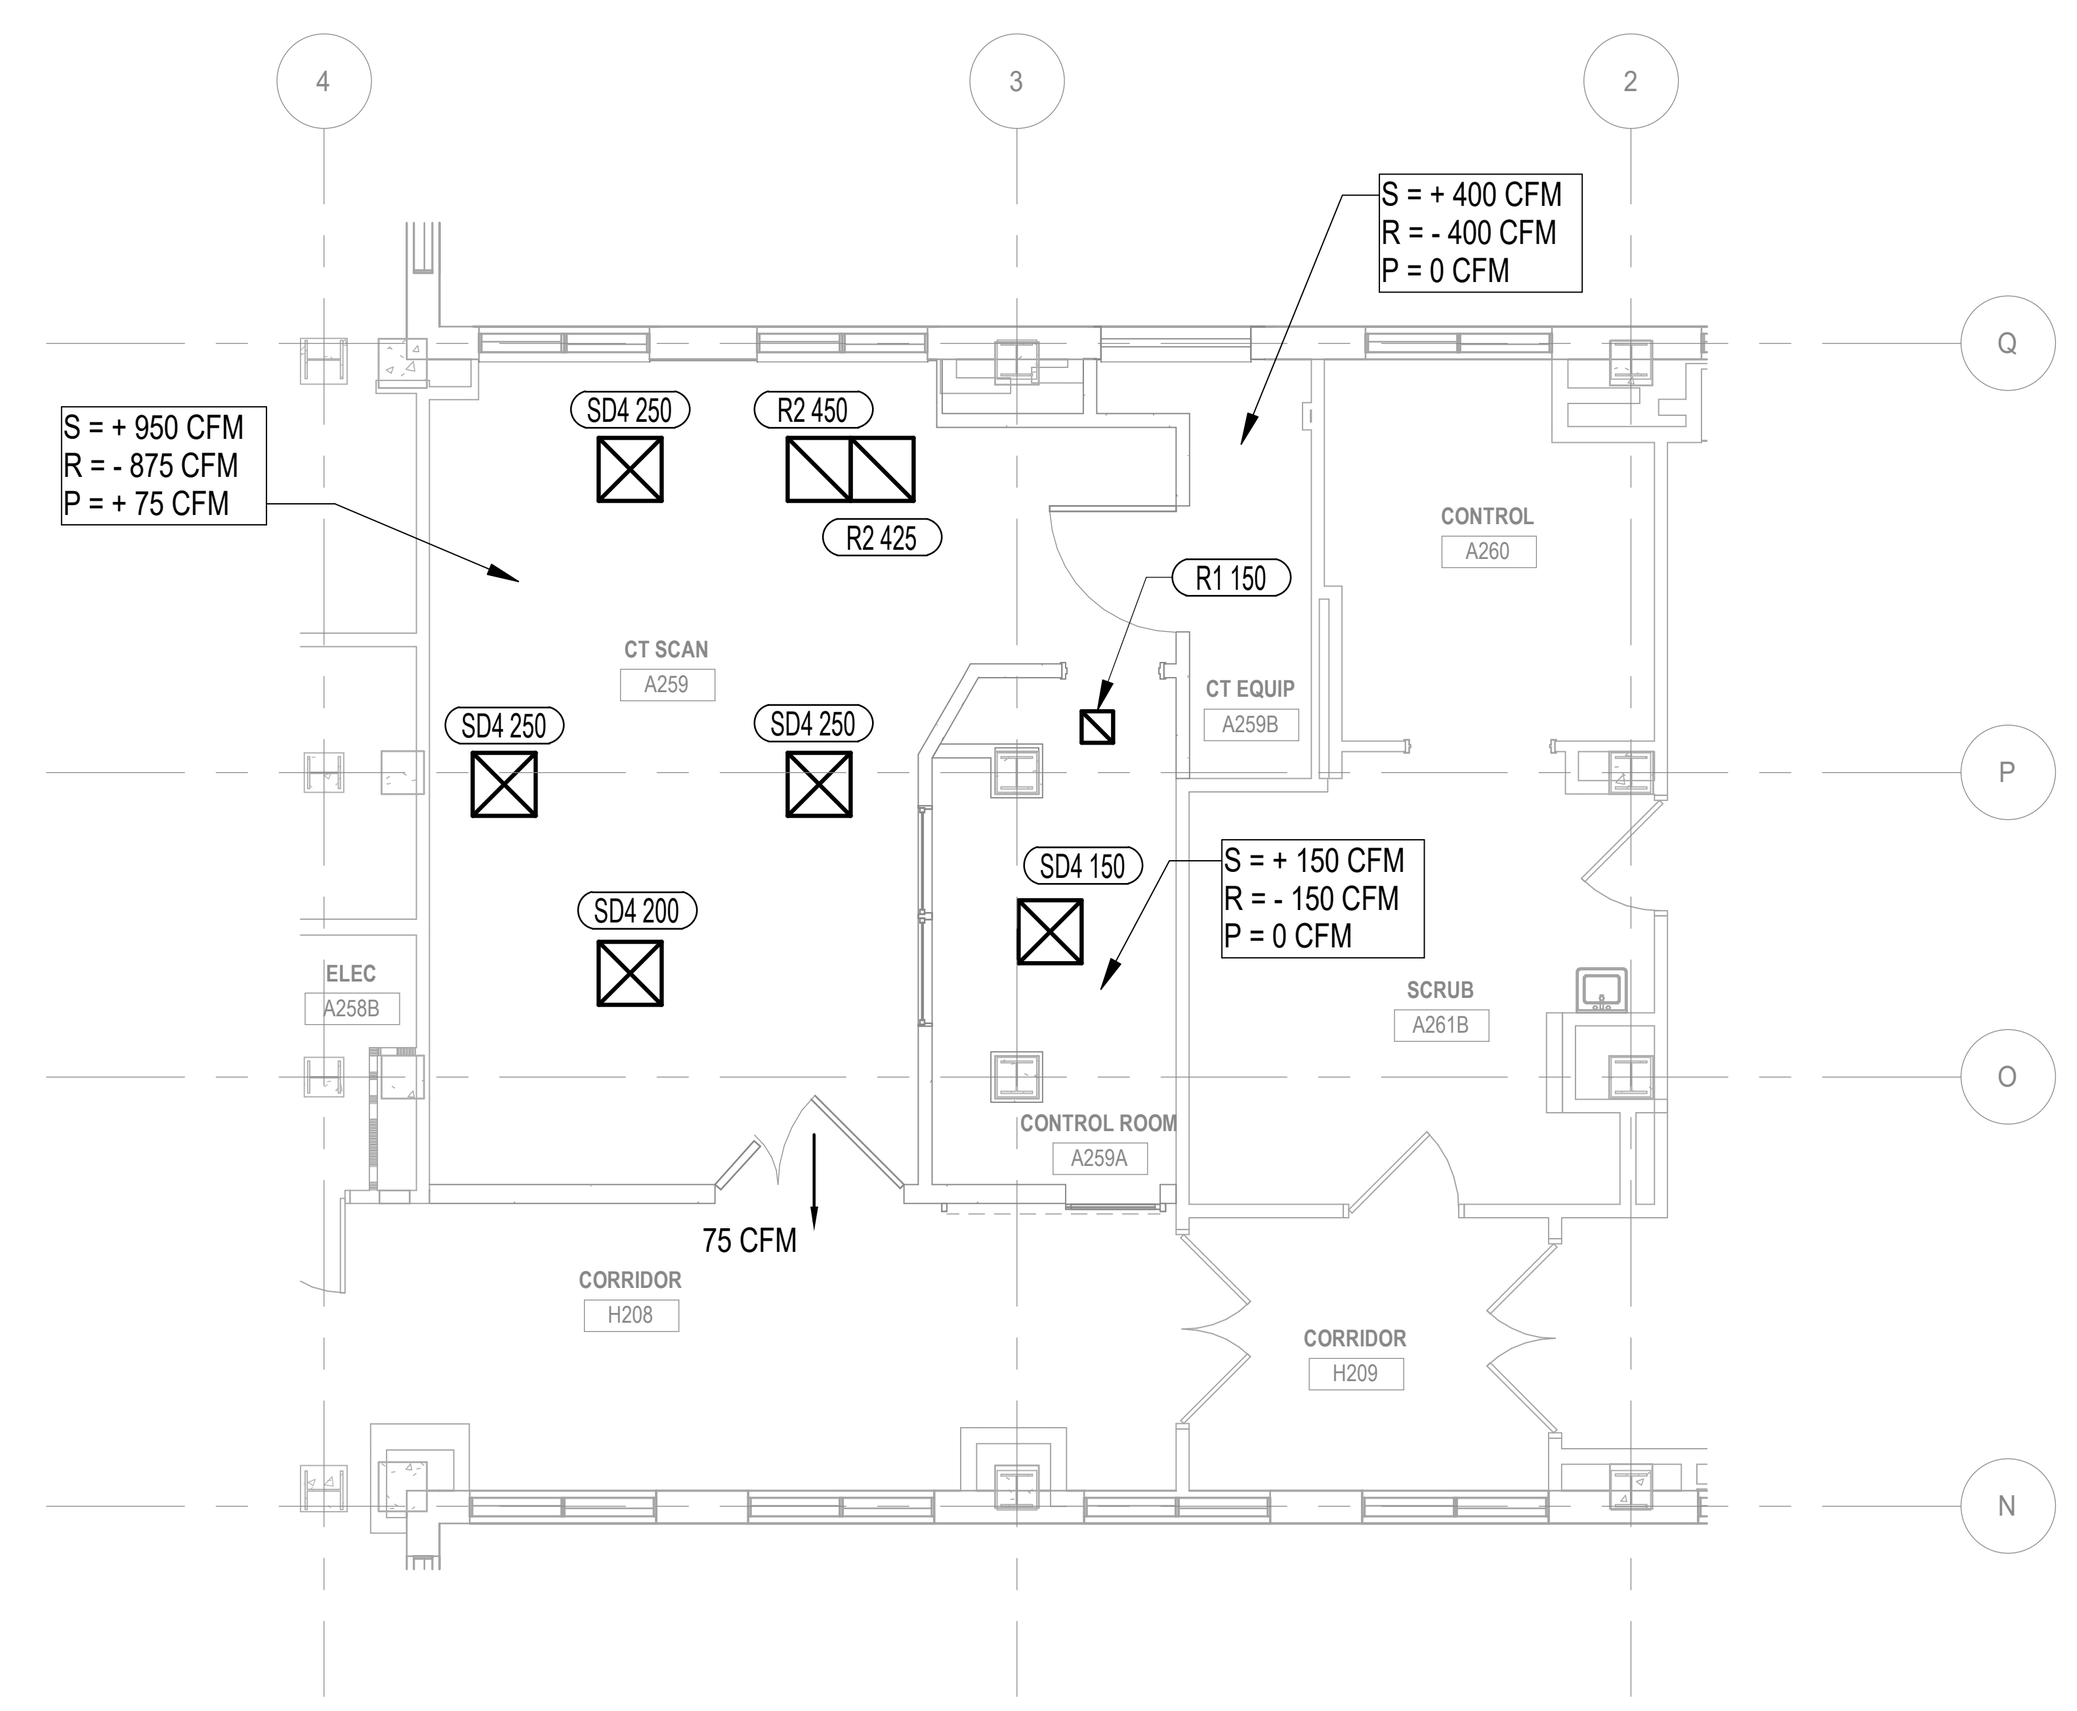

3 SECOND FLOOR PLAN - MECHANICAL PRESSURIZATION - NEW WORK
1/8" = 1'-0"

AIR BALANCE SCHEDULE

ROOM NUMBER	ROOM NAME	SUPPLY AIR (CFM)	RETURN AIR (CFM)	ROOM PRESSURIZATION (CFM)	MIN AIR CHANGES	AIRFLOW AT MIN ACH	ROOM AIR BALANCE	COMMENTS
A259	CT SCAN	950	875	+75	6	940	POSITIVE	UNDERCUT DOOR TO CORRIDOR
A259A	CONTROL ROOM	150	150	0	6	100	NEUTRAL	
A259B	CT EQUIP	400	400	0	6	50	NEUTRAL	

KEY PLAN

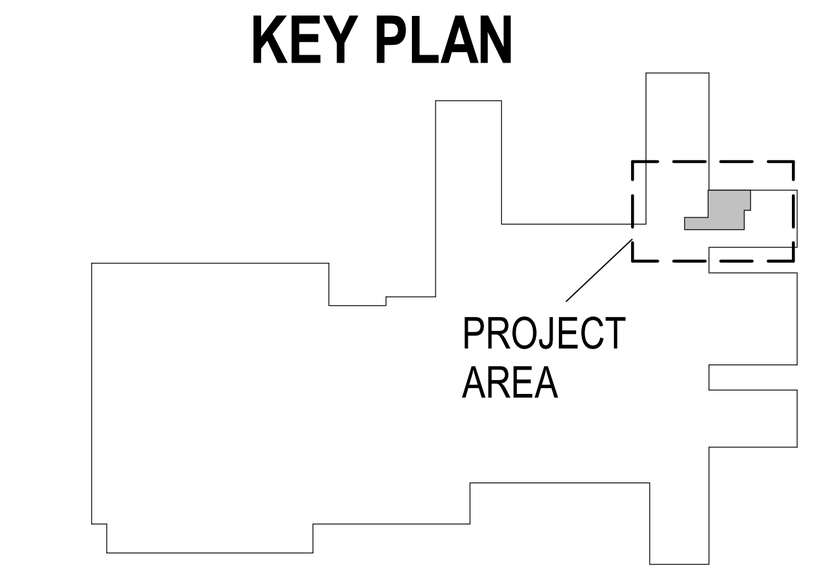

0 4' 8' 16' 24'
1/8" = 1'-0"
0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions: | Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
SECOND FLOOR PLAN - MECHANICAL - ROOM A259	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number: 1
		Issue Date: 06 MARCH 2026; Checked: CNB; Drawn: CSC	Drawing Number: MH101

CODED NOTES:

1. PROVIDE STRUCTURAL SUPPORTS FOR NEW EXPOSED DUCT AND PIPING. PROVIDE PROTECTION FROM WEATHER FOR NEW DUCTWORK SIMILAR TO THE EXISTING EXPOSED DUCT AND PIPING.
2. REFER TO ARCHITECTURE AND STRUCTURAL DRAWINGS AND DETAILS FOR DUCT ENCLOSURE AND SUPPORTS.
3. CT MANUFACTURER SUPPLIED WATER HOSES FROM THE HEAT EXCHANGER TO THE OUTDOOR UNIT TO BE INSTALLED BY THE MECHANICAL CONTRACTOR. THE HOSES SHALL BE RUN IN (2) 3" CONDUITS OR ACCORDING TO CODE.

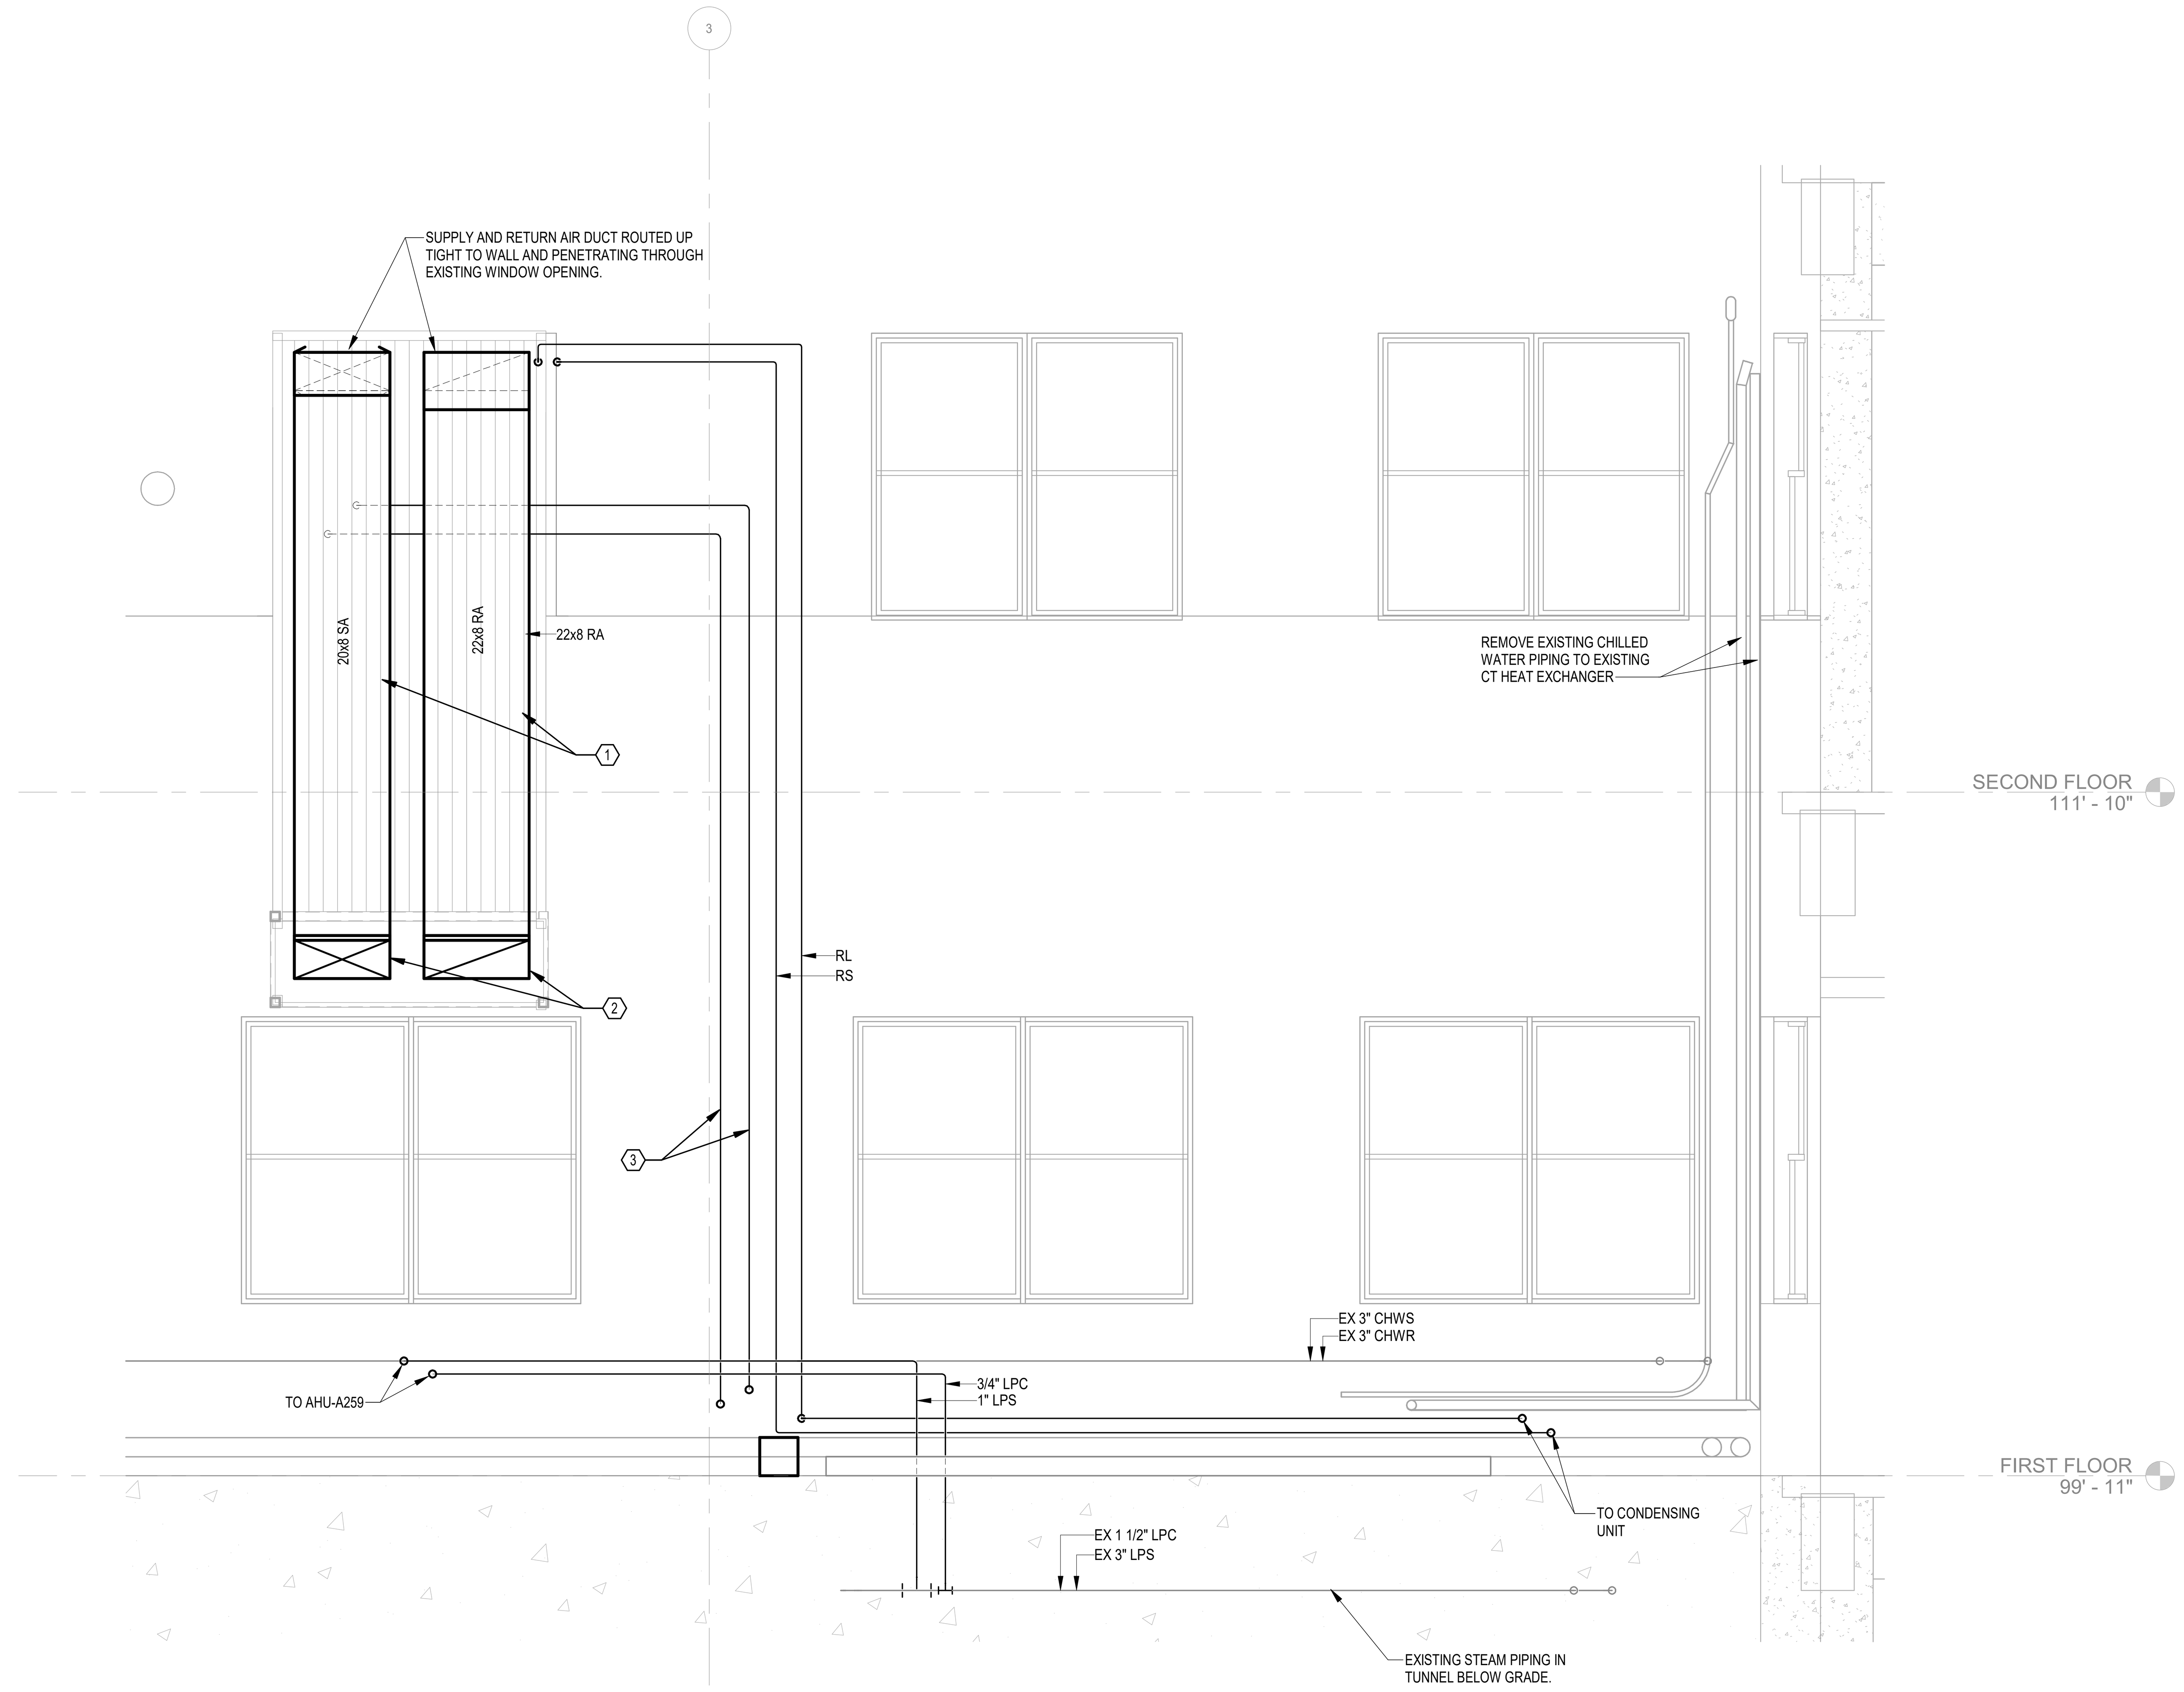

1 HVAC DUCT AND PIPING AT EXTERIOR WALL SECTION
1/2" = 1'-0"

0 1' 2' 4' 6'
1/2" = 1'-0"

Revisions: | Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP
COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	MECHANICAL SECTIONS
Approved:	
Phase	100% CONTRACT DOCUMENTS FOR BIDDING
	FULLY SPRINKLERED
Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	CNB
Drawn	CSC
Project Number	657-23-104JC
Building Number	1
Drawing Number	M-301

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt
3/6/2026 12:01:23 PM

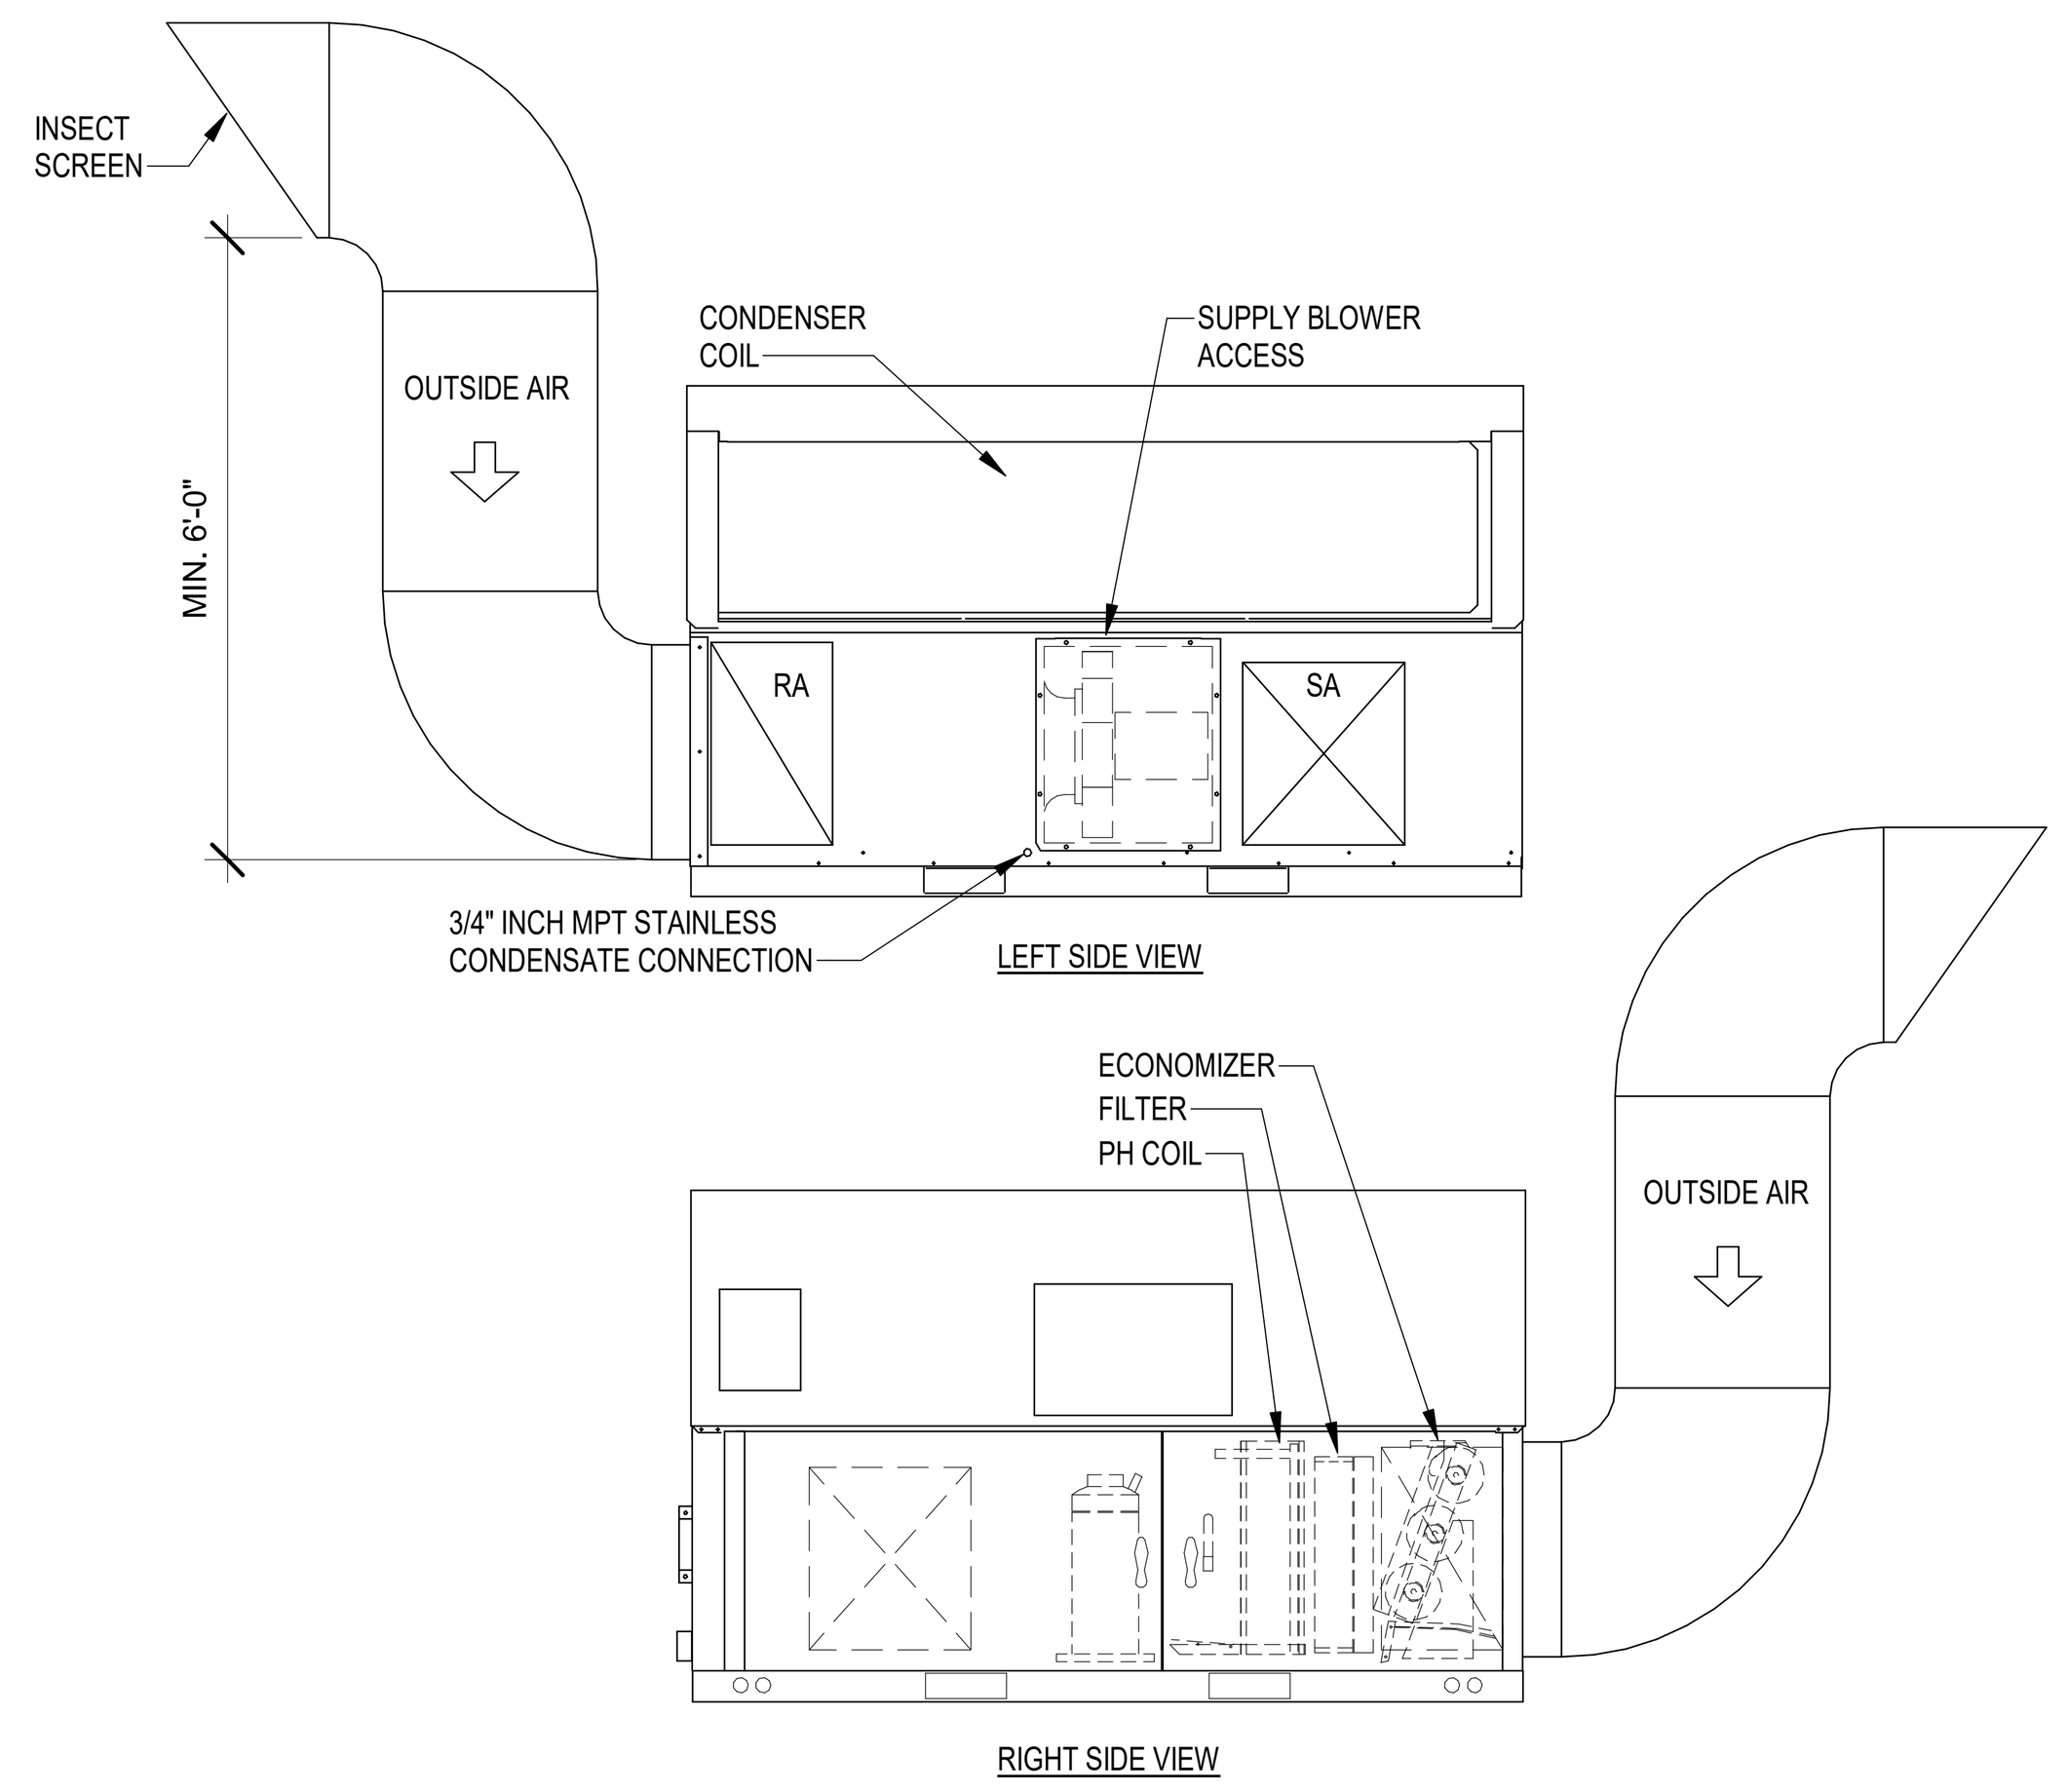

1 AIR HANDLING UNIT SECTIONS
N.T.S.

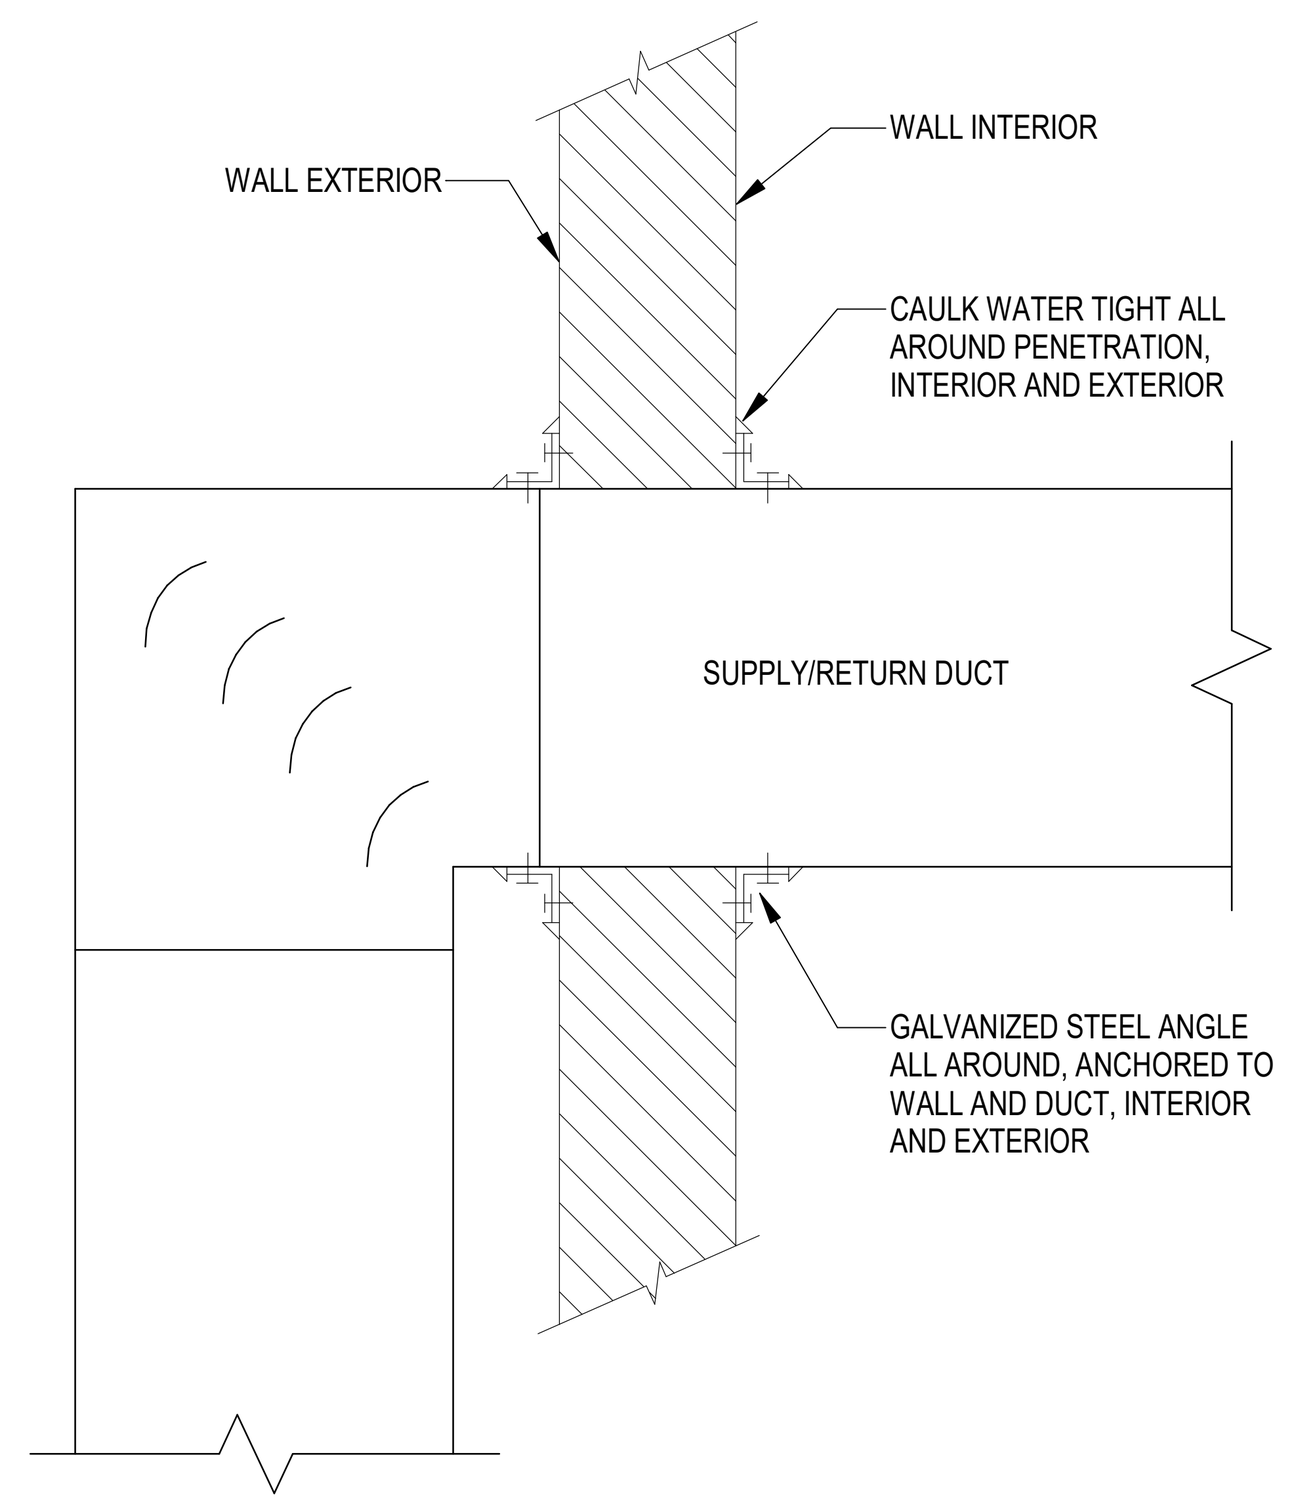

2 EXTERIOR WALL DUCT PENETRATION DETAIL
N.T.S.

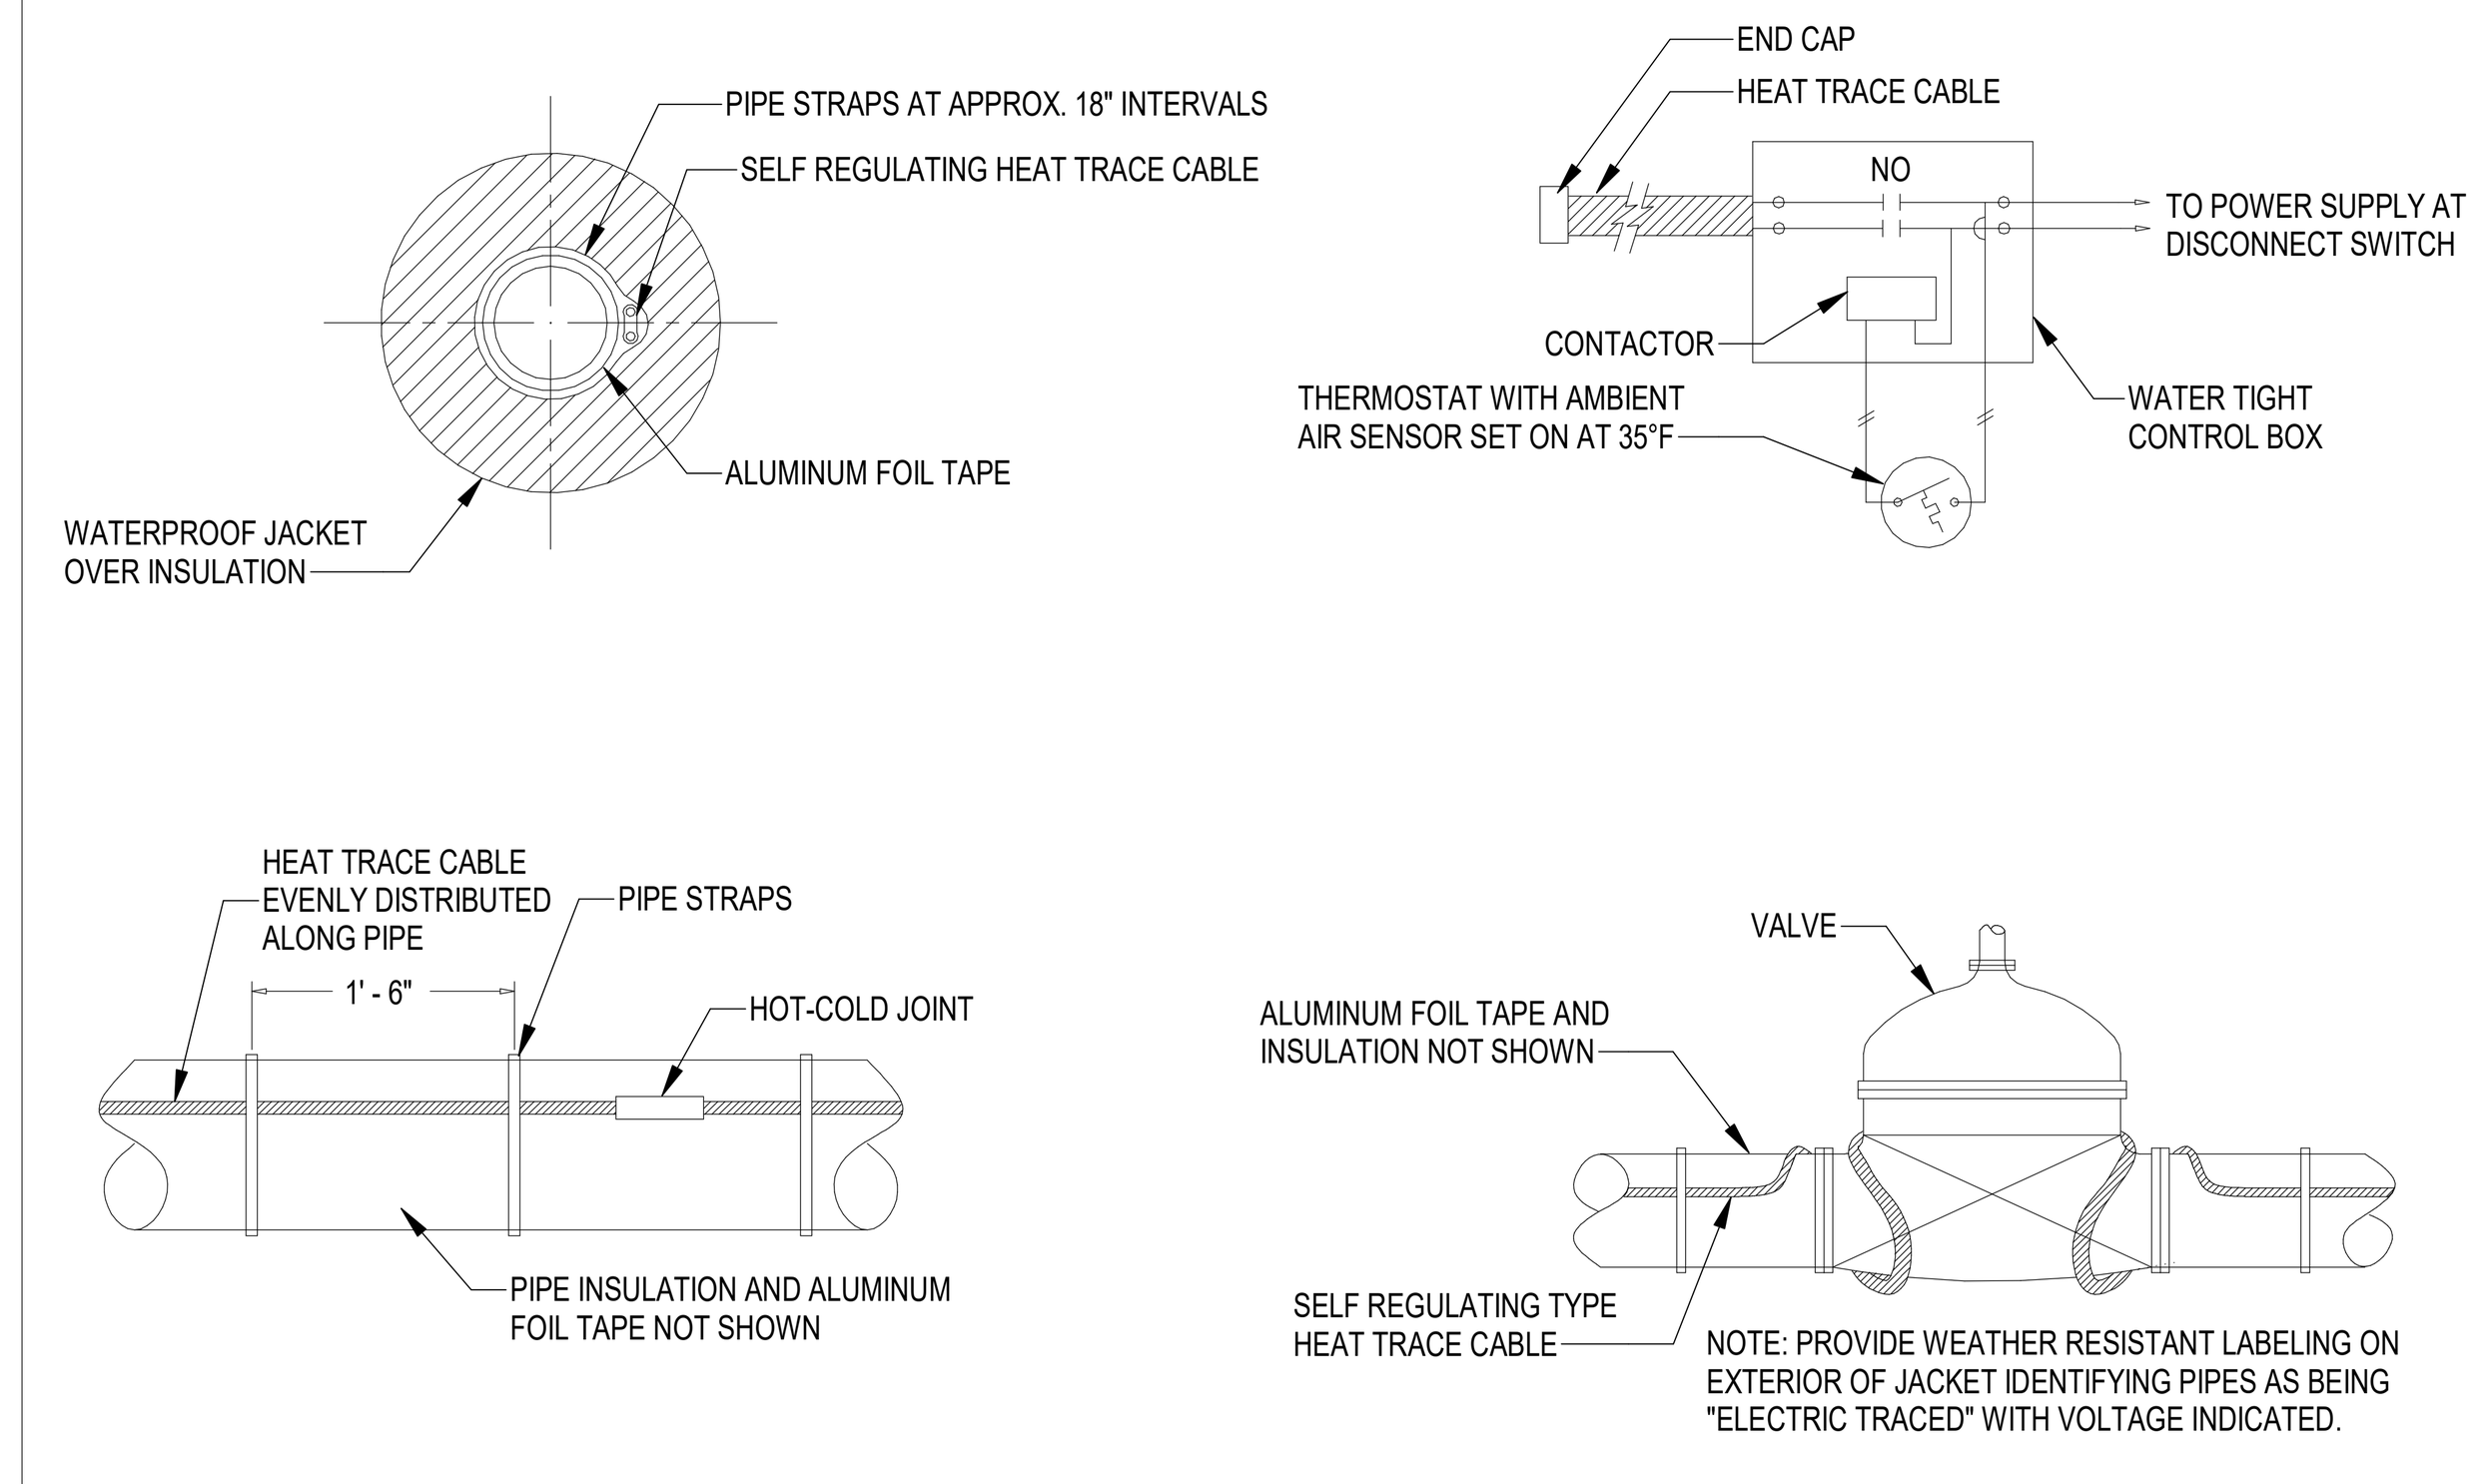

3 HEAT TRACING DETAILS
N.T.S.

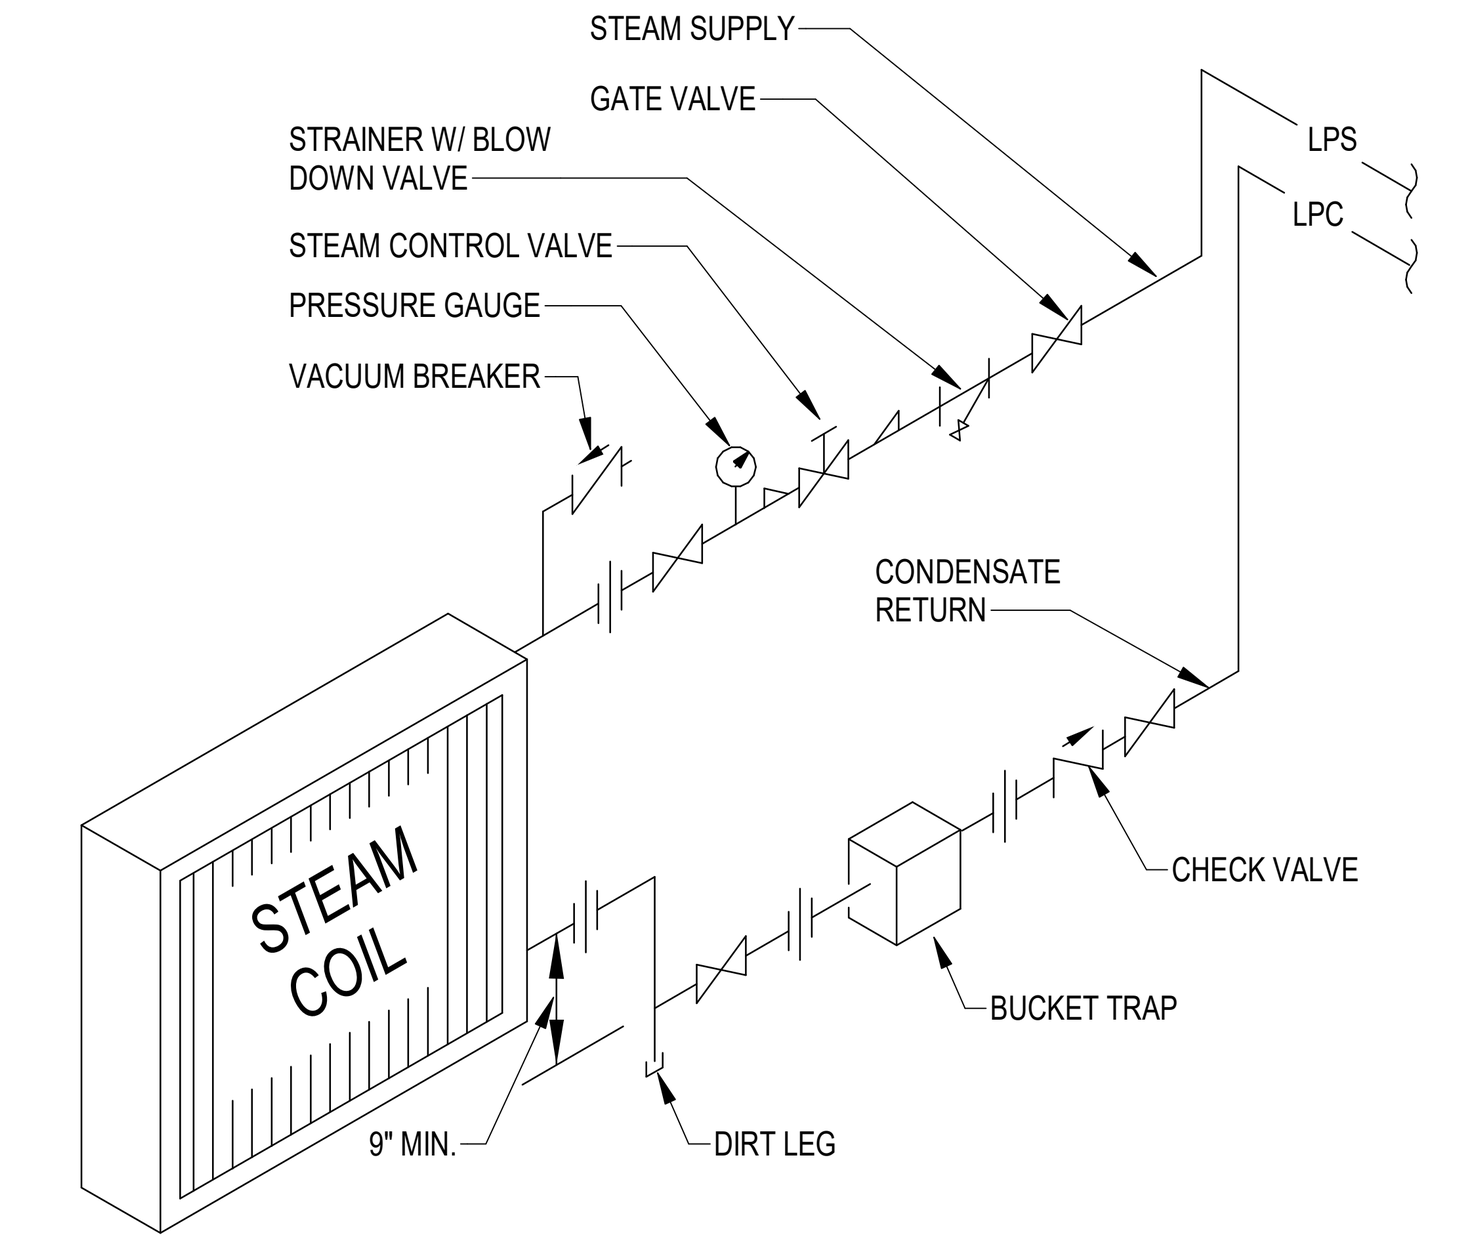

4 STEAM HEATING COIL PIPING DETAIL
N.T.S.

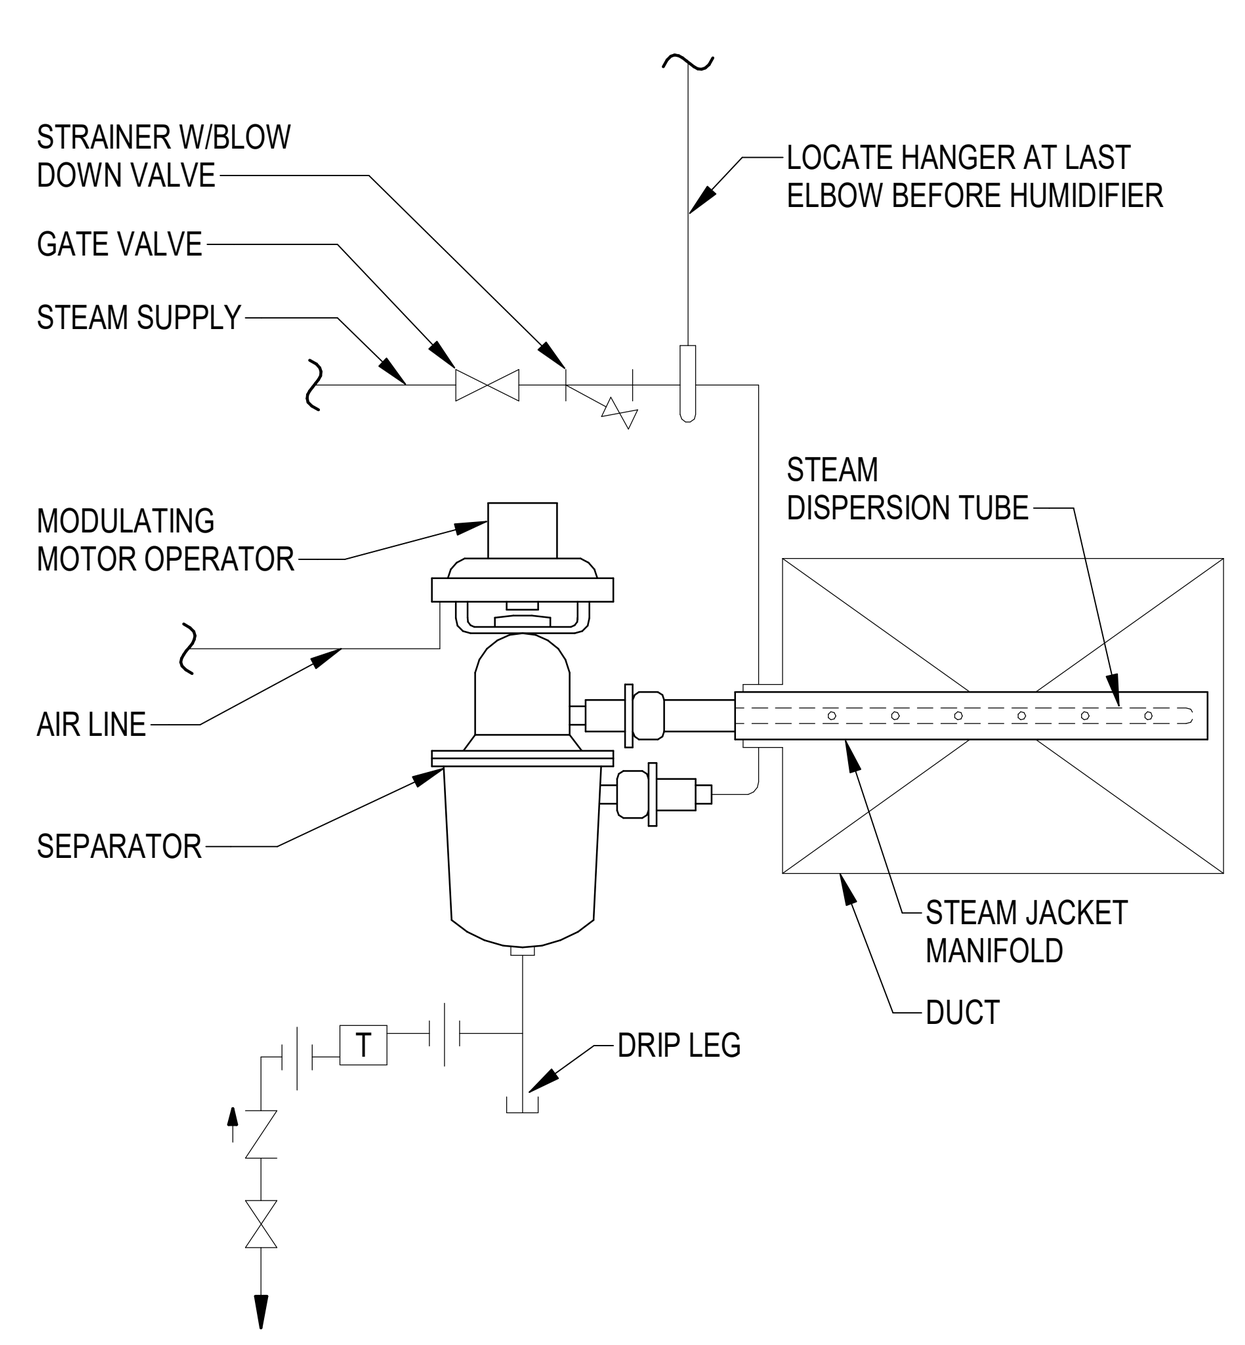

5 STEAM HUMIDIFIER PIPING DETAIL
N.T.S.

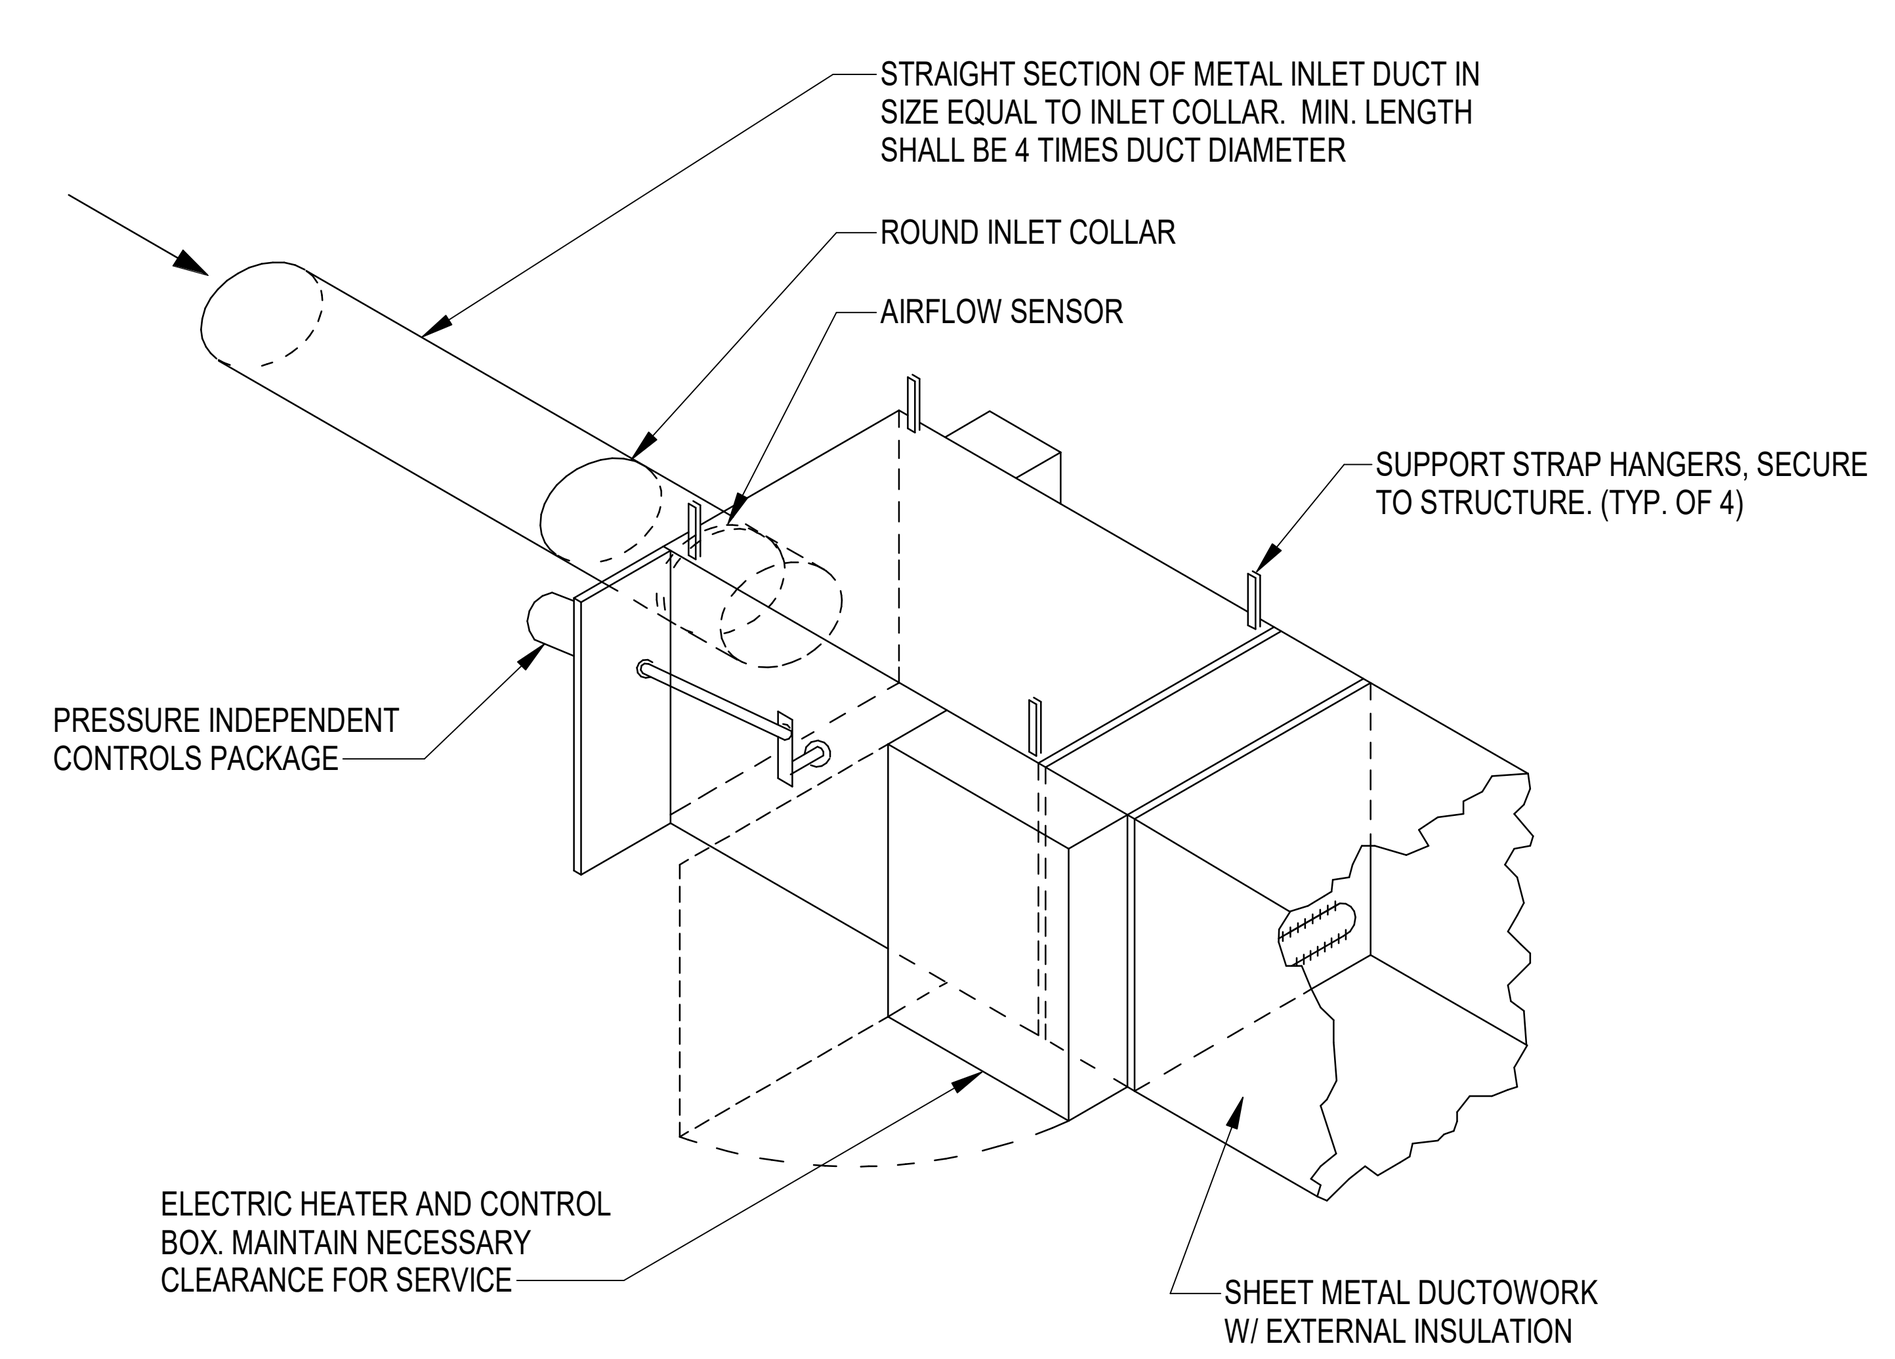

6 VARIABLE VOLUME TERMINAL W/ELECTRIC HEAT DETAIL
N.T.S.

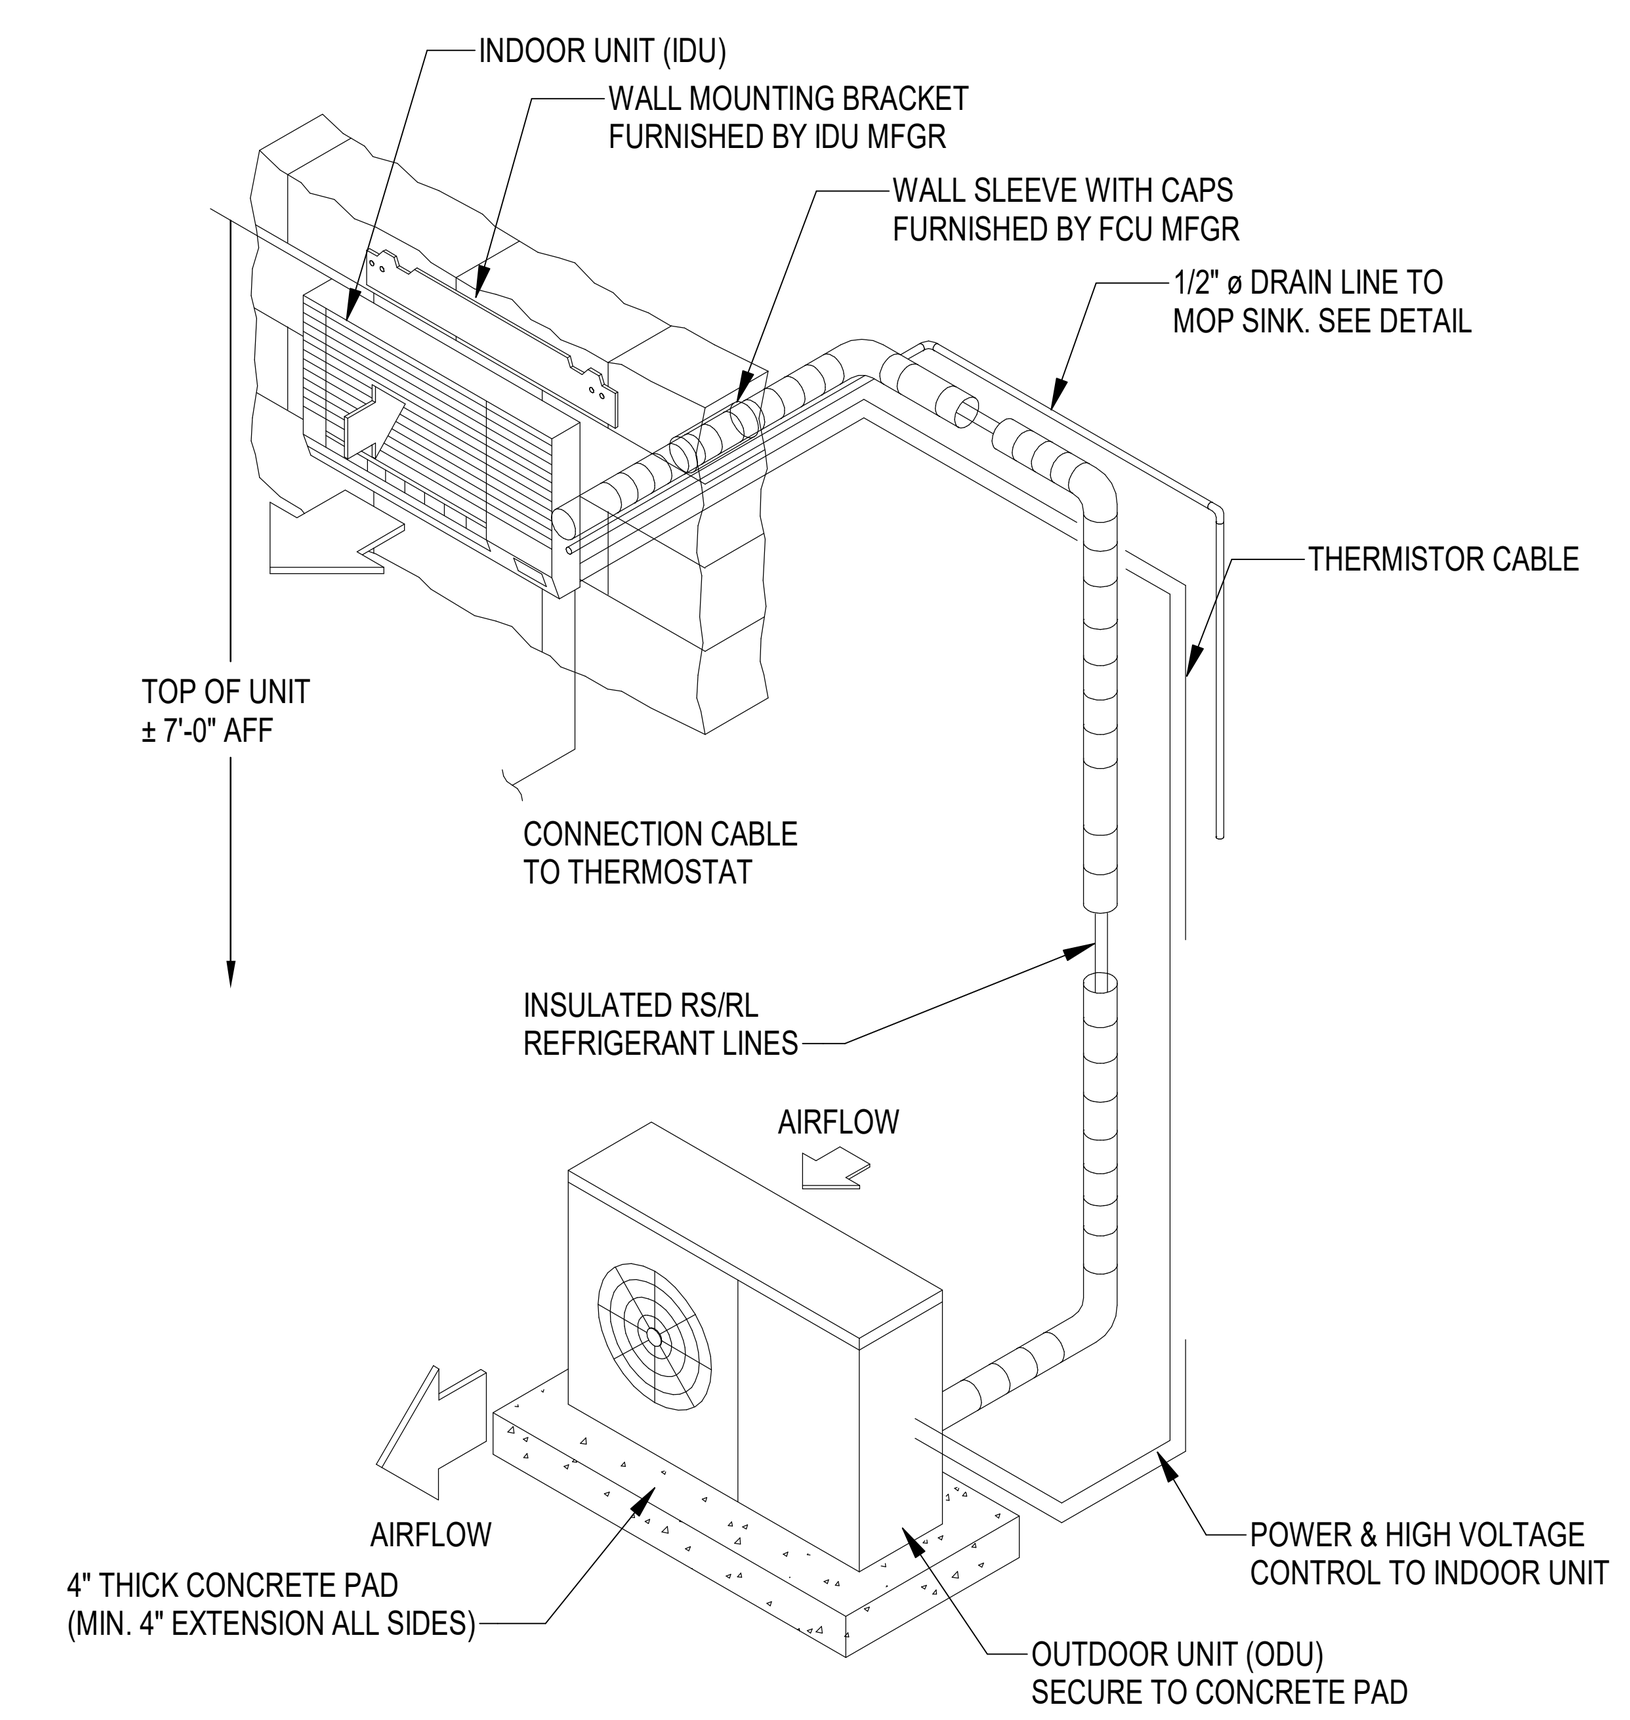

7 WALL MOUNTED MINI SPLIT DETAIL
N.T.S.

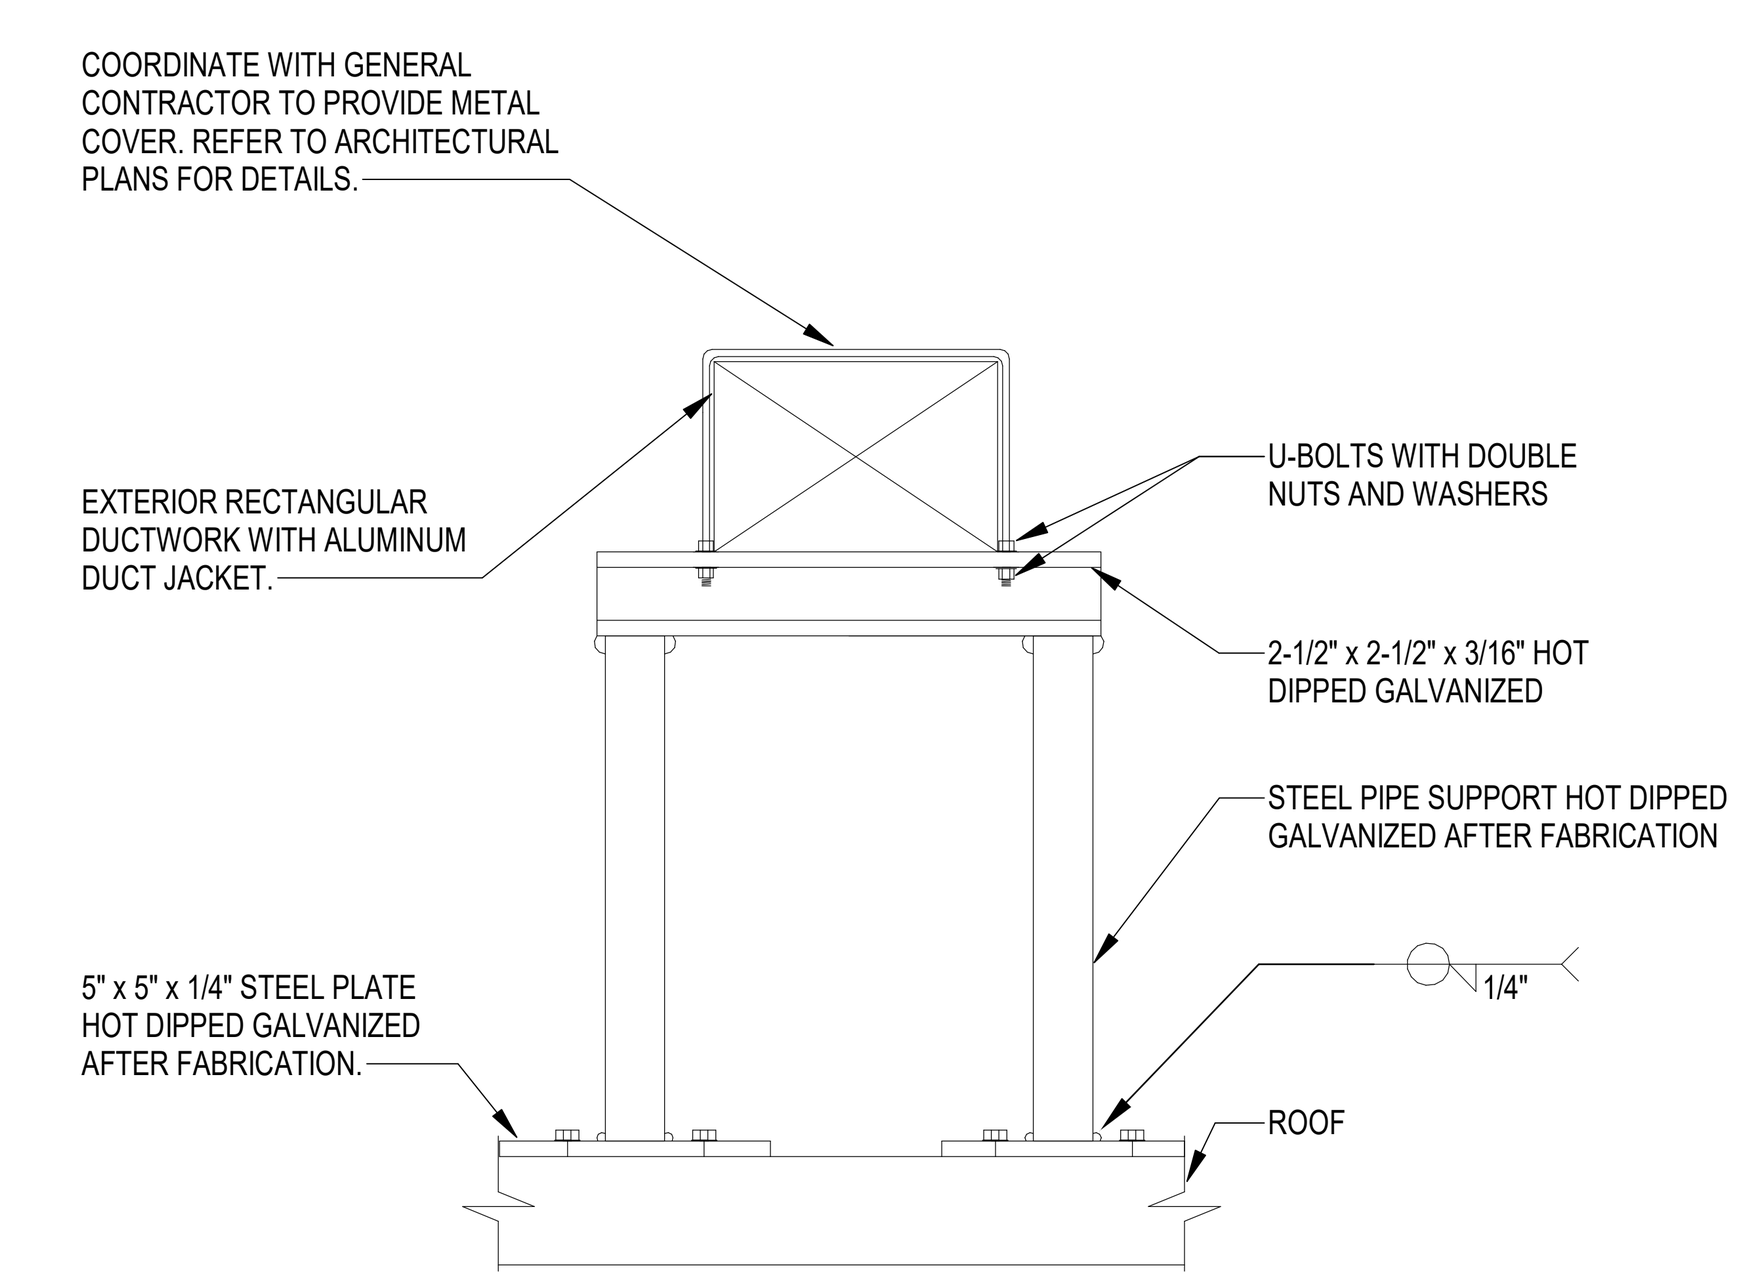

8 DUCT STAND (RECTANGULAR) DETAIL
N.T.S.

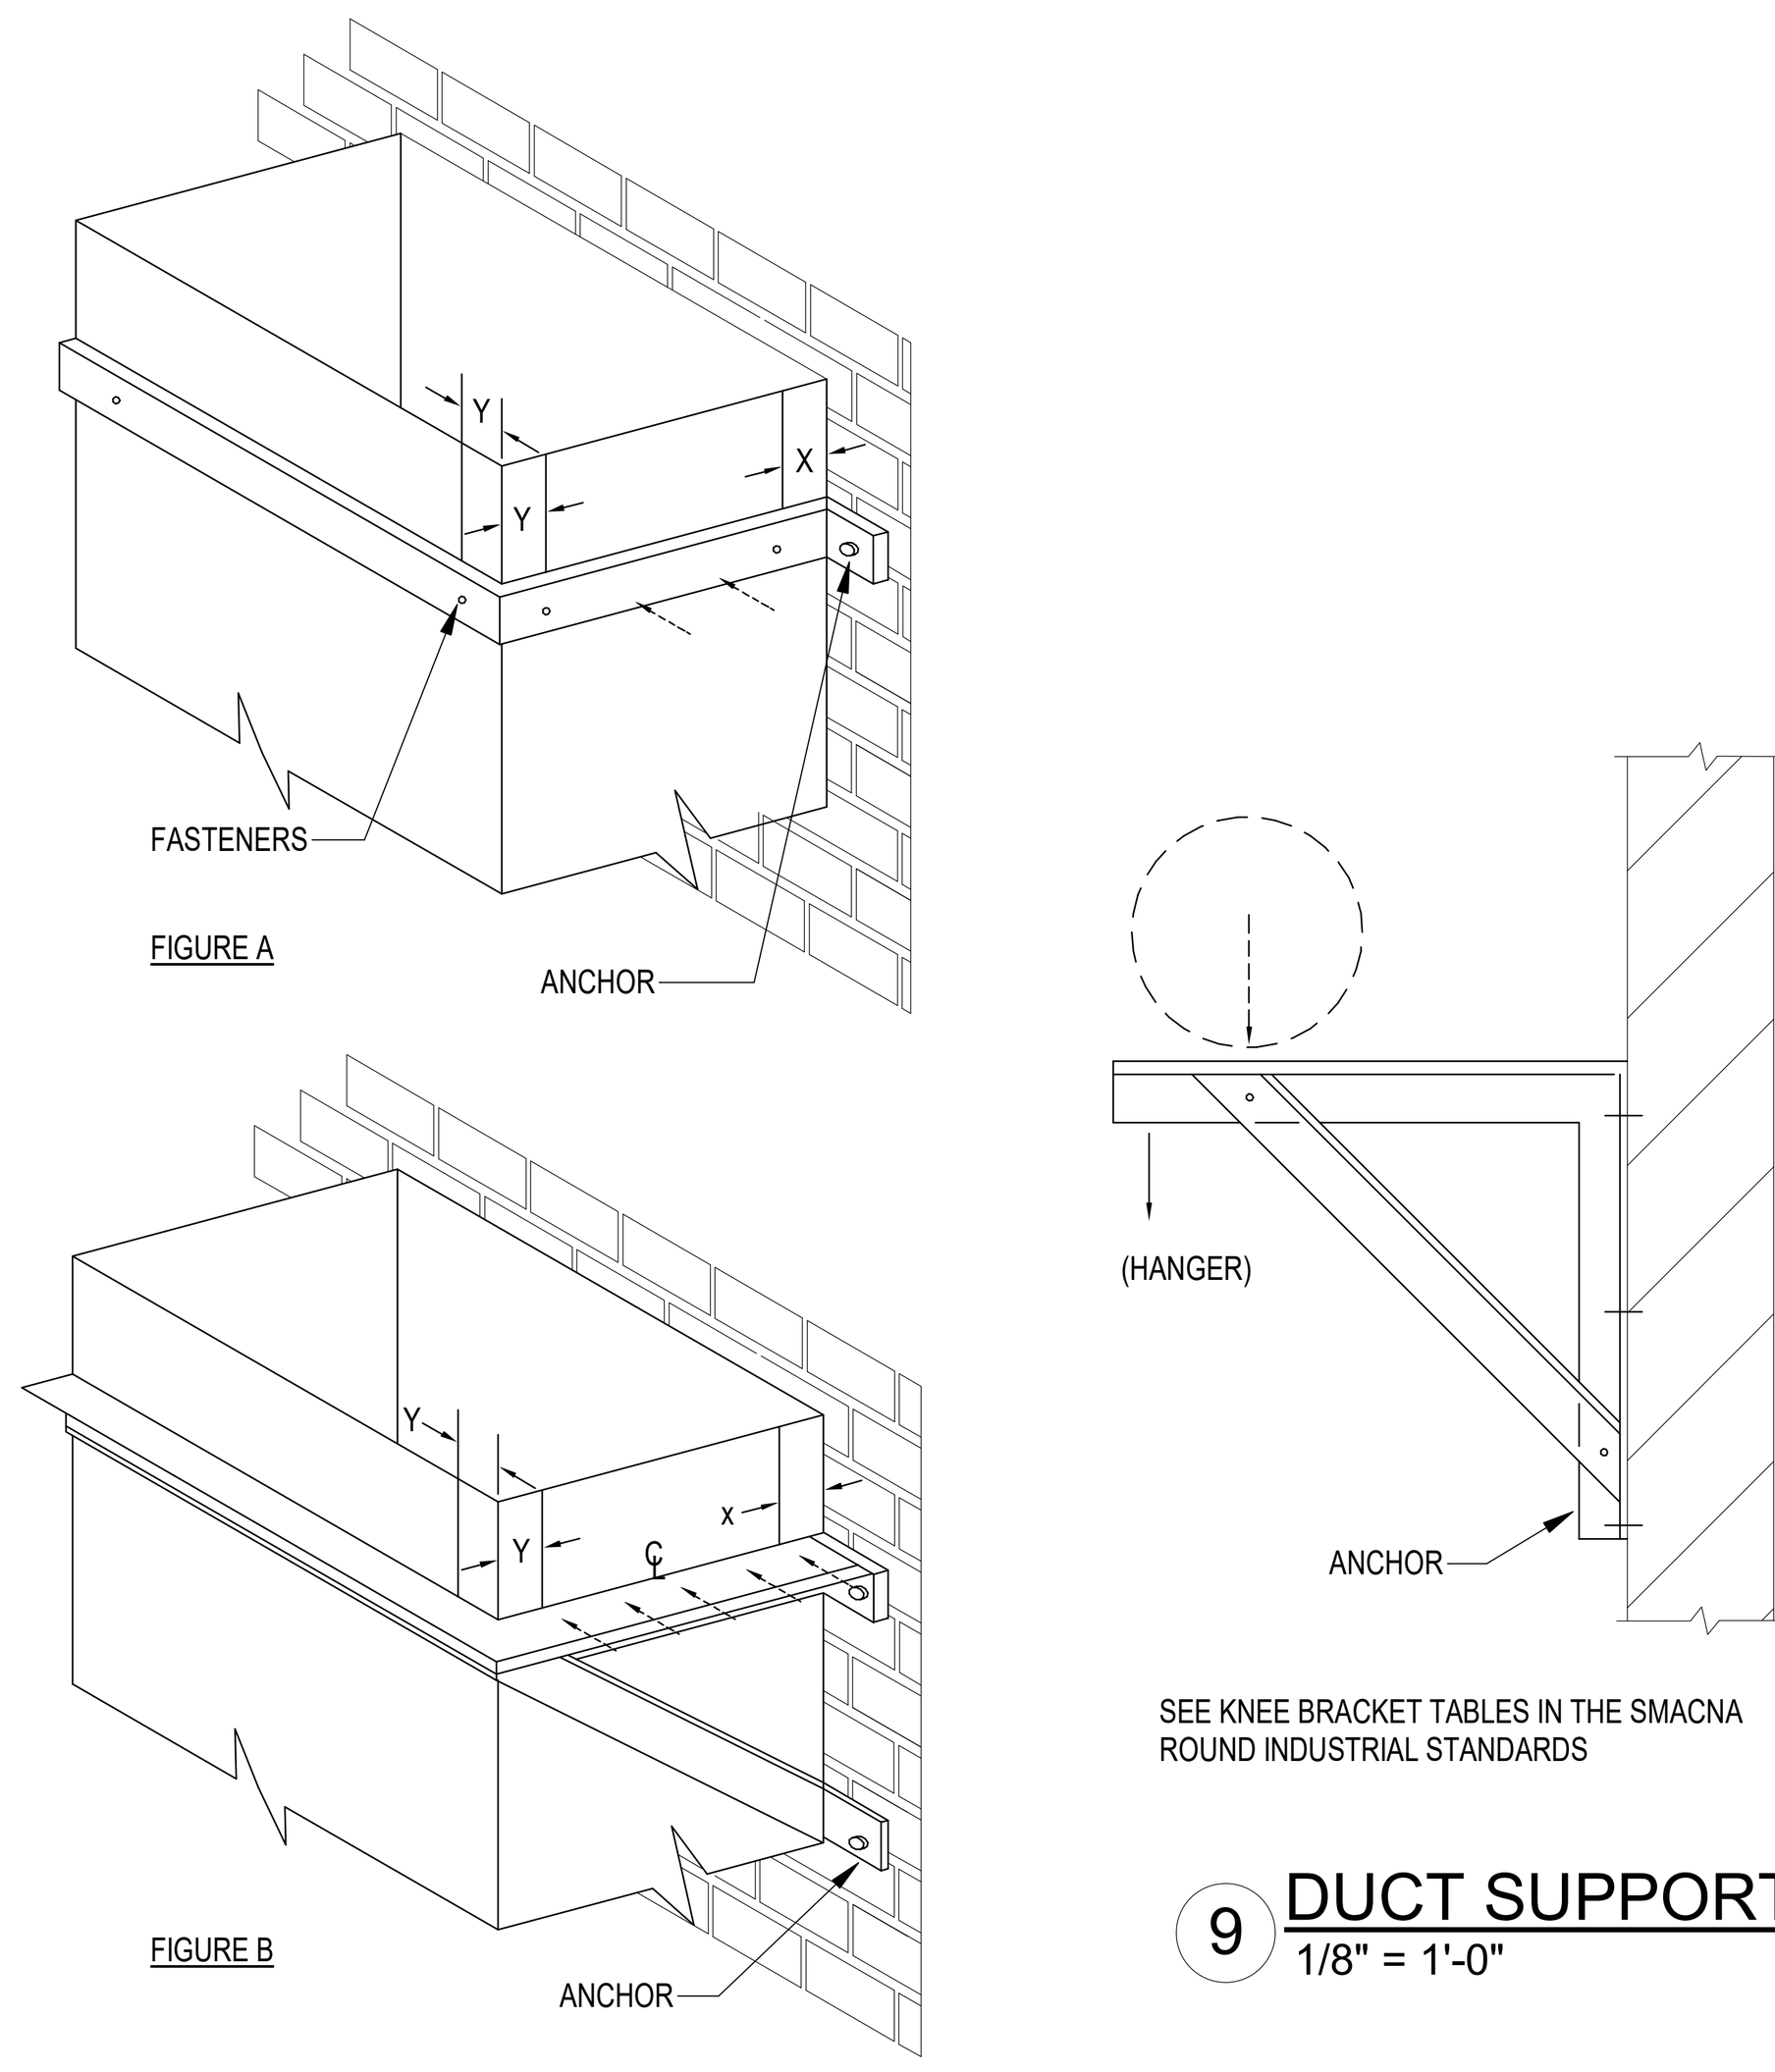

FIG A - SIZING	
DUCT SIZE	BAND
18" x 12"	1-1/2" x 16 GA
24" x 20"	1" x 1/8"

TABLE 4-4	
DUCT GAGE	ALLOWABLE LOAD PER FASTENER
28, 26	25 lb
24, 22, 20	35 lb
18, 16	50 lb

WELD, BOLT OR NO.8 SCREW (MIN.) DEVIATION PERMITTED BY OTHER ANALYSIS. X=1", Y=2"; ADD OTHERS TO ACCOMODATE LOAD. MINIMUM OF 3 24" WIDTH AND UP. ADD ALONG SIDES NEAREST ANCHORS.

FIG B - SIZING	
DUCT SIZE	ANGLE
30" x 12"	1" x 1" x 1/8"
36" x 18"	1" x 1" x 1/8"
42" x 24"	1-1/4" x 1-1/4" x 1/8"
48" x 30"	1-1/4" x 1-1/4" x 1/8"

NOTES:

1. BRACKETS ARE SIZED FOR 12 ' OF DUCT MAXIMUM
2. LOCATE DUCTS AGAINST WALL OR MAXIMUM OF 2" AWAY FROM WALL.
3. EACH WALL ANCHOR SHALL SATISFY THE FOLLOWING CRITERIA UNLESS OTHER ANALYSIS MADE.
   A. TENSILE LOAD = 3/8 x DUCT WEIGHT; SAFETY FACTOR 4.
   B. SHEAR LOAD x 1/2 x DUCT WEIGHT; SAFETY FACTOR 4.

SEE KNEE BRACKET TABLES IN THE SMACNA ROUND INDUSTRIAL STANDARDS

9 DUCT SUPPORT FROM WALL DETAIL
1/8" = 1'-0"

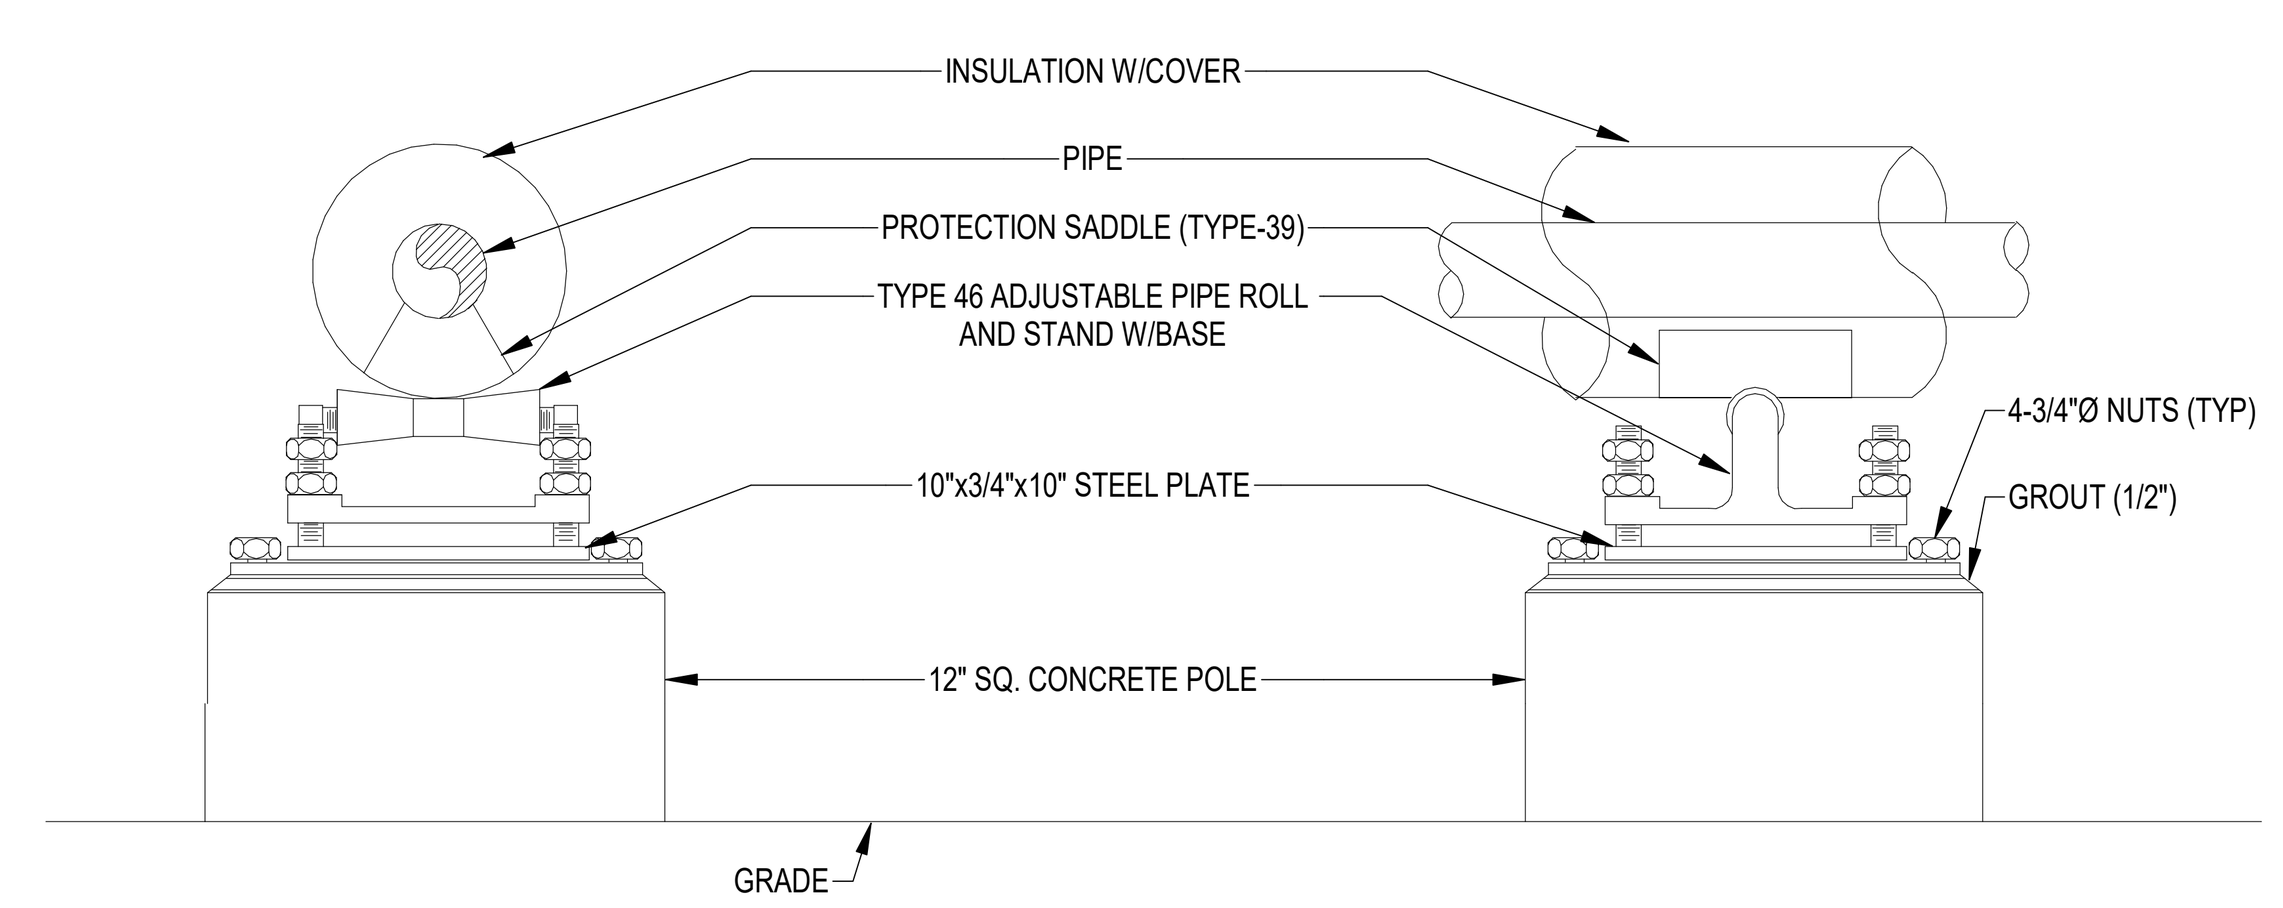

10 STEAM PIPE SUPPORT DETAIL
N.T.S.

Revisions: Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.

305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com

www.abovegroupinc.com
COA/CA Lic. No. 31120

305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM

THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
MECHANICAL DETAILS	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
			Building Number: 1
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Drawing Number: M-501
		Issue Date: 06 MARCH 2026 / Checked: CNB / Drawn: CSC	

GENERAL NOTES:

1. TERMINAL UNITS SHALL BE EQUIPPED WITH A FACTORY MOUNTED CONTROLLER.
2. ALL CONTROLS SHALL BE AUTOMATIC AND ALL SETPOINTS SHALL BE ADJUSTABLE.
3. THERMOSTATS SHALL HAVE AN UNOCCUPIED MODE OVERRIDE FOR 60 MINUTES (ADJUSTABLE).

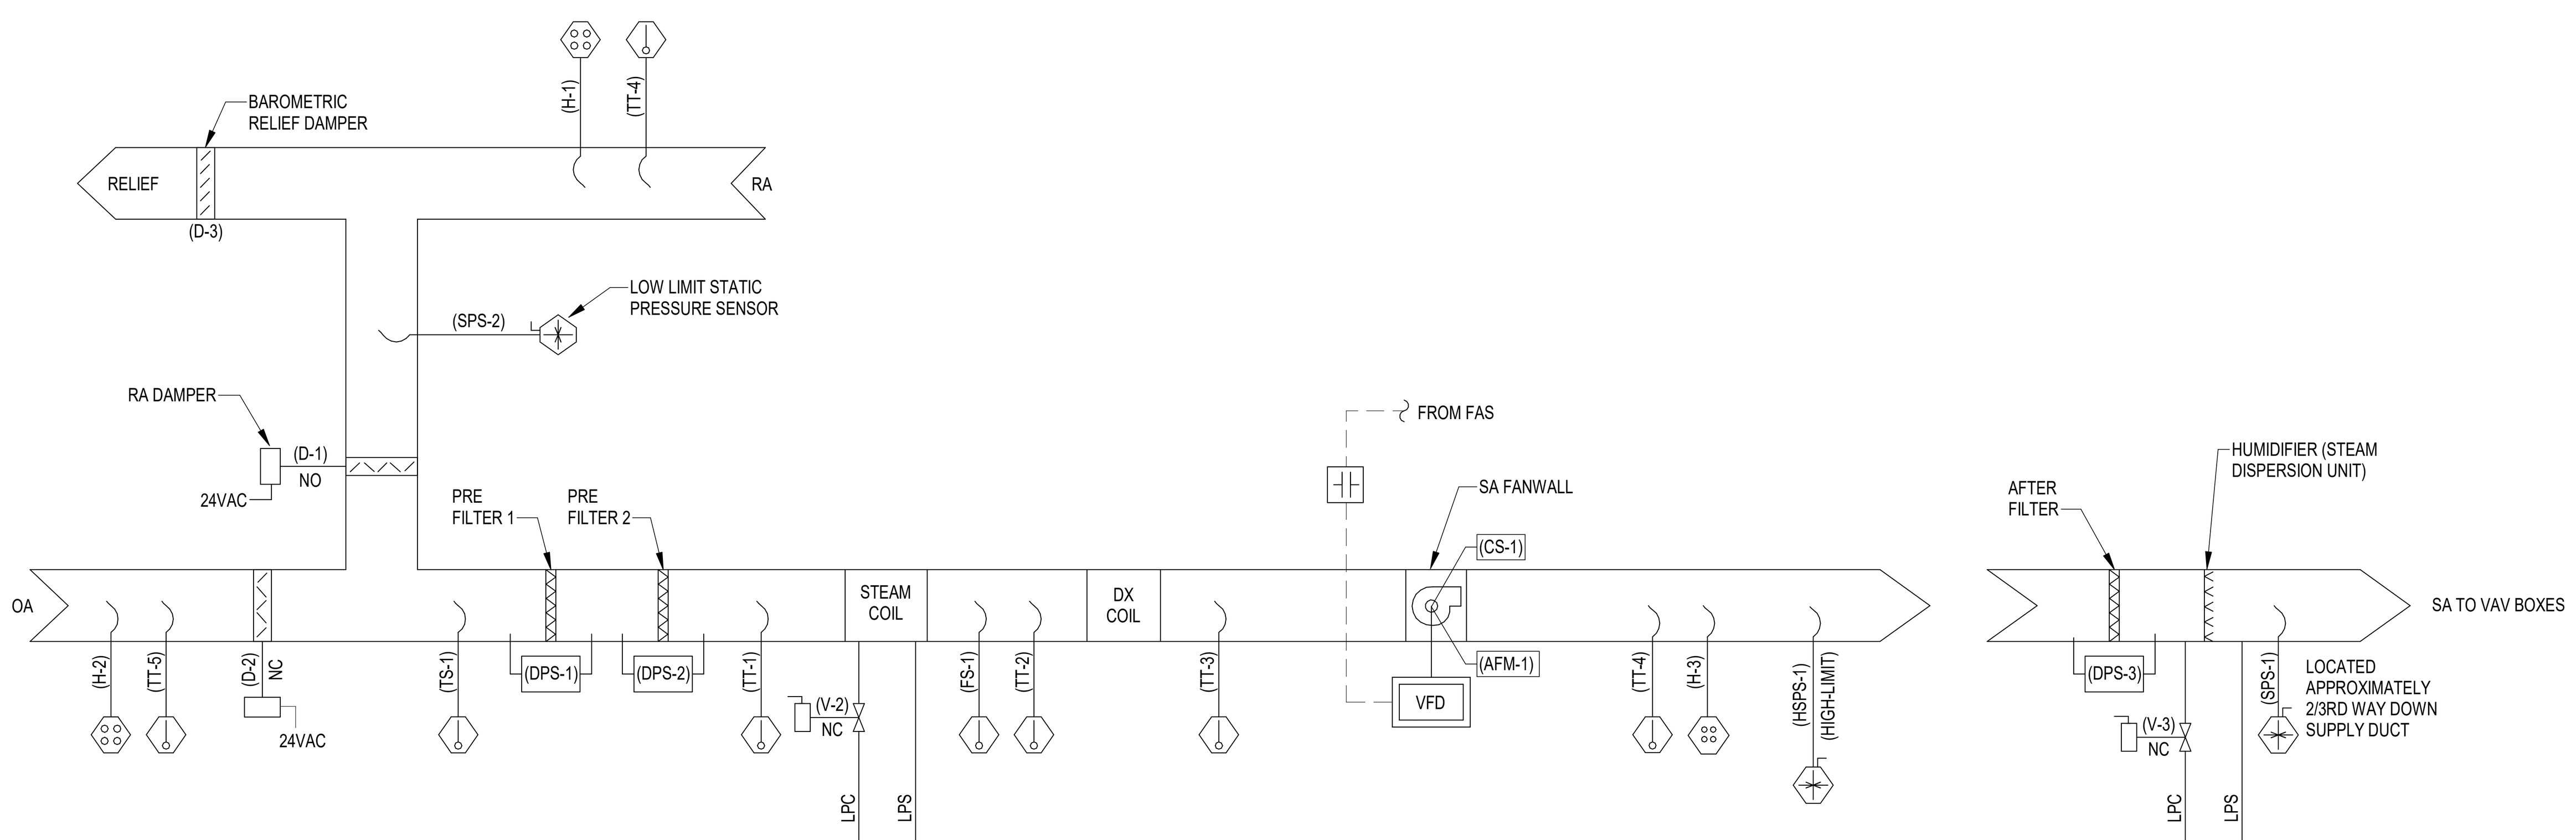

CT ROOM

(T-1) (H-1)

NOTE: REFER TO MECH. PLANS FOR LOCATION.

SEQUENCE OF OPERATION

A. **GENERAL:**
THE CONSTANT VOLUME AIR HANDLING UNIT (AHU) SHALL CONSIST OF AN OUTDOOR AIR DAMPER WITH WEATHER HOOD, RETURN AIR DAMPER, RELIEF AIR DAMPER, MIXING BOX, A FILTER SECTION, A DRECT EXPANSION (DX) COOLING SYSTEM WITH COOLING COIL, STEAM PRE-HEAT COIL, AND A VFD DRIVEN SUPPLY FAN. THE AHU SHALL BE PROVIDED WITH A FACTORY INTEGRAL MICROPROCESSOR CONTROLLER (IMC) WITH BACNET INTERFACE CAPABLE OF PROVIDING THE SEQUENCE AND POINTS DESCRIBED.

1. THE IMC SHALL INTEGRATE WITH THE BAS TO PROVIDE SEQUENCING AND LOGIC AS DESCRIBED ON THIS DRAWING.
   A. WHERE NOTED WITH AN ASTERISK, THE EQUIPMENT MANUFACTURER SHALL PROVIDE ALL FIELD DEVICES REQUIRED TO ACHIEVE THE POINTS SHOWN.
   B. THE EQUIPMENT MANUFACTURER SHALL PROVIDE INTEGRATION OF POINTS FROM THE BAS INTO THE IMC TO ACHIEVE THE SEQUENCING AND LOGIC AS DESCRIBED ON THIS DRAWING.
2. THE BAS CONTRACTOR SHALL PROVIDE THE FOLLOWING:
   A. GRAPHICS FOR THE UNIT USING THE BACNET POINTS LISTED AND DESCRIBED ON THIS DRAWING.
   B. INTERCONNECTION OF AHU BACNET CARD TO BAS NETWORK CONTROL PANEL.
   C. INTEGRATION OF POINTS PROVIDED FROM THE AHU TO THE BAS.
   D. INSTALLATION AND INTERCONNECTION OF FIELD DEVICES REMOTE FROM THE AHU.
   E. OVERRIDE TIMER SWITCH FOR MANUAL CHANGE OF STATE OF AHU FROM UNOCCUPIED MODE TO OCCUPIED MODE.
   F. COMMISSIONING VERIFICATION OF BAS SYSTEM REQUIREMENTS AS IDENTIFIED.

B. AIR HANDLING UNIT OPERATION:
THE AIR HANDLING UNIT SHALL RECEIVE AN OCCUPIED / UNOCCUPIED STATUS FROM THE BAS AS SCHEDULED BELOW.
1. AHU-A259 SHALL BE OCCUPIED 6:00 AM TO 6:00 PM, MONDAY THROUGH FRIDAY WITH THE EXCEPTION OF STATE HOLIDAYS (ADJUSTABLE, 365 DAY).

A MANUAL OVERRIDE TIMER SWITCH LOCATED IN THE OCCUPIED SPACE SHALL SWITCH THE OPERATION OF THE AHU AND ALL ASSOCIATED VAV BOXES FROM UNOCCUPIED TO OCCUPIED MODE FOR A MAXIMUM OF 60 MINUTES. AHU AND VAV BOXES SHALL REMAIN IN OCCUPIED MODE UNTIL THE TIMER SWITCH FINISHES TIME DURATION. THE BUILDING AUTOMATION SYSTEM (BAS) SHALL INDICATE THAT UNIT IS OPERATING THE OVERRIDE TIMER MODE.

C. OCCUPIED MODE:
WHEN THE UNIT IS INDEXED TO THE OCCUPIED MODE BY THE BAS, THE SUPPLY FAN SHALL BE ENERGIZED. THE IMC SHALL COMMAND THE OUTDOOR AIR AND RETURN AIR DAMPERS TO THEIR MINIMUM SCHEDULED POSITIONS AS DETERMINED BY THE AIR FLOW BALANCE. THE BAS SHALL MODULATE THE SUPPLY FAN TO MAINTAIN THE DUCT STATIC PRESSURE SETPOINT DETERMINED BY THE TAB CONTRACTOR (ADJ.). AS THE SUPPLY FAN SPEED IS REDUCED TO MINIMUM, THE OUTDOOR AIR AND RETURN AIR DAMPERS SHALL MODULAT E TO THEIR MAXIMUM POSITIONS AS DETERMINED BY THE AIR FLOW BALANCE.

THE UNIT SHALL RECEIVE THE SUPPLY AIR TEMPERATURE SETPOINT FROM THE BAS. THE BAS SHALL RESET THE SUPPLY AIR TEMPERATURE BASED ON THE ZONE TERMINAL UNIT CONTROL.
1. WHEN TERMINAL UNIT REHEAT IS ACTIVE FOR 30 MINUTES OR MORE, RESET SUPPLY AIR TEMPERATURE UP IN 1°F INCREMENTS EVERY 30 MINUTES UNTIL RETURN AIR RELATIVE HUMIDITY RISES ABOVE 60 PERCENT AT WHICH TIME SUPPLY AIR TEMPERATURE SHALL BE RESET TO 53°F IN 1°F INCREMENTS EVERY 10 MINUTES (ADJUSTABLE).

PRIOR TO ENTERING OCCUPIED MODE, THE UNIT SHALL UTILIZE AN OPTIMUM START SEQUENCE TO RETURN THE SPACE FROM THE SETBACK TEMPERATURE TO THE OCCUPIED TEMPERATURE. DURING THIS PERIOD THE OUTDOOR AIR DAMPER SHALL REMAIN FULLY CLOSED AND THE RETURN AIR DAMPER SHALL REMAIN FULLY OPEN.

D. DX COOLING:
COOLING MODE SHALL BE ENABLED WHENEVER THE UNIT DISCHARGE AIR TEMPERATURE EXCEEDS THE SYSTEM SYPPLY AIR TEMPERATURE SETPOINT, THE IMC SHALL ENERGIZE AND MODULATE THE DX COOLING SYSTEM. THE COMPRESSORS SHALL OPERATE TO MAINTAIN THE SUPPLY AIR TEMPERATURE SETPOINT, UTILIZING THE HOT GAS REHEAT COIL WHEN NEEDED FOR CAPACITY CONTROL.

E. HEATING MODE:
WHEN THE OUTSIDE AIR TEMPERATURE IS BELOW 40°F (ADJ.), THE STEAM COIL SHALL BE ENABLED. THE STEAM CONTROL VALVE SHALL MODULATE TO MAINTAIN THE SYSTEM SUPPLY AIR TEMPERATURE SETPOINT.

F. ECONOMIZER MODE:
ECONOMIZER SHALL BE A COMPARATIVE ENTHALPY TYPE. ECONOMIZER MODE SHALL BE ENABLED WHENEVER THE OUTDOOR AIR ENTHALPY IS LESS THAN THE RETURN AIR ENTHALPY. THE OUTDOOR AIR AND RETURN AIR DAMPERS SHALL MODULATE TO MAINTAIN THE SYSTEM SUPPLY AIR TEMPERATURE SETPOINT WITH MINIMAL USE OF REFRIGERATION CYCLE. THE OUTDOOR AIR DAMPER SHALL NOT CLOSE BEYOND THE MINIMUM POSITION.

ECONOMIZER MODE SHALL BE DISABLED WHENEVER THE OUTDOOR AIR ENTHALPY IS GREATER THAN THE RETURN AIR ENTHALPY OR IF THE OUTSIDE AIR TEMPERATURE IS LESS THAN 40°F

G. DEHUMIDIFICATION MODE:
WHEN THE RETURN AIR HUMIDITY MEASURES GREATER THAN 60% (ADJ), THE UNIT SHALL ENTER DEHUMIDIFICATION MODE. DURING DEHUMIDIFICATION MODE, THE IMC SHALL UTILIZE THE HOT GAS REHEAT COIL AND OVERRIDE THE SUPPLY AIR TEMPERATURE SETPOINT TO 55°F (ADJ.). WHEN THE RETURN AIR HUMIDITY MEASURES LESS THAN 50% (ADJ), THE UNIT SHALL EXIT DEHUMIDIFICATION MODE.

H. UNOCCUPIED MODE:
WHEN THE UNIT IS INDEXED TO UNOCCUPIED MODE BY THE BAS, THE AHU SHALL NORMALLY BE DE-ENERGIZED. THE OUTDOOR AIR DAMPER SHALL BE FULLY CLOSED AS PROVEN BY AN END SWITCH AND THE RETURN AIR DAMPER SHALL BE FULLY OPEN. THE BAS WILL MONITOR ZONE TEMPERATURES ASSOCIATED WITH EACH VAV BOX. IF ANY VAV ZONE TEMPERATURE DEVIATES FROM SETPOINT BY 5°F, THE BAS SHALL INDEX THE AHU TO OPERATE IN THE UNOCCUPIED MODE WITH THE OUTDOOR AIR DAMPER FULLY CLOSED AND THE RETURN AIR DAMPER FULLY OPEN. THE SUPPLY FAN SHALL BE ENERGIZED AND CIRCULATE 100% RETURN AIR.
1. UNOCCUPIED HEATING: THE BUILDING SHALL BE HEATED TO MAINTAIN SETBACK TEMPERATURE BY THE VAV BOX HEATING WATER COILS, AS CONTROLLED BY THE BAS. UPON REACHING SETPOINT, THE SUPPLY FAN SHALL BE DE-ENERGIZED.
2. UNOCCUPIED COOLING: THE DX COOLING SYSTEM SHALL OPERATE AS COMMANDED BY THE IMC TO MAINTAIN SYSTEM SUPPLY AIR TEMPERATURE BASED ON THE OUTDOOR AIR TEMPERATURE RESET SCHEDULE DESCRIBED ABOVE. UPON REACHING SETPOINT, THE COOLING SYSTEM AND THE FAN SHALL BE DE-ENERGIZED.

I. SAFETIES / ALARMS:
RESTART OF THE UNIT AFTER AN ALARM EVENT THAT SHUTS DOWN THE UNIT SHALL BE PERFORMED AT THE IMC ONCE THE ALARM HAS CLEARED.
1. LOW TEMPERATURE: UPON SENSING AIR TEMPERATURE BELOW 45°F (ADJ.) AT THE FREEZE STAT, A LOW TEMPERATURE ALARM SHALL BE DISPLAYED AT THE BAS. UPON A FURTHER DROP IN AIR TEMPERATURE TO 40°F (ADJ.), THE OUTDOOR AIR DAMPER SHALL FULLY CLOSE, THE RETURN AIR DAMPER SHALL FULLY OPEN, AND THE STEAM VALVE SHALL MODULATE FULLY OPEN.
2. SMOKE DETECTOR: UPON A TRIP OF THE SUPPLY OR RETURN AIR SMOKE DETECTOR, THE UNIT SHALL SHUT DOWN. THE SUPPLY FAN SHALL DE-ENERGIZE, THE OUTDOOR AIR DAMPER SHALL CLOSE, AND AN ALARM SHALL BE GENERATED AT THE BAS AND THE FIRE ALARM CONTROL PANEL.
3. HIGH STATIC: UPON A TRIP OF THE UNIT HIGH STATIC PRESSURE SWITCH (3.5"W.C., ADJ.) THE UNIT SHALL BE DE-ENERGIZED AND AN ALARM SHALL BE DISPLAYED AT THE BAS.
4. REFRIGERANT FAULT DETECTION AND DIAGNOSTICS: THE UNIT IMC SHALL MONITOR REFRIGERANT CIRCUIT PRESSURES, TEMPERATURES, AND ENVIRONMENTAL CONDITIONS. THE IMC SHALL PROVIDE ALARMS AND DIAGNOSTIC INFORMATION TO THE BAS.

J. EMERGENCY EPIDEMIC MODE:
WHEN COMMANDED BY THE BAS, THE UNIT SHALL OPERATE AT 100% OUTSIDE AIR CONDITIONS. OUTSIDE AIR DAMPER SHALL FULLY OPEN. RETURN AIR DAMPER SHALL CLOSE AND REDIRECT RETURN AIR TO RELIEF VENT.

INPUT/OUTPUT SUMMARY

SYSTEM		ANALOG											DIGITAL										SYSTEM FEATURES											REMARKS
		INPUT								OUTPUT			INPUT					OUTPUT					ALARMS						PROGRAMS					
VARIABLE VOLUME AIR AIR HANDLING UNIT	COMMUNICATION/ DATA INTERFACE	TEMPERATURE	HUMIDITY	STATIC PRESSURE	FREQUENCY	CFM	GPM	PPM	SPEED	SETPOINT ADJUSTMENT	VALVE ACTUATOR	DAMPER ACTUATOR	DIFF. PRESSURE SWITCH	STATUS	SPEED SWITCH	CURRENT RELAY	FLOW SWITCH	ON-OFF	DAMPER ACTUATOR	VALVE ACTUATOR	SPEED SIGNAL	ELEC. HEAT STAGES	PROOF	COMMUNICATION FAILURE	DIRTY FILTER	HIGH-LOW VALUE	HIGH/LOW PRESSURE	CO2 LEVEL	TIME SCHEDULE / TREND	PROGRAM START / STOP	HAND-OFF-AUTO	RUN TIME	GRAPHIC	
SYSTEM																		●					●						●	●	●	●	●	BAS, HOA
SUPPLY AIR FAN	●			●	●				●	●						●		●			●			●						●		●	●	CS-1, VFD, SPS-1, AFS-1
RETURN AIR	●	●	●	●								●					●									●							●	D-1, TT-1, SPS-2, FS-1
SUPPLY AIR		●																															●	TT-4
COILS		●									●						●	●															●	V-1, TT-2, TT-3
FILTERS													●												●								●	DPS-1, DPS-2, DPS-3
SPACE		●	●					●																				●					●	T-1, H-1
OUTSIDE AIR		●	●			●		●				●														●		●					●	D-2, AFS-1, T-1, H-1

1 AHU-A259 CONTROL DIAGRAM
N.T.S.

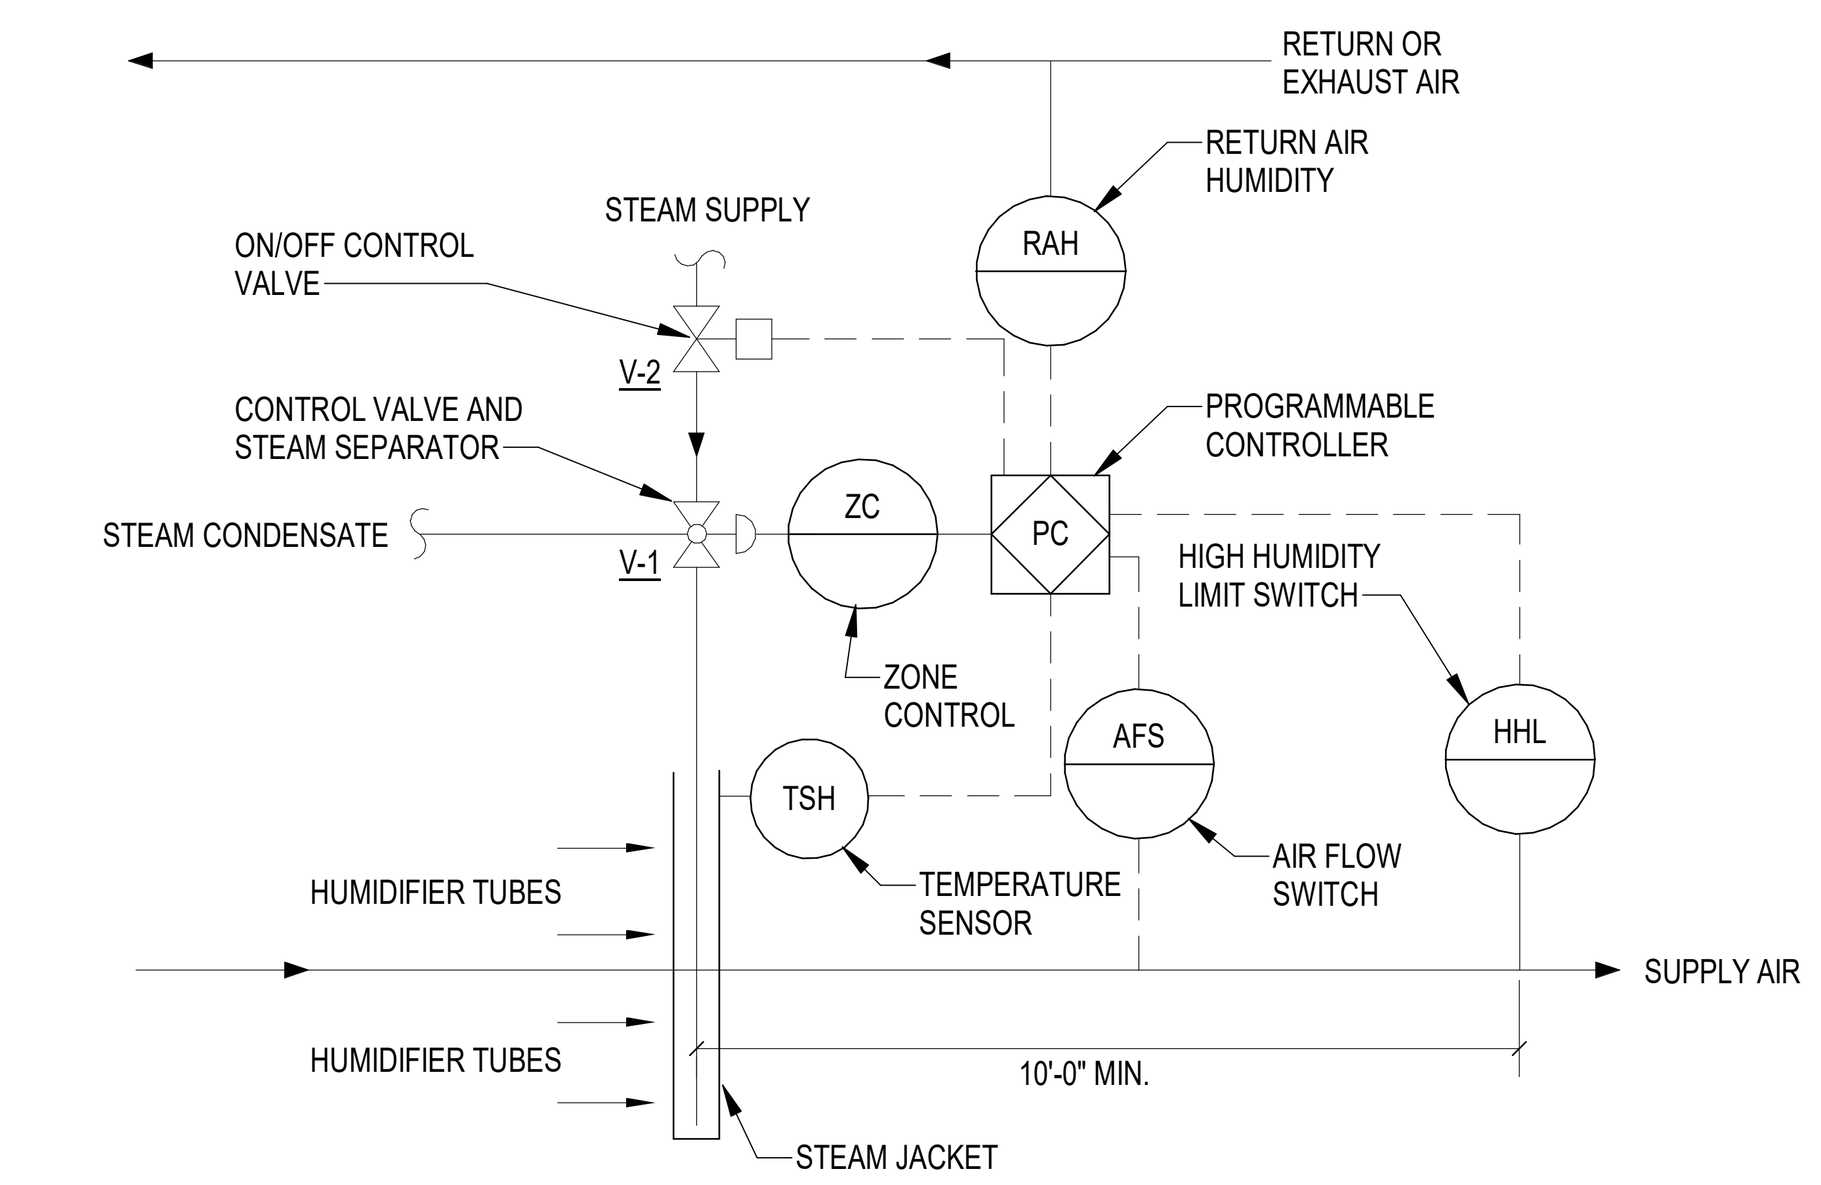

STEAM HUMIDIFIER CONTROL NOTES:
RETURN (OR EXHAUST) AIR HUMIDITY SHALL BE MONITORED. ON A CALL FOR HUMIDIFICATION, HUMIDIFIER VALVE V-1 SHALL MODULATE TO MAINTAIN THE RETURN (OR EXHAUST) AIR HUMIDITY SET POINT TO 30% (ADJ.). PRIOR TO ACTIVATION OF V-1, THE ON/OFF CONTROL VALVE V-2 SHALL BE ENABLED THROUTH ECC AND JACKET TEMPERATURE SENSED BY TSH SHALL BE WARM ENOUGH TO PREVENT CONDENSATION. THE HIGH LIMIT HUMIDITY SENSOR, LOCATED IN THE SUPPLY AIR DUCT 10 FT AWAY FROM THE HUMIDIFIER SHALL DISABLE THE HUMIDIFIER AND GIVE AN ALARM SIGNAL TO THE ECC, IF THE SUPPLY AIR HUMIDITY EXCEEDS 90% RH (ADJ.). THE AIRFLOW SWITCH SHALL PROVE AIRFLOW BEFORE HUMIDITY CONTROLS ARE ACTIVATED.

2 JACKETED STEAM HUMIDIFIER CONTROLS
N.T.S.

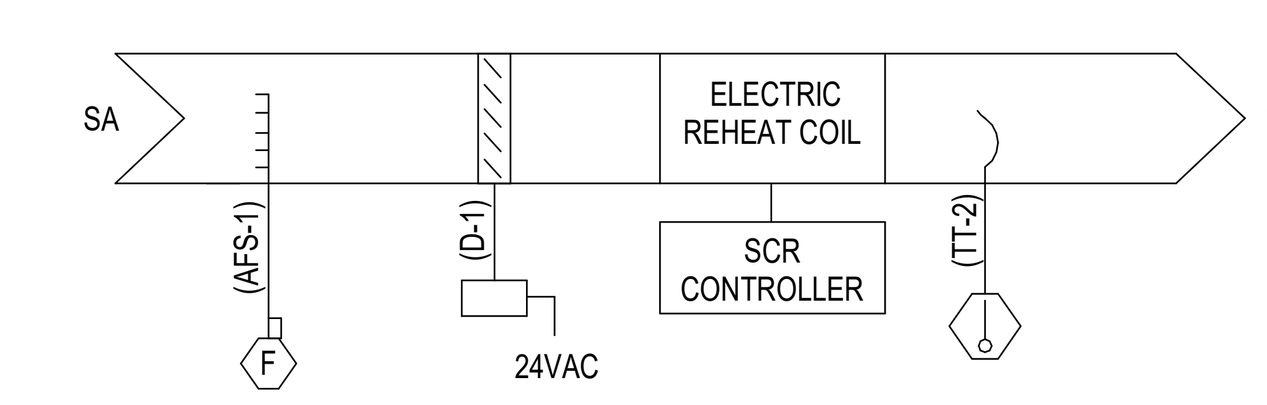

NOTES:
1. DAMPER D-1 SHALL BE PROVIDED BY VAV TERMINAL BOX MANUFACTURER.

SPACE SENSORS

(TS-1)

NOTE: REFER TO MECH. PLANS FOR LOCATIONS.

SEQUENCE OF OPERATION

A. GENERAL:
THE CV BOX WILL RECEIVE PRIMARY AIR FROM A CONSTANT AIR VOLUME AIR HANDLING UNIT.

B. OCCUPIED MODE:
DURING OCCUPIED HOURS, THE CV BOX SHALL MODULATE THE ELECTRIC COIL THROUGH SCR CONTROLS IN ORDER TO MAINTAIN THE ROOM TEMPERATURE SETPOINT. THE PRIMARY AIR DAMPER SHALL INITIALLY BE AT THE MINIMUM POSITION (AS DETERMINED DURING BALANCING) AND THE ELECTRIC COIL SHALL BE DE-ENERGIZED.

COOLING
THE COOLING SPACE TEMPERATURE SETPOINT SHALL BE 75°F (ADJ). UPON SENSING A SPACE TEMPERATURE ABOVE THE OCCUPIED SPACE TEMPERATURE SETPOINT, THE CV BOX SHALL MODULATE THE PRIMARY AIR DAMPER TO MAINTAIN SCHEDULED AIRFLOW. ELECTRIC COIL SHALL MODULATE THROUGH SCR CONTROLS TO MAINTAIN SPACE TEMPERATURE SETPOINT.

HEATING
THE HEATING SPACE TEMPERATURE SETPOINT SHALL BE 70°F (ADJ.). UPON SENSING A SPACE TEMPERATURE BELOW THE OCCUPIED SPACE TEMPERATURE SETPOINT, THE CV BOX ELECTRIC COIL SHALL MODULATE THROUGH SCR CONTROLS TO MAINTAIN SPACE TEMPERATURE SETPOINT. IF THE SPACE TEMPERATURE RISES ABOVE THE HEATING SPACE TEMPERATURE SETPOINT, THE ELECTRIC COIL SHALL MODULATE DOWN THROUGH SCR CONTROLS.

C. UNOCCUPIED:
1. DURING UNOCCUPIED HOURS, THE CV BOX SHALL MODULATE THE DAMPER IN ORDER TO MAINTAIN THE TEMPERATURE AT THE THERMOSTAT AT THE UNOCCUPIED TEMPERATURE SETPOINT OF 68°F (ADJ.).
2. MODULATION OF THE DAMPER SHALL BE IDENTICAL TO THE OCCUPIED SEQUENCE WHILE TRYING TO MAINTAIN THE UNOCCUPIED TEMPERATURE SETPOINT.

D. SAFETY:
IF THE SUPPLY AIR TEMPERATURE IS GREATER THAN 120°F, AN ALARM SHALL BE GENERATED AT THE BAS.

E. NETWORK CONNECTIVITY:
THE CV BOX SHALL BE CONNECTED TO A BAS NETWORK TO BE PROVIDED UNDER THIS CONTRACT. IF ACCESS TO NETWORK IS REQUIRED FOR BASE BUILDING OPERATION, CONNECTIVITY WILL BE THE RESPONSIBILITY OF THE BASE BUILDING CONTRACTOR.

INPUT/OUTPUT SUMMARY

SYSTEM		ANALOG							DIGITAL										SYSTEM FEATURES											REMARKS
		INPUT				OUTPUT			INPUT					OUTPUT					ALARMS						PROGRAMS					
VARIABLE AIR VOLUME TERMINAL UNIT	COMMUNICATION/ DATA INTERFACE	TEMPERATURE	STATIC PRESSURE	CFM	SPEED	SETPOINT ADJUSTMENT	VALVE ACTUATOR	DAMPER ACTUATOR	DIFF. PRESSURE SWITCH	STATUS	SPEED SWITCH	CURRENT RELAY	FLOW SWITCH	ON-OFF	DAMPER ACTUATOR	VALVE ACTUATOR	SPEED SIGNAL	ELEC. HEAT STAGES	PROOF	COMMUNICATION FAILURE	DIRTY FILTER	HIGH-LOW VALUE	HIGH/LOW PRESSURE	CO2 LEVEL	TIME SCHEDULE / TREND	PROGRAM START / STOP	HAND-OFF-AUTO	RUN TIME	GRAPHIC	
TERMINAL UNIT CONTROLLER	●																												●	BAS
SUPPLY AIR		●		●																									●	TS-1, AFS-1
DAMPERS								●																					●	D-1
REHEAT COIL																		●											●	HEATER CONTROLLER
SPACE		●																											●	TS-1

3 CONSTANT VOLUME TERMINAL UNIT CONTROL DIAGRAM
N.T.S.

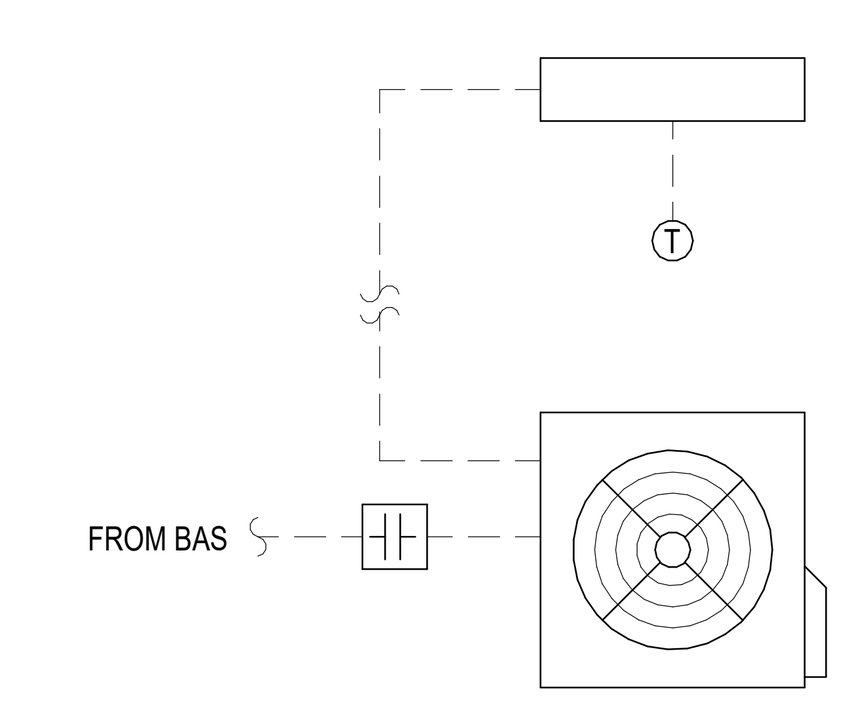

SEQUENCE OF OPERATION

GENERAL:
1. UNIT SHALLOPERATE THROUGH MANUFACTURER'S SUPPLIED CONTROLS TO MAINTAIN ROOM TEMPERATURE SETPOINT, 75°F. THERMOSTAT SHALL BE CONNECTED TO BUILDING AUTOMATION SYSTEM FOR MONITORING ONLY.

INPUT/OUTPUT SUMMARY

SYSTEM		ANALOG								DIGITAL										SYSTEM FEATURES									REMARKS
		INPUT					OUTPUT			INPUT					OUTPUT					ALARMS				PROGRAMS					
IDU	COMMUNICATION/ DATA INTERFACE	TEMPERATURE	STATIC PRESSURE	FREQUENCY	CFM	SPEED	SETPOINT ADJUSTMENT	VALVE ACTUATOR	DAMPER ACTUATOR	DIFF. PRESSURE SWITCH	STATUS	SPEED SWITCH	CURRENT RELAY	FLOW SWITCH	ON-OFF	DAMPER ACTUATOR	VALVE ACTUATOR	SPEED SIGNAL	ELEC. HEAT STAGES	PROOF	COMMUNICATION FAILURE	HIGH-LOW VALUE	HIGH/LOW PRESSURE	TIME SCHEDULE / TREND	PROGRAM START / STOP	HAND-OFF-AUTO	RUN TIME	GRAPHIC	
SPACE		●																											BAS

4 DUCTLESS SPLIT CONTROL DIAGRAM
N.T.S.

Revisions: Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP
COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
ALLEN LANTZ III
ENGINEER
PE091315

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
MECHANICAL CONTROLS	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
			Building Number: 1
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Drawing Number: M-701
		Issue Date: 06 MARCH 2026; Checked: CNB; Drawn: CSC	

AIR HANDLING UNIT SCHEDULE

UNIT NO.	AREA SERVED	LOCATION	OUTSIDE AIR MIN. CFM	OUTSIDE AIR MAX. CFM	SUPPLY FAN SUPPLY (CFM)	SUPPLY FAN QTY.	SUPPLY FAN BHP	SUPPLY FAN HP	SUPPLY FAN MAX RPM	SUPPLY FAN MAX. ESP
AHU-A259	CT ROOM A259	MECH YARD	175	1210	1210	1	1.6	2	2102	3.0

UNIT NO.	DX COOLING COIL EMERGENCY MODE EAT DB °F	EMERGENCY MODE EAT WB °F	EAT DB (°F)	EAT WB (°F)	LAT DB (°F)	LAT WB (°F)	MAX FACE VEL. (FPM)	MAX APD (In. H2O)	MAX WPD (Ft. H20)	TOTAL CAP. (MBH)	SENS. CAP. (MBH)	REFR.
AHU-A259	95.5	76.8	78.1	63.4	54	51	450	.75	10	109	57	R-454B

UNIT NO.	REHEAT COIL EAT DB (°F)	LAT DB (°F)	CAPACITY (PPH)	STM PRESS. (PSIG)	MAX FACE VEL. (FPM)	MAX APD (In. H2O)	SENS. (MBH)
AHU-A259	2	59	93	5	450	0.11	86

UNIT NO.	FILTERS PRE-FILTERS MERV	PRE-FILTERS INIT	PRE-FILTERS FINAL	PRE-FILTERS MERV	PRE-FILTERS INIT	PRE-FILTERS FINAL	FINAL FILTER MERV	FINAL FILTER INIT	FINAL FILTER FINAL
AHU-A259	8	0.14	0.25	11	0.27	0.5	14	0.35	0.70

UNIT NO.	ELECTRICAL MCA	MOCP	V	PH	HZ	UNIT WEIGHT	BASIS OF DESIGN	COMMENTS
AHU-A259	33	50	208	3	60	1000	AAON / RQ-005-A-A	ALL LISTED

NOTES:

1. AFTER FILTER (AF) IS EXTERIOR MOUNTED IN SUPPLY DUCT. PROVIDE FILTER HOUSING EQUAL TO MFR: AAF, MODEL: SUREAIRE.
2. PROVIDE WITH HOT GAS REHEAT.
3. PROVIDE SINGLE POINT ELECTRICAL CONNECTION. STARTER, RELAY, AND CONTROLS SHALL BE PART OF PACKAGED UNIT.
4. PROVIDE WITH 30% EFFICIENCY FILTERS.
5. PROVIDE WITH HUMIDISTAT CONTROL.

DUCTLESS SPLIT SYSTEM SCHEDULE

	INDOOR UNIT						OUTDOOR UNIT				ELECTRICAL DATA						
		TOTAL		EAT													
UNIT NO.	CFM	COOLING CAP. (MBH)	ESP	DB	WB	LOCATION	LOCATION	OA DB (SUMMER)	OA DB (WINTER)	MIN. SEER2	V	PH	HZ	MCA	MOCP	BASIS OF DESIGN	COMMENTS
IDU-A259B	400	18	0.5	80	67	EQUIPMENT ROOM A259B	MECHANICAL YARD	115	-40	20.2	208	1	60	12	28	MITSUBISHI / PKA-A18 - PUY-A18	ALL LISTED

NOTES:

1. PROVIDE SINGLE POINT ELECTRICAL CONNECTION.
2. DISCONNECT WIRED BY ELECTRICAL CONTRACTOR.
3. SIZE REFRIGERANT LINES PER MANUFACTURER RECOMMENDATIONS.
4. PROVIDE 5 YEAR COMPRESSOR WARRANTY.
5. PROVIDE ANTI-RECYCLE COMPRESSOR TIMER.
6. PROVIDE CONDENSER COIL GUARDS.
7. AMBIENT DESIGN TEMPERATURE: 95°F
8. INDOOR UNIT IS ELECTRICALLY POWERED FROM THE OUTDOOR UNIT.

SINGLE DUCT TERMINAL UNIT SCHEDULE (CV - ELECTRIC HEAT)

			PRIMARY AIR		STATIC PRESSURE ("WG)		PRIMARY AIR	TERMINAL HEAT COIL CHARACTERISTICS								
UNIT NO.	LOCATION	INLET SIZE (")	DESIGN CFM	HEATING CFM	INLET	DOWNSTREAM	NC RATING	MBH	EAT (°F)	LAT (°F)	MCA	MOCP	KW	V/PH/HZ	BASIS OF DESIGN	COMMENTS
TU-A259-01	CT ROOM A259	8	950	950	1.0	0.25	30	10.3	55	90	35.5	40	9.4	208/3/60	PRICE SPV8000 EC	ALL LISTED
TU-A259-02	CONTROL ROOM A259A	4	150	150	1.0	0.25	30	3.1	55	90	10.6	15	2.8	208/3/60	PRICE SPV8000 EC	ALL LISTED

NOTES:

1. ALL TERMINAL UNITS SHALL BE FURNISHED WITH CONTROLS.
2. CONTRACTOR SHALL COORDINATE 36" OF CLEARANCE FOR ALL VAV BOX CONTROL PANELS
3. CONTROLLERS SHALL BE PROVIDED TO MANUFACTURER FACTORY FOR FACTORY MOUNT AND WIRE. TERMINAL UNIT CONTROLS SHALL BE 24V POWER.
4. PROVIDE POWER SOURCE LABEL ON EACH VAV BOX. REFER TO ELECTRICAL DRAWINGS.
5. PROVIDE SCR CONTROLS FOR ELECTRIC HEATING COIL.

ELECTRIC HEAT TRACING SCHEDULE

	INSULATION									CURRENT		WATTAGE					
HEAT TRACE CIRCUIT DESIGNATION	THICKNESS	TYPE	MIN. MAINT. TEMP (°F)	MIN. AMB. TEMP. (°F)	MAX. MAINT. TEMP. (°F)	WIND SPEED DESIGN VELOCITY (MPH)	HEATER CABLE TYPE	CABLE LENGTH (FT.)	VOLTAGE	OPERATING	COLD	OPERATING	COLD	WFT HTR CABLE	WFT PIPE	HEAT LOSS W/FT	ELECTRICAL CLASSIFICATION
HTCS-PHT-01	1"	CELLULAR GLASS	36	-15.5	45	8	SELF-REGULATING	65	120	1.8	3.5	212	318	20	4	2	--

NOTES:

1. BASIS OF DESIGN: NELSON LT3-CB

STEAM HUMIDIFIER SCHEDULE

					EAT		LAT		STEAM				
UNIT NO.	SERVES	HUMIDIFIER TYPE	AIRFLOW (CFM)	# MANIFOLDS	DB (°F)	RH (%)	DB (°F)	RH (%)	SOURCE	STEAM PRESSURE (PSIG)	CAPACITY (LB/HR)	BASIS OF DESIGN	COMMENTS
H-1	AHU-A259	DUCT MTD	1100	3	13	51	55	63	PLANT	9	22.9	CONDAIR LS	ALL LISTED

NOTES:

1. PROVIDE WITH FACTORY STAINLESS STEEL DISPERSION TUBE, ELECTRONIC ACTUATOR, AND STEAM TRAP.

AIR DEVICE SCHEDULE

NO.	MIN CFM	MAX CFM	FACE SIZE ("L)	FACE SIZE ("W)	NECK SIZE (ø)	MAX. NC	TYPE	BASIS OF DESIGN
SUPPLY AIR								
SD4	150	320	24"	24"	8	30	PLAQUE	TITUS / OMNI
RETURN AIR								
R1	100	260	12"	12"	8	30	LOUVERED	TITUS / 350RL
R2	260	600	24"	24"	10	30	LOUVERED	TITUS / 350RL

NOTES:

1. AIR DISTRIBUTION DEVICES LOCATED WITHIN ACOUSTICAL TILE CEILINGS SHALL BE PROVIDED WITH BORDER TYPE 3 FOR LAY-IN MOUNTING. AIR DISTRIBUTION DEVICES LOCATED WITHIN GYPSUM BOARD CEILINGS OR WALLS SHALL BE PROVIDED WITH BORDER TYPE 1 FOR SURFACE MOUNTING. REFER TO ARCHITECTURAL DOCUMENTS FOR CEILING TYPES.
2. PROVIDE STEEL OPPOSED BLADE VOLUME DAMPER
3. PROVIDE VOLUME CONTROL DAMPERS FOR ALL RETURN GRILLES OR REGISTERS FOR BALANCED AIRFLOW. NOT REQUIRED IN TRANSFER.
4. ROUND NECK OR PROVIDE SQUARE-TO-ROUND ADAPTER
5. PROVIDE CONCEALED AIR TIGHT SEAL AROUND DIFFUSER TO PREVENT AIR LEAKAGE
6. FLEX DUCT SIZE TO BE SAME AS DIFFUSER NECK SIZE.

1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10

A B C D E F

ELECTRICAL SYMBOLS - POWER/LIGHTING PLANS

SYMBOL	DESCRIPTION
	EXISTING TO BE REMOVED (HEAVY, DASHED LINE)
	EXISTING TO REMAIN (LIGHT, SOLID LINE)
	NEW (HEAVY, SOLID LINE)
	SWITCHBOARD/ SWITCHGEAR/ DISTRIBUTION PANEL - OVER 250 VOLTS
	SWITCHBOARD/ SWITCHGEAR/ DISTRIBUTION PANEL, UNDER 250 VOLTS
	BRANCH CIRCUIT PANELBOARD, OVER 250 VOLTS, SURFACE MOUNTED
	DISCONNECT SWITCH, UNFUSED
J	JUNCTION BOX
J	WALL MOUNTED JUNCTION BOX
	RECEPTACLE, DUPLEX SUBSCRIPTS (TYPICAL FOR ALL RECEPTACLES): G = GFCI TYPE CH = MOUNTED AT COUNTER HEIGHT WITH BOTTOM OF DEVICE AT 6" ABOVE COUNTER OR 2" ABOVE BACKSPLASH OR AS NOTED ON PLANS
	RECEPTACLE, DOUBLE DUPLEX (QUADRAPLEX)
	RECEPTACLE, DUPLEX ON EMERGENCY POWER

SYMBOL	DESCRIPTION
$S_{\#}$	SWITCH (# SUBSCRIPT AS INDICATED BELOW) - SEE PLANS AND SPECIFICATIONS FOR DETAILS BLANK = SINGLE POLE 3 = THREE-WAY D = DIMMER
S_{LV2Dab}	LOW VOLTAGE SWITCH - SEE PLANS, SPECIFICATIONS AND WIRING DIAGRAMS FOR DETAILS SUBSCRIPT(S) INDICATE FIXTURES CONTROLLED 'D' INDICATES 0-10V DIMMING '2' INDICATES NUMBER OF LOW VOLTAGE ZONES 'LV' INDICATES LOW VOLTAGE SWITCH
LPP a	LIGHTING POWER PACK RELAY SUBSCRIPT INDICATES CONTROLLING SWITCH AND FIXTURES CONTROLLED (TYPICAL)
LPD	LIGHTING POWER PACK RELAY WITH 0-10V DIMMING
LPE	EMERGENCY LIGHTING POWER PACK RELAY - UL924 COMPLIANT
LPDE	EMERGENCY LIGHTING POWER PACK RELAY - UL924 COMPLIANT AND 0-10V DIMMING
A, 2, a	FIXTURE TYPE LED FIXTURE, RECESSED, PENDANT OR SURFACE CEILING LOWER CASE LETTER INDICATES CONTROLLING SWITCH CIRCUIT NUMBER
	LED, RECESSED, PENDANT OR SURFACE CEILING LIGHTING FIXTURE SHADING INDICATES FIXTURE CONNECTED TO EMERGENCY CIRCUIT (TYPICAL FOR ALL LIGHT FIXTURE SYMBOLS)
	LED, RECESSED, PENDANT OR SURFACE CEILING LUMINAIRE
	LED, WALL MOUNTED LUMINAIRE
	LED, TRACK LIGHTING, SURFACE CEILING LUMINAIRE
	EXIT LIGHT, LED, CEILING OR PENDANT MOUNTED; DIRECTIONAL ARROWS AS INDICATED; SHADED QUADRANT INDICATES FACE(S) OF LUMINAIRE
	EXIT LIGHT, LED, WALL MOUNTED

ELECTRICAL ONE-LINE

SYMBOL	DESCRIPTION
	TRANSFORMER, ONE-LINE
### ABC	PANELBOARD MAIN CIRCUIT BREAKER TYPE, ONE-LINE ### - INDICATES BREAKER RATING ABC - INDICATES PANEL DESIGNATION
### ABC	PANELBOARD MAIN LUG TYPE, ONE-LINE ### - INDICATES BUS RATING ABC - INDICATES PANEL DESIGNATION

ELECTRICAL ABBREVIATIONS

ABBR.	DESCRIPTION	ABBR.	DESCRIPTION	ABBR.	DESCRIPTION
1PH	SINGLE-PHASE	FA	FIRE ALARM	NEUT OR N	NEUTRAL
3PH	THREE-PHASE	FAAP	FIRE ALARM ANNUNCIATOR PANEL	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
4W	FOUR-WIRE	FACP	FIRE ALARM CONTROL PANEL	NIC	NOT IN CONTRACT
A/E	ARCHITECT/ENGINEER	FC	FOOTCANDLE	NL	NIGHT LIGHT
AF	AMPERE FRAME OR AMP FUSE	FLA	FULL LOAD AMPS	NO	NORMALLY OPEN
AFF	ABOVE FINISHED FLOOR	FP	FIRE PROTECTION	NS	NO SCALE
AFG	ABOVE FINISHED GRADE	FT	FEET OR FOOT	NTS	NOT TO SCALE
AHJ	AUTHORITY HAVING JURISDICTION	GND	GROUND	OC	ON CENTER
AIC	AMPERE INTERRUPTING CAPACITY	G OR GFCI	GROUND FAULT CIRCUIT INTERRUPTER	OD	OUTSIDE DIAMETER
ALT	ALTERNATE	GTB	GROUND TERMINAL BOX	OL	OVERLOAD
AMP	AMPERE	HD	HEAT DETECTOR	P	POLE
ASC	AMPS SHORT CIRCUIT	HOA	HAND-OFF-AUTOMATIC	PA	PUBLIC ADDRESS
AT	AMPERE TRIP	HP	HORSEPOWER	PCB	POLYCHLORINATED BIPHENYL
ATS	AUTOMATIC TRANSFER SWITCH	HZ	HERTZ	PH	PHASE
AUTO	AUTOMATIC	IESNA	ILLUMINATION ENGINEERING SOCIETY OF NORTH AMERICA	PNL	PANEL
AV	AUDIO VISUAL	IMC	INTERMEDIATE METAL CONDUIT	POD	POWER OPERATED DAMPER
AWG	AMERICAN WIRE GAUGE	IR	INFRARED	PVC	POLYVINYL CHLORIDE (PLASTIC)
BLDG	BUILDING	IWH	INSTANTANEOUS WATER HEATER	PWR	POWER
C	CONDUIT	J-BOX	JUNCTION BOX	RCP	REFLECTED CEILING PLAN
CAT	CATALOG	KCMIL	ONE-THOUSAND CIRCULAR MILS	RGS	RIGID GALVANIZED STEEL
CATV	COMMUNITY ANTENNA TELEVISION	kV	KILOVOLT	RM	ROOM
CCTV	CLOSED CIRCUIT TELEVISION	kVA	KILOVOLT AMPERE	RMS	ROOT MEAN SQUARE
cd	CANDELA	kVAH	KILOVOLT AMPERE PER HOUR	REQD	REQUIRED
CD	CONSTRUCTION DOCUMENTS	kVAR	KILOVOLT AMPERE REACTIVE	SCC	SHORT CIRCUIT CAPACITY
CKT	CIRCUIT	kW	KILOWATT	SD	SMOKE DETECTOR
CLG	CEILING	kWH	KILOWATT HOUR	SF	SQUARE FOOT (FEET)
COAX	COAX CABLE	LED	LIGHT EMITTING DIODE	SI	INTERNATIONAL SYSTEM OF UNITS
COMM	COMMUNICATION	LF	LINEAR FEET (FOOT)	SPEC	SPECIFICATION
CONC	CONCRETE	LM	LUMEN	SPST	SINGLE POLE, SINGLE THROW
CONT	CONTINUE	LP	LIGHT POLE	SW	SWITCH
COORD	COORDINATE	LRA	LOCKED ROTOR AMPS	SWBD	SWITCHBOARD
CRI	COLOR RENDERING INDEX	LTG	LIGHTING	SWGR	SWITCHGEAR
CT	CURRENT TRANSFORMER	LV	LOW VOLTAGE	TEL	TELEPHONE
CU	COPPER	MAX	MAXIMUM	TP	TWISTED PAIR
DB	DECIBEL OR DIRECT BURIAL	MC	METAL-CLAD	TPS	TWISTED PAIR SHIELDED
DC	DIRECT CURRENT	MCA	MINIMUM CIRCUIT AMPS	TTB	TELEPHONE TERMINAL BOARD
DEG C	DEGREES CELSIUS	MCB	MAIN CIRCUIT BREAKER	TV	TELEVISION
DEG F	DEGREES FAHRENHEIT	MCC	MOTOR CONTROL CENTER	TYP	TYPICAL
DEMO	DEMOLITION	MDP	MAIN DISTRIBUTION PANEL	UGND	UNDERGROUND
DISC	DISCONNECT	MECH	MECHANICAL	UL	UNDERWRITERS LABORATORY
DN	DOWN	MH	MANHOLE	UON	UNLESS OTHERWISE NOTED
DPDT	DOUBLE POLE, DOUBLE THROW	MIN	MINIMUM	UPS	UNINTERRUPTIBLE POWER SUPPLY
DPST	DOUBLE POLE, SINGLE THROW	MOCP	MAXIMUM OVERCURRENT PROTECTION	V	VOLT
DS	DISCONNECT SWITCH	MLO	MAIN LUGS ONLY	VA	VOLT AMPERE
DWG	DRAWING	MTD	MOUNTED	VAR	VOLT AMPERE REACTIVE
ELEC	ELECTRIC OR ELECTRICAL	MTG	MOUNTING	VFD	VARIABLE FREQUENCY DRIVE
ELEV	ELEVATOR	MTS	MANUAL TRANSFER SWITCH	VOLT	VOLTAGE
EMT	ELECTRICAL METALLIC TUBING	MV	MEDIUM VOLTAGE	W	WATT
ENCL	ENCLOSURE	MVA	MEGAVOLT-AMPERE	WH	WATER HEATER
EPO	EMERGENCY POWER OFF	MW	MEGAWATT MICROWAVE	WP	WEATHERPROOF
ESMT	EASEMENT	NA	NOT APPLICABLE	XFER	TRANSFER
EWC	ELECTRIC WATER COOLER	NC	NORMALLY CLOSED	XFMR	TRANSFORMER
EWH	ELECTRIC WATER HEATER	NEC	NATIONAL ELECTRICAL CODE		
ETR	EXISTING TO REMAIN	NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION		

SHEET LIST

3/6/2026 1:04:13 PM

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

Revisions: Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
SBA SERVICE-DISABLED VETERAN-OWNED CERTIFIED
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP
COMMONWEALTH OF PENNSYLVANIA REGISTERED PROFESSIONAL THOMAS D. BLISS ENGINEER PE077256

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
ELECTRICAL LEGENDS & SYMBOLS	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:	FULLY SPRINKLERED	Location 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number
		Issue Date: 06 MARCH 2026 / Checked: TDB / Drawn: WWS	Drawing Number: E-001

ELECTRICAL DEMOLITION NOTES

1. THE FACILITY WILL REMAIN OCCUPIED DURING RENOVATIONS.
2. DEVICES, LIGHT FIXTURES AND EQUIPMENT SHOWN IN DASHED LINE TYPE ARE EXISTING TO BE DEMOLISHED; DEVICES, LIGHT FIXTURES AND EQUIPMENT SHOWN IN LIGHT SOLID LINE TYPE ARE EXISTING TO REMAIN, UNLESS OTHERWISE NOTED.
3. EXISTING EQUIPMENT, LIGHT FIXTURES, DEVICES SHOWN ARE BASED ON FIELD SURVEYS AND RECORD DRAWINGS PROVIDED BY THE OWNER, AND IS NOT NECESSARILY ALL INCLUSIVE IN EVERY AREA AS FAR AS EXISTING ELECTRICAL EQUIPMENT, LIGHT FIXTURES AND DEVICES. EXISTING CIRCUITING SHOWN IS BASED ON RECORD DRAWINGS AND THE SURVEYED PANEL DIRECTORIES, WHERE THEY WERE AVAILABLE. THE ACTUAL CONDITIONS MAY VARY. ALL EXISTING CONDITIONS MUST BE VERIFIED PRIOR TO BID. THE CONDITIONS SHOWN ARE INTENDED TO SHOW THE LOCATIONS OF EXISTING DEVICES, LIGHT FIXTURES AND EQUIPMENT, WHERE SHOWN ON THE PLAN DRAWINGS, AND IN NO WAY RELIEVES THE CONTRACTOR FROM PROVIDING ANY AND ALL COORDINATION NECESSARY TO COMPLETE THE NEW WORK. FIELD CONDITIONS SHALL GOVERN.
4. WHERE EXISTING DEVICES ARE INDICATED TO REMAIN OR RELOCATED, LOCATED WITHIN THE SCOPE OF THIS PROJECT AND EXISTING CIRCUITING INFORMATION IS UNAVAILABLE, CONTRACTOR IS TO PROVIDE CIRCUIT TRACING TO IDENTIFY PANEL AND CIRCUIT DEVICES ARE CONNECTED TO AND PROVIDE THAT INFORMATION TO A/E PRIOR TO ROUTING CONDUITS AND WIRING FOR NEW DEVICES AND EQUIPMENT WITHIN THE SCOPE OF THIS PROJECT.
5. PRIOR TO DEMOLITION, FIELD VERIFY CONDUIT AND WIRING WHICH SERVES AREAS OUTSIDE THE SCOPE OF WORK AND PASSES THROUGH THE AREA OF WORK. MAINTAIN CONTINUITY OF SYSTEMS.
6. WHERE EXISTING DEVICES ARE TO REMAIN, CONTRACTOR MUST EXTEND EXISTING CIRCUITING WHERE NECESSARY TO MAINTAIN CONTINUITY OF CIRCUIT.
7. COORDINATE WITH THE OWNER FOR DISPOSITION OF ELECTRICAL ITEMS TO BE DEMOLISHED. OWNER SHALL HAVE THE OPTION TO RETAIN REUSABLE ITEMS SUCH AS COVERPLATES, RECEPTACLES, LIGHT FIXTURES, PANELBOARDS, TRANSFORMERS, ETC. NOT BEING USED IN THE FINISHED WORK. COORDINATE WITH THE OWNER PRIOR TO START OF DEMOLITION. PROPERLY AND LEGALLY DISPOSE OF ALL EQUIPMENT AND MATERIALS BEING REMOVED.
8. COORDINATE EXACT AREAS, WALLS, CEILINGS, ETC. TO BE DEMOLISHED WITH ARCHITECTURAL, STRUCTURAL, PLUMBING AND MECHANICAL DEMOLITION PLANS.
9. WHERE EXISTING DEVICES, LIGHT FIXTURES AND EQUIPMENT ARE INDICATED TO BE DEMOLISHED, REMOVE ASSOCIATED CONDUIT AND WIRING BACK TO SOURCE PANEL OR TO NEAREST JUNCTION BOX TO MAINTAIN CIRCUIT CONTINUITY OF DEVICES TO REMAIN AND EQUIPMENT TO REMAIN. WHERE PANELS ARE TO BE REMAIN, TURN BREAKER TO "OFF" POSITION AND LABEL THE CIRCUIT AS "SPARE" ON THE PANEL DIRECTORY.
10. ALL AREAS OUTSIDE THE SCOPE OF CONSTRUCTION ARE TO REMAIN ENERGIZED. COORDINATE PHASING WITH CONSTRUCTION MANAGER AND OWNER PRIOR TO DEMOLITION WHICH MAY RESULT IN INTERRUPTION OF POWER.
11. REFER TO ARCHITECTURAL DEMOLITION DRAWINGS FOR EXTENT OF AREA REQUIRING DEMOLITION AND ADDITIONAL INFORMATION ON ELECTRICAL DEMOLITION WITHIN THAT AREA. DISCONNECT ELECTRICAL SERVICE TO ALL EQUIPMENT BEING REMOVED. DEMOLITION SHALL BE PHASED AS REQUIRED BY DIVISION 1, OR DIRECTED BY THE OWNER.
12. REMOVE ALL CONDUIT LEFT EXPOSED BY REMOVAL OF WALLS AND CEILINGS IN REMODELED OR RENOVATED AREA. CAP BOTH ENDS OF REMAINING CONDUIT IN WALL OR FLOOR WHERE CUT. REMOVE ALL ASSOCIATED SUPPORTS. REMOVE WIRING BACK TO SOURCE OF VOLTAGE.
13. ELECTRICAL DEVICES WITHIN THE AREA OF WORK., AND NOT NOTED ON THE DEMOLITION DRAWINGS, WHETHER DUE TO CONCEALMENT BY STORAGE SHELVING, CASEWORK, FURNITURE OR FOR OTHER REASONS, ARE TO BE REMOVED AS REQUIRED, UNLESS SHOWN AS EXISTING TO REMAIN.
14. CONTRACTOR SHALL BE RESPONSIBLE FOR PATCHING ALL OPENINGS IN EXISTING CONSTRUCTION AFTER REMOVAL OF EQUIPMENT AND ELECTRICAL DEVICES, UNLESS OTHERWISE NOTED ON ARCHITECTURAL PLANS. REPAIRS ARE TO BE DONE TO LOGICAL EDGES OF SURFACES AFFECTED AND SHALL MATCH IMMEDIATE ADJACENT AREAS IN CONSTRUCTION, MATERIAL, FIRE RATING, FINISH AND COLOR.
15. PROVIDE BLANK COVERPLATES WHERE DEVICES ARE BEING REMOVED FROM EXISTING WALLS TO REMAIN. MATCH COLOR OF NEW ADJACENT DEVICE COVERPLATES.
16. FIELD VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS PRIOR TO COMMENCEMENT OF WORK AND OBTAIN CLARIFICATIONS FROM ARCHITECT/ENGINEER IF NECESSARY.
17. COORDINATE SERVICE INTERRUPTION WITH CONSTRUCTION MANAGER, OWNER, LANDLORD, AND UTILITY COMPANY, WHERE APPLICABLE, AND DO NOT INTERRUPT POWER WITHOUT WRITTEN PERMISSION. PROVIDE A MINIMUM OF ONE WEEK'S WRITTEN NOTIFICATION WHEN POWER IS DESIRED TO BE INTERRUPTED.
18. EXERCISE EXTREME CAUTION WHEN REMOVING/ RELOCATING WIRING AND EQUIPMENT. IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE THAT OTHER WIRING DEVICES, EQUIPMENT AND LIGHT FIXTURES THAT MAY BE CONNECTED TO THE SAME CIRCUIT REMAIN OPERATIONAL AND ACTIVE.
19. INFORMATION INDICATED IN THE DEMOLITION PORTION OF THE CONTRACT DRAWINGS IS DIAGRAMMATIC IN NATURE. FIELD VERIFY ELECTRICAL CIRCUIT HOMERUNS TO ALL ELECTRICAL ITEMS SCHEDULED TO BE DEMOLISHED AND PERFORM THE WORK AS INTENDED AND DEPICTED ON THE DRAWINGS.
20. UPDATE ALL EXISTING ELECTRICAL EQUIPMENT NAMEPLATES AND DIRECTORIES AS NECESSARY TO REFLECT FINAL AS-BUILT CONDITIONS AT THE END OF CONSTRUCTION.
21. STORE ITEMS INDICATED TO BE RETURNED TO THE OWNER IN A DRY, CLEAN AND PROTECTED AREA. NOTIFY OWNER WHEN ITEMS ARE READY TO BE REMOVED.
22. COORDINATE ANY ALTERATION AND CHANGES TO THE ELECTRICAL SERVICE WITH THE LOCAL UTILITY COMPANY AND THE OWNER PRIOR TO COMMENCEMENT OF WORK.
23. SCHEDULE ALL POWER INTERRUPTION WITH OWNER FOR EXACT DATE, TIME AND DURATION. PROVIDE A MINIMUM OF 72 HOURS NOTICE PRIOR TO DISCONNECTING ANY POWER TO ANY PORTION OF THE BUILDING, AND MAKE ARRANGEMENTS TO MAINTAIN POWER TO ALL CRITICAL EQUIPMENT AS NEEDED AND REQUESTED BY THE OWNER PRIOR TO COMMENCEMENT OF WORK.
24. THE DEMOLITION PLAN IS NOT INCLUSIVE OF ALL ELECTRICAL DEVICES WITHIN THE PROJECT AREA. IT IS INTENDED TO PROVIDE A GENERAL KNOWLEDGE OF THE EXISTING CONDITIONS WITHIN THE PROJECT AREA. ANY DISCREPANCIES OR CONDITIONS NOT SHOWN ON THE PLAN SHALL BE BROUGHT TO THE ATTENTION OF THE A/E. THE CONTRACTOR IS RESPONSIBLE FOR ALL REQUIRED ELECTRICAL DEMOLITION WHETHER INDICATED ON THE PLANS OR NOT.
25. ALL CONDUITS SERVING OTHER SPACES THAT RUN THROUGH THE PROJECT AREA SHALL REMAIN ACTIVE DURING CONSTRUCTION SO AS NOT TO CAUSE DISRUPTION TO THESE OTHER SPACES. ENSURE THAT ALL CONDUITS, NEW OR EXISTING WITHIN THE PROJECT AREA ARE PROPERLY SUPPORTED IN ACCORDANCE WITH THE NEC. ANY EXISTING CONDUIT IS INSTALLED BELOW THE HEIGHT OF THE NEW CEILING SHALL BE RELOCATED TO ABOVE THE NEW CEILING HEIGHT.
26. REMOVE ALL ABANDONED WIRING AND CONDUIT THAT IS WITHIN THE PROJECT AREA PRIOR TO THE END OF CONSTRUCTION.
27. UPDATE PANELBOARD DIRECTORIES WHICH ARE MODIFIED BY THIS PROJECT.
28. REPAIR DISTURBED AREAS TO MATCH EXISTING CONDITIONS.

ELECTRICAL GENERAL NOTES

1. THE DRAWINGS AND APPLICABLE SPECIFICATIONS SHALL BE CONSIDERED SUPPLEMENTARY, ONE TO THE OTHER AND ARE CONSIDERED THE "CONTRACT DOCUMENTS". ALL WORKMANSHIP, METHODS AND/OR MATERIALS DESCRIBED OR IMPLIED BY ONE AND NOT DESCRIBED OR IMPLIED BY THE OTHER SHALL BE PROVIDED, FURNISHED OR PERFORMED AS IF IT HAD APPEARED IN BOTH SECTIONS. THE TERM "CONTRACT DOCUMENTS" DESCRIBED HEREIN IS NOT LIMITED SOLELY TO THE ELECTRICAL PORTION OF THE DRAWINGS AND SPECIFICATIONS, BUT ENCOMPASSES THE DRAWINGS AND SPECIFICATIONS OF ALL DIVISIONS AS A WHOLE.
2. PROVIDE AN OPERATING AND MAINTENANCE MANUAL TO OWNER PRIOR TO THE FINAL ACCEPTANCE. THE MANUAL SHALL INCLUDE, AS A MINIMUM, (1) SUBMITTAL DATA STATING EQUIPMENT RATING AND SELECTED OPTIONS FOR EACH PIECE OF EQUIPMENT REQUIRING MAINTENANCE. ALSO PROVIDE TWO OPERATIONS AND MAINTENANCE MANUALS FOR EACH PIECE OF EQUIPMENT REQUIRING MAINTENANCE. REQUIRED ROUTINE MAINTENANCE ACTIONS AND METHOD OF OPERATION FOR EQUIPMENT SHALL BE CLEARLY IDENTIFIED, AND THE NAME, PHONE NUMBER AND ADDRESS OF AT LEAST ONE QUALIFIED SERVICE AGENCY.
3. INCLUDE ALL COSTS FOR EXCAVATION, SAW CUTTING, DIRECTIONAL BORING, CORE DRILLING, BACKFILLING, SURFACE RESTORATION, REPAIR OF FINISHES, ETC. THAT IS REQUIRED IN ORDER TO MEET THE PROJECT REQUIREMENTS.
4. INCLUDE IN BID ALL COSTS ASSOCIATED WITH TEMPORARY ELECTRICAL SERVICE AS REQUIRED FOR USE BY ALL TRADES DURING CONSTRUCTION. REMOVE TEMPORARY POWER AT THE COMPLETION OF THE PROJECT. OBTAIN AND PAY FOR ALL REQUIRED PERMITS FOR TEMPORARY POWER. ENGINEER OF RECORD SHALL BE PROVIDED WITH ADDITIONAL COMPENSATION FROM THE CONTRACTOR WHERE SIGNED & SEALED DRAWINGS ARE REQUESTED BY THE CONTRACTOR TO THE ENGINEER OF RECORD IF REQUIRED BY THE AHJ FOR THE TEMPORARY POWER.
5. LOCATE, IDENTIFY, PROTECT AND DOCUMENT ALL UTILITY LINES LOCATED WITHIN THE PROJECT BOUNDARY.
6. INCLUDE IN BID THE TRANSPORT AND DISPOSAL OR RECYCLING OF ALL WASTE MATERIALS GENERATED BY THIS PROJECT IN ACCORDANCE WITH ALL LOCAL, STATE AND FEDERAL RULES, REGULATIONS AND GUIDELINES APPLICABLE. COMPLY FULLY WITH MISSOURI STATUTES REGARDING MERCURY-CONTAINING DEVICES, AND WITH ALL DEP AND EPA APPLICABLE GUIDELINES AT THE TIME OF DISPOSAL. PROVIDE OWNER WITH WRITTEN CERTIFICATION OF ACCEPTED DISPOSAL.
7. ALL POWER CIRCUITS HAVE BEEN DESIGNED IN COMPLIANCE WITH SECTION C405.10 OF THE ENERGY CONSERVATION CODE, MISSOURI BUILDING CODE REQUIRING 5% OR LESS VOLTAGE DROP FOR FEEDERS, AND 5% OR LESS VOLTAGE DROP FOR BRANCH CIRCUITS.
   A. ELECTRICAL SYSTEM HAS BEEN DESIGNED IN ACCORDANCE WITH THE 2023 NATIONAL ELECTRICAL CODE (NFPA 70).
8. ALL BRANCH CIRCUITS SHALL BE FURNISHED WITH A DEDICATED NEUTRAL. SHARED NEUTRALS ARE NOT ALLOWED UNLESS SPECIFICALLY NOTED ON THE DRAWINGS.
9. VERIFY AND COORDINATE LOCATIONS OF ANY MISCELLANEOUS EQUIPMENT REQUIRING ELECTRICAL CONNECTIONS (I.E., CT EQUIPMENT, ETC.) WITH APPROVED SHOP DRAWINGS, OWNER-PROVIDED CUT SHEETS, MANUFACTURER'S INSTRUCTIONS, AND EQUIPMENT NAMEPLATE INFORMATION, PRIOR TO ROUGH IN, AND PROVIDE ALL NECESSARY ELECTRICAL REQUIRED.
10. VERIFY AND COORDINATE LOCATIONS AND EXACT ELECTRICAL REQUIREMENTS FOR ALL MECHANICAL, PLUMBING AND FIRE PROTECTION EQUIPMENT PRIOR TO SUBMITTAL OF SHOP DRAWINGS OF ELECTRICAL EQUIPMENT. PROVIDE ALL NECESSARY RACEWAYS, CONDUCTORS, BOXES, EQUIPMENT, ACCESSORIES, ASSOCIATED DISCONNECT SWITCHES, CIRCUIT BREAKERS, CONTROL TRANSFORMERS, FIRE ALARM SHUTDOWN, ETC. REQUIRED FOR A COMPLETE AND OPERATIONAL SYSTEM. COORDINATE WITH APPROPRIATE TRADE'S APPROVED SHOP DRAWINGS, MANUFACTURER'S INSTRUCTIONS, AND EQUIPMENT NAMEPLATE INFORMATION, PRIOR TO ROUGH IN, AND PROVIDE ALL NECESSARY ELECTRICAL REQUIRED, UNLESS OTHERWISE NOTED.
11. ALL WORK ON THE ELECTRICAL SYSTEM REQUIRED BY THE CONTRACT DOCUMENTS SHALL BE COORDINATED WITH THE WORK OF ALL OTHER DIVISIONS/TRADES PRIOR TO COMMENCEMENT OF WORK. AVOID INTERFERENCES WITH THE PROGRESS OF OTHER DIVISIONS/TRADES.
12. DRAWINGS ARE DIAGRAMMATIC AND INDICATE GENERAL ARRANGEMENT OF SYSTEMS. PROVIDE COMPONENTS INDICATED ON RISER DIAGRAMS WHETHER OR NOT INDICATED ON PLANS AND VICE VERSA.
13. ROUTING OF CONDUIT IS DIAGRAMMATIC AND NOT INTENDED TO SHOW REQUIRED OFFSETS AND DETAILS. COORDINATE EXACT ROUTING WITH FIELD CONDITIONS AND OTHER TRADES.
14. REFER TO ARCHITECTURAL, MECHANICAL, PLUMBING, FIRE PROTECTION, TECHNOLOGY, AND STRUCTURAL DRAWINGS FOR RELATED INFORMATION AND ADDITIONAL INSTALLATION REQUIREMENTS TO BE PERFORMED AS PART OF THE WORK. REFER TO ARCHITECTURAL ELEVATIONS FOR EXACT MOUNTING HEIGHT AND LOCATIONS.
15. WHERE A DISCREPANCY OR CONFLICT IS FOUND BETWEEN ONE DRAWING AND ANOTHER, OR BETWEEN A DRAWING AND APPLICABLE SPECIFICATIONS, NOTIFY THE ARCHITECT/ENGINEER IMMEDIATELY IN WRITTEN FORM. IN GENERAL, THE MOST STRINGENT REQUIREMENT SHALL GOVERN UNLESS THE DISCREPANCY CONFLICTS WITH APPLICABLE CODES OR OWNER'S DESIGN STANDARDS, WHEREIN THE CODE OR OWNER'S DESIGN STANDARDS SHALL GOVERN.
16. COORDINATE ALL PROJECT SCHEDULING AND PHASING REQUIREMENTS WITH ARCHITECT/ENGINEER AND OWNER PRIOR TO SUBMITTING BID PRICE. THIS PROJECT MAY REQUIRE PHASING SEQUENCES AND POTENTIAL PREMIUM TIME WORK AND ALL COSTS FOR SUCH SHALL BE INCLUDED IN THE BID PRICE. PROVIDE ADEQUATE WORK FORCE AND EQUIPMENT, AND INCLUDE PREMIUM TIME AS MAY BE REQUIRED IN ORDER TO ADHERE TO THE PROJECT SCHEDULE. ADDITIONALLY, ENSURE THAT LONG LEAD ITEMS DO NOT IMPACT THE PROJECT'S SCHEDULE OR PHASING.
17. ANY TEMPORARY INTERRUPTION ON POWER REQUIRED FOR THE SYSTEM TIE-IN OR SWITCHOVER FOR ANY PORTION OF THE ELECTRICAL SYSTEM SHALL BE PRE-APPROVED IN WRITING BY THE OWNER AND SCHEDULED IN ADVANCE.
18. CONDUCT WORK OPERATIONS AND DEBRIS REMOVAL IN A MANNER THAT ENSURES MINIMUM INTERFERENCE WITH NORMAL BUSINESS OPERATIONS, TRAFFIC, PARKING, ETC. ONGOING IN ADJACENT OCCUPIED SPACES OR FACILITIES. PROVIDE ALL THAT IS REQUIRED TO EFFECTIVELY PROTECT SURROUNDING OCCUPANTS, EQUIPMENT, FINISHES, FURNITURE, ETC. FROM DAMAGE OR EXCESSIVE NOISE THROUGHOUT THE DURATION OF THIS PROJECT. CONTRACTOR IS RESPONSIBLE FOR ANY LOSSES OR DAMAGE. ANY DAMAGE RESULTING FROM THE FAILURE TO ADHERE TO THIS REQUIREMENT. RESTORE DAMAGED ELEMENTS TO ORIGINAL CONDITION BY THE CONTRACTOR TO THE SATISFACTION OF THE ARCHITECT/ENGINEER AND OWNER, AT NO ADDITIONAL COSTS. REPORT OF ANY SUCH OCCURRENCE TO THE ARCHITECT/ENGINEER AND OWNER IMMEDIATELY AND AWAIT WRITTEN DIRECTION PRIOR TO PROCEEDING WITH REPAIRS.
19. COORDINATE THE LOCATION OF ALL LIGHT FIXTURES, DEVICES AND BOXES WITH WINDOWS, MIRRORS, MILLWORK, CABINETS, GLASS CURTAIN WALLS, AND GLASS WALLS PRIOR TO INSTALLATION OF CONDUITS OR BOXES. REVIEW ALL CONTRACT DRAWINGS TO ASCERTAIN ANY CONFLICTS PRIOR TO BIDDING. OBTAIN CLARIFICATION FROM A/E PRIOR TO BID. CONTRACTOR SHALL NOT BE ENTITLED TO ADDITIONAL COMPENSATION FOR WORK REQUIRED TO RELOCATE OUTLET BOXES OR RACEWAYS FOR COORDINATION WITH OTHER TRADE'S WORK.
20. THE EXCLUSIVELY DEDICATED SPACE EXTENDING FROM FLOOR TO 6' ABOVE EQUIPMENT OR STRUCTURAL CEILING, WHICHEVER DISTANCE IS LOWER, WITH A WIDTH AND DEPTH OF THE PANELBOARD OR SWITCHBOARD MUST BE CLEAR OF ALL PIPING, DUCTS, EQUIPMENT FOREIGN TO THE ELECTRICAL EQUIPMENT OR ARCHITECTURAL APPURTENANCES IN ACCORDANCE WITH NEC.
21. PROVIDE ALL TEMPORARY NORMAL LIGHTING, EMERGENCY LIGHTING AND EXIT SIGNAGE REQUIRED DURING THE PROJECT CONSTRUCTION PHASE.
22. THE INFRASTRUCTURE FOR THE ACCESS CONTROL/ CCTV OR SECURITY ELECTRONICS SYSTEM (CONDUITS, ELECTRICAL BOXES) SHALL BE INSTALLED BY DIVISION 26. THE ACCESS CONTROL/CCTV OR SECURITY ELECTRONICS SYSTEM CONTRACTOR SHALL PROVIDE AND INSTALL THE WIRE AND CABLE FOR THE SYSTEM AND ALL REQUIRED EQUIPMENT. INSTALLATION OF THE CONDUITS AND ELECTRICAL BOXES SHALL BE UNDER THE DIRECT SUPERVISION OF THE ACCESS CONTROL/ CCTV SYSTEM CONTRACTOR. COORDINATE EXACT LOCATIONS OF DEVICES, RACEWAY LOCATIONS, SIZES AND QUANTITY, CONDUIT STUB-UPS PRIOR TO ROUGH IN.
23. THE INFRASTRUCTURE FOR THE VOICE/DATA TELECOMMUNICATIONS SYSTEM (CONDUITS, ELECTRICAL BOXES) SHALL BE INSTALLED BY DIVISION 26. THE TELECOMMUNICATIONS CONTRACTOR SHALL PROVIDE AND INSTALL THE WIRE AND CABLE FOR THE SYSTEM AND ALL REQUIRED EQUIPMENT AND COMPONENTS. INSTALLATION OF THE CONDUITS AND ELECTRICAL BOXES SHALL BE UNDER THE DIRECT SUPERVISION OF THE TELECOMMUNICATIONS CONTRACTOR. COORDINATE EXACT LOCATIONS OF DEVICES, RACEWAY LOCATIONS, SIZES AND QUANTITY, CONDUIT STUB-UPS PRIOR TO ROUGH IN.
24. PROVIDE EXPERIENCED, QUALIFIED AND RESPONSIBLE SUPERVISION FOR ALL WORK REQUIRED BY THE CONTRACT DOCUMENTS. ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED IN A NEAT AND WORKMANLIKE MANNER, TO THE SATISFACTION OF THE ARCHITECT/ENGINEER AND OWNER.
25. THE ELECTRICAL PORTION OF THE CONTRACT DOCUMENTS ARE COORDINATED WITH THE DESIGN BASIS EQUIPMENT SPECIFIED BY DIVISION 26 AND OTHER DIVISIONS. WHERE THE CONTRACTOR ELECTS TO SUBSTITUTE A PRODUCT IN LIEU OF PROVIDING THE DESIGN BASIS, AND SAID SUBSTITUTION IS ACCEPTED BY THE A/E AND OWNER, THE CONTRACTOR SHALL MAKE ALL CORRECTIONS TO THE ELECTRICAL SYSTEM NECESSARY IN ORDER TO ENSURE A COMPLETE AND OPERATIONAL INSTALLATION OF THE EQUIPMENT AT NO ADDITIONAL COSTS. WHERE THE CONTRACTOR'S DESIGN SUBSTITUTION RESULTS IN THE NEED FOR THE ENGINEER TO REVISE THE CONTRACT DOCUMENTS, THE ENGINEER RESERVES THE RIGHT TO REQUEST COMPENSATION FROM THE CONTRACTOR FOR SAID SERVICES.
26. MAINTAIN A CURRENT AND ACCURATE SET OF PROJECT RECORD DOCUMENTS (AS-BUILTS) AT THE SITE THROUGHOUT THE DURATION OF THE PROJECT. RECORD DRAWINGS SHALL BE UPDATED EACH DAY TO REFLECT THE ACTUAL LOCATIONS, SIZES, ROUTING, ETC. OF EACH PORTION OF THE ELECTRICAL SYSTEM AFFECTED BY THIS WORK. A FINAL SET OF RECORD DOCUMENTS SHALL BE ISSUED TO THE A/E FOR REVIEW AND THEN SUBMITTED TO THE OWNER WITHIN 30 DAYS AFTER THE DATE OF FINAL ACCEPTANCE. PROVIDE RECORD DRAWINGS OF THE ACTUAL INSTALLATION INCLUDING SINGLE LINE DIAGRAM, POWER RISER DIAGRAM OF THE BUILDING ELECTRICAL DISTRIBUTION SYSTEM, SITE PLANS AND ALL ELECTRICAL FLOOR PLANS, DETAILS, PANEL SCHEDULES, ETC.
27. OWNER FURNISHED EQUIPMENT: VERIFY AND COORDINATE ELECTRICAL ROUGH IN REQUIREMENTS FOR OWNER FURNISHED EQUIPMENT PRIOR TO ROUGH IN.
28. WHERE SUBMITTED EQUIPMENT REQUIRES REVISION TO OVERCURRENT PROTECTION, CONDUIT OR WIRING, MAKE CHANGES IN ACCORDANCE WITH APPLICABLE CODES.

APPLICABLE CODES

1. NATIONAL FIRE PROTECTION ASSOCIATION (NFPA), INCLUDING (BUT NOT LIMITED TO):
   a. NATIONAL ELECTRICAL CODE (NEC), NFPA 70 - 2023
   b. NATIONAL FIRE ALARM CODE, NFPA 72 - 2025
   c. LIFE SAFETY CODE, NFPA 101 – 2024
   d. EMERGENCY AND STANDBY POWER SYSTEMS, NFPA 110 – 2025
   e. HEALTH CARE FACILITIES CODE, NFPA 99
2. AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI), INCLUDING (BUT NOT LIMITED TO):
   a. NATIONAL ELECTRICAL SAFETY CODE, ANSI C2
3. OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA)
4. FACILITY GUIDELINES INSTITUTE (FGI):
   a. GUIDELINES FOR DESIGN AND CONSTRUCTION OF HOSPITALS AND OUTPATIENT FACILITIES
5. FEDERAL COMMUNICATION COMMISSION (FCC)
6. NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)
7. INSULATED CABLE ENGINEERS ASSOCIATION (ICEA)
8. INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)
9. NATIONAL ELECTRICAL TESTING ASSOCIATION (NETA)
10. AMERICAN SOCIETY OF TESTING AND MATERIALS (ASTM)
11. ILLUMINATION ENGINEERING SOCIETY (IES)
12. ANTI-FRICTION BEARING MANUFACTURERS ASSOCIATION (AFBMA)
13. BUILDING OFFICIALS AND CODE ADMINISTRATORS INTERNATIONAL, INC. (BOCA)
14. INTERNATIONAL CODE COUNCIL (ICC):
    a. INTERNATIONAL BUILDING CODE (IBC)
15. UNIFORM BUILDING CODE (UBC)
16. COMBINED ANSI/ASHRAE/IES STANDARD 90.1 – "ENERGY STANDARD FOR BUILDINGS EXCEPT LOW-RISE RESIDENTIAL BUILDINGS"
17. NATIONAL ELECTRICAL CONTRACTORS ASSOCIATION INSTALLATION STANDARDS (NECA)
18. AMERICANS WITH DISABILITIES ACT (ADA)
19. APPLICABLE STATE AND LOCAL CODES, AMENDMENTS, REGULATIONS, AND PRACTICES.
20. APPLICABLE REGULATORY REQUIREMENTS AND ADVISORY PRACTICES OF APPROPRIATE
    a. AUTHORITIES HAVING JURISDICTION (AHJs).
21. APPLICABLE STANDARDS, REGULATIONS, AND PRACTICES OF THE OWNER.

WHERE THERE IS A DISCREPANCY BETWEEN ABOVE GENERAL NOTES AND SPECIFICATIONS, WHERE APPLICABLE, SPECIFICATIONS SHALL BE FOLLOWED

Revisions: | Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP
COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
THOMAS D. BLISS
ENGINEER
PE077256

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
ELECTRICAL NOTES	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number:
		Issue Date: 06 MARCH 2026 / Checked: TDB / Drawn: WWS	Drawing Number: E-002

DRAWING NOTES:

1. COORDINATE EXACT EXTENTS OF DEMOLITION WITH ARCHITECTURAL PLANS PRIOR TO CONSTRUCTION.

CODED NOTES:

1 DISCONNECT AND REMOVE EXISTING LIGHTING FIXTURE. REMOVE EXISTING CONDUIT AND CONDUCTORS BACK TO NEXT DEVICE ON BRANCH CIRCUIT THAT IS INDICATED AS EXISTING TO REMAIN. IF NO OTHER DEVICES REMAIN ON CIRCUIT, REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE. SWITCH BREAKER TO 'OFF' POSITION AND LABEL BREAKER AS 'SPARE' ON PANEL SCHEDULE. CONTRACTOR SHALL VERIFY THAT EXISTING TO REMAIN DEVICES REMAIN OPERATIONAL.

2 DISCONNECT AND REMOVE EXISTING LIGHTING CONTROLS. REMOVE EXISTING CONDUIT AND CONDUCTORS BACK TO NEXT DEVICE ON BRANCH CIRCUIT THAT IS INDICATED AS EXISTING TO REMAIN. IF NO OTHER DEVICES REMAIN ON CIRCUIT, REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE. SWITCH BREAKER TO 'OFF' POSITION AND LABEL BREAKER AS 'SPARE' ON PANEL SCHEDULE. CONTRACTOR SHALL VERIFY THAT EXISTING TO REMAIN DEVICES REMAIN OPERATIONAL.

3 DISCONNECT, REMOVE AND PRESERVE EXISTING LIGHTING FIXTURE FOR REINSTALLATION. REMOVE EXISTING CONDUIT AND CONDUCTORS BACK TO NEXT DEVICE ON BRANCH CIRCUIT THAT IS INDICATED AS EXISTING TO REMAIN. REFER TO EL-101 FOR LOCATION TO BE REINSTALLED.

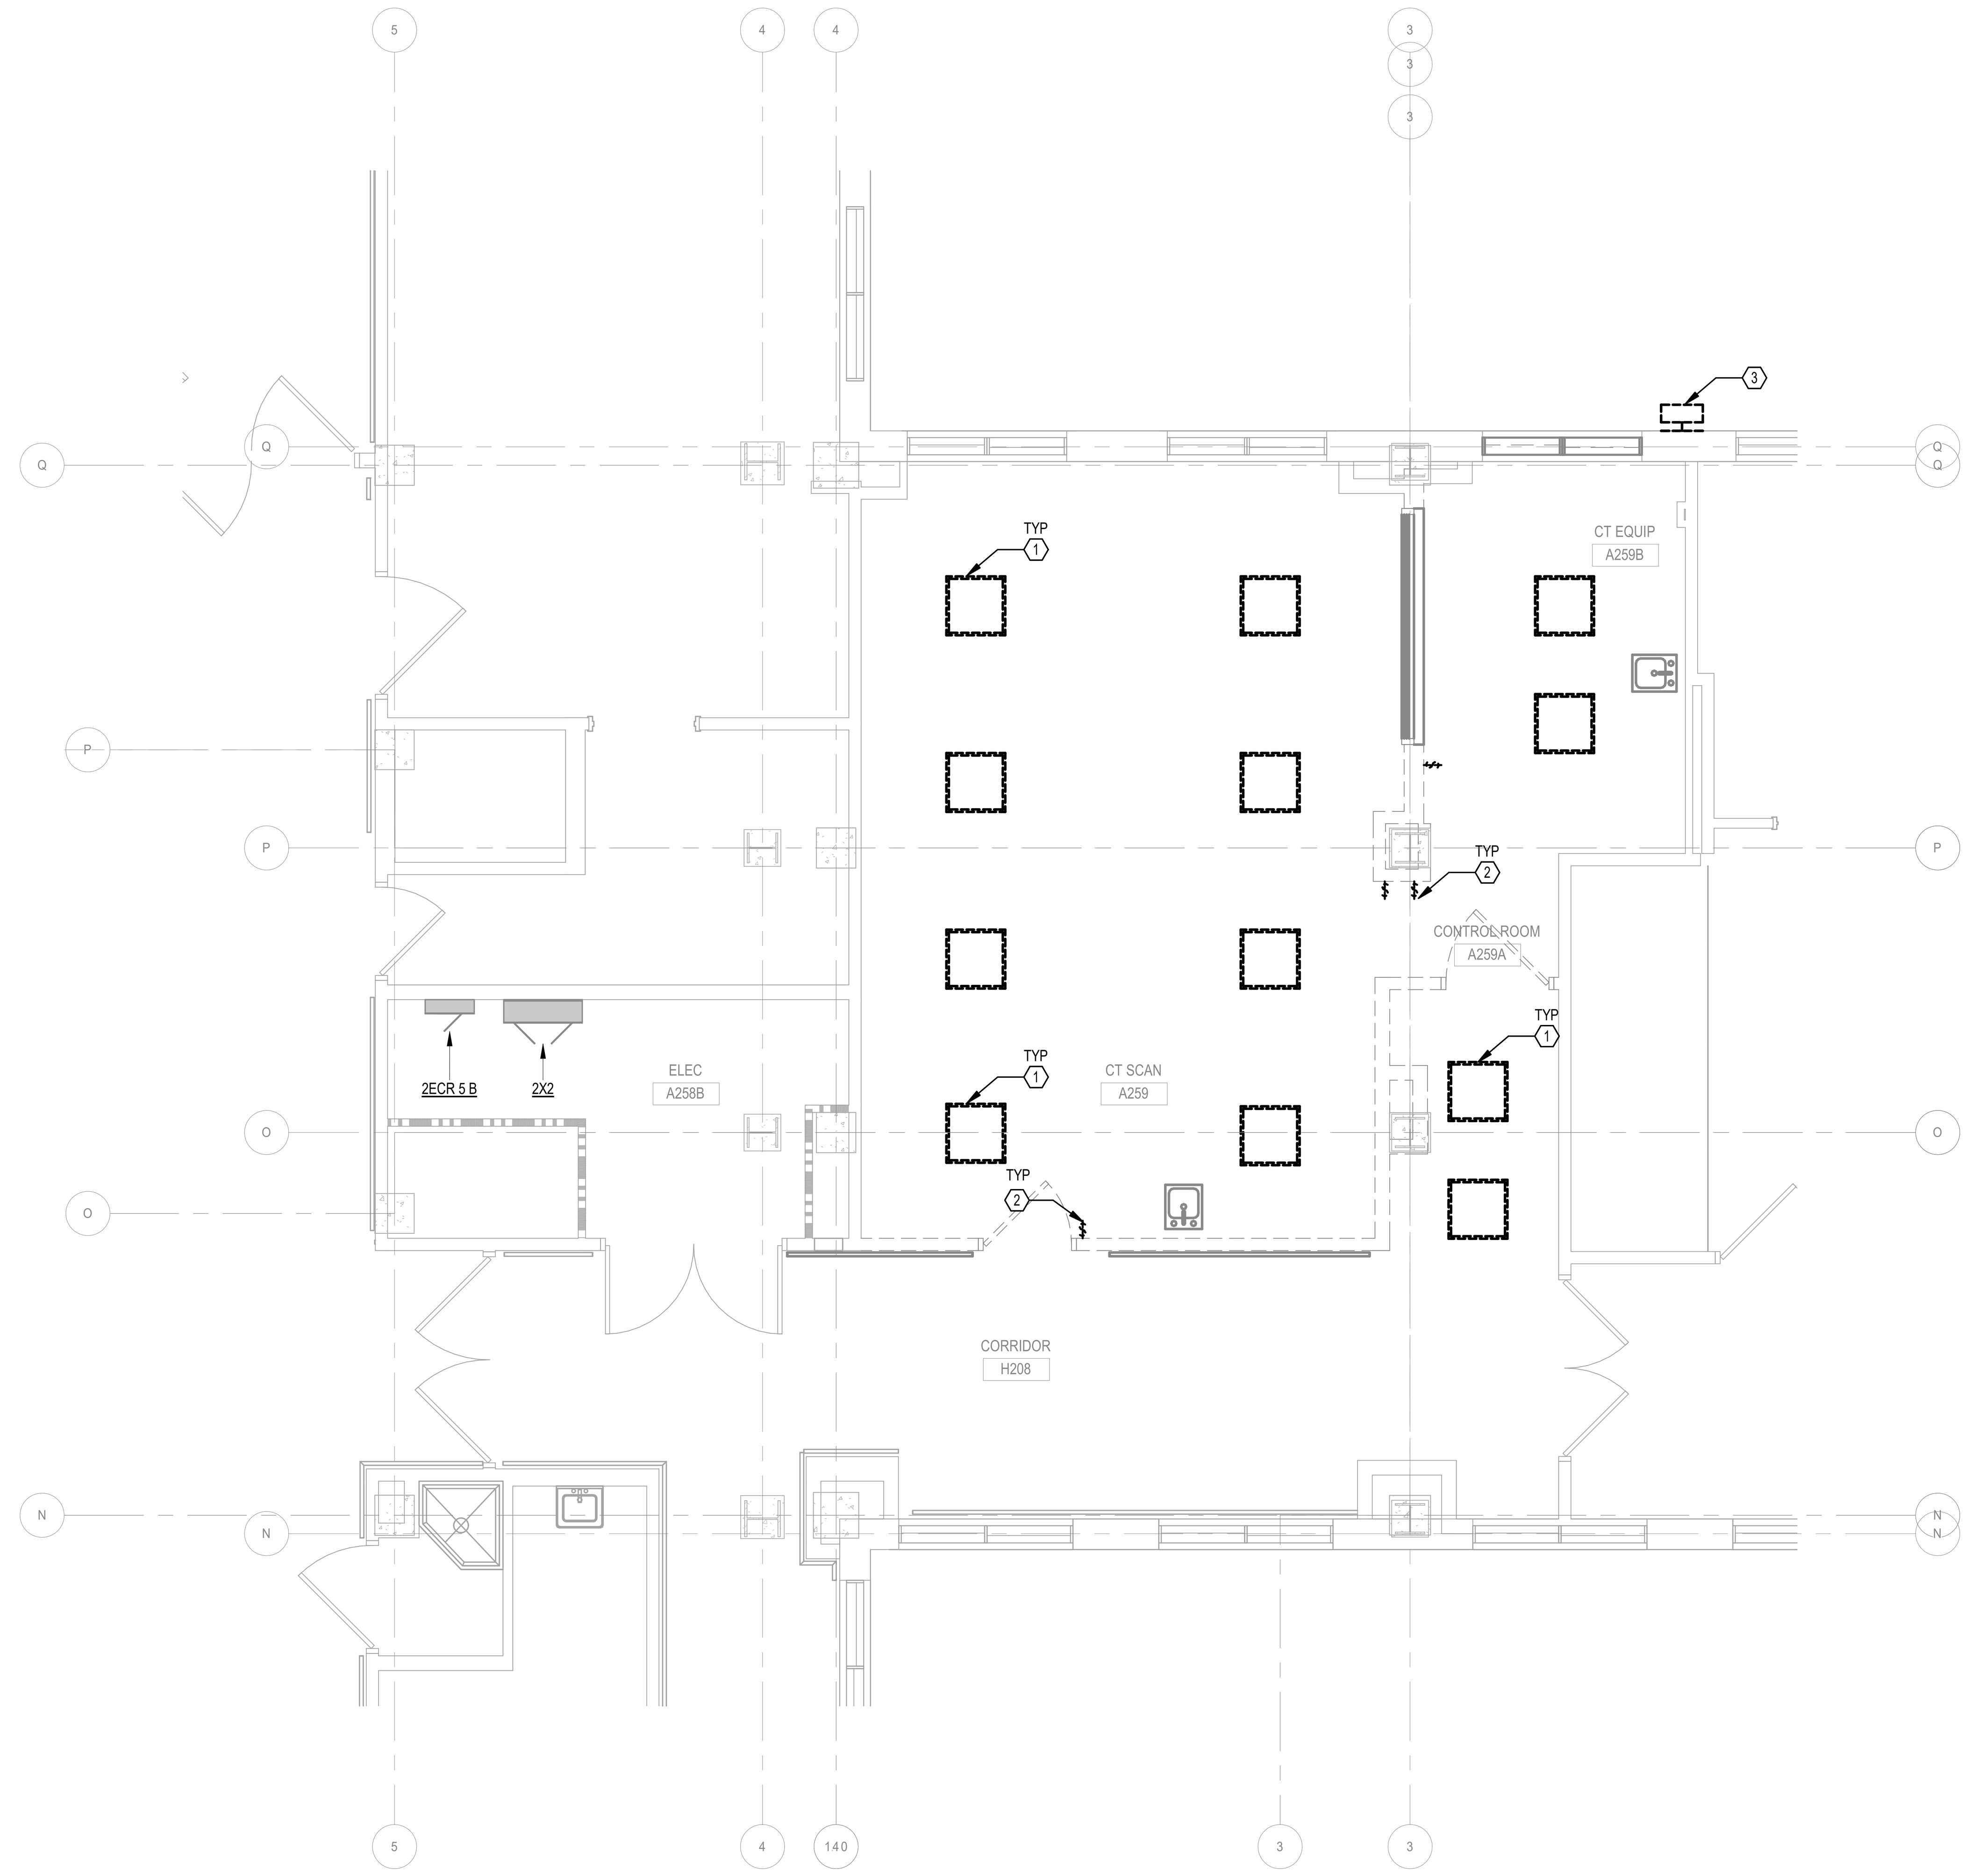

1 SECOND FLOOR PLAN - LIGHTING - DEMOLITION
1/4" = 1'-0"

KEY PLAN

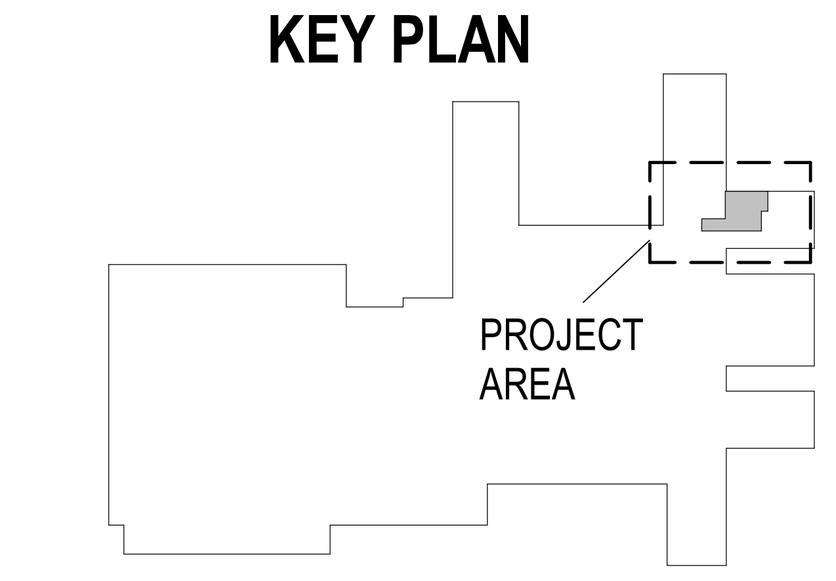

N
0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
THOMAS D. BLISS
ENGINEER
PE077256

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
SECOND FLOOR PLAN - LIGHTING - DEMOLITION	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number: 1
		Issue Date: 06 MARCH 2026 / Checked: TDB / Drawn: WWS	Drawing Number: ED101

3/6/2026 1:04:16 PM
Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

VA FORM 08 - 6231

DRAWING NOTES:

1. COORDINATE EXACT EXTENTS OF DEMOLITION WITH ARCHITECTURAL PLANS PRIOR TO CONSTRUCTION.

CODED NOTES:

1. DISCONNECT AND REMOVE EXISTING ELECTRICAL DEVICE. REMOVE EXISTING CONDUIT AND CONDUCTORS BACK TO NEXT DEVICE ON BRANCH CIRCUIT THAT IS INDICATED AS EXISTING TO REMAIN. IF NO OTHER DEVICES REMAIN ON CIRCUIT, REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE. SWITCH BREAKER TO 'OFF' POSITION AND LABEL BREAKER AS 'SPARE' ON PANEL SCHEDULE. CONTRACTOR SHALL VERIFY THAT EXISTING TO REMAIN DEVICES REMAIN OPERATIONAL.
2. DISCONNECT AND REMOVE EXISTING ELECTRICAL EQUIPMENT. REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE. SWITCH BREAKER TO 'OFF' POSITION AND LABEL BREAKER AS 'SPARE' ON PANEL SCHEDULE. CONTRACTOR SHALL VERIFY THAT EXISTING TO REMAIN DEVICES REMAIN OPERATIONAL.
3. DISCONNECT EXISTING ELECTRICAL DEVICE INSTALLED IN SURFACE MOUNTED RACEWAY. REMOVE RACEWAY AND PULL CONDUCTORS BACK TO NEXT DEVICE ON BRANCH CIRCUIT THAT IS INDICATED AS EXISTING TO REMAIN. IF NO OTHER DEVICES REMAIN ON CIRCUIT, REMOVE CONDUIT AND CONDUCTORS ABOVE CEILING BACK TO SOURCE. SWITCH BREAKER TO 'OFF' POSITION AND LABEL BREAKER AS 'SPARE' ON PANEL SCHEDULE. CONTRACTOR SHALL VERIFY THAT EXISTING TO REMAIN DEVICES REMAIN OPERATIONAL.
4. DISCONNECT EXISTING SURFACE MOUNTED ELECTRICAL DEVICE. REMOVE RACEWAY AND PULL CONDUCTORS BACK TO NEXT DEVICE ON BRANCH CIRCUIT THAT IS INDICATED AS EXISTING TO REMAIN. IF NO OTHER DEVICES REMAIN ON CIRCUIT, REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE. SWITCH BREAKER TO 'OFF' POSITION AND LABEL BREAKER AS 'SPARE' ON PANEL SCHEDULE. CONTRACTOR SHALL VERIFY THAT EXISTING TO REMAIN DEVICES REMAIN OPERATIONAL.
5. DISCONNECT EXISTING ELECTRICAL DEVICE. PULL CONDUCTORS BACK TO NEXT DEVICE ON BRANCH CIRCUIT THAT IS INDICATED AS EXISTING TO REMAIN. IF NO OTHER DEVICES REMAIN ON CIRCUIT, REMOVE CONDUIT AND CONDUCTORS ABOVE CEILING BACK TO SOURCE. SWITCH BREAKER TO 'OFF' POSITION AND LABEL BREAKER AS 'SPARE' ON PANEL SCHEDULE. ABANDON JUNCTION BOX AND CONDUIT IN WALL AND PLACE BLANK COVERPLATE ON JUNCTION BOX. CONTRACTOR SHALL VERIFY THAT EXISTING TO REMAIN DEVICES REMAIN OPERATIONAL.

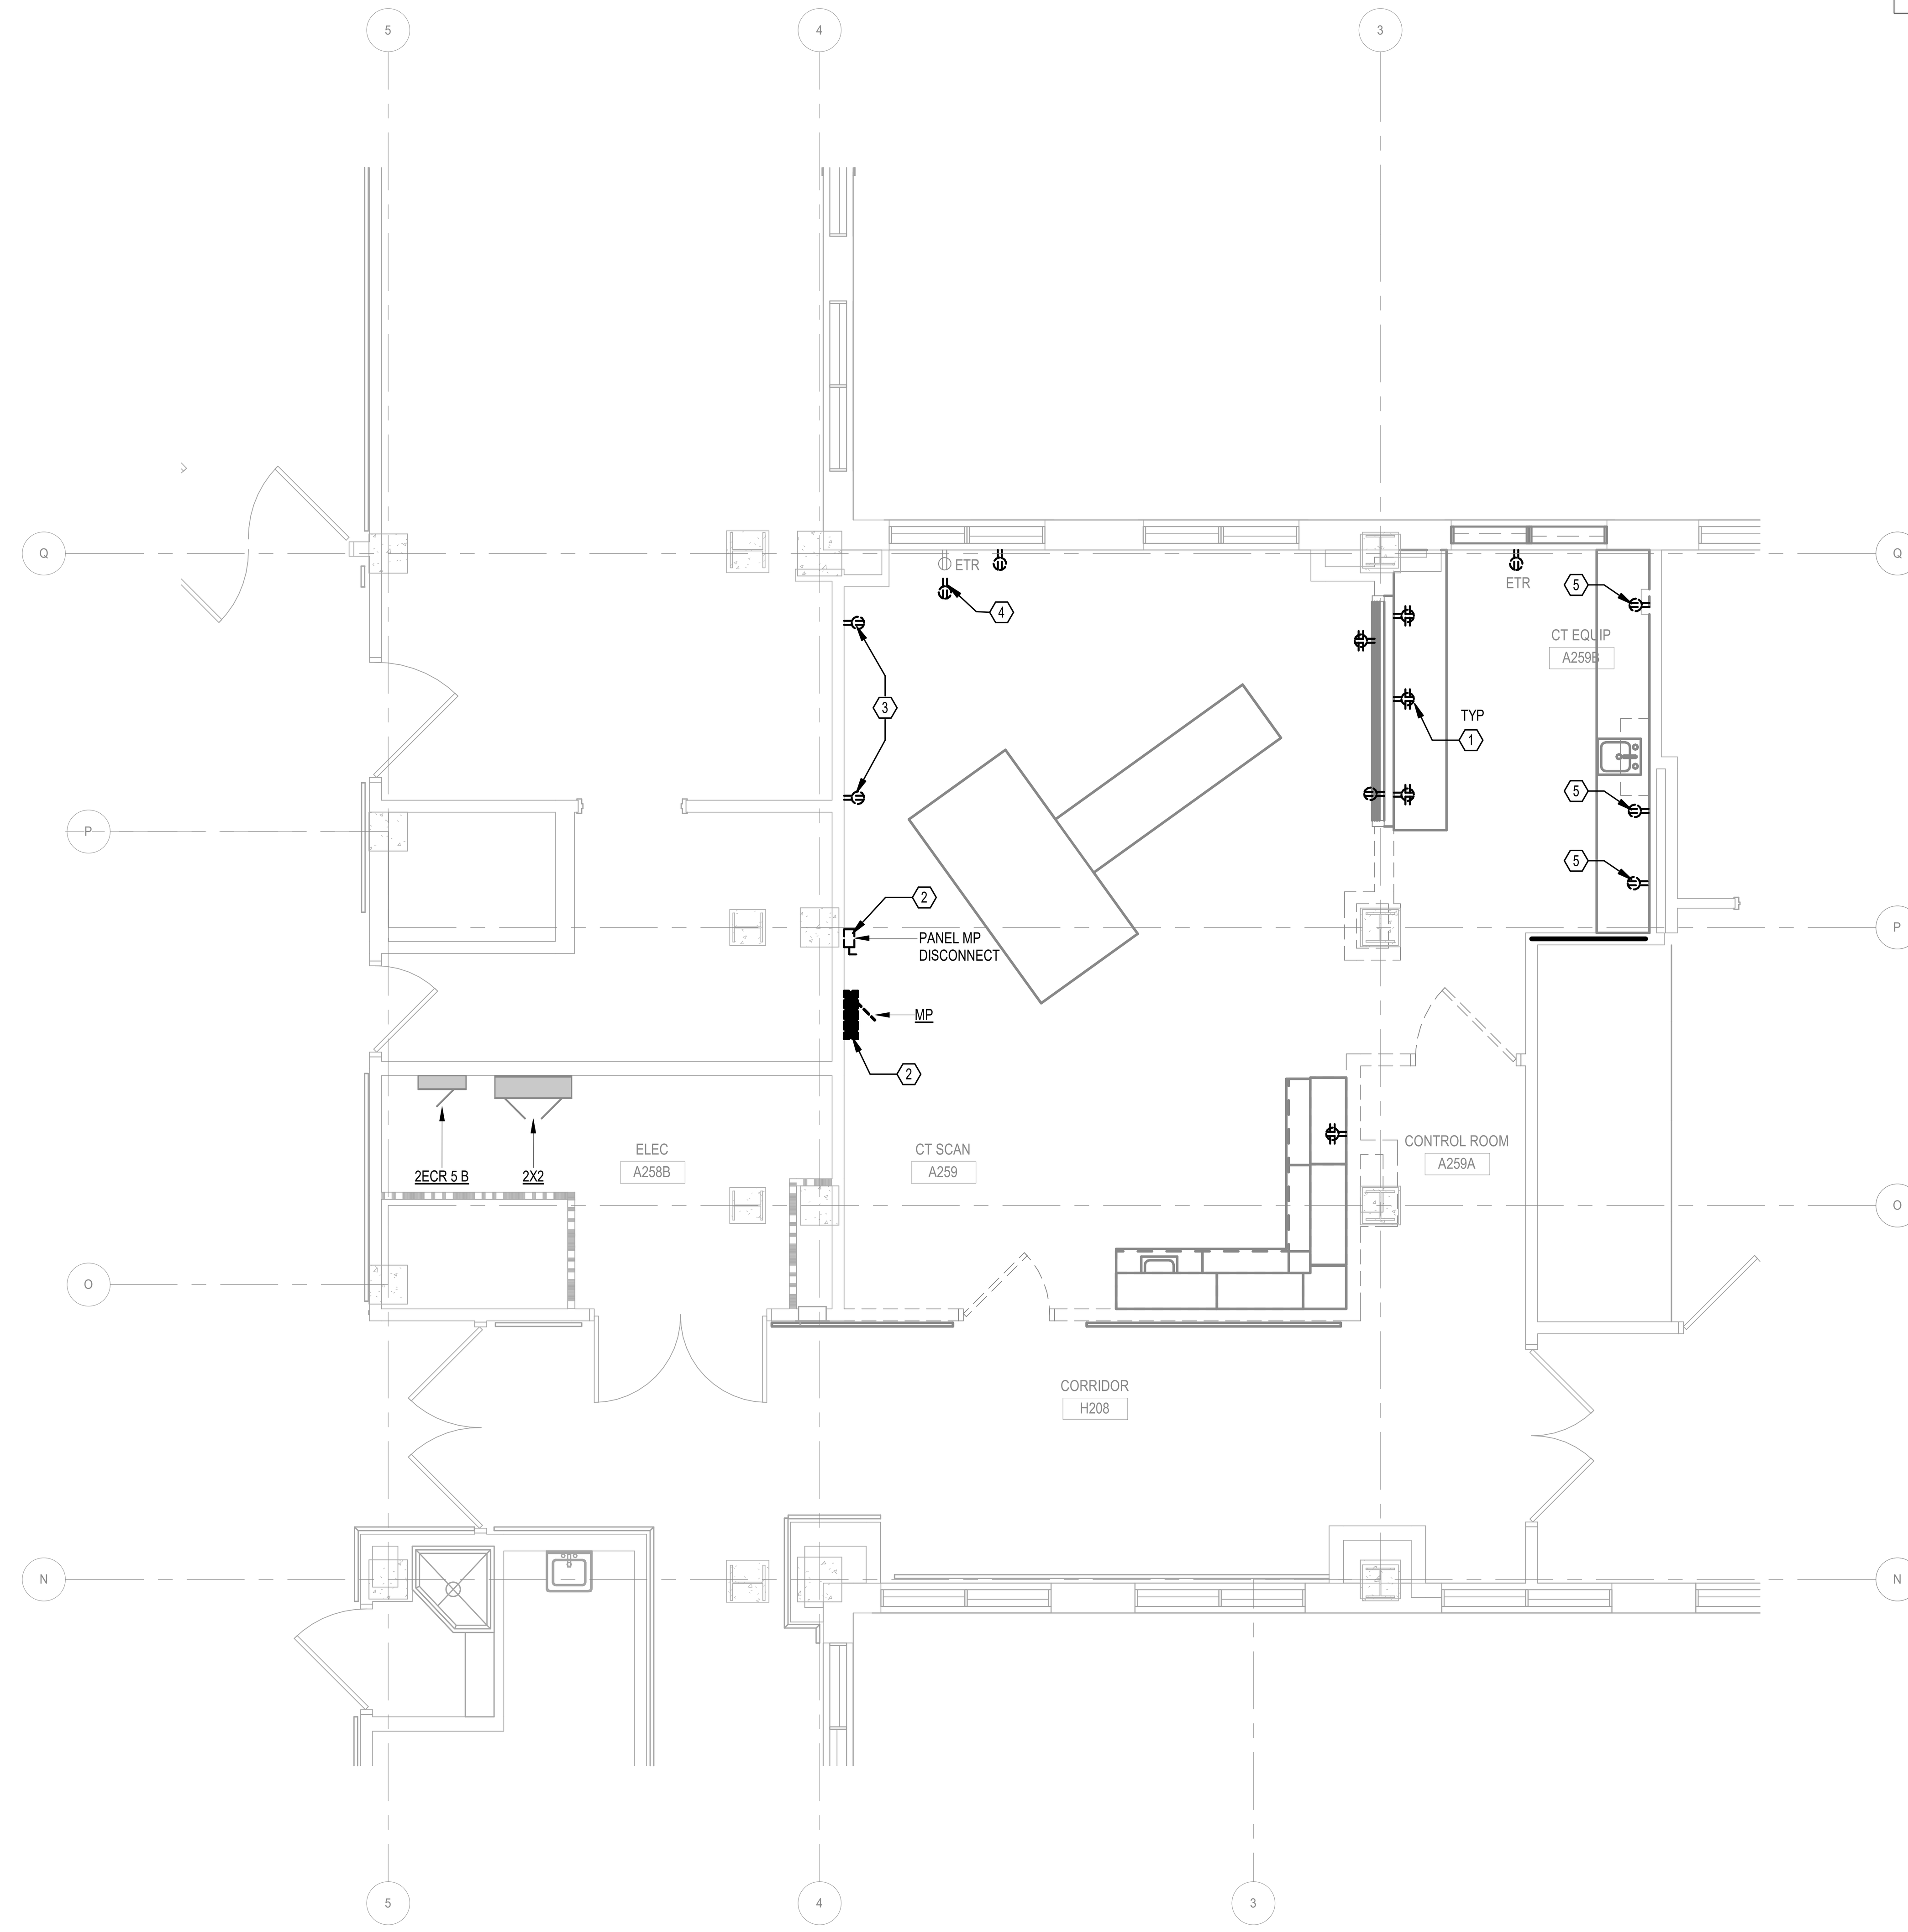

1 SECOND FLOOR PLAN - ELECTRICAL EQUIPMENT - DEMOLITION
1/4" = 1'-0"

KEY PLAN

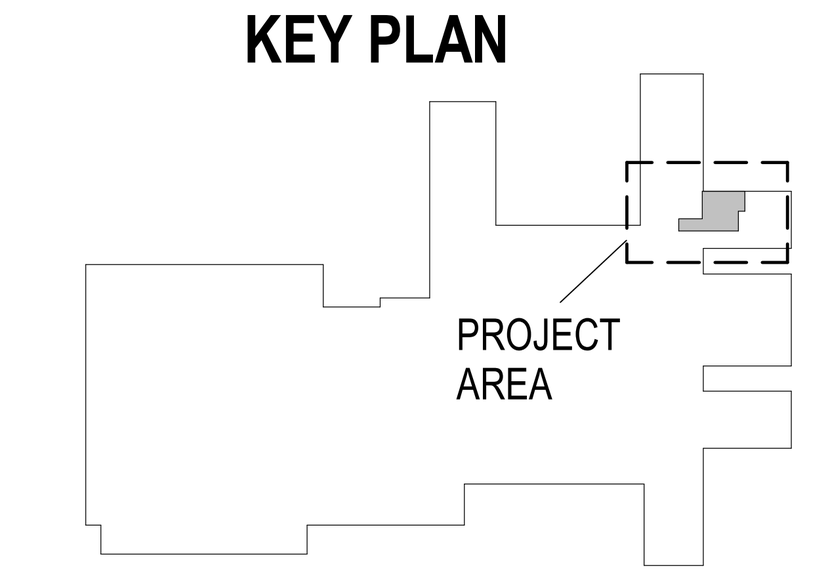

N

0 2' 4' 8' 12'
1/4" = 1'-0"

CONSULTANT	ARCHITECT/ENGINEER OF RECORD	STAMP	Office of Construction and Facilities Management	Drawing Title: SECOND FLOOR PLAN - ELECTRICAL EQUIPMENT - DEMOLITION	Phase: 100% CONTRACT DOCUMENTS FOR BIDDING
Above Group ENGINEERING. DESIGN. CONSULTING. 305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com www.abovegroupinc.com COA/CA Lic. No. 31120 305 East Dr., Suite H, Melbourne, Florida 32904 PH: 321.345.9026	THINKFORM architects THINKFORM DESIGN ARCHITECT LLC 38 EAST BROAD STREET HOPEWELL, NJ 08525 T:855.821.0274 F:609.644.4397 Russell DiNardo, AIA NY 031521-1	COMMONWEALTH OF PENNSYLVANIA REGISTERED PROFESSIONAL THOMAS D. BLISS ENGINEER PE077256	VA U.S. Department of Veterans Affairs	Approved:	FULLY SPRINKLERED

Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Project Number	657-23-104JC
Building Number	1
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	TDB
Drawn	WWS
Drawing Number	ED102

Revisions: Date:

3/6/2026 1:04:16 PM

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

CODED NOTES:

1. REFER TO SHEET E-502 FOR WIRING AND CONTROLS FOR THIS FIXTURE.
2. UNDERCABINET LIGHTING MOUNTED UNDERNEATH CABINETS IN THIS AREA. LIGHTS SHALL BE CONTROLLED VIA SWITCH INTEGRAL TO FIXTURE. COORDINATE INSTALLATION WITH ARCHITECTURAL DETAILS.
3. REINSTALL EXISTING FIXTURE TO NEW LOCATION UNOBSTRUCTED BY ENCLOSURE.

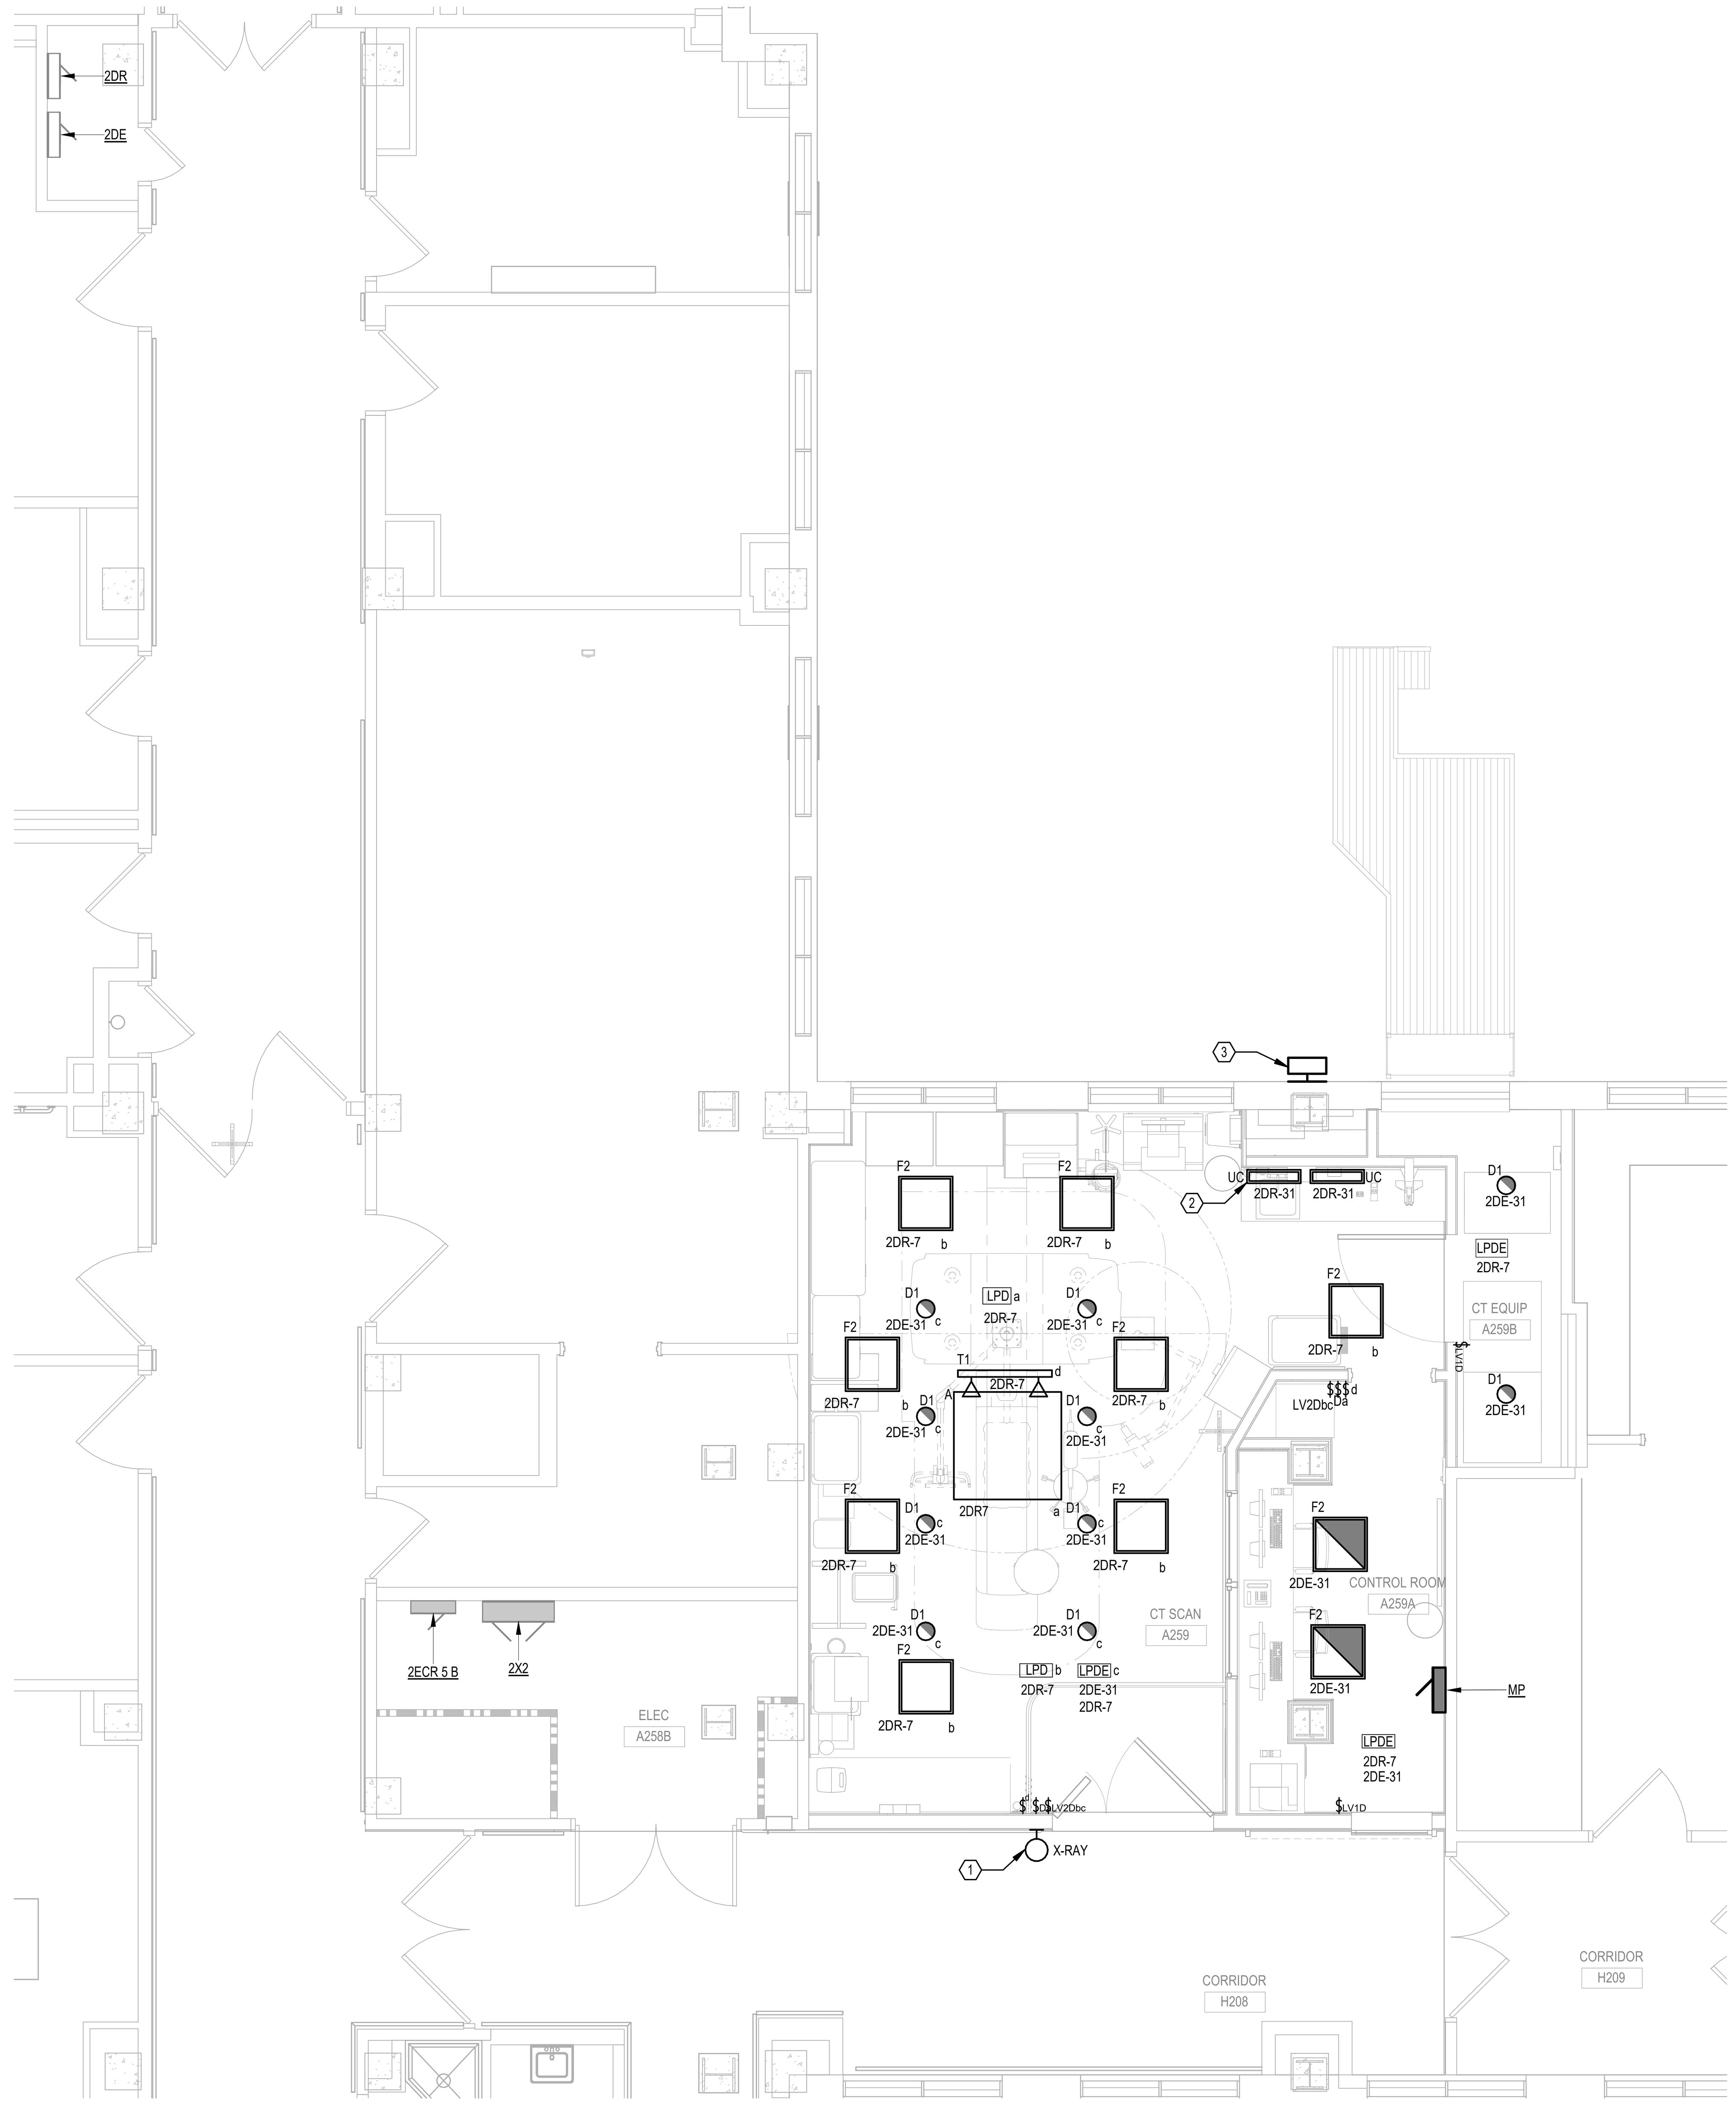

1 SECOND FLOOR PLAN - LIGHTING - NEW WORK
1/4" = 1'-0"

KEY PLAN

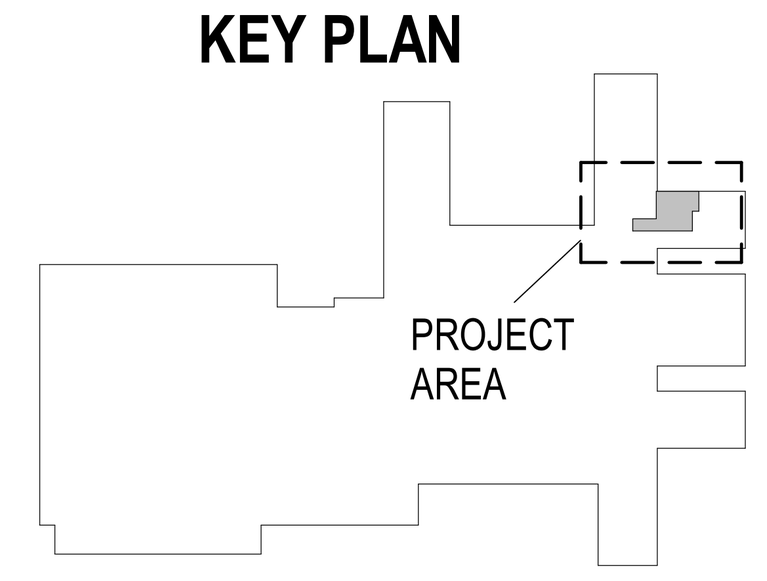

N
0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions:
Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	SECOND FLOOR PLAN - LIGHTING - NEW WORK
Approved:	
Phase	100% CONTRACT DOCUMENTS FOR BIDDING
	FULLY SPRINKLERED
Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	TDB
Drawn	WWS
Project Number	657-23-104JC
Building Number	1
Drawing Number	EL101

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt
3/6/2026 1:04:19 PM

DRAWING NOTES:

1. ALL VALUES SHOWN IN VIEWS ARE IN FOOTCANDLES (fc).

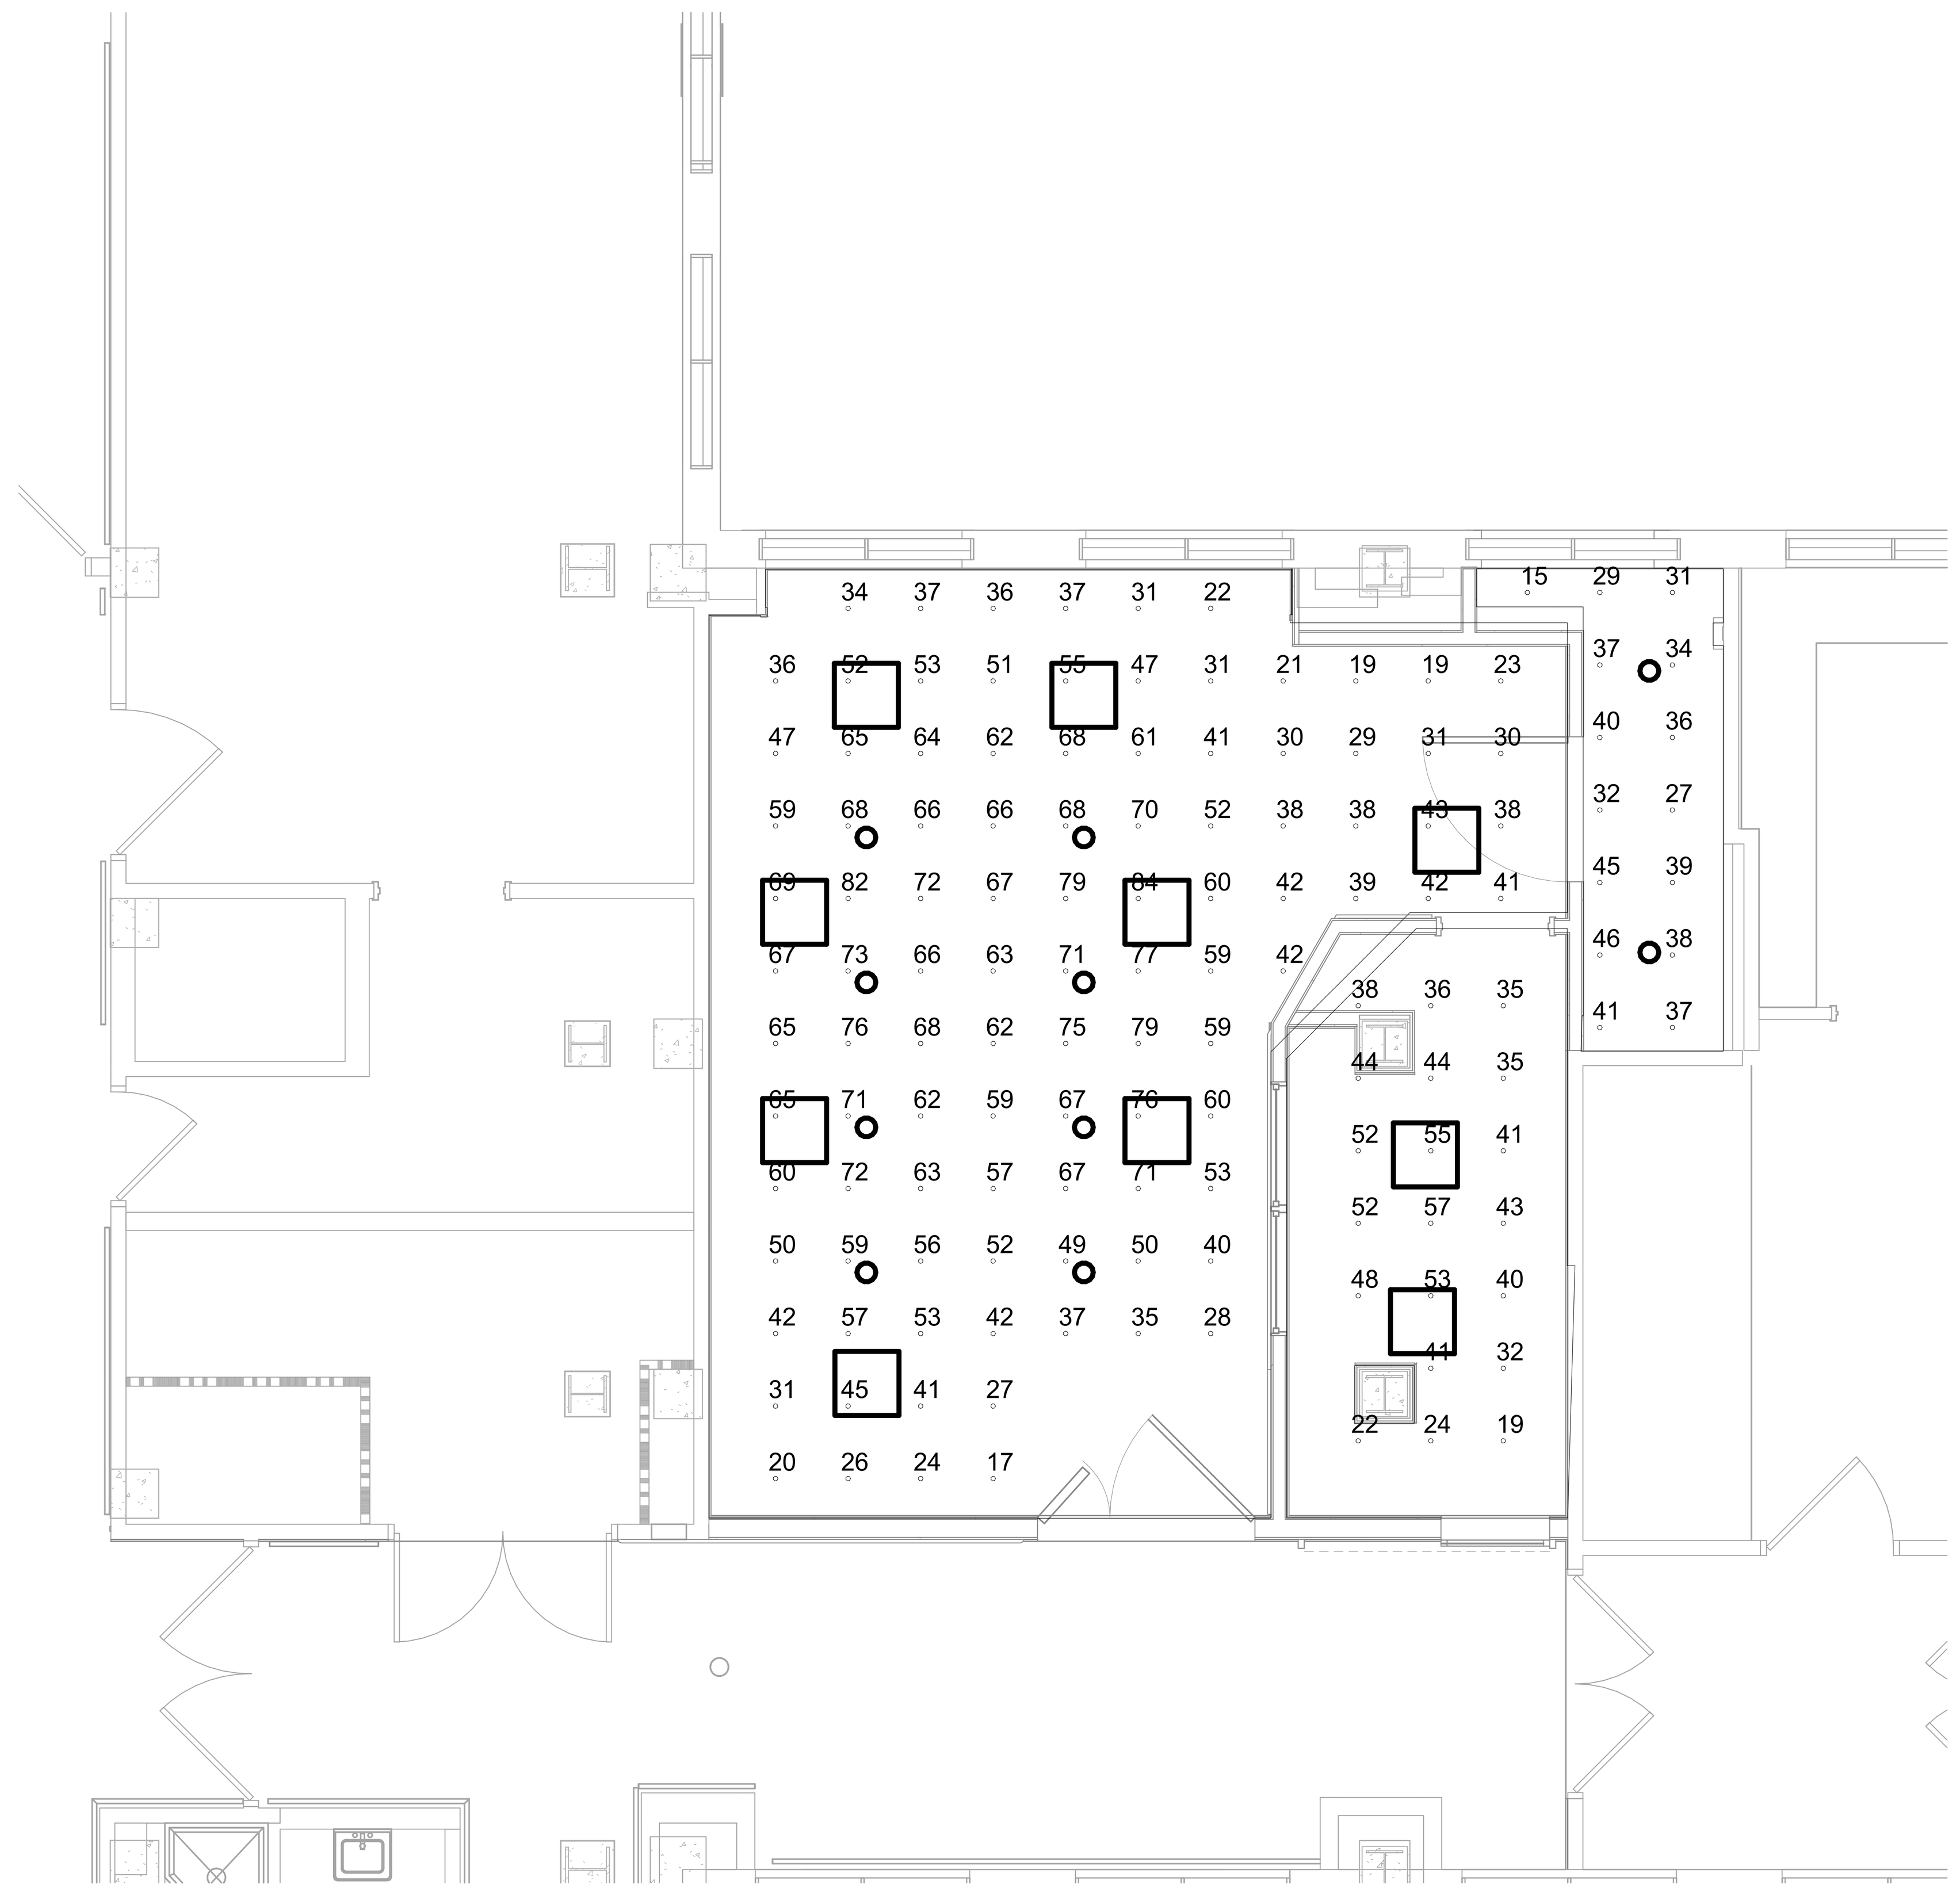

1 SECOND FLOOR PLAN - LIGHTING - PHOTOMETRICS
1/4" = 1'-0"

Name	Number	Area (sq ft)	Height (ft)	Grid Points	Avg (fc)	Max (fc)	Min (fc)	Avg/Min	Min/Avg	Max/Avg	Max/Min	LPD (W/sq ft)
CONTROL ROOM	A259A	117.8	2.5	20	48.52	56.61	19.29	2.1	0.48	1.4	2.93	0.57
CT SCAN	A259	477.74	2.5	101	51.5	83.88	17.29	2.98	0.34	1.63	4.85	0.7
CT EQUIP	A259B	54.37	2.5	15	35.14	45.62	15.38	2.29	0.44	1.3	2.97	0.54

KEY PLAN

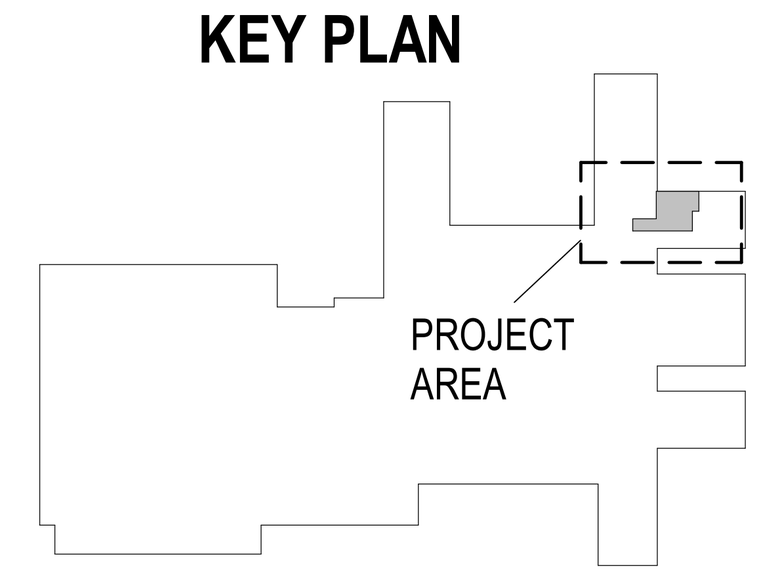



Revisions: | Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
THOMAS D. BLISS
ENGINEER
PE077256

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: SECOND FLOOR PLAN - LIGHTING - PHOTOMETRICS

Approved:

Phase: 100% CONTRACT DOCUMENTS FOR BIDDING

FULLY SPRINKLERED

Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259

Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106

Issue Date: 06 MARCH 2026

Checked: TDB

Drawn: WWS

Project Number: 657-23-104JC

Building Number: 1

Drawing Number: EL102

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

3/6/2026 1:04:20 PM

DRAWING NOTES:

1. REFER TO SHEET E-601 FOR WIRING DETAILS

DRAWING NOTES:

1. PROPOSED ROUTING OF FEED TO NEW PANEL LOCATED IN MECHANICAL YARD. REFER TO ONE-LINE DIAGRAM ON SHEET E-601 FOR ADDITIONAL DETAILS.
2. PROVIDE 8"x8" PULL BOX FOR CONDUIT ROUTING.
3. ROUTE CONDUIT OVERHEAD IN ELECTRICAL ROOM TO WALL INDICATED.
4. PROVIDE 1'x1' PULL BOX ON WALL FOR PENETRATION INTO PIPE BASEMENT.

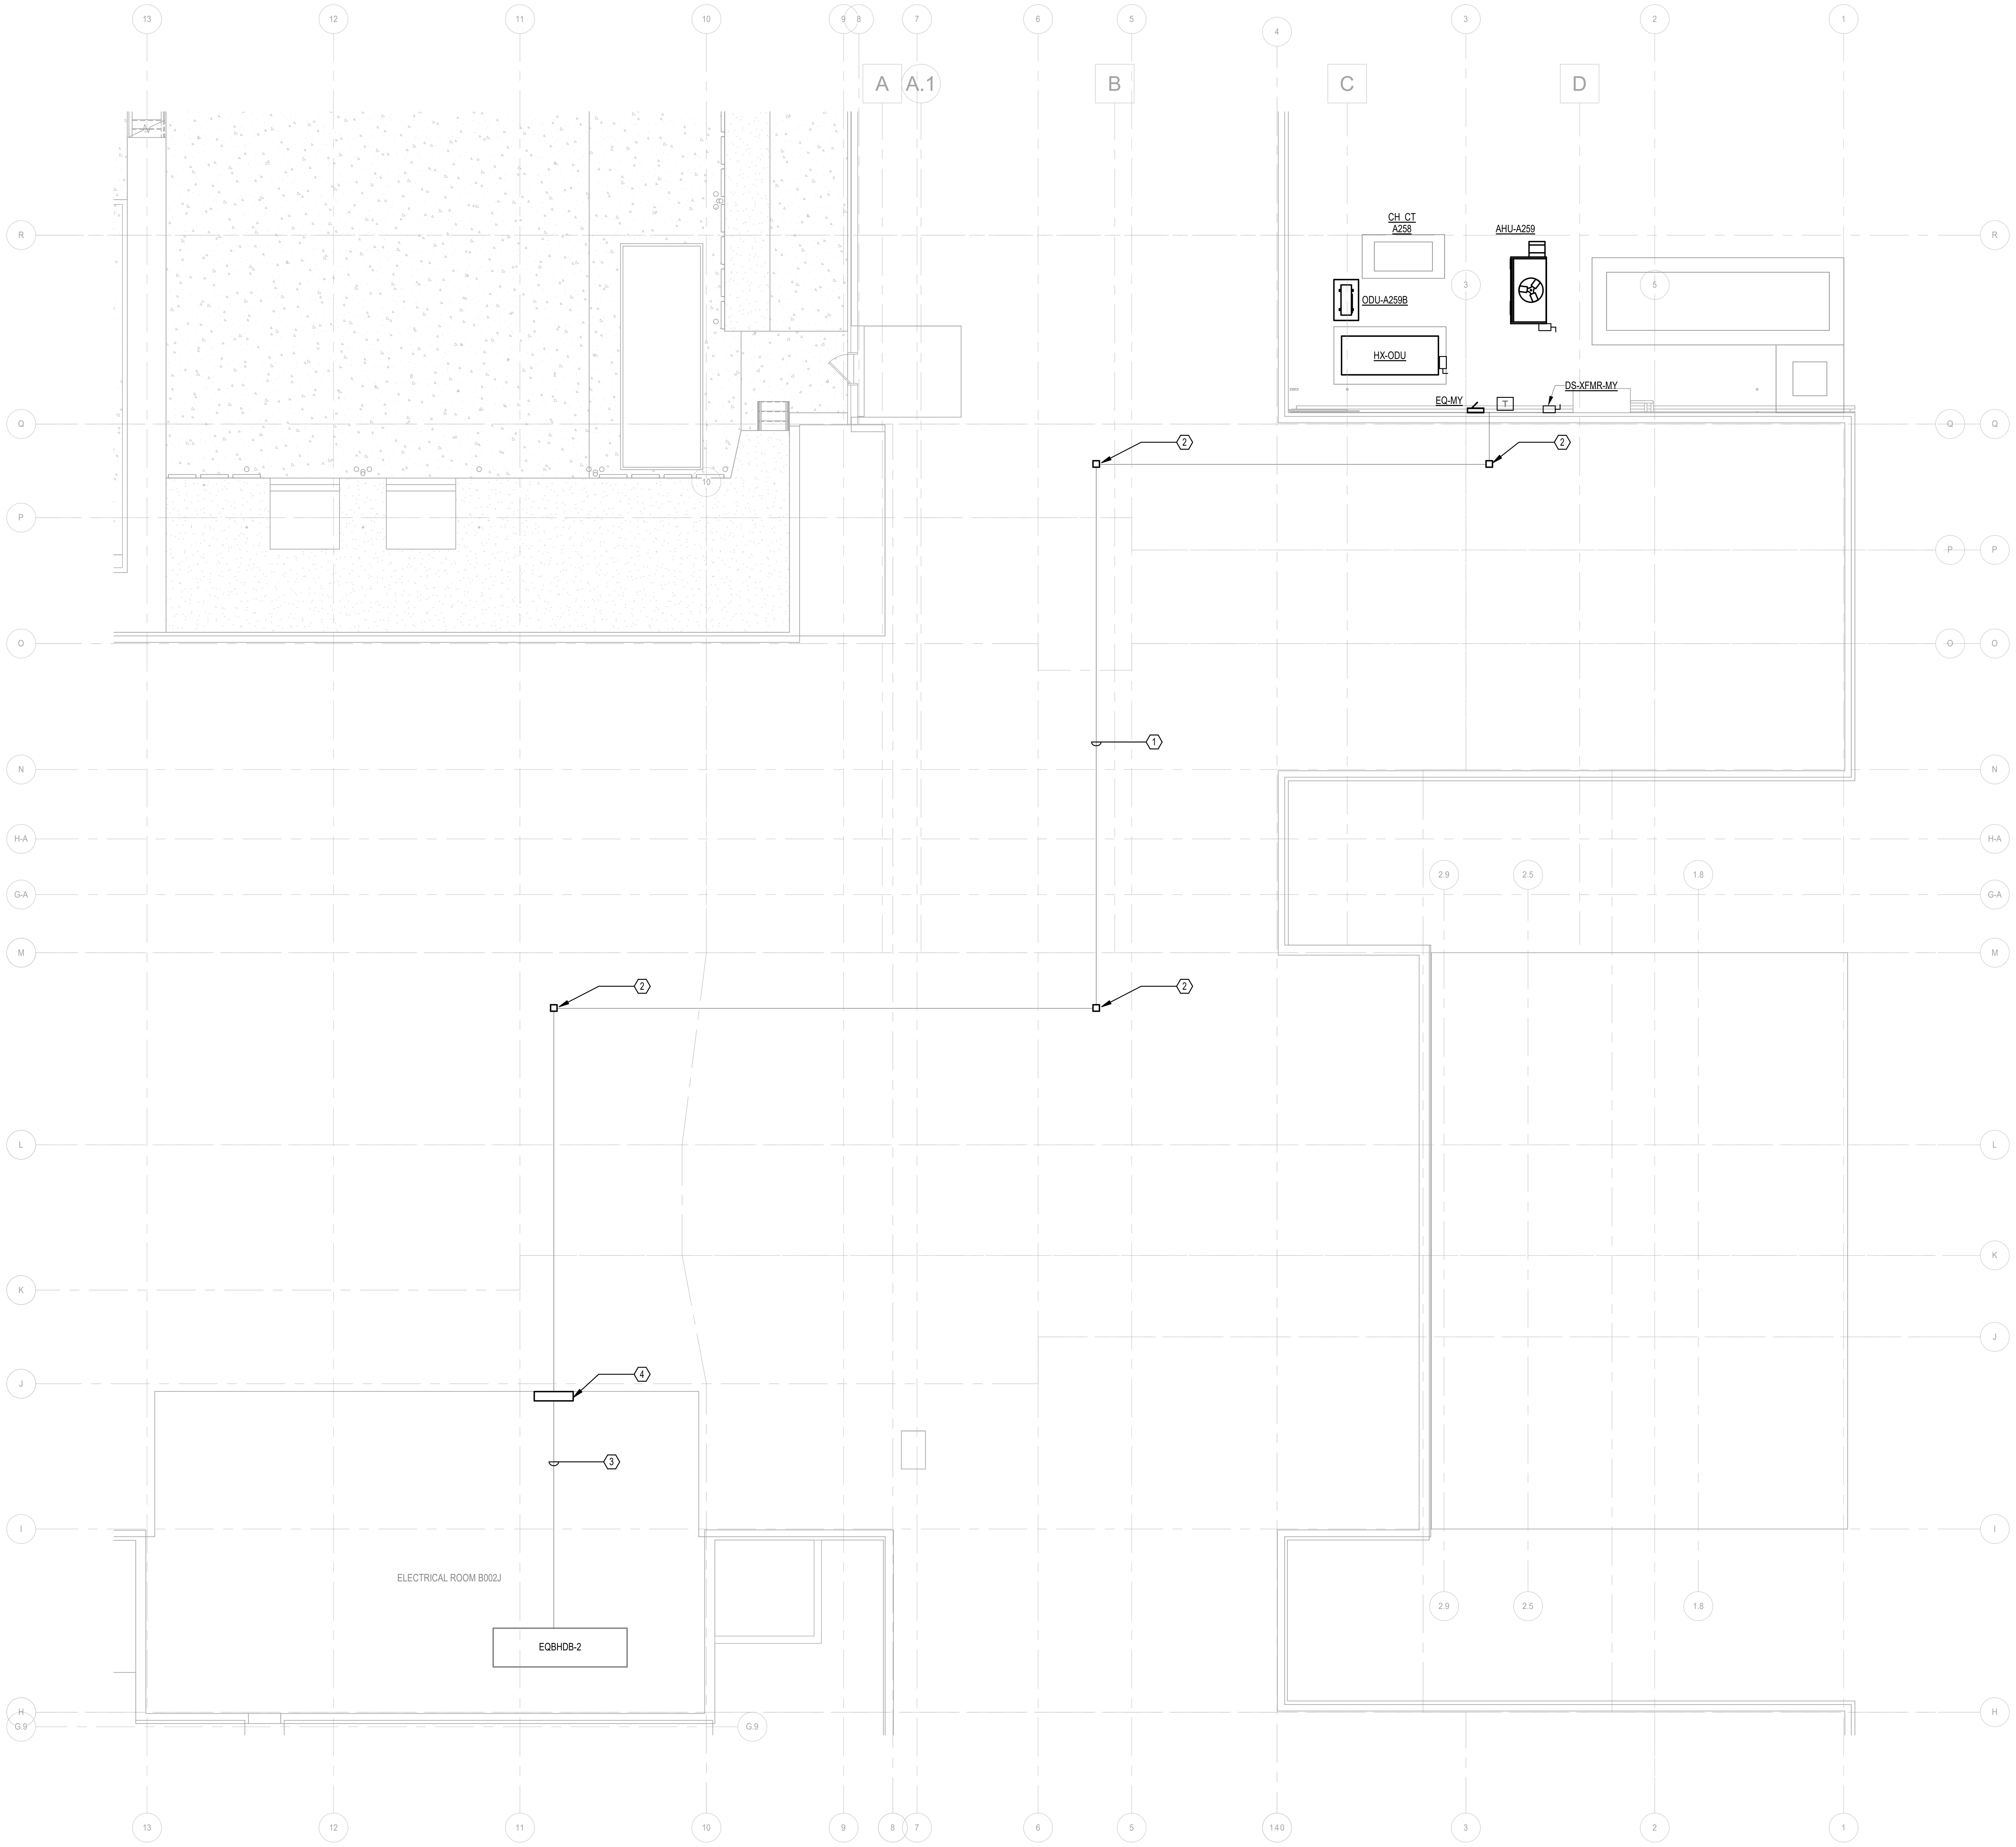

1 BASEMENT FLOOR PLAN - ELECTRICAL EQUIPMENT - NEW WORK

1/8" = 1'-0"

KEY PLAN

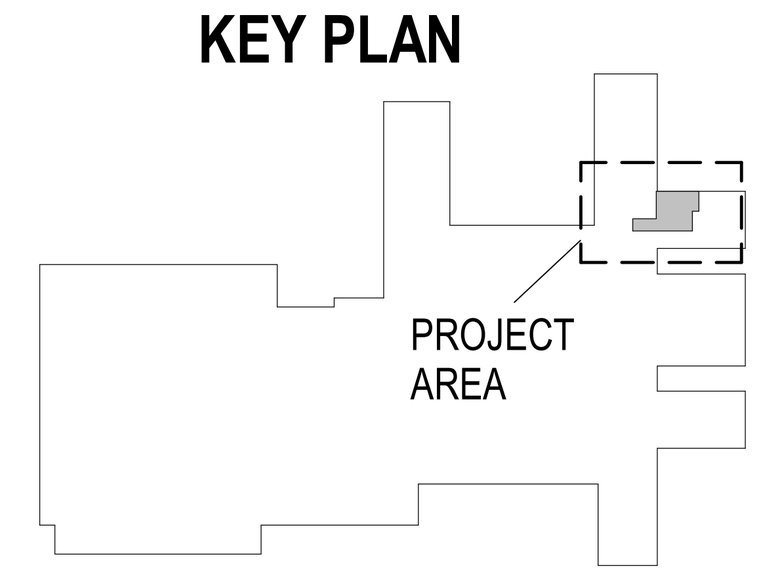

1/8" = 1'-0"

CONSULTANT Above Group ENGINEERING. DESIGN. CONSULTING. 305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com www.abovegroupinc.com COA/CA Lic. No. 31120 305 East Dr., Suite H, Melbourne, Florida 32904 PH: 321.345.9026	ARCHITECT/ENGINEER OF RECORD THINKFORM architects THINKFORM DESIGN ARCHITECT LLC 38 EAST BROAD STREET HOPEWELL, NJ 08525 T:855.821.0274 F:609.644.4397 Russell DiNardo, AIA NY 031521-1	STAMP COMMONWEALTH OF PENNSYLVANIA REGISTERED PROFESSIONAL THOMAS D. BLISS ENGINEER PE077256	Office of Construction and Facilities Management VA U.S. Department of Veterans Affairs	Drawing Title: BASEMENT FLOOR PLAN - ELECTRICAL EQUIPMENT - NEW WORK Approved:

Phase: 100% CONTRACT DOCUMENTS FOR BIDDING	Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	Project Number: 657-23-104JC	Building Number: 1
FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Issue Date: 06 MARCH 2026	Checked: TDB
		Drawn: WWS	Drawing Number: EP101

Revisions: Date:

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

3/6/2026 1:04:24 PM

DRAWING NOTES:

1. REFER TO SHEET E-601 FOR MORE INFORMATION REGARDING FEEDER SIZES TO EQUIPMENT.
2. ALL CONDUIT ROUTING FROM PANEL TO EQUIPMENT IN MECHANICAL YARD SHALL ROUTED UNDERGROUND AND STUB UP AT UNIT LOCATION.

CODED NOTES:

1. LOCATION OF UNIT-MOUNTED FACTORY PROVIDED DISCONNECT ON AIR HANDLING UNIT.
2. LOCATION OF UNIT-MOUNTED FACTORY PROVIDED DISCONNECT ON CT MANUFACTURER PROVIDED OUTDOOR COOLING UNIT. REFER TO EQUIPMENT SCHEDULE ON SHEET E-601 FOR MORE INFORMATION.
3. JUNCTION BOX WITH 120V CIRCUIT FOR HEAT TRACING FOR MECHANICAL PIPING. COORDINATE EXACT LOCATION AND ROUTING WITH MECHANICAL CONTRACTOR.
4. INDOOR UNIT IS POWERED FROM OUTDOOR UNIT. REFER TO SHEET E-601 FOR FEEDER SIZE AND ADDITIONAL INFORMATION.
5. LOCATION OF CT MANUFACTURER PROVIDED UPS. REFER TO SHEET E-502 FOR ADDITIONAL DETAILS.
6. PROVIDE 120V JUNCTION BOX NEAR TERMINAL UNIT. COORDINATE EXACT LOCATION WITH MECHANICAL CONTRACTOR.
7. PROVDE 120V JUNCTION BOX NEAR AHU FOR HUMIDFIER CONTROLS.
8. PROVIDE STAINLESS STEEL STRUT IN GROUND FOR MOUNTING OF DISCONNECT.
9. MOUNT RECEPTACLE DIRECTLY BELOW PANELBOARD. COORDINATE INSTALLATION WITH MECHANICAL PIPING ALONG THIS WALL.

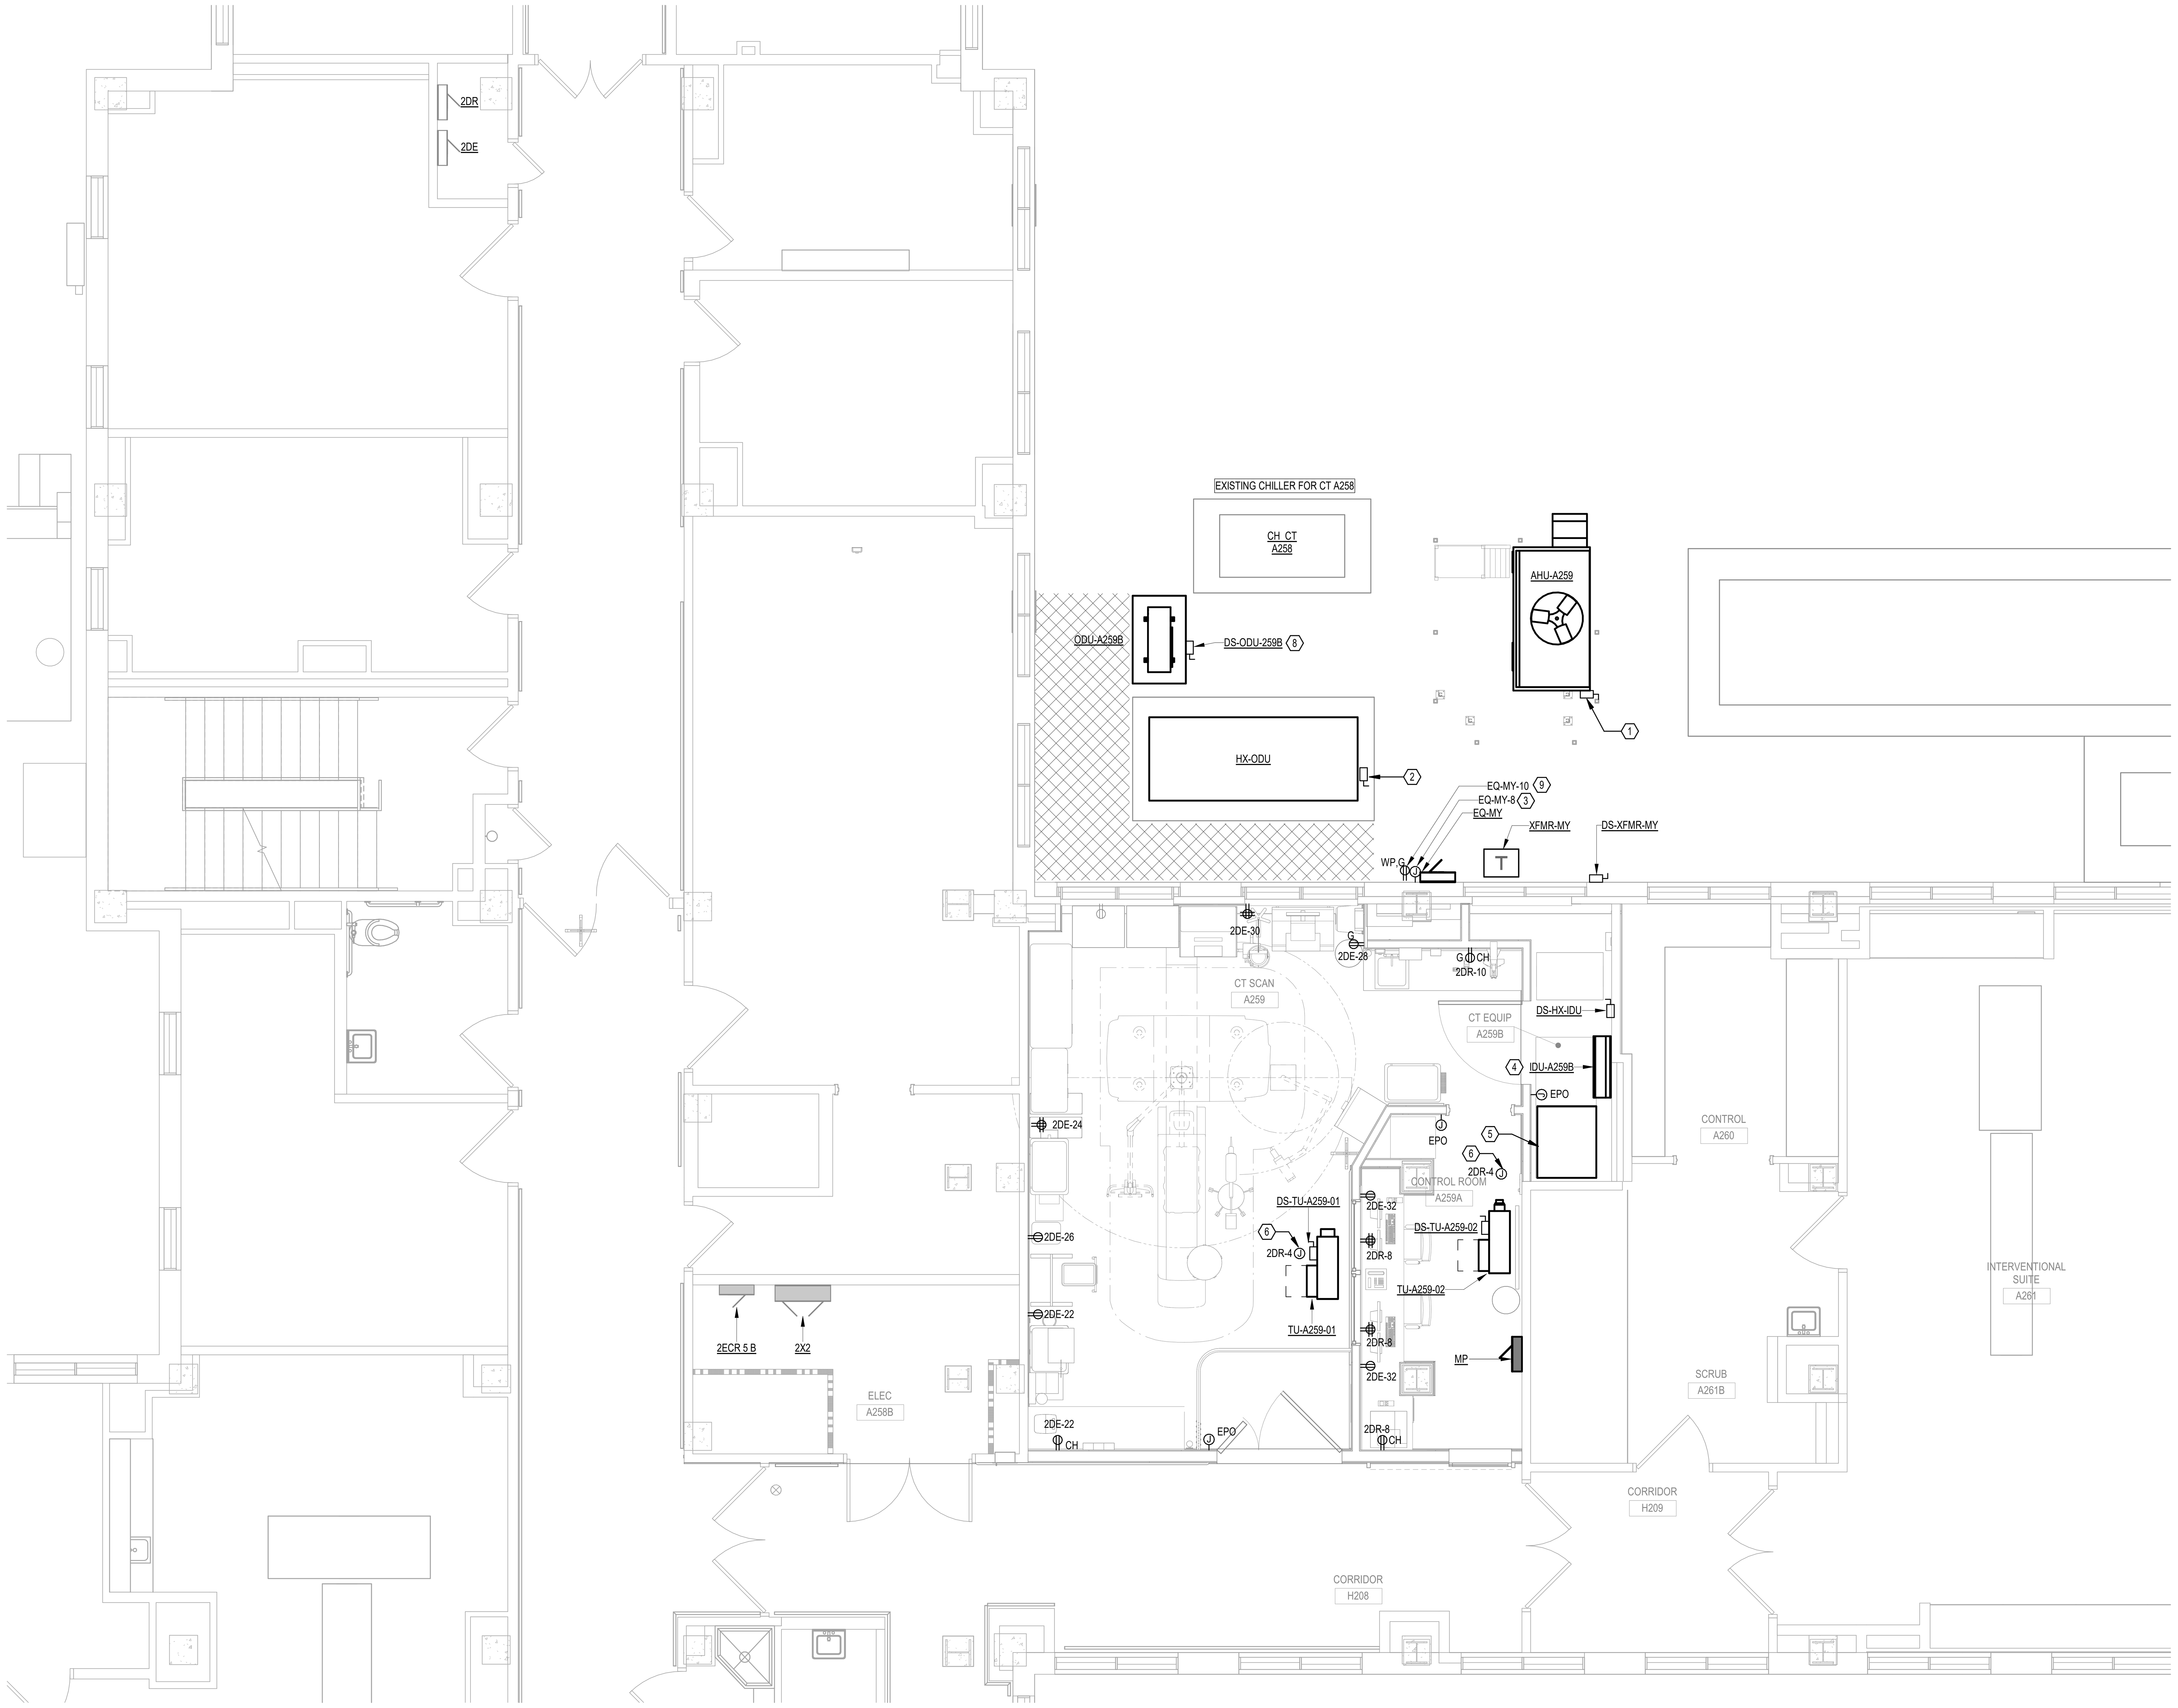

1 SECOND FLOOR PLAN - ELECTRICAL EQUIPMENT - NEW WORK
1/4" = 1'-0"

KEY PLAN

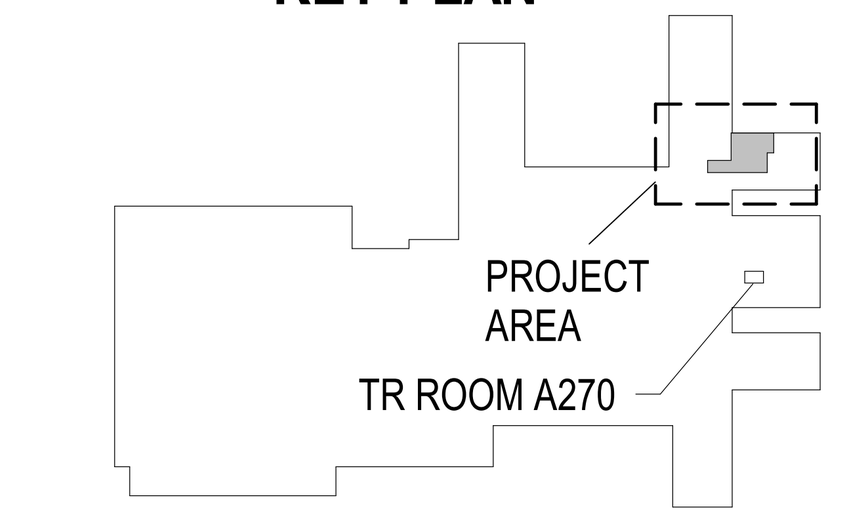

N 0 2' 4' 8' 12'
1/4" = 1'-0"

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
THOMAS D. BLISS
ENGINEER
PE077256

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
SECOND FLOOR PLAN - ELECTRICAL EQUIPMENT - NEW WORK	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number: 1
		Issue Date: 06 MARCH 2026; Checked: TDB; Drawn: WWS	Drawing Number: EP102

Revisions: Date:

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt
3/6/2026 1:04:30 PM

SPECIFIED TECHNOLOGIES INC - SPECSEAL LCI SEALANT OR EQUAL

* INDICATES SUCH PRODUCTS SHALL BEAR THE UL CERTIFICATION MARK FOR JURISDICTIONS EMPLOYING THE UL CERTIFICATION.

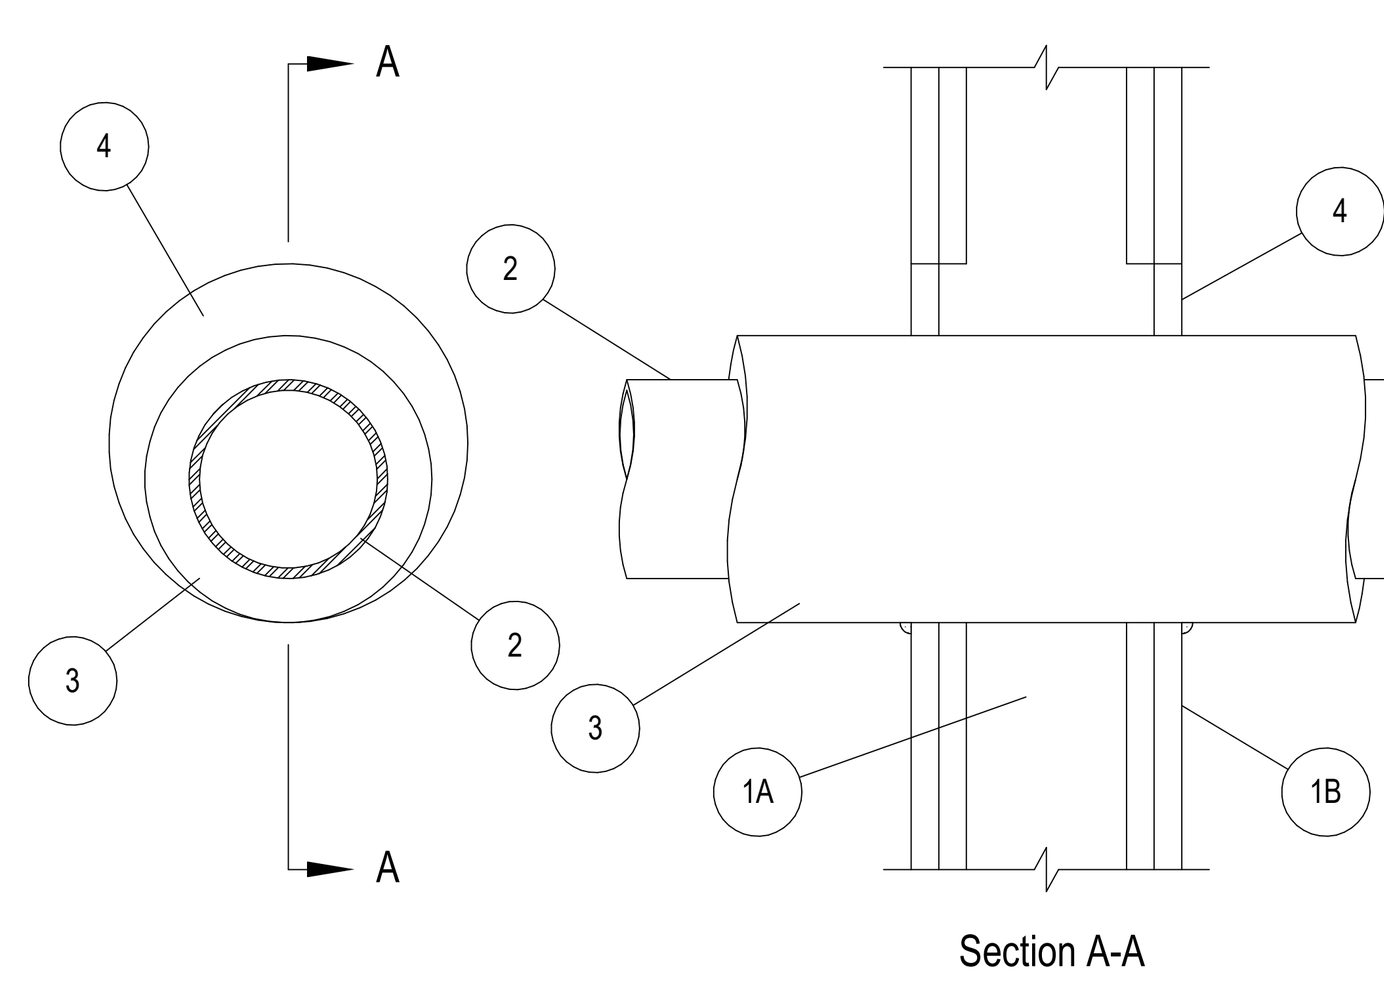

Section A-A

SYSTEM NO. W-L-5122

1. WALL ASSEMBLY - THE 1 OR 2 HR FIRE-RATED GYPSUM BOARD/STUD WALL ASSEMBLY SHALL BE CONSTRUCTED OF THE MATERIALS AND IN THE MANNER SPECIFIED IN THE INDIVIDUAL U300 OR U400 SERIES WALL OR PARTITION DESIGN IN THE UL FIRE RESISTANCE DIRECTORY AND SHALL INCLUDE THE FOLLOWING CONSTRUCTION FEATURES:
   A. STUDS - WALL FRAMING MAY CONSIST OF EITHER WOOD STUDS OR STEEL CHANNEL STUDS. WOOD STUDS TO CONSIST OF NOM 2 BY 4 IN. LUMBER SPACED 16 IN. OC. STEEL STUDS TO BE MIN 3-5/8 IN. WIDE AND SPACED MAX 24 IN. OC.
   B. GYPSUM BOARD* - THICKNESS, TYPE, NUMBER OF LAYERS AND FASTENERS AS SPECIFIED IN THE INDIVIDUAL WALL AND PARTITION DESIGN. MAX DIAM OF OPENING IS 7-1/2 IN.

   THE HOURLY F RATING OF THE FIRESTOP SYSTEM IS EQUAL TO THE HOURLY FIRE RATING OF THE WALL ASSEMBLY IN WHICH IT IS INSTALLED.
2. THROUGH PENETRANT - ONE METALLIC PIPE OR TUBE TO BE INSTALLED ECCENTRICALLY OR CONCENTRICALLY WITHIN THE FIRESTOP SYSTEM. PIPE OR TUBE TO BE RIGIDLY SUPPORTED ON BOTH SIDES OF THE WALL ASSEMBLY. THE FOLLOWING TYPES AND SIZES OF METALLIC PIPES AND TUBES MAY BE USED:
   A. STEEL PIPE - NOM 4 IN. DIAM (OR SMALLER) SCHEDULE 5 (OR HEAVIER) STEEL PIPE.
   B. IRON PIPE - NOM 4 IN. DIAM (OR SMALLER) CAST OR DUCTILE IRON PIPE.
   C. COPPER PIPE - NOM 2 IN. DIAM (OR SMALLER) REGULAR (OR HEAVIER) COPPER PIPE.
   D. COPPER TUBE - NOM 2 IN. DIAM (OR SMALLER) TYPE L (OR HEAVIER) COPPER TUBE.
3. TUBE INSULATION - PLASTICS# - NOM 3/4 IN. THICK ACRYLONITRILE BUTADIENE/POLYVINYL CHLORIDE (AB/PVC) FLEXIBLE FOAM FURNISHED IN THE FORM OF TUBING. ANNULAR SPACE SHALL BE MIN 0 IN. (POINT CONTACT) TO MAX 1-1/2 IN.

   SEE PLASTICS (QMFZ2) CATEGORY IN THE PLASTICS RECOGNIZED COMPONENT DIRECTORY FOR NAMES OF MANUFACTURERS. ANY RECOGNIZED COMPONENT TUBE INSULATION MEETING THE ABOVE SPECIFICATIONS AND HAVING A UL 94 FLAMMABILITY CLASSIFICATION OF 94-5VA MAY BE USED.
4. FILL, VOID OR CAVITY MATERIAL* - SEALANT - MIN 5/8 IN. THICKNESS OF FILL MATERIAL APPLIED WITHIN ANNULUS, FLUSH WITH BOTH SURFACES OF WALL ASSEMBLY. AT POINT CONTACT LOCATION, MIN 1/4 IN. DIAM BEAD OF FILL MATERIAL APPLIED AT INSULATED METALLIC PIPE/GYPSUM BOARD INTERFACE ON BOTH SURFACES OF WALL.

1 CONDUIT PENETRATION OF FIREWALL
N.T.S.

IDENTIFICATION OF GROUNDED CONDUCTORS SHALL BE PERFORMED BASED ON NEC ARTICLE 200.

VOLTAGE 208Y/120V	
PHASE A	BLACK
PHASE B	RED
PHASE C	BLUE
NEUTRAL	WHITE
GROUND	GREEN

VOLTAGE 480Y/277V	
PHASE A	BROWN
PHASE B	ORANGE
PHASE C	YELLOW
NEUTRAL	GREY
GROUND	GREEN

2 WIRE COLOR TABLE
N.T.S.

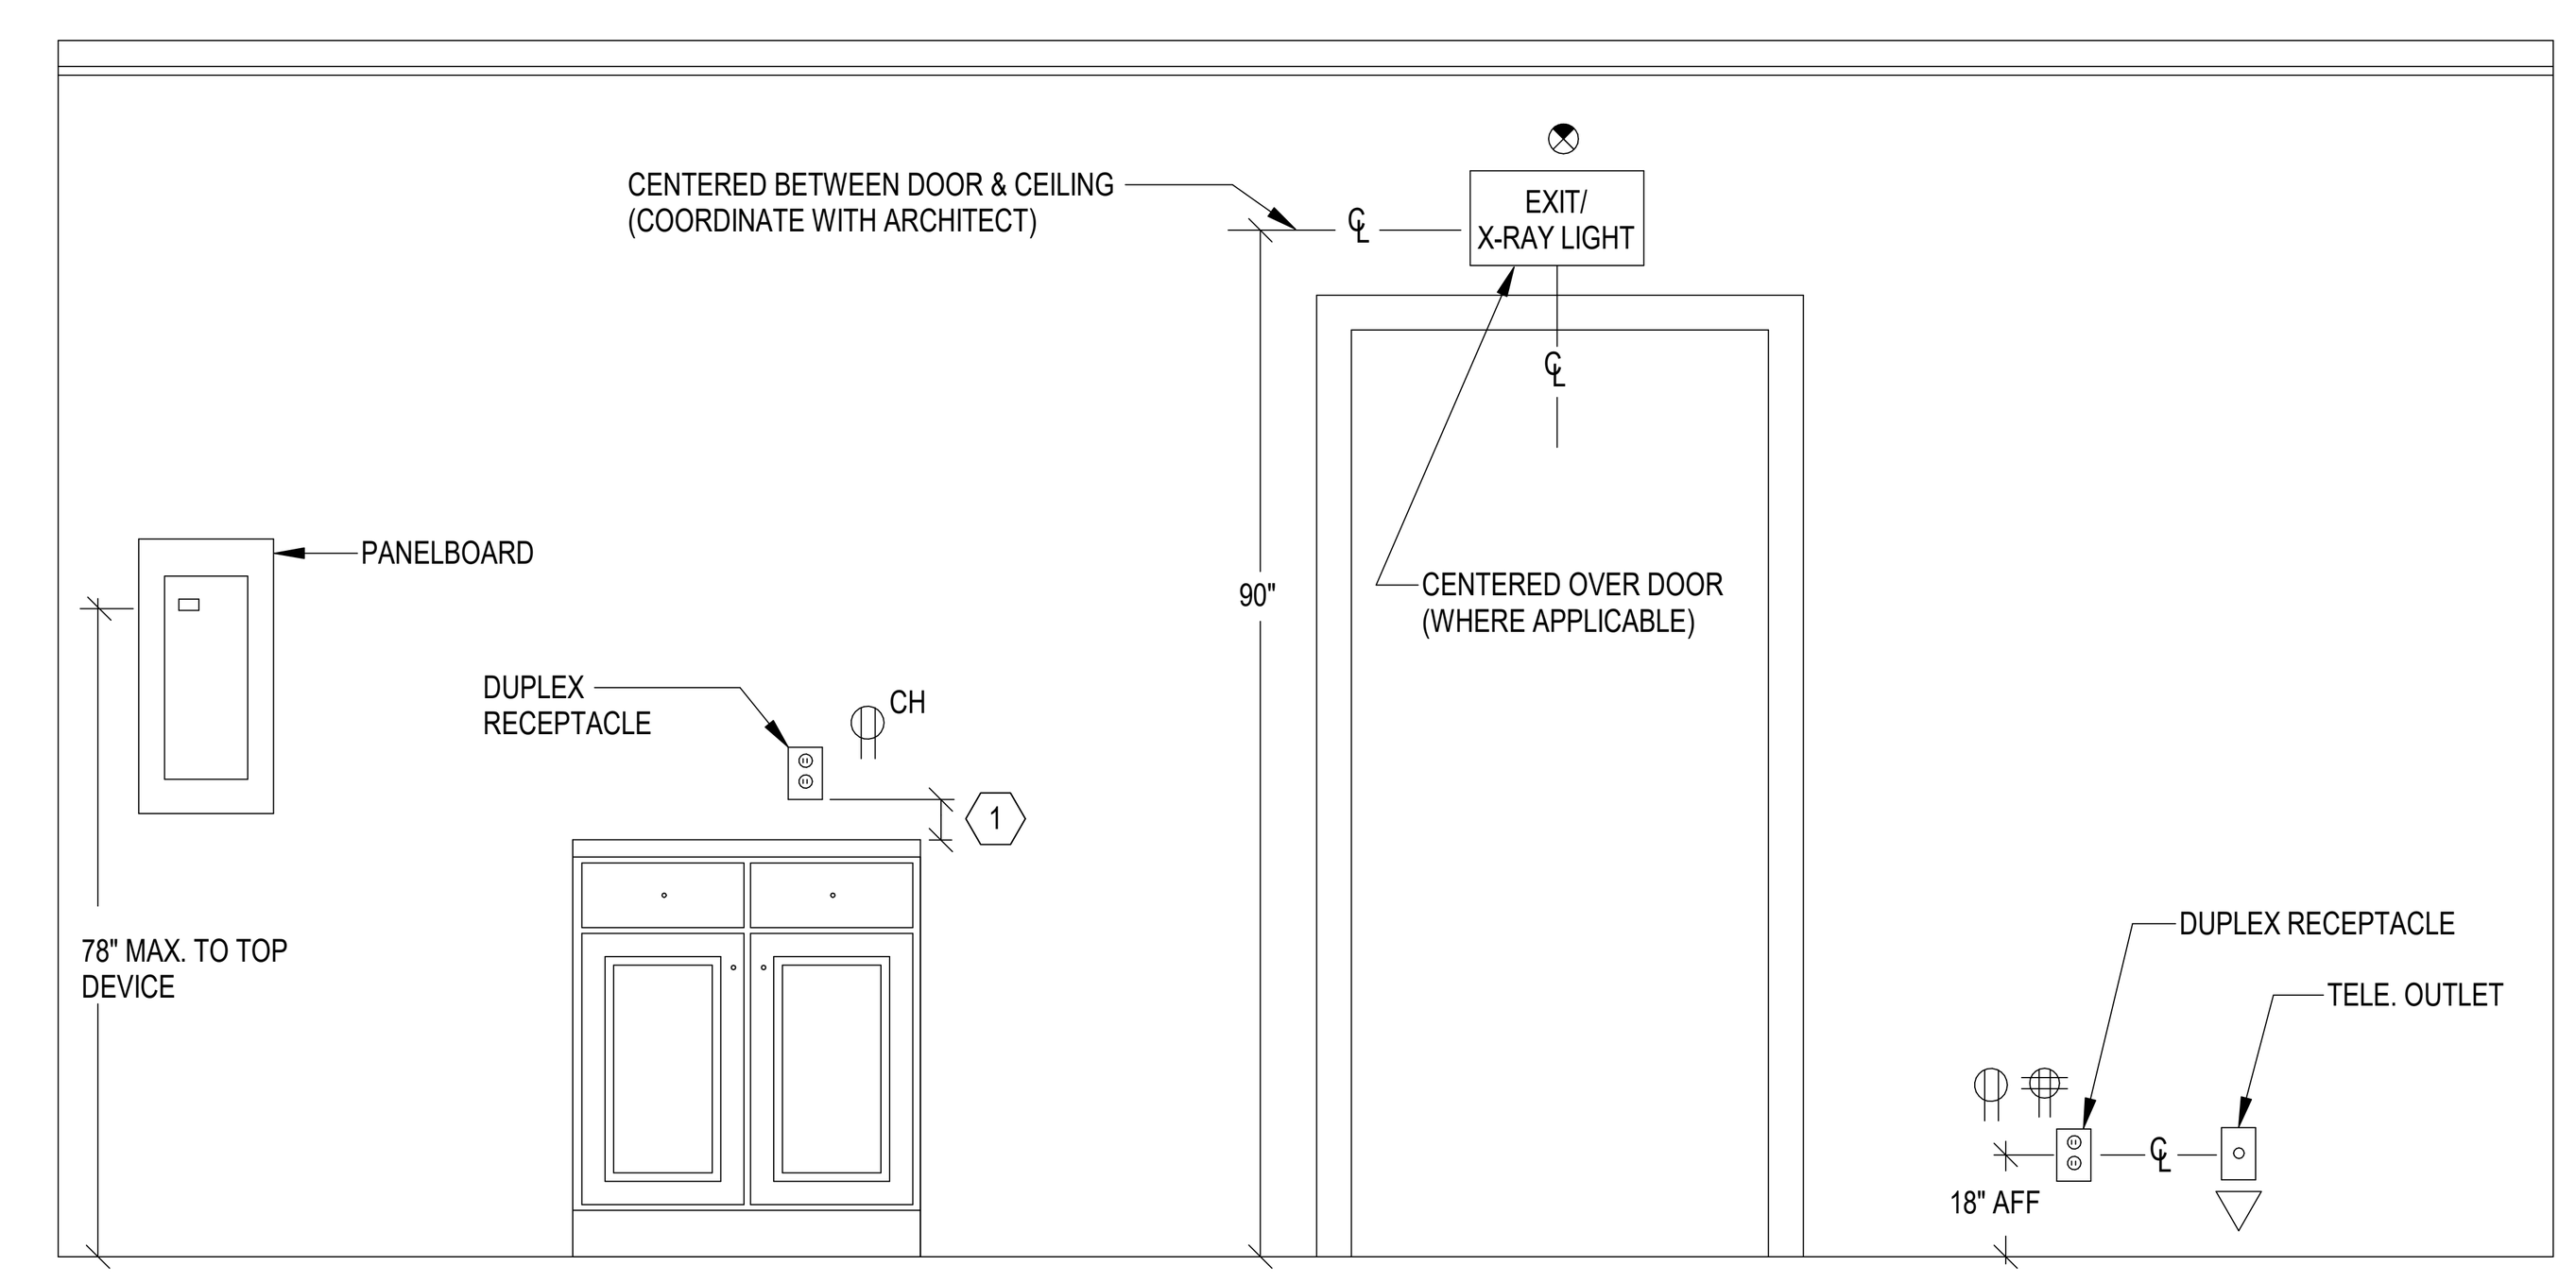

1 MOUNTED AT COUNTER HEIGHT WITH BOTTOM OF DEVICE AT 6" ABOVE COUNTER OR 2" ABOVE BACKSPLASH OR AS NOTED ON PLANS

3 TYPICAL MOUNTING HEIGHTS
N.T.S.

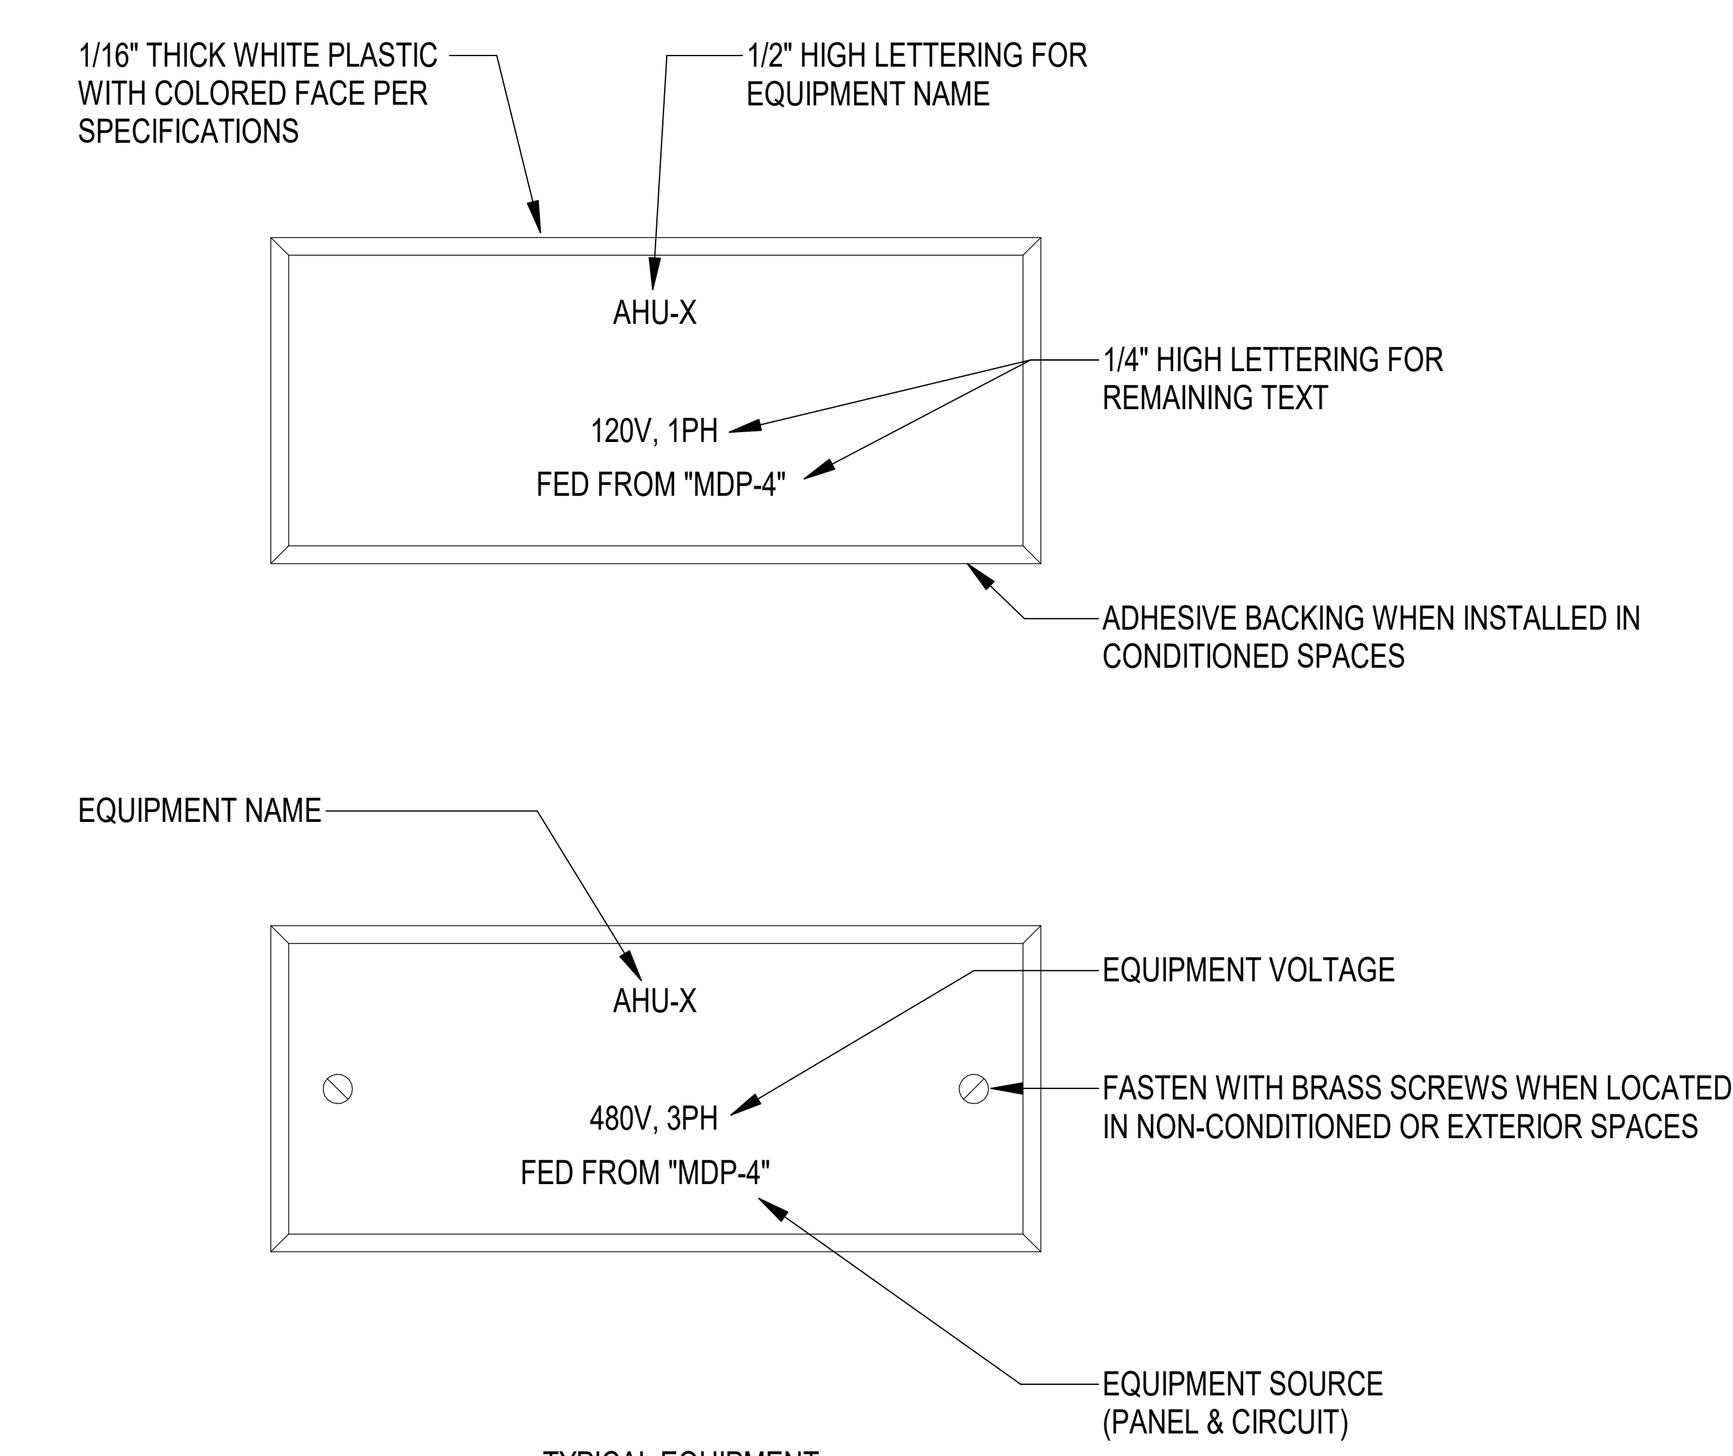

TYPICAL EQUIPMENT

4 EQUIPMENT NAMEPLATE
N.T.S.

CONDUCTORS:

1. ALL WIRE SHALL BE SIZED AS SHOWN ON THE DRAWINGS. IF NO SIZE IS SHOWN, THEN WIRE SHALL BE #12 AWG, EXCEPT AS MODIFIED FOR VOLTAGE DROP BY THE TABLE BELOW. REFER TO BRANCH CIRCUIT VOLTAGE DROP TABLES BELOW. BRANCH CIRCUIT WIRING SHALL BE SIZED TO LIMIT THE VOLTAGE DROP TO 3% OF NOMINAL VOLTAGE OR LESS.

120V (BASED ON 1500W LOAD)	MIN. CONDUCTOR SIZE CIRCUIT LENGTH INCREASE FOR VOLTAGE DROP
0 FT - 70 FT	#12 AWG
71 FT - 115 FT	#10 AWG
116 FT - 180 FT	#8 AWG

181 FEET AND LONGER: SUBMIT WIRE SIZE TO ENGINEER OF RECORD FOR WRITTEN APPROVAL.

277V (BASED ON 4155W LOAD)	MIN. CONDUCTOR SIZE CIRCUIT LENGTH INCREASE FOR VOLTAGE DROP
0 FT - 70 FT	#12 AWG
71 FT - 115 FT	#10 AWG
116 FT - 180 FT	#8 AWG

5 CONDUCTORS DETAIL
N.T.S.

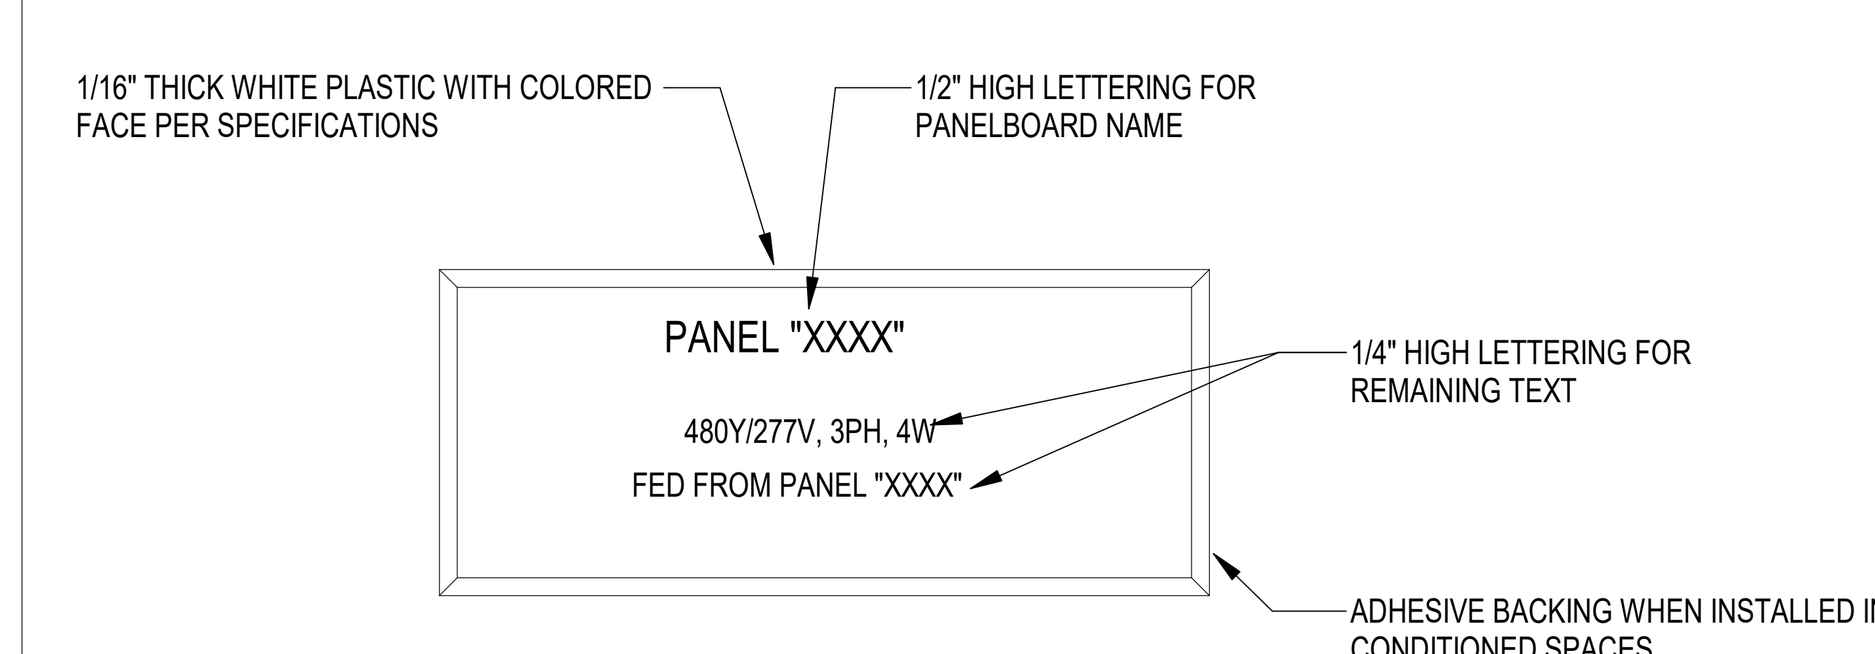

TYPICAL 480Y/277V PANELBOARD

6 PANELBOARD NAMEPLATE
N.T.S.

Revisions: | Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP



Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ELECTRICAL DETAILS

Approved:

Phase: 100% CONTRACT DOCUMENTS FOR BIDDING

FULLY SPRINKLERED

Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259

Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106

Issue Date: 06 MARCH 2026 | Checked: TDB | Drawn: WWS

Project Number: 657-23-104JC

Building Number:

Drawing Number: E-501

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

3/6/2026 1:04:30 PM

DETAIL BELOW IS BASED OFF MANUFACTURER GENERIC DRAWINGS.
DETAIL TO BE UPDATED ONCE SITE SPECIFIC DRAWINGS ARE RECEIVED.

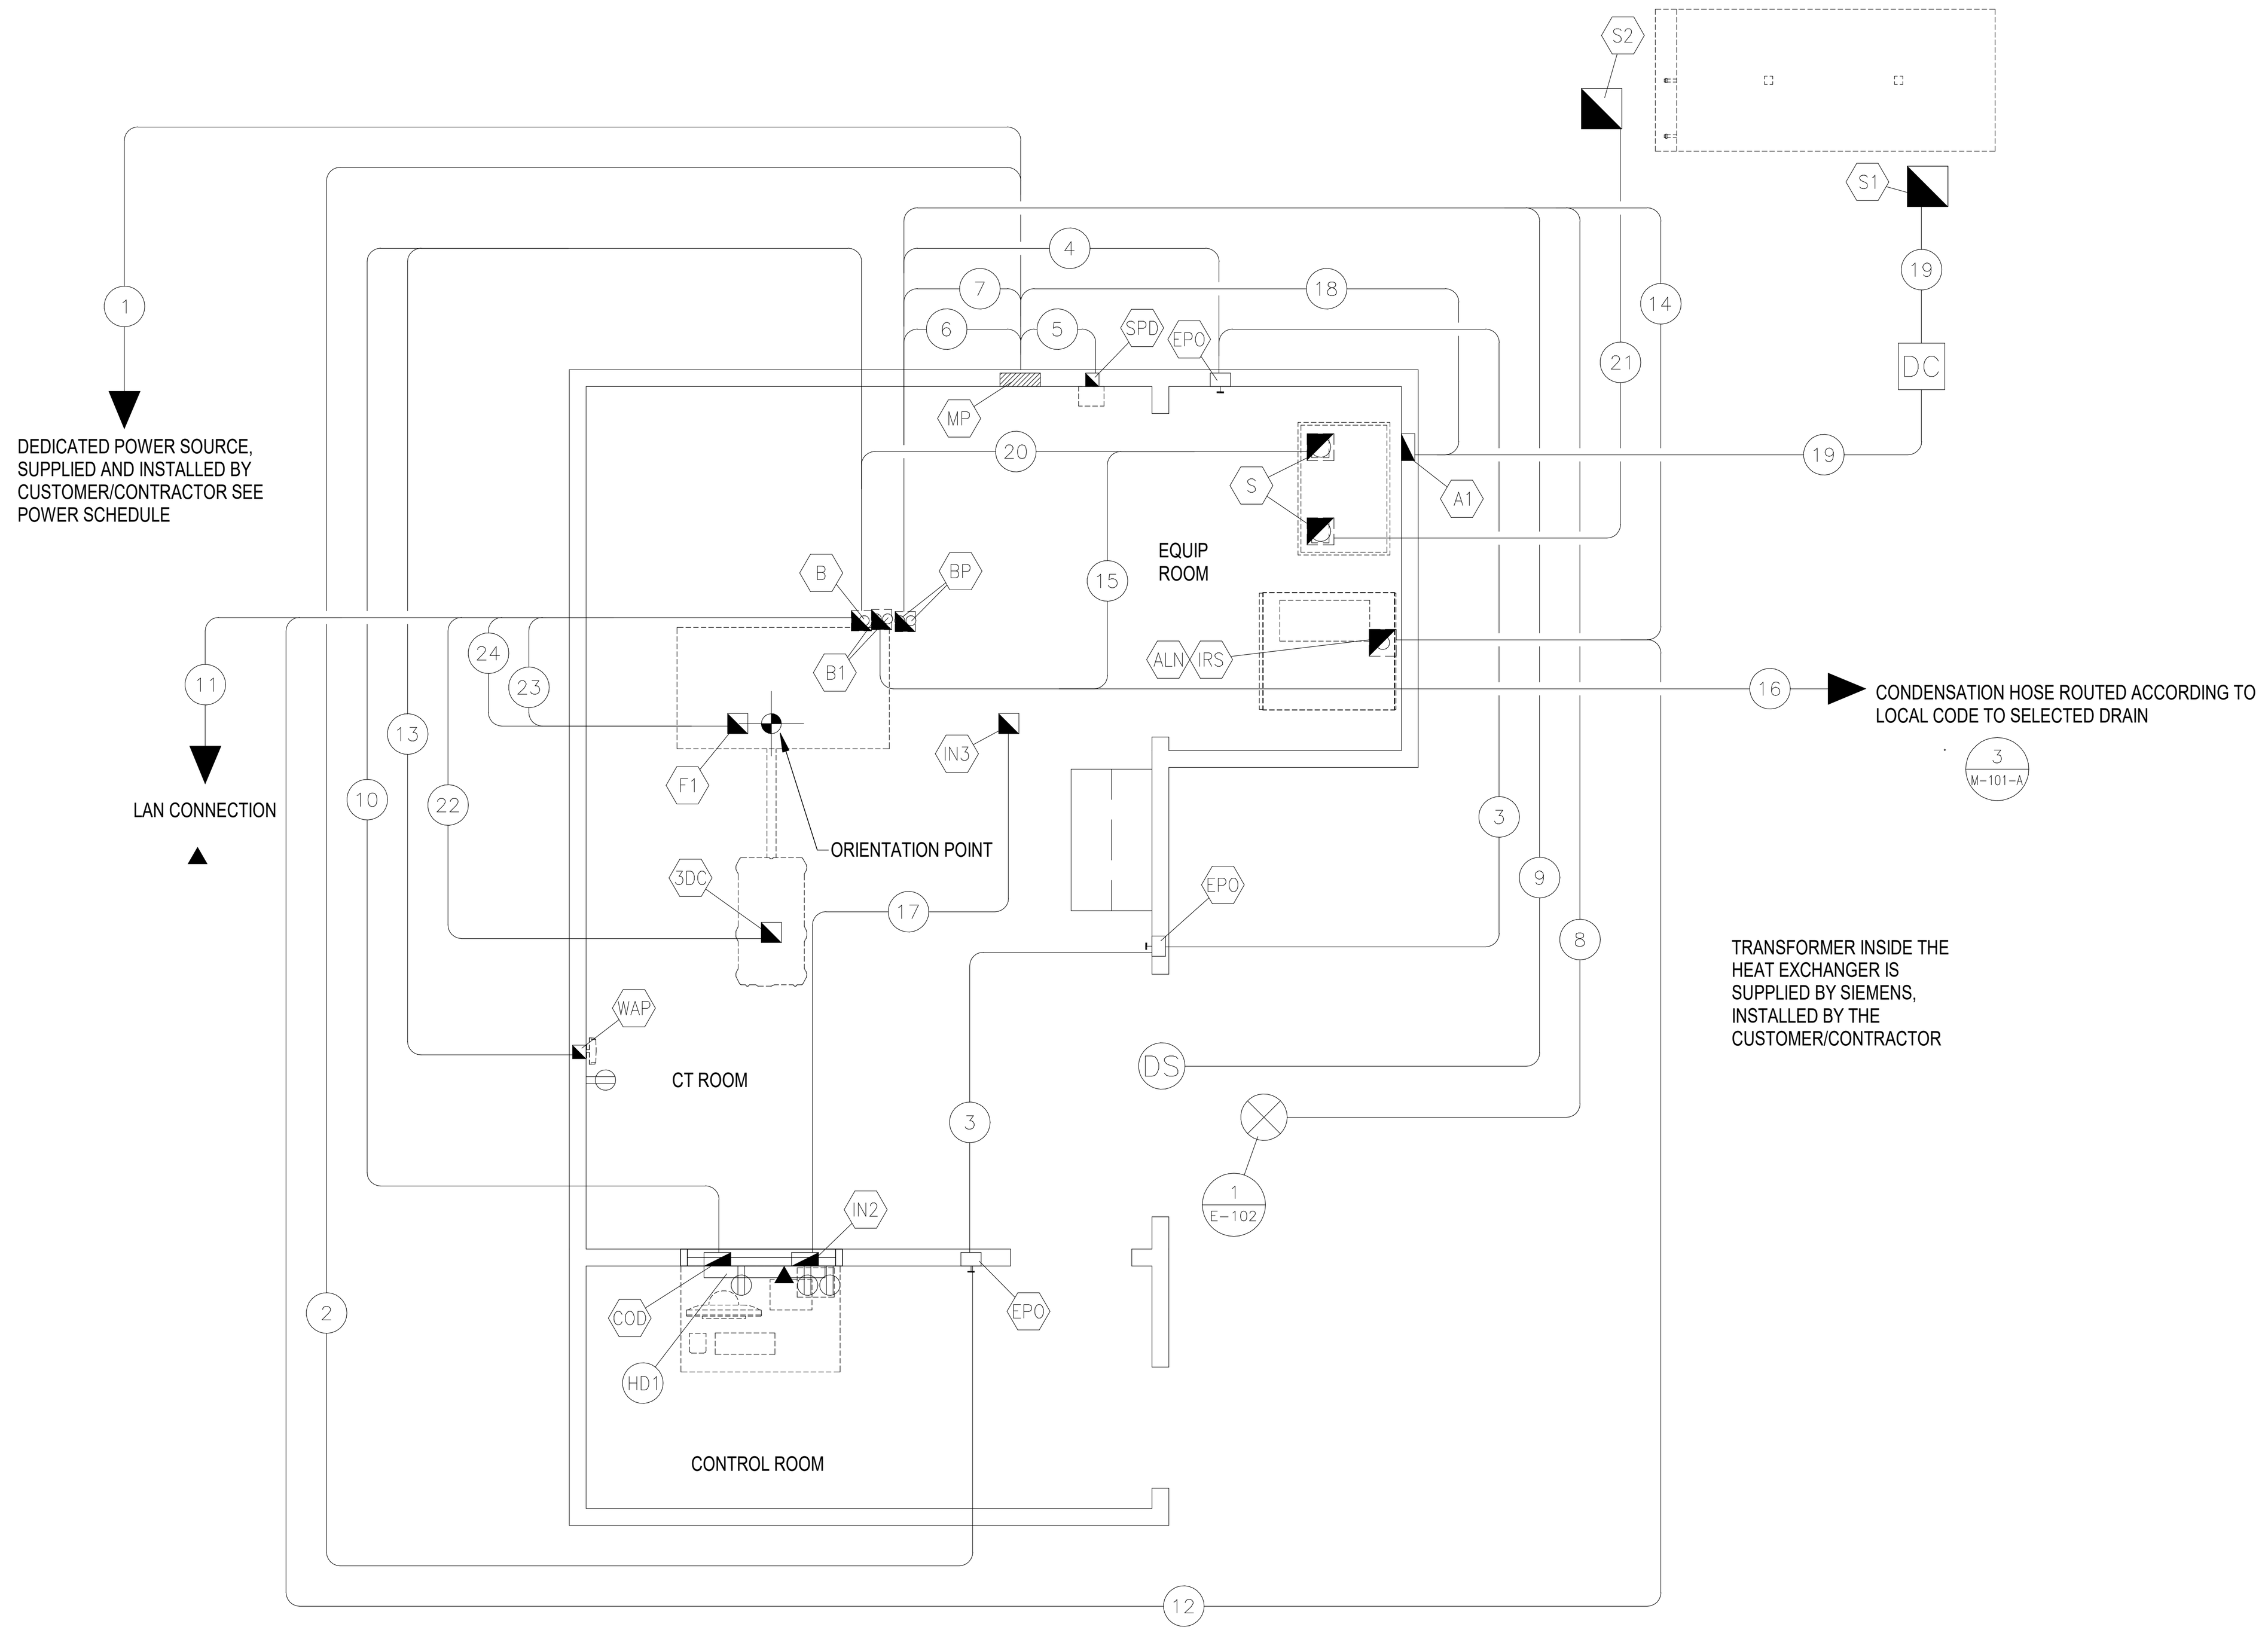

1 CT DETAIL
N.T.S.

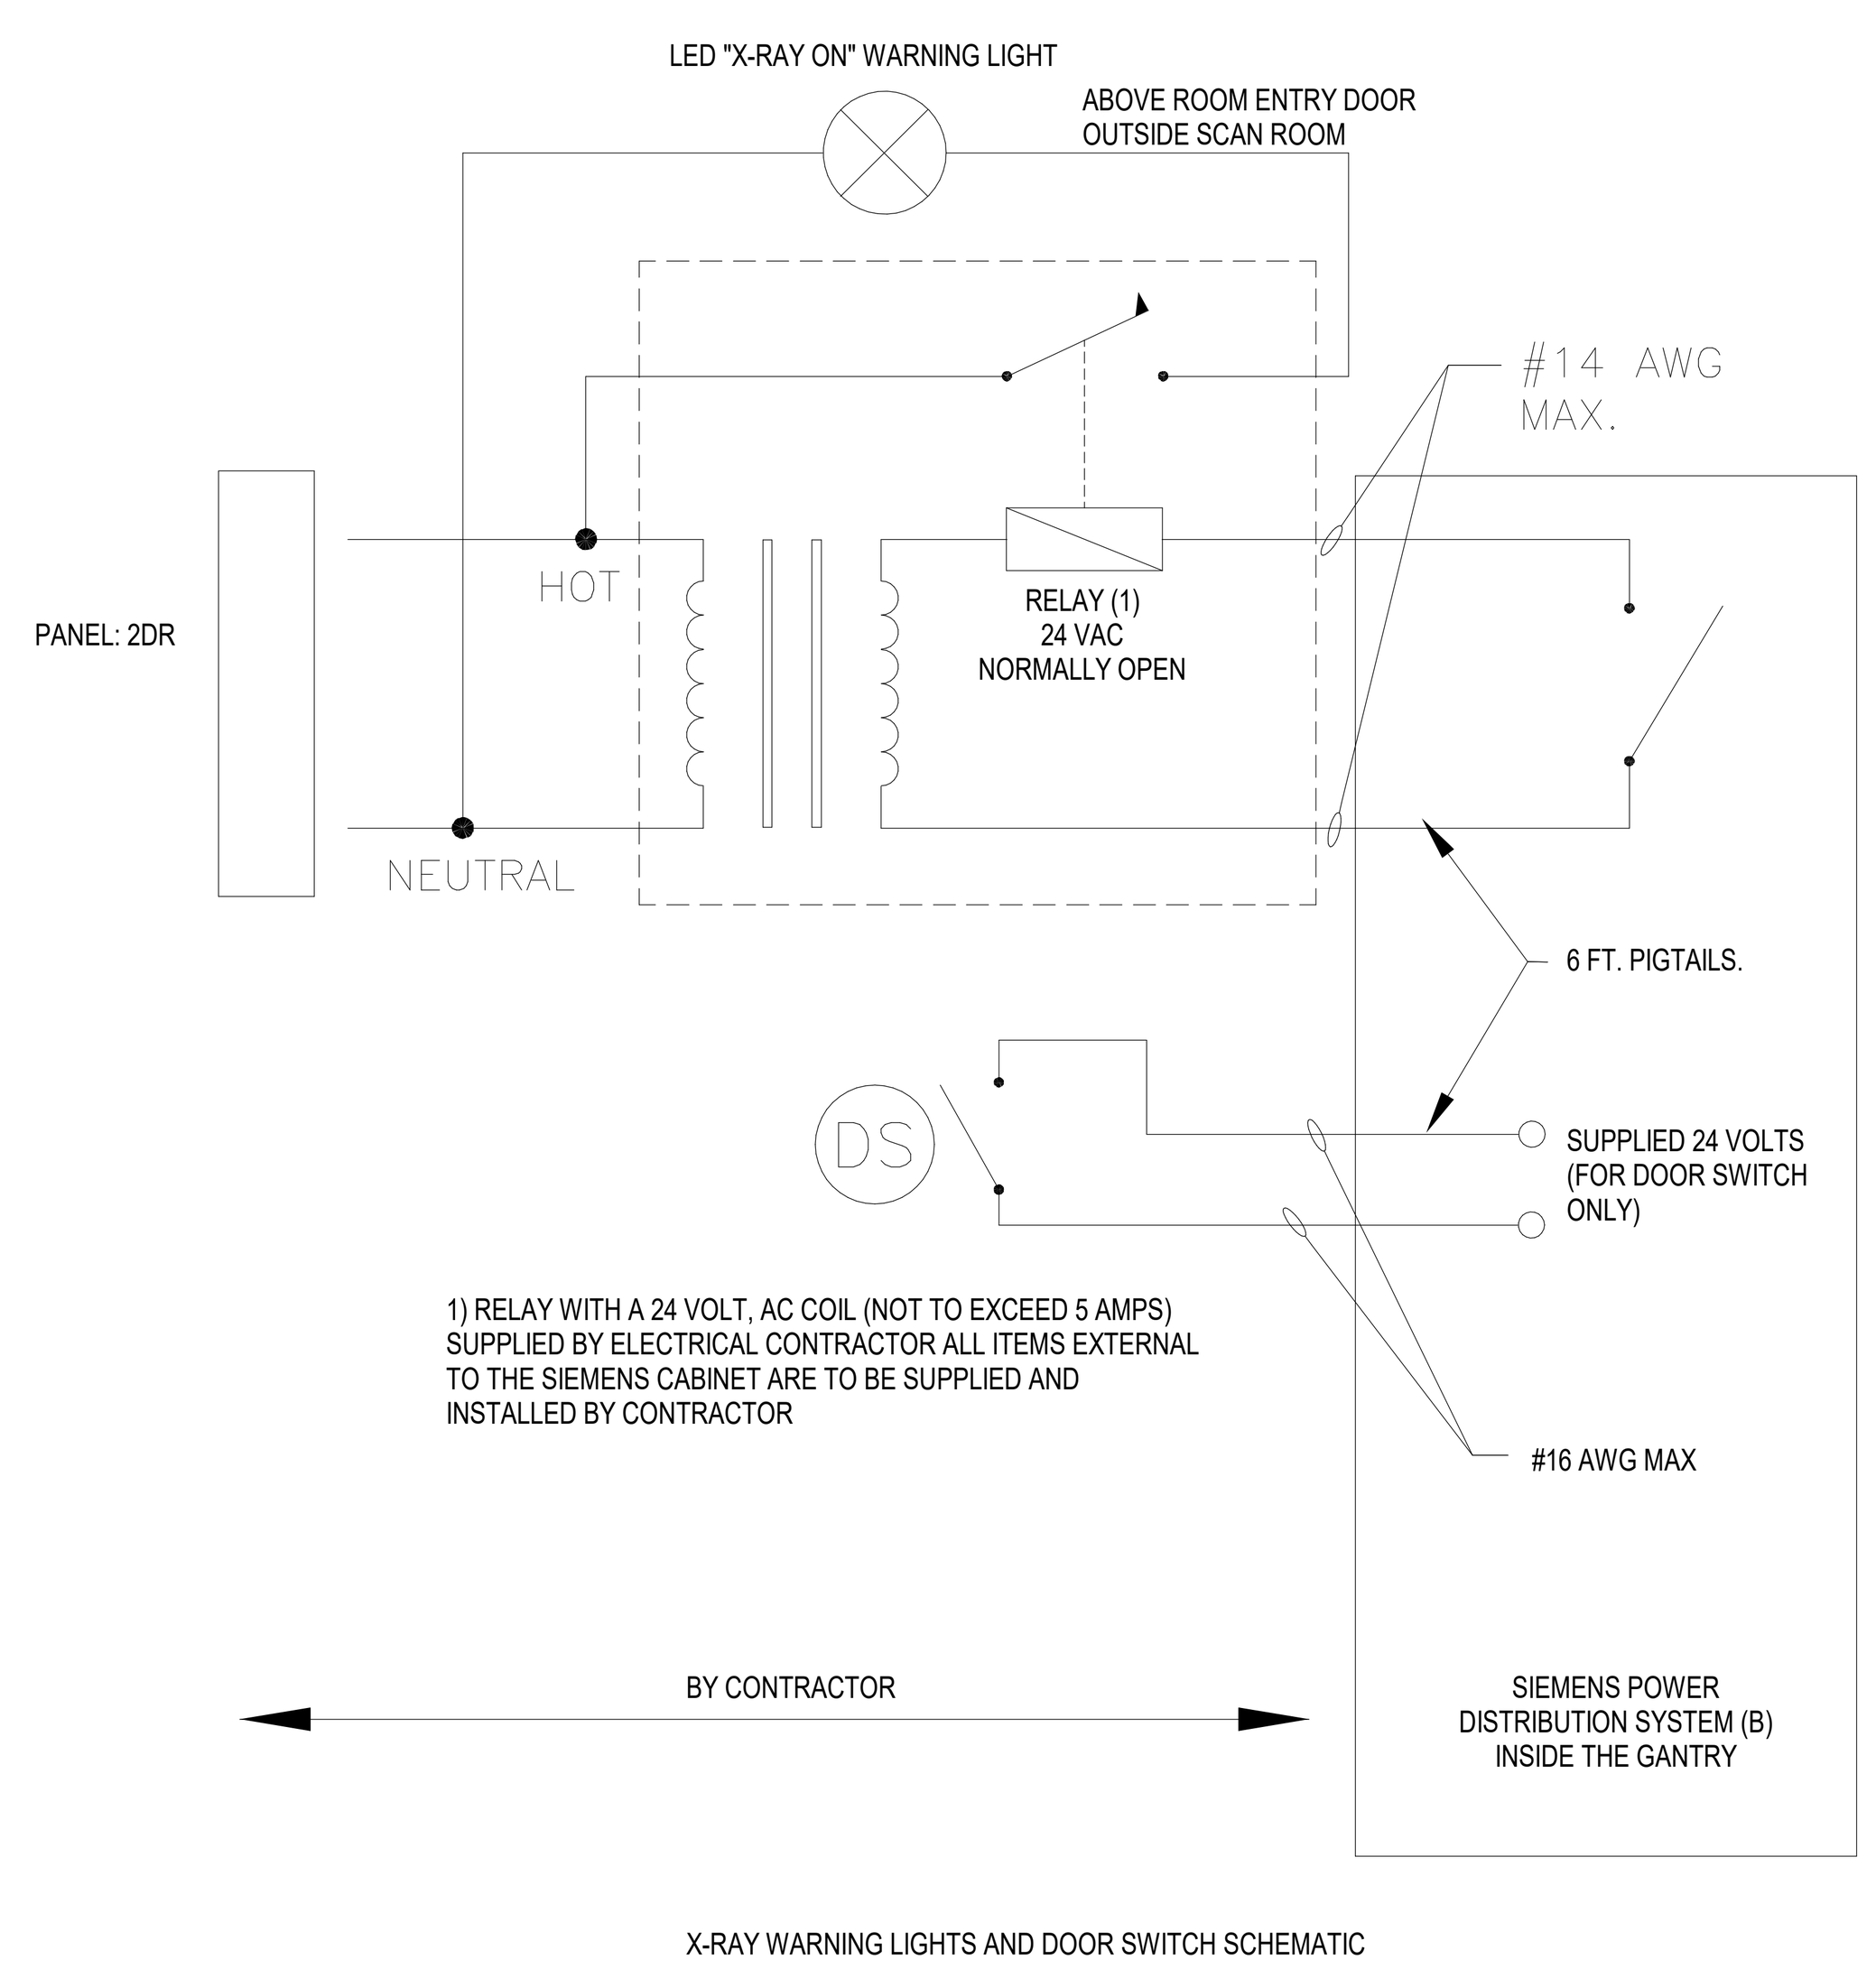

2 CT AUXILIARY WIRING
N.T.S.

ELECTRICAL LEGEND

SYM	CONDUIT SIZE	DESCRIPTION	REMARKS
A1	3/4"	PULL BOX MOUNTED FLUSH WITH FINISHED WALL AT FLOOR LINE IN SHOWN LOCATION.	
ALN	3/4"	PULL BOX MOUNTED BELOW FLOOR SLAB WITH A 4" CONDUIT RUNNING THROUGH THE FLOOR SLAB ENDING FLUSH WITH THE FINISHED FLOOR IN SHOWN LOCATION.	UNINTERRUPTIBLE POWER SUPPLY
B	3/4"	PULL BOX MOUNTED BELOW FLOOR SLAB WITH A 3" CONDUIT RUNNING THROUGH THE FLOOR SLAB ENDING FLUSH WITH THE FINISHED FLOOR IN SHOWN LOCATION.	GANTRY CABLE ACCESS
B1	3/4"	PULL BOX MOUNTED BELOW FLOOR SLAB WITH TWO 3" CONDUIT RUNNING THROUGH THE FLOOR SLAB ENDING FLUSH WITH THE FINISHED FLOOR IN SHOWN LOCATION.	GANTRY HOSE ACCESS
BP	3/4"	PULL BOX MOUNTED BELOW FLOOR SLAB WITH TWO 3" CONDUIT RUNNING THROUGH THE FLOOR SLAB ENDING FLUSH WITH THE FINISHED FLOOR IN SHOWN LOCATION.	GANTRY POWER CABLE ACCESS
COD	3/4"	PULL BOX MOUNTED FLUSH WITH FINISHED WALL AT THE FLOOR LINE IN CONTROL AREA IN SHOWN LOCATION PROVIDED WITH 3" OPENING IN FINISHED COVER.	
DC		DISCONNECT SWITCH MOUNTED NEAR OUTDOOR UNIT TO DISCONNECT POWER SUPPLY FROM INDOOR UNIT. SUPPLIED BY SIEMENS, INSTALLED BY COSTUMER/CONTRACTOR IN ACCORDANCE WITH LOCAL CODES.	OUTDOOR UNIT-WATER/AIR SPLIT
EPO	3/4"	EMERGENCY POWER OFF BUTTON. EXACT LOCATIONS TO BE DETERMINED BY CONTRACTOR.	SEE POWER SCHEDULE
F1	3/4"	PULL BOX MOUNTED ABOVE FINISHED CEILING.	CARE VISION MONITOR CEILING MOUNT
IN2	3/4"	PULL BOX MOUNTED FLUSH WITH FINISHED WALL AT FLOORLINE. THERE SHOULD ALSO BE AN ETHERNET CONNECTION AND (2) OUTLETS LOCATED NEAR THE PULL BOX TO SUPPLY 110/220 VAC.	INJECTOR ELECTRONICS
IN3	3/4"	PULL BOX MOUNTED ABOVE FINISHED CEILING IN SHOWN LOCATION.	CEILING MOUNTED INJECTOR
IRS	3/4"	FIXED POINT DESIGNATION, SAME PULL BOX/OPENING AS ALN.	
MP	3-PHASE	MAIN PANEL WITH MAIN BREAKER. EXACT LOCATION DETERMINED BY CONTRACTOR.	SEE POWER SCHEDULE
S	3/4"	TWO PULL BOXES MOUNTED BELOW FLOOR SLAB WITH TWO 5" CONDUITS RUNNING THROUGH THE FLOOR SLAB ENDING FLUSH THE FINISHED FLOOR.	HEAT EXCHANGER CABINET - WATER/AIR SPLIT
S1	3/4"	PULL BOX THAT IS PROVIDED ON THE OUTDOOR COOLING UNIT.	OUTDOOR COOLING UNIT -WATER/AIR SPLIT
S2	3/4"	PULL BOX MOUNTED ADJACENT TO OUTDOOR COOLING UNIT PROVIDED THE FLEX-TITE CONDUIT FROM PULL BOX TO WATER HOSE CONNECTIONS ON OUTDOOR COOLING UNIT.	OUTDOOR COOLING UNIT -WATER/AIR SPLIT
SPD	3/4"	PULL BOX MOUNTED FLUSH WITH FINISHED WALL PROVIDED WITH 2" OPENING IN FINISHED COVER. THE SURGE PROTECTIVE DEVICE MUST BE LOCATED WITHIN 3 FEET CABLE RUN FROM CIRCUIT BREAKER, AT HEIGHT DETERMINED BY CONTRACTOR.	SEE DETAIL S - 101
WAP	8" X 8" X 4"	PULL BOX MOUNTED FLUSH WITH FINISHED WALL AT WIRELESS ACCESS POINT LOCATION AND 110 VOLT DUPLEX OUTLET. HEIGHT OFF FF: > 6'-6 3/4"	WIRELESS ACCESS POINT
3DC	3/4"	PULL BOX MOUNTED ABOVE FINISHED CEILING TO COORDINATE WITH THE LOCATION OF THE 3D CAMERA.	3D CAMERA
HD1	10" X 3 1/2"	ELECTRICAL DUCT RUN HORIZONTALLY ON THE WALL AT THE FLOOR LINE AND SURFACE MOUNTED ON FINISHED WALL AS SHOWN FOR EXCESS CABLE STORAGE. LENGTH 3'-0".	RACEWAY
1	2 1/2"	CONDUIT FROM POWER SOURCE TO "MP"	SEE POWER SCHEDULE
2	3/4"	CONDUIT FROM "MP" TO "EPO"	SEE POWER SCHEDULE
3	3/4"	CONDUIT FROM "EPO" TO "EPO"	SEE POWER SCHEDULE
4	3/4"	CONDUIT FROM "EPO" TO "BP"	SEE POWER SCHEDULE
5	3/4"	CONDUIT FROM "MP" TO "SPD"	SEE POWER SCHEDULE
6	2"	CONDUIT FROM "MP" TO "BP"	
7	2"	CONDUIT FROM "MP" TO "BP"	
8	3/4"	CONDUIT "BP" TO "WARNING LIGHT."	
9	3/4"	CONDUIT "BP" TO "DS."	
10	3"	CONDUIT "B" TO "COD."	MAX. CONDUIT LENGTH 82'-0"
11	1"	CONDUIT (IF NEEDED	MAX. CONDUIT LENGTH 82'-0"
12	3"	CONDUIT "B" TO "IRS."	MAX. CONDUIT LENGTH 82'-0"
13	1"	CONDUIT "B" TO "WAP."	MAX. CONDUIT LENGTH 82'-0"
14	3"	CONDUIT "B" TO "ALN."	MAX. CONDUIT LENGTH 82'-0"
15	(2) 3"	CONDUITS, IF REQUIRED PER LOCAL CODE, FROM "S" TO "B1". TO CONTAIN SIEMENS COOLING WATER HOSES WITH A MINIMUM 6" BENDING RADIUS.	MAX. CONDUIT LENGTH 90'-0" SEE SHEET M-101
16	1"	CONDUIT, IF REQUIRED PER LOCAL CODE, FOR CONDENSATION HOSE FROM "B1" TO SELECTED DRAIN TYPE. THE MINIMUM BENDING RADIUS IS 1 3/16".	MAX. CONDUIT LENGTH 32'-9"
17	2-1/2"	CONDUIT FROM "IN2" TO "IN3"	MAX. CONDUIT LENGTH 75'
18	2-1/2"	CONDUIT FROM "B" TO "F1."	MAX. CONDUIT LENGTH 104'
19	2-1/2"	CONDUIT FROM "B" TO "F1."	MAX. CONDUIT LENGTH 68'
18	3/4"	CONDUIT FROM "MP" TO "A1" (S),	SEE POWER SCHEDULE
19	1-1/2"	CONDUIT "A1" ("S) TO "DC" AND "DC" TO "S1".	MAX. CONDUIT LENGTH 131'
20	1-1/2"	CONDUIT "S" TO "B."	MAX. CONDUIT LENGTH 92'
21	(2) 3"	CONDUIT IF REQUIRED BY LOCAL CODE	MAX. CONDUIT LENGTH 131'
22	2-1/2"	CONDUIT "B" TO "3DC."	MAX. CONDUIT LENGTH 88'
23	2-1/2"	CONDUIT "B" TO "F1."	MAX. CONDUIT LENGTH 98'
24	2-1/2"	CONDUIT "B" TO "F1."	MAX. CONDUIT LENGTH 62'

ELECTRICAL NOTES

1. COMPLIANCE: ELECTRICAL WORK SHALL BE IN COMPLIANCE WITH THE NATIONAL ELECTRICAL CODE (NFPA-70), O.S.H.A. REGULATIONS, AS WELL AS APPLICABLE REGULATIONS OF CITY, COUNTY, STATE AND FEDERAL AGENCIES. PROVIDE MATERIALS AND EQUIPMENT THAT COMPLY WITH ANSI, IEEE AND NEMA STANDARDS AND ARE U.L LISTED AND LABELED. THE CUSTOMER'S/CONTRACTOR'S WORK AND ALL EQUIPMENT INSTALLED SHALL COMPLY WITH THE CURRENT EDITION OF THE NATIONAL ELECTRICAL CODE ADOPTED/ENFORCED BY THE AUTHORITY HAVING JURISDICTION. QUALITY ASSURANCE: THE CONTRACTOR SHALL VERIFY EXISTING CONDITIONS IN THE FIELD TO INSURE THAT THE NEW WORK WILL FIT INTO THE EXISTING STRUCTURE AS SHOWN ON THE DRAWINGS. SHOULD ANY CONDITIONS EXIST OR BE DISCOVERED THAT PREVENT THE INSTALLATION OF
2. WORK AS SHOWN, THE CONTRACTOR SHALL NOTIFY THE OWNER'S REPRESENTATIVE PRIOR TO FABRICATION OF EQUIPMENT, OR THE PERFORMANCE OF ANY WORK THAT MAY BE AFFECTED. DO NOT ALTER DRAWINGS, DIMENSIONS, OR SPECIFICATIONS IN ANY WAY WITHOUT CONTACTING AND RECEIVING WRITTEN CONFIRMATION FROM SIEMENS PROJECT MANAGER. ALL DIMENSIONS ARE FROM FINISHED SURFACES. CONDUIT AND PULL BOXES TO BE INSTALLED BY THE CUSTOMER/CONTRACTOR WITH LOCATIONS BEING FIELD VERIFIED BY THE SIEMENS PROJECT MANAGER.
3. POWER SUPPLY SOURCE: POWER SUPPLIES FOR SIEMENS HEALTHCARE EQUIPMENT SHALL BE FROM A MEDICAL IMAGING PANEL OR BUILDING SERVICE EQUIPMENT THAT IS A GROUNDED 3 OR 4-WIRE 'WYE' SOURCE PER THE SPECIFIC EQUIPMENT OPERATION REQUIREMENTS. A DEDICATED CIRCUIT SHALL BE PROVIDED THAT IS KEPT ENTIRELY FREE AND INDEPENDENT OF ALL OTHER BUILDING WIRING. NO ELEVATORS, GENERATORS, PUMPS, HVAC OR SIMILAR EQUIPMENT SHALL BE CONNECTED TO THE SAME CIRCUIT OR MEDICAL IMAGING PANEL THAT SERVES THE SIEMENS HEALTHCARE EQUIPMENT. IF THE POWER SUPPLY SOURCE DOES NOT MEET THE SPECIFIC SIEMENS EQUIPMENT POWER REQUIREMENTS, THE CONTRACTOR SHALL PROVIDE THE NECESSARY EQUIPMENT REQUIRED TO ESTABLISH THE POWER SUPPLY IN ACCORDANCE WITH THE REQUIRED POWER SUPPLY PARAMETERS OF THE SIEMENS EQUIPMENT. THE CONTRACTOR SHALL COORDINATE THIS WORK WITH THE CUSTOMER AND/OR UTILITY COMPANY FIELD REPRESENTATIVE.
4. WORK FURNISHED BY CONTRACTOR: WORK NOT PROVIDED BY SIEMENS HEALTHCARE BUT SHOWN ON DRAWINGS TO BE FURNISHED AND INSTALLED BY 8CONTRACTOR INCLUDES, BUT IS NOT LIMITED TO, THE FOLLOWING, UNLESS NOTED OTHERWISE: ELECTRICAL RACEWAYS AND DUCTS, WIRING TROUGHS, PULL BOXES, CONDUITS, CIRCUIT BREAKERS, ACCESS PANELS, EMERGENCY OFF BUTTONS, DOOR SWITCHES, WARNING LIGHTS, WIRING, WIRING DEVICES, CONNECTORS, LIGHTING EQUIPMENT AND GROUNDING.
5. RACEWAY AND CONDUIT NOTES: ALL CONDUITS SHALL BE INSTALLED IN COMPLIANCE WITH THE CURRENT ENFORCED EDITION OF THE NATIONAL ELECTRICAL CODE. CONDUIT BODIES SHALL NOT BE USED. WHERE A CONDUIT ENTERS A BOX, FITTING, OR OTHER ENCLOSURE, AN INSULATED THROAT CONNECTOR SHALL BE PROVIDED TO PROTECT THE WIRE FROM ABRASION. ALL CONNECTORS FOR EMT SHALL BE COMPRESSION OR DOUBLE SET SCREW TYPE.
6. KEEP RACEWAYS AT LEAST 6 INCHES AWAY FROM PARALLEL RUNS OF FLUES OR STEAM AND HOT WATER PIPES. INSTALL RACEWAY RUNS ABOVE WATER AND STEAM PIPES PROVIDED THAT CABLE RUN DISTANCES ARE MAINTAINED. USE TEMPORARY CLOSURES TO PREVENT FOREIGN MATTER FROM ENTERING RACEWAY.
7. CONDUIT RUNS ARE SHOWN SCHEMATICALLY. INSTALL CONDUIT WITH A MINIMUM OF BENDS IN THE SHORTEST PRACTICAL DISTANCE CONSIDERING THE BUILDING CONSTRUCTION AND OBSTRUCTIONS, EXCEPT AS OTHERWISE INDICATED. THE CONTRACTOR SHALL MAKE CERTAIN THAT ANY CONDUIT/RACEWAY RUNS CONTAINING SIEMENS HEALTHCARE CABLES DO NOT EXCEED THE SPECIFIED MAXIMUM DISTANCES AS SHOWN ON THE ELECTRICAL DETAILS. LISTED CONDUIT SIZES FOR SIEMENS-SUPPLIED CABLES MUST BE MAINTAINED IN ORDER TO ENABLE THE TOTAL CABLE BUNDLE INCLUDING CONNECTORS TO BE PULLED THROUGH WITHOUT DAMAGE.
8. PROVIDE ENCLOSED METAL WIRE DUCT RACEWAY SYSTEM WHERE SHOWN ON DRAWINGS WITH DIVIDERS TO SEPARATE THE DUCT INTO TWO OR THREE SEPARATE COMPARTMENTS AS SHOWN ON THE SIEMENS PLANS (FOR POWER AND SIEMENS HEALTHCARE CABLING). DIVIDERS AND CROSSOVER PIECES TO BE PROVIDED AS NECESSARY. THE CABLE TO CABLE AS WELL AS THE CIRCUIT TO CIRCUIT SEPARATION REQUIREMENT WAS EVALUATED DURING THE UL SYSTEM CERTIFICATION OF THE EQUIPMENT. ADDITIONAL SEPARATION OF THE SYSTEM CABLE ASSEMBLIES INTO SEPARATE OR PARTITIONED RACEWAYS, UNLESS OTHERWISE NOTED, IS NOT NECESSARY TO INSURE SEPARATION OF CIRCUITS.
9. PROVIDE WIRE DUCT/RACEWAY WITH ACCESSIBLE REMOVABLE COVERS. LOCATIONS OF BUILDING MATERIAL OPENINGS (I.E. ACCESS PANELS) TO BE CUT IN FIELD ARE TO BE COORDINATED WITH THE DRAWING REQUIREMENTS AND BUILDING STRUCTURE. THOSE THAT ARE NOT INDICATED OR INTERFERE WITH BUILDING ELEMENTS SHALL BE COORDINATED WITH SIEMENS PROJECT MANAGER. ELECTRICAL PULL BOXES AND RACEWAY COVERS SHALL BE INSTALLED IN A MANNER TO ALLOW ACCESSIBILITY FOR INSTALLATION AND MAINTENANCE. CONTRACTORS MUST PROVIDE PULL STRINGS FOR ALL CONDUIT AND WIRE DUCT/RACEWAY. IN-FLOOR TRENCH DUCT AND FLUSH FLOOR BOXES SHALL BE PROVIDED WITH FULLY GASKETED REMOVABLE COVERS. WHEN JUNCTION
10. BOXES AND WIRE DUCT/RACEWAY ARE MOUNTED HIGHER THAN 14 FEET ABOVE FINISHED FLOOR, THE ELECTRICAL CONTRACTOR SHALL PROVIDE TWO ELECTRICIANS
11. TO HELP THE SIEMENS INSTALLERS PULL SIEMENS CABLES AT CUSTOMER'S EXPENSE. WHEN JUNCTION BOXES AND WIRE DUCT/RACEWAY ARE MOUNTED ABOVE A HARD CEILING (I.E. SHEET ROCK), A 24" x 24" ACCESS PANEL IS REQUIRED AT EACH JUNCTION
12. BOX AND WITHIN 2 FEET OF EACH RACEWAY TRANSITION (SUCH AS A 90 DEGREE ELBOW OR TEE) IN DUCT/RACEWAY. THERE MUST BE FREE AND CLEAR ACCESS TO JUNCTION BOXES AND WIRE DUCT/RACEWAY. WHEN ACCESS PANELS ARE LOCATED MORE THAN 3 FEET FROM JUNCTION BOXES AND WIRE DUCT/RACEWAY THE ELECTRICAL CONTRACTOR SHALL PROVIDE TWO ELECTRICIANS TO HELP SIEMENS INSTALLERS PULL SIEMENS SUPPLIED CABLES AT CUSTOMER'S EXPENSE.
13. WIRING: ALL WIRING INSTALLED SHALL BE 600 VOLT CLASS, STRANDED TYPE THHN/THWN-2, SINGLE CONDUCTOR ANNEALED COPPER FOR A MAXIMUM OPERATING TEMPERATURE OF 90° C (194' F), SIZED AS INDICATED, INSTALLED IN METAL RACEWAYS. THE CUSTOMER/CONTRACTOR SHALL LEAVE A MINIMUM 10 FEET OF WIRE TAILS AT ALL OUTLET POINTS WITH WIRE IDENTIFICATION TAGGED AT BOTH ENDS FOR FINAL CONNECTION BY THE CUSTOMER/ELECTRICAL CONTRACTOR.
14. SHORT CIRCUIT REQUIREMENTS: ALL CIRCUIT BREAKERS SUPPLIED FOR THE SIEMENS EQUIPMENT REQUIREMENTS SHALL BE RATED HIGHER THAN THE SHORT CIRCUIT AVAILABLE AT THE TERMINALS OF THE ELECTRICAL EQUIPMENT AS DETERMINED BY THE ENGINEER OF RECORD, BUT NOT LESS THAN 35.000A RMS SYMMETRICAL AT 480V, 3-PHASE, 60 HERTZ. THE CONTRACTOR SHALL OBTAIN THE CORRECT SHORT CIRCUIT CURRENT RATING OF ALL THE NEW EQUIPMENT FOR INSTALLATION FROM THE ENGINEER OF RECORD.

POWER SCHEDULE

ALL CONDUITS AND WIRES SIZES MUST BE DETERMINED BY THE ELECTRICAL ENGINEER OF RECORD PER N.E.C AND TO MAINTAIN SIEMENS IMPEDANCE REQUIREMENTS.

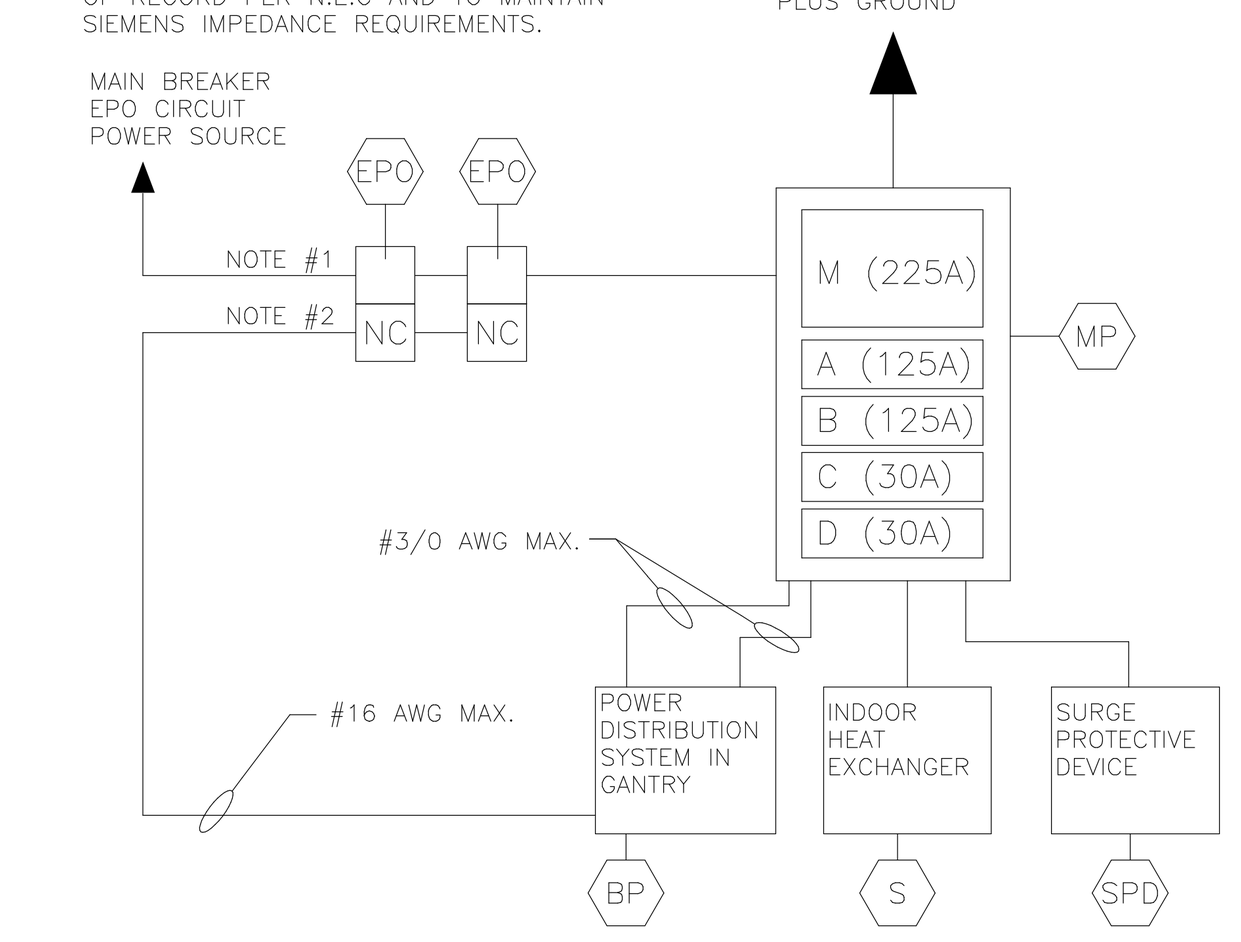

ITEM	QTY	DESCRIPTION				
MP	1	MAIN PANEL WITH CIRCUIT BREAKERS FLUSH OR SURFACE MOUNTED.				
M	1	MAIN BREAKER MUST HAVE TRIPPING DEVICE SO WHEN ANY EPO IS PRESSED THE BREAKER TRIPS.				
		MAIN BREAKER AMPS: 225				
		VOLTS	PHASES	NEUTRAL	GROUND	TOTAL WIRES
		480Y/277	3	1	1	5
A B	1 1	BREAKER AMPS: 125 (FOR GANTRY "BP")				
		VOLTS	PHASES	NEUTRAL	GROUND	TOTAL WIRES
		480Y	3	0	1	4
C	1	BREAKER AMPS: 30 (FOR INDOOR HEAT EXCHANGER "S")				
		VOLTS	PHASES	NEUTRAL	GROUND	TOTAL WIRES
		480Y	3	0	1	4
D	1	BREAKER AMPS: 30 (FOR SURGE PROTECTIVE DEVICE "SPD") (THIS BREAKER WILL NOT BE NEEDED IF THE SURGE PROTECTIVE DEVICE IS NOT PURCHASED)				
		VOLTS	PHASES	NEUTRAL	GROUND	TOTAL WIRES
		480Y/277	3	1	1	5
EPO	VARIES	NOTE 1 - EPO CIRCUIT #1 MAIN CIRCUIT BREAKER EMERGENCY POWER OFF BUTTON WITH PROTECTIVE COVER THAT PREVENTS ACCIDENTAL ACTIVATION. THE EPO MUST BE OF FAIL-SAFE DESIGN. ALL EPO'S TO HAVE MECHANICAL LATCHING MECHANISM. EPO MUST BE RESET BEFORE MAIN BREAKER CAN RESUME OPERATION. CONTACTS AND WIRING CONFIGURATION TO BE DESIGNED BY ELECTRICAL ENGINEER OF RECORD NOTE 2 - EPO CIRCUIT #2 EPO CONTACTS TO BE NORMALLY CLOSED. WIRED IN SERIES, CONNECTED TO CT (B) UPS ONLY. THE EPOs MUST BE INSTALLED BY A QUALIFIED ELECTRICAL CONTRACTOR ACCORDING TO NATIONAL ELECTRICAL CODE, STATE AND LOCAL REGULATIONS. MEASURES SHOULD BE TAKEN TO DESIGN THE CIRCUIT IN SUCH A WAY THAT IT WILL ALWAYS WORK WHEN THE MEDICAL EQUIPMENT IS POWERED. THE CUSTOMER IS SOLELY RESPONSIBLE FOR THE IMPLEMENTATION OF THE EPOs AND THEIR ASSOCIATED CIRCUITS AND MUST MAKE THE FINAL DETERMINATION CONSIDERING ALL SITE CONDITIONS AND REGULATORY FACTORS.				

UNLESS OTHERWISE NOTED, ALL ITEMS LISTED IN THIS SCHEDULE SHALL BE SUPPLIED AND INSTALLED BY CUSTOMER/CONTRACTOR.

CONTRACTOR SUPPLIED CABLES

FROM	VIA	TO	DESCRIPTION	REMARKS
POWER SOURCE	1	MP	3 PHASE 5-WIRE 2/0 AWG CONDUCTOR	SEE POWER SCHEDULE
MP	2	EPO	3 PHASE 5-WIRE 16 AWG CONDUCTOR	SEE POWER SCHEDULE
EPO	3	EPO	3 PHASE 5-WIRE 16 AWG CONDUCTOR	SEE POWER SCHEDULE
EPO	4	BP	3 PHASE 5-WIRE 16 AWG CONDUCTOR	SEE POWER SCHEDULE
MP	5	SPD	3 PHASE 5-WIRE 14 AWG CONDUCTOR	SEE POWER SCHEDULE
MP	6	BP	3 PHASE 5-WIRE 3 AWG CONDUCTOR	SEE POWER SCHEDULE
MP	7	BP	3 PHASE 5-WIRE 3 AWG CONDUCTOR	SEE POWER SCHEDULE
BP	8	WARNING LIGHT	3 PHASE 5-WIRE 12 AWG CONDUCTOR	
BP	9	DS	3 PHASE 5-WIRE 12 AWG CONDUCTOR	
MP	18,A1	S	3 PHASE 5-WIRE 14 AWG CONDUCTOR	SEE POWER SCHEDULE

INFORMATION ON THIS SHEET BASED OFF MANUFACTURER GENERIC DRAWINGS. DETAIL TO BE UPDATED ONCE SITE SPECIFIC DRAWINGS ARE RECEIVED.

Revisions: Date:

CONSULTANT
Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD
THINKFORM
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP
COMMONWEALTH OF PENNSYLVANIA REGISTERED PROFESSIONAL THOMAS D. BLISS ENGINEER PE077256

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: ELECTRICAL CT DETAILS
Approved:
Phase: 100% CONTRACT DOCUMENTS FOR BIDDING
FULLY SPRINKLERED
Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date: 06 MARCH 2026
Checked: TDB
Drawn: WWS
Project Number: 657-23-104JC
Building Number:
Drawing Number: E-502

3/6/2026 1:04:31 PM
Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt
VA FORM 08 - 6231

DRAWING NOTES:

1. NEW EQUIPMENT AND FEEDER SIZES ARE BASED OFF SIEMENS GENERIC CT DRAWINGS. FINAL SIZES SHALL BE CONFIRMED WITH FINAL SITE SPECIFIC DRAWINGS.

CODED NOTES:

1. BREAKER TRIP SETTING NOT VISIBLE DURING SITE INVESTIGATION
2. PROVIDE NEW BREAKER IN EXISTING SPACE WITH PROVISIONS FOR EATON DEVICE TYPE.
3. PROVIDE PANEL WITH INTEGRAL SURGE PROTECTION DEVICE.

LIGHTING FIXTURE SCHEDULE

TYPE	DESCRIPTION	MANUFACTURER	MODEL	VOLTAGE	VA	LAMP TYPE	FIXTURE LUMENS	FIXTURE COLOR TEMP (K)	DRIVER/BALLAST	COMMENTS
A	48" X 48" SKYCEILING	SKY FACTORY	EP44-RVN	120 V	92 VA	LED	N/A	N/A	SKYFACTORY HLG	
D1	6" ROUND DOWNLIGHT	GOTHAM ARCHITECTURAL LIGHTING	EVO6-15-AR-LSS-MD-MVOLT-GZ1	120 V	15 VA	LED	1500	3500K	0-10V DIMMING	
F2	2'x2, FLUSH FIT, FLAT PANEL LED	LITHONIA	2GTL-2-40L-ADP-GZ1-3500K	120 V	34 VA	LED	4000	3500K	0-10V DIMMING	
T1	TRACK LIGHTING FIXTURE	JUNO	T286L 35K 90CRI PDIM NFL WH	120 V	42 VA	50W, MR16	3500	3500K	N/A	PROVIDE JUNO T-4FT-WH TRACK SECTION FOR TRACK HEAD MOUNTING. PROVIDE JUNO TCLF11-WH 1A CURRENT LIMITER FOR TRACK SECTION. REFER TO FLOOR PLAN FOR NUMBER OF TRACK HEADS.
UC	UNDERCABINET LED FIXTURE WITH INTEGRAL ROCKER SWITCH	HEALTHCARE LIGHTING	HUC523 120 LED35 S1 LX6	120 V	12 VA	LED	1221	3500K	N/A	
X-RAY	X-RAY IN-USE SIGN WHITE THERMOPLASTIC	LITHONIA	LQM-P-W-1-R	120 V	10 VA	LED	N/A	N/A	N/A	

NOTES: (APPLICABLE TO LUMINAIRE SCHEDULE ONLY)

1. CATALOG NUMBERS FOR LUMINAIRES INDICATE THE TYPE AND QUALITY OF THE LUMINAIRE TO BE PROVIDED BY THE CONTRACTOR AND ARE GENERAL IN NATURE. THE CATALOG NUMBERS ARE NOT INTENDED TO INDICATE AN ACTUAL ORDER MODEL NUMBER. IT IS THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE LUMINAIRES WITH THE TYPE OF LED, DRIVER, LENS OR DIFFUSER, AND CONSTRUCTION FEATURES AS INDICATED IN THE SPECIFICATIONS.

		LINE VOLTAGE CONTROL DEVICE						LOW VOLTAGE CONTROL DEVICE						SWITCHING/DIMMING				MISCELLANEOUS								NOTES
	TYPICAL SPACE TYPE	TOGGLE SWITCH(ES)	CEILING/WALL MOUNTED OCCUPANCY SENSOR(S)	WALL BOX OCCUPANCY SENSOR(S) WITH SINGLE OUTPUT RELAY	WALL BOX OCCUPANCY SENSOR(S) WITH DIMMING	LUMINAIRE WITH BUILT-IN OCCUPANCY SENSOR	-	DIGITAL SWITCH(ES)	CEILING/WALL MOUNTED OCCUPANCY SENSOR(S)	INDOOR PHOTOSENSOR(S)	OUTDOOR PHOTOCELL(S)	ASTRONOMICAL TIMECLOCK	FRESCA	SWITCHING	STEP-DIMMING	FULL RANGE DIMMING	CENTRALIZED CIRCADIAN RHYTHM CCT CONTROL	VACANCY SENSOR TIMEOUT/DELAY (IN MINUTES)	LIGHTS MANUAL ON	LIGHTS AUTOMATIC ON TO 100% LIGHT LEVEL UPON OCCUPANCY	LIGHTS AUTOMATIC ON TO 50% LIGHT LEVEL UPON OCCUPANCY, 100% MANUAL ON	TIMECLOCK SCHEDULED "ON" TIME	TIMECLOCK SCHEDULED "OFF" TIME	OCC. SENSOR OVERRIDE TIMECLOCK DURING "OFF" HOURS	DAYLIGHTING-DIM LIGHTS TO MAINTAIN MINIMUM 50FC AT 30" AFF	
1	CT ROOM	-	-	-	-	-	-	X	-	-	-	-	-	-	-	X	-	-	X	-	-	-	-	-	-	-
2	CONTROL ROOM	-	-	-	-	-	-	X	-	-	-	-	-	-	-	X	-	-	X	-	-	-	-	-	-	-
3	CT EQUIPMENT ROOM	-	-	-	-	-	-	X	-	-	-	-	-	X	-	-	-	-	X	-	-	-	-	-	-	-

3 LIGHTING CONTROL MATRIX
N.T.S

DISCONNECT SCHEDULE

DISC NAME	TYPE OF EQUIPMENT	VOLTAGE RATING	ENCLOSURE RATING	DISC. AMP/POLE	FUSE/BREAKER SIZE	STARTER SIZE	DISCONNECT NOTES
DS-HX-IDU	NON-FUSED DISCONNECT	600V	NEMA 1	30A/3P	N/A	N/A	
DS-ODU-259B	NON-FUSED DISCONNECT	240V	NEMA 3R	30A/2P	N/A	N/A	
DS-TU-A259-01	NON-FUSED DISCONNECT	240V	NEMA 1	60A/3P	N/A	N/A	
DS-TU-A259-02	NON-FUSED DISCONNECT	240V	NEMA 1	30A/3P	N/A	N/A	

EQUIPMENT SCHEDULE

EQUIPMENT NAME	IDENTIFICATION	HP	FLA	MCA	VOLT / PH / LOAD (VA)	MOCP	CB AMPS	PANEL	CKT #	FEEDER SIZE	CONDUIT	MOTOR STARTING	DISC MEANS	COMMENTS
AHU-A259	AIR HANDLING UNIT	-	-	33	208 V/3-11875 VA	50	50	EQ-MY	1,3,5	4#6AWG + 1#10AWG GND	1"	N/A	FACTORY PROVIDED	
HX-IDU	HEAT EXCHANGER INDOOR UNIT	-	-		480 V/3-7197 VA	30	30	MP	1,3,5	3#10AWG + 1#10AWG GND	3/4"	N/A	DS-HX-IDU	
HX-ODU	HEAT EXCHANGER OUTDOOR UNIT	-	-	65	208 V/3-19000 VA	90	90	EQ-MY	2,4,6	4#2AWG + 1#8AWG GND	1-1/4"	N/A	FACTORY PROVIDED	HEAT EXCHANGER IS CT MANUFACTURER SUPPLIED. SIZING CALCULATIONS ARE BASED ON SIEMENS GENERIC EQUIPMENT INFORMATION. FINAL VALUES SHALL BE COORDINATED WITH THE FINAL MANUFACTURERS SITE SPECIFIC DRAWINGS.
ODU-A259B/IDU-A259B	DUCTLESS SPLIT SYSTEM	-	-	11	208 V/1-2496 VA	28	30	EQ-MY	7,9	2#10AWG + 1#10AWG GND	3/4"	N/A	DS-ODU-259B	INDOOR UNIT IS POWERED BY OUTDOOR UNIT. PROVIDE CONDUIT BETWEEN OUTDOOR UNIT AND INDOOR UNIT. COORDINATE INSTALLATION WITH MECHANICAL CONTRACTOR.
TU-A259-01	TERMINAL UNIT			35.5	208 V/3-9400 VA	40	40	EQ-MY	11,13,15	4#8AWG + 1#10AWG GND	3/4"	N/A	DS-TU-A259-01	
TU-A259-02	TERMINAL UNIT			10.6	208 V/3-2800 VA	15	15	EQ-MY	12,14,16	3#12AWG + 1#12AWG GND	3/4"	N/A	DS-TU-A259-02	

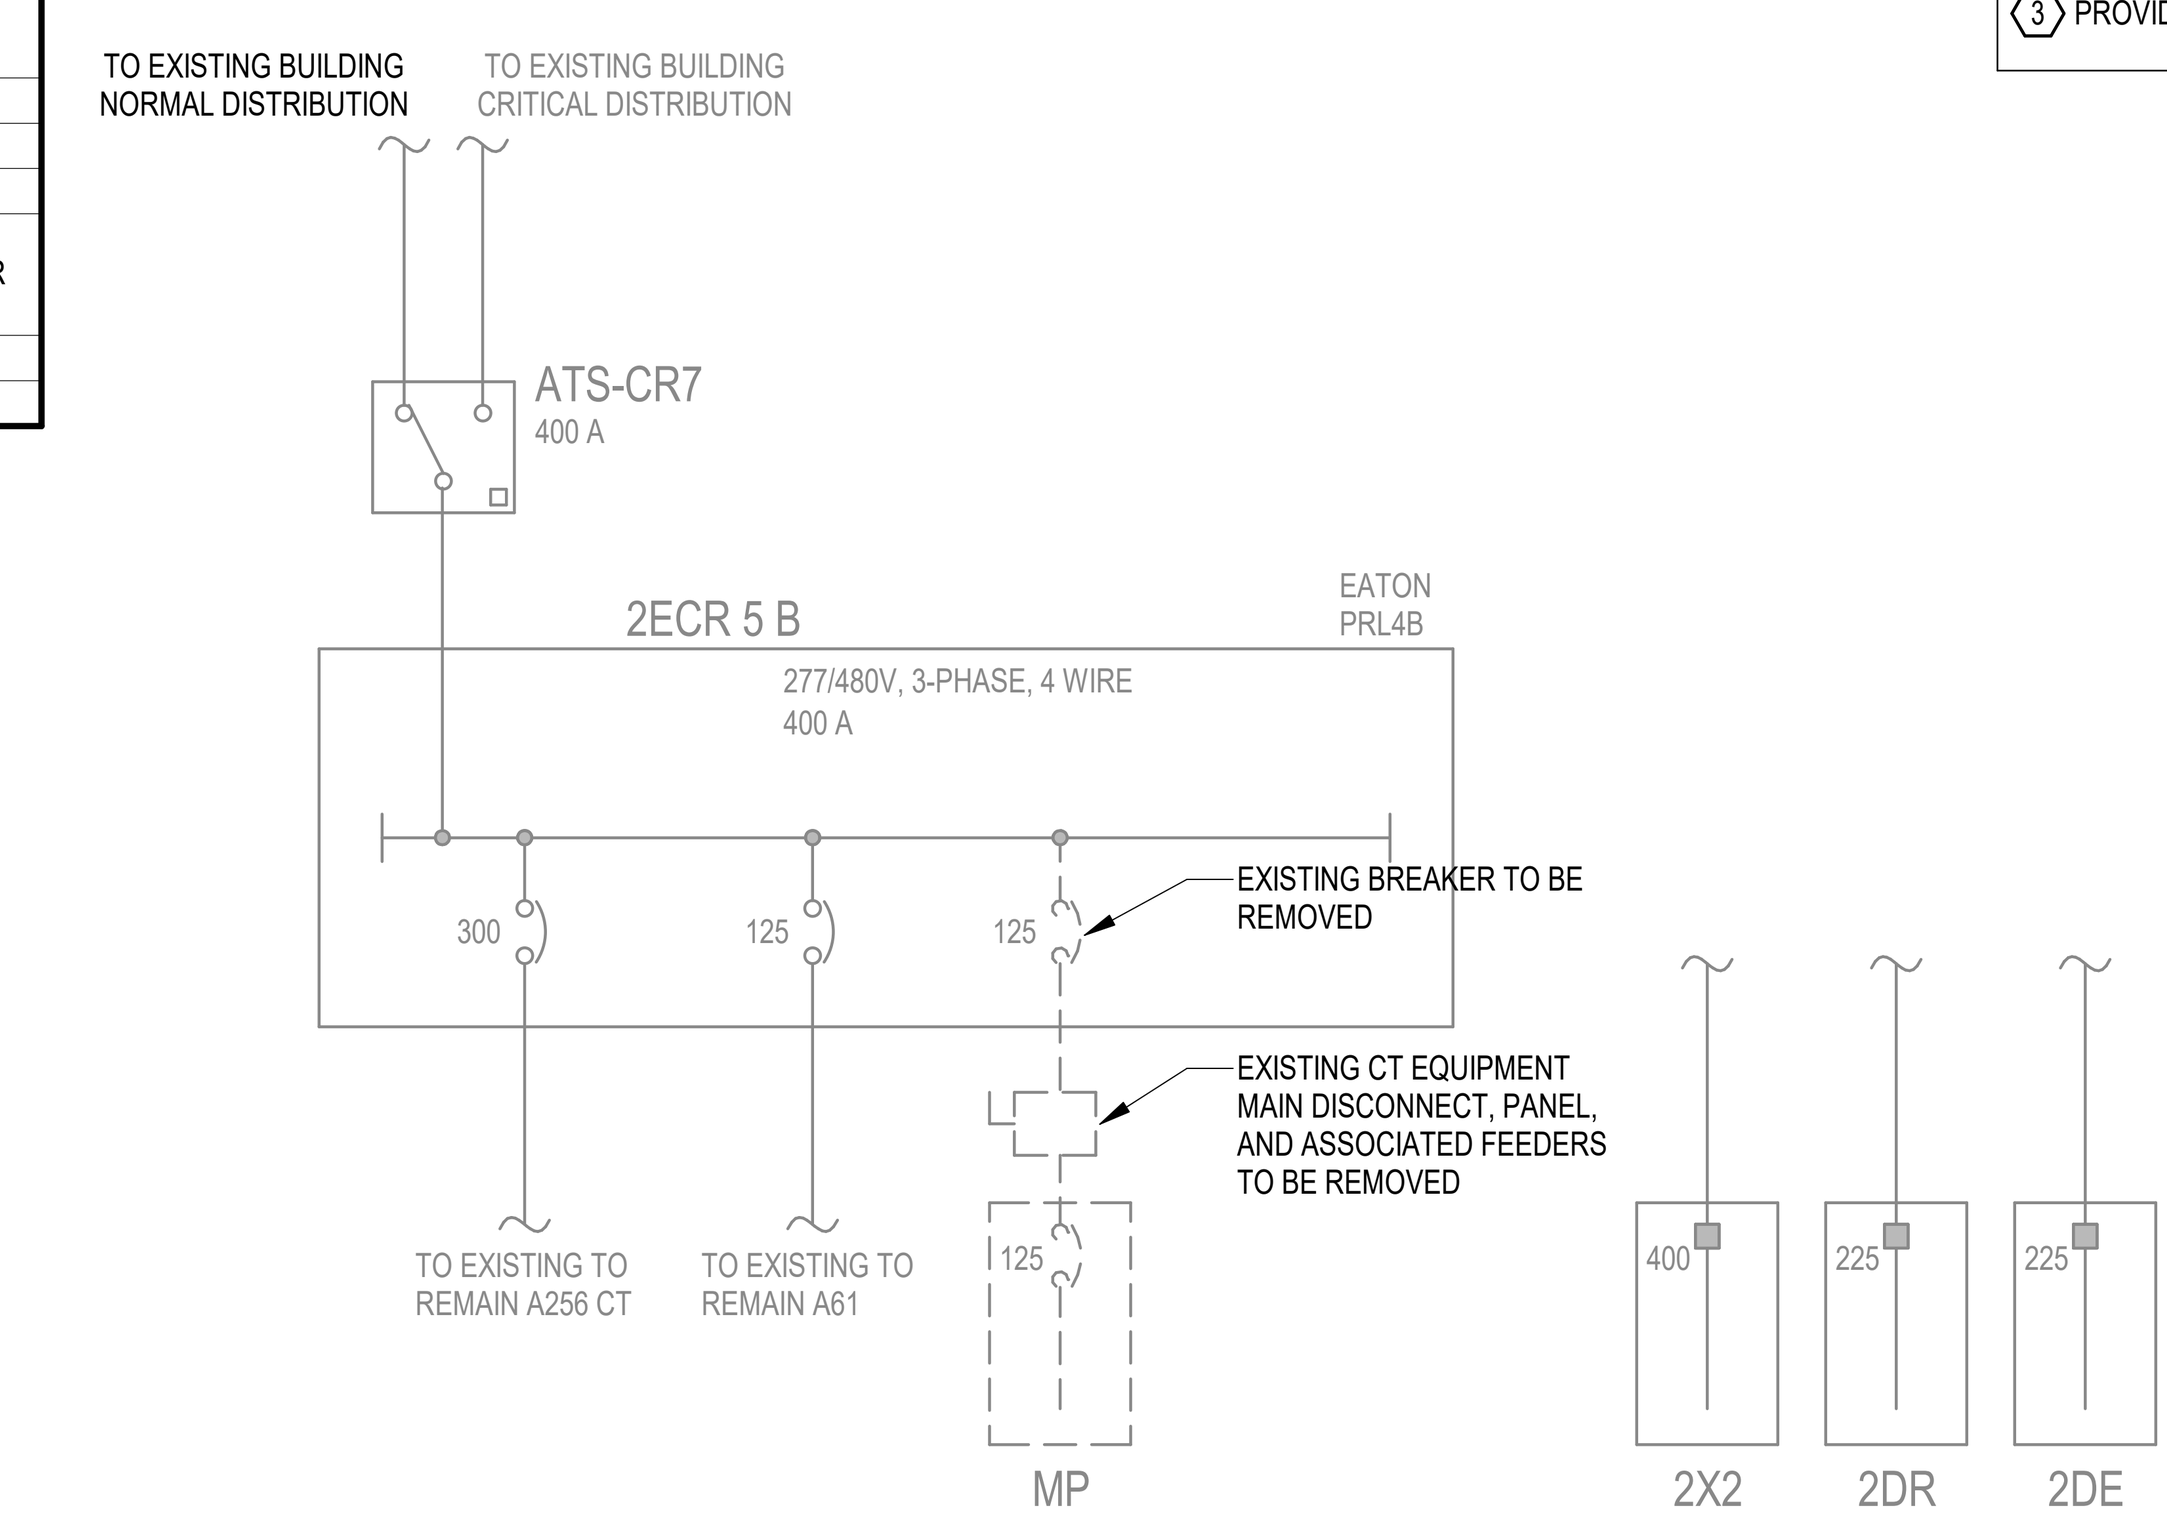

1 ELECTRICAL ONE-LINE DIAGRAM - DEMOLITION
N.T.S.

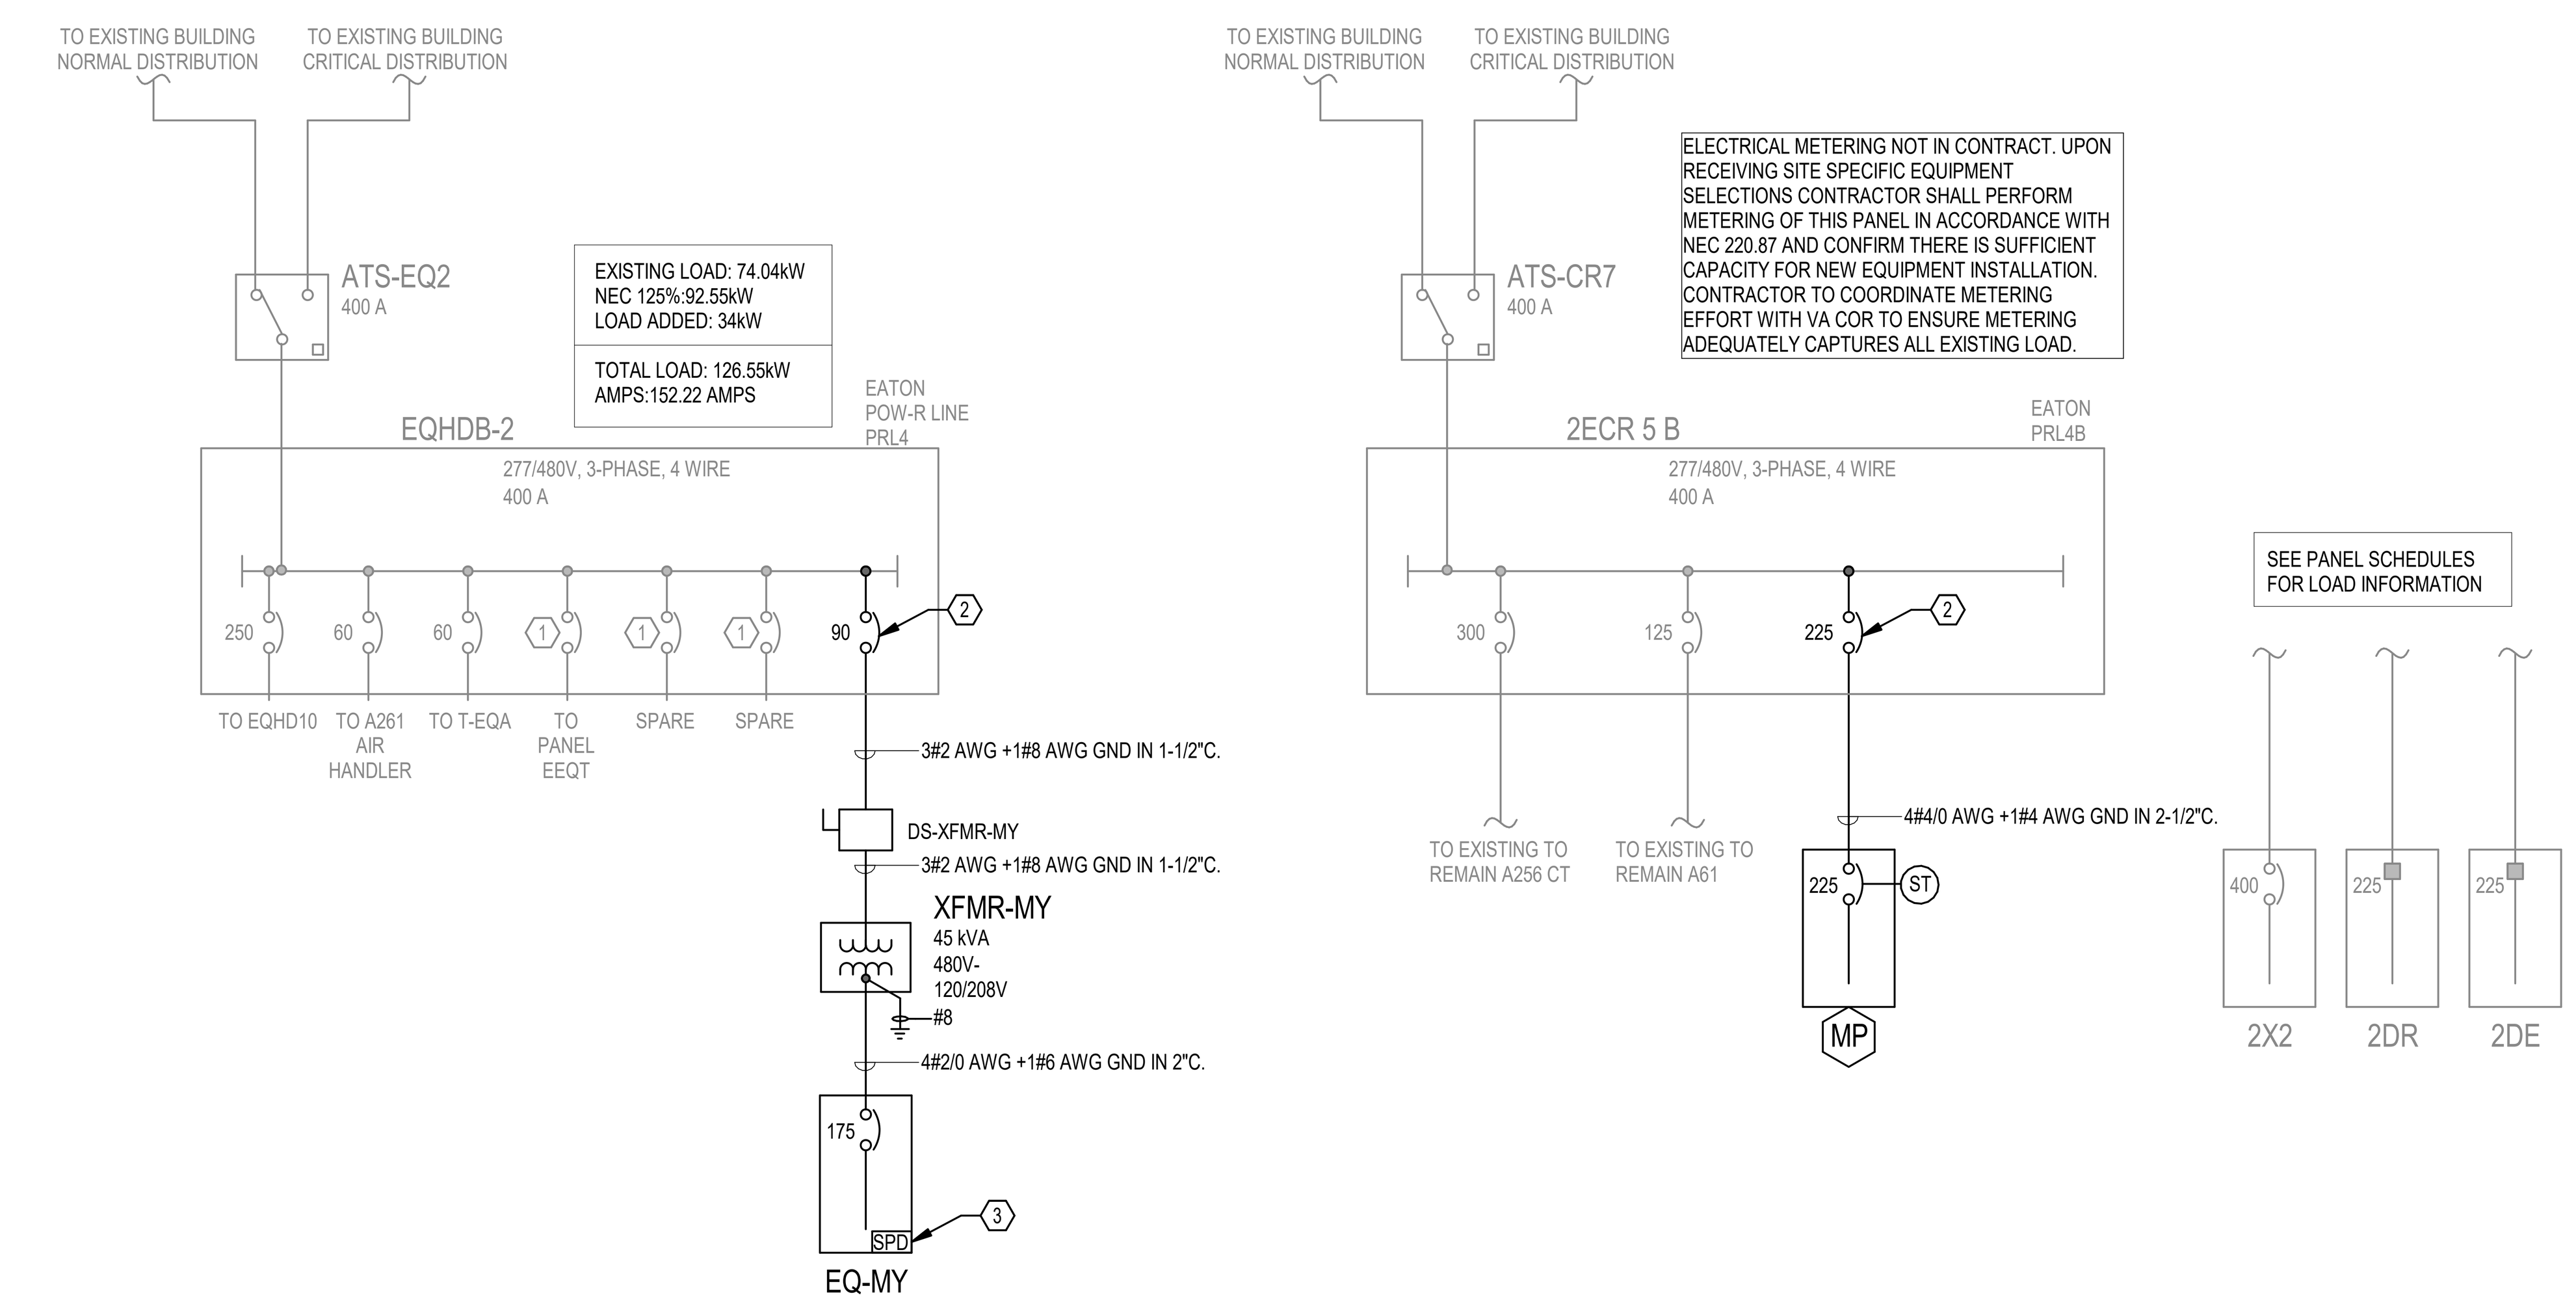

2 ELECTRICAL ONE-LINE DIAGRAM - NEW WORK
N.T.S.

CONSULTANT	ARCHITECT/ENGINEER OF RECORD	STAMP	Office of Construction and Facilities Management
Above Group ENGINEERING. DESIGN. CONSULTING. 305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com	THINKFORM DESIGN ARCHITECT LLC 38 EAST BROAD STREET HOPEWELL, NJ 08525 T:855.821.0274 F:609.644.4397 Russell DiNardo, AIA NY 031521-1	COMMONWEALTH OF PENNSYLVANIA REGISTERED PROFESSIONAL THOMAS D. BLISS ENGINEER PE077256	VA U.S. Department of Veterans Affairs
www.abovegroupinc.com COA/CA Lic. No. 31120 — 305 East Dr., Suite H, Melbourne, Florida 32904 PH: 321.345.9026			

Drawing Title: ELECTRICAL DIAGRAMS	Phase: 100% CONTRACT DOCUMENTS FOR BIDDING	Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	Project Number: 657-23-104JC
			Building Number:
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Drawing Number: E-601
		Issue Date: 06 MARCH 2026 — Checked: TDB — Drawn: WWS	

Revisions: Date:

BRANCH PANEL: 2DE

LOCATION: ELECTRICAL ROOM A258B **VOLTS:** 120/208 Wye **A.I.C. RATING:** 10k
SUPPLY FROM: EX CRITICAL DISTRIBUTION **PHASES:** 3 **MAINS TYPE:** MCB
MOUNTING: Surface **WIRES:** 4 **MAINS RATING:** 225 A
ENCLOSURE: Type 1 **SERVICE ENTRANCE:** No

GENERAL NOTES:
EXISTING CRITICAL BRANCH PANEL.

CKT	CIRCUIT DESCRIPTION	NOTES	TRIP	POLES	A	A	B	B	C	C	POLES	TRIP	NOTES	CIRCUIT DESCRIPTION	CKT
1	CORRIDOR NIGHT LIGHTS		20 A	1	300 VA	0 VA					1	20 A		SPARE IN CELING OUTSIDE A243	2
3	REC A243, EXIT LIGHTS		20 A	1			600 VA	0 VA			1	20 A		SPARE IN CELING OUTSIDE A243	4
5	CORRIDOR NIGHT LIGHTS		20 A	1					0 VA	0 VA	1	20 A		SPARE IN CELING OUTSIDE A243	6
7	OPENER A265 REC A224, EXIT LTS 2RR...		20 A	1	1000...	540 VA					1	20 A		EXISTING LOAD	8
9	REC HALLWAY, A261, A208		20 A	1			540 VA	540 VA			1	20 A		EXISTING LOAD	10
11	LIGHTS C2-2, C2-3,C2-4		20 A	1					300 VA	540 VA	1	20 A		REC A202	12
13	AL-33 CORRIDOR LIGHTS		20 A	1	300 VA	540 VA					1	20 A		WARMER REC	14
15	AL-33 CORRIDOR LIGHTS		20 A	1			300 VA	540 VA			1	20 A		A261	16
17	SPARE IN CEILING CORRIDOR		20 A	1					0 VA	540 VA	1	20 A		EXISTING LOAD	18
19	SPARE IN CEILING CORRIDOR		20 A	1	0 VA	540 VA					1	20 A		REC A259	20
21	REC A261		20 A	1			540 VA	400 VA			1	20 A		RECEPTACLE CT SCAN A259	22
23	EXISTING LOAD		20 A	1					540 VA	360 VA	1	20 A		RECEPTACLE CT SCAN A259	24
25	SPARE IN CEILING CORRIDOR		20 A	1	0 VA	200 VA					1	20 A		RECEPTACLE CT SCAN A259	26
27	REC A261		20 A	1			540 VA	200 VA			1	20 A		RECEPTACLE CT SCAN A259	28
29	EXISTING LOAD		20 A	1					540 VA	360 VA	1	20 A		RECEPTACLE CT SCAN A259	30
31	LIGHTING ROOM A259, A259b		20 A	1	218 VA	400 VA					1	20 A		RECEPTACLE CONTROL ROOM A259a	32
33	SPARE		20 A	1			0 VA	0 VA			1	20 A		SPARE	34
35	SPARE		20 A	1					0 VA	0 VA	1	20 A		SPARE	36
37	SPARE		20 A	1	0 VA	0 VA									38
39	SPARE		20 A	1			0 VA	0 VA			3	30 A		REMOTE SPD	40
41	SPARE		20 A	1					0 VA	0 VA					42
				TOTAL...	4038 VA		4200 VA		3180 VA						
				TOTAL...	35 A		36 A		27 A						

LEGEND:

LOAD CLASSIFICATION	CONNECTED LOAD	DEMAND FACTOR	ESTIMATED DEMAND	PANEL TOTALS	
Lighting	218 VA	100.00%	218 VA		
Receptacle	1920 VA	100.00%	1920 VA	TOTAL CONNECTED LOAD:	11418 VA
Spare	9280 VA	100.00%	9280 VA	TOTAL EST. DEMAND:	11418 VA
				TOTAL CONNECTED...	32 A
				TOTAL EST. DEMAND...	32 A

BRANCH CIRCUIT NOTES:

BRANCH PANEL: MP

LOCATION: CONTROL ROOM A259A **VOLTS:** 480/277 Wye **A.I.C. RATING:** 22kA
SUPPLY FROM: 2ECR 5 B **PHASES:** 3 **MAINS TYPE:** MCB
MOUNTING: Surface **WIRES:** 4 **MAINS RATING:** 225 A
ENCLOSURE: Type 1 **SERVICE ENTRANCE:** No

GENERAL NOTES:
NEW CRITICAL BRANCH PANEL. PROVDE SHUNT TRIP MAIN CIRCUIT BREAKER.

CKT	CIRCUIT DESCRIPTION	NOTES	TRIP	POLES	A	A	B	B	C	C	POLES	TRIP	NOTES	CIRCUIT DESCRIPTION	CKT
1					2399...	2500...									2
3	CT HEAT EXCHANGER		30 A	3			2399...	2500...			3	125 A		CT SCAN	4
5									2399...	2500...					6
7	SPARE		20 A	1	0 VA	0 VA									8
9	SPARE		20 A	1			0 VA	0 VA			3	30 A		SPD	10
11	SPARE		20 A	1					0 VA	0 VA					12
13	SPARE		20 A	1	0 VA	0 VA					1	20 A		SPARE	14
15	SPARE		20 A	1			0 VA	0 VA			1	20 A		SPARE	16
17	SPARE		20 A	1					0 VA	0 VA	1	20 A		SPARE	18
19	SPARE		20 A	1	0 VA	0 VA					1	20 A		SPARE	20
21	SPARE		20 A	1			0 VA	0 VA			1	20 A		SPARE	22
23	SPARE		20 A	1					0 VA	0 VA	1	20 A		SPARE	24
25	SPARE		20 A	1	0 VA	0 VA					1	20 A		SPARE	26
27	SPARE		20 A	1			0 VA	0 VA			1	20 A		SPARE	28
29	SPARE		20 A	1					0 VA	0 VA	1	20 A		SPARE	30
				TOTAL...	27399 VA		27399 VA		27399 VA						
				TOTAL...	99 A		99 A		99 A						

LEGEND:

LOAD CLASSIFICATION	CONNECTED LOAD	DEMAND FACTOR	ESTIMATED DEMAND	PANEL TOTALS	
Other	82197 VA	100.00%	82197 VA		
				TOTAL CONNECTED LOAD:	82197 VA
				TOTAL EST. DEMAND:	82197 VA
				TOTAL CONNECTED...	99 A
				TOTAL EST. DEMAND...	99 A

BRANCH CIRCUIT NOTES:

BRANCH PANEL: 2DR

LOCATION: ELECTRICAL ROOM A258B **VOLTS:** 120/208 Wye **A.I.C. RATING:** 10k
SUPPLY FROM: EX NORMAL DISTRIBUTION **PHASES:** 3 **MAINS TYPE:** MCB
MOUNTING: Surface **WIRES:** 4 **MAINS RATING:** 225 A
ENCLOSURE: Type 1 **SERVICE ENTRANCE:** No

GENERAL NOTES:
EXISTING NORMAL BRANCH PANEL.

CKT	CIRCUIT DESCRIPTION	NOTES	TRIP	POLES	A	A	B	B	C	C	POLES	TRIP	NOTES	CIRCUIT DESCRIPTION	CKT
1	LTS AND REC. ELEVATOR		30 A	1	540 VA	540 VA					1	20 A		EXISTING LOAD	2
3	REC A HALLWAY		20 A	1			540 VA	1000...			1	20 A		RECEPTACLE CT SCAN A259	4
5	EXISTING LOAD		20 A	1					540 VA	0 VA	1	20 A		SPARE	6
7	LIGHTING		20 A	1	356 VA	920 VA					1	20 A		RECEPTACLE CONTROL ROOM A259a	8
9	EXISTING LOAD		20 A	1			540 VA	180 VA			1	20 A		RECEPTACLE CT SCAN A259	10
11	EXISTING LOAD		20 A	1					540 VA	0 VA	1	20 A		SPARE	12
13					6000...	540 VA					1	30 A		REC A 246 TOP POLE	14
15	A259 HVAC		100 A	3			6000...	540 VA			1	30 A		REC A 246 TOP POLE	16
17									6000...	0 VA	1	20 A		SPARE	18
19					0 VA	0 VA					1	20 A		SPARE	20
21	OFF - SPARE		20 A	3			0 VA	0 VA			1	20 A		SPARE	22
23									0 VA	0 VA	1	20 A		SPARE	24
25	OFF SPARE		20 A	1	0 VA	0 VA					1	20 A		SPARE	26
27	OFF SPARE		20 A	1			0 VA	0 VA			1	20 A		SPARE	28
29	OFF SPARE		20 A	1					0 VA	0 VA	1	20 A		SPARE	30
31	LIGHTING CT SCAN A259		20 A	1	24 VA	0 VA									32
33	SPARE		20 A	1			0 VA	700 VA			3	100 A		MRI-HVAC	34
35	SPARE		20 A	1					700 VA	700 VA					36
37					540 VA	540 VA									38
39	MRI-HAVAC		60 A	3			540 VA	0 VA			3	30 A		REMOTE SPD	40
41									0 VA	540 VA					42
				TOTAL...	10000 VA		10040 VA		9020 VA						
				TOTAL...	85 A		85 A		75 A						

LEGEND:

LOAD CLASSIFICATION	CONNECTED LOAD	DEMAND FACTOR	ESTIMATED DEMAND	PANEL TOTALS	
Lighting	380 VA	100.00%	380 VA		
Other	1000 VA	100.00%	1000 VA	TOTAL CONNECTED LOAD:	29060 VA
Receptacle	1100 VA	100.00%	1100 VA	TOTAL EST. DEMAND:	29060 VA
Spare	26580 VA	100.00%	26580 VA	TOTAL CONNECTED...	81 A
				TOTAL EST. DEMAND...	81 A

BRANCH CIRCUIT NOTES:

BRANCH PANEL: EQ-MY

LOCATION: MECH YARD **VOLTS:** 120/208 Wye **A.I.C. RATING:** 22kA
SUPPLY FROM: EQHDB-2 **PHASES:** 3 **MAINS TYPE:** MCB
MOUNTING: Surface **WIRES:** 4 **MAINS RATING:** 175 A
ENCLOSURE: Type 3R **SERVICE ENTRANCE:** No

GENERAL NOTES:
NEW EQUIPMENT BRANCH PANEL

CKT	CIRCUIT DESCRIPTION	NOTES	TRIP	POLES	A	A	B	B	C	C	POLES	TRIP	NOTES	CIRCUIT DESCRIPTION	CKT
1					3958...	6333...									2
3	AHU-A259		50 A	3			3958...	6333...			3	90 A		HEAT EXCHANGER ODU	4
5									3958...	6333...					6
7	ODU-259B		30 A	2	1248...	500 VA					1	20 A		HEAT TRACE	8
9							1248...	180 VA			1	20 A		RECEPTACLE NEAR PANEL	10
11									3133...	933 VA					12
13	TU-A259-01		40 A	3	3133...	933 VA					3	15 A		TU-A259-02	14
15							3133...	933 VA							16
17	SPARE		20 A	1					0 VA	0 VA	1	20 A		SPARE	18
19	SPARE		20 A	1	0 VA	0 VA					1	20 A		SPARE	20
21	SPARE		20 A	1			0 VA	0 VA			1	20 A		SPARE	22
23	SPARE		20 A	1					0 VA	0 VA	1	20 A		SPARE	24
25	SPACE		--	1	--	--					1	--		SPACE	26
27	SPACE		--	1			--	--			1	--		SPACE	28
29	SPACE		--	1					--	--	1	--		SPACE	30
				TOTAL...	16106 VA		15786 VA		14358 VA						
				TOTAL...	136 A		133 A		120 A						

LEGEND:

LOAD CLASSIFICATION	CONNECTED LOAD	DEMAND FACTOR	ESTIMATED DEMAND	PANEL TOTALS	
Other	46071 VA	100.00%	46071 VA		
Receptacle	180 VA	100.00%	180 VA	TOTAL CONNECTED LOAD:	46251 VA
				TOTAL EST. DEMAND:	46251 VA
				TOTAL CONNECTED...	128 A
				TOTAL EST. DEMAND...	128 A

BRANCH CIRCUIT NOTES:

Revisions: Date:

CONSULTANT
Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD
THINKFORM
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP
COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
THOMAS D. BLISS
ENGINEER
PE077256

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: ELECTRICAL SCHEDULES
Approved:
Phase: 100% CONTRACT DOCUMENTS FOR BIDDING
FULLY SPRINKLERED
Project Title: NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date: 06 MARCH 2026
Checked: TDB
Drawn: WWS
Project Number: 657-23-104JC
Building Number
Drawing Number: E-801

ELECTRONIC SAFETY AND SECURITY SYMBOLS

SYMBOL	DESCRIPTION
	ALARM, SPEAKER/LIGHT, ONE ASSEMBLY. ADJUSTABLE 15CD, 30CD, 75CD UNLESS OTHERWISE NOTED

SHEET LIST

SHEET NUMBER	SHEET NAME
FA001	FIRE ALARM LEGENDS & SYMBOLS
FA101	FLOOR PLAN - FIRE ALARM - NEW WORK
FA-501	FIRE ALARM DETAILS

FIRE ALARM ABBREVIATIONS

ABBR.	DESCRIPTION
1PH	SINGLE-PHASE
1P	SINGLE POLE
2/C	TWO-CONDUCTOR
3/C	THREE-CONDUCTOR
3PH	THREE-PHASE
4/C	FOUR-CONDUCTOR
4W	FOUR-WIRE
A/C UNIT	AIR CONDITIONING UNIT
A/E	ARCHITECT/ENGINEER
AAP	ALARM ANNUNCIATOR PANEL
AC	ALTERNATING CURRENT OR ARMORED CABLE
ACC	ACCESSIBLE
ADDL	ADDITIONAL
ADJ	ADJACENT, ADJOINING
ADO	AUTOMATIC DOOR OPENER
AFC	ABOVE FINISHED COUNTER
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AHJ	AUTHORITY HAVING JURISDICTION
ALT	ALTERNATE
AMB OR A	AMBIENT
ARCH	ARCHITECT
ATS	AUTOMATIC TRANSFER SWITCH
AUTO	AUTOMATIC
AV	AUDIO VISUAL
BAT	BATTERY
BC	BARE COPPER
BD	BOARD
BFF	BELOW FINISH FLOOR
BLDG	BUILDING
BPIP	BOILER PLANT INSTRUMENTATION PANEL
BYP	BY PASS
C	CONDUIT
CAB	CABINET
CALC	CALCULATE
CAP	CAPACITY
CAT	CATALOG
CATV	COMMUNITY ANTENNA TELEVISION
CCR	CONTROL CONTACTOR
CCTV	CLOSED CIRCUIT TELEVISION
CD	CONSTRUCTION DOCUMENTS
CF	CONTRACTOR FURNISHED
CF/CI	CONTRACTOR FURNISHED/CONTRACTOR INSTALLED
CF/OI	CONTRACTOR FURNISHED/OWNER INSTALLED
CFE	CONTRACTOR FURNISHED EQUIPMENT
CLG	CEILING
CMU	CONCRETE MASONRY UNIT
COAX	COAX CABLE
COMM	COMMUNICATION
COMPT	COMPARTMENT
CONC	CONCRETE
CONT	CONTINUE
CONTR	CONTRACTOR
COORD	COORDINATE
CTV	CABLE TELEVISION
CU	COPPER
CU FT	CUBIC FEET
CUR	CURRENT

ABBR.	DESCRIPTION
DB	DECIBEL OR DIRECT BURIAL
DC	DIRECT CURRENT
DEG C	DEGREES CELSIUS
DEG F	DEGREES FAHRENHEIT
DEMO	DEMOLITION
DIAG	DIAGRAM
DISTR	DISTRIBUTION
DN	DOWN
DRSW	DOOR SWITCH
DWG	DRAWING
EC	EMPTY CONDUIT
EG	EQUIPMENT GROUND
EL	ELEVATION
ELEC	ELECTRIC OR ELECTRICAL
ELEV	ELEVATOR
EMER	EMERGENCY
EMI	ELECTROMAGNETIC INTERFERENCE
EMT	ELECTRICAL METALLIC TUBING
ENCL	ENCLOSURE
EPO	EMERGENCY POWER OFF
ESMT	EASEMENT
EXIST	EXISTING
FLEX	FLEXIBLE METALLIC CONDUIT
FOUTT	TELEPHONE FLOOR OUTLET
FP	FIRE PROTECTION
FT	FEET OR FOOT
FU SW	FUSED SWITCH
G OR GND	GROUND OR GENERATOR
GEN	GENERATOR
GTB	GROUND TERMINAL BOX
HOA	HAND-OFF-AUTOMATIC
HT	HEIGHT
HZ	HERTZ
IMC	INTERMEDIATE METAL CONDUIT
IR	INFRARED
J-BOX	JUNCTION BOX
LF	LINEAR FEET (FOOT)
LTNG	LIGHTING
LV	LOW VOLTAGE
MATV	MASTER ANTENNA TELEVISION SYSTEM
MAX	MAXIMUM
MECH	MECHANICAL
MH	MANHOLE
MIN	MINIMUM
MT	MOUNT
MTD	MOUNTED
MTG	MOUNTING
NA	NOT APPLICABLE
NEC	NATIONAL ELECTRICAL CODE
NEUT OR N	NEUTRAL
NIC	NOT IN CONTRACT
NS	NO SCALE
NTS	NOT TO SCALE

ABBR.	DESCRIPTION
OC	ON CENTER
OD	OUTSIDE DIAMETER
P	POLE
PA	PUBLIC ADDRESS
PB	PANELBOARD, PULL BOX, OR PUSHBUTTON
PBPU	PREFABRICATED BEDSIDE PATIENT UNIT
PED	PEDESTAL
PEND	PENDANT
PF	POWER FACTOR
PH	PHASE
PNL	PANEL
PVC	POLYVINYL CHLORIDE (PLASTIC)
PWR	POWER
RCP	REFLECTED CEILING PLAN
REC	RECESSED
RECPT	RECEPTACLE
RGS	RIGID GALVANIZED STEEL
RM	ROOM
REQD	REQUIRED
SF	SQUARE FOOT (FEET)
SHT	SHEET
SI	INTERNATIONAL SYSTEM OF UNITS
SPEC	SPECIFICATION
SURF	SURFACE
SW	SWITCH
TEL	TELEPHONE
TP	TWISTED PAIR
TPS	TWISTED PAIR SHIELDED
TTB	TELEPHONE TERMINAL BOARD
TV	TELEVISION
TYP	TYPICAL
UFD	UNDERFLOOR DUCT
UGND	UNDERGROUND
UL	UNDERWRITERS LABORATORY
UON	UNLESS OTHERWISE NOTED
UPS	UNINTERRUPTIBLE POWER SUPPLY
UTIL	UTILITY
V	VOLT
WP	WEATHERPROOF

FIRE ALARM SYSTEM NOTES

FA1. ALL FIRE ALARM EQUIPMENT IS TO BE NEW, UL LISTED FOR FIRE SERVICE, AND SHALL BE COMPATIBLE WITH THE EXISTING HONEYWELL FIRE ALARM SYSTEM.

FA2. ALL WIRING AND CONDUIT IS TO CONFORM TO NEC ARTICLE 760. WIRING SHALL BE UL LISTED, MINIMUM 300V TYPE FPLP PLENUM RATED SOLID COPPER OR STANDARD COPPER WITH MAXIMUM 19 STRANDS.

FA3. LOW VOLTAGE CONDUCTORS: PROVIDE CONDUCTORS IN ACCORDANCE WITH NFPA 70 AND NFPA 72, AND AS RECOMMENDED BY THE FIRE ALARM SYSTEM MANUFACTURER. CONDUCTORS SHALL BE COPPER, MINIMUM NO. 14 AWG, TWISTED SHIELDED PAIR.

FA4. SURVIVABILITY: PER AUTHORITY HAVING JURISDICTION, WIRING INSTALLED IN METAL RACEWAY WITHIN BUILDINGS THAT ARE PROTECTED THROUGHOUT BY SPRINKLERS SHALL BE CONSIDERED TO MEET THE REQUIREMENTS FOR PATHWAY SURVIVABILITY LEVEL 2 IN ACCORDANCE WITH NFPA 72 (2025) AS A 2-HOUR PERFORMANCE ALTERNATIVE.

FA5. PROVIDE FIRE ALARM RELAY AND DUCT DETECTOR CONNECTED TO FIRE ALARM SYSTEM, WITHIN 5' OF ALL DUCT PENETRATIONS THROUGH FIRE/SMOKE WALLS, WHETHER INDICATED ON ELECTRICAL OR MECHANICAL PLANS OR NOT.

FA6. ALL FIRE ALARM POWER CIRCUITS SHALL HAVE A DEDICATED 120V 20A BREAKER THAT SHALL BE RED IN COLOR AND MECHANICALLY PROTECTED (LOCKABLE IN THE "ON" POSITION), MARKED AS "FIRE ALARM CIRCUIT".

FA7. MINIMUM CANDELA RATING OF STROBES IS 15CD UNLESS NOTED OTHERWISE; "##" ADJACENT TO DEVICE INDICATES THE CANDELA RATING. PROVIDE SYNCHRONIZATION OF STROBES IN ALL ADJACENT AREAS WHERE STROBES ARE VISIBLE TO EACH OTHER.

FA8. FIRE ALARM DESIGN IS IN ACCORDANCE WITH THE NATIONAL FIRE PROTECTION ASSOCIATION (NFPA 72 - 2025) AND NATIONAL FIRE CODES (NFC). WHERE A FIRE ALARM RISER IS INDICATED, IT IS DIAGRAMMATIC IN NATURE AND NOT INTENDED TO REPRESENT A COMPLETE WIRING AND DEVICE DISPLAY. ALL WIRING AND DEVICES SHALL BE IN ACCORDANCE WITH SELECTED VENDOR'S POINT-BY-POINT WIRING DIAGRAM. REFER TO FLOOR PLAN FOR DESIGN INTENT AND PROPOSED QUANTITY OF FIRE ALARM SYSTEM COMPONENTS.

FA9. THESE DRAWINGS ARE SCHEMATIC IN NATURE AND ARE NOT INTENDED TO SHOW ALL POSSIBLE CONDITIONS. IT IS INTENDED THAT A COMPLETE FIRE ALARM SYSTEM BE PROVIDED WITH ALL THE NECESSARY EQUIPMENT, WIRING, CONDUIT, AND CONTROLS, COMPLETELY COORDINATED WITH ALL DISCIPLINES. THE MINIMUM FIRE ALARM DESIGN CRITERIA IN THESE DOCUMENTS SHALL BE STRICTLY CONFORMED TO IN ACCORDANCE WITH 61G15-30.008. ANY ITEMS AND LABOR REQUIRED FOR A COMPLETE FIRE ALARM SYSTEM, IN ACCORDANCE WITH ALL APPLICABLE CODES, STANDARDS, LOCAL AUTHORITIES AND THESE CONTRACT DOCUMENTS SHALL BE FURNISHED AT NO ADDITIONAL COST TO THE OWNER. THE FIRE ALARM CONTRACTOR SHALL CAREFULLY REVIEW ALL CONTRACT DOCUMENTS AND THE DESIGN OF OTHER TRADES BEFORE PREPARING SHOP DRAWINGS.

FA10. FIRE ALARM CONTRACTOR SHALL BE AWARE OF THE TYPE OF FINISHES, DECOR AND OCCUPANCY. COORDINATION WITH THE STAKEHOLDERS(S) SHALL BE PERFORMED BY THE FIRE ALARM CONTRACTOR FOR PLACEMENT OF FIRE ALARM DEVICES.

FA11. FIRE ALARM SYSTEM SHALL COMPLY WITH NFPA 70 AND 72 FOR PROPER INSTALLATION PRACTICES.

FA12. FIRE ALARM PATHWAYS IN ALL AREAS SHALL BE IN 3/4" EMT, AND SHALL BE PAINTED RED. ALL FIRE ALARM WIRING SHALL BE ROUTED THROUGH CONDUIT THAT IS STRICTLY DEDICATED FOR FIRE ALARM. NO OTHER SYSTEMS MAY UTILIZE FIRE ALARM WIRING CONDUIT OR EMT.

FA13. ALL FIRE ALARM JUNCTION BOX AND PULL BOX COVERS SHALL BE PAINTED RED.

FA14. INCREASE BATTERY CAPACITY OF FIRE ALARM SYSTEMS TO ACCOMMODATE ADDITIONAL LOAD.

FA15. PERFORM RE-ACCEPTANCE TESTING IN ACCORDANCE WITH NFPA 72.

FA16. FIRE ALARM CIRCUITS SHALL NOT HAVE SPLICES. CIRCUITS SHALL BE EXTENDED FROM DEVICE AND APPLIANCE SCREW TERMINALS.

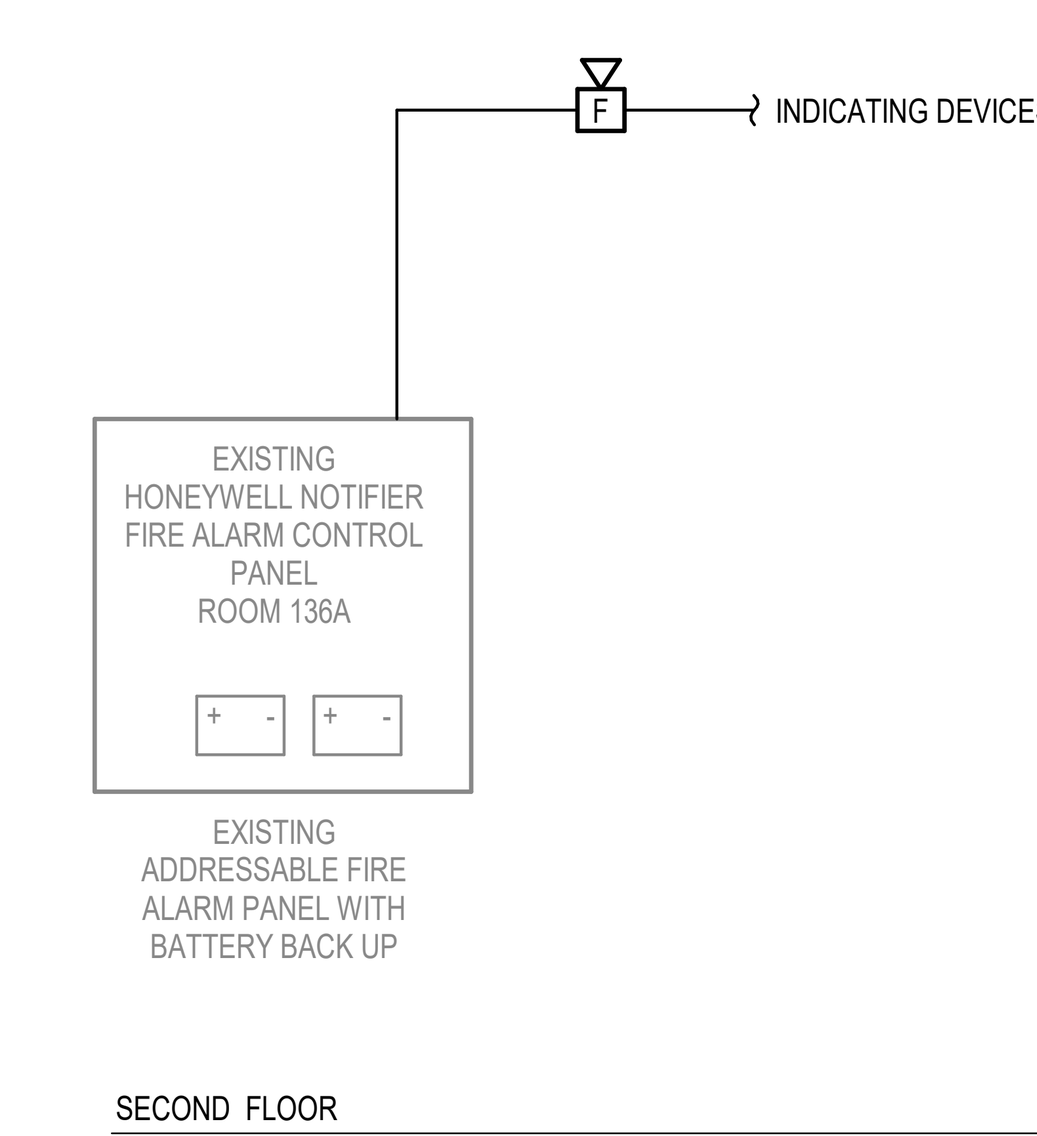

1 FIRE ALARM RISER DIAGRAM
N.T.S

THE EXISTING SEQUENCE OF OPERATIONS OF THE FIRE ALARM SYSTEM SHALL NOT BE MODIFIED.

Revisions: | Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
SBA SERVICE-DISABLED VETERAN-OWNED CERTIFIED
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
THOMAS D. BLISS
ENGINEER
PE077256

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
FIRE ALARM LEGENDS & SYMBOLS	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number:
		Issue Date: 06 MARCH 2026; Checked: TDB; Drawn: WWS	Drawing Number: FA001

DRAWING NOTES:

1. NEW FIRE ALARM DEVICE(S) SHALL BE CIRCUITED BACK TO EXISTING HONEYWELL NOTIFIER FIRE ALARM PANEL LOCATED IN TELECOM ROOM 136A.

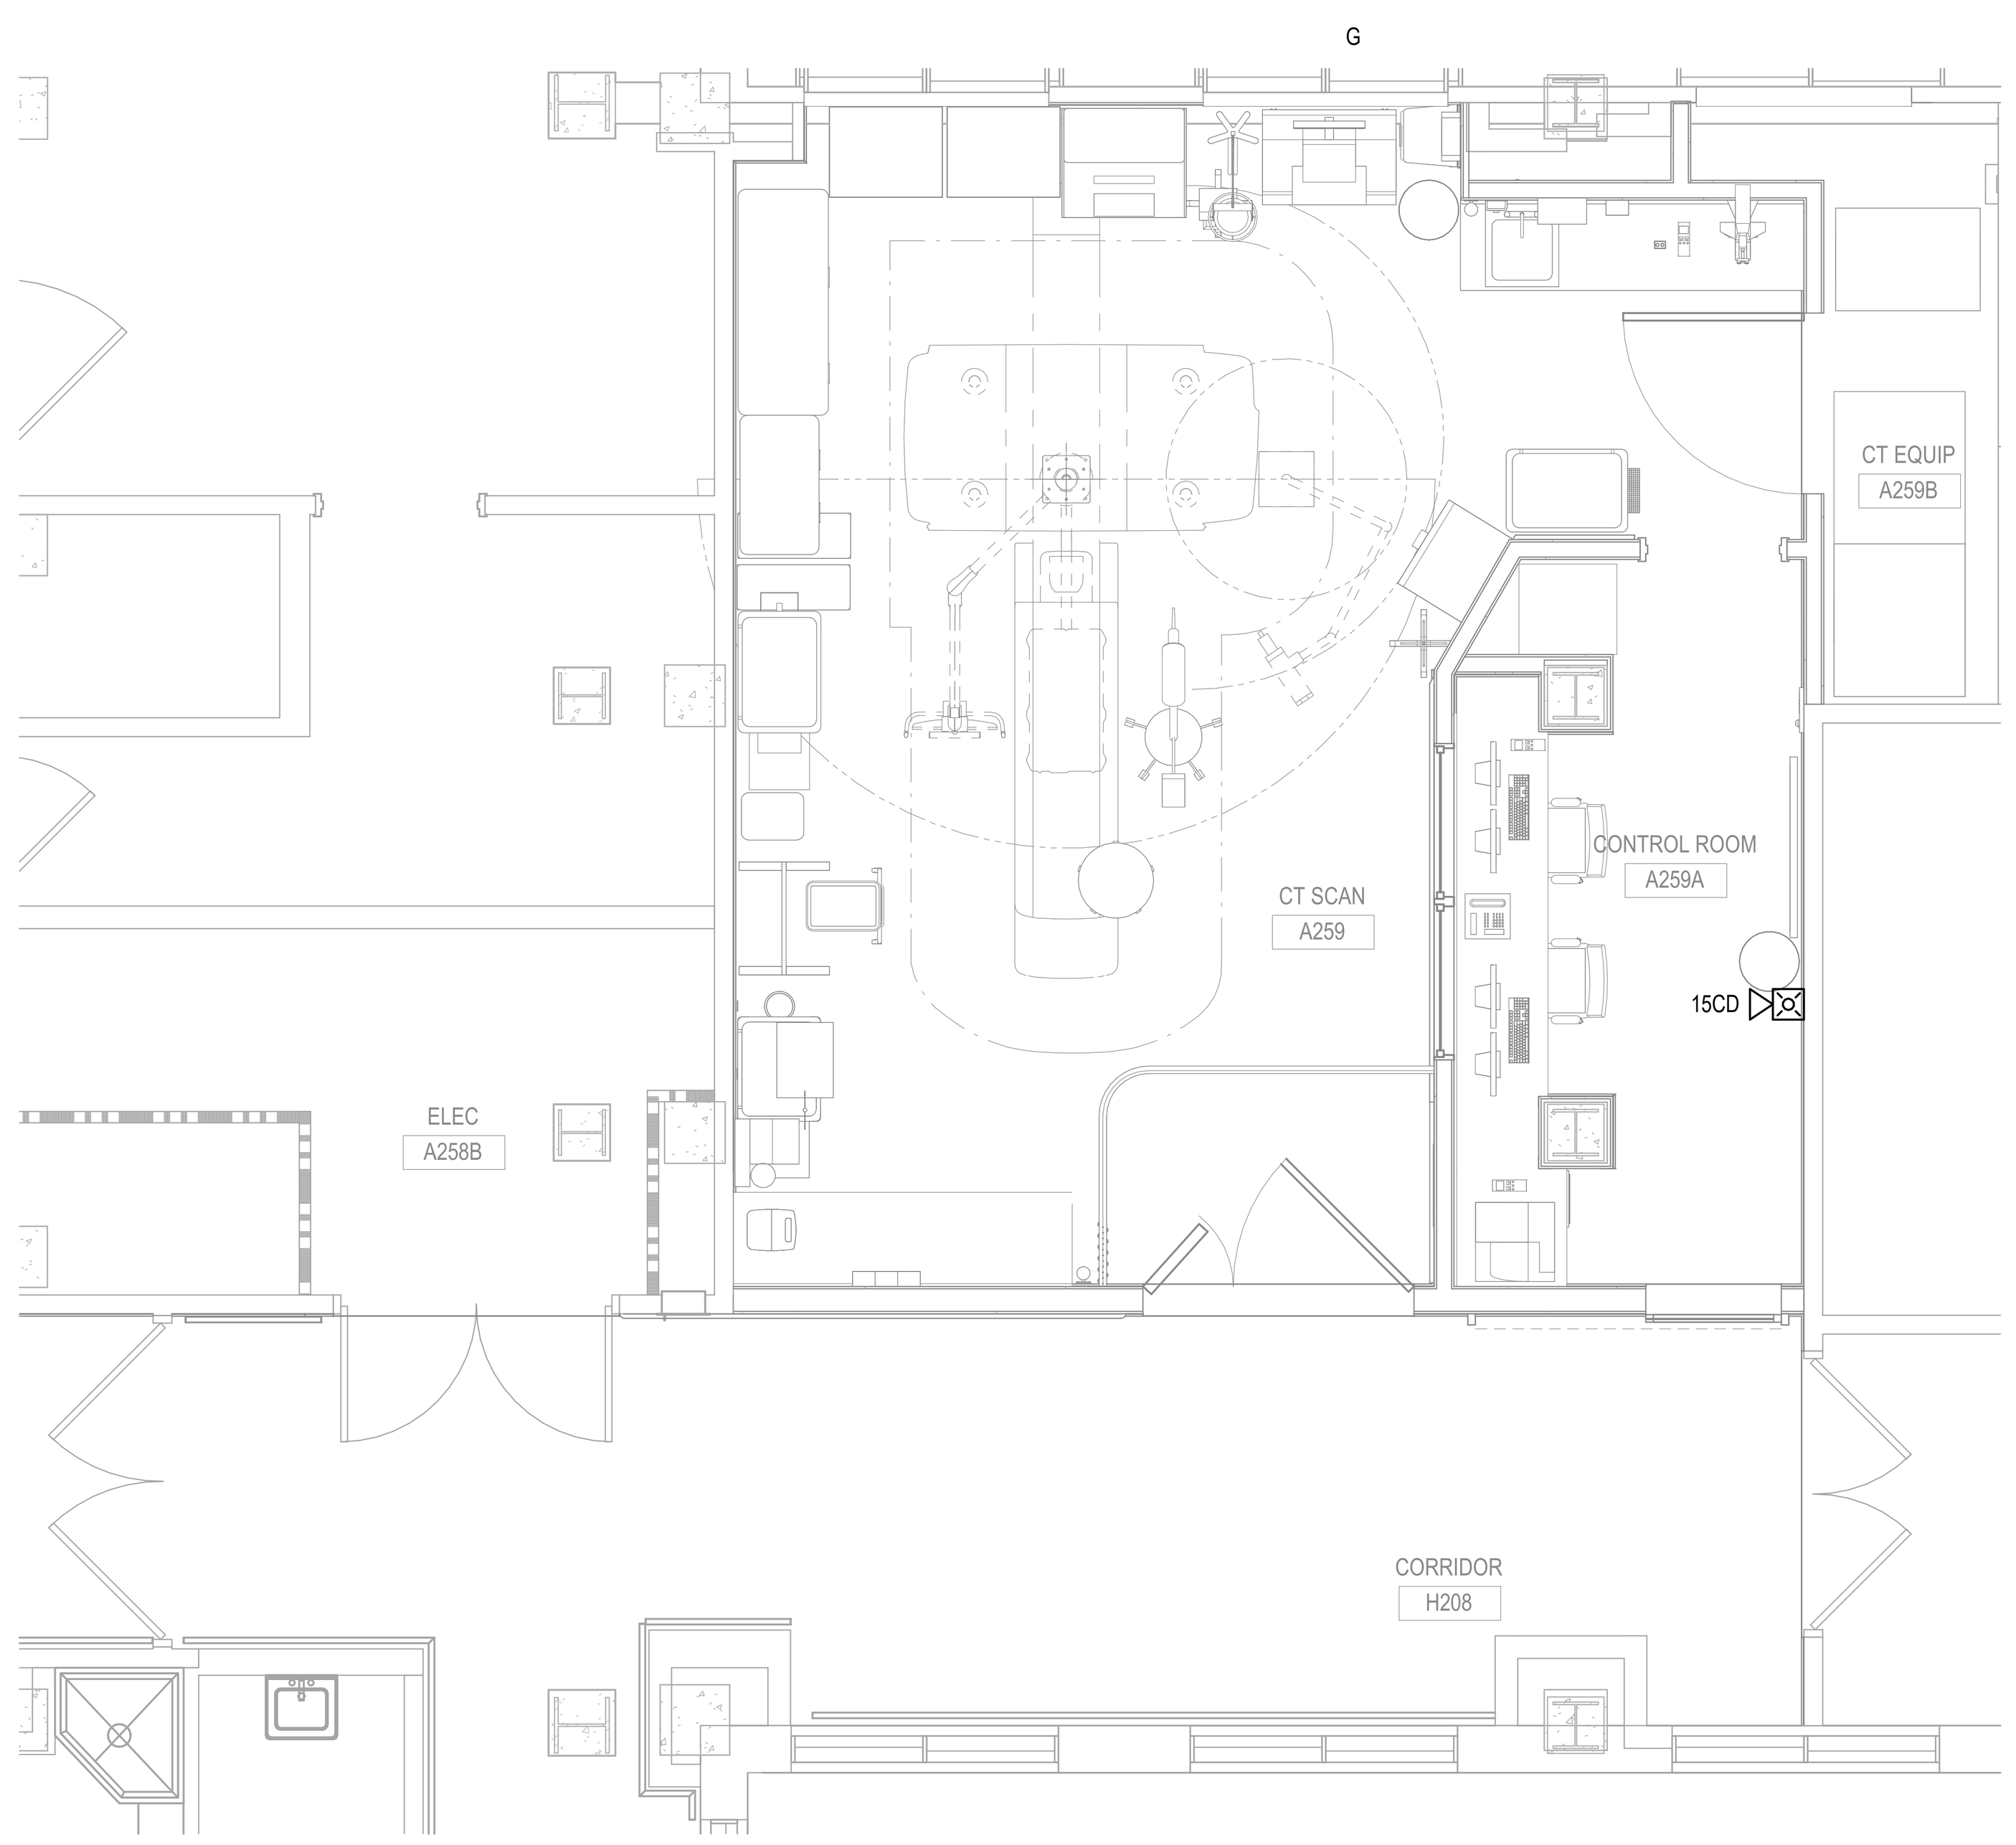

1 SECOND FLOOR PLAN -FIRE ALARM - NEW WORK
1/4" = 1'-0"

KEY PLAN

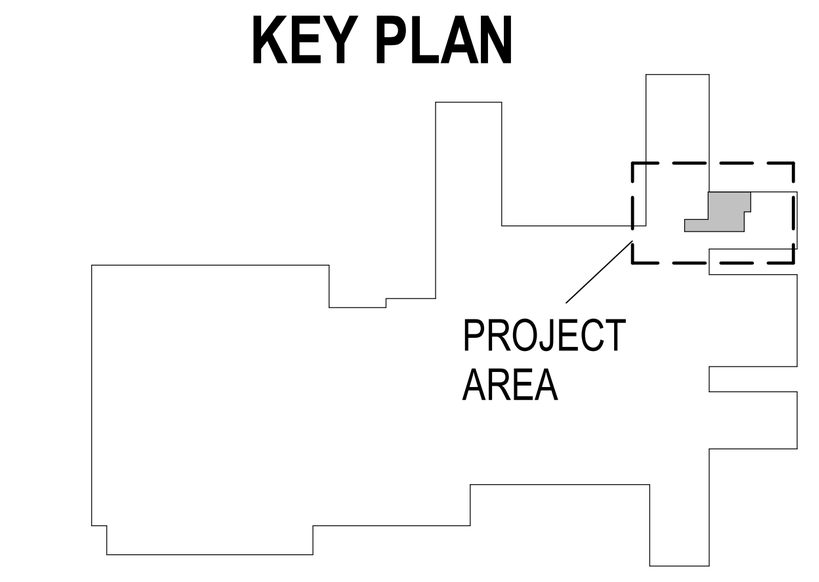

N
0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions:
Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM architects
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
THOMAS D. BLISS
ENGINEER
PE077256

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
FLOOR PLAN - FIRE ALARM - NEW WORK	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC

Building Number:

Approved:

FULLY SPRINKLERED

Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106

Issue Date	Checked	Drawn	Drawing Number
06 MARCH 2026	TDB	WWS	FA101

VA FORM 08 - 6231

3/6/2026 1:06:06 PM

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

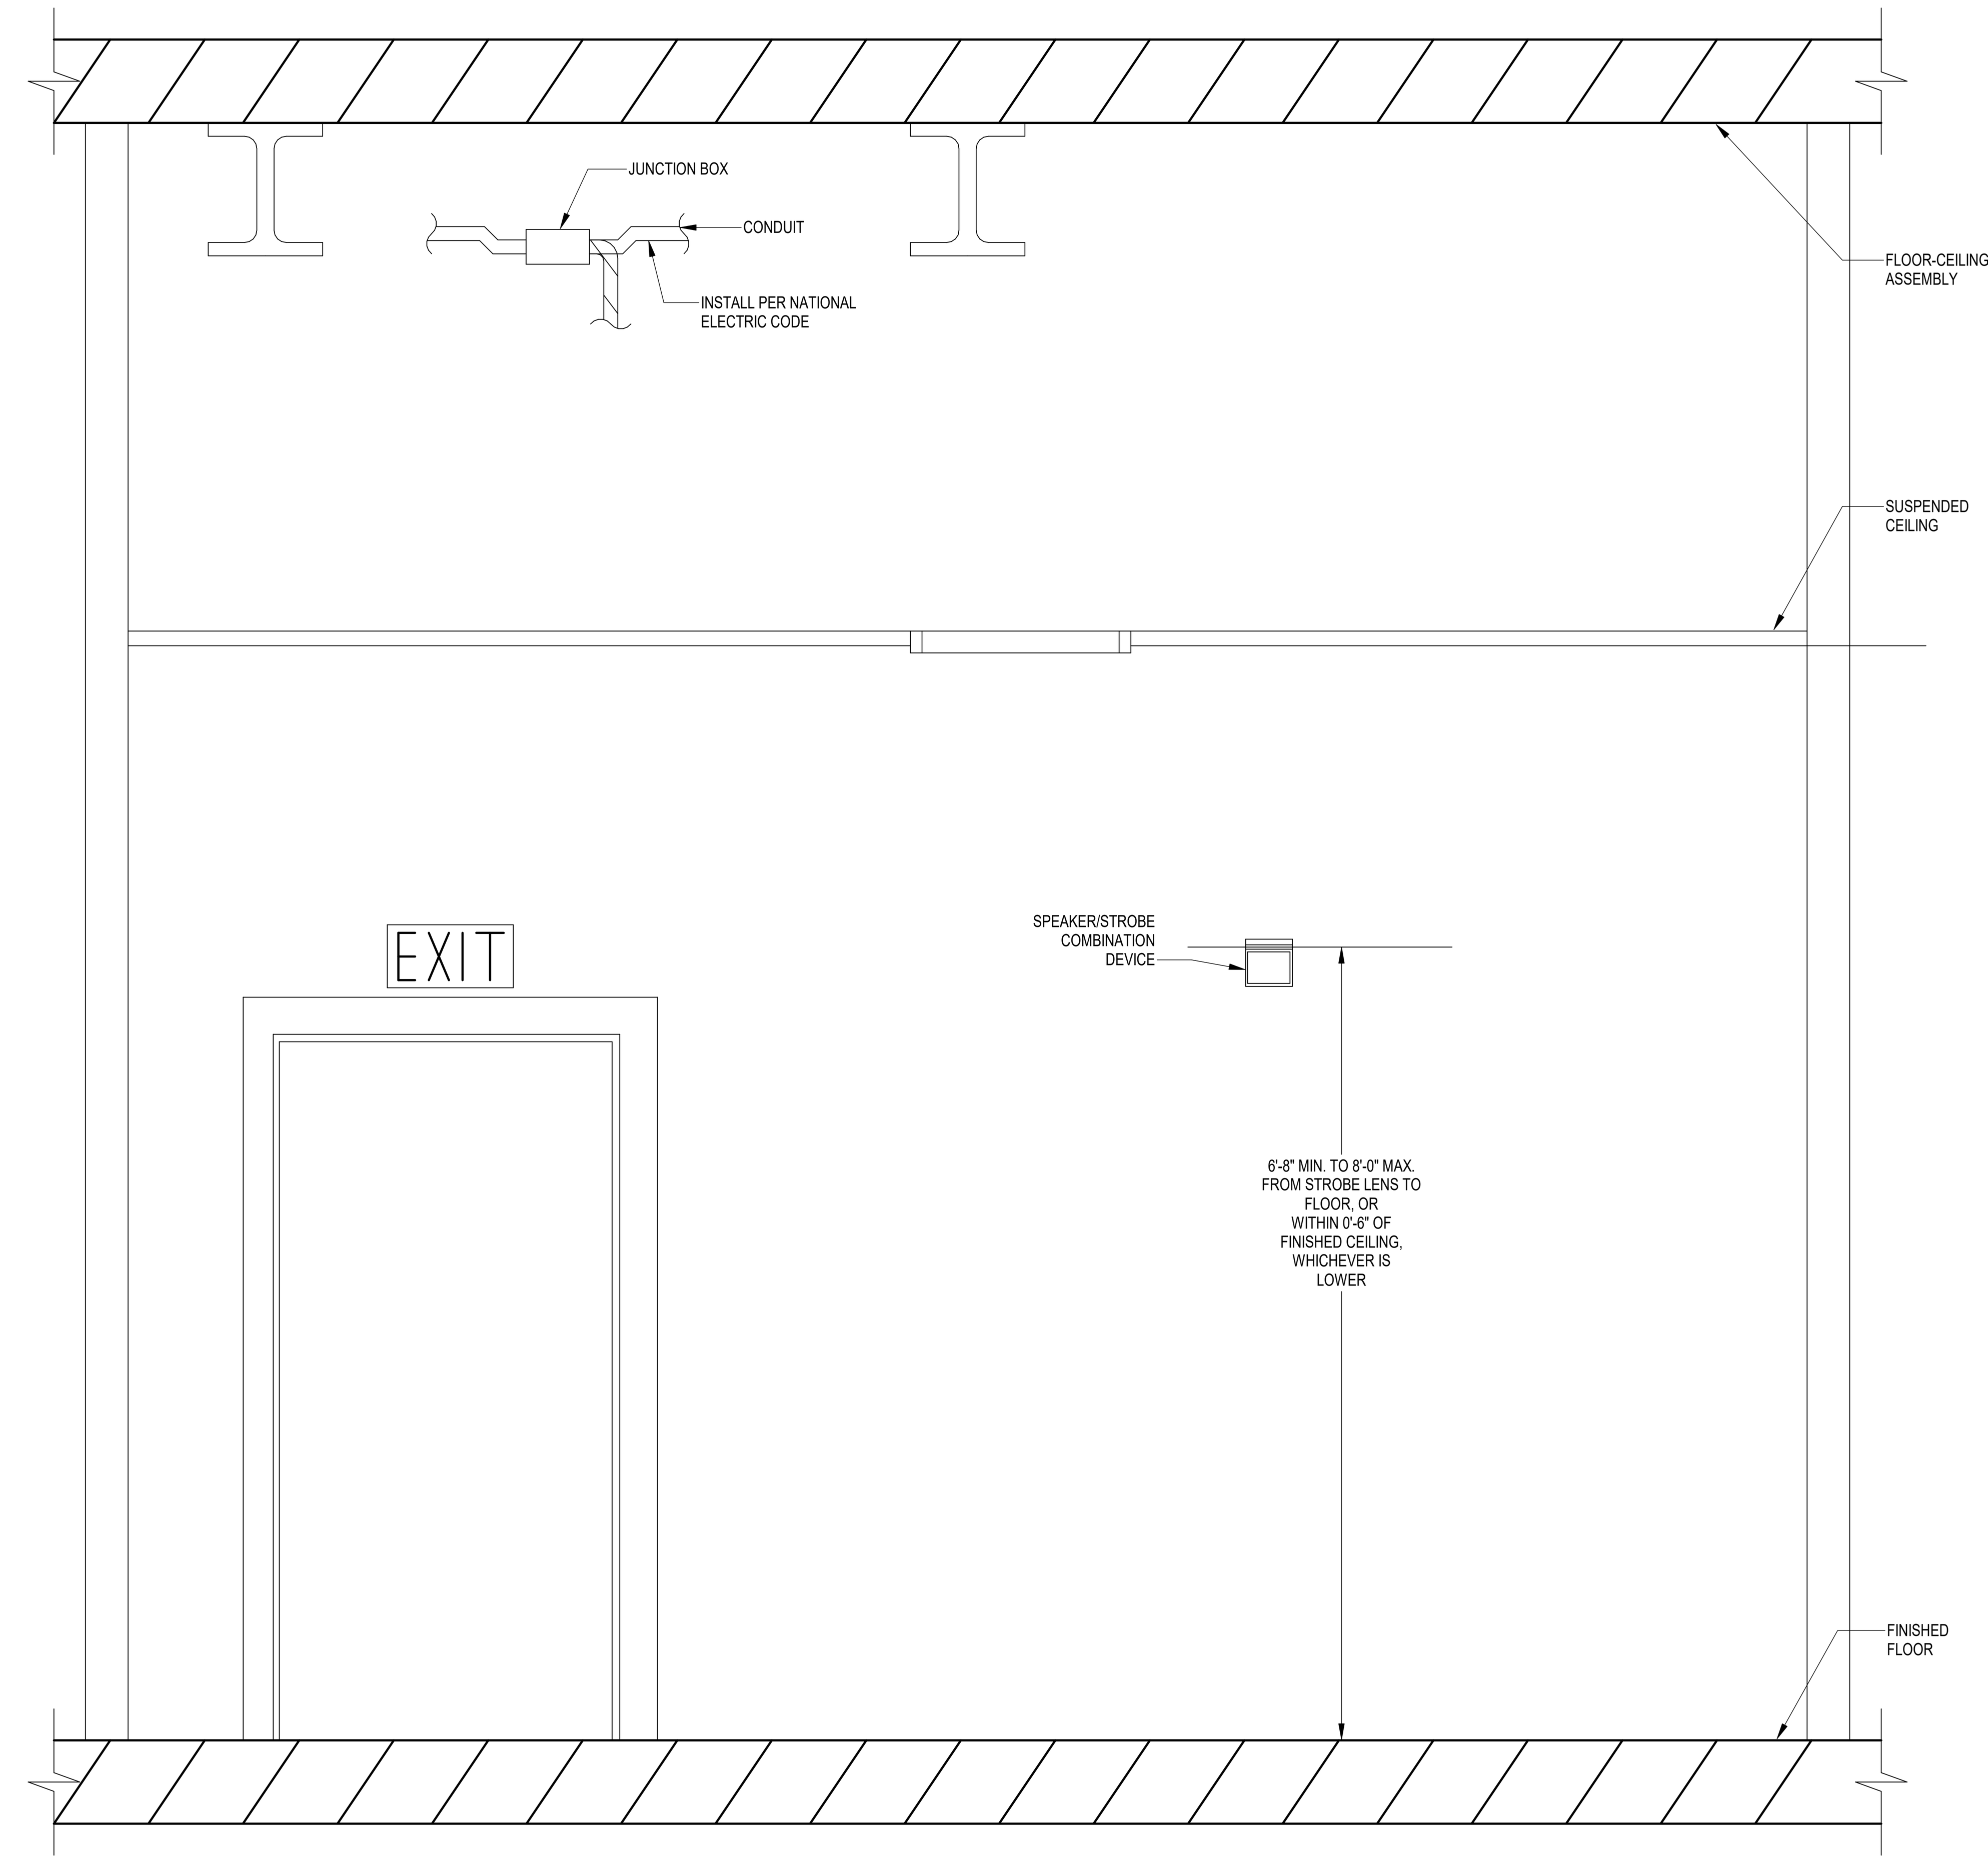

NOTE: MOUNT FIRE ALARM DEVICES ON APPROVED BOXES.

1 FIRE ALARM DEVICE MOUNTING DETAIL
N.T.S.

Revisions: | Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
THOMAS D. BLISS
ENGINEER
PE077256

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	FIRE ALARM DETAILS
Approved:	
Phase	100% CONTRACT DOCUMENTS FOR BIDDING
	FULLY SPRINKLERED
Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	TDB
Drawn	WWS
Project Number	657-23-104JC
Building Number	
Drawing Number	FA-501

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

3/6/2026 1:06:06 PM

COORDINATION NOTES

STRUCTURED CABLING SYSTEM (SCS):
THE SCS CONTRACTOR (SCSC) SHALL PROVIDE ALL HORIZONTAL CABLING, COMPONENTS AND TERMINATIONS AS REQUIRED FOR A COMPLETE AND OPERATIONAL CABLING SYSTEM PER INDUSTRY BEST PRACTICES AS PRESCRIBED BY BICSI AND NEC.

THE SCSC SHALL BE RESPONSIBLE FOR COORDINATION WITH THE ELECTRICAL CONTRACTOR (EC) FOR SPECIFIC LOCATIONS OF ALL TELECOMMUNICATIONS SYSTEM DEVICES, INCLUDING ANCILLARY SYSTEM COMPONENTS AND ASSOCIATED CONDUITS PROVIDED BY THE EC.

THE ELECTRICAL CONTRACTOR (EC) SHALL BE RESPONSIBLE FOR PROVIDING AND INSTALLING ALL ROUGH-IN COMPONENTS ASSOCIATED WITH THE TELECOMMUNICATIONS SYSTEM COMPONENTS AS NOTED ON THE DRAWINGS AND SPECIFICATIONS, INCLUDING BUT NOT LIMITED TO, CONDUIT AND BACK-BOXES. THE EC SHALL COORDINATE ALL REQUIREMENTS WITH THE SCS CONTRACTOR.

EXISTING TELECOM ROOM (TR) EQUIPMENT RACKS:
THE VA SHALL BE RESPONSIBLE FOR FURNISHING AND INSTALLING ALL ACTIVE EQUIPMENT, CONTROLLERS, SWITCHES, ETC. THAT RESIDE WITHIN THESE RACKS.

FIRESTOPPING:
THE EC SHALL BE RESPONSIBLE FOR FIRE-STOPPING SLEEVE ASSEMBLIES TO OBTAIN A UL RATING.

THE SCSC SHALL BE RESPONSIBLE FOR FIRE-STOPPING INSIDE THE SLEEVES AFTER CABLE INSTALLATION IS COMPLETE.

CASEWORK / MILLWORK:
THE SCSC SHALL BE RESPONSIBLE FOR INSTALLING TELECOMMUNICATIONS OUTLETS IN CASEWORK, AS REQUIRED. CABLES SHALL BE CONCEALED IN CASEWORK.

THE EC SHALL BE RESPONSIBLE FOR INSTALLING ASSOCIATED CONDUIT AND BACK-BOXES AND SHALL STUB CONDUIT TO THE ABOVE ACCESSIBLE CEILING SPACE.

CONDUIT:
THE EC SHALL BE RESPONSIBLE TO PROVIDE AND INSTALL ALL HORIZONTAL CABLING PATHWAYS. THIS SHALL INCLUDE ALL INTERIOR CONDUITS, PATHWAY COMPONENTS SUCH AS JUNCTION BOXES, PULL BOXES, WALL/CEILING PENETRATIONS AND CONDUIT SLEEVES, WHETHER SHOWN ON THE DRAWINGS OR AS REQUIRED TO PENETRATE FULL-HEIGHT PARTITIONS AS SHOWN ON THE DRAWINGS. THE EC SHALL PROVIDE AND INSTALL ALL BUSHINGS ON TELECOMMUNICATIONS CONDUITS PRIOR TO INSTALLATION OF CABLING.

THE SCSC SHALL BE RESPONSIBLE FOR ALL WIRE RACEWAYS, AND OTHER REQUIREMENTS FOR ROUTING AND SECURING CABLE INSIDE THE MAIN TELECOMMUNICATIONS ROOM (MTR) AND ALL TR'S.

TELECOMMUNICATIONS COMMUNICATIONS OUTLETS (C.O.'S) AND DEVICES:
THE EC SHALL BE RESPONSIBLE FOR PROVIDING AND INSTALLING ALL CONDUIT AND BACK-BOXES ASSOCIATED WITH THE TELECOMMUNICATIONS C.O.'S AND DEVICES.

THE SCSC SHALL BE RESPONSIBLE FOR INSTALLATION OF ALL STRUCTURED CABLING, JACKS, FACEPLATES AND JUMPER/PATCH CORDS.

TELECOMMUNICATIONS ABBREVIATIONS

A/C UNIT	AIR CONDITIONING UNIT
A/E	ARCHITECT/ENGINEER
AAP	ALARM ANNUNCIATOR PANEL
AC	ALTERNATING CURRENT OR ARMORED CABLE
ACC	ACCESSIBLE
ADDL	ADDITIONAL
ADJ	ADJACENT, ADJOINING
ADO	AUTOMATIC DOOR OPENER
AFC	ABOVE FINISHED COUNTER
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AHJ	AUTHORITY HAVING JURISDICTION
ALT	ALTERNATE
AMB OR A	AMBIENT
ARCH	ARCHITECT
ATS	AUTOMATIC TRANSFER SWITCH
AUTO	AUTOMATIC
AV	AUDIO VISUAL
BAT	BATTERY
BBC	BONDING BACKBONE CONDUCTOR
BC	BARE COPPER
BD	BOARD
BFF	BELOW FINISH FLOOR
BLDG	BUILDING
BPIP	BOILER PLANT INSTRUMENTATION PANEL
BYP	BY PASS
C	CONDUIT
CAB	CABINET
CALC	CALCULATE
CAP	CAPACITY
CAT	CATALOG
CATV	COMMUNITY ANTENNA TELEVISION
CCR	CONTROL CONTACTOR
CCTV	CLOSED CIRCUIT TELEVISION
CD	CONSTRUCTION DOCUMENTS
CF	CONTRACTOR FURNISHED
CF/CI	CONTRACTOR FURNISHED/CONTRACTOR INSTALLED
CF/OI	CONTRACTOR FURNISHED/OWNER INSTALLED
CFE	CONTRACTOR FURNISHED EQUIPMENT
CLG	CEILING
CMU	CONCRETE MASONRY UNIT
COAX	COAX CABLE
COMM	COMMUNICATION
COMPT	COMPARTMENT
CONC	CONCRETE
CONT	CONTINUE
CONTR	CONTRACTOR
COORD	COORDINATE
CTV	CABLE TELEVISION
CU	COPPER
CU FT	CUBIC FEET
CUR	CURRENT
DB	DECIBEL OR DIRECT BURIAL
DC	DIRECT CURRENT
DEG C	DEGREES CELSIUS
DEG F	DEGREES FAHRENHEIT
DEMO	DEMOLITION
DIAG	DIAGRAM
DISTR	DISTRIBUTION
DN	DOWN
DRSW	DOOR SWITCH
DWG	DRAWING
EC	EMPTY CONDUIT
EG	EQUIPMENT GROUND
EL	ELEVATION
ELEC	ELECTRIC OR ELECTRICAL
ELEV	ELEVATOR
EMER	EMERGENCY
EMI	ELECTROMAGNETIC INTERFERENCE
EMT	ELECTRICAL METALLIC TUBING
ENCL	ENCLOSURE
EPO	EMERGENCY POWER OFF
ESMT	EASEMENT
EXIST	EXISTING
FLEX	FLEXIBLE METALLIC CONDUIT
FOUTT	TELEPHONE FLOOR OUTLET
FP	FIRE PROTECTION
FT	FEET OR FOOT
G OR GND	GROUND OR GENERATOR
GEN	GENERATOR
GTB	GROUND TERMINAL BOX
HT	HEIGHT
HZ	HERTZ
IMC	INTERMEDIATE METAL CONDUIT
IR	INFRARED
J-BOX	JUNCTION BOX
LF	LINEAR FEET (FOOT)
LTNG	LIGHTNING
LV	LOW VOLTAGE
MATV	MASTER ANTENNA TELEVISION SYSTEM
MAX	MAXIMUM
MECH	MECHANICAL
MH	MANHOLE
MIN	MINIMUM
MT	MOUNT
MTD	MOUNTED
MTG	MOUNTING
NA	NOT APPLICABLE
NEC	NATIONAL ELECTRICAL CODE
NEUT OR N	NEUTRAL
NIC	NOT IN CONTRACT
NS	NO SCALE
NTS	NOT TO SCALE
OC	ON CENTER
OD	OUTSIDE DIAMETER
P	POLE
PA	PUBLIC ADDRESS
PB	PANELBOARD, PULL BOX, OR PUSHBUTTON
PBB	PRIMARY BONDING BUSBAR
PBPU	PREFABRICATED BEDSIDE PATIENT UNIT
PED	PEDESTAL
PEND	PENDANT
PF	POWER FACTOR
PH	PHASE
PNL	PANEL
PVC	POLYVINYL CHLORIDE (PLASTIC)
PWR	POWER
RCP	REFLECTED CEILING PLAN
REC	RECESSED
RECPT	RECEPTACLE
RGS	RIGID GALVANIZED STEEL
RM	ROOM
REQD	REQUIRED
SF	SQUARE FOOT (FEET)
SHT	SHEET
SI	INTERNATIONAL SYSTEM OF UNITS
SPEC	SPECIFICATION
SURF	SURFACE
SW	SWITCH
TBC	TELECOMMUNICATIONS BONDING BUSBAR
TEL	TELEPHONE
TP	TWISTED PAIR
TPS	TWISTED PAIR SHIELDED
TTB	TELEPHONE TERMINAL BOARD
TV	TELEVISION
TYP	TYPICAL
MSB	MAIN SWITCH BOARD
UFD	UNDERFLOOR DUCT
UGND	UNDERGROUND
UL	UNDERWRITERS LABORATORY
UON	UNLESS OTHERWISE NOTED
UPS	UNINTERRUPTIBLE POWER SUPPLY
UTIL	UTILITY
V	VOLT
WP	WEATHERPROOF

COMMUNICATION SYMBOLS

SYMBOL	DESCRIPTION
▼CH	WORK AREA TCO, COMBINATION TELEPHONE/DATA COMMUNICATION OUTLET - 4 DATA PORT FACE PLATE WITH 4 DATA PORTS - (1) CAT6A CABLE PER PORT. CH = COUNTER HEIGHT
N 2	NURSE CALL STATION: 2 = DUPLICATE FACILITIES FOR TWO BEDS (SEPARATE INDICATORS AT MASTER STATION) MTD 5'-0" AFF UNLESS OTHERWISE NOTED D = DUTY STATION. MTD 5'-0" AFF UNLESS NOTED NOTED. T = PULL CORD MTD 6'-0" AFF FOR SHOWER LOCATION, MTD 4'-6" AFF FOR TUB LOCATION, & MTD 3'-0" AFF FOR TOILET LOCATION. E = STAFF ASSISTANCE MTD 5'-0" AFF. B = CODE BLUE P = PATIENT BED STATION S = AUDIO VISUAL WALL STATION (STAFF) MTD 5'-0" AFF UNLESS OTHERWISE NOTED. U = UTILITY CALL STATION, MTD 5'-0" AFF UNLESS OTHERWISE NOTED.
2 N	NURSE CALL CORRIDOR DOME LIGHT WITH SOUNDER: 2 = NURSE'S CALL DOME LIGHT (SUFFIX INDICATES NUMBER OF LAMP) MTD 6" ABOVE DOOR. Z = AUXILIARY INTERSECTIONAL DOME LIGHT.

DEVICE MOUNTING LOCATION AND HEIGHT NOTES:

1. FOR WHEELCHAIR PATIENT USE MOUNT TELEPHONE OUTLET 36" AFF TO BOTTOM OF OUTLET BOX.
2. DESK PHONES - MOUNT OUTLET 1'-6" AFF.
3. PAY PHONES - MOUNT OUTLET 4'-0" AFF
4. HEIGHT OF TELECART OUTLETS SHALL BE AS INDICATED ON BEDWALLS OR PBPU DETAILS.
5. SEE VA BARRIER FREE DESIGN GUIDE PG-18-13.

SHEET LIST

SHEET NUMBER	SHEET NAME
T-001	TELECOMMUNICATIONS LEGEND, ABBREVIATIONS, & GENERAL NOTES
TD101	SECOND FLOOR PLAN - TELECOM - DEMOLITION
TN101	SECOND FLOOR PLAN - TELECOM - NEW WORK
T-501	TELECOM - DETAILS

GENERAL NOTES

1. PRODUCTS SHALL BE OF MATERIALS THAT ARE SUITABLE FOR THE ENVIRONMENT IN WHICH THEY ARE TO BE INSTALLED.
2. WORKING CLEARANCES AROUND ELECTRICAL EQUIPMENT SHALL BE MAINTAINED IN COMPLIANCE WITH THE NATIONAL ELECTRICAL CODE ARTICLE 110, COORDINATE EQUIPMENT INSTALLATION TO MAINTAIN REQUIRED CLEARANCES.
3. IF AN OUTLET BOX IS REQUIRED TO BE LOCATED IN AN ASSEMBLY OR PARTITION RATED AS "FIRE/SMOKE" OR "SMOKE" OR IDENTIFIED AS EITHER "FIRE/SMOKE" OR "SMOKE", THEN ALL OF THE FOLLOWING CONDITIONS SHALL BE MET:
   A. THE OUTLET BOX SHALL BE METALLIC.
   B. THE OUTLET BOX OPENINGS SHALL OCCUR ONLY ON ONE SIDE OF THE FRAMING SPACE.
   C. THE OUTLET BOX OPENINGS SHALL NOT EXCEED 16 SQUARE INCHES.
   D. ALL CLEARANCES BETWEEN THE OUTLET BOX AND THE WALL BOARD MATERIAL SHALL BE COMPLETELY SEALED WITH APPROVED MATERIALS IN ACCORDANCE WITH THE APPLICABLE CODES AND STANDARDS FOR THE PROJECT.
   E. PROVIDE A SUPPLEMENTAL BARRIER AROUND OUTLETS LARGER THAN 16 INCHES SO THAT THE ORIGINAL RATING OF THE PENETRATION IS MAINTAINED.
   F. THE TOTAL AGGREGATE SURFACE AREA OF THE OUTLET BOX SHALL NOT EXCEED 100 SQUARE INCHES PER 100 SQUARE FEET.
   G. THE OUTLET BOX SHALL BE SEPARATED FROM OPENINGS ON THE OPPOSITE SIDE OF THE RATED PARTITION BY A MINIMUM HORIZONTAL DISTANCE OF 24 INCHES.
   H. THE OUTLET BOX SHALL BE SECURELY FASTENED TO A PARTITION FRAMING MEMBER BY MEANS OF AN APPROVED ATTACHMENT METHOD.
   I. OPENINGS CUT INTO THE WALL BOARD MATERIAL SHALL NOT EXCEED 1/8 INCH BETWEEN THE EDGES OF THE OUTLET BOX AND THE EDGES OF THE OPENING.
4. LOCATIONS OF EQUIPMENT SHOWN ON THE DRAWINGS ARE APPROXIMATE, COORDINATE EXACT EQUIPMENT LOCATION AND CONNECTION REQUIREMENTS WITH THE APPROPRIATE TRADE PRIOR TO INSTALLATION.
5. FOR EXACT LOCATION OF CEILING MOUNTED EQUIPMENT REFER TO THE ARCHITECTURAL REFLECTED CEILING PLAN. LOCATIONS OF EQUIPMENT NOT INCLUDED ON THE REFLECTED CEILING PLAN SHALL BE COORDINATED WITH THOSE ITEMS SHOWN. COORDINATION OF CEILING MOUNTED EQUIPMENT SHALL BE PRIOR TO ANY ROUGH-IN. NOTIFY ARCHITECT OF ANY DISCREPANCY.
6. PROVIDE FINAL CONNECTIONS TO OWNER PROVIDED EQUIPMENT WHERE INDICATED ON THE PLAN DRAWINGS.
7. PRIOR TO ROUGH-IN AND INSTALLATION OF ANY FLOOR MOUNTED DEVICE, VERIFY LOCATION WITH THE ARCHITECT.
8. VERIFY AND COORDINATE THE LOCATION OF REQUIRED DIVISION 27 OUTLETS WITH OTHER TRADE DRAWINGS AND OWNER PROVIDED EQUIPMENT.
9. ALL RACEWAY SYSTEMS SHOWN TO SUPPORT THE INSTALLATION OF THE DIVISION 27 EQUIPMENT SHALL BE PROVIDED BY THE ELECTRICAL CONTRACTOR. PROVIDE COORDINATION FOR THE INSTALLATION OF THIS RACEWAY SYSTEM WITH THE ELECTRICAL CONTRACTOR.
10. EACH VOICE/DATA OUTLET LOCATION SHOWN, SHALL HAVE A DOUBLE GANG OUTLET BOX WITH A SINGLE GANG PLASTER RING AND (1) 1-1/2" CONDUIT STUBBED UP TO AN ACCESSIBLE LOCATION ABOVE THE FINISHED CEILING OR TO AN ACCESSIBLE CABLE TRAY WHERE PROVIDED. WORK BY ELECTRICAL CONTRACTOR PER SPECS.
11. ALL BONDING AND GROUNDING ELEMENTS UTILIZED FOR STRUCTURED CABLING SYSTEM SHALL BE IN COMPLIANCE WITH SPECIFICATION SECTION 262000.
12. PROVIDE ALL SLEEVES AS REQUIRED FOR ALL LOW VOLTAGE CABLE PATHWAYS. RESTORE THE FIRE RATING OF THE SURFACE.
13. CABLE INSTALLED BELOW SLAB SHALL HAVE INDOOR/OUTDOOR RATED JACKET FOR PROTECTION OF STRUCTURED CABLE.
14. TELECOMMUNICATIONS ROOM SHALL BE BONDED AND GROUNDED IN ACCORDANCE WITH TIA-607D.
15. ALL TELECOMMUNICATIONS CONDUITS SHALL BE PROVIDED WITH BUSHINGS AT EACH END FOR PROTECTION OF STRUCTURED CABLE.
16. CAT6A CABLE BUNDLE SIZES AND CABLES ENCLOSED IN CONDUITS SHALL NOT EXCEED CABLE QUANTITIES INDICATED IN NEC TABLE 725.144, UNLESS CABLES ARE UL LISTED AS X-LP (0.5A). TYPE 4 POE CABLES WITHOUT LP CERTIFICATION ARE SUBJECT TO INSPECTION TO ENSURE BUNDLE SIZE AND CURRENT LIMITATIONS PER NEC TABLE 725.144 ARE NOT EXCEEDED.
17. PROVIDE FACTORY PRE-TERMINATED CAT6A AND FIBER OPTIC CABLES WHEN DISTANCES ARE KNOWN. FIELD TERMINATED CABLES ARE ALLOWED IF KNOWN DISTANCES ARE NOT ABLE TO BE DETERMINED.
18. BUNDLE CABLES TOGETHER IN GROUPS OF RELEVANCE (FOR EXAMPLE, CABLES TO A SINGLE EQUIPMENT DISTRIBUTOR OR UPLINKS TO CORE DEVICES), AS THIS WILL EASE MANAGEMENT AND TROUBLESHOOTING.
19. BUNDLES OF CABLES, WHEN NECESSARY, SHOULD BE BUILT FROM SUB-BUNDLES OF NO MORE THAN 6-8 INDIVIDUAL CABLES. THE LARGER BUNDLES SHOULD NOT EXCEED FOUR SUB-BUNDLES OF LIKE QUANTITY.
20. WHEN BUNDLING OR SECURING CABLES, USE VELCRO-BASED TIES NOT MORE THAN EVERY 3 FT TO 6 FT, AND MORE FREQUENTLY AS NEEDED TO MAINTAIN A CLEAN INSTALLATION. DO NOT USE ZIP TIES OR TWIST TIES FOR CABLE BUNDLING OR SECURING, AS THESE APPLY PRESSURE ON THE CABLES.
21. ONLY BUNDLE LIKE CABLE TYPES. DO NOT BUNDLE FIBER, POWER, AND UTP TOGETHER.

PULL SCHEDULE REQUIREMENTS

CONTRACTOR SHALL PROVIDE PULL SCHEDULE WITH TELECOM SHOP DRAWINGS. TELECOM SHOP DRAWINGS WILL NOT BE REVIEWED UNLESS THEY INCLUDE PULL SCHEDULES.

CAT6A COPPER CABLE COLOR CODING

WHITE	- VOICE
YELLOW/GREEN/GREY	- DATA
ORANGE	- WIRELESS
VIOLET	- VIDEO SURVEILLANCE
BLUE	- NURSE CALL
RED	- FIRE ALARM
BLACK	- BAS & DAS

Revisions: Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
THOMAS D. BLISS
ENGINEER
PE077256

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
TELECOMMUNICATIONS LEGEND, ABBREVIATIONS, & GENERAL NOTES	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
Approved:	FULLY SPRINKLERED	Location: 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Building Number:
		Issue Date: 06 MARCH 2026 / Checked: TDB / Drawn: WWS	Drawing Number: T-001

DRAWING NOTES:

1. REFER TO SHEET TN101 FOR LOCATION OF TELECOMMUNICATIONS RACK SERVING TELECOMMUNICATIONS OUTLETS IN THIS AREA.

CODED NOTES:

1. DISCONNECT AND REMOVE EXISTING TELECOMM DEVICE. REMOVE EXISTING CONDUIT AND CABLING BACK TO TELECOMMUNICATIONS RACK.
2. DISCONNECT AND REMOVE EXISTING NURSE CALL DEVICE. REMOVE EXISTING CONDUIT AND CONDUCTORS BACK TO NEXT DEVICE ON CIRCUIT THAT IS INDICATED AS EXISTING TO REMAIN. ALL DEVICES EXISTING TO REMAIN SHALL REMAIN FUNTIONAL. IF NO OTHER DEVICES REMAIN ON CIRCUIT, REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE.

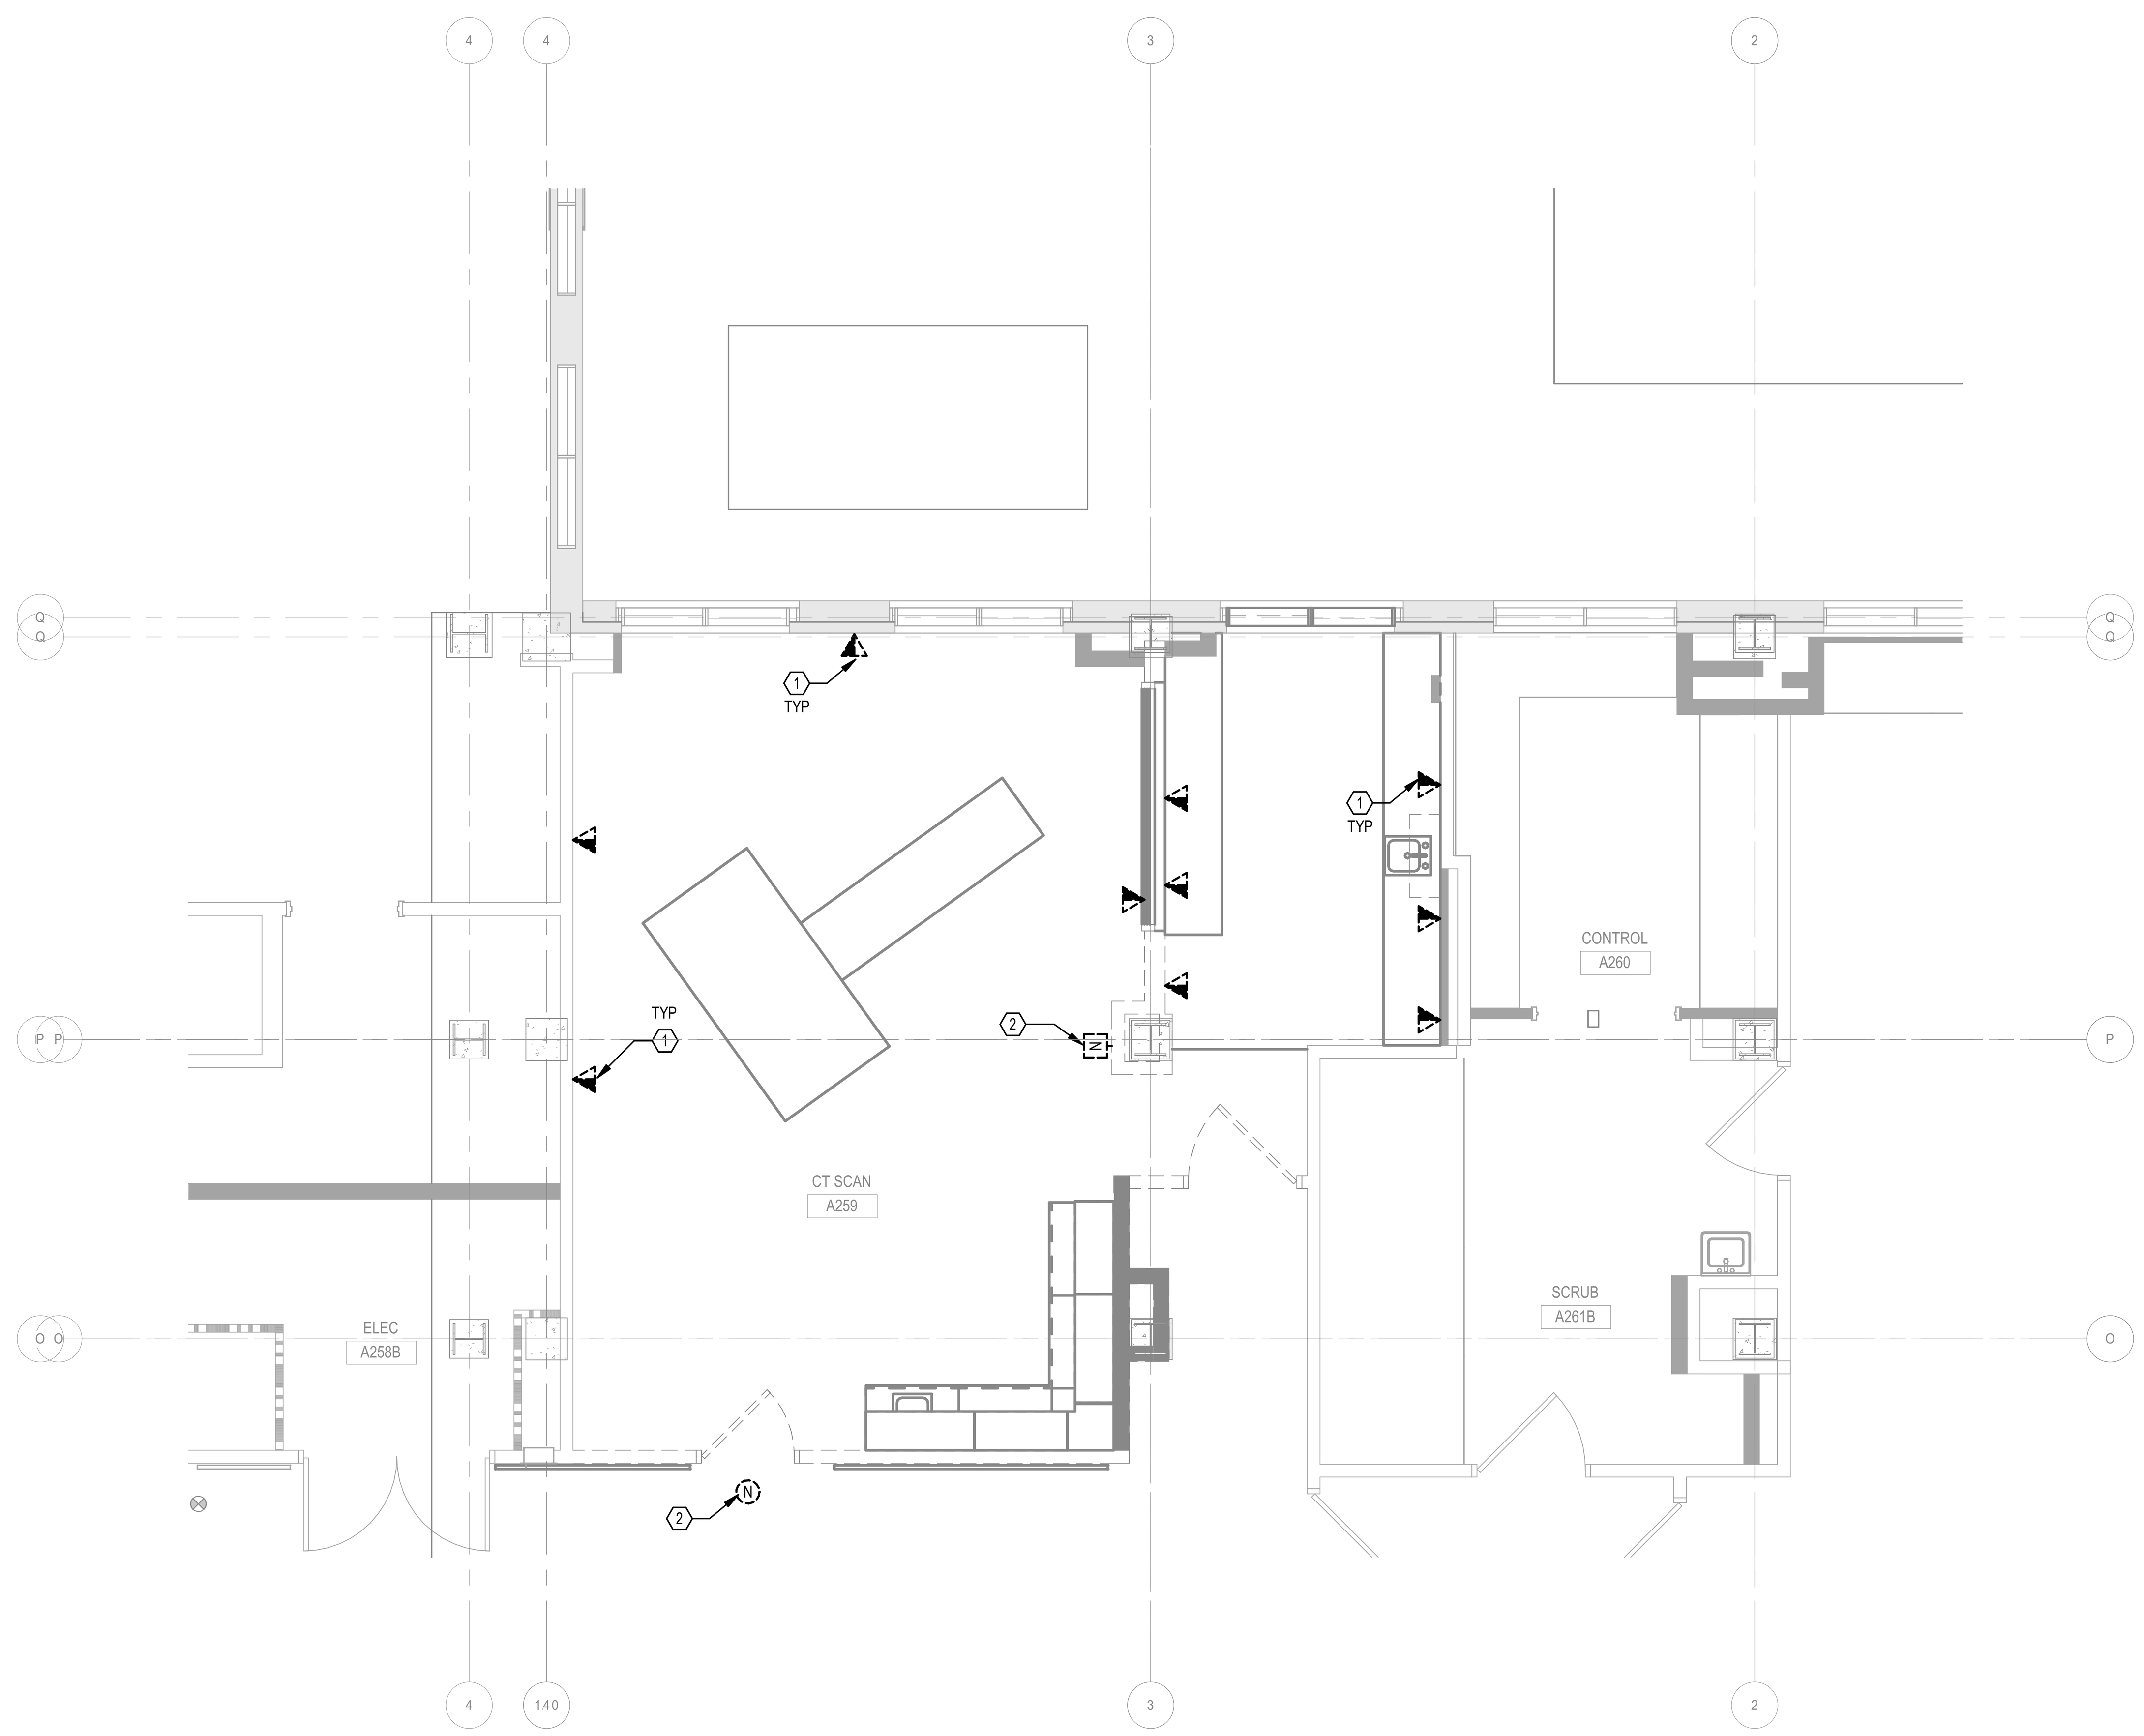

1 SECOND FLOOR PLAN - TELECOM - DEMOLITION
1/4" = 1'-0"

KEY PLAN

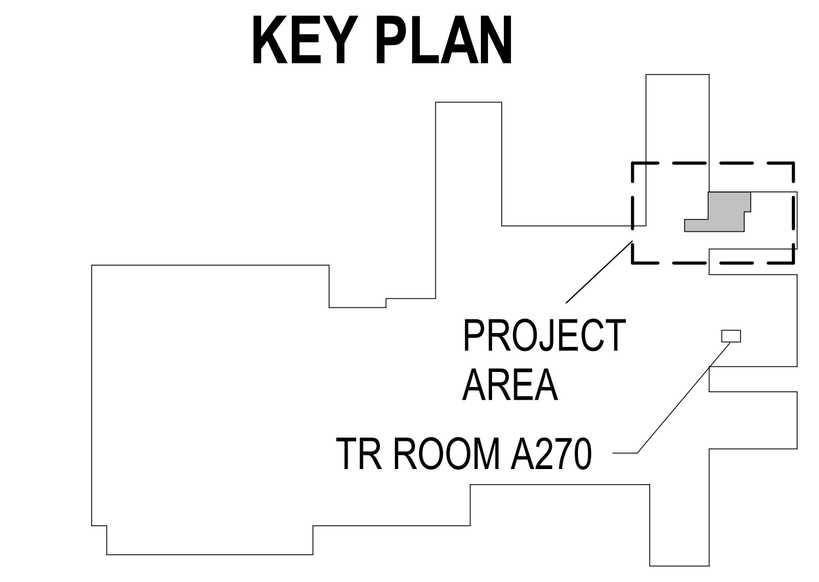

N
0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions: Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
THOMAS D. BLISS
ENGINEER
PE077256

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	Phase	Project Title	Project Number
SECOND FLOOR PLAN - TELECOM - DEMOLITION	100% CONTRACT DOCUMENTS FOR BIDDING	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259	657-23-104JC
			Building Number
Approved:	FULLY SPRINKLERED	Location 915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106	Drawing Number
		Issue Date: 06 MARCH 2026 · Checked: TDB · Drawn: WWS	TD101

DRAWING NOTES:

1. ALL COMMUNICATIONS CABLING SHALL BE CAT6A.

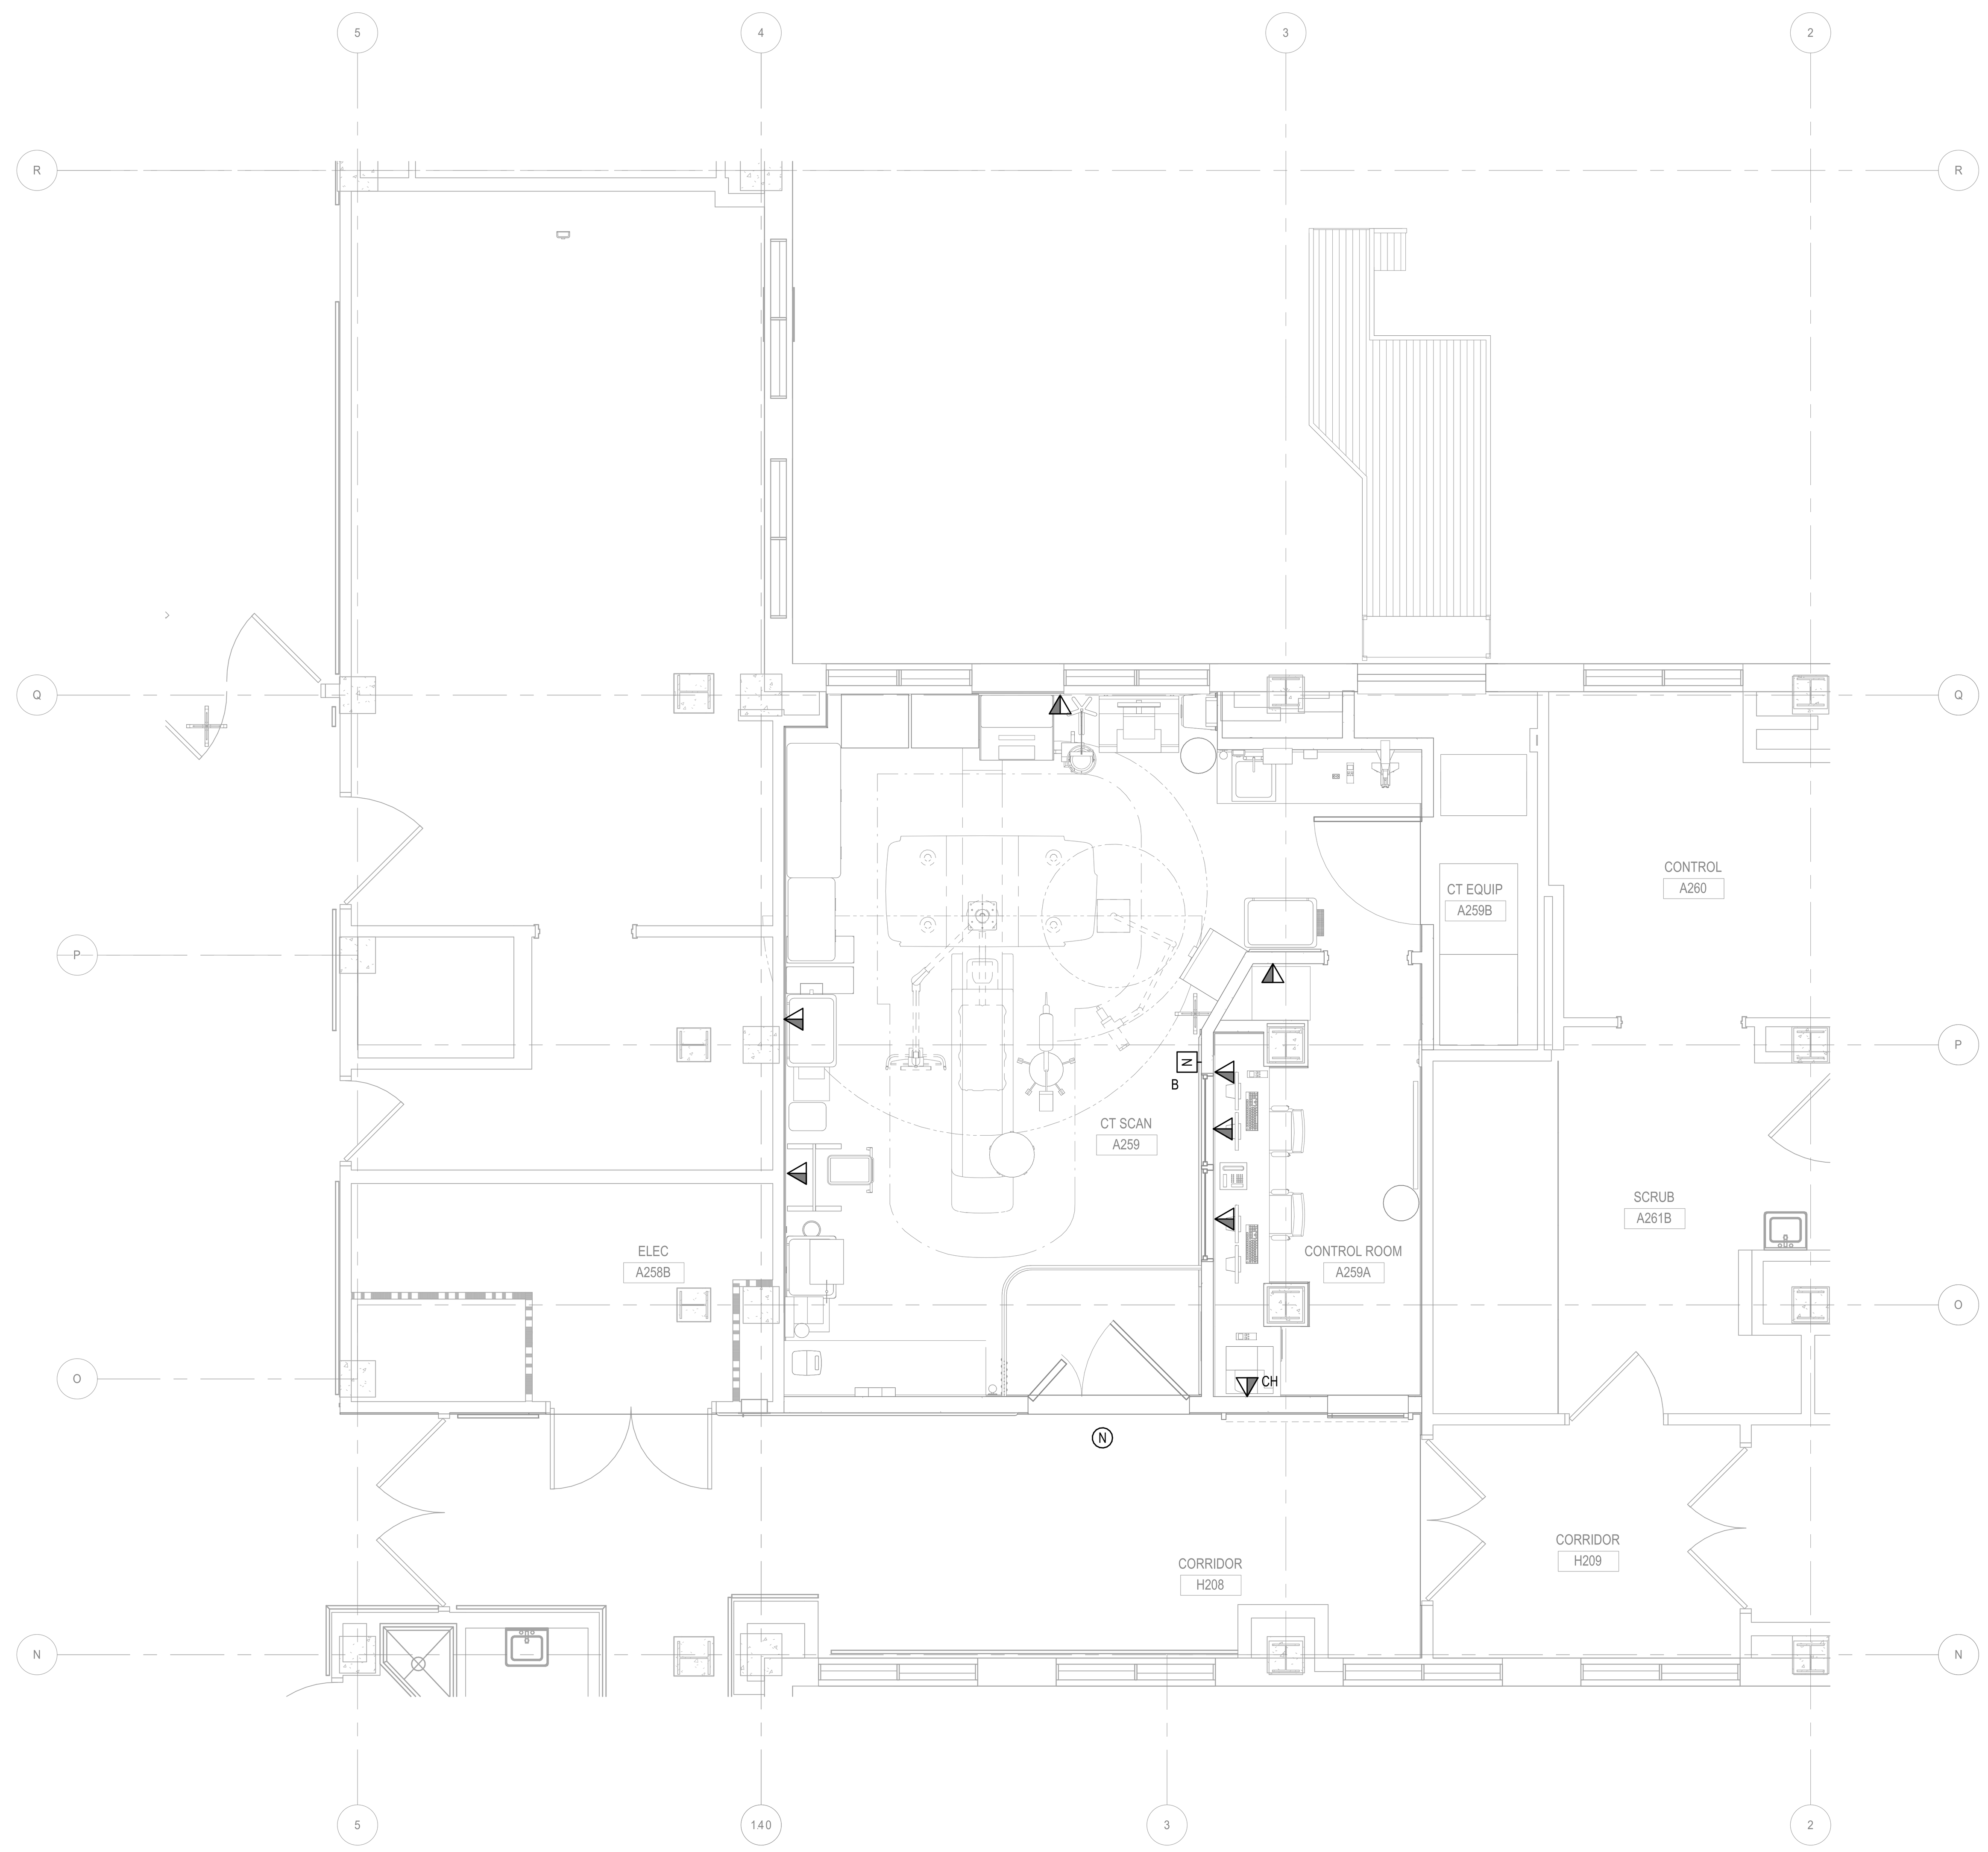

1 SECOND FLOOR PLAN - TELECOM - NEW WORK
1/4" = 1'-0"

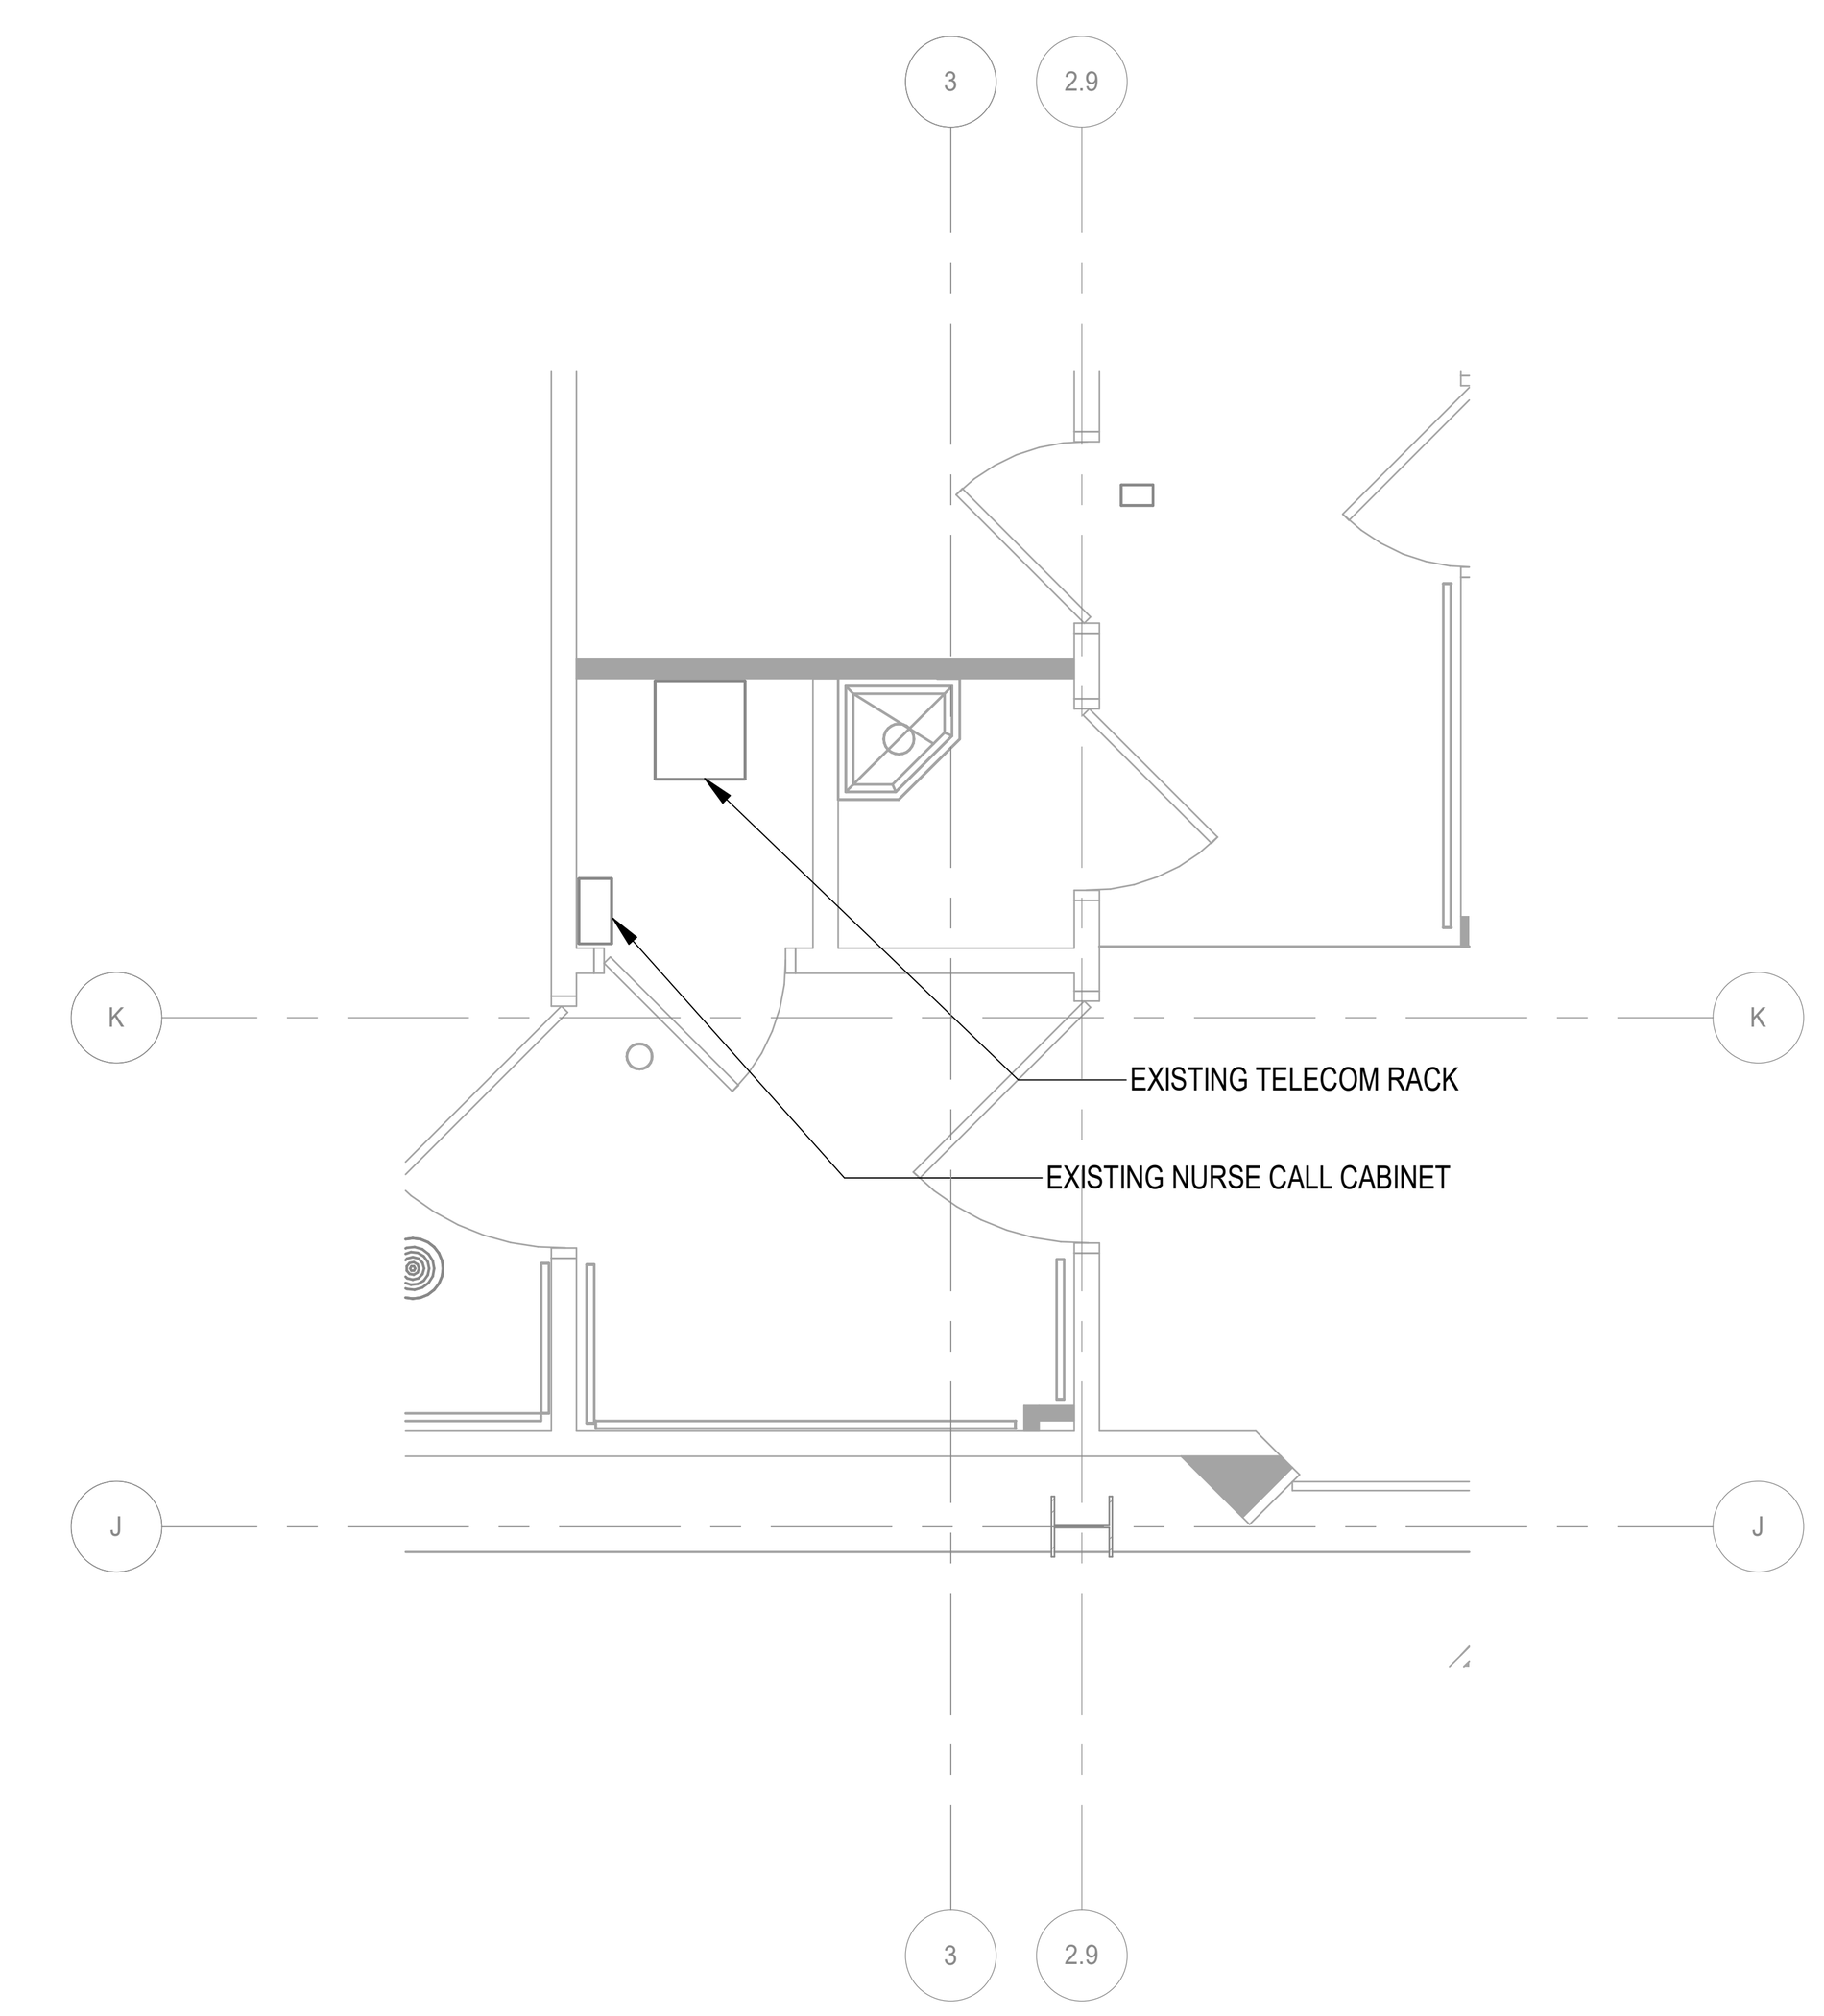

2 TR ROOM A270
1/4" = 1'-0"

KEY PLAN

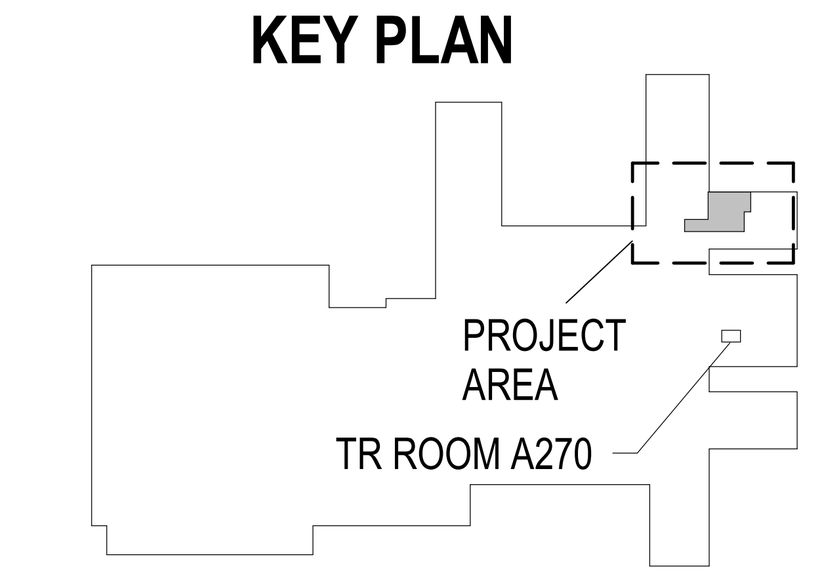

0 2' 4' 8' 12'
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
THOMAS D. BLISS
ENGINEER
PE077258

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	SECOND FLOOR PLAN - TELECOM - NEW WORK
Approved:	
Phase	100% CONTRACT DOCUMENTS FOR BIDDING
	FULLY SPRINKLERED
Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	TDB
Drawn	WWS
Project Number	657-23-104JC
Building Number	
Drawing Number	TN101

VA FORM 08 - 6231

3/6/2026 1:07:37 PM

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt

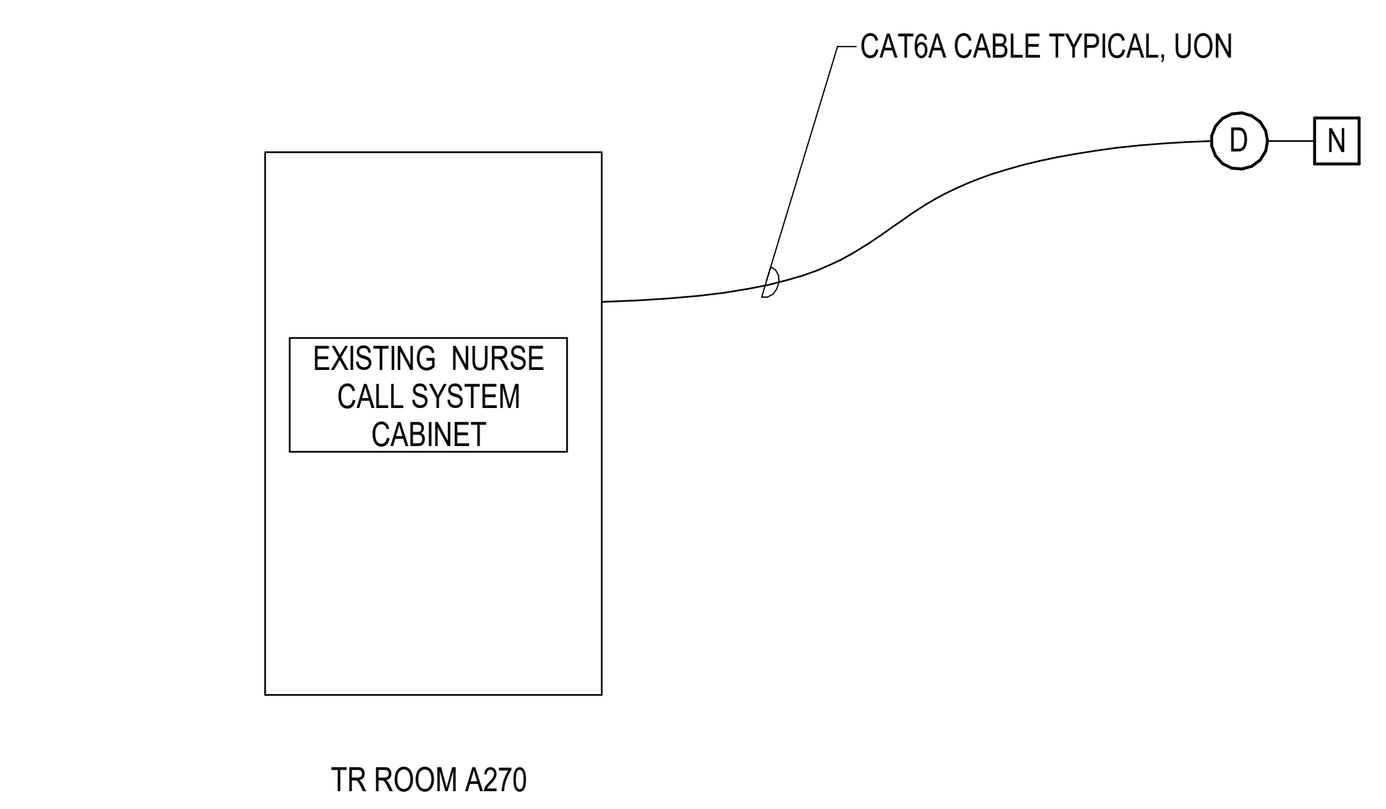

1 NURSE CALL DIAGRAM
N.T.S.

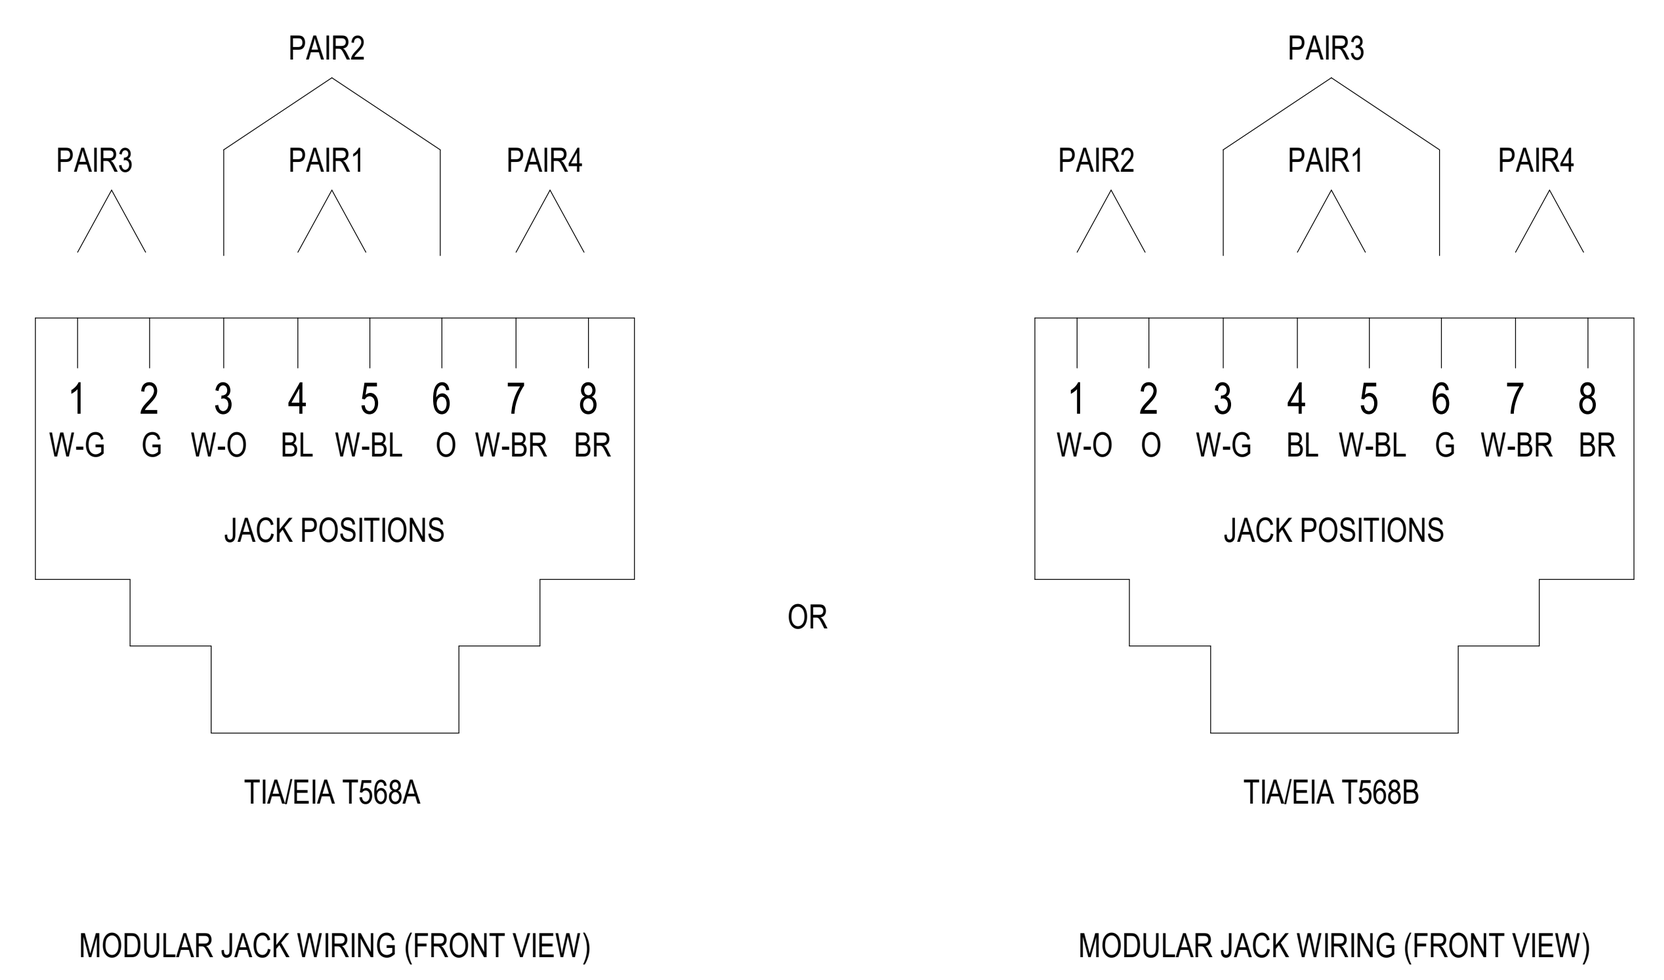

VERIFY CAMPUS STANDARD WITH CAMPUS IT REPRESENTATIVE PRIOR TO CONSTRUCTION.

2 MODULAR JACK WIRING DETAIL
N.T.S.

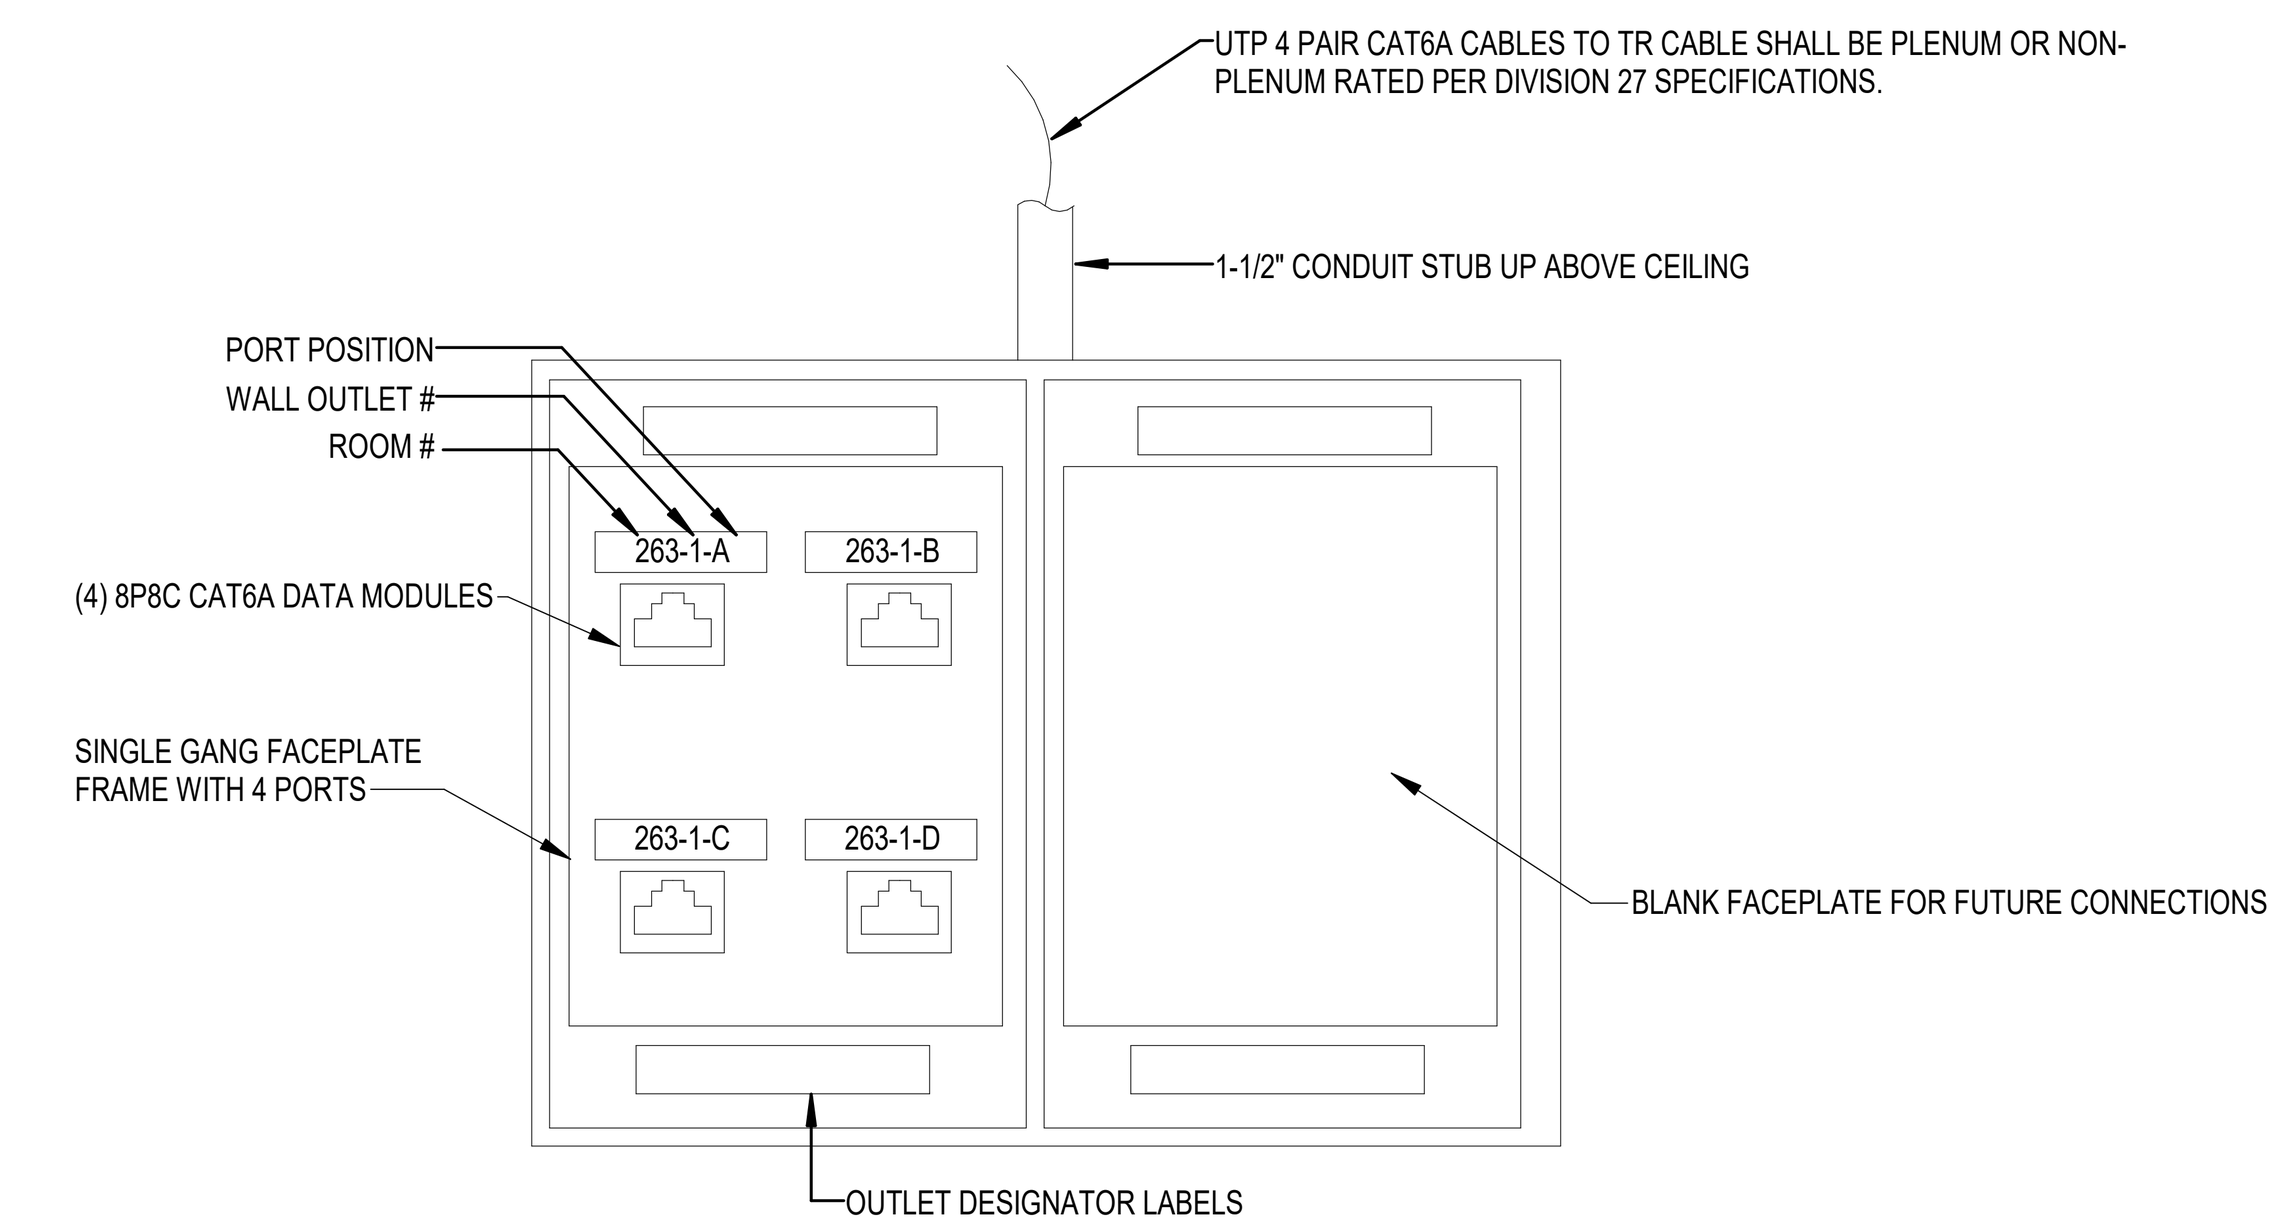


TCO PLAN SYMBOL

NOTES:

1. LABELING STANDARDS SHALL BE FOLLOWED FOR ROOM NUMBER OUTLET IS LOCATED IN, OUTLET POSITION IN ROOM (STARTING ON WALL TO LEFT OF ENTRY DOOR), AND PORT POSITION IN OUTLET - 101-1-A.

2. 8P8C CONNECTIONS IN WALL PLATES SHALL BE COLOR CODED TO MATCH CABLE COLORS INDICATED ON SHEET T-001.

3. WALL BOX SHALL BE DOUBLE-GANG TELECOMMUNICATIONS-RATED WORK BOX WITH RIGID CONDUIT EXTENDING TO THE HORIZONTAL PATHWAY.

3 WALL MOUNTED OUTLET - (TCO) VOICE/DATA
N.T.S.

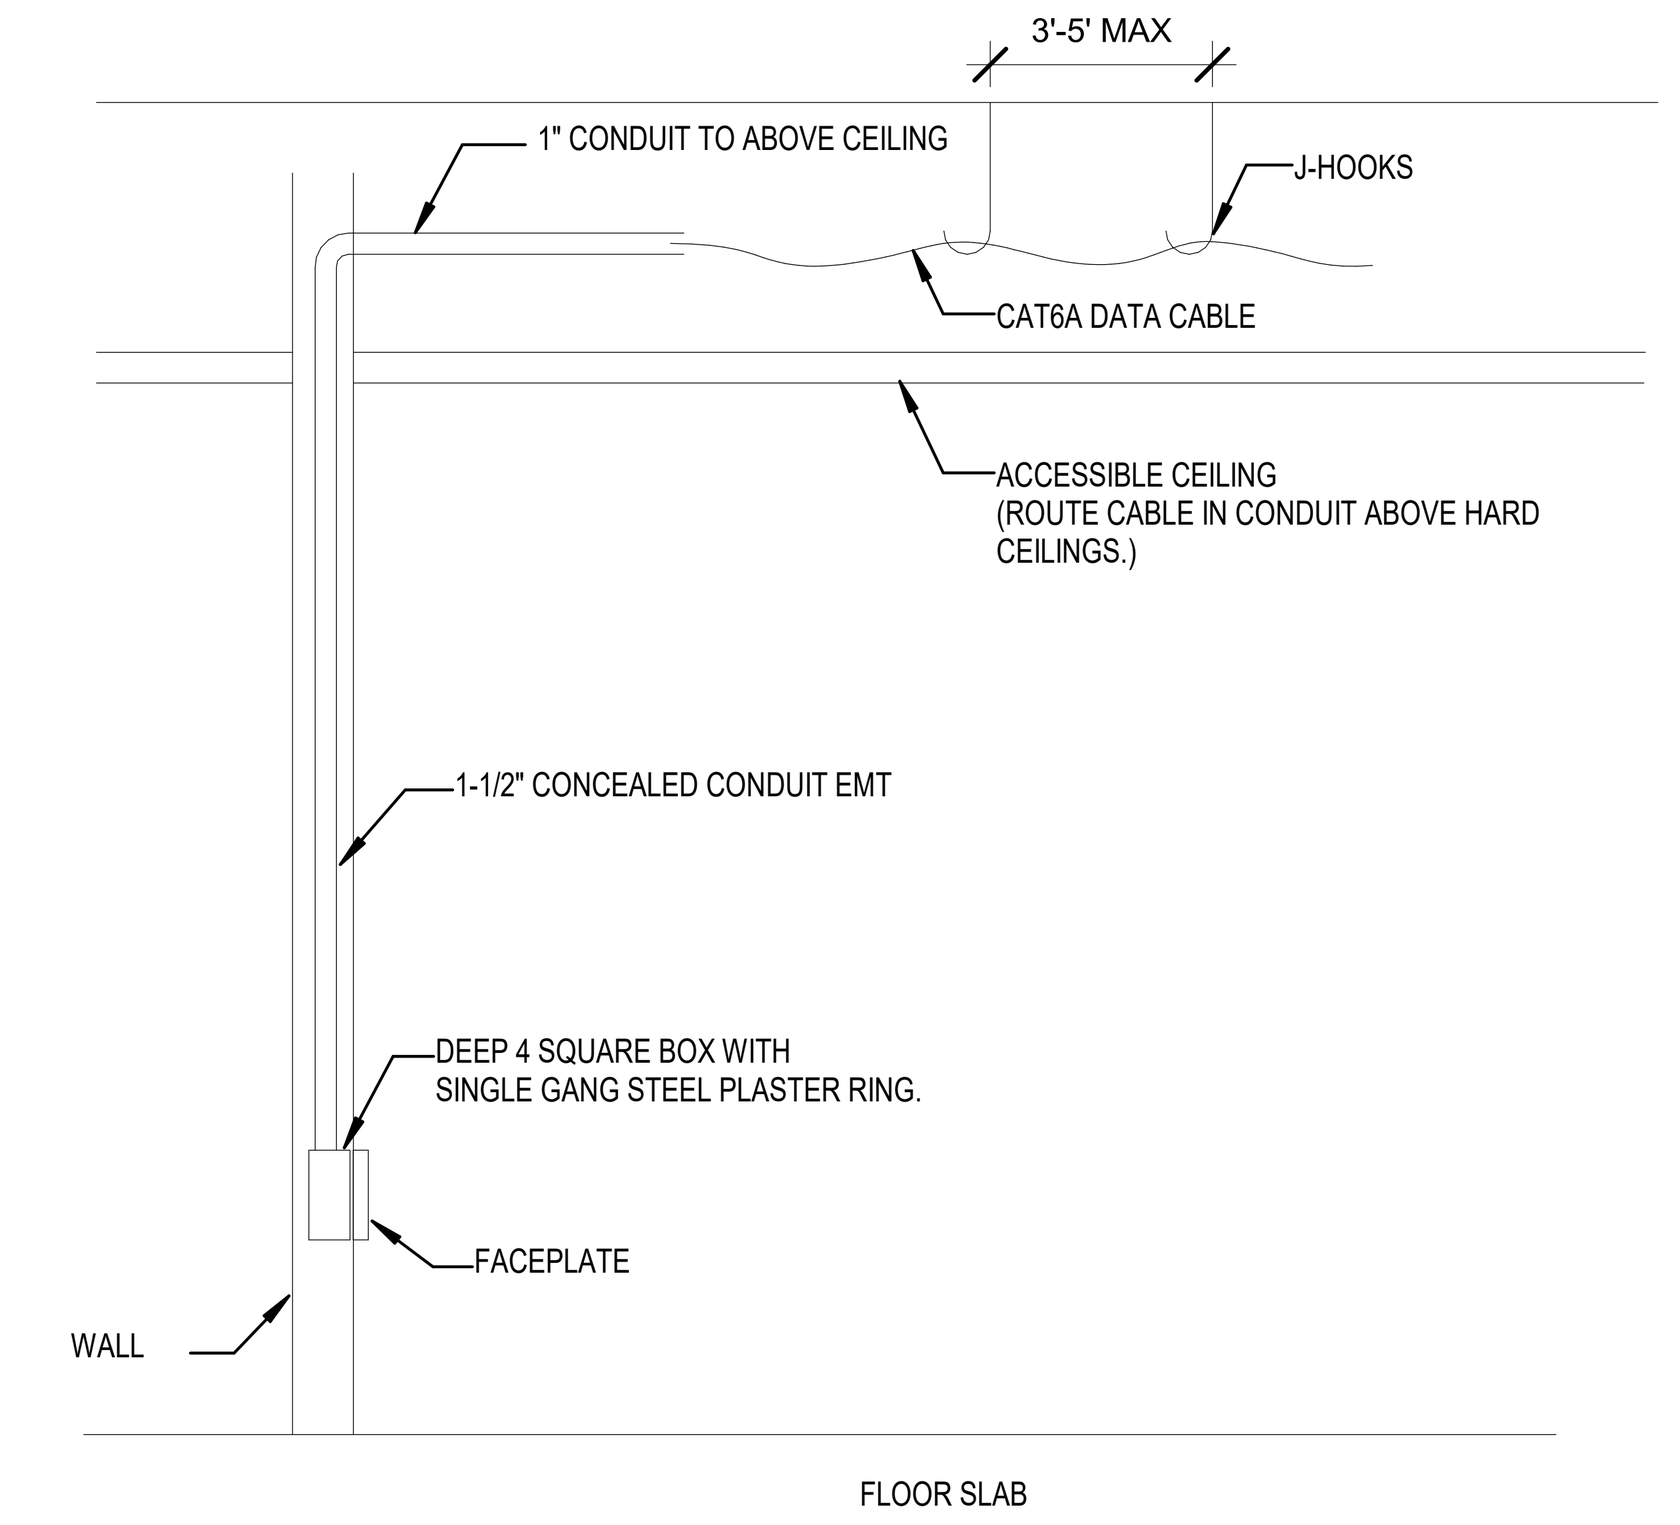

4 TYPICAL FLUSH OUTLET MOUNTING
N.T.S.

Revisions: | Date:

CONSULTANT

Above Group
ENGINEERING. DESIGN. CONSULTING.
305 East Drive, Suite H Melbourne, FL 32904 | (321) 345-9026 | www.abovegroupinc.com
www.abovegroupinc.com
COA/CA Lic. No. 31120
305 East Dr., Suite H,
Melbourne, Florida 32904
PH: 321.345.9026

ARCHITECT/ENGINEER OF RECORD

THINKFORM
THINKFORM DESIGN ARCHITECT LLC
38 EAST BROAD STREET
HOPEWELL, NJ 08525
T:855.821.0274 F:609.644.4397
Russell DiNardo, AIA NY 031521-1

STAMP

COMMONWEALTH OF PENNSYLVANIA
REGISTERED PROFESSIONAL
THOMAS D. BLISS
ENGINEER
PE077258

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	TELECOM - DETAILS
Approved:	
Phase	100% CONTRACT DOCUMENTS FOR BIDDING
	FULLY SPRINKLERED
Project Title	NEW COMPUTED TOMOGRAPHY UNIT, BLDG 1 RM A259
Location	915 GRAND BLVD. SAINT LOUIS, MISSOURI 63106
Issue Date	06 MARCH 2026
Checked	TDB
Drawn	WWS
Project Number	657-23-104JC
Building Number	
Drawing Number	T-501

VA FORM 08 - 6231

Autodesk Docs://24001 VA ST Louis CT/0124007 - St.Louis CT_R23_MEPFAFPT.rvt
3/6/2026 1:07:37 PM