


VELCRO HOOK



VELCRO LOOP


DOSIMETER PANEL FOR CHEST WITH NECK STRAP

NOT DRAWN TO SCALE

PART A - NECK STRAP

NOTES FOR PART A:

1. NECK STRAP IS MADE FROM 1" WIDE NYLON WEBBING (PC. 4) WITH 1" WIDE VELCRO PILE (PC. 2) SEWN ONTO WEBBING AS SHOWN.
2. ALTERNATE NECK STRAP LENGTHS ARE 37" OR 41" (IF REQUESTED).

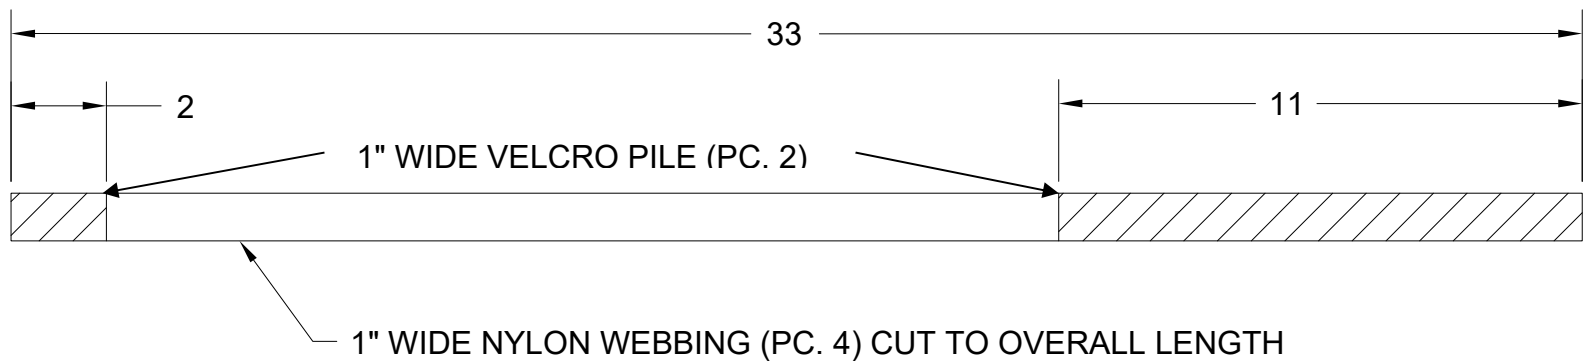

CODE 105.52 APPROVAL: /S/ D.M. STEIN
DATE: 6/18/09

DOSIMETER PANEL FOR CHEST WITH NECK STRAP

NOT DRAWN TO SCALE

PART B - DOSIMETER PANEL (FRONT VIEW)

VELCRO HOOK




VELCRO PILE

3/4" x 3/4" BOX STITCH

CORD LOOP (TYP.)
SEWN BETWEEN LAYERS OF
MATERIAL (SEE NOTE 3)

STRAIGHT STITCH

CLIP (SEE NOTE 2)

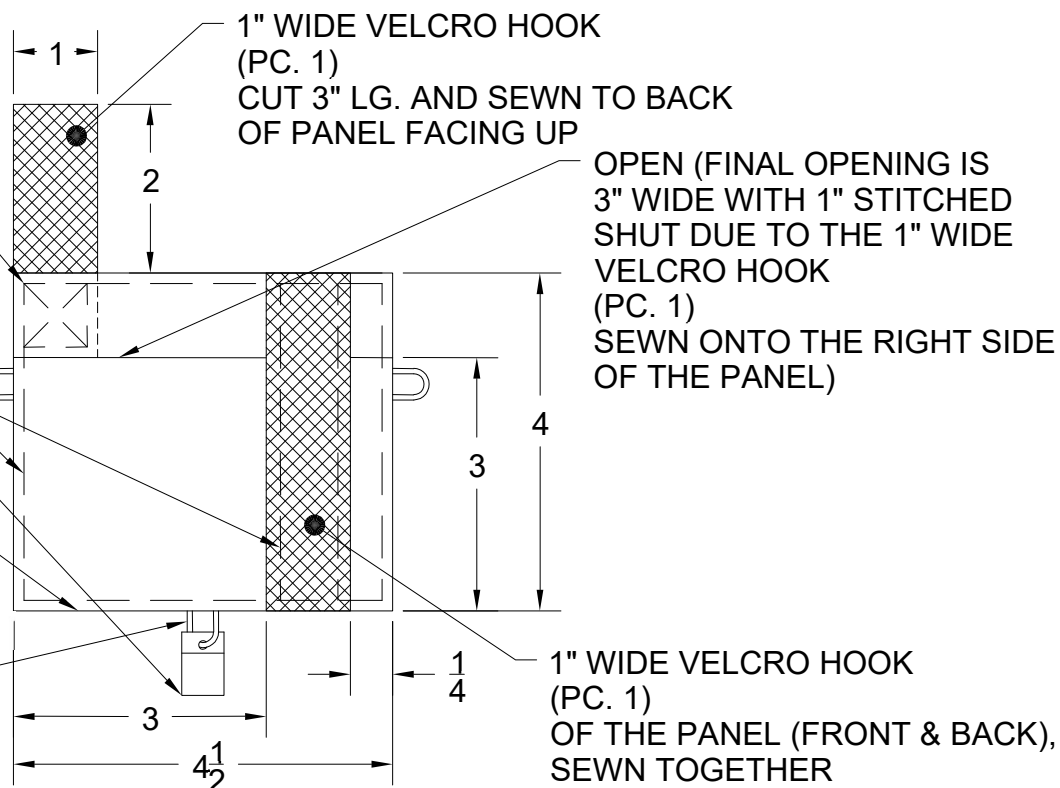FOLDED EDGE
(SEE NOTE 1)ATTACH METAL BADGE CLIP TO DOSIMETER
PANEL USING PARACHUTE CORD SEWN
TO THE BACK OF THE POUCH. ENSURE ENDS
ARE SINGED TO PREVENT FRAYING**NOTES FOR PART B:**

1. THE DOSIMETER PANEL IS MADE FROM CORDURA™ MATERIAL CUT 7" LONG X 4-1/2" WIDE. WITH THE LONG SIDE VERTICAL, FOLD THE MATERIAL 3" FROM THE BOTTOM AND STITCH THE SIDES AND BOTTOM USING A STRAIGHT STITCH APPROXIMATELY 1/8" FROM THE EDGE TO FORM THE DOSIMETER PANEL 4-1/2" WIDE X 4" (LSN: 9390-LL-R00-0339).
2. STANDARD METAL BADGE CLIP TO BE USED AS SHOWN (PC. 6)
3. CORD LOOP MATERIAL IS MADE OF PARACHUTE CORD (PC. 3) SINGE CORD ENDS TO PREVENT FRAYING.
4. DIMENSION TOLERANCE IS 1/4". DIMENSIONS ARE IN INCHES.

CODE 105.52 APPROVAL: /S/ D.M.STEIN

DATE: 6/18/09

DOSIMETER PANEL FOR CHEST WITH NECK STRAP

MATERIAL LIST		
<i>PIECE</i>	<i>DESCRIPTION</i>	<i>STOCK NUMBER</i>
1	1"W VELCRO TYPE BLACK HOOK	8315-00-935-6761
2	1"W VELCRO TYPE BLACK LOOP	8315-00-978-0113
3	CORD, BRAIDED NATURAL NYLON	4020-00-240-2146
4	WEBBING, 1"WIDE, 0.0575" THICK, OLIVE DRAB NYLON TWILL	8305-00-260-6906
5	CORDURA, BALLISTIC, BLACK URETHANE COATED NYLON, WATER REPELLANT	8305-LL-DM1-0066 8L
6	EMBOSSSED U-CLIP	5340-LL-R00-2055

NOTE: The "Material List" was added to Revision L of this drawing on 9/13/16 per request of the C/ 2305.3 EQSP.