



Rolling Fire Door Inspection Report

Carl Vinson VAMC

Date: September 16, 2025



No.: 00660

Rolling Door Inspection

Date: 09/16/2025

Start Date	09/16/2025
Start Time	08:00 AM
Technicians	Alex Maldonado
Job #	SB-082225-C13-RDB
Facility	Carl Vinson VAMC
Building	Main
City	Dublin
State	Georgia

DOORS

Door No. 1-RFD-006


FIELD NOTES

NFPA 80 5.2.3.6 requires verification of the following 17 points as a minimum

Floor	1
Serial / Job Number	SB-082225-C13-RDB
Manufacturer	C.H.I Rolling fire doors
Opening Width (Feet)	6
Opening Width (Inches)	0
Opening Height (Feet)	6
Opening Height (Inches)	10
Door Type	Rolling
Door Location	Building 2 Dining Room



Open Door Photo



Closed Door Photo

Is the door fire rated? Yes

Fire Rating Tag Yes



Fire Rating Tag Photo

Inspect bottom bar making sure label is clearly visible and legible Compliant

Rolling Door Inspection

Date: 09/16/2025

Inspect slats for dents, holes, and separation	Compliant
Inspect door for alignment, level, balance and lock (if so equipped)	Compliant
Inspect guides	Compliant
Inspect seals	N/A
Inspect hood	Compliant
Inspect gears, pulleys, and shafts	Compliant
Inspect fusible links (both sides), sash chains and cables making sure runways are clear and free of binds and twists	Compliant
Check releasing devices	Compliant
Check operation	Compliant
Inspection Date	09/16/2025
Inspection Time	09:28 AM

DROP TESTS

Drop test speed needs to be no less than 6" per second and no more than 24" per second

Drop Test #1: Speed	14.0000
Drop Test #1: Reset Door	☒
Drop Test #2 Check	☒
Drop Test #2: Reset Door	☒
Maintain and Lubricate Door	☒

DOOR COMPLIANCE

Door Compliant	Compliant
Fill Out Door Label	☒
Door Label Photo	



Technician Notes

Door No. 1-RFD-007

FIELD NOTES

NFPA 80 5.2.3.6 requires verification of the following 17 points as a minimum

Floor	1
Serial / Job Number	SB-082225-C13-RDB
Manufacturer	C.H.I Rolling Fire Doors
Opening Width (Feet)	6
Opening Width (Inches)	0
Opening Height (Feet)	6
Opening Height (Inches)	10
Door Type	Rolling
Door Location	Building 2 Dining Room



Open Door Photo



Closed Door Photo

Is the door fire rated? Yes

Fire Rating Tag Yes



Fire Rating Tag Photo

Inspect bottom bar making sure label is clearly visible and legible Compliant

Inspect slats for dents, holes, and separation Compliant

Rolling Door Inspection

Date: 09/16/2025

Inspect door for alignment, level, balance and lock (if so equipped)	Compliant
Inspect guides	Compliant
Inspect seals	N/A
Inspect hood	Compliant
Inspect gears, pulleys, and shafts	Compliant
Inspect fusible links (both sides), sash chains and cables making sure runways are clear and free of binds and twists	Compliant
Check releasing devices	Compliant
Check operation	Compliant
Inspection Date	09/16/2025
Inspection Time	09:38 AM

DROP TESTS

Drop test speed needs to be no less than 6" per second and no more than 24" per second	
Drop Test #1: Speed	13.0000
Drop Test #1: Reset Door	☒
Drop Test #2 Check	☒
Drop Test #2: Reset Door	☒
Maintain and Lubricate Door	☒

DOOR COMPLIANCE

Door Compliant	Compliant
Fill Out Door Label	☒
Door Label Photo	



Technician Notes

Door No. 1-RFD-005

FIELD NOTES

NFPA 80 5.2.3.6 requires verification of the following 17 points as a minimum

Floor	1
Serial / Job Number	SB-082225-C13-RDB
Manufacturer	C.H.I Rolling Fire Doors
Opening Width (Feet)	6
Opening Width (Inches)	0
Opening Height (Feet)	6
Opening Height (Inches)	10
Door Type	Rolling
Door Location	Building 2 Dining Room



Open Door Photo



Closed Door Photo

Is the door fire rated? Yes

Fire Rating Tag Yes



Fire Rating Tag Photo

Inspect bottom bar making sure label is clearly visible and legible Compliant

Inspect slats for dents, holes, and separation Compliant

Rolling Door Inspection

Date: 09/16/2025

Inspect door for alignment, level, balance and lock (if so equipped)	Compliant
Inspect guides	Compliant
Inspect seals	N/A
Inspect hood	Compliant
Inspect gears, pulleys, and shafts	Compliant
Inspect fusible links (both sides), sash chains and cables making sure runways are clear and free of binds and twists	Compliant
Check releasing devices	Compliant
Check operation	Compliant
Inspection Date	09/16/2025
Inspection Time	09:45 AM


DROP TESTS

Drop test speed needs to be no less than 6" per second and no more than 24" per second

Drop Test #1: Speed	13.0000
Drop Test #1: Reset Door	✓
Drop Test #2 Check	✓
Drop Test #2: Reset Door	✓
Maintain and Lubricate Door	✓

DOOR COMPLIANCE

Door Compliant	Compliant
Fill Out Door Label	✓
Door Label Photo	

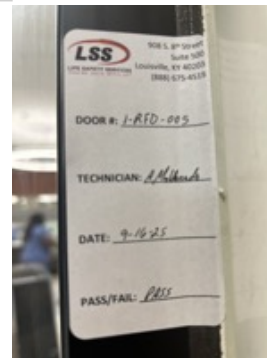

Technician Notes

Door No. 1-RFD-004

FIELD NOTES

NFPA 80 5.2.3.6 requires verification of the following 17 points as a minimum

Floor	1
Serial / Job Number	SB-082225-C13-RDB
Manufacturer	C.H.I Rolling Fire Doors
Opening Width (Feet)	6
Opening Width (Inches)	0
Opening Height (Feet)	6
Opening Height (Inches)	10
Door Type	Rolling
Door Location	Building 2 Dining Room



Open Door Photo



Closed Door Photo

Is the door fire rated? Yes

Fire Rating Tag Yes



Fire Rating Tag Photo

Inspect bottom bar making sure label is clearly visible and legible Compliant

Inspect slats for dents, holes, and separation Compliant

Rolling Door Inspection

Date: 09/16/2025

Inspect door for alignment, level, balance and lock (if so equipped)	Compliant
Inspect guides	Compliant
Inspect seals	N/A
Inspect hood	Compliant
Inspect gears, pulleys, and shafts	Compliant
Inspect fusible links (both sides), sash chains and cables making sure runways are clear and free of binds and twists	Compliant
Check releasing devices	Compliant
Check operation	Compliant
Inspection Date	09/16/2025
Inspection Time	09:49 AM

DROP TESTS

Drop test speed needs to be no less than 6" per second and no more than 24" per second

Drop Test #1: Speed	13.0000
Drop Test #1: Reset Door	✓
Drop Test #2 Check	✓
Drop Test #2: Reset Door	✓
Maintain and Lubricate Door	✓

DOOR COMPLIANCE

Door Compliant	Compliant
Fill Out Door Label	✓
Door Label Photo	



Technician Notes

Door No. 1-RFD-003

FIELD NOTES

NFPA 80 5.2.3.6 requires verification of the following 17 points as a minimum

Floor	1
Serial / Job Number	SB-082225-C13-RDB
Manufacturer	C.H.I Rolling Fire Doors
Opening Width (Feet)	6
Opening Width (Inches)	0
Opening Height (Feet)	6
Opening Height (Inches)	10
Door Type	Rolling
Door Location	Building 2 Dining Room



Open Door Photo



Closed Door Photo

Is the door fire rated? Yes

Fire Rating Tag Yes



Fire Rating Tag Photo

Inspect bottom bar making sure label is clearly visible and legible Compliant

Inspect slats for dents, holes, and separation Compliant

Rolling Door Inspection

Date: 09/16/2025

Inspect door for alignment, level, balance and lock (if so equipped)	Compliant
Inspect guides	Compliant
Inspect seals	N/A
Inspect hood	Compliant
Inspect gears, pulleys, and shafts	Compliant
Inspect fusible links (both sides), sash chains and cables making sure runways are clear and free of binds and twists	Compliant
Check releasing devices	Compliant
Check operation	Compliant
Inspection Date	09/16/2025
Inspection Time	09:54 AM


DROP TESTS

Drop test speed needs to be no less than 6" per second and no more than 24" per second

Drop Test #1: Speed	13.0000
Drop Test #1: Reset Door	☒
Drop Test #2 Check	☒
Drop Test #2: Reset Door	☒
Maintain and Lubricate Door	☒

DOOR COMPLIANCE

Door Compliant	Compliant
Fill Out Door Label	☒
Door Label Photo	

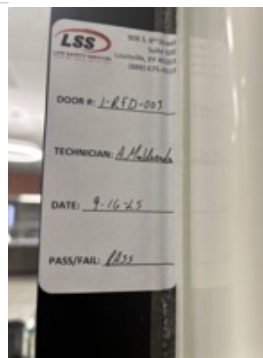

Technician Notes

Door No. 1-RFD-002

FIELD NOTES

NFPA 80 5.2.3.6 requires verification of the following 17 points as a minimum

Floor	1
Serial / Job Number	SB-082225-C13-RDB
Manufacturer	C.H.I Rolling Fire Doors
Opening Width (Feet)	3
Opening Width (Inches)	4
Opening Height (Feet)	6
Opening Height (Inches)	3
Door Type	Rolling
Door Location	Building A wing 1 outside



Open Door Photo



Closed Door Photo

Is the door fire rated? Yes

Fire Rating Tag Yes



Fire Rating Tag Photo

Inspect bottom bar making sure label is clearly visible and legible Compliant

Inspect slats for dents, holes, and separation Compliant

Rolling Door Inspection

Date: 09/16/2025

Inspect door for alignment, level, balance and lock (if so equipped)	Compliant
Inspect guides	Compliant
Inspect seals	N/A
Inspect hood	Compliant
Inspect gears, pulleys, and shafts	Compliant
Inspect fusible links (both sides), sash chains and cables making sure runways are clear and free of binds and twists	Compliant
Check releasing devices	Compliant
Check operation	Compliant
Inspection Date	09/16/2025
Inspection Time	10:19 AM

DROP TESTS

Drop test speed needs to be no less than 6" per second and no more than 24" per second	
Drop Test #1: Speed	13.0000
Drop Test #1: Reset Door	✓
Drop Test #2 Check	✓
Drop Test #2: Reset Door	✓
Maintain and Lubricate Door	✓

DOOR COMPLIANCE

Door Compliant	Compliant
Fill Out Door Label	✓
Door Label Photo	



Technician Notes

Door No. 1-RFD-001

FIELD NOTES

NFPA 80 5.2.3.6 requires verification of the following 17 points as a minimum

Floor	1
Serial / Job Number	SB-082225-C13-RDB
Manufacturer	C.H.I Rolling Fire Doors
Opening Width (Feet)	3
Opening Width (Inches)	4
Opening Height (Feet)	6
Opening Height (Inches)	4
Door Type	Rolling
Door Location	Building A Wing 1 outside



Open Door Photo



Closed Door Photo

Is the door fire rated? Yes

Fire Rating Tag Yes



Fire Rating Tag Photo

Inspect bottom bar making sure label is clearly visible and legible Compliant

Inspect slats for dents, holes, and separation Compliant

Rolling Door Inspection

Date: 09/16/2025

Inspect door for alignment, level, balance and lock (if so equipped)	Compliant
Inspect guides	Compliant
Inspect seals	N/A
Inspect hood	Compliant
Inspect gears, pulleys, and shafts	Compliant
Inspect fusible links (both sides), sash chains and cables making sure runways are clear and free of binds and twists	Compliant
Check releasing devices	Compliant
Check operation	Compliant
Inspection Date	09/16/2025
Inspection Time	10:33 AM

DROP TESTS

Drop test speed needs to be no less than 6" per second and no more than 24" per second

Drop Test #1: Speed	12.0000
Drop Test #1: Reset Door	☒
Drop Test #2 Check	☒
Drop Test #2: Reset Door	☒
Maintain and Lubricate Door	☒

DOOR COMPLIANCE

Door Compliant	Compliant
Fill Out Door Label	☒
Door Label Photo	



Technician Notes



Rolling Door Inspection

No.: 00660
Date: 09/16/2025

DOOR SUMMARY

Compliant Doors	7
Compliant Percentage	100.00
Total Doors	7
Non-compliant Doors	0
Non-compliant Percentage	0.00

FORM COMPLETION

Date	09/16/2025
Time	10:40 AM
Reminder	

Please ensure the current date and time are selected. They are used to keep paperwork in order.

Technician Signature

A handwritten signature in black ink, appearing to be "J. Maldonado", is written over the signature line.



908 South 8th Street
Louisville, KY. 40203
888.675.4519
info@LifeSafetyServices.com



www.LifeSafetyServices.com