

APPLICABLE CODES AND STANDARDS:

1. THE ORIGINAL BUILDING WAS DESIGNED TO THE 1965 EDITION OF NFPA 101, LIFE SAFETY CODE.
2. THE 1960 PUBLIC BUILDING AMENDMENT ACT (PL100-678) REQUIRES ALL FEDERAL AGENCIES TO FOLLOW THE LATEST EDITIONS OF NATIONALLY RECOGNIZED FIRE AND LIFE SAFETY CODES. THE VA HAS ADOPTED THE NATIONAL FIRE CODES PUBLISHED BY THE NATIONAL FIRE PROTECTION ASSOCIATION. LIFE SAFETY REQUIREMENTS ARE SPECIFICALLY ADDRESSED IN THE 2018 EDITION OF NFPA 101, LIFE SAFETY CODE.
3. ALL NEW CONSTRUCTION OR BUILDING RENOVATIONS ARE REQUIRED TO COMPLY WITH THE LATEST EDITION OF NFPA 101 OR ITS REFERENCED STANDARDS. EXISTING BUILDING CONDITIONS ARE REQUIRED TO COMPLY WITH THE APPLICABLE CODES OR STANDARDS AT THE TIME OF BUILDING DESIGN AND THE APPLICABLE PROVISIONS FOR EXISTING BUILDINGS IN CURRENT EDITIONS OF APPLICABLE CODES AND STANDARDS.
4. OTHER NFPA CODES AND STANDARDS:

A. NFPA 10 - PORTABLE FIRE EXTINGUISHERS, 2018 EDITION

B. NFPA 13 - SPRINKLER SYSTEMS, 2019 EDITION

C. NFPA 14 - STANDPIPE SYSTEMS, 2016 EDITION

D. NFPA 20 - FIRE PUMPS, 2019 EDITION

E. NFPA 25 - WATER-BASED FIRE PROTECTION SYSTEMS 2020 EDITION

F. NFPA 70 - NATIONAL ELECTRIC CODE, 2020 EDITION

G. NFPA 72 - NATIONAL FIRE ALARM CODE, 2019 EDITION

H. NFPA 75 - ELECTRONIC COMPUTER EQUIPMENT, 2017 EDITION

I. NFPA 80 - FIRE DOORS, 2019 EDITION

J. NFPA 90A&B - HEATING AND AIR CONDITIONING SYSTEMS, 2018 EDITION

K. NFPA 96 - COMMERCIAL COOKING EQUIPMENT, 2017 EDITION

L. NFPA 99 - HEALTH CARE FACILITIES CODE, 2018 EDITION

M. NFPA 105 - SMOKE DOORS, 2019 EDITION

N. NFPA 110 - EMERGENCY POWER SYSTEMS, 2019 EDITION

O. NFPA 241 - CONSTITUTION AND DEMOLITION, 2019 EDITION

SUITES:

1. SUITES ARE UTILIZED TO ILLUSTRATE AREAS WITH THE SAME FUNCTION, USE OF HALLWAYS OR AISLES AND TO DEFINE THE END OF PUBLIC EXIT CORRIDORS. NO EXIT SIGNS OUTSIDE OF THE SUITE MAY DIRECT OCCUPANTS INTO A SUITE TO REACH AN EXIT.
2. HEALTH CARE OCCUPANCY SUITES ARE REGULATED BY FUNCTION AND SIZE.
3. HEALTH CARE OCCUPANCY PATIENT SLEEPING SUITES:

A. SINGLE EXIT SUITE - 1,000 SQ. FT. (NFPA 101 - 19.2.5.7.2.2)

B. MULTI EXIT SUITE - 5,000 SQ. FT. (NFPA 101 - 19.2.5.7.2.3.A)

C. MULTI EXIT SUITE WITH STANDARD RESPONSE SPRINKLERS OR COMPLETE SMOKE DETECTION - 7,500 SQ. FT. (NFPA 101 - 19.2.5.7.2.3.B)

D. MULTI EXIT SUITE WITH DIRECT VISUAL SUPERVISION, QUICK RESPONSE SPRINKLERS AND COMPLETE SMOKE DETECTION - 10,000 SQ. FT. (NFPA 101 - 19.2.5.7.2.3.C)
4. PATIENT CARE NON - SLEEPING SUITES:

A. SINGLE EXIT SUITE - 2,500 SQ. FT. (NFPA 101 - 19.2.5.7.3.1.B)

B. MULTI EXIT SUITE - 10,000 SQ. FT. (NFPA 101 - 19.2.5.7.3.3)
5. HEALTH CARE OCCUPANCY NON - PATIENT - CARE SUITES FOLLOW THE TRAVEL DISTANCE REQUIREMENTS AS LISTED IN TABLE A.7.6 OF NFPA 101.
6. SUITES IN OTHER OCCUPANCIES ARE NOT REGULATED IN SIZE BUT STILL FOLLOW THE TRAVEL DISTANCE REQUIREMENTS AS LISTED IN TABLE A.7.6 OF NFPA 101.

EXIT SIGN REQUIREMENTS

1. EXITS (STAIRWAYS, HORIZONTAL EXITS AND DIRECT EXTERIOR EXIT DOORS), OTHER THAN EXTERIOR EXIT DOORS THAT ARE OBVIOUSLY AND CLEARLY IDENTIFIABLE AS EXITS. (GLASS DOORS, VISION PANELS OR ADJACENT WINDOWS) SHALL BE MARKED WITH EXIT SIGNAGE. (SECTION 7.10.1.2.1 OF NFPA 101-2018 EDITION)
2. DIRECTIONAL SIGNS REQUIRED WHERE DIRECTION OF TRAVEL IS NOT APPARENT IN AN EXIT ACCESS CORRIDOR. (SECTION 7.10.2.1 OF NFPA 101-2018 EDITION)
3. DIRECTIONAL SIGNAGE (EXIT PLACARDS) REQUIRED WITHIN HORIZONTAL COMPONENTS OF EXIT STAIR ENCLOSURES WHERE EGRESS PATH IS NOT OBVIOUS (SECTIONS 7.10.2.2 AND 7.10.1.2.2 OF NFPA 101-2018 EDITION)
4. MAXIMUM VIEWING DISTANCE TO AN EXIT SIGN IN AN EXIT ACCESS CORRIDOR IS 100 FT. (SECTION 7.10.1.5.2 OF NFPA 101-2018 EDITION)
5. EXIT SIGNS SHALL BE INSPECTED MONTHLY. (SECTION 7.10.9.1 IF NFPA 101-2018 EDITION)
6. DIRECTIONAL SIGNAGE (EXIT PLACARDS OR EXIT SIGNS) WITH OR WITHOUT DIRECTIONAL ARROWS SHOULD BE PROVIDED IN SUITES USED BY THE GENERAL PUBLIC (LESS THAN 50 TOTAL OCCUPANTS) TO DIRECT THE GENERAL PUBLIC BACK TO THE WAITING AREA. (SECTION 7.10.2.1 OF NFPA 101-2018 EDITION)
7. ROOMS OR SUITES OF ROOMS USED FOR 50 OCCUPANTS OR MORE SHALL BE PROVIDED WITH EXIT SIGNAGE. (SECTIONS 13.2.10.1 AND 3.3.196.2 OF NFPA 101-2018 EDITION)

EQUIVALENCIES

THE VA HAS ELECTIVE ACCREDITATION WITH THE JOINT COMMISSION (TJC) FOR HEALTH CARE FACILITIES. SEE THE MEMORANDUM OF UNDERSTANDING (EFFECTIVE 4 SEPTEMBER, 2017) BETWEEN THE VA AND TJC FOR IMPLEMENTATION OF TJC ENVIRONMENT OF CARE (EC) AND LIFE SAFETY (LS) STANDARDS.

THE VA HAS ELECTIVE ACCREDITATION WITH THE LONG-TERM CARE INSTITUTE, INC. (LTCI) FOR COMMUNITY LIVING CENTERS (CLC). SEE THE CLARIFICATION MEMORANDUM (EFFECTIVE MARCH 29, BETWEEN THE VA AND THE LTCI FOR IMPLEMENTATION OF LIFE SAFETY REQUIREMENTS.

THE FOLLOWING NATIONWIDE VA EQUIVALENCIES HAVE BEEN REVIEWED AND APPROVED BY THE JOINT COMMISSION AND APPLY TO ALL BUILDINGS:

1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS

2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50 FEET

3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

THE FOLLOWING SITE SPECIFIC EQUIVALENCIES HAVE BEEN APPROVED BY TJC:

1. BUILDING 200 MAIN HOSPITAL

A. LINEAR ACCELERATOR COMMON PATH OF TRAVEL

B. STAIR NO. 1 IS EXIT PASSAGEWAY

2. BUILDING 221 REHABILITATION CENTER

A. MODULAR BUILDING CONSTRUCTION SEPARATION

FIRE ALARM SYSTEM:

1. THE FIRE ALARM SYSTEM WAS DESIGNED TO 2019 EDITION OF NFPA 72, NATIONAL FIRE ALARM CODE.
2. PRIVATE MODE BUILDING OCCUPANT NOTIFICATION IS INSTALLED PER SECTIONS 19.3.4.3.1 AND 9.6.3.6.3 OF NFPA 101-2018 EDITION.
3. PRIVATE MODE AUDIBLE DEVICES (SPEAKERS) ARE INSTALLED IN CORRIDORS AND LARGER ROOMS OR SUITES PER SECTION 18.4.4.1 OF NFPA 72 - 2019 EDITION.
4. PRIVATE MODE VISIBLE DEVICES (STROBES) ARE INSTALLED AT REDUCED QUANTITY AND SPACING PER SECTION 18.6 OF THE NFPA 72 - 2019 EDITION.
5. STROBE CIRCUITS ARE REQUIRED TO BE SYNCHRONIZED IN ACCORDANCE WITH SECTION 18.5.4.3.2(3) OF NFPA 72 - 2019 EDITION.
6. TYPICAL SMOKE DETECTORS HAVE A 21 FT. RADIUS OF COVERAGE AREA (NFPA 72 - 17.7.3.2.3.1)
7. SMOKE DETECTORS THAT ARE CONNECTED TO THE BUILDING FIRE ALARM SYSTEM AND LOCATED ON BOTH SIDES OF SMOKE/FIRE DOORS MAY BE SPACED AT MAXIMUM 21' RADIUS FOR DOOR RELEASE SERVICE (NFPA 72 - 17.7.5.6.1) SMOKE DETECTORS NOT CONNECTED TO THE BUILDING FIRE ALARM SYSTEM AND USED EXCLUSIVELY FOR SMOKE/FIRE DOOR RELEASE SHALL BE LOCATED AND SPACED PER NFPA 72- 17.7.5.6.
8. CEILINGS WITH BEAM DEPTHS OF LESS THAN 10% OF CEILING HEIGHT SHALL BE CONSIDERED A SMOOTH CEILING FOR SMOKE DETECTOR COVERAGE. CEILINGS WITH BEAM DEPTHS GREATER THAN 10% OF CEILING HEIGHT SHALL HAVE REDUCED SMOKE DETECTOR SPACING COVERAGE (NFPA 72 - 17.7.3.2.4.2).
9. SMOKE DETECTORS SHALL BE LOCATED ON THE CEILINGS THE BOTTOM OF BEAMS OR MAXIMUM 12" DOWN FROM THE CEILING TO TOP OF THE DETECTOR (NFPA 72- 17.7.3.2.1).
10. SMOKE DETECTORS SHALL NOT BE LOCATED DIRECTLY IN THE AIR STREAM OF SUPPLY AIR REGISTERS (NFPA 72- 17.7.6.3.2).

FIRE SPRINKLER SYSTEM:

1. THE COMBINATION STANDPIPE AND FIRE SPRINKLER SYSTEM WAS DESIGNED TO NFPA 13 AND NFPA 14.
2. QUICK RESPONSE TYPE SPRINKLERS ARE INSTALLED THROUGHOUT MOST OF THE BUILDING. STANDARD RESPONSE TYPE SPRINKLERS ARE INSTALLED IN THE ELEVATOR MACHINE ROOMS (NFPA 13 - 3.3.4.16).
3. SPRINKLERS WERE INSTALLED IN LIGHT HAZARD AREAS INCLUDING: CORRIDORS, OFFICES, PATIENT CARE AND PATIENT SLEEPING ROOMS AT LIGHT HAZARD 0.10 GPM/1500 SQ. FT. DENSITY. MAXIMUM PROTECTION AREA OF 225 SQ. FT. (NFPA 13 - TABLE 19.3.3.1.2).
4. SPRINKLERS WERE INSTALLED IN ORDINARY HAZARD GROUP I AREAS INCLUDING: LABORATORIES (WITHOUT FLAMMABLE LIQUIDS), MECHANICAL EQUIPMENT ROOMS, ELECTRICAL SWITCH GEAR ROOMS, REPAIR SHOPS AND STORAGE ROOMS UNDER 250 SQ. FT. AT A 0.15 GPM/1500 SQ. FT. DENSITY. MAXIMUM PROTECTION AREA OF 150 SQ. FT. (NFPA 13 - TABLE 19.3.3.1.2).
5. SPRINKLERS WERE INSTALLED IN ORDINARY HAZARD GROUP II AREAS INCLUDING GENERAL STORAGE ROOMS OVER 250 SQ. FT. AND LABORATORIES (WITH THE USE OF FLAMMABLE LIQUIDS) AT A 0.20 GPM/1500 SQ. FT. DENSITY.
6. MAXIMUM DISTANCE FROM SPRINKLERS TO WALLS FOR STANDARD SPRAY SPRINKLERS SHALL NOT EXCEED 7'-6" (NFPA 13 - 10.2.5.2.1). MAXIMUM DISTANCE FROM SPRINKLERS TO WALLS FOR STANDARD SPRAY SPRINKLERS IN SMALL ROOMS (800 SQ. FT. MAXIMUM) SHALL NOT EXCEED 9' FROM ANY SINGLE WALL (NFPA 13 - 10.2.5.2.3).
7. SPRINKLERS SHALL BE INSTALLED UNDER FIXED OBSTRUCTIONS (I.E. DUCTWORK) OVER 4' WIDE (NFPA 13 - 12.1.10.3.2). THE WIDTH OF DUCT INSULATION NOT A FACTOR FOR SPRINKLERS INSTALLED PRIOR TO THE 2019 EDITION ON NFPA 13. SPRINKLERS NOT REQUIRED UNDER NON COMBUSTIBLE OBSTRUCTIONS OVER 4' WIDE WHERE THE BOTTOM OF THE OBSTRUCTION IS A MAXIMUM 24" ABOVE THE FLOOR (NFPA 13 - 9.5.5.3.1).
8. SPRINKLERS SHALL BE INSTALLED A MAXIMUM 12" BELOW A CEILING OR FLOOR/ROOF DECK (NFPA 13 - 10.2.6.1.1.1) OR A MAXIMUM 22" BELOW A FLOOR/ROOF DECK WITH STRUCTURAL MEMBER OBSTRUCTIONS (NFPA 13 - 10.2.6.1.2).
9. SHELVING ON A WALL OR SHELVING AGAINST A WALL INCLUDING STORAGE THEREON SHALL BE PERMITTED TO EXTEND WITHIN THE 18" SPRINKLERS CLEARANCE BELOW CEILING SPRINKLER DEFLECTORS (NFPA 13 - 9.5.6.1).
10. WHERE THE 18" CLEARANCE BETWEEN SPRINKLERS AND SHELVING STORAGE CANNOT BE MAINTAINED, SPRINKLERS SHALL BE INSTALLED IN EVERY AISLE PER NFPA 13 - 9.2.5(2).
11. CEILING MOUNTED OBSTRUCTIONS (I.E. PATIENT LIFT TRACKS) WITHIN THE 18" SPRINKLER DISCHARGE CLEARANCE ARE PERMITTED PER NFPA 13 - TABLE 10.2.7.1.2 AND FIGURE 10.2.7.1.2(a).
12. FLOOR MOUNTED OBSTRUCTIONS (I.E. ROOM DIVIDERS OR SHELVING) WITHIN THE 18" SPRINKLER DISCHARGE CLEARANCE ARE PERMITTED PER NFPA 13 - TABLE 10.2.7.2.2 AND FIGURE 10.2.7.2.2.

OCCUPANCY TABLE

Building No.	Floor	Healthcare	Ambulatory Health Care	Business	Industrial	Storage	Daycare	Total
1	4	0	0	99,707	0	0	0	99,707
1	3	0	0	104,344	0	0	0	104,344
1	2	0	0	104,837	0	0	0	104,837
1	1	0	0	129,758	0	0	0	129,758
1	Subtotal	0	0	438,646	0	0	0	438,646
12	3	0	0	5,019	0	0	0	5,019
12	2	0	0	5,024	0	0	0	5,024
12	1	0	0	4,999	0	0	0	4,999
12	Basement	0	0	1,174	0	0	0	1,174
12	Subtotal	0	0	16,216	0	0	0	16,216
13	3	0	0	6,312	0	0	0	6,312
13	2	0	0	6,312	0	0	0	6,312
13	1	0	0	6,396	0	0	0	6,396
13	Basement	0	0	1,426	0	0	0	1,426
13	Subtotal	0	0	20,446	0	0	0	20,446
113	Penthouse	0	0	0	4,009	0	0	4,009
113	2	0	0	26,195	0	0	0	26,195
113	1	26,063	0	0	0	0	0	26,063
113	Subtotal	26,063	0	26,195	4,009	0	0	56,267
128	1	52,567	0	0	0	0	0	52,567
128	Basement	0	0	2,520	0	0	0	2,520
128	Subtotal	52,567	0	2,520	0	0	0	55,087
200	17	0	0	0	3,168	0	0	3,168
200	16	0	0	0	5,838	0	0	5,838
200	15	0	0	0	0	19,859	0	19,859
200	14	0	19,761	0	0	0	0	19,761
200	13	0	19,867	0	0	0	0	19,867
200	12	0	19,881	0	0	0	0	19,881
200	11	19,896	0	0	0	0	0	19,896
200	10	16,637	0	0	0	0	0	16,637
200	9	19,820	0	0	0	0	0	19,820
200	8	19,843	0	0	0	0	0	19,843
200	7	19,791	0	0	0	0	0	19,791
200	6	0	19,920	0	0	0	0	19,920
200	5	0	19,814	0	0	0	0	19,814
200	4	0	0	21,041	0	0	0	21,041
200	3	0	21,058	0	0	0	0	21,058
200	2	70,248	0	0	0	0	0	70,248
200	1	0	101,263	0	0	0	0	101,263
200	Basement	0	88,007	0	0	0	0	88,007
200	Subtotal	166,235	309,571	21,041	9,006	19,859	0	525,712
217	2	57,230	0	0	0	0	0	57,230
217	1	62,907	0	0	0	0	0	62,907
217	Subtotal	120,137	0	0	0	0	0	120,137
221	1	31,276	0	0	0	0	0	31,276
221	Subtotal	31,276	0	0	0	0	0	31,276
228	5	0	0	27,298	0	0	0	27,298
228	4	32,402	0	0	0	0	0	32,402
228	3	0	0	32,392	0	0	0	32,392
228	2	32,395	0	0	0	0	0	32,395
228	1	0	0	40,734	0	0	0	40,734
228	Basement	0	0	25,616	0	0	0	25,616
228	Subtotal	64,797	0	126,040	0	0	0	190,837
GRAND TOTAL		461,075	309,571	651,104	13,015	19,859	0	1,454,624

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title	CODE SUMMARY AND OCCUPANCY TABLE
Approved: Project Director	

Project Title	EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION	Project Number	578-24-002
		Building Number	ALL
Location	HINES, ILLINOIS	Drawing Number	SOC X-2
Issue Date	06/19/2024	Checked by	JLB
		Drawn by	DJB
		Dwg.	2 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	ADMINISTRATION SUITE	2,210 Sq. Ft.	NON PATIENT CARE	2

- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST


- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- EX EXIT
- HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED


ZONE 1A

ZONE 1B

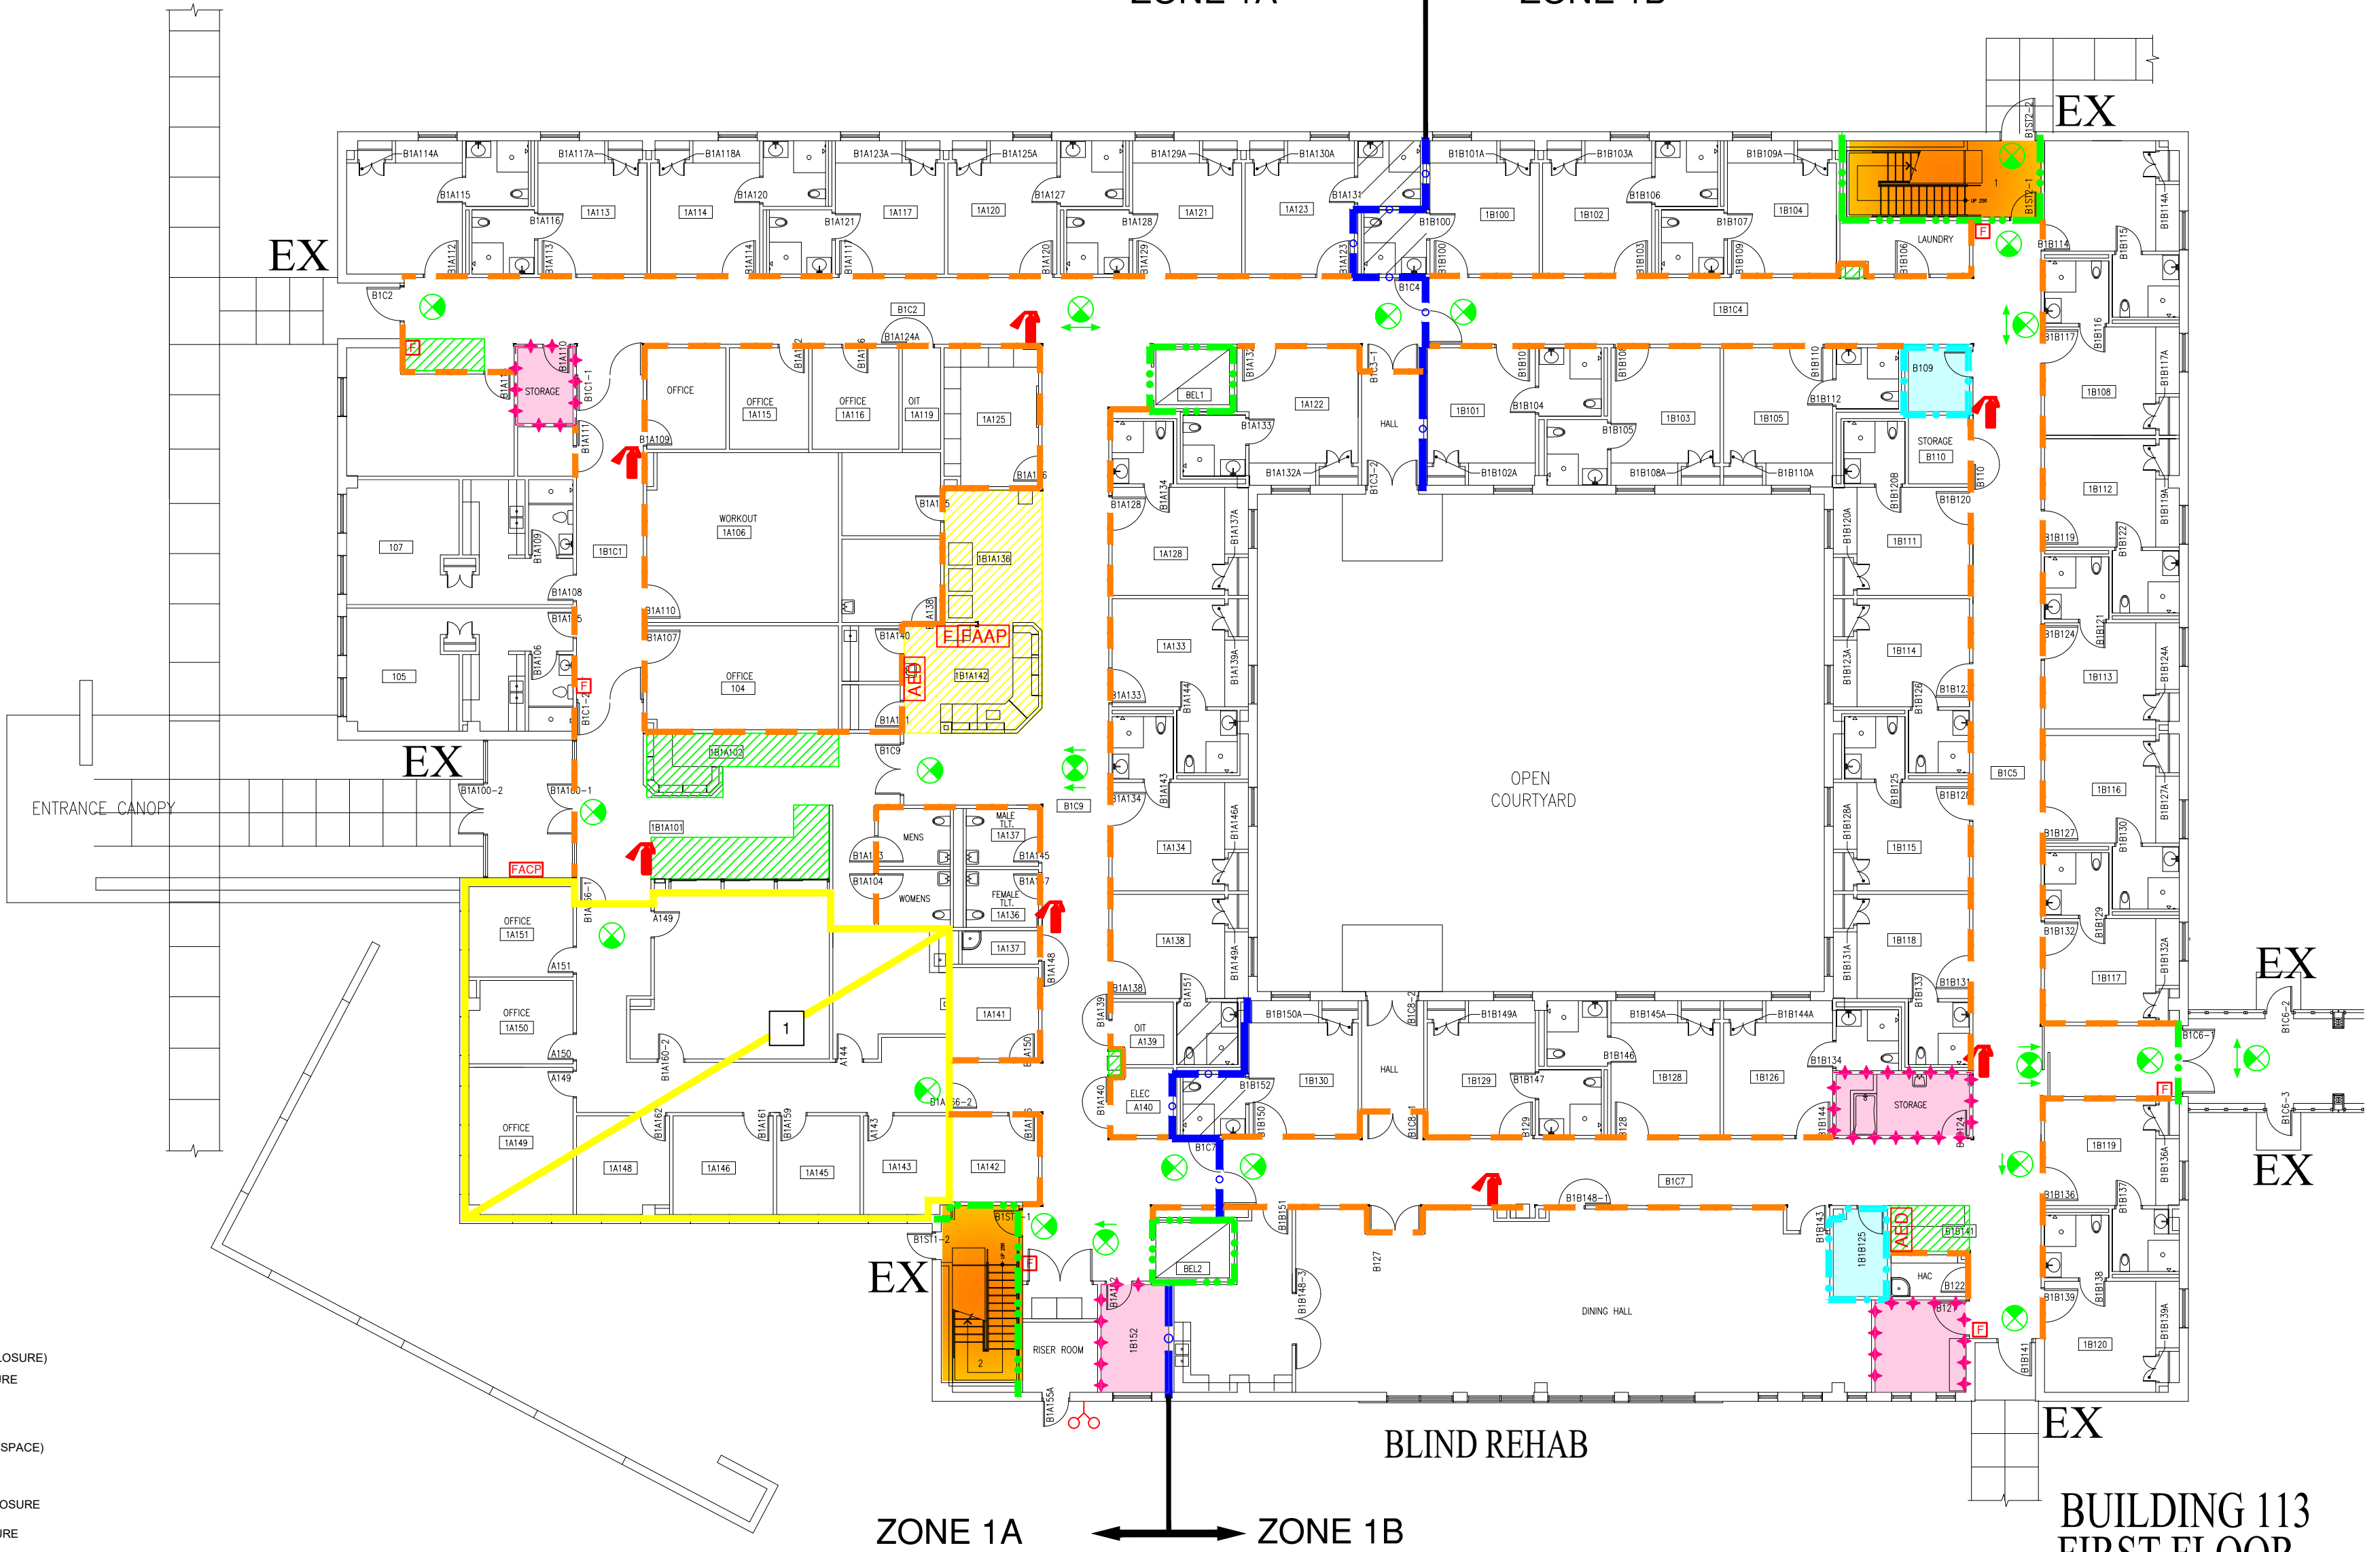

BUILDING 113
FIRST FLOOR

FULLY SPRINKLERED
HEALTH CARE OCCUPANCY



FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141


ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title	BUILDING 113 FIRST FLOOR
Approved: Project Director	

Project Title	EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION	Project Number	578-24-002
Location	HINES, ILLINOIS	Building Number	113
Issue Date	06/19/2024	Checked by	JLB
		Drawn by	DJB
		Dwg.	3 of 64

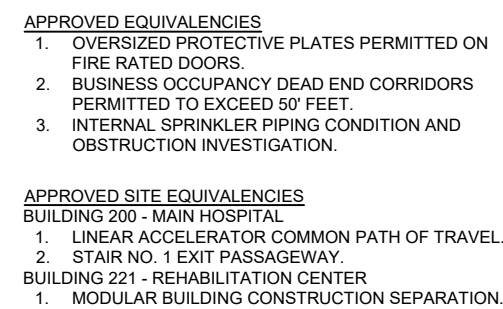

$\overrightarrow{\text{EP}}$	EXIT PASSAGEWAY
LC	LINEN CHUTE
TC	TRASH CHUTE
EX	EXIT
$\overrightarrow{\text{HE}}$	HORIZONTAL EXIT PASSAGEWAY

	2 HOUR FIRE/SMOKE ZONE BARRIER
	2 HOUR FIRE BARRIER
	SMOKE ZONE BARRIER
	1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
	SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
	NON-RATED SMOKE ZONE PARTITION
	HEALTH CARE OCCUPANCY CORRIDORS
	NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
	SPRINKLER AND FIRE ALARM ZONE BOUNDARY
	1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
	SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
	EXIT STAIRWELL/PASSAGEWAY
	SUITE DESIGNATION
	AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
	AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

FPC
&
CONSULTANTS

Dwg. 4 of 64


- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP → EXIT PASSAGEWAY
- LC → LINEN CHUTE
- TC → TRASH CHUTE
- EX → EXIT
- HE → HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

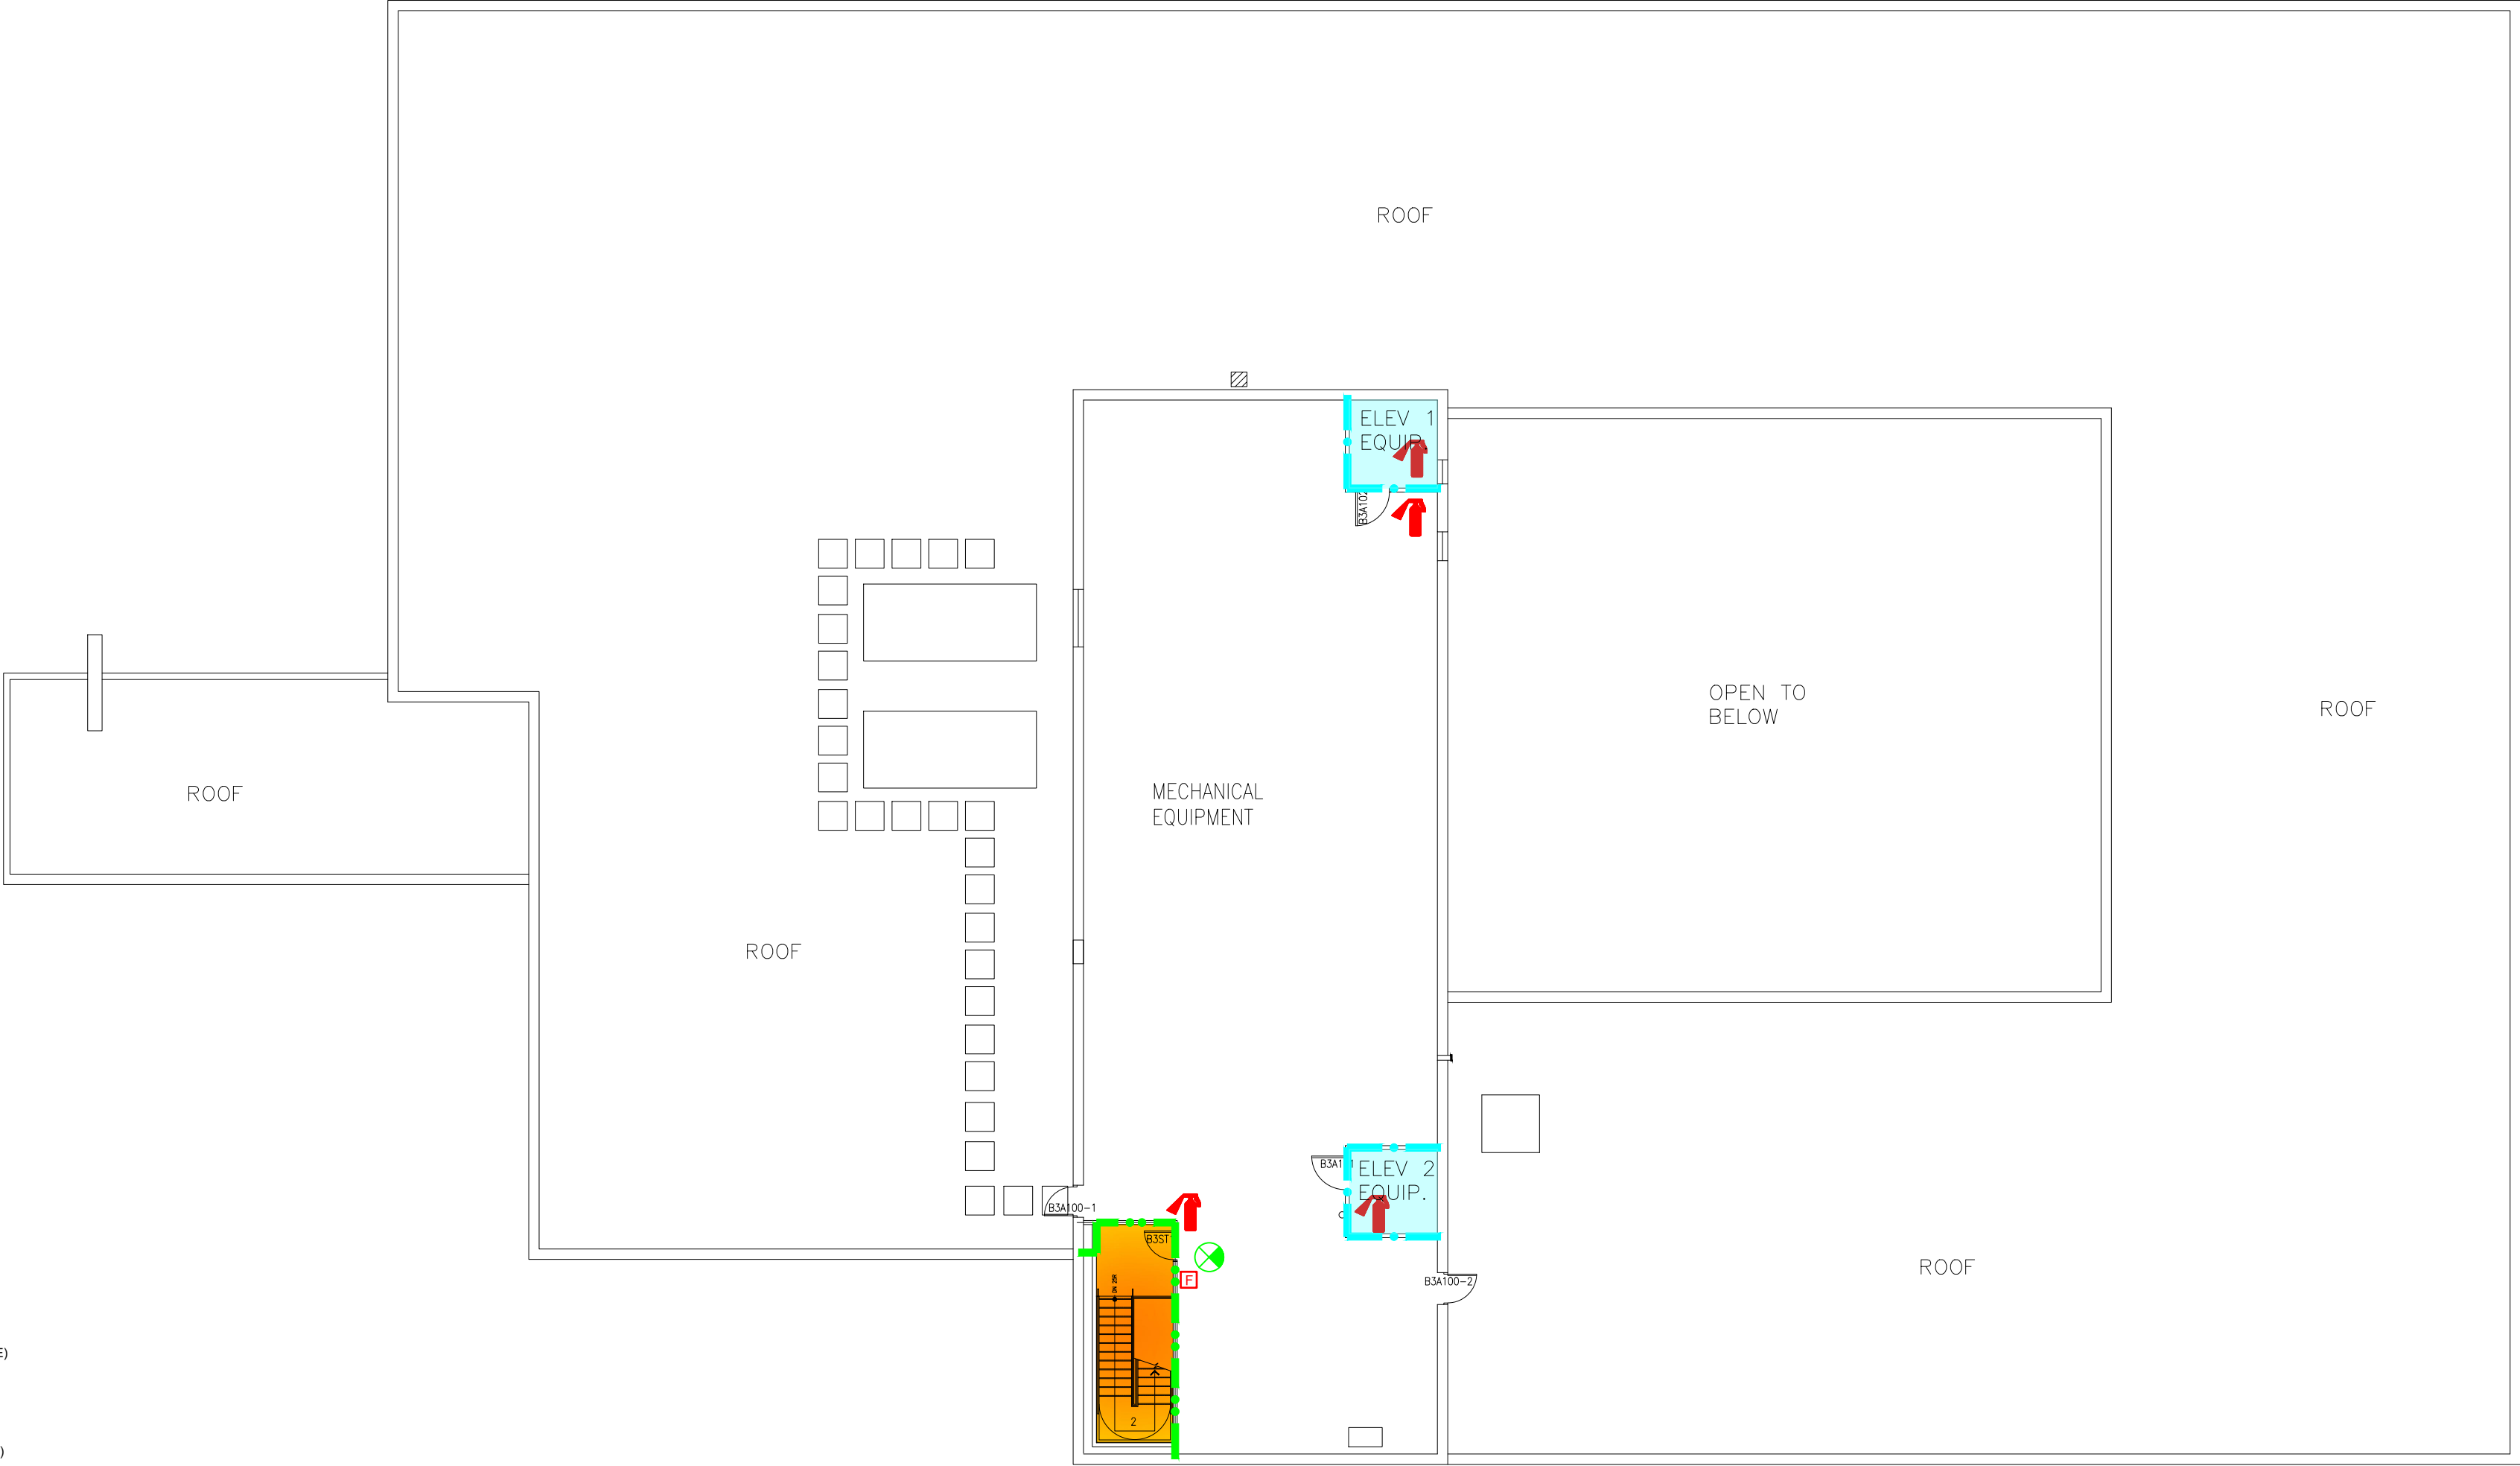

BUILDING 113
PENTHOUSE FLOOR
FULLY SPRINKLERED
INDUSTRIAL OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 113
THIRD FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

113

Drawing Number

113SOC-PH

Dwg. 5 of 64



- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP → EXIT PASSAGEWAY
- LC → LINEN CHUTE
- TC → TRASH CHUTE
- EX → EXIT
- HE → HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

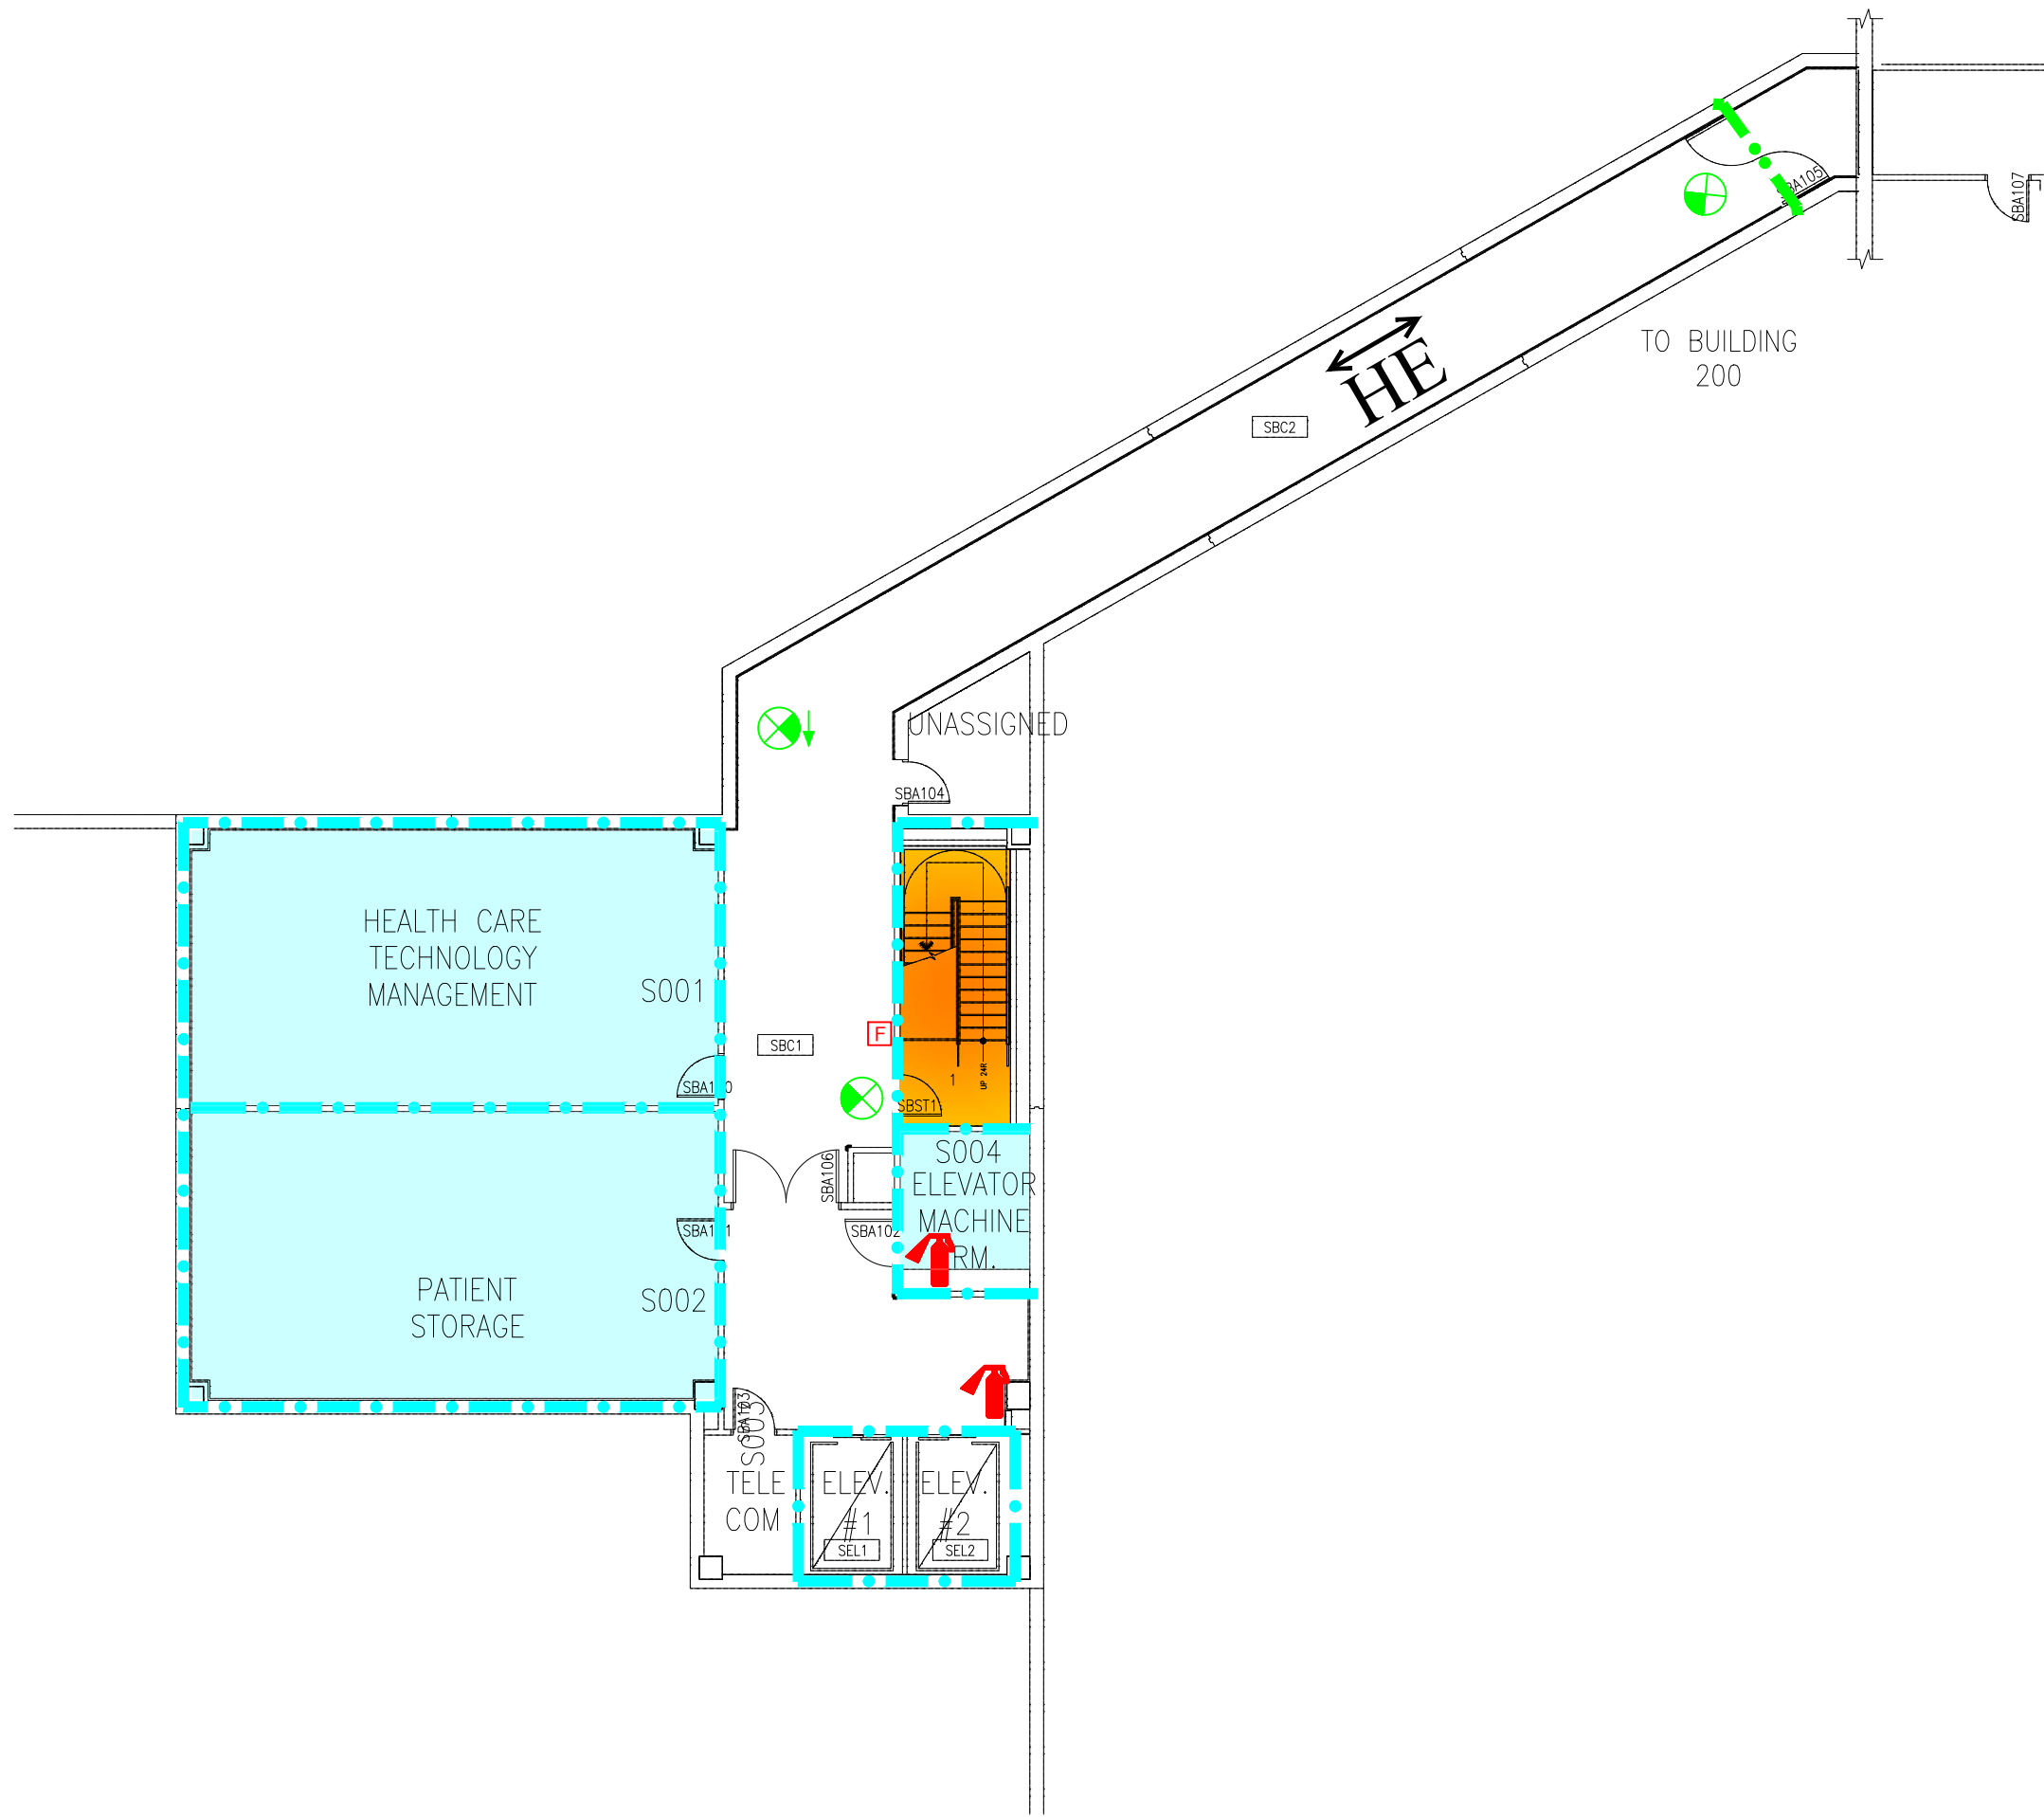

BUILDING 128 BASEMENT

FULLY SPRINKLERED
BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 128
BASEMENT

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

128

Drawing Number

128SOC-B

Dwg. 6 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	SCI SUITE	1,769 Sq. Ft.	NON SLEEPING PATIENT CARE	2
2	HOME CARE CLINIC SUITE	1,878 Sq. Ft.	NON SLEEPING PATIENT CARE	2
3	SCI THERAPY SUITE	3,151 Sq. Ft.	NON SLEEPING PATIENT CARE	2

KEY NOTES:

- 1 POWERED SMOKE DOORS ACTIVATED BY FIRE ALARM.
- 2 NEW HAZARDOUS ROOM WITH SMOKE RESISTIVE ENCLOSURE PER SECTION 4.3.7.1.2(2) OF NFPA 101-2013 EDITION.
- 3 DOOR RATING COVERED BY EDGE GUARD.

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
NORTH	15,924 Sq. Ft.	HEALTH CARE
CENTER	20,295 Sq. Ft.	HEALTH CARE
SOUTH	18,034 Sq. Ft.	HEALTH CARE

- APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- EX EXIT
- HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 128
FIRST FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number


128

Drawing Number

128SOC-1

Dwg. 7 of 64



 **BUILDING 128**
FIRST FLOOR
FULLY SPRINKLERED
HEALTH CARE OCCUPANCY


- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP → EXIT PASSAGEWAY
- LC → LINEN CHUTE
- TC → TRASH CHUTE
- EX → EXIT
- HE → HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

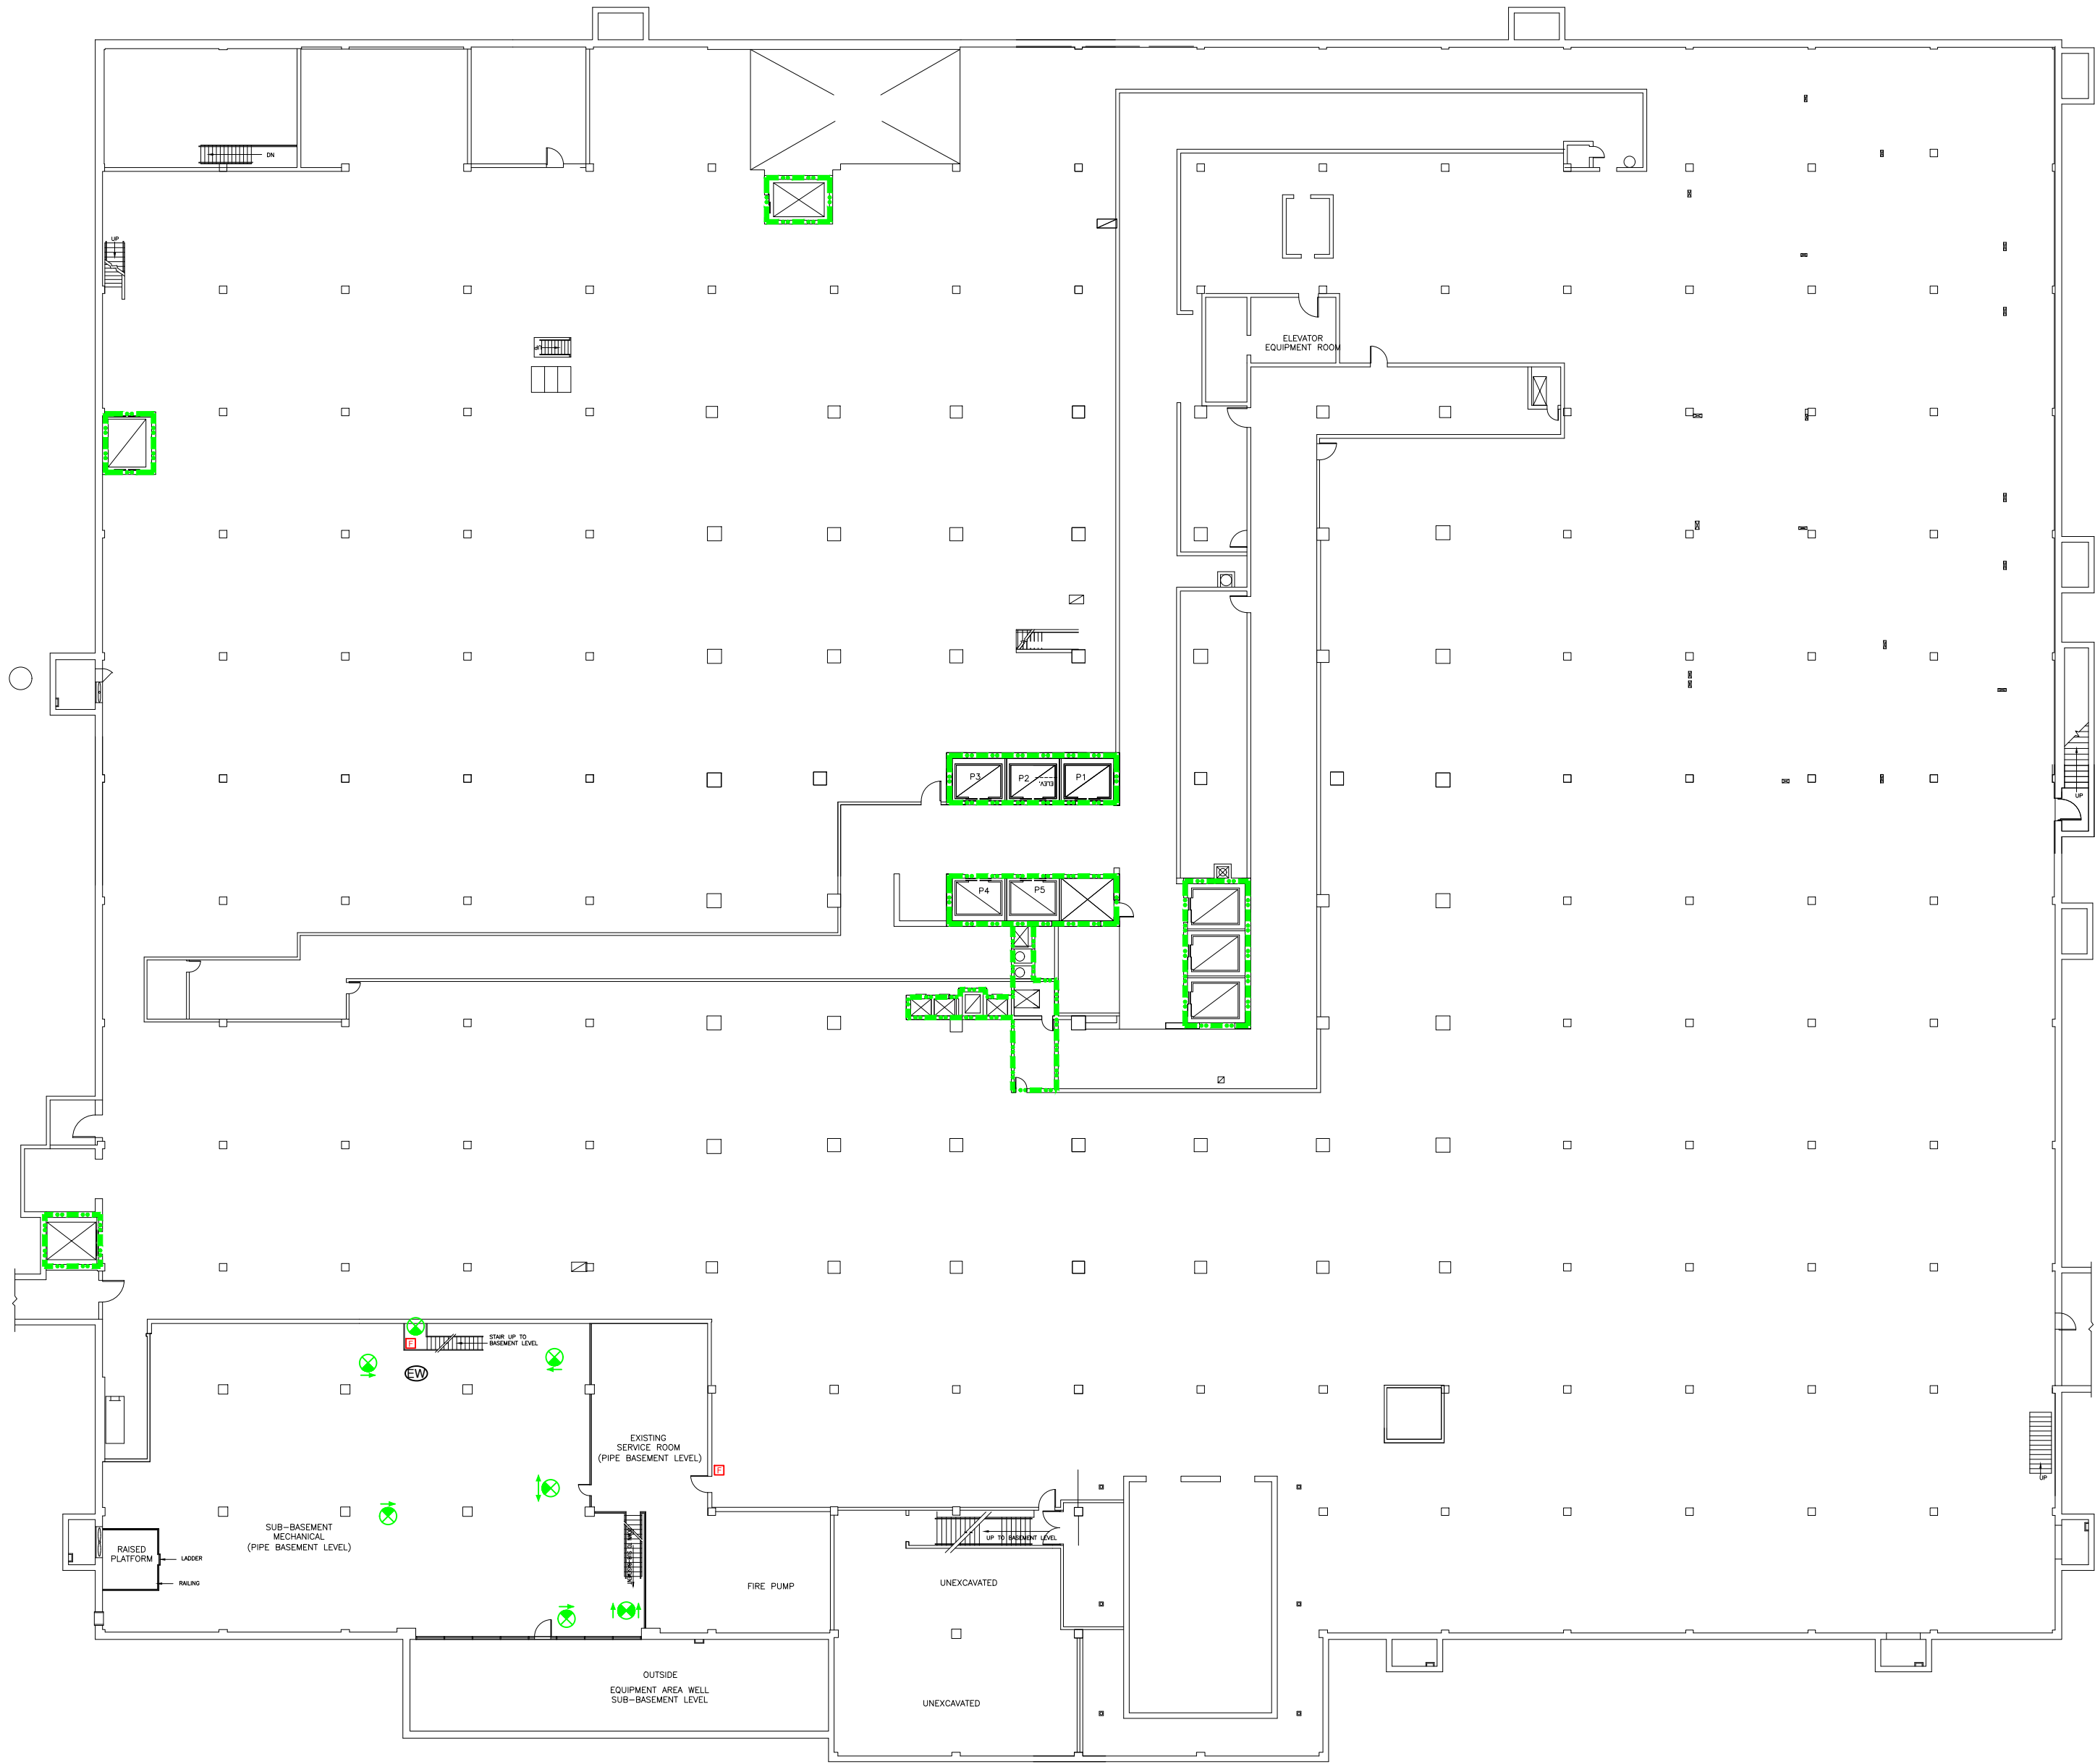

BUILDING 200 PIPE/SUB-BASEMENT

FULLY SPRINKLERED

INDUSTRIAL OCCUPANCY



FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS	
	
Edward Hines, Jr. VA Hospital 5000 5th Ave Hines, IL 60141	

ENGINEERS	
	
FP&C CONSULTANTS, KC LLC. 1330 BURLINGTON STREET, SUITE 200 NORTH KANSAS CITY, MO 64116 (816) 931-3377	

Drawing Title
BUILDING 200 SUB-BASEMENT
Approved: Project Director

Project Title
EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION
Location
HINES, ILLINOIS
Issue Date
06/19/2024
Checked by
JLB
Drawn by
DJB

Project Number
578-24-002
Building Number
200
Drawing Number
200SOC-SB
Dwg.
8 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	KITCHEN SUITE	19,995 Sq. Ft.	NON PATIENT CARE	4
2	RADIOTHERAPY OFFICE SUITE	1,275 Sq. Ft.	NON PATIENT CARE	1
3	AUTOPSY SUITE	1,540 Sq. Ft.	NON PATIENT CARE	1
4	RADIOLOGY/ONCOLOGY SUITE	9,140 Sq. Ft.	NON SLEEPING PATIENT CARE	3
5	SPD SUITE	7,655 Sq. Ft.	NON PATIENT CARE	3
6	O.R. SUITE	20,038 Sq. Ft.	NON SLEEPING PATIENT CARE	3
7	GU CLINIC CYSTO SUITE	6,265 Sq. Ft.	NON SLEEPING PATIENT CARE	3

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
NORTH WEST	28,319 Sq. Ft.	AMBULATORY HEALTH CARE
NORTH EAST	15,577 Sq. Ft.	AMBULATORY HEALTH CARE
SOUTH WEST	36,201 Sq. Ft.	AMBULATORY HEALTH CARE
SOUTH EAST	24,237 Sq. Ft.	AMBULATORY HEALTH CARE

KEY NOTES:

- NON-SPRINKLERED ELECTRICAL ROOM PER SECTION 8.15.11.2 OF NFPA 13-2016 EDITION.
- SEE EQUIVALENCY FOR EXTENDED TRAVEL DISTANCE.
- MECHANICAL ROOM OPEN TO BELOW.

APPROVED EQUIVALENCIES

- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
- BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
- INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES


- BUILDING 200 - MAIN HOSPITAL
 - LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
 - MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
 LC LINEN CHUTE
 TC TRASH CHUTE
 EX EXIT
 HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

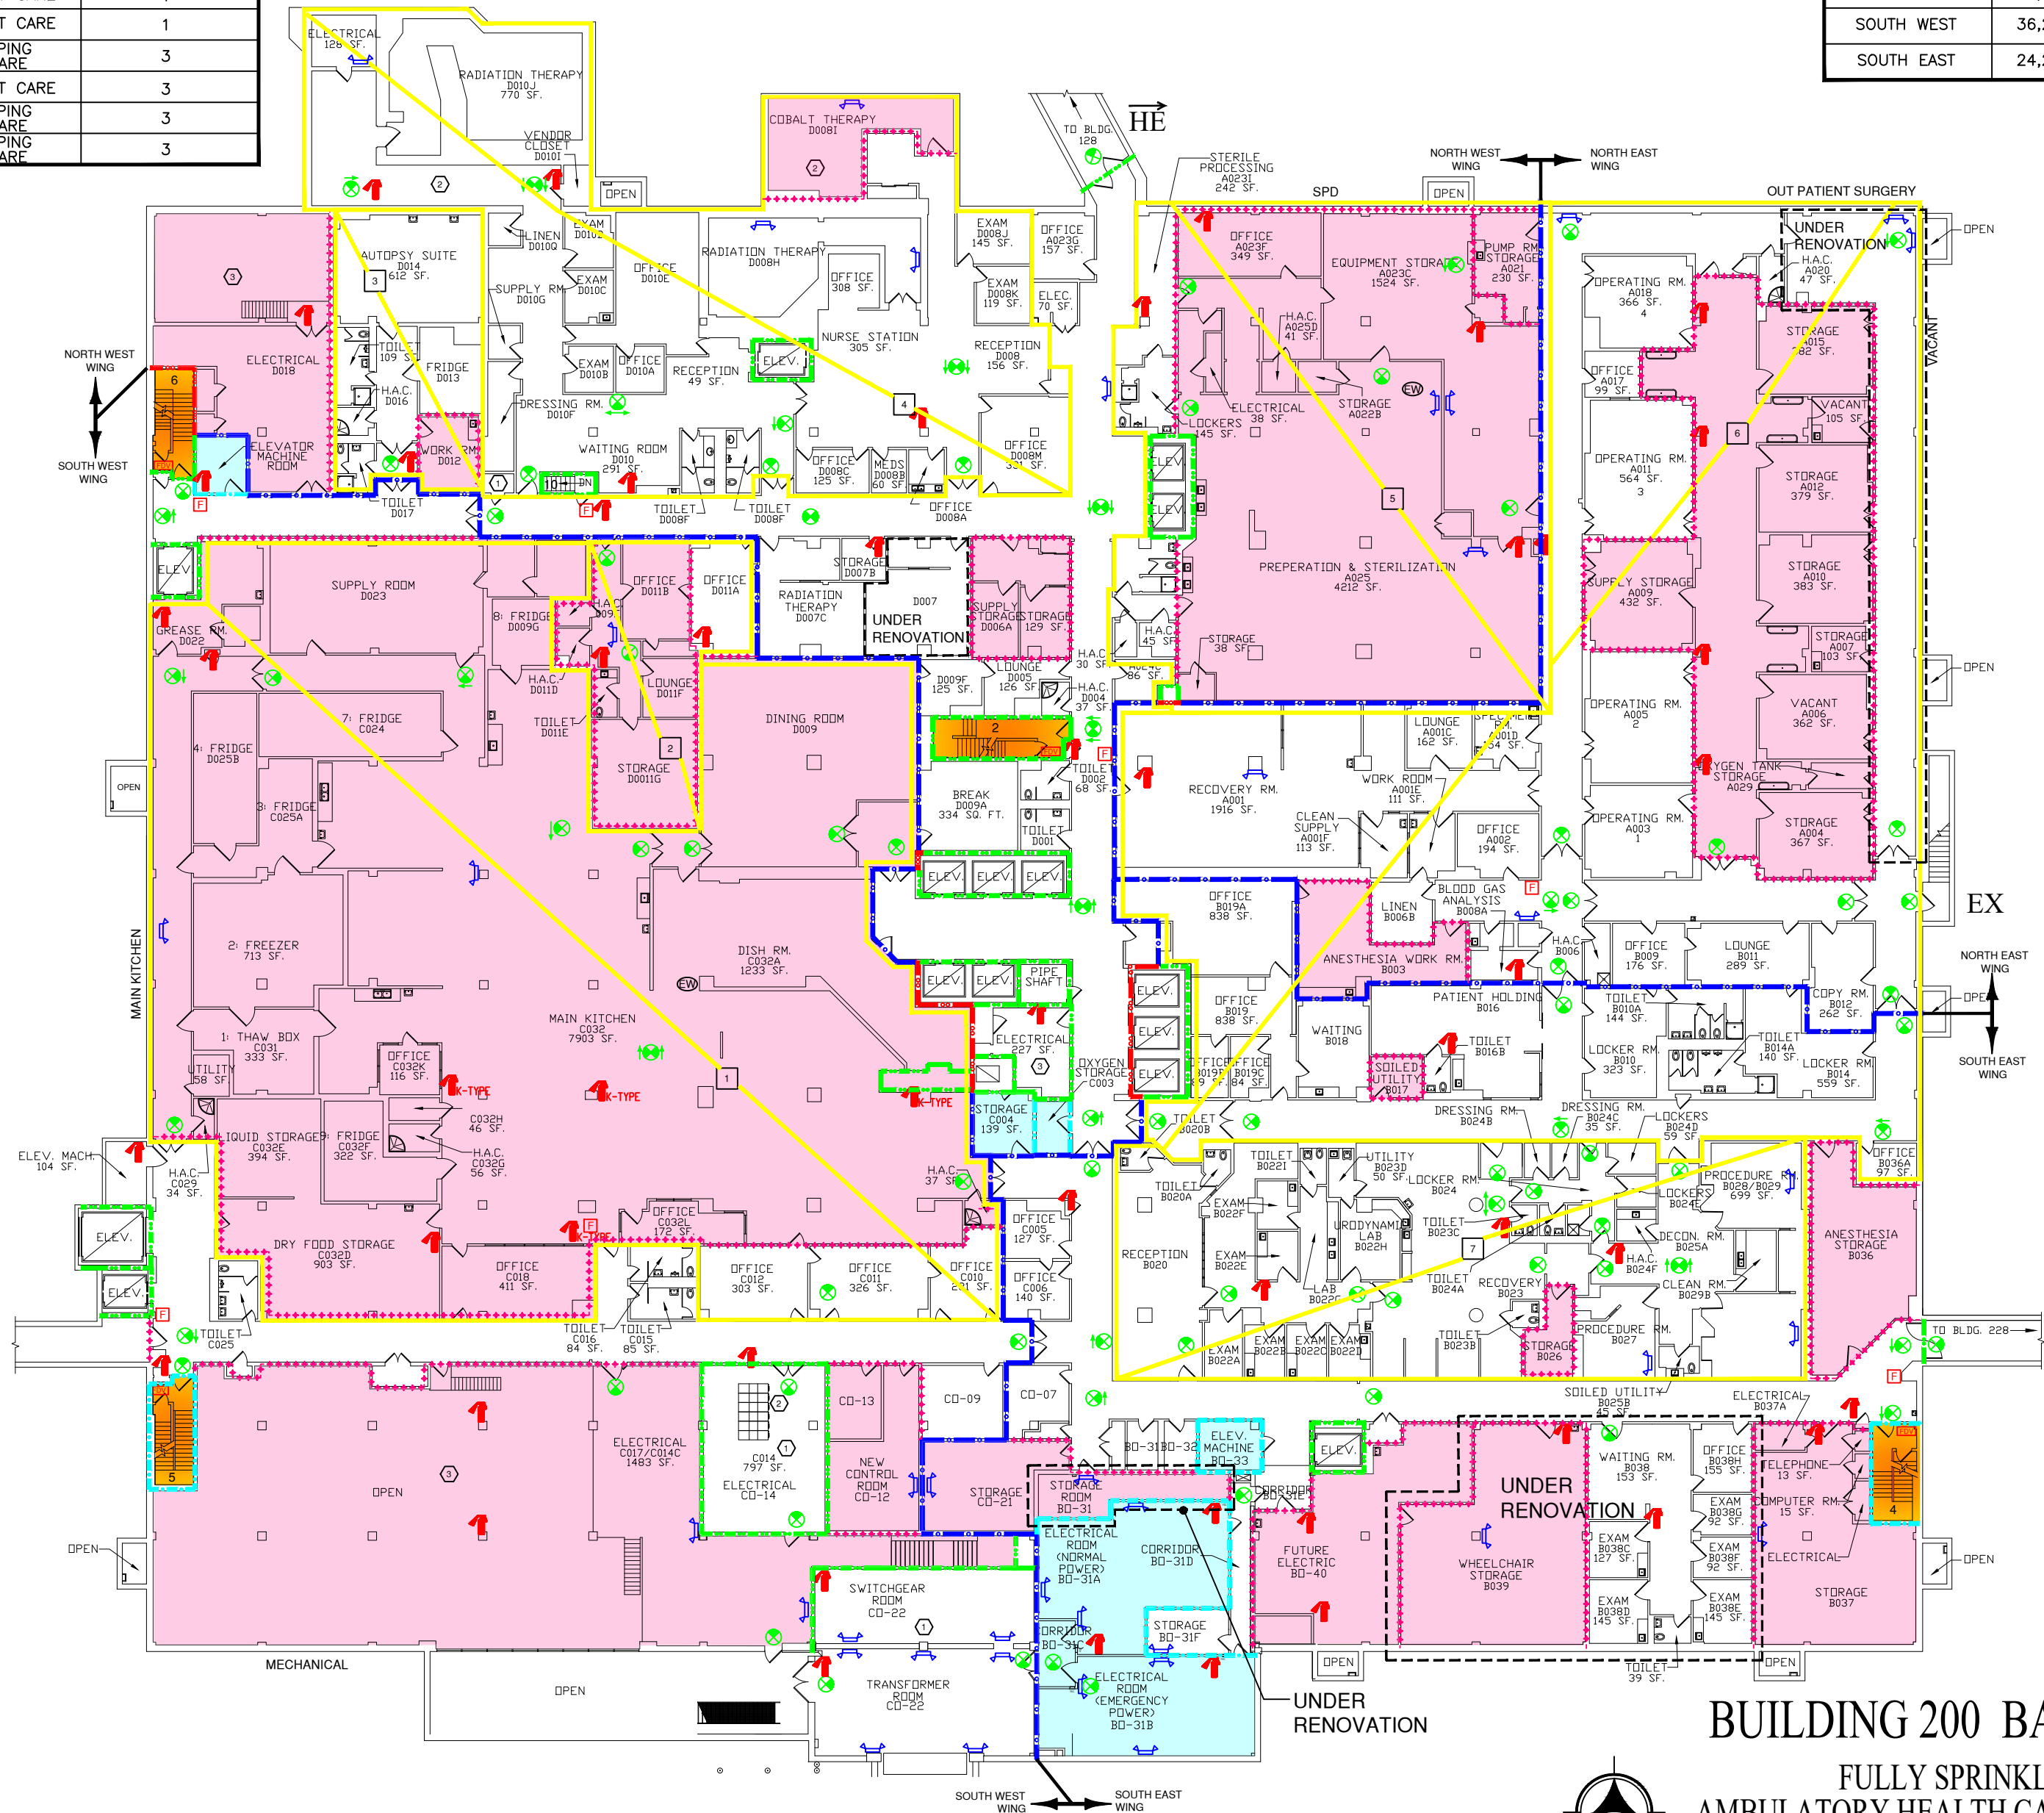

BUILDING 200 BASEMENT

FULLY SPRINKLERED
AMBULATORY HEALTH CARE OCCUPANCY



FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 200
BASEMENT

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location
HINES, ILLINOIS

Issue Date
06/19/2024

Checked by
JLB

Drawn by
DJB

Project Number

578-24-002

Building Number

200

Drawing Number

200SOC-B

Dwg. 9 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	EMERGENCY DEPT. SUITE	8,520 Sq. Ft.	NON SLEEPING PATIENT CARE	3
2	EYE CLINIC SUITE	5,880 Sq. Ft.	NON SLEEPING PATIENT CARE	3
3	CATH LAB SUITE	4,670 Sq. Ft.	NON SLEEPING PATIENT CARE	3
4	OUTPATIENT PHARMACY SUITE	5,500 Sq. Ft.	NON PATIENT CARE	3
5	CHAPLAIN OFFICE SUITE	680 Sq. Ft.	NON PATIENT CARE	2
6	INPATIENT PHARMACY SUITE	3,132 Sq. Ft.	NON PATIENT CARE	2
7	MRI/CT SCAN SUITE	6,740 Sq. Ft.	NON SLEEPING PATIENT CARE	4
8	EYE CLINIC SUITE	715 Sq. Ft.	NON SLEEPING PATIENT CARE	2
9	EYE DIAGNOSTIC CLINIC SUITE	3,275 Sq. Ft.	NON PATIENT CARE	3
10	LAB SUITE	8,640 Sq. Ft.	NON PATIENT CARE	4

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
NORTH WEST	19,786 Sq. Ft.	AMBULATORY HEALTH CARE
CENTER NORTH	24,018 Sq. Ft.	AMBULATORY HEALTH CARE
NORTH EAST	22,050 Sq. Ft.	AMBULATORY HEALTH CARE
CENTER WEST	20,659 Sq. Ft.	AMBULATORY HEALTH CARE
SOUTH WEST	10,786 Sq. Ft.	AMBULATORY HEALTH CARE
SOUTH EAST	11,972 Sq. Ft.	AMBULATORY HEALTH CARE

KEY NOTES:

- SEE EQUIVALENCY FOR STAIR 1 EXIT PASSAGEWAY.
- FIRE SPRINKLERS INSTALLED PER FLOOR MOUNTED OBSTRUCTION SPACING REQUIREMENTS OF TABLE 8.6.5.2.2 IN NFPA 13-2013 EDITION.
- DOOR LABEL LOCATED UNDER CONTINUOUS HINGE.
- UNSPRINKLERED ELECTRICAL POWER ROOM PROTECTED BY 2-HOUR FIRE BARRIER PER SECTION 708.20(B) OF NFPA 70-2019 EDITION

APPROVED EQUIVALENCIES

- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
- BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50 FEET.
- INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES

- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
- STAIR NO. 1 EXIT PASSAGEWAY.
- REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

EP	EXIT PASSAGEWAY
LC	LINEN CHUTE
TC	TRASH CHUTE
EX	EXIT
HE	HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

2 HOUR FIRE/SMOKE ZONE BARRIER	2 HOUR FIRE BARRIER
SMOKE ZONE BARRIER	1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE	NON-RATED SMOKE ZONE PARTITION
HEALTH CARE OCCUPANCY CORRIDORS	NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
SPRINKLER AND FIRE ALARM ZONE BOUNDARY	1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE	EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION	AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED	



BUILDING 200 FIRST FLOOR

FULLY SPRINKLERED
AMBULATORY HEALTH CARE OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 200
FIRST FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

200

Drawing Number

200SOC-1

Dwg. 10 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	PACU SUITE	7,168 Sq. Ft.	NON SLEEPING PATIENT CARE	2
2	SURGICAL SUITE	9,450 Sq. Ft.	NON SLEEPING PATIENT CARE	2

KEY NOTES:

- 1 MECHANICAL ROOM IS A VERTICAL EXTENSION OF THE FIRST FLOOR. NO FLOOR SLAB FIRE DAMPERS REQUIRED.
- 2 FRAME LABEL UNDER CONTINUOUS HINGE.

APPROVED EQUIVALENCIES

1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES

- BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- EX EXIT
- HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 200
SECOND FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

200

Drawing Number

200SOC-2

Dwg. 11 of 64

BUILDING 200 SECOND FLOOR




FULLY SPRINKLERED
HEALTH CARE OCCUPANCY



SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
NORTH WEST	20,604 Sq. Ft.	HEALTH CARE
NORTH EAST	11,313 Sq. Ft.	HEALTH CARE
CENTER	21,239 Sq. Ft.	HEALTH CARE
SOUTH WEST	11,668 Sq. Ft.	HEALTH CARE
SOUTH EAST	11,232 Sq. Ft.	HEALTH CARE

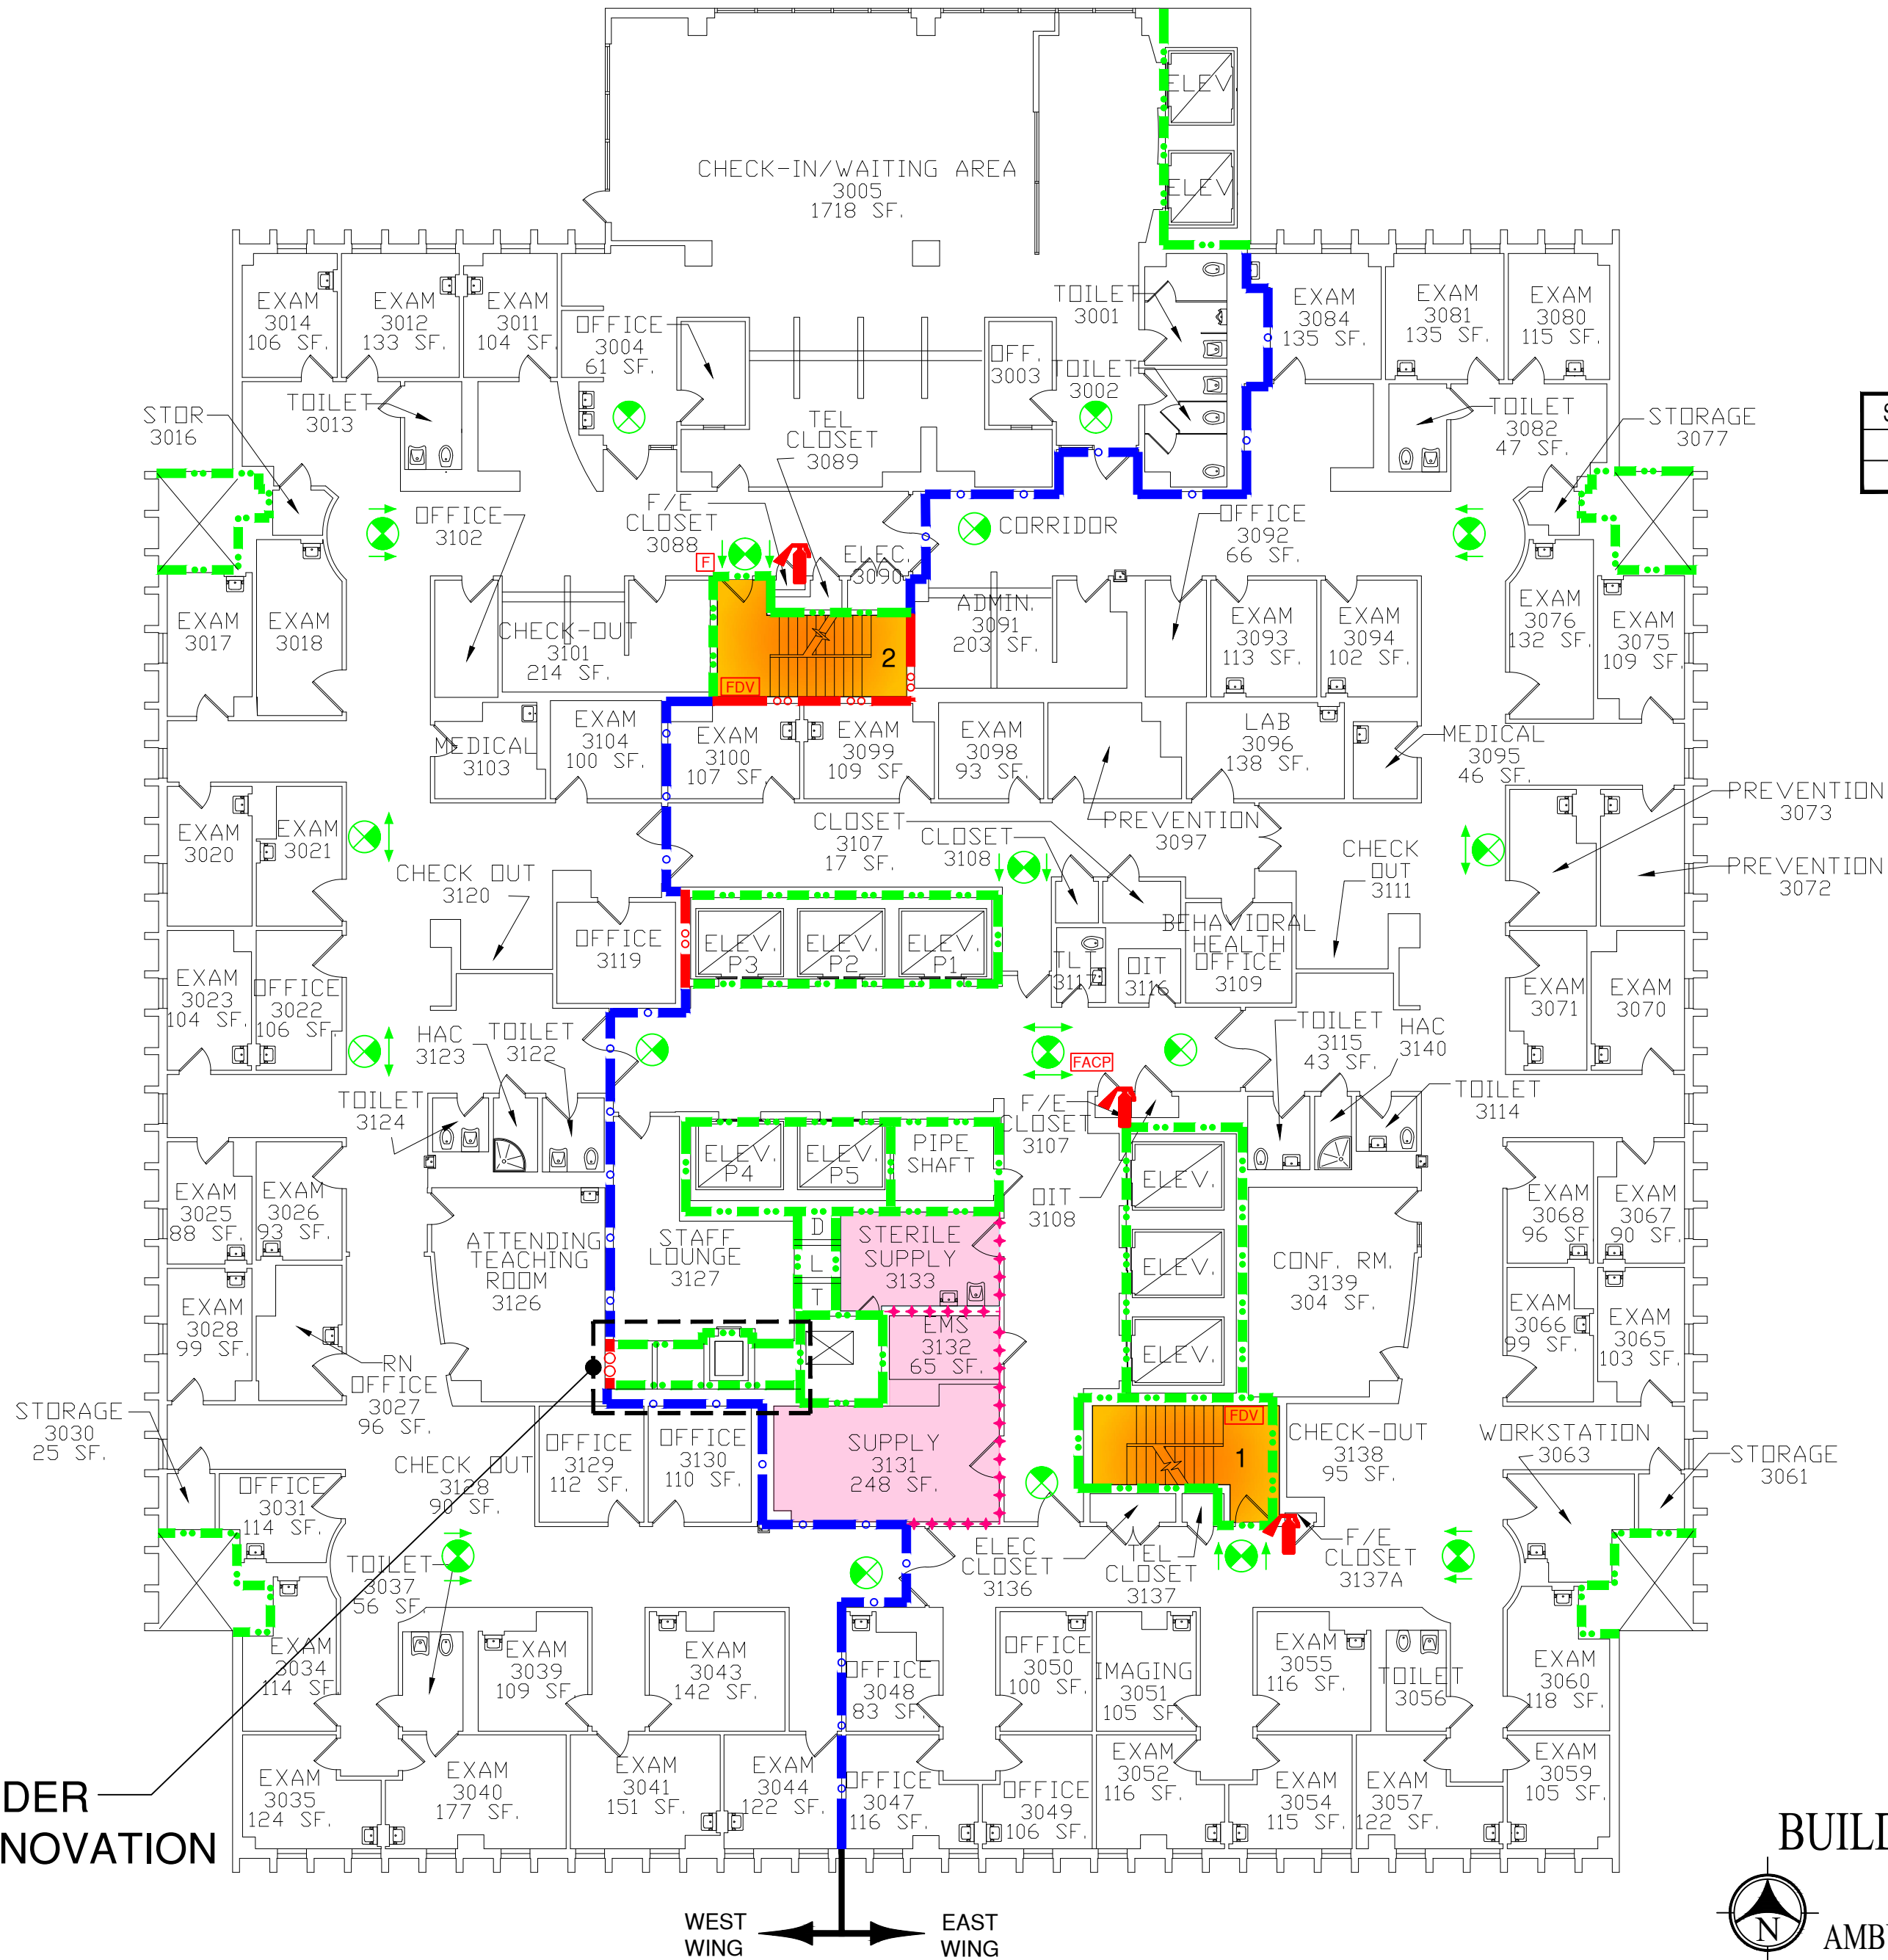

SMOKE ZONE SIZE		
SMOKE ZONE	SQ. FT.	OCCUPANCY
WEST	10,753 Sq. Ft.	AMBULATORY CARE
EAST	12,460 Sq. Ft.	AMBULATORY CARE

- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- EX EXIT
- HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

UNDER
RENOVATION

BUILDING 200 THIRD FLOOR
FULLY SPRINKLERED
AMBULATORY HEALTH CARE OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title	BUILDING 200 THIRD FLOOR	
Approved: Project Director		

Project Title	EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION	
Location	HINES, ILLINOIS	
Issue Date	Checked by	Drawn by
06/19/2024	JLB	DJB

Project Number	578-24-002
Building Number	200
Drawing Number	200SOC-3
Dwg.	12 of 64

- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.


SYMBOLS LIST

- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- EX EXIT
- HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

UNDER RENOVATION

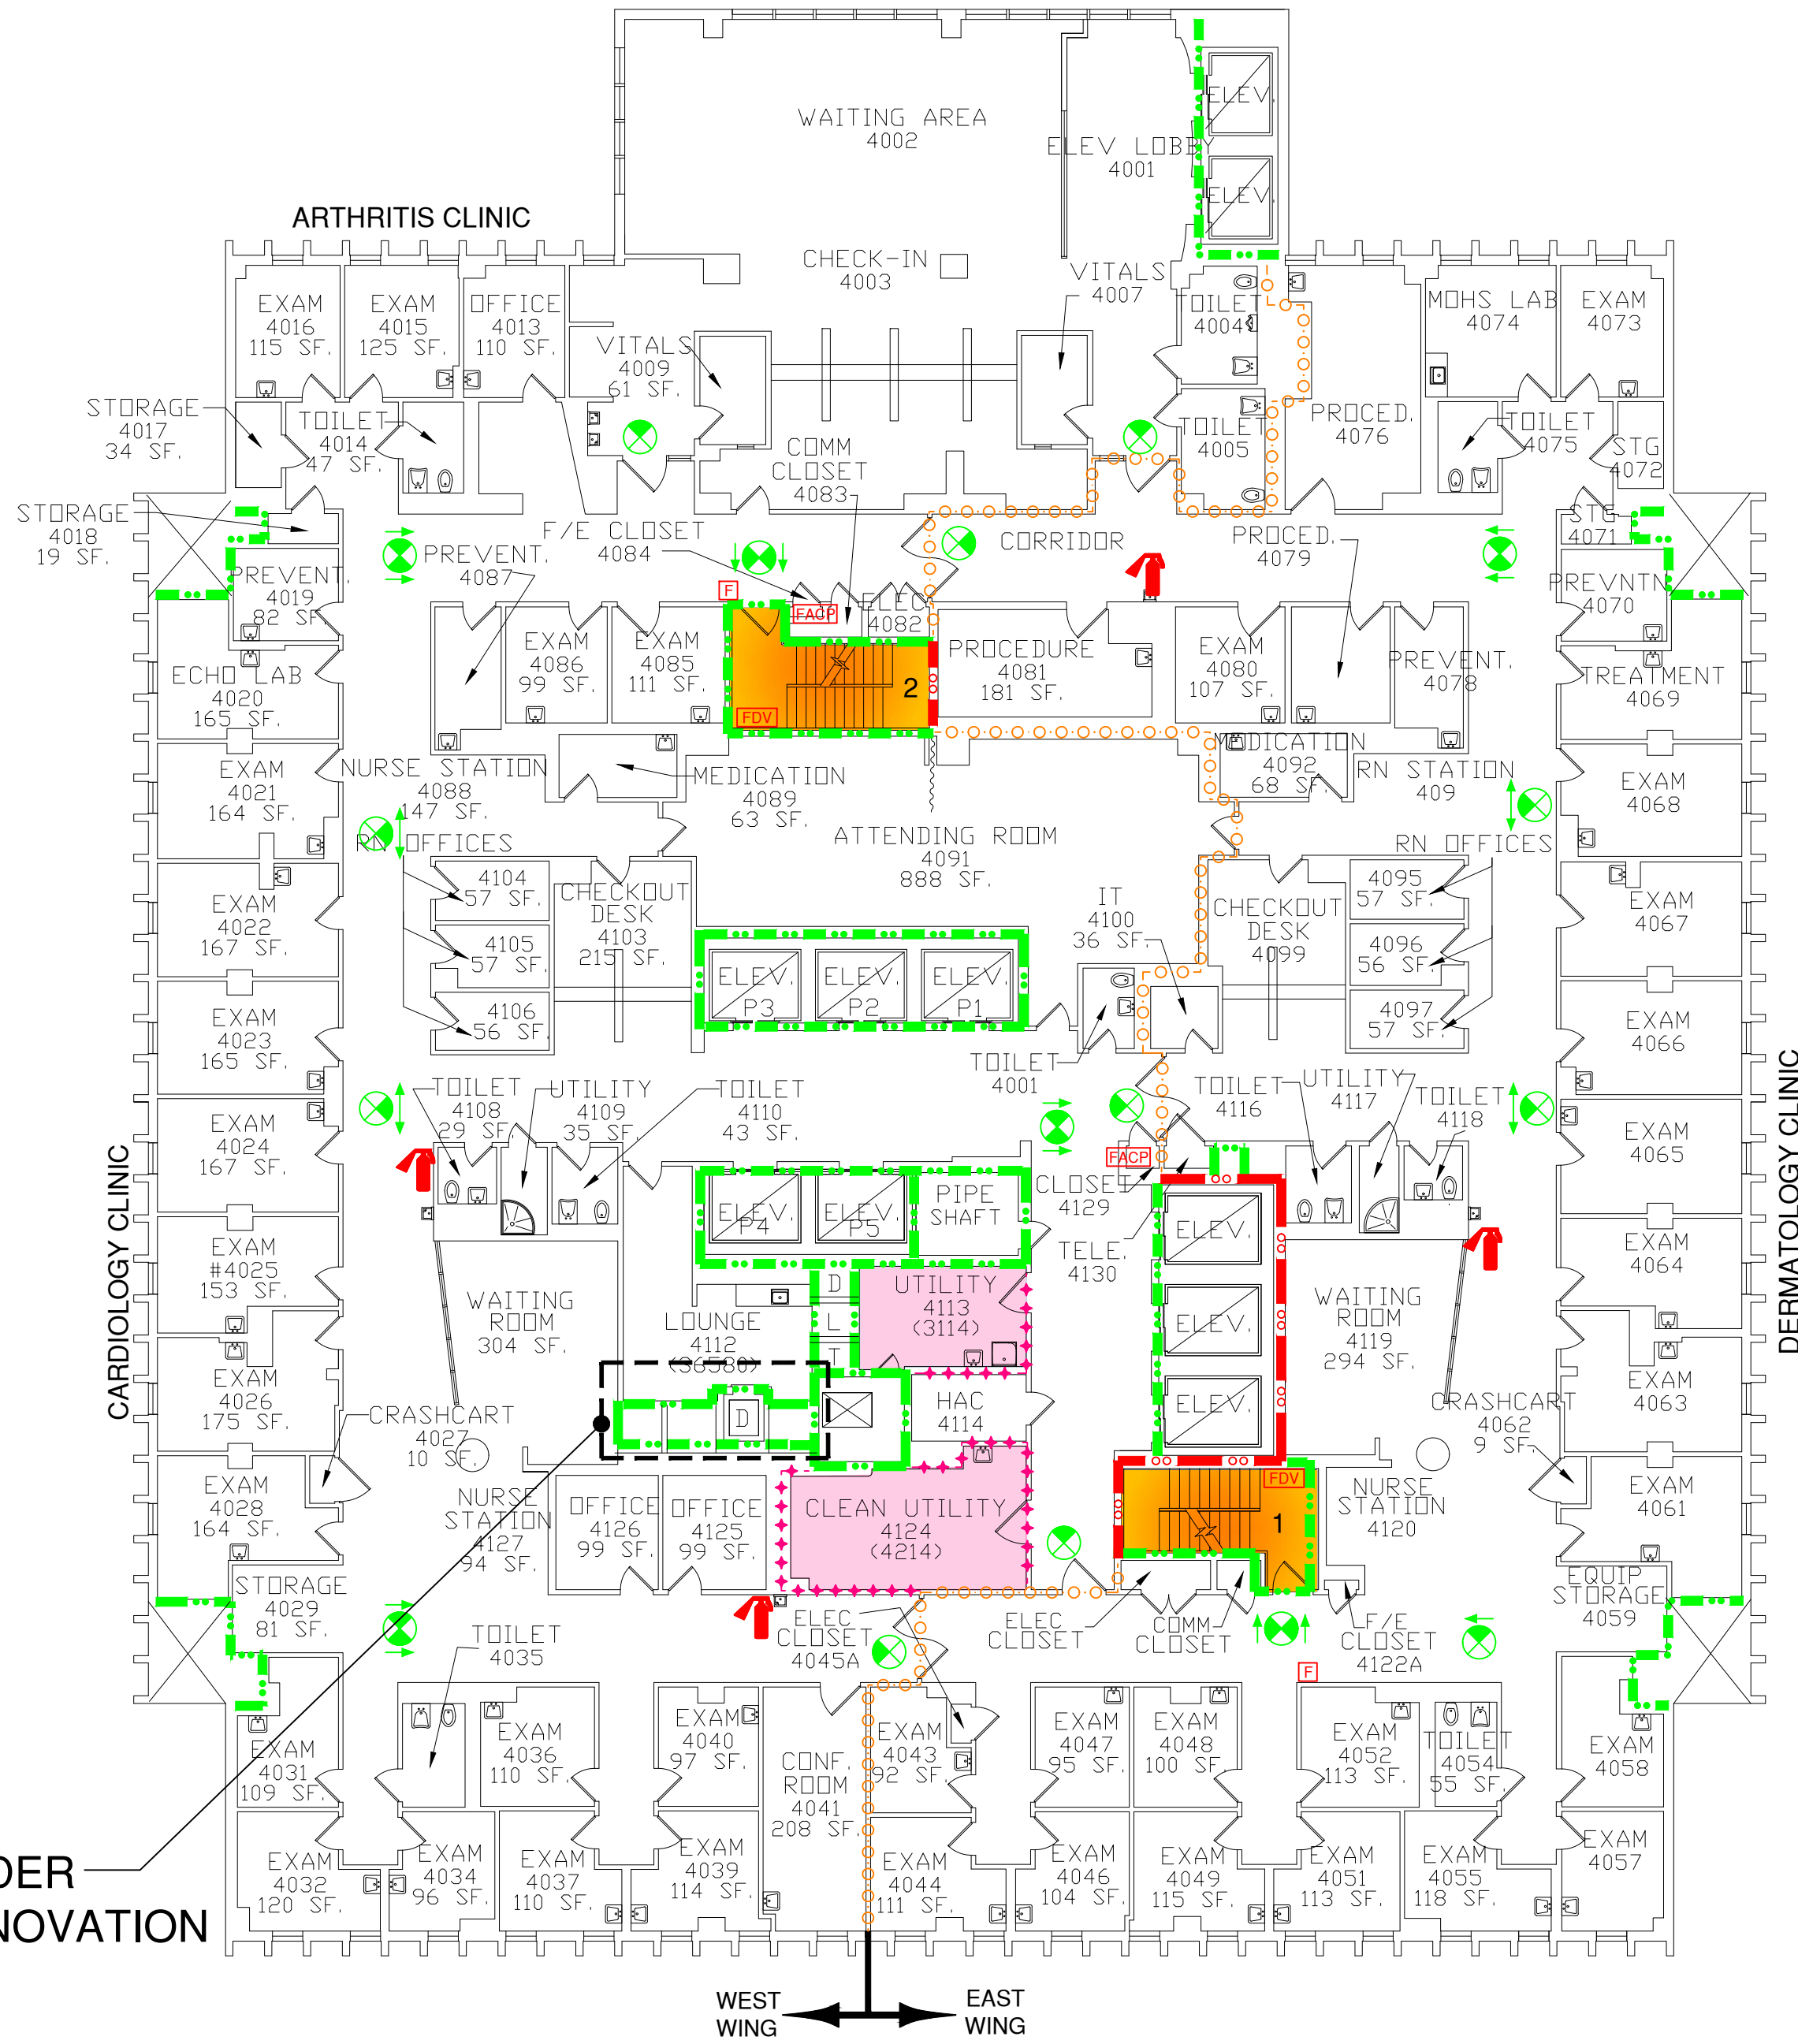

BUILDING 200 FOURTH FLOOR

FULLY SPRINKLERED
BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

 Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

 **FPC & CONSULTANTS**

FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 200
FOURTH FLOOR

Approved: Project Director

Project Title		EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION		Project Number 578-24-002	
Location		HINES, ILLINOIS		Building Number 200	
Issue Date	06/19/2024	Checked by	JLB	Drawn by	DJB
Drawing Number 200SOC-4				Dwg. 13 of 64	

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	OUTPATIENT SURGERY SUITE	1,177 Sq. Ft.	NON SLEEPING PATIENT CARE	1

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
WEST	9,206 Sq. Ft.	AMBULATORY HEALTH CARE
EAST	12,627 Sq. Ft.	AMBULATORY HEALTH CARE


- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- EX EXIT
- HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

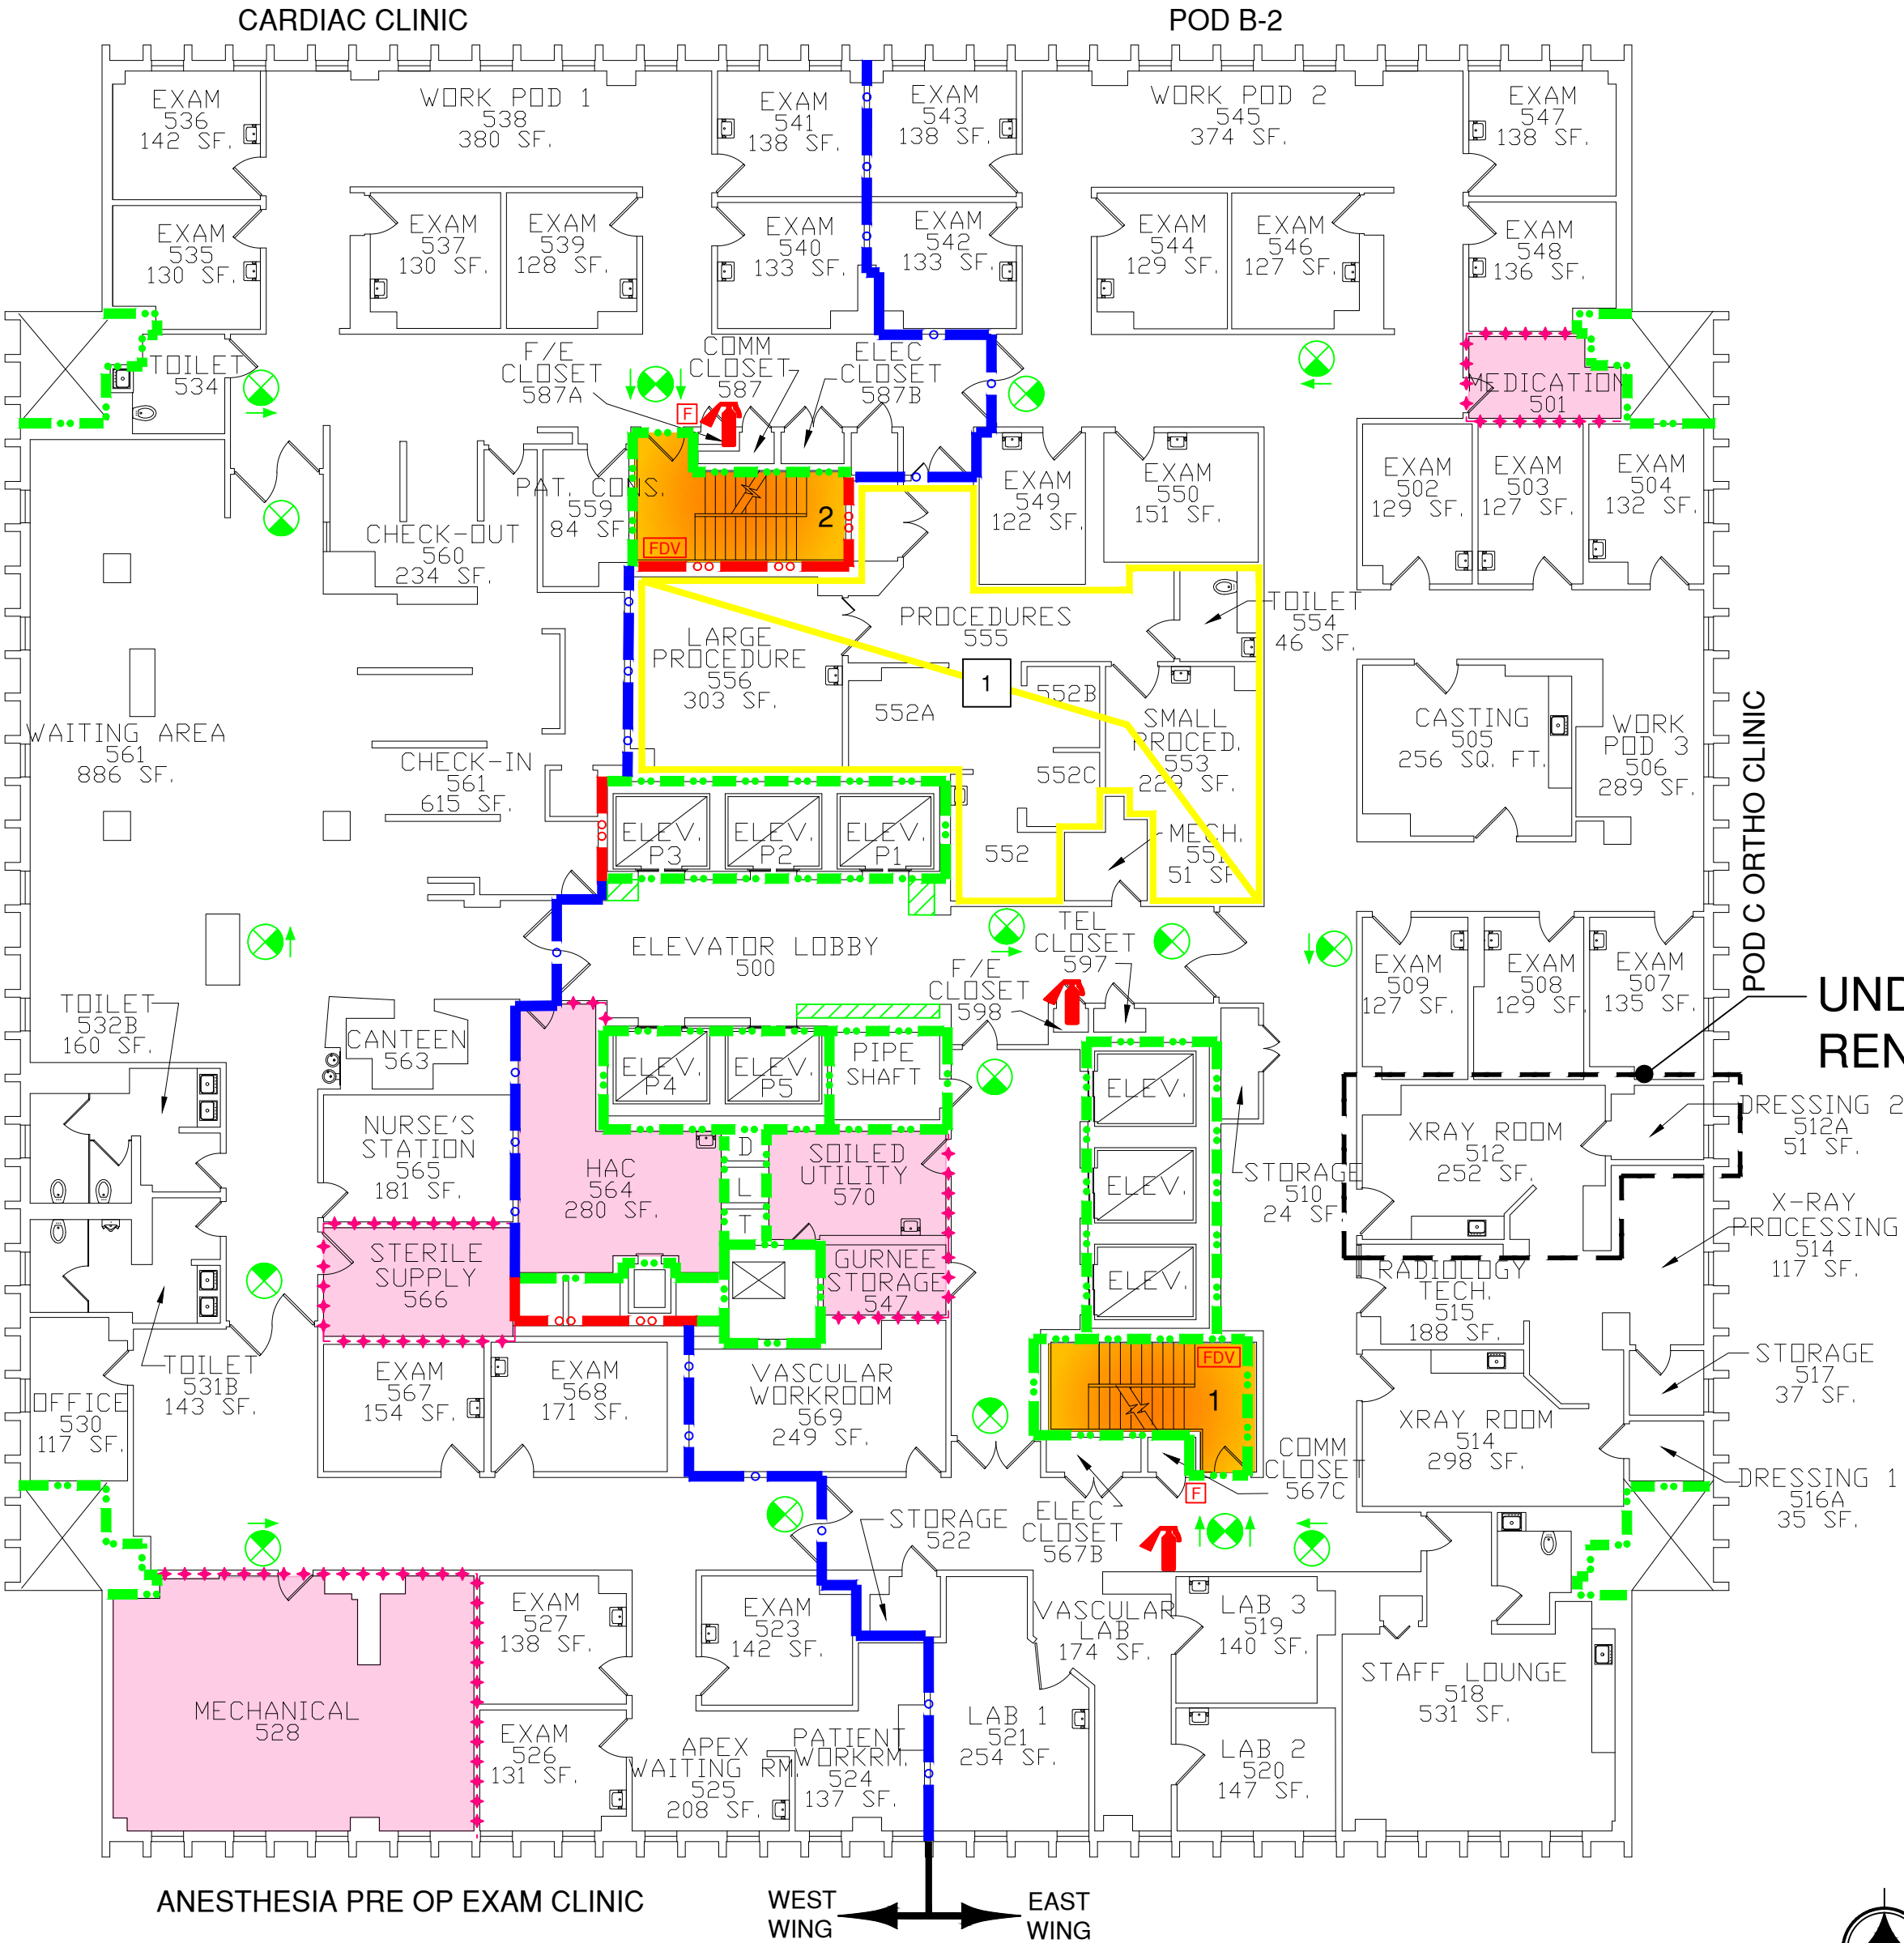

UNDER RENOVATION

BUILDING 200 FIFTH FLOOR



FULLY SPRINKLERED
AMBULATORY HEALTH CARE OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title	BUILDING 200 FIFTH FLOOR
Approved: Project Director	

Project Title	EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION
Location	HINES, ILLINOIS
Issue Date	06/19/2024
Checked by	JLB
Drawn by	DJB

Project Number	578-24-002
Building Number	200
Drawing Number	200SOC-5
Dwg.	14 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	DIALYSIS SUITE	2,959 Sq. Ft.	NON SLEEPING PATIENT CARE	1

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
WEST	8,955 Sq. Ft.	BUSINESS
EAST	12,867 Sq. Ft.	BUSINESS

- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.


SYMBOLS LIST

- EP → EXIT PASSAGEWAY
LC → LINEN CHUTE
TC → TRASH CHUTE
EX → EXIT
HE → HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
2 HOUR FIRE BARRIER
SMOKE ZONE BARRIER
1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
NON-RATED SMOKE ZONE PARTITION
HEALTH CARE OCCUPANCY CORRIDORS
NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
SPRINKLER AND FIRE ALARM ZONE BOUNDARY
1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION
AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

UNDER
RENOVATION

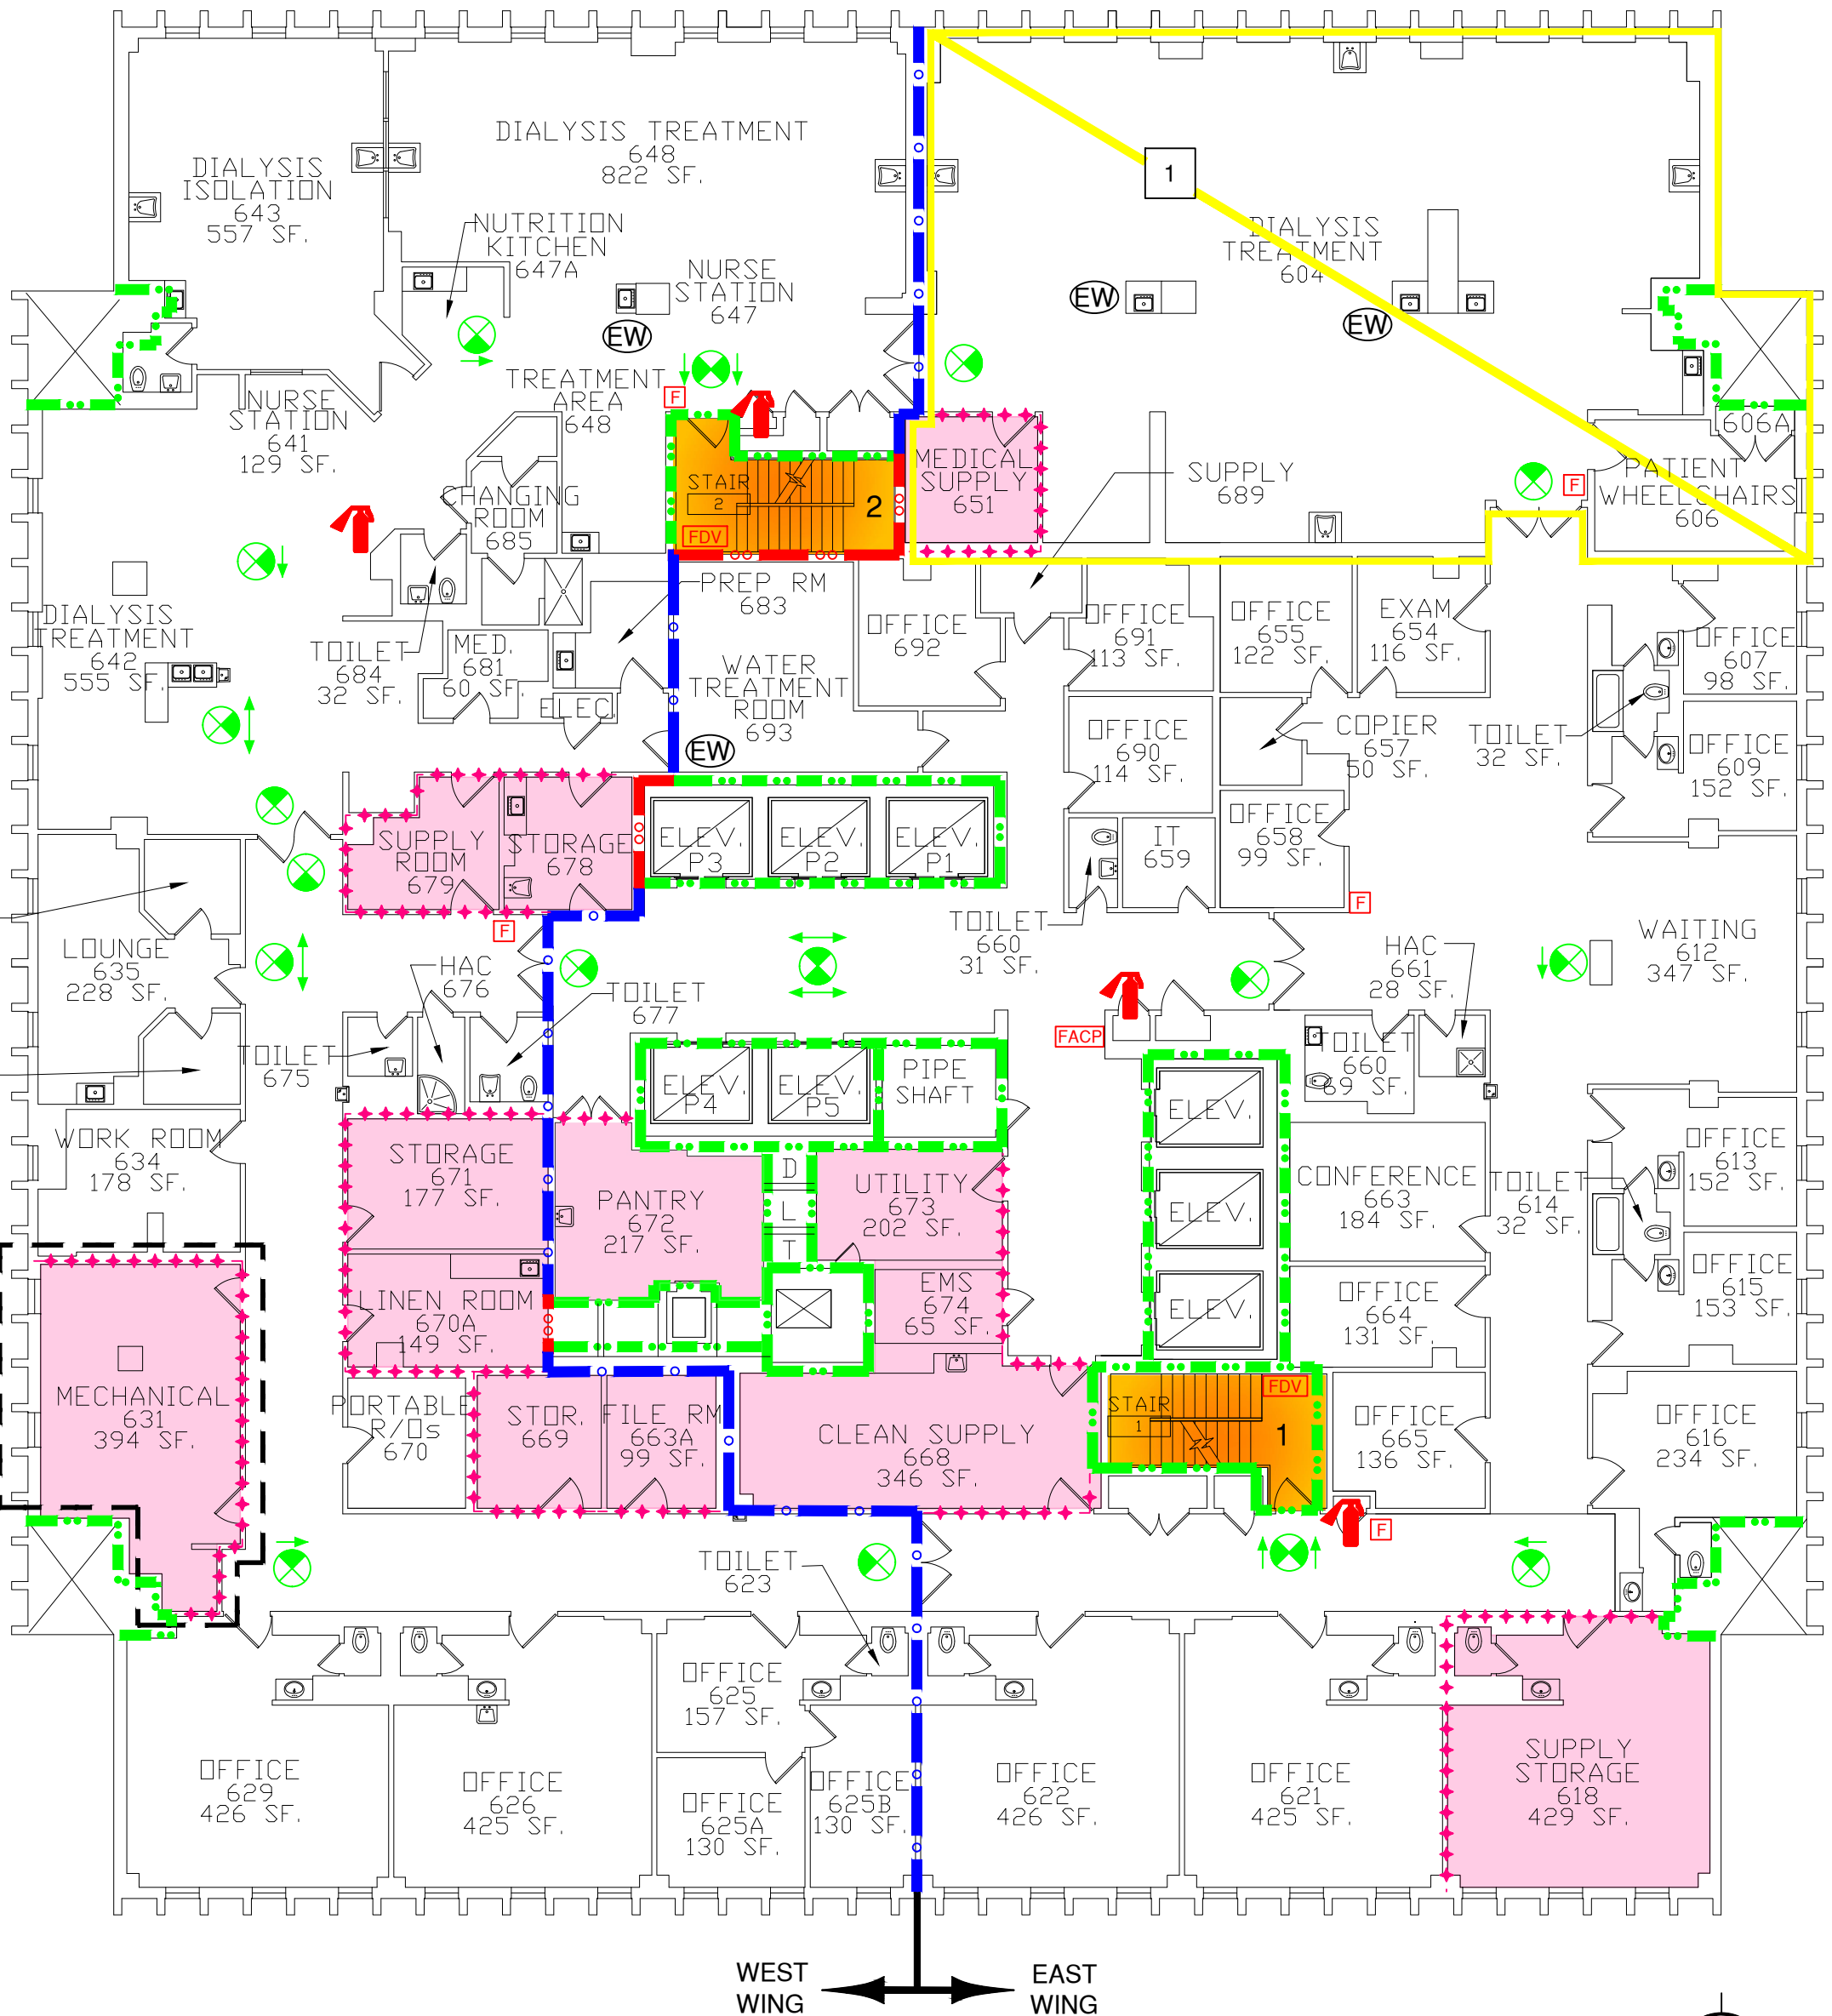

BUILDING 200 SIXTH FLOOR
FULLY SPRINKLERED
(QUICK RESPONSE TYPE)
AMBULATORY HEALTH CARE OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 200
SIXTH FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

200


Drawing Number

200SOC-6

Dwg. 15 of 64

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
WEST	8,823 Sq. Ft.	HEALTH CARE
EAST	13,013 Sq. Ft.	HEALTH CARE

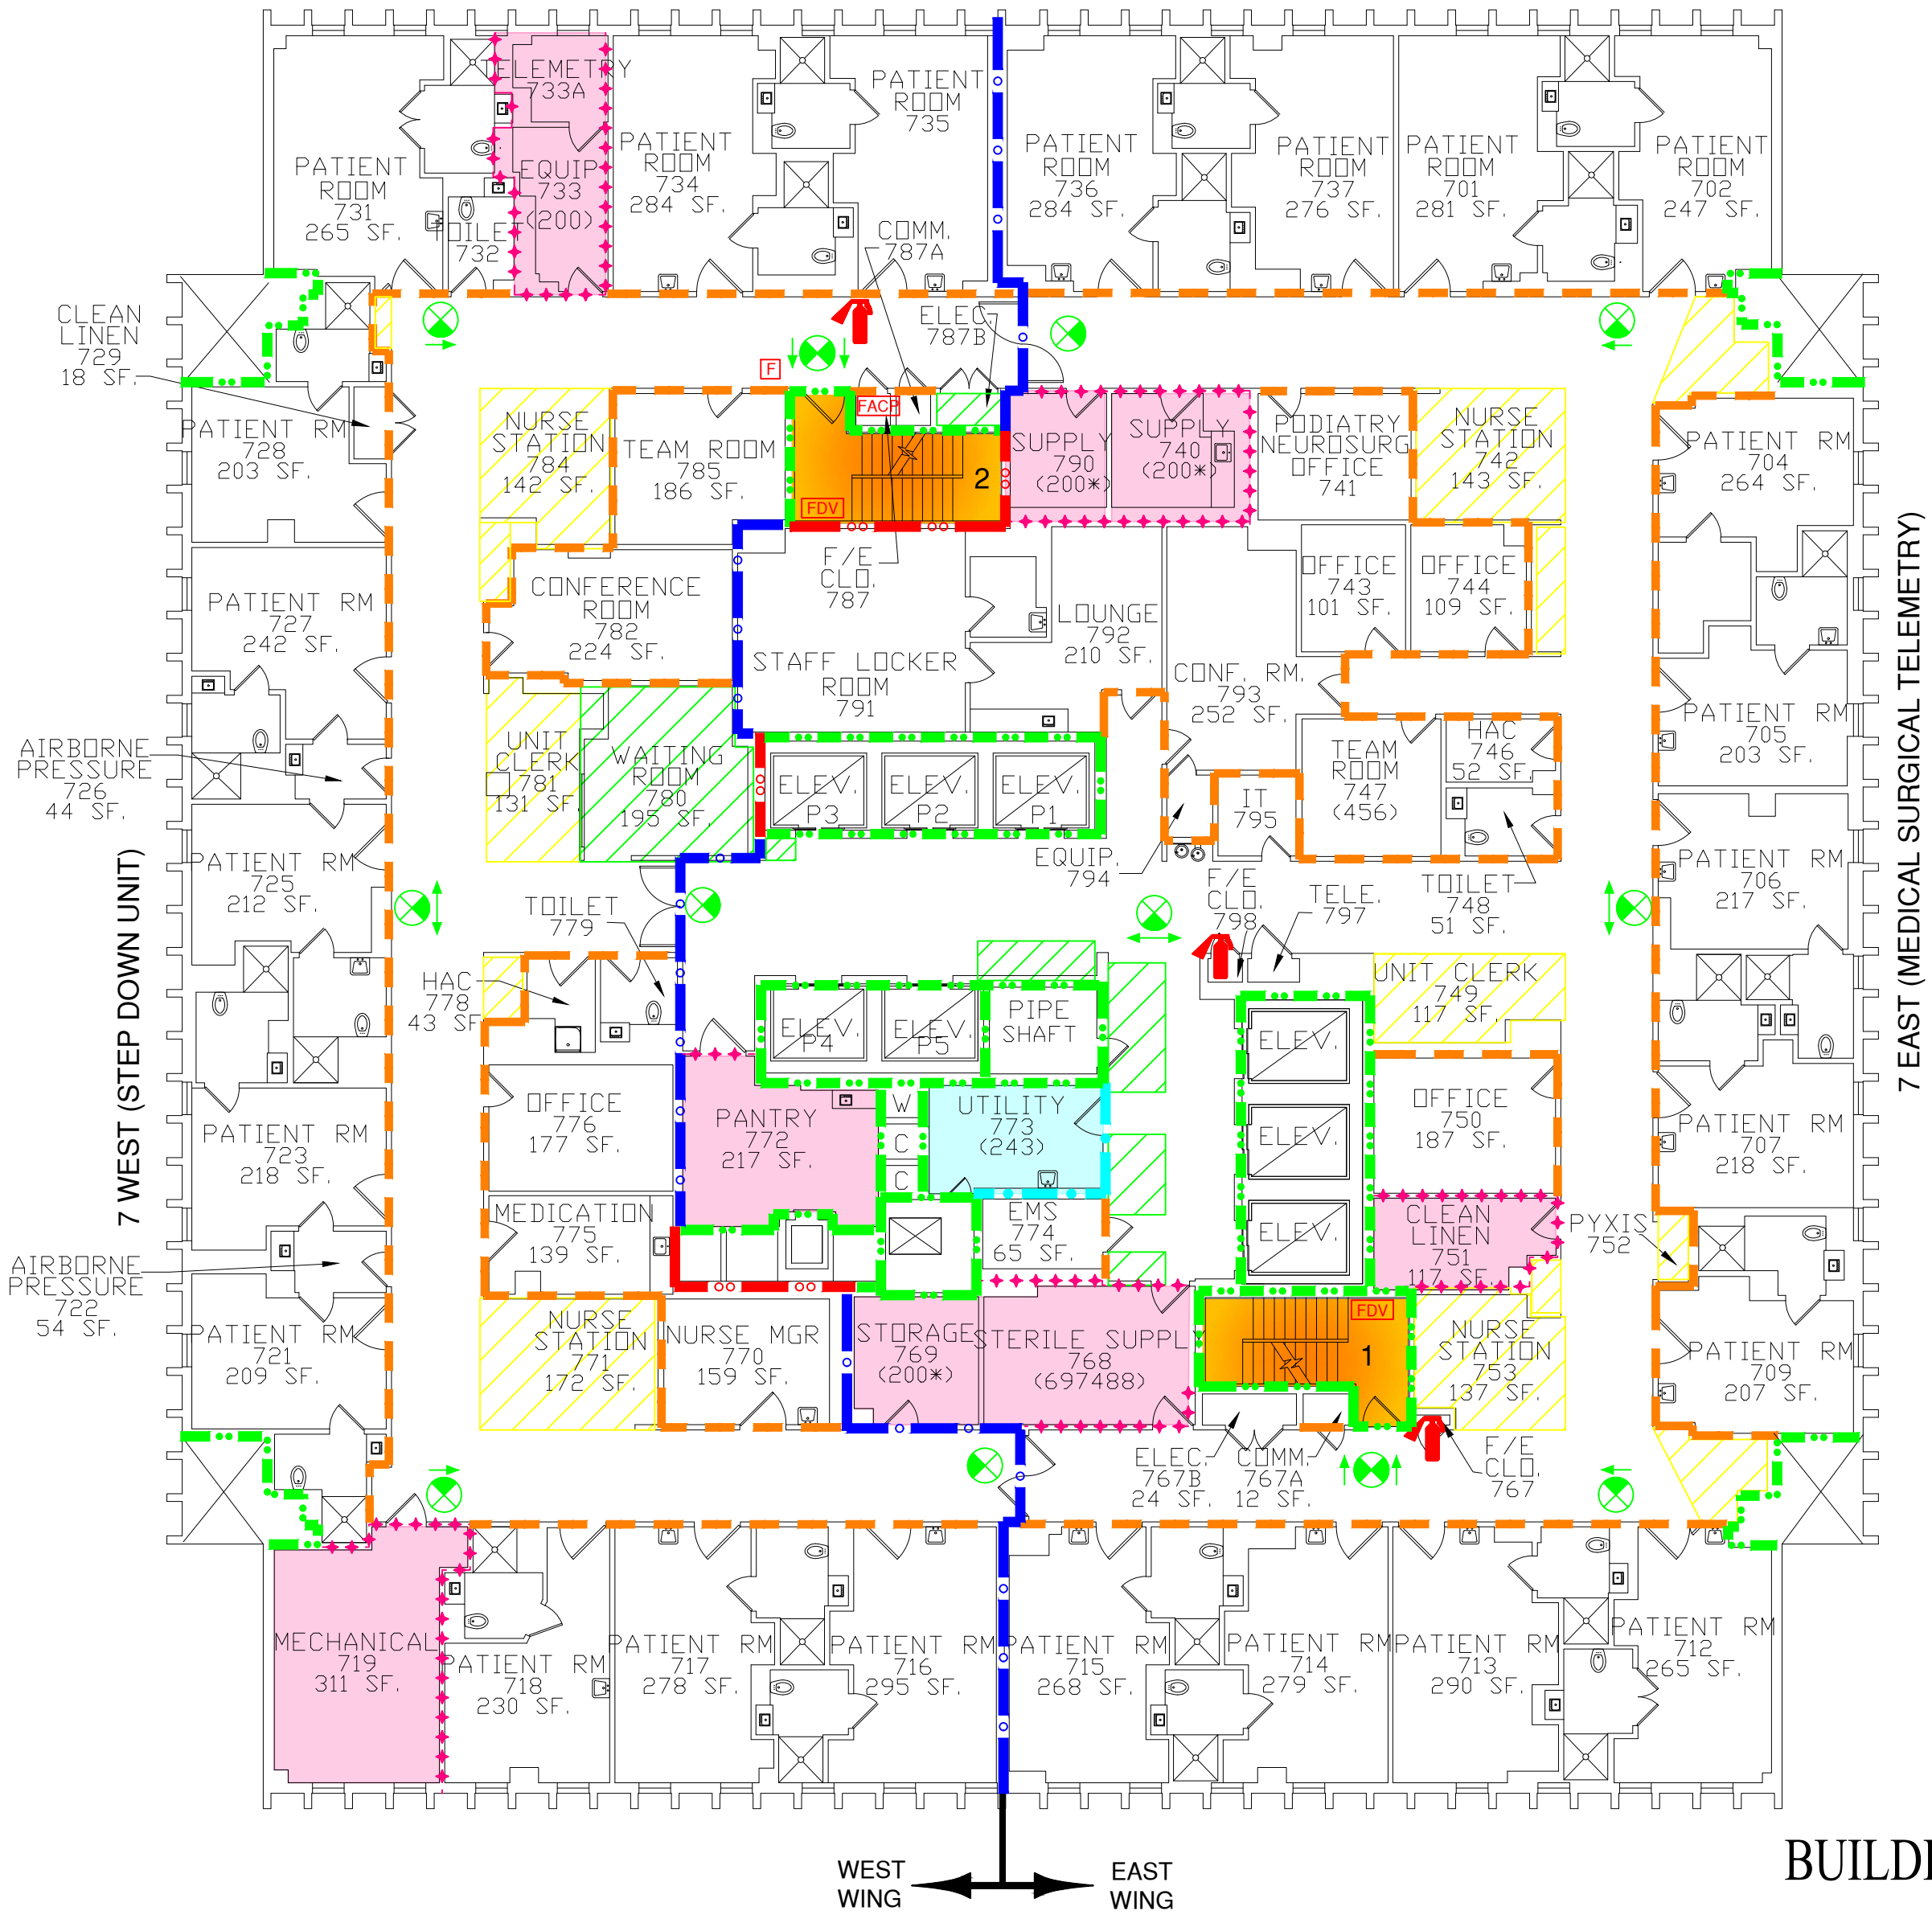

- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- EX EXIT
- HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

BUILDING 200 SEVENTH FLOOR

FULLY SPRINKLERED
(QUICK RESPONSE TYPE)

HEALTH CARE OCCUPANCY



FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 200
SEVENTH FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

200

Drawing Number

200SOC-7

Dwg. 16 of 64

KEY NOTES:

1 DOOR LABEL UNDER CONTINUOUS HINGE.


- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
LC LINEN CHUTE
TC TRASH CHUTE
EX EXIT
HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
2 HOUR FIRE BARRIER
SMOKE ZONE BARRIER
1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
NON-RATED SMOKE ZONE PARTITION
HEALTH CARE OCCUPANCY CORRIDORS
NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
SPRINKLER AND FIRE ALARM ZONE BOUNDARY
1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION
AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

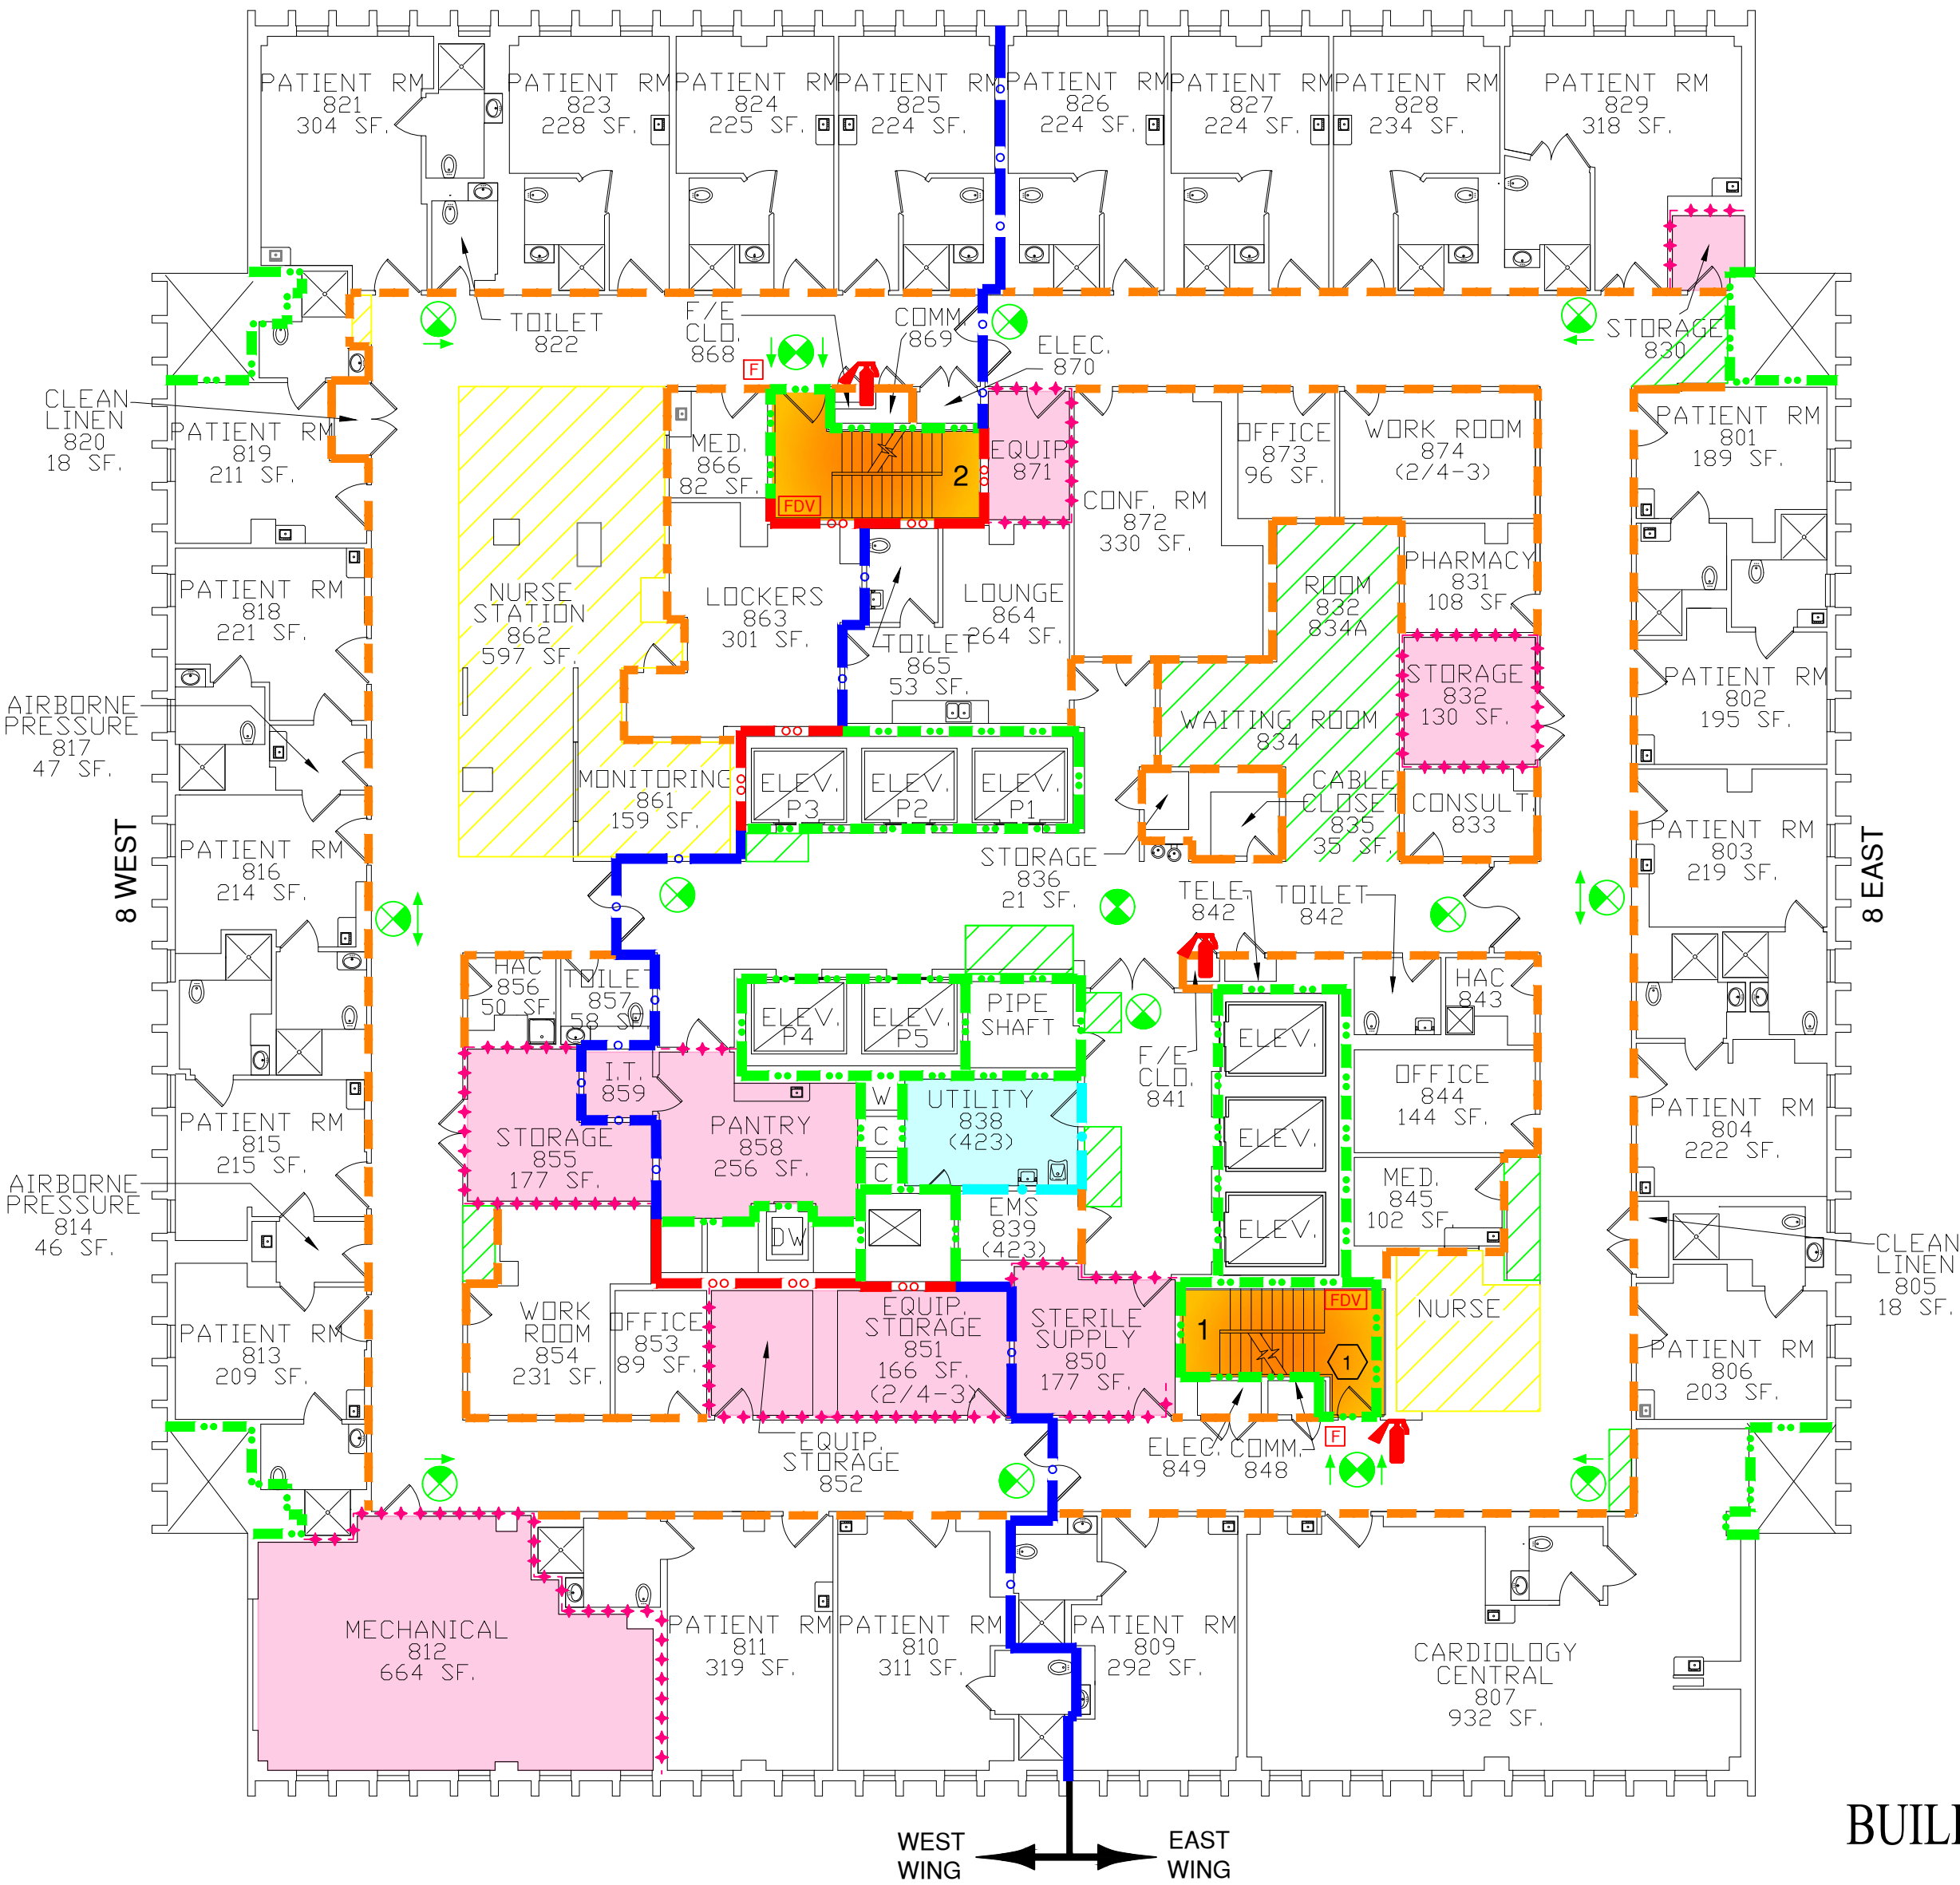

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
WEST	9,314 Sq. Ft.	HEALTH CARE
EAST	12,519 Sq. Ft.	HEALTH CARE

BUILDING 200 EIGHTH FLOOR



FULLY SPRINKLERED
HEALTH CARE OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 200
EIGHTH FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

200


Drawing Number

200SOC8

Dwg. 17 of 64

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
WEST	8,719 Sq. Ft.	HEALTH CARE
EAST	13,112 Sq. Ft.	HEALTH CARE

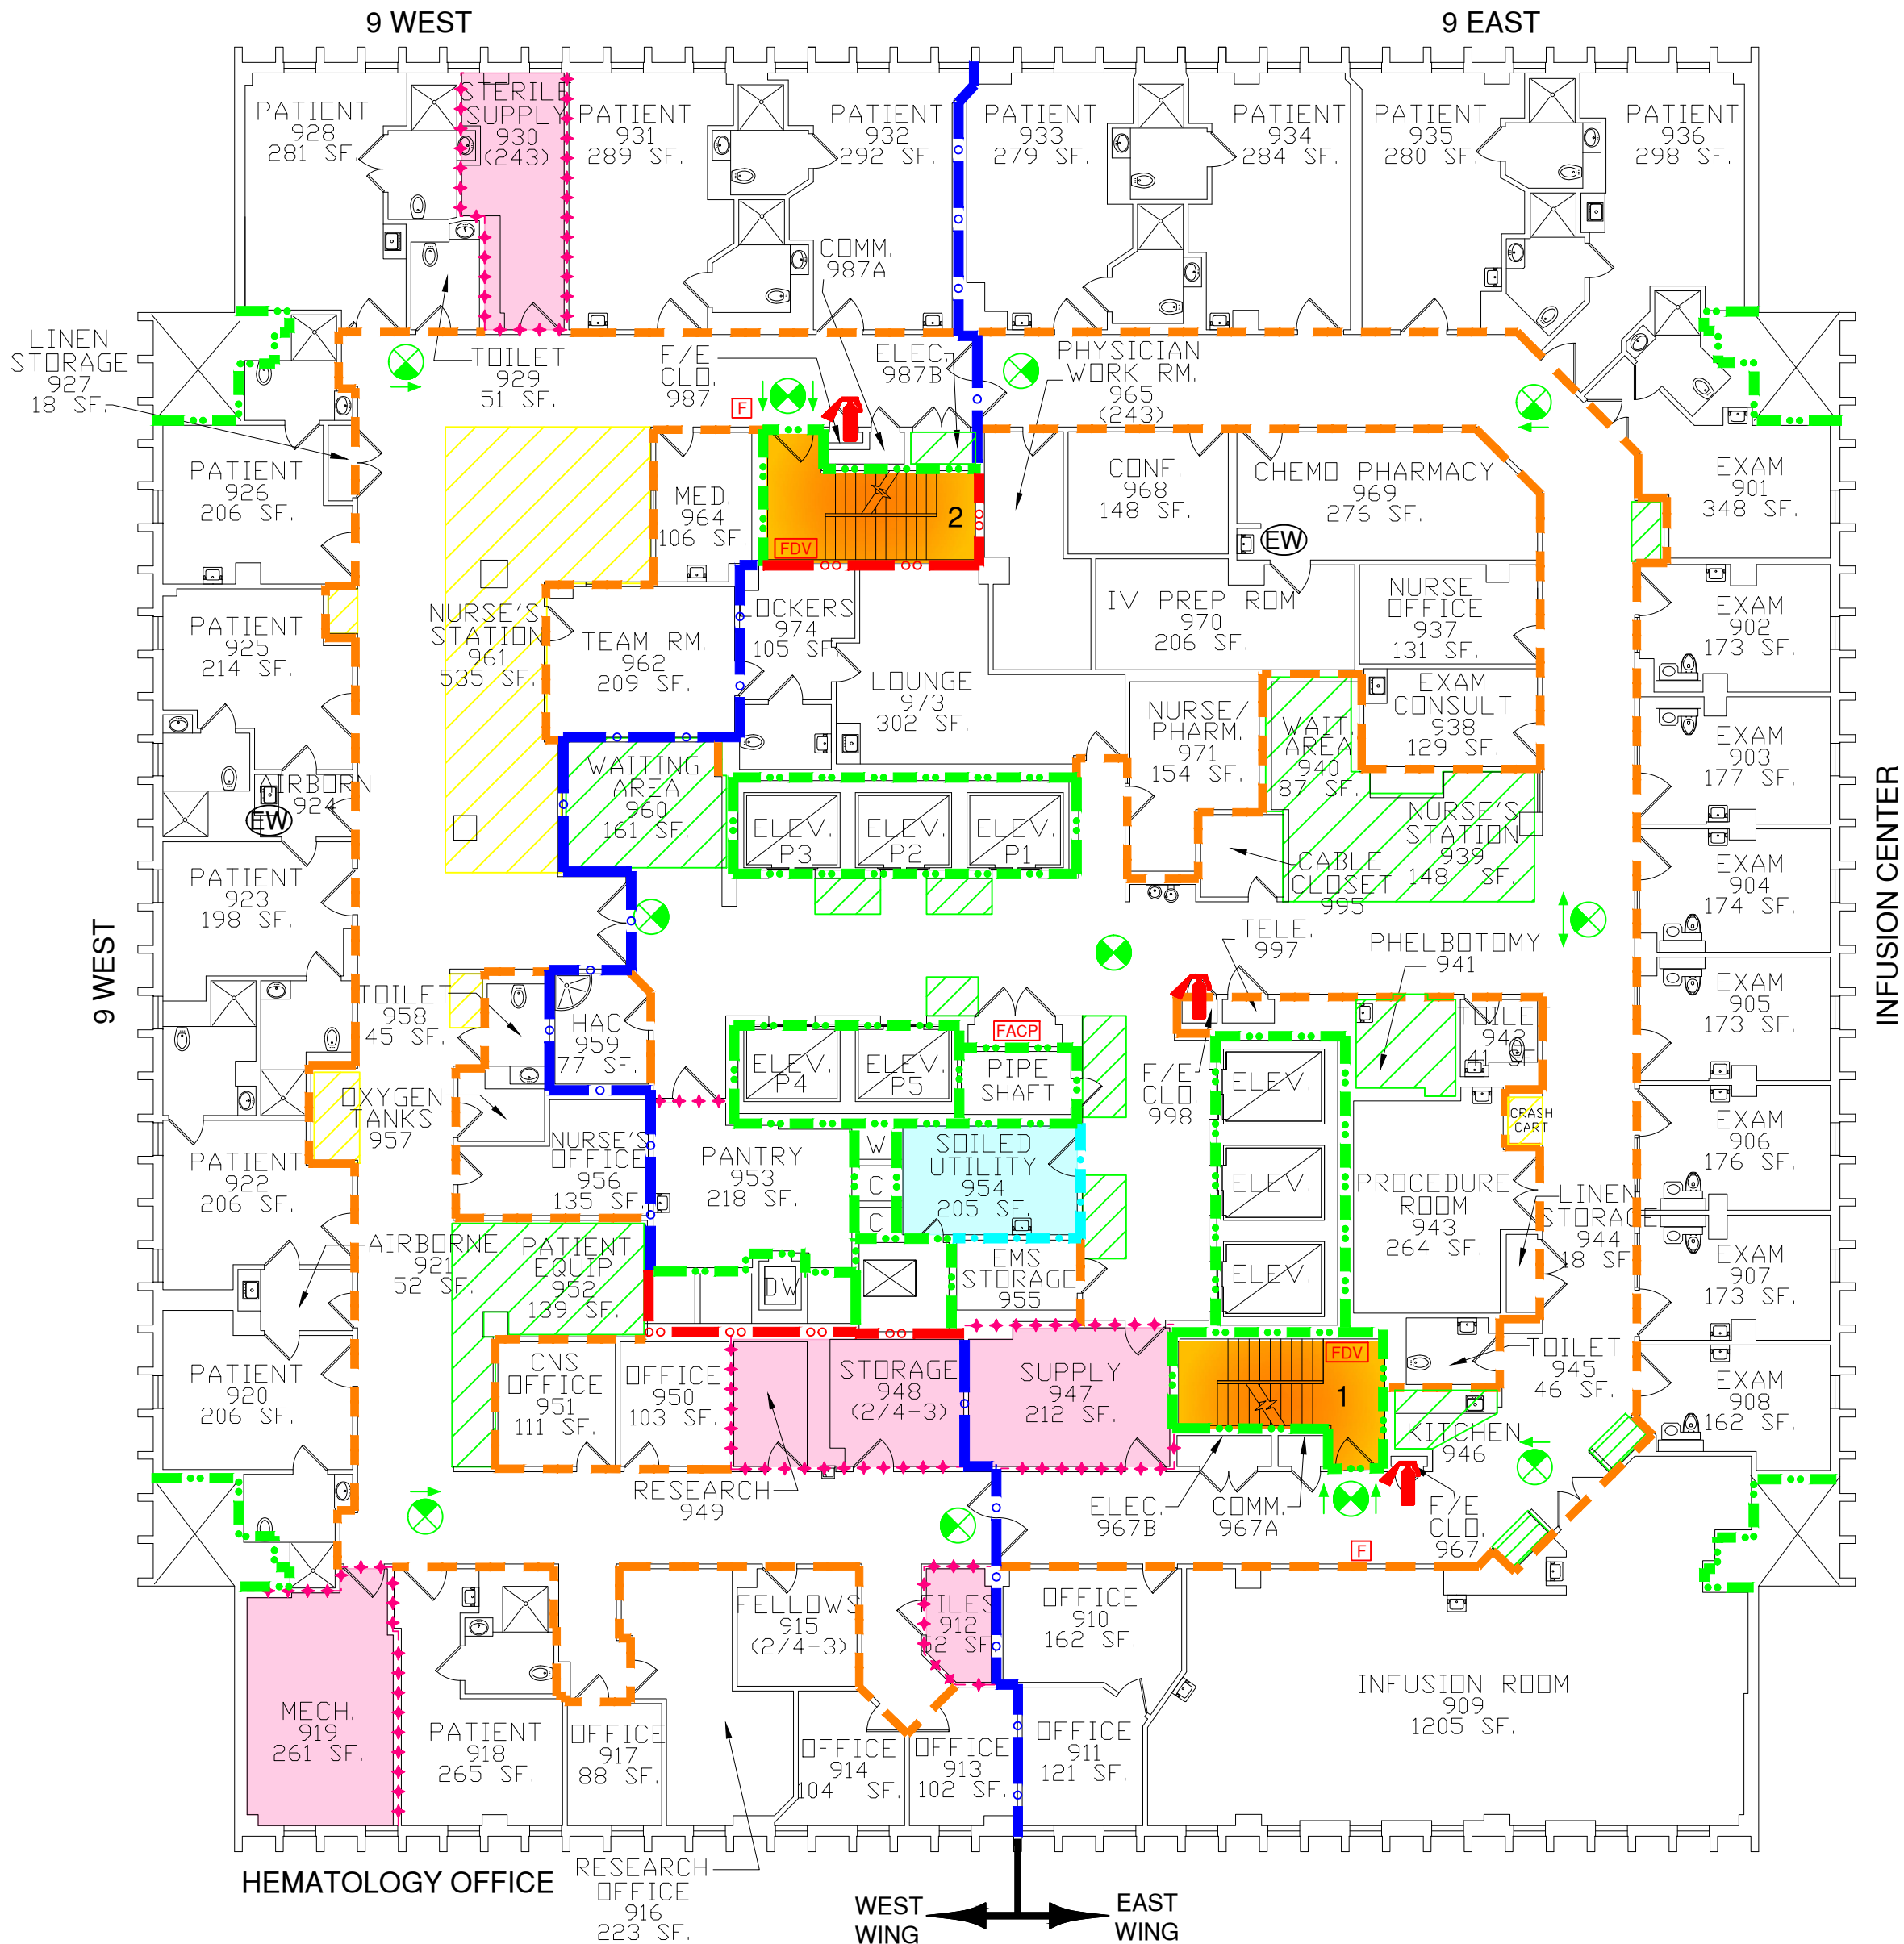

- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP → EXIT PASSAGEWAY
- LC → LINEN CHUTE
- TC → TRASH CHUTE
- EX → EXIT
- HE → HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- ++++ SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- ++++ SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

BUILDING 200 NINTH FLOOR



FULLY SPRINKLERED
(QUICK RESPONSE TYPE)
HEALTH CARE OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title	BUILDING 200 NINTH FLOOR
Approved: Project Director	

Project Title	EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION
Location	HINES, ILLINOIS
Issue Date	06/19/2024
Checked by	JLB
Drawn by	DJB


Project Number	578-24-002
Building Number	200
Drawing Number	200SOC-9
Dwg.	18 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	CARDIAC INTERVENTIONAL SUITE	4,091 Sq. Ft.	PATIENT CARE SLEEPING	2

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
WEST	9,512 Sq. Ft.	HEALTH CARE
EAST	12,324 Sq. Ft.	HEALTH CARE

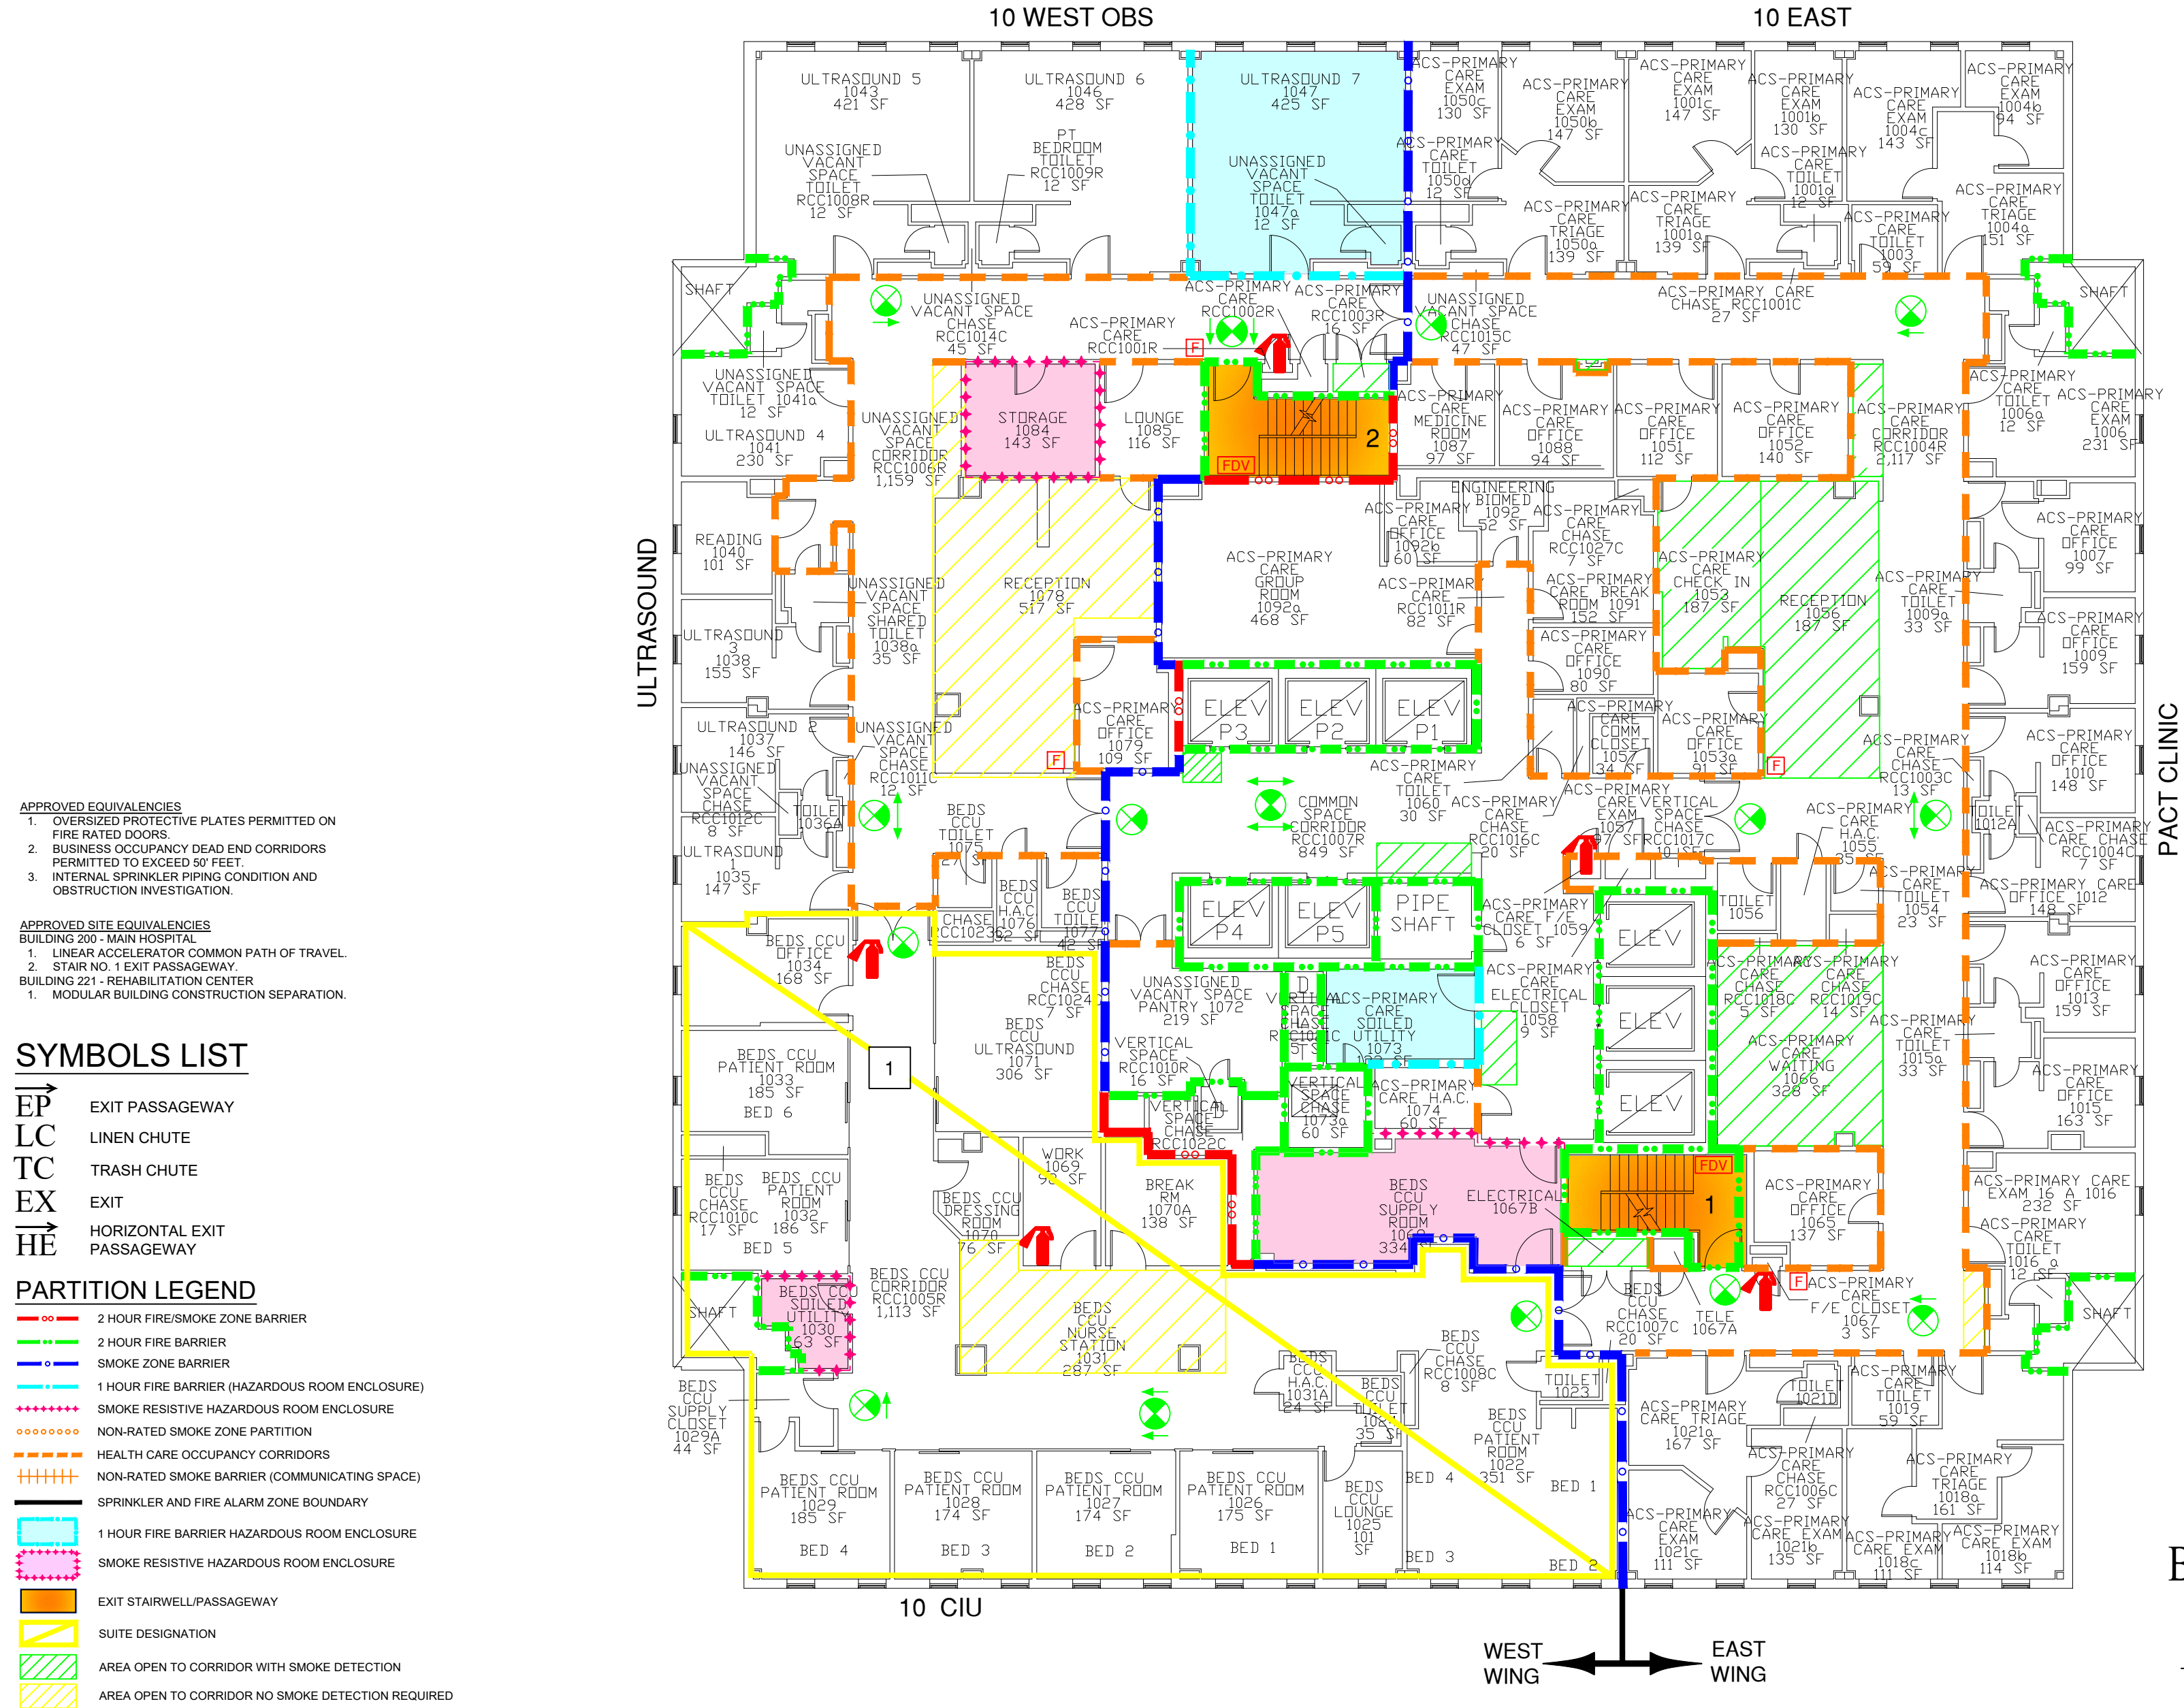

BUILDING 200 TENTH FLOOR

FULLY SPRINKLERED
HEALTH CARE OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377


Drawing Title

BUILDING 200
TENTH FLOOR

Approved: Project Director

Project Title		Project Number	
EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION		578-24-002	
Location		Building Number	
HINES, ILLINOIS		200	
Issue Date		Checked by	Drawn by
06/19/2024	JLB	DJB	
Drawing Number		Dwg.	
200SOC-10		19 of 64	

SMOKE ZONE SIZE		
SMOKE ZONE	SQ. FT.	OCCUPANCY
WEST	9,267 Sq. Ft.	HEALTH CARE
EAST	12,551 Sq. Ft.	HEALTH CARE

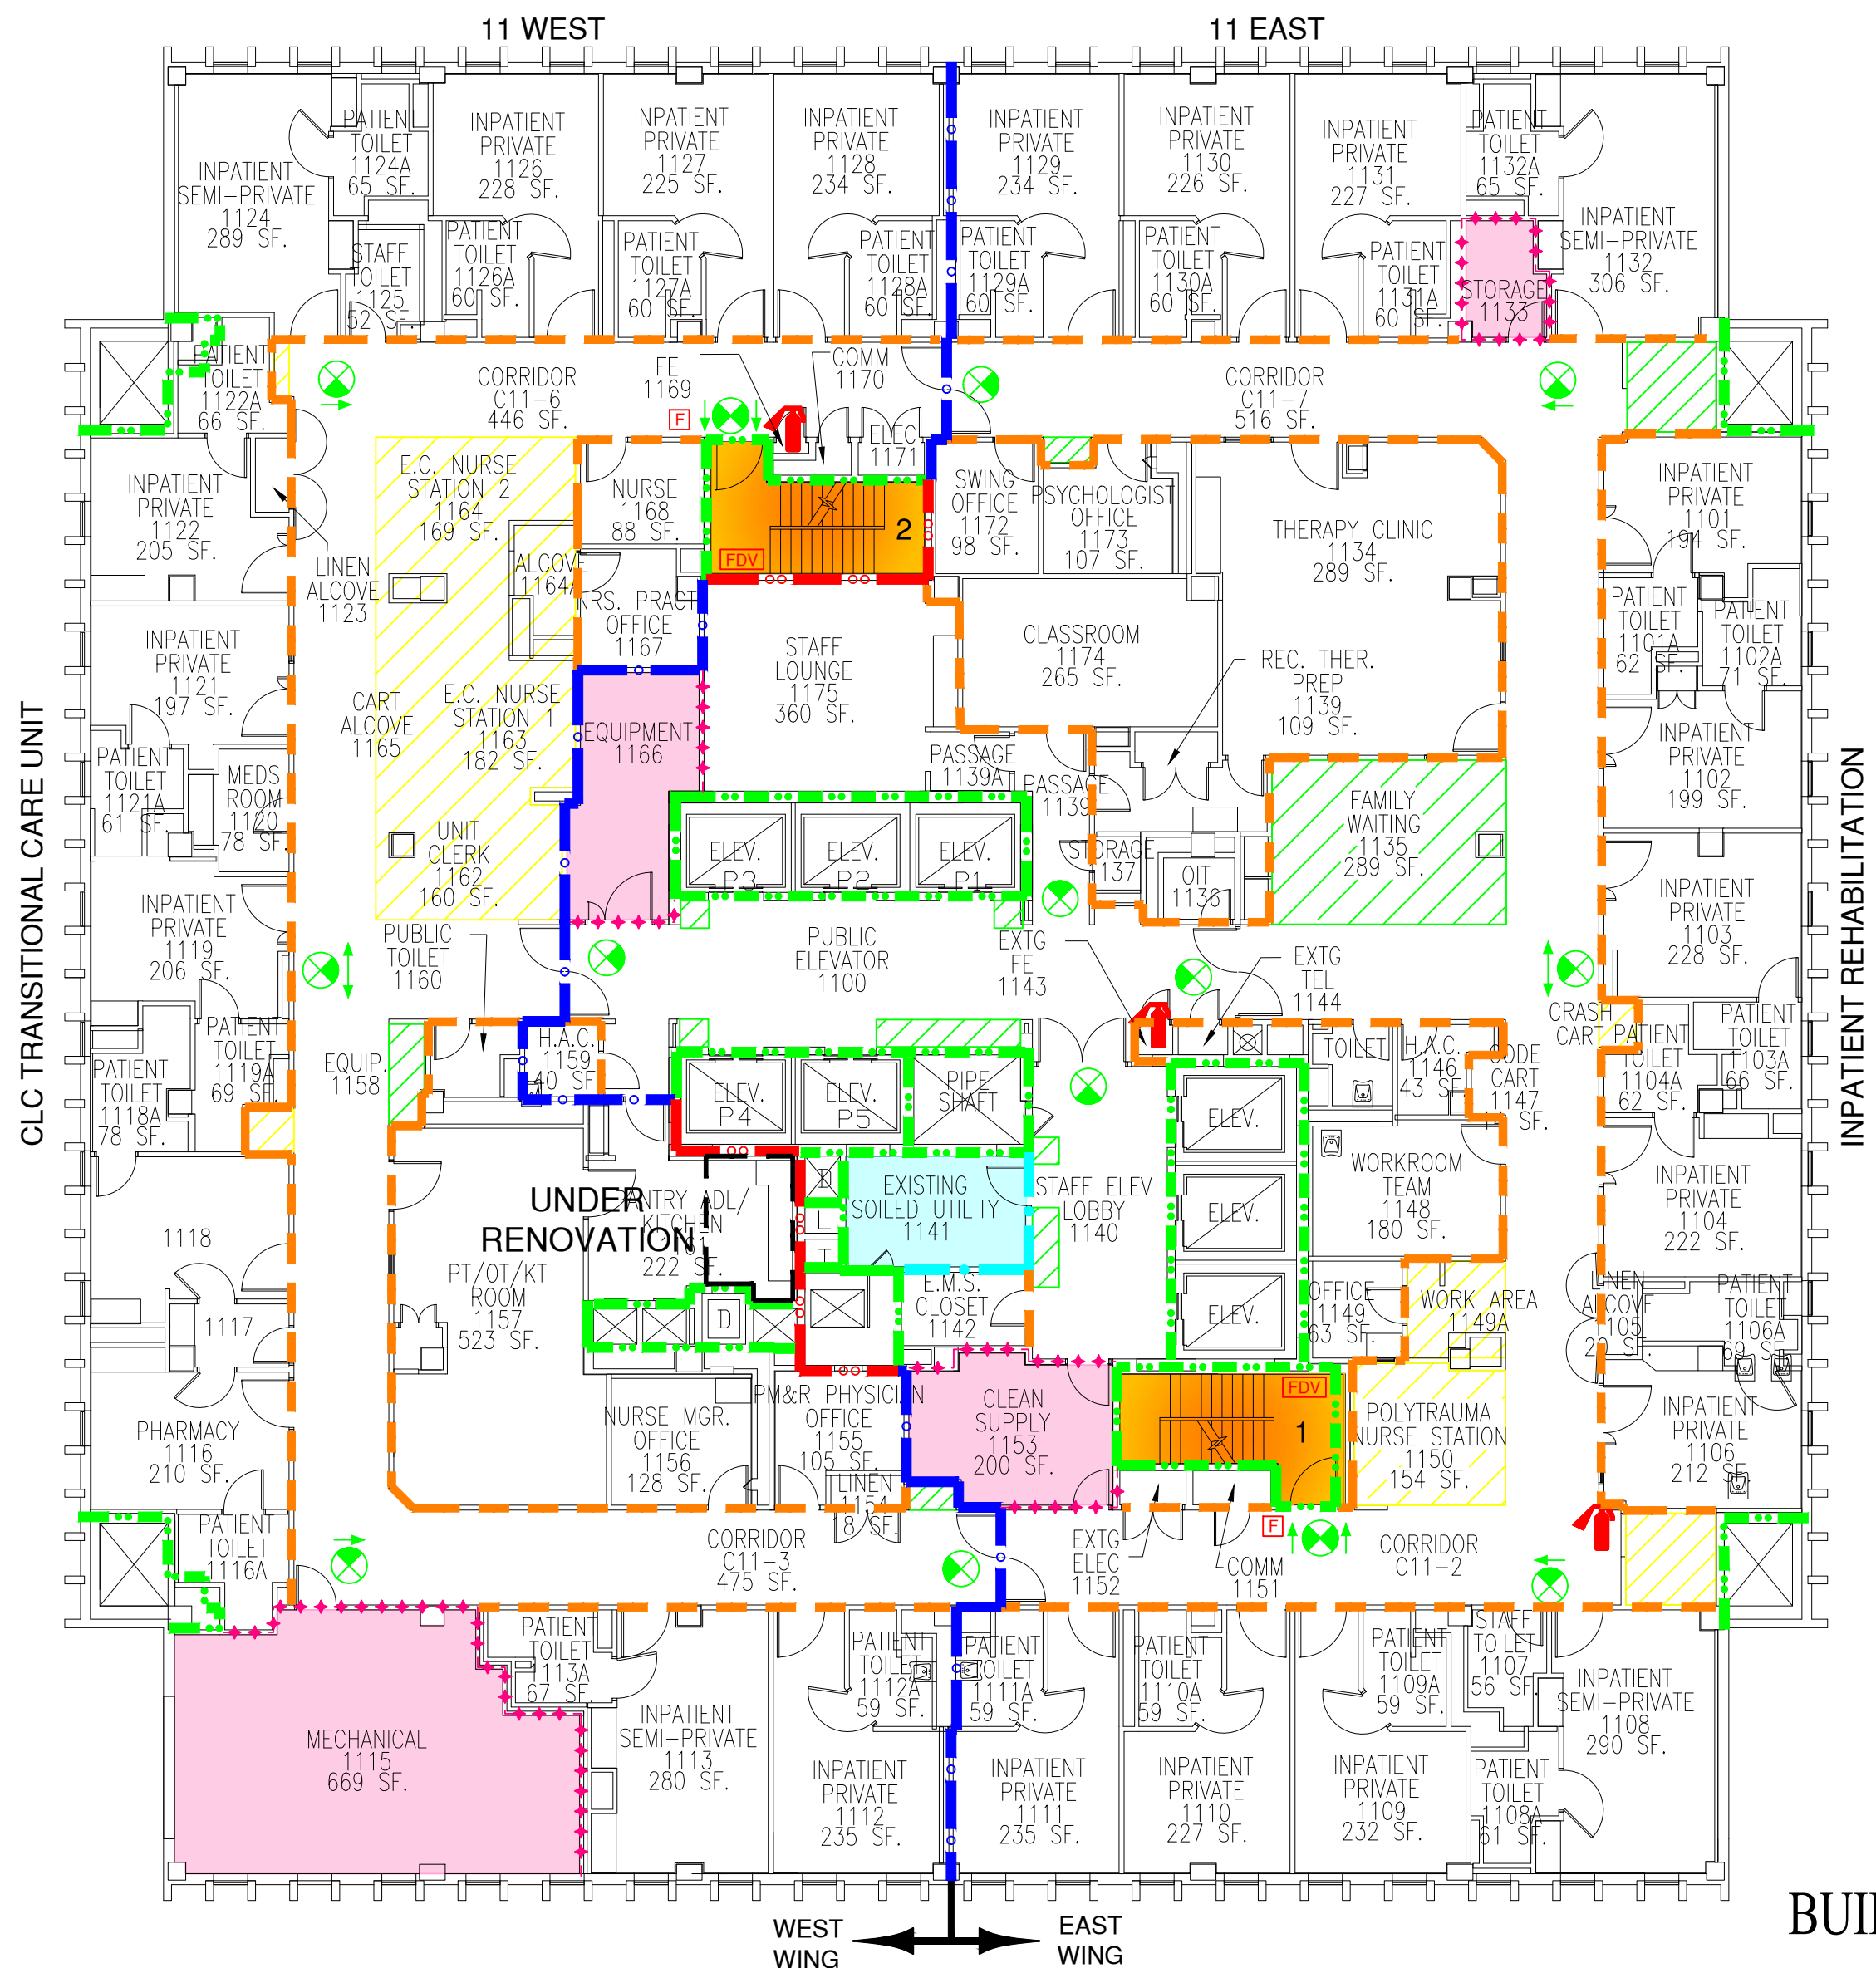

- APPROVED EQUIVALENCIES**
- 1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - 2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - 3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES**
- BUILDING 200 - MAIN HOSPITAL
- 1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - 2. STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- 1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- EX EXIT
- HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

BUILDING 200 ELEVENTH FLOOR



FULLY SPRINKLERED
HEALTH CARE OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 200
ELEVENTH FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

200

Drawing Number

200SOC-11


Dwg. 20 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	WOMENS HEALTH CLINIC SUITE	3,290 Sq. Ft.	NON SLEEPING PATIENT CARE	2

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
NORTH	12,126 Sq. Ft.	AMBULATORY HEALTH CARE
SOUTH	9,692 Sq. Ft.	AMBULATORY HEALTH CARE

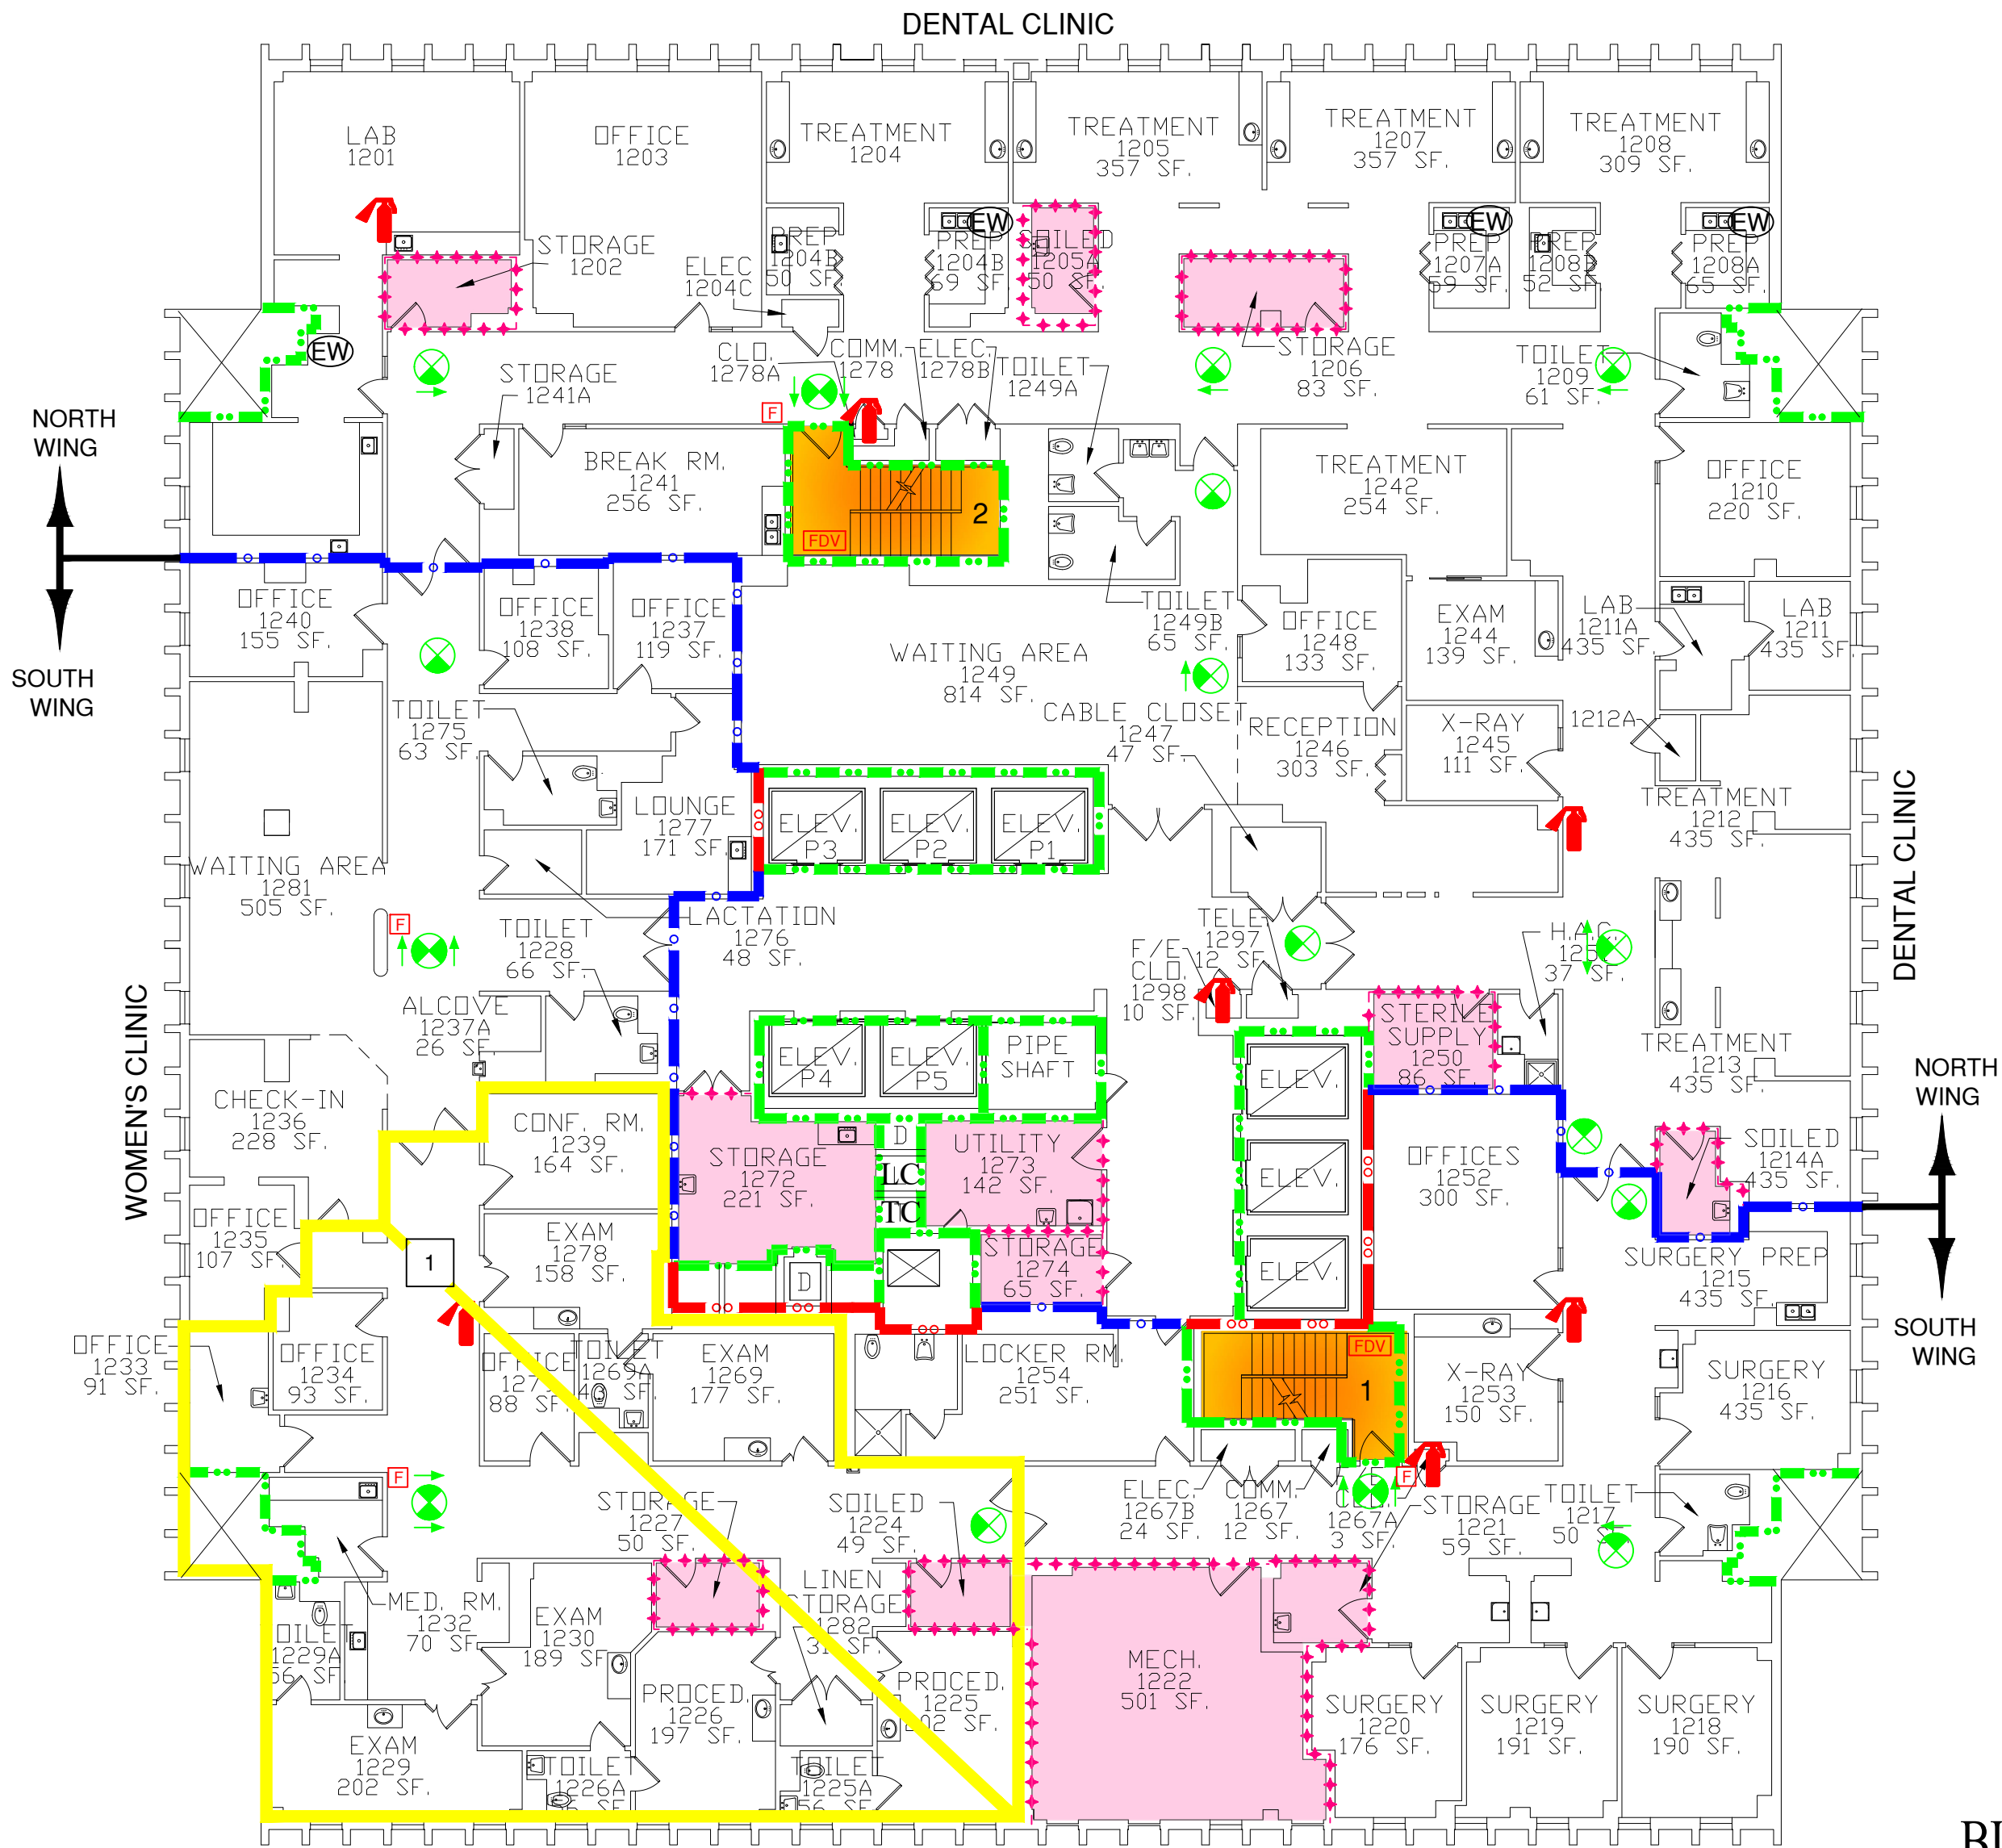

- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- EX EXIT
- HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

BUILDING 200 TWELFTH FLOOR



FULLY SPRINKLERED
AMBULATORY HEALTH CARE OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

 Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

 FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 200
TWELFTH FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

200

Drawing Number

200SOC-12

Dwg. 21 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	GI RECOVERY SUITE	3,870 Sq. Ft.	NON SLEEPING PATIENT CARE	1

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
WEST	7,794 Sq. Ft.	AMBULATORY HEALTH CARE
EAST	14,025 Sq. Ft.	AMBULATORY HEALTH CARE

KEY NOTES:

- 1 EXISTING POWER OPERATED SUITE ENTRANCE DOOR.

APPROVED EQUIVALENCIES

- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
- BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
- INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES

- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

EP	EXIT PASSAGEWAY
LC	LINEN CHUTE
TC	TRASH CHUTE
EX	EXIT
HE	HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

2 HOUR FIRE/SMOKE ZONE BARRIER	2 HOUR FIRE BARRIER
SMOKE ZONE BARRIER	1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE	NON-RATED SMOKE ZONE PARTITION
HEALTH CARE OCCUPANCY CORRIDORS	NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
SPRINKLER AND FIRE ALARM ZONE BOUNDARY	1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE	EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION	AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED	

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 200
THIRTEENTH FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002


Building Number

200


Drawing Number

200SOC-13

Dwg. 22 of 64

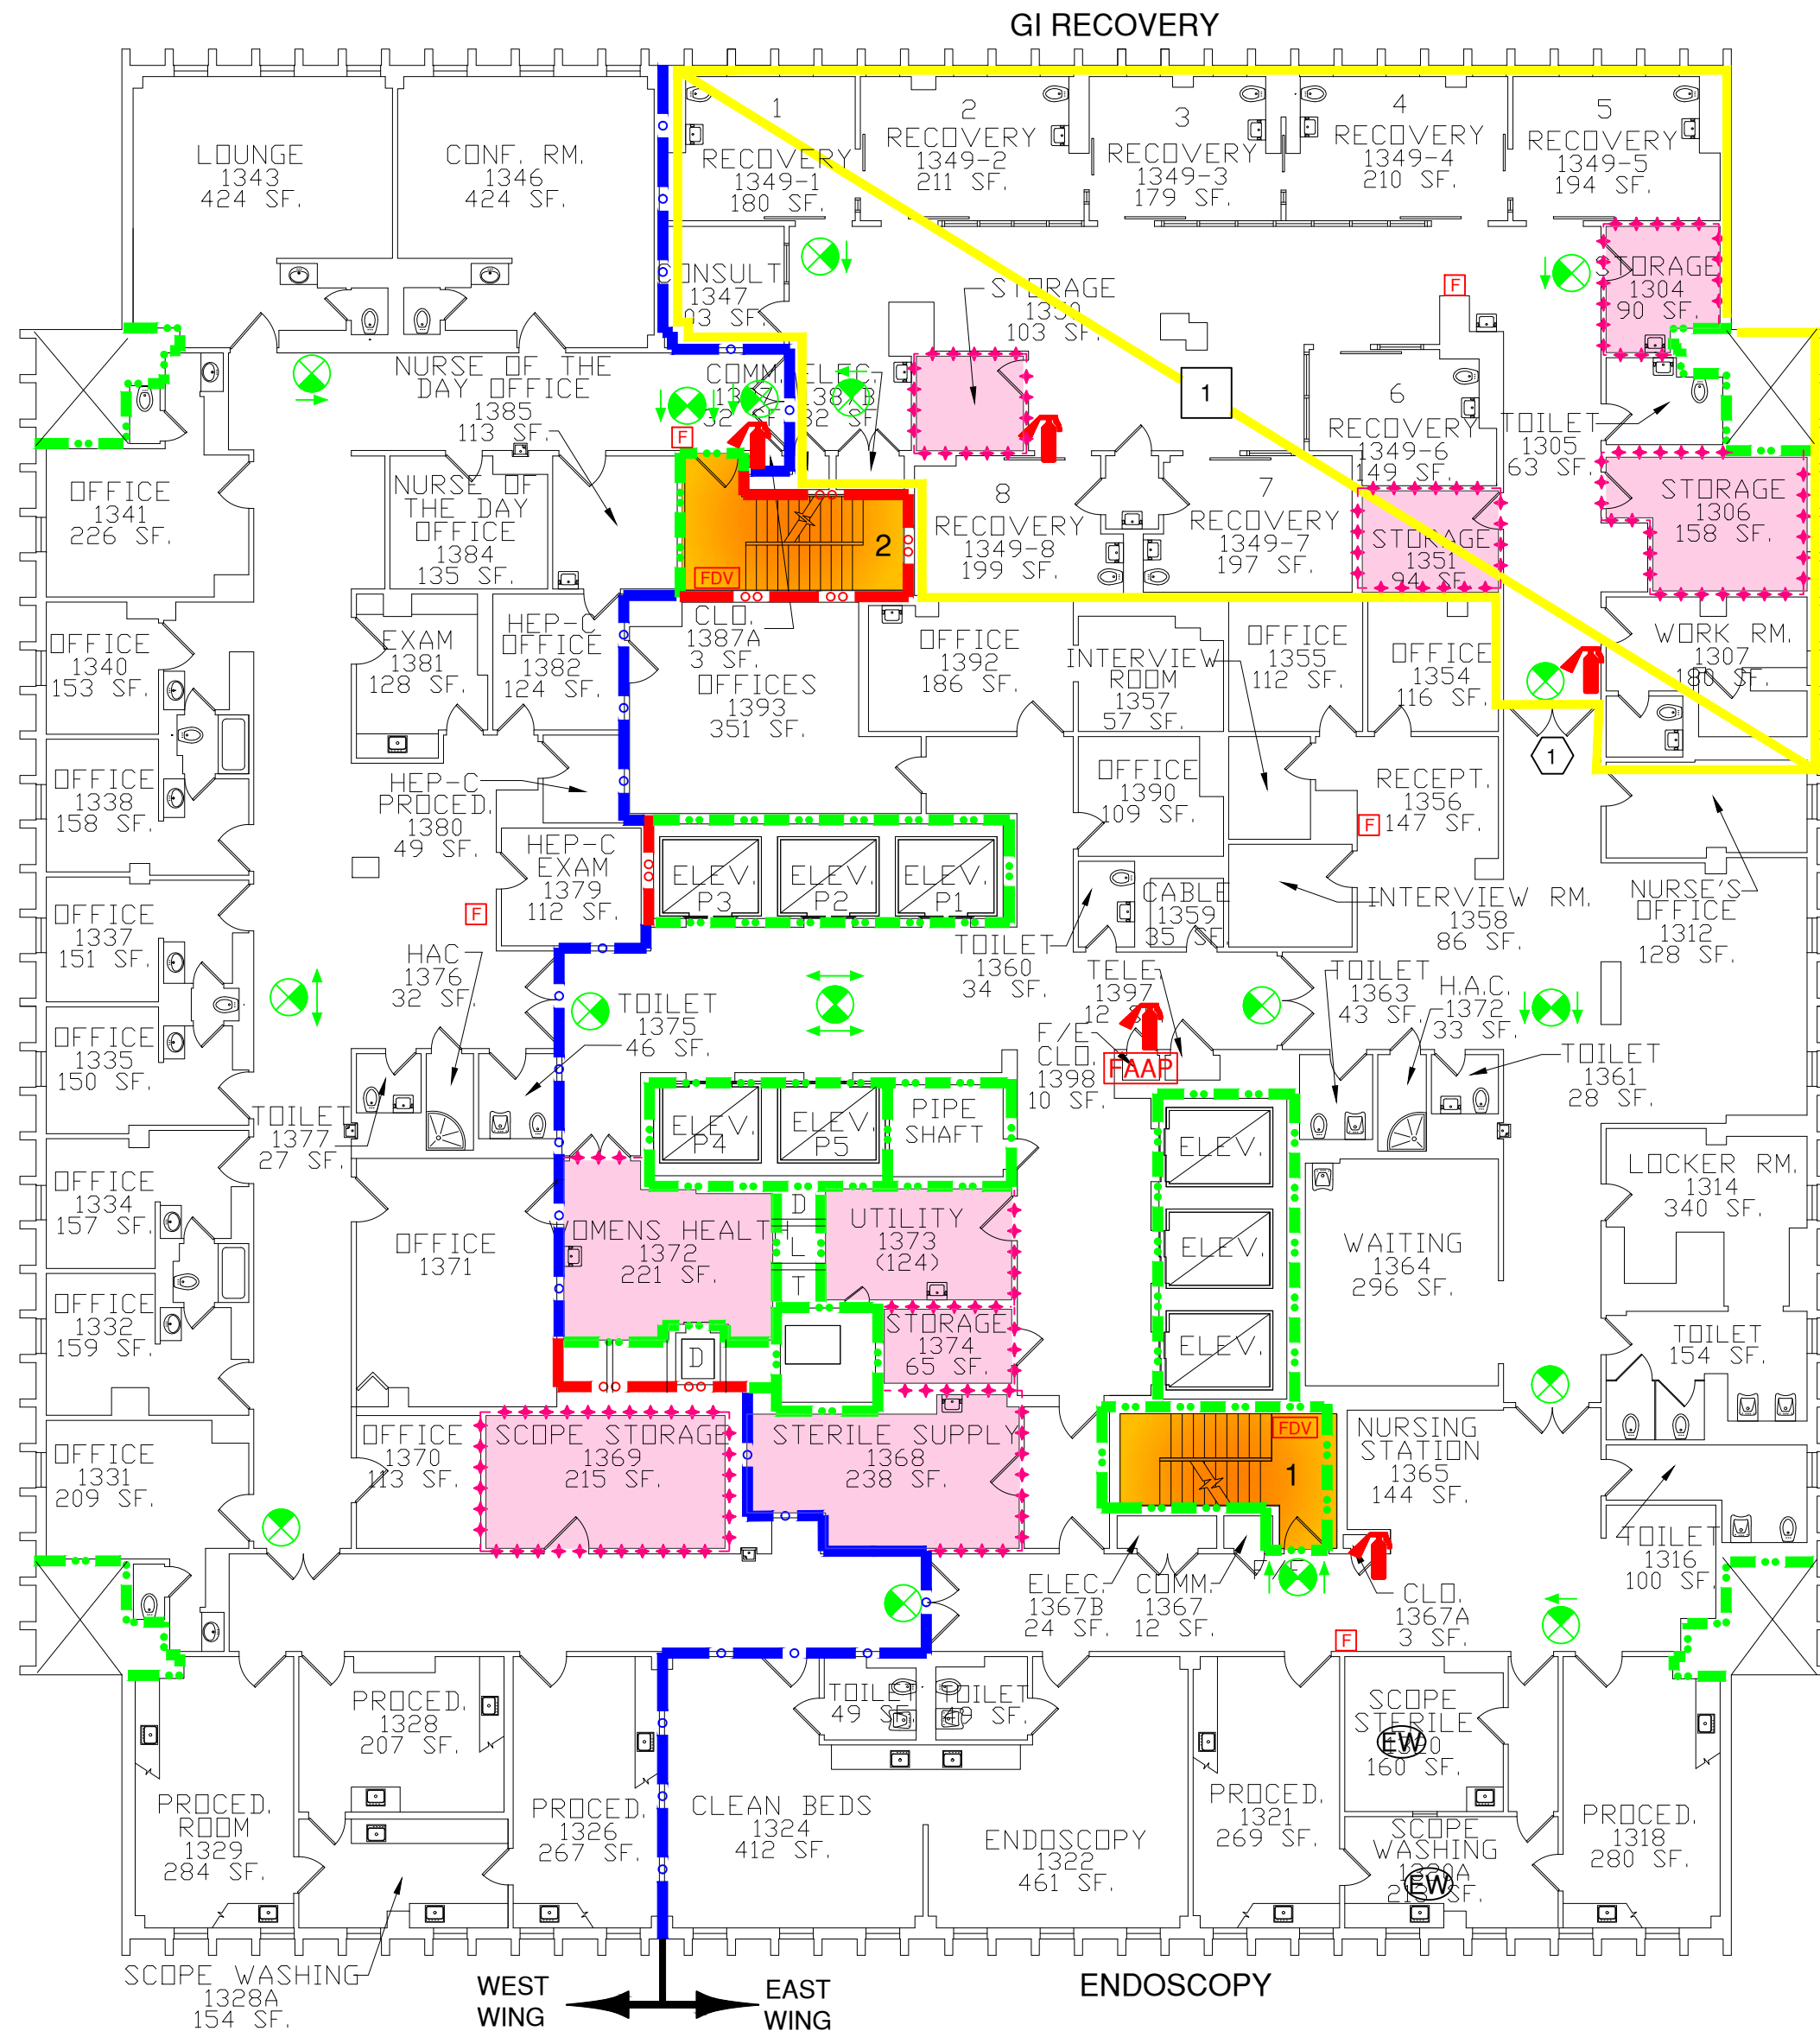

BUILDING 200 THIRTEENTH FLOOR



FULLY SPRINKLERED
AMBULATORY HEALTH CARE OCCUPANCY

SMOKE ZONE SIZE		
SMOKE ZONE	SQ. FT.	OCCUPANCY
WEST	8,921 Sq. Ft.	AMBULATORY HEALTH CARE
EAST	12,089 Sq. Ft.	AMBULATORY HEALTH CARE

KEY NOTES:

- 1
- MAXIMUM 49 OCCUPANTS.
- 2
- SMOKE BARRIER MAINTAINED AS ADDITIONAL PROTECTION OF SLEEP LAB OUTPATIENTS AND ON-CALL SLEEPING ROOMS.


- APPROVED EQUIVALENCIES
- 1
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
- 2
- BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
- 3
- INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- 1
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
- 2
- STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- 1
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP
- EXIT PASSAGEWAY
- LC
- LINEN CHUTE
- TC
- TRASH CHUTE
- EX
- EXIT
- HE
- HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2
- 2 HOUR FIRE BARRIER
- 2
- SMOKE ZONE BARRIER
- 1
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- +
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- o
- NON-RATED SMOKE ZONE PARTITION
- o
- HEALTH CARE OCCUPANCY CORRIDORS
- +
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- +
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- +
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- +
- EXIT STAIRWELL/PASSAGEWAY
- +
- SUITE DESIGNATION
- +
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- +
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

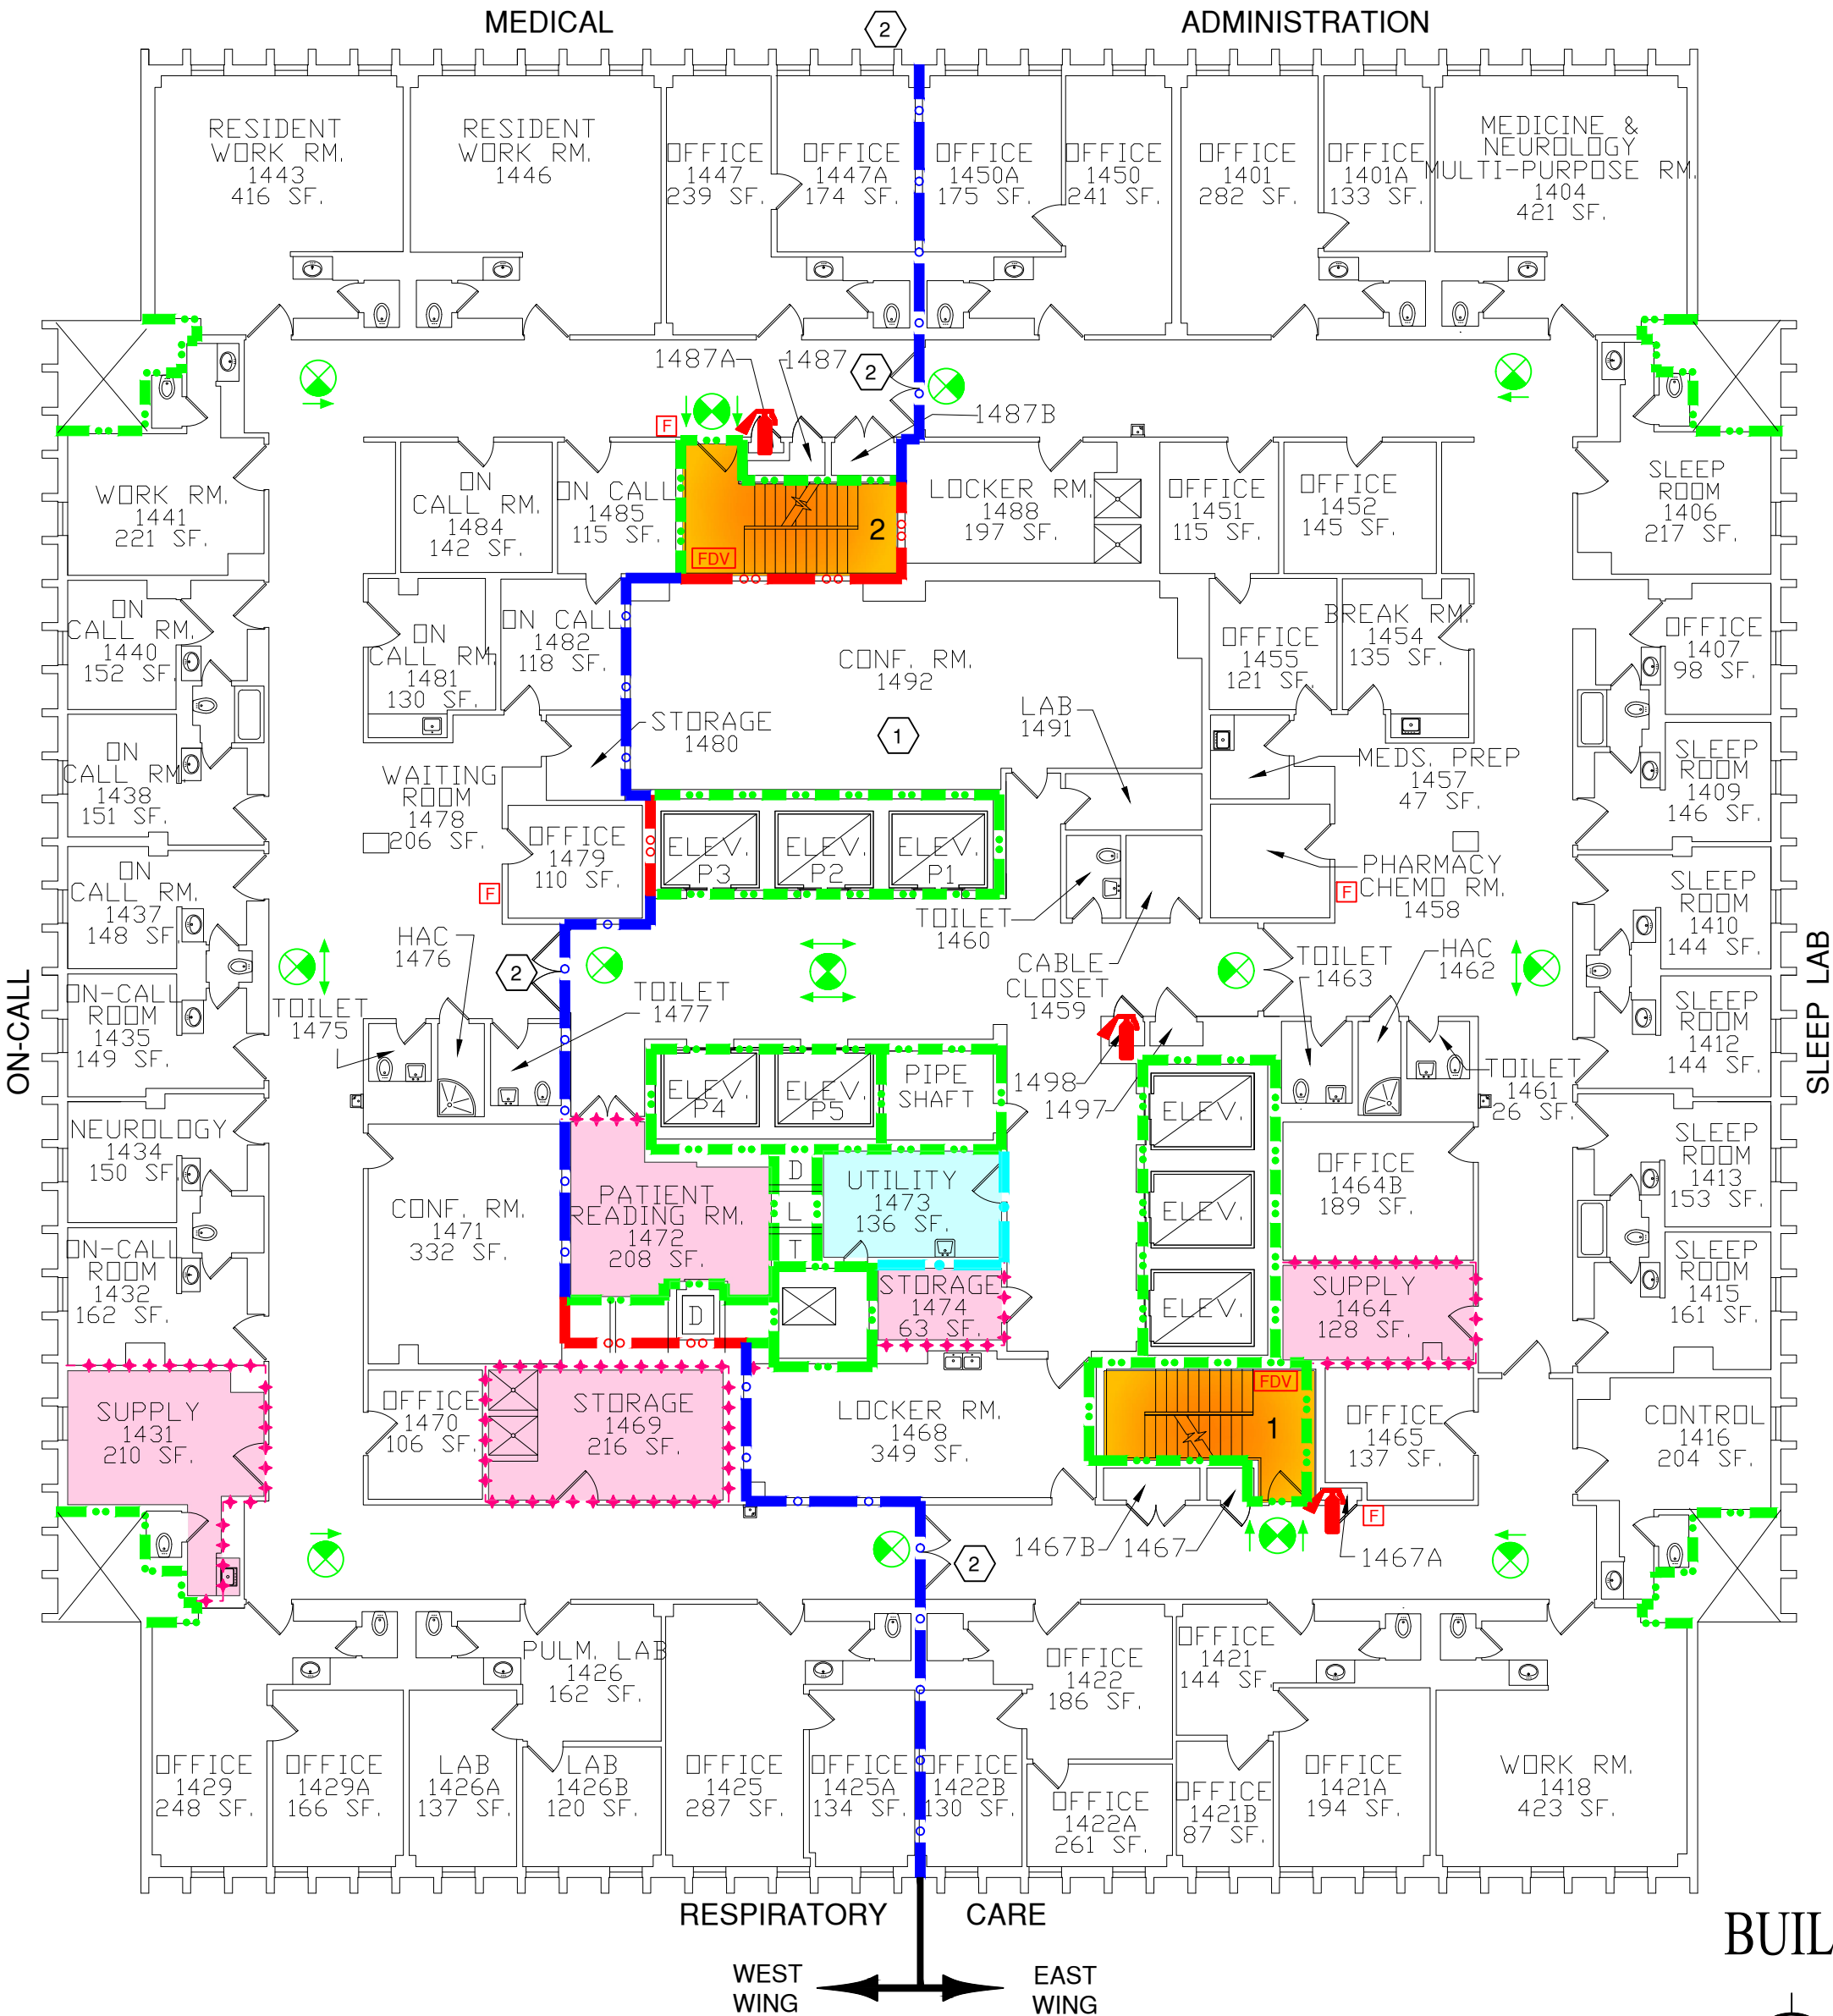

BUILDING 200 FOURTEENTH FLOOR

FULLY SPRINKLERED
AMBULATORY HEALTH CARE OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS




FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title	BUILDING 200 FOURTEENTH FLOOR	
Approved: Project Director		

Project Title	EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION	
Location	HINES, ILLINOIS	
Issue Date	Checked by	Drawn by
06/19/2024	JLB	DJB

Project Number	578-24-002
Building Number	200
Drawing Number	200SOC-14
Dwg.	23 of 64

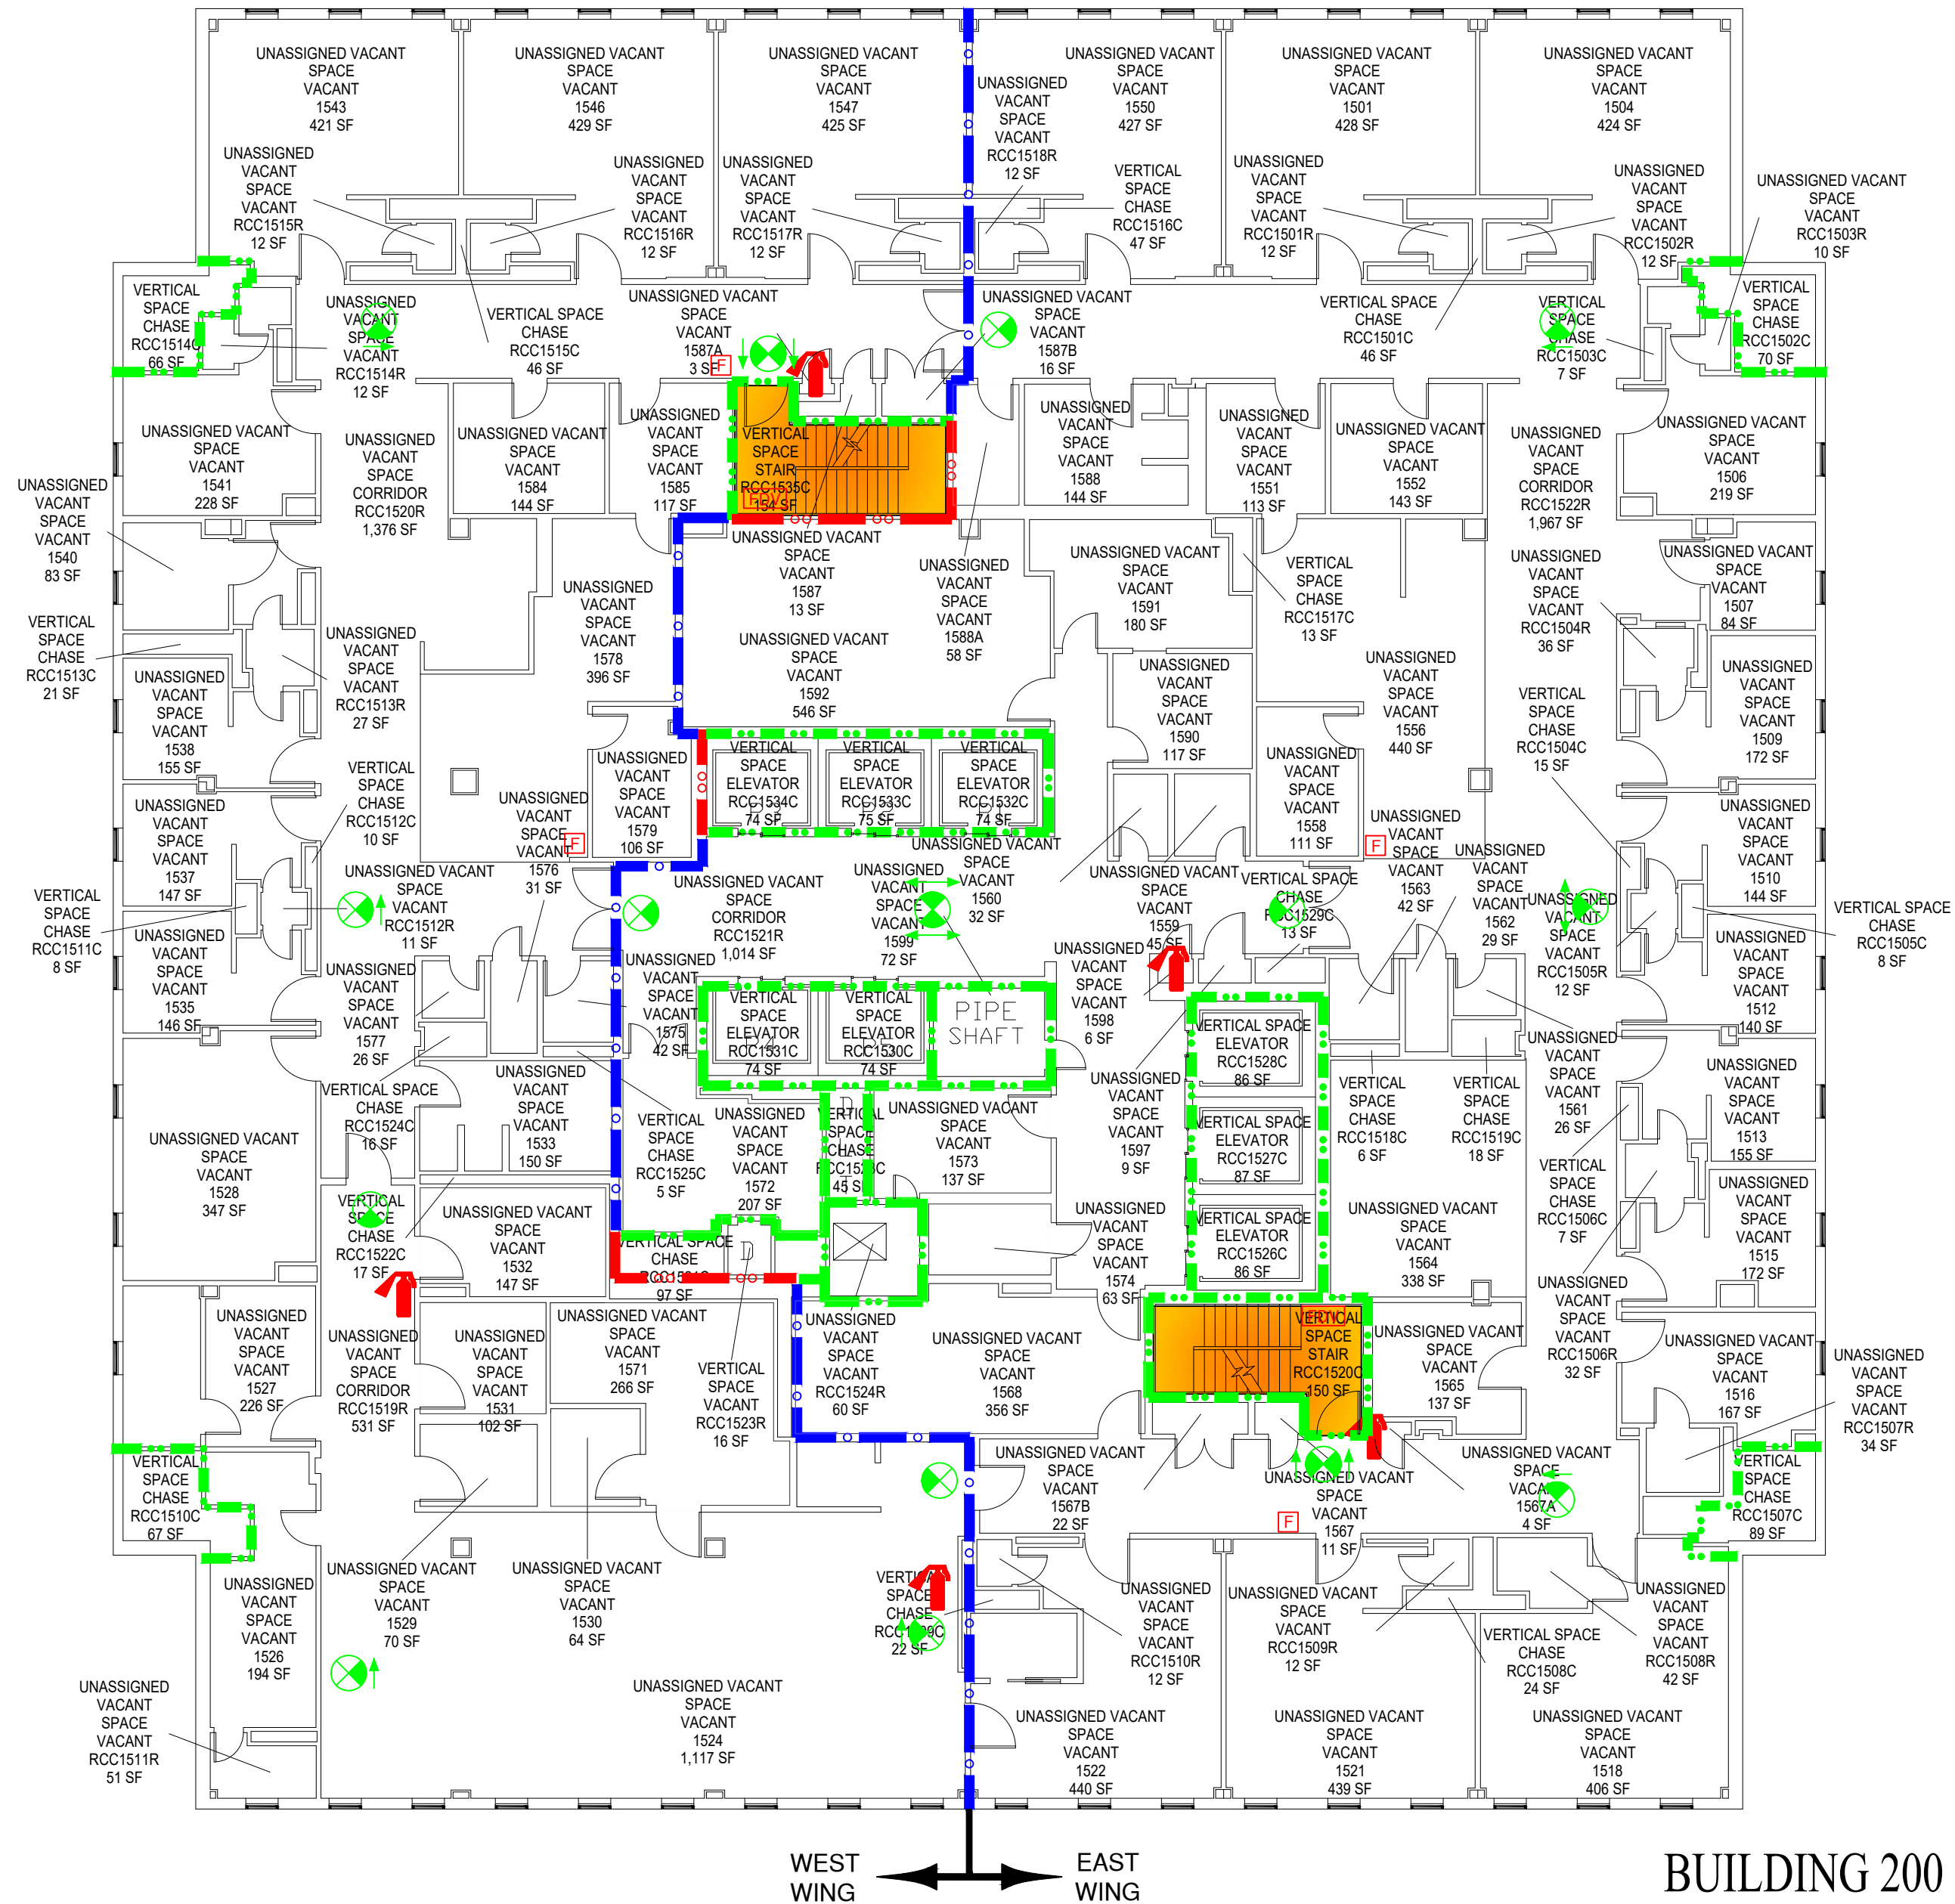

- APPROVED EQUIVALENCIES**
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES**
- BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 2. STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
LC LINEN CHUTE
TC TRASH CHUTE
EX EXIT
HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
2 HOUR FIRE BARRIER
SMOKE ZONE BARRIER
1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
NON-RATED SMOKE ZONE PARTITION
HEALTH CARE OCCUPANCY CORRIDORS
NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
SPRINKLER AND FIRE ALARM ZONE BOUNDARY
1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION
AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 200
FIFTEENTH FLOOR

Approved: Project Director

BUILDING 200 FIFTEENTH FLOOR

FULLY SPRINKLERED
STORAGE OCCUPANCY
(VACANT AWAITING RENOVATION)



CLOSED FOR
RENOVATION
FUTURE
HEALTH CARE

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

200

Drawing Number

200SOC-15

Dwg. 24 of 64

KEY NOTES:

- 1

OPEN TO FLOOR ABOVE.
- 2

EXISTING 3/16" MINIMUM STEEL PLATE FLOOR ACCESS PANEL CONSIDERED EQUIVALENT TO 2 HOUR FLOOR ASSEMBLY AT THE TIME OF BUILDING CONSTRUCTION.

- APPROVED EQUIVALENCIES
1.

OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2.

BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3.

INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL

1.

LINEAR ACCELERATOR COMMON PATH OF TRAVEL.

2.

STAIR NO. 1 EXIT PASSAGEWAY.

BUILDING 221 - REHABILITATION CENTER

1.

MODULAR BUILDING CONSTRUCTION SEPARATION.
- SYMBOLS LIST
- EP

EXIT PASSAGEWAY

LC

LINEN CHUTE

TC

TRASH CHUTE

EX

EXIT

HE

HORIZONTAL EXIT PASSAGEWAY
- PARTITION LEGEND
- 2 HOUR FIRE/SMOKE ZONE BARRIER

2 HOUR FIRE BARRIER

SMOKE ZONE BARRIER

1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)

SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE

NON-RATED SMOKE ZONE PARTITION

HEALTH CARE OCCUPANCY CORRIDORS

NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)

SPRINKLER AND FIRE ALARM ZONE BOUNDARY

1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE

SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE

EXIT STAIRWELL/PASSAGEWAY

SUITE DESIGNATION

AREA OPEN TO CORRIDOR WITH SMOKE DETECTION

AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED
-
- BUILDING 200 SIXTEENTH FLOOR
(MECHANICAL EQUIPMENT)
-
- FULLY SPRINKLERED
INDUSTRIAL OCCUPANCY
- | | | |
|---------------------|--------|-----------|
| FP&C Project Number | 23400 | |
| | | |
| | | |
| | | |
| | | |
| FINAL SOC | | 6/19/2024 |
| DRAFT SOC | | 4/08/2024 |
| REVISIONS: | NUMBER | DATE |
- SITE NAME/ADDRESS
-
- Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141
- ENGINEERS
-
- FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377
- | | |
|----------------------------|---------------------------------|
| Drawing Title | BUILDING 200
SIXTEENTH FLOOR |
| Approved: Project Director | |
- | | |
|---------------|--|
| Project Title | EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION |
| Location | HINES, ILLINOIS |
| Issue Date | 06/19/2024 |
| Checked by | JLB |
| Drawn by | DJB |
- | | |
|-----------------|------------|
| Project Number | 578-24-002 |
| Building Number | 200 |
| Drawing Number | 200SOC-16 |
| Dwg. | 25 of 64 |

KEY NOTES:

- 1

OPEN TO FLOOR BELOW.
- 2

EXISTING 3/16" MINIMUM STEEL PLATE FLOOR ACCESS PANEL CONSIDERED EQUIVALENT TO 2 HOUR FLOOR ASSEMBLY AT THE TIME OF BUILDING CONSTRUCTION.

- APPROVED EQUIVALENCIES
1.

OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2.

BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3.

INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
1.

LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2.

STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
1.

MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP

EXIT PASSAGEWAY
- LC

LINEN CHUTE
- TC


TRASH CHUTE
- EX

EXIT
- HE

HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

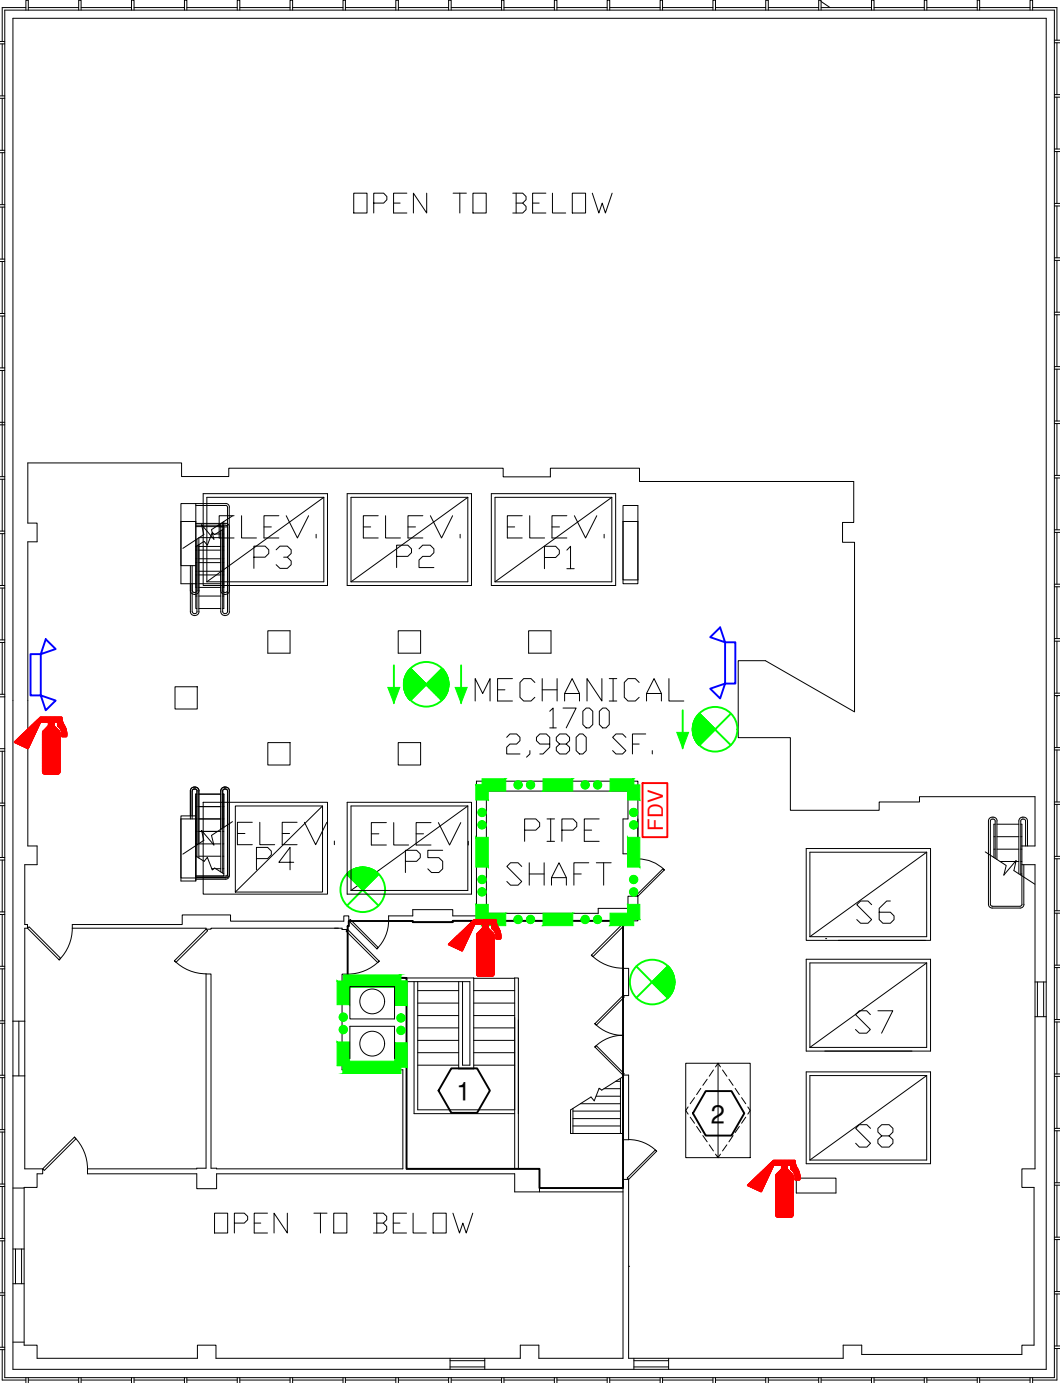

BUILDING 200 SEVENTEENTH FLOOR
(ELEVATOR EQUIPMENT)



FULLY SPRINKLERED
INDUSTRIAL OCCUPANCY

Drawing Title BUILDING 200 SEVENTEENTH FLOOR	Project Title EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION		Project Number 578-24-002
	Location HINES, ILLINOIS		Building Number 200
Approved: Project Director	Issue Date 06/19/2024		Drawing Number 200SOC-17
	Checked by JLB	Drawn by DJB	Dwg. 26 of 64

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	GERIATRIC CLINIC SUITE	7,400 Sq. Ft.	NON SLEEPING PATIENT CARE	3

KEY NOTES:

- 1 CLEAR STORY COMMUNICATING SPACE PER SECTION 8.6.6(4) OF NFPA 101-2015 EDITION.

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
UNIT A	21,156 Sq. Ft.	HEALTH CARE
UNIT B	22,807 Sq. Ft.	HEALTH CARE
UNIT C	20,041 Sq. Ft.	HEALTH CARE


- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
LC LINEN CHUTE
TC TRASH CHUTE
EX EXIT
HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
2 HOUR FIRE BARRIER
SMOKE ZONE BARRIER
1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
NON-RATED SMOKE ZONE PARTITION
HEALTH CARE OCCUPANCY CORRIDORS
NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
SPRINKLER AND FIRE ALARM ZONE BOUNDARY
1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION
AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

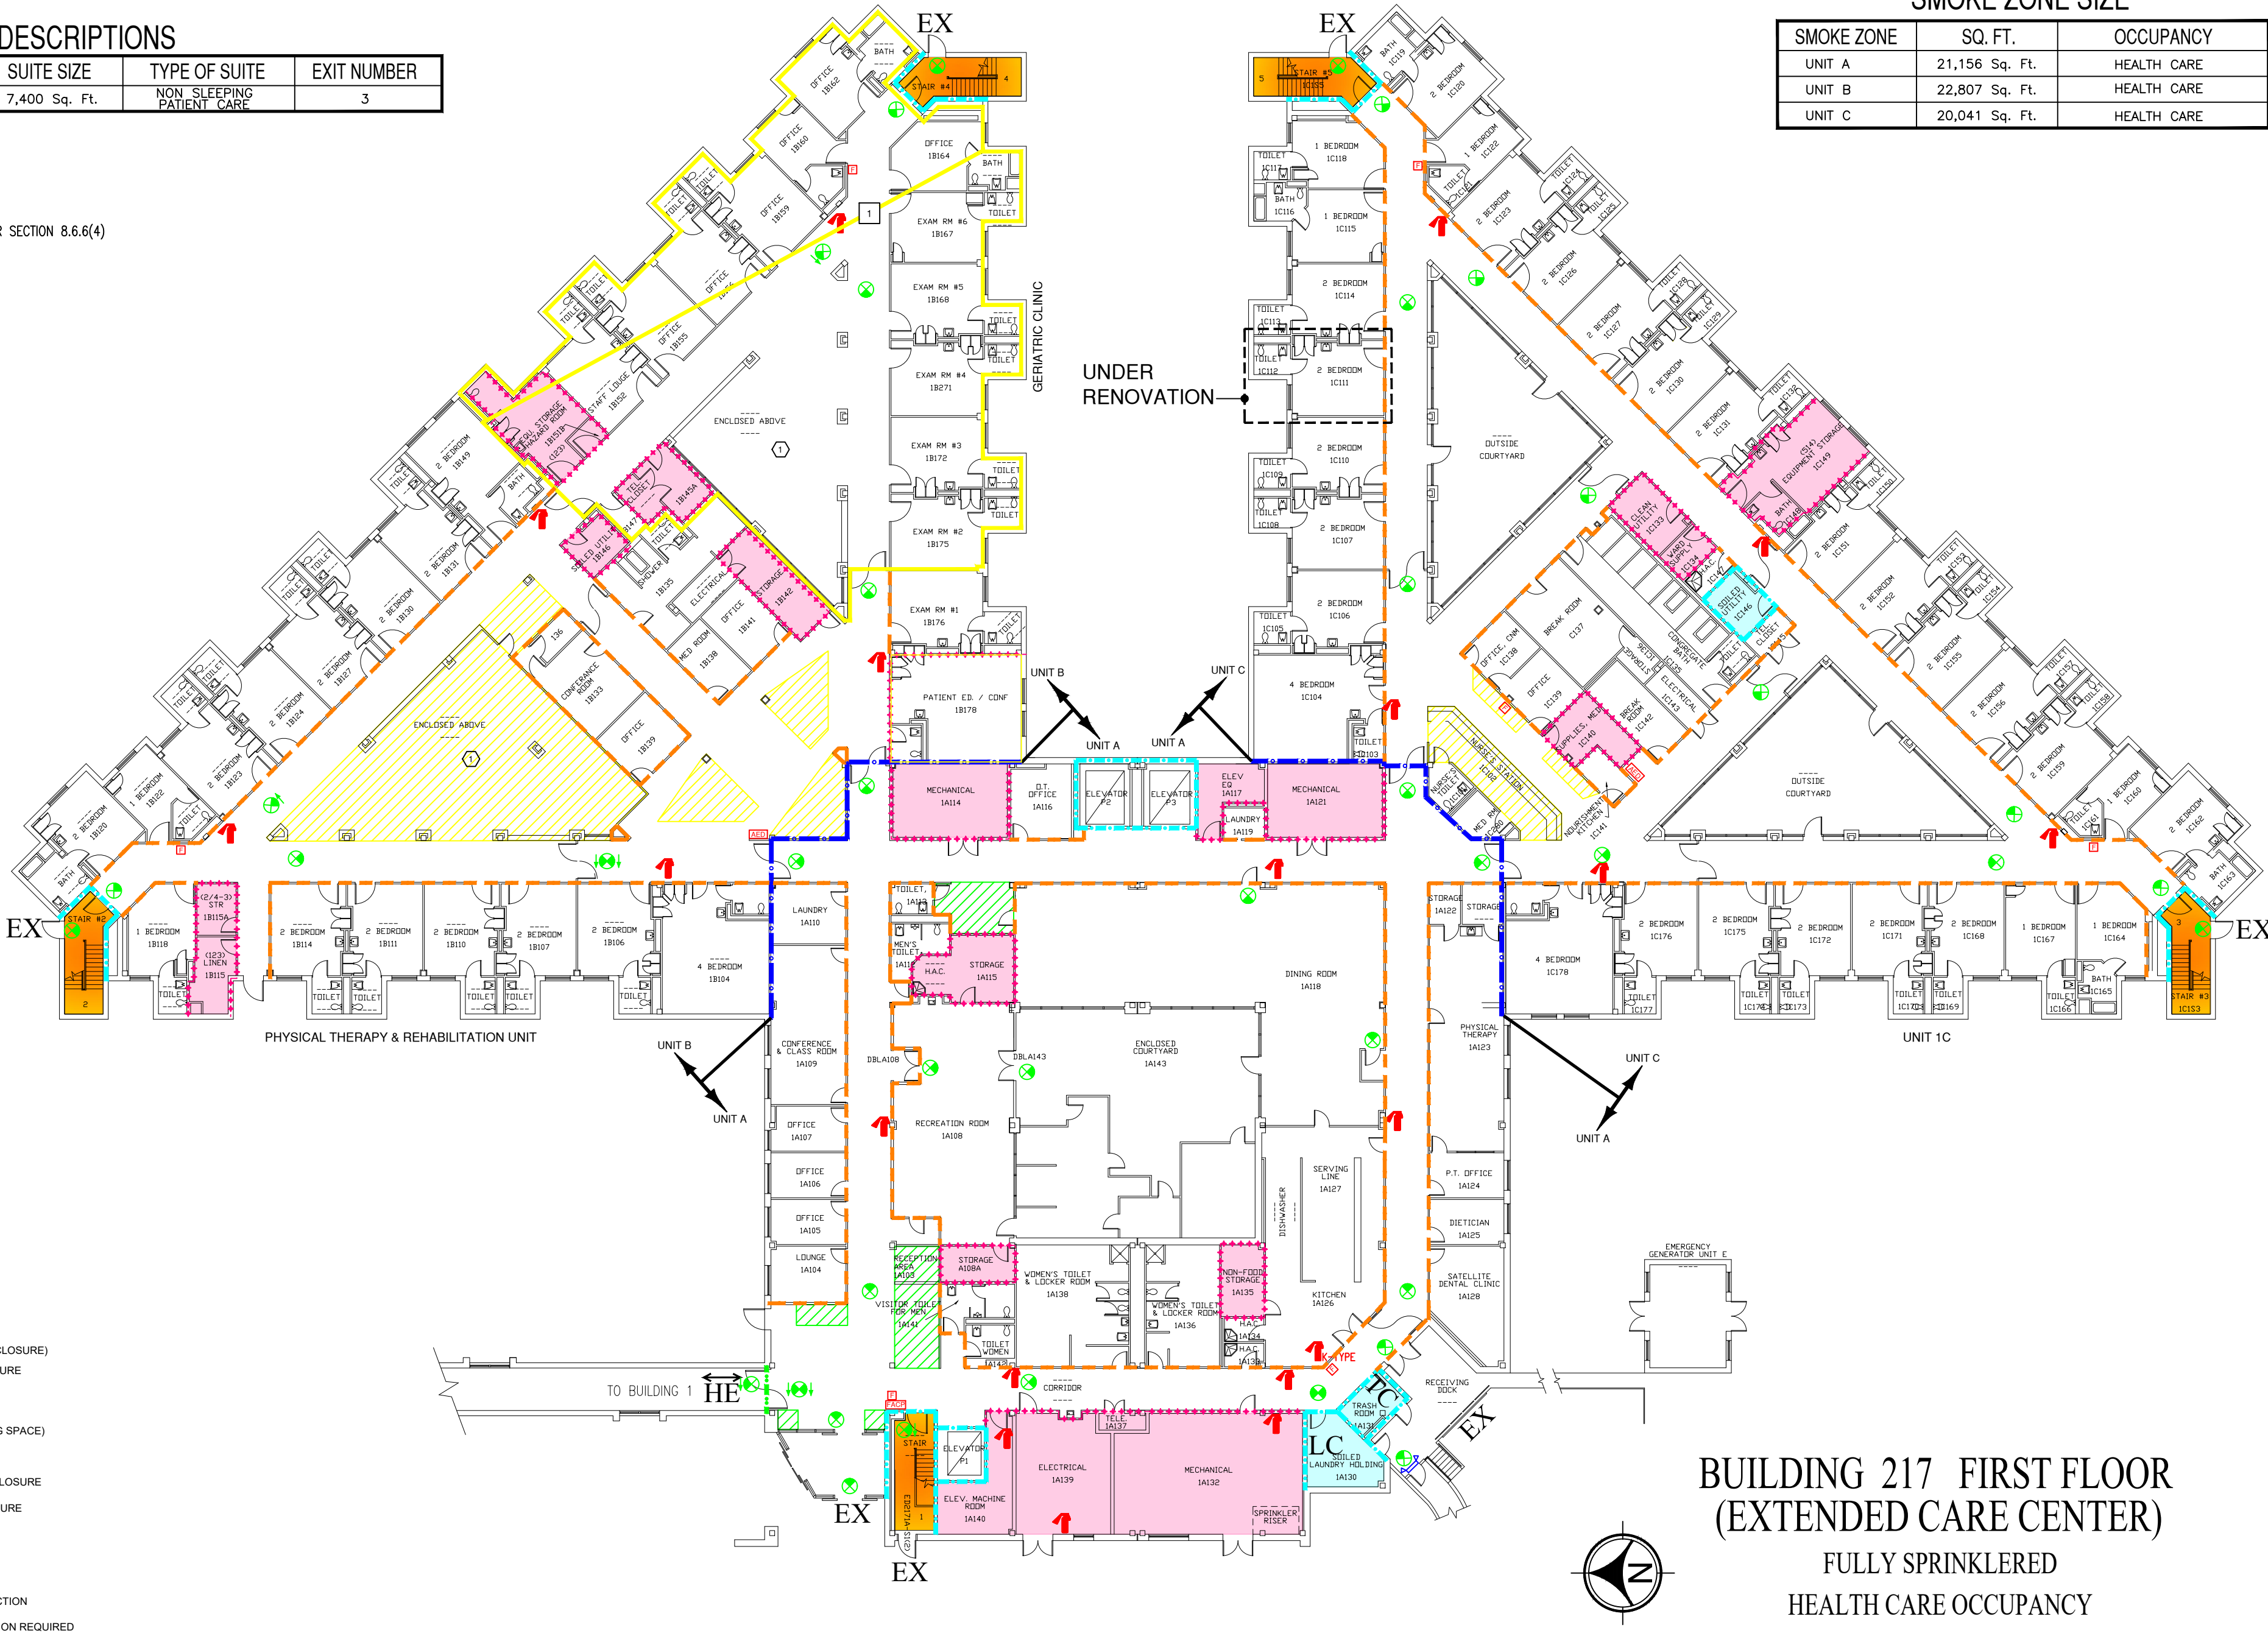

BUILDING 217 FIRST FLOOR
(EXTENDED CARE CENTER)
FULLY SPRINKLERED
HEALTH CARE OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 217
FIRST FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

217

Drawing Number

217SOC-1

Dwg. 27 of 64

GENERAL NOTES:

1. BUILT TO THE 1982 EDITION OF NFPA 101
LIFE SAFETY CODE.

KEY NOTES:

- 1 WINDOW SPRINKLER PROTECTION.
2 LINEN CHUTE NO LONGER IN SERVICE.
3 TRASH CHUTE NO LONGER IN SERVICE.

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
UNIT A	19,178 Sq. Ft.	HEALTH CARE
UNIT B	20,021 Sq. Ft.	HEALTH CARE
UNIT C	20,004 Sq. Ft.	HEALTH CARE


- APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON
FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS
PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND
OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
LC LINEN CHUTE
TC TRASH CHUTE
EX EXIT
HE HORIZONTAL EXIT
PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
2 HOUR FIRE BARRIER
SMOKE ZONE BARRIER
1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
NON-RATED SMOKE ZONE PARTITION
HEALTH CARE OCCUPANCY CORRIDORS
NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
SPRINKLER AND FIRE ALARM ZONE BOUNDARY
1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION
AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

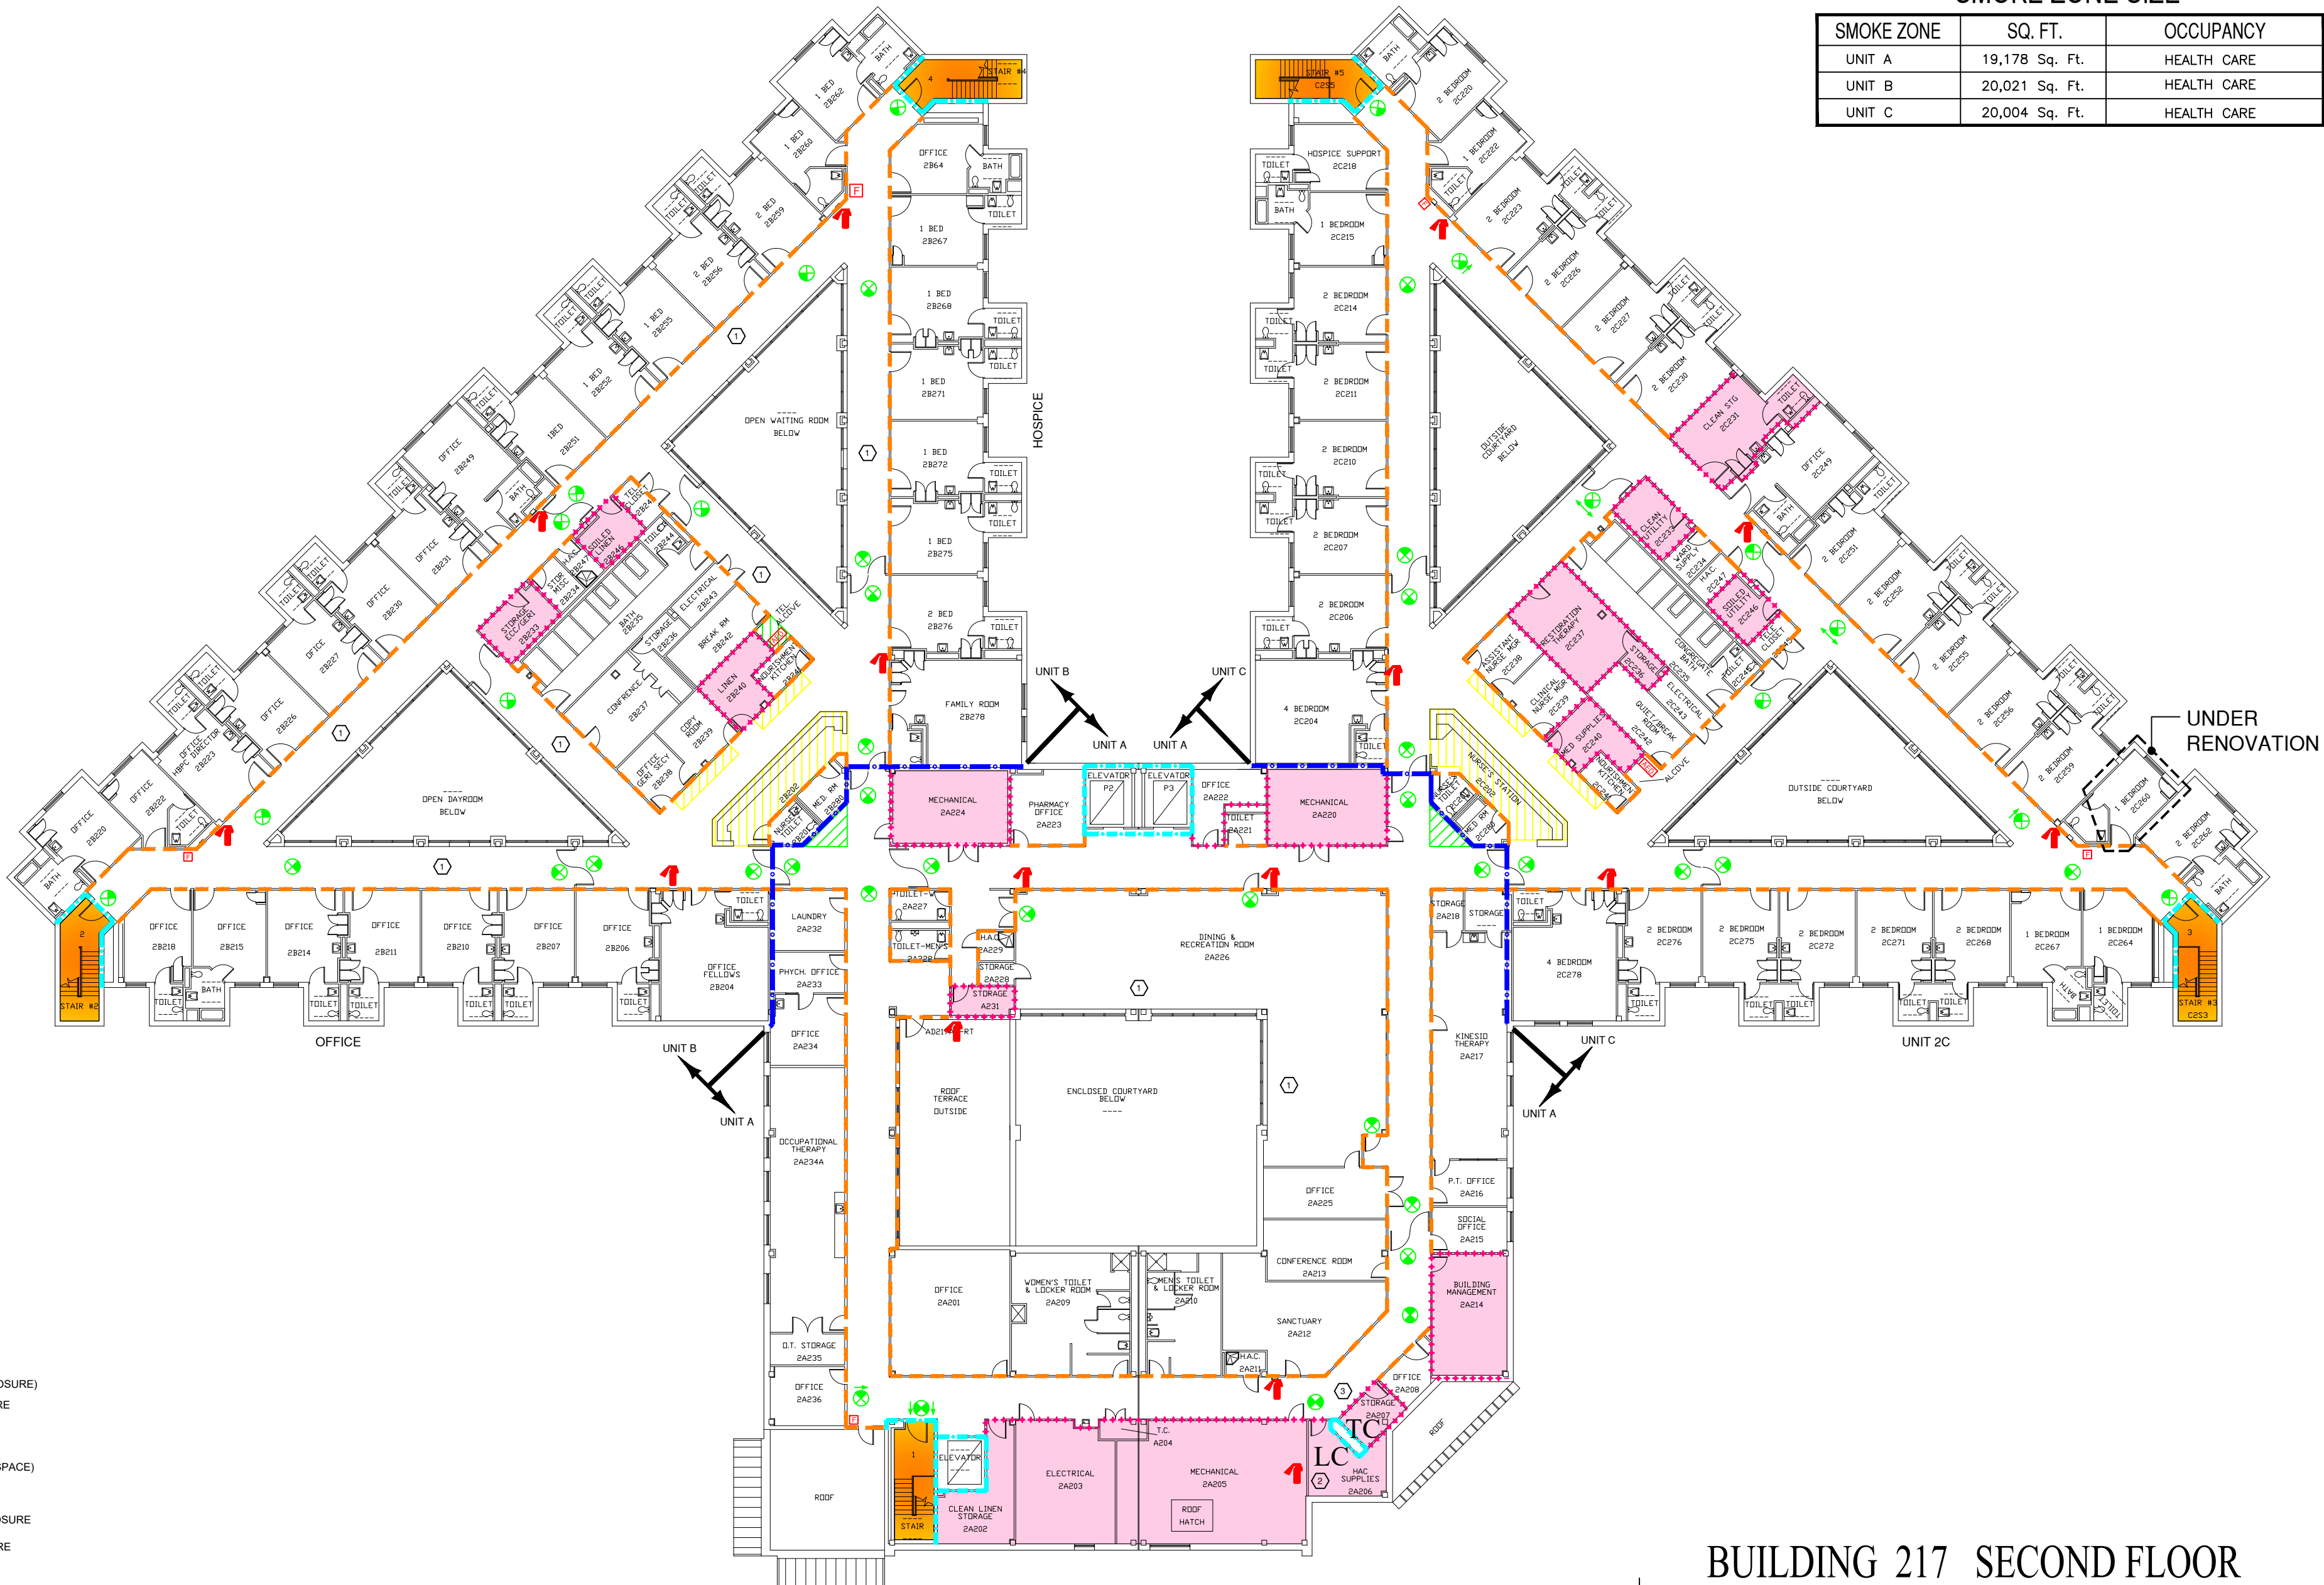

BUILDING 217 SECOND FLOOR
FULLY SPRINKLERED
(STANDARD RESPONSE TYPE)
HEALTH CARE OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 217
SECOND FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

217

Drawing Number

217SOC-2

Dwg.

28 of 64

KEY NOTES:

1 SEE EQUIVALENCY FOR MODULAR BUILDING WOOD CONSTRUCTION.

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
NORTH	8,457 Sq. Ft.	HEALTH CARE
CENTER	6,050 Sq. Ft.	HEALTH CARE
SOUTH	6,823 Sq. Ft.	HEALTH CARE
WEST	8,822 Sq. Ft.	HEALTH CARE



APPROVED EQUIVALENCIES

- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
- BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
- INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES

- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
LC LINEN CHUTE
TC TRASH CHUTE
EX EXIT
HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
2 HOUR FIRE BARRIER
SMOKE ZONE BARRIER
1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
NON-RATED SMOKE ZONE PARTITION
HEALTH CARE OCCUPANCY CORRIDORS
NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
SPRINKLER AND FIRE ALARM ZONE BOUNDARY
1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION
AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

BUILDING 221 PENTHOUSE
FULLY SPRINKLERED
INDUSTRIAL OCCUPANCY

BUILDING 221 FIRST FLOOR
FULLY SPRINKLERED
HEALTHCARE OCCUPANCY
(LONG TERM CARE)

Drawing Title	Project Title	Project Number
BUILDING 221 SECOND FLOOR	EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION	578-24-002
Approved: Project Director	Location	Building Number
	HINES, ILLINOIS	221
	Issue Date	Drawing Number
	06/19/2024	221SOC-1
	Checked by	Dwg. 29 of 64
	JLB	
	Drawn by	
	DJB	

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS


Edward Hines, Jr. VA Hospital 5000 5th Ave Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS, KC LLC. 1330 BURLINGTON STREET, SUITE 200 NORTH KANSAS CITY, MO 64116 (816) 931-3377

BUILDING 228 SUB-BASEMENT
FULLY SPRINKLERED
INDUSTRIAL OCCUPANCY

TO BUILDING #200

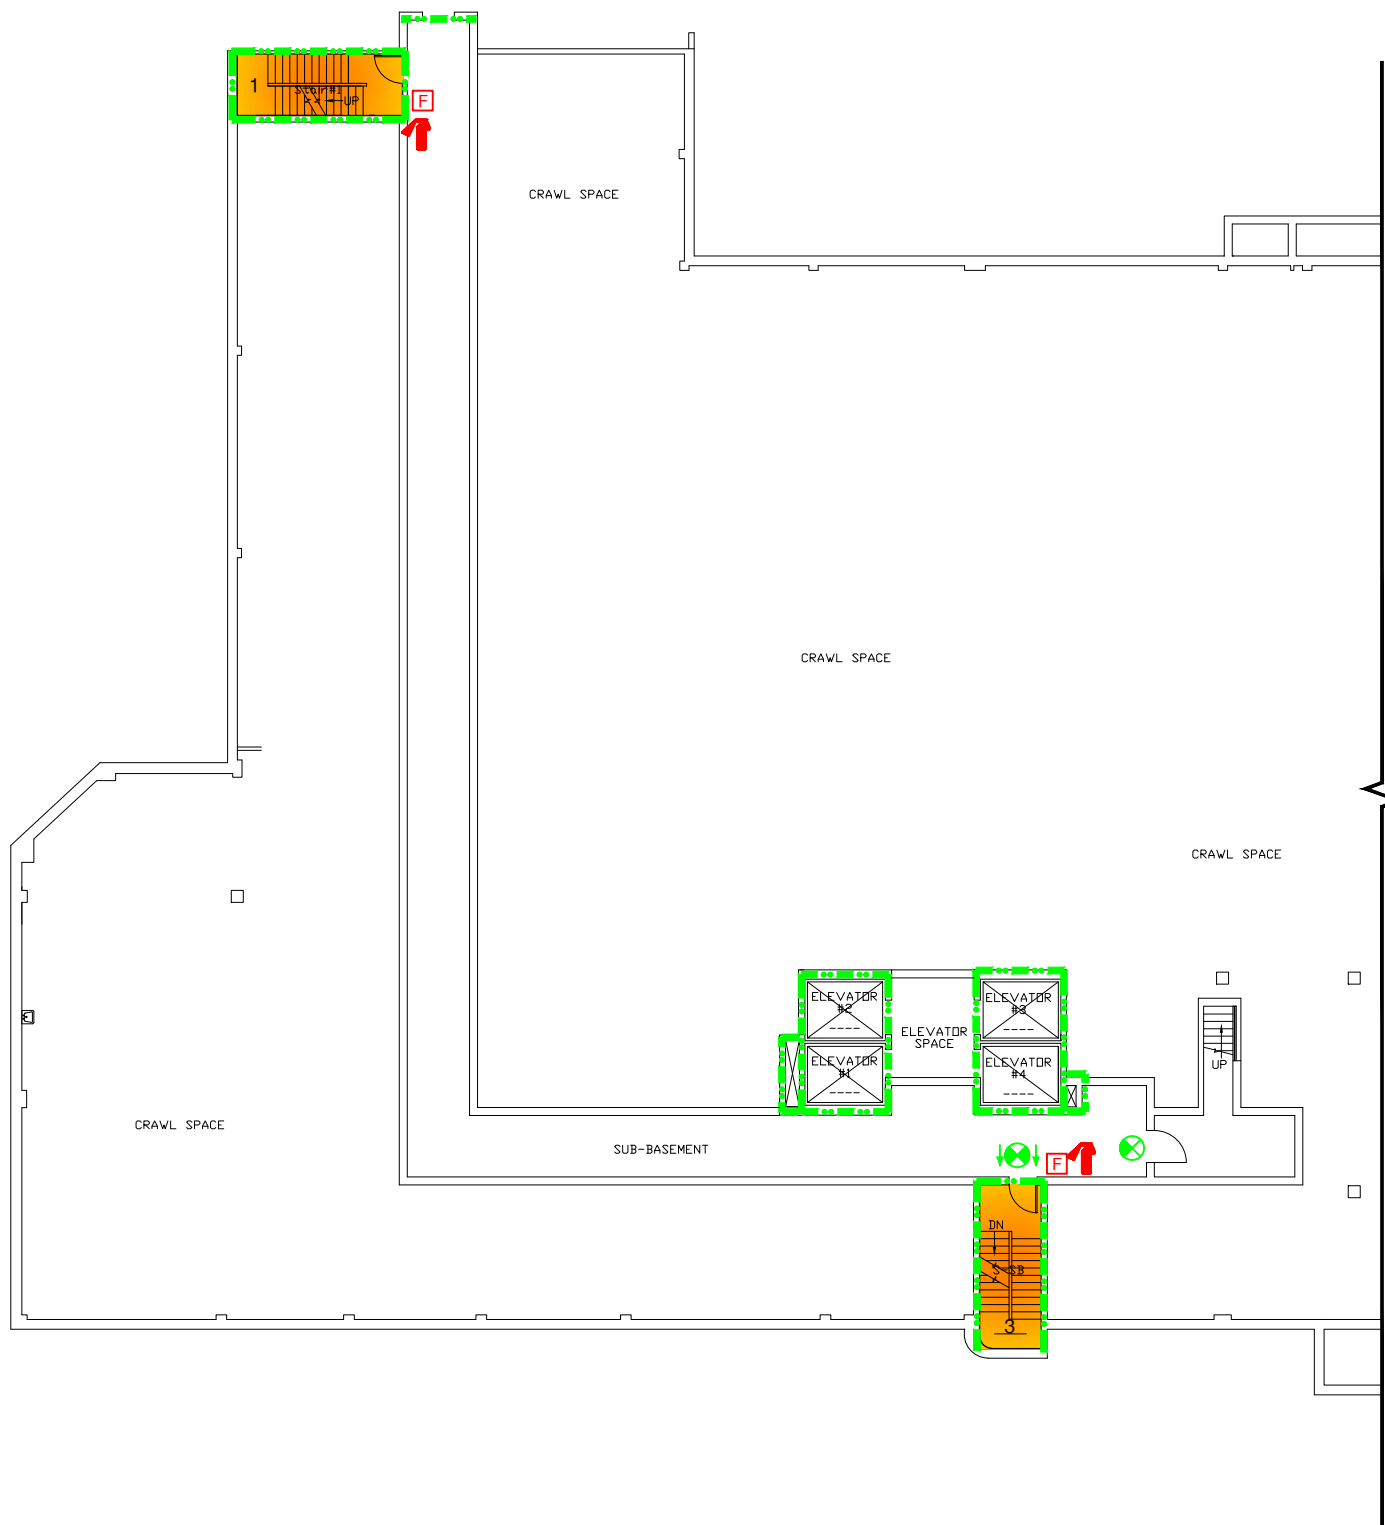


- APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 2. STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST


- EP → EXIT PASSAGEWAY
LC → LINEN CHUTE
TC → TRASH CHUTE
EX → EXIT
HE → HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
--- 2 HOUR FIRE BARRIER
--- SMOKE ZONE BARRIER
--- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
++++ SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
oooooo NON-RATED SMOKE ZONE PARTITION
----- HEALTH CARE OCCUPANCY CORRIDORS
+++++ NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
----- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
--- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
++++ SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION
AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

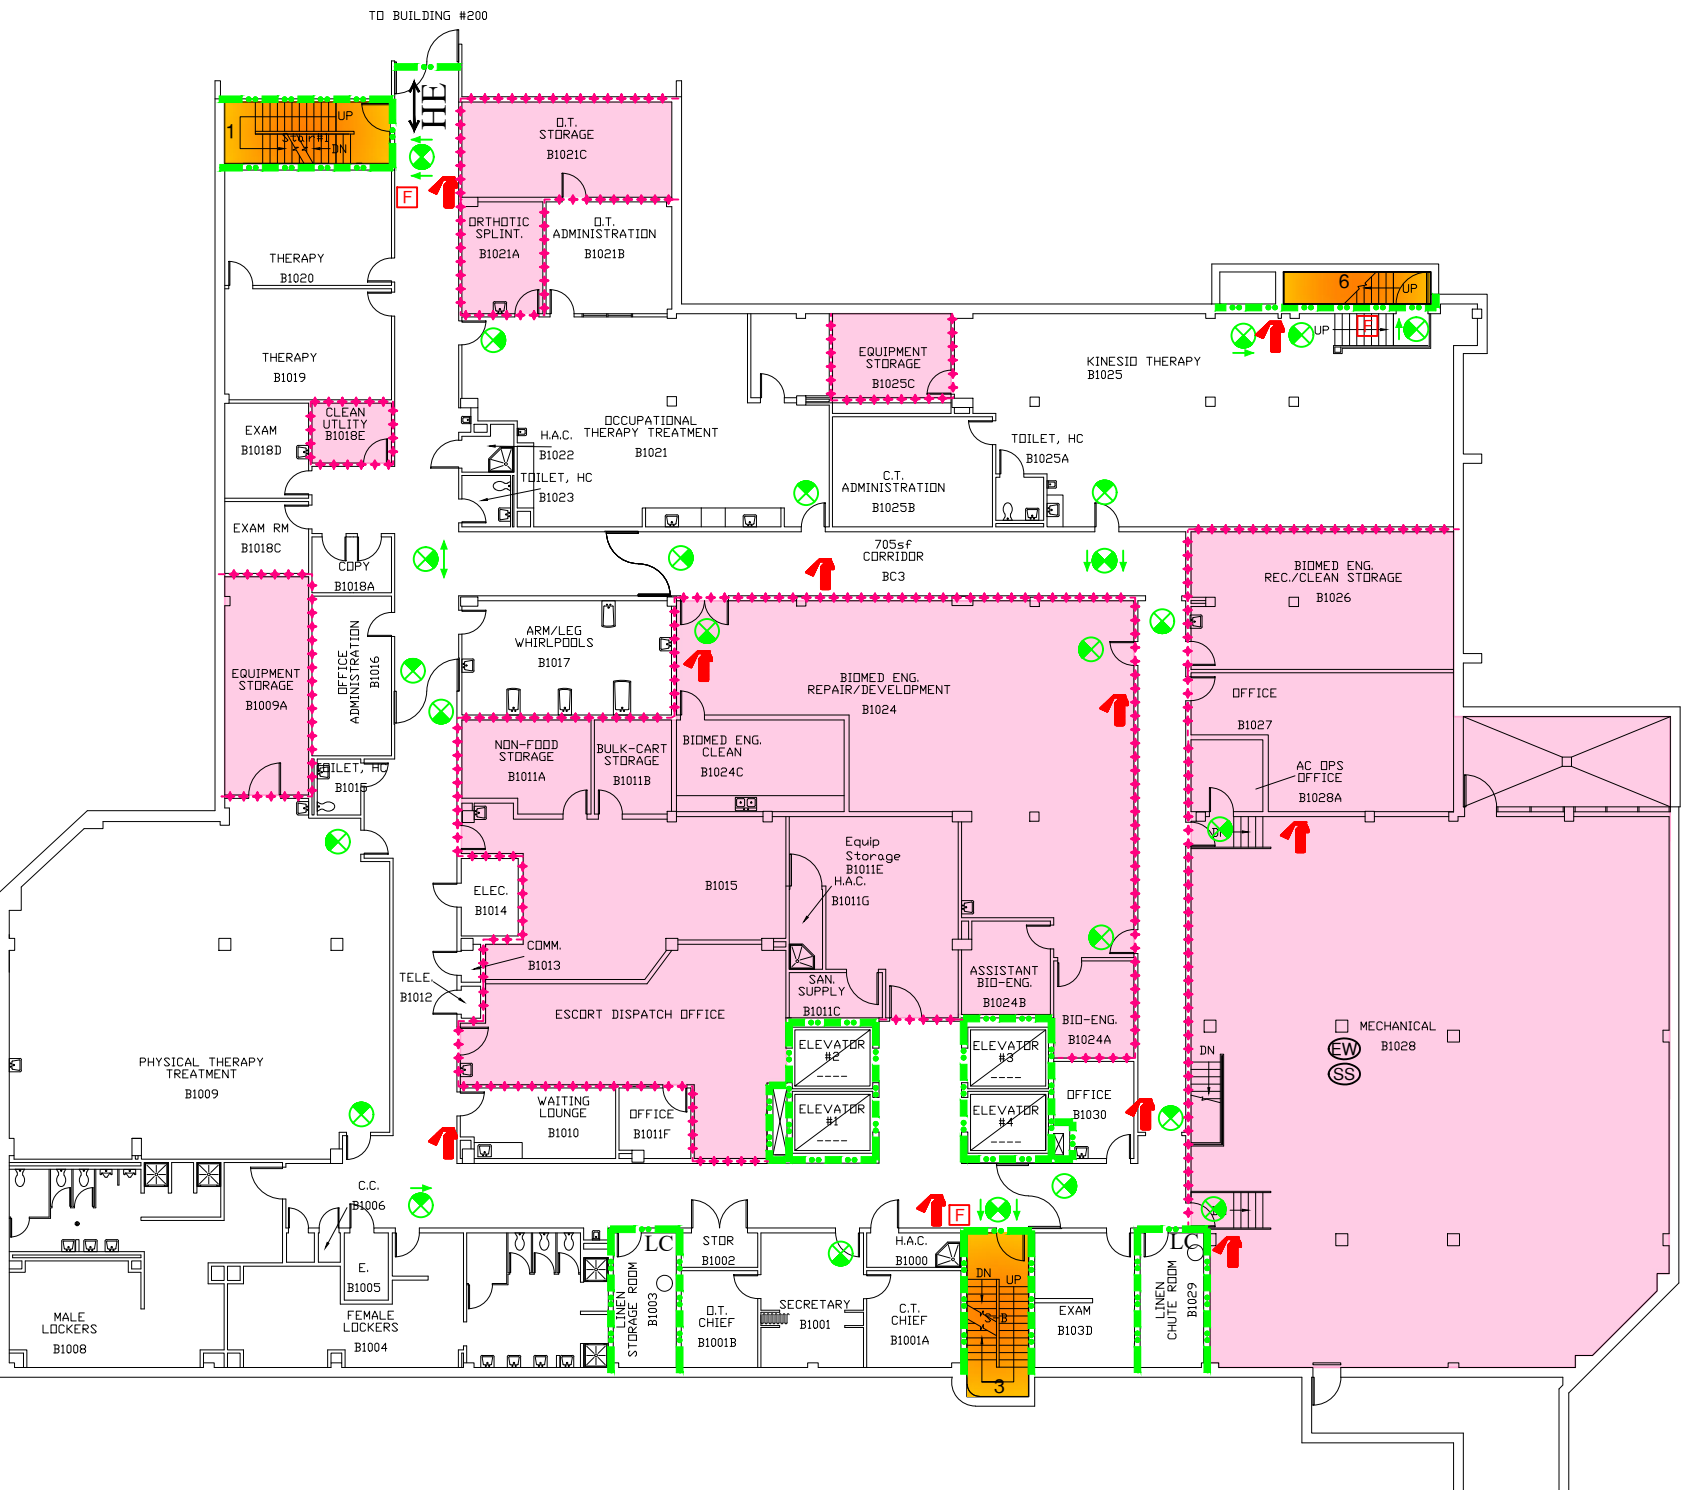

BUILDING 228 BASEMENT
FULLY SPRINKLERED
BUSINESS OCCUPANCY



FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 228
BASEMENT FLOOR

Approved: Project Director

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

228

Drawing Number

228SOC-SB-B

Dwg. 30 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	MENTAL HEALTH SERV. OFFICE SUITE	5,682 Sq. Ft.	NON PATIENT CARE	2
2	AUDIOLOGY SUITE	5,110 Sq. Ft.	NON SLEEPING PATIENT CARE	3
3	ENT CLINIC SUITE	4,083 Sq. Ft.	NON SLEEPING PATIENT CARE	2

KEY NOTES:

- 1 AUDIO BOOTHS INSTALLED UNDER 1985 VA DIRECTIVE. SPRINKLERS INSTALLED ABOVE AND AROUND AUDIO BOOTHS.


- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
 - MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
LC LINEN CHUTE
TC TRASH CHUTE
EX EXIT
HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
2 HOUR FIRE BARRIER
SMOKE ZONE BARRIER
1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
NON-RATED SMOKE ZONE PARTITION
HEALTH CARE OCCUPANCY CORRIDORS
NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
SPRINKLER AND FIRE ALARM ZONE BOUNDARY
1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION
AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED



BUILDING 228 FIRST FLOOR
FULLY SPRINKLERED
BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title	BUILDING 228 FIRST FLOOR
Approved: Project Director	

Project Title	EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION
Location	HINES, ILLINOIS
Issue Date	06/19/2024
Checked by	JLB
Drawn by	DJB

Project Number	578-24-002
Building Number	228
Drawing Number	228SOC-1
Dwg.	31 of 64

KEY NOTES:

1 FIRE DOOR RATING AND FRAME LABELING PLATE VERIFIED UNDER CONTINUOUS HINGE.

SMOKE ZONE SIZE

SMOKE ZONE	SQ. FT.	OCCUPANCY
SZ A	4,180 Sq. Ft.	HEALTH CARE
SZ B	9,597 Sq. Ft.	HEALTH CARE
SZ C	10,095 Sq. Ft.	HEALTH CARE
SZ D	4,890 Sq. Ft.	HEALTH CARE
SZ E	4,586 Sq. Ft.	HEALTH CARE

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

EP EXIT PASSAGEWAY
LC LINEN CHUTE
TC TRASH CHUTE
EX EXIT
HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

2 HOUR FIRE/SMOKE ZONE BARRIER
2 HOUR FIRE BARRIER
SMOKE ZONE BARRIER
1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
NON-RATED SMOKE ZONE PARTITION
HEALTH CARE OCCUPANCY CORRIDORS
NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
SPRINKLER AND FIRE ALARM ZONE BOUNDARY
1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION
AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377


Drawing Title

BUILDING 228
SECOND FLOOR

Approved: Project Director

BUILDING 228 SECOND FLOOR

FULLY SPRINKLERED
HEALTH CARE OCCUPANCY



Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002


Building Number

228

Drawing Number

228SOC-2

Dwg. 32 of 64

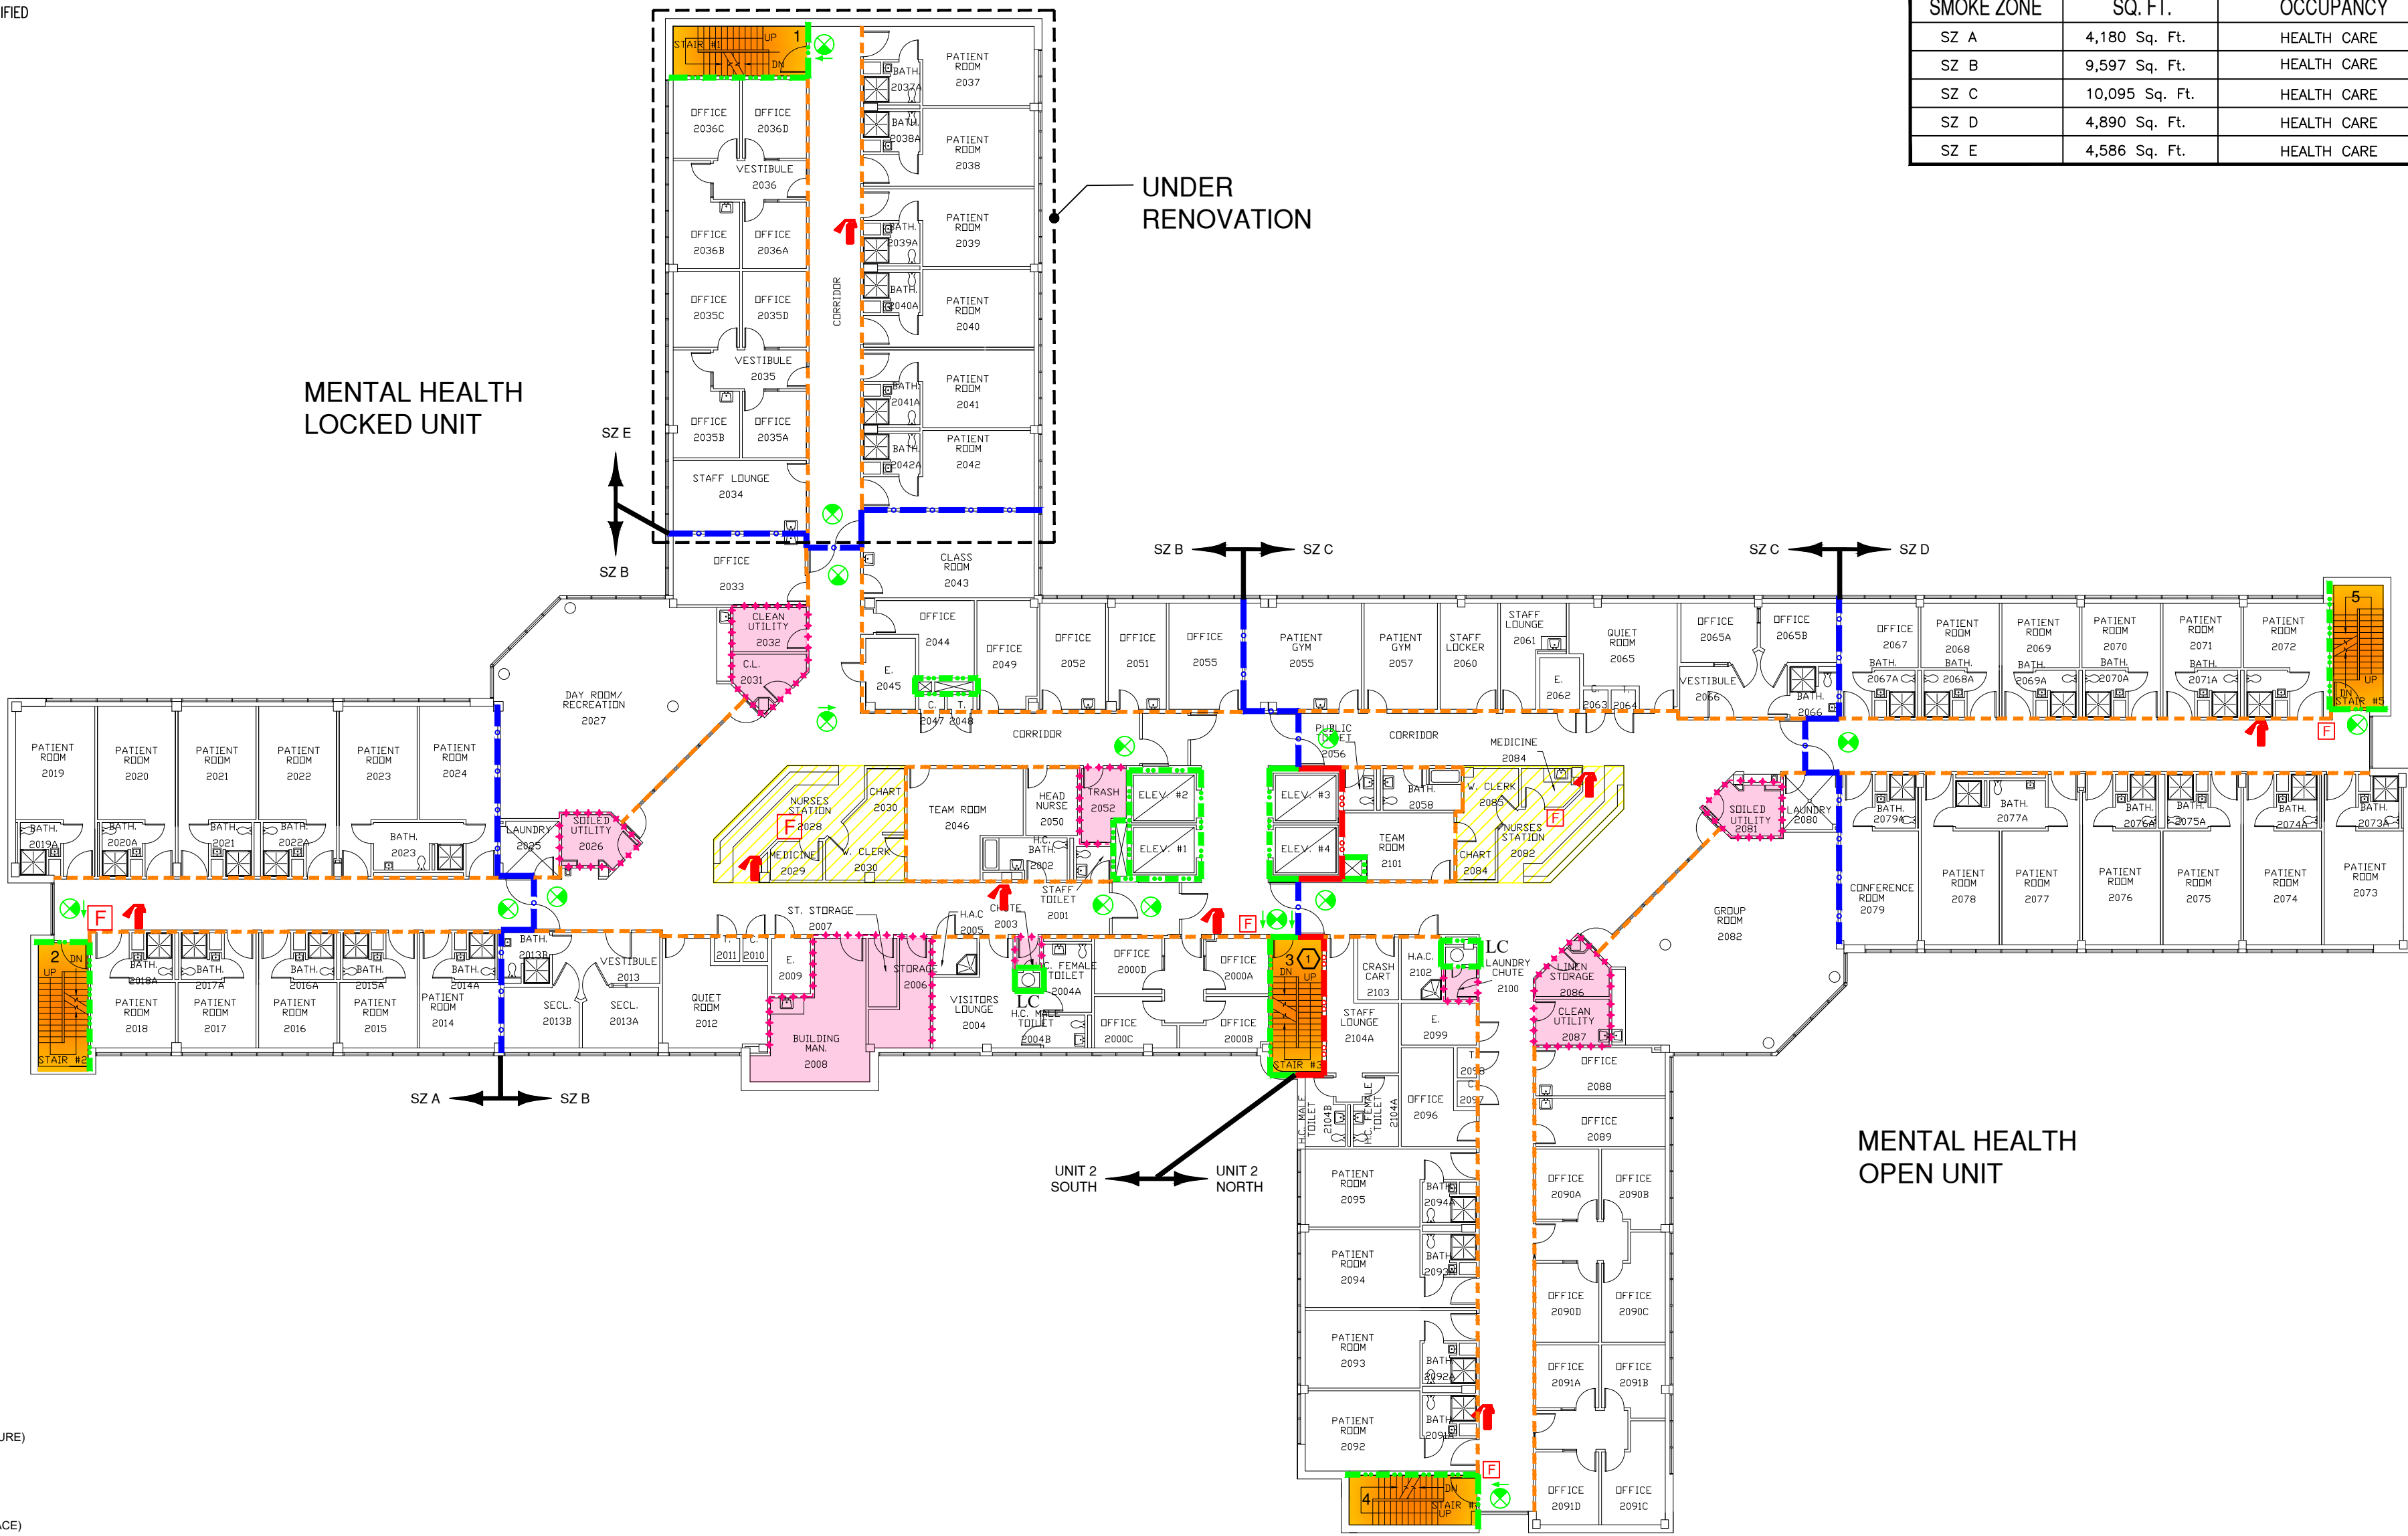



- APPROVED EQUIVALENCIES**
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES**
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
LC LINEN CHUTE
TC TRASH CHUTE
EX EXIT
HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
2 HOUR FIRE BARRIER
SMOKE ZONE BARRIER
1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
NON-RATED SMOKE ZONE PARTITION
HEALTH CARE OCCUPANCY CORRIDORS
NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
SPRINKLER AND FIRE ALARM ZONE BOUNDARY
1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION
AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS




FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 228
THIRD FLOOR

Approved: Project Director



BUILDING 228 THIRD FLOOR

FULLY SPRINKLERED
BUSINESS OCCUPANCY

Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002

Building Number

228

Drawing Number

228SOC-3

Dwg.

33 of 64



- APPROVED EQUIVALENCIES**
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES**
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP EXIT PASSAGEWAY
LC LINEN CHUTE
TC TRASH CHUTE
EX EXIT
HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
2 HOUR FIRE BARRIER
SMOKE ZONE BARRIER
1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
NON-RATED SMOKE ZONE PARTITION
HEALTH CARE OCCUPANCY CORRIDORS
NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
SPRINKLER AND FIRE ALARM ZONE BOUNDARY
1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION
AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS




FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title

BUILDING 228
FOURTH FLOOR

Approved: Project Director

BUILDING 228 FOURTH FLOOR
FULLY SPRINKLERED
BUSINESS OCCUPANCY



Project Title

EDWARD HINES, JR. VA
STATEMENT OF CONDITIONS
DOCUMENTATION

Location

HINES, ILLINOIS

Issue Date

06/19/2024

Checked by

JLB

Drawn by

DJB

Project Number

578-24-002


Building Number

228

Drawing Number

228SOC-4

Dwg. 34 of 64

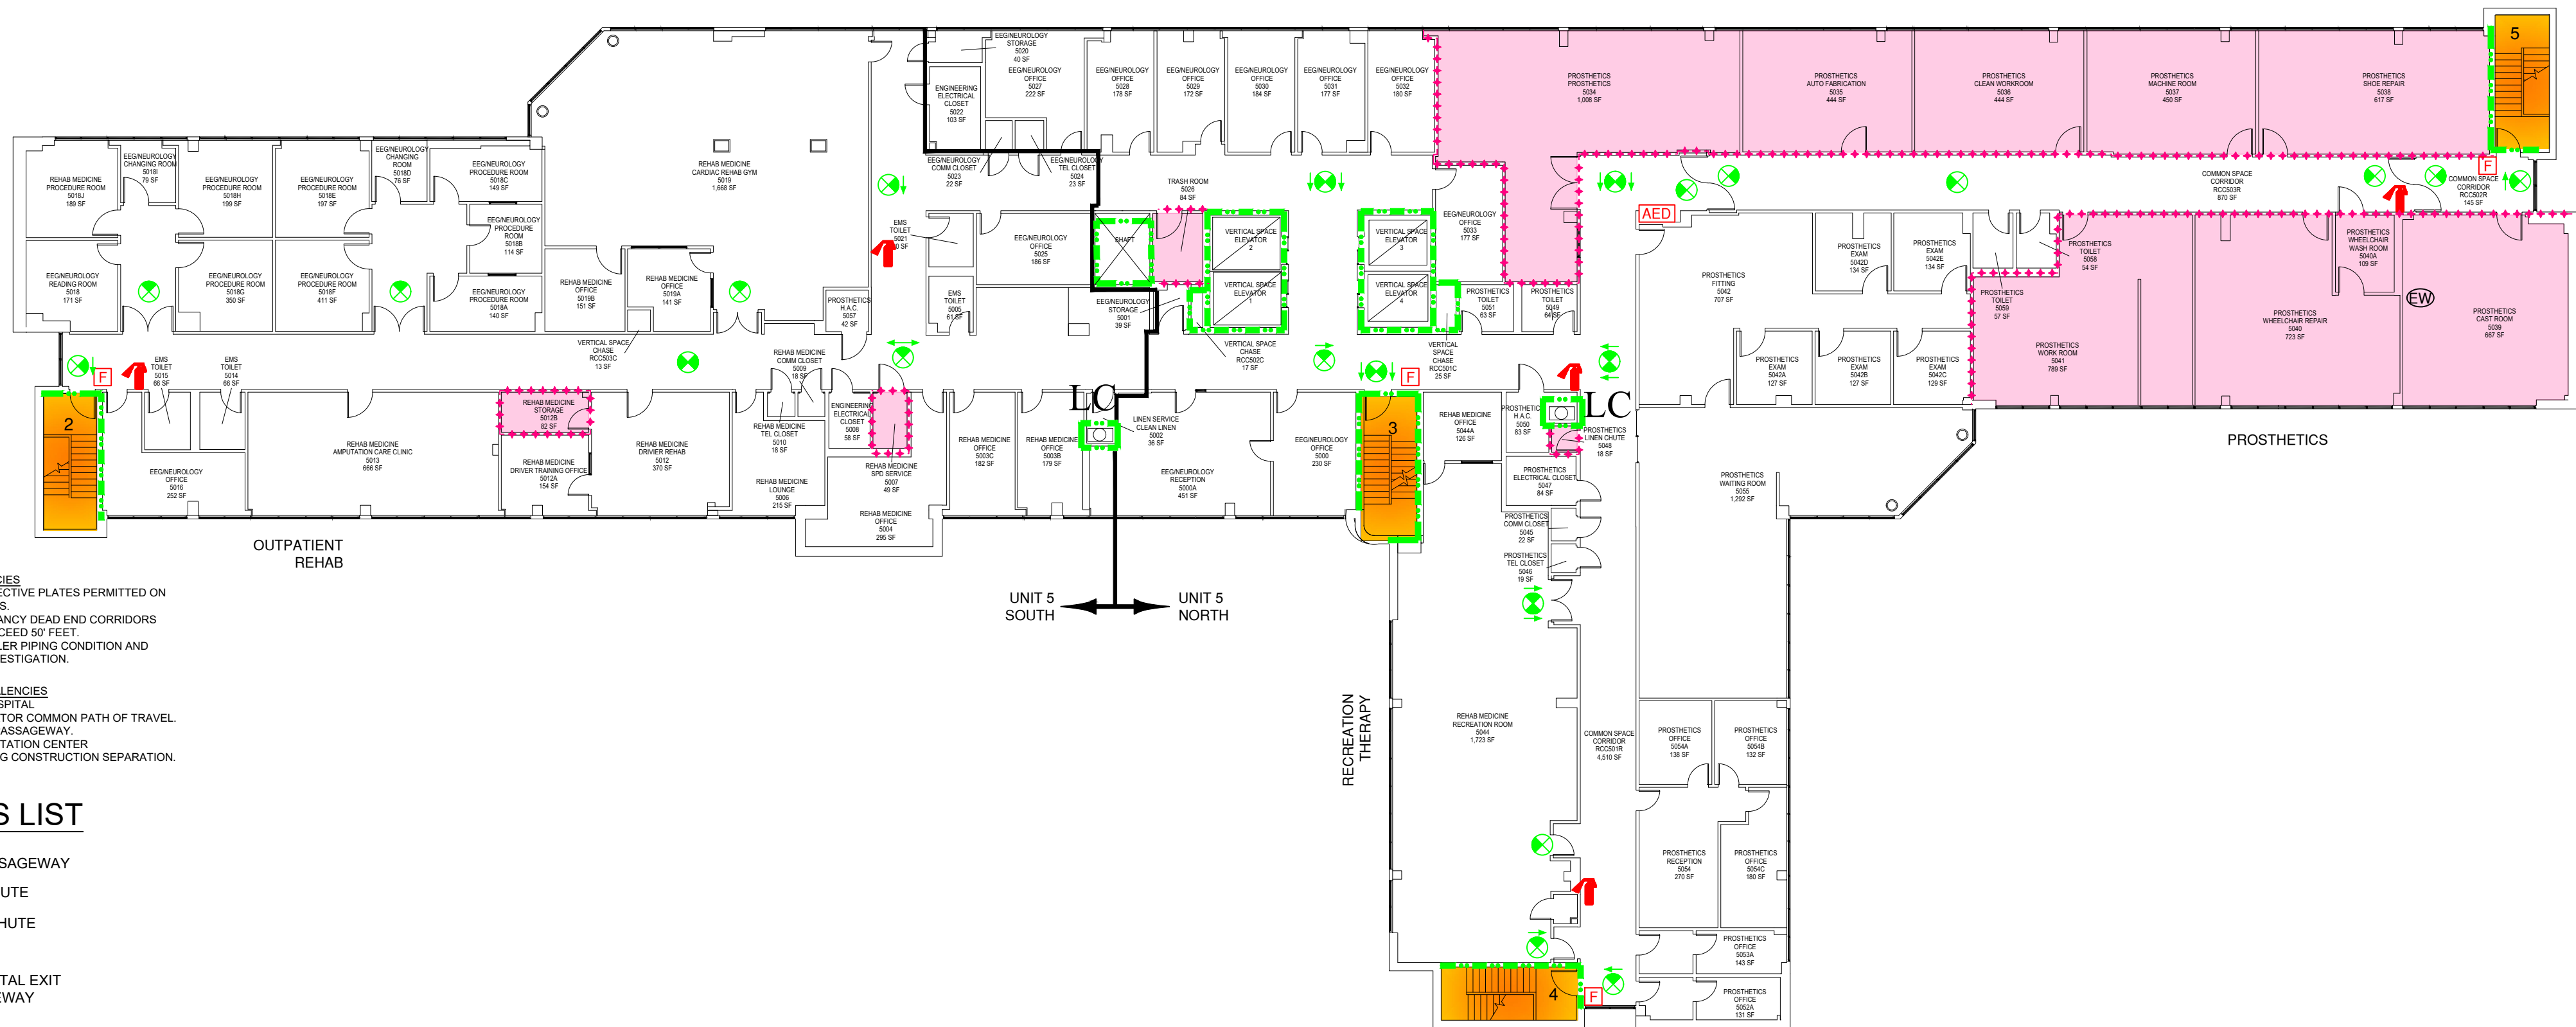

- APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 2. STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP → EXIT PASSAGEWAY
LC → LINEN CHUTE
TC → TRASH CHUTE
EX → EXIT
HE → HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
— 2 HOUR FIRE BARRIER
— SMOKE ZONE BARRIER
— 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
++++ SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
○○○○○○ NON-RATED SMOKE ZONE PARTITION
— HEALTH CARE OCCUPANCY CORRIDORS
++++ NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
— SPRINKLER AND FIRE ALARM ZONE BOUNDARY
— 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
++++ SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
EXIT STAIRWELL/PASSAGEWAY
SUITE DESIGNATION
AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377


Drawing Title	BUILDING 228 FIFTH FLOOR	
Approved: Project Director		

Project Title	EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION	
Location	HINES, ILLINOIS	
Issue Date	Checked by	Drawn by
06/19/2024	JLB	DJB

Project Number	578-24-002
Building Number	228
Drawing Number	228SOC-5
Dwg.	35 of 64

BUILDING 228 FIFTH FLOOR

FULLY SPRINKLERED
BUSINESS OCCUPANCY




- APPROVED EQUIVALENCIES
- OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
 - BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
 - INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.
- APPROVED SITE EQUIVALENCIES
- BUILDING 200 - MAIN HOSPITAL
- LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
 - STAIR NO. 1 EXIT PASSAGEWAY.
- BUILDING 221 - REHABILITATION CENTER
- MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP → EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- EX EXIT
- HE → HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

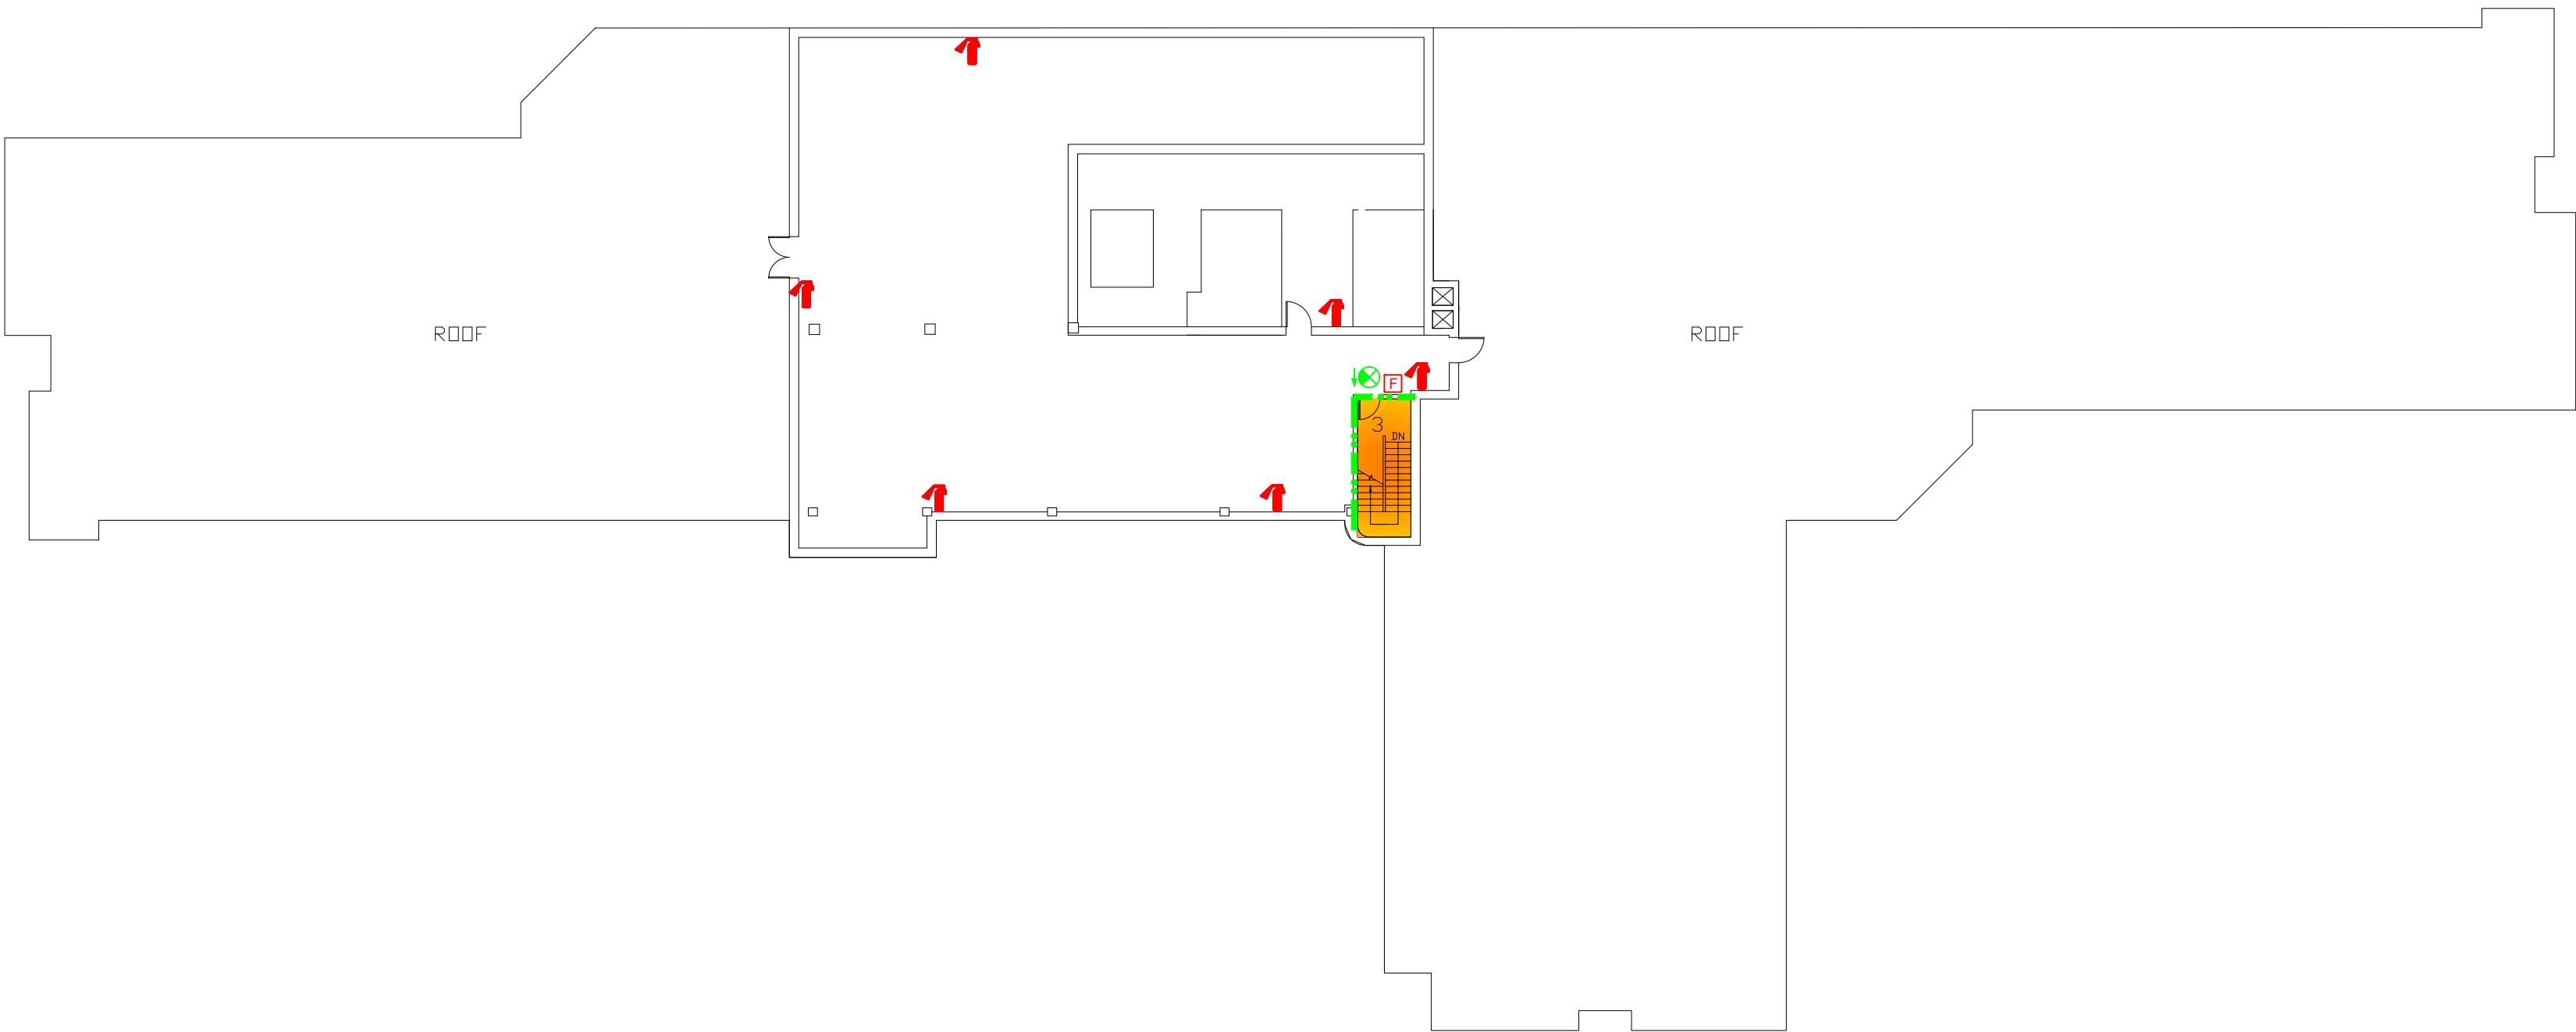


BUILDING 228 SIXTH FLOOR

(MECHANICAL EQUIPMENT)

FULLY SPRINKLERED

INDUSTRIAL OCCUPANCY



FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS



Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS



FP&C CONSULTANTS,
KC LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title
BUILDING 228 SIXTH FLOOR
Approved: Project Director

Project Title
EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION
Location
HINES, ILLINOIS
Issue Date
06/19/2024
Checked by
JLB
Drawn by
DJB

Project Number
578-24-002
Building Number
228
Drawing Number
228SOC-6
Dwg.
36 of 64