















TABLE OF CONTENTS

 			
Project Name US DEPARTMENT OF VETERANS AFFAIRS - AV-VTC SYSTEMS 6800 W. PECOS ROAD		Drawing Title CONSTRUCTION SET	
Drawing No. 3293		Date 11/13/23	
Sheet No. 3293			
Sheet Title COVER SHEET TABLE OF CONTENTS			
Project Name US DEPARTMENT OF VETERANS AFFAIRS - AV-VTC SYSTEMS 6800 W. PECOS ROAD			
Drawing Title CONSTRUCTION SET			
Drawing No. 3293			
Date 11/13/23			
Sheet No. 3293			
Sheet Title COVER SHEET TABLE OF CONTENTS			

INFRASTRUCTURE SYMBOLS

	DUPLEX WALL RECEPTACLE
	DUPLEX CEILING RECEPTACLE
	DUPLEX FLOOR/BOX RECEPTACLE
	4-PLEX (DUAL DUPLEX) WALL RECEPTACLE
	4-PLEX (DUAL DUPLEX) CEILING RECEPTACLE
	4-PLEX (DUAL DUPLEX) FLOOR BOX RECEPTACLE
	J-BOX WALL RECEPTACLE
	J-BOX CEILING RECEPTACLE
	J-BOX FLOOR BOX RECEPTACLE
	DATA DROP RECEPTACLE
	DATA DROP FLOOR BOX RECEPTACLE
	PHONE DROP RECEPTACLE
	PHONE DROP FLOOR BOX RECEPTACLE
	DATA-PHONE DROP
	DATA-PHONE DROP FLOOR BOX RECEPTACLE
	CATV FEED
	LOW VOLTAGE SWITCH
	FLOOR BOX
	CONDUIT STUB
	CONDUIT X3
	POWER CIRCUIT
	INFRASTRUCTURE DRAWING NOTE
	RECEPTACLE TAG
	CEILING SPEAKER
	CEILING MICROPHONE
	TABLE/MILLWORK MICROPHONE
	CEILING ANTENNA
	REVISION NOTE

GENERAL NOTES

GENERAL

- SYSTEM AND COMPONENTS WILL BE INSTALLED IN A NEAT AND PROFESSIONAL MANNER.
- ALL EQUIPMENT WILL BE NEW AND BLEMISH FREE UNLESS OTHERWISE NOTED IN THIS DOCUMENT.
- ANY ABOVE CEILING COMPONENTS SHALL BE INSTALLED WITH TRIM RINGS AND/OR GROMMETS WHEN NECESSARY.
- ALL RACK EQUIPMENT WILL BE INSTALLED USING PROPER MANUFACTURER SUPPLIED MOUNTING HARDWARE.
- ALL RACK OPEN SPACES WILL BE FILLED WITH EITHER A BLANK OR VENT PANEL.
- ALL RACKS WILL HAVE PROPER VENTILATION AS SPECIFIED TO PREVENT HEAT BUILDUP AND INCREASE EQUIPMENT LIFE EXPECTANCY.
- DIMENSIONS ARE INDICATED ON AUDIOVISUAL DRAWINGS WHERE CRITICAL TO THE INSTALLATION AND PERFORMANCE OF THE AUDIOVISUAL DEVICES.
- THE ARCHITECTURAL FURNITURE ILLUSTRATED ON THE AUDIOVISUAL DRAWINGS ARE FOR REFERENCE ONLY.
- POWER, VOICE & DATA SYMBOLS INDICATED ON THE AUDIOVISUAL DRAWINGS ARE FOR REFERENCE ONLY.

WIRING AND CABLES

- ALL RACK CABLING WILL BE BUNDLED NEATLY WITH CABLE TIES OR HOOK & LOOP DEPENDING ON REQUIREMENTS.
- LOW AND HIGH VOLTAGE CABLING WILL BE SEPARATED IN ACCORDING WITH NFPA 70 (NATIONAL ELECTRIC CODE) 2014 SPECIFICATIONS.
- ALL CABLING IN CONDUIT WILL COMPLY WITH THE CONDUIT FILL SPECIFICATIONS IN NFPA 70 (NATIONAL ELECTRIC CODE) 2014.
- PROPER STRAIN RELIEF AT CONNECTIONS AND JOINTS WILL BE USED.
- SUFFICIENT SERVICE LOOPS SHALL BE PROVIDED FOR ALL ABOVE CEILING ELEMENTS, ABOVE RACKS, IN RACKS OR IN CABLE TRAYS SO THAT COMPONENTS MAY BE MINIMALLY MOVED OR SERVICED WITHOUT CABLE STRAIN.
- ALL CONNECTORS ARE SIZED TO FIT THE SPECIFIC CABLING AND ARE INSTALLED IN ACCORDANCE WITH MANUFACTURE SPECIFICATIONS.
- ALL PERMANENTLY INSTALLED CABLING SHALL BE INSTALLED WITH PERMANENT SYSTEM LABELS.
- WHERE CONDUIT IS TO BE SURFACE RUN, THE CONTRACTOR SHALL VERIFY THE CONDUIT FINISH.

BACK BOX LOCATIONS AND MOUNTING

- PROVIDE BLANK COVER PLATES AT ALL NON-USED AUDIOVISUAL JUNCTION BOXES. VERIFY ALL COVER PLATE FINISHES WITH CLIENT.
- VERIFY MOUNTING CONDITIONS, HEIGHTS AND LOCATIONS OF ALL AUDIOVISUAL JUNCTION BOXES, BACK BOXES AND FLOOR BOXES WITH CLIENT/ARCHITECT.

STRUCTURAL COORDINATION:

- CEILING MOUNTED SPEAKER ENCLOSURES SHALL BE SUPPORTED FROM OVERHEAD STRUCTURE. DO NOT HANG SPEAKER ENCLOSURES FROM FINISHED CEILING.
- ALL HANGING OR FREE STANDING EQUIPMENT AND CABINETS FURNISHED INCLUDING, BUT NOT LIMITED TO, RACKS, LOUDSPEAKERS, PROJECTION SCREENS AND TV MONITORS, SHALL BE SECURED TO SUBSTANTIAL BUILDING STRUCTURE AS PRESCRIBED BY GOVERNING CODES.

INSTALLER TESTING AND ADJUSTMENTS


- PROPER GROUNDING WILL BE VERIFIED ON ALL EQUIPMENT.
- VIDEO DISPLAYS SHALL BE PROPERLY ALIGNED AND FREE FROM DISTORTION.
- CABLING AND LOUDSPEAKERS SHALL BE TESTED FOR PROPER POLARITY.
- AUDIO SHALL BE FREE OF DISTORTION, HUMS, BUZZES OR POPS.
- LOUDSPEAKER SYSTEMS SHALL BE TESTED AND EQUALIZED TO PROVIDE UNIFORM FREQUENCY RESPONSE.
- CONTROL SYSTEM PROGRAM SHALL BE TESTED FOR PROPER SYSTEM OPERATION AND SHALL BE FREE OF GLITCHES. ANY ISSUES WILL BE BROUGHT TO THE ATTENTION OF THE PROGRAMMER FOR CORRECTION.

INDEX

AV101-AV199	PLAN VIEW / RCP
AV201-AV299	ELEVATIONS/INFRASTRUCTURE DETAILS
AV301-AV399	SCHEMATICS / LINE DIAGRAMS
AV401-AV499	DETAILS AND OTHER INFO AS APPLICABLE


TYPICAL ABBREVIATIONS

ADA	AMERICAN DISABILITIES ACT
AFC	ABOVE FINISHED CEILING
AFF	ABOVE FINISHED FLOOR
ALS	ASSISTIVE LISTENING SYSTEM
APPROX	APPROXIMATELY
ASS'Y	ASSEMBLY
AV	AUDIOVISUAL
AVC	AUDIOVISUAL CONTRACTOR
B.O.	BOTTOM OF
BMS	BUILDING MANAGEMENT SYSTEM
BP	BUILDING POWER
C	CONDUIT
CL	CENTERLINE
CLG	CEILING
CLR	CLEAR
CO	CONDUIT ONLY
CONT	CONTINUOUS
COORD	COORDINATE
CU	COPPER
DIM	DIMENSION
DN	DOWN
DWG	DRAWING
EC	ELECTRICAL CONTRACTOR\
EE	ELECTRICAL ENGINEER
EMB	ELECTRONIC MARKER BOARD
EWB	ELECTRONIC WHITE BOARD
ENC	ENCLOSURE
EP	ELECTRICAL PANEL
EQ, EQUIP	EQUIPMENT
ER	EQUIPMENT RACK
ETR	EXISTING TO REMAIN
EXTG	EXISTING
FLR	FLOOR
FOH	FRONT OF HOUSE
FOP	FRONT OF PROJECTOR
FOS	FACE OF SCREEN
FURN	FURNITURE
G, GND	GROUND
GC	GENERAL CONTRACTOR
GFE	GOV'T FURNISHED EQUIPMENT
HGT/HT	HEIGHT
HV	HIGH VOLTAGE
IG	ISOLATED GROUND
IR	INFRARED
JB/JBOX	JUNCTION BOX
LBS	POUNDS
LVC	LOW VOLTAGE CONTROLLER
LV	LOW VOLTAGE
MAX	MAXIMUM
MB	MARKER BOARD
MFR	MANUFACTURER
MIN	MINIMUM
MTD	MOUNTED
N	NEUTRAL
N/A	NOT APPLICABLE
NEC	NATIONAL ELECTRICAL CODE
N.I.C.	NOT IN CONTRACT
NO., #	NUMBER
NTS	NOT TO SCALE
OFE	OWNER FURNISHED EQUIPMENT
OFCl	OWNER FURNISHED, CONTRACTOR INSTALLED
OFOI	OWNER FURNISHED, OWNER INSTALLED
OSE	OWNER SUPPLIED EQUIPMENT
PA	PUBLIC ADDRESS/OVERHEAD PAGING
PB	PULL BOX
P/O	PART OF
PROJ	PROJECTION
PROV'D	PROVIDED
PWR	POWER
RECP	RECEPTACLE
REQ'D	REQUIRED
RH	RECEPTACLE HEIGHT
RM	ROOM
SCRN	SCREEN
SH	SWITCH HEIGHT
SIM	SIMILAR
SPEC	SPECIFICATIONS
SPKR	SPEAKER (LOUDSPEAKER)
SW	SWITCH
TEL	TELEPHONE
TEL/COMM	TELECOMMUNICATION
T.O.	TOP OF
TYP	TYPICAL
UG	UNDERGROUND
UON/U.O.N.	UNLESS OTHERWISE NOTED
UPS	UNINTERRUPTIBLE POWER SUPPLY
VIF/V.I.F.	VERIFY IN FIELD
W/	WITH
W/O	WITH OUT

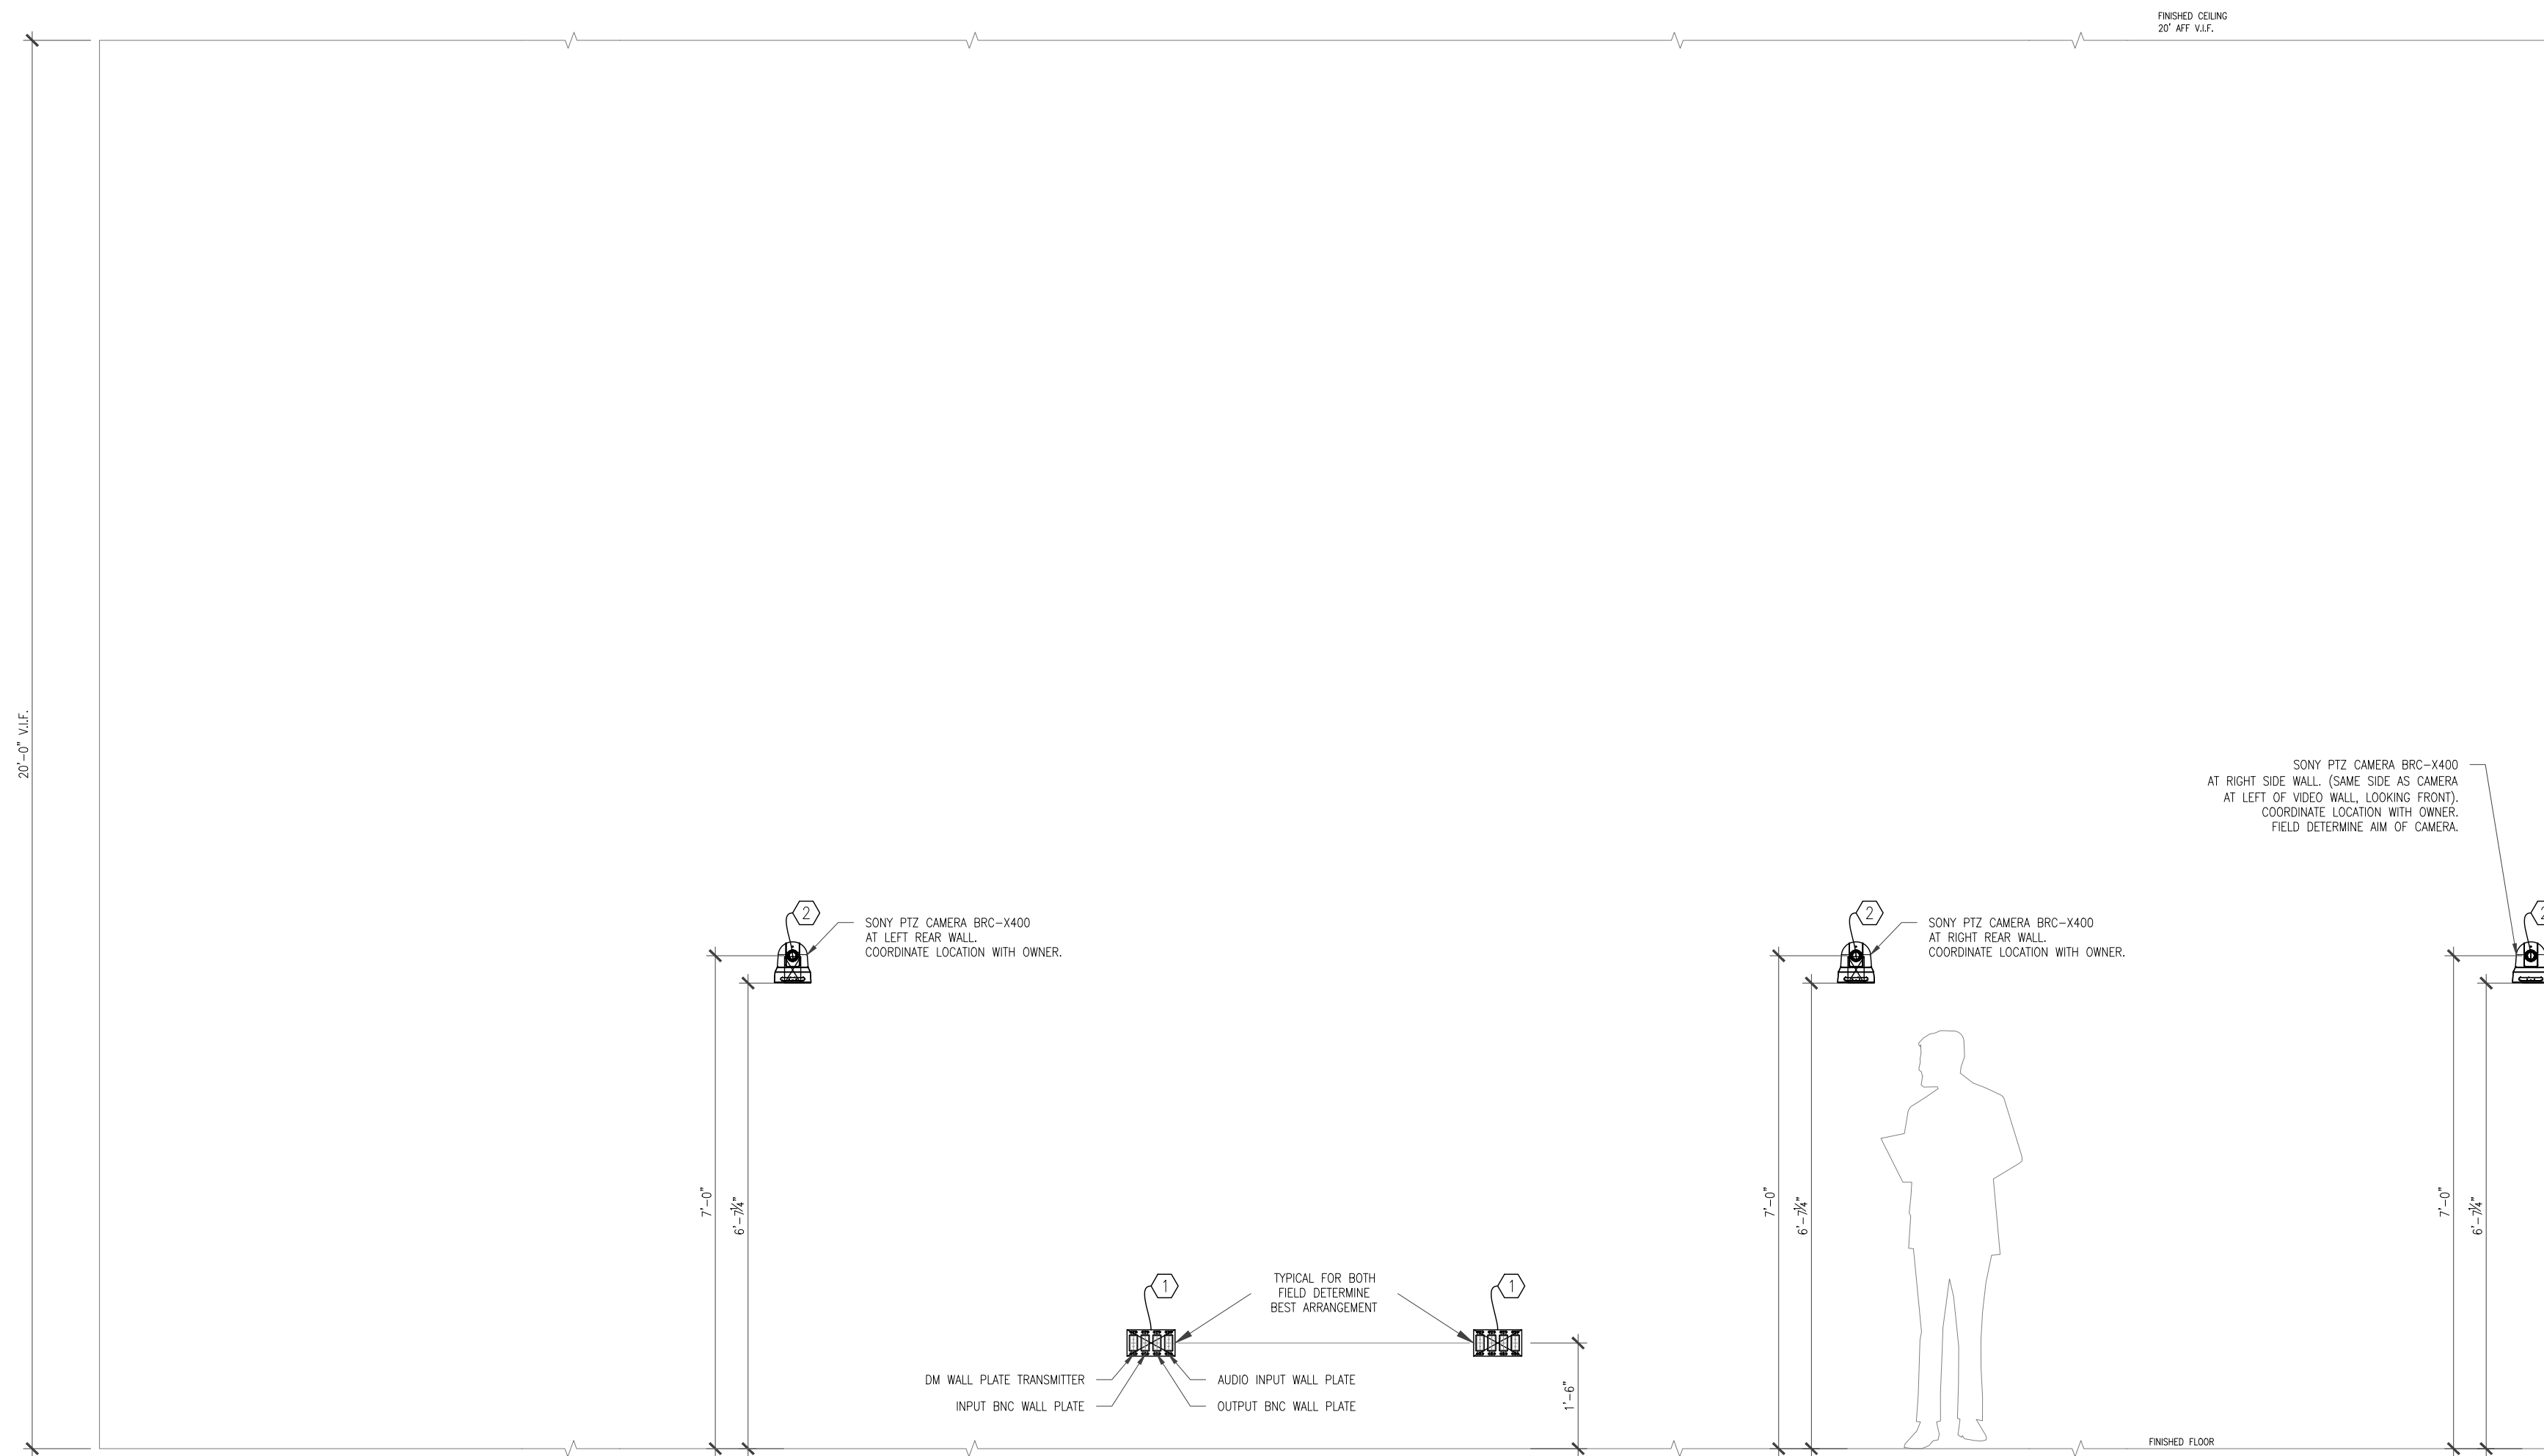


A AUDITORIUM AV EQUIPMENT ELEVATION
SCALE: 1/2" = 1'-0"


- INFRASTRUCTURE NOTES:
- PROVIDE 1 - 4-GANG J-BOX OR CUT-IN RING FOR BNC WALL PLATES, DM WALL PLATE TRANSMITTER AND AUDIO INPUT WALL PLATE (ALL DECORA). MOUNT, FLUSH IN WALL WITH PULL STRINGS TO ACC. CEILING HEIGHT PER ELEVATION. COORDINATE LOCATION WITH OWNER.
 - PROVIDE 1 - SINGLE GANG J-BOX OR CUT-IN RING FOR PTZ CAMERA, FLUSH IN WALL WITH PULL STRINGS TO ACC. CEILING HEIGHT PER ELEVATION.

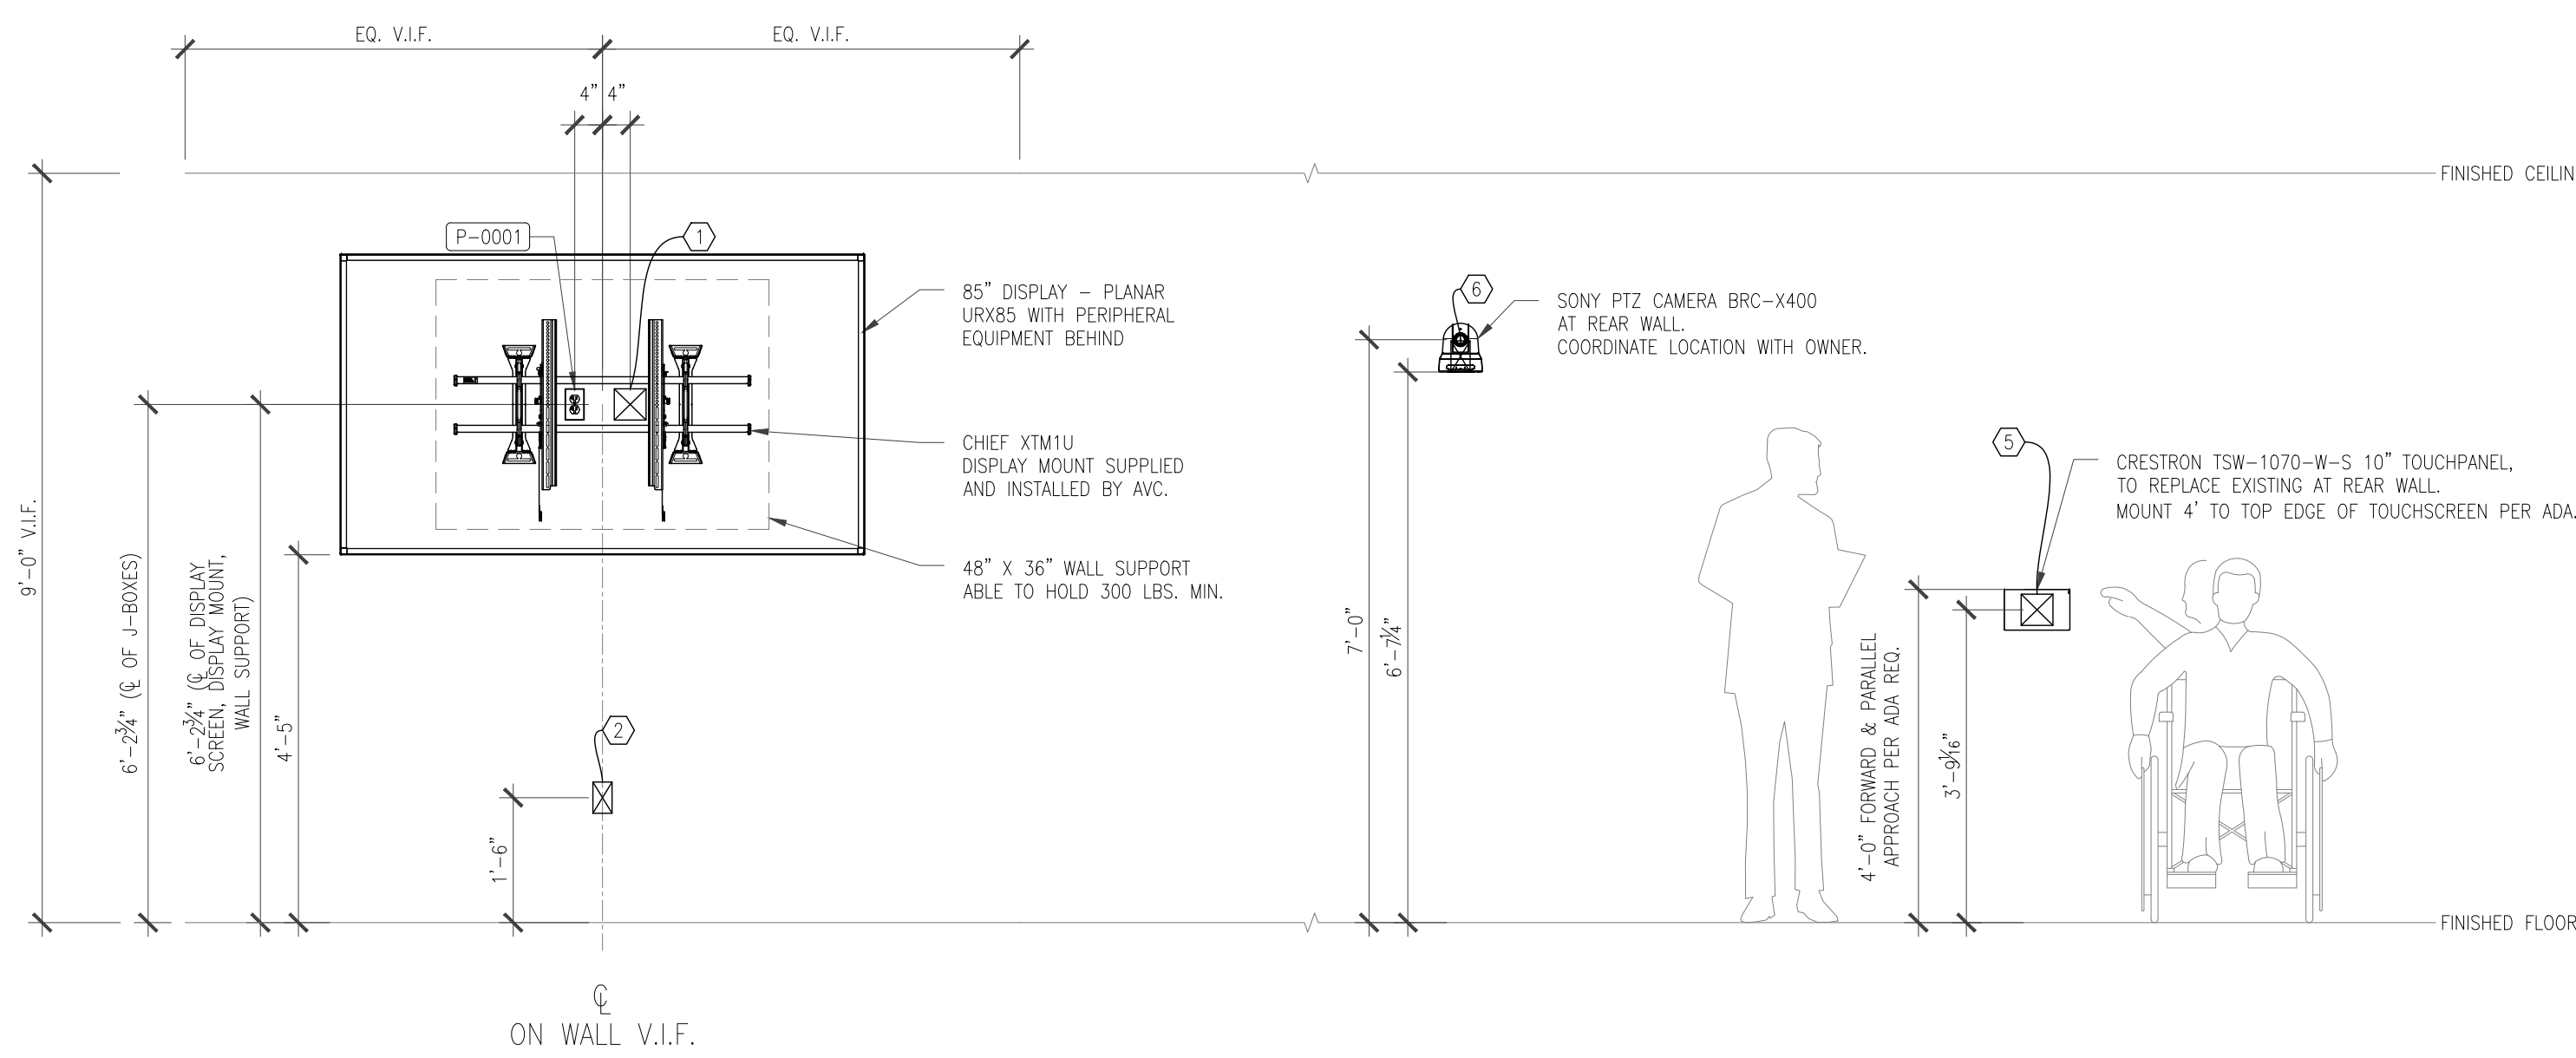

B CLASSROOM 1A, 2A, 3A - AV EQUIPMENT ELEVATION
SCALE: 1/2" = 1'-0"

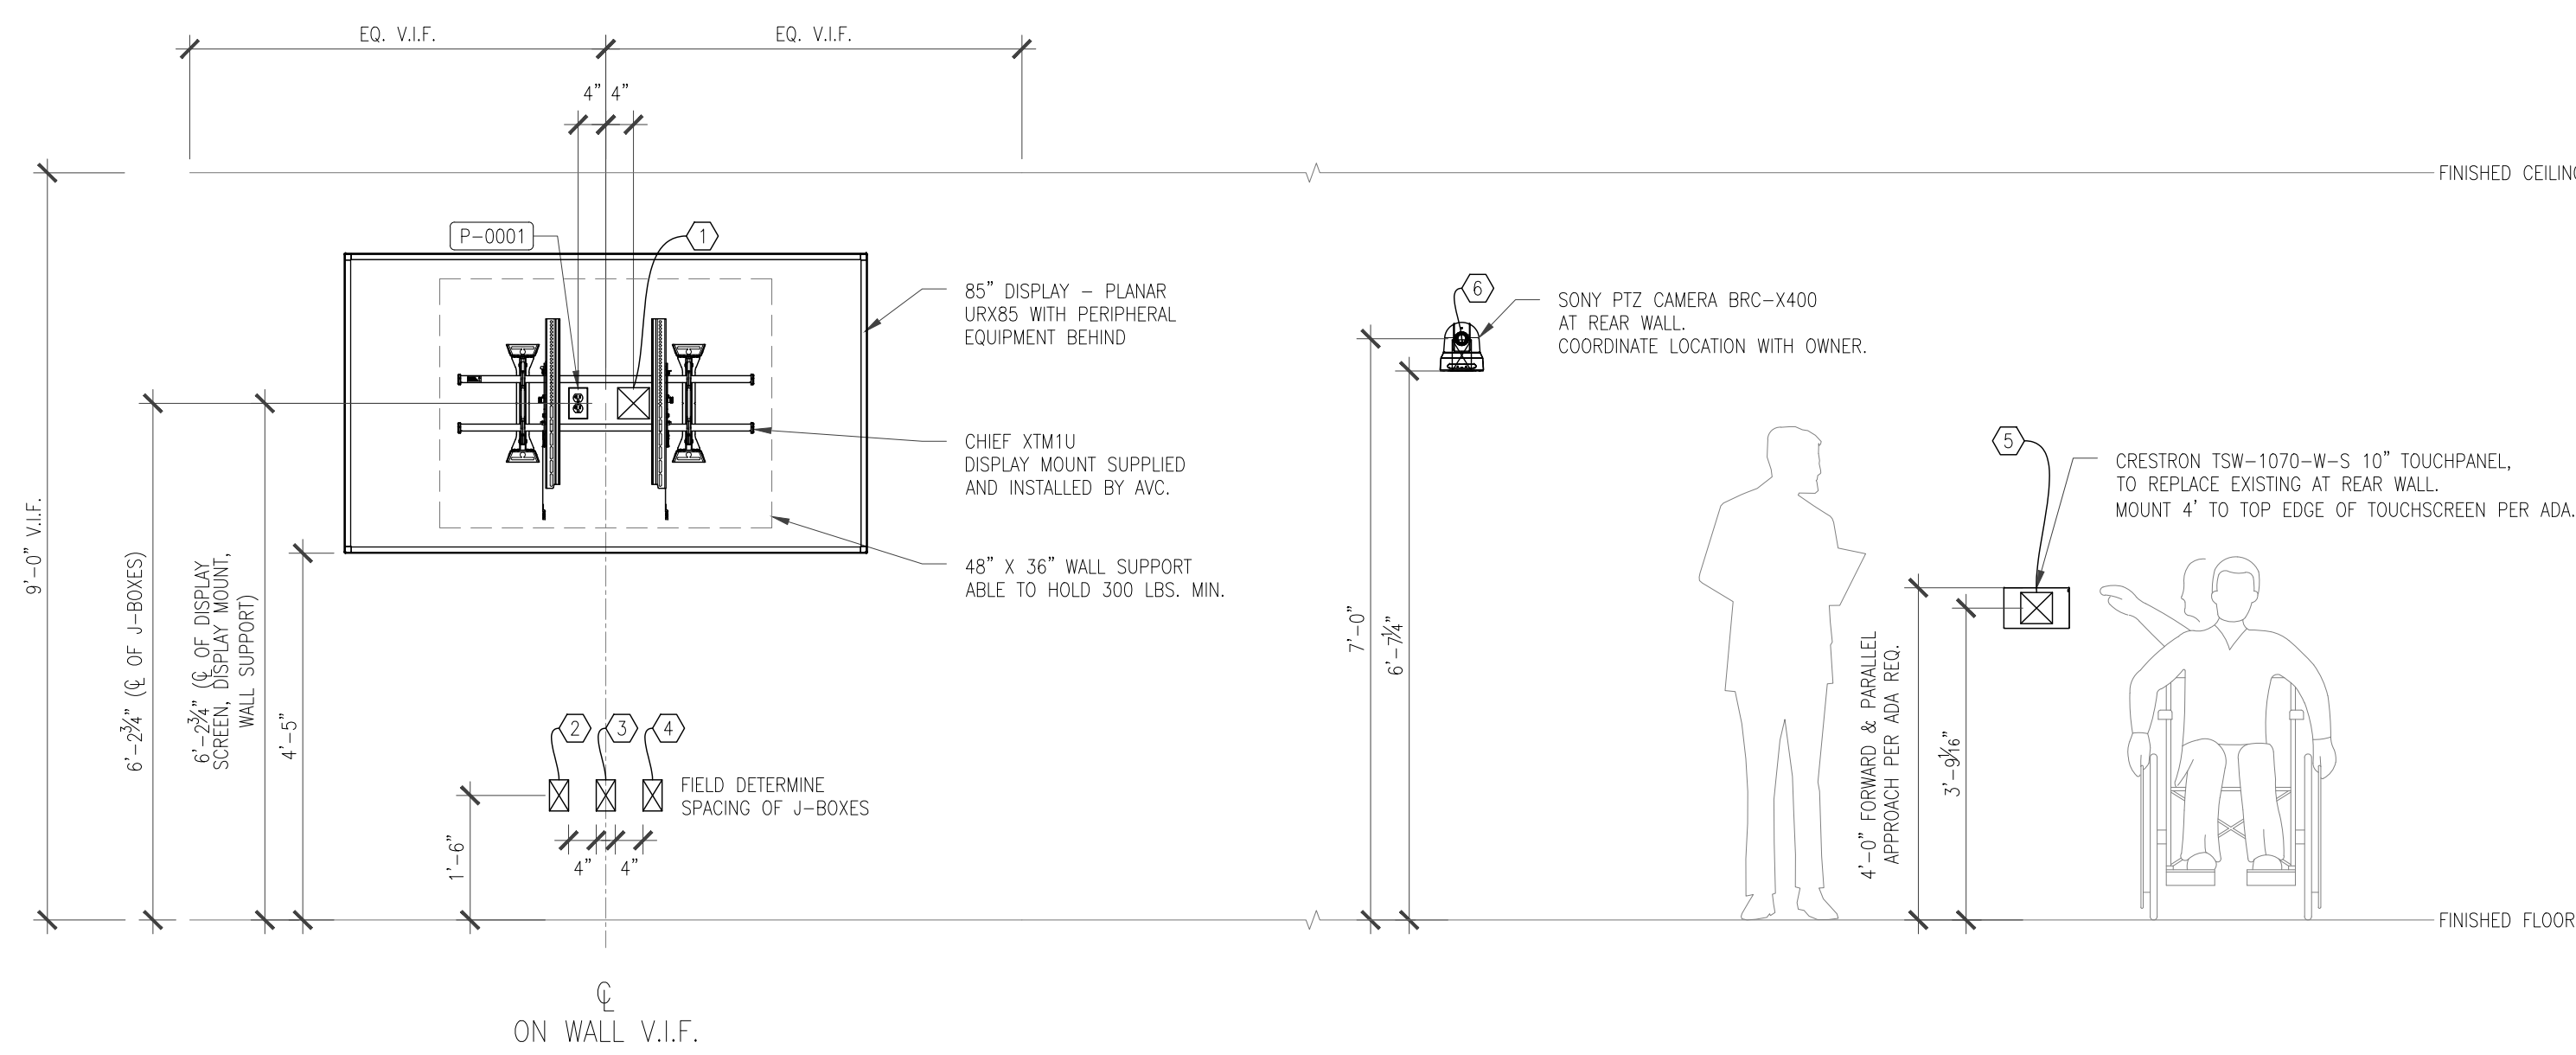

C CLASSROOM 1B, 2B, 3B - AV EQUIPMENT ELEVATION
SCALE: 1/2" = 1'-0"

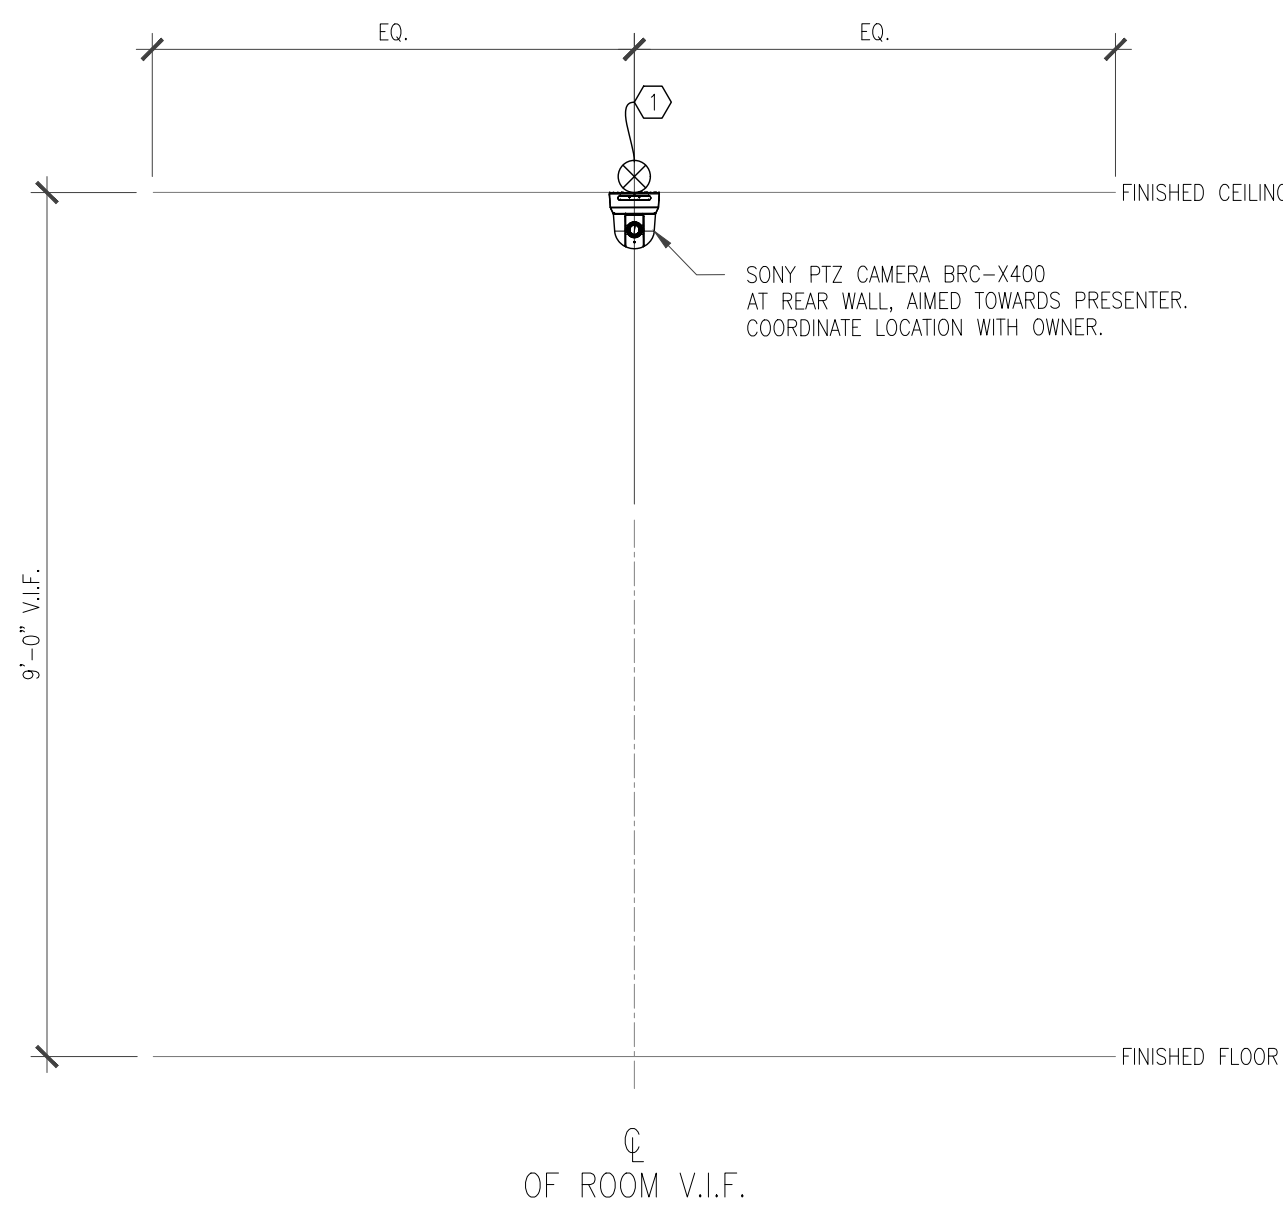


D EDUCATION BLDG RM 1-6 - AV EQUIPMENT ELEVATION
SCALE: 1/2" = 1'-0" - TYP OF 6 PLACES

- INFRASTRUCTURE NOTES:
- PROVIDE 1 - SINGLE GANG J-BOX OR CUT-IN RING FOR PTZ CAMERA, FLUSH IN CEILING WITH PULL STRINGS, HEIGHT PER ELEVATION.

NOTE: POWER REQUIREMENTS ARE FOR REFERENCE ONLY. OWNER AND CONTRACTOR SHALL PERFORM ALL WORK IN CONFORMANCE WITH APPLICABLE BUILDING CODES, REGULATORY ORDINANCES, UTILITY PROVIDED REQUIREMENTS, AND SIMILAR STANDARDS.


AV POWER SCHEDULE				
ID NO	EQUIPMENT DESCRIPTION	CIRCUIT	VOLTAGE CAPACITY	RECEPTACLE TYPE
1P-0001	DISPLAY POWER	1	120V, 20 AMP	2-POLE 4-POLE TERMINATE

- INFRASTRUCTURE NOTES:
- PROVIDE 1 - 2-GANG J-BOX OR CUT-IN RING FOR BNC WALL PLATES, FLUSH IN WALL WITH PULL STRINGS TO ACC. CEILING HEIGHT PER ELEVATION.
 - PROVIDE 1 - SINGLE GANG J-BOX OR CUT-IN RING FOR AUDIO INPUT WALL PLATES, FLUSH IN WALL WITH PULL STRINGS TO ACC. CEILING HEIGHT PER ELEVATION.
 - PROVIDE 1 - SINGLE GANG J-BOX OR CUT-IN RING FOR DM WALL PLATE, FLUSH IN WALL WITH PULL STRINGS TO ACC. CEILING HEIGHT PER ELEVATION.
 - PROVIDE 1 - SINGLE GANG J-BOX OR CUT-IN RING FOR VIDEO INPUT WALL PLATES, FLUSH IN WALL WITH PULL STRINGS TO ACC. CEILING HEIGHT PER ELEVATION.
 - PROVIDE 1 - 2-GANG J-BOX OR CUT-IN RING FOR TOUCHSCREEN PANEL, FLUSH IN WALL WITH PULL STRINGS TO ACC. CEILING HEIGHT PER ELEVATION.
 - PROVIDE 1 - SINGLE GANG J-BOX OR CUT-IN RING FOR PTZ CAMERA, FLUSH IN WALL WITH PULL STRINGS TO ACC. CEILING HEIGHT PER ELEVATION.

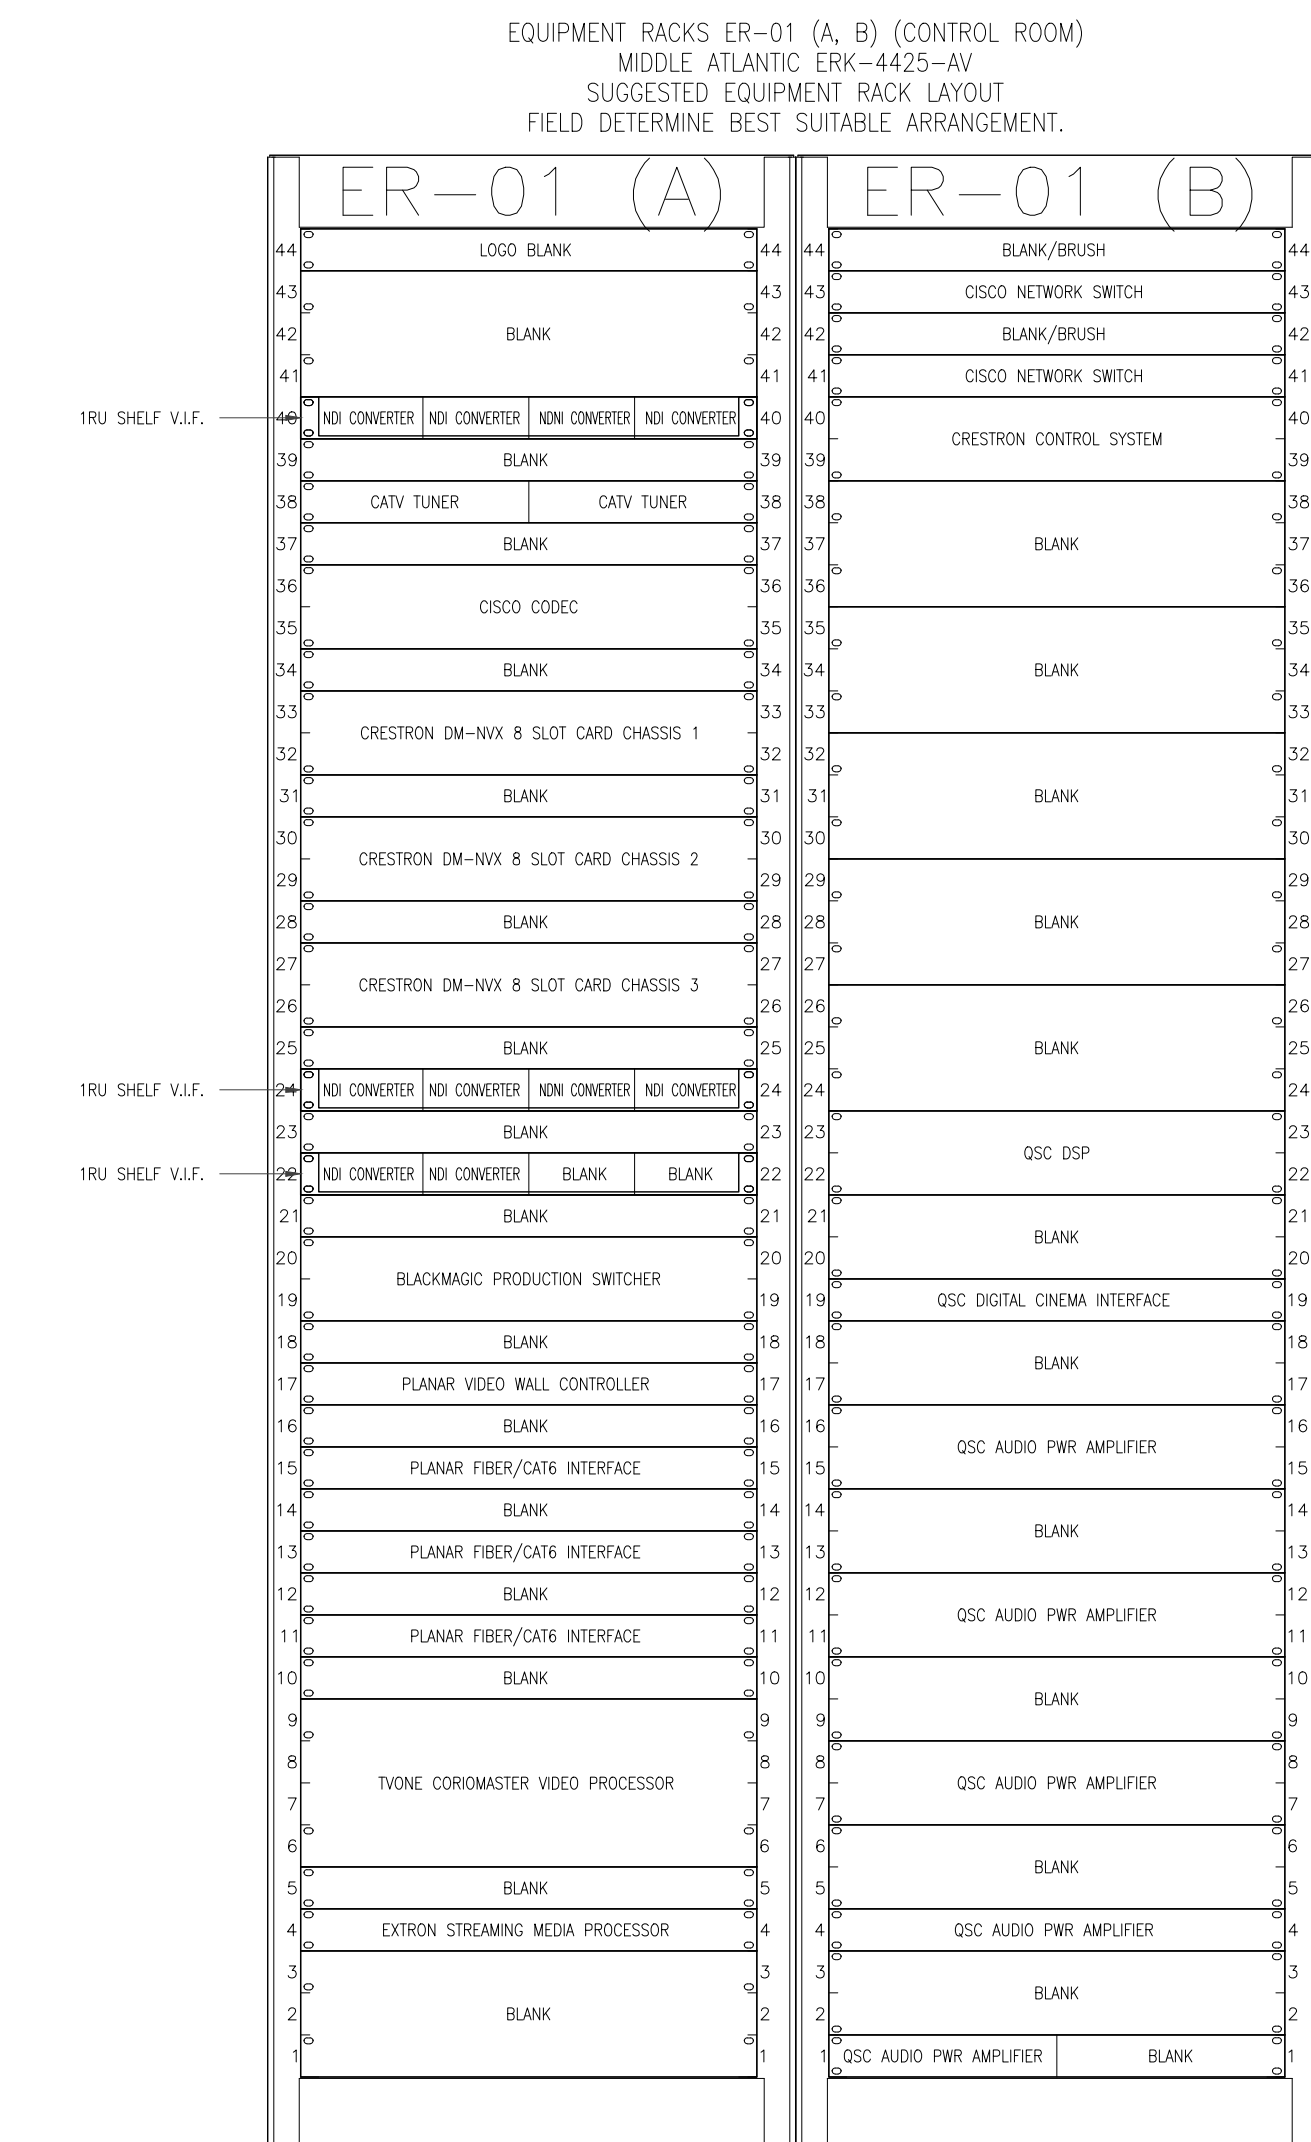

E CONTROL ROOM - AV EQUIPMENT RACKS ELEVATION
SCALE: 1-1/2" = 1'-0"

APPROVED FOR INSTALLATION

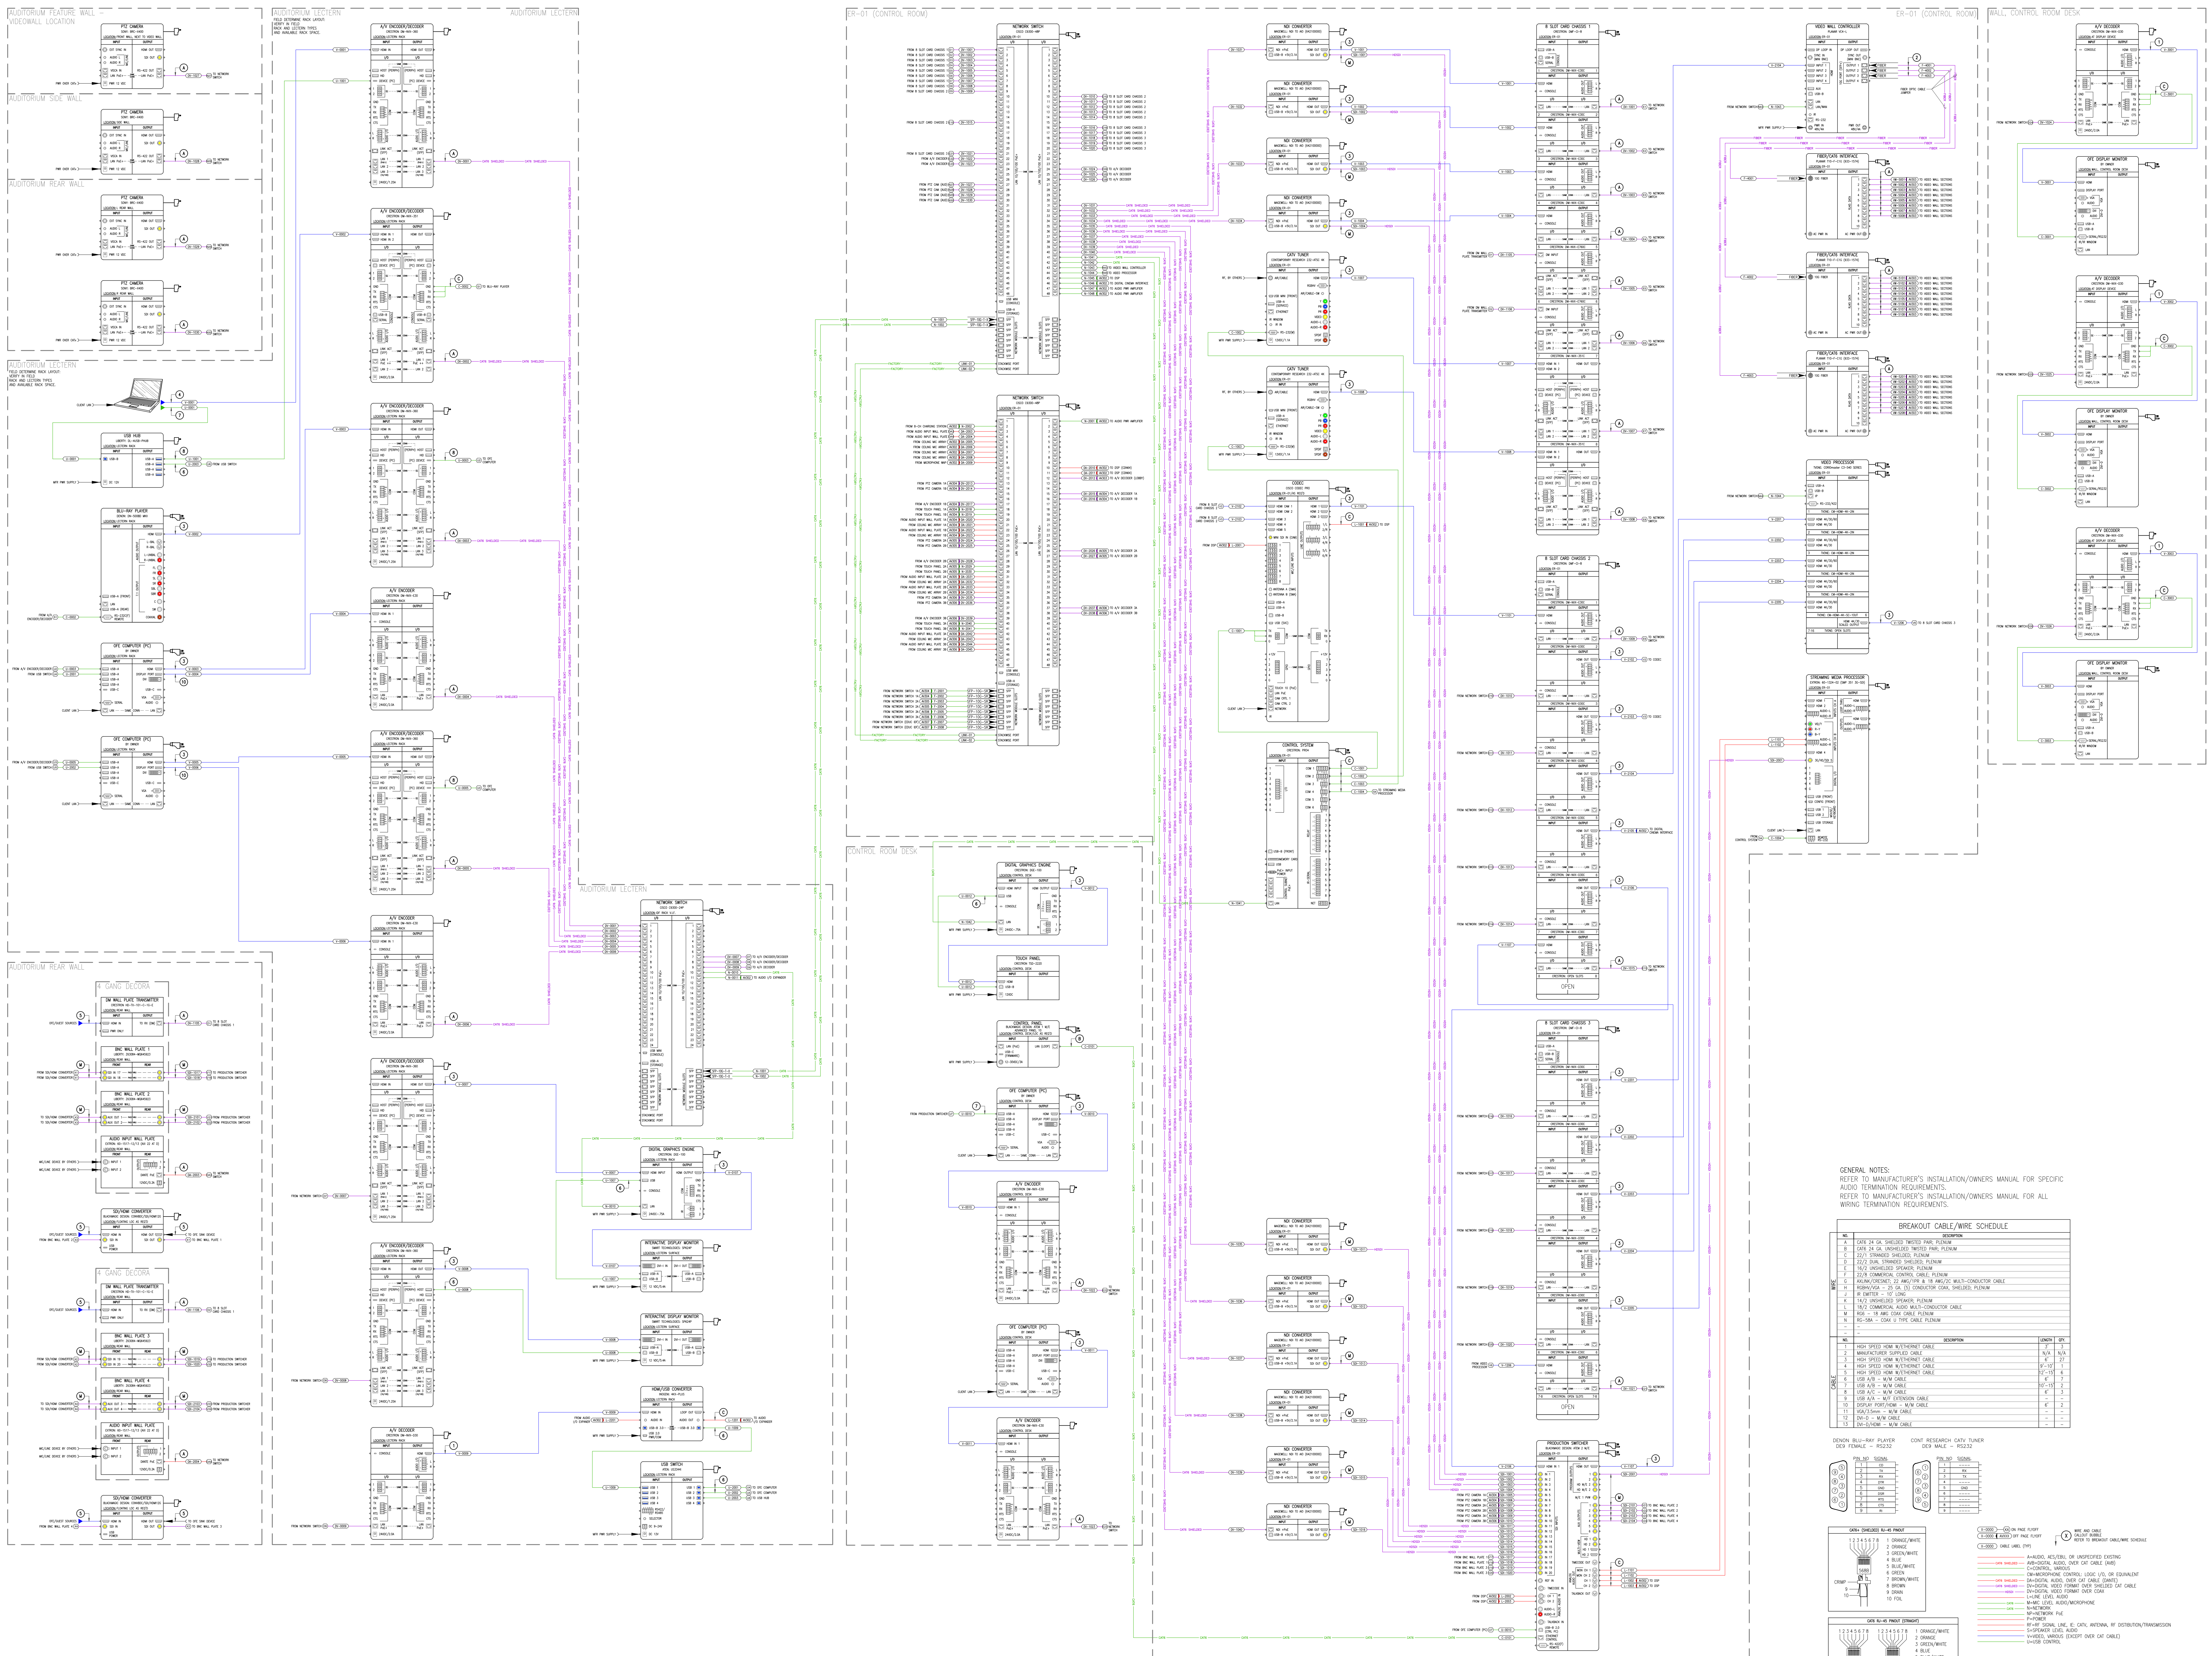

A VIDEO AND CONTROL SCHEMATIC - AUDITORIUM AND CONTROL ROOM
SCALE: NTS



U.S. Department of Veterans Affairs



World Wide Technology

Project Name: **US DEPARTMENT OF VETERANS AFFAIRS - AV/ITC SYSTEMS**
6800 N. PECOS ROAD

IB
NORCOM
Technology Solutions

0 11/13/20
1 11/13/20
2 11/13/20
3 11/13/20
4 11/13/20
5 11/13/20
6 11/13/20
7 11/13/20
8 11/13/20
9 11/13/20
10 11/13/20
11 11/13/20
12 11/13/20
13 11/13/20
14 11/13/20
15 11/13/20
16 11/13/20
17 11/13/20
18 11/13/20
19 11/13/20
20 11/13/20
21 11/13/20
22 11/13/20
23 11/13/20
24 11/13/20
25 11/13/20
26 11/13/20
27 11/13/20
28 11/13/20
29 11/13/20
30 11/13/20
31 11/13/20
32 11/13/20
33 11/13/20
34 11/13/20
35 11/13/20
36 11/13/20
37 11/13/20
38 11/13/20
39 11/13/20
40 11/13/20
41 11/13/20
42 11/13/20
43 11/13/20
44 11/13/20
45 11/13/20
46 11/13/20
47 11/13/20
48 11/13/20
49 11/13/20
50 11/13/20
51 11/13/20
52 11/13/20
53 11/13/20
54 11/13/20
55 11/13/20
56 11/13/20
57 11/13/20
58 11/13/20
59 11/13/20
60 11/13/20
61 11/13/20
62 11/13/20
63 11/13/20
64 11/13/20
65 11/13/20
66 11/13/20
67 11/13/20
68 11/13/20
69 11/13/20
70 11/13/20
71 11/13/20
72 11/13/20
73 11/13/20
74 11/13/20
75 11/13/20
76 11/13/20
77 11/13/20
78 11/13/20
79 11/13/20
80 11/13/20
81 11/13/20
82 11/13/20
83 11/13/20
84 11/13/20
85 11/13/20
86 11/13/20
87 11/13/20
88 11/13/20
89 11/13/20
90 11/13/20
91 11/13/20
92 11/13/20
93 11/13/20
94 11/13/20
95 11/13/20
96 11/13/20
97 11/13/20
98 11/13/20
99 11/13/20
100 11/13/20

NOTICE: ALL STRUCTURAL AND ELECTRICAL DRAWINGS AND NOTES ARE CONSIDERED CONFIDENTIAL AND NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. THE PERSON AND THE ASSOCIATED INFORMATION ON THIS DRAWING ARE THE PROPERTY OF AND COMPANIES. DO NOT DISCLOSE OR REPRODUCE THIS DRAWING WITHOUT THE WRITTEN PERMISSION OF NORCOM TECHNOLOGY SOLUTIONS.


NOTICE: THIS DRAWING CONTAINS CONFIDENTIAL AND PROPRIETARY DESIGN INFORMATION. THE PERSON AND THE ASSOCIATED INFORMATION ON THIS DRAWING ARE THE PROPERTY OF AND COMPANIES. DO NOT DISCLOSE OR REPRODUCE THIS DRAWING WITHOUT THE WRITTEN PERMISSION OF NORCOM TECHNOLOGY SOLUTIONS.

THIS DRAWING INDICATES YOUR AGREEMENT TO THESE TERMS.

APPROVED FOR INSTALLATION

SHEET TITLE: **SCHEMATIC 1**


AV301
CONSTRUCTION SET
11/13/20

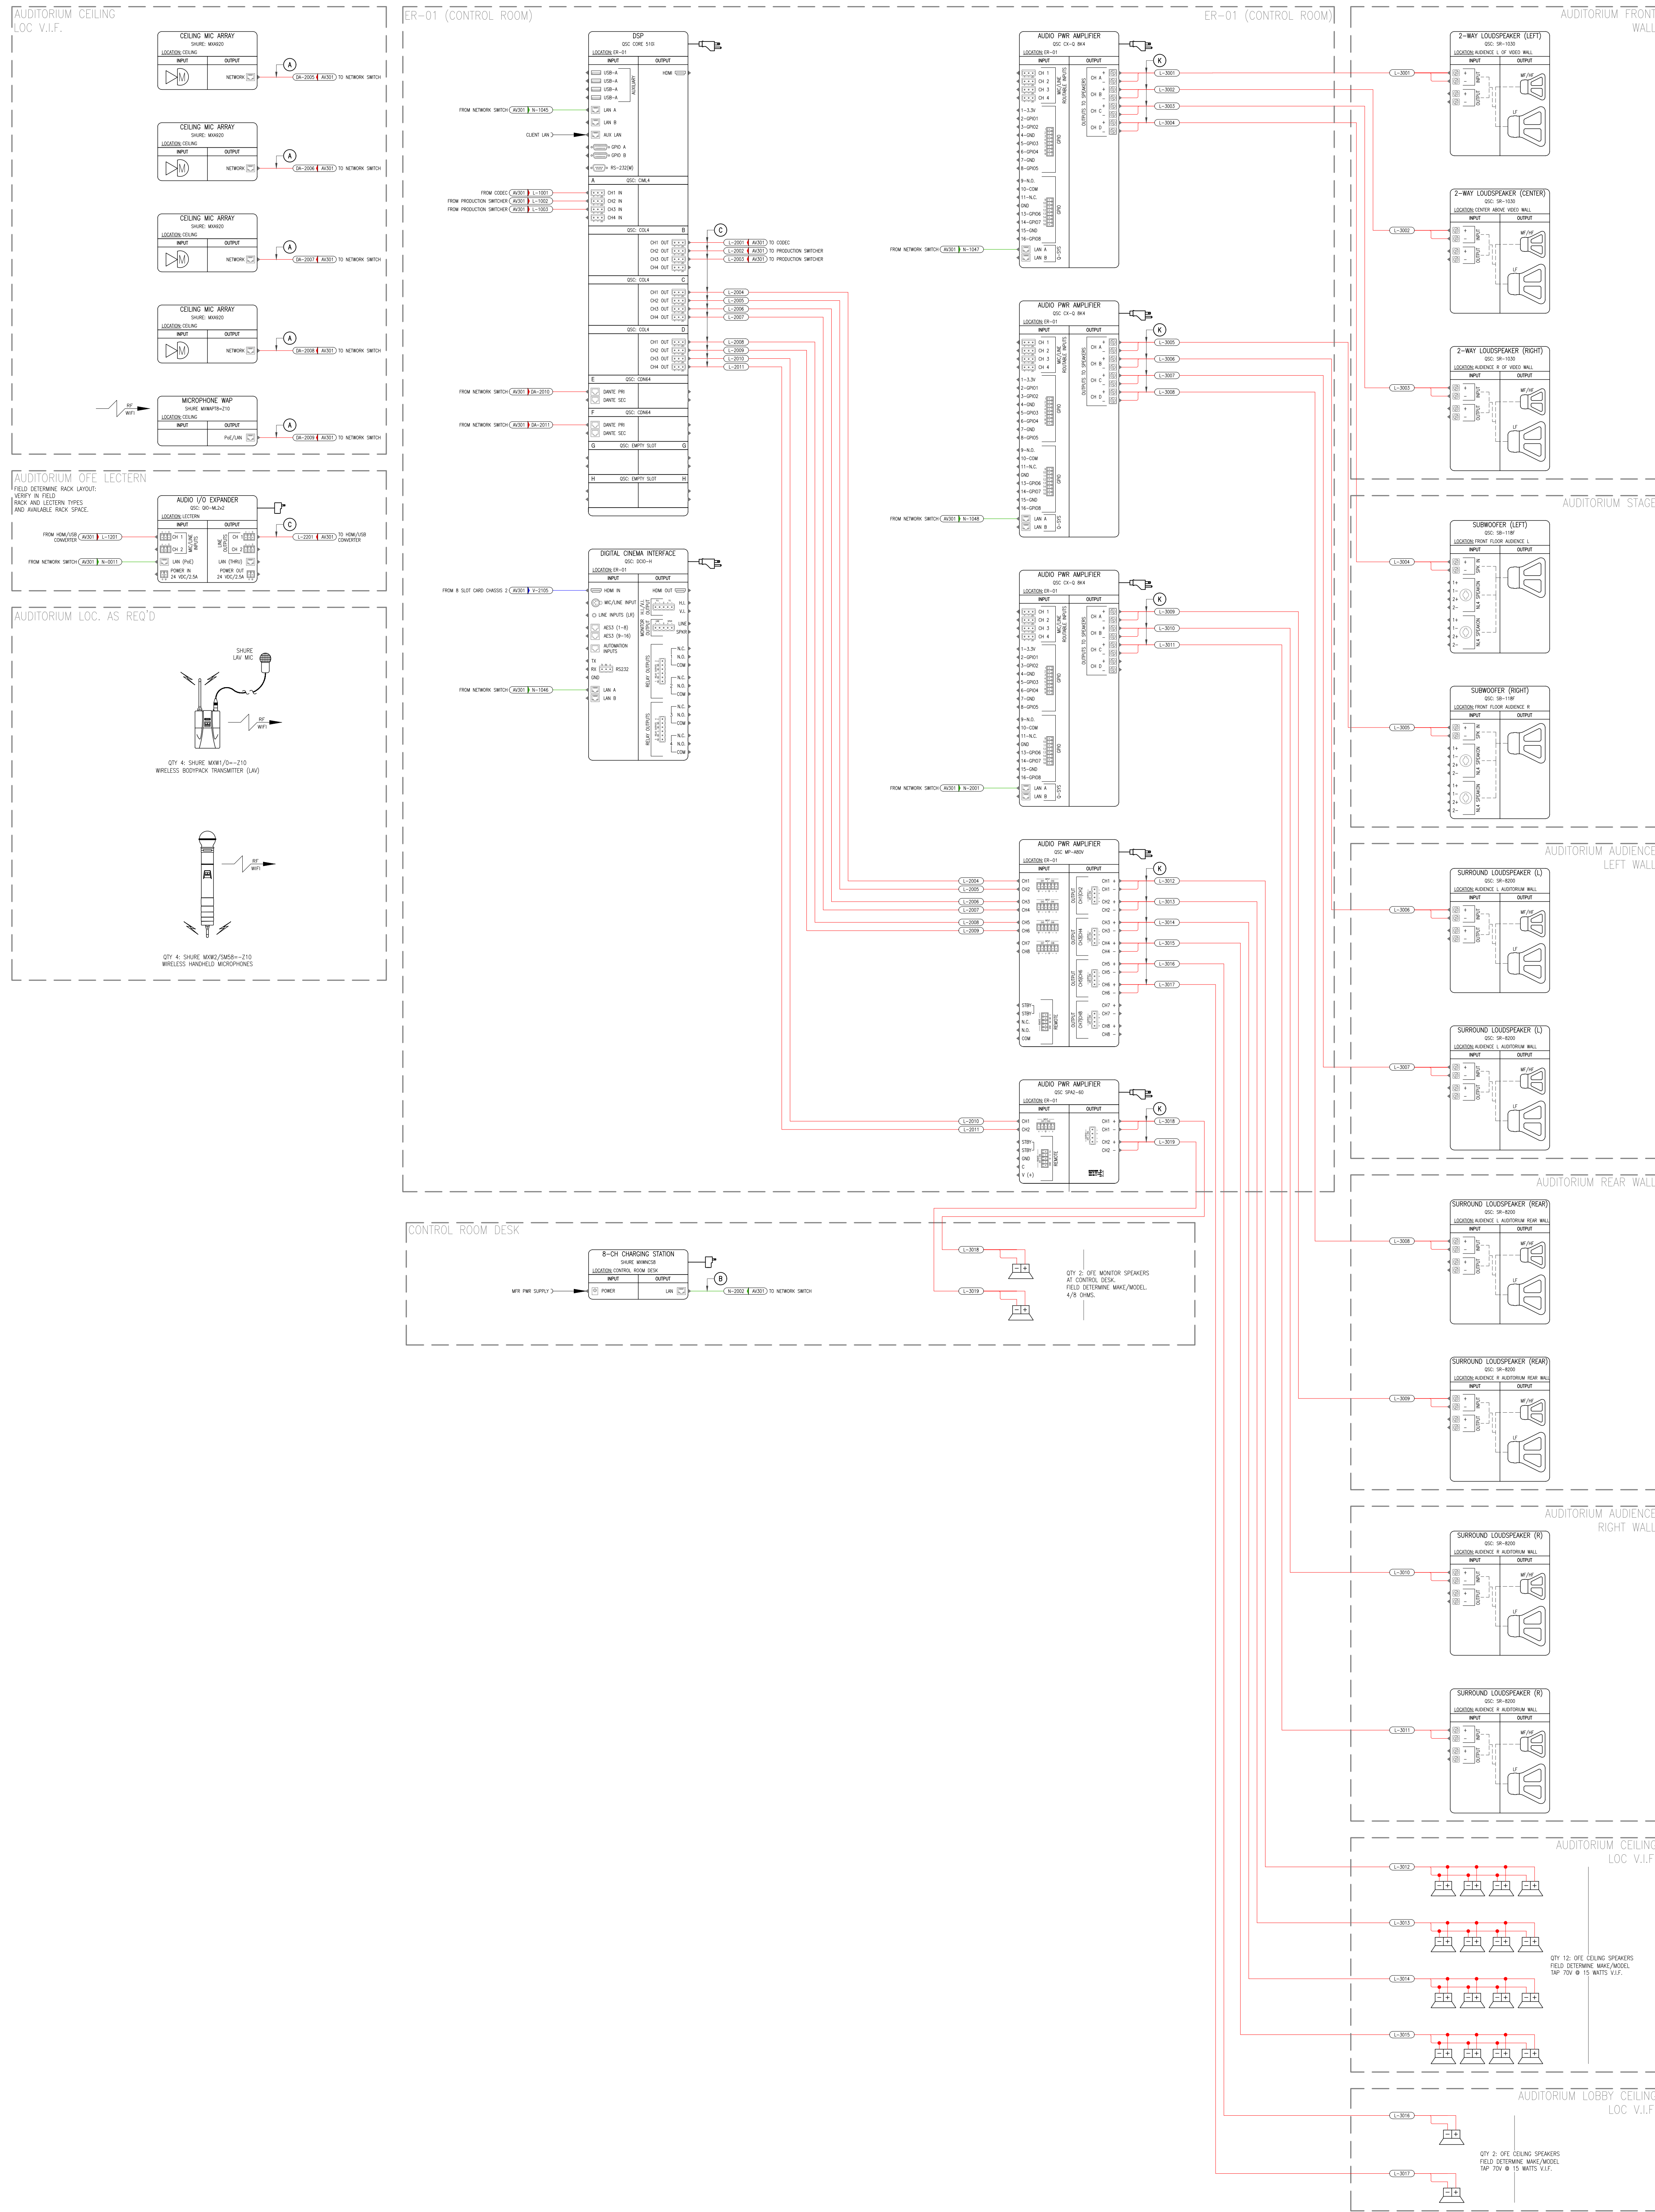

A AUDIO AND CONTROL SCHEMATIC - AUDITORIUM AND CONTROL ROOM
SCALE: NTS

GENERAL NOTES:
REFER TO MANUFACTURER'S INSTALLATION/OWNERS MANUAL FOR SPECIFIC
AUDIO TERMINATION REQUIREMENTS.
REFER TO MANUFACTURER'S INSTALLATION/OWNERS MANUAL FOR ALL
WIRING TERMINATION REQUIREMENTS.

BREAKOUT CABLE/WIRE SCHEDULE		
NO.	DESCRIPTION	QTY.
1	DATA 24 GA. SHIELDED TWISTED PAIR PLenum	1
2	DATA 24 GA. UNSHIELDED TWISTED PAIR PLenum	1
3	22/7 STAINLESS SHIELDED PLenum	1
4	22/22 SH. STAINLESS SHIELDED PLenum	1
5	1/2" SHIELDED SPEAKER PLenum	1
6	1/2" SH. STAINLESS SHIELDED PLenum	1
7	22/22 SH. STAINLESS SHIELDED PLenum	1
8	22/22 SH. STAINLESS SHIELDED PLenum	1
9	22/22 SH. STAINLESS SHIELDED PLenum	1
10	22/22 SH. STAINLESS SHIELDED PLenum	1
11	22/22 SH. STAINLESS SHIELDED PLenum	1
12	22/22 SH. STAINLESS SHIELDED PLenum	1
13	22/22 SH. STAINLESS SHIELDED PLenum	1
14	22/22 SH. STAINLESS SHIELDED PLenum	1
15	22/22 SH. STAINLESS SHIELDED PLenum	1
16	22/22 SH. STAINLESS SHIELDED PLenum	1
17	22/22 SH. STAINLESS SHIELDED PLenum	1
18	22/22 SH. STAINLESS SHIELDED PLenum	1
19	22/22 SH. STAINLESS SHIELDED PLenum	1
20	22/22 SH. STAINLESS SHIELDED PLenum	1
21	22/22 SH. STAINLESS SHIELDED PLenum	1
22	22/22 SH. STAINLESS SHIELDED PLenum	1
23	22/22 SH. STAINLESS SHIELDED PLenum	1
24	22/22 SH. STAINLESS SHIELDED PLenum	1
25	22/22 SH. STAINLESS SHIELDED PLenum	1
26	22/22 SH. STAINLESS SHIELDED PLenum	1
27	22/22 SH. STAINLESS SHIELDED PLenum	1
28	22/22 SH. STAINLESS SHIELDED PLenum	1
29	22/22 SH. STAINLESS SHIELDED PLenum	1
30	22/22 SH. STAINLESS SHIELDED PLenum	1
31	22/22 SH. STAINLESS SHIELDED PLenum	1
32	22/22 SH. STAINLESS SHIELDED PLenum	1
33	22/22 SH. STAINLESS SHIELDED PLenum	1
34	22/22 SH. STAINLESS SHIELDED PLenum	1
35	22/22 SH. STAINLESS SHIELDED PLenum	1
36	22/22 SH. STAINLESS SHIELDED PLenum	1
37	22/22 SH. STAINLESS SHIELDED PLenum	1
38	22/22 SH. STAINLESS SHIELDED PLenum	1
39	22/22 SH. STAINLESS SHIELDED PLenum	1
40	22/22 SH. STAINLESS SHIELDED PLenum	1
41	22/22 SH. STAINLESS SHIELDED PLenum	1
42	22/22 SH. STAINLESS SHIELDED PLenum	1
43	22/22 SH. STAINLESS SHIELDED PLenum	1
44	22/22 SH. STAINLESS SHIELDED PLenum	1
45	22/22 SH. STAINLESS SHIELDED PLenum	1
46	22/22 SH. STAINLESS SHIELDED PLenum	1
47	22/22 SH. STAINLESS SHIELDED PLenum	1
48	22/22 SH. STAINLESS SHIELDED PLenum	1
49	22/22 SH. STAINLESS SHIELDED PLenum	1
50	22/22 SH. STAINLESS SHIELDED PLenum	1
51	22/22 SH. STAINLESS SHIELDED PLenum	1
52	22/22 SH. STAINLESS SHIELDED PLenum	1
53	22/22 SH. STAINLESS SHIELDED PLenum	1
54	22/22 SH. STAINLESS SHIELDED PLenum	1
55	22/22 SH. STAINLESS SHIELDED PLenum	1
56	22/22 SH. STAINLESS SHIELDED PLenum	1
57	22/22 SH. STAINLESS SHIELDED PLenum	1
58	22/22 SH. STAINLESS SHIELDED PLenum	1
59	22/22 SH. STAINLESS SHIELDED PLenum	1
60	22/22 SH. STAINLESS SHIELDED PLenum	1
61	22/22 SH. STAINLESS SHIELDED PLenum	1
62	22/22 SH. STAINLESS SHIELDED PLenum	1
63	22/22 SH. STAINLESS SHIELDED PLenum	1
64	22/22 SH. STAINLESS SHIELDED PLenum	1
65	22/22 SH. STAINLESS SHIELDED PLenum	1
66	22/22 SH. STAINLESS SHIELDED PLenum	1
67	22/22 SH. STAINLESS SHIELDED PLenum	1
68	22/22 SH. STAINLESS SHIELDED PLenum	1
69	22/22 SH. STAINLESS SHIELDED PLenum	1
70	22/22 SH. STAINLESS SHIELDED PLenum	1
71	22/22 SH. STAINLESS SHIELDED PLenum	1
72	22/22 SH. STAINLESS SHIELDED PLenum	1
73	22/22 SH. STAINLESS SHIELDED PLenum	1
74	22/22 SH. STAINLESS SHIELDED PLenum	1
75	22/22 SH. STAINLESS SHIELDED PLenum	1
76	22/22 SH. STAINLESS SHIELDED PLenum	1
77	22/22 SH. STAINLESS SHIELDED PLenum	1
78	22/22 SH. STAINLESS SHIELDED PLenum	1
79	22/22 SH. STAINLESS SHIELDED PLenum	1
80	22/22 SH. STAINLESS SHIELDED PLenum	1
81	22/22 SH. STAINLESS SHIELDED PLenum	1
82	22/22 SH. STAINLESS SHIELDED PLenum	1
83	22/22 SH. STAINLESS SHIELDED PLenum	1
84	22/22 SH. STAINLESS SHIELDED PLenum	1
85	22/22 SH. STAINLESS SHIELDED PLenum	1
86	22/22 SH. STAINLESS SHIELDED PLenum	1
87	22/22 SH. STAINLESS SHIELDED PLenum	1
88	22/22 SH. STAINLESS SHIELDED PLenum	1
89	22/22 SH. STAINLESS SHIELDED PLenum	1
90	22/22 SH. STAINLESS SHIELDED PLenum	1
91	22/22 SH. STAINLESS SHIELDED PLenum	1
92	22/22 SH. STAINLESS SHIELDED PLenum	1
93	22/22 SH. STAINLESS SHIELDED PLenum	1
94	22/22 SH. STAINLESS SHIELDED PLenum	1
95	22/22 SH. STAINLESS SHIELDED PLenum	1
96	22/22 SH. STAINLESS SHIELDED PLenum	1
97	22/22 SH. STAINLESS SHIELDED PLenum	1
98	22/22 SH. STAINLESS SHIELDED PLenum	1
99	22/22 SH. STAINLESS SHIELDED PLenum	1
100	22/22 SH. STAINLESS SHIELDED PLenum	1

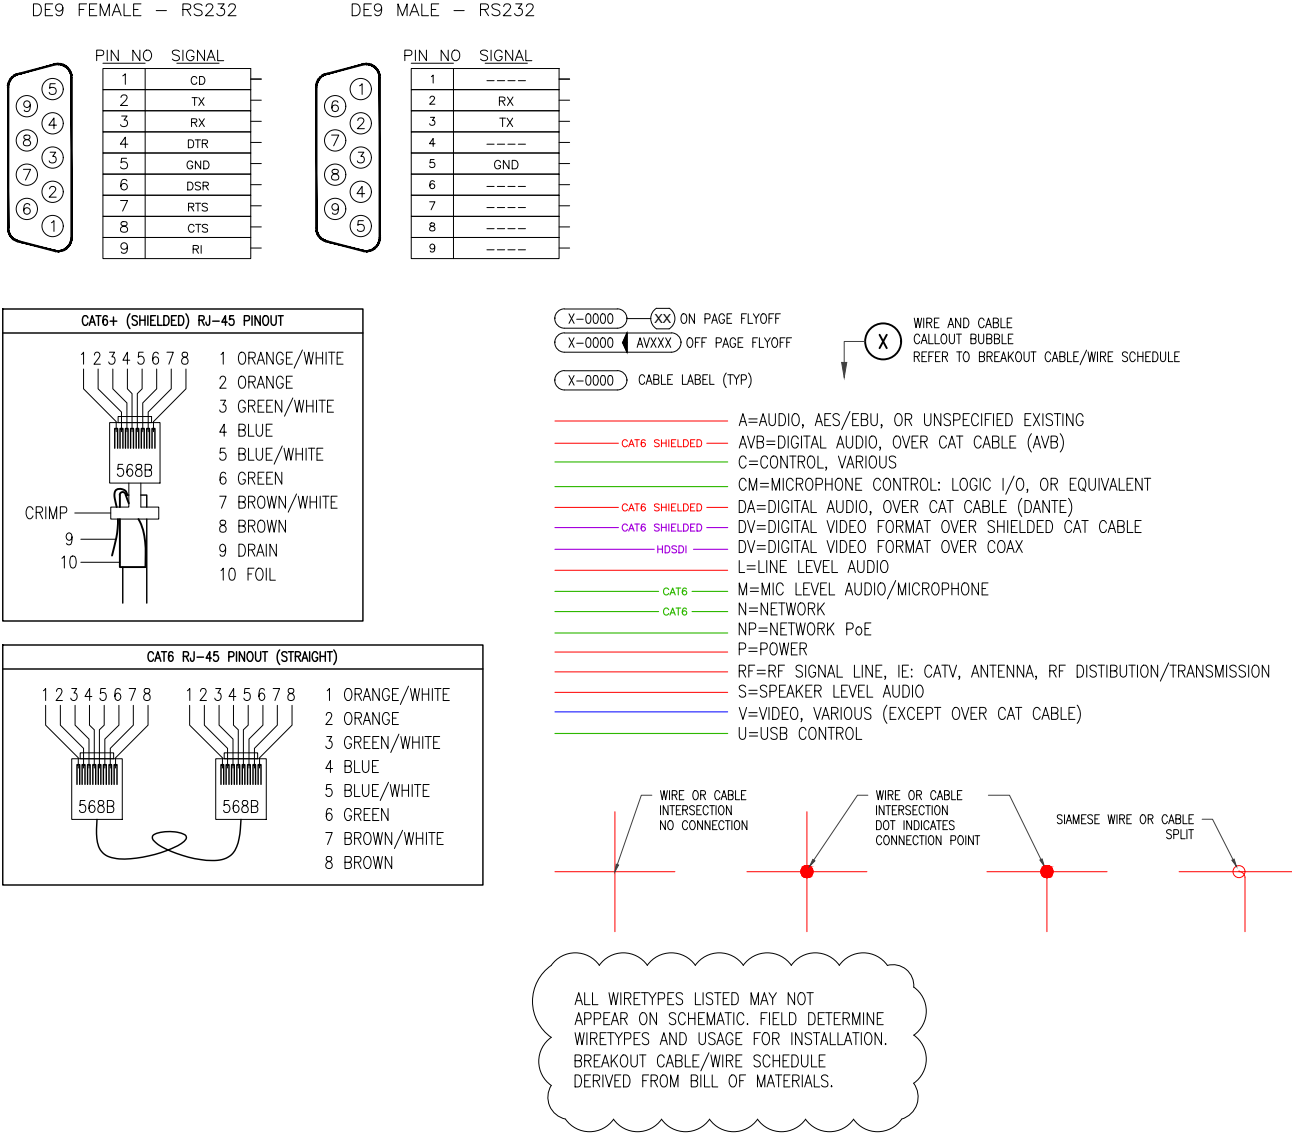

APPROVED FOR INSTALLATION

U.S. Department of Veterans Affairs

World Wide Technology

NORCOM Technology Solutions

Project Name

US DEPARTMENT OF VETERANS AFFAIRS - AV/VC SYSTEMS

8800 N. PECOS ROAD

NORTH LAS VEGAS, NV 89166

Project No.

AV302

Drawn By

CONSTRUCTION SET

Scale

11/13/23

Sheet No.

3293

Sheet Title

SCHEMATIC 2

Notes

1. INSTALLATION 11/13/23

Notes

2. DESCRIPTION 11/13/23

Notes

3. REVISIONS 11/13/23

Notes

4. REVISIONS 11/13/23

Notes

5. REVISIONS 11/13/23

Notes

6. REVISIONS 11/13/23

Notes

7. REVISIONS 11/13/23

Notes

8. REVISIONS 11/13/23

Notes

9. REVISIONS 11/13/23

Notes

10. REVISIONS 11/13/23

Notes

11. REVISIONS 11/13/23

Notes

12. REVISIONS 11/13/23

Notes

13. REVISIONS 11/13/23

Notes

14. REVISIONS 11/13/23

Notes

15. REVISIONS 11/13/23

Notes

16. REVISIONS 11/13/23

Notes

17. REVISIONS 11/13/23

Notes

18. REVISIONS 11/13/23

Notes

19. REVISIONS 11/13/23

Notes

20. REVISIONS 11/13/23

Notes

21. REVISIONS 11/13/23

Notes

22. REVISIONS 11/13/23

Notes

23. REVISIONS 11/13/23

Notes

24. REVISIONS 11/13/23

Notes

25. REVISIONS 11/13/23

Notes

26. REVISIONS 11/13/23

Notes

27. REVISIONS 11/13/23

Notes

28. REVISIONS 11/13/23

Notes

29. REVISIONS 11/13/23

Notes

30. REVISIONS 11/13/23

Notes

31. REVISIONS 11/13/23

Notes

32. REVISIONS 11/13/23

Notes

33. REVISIONS 11/13/23

Notes

34. REVISIONS 11/13/23

Notes

35. REVISIONS 11/13/23

Notes

36. REVISIONS 11/13/23

Notes

37. REVISIONS 11/13/23

Notes

38. REVISIONS 11/13/23

Notes

39. REVISIONS 11/13/23

Notes

40. REVISIONS 11/13/23

Notes

41. REVISIONS 11/13/23

Notes

42. REVISIONS 11/13/23

Notes

43. REVISIONS 11/13/23

Notes

44. REVISIONS 11/13/23

Notes

45. REVISIONS 11/13/23

Notes

46. REVISIONS 11/13/23

Notes

47. REVISIONS 11/13/23

Notes

48. REVISIONS 11/13/23

Notes

49. REVISIONS 11/13/23

Notes

50. REVISIONS 11/13/23

Notes

51. REVISIONS 11/13/23

Notes

52. REVISIONS 11/13/23

Notes

53. REVISIONS 11/13/23

Notes

54. REVISIONS 11/13/23

Notes

55. REVISIONS 11/13/23

Notes

56. REVISIONS 11/13/23

Notes

57. REVISIONS 11/13/23

Notes

58. REVISIONS 11/13/23

Notes

59. REVISIONS 11/13/23

Notes

60. REVISIONS 11/13/23

Notes

61. REVISIONS 11/13/23

Notes

62. REVISIONS 11/13/23

Notes

63. REVISIONS 11/13/23

Notes

64. REVISIONS 11/13/23

Notes

65. REVISIONS 11/13/23

Notes

66. REVISIONS 11/13/23

Notes

67. REVISIONS 11/13/23

Notes

68. REVISIONS 11/13/23

Notes

69. REVISIONS 11/13/23

Notes

70. REVISIONS 11/13/23

Notes

71. REVISIONS 11/13/23

Notes

72. REVISIONS 11/13/23

Notes

73. REVISIONS 11/13/23

Notes

74. REVISIONS 11/13/23

Notes

75. REVISIONS 11/13/23

Notes

76. REVISIONS 11/13/23

Notes

77. REVISIONS 11/13/23

Notes

78. REVISIONS 11/13/23

Notes

79. REVISIONS 11/13/23

Notes

80. REVISIONS 11/13/23

Notes

81. REVISIONS 11/13/23

Notes

82. REVISIONS 11/13/23

Notes

83. REVISIONS 11/13/23

Notes

84. REVISIONS 11/13/23

Notes

85. REVISIONS 11/13/23

Notes

86. REVISIONS 11/13/23

Notes

87. REVISIONS 11/13/23

Notes

88. REVISIONS 11/13/23

Notes

89. REVISIONS 11/13/23

Notes

90. REVISIONS 11/13/23

Notes

91. REVISIONS 11/13/23

Notes

92. REVISIONS 11/13/23

Notes

93. REVISIONS 11/13/23

Notes

94. REVISIONS 11/13/23

Notes

95. REVISIONS 11/13/23

Notes

96. REVISIONS 11/13/23

Notes

97. REVISIONS 11/13/23

Notes


98. REVISIONS 11/13/23

Notes

99. REVISIONS 11/13/23

Notes

100. REVISIONS 11/13/23






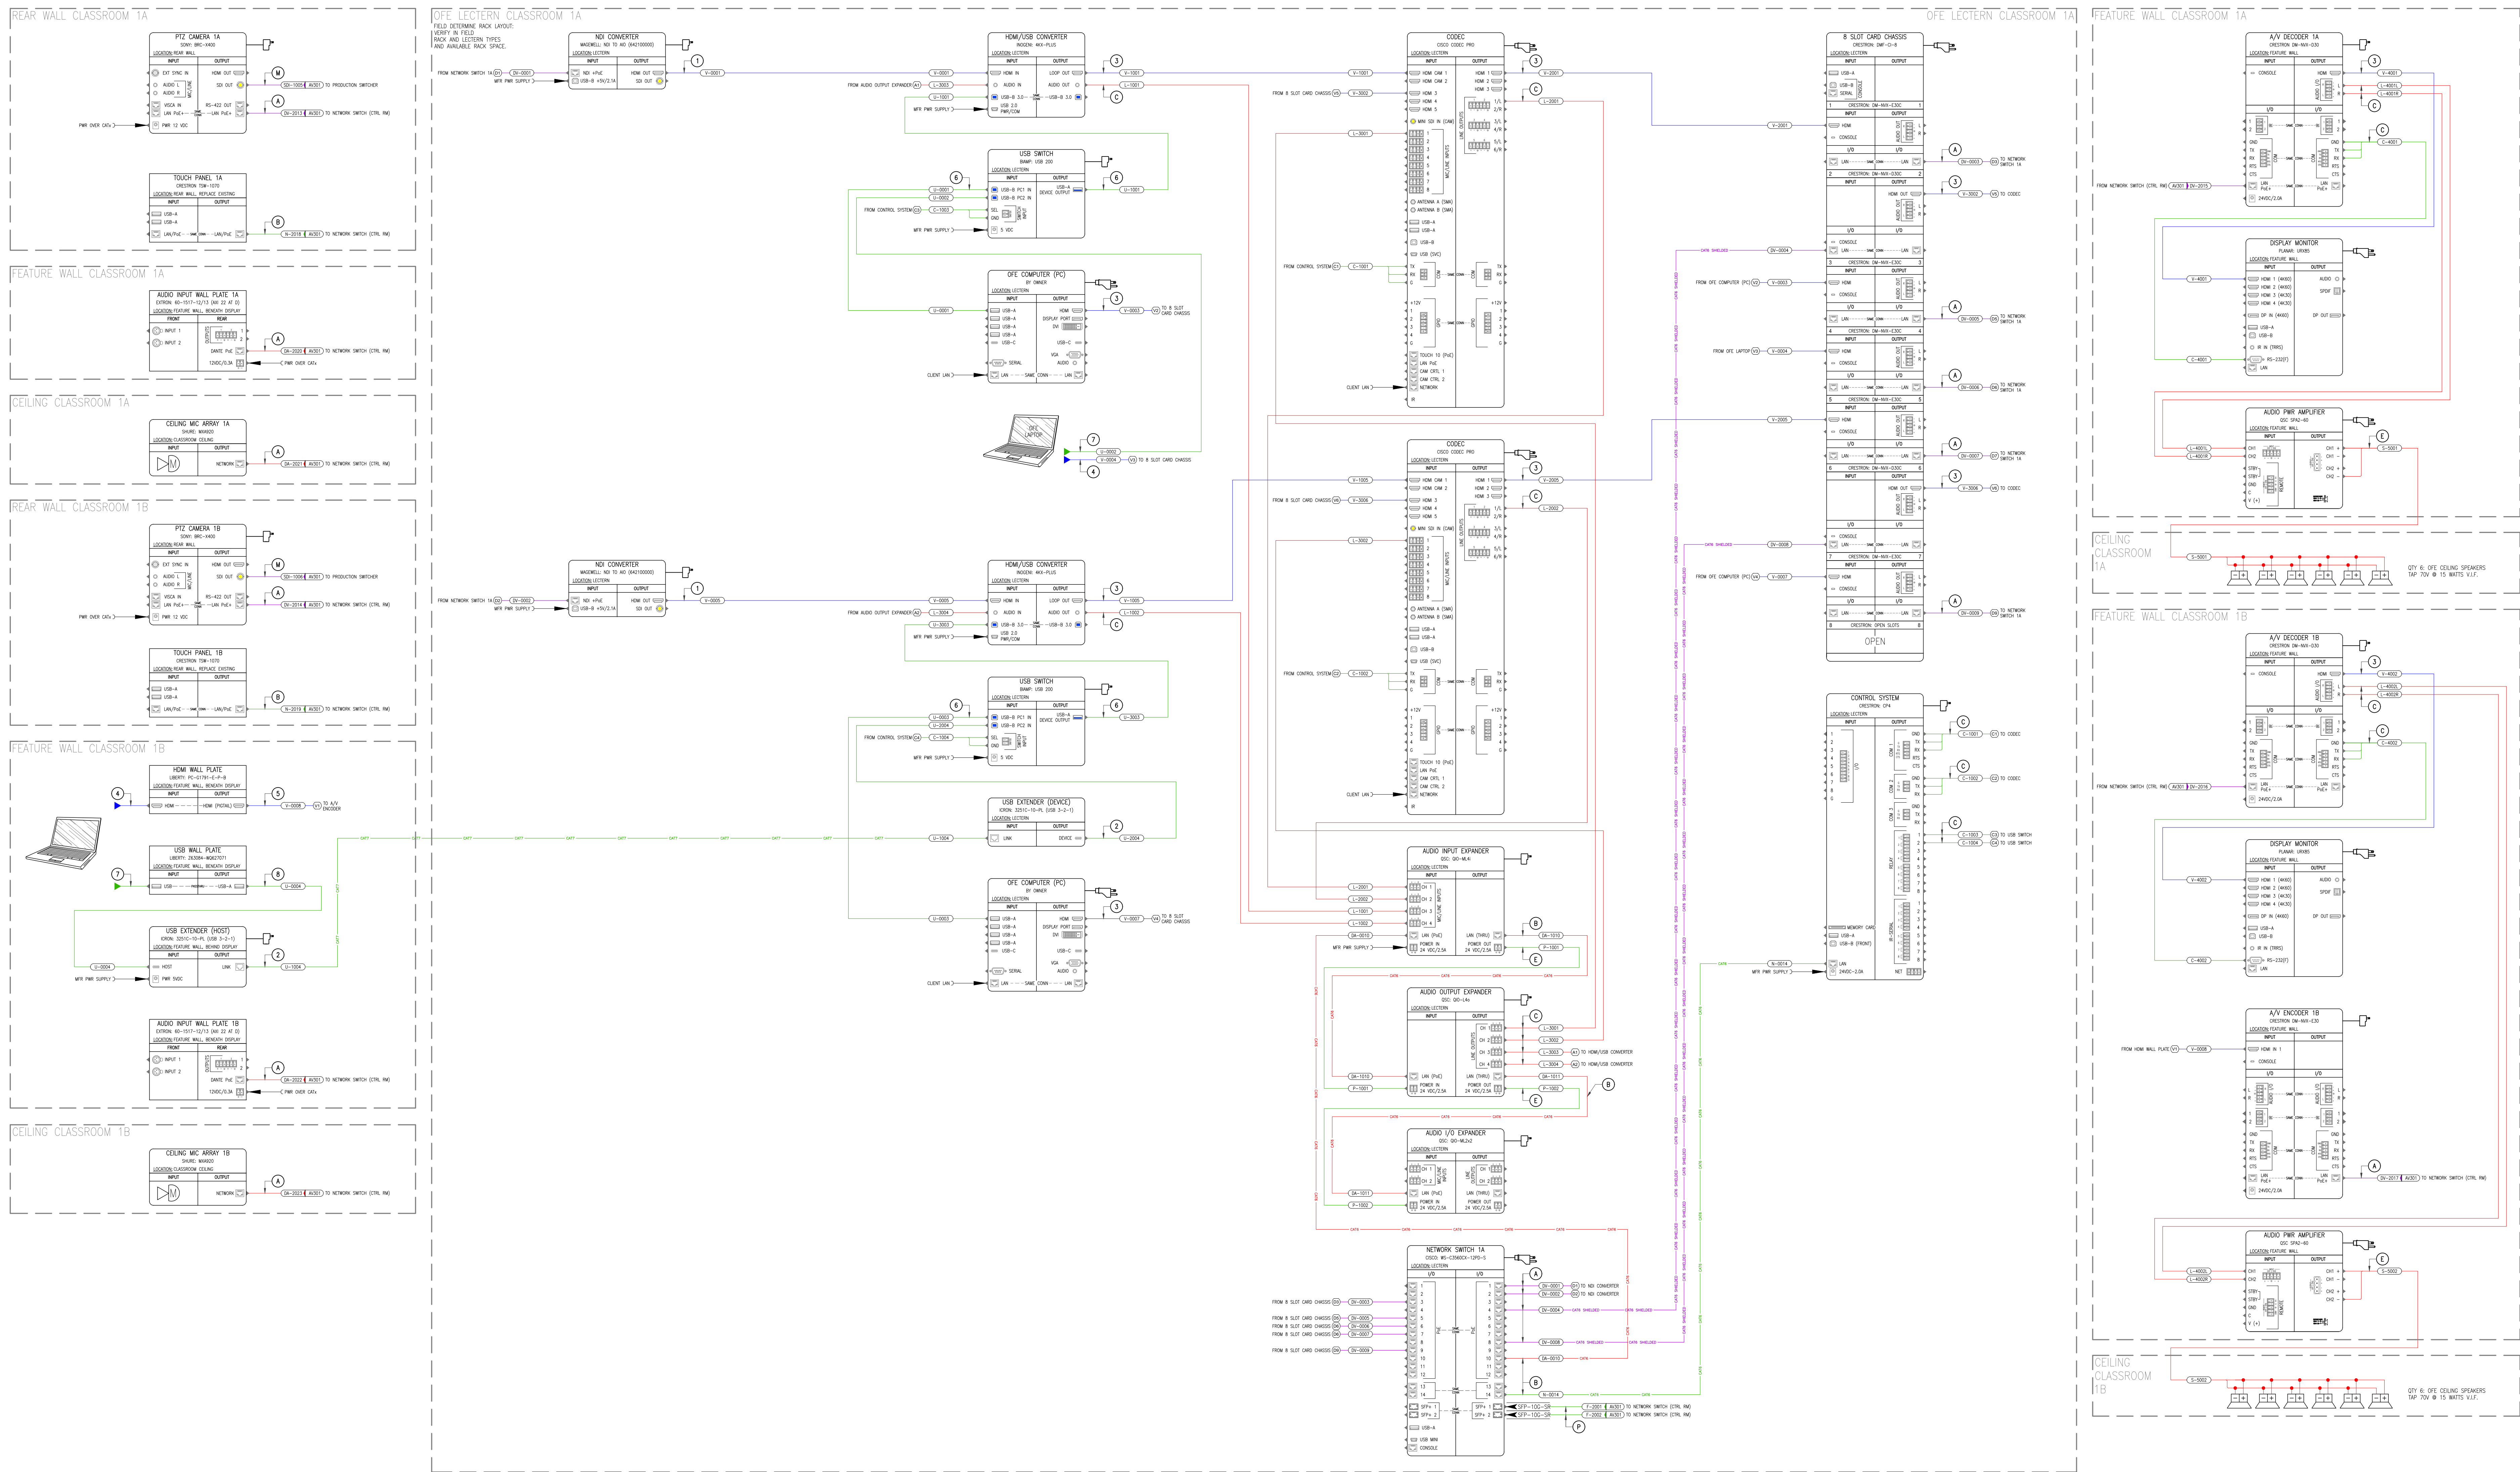


AV SCHEMATIC - CLASSROOM 1A, 1B
SCALE: NTS

GENERAL NOTES:
REFER TO MANUFACTURER'S INSTALLATION/OWNERS MANUAL FOR SPECIFIC
AUDIO TERMINATION REQUIREMENTS
REFER TO MANUFACTURER'S INSTALLATION/OWNERS MANUAL FOR ALL
WIRING TERMINATION REQUIREMENTS.

BREAKOUT CABLE/WIRE SCHEDULE			
NO.	DESCRIPTION	LENGTH	UNIT
1	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
2	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
3	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
4	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
5	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
6	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
7	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
8	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
9	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
10	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
11	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
12	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
13	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
14	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
15	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
16	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
17	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
18	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
19	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
20	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
21	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
22	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
23	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
24	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
25	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
26	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
27	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
28	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
29	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
30	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
31	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
32	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
33	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
34	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
35	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
36	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
37	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
38	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
39	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
40	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
41	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
42	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
43	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
44	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
45	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
46	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
47	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
48	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
49	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
50	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
51	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
52	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
53	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
54	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
55	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
56	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
57	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
58	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
59	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
60	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
61	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
62	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
63	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
64	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
65	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
66	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
67	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
68	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
69	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
70	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
71	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
72	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
73	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
74	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
75	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
76	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
77	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
78	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
79	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
80	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
81	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
82	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
83	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
84	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
85	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
86	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
87	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
88	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
89	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
90	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
91	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
92	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
93	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
94	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
95	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
96	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
97	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
98	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
99	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1
100	24 GA. SHIELDED TWISTED PAIR PLENUM	100'	1

PLATE	NO.	DESCRIPTION
1	1	AV WALL PLATE
2	2	AV WALL PLATE
3	3	AV WALL PLATE
4	4	AV WALL PLATE
5	5	AV WALL PLATE
6	6	AV WALL PLATE
7	7	AV WALL PLATE
8	8	AV WALL PLATE
9	9	AV WALL PLATE
10	10	AV WALL PLATE
11	11	AV WALL PLATE
12	12	AV WALL PLATE
13	13	AV WALL PLATE
14	14	AV WALL PLATE
15	15	AV WALL PLATE
16	16	AV WALL PLATE
17	17	AV WALL PLATE
18	18	AV WALL PLATE
19	19	AV WALL PLATE
20	20	AV WALL PLATE
21	21	AV WALL PLATE
22	22	AV WALL PLATE
23	23	AV WALL PLATE
24	24	AV WALL PLATE
25	25	AV WALL PLATE
26	26	AV WALL PLATE
27	27	AV WALL PLATE
28	28	AV WALL PLATE
29	29	AV WALL PLATE
30	30	AV WALL PLATE
31	31	AV WALL PLATE
32	32	AV WALL PLATE
33	33	AV WALL PLATE
34	34	AV WALL PLATE
35	35	AV WALL PLATE
36	36	AV WALL PLATE
37	37	AV WALL PLATE
38	38	AV WALL PLATE
39	39	AV WALL PLATE
40	40	AV WALL PLATE
41	41	AV WALL PLATE
42	42	AV WALL PLATE
43	43	AV WALL PLATE
44	44	AV WALL PLATE
45	45	AV WALL PLATE
46	46	AV WALL PLATE
47	47	AV WALL PLATE
48	48	AV WALL PLATE
49	49	AV WALL PLATE
50	50	AV WALL PLATE
51	51	AV WALL PLATE
52	52	AV WALL PLATE
53	53	AV WALL PLATE
54	54	AV WALL PLATE
55	55	AV WALL PLATE
56	56	AV WALL PLATE
57	57	AV WALL PLATE
58	58	AV WALL PLATE
59	59	AV WALL PLATE
60	60	AV WALL PLATE
61	61	AV WALL PLATE
62	62	AV WALL PLATE
63	63	AV WALL PLATE
64	64	AV WALL PLATE
65	65	AV WALL PLATE
66	66	AV WALL PLATE
67	67	AV WALL PLATE
68	68	AV WALL PLATE
69	69	AV WALL PLATE
70	70	AV WALL PLATE
71	71	AV WALL PLATE
72	72	AV WALL PLATE
73	73	AV WALL PLATE
74	74	AV WALL PLATE
75	75	AV WALL PLATE
76	76	AV WALL PLATE
77	77	AV WALL PLATE
78	78	AV WALL PLATE
79	79	AV WALL PLATE
80	80	AV WALL PLATE
81	81	AV WALL PLATE
82	82	AV WALL PLATE
83	83	AV WALL PLATE
84	84	AV WALL PLATE
85	85	AV WALL PLATE
86	86	AV WALL PLATE
87	87	AV WALL PLATE
88	88	AV WALL PLATE
89	89	AV WALL PLATE
90	90	AV WALL PLATE
91	91	AV WALL PLATE
92	92	AV WALL PLATE
93	93	AV WALL PLATE
94	94	AV WALL PLATE
95	95	AV WALL PLATE
96	96	AV WALL PLATE
97	97	AV WALL PLATE
98	98	AV WALL PLATE
99	99	AV WALL PLATE
100	100	AV WALL PLATE

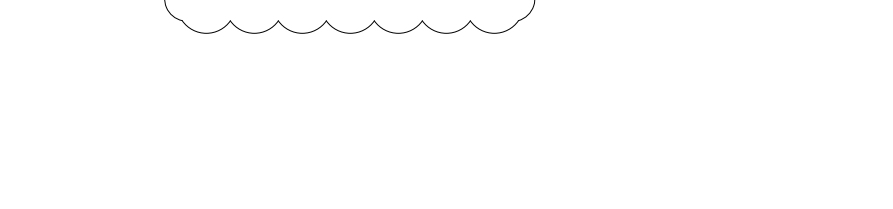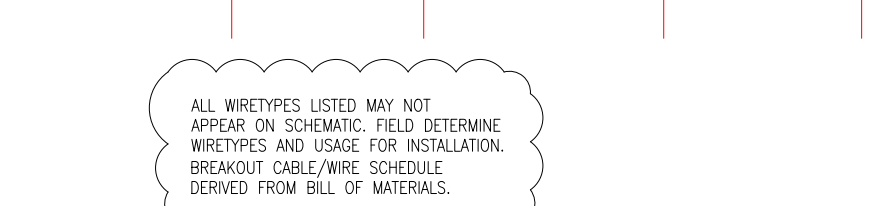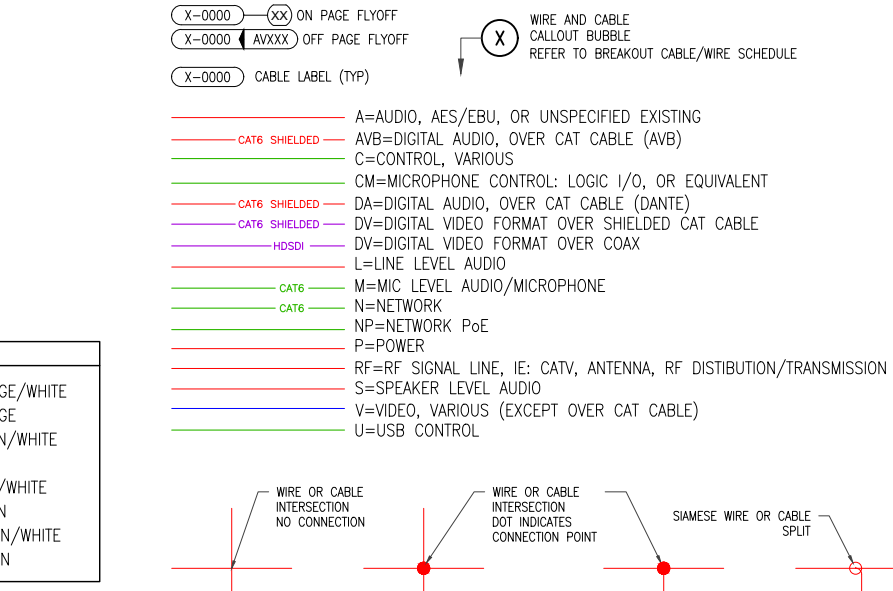
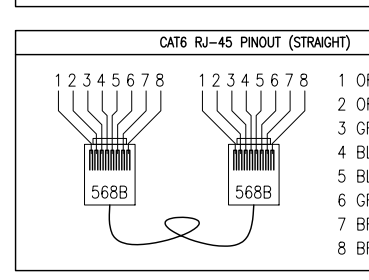
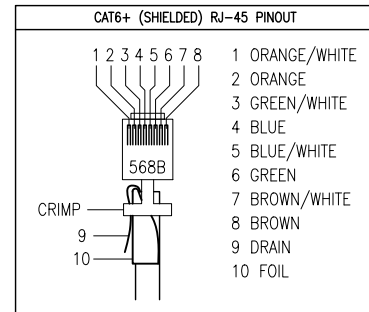




GENERAL NOTES:
REFER TO MANUFACTURER'S INSTALLATION/OWNERS MANUAL FOR SPECIFIC
AUDIO TERMINATION REQUIREMENTS.
REFER TO MANUFACTURER'S INSTALLATION/OWNERS MANUAL FOR ALL
WIRING TERMINATION REQUIREMENTS.

[illegible]PLANAR DISPLAY MONITOR
DIE FEMALE - RS232

PIN NO	SYMBOL
1	----
2	PS
3	FE
4	----
5	END
6	----
7	----
8	----





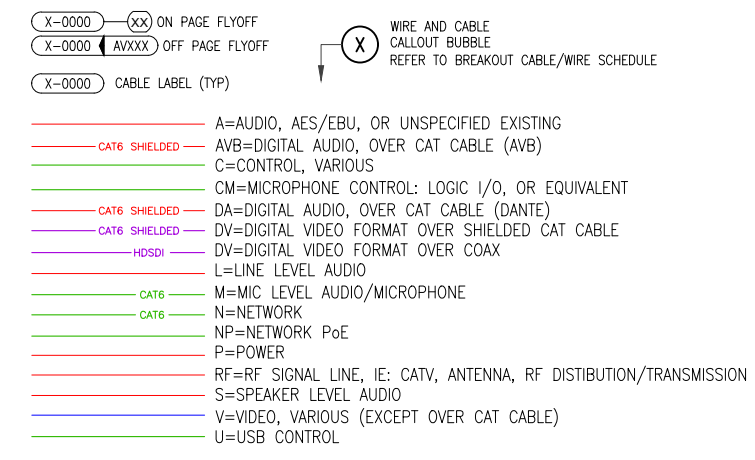
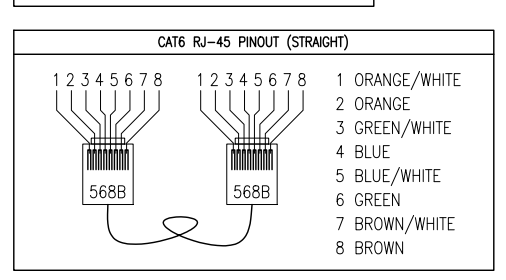
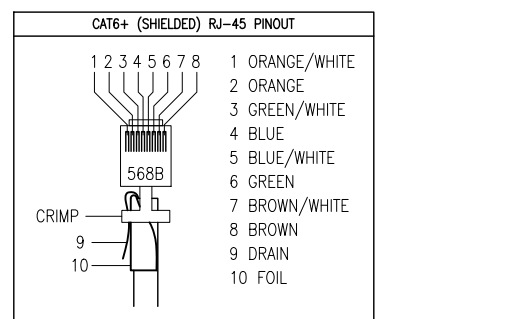


ALL WIRETYPES LISTED MAY NOT
APPEAR ON SCHEMATIC. FIELD DETERMINE
WIRETYPES AND USAGE FOR INSTALLATION.
BREAKOUT CABLE/WIRE SCHEDULE
DERIVED FROM BILL OF MATERIALS.

APPROVED FOR INSTALLATION





ALL WIRETYPES LISTED MAY NOT
APPEAR ON SCHEMATIC. FIELD DETERMINE
WIRETYPES AND USAGE FOR INSTALLATION.
BREAKOUT CABLE/WIRE SCHEDULE

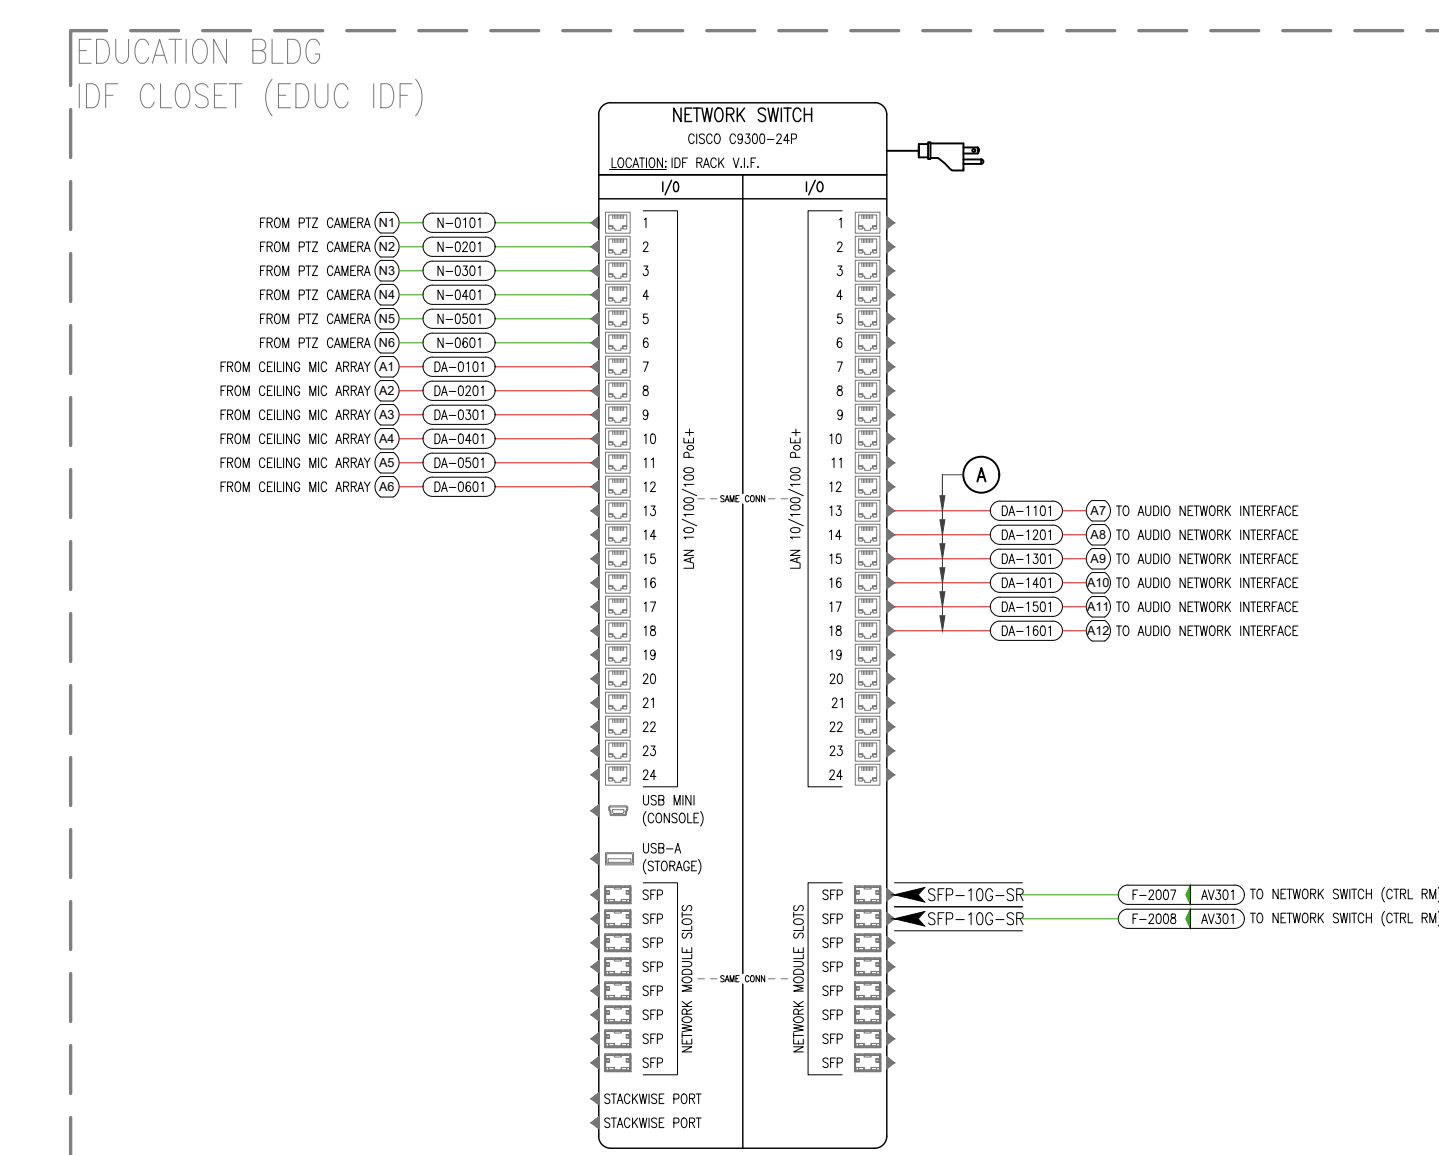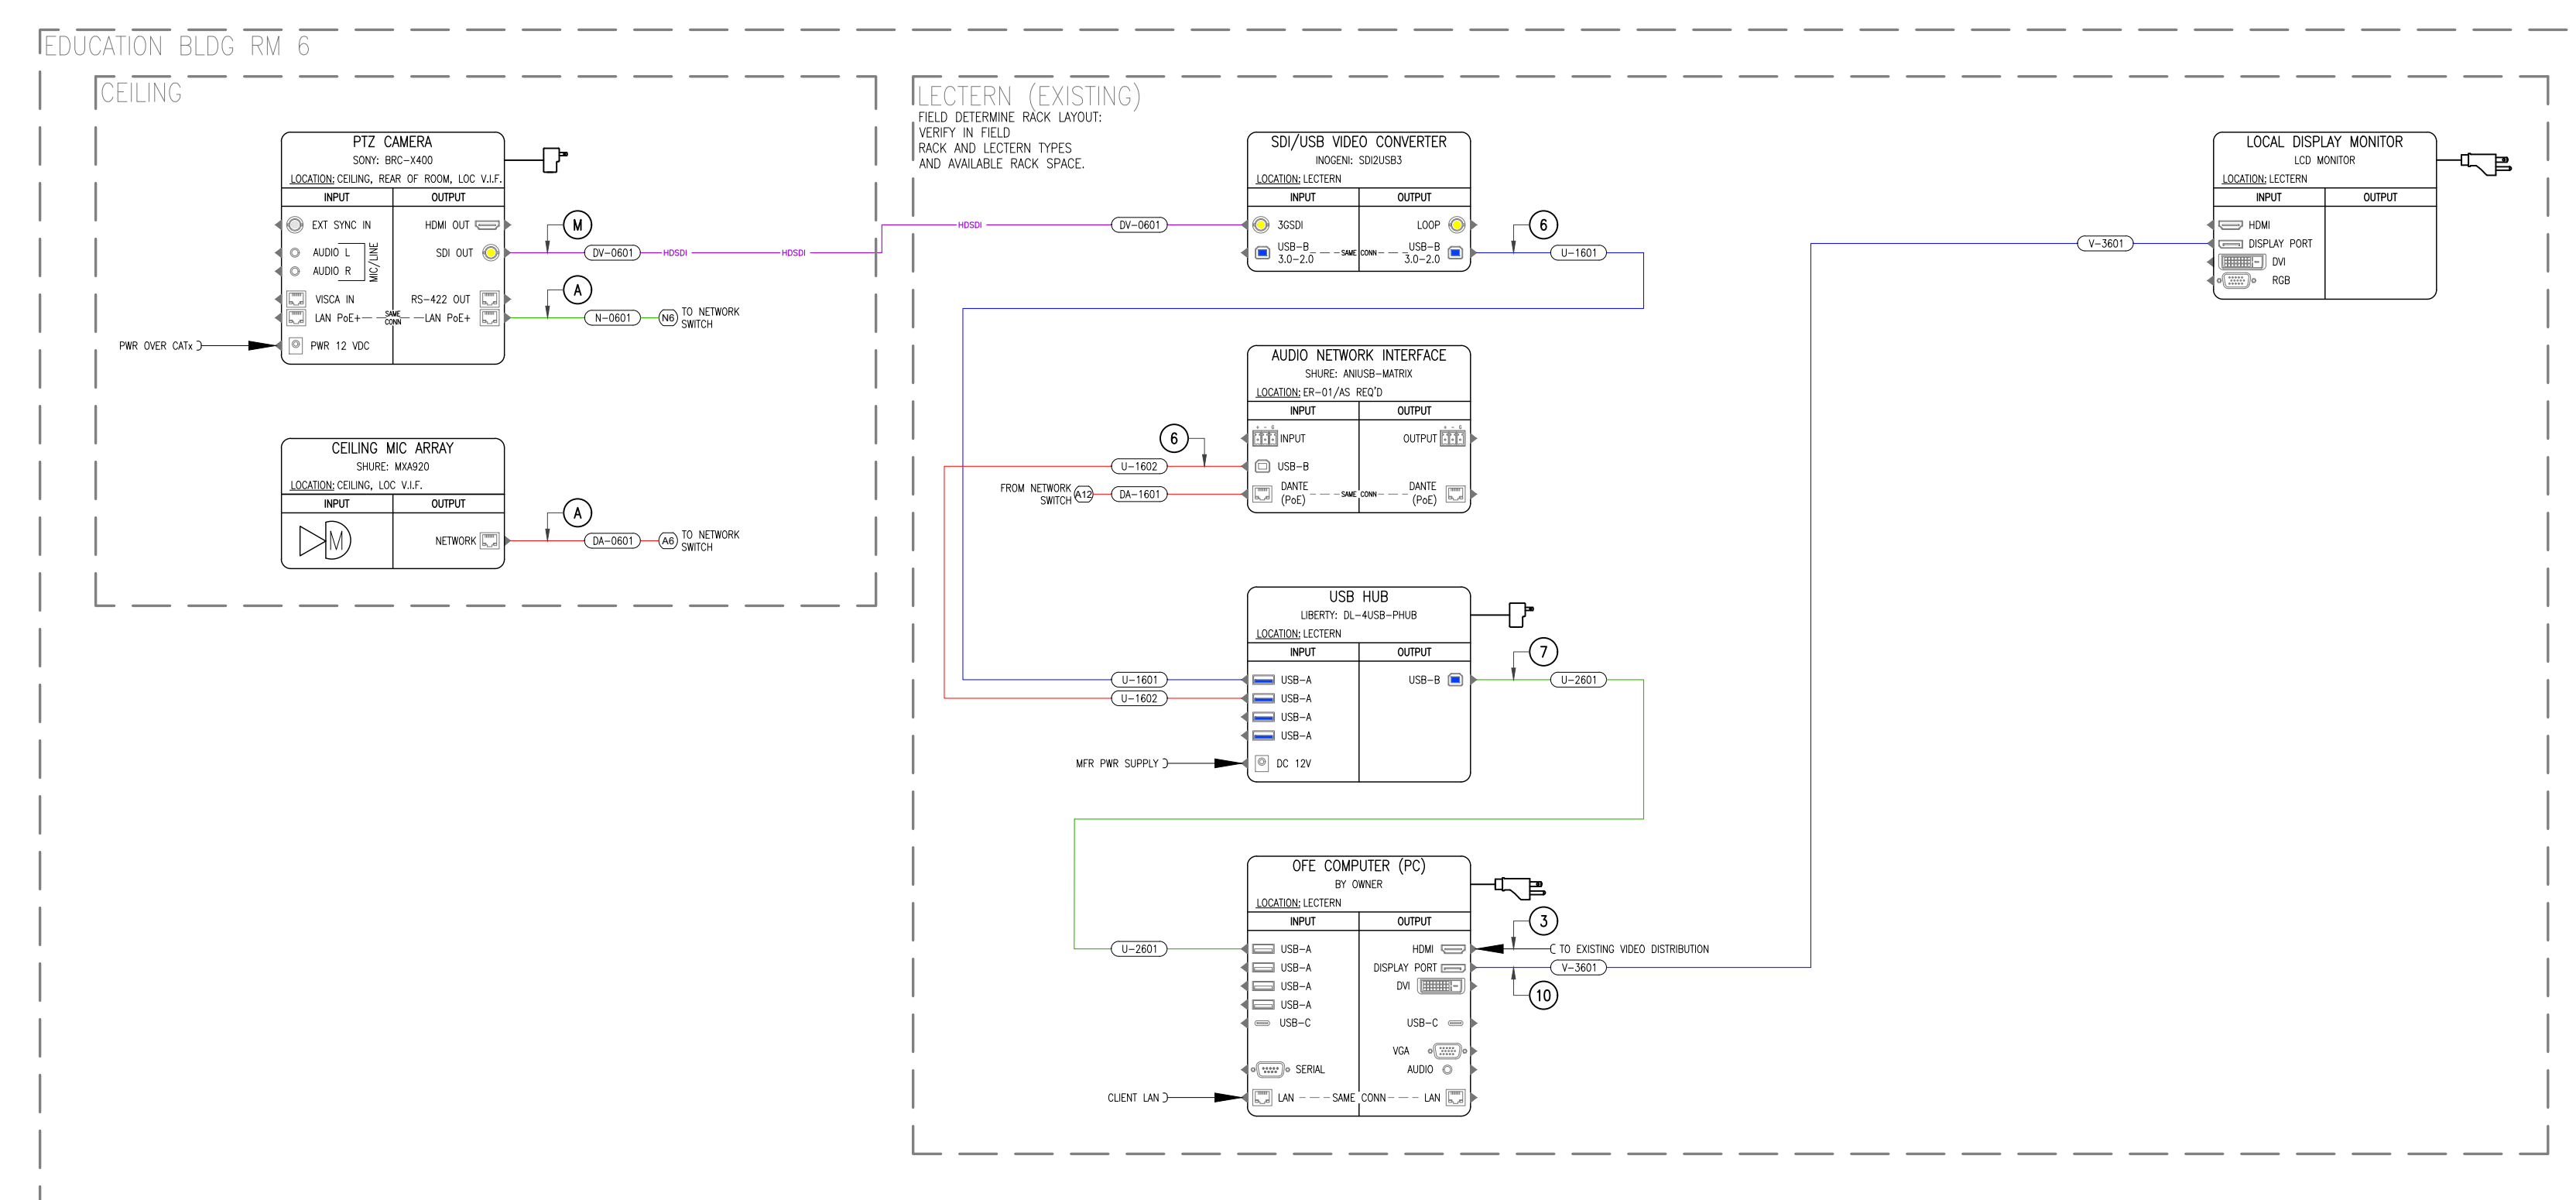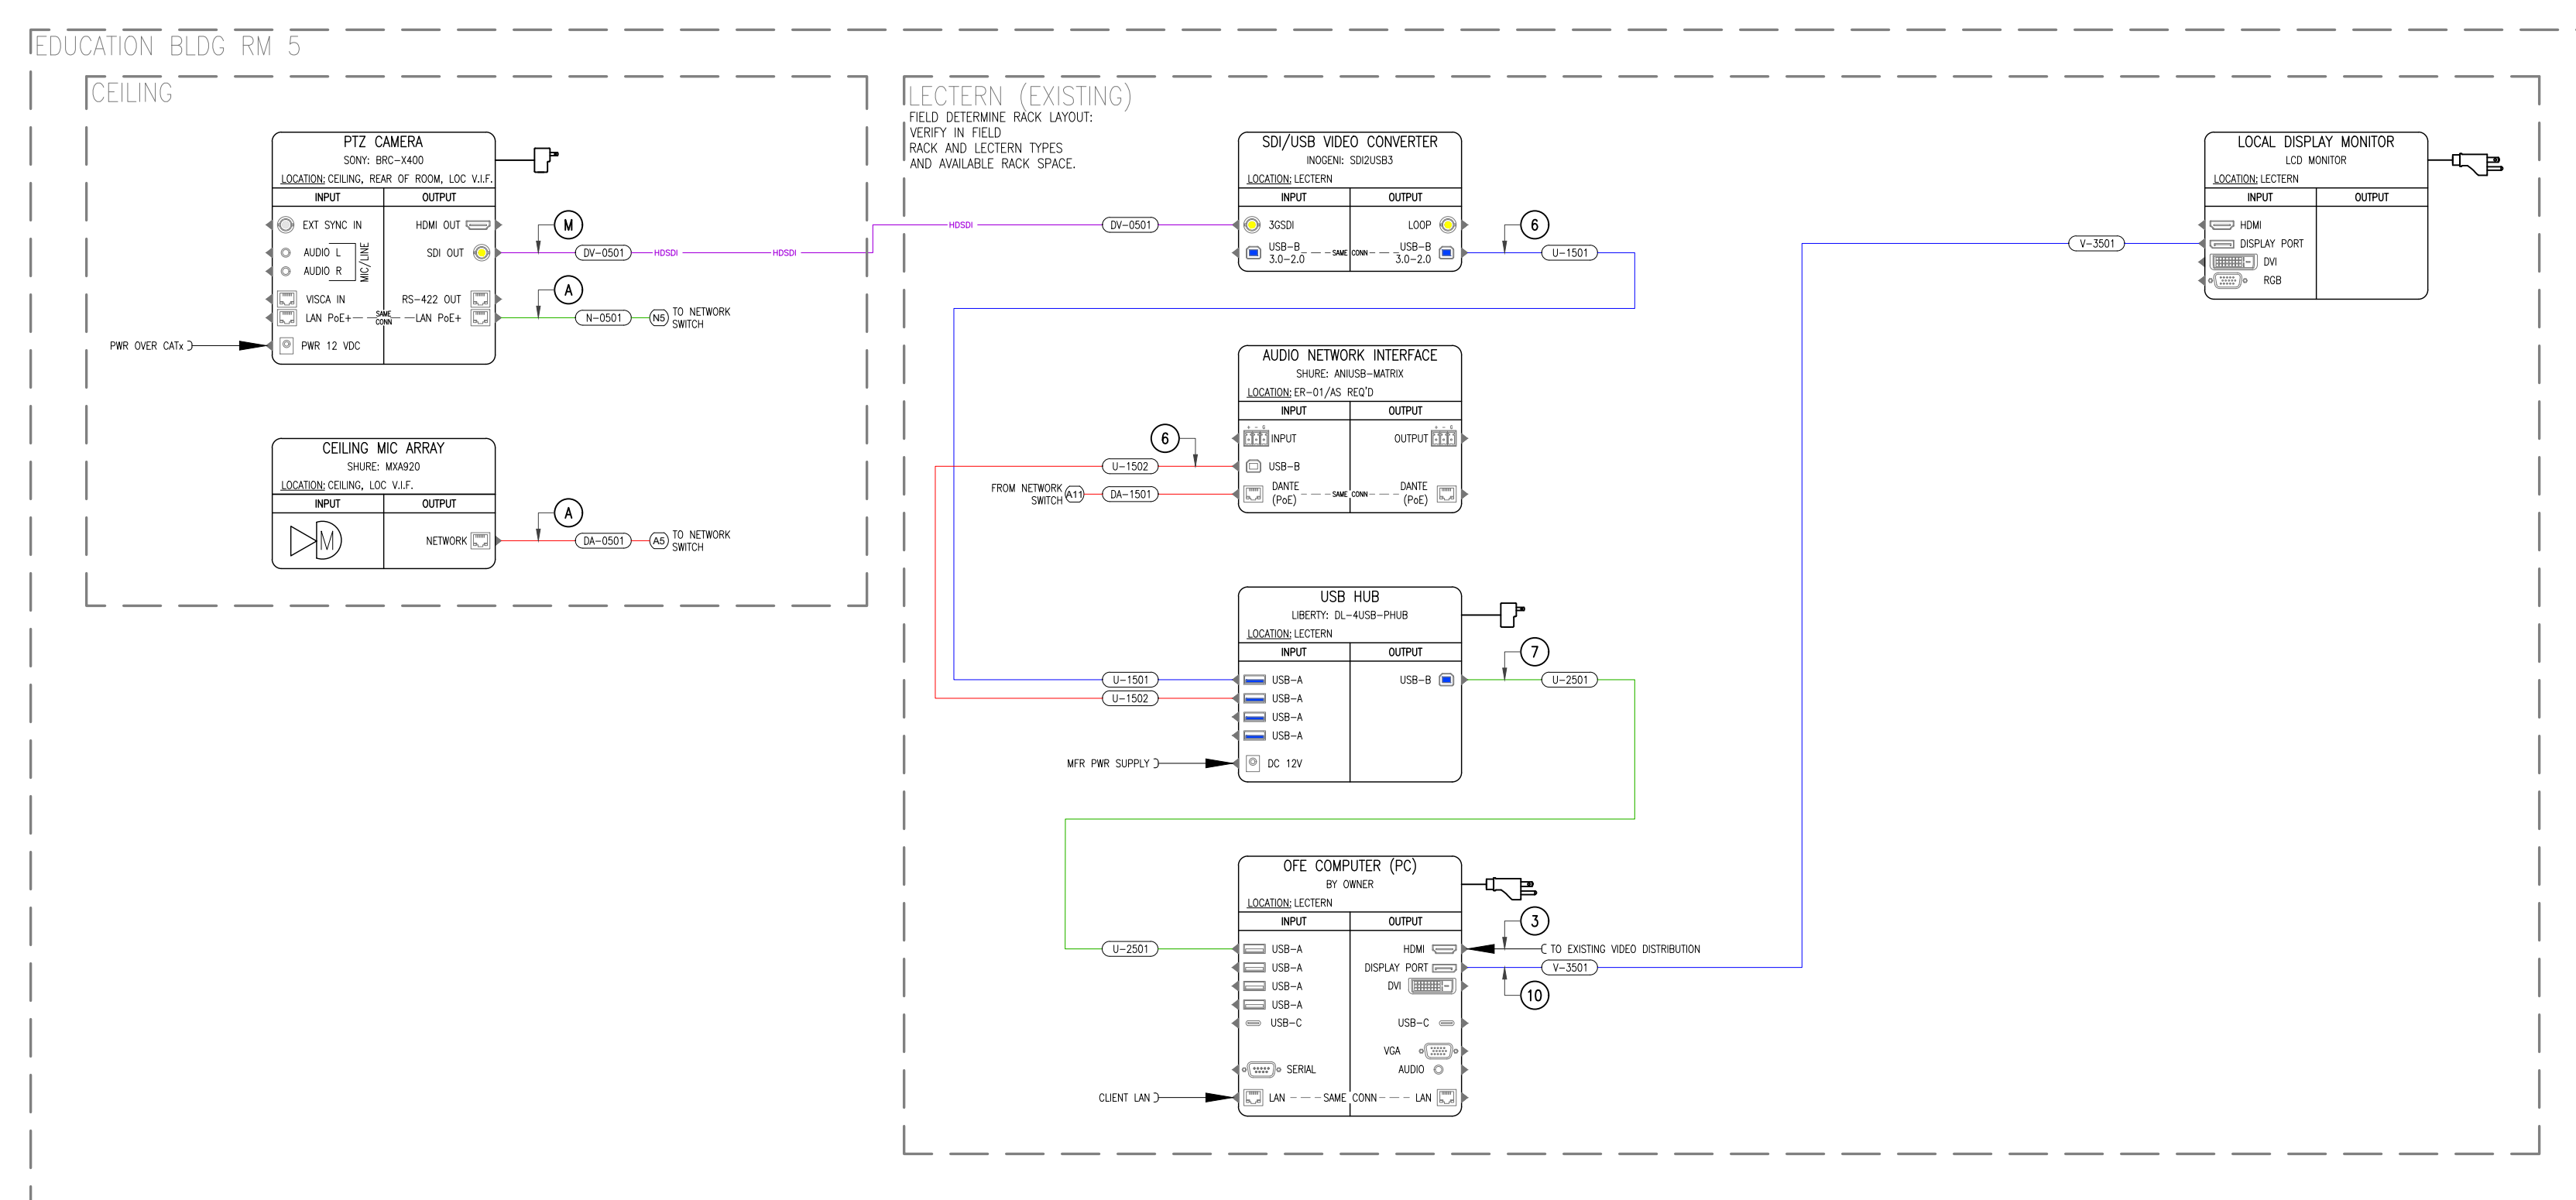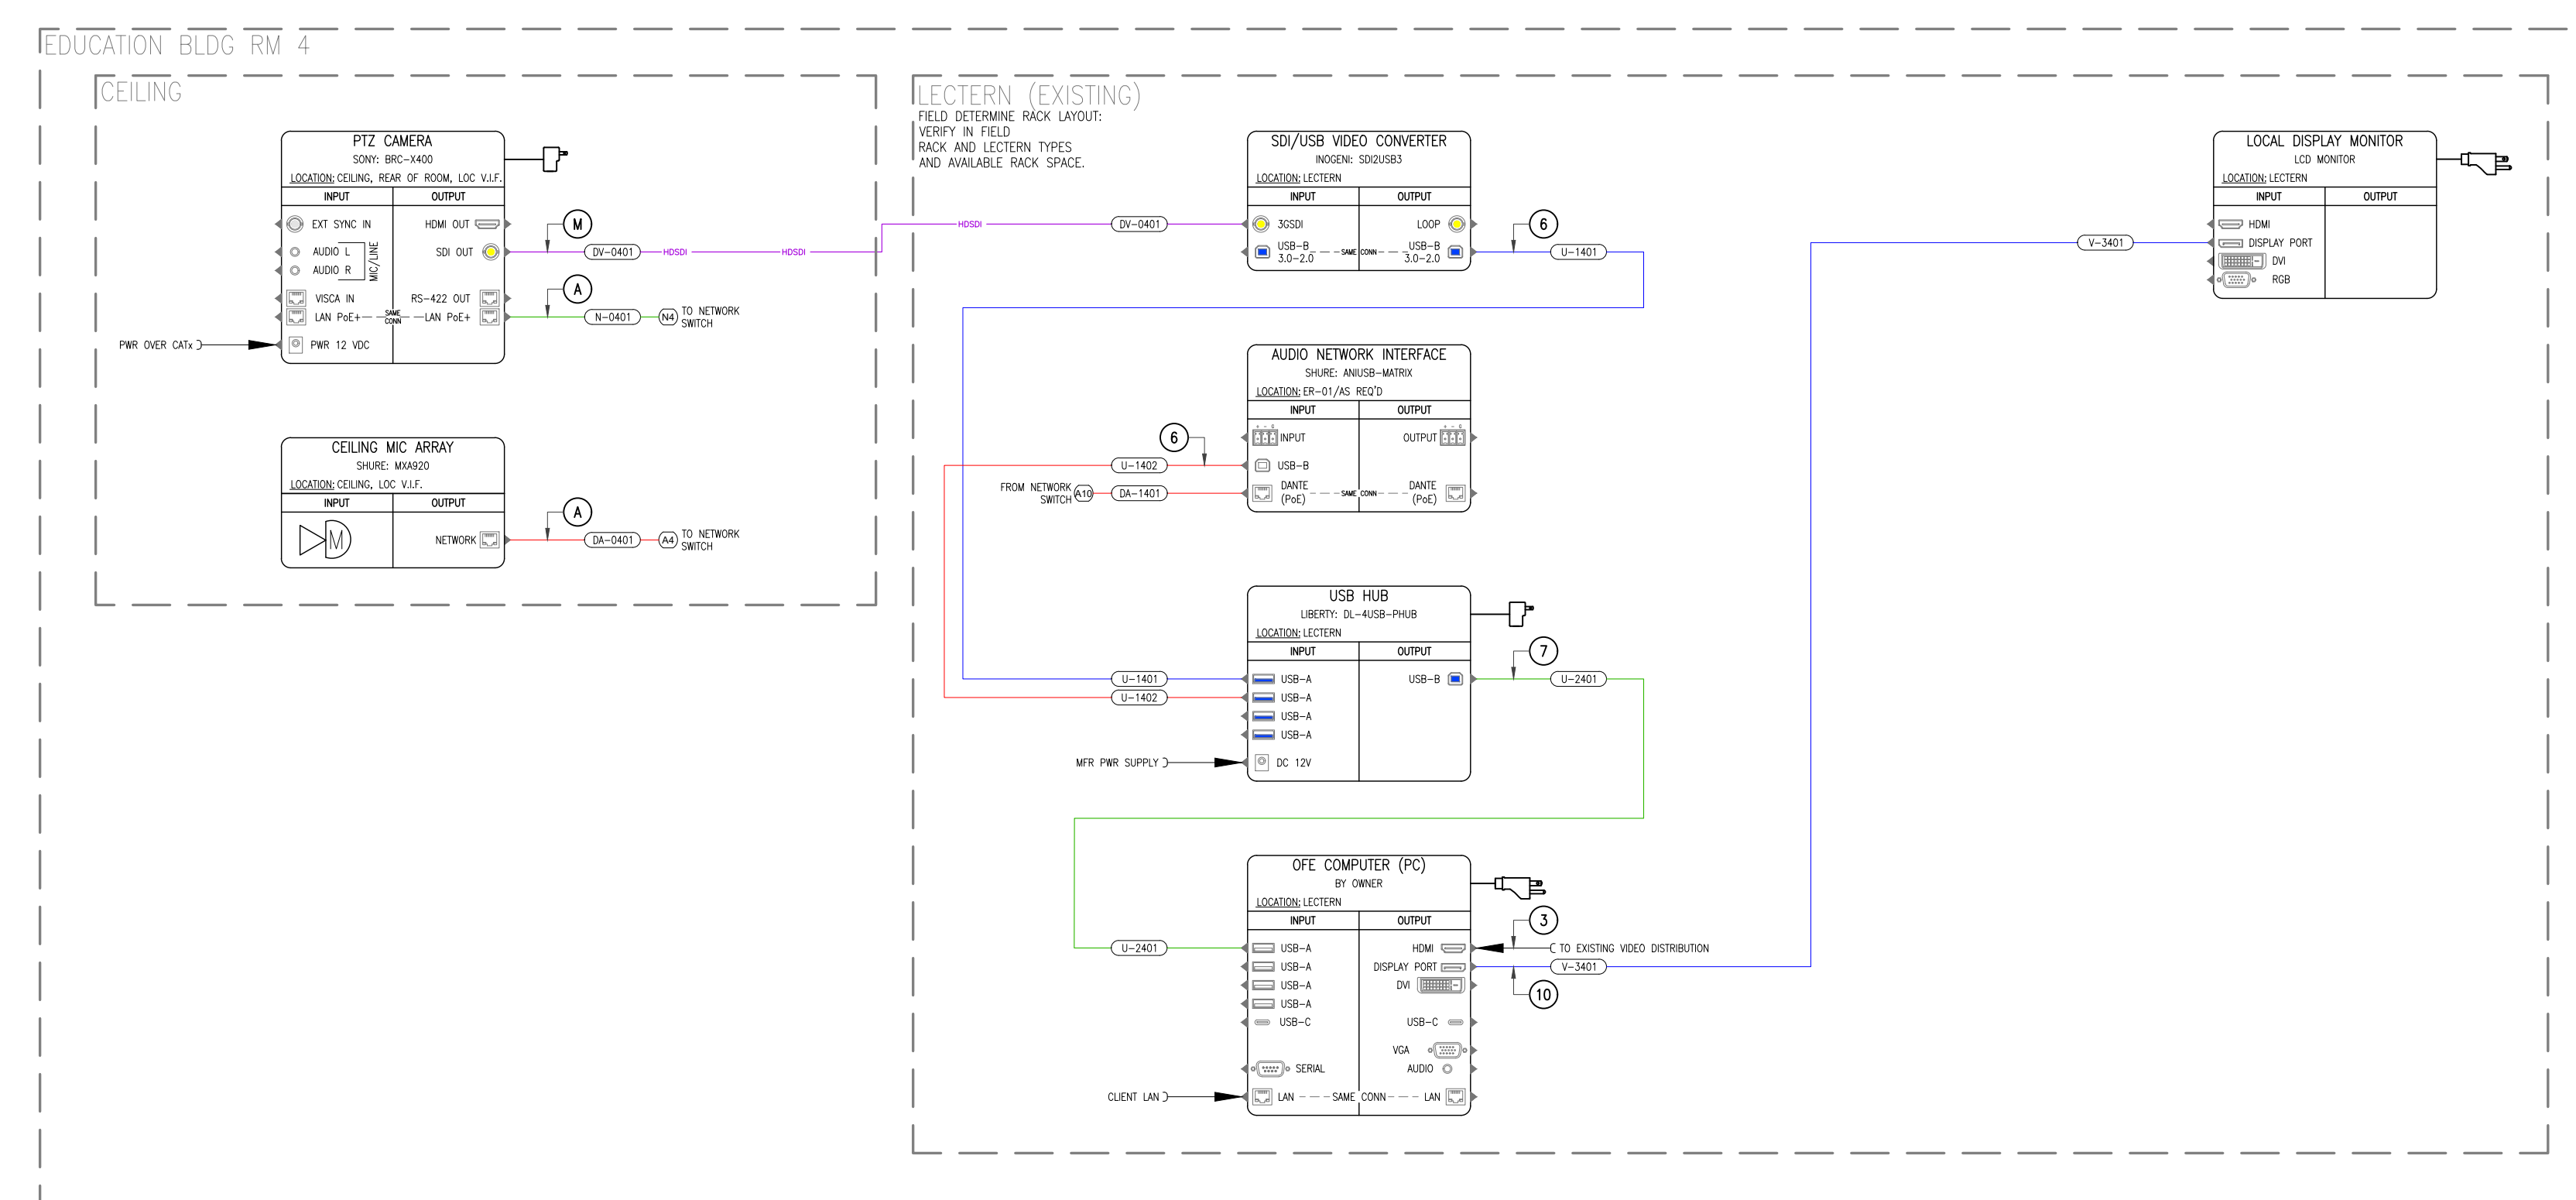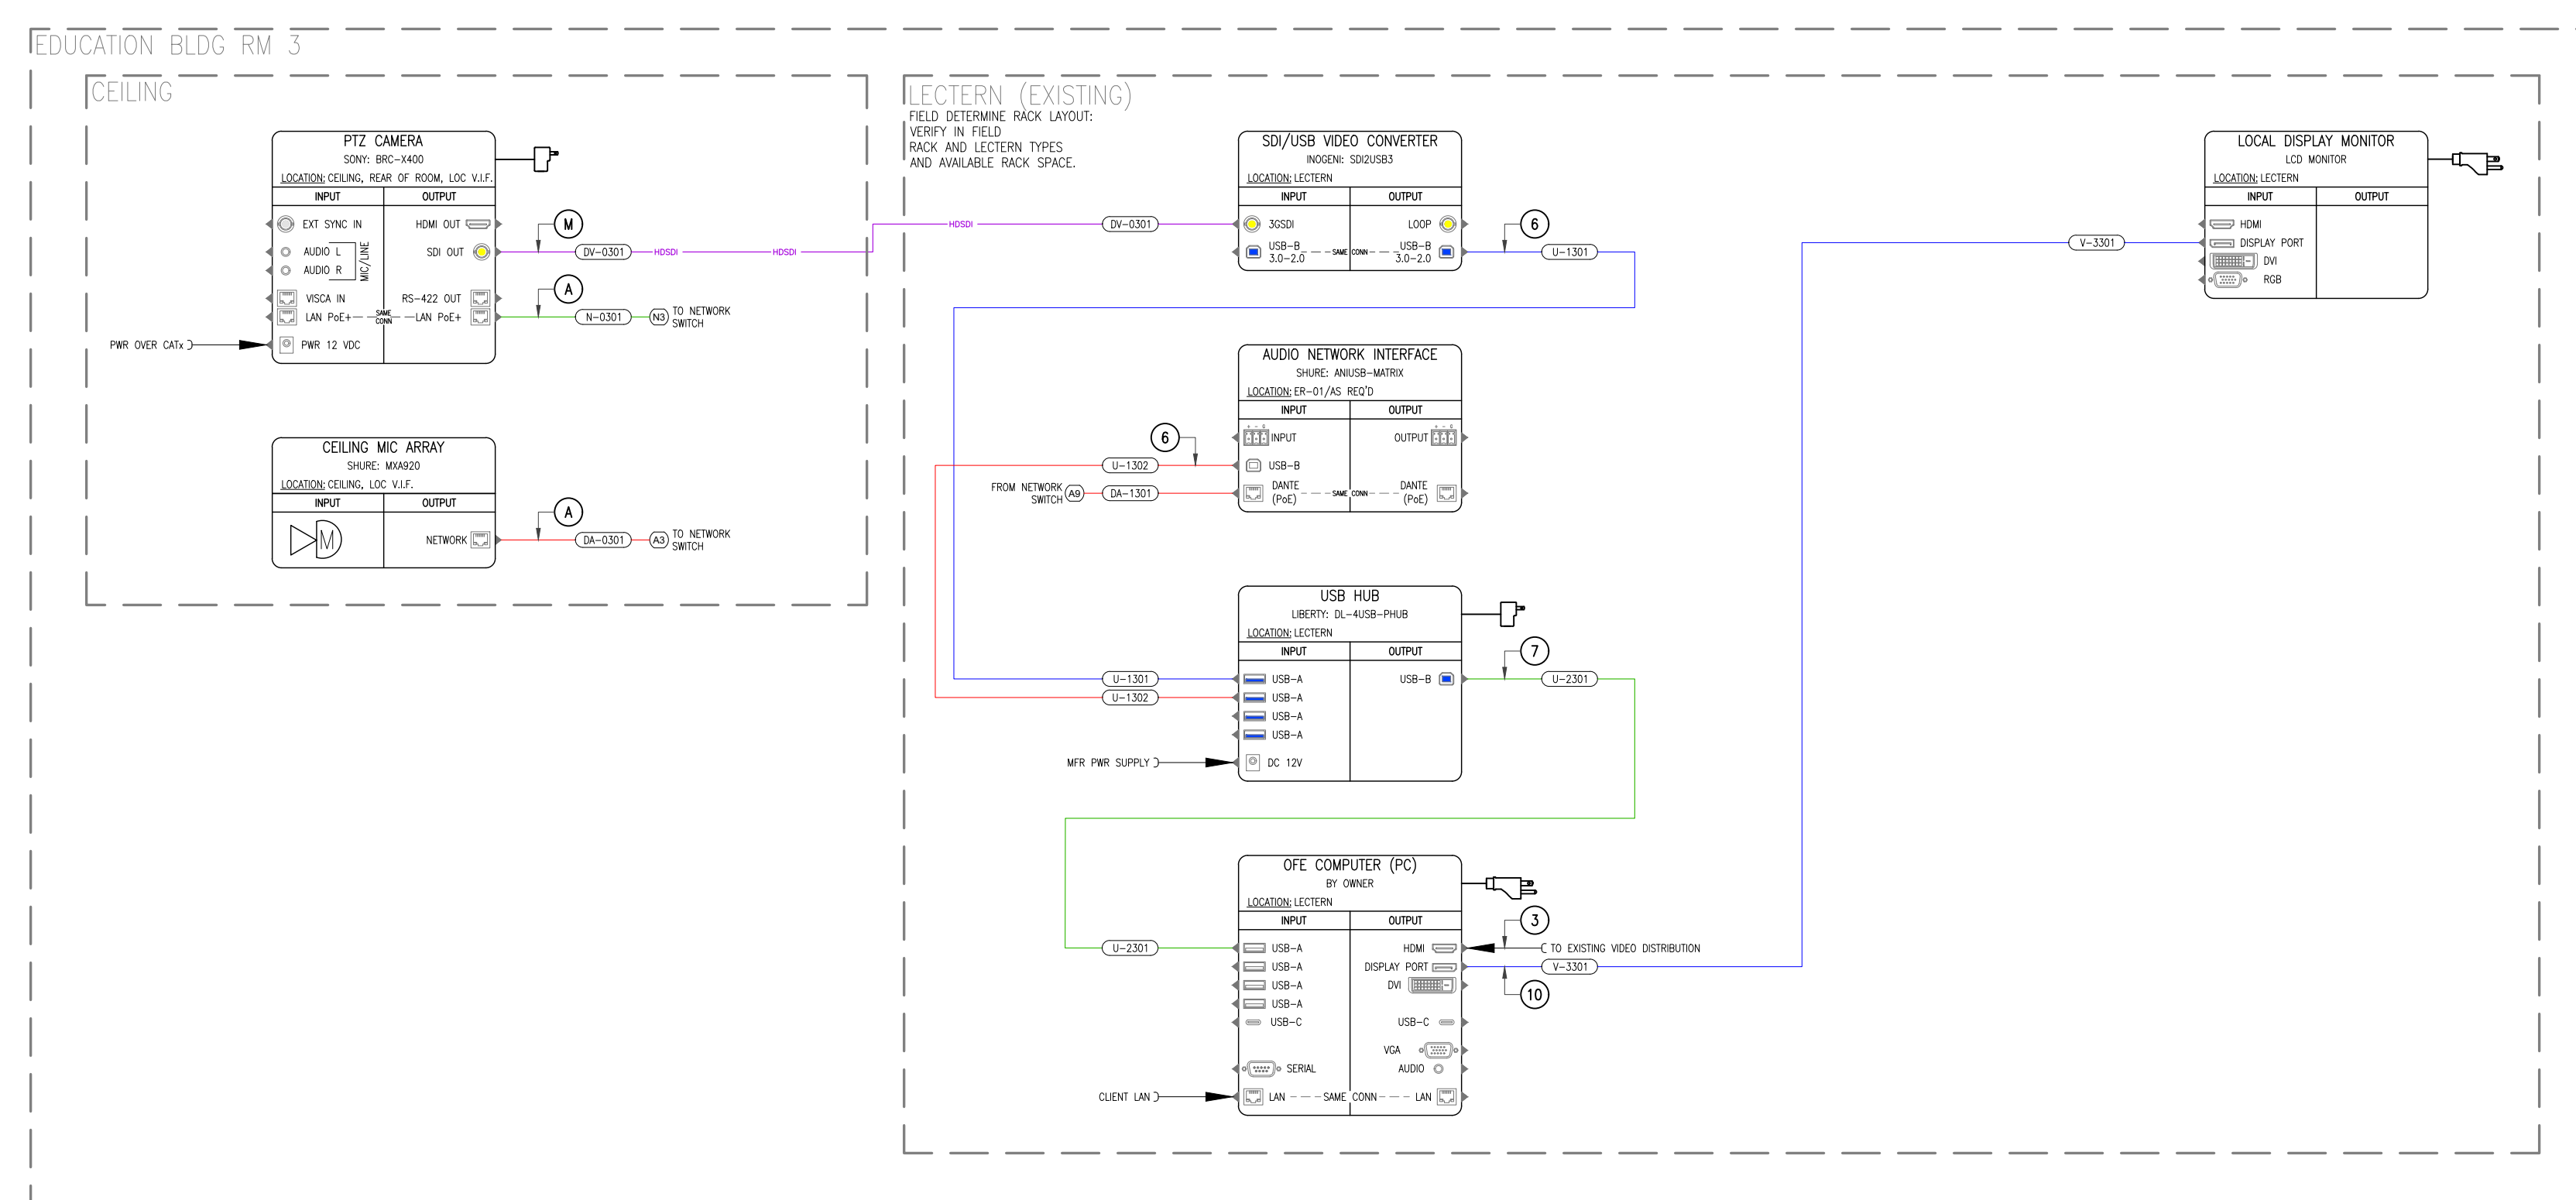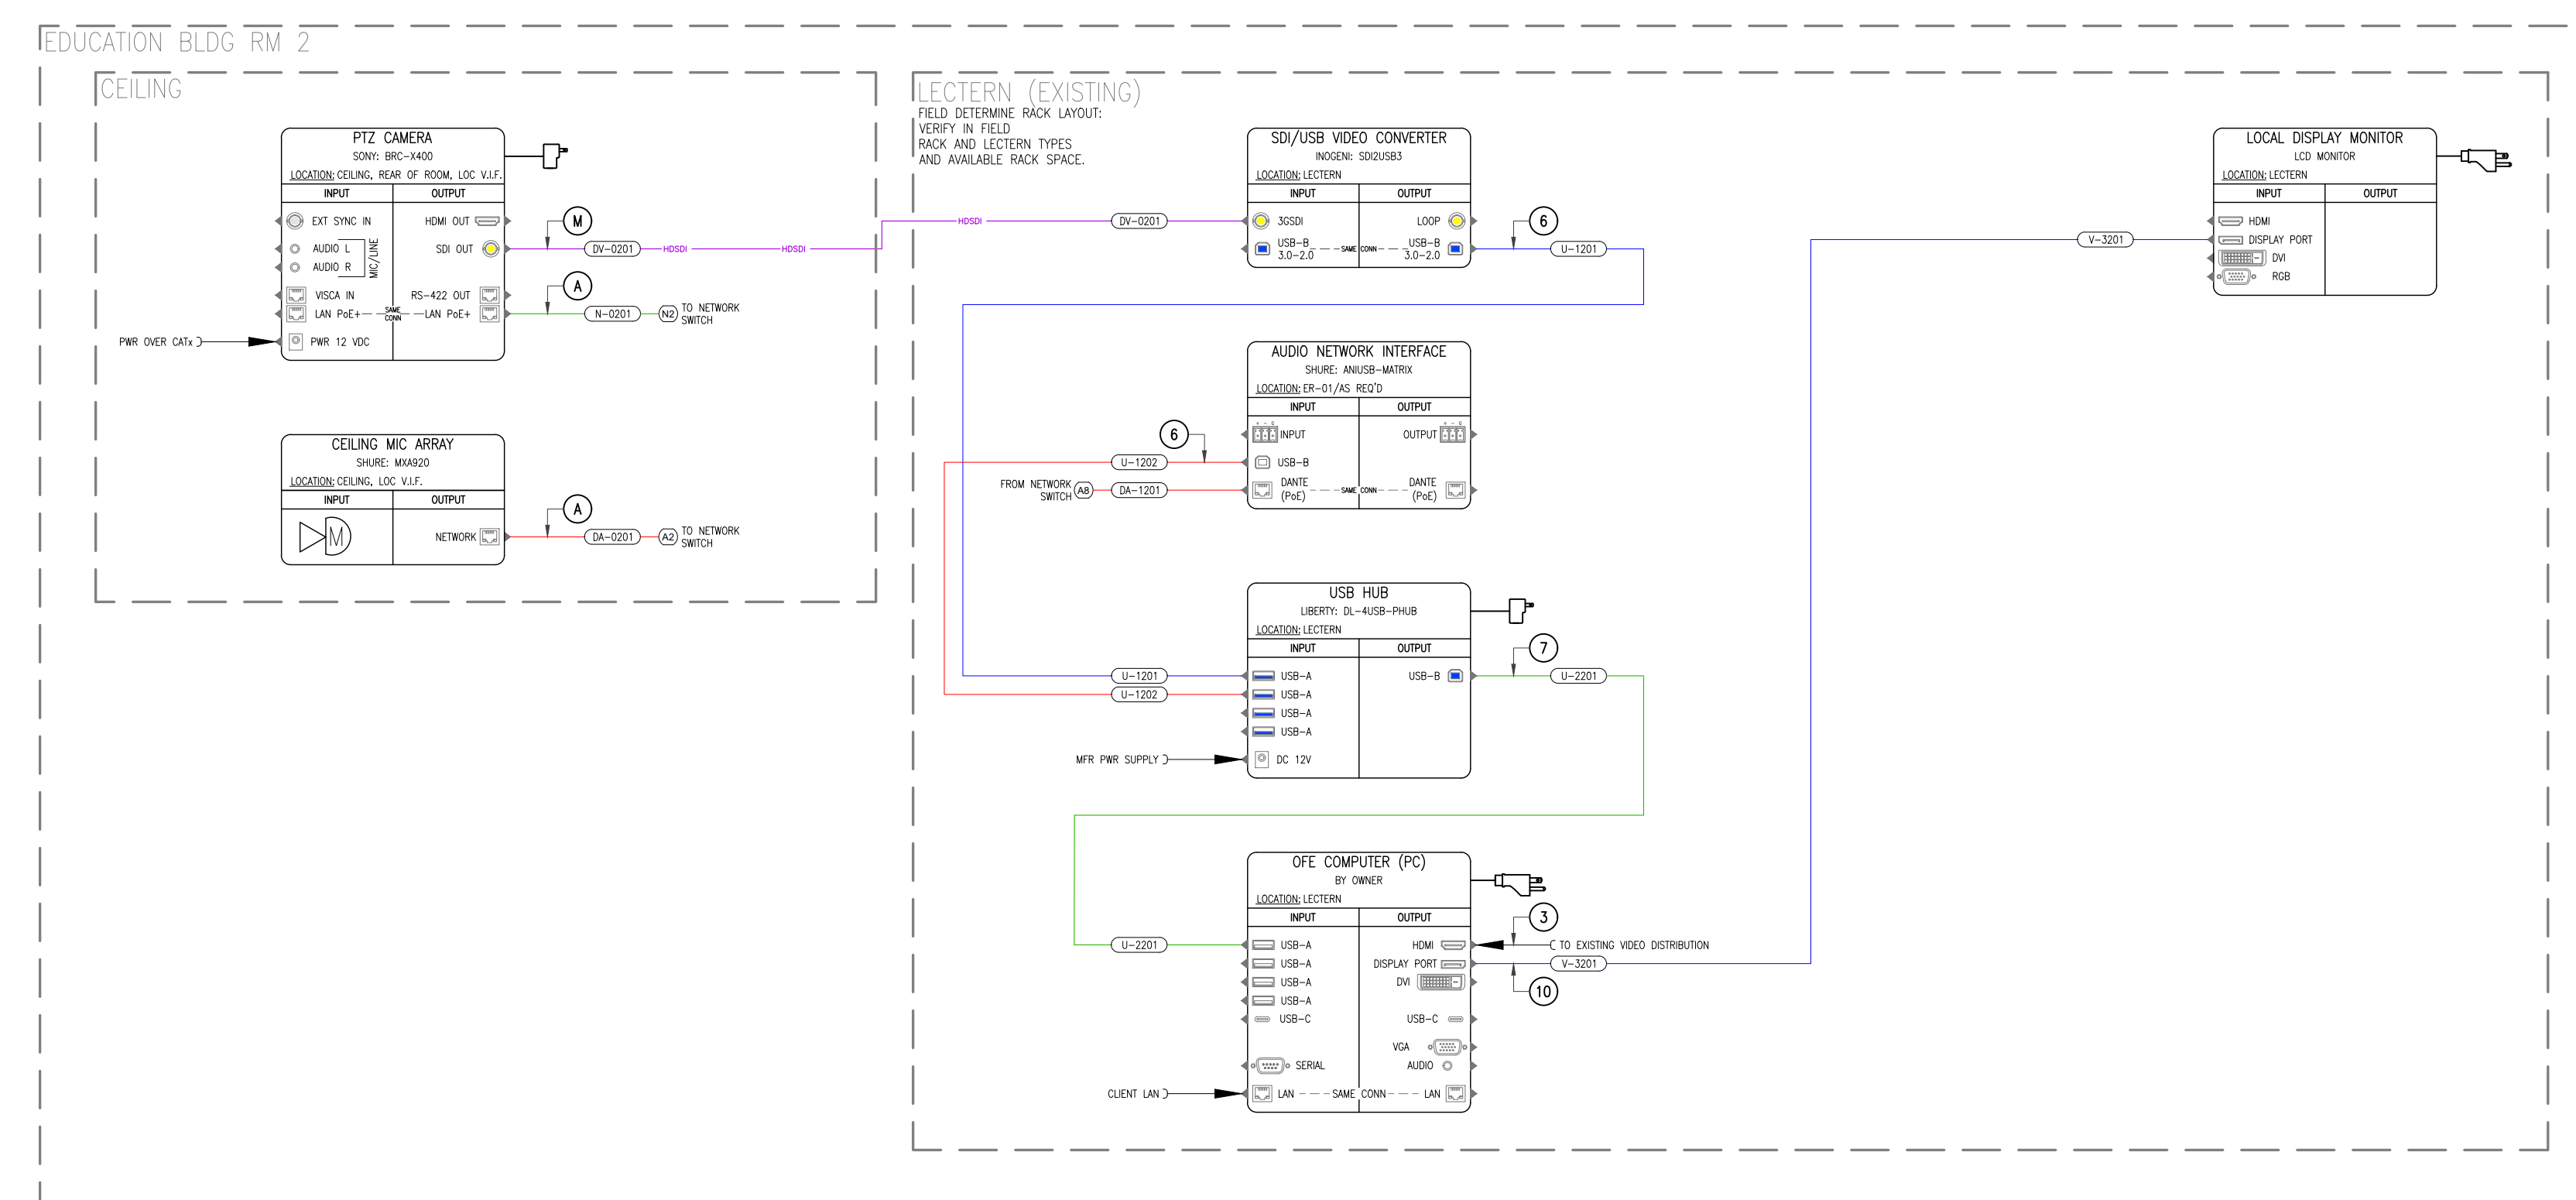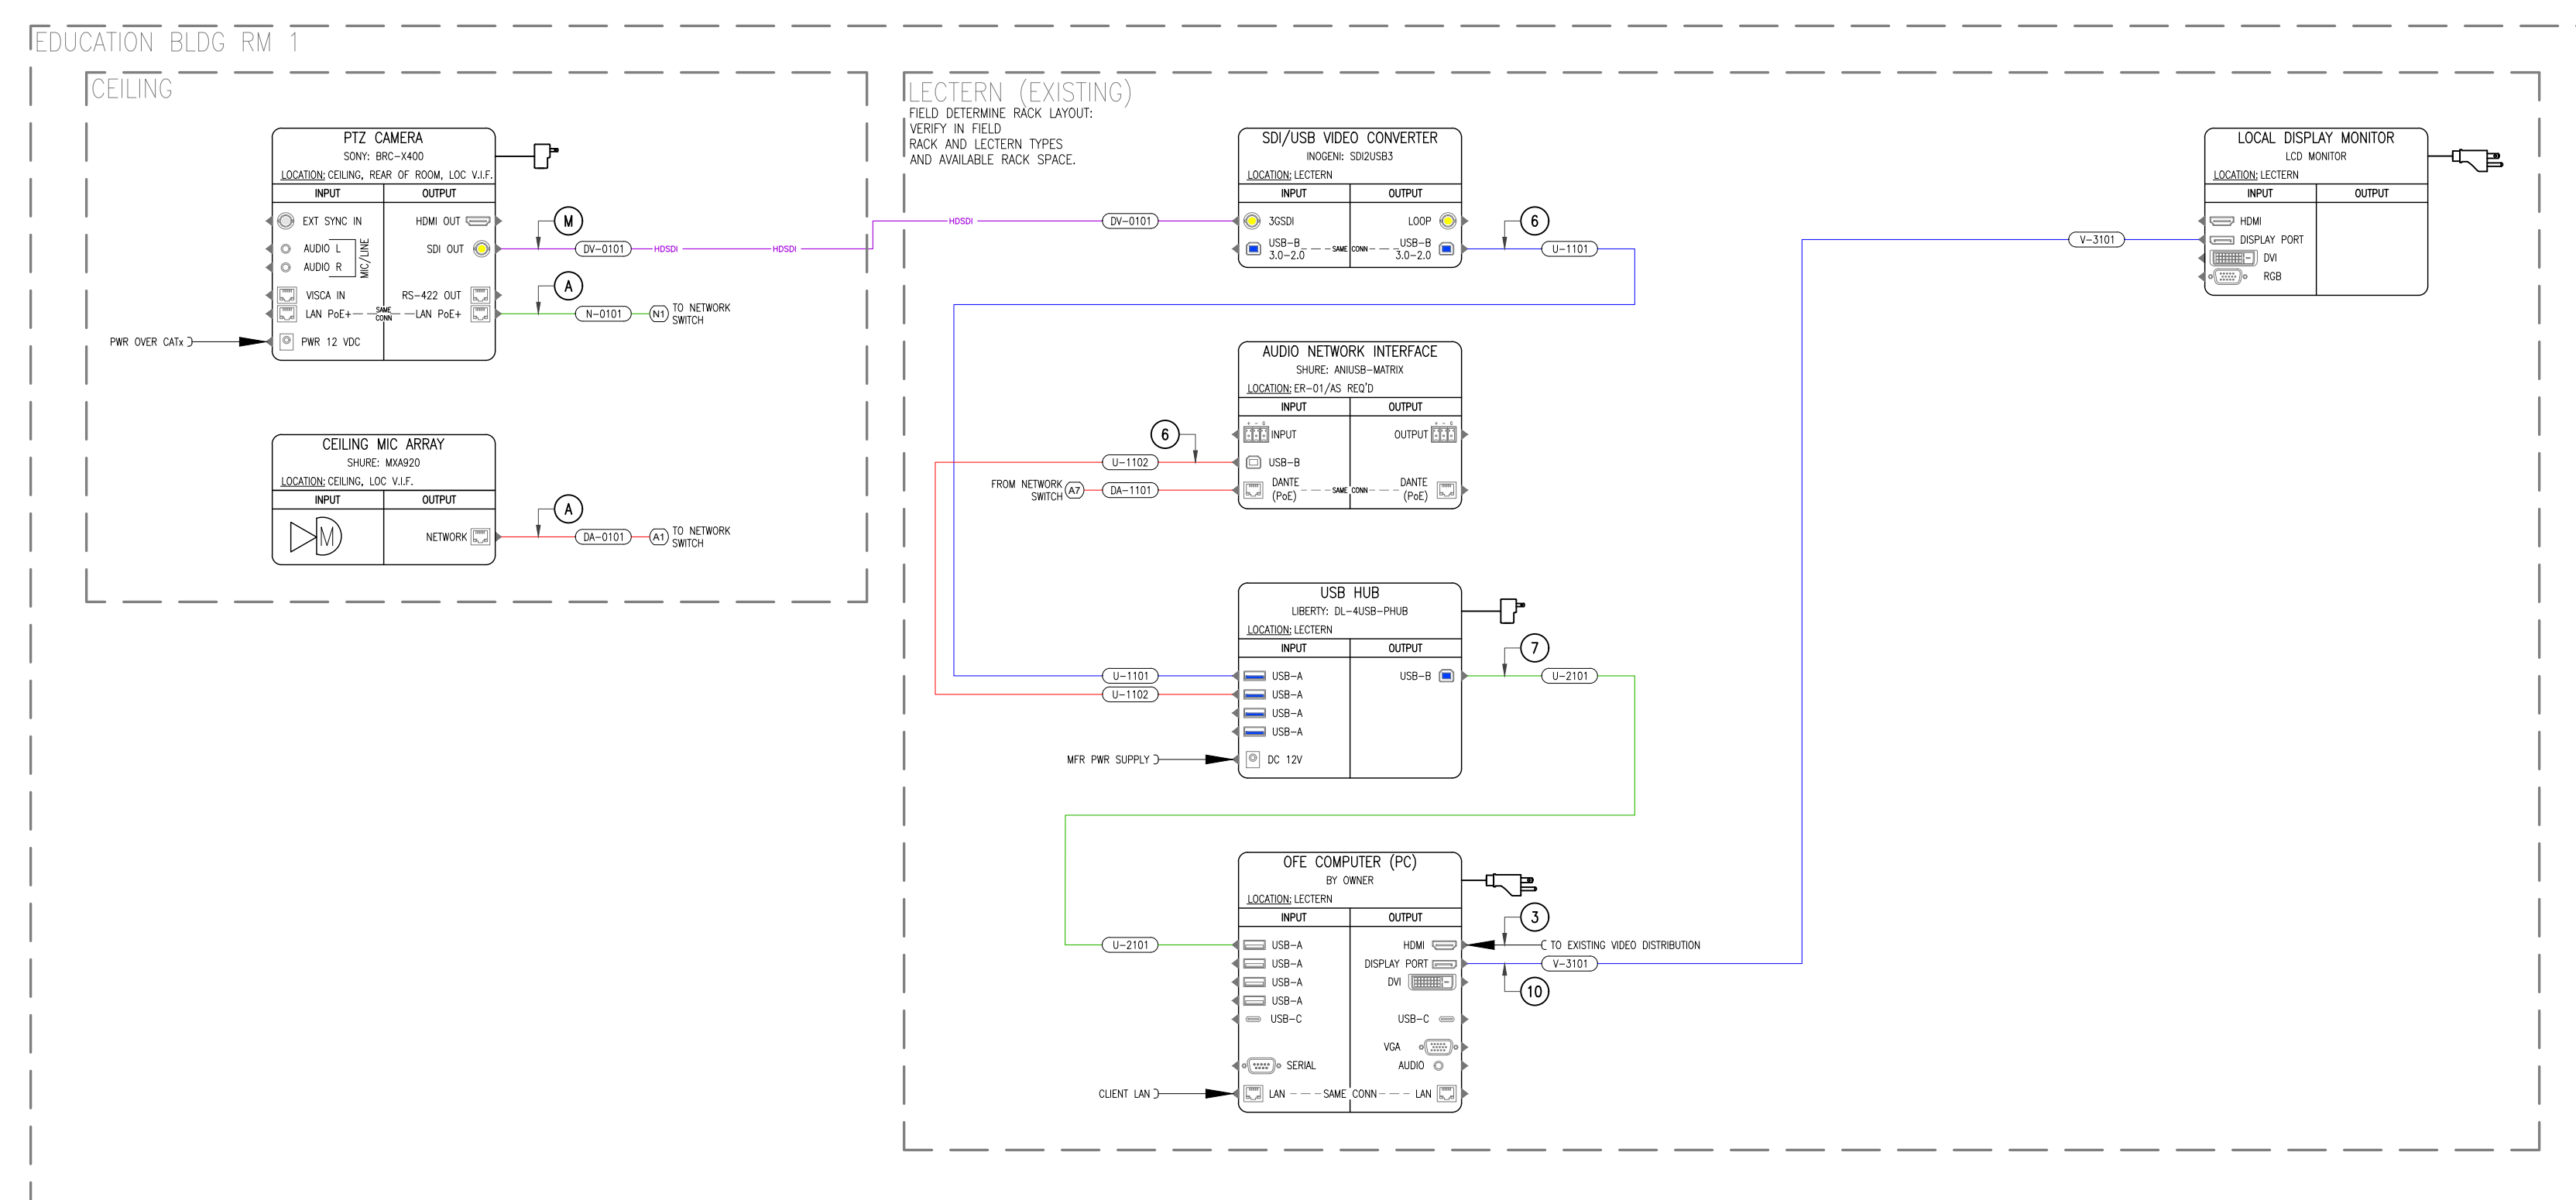

GENERAL NOTES:
REFER TO MANUFACTURER'S INSTALLATION/OWNERS MANUAL FOR SPECIFIC
AUDIO TERMINATION REQUIREMENTS.
REFER TO MANUFACTURER'S INSTALLATION/OWNERS MANUAL FOR ALL
WIRING TERMINATION REQUIREMENTS.

BREAKOUT CABLE/WIRE SCHEDULE					
		ITEM	DESCRIPTION	QTY	UNIT
CABLE	NO	1	MANUFACTURER SUPPLY CABLE	5	5
		2	LOW SPEED WIRE WITH/OUT CABLE	6	6
		3	HIGH SPEED WIRE WITH/OUT CABLE	7	7
		4	LOW SPEED WIRE WITH/OUT CABLE	8	8
		5	HIGH SPEED WIRE WITH/OUT CABLE	9	9
		6	USE A/B - W/OUT CABLE	10	10
		7	USE A/B - W/OUT CABLE	11	11
		8	USE A/B - W/OUT CABLE	12	12
		9	DISPARITY DATA - NEW CABLE	13	13
		10	DISPARITY DATA - NEW CABLE	14	14
CABLE	NO	1	MANUFACTURER SUPPLY CABLE	5	5
		2	LOW SPEED WIRE WITH/OUT CABLE	6	6
		3	HIGH SPEED WIRE WITH/OUT CABLE	7	7
		4	LOW SPEED WIRE WITH/OUT CABLE	8	8
		5	HIGH SPEED WIRE WITH/OUT CABLE	9	9
		6	USE A/B - W/OUT CABLE	10	10
		7	USE A/B - W/OUT CABLE	11	11
		8	USE A/B - W/OUT CABLE	12	12
		9	DISPARITY DATA - NEW CABLE	13	13
		10	DISPARITY DATA - NEW CABLE	14	14

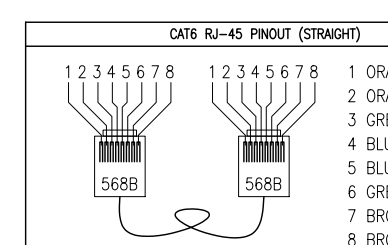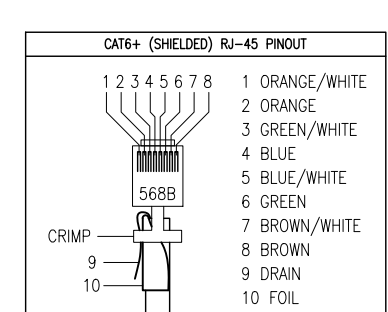

C-8000 ON/OFF ON FACE PUPPET
C-8000 ON/OFF OFF FACE PUPPET
C-8000 CABLE LINE (TMS)

VISE AND CABLE
 MOUNTING HOLES
 REFER TO BRACKET OR CABLE MOUNTING SCHEDULE

A-ALUMINUM, RES/ETHER, OR UNSPECIFIED EXISTING
AB-BITUMEN ALUMINUM, OVER CAT CABLE (ABSD)
C-CORRUGATED, W/ABS
D-DIGITAL MICROPHONE CONTROL LOGIC (V), OR EQUIVALENT
DA-DIGITAL AUDIO, OVER CAT CABLE (DANTS)
DC-DIGITAL VIDEO FORMAT OVER SHIELDS CAT CABLE
DV-DIGITAL VIDEO FORMAT OVER COAX
L-LEVEL LEVEL
M-MIC MIC LEVEL
M-MICROPHONE
MP-METROPOLY PUE
P-POWER
R-RF SIGNAL LINE, E: EXT, ANTENNA, RF DISTRIBUTION/TRANSIMPED
S-SPEAKER LEVEL
S-SPEAKERS (EXCEPT OVER CAT)

ALL WIRETYPES LISTED MAY NOT
APPEAR ON SCHEMATIC. FIELD DETERMINE
WIRETYPES AND USAGE FOR INSTALLATION.
BREAKOUT CABLE/WIRE SCHEDULE
DERIVED FROM BILL OF MATERIALS.

A AV SCHEMATIC - EDUCATION BLDG ROOMS 1-6
SCALE: NTS