



NWS WEATHER FORECAST OFFICE

UNINTERRUPTED POWER SUPPLY REPLACEMENTS

at Morristown (MRX), Nashville (OHX), and Atlanta (GA)

SITE PHOTOS



Atlanta, GA (FFC) WFO

UPS Data Plate


C&C POWER, INC.
ELMHURST, ILLINOIS U.S.A.
PHONE (630) 617-9022

UL LISTED **US** BATTERY CABINET S3TN

MODEL NO. **BC39-Y300-075**
SERIAL NO. **99006658** CABINET NO. **1**
NOMINAL DC **360 VOLTS**
RECOMMENDED FLOAT VOLTAGE (V.P.C.) **2.25-2.3**
SYSTEM FLOAT VOLTAGE **405-414**
SHORT CIRCUIT RATING **79,000 A.I.C. A50P225-4**
RETORQUE ANNUALLY (IN.-LBS.) **70-75 IN.-LBS.**
DATE MANUFACTURED **11/2001**
CUSTOMER **MITSUBISHI P.O.#4500031559**
(SUITABLE FOR COMPUTER ROOM APPLICATIONS)




UPS (Behind View)

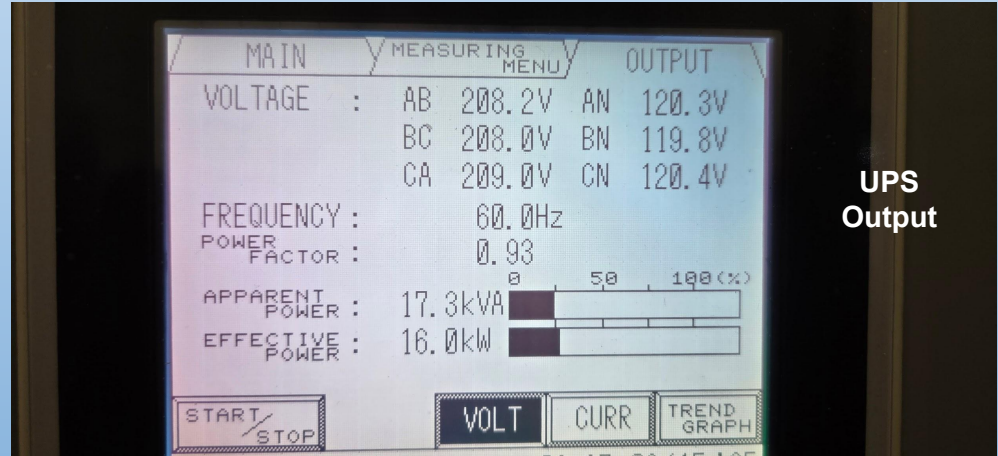

UPS Output

Atlanta, GA (FFC) WFO- Continued


UPS
Main
Display

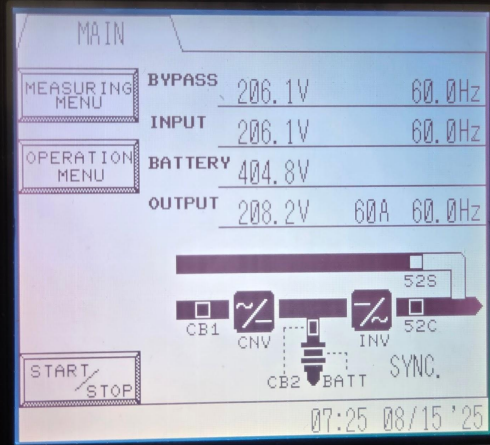


UPS Room (Inside
Entry)



UPS (Outside Entry)

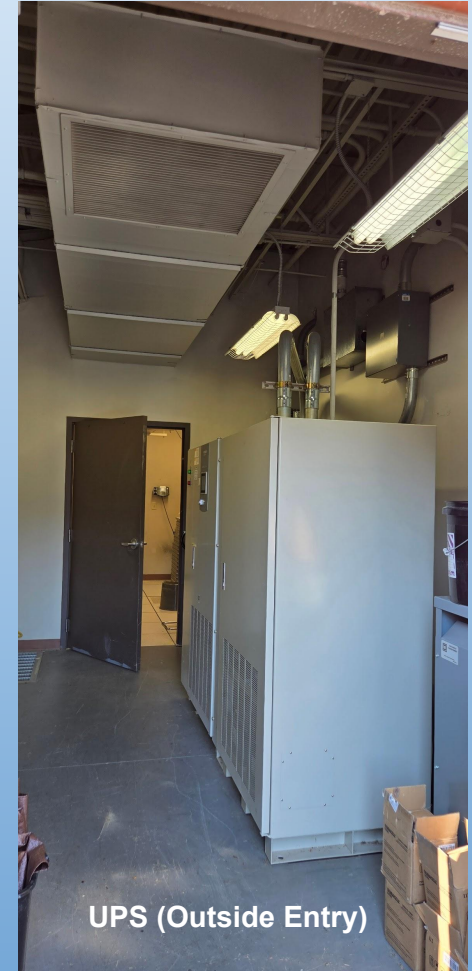

Morristown, TN (MRX) WFO

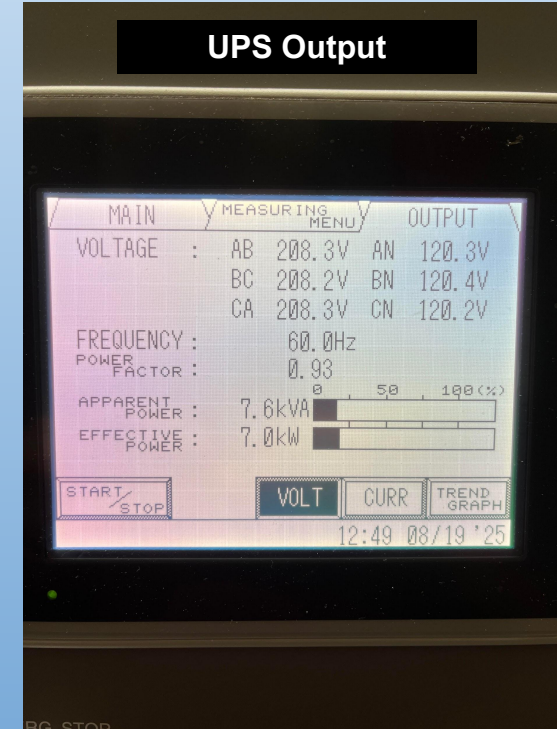



Morristown, TN (MRX) WFO- Continued



Morristown, TN (MRX) WFO- Continued



Nashville, TN (OHX) WFO

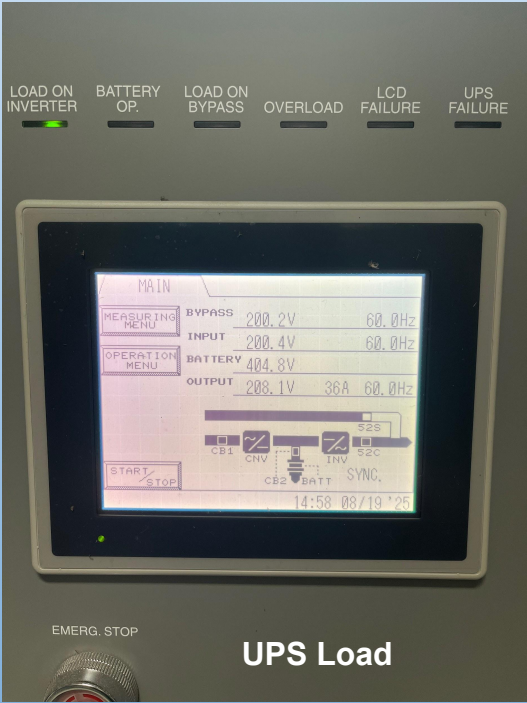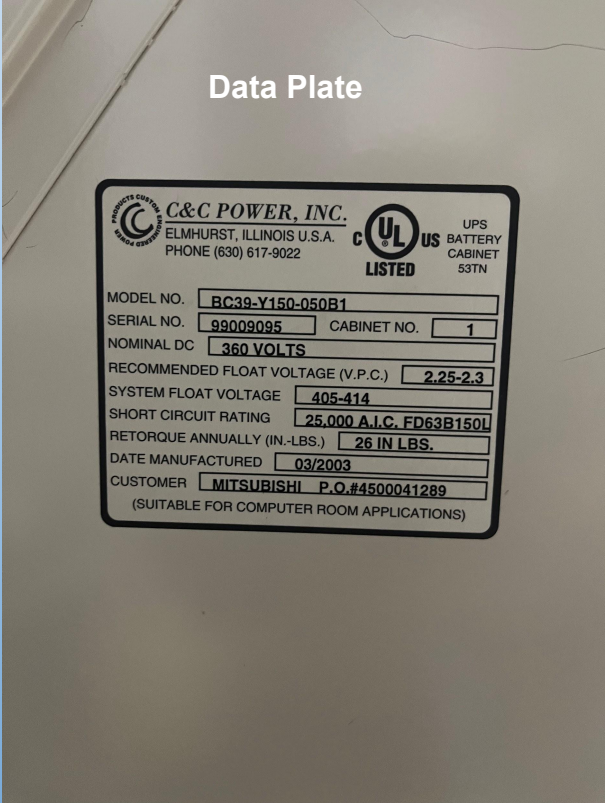

Nashville, TN (OHX) WFO- Continued



Nashville, TN (OHX) WFO- Continued

