




KEYED NOTES

1. Demolish existing boilers and circulation pumps, to include termination of all piping connections, combustion air and exhaust. Contractor is responsible for off site disposal and will track solid waste as required from the Selfridge ANG Base environmental engineering department. The existing combustion and exhaust air will be demoed. It is suggested that the contractor stage the demo in order to maintain HHW to the building during construction as required. Note: Coordination of continuation of HHW systems to the building will be coordinated with the KO and Construction COR.
2. The existing combustion and exhaust air will be demoed. All new exhaust and combustion air will be thru the roof.
3. The contractor will demo all existing PRV, strainers, chemical shot feeder, expansion tank and air separators.
4. The contractor will demo existing air compressor and terminate all connections to the air compressor.
5. Option 01 - Demo VFD for installation of new VFD controller on main AHU.
6. The contractor will demo existing humidifier and terminate all connections to the humidifier.

SELFRIDGE AIR
NATIONAL GUARD
BASE, MICHIGAN

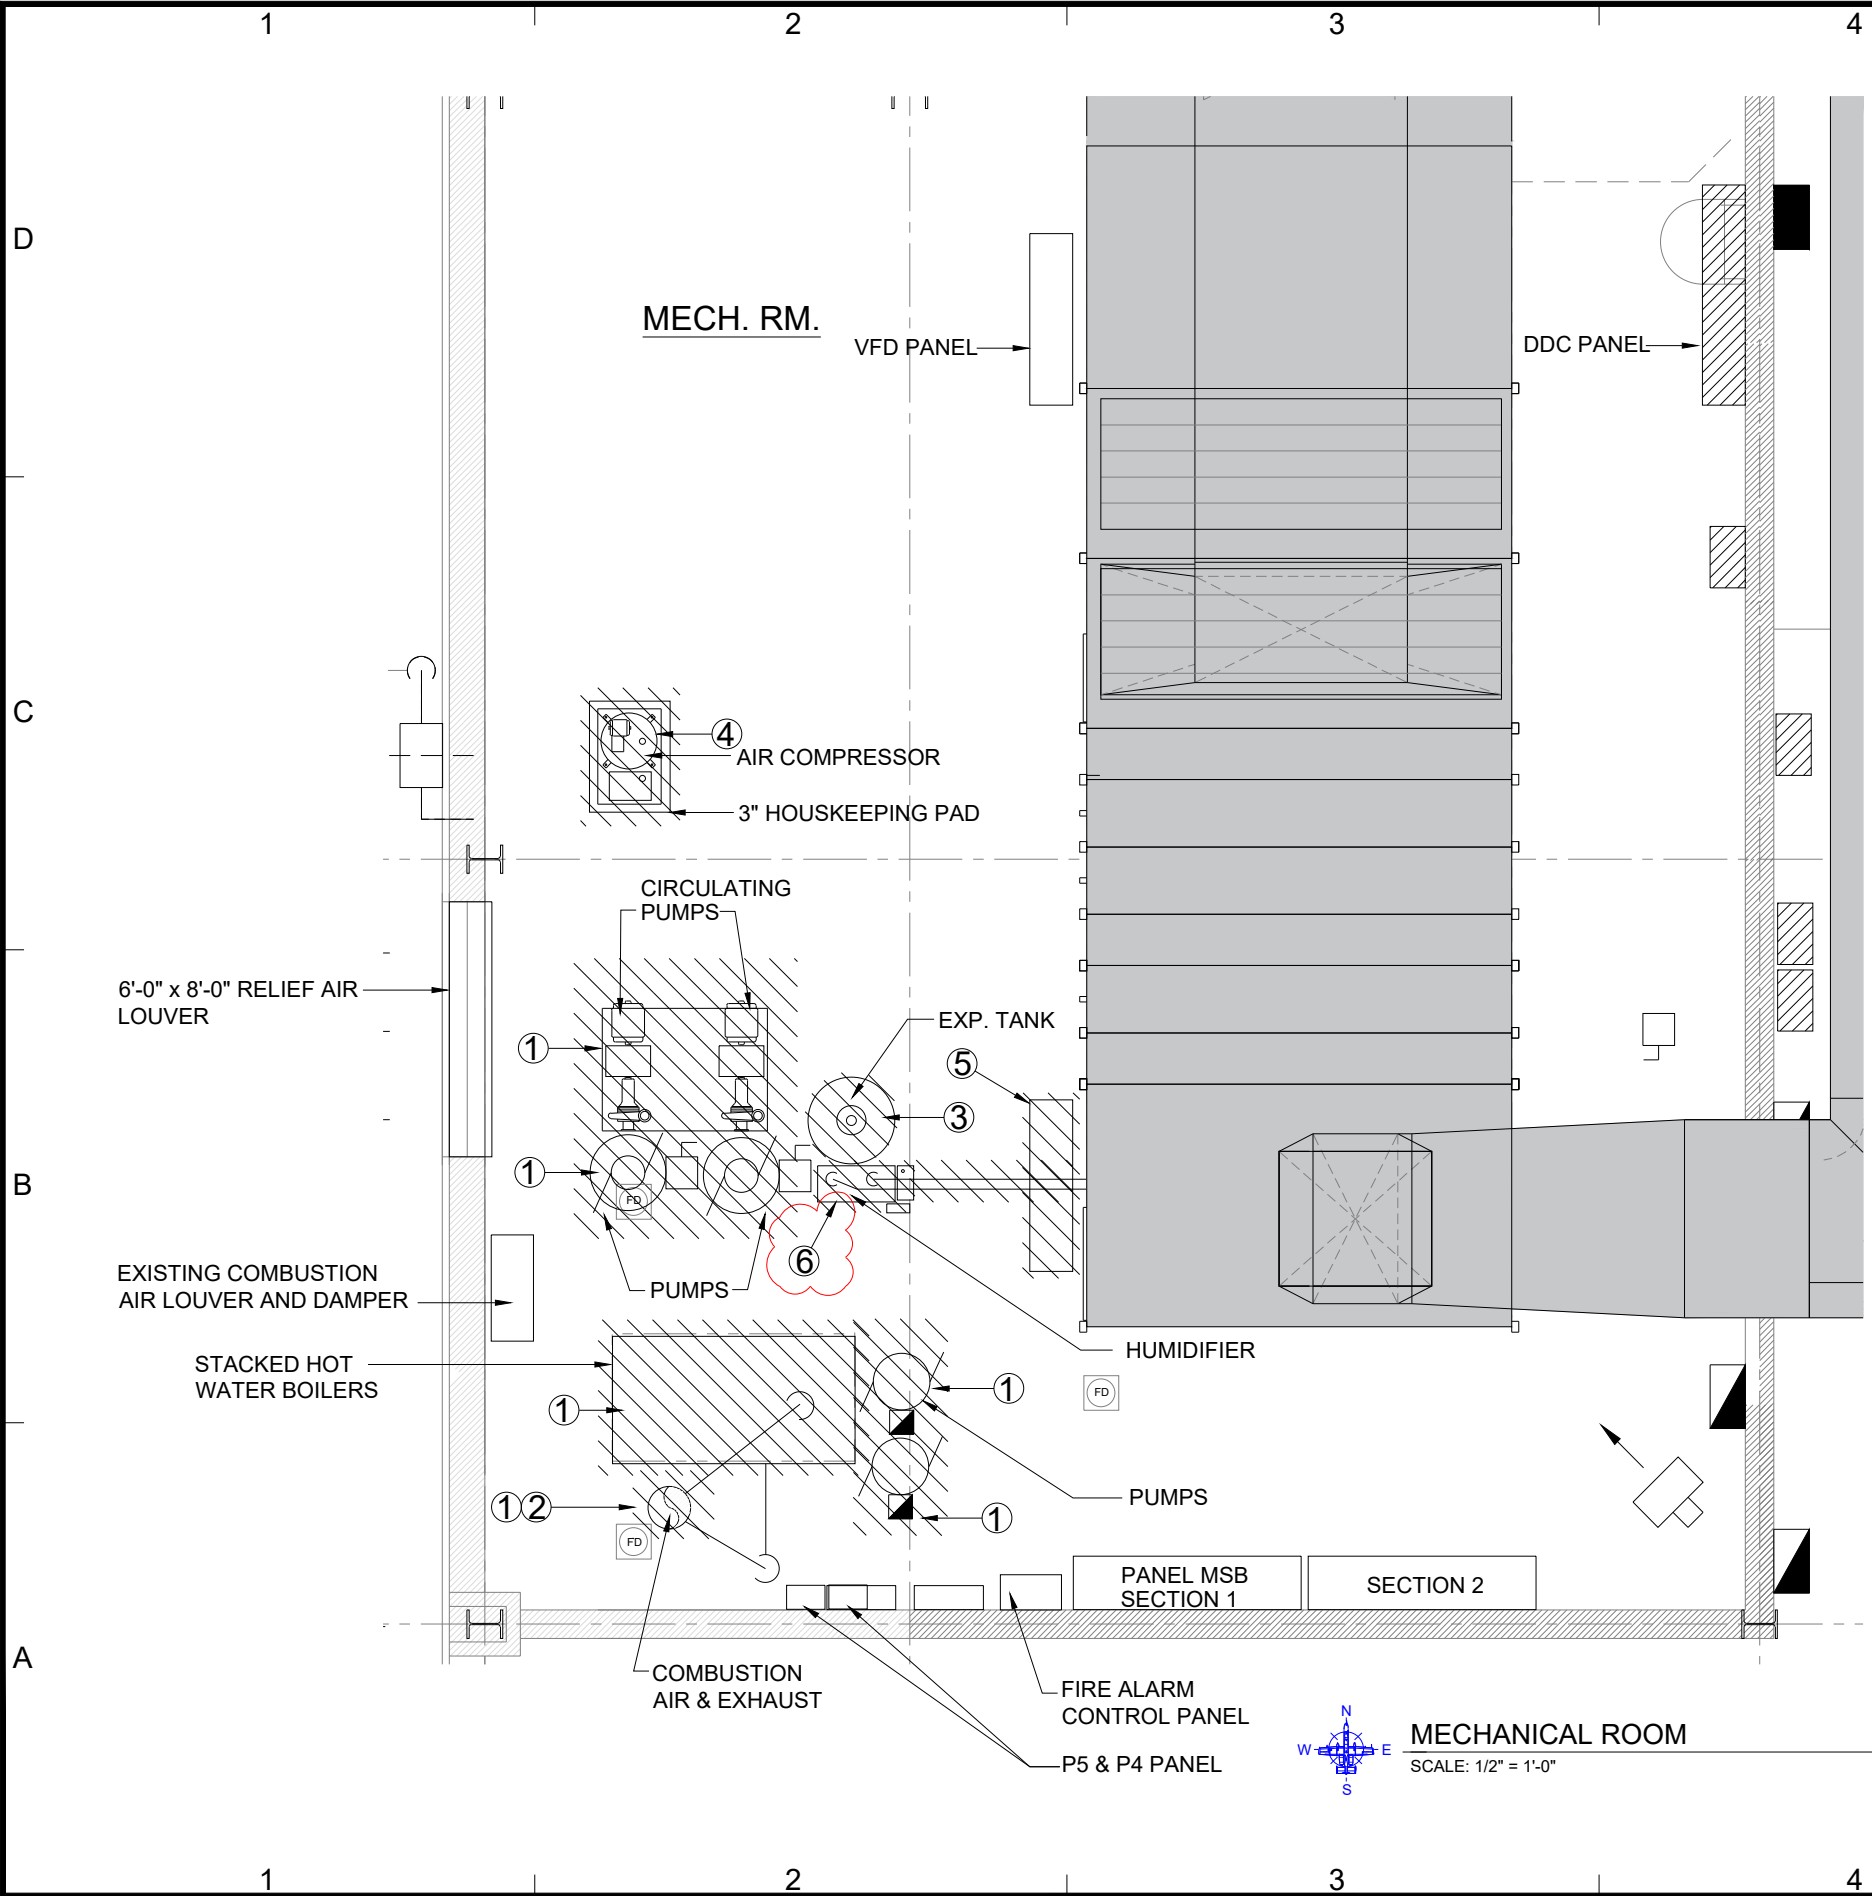

Engineer/Consultants

REVISIONS:

Mark	Date	Description
01	7/23/2025	ADDED NOTE 6
Date: 24JUL2025		
Scale: 1/2"=1'-0"		
File: -		
Project Number: VGLZ 242015		
Drawn By: J. AUSTIN		
Designed By: T. RESH		
Checked By: T. RESH		
PROJECT		

REPAIR HVAC
BLDG 105

Sheet Title

BUILDING 105
DEMO