

Classrooms: Target Criteria Daytime/Nighttime
Average Horizontal Illuminance 40 fc (400 lux) at 2'-6" (762 mm) AFF
Average Vertical Illuminance 15 fc (150 lux) at 4' (1,219 mm) AFF on presentation wall
Horizontal Illuminance Uniformity 2:1 average to minimum

Locker Room: Target Criteria Daytime/Nighttime
Average Horizontal Illuminance 5 fc (50 lux) at floor
Average Vertical Illuminance 10 fc (100 lux) at locker faces
Horizontal Illuminance Uniformity 3:1 average to minimum

Restrooms: Target Criteria Daytime/Nighttime
Average Horizontal Illuminance, General 5 fc (50 lux) at floor
Average Horizontal Illuminance, Fixtures and vanities 15 fc (150 lux) at vanity surface
Average Horizontal Illuminance, Showers 10 fc (100 lux) at floor
Horizontal Illuminance Uniformity 3:1 average to minimum


Hallways/Corridors: Target Criteria Daytime/Nighttime
Average Horizontal Illuminance 3 fc (30 lux) at floor
Horizontal Illuminance Uniformity 5:1 average to minimum

Mechanical/Boiler Rooms: Target Criteria Daytime/Nighttime
Average Horizontal Illuminance 20 fc (200 lux) at 3'-6" (1067 mm) AFF
Horizontal Illuminance Uniformity 3:1 average to minimum

Office Rooms: Target Criteria Daytime/Nighttime
Average Horizontal Illuminance 30 fc (300 lux) at 2'-6" (762 mm) AFF
Horizontal Illuminance Uniformity 2:1 average to minimum

Conference Room: Target Criteria Daytime/Nighttime
Average Horizontal Illuminance 30 fc (300 lux) at 2'-6" (762 mm) AFF
Average Vertical Illuminance 15 fc (150 lux) at 4'-0" (1524 mm) AFF
Horizontal Illuminance Uniformity 3:1 average to minimum

Storage: Target Criteria Daytime/Nighttime
Average Horizontal Illuminance 10 fc (100 lux) at floor
Average Vertical Illuminance 7.5 fc (75 lux) at 4'-0" (1219 mm) AFF
Horizontal Illuminance Uniformity 3:1 average to minimum

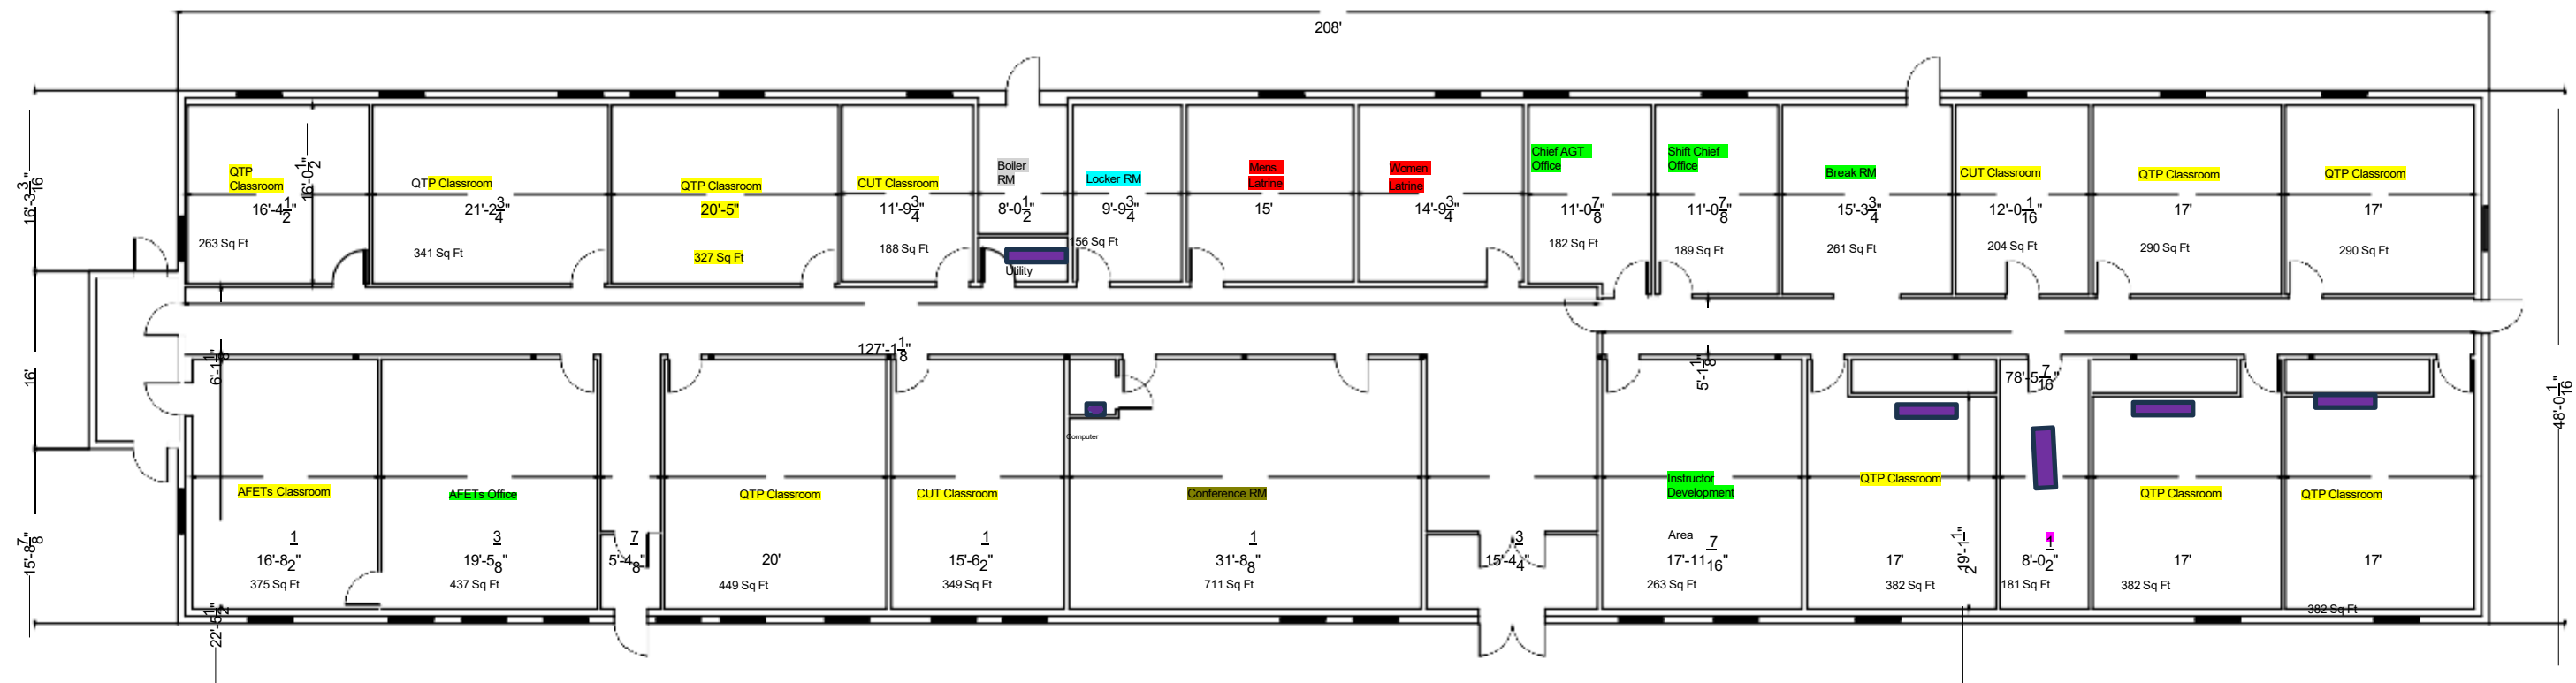

Ceiling heights: Based on existing as-built drawings; lobbies, foyers and corridors height are 7' 8"
All other spaces are 8' 8"



Project Number	Project Name	Project Date
100-100-100	Edited the computer rm. door.	3/17/2017

Project Number	Project Name	Project Date
100-100-100	Edited the computer rm. door.	3/17/2017

Project Number	Project Name	Project Date
100-100-100	Edited the computer rm. door.	3/17/2017

Project Number	Project Name	Project Date
100-100-100	Edited the computer rm. door.	3/17/2017

Project Number	Project Name	Project Date
100-100-100	Edited the computer rm. door.	3/17/2017