

Request for Information (RFI)

Title: Integration of Advanced Medium Mobile Power Sources (AMMPS) Kits

Agency: Department of the Army, Army Contracting Command – Aberdeen Proving Ground (ACC-APG), Belvoir Division

RFI Number: W909MY-26-F-TRLR

NAICS Code: 336212 - Truck Trailer Manufacturing

Response Deadline: 11 MAY 2026, 3:30 p.m. Eastern Standard Time

Contact for Questions & Submissions: Contract Specialist, Mary Suda

mary.a.suda.civ@army.mil and Contracting Officer, Shahaadah Nalls

shahaadah.c.nalls.civ@army.mil

1. INTRODUCTION AND PURPOSE

The Department of the Army is conducting market research in accordance with Federal Acquisition Regulation (FAR) Part 10 to identify sources capable of integrating Advanced Medium Mobile Power Sources (AMMPS) Kits onto either the 1-ton Light Tactical Trailer Heavy Chassis (LTT-HC) or the 2.5-ton M200A1 trailer. The Government owns the competitive Technical Data Package (TDP) for this integration, which will be provided as Government Furnished Information (GFI) under subsequent competitive action.

This RFI is for informational and planning purposes only and does not constitute a Request for Proposal (RFP) or a promise to issue an RFP in the future. The Government will not award a contract on the basis of this RFI, nor will it pay for any information submitted by respondents.

2. INSTRUCTIONS FOR RESPONDENTS

Interested parties are invited to submit a capability statement that addresses the questions in Section 3.

- **Format:** Responses should be submitted electronically in Microsoft Word or Adobe PDF format.
- **Page Limits:** The "Company Overview" section (3.1) is limited to two pages. There are no page limits for the other sections.

- **Proprietary Information:** Respondents are advised not to include proprietary or classified information. However, if a response contains information that is considered proprietary, it must be clearly marked on a page-by-page basis. The Government will handle any marked proprietary information appropriately, though its submission is at the respondent's own risk.

3. INFORMATION REQUESTED

Please provide detailed responses to the following inquiries.

3.1 Company Overview

- Company Name, CAGE Code, and UEI.
- Primary Point of Contact (Name, Title, Phone, Email).
- Company size under NAICS code 336212. Please also list any other relevant NAICS codes and your company's size under each.

3.2 Past Performance & Experience

- Describe your company's experience with integrating electrical and mechanical systems into vehicle or trailer platforms within the last 3 years.
- Provide specific examples of past projects involving the integration of power generation equipment (such as AMMPS kits or similar systems) onto trailers. Include the customer, the type of generator, and the quantity of units produced. For each project (Government or commercial), include the project name, a brief description, and its relevance to the requirements of this RFI.

3.3 Production and Integration Capabilities

- Provide the address of the facility where assembly and integration would take place.
- What is your company's maximum monthly production capacity for this type of integration?
- Describe your facility's capacity for storing trailers and generators, including any measures taken to protect them from the elements.
- Describe your company's capabilities for coordinating the shipping of the final integrated systems to their destination. What logistics and shipping methods do you typically use?

3.4 Programmatic Information

To enable respondents to develop a Rough Order of Magnitude (ROM), the Government is providing the following component details and baseline assumptions. The scope of work includes all efforts required to procure/fabricate mounting hardware, cabling, perform mechanical and electrical integration, and test the final system.

Integration Scope: The vendor is responsible for fabricating or procuring all mounting hardware, brackets, cables, and integrating/installing these components and GFE on the trailer IAW the government's TDP.

Performance Requirement: The final integrated system must be capable of being safely towed on primary and secondary roads and must meet standard military requirements for environmental durability (e.g., resistance to rain, dust, vibration).

3.4.1 Component & System Details (Government Furnished Equipment - GFE)

- Generator: AMMPS 60kW (MEP-1070A), with approximate dimensions of 75" L x 36" W x 50" H and a dry weight of 2,200 lbs. (this represents the largest generator). For all other equipment requiring integration see Appendix 1 below.
- Trailers:
 - LTT-HC (1-Ton): Flat deck with approximate usable space of 96" L x 74" W.
 - M200A1 (2.5-Ton): Chassis that will require a vendor-supplied flat deck or mounting platform. Approximate chassis length of 144".
- Detailed information is available in MIL-STD-633G, accompanying this solicitation.

3.4.2 Cost Estimate Instruction

Provide a Rough Order of Magnitude (ROM) cost estimate per system for the integration of 1) a PP-3106A Power Plant, and 2) a PU-2001A Power unit (reference appendices and MIL-STD 633G for clarifying information). This represents the most complex and least complex efforts, respectively. These estimates should be broken-down as follows:

- Non-Recurring Engineering (NRE) Cost (as a delineated cost from total cost, break down as desired for additional information).
- Recurring Per-Unit Production Cost (for each of the 50 units).
- Include a brief Basis of Estimate (BOE) explaining the methodology and assumptions used to derive your figures (e.g., estimated labor hours, material types).

- Describe any potential for cost savings or discounts based on volume (e.g., for orders of 10, 50, or 100+ units per month).
- Estimate lead time, from receipt of order, to begin initial production.

3.4.2.1 Assumptions:

- All GFE (generators, trailers with accessory boxes) will be delivered to the vendor's facility.
- The vendor is responsible for all non-recurring engineering (NRE) associated with designing the integration solution (e.g., drawings, analysis, tooling) to meet the performance requirements.
- The ROM should be based on an assumed production quantity of 50 units/system.
- The vendor is responsible for all labor, materials, and testing (e.g., factory acceptance test) required for the integration.

3.5 Engineering and Security

- Describe your company's engineering capabilities as they relate to mechanical and electrical integration.
- What quality control and inspection processes do you have in place to ensure compliance with a government-provided TDP?
- What is your company's current facility security clearance level?

3.6 Additional Information

Please provide any supplemental information that supports your company's ability to meet the requirements of this RFI. This may include commercial literature or information on human factors, engineering, safety, or other relevant topics.



Appendix 1: Total candidate systems for Integration

This lists the full potential workload of trailer/generator combinations of candidate workloads. Additional details are available in the provided MIL-STD-633G.

AMMPS A-Model NSNs			
Model	Description	NSN	LIN
MEP-1030A	Generator Set, AMMPS 5kW 50/60Hz	6115-01-679-2558	G42488
MEP-1031A	Generator Set, AMMPS 5kW 400Hz	6115-01-679-3637	Not requested
MEP-1040A	Generator Set, AMMPS 10kW 50/60Hz	6115-01-679-5145	G07461
MEP-1041A	Generator Set, AMMPS 10kW 400Hz	6115-01-679-5196	G75018
MEP-1050A	Generator Set, AMMPS 15kW 50/60Hz	6115-01679-5596	G49966
MEP-1051A	Generator Set, AMMPS 15kW 400Hz	6115-01-679-5204	G74950
MEP-1060A	Generator Set, AMMPS 30kW 50/60Hz	6115-01-679-5442	G75200
MEP-1061A	Generator Set, AMMPS 30kW 400Hz	6115-01-679-4745	G62710
MEP-1070A	Generator Set, AMMPS 60kW 50/60Hz	6115-01-679-4747	G63256
MEP-1071A	Generator Set, AMMPS 60kW 400Hz	6115-01-679-4754	G62960
PU-2001A	Power Unit, AMMPS LTT 5kW, 50/60Hz	6115-01-680-2376	L26934
PU-2002A	Power Unit, AMMPS LTT 10kW, 50/60Hz	6115-01-680-2060	L84622
PU-2012A	Power Unit, AMMPS LTT 10kW, 400Hz	6115-01-680-2283	L84758
PU-2003A	Power Unit, AMMPS LTT 15kW, 50/60Hz	6115-01-680-2322	L84690
PU-2101A	Power Unit, AMMPS M200A1, 15kW, 50/60Hz	6115-01-680-1076	T40090
PU-2111A	Power Unit, AMMPS M200A1, 15kW, 400Hz	6115-01-680-1252	T40022
PU-2102A	Power Unit, AMMPS M200A1, 30kW, 50/60Hz	6115-01-680-1168	T39954
PU-2112A	Power Unit, AMMPS M200A1, 30kW, 400Hz	6115-01-680-2318	T93300
PU-2103A	Power Unit, AMMPS M200A1, 60kW, 50/60Hz	6115-01-680-2046	T60034
PU-2113A	Power Unit, AMMPS M200A1, 60kW, 400Hz	6115-01-680-1182	T93368
PP-3001A	Power Plant, AMMPS LTT, 5kW 50/60Hz	6115-01-681-7740	L27002
PP-3101A	Power Plant, AMMPS M200A1, 5kW 50/60Hz	6115-01-681-6977	L27070
PP-3102A	Power Plant, AMMPS M200A1, 10kW 50/60Hz	6115-01-682-0892	T39849
PP-3003A	Power Plant, AMMPS 2 LTT, 15kW 50/60Hz	6115-01-681-5689	T49579
PP-3105A	Power Plant, AMMPS 2 M200A1, 30kW 50/60Hz	6115-01-682-0842	T39917
PP-3106A	Power Plant, AMMPS 2 M200A1, 60kW 50/60Hz	6115-01-682-0823	T93232
AMMPS Microgrid NSNs			
Model	Description	NSN	ZLIN
MG-5106	Power Plant, Electrical Microgrid MG-5106, Two M200A1 Trailer Mounted, 120 Kw, 50/60Hz	6115-01-666-7896	Z05741

Appendix 2: Select MIL-STD 633G excerpts

Identification Data			
Model	NSN	LIN	SSN
PU-2001	6115-01-562-3992	Z01420	R62700
Physical Characteristic			
Dimension: LWH (in)	Ship Cube (ft ³)	Wet Weight (lbs)	Ship Weight (lbs)
135 x 86 x 71	477	2221	2200
Documentation			
Technical Manual	Specification	Camouflage Drawing	Top Assembly
TM 9-6115-755-13&P		30554-04-21181	TA-04-2001

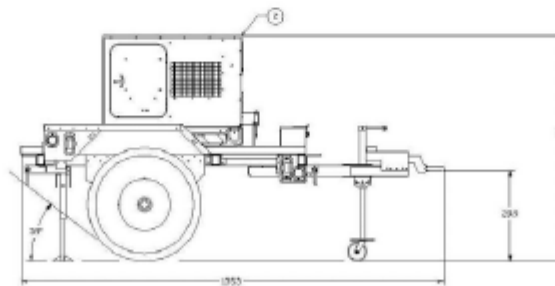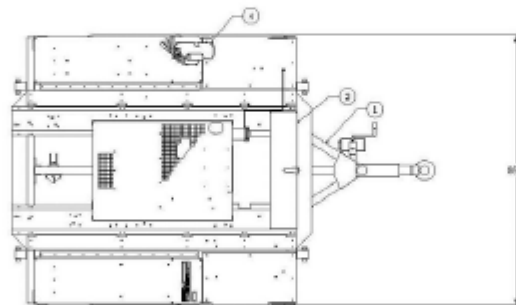

FIND NO.	COMPONENT	QTY	IDENTIFIER
1	Light Tactical Trailer (LTT)	1	97403-13230E6565
2	MEP-1030	1	6115-01-561-7329
3	Accessory box	1	97403-13229E7946
4	Fire extinguisher, 5 lb., A-A-1106	1	4210-00-270-4512


FIGURE A- 6 PU-2001 - AMMPS Power Unit, 5 kW, 60 Hz

NOTE: Find number 1-4 are GFE. Only fasteners are required to integrate.

Identification Data			
Model	NSN	LIN	SSN
PP-3106	6115-01-562-4066	Z01388	R62700
Physical Characteristic			
Dimension: LWH (in)	Ship Cube (ft ³)	Wet Weight (lbs)	Ship Weight (lbs)
165 x 96 x 89.5 each	821 each	Unit A: 5819 Unit B: 5886	Unit A: 5583 Unit B: 5650
Documentation			
Technical Manual	Specification	Camouflage Drawing	Top Assembly
TM 9-6115-759-13&P		30554-04-21310	TA-04-3106



PP-3106 – AMMPS Power Plant, 60 kW, 50/60 Hz

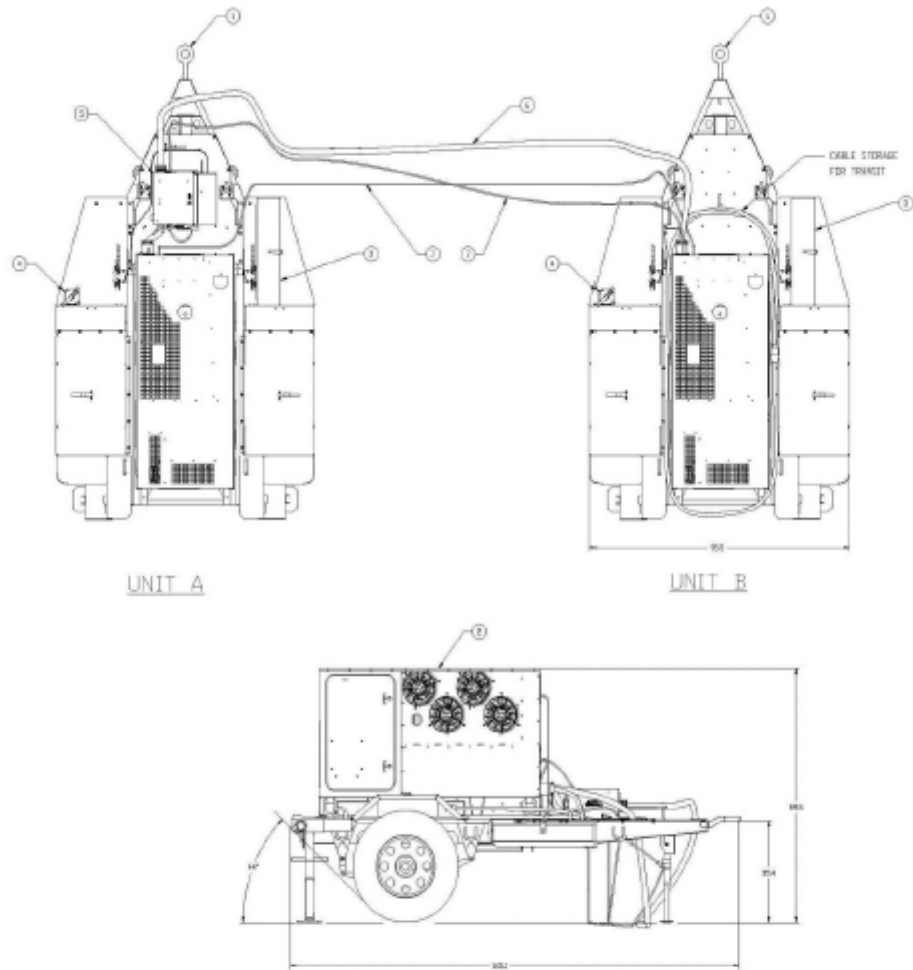

FIND NO.	COMPONENT	QTY	IDENTIFIER
1	2 1/2 Ton Modified Trailer, M200A1	2	30554-04-21234
2	MEP-1070	2	6115-01-561-7788
3	Accessory box	2	97403-13229E7946
4	Fire extinguisher, 5 lb., A-A-1106	2	4210-00-270-4512
5	Switch Box (Unit A)	1	30554-04-20840-1
6	Cable Assembly (Unit B)	1	97403-13229E5741
7	Paralleling Cable Assembly	2	30554-04-21228

PP-3106 – AMMPS Power Plant, 60 kW, 50/60 Hz

NOTE: Find Number 1-4 are provided GFE. 5-7 must be