


Calculation Summary				
Label	Cct Type	Avg	Asym%	On42
L1,Workplane	Illuminance	37.73	1.79	0
L10,Workplane	Illuminance	38.61	3.39	2.5
L11,Workplane	Illuminance	43.83	1.51	2.5
L2,Workplane	Illuminance	37.50	2.88	2.5
L3,Workplane	Illuminance	41.09	1.76	2.5
L4,Workplane	Illuminance	41.43	2.37	2.5
L6,Workplane	Illuminance	40.28	1.77	2.5
L7,Workplane	Illuminance	34.36	3.73	2.5
L8,Workplane	Illuminance	46.89	1.66	2.5
L9,Workplane	Illuminance	42.95	2.88	2.5
L20,Workplane	Illuminance	46.65	1.60	2.5
L21,Workplane	Illuminance	56.34	2.39	2.5
L3,Workplane	Illuminance	40.31	2.00	2.5
L4,Workplane	Illuminance	33.86	2.20	2.5
L5,Workplane	Illuminance	42.56	1.79	2.5
L6,Workplane	Illuminance	44.31	1.94	2.5
L7,Workplane	Illuminance	40.49	3.54	2.5
L7, AET OFF, Workplane	Illuminance	30.62	2.88	2.5
AET VERT	Illuminance	13.80	1.36	4
AET Workplane	Illuminance	38.88	2.67	2.5
BLC Workplane	Illuminance	0.00	N/A	3.5
BPR BLC Workplane	Illuminance	30.08	2.13	2.5
CLOSET LRP	Illuminance	12.82	2.44	0
CLOSET LRP Workplane	Illuminance	15.59	1.53	0
CLOSET LRP Workplane	Illuminance	13.34	1.71	0
CLOSET LRP Workplane	Illuminance	21.90	3.17	0
WORKN Workplane	Illuminance	29.60	1.80	0
PN1 VERT	Illuminance	16.69	1.37	4
PN1 L VERT	Illuminance	15.43	1.05	4
PN1 R VERT	Illuminance	15.30	1.09	4
PN1 R VERT	Illuminance	15.66	1.04	4
PN1 R VERT	Illuminance	11.63	1.14	4
PN1 R VERT	Illuminance	15.79	1.05	4
PN1 VERT	Illuminance	16.05	1.14	4
PN1 VERT	Illuminance	12.36	1.08	4
PN1 VERT	Illuminance	10.86	1.07	4
PN1 VERT	Illuminance	15.46	1.12	4
PN1 VERT	Illuminance	17.64	1.19	4
PN1 VERT L	Illuminance	15.64	1.15	4
PN1 VERT	Illuminance	14.35	1.09	4
STORAGE CLOAK Workplane	Illuminance	38.63	1.75	0
UTL Workplane	Illuminance	20.90	1.11	0
VERT Workplane	Illuminance	21.44	1.49	0
WORKN Workplane	Illuminance	29.60	1.67	0

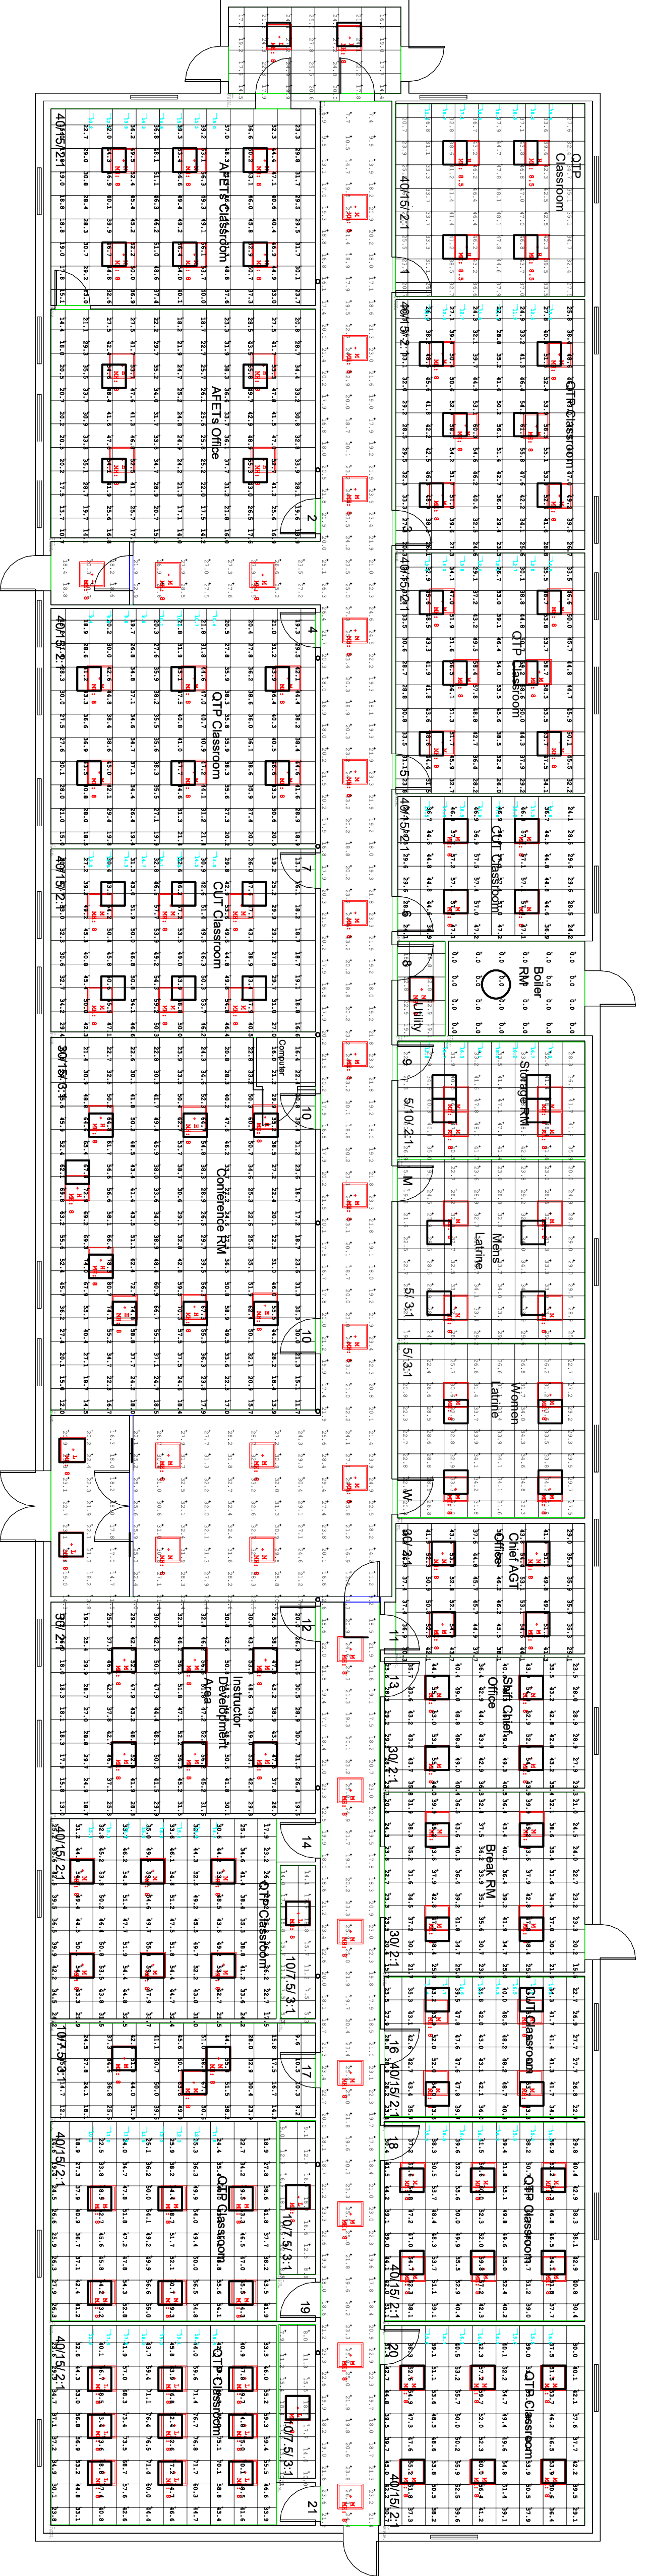

Luminaire Schedule				
Symbol	Qty	Type	Description	
	16	H	2-4 footcandle architectural reflect, round acrylic	
	17	L	2-22 footcandle architectural reflect, round acrylic	
	119	M	11-9 footcandle architectural reflect, round acrylic	
			lum, medium output ceiling, 30K	
			COLUMBIA LIGHTING	
			LCAT23-LDC5, MED, 3500K	
			When	Lumens
			32	4227
			19.2	2714
			22.8	3162

LFD Area Summary				
Label	Area	Total Watts	LFD	
L1,LFD	263.17	128	0.49	
L6,LFD	711.23	298	0.38	
L11,LFD	177.64	91.2	0.51	
L2,LFD	403.50	136.8	0.34	
L3,LFD	188.35	91.2	0.48	
L4,LFD	332.57	136.8	0.42	
L6,LFD	262.47	91.2	0.45	
L7,LFD	180.32	68.39999	0.38	
L8,LFD	268.16	136.8	0.47	
L9,LFD	322.51	136.8	0.42	
L20,LFD	269.56	136.8	0.47	
L21,LFD	324.51	172.8	0.53	
3,LFD	346.59	136.8	0.40	
4,LFD	446.17	136.8	0.30	
5,LFD	327.29	136.8	0.42	
6,LFD	187.53	91.2	0.49	
7,LFD	346.05	136.8	0.39	
AET OFF, LFD	437.08	128	0.29	
AET LFD	372.48	136.8	0.36	
BLC LFD	52.66	0	0.00	
BPR BLC LFD	260.45	91.2	0.35	
CLOSET LFD	39.46	19.2	0.49	
CLOSET LFD	49.76	19.2	0.47	
CLOSET LFD	46.69	19.2	0.47	
CORNR LFD	16.68	591.9999	0.35	
MEN LFD	242.70	91.2	0.39	
STORAGE CLOAK LFD	143.71	91.2	0.70	
UTL LFD	32.42	22.8	0.70	
VERT LFD	197.46	39.4	0.38	
WORKN LFD	233.30	91.2	0.39	