


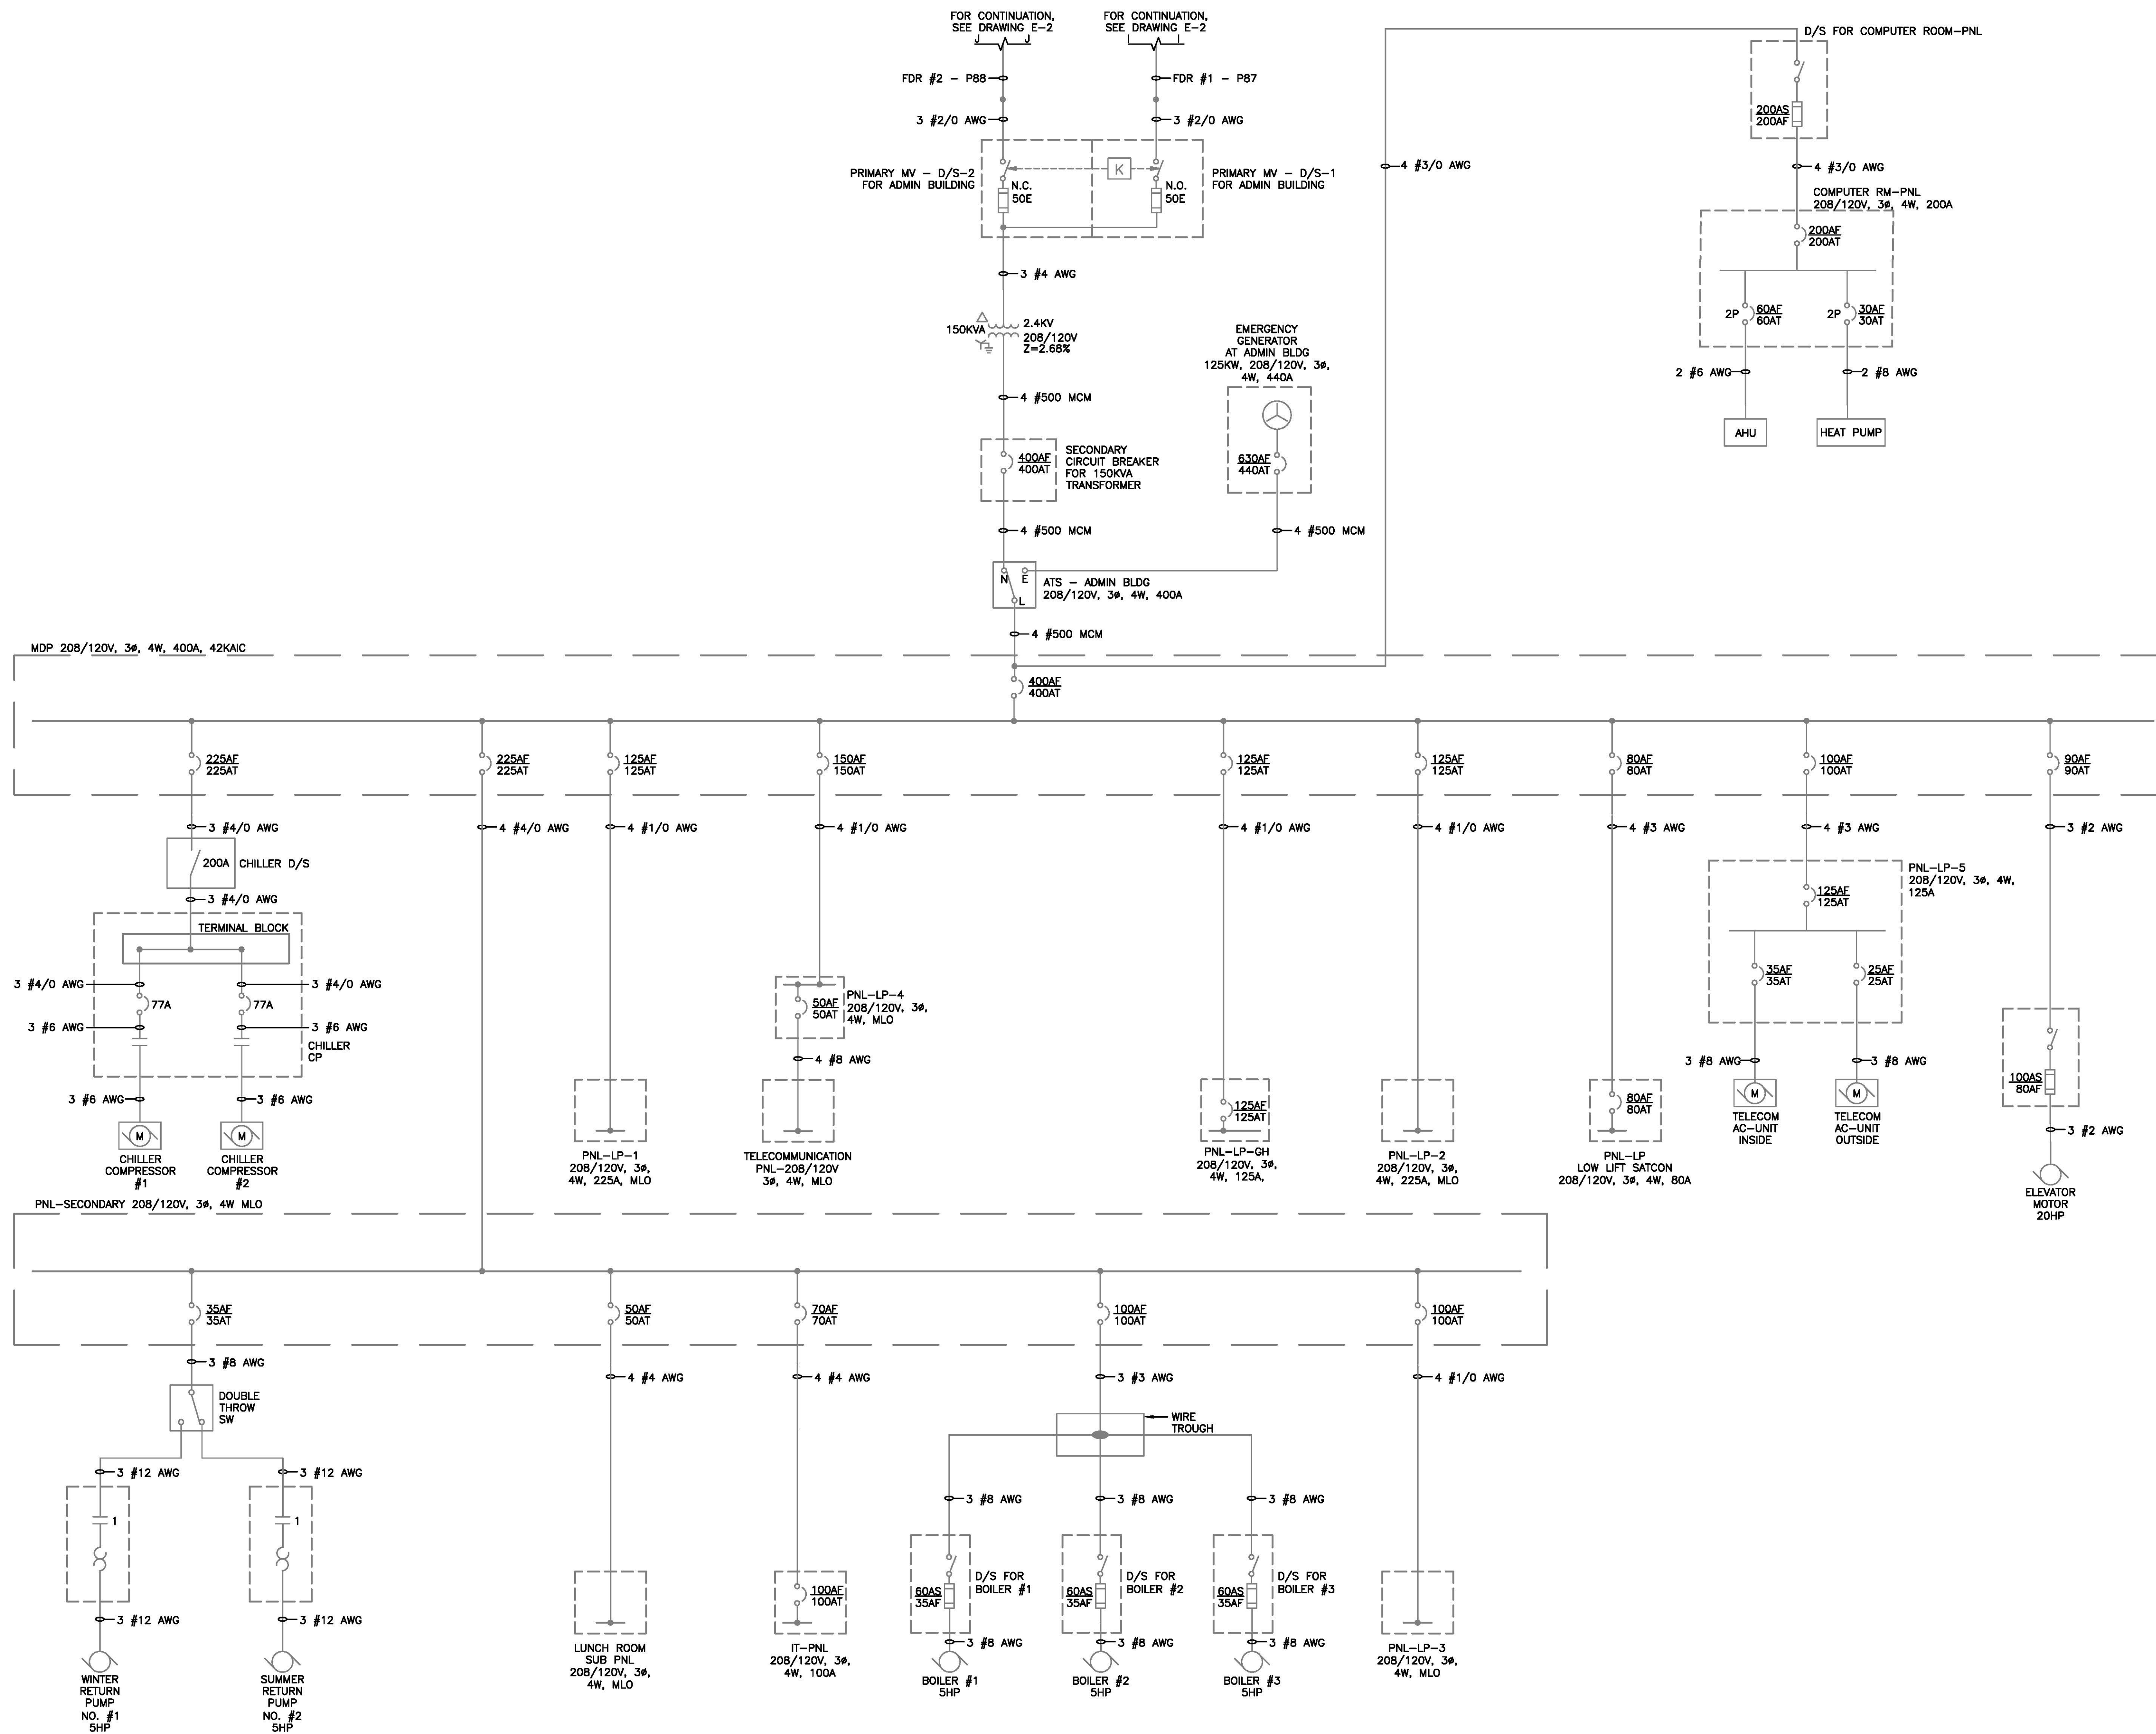

GENERAL NOTES:

1. FOR SYMBOLS AND ABBREVIATIONS, SEE DRAWING E-1.


ADMIN BUILDING - ONE-LINE DIAGRAM - EXISTING

SCALE: NONE


SHAH & ASSOCIATES ENGINEERS CONSULTANTS

418 NORTH FREDERICK AVENUE
GAITHERSBURG, MARYLAND 20877 (301) 926-2797


REV	DATE	DESCRIPTION	BY
U.S. ARMY ENGINEER DISTRICT, BALTIMORE CORPS OF ENGINEERS BALTIMORE, MARYLAND WASHINGTON AQUEDUCT DALECARLIA WATER TREATMENT PLANT, WASHINGTON D.C. ARC FLASH SAFETY IMPROVEMENTS ADMIN BUILDING ONE-LINE DIAGRAM - EXISTING			
DESIGNED BY: HFM	DRAWING NUMBER: XX.XX-X.XX-XX	PLATE: XX	
CAD BY: AJS			
CHECKED BY: KRS			
SCALE: NONE	DATE: 12/04/2017	SHEET: E-7	

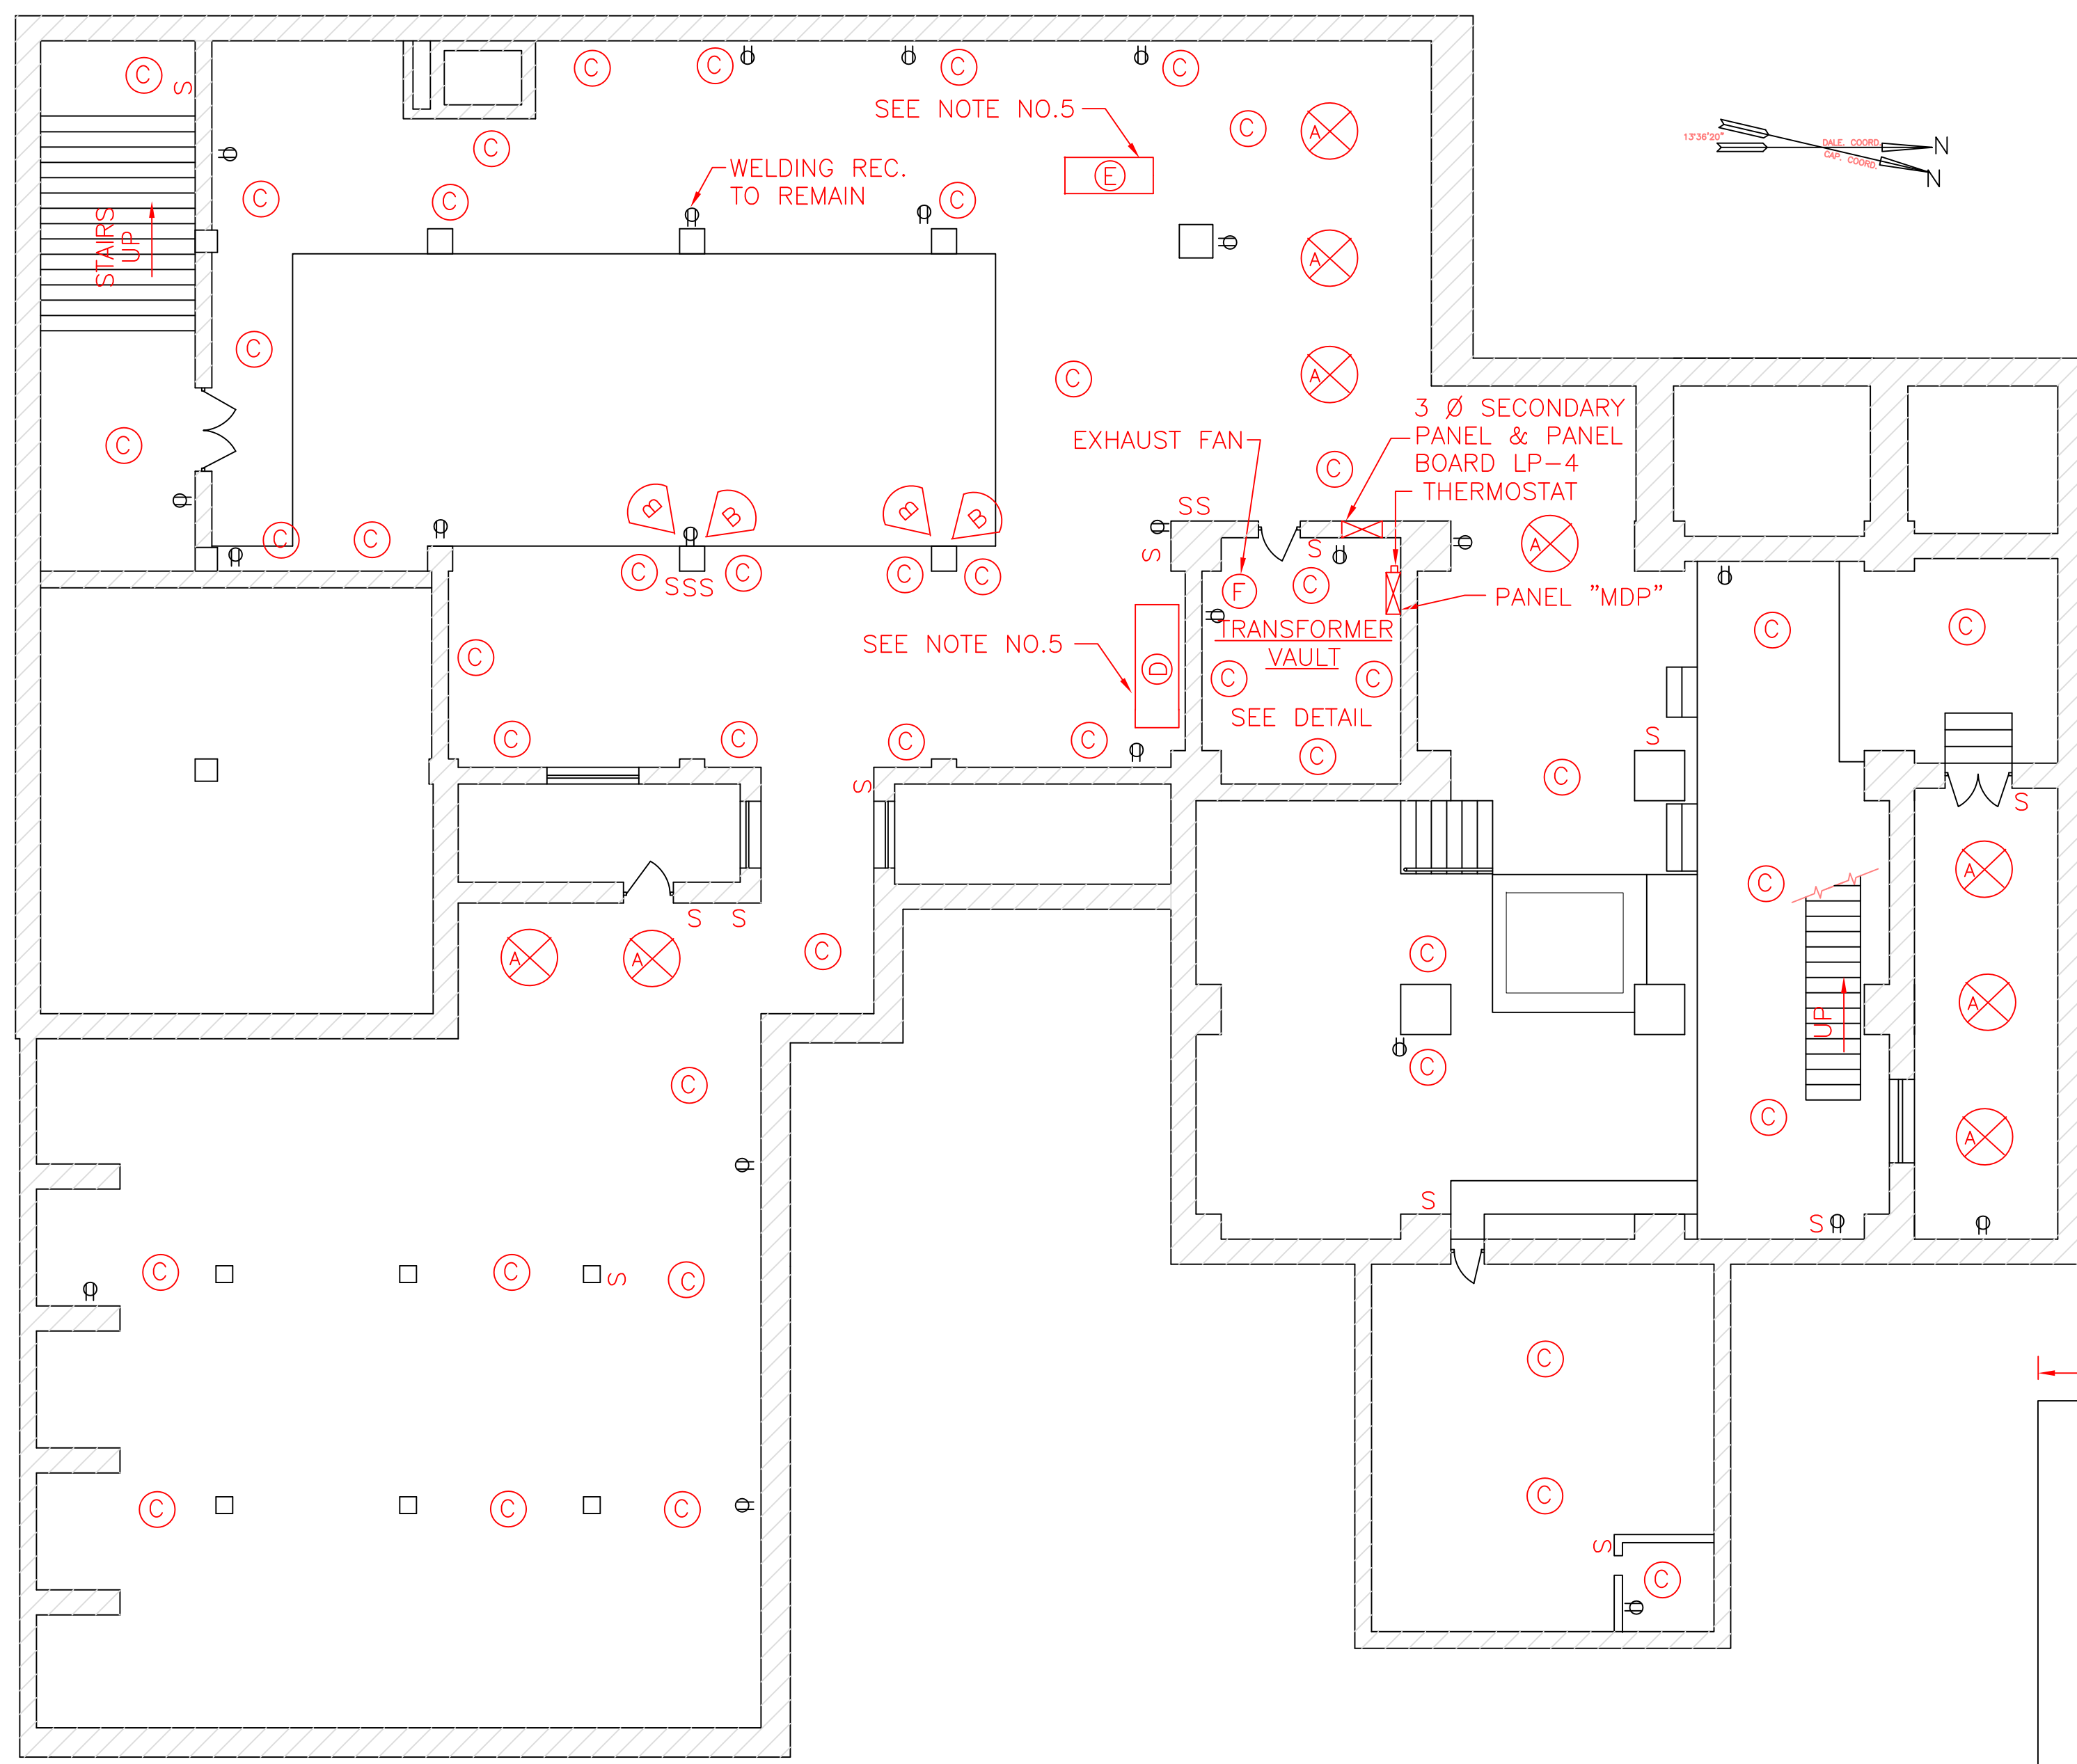


DEMOLITION/REMOVAL BASEMENT PLAN
SCALE: 1/8" = 1'-0"

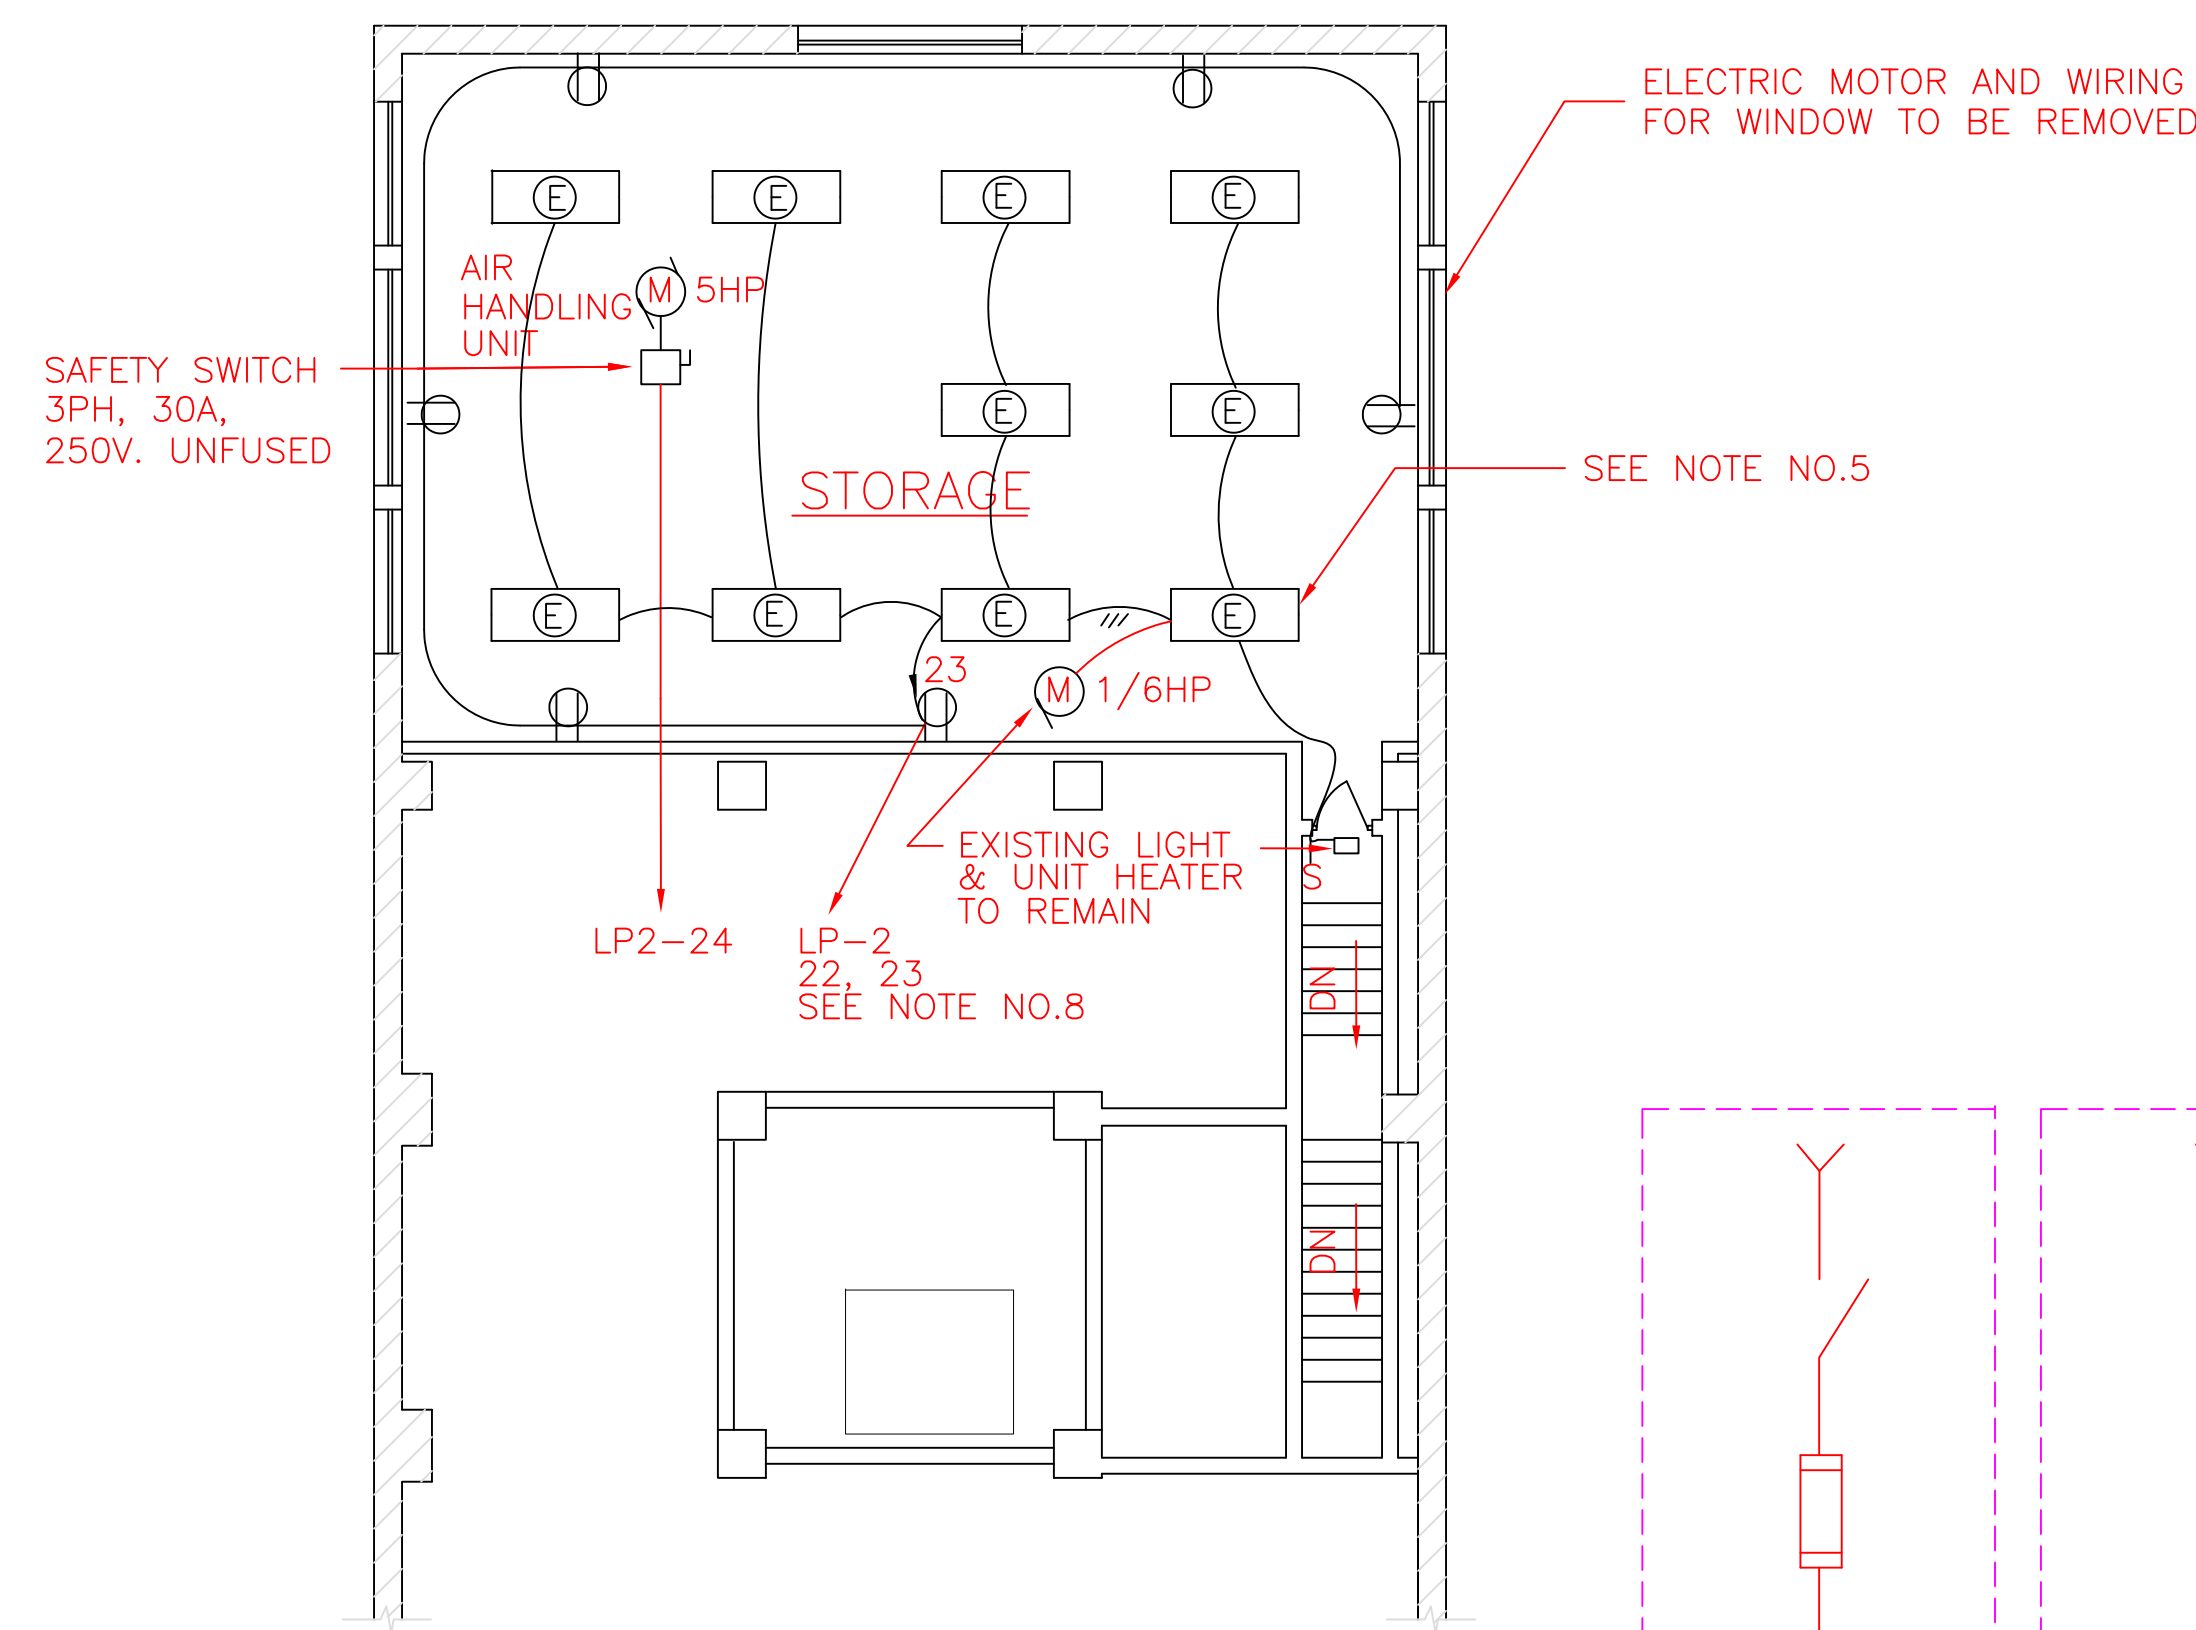


DEMOLITION/REMOVAL THIRD FLOOR PLAN
SCALE: 1/8" = 1'-0"

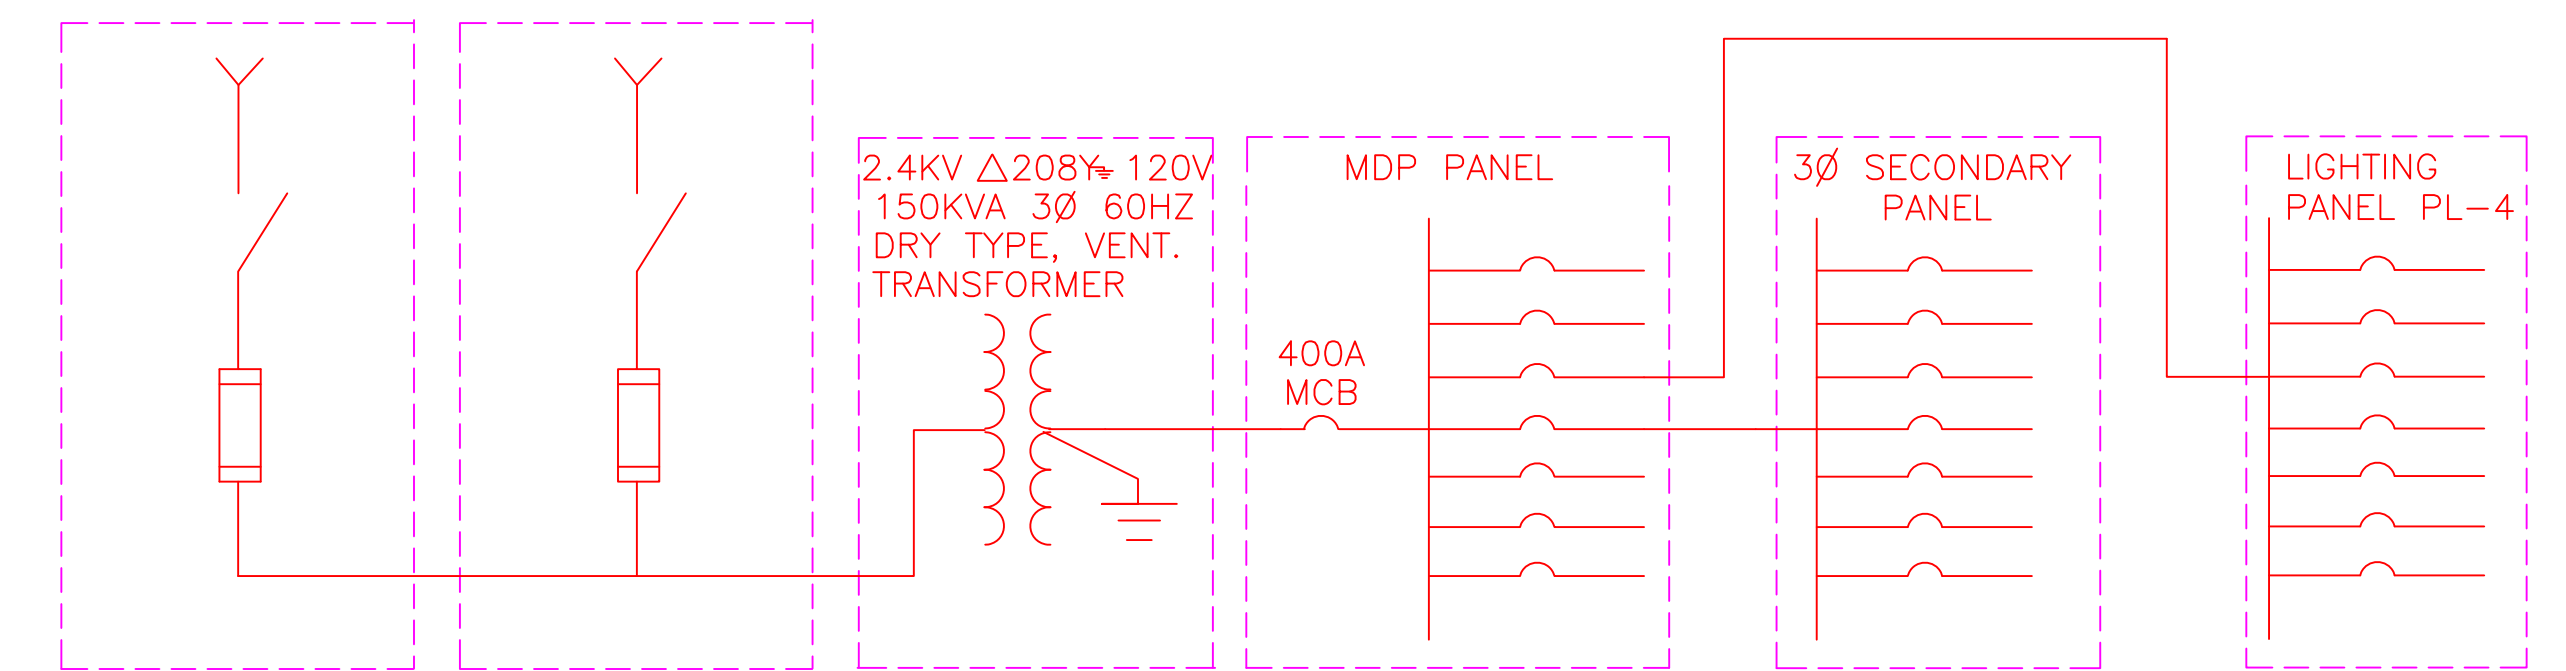

ONE-LINE DIAGRAM

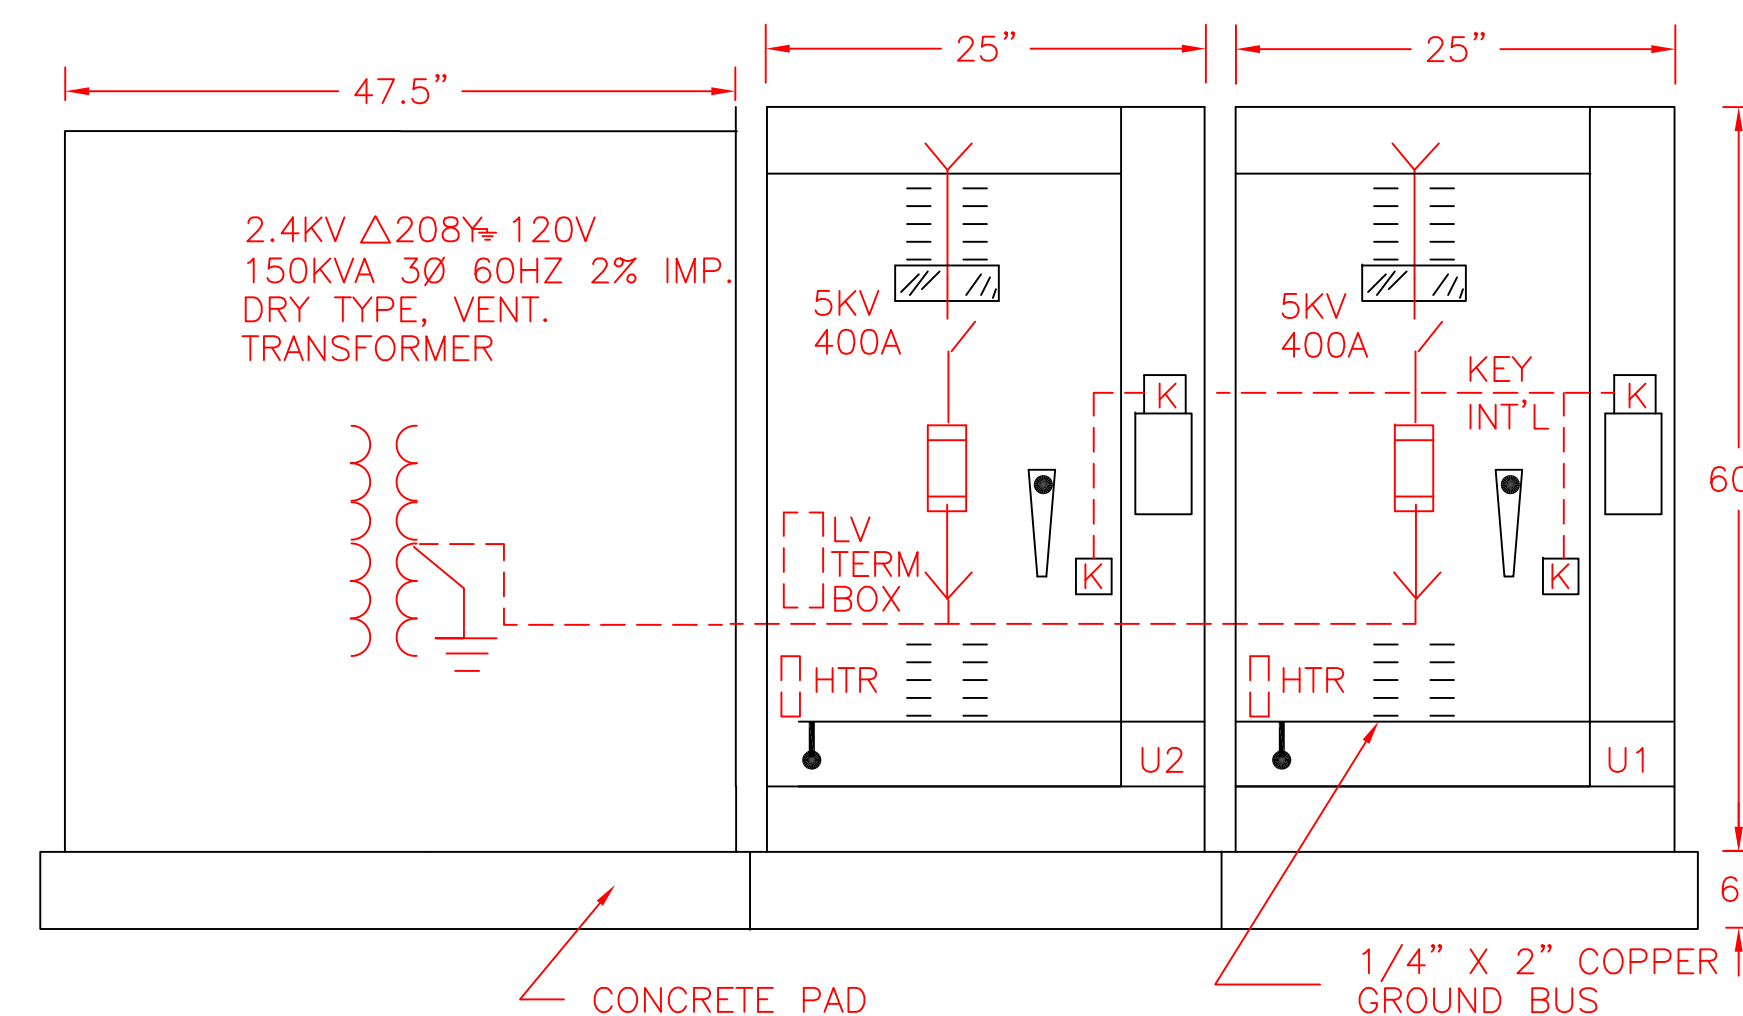


ELEVATION
1/8" = 1'-0"
N.T.S.

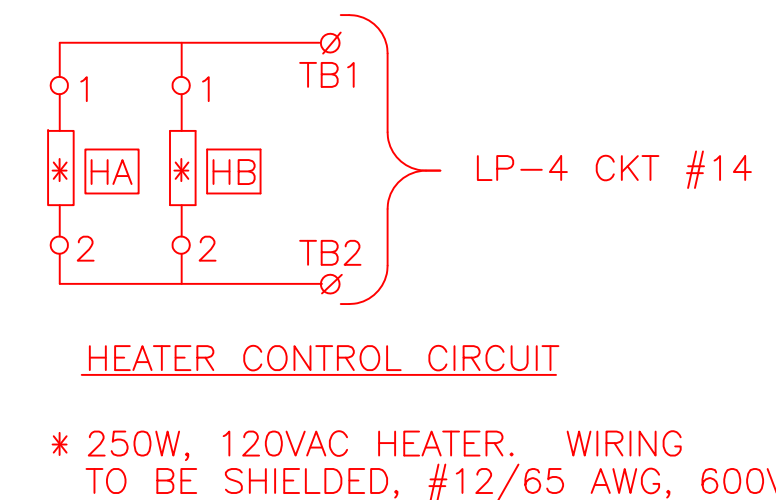


HEATER CONTROL CIRCUIT

DEMOLITION/REMOVAL LEGEND:

- (X) INCANDESCENT WITH PANREFLECTOR
- (B) FLOOD INCANDESCENT
- (C) STANDARD INCANDESCENT WITH /WITHOUT GUARD AND RECEPTACLE
- (D) FLUORESCENT - 96-INCH LENGTH
- (E) FLUORESCENT - 48-INCH LENGTH
- (P) DUPLEX RECEPTACLE 120V
- (F) EXHAUST FAN
- (PB) PANEL BOARD
- (OT) 3-75KVA OIL TRANSFORMERS
- (TS) TRANSFORMER SWITCH AND OIL FUSE

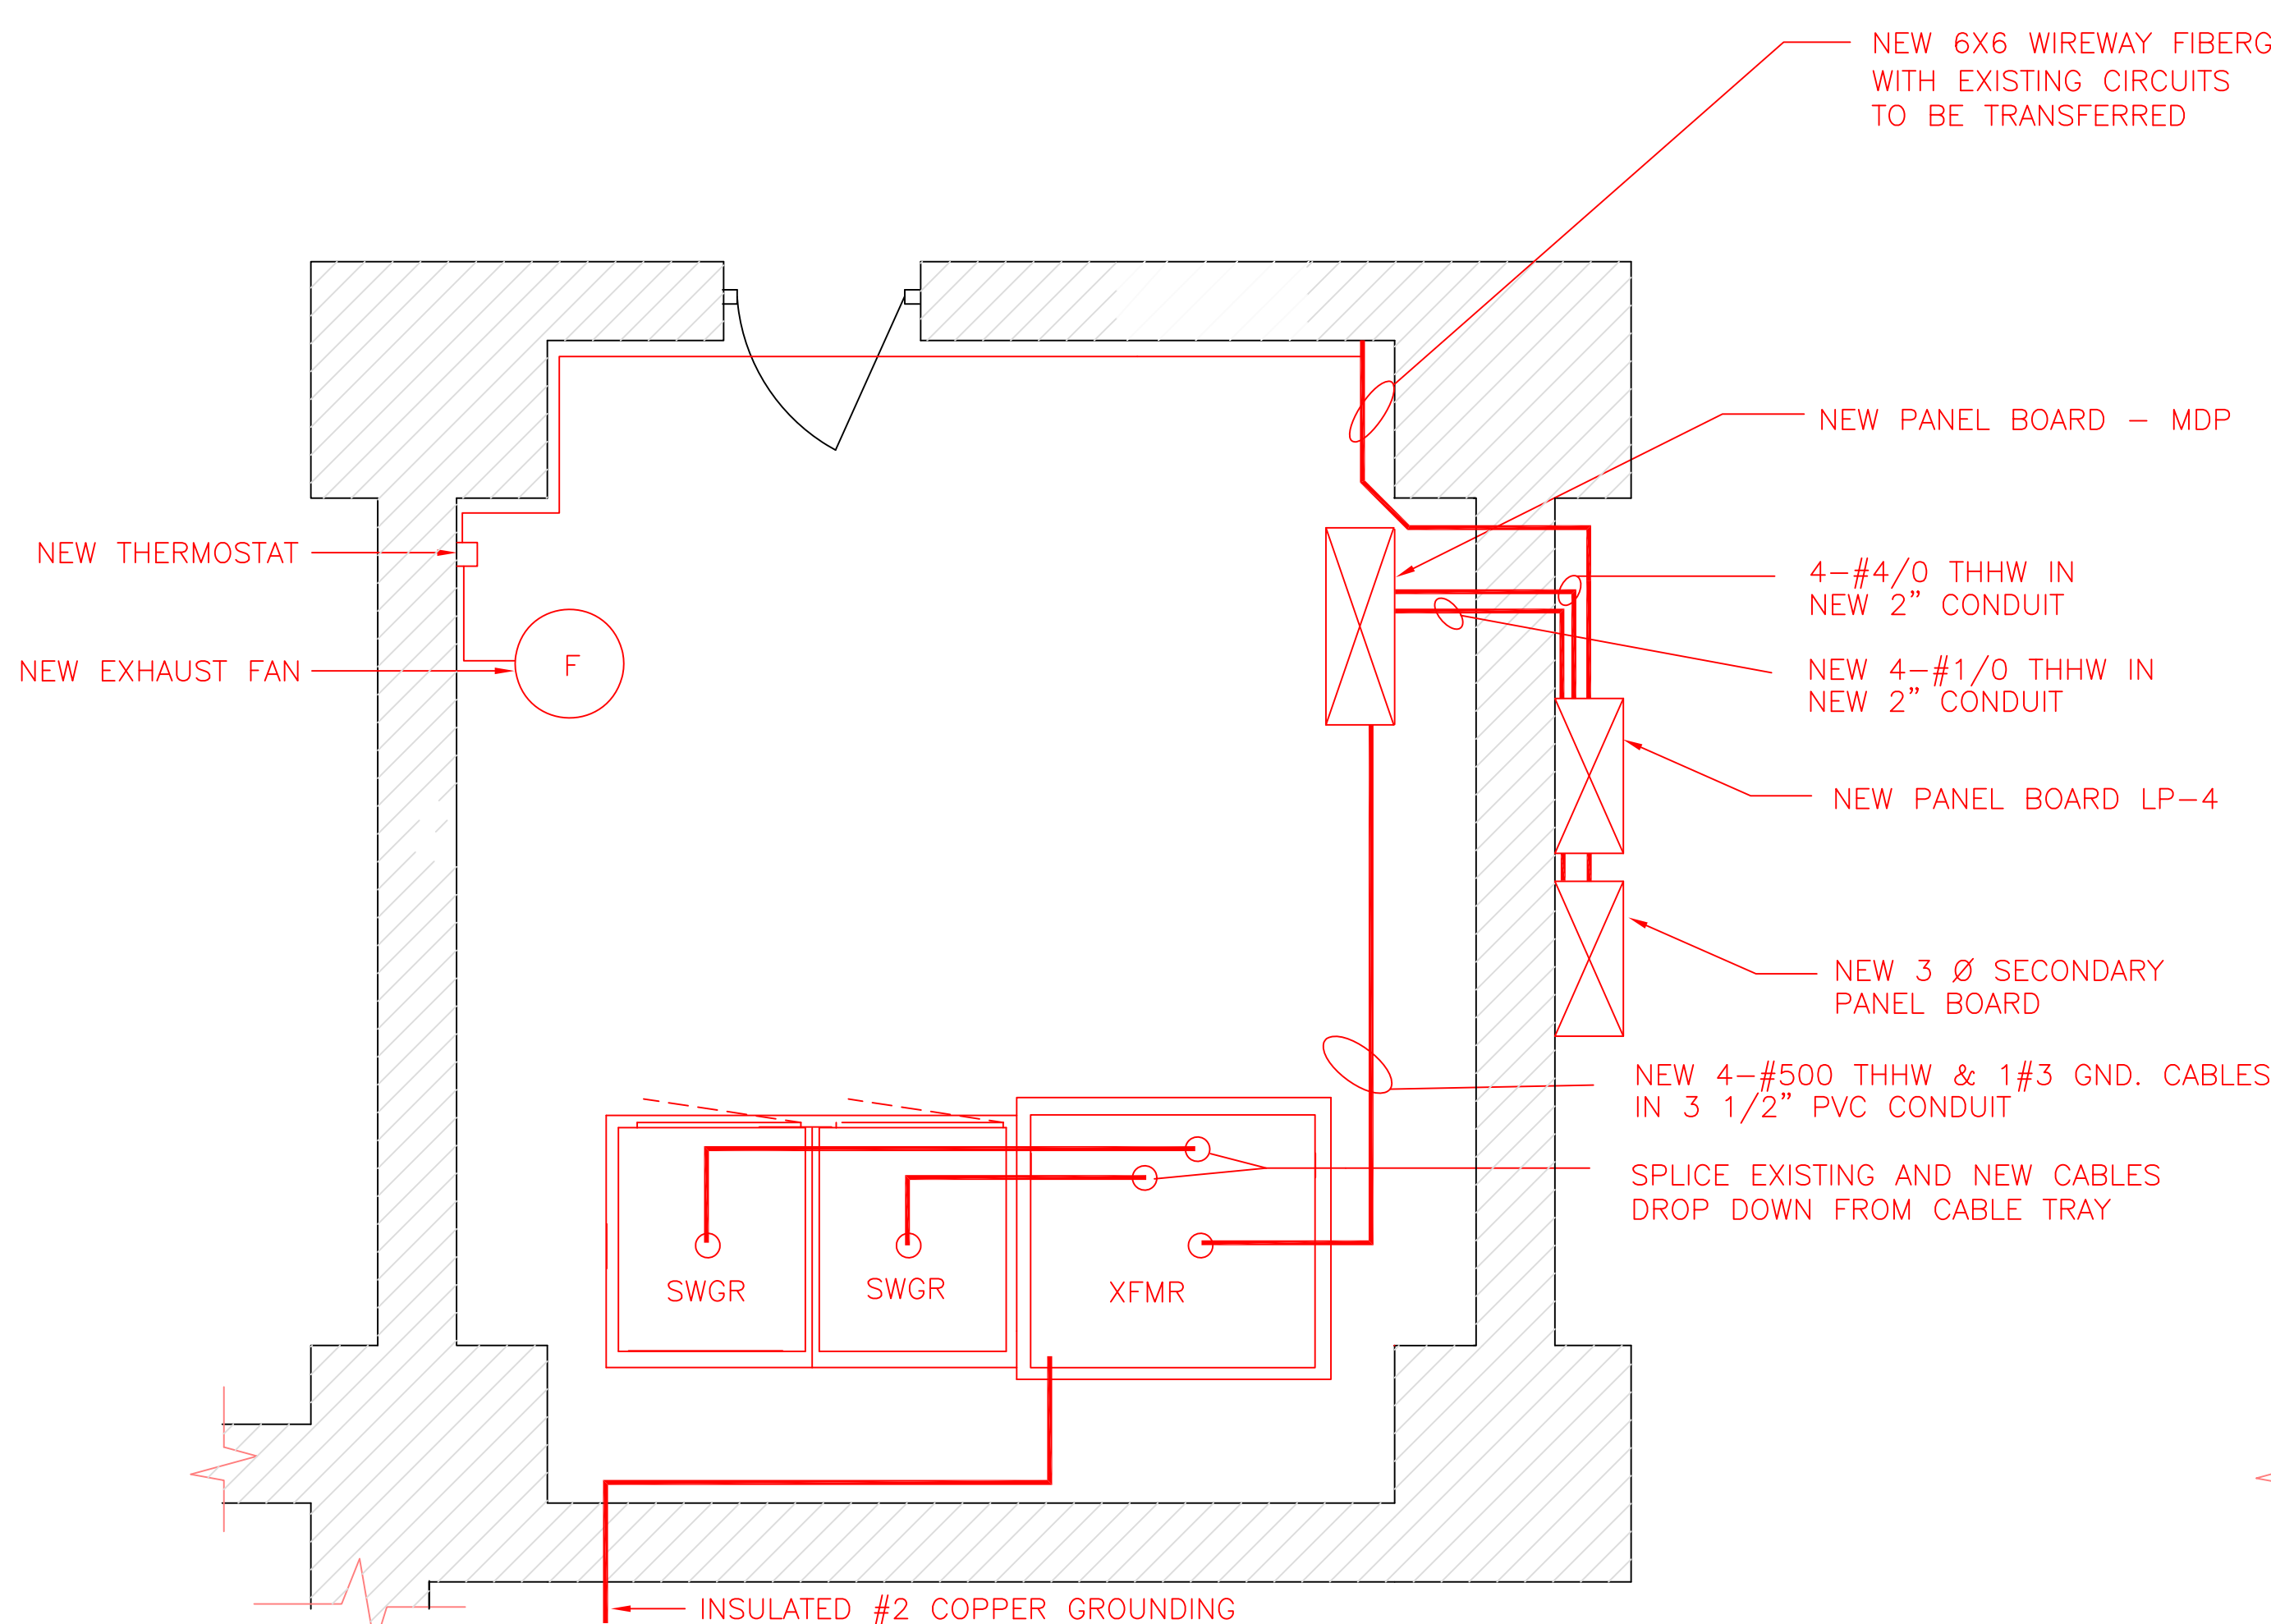


NEW TRANSFORMER AND DISCONNECT SWITCH DETAIL
N. T. S.
SK-4

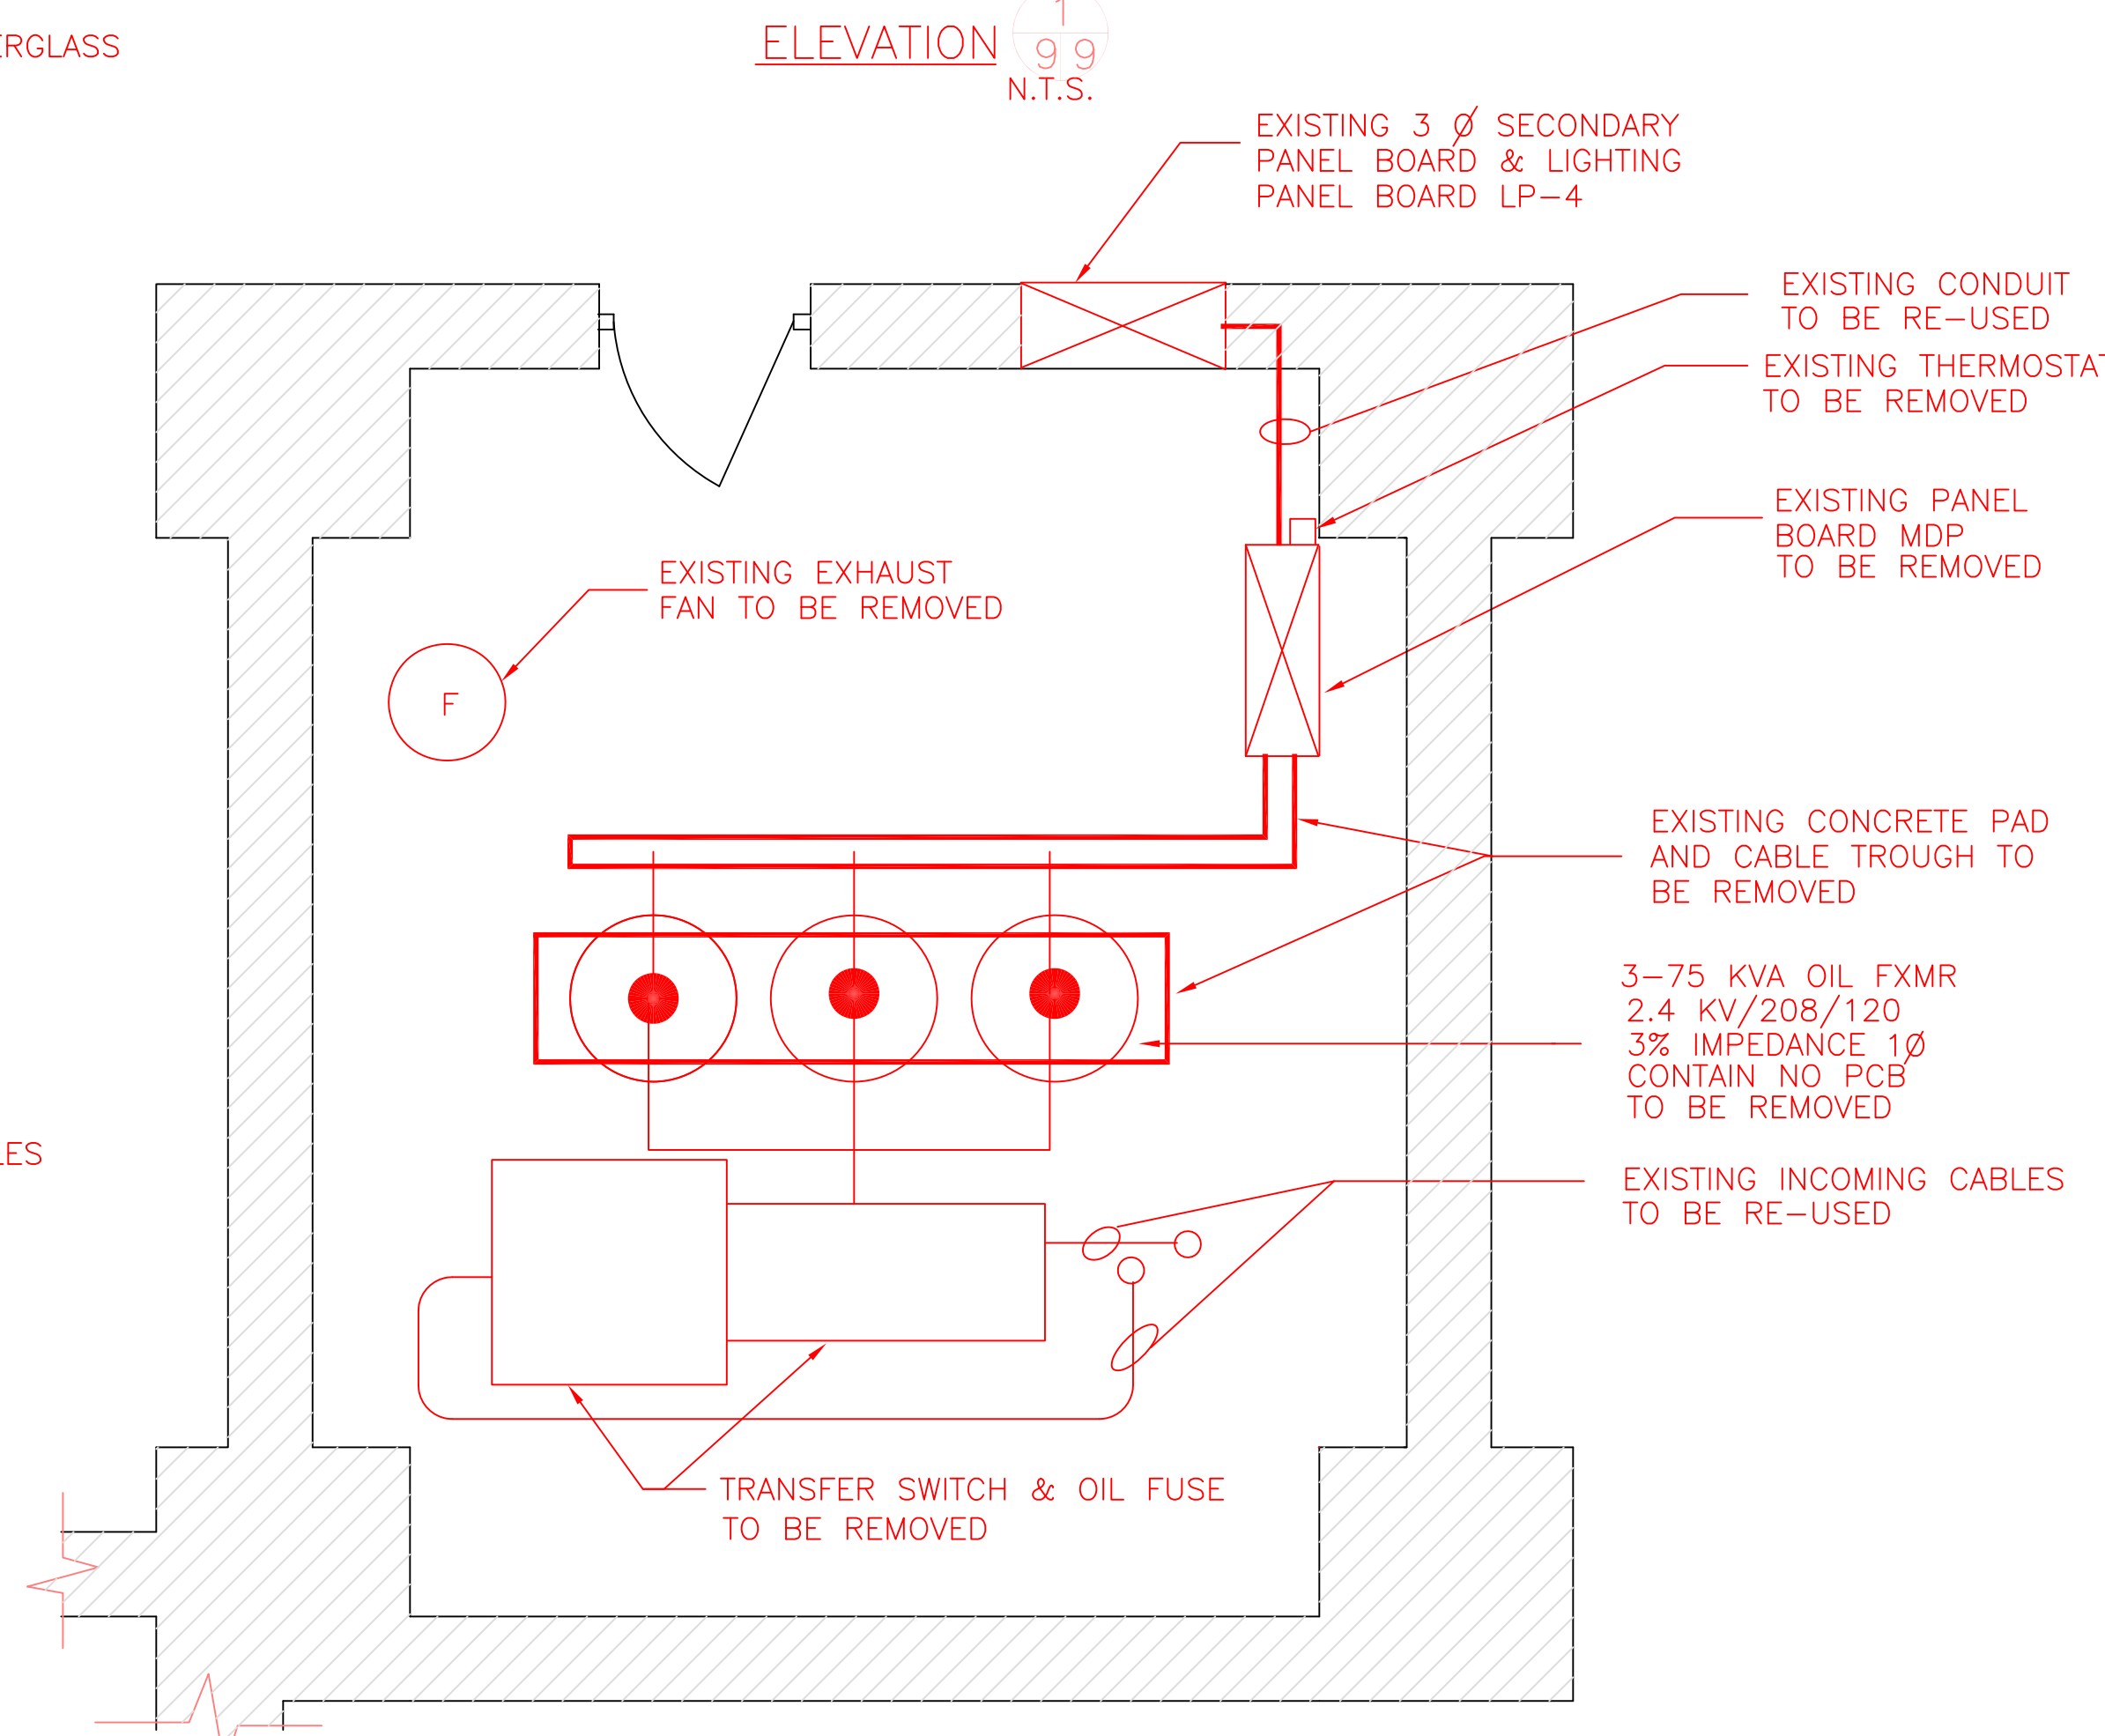

EXISTING TRANSFORMER AND TRANSFER SWITCH DETAIL
SCALE: 1/2" = 1'-0"

NOTES:

- 1) THE CONTRACTOR SHALL PROVIDE NEW CONCRETE PADS FOR SWITCHGEAR AND TRANSFORMER. THE NEW CONCRETE PADS SHALL BE SECURED TO EXISTING FLOOR SLAB.
- 2) ALL LIGHTING FIXTURES, PANELBOARDS, MOTORS, AND DEVICES INDICATED, ARE TO BE REMOVED UNLESS OTHERWISE INDICATED.
- 3A) REMOVAL OF EXISTING BRANCH-CIRCUIT WIRING AND RACEWAYS AS REQUIRED.
- 3B) THE EXISTING FEEDERS AND BRANCH-CIRCUITS CONNECTED TO EXISTING PANELS TO BE REMOVED, SHALL BE RECONNECTED TO NEW PANELS AS INDICATED ON SHEET E-3, PLATE 11.
- 4) EXISTING GROUNDING SHALL BE RE-USED FOR NEW TRANSFORMER AND SWITCHGEARS.
- 5) ASSUME THE BALLASTS OF THE EXISTING FLUORESCENT LIGHTING FIXTURES ARE POLYCHLORINATED BIPHENYL (PCB) CONTAMINATED. BALLASTS SHALL BE HANDLED AS HAZARDOUS WASTE AND REMOVE AND DISPOSITION SHALL COMPLY WITH ALL APPLICABLE LOCAL, STATE FEDERAL REGULATIONS.
- 6) REPLACE ALL EXISTING FIXTURES, BOXES, RECEPTACLES, SWITCHES, CONDUIT AND WIRING.
- 7) REPLACE LIGHTING PANEL, MDP PANELS, TRANSFORMER SELECTOR SWITCH, CONDUIT AND CABLES.
- 8) HOME RUN LP-2 - 22, 23 SHALL BE REPLACED WITH NEW.

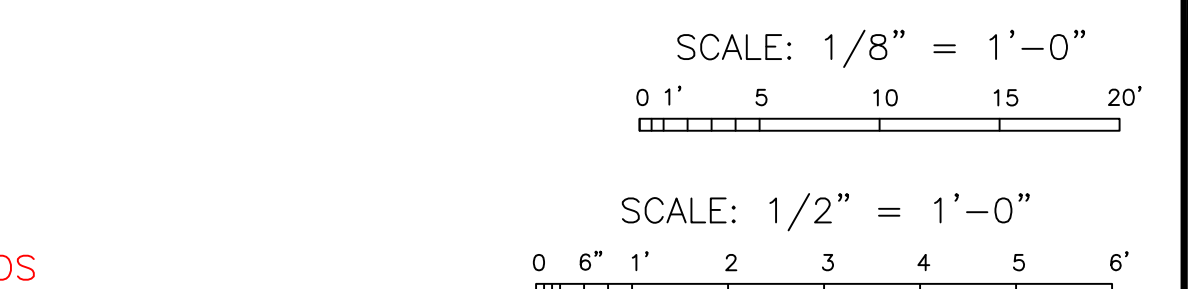

RECORD DRAWING "AS-BUILT"
COASTAL GUNITE CONSTR CO.-CONTRACTOR

REV	DATE	DESCRIPTION	BY
10/19/2000	AS BUILT CHANGES NONE	S.K.	
U.S. ARMY ENGINEER DISTRICT, BALTIMORE CORPS OF ENGINEERS BALTIMORE, MARYLAND			
WASHINGTON AQUEDUCT DALECARLIA WATER TREATMENT PLANT, WASHINGTON, D.C. ADMINISTRATION BUILDING IMPROVEMENTS BASEMENT AND THIRD FLOOR-EXISTING LIGHTING PLANS, ONE LINE DIAGRAM ELECTRICAL			
DESIGNED BY: J.H.	CAD BY: J.H., M.T.	DRAWING NUMBER: 40.13-3.11-13	PLATE: 9
CHECKED BY: N.C.			
SCALE: AS SHOWN	DATE: APR. 1999	SHEET: E-1	





