


Audit Separation Panel: LAMP distinguishes null controls, valid signal and contamination sentinels

Null / weak

Valid signal

Leakage / ceiling

IRIS / Neumayer III

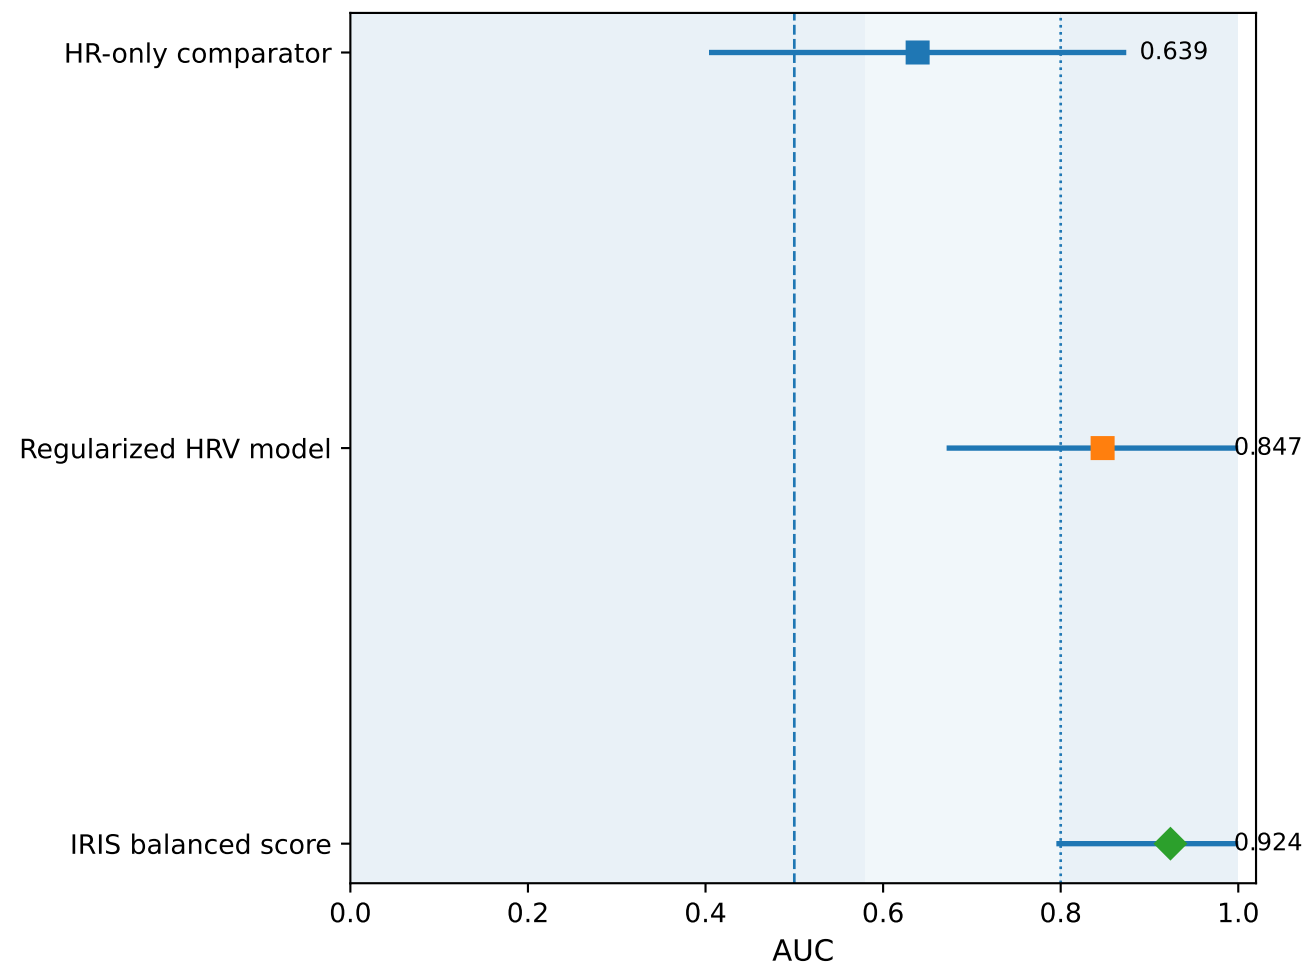

Null / weak

Valid signal

Leakage / ceiling

PhysioNet/CinC 2019 Sepsis

