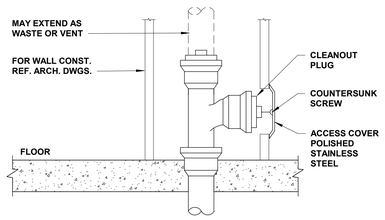


7 WALL CLEANOUT

SCALE: NOT TO SCALE

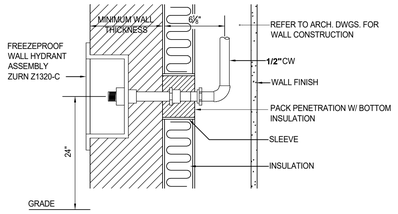


4 FREEZEPROOF WALL HYDRANT

SCALE: NOT TO SCALE




1 FLOOR CLEANOUT

SCALE: NOT TO SCALE

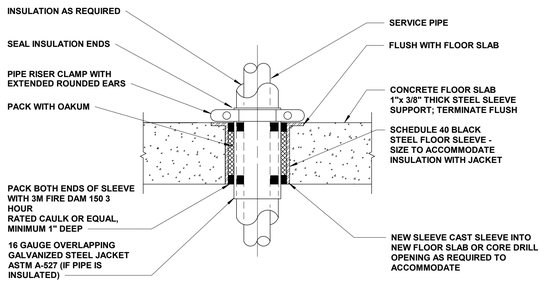


8 PIPE THRU FLOOR PENETRATION

SCALE: NOT TO SCALE

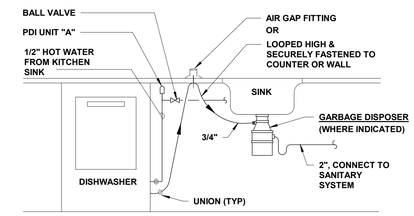


5 RESIDENTIAL DISHWASHER PIPING

SCALE: NOT TO SCALE

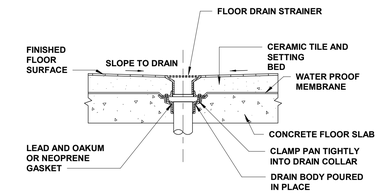


2 FLOOR DRAIN

SCALE: NOT TO SCALE

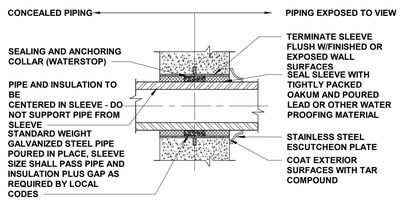


9 SLEEVE THRU EXTERIOR WALL

SCALE: NOT TO SCALE

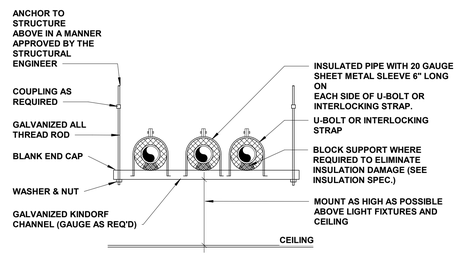


NOTE:
1. ALL PIPING SUPPORT SYSTEM COMPONENTS SHALL HAVE A NON-CORROSIVE METAL FINISH, GALV-KROM OR EQUAL
2. COORDINATE CROSS PIPING WITH MECHANICAL PIPING ROUTED IN CORRIDORS & SPRINKLER PIPING MAINS CROSSING IN CORRIDORS.

6 TRAPEZE PIPING SUPPORT

SCALE: NOT TO SCALE

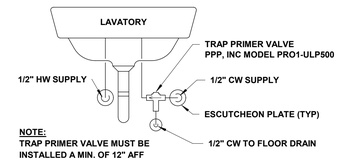


NOTE:
TRAP PRIMER VALVE MUST BE INSTALLED A MIN. OF 12" AFF

3 BELOW LAVATORY TRAP PRIMER

SCALE: NOT TO SCALE

| REVISION | DESCRIPTION | BY | DATE |
|---|---|---|---|
| | | | |

ARCHITECT

MEP. ENG.

NIST

FOR OFFICIAL USE ONLY

U.S. DEPARTMENT OF COMMERCE

OFFICE OF FACILITIES & PROPERTY MANAGEMENT

NIST – SINGLE FAMILY DETACHED HOME
SINGLE STORY

PLUMBING DETAILS

P301

SH. NO. ___ OF ___ DWG. P301

| APPROVED BY / DATE | SPONSOR / DATE | MAINTENANCE ENG. OFF. / DATE | ENVIRONMENTAL MANAGEMENT / DATE | SAFETY / DATE | SHED – NIST FIRE MARSHAL/AHJ / DATE | FACILITIES ENGR. OFF. / DATE | PROJECT LEADER: VAY / DATE | DRAWN BY: AA / DATE: 08/15/2022 | PROJECT/ W.O. #: Project Number |
|---|---|---|---|---|---|---|---|---|---|

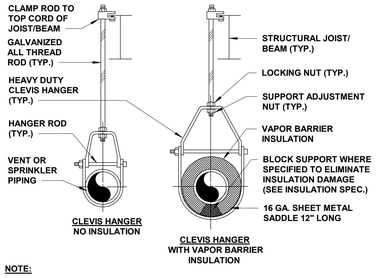


NOTE:

1. ALL PIPE HANGERS SHALL BE PAINTED WITH RUST INHIBITING PAINT AS SPECIFIED.

4 INDIVIDUAL PIPE SUPPORT

SCALE: NOT TO SCALE

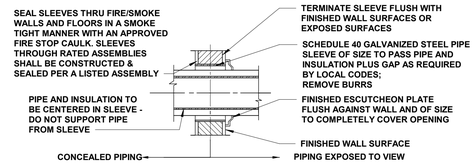


NOTE:

FOR INTERIOR FRAME PARTITIONS-PIPE SLEEVES MAY BE FABRICATED FROM GALVANIZED SHEET METAL; ROUND TUBE CLOSED WITH SNAPLOCK JOINT, WELDED SPIRAL SEAMS, OR WELDED LONGITUDINAL JOINT. FABRICATE FROM THE FOLLOWING GAUGES: 3" AND SMALLER, 20 GAUGE; 4" TO 6", 16 GAUGE; OVER 6", 14 GAUGE.

1 SLEEVE THRU INTERIOR WALL

SCALE: NOT TO SCALE

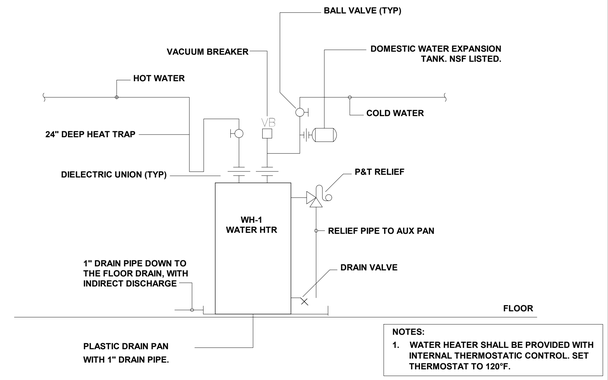


NOTES:

1. WATER HEATER SHALL BE PROVIDED WITH INTERNAL THERMOSTATIC CONTROL. SET THERMOSTAT TO 120°F.

5 ELECTRIC WATER HEATER

SCALE: NOT TO SCALE

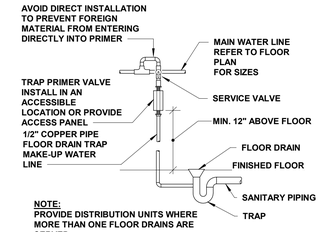


NOTE:
PROVIDE DISTRIBUTION UNITS WHERE MORE THAN ONE FLOOR DRAINS ARE SERVED

2 TRAP PRIMER

SCALE: NOT TO SCALE

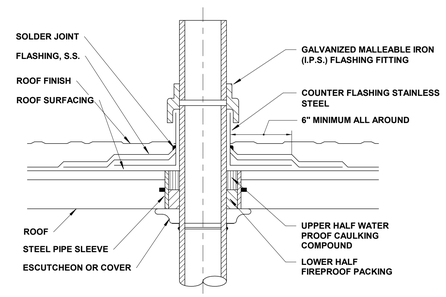


3 VENT THRU ROOF

SCALE: NOT TO SCALE

| REVISION | DESCRIPTION | BY | DATE |
|---|---|---|---|
| | | | |

ARCHITECT

MEP. ENG.

NIST

FOR OFFICIAL USE ONLY

U.S. DEPARTMENT OF COMMERCE

OFFICE OF FACILITIES & PROPERTY MANAGEMENT

NIST – SINGLE FAMILY DETACHED HOME
SINGLE STORY

PLUMBING DETAILS

P302

SH. NO. ___ OF ___ DWG. P302

| APPROVED BY | DATE | SPONSOR | DATE | MAINTENANCE ENG. OFF. | DATE | ENVIRONMENTAL MANAGEMENT | DATE | SAFETY | DATE | SHED – NIST FIRE MARSHAL/AHJ | DATE | FACILITIES ENGR. OFF. | DATE | VAY PROJECT LEADER | DATE | AA DRAWN BY | DATE | 08/15/2022 PROJECT/ W.O. # | Project Number |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|