


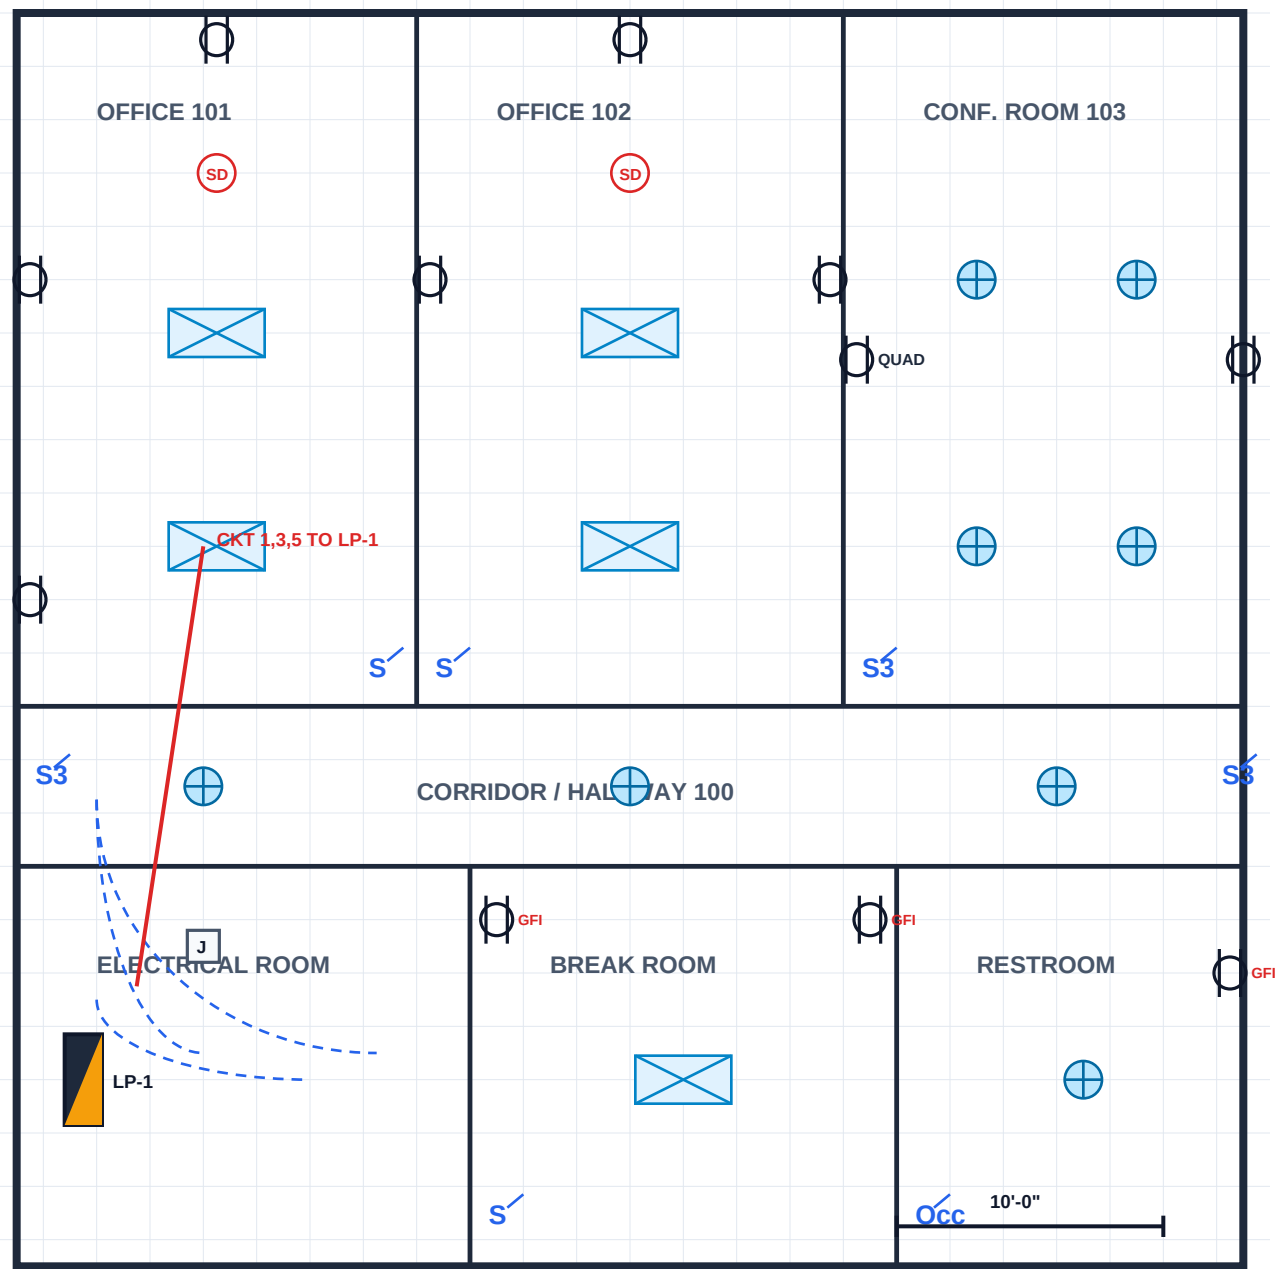

ELECTRICAL SYMBOL LEGEND

Duplex Receptacle 20A

GFCI Receptacle 20A

Single-Pole Switch

3-Way Switch

2x4 LED Lay-in Troffer

Recessed LED Can Light

Panelboard LP-1 (200A)

Junction Box (J-Box)

PANEL SCHEDULE — LP-1 (120/208V)

CK T	DESCRIPTION	TRIP	WIRE
1	Office 101/102 Troffers	20A/1P	#12 THHN
2	Office Receptacles	20A/1P	#12 THHN
3	Conf. Room Power/AV	20A/1P	#12 THHN
4	Breakroom GFCI Drops	20A/1P	#12 THHN
5	Corridor/Exit Lights	20A/1P	#12 THHN
6,8	AC-1 Disconnect	30A/2P	#10 THHN

GENERAL ELECTRICAL NOTES

1. ALL WIRING TO BE COPPER THHN/THWN IN EMT CONDUIT.

2. MAXIMUM 8 DUPLEX RECEPTACLES PER 20A BRANCH CKT.

3. PROVIDE GFCI PROTECTION FOR ALL COUNTERTOPS.

4. MOUNT SWITCHES AT 48" A.F.F., RECEPTACLES AT 18" A.F.F.

5. ALL WORK TO COMPLY WITH NEC 2026 & LOCAL CODES.