




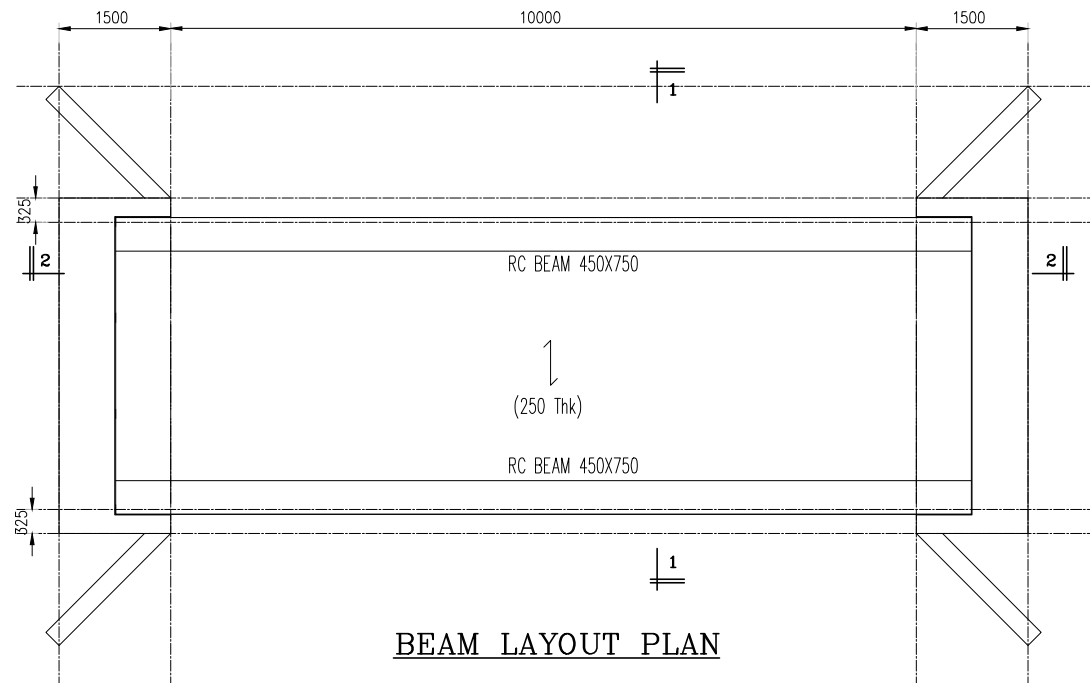


BEAM LAYOUT PLAN

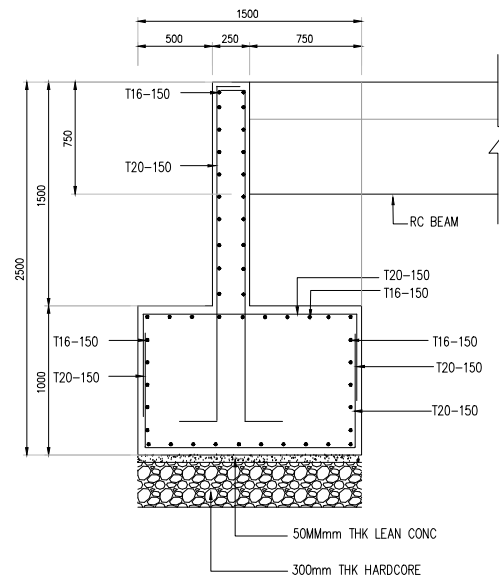


ABUTMENT DETAIL

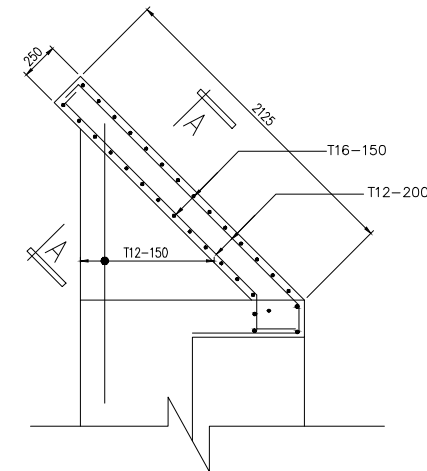


TYPICAL WING WALL DETAIL

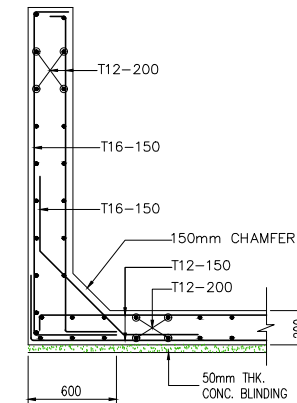


SECTION A-A

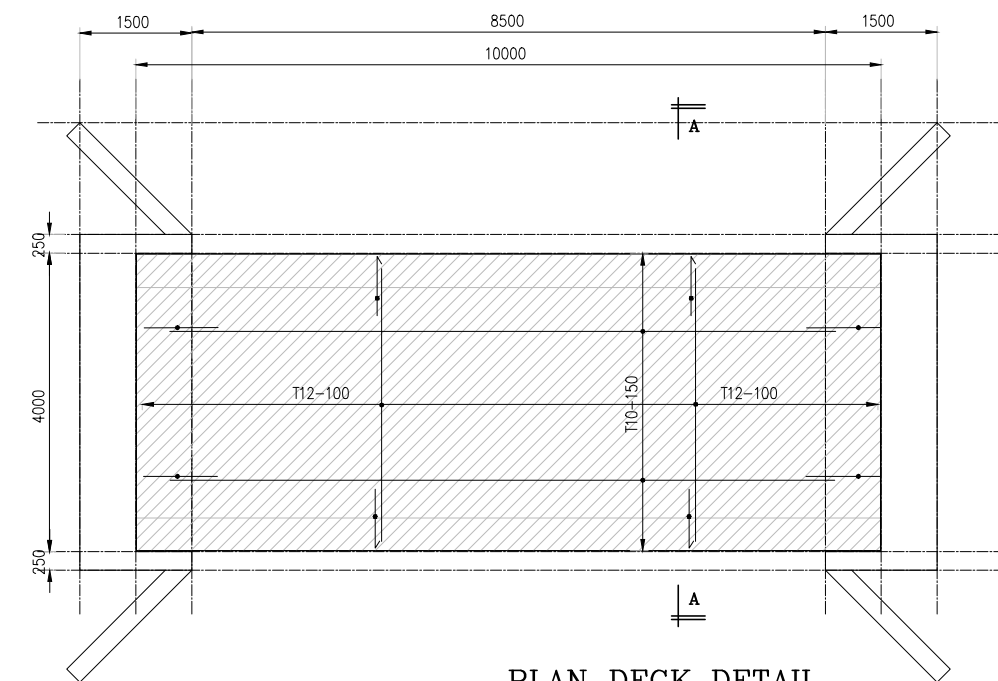


PLAN DECK DETAIL

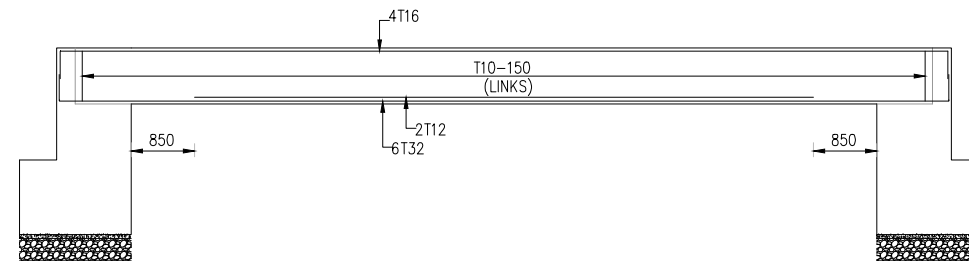


RC BEAM (450 X 750)

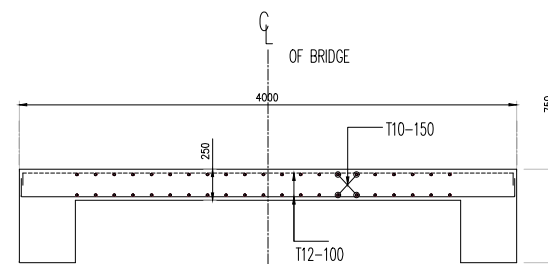

TYPICAL SECTION A-A

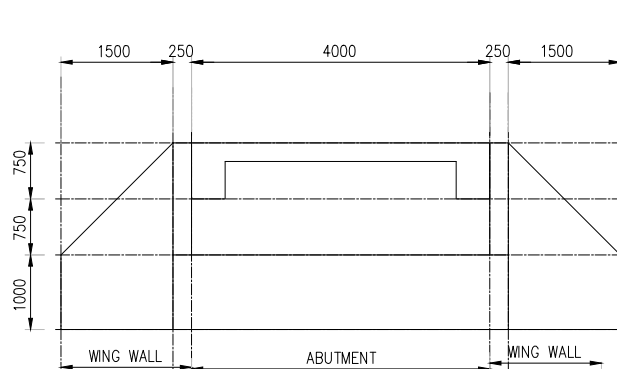

SECTION 1-1

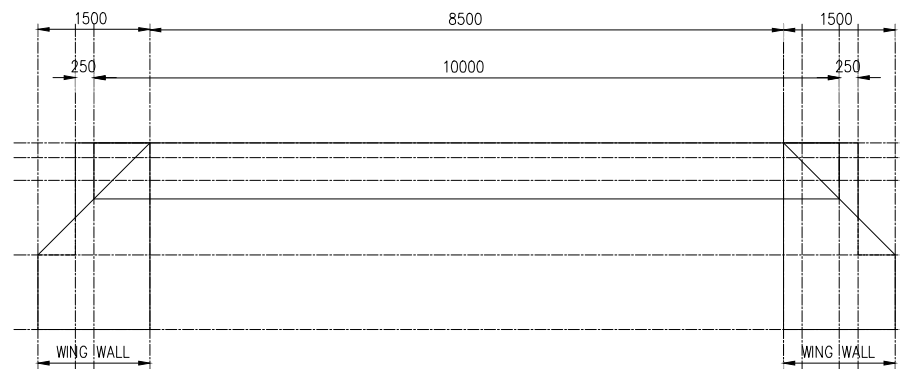

SECTION 2-2

GENERAL NOTES

- CONTRACTOR MUST FOLLOW THE DIMENSIONS GIVEN ON THIS DRAWING AND THESE DIMENSIONS MUST BE READ IN CONJUNCTION WITH ALL ARCHITECTURAL AND SERVICES DRAWINGS AND CONTRACT SPECIFICATIONS.
- ALL DIMENSIONS MUST BE CHECKED AND VERIFIED ON SITE. ANY DISCREPANCY MUST BE NOTIFIED TO THE DESIGN ENGINEERS IMMEDIATELY.
- ALL CONCRETE WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH THE LATEST B.S. CODES OF PRACTICE AND CONTRACT SPECIFICATIONS.
- THE CEMENT USED, UNLESS OTHERWISE SPECIFIED, SHALL BE ORDINARY PORTLAND CEMENT IN ACCORDANCE WITH B.S. 12.
- FINE AND COARSE AGGREGATES USED, UNLESS OTHERWISE SPECIFIED SHALL COMPLY WITH B.S.882.
- NOMINAL MIXES FOR STRUCTURAL ELEMENTS SHALL BE AS FOLLOWS :-

STRUCTURAL ELEMENTS	NOMINAL MIX
ABUTMENT/WALL	G30
SLABS	G30
LEAN CONCRETE	G15
- ALL STEEL REINFORCEMENT SHALL COMPLY WITH B.S.4449.
- 'R' DENOTES MILD STEEL IN METRIC SIZE
R8=8mm, R10=10mm, R12=12mm, R16=16mm
R20=20mm, R25=25mm, R32=32mm.
- 'T' DENOTES HIGH TENSILE STEEL IN METRIC SIZE
- UNLESS OTHERWISE STATED, STEEL REINFORCEMENT SHALL BE LAPPED AS FOLLOWS :-

	COMPRESSION	TENSION
MILD STEEL	40D	52D
H.T. STEEL	40D	52D
- ALL STEEL REINFORCEMENT, UNLESS OTHERWISE STATED, SHALL HAVE THE FOLLOWING CLEAR CONCRETE COVER:-

FOOTING	50mm
COLUMN	25mm
GROUND BEAM	40mm
SUPERSTRUCTURE BEAMS	25mm
SUPERSTRUCTURE SLABS	25mm
- ALL CONSTRUCTION JOINTS NOT SHOWN IN THIS DRAWING SHALL BE LOCATED ONLY WITH THE APPROVAL OF THE DESIGN ENGINEERS.
- ALL UNDERGROUND R.C. STRUCTURE TO BE SCREED WITH 50mm THK. LEAN CONCRETE.

STEEL STRUCTURAL NOTES

- ALL STRUCTURAL STEELWORKS GENERALLY SHALL BE MILD STEEL IN ACCORDANCE WITH B.S. 4360 OR LATEST B.S. CODE. THE MANUFACTURER'S TEST CERTIFICATES SHALL BE PRODUCED TO THE ENGINEER BEFORE ANY STEEL MAY BE ACCEPTED
- ALL WORKMANSHIP SHALL BE IN ACCORDANCE WITH B.S. 449
- ALL SURFACES OF STEELWORK FORMING THE ROOF TRUSSES SHALL RECEIVE THE NECESSARY COATS OF PAINT IN ACCORDANCE WITH THE SPECIFICATION
- THE CONTRACTOR SHALL SUPPLY AND FIX ALL NECESSARY WASHERS ETC.
- WELDING OF ALL STEELWORK SHALL COMPLY WITH B.S. 5135
- ELECTRODE USED FOR ALL WELDING SHALL COMPLY WITH B.S. 639 : 1976
- ENDS OF HOLLOW SECTIONS TO BE SEALED WITH 10mm THICK M.S. PLATE
- ALL WELD SHALL BE 6mm THICK FILLET WELD ALL ROUND UNLESS OTHERWISE SPECIFIED

RUANG KEGUNAAN MPAJ

TAJUK CADANGAN

TANDATANGAN JURUTERA :
I hereby certify that these works have been designed by me in accordance with sound engineering practice and that I take full responsibility for the design and proper performance of the same

JURUTERA PROFESIONAL
AWAM
Ir. MOHD NASPI BUSTAMAY
C110264
MALAYSIA

TAJUK LUKISAN

LAYOUT PLAN AND DETAIL
CROSSING BRIDGE

Dilukis Oleh :	MT	Skala :	AS SHOWN
Disemak Oleh :	ABUL	Tarikh :	MAY 2026
No Projek :	STRC/26/05	Peringkat :	SUBMISSION

NO. LUKISAN

STRC/DETAIL/01