



Energy Monitoring System



Home



Real Time



Equipments



Communication



Single Line

Electrical
HealthBreaker
Aging

EMS Report



Plant Running Demand Overview





Energy Monitoring System



Home



Real Time



Equipments



Communication



Single Line

Electrical
HealthBreaker
Aging

EMS Report



Power

Matrix

MTZ

MCCB/NSX

HB SERVER ROOM

Temperature

Group/Equipment	Rated Load	Running Load	Percent Loading
EB_INCOMER_TRANSFORMER_1	2000kVA	... kVA	0.0 %
DG_SET_1	750kVA	kVA	0.0 %
DG_SET_2	1250kVA	kVA	0.0 %
DG_SET_3	1250kVA	kVA	0.0 %
SOLAR	200kW	... kW	0.0 %

Energy Monitoring System



Home



Real Time



Equipments



Communication



Single Line



Electrical
Health



Breaker
Aging



EMS Report



Back

HIGH BAY LT ROOM

Next

Feeder name	VLL	VLN	A	Hz	PF	kW	kVA	kVAh	kWh
B1HB_M06_I01_INC_80KVA_UPS1	0	0	0			0.0		0	0
B1HB_M06_I01_INC_80KVA_UPS2	0	0	0			0.0		0	0
B1HB_M06_F01_PSDB1	397	229	1	50.0	0.745	0.6		0	4,312
B1HB_M06_F02_PSDB2	397	229	6	50.0	0.987	4.4		0	17,974
B1HB_M06_F03_PSDB3	397	229	7	50.0	0.979	4.7		0	24,977
B1HB_M06_F05_VTPN1	397	229	0	50.0		0.0		0	0
B1HB_M06_F05_VTPN4	397	229	2	50.0	0.899	1.3		0	7,014
B1HB_M06_F07_PSDB4	397	229	3	50.0	0.867	1.9		0	4,748
B1HB_M06_F08_PSDB5	397	229	0	50.0	0.142	0.0		0	42
B1HB_M06_F09_PSDB6	397	229	2	50.0	0.966	1.3		0	3,020
B1HB_M06_F11_VTPN2	397	229	6	50.0	0.996	4.2		0	14,745
B1HB_M06_F12_VTPN3	397	230	0	50.0		0.0		0	0
B1HB_M04_I01_I/C_B1HBM01EXH_PNL1	404	233	3	50.0	0.055	0.1		0	1,015
B1HB_M05_I01_INC_B1HB01	404	233	5	50.0	0.454	1.6		0	727
B1HB_M03_I01_INC_B1HB_M01	404	233	10	50.0	0.977	7.0		0	33,674



Energy Monitoring System



Home



Real Time



Equipments



Communication



Single Line

Electrical
HealthBreaker
Aging

EMS Report




Back

HIGH BAY LT ROOM

Next

Feeder name	VLL	VLN	A	Hz	PF	kW	kVA	kVAh	kWh
B1HB_M03_I02_FUTURE_PROVISION	0	0	0			0.0		0	0
B1HB_MO3_F04_O/G_TO_20KVA_UPS1	404	404	4	50.0	0.518	1.4		0	6,155
B1HB_MO3_F05_O/G_TO_20KVA_UPS2	404	233	4	50.0	0.534	1.4		0	6,205
B1HB_MO3_F06_O/G_TO_80KVA_UPS1	405	234	30	50.0	0.980	19.0		0	96,660
B1HB_MO3_F12_O/G_TO_80KVA_UPS2	405	234	0	50.0	0.021	0.7		0	5,755
B1HB_M03_F10_O/G_TO_PAC1	405	234	2	50.0	0.861	0.1		0	7,867
B1HB_M03_F11_O/G_TO_PAC2	405	234	0	...		0.0		0	0
B1HB_M01_I01_INC_M_LT_UMER_M01	...	...		...		...	...	...	...
B1HB_M01_F02_O/G_LOW_BAY_MEZ	404	234	66	50.0	0.881	16.2		0	127,213
B1HB_M01_F05_O/G_SPARE	404	233	0	50.0		0.0		0	0
B1HB_M01_F06_O/G_Highbay_FLOOR	405	234	10	50.0	0.899	1.2		0	17,407
B1HB_M01_F09_O/G_UPS/MAIN_LTP	404	234	12	50.0	0.865	1.4		0	7,333
B1HB_M01_F09_O/G_LOW_BAYGF_LTP	405	234	5	50.0	0.860	2.6		0	11,699
B1HB_M02_I01_I/C_Highbay_MAIN_LT	403	233	31	50.0	0.967	21.2	21.9	76,463	71,626
B1HB_M02_F01_O/G_PSDB1	...	...		...	...	...	...	...	...

Energy Monitoring System – Developed By Schneider Electric



Energy Monitoring System

Collins Aerospace, Bangalore



Home



Real Time



Equipments



Communication



Single Line

Electrical
HealthBreaker
Aging

EMS Report



TRANSFORMER_1



2MVA

	HV SIDE	LV SIDE
VII	10,429.2	...
A	18.7	...
Hz	49.97	...
PF	-99.9 %	...
kW	330	...
kVA	330	...
kVAR	14	...
kWh	111,922	...

DG_SET_1



750kVA

VII	0.0
A	0.0
Hz	
PF	
kW	0.0
kVA	
kVAR	
kWh	6,582

DG_SET_2



1250kVA

VII	0.0
A	0.0
Hz	
PF	
kW	0.0
kVA	
kVAR	
kWh	5,757

DG_SET_3



1250kVA

VII	0.0
A	0.0
Hz	
PF	
kW	0.0
kVA	
kVAR	
kWh	8,398

SOLAR



200kW

VII	...
A	...
Hz	...
PF	...
kW	...
kVA	...
kVAR	...
kWh	...



Energy Monitoring System

Collins Aerospace, Bangalore



Home



Real Time



Equipments



Communication



Single Line



Electrical
Health



Breaker
Aging



EMS Report



Back

- Communicating
- Not Communicating

Next


Feeder name	Modbus ID	Status
B1HB_M02_I01_I/C_HIGHBAY_MAIN_LT	8	●
B1HB_M02_F01_O/G_PSDB1	9	●
B1HB_M02_F02_O/G_PSDB2	10	●
B1HB_M02_F05_O/G_VTPN_DB1	11	●
B1HB_M02_F04_O/G_EXHAUST_U1	12	●
B1HB_M02_F03_O/G_PSDB5	13	●
B1HB_M02_F07_O/G_PSDB6	14	●
B1HB_M02_F10_O/G_VTPN_DB2	15	●
B1HB_M02_F11_O/G_VTPN_DB3	16	●
B1HB_M07_I01_INC_20KVA_UPS1	17	●
B1LB_M01_I01_INC_B1HB_M01	2	●
B1LB_M01_F01_O/G_PSDB1	3	●
B1LB_M01_F02_O/G_ECU1	4	●
B1LB_M01_F03_O/G_ECU2	5	●

Feeder name	Modbus ID	Status
B1LB_M01_F04_O/G_ECU-3	6	●
B1LB_M01_F05_O/G_AIR_COMP1	7	●
B1LB_M01_F06_O/G_PSDB2	8	●
B1LB_M01_F07_OG_AIR_COMP2	9	●
B1LB_M01_F08_O/G_VTPN 01	10	●
B1LB_M01_F09_O/G_VTPN 02	11	●
B1LB_M01_F10_O/G_VTPN 03	12	●
B1LB_M01_F11_O/G_PSDB 02	13	●
B1LB_M01_F12_O/G_PSDB 03	14	●
B1MZ_M03_I01_INC_B1MZ_M01	2	●
B1MZ_M03_F01_SERVICE_LIFT01	3	●
B1NZ_M03_F02_SERVICE_LIFT02	4	●
B1MZ_M03_F03_PASSANGER_LIFT02	5	●
B1MZ_M01_I01_INC_B1HB	6	●

- Home
- Real Time
- Equipments
- Communication
- Single Line
- Electrical Health
- Breaker Aging
- EMS Report



Single Line Diagram Voltage & Current (Click on the meter icon to view the details)

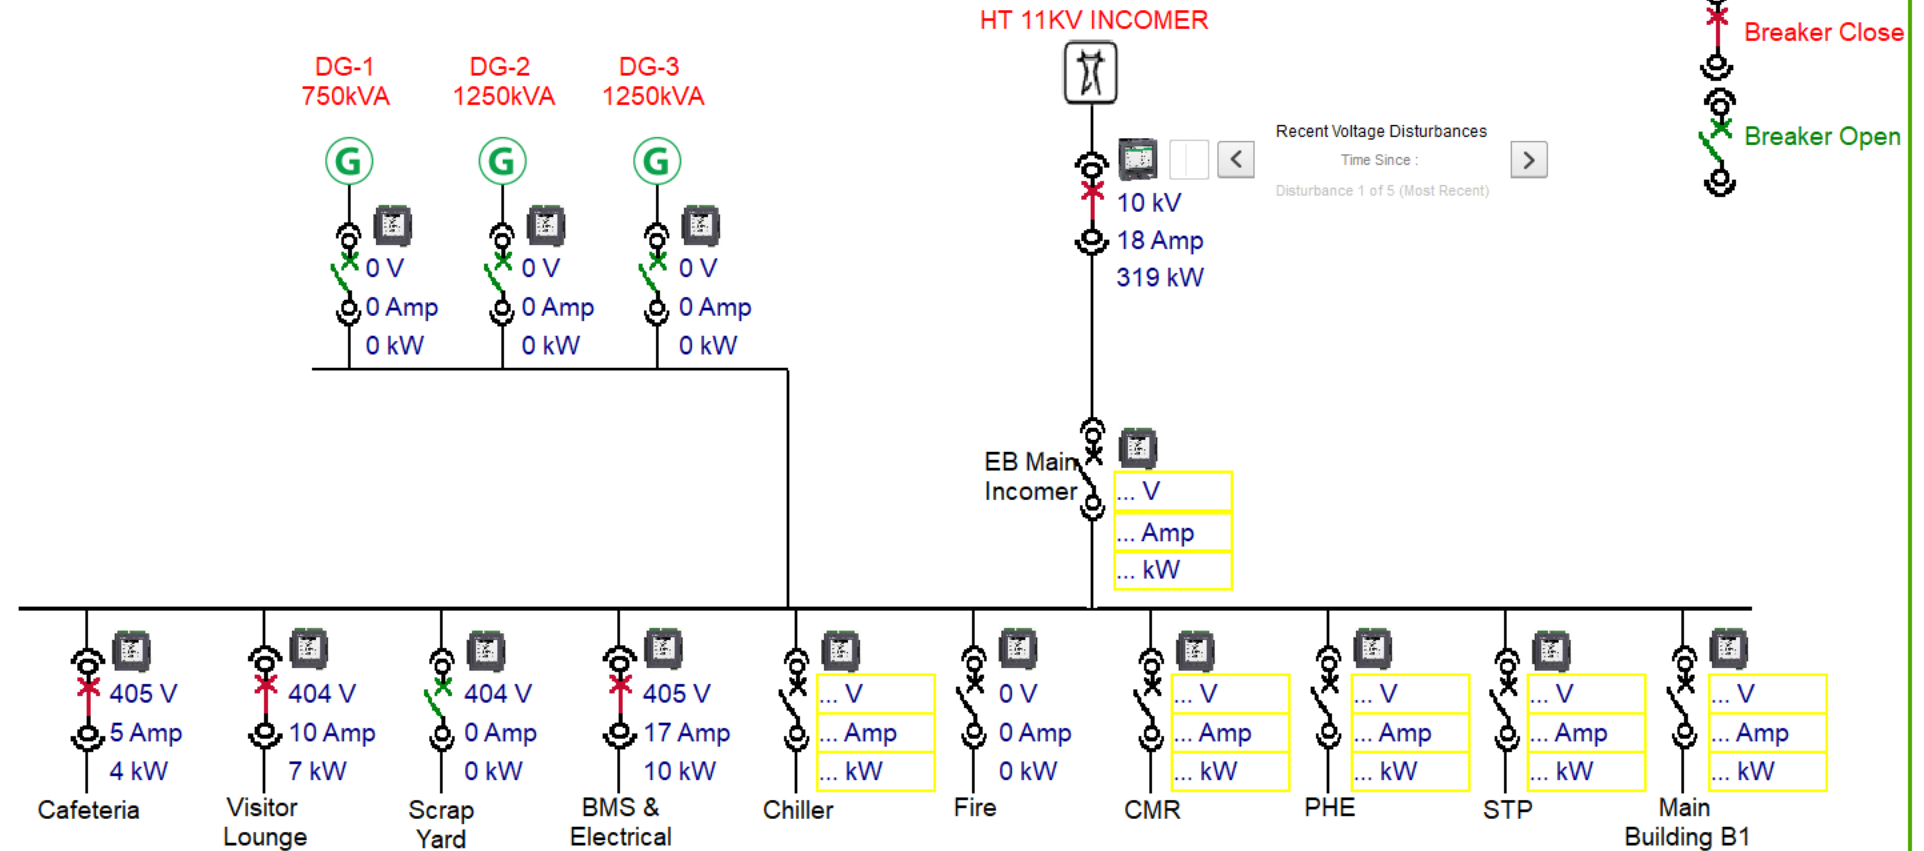



Energy Monitoring System

Collins Aerospace, Bangalore



Single Line Diagram Voltage & Current (Click on the meter icon to view the details)

LOC: STP ROOM

FROM FUTURE PHASE

FROM UTILITY PANEL

