


ENERGY MANAGEMENT SYSTEM BCPM

Second Floor

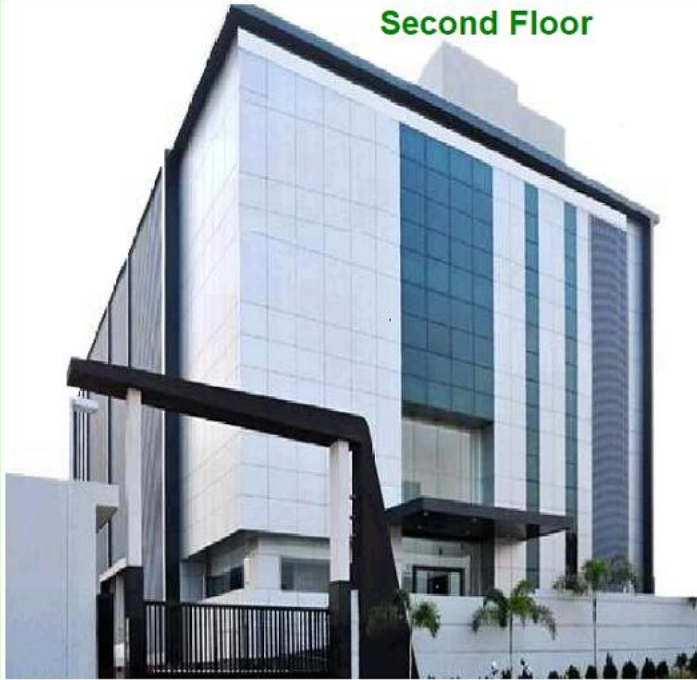

Zone-1 Summary

1,232.2 kW 60,942,446.6 kWh



ZONE-1 SOURCE-1 PDU

585.3 kW 27,395,644.2 kWh



ZONE-1 SOURCE-2 PDU

646.9 kW 33,546,802.4 kWh



Zone-2 Summary

1,261.7 kW 61,775,921.4 kWh



ZONE-2 SOURCE-1 PDU

622.1 kW 28,682,335.8 kWh



ZONE-2 SOURCE-2 PDU

639.6 kW 33,093,585.6 kWh



DC3SF.SH2_250kVA_PDU1_S1_A DC3SF.SH2_250kVA_PDU1_S1_B
DC3SF.SH2_250kVA_PDU1_S2_A DC3SF.SH2_250kVA_PDU1_S2_B

DC 2 GF COLO PDU 14 SUMMARY

73.8 kW 828,240.9 kWh



DC 2 3F SH 4 PDU 13 SUMMARY

9.1 kW 33,568.1 kWh



DC 2 FF KFINTECH PDU 6 SUMMARY

91.4 kW 996,844.6 kWh



DC 2 COLO DC OLA S1 PDUs

91.4 kW 1,338,350.6 kWh



DC 2 COLO DC OLA S2 PDUs

76.8 kW



Go to Settings Program Windows

PDU - POWER & ENERGY

MAIN

ZONE-1 SOURCE-1 PDU

PDU NO	Phase	kW	TOTAL KW	TOTAL KWH
Z1_S1_PDU 1	R-KW	28.6	77.9	3,274,704.4
	Y-KW	22.8		
	B-KW	26.5		
Z1_S1_PDU 2	R-KW	31.6	90.6	3,491,937.2
	Y-KW	28.3		
	B-KW	30.7		
Z1_S1_PDU 3	R-KW	25.1	71.9	3,353,989.1
	Y-KW	22.3		
	B-KW	24.6		
Z1_S1_PDU 4	R-KW	32.3	95.3	4,444,464.4
	Y-KW	29.3		
	B-KW	33.7		
Z1_S1_PDU 5	R-KW	33.2	93.8	4,735,558.3
	Y-KW	29.1		
	B-KW	31.6		
Z1_S1_PDU 6	R-KW	26.2	72.5	3,638,442.7
	Y-KW	22.6		
	B-KW	23.7		
Z1_S1_PDU 7	R-KW	33.1	83.1	4,456,552.3
	Y-KW	23.0		
	B-KW	27.0		

Zone-1 Source-1 Summary

Voltage V L-N	230.6 V
Voltage V L-L	399.5 V
Total Current	2,587.7 A
Frequency	50.0 Hz
Total KW-R	210.2
Total KW-Y	177.3
Total KW-B	197.6
Overall KW	585.2
Total KWH	27,395,648.5

CIRCUIT PARAMETERS

MAIN

Z2_S1_PDU'S

ZONE-2 SOURCE-1 PDU 1

➔

NEXT

Zone-2 Source-1 PDU 1 Summary

Voltage V	230.8 V
Voltage V	399.8 V
Total Current	366.7 A
Frequency	50.0 Hz
Total KW-R	28.2
Total KW-Y	24.7
Total KW-B	29.6
Overall KW	82.6
Total KWH	4,445,446.9

MCB.	SR. NO	Circuit Name	I(Amps)	PF	kW
1.	1.	Z2:P4:R2:SSD:PDU1:S1:M01_R	3.6	...	0.8
	2.	Z2:P4:R2:SSD:PDU1:S1:M01_Y	3.2	...	0.7
	3.	Z2:P4:R2:SSD:PDU1:S1:M01_B	6.7	...	1.5
2.	4.	Z2:P4:R2:R16:PDU1:S1:M02_R	7.2	...	1.6
	5.	Z2:P4:R2:R16:PDU1:S1:M02_Y	6.7	...	1.5
	6.	Z2:P4:R2:R16:PDU1:S1:M02_B	7.9	...	1.8
3.	7.	Z2:P4:R2:R15:PDU1:S1:M03_R	6.8	...	1.5
	8.	Z2:P4:R2:R15:PDU1:S1:M03_Y	6.6	...	1.5
	9.	Z2:P4:R2:R15:PDU1:S1:M03_B	8.2	...	1.9
4.	10.	Z2:P4:R2:R14:PDU1:S1:M04_R	5.9	...	1.4
	11.	Z2:P4:R2:R14:PDU1:S1:M04_Y	6.7	...	1.5
	12.	Z2:P4:R2:R14:PDU1:S1:M04_B	6.9	...	1.6
5.	13.	Z2:P4:R2:R13:PDU1:S1:M05_R	7.9	...	1.8
	14.	Z2:P4:R2:R13:PDU1:S1:M05_Y	7.9	...	1.8
	15.	Z2:P4:R2:R13:PDU1:S1:M05_B	6.6	...	1.5
6.	16.	Z2:P4:R2:R12:PDU1:S1:M06_R	7.2	...	1.7
	17.	Z2:P4:R2:R12:PDU1:S1:M06_Y	6.3	...	1.4
	18.	Z2:P4:R2:R12:PDU1:S1:M06_B	7.6	...	1.7
7.	19.	Z2:P4:R2:R11:PDU1:S1:M07_R	6.6	...	1.5
	20.	Z2:P4:R2:R11:PDU1:S1:M07_Y	5.7	...	1.3
	21.	Z2:P4:R2:R11:PDU1:S1:M07_B	7.9	...	1.8
8.	22.	Z2:P4:R2:R10:PDU1:S1:M08_R	7.2	...	1.6
	23.	Z2:P4:R2:R10:PDU1:S1:M08_Y	6.1	...	1.4
	24.	Z2:P4:R2:R10:PDU1:S1:M08_B	6.3	...	1.4
9.	25.	Z2:P4:R2:R09:PDU1:S1:M09_R	7.9	...	1.8
	26.	Z2:P4:R2:R09:PDU1:S1:M09_Y	6.5	...	1.5
	27.	Z2:P4:R2:R09:PDU1:S1:M09_B	5.6	...	1.3

DC_3F_CADENCE.PDU7_S1_A

Alarms

Current, Volt, Pwr

Demand

Energy

Diagnostic

 Back to Network

Channel Current, Power, Power Factor

Single Row: Sequential

PF (%)	P (kVA)	P (kW)	I (amps)			I (amps)	P (kW)	P (kVA)	PF (%)
0.0	0.000	0.000	0.00	01	02	1.10	0.247	0.253	1.0
0.8	0.319	0.271	1.39	03	04	0.00	0.000	0.000	0.0
1.0	0.255	0.237	1.10	05	06	1.29	0.244	0.295	0.8
0.0	0.000	0.000	0.00	07	08	1.06	0.229	0.244	1.0
0.9	0.327	0.276	1.42	09	10	0.00	0.000	0.000	0.0
1.0	0.248	0.238	1.07	11	12	1.33	0.255	0.305	0.8
0.0	0.000	0.000	0.00	13	14	1.08	0.235	0.250	1.0
0.8	0.293	0.242	1.27	15	16	0.00	0.000	0.000	0.0
0.1	0.159	0.010	0.68	17	18	1.49	0.297	0.342	0.9
0.0	0.000	0.000	0.00	19	20	0.37	0.020	0.084	0.2
0.8	0.289	0.238	1.25	21	22	1.10	0.247	0.255	1.0
0.0	0.000	0.000	0.00	23	24	1.48	0.296	0.341	0.9
1.0	0.255	0.000	1.11	25	26	0.00	0.000	0.000	0.0
0.8	0.288	0.238	1.25	27	28	2.81	0.617	0.647	1.0
1.0	0.587	0.576	2.55	29	30	0.00	0.000	0.000	0.0
0.9	0.674	0.637	2.93	31	32	2.40	0.536	0.553	1.0
1.0	0.637	0.628	2.77	33	34	0.00	0.000	0.000	0.0
0.0	0.000	0.000	0.00	35	36	0.00	0.000	0.000	0.0
0.0	0.000	0.000	0.00	37	38	1.39	0.315	0.321	0.9
0.9	0.295	0.252	1.28	39	40	1.55	0.295	0.358	0.8
0.9	0.520	0.492	2.26	41	42	4.13	0.872	0.951	0.9

Voltage, Freq

V 12	399.2 V
V 23	399.3 V
V 31	399.2 V
Vll avg	399.2 V
V 1N	230.5 V
V 2N	230.4 V
V 3N	230.6 V
Vln avg	230.5 V
Frequency	50.00 Hz



Panel-Main



Logs

Device Type BCPM A

Activate Windows

Go to Settings to activate Windows.



DC_3F_CADENCE.PDU7_S1_A

Alarms

Current, Volt, Pwr

Demand

Energy

Diagnostic

 Back to Network**Channel Current Demand**

Single Row: Sequential

I Peak Dmd (amps)	I Dmd Last (amps)			I Dmd Last (amps)	I Peak Dmd (amps)
5.96	0.00	01	02	1.09	5.61
5.56	1.40	03	04	0.00	6.54
6.15	0.19	05	06	1.28	6.10
4.99	0.00	07	08	0.31	4.69
4.66	1.41	09	10	0.00	5.99
5.64	0.74	11	12	1.32	5.60
4.66	0.00	13	14	0.44	4.38
4.35	1.27	15	16	0.00	9.22
9.17	0.69	17	18	1.49	9.15
4.64	0.00	19	20	0.38	4.36
4.33	1.26	21	22	1.09	6.80
6.38	0.00	23	24	1.48	6.34
6.18	0.19	25	26	0.00	5.82
5.78	1.25	27	28	2.78	5.29
4.99	2.56	29	30	0.00	4.95
10.72	2.94	31	32	2.39	10.09
10.00	2.83	33	34	0.00	4.99
4.70	0.00	35	36	0.00	4.67
4.75	0.00	37	38	1.46	4.47
4.44	1.27	39	40	1.63	7.64
7.63	2.26	41	42	4.12	7.60

Reset ALL
Peak Demand
(Also resets peak power dmd, main dmd)

Ch Power
DemandPanel-Main
Demand

Device Type BCPM A

Activate Windows
Go to Settings to activate Windows.



 Back to
Volts/Amps

Channel Current & Power Logs

Single Row: Sequential

Logs		Logs	
	01		02
	03		04
	05		06
	07		08
	09		10
	11		12
	13		14
	15		16
	17		18
	19		20
	21		22
	23		24
	25		26
	27		28
	29		30
	31		32
	33		34
	35		36
	37		38
	39		40
	41		42

Panel-Main Logs

Volts, PF, kW Demand 

Current 

Device Type BCPM A

	Timestamp	Current Avg Mean	Active Power Mean
1	14-07-2026 16:00:00.000	1.093	0.247
2	14-07-2026 15:45:00.000	1.001	0.23
3	14-07-2026 15:30:00.000	0.185	0.006
4	14-07-2026 15:15:00.000	0.185	0.006
5	14-07-2026 15:00:00.000	0.185	0.006
6	14-07-2026 14:45:00.000	0.185	0.006
7	14-07-2026 14:30:00.000	0.185	0.006
8	14-07-2026 14:15:00.000	0.185	0.006
9	14-07-2026 14:00:00.000	0.184	0.006
10	14-07-2026 13:45:00.000	0.186	0.006
11	14-07-2026 13:30:00.000	0.185	0.006
12	14-07-2026 13:15:00.000	0.185	0.006
13	14-07-2026 13:00:00.000	0.185	0.006
14	14-07-2026 12:45:00.000	0.185	0.006
15	14-07-2026 12:30:00.000	0.185	0.006
16	14-07-2026 12:15:00.000	0.186	0.006
17	14-07-2026 12:00:00.000	0.185	0.006
18	14-07-2026 11:45:00.000	0.185	0.006
19	14-07-2026 11:30:00.000	0.184	0.006
20	14-07-2026 11:15:00.000	0.185	0.006
21	14-07-2026 11:00:00.000	0.184	0.006
22	14-07-2026 10:45:00.000	0.185	0.006
23	14-07-2026 10:30:00.000	0.185	0.006
24	14-07-2026 10:15:00.000	0.185	0.006
25	14-07-2026 10:00:00.000	0.185	0.006
26	14-07-2026 09:45:00.000	0.186	0.007
27	14-07-2026 09:30:00.000	0.185	0.006
28	14-07-2026 09:15:00.000	0.186	0.006
29	14-07-2026 09:00:00.000	0.186	0.006
30	14-07-2026 08:45:00.000	0.184	0.006
31	14-07-2026 08:30:00.000	0.184	0.006
32	14-07-2026 08:15:00.000	0.185	0.006
33	14-07-2026 08:00:00.000	0.185	0.006
34	14-07-2026 07:45:00.000	0.185	0.006
35	14-07-2026 07:30:00.000	0.186	0.006
36	14-07-2026 07:15:00.000	0.185	0.006
37	14-07-2026 07:00:00.000	0.185	0.006
38	14-07-2026 06:45:00.000	0.185	0.006
39	14-07-2026 06:30:00.000	0.185	0.006
40	14-07-2026 06:15:00.000	0.185	0.006
41	14-07-2026 06:00:00.000	0.185	0.006
42	14-07-2026 05:45:00.000	0.186	0.006
43	14-07-2026 05:30:00.000	0.186	0.006
44	14-07-2026 05:15:00.000	0.185	0.006
45	14-07-2026 05:00:00.000	0.185	0.006
46	14-07-2026 04:45:00.000	0.186	0.007
47	14-07-2026 04:30:00.000	0.185	0.006
48	14-07-2026 04:15:00.000	0.185	0.006
49	14-07-2026 04:00:00.000	0.186	0.006

Activate Windows
Go to Settings to activate Windows.



DC_3F_CADENCE.PDU7_S1_A

Alarms | Current, Volt, Pwr | Demand | Energy | Diagnostic

 Back to Network

Channel Energy

Single Row: Sequential

Resets	kWh		kWh	Resets
	1	01	37	
	272	03	1	
	33	05	246	
	1	07	34	
	278	09	1	
	36	11	264	
	0	13	35	
	242	15	1	
	4	17	297	
	9	19	5	
	239	21	45	
	0	23	279	
	37	25	1	
	245	27	191	
	173	29	0	
	197	31	430	
	186	33	0	
	0	35	0	
	1	37	151	
	223	39	104	
	456	41	843	
		42		

Panel-Main Energy

kWh

0

Reset main energy 

Global Energy

Reset ALL energy 


Energy
Logs

Device Type BCPM A

Activate Windows
Go to Settings to activate Windows.

