






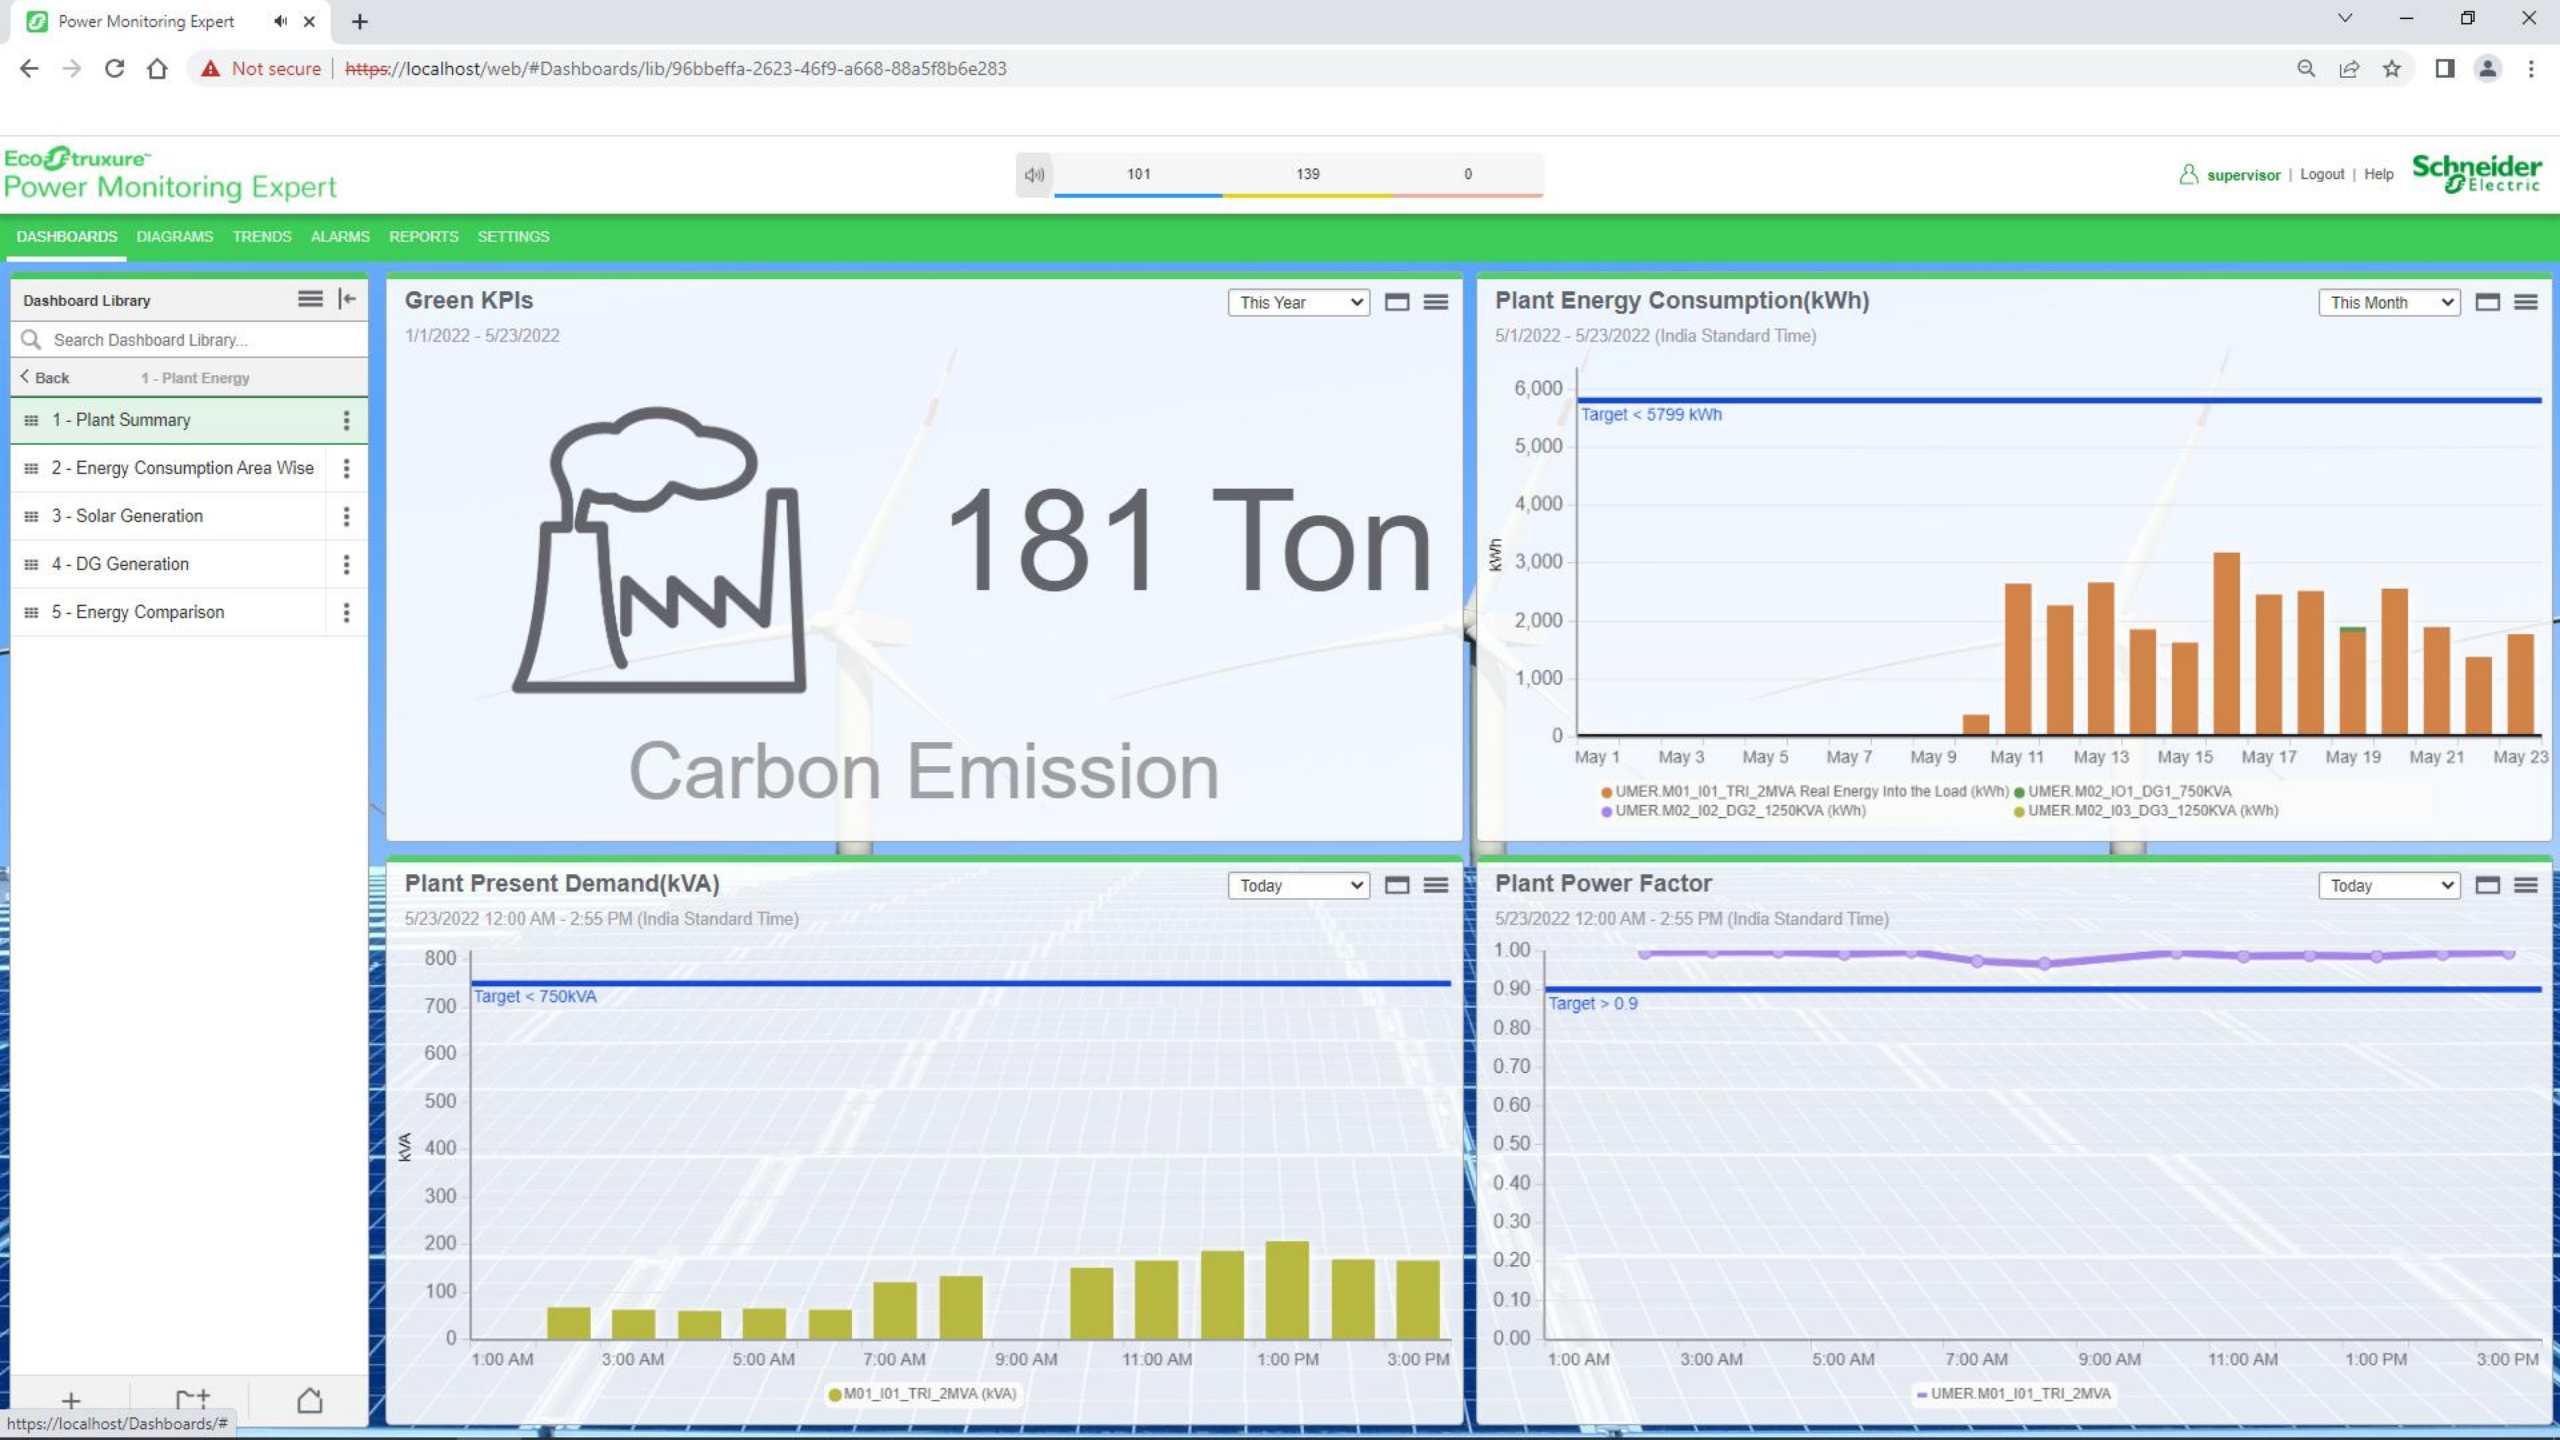

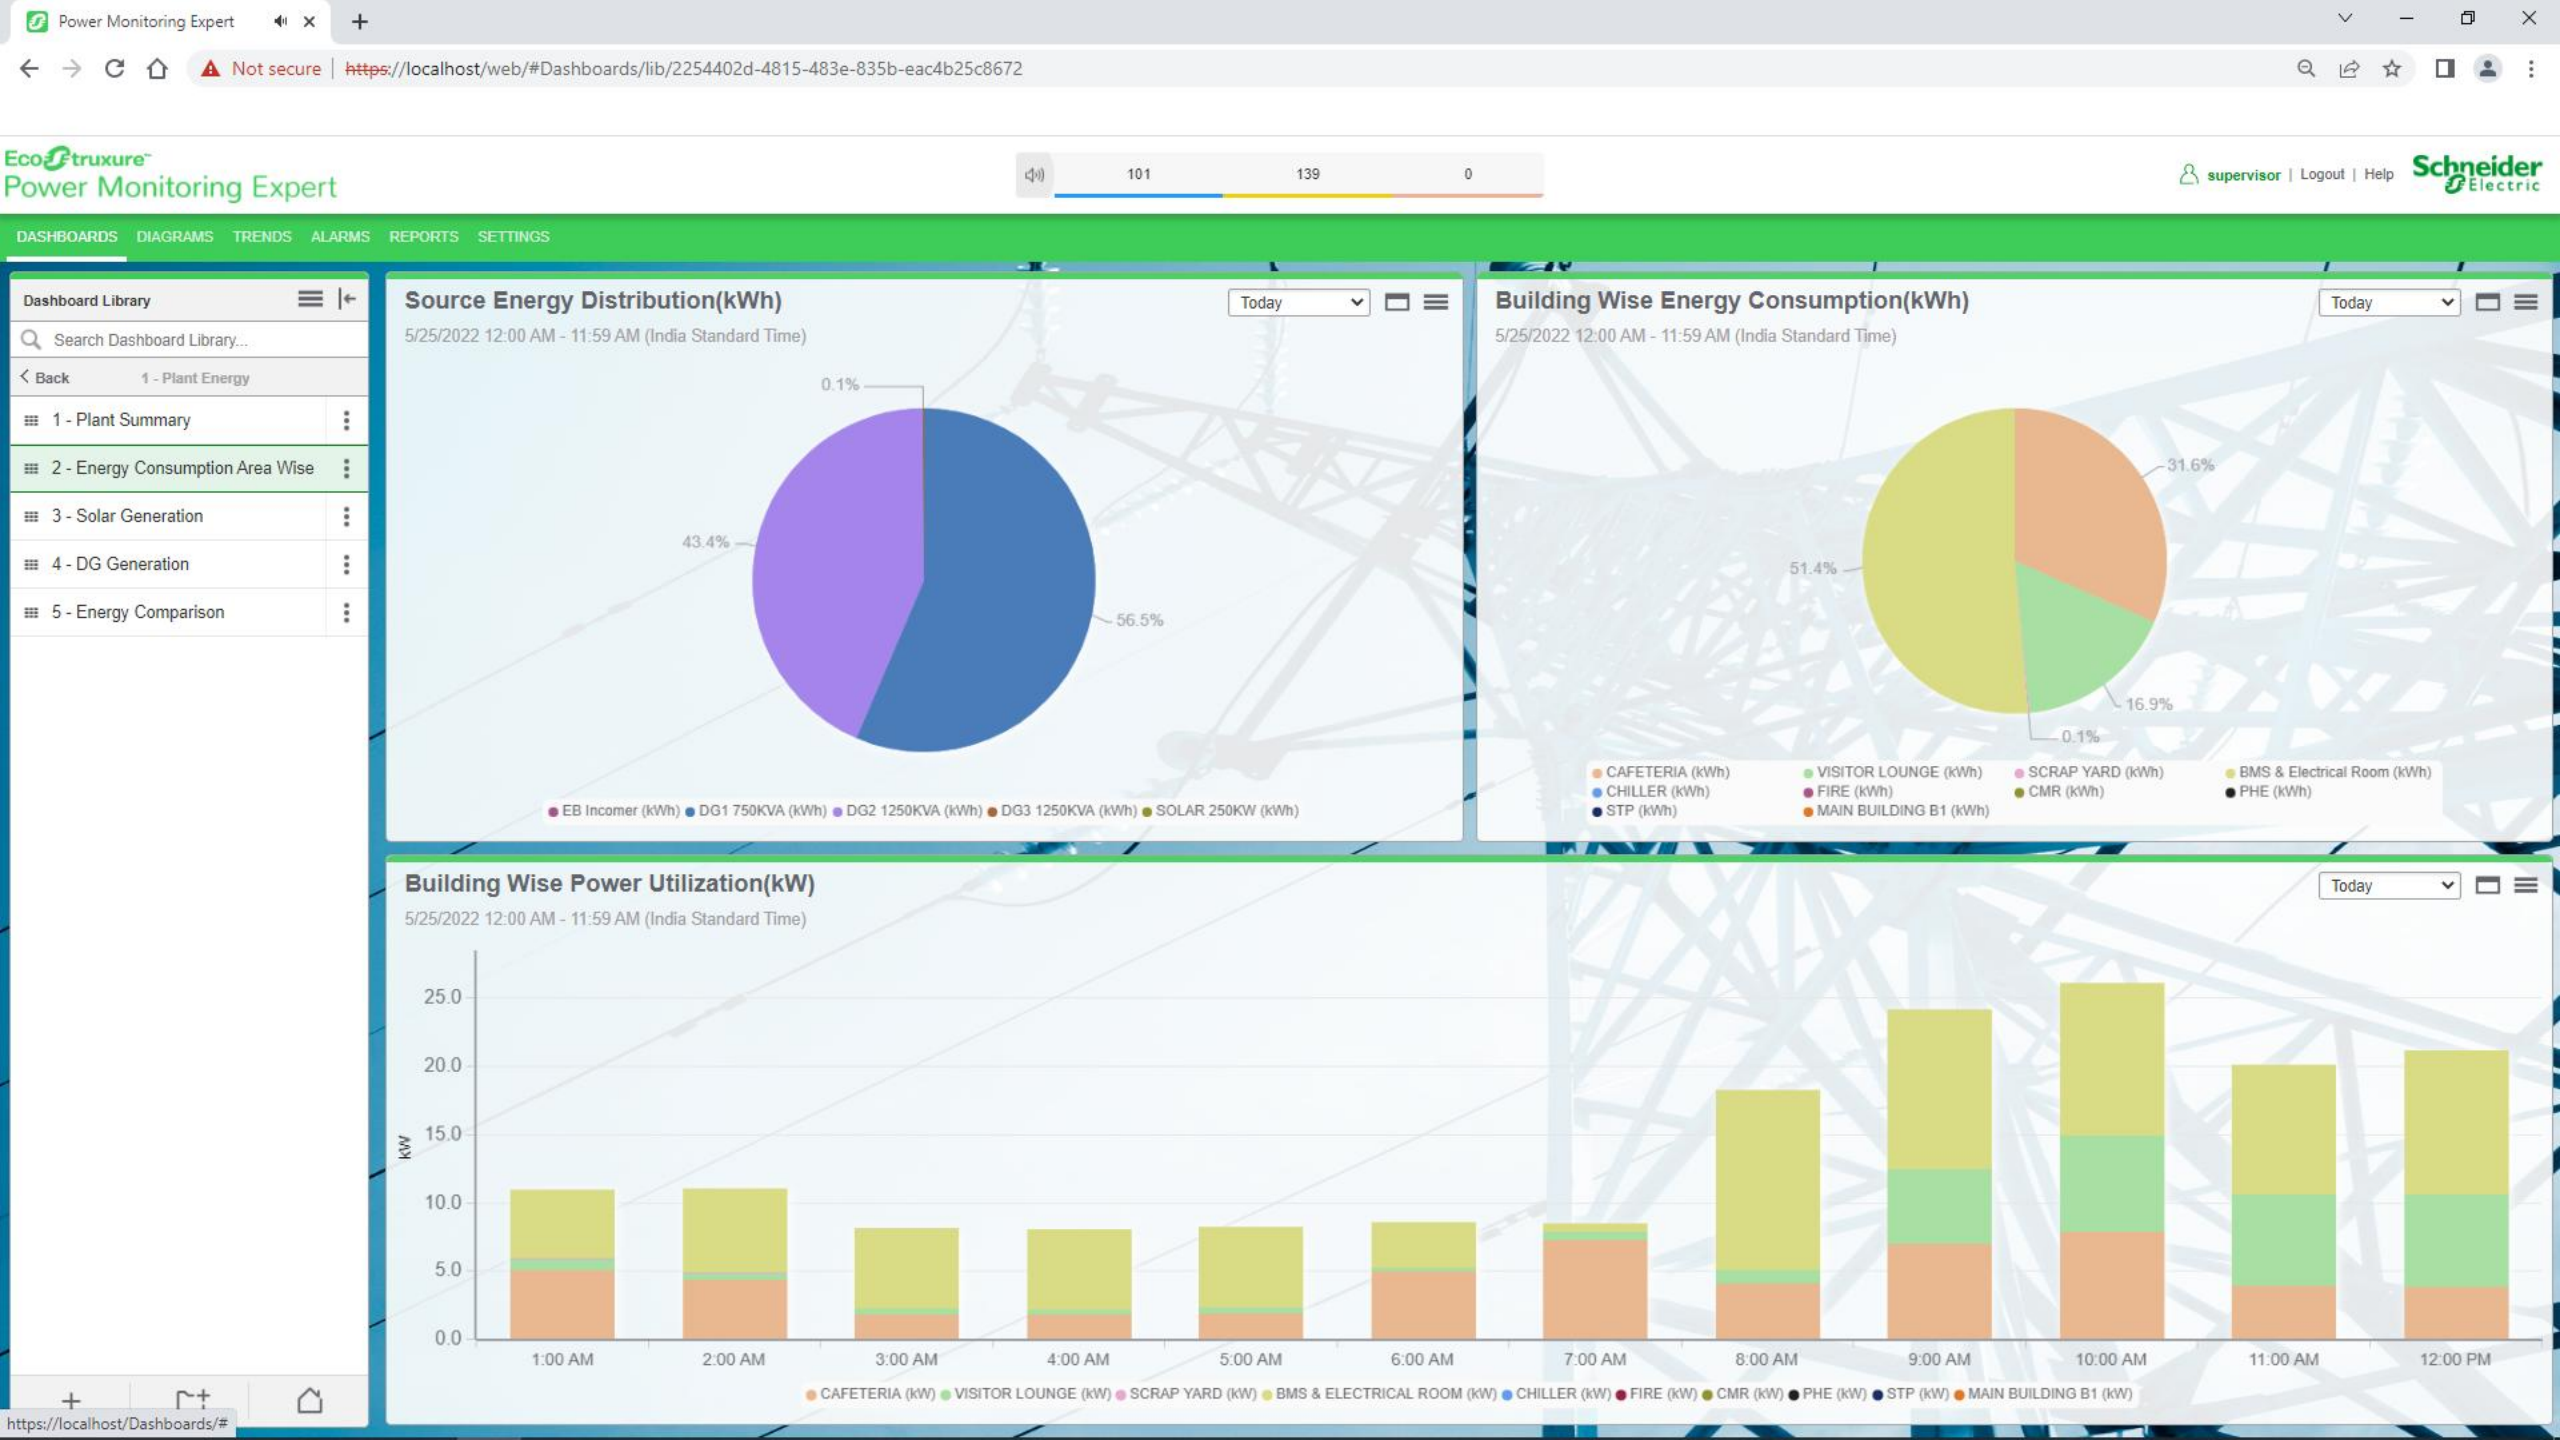

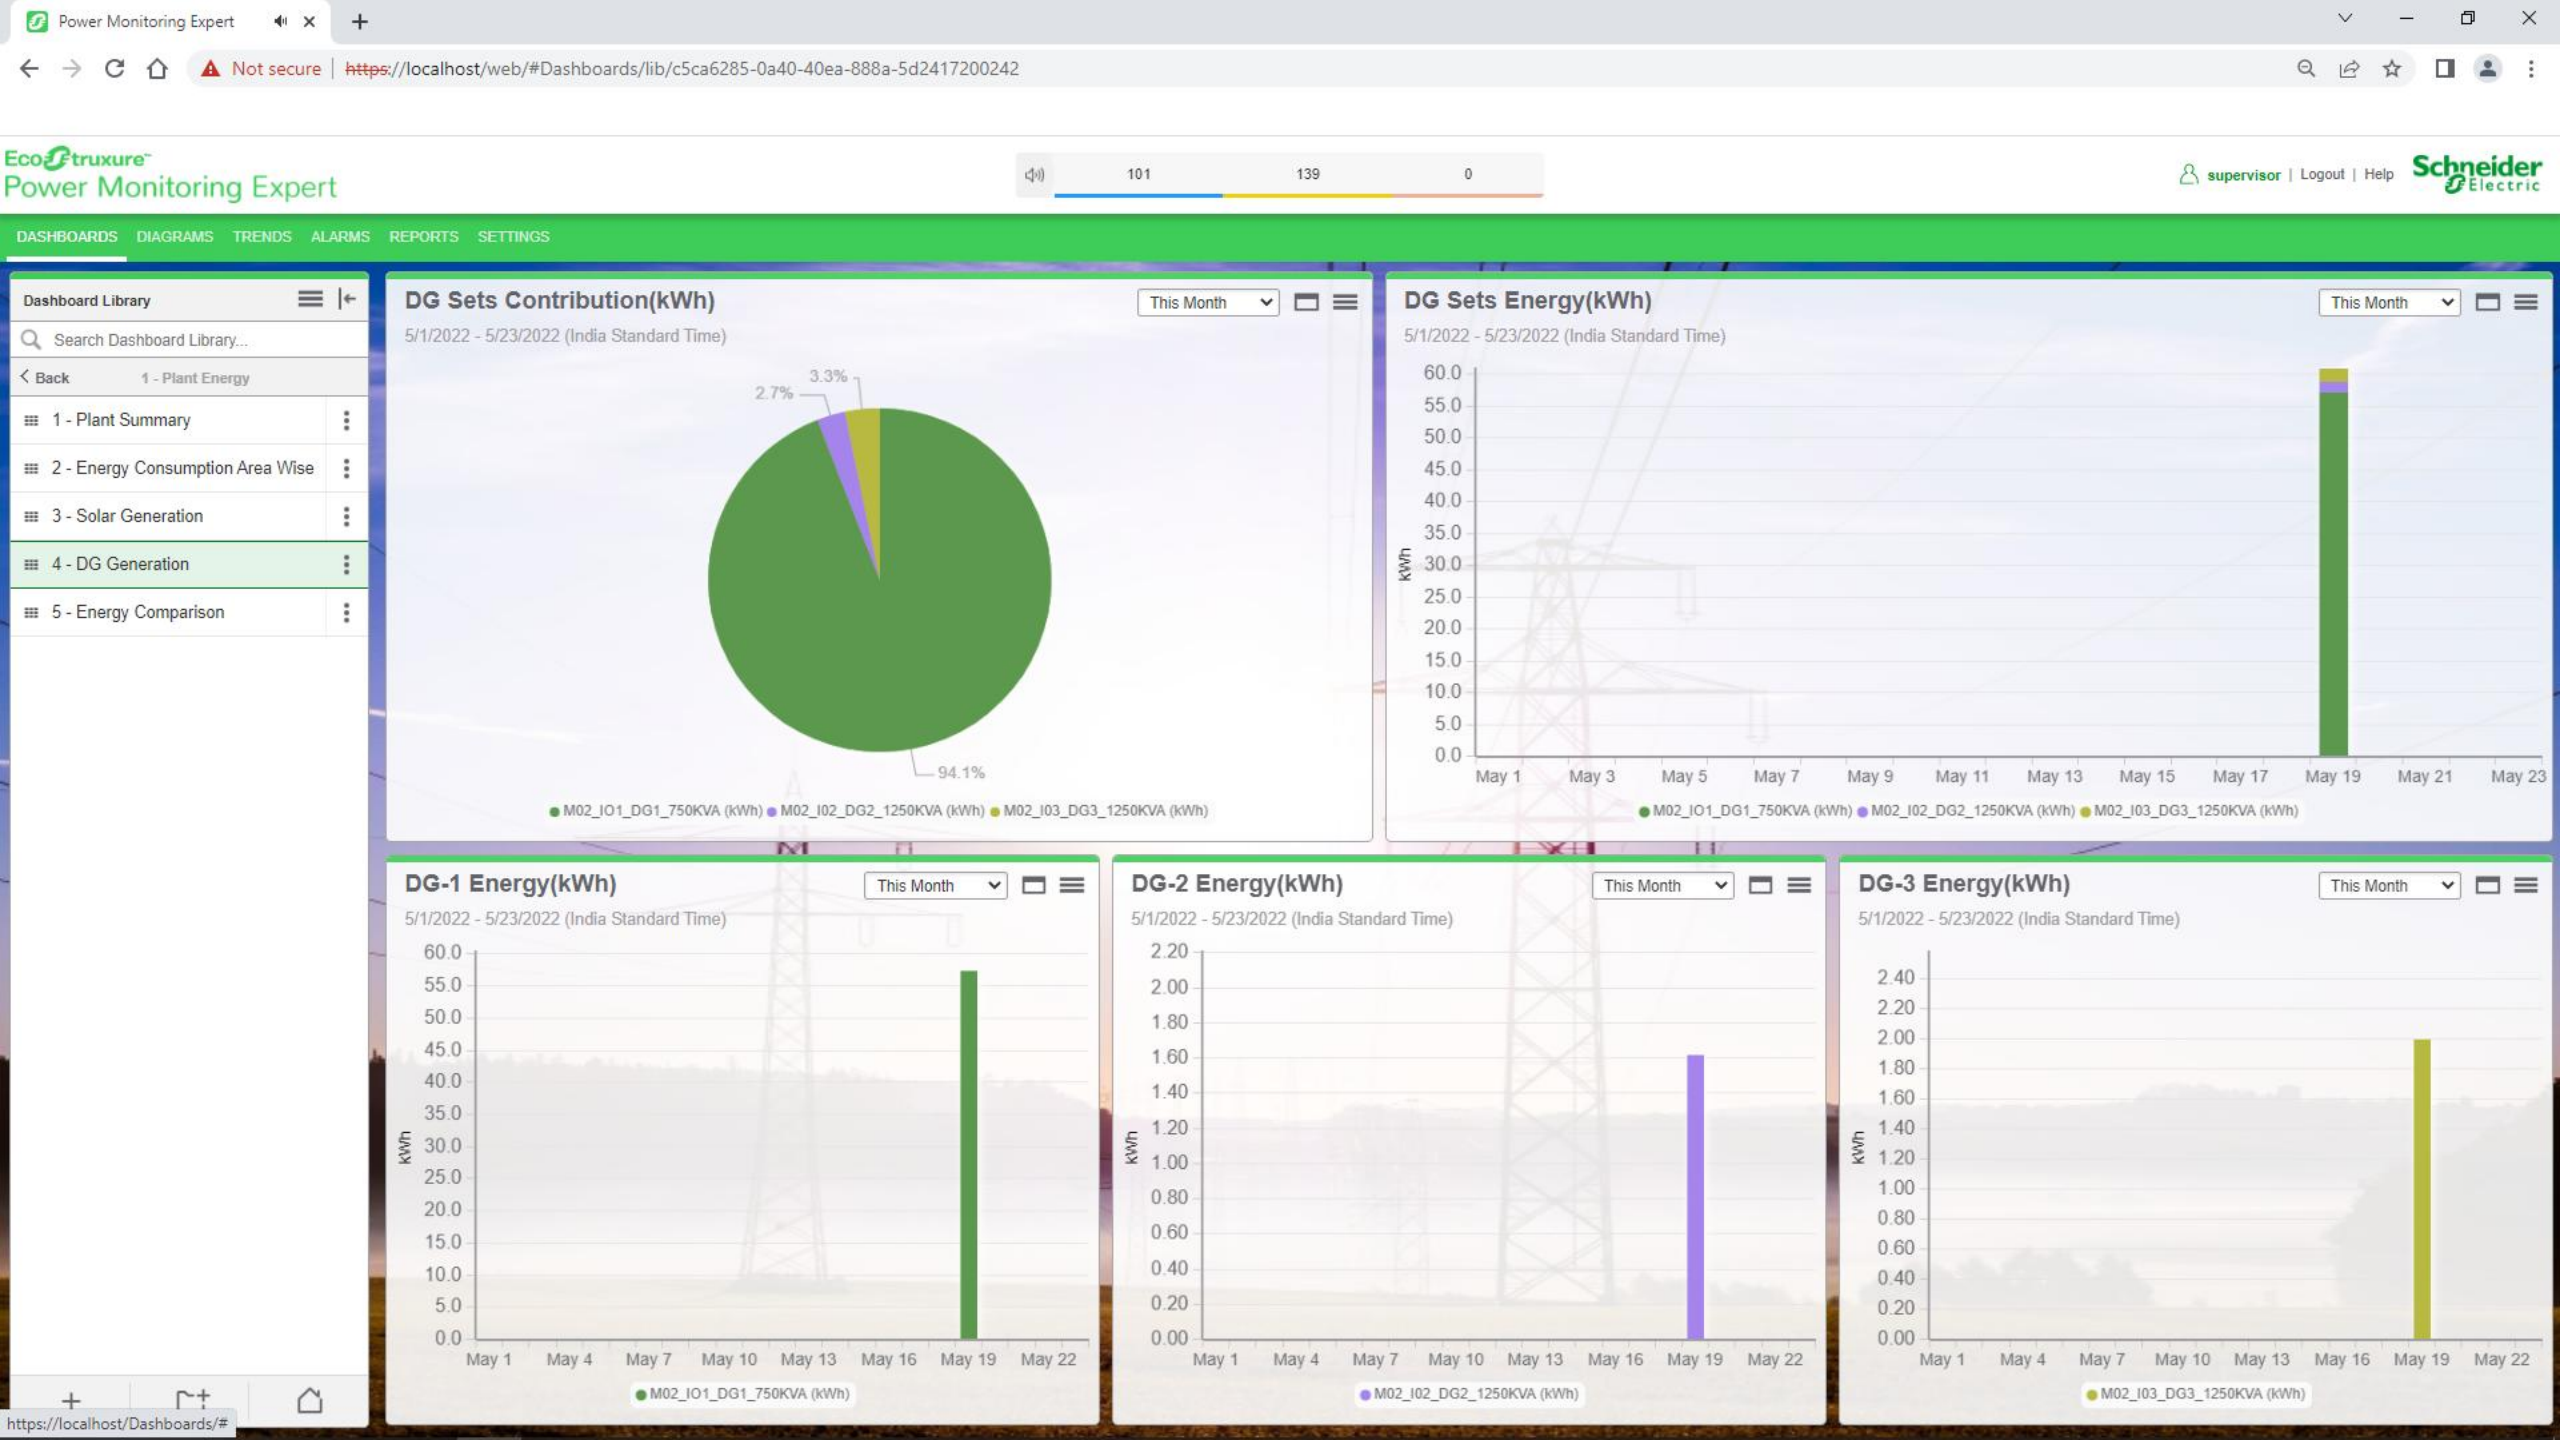

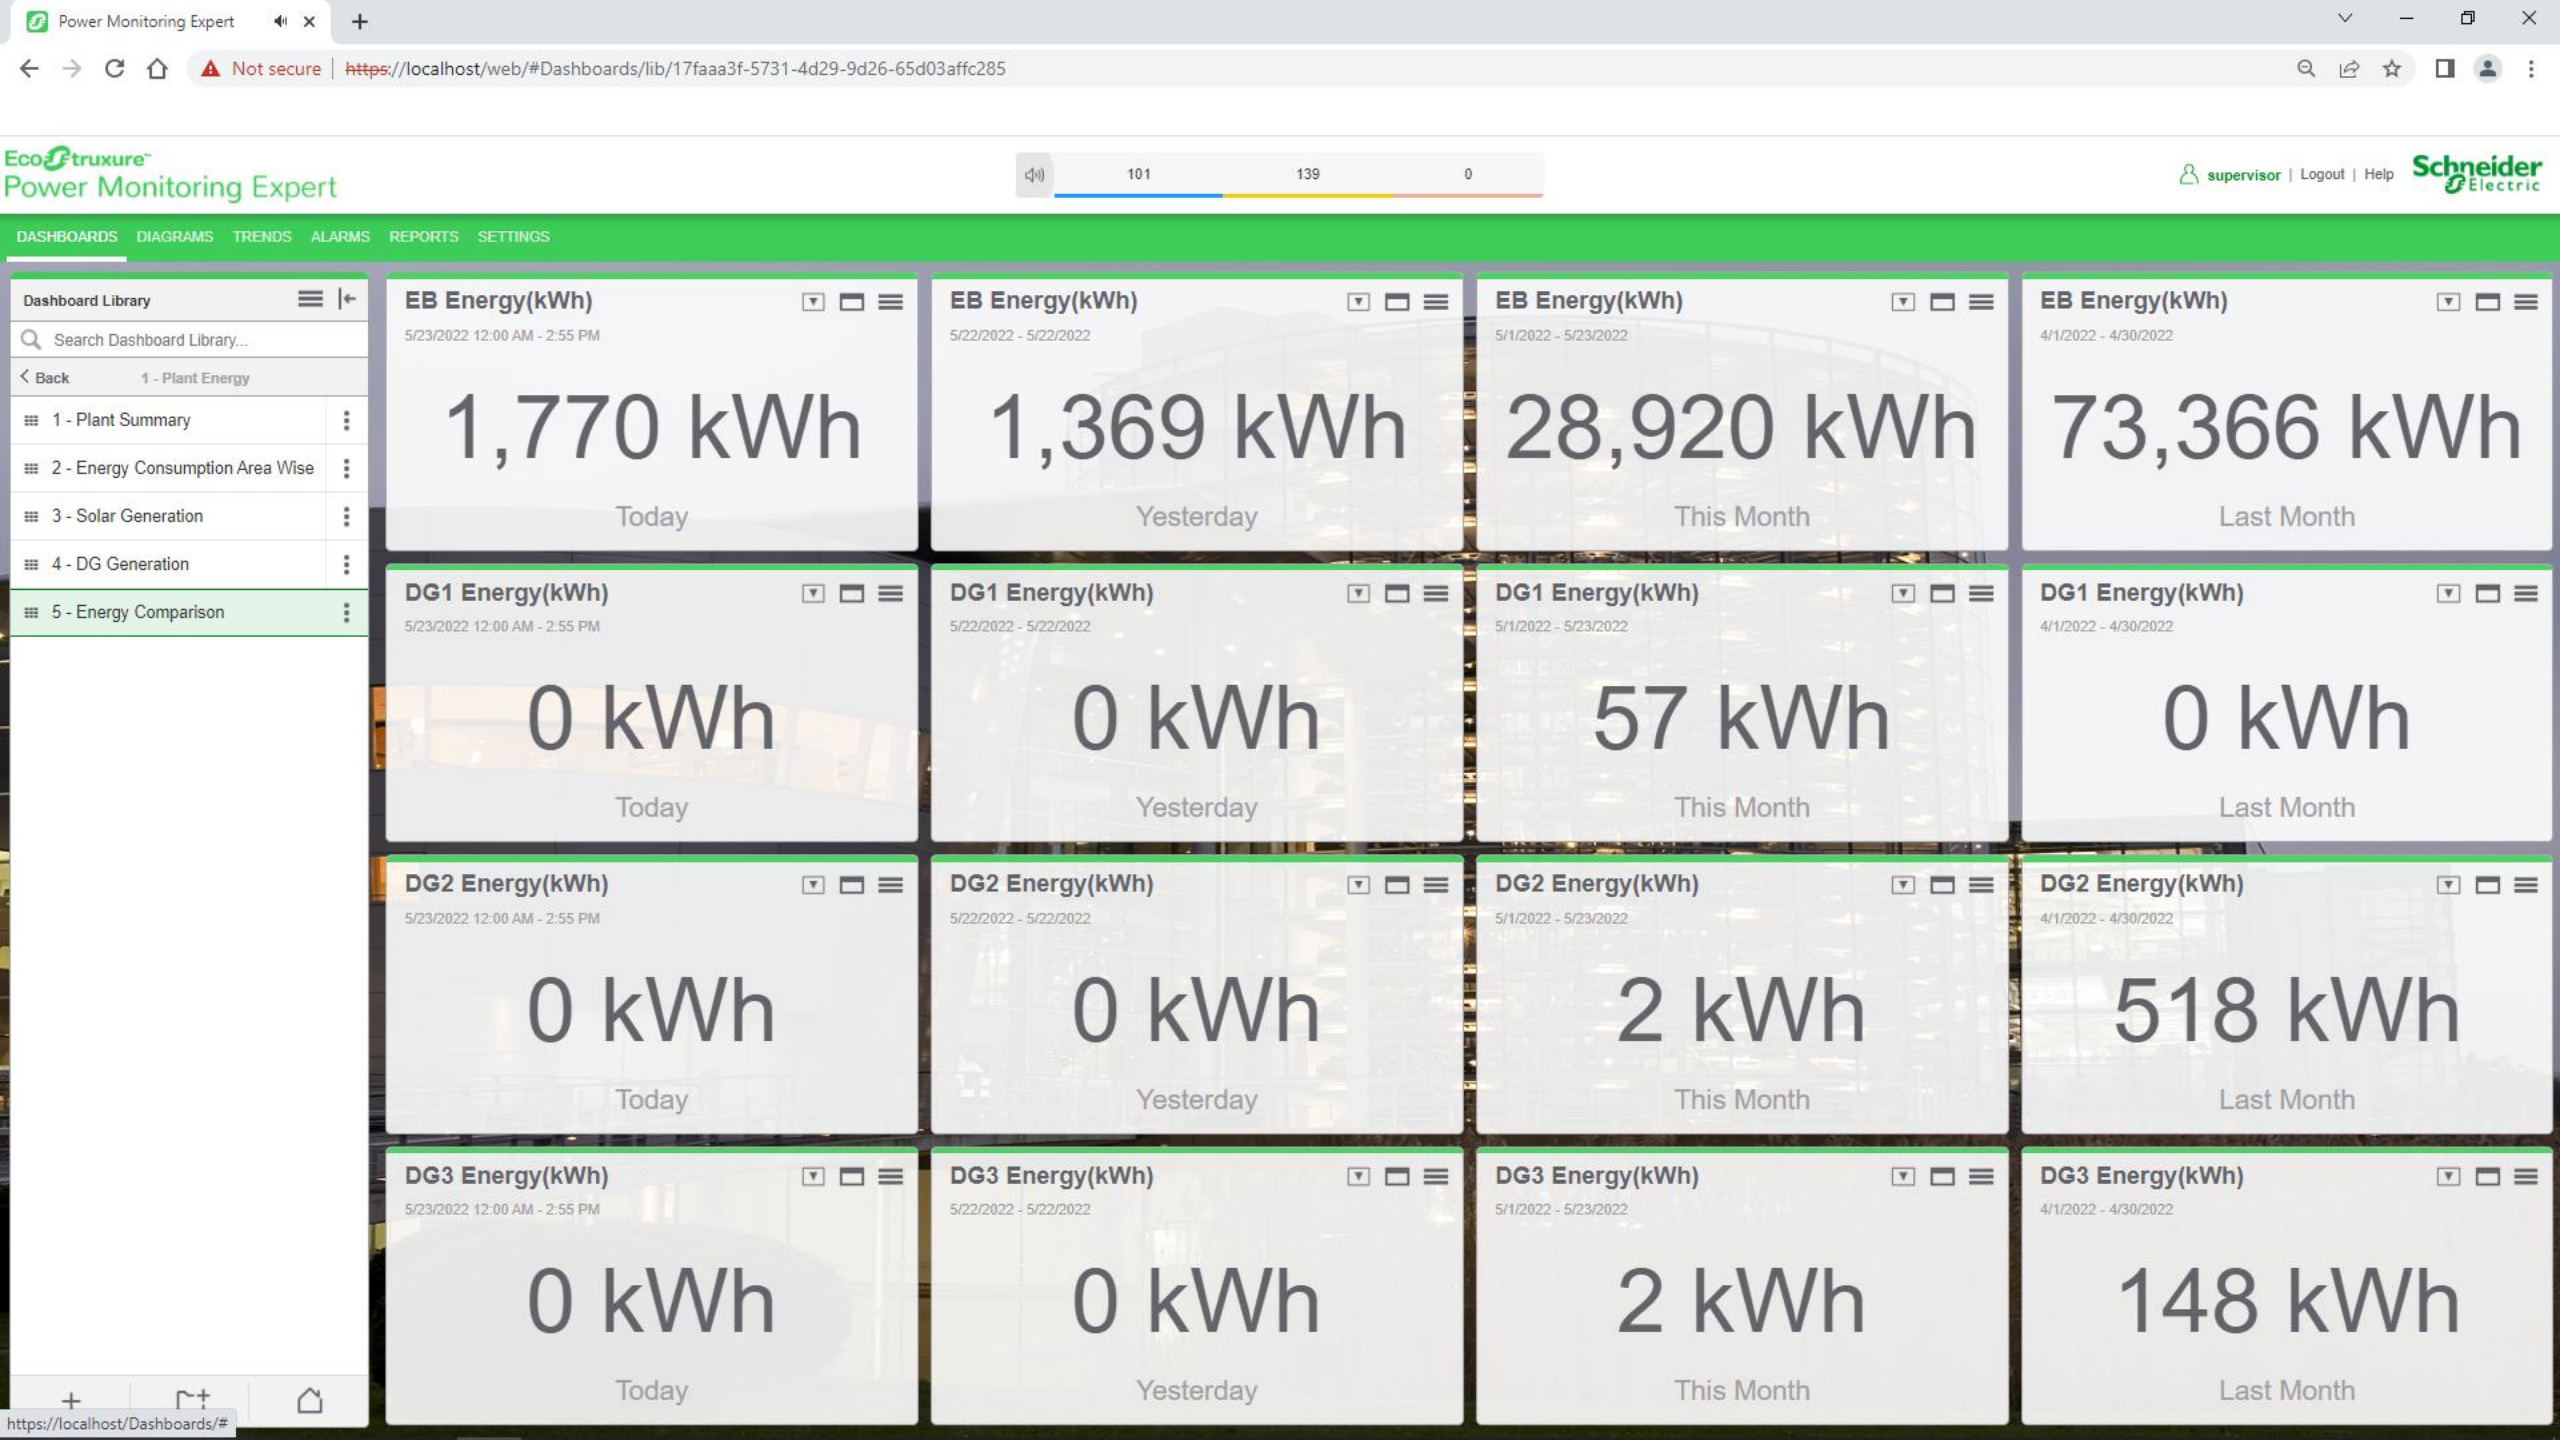

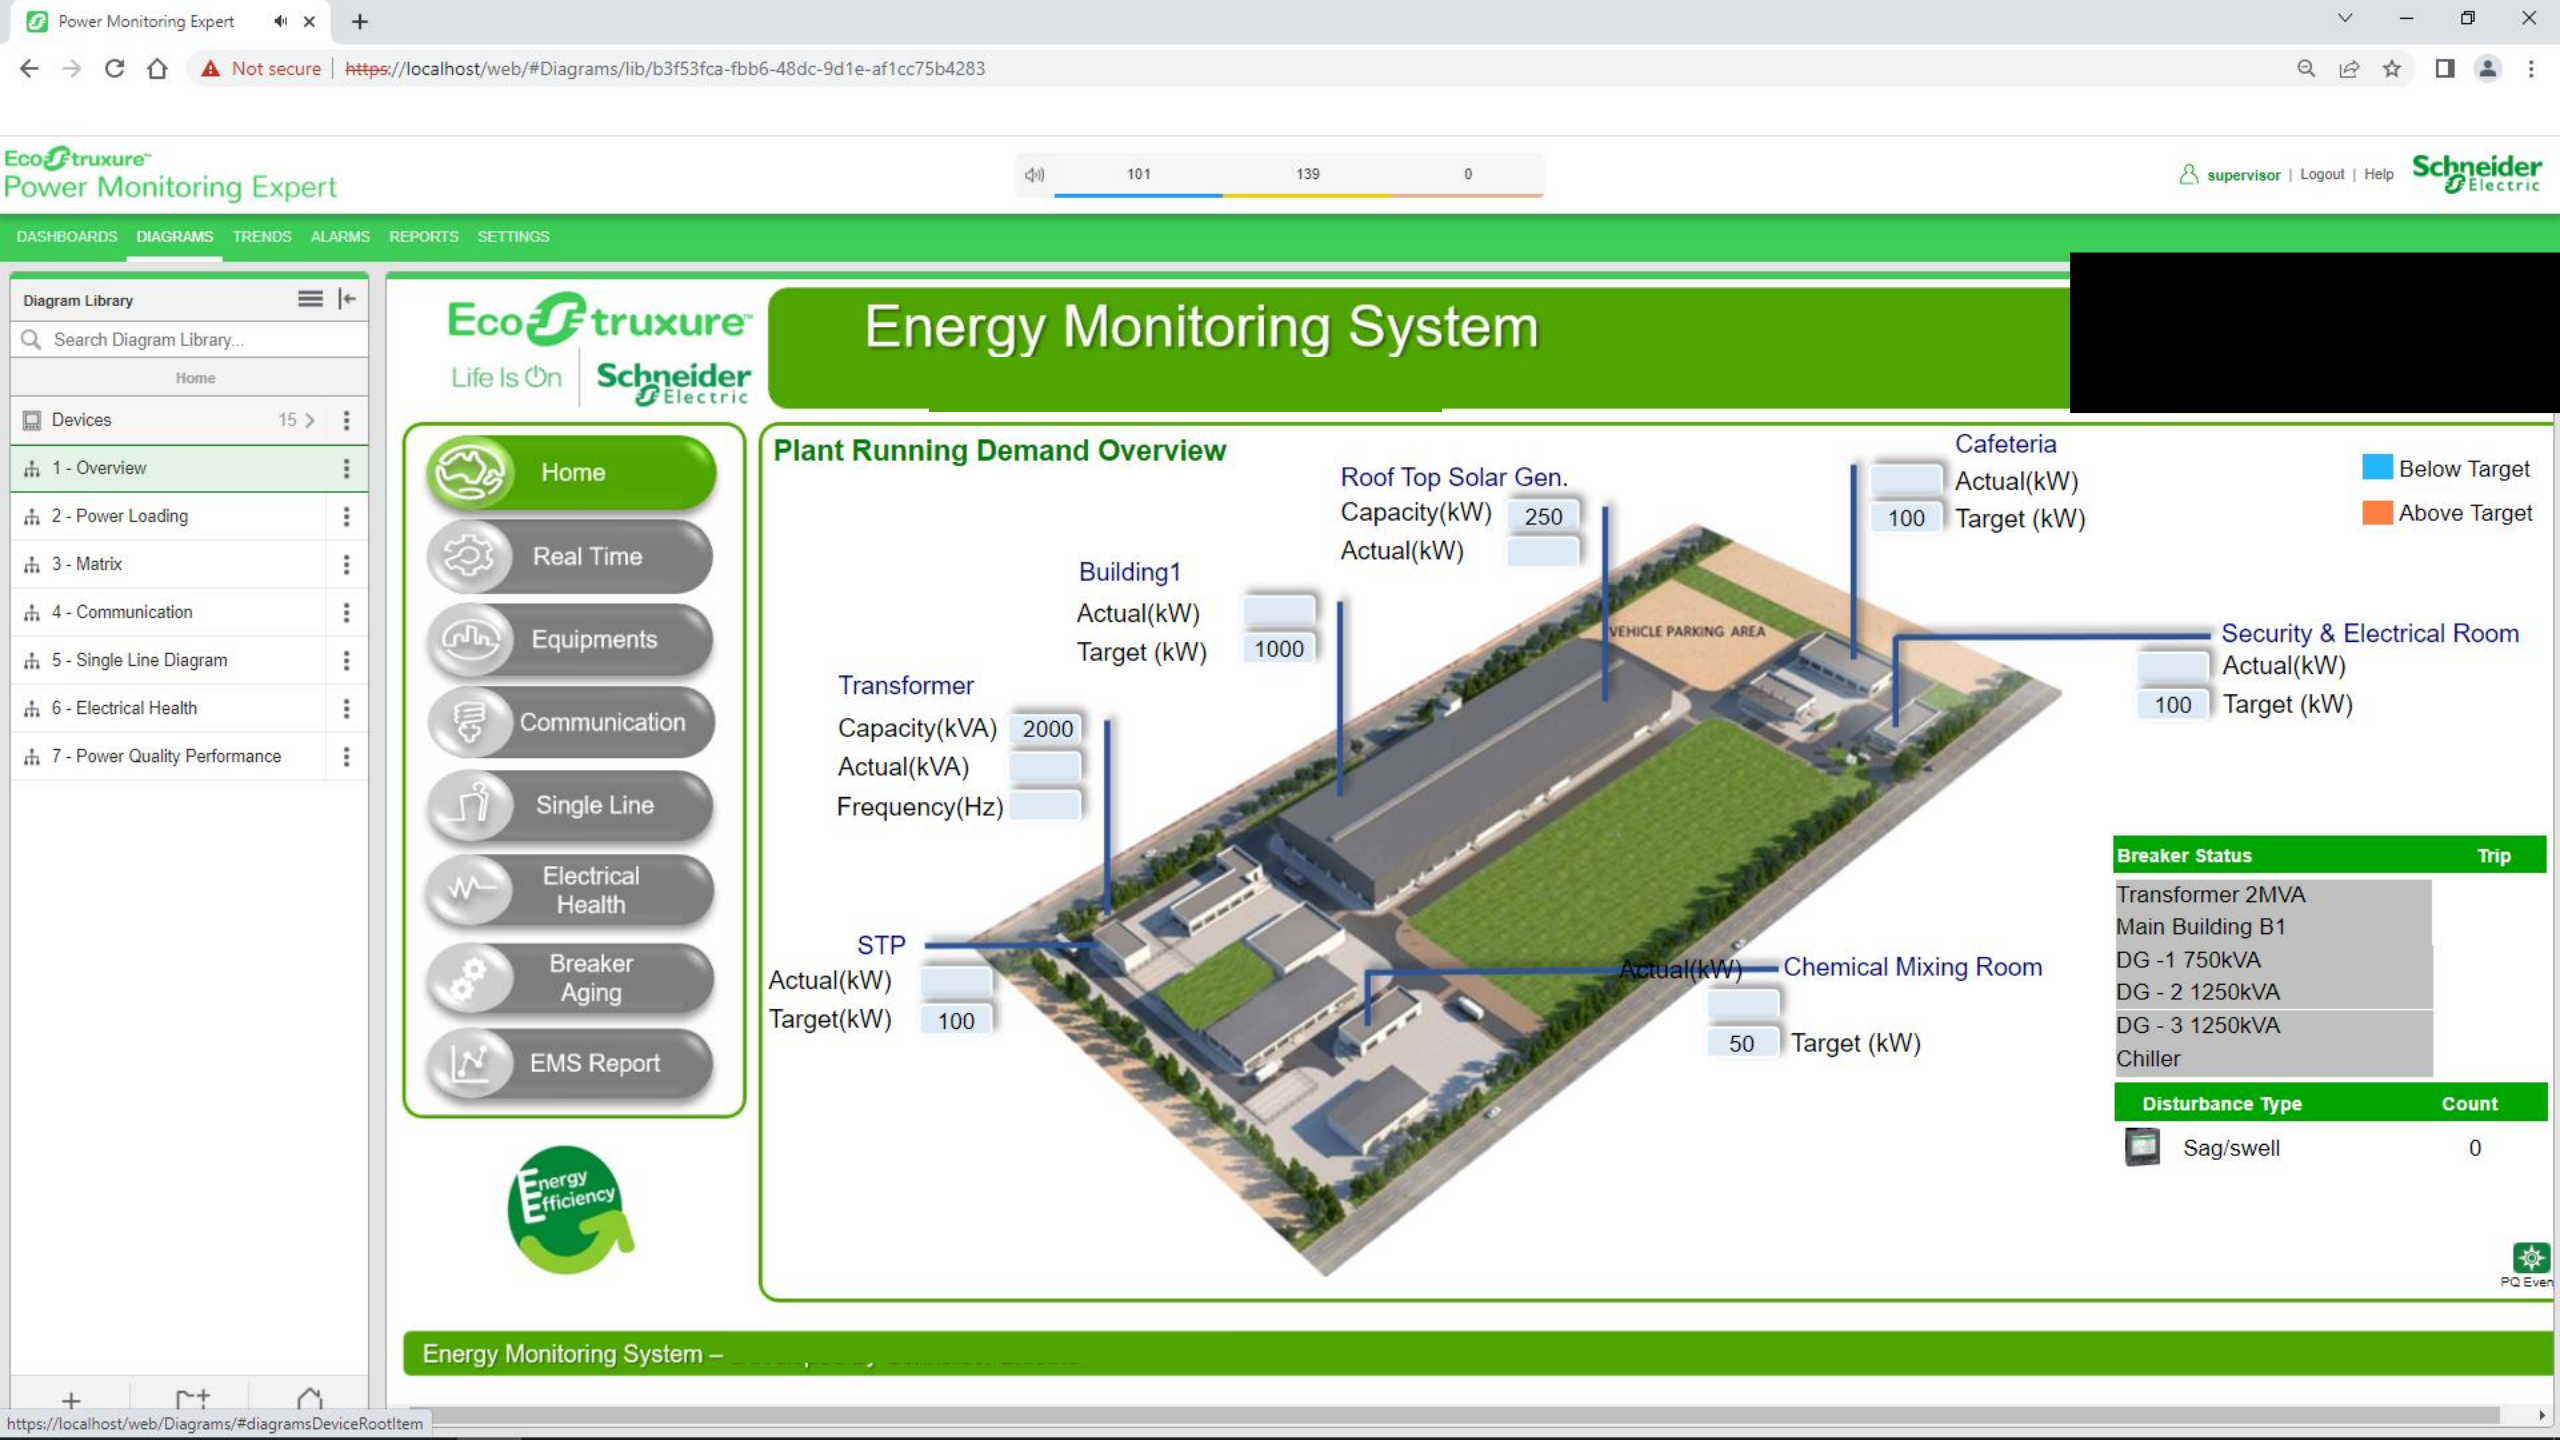



Energy Monitoring System



Home



Real Time



Equipments



Communication



Single Line

Electrical
HealthBreaker
Aging

EMS Report




Back

HIGH BAY LT ROOM

Next

Feeder name	VLL	VLN	A	Hz	PF	kW	kVA	kVAh	kWh
B1HB_M06_I01_INC_80KVA_UPS1	0	0	0			0.0		0	0
B1HB_M06_I01_INC_80KVA_UPS2	0	0	0			0.0		0	0
B1HB_M06_F01_PSDB1	397	229	1	50.0	0.745	0.6		0	4,312
B1HB_M06_F02_PSDB2	397	229	6	50.0	0.987	4.4		0	17,974
B1HB_M06_F03_PSDB3	397	229	7	50.0	0.979	4.7		0	24,977
B1HB_M06_F05_VTPN1	397	229	0	50.0		0.0		0	0
B1HB_M06_F05_VTPN4	397	229	2	50.0	0.899	1.3		0	7,014
B1HB_M06_F07_PSDB4	397	229	3	50.0	0.867	1.9		0	4,748
B1HB_M06_F08_PSDB5	397	229	0	50.0	0.142	0.0		0	42
B1HB_M06_F09_PSDB6	397	229	2	50.0	0.966	1.3		0	3,020
B1HB_M06_F11_VTPN2	397	229	6	50.0	0.996	4.2		0	14,745
B1HB_M06_F12_VTPN3	397	230	0	50.0		0.0		0	0
B1HB_M04_I01_I/C_B1HBM01EXH_PNL1	404	233	3	50.0	0.055	0.1		0	1,015
B1HB_M05_I01_INC_B1HB01	404	233	5	50.0	0.454	1.6		0	727
B1HB_M03_I01_INC_B1HB_M01	404	233	10	50.0	0.977	7.0		0	33,674

Energy Monitoring System -



Energy Monitoring System



Home



Real Time



Equipments



Communication



Single Line

Electrical
HealthBreaker
Aging

EMS Report



TRANSFORMER_1



2MVA

	HV SIDE	LV SIDE
VII	10,429.2	...
A	18.7	...
Hz	49.97	...
PF	-99.9 %	...
kW	330	...
kVA	330	...
kVAR	14	...
kWh	111,922	...

DG_SET_1



750kVA

VII	0.0
A	0.0
Hz	
PF	
kW	0.0
kVA	
kVAR	
kWh	6,582

DG_SET_2



1250kVA

VII	0.0
A	0.0
Hz	
PF	
kW	0.0
kVA	
kVAR	
kWh	5,757

DG_SET_3



1250kVA

VII	0.0
A	0.0
Hz	
PF	
kW	0.0
kVA	
kVAR	
kWh	8,398

SOLAR



200kW

VII	...
A	...
Hz	...
PF	...
kW	...
kVA	...
kVAR	...
kWh	...



Energy Monitoring System



Home



Real Time



Equipments



Communication



Single Line

Electrical
HealthBreaker
Aging

EMS Report



Back


- Communicating
- Not Communicating

Next

Feeder name	Modbus ID	Status
B1HB_M06_I01_INC_80KVA_UPS1	2	●
B1HB_M06_I01_INC_80KVA_UPS2	3	●
B1HB_M06_F01_PSDB1	4	●
B1HB_M06_F02_PSDB2	5	●
B1HB_M06_F03_PSDB3	6	●
B1HB_M06_F05_VTPN1	7	●
B1HB_M06_F05_VTPN4	8	●
B1HB_M06_F07_PSDB4	9	●
B1HB_M06_F08_PSDB5	10	●
B1HB_M06_F09_PSDB6	11	●
B1HB_M06_F11_VTPN2	12	●
B1HB_M06_F12_VTPN3	13	●
B1HB_M04_I01_I/C_B1HBM01EXH_PNL1	14	●
B1HB_M05_I01_INC_B1HB01	15	●

Feeder name	Modbus ID	Status
B1HB_M03_I01_INC_B1HB_M01	16	●
B1HB_M03_I02_FUTURE_PROVISION	17	●
B1HB_M03_F04_O/G_TO_20KVA_UPS1	18	●
B1HB_M03_F05_O/G_TO_20KVA_UPS2	19	●
B1HB_M03_F06_O/G_TO_80KVA_UPS1	20	●
B1HB_M03_F12_O/G_TO_80KVA_UPS2	21	●
B1HB_M03_F10_O/G_TO_PAC1	22	●
B1HB_M03_F11_O/G_TO_PAC2	23	●
B1HB_M01_I01_INC_M_LT_UMER_M01	2	●
B1HB_M01_F02_O/G_LOW_BAY_MEZ	3	●
B1HB_M01_F05_O/G_SPARE	4	●
B1HB_M01_F06_O/G_HIGHBAY_FLOOR	5	●
B1HB_M01_F09_O/G_UPS/MAIN_LTP	6	●
B1HB_M01_F09_O/G_LOW_BAYGF_LTP	7	●

Energy Monitoring System -




Energy Monitoring System

- Home
- Real Time
- Equipments
- Communication
- Single Line
- Electrical Health
- Breaker Aging
- EMS Report



Single Line Diagram Voltage & Current (Click on the meter icon to view the details)

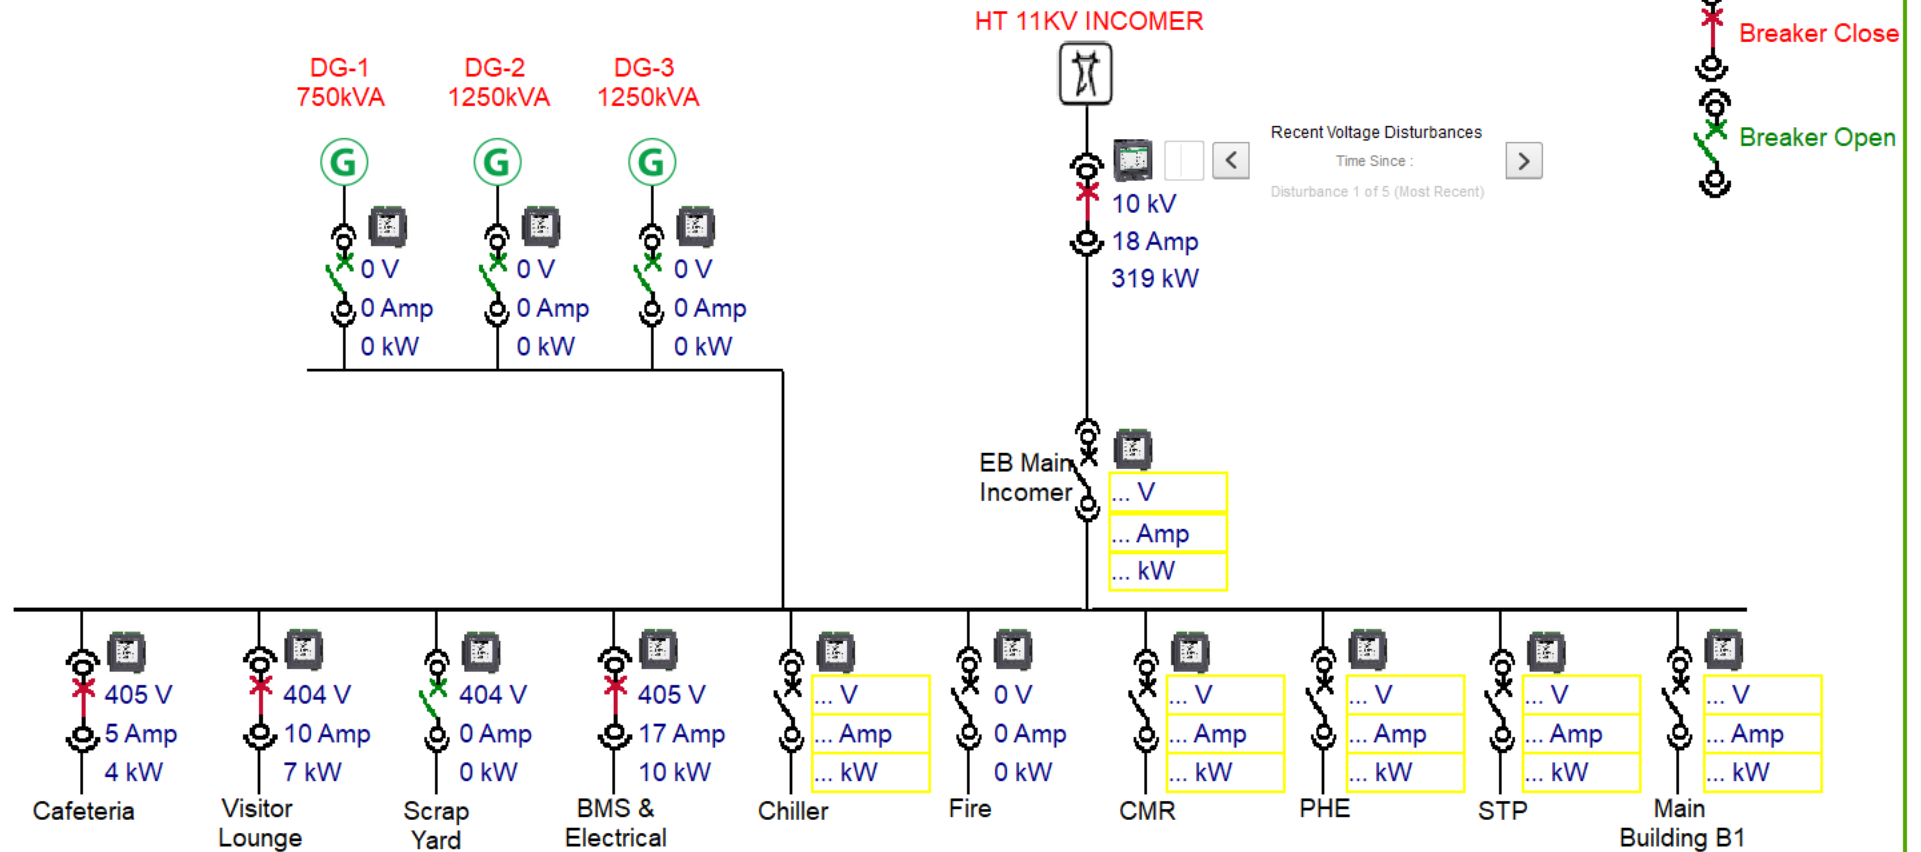

Thermal Monitoring System

Life Is On | Schneider Electric

Home

Key SLD

Network

NTPC Meja Rd, Uttar Pradesh

2UAA
INCOMER FROM UAT
#2A

TOP (°C)
R
Y
B
BOTTOM (°C)
R
Y
B



INCOMER FROM UAT
#2B

TOP (°C)
R
Y
B
BOTTOM (°C)
R
Y
B



INCOMER #A FROM
ST-2

TOP (°C)
31.3 R
32.0 Y
31.0 B
BOTTOM (°C)
31.9 R
32.9 Y
31.6 B



TIE TO UNIT BUS
#2UA

TOP (°C)
0.0 R
0.0 Y
0.0 B
BOTTOM (°C)
0.0 R
0.0 Y
0.0 B



INCOMER #B FROM
ST-2

TOP (°C)
31.1 R
31.1 Y
31.6 B
BOTTOM (°C)
30.7 R
30.8 Y
31.0 B



TIE TO UNIT BUS
#2UB

TOP (°C)
0.0 R
0.0 Y
0.0 B
BOTTOM (°C)
0.0 R
0.0 Y
0.0 B



INCOMER FROM UT #
2A

TOP (°C)
R
Y
B
BOTTOM (°C)
R
Y
B



TIE FROM STN BUS
#2SA

TOP (°C)
0.0 R
0.0 Y
0.0 B
BOTTOM (°C)
0.0 R
0.0 Y
0.0 B



TIE FROM STATION
BUS # 2SB

TOP (°C)
0.0 R
0.0 Y
0.0 B
BOTTOM (°C)
0.0 R
0.0 Y
0.0 B



INCOMER FROM UT #
2B

TOP (°C)
R
Y
B
BOTTOM (°C)
R
Y
B



Thermal Monitoring System

Life Is On | Schneider Electric

Home

Key SLD

Network

SCADA ROOM



TMS IP: 172.15.0.100

HMI

PLC

GATEWAY

Thermal sensor

LAN/ CAT6

SECTION; 3.3KV

SECTION; 11KV

SECTION; 11KV

SECTION; 11KV

SECTION; 11KV

ET IP: 172.14.0.35

ET1 IP: 172.15.0.30
ET2 IP: 172.14.0.20

IP: 1722.14.0.10
INCOMER FROM
UAT #2A

X 6

IP: 1722.14.0.11
INCOMER FROM
UAT #2B

X 6

ET IP: 172.14.0.36

ET1 IP: 172.15.0.31
ET2 IP: 172.14.0.21

IP: 1722.14.0.12
INCOMER #A FROM
ST-2

X 6

IP: 1722.14.0.13
TIE TO UNIT BUS
#2UA

X 6

ET IP: 172.14.0.37

ET1 IP: 172.15.0.32
ET2 IP: 172.14.0.22

IP: 1722.14.0.14
INCOMER #B FROM
ST-2

X 6

IP: 1722.14.0.15
TIE TO UNIT BUS
#2UB

X 6

ET IP: 172.14.0.38

ET1 IP: 172.15.0.33
ET2 IP: 172.14.0.23

IP: 1722.14.0.16
TIE FROM STN BUS
#2SA

X 6

IP: 1722.14.0.17
INCOMER FROM UT
2A

X 6

ET IP: 172.14.0.39

ET1 IP: 172.15.0.34
ET2 IP: 172.14.0.24

IP: 1722.14.0.18
TIE FROM STATION
BUS # 2SB

X 6

IP: 1722.14.0.19
INCOMER FROM UT
2B

X 6