

Diagram Library

Search Diagram Library...

< Back Datacenter

Datacenter_Main_IEC

Datacenter_Main_NEMA

MV_Thermal_Monitoring

Switchgear Monitoring

Alarm

Status

Global Status

Comm Status

Cubicle

Transformer

Cubicles Configured Max Temp

Cubicle 1	☐	✗ °C
Cubicle 2	☐	✗ °C
Cubicle 3	☐	✗ °C
Cubicle 4	☐	✗ °C
Cubicle 5	☐	✗ °C
Cubicle 6	☐	✗ °C
Cubicle 7	☐	✗ °C
Cubicle 8	☐	✗ °C
Cubicle 9	☐	✗ °C
Cubicle 10	☐	✗ °C
Cubicle 11	☐	✗ °C
Cubicle 12	☐	✗ °C
Cubicle 13	☐	✗ °C
Cubicle 14	☐	✗ °C
Cubicle 15	☐	✗ °C
Cubicle 16	☐	✗ °C

SMD_MainBuilding

Cubicle 1

Labels	Cable 01					Cable 02				
	Status		Values	Threshold		Status		Values	Threshold	
	Pre-Alarm	Alarm		Pre-Alarm	Alarm	Pre-Alarm	Alarm		Pre-Alarm	Alarm
Phase 1	☐	☐	0.00 °C			☐	☐	0.00 °C		
Phase 2	☐	☐	0.00 °C	0.00 °C	0.00 °C	☐	☐	0.00 °C	0.00 °C	0.00 °C
Phase 3	☐	☐	0.00 °C			☐	☐	0.00 °C		
Discrepancy	☐	☐	0.00 °C	0.00 °C	0.00 °C	☐	☐	0.00 °C	0.00 °C	0.00 °C

Labels	Circuit Breaker UP					Circuit Breaker Down				
	Status		Values	Threshold		Status		Values	Threshold	
	Pre-Alarm	Alarm		Pre-Alarm	Alarm	Pre-Alarm	Alarm		Pre-Alarm	Alarm
Phase 1	☐	☐	0.00 °C			☐	☐	0.00 °C		
Phase 2	☐	☐	0.00 °C	0.00 °C	0.00 °C	☐	☐	0.00 °C	0.00 °C	0.00 °C
Phase 3	☐	☐	0.00 °C			☐	☐	0.00 °C		
Discrepancy	☐	☐	0.00 °C	0.00 °C	0.00 °C	☐	☐	0.00 °C	0.00 °C	0.00 °C

Labels	Busbar				
	Status		Values	Threshold	
	Pre-Alarm	Alarm		Pre-Alarm	Alarm
Phase 1	☐	☐	0.00 °C		
Phase 2	☐	☐	0.00 °C	0.00 °C	0.00 °C
Phase 3	☐	☐	0.00 °C		
Discrepancy	☐	☐	0.00 °C	0.00 °C	0.00 °C

Diagram Library

Search Diagram Library...

< Back Datacenter

Datacenter_Main_IEC

Datacenter_Main_NEMA

MV_Thermal_Monitoring

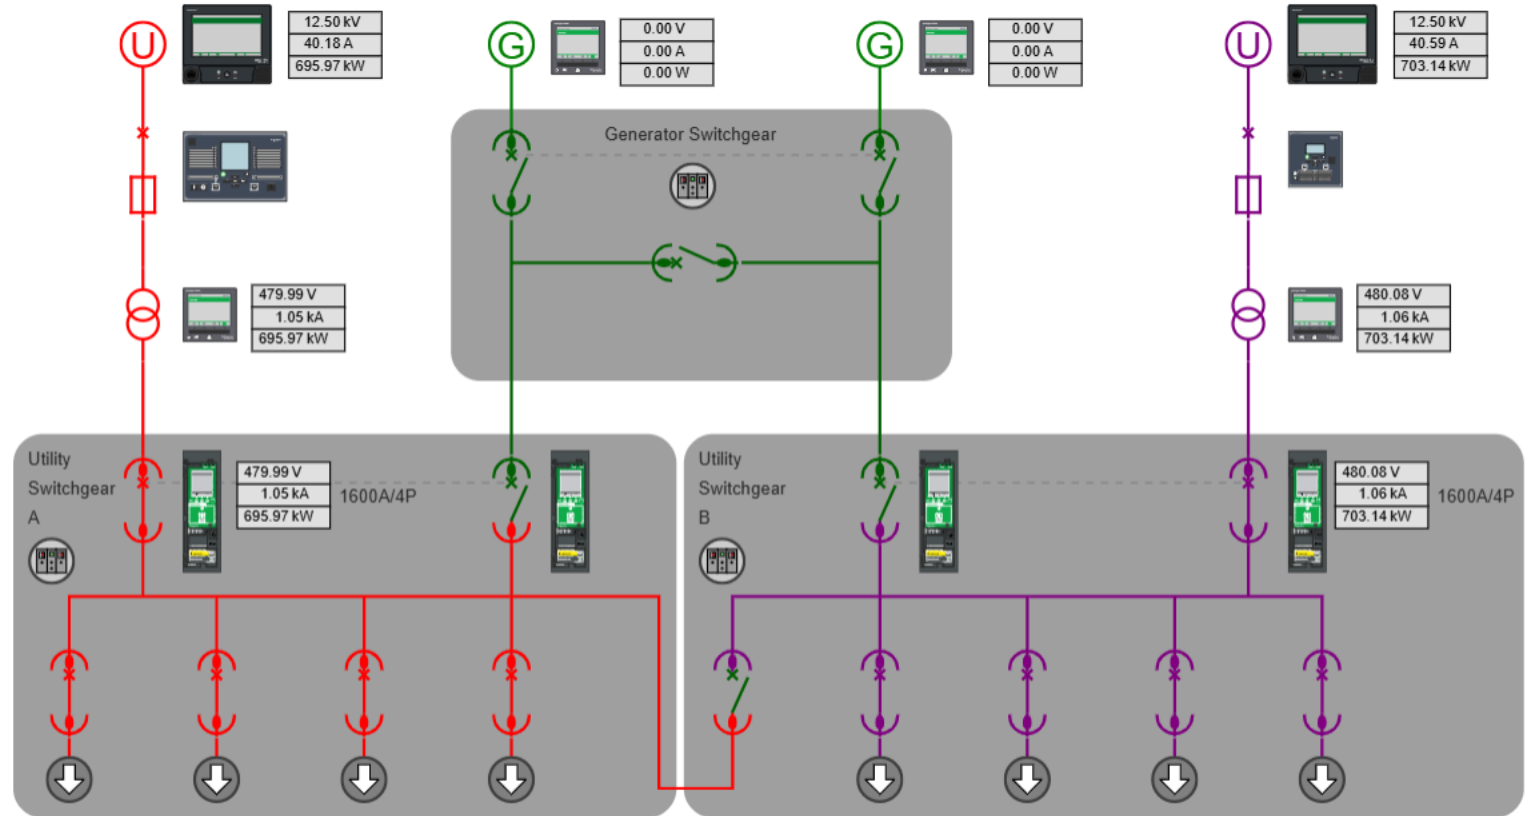


Diagram Library

Search Diagram Library...

< Back EV Battery

EV_Battery_Main_IEC

EV_Battery_Main_NEMA

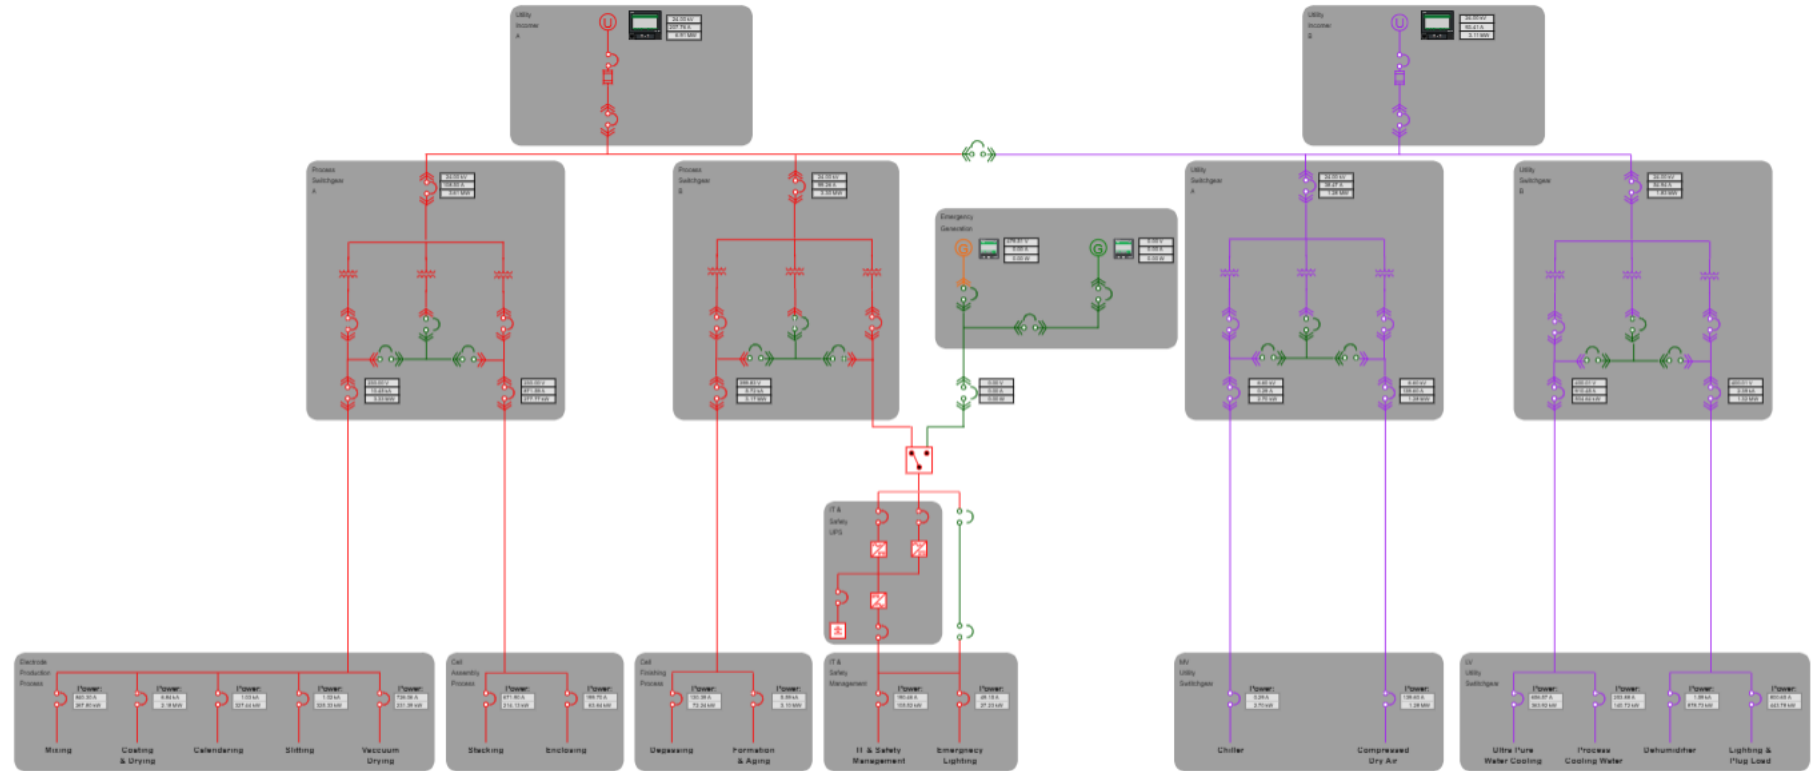


Diagram Library

Search Diagram Library...

< Back

Microgrid

Microgrid_Main_IEC

Microgrid_Main_NEMA

