Synthetic scientific figure

FICTIONAL DATA - no biological or clinical conclusion is asserted.

Figure 1. Artificial endpoint measurements.

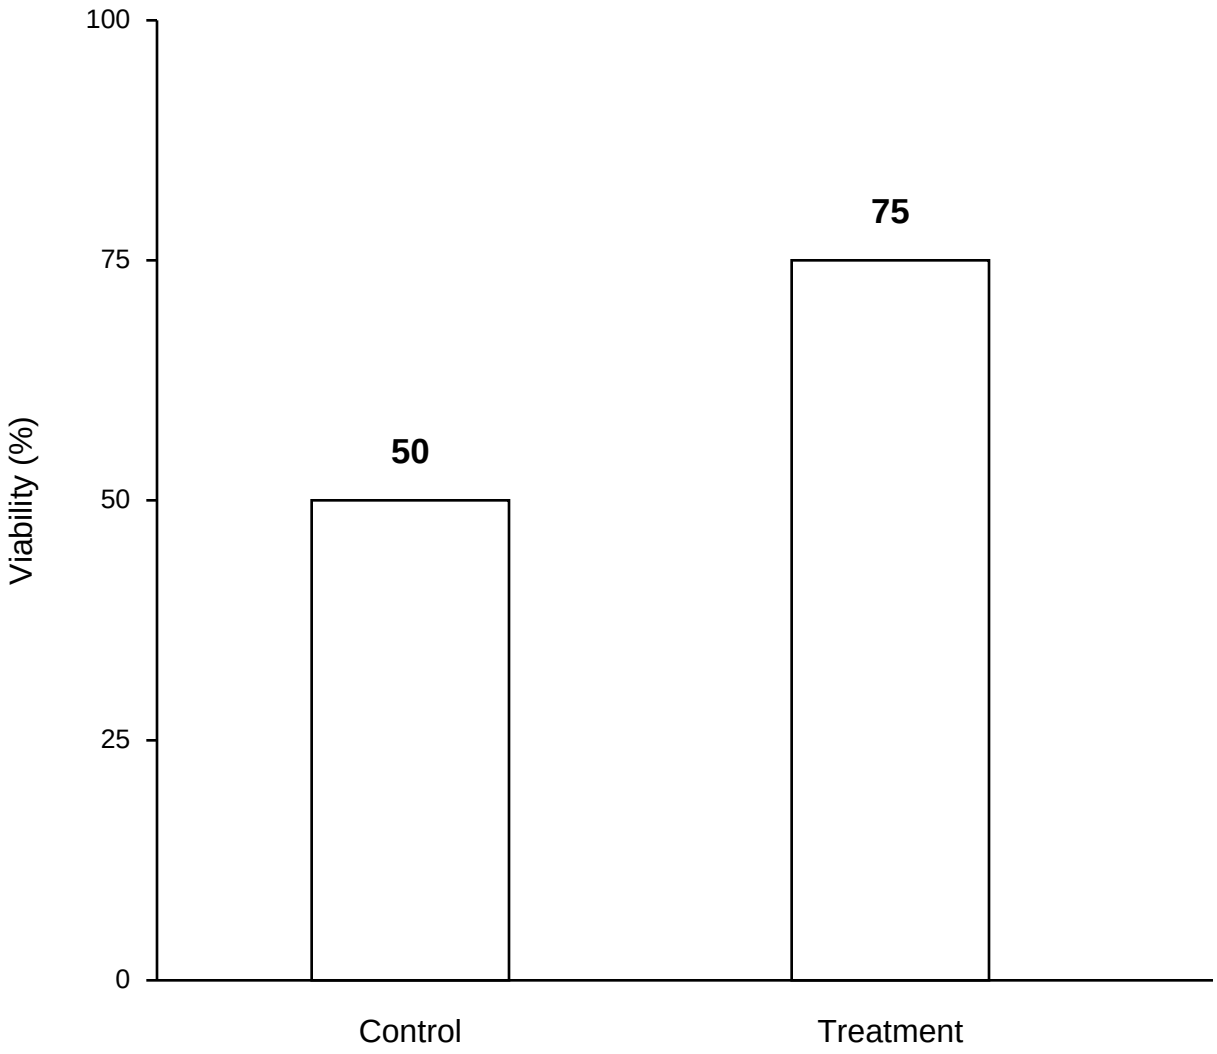

Fictional author claim: "Treatment is twice the control."

No replicate count, error bars, or statistical test is supplied.

Treat that claim as source prose, not automatically as a valid inference.

Table and equation structure

SYNTHETIC TEST FIXTURE

Table 1. Artificial instrument readings; units are arbitrary units (a.u.).

Time (h)	Control (a.u.)	Treatment (a.u.)
0	10	10
24	15	30

Equation supplied in plain text: R = (T - C) / C

T and C denote treatment and control readings at the same time.

Units and row/column associations must be preserved.