

# Preface

## Manual Usage

This manual introduces the main characteristics, performance, and working principle of the new generation Tower intelligent UPS, and provides users with information on installation, use, operation, and maintenance.

## Users

Technical Support Engineer  
Service Engineer  
Authorized Person

## Note

Our company is providing a full range of technical support and service. Customers can contact our local office or customer service center for help.

The manual will update irregularly, due to the product upgrading or other reasons.

Unless otherwise agreed, the manual is only used as guide for users and any statements or information contained in this manual make no warranty expressed or implied.

# Contents

|                                                  |           |
|--------------------------------------------------|-----------|
| <b>Preface .....</b>                             | <b>1</b>  |
| Manual Usage .....                               | 1         |
| Users .....                                      | 1         |
| Note .....                                       | 1         |
| <b>Contents.....</b>                             | <b>2</b>  |
| <b>1 Safety Precautions .....</b>                | <b>4</b>  |
| 1.1 Safety Information Definition .....          | 4         |
| 1.2 Warning Label .....                          | 4         |
| 1.3 Safety Instruction .....                     | 4         |
| 1.5 Debug & Operate .....                        | 5         |
| 1.6 Maintenance & Replacement .....              | 5         |
| 1.7 Battery Safety .....                         | 6         |
| 1.8 Disposal .....                               | 7         |
| 1.9 Note .....                                   | 7         |
| <b>2 UPS Structure and Introduction .....</b>    | <b>8</b>  |
| 2.1 Product Introduction .....                   | 8         |
| 2.3 UPS Type and Configuration .....             | 8         |
| 2.3.1 UPS Type .....                             | 8         |
| 2.3.2 UPS Configuration .....                    | 8         |
| 2.4 Appearance and Components .....              | 9         |
| 2.4.1 Details of UPS front and rear views .....  | 11        |
| 2.5 UPS System Description .....                 | 16        |
| 2.6 Operation Mode .....                         | 16        |
| 2.6.1 Normal Mode .....                          | 17        |
| 2.6.2 Battery Mode .....                         | 17        |
| 2.6.3 Bypass Mode .....                          | 17        |
| 2.6.4 Maintenance Mode (Manual Bypass) .....     | 18        |
| 2.6.5 ECO Mode .....                             | 18        |
| 2.6.6 Source-share mode .....                    | 19        |
| 2.6.7 Auto-restart Mode .....                    | 19        |
| 2.6.8 Frequency Converter Mode .....             | 20        |
| <b>3 Installation .....</b>                      | <b>21</b> |
| 3.1 Location .....                               | 21        |
| 3.1.1 Installation Environment .....             | 21        |
| 3.1.2 Site Selection .....                       | 21        |
| 3.1.3 Size and Weight .....                      | 21        |
| 3.2 Unpacking and Inspection .....               | 22        |
| 3.2.1 Moving and Unpacking of the Cabinet .....  | 22        |
| 3.3 Positioning .....                            | 23        |
| 3.3.1 Positioning Cabinet .....                  | 23        |
| 3.4 Battery .....                                | 26        |
| 3.5 Cable Entry .....                            | 26        |
| 3.6 Power Cables .....                           | 27        |
| 3.6.1 Cables Specifications .....                | 27        |
| 3.6.2 Power Cables Terminal Specifications ..... | 29        |
| 3.6.3 Circuit Breaker Specifications .....       | 29        |
| 3.6.4 Connecting Power Cables .....              | 29        |
| 3.7 Control and Communication Cables .....       | 31        |
| 3.7.1 Dry Contact Interface .....                | 34        |
| 3.7.2 Communication Interface .....              | 39        |
| <b>4 UPS Control LCD Panel .....</b>             | <b>40</b> |
| 4.1 UPS LCD Panel .....                          | 40        |
| 4.1.1 LED Indicator .....                        | 40        |

|                                                                            |           |
|----------------------------------------------------------------------------|-----------|
| 4.1.3 LCD Touch Screen .....                                               | 41        |
| 4.2 Main Menu.....                                                         | 42        |
| 4.2.1 User Login .....                                                     | 42        |
| 4.2.2 Data Menu .....                                                      | 43        |
| 4.2.4 Set Menu .....                                                       | 44        |
| 4.2.5 Log Menu.....                                                        | 46        |
| 4.2.6 Control Menu .....                                                   | 54        |
| <b>5 Operations .....</b>                                                  | <b>57</b> |
| 5.1 UPS Start-up .....                                                     | 57        |
| 5.1.1 Startup in normal mode .....                                         | 57        |
| 5.1.2 Start from battery.....                                              | 57        |
| 5.2 UPS Shut down .....                                                    | 58        |
| 5.3 Procedure for Switching between Operation Modes .....                  | 59        |
| 5.3.1 Switching the UPS from Normal Mode into Battery Mode .....           | 59        |
| 5.3.2 Switching the UPS from Normal Mode into Bypass Mode.....             | 59        |
| 5.3.3 Switching the UPS into Normal Mode from Bypass Mode.....             | 59        |
| 5.3.4 Switching the UPS into Maintenance Bypass Mode from Normal Mode..... | 59        |
| 5.3.5 Switching the UPS into Normal Mode from Maintenance Bypass Mode..... | 60        |
| 5.4 Battery Maintenance .....                                              | 61        |
| 5.5 Parallel UPS .....                                                     | 62        |
| 5.5.1 Diagram of the parallel system.....                                  | 62        |
| 5.5.2 Parallel operation process .....                                     | 63        |
| <b>6 Maintenance .....</b>                                                 | <b>66</b> |
| 6.1 Precautions .....                                                      | 66        |
| 6.2 Instruction for maintaining UPS .....                                  | 66        |
| 6.3 Instruction for Maintaining Battery String.....                        | 66        |
| <b>7. Product Specifications .....</b>                                     | <b>68</b> |
| 7.1 Applicable Standards .....                                             | 68        |
| 7.2 Environmental Characteristics .....                                    | 68        |
| 7.3 Mechanical Characteristics .....                                       | 69        |
| 7.4 Electrical Characteristics.....                                        | 69        |
| 7.4.1 Electrical Characteristics (Input Rectifier) .....                   | 69        |
| 7.4.2 Electrical Characteristics (Intermediate DC Link) .....              | 70        |
| 7.4.3 Electrical Characteristics (Inverter Output) .....                   | 70        |
| 7.4.4 Electrical Characteristics (Bypass Mains Input).....                 | 71        |
| 7.5 Efficiency .....                                                       | 72        |
| 7.6 Display and Interface .....                                            | 72        |
| <b>Annex. A   Installation of internal batteries .....</b>                 | <b>73</b> |

# 1 Safety Precautions

This manual contains information concerning the installation and operation of Tower UPS. Please carefully read this manual prior to installation.

The Tower UPS cannot be put into operation until it is commissioned by engineers approved by the manufacturer (or its agent). Not doing so could result in personnel safety risk, equipment malfunction and invalidation of warranty.

## 1.1 Safety Information Definition

**Danger:** Serious human injury or even death may be caused, if this requirement is ignored.

**Warning:** Human injury or equipment damage may be caused, if this is requirement is ignored.

**Attention:** Equipment damage, loss of data or poor performance may be caused, if this requirement is ignored.

**Commissioning Engineer:** The engineer who installs or operates the equipment should be well trained in electricity and safety, and familiar with the operation, debug, and maintenance of the equipment.

## 1.2 Warning Label

The warning label indicates the possibility of human injury or equipment damage, and advised the proper step to avoid the danger. In this manual, there are three types of warning labels as below.

| Labels                                                                                             | Description                                                                                       |
|----------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------|
|  <b>DANGER</b>  | Serious human injury or even death may be caused, if this requirement is ignored.                 |
|  <b>WARNING</b> | Human injury or equipment damage may be caused, if this requirement is ignored.                   |
|  <b>CAUTION</b> | Equipment damage, loss of data or poor performance may be caused, if this requirement is ignored. |

## 1.3 Safety Instruction

|                                                                                                    |                                                                                                                                                                                                                                                |
|----------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  <b>DANGER</b>  | <ul style="list-style-type: none"> <li>Performed only by commissioning engineers.</li> <li>This UPS is designed for commercial and industrial applications only, and is not intended for any use in life-support devices or system.</li> </ul> |
|  <b>WARNING</b> | <ul style="list-style-type: none"> <li>Read all the warning labels carefully before operation, and follow the instructions.</li> </ul>                                                                                                         |
|                 | <ul style="list-style-type: none"> <li>When the system is running, do not touch the surface with this label, to avoid any hurt or scald.</li> </ul>                                                                                            |
|                 | <ul style="list-style-type: none"> <li>ESD sensitive components inside the UPS, anti-ESD measure should be taken before handling.</li> </ul>                                                                                                   |

## 1.4 Move & Installation

|                                                                                                  |                                                                                                                                                                                                                                                                                                                                                                     |
|--------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  <b>DANGER</b>  | <ul style="list-style-type: none"> <li>■ Keep the equipment away from heat source or air outlets.</li> <li>■ In case of fire, use dry powder extinguisher only, any liquid extinguisher can result in electric shock.</li> </ul>                                                                                                                                    |
|  <b>WARNING</b> | <ul style="list-style-type: none"> <li>■ Don't start the system if any damage or abnormal parts founded.</li> <li>■ Contacting the UPS with wet material or hands may be subject to electric shock.</li> </ul>                                                                                                                                                      |
|  <b>CAUTION</b> | <ul style="list-style-type: none"> <li>■ Use proper facilities to handle and install the UPS. Shielding shoes, protective clothes and other protective facilities are necessary to avoid injury.</li> <li>■ During positioning, keep the UPS away from shock or vibration.</li> <li>■ Install the UPS in proper environment, more detail in section 2.3.</li> </ul> |

## 1.5 Debug & Operate

|                                                                                                    |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
|----------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  <b>DANGER</b>  | <ul style="list-style-type: none"> <li>■ Make sure the grounding cable is well connected before connecting the power cables, the grounding cable and neutral cable must be in accordance with the local and national codes practice.</li> <li>■ Before moving or re-connecting the cables, make sure to cut off all the input power sources, and wait for at least 10 minutes for internal discharge. Use a multi-meter to measure the voltage on terminals and ensure the voltage is lower than 36V before operation.</li> </ul> |
|  <b>WARNING</b> | <ul style="list-style-type: none"> <li>■ The earth leakage current of load will be carried by RCCB OR RCD.</li> <li>■ Initial check and inspection should be performed after long time storing of UPS.</li> </ul>                                                                                                                                                                                                                                                                                                                 |

## 1.6 Maintenance & Replacement

|                                                                                                   |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |
|---------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  <b>DANGER</b> | <ul style="list-style-type: none"> <li>■ All the equipment maintenance and servicing procedures involving internal access need special tools and should be carried out only by trained personnel. The components that can be accessed by opening the protective cover with tools cannot be maintenance by user.</li> <li>■ This UPS full complies with "IEC62040-1-1-General and safety requirements for use in operator access area UPS". Dangerous voltages are present within the battery box.</li> <li>■ However, the risk of contact with these high voltages is minimized for non-service personnel. Since the component with dangerous voltage can only be touched by opening the protective cover with a tool, the possibility of touching high voltage component is minimized. No risk exists to any personnel when operating the equipment in the normal manner, following the recommended operating procedures in this manual.</li> </ul> |
|---------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

## 1.7 Battery Safety

|                                                                                                   |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
|---------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  <b>DANGER</b> | <ul style="list-style-type: none"> <li>■ All the battery maintenance and servicing procedures involving internal access need special tools or keys and should be carried out only by trained personnel.</li> <li>■ When connected together, the battery terminal voltage will exceed 400Vdc and is potentially lethal.</li> <li>■ Battery manufacturers supply details of the necessary precautions to be observed when working on, or in the vicinity of a large bank of battery cells. These precautions should be followed implicitly at all times. Particular attention should be paid to the recommendations concerning local environmental conditions and the provision of protective clothing, first aid and fire-fighting facilities.</li> <li>■ Ambient temperature is a major factor in determining the battery capacity and life. The nominal operating temperature of battery is 20°C. Operating above this temperature will reduce the battery life. Periodically change the battery according to the battery user manuals to ensure the back-up time of UPS.</li> <li>■ Replace the batteries only with the same type and the same number, or it may cause explosion or poor performance.</li> <li>■ When connecting the battery, follow the precautions for high-voltage operation before accepting and using the battery, check the appearance of the batteries. If the package is damaged, or the battery terminal is dirty, corroded or rusted or the shell is broken, deformed or has leakage, replace it with new product. Otherwise, battery capacity reduction, electric leakage or fire may be caused.</li> <li>■ Before operating the battery, remove the finger ring, watch, necklace, bracelet and any other metal jewelry.</li> <li>■ Wear rubber gloves.</li> <li>■ Eye protection should be worn to prevent injury from accidental electrical arcs.</li> <li>■ Only use tools (e.g. wrench) with insulated handles.</li> <li>■ The batteries are very heavy. Please handle and lift the battery with proper method to prevent any human injury or damage to the battery terminal.</li> <li>■ Don't decompose, modify or damage the battery. Otherwise, battery short circuit, leakage or even human injury may be caused.</li> <li>■ The battery contains sulfuric acid. In normal operation, all the sulfuric acid is attached to the separation board and plate in the battery. However, when the battery case is broken, the acid will leak from the battery. Therefore, be sure to wear a pair of protective glasses, rubber gloves and skirt when operating the battery. Otherwise, you may become blind if acid enters your eyes and your skin may be damaged by the acid.</li> <li>■ At the end of battery life, the battery may have internal short circuit, drain of electrolytic and erosion of positive/negative plates. If this condition continues, the battery may have temperature out of control, swell or leak. Be sure to replace the battery before these phenomena</li> </ul> |
|---------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

|  |                                                                                                                                                                                                                                                                                                                                                                                           |
|--|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  | <p>happen.</p> <ul style="list-style-type: none"> <li>■ If a battery leaks electrolyte, or is otherwise physically damaged, it must be replaced, stored in a container resistant to sulfuric acid and disposed of in accordance with local regulations.</li> <li>■ If electrolyte comes into contact with the skin, the affected area should be washed immediately with water.</li> </ul> |
|--|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

## 1.8 Disposal

|                                                                                                  |                                                                                                                  |
|--------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------|
|  <b>WARNING</b> | <ul style="list-style-type: none"> <li>■ Dispose of used battery according to the local instructions.</li> </ul> |
|--------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------|

## 1.9 Note

|                                                                                               |                                                                                                                          |
|-----------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------|
|  <b>Note</b> | <ul style="list-style-type: none"> <li>■ Represents a supplementary explanation or emphasis to the main text.</li> </ul> |
|-----------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------|

## 2 UPS Structure and Introduction

### 2.1 Product Introduction

The intelligent tower UPS series products adopt online double conversion design, based on DSP full digital control, to provide a stable and uninterrupted power supply for important loads, which can eliminate surges, instantaneous high voltage, instantaneous low voltage, and "Power pollution" such as wire noise and frequency offset, provide customers with high-efficiency and high-power-density power supply guarantees.

### 2.3 UPS Type and Configuration

#### 2.3.1 UPS Type

The UPS types are shown in Table 2-1.

Table 2-1 UPS Type

| Model  | Type                                     |
|--------|------------------------------------------|
| 10kVA  | Long backup time<br>Standard backup time |
| 20kVA  |                                          |
| 30kVA  |                                          |
| 40kVA  |                                          |
| 60kVA  |                                          |
| 80kVA  |                                          |
| 100kVA |                                          |
| 180kVA |                                          |
| 200kVA | Long backup time                         |

#### 2.3.2 UPS Configuration

The UPS configurations are shown in Table 2-2.


Table 2-2 UPS Configuration

| Item                 | Components          | Quantity | Remark                       |
|----------------------|---------------------|----------|------------------------------|
| Standard Backup Type | Circuit Breakers    | 5        | Standard                     |
|                      | Dual Input          | 1        | Standard                     |
|                      | Dry Contact Card    | 1        | Standard                     |
|                      | RS232,485, USB      | 1        | Standard                     |
|                      | SNMP; Parallel Card | 1        | Optional                     |
|                      | Battery cold start  | 1        | Standard                     |
| Long Backup Type     | Circuit Breakers    | 4        | Standard                     |
|                      | Dual Input          | 1        | Standard                     |
|                      | Dry Contact Card    | 1        | Standard                     |
|                      | RS232,485, USB      | 1        | Standard                     |
|                      | SNMP; Parallel Card | 1        | Optional                     |
|                      | Battery cold start  | 1        | Optional(80-200kva standard) |




## 2.4 Appearance and Components


The UPS outlooks are shown as figure 2-1.

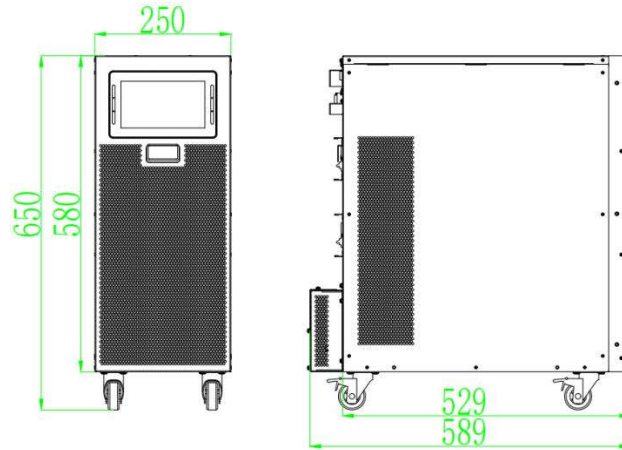


(a) 10/15/20/30kVA long backup type (unit: mm)

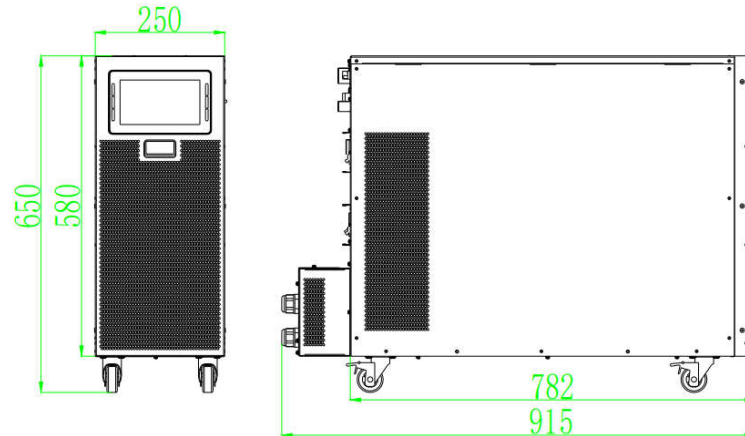


(b) 40/60kVA long backup type (unit: mm)

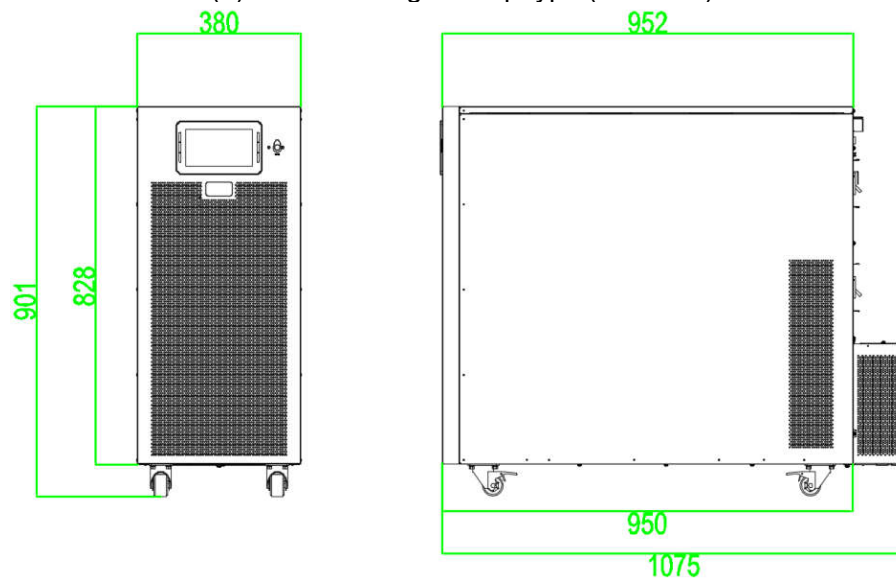


(c) 80-100kVA long backup type (unit: mm)

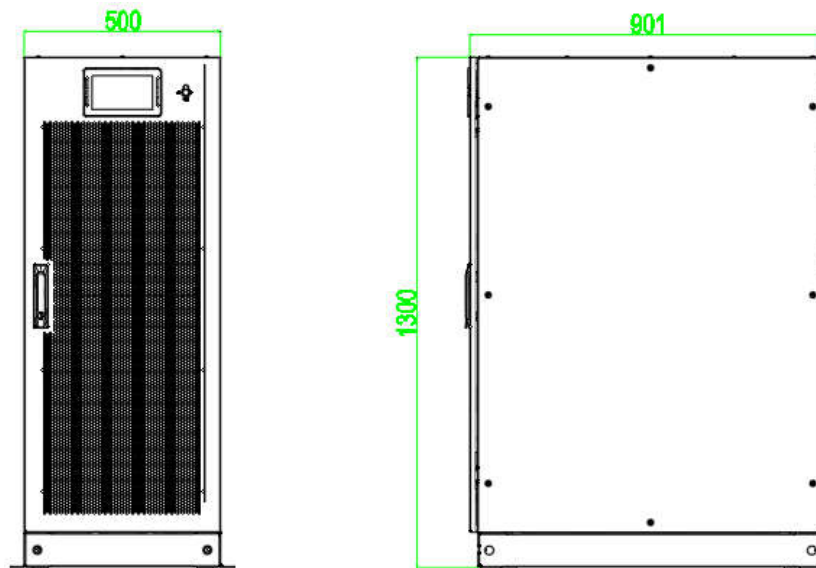


(d) 180-200kVA long backup type (unit: mm)

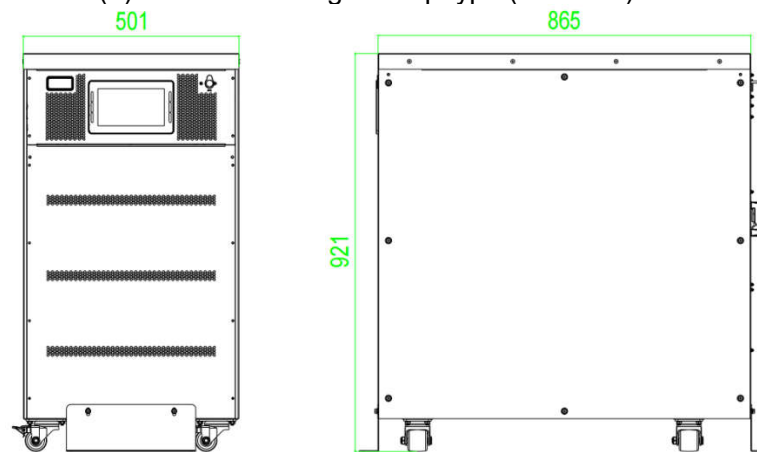

(e) 10/15/20/30/40kVA standard backup type (unit: mm)

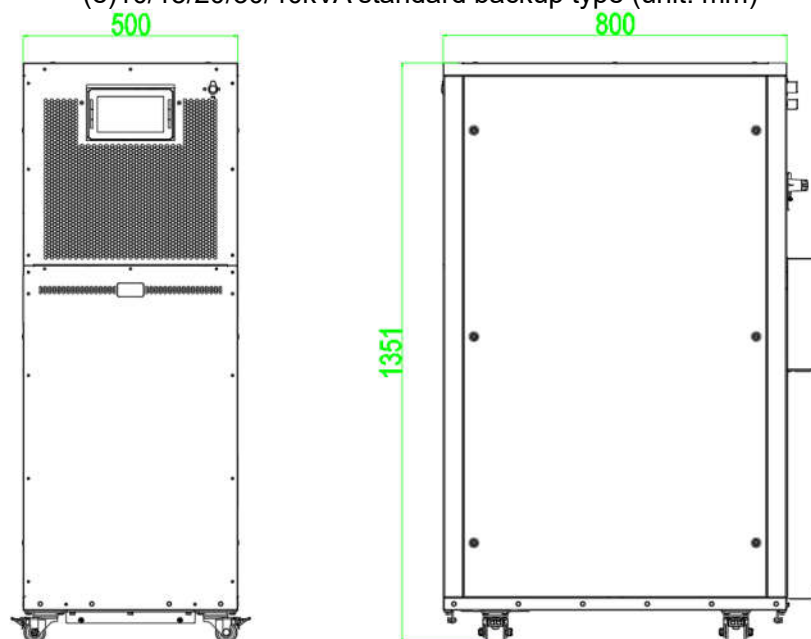

(f) 60kVA standard backup type (unit: mm)

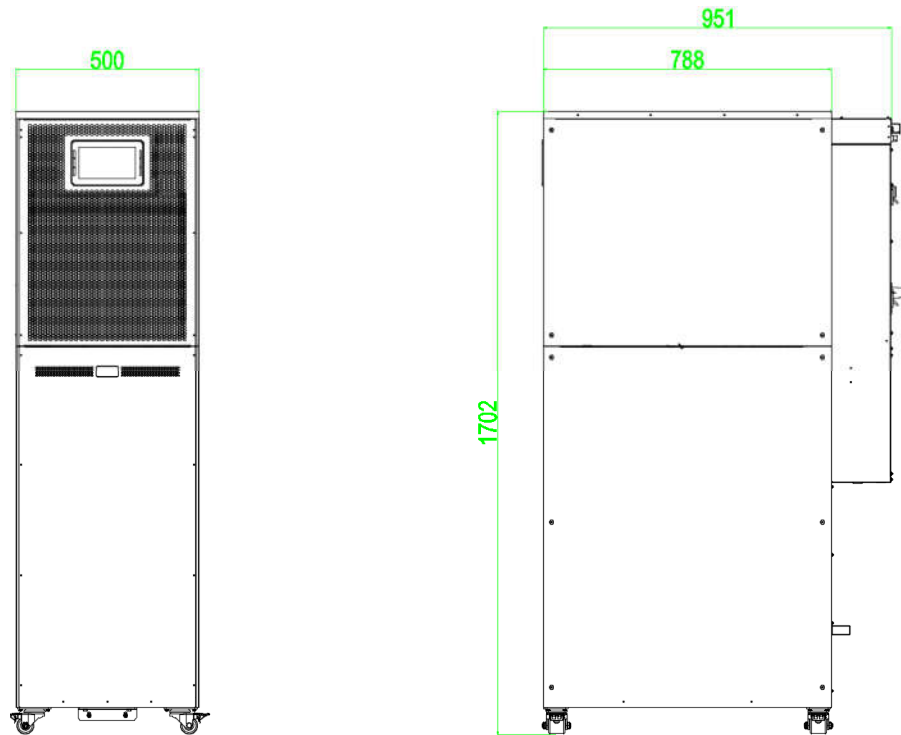


(g)80/100kVA standard backup type (unit: mm)


Figure 2-1 UPS Outlook

#### 2.4.1 Details of UPS front and rear views


The UPS front and rear views are shown as Figure 1-2.

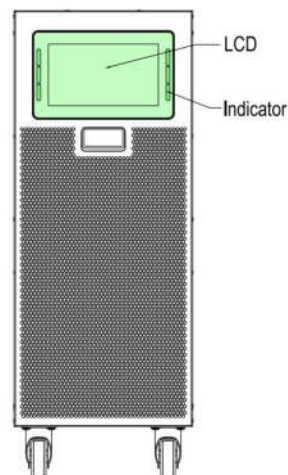


(a)10-100kVA long backup type

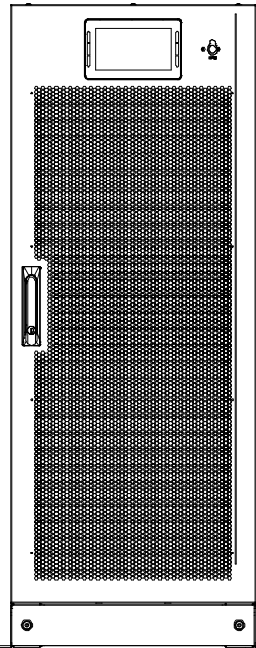


(b) 180/200kVA long backup type

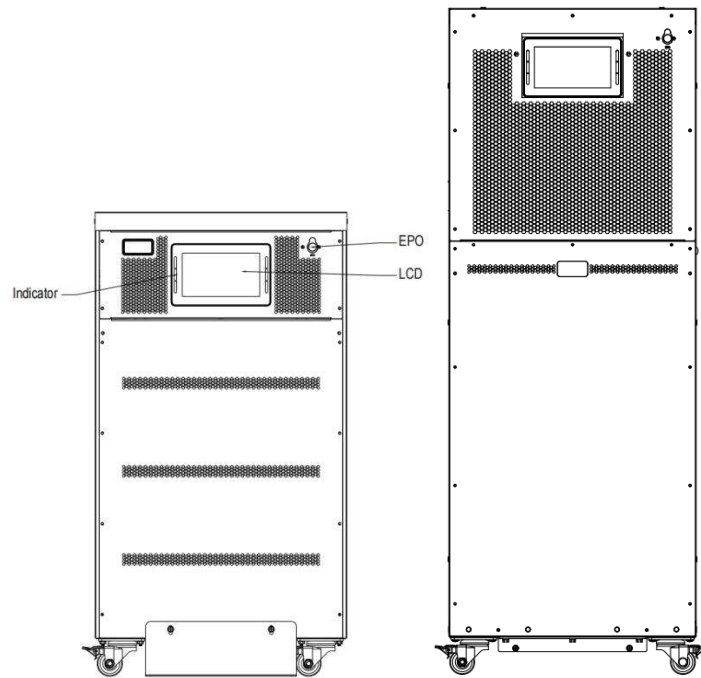


(c) 10-40kVA & 60kVA standard type

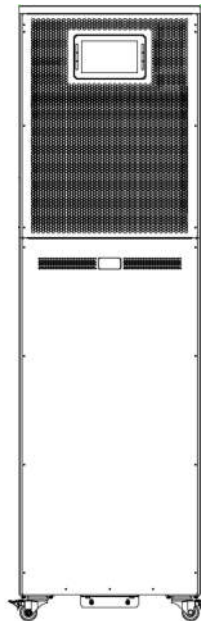


(d) 80/100kVA standard type

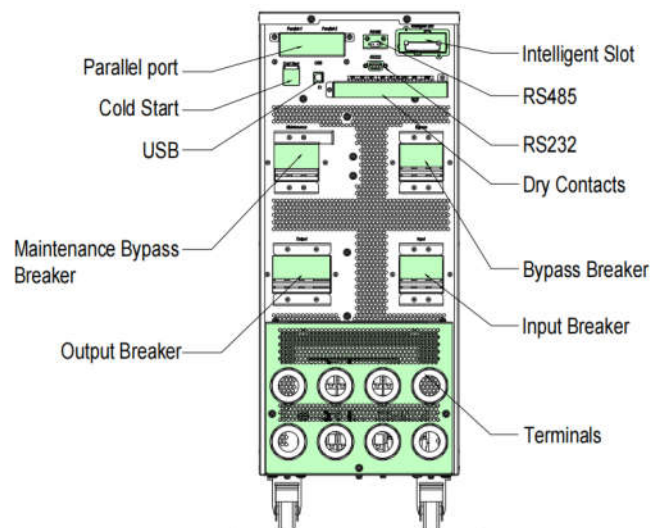


(e) 10-30kVA long backup type

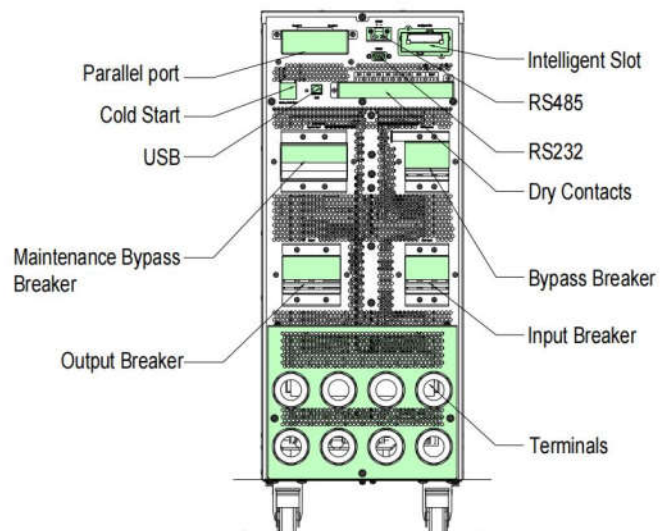


(f) 40/60kVA long backup type

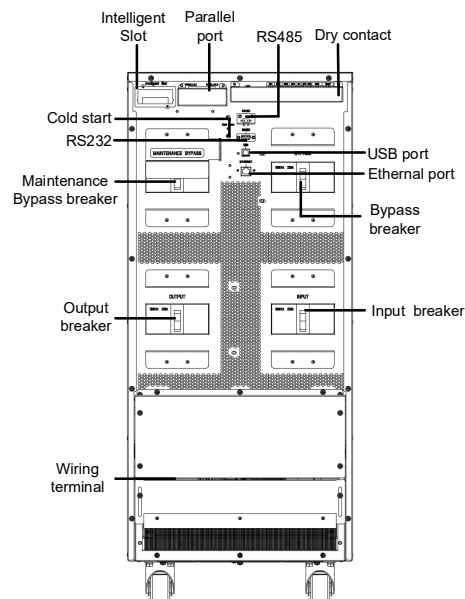


(g) 80/100kVA long backup type

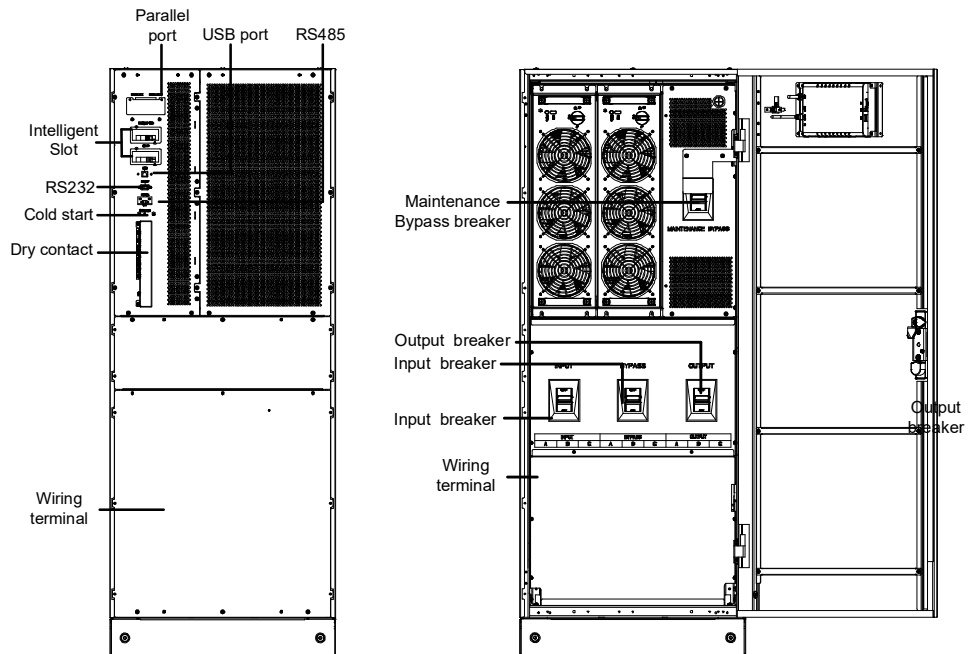


(h) 180/200kVA long backup type

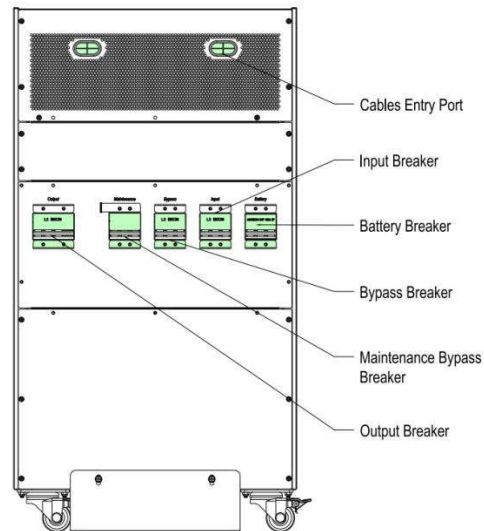

(i) 10-40kVA standard backup type

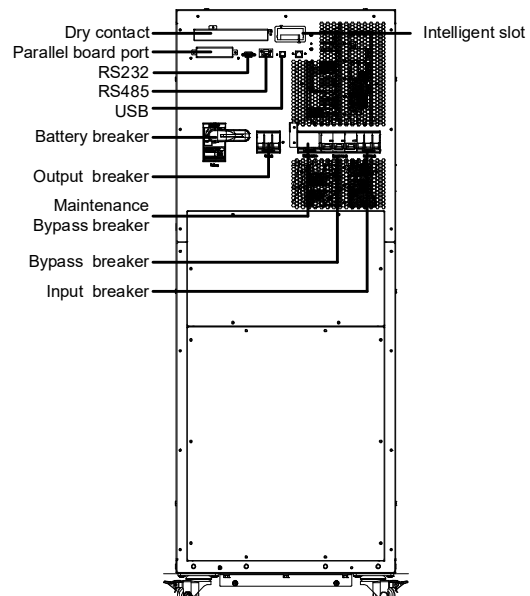

(j) 60kVA standard backup type

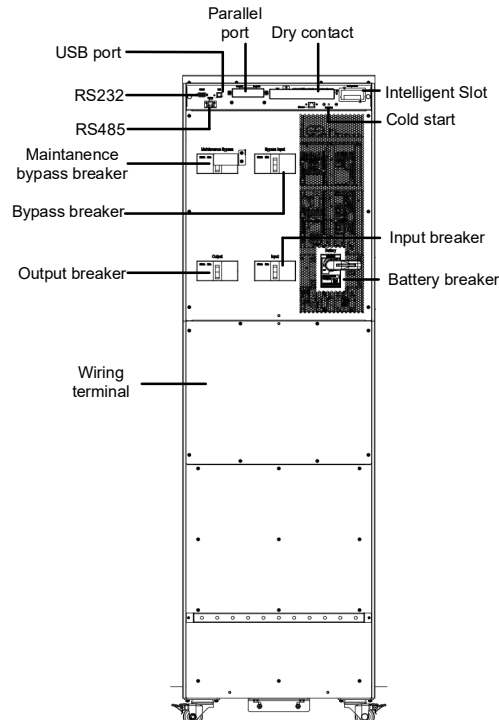

(k) 80/100kVA standard backup type  
 Figure 1-2 Details of UPS front and rear views

## 2.5 UPS System Description

The Tower UPS is configured by the following part: Rectifier, Charger, Inverter, Static bypass switch. One or several battery strings should be installed to provide backup energy once the utility fails. The UPS structures are shown in Figure 2-3.

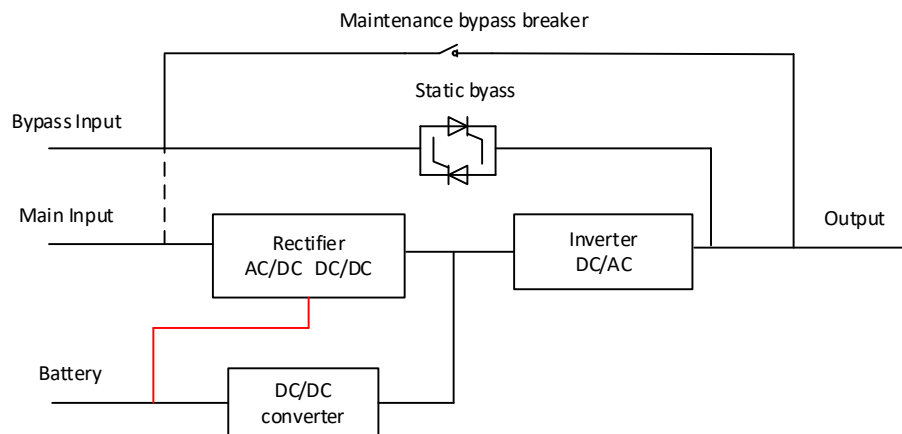


Figure 2-3 UPS schematic diagram

## 2.6 Operation Mode

The Tower UPS is an on-line, double-conversion UPS that permits operation in the following modes:

- Normal mode
- Battery mode
- Bypass mode
- Maintenance mode(manual bypass)
- ECO mode
- Auto-restart Mode



- Frequency Converter mode

### 2.6.1 Normal Mode

The UPS turns the AC input into DC voltage (AC/DC) through the rectifier, and the DC voltage boost to the BUS voltage. When the system is connected to the external battery, part of the input current charges the battery (DC/DC) by the Bidirectional DC/DC converter, and the other part changes to the AC output (DC/AC) by the inverter to provide high quality AC power for the load. Normal mode schematic diagram as shown below Figure 2-4.

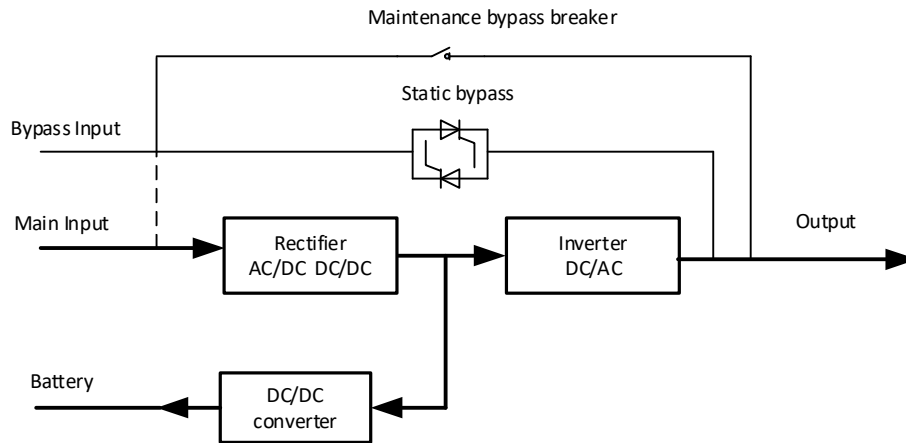


Figure 2-4 Normal mode schematic diagram

### 2.6.2 Battery Mode

In battery mode, the battery supplies power to the load by converting DC to AC through the inverter. When mains power fails, the UPS automatically switches to battery mode, ensuring uninterrupted power supply. Once mains power is restored, the UPS seamlessly returns to normal operation. Battery mode schematic diagram as shown below Figure 2-5.

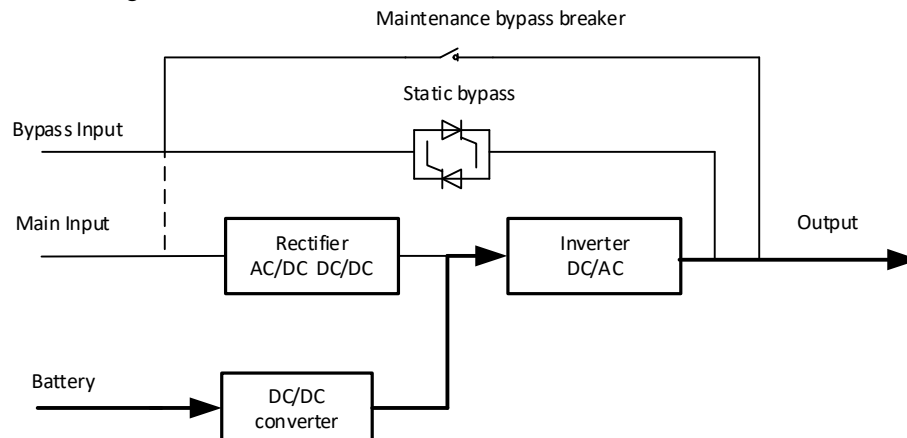


Figure 2-5 Battery mode schematic diagram

Note: With the function of "Battery Cold Start", the UPS could start without utility.

### 2.6.3 Bypass Mode

After the system is powered on, when the inverter is not turned on or the inverter is

artificially turned off, the load is powered by the bypass. In the normal mode, if the UPS monitoring unit detects the system over temperature, overload or other shutdown failure of the inverter, the system will automatically switch to the bypass. In this condition, the mains supplies power to the load through the bypass directly. In the bypass mode, the quality of input power is not protected by UPS, and it can be easily influenced by the power failure, voltage waveform or abnormal frequency, etc. Bypass mode schematic diagram is shown in Figure 2-6.

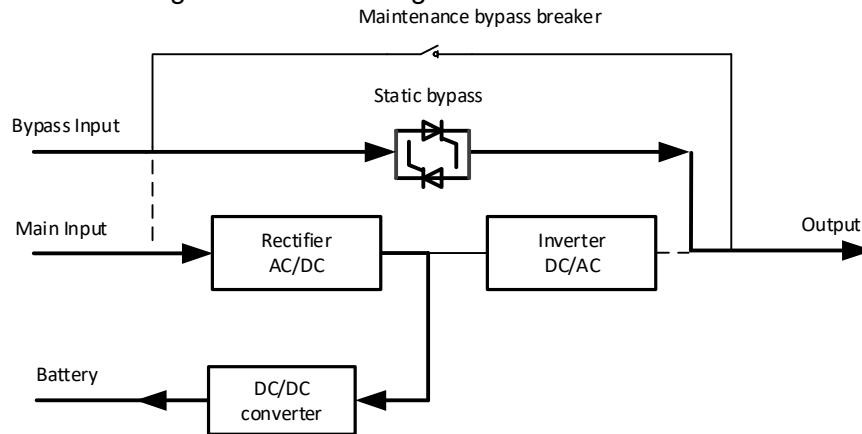


Figure 2-6 Bypass mode schematic diagram

#### 2.6.4 Maintenance Mode (Manual Bypass)

When UPS system and battery need to repair or troubleshoot problems, manually closing the manual bypass switch, and the load is directly supplied by the mains power through the manual bypass to realize the emergency power supply to the load. Manual bypass mode schematic diagram is shown in Figure 2-7.

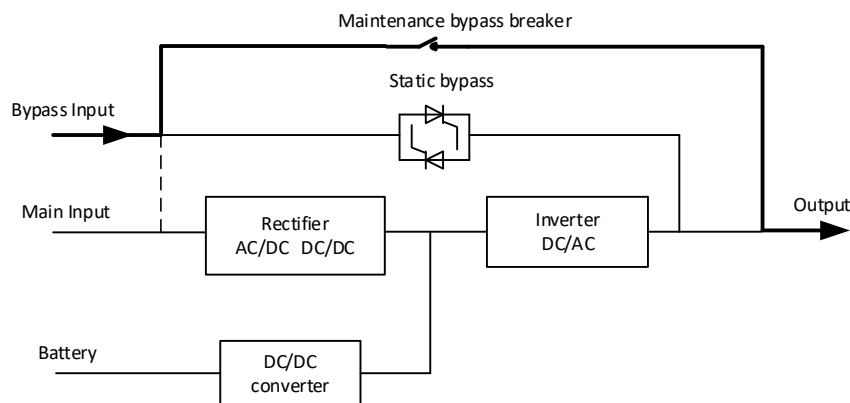


Figure 2-7 Maintenance mode schematic diagram



#### **DANGER**

- During Maintenance mode, the UPS does not work and the LCD does not display. The input terminals and output terminals as well as the N line are charged.

#### 2.6.5 ECO Mode

The ECO mode, also known as the UPS economic mode, can be configured through the LCD or monitor software. When set to ECO mode and the bypass input voltage

falls within the ECO voltage range, the load is directly powered by the mains through bypass, while the rectifier and inverter remain in standby status. If the bypass input voltage exceeds the ECO voltage range, the system switches from bypass power supply to inverter operation, returning to normal mode. This ECO mode significantly enhances system efficiency. ECO mode schematic diagram is shown in Figure 2-8.

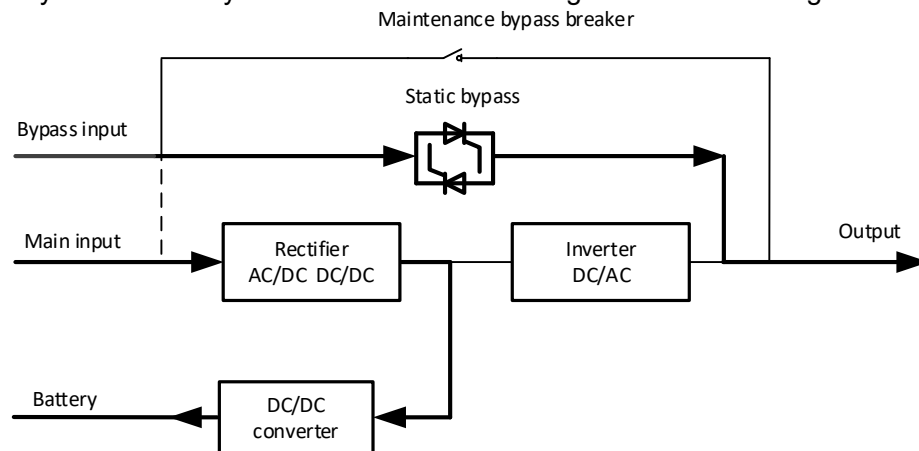


Figure 2-8 ECO mode schematic diagram



**Note:** There is a short interruption time (less than 10ms) when transferring from ECO mode to battery mode, it must be sure that the interruption has no effect on loads.

### 2.6.6 Source-share mode

If the UPS works properly and the AC input power of the rectifiers is insufficient, the UPS transfer to source-share mode. In this case, the power module obtains energy from both the mains and batteries, and the energy is converted into AC outputs over the inverter. Source-share mode schematic diagram is show Figure 2-9.

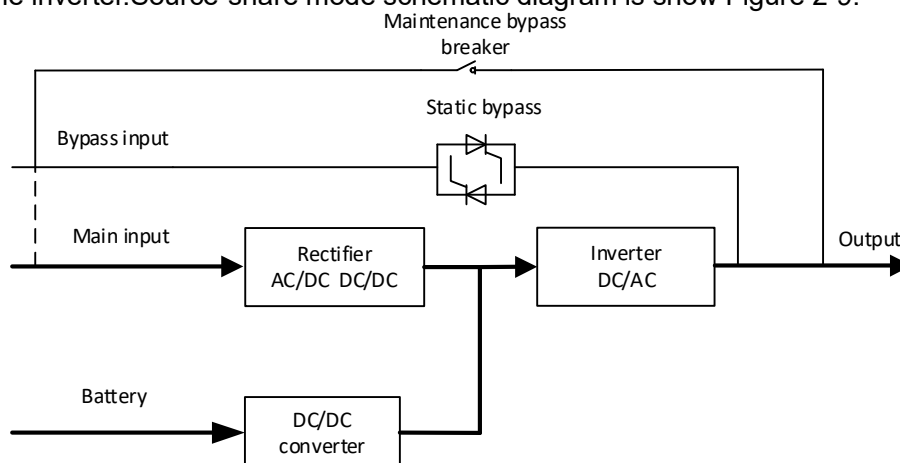


Figure 2-9 Source-share mode

### 2.6.7 Auto-restart Mode

UPS has automatic power-on function, that is, the mains power outage time is too

long, the battery discharge to the EOD voltage causes the inverter to shut down. If the mains power recovery, UPS will automatically start UPS. **The mode and the delay time are programmed by the commissioning engineer.**

#### 2.6.8 Frequency Converter Mode

The UPS can be set to frequency converter mode, providing a stable output frequency of 50Hz or 60Hz. The input frequency range is 40Hz to 70Hz. In this mode, static bypass is disabled and batteries are optional. Whether to use batteries depends on whether battery operation is required.

## 3 Installation

This chapter introduces UPS installation, including unpacking and inspection, main cabinet installation, cables connection.

### 3.1 Location

As each site has itself requirements, the installation instructions in this section are as a guide for the general procedures and practices that should be observed by the installing engineer.

#### 3.1.1 Installation Environment

The UPS is intended for indoor installation and uses forced convection cooling by internal fans. Please make sure there is enough space for the UPS ventilation and cooling.

Keep the UPS far away from water, heat and inflammable and explosive corrosive material. Avoid installing the UPS in the environment with direct sunlight, dust, volatile gases, corrosive material and high salinity.

Avoid installing the UPS in the environment with conductive dirt.

The operating environment temperature for batteries is 20℃-25℃. Operating above 25℃ will reduce the battery life, and operation below 20℃ will reduce the battery capacity.

The battery will generate a little amount of hydrogen and oxygen at the end of charging; ensure the fresh air volume of the battery installation environment must meet EN50272-2001 requirements.

When external batteries are used, the battery circuit breakers (or fuses) must be mounted as close as possible to the batteries, and the connecting cables should be as short as possible.

#### 3.1.2 Site Selection

Ensure the ground or installation platform can bear the weight of the UPS cabinet, batteries and battery racks.

No vibration and less than 5 degree inclination horizontally.

The equipment should be stored in a room so as to protect it against excessive humidity and heat sources.

The battery needs to be stored in dry and cool place with good ventilation. The most suitable storage temperature is 20℃ to 25℃.

#### 3.1.3 Size and Weight

The dimension and weigh for the UPS cabinet is shown in Table 3-1

Table 3-1 Weight for the cabinet

| Configuration                       | Dimension(W*D*H)mm |
|-------------------------------------|--------------------|
| 10/15/20/30k long backup time model | 250*530*650        |
| 40/60k long backup time model       | 250*782*650        |
| 80/100k long backup time model      | 380*950*900        |
| 180/200k long backup time model     | 500*900*1300       |
| 10/15/20/30/40k standard model      | 500*865*921        |
| 60k standard model                  | 500*800*1350       |

80/100k standard model

500\*950\*1700

## 3.2 Unpacking and Inspection

### 3.2.1 Moving and Unpacking of the Cabinet

The steps to move and unpack the cabinet are as follows:

1. Check if any damages to the packing. (If any, contact to the carrier)
2. Transport the equipment to the designated site by forklift, as shown in Figure 3-1.

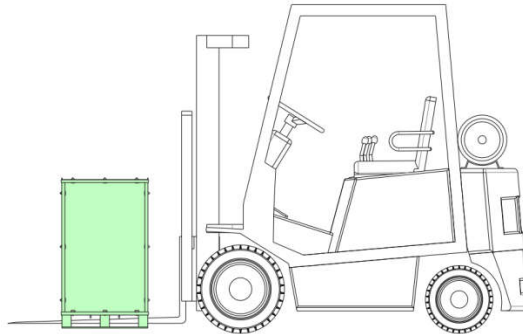


Figure 3-1 Transport to the designated site

3. Unpack the package as shown in Figure 3-2.

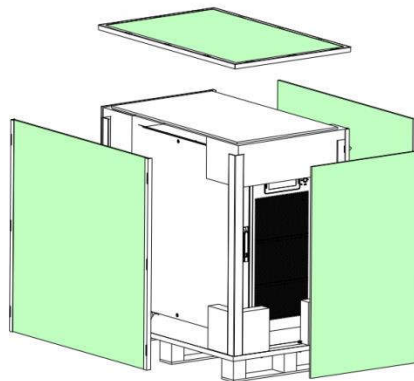


Figure 3-2 Disassemble the case

4. Remove the protective foam around the cabinet as shown in Figure 3-3.

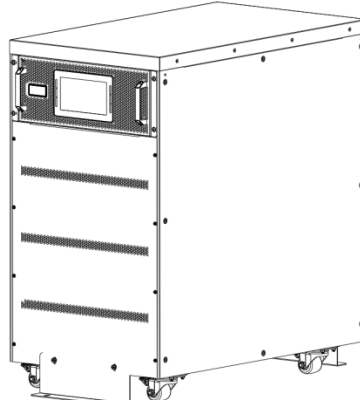


Figure 3-3 remove the protective foam

5. Check the UPS.
  - (a) Visually examine if there are any damages to UPS during transportation. If

any, contact to the carrier.

(b) Check the UPS with the list of the goods. If any items are not included in the list, contact to our company or the local office.

6. Dismantle the bolt that connects the cabinet and wooden pallet after disassembly.

7. Move the cabinet to the installation position.



### CAUTION

Be careful while removing to avoid scratching the equipment.




### CAUTION

The waste materials of unpacking should be disposed to meet the demand for environmental protection.


## 3.3 Positioning

### 3.3.1 Positioning Cabinet


For 10-200kVA standard & long backup time model UPS, the UPS cabinet supports itself by the four wheels at the bottom. The supporting structure is shown in Figure 3-4.

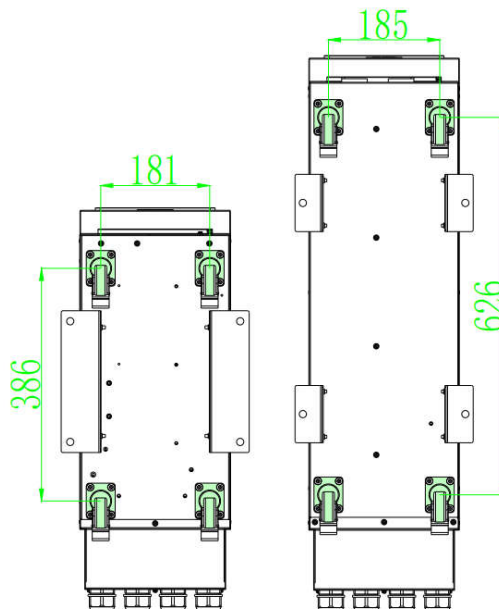

(a) 10-30kVA & 40-60kVA long backup type (Bottom, unit: mm)

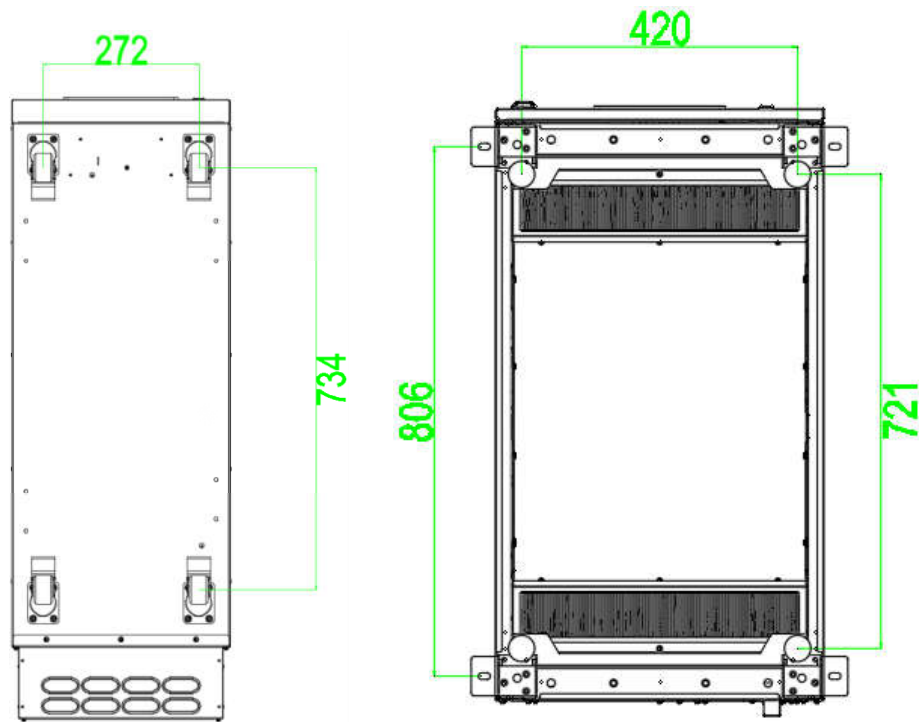


(b) 80-100&180-200kVA long backup type (Bottom, unit: mm)

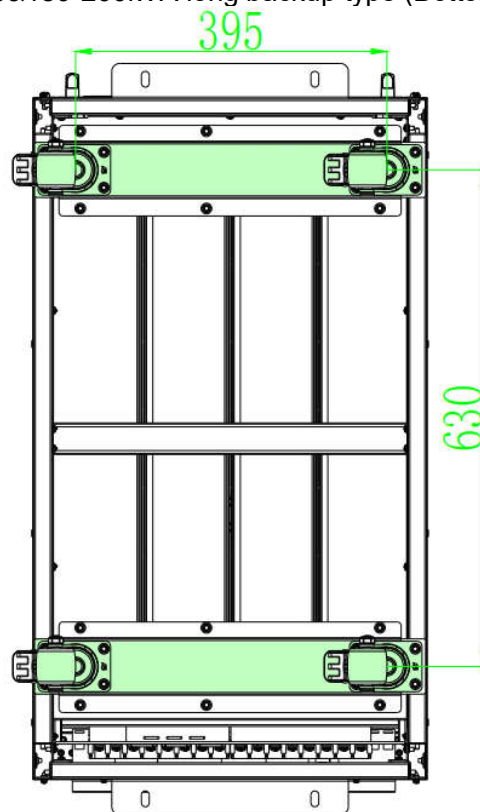


(c) 10-40kVA standard type (Bottom, unit: mm)



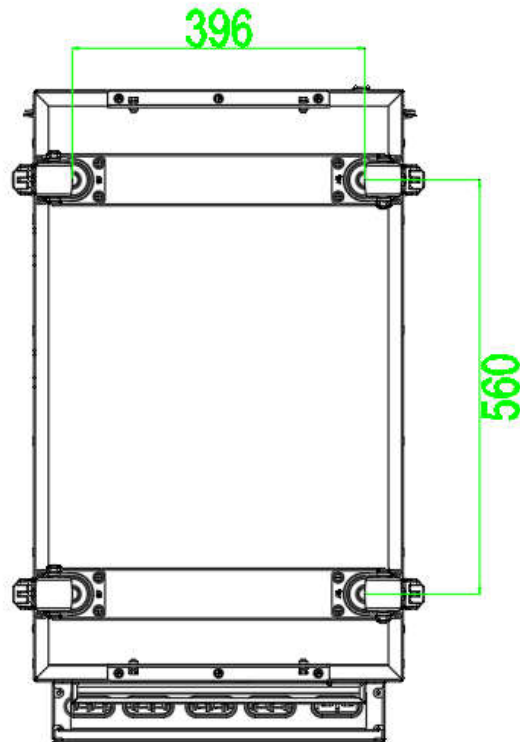

(d) 60kVA standard type (Bottom, unit: mm)

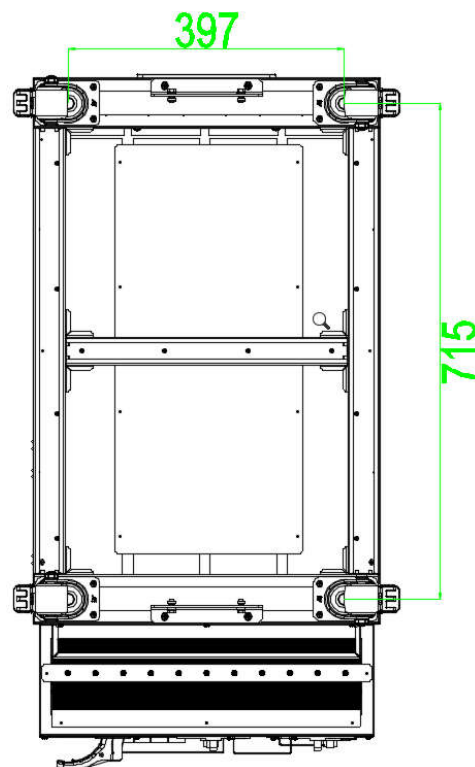


(e) 80/100kVA standard type (Bottom, unit: mm)

Figure 3-4 Supporting structure (Bottom View)

The steps to position the cabinet are as follows:

- 1.Ensure the supporting structure is in good condition and the mounting floor is smooth and strong.
- 2.Adjust the cabinet to the right position by the supporting wheels.

3. Press the fixed position of the brake assembly.

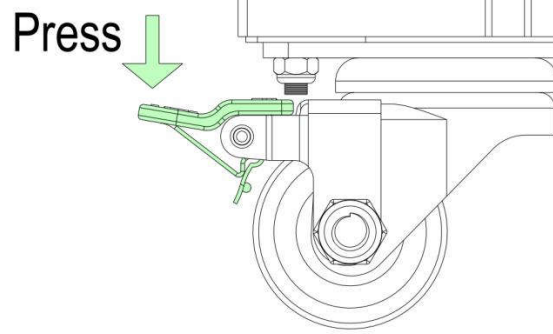

### CAUTION

Auxiliary equipment is needed when the mounting floor is not solid enough to support the cabinet, which helps distribute the weight over a larger area. For instance, cover the floor with iron plate or increase the supporting area of the anchor bolts.

## 3.4 Battery

Three terminals (positive, neutral, negative) are drawn from the battery group and connected to UPS system. The neutral line is drawn from the middle of the batteries in series (See Figure 3-5)

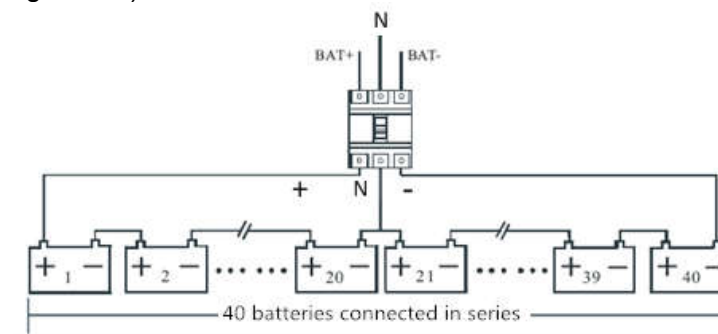


Figure 3-5 Battery string wiring diagram



### DANGER


The battery terminal voltage is of more than 400Vdc, please follow the safety instructions to avoid electric shock hazard.

Ensure the positive, negative, neutral electrode is correctly connected from the battery unit terminals to the breaker and from the breaker to the UPS system.

## 3.5 Cable Entry

For 10-100kVA long or standard backup type, cables entry from the bottom of the rear side. The 200kVA long backup type, cables entry from the bottom of the front & rear side.

These cable entry ways are shown in Figure 2-6.

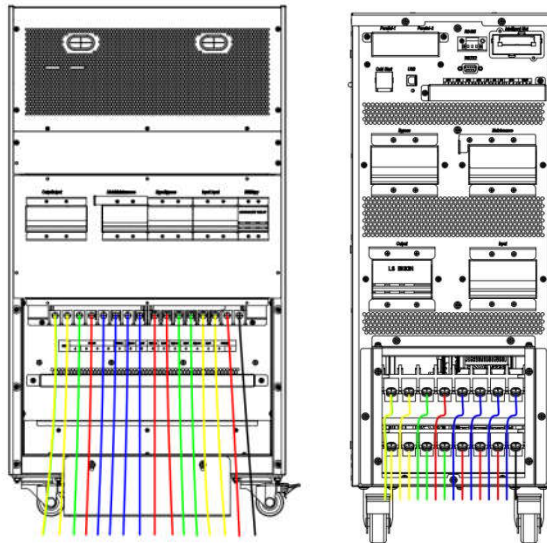

(a)10-200kVA standard & long backup time type cables entry

Figure 3-6 Cables entry

## 3.6 Power Cables

### 3.6.1 Cables Specifications

The UPS power cables are recommended in Table 3-2.

Table 3-2 Recommended cables for power cables

| Contents      |                                 |   | 10k | 15k | 20k | 30k | 40k  |
|---------------|---------------------------------|---|-----|-----|-----|-----|------|
| Main Input    | Main Input Current(A)           |   | 19A | 28A | 38A | 57A | 76A  |
|               | CableSection (mm <sup>2</sup> ) | A | 6   | 6   | 6   | 10  | 16   |
|               |                                 | B |     |     |     |     |      |
|               |                                 | C |     |     |     |     |      |
|               |                                 | N |     |     |     |     |      |
| Main Output   | Main Output Current(A)          |   | 15A | 22A | 30A | 45A | 60A  |
|               | CableSection (mm <sup>2</sup> ) | A | 6   | 6   | 6   | 6   | 10   |
|               |                                 | B |     |     |     |     |      |
|               |                                 | C |     |     |     |     |      |
|               |                                 | N |     |     |     |     |      |
| Bypass Input  | Bypass Input Current(A)         |   | 15A | 22A | 30A | 45A | 60A  |
|               | CableSection (mm <sup>2</sup> ) | A | 6   | 6   | 6   | 6   | 10   |
|               |                                 | B |     |     |     |     |      |
|               |                                 | C |     |     |     |     |      |
|               |                                 | N |     |     |     |     |      |
| Battery Input | Battery Input current(A)        |   | 26A | 39A | 54A | 78A | 104A |
|               | CableSection                    | + | 6   | 10  | 10  | 16  | 25   |

|    |                                    |    |   |   |   |    |    |
|----|------------------------------------|----|---|---|---|----|----|
|    | (mm <sup>2</sup> )                 | -  |   |   |   |    |    |
|    |                                    | N  |   |   |   |    |    |
| PE | CableSection<br>(mm <sup>2</sup> ) | PE | 6 | 6 | 6 | 10 | 16 |

| Contents      |                                    |    | 60k  | 80k  | 100k | 180k | 200k      |
|---------------|------------------------------------|----|------|------|------|------|-----------|
| Main Input    | Main Input Current(A)              |    | 113A | 152A | 192A | 342A | 380A      |
|               | CableSection<br>(mm <sup>2</sup> ) | A  | 25   | 50   | 70   | 150  | 185       |
|               |                                    | B  |      |      |      |      |           |
|               |                                    | C  |      |      |      |      |           |
|               |                                    | N  |      |      |      |      |           |
| Main Output   | Main Output Current(A)             |    | 90A  | 121A | 152A | 274A | 304A      |
|               | CableSection<br>(mm <sup>2</sup> ) | A  | 16   | 25   | 50   | 95   | 120       |
|               |                                    | B  |      |      |      |      |           |
|               |                                    | C  |      |      |      |      |           |
|               |                                    | N  |      |      |      |      |           |
| Bypass Input  | Bypass Input Current(A)            |    | 90A  | 121A | 152A | 274A | 304A      |
|               | CableSection<br>(mm <sup>2</sup> ) | A  | 16   | 25   | 50   | 95   | 120       |
|               |                                    | B  |      |      |      |      |           |
|               |                                    | C  |      |      |      |      |           |
|               |                                    | N  |      |      |      |      |           |
| Battery Input | Battery Input current(A)           |    | 142A | 190A | 238A | 451A | 501A      |
|               | CableSection<br>(mm <sup>2</sup> ) | +  | 35   | 70   | 95   | 240  | 2*<br>150 |
|               |                                    | -  |      |      |      |      |           |
|               |                                    | N  |      |      |      |      |           |
| PE            | CableSection<br>(mm <sup>2</sup> ) | PE | 16   | 25   | 35   | 95   | 95        |



**Note:**The recommended cable section for power cables are only for the situations described below:

- Ambient temperature: 30℃.
- AC loss less than 3%,DC loss less than1%,The length of the AC power cables are no longer than 50 m and the length of the DC power cables are no longer than 30 m.
- For 90℃ copper conductor flexible cables, when the external conditions change, please refer to IEC60364-5-52 and relevant local codes for verification. The current values in the table are based on 380V. For the 400V rated voltage, the current value needs to be multiplied by 0.95; for the 415V rated voltage, the current value needs to be multiplied by 0.92.
- The cross-section of neutral lines need to be increased to 1.5~1.7 times of the value listed above when the main loads are non-linear load.

### 3.6.2 Power Cables Terminal Specifications

Specifications for power cables connector are listed as Table 3-3.

Table 3-3 Requirements for power terminal

|            | Port          | Connection                    | Bolt | Torque Moment |
|------------|---------------|-------------------------------|------|---------------|
| 10-60kVA   | Mains input   | Cables crimped<br>OT terminal | M6   | 4.9Nm         |
|            | Bypass Input  |                               |      |               |
|            | Battery Input |                               |      |               |
|            | Output        |                               | M8   | 8.3Nm         |
|            | PE            |                               |      |               |
| 100-200kVA | Mains input   | Cables crimped<br>OT terminal | M10  | 16.4Nm        |
|            | Bypass Input  |                               |      |               |
|            | Battery Input |                               |      |               |
|            | Output        |                               |      |               |
|            | PE            |                               |      |               |

### 3.6.3 Circuit Breaker Specifications

The external circuit breakers (CB) for the system are recommended in Table 3-4.

| Installed position      | 10k    | 15k    | 20k    | 30k    | 40k    | 60k     | 80k     | 100k    | 180k    | 200k    |
|-------------------------|--------|--------|--------|--------|--------|---------|---------|---------|---------|---------|
| Input CB                | 32A/3P | 32A/3P | 40A/3P | 63A/3P | 80A/3P | 125A/3P | 160A/3P | 200A/3P | 350A/3P | 400A/3P |
| Bypass input CB         | 32A/3P | 32A/3P | 32A/3P | 63A/3P | 63A/3P | 100A/3P | 125A/3P | 160A/3P | 315A/3P | 315A/3P |
| Output CB               | 32A/3P | 32A/3P | 32A/3P | 63A/3P | 63A/3P | 100A/3P | 125A/3P | 160A/3P | 315A/3P | 315A/3P |
| External maintenance CB | 32A/3P | 32A/3P | 32A/3P | 63A/3P | 63A/3P | 100A/3P | 125A/3P | 160A/3P | 315A/3P | 315A/3P |
| Battery CB              | DC32A  | DC40A  | DC63A  | DC80A  | DC125A | DC160A  | DC200A  | DC250A  | DC500A  | DC630A  |

Table 3-4 Recommended CB




#### CAUTION

*The CB with RCD (Residual Current Device) is not suggested for the system.*


### 3.6.4 Connecting Power Cables

(1) Verify that all the switches of the UPS are completely open and the UPS internal maintenance bypass switch is open. Attach necessary warning signs to these switches to prevent unauthorized operation.

(2) For 10-200kVA long backup type, the connection terminals are in the bottom rear of UPS, for 10-100kVA standard backup type, the connection terminals are in the top rear of UPS, remove the metal protective cover, the terminals are shown in Figure 2-7.




| PE | Output |   |   |   | Bypass | Input | Battery |
|----|--------|---|---|---|--------|-------|---------|
|    | A      | B | C | N | N      | N     | N       |





| Bypass | Input | Bypass | Input | Bypass | Input | Battery |   |
|--------|-------|--------|-------|--------|-------|---------|---|
| A      | A     | B      | B     | C      | C     | +       | - |

(a) Connection terminals for 10-60kVA long backup time




| PE | Output |   |   |   | Battery | Bypass | Input | Bypass | Input | Bypass | Input | Bypass | Input | Battery      |
|----|--------|---|---|---|---------|--------|-------|--------|-------|--------|-------|--------|-------|--------------|
|    | A      | B | C | N | N       | N      | N     | C      | C     | B      | B     | A      | A     | + <th>-</th> |


(b) Connection terminals for 10-60kVA standard backup time

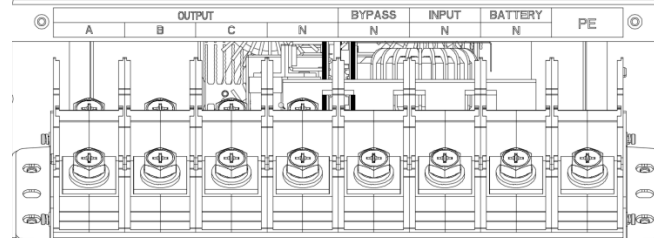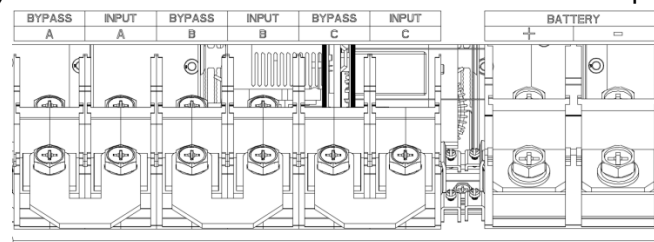

(c) Connection terminals for 80-100kVA long backup time

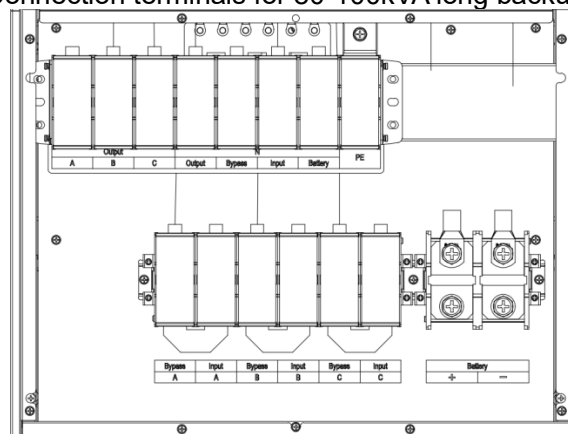

(d) Connection terminals for 100kVA standard backup time

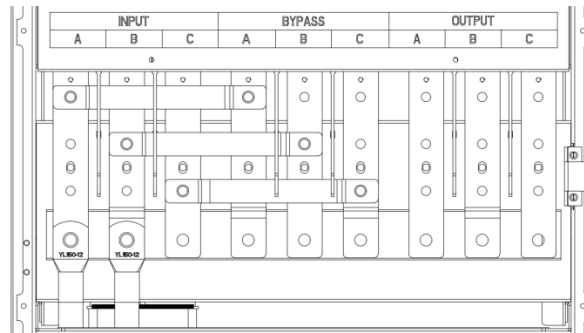

(e) Connection terminals for 180-200kVA long backup time

Figure 3-7 Connection terminals

- (3) Connect the protective earth wire to protective earth terminal (PE).
- (4) Connect the AC input supply cables to the main input terminal and AC output supply cables to the output terminal.
- (5) Connect the battery cables to the battery terminal.
- (6) Check to ensure there is no mistake and re-install all the protective covers.



**Note:** mA, mB, mC standard for Main input phase A, B and C; bA, bB, bC standard for Bypass Input phase A, B and C.



## CAUTION

The operations described in this section must be performed by authorized electricians or qualified technical personnel. If you have any difficulties, contact the manufacturer or agency.




## WARNING


When connecting power cables, follow the torque listed in Table 3.3 to ensure the tightness of the wiring terminals and avoid potential safety hazards. Before wiring the UPS, confirm the position and status of the UPS input switch and the mains power distribution switch. Make sure that the switch is in the off state and attach a warning sign to prevent others from operating the switch.

## 3.7 Control and Communication Cables


The rear panel of the cabinet provides dry contact interface and communication interface (RS232, RS485, SNMP, Parallel card interface and USB port), as it is shown in Figure 3-7.

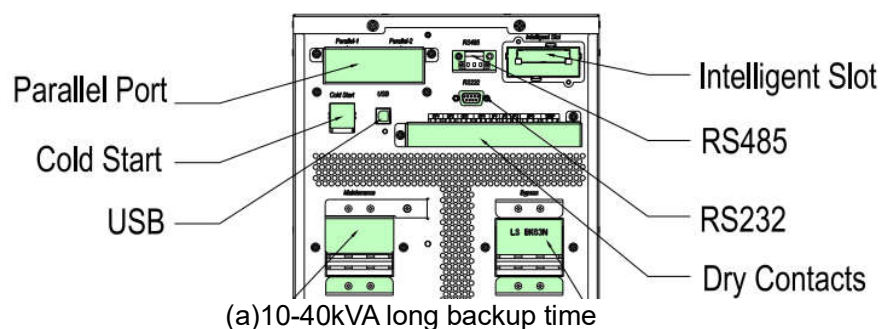


(a) 10-40kVA long backup time

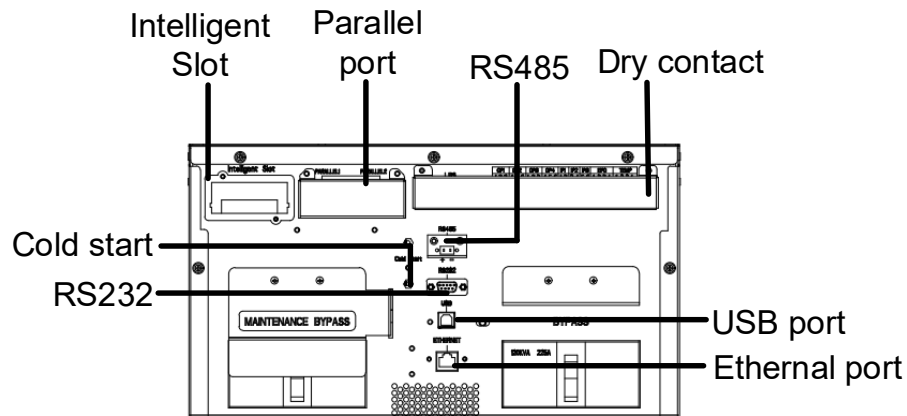


(b)80-100kVA long backup time

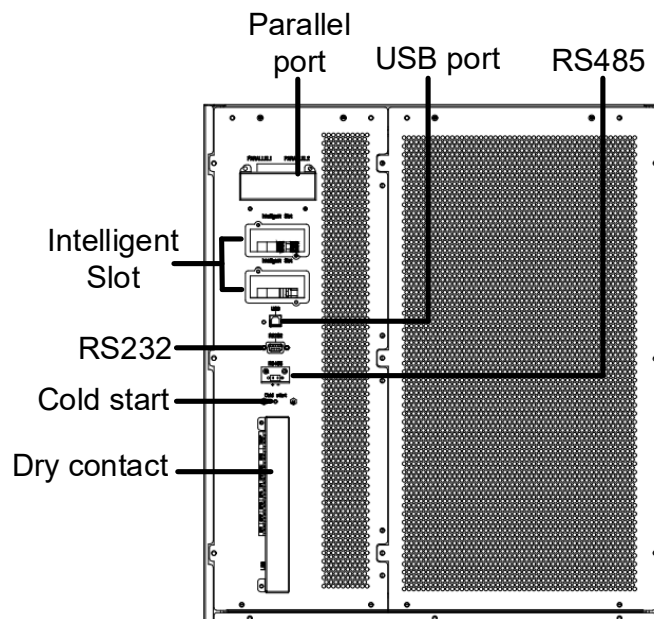

(c)180-200kVA long backup time

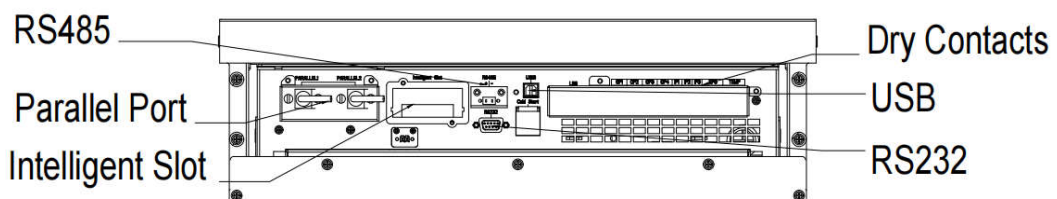

(d)10-40kVA standard backup time

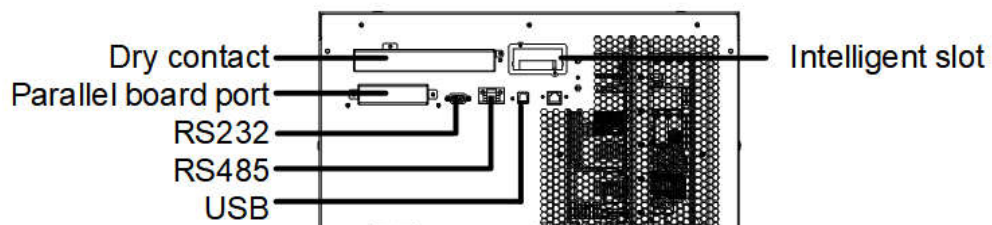

(e)60kVA standard backup time



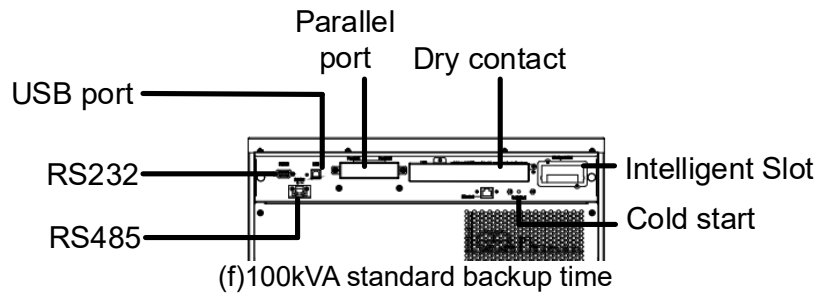


Figure 3-8 Dry contact & communication interface



### CAUTION

The operations described in this section must be performed by authorized electricians or qualified technical personnel. If you have any difficulty, please contact the manufacturer or the agency.



### WARNING

- Tighten the connections terminals to enough torque moment, refer to Table 2-3 and please ensure correct phase rotation.
- Before connection, ensure the input switch and the power supply are off, attach warnings label to warn not to operate by others
- The grounding cable and neutral cable must be connected in accordance with local and national codes.

### 3.7.1 Dry Contact Interface

Dry contact always includes 5 sets of interfaces, and the default definitions of these ports are shown in Table 3-5.

Table 3-5 Default Functions of the ports

| Port   | Name              | Function                                                                                                                                                 |
|--------|-------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------|
| EPO-1  | REMOTE_EPO_NO     | Trigger EPO when short- circuited with EPO-2                                                                                                             |
| EPO-2  | +24V_DRY          | +24V                                                                                                                                                     |
| EPO-3  | +24V_DRY          | +24V                                                                                                                                                     |
| EPO-4  | REMOTE_EPO_NC     | Trigger EPO when disconnected with EPO-3                                                                                                                 |
| TEMP-1 | ENV_TEMP          | Detection of environmental temperature                                                                                                                   |
| TEMP-2 | TEMP_COM          | Common terminal for temperature detection                                                                                                                |
| TEMP-3 | TEMP_COM          | Common terminal for temperature detection                                                                                                                |
| TEMP-4 | TEMP_BAT          | Detection of battery temperature                                                                                                                         |
| IP1-1  | BCB_Status        | Input dry contact, the function is settable.<br>Default: BCB Status & BCB Online available<br>(when BCB Status is invalid, the alarm make<br>no battery) |
| IP1-2  | GND_DRY           | Ground for +24V                                                                                                                                          |
| IP2-3  | BCB_Online        | Input dry contact, the function is settable.                                                                                                             |
| IP2-4  | GND_DRY           | Ground for +24V                                                                                                                                          |
| IP3-5  | GEN_CONNECTED     | Input dry contact, the function is settable.<br>Default: Generator input                                                                                 |
| IP3-6  | +24V_DRY          | +24V                                                                                                                                                     |
| OP1-1  | BAT_LOW_ALARM_NC  | Output dry contact(Normally Closed), the<br>function is settable.<br>Default: Battery voltage low.                                                       |
| OP1-2  | BAT_LOW_ALARM_NO  | Output dry contact(Normally open), the<br>function is settable.<br>Default: Battery voltage low.                                                         |
| OP1-3  | BAT_LOW_ALARM_GND | OP1-1 and OP1-2 Common                                                                                                                                   |
| OP2-4  | GENERAL_ALARM_NC  | Output dry contact(Normally Closed), the<br>function is settable.<br>Default: General alarm                                                              |
| OP2-5  | GENERAL_ALARM_NO  | Output dry contact(Normally open), the<br>function is settable.<br>Default: General alarm                                                                |
| OP2-6  | GENERAL_ALARM_GND | OP2-4 and OP2-5 Common                                                                                                                                   |
| OP3-1  | UTILITY_FAIL_NC   | Output dry contact(Normally Closed), the<br>function is settable.<br><br>Default: Utility abnormal                                                       |
| OP3-2  | UTILITY_FAIL_NO   | Output dry contact(Normally open), the<br>function is settable.<br>Default: Utility abnormal                                                             |
| OP3-3  | UTILITY_FAIL_GND  | OP3-1 and OP3-2 Common                                                                                                                                   |
| OP4-4  | BCB Drive         | Output dry contact, the function is settable.<br>Default: Battery BCB (In the EOD or EPO<br>available)                                                   |
| OP4-5  | GND_DRY           | Ground for +24V                                                                                                                                          |
| OP4-6  | +24V_DRY          | +24V                                                                                                                                                     |



**Note:**

The dry contact ports can be programmed through our background monitor software.

### Remote EPO Input Port

EPO1-4 is the input port for remote EPO. It requires connecting NC (EPO-4) and +24V (EPO-3) and disconnecting NO (EPO-1) and +24V (EPO-2) during normal operations, and EPO is triggered when disconnecting NC (EPO-4) and +24V (EPO-3), or connecting NO (EPO-1) and +24V (EPO-2). The port diagram is shown in Figure 3-9, and the port description is shown in Table 3-6.

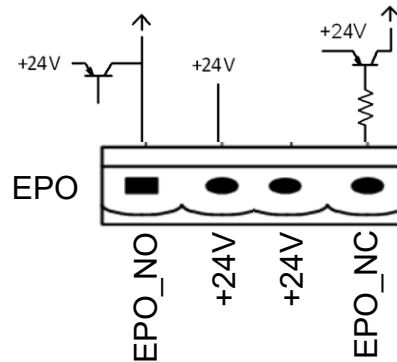


Figure 3-9 Diagram of input port for remote EPO

Table 3-6 Description of input port for remote EPO

| Port  | Name          | Function                               |
|-------|---------------|----------------------------------------|
| EPO-1 | REMOTE_EPO_NO | Trigger EPO when connect with EPO-2    |
| EPO-2 | +24V_DRY      | +24V                                   |
| EPO-3 | +24V_DRY      | +24V                                   |
| EPO-4 | REMOTE_EPO_NC | Trigger EPO when disconnect with EPO-3 |



**Note:** EPO-1 and EPO-2 must be disconnected in normal operations.

### Interface of Battery and Environmental Temperature Detection

The input dry contact can detect the temperature of batteries and environment respectively, which can be used in environment monitoring and battery temperature compensation. Interfaces diagram for TEMP\_1-4 are shown in Figure 3-10, the description of the interface is in Table 3-7.

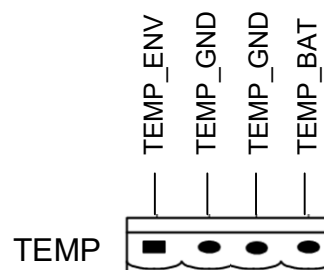


Figure 3-10 TEMP 1-4 for temperature detecting

Table 3-7 Description of TEMP 1-4

| Port   | Name     | Function                         |
|--------|----------|----------------------------------|
| TEMP-1 | ENV_TEMP | Detection of battery temperature |
| TEMP-2 | TEMP_COM | common terminal                  |

|        |          |                                        |
|--------|----------|----------------------------------------|
| TEMP-3 | TEMP_COM | common terminal                        |
| TEMP-4 | TEMP_BAT | Detection of environmental temperature |



#### Note

A specified temperature sensor is required for temperature detection, and it's optional, please confirm with the manufacturer or the local agency before the order.

### Generator Input Dry Contact

The default function of IP3 5-6 is the interface for generator input, when connecting IP3-5 with +24V (IP3-6), the UPS judges the generator has been connected in the system. The port diagram is shown in Figure 3-11, the port description is shown in Table 3-8.

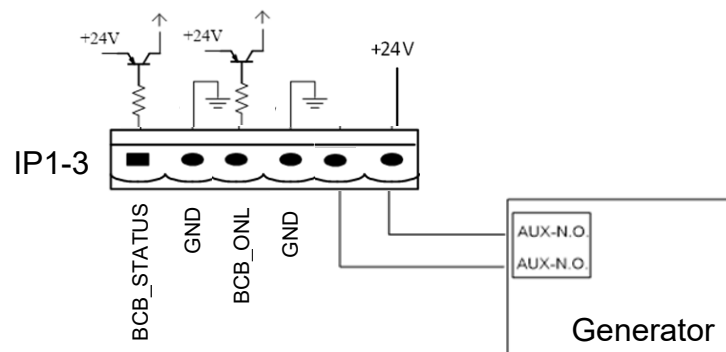



Figure 3-11 Diagram of input port for generator input

Table 3-8 Description of input port for generator input

| Port  | Name          | Function                              |
|-------|---------------|---------------------------------------|
| IP3-5 | GEN_CONNECTED | Default: Generator input dry contact. |
| IP3-6 | +24V_DRY      | +24V                                  |

### BCB Input Port

The default functions of OP4 4-6 are the ports for BCB tripping and BCB status, connect OP4-4 and OP4-5 to BCB tripper, the port OP4-4 can provide a driver signal (+24VDC, 100mA) to trip the battery breaker when EPO is triggered or EOD (end of discharge) happen. The UPS would detect the BCB status, when BCB is closed, it indicates batteries are connected, when open, it alarms batteries not connected. The port diagram is shown in Figure 3-12, and the description is shown in Table 3-9.

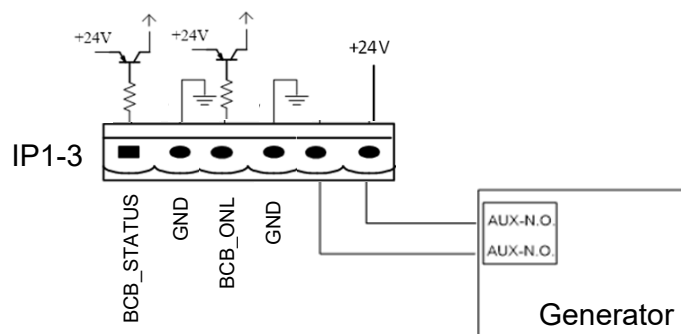

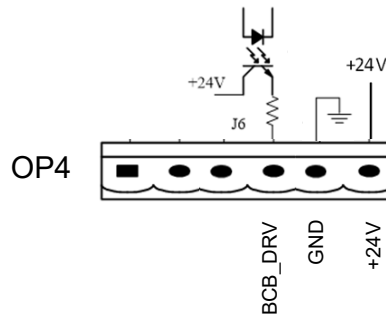


Figure 3-12 BCB Port

Table 3-9 Description of BCB port

| Port  | Name       | Function                                                         |
|-------|------------|------------------------------------------------------------------|
| IP1-1 | BCB_Status | BCB contact status, connect with the normally open signal of BCB |
| IP1-2 | GND_DRY    | Ground for +24V                                                  |
| IP2-3 | BCB_Online | BCB contact status, connect with the normally open signal of BCB |
| IP2-4 | GND_DRY    | Ground for +24                                                   |
| OP4-4 | BCB_Drive  | BCB trip signal output, +24V, maximum support of 100mA           |
| OP4-5 | GND_DRY    | Ground for +24V                                                  |
| OP4-6 | +24V_DRY   | +24V                                                             |

### Battery Warning Output Dry Contact Interface

The default function of OP1 1-3 is the output dry contact interface for battery voltage low alarm, when the battery voltage is lower than the setting value, an auxiliary dry contact signal will be activated via the relay, before UPS alarms "Battery voltage low", OP1-1 and OP1-3 are connected by the relay, OP1-2 and OP1-3 are disconnected, when UPS alarms "battery voltage low", OP1-1 and OP1-3 are disconnected by the relay, OP1-2 and OP1-3 are connected.

The port diagram is shown in Figure 3-13, and the description is shown in Table 3-10.

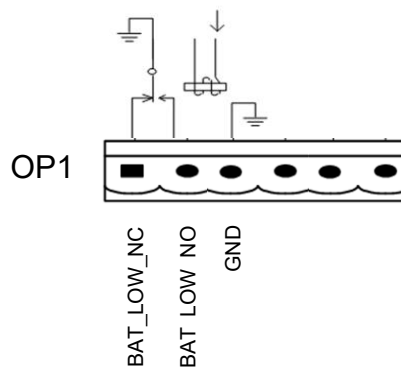


Figure 3-13 Battery warning output dry contact interface diagram

Table 3-10 Battery warning output dry contact interface description

| Port  | Name              | Function                                                            |
|-------|-------------------|---------------------------------------------------------------------|
| OP1-1 | BAT_LOW_ALARM_NC  | Battery warning relay (normally closed) will be open during warning |
| OP1-2 | BAT_LOW_ALARM_NO  | Battery warning relay (normally open) will be closed during warning |
| OP1-3 | BAT_LOW_ALARM_GND | Common terminal                                                     |

## General Alarm Output Dry Contact Interface

The default function of OP2 is the general alarm output dry contact dry interface. When one and more warnings are trigger, an auxiliary dry contact signal will be active via the isolation of a relay. The port diagram is shown in Figure 3-14, and the description is shown in Table 3-11.

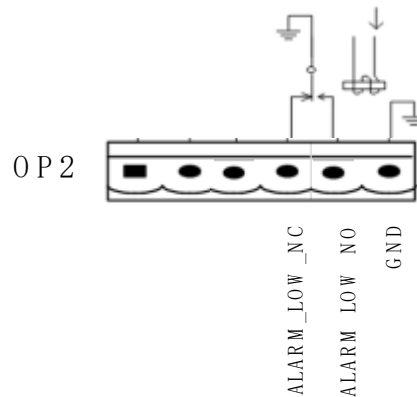


Figure 3-14 General alarm dry contact interface diagram

Table 3-11 General alarm dry contact interface description

| Port  | Name              | Function                                                               |
|-------|-------------------|------------------------------------------------------------------------|
| OP2-4 | GENERAL_ALARM_NC  | Integrated warning relay (normally closed) will be open during warning |
| OP2-5 | GENERAL_ALARM_NO  | Integrated warning relay (normally open) will be closed during warning |
| OP2-6 | GENERAL_ALARM_GND | Common terminal                                                        |

## Utility Fail Warning Output Dry Contact Interface

The default function of OP3 is the output dry contact interface for utility failure warning, when the utility fails, the system will send a utility failure warning information, and provide an auxiliary dry contact signal via the isolation of a relay. The interface diagram is shown in Figure 3-15, and the description is shown in Table 3-12.

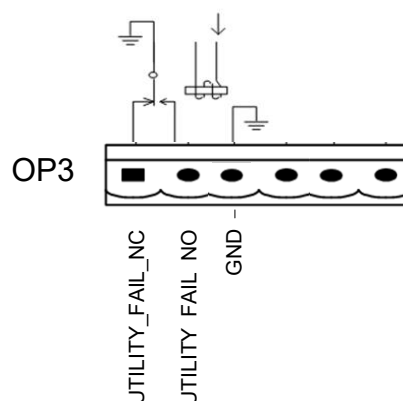


Figure 3-15 Utility failure warning dry contact interface diagram

Table 3-12 Utility failure warning dry contact interface description

| Port  | Name            | Function                                                                 |
|-------|-----------------|--------------------------------------------------------------------------|
| OP3-1 | UTILITY_FAIL_NC | Mains failure warning relay(normally closed) will be open during warning |

| Port  | Name             | Function                                                                  |
|-------|------------------|---------------------------------------------------------------------------|
| OP3-2 | UTILITY_FAIL_NO  | Mains failure warning relay (normally open) will be closed during warning |
| OP3-3 | UTILITY_FAIL_GND | Common terminal                                                           |

### 3.7.2 Communication Interface

RS232, RS485 and USB ports can provide series data which can be used for commissioning and maintenance by authorized engineers or can be used for networking or integrated monitoring system in the service room.

SNMP card: It is used on site for communication (Optional).

Intelligent card: It is used for extension dry contact interface (Optional).

## 4 UPS Control LCD Panel

### 4.1 UPS LCD Panel

The LCD panel for cabinet is divided into three functional areas: LED indicator, control and operation keys and LCD touch screen.

The structure of operator control and display panel for cabinet is shown in Figure 4-1.



1: LCD touch screen

2: Status indicator

Figure 4-1 Control and display panel for cabinet

#### 4.1.1 LED Indicator

There LED on the panel to indicate the operating status and fault. The description of indicators is shown in Table 4-1.

Table 4-1 Status description of indicator

| Indicator        | State  | Description      |
|------------------|--------|------------------|
| Status indicator | Green  | Normal operation |
|                  | Red    | Fault alarm      |
|                  | Yellow | Warning alarm    |

There are two different types of audible alarm during UPS operation, as shown in Table 4-2.

Table 4-2 Description of audible alarm

| Alarm                           | Description                                                                  |
|---------------------------------|------------------------------------------------------------------------------|
| Two short alarm with a long one | when system has general alarm (for example: AC fault),                       |
| Continuous alarm                | When system has serious faults (for example: fuse blown or hardware failure) |

### CAUTION

When bypass frequency is over track, there is interruption time(less than 10ms) for transferring from bypass to inverter.



### 4.1.3 LCD Touch Screen

User can easily browse the information, operate the UPS, and set the parameters through the LCD touch screen, which is friendly for users.

After the monitoring system starts self-test, the system enters the home page, following the welcome window. The home page is shown in Figure 4-2.

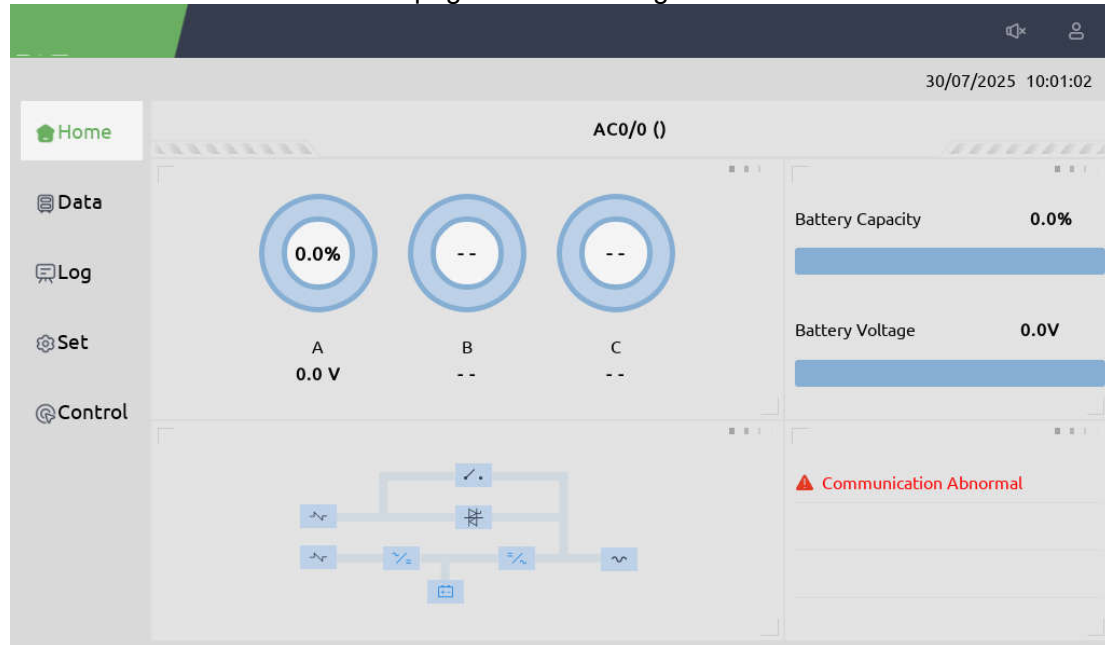


Figure 4-2 Home page

Home page consists of Status bar, Information display, warning information and main menu.

- Status Bar

The status bar contains the product, capacity, operational mode, and the time of the system.

- Warning Information

Display the warning information of the cabinet. The red indicates a serious alarm, while orange indicates a general alarm.

- Information Display

Users can check the information of the cabinet in this area.

The bypass voltage, main input voltage, battery voltage, and output voltages are presented in the form of gauge. The energy flow mimics the flow of the power.

- Main Menu

The main menu includes Data, Setting, Log, Control. Users can operate and control the UPS, and browse all measured parameters through main menu.

The structure of the main menu tree is shown in Figure 4-3.

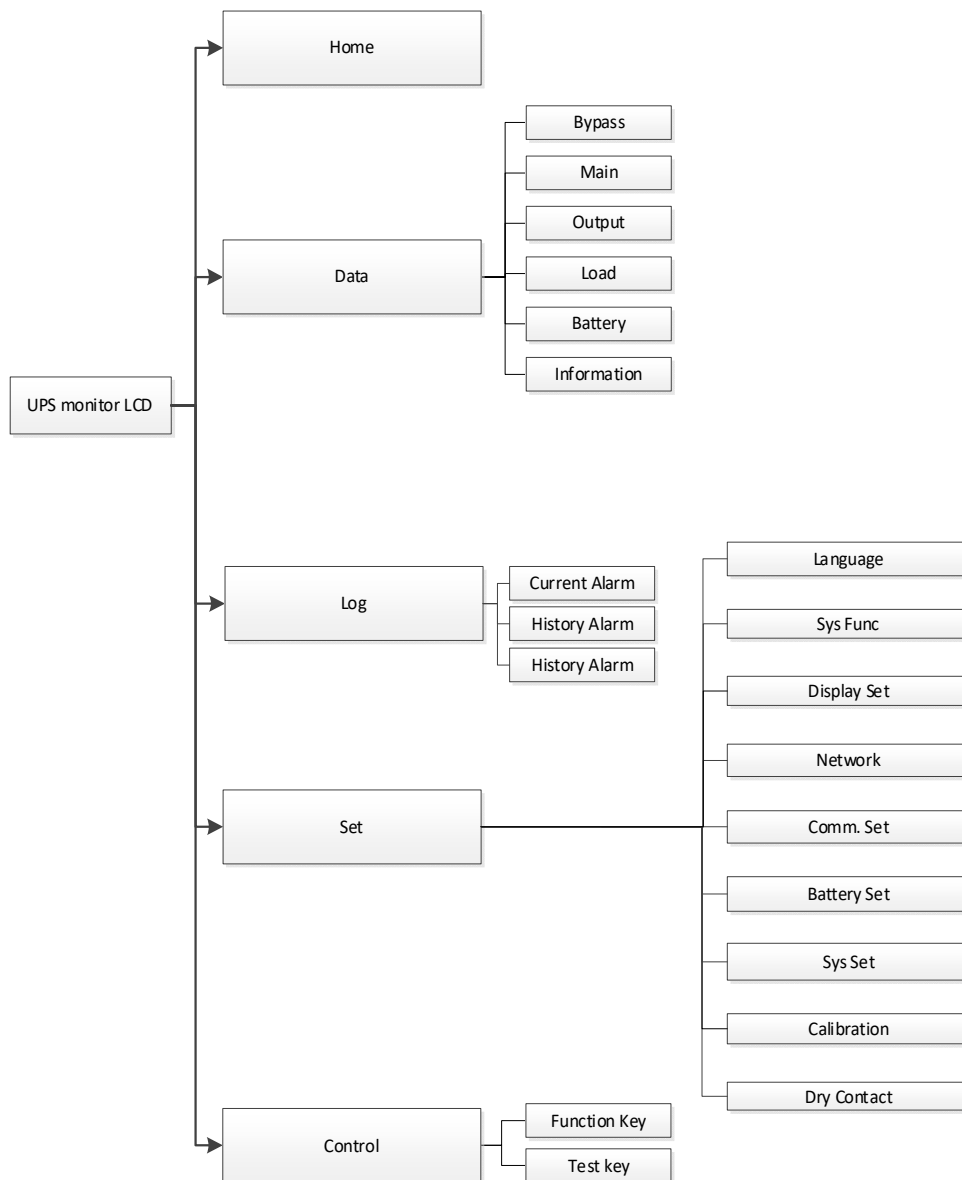


Figure 4-3 Structure of menu diagram

## 4.2 Main Menu

The main menu includes Home page, Data, Setting, Log, Control, and it is described in details below.

### 4.2.1 User Login

Click on the icon  in the upper right corner of the homepage to enter the user login interface, as shown in Figure 4-4. Enter the authorized account and password to log in to the system and perform corresponding permission operations.

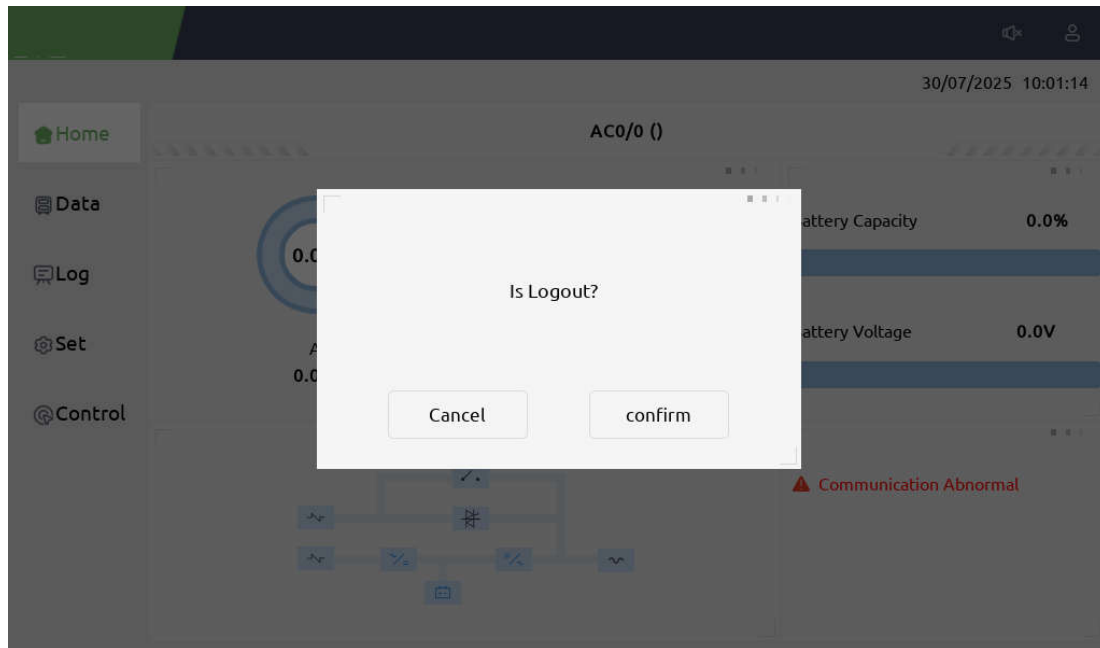


Figure 4-4 Login page

## 4.2.2 Data Menu

Touch the icon  (at the left of the screen), and the system enters the page of the data menu, as it is shown in Figure 4-5.

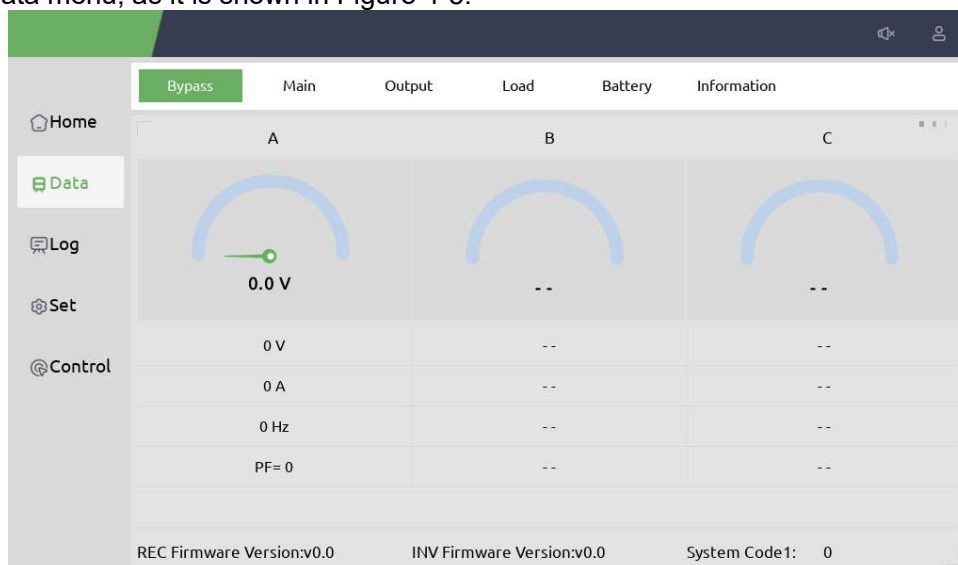


Figure 4-5 Cabinet menu

The cabinet menu interface mainly consists of sub menus for bypass, main input, output, load, and battery. Each sub-menu displays detection information for each part of the cabinet. The sub-menu of Cabinet is described in details below in Table 4-4.

Menu information can be displayed on the next page through the flip icon  in the bottom right corner.

Table 4-4 Description of each sub-menu of Data

| Sub-menu | Contents | Meaning       |
|----------|----------|---------------|
| Bypass   | V        | Phase voltage |
|          | A        | Phase current |

| Sub-menu    | Contents             | Meaning                                       |
|-------------|----------------------|-----------------------------------------------|
| Main        | Hz                   | Input frequency                               |
|             | PF                   | Power factor                                  |
|             | V                    | Phase voltage                                 |
|             | A                    | Phase current                                 |
|             | Hz                   | Bypass frequency                              |
| Output      | PF                   | Power factor                                  |
|             | V                    | Phase voltage                                 |
|             | A                    | Phase current                                 |
|             | Hz                   | Output frequency                              |
| Load        | PF                   | Power factor                                  |
|             | kVA                  | Sout: Apparent Power                          |
|             | kW                   | Pout: Active Power                            |
|             | kVA <sub>r</sub>     | Qout: Reactive power                          |
| Battery     | %                    | Load (The percentage of the UPS load)         |
|             | Battery Number       | Total number of battery connections per group |
|             | Battery Status       | Battery boost/float charging status           |
|             | Run time             | Total battery run time                        |
|             | V                    | Battery positive/negative Voltage             |
|             | A                    | Battery positive/negative Current             |
|             | Battery Capacity (%) | The percentage compared with new battery      |
|             | Remain Time (Min)    | Remaining battery backup time                 |
|             | Battery Temp.(□)     | Battery temperature                           |
| Information | Ambient Temp.(□)     | Environmental temperature                     |
|             | DC BUS +/- (V)       | Bus voltage(positive & negative)              |
|             | Battery +/- (V)      | Battery voltage (positive & negative)         |
|             | Charger(V)           | Charger voltage(positive & negative)          |
|             | Charger(A)           | Charger current(positive & negative)          |
|             | Discharger(A)        | Discharger current(positive & negative)       |
|             | INV Voltage(V)       | Inverter phase A/B/C voltage                  |
|             | Fan Run Time(H)      | Total fan's running time                      |
|             | Capacitor Run        | Total capacitor running time                  |
|             | Air Inlet Temp.(°C)  | Air inlet temperature                         |
|             | Air Outlet Temp.(°C) | Air outlet temperature                        |
|             | REC IGBT Temp.(°C)   | REC IGBT temperature of the phase A/B/C       |
|             | INV IGBT Temp.(°C)   | INV IGBRT temperature of the phase A/B/C      |

#### 4.2.4 Set Menu

Touch the icon  (At the left of the screen), and the system enters the page of the Setting, as is shown in Figure 4-6.

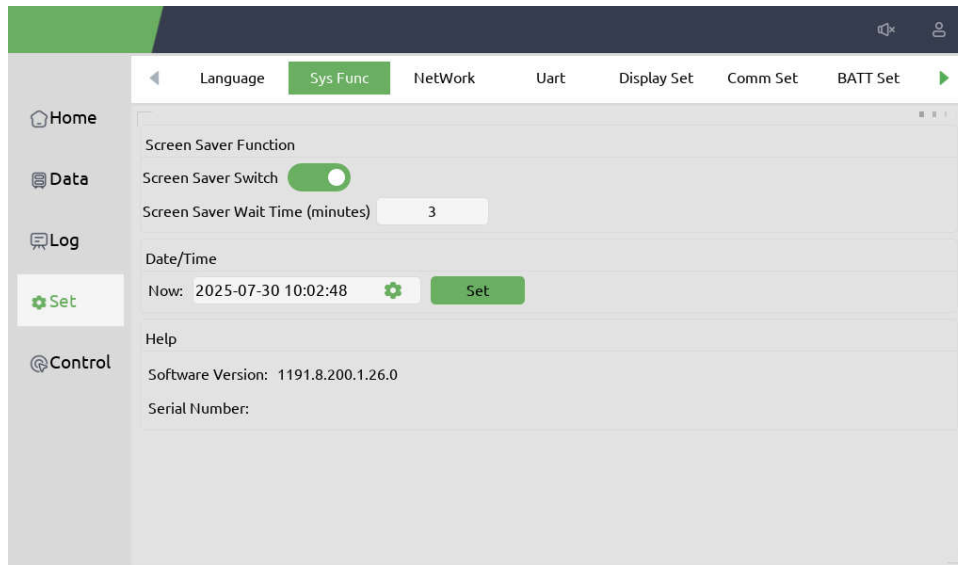


Figure 4-6 Setting menu

Under the setting menu, there are the following grading sub-menus, which are language setting, system function, network setting, general setting, communication setting, user setting, battery setting, system setting, rating setting, system code setting, calibration function and dry contact setting.

The setup subordinate sub-menu is shown in Table 4-6.

Table 4-6 Description of each sub-menu of Setting Menu

| Sub-menu | Contents                       | Description                                                                                                                |
|----------|--------------------------------|----------------------------------------------------------------------------------------------------------------------------|
| Language | Select language                | Select the language of software                                                                                            |
| Sys Func | System function setting        | Setting screensaver, system time, and software version                                                                     |
| NetWork  | Network setting                | Setting network parameters of LCD                                                                                          |
| Comm Set | Comm. interface                | Include RS232,RS485,USB                                                                                                    |
|          | Protocol                       | IncludeModBus_ASCII protocol 、 ModBus_RTU protocol                                                                         |
|          | Baud-rate                      | Setting the baud-rate                                                                                                      |
|          | Device Address                 | Setting the Device address                                                                                                 |
| BATT Set | Battery Type                   | Setting the battery type: VRLA or Lithium                                                                                  |
|          | Battery Number                 | VRLA 12V 30-50 pcs<br>Lithium 3.2V 128-192 pcs                                                                             |
|          | Battery Capacity               | Setting of the AH of the battery<br>VRLA Capacity=Battery(12V) Ah* N groups<br>Lithium Capacity=Battery(3.2V) Ah* N groups |
|          | Float Charge Voltage/Cell*     | Setting the floating Voltage for battery cell<br>VRLA (Cell/2V)<2.5V;Lithium (Cell/3.2V)>3V                                |
|          | Boost Charge Voltage/Cell*     | Setting the boost Voltage for battery cell<br>VRLA (Cell/2V)<2.5V;Lithium (Cell/3.2V)>3V                                   |
|          | EOD Voltage(0.6C)*             | EOD voltage for cell battery,@0.6C current<br>VRLA (Cell/2V)<2V;Lithium (Cell/3.2V)>2V                                     |
|          | EOD Voltage(0.15C)*            | EOD voltage for cell battery,@0.15C current<br>VRLA (Cell/2V)<2V;Lithium (Cell/3.2V)>2V                                    |
|          | Charge Current Percent Limit   | Charge current (percentage of the rated current)                                                                           |
|          | Battery Temperature Compensate | Coefficient for battery temperature                                                                                        |
| Sys Set  | System Mode                    | Setting the system mode: Single , parallel, Single                                                                         |

|             |                                     |                                                                                                   |
|-------------|-------------------------------------|---------------------------------------------------------------------------------------------------|
|             |                                     | ECO, parallel ECO,LBS, parallel LBS                                                               |
|             | Unit Number                         | Set the number of UPS in parallel system                                                          |
|             | Cabinet ID                          | For parallel system, the ID starts from 0                                                         |
|             | Output Voltage Adjustment           | Setting the output voltage                                                                        |
| Calibration | Calibrating product parameters      | Calibrating the UPS voltage                                                                       |
| Dry contact | Configuring the dry contact         | Configuring the dry contact                                                                       |
| Rate set    | Setting rated voltage and frequency | Setting the rated input voltage,rated output voltage,rated input frequency,rated output frequency |



#### Note

1. Improper parameter settings may affect product performance, please ensure that operators receive appropriate training and authorization.
2. The C set for the battery is the ampere hour of the battery. If it is a 100AH battery, then C=100A.
3. Setting up projects may vary depending on different user permissions. For example, lithium battery settings, please contact the manufacturer




#### WARNING

Ensure the number of the battery, set via the menu or the monitoring software, is completely equal to the real installed number. Otherwise, it may cause serious damage to the batteries or the equipment.

### 4.2.5 Log Menu

Click on the icon on the left side of the LCD screen to enter the Log menu, where history is recorded by time.

Display various events and alarm information that have occurred in the system in sequence, and record the time of their set and clear. The recording menu is divided into these menus: current alarm ,historical alarm and operation log. The Home screen is shown in Figure 4-7 below.

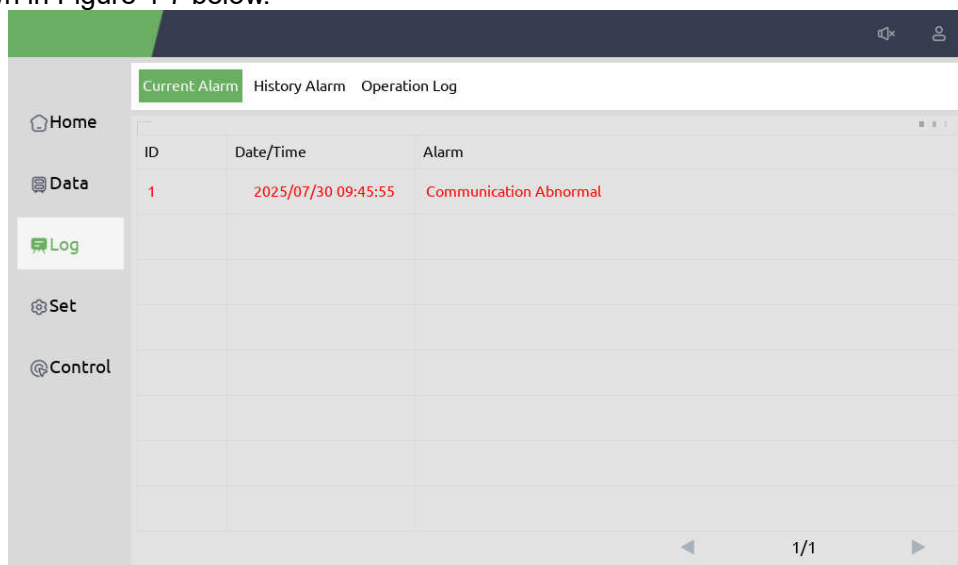

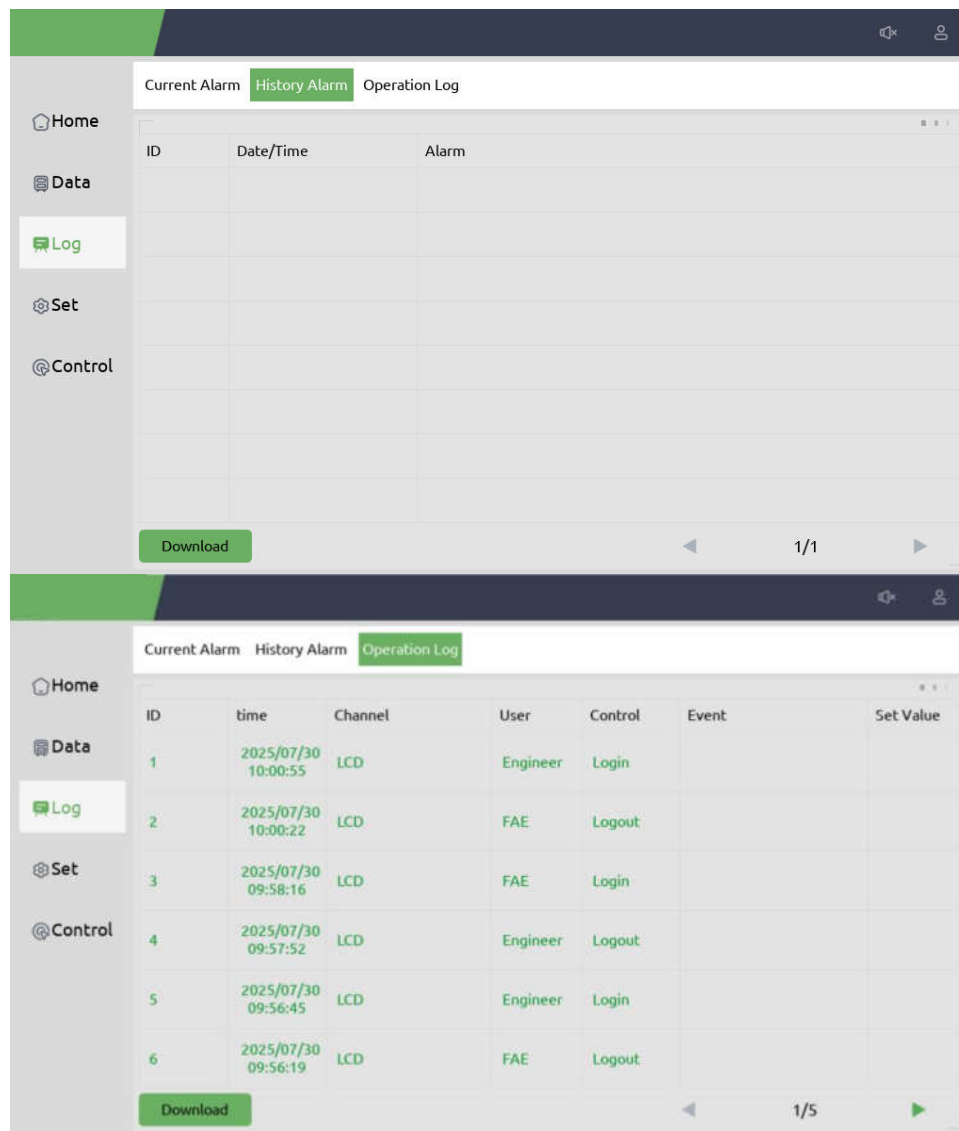


Figure 4-7 Log menu

The Table 4-7 below displays all the events and gives a brief explanation  
Table 4-7 the list for events

| UPS events                   | Description                               |
|------------------------------|-------------------------------------------|
| <b>Fault Clear</b>           | Manually clear fault                      |
| <b>Log Clear</b>             | Manually clear History log                |
| <b>Load On UPS</b>           | Inverter feeds load                       |
| <b>Load On Bypass</b>        | Bypass feeds load                         |
| <b>No Load</b>               | No load                                   |
| <b>Battery Boost</b>         | Charger is working in boost charging mode |
| <b>Battery Float</b>         | Charger is working in float charging mode |
| <b>Battery Discharge</b>     | Battery is discharging                    |
| <b>Battery Connected</b>     | Battery is connected                      |
| <b>Battery Not Connected</b> | Battery is not connected.                 |

|                                |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |
|--------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Maintenance CB Closed</b>   | Manual maintenance breaker is closed                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| <b>Maintenance CB Open</b>     | Manual maintenance breaker is opened                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| <b>EPO</b>                     | Emergency Power Off                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |
| <b>Module On Less</b>          | Available power module capacity is less then the load capacity. Please reduce the load capacity or add extra power module to make sure that the UPS capacity is big enough.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |
| <b>Generator Input</b>         | Generator is connected and a signal is sent to the UPS.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |
| <b>Utility Abnormal</b>        | Utility (Grid) is abnormal. Mains voltage or frequency exceeds the upper or lower limit and results in rectifier shutdown. Check the input phase voltage of rectifier.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              |
| <b>Bypass Sequence Error</b>   | Bypass voltage Sequence is reverse. Check if input power cables are connected correctly.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
| <b>Bypass Volt Abnormal</b>    | <p>This alarm is triggered by an inverter software routine when the amplitude or frequency of bypass voltage exceeds the limit. The alarm will automatically reset if the bypass voltage becomes normal.</p> <p>First check if relevant alarm exists, such as “bypass circuit breaker open”, “Byp Sequence Err” and “Ip Neutral Lost”. If there is any relevant alarm, first clear this alarm.</p> <p>1. Then check and confirm if the bypass voltage and frequency displayed on the LCD are within the setting range. Note that the rated voltage and frequency are respectively specified by “Output Voltage” and “Output Frequency”.</p> <p>2. If the displayed voltage is abnormal, measure the actual bypass voltage and frequency. If the measurement is abnormal, check the external bypass power supply. If the alarm occurs frequently, use the configuration software to increase the bypass high limit set point according to the user’s suggestions</p> |
| <b>Bypass Module Fail</b>      | Bypass Module Fails. This fault is locked until power off. Or bypass fans fail.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |
| <b>Bypass Module Over Load</b> | Bypass current is over the limitation. If bypass current is under 125% of the rated current. The UPS alarms but has no action.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |
| <b>Bypass Over Load Tout</b>   | The bypass overload status continues and the overload times out.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>Byp Freq Over Track</b>     | <p>This alarm is triggered by an inverter software routine when the frequency of bypass voltage exceeds the limit. The alarm will automatically reset if the bypass voltage becomes normal.</p> <p>First check if relevant alarm exists, such as “Byp Sequence Err” and “Input Neutral Lost”. If there is any relevant alarm, first clear this alarm.</p> <p>Then check and confirm if the bypass frequency displayed on the LCD are within the setting range. Note that the rated frequency are respectively specified by “Output Frequency”.</p> <p>If the displayed voltage is abnormal, measure the actual bypass frequency. If the measurement is abnormal, check the external bypass power supply. If the alarm occurs frequently, use the configuration software to increase the bypass high limit set point according to the user’s suggestions</p>                                                                                                         |
| <b>Exceed Tx Times Lmt</b>     | The load is on bypass because the output overload transfer and re-transfer is fixed to the set times during the current hour. The system can recover automatically and will transfer back to the inverter with 1 hour                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                               |
| <b>Output Short</b>            | Output shorted Circuit.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |



|                               |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
|-------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Circuit</b>                | Fist check and confirm if loads have something wrong. Then check and confirm if there is something wrong with terminals, sockets or some other power distribution unit. If the fault is solved, press “Fault Clear” to restart UPS.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
| <b>Battery EOD</b>            | Inverter turned off due to low battery voltage. Check the mains power failure status and recover the mains power in time                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| <b>Battery Test</b>           | System transfer to battery mode for 20 seconds to check if batteries are normal                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| <b>Battery Test OK</b>        | Battery Test OK                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| <b>Battery Maintenance</b>    | System transfer to battery mode until battery voltage is down to 1.1*EOD voltage to maintain battery string                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>Battery Maintenance OK</b> | Battery maintenance succeed                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>Module inserted</b>        | Power Module is inserted in system.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
| <b>Module Exit</b>            | Power Module is pulled out from system.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |
| <b>Rectifier Fail</b>         | The N# Power Module Rectifier Fail, The rectifier is fault and results in rectifier shutdown and battery discharging.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |
| <b>Inverter Fail</b>          | The N# Power Module Inverter Fail. The inverter output voltage is abnormal and the load transfers to bypass.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
| <b>Rectifier Over Temp.</b>   | The N# Power Module Rectifier Over Temperature. The temperature of the rectifier IGBTs is too high to keep rectifier running. This alarm is triggered by the signal from the temperature monitoring device mounted in the rectifier IGBTs. The UPS recovers automatically after the over temperature signal disappears.<br>If over temperature exists, check:<br>1. Whether the ambient temperature is too high.<br>2. Whether the ventilation channel is blocked.<br>3. Whether fan fault happens.<br>4. Whether the input voltage is too low.                                                                                                                                                                                |
| <b>Fan Fail</b>               | At least one fan fails in the N# power module.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |
| <b>Output Over load</b>       | The N# Power Module Output Over Load. This alarm appears when the load rises above 100% of nominal rating. The alarm automatically resets once the overload condition is removed.<br>1. Check which phase has overload through the load (%) displayed in LCD so as to confirm if this alarm is true.<br>2. If this alarm is true, measure the actual output current to confirm if the displayed value is correct.<br>Disconnect non-critical load. In parallel system, this alarm will be triggered if the load is severely imbalanced.                                                                                                                                                                                        |
| <b>Inverter Overload Tout</b> | N# Power Module Inverter Over Load Timeout. The UPS overload status continues and the overload times out.<br>Note:<br>The highest loaded phase will indicate overload timing-out first.<br>When the timer is active, then the alarm “unit over load” should also be active as the load is above nominal.<br>When the time has expired, the inverter Switch is opened and the load transferred to bypass.<br>If the load decreases to lower than 95%, after 2 minutes, the system will transfer back to inverter mode. Check the load (%) displayed in LCD so as to confirm if this alarm is true. If LCD displays that overload happens, then check the actual load and confirm if the UPS has over load before alarm happens. |
| <b>Inverter Over</b>          | The N# Power Module Inverter Over Temperature.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |

|                                 |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
|---------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Temp.</b>                    | The temperature of the inverter heat sink is too high to keep inverter running. This alarm is triggered by the signal from the temperature monitoring device mounted in the inverter IGBTs. The UPS recovers automatically after the over temperature signal disappears.<br>If over temperature exists, check:<br>Whether the ambient temperature is too high.<br>Whether the ventilation channel is blocked.<br>Whether fan fault happens.<br>Whether inverter overload time is out. |
| <b>On UPS Inhibited</b>         | Inhibit system transfer from bypass to UPS (inverter). Check:<br>Whether the power module's capacity is big enough for load.<br>Whether the rectifier is ready.<br>Whether the bypass voltage is normal.                                                                                                                                                                                                                                                                              |
| <b>Manual Transfer Byp</b>      | Transfer to bypass manually                                                                                                                                                                                                                                                                                                                                                                                                                                                           |
| <b>Esc Manual Bypass</b>        | Escape from "transfer to bypass manually" command. If UPS has been transferred to bypass manually, this command enable UPS to transfer to inverter.                                                                                                                                                                                                                                                                                                                                   |
| <b>Battery Volt Low</b>         | Battery Voltage is Low. Before the end of discharging, battery voltage is low warning should occur. After this pre-warning, battery should have the capacity for 3 minutes discharging with full load.                                                                                                                                                                                                                                                                                |
| <b>Battery Reverse</b>          | Battery cables are connected not correctly.                                                                                                                                                                                                                                                                                                                                                                                                                                           |
| <b>Inverter Protect</b>         | The N# Power Module Inverter Protect. Check:<br>Whether inverter voltage is abnormal<br>Whether inverter voltage is much different from other modules, if yes, please adjust inverter voltage of the power module separately.                                                                                                                                                                                                                                                         |
| <b>Input Neutral Lost</b>       | The mains neutral wire is lost or not detected. For 3 phases UPS, it's recommended that user use a 3-poles breaker or switch between input power and UPS.                                                                                                                                                                                                                                                                                                                             |
| <b>Bypass Fan Fail</b>          | At least one of bypass module Fans Fails                                                                                                                                                                                                                                                                                                                                                                                                                                              |
| <b>Manual Shutdown</b>          | The N# Power Module is manually shutdown. The power module shuts down rectifier and inverter, and there's on inverter output.                                                                                                                                                                                                                                                                                                                                                         |
| <b>Manual Boost Charge</b>      | Manually force the Charger work in boost charge mode.                                                                                                                                                                                                                                                                                                                                                                                                                                 |
| <b>Manual Float Charge</b>      | Manually force the charger work in float charge mode.                                                                                                                                                                                                                                                                                                                                                                                                                                 |
| <b>UPS Locked</b>               | Forbidden to shutdown UPS power module manually.                                                                                                                                                                                                                                                                                                                                                                                                                                      |
| <b>Parallel Cable Error</b>     | Parallel cables error. Check:<br>If one or more parallel cables are disconnected or not connected correctly<br>If parallel cable round is disconnected<br>If parallel cable is OK                                                                                                                                                                                                                                                                                                     |
| <b>Lost N+X Redundant</b>       | Lost N+X Redundant. There is no X redundant powers module in system.                                                                                                                                                                                                                                                                                                                                                                                                                  |
| <b>EOD Sys Inhibited</b>        | System is inhibited to supply after the battery is EOD (end of discharging)                                                                                                                                                                                                                                                                                                                                                                                                           |
| <b>Battery Test Fail</b>        | Battery Test Fail. Check if UPS is normal and battery voltage is over 90% of float voltage.                                                                                                                                                                                                                                                                                                                                                                                           |
| <b>Battery Maintenance Fail</b> | Check<br>If UPS is normal and not any alarms<br>If the battery voltage is over 90% of float voltage<br>If load is over 25%                                                                                                                                                                                                                                                                                                                                                            |

|                                 |                                                                                                                                                                                                                                                                                                                                                                          |
|---------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Ambient Over Temp</b>        | Ambient temperature is over the limit of UPS. Air conditioners are required to regulate ambient temperature.                                                                                                                                                                                                                                                             |
| <b>REC CAN Fail</b>             | Rectifier CAN bus communication is abnormal. Please check if communication cables are not connected correctly.                                                                                                                                                                                                                                                           |
| <b>INV IO CAN Fail</b>          | IO signal communication of inverter CAN bus is abnormal. Please check if communication cables are not connected correctly.                                                                                                                                                                                                                                               |
| <b>INV DATA CAN Fail</b>        | DATA communication of inverter CAN bus is abnormal. Please check if communication cables are not connected correctly.                                                                                                                                                                                                                                                    |
| <b>Power Share Fail</b>         | The difference of two or more power modules' output current in system is over limitation. Please adjust output voltage of power modules and restart UPS.                                                                                                                                                                                                                 |
| <b>Sync Pulse Fail</b>          | Synchronization signal between modules is abnormal. Please check if communication cables are not connected correctly.                                                                                                                                                                                                                                                    |
| <b>Input Volt Detect Fail</b>   | Input voltage of N# power module is abnormal.<br>Please check if the input cables are connected correctly.<br>Please check if input fuses are broken.<br>Please check if utility is normal.                                                                                                                                                                              |
| <b>Battery Volt Detect Fail</b> | Battery voltage is abnormal.<br>Please check if batteries are normal.<br>Please check if battery fuses are broken on input power board.                                                                                                                                                                                                                                  |
| <b>Output Volt Fail</b>         | Output voltage is abnormal.                                                                                                                                                                                                                                                                                                                                              |
| <b>Bypass Volt Detect Fail</b>  | Bypass voltage is abnormal.<br>Please check if bypass breaker is closed and is good.<br>Please check if bypass cables are connected correctly.                                                                                                                                                                                                                           |
| <b>INV Bridge Fail</b>          | Inverter IGBTs are broken and opened.                                                                                                                                                                                                                                                                                                                                    |
| <b>Outlet Temp Error</b>        | Outlet temperature of power module is over the limitation.<br>Please check if fans are abnormal.<br>Please check if PFC or inverter inductors are abnormal.<br>Please check if air passage is blocked.<br>Please check if ambient temperature is too high.                                                                                                               |
| <b>Input Curr Unbalance</b>     | The difference of input current between every two phases is over 40% of rated current.<br>Please check if rectifier's fuses, diode, IGBT or PFC diodes are broken.<br>Please check if input voltage is abnormal.                                                                                                                                                         |
| <b>DC Bus Over Volt</b>         | Voltage of DC bus capacitors is over limitation. UPS shutdown rectifier and inverter.                                                                                                                                                                                                                                                                                    |
| <b>REC Soft Start Fail</b>      | While soft start procedures are finished, DC bus voltage is lower than the limitation of calculation according utility voltage. Please check<br>1. Whether rectifier diodes are broken<br>2. Whether PFC IGBTs are broken<br>3. Whether PFC diodes are broken<br>4. Whether drivers of SCR or IGBT are abnormal<br>5. Whether soft start resistors or relay are abnormal |
| <b>Relay Connect Fail</b>       | Inverter relays are opened and cannot work or fuses are broken.                                                                                                                                                                                                                                                                                                          |
| <b>Relay Short Circuit</b>      | Inverter relays are shorted and cannot be released.                                                                                                                                                                                                                                                                                                                      |
| <b>PWM Sync Fail</b>            | PWM synchronizing signal is abnormal                                                                                                                                                                                                                                                                                                                                     |
| <b>Intelligent Sleep</b>        | UPS works in intelligent sleep mode. In this mode, the power modules will be standby in turn. It will be more reliability and higher efficiency. It must be confirmed that remained power modules' capacity is big enough to feed load. It must be                                                                                                                       |

|                               |                                                                                                                                                                                                                     |
|-------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                               | conformed that working modules' capacity is big enough if user add more load to UPS. It's recommended that sleeping power modules are waken up if the capacity of new added loads is not sure.                      |
| <b>Manual Transfer to INV</b> | Manually transfer UPS to inverter. It's used to transfer UPS to inverter when bypass is over tracking. The interrupt time could be over 20ms.                                                                       |
| <b>Input Over Curr Tout</b>   | Input over current timeout and UPS transfer to battery mode. Please check if input voltage is too low and output load is big. Please regulate input voltage to be higher if it's possible or disconnect some loads. |
| <b>No Inlet Temp. Sensor</b>  | Inlet temperature sensor is not connected correctly.                                                                                                                                                                |
| <b>No Outlet Temp. Sensor</b> | Outlet temperature sensor is not connected correctly.                                                                                                                                                               |
| <b>Inlet Over Temp.</b>       | Inlet air is over temperature. Make sure that the operation temperature of UPS is between 0-40°C.                                                                                                                   |
| <b>Capacitor Time Reset</b>   | Reset timing of DC bus capacitors.                                                                                                                                                                                  |
| <b>Fan Time Reset</b>         | Reset timing of fans.                                                                                                                                                                                               |
| <b>Battery History Reset</b>  | Reset battery history data.                                                                                                                                                                                         |
| <b>Byp Fan Time Reset</b>     | Reset timing of bypass fans.                                                                                                                                                                                        |
| <b>Battery Over Temp.</b>     | Battery is over temperature. It's optional.                                                                                                                                                                         |
| <b>Bypass Fan Expired</b>     | Working life of bypass fans is expired, and it's recommended that the fans are replaced with new fans. It must be activated via software.                                                                           |
| <b>Capacitor Expired</b>      | Working life of capacitors is expired, and it's recommended that the capacitors are replaced with new capacitors. It must be activated via software.                                                                |
| <b>Fan Expired</b>            | Working life of power modules' fans is expired, and it's recommended that the fans are replaced with new fans. It must be activated via software.                                                                   |
| <b>INV IGBT Driver Block</b>  | Inverter IGBTs are shutdown.<br>Please check if power modules are inserted in cabinet correctly.<br>Please check if fuses between rectifier and inverter are broken.                                                |
| <b>Battery Expired</b>        | Working life of batteries is expired, and it's recommended that the batteries are replaced with new batteries. It must be activated via software.                                                                   |
| <b>Bypass CAN Fail</b>        | The CAN bus between bypass module and cabinet is abnormal.                                                                                                                                                          |
| <b>Dust Filter Expired</b>    | Dust filter need to be clear or replaced with a new one                                                                                                                                                             |
| <b>Stop Test</b>              | Manually stop battery test or battery maintenance, UPS transfer back to normal mode.                                                                                                                                |
| <b>Wave Trigger</b>           | Waveform has been saved while UPS fail                                                                                                                                                                              |
| <b>Bypass CAN Fail</b>        | Bypass and cabinet communicate with each other via CAN bus. Check<br>If connector or signal cable is abnormal.<br>If monitoring board is abnormal.                                                                  |
| <b>Firmware Error</b>         | Manufacturer used only.                                                                                                                                                                                             |
| <b>System Setting</b>         | Manufacturer used only.                                                                                                                                                                                             |

| Error                      |                                                                                                                                                                                             |
|----------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Bypass Over Temp.</b>   | Bypass module is over temperature. Please check<br>If bypass load is overload<br>If ambient temperature is over 40°C<br>If bypass SCRs are assembled correctly<br>If bypass fans are normal |
| <b>Module ID Duplicate</b> | At least two modules are set as same ID on the power connector board, please set the ID as correct sequence                                                                                 |



#### Note

Different colors of the words represent different level of events:

- (a) Green, an event occurs or disappear;
- (b) Yellow, warning occurs;
- (c) Red, faults happen.

## 4.2.6 Control Menu

Touch the icon  (at the left of the screen), and the system enters the page of the "Control",  
The control menu include "Func Button" & "Test Command", as it is shown in Figure 4-8& Figure 4-9.

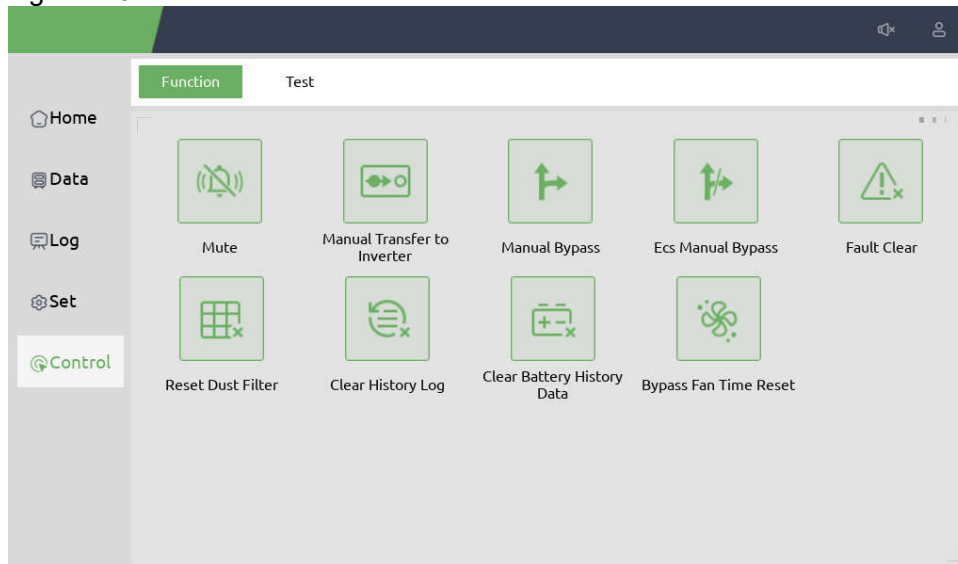


Figure 4-8 Control-Function Button menu

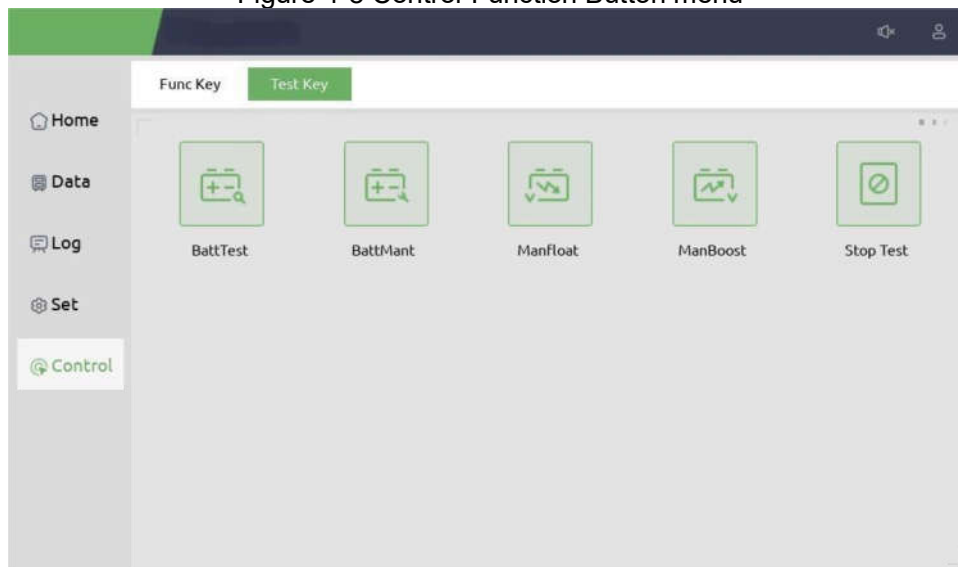


Figure 4-9 Control-Test Command menu

The "Control" menu includes "Func Button" and "Test Command". The contents are described in details below.

### Function Button

#### Mute and Unmute

Mute or unmute alarm of the system by touching the icon



#### Fault Clear




Clear the faults by touching the icon **Fault Clear** .

## Manual Bypass and ESC Manual Bypass




Transfer to bypass mode or cancel this command by touching the icon **Manual Bypass** or



**Ecs Manual Bypass** .

## Manual Transfer Inv



Transfer the bypass mode to Inverter Mode by touching the icon **Manual Transfer Inv** .

## Battery History Data Clear



Clear the battery history data by touching the icon **Batt His Data Clr** , the history data includes the times of discharge, days for running and hours of discharging.

## Reset Dust Filter



Reset the time of dust filter using by touching the icon **Reset Dust Filter** , it includes the days of using and maintenance period.

## Test Command

### Battery Test



By touching the icon **BattTest** , the system transfer to the battery mode to test the condition of the battery. Ensure the bypass is working normally and the capacity of the battery is no less than 25%.

### Battery Maintenance



By touching the icon **BattMant** , the system transfer to the battery mode. This function is used for maintaining the battery, which requires the normality of the bypass and minimum capacity of 25% for the battery.

### Battery Boost



By touching the icon **ManBoost** , the system starts boost charging.

## Battery Float



By touching the icon **ManFloat**, the system starts float charging.

## Stop Test



By touching the icon **Stop Test**, the system stops battery test or battery maintenance.



## 5 Operations

### 5.1 UPS Start-up

#### 5.1.1 Startup in normal mode

The UPS must be started up by commissioning engineer after the completeness of installation. The steps below must be followed:

1. Ensure all the circuit breakers are open.
2. One by one to close the output breaker, input breaker, bypass input breaker, and then the system starts initializing;
3. The LCD in front of the cabinet is lit up. The system enters the home page, as shown in Figure 4-2.
4. Notice the energy flowing diagram, the rectifier start.
5. After about 30S, the rectifier start is completed, the bypass static switch is on.
6. After the bypass static switch is on, the inverter start.
7. After about 30S, when the inverter is running normally, the UPS switches from the bypass to the inverter.
8. Users can close the external or internal battery breaker, the load indicator flashing. Then start charge the battery. The startup has finished.




**Note:** You can set the parameters of language, date and time through sub-menu. When the system starts, the stored setting will be defaulted. If you have already set these parameters, system default existing settings. Users can browse all events during the process of the starting up by checking the menu Log.


#### 5.1.2 Start from battery

The start from battery refers to the battery cold start(optional). The steps of the start-up are as follow:


1. Confirm the batteries are correctly connected, and then close the output circuit breaker and external or internal battery circuit breakers.
2. Press and hold the red button of battery, as shown in Figure 5-1, battery supply power to UPS.

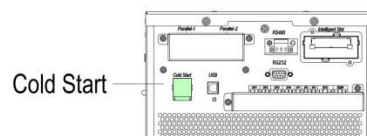


(a) 10-60kVA long backup type

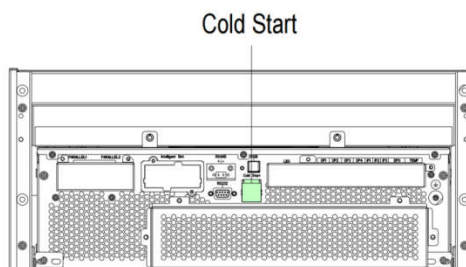


(b) 10-40kVA standard backup type

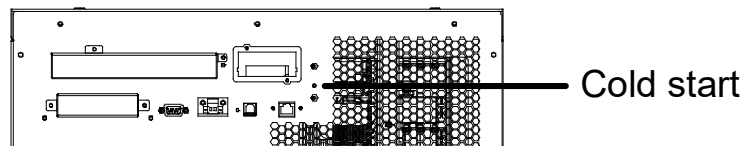


(c) 60kVA standard backup type

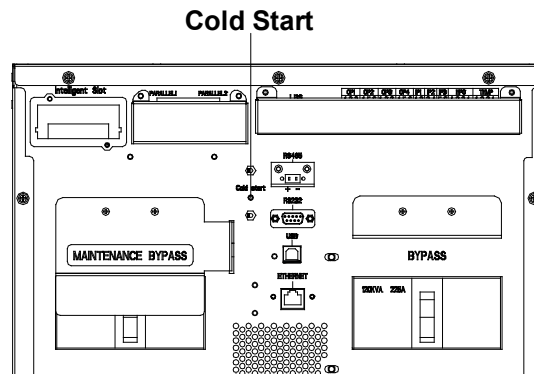

(d) 80-100kVA long backup type

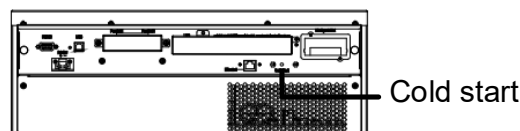

(e) 80/100kVA standard backup type

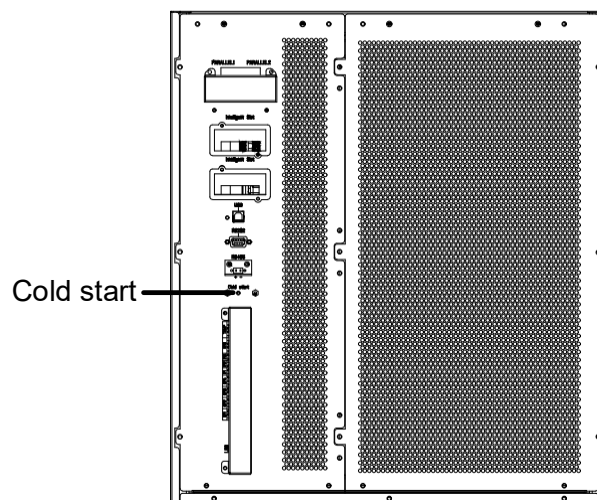

(f) 180-200kVA long backup type

Figure5-1 Position of the battery cold start button

3. Then UPS starts up after step 3 normal mode, the rectifier completes the start, and the inverter begins to start, and after 60 seconds, the inverter complete the start, UPS run in battery mode.

*Attention: Press battery cold start button after 1 minute of battery access.*

## 5.2 UPS Shut down

If want to shut down UPS completely, please first ensure the load is shut down correctly,

and then turn off the battery breaker (internal or external), the main input breaker (internal or external), the bypass input breaker (internal or external, if have) one by one, the display screen will be off completely.


Note: If UPS in maintenance bypass mode, please also turn off the maintenance bypass breaker.

## 5.3 Procedure for Switching between Operation Modes

### 5.3.1 Switching the UPS from Normal Mode into Battery Mode

The UPS transfers to battery mode immediately after the utility (mains voltage) fails or drops down below the predefined limit.

### 5.3.2 Switching the UPS from Normal Mode into Bypass Mode




Enter the menu "Control", touch the icon "transfer to bypass" and the system should transfer to bypass mode.



#### **WARNING**

Ensure the bypass is working normally before transferring to bypass mode. Or it may cause failure.

### 5.3.3 Switching the UPS into Normal Mode from Bypass Mode



Enter the menu "Control", touch the icon "Ecs Manual Bypass" and the system should transfer to Normal mode.




#### **Note**

Normally, the system will transfer to the normal mode automatically. This function is used when the frequency of the bypass is over track and when the system needs to transfer to Normal mode by manual.

### 5.3.4 Switching the UPS into Maintenance Bypass Mode from Normal Mode

These following procedures can transfer the load from the UPS inverter output to the maintenance bypass supply, which is used for maintaining the UPS.

1. Transfer the UPS into Bypass mode as per the chapter 5.3.2.
2. Remove the cover of maintenance bypass breaker.

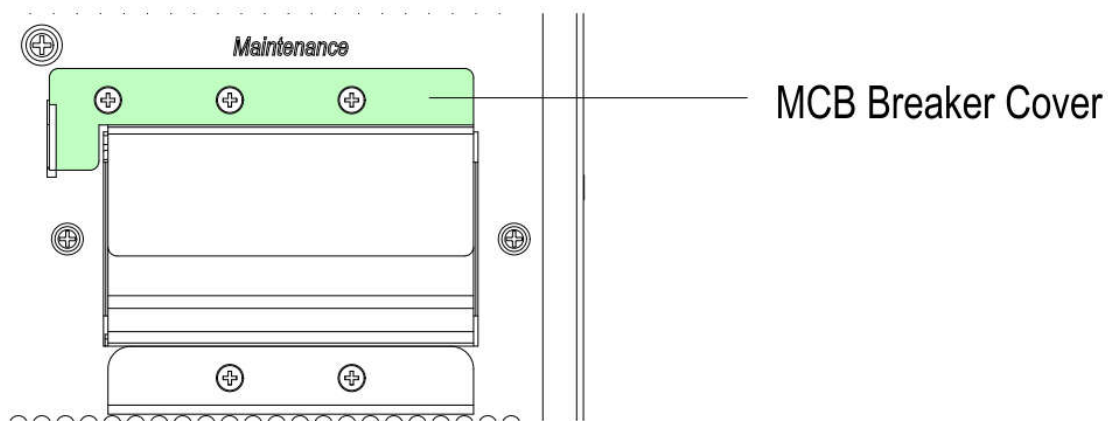

3. Turn on the maintenance bypass breaker. And the load is powered through maintenance bypass and static bypass.
4. One by one to turn off the battery breaker, input breaker, bypass input breaker and output breaker.
5. The load is powered through maintenance bypass.



#### Note

- In manual bypass mode (The manual bypass supplies power to loads), dangerous voltages are present on terminal.
- The UPS need to use external circuit breakers (Includes external input breaker, external bypass input breaker, external output breaker and external maintenance bypass breaker).



#### WARNING

Before making this operation, please read messages on LCD display to ensure that bypass supply is regular and the inverter is synchronous with it, so as not to risk a short interruption in powering the load.



#### DANGER

Even with the LCD turned off, the terminals of input and output may be still energized. Wait for 10 minutes to let the DC bus capacitor fully discharge before removing the cover.

### 5.3.5 Switching the UPS into Normal Mode from Maintenance Bypass Mode

These following procedures can transfer the load from the Maintenance Bypass mode to inverter output.

1. After finish of maintenance. One by one to turn on the output breaker, the bypass input breaker, the input breaker and the external or internal battery breaker. After 30S, the bypass indicator LED flashes and the load is powered through maintenance bypass breaker and static bypass.
2. Turn off the maintenance bypass breaker and fix the protection cover, and then the load is powered through static bypass. The rectifier starts after 30 seconds, inverter is starting. The inverter energy bar flashes and the inverter starts.
3. After 60 seconds, the system transfers to normal mode.

## 5.4 Battery Maintenance

If batteries are not in use for a long time, it is necessary to test the condition of the battery. Two methods are provided:

1) Manual discharging test. Enter the "Control" menu, as is shown in Figure 5-2 and touch



the icon "Battery maintenance" BattMant, the system transfers into battery mode for discharging. The system will stop discharging when batteries have 20% of capacity or in



low voltage. Users can stop the discharging by touching the "Stop Test" icon Stop Test.

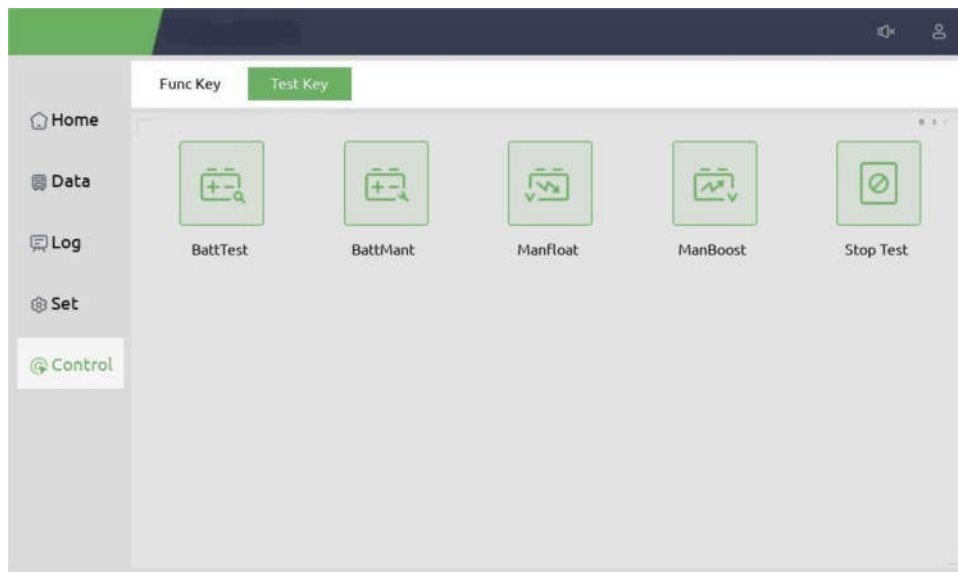


Figure 5-2 Battery maintenance

2) Auto discharging. The system can be set to discharge automatically per a certain time. The setting procedures are as follows.(this needs to be done by factory or connect the background monitor software operation).

- Enable "battery auto discharge". Enter the "Set" page of the setting menu, tick "Battery Auto Discharge" and confirm.
- Setting the period for "battery auto discharge". Enter the "Battery Set" page of the setting, set the period time in the item "Auto Maintenance Discharge Period" and confirm.



**WARNING**  
The load for the auto maintenance discharge should be 20%-100%,if not, the system will not start the process automatically.

## 5.5 Parallel UPS

### 5.5.1 Diagram of the parallel system

UPS can be scaled up to four times the stand-alone capacity by parallel 4 cabinets, The parallel structure diagram is shown in Figure 5-3.

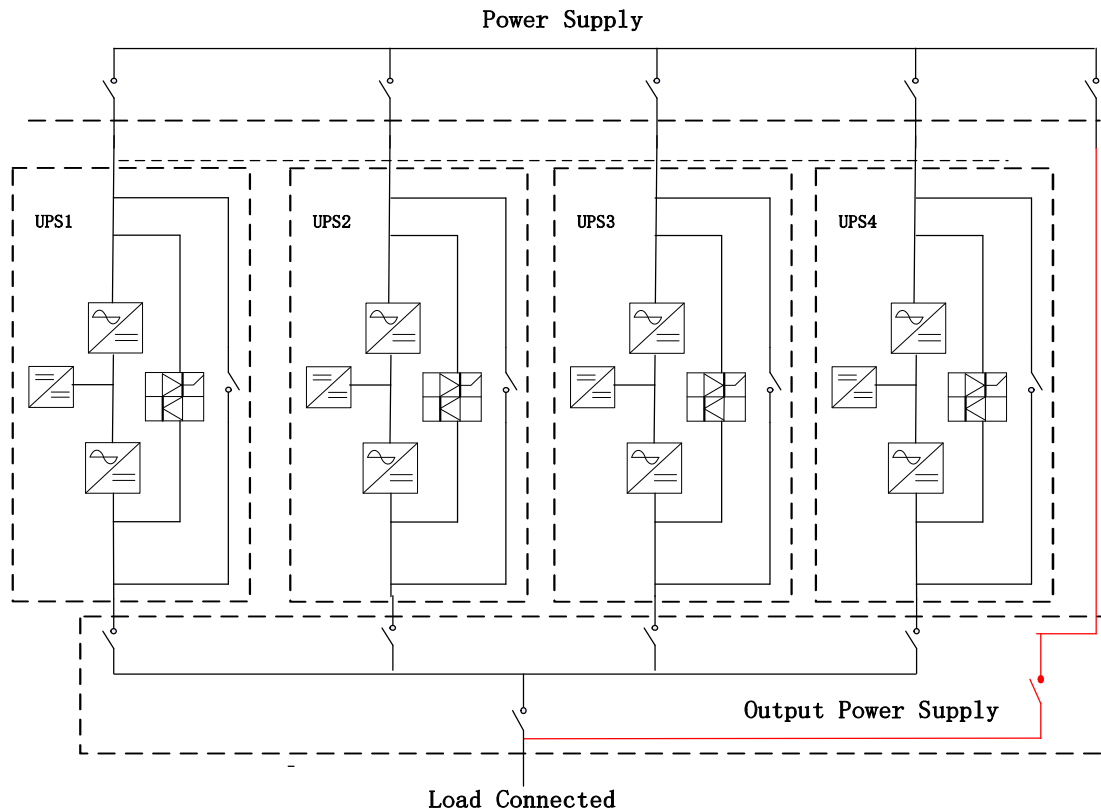


Figure5-3 Parallel Structure

The system parallel board is located on the rear of the UPS cabinet, Its position is shown in Figure 5-4.

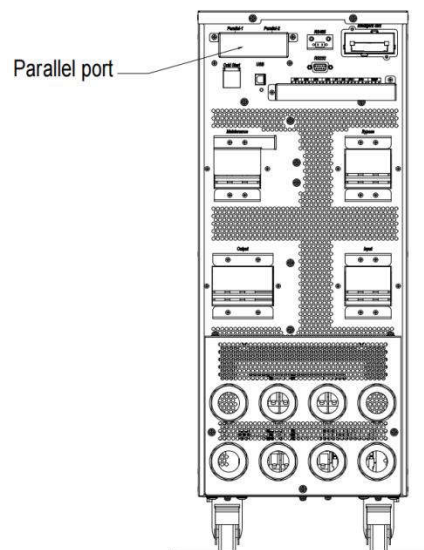


Figure5-4 Parallel board location

Open the cover of parallel board, connect the terminals in order with cables, connected into a ring. The connection is shown in Figure 5-5.

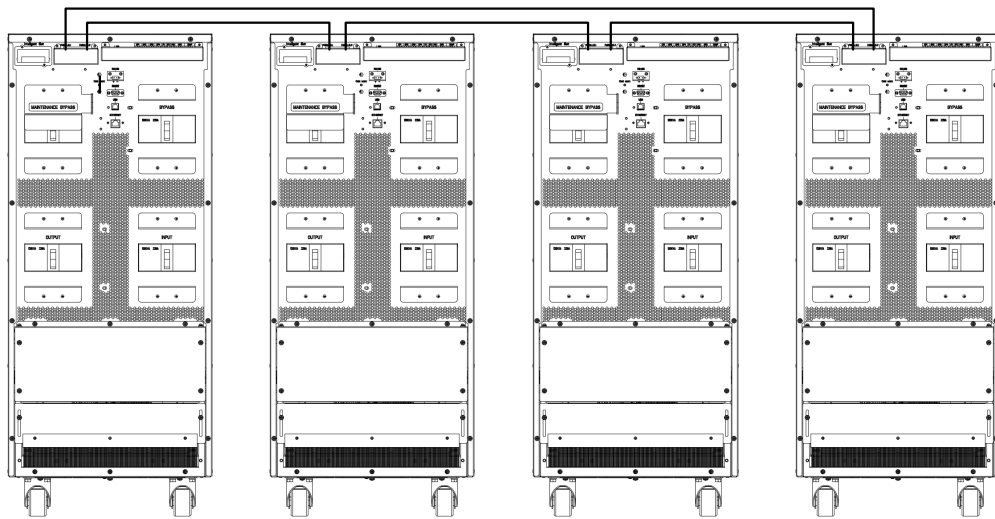


Figure5-5 Parallel connection

### 5.5.2 Parallel operation process

Short-circuit the main and bypass inputs of each UPS in the system (If the main side of different sources, then short circuit the main road, bypass and other UPS in the system of the main road, bypass together). Taking into account the bypass current sharing problem of the parallel system, the specifications and length of the input and output power lines of each UPS in the parallel system should be consistent.

If the customer needs to set the parallel parameters according to actual needs, please follow the steps below:

- 1、Set each UPS in the machine system one by one: In LCD screen or background software click "Set" "System Set", set to "Parallel" and select "United Number" and "Cabinet ID". In principle, the Cabinet ID starts from "0" and is continuous and must not be repeated. For example: a three-parallel system, the ID of one UPS is set to "0", and the other two are set to "1" and "2" in turn. The UPS and the code correspond freely, and no special requirement. All UPS output parameters must be consistent, otherwise they can't be paralleled.

All settings take effect after the UPS restarts. Background parallel parameter settings are shown in Figure.5-6.


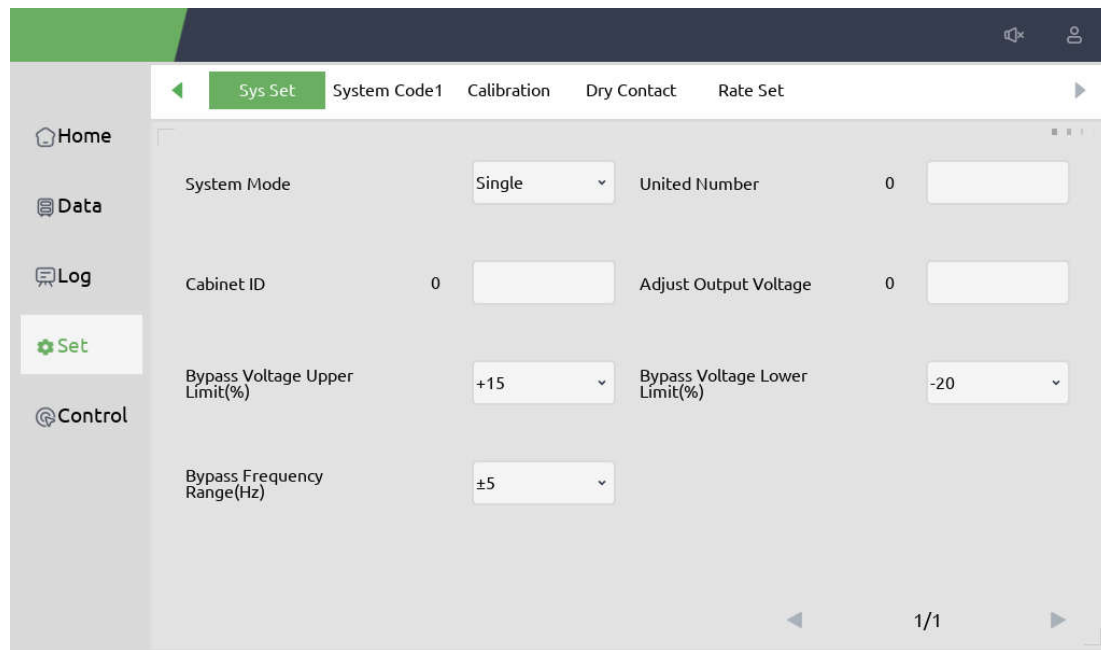


Figure5-6 parallel setting

2. Depending on the number of parallel connections, the corresponding short-circuit pin status on the board is also different. Please consult the manufacturer.  
 The parallel board is shown in the figure below.

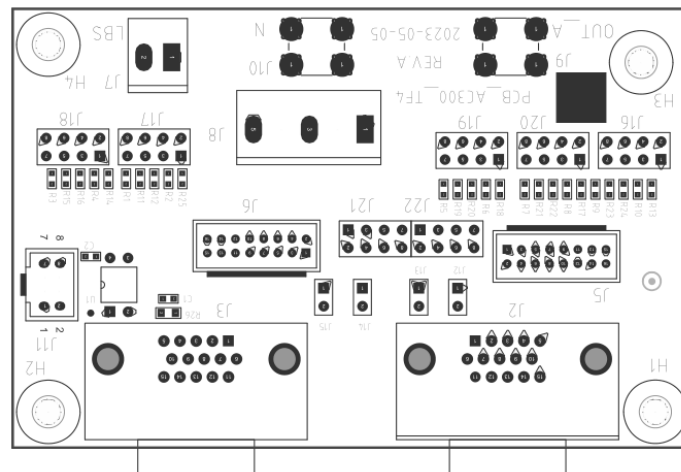

**Note:** Please contact the manufacturer for parallel set and follow the parallel setting manual.

After confirming that each single UPS is properly commissioned, debug the parallel system, the specific steps are as follows:

- 1) Close the input and output breakers of one of the UPSs, and the UPS will power on and enter the bypass for power supply. The rectifier and inverter are turned on one after another and switched to the inverter power supply mode, test whether the output is normal;
- 2) Close the input and output breaker of the second UPS, follow the above start-up operation steps, and the UPS will automatically enter the system. Check the LCD display UPS without warning and make sure that the UPS is working normally;
- 3) And so on, continue to put the third or fourth UPS into the parallel system after turning on the inverter;
- 4) With a certain load, each UPS should be able to share the load equally.





## **WARNING**

During the power-on process of the parallel system, make sure that the external output of each UPS is closed, and that all UPS inverter outputs are parallel.

---

## 6 Maintenance

This chapter introduces UPS maintenance, including the maintenance instructions of power parts and monitoring bypass parts and the replacement method of dust filter.

### 6.1 Precautions

1. Only maintaining engineers can maintain the power parts.
2. The power parts should be disassembled from top to bottom, so as to prevent any inclination from high gravity center of the cabinet.
3. To ensure the safety before maintaining power parts and bypass parts, use a multi-meter to measure the voltage between operating parts and the earth to ensure the voltage is lower than hazardous voltage, i.e. DC voltage is lower than 60Vdc, and AC maximum voltage is lower than 42.4 Vac, the voltage on the DC bus capacitor is less than 60Vdc
4. Wait 10 minutes before opening the cover of the power parts or the bypass after pulling out from the cabinet.

### 6.2 Instruction for maintaining UPS

Please refer to Chapter 5.3.4 to transfer to maintenance bypass mode, remove the UPS panel and the damaged parts. After the maintenance is complete, the components and the panels are returned to the cabinet. Refer to chapter 5.3.5 to transfer UPS to normal module from maintenance bypass mode.

### 6.3 Instruction for Maintaining Battery String

For the Lead-Acid maintenance free battery, when maintaining the battery according to requirements, battery life can be prolonged. The battery life is mainly determined by the following factors: installation, temperature, charging/discharging current, charging voltage, discharge depth, long-time discharge.

- 1) Installation. The battery should be placed in dry and cool place with good ventilation. Avoid direct sunlight and keep away from heat source. When installing, ensure the correct connection to the batteries with same specification.
- 2) Temperature. The most suitable storage temperature is about 25℃.
- 3) Charging/discharging current. The best charging current for the lead-acid battery is 0.1C. The maximum charging current for the battery can be 0.2C. The discharging current should be 0.05C-3C.
- 4) Charging voltage. In most of the time, the battery is in standby state. When the utility is normal, the system will charge the battery in boost mode (constant voltage with maximum limited) to full and then transfers to the state of float charge to prolong the battery life. Discharge only without power. Float charging voltage of each cell is about 13.7V. If the charging voltage is too high, the battery will be overcharged, if the charging voltage is too low, the battery will be lack of power.
- 5) Discharge depth. Avoiding deep discharge, which will greatly reduce the life time of the battery. When the UPS runs in battery mode with light load or no load for a long time, it will cause the battery to deep discharge.
- 6) Check periodically. The battery should be checked regularly after a certain amount of time. Observe if any abnormality of the battery, measure if the voltage of each battery is in balance. Discharge the battery periodically. The battery remain charged for a long time, which will make the battery less active, so even without power outages, UPS will need to conduct regular discharge tests to keep the battery active.



### **WARNING**

Daily inspection is very important!

Check and confirm the battery connection is tightened regularly, and make sure there is no abnormal heat generated from the battery.

---



### **WARNING**

If one battery has leakage or is damaged, it must be replaced, stored in a container resistant to sulfuric acid and disposed of in accordance with local regulations.

---

The waste lead-acid battery is a kind of hazardous waste and is one of the major contaminants controlled by government.

Therefore, its storage, transportation, use and disposal must comply with the national or local regulations and laws about the disposal of hazardous waste and waste batteries or other standards.

According to the national laws, the waste lead-acid battery should be recycled and reused, and it is prohibited to dispose of the batteries in other ways except recycling. Throwing away the waste lead-acid batteries at will or other improper disposal methods will cause severe environment pollution, and the person who does this will bear the corresponding legal responsibilities.

## 7. Product Specifications

This chapter provides the specifications of the product, including environment characteristics mechanical characteristics and electrical characteristics.

### 7.1 Applicable Standards

The UPS has been designed to conform to the following European and international standards:

Table7-1 Compliance with European and International Standards

| Item                                                              | Normative reference                          |
|-------------------------------------------------------------------|----------------------------------------------|
| General safety requirements for UPS used in operator access areas | EN50091-1-1/IEC62040-1-1/AS 62040-1-1        |
| Electromagnetic compatibility (EMC) requirements for UPS          | EN50091-2/IEC62040-2/AS 62040-2 (C3)         |
| Method of specifying the performance and test requirements of UPS | EN50091-3/IEC62040-3/AS 62040-3 (VFI SS 111) |

**Attention:** The above-mentioned product standards incorporate relevant compliance clauses with generic IEC and EN standards for safety (IEC/EN/AS60950), electromagnetic emission and immunity (IEC/EN61000 series) and construction (IEC/EN60146 series and 60950).

### 7.2 Environmental Characteristics

Table7-2 Environmental Characteristics

| Item                            | Unit | Parameter                                                                    |
|---------------------------------|------|------------------------------------------------------------------------------|
| Acoustic noise level at 1 meter | dB   | 65dB @ 100% load, 62dB @ 45% load                                            |
| Altitude of Operation           | m    | ≤1000, load de-rated 1% per 100m from 1000m to 2000m                         |
| Relative Humidity               | %RH  | 0-95, non-condensing                                                         |
| Operating Temperature           | °C   | 0-40(for UPS only),Battery life is halved for every 10°C increase above 20°C |
| UPS Storage Temperature         | °C   | -40-70                                                                       |

|          |  |           |
|----------|--|-----------|
| Waveform |  | Sine wave |
|----------|--|-----------|

## 7.3 Mechanical Characteristics

The main mechanical characteristics of the cabinet are shown below for table 7-3.

Table7-3 mechanical characteristics of the cabinet

| Cabinet model     | Unit | 10/15/20/30k long backup model | 40/60k long backup model | 80/100k long backup model | 180/200k long backup model |
|-------------------|------|--------------------------------|--------------------------|---------------------------|----------------------------|
| Dimension (W×D×H) | mm   | 250*530*650                    | 250*782*650              | 350*950*900               | 500*900*1300               |
| Color             | N/A  | Black                          |                          |                           |                            |
| Protection Level  | N/A  | IP20                           |                          |                           |                            |
| Cabinet model     | Unit | 10/15/20/30/40k Standard model | 60k Standard model       | 80/100k Standard model    |                            |
| Dimension (W×D×H) | mm   | 500*865*920                    | 500*800*1350             | 500*950*1700              |                            |
| Color             | N/A  | Black                          |                          |                           |                            |
| Protection Level  | N/A  | IP20                           |                          |                           |                            |

## 7.4 Electrical Characteristics

### 7.4.1 Electrical Characteristics (Input Rectifier)

The main electrical characteristics of the rectifier are shown in Table 7-4 below.

Table7-4 Rectifier AC input Mains

| Item                   | Unit             | Parameter                                                                                             |
|------------------------|------------------|-------------------------------------------------------------------------------------------------------|
| Grid System            | \                | 3 Lines + Neutral + Ground                                                                            |
| Rated AC Input Voltage | Vac              | 380/400/415(three-phase and sharing neutral with the bypass input)                                    |
| Rated Frequency        | Vac              | 50/60Hz                                                                                               |
| Input voltage range    | Vac              | 304V~478VVac (Line-Line),full load<br>228V~304Vac (Line-Line),load decrease linearly from 100% to 50% |
| Input Frequency range  | Hz               | 40~70                                                                                                 |
| Input Power factor     | kW/kVA,full load | >0.99                                                                                                 |
| THDI                   | THDI%            | <3% (100% linear load,10-60kVA)<br><2% (100% linear load,80-200kVA)                                   |

## 7.4.2 Electrical Characteristics (Intermediate DC Link)

Table7-5 Battery parameter

| Items                              | Unit              | Parameters                                                                                                                                                                                                                                             |
|------------------------------------|-------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Battery bus voltage                | Vdc               | Rated: $\pm 240V$                                                                                                                                                                                                                                      |
| Quantity of lead-acid cells        | Nominal           | 40=[1 battery(12V)] ,240=[1 battery(2V)]                                                                                                                                                                                                               |
| Float charge voltage               | V/cell (VRLA)     | 2.25V/cell(selectable from 2.2V/cell~2.35V/cell)<br>Constant current and constant voltage charge mode                                                                                                                                                  |
| Temperature compensation           | mV/□/cl           | - 3.0(selectable:0~-5.0)                                                                                                                                                                                                                               |
| Ripple voltage                     | % V float         | $\leq 1$                                                                                                                                                                                                                                               |
| Ripple current                     | % C <sub>10</sub> | $\leq 5$                                                                                                                                                                                                                                               |
| Boost Voltage                      | VRLA              | 2.4V/cell(selectable from : 2.30V/cell~2.45V/cell)<br>Constant current and constant voltage charge mode                                                                                                                                                |
| End Of Discharge Voltage           | V/cell (VRLA)     | 1.65V/cell(selectable from: 1.60V/cell~1.750V/cell)<br>@0.6C discharge current<br>1.75V/cell (selectable from: 1.65V/cell~1.8V/cell)<br>@0.15C discharge current<br>(EOD voltage changes linearly within the set range according to discharge current) |
| Battery Charge                     | V/cell            | 2.4V/cell(selectable from : 2.3V/cell~2.45V/cell)<br>Constant current and constant voltage charging mode                                                                                                                                               |
| Battery Charging Power Max Current | kW                | 10%* UPS capacity (selectable from :<br>10-60kVA:1~20%* UPS capacity<br>80-200kVA:1~15%* UPS capacity)                                                                                                                                                 |

Note: The default battery number is 40. When the actual battery in use is 30-50, ensure the actual number and the set number is the same, otherwise, batteries may be damaged. To set the number of battery packs, please contact the manufacturer's customer service phone.

## 7.4.3 Electrical Characteristics (Inverter Output)

Table7-6 Inverter Output (To critical load)

| Items            | Unit | Parameters                                                              |
|------------------|------|-------------------------------------------------------------------------|
| Rated AC voltage | Vac  | 380/400/415 (Three-phase four-line, with the bypass common middle line) |
| Rated Frequency  | Hz   | 50/60                                                                   |

| Items                                            | Unit | Parameters                                                                                                        |
|--------------------------------------------------|------|-------------------------------------------------------------------------------------------------------------------|
| Frequency Regulation                             | Hz   | 50/60Hz±0.1%                                                                                                      |
| Voltage precision                                | %    | ±1(0-100% Linear load)                                                                                            |
| Overload                                         | %    | 110%, 60min;<br>125%, 10min;<br>150%, 1min;<br>>150%, 200ms                                                       |
| Synchronized Range                               | Hz   | Settable, ±0.5Hz ~±5Hz, default ±3Hz                                                                              |
| Synchronized Slew Rate                           | Hz   | Settable, 0.5Hz/S ~ 3Hz/S, default 0.5Hz/S                                                                        |
| Output Power Factor                              |      | 1                                                                                                                 |
| Output Voltage THDu                              |      | <1% ,0-100%,linear load;<5% ,non-linear load(10-60kVA)<br><1% ,0-100%,linear load;<3% ,non-linear load(80-100kVA) |
| Output short circuit current (I <sub>rms</sub> ) | A    | 2.5 times rated current                                                                                           |
| Output short circuit (I <sub>peak</sub> )        | A    | 3 times rated current                                                                                             |

#### 7.4.4 Electrical Characteristics (Bypass Mains Input)

Table 7-7 Bypass Mains Input

| Item                                      | Unit | Value                                                                      |
|-------------------------------------------|------|----------------------------------------------------------------------------|
| Rated AC voltage                          | Vac  | 380/400/415<br>(three-phase four-wire and sharing neutral with the bypass) |
| Rated current                             | A    | 15-304                                                                     |
| Current rating of neutral cable           | A    | 1.7×I <sub>n</sub>                                                         |
| Frequency                                 | Hz   | 50/60                                                                      |
| Switch time (between bypass and inverter) | ms   | Synchronized transfer: 0ms                                                 |

|                        |    |                                                                                                   |
|------------------------|----|---------------------------------------------------------------------------------------------------|
| Bypass voltage range   | %  | Settable: Upper limit: +10, +15, +20, default +15<br>Lower limit: -10, -15, -30, -40, default -20 |
| Bypass frequency range | %  | Settable, $\pm 1\text{Hz}$ , $\pm 3\text{Hz}$ , $\pm 5\text{Hz}$                                  |
| Synchronized Range     | Hz | Default: $\pm 2\text{Hz}$ (Settable: $\pm 0.5\text{Hz} \sim \pm 5\text{Hz}$ )                     |

## 7.5 Efficiency

Table7-8 Efficiency

| Items        | Unit | Parameters                                  |
|--------------|------|---------------------------------------------|
| Normal mode  | %    | Up to 96%(10-60kVA)<br>Up to 97%(80-200kVA) |
| ECO mode     | %    | >99%                                        |
| Battery mode | %    | Up to 96%                                   |

## 7.6 Display and Interface

The system display and interface are shown in the following table 7.9

Table7-9 System display and interface

|           |                                                                    |
|-----------|--------------------------------------------------------------------|
| Display   | LCD                                                                |
| Interface | Standard: RS232, RS485, Dry Contact, USB<br>Option: SNMP, Parallel |



## Annex. A Installation of internal batteries


For 10-40kVA UPS, 120 pieces of 9AH batteries can be installed.

For 60kVA UPS, 160 pieces of 9AH batteries can be installed.


For 100kVA UPS, 200 pieces of 9AH batteries can be installed.

Each groups have 4 battery strings. The interconnection among groups is via cable with Anderson Socket.


1. Connect the all-battery strings internal cables as shown below.

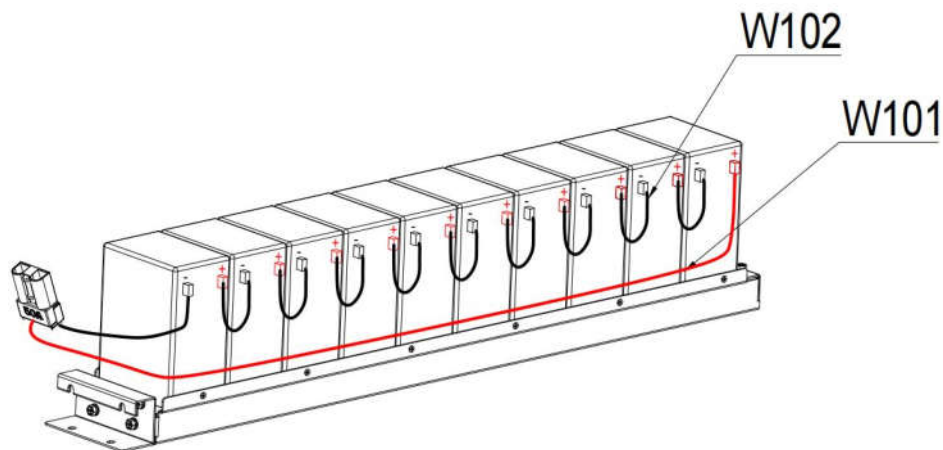

2. All battery packs are connected the same, shown as a set of battery packs, 4 battery strings. Connect the battery pack according to the schematic diagram.

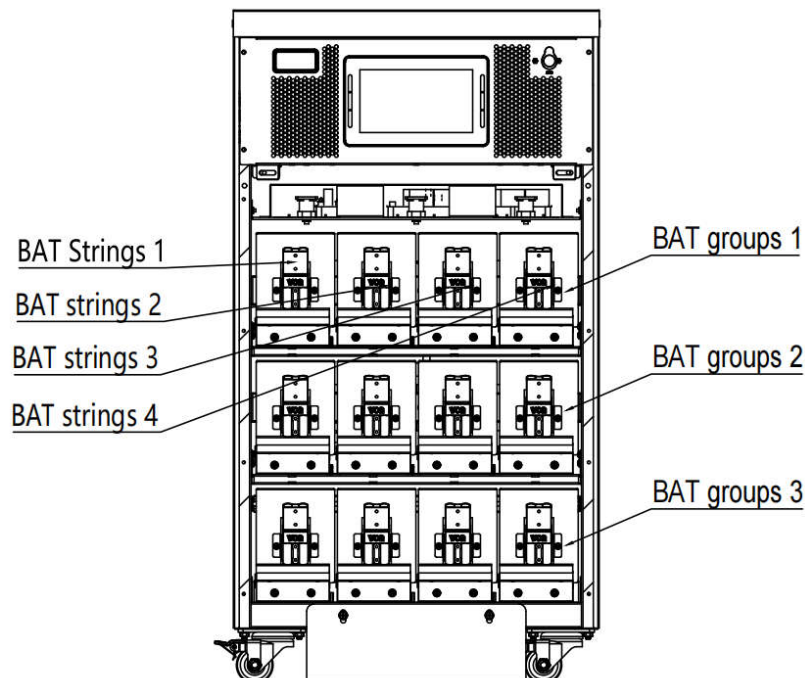

3. Connect the positive and negative cables of the battery pack and the N cables to the busbar.

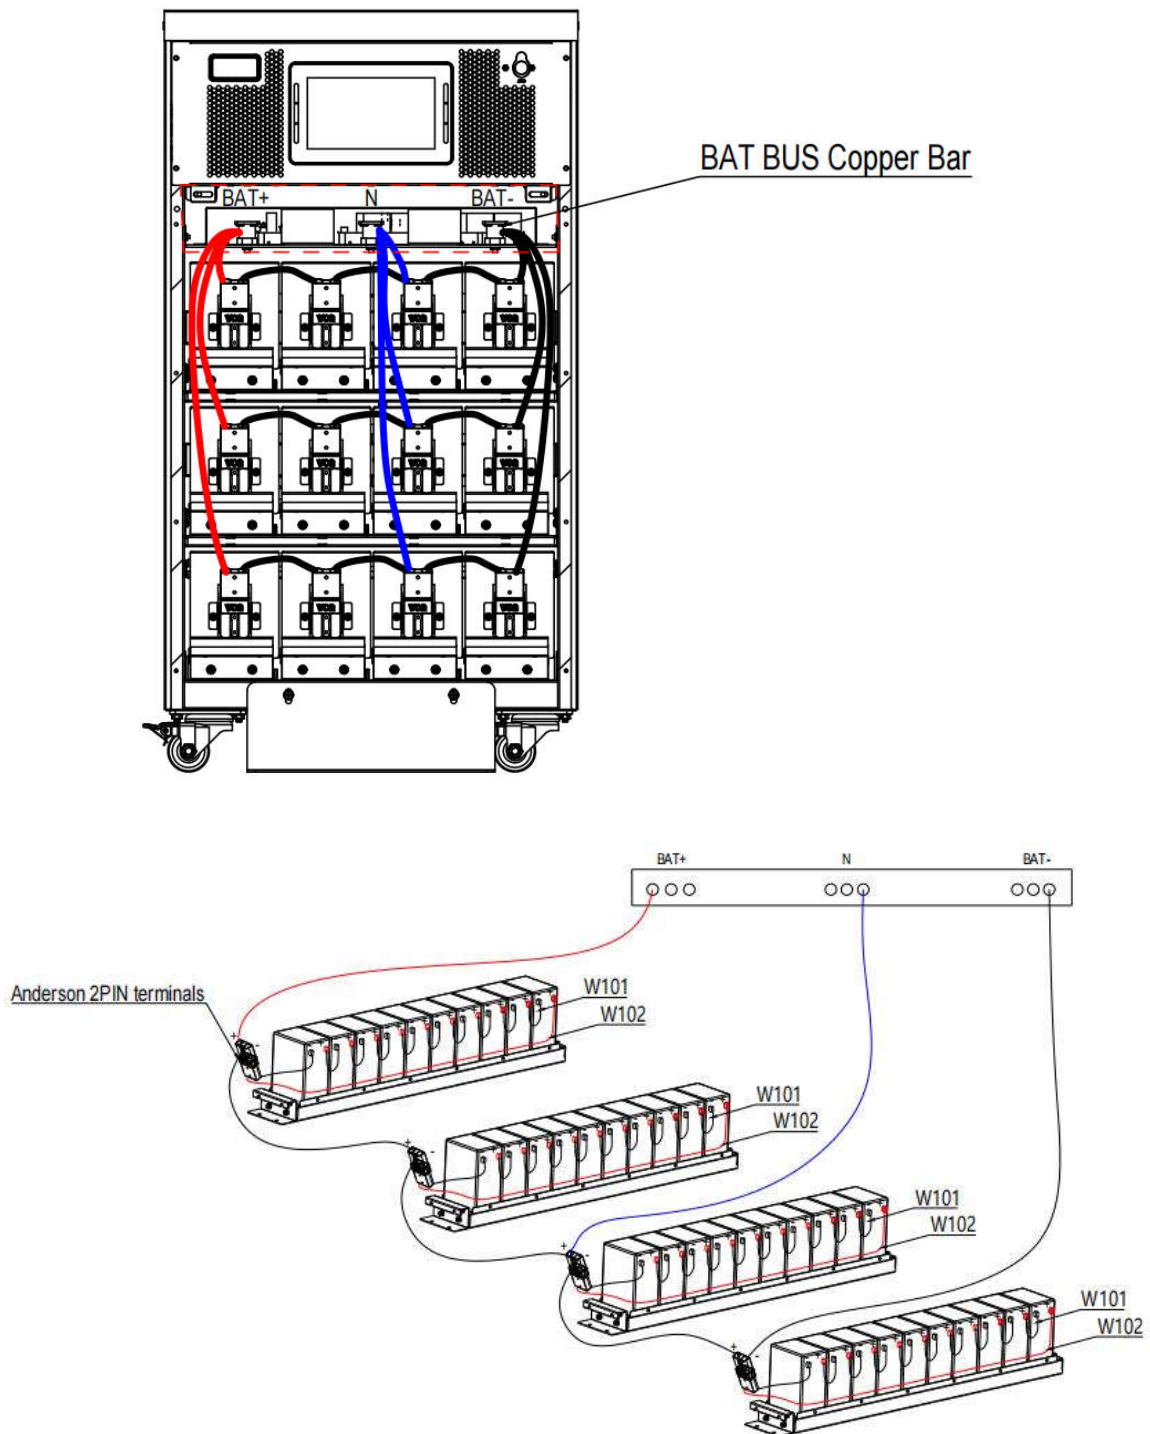

## **WARNING**

Make sure the polarity of the battery is correct according to the diagrams above.  
Test and confirm the battery voltage before connecting to the main circuit.