



PsV nAb response by variant in Phase 1
Post-2nd dose of mRNA-1273

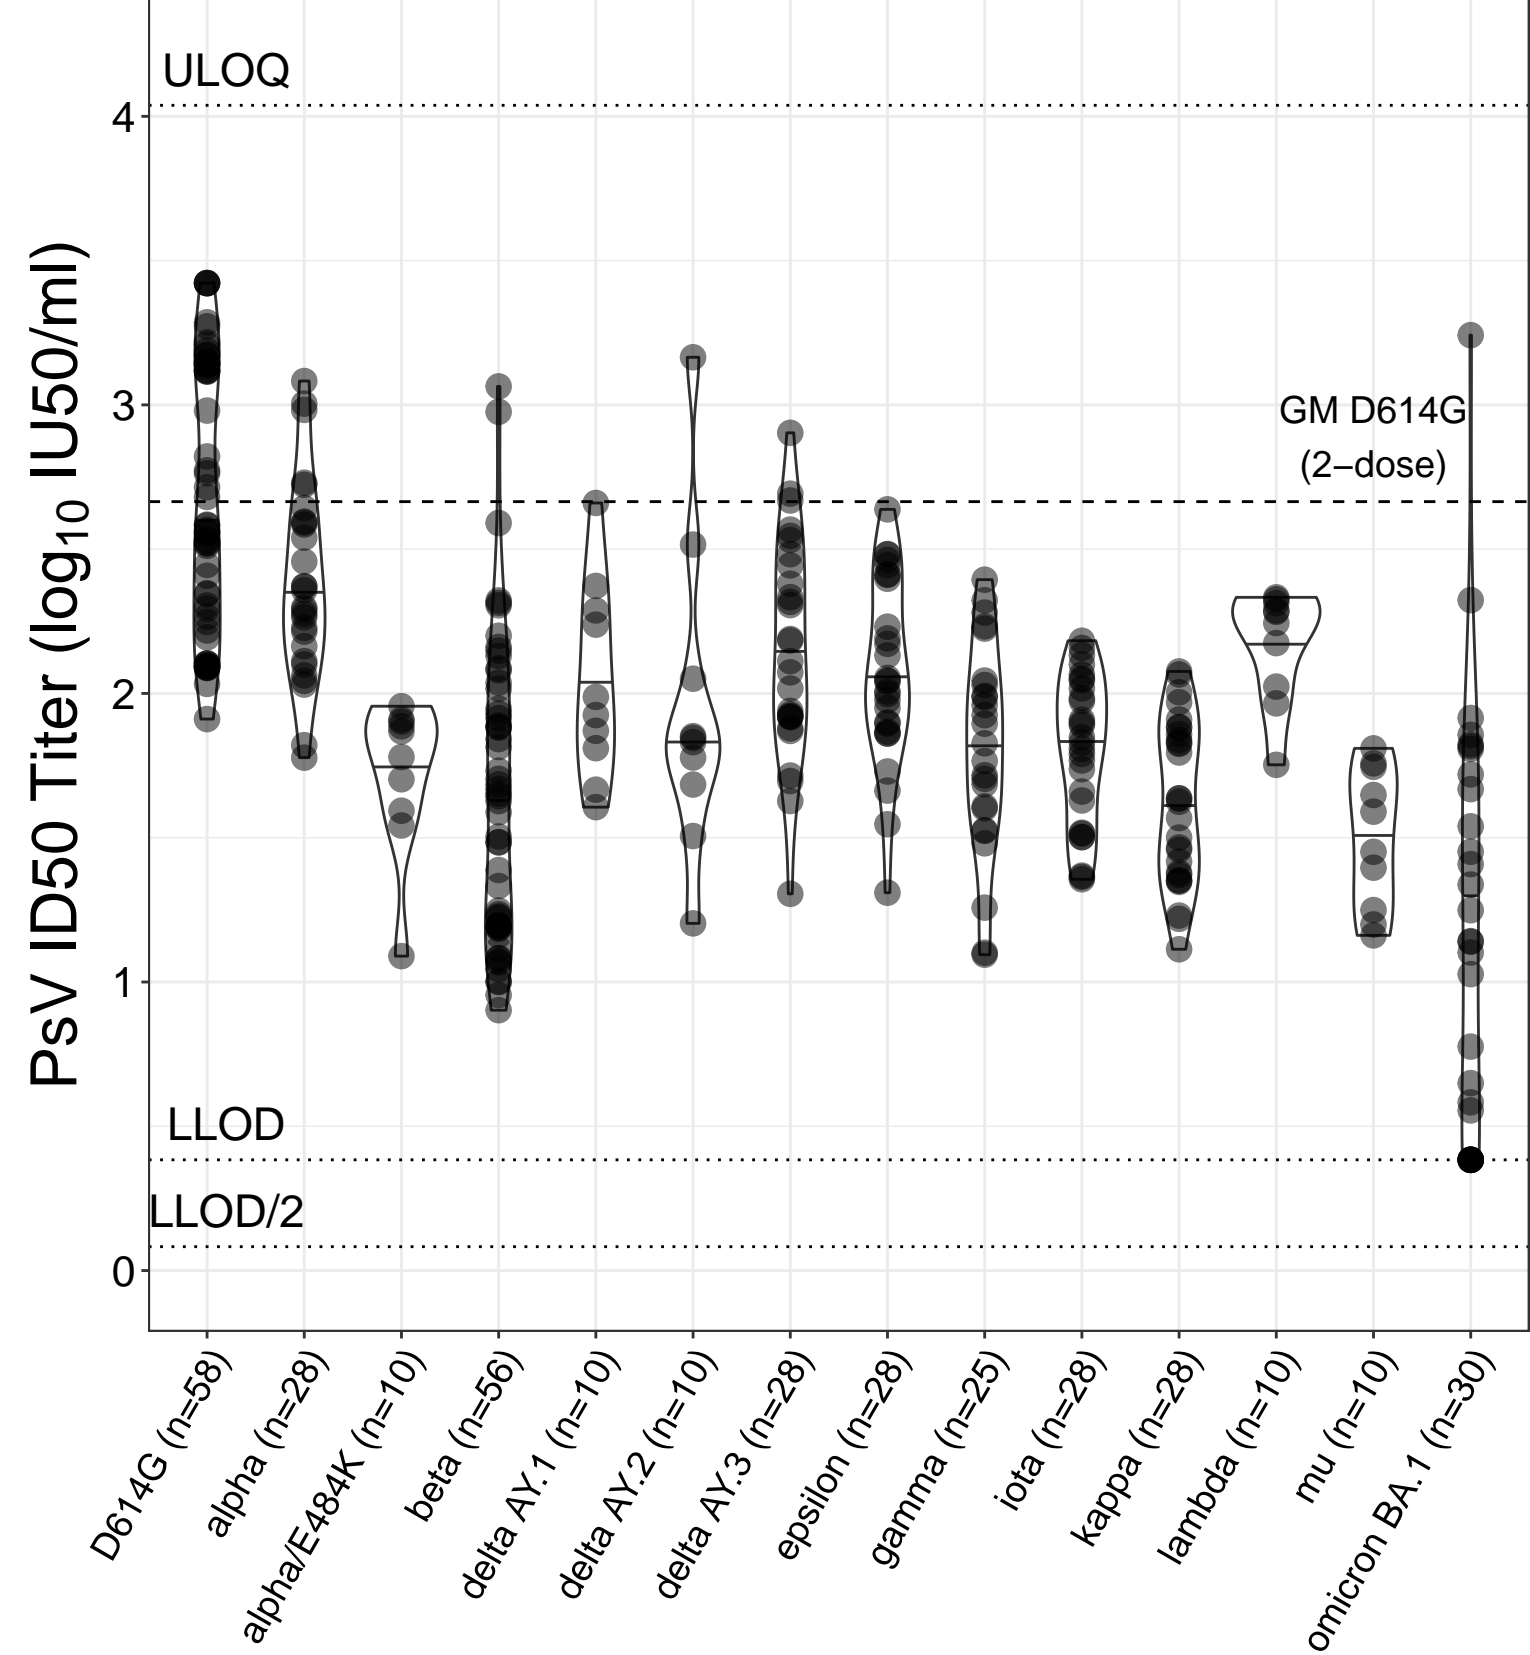

Post-3rd dose of mRNA-1273

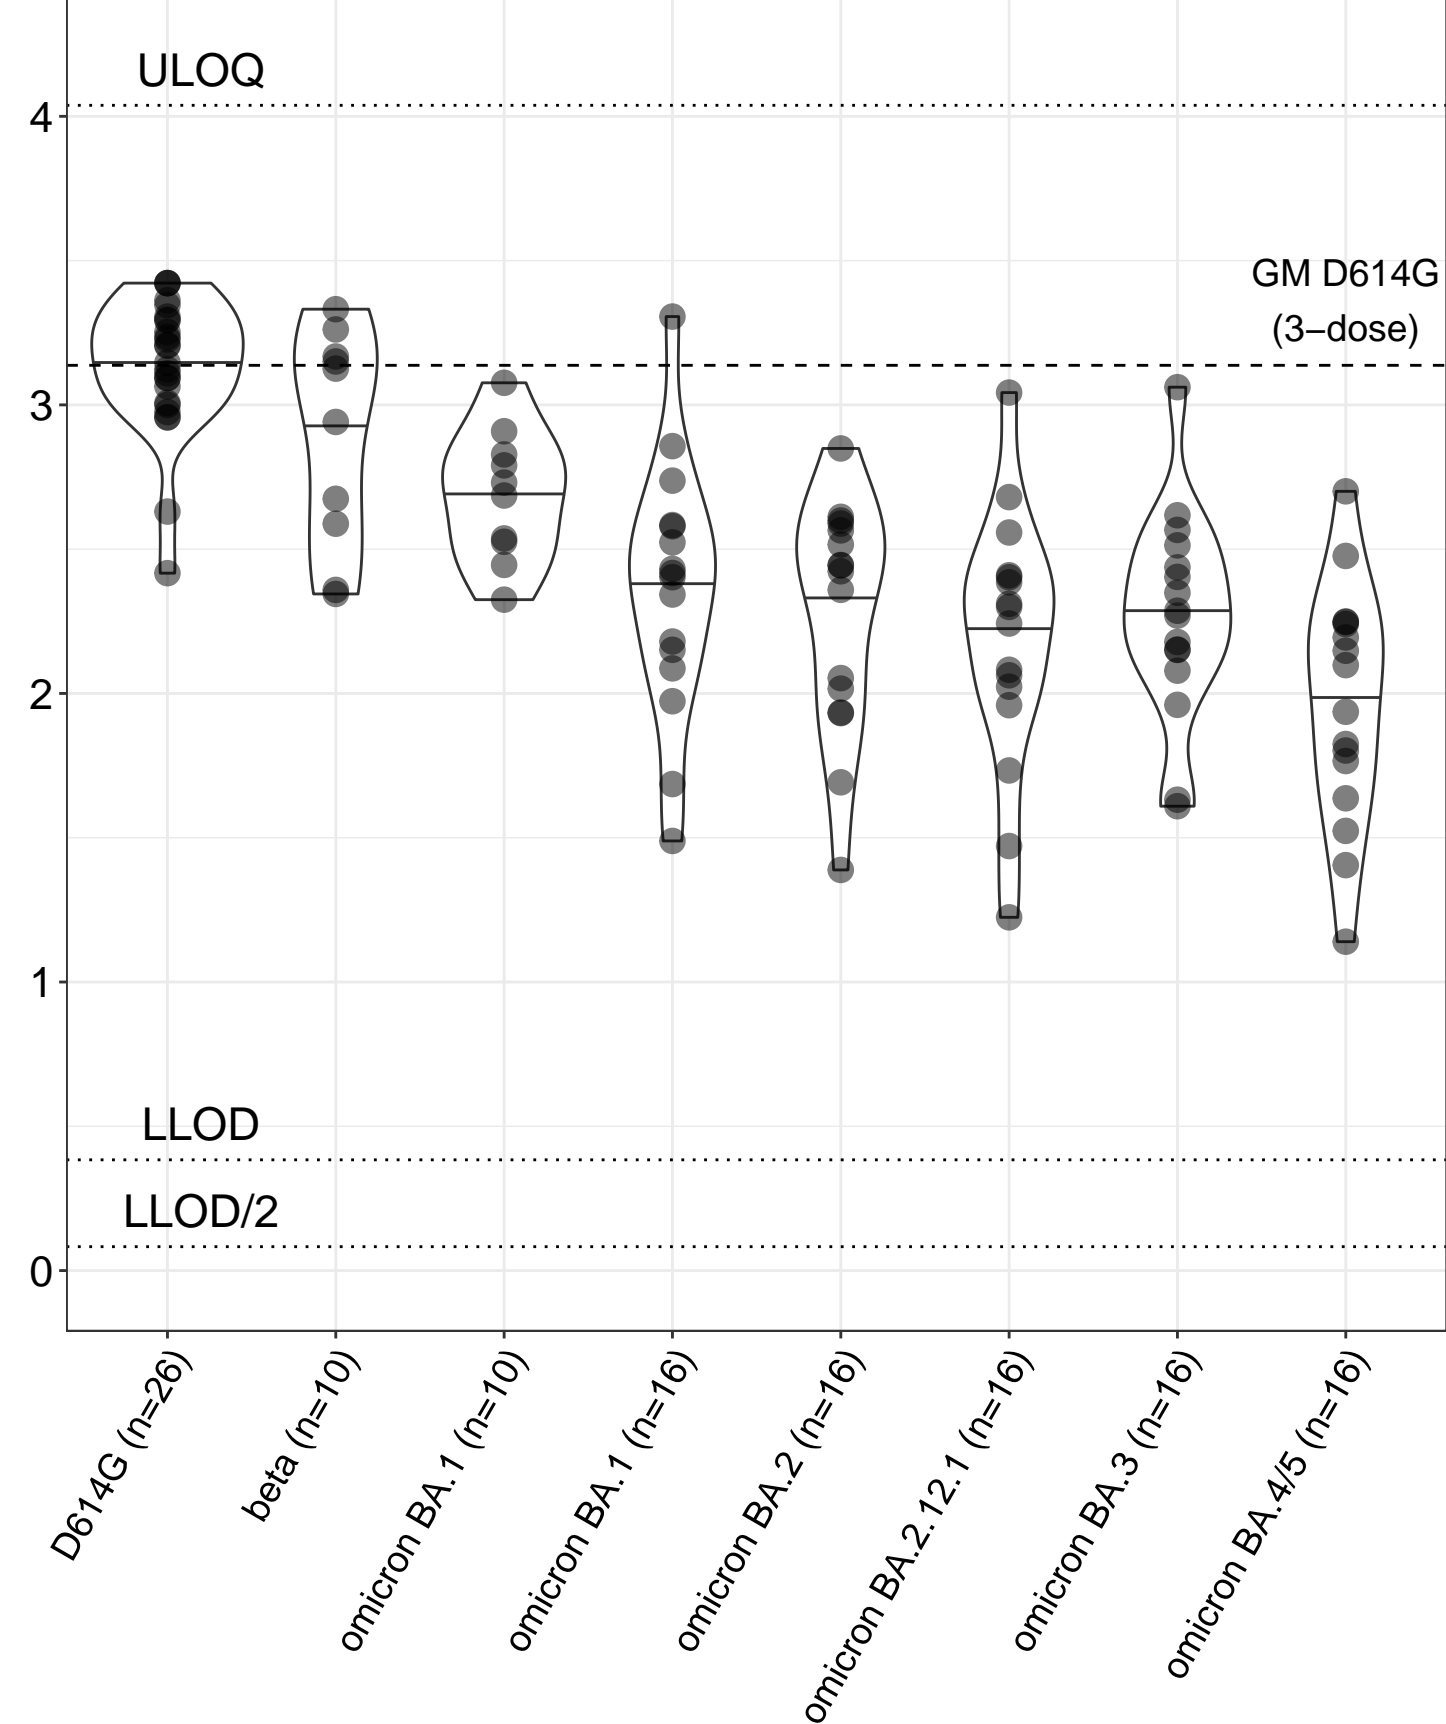

Variant and sublineage (sample size)

Units (IU50/ml) were defined by calibrating D614G ID50 titers to the WHO International Standard, which amounted to multiplying original ID50 values by 0.242. ID50 to other strains were not calibrated to an international standard: original ID50 values were multiplied by 0.242 also to maximize comparability of readouts across variant strains.