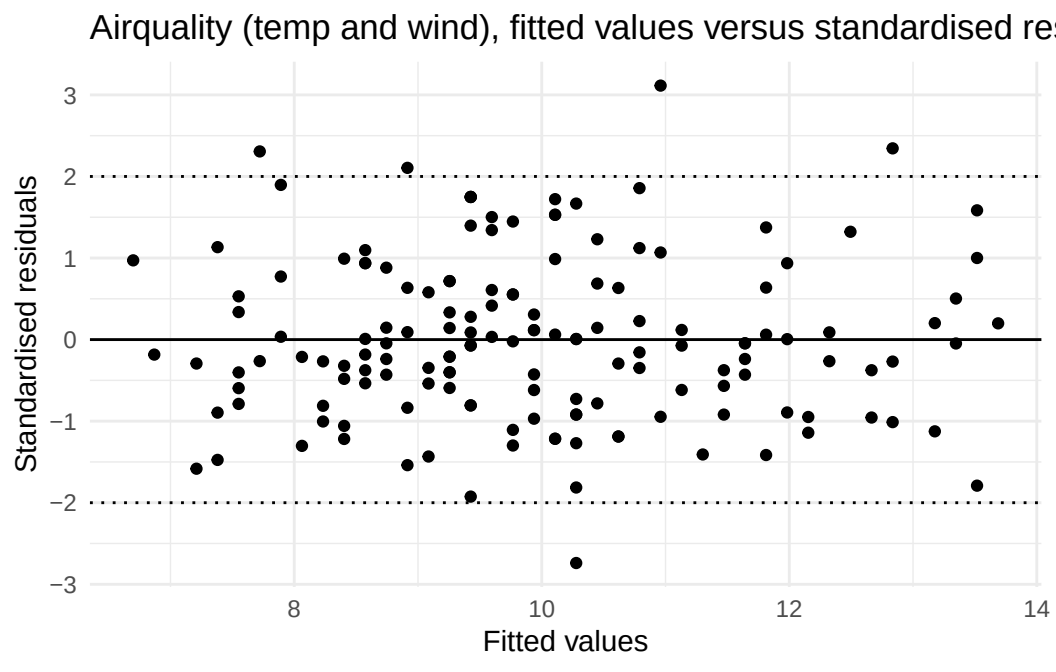
Airquality (temp and wind), fitted values versus standardised res
Standardised residuals
3
2
1
0
−1
−2
−3
8
10
12
14
Fitted values