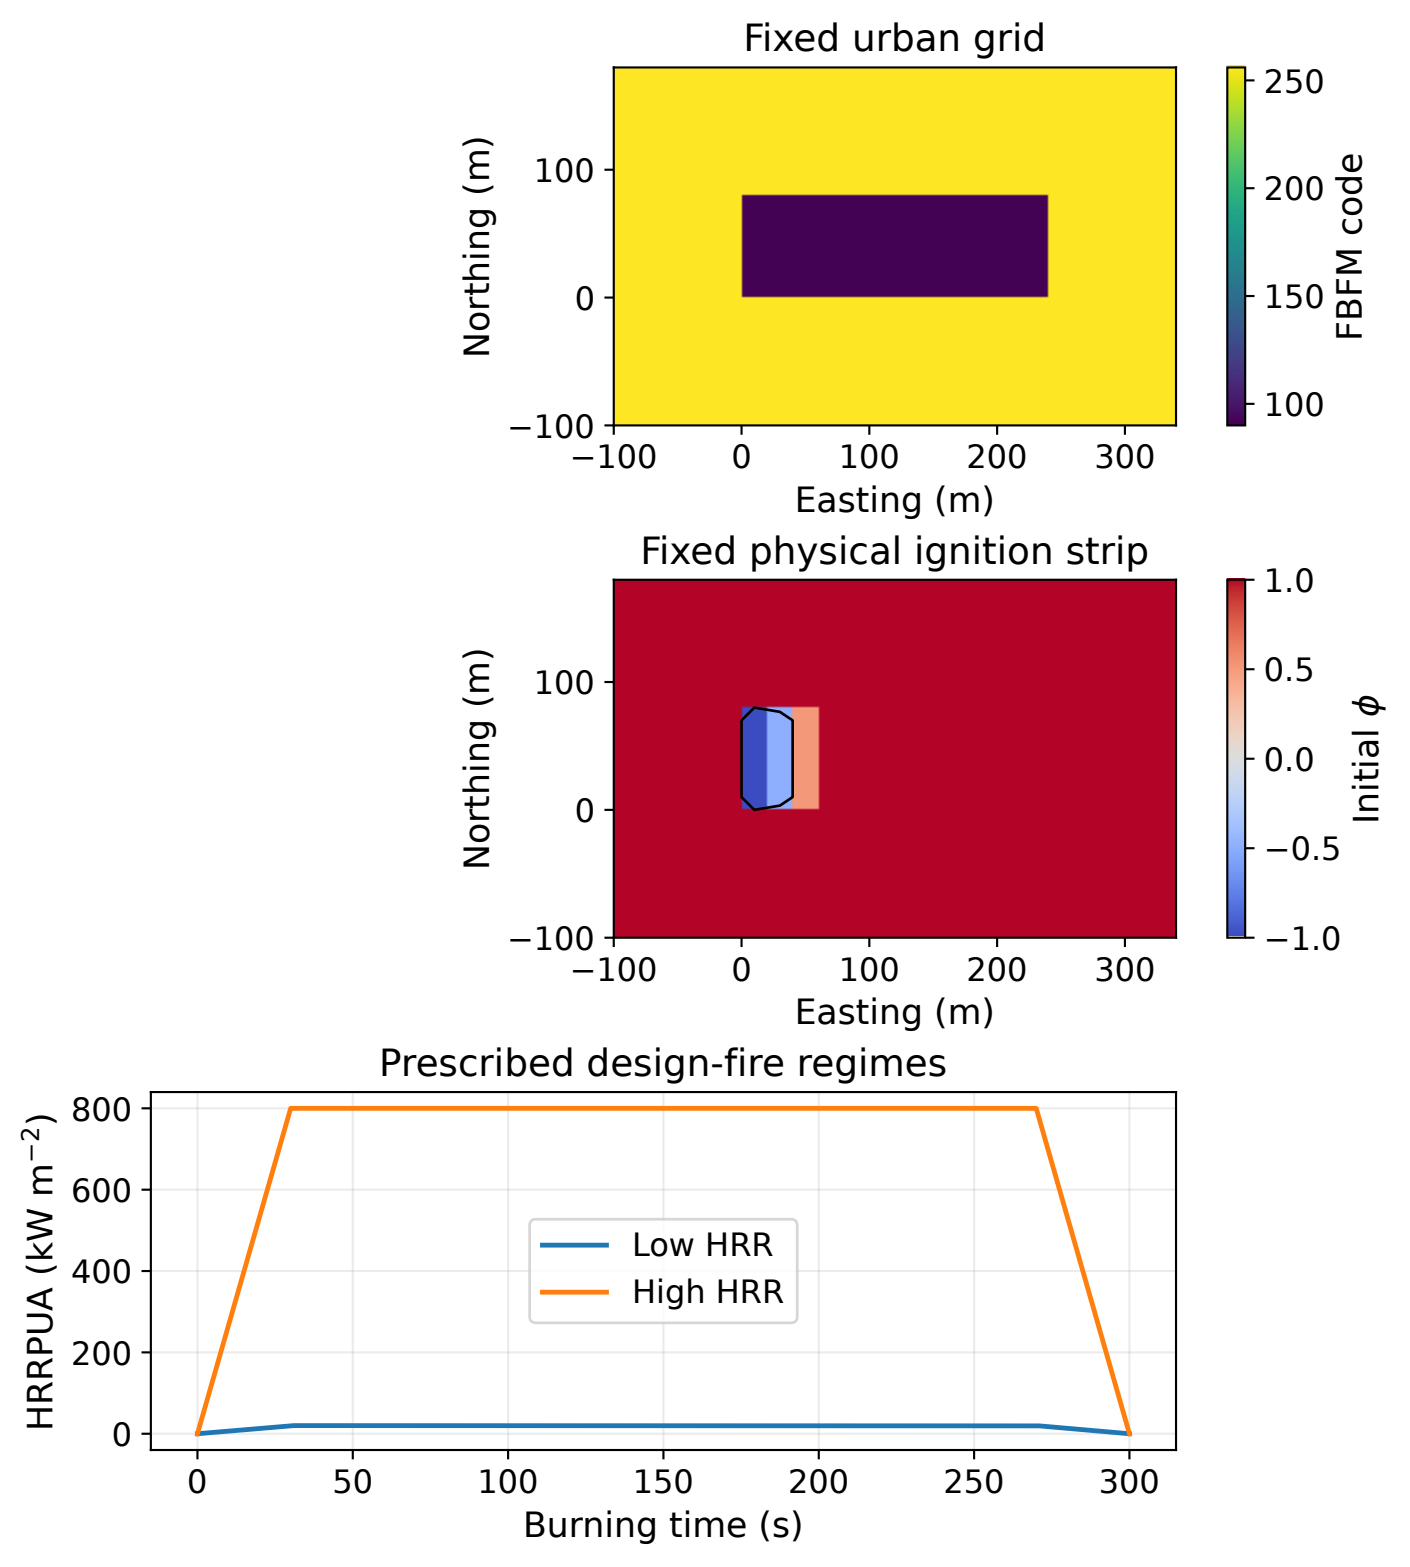
Fixed urban grid
Northing (m)
Easting (m)
FBFM code
250
200
150
100
Fixed physical ignition strip
Initial ϕ
1.0
0.5
0.0
−0.5
−1.0
Prescribed design-fire regimes
HRRPUA (kW m^{-2})
Burning time (s)
Low HRR
High HRR