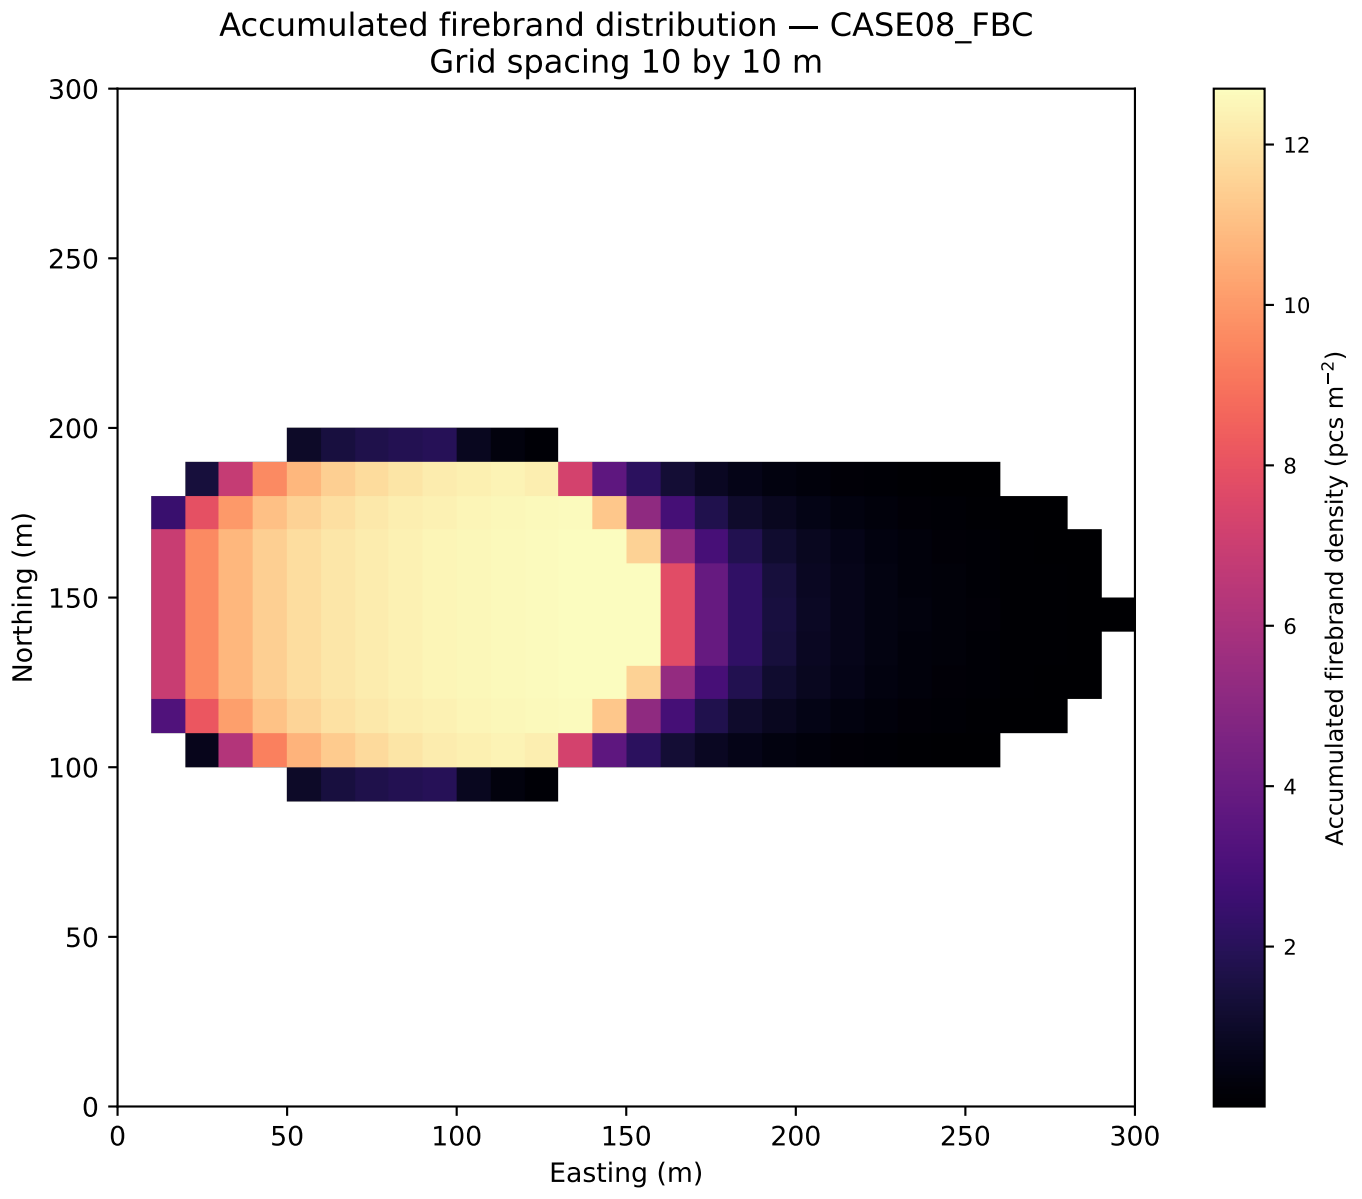
Accumulated firebrand distribution — CASE08_FBC
Grid spacing 10 by 10 m
Northing (m)
Easting (m)
0
50
100
150
200
250
300
Accumulated firebrand density (pcs m^{-2})
2
4
6
8
10
12