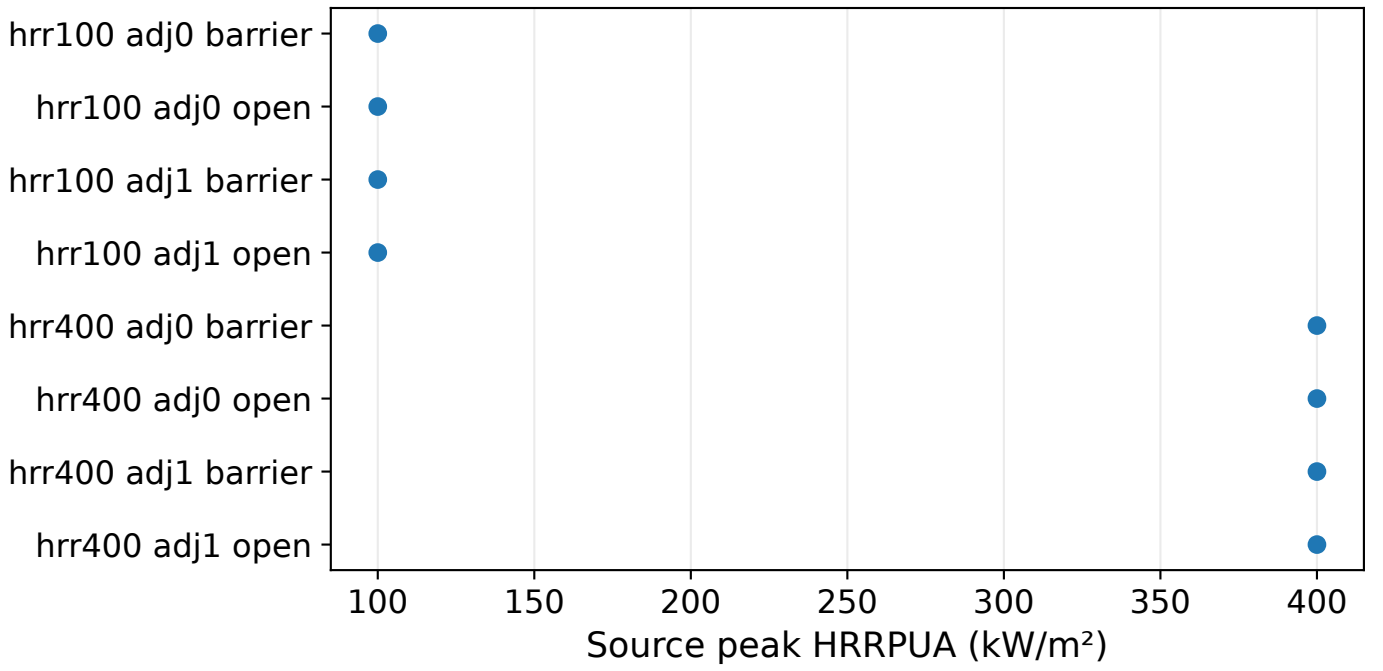
hrr100 adj0 barrier
hrr100 adj0 open
hrr100 adj1 barrier
hrr100 adj1 open
hrr400 adj0 barrier
hrr400 adj0 open
hrr400 adj1 barrier
hrr400 adj1 open
100
150
200
250
300
350
400
Source peak HRRPUA (kW/m²)

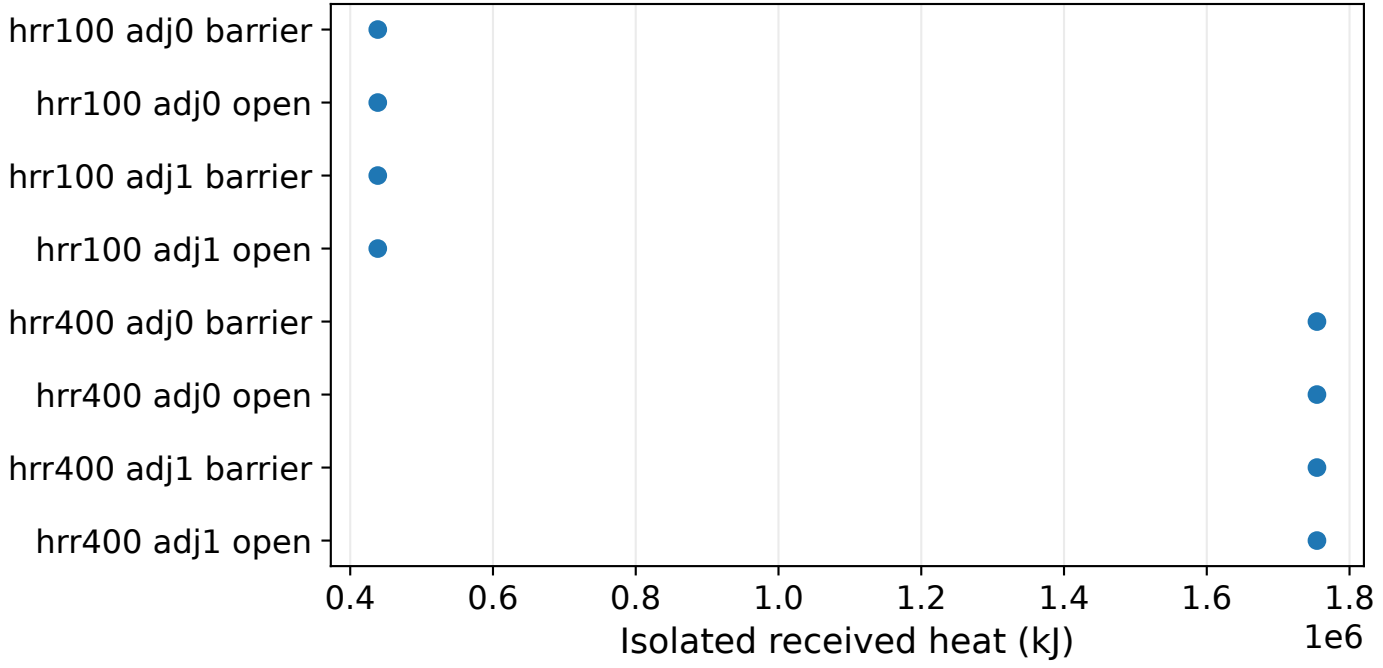
hrr100 adj0 barrier
hrr100 adj0 open
hrr100 adj1 barrier
hrr100 adj1 open
hrr400 adj0 barrier
hrr400 adj0 open
hrr400 adj1 barrier
hrr400 adj1 open
0.4
0.6
0.8
1.0
1.2
1.4
1.6
1.8
1e6
Isolated received heat (kJ)