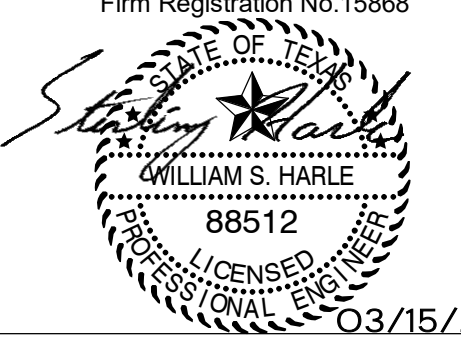


REVISION HISTORY


REVISION	DESCRIPTION	DATE
2	DRB 25	03-15-2024
1	DRB 24	02-25-2024

PROFESSIONAL SEALS  
Page Southernland Page, Inc.  
Firm Registration No. 159588  


MECHANICAL HVAC - FLOOR PLAN -  
CEILING INTERSTITIAL LEVEL - SECTOR E

DRAWN BY  
CC  
PROJECT NUMBER  
322015  
ORIGINAL ISSUE  
IFC COMPLETION PKG

CHECKED BY  
WSH  
PROJECT ABBREVIATION  
GWA-BLDG-A-P1  
DATE  
15 SEP 2023

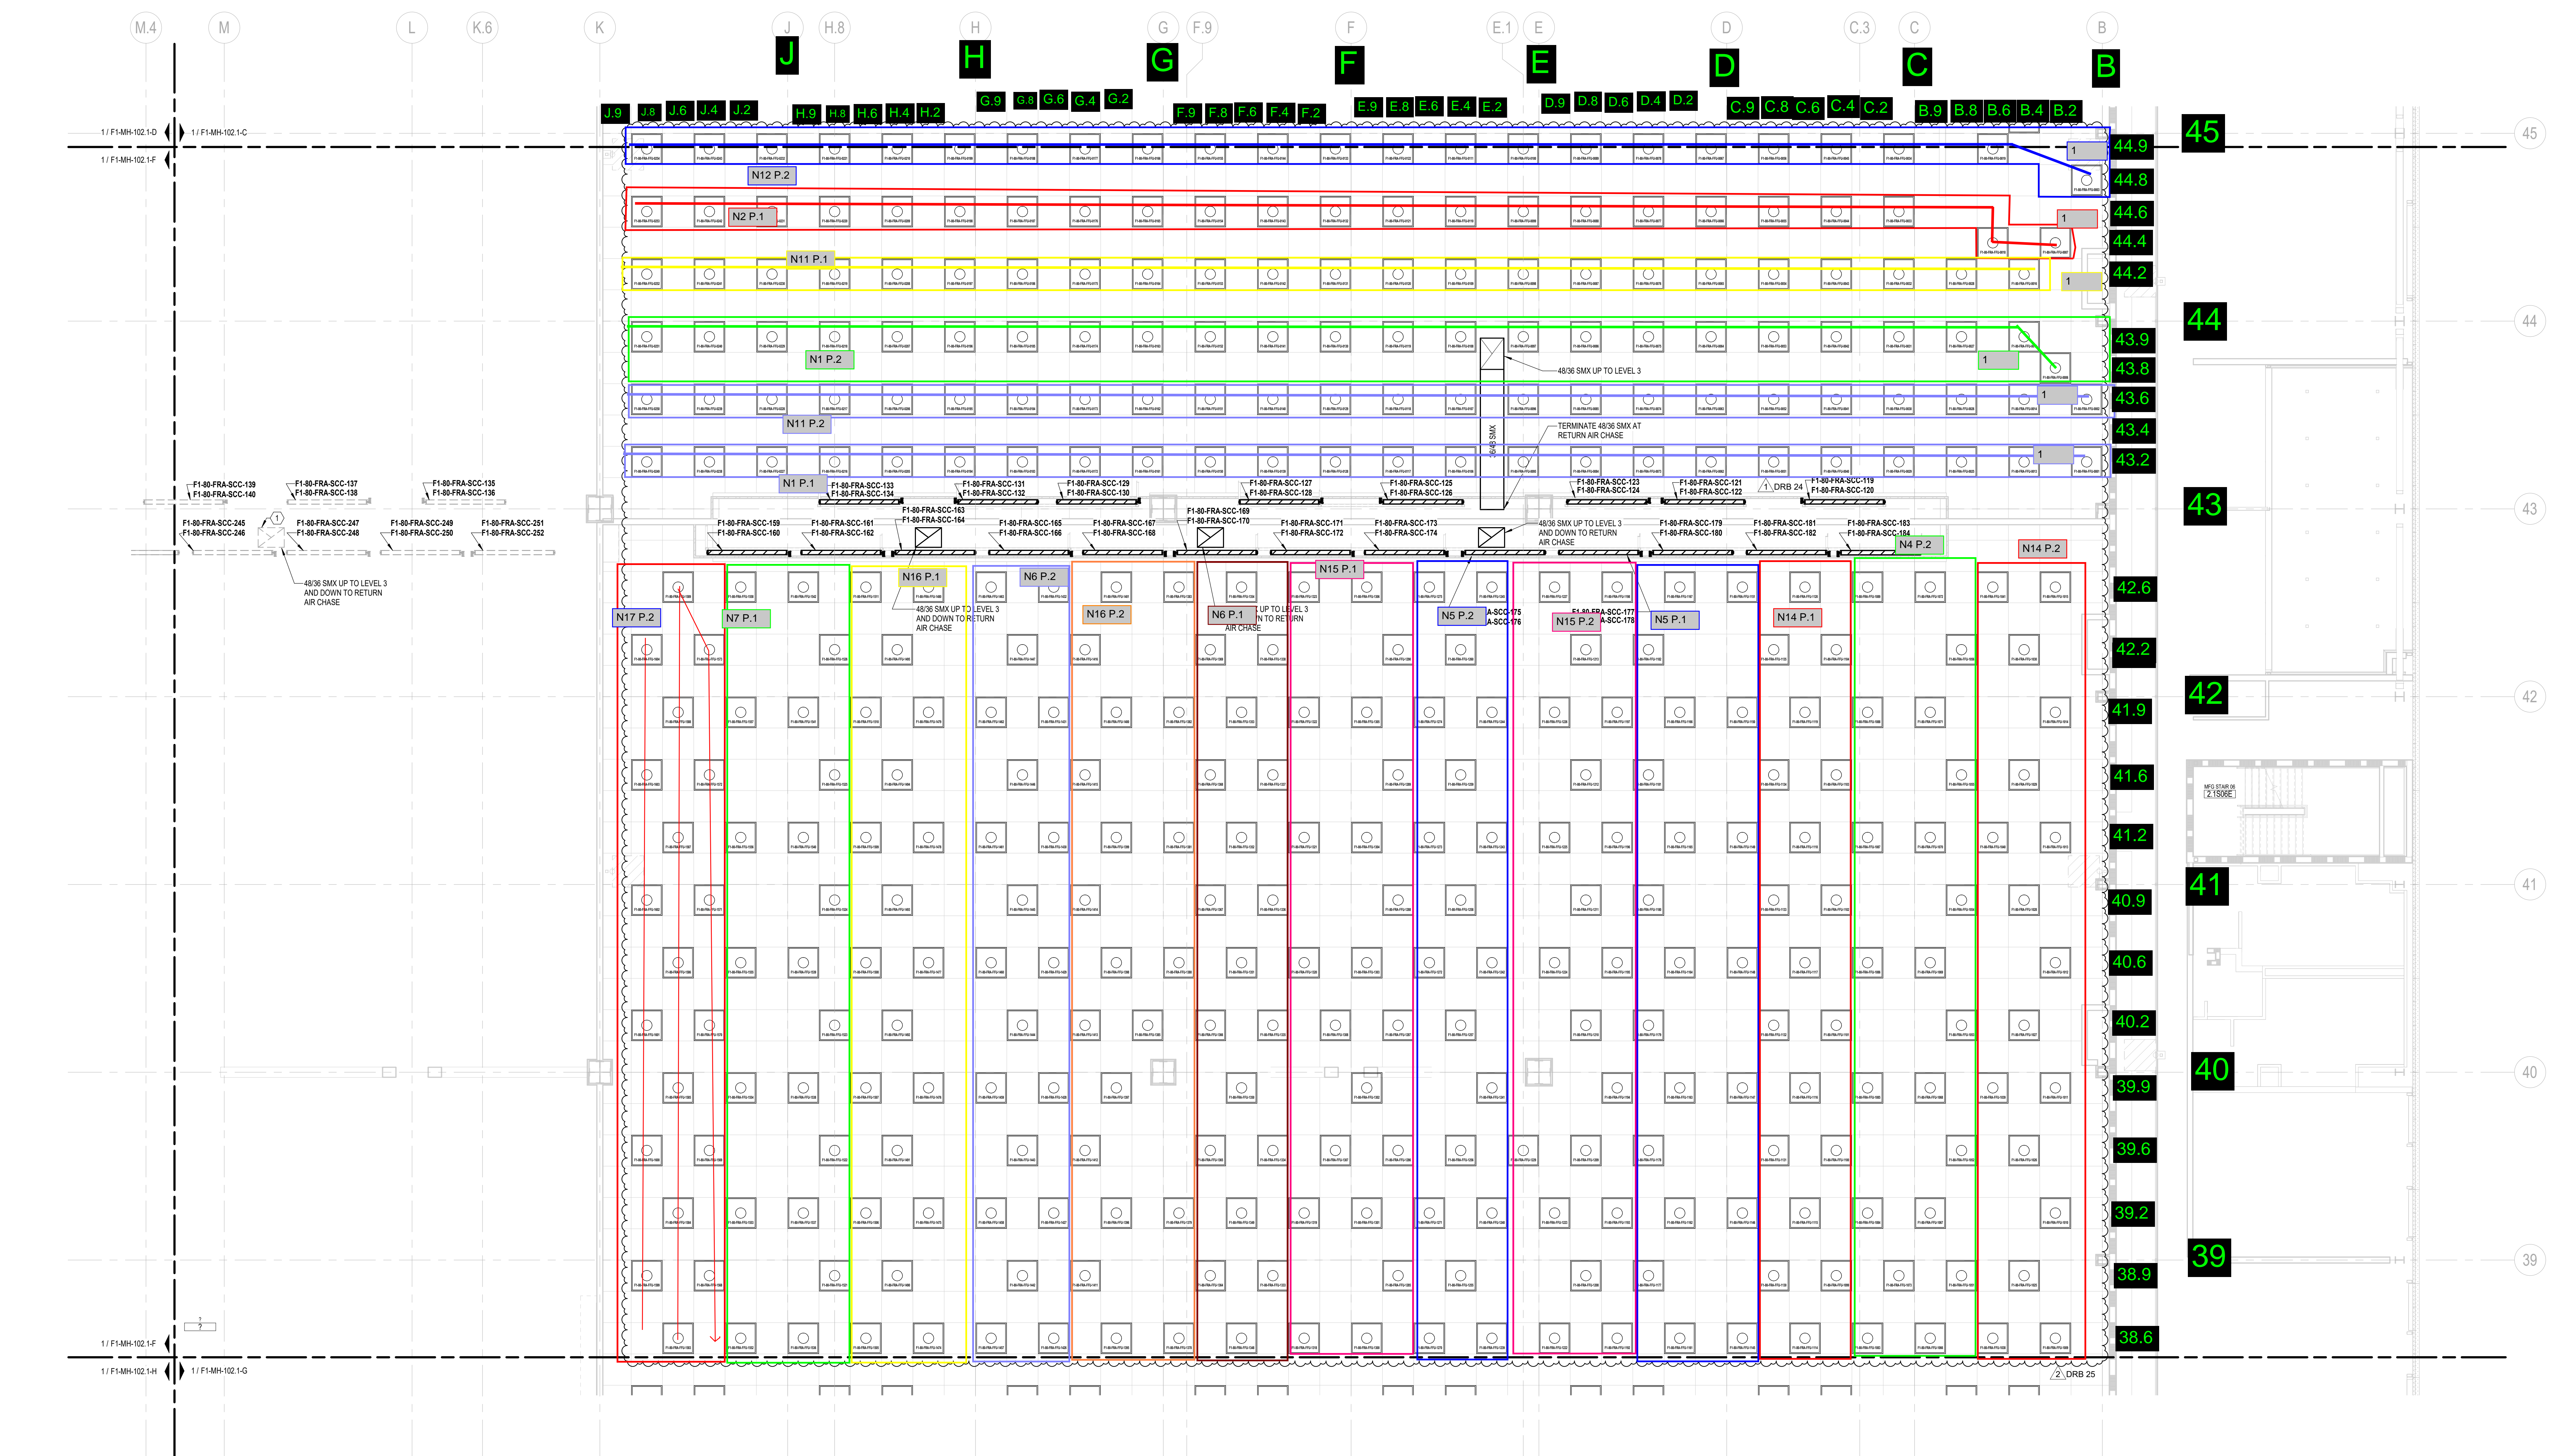

1 MECHANICAL HVAC - FLOOR PLAN - CEILING INTERSTITIAL LEVEL - SECTOR E  
SCALE: 1/8" = 1'-0"

FLOOR PLAN GENERAL NOTES

- REFER TO DRAWING F1-M-001 FOR HVAC LEGENDS, ABBREVIATIONS, AND GENERAL NOTES.
- COORDINATE WORK ON THIS SHEET WITH ALL TRADES. WORK SHOWN ON THIS SHEET IS INTENDED TO PROVIDE THE OVERALL ENGINEERING DESIGN CONCEPT AND DOES NOT PROVIDE FOR RELOCATIONS, OFFSETS, ETC., THAT ARE REQUIRED BY THE COORDINATION OF TRADES. THESE SHALL BE PROVIDED BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.
- COORDINATE THE EXACT LOCATION OF ALL GRILLES, REGISTERS, AND DIFFUSERS WITH THE ARCHITECTURAL REFLECTED CEILING PLAN.
- ALL THERMOSTATS UNLESS OTHERWISE NOTED SHALL BE LOCATED 48" A.F.F. AND ADJACENT TO THE LIGHT SWITCH WHERE SUCH SITUATIONS OCCUR. COORDINATE EXACT LOCATION WITH THE ELECTRICAL CONTRACTOR AND ARCHITECT.
- ALL DUCT RUNOUTS TO INDIVIDUAL DIFFUSERS, GRILLES, AND REGISTERS SHALL BE THE SAME AS THE DIFFUSER, GRILLE, REGISTER NECK SIZE UNLESS NOTED OTHERWISE.
- PROVIDE BALANCE DAMPERS IN SUPPLY, RETURN, AND EXHAUST DUCTS AT ALL TAKE-OFFS TO INDIVIDUAL DIFFUSERS, GRILLES, AND REGISTERS.
- ALL CONDENSATE PIPING (CONDWT & CONDTR) SHALL BE SLOPED AT 1% UNLESS NOTED OTHERWISE.

KEYED NOTES

NUMBER	DESCRIPTION
1	FUTURE SMX DUCTWORK SERVING PHASE 2 SHOWN FOR SPACE MANAGEMENT PURPOSES.

KEY PLAN (NOT TO SCALE)

