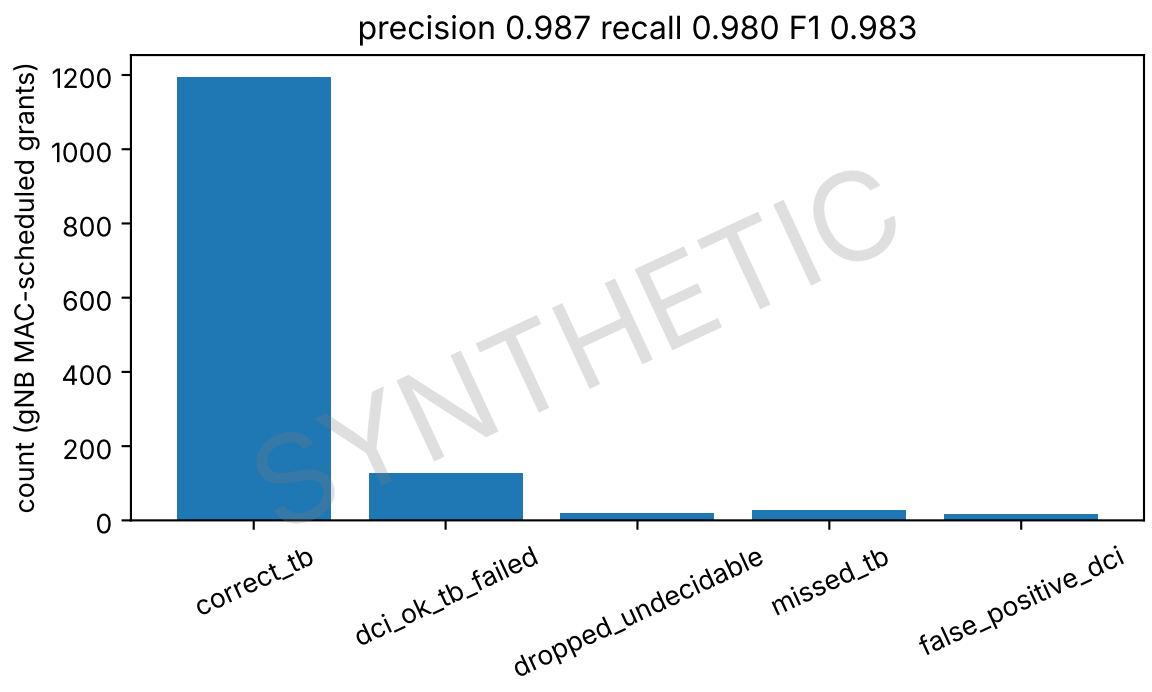
precision 0.987 recall 0.980 F1 0.983
count (gNB MAC-scheduled grants)
0
200
400
600
800
1000
1200
SYNTHETIC
correct_tb
dci_ok_tb_failed
dropped_undecidable
missed_tb
false_positive_dci