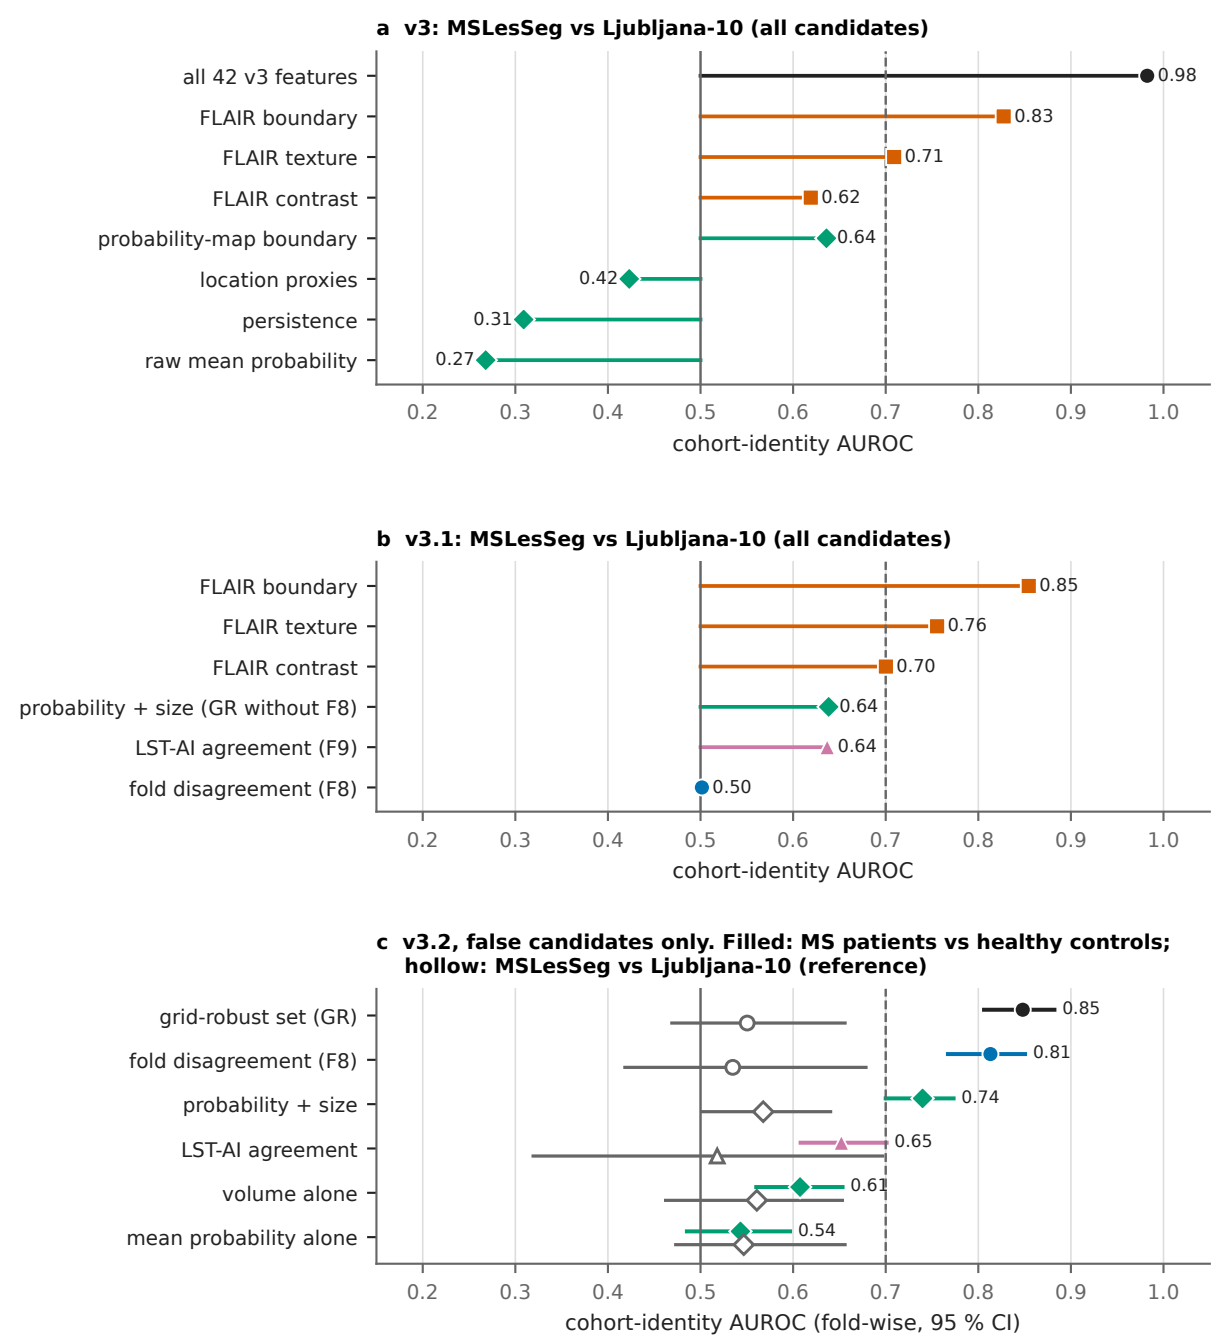

0.5 = cohort not recognisable; dashed 0.70 = v3.2 pre-registered reading threshold (reference only in a-b). Pooled out-of-fold values (a-b) are biased downward for weak signals (v3 D4, v3.2 D1), so values near or below 0.5 understate separability; panel c is fold-wise.